



March 25, 2024

North Kansas City School District
2000 Northeast 46th Street
Kansas City, Missouri 64116

Project: Limited Lead in Drinking Water Testing
Address: 825 Northeast 79th Terrace, Kansas City, Missouri 64118

On December 26, 2023, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 78 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of "lead free" to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of "lead free" as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: <https://www.epa.gov/dwreginfo/lead-and-copper-rule>

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.

Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school's buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in **red text**.

December 26, 2023 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
825-1-FD	Oak Park High School -Outside W206-Far Left	Drinking Fountain	First Draw	<0.4
825-2-FD	Oak Park High School -Outside W206-Left Middle	Drinking Fountain	First Draw	0.4
825-3-FD	Oak Park High School -Outside W206-Right Middle	Drinking Fountain	First Draw	0.4
825-4-FD	Oak Park High School -Outside W206-Far Right	Drinking Fountain	First Draw	0.5
825-5-FD	Oak Park High School -Outside E238-Far Left	Drinking Fountain	First Draw	<0.4
825-6-FD	Oak Park High School -Outside E238-Left Middle	Drinking Fountain	First Draw	<0.4
825-7-FD	Oak Park High School -Outside E238-Right Middle	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
825-8-FD	Oak Park High School - Outside E238-Far Right	Drinking Fountain	First Draw	<0.4
825-9-FD	Oak Park High School - S250	Sink Tap	First Draw	2.7
825-10-FD	Oak Park High School - Outside S250-Far Left	Drinking Fountain	First Draw	0.5
825-11-FD	Oak Park High School - Outside S250-Left Middle	Drinking Fountain	First Draw	0.4
825-12-FD	Oak Park High School - Outside S250-Right Middle	Drinking Fountain	First Draw	0.7
825-13-FD	Oak Park High School - Outside S250-Far Right	Drinking Fountain	First Draw	0.9
825-14-FD	Oak Park High School - Outside C294-Far Left	Drinking Fountain	First Draw	1
825-15-FD	Oak Park High School - Outside C294-Left Middle	Drinking Fountain	First Draw	1.8
825-16-FD	Oak Park High School - Outside C294-Right Middle	Drinking Fountain	First Draw	0.5
825-17-FD	Oak Park High School - Outside C294-Far Right	Drinking Fountain	First Draw	0.7
825-18-FD	Oak Park High School - LMC	Drinking Fountain	First Draw	<0.4
825-19-FD	Oak Park High School - F113-West Sink	Sink Tap	First Draw	<0.4
825-20-FD	Oak Park High School - F113-North Middle Sink	Sink Tap	First Draw	<0.4
825-21-FD	Oak Park High School - F113-Northeast Sink	Sink Tap	First Draw	<0.4
825-22-FD	Oak Park High School - F113-South Sink	Sink Tap	First Draw	<0.4
825-23-FD	Oak Park High School - F113-Three Bay Sink	Sink Tap	First Draw	<0.4
825-24-FD	Oak Park High School - F113-Handwashing Sink	Sink Tap	First Draw	<0.4
825-25-FD	Oak Park High School - F113-Southwest Sink	Sink Tap	First Draw	<0.4
825-26-FD	Oak Park High School - Outside F109-Left	Drinking Fountain	First Draw	0.6
825-27-FD	Oak Park High School - Outside F109-Right	Drinking Fountain	First Draw	0.7
825-28-FD	Oak Park High School - Outside N150-Left	Drinking Fountain	First Draw	<0.4
825-29-FD	Oak Park High School - Outside N150-Right	Drinking Fountain	First Draw	<0.4
825-30-FD	Oak Park High School - C142	Sink Tap	First Draw	1.1
825-31-FD	Oak Park High School - N150	Sink Tap	First Draw	3.2
825-32-FD	Oak Park High School - N155	Sink Tap	First Draw	8.4
825-33-FD	Oak Park High School - N153	Sink Tap	First Draw	3.8

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
825-34-FD	Oak Park High School - Outside C125-Far Left	Drinking Fountain	First Draw	0.9
825-35-FD	Oak Park High School - Outside C125-Left Middle	Drinking Fountain	First Draw	0.5
825-36-FD	Oak Park High School - Outside C125-Right Middle	Drinking Fountain	First Draw	0.4
825-37-FD	Oak Park High School - Outside C125-Far Right	Drinking Fountain	First Draw	0.4
825-38-FD	Oak Park High School - C125	Sink Tap	First Draw	3.5
825-39-FD	Oak Park High School - C124	Sink Tap	First Draw	9.2
825-40-FD	Oak Park High School - C121	Bubbler	First Draw	3.1
825-41-FD	Oak Park High School - C121-Left Sink-Middle	Sink Tap	First Draw	3.7
825-42-FD	Oak Park High School - C121-Right Sink-Far Left	Sink Tap	First Draw	1.1
825-43-FD	Oak Park High School - C121-Right Sink-Middle	Sink Tap	First Draw	0.6
825-44-FD	Oak Park High School - C121-Right Sink-Far Right	Sink Tap	First Draw	1.7
825-45-FD	Oak Park High School - Outside Training Room-Left	Drinking Fountain	First Draw	<0.4
825-46-FD	Oak Park High School - Outside Training Room-Right	Drinking Fountain	First Draw	<0.4
825-47-FD	Oak Park High School - Training Room	Sink Tap	First Draw	0.6
825-48-FD	Oak Park High School - Training Room	Ice Machine	First Draw	<0.4
825-49-FD	Oak Park High School - Kitchen-Southwest Sink	Sink Tap	First Draw	0.5
825-50-FD	Oak Park High School - Kitchen-South Handwashing Sink	Sink Tap	First Draw	0.6
825-51-FD	Oak Park High School - Kitchen-South Middle Sink	Sink Tap	First Draw	2
825-52-FD	Oak Park High School - Kitchen	Steam Kettle	First Draw	1.5
825-53-FD	Oak Park High School - Kitchen-North Middle Sink	Sink Tap	First Draw	0.8
825-54-FD	Oak Park High School - Kitchen-Northeast Wall-Far Right	Sink Tap	First Draw	0.7
825-55-FD	Oak Park High School - Kitchen-Northwest Wall-Right Middle	Sink Tap	First Draw	0.7
825-56-FD	Oak Park High School - Kitchen-Northwest Wall-Left Middle	Sink Tap	First Draw	2.1
825-57-FD	Oak Park High School - Kitchen-Northwest Wall-Far Left	Sink Tap	First Draw	0.8

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
825-58-FD	Oak Park High School - Kitchen-North Handwashing Sink	Sink Tap	First Draw	<0.4
825-59-FD	Oak Park High School - Serving-Handwashing Sink	Sink Tap	First Draw	<0.4
825-60-FD	Oak Park High School - Kitchen	Ice Machine	First Draw	0.4
825-61-FD	Oak Park High School - Women's Locker Room by Training-Right	Drinking Fountain	First Draw	<0.4
825-62-FD	Oak Park High School - Women's Locker Room by Training-Left	Drinking Fountain	First Draw	<0.4
825-63-FD	Oak Park High School - Women's Locker Room by Training-Middle	Sink Tap	First Draw	<0.4
825-64-FD	Oak Park High School - Outside Welcome Center-Left	Drinking Fountain	First Draw	<0.4
825-65-FD	Oak Park High School - Outside Welcome Center-Right	Drinking Fountain	First Draw	<0.4
825-66-FD	Oak Park High School - Outside Weight Room-Left	Drinking Fountain	First Draw	<0.4
825-67-FD	Oak Park High School - Outside Weight Room-Right	Drinking Fountain	First Draw	<0.4
825-68-FD	Oak Park High School - Men's Locker Room by Main Gym-Left (Restrooms)	Drinking Fountain	First Draw	<0.4
825-69-FD	Oak Park High School - Men's Locker Room by Main Gym-Right (Restrooms)	Drinking Fountain	First Draw	<0.4
825-70-FD	Oak Park High School - Men's Locker Room by Main Gym-Left	Drinking Fountain	First Draw	<0.4
825-71-FD	Oak Park High School - Men's Locker Room by Main Gym-Right	Drinking Fountain	First Draw	<0.4
825-72-FD	Oak Park High School - Outside Little Theatre	Drinking Fountain	First Draw	<0.4
825-73-FD	Oak Park High School - W101-Left	Sink Tap	First Draw	5.4
825-74-FD	Oak Park High School - W101-Middle	Sink Tap	First Draw	3.9
825-75-FD	Oak Park High School - W101-Right	Sink Tap	First Draw	10.6
825-76-FD	Oak Park High School - Nurse's Office	Sink Tap	First Draw	0.6
825-77-FD	Oak Park High School - By Exit Door 21	Outside Hydrant	First Draw	1.1
825-78-FD	Oak Park High School - F113	Ice Machine	First Draw	0.9

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
 - The test results and a summary that explains such results;
 - A description of any remedial steps taken; and
 - A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Appendix A Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date: 10/4/2023
Expiration Date: 10/4/2025
License Number: 211004-300006201



Paula F. Nickelson

Paula F. Nickelson
Director

Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.
- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

Appendix C

Laboratory Analytical Report



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: Lead Analysis

Project / PO Number: 825 Northeast 79th Terrace / 825
Received: 01/16/2024
Reported: 02/08/2024

Analytical Testing Parameters

Client Sample ID: 825-1-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-01

Collected By: Young, Bradley
Collection Date: 12/26/2023 8:52

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1835	RVV

Client Sample ID: 825-2-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-02

Collected By: Young, Bradley
Collection Date: 12/26/2023 8:52

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1838	RVV

Client Sample ID: 825-3-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-03

Collected By: Young, Bradley
Collection Date: 12/26/2023 8:52

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1841	RVV

Client Sample ID: 825-4-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-04

Collected By: Young, Bradley
Collection Date: 12/26/2023 8:52

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/05/24 1423	02/06/24 1850	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-5-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-05

Collected By: Young, Brady
Collection Date: 12/26/2023 8:53

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1853	RVV

Client Sample ID: 825-6-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-06

Collected By: Young, Brady
Collection Date: 12/26/2023 8:53

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1856	RVV

Client Sample ID: 825-7-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-07

Collected By: Young, Brady
Collection Date: 12/26/2023 8:53

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1859	RVV

Client Sample ID: 825-8-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-08

Collected By: Young, Brady
Collection Date: 12/26/2023 8:53

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1902	RVV

Client Sample ID: 825-9-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-09

Collected By: Young, Brady
Collection Date: 12/26/2023 8:54

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.7	0.4	ppb	2		02/05/24 1423	02/06/24 1905	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-10-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-10

Collected By: Young, Bradly
Collection Date: 12/26/2023 8:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/05/24 1423	02/06/24 1913	RVV

Client Sample ID: 825-11-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-11

Collected By: Young, Bradly
Collection Date: 12/26/2023 8:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1928	RVV

Client Sample ID: 825-12-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-12

Collected By: Young, Bradly
Collection Date: 12/26/2023 8:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/05/24 1423	02/06/24 1931	RVV

Client Sample ID: 825-13-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-13

Collected By: Young, Bradly
Collection Date: 12/26/2023 8:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		02/05/24 1423	02/06/24 1934	RVV

Client Sample ID: 825-14-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-14

Collected By: Young, Bradly
Collection Date: 12/26/2023 8:57

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		02/05/24 1423	02/06/24 1937	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-15-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-15

Collected By: Young, Brady
Collection Date: 12/26/2023 8:57

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.8	0.4	ppb	2		02/05/24 1423	02/06/24 1940	RVV

Client Sample ID: 825-16-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-16

Collected By: Young, Brady
Collection Date: 12/26/2023 8:57

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/05/24 1423	02/06/24 1943	RVV

Client Sample ID: 825-17-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-17

Collected By: Young, Brady
Collection Date: 12/26/2023 8:57

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/05/24 1423	02/06/24 1946	RVV

Client Sample ID: 825-18-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-18

Collected By: Young, Brady
Collection Date: 12/26/2023 8:59

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1949	RVV

Client Sample ID: 825-19-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-19

Collected By: Young, Brady
Collection Date: 12/26/2023 9:00

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 1952	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-20-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-20

Collected By: Young, Brady
Collection Date: 12/26/2023 9:22

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2001	RVV

Client Sample ID: 825-21-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-21

Collected By: Young, Brady
Collection Date: 12/26/2023 9:00

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2004	RVV

Client Sample ID: 825-22-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-22

Collected By: Young, Brady
Collection Date: 12/26/2023 9:00

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2007	RVV

Client Sample ID: 825-23-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-23

Collected By: Young, Brady
Collection Date: 12/26/2023 9:01

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2010	RVV

Client Sample ID: 825-24-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-24

Collected By: Young, Brady
Collection Date: 12/26/2023 9:01

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2013	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-25-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-25

Collected By: Young, Brady
Collection Date: 12/26/2023 9:02

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2016	RVV

Client Sample ID: 825-26-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-26

Collected By: Young, Brady
Collection Date: 12/26/2023 9:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/05/24 1423	02/06/24 2019	RVV

Client Sample ID: 825-27-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-27

Collected By: Young, Brady
Collection Date: 12/26/2023 9:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/05/24 1423	02/06/24 2022	RVV

Client Sample ID: 825-28-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-28

Collected By: Young, Brady
Collection Date: 12/26/2023 9:06

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2025	RVV

Client Sample ID: 825-29-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-29

Collected By: Young, Brady
Collection Date: 12/26/2023 9:06

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2028	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-30-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-30

Collected By: Young, Brady
Collection Date: 12/26/2023 9:07

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.1	0.4	ppb	2		02/05/24 1423	02/06/24 2043	RVV

Client Sample ID: 825-31-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-31

Collected By: Young, Brady
Collection Date: 12/26/2023 9:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.2	0.4	ppb	2		02/05/24 1423	02/06/24 2052	RVV

Client Sample ID: 825-32-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-32

Collected By: Young, Brady
Collection Date: 12/26/2023 9:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	8.4	0.4	ppb	2		02/05/24 1423	02/06/24 2055	RVV

Client Sample ID: 825-33-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-33

Collected By: Young, Brady
Collection Date: 12/26/2023 9:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.8	0.4	ppb	2		02/05/24 1423	02/06/24 2058	RVV

Client Sample ID: 825-34-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-34

Collected By: Young, Brady
Collection Date: 12/26/2023 9:10

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		02/05/24 1423	02/06/24 2101	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-35-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-35

Collected By: Young, Brady
Collection Date: 12/26/2023 9:10

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/05/24 1423	02/06/24 2104	RVV

Client Sample ID: 825-36-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-36

Collected By: Young, Brady
Collection Date: 12/26/2023 9:10

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2113	RVV

Client Sample ID: 825-37-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-37

Collected By: Young, Brady
Collection Date: 12/26/2023 9:11

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2116	RVV

Client Sample ID: 825-38-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-38

Collected By: Young, Brady
Collection Date: 12/26/2023 10:28

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.5	0.4	ppb	2		02/05/24 1423	02/06/24 2119	RVV

Client Sample ID: 825-39-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-39

Collected By: Young, Brady
Collection Date: 12/26/2023 9:12

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	9.2	0.4	ppb	2		02/05/24 1423	02/06/24 2122	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-40-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-40

Collected By: Young, Brady
Collection Date: 12/26/2023 9:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.1	0.4	ppb	2		02/05/24 1423	02/06/24 2125	RVV

Client Sample ID: 825-41-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-41

Collected By: Young, Brady
Collection Date: 12/26/2023 9:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.7	0.4	ppb	2		02/05/24 1423	02/06/24 2128	RVV

Client Sample ID: 825-42-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-42

Collected By: Young, Brady
Collection Date: 12/26/2023 9:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.1	0.4	ppb	2		02/05/24 1423	02/06/24 2131	RVV

Client Sample ID: 825-43-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-43

Collected By: Young, Brady
Collection Date: 12/26/2023 9:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/05/24 1423	02/06/24 2134	RVV

Client Sample ID: 825-44-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-44

Collected By: Young, Brady
Collection Date: 12/26/2023 9:14

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.7	0.4	ppb	2		02/05/24 1423	02/06/24 2137	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-45-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-45

Collected By: Young, Brady
Collection Date: 12/26/2023 9:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2140	RVV

Client Sample ID: 825-46-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-46

Collected By: Young, Brady
Collection Date: 12/26/2023 9:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2148	RVV

Client Sample ID: 825-47-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-47

Collected By: Young, Brady
Collection Date: 12/26/2023 9:17

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/05/24 1423	02/06/24 2151	RVV

Client Sample ID: 825-48-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-48

Collected By: Young, Brady
Collection Date: 12/26/2023 9:17

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2154	RVV

Client Sample ID: 825-49-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-49

Collected By: Young, Brady
Collection Date: 12/26/2023 9:18

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/05/24 1423	02/06/24 2157	RVV

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-50-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-50

Collected By: Young, Brady
Collection Date: 12/26/2023 9:18

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/05/24 1423	02/06/24 2206	RVV

Client Sample ID: 825-51-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-51

Collected By: Young, Brady
Collection Date: 12/26/2023 9:19

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.0	0.4	ppb	2		02/05/24 1423	02/06/24 2215	RVV

Client Sample ID: 825-52-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-52

Collected By: Young, Brady
Collection Date: 12/26/2023 9:19

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.5	0.4	ppb	2		02/05/24 1423	02/06/24 2224	RVV

Client Sample ID: 825-53-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-53

Collected By: Young, Brady
Collection Date: 12/26/2023 9:19

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		02/05/24 1423	02/06/24 2227	RVV

Client Sample ID: 825-54-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-54

Collected By: Young, Brady
Collection Date: 12/26/2023 10:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/05/24 1423	02/06/24 2230	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-55-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-55

Collected By: Young, Brady
Collection Date: 12/26/2023 9:20

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/05/24 1423	02/06/24 2233	RVV

Client Sample ID: 825-56-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-56

Collected By: Young, Brady
Collection Date: 12/26/2023 9:21

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.1	0.4	ppb	2		02/05/24 1423	02/06/24 2236	RVV

Client Sample ID: 825-57-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-57

Collected By: Young, Brady
Collection Date: 12/26/2023 9:21

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		02/05/24 1423	02/06/24 2239	RVV

Client Sample ID: 825-58-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-58

Collected By: Young, Brady
Collection Date: 12/26/2023 9:21

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2242	RVV

Client Sample ID: 825-59-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-59

Collected By: Young, Brady
Collection Date: 12/26/2023 9:22

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2245	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-60-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-60

Collected By: Young, Brady
Collection Date: 12/26/2023 9:22

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2248	RVV

Client Sample ID: 825-61-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-61

Collected By: Young, Brady
Collection Date: 12/26/2023 9:23

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2251	RVV

Client Sample ID: 825-62-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-62

Collected By: Young, Brady
Collection Date: 12/26/2023 9:23

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2300	RVV

Client Sample ID: 825-63-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-63

Collected By: Young, Brady
Collection Date: 12/26/2023 9:24

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2303	RVV

Client Sample ID: 825-64-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-64

Collected By: Young, Brady
Collection Date: 12/26/2023 9:25

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2306	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-65-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-65

Collected By: Young, Brady
Collection Date: 12/26/2023 9:25

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2309	RVV

Client Sample ID: 825-66-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-66

Collected By: Young, Brady
Collection Date: 12/26/2023 9:26

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2312	RVV

Client Sample ID: 825-67-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-67

Collected By: Young, Brady
Collection Date: 12/26/2023 9:26

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2315	RVV

Client Sample ID: 825-68-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-68

Collected By: Young, Brady
Collection Date: 12/26/2023 9:22

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2318	RVV

Client Sample ID: 825-69-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-69

Collected By: Young, Brady
Collection Date: 12/26/2023 9:27

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2321	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-70-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-70

Collected By: Young, Bradly
Collection Date: 12/26/2023 9:28

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2336	RVV

Client Sample ID: 825-71-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-71

Collected By: Young, Bradly
Collection Date: 12/26/2023 9:28

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2345	RVV

Client Sample ID: 825-72-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-72

Collected By: Young, Bradly
Collection Date: 12/26/2023 9:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/05/24 1423	02/06/24 2348	RVV

Client Sample ID: 825-73-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-73

Collected By: Young, Bradly
Collection Date: 12/26/2023 9:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	5.4	0.4	ppb	2		02/05/24 1423	02/06/24 2351	RVV

Client Sample ID: 825-74-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-74

Collected By: Young, Bradly
Collection Date: 12/26/2023 9:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.9	0.4	ppb	2		02/05/24 1423	02/06/24 2354	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0071

Client Sample ID: 825-75-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-75

Collected By: Young, Brady
Collection Date: 12/26/2023 9:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	10.6	0.4	ppb	2		02/05/24 1423	02/06/24 2357	RVV

Client Sample ID: 825-76-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-76

Collected By: Young, Brady
Collection Date: 12/26/2023 9:35

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/05/24 1423	02/07/24 0000	RVV

Client Sample ID: 825-77-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-77

Collected By: Young, Brady
Collection Date: 12/26/2023 9:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.1	0.4	ppb	2		02/05/24 1423	02/07/24 0003	RVV

Client Sample ID: 825-78-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0071-78

Collected By: Young, Brady
Collection Date: 12/26/2023 9:02

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		02/05/24 1423	02/07/24 0012	RVV

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.

Victoria Bruck
Field Technician II
02/08/24 09:17

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER: <u>Bradly Young</u>		NAME: <u>Jeff Hurst</u>		NAME: <u>Jeff Hurst</u>	
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS: <u>825 Northeast 79th Terrace</u>		ADDRESS: <u>PO Box 47166</u>		ADDRESS: <u>PO Box 47166</u>	
CITY/ST/ZIP: <u>Kansas City, Missouri 64118</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>	
PHONE: <u>816-321-4702</u>		PHONE: <u>816-678-7894</u>		PHONE: <u>816-678-7894</u>	
		EMAIL: <u>jeffh@axiomservicepros.com</u>		EMAIL: <u>jeffh@axiomservicepros.com</u>	


CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	<u>14.2/11.0</u>
															Sample Condition	Sample #
825-1-FD	12/26/2023	08:52	Oak Park High School - Drinking Fountain - Outside 206-Far Left	1	Wt	Grab	X									<u>01</u>
825-2-FD	12/26/2023	08:52	Oak Park High School - Drinking Fountain - Outside W206-Left Middle	1	Wt	Grab	X									<u>02</u>
825-3-FD	12/26/2023	08:52	Oak Park High School - Drinking Fountain - Outside W206-Right Middle	1	Wt	Grab	X									<u>03</u>
825-4-FD	12/26/2023	08:52	Oak Park High School - Drinking Fountain - Outside W206-Far Right	1	Wt	Grab	X									<u>04</u>
825-5-FD	12/26/2023	08:53	Oak Park High School - Drinking Fountain - Outside E238-Far Left	1	Wt	Grab	X									<u>05</u>
825-6-FD	12/26/2023	08:53	Oak Park High School - Drinking Fountain - Outside E238-Left Middle	1	Wt	Grab	X									<u>06</u>
825-7-FD	12/26/2023	08:53	Oak Park High School - Drinking Fountain - Outside E238-Right Middle	1	Wt	Grab	X									<u>07</u>

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
<u>Bradly Young</u>	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		 3 H A 0 0 7 1 AXIOM Service Professionals PM: Carolyn Jackson
	Time:		<u>Kylee Lappoon</u>	Time:	<u>1-16-24</u> <u>8:30</u>	

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED							LAB USE ONLY	
															Wk Order #:	3H A 0071
															Short Hold:	
															Rush:	
															Temp: oC	14.2/11.0
															Sample Condition	Sample #
825-8-FD	12/26/2023	08:53	Oak Park High School - Drinking Fountain - Outside E238-Far Right	1	Wt	Grab	X									08
825-9-FD	12/26/2023	08:54	Oak Park High School - Sink Tap - S250	1	Wt	Grab	X									09
825-10-FD	12/26/2023	08:55	Oak Park High School - Drinking Fountain - Outside S250-Far Left	1	Wt	Grab	X									10
825-11-FD	12/26/2023	08:55	Oak Park High School - Drinking Fountain - Outside S250-Left Middle	1	Wt	Grab	X									11
825-12-FD	12/26/2023	08:55	Oak Park High School - Drinking Fountain - Outside S250-Right Middle	1	Wt	Grab	X									12
825-13-FD	12/26/2023	08:55	Oak Park High School - Drinking Fountain - Outside S250-Far Right	1	Wt	Grab	X									13
825-14-FD	12/26/2023	08:57	Oak Park High School - Drinking Fountain - Outside C294-Far Left	1	Wt	Grab	X									14

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				1-16-24		
	Time:			Time:	8:30	



PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	14.2/11.0
															Sample Condition	Sample #
825-15-FD	12/26/2023	08:57	Oak Park High School - Drinking Fountain - Outside C294-Left Middle	1	Wt	Grab	X									15
825-16-FD	12/26/2023	08:57	Oak Park High School - Drinking Fountain - Outside C294-Right Middle	1	Wt	Grab	X									16
825-17-FD	12/26/2023	08:57	Oak Park High School - Drinking Fountain - Outside C294-Far Right	1	Wt	Grab	X									17
825-18-FD	12/26/2023	08:59	Oak Park High School - Drinking Fountain - LMC	1	Wt	Grab	X									18
825-19-FD	12/26/2023	09:00	Oak Park High School - Sink Tap - F113-West Sink	1	Wt	Grab	X									19
825-20-FD	12/26/2023	09:22	Oak Park High School - Sink Tap - F113-North Middle Sink	1	Wt	Grab	X									20
825-21-FD	12/26/2023	09:00	Oak Park High School - Sink Tap - F113-Northeast Sink	1	Wt	Grab	X									21

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
						
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 0 7 1
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	14.2/11.0
															Sample Condition	Sample #
825-22-FD	12/26/2023	09:00	Oak Park High School - Sink Tap - F113-South Sink	1	Wt	Grab	X									22
825-23-FD	12/26/2023	09:01	Oak Park High School - Sink Tap - F113-3 Bay Sink	1	Wt	Grab	X									23
825-24-FD	12/26/2023	09:01	Oak Park High School - Sink Tap - F113-Handwashing Sink	1	Wt	Grab	X									24
825-25-FD	12/26/2023	09:02	Oak Park High School - Sink Tap - F113-Southwest Sink	1	Wt	Grab	X									25
825-26-FD	12/26/2023	09:03	Oak Park High School - Drinking Fountain - Outside F109-Left	1	Wt	Grab	X									26
825-27-FD	12/26/2023	09:03	Oak Park High School - Drinking Fountain - Outside F109-Right	1	Wt	Grab	X									27
825-28-FD	12/26/2023	09:06	Oak Park High School - Drinking Fountain - Outside N150-Left	1	Wt	Grab	X									28


Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
						
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				1-16-24		
	Time:			Time:		
				8:30		



3 H A 0 0 7 1
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	14.2/11.0
														Sample Condition	Sample #
825-29-FD	12/26/2023	09:06	Oak Park High School - Drinking Fountain - Outside N150-Right	1	Wt	Grab	X								29
825-30-FD	12/26/2023	09:07	Oak Park High School - Sink Tap - C142	1	Wt	Grab	X								30
825-31-FD	12/26/2023	09:08	Oak Park High School - Sink Tap - N150	1	Wt	Grab	X								31
825-32-FD	12/26/2023	09:08	Oak Park High School - Sink Tap - N155	1	Wt	Grab	X								32
825-33-FD	12/26/2023	09:08	Oak Park High School - Sink Tap - N153	1	Wt	Grab	X								33
825-34-FD	12/26/2023	09:10	Oak Park High School - Drinking Fountain - Outside C125-Far Left	1	Wt	Grab	X								34
825-35-FD	12/26/2023	09:10	Oak Park High School - Drinking Fountain - Outside C125-Left Middle	1	Wt	Grab	X								35

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:	1-16-24	
					8:30	



3 H A 0 0 7 1
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	Sample #
825-36-FD	12/26/2023	09:10	Oak Park High School - Drinking Fountain - Outside C125-Right Middle	1	Wt	Grab	X							34A-00571	36
825-37-FD	12/26/2023	09:11	Oak Park High School - Drinking Fountain - Outside C125-Far Right	1	Wt	Grab	X								37
825-38-FD	12/26/2023	10:28	Oak Park High School - Sink Tap - C125	1	Wt	Grab	X								38
825-39-FD	12/26/2023	09:12	Oak Park High School - Sink Tap - C124	1	Wt	Grab	X								39
825-40-FD	12/26/2023	09:13	Oak Park High School - Bubbler - C121	1	Wt	Grab	X								40
825-41-FD	12/26/2023	09:13	Oak Park High School - Sink Tap - C121-Left Sink-Middle	1	Wt	Grab	X								41
825-42-FD	12/26/2023	09:13	Oak Park High School - Sink Tap - C121-Right Sink-Far Left	1	Wt	Grab	X								42


Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
		Kyle Layton	1-16-24	
			8:30	




3 H A 0 0 7 1
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com


CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	14.2/11.0
															Sample Condition	Sample #
825-43-FD	12/26/2023	09:13	Oak Park High School - Sink Tap - C121-Right Sink-Middle	1	Wt	Grab	X									43
825-44-FD	12/26/2023	09:14	Oak Park High School - Sink Tap - C121-Right Sink-Far Right	1	Wt	Grab	X									44
825-45-FD	12/26/2023	09:16	Oak Park High School - Drinking Fountain - Outside Training Room-Left	1	Wt	Grab	X									45
825-46-FD	12/26/2023	09:16	Oak Park High School - Drinking Fountain - Outside Training Room-Right	1	Wt	Grab	X									46
825-47-FD	12/26/2023	09:17	Oak Park High School - Sink Tap - Training Room	1	Wt	Grab	X									47
825-48-FD	12/26/2023	09:17	Oak Park High School - Ice Machine - Training Room	1	Wt	Grab	X									48
825-49-FD	12/26/2023	09:18	Oak Park High School - Sink Tap - Kitchen-Southwest Sink	1	Wt	Grab	X									49

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
	Time:		Time:	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
			11-24	
	Time:		Time:	
			8:30	

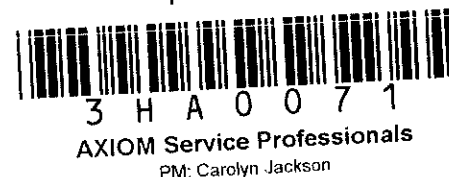

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com


CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	14.2/11.0
														Sample Condition	Sample #
825-50-FD	12/26/2023	09:18	Oak Park High School - Sink Tap - Kitchen-South Handwashing Sink	1	Wt	Grab	X								50
825-51-FD	12/26/2023	09:19	Oak Park High School - Sink Tap - Kitchen-South Middle Sink	1	Wt	Grab	X								51
825-52-FD	12/26/2023	09:19	Oak Park High School - Steam Kettle - Kitchen	1	Wt	Grab	X								52
825-53-FD	12/26/2023	09:19	Oak Park High School - Sink Tap - Kitchen-North Middle Sink	1	Wt	Grab	X								53
825-54-FD	12/26/2023	10:33	Oak Park High School - Sink Tap - Kitchen-Northeast Wall-Far Right	1	Wt	Grab	X								54
825-55-FD	12/26/2023	09:20	Oak Park High School - Sink Tap - Kitchen-Northwest Wall-Right Middle	1	Wt	Grab	X								55
825-56-FD	12/26/2023	09:20	Oak Park High School - Sink Tap - Kitchen-Northwest Wall-Left Middle	1	Wt	Grab	X								56

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
	Time:		Time:	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
			1-26-24	
	Time:		Time:	
			8:30	



PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: °C	14.2/11.0
														Sample Condition	Sample #
825-57-FD	12/26/2023	09:21	Oak Park High School - Sink Tap - Kitchen-Northwest Wall-Far Left	1	Wt	Grab	X								57
825-58-FD	12/26/2023	09:21	Oak Park High School - Sink Tap - Kitchen-North Handwashing Sink	1	Wt	Grab	X								58
825-59-FD	12/26/2023	09:22	Oak Park High School - Sink Tap - Serving-Handwashing Sink	1	Wt	Grab	X								59
825-60-FD	12/26/2023	09:22	Oak Park High School - Ice Machine - Kitchen	1	Wt	Grab	X								60
825-61-FD	12/26/2023	09:23	Oak Park High School - Drinking Fountain - Women's Locker Room by Training-Right	1	Wt	Grab	X								61
825-62-FD	12/26/2023	09:23	Oak Park High School - Drinking Fountain - Women's Locker Room by Training-Left	1	Wt	Grab	X								62
825-63-FD	12/26/2023	09:24	Oak Park High School - Sink Tap - Women's Locker Room by Training-Middle	1	Wt	Grab	X								63

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
			12/26/24	
			8:30	



PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	3HA0071
														Short Hold:	
														Rush:	
														Temp: oC	14.2/11.0
														Sample Condition	Sample #
825-64-FD	12/26/2023	09:25	Oak Park High School - Drinking Fountain - Outside Welcome Center-Left	1	Wt	Grab	X								64
825-65-FD	12/26/2023	09:25	Oak Park High School - Drinking Fountain - Outside Welcome Center-Right	1	Wt	Grab	X								65
825-66-FD	12/26/2023	09:26	Oak Park High School - Drinking Fountain - Outside Weight Room-Left	1	Wt	Grab	X								66
825-67-FD	12/26/2023	09:26	Oak Park High School - Drinking Fountain - Outside Weight Room-Right	1	Wt	Grab	X								67
825-68-FD	12/26/2023	09:27	Oak Park High School - Drinking Fountain - Men's Locker Room by Main Gym-Left(Bathrooms)	1	Wt	Grab	X								68
825-69-FD	12/26/2023	09:27	Oak Park High School - Drinking Fountain - Men's Locker Room by Main Gym-Right (Bathrooms)	1	Wt	Grab	X								69
825-70-FD	12/26/2023	09:28	Oak Park High School - Drinking Fountain - Men's Locker Room by Main Gym-Left	1	Wt	Grab	X								70




3 H A 0 0 7 1
AXIOM Service Professionals
PM: Carolyn Jackson

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
------------------------------	-------	--------------------------	-------	----------

Kyle Laffoon 1-16-24
8:30

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	14.2/11.0
														Sample Condition	Sample #
825-71-FD	12/26/2023	09:28	Oak Park High School - Drinking Fountain - Men's Locker Room by Main Gym-Right	1	Wt	Grab	X								71
825-72-FD	12/26/2023	09:38	Oak Park High School - Drinking Fountain - Outside Little Theatre	1	Wt	Grab	X								72
825-73-FD	12/26/2023	09:31	Oak Park High School - Sink Tap - W101-Left	1	Wt	Grab	X								73
825-74-FD	12/26/2023	09:31	Oak Park High School - Sink Tap - W101-Middle	1	Wt	Grab	X								74
825-75-FD	12/26/2023	09:31	Oak Park High School - Sink Tap - W101-Right	1	Wt	Grab	X								75
825-76-FD	12/26/2023	09:35	Oak Park High School - Sink Tap - Nurse Office	1	Wt	Grab	X								76
825-77-FD	12/26/2023	09:38	Oak Park High School - Outside Hydrant - By Exit Door 21	1	Wt	Grab	X								77

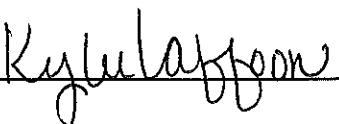
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	1-16-24	
	Time:			Time:	8:30	



3 H A 0 0 7 1
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	825 Northeast 79th Terrace	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64118	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	14.2/11.0
														Sample Condition	Sample #
825-78-FD	12/26/2023	09:02	Oak Park High School - Ice Machine - F113	1	Wt	Grab	X								78

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				12-16-24		
	Time:			Time: 8:30		



3 H A 0 0 7 1
AXIOM Service Professionals
PM: Carolyn Jackson

Appendix D

Photo Log



12/26/2023 - 825-1 - Oak Park High School - Outside 206-Far Left



12/26/2023 - 825-2 - Oak Park High School - Outside W206-Left Middle



12/26/2023 - 825-3 - Oak Park High School - Outside W206-Right Middle



12/26/2023 - 825-4 - Oak Park High School - Outside W206-Far Right




12/26/2023 - 825-5 - Oak Park High School - Outside E238-Far Left



12/26/2023 - 825-6 - Oak Park High School - Outside E238-Left Middle



12/26/2023 - 825-7 - Oak Park High School - Outside E238-Right Middle

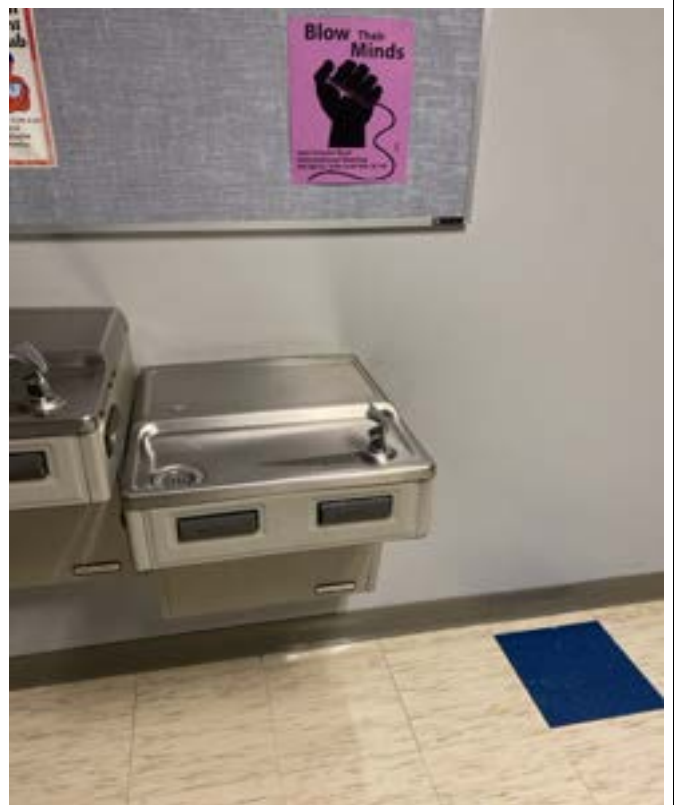

12/26/2023 - 825-8 - Oak Park High School - Outside E238-Far Right




12/26/2023 - 825-9 - Oak Park High School - S250



12/26/2023 - 825-10 - Oak Park High School - Outside S250-Far Left



12/26/2023 - 825-11 - Oak Park High School - Outside S250-Left Middle

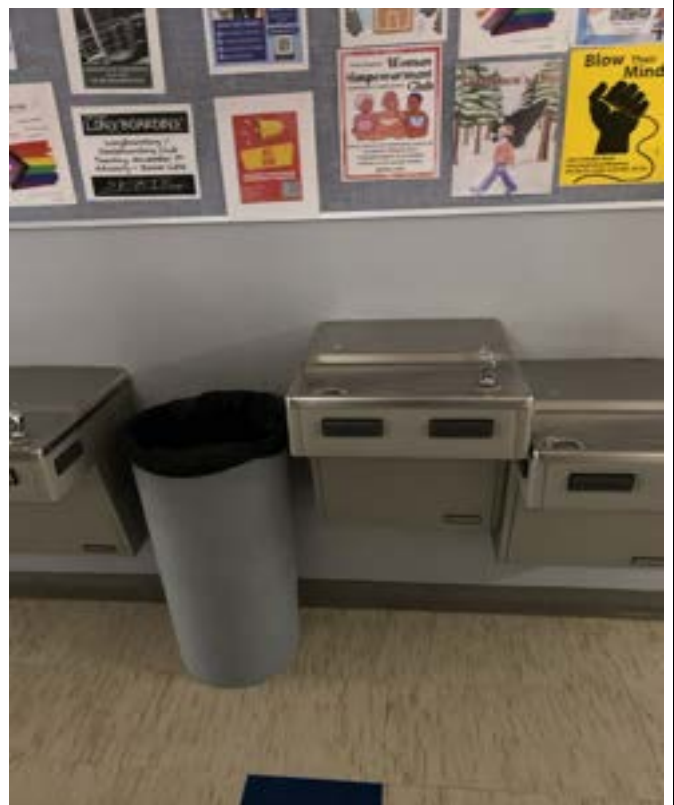

12/26/2023 - 825-12 - Oak Park High School - Outside S250-Right Middle



12/26/2023 - 825-13 - Oak Park High School - Outside S250-Far Right



12/26/2023 - 825-14 - Oak Park High School - Outside C294-Far Left



12/26/2023 - 825-15 - Oak Park High School - Outside C294-Left Middle



12/26/2023 - 825-16 - Oak Park High School - Outside C294-Right Middle



12/26/2023 - 825-17 - Oak Park High School - Outside C294-Far Right



12/26/2023 - 825-18 - Oak Park High School - LMC



12/26/2023 - 825-19 - Oak Park High School - F113-West Sink



12/26/2023 - 825-20 - Oak Park High School - F113-North Middle Sink



12/26/2023 - 825-21 - Oak Park High School - F113-Northeast Sink



12/26/2023 - 825-22 - Oak Park High School - F113-South Sink



12/26/2023 - 825-23 - Oak Park High School - F113-3 Bay Sink



12/26/2023 - 825-24 - Oak Park High School - F113-Handwashing Sink



12/26/2023 - 825-25 - Oak Park High School - F113-Southwest Sink



12/26/2023 - 825-26 - Oak Park High School - Outside F109-Left



12/26/2023 - 825-27 - Oak Park High School - Outside F109-Right



12/26/2023 - 825-28 - Oak Park High School - Outside N150-Left



12/26/2023 - 825-29 - Oak Park High School - Outside N150-Right



12/26/2023 - 825-30 - Oak Park High School - C142



12/26/2023 - 825-31 - Oak Park High School - N150



12/26/2023 - 825-32 - Oak Park High School - N155



12/26/2023 - 825-33 - Oak Park High School - N153



12/26/2023 - 825-34 - Oak Park High School - Outside C125-Far Left



12/26/2023 - 825-35 - Oak Park High School - Outside C125-Left Middle



12/26/2023 - 825-36 - Oak Park High School - Outside C125-Right Middle



12/26/2023 - 825-37 - Oak Park High School - Outside C125-Far Right



12/26/2023 - 825-38 - Oak Park High School - C125




12/26/2023 - 825-39 - Oak Park High School - C124



12/26/2023 - 825-40 - Oak Park High School - C121




12/26/2023 - 825-41 - Oak Park High School - C121-Left Sink-Middle

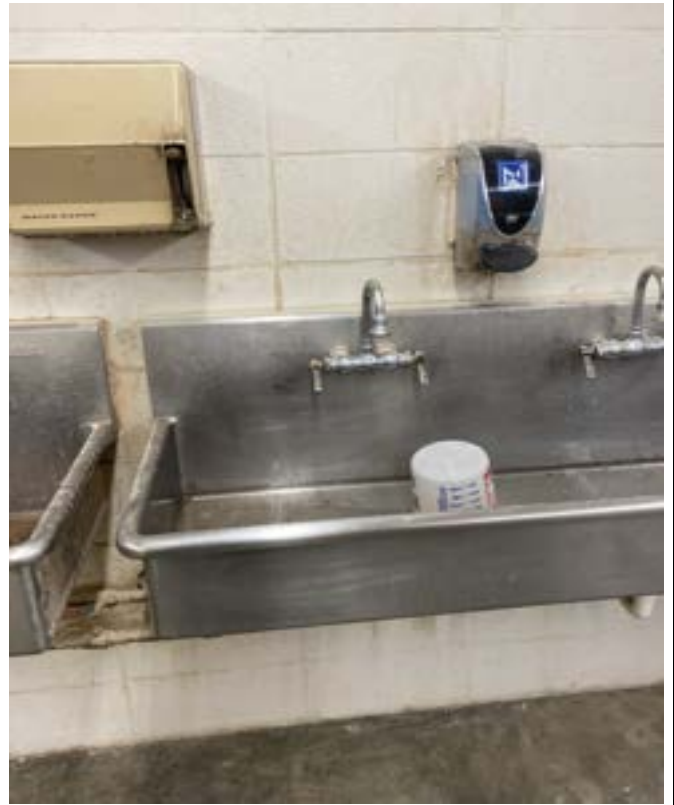

12/26/2023 - 825-42 - Oak Park High School - C121-Right Sink-Far Left



12/26/2023 - 825-43 - Oak Park High School - C121-Right Sink-Middle

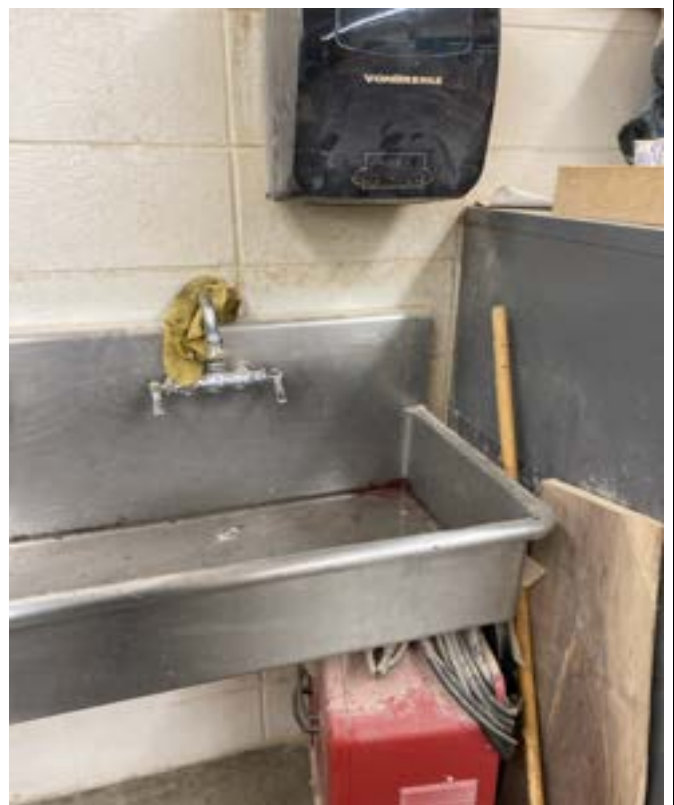


12/26/2023 - 825-44 - Oak Park High School - C121-Right Sink-Far Right



12/26/2023 - 825-45 - Oak Park High School -
Outside Training Room-Left



12/26/2023 - 825-46 - Oak Park High School -
Outside Training Room-Right

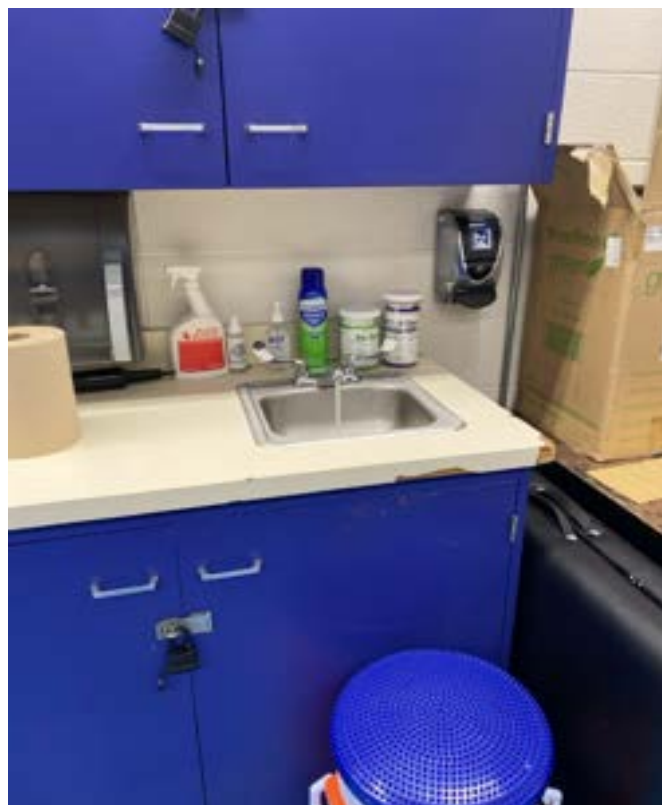

12/26/2023 - 825-47 - Oak Park High School -
Training Room



12/26/2023 - 825-48 - Oak Park High School -
Training Room



12/26/2023 - 825-49 - Oak Park High School -
Kitchen-Southwest Sink



12/26/2023 - 825-50 - Oak Park High School -
Kitchen-South Handwashing Sink



12/26/2023 - 825-51 - Oak Park High School -
Kitchen-South Middle Sink



12/26/2023 - 825-52 - Oak Park High School -
Kitchen



12/26/2023 - 825-53 - Oak Park High School - Kitchen-North Middle Sink



12/26/2023 - 825-54 - Oak Park High School - Kitchen-Northeast Wall-Far Right



12/26/2023 - 825-55 - Oak Park High School - Kitchen-Northwest Wall-Right Middle



12/26/2023 - 825-56 - Oak Park High School - Kitchen-Northwest Wall-Left Middle



12/26/2023 - 825-57 - Oak Park High School - Kitchen-Northwest Wall-Far Left



12/26/2023 - 825-58 - Oak Park High School - Kitchen-North Handwashing Sink




12/26/2023 - 825-59 - Oak Park High School - Serving-Handwashing Sink



12/26/2023 - 825-60 - Oak Park High School - Kitchen




12/26/2023 - 825-61 - Oak Park High School - Women's Locker Room by Training-Right

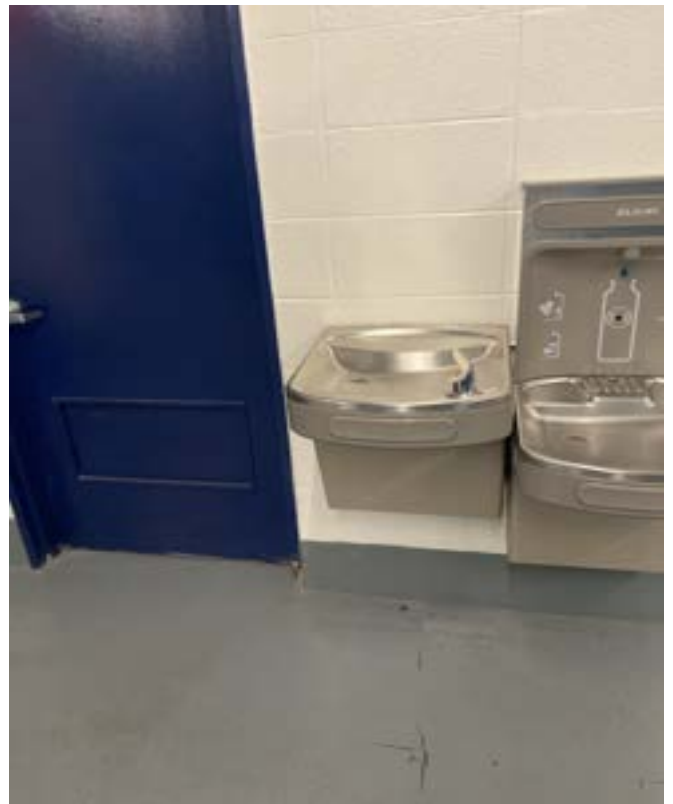

12/26/2023 - 825-62 - Oak Park High School - Women's Locker Room by Training-Left




12/26/2023 - 825-63 - Oak Park High School - Women's Locker Room by Training-Middle

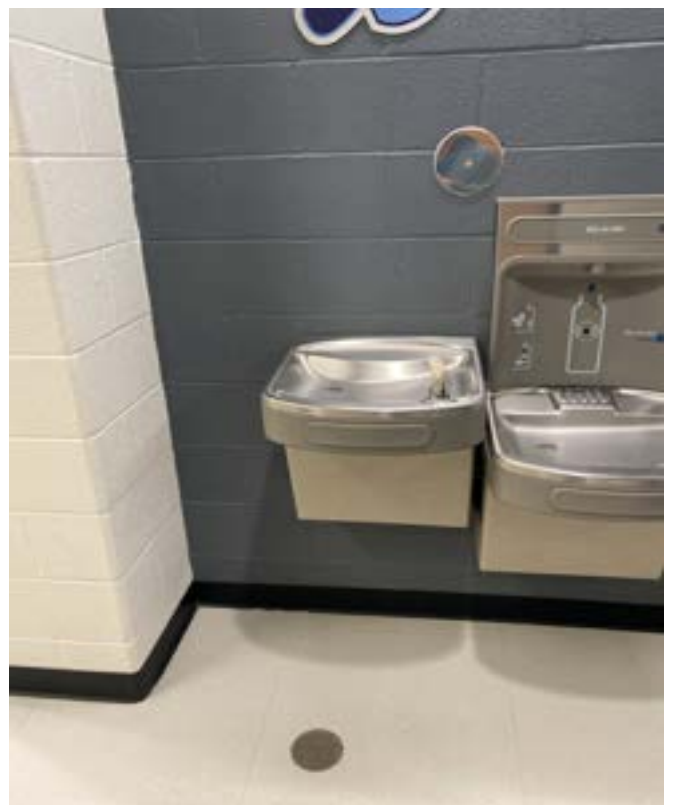


12/26/2023 - 825-64 - Oak Park High School - Outside Welcome Center-Left




12/26/2023 - 825-65 - Oak Park High School - Outside Welcome Center-Right

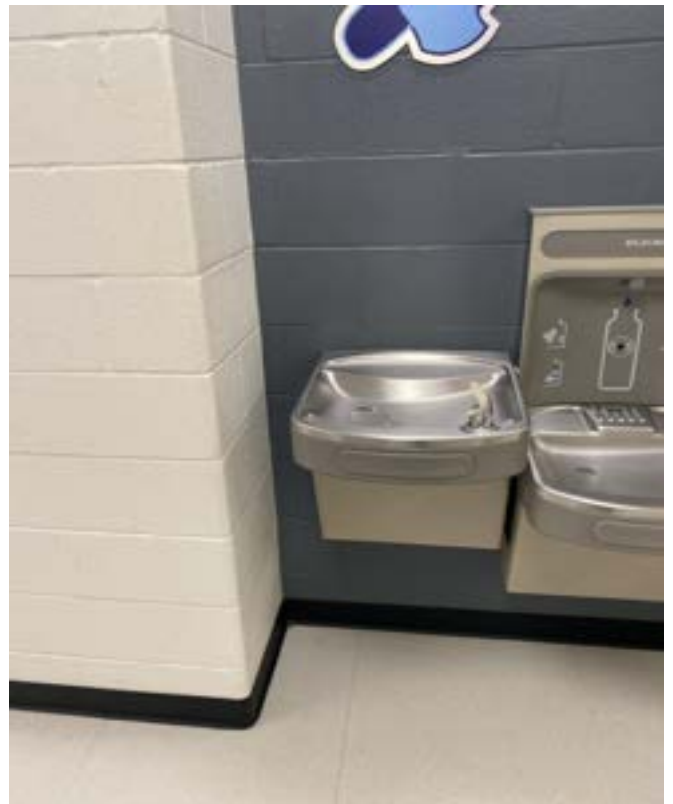

12/26/2023 - 825-66 - Oak Park High School - Outside Weight Room-Left

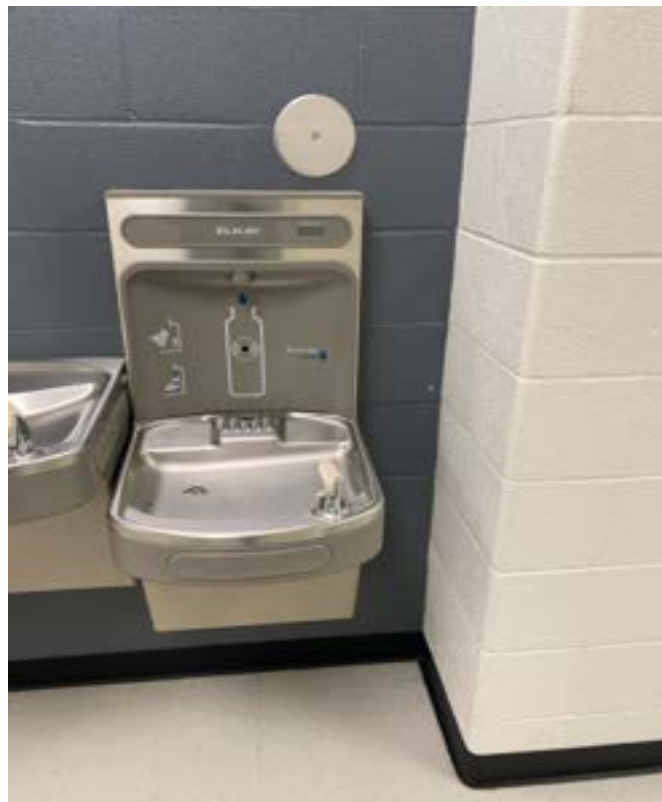


12/26/2023 - 825-67 - Oak Park High School - Outside Weight Room-Right

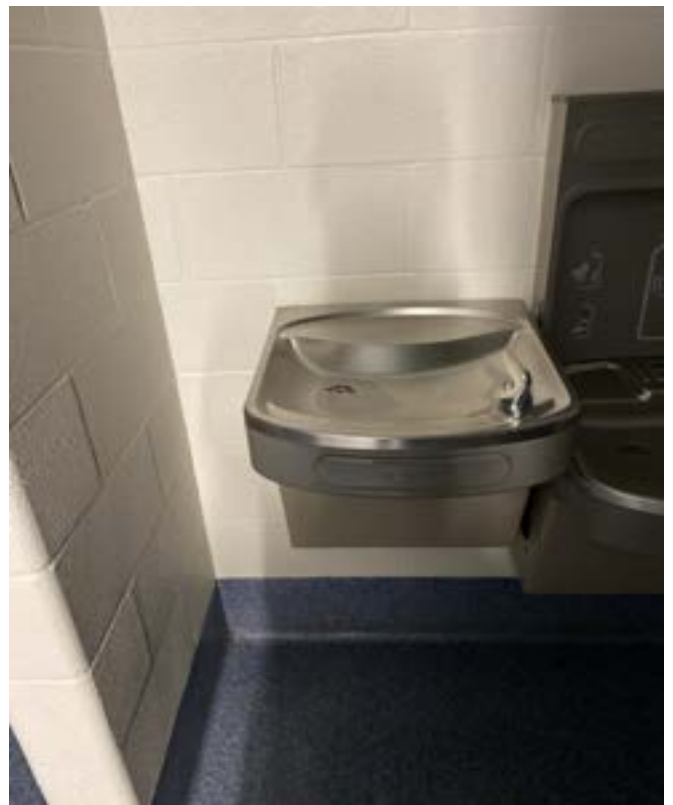

12/26/2023 - 825-68 - Oak Park High School - Men's Locker Room by Main Gym-Left (Restrooms)



12/26/2023 - 825-69 - Oak Park High School - Men's Locker Room by Main Gym-Right (Restrooms)

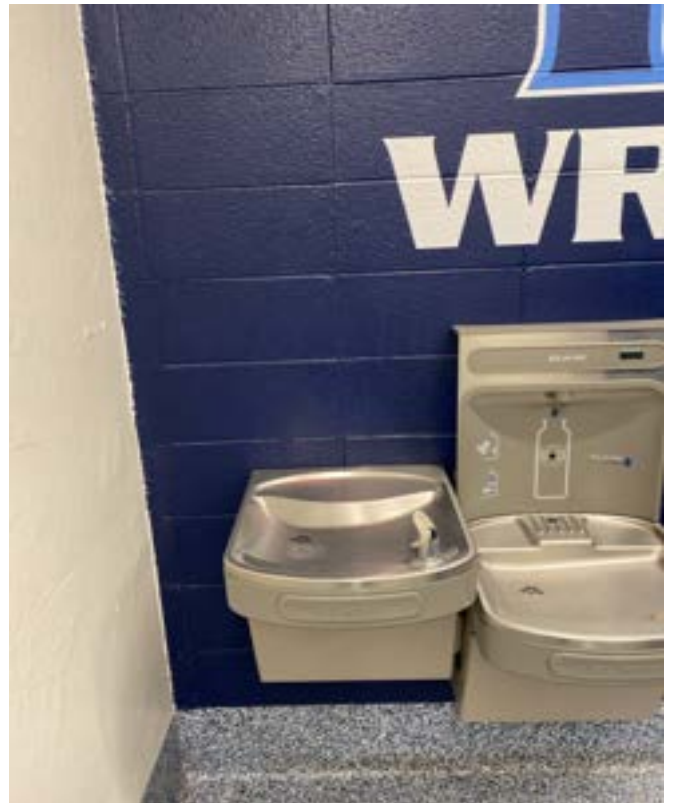

12/26/2023 - 825-70 - Oak Park High School - Men's Locker Room by Main Gym-Left



12/26/2023 - 825-71 - Oak Park High School - Men's Locker Room by Main Gym-Right



12/26/2023 - 825-72 - Oak Park High School - Outside Little Theatre



12/26/2023 - 825-73 - Oak Park High School - W101-Left



12/26/2023 - 825-74 - Oak Park High School - W101-Middle



12/26/2023 - 825-75 - Oak Park High School - W101-Right



12/26/2023 - 825-76 - Oak Park High School - Nurse Office



12/26/2023 - 825-77 - Oak Park High School - By
Exit Door 21



12/26/2023 - 825-78 - Oak Park High School -
F113

Appendix E

Source Identification Diagram

ASP was provided sample locations by
North Kansas City School District

EMERGENCY INFORMATION

Oak Park High School
825 NE 79th Terrace
Kansas City, MO 64118

-  Primary Exit Route
-  Secondary Exit Route
-  You Are Here
-  Exit Location
-  Stairway
-  Elevator
-  Defibrillator - 1st Floor Nurse & Main Gym
-  Severe Weather Shelter

IN CASE OF SEVERE WEATHER

Go To Training Room



Emergency Egress Plan
Oak Park High School
Level 2



EMERGENCY INFORMATION

Oak Park High School
825 NE 79th Terrace
Kansas City, MO 64118

-  Primary Exit Route
-  Secondary Exit Route
-  You Are Here
-  Exit Location
-  Stairway
-  Elevator
-  Defibrillator
-  Severe Weather Shelter

IN CASE OF SEVERE WEATHER

Shelter in Nurse's Office
or Vault



Emergency Egress Plan
Oak Park High School
Level 1

