



March 25, 2024

North Kansas City School District
2000 Northeast 46th Street
Kansas City, Missouri 64116

Project: Limited Lead in Drinking Water Testing
Address: 620 East 23rd Avenue, North Kansas City, Missouri 64116

On December 21, 2023 and January 2, 2024, Bradley Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 94 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of "lead free" to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of "lead free" as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: <https://www.epa.gov/dwreginfo/lead-and-copper-rule>

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.

Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school's buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in **red text**.

December 21, 2023 and January 2, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
620-1-FD	NKC High School - M339-Left	Sink Tap	First Draw	<0.4
620-2-FD	NKC High School - M339-Middle	Sink Tap	First Draw	<0.4
620-3-FD	NKC High School - M339-Right	Sink Tap	First Draw	<0.4
620-4-FD	NKC High School - M337-Left	Sink Tap	First Draw	<0.4
620-5-FD	NKC High School - M337-Middle	Sink Tap	First Draw	0.4
620-6-FD	NKC High School - M337-Right	Sink Tap	First Draw	<0.4
620-7-FD	NKC High School - M335-Left	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
620-8-FD	NKC High School - M335-Right	Sink Tap	First Draw	<0.4
620-9-FD	NKC High School - Outside M310-Left	Drinking Fountain	First Draw	<0.4
620-10-FD	NKC High School - Outside M310-Right	Drinking Fountain	First Draw	<0.4
620-11-FD	NKC High School - M333	Sink Tap	First Draw	0.4
620-12-FD	NKC High School - A307	Sink Tap	First Draw	0.8
620-13-FD	NKC High School - A309	Sink Tap	First Draw	0.7
620-14-FD	NKC High School - Restrooms by A304- Left	Drinking Fountain	First Draw	<0.4
620-15-FD	NKC High School - Restrooms by A304- Right	Drinking Fountain	First Draw	<0.4
620-16-FD	NKC High School - Restrooms by B247-Left	Drinking Fountain	First Draw	<0.4
620-17-FD	NKC High School - Restrooms by B247-Right	Drinking Fountain	First Draw	<0.4
620-18-FD	NKC High School - Weight Room-Left	Drinking Fountain	First Draw	<0.4
620-19-FD	NKC High School - Weight Room-Right	Drinking Fountain	First Draw	<0.4
620-20-FD	NKC High School - C255-Teachers Lounge	Sink Tap	First Draw	<0.4
620-21-FD	NKC High School - Outside B233-Left	Drinking Fountain	First Draw	<0.4
620-22-FD	NKC High School - Outside B233-Right	Drinking Fountain	First Draw	<0.4
620-23-FD	NKC High School - M232.1	Sink Tap	First Draw	0.5
620-24-FD	NKC High School - M232.1	Sink Tap	First Draw	1.6
620-25-FD	NKC High School - M232.1	Ice Machine	First Draw	<0.4
620-26-FD	NKC High School - M245.1	Sink Tap	First Draw	0.4
620-27-FD	NKC High School - Outside M239-Left	Drinking Fountain	First Draw	<0.4
620-28-FD	NKC High School - Outside M239-Right	Drinking Fountain	First Draw	<0.4
620-29-FD	NKC High School - Outside M112-Left	Drinking Fountain	First Draw	<0.4
620-30-FD	NKC High School - Outside M112-Right	Drinking Fountain	First Draw	<0.4
620-31-FD	NKC High School - M159 Breakroom	Sink Tap	First Draw	<0.4
620-32-FD	NKC High School - M104-Nurse	Sink Tap	First Draw	0.4
620-33-FD	NKC High School - M104-Nurse	Ice Machine	First Draw	0.6

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
620-34-FD	NKC High School - M104.2-Nurse	Sink Tap	First Draw	1
620-35-FD	NKC High School - M121-Closest to Door	Sink Tap	First Draw	0.6
620-36-FD	NKC High School - M121	Sink Tap	First Draw	<0.4
620-37-FD	NKC High School - A106	Sink Tap	First Draw	0.5
620-38-FD	NKC High School - A104	Sink Tap	First Draw	0.7
620-39-FD	NKC High School - Outside A109-Left	Drinking Fountain	First Draw	<0.4
620-40-FD	NKC High School - Outside A109-Right	Drinking Fountain	First Draw	<0.4
620-41-FD	NKC High School - A109	Sink Tap	First Draw	0.4
620-42-FD	NKC High School - A110	Sink Tap	First Draw	0.7
620-43-FD	NKC High School - A112-Left	Sink Tap	First Draw	<0.4
620-44-FD	NKC High School - A112-Middle	Sink Tap	First Draw	<0.4
620-45-FD	NKC High School - A112-Right	Sink Tap	First Draw	<0.4
620-46-FD	NKC High School - Restrooms Outside A102-Left	Drinking Fountain	First Draw	<0.4
620-47-FD	NKC High School - Restrooms Outside A102-Right	Drinking Fountain	First Draw	<0.4
620-48-FD	NKC High School - B143-Three Bay Sink	Sink Tap	First Draw	<0.4
620-49-FD	NKC High School - B143-Next to Three Bay Sink	Sink Tap	First Draw	<0.4
620-50-FD	NKC High School - B143- Next to Oven	Sink Tap	First Draw	<0.4
620-51-FD	NKC High School - B143-Next to Oven-Right	Sink Tap	First Draw	<0.4
620-52-FD	NKC High School - B145-Northeast Sink	Sink Tap	First Draw	<0.4
620-53-FD	NKC High School - B145-North Middle Sink	Sink Tap	First Draw	<0.4
620-54-FD	NKC High School - B145-South Middle Sink	Sink Tap	First Draw	<0.4
620-55-FD	NKC High School - B145-Southeast Sink	Sink Tap	First Draw	<0.4
620-56-FD	NKC High School - B145-South Sink	Sink Tap	First Draw	<0.4
620-57-FD	NKC High School - B145-Southwest Sink	Sink Tap	First Draw	<0.4
620-58-FD	NKC High School - B145-Northwest Sink	Sink Tap	First Draw	0.5
620-59-FD	NKC High School - B145-North Sink	Sink Tap	First Draw	7.2

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
620-60-FD	NKC High School - Restrooms by Cafe-Left	Drinking Fountain	First Draw	<0.4
620-61-FD	NKC High School - Restrooms by Cafe-Right	Drinking Fountain	First Draw	<0.4
620-62-FD	NKC High School - Kitchen-Handwashing by Ice Machine	Sink Tap	First Draw	<0.4
620-63-FD	NKC High School - Kitchen-Three Bay Sink Right	Sink Tap	First Draw	<0.4
620-64-FD	NKC High School - Kitchen-Three Bay Sink-Middle	Sink Tap	First Draw	<0.4
620-65-FD	NKC High School - Kitchen-Three Bay Sink-Left	Sink Tap	First Draw	<0.4
620-66-FD	NKC High School - Kitchen-West Sink	Sink Tap	First Draw	<0.4
620-67-FD	NKC High School - Kitchen-Northwest Sink	Sink Tap	First Draw	<0.4
620-68-FD	NKC High School - Kitchen	Pot Filler	First Draw	<0.4
620-69-FD	NKC High School - Kitchen-Middle Left Sink	Sink Tap	First Draw	<0.4
620-70-FD	NKC High School - Kitchen-Middle Right Sink	Sink Tap	First Draw	<0.4
620-71-FD	NKC High School - Kitchen-Northeast Handwashing Sink	Sink Tap	First Draw	<0.4
620-72-FD	NKC High School - Kitchen	Ice Machine	First Draw	<0.4
620-73-FD	NKC High School - Concessions-Handwashing Sink	Sink Tap	First Draw	<0.4
620-74-FD	NKC High School - Concessions-Three Bay Sink-Left	Sink Tap	First Draw	<0.4
620-75-FD	NKC High School - Concessions-Three Bay Sink-Right	Sink Tap	First Draw	<0.4
620-76-FD	NKC High School - C167	Sink Tap	First Draw	<0.4
620-77-FD	NKC High School - C167	Ice Machine	First Draw	<0.4
620-78-FD	NKC High School - By Exit 1	Outside Hydrant	First Draw	1
620-79-FD	NKC High School - Southwest Corner	Outside Hydrant	First Draw	3.7
620-80-FD	NKC High School - By Exit Door 5	Outside Hydrant	First Draw	1
620-81-FD	NKC High School - Courtyard by Exit 6	Outside Hydrant	First Draw	1.6
620-82-FD	NKC High School - North of Courtyard by Exit 6	Outside Hydrant	First Draw	14
620-83-FD	NKC High School - Courtyard by Exit 8	Outside Hydrant	First Draw	1.3
620-84-FD	NKC High School - By Exit Door 11	Outside Hydrant	First Draw	8.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
620-85-FD	NKC High School - By Exit Door 15	Outside Hydrant	First Draw	7.9
620-86-FD	NKC High School - Outside Exit Door 16	Outside Hydrant	First Draw	5.7
620-87-FD	NKC High School - North of Exit Door 18	Outside Hydrant	First Draw	1.6
620-88-FD	NKC High School - South of Exit Door 18	Outside Hydrant	First Draw	24.7
620-89-FD	NKC High School - West of Exit Door 20	Outside Hydrant	First Draw	3.8
620-90-FD	NKC High School - North of Exit Door 21	Outside Hydrant	First Draw	1.2
620-91-FD	NKC High School - Gym-East-Left	Drinking Fountain	First Draw	<0.4
620-92-FD	NKC High School - Gym-East-Right	Drinking Fountain	First Draw	<0.4
620-93-FD	NKC High School - Gym-West-Left	Drinking Fountain	First Draw	<0.4
620-94-FD	NKC High School - Gym-West-Right	Drinking Fountain	First Draw	<0.4

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date: 10/4/2023
Expiration Date: 10/4/2025
License Number: 211004-300006201



Paula F. Nickelson

Paula F. Nickelson
Director

Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



**Missouri Department of Health
and Senior Services**

Lead Occupation License - ID Badge

License Number:

000801-200166567

Lead Risk Assessor

**Jeffrey
Hurst**

Expiration Date: **8/1/2024**

Paula F. Nickelson

Paula F. Nickelson
Acting Director

Missouri Department of Health and Senior Services

Kansas City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.
- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

Appendix C

Laboratory Analytical Report



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: Lead Analysis

Project / PO Number: 620 East 23rd Avenue / 620 East
Received: 01/16/2024
Reported: 03/05/2024

Analytical Testing Parameters

Client Sample ID: 620-1-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-01

Collected By: Young, Bradley
Collection Date: 12/21/2023 13:30

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1129	RVV

Client Sample ID: 620-2-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-02

Collected By: Young, Bradley
Collection Date: 12/21/2023 13:30

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1138	RVV

Client Sample ID: 620-3-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-03

Collected By: Young, Bradley
Collection Date: 12/21/2023 13:30

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1141	RVV

Client Sample ID: 620-4-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-04

Collected By: Young, Bradley
Collection Date: 12/21/2023 13:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1144	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-5-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-05

Collected By: Young, Brady
Collection Date: 12/21/2023 13:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1147	RVV

Client Sample ID: 620-6-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-06

Collected By: Young, Brady
Collection Date: 12/21/2023 13:32

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1150	RVV

Client Sample ID: 620-7-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-07

Collected By: Young, Brady
Collection Date: 12/21/2023 13:32

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1153	RVV

Client Sample ID: 620-8-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-08

Collected By: Young, Brady
Collection Date: 12/21/2023 13:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1156	RVV

Client Sample ID: 620-9-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-09

Collected By: Young, Brady
Collection Date: 12/21/2023 13:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1205	RVV

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-10-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-10

Collected By: Young, Bradly
Collection Date: 12/21/2023 13:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1208	RVV

Client Sample ID: 620-11-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-11

Collected By: Young, Bradly
Collection Date: 12/21/2023 13:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1211	RVV

Client Sample ID: 620-12-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-12

Collected By: Young, Bradly
Collection Date: 12/21/2023 13:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		02/04/24 0837	02/04/24 1213	RVV

Client Sample ID: 620-13-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-13

Collected By: Young, Bradly
Collection Date: 12/21/2023 13:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/04/24 0837	02/04/24 1216	RVV

Client Sample ID: 620-14-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-14

Collected By: Young, Bradly
Collection Date: 12/21/2023 13:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1219	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-15-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-15

Collected By: Young, Brady
Collection Date: 12/21/2023 13:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1222	RVV

Client Sample ID: 620-16-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-16

Collected By: Young, Brady
Collection Date: 12/21/2023 13:42

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1225	RVV

Client Sample ID: 620-17-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-17

Collected By: Young, Brady
Collection Date: 12/21/2023 13:42

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1228	RVV

Client Sample ID: 620-18-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-18

Collected By: Young, Brady
Collection Date: 12/21/2023 13:44

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1231	RVV

Client Sample ID: 620-19-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-19

Collected By: Young, Brady
Collection Date: 12/21/2023 13:44

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1240	RVV

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-20-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-20

Collected By: Young, Brady
Collection Date: 12/21/2023 15:01

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1243	RVV

Client Sample ID: 620-21-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-21

Collected By: Young, Brady
Collection Date: 12/21/2023 13:47

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1252	RVV

Client Sample ID: 620-22-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-22

Collected By: Young, Brady
Collection Date: 12/21/2023 13:47

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1301	RVV

Client Sample ID: 620-23-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-23

Collected By: Young, Brady
Collection Date: 12/21/2023 13:49

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/04/24 0837	02/04/24 1304	RVV

Client Sample ID: 620-24-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-24

Collected By: Young, Brady
Collection Date: 12/21/2023 13:49

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.6	0.4	ppb	2		02/04/24 0837	02/04/24 1307	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-25-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-25

Collected By: Young, Brady
Collection Date: 12/21/2023 13:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1316	RVV

Client Sample ID: 620-26-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-26

Collected By: Young, Brady
Collection Date: 12/21/2023 13:51

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1319	RVV

Client Sample ID: 620-27-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-27

Collected By: Young, Brady
Collection Date: 12/21/2023 13:52

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1322	RVV

Client Sample ID: 620-28-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-28

Collected By: Young, Brady
Collection Date: 12/21/2023 13:52

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1325	RVV

Client Sample ID: 620-29-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-29

Collected By: Young, Brady
Collection Date: 12/21/2023 13:53

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1328	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-30-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-30

Collected By: Young, Brady
Collection Date: 12/21/2023 13:53

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1331	RVV

Client Sample ID: 620-31-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-31

Collected By: Young, Brady
Collection Date: 12/21/2023 13:54

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1334	RVV

Client Sample ID: 620-32-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-32

Collected By: Young, Brady
Collection Date: 12/21/2023 13:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1337	RVV

Client Sample ID: 620-33-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-33

Collected By: Young, Brady
Collection Date: 12/21/2023 13:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/04/24 0837	02/04/24 1340	RVV

Client Sample ID: 620-34-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-34

Collected By: Young, Brady
Collection Date: 12/21/2023 13:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		02/04/24 0837	02/04/24 1343	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-35-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-35

Collected By: Young, Brady
Collection Date: 12/21/2023 13:56

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/04/24 0837	02/04/24 1351	RVV

Client Sample ID: 620-36-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-36

Collected By: Young, Brady
Collection Date: 12/21/2023 13:57

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1354	RVV

Client Sample ID: 620-37-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-37

Collected By: Young, Brady
Collection Date: 12/21/2023 13:59

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/04/24 0837	02/04/24 1357	RVV

Client Sample ID: 620-38-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-38

Collected By: Young, Brady
Collection Date: 12/21/2023 13:59

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/04/24 0837	02/04/24 1400	RVV

Client Sample ID: 620-39-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-39

Collected By: Young, Brady
Collection Date: 12/21/2023 14:00

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1403	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-40-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-40

Collected By: Young, Brady
Collection Date: 12/21/2023 14:00

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1406	RVV

Client Sample ID: 620-41-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-41

Collected By: Young, Brady
Collection Date: 12/21/2023 14:02

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1415	RVV

Client Sample ID: 620-42-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-42

Collected By: Young, Brady
Collection Date: 12/21/2023 14:02

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/04/24 0837	02/04/24 1430	RVV

Client Sample ID: 620-43-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-43

Collected By: Young, Brady
Collection Date: 12/21/2023 14:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1433	RVV

Client Sample ID: 620-44-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-44

Collected By: Young, Brady
Collection Date: 12/21/2023 14:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1436	RVV

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-45-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-45

Collected By: Young, Brady
Collection Date: 12/21/2023 14:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1439	RVV

Client Sample ID: 620-46-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-46

Collected By: Young, Brady
Collection Date: 12/21/2023 14:05

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1442	RVV

Client Sample ID: 620-47-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-47

Collected By: Young, Brady
Collection Date: 12/21/2023 14:05

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1445	RVV

Client Sample ID: 620-48-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-48

Collected By: Young, Brady
Collection Date: 12/21/2023 14:06

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1448	RVV

Client Sample ID: 620-49-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-49

Collected By: Young, Brady
Collection Date: 12/21/2023 14:06

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1451	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-50-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-50

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:06

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1454	RVV

Client Sample ID: 620-51-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-51

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:07

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1503	RVV

Client Sample ID: 620-52-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-52

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1506	RVV

Client Sample ID: 620-53-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-53

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1509	RVV

Client Sample ID: 620-54-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-54

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1512	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-55-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-55

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:09

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1515	RVV

Client Sample ID: 620-56-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-56

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:09

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1518	RVV

Client Sample ID: 620-57-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-57

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:09

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1521	RVV

Client Sample ID: 620-58-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-58

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:09

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/04/24 0837	02/04/24 1524	RVV

Client Sample ID: 620-59-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-59

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:09

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	7.2	0.4	ppb	2		02/04/24 0837	02/04/24 1527	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-60-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-60

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:11

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1530	RVV

Client Sample ID: 620-61-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-61

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:11

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1545	RVV

Client Sample ID: 620-62-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-62

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:12

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1554	RVV

Client Sample ID: 620-63-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-63

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:12

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1557	RVV

Client Sample ID: 620-64-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-64

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1600	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-65-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-65

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1603	RVV

Client Sample ID: 620-66-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-66

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1606	RVV

Client Sample ID: 620-67-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-67

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:14

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1615	RVV

Client Sample ID: 620-68-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-68

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:14

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1618	RVV

Client Sample ID: 620-69-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-69

Collected By: Young, Bradley
Collection Date: 12/21/2023 14:14

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1621	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-70-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-70

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:15

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1624	RVV

Client Sample ID: 620-71-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-71

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:15

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1627	RVV

Client Sample ID: 620-72-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-72

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:15

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1630	RVV

Client Sample ID: 620-73-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-73

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1633	RVV

Client Sample ID: 620-74-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-74

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1636	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-75-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-75

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1639	RVV

Client Sample ID: 620-76-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-76

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:18

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1642	RVV

Client Sample ID: 620-77-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-77

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:18

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1651	RVV

Client Sample ID: 620-78-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-78

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:21

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		02/04/24 0837	02/04/24 1654	RVV

Client Sample ID: 620-79-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-79

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:21

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.7	0.4	ppb	2		02/04/24 0837	02/04/24 1657	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-80-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-80

Collected By: Young, Brady
Collection Date: 12/21/2023 14:22

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		02/04/24 0837	02/04/24 1700	RVV

Client Sample ID: 620-81-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-81

Collected By: Young, Brady
Collection Date: 12/21/2023 14:22

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.6	0.4	ppb	2		02/04/24 0837	02/04/24 1709	RVV

Client Sample ID: 620-82-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-82

Collected By: Young, Brady
Collection Date: 12/21/2023 14:23

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	14.0	0.4	ppb	2		02/04/24 0837	02/04/24 1718	RVV

Client Sample ID: 620-83-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-83

Collected By: Young, Brady
Collection Date: 12/21/2023 14:24

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.3	0.4	ppb	2		02/04/24 0837	02/04/24 1727	RVV

Client Sample ID: 620-84-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-84

Collected By: Young, Brady
Collection Date: 12/21/2023 14:24

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	8.4	0.4	ppb	2		02/04/24 0837	02/04/24 1730	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-85-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-85

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:25

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	7.9	0.4	ppb	2		02/04/24 0837	02/04/24 1733	RVV

Client Sample ID: 620-86-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-86

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:25

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	5.7	0.4	ppb	2		02/04/24 0837	02/04/24 1736	RVV

Client Sample ID: 620-87-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-87

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:30

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.6	0.4	ppb	2		02/04/24 0837	02/04/24 1739	RVV

Client Sample ID: 620-88-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-88

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:30

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	24.7	0.4	ppb	2		02/04/24 0837	02/04/24 1742	RVV

Client Sample ID: 620-89-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-89

Collected By: Young, Bradly
Collection Date: 12/21/2023 14:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.8	0.4	ppb	2		02/04/24 0837	02/04/24 1745	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Client Sample ID: 620-90-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-90

Collected By: Young, Brady
Collection Date: 12/21/2023 14:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		02/04/24 0837	02/04/24 1748	RVV

Client Sample ID: 620-91-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-91

Collected By: Young, Brady
Collection Date: 01/02/2024 15:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1751	RVV

Client Sample ID: 620-92-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-92

Collected By: Young, Brady
Collection Date: 01/02/2024 15:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1754	RVV

Client Sample ID: 620-93-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-93

Collected By: Young, Brady
Collection Date: 01/02/2024 15:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1803	RVV

Client Sample ID: 620-94-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0067-94

Collected By: Young, Brady
Collection Date: 01/02/2024 15:04

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/04/24 0837	02/04/24 1806	RVV



Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0067

Definitions

DF:	Dilution Factor representing the amount the sample was diluted during analysis and may not represent preparation factors.
RL:	Reporting Limit

Report Comments

Reviewed and Approved By:

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.

Victoria Bruck
Field Technician II
03/05/24 07:10

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER: <u>Bradly Young</u>		NAME: <u>Jeff Hurst</u>		NAME: <u>Jeff Hurst</u>	
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS: <u>620 East 23rd Avenue</u>		ADDRESS: <u>PO Box 47166</u>		ADDRESS: <u>PO Box 47166</u>	
CITY/ST/ZIP: <u>North Kansas City, Missouri 64116</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>	
PHONE: <u>816-321-4702</u>		PHONE: <u>816-678-7894</u>		PHONE: <u>816-678-7894</u>	
		EMAIL: <u>jeffh@axiomservicepros.com</u>		EMAIL: <u>jeffh@axiomservicepros.com</u>	

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	15.1
															Sample Condition	Sample #
620-1-FD	12/21/2023	13:30	NKC High School - Sink Tap - M339-Left	1	Wt	Grab	X									01
620-2-FD	12/21/2023	13:30	NKC High School - Sink Tap - M339-Middle	1	Wt	Grab	X									02
620-3-FD	12/21/2023	13:30	NKC High School - Sink Tap - M339-Right	1	Wt	Grab	X									03
620-4-FD	12/21/2023	13:31	NKC High School - Sink Tap - M337-Left	1	Wt	Grab	X									04
620-5-FD	12/21/2023	13:31	NKC High School - Sink Tap - M337-Middle	1	Wt	Grab	X									05
620-6-FD	12/21/2023	13:32	NKC High School - Sink Tap - M337-Right	1	Wt	Grab	X									06
620-7-FD	12/21/2023	13:32	NKC High School - Sink Tap - M335-Left	1	Wt	Grab	X									07

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
<u>Bradly Young</u>						
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				1/16/24		
	Time:		<u>John McManis</u>	Time:	830	



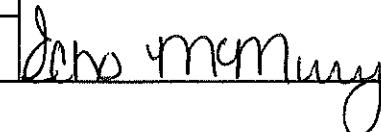
3 H A 0 0 6 7

AXIOM Service Professionals

PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	3H A 0067
														Short Hold:	
														Rush:	
														Temp: oC	15.1
														Sample Condition	Sample #
620-8-FD	12/21/2023	13:33	NKC High School - Sink Tap - M335-Right	1	Wt	Grab	X								08
620-9-FD	12/21/2023	13:33	NKC High School - Drinking Fountain - Outside M330-Left	1	Wt	Grab	X								09
620-10-FD	12/21/2023	13:33	NKC High School - Drinking Fountain - Outside M330-Right	1	Wt	Grab	X								10
620-11-FD	12/21/2023	13:34	NKC High School - Sink Tap - M333	1	Wt	Grab	X								11
620-12-FD	12/21/2023	13:36	NKC High School - Sink Tap - A307	1	Wt	Grab	X								12
620-13-FD	12/21/2023	13:36	NKC High School - Sink Tap - A309	1	Wt	Grab	X								13
620-14-FD	12/21/2023	13:38	NKC High School - Drinking Fountain - Bathrooms by A304- Left	1	Wt	Grab	X								14

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:			Time:	830	



3 H A 0 0 6 7

AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME	# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
						Lead								Wk Order #:	3H A 0 0 6 7
														Short Hold:	
														Rush:	
														Temp: oC	15.1
														Sample Condition	Sample #
620-15-FD	12/21/2023	13:38	NKC High School - Drinking Fountain - Bathrooms by A304-Right	1	Wt	Grab	X								15
620-16-FD	12/21/2023	13:42	NKC High School - Drinking Fountain - Bathrooms by B247-Left	1	Wt	Grab	X								16
620-17-FD	12/21/2023	13:42	NKC High School - Drinking Fountain - Bathrooms by B247-Right	1	Wt	Grab	X								17
620-18-FD	12/21/2023	13:44	NKC High School - Drinking Fountain - Weight Room-Left	1	Wt	Grab	X								18
620-19-FD	12/21/2023	13:44	NKC High School - Drinking Fountain - Weight Room-Right	1	Wt	Grab	X								19
620-20-FD	1/2/2024	15:01	NKC High School - Sink Tap - C255-Teachers Lounge	1	Wt	Grab	X								20
620-21-FD	12/21/2023	13:47	NKC High School - Drinking Fountain - Outside B233-Left	1	Wt	Grab	X								21

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
<i>Becky Jones</i>				
	Time:		Time:	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
			1/16/24	
	Time:	<i>John McManis</i>	Time:	
			830	



3 H A 0 0 6 7

AXIOM Service Professionals

PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	3HA0067
														Short Hold:	
														Rush:	
														Temp: oC	15.1
														Sample Condition	Sample #
620-22-FD	12/21/2023	13:47	NKC High School - Drinking Fountain - Outside B233-Right	1	Wt	Grab	X								22
620-23-FD	12/21/2023	13:49	NKC High School - Sink Tap - M232.1	1	Wt	Grab	X								23
620-24-FD	12/21/2023	13:49	NKC High School - Sink Tap - M232.1	1	Wt	Grab	X								24
620-25-FD	12/21/2023	13:50	NKC High School - Ice Machine - M232.1	1	Wt	Grab	X								25
620-26-FD	12/21/2023	13:51	NKC High School - Sink Tap - M245.1	1	Wt	Grab	X								26
620-27-FD	12/21/2023	13:52	NKC High School - Drinking Fountain - Outside M239-Left	1	Wt	Grab	X								27
620-28-FD	12/21/2023	13:52	NKC High School - Drinking Fountain - Outside M239-Right	1	Wt	Grab	X								28


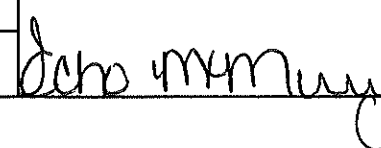
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
<i>Bryce J...</i>	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	1/10/24	
	Time:		<i>John M...</i>	Time:	830	



3 H A 0 0 6 7
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3HAC0067
															Short Hold:	
															Rush:	
															Temp: oC	15.1
															Sample Condition	Sample #
620-29-FD	12/21/2023	13:53	NKC High School - Drinking Fountain - Outside M112-Left	1	Wt	Grab	X									29
620-30-FD	12/21/2023	13:53	NKC High School - Drinking Fountain - Outside M112-Right	1	Wt	Grab	X									30
620-31-FD	12/21/2023	13:54	NKC High School - Sink Tap - M159 Breakroom	1	Wt	Grab	X									31
620-32-FD	12/21/2023	13:55	NKC High School - Sink Tap - M104-Nurse	1	Wt	Grab	X									32
620-33-FD	12/21/2023	13:55	NKC High School - Ice Machine - M104-Nurse	1	Wt	Grab	X									33
620-34-FD	12/21/2023	13:55	NKC High School - Sink Tap - M104.2-Nurse	1	Wt	Grab	X									34
620-35-FD	12/21/2023	13:56	NKC High School - Sink Tap - M121-Closest to Door	1	Wt	Grab	X									35

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:			Time:	830	



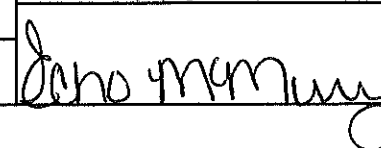
3 H A 0 0 6 7

AXIOM Service Professionals

PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	15.1
															Sample Condition	Sample #
620-36-FD	12/21/2023	13:57	NKC High School - Sink Tap - M121	1	Wt	Grab	X									36
620-37-FD	12/21/2023	13:59	NKC High School - Sink Tap - A106	1	Wt	Grab	X									37
620-38-FD	12/21/2023	13:59	NKC High School - Sink Tap - A104	1	Wt	Grab	X									38
620-39-FD	12/21/2023	14:00	NKC High School - Drinking Fountain - Outside A109-Left	1	Wt	Grab	X									39
620-40-FD	12/21/2023	14:00	NKC High School - Drinking Fountain - Outside A109-Right	1	Wt	Grab	X									40
620-41-FD	12/21/2023	14:01	NKC High School - Sink Tap - A109	1	Wt	Grab	X									41
620-42-FD	12/21/2023	14:02	NKC High School - Sink Tap - A110	1	Wt	Grab	X									42

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			1/16/24		
				Time:	830	




3 H A 0 0 6 7

AXIOM Service Professionals

PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	15.1
															Sample Condition	Sample #
620-43-FD	12/21/2023	14:03	NKC High School - Sink Tap - A112-Left	1	Wt	Grab	X									43
620-44-FD	12/21/2023	14:03	NKC High School - Sink Tap - A112-Middle	1	Wt	Grab	X									44
620-45-FD	12/21/2023	14:03	NKC High School - Sink Tap - A112-Right	1	Wt	Grab	X									45
620-46-FD	12/21/2023	14:05	NKC High School - Drinking Fountain - Bathrooms Outside A102-Left	1	Wt	Grab	X									46
620-47-FD	12/21/2023	14:05	NKC High School - Drinking Fountain - Bathrooms Outside A102-Right	1	Wt	Grab	X									47
620-48-FD	12/21/2023	14:06	NKC High School - Sink Tap - B143-3Bay Sink	1	Wt	Grab	X									48
620-49-FD	12/21/2023	14:06	NKC High School - Sink Tap - B143-Next to 3 Bay Sink	1	Wt	Grab	X									49


Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
Time:		Time:		
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
			1/16/24	
Time:			Time:	
			830	



3 H A 0 0 6 7
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3HAC067
															Short Hold:	
															Rush:	
															Temp: oC	15.1
															Sample Condition	Sample #
620-50-FD	12/21/2023	14:06	NKC High School - Sink Tap - B143- Next to Oven	1	Wt	Grab	X									50
620-51-FD	12/21/2023	14:07	NKC High School - Sink Tap - B143-Next to Oven-Right	1	Wt	Grab	X									51
620-52-FD	12/21/2023	14:08	NKC High School - Sink Tap - B145-Northeast Sink	1	Wt	Grab	X									52
620-53-FD	12/21/2023	14:08	NKC High School - Sink Tap - B145-North Middle Sink	1	Wt	Grab	X									53
620-54-FD	12/21/2023	14:08	NKC High School - Sink Tap - B145-South Middle Sink	1	Wt	Grab	X									54
620-55-FD	12/21/2023	14:09	NKC High School - Sink Tap - B145-Southeast Sink	1	Wt	Grab	X									55
620-56-FD	12/21/2023	14:09	NKC High School - Sink Tap - B145-South Sink	1	Wt	Grab	X									56

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
			1/16/24	
			830	

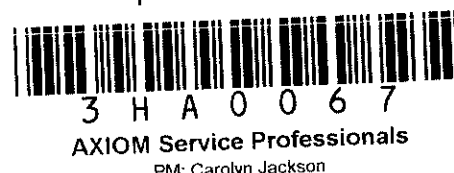


3 H A 0 0 6 7
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

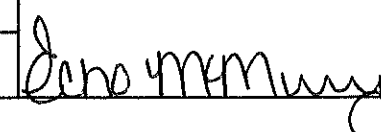
CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED							LAB USE ONLY	
															Wk Order #:	3H A 0067
															Short Hold:	
															Rush:	
															Temp: oC	15.1
															Sample Condition	Sample #
620-57-FD	12/21/2023	14:09	NKC High School - Sink Tap - B145-Southwest Sink	1	Wt	Grab	X									57
620-58-FD	12/21/2023	14:09	NKC High School - Sink Tap - B145-Northwest Sink	1	Wt	Grab	X									58
620-59-FD	12/21/2023	14:09	NKC High School - Sink Tap - B145-North Sink	1	Wt	Grab	X									59
620-60-FD	12/21/2023	14:11	NKC High School - Drinking Fountain - Bathrooms by Cafe-Left	1	Wt	Grab	X									60
620-61-FD	12/21/2023	14:11	NKC High School - Drinking Fountain - Bathrooms by Cafe-Right	1	Wt	Grab	X									61
620-62-FD	12/21/2023	14:12	NKC High School - Sink Tap - Kitchen-Handwashing by Ice Machine	1	Wt	Grab	X									62
620-63-FD	12/21/2023	14:12	NKC High School - Sink Tap - Kitchen-3 Bay Sink Right	1	Wt	Grab	X									63

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
			1/14/23	
			830	



PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER: _____		NAME: Jeff Hurst		NAME: Jeff Hurst	
SITE NAME: _____		CO. NAME: _____		CO. NAME: _____	
ADDRESS: 620 East 23rd Avenue		ADDRESS: PO Box 47166		ADDRESS: PO Box 47166	
CITY/ST/ZIP: North Kansas City, Missouri 64116		CITY/ST/ZIP: Kansas City, Missouri 64188		CITY/ST/ZIP: Kansas City, Missouri 64188	
PHONE: 816-321-4702		PHONE: 816-678-7894		PHONE: 816-678-7894	
		EMAIL: jeffh@axiomservicepros.com		EMAIL: jeffh@axiomservicepros.com	

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp:	oC
															Sample Condition	Sample #
620-64-FD	12/21/2023	14:13	NKC High School - Sink Tap - Kitchen-3 Bay Sink-Middle	1	Wt	Grab	X									64
620-65-FD	12/21/2023	14:13	NKC High School - Sink Tap - Kitchen-3 Bay Sink-Left	1	Wt	Grab	X									65
620-66-FD	12/21/2023	14:13	NKC High School - Sink Tap - Kitchen-West Sink	1	Wt	Grab	X									66
620-67-FD	12/21/2023	14:14	NKC High School - Sink Tap - Kitchen-Northwest Sink	1	Wt	Grab	X									67
620-68-FD	12/21/2023	14:14	NKC High School - Pot Filler - Kitchen	1	Wt	Grab	X									68
620-69-FD	12/21/2023	14:14	NKC High School - Sink Tap - Kitchen-Middle Left Sink	1	Wt	Grab	X									69
620-70-FD	12/21/2023	14:15	NKC High School - Sink Tap - Kitchen-Middle Right Sink	1	Wt	Grab	X									70

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
	Time:		Time:	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
			1/16/24	
	Time:		Time:	
			830	




3 H A 0 0 6 7

AXIOM Service Professionals

PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3H A 0 0 6 7
															Short Hold:	
															Rush:	
															Temp: oC	15.1
															Sample Condition	Sample #
620-71-FD	12/21/2023	14:15	NKC High School - Sink Tap - Kitchen-Northeast Handwashing Sink	1	Wt	Grab	X									71
620-72-FD	12/21/2023	14:15	NKC High School - Ice Machine - Kitchen	1	Wt	Grab	X									72
620-73-FD	12/21/2023	14:16	NKC High School - Sink Tap - Concessions-Handwashing Sink	1	Wt	Grab	X									73
620-74-FD	12/21/2023	14:16	NKC High School - Sink Tap - Concessions-3 Bay Sink-Left	1	Wt	Grab	X									74
620-75-FD	12/21/2023	14:16	NKC High School - Sink Tap - Concessions-3 Bay Sink-Right	1	Wt	Grab	X									75
620-76-FD	12/21/2023	14:18	NKC High School - Sink Tap - C167	1	Wt	Grab	X									76
620-77-FD	12/21/2023	14:18	NKC High School - Ice Machine - C167	1	Wt	Grab	X									77


Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
			1/16/24	
			830	



3 H A 0 0 6 7
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	15.1
														Sample Condition	Sample #
620-78-FD	12/21/2023	14:21	NKC High School - Outside Hydrant - By Exit 1	1	Wt	Grab	X								78
620-79-FD	12/21/2023	14:21	NKC High School - Outside Hydrant - Southwest Corner	1	Wt	Grab	X								79
620-80-FD	12/21/2023	14:22	NKC High School - Outside Hydrant - By Exit Door 5	1	Wt	Grab	X								80
620-81-FD	12/21/2023	14:22	NKC High School - Outside Hydrant - Courtyard by Exit 6	1	Wt	Grab	X								81
620-82-FD	12/21/2023	14:23	NKC High School - Outside Hydrant - North of Courtyard by Exit 6	1	Wt	Grab	X								82
620-83-FD	12/21/2023	14:24	NKC High School - Outside Hydrant - Courtyard by Exit 8	1	Wt	Grab	X								83
620-84-FD	12/21/2023	14:24	NKC High School - Outside Hydrant - By Exit Door 11	1	Wt	Grab	X								84

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
						
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
						
	Time:			Time:	830	



PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3H A 0067
															Short Hold:	
															Rush:	
															Temp: oC	15.1
															Sample Condition	Sample #
620-85-FD	12/21/2023	14:25	NKC High School - Outside Hydrant - By Exit Door 15	1	Wt	Grab	X									85
620-86-FD	12/21/2023	14:25	NKC High School - Outside Hydrant - Outside Exit Door 16	1	Wt	Grab	X									86
620-87-FD	12/21/2023	14:30	NKC High School - Outside Hydrant - North of Exit Door 18	1	Wt	Grab	X									87
620-88-FD	12/21/2023	14:30	NKC High School - Outside Hydrant - South of Exit Door 18	1	Wt	Grab	X									88
620-89-FD	12/21/2023	14:31	NKC High School - Outside Hydrant - West of Exit Door 20	1	Wt	Grab	X									89
620-90-FD	12/21/2023	14:34	NKC High School - Outside Hydrant - North of Exit Door 21	1	Wt	Grab	X									90
620-91-FD	1/2/2024	15:03	NKC High School - Drinking Fountain - Gym-East-Left	1	Wt	Grab	X									91


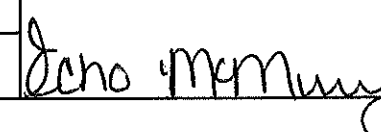
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:			Time:	830	



3 H A 0 0 6 7
AXIOM Service Professionals
PM: Carolyn Jackson

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	620 East 23rd Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	North Kansas City, Missouri 64116	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3HA0067
															Short Hold:	
															Rush:	
															Temp: oC	15.1
															Sample Condition	Sample #
620-92-FD	1/2/2024	15:03	NKC High School - Drinking Fountain - Gym-East-Right	1	Wt	Grab	X									92
620-93-FD	1/2/2024	15:03	NKC High School - Drinking Fountain - Gym-West-Left	1	Wt	Grab	X									93
620-94-FD	1/2/2024	15:04	NKC High School - Drinking Fountain - Gym-West-Right	1	Wt	Grab	X									94

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				1/14/24		
	Time:			Time:	8:50	



3 H A 0 0 6 7
AXIOM Service Professionals
PM: Carolyn Jackson

Appendix D

Photo Log



12/21/2023 - 620-1 - NKC High School - M339-Left



12/21/2023 - 620-2 - NKC High School - M339-Middle



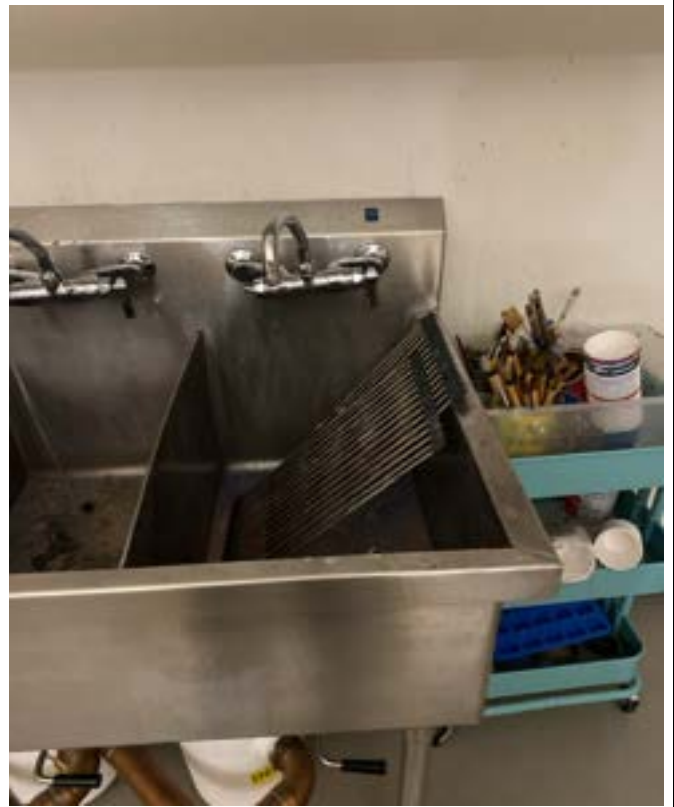
12/21/2023 - 620-3 - NKC High School - M339-Right



12/21/2023 - 620-4 - NKC High School - M337-Left



12/21/2023 - 620-5 - NKC High School - M337-
Middle



12/21/2023 - 620-6 - NKC High School - M337-
Right



12/21/2023 - 620-7 - NKC High School - M335-
Left



12/21/2023 - 620-8 - NKC High School - M335-
Right



12/21/2023 - 620-9 - NKC High School - Outside
M310-Left



12/21/2023 - 620-10 - NKC High School - Outside
M310-Right



12/21/2023 - 620-11 - NKC High School - M333



12/21/2023 - 620-12 - NKC High School - A307



12/21/2023 - 620-13 - NKC High School - A309



12/21/2023 - 620-14 - NKC High School - Restrooms by A304- Left



12/21/2023 - 620-15 - NKC High School - Restrooms by A304- Right



12/21/2023 - 620-16 - NKC High School - Restrooms by B247-Left



12/21/2023 - 620-17 - NKC High School - Restrooms by B247-Right



12/21/2023 - 620-18 - NKC High School - Weight Room-Left



12/21/2023 - 620-19 - NKC High School - Weight Room-Right



12/21/2023 - 620-20 - NKC High School - C255-Teachers Lounge



12/21/2023 - 620-21 - NKC High School - Outside B233-Left



12/21/2023 - 620-22 - NKC High School - Outside B233-Right



12/21/2023 - 620-23 - NKC High School - M232.1



12/21/2023 - 620-24 - NKC High School - M232.1



12/21/2023 - 620-25 - NKC High School - M232.1



12/21/2023 - 620-26 - NKC High School - M245.1



12/21/2023 - 620-27 - NKC High School - Outside
M239-Left



12/21/2023 - 620-28 - NKC High School - Outside
M239-Right



12/21/2023 - 620-29 - NKC High School - Outside
M112-Left



12/21/2023 - 620-30 - NKC High School - Outside
M112-Right



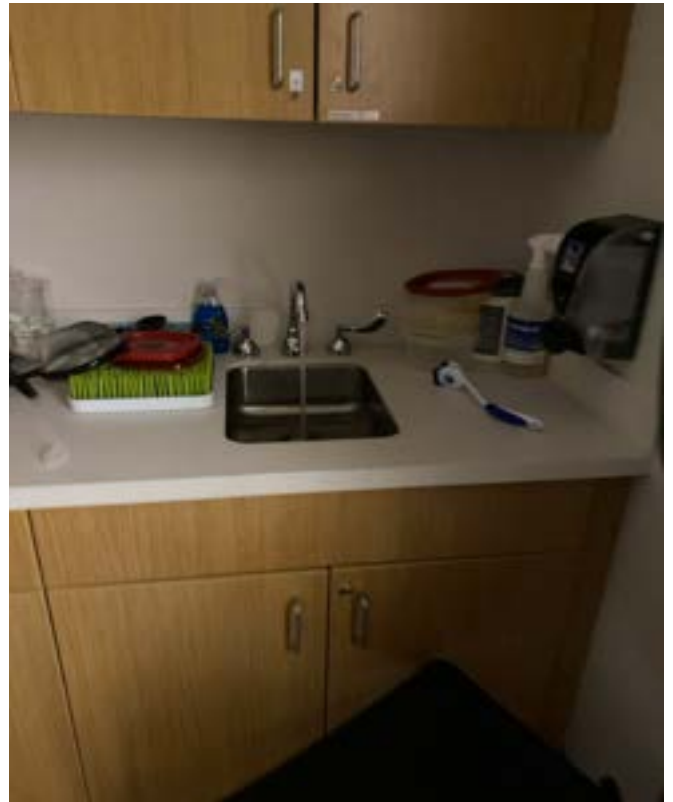
12/21/2023 - 620-31 - NKC High School - M159
Breakroom



12/21/2023 - 620-32 - NKC High School - M104-
Nurse



12/21/2023 - 620-33 - NKC High School - M104-
Nurse



12/21/2023 - 620-34 - NKC High School - M104.2-
Nurse



12/21/2023 - 620-35 - NKC High School - M121-
Closest to Door



12/21/2023 - 620-36 - NKC High School - M121



12/21/2023 - 620-37 - NKC High School - A106



12/21/2023 - 620-38 - NKC High School - A104



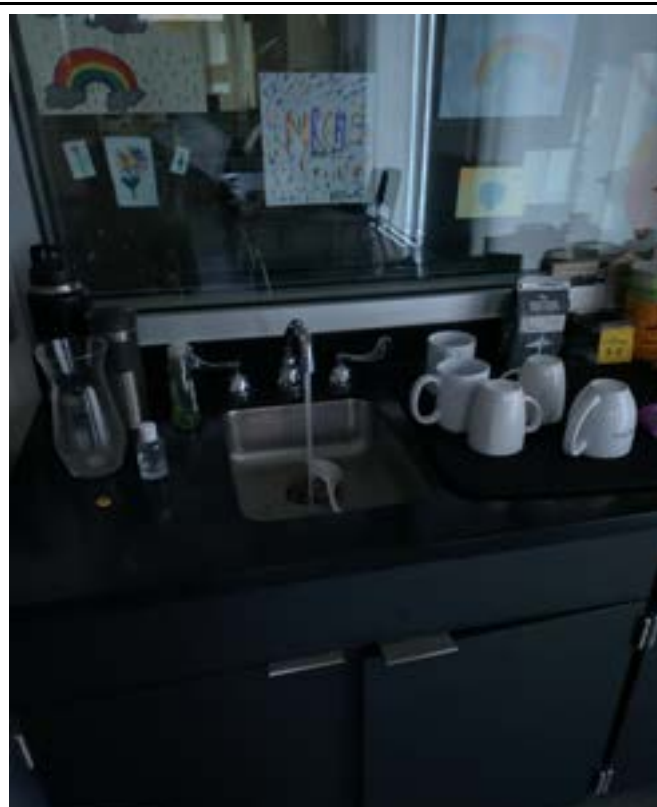
12/21/2023 - 620-39 - NKC High School - Outside
A109-Left



12/21/2023 - 620-40 - NKC High School - Outside
A109-Right



12/21/2023 - 620-41 - NKC High School - A109



12/21/2023 - 620-42 - NKC High School - A110



12/21/2023 - 620-43 - NKC High School - A112-
Left



12/21/2023 - 620-44 - NKC High School - A112-
Middle



12/21/2023 - 620-45 - NKC High School - A112-Right



12/21/2023 - 620-46 - NKC High School - Restrooms Outside A102-Left



12/21/2023 - 620-47 - NKC High School - Restrooms Outside A102-Right



12/21/2023 - 620-48 - NKC High School - B143-Three Bay Sink



12/21/2023 - 620-49 - NKC High School - B143-
Next to Three Bay Sink



12/21/2023 - 620-50 - NKC High School - B143-
Next to Oven



12/21/2023 - 620-51 - NKC High School - B143-
Next to Oven-Right



12/21/2023 - 620-52 - NKC High School - B145-
Northeast Sink



12/21/2023 - 620-53 - NKC High School - B145-
North Middle Sink



12/21/2023 - 620-54 - NKC High School - B145-
South Middle Sink



12/21/2023 - 620-55 - NKC High School - B145-
Southeast Sink



12/21/2023 - 620-56 - NKC High School - B145-
South Sink



12/21/2023 - 620-57 - NKC High School - B145-
Southwest Sink



12/21/2023 - 620-58 - NKC High School - B145-
Northwest Sink



12/21/2023 - 620-59 - NKC High School - B145-
North Sink



12/21/2023 - 620-60 - NKC High School -
Restrooms by Cafe-Left



12/21/2023 - 620-61 - NKC High School - Restrooms by Cafe-Right



12/21/2023 - 620-62 - NKC High School - Kitchen- Handwashing by Ice Machine



12/21/2023 - 620-63 - NKC High School - Kitchen- Three Bay Sink Right



12/21/2023 - 620-64 - NKC High School - Kitchen- Three Bay Sink-Middle



12/21/2023 - 620-65 - NKC High School - Kitchen-
Three Bay Sink-Left



12/21/2023 - 620-66 - NKC High School - Kitchen-
West Sink



12/21/2023 - 620-67 - NKC High School - Kitchen-
Northwest Sink



12/21/2023 - 620-68 - NKC High School - Kitchen



12/21/2023 - 620-69 - NKC High School - Kitchen-
Middle Left Sink



12/21/2023 - 620-70 - NKC High School - Kitchen-
Middle Right Sink



12/21/2023 - 620-71 - NKC High School - Kitchen-
Northeast Handwashing Sink



12/21/2023 - 620-72 - NKC High School - Kitchen



12/21/2023 - 620-73 - NKC High School -
Concessions-Handwashing Sink



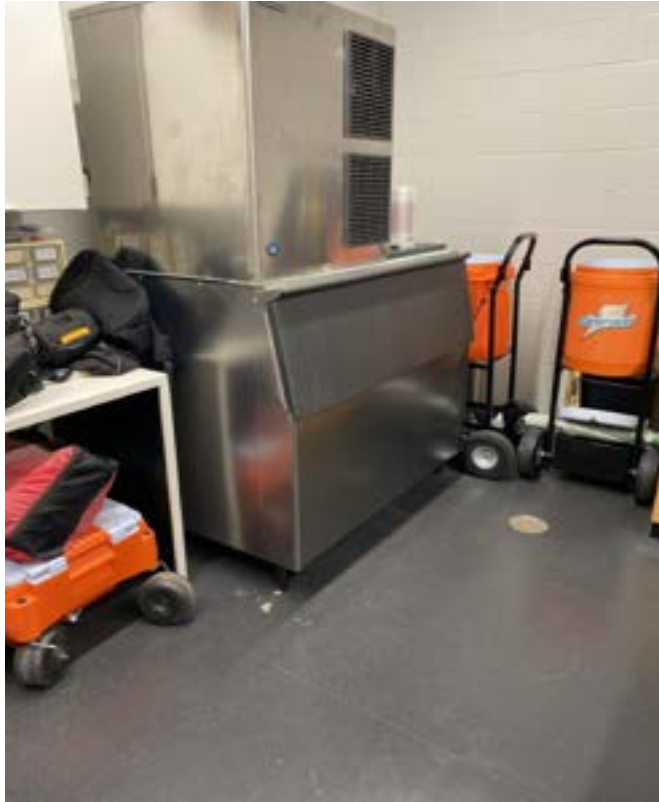
12/21/2023 - 620-74 - NKC High School -
Concessions-Three Bay Sink-Left



12/21/2023 - 620-75 - NKC High School -
Concessions-Three Bay Sink-Right



12/21/2023 - 620-76 - NKC High School - C167



12/21/2023 - 620-77 - NKC High School - C167



12/21/2023 - 620-78 - NKC High School - By Exit
1



12/21/2023 - 620-79 - NKC High School -
Southwest Corner



12/21/2023 - 620-81 - NKC High School -
Courtyard by Exit 6



12/21/2023 - 620-82 - NKC High School - North of Courtyard by Exit 6



12/21/2023 - 620-83 - NKC High School - Courtyard by Exit 8



12/21/2023 - 620-84 - NKC High School - By Exit Door 11



12/21/2023 - 620-85 - NKC High School - By Exit Door 15



12/21/2023 - 620-86 - NKC High School - Outside Exit Door 16



12/21/2023 - 620-87 - NKC High School - North of Exit Door 18



12/21/2023 - 620-88 - NKC High School - South of Exit Door 18



12/21/2023 - 620-89 - NKC High School - West of Exit Door 20



12/21/2023 - 620-90 - NKC High School - North of Exit Door 21



01/02/2024 - 620-91 - NKC High School - Gym-East-Left



01/02/2024 - 620-92 - NKC High School - Gym-East-Right



01/02/2024 - 620-93 - NKC High School - Gym-West-Left



01/02/2024 - 620-94 - NKC High School -
Gym-West-Right

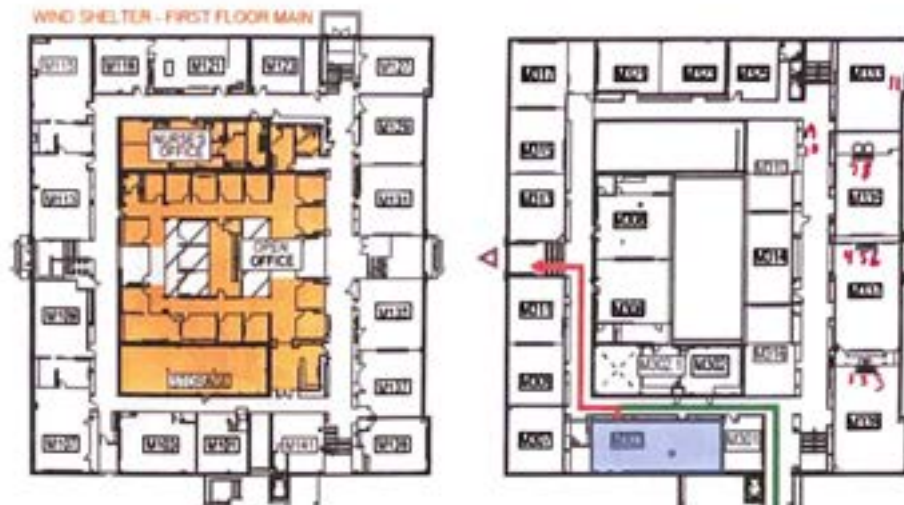
Appendix E

Source Identification Diagram

ASP was provided sample locations by
North Kansas City School District

LEGEND

-  YOU ARE HERE
-  PRIMARY EXIT ROUTE
-  SECONDARY EXIT ROUTE
-  HIGH WIND SHELTER
-  PROCEED TO THE FOOTBALL FIELD AND AWAIT DIRECTION



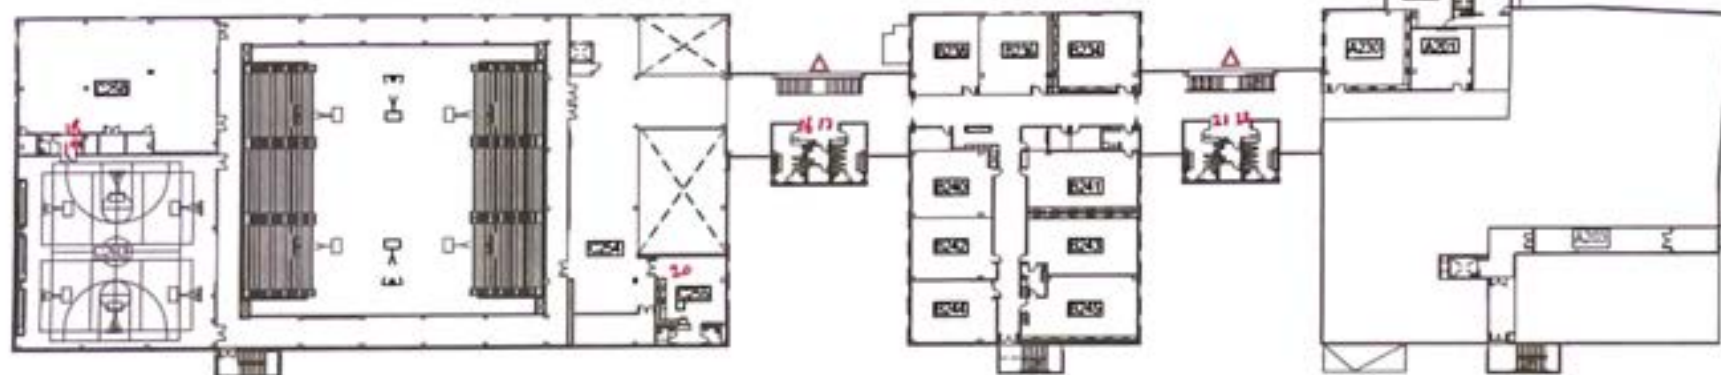
NKCSD

**NORTH KANSAS CITY SCHOOLS
BUILDING PLAN**

M303

Architect **bnim**

By **bnim**



NKCSD


**NORTH KANSAS CITY SCHOOLS
BUILDING PLAN**

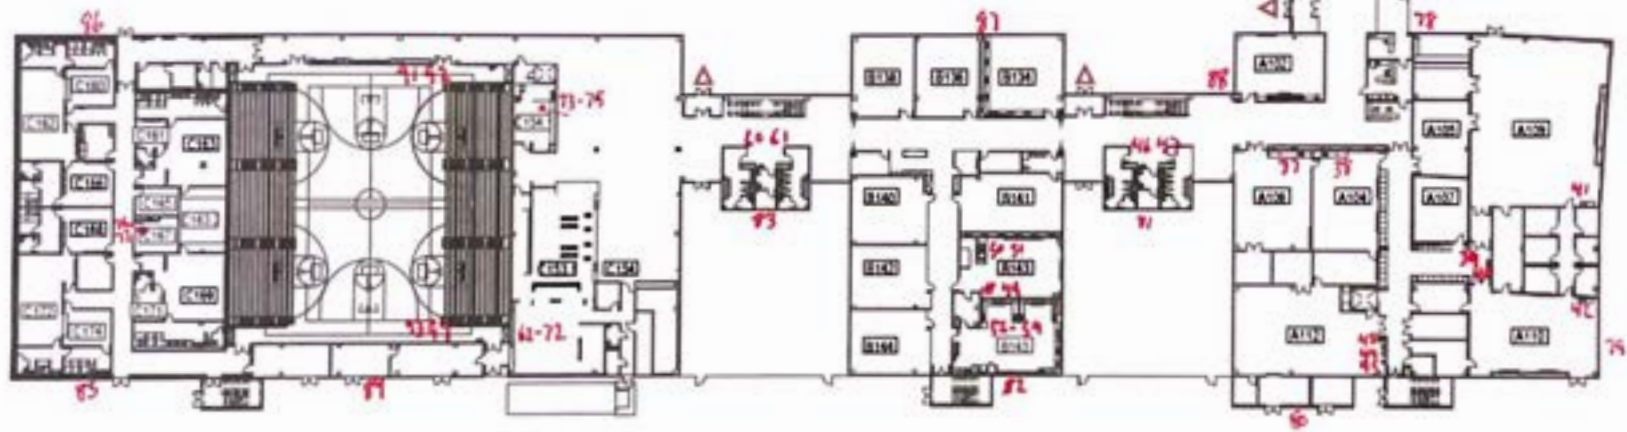
M201

Architect **bnim**

By **bnim**

LEGEND

-  YOU ARE HERE
-  PRIMARY EXIT ROUTE
-  SECONDARY EXIT ROUTE
-  HIGH WIND SHELTER
-  PROCEED TO THE FOOTBALL FIELD AND AWAIT DIRECTION



NKCSD

**NORTH KANSAS CITY SCHOOLS
BUILDING PLAN**

M101

Architect **bnim**

By **bnim**