



March 25, 2024

North Kansas City School District  
2000 Northeast 46th Street  
Kansas City, Missouri 64116

**Project: Limited Lead in Drinking Water Testing**

**Address: 2800 Northeast Shoal Creek Parkway, Kansas City, Missouri 64156**

On December 27, 2023, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 118 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

**Drinking Water Standards**

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of "lead free" to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of "lead free" as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: <https://www.epa.gov/dwreginfo/lead-and-copper-rule>

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.

Reference: [https://www.senate.mo.gov/22info/BTS\\_Web/Bill.aspx?SessionType=R&BillID=71259862](https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862)

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school's buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

### Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

### Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in **red text**.

### December 27, 2023 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
2800-1-FD	Staley High School - Weight Room-Left	Drinking Fountain	First Draw	<0.4
2800-2-FD	Staley High School - Weight Room-Right	Drinking Fountain	First Draw	<0.4
2800-3-FD	Staley High School - Outside PE208	Bottle Filler	First Draw	<0.4
2800-4-FD	Staley High School - Outside PE205	Bottle Filler	First Draw	<0.4
2800-5-FD	Staley High School - Outside PE205-Left	Drinking Fountain	First Draw	<0.4
2800-6-FD	Staley High School - Outside PE205-Right	Drinking Fountain	First Draw	<0.4
2800-7-FD	Staley High School - PE205	Sink Tap	First Draw	3.1

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
2800-8-FD	Staley High School - Nurse's Office	Sink Tap	First Draw	<0.4
2800-9-FD	Staley High School - Nurse's Office	Sink Tap	First Draw	1.2
2800-10-FD	Staley High School - FP205	Sink Tap	First Draw	0.9
2800-11-FD	Staley High School - FP208-Left	Sink Tap	First Draw	0.6
2800-12-FD	Staley High School - FP208-Middle	Sink Tap	First Draw	1
2800-13-FD	Staley High School - FP208-Right	Sink Tap	First Draw	<0.4
2800-14-FD	Staley High School - FP209-Left	Sink Tap	First Draw	1.2
2800-15-FD	Staley High School - FP209-Middle	Sink Tap	First Draw	0.5
2800-16-FD	Staley High School - FP209-Right	Sink Tap	First Draw	0.8
2800-17-FD	Staley High School - FP211-Far Left	Sink Tap	First Draw	1.2
2800-18-FD	Staley High School - FP211-Left Middle	Sink Tap	First Draw	0.4
2800-19-FD	Staley High School - FP211-Right Middle	Sink Tap	First Draw	0.6
2800-20-FD	Staley High School - FP211-Far Right	Sink Tap	First Draw	0.4
2800-21-FD	Staley High School - CR202	Sink Tap	First Draw	0.5
2800-22-FD	Staley High School - CR206	Sink Tap	First Draw	1.9
2800-23-FD	Staley High School - Outside CR206-Far Left	Drinking Fountain	First Draw	<0.4
2800-24-FD	Staley High School - Outside CR206-Left Middle	Drinking Fountain	First Draw	<0.4
2800-25-FD	Staley High School - Outside CR206-Right Middle	Drinking Fountain	First Draw	<0.4
2800-26-FD	Staley High School - Outside CR206-Far Right	Drinking Fountain	First Draw	<0.4
2800-27-FD	Staley High School - CR226	Sink Tap	First Draw	0.5
2800-28-FD	Staley High School - CR277-Left	Sink Tap	First Draw	<0.4
2800-29-FD	Staley High School - CR277	Sink Tap	First Draw	0.9
2800-30-FD	Staley High School - CR277-Right	Sink Tap	First Draw	<0.4
2800-31-FD	Staley High School - CR275	Sink Tap	First Draw	2.1
2800-32-FD	Staley High School - Outside CR226-Far Left-Left	Drinking Fountain	First Draw	<0.4
2800-33-FD	Staley High School - Outside CR226-Far Left-Right	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
2800-34-FD	Staley High School - Outside CR226-Middle-Left	Drinking Fountain	First Draw	<0.4
2800-35-FD	Staley High School - Outside CR226-Middle-Right	Drinking Fountain	First Draw	<0.4
2800-36-FD	Staley High School - Outside CR226-Far Right-Left	Drinking Fountain	First Draw	<0.4
2800-37-FD	Staley High School - Outside CR226-Far Right-Right	Drinking Fountain	First Draw	<0.4
2800-38-FD	Staley High School - CR273	Sink Tap	First Draw	<0.4
2800-39-FD	Staley High School - Counseling Office Break Room	Sink Tap	First Draw	<0.4
2800-40-FD	Staley High School - LMC Office	Sink Tap	First Draw	0.6
2800-41-FD	Staley High School - SEC Kitchenette	Sink Tap	First Draw	0.7
2800-42-FD	Staley High School - CR148	Sink Tap	First Draw	<0.4
2800-43-FD	Staley High School - Outside CR108	Drinking Fountain	First Draw	<0.4
2800-44-FD	Staley High School - Outside CR108	Drinking Fountain	First Draw	<0.4
2800-45-FD	Staley High School - Outside CR108	Drinking Fountain	First Draw	<0.4
2800-46-FD	Staley High School - Outside CR108	Drinking Fountain	First Draw	<0.4
2800-47-FD	Staley High School - Outside CR170-Third from Left	Drinking Fountain	First Draw	<0.4
2800-48-FD	Staley High School - Outside CR170-Fourth from Left	Drinking Fountain	First Draw	<0.4
2800-49-FD	Staley High School - Outside CR170-Fifth from Left	Drinking Fountain	First Draw	<0.4
2800-50-FD	Staley High School - Outside CR170-Far Right	Drinking Fountain	First Draw	<0.4
2800-51-FD	Staley High School - CR183-Handwashing Sink	Sink Tap	First Draw	0.6
2800-52-FD	Staley High School - CR183-West Sink	Sink Tap	First Draw	<0.4
2800-53-FD	Staley High School - CR183-Northwest Handwashing Sink	Sink Tap	First Draw	0.6
2800-54-FD	Staley High School - CR183-East Middle Sink	Sink Tap	First Draw	<0.4
2800-55-FD	Staley High School - CR183-East Middle Handwashing Sink	Sink Tap	First Draw	<0.4
2800-56-FD	Staley High School - CR183-Southeast Handwashing Sink	Sink Tap	First Draw	1
2800-57-FD	Staley High School - CR183-East Two Bay Sink-Left	Sink Tap	First Draw	<0.4
2800-58-FD	Staley High School - CR183-East Two Bay Sink-Right	Sink Tap	First Draw	<0.4
2800-59-FD	Staley High School - CR183-East Garbage Sink	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
2800-60-FD	Staley High School - Faculty Dining	Sink Tap	First Draw	<0.4
2800-61-FD	Staley High School - Kitchen-West Middle Sink	Sink Tap	First Draw	0.4
2800-62-FD	Staley High School - Kitchen-Middle Sink	Sink Tap	First Draw	<0.4
2800-63-FD	Staley High School - Kitchen-East Wall-Left	Sink Tap	First Draw	<0.4
2800-64-FD	Staley High School - Kitchen-East Wall-Right	Sink Tap	First Draw	<0.4
2800-65-FD	Staley High School - Kitchen-Southeast Handwashing Sink	Sink Tap	First Draw	0.5
2800-66-FD	Staley High School - Kitchen	Steam Kettle	First Draw	0.5
2800-67-FD	Staley High School - Kitchen	Pot Filler	First Draw	0.9
2800-68-FD	Staley High School - Kitchen	Pot Filler	First Draw	2.7
2800-69-FD	Staley High School - Kitchen	Ice Machine	First Draw	<0.4
2800-70-FD	Staley High School - Kitchen-Southwest Handwashing Sink	Sink Tap	First Draw	<0.4
2800-71-FD	Staley High School - Kitchen-Northwest Handwashing	Sink Tap	First Draw	<0.4
2800-72-FD	Staley High School - North of Kitchen	Drinking Fountain	First Draw	<0.4
2800-73-FD	Staley High School - FP146	Sink Tap	First Draw	1.2
2800-74-FD	Staley High School - Outside FP146-Left	Drinking Fountain	First Draw	<0.4
2800-75-FD	Staley High School - Outside FP146-Right	Drinking Fountain	First Draw	<0.4
2800-76-FD	Staley High School - FP152-Left	Sink Tap	First Draw	<0.4
2800-77-FD	Staley High School - FP152-Right	Sink Tap	First Draw	1.1
2800-78-FD	Staley High School - FP155-Left	Sink Tap	First Draw	2.1
2800-79-FD	Staley High School - FP155-Right	Sink Tap	First Draw	0.6
2800-80-FD	Staley High School - FP118-Left	Sink Tap	First Draw	6.1
2800-81-FD	Staley High School - FP118-Right	Sink Tap	First Draw	5.8
2800-82-FD	Staley High School - FP117-Right	Sink Tap	First Draw	7.9
2800-83-FD	Staley High School - FP117-Left	Sink Tap	First Draw	2.1
2800-84-FD	Staley High School - FP115	Sink Tap	First Draw	1.7
2800-85-FD	Staley High School - FP115-Right	Sink Tap	First Draw	<0.4



Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
2800-86-FD	Staley High School - FP110	Sink Tap	First Draw	<0.4
2800-87-FD	Staley High School - FP104	Sink Tap	First Draw	0.7
2800-88-FD	Staley High School - FP103	Sink Tap	First Draw	94.2
2800-89-FD	Staley High School - FP103-East Handwashing Sink	Sink Tap	First Draw	1.1
2800-90-FD	Staley High School - FP103-East Wall Left Sink	Sink Tap	First Draw	3.9
2800-91-FD	Staley High School - FP103-East Wall-Middle	Sink Tap	First Draw	10.3
2800-92-FD	Staley High School - FP103-Garbage Sink	Sink Tap	First Draw	<0.4
2800-93-FD	Staley High School - FP102-Teacher Sink	Sink Tap	First Draw	<0.4
2800-94-FD	Staley High School - FP102-Southeast Sink	Sink Tap	First Draw	<0.4
2800-95-FD	Staley High School - FP102-East Middle Sink	Sink Tap	First Draw	<0.4
2800-96-FD	Staley High School - FP102-Northeast Sink	Sink Tap	First Draw	<0.4
2800-97-FD	Staley High School - FP102-Northwest Sink	Sink Tap	First Draw	0.4
2800-98-FD	Staley High School - FP102-West Middle Sink	Sink Tap	First Draw	<0.4
2800-99-FD	Staley High School - FP102-Southwest Sink	Sink Tap	First Draw	<0.4
2800-100-FD	Staley High School - FP102	Ice Machine	First Draw	0.6
2800-101-FD	Staley High School - FP102-Storage Room	Sink Tap	First Draw	1.9
2800-102-FD	Staley High School - Concessions-Left	Sink Tap	First Draw	1.4
2800-103-FD	Staley High School - Concessions-Handwashing Sink	Sink Tap	First Draw	1
2800-104-FD	Staley High School - Restroom by Concessions-Left	Drinking Fountain	First Draw	<0.4
2800-105-FD	Staley High School - Restroom by Concessions-Right	Drinking Fountain	First Draw	<0.4
2800-106-FD	Staley High School - Training Room	Sink Tap	First Draw	1.7
2800-107-FD	Staley High School - Training Room Closet	Sink Tap	First Draw	1.2
2800-108-FD	Staley High School - Outside Men's Locker Room-Far Left	Drinking Fountain	First Draw	<0.4
2800-109-FD	Staley High School - Outside Men's Locker Room-Left Middle	Drinking Fountain	First Draw	<0.4
2800-110-FD	Staley High School - Outside Men's Locker Room-Right Middle	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
2800-111-FD	Staley High School - Outside Men's Locker Room-Far Right	Drinking Fountain	First Draw	<0.4
2800-112-FD	Staley High School - ADM 7	Sink Tap	First Draw	0.7
2800-113-FD	Staley High School - DAC-Outside Women's Restroom-Left	Drinking Fountain	First Draw	<0.4
2800-114-FD	Staley High School - DAC-Outside Women's Restroom-Right	Drinking Fountain	First Draw	<0.4
2800-115-FD	Staley High School - DAC-Outside Men's Restroom-Left	Drinking Fountain	First Draw	<0.4
2800-116-FD	Staley High School - DAC-Outside Men's Restroom-Right	Drinking Fountain	First Draw	<0.4
2800-117-FD	Staley High School - DAC-Concessions	Sink Tap	First Draw	0.9
2800-118-FD	Staley High School - DAC-Concessions	Ice Machine	First Draw	1

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

### Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post "Not for Drinking/Cooking" at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

## Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

## Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
  - The test results and a summary that explains such results;
  - A description of any remedial steps taken; and
  - A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

## General Recommendations


- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.



Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst  
Axiom Service Professionals LLC  
[jeffh@axiomservicepros.com](mailto:jeffh@axiomservicepros.com)

### **Limitations Drinking Water Testing**

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

## **Appendix A Certifications**

**STATE OF MISSOURI**  
**DEPARTMENT OF HEALTH AND SENIOR SERVICES**

**LEAD OCCUPATION LICENSE REGISTRATION**

Issued to:

**Bradly A. Young**

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector  
Category of License

Issuance Date: 10/4/2023  
Expiration Date: 10/4/2025  
License Number: 211004-300006201



*Paula F. Nickelson*

Paula F. Nickelson  
Director

Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102



**STATE OF MISSOURI**  
**DEPARTMENT OF HEALTH AND SENIOR SERVICES**

**LEAD OCCUPATION LICENSE REGISTRATION**

Issued to:

**Jeffrey A. Hurst**

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

**Lead Risk Assessor**  
Category of License

Issuance Date: **8/1/2022**  
Expiration Date: **8/1/2024**  
License Number: **000801-200166567**



**Missouri Department of Health  
and Senior Services**

Lead Occupation License - ID Badge

License Number:

**000801-200166567**

**Lead Risk Assessor**

**Jeffrey  
Hurst**

Expiration Date: **8/1/2024**

*Paula F. Nickelson*

**Paula F. Nickelson  
Acting Director**

**Department of Health and Senior Services**

**Kansas City, MO 65102**

**Appendix B**  
**EPA Listed Lead Containing Drinking Fountains**



Table C-1  
Water Coolers With Other Lead Components

## EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.
- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

## Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2  
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A    WT8A    GC10ACR    GC10A    GC5A    RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

# **Appendix C**

## **Laboratory Analytical Report**



Keystone Laboratories - Kansas City  
CERTIFICATE OF ANALYSIS  
3HA0075

**AXIOM Service Professionals**

Jeff Hurst  
PO Box 47166  
Kansas City, MO 64188

**Project Name: Lead Analysis**

Project / PO Number: 2800 Northeast Shoal Creek Par  
Received: 01/16/2024  
Reported: 02/09/2024

**Analytical Testing Parameters**

Client Sample ID: 2800-1-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-01

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:29

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1604	RVV

Client Sample ID: 2800-2-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-02

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:29

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1613	RVV

Client Sample ID: 2800-3-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-03

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:29

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1616	RVV

Client Sample ID: 2800-4-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-04

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:30

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1619	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-5-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-05

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:30

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1627	RVV

Client Sample ID: 2800-6-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-06

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:30

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1630	RVV

Client Sample ID: 2800-7-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-07

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.1	0.4	ppb	2		02/07/24 1408	02/07/24 1633	RVV

Client Sample ID: 2800-8-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-08

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1636	RVV

Client Sample ID: 2800-9-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-09

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		02/07/24 1408	02/07/24 1639	RVV

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com

Page 2 of 41



## Keystone Laboratories - Kansas City

## CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-10-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-10

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		02/07/24 1408	02/07/24 1642	RVV

Client Sample ID: 2800-11-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-11

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/07/24 1408	02/07/24 1645	RVV

Client Sample ID: 2800-12-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-12

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		02/07/24 1408	02/07/24 1648	RVV

Client Sample ID: 2800-13-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-13

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1651	RVV

Client Sample ID: 2800-14-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-14

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:35

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		02/07/24 1408	02/07/24 1654	RVV





## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-15-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-15

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:35

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/07/24 1408	02/07/24 1703	RVV

Client Sample ID: 2800-16-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-16

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:35

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		02/07/24 1408	02/07/24 1706	RVV

Client Sample ID: 2800-17-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-17

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		02/07/24 1408	02/07/24 1709	RVV

Client Sample ID: 2800-18-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-18

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1712	RVV

Client Sample ID: 2800-19-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-19

Collected By: Young, Bradly  
Collection Date: 12/27/2023 13:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/07/24 1408	02/07/24 1715	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-20-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-20

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1718	RVV

Client Sample ID: 2800-21-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-21

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:40

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/07/24 1408	02/07/24 1727	RVV

Client Sample ID: 2800-22-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-22

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:41

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.9	0.4	ppb	2		02/07/24 1408	02/07/24 1742	RVV

Client Sample ID: 2800-23-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-23

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:43

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1745	RVV

Client Sample ID: 2800-24-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-24

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:43

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1748	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-25-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-25

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:44

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1751	RVV

Client Sample ID: 2800-26-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-26

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:44

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1754	RVV

Client Sample ID: 2800-27-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-27

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:45

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/07/24 1408	02/07/24 1756	RVV

Client Sample ID: 2800-28-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-28

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:47

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1759	RVV

Client Sample ID: 2800-29-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-29

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:47

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		02/07/24 1408	02/07/24 1802	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-30-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-30

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:47

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1805	RVV

Client Sample ID: 2800-31-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-31

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:48

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.1	0.4	ppb	2		02/07/24 1408	02/07/24 1814	RVV

Client Sample ID: 2800-32-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-32

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1817	RVV

Client Sample ID: 2800-33-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-33

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1820	RVV

Client Sample ID: 2800-34-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-34

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1823	RVV



## Keystone Laboratories - Kansas City

## CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-35-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-35

Collected By: Young, Brady  
Collection Date: 12/27/2023 13:51

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1826	RVV

Client Sample ID: 2800-36-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-36

Collected By: Young, Brady  
Collection Date: 12/27/2023 13:51

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1829	RVV

Client Sample ID: 2800-37-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-37

Collected By: Young, Brady  
Collection Date: 12/27/2023 13:51

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1832	RVV

Client Sample ID: 2800-38-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-38

Collected By: Young, Brady  
Collection Date: 12/27/2023 13:53

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1835	RVV

Client Sample ID: 2800-39-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-39

Collected By: Young, Brady  
Collection Date: 12/27/2023 13:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1838	RVV





## Keystone Laboratories - Kansas City

## CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-40-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-40

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:58

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/07/24 1408	02/07/24 1841	RVV

Client Sample ID: 2800-41-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-41

Collected By: Young, Bradley  
Collection Date: 12/27/2023 13:59

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/07/24 1408	02/07/24 1856	RVV

Client Sample ID: 2800-42-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-42

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:01

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1905	RVV

Client Sample ID: 2800-43-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-43

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:02

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1908	RVV

Client Sample ID: 2800-44-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-44

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:02

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1911	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-45-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-45

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1914	RVV

Client Sample ID: 2800-46-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-46

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1917	RVV

Client Sample ID: 2800-47-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-47

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:05

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1926	RVV

Client Sample ID: 2800-48-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-48

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:05

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1929	RVV

Client Sample ID: 2800-49-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-49

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:06

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1932	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-50-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-50

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:06

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1935	RVV

Client Sample ID: 2800-51-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-51

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:07

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/07/24 1408	02/07/24 1938	RVV

Client Sample ID: 2800-52-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-52

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:07

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1941	RVV

Client Sample ID: 2800-53-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-53

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:07

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/07/24 1408	02/07/24 1944	RVV

Client Sample ID: 2800-54-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-54

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:07

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1947	RVV

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-55-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-55

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 1950	RVV

Client Sample ID: 2800-56-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-56

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		02/07/24 1408	02/07/24 1953	RVV

Client Sample ID: 2800-57-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-57

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2002	RVV

Client Sample ID: 2800-58-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-58

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2005	RVV

Client Sample ID: 2800-59-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-59

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:09

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2008	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-60-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-60

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:11

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2010	RVV

Client Sample ID: 2800-61-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-61

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2019	RVV

Client Sample ID: 2800-62-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-62

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2028	RVV

Client Sample ID: 2800-63-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-63

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2037	RVV

Client Sample ID: 2800-64-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-64

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:14

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2040	RVV





## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-65-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-65

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:14

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/07/24 1408	02/07/24 2043	RVV

Client Sample ID: 2800-66-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-66

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:15

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		02/07/24 1408	02/07/24 2046	RVV

Client Sample ID: 2800-67-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-67

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:15

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		02/07/24 1408	02/07/24 2049	RVV

Client Sample ID: 2800-68-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-68

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:15

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.7	0.4	ppb	2		02/07/24 1408	02/07/24 2052	RVV

Client Sample ID: 2800-69-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-69

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2055	RVV



## Keystone Laboratories - Kansas City

## CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-70-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-70

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2058	RVV

Client Sample ID: 2800-71-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-71

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2101	RVV

Client Sample ID: 2800-72-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-72

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:17

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2104	RVV

Client Sample ID: 2800-73-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-73

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:19

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		02/07/24 1408	02/07/24 2113	RVV

Client Sample ID: 2800-74-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-74

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:19

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2116	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-75-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-75

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:19

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2119	RVV

Client Sample ID: 2800-76-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-76

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:21

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2122	RVV

Client Sample ID: 2800-77-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-77

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:21

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.1	0.4	ppb	2		02/07/24 1408	02/07/24 2125	RVV

Client Sample ID: 2800-78-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-78

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:22

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.1	0.4	ppb	2		02/07/24 1408	02/07/24 2128	RVV

Client Sample ID: 2800-79-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-79

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:22

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/07/24 1408	02/07/24 2131	RVV



# Keystone Laboratories - Kansas City

## CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-80-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-80

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:24

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	6.1	0.4	ppb	2		02/07/24 1408	02/07/24 2134	RVV

Client Sample ID: 2800-81-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-81

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:24

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	5.8	0.4	ppb	2		02/07/24 1408	02/07/24 2149	RVV

Client Sample ID: 2800-82-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-82

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:25

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	7.9	0.4	ppb	2		02/07/24 1408	02/07/24 2158	RVV

Client Sample ID: 2800-83-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-83

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:25

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.1	0.4	ppb	2		02/07/24 1408	02/07/24 2201	RVV

Client Sample ID: 2800-84-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-84

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:27

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.7	0.4	ppb	2		02/07/24 1408	02/07/24 2204	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-85-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-85

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:27

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2207	RVV

Client Sample ID: 2800-86-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-86

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:28

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2210	RVV

Client Sample ID: 2800-87-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-87

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:30

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/07/24 1408	02/07/24 2213	RVV

Client Sample ID: 2800-88-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-88

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	94.2	0.4	ppb	2		02/07/24 1408	02/07/24 2216	RVV

Client Sample ID: 2800-89-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-89

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.1	0.4	ppb	2		02/07/24 1408	02/07/24 2225	RVV





## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-90-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-90

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.9	0.4	ppb	2		02/07/24 1408	02/07/24 2228	RVV

Client Sample ID: 2800-91-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-91

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:32

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	10.3	0.4	ppb	2		02/07/24 1408	02/07/24 2231	RVV

Client Sample ID: 2800-92-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-92

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:32

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2234	RVV

Client Sample ID: 2800-93-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-93

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2237	RVV

Client Sample ID: 2800-94-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-94

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2240	RVV

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



## Keystone Laboratories - Kansas City

## CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-95-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-95

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2243	RVV

Client Sample ID: 2800-96-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-96

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2246	RVV

Client Sample ID: 2800-97-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-97

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2249	RVV

Client Sample ID: 2800-98-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-98

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2252	RVV

Client Sample ID: 2800-99-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-99

Collected By: Young, Brady  
Collection Date: 12/27/2023 14:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2301	RVV



# Keystone Laboratories - Kansas City

## CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-100-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AA

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:43

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		02/07/24 1408	02/07/24 2304	RVV

Client Sample ID: 2800-101-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AB

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:43

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.9	0.4	ppb	2		02/07/24 1408	02/07/24 2313	RVV

Client Sample ID: 2800-102-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AC

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:37

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.4	0.4	ppb	2		02/07/24 1408	02/07/24 2322	RVV

Client Sample ID: 2800-103-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AD

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:39

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		02/07/24 1408	02/07/24 2325	RVV

Client Sample ID: 2800-104-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AE

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:39

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2328	RVV

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



## Keystone Laboratories - Kansas City

## CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-105-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AF

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:40

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2337	RVV

Client Sample ID: 2800-106-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AG

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:40

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.7	0.4	ppb	2		02/07/24 1408	02/07/24 2340	RVV

Client Sample ID: 2800-107-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AH

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:41

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		02/07/24 1408	02/07/24 2343	RVV

Client Sample ID: 2800-108-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AI

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:41

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2346	RVV

Client Sample ID: 2800-109-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AJ

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:43

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2349	RVV



## Keystone Laboratories - Kansas City

### CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-110-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AK

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:43

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2352	RVV

Client Sample ID: 2800-111-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AL

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:43

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/07/24 2355	RVV

Client Sample ID: 2800-112-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AM

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:43

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		02/07/24 1408	02/07/24 2358	RVV

Client Sample ID: 2800-113-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AN

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:45

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/08/24 0001	RVV

Client Sample ID: 2800-114-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AO

Collected By: Young, Bradley  
Collection Date: 12/27/2023 14:49

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/08/24 0004	RVV

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com





## Keystone Laboratories - Kansas City

## CERTIFICATE OF ANALYSIS

3HA0075

Client Sample ID: 2800-115-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AP

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:49

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/08/24 0013	RVV

Client Sample ID: 2800-116-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AQ

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/07/24 1408	02/08/24 0016	RVV

Client Sample ID: 2800-117-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AR

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		02/07/24 1408	02/08/24 0019	RVV

Client Sample ID: 2800-118-FD  
Sample Matrix: Drink Wtr  
Lab Sample ID: 3HA0075-AS

Collected By: Young, Bradly  
Collection Date: 12/27/2023 14:51

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		02/07/24 1408	02/08/24 0022	RVV

## Definitions

RL: Reporting Limit

## Report Comments

Reviewed and Approved By:

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.

Victoria Bruck  
Field Technician II  
02/09/24 08:13

Keystone Laboratories - Kansas City

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | [www.microbac.com](http://www.microbac.com)

Page 24 of 41

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b> <i>Bradly Young</i>		<b>NAME:</b> Jeff Hurst		<b>NAME:</b> Jeff Hurst	
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b> 2800 Northeast Shoal Creek Parkway		<b>ADDRESS:</b> PO Box 47166		<b>ADDRESS:</b> PO Box 47166	
<b>CITY/ST/ZIP:</b> Kansas City, Missouri 64156		<b>CITY/ST/ZIP:</b> Kansas City, Missouri 64188		<b>CITY/ST/ZIP:</b> Kansas City, Missouri 64188	
<b>PHONE:</b> 816-321-4702		<b>PHONE:</b> 816-678-7894		<b>PHONE:</b> 816-678-7894	
		<b>EMAIL:</b> jeffh@axiomservicepros.com		<b>EMAIL:</b> jeffh@axiomservicepros.com	

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3HA0075
															Short Hold:	
															Rush:	
															Temp: oC	17.2
															Sample Condition	Sample #
2800-1-FD	12/27/2023	13:29	Staley High School - Drinking Fountain - Weight Room-Left	1	Wt	Grab	X									01
2800-2-FD	12/27/2023	13:29	Staley High School - Drinking Fountain - Weight Room-Right	1	Wt	Grab	X									02
2800-3-FD	12/27/2023	13:29	Staley High School - Bottle Filler - Outside PE208	1	Wt	Grab	X									03
2800-4-FD	12/27/2023	13:30	Staley High School - Bottle Filler - Outside PE205	1	Wt	Grab	X									04
2800-5-FD	12/27/2023	13:30	Staley High School - Drinking Fountain - Outside PE205-Left	1	Wt	Grab	X									05
2800-6-FD	12/27/2023	13:30	Staley High School - Drinking Fountain - Outside PE205-Right	1	Wt	Grab	X									06
2800-7-FD	12/27/2023	13:31	Staley High School - Sink Tap - PE205	1	Wt	Grab	X									07

<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	<b>Remarks:</b>
<i>Bradly Young</i>		<i>Brandon Schell</i>	1/16/24	
	<b>Time:</b>		8:30	
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	
	<b>Time:</b>			





3 H A 0 0 7 5

AXIOM Service Professionals

PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3 HA 0075
															Short Hold:	
															Rush:	
															Temp:	oC
															Sample Condition	Sample #
2800-8-FD	12/27/2023	13:33	Staley High School - Sink Tap - Nurse Office	1	Wt	Grab	X									08
2800-9-FD	12/27/2023	13:33	Staley High School - Sink Tap - Nurse Office	1	Wt	Grab	X									09
2800-10-FD	12/27/2023	13:33	Staley High School - Sink Tap - FP205	1	Wt	Grab	X									10
2800-11-FD	12/27/2023	13:34	Staley High School - Sink Tap - FP208-Left	1	Wt	Grab	X									11
2800-12-FD	12/27/2023	13:34	Staley High School - Sink Tap - FP208-Middle	1	Wt	Grab	X									12
2800-13-FD	12/27/2023	13:34	Staley High School - Sink Tap - FP208-Right	1	Wt	Grab	X									13
2800-14-FD	12/27/2023	13:35	Staley High School - Sink Tap - FP209-Left	1	Wt	Grab	X									14

<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	<b>Remarks:</b>
			1/16/24	
	<b>Time:</b>		8:50	
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	
	<b>Time:</b>			





3 HA 0075

AXIOM Service Professionals

PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED							LAB USE ONLY	
															Wk Order #:	3 H A 0 0 7 5
															Short Hold:	
															Rush:	
															Temp: oC	
															Sample Condition	Sample #
2800-15-FD	12/27/2023	13:35	Staley High School - Sink Tap - FP209-Middle	1	Wt	Grab	X									15
2800-16-FD	12/27/2023	13:35	Staley High School - Sink Tap - FP209-Right	1	Wt	Grab	X									16
2800-17-FD	12/27/2023	13:36	Staley High School - Sink Tap - FP211-Far Left	1	Wt	Grab	X									17
2800-18-FD	12/27/2023	13:36	Staley High School - Sink Tap - FP211-Left Middle	1	Wt	Grab	X									18
2800-19-FD	12/27/2023	13:38	Staley High School - Sink Tap - FP211-Right Middle	1	Wt	Grab	X									19
2800-20-FD	12/27/2023	13:38	Staley High School - Sink Tap - FP211-Far Right	1	Wt	Grab	X									20
2800-21-FD	12/27/2023	13:40	Staley High School - Sink Tap - CR202	1	Wt	Grab	X									21



Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
			1/16/24	
	Time:		8:30	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
	Time:			



3 H A 0 0 7 5  
AXIOM Service Professionals  
PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	
															Sample Condition	Sample #
2800-22-FD	12/27/2023	13:41	Staley High School - Sink Tap - CR206	1	Wt	Grab	X									22
2800-23-FD	12/27/2023	13:43	Staley High School - Drinking Fountain - Outside CR206-Far Left	1	Wt	Grab	X									23
2800-24-FD	12/27/2023	13:43	Staley High School - Drinking Fountain - Outside CR206-Left Middle	1	Wt	Grab	X									24
2800-25-FD	12/27/2023	13:44	Staley High School - Drinking Fountain - Outside CR206-Right Middle	1	Wt	Grab	X									25
2800-26-FD	12/27/2023	13:44	Staley High School - Drinking Fountain - Outside CR206-Far Right	1	Wt	Grab	X									26
2800-27-FD	12/27/2023	13:45	Staley High School - Sink Tap - CR226	1	Wt	Grab	X									27
2800-28-FD	12/27/2023	13:47	Staley High School - Sink Tap - CR277-Left	1	Wt	Grab	X									28

<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	<b>Remarks:</b>
			11/16/24	
	<b>Time:</b>		8:30	
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	
	<b>Time:</b>		<b>Time:</b>	



3 H A 0 0 7 5

AXIOM Service Professionals


PM: Carolyn Jackson



<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com



CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3HA0075
															Short Hold:	
															Rush:	
															Temp: oC	
															Sample Condition	Sample #
2800-29-FD	12/27/2023	13:47	Staley High School - Sink Tap - CR277	1	Wt	Grab	X									29
2800-30-FD	12/27/2023	13:47	Staley High School - Sink Tap - CR277-Right	1	Wt	Grab	X									30
2800-31-FD	12/27/2023	13:48	Staley High School - Sink Tap - CR275	1	Wt	Grab	X									31
2800-32-FD	12/27/2023	13:50	Staley High School - Drinking Fountain - Outside CR226-Far Left-Left	1	Wt	Grab	X									32
2800-33-FD	12/27/2023	13:50	Staley High School - Drinking Fountain - Outside CR226-Far Left-Right	1	Wt	Grab	X									33
2800-34-FD	12/27/2023	13:50	Staley High School - Drinking Fountain - Outside CR226-Middle-Left	1	Wt	Grab	X									34
2800-35-FD	12/27/2023	13:51	Staley High School - Drinking Fountain - Outside CR226-Middle-Right	1	Wt	Grab	X									35

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
			11/26/24	
	Time:		8:30	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
	Time:			

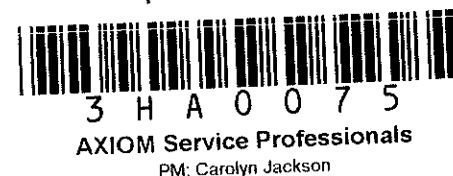

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3HA0075
															Short Hold:	
															Rush:	
															Temp:	oC
															Sample Condition	Sample #
2800-36-FD	12/27/2023	13:51	Staley High School - Drinking Fountain - Outside CR226-Far Right-Left	1	Wt	Grab	X									36
2800-37-FD	12/27/2023	13:51	Staley High School - Drinking Fountain - Outside CR226-Far Right-Right	1	Wt	Grab	X									37
2800-38-FD	12/27/2023	13:53	Staley High School - Sink Tap - CR273	1	Wt	Grab	X									38
2800-39-FD	12/27/2023	13:55	Staley High School - Sink Tap - Counseling Office Break Room	1	Wt	Grab	X									39
2800-40-FD	12/27/2023	13:58	Staley High School - Sink Tap - LMC Office	1	Wt	Grab	X									40
2800-41-FD	12/27/2023	13:59	Staley High School - Sink Tap - SEC Kitchenette	1	Wt	Grab	X									41
2800-42-FD	12/27/2023	14:01	Staley High School - Sink Tap - CR148	1	Wt	Grab	X									42



<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	<b>Remarks:</b>
			11/6/24	
	<b>Time:</b>		5:30	
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	
	<b>Time:</b>		<b>Time:</b>	



3 H A 0 0 7 5  
AXIOM Service Professionals  
PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	Sample #
2800-43-FD	12/27/2023	14:02	Staley High School - Drinking Fountain - Outside CR108	1	Wt	Grab	X							3HA0075	43
2800-44-FD	12/27/2023	14:02	Staley High School - Drinking Fountain - Outside CR108	1	Wt	Grab	X								44
2800-45-FD	12/27/2023	14:03	Staley High School - Drinking Fountain - Outside CR108	1	Wt	Grab	X								45
2800-46-FD	12/27/2023	14:03	Staley High School - Drinking Fountain - Outside CR108	1	Wt	Grab	X								46
2800-47-FD	12/27/2023	14:05	Staley High School - Drinking Fountain - Outside CR170-Third from Left	1	Wt	Grab	X								47
2800-48-FD	12/27/2023	14:05	Staley High School - Drinking Fountain - Outside CR170-Fourth from Left	1	Wt	Grab	X								48
2800-49-FD	12/27/2023	14:06	Staley High School - Drinking Fountain - Outside CR170-Fifth from Left	1	Wt	Grab	X								49

<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	<b>Remarks:</b>
			1/14/24	
	<b>Time:</b>		8:30	
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	
	<b>Time:</b>		<b>Time:</b>	



3 H A 0 0 7 5  
AXIOM Service Professionals  
PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED							LAB USE ONLY	
															Wk Order #:	
															Short Hold:	
															Rush:	
															Temp:	oC
															Sample Condition	Sample #
2800-50-FD	12/27/2023	14:06	Staley High School - Drinking Fountain - Outside CR170-Far Right	1	Wt	Grab	X									S0
2800-51-FD	12/27/2023	14:07	Staley High School - Sink Tap - CR183-Handwashing Sink	1	Wt	Grab	X									S1
2800-52-FD	12/27/2023	14:07	Staley High School - Sink Tap - CR183-West Sink	1	Wt	Grab	X									S2
2800-53-FD	12/27/2023	14:07	Staley High School - Sink Tap - CR183-Northwest Handwashing	1	Wt	Grab	X									S3
2800-54-FD	12/27/2023	14:07	Staley High School - Sink Tap - CR183-East Middle Sink	1	Wt	Grab	X									S4
2800-55-FD	12/27/2023	14:08	Staley High School - Sink Tap - CR183-East Middle Handwashing Sink	1	Wt	Grab	X									S5
2800-56-FD	12/27/2023	14:08	Staley High School - Sink Tap - CR183-Southeast Handwashing Sink	1	Wt	Grab	X									S6



Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
			11/27/24	
	Time:		8:30	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
	Time:			



3 H A 0 0 7 5  
AXIOM Service Professionals  
PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: °C	
															Sample Condition	Sample #
2800-57-FD	12/27/2023	14:08	Staley High School - Sink Tap - CR183-East 2 Bay Sink-Left	1	Wt	Grab	X									S7
2800-58-FD	12/27/2023	14:08	Staley High School - Sink Tap - CR183-East 2 Bay Sink-Right	1	Wt	Grab	X									S8
2800-59-FD	12/27/2023	14:09	Staley High School - Sink Tap - CR183-East Garbage Sink	1	Wt	Grab	X									S9
2800-60-FD	12/27/2023	14:11	Staley High School - Sink Tap - Faculty Dining	1	Wt	Grab	X									60
2800-61-FD	12/27/2023	14:13	Staley High School - Sink Tap - Kitchen-West Middle Sink	1	Wt	Grab	X									61
2800-62-FD	12/27/2023	14:13	Staley High School - Sink Tap - Kitchen-Middle Sink	1	Wt	Grab	X									62
2800-63-FD	12/27/2023	14:13	Staley High School - Sink Tap - Kitchen-East Wall-Left	1	Wt	Grab	X									63

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
				11/11/24		
	Time:			8:30		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		





3 H A 0 0 7 5  
AXIOM Service Professionals  
PM: Carolyn Jackson



<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp:	oC
															Sample Condition	Sample #
2800-64-FD	12/27/2023	14:14	Staley High School - Sink Tap - Kitchen-East Wall-Right	1	Wt	Grab	X									64
2800-65-FD	12/27/2023	14:14	Staley High School - Sink Tap - Kitchen-Southeast Handwashing Sink	1	Wt	Grab	X									65
2800-66-FD	12/27/2023	14:15	Staley High School - Steam Kettle - Kitchen	1	Wt	Grab	X									66
2800-67-FD	12/27/2023	14:15	Staley High School - Pot Filler - Kitchen	1	Wt	Grab	X									67
2800-68-FD	12/27/2023	14:15	Staley High School - Pot Filler - Kitchen	1	Wt	Grab	X									68
2800-69-FD	12/27/2023	14:16	Staley High School - Ice Machine - Kitchen	1	Wt	Grab	X									69
2800-70-FD	12/27/2023	14:16	Staley High School - Sink Tap - Kitchen-Southwest Handwashing Sink	1	Wt	Grab	X									70

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
			11/16/24	
	Time:		8:30	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
	Time:			





3 H A 0 0 7 5

AXIOM Service Professionals

PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp:	oC
														Sample Condition	Sample #
2800-71-FD	12/27/2023	14:16	Staley High School - Sink Tap - Kitchen-Northwest Handwashing	1	Wt	Grab	X								71
2800-72-FD	12/27/2023	14:17	Staley High School - Drinking Fountain - North of Kitchen	1	Wt	Grab	X								72
2800-73-FD	12/27/2023	14:19	Staley High School - Sink Tap - FP146	1	Wt	Grab	X								73
2800-74-FD	12/27/2023	14:19	Staley High School - Drinking Fountain - Outside FP146-Left	1	Wt	Grab	X								74
2800-75-FD	12/27/2023	14:19	Staley High School - Drinking Fountain - Outside FP146-Right	1	Wt	Grab	X								75
2800-76-FD	12/27/2023	14:21	Staley High School - Sink Tap - FP152-Left	1	Wt	Grab	X								76
2800-77-FD	12/27/2023	14:21	Staley High School - Sink Tap - FP152-Right	1	Wt	Grab	X								77

<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	<b>Remarks:</b>
			1/16/24	
	<b>Time:</b>		<b>Time:</b>	
			8:30	
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	
	<b>Time:</b>		<b>Time:</b>	





3 H A 0 0 7 5

AXIOM Service Professionals

PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp:	oC
															Sample Condition	Sample #
2800-78-FD	12/27/2023	14:22	Staley High School - Sink Tap - FP155-Left	1	Wt	Grab	X									78
2800-79-FD	12/27/2023	14:22	Staley High School - Sink Tap - FP155-Right	1	Wt	Grab	X									79
2800-80-FD	12/27/2023	14:24	Staley High School - Sink Tap - FP118-Left	1	Wt	Grab	X									80
2800-81-FD	12/27/2023	14:24	Staley High School - Sink Tap - FP118-Right	1	Wt	Grab	X									81
2800-82-FD	12/27/2023	14:25	Staley High School - Sink Tap - FP117-Right	1	Wt	Grab	X									82
2800-83-FD	12/27/2023	14:25	Staley High School - Sink Tap - FP117-Left	1	Wt	Grab	X									83
2800-84-FD	12/27/2023	14:27	Staley High School - Sink Tap - FP115	1	Wt	Grab	X									84



<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	<b>Remarks:</b>
			1/16/24	
	<b>Time:</b>		8:30	
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	
	<b>Time:</b>		<b>Time:</b>	



3 H A 0 0 7 5  
AXIOM Service Professionals  
PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	
															Sample Condition	Sample #
2800-85-FD	12/27/2023	14:27	Staley High School - Sink Tap - FP115-Right	1	Wt	Grab	X									85
2800-86-FD	12/27/2023	14:28	Staley High School - Sink Tap - FP110	1	Wt	Grab	X									86
2800-87-FD	12/27/2023	14:30	Staley High School - Sink Tap - FP104	1	Wt	Grab	X									87
2800-88-FD	12/27/2023	14:31	Staley High School - Sink Tap - FP103	1	Wt	Grab	X									88
2800-89-FD	12/27/2023	14:31	Staley High School - Sink Tap - FP103-East Handwashing	1	Wt	Grab	X									89
2800-90-FD	12/27/2023	14:31	Staley High School - Sink Tap - FP103-East Wall Left Sink	1	Wt	Grab	X									90
2800-91-FD	12/27/2023	14:32	Staley High School - Sink Tap - FP103-East Wall-Middle	1	Wt	Grab	X									91



<b>Relinquished by: (Signature)</b>	<b>Date:</b>		<b>Received by: (Signature)</b>	<b>Date:</b>		<b>Remarks:</b>
				11/16/24		
	<b>Time:</b>			8:30		
<b>Relinquished by: (Signature)</b>	<b>Date:</b>		<b>Received by: (Signature)</b>	<b>Date:</b>		
	<b>Time:</b>			<b>Time:</b>		




3 H A 0 0 7 5  
AXIOM Service Professionals  
PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com



CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	
															Sample Condition	Sample #
2800-92-FD	12/27/2023	14:32	Staley High School - Sink Tap - FP103-Garbage Sink	1	Wt	Grab	X									92
2800-93-FD	12/27/2023	14:34	Staley High School - Sink Tap - FP102-Teacher Sink	1	Wt	Grab	X									93
2800-94-FD	12/27/2023	14:34	Staley High School - Sink Tap - FP102-Southeast Sink	1	Wt	Grab	X									94
2800-95-FD	12/27/2023	14:34	Staley High School - Sink Tap - FP102-East Middle Sink	1	Wt	Grab	X									95
2800-96-FD	12/27/2023	14:36	Staley High School - Sink Tap - FP102-Northeast Sink	1	Wt	Grab	X									96
2800-97-FD	12/27/2023	14:36	Staley High School - Sink Tap - FP102-Northwest Sink	1	Wt	Grab	X									97
2800-98-FD	12/27/2023	14:36	Staley High School - Sink Tap - FP102-West Middle Sink	1	Wt	Grab	X									98
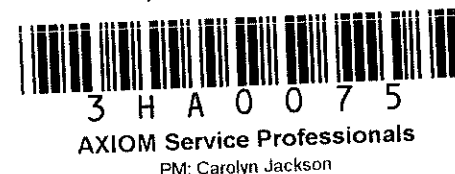
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	<b>Remarks:</b>
			11/10/24	
	<b>Time:</b>		8:30	
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	
	<b>Time:</b>			



<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
2800-99-FD	12/27/2023	14:36	Staley High School - Sink Tap - FP102-Southwest Sink	1	Wt	Grab	X								99
2800-100-FD	12/27/2023	14:43	Staley High School - Ice Machine - FP102	1	Wt	Grab	X								AA
2800-101-FD	12/27/2023	14:37	Staley High School - Sink Tap - FP102-Storage Room	1	Wt	Grab	X								AB
2800-102-FD	12/27/2023	14:39	Staley High School - Sink Tap - Concessions-Left	1	Wt	Grab	X								AC
2800-103-FD	12/27/2023	14:39	Staley High School - Sink Tap - Concessions-Handwashing Sink	1	Wt	Grab	X								AD
2800-104-FD	12/27/2023	14:40	Staley High School - Drinking Fountain - Restrooms by Concessions-Left	1	Wt	Grab	X								AE
2800-105-FD	12/27/2023	14:40	Staley High School - Drinking Fountain - Restroom by Concessions-Right	1	Wt	Grab	X								AF

<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	<b>Remarks:</b>
			11/16/24	
	<b>Time:</b>		8:30	
<b>Relinquished by: (Signature)</b>	<b>Date:</b>	<b>Received by: (Signature)</b>	<b>Date:</b>	
	<b>Time:</b>		<b>Time:</b>	






3 H A 0 0 7 5  
AXIOM Service Professionals  
PM: Carolyn Jackson



<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com



CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp:	oC
															Sample Condition	Sample #
2800-106-FD	12/27/2023	14:41	Staley High School - Sink Tap - Training Room	1	Wt	Grab	X									AG
2800-107-FD	12/27/2023	14:41	Staley High School - Sink Tap - Training Room Closet	1	Wt	Grab	X									AH
2800-108-FD	12/27/2023	14:43	Staley High School - Drinking Fountain - Outside Men's Locker Room-Far Left	1	Wt	Grab	X									AI
2800-109-FD	12/27/2023	14:43	Staley High School - Drinking Fountain - Outside Men's Locker Room-Left Middle	1	Wt	Grab	X									AJ
2800-110-FD	12/27/2023	14:43	Staley High School - Drinking Fountain - Outside Men's Locker Room-Right Middle	1	Wt	Grab	X									AK
2800-111-FD	12/27/2023	14:43	Staley High School - Drinking Fountain - Outside Men's Locker Room-Far Right	1	Wt	Grab	X									AL
2800-112-FD	12/27/2023	14:45	Staley High School - Sink Tap - ADM 7	1	Wt	Grab	X									AM

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
			1/16/24	
	Time:		8:30	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
	Time:			

  
3 H A 0 0 7 5  
**AXIOM Service Professionals**  
PM: Carolyn Jackson

<b>PRINT OR TYPE INFO BELOW:</b>		<b>REPORT TO:</b>		<b>BILL TO:</b>	
<b>SAMPLER:</b>		<b>NAME:</b>	Jeff Hurst	<b>NAME:</b>	Jeff Hurst
<b>SITE NAME:</b>		<b>CO. NAME:</b>		<b>CO. NAME:</b>	
<b>ADDRESS:</b>	2800 Northeast Shoal Creek Parkway	<b>ADDRESS:</b>	PO Box 47166	<b>ADDRESS:</b>	PO Box 47166
<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64156	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188	<b>CITY/ST/ZIP:</b>	Kansas City, Missouri 64188
<b>PHONE:</b>	816-321-4702	<b>PHONE:</b>	816-678-7894	<b>PHONE:</b>	816-678-7894
		<b>EMAIL:</b>	jeffh@axiomservicepros.com	<b>EMAIL:</b>	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
2800-113-FD	12/27/2023	14:49	Staley High School - Drinking Fountain - DAC-Outside Women's RR-Left	1	Wt	Grab	X								AN
2800-114-FD	12/27/2023	14:49	Staley High School - Drinking Fountain - DAC-Outside Women's RR-Right	1	Wt	Grab	X								AO
2800-115-FD	12/27/2023	14:50	Staley High School - Drinking Fountain - DAC-Outside Men's RR-Left	1	Wt	Grab	X								AP
2800-116-FD	12/27/2023	14:50	Staley High School - Drinking Fountain - DAC-Outside Men's RR-Right	1	Wt	Grab	X								AQ
2800-117-FD	12/27/2023	14:51	Staley High School - Sink Tap - DAC-Concessions	1	Wt	Grab	X								AR
2800-118-FD	12/27/2023	14:51	Staley High School - Ice Machine - DAC-Concessions	1	Wt	Grab	X								AS

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
			1/16/24	
	Time:		8:30	
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	
	Time:			



3 H A 0 0 7 5

AXIOM Service Professionals

PM: Carolyn Jackson

## Appendix D

### Photo Log



12/27/2023 - 2800-1 - Staley High School - Weight Room-Left



12/27/2023 - 2800-2 - Staley High School - Weight Room-Right




12/27/2023 - 2800-3 - Staley High School - Outside PE208



12/27/2023 - 2800-4 - Staley High School - Outside PE205



12/27/2023 - 2800-5 - Staley High School -  
Outside PE205-Left

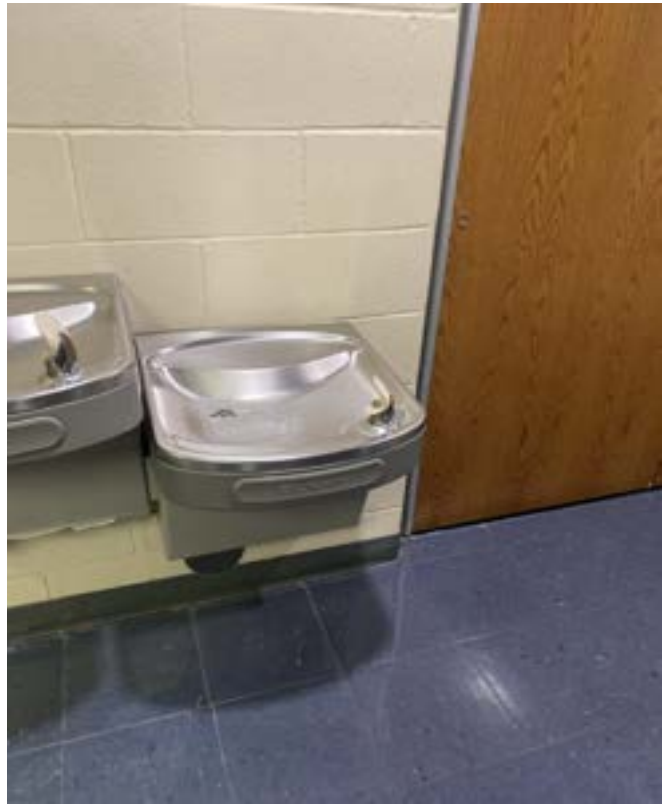

12/27/2023 - 2800-6 - Staley High School -  
Outside PE205-Right



12/27/2023 - 2800-7 - Staley High School - PE205



12/27/2023 - 2800-8 - Staley High School -  
Nurse's Office





12/27/2023 - 2800-9 - Staley High School - Nurse's Office



12/27/2023 - 2800-10 - Staley High School - FP205



12/27/2023 - 2800-11 - Staley High School - FP208-Left



12/27/2023 - 2800-12 - Staley High School - FP208-Middle





12/27/2023 - 2800-13 - Staley High School -  
FP208-Right



12/27/2023 - 2800-14 - Staley High School -  
FP209-Left



12/27/2023 - 2800-15 - Staley High School -  
FP209-Middle



12/27/2023 - 2800-16 - Staley High School -  
FP209-Right




12/27/2023 - 2800-17 - Staley High School -  
FP211-Far Left



12/27/2023 - 2800-18 - Staley High School -  
FP211-Left Middle



12/27/2023 - 2800-19 - Staley High School -  
FP211-Right Middle

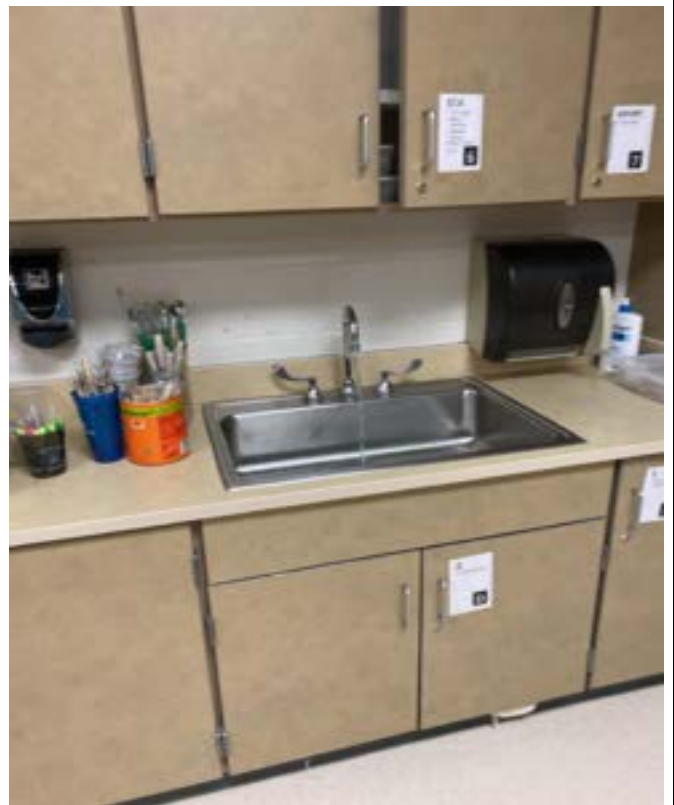

12/27/2023 - 2800-20 - Staley High School -  
FP211-Far Right





12/27/2023 - 2800-21 - Staley High School - CR202



12/27/2023 - 2800-22 - Staley High School - CR206



12/27/2023 - 2800-23 - Staley High School - Outside CR206-Far Left



12/27/2023 - 2800-24 - Staley High School - Outside CR206-Left Middle



12/27/2023 - 2800-25 - Staley High School - Outside CR206-Right Middle



12/27/2023 - 2800-26 - Staley High School - Outside CR206-Far Right



12/27/2023 - 2800-27 - Staley High School - CR226



12/27/2023 - 2800-28 - Staley High School - CR277-Left






12/27/2023 - 2800-29 - Staley High School - CR277



12/27/2023 - 2800-30 - Staley High School - CR277-Right



12/27/2023 - 2800-31 - Staley High School - CR275

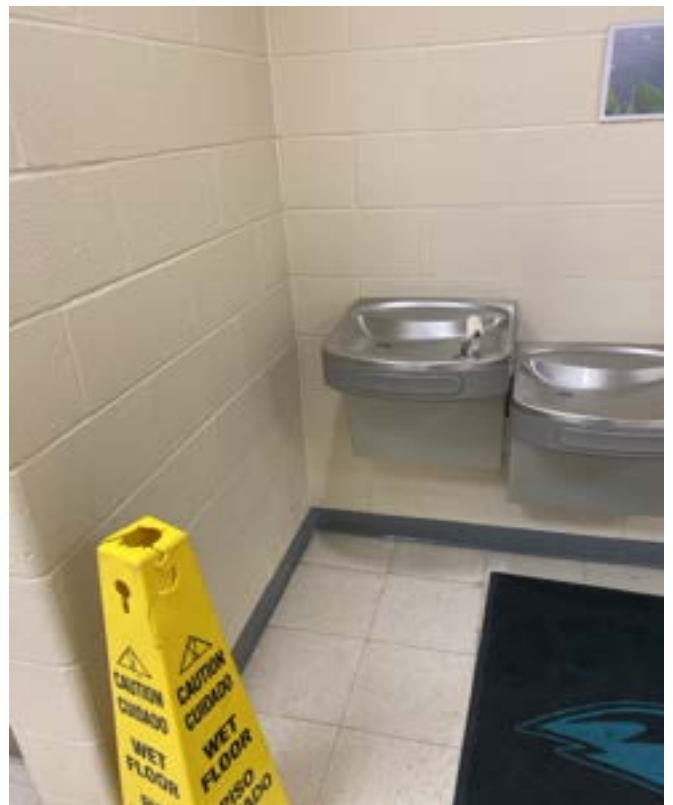

12/27/2023 - 2800-32 - Staley High School - Outside CR226-Far Left-Left



12/27/2023 - 2800-33 - Staley High School -  
Outside CR226-Far Left-Right



12/27/2023 - 2800-34 - Staley High School -  
Outside CR226-Middle-Left



12/27/2023 - 2800-35 - Staley High School -  
Outside CR226-Middle-Right



12/27/2023 - 2800-36 - Staley High School -  
Outside CR226-Far Right-Left



12/27/2023 - 2800-37 - Staley High School -  
Outside CR226-Far Right-Right



12/27/2023 - 2800-38 - Staley High School -  
CR273



12/27/2023 - 2800-39 - Staley High School -  
Counseling Office Break Room



12/27/2023 - 2800-40 - Staley High School - LMC  
Office





12/27/2023 - 2800-41 - Staley High School - SEC Kitchenette



12/27/2023 - 2800-42 - Staley High School - CR148



12/27/2023 - 2800-43 - Staley High School - Outside CR108



12/27/2023 - 2800-44 - Staley High School - Outside CR108




12/27/2023 - 2800-45 - Staley High School -  
Outside CR108



12/27/2023 - 2800-46 - Staley High School -  
Outside CR108



12/27/2023 - 2800-47 - Staley High School -  
Outside CR170-Third from Left

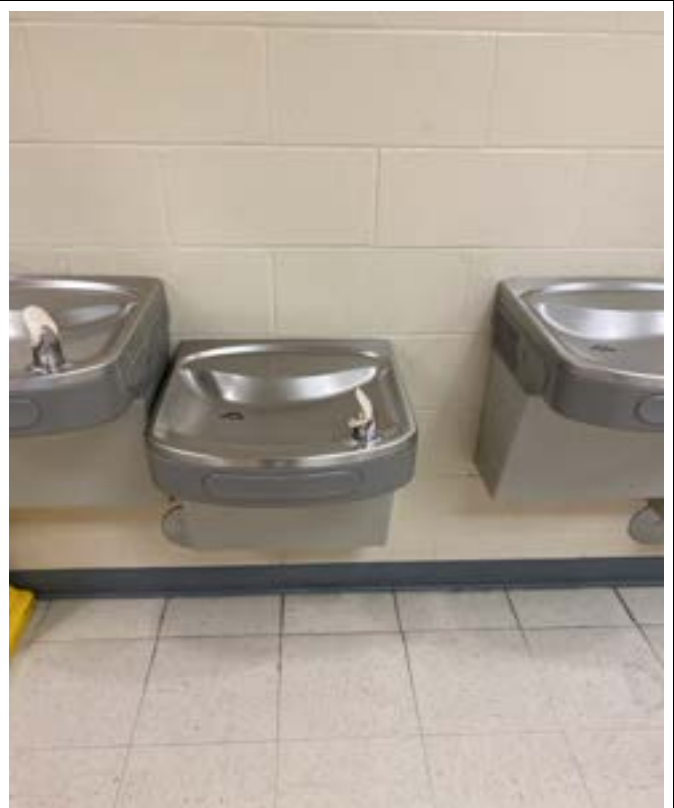

12/27/2023 - 2800-48 - Staley High School -  
Outside CR170-Fourth from Left





12/27/2023 - 2800-49 - Staley High School -  
Outside CR170-Fifth from Left



12/27/2023 - 2800-50 - Staley High School -  
Outside CR170-Far Right



12/27/2023 - 2800-51 - Staley High School -  
CR183-Handwashing Sink



12/27/2023 - 2800-52 - Staley High School -  
CR183-West Sink



12/27/2023 - 2800-53 - Staley High School - CR183-Northwest Handwashing Sink



12/27/2023 - 2800-54 - Staley High School - CR183-East Middle Sink



12/27/2023 - 2800-55 - Staley High School - CR183-East Middle Handwashing Sink



12/27/2023 - 2800-56 - Staley High School - CR183-Southeast Handwashing Sink





12/27/2023 - 2800-57 - Staley High School - CR183-East 2 Bay Sink-Left



12/27/2023 - 2800-58 - Staley High School - CR183-East 2 Bay Sink-Right



12/27/2023 - 2800-59 - Staley High School - CR183-East Garbage Sink



12/27/2023 - 2800-60 - Staley High School - Faculty Dining



12/27/2023 - 2800-61 - Staley High School -  
Kitchen-West Middle Sink



12/27/2023 - 2800-62 - Staley High School -  
Kitchen-Middle Sink



12/27/2023 - 2800-63 - Staley High School -  
Kitchen-East Wall-Left



12/27/2023 - 2800-64 - Staley High School -  
Kitchen-East Wall-Right





12/27/2023 - 2800-65 - Staley High School - Kitchen-Southeast Handwashing Sink



12/27/2023 - 2800-66 - Staley High School - Kitchen



12/27/2023 - 2800-67 - Staley High School - Kitchen



12/27/2023 - 2800-68 - Staley High School - Kitchen





12/27/2023 - 2800-69 - Staley High School - Kitchen



12/27/2023 - 2800-70 - Staley High School - Kitchen-Southwest Handwashing Sink



12/27/2023 - 2800-71 - Staley High School - Kitchen-Northwest Handwashing



12/27/2023 - 2800-72 - Staley High School - North of Kitchen




12/27/2023 - 2800-73 - Staley High School -  
FP146



12/27/2023 - 2800-74 - Staley High School -  
Outside FP146-Left



12/27/2023 - 2800-75 - Staley High School -  
Outside FP146-Right

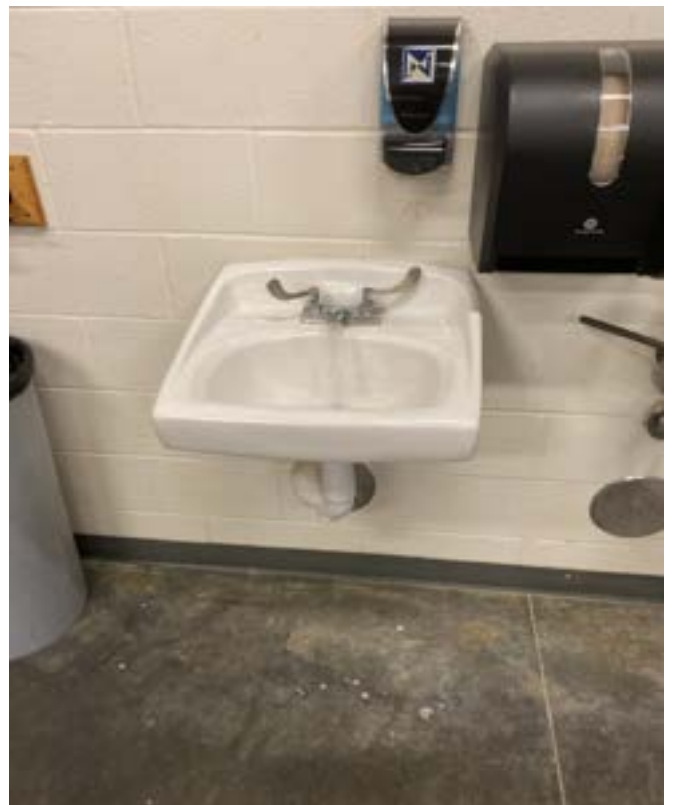


12/27/2023 - 2800-76 - Staley High School -  
FP152-Left





12/27/2023 - 2800-77 - Staley High School -  
FP152-Right

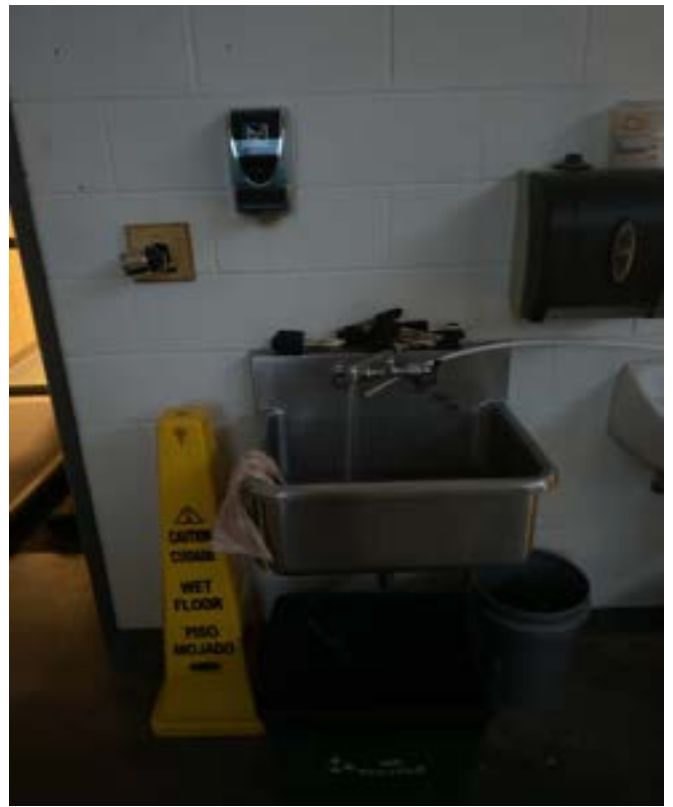

12/27/2023 - 2800-78 - Staley High School -  
FP155-Left




12/27/2023 - 2800-79 - Staley High School -  
FP155-Right



12/27/2023 - 2800-80 - Staley High School -  
FP118-Left



12/27/2023 - 2800-81 - Staley High School -  
FP118-Right

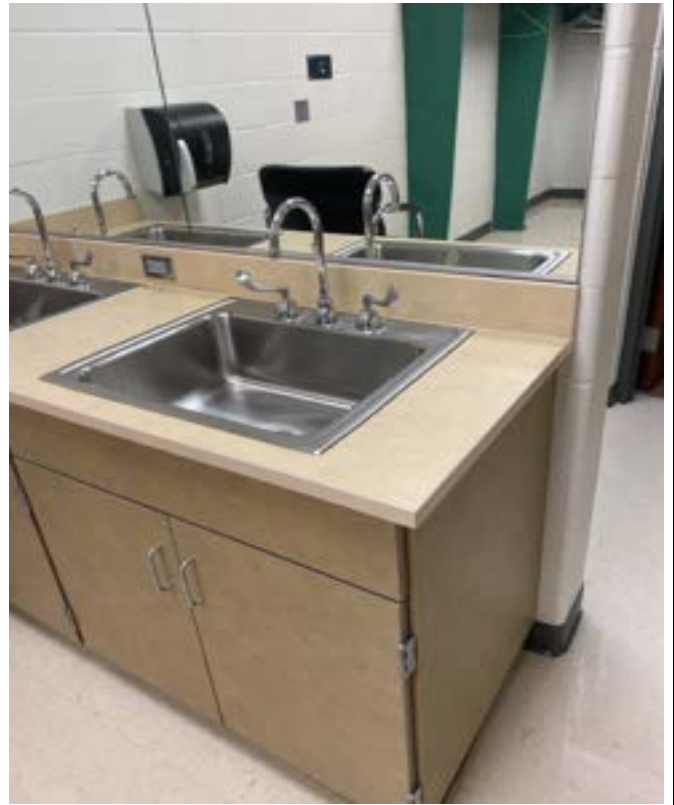

12/27/2023 - 2800-82 - Staley High School -  
FP117-Right



12/27/2023 - 2800-83 - Staley High School -  
FP117-Left



12/27/2023 - 2800-84 - Staley High School -  
FP115





12/27/2023 - 2800-85 - Staley High School -  
FP115-Right



12/27/2023 - 2800-86 - Staley High School -  
FP110



12/27/2023 - 2800-87 - Staley High School -  
FP104



12/27/2023 - 2800-88 - Staley High School -  
FP103



12/27/2023 - 2800-89 - Staley High School -  
FP103-East Handwashing Sink



12/27/2023 - 2800-90 - Staley High School -  
FP103-East Wall Left Sink



12/27/2023 - 2800-91 - Staley High School -  
FP103-East Wall-Middle



12/27/2023 - 2800-92 - Staley High School -  
FP103-Garbage Sink





12/27/2023 - 2800-93 - Staley High School -  
FP102-Teacher Sink



12/27/2023 - 2800-94 - Staley High School -  
FP102-Southeast Sink



12/27/2023 - 2800-95 - Staley High School -  
FP102-East Middle Sink



12/27/2023 - 2800-96 - Staley High School -  
FP102-Northeast Sink





12/27/2023 - 2800-97 - Staley High School -  
FP102-Northwest Sink



12/27/2023 - 2800-98 - Staley High School -  
FP102-West Middle Sink



12/27/2023 - 2800-99 - Staley High School -  
FP102-Southwest Sink



12/27/2023 - 2800-100 - Staley High School -  
FP102



12/27/2023 - 2800-101 - Staley High School -  
FP102-Storage Room



12/27/2023 - 2800-102 - Staley High School -  
Concessions-Left



12/27/2023 - 2800-103 - Staley High School -  
Concessions-Handwashing Sink



12/27/2023 - 2800-104 - Staley High School -  
Restroom by Concessions-Left





12/27/2023 - 2800-105 - Staley High School - Restroom by Concessions-Right



12/27/2023 - 2800-106 - Staley High School - Training Room



12/27/2023 - 2800-107 - Staley High School - Training Room Closet



12/27/2023 - 2800-108 - Staley High School - Outside Men's Locker Room-Far Left







12/27/2023 - 2800-113 - Staley High School -  
DAC-Outside Women's Restroom-Left



12/27/2023 - 2800-114 - Staley High School -  
DAC-Outside Women's Restroom-Right



12/27/2023 - 2800-115 - Staley High School -  
DAC-Outside Men's Restroom-Left



12/27/2023 - 2800-116 - Staley High School -  
DAC-Outside Men's Restroom-Right



12/27/2023 - 2800-117 - Staley High School -  
DAC-Concessions



12/27/2023 - 2800-118 - Staley High School -  
DAC-Concessions


## **Appendix E**

### **Source Identification Diagram**

ASP was provided sample locations by  
North Kansas City School District





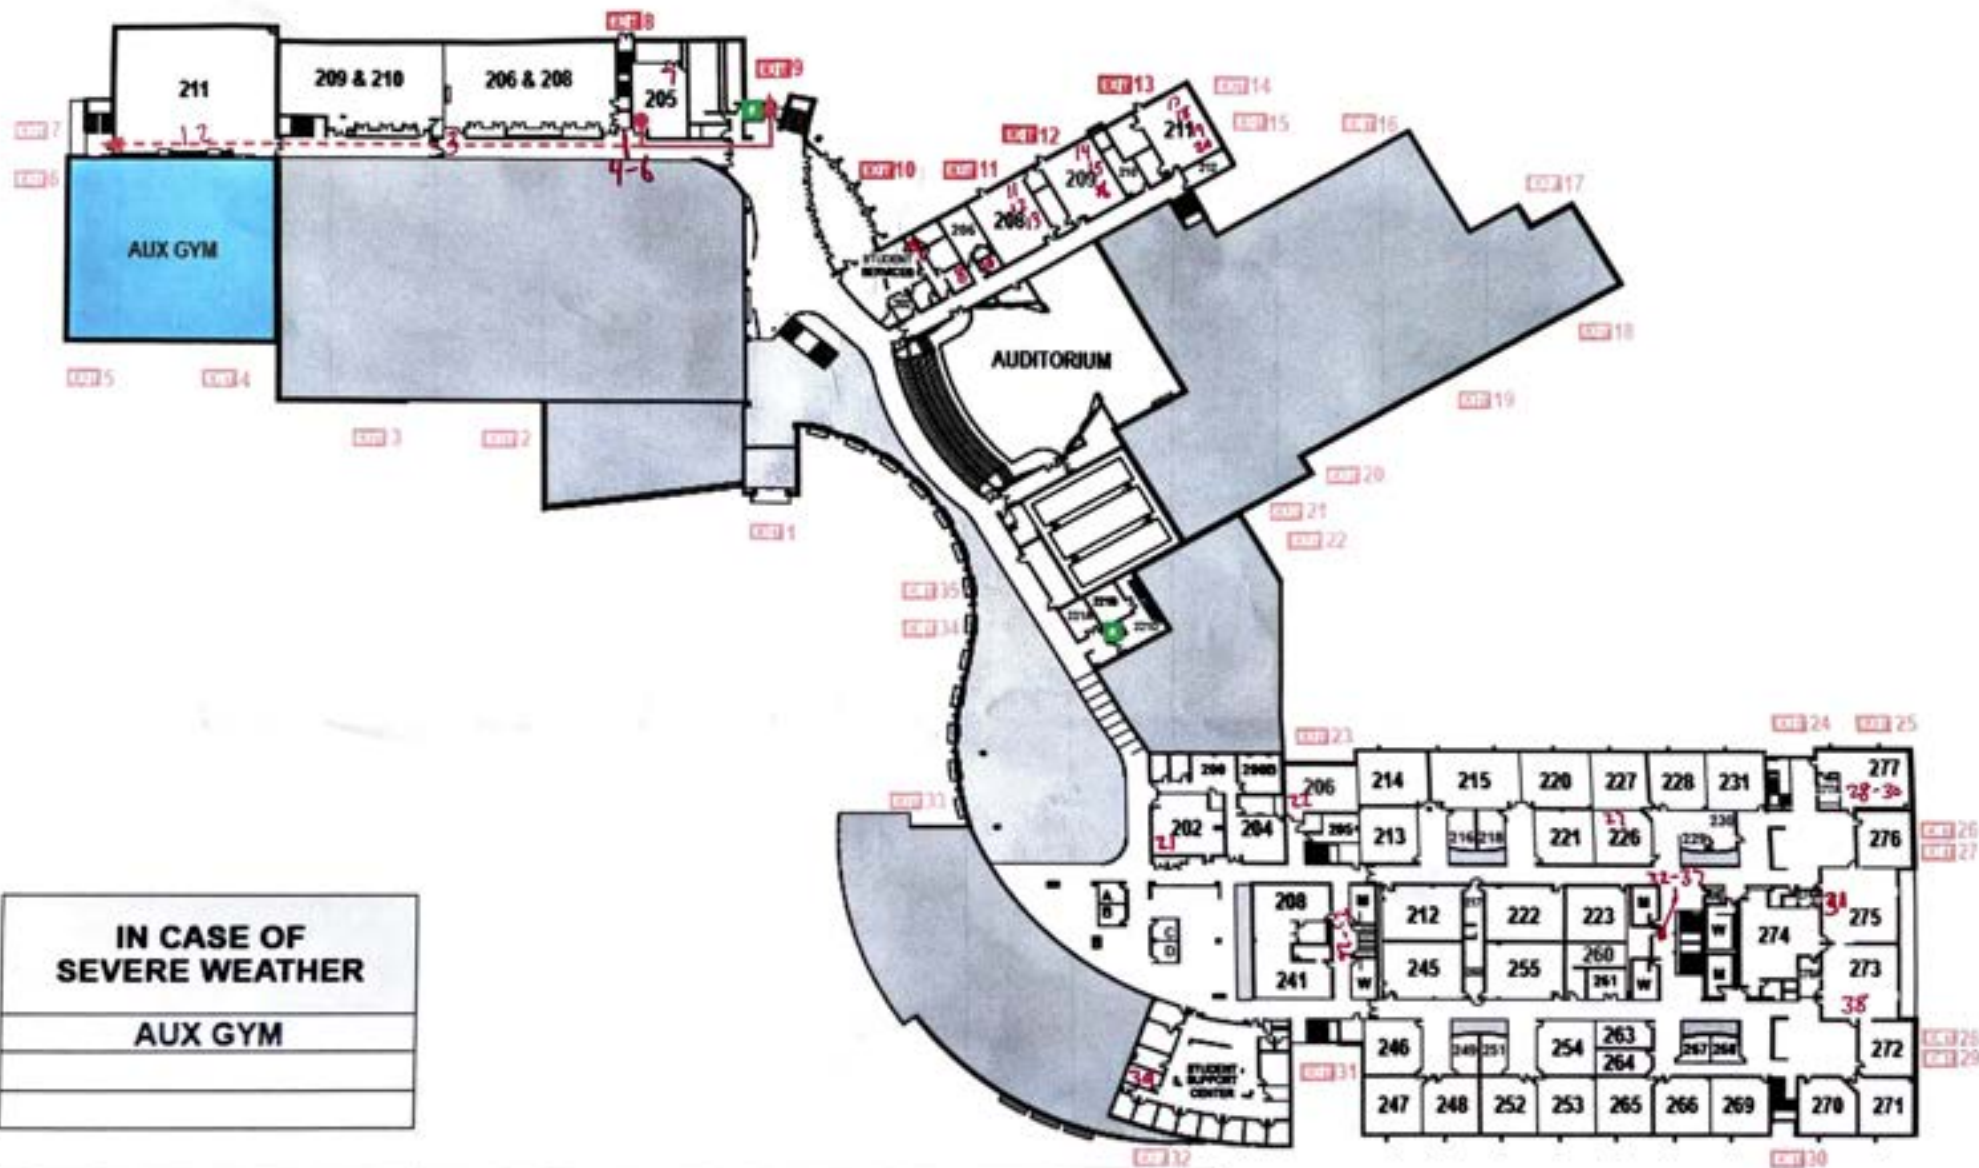





**IN CASE OF  
SEVERE WEATHER**

**AUX GYM**

### EMERGENCY INFORMATION

**Staley High School**  
2800 NE Shoal Creek Parkway  
Kansas City, MO 64156

-  Primary Exit Route
-  Secondary Exit Route
-  You Are Here
-  Exit Location

-  Stairway
-  Elevator
-  Defibrillator - 1<sup>st</sup> Floor Commons & Outside Main Office
-  Severe Weather Shelter

Emergency Egress Plan  
**Staley High School**  
**Level 2**

