March 25, 2024

North Kansas City School District
2000 Northeast 46th Street
Kansas City, Missouri 64116

Project: Limited Lead in Drinking Water Testing
Address: 6479 North Prospect Avenue, Gladstone, Missouri 64119

On January 2, 2024, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 130 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of “lead free” to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of “lead free” as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: https://www.epa.gov/dwreginfo/lead-and-copper-rule

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.
Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school’s buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in red text.

January 2, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
6479-1-FD	Early Education Center - Lobby	Drinking Fountain	First Draw	<0.4
6479-2-FD	Early Education Center - Room 400	Sink Tap	First Draw	<0.4
6479-3-FD	Early Education Center - Room 402	Sink Tap	First Draw	<0.4
6479-4-FD	Early Education Center - Outside 405a	Sink Tap	First Draw	<0.4
6479-5-FD	Early Education Center - Room 406	Sink Tap	First Draw	<0.4
6479-6-FD	Early Education Center - Room 406	Bubbler	First Draw	<0.4
6479-7-FD	Early Education Center - Room 408	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
6479-8-FD	Early Education Center - Room 408	Bubbler	First Draw	<0.4
6479-9-FD	Early Education Center - Room 802	Sink Tap	First Draw	<0.4
6479-10-FD	Early Education Center - Room 802	Bubbler	First Draw	<0.4
6479-11-FD	Early Education Center - Room 806	Sink Tap	First Draw	0.4
6479-12-FD	Early Education Center - Room 806	Bubbler	First Draw	<0.4
6479-13-FD	Early Education Center - Room 803	Sink Tap	First Draw	<0.4
6479-14-FD	Early Education Center - Room 803	Bubbler	First Draw	<0.4
6479-15-FD	Early Education Center - Room 801	Sink Tap	First Draw	<0.4
6479-16-FD	Early Education Center - Room 801	Bubbler	First Draw	<0.4
6479-17-FD	Early Education Center - Room 504-Left	Sink Tap	First Draw	<0.4
6479-18-FD	Early Education Center - Room 504-Right	Sink Tap	First Draw	<0.4
6479-19-FD	Early Education Center - Room 502	Sink Tap	First Draw	<0.4
6479-20-FD	Early Education Center - Room 506	Sink Tap	First Draw	<0.4
6479-21-FD	Early Education Center - Room 506	Bubbler	First Draw	<0.4
6479-22-FD	Early Education Center - Room 501	Sink Tap	First Draw	<0.4
6479-23-FD	Early Education Center - Room 501	Bubbler	First Draw	<0.4
6479-24-FD	Early Education Center - Room 601	Sink Tap	First Draw	<0.4
6479-25-FD	Early Education Center - Room 601	Bubbler	First Draw	<0.4
6479-26-FD	Early Education Center - Room 508	Sink Tap	First Draw	<0.4
6479-27-FD	Early Education Center - Room 508	Bubbler	First Draw	<0.4
6479-28-FD	Early Education Center - Room 510	Sink Tap	First Draw	<0.4
6479-29-FD	Early Education Center - Room 510	Bubbler	First Draw	<0.4
6479-30-FD	Early Education Center - Outside 508	Sink Tap	First Draw	0.4
6479-31-FD	Early Education Center - Room 512	Sink Tap	First Draw	<0.4
6479-32-FD	Early Education Center - Room 512	Bubbler	First Draw	<0.4
6479-33-FD	Early Education Center - Outside 512-Left	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
6479-34-FD	Early Education Center - Outside 512-Right	Drinking Fountain	First Draw	<0.4
6479-35-FD	Early Education Center - Room 503	Sink Tap	First Draw	<0.4
6479-36-FD	Early Education Center - Room 503	Ice Machine	First Draw	0.4
6479-37-FD	Early Education Center - Room 600	Sink Tap	First Draw	<0.4
6479-38-FD	Early Education Center - Room 600	Bubbler	First Draw	<0.4
6479-39-FD	Early Education Center - Room 606	Sink Tap	First Draw	<0.4
6479-40-FD	Early Education Center - Room 606	Bubbler	First Draw	<0.4
6479-41-FD	Early Education Center - Room 605	Sink Tap	First Draw	<0.4
6479-42-FD	Early Education Center - Room 605	Bubbler	First Draw	<0.4
6479-43-FD	Early Education Center - Room 608	Sink Tap	First Draw	<0.4
6479-44-FD	Early Education Center - Room 912	Sink Tap	First Draw	<0.4
6479-45-FD	Early Education Center - Room 913	Sink Tap	First Draw	<0.4
6479-46-FD	Early Education Center - Room 710	Sink Tap	First Draw	<0.4
6479-47-FD	Early Education Center - Room 710	Bubbler	First Draw	<0.4
6479-48-FD	Early Education Center - Outside 710	Sink Tap	First Draw	<0.4
6479-49-FD	Early Education Center - Room 708	Sink Tap	First Draw	<0.4
6479-50-FD	Early Education Center - Room 708	Bubbler	First Draw	<0.4
6479-51-FD	Early Education Center - Room 706	Sink Tap	First Draw	<0.4
6479-52-FD	Early Education Center - Room 704	Sink Tap	First Draw	<0.4
6479-53-FD	Early Education Center - Room 704	Bubbler	First Draw	<0.4
6479-54-FD	Early Education Center - Room 702	Sink Tap	First Draw	<0.4
6479-55-FD	Early Education Center - Room 702	Bubbler	First Draw	<0.4
6479-56-FD	Early Education Center - Room 700	Sink Tap	First Draw	<0.4
6479-57-FD	Early Education Center - Room 700	Bubbler	First Draw	<0.4
6479-58-FD	Early Education Center - Outside 702- Far Left	Drinking Fountain	First Draw	<0.4
6479-59-FD	Early Education Center - Outside 702-Left Middle	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
6479-60-FD	Early Education Center - Outside 702-Right Middle	Drinking Fountain	First Draw	<0.4
6479-61-FD	Early Education Center - Outside 702-Far Right	Drinking Fountain	First Draw	<0.4
6479-62-FD	Early Education Center - Room 316	Sink Tap	First Draw	<0.4
6479-63-FD	Early Education Center - Room 316	Ice Machine	First Draw	0.4
6479-64-FD	Early Education Center - Outside 316-Left	Drinking Fountain	First Draw	<0.4
6479-65-FD	Early Education Center - Outside 316-Right	Drinking Fountain	First Draw	<0.4
6479-66-FD	Early Education Center - Nurse's Room 310	Sink Tap	First Draw	<0.4
6479-67-FD	Early Education Center - Nurse's Prep Room	Sink Tap	First Draw	<0.4
6479-68-FD	Early Education Center - Nurse's Room 310A	Sink Tap	First Draw	<0.4
6479-69-FD	Early Education Center - Nurse's Room 310	Ice Machine	First Draw	0.8
6479-70-FD	Early Education Center - Room 308	Sink Tap	First Draw	<0.4
6479-71-FD	Early Education Center - Room 308	Bubbler	First Draw	<0.4
6479-72-FD	Early Education Center - Room 306	Sink Tap	First Draw	<0.4
6479-73-FD	Early Education Center - Room 306	Bubbler	First Draw	<0.4
6479-74-FD	Early Education Center - Room 304	Sink Tap	First Draw	0.5
6479-75-FD	Early Education Center - Room 304	Bubbler	First Draw	<0.4
6479-76-FD	Early Education Center - Room 307	Sink Tap	First Draw	<0.4
6479-77-FD	Early Education Center - Room 307	Bubbler	First Draw	<0.4
6479-78-FD	Early Education Center - Room 303	Sink Tap	First Draw	<0.4
6479-79-FD	Early Education Center - Room 303	Bubbler	First Draw	<0.4
6479-80-FD	Early Education Center - Room 300	Sink Tap	First Draw	<0.4
6479-81-FD	Early Education Center - Room 300	Bubbler	First Draw	<0.4
6479-82-FD	Early Education Center - Room 302	Sink Tap	First Draw	<0.4
6479-83-FD	Early Education Center - Room 302	Bubbler	First Draw	<0.4
6479-84-FD	Early Education Center - Room 206	Sink Tap	First Draw	<0.4
6479-85-FD	Early Education Center - Room 206	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
6479-86-FD	Early Education Center - Room 204	Sink Tap	First Draw	<0.4
6479-87-FD	Early Education Center - Room 204	Bubbler	First Draw	<0.4
6479-88-FD	Early Education Center - Room 201	Sink Tap	First Draw	<0.4
6479-89-FD	Early Education Center - Room 201	Bubbler	First Draw	<0.4
6479-90-FD	Early Education Center - Room 105	Sink Tap	First Draw	<0.4
6479-91-FD	Early Education Center - Room 105	Bubbler	First Draw	<0.4
6479-92-FD	Early Education Center - Room 202	Sink Tap	First Draw	<0.4
6479-93-FD	Early Education Center - Room 202	Bubbler	First Draw	<0.4
6479-94-FD	Early Education Center - Outside 202	Sink Tap	First Draw	<0.4
6479-95-FD	Early Education Center - Room 200	Sink Tap	First Draw	<0.4
6479-96-FD	Early Education Center - Room 112	Sink Tap	First Draw	<0.4
6479-97-FD	Early Education Center - Room 112	Bubbler	First Draw	<0.4
6479-98-FD	Early Education Center - Room 110	Sink Tap	First Draw	<0.4
6479-99-FD	Early Education Center - Room 110	Bubbler	First Draw	<0.4
6479-100-FD	Early Education Center - Room 104	Sink Tap	First Draw	<0.4
6479-101-FD	Early Education Center - Room 104	Bubbler	First Draw	<0.4
6479-102-FD	Early Education Center - Room 101	Sink Tap	First Draw	0.4
6479-103-FD	Early Education Center - Room 101	Bubbler	First Draw	<0.4
6479-104-FD	Early Education Center - Room 102	Sink Tap	First Draw	<0.4
6479-105-FD	Early Education Center - Room 102	Ice Machine	First Draw	1.3
6479-106-FD	Early Education Center - Outside 016-Left	Drinking Fountain	First Draw	<0.4
6479-107-FD	Early Education Center - Outside 016-Right	Drinking Fountain	First Draw	<0.4
6479-108-FD	Early Education Center - Kitchen-South Handwashing	Sink Tap	First Draw	<0.4
6479-109-FD	Early Education Center - Kitchen-South Sink	Sink Tap	First Draw	<0.4
6479-110-FD	Early Education Center - Kitchen	Steam Kettle	First Draw	<0.4
6479-111-FD	Early Education Center - Kitchen-North Handwashing	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
6479-112-FD	Early Education Center - Kitchen-East Handwashing	Sink Tap	First Draw	<0.4
6479-113-FD	Early Education Center - Kitchen- 3 Bay Sink-Left	Sink Tap	First Draw	<0.4
6479-114-FD	Early Education Center - Kitchen-3 Bay Sink-Middle	Sink Tap	First Draw	<0.4
6479-115-FD	Early Education Center - Kitchen-3 Bay Sink-Right	Sink Tap	First Draw	<0.4
6479-116-FD	Early Education Center - Kitchen-Garbage Sink	Sink Tap	First Draw	<0.4
6479-117-FD	Early Education Center - Workroom 013	Sink Tap	First Draw	<0.4
6479-118-FD	Early Education Center - Workroom 013	Ice Machine	First Draw	0.4
6479-119-FD	Early Education Center - IT Lobby-Left	Drinking Fountain	First Draw	<0.4
6479-120-FD	Early Education Center - IT Lobby-Right	Drinking Fountain	First Draw	<0.4
6479-121-FD	Early Education Center - IT Center-Kitchenette	Sink Tap	First Draw	<0.4
6479-122-FD	Early Education Center - IT Center-Kitchenette	Ice Machine	First Draw	<0.4
6479-123-FD	Early Education Center - PD-Left	Drinking Fountain	First Draw	<0.4
6479-124-FD	Early Education Center - PD-Right	Drinking Fountain	First Draw	<0.4
6479-125-FD	Early Education Center - PD-Kitchen-Right	Sink Tap	First Draw	<0.4
6479-126-FD	Early Education Center - PD-Kitchen-Left	Sink Tap	First Draw	<0.4
6479-127-FD	Early Education Center - PD Kitchen	Ice Machine	First Draw	<0.4
6479-128-FD	Early Education Center - Adult Learning-Outside 108-Left	Drinking Fountain	First Draw	<0.4
6479-129-FD	Early Education Center - Adult Learning-Outside 108-Right	Drinking Fountain	First Draw	<0.4
6479-130-FD	Early Education Center - Room 402	Bubbler	First Draw	2

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A
Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date:	**10/4/2023**
Expiration Date:	**10/4/2025**
License Number:	**211004-300006201**

Paula F. Nickelson
Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



Paula F. Nickelson
Acting Director
t of Health and Senior Services

son City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.

- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

PO Box 47166 Kansas City, MO 64188 • 816-678-7894 • www.axiomservicepros.com

Appendix C
Laboratory Analytical Report

Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0092

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: Lead Analysis

Project / PO Number: 6479 North Prospect Avenue / 64
Received: 01/16/2024
Reported: 02/15/2024

Analytical Testing Parameters

Client Sample ID: 6479-1-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-01
Collected By: Bradley Young
Collection Date: 01/02/2024 12:35

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2010	RVV

Client Sample ID: 6479-2-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-02
Collected By: Bradley Young
Collection Date: 01/02/2024 12:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2013	RVV

Client Sample ID: 6479-3-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-03
Collected By: Bradley Young
Collection Date: 01/02/2024 12:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2016	RVV

Client Sample ID: 6479-4-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-04
Collected By: Bradley Young
Collection Date: 01/02/2024 12:37

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2031	RVV

Client Sample ID:	6479-5-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-05	**Collection Date:**	01/02/2024 12:37

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2040	RVV

Client Sample ID:	6479-6-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-06	**Collection Date:**	01/02/2024 12:37

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2043	RVV

Client Sample ID:	6479-7-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-07	**Collection Date:**	01/02/2024 12:37

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2046	RVV

Client Sample ID:	6479-8-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-08	**Collection Date:**	01/02/2024 12:37

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2049	RVV

Client Sample ID:	6479-9-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-09	**Collection Date:**	01/02/2024 12:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2052	RVV

Client Sample ID: 6479-10-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-10
Collected By: Bradley Young
Collection Date: 01/02/2024 12:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2055	RVV

Client Sample ID: 6479-11-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-11
Collected By: Bradley Young
Collection Date: 01/02/2024 12:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		02/14/24 0840	02/14/24 2058	RVV

Client Sample ID: 6479-12-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-12
Collected By: Bradley Young
Collection Date: 01/02/2024 12:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2107	RVV

Client Sample ID: 6479-13-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-13
Collected By: Bradley Young
Collection Date: 01/02/2024 12:39

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2110	RVV

Client Sample ID: 6479-14-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-14
Collected By: Bradley Young
Collection Date: 01/02/2024 12:39

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2113	RVV

Client Sample ID:	6479-15-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-15	**Collection Date:**	01/02/2024 12:39

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2116	RVV

Client Sample ID:	6479-16-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-16	**Collection Date:**	01/02/2024 12:39

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2119	RVV

Client Sample ID:	6479-17-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-17	**Collection Date:**	01/02/2024 12:40

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2122	RVV

Client Sample ID:	6479-18-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-18	**Collection Date:**	01/02/2024 12:40

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2125	RVV

Client Sample ID:	6479-19-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-19	**Collection Date:**	01/02/2024 12:40

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2128	RVV

Client Sample ID:	6479-20-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-20	**Collection Date:**	01/02/2024 12:41

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2131	RVV

Client Sample ID:	6479-21-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-21	**Collection Date:**	01/02/2024 12:40

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2134	RVV

Client Sample ID:	6479-22-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-22	**Collection Date:**	01/02/2024 12:41

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2143	RVV

Client Sample ID:	6479-23-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-23	**Collection Date:**	01/02/2024 12:41

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2146	RVV

Client Sample ID:	6479-24-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-24	**Collection Date:**	01/02/2024 12:43

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2155	RVV

Client Sample ID: 6479-25-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-25
Collected By: Bradley Young
Collection Date: 01/02/2024 12:44

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2205	RVV

Client Sample ID: 6479-26-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-26
Collected By: Bradley Young
Collection Date: 01/02/2024 12:45

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2208	RVV

Client Sample ID: 6479-27-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-27
Collected By: Bradley Young
Collection Date: 01/02/2024 12:45

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2211	RVV

Client Sample ID: 6479-28-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-28
Collected By: Bradley Young
Collection Date: 01/02/2024 12:46

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2219	RVV

Client Sample ID: 6479-29-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-29
Collected By: Bradley Young
Collection Date: 01/02/2024 12:46

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2223	RVV

Client Sample ID: 6479-30-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-30
Collected By: Bradley Young
Collection Date: 01/02/2024 12:48

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		02/14/24 0840	02/14/24 2226	RVV

Client Sample ID: 6479-31-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-31
Collected By: Bradley Young
Collection Date: 01/02/2024 12:49

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2229	RVV

Client Sample ID: 6479-32-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-32
Collected By: Bradley Young
Collection Date: 01/02/2024 12:49

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2232	RVV

Client Sample ID: 6479-33-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-33
Collected By: Bradley Young
Collection Date: 01/02/2024 12:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2235	RVV

Client Sample ID: 6479-34-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-34
Collected By: Bradley Young
Collection Date: 01/02/2024 12:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2238	RVV

Client Sample ID: 6479-35-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-35
Collected By: Bradley Young
Collection Date: 01/02/2024 12:52

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2241	RVV

Client Sample ID: 6479-36-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-36
Collected By: Bradley Young
Collection Date: 01/02/2024 12:52

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		02/14/24 0840	02/14/24 2244	RVV

Client Sample ID: 6479-37-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-37
Collected By: Bradley Young
Collection Date: 01/02/2024 12:54

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2247	RVV

Client Sample ID: 6479-38-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-38
Collected By: Bradley Young
Collection Date: 01/02/2024 12:54

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2256	RVV

Client Sample ID: 6479-39-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-39
Collected By: Bradley Young
Collection Date: 01/02/2024 12:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2259	RVV

Client Sample ID: 6479-40-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-40
Collected By: Bradley Young
Collection Date: 01/02/2024 12:55

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2302	RVV

Client Sample ID: 6479-41-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-41
Collected By: Bradley Young
Collection Date: 01/02/2024 12:56

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2305	RVV

Client Sample ID: 6479-42-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-42
Collected By: Bradley Young
Collection Date: 01/02/2024 12:56

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2308	RVV

Client Sample ID: 6479-43-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-43
Collected By: Bradley Young
Collection Date: 01/02/2024 12:57

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2311	RVV

Client Sample ID: 6479-44-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-44
Collected By: Bradley Young
Collection Date: 01/02/2024 12:58

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2320	RVV

Client Sample ID: 6479-45-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-45
Collected By: Bradley Young
Collection Date: 01/02/2024 12:58

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2334	RVV

Client Sample ID: 6479-46-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-46
Collected By: Bradley Young
Collection Date: 01/02/2024 13:00

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2337	RVV

Client Sample ID: 6479-47-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-47
Collected By: Bradley Young
Collection Date: 01/02/2024 13:00

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2340	RVV

Client Sample ID: 6479-48-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-48
Collected By: Bradley Young
Collection Date: 01/02/2024 13:00

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2343	RVV

Client Sample ID: 6479-49-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-49
Collected By: Bradley Young
Collection Date: 01/02/2024 13:02

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2346	RVV

Client Sample ID: 6479-50-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-50
Collected By: Bradley Young
Collection Date: 01/02/2024 13:02

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2349	RVV

Client Sample ID: 6479-51-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-51
Collected By: Bradley Young
Collection Date: 01/02/2024 13:03

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2352	RVV

Client Sample ID: 6479-52-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-52
Collected By: Bradley Young
Collection Date: 01/02/2024 13:04

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2355	RVV

Client Sample ID: 6479-53-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-53
Collected By: Bradley Young
Collection Date: 01/02/2024 13:04

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/14/24 2358	RVV

Client Sample ID: 6479-54-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-54
Collected By: Bradley Young
Collection Date: 01/02/2024 13:05

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0007	RVV

Client Sample ID: 6479-55-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-55
Collected By: Bradley Young
Collection Date: 01/02/2024 13:05

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0010	RVV

Client Sample ID: 6479-56-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-56
Collected By: Bradley Young
Collection Date: 01/02/2024 13:06

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0013	RVV

Client Sample ID: 6479-57-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-57
Collected By: Bradley Young
Collection Date: 01/02/2024 13:06

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0016	RVV

Client Sample ID: 6479-58-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-58
Collected By: Bradley Young
Collection Date: 01/02/2024 13:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0019	RVV

Client Sample ID: 6479-59-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-59
Collected By: Bradley Young
Collection Date: 01/02/2024 13:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0022	RVV

Client Sample ID: 6479-60-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-60
Collected By: Bradley Young
Collection Date: 01/02/2024 13:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0025	RVV

Client Sample ID: 6479-61-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-61
Collected By: Bradley Young
Collection Date: 01/02/2024 13:08

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0028	RVV

Client Sample ID: 6479-62-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-62
Collected By: Bradley Young
Collection Date: 01/02/2024 13:10

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0031	RVV

Client Sample ID: 6479-63-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-63
Collected By: Bradley Young
Collection Date: 01/02/2024 13:10

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		02/14/24 0840	02/15/24 0034	RVV

Client Sample ID: 6479-64-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-64
Collected By: Bradley Young
Collection Date: 01/02/2024 13:11

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0049	RVV

Client Sample ID:	6479-65-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-65	**Collection Date:**	01/02/2024 13:11

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0058	RVV

Client Sample ID:	6479-66-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-66	**Collection Date:**	01/02/2024 13:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0101	RVV

Client Sample ID:	6479-67-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-67	**Collection Date:**	01/02/2024 13:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0104	RVV

Client Sample ID:	6479-68-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-68	**Collection Date:**	01/02/2024 13:13

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0107	RVV

Client Sample ID:	6479-69-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-69	**Collection Date:**	01/02/2024 13:14

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		02/14/24 0840	02/15/24 0110	RVV

Client Sample ID: 6479-70-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-70
Collected By: Bradley Young
Collection Date: 01/02/2024 13:15

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0119	RVV

Client Sample ID: 6479-71-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-71
Collected By: Bradley Young
Collection Date: 01/02/2024 13:15

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0122	RVV

Client Sample ID: 6479-72-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-72
Collected By: Bradley Young
Collection Date: 01/02/2024 13:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0125	RVV

Client Sample ID: 6479-73-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-73
Collected By: Bradley Young
Collection Date: 01/02/2024 13:16

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0127	RVV

Client Sample ID: 6479-74-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-74
Collected By: Bradley Young
Collection Date: 01/02/2024 13:17

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		02/14/24 0840	02/15/24 0130	RVV

Client Sample ID: 6479-75-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-75
Collected By: Bradley Young
Collection Date: 01/02/2024 13:17

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0133	RVV

Client Sample ID: 6479-76-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-76
Collected By: Bradley Young
Collection Date: 01/02/2024 13:19

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0136	RVV

Client Sample ID: 6479-77-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-77
Collected By: Bradley Young
Collection Date: 01/02/2024 13:19

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0139	RVV

Client Sample ID: 6479-78-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-78
Collected By: Bradley Young
Collection Date: 01/02/2024 13:20

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0142	RVV

Client Sample ID: 6479-79-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-79
Collected By: Bradley Young
Collection Date: 01/02/2024 13:20

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0145	RVV

Client Sample ID: 6479-80-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-80
Collected By: Bradley Young
Collection Date: 01/02/2024 13:21

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0154	RVV

Client Sample ID: 6479-81-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-81
Collected By: Bradley Young
Collection Date: 01/02/2024 13:22

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0157	RVV

Client Sample ID: 6479-82-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-82
Collected By: Bradley Young
Collection Date: 01/02/2024 13:23

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0200	RVV

Client Sample ID: 6479-83-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-83
Collected By: Bradley Young
Collection Date: 01/02/2024 13:23

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0203	RVV

Client Sample ID: 6479-84-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-84
Collected By: Bradley Young
Collection Date: 01/02/2024 13:25

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0212	RVV

Client Sample ID: 6479-85-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-85
Collected By: Bradley Young
Collection Date: 01/02/2024 13:25

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0221	RVV

Client Sample ID: 6479-86-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-86
Collected By: Bradley Young
Collection Date: 01/02/2024 13:26

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0230	RVV

Client Sample ID: 6479-87-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-87
Collected By: Bradley Young
Collection Date: 01/02/2024 13:26

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0233	RVV

Client Sample ID: 6479-88-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-88
Collected By: Bradley Young
Collection Date: 01/02/2024 13:28

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0236	RVV

Client Sample ID: 6479-89-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-89
Collected By: Bradley Young
Collection Date: 01/02/2024 13:28

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0239	RVV

Client Sample ID:	6479-90-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-90	**Collection Date:**	01/02/2024 13:29

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0242	RVV

Client Sample ID:	6479-91-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-91	**Collection Date:**	01/02/2024 13:29

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0245	RVV

Client Sample ID:	6479-92-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-92	**Collection Date:**	01/02/2024 13:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0248	RVV

Client Sample ID:	6479-93-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-93	**Collection Date:**	01/02/2024 13:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0251	RVV

Client Sample ID:	6479-94-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-94	**Collection Date:**	01/02/2024 13:31

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0254	RVV

Client Sample ID:	6479-95-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-95	**Collection Date:**	01/02/2024 13:32

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0257	RVV

Client Sample ID:	6479-96-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-96	**Collection Date:**	01/02/2024 13:32

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0306	RVV

Client Sample ID:	6479-97-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-97	**Collection Date:**	01/02/2024 13:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0309	RVV

Client Sample ID:	6479-98-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-98	**Collection Date:**	01/02/2024 13:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0312	RVV

Client Sample ID:	6479-99-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-99	**Collection Date:**	01/02/2024 13:33

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0315	RVV

Client Sample ID: 6479-100-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AA
Collected By: Bradley Young
Collection Date: 01/02/2024 13:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0318	RVV

Client Sample ID: 6479-101-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AB
Collected By: Bradley Young
Collection Date: 01/02/2024 13:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0321	RVV

Client Sample ID: 6479-102-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AC
Collected By: Bradley Young
Collection Date: 01/02/2024 13:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		02/14/24 0840	02/15/24 0324	RVV

Client Sample ID: 6479-103-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AD
Collected By: Bradley Young
Collection Date: 01/02/2024 13:34

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0327	RVV

Client Sample ID: 6479-104-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AE
Collected By: Bradley Young
Collection Date: 01/02/2024 13:35

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0342	RVV

Client Sample ID: 6479-105-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AF
Collected By: Bradley Young
Collection Date: 01/02/2024 13:35

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		02/14/24 0840	02/15/24 0351	RVV

Client Sample ID: 6479-106-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AG
Collected By: Bradley Young
Collection Date: 01/02/2024 13:35

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0354	RVV

Client Sample ID: 6479-107-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AH
Collected By: Bradley Young
Collection Date: 01/02/2024 13:35

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0357	RVV

Client Sample ID: 6479-108-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AI
Collected By: Bradley Young
Collection Date: 01/02/2024 13:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0400	RVV

Client Sample ID: 6479-109-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AJ
Collected By: Bradley Young
Collection Date: 01/02/2024 13:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0403	RVV

Client Sample ID: 6479-110-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AK
Collected By: Bradley Young
Collection Date: 01/02/2024 13:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0406	RVV

Client Sample ID: 6479-111-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AL
Collected By: Bradley Young
Collection Date: 01/02/2024 13:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0409	RVV

Client Sample ID: 6479-112-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AM
Collected By: Bradley Young
Collection Date: 01/02/2024 13:37

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0418	RVV

Client Sample ID: 6479-113-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AN
Collected By: Bradley Young
Collection Date: 01/02/2024 13:37

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0421	RVV

Client Sample ID: 6479-114-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AO
Collected By: Bradley Young
Collection Date: 01/02/2024 13:37

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0424	RVV

Client Sample ID:	6479-115-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AP	**Collection Date:**	01/02/2024 13:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0427	RVV

Client Sample ID:	6479-116-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AQ	**Collection Date:**	01/02/2024 13:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0430	RVV

Client Sample ID:	6479-117-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AR	**Collection Date:**	01/02/2024 13:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0433	RVV

Client Sample ID:	6479-118-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AS	**Collection Date:**	01/02/2024 13:38

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		02/14/24 0840	02/15/24 0436	RVV

Client Sample ID:	6479-119-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AT	**Collection Date:**	01/02/2024 13:42

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0439	RVV

Client Sample ID:	6479-120-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AU	**Collection Date:**	01/02/2024 13:42

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0442	RVV

Client Sample ID:	6479-121-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AV	**Collection Date:**	01/02/2024 13:42

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0445	RVV

Client Sample ID:	6479-122-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AW	**Collection Date:**	01/02/2024 13:42

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0454	RVV

Client Sample ID:	6479-123-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AX	**Collection Date:**	01/02/2024 13:44

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0457	RVV

Client Sample ID:	6479-124-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-AY	**Collection Date:**	01/02/2024 13:44

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0506	RVV

Client Sample ID: 6479-125-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-AZ
Collected By: Bradley Young
Collection Date: 01/02/2024 13:45

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0515	RVV

Client Sample ID: 6479-126-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-BA
Collected By: Bradley Young
Collection Date: 01/02/2024 13:45

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0518	RVV

Client Sample ID: 6479-127-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-BB
Collected By: Bradley Young
Collection Date: 01/02/2024 13:45

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0521	RVV

Client Sample ID: 6479-128-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-BC
Collected By: Bradley Young
Collection Date: 01/02/2024 13:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0530	RVV

Client Sample ID: 6479-129-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0092-BD
Collected By: Bradley Young
Collection Date: 01/02/2024 13:50

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		02/14/24 0840	02/15/24 0533	RVV

Keystone Laboratories - Kansas City

CERTIFICATE OF ANALYSIS

3HA0092

Client Sample ID:	6479-130-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HA0092-BE	**Collection Date:**	01/02/2024 12:36

Analyses Performed by: Keystone Laboratories - Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		02/14/24 0840	02/15/24 0536	RVV

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Victoria Bruck
Field Technician II
02/15/24 12:50

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
6479-1-FD	1/2/2024	12:35	Early Education Center - Drinking Fountain - Lobby	1	Wt	Grab	X								01
6479-2-FD	1/2/2024	12:36	Early Education Center - Sink Tap - Room 400	1	Wt	Grab	X								02
6479-3-FD	1/2/2024	12:36	Early Education Center - Sink Tap - Room 402	1	Wt	Grab	X								03
6479-4-FD	1/2/2024	12:37	Early Education Center - Sink Tap - Outside 405a	1	Wt	Grab	X								04
6479-5-FD	1/2/2024	12:37	Early Education Center - Sink Tap - Room 406	1	Wt	Grab	X								05
6479-6-FD	1/2/2024	12:37	Early Education Center - Bubbler - Room 406	1	Wt	Grab	X								06
6479-7-FD	1/2/2024	12:37	Early Education Center - Sink Tap - Room 408	1	Wt	Grab	X								07

LAB USE ONLY: Wk Order #: 3HA0092 | Short Hold: | Rush: | Temp: oC 18.0

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brad Young						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Linda Mabonna	1/16/24		
	Time:			Time: 08:30		

3HA0092
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HA0092	
														Short Hold:	
														Rush:	
														Temp: oC 18.0	
6479-8-FD	1/2/2024	12:37	Early Education Center - Bubbler - Room 408	1	Wt	Grab	X								08
6479-9-FD	1/2/2024	12:38	Early Education Center - Sink Tap - Room 802	1	Wt	Grab	X								09
6479-10-FD	1/2/2024	12:38	Early Education Center - Bubbler - Room 802	1	Wt	Grab	X								10
6479-11-FD	1/2/2024	12:38	Early Education Center - Sink Tap - Room 806	1	Wt	Grab	X								11
6479-12-FD	1/2/2024	12:38	Early Education Center - Bubbler - Room 806	1	Wt	Grab	X								12
6479-13-FD	1/2/2024	12:39	Early Education Center - Sink Tap - Room 803	1	Wt	Grab	X								13
6479-14-FD	1/2/2024	12:39	Early Education Center - Bubbler - Room 803	1	Wt	Grab	X								14

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brett Young						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:		Linda Malone	Time:	08:30	

3HA0092
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HA0092	
														Short Hold:	
														Rush:	
														Temp: oC 18.0	
6479-15-FD	1/2/2024	12:39	Early Education Center - Sink Tap - Room 801	1	Wt	Grab	X								15
6479-16-FD	1/2/2024	12:39	Early Education Center - Bubbler - Room 801	1	Wt	Grab	X								16
6479-17-FD	1/2/2024	12:40	Early Education Center - Sink Tap - Room 504-Left	1	Wt	Grab	X								17
6479-18-FD	1/2/2024	12:40	Early Education Center - Sink Tap - Room 504-Right	1	Wt	Grab	X								18
6479-19-FD	1/2/2024	12:40	Early Education Center - Sink Tap - Room 502	1	Wt	Grab	X								19
6479-20-FD	1/2/2024	12:41	Early Education Center - Sink Tap - Room 506	1	Wt	Grab	X								20
6479-21-FD	1/2/2024	12:40	Early Education Center - Bubbler - Room 506	1	Wt	Grab	X								21

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brady Jung						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Linda Mabon	1/16/24		
	Time:			Time:		
				08:30		

3HA0092
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HA0092	
														Short Hold:	
														Rush:	
														Temp: oC 18.0	
6479-22-FD	1/2/2024	12:41	Early Education Center - Sink Tap - Room 501	1	Wt	Grab	X								22
6479-23-FD	1/2/2024	12:41	Early Education Center - Bubbler - Room 501	1	Wt	Grab	X								23
6479-24-FD	1/2/2024	12:43	Early Education Center - Sink Tap - Room 601	1	Wt	Grab	X								24
6479-25-FD	1/2/2024	12:44	Early Education Center - Bubbler - Room 601	1	Wt	Grab	X								25
6479-26-FD	1/2/2024	12:45	Early Education Center - Sink Tap - Room 508	1	Wt	Grab	X								26
6479-27-FD	1/2/2024	12:45	Early Education Center - Bubbler - Room 508	1	Wt	Grab	X								27
6479-28-FD	1/2/2024	12:46	Early Education Center - Sink Tap - Room 510	1	Wt	Grab	X								28

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brady Jay						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:		Linda Mabon	Time:	08:30	

3HA0092

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HA0092
														Short Hold:	
														Rush:	
														Temp: oC	18.0
6479-29-FD	1/2/2024	12:46	Early Education Center - Bubbler - Room 510	1	Wt	Grab	X								29
6479-30-FD	1/2/2024	12:48	Early Education Center - Sink Tap - Outside 508	1	Wt	Grab	X								30
6479-31-FD	1/2/2024	12:49	Early Education Center - Sink Tap - Room 512	1	Wt	Grab	X								31
6479-32-FD	1/2/2024	12:49	Early Education Center - Bubbler - Room 512	1	Wt	Grab	X								32
6479-33-FD	1/2/2024	12:50	Early Education Center - Drinking Fountain - Outside 512-Left	1	Wt	Grab	X								33
6479-34-FD	1/2/2024	12:50	Early Education Center - Drinking Fountain - Outside 512-Right	1	Wt	Grab	X								34
6479-35-FD	1/2/2024	12:52	Early Education Center - Sink Tap - Room 503	1	Wt	Grab	X								35

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
			Linda Mahoon	Time:	08:30	

3HA0092

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HA0092	
														Short Hold:	
														Rush:	
														Temp: oC 18.0	
6479-36-FD	1/2/2024	12:52	Early Education Center - Ice Machine - Room 503	1	Wt	Grab	X								36
6479-37-FD	1/2/2024	12:54	Early Education Center - Sink Tap - Room 600	1	Wt	Grab	X								37
6479-38-FD	1/2/2024	12:54	Early Education Center - Bubbler - Room 600	1	Wt	Grab	X								38
6479-39-FD	1/2/2024	12:55	Early Education Center - Sink Tap - Room 606	1	Wt	Grab	X								39
6479-40-FD	1/2/2024	12:55	Early Education Center - Bubbler - Room 606	1	Wt	Grab	X								40
6479-41-FD	1/2/2024	12:56	Early Education Center - Sink Tap - Room 605	1	Wt	Grab	X								41
6479-42-FD	1/2/2024	12:56	Early Education Center - Bubbler - Room 605	1	Wt	Grab	X								42

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brett Jung						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:		Linda Malcom	Time:	08:30	

3HA0092
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HA0092
														Short Hold:	
														Rush:	
														Temp: oC	18.0
6479-43-FD	1/2/2024	12:57	Early Education Center - Sink Tap - Room 608	1	Wt	Grab	X								43
6479-44-FD	1/2/2024	12:58	Early Education Center - Sink Tap - Room 912	1	Wt	Grab	X								44
6479-45-FD	1/2/2024	12:58	Early Education Center - Sink Tap - Room 913	1	Wt	Grab	X								45
6479-46-FD	1/2/2024	13:00	Early Education Center - Sink Tap - Room 710	1	Wt	Grab	X								46
6479-47-FD	1/2/2024	13:00	Early Education Center - Bubbler - Room 710	1	Wt	Grab	X								47
6479-48-FD	1/2/2024	13:00	Early Education Center - Sink Tap - Outside 710	1	Wt	Grab	X								48
6479-49-FD	1/2/2024	13:02	Early Education Center - Sink Tap - Room 708	1	Wt	Grab	X								49

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brett Jung						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Linda Mabson	1/16/24		
	Time:			Time:		
				08:30		

3 H A 0 0 9 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HA0092
														Short Hold:	
														Rush:	
														Temp: oC	18.0
6479-50-FD	1/2/2024	13:02	Early Education Center - Bubbler - Room 708	1	Wt	Grab	X								S0
6479-51-FD	1/2/2024	13:03	Early Education Center - Sink Tap - Room 706	1	Wt	Grab	X								S1
6479-52-FD	1/2/2024	13:04	Early Education Center - Sink Tap - Room 704	1	Wt	Grab	X								S2
6479-53-FD	1/2/2024	13:04	Early Education Center - Bubbler - Room 704	1	Wt	Grab	X								S3
6479-54-FD	1/2/2024	13:05	Early Education Center - Sink Tap - Room 702	1	Wt	Grab	X								S4
6479-55-FD	1/2/2024	13:05	Early Education Center - Bubbler - Room 702	1	Wt	Grab	X								S5
6479-56-FD	1/2/2024	13:06	Early Education Center - Sink Tap - Room 700	1	Wt	Grab	X								S6

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brett Jung						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:		Linda Mabom	Time:	08:30	

3 H A 0 0 9 2
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HA0092	
														Short Hold:	
														Rush:	
														Temp: oC 18.0	
6479-57-FD	1/2/2024	13:06	Early Education Center - Bubbler - Room 700	1	Wt	Grab	X								57
6479-58-FD	1/2/2024	13:08	Early Education Center - Drinking Fountain - Outside 702- Far Left	1	Wt	Grab	X								58
6479-59-FD	1/2/2024	13:08	Early Education Center - Drinking Fountain - Outside 702-Left Middle	1	Wt	Grab	X								59
6479-60-FD	1/2/2024	13:08	Early Education Center - Drinking Fountain - Outside 702-Right Middle	1	Wt	Grab	X								60
6479-61-FD	1/2/2024	13:08	Early Education Center - Drinking Fountain - Outside 702-Far Right	1	Wt	Grab	X								61
6479-62-FD	1/2/2024	13:10	Early Education Center - Sink Tap - Room 316	1	Wt	Grab	X								62
6479-63-FD	1/2/2024	13:10	Early Education Center - Ice Machine - Room 316	1	Wt	Grab	X								63

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brett Jung						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				1/16/24		
	Time:		Linda Malcom	Time:		
				08:30		

3 H A 0 0 9 2
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
6479-64-FD	1/2/2024	13:11	Early Education Center - Drinking Fountain - Outside 316-Left	1	Wt	Grab	X								64
6479-65-FD	1/2/2024	13:11	Early Education Center - Drinking Fountain - Outside 316-Right	1	Wt	Grab	X								65
6479-66-FD	1/2/2024	13:13	Early Education Center - Sink Tap - Nurse Room 310	1	Wt	Grab	X								66
6479-67-FD	1/2/2024	13:13	Early Education Center - Sink Tap - Nurse Prep Room	1	Wt	Grab	X								67
6479-68-FD	1/2/2024	13:13	Early Education Center - Sink Tap - Nurse Room 310A	1	Wt	Grab	X								68
6479-69-FD	1/2/2024	13:14	Early Education Center - Ice Machine - Nurse Room 310	1	Wt	Grab	X								69
6479-70-FD	1/2/2024	13:15	Early Education Center - Sink Tap - Room 308	1	Wt	Grab	X								70

LAB USE ONLY
Wk Order #: 3HA0092
Short Hold:
Rush:
Temp: oC 18.0

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brad Jung						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Linda Malborn	1/16/24		
	Time:			Time:		
				08:30		

3 H A 0 0 9 2
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HA0092
														Short Hold:	
														Rush:	
														Temp: oC	18.0
6479-71-FD	1/2/2024	13:15	Early Education Center - Bubbler - Room 308	1	Wt	Grab	X								71
6479-72-FD	1/2/2024	13:16	Early Education Center - Sink Tap - Room 306	1	Wt	Grab	X								72
6479-73-FD	1/2/2024	13:16	Early Education Center - Bubbler - Room 306	1	Wt	Grab	X								73
6479-74-FD	1/2/2024	13:17	Early Education Center - Sink Tap - Room 304	1	Wt	Grab	X								74
6479-75-FD	1/2/2024	13:17	Early Education Center - Bubbler - Room 304	1	Wt	Grab	X								75
6479-76-FD	1/2/2024	13:19	Early Education Center - Sink Tap - Room 307	1	Wt	Grab	X								76
6479-77-FD	1/2/2024	13:19	Early Education Center - Bubbler - Room 307	1	Wt	Grab	X								77

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				1/16/24		
	Time:		Linda Malcom	Time:		
				08:30		

3HA0092
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HA0092
														Short Hold:	
														Rush:	
														Temp: oC	18.0
6479-78-FD	1/2/2024	13:20	Early Education Center - Sink Tap - Room 303	1	Wt	Grab	X								78
6479-79-FD	1/2/2024	13:20	Early Education Center - Bubbler - Room 303	1	Wt	Grab	X								79
6479-80-FD	1/2/2024	13:21	Early Education Center - Sink Tap - Room 300	1	Wt	Grab	X								80
6479-81-FD	1/2/2024	13:22	Early Education Center - Bubbler - Room 300	1	Wt	Grab	X								81
6479-82-FD	1/2/2024	13:23	Early Education Center - Sink Tap - Room 302	1	Wt	Grab	X								82
6479-83-FD	1/2/2024	13:23	Early Education Center - Bubbler - Room 302	1	Wt	Grab	X								83
6479-84-FD	1/2/2024	13:25	Early Education Center - Sink Tap - Room 206	1	Wt	Grab	X								84

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brett Jung						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:		Linda Mahoney	Time:	08:30	

3 H A 0 0 9 2
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HA0092	
														Short Hold:	
														Rush:	
														Temp: oC 18.0	
6479-85-FD	1/2/2024	13:25	Early Education Center - Bubbler - Room 206	1	Wt	Grab	X								85
6479-86-FD	1/2/2024	13:26	Early Education Center - Sink Tap - Room 204	1	Wt	Grab	X								86
6479-87-FD	1/2/2024	13:26	Early Education Center - Bubbler - Room 204	1	Wt	Grab	X								87
6479-88-FD	1/2/2024	13:28	Early Education Center - Sink Tap - Room 201	1	Wt	Grab	X								88
6479-89-FD	1/2/2024	13:28	Early Education Center - Bubbler - Room 201	1	Wt	Grab	X								89
6479-90-FD	1/2/2024	13:29	Early Education Center - Sink Tap - Room 105	1	Wt	Grab	X								90
6479-91-FD	1/2/2024	13:29	Early Education Center - Bubbler - Room 105	1	Wt	Grab	X								91

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brett Jung						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:		Linda Malsom	Time:	08:30	

3 H A 0 0 9 2
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
6479-92-FD	1/2/2024	13:31	Early Education Center - Sink Tap - Room 202	1	Wt	Grab	X								92
6479-93-FD	1/2/2024	13:31	Early Education Center - Bubbler - Room 202	1	Wt	Grab	X								93
6479-94-FD	1/2/2024	13:31	Early Education Center - Sink Tap - Outside 202	1	Wt	Grab	X								94
6479-95-FD	1/2/2024	13:32	Early Education Center - Sink Tap - Room 200	1	Wt	Grab	X								95
6479-96-FD	1/2/2024	13:32	Early Education Center - Sink Tap - Room 112	1	Wt	Grab	X								96
6479-97-FD	1/2/2024	13:33	Early Education Center - Bubbler - Room 112	1	Wt	Grab	X								97
6479-98-FD	1/2/2024	13:33	Early Education Center - Sink Tap - Room 110	1	Wt	Grab	X								98

LAB USE ONLY: Wk Order #: 3HA0092; Short Hold:; Rush:; Temp: oC 18.0

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brett Jung						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				1/16/24		
	Time:		Linda Mabon	Time: 08:30		

3 H A 0 0 9 2
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HA0092
														Short Hold:	
														Rush:	
														Temp: oC	18.0
6479-99-FD	1/2/2024	13:33	Early Education Center - Bubbler - Room 110	1	Wt	Grab	X								99
6479-100-FD	1/2/2024	13:34	Early Education Center - Sink Tap - Room 104	1	Wt	Grab	X								AA
6479-101-FD	1/2/2024	13:34	Early Education Center - Bubbler - Room 104	1	Wt	Grab	X								AB
6479-102-FD	1/2/2024	13:34	Early Education Center - Sink Tap - Room 101	1	Wt	Grab	X								AC
6479-103-FD	1/2/2024	13:34	Early Education Center - Bubbler - Room 101	1	Wt	Grab	X								AD
6479-104-FD	1/2/2024	13:35	Early Education Center - Sink Tap - Room 102	1	Wt	Grab	X								AE
6479-105-FD	1/2/2024	13:35	Early Education Center - Ice Machine - Room 102	1	Wt	Grab	X								AF

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
Brad Jay						
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
	Time:		Linda Malcom	Time:	08:30	

3HA0092
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HA0092	
														Short Hold:	
														Rush:	
														Temp: oC 18.0	
6479-106-FD	1/2/2024	13:35	Early Education Center - Drinking Fountain - Outside 016-Left	1	Wt	Grab	X								AG
6479-107-FD	1/2/2024	13:35	Early Education Center - Drinking Fountain - Outside 016-Right	1	Wt	Grab	X								AH
6479-108-FD	1/2/2024	13:36	Early Education Center - Sink Tap - Kitchen-South Handwashing	1	Wt	Grab	X								AI
6479-109-FD	1/2/2024	13:36	Early Education Center - Sink Tap - Kitchen-South Sink	1	Wt	Grab	X								AJ
6479-110-FD	1/2/2024	13:36	Early Education Center - Steam Kettle - Kitchen	1	Wt	Grab	X								AK
6479-111-FD	1/2/2024	13:36	Early Education Center - Sink Tap - Kitchen-North Handwashing	1	Wt	Grab	X								AL
6479-112-FD	1/2/2024	13:37	Early Education Center - Sink Tap - Kitchen-East Handwashing	1	Wt	Grab	X								AM

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
Brett Jung					
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
			Linda Malborn	1/16/24	
	Time:			Time:	
				08:30	

Remarks:

3 H A 0 0 9 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HA0092	
														Short Hold:	
														Rush:	
														Temp: oC 18.0	
6479-113-FD	1/2/2024	13:37	Early Education Center - Sink Tap - Kitchen- 3 Bay Sink-Left	1	Wt	Grab	X								AN
6479-114-FD	1/2/2024	13:37	Early Education Center - Sink Tap - Kitchen-3 Bay Sink-Middle	1	Wt	Grab	X								AO
6479-115-FD	1/2/2024	13:38	Early Education Center - Sink Tap - Kitchen-3 Bay Sink-Right	1	Wt	Grab	X								AP
6479-116-FD	1/2/2024	13:38	Early Education Center - Sink Tap - Kitchen-Garbage Sink	1	Wt	Grab	X								AQ
6479-117-FD	1/2/2024	13:38	Early Education Center - Sink Tap - Workroom 013	1	Wt	Grab	X								AR
6479-118-FD	1/2/2024	13:38	Early Education Center - Ice Machine - Workroom 013	1	Wt	Grab	X								AS
6479-119-FD	1/2/2024	13:42	Early Education Center - Drinking Fountain - IT Lobby-Left	1	Wt	Grab	X								AT

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
Brett Jung					
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
			Linda Mabson	1/16/24	
	Time:			Time:	
				08:30	

Remarks:

3 H A 0 0 9 2
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HA0092
														Short Hold:	
														Rush:	
														Temp: oC	18.0
6479-120-FD	1/2/2024	13:42	Early Education Center - Drinking Fountain - IT Lobby-Right	1	Wt	Grab	X								AU
6479-121-FD	1/2/2024	13:42	Early Education Center - Sink Tap - IT Center-Kitchenette	1	Wt	Grab	X								AV
6479-122-FD	1/2/2024	13:42	Early Education Center - Ice Machine - IT Center-Kitchenette	1	Wt	Grab	X								AW
6479-123-FD	1/2/2024	13:44	Early Education Center - Drinking Fountain - PD-Left	1	Wt	Grab	X								AX
6479-124-FD	1/2/2024	13:44	Early Education Center - Drinking Fountain - PD-Right	1	Wt	Grab	X								AY
6479-125-FD	1/2/2024	13:45	Early Education Center - Sink Tap - PD-Kitchen-Right	1	Wt	Grab	X								AZ
6479-126-FD	1/2/2024	13:45	Early Education Center - Sink Tap - PD-Kitchen-Left	1	Wt	Grab	X								BA

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24
			Linda Nabors	Time:	08:30
	Time:				

Remarks:

3HA0092

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	6479 North Prospect Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Gladstone, Missouri 64119	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
6479-127-FD	1/2/2024	13:45	Early Education Center - Ice Machine - PD Kitchen	1	Wt	Grab	X								BB
6479-128-FD	1/2/2024	13:50	Early Education Center - Drinking Fountain - Adult Learning-Outside 108-Left	1	Wt	Grab	X								BC
6479-129-FD	1/2/2024	13:50	Early Education Center - Drinking Fountain - Adult Learning-Outside 108-Right	1	Wt	Grab	X								BD
6479-130-FD	1/2/2024	12:36	Early Education Center - Bubbler - Room 402	1	Wt	Grab	X								BE

LAB USE ONLY
Wk Order #: 3HA0092
Short Hold:
Rush:
Temp: oC 18.0

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	1/16/24	
				Time:	08:30	
	Time:					

3 H A 0 0 9 2
AXIOM Service Professionals
PM: Carolyn Jackson

Appendix D
Photo Log



1/2/2024 - 6479-1 - Early Education Center - Lobby



1/2/2024 - 6479-2 - Early Education Center - Room 400



1/2/2024 - 6479-3 - Early Education Center - Room 402




1/2/2024 - 6479-4 - Early Education Center - Outside 405a




1/2/2024 - 6479-5 - Early Education Center - Room 406



1/2/2024 - 6479-6 - Early Education Center - Room 406

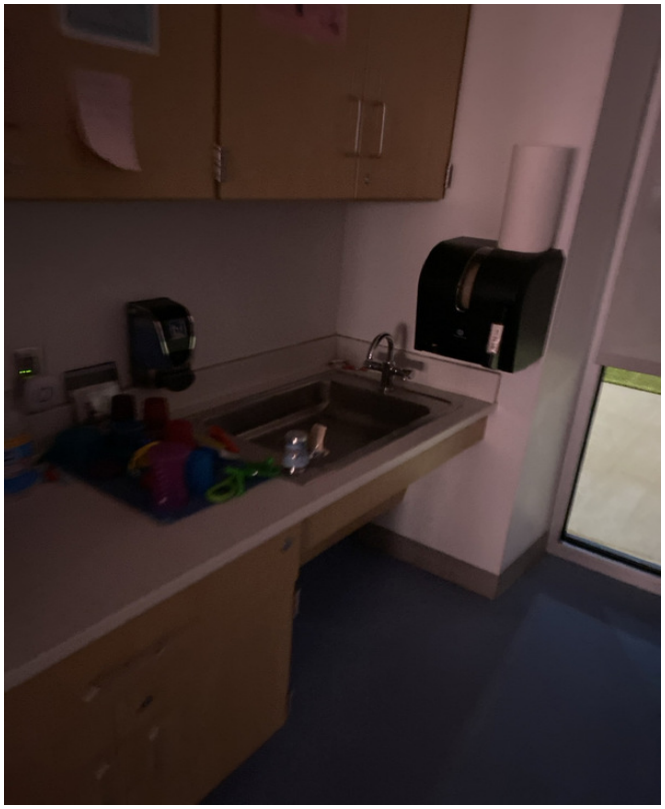

1/2/2024 - 6479-7 - Early Education Center - Room 408

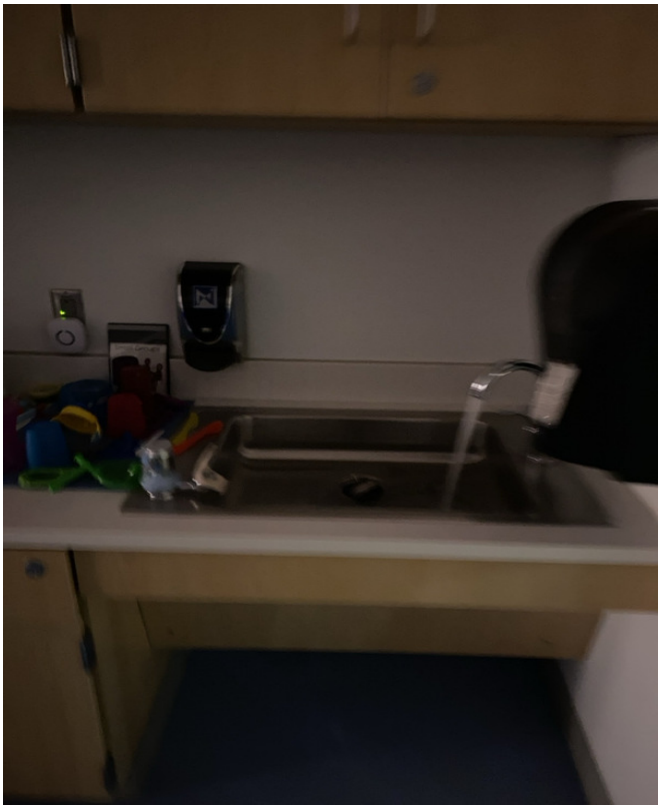


1/2/2024 - 6479-8 - Early Education Center - Room 408




1/2/2024 - 6479-9 - Early Education Center - Room 802



1/2/2024 - 6479-10 - Early Education Center - Room 802

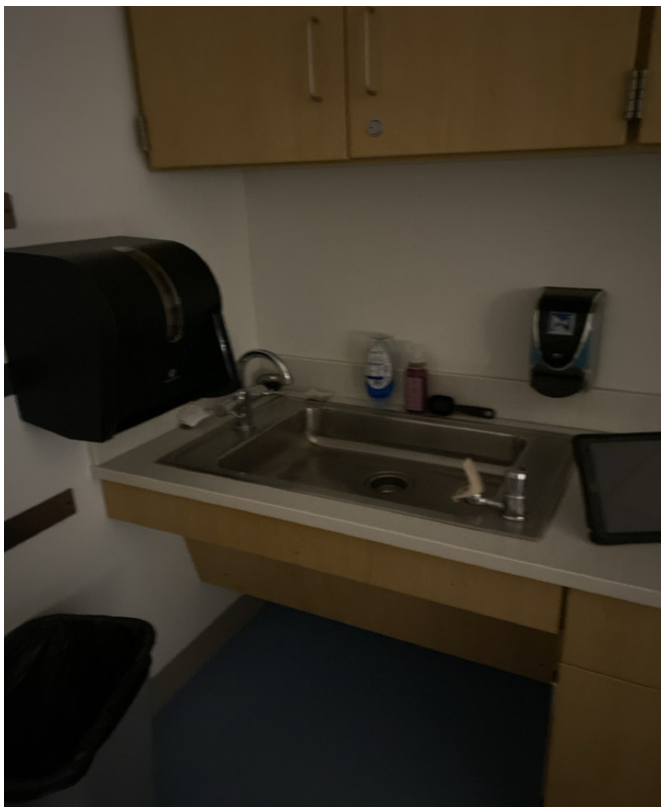

1/2/2024 - 6479-11 - Early Education Center - Room 806

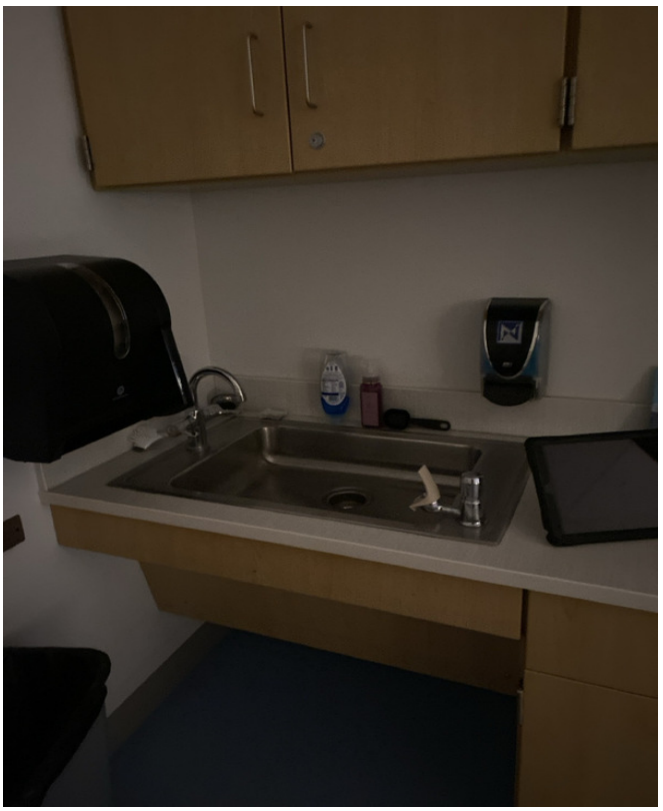


1/2/2024 - 6479-12 - Early Education Center - Room 806




1/2/2024 - 6479-13 - Early Education Center - Room 803



1/2/2024 - 6479-14 - Early Education Center - Room 803

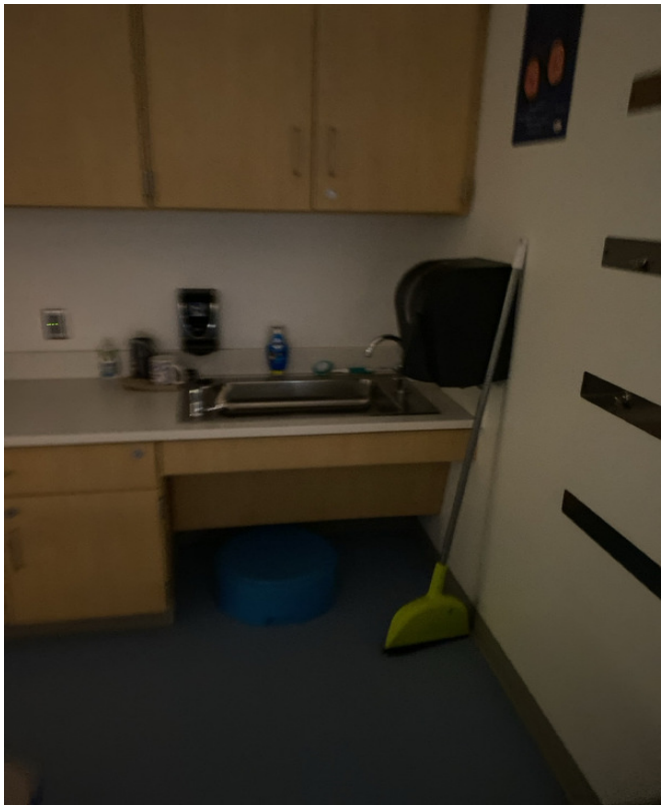

1/2/2024 - 6479-15 - Early Education Center - Room 801

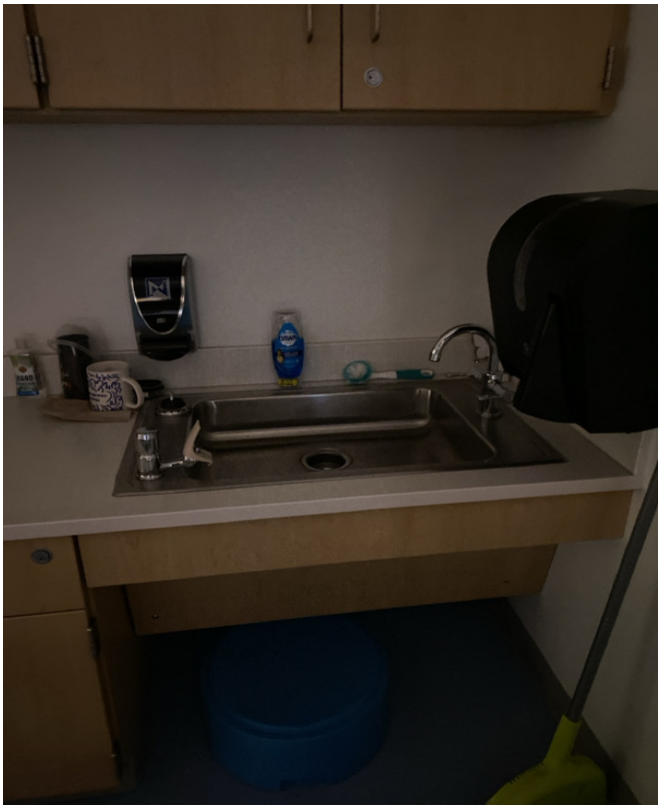

1/2/2024 - 6479-16 - Early Education Center - Room 801



1/2/2024 - 6479-17 - Early Education Center - Room 504-Left



1/2/2024 - 6479-18 - Early Education Center - Room 504-Right



1/2/2024 - 6479-19 - Early Education Center - Room 502



1/2/2024 - 6479-20 - Early Education Center - Room 506



1/2/2024 - 6479-21 - Early Education Center - Room 506



1/2/2024 - 6479-22 - Early Education Center - Room 501



1/2/2024 - 6479-23 - Early Education Center - Room 501



1/2/2024 - 6479-24 - Early Education Center - Room 601




1/2/2024 - 6479-25 - Early Education Center - Room 601




1/2/2024 - 6479-26 - Early Education Center - Room 508



1/2/2024 - 6479-27 - Early Education Center - Room 508

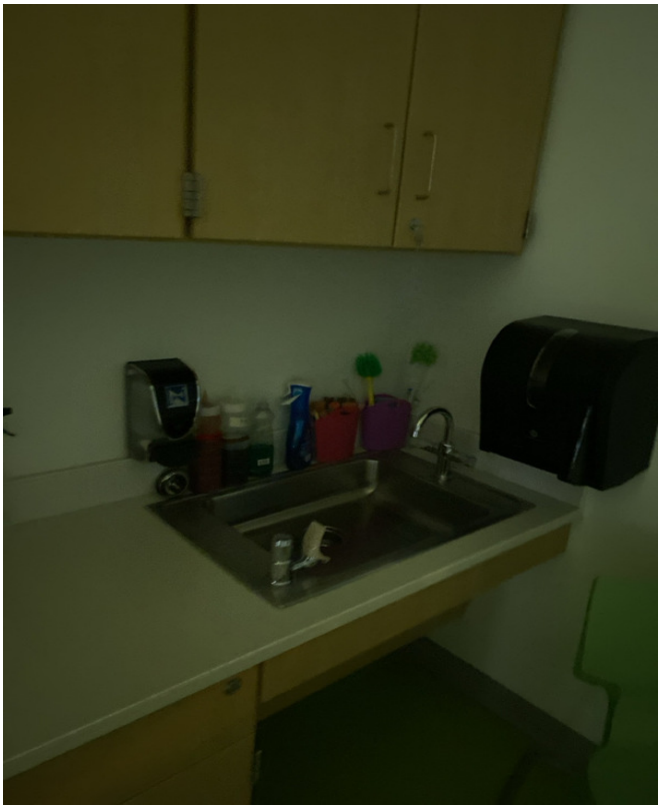

1/2/2024 - 6479-28 - Early Education Center - Room 510

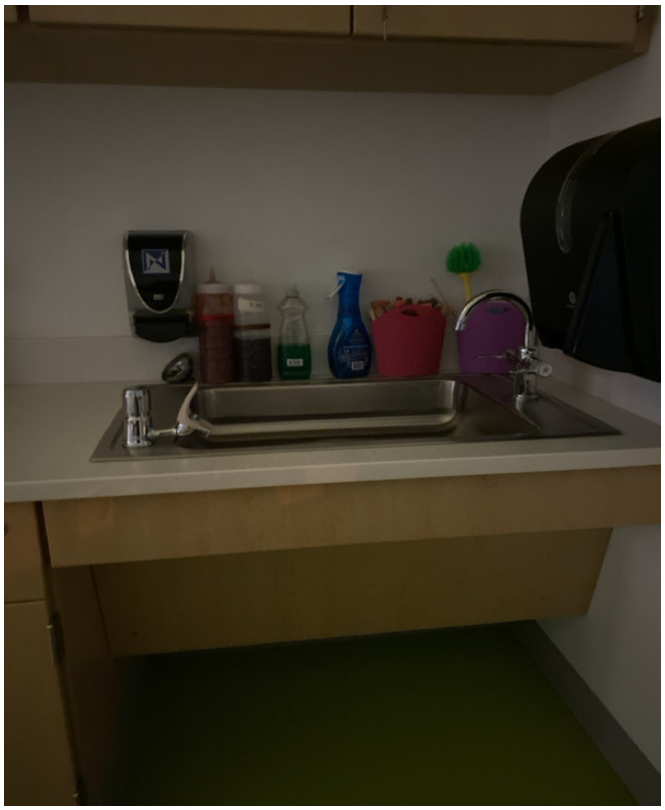

1/2/2024 - 6479-29 - Early Education Center - Room 510



1/2/2024 - 6479-30 - Early Education Center - Outside 508



1/2/2024 - 6479-31 - Early Education Center - Room 512



1/2/2024 - 6479-32 - Early Education Center - Room 512



1/2/2024 - 6479-33 - Early Education Center - Outside 512-Left



1/2/2024 - 6479-34 - Early Education Center - Outside 512-Right



1/2/2024 - 6479-35 - Early Education Center - Room 503




1/2/2024 - 6479-36 - Early Education Center - Room 503



1/2/2024 - 6479-37 - Early Education Center - Room 600



1/2/2024 - 6479-38 - Early Education Center - Room 600

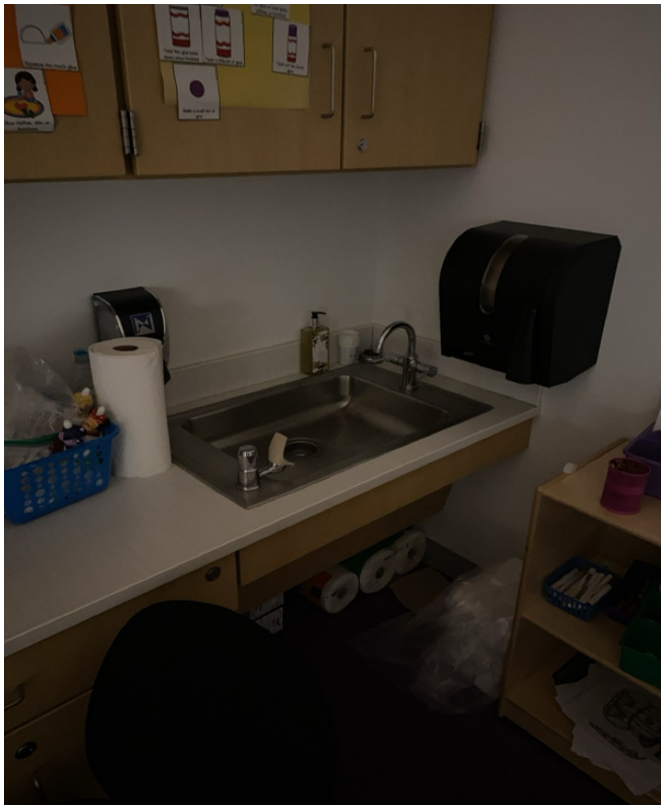

1/2/2024 - 6479-39 - Early Education Center - Room 606



1/2/2024 - 6479-40 - Early Education Center - Room 606



1/2/2024 - 6479-41 - Early Education Center - Room 605



1/2/2024 - 6479-42 - Early Education Center - Room 605



1/2/2024 - 6479-43 - Early Education Center - Room 608



1/2/2024 - 6479-44 - Early Education Center - Room 912



1/2/2024 - 6479-45 - Early Education Center - Room 913



1/2/2024 - 6479-46 - Early Education Center - Room 710



1/2/2024 - 6479-47 - Early Education Center - Room 710



1/2/2024 - 6479-48 - Early Education Center - Outside 710



1/2/2024 - 6479-49 - Early Education Center - Room 708



1/2/2024 - 6479-50 - Early Education Center - Room 708



1/2/2024 - 6479-51 - Early Education Center - Room 706



1/2/2024 - 6479-52 - Early Education Center - Room 704



1/2/2024 - 6479-53 - Early Education Center - Room 704



1/2/2024 - 6479-54 - Early Education Center - Room 702



1/2/2024 - 6479-55 - Early Education Center - Room 702



1/2/2024 - 6479-56 - Early Education Center - Room 700



1/2/2024 - 6479-57 - Early Education Center - Room 700



1/2/2024 - 6479-58 - Early Education Center - Outside 702- Far Left



1/2/2024 - 6479-59 - Early Education Center - Outside 702-Left Middle



1/2/2024 - 6479-60 - Early Education Center - Outside 702-Right Middle



1/2/2024 - 6479-61 - Early Education Center - Outside 702-Far Right



1/2/2024 - 6479-62 - Early Education Center - Room 316



1/2/2024 - 6479-63 - Early Education Center - Room 316



1/2/2024 - 6479-64 - Early Education Center - Outside 316-Left



1/2/2024 - 6479-65 - Early Education Center - Outside 316-Right



1/2/2024 - 6479-66 - Early Education Center - Nurse's Room 310



1/2/2024 - 6479-67 - Early Education Center - Nurse's Prep Room



1/2/2024 - 6479-68 - Early Education Center - Nurse's Room 310A




1/2/2024 - 6479-69 - Early Education Center - Nurse's Room 310



1/2/2024 - 6479-70 - Early Education Center - Room 308



1/2/2024 - 6479-71 - Early Education Center - Room 308

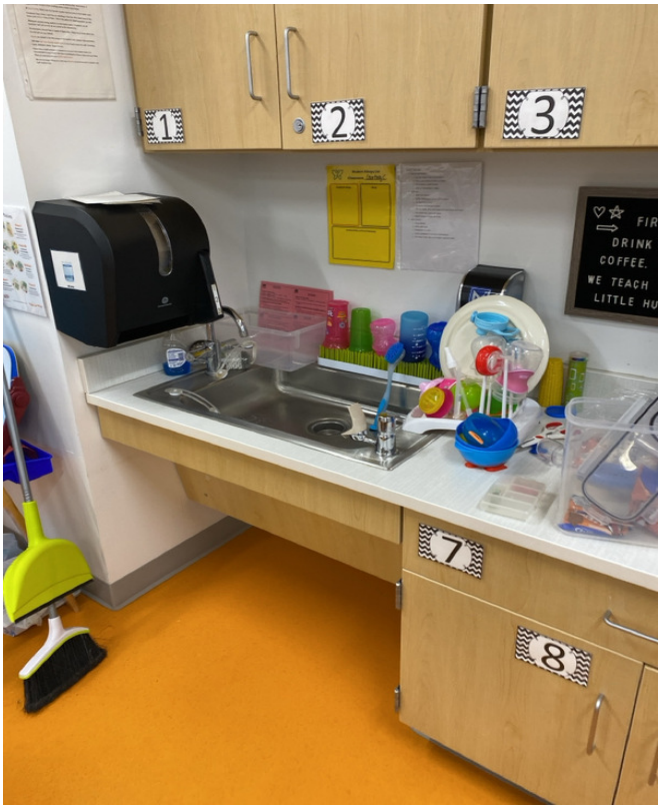

1/2/2024 - 6479-72 - Early Education Center - Room 306



1/2/2024 - 6479-73 - Early Education Center - Room 306



1/2/2024 - 6479-74 - Early Education Center - Room 304



1/2/2024 - 6479-75 - Early Education Center - Room 304



1/2/2024 - 6479-76 - Early Education Center - Room 307



1/2/2024 - 6479-77 - Early Education Center - Room 307



1/2/2024 - 6479-78 - Early Education Center - Room 303



1/2/2024 - 6479-79 - Early Education Center - Room 303



1/2/2024 - 6479-80 - Early Education Center - Room 300



1/2/2024 - 6479-81 - Early Education Center - Room 300



1/2/2024 - 6479-82 - Early Education Center - Room 302



1/2/2024 - 6479-83 - Early Education Center - Room 302



1/2/2024 - 6479-84 - Early Education Center - Room 206



1/2/2024 - 6479-85 - Early Education Center - Room 206



1/2/2024 - 6479-86 - Early Education Center - Room 204



1/2/2024 - 6479-87 - Early Education Center - Room 204



1/2/2024 - 6479-88 - Early Education Center - Room 201



1/2/2024 - 6479-89 - Early Education Center - Room 201



1/2/2024 - 6479-90 - Early Education Center - Room 105



1/2/2024 - 6479-91 - Early Education Center - Room 105



1/2/2024 - 6479-92 - Early Education Center - Room 202



1/2/2024 - 6479-93 - Early Education Center - Room 202



1/2/2024 - 6479-94 - Early Education Center - Outside 202



1/2/2024 - 6479-95 - Early Education Center - Room 200



1/2/2024 - 6479-96 - Early Education Center - Room 112



1/2/2024 - 6479-97 - Early Education Center - Room 112



1/2/2024 - 6479-98 - Early Education Center - Room 110



1/2/2024 - 6479-99 - Early Education Center - Room 110



1/2/2024 - 6479-100 - Early Education Center - Room 104



1/2/2024 - 6479-101 - Early Education Center - Room 104



1/2/2024 - 6479-102 - Early Education Center - Room 101



1/2/2024 - 6479-103 - Early Education Center - Room 101



1/2/2024 - 6479-104 - Early Education Center - Room 102



1/2/2024 - 6479-105 - Early Education Center - Room 102



1/2/2024 - 6479-106 - Early Education Center - Outside 016-Left



1/2/2024 - 6479-107 - Early Education Center - Outside 016-Right



1/2/2024 - 6479-108 - Early Education Center - Kitchen-South Handwashing



1/2/2024 - 6479-109 - Early Education Center - Kitchen-South Sink



1/2/2024 - 6479-110 - Early Education Center - Kitchen



1/2/2024 - 6479-111 - Early Education Center - Kitchen-North Handwashing



1/2/2024 - 6479-112 - Early Education Center - Kitchen-East Handwashing



1/2/2024 - 6479-113 - Early Education Center - Kitchen- 3 Bay Sink-Left



1/2/2024 - 6479-114 - Early Education Center - Kitchen-3 Bay Sink-Middle



1/2/2024 - 6479-115 - Early Education Center - Kitchen-3 Bay Sink-Right



1/2/2024 - 6479-116 - Early Education Center - Kitchen-Garbage Sink



1/2/2024 - 6479-117 - Early Education Center - Workroom 013



1/2/2024 - 6479-118 - Early Education Center - Workroom 013



1/2/2024 - 6479-119 - Early Education Center - IT Lobby-Left



1/2/2024 - 6479-120 - Early Education Center - IT Lobby-Right



1/2/2024 - 6479-121 - Early Education Center - IT Center-Kitchenette



1/2/2024 - 6479-122 - Early Education Center - IT Center-Kitchenette



1/2/2024 - 6479-123 - Early Education Center - PD-Left



1/2/2024 - 6479-124 - Early Education Center - PD-Right



1/2/2024 - 6479-125 - Early Education Center - PD-Kitchen-Right



1/2/2024 - 6479-126 - Early Education Center - PD-Kitchen-Left



1/2/2024 - 6479-127 - Early Education Center - PD Kitchen



1/2/2024 - 6479-128 - Early Education Center - Adult Learning-Outside 108-Left



1/2/2024 - 6479-129 - Early Education Center - Adult Learning-Outside 108-Right

Appendix E
Source Identification Diagram

ASP was provided sample locations by
North Kansas City School District

EMERGENCY EVACUATION PLAN

Early Education Center

6479 N. Prospect, Gladstone, MO 64119



LEGEND

- YOU ARE HERE
- PRIMARY EXIT ROUTE
- SECONDARY EXIT ROUTE
- STAIRS
- FIRE EXTINGUISHER
- FIRE ALARM
- SHELTER AREA
- RR RESTROOM

IN THE CASE OF AN EMERGENCY CALL 911

Floor Plan Not Provided for IT or PD
This Includes Source Samples 119-130