



Introduction

Radon is a colorless and odorless gas that comes from the soil. Exposure to radon over time can cause lung cancer. The U.S. Environmental Protection Agency (EPA) has set a target level of 4 pCi/L and to consider action at 2 pCi/L.

Meridian Consulting conducted short-term radon testing for Grey Cloud Elementary at 9525 Indian Blvd, Cottage Grove, MN 55016. Testing was conducted to determine if occupants are exposed to elevated levels of radon. Radon testing was done according to ANSI/AARST MA-MFLB 2023.

Testing

Testing was conducted from 02/05/2024 to 02/07/2024 using Air Chek Pro Chek radon test kits from Air Chek, Inc. 1936 Butler Bridge Rd, Mills River, NC. 28759, NRPP Certified Lab # 101138 AL.

Testing was conducted by the following Minnesota Department of Health (MDH) licensed radon measurement professionals:

Name	MDH License #	Signature
Wendy German	RMEA-00447	

All ground-contact rooms that are occupied or intended to be occupied were tested. In addition, tests were conducted in all rooms above ground-contact rooms that were not tested. On second floors, ten percent of rooms were tested with at least one test conducted on each story.

Test Conditions

Radon levels in a building can be influenced by many factors including weather, season, and occupancy patterns. Temporary conditions observed during the testing period may cause the test to not reflect the occupant's risk from radon.

The radon levels stated for this period had the following situations present:

There were no situations present that would interfere with accurate testing.

Test Results

One test result was between 2 – 3.9 pCi/L. Locations of the test results are shown in the map location in Appendix A. All remaining results were less than 2 pCi/L.

Missing or Invalid Test Results

Location	Missing/Invalid/Not Tested	Explanation
n/a	None	n/a

There were no missing tests.

Quality Assurance and Quality Control

Quality control measurements were conducted in compliance with ANSI/AARST MA-MFLB 2023.

Recommendations

Test result is 4.0 pCi/L or greater:

- Fix the building if test results indicate occupants may be exposed to radon concentrations that meet or exceed the EPA action level of 4.0 pCi/L.
- Efforts to reduce radon concentrations are not complete until a retest provides evidence of effectiveness.
- The initial retest should be conducted within 30 days after mitigation efforts and system installations.
- Post-mitigation clearance testing to confirm each building is fixed requires testing all buildings that demonstrated elevated radon concentrations:
 1. in all ground-contact rooms and dwellings,
 2. in not less than 10% of non-residential rooms and dwellings on each upper floor.
- Should testing indicate that concentrations meet or exceed the action level, conduct evaluations, corrections, and further testing under radon concentrations have been mitigated to below the action level.
- Retest every 2 years to ensure the system remains effective.

Test results between 2.0 and 4.0 pCi/L:

- Consider fixing the building if the test results indicate radon levels greater than half of the EPA action level.
- Tests conducted when heating systems are active both day and night are more likely to provide a clear characterization of potential radon hazards.

When to Retest:

- Retest every 5 years if no mitigation system is installed.
- Retest in conjunction with the sale of any new or existing building.
- Be certain to test again when any of the following circumstances occur:
 - A new addition is constructed or alterations for building rehab or reconfiguration occur;
 - A ground contact area not previously tested is occupied, or a building is newly occupied;
 - Heating and cooling systems are significantly altered, resulting in changes to air pressure or pressure relationships;
 - Ventilation is significantly altered by extensive weatherization, changes to mechanical systems or comparable procedures;
 - Significant openings to the soil occur due to:
 - Groundwater or slab surface water control systems that are altered or added (ex. sumps, perimeter drain tile, shower/tub retrofits) or,
 - Natural settlement causing major cracks to develop.
 - Earthquakes, construction blasting, or formation of sink holes nearby; or
 - A radon mitigation system is altered, modified, or repaired.

Radon Information

Additional information on radon can be found on the Minnesota Department of Health's website at mn.gov/radon or by contacting them at 651-201-4601 or health.indoorair@state.mn.us.

If you have any questions, please contact us at 320-224-1908 or wendy@meridianconsult.net

Appendix A: Floor Plan Diagram

[MAP HAS BEEN REMOVED FROM THIS REPORT]

Appendix B: Test Conditions

- The minimum outdoor temperature that existed 12 hours prior to and during the test period was 25°F. The maximum outdoor temperature was 55°F. The average outdoor temperature was 41°F.
- Weather was mild and rainy. No snow coverage on ground.

		Annual	During the Test
Outdoor Temperatures	Avg. °F	45°	41°
Operating Conditions	Heating (% year)	75%	100%
Operating Conditions	Cooling (% year)	0	0
Operating Conditions	Mixed (% year)	25%	0
Prevailing Operating Condition	Heating/Cooling/Mixed	Heating	Heating

Appendix C: Quality Control Measurements

Duplicates: Two devices are placed next to each other for the results to be compared. This measures the accuracy and consistency of the lab, and the quality and reproducibility of the testing kits.

Sample ID	Result	Average	Pass/Fail
11449175	< 0.3	< 0.3	Pass
11449173	< 0.3		
11449183	< 0.3	< 0.3	Pass
11449180	< 0.3		
11449151	1.5	1.3	Pass
11449148	1.0		
11449134	0.8	0.6	Pass
11449139	< 0.3		
11449158	0.9	1.7	Pass
11449163	2.4		
11449124	1.1	1.2	Pass
11449123	1.2		
11449104	.8	.8	Pass
11449103	.7		

Blanks: Devices that are sealed immediately and not exposed to air at different times during the testing process. Transit blanks are sent to the lab immediately after receiving the test kits to verify that no radon has been accumulated through transit. Office blanks are sealed on test day to verify that no radon has been accumulated during storage. Field blanks are sealed and placed throughout the buildings being tested.

Transit	7408066	< 0.3	Pass
Transit	7408065	< 0.3	Pass
Transit	7408064	< 0.3	Pass
Office	11726803	< 0.3	Pass
Office	11726802	< 0.3	Pass
Office	11726801	< 0.3	Pass

Staff Dining	11449113	< 0.3	Pass
002B	11449178	< 0.3	Pass
140	11449136	< 0.3	Pass
Nurse	11449106	< 0.3	Pass

Spikes: devices that are sent to a third-party lab, where it is exposed to a known concentration of radon. The device is then sent to the lab to compare results. This measures the accuracy of the test kits.

Sample ID	Exposed	Result	Pass/Fail
11726672	10.5	12.2	Pass
11726673	10.5	11.6	Pass
11726674	10.5	12.2	Pass
11726675	10.5	12.4	Pass
11726679	10.5	12.1	Pass
11726680	10.5	10.9	Pass

Appendix D: Analytical Results

Sample ID	Location	Start Date/Time	End Date/Time	Duplicates	Result
11449179	001	2/5/24 9:00	2/7/24 8:00		0.7
11449187	002A	2/5/24 9:00	2/7/24 8:00		< 0.3
11449177	002B	2/5/24 9:00	2/7/24 8:00		< 0.3
11449147	003	2/5/24 8:00	2/7/24 8:00		0.9
11449150	004A	2/5/24 8:00	2/7/24 8:00		0.6
11449145	004B	2/5/24 8:00	2/7/24 8:00		< 0.3
11449167	005	2/5/24 9:00	2/7/24 8:00		1.7
11449168	006	2/5/24 9:00	2/7/24 8:00		1.2
11449169	006C	2/5/24 9:00	2/7/24 8:00		0.7
11449189	100	2/5/24 9:00	2/7/24 9:00		< 0.3
11449166	101	2/5/24 9:00	2/7/24 8:00		1.3
11449165	102	2/5/24 9:00	2/7/24 8:00		1.7
11449157	104	2/5/24 9:00	2/7/24 8:00		1.3
11449160	105	2/5/24 9:00	2/7/24 8:00		1.5
11449159	106B	2/5/24 9:00	2/7/24 8:00		< 0.3
11449188	108	2/5/24 9:00	2/7/24 8:00		1.3
11449138	109	2/5/24 9:00	2/7/24 8:00		1.3
11449161	112A	2/5/24 9:00	2/7/24 8:00		< 0.3
11449170	115	2/5/24 9:00	2/7/24 8:00		< 0.3
11449171	116	2/5/24 9:00	2/7/24 8:00		< 0.3
11449172	117	2/5/24 9:00	2/7/24 8:00		0.6
11449175	118	2/5/24 9:00	2/7/24 8:00	< 0.3	< 0.3
11449173	118	2/5/24 9:00	2/7/24 8:00	< 0.3	
11449174	119	2/5/24 9:00	2/7/24 8:00		0.7
11449176	120	2/5/24 9:00	2/7/24 8:00		0.3
11449186	121	2/5/24 9:00	2/7/24 8:00		1.1
11449184	122	2/5/24 9:00	2/7/24 8:00		< 0.3
11449185	123	2/5/24 9:00	2/7/24 8:00		1.2

11449182	124	2/5/24 9:00	2/7/24 8:00		0.7
11449181	125	2/5/24 9:00	2/7/24 8:00		< 0.3
11449183	126	2/5/24 9:00	2/7/24 8:00	< 0.3	< 0.3
11449180	126	2/5/24 9:00	2/7/24 8:00	< 0.3	
11449162	127	2/5/24 9:00	2/7/24 8:00		< 0.3
11449146	128	2/5/24 8:00	2/7/24 8:00		< 0.3
11449151	129	2/5/24 8:00	2/7/24 8:00	1.5	1.3
11449148	129	2/5/24 8:00	2/7/24 8:00	1.0	
11449153	130	2/5/24 8:00	2/7/24 8:00		< 0.3
11449149	131	2/5/24 8:00	2/7/24 8:00		1.0
11449152	132	2/5/24 8:00	2/7/24 8:00		0.7
11449144	133	2/5/24 8:00	2/7/24 8:00		< 0.3
11449142	134	2/5/24 8:00	2/7/24 8:00		1.2
11449143	135	2/5/24 8:00	2/7/24 8:00		0.7
11449141	136	2/5/24 8:00	2/7/24 8:00		1.3
11449140	137	2/5/24 8:00	2/7/24 8:00		< 0.3
11449134	138	2/5/24 8:00	2/7/24 8:00	0.8	0.6
11449139	138	2/5/24 8:00	2/7/24 8:00	< 0.3	
11449129	139	2/5/24 8:00	2/7/24 8:00	0.9	0.8
11449130	139	2/5/24 8:00	2/7/24 8:00	0.6	
11449131	139A	2/5/24 8:00	2/7/24 8:00		< 0.3
11449135	140	2/5/24 8:00	2/7/24 8:00		1.0
11449132	140A	2/5/24 8:00	2/7/24 8:00		1.3
11449156	152	2/5/24 9:00	2/7/24 8:00		1.1
11449102	159	2/5/24 7:00	2/7/24 7:00		1.2
11449108	160	2/5/24 7:00	2/7/24 7:00		0.7
11449107	162	2/5/24 7:00	2/7/24 7:00		0.8
11449164	200	2/5/24 9:00	2/7/24 8:00		1.5
11449158	201	2/5/24 9:00	2/7/24 8:00	0.9	1.7
11449163	201	2/5/24 9:00	2/7/24 8:00	2.4	

11449128	300	2/5/24 8:00	2/7/24 8:00		0.8
11449127	301	2/5/24 8:00	2/7/24 8:00		1.2
11449126	302	2/5/24 8:00	2/7/24 8:00		1.2
11449125	303	2/5/24 8:00	2/7/24 8:00		1.5
11449118	304	2/5/24 8:00	2/7/24 8:00		1.7
11449117	305	2/5/24 8:00	2/7/24 8:00		0.9
11449124	306	2/5/24 8:00	2/7/24 8:00	1.1	1.2
11449123	306	2/5/24 8:00	2/7/24 8:00	1.2	
11449133	Commons	2/5/24 8:00	2/7/24 8:00		1.1
11449137	Commons 2	2/5/24 8:00	2/7/24 8:00		0.8
11449109	Custodian	2/5/24 8:00	2/7/24 7:00		1.7
11449115	Gym 2	2/5/24 8:00	2/7/24 8:00		0.7
11449116	Gym 3	2/5/24 8:00	2/7/24 8:00		0.6
11449119	Gym 4	2/5/24 8:00	2/7/24 8:00		1.3
11449120	Gym 5	2/5/24 8:00	2/7/24 8:00		0.8
11449121	Gym 6	2/5/24 8:00	2/7/24 8:00		0.8
11449122	Gym Office	2/5/24 8:00	2/7/24 8:00		1.8
11449114	Gym 1	2/5/24 8:00	2/7/24 8:00		0.9
11449111	Kitchen	2/5/24 8:00	2/7/24 8:00		1.3
11449110	Kitchen Office	2/5/24 8:00	2/7/24 8:00		1.1
11449154	Media 1	2/5/24 8:00	2/7/24 8:00		< 0.3
11449155	Media 2	2/5/24 8:00	2/7/24 8:00		0.7
11449105	Nurse	2/5/24 7:00	2/7/24 7:00		< 0.3
11449104	Office	2/5/24 7:00	2/7/24 7:00	0.8	0.8
11449103	Office	2/5/24 7:00	2/7/24 7:00	0.7	
11449112	Staff Dining	2/5/24 8:00	2/7/24 8:00		0.6
11449101	Workroom	2/5/24 7:00	2/7/24 7:00		1.1

Appendix E: Test Notifications

Client Advisories Prior to Testing

Testing will be conducted in compliance with ANSI/AARST MA-MFLB 2023 and the Minnesota Radon Licensing Act.

- Tests will be done in 100% ground contact residential units and non-residential rooms that are occupied or intended to be occupied.
- In addition, 10% of residential units and non-residential rooms will be tested on each upper floor, with a minimum of one test per floor.
- Quality control measurements will be done at 10% duplicates (extended testing option), 5% blanks, and 3% spikes.
- Closed-building conditions must be maintained at least 12-hours prior to and during the test.

There are two test options that comply with the standards:

Time-Sensitive Testing	Extended Testing
Tests at each location are tested using two short-term test devices or a continuous radon monitor	Tests at each location are conducted using a single short-term test device
	All locations that meet or exceed the action level (4.0 pCi/L) are retested
Decisions to mitigate are based on the results of the average of the two short-term test devices or the average from a continuous radon monitor	Decisions to mitigate are based on the results of the average of the two rounds of testing

Failure to reasonably maintain test conditions can lead to unnecessary expense, disruptions, and unreliable data. Disturbing test devices can also cause reliable and invalid test results.

To aid in proper test conditions, the measurement professional will:

- Inform the person responsible for building operations of the required test conditions,
- Ensure “Radon Test in Progress” signs are posted in prominent locations,
- Attempt to obtain a signed statement from onsite supervisors or facilitating staff members that they will aid in the quality control of closed-building conditions, and
- Conduct a visual inspection upon detector placement and retrieval to ensure all closed-building conditions are met.

Please provide, in writing, a list of who is authorized to receive test data and at which junctures data should be provided.

Instructions for Notifying Individual of Test Conditions

Proper notification is essential to get compliance with required testing conditions.

Enclosed are notification forms for facilitating staff such as authorized building supervisors, maintenance staff, teachers, or office managers. Facilitating staff should ensure closed-building conditions are met in non-residential spaces at least 12-hours prior to the test and maintained during the test period.


In addition, notifications must be distributed to all occupants of tested and not-tested units and contain:

- Scheduled dates and times for test device placement and retrieval,
- Essential closed-building requirements portrayed in Table 4-A of the ANSI/AARST standard and that these conditions are required no later than 12 hours prior to the test and throughout the test period,
- Information on how to obtain federal or state radon health guidance, and
- Local contact information for inquiries, such as the authorized building supervisor.


Enclosed are notification forms for occupants. Please distribute notifications to occupants at least 24 hours prior to testing. Notifications also need to be posted in prominent areas such as entry doors and community bulletins.

Normal Occupied Building Conditions

Minnesota is in Temperature Zones 6 and 7. Across the state, the prevailing HVAC condition is heating. Radon testing is recommended during the heating season.

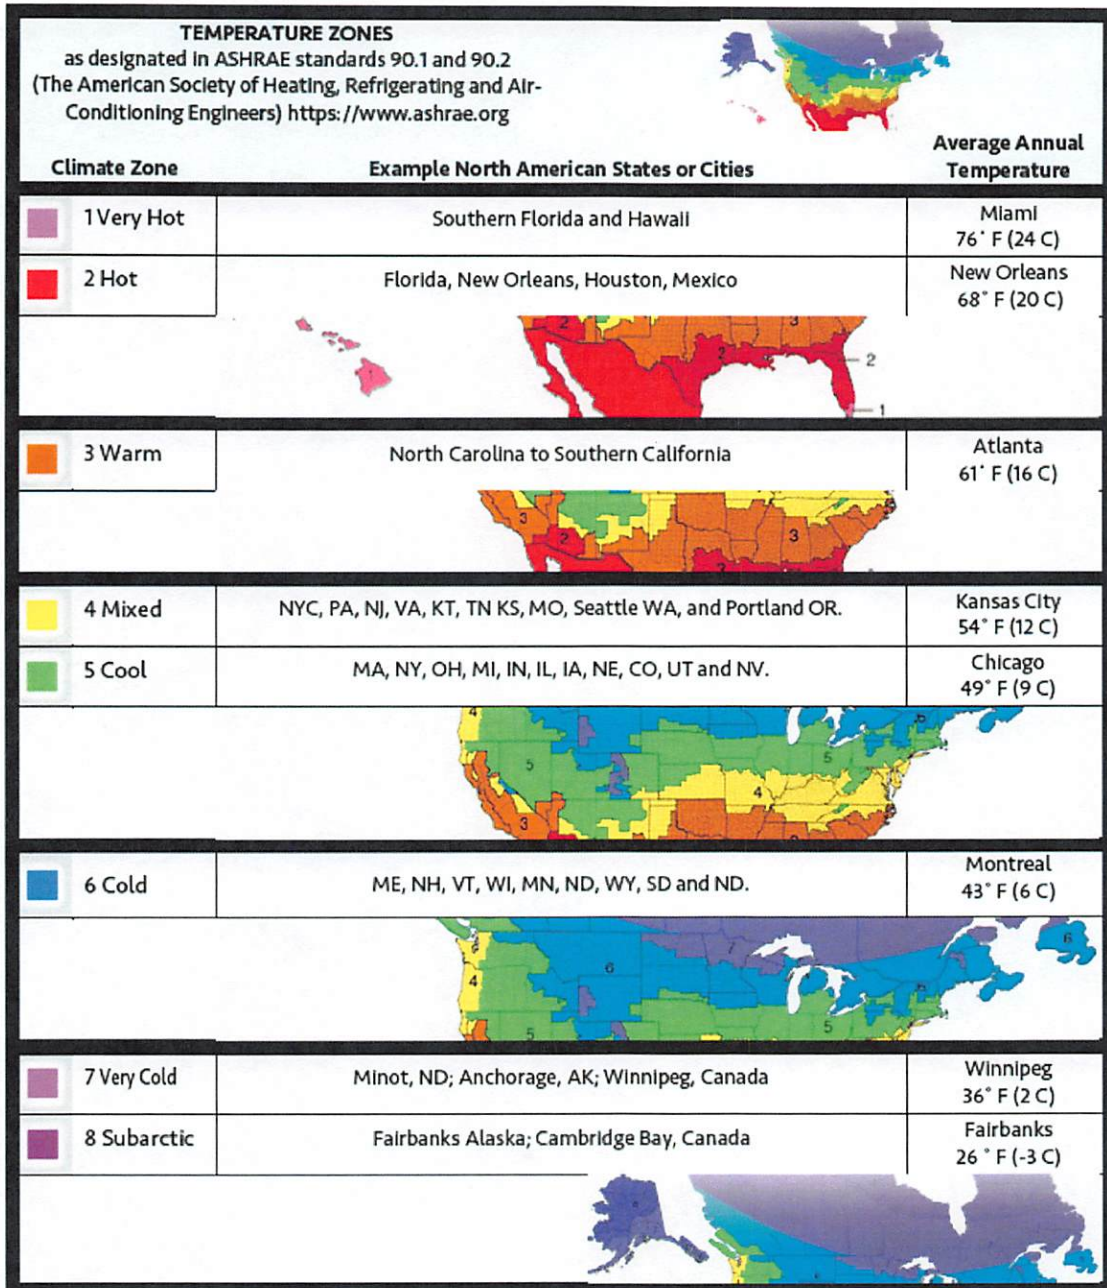

CLIENT ADVISORIES PRIOR TO TESTING


<p>Very Cold</p> <p>Climate Zone 7</p> <p>Includes many Canadian provinces, mountain tops, and utmost northern locations in the United States</p> <p>This data is based on Minot, ND</p>														
<p>24 Hour Averages</p> <p>For dwellings and other 24 hour occupancies</p>														
<p>24 Hour</p> <p>7-Very cold</p>	<p>Minot, ND</p> <p>Annual Avg</p> <p>39</p>	<p>Sep</p> <p>56</p>	<p>Oct</p> <p>45</p>	<p>Nov</p> <p>26</p>	<p>Dec</p> <p>14</p>	<p>Jan</p> <p>5</p>	<p>Feb</p> <p>11</p>	<p>Mar</p> <p>21</p>	<p>Apr</p> <p>41</p>	<p>May</p> <p>53</p>	<p>Jun</p> <p>61</p>	<p>Jul</p> <p>68</p>	<p>Aug</p> <p>67</p>	
<p><i>Operating Condition</i></p>	<p>Prevailing Annually</p>													
	<p><i>Heating Conditions</i></p>		<p>83%</p>											
	<p><i>Cooling Conditions</i></p>		<p>-</p>											
	<p><i>Mixed Conditions</i></p>		<p>16%</p>											
<p>Normal Operating Condition</p>		<ul style="list-style-type: none"> • Heating conditions • No variance in outdoor air ventilation 												
<p>Condition less likely to inhibit characterization of a radon hazard</p>		<ul style="list-style-type: none"> • Heating and air distribution systems active 												
<p>Daytime Averages</p> <p>For non-residential occupancies</p>														
<p>Daytime</p> <p>7-Very cold</p>	<p>Minot, ND</p> <p>Annual Avg</p> <p>45</p>	<p>School Avg</p> <p>36</p>	<p>Sep</p> <p>63</p>	<p>Oct</p> <p>51</p>	<p>Nov</p> <p>31</p>	<p>Dec</p> <p>19</p>	<p>Jan</p> <p>11</p>	<p>Feb</p> <p>16</p>	<p>Mar</p> <p>26</p>	<p>Apr</p> <p>47</p>	<p>May</p> <p>59</p>	<p>Jun</p> <p>67</p>	<p>Jul</p> <p>75</p>	<p>Aug</p> <p>74</p>
<p><i>Operating Condition</i></p>	<p>Prevailing Annually</p>													
	<p><i>Heating Conditions</i></p>		<p>75%</p>											
	<p><i>Cooling Conditions</i></p>		<p>-</p>											
	<p><i>Mixed Conditions</i></p>		<p>25%</p>											
<p>Normal Operating Condition</p>		<ul style="list-style-type: none"> • Heating conditions • No variance in outdoor air ventilation 												
<p>Condition less likely to inhibit characterization of a radon hazard</p>		<ul style="list-style-type: none"> • Heating and air distribution systems active 												

Some Cities in This Climate Zone

Note—Exact percentages will vary slightly depending upon location

- | | |
|-----------------|------------------|
| Caribou ME | Breckenridge, CO |
| Quebec, CA | Aspen, CO |
| Marquette MI | |
| Duluth MN | |
| Winnipeg, CA | |
| Grand Forks, ND | |
| Anchorage, AK | |

CLIENT ADVISORIES PRIOR TO TESTING

<p>Cold</p> <p>Climate Zone 6</p> <p>Includes portions of ME, NH, VT, WI, MN, ND, WY, SD, ND and Canada.</p> <p>This data is based on Minneapolis, MN</p>			
<p>24 Hour Averages</p> <p>For dwellings and other 24 hour occupancies</p>			
<p>24 Hour</p> <p>6 Cold</p>	<p>Annual Avg</p> <p>Minneapolis, MN 45</p>	<p>Sep 61</p> <p>Oct 50</p> <p>Nov 33</p> <p>Dec 19</p> <p>Jan 13</p> <p>Feb 18</p> <p>Mar 31</p> <p>Apr 46</p> <p>May 59</p> <p>Jun 68</p> <p>Jul 73</p> <p>Aug 71</p>	
		<p>Prevailing Annually</p>	
<p>Operating Condition</p>	<p>Heating Conditions</p>	75%	
	<p>Cooling Conditions</p>	-	
	<p>Mixed Conditions</p>	25%	
<p>Normal Operating Condition</p>		<ul style="list-style-type: none"> • Heating conditions • No variance in outdoor air ventilation 	
<p>Condition less likely to inhibit characterization of a radon hazard</p>		<ul style="list-style-type: none"> • Heating and air distribution systems active 	
<p>Daytime Averages</p> <p>For non-residential occupancies</p>			
<p>Daytime</p> <p>6 Cold</p>	<p>Annual Avg</p> <p>Minneapolis, MN 50</p>	<p>School Avg</p> <p>41</p>	<p>Sep 66</p> <p>Oct 55</p> <p>Nov 37</p> <p>Dec 23</p> <p>Jan 17</p> <p>Feb 23</p> <p>Mar 35</p> <p>Apr 51</p> <p>May 64</p> <p>Jun 73</p> <p>Jul 78</p> <p>Aug 76</p>
		<p>Prevailing Annually</p>	
<p>Operating Condition</p>	<p>Heating Conditions</p>	66%	88%
	<p>Cooling Conditions</p>	16%	11%
	<p>Mixed Conditions</p>	16%	-
<p>Normal Operating Condition</p>		<ul style="list-style-type: none"> • Heating conditions • No variance in outdoor air ventilation 	
<p>Condition less likely to inhibit characterization of a radon hazard</p>		<ul style="list-style-type: none"> • Heating and air distribution systems active 	

Some Cities in This Climate Zone

Note—Exact percentages will vary slightly depending upon location

- Portland, ME
- Buffalo, NY
- Burlington, NH
- Milwaukee, WI
- Minneapolis, MN
- Bismarck, ND
- Pierre, SD
- Cheyenne, WY
- Billings, MT
- Helena, MT

Minnesota Department of Health, Indoor Air Unit, health.indoorair@state.mn.us, mn.gov/radon

10/25/2023 To obtain this information in a different format, call: 651-201-4621.

Client Authorizations & Communications

Client and Facilitating Staff Member Contact Information

Client/Authorized Agent Kyle Uecker phone (651) 425-6299
Onsite Supervisor Principals at each building phone _____
Building/Dwelling Access Wendy has full access phone _____
HVAC Operations Kyle Uecker phone _____
Other Contact/Title _____ phone _____

Radon Testing Professional Contact Information

Scheduling/Logistics Wendy German phone (651) 425-6277
Onsite Supervisor same phone _____
Field Technician same phone _____
Field Technician _____ phone _____

Staff authorized for responding to occupant and public inquiries:

Name/Title Kyle Uecker phone _____
Name/Title _____ phone _____

Person(s) authorized to receive report data and incremental reports:

Name/Title Kyle Uecker phone _____
Name/Title _____ phone _____

Frequency of Reports

prior to testing after each phase of testing when testing is complete

Notice of Inspection for Building Occupants

A radon test is scheduled for:

Building: **Grey Cloud Elementary**

Test Start Date: **2/5/24** Test End Date: **2/7/24**

An important step is being taken to ensure a safe and healthy building. Testing for radon is recommended for all homes and schools.

Radon is a naturally occurring radioactive gas that can be present in some buildings at concentrations greater than recommended. In the United States, radon exposure is the second leading cause of lung cancer, and it is the leading cause of lung cancer in nonsmokers.

Please help to maintain the required test conditions throughout the building.

1. All windows and exterior doors must be kept closed (aside from momentary entry or exit) for 12 hours before and during the test.
2. Heating and cooling systems must be set to normal occupied operating temperatures.
3. Test devices are not to be disturbed.

The test devices are not dangerous in any way, if a test gets incidentally moved, please put it back where it was originally placed. If you think a test has been heavily tampered with (smashed, ripped, moved) please leave me a note so that I can research its validity.

More information about radon in Minnesota can be found online at mn.gov/radon.

If you have any questions or concerns, please contact:



Wendy German

South Washington County Schools

Facilities – Health and Safety

wgerman@sowashco.org

651-425-6277

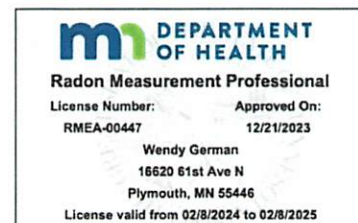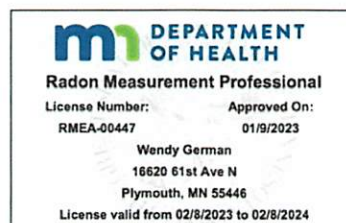

Client Commitment to Compliance

Management Commitment:

To the extent reasonably possible, I, on behalf of Grey Cloud Elementary, commit to helping ensure that building conditions required to achieve reliable radon tests are met, as portrayed herein.

To the extent reasonably possible, I commit to helping ensure that building conditions required to achieve reliable radon tests are met, as portrayed herein, by accepting the following responsibilities:

1. **Building Preparation:** I accept responsibility that, no later than 12 hours prior to testing, each building scheduled for testing will be reviewed for compliance with closed-building requirements.
2. **Compliance Verification:** I accept responsibility for taking actions that could include adjustments to HVAC units and repairs where completion is required no later than 12 hours prior to testing.


Client/Authorized Agent: Kyle Uecker


Signature:  Date: 1/23/24

Building On-Site Supervisor Commitment:

To the extent reasonably possible, I commit to helping ensure that building conditions required to achieve reliable radon tests are met, as portrayed herein, by accepting the following responsibilities:

1. **Prior Notifications:** Notices will be distributed to all staff and posted in publicly accessible areas in a timely manner.
2. **Access:** Access will be provided to each location being tested within a building with intent to access all locations on the same day for both the event of placing testing devices and a second event for retrieving test devices.

On-Site Supervisor/Principal:  Laura Lashela

Signature:  Date: 2/1/2024

RADON TEST IN PROGRESS

from

to

Start Date

End Date

Required closed-building conditions (12 hours prior to the test and during the test)	
Keep closed	Windows & Exterior doors <i>(except for momentary use)</i>
Set to normal	Heating & Cooling systems <i>keep between about 65° - 80° F)</i>
Set to lowest outdoor ventilation	Systems that temporarily ventilate with outdoor air for seasonal comfort or energy savings
Avoid excessive operation	Clothes dryers, range hoods and bathroom fans
Do not operate	Whole-house and window fans
	Fireplaces that burn solid, liquid or gas fuels, unless they are the primary sources of heat for the building

RADON TEST IN PROGRESS

from

to

Start Date

End Date

Required closed-building conditions (12 hours prior to the test and during the test)	
Keep closed	Windows & Exterior doors <i>(except for momentary use)</i>
Set to normal	Heating & Cooling systems <i>keep between about 65° - 80° F)</i>
Set to lowest outdoor ventilation	Systems that temporarily ventilate with outdoor air for seasonal comfort or energy savings
Avoid excessive operation	Clothes dryers, range hoods and bathroom fans
Do not operate	Whole-house and window fans
	Fireplaces that burn solid, liquid or gas fuels, unless they are the primary sources of heat for the building