



SUPPLY FAN											
Equipment ID	Fan Model	Manufacturer	Airflow Rate (CFM)	Static Pressure (in WC)	Power Supply (V/Phase/Hz)	FLA (A)	Fan Speed (RPM)	Motor Horsepower	Fan Efficiency	Dimensions	Weight (lb)
SF-1	DSI - 165	TCF TWIN CITY FAN	2,095	1	460/3/60	1.2	1,064	3/4 HP	FEI 1.40, FEP (KW) 0.57	26.00" x 26.50"	354

NOTES: 2" MERV 13 filter box, spring vibration isolators

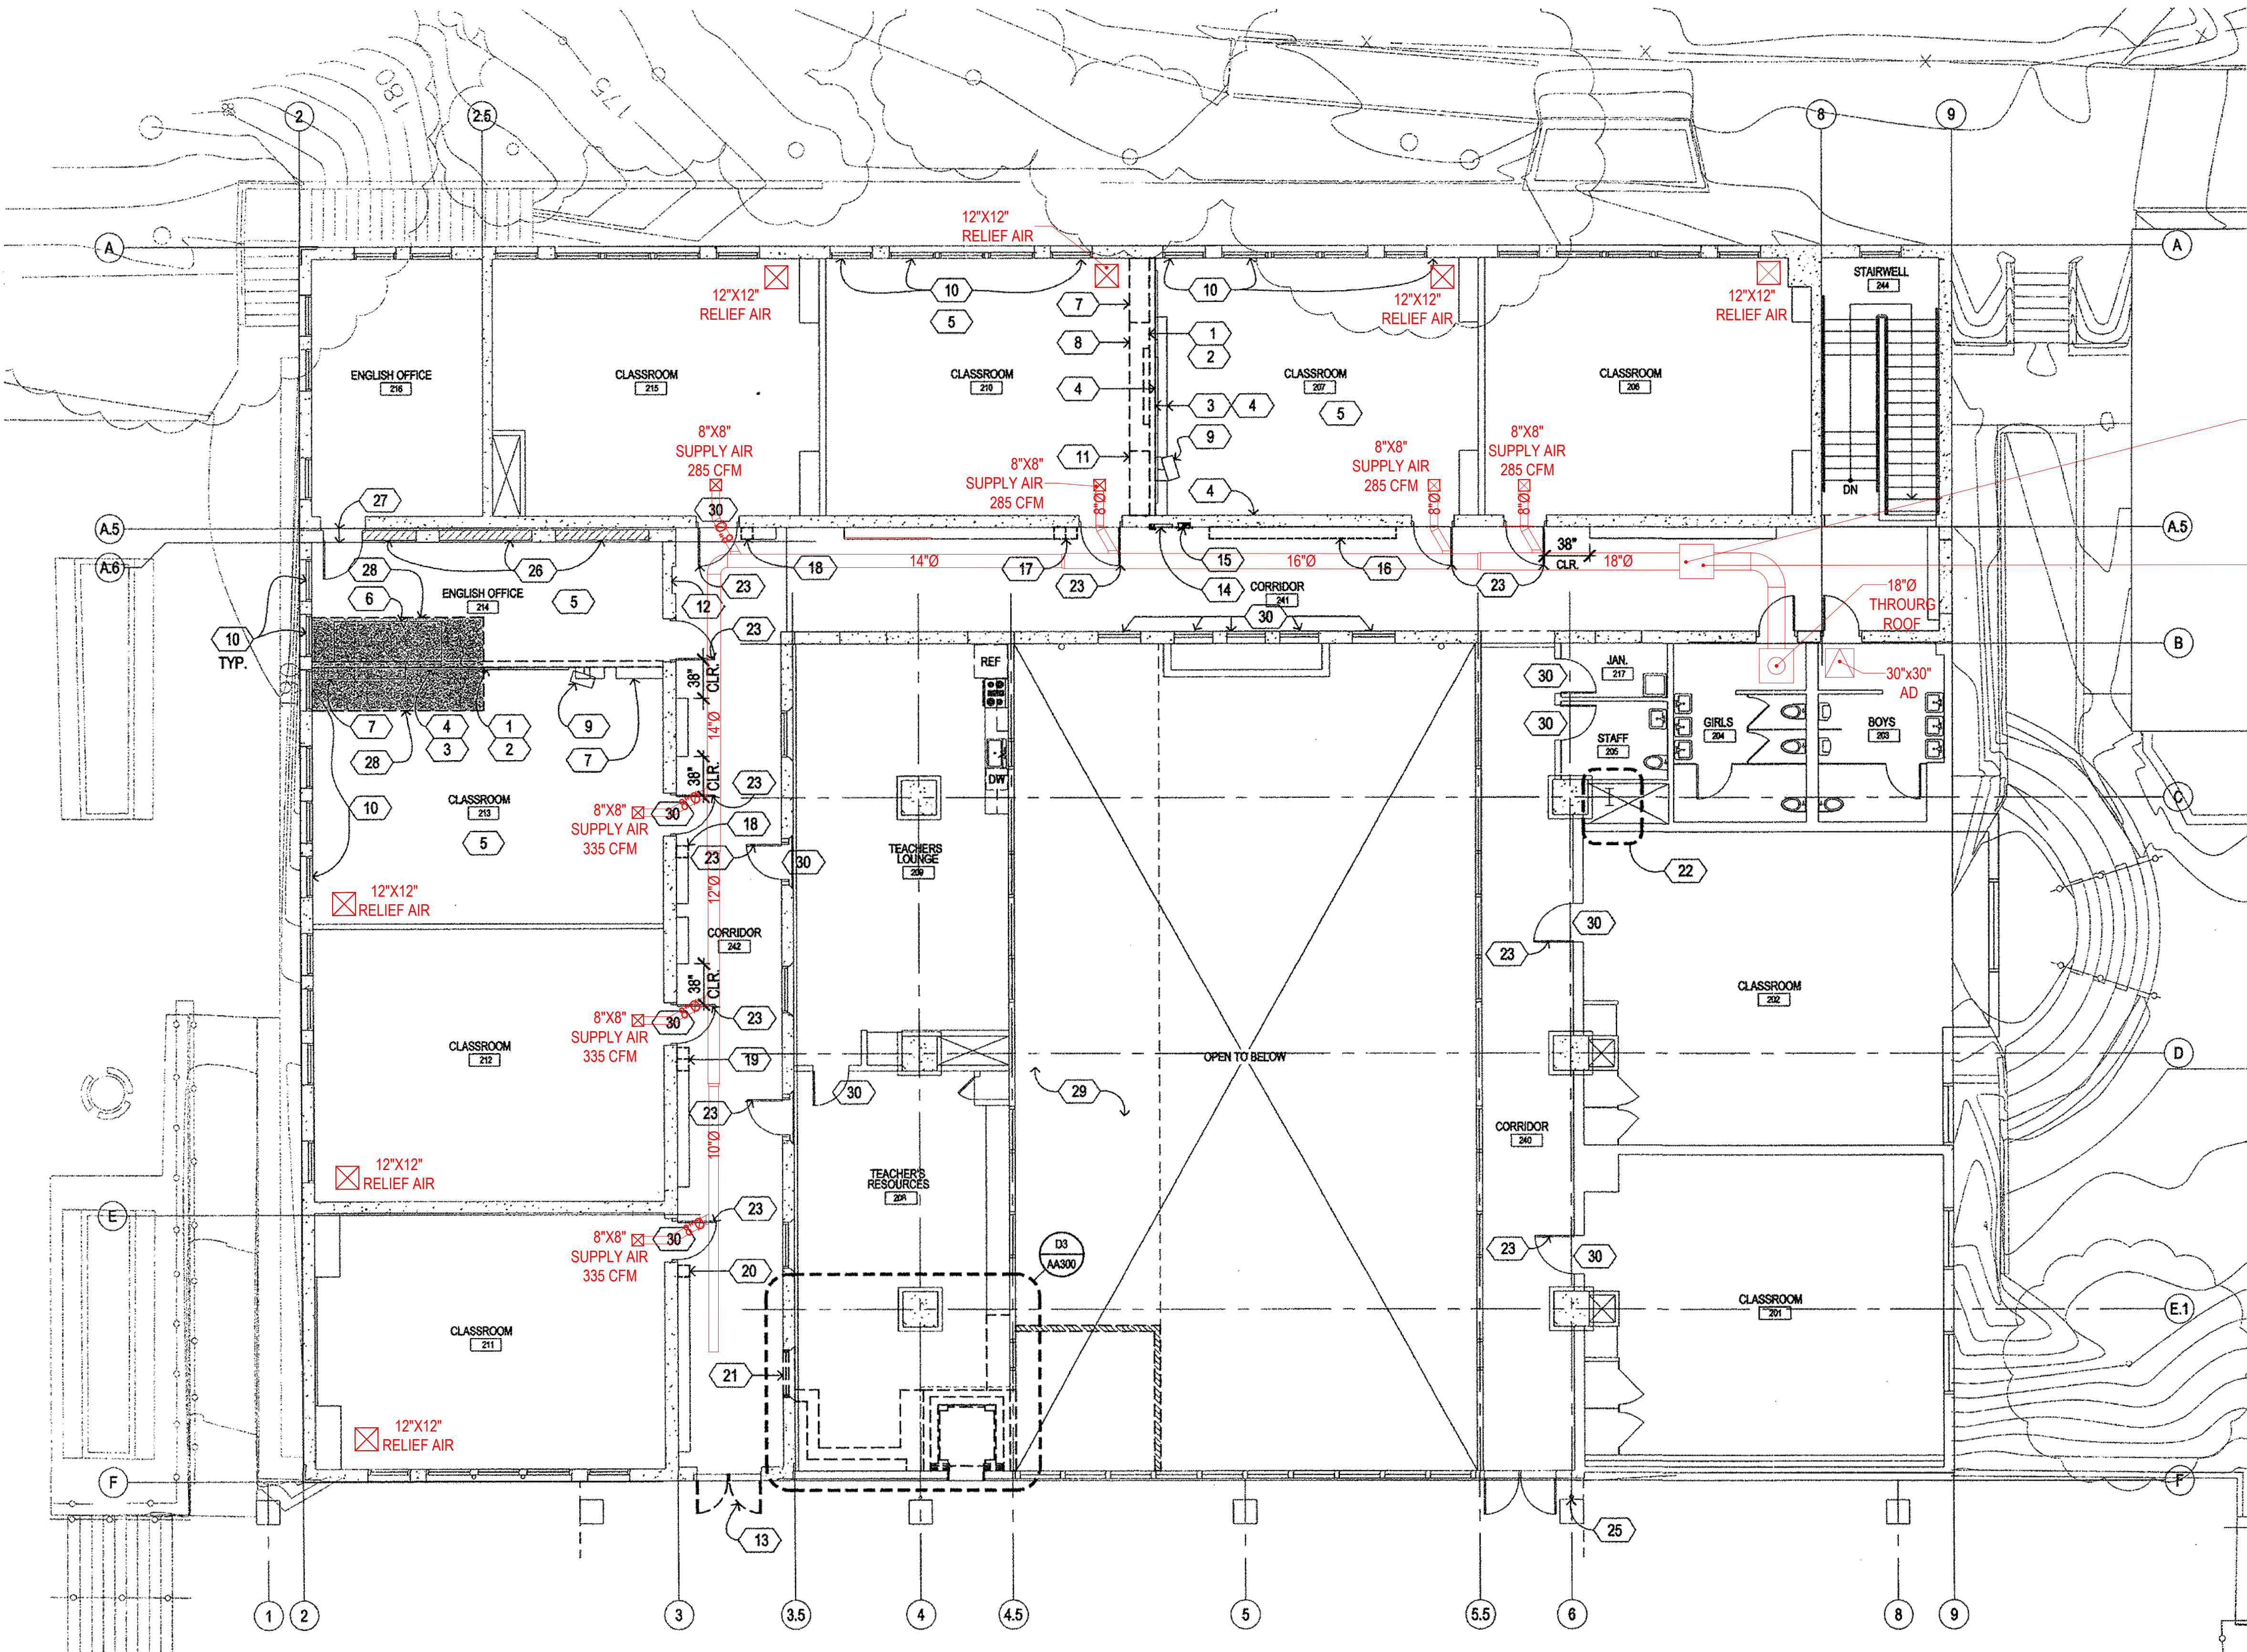

1A SECOND FLOOR
SCALE: NOT TO SCALE



SHEET NOTES:

1. REMOVE PORTION (E) WOOD JOIST CEILING TO INSTALL (N) SHEARWALL. SHORE AS REQUIRED.
2. REMOVE (E) WOOD STUD WALL.
3. REMOVE (E) PROJECTION SCREEN, STORE FOR REINSTALL.
4. REMOVE (E) WITTED BOARD, THICK BOARD, STORE FOR REINSTALL.
5. REMOVE (E) CARPET, STORE FOR REINSTALL.
6. REMOVE (E) CABINET, STORE FOR REINSTALL.
7. REMOVE (E) BASEWORK, STORE FOR REINSTALLATION.
8. REMOVE (E) TURNED SOFFIT.
9. REMOVE (E) T AND WALL MOUNT BRACKET, STORE FOR REINSTALLATION.
10. REMOVE ALL WINDOW BLINDS IN ROOMS WHERE CONSTRUCTION OCCURS AND STORE FOR REINSTALLATION.
11. REMOVE (E) CLOSET, DOOR, AND FRAME.
12. PROTECT (E) HISTORIC TILE ABOVE FROM DAMAGE. SUBMIT PROTECTION PLAN FOR REVIEW PRIOR TO DEMOLITION WORK.
13. REMOVE (E) DOORS AND CENTER POST.
14. REMOVE FIRE HOSE VALVE, GFI WATER TIE, DEMO ABOVE.
15. REMOVE (E) FIRE EXTINGUISHER AND CABINET.
16. REMOVE LOCKERS AND RELOCATE TO ACHIEVE 48" CLEARANCE AT FULL SIDE OF DOOR, SALVAGE FOR REINSTALLATION AT NEW LOCATION.
17. REMOVE TWO SETS OF TWO TIER LOCKERS TO ACHIEVE 48" CLEARANCE AT FULL SIDE OF DOOR AND SALVAGE FOR REINSTALLATION AT NEW LOCATION.
18. REMOVE ONE SET OF TWO TIER LOCKERS AND SALVAGE FOR REINSTALLATION TO NEW LOCATION NOTED.
19. REMOVE TWO SETS OF TWO TIER LOCKERS AND RELOCATE TO NEW LOCATION. NOTED: MOVE ENTIRE RUN OF LOCKERS REMAINING NORTHWARD TO ACHIEVE 60" CLEARANCE WHERE NOTED.
20. REMOVE ONE SET OF TWO TIER LOCKERS AND RELOCATE TO NEW LOCATION NOTED. MOVE ENTIRE RUN OF LOCKERS REMAINING SOUTHWARD APPROX 8 INCHES TO ACHIEVE 18" CLEARANCE WHERE NOTED.
21. REMOVE (E) WINDOW, SAWCUT CONCRETE AND REMOVE WALL BELOW WINDOW FOR (N) DOOR OPENING.
22. REMOVE WALL & FLOOR FINISHES AS REQUIRED TO ACCOMPLISH SEISMIC WORK, SEE DET 60-1E.
23. REMOVE (E) HIGH DOWN DOOR STOP.
24. NOT USED.
25. NOT USED.
26. (E) BRICK WALL.
27. REMOVE (E) DOOR AND FRAME - SALVAGE FOR REINSTALLATION.
28. REMOVE PORTION OF (E) CONC FLOOR SLAB PER STRUCTURAL DWGS.
29. TOP OF CONTAINMENT AREA BELOW.
30. SEAL DOOR OPENING W/ 40 MIL PLASTIC & TAPE AIRTIGHT.

LEGEND:

- DEMO WALL
- TEMPORARY WALL
- (E) WALL
- (E) CONC WALL

DATE	DESCRIPTION




PROJECT TITLE:
**Quad / Student Center
Seismic Strengthening/
Modernization Project**

Piedmont High School
800 Magnolia Avenue
Piedmont, California
Piedmont Unified School District

100% DSA SUBMITTAL
2/4/09

BASE BID #2

SCALE: 1/8" = 1'
0 5 10 15 20

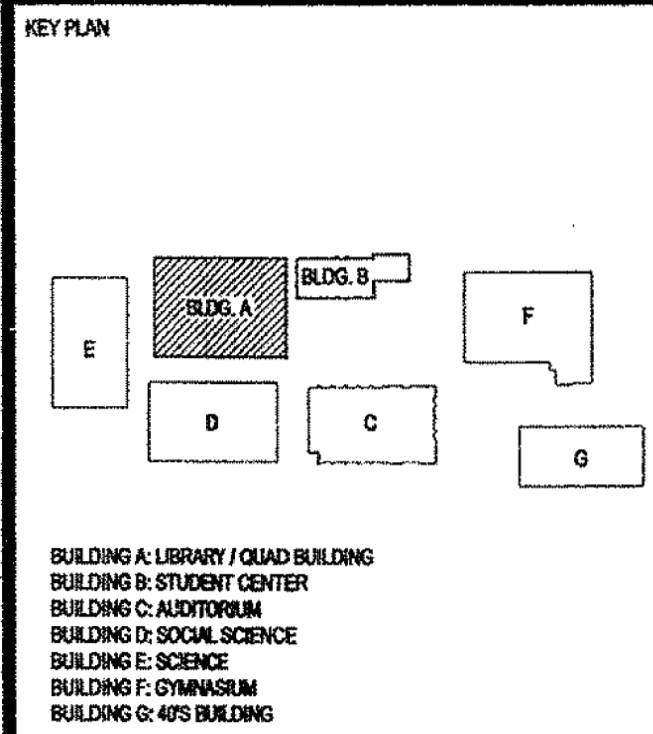

SHEET TITLE:
SECOND FLOOR

BASE BID #2
BUILDING A:
QUAD / LIBRARY

PROJECT NUMBER: 0629 PHS	
CONSTRUCTION ISSUE DATE:	SHEET NUMBER
SCALE: AS NOTED	AA201
DRAWN: KIC, MCD, DW	
PLOT: XX-XX-08	
ALL DRAWINGS AND WRITTEN MATERIAL APPLYING HEREON CONSTITUTE THE OFFICIAL AND UNREVOKED WORK OF THE ARCHITECT AND NO ONE ELSE. NOT BE REPRODUCED, COPIED, OR DISCLOSED WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT.	

- 1 FOR SCOPE OF WORK ON ROOF EQUIPMENT AS A RESULT OF REROOFING AND SEISMIC RETROFIT, REFER TO SHEET MA 2.03.
- 2 CONDENSING UNIT SECURE AND BOLT DOWN ON 4X4 REDWOOD SLEEPERS (2 REQUIRED)


[illegible]

DSA BACKCHECK
08/19/2009
IDENTIFICATION STAMP
DIVISION OF THE STATE POLICE
APPL 01-110422
AUG 24 2009

SHEET TITLE:

ROOF PLAN - BLDG. A -
HVAC
BASE BID #2

CONSTRUCTION ISSUE DATE:	SHEET NUMBER
SCALE: AS NOTED	MA2.30
DRAWN: KC, MHZ, DW	
PLOT: JXC-JX-09	
ALL DRAWINGS AND WRITTEN MATERIAL APPEARING HEREIN CONSTITUTE THE ORIGINAL AND UNPUBLISHED WORK OF THE ARCHITECT AND THE SAME MAY NOT BE REPRODUCED, COPIED, OR DISCLOSED WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT.	

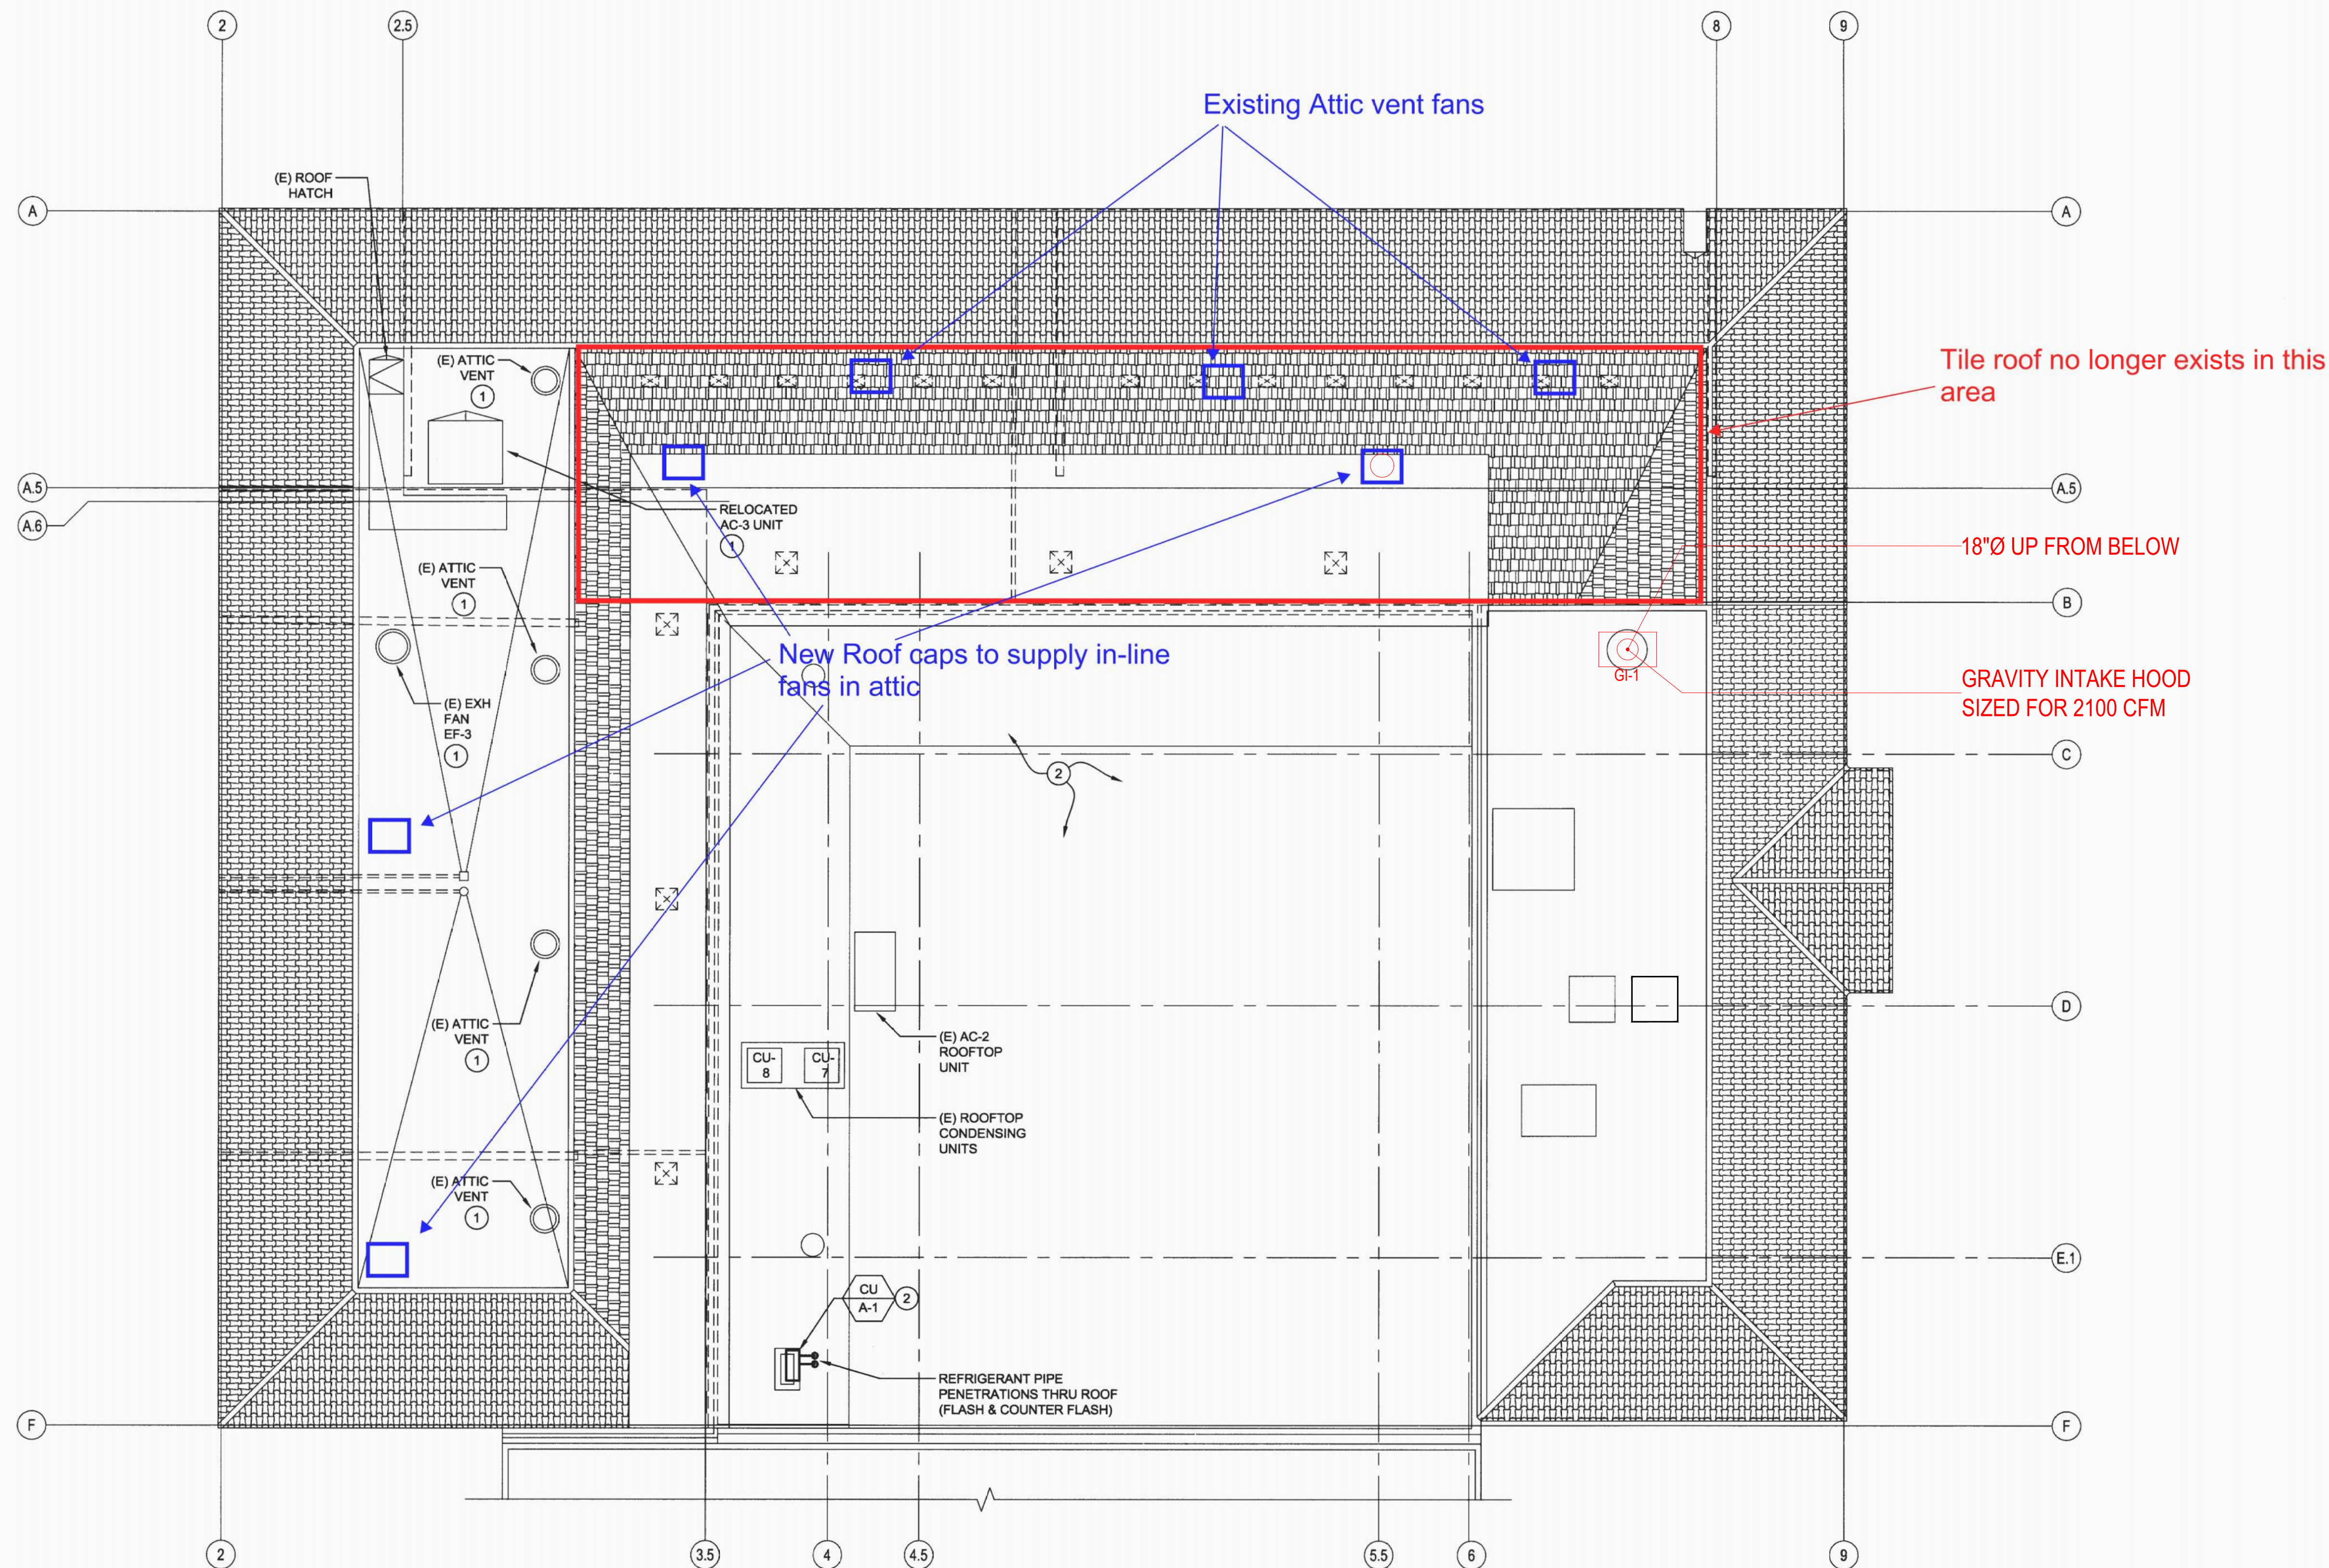

1 ROOF PLAN - BUILDING A - HVAC
SCALE: 1/8"=1'-0"



Login: DAN EILER
Drawing File: HME014zMA230.dwg
Plotting Date: 8/9/2009 4:44 PM
Last saved by: DEILER Sunday, August 09, 2009 1:13:43 PM