

South St. Paul Schools Lead-in-Water Sampling 2023-2024

In 2017 the State of Minnesota passed statute 121A.335, requiring school districts to test for lead in water. Prior to the 2017 state legislation, South Saint Paul School District has tested potable water sources for lead every five years since the late 1980s. This was done voluntarily by the district for the safety and healthy learning and working environment for students, staff, and community.

The Federal EPA action level for lead in water is 20 parts-per-billion (ppb). In 2023, the Minnesota Legislature enacted legislation that lowered the acceptable lead level by 75% to 5 ppb.

South Saint Paul School District tests drinking fountains, bottle fillers, kitchen prep sinks, kitchen sprayers, kitchen kettles, staff lounge sinks, health office sinks, classroom sinks, and other types of fixtures meant for consumption. The district does not test bathroom sinks, slop sinks, handwashing sinks, hose spigots, or science lab sinks. These sinks are not meant for consumption, and there are generally suitable potable water sources nearby. In a case where the use of a water source is unclear or has a potential to be used for consumption due to distance from a water fountain, the district errs on the side of caution and tests the fixtures.

The initial round of water sampling for the 2023-2024 school year included 304 fixtures. The Secondary building, Central Square Community Center, Community Learning Center, and the District Office & Family Education Center had no samples that were above the action level of 5 ppb. Kaposia Education Center and Lincoln Center Elementary had 27 fixtures that were found to have lead levels over 5 ppb in some sinks, and in nearly every case these sinks are paired with water fountains that tested below 5 ppb. The fixtures that had lead levels over 5 ppb were turned off, and were either replaced, removed entirely, or had water filters installed. After each action, retests were performed to verify the effectiveness of the repair. All repaired or replaced fixtures tested below the 5 ppb action level.

The next round of testing will be during the 2028-2029 school year. For questions or more information regarding lead in water, please contact: David Slomkowski—dslomkowski@sspps.org, or Mark Fenton—mfenton@sspps.org

Laboratory results and sample maps are included following this summary. Fixtures that initially tested over 5 ppb that are missing on subsequent lab reports were removed.

Twin City Water Clinic Laboratory Test Report

Minnesota State Laboratory ID# 027-053-119
 Wisconsin State Laboratory ID# 105-10117
 Wisconsin DNR Lab ID #359073400

Client:	South St. Paul Schools, Central Square Meridian Consulting Address: 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-02635 Sample Receipt Date: 3/22/23 Sample Prep. Date: 3/22/23 Sample Prep. Time: 14:20 Report Issue Date: 4/20/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077
Laboratory Analyte	Sample	Parameter	Sample Collection
Sample ID	Location	Date	Time
23-02635	Lead	WF by main office - L	Drinking Water
23-02636	Lead	WF by main office - R	Drinking Water
23-02637	Lead	BF by main office	Drinking Water
23-02638	Lead	Centennial North Sink	Drinking Water
23-02639	Lead	Centennial South Sink	Drinking Water
23-02640	Lead	Kitchen	Drinking Water
23-02641	Lead	WF by Room A - L	Drinking Water
23-02642	Lead	WF by Room A - R	Drinking Water
23-02643	Lead	BF by Room A	Drinking Water
23-02644	Lead	Room A sink	Drinking Water
23-02645	Lead	Room B Sink	Drinking Water
23-02646	Lead	Room C Sink	Drinking Water
23-02647	Lead	WF Pool Deck	Drinking Water
23-02648	Lead	WF Gymnastics	Drinking Water

X No samples were subcontracted; or the above test result(s) with ** designation were produced by a subcontracted laboratory.
 [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.

Approved methods used in analyzing the samples listed above have the following reporting levels:
 SM3113 - Lead, 2.0 µg/L
 Maximum contaminant level: Lead, 15.0 µg/L

Sample Collected by: Client TCWC
 Sample Temp.: 16°C

Notes:

Discussion: WF = Water Fountain, BF = Bottle Filler, L = Left, R = Right

Approved By:



 Bill Van Arsdale
 Laboratory Manager

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Water Sample Locations, March 2023



Water Sample Locations, March 2023

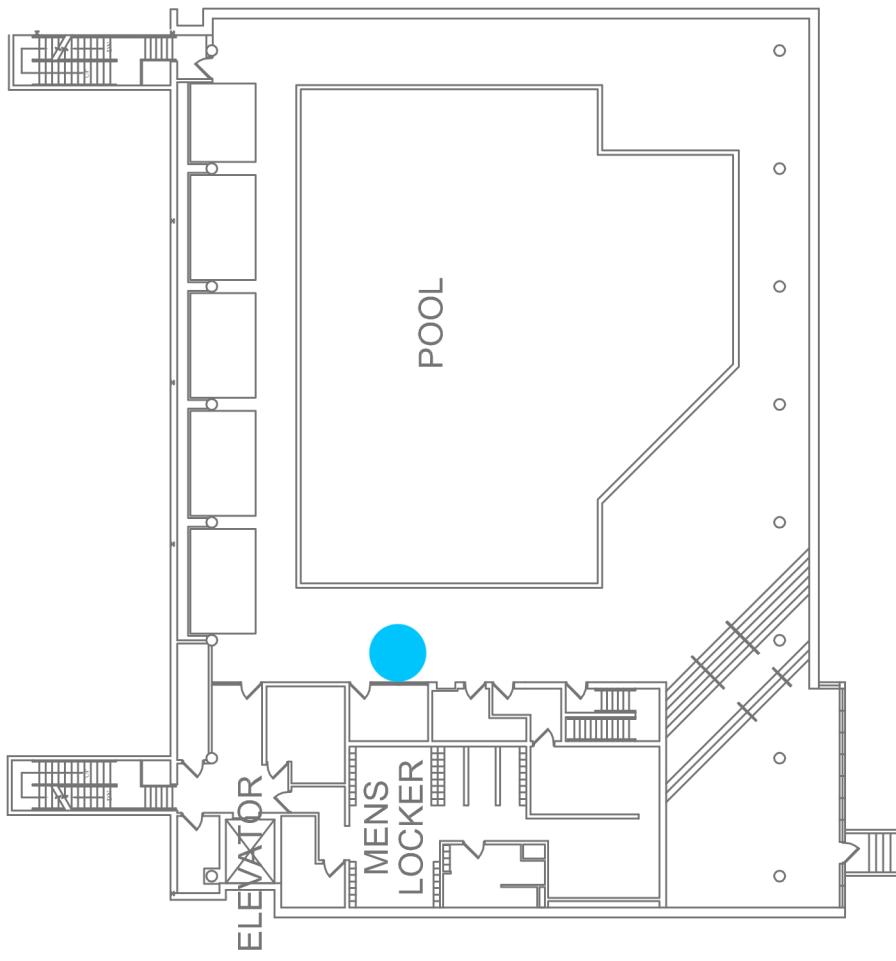

Central Square Community Center
100 7th Avenue North
South St. Paul, MN 55075


Pool Level Floor Plan
2021



↑ N
South St. Paul
Public Schools



Water Sample Locations, March 2023

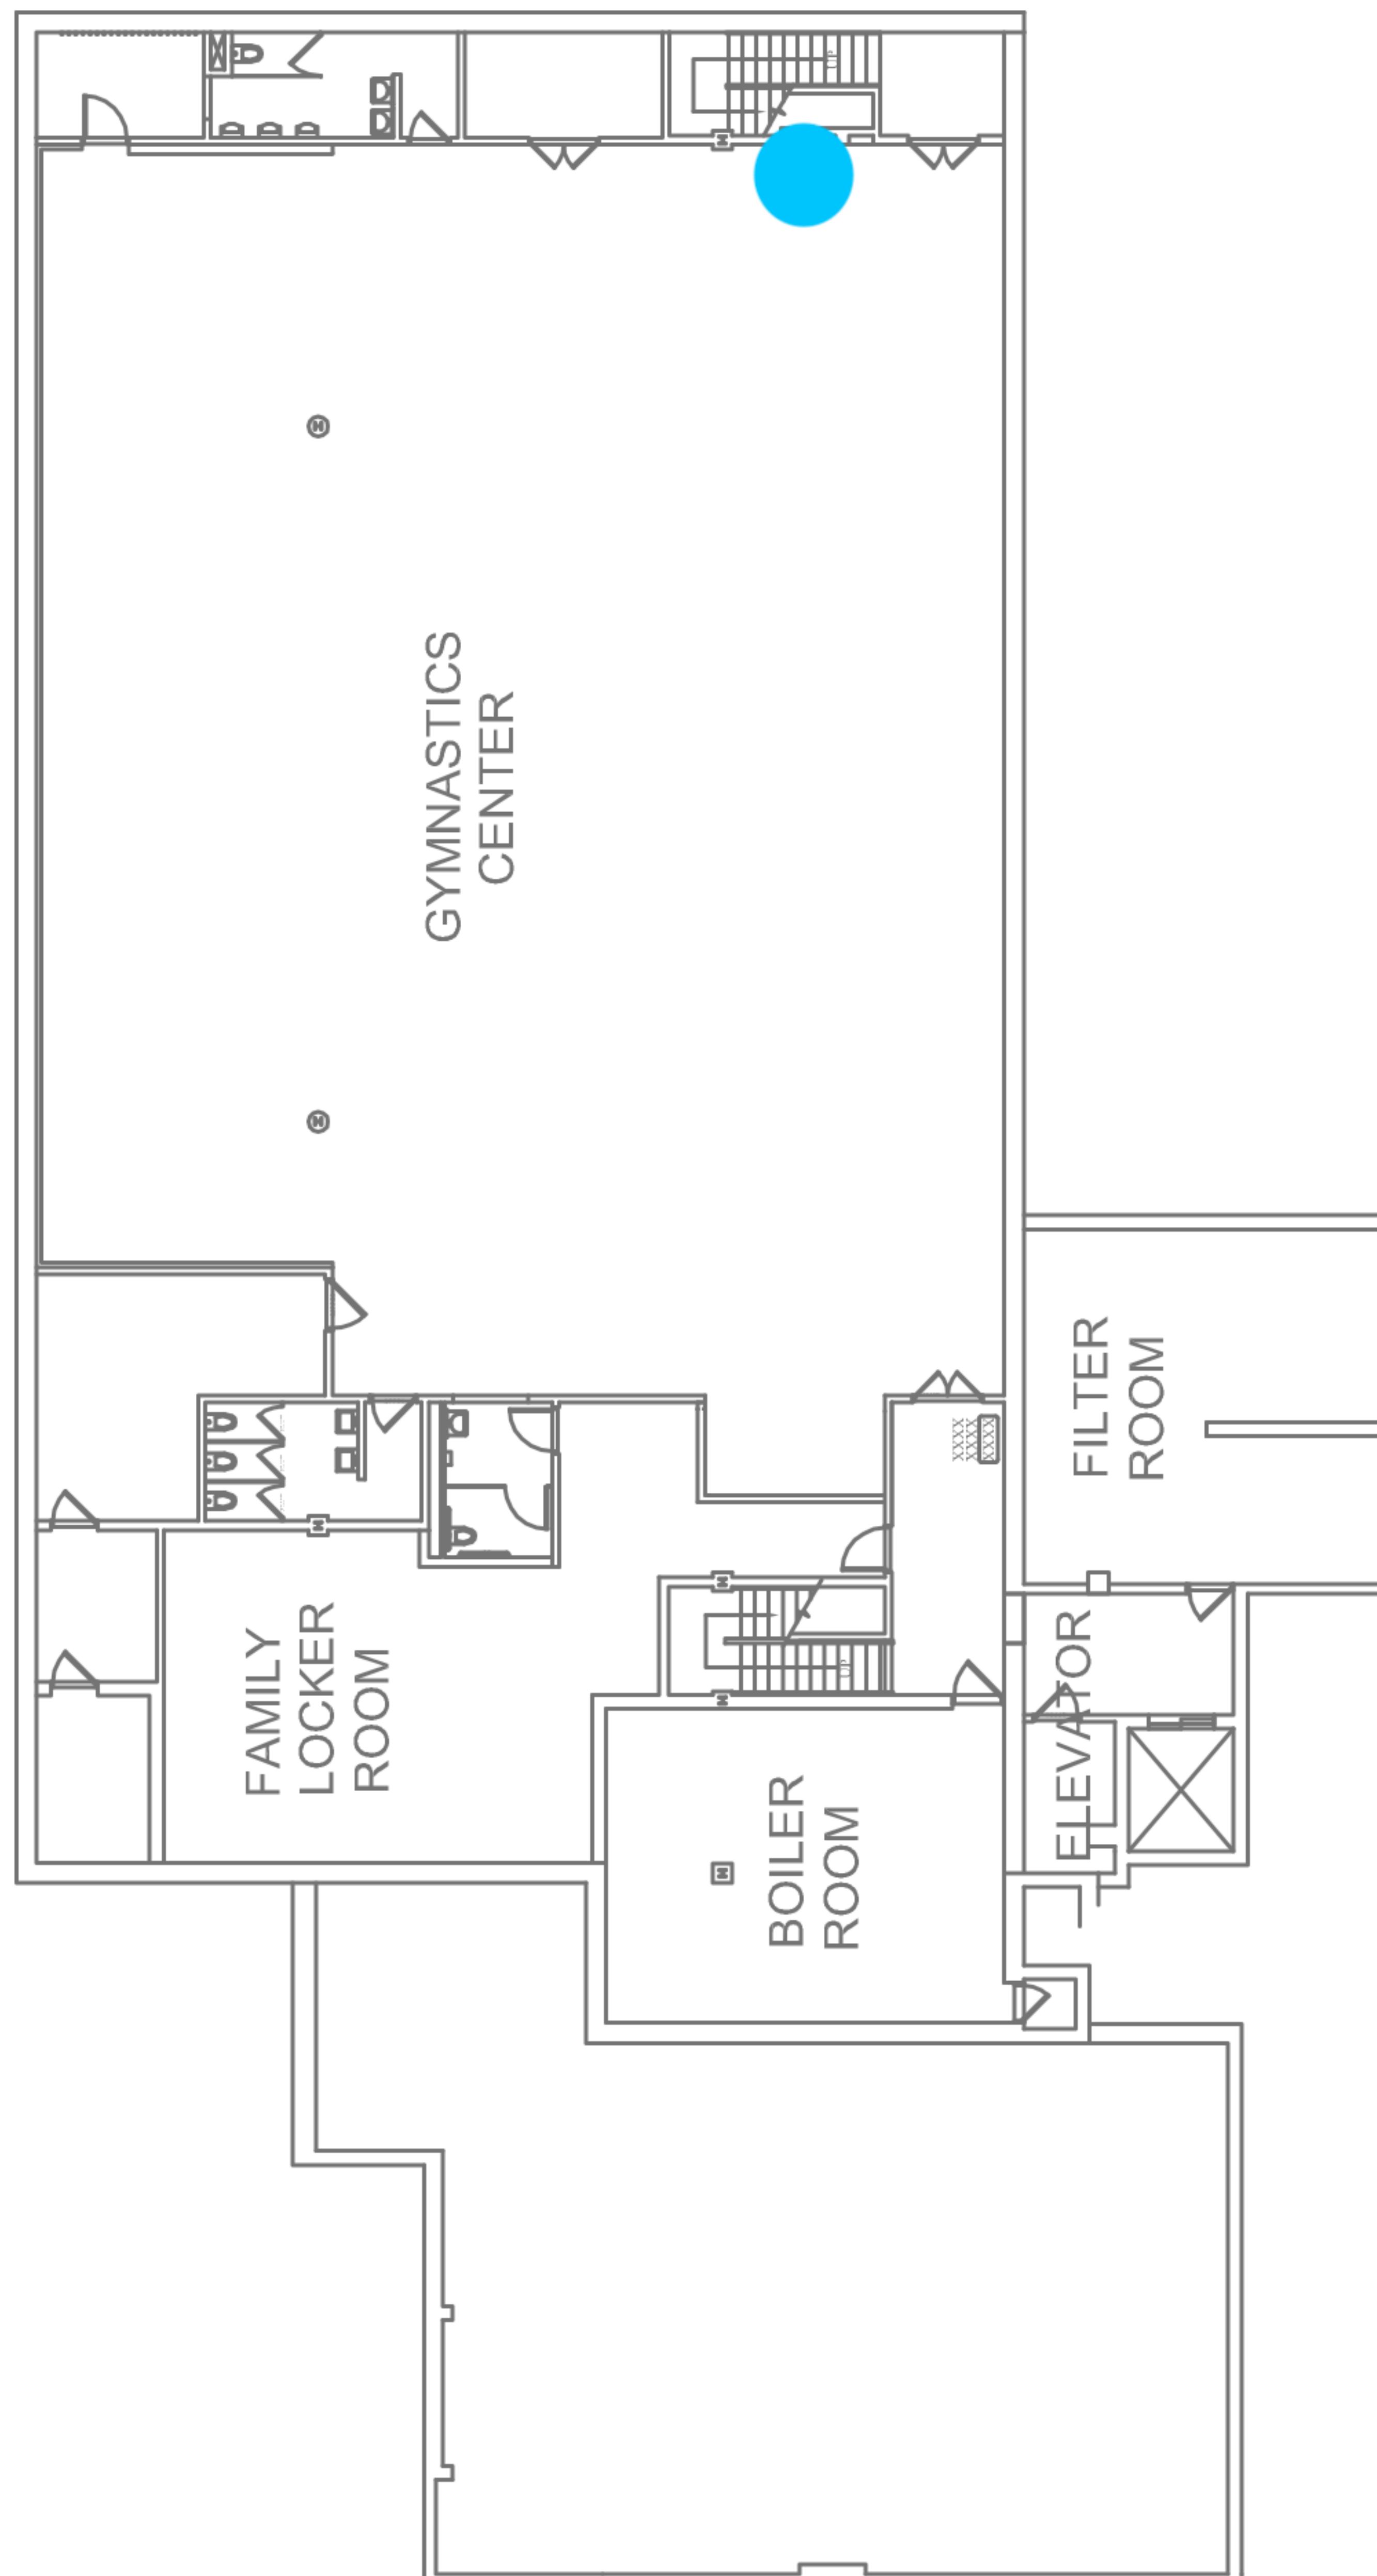

Central Square Community Center
100 7th Avenue North
South St. Paul, MN 55075

Basement Floor Plan
2021



Twin City Water Clinic Laboratory Test Report

Minnesota State Laboratory ID# 027-053-119
 Wisconsin State Laboratory ID# 105-10117
 Wisconsin DNR Lab ID #359073400

Client: South St. Paul Schools,
 District Center
 Meridian Consulting
Address: 16620 - 61st Ave N
 Plymouth, MN 55446

Report Number: 23-02666
Sample Receipt Date: 3/22/23
Sample Prep. Date: 3/22/23
Sample Prep. Time: 14:20
Report Issue Date: 4/20/23

Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test	Approved methods used in analyzing the samples listed above have the following reporting levels:
Sample ID		Location		Date	Date	Results	Units
23-02666	Lead	WF by Bathroom in DO	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02667	Lead	BF by Bathroom in DO	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02668	Lead	DO Conference Sink	Drinking Water	3/16/2023	07:30	04/20/23	4.96 µg/L
23-02669	Lead	FEC Staff Sink	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02670	Lead	FEC WF - L	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02671	Lead	FEC WF - R	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02672	Lead	FEC BF	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02673	Lead	FEC Parenting	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02674	Lead	FEC Classroom 1 Sink - L	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02675	Lead	FEC Classroom 1 Sink - R	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02676	Lead	FEC Classroom 2 Sink - L	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02677	Lead	FEC Classroom 2 Sink - R	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02678	Lead	FEC Motor Room Sink	Drinking Water	3/16/2023	07:30	04/20/23	4.87 µg/L
23-02679	Lead	FEC Motor Room WF	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02680	Lead	DO Staff	Drinking Water	3/16/2023	07:30	04/20/23	4.49 µg/L
23-02681	Lead	Foundation Sink	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L
23-02682	Lead	Birth to 3 Sink	Drinking Water	3/16/2023	07:30	04/20/23	<2.0 µg/L

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.


 Bill Van Arsdale
 Laboratory Manager

Discussion: WF = Water Fountain, BF = Bottle Filler, L = Left, R = Right

SM3113 - Lead, 2.0 µg / L

Maximum contaminant level: Lead, 15.0 µg/L



Approved By:

TCWC



South St. Paul
Public Schools

District Center
104 Fifth Avenue South
South St. Paul, MN 55075

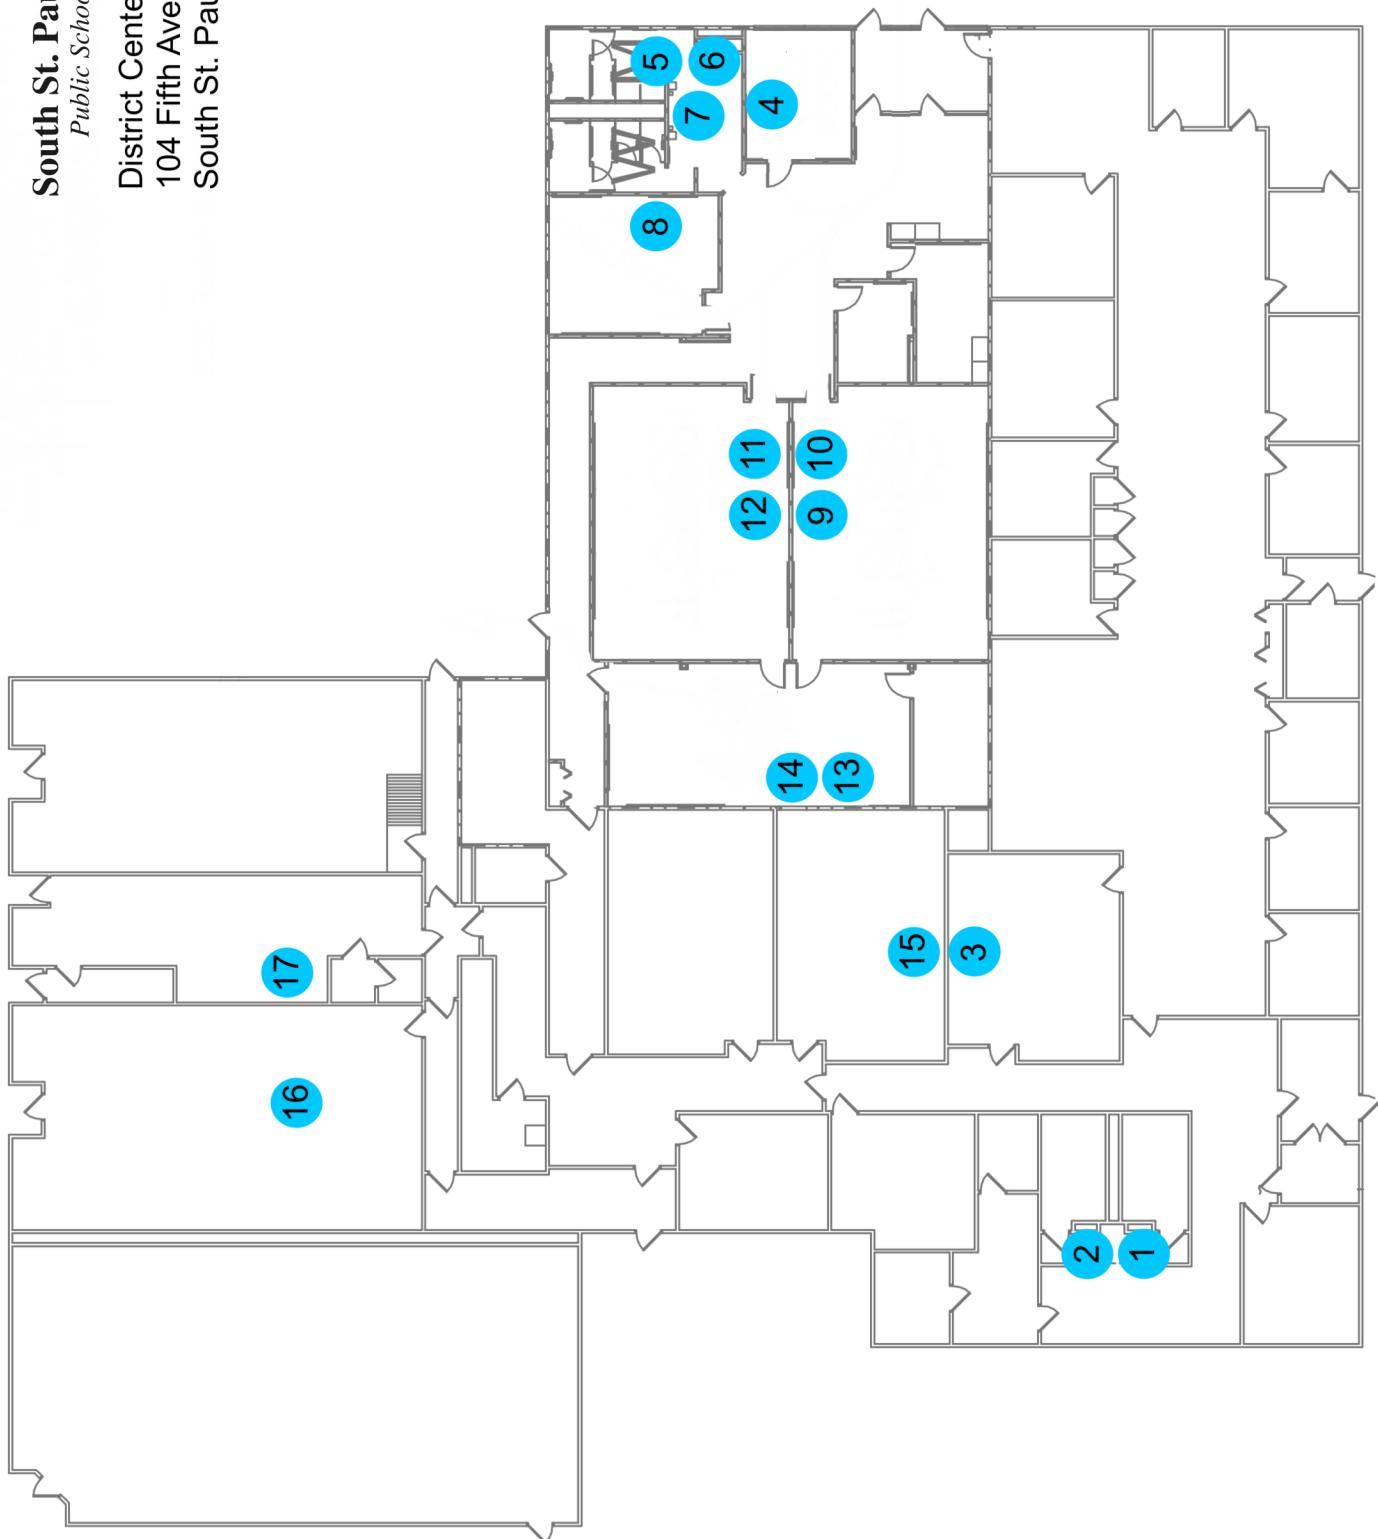

Twin City Water Clinic Laboratory Test Report

Client: Kaposia Elementary Address: 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-02862 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 5/8/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077	<p>Minnesota State Laboratory ID# 105-10117 Wisconsin State Laboratory ID# 027-053-119 Wisconsin DNR Lab ID #399073400</p> <p><input checked="" type="checkbox"/> No samples were subcontracted; or the above test results(s) with ** designation were produced by a subcontracted laboratory. [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.</p>
Laboratory Sample ID Sample Analyte	Parameter Sample Location Collection Date Time	Sample Analysis Date Time Results Units	Test Approved methods used in analyzing the samples listed above have the following reporting levels:
23-02862 Lead Kitchen Sprayer	Drinking Water 3/22/2023 06:00	04/25/23 11:19 <2.0 µg/L	SM3113 - Lead, 2.0 µg / L
23-02863 Lead Kitchen Sink	Drinking Water 3/22/2023 06:00	04/25/23 11:25 2.00 µg/L	Maximum contaminant level: Lead, 15.0 µg/L
23-02864 Lead Cafeteria Fountain	Drinking Water 3/22/2023 06:00	04/25/23 11:31 <2.0 µg/L	
23-02865 Lead WF Left by Gym	Drinking Water 3/22/2023 06:00	04/25/23 11:37 <2.0 µg/L	
23-02866 Lead WF Right by Gym	Drinking Water 3/22/2023 06:00	04/25/23 11:43 <2.0 µg/L	Sample Collected by: <input checked="" type="checkbox"/> Client — TCWC
23-02867 Lead WF by S20 Left	Drinking Water 3/22/2023 06:00	04/25/23 11:49 <2.0 µg/L	
23-02868 Lead BF by S20	Drinking Water 3/22/2023 06:00	04/25/23 11:55 <2.0 µg/L	Sample Temp.: 11° C
23-02869 Lead WF by S20 Right	Drinking Water 3/22/2023 06:00	04/25/23 12:13 <2.0 µg/L	
23-02870 Lead WF S23	Drinking Water 3/22/2023 06:00	04/25/23 12:31 <2.0 µg/L	
23-02871 Lead Sink Left S24	Drinking Water 3/22/2023 06:00	04/25/23 12:37 <2.0 µg/L	Notes:
23-02872 Lead Sink Left S25	Drinking Water 3/22/2023 06:00	04/25/23 12:43 <2.0 µg/L	
23-02873 Lead 207 WF	Drinking Water 3/22/2023 06:00	04/25/23 12:49 2.00 µg/L	
23-02874 Lead 206 WF	Drinking Water 3/22/2023 06:00	04/25/23 12:55 <2.0 µg/L	Discussion: BF = Bottle Filler, WF = Water Fountain
23-02875 Lead WF by S10 Left	Drinking Water 3/22/2023 06:00	04/25/23 13:01 <2.0 µg/L	
23-02876 Lead BF by S10	Drinking Water 3/22/2023 06:00	04/25/23 13:07 <2.0 µg/L	
23-02877 Lead WF by S10 Right	Drinking Water 3/22/2023 06:00	04/25/23 13:29 <2.0 µg/L	
23-02878 Lead S13 WF	Drinking Water 3/22/2023 06:00	04/25/23 13:35 <2.0 µg/L	Approved By: 
23-02879 Lead S14 WF	Drinking Water 3/22/2023 06:00	04/25/23 13:53 <2.0 µg/L	
23-02880 Lead S15 WF	Drinking Water 3/22/2023 06:00	04/25/23 14:11 <2.0 µg/L	
23-02881 Lead 109 WF	Drinking Water 3/22/2023 06:00	04/25/23 14:16 <2.0 µg/L	

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Client: Kaposia Elementary Meridian Consulting Address: 166620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-02882 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 5/8/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077
Laboratory Sample ID Analyte Sample Location	Parameter Sample Collection Date Time Sample Analysis Date Time Results Test	Approved methods used in analyzing the samples listed above have the following reporting levels: SM3113 - Lead, 2.0 µg/L Maximum contaminant level: Lead, 15.0 µg/L
23-02882 Lead 105 WF Drinking Water	3/22/2023 06:00 04/25/23 14:22 <2.0 µg/L	
23-02883 Lead 104 WF Drinking Water	3/22/2023 06:00 04/25/23 14:28 <2.0 µg/L	
23-02884 Lead 103 WF Drinking Water	3/22/2023 06:00 04/25/23 14:34 <2.0 µg/L	
23-02885 Lead 230 Sink Drinking Water	3/29/2023 06:00 04/25/23 14:40 <2.0 µg/L	
23-02886 Lead 229 Sink Drinking Water	3/29/2023 06:00 04/25/23 14:46 <2.0 µg/L	
23-02887 Lead 229 Fountain Drinking Water	3/29/2023 06:00 04/25/23 14:52 <2.0 µg/L	
23-02888 Lead 228 Sink Drinking Water	3/29/2023 06:00 04/25/23 14:58 <2.0 µg/L	
23-02889 Lead 228 Fountain Drinking Water	3/29/2023 06:00 04/25/23 15:16 <2.0 µg/L	
23-02890 Lead 227 Sink Drinking Water	3/29/2023 06:00 04/25/23 15:34 2.20 µg/L	
23-02891 Lead 227 Fountain Drinking Water	3/29/2023 06:00 04/25/23 15:40 <2.0 µg/L	
23-02892 Lead 225 Sink Drinking Water	3/29/2023 06:00 04/25/23 15:46 4.32 µg/L	
23-02893 Lead 225 Fountain Drinking Water	3/29/2023 06:00 04/25/23 15:52 <2.0 µg/L	
23-02894 Lead 224 Sink Drinking Water	3/29/2023 06:00 04/25/23 15:58 2.40 µg/L	
23-02895 Lead 224 Fountain Drinking Water	3/29/2023 06:00 04/25/23 16:04 <2.0 µg/L	
23-02896 Lead 223 Sink Drinking Water	3/29/2023 06:00 04/25/23 16:10 <2.0 µg/L	
23-02897 Lead 223 Fountain Drinking Water	3/29/2023 06:00 04/25/23 16:16 <2.0 µg/L	
23-02898 Lead 221 Sink Drinking Water	3/29/2023 06:00 04/25/23 16:25 22.2 µg/L	
23-02899 Lead 221 Fountain Drinking Water	3/29/2023 06:00 04/27/23 12:13 2.42 µg/L	
23-02900 Lead 220 Sink Drinking Water	3/29/2023 06:00 04/27/23 12:46 <2.0 µg/L	
23-02901 Lead 220 Fountain Drinking Water	3/29/2023 06:00 04/27/23 13:04 <2.0 µg/L	

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

[Signature]

Approved By:
Bill Van Arsdale
Laboratory Manager

Twin City Water Clinic Laboratory Test Report

Client:	Kaposia Elementary			Report Number: 23-02902	Twin City Water Clinic Inc.		
Address:	Meridian Consulting 16620 - 61st Ave N Plymouth, MN 55446			Sample Receipt Date: 3/30/23	617 13th Avenue South Hopkins, MN 55343		
				Sample Prep. Date: 3/30/23	Phone: (952)935-3556		
				Sample Prep. Time: 12:00	Fax: (952)935-5077		
				Report Issue Date: 5/8/23			
Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test	
Sample ID		Location		Date	Time	Results	Units
23-02902	Lead	219 Sink	Drinking Water	3/29/2023	06:00	04/27/23	13:10
23-02903	Lead	219 Fountain	Drinking Water	3/29/2023	06:00	04/27/23	13:16
23-02904	Lead	217 Sink	Drinking Water	3/29/2023	06:00	04/27/23	13:22
23-02905	Lead	217 Fountain	Drinking Water	3/29/2023	06:00	04/27/23	13:28
23-02906	Lead	216 Sink	Drinking Water	3/29/2023	06:00	04/27/23	13:34
23-02907	Lead	216 Fountain	Drinking Water	3/29/2023	06:00	04/27/23	13:40
23-02908	Lead	215 Sink	Drinking Water	3/29/2023	06:00	04/27/23	13:46
23-02909	Lead	215 Fountain	Drinking Water	3/29/2023	06:00	04/27/23	13:52
23-02910	Lead	211 Sink	Drinking Water	3/29/2023	06:00	05/02/23	11:05
23-02911	Lead	Workroom Sink	Drinking Water	3/29/2023	06:00	05/02/23	11:27
23-02912	Lead	Health office sink	Drinking Water	3/29/2023	06:00	05/02/23	11:51
23-02913	Lead	235 Sink	Drinking Water	3/29/2023	06:00	05/02/23	12:00
23-02914	Lead	200 Sink	Drinking Water	3/29/2023	06:00	05/02/23	12:06
23-02915	Lead	214 Sink	Drinking Water	3/29/2023	06:00	05/02/23	12:12
23-02916	Lead	214 Fountain	Drinking Water	3/29/2023	06:00	05/02/23	12:18
23-02917	Lead	213 Sink	Drinking Water	3/29/2023	06:00	05/02/23	12:27
23-02918	Lead	213 Fountain	Drinking Water	3/29/2023	06:00	05/02/23	12:33
23-02919	Lead	212 Sink	Drinking Water	3/29/2023	06:00	05/02/23	12:39
23-02920	Lead	212 Fountain	Drinking Water	3/29/2023	06:00	05/02/23	13:03
23-02921	Lead	S24 Fountain	Drinking Water	3/29/2023	06:00	05/02/23	13:22

Minnesota State Laboratory ID# 027-053-119
 Wisconsin State Laboratory ID# 105-10117
 Wisconsin DNR Lab ID #399073400

X No samples were subcontracted; or the above test results(s) with ** designation were produced by a subcontracted laboratory. [laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.

X No samples were subcontracted; or the above test results(s) with ** designation were produced by a subcontracted laboratory. [laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.
The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Client: Kaposia Elementary Meridian Consulting Address: 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-02922 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 5/8/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077
Laboratory Sample ID Analyte	Sample Location Parameter Sample Collection Date Time Sample Analysis Date Time Results Test Units	Approved methods used in analyzing the samples listed above have the following reporting levels: SM3113 - Lead, 2.0 µg/L Maximum contaminant level: Lead, 15.0 µg/L
23-02922 Lead	S25 Fountain Drinking Water 3/29/2023 06:00 05/02/23 13:28 <2.0 µg/L	
23-02923 Lead	209 Sink Drinking Water 3/29/2023 06:00 05/02/23 13:34 <2.0 µg/L	
23-02924 Lead	210 Sink Drinking Water 3/29/2023 06:00 05/02/23 13:43 27.0 µg/L	
23-02925 Lead	202 Sink Drinking Water 3/29/2023 06:00 05/02/23 13:52 29.2 µg/L	
23-02926 Lead	206 Fountain Drinking Water 3/29/2023 06:00 05/02/23 13:58 <2.0 µg/L	
23-02927 Lead	204 Fountain Drinking Water 3/29/2023 06:00 05/02/23 14:04 <2.0 µg/L	
23-02928 Lead	204 Sink Left Drinking Water 3/29/2023 06:00 05/02/23 14:10 <2.0 µg/L	
23-02929 Lead	102 Fountain Drinking Water 3/29/2023 06:00 05/02/23 14:16 <2.0 µg/L	
23-02930 Lead	102 Sink Drinking Water 3/29/2023 06:00 05/02/23 14:34 <2.0 µg/L	
23-02931 Lead	109 Sink Drinking Water 3/29/2023 06:00 05/02/23 14:58 <2.0 µg/L	
23-02932 Lead	110 Fountain Drinking Water 3/29/2023 06:00 05/02/23 15:04 <2.0 µg/L	
23-02933 Lead	110 Sink Drinking Water 3/29/2023 06:00 05/02/23 15:10 2.45 µg/L	
23-02934 Lead	111 Sink Drinking Water 3/29/2023 06:00 05/02/23 15:21 22.8 µg/L	
23-02935 Lead	111 Fountain Drinking Water 3/29/2023 06:00 05/02/23 15:27 <2.0 µg/L	
23-02936 Lead	113 Sink Drinking Water 3/29/2023 06:00 05/02/23 15:33 2.09 µg/L	
23-02937 Lead	113 Fountain Drinking Water 3/29/2023 06:00 05/02/23 15:39 <2.0 µg/L	
23-02938 Lead	114 Sink Drinking Water 3/29/2023 06:00 05/02/23 15:45 2.09 µg/L	
23-02939 Lead	114 Fountain Drinking Water 3/29/2023 06:00 05/02/23 15:51 <2.0 µg/L	
23-02940 Lead	115 Sink Drinking Water 3/29/2023 06:00 05/04/23 11:25 24.2 µg/L	
23-02941 Lead	115 Fountain Drinking Water 3/29/2023 06:00 05/04/23 11:31 <2.0 µg/L	

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Bill Van Arsdale
Laboratory Manager

Twin City Water Clinic Laboratory Test Report

Client:	Kaposia Elementary			Report Number: 23-02942	Twin City Water Clinic Inc.		
Address:	Meridian Consulting 16620 - 61st Ave N Plymouth, MN 55446			Sample Receipt Date: 3/30/23	617 13th Avenue South Hopkins, MN 55343		
				Sample Prep. Date: 3/30/23	Phone: (952)935-3556		
				Sample Prep. Time: 12:00	Fax: (952)935-5077		
				Report Issue Date: 5/8/23			
Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test	
Sample ID		Location		Date	Time	Results	Units
23-02942	Lead	108 Fountain	Drinking Water	3/29/2023	06:00	05/04/23	11:37
23-02943	Lead	108 Sink	Drinking Water	3/29/2023	06:00	05/04/23	11:46
23-02944	Lead	117 Sink	Drinking Water	3/29/2023	06:00	05/04/23	11:55
23-02945	Lead	117 Fountain	Drinking Water	3/29/2023	06:00	05/04/23	12:01
23-02946	Lead	118 Sink	Drinking Water	3/29/2023	06:00	05/04/23	12:22
23-02947	Lead	118 Fountain	Drinking Water	3/29/2023	06:00	05/04/23	12:46
23-02948	Lead	119 Sink	Drinking Water	3/29/2023	06:00	05/04/23	12:56
23-02949	Lead	119 Fountain	Drinking Water	3/29/2023	06:00	05/04/23	13:02
23-02950	Lead	120 Sink	Drinking Water	3/29/2023	06:00	05/04/23	13:08
23-02951	Lead	120 Fountain	Drinking Water	3/29/2023	06:00	05/04/23	13:14
23-02952	Lead	121 Sink	Drinking Water	3/29/2023	06:00	05/04/23	13:20
23-02953	Lead	121 Fountain	Drinking Water	3/29/2023	06:00	05/04/23	13:25
23-02954	Lead	122 Sink	Drinking Water	3/29/2023	06:00	05/04/23	13:31
23-02955	Lead	122 Fountain	Drinking Water	3/29/2023	06:00	05/08/23	11:20
23-02956	Lead	124 Sink	Drinking Water	3/29/2023	06:00	05/08/23	11:26
23-02957	Lead	124 Fountain	Drinking Water	3/29/2023	06:00	05/08/23	11:32
23-02958	Lead	125 Sink	Drinking Water	3/29/2023	06:00	05/08/23	11:41
23-02959	Lead	125 Fountain	Drinking Water	3/29/2023	06:00	05/08/23	11:59
23-02960	Lead	126 Sink Left	Drinking Water	3/29/2023	06:00	05/08/23	12:17
23-02961	Lead	126 Sink Center	Drinking Water	3/29/2023	06:00	05/08/23	12:26
							26.4 µg/L

Minnesota State Laboratory ID# 027-053-119
 Wisconsin State Laboratory ID# 105-10117
 Wisconsin DNR Lab ID #399073400

X No samples were subcontracted; or the above test results(s) with ** designation were produced by a subcontracted laboratory. [laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.

Approved methods used in analyzing the samples listed above have the following reporting levels:
 SM3113 - Lead, 2.0 µg / L
 Maximum contaminant level: Lead, 15.0 µg / L

Approved methods used in analyzing the samples listed above have the following reporting levels:
 SM3113 - Lead, 2.0 µg / L
 Maximum contaminant level: Lead, 15.0 µg / L

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Approved methods used in analyzing the samples listed above have the following reporting levels:
 SM3113 - Lead, 2.0 µg / L
 Maximum contaminant level: Lead, 15.0 µg / L

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Twin City Water Clinic Laboratory Test Report						
Minnesota State Laboratory ID# 027-053-119 Wisconsin State Laboratory ID# 105-10117 Wisconsin DNR Lab ID #3398073400						
Client: Kaposia Elementary Meridian Consulting 16620 - 61st Ave N Plymouth, MN 55446				Report Number: 23-02962 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 5/8/23 Twin City Water Clinic Inc. 6117 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077		
Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test
Sample ID		Location		Date	Date	Time
23-02962	Lead	126 Fountain	Drinking Water	3/29/2023	06:00	05/08/23 12:32
23-02963	Lead	126 Sink Right	Drinking Water	3/29/2023	06:00	05/08/23 12:38
23-02964	Lead	127 Sink Left	Drinking Water	3/29/2023	06:00	05/08/23 12:44
23-02965	Lead	127 Sink Center	Drinking Water	3/29/2023	06:00	05/08/23 12:50
23-02966	Lead	127 Sink Right	Drinking Water	3/29/2023	06:00	05/08/23 12:56
23-02967	Lead	S25 Sink Right	Drinking Water	3/29/2023	06:00	05/08/23 13:02
23-02968	Lead	S24 Sink Right	Drinking Water	3/29/2023	06:00	05/08/23 13:08
23-02969	Lead	S23 Sink Left	Drinking Water	3/29/2023	06:00	05/08/23 13:26
23-02970	Lead	S23 Sink Right	Drinking Water	3/29/2023	06:00	05/08/23 13:44
Notes:						
Approved methods used in analyzing the samples listed above have the following reporting levels: SM3113 - Lead, 2.0 µg / L Maximum contaminant level: Lead, 15.0 µg/L						
Sample Collected by: <input checked="" type="checkbox"/> Client <input type="checkbox"/> TCWC						
Discussion: BF = Bottle Filler, WF = Water Fountain						
Approved By:  Bill Van Arsdale Laboratory Manager						

Discussion: BF = Bottle Filler, WF = Water Fountain

[Signature]
Approved By:
Bill Van Arsdale
Laboratory Manager

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Minnesota State Laboratory ID# 027-053-119
 Wisconsin State Laboratory ID# 105-10117
 Wisconsin DNR Lab ID #399073400

Client: Kaposia Elementary
 Meridian Consulting
Address: 16620 - 61st Ave N
 Plymouth, MN 55446

Report Number: 24-01422 **Sample Receipt Date:** 2/8/2024
Sample Prep. Date: 2/8/2024 **Sample Prep. Time:** 10:30
Report Issue Date: 3/5/2024 **Phone:** (952)935-3556
Fax: (952)935-5077

Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test	Approved methods used in analyzing the samples listed above have the following reporting levels:
Sample ID		Location		Date	Time	Results	Units
24-01422	Lead	221 Sink	Drinking Water	2/8/2024	6:45	2/29/2024	14:03 <2.00 µg/L
24-01423	Lead	211 Sink	Drinking Water	2/8/2024	6:45	2/29/2024	14:09 <2.00 µg/L
24-01424	Lead	Workroom Sink	Drinking Water	2/8/2024	6:45	2/29/2024	14:15 <2.00 µg/L
24-01425	Lead	213 Sink	Drinking Water	2/8/2024	6:45	2/29/2024	14:33 <2.00 µg/L
24-01426	Lead	210 Sink	Drinking Water	2/8/2024	6:45	2/29/2024	14:51 <2.00 µg/L
24-01427	Lead	202 Sink	Drinking Water	2/8/2024	6:45	2/29/2024	14:57 2.95 µg/L
24-01428	Lead	111 Sink	Drinking Water	2/8/2024	6:45	2/29/2024	15:03 <2.00 µg/L
24-01429	Lead	115 Sink	Drinking Water	2/8/2024	6:45	2/29/2024	15:09 2.01 µg/L
24-01430	Lead	108 Sink	Drinking Water	2/8/2024	6:45	2/29/2024	15:15 <2.00 µg/L
24-01431	Lead	117 Sink	Drinking Water	2/8/2024	6:45	3/5/2024	10:54 <2.00 µg/L
24-01432	Lead	118 Sink	Drinking Water	2/8/2024	6:45	3/5/2024	11:01 6.12 µg/L
24-01433	Lead	119 Sink	Drinking Water	2/8/2024	6:45	3/5/2024	11:07 <2.00 µg/L
24-01434	Lead	125 Sink	Drinking Water	2/8/2024	6:45	3/5/2024	11:13 2.22 µg/L
24-01435	Lead	126 Sink - Center	Drinking Water	2/8/2024	6:45	3/5/2024	11:31 <2.00 µg/L
24-01436	Lead	Health office Sink	Drinking Water	2/8/2024	6:45	3/5/2024	11:37 4.32 µg/L

Approved By:

Frances Turner
 Laboratory Director

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Minnesota State Laboratory ID# 027-053-119
Wisconsin State Laboratory ID# 105-10117
Wisconsin DNR Lab ID #399073400

Client: Kapoia Elementary
Address: 16620 - 61st Ave N
Plymouth, MN 55446

Report Number:	24-04322	Twin City Water Clinic Inc.
Sample Receipt Date:	4/24/2024	617 13th Avenue South
Sample Prep. Date:	4/24/2024	Hopkins, MN 55343
Sample Prep. Time:	9:15	Phone: (952)935-3556
Report Issue Date:	4/25/2024	Fax: (952)935-5077

Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis		Test	
Sample ID		Location		Date	Date	Time	Results	Units
24-04322	Lead	118 Sink	Drinking Water	4/18/2024	8:00	4/25/2024	13:30	<2.0 µg/L

Maximum contaminant level: Lead, 15.0 µg/L

Sample Collected by: X Client TCWC

Sample Temp.: 14° C

Notes:

Discussion:

Approved By:

Howard

Frances Tunnel
Laboratory Director

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety.


All methods are certified by the Minnesota Department of Health, unless otherwise noted.



South St. Paul
Public Schools

South St. Paul School District
Kaposia Education Center

2023-2024 water sampling locations

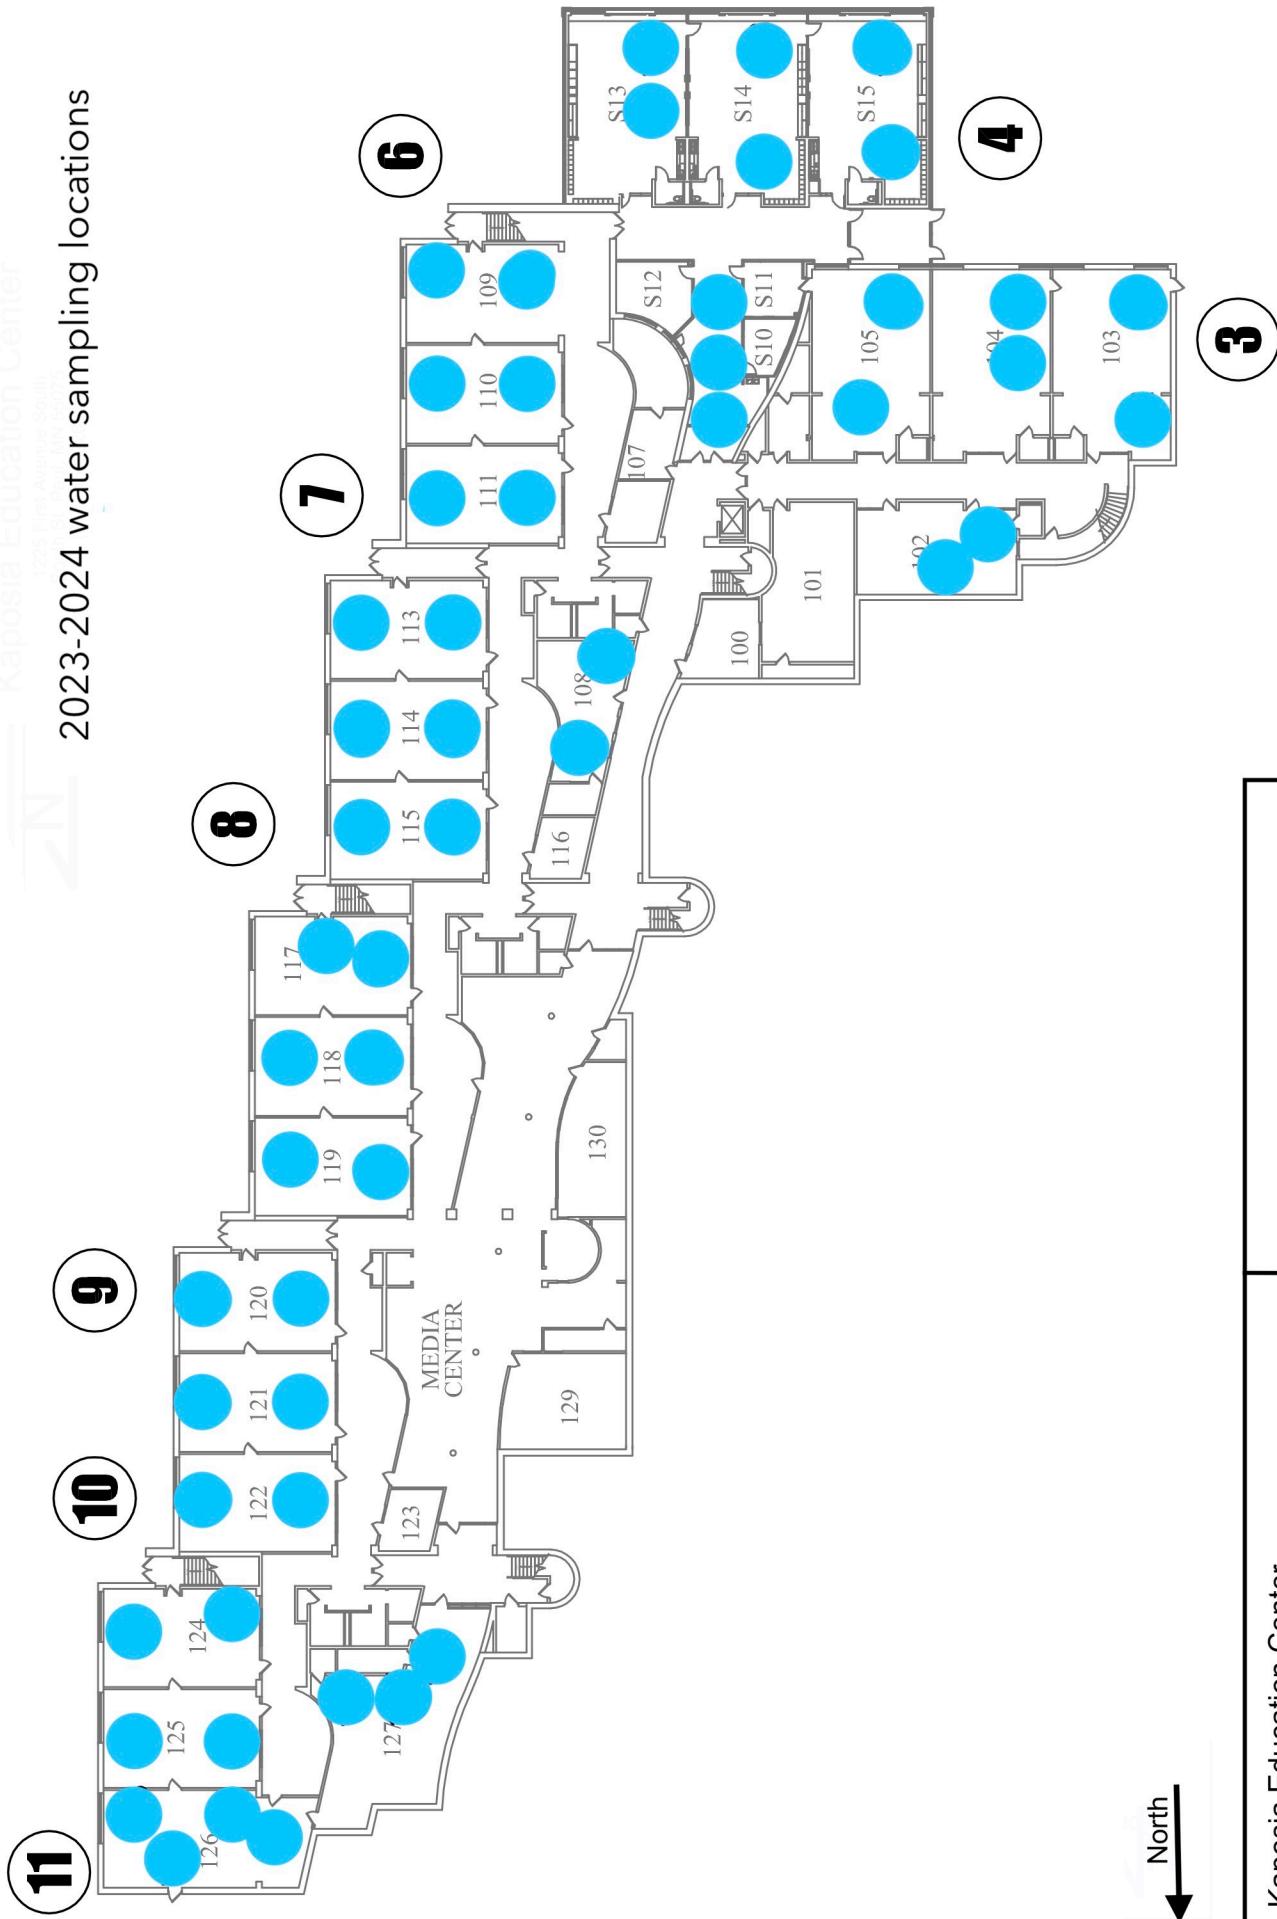

North


Kaposia Education Center
1225 1st Avenue South
South St. Paul, MN 55075
2021
First Level Floor Plan



South St. Paul
Public Schools

South St. Paul School District
Kaposia Education Center

1225 First Avenue South
South St. Paul, MN 55075
(651) 451-8280

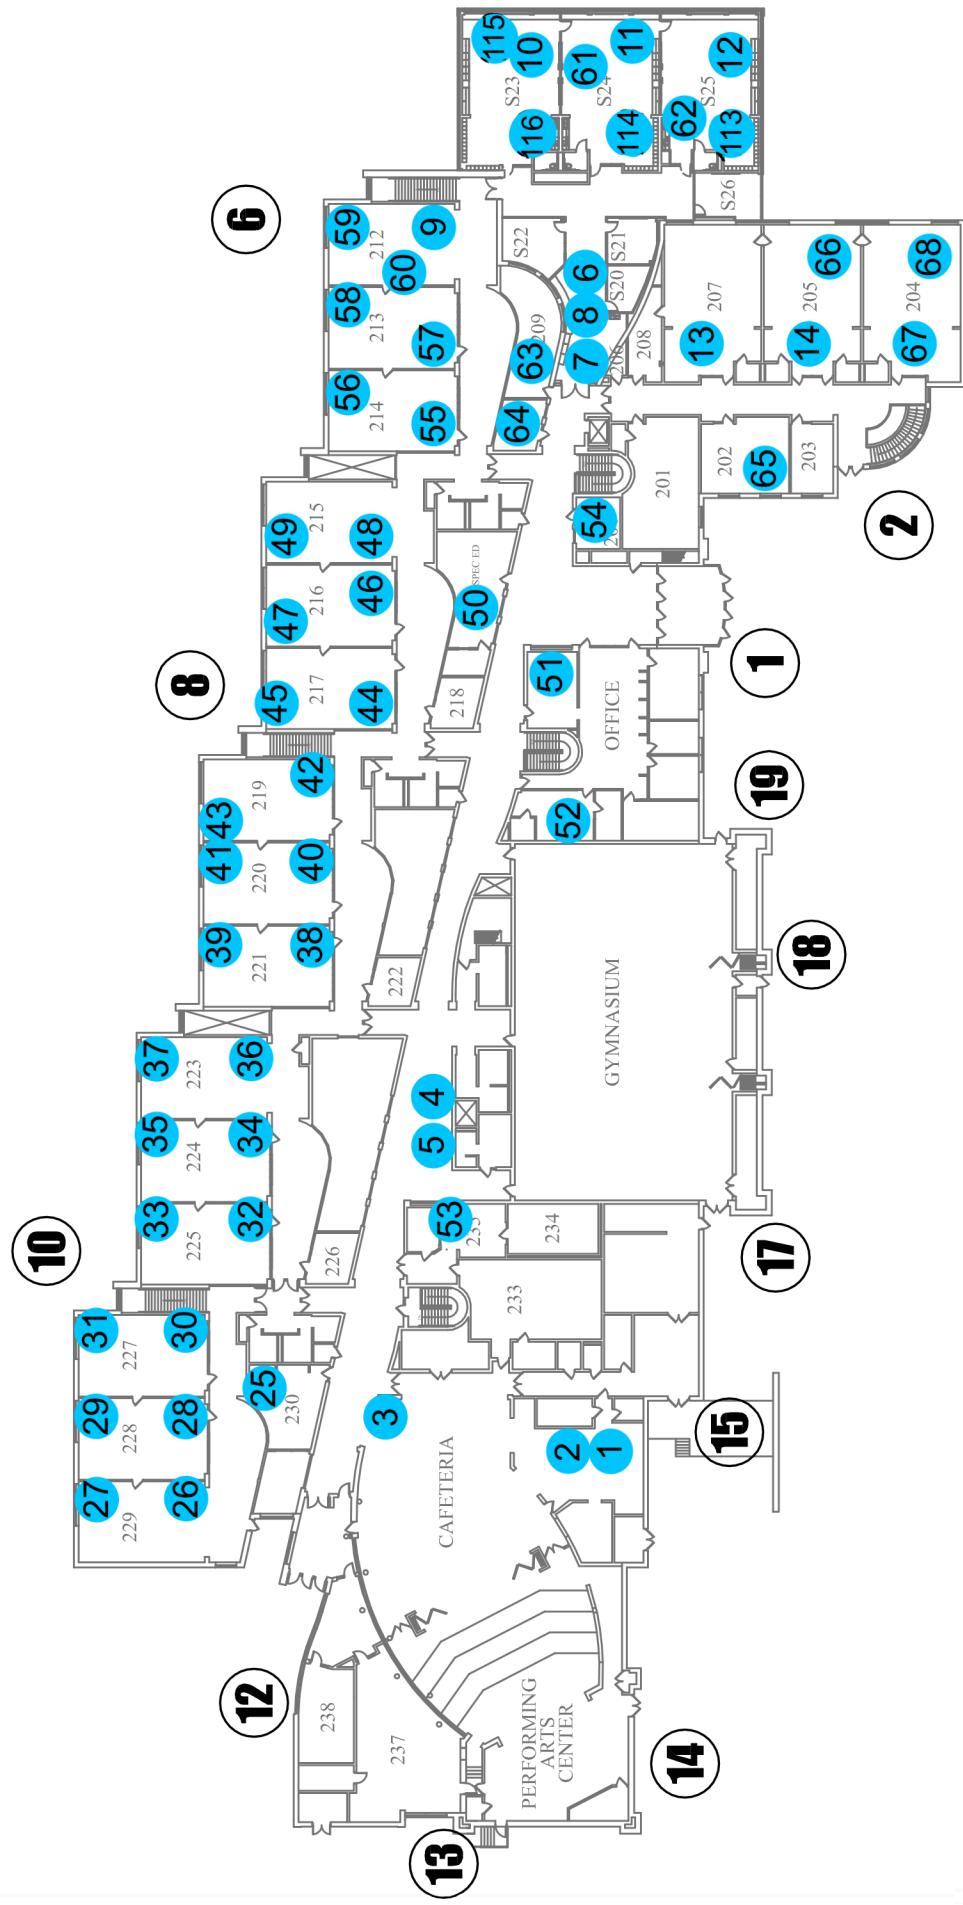

Kaposia Education Center
1225 1st Avenue South
South St. Paul, MN 55075

Second Level Floor Plan
2021

Twin City Water Clinic Laboratory Test Report

Client: Lincoln Center Meridian Consulting Address: 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-02971 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 5/25/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077																																																																																																																																																																																																																								
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Laboratory</th> <th>Analyte</th> <th>Sample</th> <th>Parameter</th> <th>Sample Collection</th> <th>Sample Analysis</th> <th>Test</th> <th></th> </tr> <tr> <th>Sample ID</th> <th></th> <th>Location</th> <th></th> <th>Date</th> <th>Time</th> <th>Results</th> <th>Units</th> </tr> </thead> <tbody> <tr> <td>23-02971</td> <td>Lead</td> <td>Kitchen Produce Sink</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/08/23</td> <td>13:50</td> <td>2.36</td> <td>µg/L</td> </tr> <tr> <td>23-02972</td> <td>Lead</td> <td>Kitchen Center Sink</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/08/23</td> <td>13:56</td> <td>4.20</td> <td>µg/L</td> </tr> <tr> <td>23-02973</td> <td>Lead</td> <td>Kitchen Kettle</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/08/23</td> <td>14:02</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02974</td> <td>Lead</td> <td>Cafeteria Fountain</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/08/23</td> <td>14:08</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02975</td> <td>Lead</td> <td>B39 Fountain</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/08/23</td> <td>14:14</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02976</td> <td>Lead</td> <td>Kids choice Sink</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/08/23</td> <td>14:20</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02977</td> <td>Lead</td> <td>B28 Sink Right</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/08/23</td> <td>14:26</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02978</td> <td>Lead</td> <td>B28 Sink Left</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/08/23</td> <td>14:32</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02979</td> <td>Lead</td> <td>B25 Sink Left</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/11/23</td> <td>13:03</td> <td>3.75</td> <td>µg/L</td> </tr> <tr> <td>23-02980</td> <td>Lead</td> <td>B25 Sink Right</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/11/23</td> <td>13:22</td> <td>2.99</td> <td>µg/L</td> </tr> <tr> <td>23-02981</td> <td>Lead</td> <td>B25 West Sink</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/11/23</td> <td>12:45</td> <td>30.9</td> <td>µg/L</td> </tr> <tr> <td>23-02982</td> <td>Lead</td> <td>B19 Sink Left</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/11/23</td> <td>13:40</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02983</td> <td>Lead</td> <td>B19 Sink Right</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/11/23</td> <td>13:46</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02984</td> <td>Lead</td> <td>B01 Sink Left</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/11/23</td> <td>13:52</td> <td>2.92</td> <td>µg/L</td> </tr> <tr> <td>23-02985</td> <td>Lead</td> <td>B01 Sink Right</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/11/23</td> <td>13:58</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02986</td> <td>Lead</td> <td>B02 Sink</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/11/23</td> <td>14:04</td> <td>2.44</td> <td>µg/L</td> </tr> <tr> <td>23-02987</td> <td>Lead</td> <td>B03 Sink</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/11/23</td> <td>14:10</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02988</td> <td>Lead</td> <td>B04 Sink</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/16/23</td> <td>11:21</td> <td><2.0</td> <td>µg/L</td> </tr> <tr> <td>23-02989</td> <td>Lead</td> <td>B05 Sink</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/16/23</td> <td>11:39</td> <td>3.57</td> <td>µg/L</td> </tr> <tr> <td>23-02990</td> <td>Lead</td> <td>WF by B05 Left</td> <td>Drinking Water</td> <td>3/29/2023</td> <td>06:00</td> <td>05/16/23</td> <td>11:45</td> <td><2.0</td> <td>µg/L</td> </tr> </tbody> </table>			Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test		Sample ID		Location		Date	Time	Results	Units	23-02971	Lead	Kitchen Produce Sink	Drinking Water	3/29/2023	06:00	05/08/23	13:50	2.36	µg/L	23-02972	Lead	Kitchen Center Sink	Drinking Water	3/29/2023	06:00	05/08/23	13:56	4.20	µg/L	23-02973	Lead	Kitchen Kettle	Drinking Water	3/29/2023	06:00	05/08/23	14:02	<2.0	µg/L	23-02974	Lead	Cafeteria Fountain	Drinking Water	3/29/2023	06:00	05/08/23	14:08	<2.0	µg/L	23-02975	Lead	B39 Fountain	Drinking Water	3/29/2023	06:00	05/08/23	14:14	<2.0	µg/L	23-02976	Lead	Kids choice Sink	Drinking Water	3/29/2023	06:00	05/08/23	14:20	<2.0	µg/L	23-02977	Lead	B28 Sink Right	Drinking Water	3/29/2023	06:00	05/08/23	14:26	<2.0	µg/L	23-02978	Lead	B28 Sink Left	Drinking Water	3/29/2023	06:00	05/08/23	14:32	<2.0	µg/L	23-02979	Lead	B25 Sink Left	Drinking Water	3/29/2023	06:00	05/11/23	13:03	3.75	µg/L	23-02980	Lead	B25 Sink Right	Drinking Water	3/29/2023	06:00	05/11/23	13:22	2.99	µg/L	23-02981	Lead	B25 West Sink	Drinking Water	3/29/2023	06:00	05/11/23	12:45	30.9	µg/L	23-02982	Lead	B19 Sink Left	Drinking Water	3/29/2023	06:00	05/11/23	13:40	<2.0	µg/L	23-02983	Lead	B19 Sink Right	Drinking Water	3/29/2023	06:00	05/11/23	13:46	<2.0	µg/L	23-02984	Lead	B01 Sink Left	Drinking Water	3/29/2023	06:00	05/11/23	13:52	2.92	µg/L	23-02985	Lead	B01 Sink Right	Drinking Water	3/29/2023	06:00	05/11/23	13:58	<2.0	µg/L	23-02986	Lead	B02 Sink	Drinking Water	3/29/2023	06:00	05/11/23	14:04	2.44	µg/L	23-02987	Lead	B03 Sink	Drinking Water	3/29/2023	06:00	05/11/23	14:10	<2.0	µg/L	23-02988	Lead	B04 Sink	Drinking Water	3/29/2023	06:00	05/16/23	11:21	<2.0	µg/L	23-02989	Lead	B05 Sink	Drinking Water	3/29/2023	06:00	05/16/23	11:39	3.57	µg/L	23-02990	Lead	WF by B05 Left	Drinking Water	3/29/2023	06:00	05/16/23	11:45	<2.0	µg/L
Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test																																																																																																																																																																																																																				
Sample ID		Location		Date	Time	Results	Units																																																																																																																																																																																																																			
23-02971	Lead	Kitchen Produce Sink	Drinking Water	3/29/2023	06:00	05/08/23	13:50	2.36	µg/L																																																																																																																																																																																																																	
23-02972	Lead	Kitchen Center Sink	Drinking Water	3/29/2023	06:00	05/08/23	13:56	4.20	µg/L																																																																																																																																																																																																																	
23-02973	Lead	Kitchen Kettle	Drinking Water	3/29/2023	06:00	05/08/23	14:02	<2.0	µg/L																																																																																																																																																																																																																	
23-02974	Lead	Cafeteria Fountain	Drinking Water	3/29/2023	06:00	05/08/23	14:08	<2.0	µg/L																																																																																																																																																																																																																	
23-02975	Lead	B39 Fountain	Drinking Water	3/29/2023	06:00	05/08/23	14:14	<2.0	µg/L																																																																																																																																																																																																																	
23-02976	Lead	Kids choice Sink	Drinking Water	3/29/2023	06:00	05/08/23	14:20	<2.0	µg/L																																																																																																																																																																																																																	
23-02977	Lead	B28 Sink Right	Drinking Water	3/29/2023	06:00	05/08/23	14:26	<2.0	µg/L																																																																																																																																																																																																																	
23-02978	Lead	B28 Sink Left	Drinking Water	3/29/2023	06:00	05/08/23	14:32	<2.0	µg/L																																																																																																																																																																																																																	
23-02979	Lead	B25 Sink Left	Drinking Water	3/29/2023	06:00	05/11/23	13:03	3.75	µg/L																																																																																																																																																																																																																	
23-02980	Lead	B25 Sink Right	Drinking Water	3/29/2023	06:00	05/11/23	13:22	2.99	µg/L																																																																																																																																																																																																																	
23-02981	Lead	B25 West Sink	Drinking Water	3/29/2023	06:00	05/11/23	12:45	30.9	µg/L																																																																																																																																																																																																																	
23-02982	Lead	B19 Sink Left	Drinking Water	3/29/2023	06:00	05/11/23	13:40	<2.0	µg/L																																																																																																																																																																																																																	
23-02983	Lead	B19 Sink Right	Drinking Water	3/29/2023	06:00	05/11/23	13:46	<2.0	µg/L																																																																																																																																																																																																																	
23-02984	Lead	B01 Sink Left	Drinking Water	3/29/2023	06:00	05/11/23	13:52	2.92	µg/L																																																																																																																																																																																																																	
23-02985	Lead	B01 Sink Right	Drinking Water	3/29/2023	06:00	05/11/23	13:58	<2.0	µg/L																																																																																																																																																																																																																	
23-02986	Lead	B02 Sink	Drinking Water	3/29/2023	06:00	05/11/23	14:04	2.44	µg/L																																																																																																																																																																																																																	
23-02987	Lead	B03 Sink	Drinking Water	3/29/2023	06:00	05/11/23	14:10	<2.0	µg/L																																																																																																																																																																																																																	
23-02988	Lead	B04 Sink	Drinking Water	3/29/2023	06:00	05/16/23	11:21	<2.0	µg/L																																																																																																																																																																																																																	
23-02989	Lead	B05 Sink	Drinking Water	3/29/2023	06:00	05/16/23	11:39	3.57	µg/L																																																																																																																																																																																																																	
23-02990	Lead	WF by B05 Left	Drinking Water	3/29/2023	06:00	05/16/23	11:45	<2.0	µg/L																																																																																																																																																																																																																	
<p style="margin-left: 100px;">Approved methods used in analyzing the samples listed above have the following reporting levels:</p> <p style="margin-left: 100px;">SM3113 - Lead, 2.0 µg / L Maximum contaminant level: Lead, 15.0 µg / L</p> <p style="margin-left: 100px;">Approved methods used in analyzing the samples listed above have the following reporting levels:</p> <p style="margin-left: 100px;">TCWC</p> <p style="margin-left: 100px;">Sample Collected by: <input checked="" type="checkbox"/> Client <input type="checkbox"/> TCWC</p> <p style="margin-left: 100px;">Sample Temp.: 11° C</p> <p style="margin-left: 100px;">Notes:</p> <p style="margin-left: 100px;">Discussion: BF = Bottle Filler, WF = Water Fountain</p>																																																																																																																																																																																																																										

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.



Bill Van Arsdale
Laboratory Manager

Twin City Water Clinic Laboratory Test Report

Client: Lincoln Center Meridian Consulting Address: 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-02991 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 5/25/23 Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077	<p>Minnesota State Laboratory ID# 027-053-119 Wisconsin State Laboratory ID# 105-10117 Wisconsin DNR Lab ID #399073400</p> <p>X No samples were subcontracted; or the above test results(s) with ** designation were produced by a subcontracted laboratory. [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.</p>						
Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test		
Sample ID		Location	Date	Time	Date	Results	Units	
23-02991	Lead	WF by B05 Right	Drinking Water	3/29/2023	06:00	05/16/23	<2.0	µg/L
23-02992	Lead	B06 WF	Drinking Water	3/29/2023	06:00	05/16/23	26.3	µg/L
23-02993	Lead	B42 Fountain Left	Drinking Water	3/29/2023	06:00	05/16/23	<2.0	µg/L
23-02994	Lead	B42 Fountain Right	Drinking Water	3/29/2023	06:00	05/16/23	<2.0	µg/L
23-02995	Lead	B42 BF	Drinking Water	3/29/2023	06:00	05/16/23	<2.0	µg/L
23-02996	Lead	WF by B29	Drinking Water	3/29/2023	06:00	05/16/23	<2.0	µg/L
23-02997	Lead	WF by 117 Left	Drinking Water	3/29/2023	06:00	05/16/23	<2.0	µg/L
23-02998	Lead	WF by 117 Right	Drinking Water	3/29/2023	06:00	05/16/23	12:18	Sample Collected by: X Client — TCWC
23-02999	Lead	112 Sink	Drinking Water	3/29/2023	06:00	05/16/23	12:30	Sample Temp.: 11° C
23-03000	Lead	108 Sink	Drinking Water	3/29/2023	06:00	05/16/23	<2.0	µg/L
23-03001	Lead	107 Sink	Drinking Water	3/29/2023	06:00	05/16/23	12:36	Notes:
23-03002	Lead	105 Sink	Drinking Water	3/29/2023	06:00	05/16/23	12:54	3.36
23-03003	Lead	104 Sink	Drinking Water	3/29/2023	06:00	05/16/23	13:15	µg/L
23-03004	Lead	102 Sink	Drinking Water	3/29/2023	06:00	05/16/23	13:21	2.54
23-03005	Lead	103 Sink	Drinking Water	3/29/2023	06:00	05/16/23	13:27	µg/L
23-03006	Lead	WF by 104 Left	Drinking Water	3/29/2023	06:00	05/16/23	4.30	µg/L
23-03007	Lead	WF by 104 Right	Drinking Water	3/29/2023	06:00	05/16/23	<2.0	µg/L
23-03008	Lead	WF by 107 Left	Drinking Water	3/29/2023	06:00	05/16/23	14:21	Bill Van Arsdale
23-03009	Lead	WF by 107 Right	Drinking Water	3/29/2023	06:00	05/16/23	2.90	Laboratory Manager
23-03010	Lead	Health Office Sink	Drinking Water	3/29/2023	06:00	05/16/23	2.02	
						14:39	µg/L	
						14:45	µg/L	
						<2.0		
						µg/L		

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Client: Lincoln Center Meridian Consulting 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-03011 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 5/25/23 Phone: (952)935-3556 Fax: (952)935-5077	Minnesota State Laboratory ID# 105-10117 Wisconsin State Laboratory ID# 105-10117 Wisconsin DNR Lab ID #399073400							
		<input checked="" type="checkbox"/> No samples were subcontracted; or the above test results(s) with ** designation were produced by a subcontracted laboratory. [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.							
Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test			
Sample ID		Location	Date	Time	Date	Results	Units		
23-03011	Lead	Staff Lounge	Drinking Water	3/29/2023	06:00	05/16/23	14:57	73.0	µg/L
23-03012	Lead	135 Sink	Drinking Water	3/29/2023	06:00	05/16/23	15:03	<2.0	µg/L
23-03013	Lead	138 Fountain	Drinking Water	3/29/2023	06:00	05/16/23	15:09	4.71	µg/L
23-03014	Lead	138 Sink	Drinking Water	3/29/2023	06:00	05/16/23	15:16	<2.0	µg/L
23-03015	Lead	WF by 139 Left	Drinking Water	3/29/2023	06:00	05/16/23	15:22	<2.0	µg/L
23-03016	Lead	WF by 139 Right	Drinking Water	3/29/2023	06:00	05/16/23	15:28	<2.0	µg/L
23-03017	Lead	BF by 139	Drinking Water	3/29/2023	06:00	05/16/23	15:34	<2.0	µg/L
23-03018	Lead	165A Sink Left	Drinking Water	3/29/2023	06:00	05/18/23	12:02	<2.0	µg/L
23-03019	Lead	165A Fountain	Drinking Water	3/29/2023	06:00	05/18/23	12:08	4.22	µg/L
23-03020	Lead	165B Fountain	Drinking Water	3/29/2023	06:00	05/18/23	12:14	<2.0	µg/L
23-03021	Lead	165B Sink Right	Drinking Water	3/29/2023	06:00	05/18/23	12:20	<2.0	µg/L
23-03022	Lead	Gym 3 WF	Drinking Water	3/29/2023	06:00	05/18/23	12:26	<2.0	µg/L
23-03023	Lead	166 Sink	Drinking Water	3/29/2023	06:00	05/18/23	12:32	2.99	µg/L
23-03024	Lead	167 Sink	Drinking Water	3/29/2023	06:00	05/18/23	12:38	<2.0	µg/L
23-03025	Lead	Gym 4 Fountain	Drinking Water	3/29/2023	06:00	05/18/23	12:56	2.04	µg/L
23-03026	Lead	Gym 5 Fountain	Drinking Water	3/29/2023	06:00	05/18/23	13:15	4.20	µg/L
23-03027	Lead	153 Fountain	Drinking Water	3/29/2023	06:00	05/18/23	13:21	<2.0	µg/L
23-03028	Lead	152 Fountain	Drinking Water	3/29/2023	06:00	05/18/23	13:27	3.58	µg/L
23-03029	Lead	151 Fountain	Drinking Water	3/29/2023	06:00	05/18/23	13:33	<2.0	µg/L
23-03030	Lead	150 Fountain	Drinking Water	3/29/2023	06:00	05/18/23	13:39	<2.0	µg/L

Approved methods used in analyzing the samples listed above have the following reporting levels:
 SM3113 - Lead, 2.0 µg/L
 Maximum contaminant level: Lead, 15.0 µg/L


 Sample Collected by: Client TCWC
 Notes:

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Client: Lincoln Center Meridian Consulting 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-03031 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 5/25/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077
Laboratory Sample ID Analyte Sample Location	Parameter Sample Collection Date Time Sample Analysis Date Time Results Test Units	Approved methods used in analyzing the samples listed above have the following reporting levels: SM3113 - Lead, 2.0 µg/L Maximum contaminant level: Lead, 15.0 µg/L
23-03031 Lead 149 Fountain	Drinking Water 3/29/2023 06:00 05/18/23 13:45 4.22 µg/L	
23-03032 Lead Fountain by 149	Drinking Water 3/29/2023 06:00 05/18/23 13:51 3.31 µg/L	
23-03033 Lead Fountain by Media Ctr West	Drinking Water 3/29/2023 06:00 05/18/23 13:57 <2.0 µg/L	
23-03034 Lead 142 Fountain	Drinking Water 3/29/2023 06:00 05/18/23 14:03 <2.0 µg/L	
23-03035 Lead 144 Fountain	Drinking Water 3/29/2023 06:00 05/18/23 14:21 3.76 µg/L	Sample Collected by: <input checked="" type="checkbox"/> Client <input type="checkbox"/> TCWC
23-03036 Lead 117 Fountain	Drinking Water 3/29/2023 06:00 05/18/23 14:41 22.9 µg/L	
23-03037 Lead 216 Sink	Drinking Water 3/29/2023 06:00 05/18/23 14:50 29.5 µg/L	Sample Temp.: 11° C
23-03038 Lead Fountain by 215 Left	Drinking Water 3/29/2023 06:00 05/18/23 14:56 <2.0 µg/L	
23-03039 Lead Fountain by 215 Right	Drinking Water 3/29/2023 06:00 05/18/23 15:02 <2.0 µg/L	
23-03040 Lead BF by 215	Drinking Water 3/29/2023 06:00 05/18/23 15:08 <2.0 µg/L	Notes:
23-03041 Lead 215 Fountain	Drinking Water 3/29/2023 06:00 05/18/23 15:14 <2.0 µg/L	
23-03042 Lead 209 Fountain	Drinking Water 3/29/2023 06:00 05/18/23 15:20 <2.0 µg/L	
23-03043 Lead 206 Fountain	Drinking Water 3/29/2023 06:00 05/18/23 15:26 3.75 µg/L	Discussion: BF = Bottle Filler, WF = Water Fountain
23-03044 Lead WF by 206 Left	Drinking Water 3/29/2023 06:00 05/18/23 15:32 <2.0 µg/L	
23-03045 Lead WF by 206 Right	Drinking Water 3/29/2023 06:00 05/22/23 13:14 2.97 µg/L	
23-03046 Lead 204 Sink	Drinking Water 3/29/2023 06:00 05/22/23 13:20 2.92 µg/L	
23-03047 Lead 203 Sink	Drinking Water 3/29/2023 06:00 05/22/23 13:26 <2.0 µg/L	Approved By:
23-03048 Lead 201 Sink	Drinking Water 3/29/2023 06:00 05/22/23 13:35 27.3 µg/L	 Bill Van Arsdale Laboratory Manager
23-03049 Lead 202 Sink	Drinking Water 3/29/2023 06:00 05/22/23 13:41 <2.0 µg/L	
23-03050 Lead WF by 203 Left	Drinking Water 3/29/2023 06:00 05/22/23 13:47 <2.0 µg/L	

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Client:	Lincoln Center Meridian Consulting 16620 - 61st Ave N Plymouth, MN 55446	Report Number:	23-03051	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077	Minnesota State Laboratory ID# 027-053-119 Wisconsin State Laboratory ID# 105-10117 Wisconsin DNR Lab ID #399073400	X No samples were subcontracted; or the above test results(s) with ** designation were produced by a subcontracted laboratory. [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.
Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test
Sample ID		Location	Date	Time	Date	Results
23-03051	Lead	WF by 203 Right	Drinking Water	3/29/2023	06:00	05/22/23 13:53 2.36 µg/L
23-03052	Lead	229 Fountain	Drinking Water	3/29/2023	06:00	05/22/23 13:59 4.30 µg/L
23-03053	Lead	230 Fountain	Drinking Water	3/29/2023	06:00	05/22/23 14:05 2.77 µg/L
23-03054	Lead	WF by 230	Drinking Water	3/29/2023	06:00	05/25/23 11:21 <2.0 µg/L
23-03055	Lead	236 Sink North	Drinking Water	3/29/2023	06:00	05/25/23 11:27 <2.0 µg/L
23-03056	Lead	236 Sink West	Drinking Water	3/29/2023	06:00	05/25/23 11:39 63.7 µg/L
23-03057	Lead	237 Bath Sink	Drinking Water	3/29/2023	06:00	05/25/23 11:45 <2.0 µg/L
23-03058	Lead	238 Sink	Drinking Water	3/29/2023	06:00	05/25/23 12:04 5.44 µg/L
23-03059	Lead	239 Sink	Drinking Water	3/29/2023	06:00	05/25/23 12:22 15.5 µg/L
23-03060	Lead	WF by 245 Left	Drinking Water	3/29/2023	06:00	05/25/23 12:28 <2.0 µg/L
23-03061	Lead	WF by 245 Right	Drinking Water	3/29/2023	06:00	05/25/23 12:34 <2.0 µg/L
23-03062	Lead	224 Fountain	Drinking Water	3/29/2023	06:00	05/25/23 12:40 <2.0 µg/L
23-03063	Lead	223 Sink	Drinking Water	3/29/2023	06:00	05/25/23 12:46 <2.0 µg/L
23-03064	Lead	232 Sink	Drinking Water	3/29/2023	06:00	05/25/23 12:52 7.06 µg/L
23-03065	Lead	218 Sink	Drinking Water	3/29/2023	06:00	05/25/23 12:58 2.99 µg/L
23-03066	Lead	217 Sink	Drinking Water	3/29/2023	06:00	05/25/23 13:04 17.6 µg/L

Approved By:

WV
Bill Van Arsdale
Laboratory Manager

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Minnesota State Laboratory ID# 027-053-119
 Wisconsin State Laboratory ID# 105-10117
 Wisconsin DNR Lab ID #399073400

Client:	Lincoln Center Meridian Consulting	Report Number:	23-06894
Address:	16620 - 61st Ave N Plymouth, MN 55446	Sample Receipt Date:	6/30/23
		Sample Prep. Date:	6/30/23
		Sample Prep. Time:	11:09
		Report Issue Date:	7/6/23

Laboratory	Analyte	Sample	Parameter	Sample Collection		Sample Analysis	Test	
Sample ID		Location		Date	Time	Date	Results	Units
23-06894	Lead	B25 West Sink	Drinking Water	6/29/2023	07:00	07/05/23	14:34	17.3 µg/L
23-06895	Lead	B06 Fountain	Drinking Water	6/29/2023	07:00	07/05/23	14:40	16.7 µg/L
23-06896	Lead	112 Sink	Drinking Water	6/29/2023	07:00	07/05/23	14:46	12.0 µg/L
23-06897	Lead	117 Fountain	Drinking Water	6/29/2023	07:00	07/05/23	14:52	9.01 µg/L
23-06898	Lead	Staff Lounge Sink	Drinking Water	6/29/2023	07:00	07/05/23	15:10	4.16 µg/L
23-06899	Lead	216 Sink	Drinking Water	6/29/2023	07:00	07/05/23	15:28	12.5 µg/L
23-06900	Lead	236 West Sink	Drinking Water	6/29/2023	07:00	07/05/23	15:37	29.3 µg/L
23-06901	Lead	201 Sink	Drinking Water	6/29/2023	07:00	07/05/23	15:43	3.76 µg/L
23-06902	Lead	238 Sink	Drinking Water	6/29/2023	07:00	07/05/23	16:10	4.32 µg/L
23-06903	Lead	239 Sink	Drinking Water	6/29/2023	07:00	07/05/23	16:28	3.31 µg/L
23-06904	Lead	232 Sink	Drinking Water	6/29/2023	07:00	07/05/23	16:37	2.09 µg/L
23-06905	Lead	217 Sink	Drinking Water	6/29/2023	07:00	07/05/23	16:43	2.51 µg/L

Discussion:

Bill Van Arsdale
Laboratory Manager

Approved By:

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Client: Lincoln Center Meridian Consulting Address: 16620 - 61st Ave N Plymouth, MN 55446		Minnesota State Laboratory ID# 027-053-119 Wisconsin State Laboratory ID# 105-10117 Wisconsin DNR Lab ID #399073400		<p><input checked="" type="checkbox"/> No samples were subcontracted; or the above test result(s) with *** designation were produced by a subcontracted laboratory. [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.</p>					
		Report Number: 24-01436 Sample Receipt Date: 2/8/2024 Sample Prep. Date: 2/8/2024 Sample Prep. Time: 10:30 Report Issue Date: 3/5/2024 Phone: (952)935-3556 Fax: (952)935-5077							
Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test			
Sample ID	Location	Date	Time	Date	Time	Results			
24-01436	Lead	B25 West Sink	Drinking Water	2/8/2024	6:30	3/5/2024	11:49	<2.00	$\mu\text{g}/\text{L}$
24-01437	Lead	B06 Fountain	Drinking Water	2/8/2024	6:30	3/5/2024	11:55	15.2	$\mu\text{g}/\text{L}$
24-01438	Lead	112 Sink	Drinking Water	2/8/2024	6:30	3/5/2024	12:01	2.06	$\mu\text{g}/\text{L}$
24-01439	Lead	117 Fountain	Drinking Water	2/8/2024	6:30	3/5/2024	12:07	<2.00	$\mu\text{g}/\text{L}$
24-01440	Lead	216 Sink	Drinking Water	2/8/2024	6:30	3/5/2024	12:13	6.05	$\mu\text{g}/\text{L}$
Sample Collected by: <input checked="" type="checkbox"/> Client <input type="checkbox"/> TCWC Sample Temp.: 21°C									
Notes:									
Discussion:									
Approved By:  Frances Turner Laboratory Director									

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety.
 All methods are certified by the Minnesota Department of Health, unless otherwise noted.


Twin City Water Clinic Laboratory Test Report

Client: Lincoln Center Meridian Consulting Address: 16620 - 61st Ave N Plymouth, MN 55446		Minnesota State Laboratory ID# 027-053-119 Wisconsin State Laboratory ID# 105-10117 Wisconsin DNR Lab ID #399073400		X No samples were subcontracted; or the above test result(s) with *** designation were produced by a subcontracted laboratory. [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.	
Report Number: 24-04320 Sample Receipt Date: 4/24/2024 Sample Prep. Date: 4/24/2024 Sample Prep. Time: 9:15 Report Issue Date: 4/25/2024		Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077			
Laboratory Sample ID 24-04320 Lead	Analyte Sample Location 216 Sink	Parameter Sample Collection Date 4/18/2024	Sample Analysis Date Time 7:00	Test Results Units <2.0 µg/L	
Drinking Water 24-04321 Lead	Drinking Water B06 Fountain	4/18/2024 7:30	4/25/2024 13:24	<2.0 µg/L	Maximum contaminant level: Lead, 15.0 µg/L
<p>Approved methods used in analyzing the samples listed above have the following reporting levels:</p> <p>SM3113 - Lead, 2.0 µg / L</p> <p>Sample Collected by: <input checked="" type="checkbox"/> Client <input type="checkbox"/> TCWC</p> <p>Sample Temp.: 14° C</p> <p>Notes:</p> <p>Discussion:</p> <p>Approved By:</p> <p> Frances Turner Laboratory Director</p>					


The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety.
 All methods are certified by the Minnesota Department of Health, unless otherwise noted.



South St. Paul
Public Schools

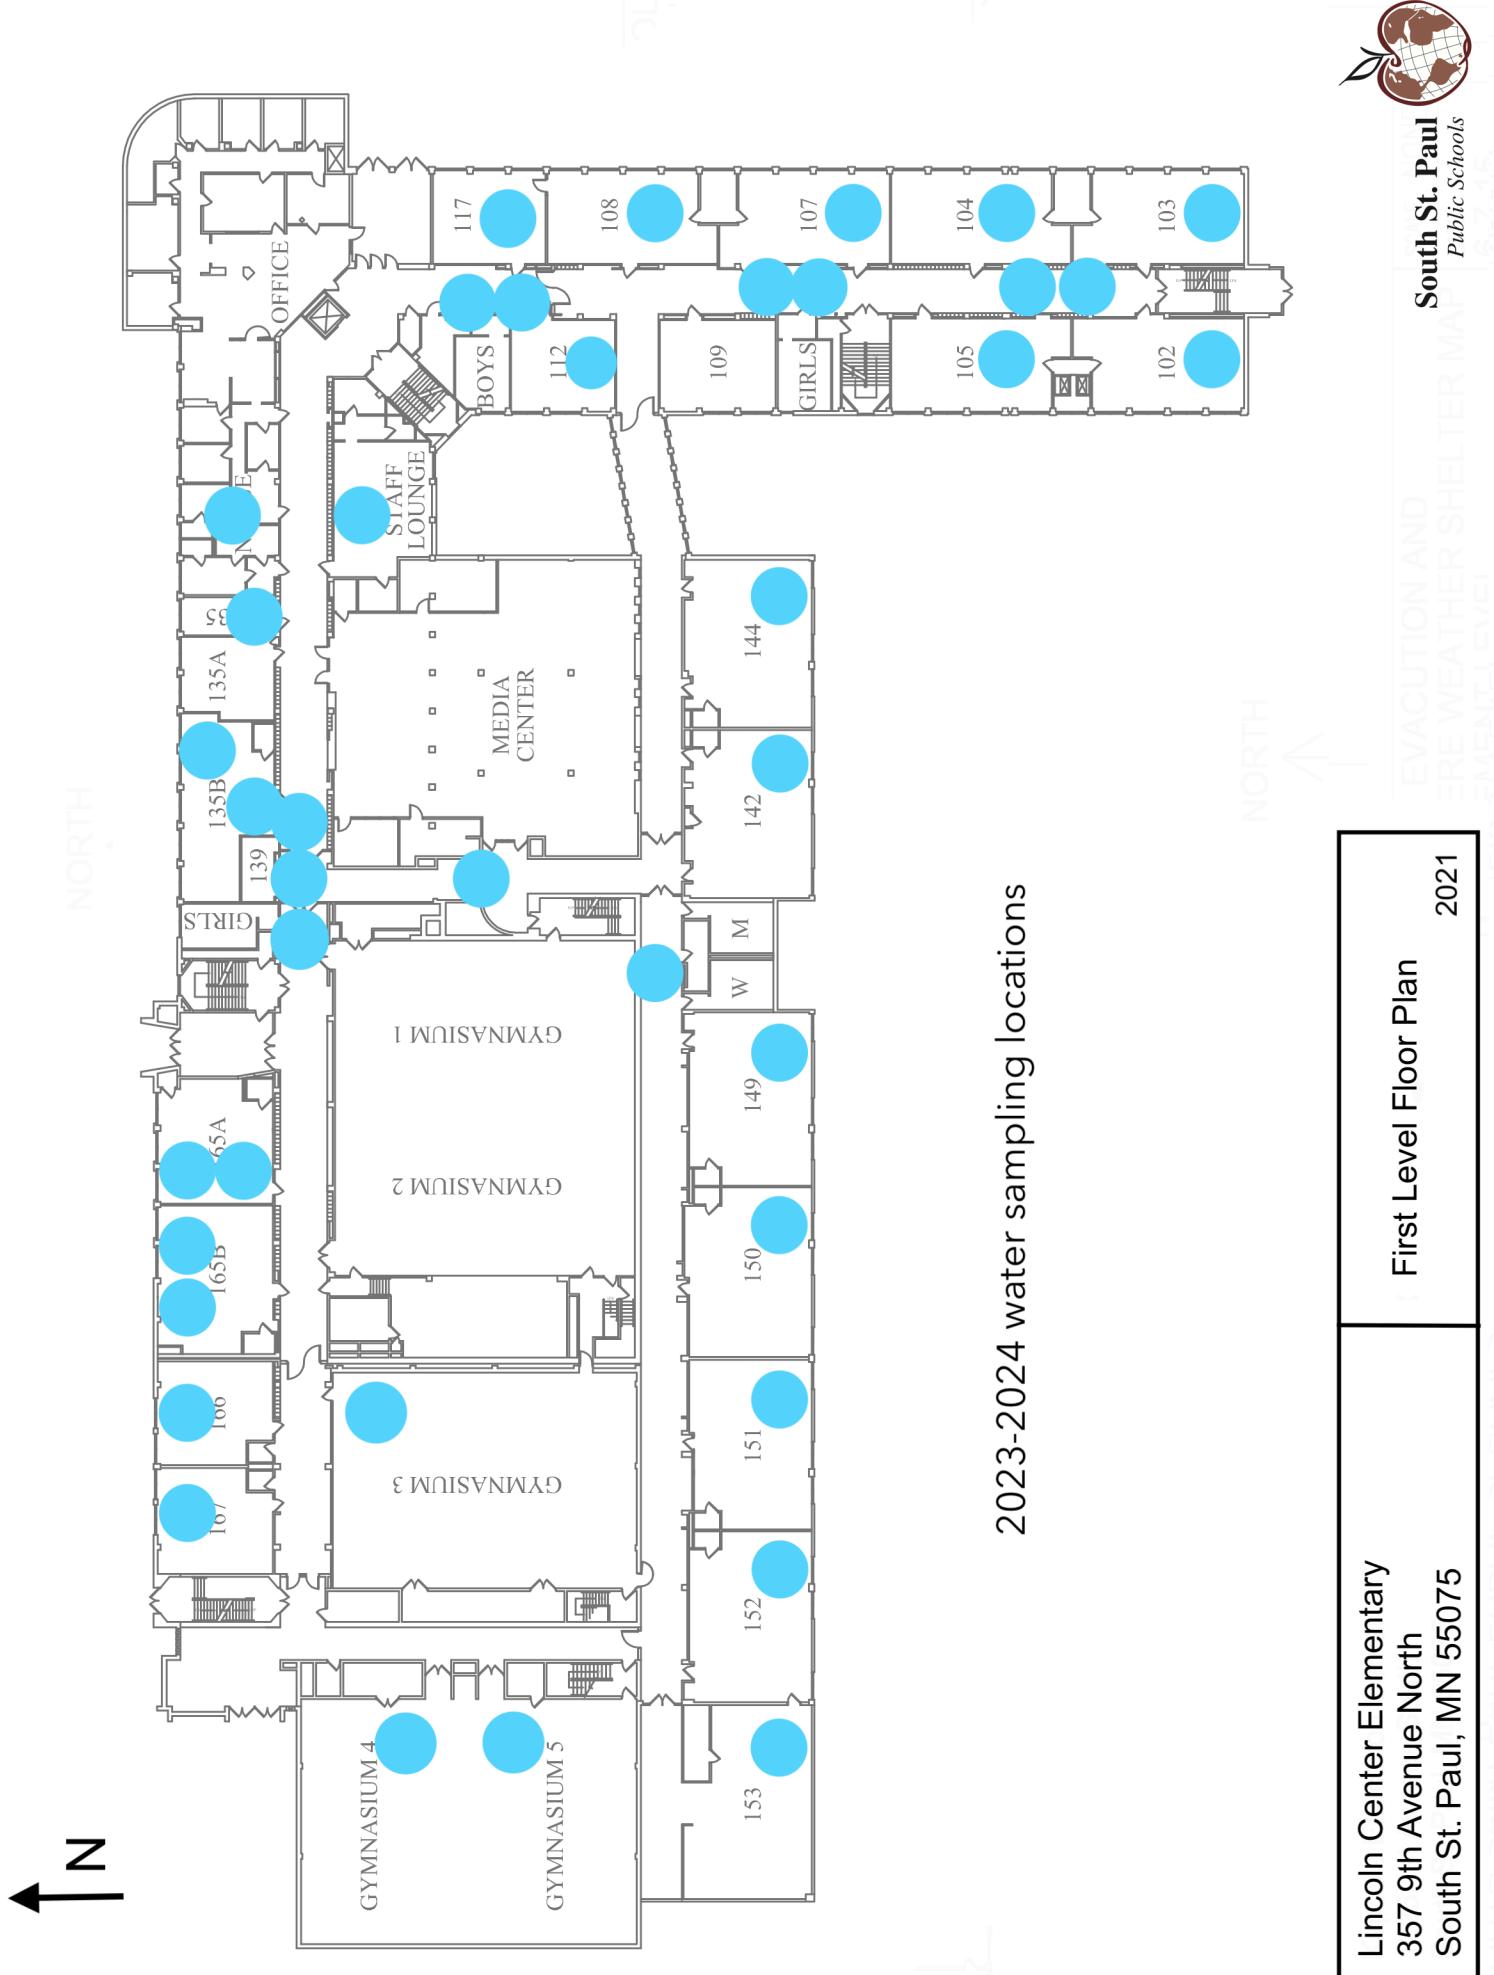

Lincoln Center Elementary 357 9th Avenue North South St. Paul, MN 55075	First Level Floor Plan	2021
---	------------------------	------

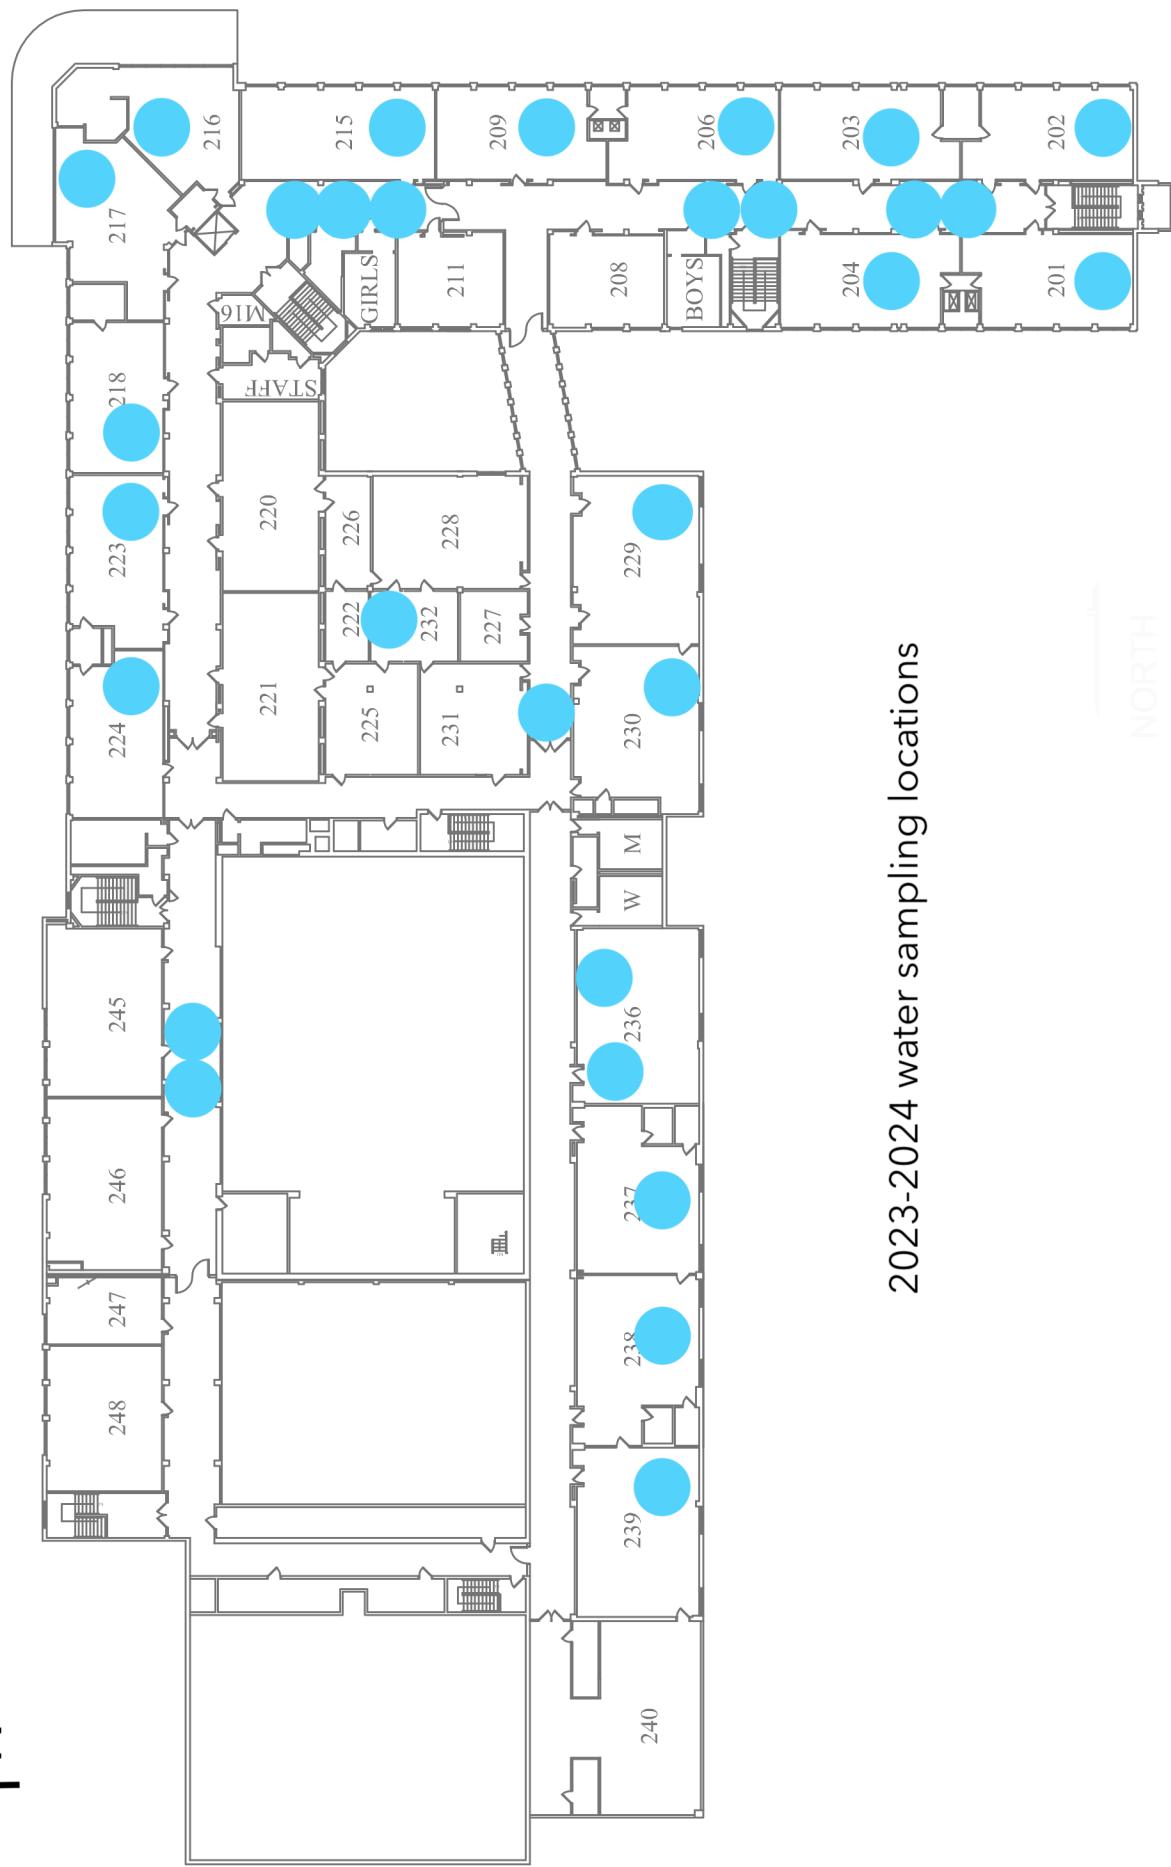

2023-2024 water sampling locations


Lincoln Center Elementary
357 9th Avenue North
South St. Paul, MN 55075

Second Level Floor Plan
2021

South St. Paul
Public Schools

6-25-15

N

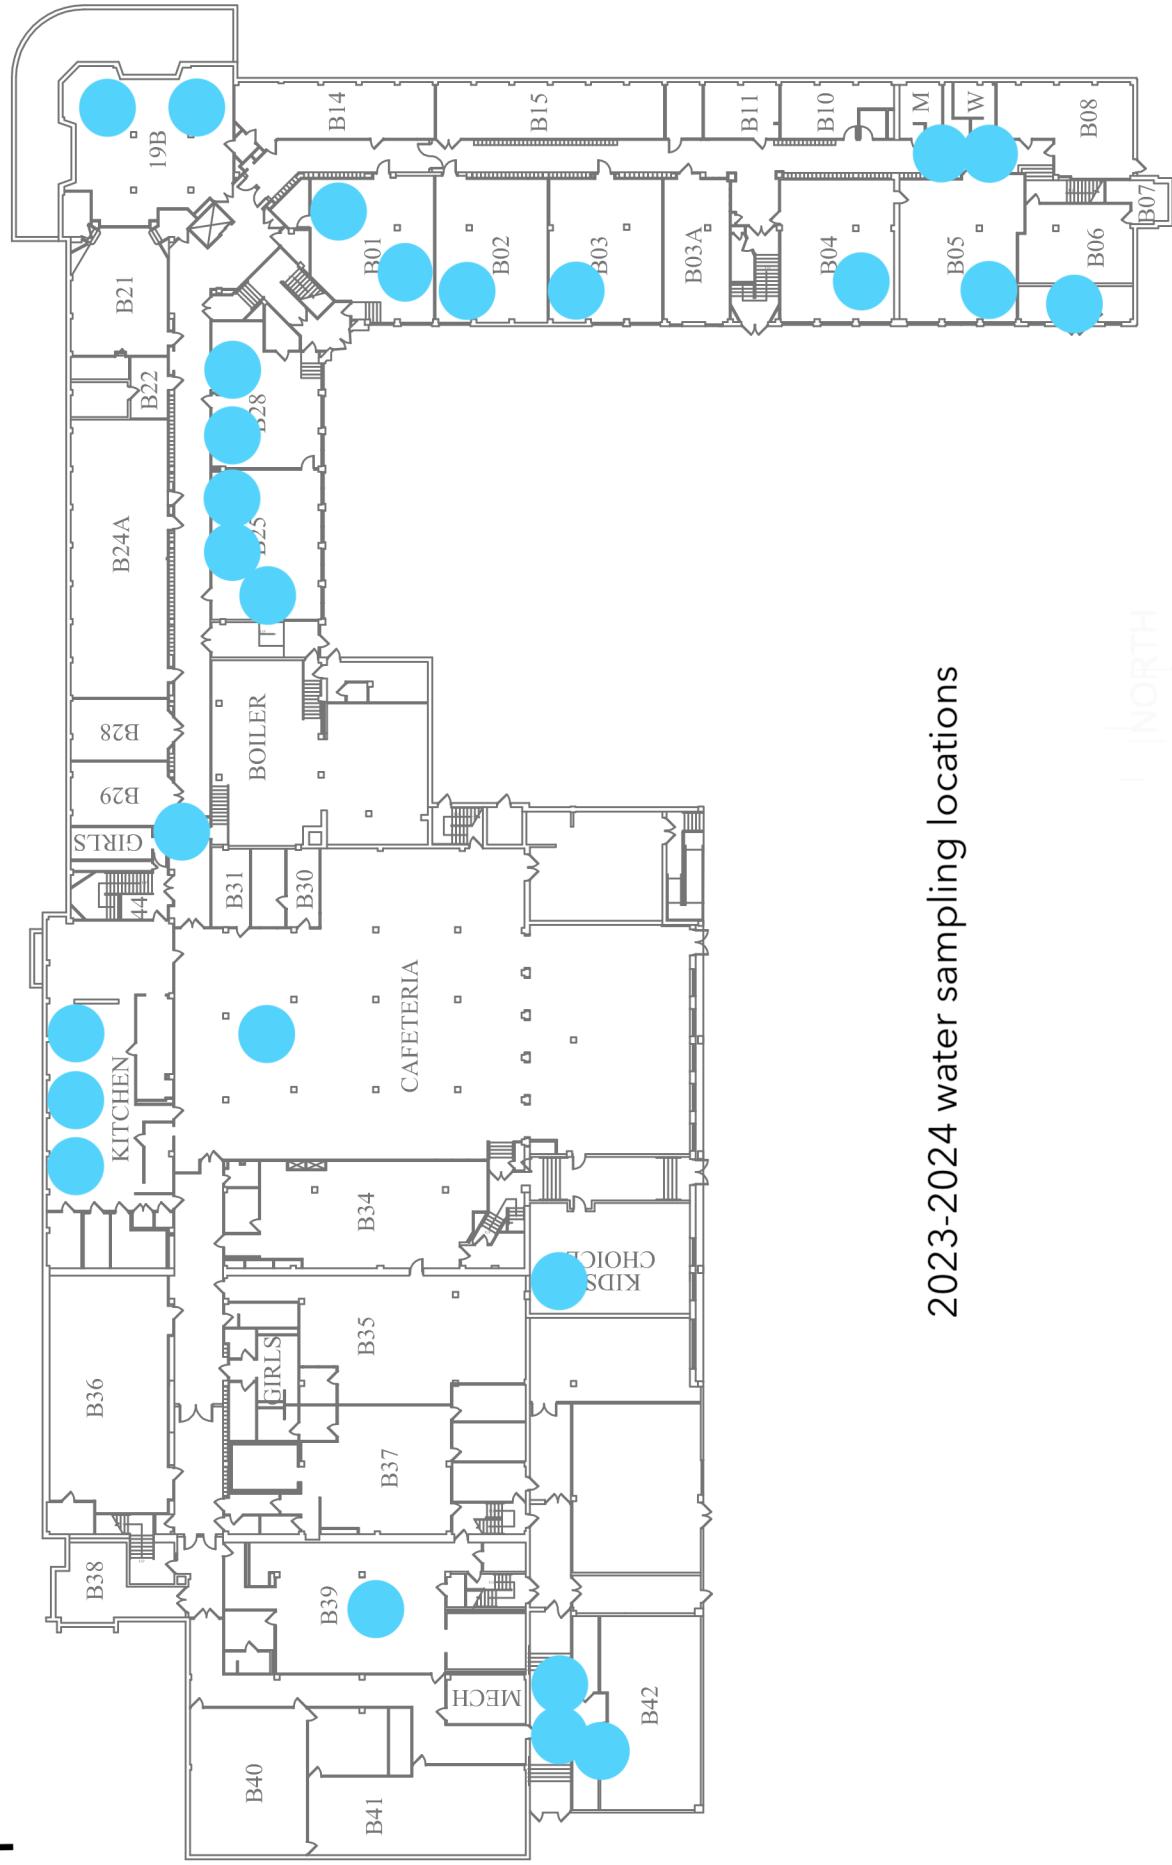

2023-2024 water sampling locations

Lincoln Center Elementary
357 9th Avenue North
South St. Paul, MN 55075

Basement Floor Plan 2021

South St. Paul
Public Schools

EVACUATION AND
EMERGENCY SHELTER
LEVEL



67-15

Twin City Water Clinic Laboratory Test Report

Client: South St. Paul High School Meridian Consulting Address: 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-03067 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 6/1/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077
Laboratory Sample ID Sample Analyte Location	Parameter Sample Collection Date Time Sample Analysis Test	Results Units
23-03067 Lead Kitchen Sink South	Drinking Water 3/30/2023 06:00 05/25/23 13:10	3.31 µg/L
23-03068 Lead Kitchen Sprayer	Drinking Water 3/30/2023 06:00 05/25/23 13:28	2.09 µg/L
23-03069 Lead Kitchen Kettle	Drinking Water 3/30/2023 06:00 05/25/23 13:46	<2.0 µg/L
23-03070 Lead Girls Locker Room WF	Drinking Water 3/30/2023 06:00 05/25/23 13:52	<2.0 µg/L
23-03071 Lead Boys Locker Room WF	Drinking Water 3/30/2023 06:00 05/25/23 13:58	<2.0 µg/L
23-03072 Lead A017 Training Room Sink	Drinking Water 3/30/2023 06:00 05/25/23 14:03	<2.0 µg/L
23-03073 Lead PAC WF Left	Drinking Water 3/30/2023 06:00 05/25/23 14:09	<2.0 µg/L
23-03074 Lead PAC VWF Right	Drinking Water 3/30/2023 06:00 05/25/23 14:15	<2.0 µg/L
23-03075 Lead STEM Left WF Left	Drinking Water 3/30/2023 06:00 05/25/23 14:21	<2.0 µg/L
23-03076 Lead STEM Left WF Right	Drinking Water 3/30/2023 06:00 05/25/23 14:27	<2.0 µg/L
23-03077 Lead STEM Left BF	Drinking Water 3/30/2023 06:00 05/25/23 14:33	<2.0 µg/L
23-03078 Lead STEM Right WF Left	Drinking Water 3/30/2023 06:00 05/25/23 14:51	<2.0 µg/L
23-03079 Lead STEM Right WF Right	Drinking Water 3/30/2023 06:00 05/25/23 15:10	<2.0 µg/L
23-03080 Lead STEM Right BF	Drinking Water 3/30/2023 06:00 05/25/23 15:16	<2.0 µg/L
23-03081 Lead A176 Sink	Drinking Water 3/30/2023 06:00 05/25/23 15:22	2.77 µg/L
23-03082 Lead A120 Sink	Drinking Water 3/30/2023 06:00 05/25/23 15:28	<2.0 µg/L
23-03083 Lead A149 North Left Sink	Drinking Water 3/30/2023 06:00 05/25/23 15:34	4.32 µg/L
23-03084 Lead A149 North Right Sink	Drinking Water 3/30/2023 06:00 05/25/23 15:40	2.51 µg/L
23-03085 Lead A149 East North Sink	Drinking Water 3/30/2023 06:00 05/25/23 15:46	4.20 µg/L
23-03086 Lead A149 East Center L Sink	Drinking Water 3/30/2023 06:00 05/25/23 15:52	4.30 µg/L

Minnesota State Laboratory ID# 027-053-119
 Wisconsin State Laboratory ID# 105-10117
 Wisconsin DNR Lab ID #399073400

X No samples were subcontracted; or the above test results(s) with ** designation were produced by a subcontracted laboratory. [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.

Approved methods used in analyzing the samples listed above have the following reporting levels:
 SM3113 - Lead, 2.0 µg/L
 Maximum contaminant level: Lead, 15.0 µg/L
 Sample Collected by: Client TCWC
 Sample Temp.: 11° C
 Notes:

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Bill Van Arsdale
 Bill Van Arsdale
 Laboratory Manager

Twin City Water Clinic Laboratory Test Report

Client: South St. Paul High School Meridian Consulting Address: 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-03087 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 6/1/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077
Laboratory Sample ID Sample Analyte Location	Parameter Sample Collection Date Time Date Time Test Results Units	Approved methods used in analyzing the samples listed above have the following reporting levels: X No samples were subcontracted; or the above test results(s) with ** designation were produced by a subcontracted laboratory. [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed. SM3113 - Lead, 2.0 µg/L Maximum contaminant level: Lead, 15.0 µg/L
23-03087 Lead A149 East Center Right Sink Drinking Water	3/30/2023 06:00 05/25/23 15:58 3.86 µg/L	
23-03088 Lead A149 East South Sink Drinking Water	3/30/2023 06:00 05/30/23 11:03 2.99 µg/L	
23-03089 Lead A149 West Sink Drinking Water	3/30/2023 06:00 05/30/23 11:09 3.14 µg/L	
23-03090 Lead A141 Sink Drinking Water	3/30/2023 06:00 05/30/23 11:15 <2.0 µg/L	
23-03091 Lead Teacher Lounge Sink Drinking Water	3/30/2023 06:00 05/30/23 11:21 <2.0 µg/L	Sample Collected by: <input checked="" type="checkbox"/> Client <input type="checkbox"/> TCWC
23-03092 Lead Teacher Lounge Filter Sink Drinking Water	3/30/2023 06:00 05/30/23 11:27 <2.0 µg/L	
23-03093 Lead Health Office Sink Drinking Water	3/30/2023 06:00 05/30/23 11:33 <2.0 µg/L	Sample Temp.: 11° C
23-03094 Lead WF Left by School Store Drinking Water	3/30/2023 06:00 05/30/23 11:51 <2.0 µg/L	
23-03095 Lead WF Right by school Store Drinking Water	3/30/2023 06:00 05/30/23 12:09 <2.0 µg/L	
23-03096 Lead BF by School Store Drinking Water	3/30/2023 06:00 05/30/23 12:16 <2.0 µg/L	Notes:
23-03097 Lead Cafeteria WF Drinking Water	3/30/2023 06:00 05/30/23 12:22 <2.0 µg/L	
23-03098 Lead WF by B121A Left Left Drinking Water	3/30/2023 06:00 05/30/23 12:27 <2.0 µg/L	
23-03099 Lead WF by B121A Left Right Drinking Water	3/30/2023 06:00 05/30/23 12:33 <2.0 µg/L	Discussion: BF = Bottle Filler, WF = Water Fountain
23-03100 Lead BF by B121A Left Drinking Water	3/30/2023 06:00 05/30/23 12:39 <2.0 µg/L	
23-03101 Lead WF by B121A Right Left Drinking Water	3/30/2023 06:00 05/30/23 12:45 <2.0 µg/L	
23-03102 Lead WF by B121A Right Right Drinking Water	3/30/2023 06:00 05/30/23 12:51 <2.0 µg/L	
23-03103 Lead BF by B121A Right Drinking Water	3/30/2023 06:00 05/30/23 12:57 <2.0 µg/L	Approved By: <i>Bill Van Arsdale</i>
23-03104 Lead Print Shop Sink Drinking Water	3/30/2023 06:00 05/30/23 13:15 <2.0 µg/L	Laboratory Manager
23-03105 Lead WF Left by Concessions Drinking Water	3/30/2023 06:00 05/30/23 13:33 <2.0 µg/L	
23-03106 Lead WF Right by Concessions Drinking Water	3/30/2023 06:00 05/30/23 13:39 <2.0 µg/L	

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

Twin City Water Clinic Laboratory Test Report

Client: South St. Paul High School Meridian Consulting Address: 16620 - 61st Ave N Plymouth, MN 55446	Report Number: 23-03107 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 6/1/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077
Laboratory Sample ID Analyte Sample Location Parameter Sample Collection Date Time Sample Analysis Date Time Results Units	Report Number: 23-03107 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 6/1/23	Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556 Fax: (952)935-5077
23-03107 Lead Concessions Sink Drinking Water 3/30/2023 06:00 05/30/23 13:45 3.75 µg/L	Approved methods used in analyzing the samples listed above have the following reporting levels: SM3113 - Lead, 2.0 µg / L Maximum contaminant level: Lead, 15.0 µg/L	Approved methods used in analyzing the samples listed above have the following reporting levels: SM3113 - Lead, 2.0 µg / L Maximum contaminant level: Lead, 15.0 µg/L
23-03108 Lead WF Hallway by Wrestling Comp Gym WF South Drinking Water 3/30/2023 06:00 05/30/23 13:51 4.90 µg/L		
23-03109 Lead Comp Gym WF North Drinking Water 3/30/2023 06:00 05/30/23 13:57 3.77 µg/L		
23-03110 Lead Comp Gym WF North Drinking Water 3/30/2023 06:00 05/30/23 14:03 2.77 µg/L		
23-03111 Lead Girls Basketball Sink Drinking Water 3/30/2023 06:00 05/30/23 14:09 2.92 µg/L	Sample Collected by: <input checked="" type="checkbox"/> Client <input type="checkbox"/> TCWC	Sample Collected by: <input checked="" type="checkbox"/> Client <input type="checkbox"/> TCWC
23-03112 Lead Girls Locker Room WF Drinking Water 3/30/2023 06:00 05/30/23 14:15 <2.0 µg/L		
23-03113 Lead Wrestling Room WF Drinking Water 3/30/2023 06:00 05/30/23 14:21 3.17 µg/L	Sample Temp.: 11° C	
23-03114 Lead Boys Locker Room WF Drinking Water 3/30/2023 06:00 05/30/23 14:39 <2.0 µg/L		
23-03115 Lead B301 Center Island Sink Drinking Water 3/30/2023 06:00 05/30/23 14:57 3.57 µg/L		
23-03116 Lead B301 South Sink Drinking Water 3/30/2023 06:00 05/30/23 15:03 2.44 µg/L	Notes:	
23-03117 Lead WF by B319 Drinking Water 3/30/2023 06:00 05/30/23 15:09 <2.0 µg/L		
23-03118 Lead WF by B312 Drinking Water 3/30/2023 06:00 05/30/23 15:16 <2.0 µg/L		
23-03119 Lead BF by B312 Drinking Water 3/30/2023 06:00 05/30/23 15:22 <2.0 µg/L		
23-03120 Lead WF by B323 Left Drinking Water 3/30/2023 06:00 05/30/23 15:28 <2.0 µg/L		
23-03121 Lead WF by B323 Right Drinking Water 3/30/2023 06:00 05/30/23 15:34 <2.0 µg/L		
23-03122 Lead BF by B323 Drinking Water 3/30/2023 06:00 05/30/23 15:40 <2.0 µg/L		
23-03123 Lead B327 Sink Drinking Water 3/30/2023 06:00 05/30/23 15:46 <2.0 µg/L	Approved By: 	Approved By: Bill Van Arsdale Laboratory Manager
23-03124 Lead WF by B223 Left Drinking Water 3/30/2023 06:00 06/01/23 10:26 <2.0 µg/L		
23-03125 Lead WF by B223 Right Drinking Water 3/30/2023 06:00 06/01/23 10:32 <2.0 µg/L		
23-03126 Lead BF by B223 Drinking Water 3/30/2023 06:00 06/01/23 10:38 <2.0 µg/L		


The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.


Twin City Water Clinic Laboratory Test Report

Twin City Water Clinic Laboratory Test Report						
			<p>Minnesota State Laboratory ID# 027-053-119 Wisconsin State Laboratory ID# 105-10117 Wisconsin DNR Lab ID #3399073400</p> <p>Twin City Water Clinic Inc. 617 13th Avenue South Hopkins, MN 55343 Phone: (952)935-3556</p> <p>Report Number: 23-03127 Sample Receipt Date: 3/30/23 Sample Prep. Date: 3/30/23 Sample Prep. Time: 12:00 Report Issue Date: 6/1/23 Fax: (952)935-5077</p>			
Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test
Sample ID		Location	Date	Date	Time	Results
23-03127	Lead	B227 Sink	3/30/2023	06:00	06/01/23 10:44	<2.0 µg/L
23-03128	Lead	WF by B219	3/30/2023	06:00	06/01/23 10:50	2.08 µg/L
23-03129	Lead	WF by B212	3/30/2023	06:00	06/01/23 10:56	<2.0 µg/L
23-03130	Lead	BF by B212	3/30/2023	06:00	06/01/23 11:02	<2.0 µg/L

The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.



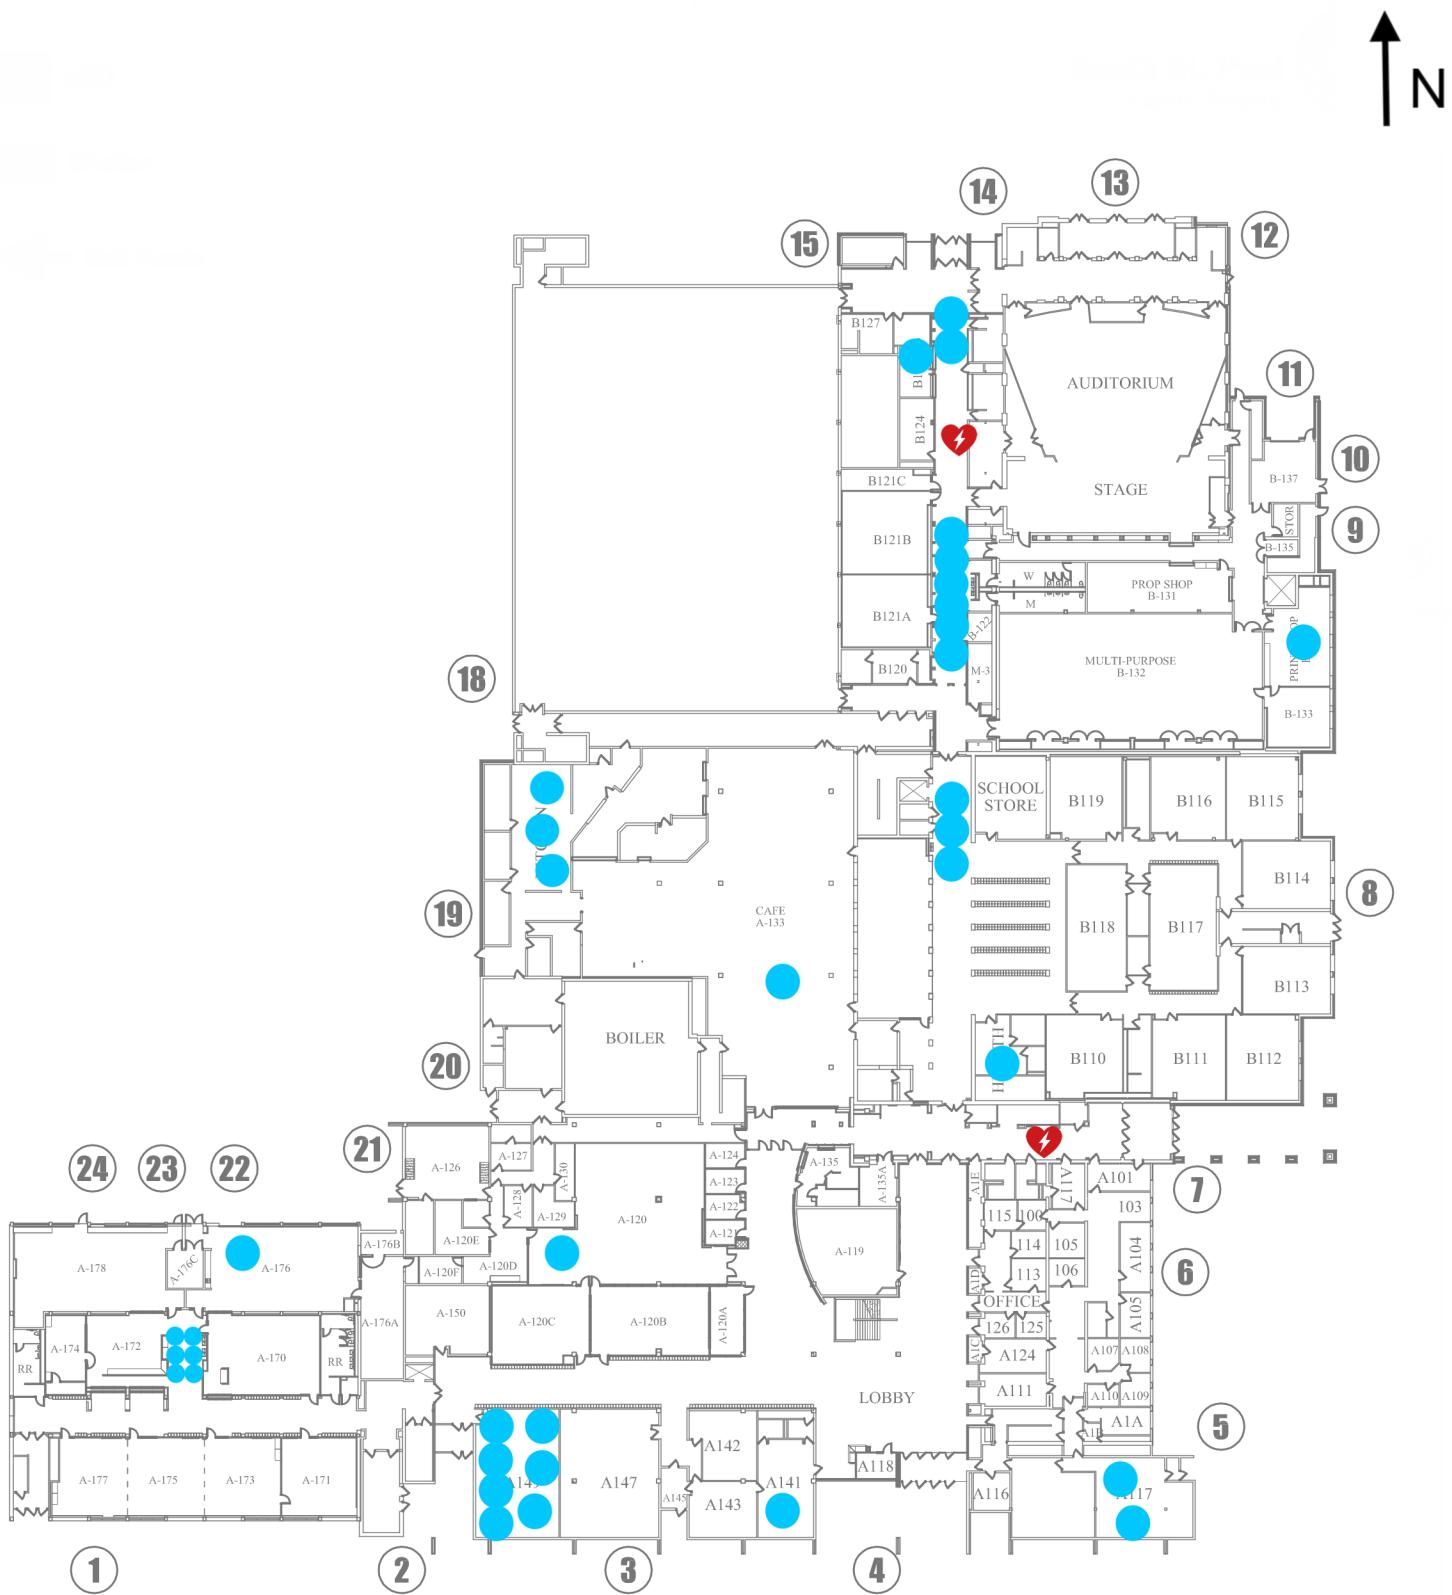

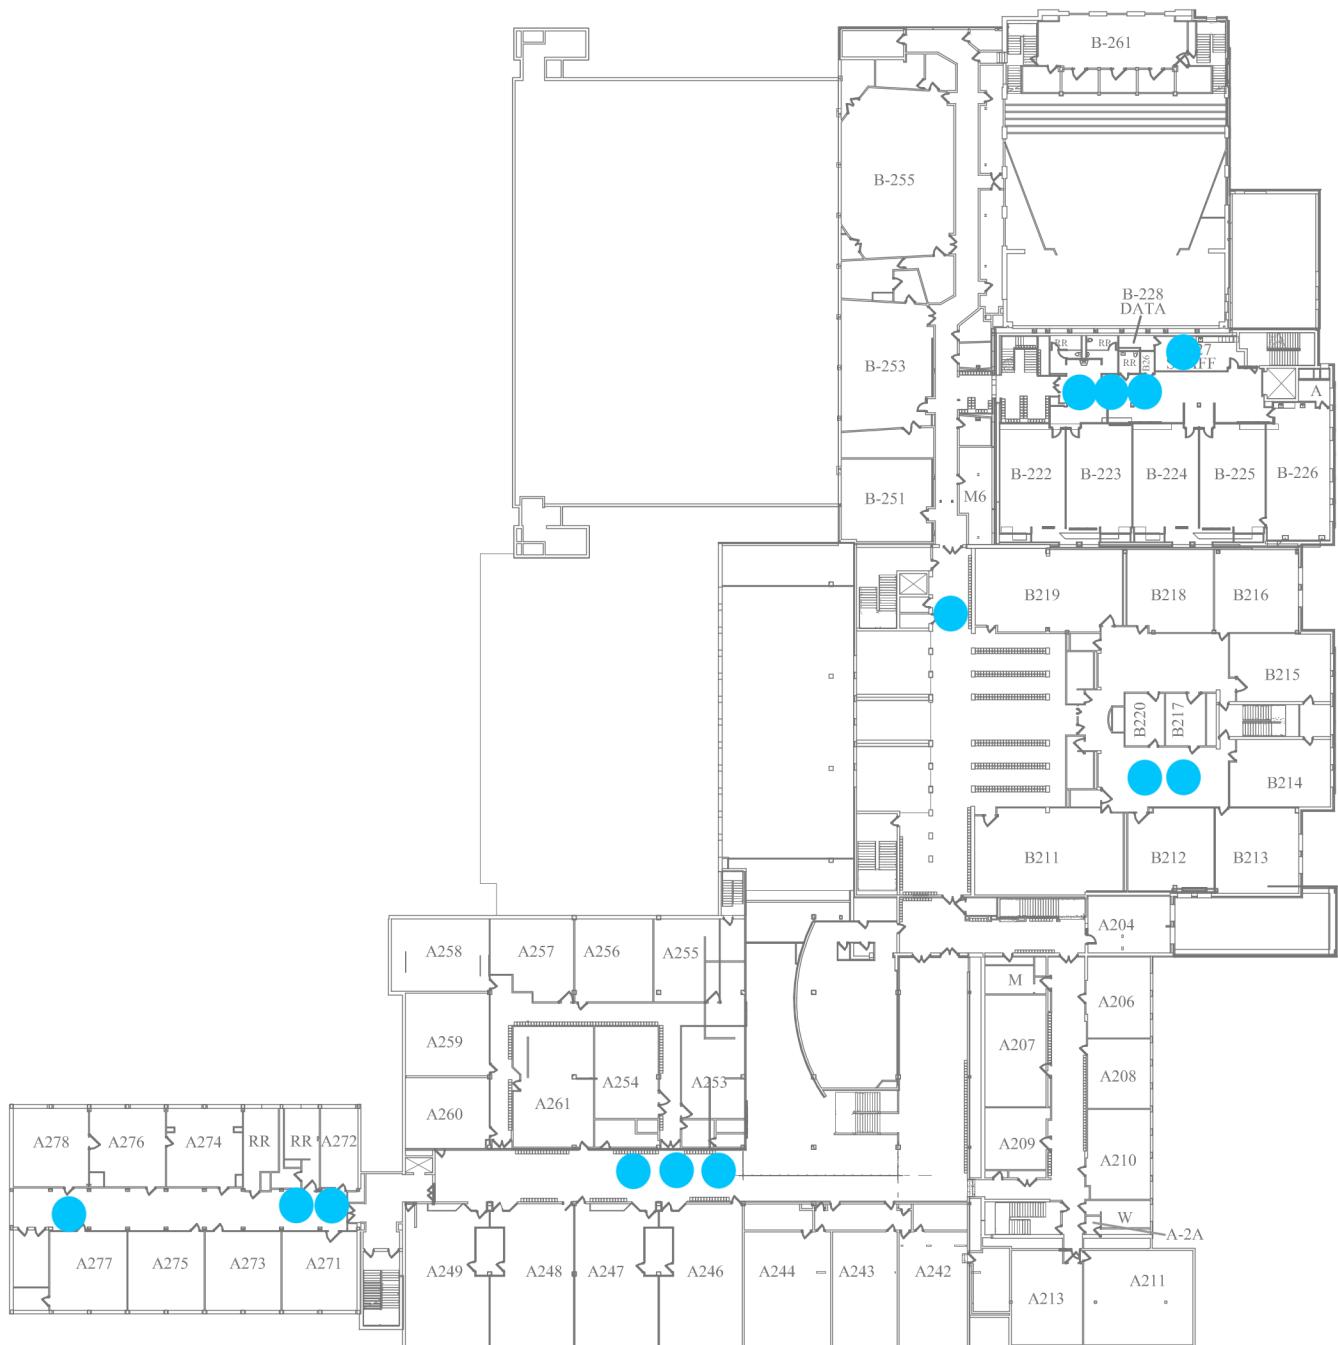

↑ N



South St. Paul Secondary
700 2nd Street North
South St. Paul, MN 55075

Third Level Floor Plan


2021



N



South St. Paul
Public Schools

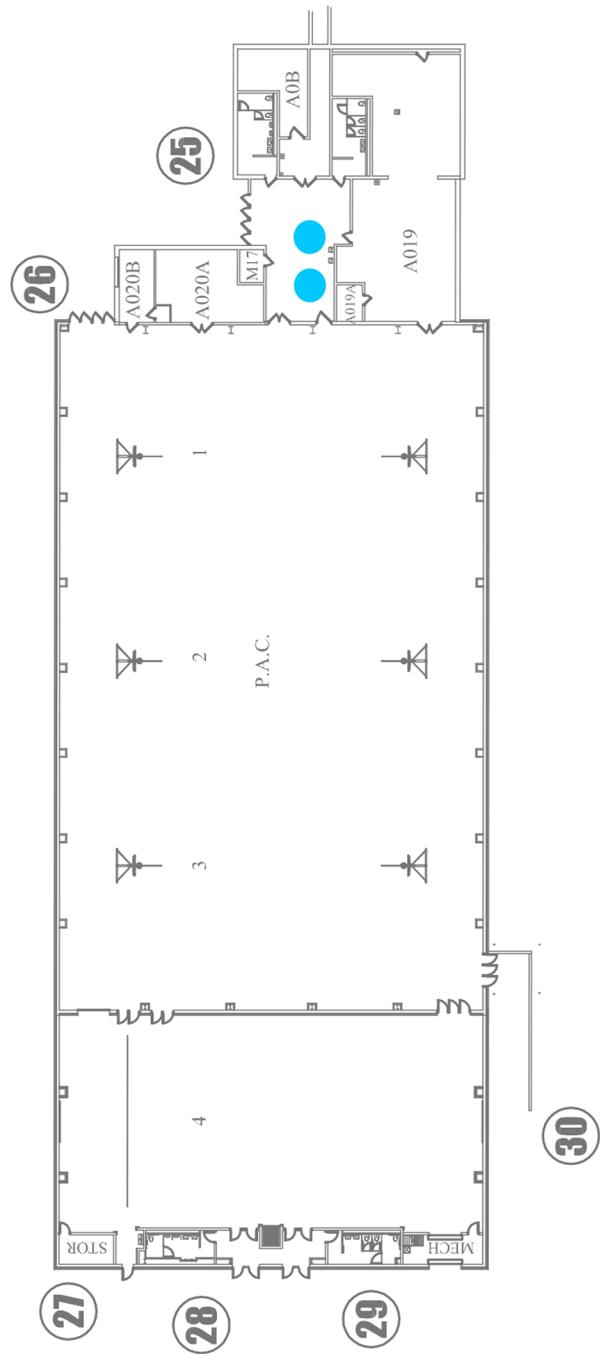

South St. Paul Secondary
700 2nd Street North
South St. Paul, MN 55075

Ground Level Floor Plan
2021

Twin City Water Clinic Laboratory Test Report

Minnesota State Laboratory ID# 027-053-119
 Wisconsin State Laboratory ID# 105-10117
 Wisconsin DNR Lab ID #339073400

Client: South St. Paul Schools,
SSPEC
 Meridian Consulting
Address: 16620 - 61st Ave N
 Plymouth, MN 55446

Report Number: 23-02649 **Sample Receipt Date:** 3/22/23
Sample Prep. Date: 3/22/23 **Sample Prep. Time:** 14:20
Report Issue Date: 4/20/23 **Phone:** (952)935-3556
Fax: (952)935-5077

X No samples were subcontracted; or the above test result(s) with ** designation were produced by a subcontracted laboratory.
 [Laboratory name; address; MDH Lab ID#]. The subcontracted laboratory maintains MDH Certification for the field(s) of testing performed.

Laboratory	Analyte	Sample	Parameter	Sample Collection	Sample Analysis	Test	Approved methods used in analyzing the samples listed above have the following reporting levels:
Sample ID		Location		Date	Date	Results	Units
23-02649	Lead	WF near kitchen	Drinking Water	3/16/2023	06:00	04/18/23 14:24	4.60 µg/L
23-02650	Lead	Kitchen Sink - L	Drinking Water	3/16/2023	06:00	04/18/23 14:30	<2.0 µg/L
23-02651	Lead	Kitchen Sink - R	Drinking Water	3/16/2023	06:00	04/18/23 14:36	<2.0 µg/L
23-02652	Lead	WF near A305 - L	Drinking Water	3/16/2023	06:00	04/18/23 14:42	<2.0 µg/L
23-02653	Lead	WF near A305 - R	Drinking Water	3/16/2023	06:00	04/20/23 10:58	<2.0 µg/L
23-02654	Lead	BF near A 305	Drinking Water	3/16/2023	06:00	04/20/23 11:04	<2.0 µg/L
23-02655	Lead	WF near A207 L	Drinking Water	3/16/2023	06:00	04/20/23 11:10	<2.0 µg/L
23-02656	Lead	WF near A207 R	Drinking Water	3/16/2023	06:00	04/20/23 11:16	<2.0 µg/L
23-02657	Lead	BF near A207	Drinking Water	3/16/2023	06:00	04/20/23 11:34	<2.0 µg/L
23-02658	Lead	A203 Sink	Drinking Water	3/16/2023	06:00	04/20/23 11:52	<2.0 µg/L
23-02659	Lead	A207 Sink	Drinking Water	3/16/2023	06:00	04/20/23 11:58	3.79 µg/L
23-02660	Lead	Health Office Sink	Drinking Water	3/16/2023	06:00	04/20/23 12:04	2.11 µg/L
23-02661	Lead	Lobby WF 2nd Floor	Drinking Water	3/16/2023	06:00	04/20/23 12:10	4.40 µg/L
23-02662	Lead	Lobby BF 2nd Floor	Drinking Water	3/16/2023	06:00	04/20/23 12:16	4.60 µg/L
23-02663	Lead	Lobby WF 1st Floor	Drinking Water	3/16/2023	06:00	04/20/23 12:22	<2.0 µg/L
23-02664	Lead	Lobby BF 1st Floor	Drinking Water	3/16/2023	06:00	04/20/23 12:28	4.66 µg/L
23-02665	Lead	A107 Sink	Drinking Water	3/16/2023	06:00	04/20/23 12:34	4.92 µg/L

Discussion: WF = Water Fountain, BF = Bottle Filler, L = Left, R = Right


Approved By:


 Bill Van Arsdale
 Laboratory Manager


The results listed in this report apply only to the above listed samples. All routine quality assurance procedures were followed, unless otherwise noted. This analytical report must be reported in its entirety. All methods are certified by the Minnesota Department of Health, unless otherwise noted.

South St. Paul Education Center—710 19th Avenue North

First Floor

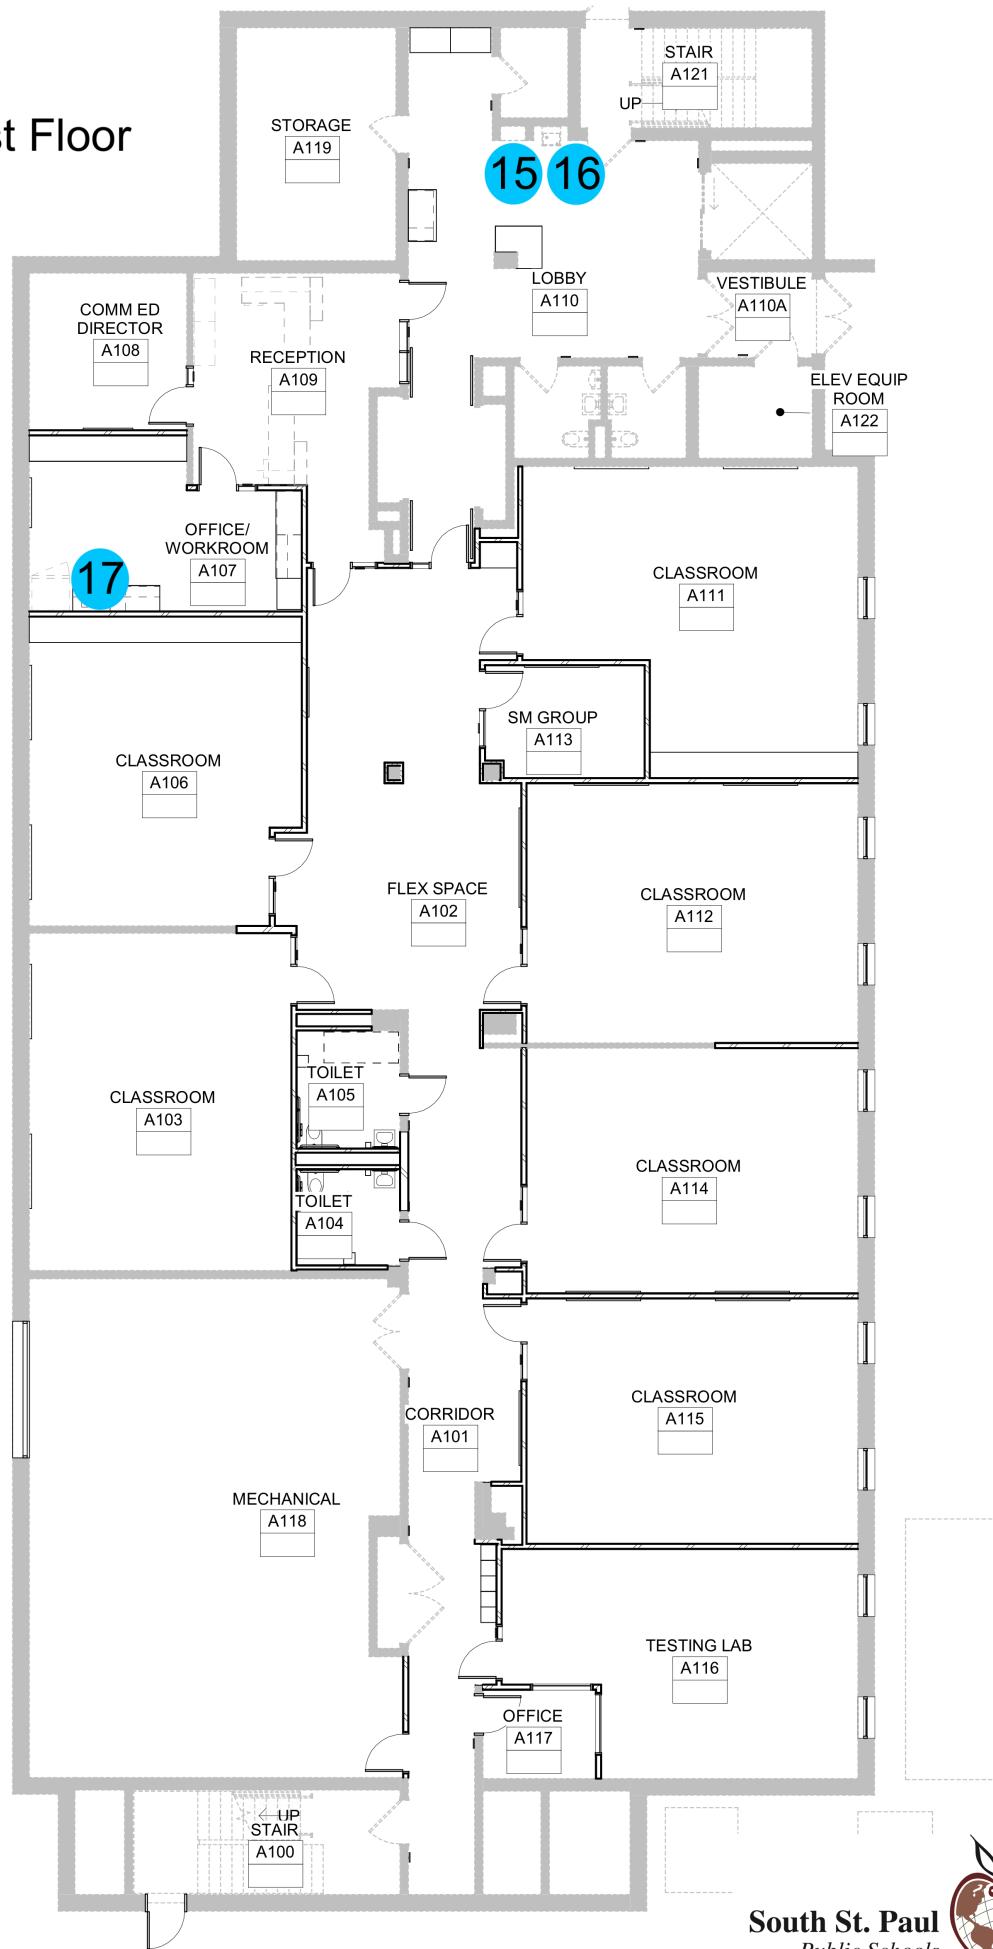


Water Sampling Locations March 2023

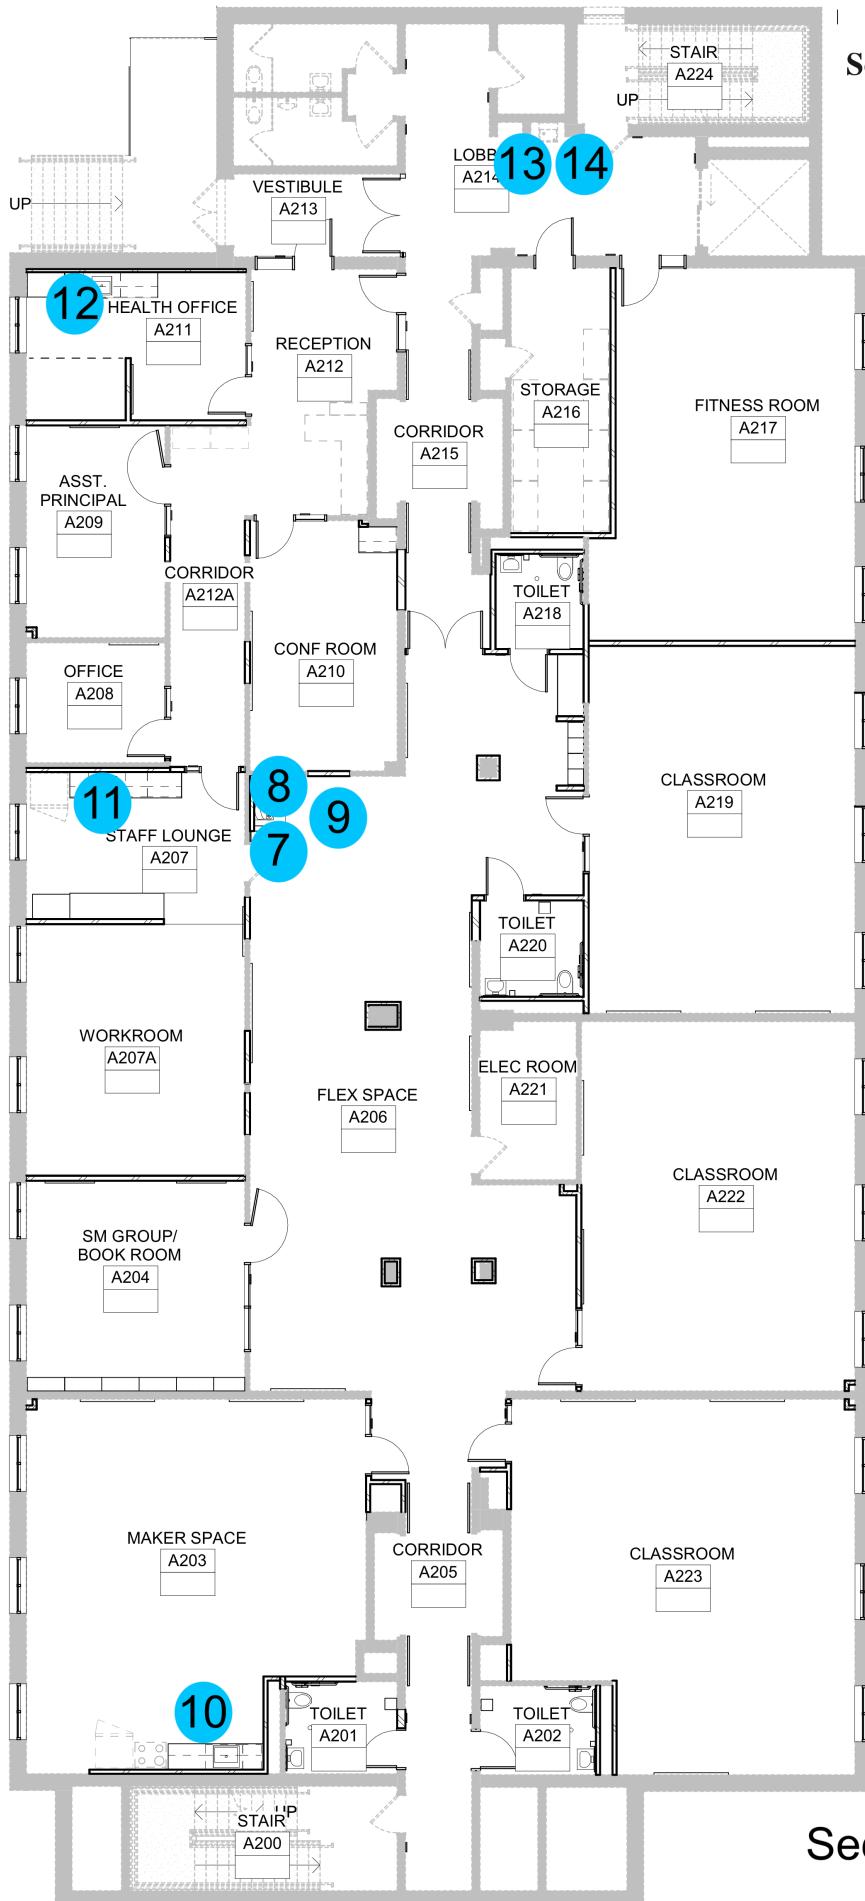

Second Floor

South St. Paul Education Center—710 19th Avenue North

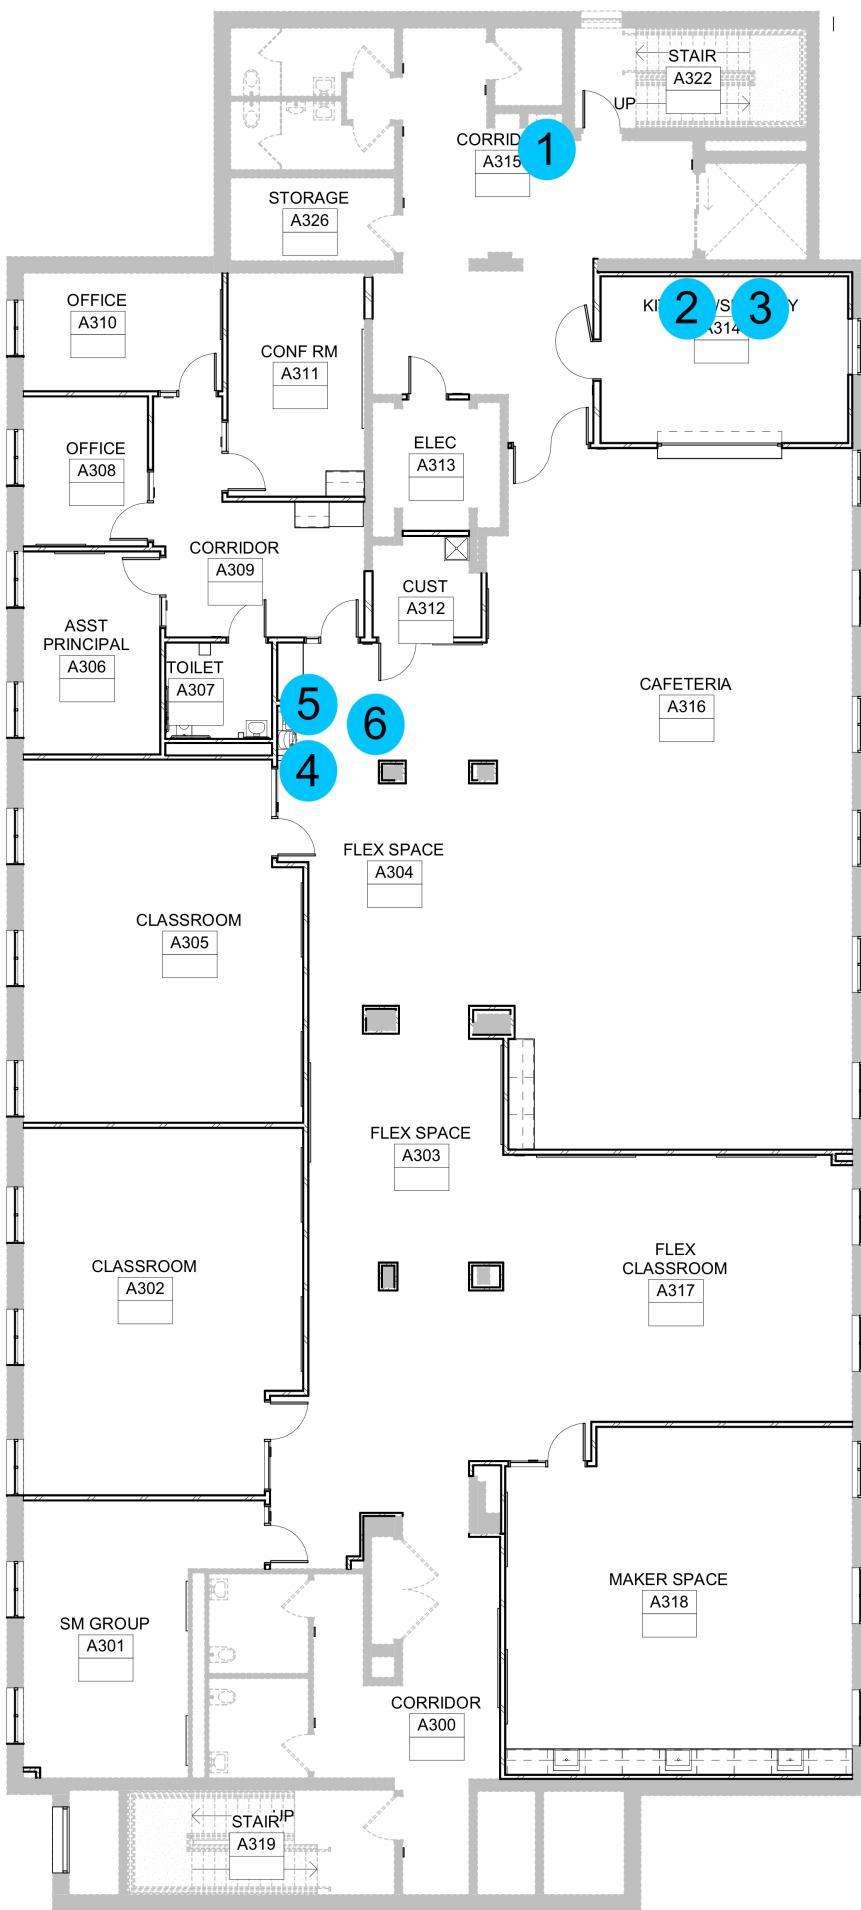

Third Floor

South St. Paul
Public Schools

