



BEDFORD CENTRAL SCHOOL DISTRICT
FOX LANE CAMPUS
P.O. BOX 180
MOUNT KISCO, NY 10549

LEAD WATER TESTING

For

Fox Lane Middle School
Fox Lane Campus
Mount Kisco, NY 10549

Date of Assessment: October 15, 2016

Date of Report: November 9, 2016

Completed By: Justin Joe, PhD, CSP
Industrial Hygienist / Building Inspector
BNF Consulting, Inc.
152 Route 202, #404
Lincolndale, NY 10540
bnfjustin@gmail.com

EXECUTIVE SUMMARY

On October 15, 2016, lead water testing was completed for Fox Lane Middle School (FLMS), one of the Bedford Central School District (BCSD) schools, located at Fox Lane Campus, Mount Kisco, NY 10549. Primarily assisting in the completion of this study were Mr. Gregory Sullivan, Interim Assistant Superintendent; Mr. Shawn Pitulle, Interim Director of Buildings and Grounds; and the maintenance staff in FLMS.

The purpose of this survey is to comply to 10 NYCRR SUBPART 67-4: Lead Testing in School Drinking Water. This subpart requires all school districts and boards of cooperative education services, including those already classified as a public water system under 10 NYCRR Subpart 5-1, to test portable water for lead contamination and to develop and implement a lead remediation plan, when applicable. Action Level used in the Subpart means 15 micrograms per liter ($\mu\text{g/L}$) or parts per billion (ppb). Exceedance of the action level requires a response to implement a lead remediation plan.

First-draw water samples were collected from all available water outlets including faucets, sinks and water fountains in and around the building. These areas included classrooms, restrooms, hallways, the kitchen, custodial closets, the boiler room, and the exterior. The sampled water was motionless in the pipes for a minimum of 8 hours, but not more than 18 hours, before the sample collection according to the guideline from the Subpart. The first-draw samples were collected from a cold water outlet before any water was used. The samples were sent to Phoenix Environmental Laboratories, Inc., which is approved to perform lead analyses by the Department's Environmental Laboratory Approval Program (ELAP#: 11715).

Lab results indicate that:

- 6 out of 174 water outlets were above the action level.
- No water fountain and kitchen sinks were above the action level.
- The following water outlets are listed as being above the action level:
 1. Sink in gym 104 (Left)
 2. Exterior gym front (West) (See the floor plan)
 3. Exterior S-House (Right) (See the floor plan)
 4. Exterior W-House (Left) (See the floor plan)
 5. Exterior W-House (Right)
 6. Sink in Rm C-118

RECOMMENDATIONS

The following is a recommendation from this survey.

- 2016-10-01 Install carbon filters to reduce the lead content from the water outlet fixtures tested above the action level, or the allowable limits.
- 2016-10-02 Check for plumbing work. If copper pipes are joined with lead solder that has been installed, notify a qualified plumber to replace the lead solder with lead-free solder. Lead solder looks dull gray and when scratched with a key, looks shiny.
- 2016-10-03 Check type of piping used to connect to water main. Determine whether or not the service line that connects the building to the water line is made of lead.

CONCLUSION

This survey revealed that most of the lead testing from water source fixtures indicated low or non-detectable exposures. However, 6 out of 174 samples were above the Action Level, 15 micrograms per liter ($\mu\text{g/L}$) or parts per billion (ppb), listed in the report. No water fountains or kitchen sinks were above the action level.

The recommendations in this report are intended to achieve the goal of a safer and more healthful environment. If the recommendations are completed, future health issues should be prevented.

If there are any questions regarding the contents of this report or further assistance is needed for recommendation completion, please feel free to contact Dr. Justin Joe, who can be reached via the following:

Justin H. Joe, PhD, CSP
BNF Consulting, Inc.
152 Route 202, #404
Lincolndale, NY 10540
bnfjustin@gmail.com

A closing Thank You is extended to all who assisted or participated in completion of this Survey.

The information, suggestions and recommendations contained herein are for general informational purposes only. This information has been compiled from sources believed to be reliable. No warranty, guarantee, or representation, either expressed or implied, is made as to the correctness or sufficiency of any representation contained herein. This information should not be construed as business, risk management, or legal advice or legal opinion.

APPENDIX A

LEAD WATER TESTING LAB RESULTS



Monday, November 07, 2016

Attn: Justin Joe
BNF Consulting
152 Route 202 #404
Lincolndale, NY 10540-0404

Project ID: FOX LANE MIDDLE SCHOOL
Sample ID#s: BV54075 - BV54146

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

If you have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext. 200.

Sincerely yours,

A handwritten signature in black ink that reads "Phyllis Shiller". The signature is written in a cursive style with a large initial "P".

Phyllis Shiller
Laboratory Director

NELAC - #NY11301
CT Lab Registration #PH-0618
MA Lab Registration #MA-CT-007
ME Lab Registration #CT-007
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003
NY Lab Registration #11301
PA Lab Registration #68-03530
RI Lab Registration #63
VT Lab Registration #VT11301



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 7:55
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54075

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 571 KITCHEN SINK RIGHT SIDE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 7:55
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54076

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 572 KITCHEN STEAMER

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:00
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54077

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 573 FACULTY LUNCHROOM

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:02
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54078

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 574 GIRLS BATHROOM CAFETERIA LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0127	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:02
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54079

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 575 GIRLS BATHROOM CAFETERIA RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:04
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54080

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 576 BOYS BATHROOM LIBRARY LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0013	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:04
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54081

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 577 GIRLS BATHROOM CAFETERIA RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:04
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54082

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 578 BOYS BATHROOM LIBRARY MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0012	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:04
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54083

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 579 BOYS BATHROOM LIBRARY MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:04
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54084

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 580 BOYS BATHROOM LIBRARY RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0021	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:09
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54085

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 581 WF LIBRARY

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:10
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54086

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 582 LIBRARY BATHROOM

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:11
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54087

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 583 LIBRARY SINK

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

8:17
 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54088

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 584 WF BY E-202

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:17
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54089

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 585 CUSTODIAL CLOSET BY E-204

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:19
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54090

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 586 BOYS BATHROOM BY E-206 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0021	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:19
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54091

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 587 BOYS BATHROOM BY E-206 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:21
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54092

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 588 E-206 STAFF BATHROOM

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0014	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:21
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54093

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 589 GIRLS BATHROOM BY E206 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0017	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:24
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54094

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 590 WF BY E-212 HIGH

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:24
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54095

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 591 WF BY E-212 LOW

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:29
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54096

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 592 WF E-HOUSE LOBBY

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0030	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:29
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54097

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 593 CUSTODAIL CLOSET E-HOUSE LOBBY

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0036	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:30
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54098

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 594 RM E-109

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0020	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:30
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54099

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 595 RM E-110

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0022	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:31
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54100

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 596 RM E113 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0029	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:31
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54101

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 597 RM E-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0012	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

8:31
 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54102

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 598 RM E-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0015	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:31
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54103

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 599 RM E-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0020	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:31
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54104

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 600 RM E-113 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:32
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54105

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 601 RM E-113A

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0044	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:34
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54106

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 602 RM E-114 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0031	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:34
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54107

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 603 RM E -114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0021	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:34
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54108

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 604 RM E-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0023	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:34
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54109

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 605 RM E-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0030	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:34
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54110

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 606 RM E-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0025	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:34
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54111

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 607 RM E 114 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0024	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

8:40
 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54112

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 608 GYM 123 BOYS COACH OFFICE 1ST FL

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:40
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54113

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 609 GYM 123 WF BOYS LOCKER RM

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0012	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:40
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54114

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 610 GYM 123 BOYS LOCKER ROOM SINK LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0020	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:40
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54115

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 611 GYM 123 BOYS LOCKER ROOM SINK RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0012	0.0010	1	mg/L	0.015			11/04/16	TH	E200.5
Total Metal Digestion	Completed							10/21/16	CB/G/CB	E200.5/E200.7

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:45
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54116

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 612 GYM 121 BOYS BATHROOM LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0029	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:04
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54117

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 613 GYM 121 BOYS BATHROOM RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:04
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54118

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 614 GYM 113 CUSTODIAL CLOSET

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:09
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54119

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 615 GYM 104 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.945	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
*** Lead exceeds Action Level of 0.015 ***										
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:10
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54120

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 616 GYM 104 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:11
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54121

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 617 GYM 109

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:17
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54122

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 618 GYM 100 WF

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:17
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54123

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 619 GYM 100 SINK LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:19
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54124

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 620 GYM 100 SINK RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0018	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:19
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54125

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 621 GYM 2ND FL WF BY STAIRS EAST

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0018	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

8:21
 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54126

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 622 CUSTODIAL CLOSET GYM 2ND FL

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0072	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:21
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54127

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 623 GYM 2ND FL WF BY STAIRS WEST

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0010	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:24
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54128

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 624 GYM GROUND WF

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0047	0.0010	1	mg/L	0.015			10/22/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

8:24
 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54129

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 625 EXTERIOR GYM FRONT WEST

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.176	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
*** Lead exceeds Action Level of 0.015 ***										
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:29
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54130

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 626 CAFETERIA BASEMENT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0014	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:29
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54131

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 627 EXTERIOR E-HOUSE RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0136	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:30
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54132

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 628 EXTERIOR E-HOUSE LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0020	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:30
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54133

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 629 EXTERIOR S-HOUSE RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0170	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
*** Lead exceeds Action Level of 0.015 ***										
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:31
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54134

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 630 EXTERIOR S-HOUSE RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0066	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

8:31
 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54135

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 631EXTERIOR W-HOUSE LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0413	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
*** Lead exceeds Action Level of 0.015 ***										
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:31
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54136

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 632 EXTERIRO W HOUSE RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0406	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
*** Lead exceeds Action Level of 0.015 ***										
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:31
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54137

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 633 EXTERIOR CENTRAL BUILDING LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0060	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:31
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54138

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 634 EXTERIOR CENTRAL BUILDING RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0013	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 6:06
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54139

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 471A RM C-118

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0249	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
*** Lead exceeds Action Level of 0.015 ***										
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:40
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54140

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 611A CUSTODIAL CLOSET IN GYM 123

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0012	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:50
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54141

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 617A GYM 109A

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0099	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 8:57
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54142

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 625A EXTERIOR GYM NORTH SIDE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0088	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 9:15
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54143

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 634A MAINTENANCE LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0117	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 9:10
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54144

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 634B MAINTENANCE LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0026	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 9:17
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54145

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 634C EXTERIOR BY CAFETERIA STAFF ROOM SOUTH

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0101	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 November 07, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 9:20
 10/17/16 16:01

Laboratory Data

SDG ID: GBV54075
 Phoenix ID: BV54146

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 634D EXTERIOR BY CAFETERIA NORTH

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0044	0.0010	1	mg/L	0.015			10/23/16	LK	E200.5
Total Metal Digestion	Completed							10/21/16	AG/RT/AGE200.5/E200.7	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

November 07, 2016

Reviewed and Released by: Kathleen Cressia, QA/QC Officer



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O. Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823



QA/QC Report

November 07, 2016

QA/QC Data

SDG I.D.: GBV54075

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
-----------	-------	-----------	------------------	---------------	------------	----------	-----------	------------	---------	----------	-----------	--------------------	--------------------

QA/QC Batch 363814A (mg/L), QC Sample No: BV53848 (BV54075)

ICP Metals - Aqueous

Lead	BRL	0.0010				88.5			86.3			85 - 115	20
------	-----	--------	--	--	--	------	--	--	------	--	--	----------	----

Comment:

This batch does not include a duplicate.

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 363853 (mg/L), QC Sample No: BV54076 (BV54076, BV54077)

ICP Metals - Aqueous

Lead	BRL	0.0010	<0.0010	<0.0010	NC	93.9			86.8			85 - 115	20
------	-----	--------	---------	---------	----	------	--	--	------	--	--	----------	----

Comment:

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 363815 (mg/L), QC Sample No: BV54078 (BV54078, BV54079, BV54080, BV54081, BV54082, BV54083, BV54084, BV54085)

ICP Metals - Aqueous

Lead	BRL	0.0010	0.0127	0.0120	5.70	97.9			97.3			85 - 115	20
------	-----	--------	--------	--------	------	------	--	--	------	--	--	----------	----

Comment:

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 363815A (mg/L), QC Sample No: BV54086 (BV54086, BV54087, BV54088, BV54089, BV54090, BV54091, BV54092, BV54093, BV54094, BV54095)

ICP Metals - Aqueous

Lead	BRL	0.0010				97.9			97.5			85 - 115	20
------	-----	--------	--	--	--	------	--	--	------	--	--	----------	----

Comment:

This batch does not include a duplicate.

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 363816 (mg/L), QC Sample No: BV54096 (BV54096, BV54097, BV54098, BV54099, BV54100, BV54101, BV54102, BV54103, BV54104, BV54105)

ICP Metals - Aqueous

Lead	BRL	0.0010	0.0030	0.0031	NC	104			98.3			85 - 115	20
------	-----	--------	--------	--------	----	-----	--	--	------	--	--	----------	----

Comment:

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 363816A (mg/L), QC Sample No: BV54106 (BV54106, BV54107, BV54108, BV54109, BV54110, BV54111, BV54112, BV54113, BV54114, BV54115)

ICP Metals - Aqueous

Lead	BRL	0.0010				104			99.3			85 - 115	20
------	-----	--------	--	--	--	-----	--	--	------	--	--	----------	----

Comment:

This batch does not include a duplicate.

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Data

SDG I.D.: GBV54075

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
-----------	-------	-----------	------------------	---------------	------------	----------	-----------	------------	---------	----------	-----------	--------------------	--------------------

QA/QC Batch 363842 (mg/L), QC Sample No: BV54116 (BV54116, BV54117, BV54118, BV54119, BV54120, BV54121, BV54122, BV54123)

ICP Metals - Aqueous

Lead	BRL	0.0010	0.0029	0.0022	NC	97.6			97.3			85 - 115	20
------	-----	--------	--------	--------	----	------	--	--	------	--	--	----------	----

Comment:

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 363842A (mg/L), QC Sample No: BV54124 (BV54124, BV54125, BV54126, BV54127, BV54128)

ICP Metals - Aqueous

Lead	BRL	0.0010				97.6			97.4			85 - 115	20
------	-----	--------	--	--	--	------	--	--	------	--	--	----------	----

Comment:

This batch does not include a duplicate.

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 363843 (mg/L), QC Sample No: BV54129 (BV54129, BV54130, BV54131, BV54132, BV54133, BV54134, BV54135, BV54136, BV54137, BV54138)

ICP Metals - Aqueous

Lead	BRL	0.0010	0.176	0.178	1.10	97.1			96.0			85 - 115	20
------	-----	--------	-------	-------	------	------	--	--	------	--	--	----------	----

Comment:

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

QA/QC Batch 363843A (mg/L), QC Sample No: BV54139 (BV54139, BV54140, BV54141, BV54142, BV54143, BV54144, BV54145, BV54146)

ICP Metals - Aqueous

Lead	BRL	0.0010				97.1			88.8			85 - 115	20
------	-----	--------	--	--	--	------	--	--	------	--	--	----------	----


Comment:

This batch does not include a duplicate.

Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

- RPD - Relative Percent Difference
- LCS - Laboratory Control Sample
- LCSD - Laboratory Control Sample Duplicate
- MS - Matrix Spike
- MS Dup - Matrix Spike Duplicate
- NC - No Criteria
- Intf - Interference


 Phyllis Shiller, Laboratory Director
 November 07, 2016

Sample Criteria Exceedances Report

Criteria: None

GBV54075 - BNFCNSLT

State: NY

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
BV54119	PB-DWICP	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	0.945	0.0010	0.015	0.001	mg/L
BV54119	PB-DWICP	Lead	NY / NY Residential DW / Lead & Copper Als	0.945	0.0010	0.015	0.015	mg/L
BV54129	PB-DWICP	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	0.176	0.0010	0.015	0.001	mg/L
BV54129	PB-DWICP	Lead	NY / NY Residential DW / Lead & Copper Als	0.176	0.0010	0.015	0.015	mg/L
BV54133	PB-DWICP	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	0.0170	0.0010	0.015	0.001	mg/L
BV54133	PB-DWICP	Lead	NY / NY Residential DW / Lead & Copper Als	0.0170	0.0010	0.015	0.015	mg/L
BV54135	PB-DWICP	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	0.0413	0.0010	0.015	0.001	mg/L
BV54135	PB-DWICP	Lead	NY / NY Residential DW / Lead & Copper Als	0.0413	0.0010	0.015	0.015	mg/L
BV54136	PB-DWICP	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	0.0406	0.0010	0.015	0.001	mg/L
BV54136	PB-DWICP	Lead	NY / NY Residential DW / Lead & Copper Als	0.0406	0.0010	0.015	0.015	mg/L
BV54139	PB-DWICP	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	0.0249	0.0010	0.015	0.001	mg/L
BV54139	PB-DWICP	Lead	NY / NY Residential DW / Lead & Copper Als	0.0249	0.0010	0.015	0.015	mg/L

Phoenix Laboratories does not assume responsibility for the data contained in this report. It is provided as an additional tool to identify requested criteria exceedances. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedance information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



NY Temperature Narration

November 07, 2016

SDG I.D.: GBV54075

The samples in this delivery group were received at 20°C.
(Note acceptance criteria is above freezing up to 6°C)

BNF

page 4 of 620inc

BCSD Lead Water Sampling COC - Fox Lane Middle School

No	Date	Address	Date	Time	Location	Notes	Room	Sample ID
571	10/14	1854	10/15	0755	FLMS	See the floor plan	Kitchen sink Right side	54075
572	10/14	1854	10/15	0755	FLMS	See the floor plan	Kitchen steamer	54076
573	10/14	1855	10/15	0800	FLMS	See the floor plan	Faculty lunchroom	54077
574	10/14	1857	10/15	0802	FLMS	See the floor plan	Girls bathroom cafeteria Left	54078
575	10/14	1857	10/15	0802	FLMS	See the floor plan	Girls bathroom cafeteria Right	54079
576	10/14	1900	10/15	0804	FLMS	See the floor plan	Boys bathroom Library Left	54080
577	10/14	1857	10/15	0804	FLMS	See the floor plan	Girls bathroom cafeteria Right	54081
578	10/14	1900	10/15	0804	FLMS	See the floor plan	Boys bathroom Library Middle	54082
579	10/14	1900	10/15	0804	FLMS	See the floor plan	Boys bathroom Library Middle	54083
580	10/14	1900	10/15	0804	FLMS	See the floor plan	Boys bathroom Library Right	54084
581	10/14	1902	10/15	0809	FLMS	See the floor plan	WF Library	54085
582	10/14	1902	10/15	0810	FLMS	See the floor plan	Library bathroom	54086
583	10/14	1902	10/15	0811	FLMS	See the floor plan	Library sink	54087
584	10/14	1820	10/15	0817	FLMS	See the floor plan	WF by E-202	54088
585	10/14	1822	10/15	0817	FLMS	See the floor plan	Custodial closet by E-204	54089
586	10/14	1824	10/15	0819	FLMS	See the floor plan	Boys bathroom by E-206 Left	54090
587	10/14	1824	10/15	0819	FLMS	See the floor plan	Boys bathroom by E-206 Right	54091
588	10/14	1826	10/15	0821	FLMS	See the floor plan	E-206 Staff bathroom	54092
589	10/14	1828	10/15	0821	FLMS	See the floor plan	Girls bathroom by E-206 Right	54093
590	10/14	1831	10/15	0824	FLMS	See the floor plan	WF by E-212 High	54094
591	10/14	1831	10/15	0824	FLMS	See the floor plan	WF by E-212 Low	54095
592	10/14	1837	10/15	0829	FLMS	See the floor plan	WF E-House lobby	54096
593	10/14	1838	10/15	0829	FLMS	See the floor plan	Custodial closet E-House lobby	54097
594	10/14	1839	10/15	0830	FLMS	See the floor plan	Rm E-109	54098
595	10/14	1839	10/15	0830	FLMS	See the floor plan	Rm E-110	54099
596	10/14	1840	10/15	0831	FLMS	See the floor plan	Rm E-113 Left	54100
597	10/14	1840	10/15	0831	FLMS	See the floor plan	Rm E-113 Middle	54101
598	10/14	1840	10/15	0831	FLMS	See the floor plan	Rm E-113 Middle	54102
599	10/14	1840	10/15	0831	FLMS	See the floor plan	Rm E-113 Middle	54103
600	10/14	1840	10/15	0831	FLMS	See the floor plan	Rm E-113 Right	54104
601	10/14	1840	10/15	0832	FLMS	See the floor plan	Rm E-113A	54105
602	10/14	1842	10/15	0834	FLMS	See the floor plan	Rm E-114 Left	54106
603	10/14	1842	10/15	0834	FLMS	See the floor plan	Rm E-114 Middle	54107
604	10/14	1842	10/15	0834	FLMS	See the floor plan	Rm E-114 Middle	54108

BNF 10-17-16 14:48

BNF

BNF Consulting

T. Conway

10-17-16

16:01

BNF

Page 5 of 62911C

BCSD Lead Water Sampling COC - Fox Lane Middle School

NO	DATE	NO	DATE	NO	FLMS	DESCRIPTION	LOCATION	NO
605	10/14	1842	10/15	0834	FLMS	See the floor plan	Rm E-114 Middle	50109
606	10/14	1842	10/15	0834	FLMS	See the floor plan	Rm E-114 Middle	50110
607	10/14	1842	10/15	0834	FLMS	See the floor plan	Rm E-114 Right	50111
608	10/14	1850	10/15	0840	FLMS	See the floor plan	Gym 123 Boys Coach office 1st fl	50112
609	10/14	1852	10/15	0840	FLMS	See the floor plan	Gym 123 WF Boys Locker room	50113
610	10/14	1854	10/15	0840	FLMS	See the floor plan	Gym 123 Boys Locker room sink Left	50114
611	10/14	1854	10/15	0840	FLMS	See the floor plan	Gym 123 Boys Locker room sink Right	50115
612	10/14	1900	10/15	0845	FLMS	See the floor plan	Gym 121 Boys bathroom Left	50116
613	10/14	1900	10/15	0804	FLMS	See the floor plan	Gym 121 Boys bathroom Right	50117
614	10/14	1902	10/15	0804	FLMS	See the floor plan	Gym 113 Custodial Closet	50118
615	10/14	1902	10/15	0809	FLMS	See the floor plan	Gym 104 Left	50119
616	10/14	1902	10/15	0810	FLMS	See the floor plan	Gym 104 Right	50120
617	10/14	1904	10/15	0811	FLMS	See the floor plan	Gym 109	50121
618	10/14	1906	10/15	0817	FLMS	See the floor plan	Gym 100 WF	50122
619	10/14	1906	10/15	0817	FLMS	See the floor plan	Gym 100 Sink Left	50123
620	10/14	1906	10/15	0819	FLMS	See the floor plan	Gym 100 Sink Right	50124
621	10/14	1906	10/15	0819	FLMS	See the floor plan	Gym 2nd fl WF by stairs East	50125
622	10/14	1908	10/15	0821	FLMS	See the floor plan	Custodial closet Gym 2nd fl	50126
623	10/14	1910	10/15	0821	FLMS	See the floor plan	Gym 2nd fl WF by stairs West	50127
624	10/14	1831	10/15	0824	FLMS	See the floor plan	Gym Ground WF	50128
625	10/14	1835	10/15	0824	FLMS	See the floor plan	Exterior Gym Front (West)	50129
626	10/14	1837	10/15	0829	FLMS	See the floor plan	Cafeteria basement	50130
627	10/14	1839	10/15	0829	FLMS	See the floor plan	Exterior E-House Right	50131
628	10/14	1839	10/15	0830	FLMS	See the floor plan	Exterior E-House Left	50132
629	10/14	1840	10/15	0830	FLMS	See the floor plan	Exterior S-House Left	50133
630	10/14	1840	10/15	0831	FLMS	See the floor plan	Exterior S-House Right	50134
631	10/14	1842	10/15	0831	FLMS	See the floor plan	Exterior W-House Left	50135
632	10/14	1844	10/15	0831	FLMS	See the floor plan	Exterior W-House Right	50136
633	10/14	1845	10/15	0831	FLMS	See the floor plan	Exterior Central Building Left	50137
634	10/14	1847	10/15	0831	FLMS	See the floor plan	Exterior Central Building Right	50138
471A	10/14	1945	10/15	0606	FLMS	See the floor plan	Rm C-118	50139
611A	10/14	1854	10/15	0840	FLMS	See the floor plan	Custodial closet in Gym 123	50140
617A	10/14	1904	10/15	0850	FLMS	See the floor plan	Gym 109A	50141
625A	10/14	1814	10/15	0857	FLMS	See the floor plan	Exterior Gym North Side	50142

BNF Consulting
 BNF 10-17-16 14:40
 T. County 10-17-16 16:01


BNP

page 6 of 6 2016

BCSD Lead Water Sampling COC - Fox Lane Middle School

NO	Date/Time		Date/Time		School	Location	Remark
634A	10/14 1820		10/15 0915		FLMS	See the floor plan	Maintenance Left
634B	10/14 1822		10/15 0910		FLMS	See the floor plan	Maintenance Left
634C	10/14 1824		10/15 0917		FLMS	See the floor plan	Exterior by Cafeteria Staff Room South
634D	10/14 1826		10/15 0920		FLMS	See the floor plan	Exterior by Cafeteria North

SU143
 SU144
 SU145
 SU146

BNP Consulting

 T. Cornsday 10-17-16 1601
 10-17-16 14:40



Friday, October 28, 2016

Attn: Justin Joe
BNF Consulting
152 Route 202 #404
Lincolndale, NY 10540-0404

Project ID: FOX LANE MIDDLE SCHOOL
Sample ID#s: BV53973 - BV54074

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

If you have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext. 200.

Sincerely yours,

A handwritten signature in black ink that reads "Phyllis Shiller". The signature is written in a cursive style.

Phyllis Shiller
Laboratory Director

NELAC - #NY11301
CT Lab Registration #PH-0618
MA Lab Registration #MA-CT-007
ME Lab Registration #CT-007
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003
NY Lab Registration #11301
PA Lab Registration #68-03530
RI Lab Registration #63
VT Lab Registration #VT11301



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:05
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53973

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 469 TECHNOLOGY BATHROOM

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0022	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	;/RVM/G/CE200.9	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:06
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53974

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 470 FRONT OFFICE BATHROOM

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0026	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	I/RVM/G/CE200.9	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:06
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53975

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 471 RM C-118 NURSES OFFICE BATHROOM

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0024	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	I/RVM/G/CE200.9	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:08
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53976

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 472 RM C-117 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0022	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	I/RVM/G/CE200.9	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:08
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53977

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 473 RM C-117 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0010	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	I/RVM/G/CE200.9	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:11
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53978

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 474 CUSTODIAL CLOSET BY C-117

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0042	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	I/RVM/G/CE200.9	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:13
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53979

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 475 BOILER RM

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0089	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	I/RVM/G/CE200.9	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:13
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53980

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 476 RM C-127

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0053	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	;/RVM/G/CE200.9	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:13
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53981

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 477 WF HALLWAY

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0035	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	;/RVM/G/CE200.9	

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:13
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53982

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 478 WF BY RM 210 HIGH

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0015	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:13
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53983

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 479 WF BY RM 210 LOW

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:15
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53984

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 480 BOYS BATHROOM LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0033	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:15
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53985

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 481 BOYS BATHROOM RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0026	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:16
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53986

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 482 RN C-210

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0141	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:17
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53987

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 483 BAND ROOM

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0022	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:18
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53988

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 484 RM C-211

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0143	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:19
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53989

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 485 GIRLS BATHROOM BY RM C-211 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0067	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:19
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53990

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 486 GIRLS BATHROOM BY RM C-211 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0029	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:20
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53991

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 487 WF BY RM C-211

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0020	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:20
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53992

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 488 WF BY RM C-301B

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0031	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:30
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53993

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 489 GIRLS BATHROOM 3RD FL.

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0104	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 6:32
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53994

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 490 RM C-304 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0069	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:32
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53995

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 491 RM C-304 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0040	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:34
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53996

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 492 RM C-301B

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0037	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report
 October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 6:34
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53997

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 493 RM C-301A

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0036	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:35
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53998

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 494 RM C-309

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0046	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:37
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV53999

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 495 BOYS BATHROOM BY RM 309 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0048	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:37
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54000

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 496 BOYS BATHROOM BY RM 309 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0064	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:39
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54001

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 497 WF BY RM C-309 HIGH

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:39
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54002

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 498 WF BY RM C-309 LOW

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:41
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54003

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 499 UA 3 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0051	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 6:41
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54004

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 500 US 3 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0015	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:43
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54005

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 501 UA 2 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0143	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:43
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54006

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 502 UA 2 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0058	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:43
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54007

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 503 UA 2 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0030	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date Time
 10/15/16 6:43
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54008

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 504 UA 2 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0087	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:45
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54009

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 505 UA 1 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0011	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/BF	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:45
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54010

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 506 UA 1 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0017	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:45
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54011

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 507 UA 1 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0094	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:50
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54012

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 508 WF BY W-212 HIGH

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:50
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54013

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 509 WF BY W-212 LOW

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:51
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54014

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 510 CUSTODIAL CLOSET WEST HOUSE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0043	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:59
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54015

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 511 BOYS BATHROOM W-HOUSE LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0026	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

6:59
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54016

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 512 BOYS BATHROOM W HOUSE RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0025	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:01
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54017

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 513 GIRLS BATHROOM W HOUSE RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0111	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:01
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54018

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 514 GIRLS BATHROOM W HOUSE RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0030	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:03
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54019

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 515 STAFF BATHROOMN BY RM W-205

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0014	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:04
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54020

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 516 WF BY RM W-202

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:06
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54021

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 517 RM W-110

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0013	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:06
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54022

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 518 RM W-109

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0012	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:07
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54023

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 519 WF W-HOUSE FIRST FLOOR

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0020	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:07
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54024

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 520 CUSTODIAL CLOSET W-HOUSE 1ST FL

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0013	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:10
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54025

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 521 RM W-113 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0023	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:10
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54026

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 522 RM W-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0025	0.0005	1	mg/L	0.015			10/22/16	MA/RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:10
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54027

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 523 WM W-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0026	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:10
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54028

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 524 RM W-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0025	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:10
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54029

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 525 RM W-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0016	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:10
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54030

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 526 RM W-113 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0025	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:12
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54031

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 527W-114A

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0025	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:14
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54032

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 528 RM W-114 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0028	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:14
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54033

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 529 RM W-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0013	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:14
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54034

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 530 RM W-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0135	0.0020	4	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:14
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54035

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 531 RM W-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0020	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:14
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54036

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 532 RM W-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0019	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:14
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54037

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 533 RM W-114 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0071	0.0020	4	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:16
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54038

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 534 RM S-110

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0009	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:16
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54039

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 535 RM S-109

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0014	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:18
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54040

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 536 WF S-HOUSE 1ST FL.

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/23/16	PS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:18
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54041

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 537 CUSTODIAL CLOSET S-HOUSE 1ST FL

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0036	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:36
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54042

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 538 RM S-113 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0018	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:36
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54043

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 539 RM S-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0017	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 7:36
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54044

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 540 RM S-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0021	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:36
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54045

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 541 RM S-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0012	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:36
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54046

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 542 RM S-113 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0017	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 7:36
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54047

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 543 RM S-113 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0050	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:38
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54048

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 544 RM S-113A

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0049	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:37
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54049

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 545 RM S-114 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0019	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 7:37
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54050

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 546 RM S-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0023	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:37
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54051

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 547 RM S-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0046	0.0020	4	mg/L	0.015			10/23/16	PS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 7:37
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54052

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 548 RM S-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0010	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:37
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54053

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 549 RM S-114 MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0013	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 7:37
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54054

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 550 RM S-114 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0017	0.0010	4	mg/L	0.015			10/23/16	PS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:18
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54055

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 551 WF BY RM S-212 HIGH

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:18
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54056

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 552 WF BY RM-212 LOW

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 7:19
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54057

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 553 STAFF BATHROOM BY S-210

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:21
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54058

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 554 BOYS BATHROOM BY S-210 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0011	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:21
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54059

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 555 BOYS BATHROOM BY S-210 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0012	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:23
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54060

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 556 GIRLS BATHROOM BY S-204 LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0030	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 7:23
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54061

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 557 GIRLS BATHROOM BY S204 RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0013	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:25
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54062

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 558 CUSTODIAL CLOSET BY S-204

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0006	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

Time

10/15/16 7:25
 10/17/16 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54063

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 559 WF BY S-204

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0008	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:50
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54064

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 560 CUSTODIAL CLOSET BY CAFETERIA

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0007	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:50
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54065

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 561 WF BY CAFETERIA HIGH

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:50
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54066

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 562 WF BY CAFETERIA LOW

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:55
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54067

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 563 KITCHEN SINK FRONT ROW LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0011	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:55
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54068

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 564 KITCHEN SINK FRONT ROW RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0013	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:55
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54069

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 565 KITCHEN SINK SECOND ROW LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:55
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54070

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 566 KITCHEN SINK SECOND ROW RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0011	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:55
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54071

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 567 KITCHEN SINK LEFT SIDE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:55
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54072

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 568 KITCHEN SINK REAR LEFT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0014	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:55
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54073

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 569 KITCHNE SINK NEAR MIDDLE

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	< 0.0005	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823

Analysis Report

October 28, 2016

FOR: Attn: Justin Joe
 BNF Consulting
 152 Route 202 #404
 Lincolndale, NY 10540-0404

Sample Information

Matrix: DRINKING WATER
 Location Code: BNFCNSLT
 Rush Request: Standard
 P.O.#:

Custody Information

Collected by:
 Received by: LB
 Analyzed by: see "By" below

Date

10/15/16
 10/17/16

Time

7:55
 16:01

Laboratory Data

SDG ID: GBV53973
 Phoenix ID: BV54074

Project ID: FOX LANE MIDDLE SCHOOL
 Client ID: 570 KITCHEN SINK NEAR RIGHT

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.0008	0.0005	1	mg/L	0.015			10/23/16	RS	E200.9/SM3113B-10
Total Metal Digestion	Completed							10/18/16	/W	E200.9

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
 BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
 AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Maximum Contaminant Level (MCL) (Lower of): 40 CFR Part 141; Public Health Law, Section 225 Part 5. The highest level of a contaminant that is allowed in drinking water. MCLs are enforceable standards.

Action Level (AL): (Lower of): 40 CFR Part 141.80; Public Health Law, Section 225 Part 5.

Secondary DW Maximum Contaminant Level Goal (MCLG): (Lower of): 40 CFR Part 141; 40 CFR Part 143. The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are non-enforceable public health goals.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.
 This report must not be reproduced except in full as defined by the attached chain of custody.

Phyllis Shiller, Laboratory Director

October 28, 2016

Reviewed and Released by: Phyllis Shiller, Laboratory Director



Environmental Laboratories, Inc.
 587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
 Tel. (860) 645-1102 Fax (860) 645-0823



QA/QC Report

October 28, 2016

QA/QC Data

SDG I.D.: GBV53973

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
QA/QC Batch 363268 (mg/L), QC Sample No: BV45963 (BV53973)													
Lead	BRL	0.001	0.109	0.104	4.70	96.7			105			85 - 115	20
Comment: Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363345A (mg/L), QC Sample No: BV52811 (BV53982, BV53983, BV53984, BV53985, BV53986, BV53987, BV53988, BV53989)													
Lead	BRL	0.001				93.0			94.4			85 - 115	20
Comment: This batch does not include a duplicate. Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363268A (mg/L), QC Sample No: BV53974 (BV53974, BV53975, BV53976, BV53977, BV53978, BV53979, BV53980, BV53981)													
Lead	BRL	0.001				96.7			95.5			85 - 115	20
Comment: This batch does not include a duplicate. Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363346 (mg/L), QC Sample No: BV53990 (BV53990, BV53991, BV53992, BV53993, BV53994, BV53995, BV53996, BV53997, BV53998, BV53999)													
Lead	BRL	0.001	0.0029	0.003	NC	96.3			98.3			85 - 115	20
Comment: Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363346A (mg/L), QC Sample No: BV54000 (BV54000, BV54001, BV54002, BV54003, BV54004, BV54005, BV54006, BV54007, BV54008, BV54009)													
Lead	BRL	0.001				96.3			93.8			85 - 115	20
Comment: This batch does not include a duplicate. Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363347 (mg/L), QC Sample No: BV54010 (BV54010, BV54011, BV54012, BV54013, BV54014, BV54015, BV54016, BV54017, BV54018, BV54019)													
Lead	BRL	0.001	0.0017	0.002	NC	98.1			95.1			85 - 115	20
Comment: Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363347A (mg/L), QC Sample No: BV54020 (BV54020, BV54021, BV54022, BV54023, BV54024, BV54025, BV54026, BV54027, BV54028, BV54029)													
Lead	BRL	0.001				98.1			98.5			85 - 115	20
Comment: This batch does not include a duplicate. Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													

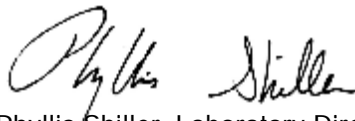
QA/QC Data

SDG I.D.: GBV53973

Parameter	Blk Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
QA/QC Batch 363348 (mg/L), QC Sample No: BV54030 (BV54030, BV54031, BV54032, BV54033, BV54034, BV54035, BV54036, BV54037, BV54038, BV54039)													
Lead	BRL	0.001	0.0025	0.003	NC	92.4			83.0			85 - 115	20
Comment:													
Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363348A (mg/L), QC Sample No: BV54040 (BV54040, BV54041, BV54042, BV54043, BV54044, BV54045, BV54046, BV54047, BV54048, BV54049)													
Lead	BRL	0.001				92.4			93.6			85 - 115	20
Comment:													
This batch does not include a duplicate.													
Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363350 (mg/L), QC Sample No: BV54050 (BV54050, BV54051, BV54052, BV54053, BV54054, BV54055, BV54056, BV54057, BV54058, BV54059)													
Lead	BRL	0.001	0.0023	0.002	NC	90.5			81.4			85 - 115	20
Comment:													
Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363350A (mg/L), QC Sample No: BV54060 (BV54060, BV54061, BV54062, BV54063, BV54064, BV54065, BV54066, BV54067, BV54068, BV54069)													
Lead	BRL	0.001				90.5			83.5			85 - 115	20
Comment:													
This batch does not include a duplicate.													
Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													
QA/QC Batch 363351 (mg/L), QC Sample No: BV54070 (BV54070, BV54071, BV54072, BV54073, BV54074)													
Lead	BRL	0.001	0.0011	0.001	NC	95.5			94.0			85 - 115	20
Comment:													
Additional: LCS acceptance range is 85-115% MS acceptance range 75-125%.													

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

- RPD - Relative Percent Difference
- LCS - Laboratory Control Sample
- LCSD - Laboratory Control Sample Duplicate
- MS - Matrix Spike
- MS Dup - Matrix Spike Duplicate
- NC - No Criteria
- Intf - Interference


 Phyllis Shiller, Laboratory Director
 October 28, 2016

Sample Criteria Exceedances Report

Criteria: None

GBV53973 - BNFCNSLT

State: NY

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
--------	-------	-----------------	----------	--------	----	----------	----------------	-------------------

*** No Data to Display ***

Phoenix Laboratories does not assume responsibility for the data contained in this report. It is provided as an additional tool to identify requested criteria exceedances. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedance information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



NY Temperature Narration

October 28, 2016

SDG I.D.: GBV53973

The samples in this delivery group were received at 20°C.
(Note acceptance criteria is above freezing up to 6°C)

BNF

page 1 of 6

2014C

BCSD Lead Water Sampling COC - Fox Lane Middle School

NO	PLS No.	PLS Year	PLS Date	PLS ID	PLS Name	Location	Remark	
469	10/14	1943	10/15	0605	FLMS	See the floor plan	Technology Bathroom	53973
470	10/14	1944	10/15	0606	FLMS	See the floor plan	Front office bathroom	53974
471	10/14	1945	10/15	0606	FLMS	See the floor plan	Rm C-118 Nurse office bathroom	53975
472	10/14	1945	10/15	0608	FLMS	See the floor plan	Rm C-117 Left	53976
473	10/14	1945	10/15	0608	FLMS	See the floor plan	Rm C-117 Right	53977
474	10/14	1945	10/15	0611	FLMS	See the floor plan	Custodial closet by C-117	53978
475	10/14	1948	10/15	0612	FLMS	See the floor plan	Boiler room	53979
476	10/14	1949	10/15	0612	FLMS	See the floor plan	Rm C-127	53980
477	10/14	1950	10/15	0613	FLMS	See the floor plan	WF Hallway	53981
478	10/14	1952	10/15	0613	FLMS	See the floor plan	WF by Rm 210 High	53982
479	10/14	1952	10/15	0613	FLMS	See the floor plan	WF by Rm 210 Low	53983
480	10/14	1954	10/15	0615	FLMS	See the floor plan	Boys Bathroom Left	53984
481	10/14	1954	10/15	0615	FLMS	See the floor plan	Boys Bathroom Right	53985
482	10/14	1956	10/15	0616	FLMS	See the floor plan	Rm C-210	53986
483	10/14	1956	10/15	0617	FLMS	See the floor plan	Band Room	53987
484	10/14	1956	10/15	0618	FLMS	See the floor plan	Rm C-211	53988
485	10/14	1958	10/15	0619	FLMS	See the floor plan	Girls Bathroom by Rm C-211 Left	53989
486	10/14	1958	10/15	0619	FLMS	See the floor plan	Girls Bathroom by Rm C-211 Right	53990
487	10/14	1959	10/15	0620	FLMS	See the floor plan	WF by Rm C-211	53991
488	10/14	2002	10/15	0620	FLMS	See the floor plan	WF by Rm C-301B	53992
489	10/14	2002	10/15	0630	FLMS	See the floor plan	Girls bathroom 3rd floor	53993
490	10/14	2004	10/15	0632	FLMS	See the floor plan	Rm C-304 Left	53994
491	10/14	2004	10/15	0632	FLMS	See the floor plan	Rm C-304 Right	53995
492	10/14	2006	10/15	0634	FLMS	See the floor plan	Rm C-301B	53996
493	10/14	2006	10/15	0634	FLMS	See the floor plan	Rm C-301A	53997
494	10/14	2007	10/15	0635	FLMS	See the floor plan	Rm C-309	53998
495	10/14	2007	10/15	0637	FLMS	See the floor plan	Boys bathroom by Rm 309 Left	53999
496	10/14	2007	10/15	0637	FLMS	See the floor plan	Boys bathroom by Rm 309 Right	54000
497	10/14	2009	10/15	0639	FLMS	See the floor plan	WF by Rm C-309 High	54001
498	10/14	2009	10/15	0639	FLMS	See the floor plan	WF by Rm C-309 Low	54002
499	10/14	2011	10/15	0641	FLMS	See the floor plan	UA 3 Left	54003
500	10/14	2011	10/15	0641	FLMS	See the floor plan	UA 3 Right	54004
501	10/14	2013	10/15	0643	FLMS	See the floor plan	UA 2 Left	54005
502	10/14	2013	10/15	0643	FLMS	See the floor plan	UA 2 Middle	54006

BDF

BNF Consulting

T. Gansley

10-17-16 14:48

10-17-16

1601

BCSD Lead Water Sampling COC - Fox Lane Middle School

503	10/14	2015	10/15	0643	FLMS	See the floor plan	UA 2 Middle	54007
504	10/14	2015	10/15	0643	FLMS	See the floor plan	UA 2 Right	54008
505	10/14	2016	10/15	0645	FLMS	See the floor plan	UA 1 Right	54009
506	10/14	2016	10/15	0645	FLMS	See the floor plan	UA 1 Middle	54010
507	10/14	2016	10/15	0645	FLMS	See the floor plan	UA 1 Left	54011
508	10/14	2018	10/15	0650	FLMS	See the floor plan	WF by W-212 High	54012
509	10/14	2018	10/15	0650	FLMS	See the floor plan	WF by W-212 Low	54013
510	10/14	1905	10/15	0651	FLMS	See the floor plan	Custodial Closet West-House	54014
511	10/14	1906	10/15	0659	FLMS	See the floor plan	Boys bathroom W-House Left	54015
512	10/14	1906	10/15	0659	FLMS	See the floor plan	Boys bathroom W-House Right	54016
513	10/14	1908	10/15	0701	FLMS	See the floor plan	Girls bathroom W-House Left	54017
514	10/14	1908	10/15	0701	FLMS	See the floor plan	Girls bathroom W-House Right	54018
515	10/14	1909	10/15	0703	FLMS	See the floor plan	Staff bathroom by Rm W-205	54019
516	10/14	1909	10/15	0704	FLMS	See the floor plan	WF by Rm W-202	54020
517	10/14	1910	10/15	0706	FLMS	See the floor plan	Rm W-110	54021
518	10/14	1910	10/15	0706	FLMS	See the floor plan	Rm W-109	54022
519	10/14	1911	10/15	0707	FLMS	See the floor plan	WF W-House First Floor	54023
520	10/14	1912	10/15	0707	FLMS	See the floor plan	Custodial closet W-House 1st fl	54024
521	10/14	1913	10/15	0710	FLMS	See the floor plan	Rm W-113 Left	54025
522	10/14	1913	10/15	0710	FLMS	See the floor plan	Rm W-113 Middle	54026
523	10/14	1913	10/15	0710	FLMS	See the floor plan	Rm W-113 Middle	54027
524	10/14	1913	10/15	0710	FLMS	See the floor plan	Rm W-113 Middle	54028
525	10/14	1913	10/15	0710	FLMS	See the floor plan	Rm W-113 Middle	54029
526	10/14	1913	10/15	0710	FLMS	See the floor plan	Rm W-113 Right	54030
527	10/14	1913	10/15	0712	FLMS	See the floor plan	W-114A	54031
528	10/14	1916	10/15	0714	FLMS	See the floor plan	Rm W-114 Left	54032
529	10/14	1916	10/15	0714	FLMS	See the floor plan	Rm W-114 Middle	54033
530	10/14	1916	10/15	0714	FLMS	See the floor plan	Rm W-114 Middle	54034
531	10/14	1916	10/15	0714	FLMS	See the floor plan	Rm W-114 Middle	54035
532	10/14	1916	10/15	0714	FLMS	See the floor plan	Rm W-114 Middle	54036
533	10/14	1916	10/15	0714	FLMS	See the floor plan	Rm W-114 Right	54037
534	10/14	1851	10/15	0716	FLMS	See the floor plan	Rm S-110	54038
535	10/14	1852	10/15	0716	FLMS	See the floor plan	Rm S-109	54039
536	10/14	1853	10/15	0718	FLMS	See the floor plan	WF S-House 1st fl	54040

BNP

BNP Consulting

T. Conway

10-17-16 14:40

10-17-16

1601

BMF

BCSD Lead Water Sampling COC - Fox Lane Middle School

NO.	Date	Sample ID	Time	Location	Room	Notes	Remarks	
537	10/14	1854	10/15	0718	FLMS	See the floor plan	Custodial closet S-House 1st fl	54001
538	10/14	1855	10/15	0736	FLMS	See the floor plan	Rm S-113 Left	54002
539	10/14	1855	10/15	0736	FLMS	See the floor plan	Rm S-113 Middle	54003
540	10/14	1855	10/15	0736	FLMS	See the floor plan	Rm S-113 Middle	54004
541	10/14	1855	10/15	0736	FLMS	See the floor plan	Rm S-113 Middle	54005
542	10/14	1855	10/15	0736	FLMS	See the floor plan	Rm S-113 Middle	54006
543	10/14	1855	10/15	0736	FLMS	See the floor plan	Rm S-113 Right	54007
544	10/14	1855	10/15	0738	FLMS	See the floor plan	Rm S-113A	54008
545	10/14	1902	10/15	0737	FLMS	See the floor plan	Rm S-114 Left	54009
546	10/14	1908	10/15	0737	FLMS	See the floor plan	Rm S-114 Middle	54050
547	10/14	1908	10/15	0737	FLMS	See the floor plan	Rm S-114 Middle	54051
548	10/14	1908	10/15	0737	FLMS	See the floor plan	Rm S-114 Middle	54052
549	10/14	1908	10/15	0737	FLMS	See the floor plan	Rm S-114 Middle	54053
550	10/14	1908	10/15	0737	FLMS	See the floor plan	Rm S-114 Right	54054
551	10/14	1907	10/15	0718	FLMS	See the floor plan	WF by Rm S-212 High	54055
552	10/14	1907	10/15	0718	FLMS	See the floor plan	WF by Rm S-212 Low	54056
553	10/14	1907	10/15	0719	FLMS	See the floor plan	Staff bathroom by S-210	54057
554	10/14	1903	10/15	0721	FLMS	See the floor plan	Boys bathroom by S-210 Left	54058
555	10/14	1903	10/15	0721	FLMS	See the floor plan	Boys bathroom by S-210 Right	54059
556	10/14	1905	10/15	0723	FLMS	See the floor plan	Girls bathroom by S-204 Left	54060
557	10/14	1905	10/15	0723	FLMS	See the floor plan	Girls bathroom by S-204 Right	54061
558	10/14	1906	10/15	0725	FLMS	See the floor plan	Custodial closet by S-204	54062
559	10/14	1908	10/15	0725	FLMS	See the floor plan	WF by S-204	54063
560	10/14	1850	10/15	0750	FLMS	See the floor plan	Custodial closet by cafeteria	54064
561	10/14	1851	10/15	0750	FLMS	See the floor plan	WF by cafeteria High	54065
562	10/14	1852	10/15	0750	FLMS	See the floor plan	WF by cafeteria Low	54066
563	10/14	1853	10/15	0755	FLMS	See the floor plan	Kitchen Sink front row Left	54067
564	10/14	1853	10/15	0755	FLMS	See the floor plan	Kitchen Sink front row Right	54068
565	10/14	1853	10/15	0755	FLMS	See the floor plan	Kitchen Sink second row Left	54069
566	10/14	1853	10/15	0755	FLMS	See the floor plan	Kitchen Sink second row Right	54070
567	10/14	1853	10/15	0755	FLMS	See the floor plan	Kitchen Sink Left side	54071
568	10/14	1853	10/15	0755	FLMS	See the floor plan	Kitchen sink rear Left	54072
569	10/14	1853	10/15	0755	FLMS	See the floor plan	Kitchen sink rear Middle	54073
570	10/14	1853	10/15	0755	FLMS	See the floor plan	Kitchen sink rear Right	54074

10-17-11 14:48

BNF Consulting
 T. Courney 10.17.16 1601