May 23, 2024

Steve Aldrich
Director of Facilities and Grounds
Liberty School District
801 Kent Street
Liberty, Missouri 64068

Project: Limited Lead in Drinking Water Testing
Address: 8150 North Farley Avenue, Kansas City, Missouri 64158

Mr. Steve Aldrich

On March 13, 2024 and April 30, 2024, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 120 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of “lead free” to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of “lead free” as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: https://www.epa.gov/dwreginfo/lead-and-copper-rule

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.
Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school’s buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in red text.

March 13, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
8150-1-FD	Liberty Oaks - 003767-Room 1B (Conference Room)	Sink Tap	First Draw	<0.4
8150-2-FD	Liberty Oaks - 003770-Across from 1D-Staff Restroom	Sink Tap	First Draw	<0.4
8150-3-FD	Liberty Oaks - 003768-Nurse's Office	Sink Tap	First Draw	<0.4
8150-4-FD	Liberty Oaks - 003769-Nurse's Office Restroom	Sink Tap	First Draw	<0.4
8150-5-FD	Liberty Oaks - 003773-Room 2-Far Right	Sink Tap	First Draw	0.4
8150-6-FD	Liberty Oaks - 003774-Room 2-Right Middle	Sink Tap	First Draw	<0.4
8150-7-FD	Liberty Oaks - 003775-Room 2-Left Middle	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
8150-8-FD	Liberty Oaks - 003776-Room 2-Far Left	Sink Tap	First Draw	<0.4
8150-9-FD	Liberty Oaks - 003777-Room 4	Sink Tap	First Draw	<0.4
8150-10-FD	Liberty Oaks - 003772-Gym-Left	Drinking Fountain	First Draw	<0.4
8150-11-FD	Liberty Oaks - 003772-Gym-Right	Drinking Fountain	First Draw	<0.4
8150-12-FD	Liberty Oaks - 003778-Across from Room 4-Boys-Right	Sink Tap	First Draw	<0.4
8150-13-FD	Liberty Oaks - 003779-Across from Room 4-Boys-Left	Sink Tap	First Draw	<0.4
8150-14-FD	Liberty Oaks - 003780-Across from Room 4-Girls-Right	Sink Tap	First Draw	<0.4
8150-15-FD	Liberty Oaks - 003781-Across from Room 4-Girls-Left	Sink Tap	First Draw	<0.4
8150-16-FD	Liberty Oaks - 003771-Outside Gym	Drinking Fountain	First Draw	<0.4
8150-17-FD	Liberty Oaks - 004619-Kitchen-In Front of Freezer	Sink Tap	First Draw	<0.4
8150-18-FD	Liberty Oaks - 004620-Kitchen-In Front of Freezer	Sink Tap	First Draw	<0.4
8150-19-FD	Liberty Oaks - 004621-Kitchen-In Dishwashing Room	Sink Tap	First Draw	<0.4
8150-20-FD	Liberty Oaks - 004622-Kitchen-Handwashing in Dishwashing Room	Sink Tap	First Draw	<0.4
8150-21-FD	Liberty Oaks - 004909-Kitchen-Dishwashing Room	Sink Tap	First Draw	3
8150-22-FD	Liberty Oaks - 004623-Kitchen-Three Bay Sink	Sink Tap	First Draw	1.5
8150-23-FD	Liberty Oaks - 004624-Kitchen-Three Bay Sink	Sink Tap	First Draw	0.7
8150-24-FD	Liberty Oaks - 004625-Kitchen-Three Bay Sink	Sink Tap	First Draw	0.6
8150-25-FD	Liberty Oaks - 004626-Kitchen-Handwashing By Kitchen Office	Sink Tap	First Draw	<0.4
8150-26-FD	Liberty Oaks - 004627-Kitchen-Faucet on Kettle	Sink Tap	First Draw	2.4
8150-27-FD	Liberty Oaks - 004628-Kitchen-By Office	Sink Tap	First Draw	3.4
8150-28-FD	Liberty Oaks - 004629-Kitchen-By Office	Sink Tap	First Draw	11.2
8150-29-FD	Liberty Oaks - 004631-Kitchen-Restroom	Sink Tap	First Draw	<0.4
8150-30-FD	Liberty Oaks - 004632-Kitchen-Serving Line	Sink Tap	First Draw	<0.4
8150-31-FD	Liberty Oaks - 004630-Kitchen-Handwashing Next to Restroom	Sink Tap	First Draw	<0.4
8150-32-FD	Liberty Oaks - 0004910-Kitchen	Ice Machine	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
8150-33-FD	Liberty Oaks - 001973-Next to Room 8-Girls	Drinking Fountain	First Draw	<0.4
8150-34-FD	Liberty Oaks - 001973F-By Room 8	Bottle Filler	First Draw	<0.4
8150-35-FD	Liberty Oaks - 001974-Next to Room 8-Boys	Drinking Fountain	First Draw	<0.4
8150-36-FD	Liberty Oaks - 001975F-Restroom by 8	Sink Tap	First Draw	<0.4
8150-37-FD	Liberty Oaks - 001976-Room 100	Sink Tap	First Draw	<0.4
8150-38-FD	Liberty Oaks - 001977-Staff Restroom by 100	Sink Tap	First Draw	<0.4
8150-39-FD	Liberty Oaks - 001979F-Room 104	Sink Tap	First Draw	<0.4
8150-40-FD	Liberty Oaks - 001978B-Room 104	Bubbler	First Draw	<0.4
8150-41-FD	Liberty Oaks - 001980-Room 104-Restroom	Sink Tap	First Draw	<0.4
8150-42-FD	Liberty Oaks - 001981F-Room 106-Restroom	Sink Tap	First Draw	<0.4
8150-43-FD	Liberty Oaks - 001982B-Room 106	Bubbler	First Draw	<0.4
8150-44-FD	Liberty Oaks - 001983F-Room 106	Sink Tap	First Draw	<0.4
8150-45-FD	Liberty Oaks - 001984F-Room 110-Restroom	Sink Tap	First Draw	<0.4
8150-46-FD	Liberty Oaks - 001985B-Room 110	Bubbler	First Draw	<0.4
8150-47-FD	Liberty Oaks - 001986F-Room 110	Sink Tap	First Draw	<0.4
8150-48-FD	Liberty Oaks - 001988F-Room 112	Sink Tap	First Draw	<0.4
8150-49-FD	Liberty Oaks - 001989B-Room 112	Bubbler	First Draw	<0.4
8150-50-FD	Liberty Oaks - 001987-Room 112-Restroom	Sink Tap	First Draw	<0.4
8150-51-FD	Liberty Oaks - 001990F-Room 113	Sink Tap	First Draw	<0.4
8150-52-FD	Liberty Oaks - 003701B-Room 113	Bubbler	First Draw	<0.4
8150-53-FD	Liberty Oaks - 003702F-Room 111	Sink Tap	First Draw	<0.4
8150-54-FD	Liberty Oaks - 003703F-Room 111	Bubbler	First Draw	<0.4
8150-55-FD	Liberty Oaks - 003704F-Room 107	Sink Tap	First Draw	<0.4
8150-56-FD	Liberty Oaks - 003705B-Room 107	Bubbler	First Draw	<0.4
8150-57-FD	Liberty Oaks - 003706F-Room 105	Sink Tap	First Draw	<0.4
8150-58-FD	Liberty Oaks - 003707B-Room 105	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
8150-59-FD	Liberty Oaks - 003708F-Room 9-Restroom	Sink Tap	First Draw	<0.4
8150-61-FD	Liberty Oaks - 003710F-Room 9	Sink Tap	First Draw	<0.4
8150-62-FD	Liberty Oaks - 003753F-Room 10I	Sink Tap	First Draw	1.4
8150-63-FD	Liberty Oaks - 003754B-Room 10I	Sink Tap	First Draw	<0.4
8150-64-FD	Liberty Oaks - 003752-Room 10-Staff Restroom	Sink Tap	First Draw	<0.4
8150-65-FD	Liberty Oaks - 003755F-Room 10H	Sink Tap	First Draw	<0.4
8150-66-FD	Liberty Oaks - 003756B-Room 10H	Bubbler	First Draw	<0.4
8150-67-FD	Liberty Oaks - 003757-Room 10F	Sink Tap	First Draw	<0.4
8150-68-FD	Liberty Oaks - 003758-Room 10G	Sink Tap	First Draw	<0.4
8150-69-FD	Liberty Oaks - 003760F-Room 10D	Sink Tap	First Draw	<0.4
8150-70-FD	Liberty Oaks - 003761B-Room 10D	Bubbler	First Draw	<0.4
8150-71-FD	Liberty Oaks - 003759B-Room 10-Left	Drinking Fountain	First Draw	<0.4
8150-72-FD	Liberty Oaks - 003759-Room 10-Right	Drinking Fountain	First Draw	<0.4
8150-73-FD	Liberty Oaks - 003711F-Room 11	Sink Tap	First Draw	<0.4
8150-74-FD	Liberty Oaks - 003712B-Room 11	Bubbler	First Draw	<0.4
8150-75-FD	Liberty Oaks - 003713-Room 11-Restroom	Sink Tap	First Draw	<0.4
8150-76-FD	Liberty Oaks - 003717F-Room 204	Sink Tap	First Draw	<0.4
8150-77-FD	Liberty Oaks - 003718B-Room 204	Bubbler	First Draw	<0.4
8150-78-FD	Liberty Oaks - 003719F-Room 206	Sink Tap	First Draw	<0.4
8150-79-FD	Liberty Oaks - 003720B-Room 206	Bubbler	First Draw	<0.4
8150-80-FD	Liberty Oaks - 003721F-Room 210	Sink Tap	First Draw	0.4
8150-81-FD	Liberty Oaks - 003722B-Room 210	Bubbler	First Draw	<0.4
8150-82-FD	Liberty Oaks - 003723F-Room 212	Sink Tap	First Draw	<0.4
8150-83-FD	Liberty Oaks - 003724B-Room 212	Bubbler	First Draw	<0.4
8150-84-FD	Liberty Oaks - 003725F-Room 213	Sink Tap	First Draw	<0.4
8150-85-FD	Liberty Oaks - 003726B-Room 213	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
8150-86-FD	Liberty Oaks - 003727F-Room 211	Sink Tap	First Draw	1.5
8150-87-FD	Liberty Oaks - 003728B-Room 211	Bubbler	First Draw	<0.4
8150-88-FD	Liberty Oaks - 003729F-Room 207	Sink Tap	First Draw	<0.4
8150-89-FD	Liberty Oaks - 003730B-Room 207	Bubbler	First Draw	<0.4
8150-90-FD	Liberty Oaks - 003731F-Room 205	Sink Tap	First Draw	<0.4
8150-91-FD	Liberty Oaks - 003732B-Room 205	Bubbler	First Draw	<0.4
8150-92-FD	Liberty Oaks - 003716-By Room 13-Girls	Drinking Fountain	First Draw	<0.4
8150-93-FD	Liberty Oaks - 003715-By Room 13-Boys	Drinking Fountain	First Draw	<0.4
8150-94-FD	Liberty Oaks - 003715-By Room 13-Boys	Bottle Filler	First Draw	<0.4
8150-95-FD	Liberty Oaks - 003714-Handwashing by Room 13	Sink Tap	First Draw	<0.4
8150-96-FD	Liberty Oaks - 003733F-Room 304	Sink Tap	First Draw	<0.4
8150-97-FD	Liberty Oaks - 003734B-Room 304	Bubbler	First Draw	<0.4
8150-98-FD	Liberty Oaks - 003735F-Room 306	Sink Tap	First Draw	<0.4
8150-99-FD	Liberty Oaks - 003736B-Room 306	Bubbler	First Draw	<0.4
8150-100-FD	Liberty Oaks - 003737F-Room 310	Sink Tap	First Draw	<0.4
8150-101-FD	Liberty Oaks - 003738B-Room 310	Bubbler	First Draw	<0.4
8150-102-FD	Liberty Oaks - 003739F-Room 312	Sink Tap	First Draw	0.4
8150-103-FD	Liberty Oaks - 003740B-Room 312	Bubbler	First Draw	<0.4
8150-104-FD	Liberty Oaks - 003741F-Room 313	Sink Tap	First Draw	0.6
8150-105-FD	Liberty Oaks - 003742B-Room 313	Bubbler	First Draw	<0.4
8150-106-FD	Liberty Oaks - 003743F-Room 311	Sink Tap	First Draw	1
8150-107-FD	Liberty Oaks - 003744B-Room 311	Bubbler	First Draw	<0.4
8150-108-FD	Liberty Oaks - 003745F-Room 307	Sink Tap	First Draw	<0.4
8150-109-FD	Liberty Oaks - 003746B-Room 307	Bubbler	First Draw	<0.4
8150-110-FD	Liberty Oaks - 003747F-Room 305	Sink Tap	First Draw	<0.4
8150-111-FD	Liberty Oaks - 003748B-Room 305	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
8150-112-FD	Liberty Oaks - 003750-Across from 302-Girls	Drinking Fountain	First Draw	<0.4
8150-113-FD	Liberty Oaks - 003750-Across from 302-Girls	Bottle Filler	First Draw	<0.4
8150-114-FD	Liberty Oaks - 003751-Across from Room 302	Sink Tap	First Draw	<0.4
8150-115-FD	Liberty Oaks - 003749-Across from 302-Boys	Drinking Fountain	First Draw	<0.4
8150-116-FD	Liberty Oaks - 003763-LMC	Drinking Fountain	First Draw	<0.4
8150-117-FD	Liberty Oaks - 003762-LMC Restroom	Sink Tap	First Draw	<0.4
8150-118-FD	Liberty Oaks - 003764-Library AV Storage	Sink Tap	First Draw	<0.4
8150-119-FD	Liberty Oaks - 003765F-Room 19	Sink Tap	First Draw	<0.4
8150-120-FD	Liberty Oaks - 003766B-Room 19	Bubbler	First Draw	<0.4

April 30, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
8150-60-FD	Liberty Oaks - 003709B-Room 9	Bubbler	First Draw	<0.4

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A
Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date:	**10/4/2023**
Expiration Date:	**10/4/2025**
License Number:	**211004-300006201**

Paula F. Nickelson
Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



Paula F. Nickelson
Acting Director
t of Health and Senior Services

son City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.

- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

PO Box 47166 Kansas City, MO 64188 • 816-678-7894 • www.axiomservicepros.com

Appendix C
Laboratory Analytical Report

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0074

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 8150 North Farley Avenue

Project / PO Number: 8150 North Farley Avenue
Received: 03/15/2024
Reported: 04/01/2024

Analytical Testing Parameters

Client Sample ID: 8150-1-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-01
Collected By: Bradley Young
Collection Date: 03/13/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 1845	RVV

Client Sample ID: 8150-2-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-02
Collected By: Bradley Young
Collection Date: 03/13/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 1901	RVV

Client Sample ID: 8150-3-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-03
Collected By: Bradley Young
Collection Date: 03/13/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 1917	RVV

Client Sample ID: 8150-4-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-04
Collected By: Bradley Young
Collection Date: 03/13/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 1923	RVV

Client Sample ID: 8150-5-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-05
Collected By: Bradley Young
Collection Date: 03/13/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		03/27/24 0934	03/27/24 1928	RVV

Client Sample ID: 8150-6-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-06
Collected By: Bradley Young
Collection Date: 03/13/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 1934	RVV

Client Sample ID: 8150-7-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-07
Collected By: Bradley Young
Collection Date: 03/13/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 1939	RVV

Client Sample ID: 8150-8-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-08
Collected By: Bradley Young
Collection Date: 03/13/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 1945	RVV

Client Sample ID: 8150-9-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-09
Collected By: Bradley Young
Collection Date: 03/13/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 1950	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-10-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-10
Collected By: Bradley Young
Collection Date: 03/13/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 1956	RVV

Client Sample ID: 8150-11-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-11
Collected By: Bradley Young
Collection Date: 03/13/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2001	RVV

Client Sample ID: 8150-12-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-12
Collected By: Bradley Young
Collection Date: 03/13/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2007	RVV

Client Sample ID: 8150-13-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-13
Collected By: Bradley Young
Collection Date: 03/13/2024 22:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2023	RVV

Client Sample ID: 8150-14-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-14
Collected By: Bradley Young
Collection Date: 03/13/2024 22:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2028	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-15-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-15
Collected By: Bradley Young
Collection Date: 03/13/2024 22:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2034	RVV

Client Sample ID: 8150-16-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-16
Collected By: Bradley Young
Collection Date: 03/13/2024 22:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2039	RVV

Client Sample ID: 8150-17-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-17
Collected By: Bradley Young
Collection Date: 03/13/2024 22:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2045	RVV

Client Sample ID: 8150-18-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-18
Collected By: Bradley Young
Collection Date: 03/13/2024 22:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2050	RVV

Client Sample ID: 8150-19-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-19
Collected By: Bradley Young
Collection Date: 03/13/2024 22:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2056	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-20-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-20
Collected By: Bradley Young
Collection Date: 03/13/2024 22:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2101	RVV

Client Sample ID: 8150-21-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-21
Collected By: Bradley Young
Collection Date: 03/13/2024 22:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.0**	0.4	ppb	2		03/27/24 0934	03/27/24 2128	RVV

Client Sample ID: 8150-22-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-22
Collected By: Bradley Young
Collection Date: 03/13/2024 22:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		03/27/24 0934	03/27/24 2145	RVV

Client Sample ID: 8150-23-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-23
Collected By: Bradley Young
Collection Date: 03/13/2024 22:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		03/27/24 0934	03/27/24 2150	RVV

Client Sample ID: 8150-24-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-24
Collected By: Bradley Young
Collection Date: 03/13/2024 22:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		03/27/24 0934	03/27/24 2156	RVV

Client Sample ID: 8150-25-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-25
Collected By: Bradley Young
Collection Date: 03/13/2024 22:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2201	RVV

Client Sample ID: 8150-26-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-26
Collected By: Bradley Young
Collection Date: 03/13/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		03/27/24 0934	03/27/24 2207	RVV

Client Sample ID: 8150-27-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-27
Collected By: Bradley Young
Collection Date: 03/13/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.4**	0.4	ppb	2		03/27/24 0934	03/27/24 2212	RVV

Client Sample ID: 8150-28-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-28
Collected By: Bradley Young
Collection Date: 03/13/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**11.2**	0.4	ppb	2		03/27/24 0934	03/27/24 2218	RVV

Client Sample ID: 8150-29-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-29
Collected By: Bradley Young
Collection Date: 03/13/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2234	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-30-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-30
Collected By: Bradley Young
Collection Date: 03/13/2024 23:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2239	RVV

Client Sample ID: 8150-31-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-31
Collected By: Bradley Young
Collection Date: 03/13/2024 23:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2245	RVV

Client Sample ID: 8150-32-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-32
Collected By: Bradley Young
Collection Date: 03/13/2024 23:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2250	RVV

Client Sample ID: 8150-33-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-33
Collected By: Bradley Young
Collection Date: 03/13/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2256	RVV

Client Sample ID: 8150-34-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-34
Collected By: Bradley Young
Collection Date: 03/13/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2301	RVV

Client Sample ID: 8150-35-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-35
Collected By: Bradley Young
Collection Date: 03/13/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2307	RVV

Client Sample ID: 8150-36-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-36
Collected By: Bradley Young
Collection Date: 03/13/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2312	RVV

Client Sample ID: 8150-37-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-37
Collected By: Bradley Young
Collection Date: 03/13/2024 23:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2318	RVV

Client Sample ID: 8150-38-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-38
Collected By: Bradley Young
Collection Date: 03/13/2024 23:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2323	RVV

Client Sample ID: 8150-39-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-39
Collected By: Bradley Young
Collection Date: 03/13/2024 23:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2339	RVV

Client Sample ID: 8150-40-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-40
Collected By: Bradley Young
Collection Date: 03/13/2024 23:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/27/24 2345	RVV

Client Sample ID: 8150-41-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-41
Collected By: Bradley Young
Collection Date: 03/13/2024 23:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0001	RVV

Client Sample ID: 8150-42-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-42
Collected By: Bradley Young
Collection Date: 03/13/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0018	RVV

Client Sample ID: 8150-43-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-43
Collected By: Bradley Young
Collection Date: 03/13/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0023	RVV

Client Sample ID: 8150-44-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-44
Collected By: Bradley Young
Collection Date: 03/13/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0029	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-45-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-45
Collected By: Bradley Young
Collection Date: 03/13/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0045	RVV

Client Sample ID: 8150-46-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-46
Collected By: Bradley Young
Collection Date: 03/13/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0050	RVV

Client Sample ID: 8150-47-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-47
Collected By: Bradley Young
Collection Date: 03/13/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0056	RVV

Client Sample ID: 8150-48-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-48
Collected By: Bradley Young
Collection Date: 03/13/2024 23:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0101	RVV

Client Sample ID: 8150-49-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-49
Collected By: Bradley Young
Collection Date: 03/13/2024 23:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0107	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-50-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-50
Collected By: Bradley Young
Collection Date: 03/13/2024 23:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0112	RVV

Client Sample ID: 8150-51-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-51
Collected By: Bradley Young
Collection Date: 03/13/2024 23:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0118	RVV

Client Sample ID: 8150-52-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-52
Collected By: Bradley Young
Collection Date: 03/13/2024 23:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0123	RVV

Client Sample ID: 8150-53-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-53
Collected By: Bradley Young
Collection Date: 03/13/2024 23:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0129	RVV

Client Sample ID: 8150-54-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-54
Collected By: Bradley Young
Collection Date: 03/13/2024 23:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0134	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-55-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-55
Collected By: Bradley Young
Collection Date: 03/13/2024 23:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0151	RVV

Client Sample ID: 8150-56-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-56
Collected By: Bradley Young
Collection Date: 03/13/2024 23:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0156	RVV

Client Sample ID: 8150-57-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-57
Collected By: Bradley Young
Collection Date: 03/13/2024 23:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0202	RVV

Client Sample ID: 8150-58-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-58
Collected By: Bradley Young
Collection Date: 03/13/2024 23:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0207	RVV

Client Sample ID: 8150-59-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-59
Collected By: Bradley Young
Collection Date: 03/13/2024 23:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0213	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-61-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-60
Collected By: Bradley Young
Collection Date: 03/13/2024 23:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0218	RVV

Client Sample ID: 8150-62-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-61
Collected By: Bradley Young
Collection Date: 03/13/2024 23:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.4**	0.4	ppb	2		03/27/24 0934	03/28/24 0235	RVV

Client Sample ID: 8150-63-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-62
Collected By: Bradley Young
Collection Date: 03/13/2024 23:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0302	RVV

Client Sample ID: 8150-64-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-63
Collected By: Bradley Young
Collection Date: 03/13/2024 23:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0307	RVV

Client Sample ID: 8150-65-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-64
Collected By: Bradley Young
Collection Date: 03/13/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0313	RVV

Client Sample ID: 8150-66-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-65
Collected By: Bradley Young
Collection Date: 03/13/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0318	RVV

Client Sample ID: 8150-67-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-66
Collected By: Bradley Young
Collection Date: 03/13/2024 23:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0324	RVV

Client Sample ID: 8150-68-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-67
Collected By: Bradley Young
Collection Date: 03/13/2024 23:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0329	RVV

Client Sample ID: 8150-69-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-68
Collected By: Bradley Young
Collection Date: 03/13/2024 23:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0335	RVV

Client Sample ID: 8150-70-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-69
Collected By: Bradley Young
Collection Date: 03/13/2024 23:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0340	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-71-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-70
Collected By: Bradley Young
Collection Date: 03/13/2024 23:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0346	RVV

Client Sample ID: 8150-72-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-71
Collected By: Bradley Young
Collection Date: 03/13/2024 23:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0402	RVV

Client Sample ID: 8150-73-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-72
Collected By: Bradley Young
Collection Date: 03/13/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0408	RVV

Client Sample ID: 8150-74-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-73
Collected By: Bradley Young
Collection Date: 03/13/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0413	RVV

Client Sample ID: 8150-75-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-74
Collected By: Bradley Young
Collection Date: 03/13/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0419	RVV

Client Sample ID: 8150-76-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-75
Collected By: Bradley Young
Collection Date: 03/13/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0424	RVV

Client Sample ID: 8150-77-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-76
Collected By: Bradley Young
Collection Date: 03/13/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0430	RVV

Client Sample ID: 8150-78-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-77
Collected By: Bradley Young
Collection Date: 03/13/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0435	RVV

Client Sample ID: 8150-79-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-78
Collected By: Bradley Young
Collection Date: 03/13/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0441	RVV

Client Sample ID: 8150-80-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-79
Collected By: Bradley Young
Collection Date: 03/13/2024 23:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		03/27/24 0934	03/28/24 0446	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-81-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-80
Collected By: Bradley Young
Collection Date: 03/13/2024 23:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0452	RVV

Client Sample ID: 8150-82-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-81
Collected By: Bradley Young
Collection Date: 03/13/2024 23:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0519	RVV

Client Sample ID: 8150-83-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-82
Collected By: Bradley Young
Collection Date: 03/13/2024 23:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0535	RVV

Client Sample ID: 8150-84-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-83
Collected By: Bradley Young
Collection Date: 03/13/2024 23:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0541	RVV

Client Sample ID: 8150-85-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-84
Collected By: Bradley Young
Collection Date: 03/13/2024 23:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0546	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-86-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-85
Collected By: Bradley Young
Collection Date: 03/13/2024 23:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		03/27/24 0934	03/28/24 0552	RVV

Client Sample ID: 8150-87-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-86
Collected By: Bradley Young
Collection Date: 03/13/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0557	RVV

Client Sample ID: 8150-88-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-87
Collected By: Bradley Young
Collection Date: 03/13/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/27/24 0934	03/28/24 0614	RVV

Client Sample ID: 8150-89-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-88
Collected By: Bradley Young
Collection Date: 03/13/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1347	RVV

Client Sample ID: 8150-90-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-89
Collected By: Bradley Young
Collection Date: 03/13/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1356	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-91-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-90
Collected By: Bradley Young
Collection Date: 03/13/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1359	RVV

Client Sample ID: 8150-92-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-91
Collected By: Bradley Young
Collection Date: 03/13/2024 23:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1402	RVV

Client Sample ID: 8150-93-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-92
Collected By: Bradley Young
Collection Date: 03/13/2024 23:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1411	RVV

Client Sample ID: 8150-94-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-93
Collected By: Bradley Young
Collection Date: 03/13/2024 23:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1413	RVV

Client Sample ID: 8150-95-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-94
Collected By: Bradley Young
Collection Date: 03/13/2024 23:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1416	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-96-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-95
Collected By: Bradley Young
Collection Date: 03/13/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1419	RVV

Client Sample ID: 8150-97-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-96
Collected By: Bradley Young
Collection Date: 03/13/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1422	RVV

Client Sample ID: 8150-98-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-97
Collected By: Bradley Young
Collection Date: 03/13/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1425	RVV

Client Sample ID: 8150-99-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-98
Collected By: Bradley Young
Collection Date: 03/13/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1428	RVV

Client Sample ID: 8150-100-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-99
Collected By: Bradley Young
Collection Date: 03/13/2024 23:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1431	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-101-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AA
Collected By: Bradley Young
Collection Date: 03/13/2024 23:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1434	RVV

Client Sample ID: 8150-102-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AB
Collected By: Bradley Young
Collection Date: 03/13/2024 23:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		03/28/24 1410	03/29/24 1437	RVV

Client Sample ID: 8150-103-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AC
Collected By: Bradley Young
Collection Date: 03/13/2024 23:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1446	RVV

Client Sample ID: 8150-104-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AD
Collected By: Bradley Young
Collection Date: 03/13/2024 23:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		03/28/24 1410	03/29/24 1449	RVV

Client Sample ID: 8150-105-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AE
Collected By: Bradley Young
Collection Date: 03/13/2024 23:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1452	RVV

Client Sample ID: 8150-106-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AF
Collected By: Bradley Young
Collection Date: 03/13/2024 23:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		03/28/24 1410	03/29/24 1455	RVV

Client Sample ID: 8150-107-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AG
Collected By: Bradley Young
Collection Date: 03/13/2024 23:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1458	RVV

Client Sample ID: 8150-108-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AH
Collected By: Bradley Young
Collection Date: 03/13/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1501	RVV

Client Sample ID: 8150-109-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AI
Collected By: Bradley Young
Collection Date: 03/13/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1510	RVV

Client Sample ID: 8150-110-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AJ
Collected By: Bradley Young
Collection Date: 03/13/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1525	RVV

CERTIFICATE OF ANALYSIS

3HC0074

Client Sample ID: 8150-111-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AK
Collected By: Bradley Young
Collection Date: 03/13/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1528	RVV

Client Sample ID: 8150-112-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AL
Collected By: Bradley Young
Collection Date: 03/13/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1531	RVV

Client Sample ID: 8150-113-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AM
Collected By: Bradley Young
Collection Date: 03/13/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1534	RVV

Client Sample ID: 8150-114-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AN
Collected By: Bradley Young
Collection Date: 03/13/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1537	RVV

Client Sample ID: 8150-115-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AO
Collected By: Bradley Young
Collection Date: 03/13/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1540	RVV

Client Sample ID: 8150-116-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AP
Collected By: Bradley Young
Collection Date: 03/13/2024 23:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1543	RVV

Client Sample ID: 8150-117-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AQ
Collected By: Bradley Young
Collection Date: 03/13/2024 23:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1546	RVV

Client Sample ID: 8150-118-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AR
Collected By: Bradley Young
Collection Date: 03/13/2024 23:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1549	RVV

Client Sample ID: 8150-119-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AS
Collected By: Bradley Young
Collection Date: 03/13/2024 23:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1558	RVV

Client Sample ID: 8150-120-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0074-AT
Collected By: Bradley Young
Collection Date: 03/13/2024 23:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/28/24 1410	03/29/24 1601	RVV

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Victoria Bruck
Field Technician II
04/01/24 13:37

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HC0074
														Short Hold:	
														Rush:	
														Temp: oC	20.0
8150-1-FD	3/13/2024	22:50	Liberty Oaks - Sink Tap - 003767-Room 110(Conference Room)	1	Wt	Grab	X								01
8150-2-FD	3/13/2024	22:50	Liberty Oaks - Sink Tap - 003770-Across from 1D-Staff Bathroom	1	Wt	Grab	X								02
8150-3-FD	3/13/2024	22:51	Liberty Oaks - Sink Tap - 003768-Nurse Office	1	Wt	Grab	X								03
8150-4-FD	3/13/2024	22:51	Liberty Oaks - Sink Tap - 003769-Nurse Office Bathroom	1	Wt	Grab	X								04
8150-5-FD	3/13/2024	22:52	Liberty Oaks - Sink Tap - 003773-Room 2-Far Right	1	Wt	Grab	X								05
8150-6-FD	3/13/2024	22:52	Liberty Oaks - Sink Tap - 003774-Room 2-Right Middle	1	Wt	Grab	X								06
8150-7-FD	3/13/2024	22:52	Liberty Oaks - Sink Tap - 003775-Room 2-Left Middle	1	Wt	Grab	X								07

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vicki Bh	Time:	9:20	
	Time:					

3 H C 0 0 7 4

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
8150-8-FD	3/13/2024	22:52	Liberty Oaks - Sink Tap - 003776-Room 2-Far Left	1	Wt	Grab	X								08
8150-9-FD	3/13/2024	22:53	Liberty Oaks - Sink Tap - 003777-Room 4	1	Wt	Grab	X								09
8150-10-FD	3/13/2024	22:53	Liberty Oaks - Drinking Fountain - 003772-Gym-Left	1	Wt	Grab	X								10
8150-11-FD	3/13/2024	22:53	Liberty Oaks - Drinking Fountain - 003772-Gym-Right	1	Wt	Grab	X								11
8150-12-FD	3/13/2024	22:53	Liberty Oaks - Sink Tap - 003778-Across from Rm 4-Boys-Right	1	Wt	Grab	X								12
8150-13-FD	3/13/2024	22:54	Liberty Oaks - Sink Tap - 003779-Across from Rm 4-Boys-Left	1	Wt	Grab	X								13
8150-14-FD	3/13/2024	22:54	Liberty Oaks - Sink Tap - 003780-Across from Rm 4-Girls-Right	1	Wt	Grab	X								14

LAB USE ONLY: Wk Order #: 3HC0074; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 4

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
8150-15-FD	3/13/2024	22:55	Liberty Oaks - Sink Tap - 003781-Across from Rm 4-Girls-Left	1	Wt	Grab	X								15
8150-16-FD	3/13/2024	22:55	Liberty Oaks - Drinking Fountain - 003771-Outside Gym	1	Wt	Grab	X								16
8150-17-FD	3/13/2024	22:57	Liberty Oaks - Sink Tap - 004619-Kitchen-In Front of Freezer	1	Wt	Grab	X								17
8150-18-FD	3/13/2024	22:57	Liberty Oaks - Sink Tap - 004620-Kitchen-In Front of Freezer	1	Wt	Grab	X								18
8150-19-FD	3/13/2024	22:57	Liberty Oaks - Sink Tap - 004621-Kitchen-In Dishwasher Room	1	Wt	Grab	X								19
8150-20-FD	3/13/2024	22:58	Liberty Oaks - Sink Tap - 004622-Kitchen-Handwashing in Dishwashing Room	1	Wt	Grab	X								20
8150-21-FD	3/13/2024	22:58	Liberty Oaks - Sink Tap - 004909-Kitchen-Dishwashing Room	1	Wt	Grab	X								21

LAB USE ONLY
Wk Order #: 3HC0074
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vicki Burk	Time:	9:20	
	Time:					

3HC0074

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
8150-22-FD	3/13/2024	22:59	Liberty Oaks - Sink Tap - 004623-Kitchen-3 Bay Sink	1	Wt	Grab	X								22
8150-23-FD	3/13/2024	22:59	Liberty Oaks - Sink Tap - 004624-Kitchen-3 Bay Sink	1	Wt	Grab	X								23
8150-24-FD	3/13/2024	22:59	Liberty Oaks - Sink Tap - 004625-Kitchen-3 Bay Sink	1	Wt	Grab	X								24
8150-25-FD	3/13/2024	22:59	Liberty Oaks - Sink Tap - 004626-Kitchen-Handwashing By Kitchen Office	1	Wt	Grab	X								25
8150-26-FD	3/13/2024	23:00	Liberty Oaks - Sink Tap - 004627-Kitchen-Faucet on Kettle	1	Wt	Grab	X								26
8150-27-FD	3/13/2024	23:00	Liberty Oaks - Sink Tap - 004628-Kitchen-By Office	1	Wt	Grab	X								27
8150-28-FD	3/13/2024	23:00	Liberty Oaks - Sink Tap - 004629-Kitchen-By Office	1	Wt	Grab	X								28

LAB USE ONLY
Wk Order #: 3HC0074
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3HC0074

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HC0074
														Short Hold:	
														Rush:	
														Temp: oC	
8150-29-FD	3/13/2024	23:00	Liberty Oaks - Sink Tap - 004631-Kitchen-Restroom	1	Wt	Grab	X								29
8150-30-FD	3/13/2024	23:01	Liberty Oaks - Sink Tap - 004632-Kitchen-Serving Line	1	Wt	Grab	X								30
8150-31-FD	3/13/2024	23:01	Liberty Oaks - Sink Tap - 004630-Kitchen-Handwashing Next to Bathroom	1	Wt	Grab	X								31
8150-32-FD	3/13/2024	23:01	Liberty Oaks - Ice Machine - 0004910-Kitchen	1	Wt	Grab	X								32
8150-33-FD	3/13/2024	23:03	Liberty Oaks - Drinking Fountain - 001973-Next to Room 8-Girls	1	Wt	Grab	X								33
8150-34-FD	3/13/2024	23:03	Liberty Oaks - Bottle Filler - 001973F-By Room 8	1	Wt	Grab	X								34
8150-35-FD	3/13/2024	23:03	Liberty Oaks - Drinking Fountain - 001974-Next to Room 8-Boys	1	Wt	Grab	X								35

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				3/15/24		
	Time:		Vinti BK	Time:		
				9:20		

3HC0074

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HC0074
														Short Hold:	
														Rush:	
														Temp:	oC
8150-36-FD	3/13/2024	23:03	Liberty Oaks - Sink Tap - 001975F-Bathroom by 8	1	Wt	Grab	X								36
8150-37-FD	3/13/2024	23:04	Liberty Oaks - Sink Tap - 001976-Room 100	1	Wt	Grab	X								37
8150-38-FD	3/13/2024	23:04	Liberty Oaks - Sink Tap - 001977-Staff Restroom by 100	1	Wt	Grab	X								38
8150-39-FD	3/13/2024	23:05	Liberty Oaks - Sink Tap - 001979F-Room 104	1	Wt	Grab	X								39
8150-40-FD	3/13/2024	23:05	Liberty Oaks - Bubbler - 001978B-Room 104	1	Wt	Grab	X								40
8150-41-FD	3/13/2024	23:05	Liberty Oaks - Sink Tap - 001980-Room 104-Bathroom	1	Wt	Grab	X								41
8150-42-FD	3/13/2024	23:06	Liberty Oaks - Sink Tap - 001981F-Room 106-Bathroom	1	Wt	Grab	X								42

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 4

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC0074
														Short Hold:	
														Rush:	
														Temp: oC	
8150-43-FD	3/13/2024	23:06	Liberty Oaks - Bubbler - 001982B-Room 106	1	Wt	Grab	X								43
8150-44-FD	3/13/2024	23:06	Liberty Oaks - Sink Tap - 001983F-Room 106	1	Wt	Grab	X								44
8150-45-FD	3/13/2024	23:07	Liberty Oaks - Sink Tap - 001984F-Room 110-Bathroom	1	Wt	Grab	X								45
8150-46-FD	3/13/2024	23:07	Liberty Oaks - Bubbler - 001985B-Room 110	1	Wt	Grab	X								46
8150-47-FD	3/13/2024	23:07	Liberty Oaks - Sink Tap - 001986F-Room 110	1	Wt	Grab	X								47
8150-48-FD	3/13/2024	23:08	Liberty Oaks - Sink Tap - 001988F-Room 112	1	Wt	Grab	X								48
8150-49-FD	3/13/2024	23:08	Liberty Oaks - Bubbler - 001989B-Room 112	1	Wt	Grab	X								49

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vinti Patel	Time:	9:20	
	Time:					

3HC0074

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HC0074
														Short Hold:	
														Rush:	
														Temp: oC	
8150-50-FD	3/13/2024	23:08	Liberty Oaks - Sink Tap - 001987-Room 112-Bathroom	1	Wt	Grab	X								50
8150-51-FD	3/13/2024	23:09	Liberty Oaks - Sink Tap - 001990F-Room 113	1	Wt	Grab	X								51
8150-52-FD	3/13/2024	23:09	Liberty Oaks - Bubbler - 003701B-Room 113	1	Wt	Grab	X								52
8150-53-FD	3/13/2024	23:09	Liberty Oaks - Sink Tap - 003702F-Room 111	1	Wt	Grab	X								53
8150-54-FD	3/13/2024	23:09	Liberty Oaks - Bubbler - 003703F-Room 111	1	Wt	Grab	X								54
8150-55-FD	3/13/2024	23:10	Liberty Oaks - Sink Tap - 003704F-Room 107	1	Wt	Grab	X								55
8150-56-FD	3/13/2024	23:10	Liberty Oaks - Bubbler - 003705B-Room 107	1	Wt	Grab	X								56

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vinita Patel	Time:	9:20	
	Time:					

3HC0074

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HC0074	
														Short Hold:	
														Rush:	
														Temp: oC	
8150-57-FD	3/13/2024	23:10	Liberty Oaks - Sink Tap - 003706F-Room 105	1	Wt	Grab	X								57
8150-58-FD	3/13/2024	23:10	Liberty Oaks - Bubbler - 003707B-Room 105	1	Wt	Grab	X								58
8150-59-FD	3/13/2024	23:12	Liberty Oaks - Sink Tap - 003708F-Room 9-Bathroom	1	Wt	Grab	X								59
8150-61-FD	3/13/2024	23:11	Liberty Oaks - Sink Tap - 003710F-Room 9	1	Wt	Grab	X								60
8150-62-FD	3/13/2024	23:12	Liberty Oaks - Sink Tap - 003753F-Room 10I	1	Wt	Grab	X								61
8150-63-FD	3/13/2024	23:12	Liberty Oaks - Sink Tap - 003754B-Room 10I	1	Wt	Grab	X								62
8150-64-FD	3/13/2024	23:12	Liberty Oaks - Sink Tap - 003752-Room 10-Staff Bathroom	1	Wt	Grab	X								63

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vicki Burk	Time:	9:20	
	Time:					

3 H C 0 0 7 4

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
8150-65-FD	3/13/2024	23:13	Liberty Oaks - Sink Tap - 003755F-Room 10H	1	Wt	Grab	X								64
8150-66-FD	3/13/2024	23:13	Liberty Oaks - Bubbler - 003756B-Room 10H	1	Wt	Grab	X								65
8150-67-FD	3/13/2024	23:14	Liberty Oaks - Sink Tap - 003757-Room 10F	1	Wt	Grab	X								66
8150-68-FD	3/13/2024	23:14	Liberty Oaks - Sink Tap - 003758-Room 10G	1	Wt	Grab	X								67
8150-69-FD	3/13/2024	23:15	Liberty Oaks - Sink Tap - 003760F-Room 10D	1	Wt	Grab	X								68
8150-70-FD	3/13/2024	23:15	Liberty Oaks - Bubbler - 003761B-Room 10D	1	Wt	Grab	X								69
8150-71-FD	3/13/2024	23:16	Liberty Oaks - Drinking Fountain - 003759B-Room 10-Left	1	Wt	Grab	X								70

LAB USE ONLY
Wk Order #: 3HC0074
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				3/15/24		
	Time:			Time:		
				9:20		

3 H C 0 0 7 4

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
8150-72-FD	3/13/2024	23:16	Liberty Oaks - Drinking Fountain - 003759-Room 10-Right	1	Wt	Grab	X								71
8150-73-FD	3/13/2024	23:17	Liberty Oaks - Sink Tap - 003711F-Room 11	1	Wt	Grab	X								72
8150-74-FD	3/13/2024	23:17	Liberty Oaks - Bubbler - 003712B-Room 11	1	Wt	Grab	X								73
8150-75-FD	3/13/2024	23:17	Liberty Oaks - Sink Tap - 003713-Room 11-Bathroom	1	Wt	Grab	X								74
8150-76-FD	3/13/2024	23:19	Liberty Oaks - Sink Tap - 003717F-Room 204	1	Wt	Grab	X								75
8150-77-FD	3/13/2024	23:19	Liberty Oaks - Bubbler - 003718B-Room 204	1	Wt	Grab	X								76
8150-78-FD	3/13/2024	23:19	Liberty Oaks - Sink Tap - 003719F-Room 206	1	Wt	Grab	X								77

LAB USE ONLY: Wk Order #: 3HC0074; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
	Time:			Time:	9:20	

3 H C 0 0 7 4

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC0074
														Short Hold:	
														Rush:	
														Temp: oC	
8150-79-FD	3/13/2024	23:19	Liberty Oaks - Bubbler - 003720B-Room 206	1	Wt	Grab	X								78
8150-80-FD	3/13/2024	23:20	Liberty Oaks - Sink Tap - 003721F-Room 210	1	Wt	Grab	X								79
8150-81-FD	3/13/2024	23:20	Liberty Oaks - Bubbler - 003722B-Room 210	1	Wt	Grab	X								80
8150-82-FD	3/13/2024	23:20	Liberty Oaks - Sink Tap - 003723F-Room 212	1	Wt	Grab	X								81
8150-83-FD	3/13/2024	23:20	Liberty Oaks - Bubbler - 003724B-Room 212	1	Wt	Grab	X								82
8150-84-FD	3/13/2024	23:21	Liberty Oaks - Sink Tap - 003725F-Room 213	1	Wt	Grab	X								83
8150-85-FD	3/13/2024	23:21	Liberty Oaks - Bubbler - 003726B-Room 213	1	Wt	Grab	X								84

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vinita Patel			
	Time:			Time:	9:20	

3HC0074

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC00074
														Short Hold:	
														Rush:	
														Temp: oC	
8150-86-FD	3/13/2024	23:21	Liberty Oaks - Sink Tap - 003727F-Room 211	1	Wt	Grab	X								85
8150-87-FD	3/13/2024	23:22	Liberty Oaks - Bubbler - 003728B-Room 211	1	Wt	Grab	X								86
8150-88-FD	3/13/2024	23:22	Liberty Oaks - Sink Tap - 003729F-Room 207	1	Wt	Grab	X								87
8150-89-FD	3/13/2024	23:22	Liberty Oaks - Bubbler - 003730B-Room 207	1	Wt	Grab	X								88
8150-90-FD	3/13/2024	23:22	Liberty Oaks - Sink Tap - 003731F-Room 205	1	Wt	Grab	X								89
8150-91-FD	3/13/2024	23:22	Liberty Oaks - Bubbler - 003732B-Room 205	1	Wt	Grab	X								90
8150-92-FD	3/13/2024	23:24	Liberty Oaks - Drinking Fountain - 003716-By Room 13-Girls Side	1	Wt	Grab	X								91

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vatin Bark	Time:	9:20	
	Time:					

3HC00074

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC0074
														Short Hold:	
														Rush:	
														Temp: oC	
8150-93-FD	3/13/2024	23:24	Liberty Oaks - Drinking Fountain - 003715-By Room 13-Boys	1	Wt	Grab	X								92
8150-94-FD	3/13/2024	23:24	Liberty Oaks - Bottle Filler - 003715-By Room 13-Boys	1	Wt	Grab	X								93
8150-95-FD	3/13/2024	23:24	Liberty Oaks - Sink Tap - 003714-Handwashing by Room 13	1	Wt	Grab	X								94
8150-96-FD	3/13/2024	23:27	Liberty Oaks - Sink Tap - 003733F-Room 304	1	Wt	Grab	X								95
8150-97-FD	3/13/2024	23:27	Liberty Oaks - Bubbler - 003734B-Room 304	1	Wt	Grab	X								96
8150-98-FD	3/13/2024	23:27	Liberty Oaks - Sink Tap - 003735F-Room 306	1	Wt	Grab	X								97
8150-99-FD	3/13/2024	23:27	Liberty Oaks - Bubbler - 003736B-Room 306	1	Wt	Grab	X								98

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vicki Bell	Time:	9:20	
	Time:					

3 H C 0 0 7 4

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
8150-100-FD	3/13/2024	23:28	Liberty Oaks - Sink Tap - 003737F-Room 310	1	Wt	Grab	X								99
8150-101-FD	3/13/2024	23:28	Liberty Oaks - Bubbler - 003738B-Room 310	1	Wt	Grab	X								AA
8150-102-FD	3/13/2024	23:28	Liberty Oaks - Sink Tap - 003739F-Room 312	1	Wt	Grab	X								AB
8150-103-FD	3/13/2024	23:28	Liberty Oaks - Bubbler - 003740B-Room 312	1	Wt	Grab	X								AC
8150-104-FD	3/13/2024	23:29	Liberty Oaks - Sink Tap - 003741F-Room 313	1	Wt	Grab	X								AD
8150-105-FD	3/13/2024	23:29	Liberty Oaks - Bubbler - 003742B-Room 313	1	Wt	Grab	X								AE
8150-106-FD	3/13/2024	23:29	Liberty Oaks - Sink Tap - 003743F-Room 311	1	Wt	Grab	X								& AF

LAB USE ONLY
Wk Order #: 3HC0074
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vicki Bk	Time:	9:20	
	Time:					

3 H C 0 0 7 4

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HC0074	
														Short Hold:	
														Rush:	
														Temp: oC	
8150-107-FD	3/13/2024	23:29	Liberty Oaks - Bubbler - 003744B-Room 311	1	Wt	Grab	X								AG
8150-108-FD	3/13/2024	23:30	Liberty Oaks - Sink Tap - 003745F-Room 307	1	Wt	Grab	X								AH
8150-109-FD	3/13/2024	23:30	Liberty Oaks - Bubbler - 003746B-Room 307	1	Wt	Grab	X								AI
8150-110-FD	3/13/2024	23:30	Liberty Oaks - Sink Tap - 003747F-Room 305	1	Wt	Grab	X								AJ
8150-111-FD	3/13/2024	23:30	Liberty Oaks - Bubbler - 003748B-Room 305	1	Wt	Grab	X								AK
8150-112-FD	3/13/2024	23:32	Liberty Oaks - Drinking Fountain - 003750-Across from 302(Girls)	1	Wt	Grab	X								AL
8150-113-FD	3/13/2024	23:32	Liberty Oaks - Bottle Filler - 003750-Across from 302(Girls)	1	Wt	Grab	X								AM

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Vinti Bhatt	3/15/24		
	Time:			Time:		
				9:20		

3 H C 0 0 7 4

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC0074
														Short Hold:	
														Rush:	
														Temp: oC	
8150-114-FD	3/13/2024	23:32	Liberty Oaks - Sink Tap - 003751-Across from Room 302	1	Wt	Grab	X								AN
8150-115-FD	3/13/2024	23:32	Liberty Oaks - Drinking Fountain - 003749-Across from 302(Boys)	1	Wt	Grab	X								AO
8150-116-FD	3/13/2024	23:34	Liberty Oaks - Drinking Fountain - 003763-LMC	1	Wt	Grab	X								AP
8150-117-FD	3/13/2024	23:34	Liberty Oaks - Sink Tap - 003762-LMC Restroom	1	Wt	Grab	X								AQ
8150-118-FD	3/13/2024	23:35	Liberty Oaks - Sink Tap - 003764-Library AV Storage	1	Wt	Grab	X								AR
8150-119-FD	3/13/2024	23:36	Liberty Oaks - Sink Tap - 003765F-Room 19	1	Wt	Grab	X								AS
8150-120-FD	3/13/2024	23:36	Liberty Oaks - Bubbler - 003766B-Room 19	1	Wt	Grab	X								AT

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
	Time:			Time:	9:20	

3HC0074

AXIOM Service Professionals

PM: Carolyn Jackson

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HE0033

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: Liberty Oaks

Project / PO Number: Liberty Oaks
Received: 05/02/2024
Reported: 05/10/2024

Work Order Special Information

Young, Bradly
Liberty Oaks

Analytical Testing Parameters

Client Sample ID:	8150-60-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HE0033-01	**Collection Date:**	04/30/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0259	RVV

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
05/10/24 13:19

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	~~Jeff Hurst~~ Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Liberty Oaks Elementary	CO. NAME:		CO. NAME:	
ADDRESS:	8150 North Farley Avenue	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
8150-60-FD	4/30/2024	23:07	Liberty Oaks - Bubbler - 003709B-Room 9	1	Wt	Grab	X								3HE0033 01

LAB USE ONLY:
Wk Order #: 3HE0033
Short Hold:
Rush:
Temp: oC 20.0

3 H E 0 0 3 3

AXIOM Service Professionals
PM: Carolyn Jackson

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	05/02/24	
			Crystal Green			
	Time:			Time:	12:00	


Appendix D
Photo Log



3/13/2024 - 8150-1 - Liberty Oaks - 003767-Room 1B (Conference Room)



3/13/2024 - 8150-2 - Liberty Oaks - 003770-Across from 1D-Staff Restroom

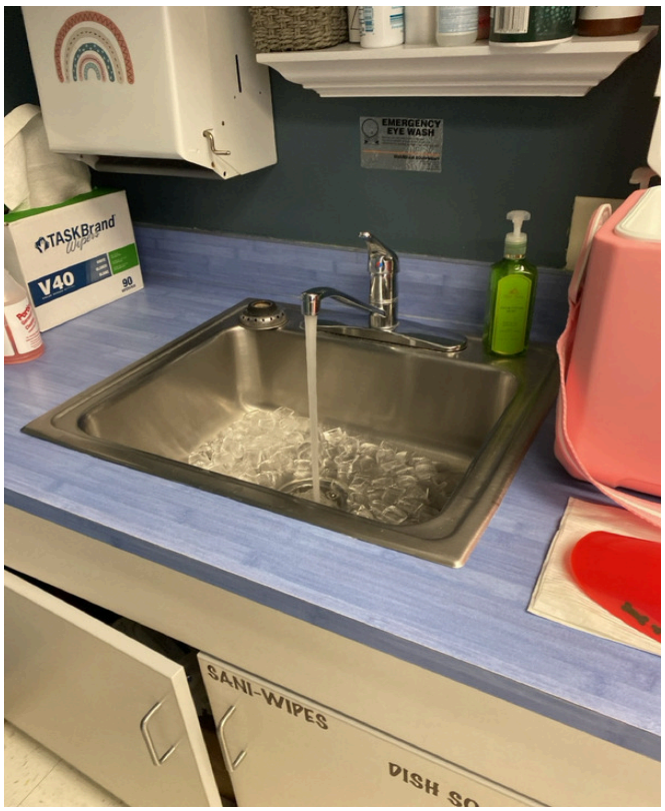

3/13/2024 - 8150-3 - Liberty Oaks - 003768-Nurse's Office



3/13/2024 - 8150-4 - Liberty Oaks - 003769-Nurse's Office Restroom



3/13/2024 - 8150-5 - Liberty Oaks - 003773-Room 2-Far Right



3/13/2024 - 8150-6 - Liberty Oaks - 003774-Room 2-Right Middle



3/13/2024 - 8150-7 - Liberty Oaks - 003775-Room 2-Left Middle



3/13/2024 - 8150-8 - Liberty Oaks - 003776-Room 2-Far Left



3/13/2024 - 8150-9 - Liberty Oaks - 003777-Room 4



3/13/2024 - 8150-10 - Liberty Oaks - 003772-Gym-Left



3/13/2024 - 8150-11 - Liberty Oaks - 003772-Gym-Right



3/13/2024 - 8150-12 - Liberty Oaks - 003778-Across from Room 4-Boys-Right



3/13/2024 - 8150-13 - Liberty Oaks - 003779-
Across from Room 4-Boys-Left



3/13/2024 - 8150-14 - Liberty Oaks - 003780-
Across from Room 4-Girls-Right



3/13/2024 - 8150-15 - Liberty Oaks - 003781-
Across from Room 4-Girls-Left



3/13/2024 - 8150-16 - Liberty Oaks - 003771-
Outside Gym



3/13/2024 - 8150-17 - Liberty Oaks - 004619-Kitchen-In Front of Freezer



3/13/2024 - 8150-18 - Liberty Oaks - 004620-Kitchen-In Front of Freezer



3/13/2024 - 8150-19 - Liberty Oaks - 004621-Kitchen-In Dishwashing Room



3/13/2024 - 8150-20 - Liberty Oaks - 004622-Kitchen-Handwashing in Dishwashing Room



3/13/2024 - 8150-21 - Liberty Oaks - 004909-Kitchen-Dishwashing Room



3/13/2024 - 8150-22 - Liberty Oaks - 004623-Kitchen-Three Bay Sink



3/13/2024 - 8150-23 - Liberty Oaks - 004624-Kitchen-Three Bay Sink



3/13/2024 - 8150-24 - Liberty Oaks - 004625-Kitchen-Three Bay Sink



3/13/2024 - 8150-25 - Liberty Oaks - 004626-Kitchen-Handwashing By Kitchen Office



3/13/2024 - 8150-26 - Liberty Oaks - 004627-Kitchen-Faucet on Kettle



3/13/2024 - 8150-27 - Liberty Oaks - 004628-Kitchen-By Office



3/13/2024 - 8150-28 - Liberty Oaks - 004629-Kitchen-By Office



3/13/2024 - 8150-29 - Liberty Oaks - 004631-Kitchen-Restroom



3/13/2024 - 8150-30 - Liberty Oaks - 004632-Kitchen-Serving Line



3/13/2024 - 8150-31 - Liberty Oaks - 004630-Kitchen-Handwashing Next to Restroom



3/13/2024 - 8150-32 - Liberty Oaks - 0004910-Kitchen



3/13/2024 - 8150-33 - Liberty Oaks - 001973-Next to Room 8-Girls



3/13/2024 - 8150-34 - Liberty Oaks - 001973F-By Room 8



3/13/2024 - 8150-35 - Liberty Oaks - 001974-Next to Room 8-Boys



3/13/2024 - 8150-36 - Liberty Oaks - 001975F-Restroom by 8



3/13/2024 - 8150-37 - Liberty Oaks - 001976-Room 100



3/13/2024 - 8150-38 - Liberty Oaks - 001977-Staff Restroom by 100



3/13/2024 - 8150-39 - Liberty Oaks - 001979F-Room 104



3/13/2024 - 8150-40 - Liberty Oaks - 001978B-Room 104



3/13/2024 - 8150-41 - Liberty Oaks - 001980-Room 104-Restroom



3/13/2024 - 8150-42 - Liberty Oaks - 001981F-Room 106-Restroom



3/13/2024 - 8150-42 - Liberty Oaks - 001981F-Room 106-Restroom



3/13/2024 - 8150-43 - Liberty Oaks - 001982B-Room 106



3/13/2024 - 8150-44 - Liberty Oaks - 001983F-Room 106



3/13/2024 - 8150-45 - Liberty Oaks - 001984F-Room 110-Restroom



3/13/2024 - 8150-46 - Liberty Oaks - 001985B-Room 110



3/13/2024 - 8150-47 - Liberty Oaks - 001986F-Room 110



3/13/2024 - 8150-48 - Liberty Oaks - 001988F-Room 112



3/13/2024 - 8150-49 - Liberty Oaks - 001989B-Room 112



3/13/2024 - 8150-50 - Liberty Oaks - 001987-Room 112-Restroom



3/13/2024 - 8150-51 - Liberty Oaks - 001990F-Room 113



3/13/2024 - 8150-52 - Liberty Oaks - 003701B-Room 113



3/13/2024 - 8150-53 - Liberty Oaks - 003702F-Room 111



3/13/2024 - 8150-53 - Liberty Oaks - 003702F-Room 111



3/13/2024 - 8150-54 - Liberty Oaks - 003703F-Room 111



3/13/2024 - 8150-54 - Liberty Oaks - 003703F- Room 111



3/13/2024 - 8150-55 - Liberty Oaks - 003704F- Room 107



3/13/2024 - 8150-56 - Liberty Oaks - 003705B- Room 107




3/13/2024 - 8150-57 - Liberty Oaks - 003706F- Room 105



3/13/2024 - 8150-58 - Liberty Oaks - 003707B-Room 105



3/13/2024 - 8150-59 - Liberty Oaks - 003708F-Room 9-Restroom

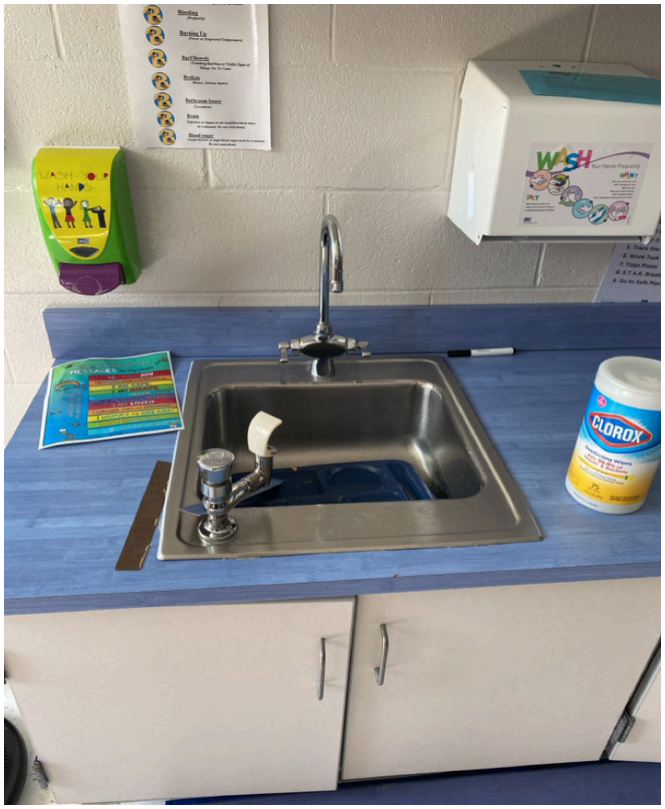

3/13/2024 - 8150-61 - Liberty Oaks - 003710F-Room 9



3/13/2024 - 8150-62 - Liberty Oaks - 003753F-Room 10l



3/13/2024 - 8150-63 - Liberty Oaks - 003754B-Room 10I




3/13/2024 - 8150-64 - Liberty Oaks - 003752-Room 10-Staff Restroom



3/13/2024 - 8150-65 - Liberty Oaks - 003755F-Room 10H



3/13/2024 - 8150-66 - Liberty Oaks - 003756B-Room 10H

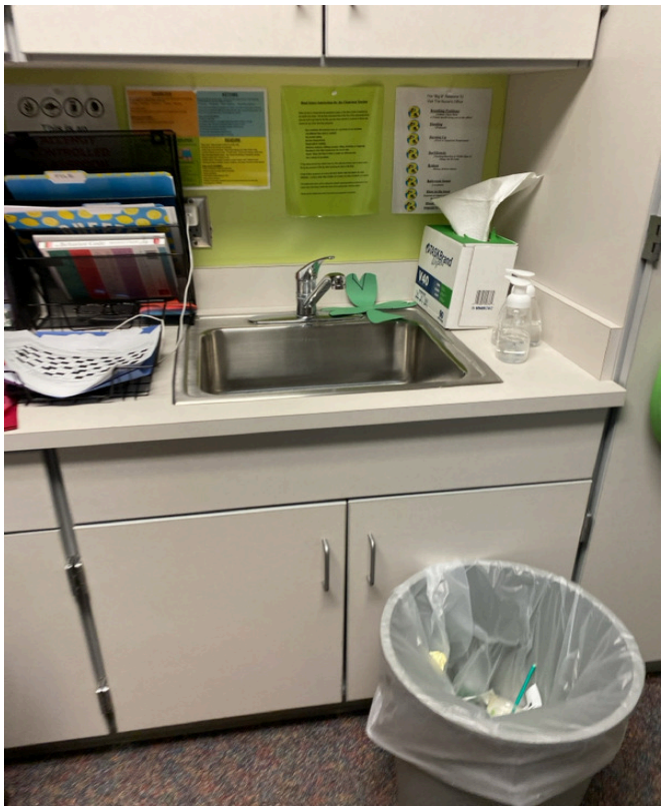

3/13/2024 - 8150-67 - Liberty Oaks - 003757-Room 10F



3/13/2024 - 8150-68 - Liberty Oaks - 003758-Room 10G



3/13/2024 - 8150-69 - Liberty Oaks - 003760F-Room 10D



3/13/2024 - 8150-70 - Liberty Oaks - 003761B-Room 10D



3/13/2024 - 8150-71 - Liberty Oaks - 003759B-Room 10-Left



3/13/2024 - 8150-72 - Liberty Oaks - 003759-Room 10-Right



3/13/2024 - 8150-73 - Liberty Oaks - 003711F-Room 11




3/13/2024 - 8150-74 - Liberty Oaks - 003712B-Room 11



3/13/2024 - 8150-75 - Liberty Oaks - 003713-Room 11-Restroom



3/13/2024 - 8150-76 - Liberty Oaks - 003717F-Room 204

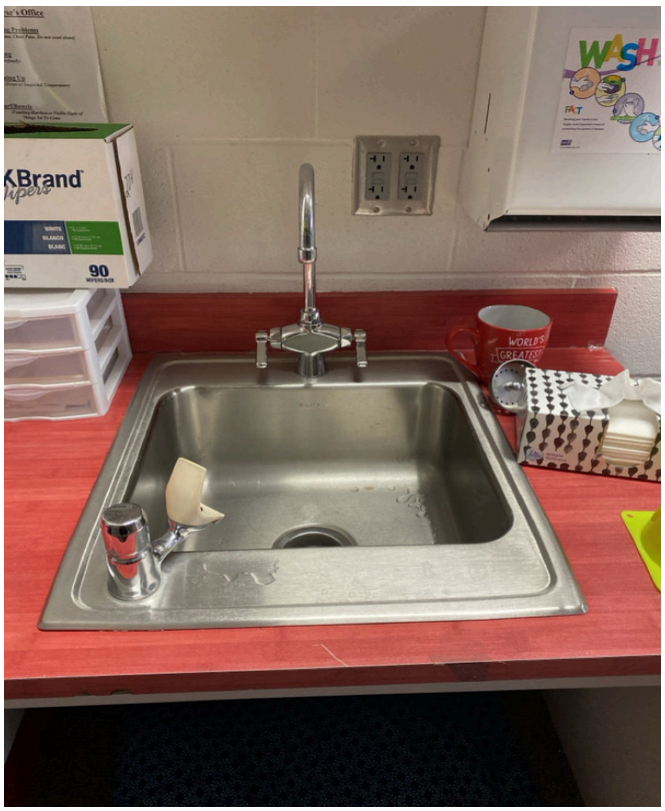

3/13/2024 - 8150-77 - Liberty Oaks - 003718B-Room 204



3/13/2024 - 8150-78 - Liberty Oaks - 003719F-Room 206



3/13/2024 - 8150-79 - Liberty Oaks - 003720B-Room 206



3/13/2024 - 8150-80 - Liberty Oaks - 003721F-Room 210



3/13/2024 - 8150-81 - Liberty Oaks - 003722B-Room 210



3/13/2024 - 8150-82 - Liberty Oaks - 003723F-Room 212



3/13/2024 - 8150-83 - Liberty Oaks - 003724B- Room 212



3/13/2024 - 8150-84 - Liberty Oaks - 003725F- Room 213



3/13/2024 - 8150-85 - Liberty Oaks - 003726B- Room 213



3/13/2024 - 8150-86 - Liberty Oaks - 003727F- Room 211



3/13/2024 - 8150-87 - Liberty Oaks - 003728B- Room 211



3/13/2024 - 8150-88 - Liberty Oaks - 003729F- Room 207



3/13/2024 - 8150-89 - Liberty Oaks - 003730B- Room 207



3/13/2024 - 8150-90 - Liberty Oaks - 003731F- Room 205



3/13/2024 - 8150-91 - Liberty Oaks - 003732B-Room 205



3/13/2024 - 8150-92 - Liberty Oaks - 003716-By Room 13-Girls



3/13/2024 - 8150-93 - Liberty Oaks - 003715-By Room 13-Boys



3/13/2024 - 8150-94 - Liberty Oaks - 003715-By Room 13-Boys



3/13/2024 - 8150-96 - Liberty Oaks - 003733F-Room 304



3/13/2024 - 8150-97 - Liberty Oaks - 003734B-Room 304



3/13/2024 - 8150-98 - Liberty Oaks - 003735F-Room 306



3/13/2024 - 8150-99 - Liberty Oaks - 003736B-Room 306



3/13/2024 - 8150-100 - Liberty Oaks - 003737F-Room 310




3/13/2024 - 8150-101 - Liberty Oaks - 003738B-Room 310



3/13/2024 - 8150-102 - Liberty Oaks - 003739F-Room 312




3/13/2024 - 8150-103 - Liberty Oaks - 003740B-Room 312

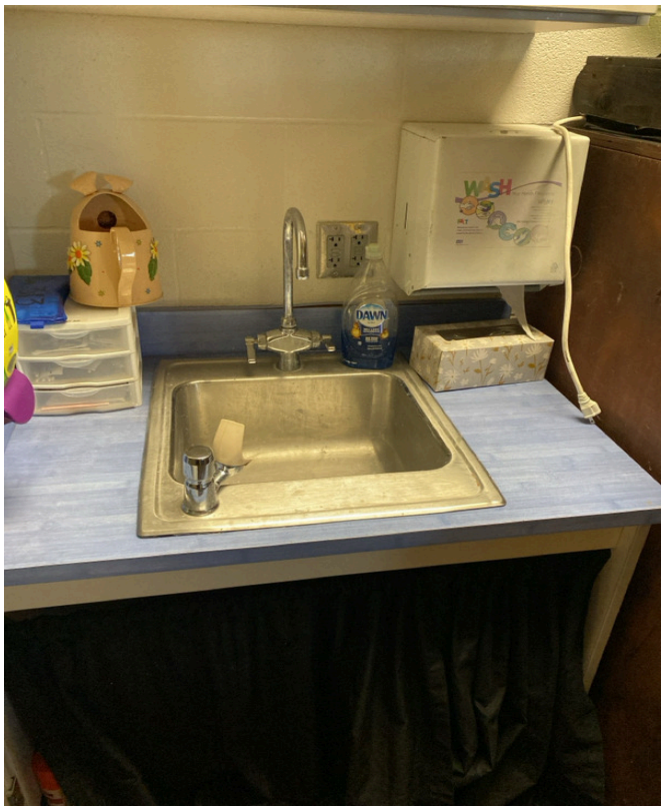


3/13/2024 - 8150-104 - Liberty Oaks - 003741F-Room 313




3/13/2024 - 8150-105 - Liberty Oaks - 003742B-Room 313

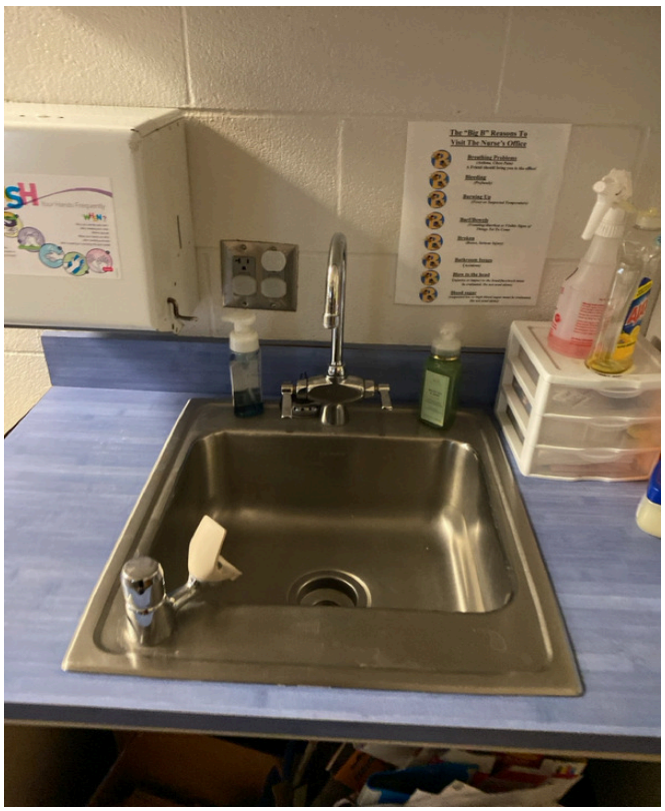


3/13/2024 - 8150-106 - Liberty Oaks - 003743F-Room 311

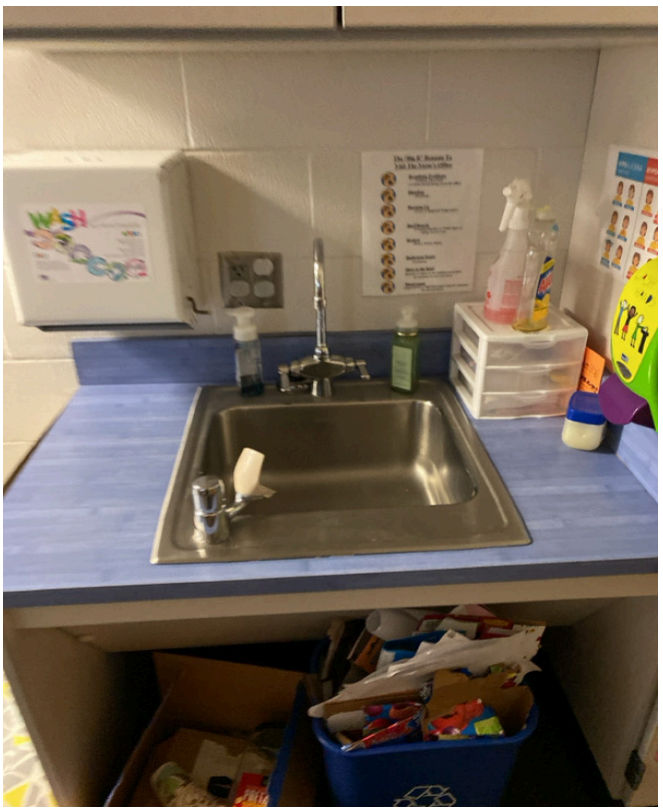

3/13/2024 - 8150-107 - Liberty Oaks - 003744B-Room 311

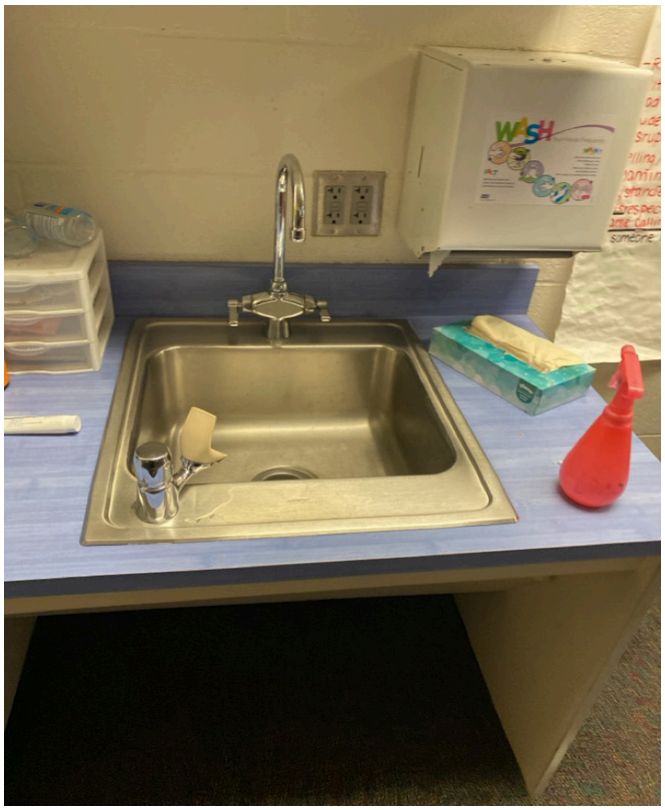


3/13/2024 - 8150-108 - Liberty Oaks - 003745F-Room 307

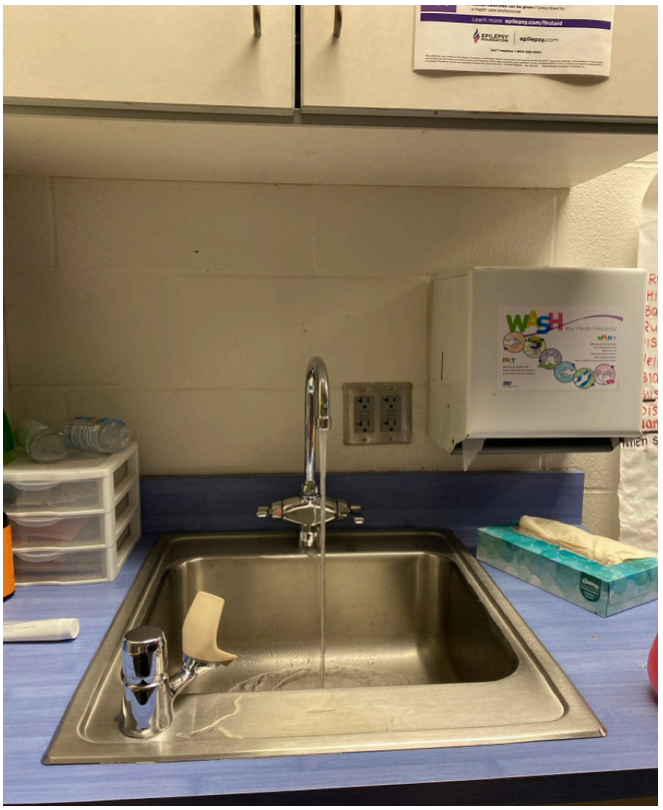

3/13/2024 - 8150-109 - Liberty Oaks - 003746B-Room 307



3/13/2024 - 8150-110 - Liberty Oaks - 003747F-Room 305

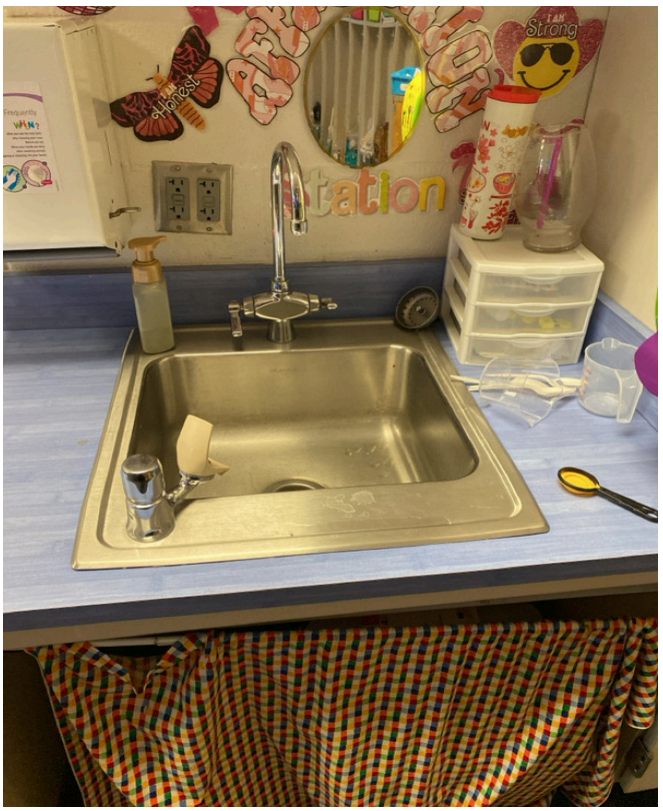

3/13/2024 - 8150-111 - Liberty Oaks - 003748B-Room 305



3/13/2024 - 8150-112 - Liberty Oaks - 003750-Across from 302-Girls



3/13/2024 - 8150-113 - Liberty Oaks - 003750-Across from 302-Girls



3/13/2024 - 8150-114 - Liberty Oaks - 003751-Across from Room 302



3/13/2024 - 8150-115 - Liberty Oaks - 003749-Across from 302-Boys



3/13/2024 - 8150-116 - Liberty Oaks - 003763-LMC



3/13/2024 - 8150-117 - Liberty Oaks - 003762-LMC Restroom



3/13/2024 - 8150-118 - Liberty Oaks - 003764-Library AV Storage



3/13/2024 - 8150-119 - Liberty Oaks - 003765F-Room 19



3/13/2024 - 8150-120 - Liberty Oaks - 003766B-Room 19




4/30/2024 - 8150-60 - Liberty Oaks - 003709B-Room 9

Appendix E
Source Identification Diagram

ASP was provided sample locations by
Liberty School District

Liberty Oaks Elementary
8150 N. Farley
Kansas City, Mo 64158
Phone: 816.736.5600

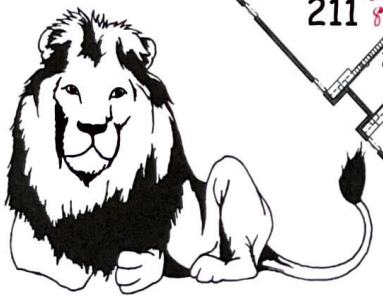

Map Design by: Curt Laven

Last Updated: 08/26/2022