



May 23, 2024

Steve Aldrich
Director of Facilities and Grounds
Liberty School District
801 Kent Street
Liberty, Missouri 64068

Project: Limited Lead in Drinking Water Testing
Address: 9600 Northeast 79th Street, Kansas City, Missouri 64158

Mr. Steve Aldrich

On March 12, 2024 and April 30, 2024, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 68 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of "lead free" to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of "lead free" as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: <https://www.epa.gov/dwreginfo/lead-and-copper-rule>

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.

Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school's buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in **red text**.

March 12, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9600-1-FD	ECC - 003782B-Next to 408-Left	Drinking Fountain	First Draw	0.6
9600-2-FD	ECC - 003782B-Next to 408-Right	Drinking Fountain	First Draw	1.1
9600-3-FD	ECC - 003783-Boys Restroom by 408-Left	Sink Tap	First Draw	0.8
9600-4-FD	ECC - 003784-Boys Restroom by 408-Middle	Sink Tap	First Draw	<0.4
9600-5-FD	ECC - 003785-Boys Restroom by 408-Right	Sink Tap	First Draw	<0.4
9600-6-FD	ECC - 003786-Girls Restroom by 408-Left	Sink Tap	First Draw	<0.4
9600-7-FD	ECC - 003787-Girls Restroom by 408-Middle	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9600-8-FD	ECC - 003788-Girls Restroom by 408-Right	Sink Tap	First Draw	<0.4
9600-9-FD	ECC - 003789-Across from Main Office	Sink Tap	First Draw	<0.4
9600-10-FD	ECC - 003790-Room 400-Staff Restroom	Sink Tap	First Draw	<0.4
9600-11-FD	ECC - 003791-Room 400	Sink Tap	First Draw	0.9
9600-12-FD	ECC - 002023-Between 200-201	Sink Tap	First Draw	<0.4
9600-13-FD	ECC - 002024-Room 201	Sink Tap	First Draw	1.4
9600-14-FD	ECC - 002025-Between 201-203-Right	Sink Tap	First Draw	<0.4
9600-15-FD	ECC - 002026-Between 201-203-Left	Sink Tap	First Draw	<0.4
9600-16-FD	ECC - 002027-Room 203	Sink Tap	First Draw	<0.4
9600-17-FD	ECC - 002028-Between 203-205	Sink Tap	First Draw	<0.4
9600-18-FD	ECC - 002029-Room 205	Sink Tap	First Draw	<0.4
9600-19-FD	ECC - 002030-Between 205-206-Right	Sink Tap	First Draw	<0.4
9600-20-FD	ECC - 002031-Between 205-206-Left	Sink Tap	First Draw	<0.4
9600-21-FD	ECC - 002032-Room 206	Sink Tap	First Draw	1.4
9600-22-FD	ECC - 002033-Room 207	Sink Tap	First Draw	<0.4
9600-23-FD	ECC - 002034-Room 207	Sink Tap	First Draw	<0.4
9600-24-FD	ECC - 002035-Room 207	Sink Tap	First Draw	<0.4
9600-25-FD	ECC - 002036-Staff Restroom Across from 207	Sink Tap	First Draw	<0.4
9600-26-FD	ECC - 002037-Room 208	Sink Tap	First Draw	<0.4
9600-27-FD	ECC - 002038-Between 208-209	Sink Tap	First Draw	0.9
9600-28-FD	ECC - 002039-Room 209	Sink Tap	First Draw	1.2
9600-29-FD	ECC - 002040-Room 209-Restroom	Sink Tap	First Draw	1
9600-30-FD	ECC - 002041-Room 210	Sink Tap	First Draw	<0.4
9600-31-FD	ECC - 002042-Between 210-211	Sink Tap	First Draw	<0.4
9600-32-FD	ECC - 002043-Between 210-211	Sink Tap	First Draw	<0.4
9600-33-FD	ECC - 002044-Room 211	Sink Tap	First Draw	1.1
9600-34-FD	ECC - 002045-Next to 204	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9600-35-FD	ECC - 003795-Room 300	Sink Tap	First Draw	<0.4
9600-36-FD	ECC - 003796-Room 300- Unisex Restroom	Sink Tap	First Draw	<0.4
9600-37-FD	ECC - 003793-Room 301	Sink Tap	First Draw	1.6
9600-38-FD	ECC - 003794-Room 301- Unisex Restroom	Sink Tap	First Draw	<0.4
9600-40-FD	ECC - 003797-Room 303	Sink Tap	First Draw	<0.4
9600-41-FD	ECC - 003798-Room 303 Unisex Restroom	Sink Tap	First Draw	<0.4
9600-42-FD	ECC - 003799-Room 303- Unisex Restroom	Sink Tap	First Draw	0.4
9600-43-	ECC - 003800-Classroom 303 - Out of Order	Sink Tap	Not Tested	Not Sampled
9600-44-FD	ECC - 002002-Room 305- Lounge	Sink Tap	First Draw	<0.4
9600-45-FD	ECC - 002003-Room 305- Lounge	Ice Machine	First Draw	0.8
9600-47-FD	ECC - 002005-Between 304- 306	Sink Tap	First Draw	<0.4
9600-48-FD	ECC - 002006-Room 306	Sink Tap	First Draw	0.5
9600-49-FD	ECC - 002007-Between 306- 307	Sink Tap	First Draw	<0.4
9600-50-FD	ECC - 002008-Between 306- 307	Sink Tap	First Draw	<0.4
9600-51-FD	ECC - 002009-Room 307	Sink Tap	First Draw	0.4
9600-52-FD	ECC - 002010-Across from 306-Left	Drinking Fountain	First Draw	0.5
9600-53-FD	ECC - 002011-Staff Restroom by 308	Sink Tap	First Draw	<0.4
9600-54-FD	ECC - 002012-Room 308 Unisex Restroom	Sink Tap	First Draw	<0.4
9600-55-FD	ECC - 002013- Room 308 Unisex Restroom	Sink Tap	First Draw	<0.4
9600-56-FD	ECC - 002014-Room 308	Sink Tap	First Draw	<0.4
9600-57-FD	ECC - 002015-Room 309	Sink Tap	First Draw	0.8
9600-58-FD	ECC - 002016- Between 309- 310	Sink Tap	First Draw	<0.4
9600-60-FD	ECC - 002018-Room 311	Sink Tap	First Draw	0.7
9600-61-FD	ECC - 002019-Between 311- 312	Sink Tap	First Draw	0.7
9600-62-FD	ECC - 002020-Between 311- 312	Sink Tap	First Draw	0.5
9600-63-FD	ECC - 002021-Between 311- 312	Sink Tap	First Draw	0.6

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9600-64-FD	ECC - 002502-Nurse's Office	Sink Tap	First Draw	<0.4
9600-65-FD	ECC - 003792B-Across from 300	Drinking Fountain	First Draw	<0.4
9600-66-FD	ECC - 003792F-Across from 300	Bottle Filler	First Draw	<0.4
9600-67-FD	ECC - 002045B-Next to 204-Right	Drinking Fountain	First Draw	<0.4
9600-68-FD	ECC - 002045F-Next to 204	Bottle Filler	First Draw	<0.4
9600-69-FD	ECC - 002010-Across from 306-Right	Drinking Fountain	First Draw	0.5

April 30, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9600-39-FD	ECC - 002001-Between 302/303	Sink Tap	First Draw	0.9
9600-46-FD	ECC - 002004-Room 304	Sink Tap	First Draw	0.5
9600-59-FD	ECC - 002501/002017-Room 310	Sink Tap	First Draw	<0.4

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date: 10/4/2023
Expiration Date: 10/4/2025
License Number: 211004-300006201



Paula F. Nickelson

Paula F. Nickelson
Director

Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



**Missouri Department of Health
and Senior Services**

Lead Occupation License - ID Badge

License Number:

000801-200166567

Lead Risk Assessor

**Jeffrey
Hurst**

Expiration Date: **8/1/2024**

Paula F. Nickelson

**Paula F. Nickelson
Acting Director**

Department of Health and Senior Services

Jefferson City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.
- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

Appendix C

Laboratory Analytical Report



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 9600 Northeast 79th Street

Project / PO Number: 9600 Northeast 79th Street
Received: 03/15/2024
Reported: 03/27/2024

Analytical Testing Parameters

Client Sample ID: 9600-1-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-01

Collected By: Bradley Young
Collection Date: 03/12/2024 0:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		03/21/24 1239	03/26/24 1322	RVV

Client Sample ID: 9600-2-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-02

Collected By: Bradley Young
Collection Date: 03/12/2024 0:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.1	0.4	ppb	2		03/21/24 1239	03/26/24 1332	RVV

Client Sample ID: 9600-3-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-03

Collected By: Bradley Young
Collection Date: 03/12/2024 0:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		03/21/24 1239	03/26/24 1335	RVV

Client Sample ID: 9600-4-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-04

Collected By: Bradley Young
Collection Date: 03/12/2024 0:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1338	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-5-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-05

Collected By: Bradley Young
Collection Date: 03/12/2024 0:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1348	RVV

Client Sample ID: 9600-6-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-06

Collected By: Bradley Young
Collection Date: 03/12/2024 0:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1351	RVV

Client Sample ID: 9600-7-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-07

Collected By: Bradley Young
Collection Date: 03/12/2024 0:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1354	RVV

Client Sample ID: 9600-8-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-08

Collected By: Bradley Young
Collection Date: 03/12/2024 0:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1357	RVV

Client Sample ID: 9600-9-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-09

Collected By: Bradley Young
Collection Date: 03/12/2024 0:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1400	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-10-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-10

Collected By: Bradley Young
Collection Date: 03/12/2024 0:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1404	RVV

Client Sample ID: 9600-11-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-11

Collected By: Bradley Young
Collection Date: 03/12/2024 0:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		03/21/24 1239	03/26/24 1407	RVV

Client Sample ID: 9600-12-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-12

Collected By: Bradley Young
Collection Date: 03/12/2024 0:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1410	RVV

Client Sample ID: 9600-13-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-13

Collected By: Bradley Young
Collection Date: 03/12/2024 0:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.4	0.4	ppb	2		03/21/24 1239	03/26/24 1413	RVV

Client Sample ID: 9600-14-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-14

Collected By: Bradley Young
Collection Date: 03/12/2024 0:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1417	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-15-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-15

Collected By: Bradley Young
Collection Date: 03/12/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1426	RVV

Client Sample ID: 9600-16-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-16

Collected By: Bradley Young
Collection Date: 03/12/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1429	RVV

Client Sample ID: 9600-17-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-17

Collected By: Bradley Young
Collection Date: 03/12/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1433	RVV

Client Sample ID: 9600-18-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-18

Collected By: Bradley Young
Collection Date: 03/12/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1436	RVV

Client Sample ID: 9600-19-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-19

Collected By: Bradley Young
Collection Date: 03/12/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1439	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-20-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-20

Collected By: Bradley Young
Collection Date: 03/12/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1442	RVV

Client Sample ID: 9600-21-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-21

Collected By: Bradley Young
Collection Date: 03/12/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.4	0.4	ppb	2		03/21/24 1239	03/26/24 1452	RVV

Client Sample ID: 9600-22-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-22

Collected By: Bradley Young
Collection Date: 03/12/2024 0:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1508	RVV

Client Sample ID: 9600-23-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-23

Collected By: Bradley Young
Collection Date: 03/12/2024 8:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1511	RVV

Client Sample ID: 9600-24-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-24

Collected By: Bradley Young
Collection Date: 03/12/2024 0:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1514	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-25-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-25

Collected By: Bradley Young
Collection Date: 03/12/2024 0:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1518	RVV

Client Sample ID: 9600-26-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-26

Collected By: Bradley Young
Collection Date: 03/12/2024 0:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1521	RVV

Client Sample ID: 9600-27-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-27

Collected By: Bradley Young
Collection Date: 03/12/2024 0:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		03/21/24 1239	03/26/24 1524	RVV

Client Sample ID: 9600-28-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-28

Collected By: Bradley Young
Collection Date: 03/12/2024 0:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		03/21/24 1239	03/26/24 1527	RVV

Client Sample ID: 9600-29-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-29

Collected By: Bradley Young
Collection Date: 03/12/2024 0:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		03/21/24 1239	03/26/24 1531	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-30-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-30

Collected By: Bradley Young
Collection Date: 03/12/2024 0:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1534	RVV

Client Sample ID: 9600-31-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-31

Collected By: Bradley Young
Collection Date: 03/12/2024 0:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1543	RVV

Client Sample ID: 9600-32-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-32

Collected By: Bradley Young
Collection Date: 03/12/2024 0:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1547	RVV

Client Sample ID: 9600-33-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-33

Collected By: Bradley Young
Collection Date: 03/12/2024 0:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.1	0.4	ppb	2		03/21/24 1239	03/26/24 1550	RVV

Client Sample ID: 9600-34-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-34

Collected By: Bradley Young
Collection Date: 03/12/2024 0:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1553	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-35-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-35

Collected By: Bradley Young
Collection Date: 03/12/2024 0:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1556	RVV

Client Sample ID: 9600-36-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-36

Collected By: Bradley Young
Collection Date: 03/12/2024 0:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1600	RVV

Client Sample ID: 9600-37-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-37

Collected By: Bradley Young
Collection Date: 03/12/2024 0:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.6	0.4	ppb	2		03/21/24 1239	03/26/24 1603	RVV

Client Sample ID: 9600-38-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-38

Collected By: Bradley Young
Collection Date: 03/12/2024 0:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1606	RVV

Client Sample ID: 9600-40-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-39

Collected By: Bradley Young
Collection Date: 03/12/2024 0:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1609	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-41-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-40

Collected By: Bradley Young
Collection Date: 03/12/2024 0:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1612	RVV

Client Sample ID: 9600-42-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-41

Collected By: Bradley Young
Collection Date: 03/12/2024 0:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1629	RVV

Client Sample ID: 9600-44-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-42

Collected By: Bradley Young
Collection Date: 03/12/2024 0:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1638	RVV

Client Sample ID: 9600-45-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-43

Collected By: Bradley Young
Collection Date: 03/12/2024 0:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		03/21/24 1239	03/26/24 1642	RVV

Client Sample ID: 9600-47-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-44

Collected By: Bradley Young
Collection Date: 03/12/2024 0:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1645	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-48-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-45

Collected By: Bradley Young
Collection Date: 03/12/2024 0:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		03/21/24 1239	03/26/24 1648	RVV

Client Sample ID: 9600-49-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-46

Collected By: Bradley Young
Collection Date: 03/12/2024 0:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1651	RVV

Client Sample ID: 9600-50-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-47

Collected By: Bradley Young
Collection Date: 03/12/2024 0:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1701	RVV

Client Sample ID: 9600-51-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-48

Collected By: Bradley Young
Collection Date: 03/12/2024 0:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1704	RVV

Client Sample ID: 9600-52-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-49

Collected By: Bradley Young
Collection Date: 03/12/2024 0:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		03/21/24 1239	03/26/24 1707	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-53-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-50

Collected By: Bradley Young
Collection Date: 03/12/2024 0:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1711	RVV

Client Sample ID: 9600-54-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-51

Collected By: Bradley Young
Collection Date: 03/12/2024 0:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1714	RVV

Client Sample ID: 9600-55-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-52

Collected By: Bradley Young
Collection Date: 03/12/2024 0:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1717	RVV

Client Sample ID: 9600-56-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-53

Collected By: Bradley Young
Collection Date: 03/12/2024 0:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1720	RVV

Client Sample ID: 9600-57-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-54

Collected By: Bradley Young
Collection Date: 03/12/2024 0:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		03/21/24 1239	03/26/24 1723	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-58-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-55

Collected By: Bradley Young
Collection Date: 03/12/2024 0:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1727	RVV

Client Sample ID: 9600-60-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-56

Collected By: Bradley Young
Collection Date: 03/12/2024 8:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		03/21/24 1239	03/26/24 1730	RVV

Client Sample ID: 9600-61-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-57

Collected By: Bradley Young
Collection Date: 03/12/2024 0:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		03/21/24 1239	03/26/24 1740	RVV

Client Sample ID: 9600-62-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-58

Collected By: Bradley Young
Collection Date: 03/12/2024 0:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		03/21/24 1239	03/26/24 1743	RVV

Client Sample ID: 9600-63-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-59

Collected By: Bradley Young
Collection Date: 03/12/2024 0:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		03/21/24 1239	03/26/24 1746	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-64-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-60

Collected By: Bradley Young
Collection Date: 03/12/2024 0:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1749	RVV

Client Sample ID: 9600-65-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-61

Collected By: Bradley Young
Collection Date: 03/12/2024 0:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1759	RVV

Client Sample ID: 9600-66-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-62

Collected By: Bradley Young
Collection Date: 03/12/2024 0:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1809	RVV

Client Sample ID: 9600-67-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-63

Collected By: Bradley Young
Collection Date: 03/12/2024 0:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1818	RVV

Client Sample ID: 9600-68-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-64

Collected By: Bradley Young
Collection Date: 03/12/2024 0:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 1239	03/26/24 1822	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0072

Client Sample ID: 9600-69-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0072-65

Collected By: Bradley Young
Collection Date: 03/12/2024 0:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		03/21/24 1239	03/26/24 1825	RVV

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.

Victoria Bruck
Field Technician II
03/27/24 14:17

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER: <u>Bradly Young</u>		NAME: <u>Jeff Hurst</u>		NAME: <u>Jeff Hurst</u>	
SITE NAME: <u>Early Childhood Center</u>		CO. NAME: _____		CO. NAME: _____	
ADDRESS: <u>9600 Northeast 79th Street</u>		ADDRESS: <u>PO Box 47166</u>		ADDRESS: <u>PO Box 47166</u>	
CITY/ST/ZIP: <u>Kansas City, Missouri 64158</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>	
PHONE: <u>816-522-2275</u>		PHONE: <u>816-678-7894</u>		PHONE: <u>816-678-7894</u>	
		EMAIL: <u>jeffh@axiomservicepros.com</u>		EMAIL: <u>jeffh@axiomservicepros.com</u>	

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	19.4
														Sample Condition	Sample #
9600-1-FD	3/12/2024	00:20	ECC - Drinking Fountain - 003782B-Next to 408-Left	1	Wt	Grab	X								01
9600-2-FD	3/12/2024	00:20	ECC - Drinking Fountain - 003782B-Next to 408-Right	1	Wt	Grab	X								02
9600-3-FD	3/12/2024	00:20	ECC - Sink Tap - 003783-Boys Bathroom by 408-Left	1	Wt	Grab	X								03
9600-4-FD	3/12/2024	00:21	ECC - Sink Tap - 003784-Boys Bathroom by 408-Middle	1	Wt	Grab	X								04
9600-5-FD	3/12/2024	00:21	ECC - Sink Tap - 003785-Boys Bathroom by 408-Right	1	Wt	Grab	X								05
9600-6-FD	3/12/2024	00:21	ECC - Sink Tap - 003786-Girls Bathroom by 408-Left	1	Wt	Grab	X								06
9600-7-FD	3/12/2024	00:22	ECC - Sink Tap - 003787-Girls Bathroom by 408-Middle	1	Wt	Grab	X								07

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:		<u>Vik BH</u>	3/15/24		
				9:20		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Early Childhood Center	CO. NAME:		CO. NAME:	
ADDRESS:	9600 Northeast 79th Street	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp:	oC
														Sample Condition	Sample #
9600-8-FD	3/12/2024	00:22	ECC - Sink Tap - 003788-Girls Bathroom by 408-Right	1	Wt	Grab	X								08
9600-9-FD	3/12/2024	00:22	ECC - Sink Tap - 003789-Across from Main Office	1	Wt	Grab	X								09
9600-10-FD	3/12/2024	00:23	ECC - Sink Tap - 003790-Room 400-Staff Bathroom	1	Wt	Grab	X								10
9600-11-FD	3/12/2024	00:23	ECC - Sink Tap - 003791-Room 400	1	Wt	Grab	X								11
9600-12-FD	3/12/2024	00:25	ECC - Sink Tap - 002023-Between 200-201	1	Wt	Grab	X								12
9600-13-FD	3/12/2024	00:25	ECC - Sink Tap - 002024-Room 201	1	Wt	Grab	X								13
9600-14-FD	3/12/2024	00:25	ECC - Sink Tap - 002025-Between 201-203-Right	1	Wt	Grab	X								14

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				3/15/24		
	Time:			Time:		
				9:20		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Early Childhood Center	CO. NAME:		CO. NAME:	
ADDRESS:	9600 Northeast 79th Street	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9600-15-FD	3/12/2024	00:26	ECC - Sink Tap - 002026-Between 201-203-Left	1	Wt	Grab	X								15
9600-16-FD	3/12/2024	00:26	ECC - Sink Tap - 002027-Room 203	1	Wt	Grab	X								16
9600-17-FD	3/12/2024	00:26	ECC - Sink Tap - 002028-Between 203-205	1	Wt	Grab	X								17
9600-18-FD	3/12/2024	00:26	ECC - Sink Tap - 002029-Room 205	1	Wt	Grab	X								18
9600-19-FD	3/12/2024	00:26	ECC - Sink Tap - 002030-Between 205-206-Right	1	Wt	Grab	X								19
9600-20-FD	3/12/2024	00:26	ECC - Sink Tap - 002031-Between 205-206-Left	1	Wt	Grab	X								20
9600-21-FD	3/12/2024	00:26	ECC - Sink Tap - 002032-Room 206	1	Wt	Grab	X								21

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			3/15/24		
				9:20		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Early Childhood Center	CO. NAME:		CO. NAME:	
ADDRESS:	9600 Northeast 79th Street	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9600-22-FD	3/12/2024	00:28	ECC - Sink Tap - 002033-Room 207	1	Wt	Grab	X								22
9600-23-FD	3/12/2024	08:04	ECC - Sink Tap - 002034-Room 207	1	Wt	Grab	X								23
9600-24-FD	3/12/2024	00:28	ECC - Sink Tap - 002035-Room 207	1	Wt	Grab	X								24
9600-25-FD	3/12/2024	00:28	ECC - Sink Tap - 002036-Staff Restroom Across from 207	1	Wt	Grab	X								25
9600-26-FD	3/12/2024	00:29	ECC - Sink Tap - 002037-Room 208	1	Wt	Grab	X								26
9600-27-FD	3/12/2024	00:29	ECC - Sink Tap - 002038-Between 208-209	1	Wt	Grab	X								27
9600-28-FD	3/12/2024	00:29	ECC - Sink Tap - 002039-Room 209	1	Wt	Grab	X								28

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				3/15/24		
	Time:			Time:		
				9:20		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Early Childhood Center	CO. NAME:		CO. NAME:	
ADDRESS:	9600 Northeast 79th Street	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME	# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED							LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp:	oC
														Sample Condition	Sample #
9600-29-FD	3/12/2024	00:29	ECC - Sink Tap - 002040-Room 209-Bathroom	1	Wt	Grab	X								29
9600-30-FD	3/12/2024	00:30	ECC - Sink Tap - 002041-Room 210	1	Wt	Grab	X								30
9600-31-FD	3/12/2024	00:30	ECC - Sink Tap - 002042-Between 210-211	1	Wt	Grab	X								31
9600-32-FD	3/12/2024	00:30	ECC - Sink Tap - 002043-Between 210-211	1	Wt	Grab	X								32
9600-33-FD	3/12/2024	00:31	ECC - Sink Tap - 002044-Room 211	1	Wt	Grab	X								33
9600-34-FD	3/12/2024	00:31	ECC - Drinking Fountain - 002045-Next to 204	1	Wt	Grab	X								34
9600-35-FD	3/12/2024	00:33	ECC - Sink Tap - 003795-Room 300	1	Wt	Grab	X								35

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Early Childhood Center	CO. NAME:		CO. NAME:	
ADDRESS:	9600 Northeast 79th Street	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp:	oC
														Sample Condition	Sample #
9600-36-FD	3/12/2024	00:33	ECC - Sink Tap - 003796-Room 300-Unisex Bathroom	1	Wt	Grab	X								36
9600-37-FD	3/12/2024	00:33	ECC - Sink Tap - 003793-Room 301	1	Wt	Grab	X								37
9600-38-FD	3/12/2024	00:34	ECC - Sink Tap - 003794-Room 301-Unisex Bathroom	1	Wt	Grab	X								38
9600-40-FD	3/12/2024	00:36	ECC - Sink Tap - 003797-Room 303	1	Wt	Grab	X								39
9600-41-FD	3/12/2024	00:36	ECC - Sink Tap - 003798-Room 303 Unisex Restroom	1	Wt	Grab	X								40
9600-42-FD	3/12/2024	00:36	ECC - Sink Tap - 003799-Room 303-Unisex Restroom	1	Wt	Grab	X								41
9600-44-FD	3/12/2024	00:37	ECC - Sink Tap - 002002-Room 305-Lounge	1	Wt	Grab	X								42

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				3/15/24		
	Time:			Time:		
				9:20		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Early Childhood Center	CO. NAME:		CO. NAME:	
ADDRESS:	9600 Northeast 79th Street	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp:	oC
														Sample Condition	Sample #
9600-45-FD	3/12/2024	00:38	ECC - Ice Machine - 002003-Room 305-Lounge	1	Wt	Grab	X								43
9600-47-FD	3/12/2024	00:39	ECC - Sink Tap - 002005-Between 304-306	1	Wt	Grab	X								44
9600-48-FD	3/12/2024	00:39	ECC - Sink Tap - 002006-Room 306	1	Wt	Grab	X								45
9600-49-FD	3/12/2024	00:39	ECC - Sink Tap - 002007-Between 306-307	1	Wt	Grab	X								46
9600-50-FD	3/12/2024	00:40	ECC - Sink Tap - 002008-Between 306-307	1	Wt	Grab	X								47
9600-51-FD	3/12/2024	00:40	ECC - Sink Tap - 002009-Room 307	1	Wt	Grab	X								48
9600-52-FD	3/12/2024	00:41	ECC - Drinking Fountain - 002010-Across from 306-Left	1	Wt	Grab	X								49

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				3/15/24		
	Time:			Time:		
				9:20		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Early Childhood Center	CO. NAME:		CO. NAME:	
ADDRESS:	9600 Northeast 79th Street	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp:	oC
														Sample Condition	Sample #
9600-53-FD	3/12/2024	00:41	ECC - Sink Tap - 002011-Staff Bathroom by 308	1	Wt	Grab	X								50
9600-54-FD	3/12/2024	00:43	ECC - Sink Tap - 002012-Room 308 Unisex Bathroom	1	Wt	Grab	X								51
9600-55-FD	3/12/2024	00:43	ECC - Sink Tap - 002013- Room 308 Unisex Bathroom	1	Wt	Grab	X								52
9600-56-FD	3/12/2024	00:44	ECC - Sink Tap - 002014-Room 308	1	Wt	Grab	X								53
9600-57-FD	3/12/2024	00:44	ECC - Sink Tap - 002015-Room 309	1	Wt	Grab	X								54
9600-58-FD	3/12/2024	00:44	ECC - Sink Tap - 002016- Between 309-310	1	Wt	Grab	X								55
9600-60-FD	3/12/2024	08:21	ECC - Sink Tap - 002018-Room 311	1	Wt	Grab	X								56

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Early Childhood Center	CO. NAME:		CO. NAME:	
ADDRESS:	9600 Northeast 79th Street	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9600-61-FD	3/12/2024	00:45	ECC - Sink Tap - 002019-Between 311-312-	1	Wt	Grab	X								57
9600-62-FD	3/12/2024	00:46	ECC - Sink Tap - 002020-Between 311-312-	1	Wt	Grab	X								58
9600-63-FD	3/12/2024	00:46	ECC - Sink Tap - 002021-Between 311-312-	1	Wt	Grab	X								59
9600-64-FD	3/12/2024	00:48	ECC - Sink Tap - 002502-Nurse Office	1	Wt	Grab	X								60
9600-65-FD	3/12/2024	00:49	ECC - Drinking Fountain - 003792B-Across from 300	1	Wt	Grab	X								61
9600-66-FD	3/12/2024	00:49	ECC - Bottle Filler - 003792F-Across from 300	1	Wt	Grab	X								62
9600-67-FD	3/12/2024	00:31	ECC - Drinking Fountain - 002045B-Next to 204-Right	1	Wt	Grab	X								63

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				3/15/24		
	Time:			Time:		
				9:20		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Early Childhood Center	CO. NAME:		CO. NAME:	
ADDRESS:	9600 Northeast 79th Street	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64158	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9600-68-FD	3/12/2024	00:31	ECC - Bottle Filler - 002045F-Next to 204	1	Wt	Grab	X								64
9600-69-FD	3/12/2024	00:41	ECC - Drinking Fountain - 002010-Across from 306-Right	1	Wt	Grab	X								65

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H C 0 0 7 2

AXIOM Service Professionals

PM: Carolyn Jackson



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HE0034

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: Early Childhood Center

Project / PO Number: Early Childhood Center
Received: 05/02/2024
Reported: 05/10/2024

Work Order Special Information

Young, Bradly
Early Childhood Center

Analytical Testing Parameters

Client Sample ID: 9600-39-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0034-01

Collected By: Young, Bradly
Collection Date: 04/30/2024 23:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		05/07/24 1516	05/09/24 0317	RVV

Client Sample ID: 9600-46-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0034-02

Collected By: Young, Bradly
Collection Date: 04/30/2024 23:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		05/07/24 1516	05/09/24 0334	RVV

Client Sample ID: 9600-59-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0034-03

Collected By: Young, Bradly
Collection Date: 04/30/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0340	RVV

Definitions

RL: Reporting Limit

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HE0034

Report Comments

*The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. **The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Reviewed and Approved By:

Carolyn Jackson

Project Manager

carolyn.jackson@microbac.com

05/10/24 13:19

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER: <u>Bradly Young</u>		NAME: <u>Jeff Hurst</u>		NAME: <u>Jeff Hurst</u>	
SITE NAME: <u>Early Childhood Center</u>		CO. NAME:		CO. NAME:	
ADDRESS: <u>9600 Northeast 79th Street</u>		ADDRESS: <u>PO Box 47166</u>		ADDRESS: <u>PO Box 47166</u>	
CITY/ST/ZIP: <u>Kansas City, Missouri 64158</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>	
PHONE: <u>816-522-2275</u>		PHONE: <u>816-678-7894</u>		PHONE: <u>816-678-7894</u>	
		EMAIL: <u>jeffh@axiomservicepros.com</u>		EMAIL: <u>jeffh@axiomservicepros.com</u>	

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY		
							Lead								Wk Order #:	Sample #	
9600-39-FD	4/30/2024	23:11	ECC - Sink Tap - 002001-Between 302/303	1	Wt	Grab	X									3HE0034	
9600-46-FD	4/30/2024	23:12	ECC - Sink Tap - 002004-Room 304	1	Wt	Grab	X										02
9600-59-FD	4/30/2024	23:13	ECC - Sink Tap - 002501/002017-Room 310	1	Wt	Grab	X										03



3 H E 0 0 3 4

AXIOM Service Professionals

PM: Carolyn Jackson

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	05/02/24	
					12:00	
	Time:			Time:		

Appendix D

Photo Log




3/12/2024 - 9600-1 - ECC - 003782B-Next to 408-Left



3/12/2024 - 9600-2 - ECC - 003782B-Next to 408-Right



3/12/2024 - 9600-3 - ECC - 003783-Boys Restroom by 408-Left

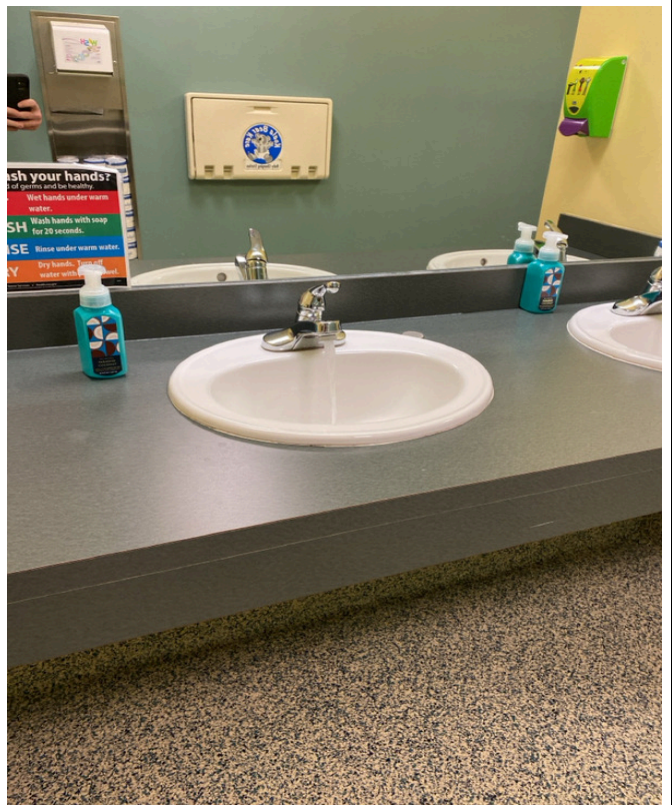

3/12/2024 - 9600-4 - ECC - 003784-Boys Restroom by 408-Middle



3/12/2024 - 9600-5 - ECC - 003785-Boys
Restroom by 408-Right



3/12/2024 - 9600-6 - ECC - 003786-Girls
Restroom by 408-Left



3/12/2024 - 9600-7 - ECC - 003787-Girls
Restroom by 408-Middle



3/12/2024 - 9600-8 - ECC - 003788-Girls
Restroom by 408-Right



3/12/2024 - 9600-9 - ECC - 003789-Across from Main Office



3/12/2024 - 9600-10 - ECC - 003790-Room 400-Staff Restroom



3/12/2024 - 9600-11 - ECC - 003791-Room 400



3/12/2024 - 9600-12 - ECC - 002023-Between 200-201



3/12/2024 - 9600-13 - ECC - 002024-Room 201



3/12/2024 - 9600-14 - ECC - 002025-Between
201-203-Right



3/12/2024 - 9600-15 - ECC - 002026-Between
201-203-Left



3/12/2024 - 9600-16 - ECC - 002027-Room 203



3/12/2024 - 9600-17 - ECC - 002028-Between
203-205



3/12/2024 - 9600-18 - ECC - 002029-Room 205



3/12/2024 - 9600-19 - ECC - 002030-Between
205-206-Right




3/12/2024 - 9600-20 - ECC - 002031-Between
205-206-Left



3/12/2024 - 9600-21 - ECC - 002032-Room 206



3/12/2024 - 9600-22 - ECC - 002033-Room 207

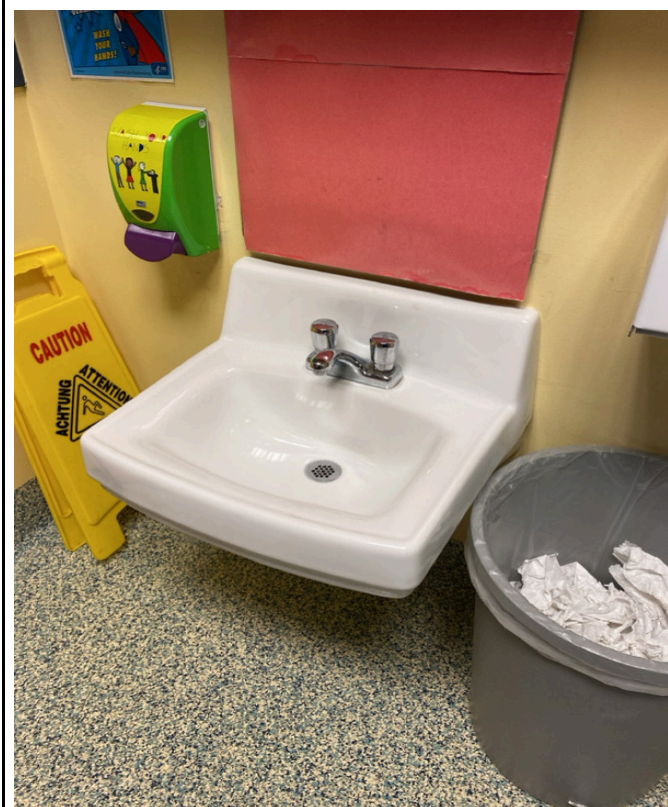

3/12/2024 - 9600-23 - ECC - 002034-Room 207



3/12/2024 - 9600-24 - ECC - 002035-Room 207



3/12/2024 - 9600-25 - ECC - 002036-Staff
Restroom Across from 207




3/12/2024 - 9600-26 - ECC - 002037-Room 208



3/12/2024 - 9600-27 - ECC - 002038-Between
208-209



3/12/2024 - 9600-28 - ECC - 002039-Room 209

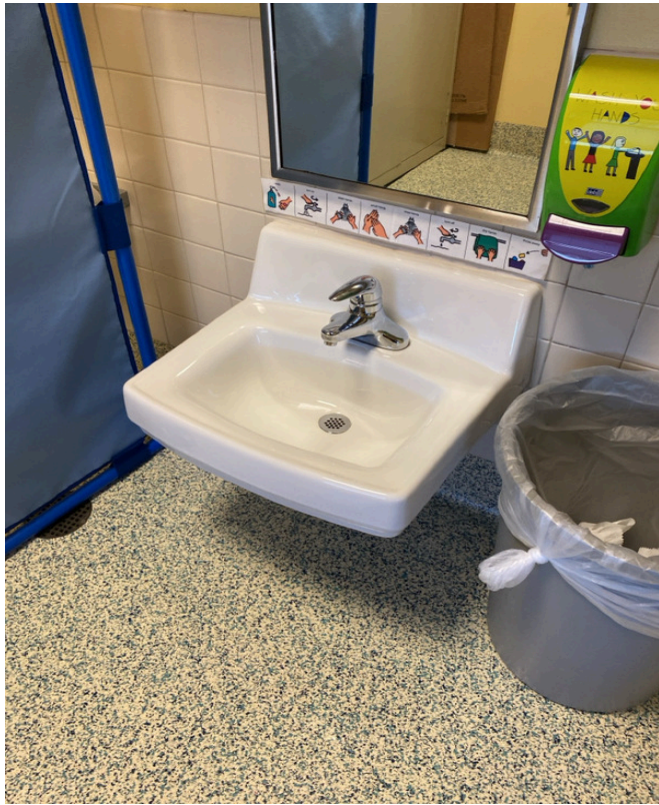

3/12/2024 - 9600-29 - ECC - 002040-Room 209-
Restroom



3/12/2024 - 9600-30 - ECC - 002041-Room 210



3/12/2024 - 9600-31 - ECC - 002042-Between
210-211



3/12/2024 - 9600-32 - ECC - 002043-Between
210-211



3/12/2024 - 9600-33 - ECC - 002044-Room 211



3/12/2024 - 9600-34 - ECC - 002045-Next to 204



3/12/2024 - 9600-35 - ECC - 003795-Room 300



3/12/2024 - 9600-36 - ECC - 003796-Room 300-
Unisex Restroom



3/12/2024 - 9600-37 - ECC - 003793-Room 301



3/12/2024 - 9600-38 - ECC - 003794-Room 301-
Unisex Restroom



3/12/2024 - 9600-40 - ECC - 003797-Room 303



3/12/2024 - 9600-41 - ECC - 003798-Room 303
Unisex Restroom



3/12/2024 - 9600-42 - ECC - 003799-Room 303-
Unisex Restroom



3/12/2024 - 9600-43 - ECC - 003800-Classroom
303 - Out of Order



3/12/2024 - 9600-44 - ECC - 002002-Room 305-
Lounge



3/12/2024 - 9600-45 - ECC - 002003-Room 305-
Lounge



3/12/2024 - 9600-47 - ECC - 002005-Between
304-306



3/12/2024 - 9600-48 - ECC - 002006-Room 306



3/12/2024 - 9600-49 - ECC - 002007-Between
306-307



3/12/2024 - 9600-50 - ECC - 002008-Between
306-307




3/12/2024 - 9600-51 - ECC - 002009-Room 307



3/12/2024 - 9600-52 - ECC - 002010-Across from 306-Left



3/12/2024 - 9600-53 - ECC - 002011-Staff Restroom by 308

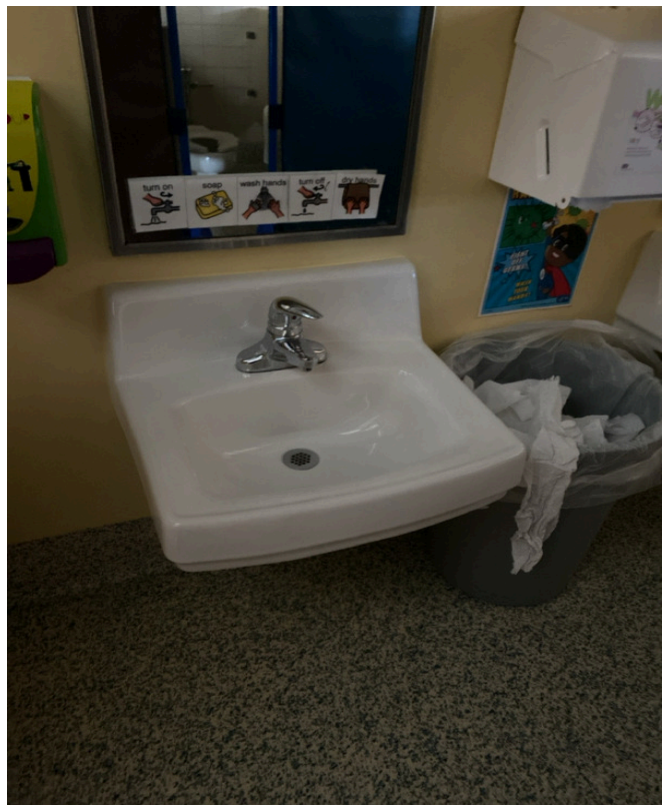

3/12/2024 - 9600-54 - ECC - 002012-Room 308 Unisex Restroom



3/12/2024 - 9600-55 - ECC - 002013- Room 308
Unisex Restroom



3/12/2024 - 9600-56 - ECC - 002014-Room 308




3/12/2024 - 9600-57 - ECC - 002015-Room 309



3/12/2024 - 9600-58 - ECC - 002016- Between
309-310



3/12/2024 - 9600-60 - ECC - 002018-Room 311

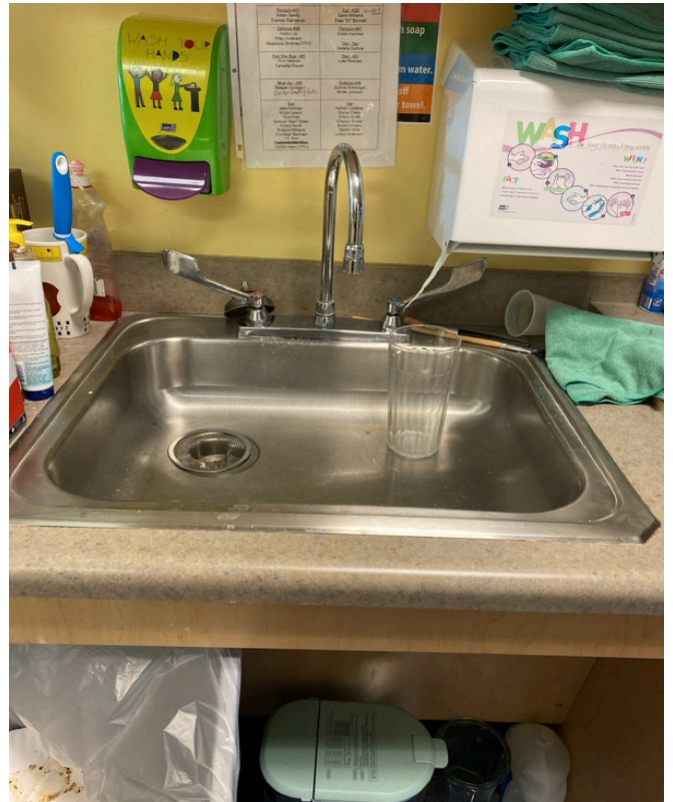

3/12/2024 - 9600-61 - ECC - 002019-Between 311-312



3/12/2024 - 9600-62 - ECC - 002020-Between 311-312



3/12/2024 - 9600-63 - ECC - 002021-Between 311-312



3/12/2024 - 9600-64 - ECC - 002502-Nurse's Office



3/12/2024 - 9600-65 - ECC - 003792B-Across from 300



3/12/2024 - 9600-66 - ECC - 003792F-Across from 300



3/12/2024 - 9600-67 - ECC - 002045B-Next to 204-Right



3/12/2024 - 9600-68 - ECC - 002045F-Next to 204



3/12/2024 - 9600-69 - ECC - 002010-Across from 306-Right



4/30/2024 - 9600-39 - ECC - 002001-Between 302/303



4/30/2024 - 9600-46 - ECC - 002004-Room 304





4/30/2024 - 9600-59 - ECC - 002501/002017-
Room 310

Appendix E

Source Identification Diagram

ASP was provided sample locations by
Liberty School District

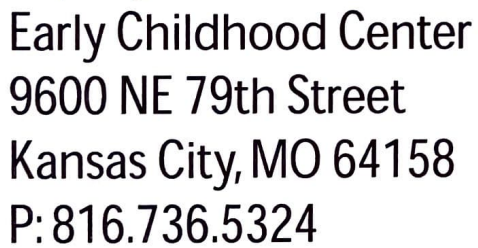

Map Design by: Curt Laven
Last Updated: 5/17/2023