May 23, 2024

Steve Aldrich
Director of Facilities and Grounds
Liberty School District
801 Kent Street
Liberty, Missouri 64068

Project: Limited Lead in Drinking Water Testing
Address: 9000 Northeast Flintlock Road, Kansas City, Missouri 64157

Mr. Steve Aldrich

On March 15, 2024 and April 30, 2024, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 149 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of “lead free” to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of “lead free” as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: https://www.epa.gov/dwreginfo/lead-and-copper-rule

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.
Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school’s buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in red text.

March 15, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9000-1-FD	Shoal Creek - 002051-Room 001A	Sink Tap	First Draw	<0.4
9000-2-FD	Shoal Creek - 004905-Teacher's Lounge	Ice Machine	First Draw	<0.4
9000-3-FD	Shoal Creek - 002052-Room 001A	Sink Tap	First Draw	<0.4
9000-4-FD	Shoal Creek - 002053-Room 001A	Sink Tap	First Draw	<0.4
9000-5-FD	Shoal Creek - 002504-Nurse's Office-Restroom	Sink Tap	First Draw	<0.4
9000-6-FD	Shoal Creek - 002505-Nurse's Office	Sink Tap	First Draw	<0.4
9000-7-FD	Shoal Creek - 002055-Handwashing by 407-Girls	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9000-8-FD	Shoal Creek - 002054-Handwashing by 407-Boys	Sink Tap	First Draw	<0.4
9000-9-FD	Shoal Creek - 002056-By Room 400-Left	Drinking Fountain	First Draw	<0.4
9000-10-FD	Shoal Creek - 002056B-By Room 400-Right	Drinking Fountain	First Draw	<0.4
9000-11-FD	Shoal Creek - 002056F-By Room 400	Bottle Filler	First Draw	<0.4
9000-12-FD	Shoal Creek - 002089-By Room 103	Drinking Fountain	First Draw	<0.4
9000-13-FD	Shoal Creek - 002090-By Room 103	Drinking Fountain	First Draw	<0.4
9000-14-FD	Shoal Creek - 002090-By 103	Bottle Filler	First Draw	<0.4
9000-15-FD	Shoal Creek - 002091-Staff Restroom by 103	Sink Tap	First Draw	<0.4
9000-16-FD	Shoal Creek - 004906-Boys Restrooms by 103-Far Left	Sink Tap	First Draw	<0.4
9000-17-FD	Shoal Creek - 004907-Across from 103-Boys Restroom-Left Middle	Sink Tap	First Draw	<0.4
9000-18-FD	Shoal Creek - 004908-Across from 103-Boys Restroom-Right Middle	Sink Tap	First Draw	<0.4
9000-19-FD	Shoal Creek - 002201-Across from 103-Boys Restroom-Far Right	Sink Tap	First Draw	<0.4
9000-20-FD	Shoal Creek - 002202-By 103-Girls Restroom-Far Left	Sink Tap	First Draw	0.8
9000-21-FD	Shoal Creek - 002203-By 103-Girls Restroom-Left Middle	Sink Tap	First Draw	<0.4
9000-22-FD	Shoal Creek - 002204-By 103-Girls Restroom-Middle	Sink Tap	First Draw	<0.4
9000-23-FD	Shoal Creek - 002205-By 103-Girls Restroom-Right Middle	Sink Tap	First Draw	<0.4
9000-24-FD	Shoal Creek - 002205-By 103-Girls Restroom-Far Right	Sink Tap	First Draw	<0.4
9000-25-FD	Shoal Creek - 002085-Room 104	Sink Tap	First Draw	<0.4
9000-26-FD	Shoal Creek - 002086-Room 104	Bubbler	First Draw	<0.4
9000-27-FD	Shoal Creek - 002088-Room 105	Sink Tap	First Draw	<0.4
9000-28-FD	Shoal Creek - 002087-Room 105	Bubbler	First Draw	<0.4
9000-29-FD	Shoal Creek - 002081-Room 106	Sink Tap	First Draw	<0.4
9000-30-FD	Shoal Creek - 002082-Room 106	Bubbler	First Draw	<0.4
9000-31-FD	Shoal Creek - 002084-Room 107	Sink Tap	First Draw	<0.4
9000-32-FD	Shoal Creek - 002083-Room 107	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9000-33-FD	Shoal Creek - 002080-Room 108	Sink Tap	First Draw	<0.4
9000-34-FD	Shoal Creek - 002079-Room 108	Bubbler	First Draw	<0.4
9000-35-FD	Shoal Creek - 002078-Room 109	Sink Tap	First Draw	<0.4
9000-36-FD	Shoal Creek - 002077-Room 109	Bubbler	First Draw	<0.4
9000-37-FD	Shoal Creek - 002061-Room 110	Sink Tap	First Draw	<0.4
9000-38-FD	Shoal Creek - 002062-Room 110	Bubbler	First Draw	<0.4
9000-39-FD	Shoal Creek - 002069-Room 110	Sink Tap	First Draw	0.8
9000-40-FD	Shoal Creek - 002070-Room 110	Bubbler	First Draw	<0.4
9000-41-FD	Shoal Creek - 002071-Room 110-Restroom	Sink Tap	First Draw	<0.4
9000-42-FD	Shoal Creek - 002072-Room 111	Sink Tap	First Draw	<0.4
9000-43-FD	Shoal Creek - 002073-Room 111	Bubbler	First Draw	<0.4
9000-44-FD	Shoal Creek - 002075-Room 111	Sink Tap	First Draw	<0.4
9000-45-FD	Shoal Creek - 002074-Room 111	Bubbler	First Draw	<0.4
9000-46-FD	Shoal Creek - 002076-Room 111-Restroom	Sink Tap	First Draw	<0.4
9000-47-FD	Shoal Creek - 002059-Room 112	Sink Tap	First Draw	0.7
9000-48-FD	Shoal Creek - 002060-Room 112	Bubbler	First Draw	<0.4
9000-49-FD	Shoal Creek - 002067-Room 112	Sink Tap	First Draw	0.7
9000-50-FD	Shoal Creek - 002516-Room 112	Bubbler	First Draw	<0.4
9000-51-FD	Shoal Creek - 002068-Room 112-Restroom	Sink Tap	First Draw	<0.4
9000-52-FD	Shoal Creek - 002057-Room 113	Sink Tap	First Draw	0.7
9000-53-FD	Shoal Creek - 002058-Room 113	Bubbler	First Draw	<0.4
9000-54-FD	Shoal Creek - 002064-Room 113	Sink Tap	First Draw	0.7
9000-55-FD	Shoal Creek - 002063-Room 113	Bubbler	First Draw	<0.4
9000-56-FD	Shoal Creek - 002065-Room 113-Restroom	Sink Tap	First Draw	<0.4
9000-57-FD	Shoal Creek - 004853-Library Restroom	Sink Tap	First Draw	<0.4
9000-58-FD	Shoal Creek - 004826-By Room 203	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9000-59-FD	Shoal Creek - 004826F-By 203	Bottle Filler	First Draw	<0.4
9000-60-FD	Shoal Creek - 004825-By Room 203	Drinking Fountain	First Draw	<0.4
9000-61-FD	Shoal Creek - 004827-Staff Restroom by 203	Sink Tap	First Draw	<0.4
9000-62-FD	Shoal Creek - 002507-Boys Bathroom by 203-Far Left	Sink Tap	First Draw	<0.4
9000-63-FD	Shoal Creek - 002508-Boys BathRoom by 203-Left Middle	Sink Tap	First Draw	<0.4
9000-64-FD	Shoal Creek - 002509-Boys Restroom by 203-Right Middle	Sink Tap	First Draw	<0.4
9000-65-FD	Shoal Creek - 002510-Boys Restroom by 203-Far Right	Sink Tap	First Draw	<0.4
9000-66-FD	Shoal Creek - 002511-Girls Restroom by 203-Far Left	Sink Tap	First Draw	<0.4
9000-67-FD	Shoal Creek - 002512-Girls Restroom by 203-Left Middle	Sink Tap	First Draw	<0.4
9000-68-FD	Shoal Creek - 002513-Girls Restroom by 203-Middle	Sink Tap	First Draw	0.5
9000-70-FD	Shoal Creek - 002515-Girls Restroom by 203-Far Right	Sink Tap	First Draw	<0.4
9000-71-FD	Shoal Creek - 004823-Room 204	Sink Tap	First Draw	0.4
9000-72-FD	Shoal Creek - 004824-Room 204	Bubbler	First Draw	<0.4
9000-73-FD	Shoal Creek - 004821-Room 205	Sink Tap	First Draw	<0.4
9000-74-FD	Shoal Creek - 004822-Room 205	Sink Tap	First Draw	<0.4
9000-75-FD	Shoal Creek - 004817-Room 206	Sink Tap	First Draw	<0.4
9000-76-FD	Shoal Creek - 004818-Room 206	Bubbler	First Draw	<0.4
9000-77-FD	Shoal Creek - 004819-Room 207	Sink Tap	First Draw	0.5
9000-79-FD	Shoal Creek - 004815-Room 208	Sink Tap	First Draw	<0.4
9000-80-FD	Shoal Creek - 004816-Room 208	Sink Tap	First Draw	<0.4
9000-81-FD	Shoal Creek - 004814-Room 209	Sink Tap	First Draw	0.5
9000-82-FD	Shoal Creek - 004813-Room 209	Bubbler	First Draw	<0.4
9000-83-FD	Shoal Creek - 004811-Room 210	Sink Tap	First Draw	<0.4
9000-84-FD	Shoal Creek - 004812-Room 210	Bubbler	First Draw	<0.4
9000-85-FD	Shoal Creek - 004809-Room 211	Sink Tap	First Draw	<0.4
9000-86-FD	Shoal Creek - 004810-Room 211	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9000-87-FD	Shoal Creek - 002506-Room 16	Sink Tap	First Draw	0.5
9000-88-FD	Shoal Creek - 004829-By 302	Drinking Fountain	First Draw	<0.4
9000-89-FD	Shoal Creek - 004830-By 302	Drinking Fountain	First Draw	<0.4
9000-90-FD	Shoal Creek - 004828-By 302-Staff Restroom	Sink Tap	First Draw	0.7
9000-91-FD	Shoal Creek - 002207-Girls Restroom by 302-Far Left	Sink Tap	First Draw	0.8
9000-92-FD	Shoal Creek - 002208-Girls Restroom by 302-Left Middle	Sink Tap	First Draw	1.6
9000-93-FD	Shoal Creek - 002209-Girls Restroom by 302-Middle	Sink Tap	First Draw	1
9000-94-FD	Shoal Creek - 002210-Girls Restroom by 302-Right Middle	Sink Tap	First Draw	0.8
9000-95-FD	Shoal Creek - 002211-Girls Restroom by 302-Far Right	Sink Tap	First Draw	<0.4
9000-96-FD	Shoal Creek - 002212-By 302-Boys Restroom-Far Left	Sink Tap	First Draw	<0.4
9000-97-FD	Shoal Creek - 002213-By 302-Boys Restroom-Left Middle	Sink Tap	First Draw	0.6
9000-98-FD	Shoal Creek - 002214-By 302-Boys Restroom-Right Middle	Sink Tap	First Draw	0.9
9000-99-FD	Shoal Creek - 002215-By 302-Boys Restroom-Far Right	Sink Tap	First Draw	0.5
9000-100-FD	Shoal Creek - 004845-Room 304	Sink Tap	First Draw	2.3
9000-101-FD	Shoal Creek - 004846-Room 304	Bubbler	First Draw	<0.4
9000-102-FD	Shoal Creek - 004844-Room 305	Sink Tap	First Draw	0.9
9000-104-FD	Shoal Creek - 004840-Room 306	Sink Tap	First Draw	<0.4
9000-105-FD	Shoal Creek - 004839-Room 306	Bubbler	First Draw	<0.4
9000-106-FD	Shoal Creek - 004842-Room 307	Sink Tap	First Draw	<0.4
9000-107-FD	Shoal Creek - 004841-Room 307	Bubbler	First Draw	<0.4
9000-108-FD	Shoal Creek - 004837-Room 308	Sink Tap	First Draw	0.4
9000-109-FD	Shoal Creek - 004838-Room 308	Bubbler	First Draw	<0.4
9000-110-FD	Shoal Creek - 004836-Room 309	Sink Tap	First Draw	<0.4
9000-111-FD	Shoal Creek - 004835-Room 309	Bubbler	First Draw	<0.4
9000-112-FD	Shoal Creek - 004833-Room 310	Sink Tap	First Draw	<0.4
9000-113-FD	Shoal Creek - 004834-Room 310	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9000-114-FD	Shoal Creek - 004831-Room 311	Sink Tap	First Draw	<0.4
9000-115-FD	Shoal Creek - 004832-Room 311	Bubbler	First Draw	<0.4
9000-116-FD	Shoal Creek - 004847-Room 20-Far Right	Sink Tap	First Draw	<0.4
9000-117-FD	Shoal Creek - 004848-Room 20-Right Middle	Sink Tap	First Draw	<0.4
9000-118-FD	Shoal Creek - 004849-Room 20-Left Middle	Sink Tap	First Draw	<0.4
9000-119-FD	Shoal Creek - 004850-Room 20-Far Left	Sink Tap	First Draw	<0.4
9000-120-FD	Shoal Creek - 004851-Room 21	Sink Tap	First Draw	<0.4
9000-122-FD	Shoal Creek - 004854-Girls Restroom by Cafe-Far Right	Sink Tap	First Draw	<0.4
9000-123-FD	Shoal Creek - 004855-Girls Restroom by Cafe-Right Middle	Sink Tap	First Draw	<0.4
9000-124-FD	Shoal Creek - 004856-Girls Restroom by Cafe-Left Middle	Sink Tap	First Draw	<0.4
9000-125-FD	Shoal Creek - 004857-Girls Restroom by Cafe-Far Left	Sink Tap	First Draw	<0.4
9000-126-FD	Shoal Creek - 004862B-Cafe	Drinking Fountain	First Draw	<0.4
9000-127-FD	Shoal Creek - 004862F-Cafe	Bottle Filler	First Draw	<0.4
9000-128-FD	Shoal Creek - 002093-Kitchen-Outside Office	Sink Tap	First Draw	<0.4
9000-129-FD	Shoal Creek - 002094-Kitchen-Outside Office	Sink Tap	First Draw	<0.4
9000-130-FD	Shoal Creek - 002095-Kitchen-Next to Rational Oven	Sink Tap	First Draw	<0.4
9000-131-FD	Shoal Creek - 002096-Kitchen-Next to Rational Oven	Sink Tap	First Draw	<0.4
9000-132-FD	Shoal Creek - 002097-Kitchen-Outside Dishwashing Room	Sink Tap	First Draw	<0.4
9000-133-FD	Shoal Creek - 002098-Outside Dishwasher Room	Sink Tap	First Draw	0.6
9000-134-FD	Shoal Creek - 004804-Kitchen-In Dishwasher Room	Sink Tap	First Draw	<0.4
9000-135-FD	Shoal Creek - 004805-Kitchen-In Dishwasher Room	Sink Tap	First Draw	<0.4
9000-136-FD	Shoal Creek - 004806-Kitchen-Dishwasher Room	Sink Tap	First Draw	<0.4
9000-137-FD	Shoal Creek - 004807-Kitchen-Dishwasher Room	Sink Tap	First Draw	<0.4
9000-138-FD	Shoal Creek - 004808-Kitchen-Dishwasher Room	Sink Tap	First Draw	1.6
9000-139-FD	Shoal Creek - 002100-Kitchen-Handwashing in Dish Room	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9000-140-FD	Shoal Creek - 004803-Kitchen-Handwashing by Prep Area Doorway	Sink Tap	First Draw	1.2
9000-141-FD	Shoal Creek - 002099-Kitchen-Prep Area Handwashing	Sink Tap	First Draw	<0.4
9000-142-FD	Shoal Creek - 004864-Kitchen-Staff Restroom	Sink Tap	First Draw	<0.4
9000-143-FD	Shoal Creek - 002216-Kitchen	Ice Machine	First Draw	<0.4
9000-144-FD	Shoal Creek - 004865-Gym Restroom	Sink Tap	First Draw	<0.4
9000-145-FD	Shoal Creek - 004866-Gym	Drinking Fountain	First Draw	<0.4
9000-146-FD	Shoal Creek - 004867-Gym	Drinking Fountain	First Draw	<0.4
9000-147-FD	Shoal Creek - 004858-Boys Locker Room-Far Right	Sink Tap	First Draw	<0.4
9000-148-FD	Shoal Creek - 004859-Boys Locker Room-Right Middle	Sink Tap	First Draw	<0.4
9000-149-FD	Shoal Creek - 004860-Boys Locker Room-Left Middle	Sink Tap	First Draw	<0.4
9000-150-FD	Shoal Creek - 004861-Boys Locker Room-Far Left	Sink Tap	First Draw	<0.4

April 30, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9000-69-FD	Shoal Creek - 002514-By 203-Girls-Right Middle	Sink Tap	First Draw	<0.4
9000-78-FD	Shoal Creek - 004820-Room 207	Bubbler	First Draw	<0.4
9000-103-FD	Shoal Creek - 004843-Room 305	Bubbler	First Draw	<0.4

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A
Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date:	**10/4/2023**
Expiration Date:	**10/4/2025**
License Number:	**211004-300006201**

Paula F. Nickelson
Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



Paula F. Nickelson
Acting Director
t of Health and Senior Services

son City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.

- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

PO Box 47166 Kansas City, MO 64188 • 816-678-7894 • www.axiomservicepros.com

Appendix C
Laboratory Analytical Report

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HC0071

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 9000 Northeast Flintlock Road

Project / PO Number: 9000 Northeast Flintlock Road
Received: 03/15/2024
Reported: 03/21/2024

Analytical Testing Parameters

Client Sample ID: 9000-1-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-01
Collected By: Bradley Young
Collection Date: 03/15/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1839	03/20/24 1839	RVV

Client Sample ID: 9000-2-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-02
Collected By: Bradley Young
Collection Date: 03/15/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1842	03/20/24 1842	RVV

Client Sample ID: 9000-3-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-03
Collected By: Bradley Young
Collection Date: 03/15/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1845	03/20/24 1845	RVV

Client Sample ID: 9000-4-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-04
Collected By: Bradley Young
Collection Date: 03/15/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1854	03/20/24 1854	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-5-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-05
Collected By: Bradley Young
Collection Date: 03/15/2024 0:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1857	03/20/24 1857	RVV

Client Sample ID: 9000-6-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-06
Collected By: Bradley Young
Collection Date: 03/15/2024 0:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1900	03/20/24 1900	RVV

Client Sample ID: 9000-7-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-07
Collected By: Bradley Young
Collection Date: 03/15/2024 0:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1903	03/20/24 1903	RVV

Client Sample ID: 9000-8-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-08
Collected By: Bradley Young
Collection Date: 03/15/2024 0:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1906	03/20/24 1906	RVV

Client Sample ID: 9000-9-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-09
Collected By: Bradley Young
Collection Date: 03/15/2024 0:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1909	03/20/24 1909	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-10-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-10
Collected By: Bradley Young
Collection Date: 03/15/2024 0:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1912	03/20/24 1912	RVV

Client Sample ID: 9000-11-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-11
Collected By: Bradley Young
Collection Date: 03/15/2024 0:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1921	03/20/24 1921	RVV

Client Sample ID: 9000-12-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-12
Collected By: Bradley Young
Collection Date: 03/15/2024 0:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1936	03/20/24 1936	RVV

Client Sample ID: 9000-13-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-13
Collected By: Bradley Young
Collection Date: 03/15/2024 0:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1939	03/20/24 1939	RVV

Client Sample ID: 9000-14-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-14
Collected By: Bradley Young
Collection Date: 03/15/2024 0:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1942	03/20/24 1942	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-15-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-15
Collected By: Bradley Young
Collection Date: 03/15/2024 0:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1945	03/20/24 1945	RVV

Client Sample ID: 9000-16-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-16
Collected By: Bradley Young
Collection Date: 03/15/2024 0:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1948	03/20/24 1948	RVV

Client Sample ID: 9000-17-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-17
Collected By: Bradley Young
Collection Date: 03/15/2024 0:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1951	03/20/24 1951	RVV

Client Sample ID: 9000-18-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-18
Collected By: Bradley Young
Collection Date: 03/15/2024 0:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1954	03/20/24 1954	RVV

Client Sample ID: 9000-19-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-19
Collected By: Bradley Young
Collection Date: 03/15/2024 0:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 1957	03/20/24 1957	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-20-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-20
Collected By: Bradley Young
Collection Date: 03/15/2024 0:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		03/20/24 2006	03/20/24 2006	RVV

Client Sample ID: 9000-21-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-21
Collected By: Bradley Young
Collection Date: 03/15/2024 0:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2009	03/20/24 2009	RVV

Client Sample ID: 9000-22-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-22
Collected By: Bradley Young
Collection Date: 03/15/2024 0:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2012	03/20/24 2012	RVV

Client Sample ID: 9000-23-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-23
Collected By: Bradley Young
Collection Date: 03/15/2024 0:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2015	03/20/24 2015	RVV

Client Sample ID: 9000-24-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-24
Collected By: Bradley Young
Collection Date: 03/15/2024 0:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2018	03/20/24 2018	RVV

Client Sample ID: 9000-25-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-25
Collected By: Bradley Young
Collection Date: 03/15/2024 0:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2021	03/20/24 2021	RVV

Client Sample ID: 9000-26-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-26
Collected By: Bradley Young
Collection Date: 03/15/2024 0:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2024	03/20/24 2024	RVV

Client Sample ID: 9000-27-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-27
Collected By: Bradley Young
Collection Date: 03/15/2024 0:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2027	03/20/24 2027	RVV

Client Sample ID: 9000-28-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-28
Collected By: Bradley Young
Collection Date: 03/15/2024 0:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2030	03/20/24 2030	RVV

Client Sample ID: 9000-29-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-29
Collected By: Bradley Young
Collection Date: 03/15/2024 0:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2033	03/20/24 2033	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-30-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-30
Collected By: Bradley Young
Collection Date: 03/15/2024 0:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2042	03/20/24 2042	RVV

Client Sample ID: 9000-31-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-31
Collected By: Bradley Young
Collection Date: 03/15/2024 0:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2051	03/20/24 2051	RVV

Client Sample ID: 9000-32-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-32
Collected By: Bradley Young
Collection Date: 03/15/2024 0:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2100	03/20/24 2100	RVV

Client Sample ID: 9000-33-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-33
Collected By: Bradley Young
Collection Date: 03/15/2024 0:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2103	03/20/24 2103	RVV

Client Sample ID: 9000-34-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-34
Collected By: Bradley Young
Collection Date: 03/15/2024 0:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2106	03/20/24 2106	RVV

Client Sample ID: 9000-35-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-35
Collected By: Bradley Young
Collection Date: 03/15/2024 0:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2109	03/20/24 2109	RVV

Client Sample ID: 9000-36-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-36
Collected By: Bradley Young
Collection Date: 03/15/2024 0:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2118	03/20/24 2118	RVV

Client Sample ID: 9000-37-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-37
Collected By: Bradley Young
Collection Date: 03/15/2024 0:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2121	03/20/24 2121	RVV

Client Sample ID: 9000-38-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-38
Collected By: Bradley Young
Collection Date: 03/15/2024 0:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2124	03/20/24 2124	RVV

Client Sample ID: 9000-39-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-39
Collected By: Bradley Young
Collection Date: 03/15/2024 0:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		03/20/24 2127	03/20/24 2127	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-40-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-40
Collected By: Bradley Young
Collection Date: 03/15/2024 0:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2130	03/20/24 2130	RVV

Client Sample ID: 9000-41-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-41
Collected By: Bradley Young
Collection Date: 03/15/2024 0:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2			03/20/24 2134	RVV

Client Sample ID: 9000-42-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-42
Collected By: Bradley Young
Collection Date: 03/15/2024 0:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2137	03/20/24 2137	RVV

Client Sample ID: 9000-43-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-43
Collected By: Bradley Young
Collection Date: 03/15/2024 0:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2140	03/20/24 2140	RVV

Client Sample ID: 9000-44-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-44
Collected By: Bradley Young
Collection Date: 03/15/2024 0:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2143	03/20/24 2143	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-45-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-45
Collected By: Bradley Young
Collection Date: 03/15/2024 0:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2146	03/20/24 2146	RVV

Client Sample ID: 9000-46-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-46
Collected By: Bradley Young
Collection Date: 03/15/2024 19:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2			03/20/24 2155	RVV

Client Sample ID: 9000-47-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-47
Collected By: Bradley Young
Collection Date: 03/15/2024 0:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2			03/20/24 2158	RVV

Client Sample ID: 9000-48-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-48
Collected By: Bradley Young
Collection Date: 03/15/2024 0:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2200	03/20/24 2200	RVV

Client Sample ID: 9000-49-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-49
Collected By: Bradley Young
Collection Date: 03/15/2024 0:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		03/20/24 2203	03/20/24 2203	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-50-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-50
Collected By: Bradley Young
Collection Date: 03/15/2024 0:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2206	03/20/24 2206	RVV

Client Sample ID: 9000-51-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-51
Collected By: Bradley Young
Collection Date: 03/15/2024 0:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2215	03/20/24 2215	RVV

Client Sample ID: 9000-52-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-52
Collected By: Bradley Young
Collection Date: 03/15/2024 0:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		03/20/24 2230	03/20/24 2230	RVV

Client Sample ID: 9000-53-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-53
Collected By: Bradley Young
Collection Date: 03/15/2024 0:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2233	03/20/24 2233	RVV

Client Sample ID: 9000-54-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-54
Collected By: Bradley Young
Collection Date: 03/15/2024 0:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		03/20/24 2236	03/20/24 2236	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-55-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-55
Collected By: Bradley Young
Collection Date: 03/15/2024 0:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2239	03/20/24 2239	RVV

Client Sample ID: 9000-56-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-56
Collected By: Bradley Young
Collection Date: 03/15/2024 0:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2242	03/20/24 2242	RVV

Client Sample ID: 9000-57-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-57
Collected By: Bradley Young
Collection Date: 03/15/2024 0:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2245	03/20/24 2245	RVV

Client Sample ID: 9000-58-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-58
Collected By: Bradley Young
Collection Date: 03/15/2024 0:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2248	03/20/24 2248	RVV

Client Sample ID: 9000-59-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-59
Collected By: Bradley Young
Collection Date: 03/15/2024 0:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2251	03/20/24 2251	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID:	9000-60-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HC0071-60	**Collection Date:**	03/15/2024 0:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2254	03/20/24 2254	RVV

Client Sample ID:	9000-61-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HC0071-61	**Collection Date:**	03/15/2024 0:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2257	03/20/24 2257	RVV

Client Sample ID:	9000-62-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HC0071-62	**Collection Date:**	03/15/2024 0:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2306	03/20/24 2306	RVV

Client Sample ID:	9000-63-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HC0071-63	**Collection Date:**	03/15/2024 0:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2309	03/20/24 2309	RVV

Client Sample ID:	9000-64-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HC0071-64	**Collection Date:**	03/15/2024 0:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2312	03/20/24 2312	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-65-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-65
Collected By: Bradley Young
Collection Date: 03/15/2024 0:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2315	03/20/24 2315	RVV

Client Sample ID: 9000-66-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-66
Collected By: Bradley Young
Collection Date: 03/15/2024 0:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2318	03/20/24 2318	RVV

Client Sample ID: 9000-67-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-67
Collected By: Bradley Young
Collection Date: 03/15/2024 0:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2321	03/20/24 2321	RVV

Client Sample ID: 9000-68-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-68
Collected By: Bradley Young
Collection Date: 03/15/2024 0:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		03/20/24 2324	03/20/24 2324	RVV

Client Sample ID: 9000-70-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-69
Collected By: Bradley Young
Collection Date: 03/15/2024 0:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2327	03/20/24 2327	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-71-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-70
Collected By: Bradley Young
Collection Date: 03/15/2024 0:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		03/20/24 2330	03/20/24 2330	RVV

Client Sample ID: 9000-72-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-71
Collected By: Bradley Young
Collection Date: 03/15/2024 0:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2345	03/20/24 2345	RVV

Client Sample ID: 9000-73-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-72
Collected By: Bradley Young
Collection Date: 03/15/2024 0:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2354	03/20/24 2354	RVV

Client Sample ID: 9000-74-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-73
Collected By: Bradley Young
Collection Date: 03/15/2024 0:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/20/24 2357	03/20/24 2357	RVV

Client Sample ID: 9000-75-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-74
Collected By: Bradley Young
Collection Date: 03/15/2024 0:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0000	03/21/24 0000	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-76-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-75
Collected By: Bradley Young
Collection Date: 03/15/2024 0:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0003	03/21/24 0003	RVV

Client Sample ID: 9000-77-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-76
Collected By: Bradley Young
Collection Date: 03/15/2024 0:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		03/21/24 0006	03/21/24 0006	RVV

Client Sample ID: 9000-79-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-77
Collected By: Bradley Young
Collection Date: 03/15/2024 0:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0009	03/21/24 0009	RVV

Client Sample ID: 9000-80-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-78
Collected By: Bradley Young
Collection Date: 03/15/2024 0:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0017	03/21/24 0017	RVV

Client Sample ID: 9000-81-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-79
Collected By: Bradley Young
Collection Date: 03/15/2024 0:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		03/21/24 0020	03/21/24 0020	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-82-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-80
Collected By: Bradley Young
Collection Date: 03/15/2024 0:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0023	03/21/24 0023	RVV

Client Sample ID: 9000-83-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-81
Collected By: Bradley Young
Collection Date: 03/15/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0026	03/21/24 0026	RVV

Client Sample ID: 9000-84-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-82
Collected By: Bradley Young
Collection Date: 03/15/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0029	03/21/24 0029	RVV

Client Sample ID: 9000-85-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-83
Collected By: Bradley Young
Collection Date: 03/15/2024 0:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0032	03/21/24 0032	RVV

Client Sample ID: 9000-86-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-84
Collected By: Bradley Young
Collection Date: 03/15/2024 0:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0035	03/21/24 0035	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-87-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-85
Collected By: Bradley Young
Collection Date: 03/15/2024 0:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		03/21/24 0038	03/21/24 0038	RVV

Client Sample ID: 9000-88-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-86
Collected By: Bradley Young
Collection Date: 03/15/2024 0:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0041	03/21/24 0041	RVV

Client Sample ID: 9000-89-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-87
Collected By: Bradley Young
Collection Date: 03/15/2024 0:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0044	03/21/24 0044	RVV

Client Sample ID: 9000-90-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-88
Collected By: Bradley Young
Collection Date: 03/15/2024 0:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		03/21/24 0053	03/21/24 0053	RVV

Client Sample ID: 9000-91-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-89
Collected By: Bradley Young
Collection Date: 03/15/2024 0:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		03/21/24 0056	03/21/24 0056	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-92-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-90
Collected By: Bradley Young
Collection Date: 03/15/2024 0:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		03/21/24 0059	03/21/24 0059	RVV

Client Sample ID: 9000-93-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-91
Collected By: Bradley Young
Collection Date: 03/15/2024 0:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		03/21/24 0108	03/21/24 0108	RVV

Client Sample ID: 9000-94-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-92
Collected By: Bradley Young
Collection Date: 03/15/2024 0:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		03/21/24 0117	03/21/24 0117	RVV

Client Sample ID: 9000-95-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-93
Collected By: Bradley Young
Collection Date: 03/15/2024 0:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0120	03/21/24 0120	RVV

Client Sample ID: 9000-96-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-94
Collected By: Bradley Young
Collection Date: 03/15/2024 0:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0129	03/21/24 0129	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-97-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-95
Collected By: Bradley Young
Collection Date: 03/15/2024 0:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		03/21/24 0132	03/21/24 0132	RVV

Client Sample ID: 9000-98-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-96
Collected By: Bradley Young
Collection Date: 03/15/2024 0:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		03/21/24 0135	03/21/24 0135	RVV

Client Sample ID: 9000-99-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-97
Collected By: Bradley Young
Collection Date: 03/15/2024 0:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		03/21/24 0138	03/21/24 0138	RVV

Client Sample ID: 9000-100-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-98
Collected By: Bradley Young
Collection Date: 03/15/2024 0:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.3**	0.4	ppb	2		03/21/24 0141	03/21/24 0141	RVV

Client Sample ID: 9000-101-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-99
Collected By: Bradley Young
Collection Date: 03/15/2024 0:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0144	03/21/24 0144	RVV

Client Sample ID: 9000-102-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AA
Collected By: Bradley Young
Collection Date: 03/15/2024 0:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		03/21/24 0147	03/21/24 0147	RVV

Client Sample ID: 9000-104-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AB
Collected By: Bradley Young
Collection Date: 03/15/2024 0:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0150	03/21/24 0150	RVV

Client Sample ID: 9000-105-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AC
Collected By: Bradley Young
Collection Date: 03/15/2024 0:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0153	03/21/24 0153	RVV

Client Sample ID: 9000-106-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AD
Collected By: Bradley Young
Collection Date: 03/15/2024 0:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0156	03/21/24 0156	RVV

Client Sample ID: 9000-107-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AE
Collected By: Bradley Young
Collection Date: 03/15/2024 0:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0205	03/21/24 0205	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-108-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AF
Collected By: Bradley Young
Collection Date: 03/15/2024 0:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		03/21/24 0208	03/21/24 0208	RVV

Client Sample ID: 9000-109-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AG
Collected By: Bradley Young
Collection Date: 03/15/2024 0:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0211	03/21/24 0211	RVV

Client Sample ID: 9000-110-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AH
Collected By: Bradley Young
Collection Date: 03/15/2024 0:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0214	03/21/24 0214	RVV

Client Sample ID: 9000-111-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AI
Collected By: Bradley Young
Collection Date: 03/15/2024 0:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0217	03/21/24 0217	RVV

Client Sample ID: 9000-112-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AJ
Collected By: Bradley Young
Collection Date: 03/15/2024 0:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0220	03/21/24 0220	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-113-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AK
Collected By: Bradley Young
Collection Date: 03/15/2024 0:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0223	03/21/24 0223	RVV

Client Sample ID: 9000-114-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AL
Collected By: Bradley Young
Collection Date: 03/15/2024 0:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0232	03/21/24 0232	RVV

Client Sample ID: 9000-115-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AM
Collected By: Bradley Young
Collection Date: 03/15/2024 0:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0247	03/21/24 0247	RVV

Client Sample ID: 9000-116-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AN
Collected By: Bradley Young
Collection Date: 03/15/2024 0:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0250	03/21/24 0250	RVV

Client Sample ID: 9000-117-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AO
Collected By: Bradley Young
Collection Date: 03/15/2024 0:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0253	03/21/24 0253	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-118-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AP
Collected By: Bradley Young
Collection Date: 03/15/2024 0:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0256	03/21/24 0256	RVV

Client Sample ID: 9000-119-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AQ
Collected By: Bradley Young
Collection Date: 03/15/2024 0:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0259	03/21/24 0259	RVV

Client Sample ID: 9000-120-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AR
Collected By: Bradley Young
Collection Date: 03/15/2024 0:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0302	03/21/24 0302	RVV

Client Sample ID: 9000-122-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AS
Collected By: Bradley Young
Collection Date: 03/15/2024 0:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0305	03/21/24 0305	RVV

Client Sample ID: 9000-123-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AT
Collected By: Bradley Young
Collection Date: 03/15/2024 0:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0308	03/21/24 0308	RVV

Client Sample ID: 9000-124-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AU
Collected By: Bradley Young
Collection Date: 03/15/2024 0:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0317	03/21/24 0317	RVV

Client Sample ID: 9000-125-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AV
Collected By: Bradley Young
Collection Date: 03/15/2024 0:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0320	03/21/24 0320	RVV

Client Sample ID: 9000-126-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AW
Collected By: Bradley Young
Collection Date: 03/15/2024 0:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0323	03/21/24 0323	RVV

Client Sample ID: 9000-127-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AX
Collected By: Bradley Young
Collection Date: 03/15/2024 0:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0326	03/21/24 0326	RVV

Client Sample ID: 9000-128-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AY
Collected By: Bradley Young
Collection Date: 03/15/2024 0:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0329	03/21/24 0329	RVV

Client Sample ID: 9000-129-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-AZ
Collected By: Bradley Young
Collection Date: 03/15/2024 0:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0332	03/21/24 0332	RVV

Client Sample ID: 9000-130-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BA
Collected By: Bradley Young
Collection Date: 03/15/2024 0:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0335	03/21/24 0335	RVV

Client Sample ID: 9000-131-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BB
Collected By: Bradley Young
Collection Date: 03/15/2024 0:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0338	03/21/24 0338	RVV

Client Sample ID: 9000-132-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BC
Collected By: Bradley Young
Collection Date: 03/15/2024 0:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0341	03/21/24 0341	RVV

Client Sample ID: 9000-133-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BD
Collected By: Bradley Young
Collection Date: 03/15/2024 0:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		03/21/24 0344	03/21/24 0344	RVV

Client Sample ID: 9000-134-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BE
Collected By: Bradley Young
Collection Date: 03/15/2024 0:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0353	03/21/24 0353	RVV

Client Sample ID: 9000-135-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BF
Collected By: Bradley Young
Collection Date: 03/15/2024 0:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0402	03/21/24 0402	RVV

Client Sample ID: 9000-136-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BG
Collected By: Bradley Young
Collection Date: 03/15/2024 0:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0411	03/21/24 0411	RVV

Client Sample ID: 9000-137-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BH
Collected By: Bradley Young
Collection Date: 03/15/2024 0:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0414	03/21/24 0414	RVV

Client Sample ID: 9000-138-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BI
Collected By: Bradley Young
Collection Date: 03/15/2024 0:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		03/21/24 0417	03/21/24 0417	RVV

Client Sample ID: 9000-139-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BJ
Collected By: Bradley Young
Collection Date: 03/15/2024 0:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0420	03/21/24 0420	RVV

Client Sample ID: 9000-140-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BK
Collected By: Bradley Young
Collection Date: 03/15/2024 0:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		03/21/24 0429	03/21/24 0429	RVV

Client Sample ID: 9000-141-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BL
Collected By: Bradley Young
Collection Date: 03/15/2024 0:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0432	03/21/24 0432	RVV

Client Sample ID: 9000-142-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BM
Collected By: Bradley Young
Collection Date: 03/15/2024 0:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0435	03/21/24 0435	RVV

Client Sample ID: 9000-143-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BN
Collected By: Bradley Young
Collection Date: 03/15/2024 0:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0438	03/21/24 0438	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID: 9000-144-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BO
Collected By: Bradley Young
Collection Date: 03/15/2024 0:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0441	03/21/24 0441	RVV

Client Sample ID: 9000-145-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BP
Collected By: Bradley Young
Collection Date: 03/15/2024 0:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0444	03/21/24 0444	RVV

Client Sample ID: 9000-146-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BQ
Collected By: Bradley Young
Collection Date: 03/15/2024 0:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0447	03/21/24 0447	RVV

Client Sample ID: 9000-147-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BR
Collected By: Bradley Young
Collection Date: 03/15/2024 0:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2			03/21/24 0451	RVV

Client Sample ID: 9000-148-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HC0071-BS
Collected By: Bradley Young
Collection Date: 03/15/2024 0:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0454	03/21/24 0454	RVV

CERTIFICATE OF ANALYSIS

3HC0071

Client Sample ID:	9000-149-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HC0071-BT	**Collection Date:**	03/15/2024 0:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/21/24 0457	03/21/24 0457	RVV

Client Sample ID:	9000-150-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HC0071-BU	**Collection Date:**	03/15/2024 0:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2			03/21/24 0506	RVV

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Victoria Bruck
Field Technician II
03/21/24 13:30

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Brady Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC00071
														Short Hold:	
														Rush:	
														Temp: oC	19.3°C
9000-1-FD	3/15/2024	00:00	Shoal Creek - Sink Tap - 002051-Room 001A	1	Wt	Grab	X								01
9000-2-FD	3/15/2024	00:00	Shoal Creek - Ice Machine - 004905-Teachers Lounge	1	Wt	Grab	X								02
9000-3-FD	3/15/2024	00:00	Shoal Creek - Sink Tap - 002052-Room 001A	1	Wt	Grab	X								03
9000-4-FD	3/15/2024	00:00	Shoal Creek - Sink Tap - 002053-Room 001A	1	Wt	Grab	X								04
9000-5-FD	3/15/2024	00:01	Shoal Creek - Sink Tap - 002504-Nurse Office-Bathroom	1	Wt	Grab	X								05
9000-6-FD	3/15/2024	00:01	Shoal Creek - Sink Tap - 002505-Nurse Office	1	Wt	Grab	X								06
9000-7-FD	3/15/2024	00:02	Shoal Creek - Sink Tap - 002055-Handwashing by 407-Girls	1	Wt	Grab	X								07

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
			Vithi Rh	Time:	9:20	
	Time:					

3HC00071

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___	600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___	3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X	835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___	205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC0071
														Short Hold:	
														Rush:	
														Temp: oC	
9000-8-FD	3/15/2024	00:02	Shoal Creek - Sink Tap - 002054-Handwashing by 407-Boys	1	Wt	Grab	X								08
9000-9-FD	3/15/2024	00:02	Shoal Creek - Drinking Fountain - 002056-By Room 400-Left	1	Wt	Grab	X								09
9000-10-FD	3/15/2024	00:03	Shoal Creek - Drinking Fountain - 002056B-By Room 400-Right	1	Wt	Grab	X								10
9000-11-FD	3/15/2024	00:03	Shoal Creek - Bottle Filler - 002056F-By Room 400	1	Wt	Grab	X								11
9000-12-FD	3/15/2024	00:04	Shoal Creek - Drinking Fountain - 002089-By Room 103	1	Wt	Grab	X								12
9000-13-FD	3/15/2024	00:04	Shoal Creek - Drinking Fountain - 002090-By Room 103	1	Wt	Grab	X								13
9000-14-FD	3/15/2024	00:04	Shoal Creek - Bottle Filler - 002090-By 103	1	Wt	Grab	X								14

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3HC0071

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
9000-15-FD	3/15/2024	00:04	Shoal Creek - Sink Tap - 002091-Staff Bathroom by 103	1	Wt	Grab	X								15
9000-16-FD	3/15/2024	00:05	Shoal Creek - Sink Tap - 004906-Boys Bathrooms by 103-Far Left	1	Wt	Grab	X								16
9000-17-FD	3/15/2024	00:05	Shoal Creek - Sink Tap - 004907-Across from 103-Boys Bathroom-Left Middle	1	Wt	Grab	X								17
9000-18-FD	3/15/2024	00:05	Shoal Creek - Sink Tap - 004908-Across from 103-Boys Bathroom-Right Middle	1	Wt	Grab	X								18
9000-19-FD	3/15/2024	00:05	Shoal Creek - Sink Tap - 002201-Across from 103-Boys Bathroom-Far Right	1	Wt	Grab	X								19
9000-20-FD	3/15/2024	00:06	Shoal Creek - Sink Tap - 002202-By 103-Girls RR-Far Left	1	Wt	Grab	X								20
9000-21-FD	3/15/2024	00:06	Shoal Creek - Sink Tap - 002203-By 103-Girls RR-Left Middle	1	Wt	Grab	X								21

LAB USE ONLY
Wk Order #: 3HC0071
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
			V-Air Bld.	3/15/24	

3 H C 0 0 7 1

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HC0071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-22-FD	3/15/2024	00:07	Shoal Creek - Sink Tap - 002204-By 103-Girls RR-Middle	1	Wt	Grab	X								22
9000-23-FD	3/15/2024	00:07	Shoal Creek - Sink Tap - 002205-By 103-Girls RR-Right Middle	1	Wt	Grab	X								23
9000-24-FD	3/15/2024	00:07	Shoal Creek - Sink Tap - 002205-By 103-Girls RR-Far Right	1	Wt	Grab	X								24
9000-25-FD	3/15/2024	00:07	Shoal Creek - Sink Tap - 002085-Room 104	1	Wt	Grab	X								25
9000-26-FD	3/15/2024	00:08	Shoal Creek - Bubbler - 002086-Room 104	1	Wt	Grab	X								26
9000-27-FD	3/15/2024	00:08	Shoal Creek - Sink Tap - 002088-Room 105	1	Wt	Grab	X								27
9000-28-FD	3/15/2024	00:08	Shoal Creek - Bubbler - 002087-Room 105	1	Wt	Grab	X								28

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3HC0071

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
9000-29-FD	3/15/2024	00:08	Shoal Creek - Sink Tap - 002081-Room 106	1	Wt	Grab	X								29
9000-30-FD	3/15/2024	00:09	Shoal Creek - Bubbler - 002082-Room 106	1	Wt	Grab	X								30
9000-31-FD	3/15/2024	00:09	Shoal Creek - Sink Tap - 002084-Room 107	1	Wt	Grab	X								31
9000-32-FD	3/15/2024	00:09	Shoal Creek - Bubbler - 002083-Room 107	1	Wt	Grab	X								32
9000-33-FD	3/15/2024	00:09	Shoal Creek - Sink Tap - 002080-Room 108	1	Wt	Grab	X								33
9000-34-FD	3/15/2024	00:10	Shoal Creek - Bubbler - 002079-Room 108	1	Wt	Grab	X								34
9000-35-FD	3/15/2024	00:10	Shoal Creek - Sink Tap - 002078-Room 109	1	Wt	Grab	X								35

LAB USE ONLY: Wk Order #: 3HC0071; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
9000-36-FD	3/15/2024	00:10	Shoal Creek - Bubbler - 002077-Room 109	1	Wt	Grab	X								36
9000-37-FD	3/15/2024	00:10	Shoal Creek - Sink Tap - 002061-Room 110	1	Wt	Grab	X								37
9000-38-FD	3/15/2024	00:11	Shoal Creek - Bubbler - 002062-Room 110	1	Wt	Grab	X								38
9000-39-FD	3/15/2024	00:11	Shoal Creek - Sink Tap - 002069-Room 110	1	Wt	Grab	X								39
9000-40-FD	3/15/2024	00:11	Shoal Creek - Bubbler - 002070-Room 110	1	Wt	Grab	X								40
9000-41-FD	3/15/2024	00:11	Shoal Creek - Sink Tap - 002071-Room 110-Bathroom	1	Wt	Grab	X								41
9000-42-FD	3/15/2024	00:12	Shoal Creek - Sink Tap - 002072-Room 111	1	Wt	Grab	X								42

LAB USE ONLY
Wk Order #: 3HC0071
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Vitin Bhl	3/15/24		
	Time:			Time:		
				9:20		

3 H C 0 0 7 1

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___	600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___	3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X	835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___	205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
9000-43-FD	3/15/2024	00:12	Shoal Creek - Bubbler - 002073-Room 111	1	Wt	Grab	X								43
9000-44-FD	3/15/2024	00:12	Shoal Creek - Sink Tap - 002075-Room 111	1	Wt	Grab	X								44
9000-45-FD	3/15/2024	00:12	Shoal Creek - Bubbler - 002074-Room 111	1	Wt	Grab	X								45
9000-46-FD	3/15/2024	19:13	Shoal Creek - Sink Tap - 002076-Room 111-Bathroom	1	Wt	Grab	X								46
9000-47-FD	3/15/2024	00:13	Shoal Creek - Sink Tap - 002059-Room 112	1	Wt	Grab	X								47
9000-48-FD	3/15/2024	00:13	Shoal Creek - Bubbler - 002060-Room 112	1	Wt	Grab	X								48
9000-49-FD	3/15/2024	00:13	Shoal Creek - Sink Tap - 002067-Room 112	1	Wt	Grab	X								49

LAB USE ONLY
Wk Order #: 3HC0071
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 1

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HC0071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-50-FD	3/15/2024	00:14	Shoal Creek - Bubbler - 002516-Room 112	1	Wt	Grab	X								50
9000-51-FD	3/15/2024	00:14	Shoal Creek - Sink Tap - 002068-Room 112-Bathroom	1	Qt	Grab	X								51
9000-52-FD	3/15/2024	00:14	Shoal Creek - Sink Tap - 002057-Room 113	1	Wt	Grab	X								52
9000-53-FD	3/15/2024	00:15	Shoal Creek - Bubbler - 002058-Room 113	1	Wt	Grab	X								53
9000-54-FD	3/15/2024	00:15	Shoal Creek - Sink Tap - 002064-Room 113	1	Wt	Composite	X								54
9000-55-FD	3/15/2024	00:15	Shoal Creek - Bubbler - 002063-Room 113	1	Wt	Grab	X								55
9000-56-FD	3/15/2024	00:15	Shoal Creek - Sink Tap - 002065-Room 113-Bathroom	1	Wt	Grab	X								56

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				3/15/24		
	Time:			Time:		
				9:20		

3HC0071

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HC00071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-57-FD	3/15/2024	00:17	Shoal Creek - Sink Tap - 004853-Library Bathroom	1	Wt	Grab	X								57
9000-58-FD	3/15/2024	00:18	Shoal Creek - Drinking Fountain - 004826-By Room 203	1	Wt	Grab	X								58
9000-59-FD	3/15/2024	00:18	Shoal Creek - Bottle Filler - 004826F-By 203	1	Wt	Grab	X								59
9000-60-FD	3/15/2024	00:18	Shoal Creek - Drinking Fountain - 004825-By Room 203	1	Wt	Grab	X								60
9000-61-FD	3/15/2024	00:19	Shoal Creek - Sink Tap - 004827-Staff Bathroom by 203	1	Wt	Grab	X								61
9000-62-FD	3/15/2024	00:19	Shoal Creek - Sink Tap - 002507-Boys Bathroom by 203-Far Left	1	Wt	Grab	X								62
9000-63-FD	3/15/2024	00:19	Shoal Creek - Sink Tap - 002508-Boys Locker Room by 203-Left Middle	1	Wt	Grab	X								63

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC0071
														Short Hold:	
														Rush:	
														Temp: oC	
9000-64-FD	3/15/2024	00:19	Shoal Creek - Sink Tap - 002509-Boys Bathroom by 203-Right Middle	1	Wt	Grab	X								64
9000-65-FD	3/15/2024	00:20	Shoal Creek - Sink Tap - 002510-Boys Bathroom by 203-Far Right	1	Wt	Grab	X								65
9000-66-FD	3/15/2024	00:20	Shoal Creek - Sink Tap - 002511-Girls Bathroom by 203-Far Left	1	Wt	Grab	X								66
9000-67-FD	3/15/2024	00:20	Shoal Creek - Sink Tap - 002512-Girls Bathroom by 203-Left Middle	1	Wt	Grab	X								67
9000-68-FD	3/15/2024	00:20	Shoal Creek - Sink Tap - 002513-Girls Bathroom by 203-Middle	1	Wt	Grab	X								68
9000-70-FD	3/15/2024	00:21	Shoal Creek - Sink Tap - 002515-Girls Bathroom by 203-	1	Qt	Grab	X								69
9000-71-FD	3/15/2024	00:21	Shoal Creek - Sink Tap - 004823-Room 204	1	Wt	Grab	X								70

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3HC0071

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HC0071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-72-FD	3/15/2024	00:21	Shoal Creek - Bubbler - 004824-Room 204	1	Wt	Grab	X								71
9000-73-FD	3/15/2024	00:21	Shoal Creek - Sink Tap - 004821-Room 205	1	Wt	Grab	X								72
9000-74-FD	3/15/2024	00:23	Shoal Creek - Sink Tap - 004822-Room 205	1	Wt	Grab	X								73
9000-75-FD	3/15/2024	00:23	Shoal Creek - Sink Tap - 004817-Room 206	1	Wt	Grab	X								74
9000-76-FD	3/15/2024	00:23	Shoal Creek - Bubbler - 004818-Room 206	1	Wt	Grab	X								75
9000-77-FD	3/15/2024	00:24	Shoal Creek - Sink Tap - 004819-Room 207	1	Wt	Grab	X								76
9000-79-FD	3/15/2024	00:24	Shoal Creek - Sink Tap - 004815-Room 208	1	Wt	Grab	X								77

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				3/15/24		
	Time:			Time:		
				9:20		

3 H C 0 0 7 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
9000-80-FD	3/15/2024	00:25	Shoal Creek - Sink Tap - 004816-Room 208	1	Wt	Grab	X								78
9000-81-FD	3/15/2024	00:25	Shoal Creek - Sink Tap - 004814-Room 209	1	Wt	Grab	X								79
9000-82-FD	3/15/2024	00:24	Shoal Creek - Bubbler - 004813-Room 209	1	Wt	Grab	X								80
9000-83-FD	3/15/2024	00:26	Shoal Creek - Sink Tap - 004811-Room 210	1	Wt	Grab	X								81
9000-84-FD	3/15/2024	00:26	Shoal Creek - Bubbler - 004812-Room 210	1	Wt	Grab	X								82
9000-85-FD	3/15/2024	00:26	Shoal Creek - Sink Tap - 004809-Room 211	1	Wt	Grab	X								83
9000-86-FD	3/15/2024	00:27	Shoal Creek - Bubbler - 004810-Room 211	1	Wt	Grab	X								84

LAB USE ONLY: Wk Order #: 3HC0071; Short Hold: ; Rush: ; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC0071
														Short Hold:	
														Rush:	
														Temp: oC	
9000-87-FD	3/15/2024	00:28	Shoal Creek - Sink Tap - 002506-Room 16	1	Wt	Grab	X								85
9000-88-FD	3/15/2024	00:29	Shoal Creek - Drinking Fountain - 004829-By 302	1	Wt	Grab	X								86
9000-89-FD	3/15/2024	00:28	Shoal Creek - Drinking Fountain - 004830-By 302	1	Wt	Grab	X								87
9000-90-FD	3/15/2024	00:29	Shoal Creek - Sink Tap - 004828-By 302-Staff Bathroom	1	Wt	Grab	X								88
9000-91-FD	3/15/2024	00:29	Shoal Creek - Sink Tap - 002207-Girls Bathrooms by 302-Far Left	1	Wt	Grab	X								89
9000-92-FD	3/15/2024	00:31	Shoal Creek - Sink Tap - 002208-Girls Bathrooms by 302-Left Middle	1	Wt	Grab	X								90
9000-93-FD	3/15/2024	00:31	Shoal Creek - Sink Tap - 002209-Girls Bathrooms by 302-Middle	1	Wt	Grab	X								91

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date: 3/15/24	
				Time: 9:20	
	Time:				

3HC0071

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___	600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___	3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X	835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___	205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:

SAMPLER:	
SITE NAME:	Shoal Creek Elementary School
ADDRESS:	9000 Northeast Flintlock Road
CITY/ST/ZIP:	Kansas City, Missouri 64157
PHONE:	816-522-2275

REPORT TO:

NAME:	Jeff Hurst
CO. NAME:	
ADRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-678-7894
EMAIL:	jeffh@axiomservicepros.com

BILL TO:

NAME:	Jeff Hurst
CO. NAME:	
ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-678-7894
EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HC0071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-94-FD	3/15/2024	00:31	Shoal Creek - Sink Tap - 002210-Girls Bathrooms by 302-Right Middle	1	Wt	Grab	X								92
9000-95-FD	3/15/2024	00:32	Shoal Creek - Sink Tap - 002211-Girls Bathroom by 302-Far Right	1	Wt	Grab	X								93
9000-96-FD	3/15/2024	00:32	Shoal Creek - Sink Tap - 002212-By 302-Boys RR-Far Left	1	Wt	Grab	X								94
9000-97-FD	3/15/2024	00:32	Shoal Creek - Sink Tap - 002213-By 302-Boys RR-Left Middle	1	Wt	Grab	X								95
9000-98-FD	3/15/2024	00:33	Shoal Creek - Sink Tap - 002214-By 302-Boys RR-Right Middle	1	Wt	Grab	X								96
9000-99-FD	3/15/2024	00:33	Shoal Creek - Sink Tap - 002215-By 302-Boys RR-Far Right	1	Wt	Grab	X								97
9000-100-FD	3/15/2024	00:34	Shoal Creek - Sink Tap - 004845-Room 304	1	Wt	Grab	X								98

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HC00071
														Short Hold:	
														Rush:	
														Temp: oC	
9000-101-FD	3/15/2024	00:34	Shoal Creek - Bubbler - 004846-Room 304	1	Wt	Grab	X								99
9000-102-FD	3/15/2024	00:35	Shoal Creek - Sink Tap - 004844-Room 305	1	Wt	Grab	X								AA
9000-104-FD	3/15/2024	00:35	Shoal Creek - Sink Tap - 004840-Room 306	1	Wt	Grab	X								AB
9000-105-FD	3/15/2024	00:36	Shoal Creek - Bubbler - 004839-Room 306	1	Wt	Grab	X								AC
9000-106-FD	3/15/2024	00:36	Shoal Creek - Sink Tap - 004842-Room 307	1	Wt	Grab	X								AD
9000-107-FD	3/15/2024	00:36	Shoal Creek - Bubbler - 004841-Room 307	1	Wt	Grab	X								AE
9000-108-FD	3/15/2024	00:37	Shoal Creek - Sink Tap - 004837-Room 308	1	Wt	Grab	X								AF

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3HC00071

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HC0071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-109-FD	3/15/2024	00:37	Shoal Creek - Bubbler - 004838-Room 308	1	Wt	Grab	X								AG
9000-110-FD	3/15/2024	00:37	Shoal Creek - Sink Tap - 004836-Room 309	1	Wt	Grab	X								AH
9000-111-FD	3/15/2024	00:38	Shoal Creek - Bubbler - 004835-Room 309	1	Wt	Grab	X								AI
9000-112-FD	3/15/2024	00:38	Shoal Creek - Sink Tap - 004833-Room 310	1	Wt	Grab	X								AJ
9000-113-FD	3/15/2024	00:38	Shoal Creek - Bubbler - 004834-Room 310	1	Wt	Grab	X								AK
9000-114-FD	3/15/2024	00:38	Shoal Creek - Sink Tap - 004831-Room 311	1	Wt	Grab	X								AL
9000-115-FD	3/15/2024	00:39	Shoal Creek - Bubbler - 004832-Room 311	1	Wt	Grab	X								AM

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
9000-116-FD	3/15/2024	00:41	Shoal Creek - Sink Tap - 004847-Room 20-Far Right	1	Wt	Grab	X								AN
9000-117-FD	3/15/2024	00:41	Shoal Creek - Sink Tap - 004848-Room 20-Right Middle	1	Wt	Grab	X								AO
9000-118-FD	3/15/2024	00:41	Shoal Creek - Sink Tap - 004849-Room 20-Left Middle	1	Wt	Grab	X								AP
9000-119-FD	3/15/2024	00:41	Shoal Creek - Sink Tap - 004850-Room 20-Far Left	1	Wt	Grab	X								AQ
9000-120-FD	3/15/2024	00:42	Shoal Creek - Sink Tap - 004851-Room 21	1	Wt	Grab	X								@AR
9000-122-FD	3/15/2024	00:43	Shoal Creek - Sink Tap - 004854-Girls Bathroom by Cafe-Far Right	1	Wt	Grab	X								AS
9000-123-FD	3/15/2024	00:43	Shoal Creek - Sink Tap - 004855-Girls Bathroom by Cafe-Right Middle	1	Wt	Grab	X								AT

LAB USE ONLY
Wk Order #: 3HC0071
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HC00071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-124-FD	3/15/2024	00:43	Shoal Creek - Sink Tap - 004856-Girls Bathroom by Cafe-Left Middle	1	Wt	Grab	X								AU
9000-125-FD	3/15/2024	00:43	Shoal Creek - Sink Tap - 004857-Girls Bathroom by Cafe-Far Left	1	Wt	Grab	X								AV
9000-126-FD	3/15/2024	00:44	Shoal Creek - Drinking Fountain - 004862B-Cafe	1	Wt	Grab	X								AW
9000-127-FD	3/15/2024	00:44	Shoal Creek - Bottle Filler - 004862F-Cafe	1	Wt	Grab	X								AX
9000-128-FD	3/15/2024	00:46	Shoal Creek - Sink Tap - 002093-Kitchen-Outside Office	1	Wt	Grab	X								AY
9000-129-FD	3/15/2024	00:46	Shoal Creek - Sink Tap - 002094-Kitchen-Outside Office	1	Wt	Grab	X								AZ
9000-130-FD	3/15/2024	00:46	Shoal Creek - Sink Tap - 002095-Kitchen-Next to Rational Oven	1	Wt	Grab	X								BA

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
	Time:			Time:	9:20	

3HC00071

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HC0071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-131-FD	3/15/2024	00:47	Shoal Creek - Sink Tap - 002096-Kitchen-Next to Rational Oven	1	Wt	Grab	X								BB
9000-132-FD	3/15/2024	00:47	Shoal Creek - Sink Tap - 002097-Kitchen-Outside Dishwashing Room	1	Wt	Grab	X								BC
9000-133-FD	3/15/2024	00:47	Shoal Creek - Sink Tap - 002098-Outside Dishwasher Room	1	Wt	Grab	X								BD
9000-134-FD	3/15/2024	00:48	Shoal Creek - Sink Tap - 004804-Kitchen-In Dishwasher Room	1	Wt	Grab	X								BE
9000-135-FD	3/15/2024	00:48	Shoal Creek - Sink Tap - 004805-Kitchen-In Dishwasher Room	1	Wt	Grab	X								BF
9000-136-FD	3/15/2024	00:48	Shoal Creek - Sink Tap - 004806-Kitchen-Dishwasher Room	1	Wt	Grab	X								BG
9000-137-FD	3/15/2024	00:48	Shoal Creek - Sink Tap - 004807-Kitchen-Dishwasher Room	1	Wt	Grab	X								BH

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
					Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
				3/15/24	
	Time:			Time:	
				9:20	

3HC0071

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HC0071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-138-FD	3/15/2024	00:49	Shoal Creek - Sink Tap - 004808-Kitchen-Dishwasher Room	1	Wt	Grab	X								B1
9000-139-FD	3/15/2024	00:49	Shoal Creek - Sink Tap - 002100-Kitchen-Handwashing in Dish Room	1	Wt	Grab	X								BJ
9000-140-FD	3/15/2024	00:49	Shoal Creek - Sink Tap - 004803-Kitchen-Handwashing by Prep Area Doorway	1	Wt	Grab	X								BK
9000-141-FD	3/15/2024	00:49	Shoal Creek - Sink Tap - 002099-Kitchen-Prep Area Handwashing	1	Wt	Grab	X								BL
9000-142-FD	3/15/2024	00:49	Shoal Creek - Sink Tap - 004864-Kitchen-Staff Restroom	1	Wt	Grab	X								BM
9000-143-FD	3/15/2024	00:50	Shoal Creek - Ice Machine - 002216-Kitchen	1	Wt	Grab	X								BN
9000-144-FD	3/15/2024	00:51	Shoal Creek - Sink Tap - 004865-Gym Restroom	1	Wt	Grab	X								BO

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24
			Vitin BK	Time:	9:20

Remarks:

3 H C 0 0 7 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HC00071	
														Short Hold:	
														Rush:	
														Temp: oC	
9000-145-FD	3/15/2024	00:51	Shoal Creek - Drinking Fountain - 004866-Gym	1	Wt	Grab	X								BP
9000-146-FD	3/15/2024	00:51	Shoal Creek - Drinking Fountain - 004867-Gym	1	Wt	Grab	X								BQ
9000-147-FD	3/15/2024	00:52	Shoal Creek - Sink Tap - 004858-Boys Locker Room-Far Right	1	Wt	Grab	X								BR
9000-148-FD	3/15/2024	00:53	Shoal Creek - Sink Tap - 004859-Boys Locker Room-Right Middle	1	Wt	Grab	X								BS
9000-149-FD	3/15/2024	00:53	Shoal Creek - Sink Tap - 004860-Boys Locker Room-Left Middle	1	Wt	Grab	X								BT
9000-150-FD	3/15/2024	00:53	Shoal Creek - Sink Tap - 004861-Boys Locker Room-Far Left	1	Wt	Grab	X								BU

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	3/15/24	
				Time:	9:20	
	Time:					

3 H C 0 0 7 1

AXIOM Service Professionals

PM: Carolyn Jackson

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HE0036

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: Shoal Creek Elementary School

Project / PO Number: Shoal Creek Elementary School
Received: 05/02/2024
Reported: 05/10/2024

Work Order Special Information

Young, Bradly
Shoal Creek Elementary School

Analytical Testing Parameters

Client Sample ID: 9000-69-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0036-01
Collected By: Young, Bradly
Collection Date: 04/30/2024 23:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0404	RVV

Client Sample ID: 9000-78-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0036-02
Collected By: Young, Bradly
Collection Date: 04/30/2024 23:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0410	RVV

Client Sample ID: 9000-103-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0036-03
Collected By: Young, Bradly
Collection Date: 04/30/2024 23:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0416	RVV

Definitions

RL: Reporting Limit

CERTIFICATE OF ANALYSIS

3HE0036

Report Comments

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
05/10/24 13:20

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	~~Jeff Hurst~~ Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:	Shoal Creek Elementary School	CO. NAME:		CO. NAME:	
ADDRESS:	9000 Northeast Flintlock Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64157	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
9000-69-FD	4/30/2024	23:01	Shoal Creek - Sink Tap - 002514-By 203-Girls-Right Middle	1	Wt	Grab	X								3HE0036-01
9000-78-FD	5/1/2024	23:02	Shoal Creek - Bubbler - 004820-Room 207	1	Wt	Grab	X								02
9000-103-FD	4/30/2024	23:04	Shoal Creek - Bubbler - 004843-Room 305	1	Wt	Grab	X								03


LAB USE ONLY
Wk Order #: 3HE0036
Short Hold:
Rush:
Temp: oC 20.0

3 H E 0 0 3 6
AXIOM Service Professionals
PM: Carolyn Jackson

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	05/02/24
			Crystal Jackson		
	Time:			Time:	12:00

Remarks:

Appendix D
Photo Log

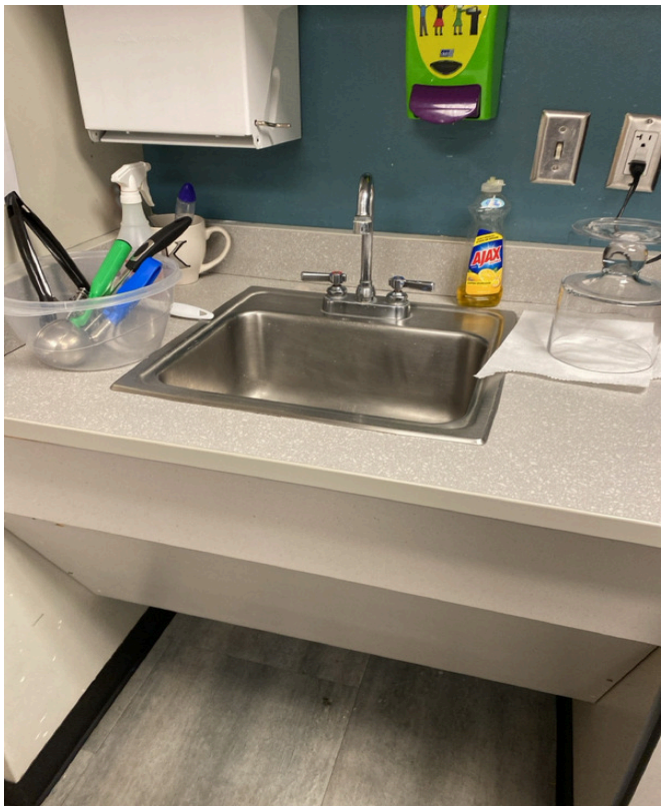

3/15/2024 - 9000-1 - Shoal Creek - 002051-Room 001A



3/15/2024 - 9000-2 - Shoal Creek - 004905-Teacher's Lounge




3/15/2024 - 9000-3 - Shoal Creek - 002052-Room 001A



3/15/2024 - 9000-4 - Shoal Creek - 002053-Room 001A



3/15/2024 - 9000-5 - Shoal Creek - 002504-Nurse's Office-Restroom

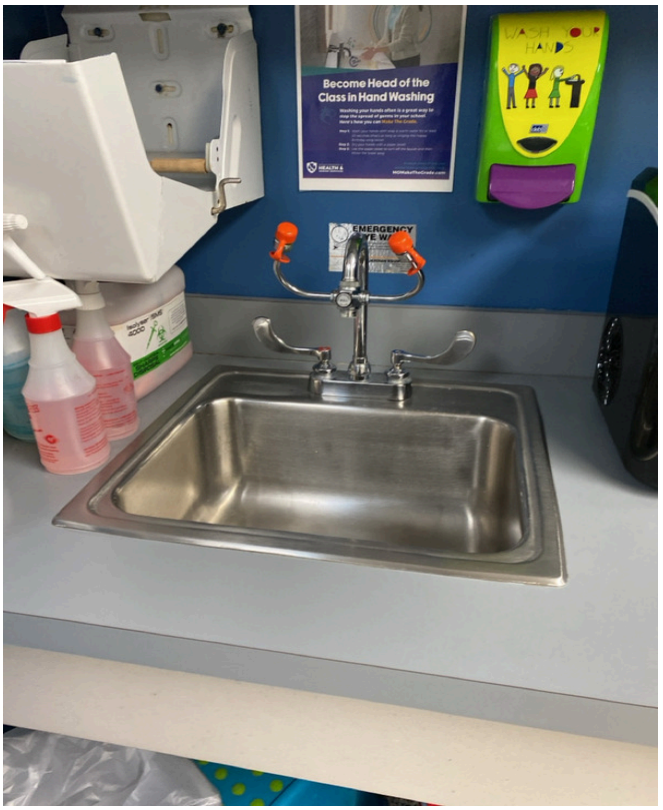

3/15/2024 - 9000-6 - Shoal Creek - 002505-Nurse's Office



3/15/2024 - 9000-7 - Shoal Creek - 002055-Handwashing by 407-Girls



3/15/2024 - 9000-8 - Shoal Creek - 002054-Handwashing by 407-Boys



3/15/2024 - 9000-10 - Shoal Creek - 002056B-By Room 400-Right



3/15/2024 - 9000-11 - Shoal Creek - 002056F-By Room 400



3/15/2024 - 9000-12 - Shoal Creek - 002089-By Room 103



3/15/2024 - 9000-13 - Shoal Creek - 002090-By Room 103




3/15/2024 - 9000-14 - Shoal Creek - 002090-By 103



3/15/2024 - 9000-15 - Shoal Creek - 002091-Staff Restroom by 103



3/15/2024 - 9000-16 - Shoal Creek - 004906-Boys Restrooms by 103-Far Left

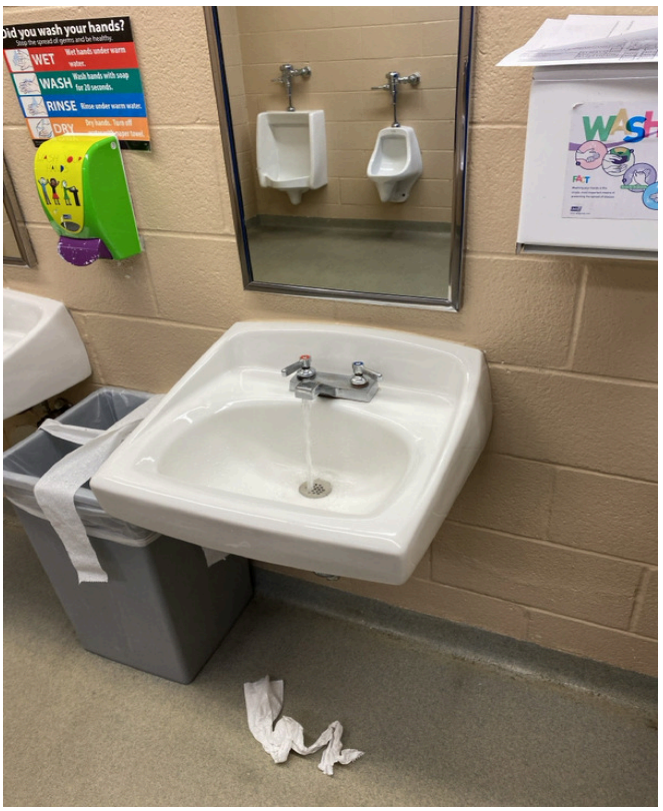

3/15/2024 - 9000-17 - Shoal Creek - 004907-Across from 103-Boys Restroom-Left Middle



3/15/2024 - 9000-18 - Shoal Creek - 004908-Across from 103-Boys Restroom-Right Middle



3/15/2024 - 9000-19 - Shoal Creek - 002201-Across from 103-Boys Restroom-Far Right



3/15/2024 - 9000-20 - Shoal Creek - 002202-By 103-Girls Restroom-Far Left



3/15/2024 - 9000-21 - Shoal Creek - 002203-By 103-Girls Restroom-Left Middle




3/15/2024 - 9000-22 - Shoal Creek - 002204-By 103-Girls Restroom-Middle




3/15/2024 - 9000-23 - Shoal Creek - 002205-By 103-Girls Restroom-Right Middle




3/15/2024 - 9000-24 - Shoal Creek - 002205-By 103-Girls Restroom-Far Right

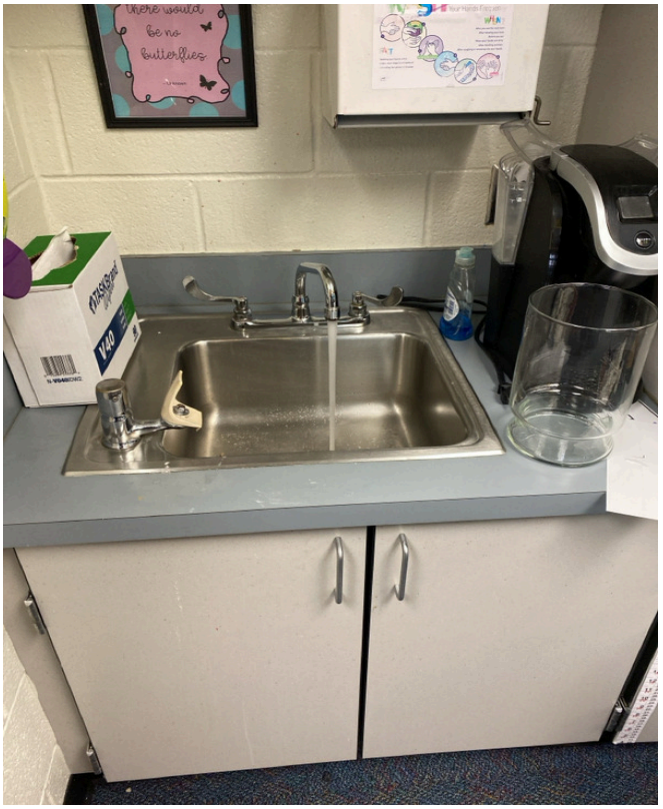


3/15/2024 - 9000-25 - Shoal Creek - 002085-Room 104

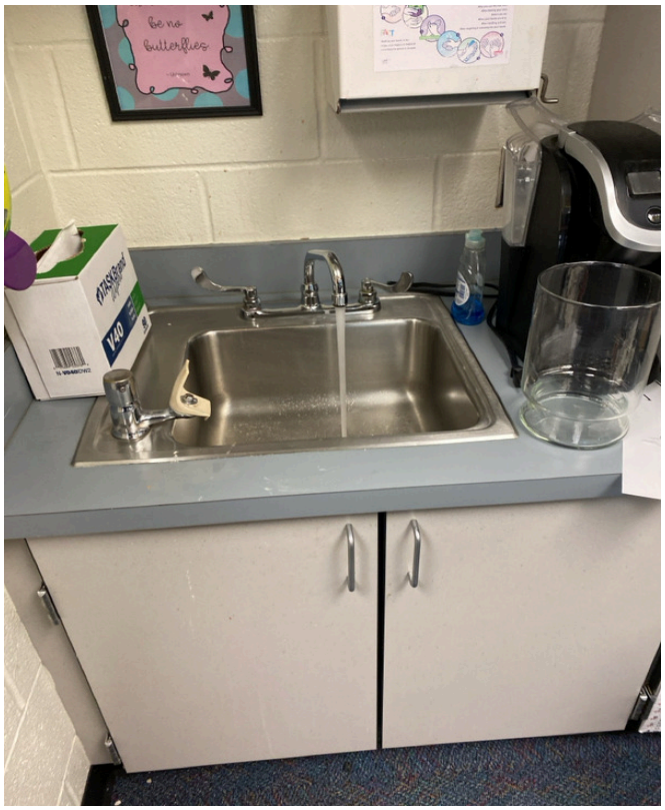

3/15/2024 - 9000-26 - Shoal Creek - 002086-Room 104

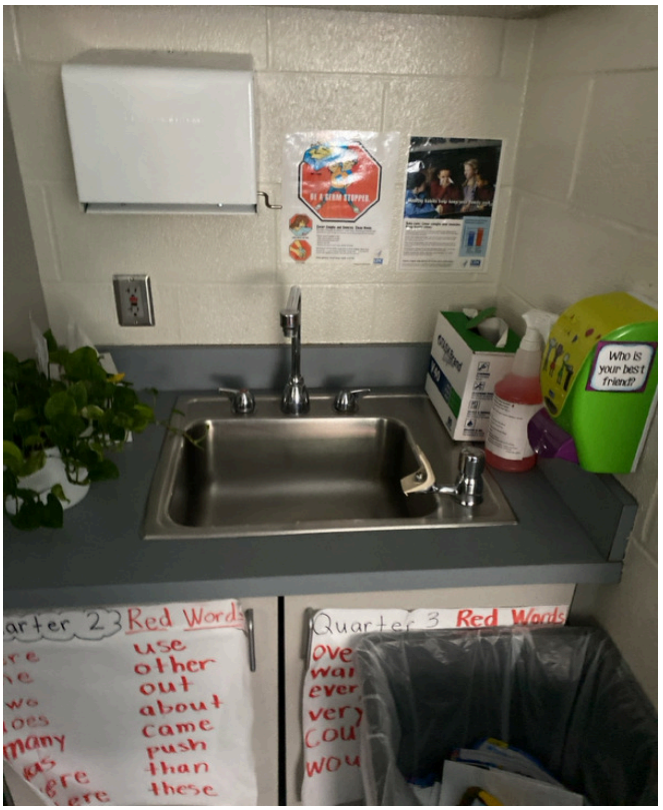

3/15/2024 - 9000-27 - Shoal Creek - 002088-Room 105

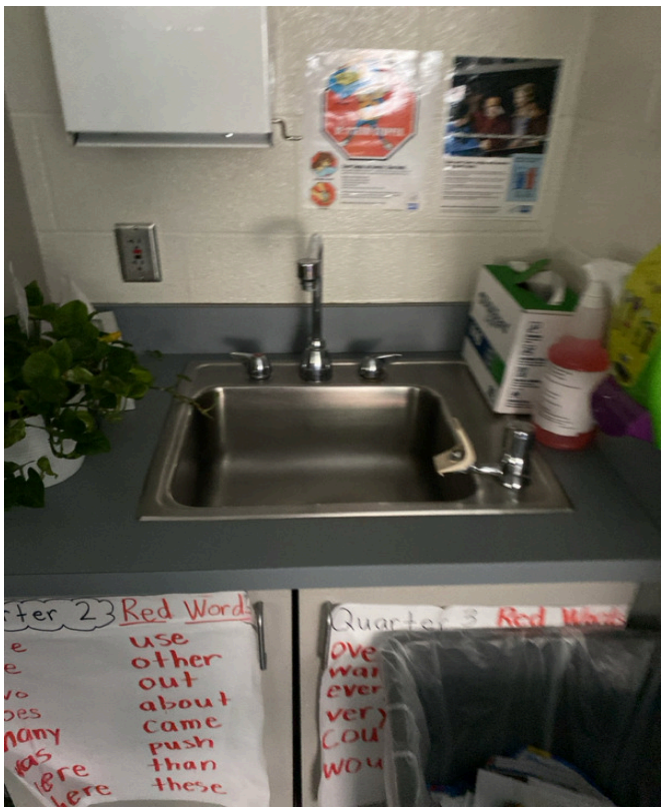


3/15/2024 - 9000-28 - Shoal Creek - 002087-Room 105




3/15/2024 - 9000-29 - Shoal Creek - 002081-Room 106



3/15/2024 - 9000-30 - Shoal Creek - 002082-Room 106

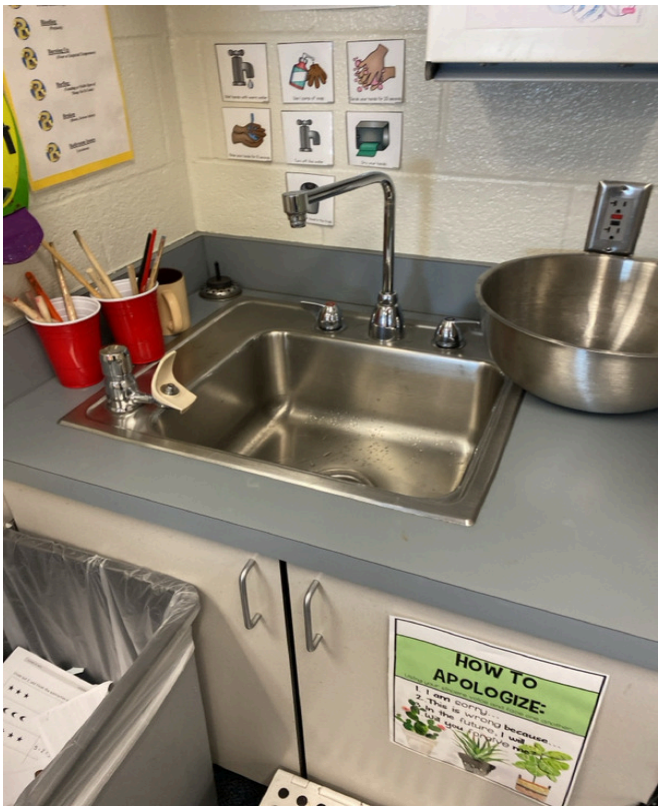

3/15/2024 - 9000-31 - Shoal Creek - 002084-Room 107

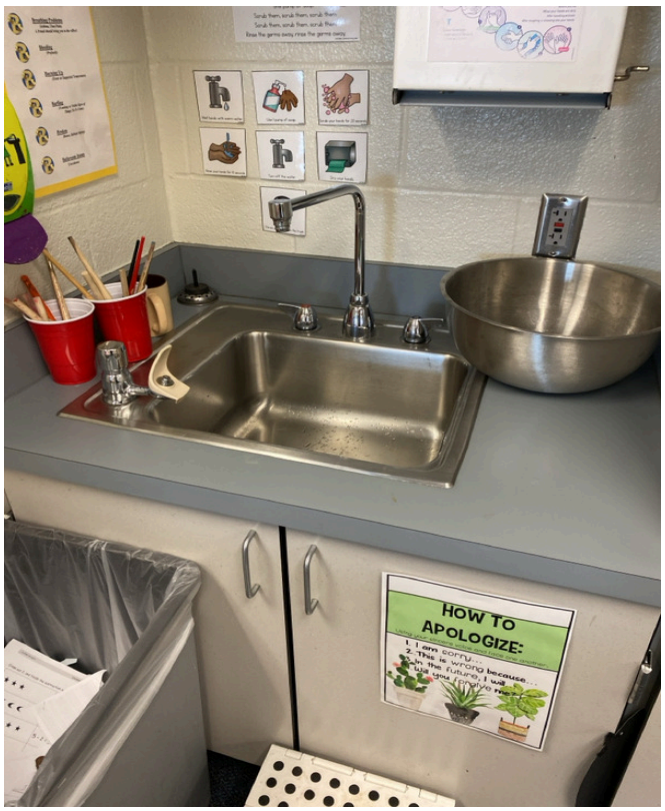


3/15/2024 - 9000-32 - Shoal Creek - 002083-Room 107




3/15/2024 - 9000-33 - Shoal Creek - 002080-Room 108



3/15/2024 - 9000-34 - Shoal Creek - 002079-Room 108

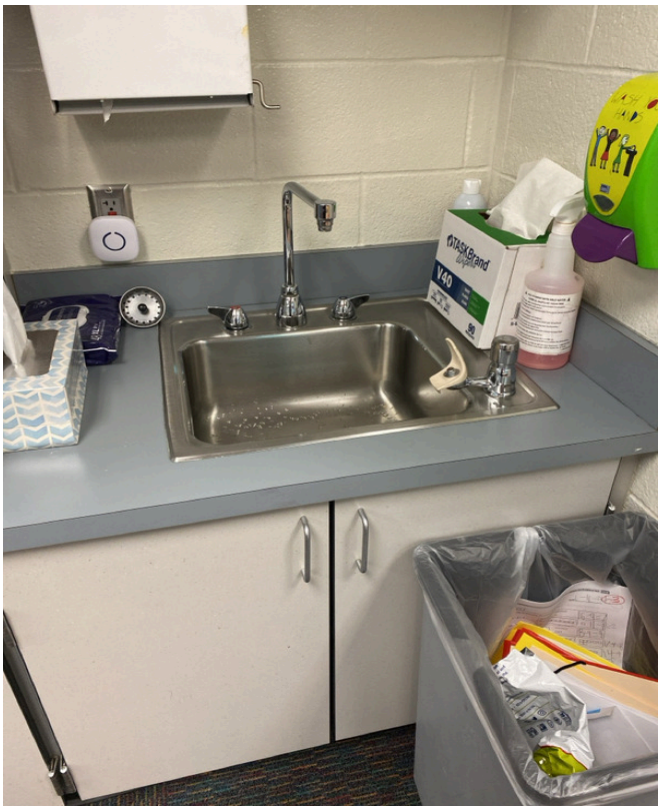

3/15/2024 - 9000-35 - Shoal Creek - 002078-Room 109

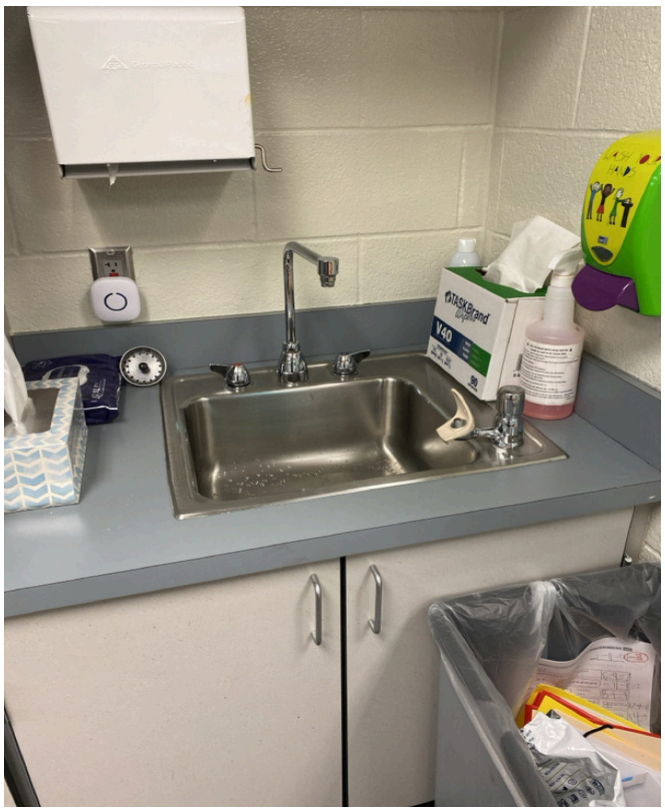


3/15/2024 - 9000-36 - Shoal Creek - 002077-Room 109



3/15/2024 - 9000-37 - Shoal Creek - 002061-Room 110



3/15/2024 - 9000-38 - Shoal Creek - 002062-Room 110

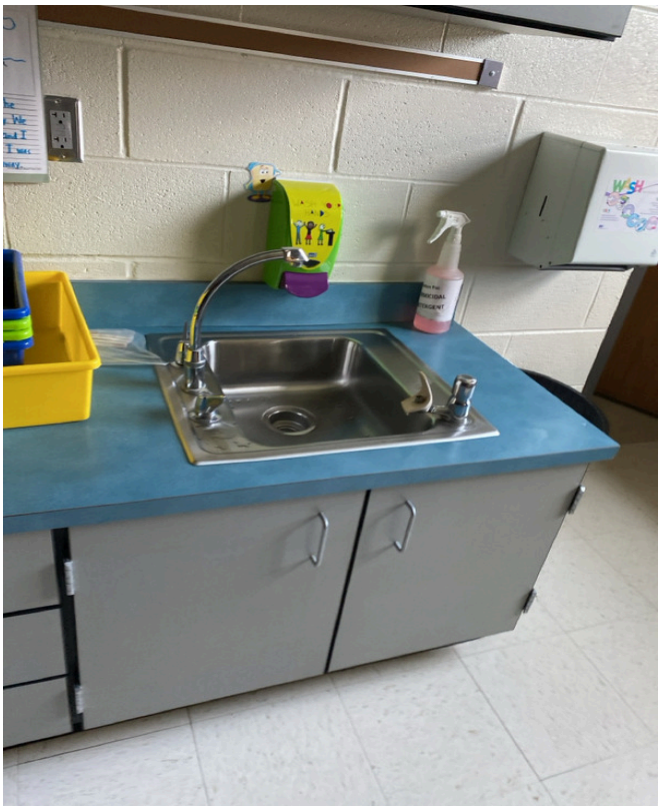

3/15/2024 - 9000-39 - Shoal Creek - 002069-Room 110



3/15/2024 - 9000-40 - Shoal Creek - 002070-Room 110



3/15/2024 - 9000-41 - Shoal Creek - 002071-Room 110-Restroom



3/15/2024 - 9000-42 - Shoal Creek - 002072-Room 111



3/15/2024 - 9000-43 - Shoal Creek - 002073-Room 111




3/15/2024 - 9000-44 - Shoal Creek - 002075-Room 111



3/15/2024 - 9000-45 - Shoal Creek - 002074-Room 111



3/15/2024 - 9000-46 - Shoal Creek - 002076-Room 111-Restroom

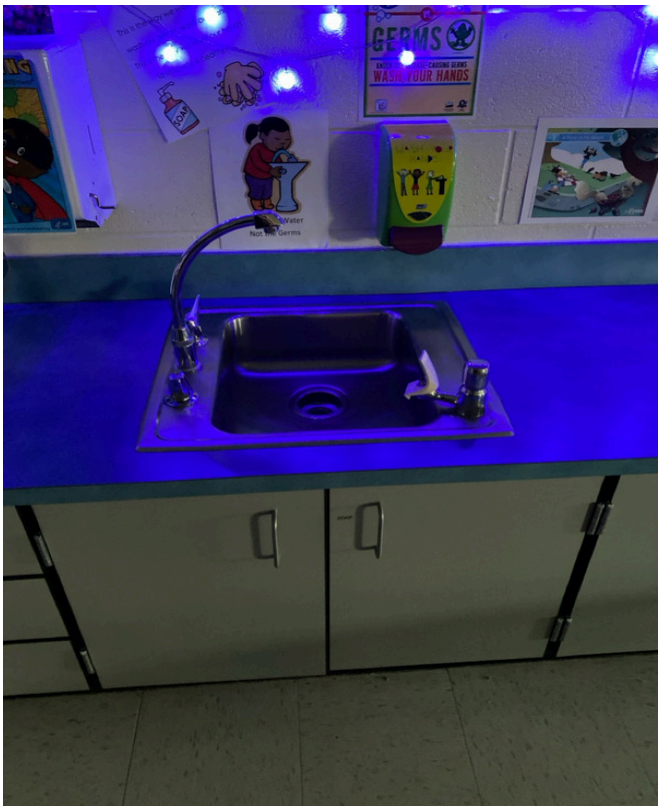

3/15/2024 - 9000-47 - Shoal Creek - 002059-Room 112



3/15/2024 - 9000-48 - Shoal Creek - 002060-Room 112



3/15/2024 - 9000-49 - Shoal Creek - 002067-Room 112



3/15/2024 - 9000-50 - Shoal Creek - 002516-Room 112



3/15/2024 - 9000-51 - Shoal Creek - 002068-Room 112-Restroom



3/15/2024 - 9000-52 - Shoal Creek - 002057-Room 113



3/15/2024 - 9000-53 - Shoal Creek - 002058-Room 113



3/15/2024 - 9000-54 - Shoal Creek - 002064-Room 113



3/15/2024 - 9000-55 - Shoal Creek - 002063-Room 113



3/15/2024 - 9000-56 - Shoal Creek - 002065-Room 113-Restroom



3/15/2024 - 9000-57 - Shoal Creek - 004853-Library Restroom



3/15/2024 - 9000-58 - Shoal Creek - 004826-By Room 203



3/15/2024 - 9000-59 - Shoal Creek - 004826F-By 203



3/15/2024 - 9000-60 - Shoal Creek - 004825-By Room 203



3/15/2024 - 9000-61 - Shoal Creek - 004827-Staff Restroom by 203



3/15/2024 - 9000-62 - Shoal Creek - 002507-Boys Bathroom by 203-Far Left



3/15/2024 - 9000-63 - Shoal Creek - 002508-Boys BathRoom by 203-Left Middle



3/15/2024 - 9000-64 - Shoal Creek - 002509-Boys Restroom by 203-Right Middle



3/15/2024 - 9000-65 - Shoal Creek - 002510-Boys Restroom by 203-Far Right



3/15/2024 - 9000-66 - Shoal Creek - 002511-Girls Restroom by 203-Far Left



3/15/2024 - 9000-67 - Shoal Creek - 002512-Girls Restroom by 203-Left Middle



3/15/2024 - 9000-68 - Shoal Creek - 002513-Girls Restroom by 203-Middle



3/15/2024 - 9000-70 - Shoal Creek - 002515-Girls Restroom by 203-Far Right




3/15/2024 - 9000-71 - Shoal Creek - 004823-Room 204




3/15/2024 - 9000-72 - Shoal Creek - 004824-Room 204




3/15/2024 - 9000-73 - Shoal Creek - 004821-Room 205

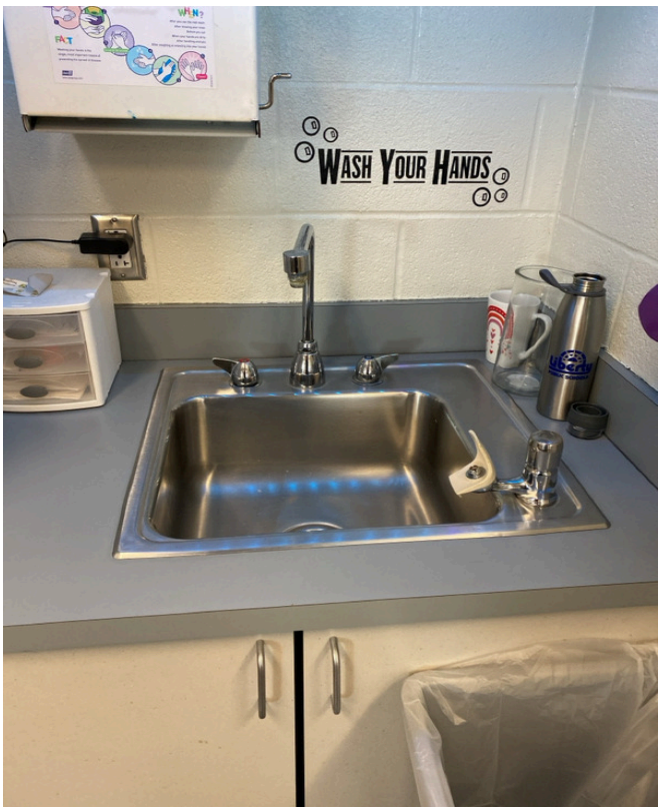

3/15/2024 - 9000-74 - Shoal Creek - 004822-Room 205

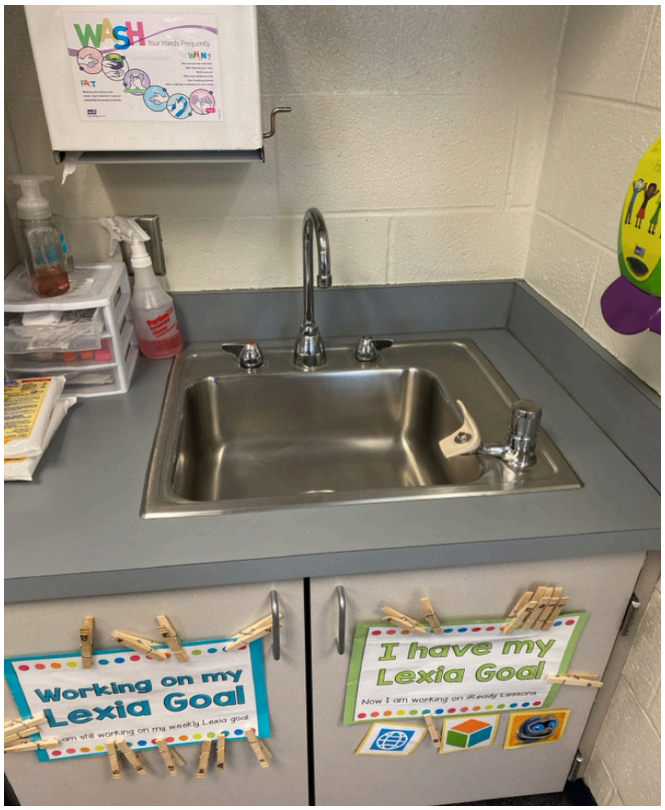

3/15/2024 - 9000-75 - Shoal Creek - 004817-Room 206

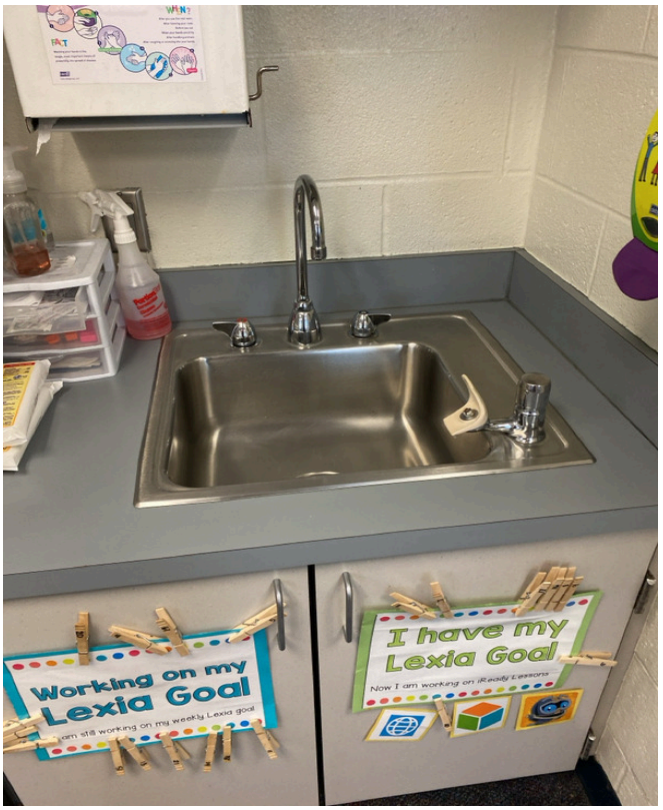

3/15/2024 - 9000-76 - Shoal Creek - 004818-Room 206




3/15/2024 - 9000-77 - Shoal Creek - 004819-Room 207




3/15/2024 - 9000-79 - Shoal Creek - 004815-Room 208




3/15/2024 - 9000-80 - Shoal Creek - 004816-Room 208

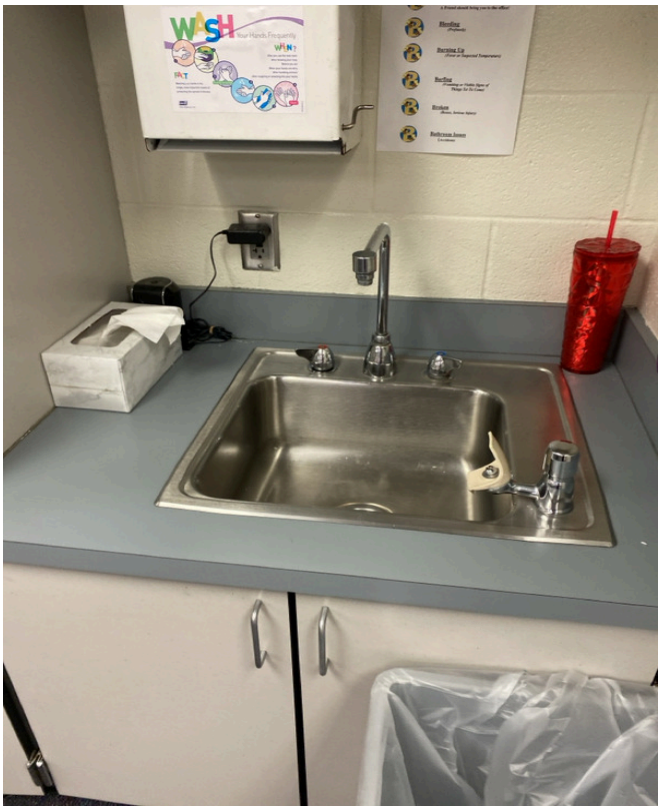


3/15/2024 - 9000-81 - Shoal Creek - 004814-Room 209

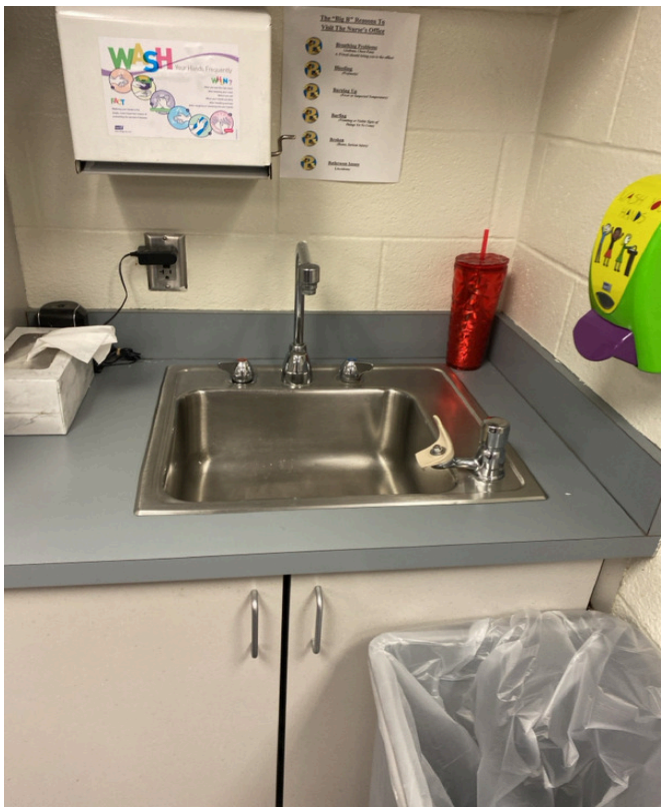


3/15/2024 - 9000-82 - Shoal Creek - 004813-Room 209

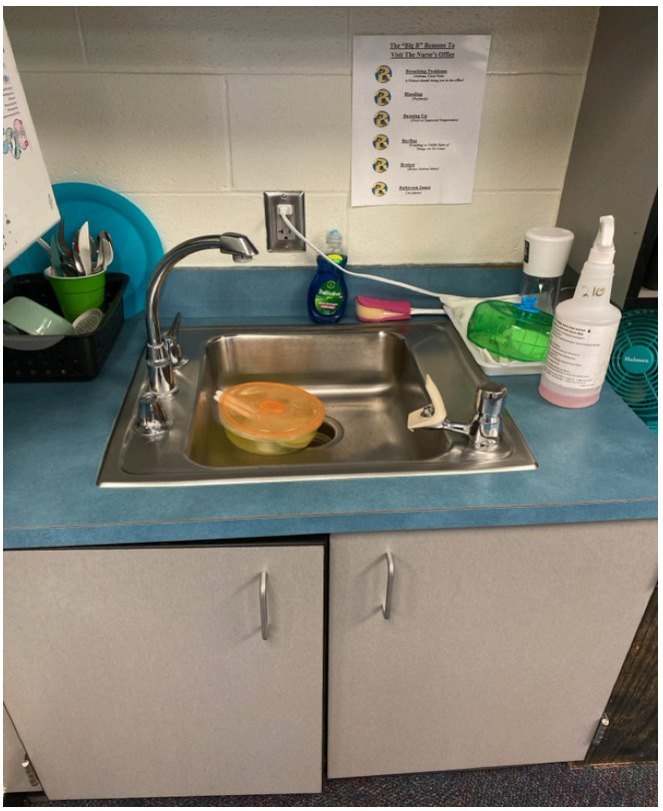

3/15/2024 - 9000-83 - Shoal Creek - 004811-Room 210

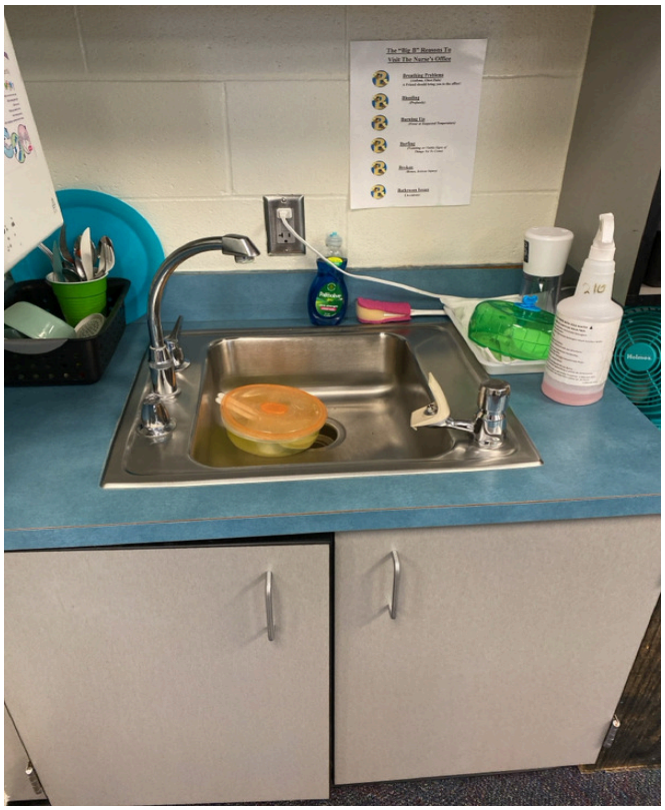

3/15/2024 - 9000-84 - Shoal Creek - 004812-Room 210

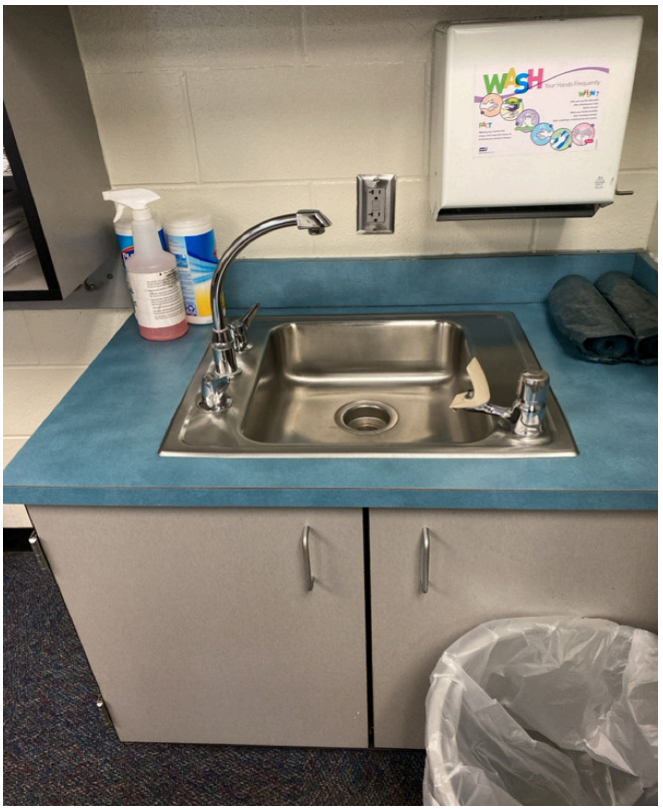

3/15/2024 - 9000-85 - Shoal Creek - 004809-Room 211



3/15/2024 - 9000-86 - Shoal Creek - 004810-Room 211



3/15/2024 - 9000-87 - Shoal Creek - 002506-Room 16



3/15/2024 - 9000-88 - Shoal Creek - 004829-By 302



3/15/2024 - 9000-89 - Shoal Creek - 004830-By 302



3/15/2024 - 9000-90 - Shoal Creek - 004828-By 302-Staff Restroom



3/15/2024 - 9000-91 - Shoal Creek - 002207-Girls Restroom by 302-Far Left



3/15/2024 - 9000-92 - Shoal Creek - 002208-Girls Restroom by 302-Left Middle



3/15/2024 - 9000-93 - Shoal Creek - 002209-Girls Restroom by 302-Middle



3/15/2024 - 9000-94 - Shoal Creek - 002210-Girls Restroom by 302-Right Middle



3/15/2024 - 9000-95 - Shoal Creek - 002211-Girls Restroom by 302-Far Right



3/15/2024 - 9000-96 - Shoal Creek - 002212-By 302-Boys Restroom-Far Left



3/15/2024 - 9000-97 - Shoal Creek - 002213-By 302-Boys Restroom-Left Middle




3/15/2024 - 9000-98 - Shoal Creek - 002214-By 302-Boys Restroom-Right Middle



3/15/2024 - 9000-99 - Shoal Creek - 002215-By 302-Boys Restroom-Far Right



3/15/2024 - 9000-100 - Shoal Creek - 004845-Room 304

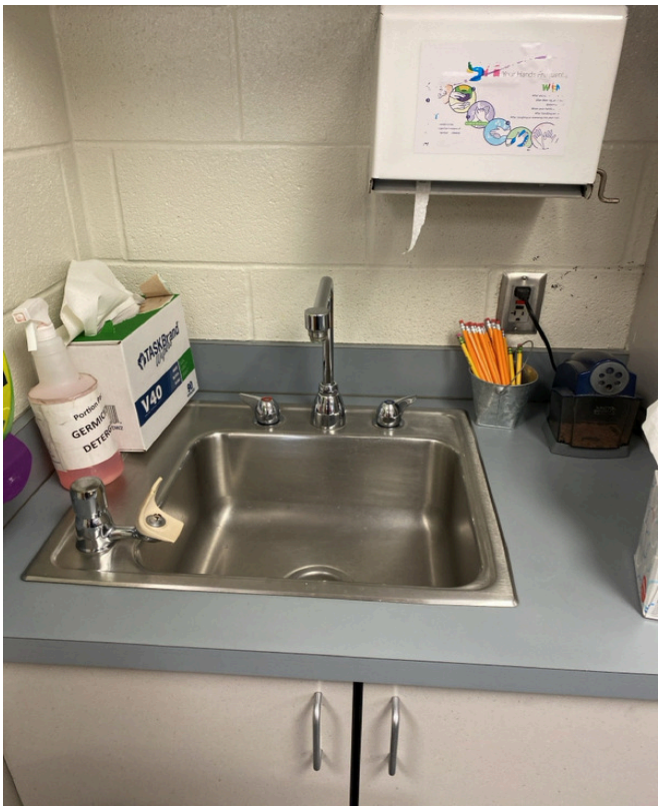


3/15/2024 - 9000-101 - Shoal Creek - 004846-Room 304



3/15/2024 - 9000-102 - Shoal Creek - 004844-Room 305



3/15/2024 - 9000-104 - Shoal Creek - 004840-Room 306

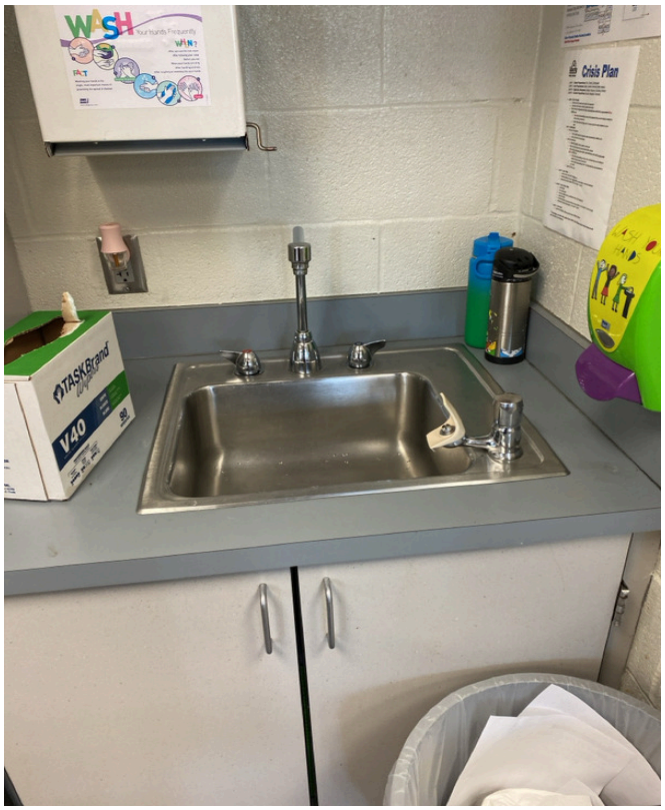


3/15/2024 - 9000-105 - Shoal Creek - 004839-Room 306



3/15/2024 - 9000-106 - Shoal Creek - 004842-Room 307



3/15/2024 - 9000-107 - Shoal Creek - 004841-Room 307

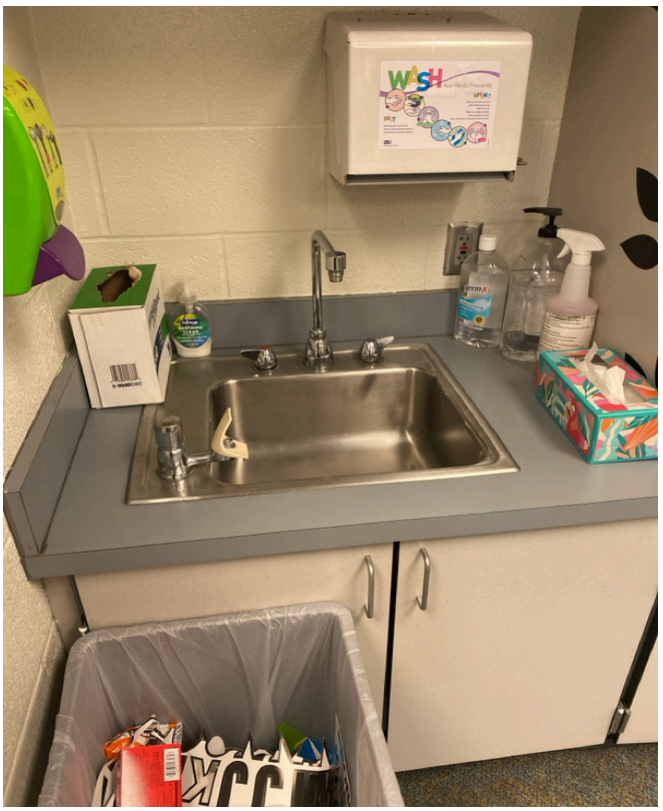

3/15/2024 - 9000-108 - Shoal Creek - 004837-Room 308



3/15/2024 - 9000-109 - Shoal Creek - 004838-Room 308



3/15/2024 - 9000-110 - Shoal Creek - 004836-Room 309



3/15/2024 - 9000-111 - Shoal Creek - 004835-Room 309



3/15/2024 - 9000-112 - Shoal Creek - 004833-Room 310



3/15/2024 - 9000-113 - Shoal Creek - 004834-Room 310




3/15/2024 - 9000-114 - Shoal Creek - 004831-Room 311



3/15/2024 - 9000-115 - Shoal Creek - 004832-Room 311



3/15/2024 - 9000-116 - Shoal Creek - 004847-Room 20-Far Right

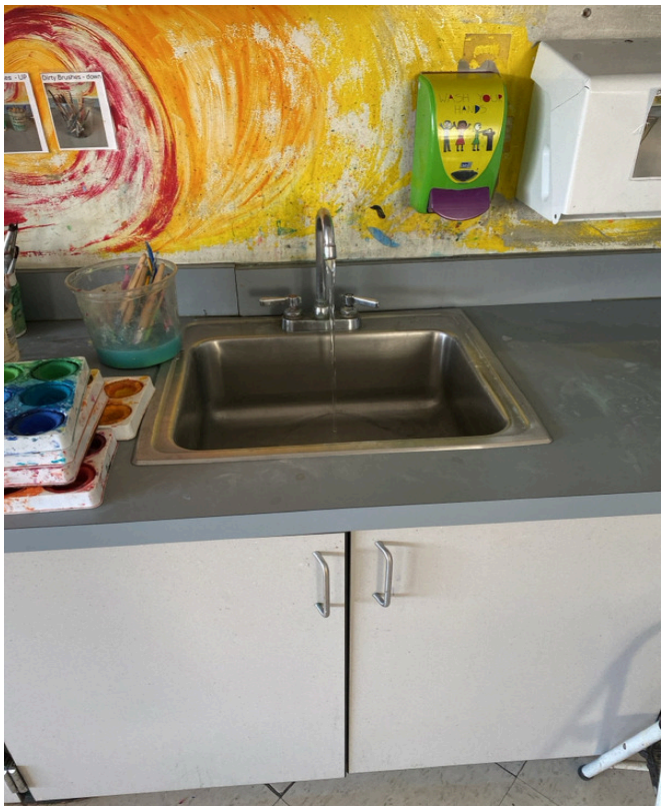


3/15/2024 - 9000-117 - Shoal Creek - 004848-Room 20-Right Middle




3/15/2024 - 9000-118 - Shoal Creek - 004849-Room 20-Left Middle



3/15/2024 - 9000-119 - Shoal Creek - 004850-Room 20-Far Left

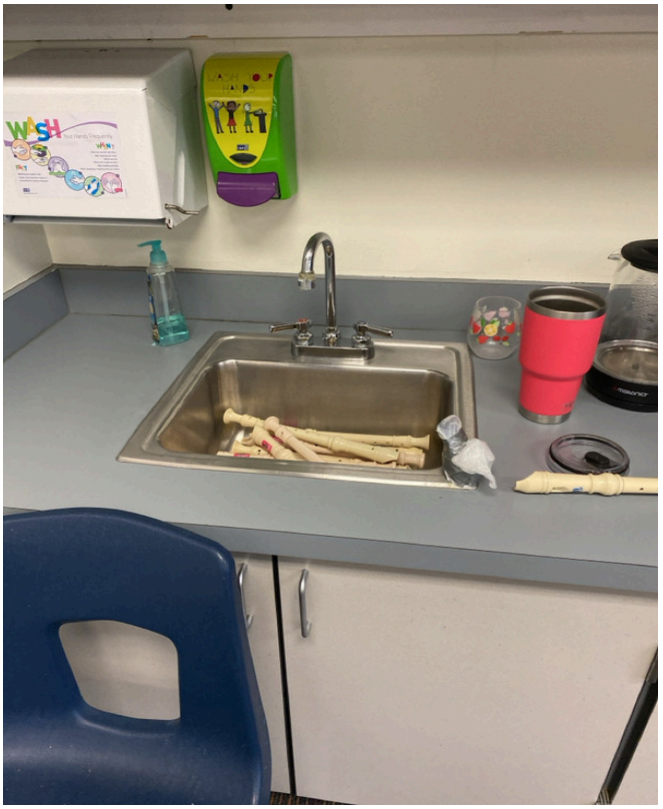

3/15/2024 - 9000-120 - Shoal Creek - 004851-Room 21

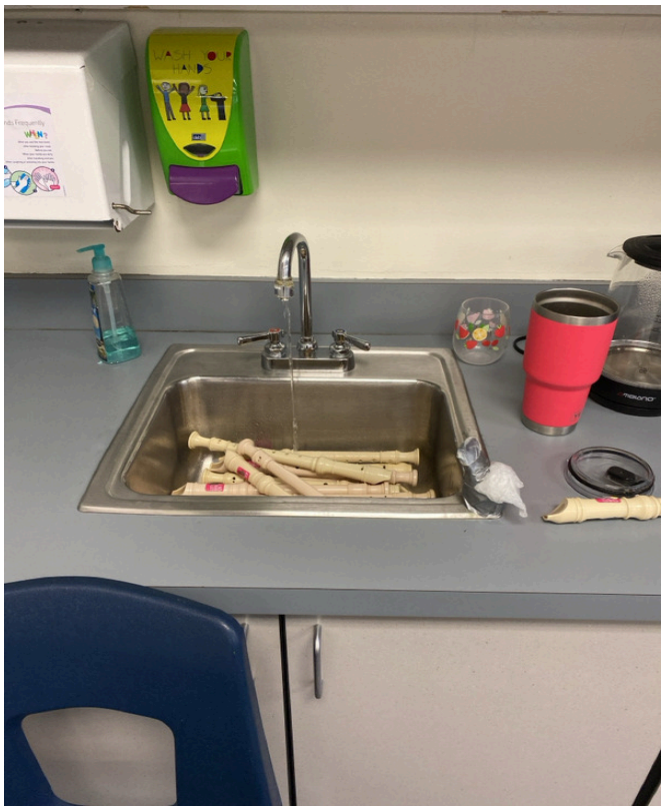

3/15/2024 - 9000-121 - Shoal Creek - 004852-Room 21




3/15/2024 - 9000-122 - Shoal Creek - 004854-Girls Restroom by Cafe-Far Right




3/15/2024 - 9000-123 - Shoal Creek - 004855-Girls Restroom by Cafe-Right Middle




3/15/2024 - 9000-124 - Shoal Creek - 004856-Girls Restroom by Cafe-Left Middle

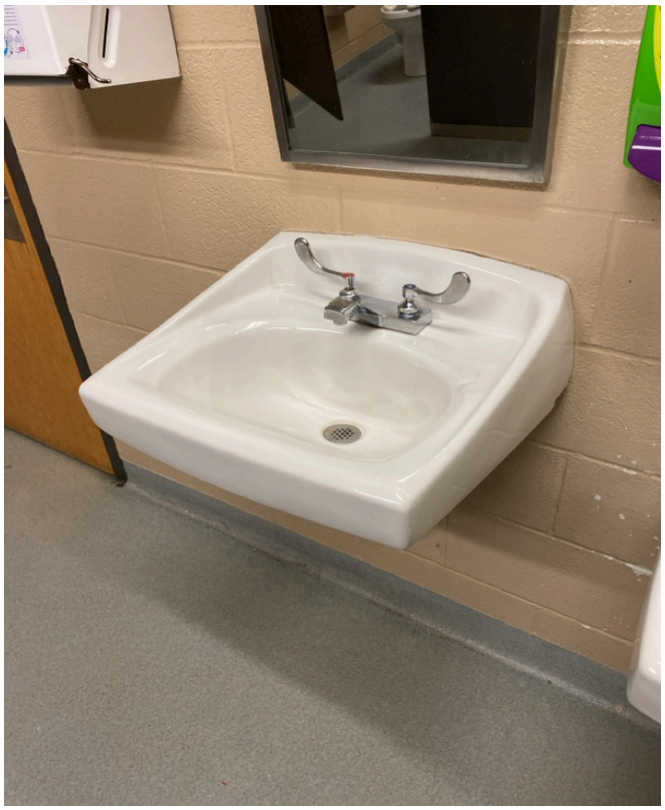

3/15/2024 - 9000-125 - Shoal Creek - 004857-Girls Restroom by Cafe-Far Left

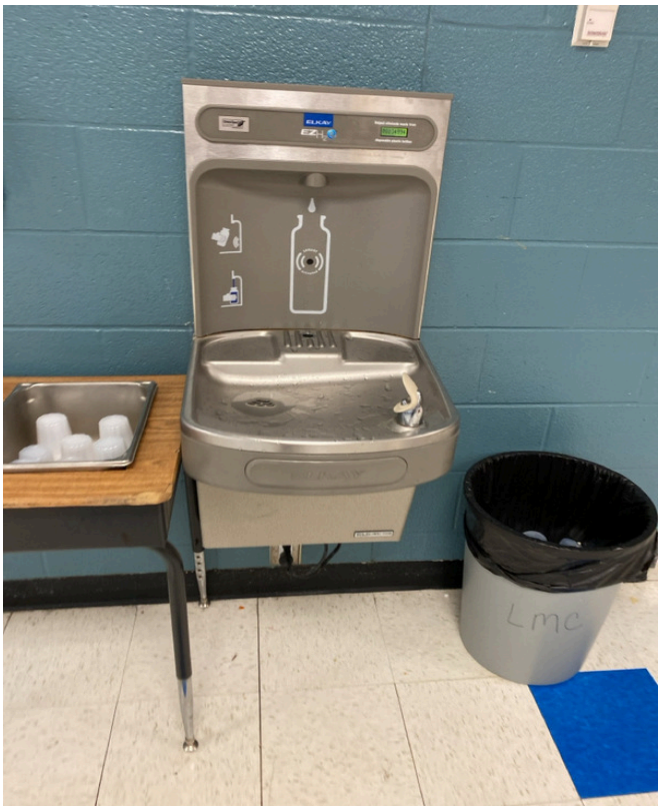

3/15/2024 - 9000-126 - Shoal Creek - 004862B-Cafe

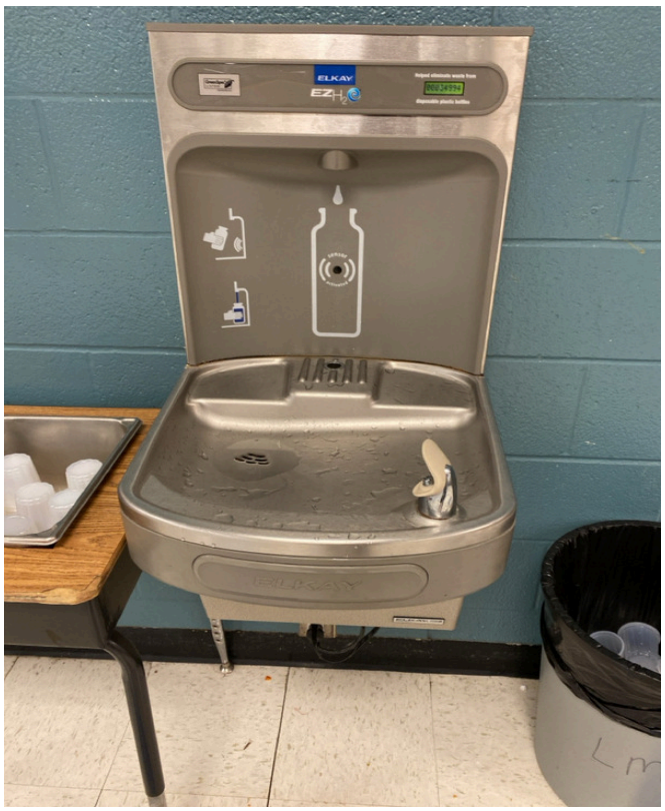

3/15/2024 - 9000-127 - Shoal Creek - 004862F-Cafe



3/15/2024 - 9000-128 - Shoal Creek - 002093-Kitchen-Outside Office



3/15/2024 - 9000-129 - Shoal Creek - 002094-Kitchen-Outside Office



3/15/2024 - 9000-130 - Shoal Creek - 002095-Kitchen-Next to Rational Oven



3/15/2024 - 9000-131 - Shoal Creek - 002096-Kitchen-Next to Rational Oven



3/15/2024 - 9000-132 - Shoal Creek - 002097-Kitchen-Outside Dishwashing Room



3/15/2024 - 9000-133 - Shoal Creek - 002098-Outside Dishwasher Room



3/15/2024 - 9000-134 - Shoal Creek - 004804-Kitchen-In Dishwasher Room



3/15/2024 - 9000-135 - Shoal Creek - 004805-Kitchen-In Dishwasher Room



3/15/2024 - 9000-136 - Shoal Creek - 004806-Kitchen-Dishwasher Room



3/15/2024 - 9000-137 - Shoal Creek - 004807-Kitchen-Dishwasher Room



3/15/2024 - 9000-138 - Shoal Creek - 004808-Kitchen-Dishwasher Room



3/15/2024 - 9000-139 - Shoal Creek - 002100-Kitchen-Handwashing in Dish Room



3/15/2024 - 9000-140 - Shoal Creek - 004803-Kitchen-Handwashing by Prep Area Doorway



3/15/2024 - 9000-141 - Shoal Creek - 002099-Kitchen-Prep Area Handwashing



3/15/2024 - 9000-142 - Shoal Creek - 004864-Kitchen-Staff Restroom



3/15/2024 - 9000-143 - Shoal Creek - 002216-Kitchen



3/15/2024 - 9000-144 - Shoal Creek - 004865-Gym Restroom



3/15/2024 - 9000-145 - Shoal Creek - 004866-Gym



3/15/2024 - 9000-146 - Shoal Creek - 004867-Gym




3/15/2024 - 9000-147 - Shoal Creek - 004858-Boys Locker Room-Far Right



3/15/2024 - 9000-148 - Shoal Creek - 004859-Boys Locker Room-Right Middle



3/15/2024 - 9000-149 - Shoal Creek - 004860-Boys Locker Room-Left Middle

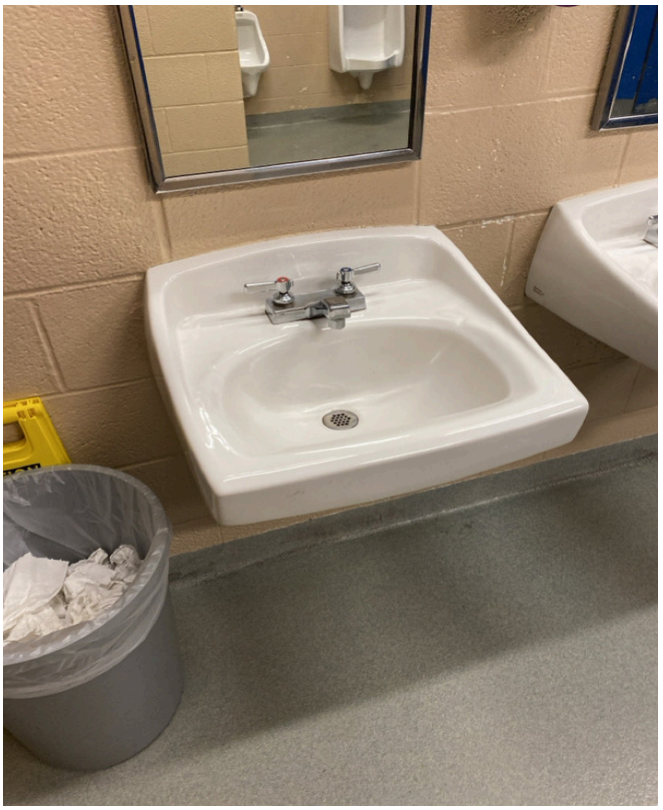

3/15/2024 - 9000-150 - Shoal Creek - 004861-Boys Locker Room-Far Left



4/30/2024 - 9000-69 - Shoal Creek - 002514-By 203-Girls-Right Middle




4/30/2024 - 9000-78 - Shoal Creek - 004820-Room 207



4/30/2024 - 9000-103 - Shoal Creek - 004843-Room 305

Appendix E
Source Identification Diagram

ASP was provided sample locations by
Liberty School District

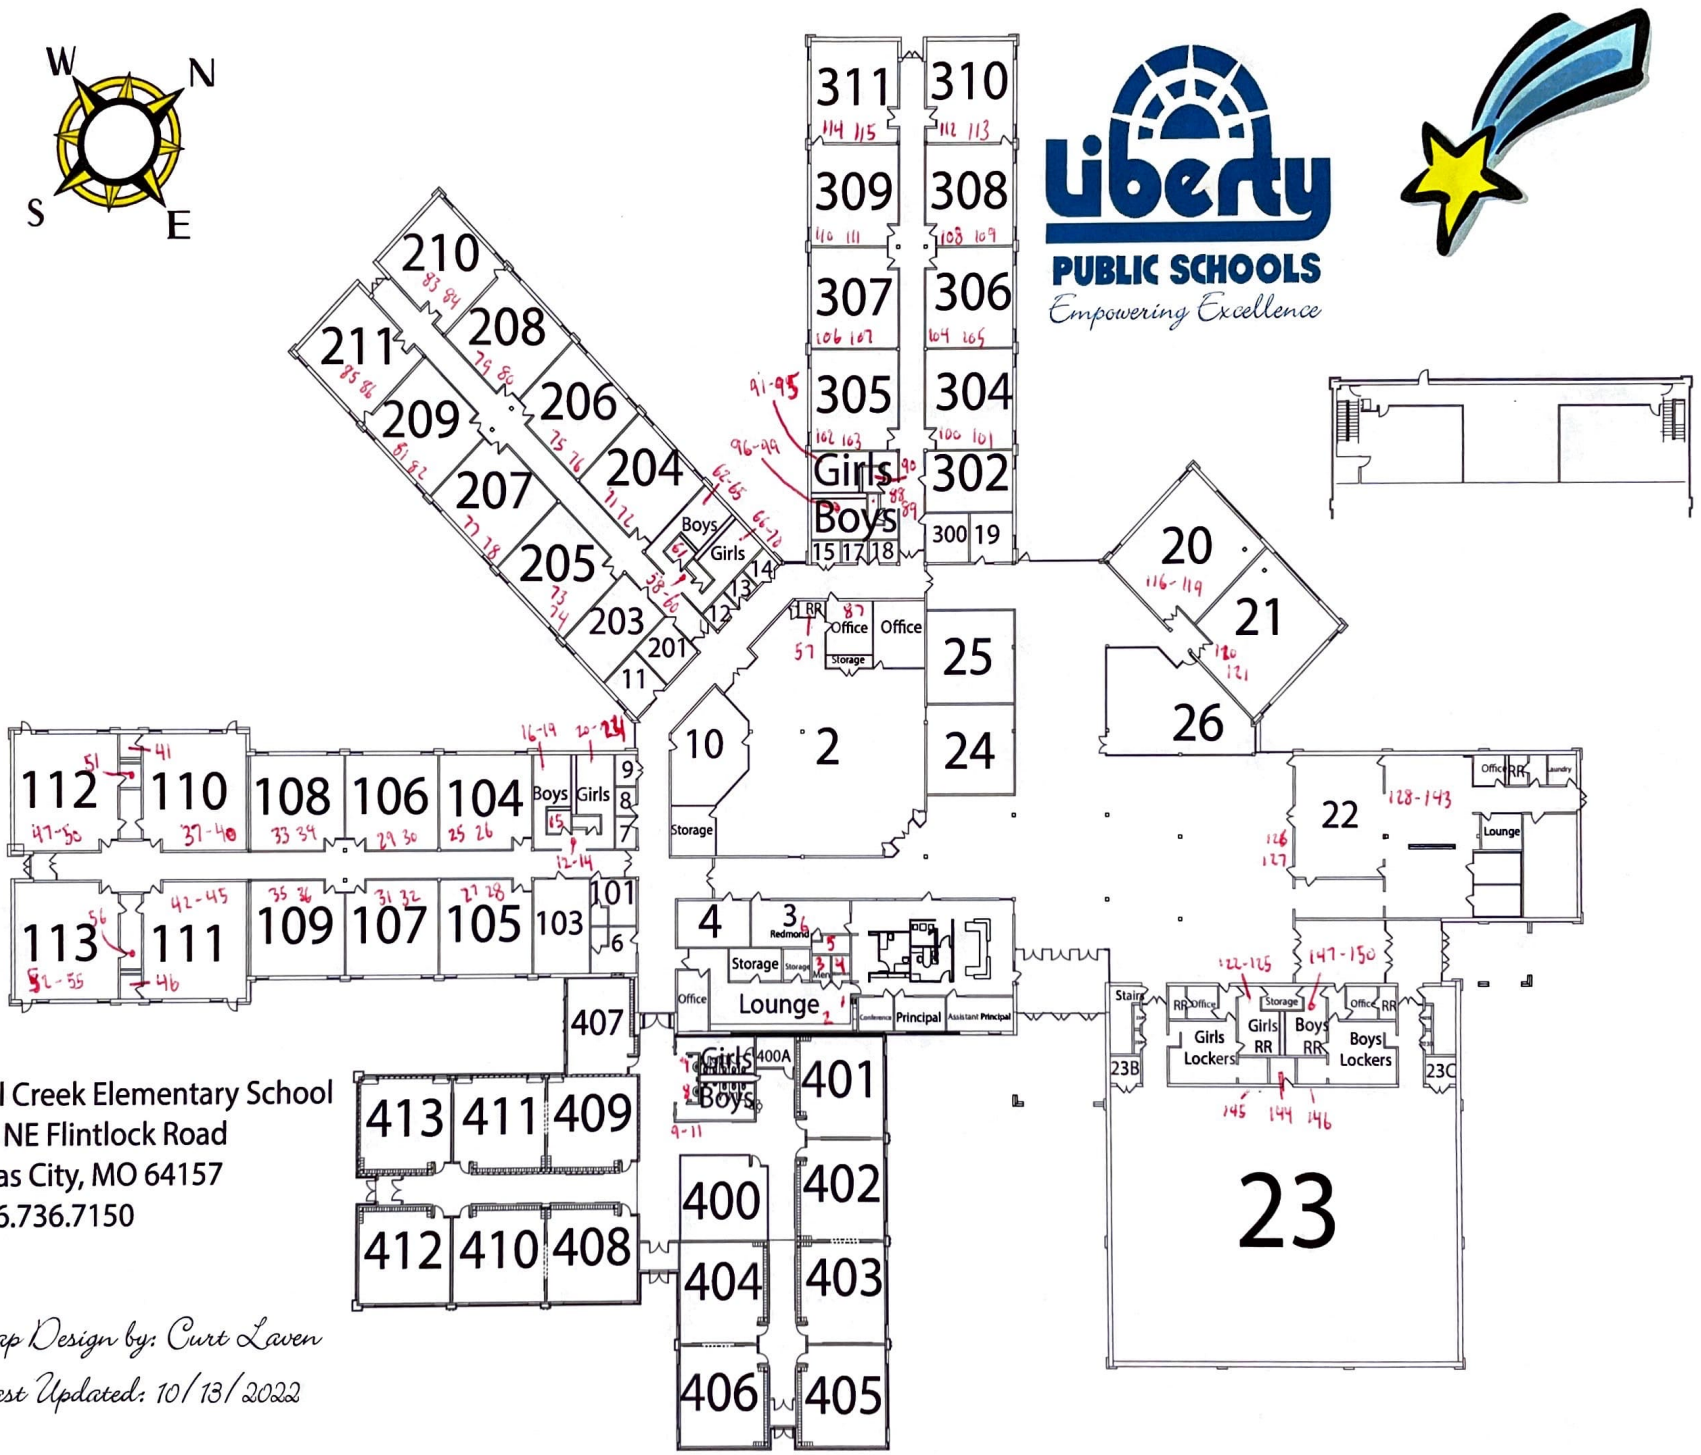
W
N
S
E
Liberty
PUBLIC SCHOOLS
Empowering Excellence
311
310
309
308
307
306
305
304
302
Girls
Boys
300
19
15
17
18
210
208
211
209
206
207
204
205
203
201
11
Boys
Girls
14
13
12
10
2
Storage
Office
Office
Storage
25
24
20
21
26
112
110
108
106
104
113
111
109
107
105
103
101
6
Boys
Girls
9
8
7
4
3
Redmond
Storage
Lounge
Office
Conference
Principal
Assistant Principal
407
413
411
409
412
410
408
Girls
Boys
400A
401
400
402
404
403
406
405
22
Lounge
Stair
Girls Lockers
Girls RR
Boys RR
Boys Lockers
23B
23C
23
Shoal Creek Elementary School
9000 NE Flintlock Road
Kansas City, MO 64157
P: 816.736.7150
Map Design by: Curt Laven
Last Updated: 10/13/2022