May 24, 2024

Xavier Hernandez
Director School Facilities & Operations
White Plains Public Schools
580 North Street
White Plains, NY 10605

Subject: Lead Testing of School Drinking Water
White Plains High School
550 North Street
White Plains, NY 10605
Langan Project No.: 101061142

Dear Mr. Hernandez:

Langan Engineering, Environmental, Surveying, Landscape Architecture and Geology, D.P.C. (Langan) completed the testing program for lead in water at the White Plains High School building located at 550 North Street in White Plains, New York. Langan's team of industrial hygienists completed a visual assessment of the building to determine applicable vs non-applicable outlets prior to sampling.

Langan is providing the following New York State Department of Health (NYS DOH) required documentation: Laboratory Results, Exceedance Table, a draft Parents Notification Letter and notification to the local department of health of exceedances, when applicable. If requested by the district, Langan will complete the required reporting into the NYS Health Electronic Response Data System (HERDS). The district will need to provide access to the system in order for Langan to complete the required reporting.

Project Background

On September 6, 2016, the Governor signed legislation requiring all school districts in NYS to test potable water systems for lead contamination and to take responsive actions. To implement this new law, the DOH issued emergency regulations, titled Lead Testing in School Drinking Water. On May 9, 2018, the Lead Testing in School Drinking Water final regulation was published in the State Register, replacing the emergency regulation:

- By September 30, 2016, all school buildings serving children in pre-K through grade 5 were required to collect a sample from each outlet for testing.
- By October 31, 2016, all school buildings serving children in grades 6 through 12 must collect a sample from each outlet for testing.
- Schools must complete initial first-draw sampling for Compliance Year 2020 between January 1, 2020 – December 31, 2020, and every 5 years thereafter or at an earlier time as determined by the Commissioner of Health. On October 13, 2020, NYS DOH provided an Extension of School Lead Testing Requirements to June 30, 2021.

On December 22, 2022, revisions to the Public Health Law (PHL) which governs potable water testing and standards in schools went into effect. The key revisions to the law requiring changes included:

- Revised action level of lead in drinking water to 5 parts per billion (ppb), reduced from 15 ppb.
- School buildings deemed "lead free" are no longer exempt from testing requirements:
- Should it be necessary to provide water to school occupants following an outlet being taken out of service due to an action level exceedance, it will be provided free of charge.
- Copies of the lead sampling results, including lab results and any lead remediation plans, must be made available to the public and posted on the school's website.
- Compliance testing will occur on a triennial (every 3 years) schedule.

KEY DEFINITIONS IN THE LAW/REGULATIONS

1. Outlet means a potable water fixture currently or potentially used for drinking or cooking purposes, including but not limited to a bubbler, drinking fountain, hose bib, sinks or faucets.

2. "Applicable" outlets: Outlets that should be sampled may be located anywhere on school property including external outlets (hose bibs) if the outlet may be used for drinking or cooking (including food preparation). Superintendents or their designees have the responsibility to identify which outlets on a school property meet the regulation requirements for sampling ("applicable outlets"). If a Superintendent or their designee determines that they have outlets that fall outside of the scope of the regulation (outlets not used or potentially used for drinking or cooking), the school must remediate or/and have a remedial action plan that includes details on how those outlets will not be accessed and/or utilized for drinking or cooking purposes ("non-applicable outlets").

3. "Non-applicable" outlets: The Rule of Thumb is that generally, any outlet in a room or office within a school that is not used by students (pre-kindergarten through grade 12) and does not provide water for drinking or cooking does not require sampling.

4. Action level means 5 parts per billion (ppb). Lead test results greater than 5 ppb exceeds the lead action level and requires the outlet to be taken out of service and a remediation action plan be implemented.

5. For additional guidance regarding applicable vs. non-applicable outlets, and other requirements please see the Appendices for NYS DOH Lead Testing in School Drinking Water 2022 Compliance Requirements, and NYS DOH Frequently Asked Questions (FAQs).

Sampling Methodology

1. The NYS DOH Emergency Regulation, Section 67-4.3 – Monitoring states:

    - First-draw samples shall be collected from all "applicable" outlets. A first-draw sample volume shall be 250 milliliters (mL), collected from a cold-water outlet before any water is used. The water shall be motionless in the pipes for a minimum of 8 hours, but no more

than 18 hours, before sample collection. Note: The NYS DOH requires that for outlets which do not have regular use and water remains motionless in the pipes for greater than 18 hours, the outlets were to be sampled as well (to represent "normal use patterns").
- All first-draw samples shall be analyzed by a laboratory approved to perform such analyses by the Department's Environmental Laboratory Approval Program (ELAP).
- Although not required by the NYS DOH Emergency Regulation, Langan also followed additional methodologies included in Environmental Protection Agency (EPA) document entitled "3Ts for Reducing Lead in Drinking Water in Schools".

2. Sampling Plan:

    - In developing a sampling plan before sample collection took place at the School, Langan determined the location of the water service line. Sampling at the School started from a location closest to the service line entrance and proceeded outwards from that point.
    - A map, depicting the location of the service line entrance, and arrows indicating the direction of sampling was provided to and used by the sampling team. The sampling team verified the location of the service line entrance prior to sampling.

3. Laboratory Analysis: Samples were submitted to York Analytical (Stratford, CT) for analysis under chain-of-custody. The laboratory is certified through the NYS DOH Environmental Laboratory Approval Program (ELAP) and are approved for analysis of lead in potable water.

4. Re-sampling can be performed provided corrective action or remediation options, as reviewed in the Recommendation section, are complete. Proper flushing of new equipment (e.g. pipes, faucets etc.) is recommended.

5. Flushing Program and Resampling: when routine flushing programs are implemented, the school plumbing system should be flushed according to an establish protocol. After flushing and before sampling or resampling, a period of 3-4 days of normal use is recommended. First-draw lead water sampling can be performed after the required hold time of 8-18 hours is completed.

6. In accordance with the NYS DOH, the following post-remediation testing requirements apply:

    - Follow-up samples collected after an outlet has been remediated must also be "first-draw" samples. Schools may choose to perform additional sampling (i.e., 30-second flush, etc.) to determine the contribution of lead from plumbing to guide remediation decisions.
    - Only those outlets that exceed the action level need to be resampled (following remediation).
    - All remediated outlets will likely require flushing before being placed back into service.
    - Post-remediation tests results need to be reported in the Department's HERDS application on HCS, and on the school website within the same reporting timeframes/requirements as specified for the initial sampling.

RESULTS DISCUSSION

The following Assessment Results Exceedance Table provides details on the date of sampling, sample identification, location and laboratory results that exceeded 5 ppb, if applicable. A copy of the full laboratory results and the chain of custody are presented at the end of this report in Appendix A. Laboratory certifications can be found in Appendix B. An Applicable vs Non-Applicable Outlet Inventory & Water Source Location Drawings are located in Appendix C.

Of the **64** samples collected at White Plains High School, **two (3%)** had lead concentrations that exceeded 5 ppb. The table below details the sample locations and the laboratory results.

White Plains High School				
Sample Date	**Sample ID**	**Floor**	**Location**	**Lead Level (ppb)**
4/26/2024	31	P	Pool Level – E1024C – Auxiliary Locker Room Hallway - WF	30.6
4/26/2024	66	FH	Field House – S. Locker Room – WF	5.24

Upon receipt of the results, Langan is making the following recommendations to the district as required by Subpart 67-4 of Title 10 (Health) of the Official Compilation of Codes, Rules and Regulations of the State of New York:

- Review the Exceedance Table, Laboratory Results and Notification Letter, indicating lead water sample results exceeding the NYSDOH Action Level of 5 ppb, and require these outlets to be taken out of service and a remediation action plan be implemented.
- Please see Lead Testing in School Drinking Water, 10 NYCRR Subpart 67-4, adopted May 9, 2018 for applicable requirements
- (https://www.health.ny.gov/environmental/water/drinking/lead/lead_testing_of_school_drinking_water.htm)

RECOMMENDATIONS

When lead concentrations exceed 5 ppb, Langan offers the following recommendations to White Plains for remediation:

In accordance with Subpart 67-4, Section 67-4.4 Response, the following immediate Response Actions are necessary:

- Prohibit the use of the outlet immediately (take outlet out of service or turn off) until:
  1. A lead remedial action plan is implemented to mitigate the lead level at the outlet, and
  2. Post-remediation test results indicate that the lead levels are at or below the action level;
- Provide building occupants with an adequate supply of water for drinking and cooking until remediation is performed;
- Report the test results to the local health department as soon as practicable, but no more than 1 business day after the school received the laboratory report **(Notification issued by Langan via email on 5/03/2024)**

- Notify all staff and all persons in parental relation to students of the test results, in writing, as soon as practicable but no more than 10 business days after the school received the laboratory report **(See Attached Draft Letter for Issuance by District)**

If an outlet tested above the "action level", it can still be used for cleaning and handwashing.

However, please note:

- Signage must be placed at such outlets stating that the water should not be used for drinking (only handwashing and cleaning).
- Pictures should be used if there are small children using the water outlets, and staff should ensure the children understand what the signs mean and monitor the outlets to ensure they are not used for drinking.

Corrective Actions / Remediation Options

- Permanent removal of an outlet
- Outlet replacement with "lead-free" plumbing materials
- Pipe replacement with "lead-free" plumbing materials
- Remove other sources of lead (lead pipe, lead solder joints, and brass plumbing components with "lead-free" materials)
- Flushing (systematic flushing program)
- Point of Use (POU) Filters*
- Supervision
- Engineering controls
- Education
- Signage. Signage used at outlets are considered to be a temporary measure and cannot be used as a permanent measure.

Non-Applicable Outlets

- Tempered Outlets. These outlets should be clearly posted with signs ("Do Not Drink" or equivalent), provide awareness education to students and staff and implement appropriate remedial actions to prevent drinking from these outlets.
- Science/Art sinks: as noted by NYSDOL, typically these classroom settings prohibit eating and/or drinking. The school Superintendent has the authority to determine whether these outlets may be used for drinking or cooking or whether they require sampling. Management controls such as restricted/secured access (e.g. locked doors), signage, required supervision and other management controls are part of the overall safety and health program elements that should be in place.

LIMITATIONS, EXCEPTIONS AND ASSUMPTIONS

Opinions and recommendations presented in this report apply to site conditions and features as they existed at the time of Langan's site visits, and those reasonably foreseeable. They cannot necessarily apply to conditions and features of which Langan is unaware and has not had the opportunity to evaluate. The conclusions presented in this report are professional opinions based solely upon Langan's visual observations of accessible areas and sampling data. These conclusions are intended exclusively for the purpose state herein, at the sites indicated, and for the project indicated. No expressed or implied representation or warranty is included or intended in our reports, except that our services were performed, within the limits prescribed by our client, with the customary thoroughness and competence of our profession.

CLOSURE

We trust that the information and recommendations provided in this report adequately address your concerns. If you have any questions, please do not hesitate to contact us.

.

Very Truly Yours,
Langan Engineering, Environmental, Surveying, Landscape Architecture and Geology, D.P.C.

Brian Feury, CIH
Senior Project Manager

Craig Napolitano, CHMM
Associate

APPENDIX A

Laboratory Results and Chain of Custody

Technical Report

prepared for:

Langan Engineering & Environmental Services (NJ)
300 Kimball Drive, 4th Floor
Parsipanny NJ, 07054-2172
Attention: Brian Feury

Report Date: 05/03/2024
Client Project ID: 101061142
York Project (SDG) No.: 24D1748

Report Date: 05/03/2024
Client Project ID: 101061142
York Project (SDG) No.: 24D1748

Langan Engineering & Environmental Services (NJ)
300 Kimball Drive, 4th Floor
Parsipanny NJ, 07054-2172
Attention: Brian Feury

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on April 26, 2024 and listed below. The project was identified as your project: **101061142**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

York Sample ID	Client Sample ID	Matrix	Date Collected	Date Received
24D1748-01	1. A1020-Rm A006 Kitchen-Sink	Drinking Water	04/26/2024	04/26/2024
24D1748-02	. A2001-Hallway at Womens Faculty Bathroom-W	Drinking Water	04/26/2024	04/26/2024
24D1748-03	. A2001-Hallway at Womens Faculty Bathroom-Bl	Drinking Water	04/26/2024	04/26/2024
24D1748-04	4. A2039-Admin Office-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-05	5. A3001-Hallway at Girls Bathroom-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-06	6. A3001-Hallway at Girls Bathroom-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-07	7. B1003-Rm B101-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-08	8. B1002-Hallway at Boys Bathroom-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-09	9. B1002-Hallway at Boys Bathroom-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-10	10. B1032-Hallway at Girls Bathroom-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-11	11. B1032-Hallway at Girls Bathroom-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-12	12. B2017-Hallway at Faculty Bathroom-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-13	13. B2017-Hallway at Faculty Bathroom-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-14	14. C1027-Rm C001A-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-15	15. C1033 Hallway at Rm C007-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-16	16. C1033 Hallway at Rm C007-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-17	17. C1033 Hallway at Rm C015B-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-18	18. C1033 Hallway at Rm C015B-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-19	19. C2005-Rm C141-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-20	20. C2058-Library-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-21	21. C2059-Hallway at Library Bathroom-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-22	22. C2086-Hallway at Rm C110-WF	Drinking Water	04/26/2024	04/26/2024

York Sample ID	Client Sample ID	Matrix	Date Collected	Date Received
24D1748-23	23. C2086-Hallway at Rm C110-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-24	24. C2086-Hallway at Rm C102-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-25	25. C2086-Hallway at Rm C102-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-26	26. C2101-Rm C151-Sink (Home Economics)-Left	Drinking Water	04/26/2024	04/26/2024
24D1748-27	27. C2101-Rm C151-Sink (Home Economics)-Righ	Drinking Water	04/26/2024	04/26/2024
24D1748-28	28. D2002-Hallway at Faculty Bathroom-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-29	29. E1007-Hallway at Janitors Closet-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-30	30. E1007-Hallway at Janitors Closet-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-31	31. E1024C-Auxlliary Locker Rm Hallway-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-32	32. E1029-Hallway at Girls Locker Rm-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-33	33. E1029-Hallway at Girls Locker Rm-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-34	4. E2000-North Gym Lobby Stairwell Landing-WI	Drinking Water	04/26/2024	04/26/2024
24D1748-35	5. E2001-North Gym Lobby Stairwell Landing-WI	Drinking Water	04/26/2024	04/26/2024
24D1748-36	6. E2002-Hallway to North Gym Mechanical Rm-I	Drinking Water	04/26/2024	04/26/2024
24D1748-37	38. E2016 Hallway at Pool Bulding Breezeway-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-38	39. E2016 Hallway at Pool Bulding Breezeway-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-39	irst Room Left-IM (adj N Gym Ground Floor) Tra	Drinking Water	04/26/2024	04/26/2024
24D1748-40	43. E3002-Nurses Office-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-41	44. E3001-Hallway at Boys Bathroom-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-42	45. E3001-Hallway at Boys Bathroom-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-43	46. E3012-Hallway at Girls Bathroom-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-44	47. E3012-Hallway at Girls Bathroom-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-45	48. F2001-Poolside at Locker Rms-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-47	50. G1001 Hallway at Girls Bathroom-WF Left	Drinking Water	04/26/2024	04/26/2024
24D1748-48	51. G1001 Hallway at Girls Bathroom-BF Left	Drinking Water	04/26/2024	04/26/2024
24D1748-49	52. G1001 Hallway at Girls Bathrom-WF Right	Drinking Water	04/26/2024	04/26/2024
24D1748-50	53. G1001 Hallway at Girls Bathrom-BF Right	Drinking Water	04/26/2024	04/26/2024
24D1748-51	54. H1004B-Cafeteria-WF-Left	Drinking Water	04/26/2024	04/26/2024
24D1748-52	55. H1004B-Cafeteria-WF-Right	Drinking Water	04/26/2024	04/26/2024
24D1748-53	56. H1004B-Cafeteria-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-54	7. H1006-Kitchen-Food Prep-Sink (Rear of Kitche	Drinking Water	04/26/2024	04/26/2024
24D1748-55	. H1006- Kitchen-Pasta Filler-SPY (Rear of Kitche	Drinking Water	04/26/2024	04/26/2024
24D1748-56	[1006- Kitchen-Fryer Filler-SPY (Rear of Kitchen)	Drinking Water	04/26/2024	04/26/2024
24D1748-57	1006- Kitchen-Fryer Filler-SPY (Rear of Kitchen)-	Drinking Water	04/26/2024	04/26/2024
24D1748-58	1006- Kitchen-Food Prep-Sink (Front of Kitchen)-	Drinking Water	04/26/2024	04/26/2024
24D1748-59	1006-Kitchen-Food Prep-Sink (Front of Kitchen)-	Drinking Water	04/26/2024	04/26/2024
24D1748-60	66. Field House-S Locker Rm-WF	Drinking Water	04/26/2024	04/26/2024
24D1748-61	67. Field House-Garage-IM	Drinking Water	04/26/2024	04/26/2024
24D1748-62	68. Field House- Garage-Sink	Drinking Water	04/26/2024	04/26/2024
24D1748-63	69. Main Office Pantry/Kitchen C1295-BF	Drinking Water	04/26/2024	04/26/2024
24D1748-64	70. Field House-Garage-Hose	Drinking Water	04/26/2024	04/26/2024

General Notes for York Project (SDG) No.: 24D1748

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

Approved By  **Date:** 05/03/2024

Cassie L. Mosher
Laboratory Manager

Sample Information

Client Sample ID: **1. A1020-Rm A006 Kitchen-Sink** **York Sample ID:** **24D1748-01**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:19 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/01/2024 11:02	05/01/2024 15:10	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 2. A2001-Hallway at Womens Faculty Bathroom-WF **York Sample ID:** 24D1748-02

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:20 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/01/2024 11:02	05/01/2024 15:12	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 3. A2001-Hallway at Womens Faculty Bathroom-BF **York Sample ID:** 24D1748-03

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:20 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/01/2024 11:02	05/01/2024 15:13	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **4. A2039-Admin Office-BF** **York Sample ID:** **24D1748-04**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:22 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/01/2024 11:02	05/01/2024 15:14	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **5. A3001-Hallway at Girls Bathroom-WF** **York Sample ID:** **24D1748-05**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:18 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/01/2024 11:02	05/01/2024 15:28	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 6. A3001-Hallway at Girls Bathroom-BF **York Sample ID:** 24D1748-06

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:18 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/01/2024 11:02	05/01/2024 15:29	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 7. B1003-Rm B101-BF **York Sample ID:** 24D1748-07

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:52 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/01/2024 11:02	05/01/2024 15:30	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 8. B1002-Hallway at Boys Bathroom-WF **York Sample ID:** 24D1748-08

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:54 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:21	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 9. B1002-Hallway at Boys Bathroom-BF **York Sample ID:** 24D1748-09

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:54 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:23	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **10. B1032-Hallway at Girls Bathroom-WF** **York Sample ID:** **24D1748-10**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:53 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:25	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **11. B1032-Hallway at Girls Bathroom-BF** **York Sample ID:** **24D1748-11**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:53 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:26	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **12. B2017-Hallway at Faculty Bathroom-WF** **York Sample ID:** **24D1748-12**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:56 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:27	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 13. B2017-Hallway at Faculty Bathroom-BF **York Sample ID:** 24D1748-13

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:56 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:29	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **14. C1027-Rm C001A-BF** **York Sample ID:** **24D1748-14**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:10 am	04/26/2024

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:30	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 15. C1033 Hallway at Rm C007-WF **York Sample ID:** 24D1748-15

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:10 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:34	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **16. C1033 Hallway at Rm C007-BF** **York Sample ID:** **24D1748-16**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:10 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:35	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 17. C1033 Hallway at Rm C015B-WF **York Sample ID:** 24D1748-17

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:08 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:37	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **18. C1033 Hallway at Rm C015B-BF** **York Sample ID:** **24D1748-18**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:08 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:38	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 19. C2005-Rm C141-BF **York Sample ID:** 24D1748-19

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:36 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:39	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **20. C2058-Library-BF** **York Sample ID:** **24D1748-20**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:50 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:41	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **21. C2059-Hallway at Library Bathroom-WF** **York Sample ID:** **24D1748-21**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:50 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:42	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **22. C2086-Hallway at Rm C110-WF** **York Sample ID:** **24D1748-22**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:32 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:43	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **23. C2086-Hallway at Rm C110-BF** **York Sample ID:** **24D1748-23**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:32 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:45	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **24. C2086-Hallway at Rm C102-WF** **York Sample ID:** **24D1748-24**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:31 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:46	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **25. C2086-Hallway at Rm C102-BF** **York Sample ID:** **24D1748-25**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:31 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:50	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **26. C2101-Rm C151-Sink (Home Economics)-Left** **York Sample ID:** **24D1748-26**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:35 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:51	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 27. C2101-Rm C151-Sink (Home Economics)-Right **York Sample ID:** 24D1748-27

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:35 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:11	05/02/2024 14:53	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **28. D2002-Hallway at Faculty Bathroom-WF** **York Sample ID:** **24D1748-28**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:14 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 14:59	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 29. E1007-Hallway at Janitors Closet-WF **York Sample ID:** 24D1748-29

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:31 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:02	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **30. E1007-Hallway at Janitors Closet-BF** **York Sample ID:** **24D1748-30**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:31 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:06	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **31. E1024C-Auxlliary Locker Rm Hallway-WF** **York Sample ID:** **24D1748-31**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:36 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	**Lead**	**30.6**	M-PbE X	ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:07	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 32. E1029-Hallway at Girls Locker Rm-WF **York Sample ID:** 24D1748-32

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:35 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:09	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 33. E1029-Hallway at Girls Locker Rm-BF **York Sample ID:** 24D1748-33

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:35 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:10	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **34. E2000-North Gym Lobby Stairwell Landing-WF** **York Sample ID:** **24D1748-34**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:28 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	**Lead**	**3.90**		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:11	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **35. E2001-North Gym Lobby Stairwell Landing-WF** **York Sample ID:** **24D1748-35**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:29 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	**Lead**	**2.66**		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:13	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **36. E2002-Hallway to North Gym Mechanical Rm-IM** **York Sample ID:** **24D1748-36**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:29 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:14	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **38. E2016 Hallway at Pool Bulding Breezeway-WF** **York Sample ID:** **24D1748-37**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:25 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:15	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **39. E2016 Hallway at Pool Bulding Breezeway-BF** **York Sample ID:** **24D1748-38**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:25 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:17	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 42. E3000-First Room Left-IM (adj N Gym Ground Floor) Trainors Room **York Sample ID:** 24D1748-39

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:18 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:18	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **43. E3002-Nurses Office-BF** **York Sample ID:** **24D1748-40**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:19 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	**Lead**	**1.47**		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:22	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 44. E3001-Hallway at Boys Bathroom-WF **York Sample ID:** 24D1748-41

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:21 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:23	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **45. E3001-Hallway at Boys Bathroom-BF** **York Sample ID:** **24D1748-42**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:21 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:25	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 46. E3012-Hallway at Girls Bathroom-WF **York Sample ID:** 24D1748-43

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:21 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:26	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 47. E3012-Hallway at Girls Bathroom-BF **York Sample ID:** 24D1748-44

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:21 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:27	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **48. F2001-Poolside at Locker Rms-WF** **York Sample ID:** **24D1748-45**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:34 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:29	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **49. F2001-Poolside at Locker Rms-BF** **York Sample ID:** **24D1748-46**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:34 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:30	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **50. G1001 Hallway at Girls Bathroom-WF Left** **York Sample ID:** **24D1748-47**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:14 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	1.00	1	EPA 200.8	05/02/2024 11:13	05/02/2024 15:31	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **51. G1001 Hallway at Girls Bathroom-BF Left** **York Sample ID:** **24D1748-48**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:14 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 15:46	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **52. G1001 Hallway at Girls Bathrom-WF Right** **York Sample ID:** **24D1748-49**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:15 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 15:47	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **53. G1001 Hallway at Girls Bathrom-BF Right** **York Sample ID:** **24D1748-50**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:15 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 15:49	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **54. H1004B-Cafeteria-WF-Left** **York Sample ID:** **24D1748-51**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:06 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 15:50	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **55. H1004B-Cafeteria-WF-Right** **York Sample ID:** **24D1748-52**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:06 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 15:54	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **56. H1004B-Cafeteria-BF** **York Sample ID:** **24D1748-53**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:05 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 15:55	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **57. H1006-Kitchen-Food Prep-Sink (Rear of Kitchen)** **York Sample ID:** **24D1748-54**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:01 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	**Lead**	**1.85**	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 15:57	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **58. H1006- Kitchen-Pasta Filler-SPY (Rear of Kitchen)** **York Sample ID:** **24D1748-55**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:00 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 15:58	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **59. H1006- Kitchen-Fryer Filler-SPY (Rear of Kitchen)-Left** **York Sample ID:** **24D1748-56**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:02 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	**Lead**	**1.37**	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 15:59	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 60. H1006- Kitchen-Fryer Filler-SPY (Rear of Kitchen)-Right **York Sample ID:** 24D1748-57

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:02 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 16:01	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 61. H1006- Kitchen-Food Prep-Sink (Front of Kitchen)-Rear **York Sample ID:** 24D1748-58

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:03 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 16:02	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 62. H1006-Kitchen-Food Prep-Sink (Front of Kitchen)- Front **York Sample ID:** 24D1748-59

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:03 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 16:03	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: 66. Field House-S Locker Rm-WF **York Sample ID:** 24D1748-60

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 5:55 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	**Lead**	**5.24**	M-BS, M-CCV 1, M-PbEX	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 16:05	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **67. Field House-Garage-IM** **York Sample ID:** **24D1748-61**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 6:00 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS, M-CCV 1	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 16:06	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **68. Field House- Garage-Sink** **York Sample ID:** **24D1748-62**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 6:00 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	**Lead**	**1.28**	M-BS	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 16:10	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **69. Main Office Pantry/Kitchen C1295-BF** **York Sample ID:** **24D1748-63**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 4:45 am	04/26/2024

Lead by EPA 200.8

Log-in Notes: PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 16:11	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Sample Information

Client Sample ID: **70. Field House-Garage-Hose** **York Sample ID:** **24D1748-64**

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
24D1748	101061142	Drinking Water	April 26, 2024 6:01 am	04/26/2024

Lead by EPA 200.8 **Log-in Notes:** PRES **Sample Notes:**

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND	M-BS	ug/L	1.00	1	EPA 200.8	05/02/2024 11:15	05/02/2024 16:13	AJL
							Certifications:	CTDOH-PH-0723,NELAC-NY10854,NJDEP-CT005,PADEP-68-044		

Analytical Batch Summary

Batch ID: BE40056 **Preparation Method:** EPA 200.8 **Prepared By:** AJL

YORK Sample ID	Client Sample ID	Preparation Date
24D1748-01	1. A1020-Rm A006 Kitchen-Sir	05/01/24
24D1748-02	2. A2001-Hallway at Womens F	05/01/24
24D1748-03	3. A2001-Hallway at Womens F	05/01/24
24D1748-04	4. A2039-Admin Office-BF	05/01/24
24D1748-05	5. A3001-Hallway at Girls Bath	05/01/24
24D1748-06	6. A3001-Hallway at Girls Bath	05/01/24
24D1748-07	7. B1003-Rm B101-BF	05/01/24
BE40056-BLK1	Blank	05/01/24
BE40056-BS1	LCS	05/01/24
BE40056-DUP1	Duplicate	05/01/24
BE40056-MS1	Matrix Spike	05/01/24
BE40056-MS2	Matrix Spike	05/01/24

Batch ID: BE40149 **Preparation Method:** EPA 200.8 **Prepared By:** AJL

YORK Sample ID	Client Sample ID	Preparation Date
24D1748-08	8. B1002-Hallway at Boys Bath	05/02/24
24D1748-09	9. B1002-Hallway at Boys Bath	05/02/24
24D1748-10	10. B1032-Hallway at Girls Bat	05/02/24
24D1748-11	11. B1032-Hallway at Girls Bat	05/02/24
24D1748-12	12. B2017-Hallway at Faculty I	05/02/24
24D1748-13	13. B2017-Hallway at Faculty I	05/02/24
24D1748-14	14. C1027-Rm C001A-BF	05/02/24
24D1748-15	15. C1033 Hallway at Rm C007	05/02/24
24D1748-16	16. C1033 Hallway at Rm C007	05/02/24
24D1748-17	17. C1033 Hallway at Rm C015	05/02/24
24D1748-18	18. C1033 Hallway at Rm C015	05/02/24
24D1748-19	19. C2005-Rm C141-BF	05/02/24
24D1748-20	20. C2058-Library-BF	05/02/24
24D1748-21	21. C2059-Hallway at Library I	05/02/24
24D1748-22	22. C2086-Hallway at Rm C11(	05/02/24
24D1748-23	23. C2086-Hallway at Rm C11(	05/02/24
24D1748-24	24. C2086-Hallway at Rm C10	05/02/24
24D1748-25	25. C2086-Hallway at Rm C10	05/02/24
24D1748-26	26. C2101-Rm C151-Sink (Hor	05/02/24
24D1748-27	27. C2101-Rm C151-Sink (Hor	05/02/24
BE40149-BLK1	Blank	05/02/24
BE40149-BS1	LCS	05/02/24
BE40149-DUP1	Duplicate	05/02/24
BE40149-MS1	Matrix Spike	05/02/24
BE40149-MS2	Matrix Spike	05/02/24

Batch ID: BE40150 **Preparation Method:** EPA 200.8 **Prepared By:** AJL

YORK Sample ID	Client Sample ID	Preparation Date

24D1748-28	28. D2002-Hallway at Faculty I	05/02/24
24D1748-29	29. E1007-Hallway at Janitors (	05/02/24
24D1748-30	30. E1007-Hallway at Janitors (	05/02/24
24D1748-31	31. E1024C-Auxlliary Locker F	05/02/24
24D1748-32	32. E1029-Hallway at Girls Loc	05/02/24
24D1748-33	33. E1029-Hallway at Girls Loc	05/02/24
24D1748-34	34. E2000-North Gym Lobby S	05/02/24
24D1748-35	35. E2001-North Gym Lobby S	05/02/24
24D1748-36	36. E2002-Hallway to North Gy	05/02/24
24D1748-37	38. E2016 Hallway at Pool Bul	05/02/24
24D1748-38	39. E2016 Hallway at Pool Bul	05/02/24
24D1748-39	42. E3000-First Room Left-IM	05/02/24
24D1748-40	43. E3002-Nurses Office-BF	05/02/24
24D1748-41	44. E3001-Hallway at Boys Bat	05/02/24
24D1748-42	45. E3001-Hallway at Boys Bat	05/02/24
24D1748-43	46. E3012-Hallway at Girls Bat	05/02/24
24D1748-44	47. E3012-Hallway at Girls Bat	05/02/24
24D1748-45	48. F2001-Poolside at Locker R	05/02/24
24D1748-46	49. F2001-Poolside at Locker R	05/02/24
24D1748-47	50. G1001 Hallway at Girls Bat	05/02/24
BE40150-BLK1	Blank	05/02/24
BE40150-BS1	LCS	05/02/24
BE40150-DUP1	Duplicate	05/02/24
BE40150-MS1	Matrix Spike	05/02/24
BE40150-MS2	Matrix Spike	05/02/24

Batch ID: BE40151 **Preparation Method:** EPA 200.8 **Prepared By:** AJL

YORK Sample ID	Client Sample ID	Preparation Date
24D1748-48	51. G1001 Hallway at Girls Bat	05/02/24
24D1748-49	52. G1001 Hallway at Girls Bat	05/02/24
24D1748-50	53. G1001 Hallway at Girls Bat	05/02/24
24D1748-51	54. H1004B-Cafeteria-WF-Left	05/02/24
24D1748-52	55. H1004B-Cafeteria-WF-Rigl	05/02/24
24D1748-53	56. H1004B-Cafeteria-BF	05/02/24
24D1748-54	57. H1006-Kitchen-Food Prep-S	05/02/24
24D1748-55	58. H1006- Kitchen-Pasta Filler	05/02/24
24D1748-56	59. H1006- Kitchen-Fryer Filler	05/02/24
24D1748-57	60. H1006- Kitchen-Fryer Filler	05/02/24
24D1748-58	61. H1006- Kitchen-Food Prep-	05/02/24
24D1748-59	62. H1006-Kitchen-Food Prep-S	05/02/24
24D1748-60	66. Field House-S Locker Rm-V	05/02/24
24D1748-61	67. Field House-Garage-IM	05/02/24
24D1748-62	68. Field House- Garage-Sink	05/02/24
24D1748-63	69. Main Office Pantry/Kitchen	05/02/24
24D1748-64	70. Field House-Garage-Hose	05/02/24
BE40151-BLK1	Blank	05/02/24
BE40151-BS1	LCS	05/02/24
BE40151-DUP1	Duplicate	05/02/24
BE40151-MS1	Matrix Spike	05/02/24
BE40151-MS2	Matrix Spike	05/02/24

Metals by ICP/MS - Quality Control Data

York Analytical Laboratories, Inc. - Stratford

Analyte		Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BE40056 - EPA 200.8												
Blank (BE40056-BLK1)	Blank								Prepared & Analyzed: 05/01/2024			
Lead		ND	1.00	ug/L								
LCS (BE40056-BS1)	LCS								Prepared & Analyzed: 05/01/2024			
Lead		45.7		ug/L	50.0		91.5	85-115				
Duplicate (BE40056-DUP1)	Duplicate	*Source sample: 24D1748-07 (7. B1003-Rm B101-BF)							Prepared & Analyzed: 05/01/2024			
Lead		ND	1.00	ug/L		ND					20	
Matrix Spike (BE40056-MS1)	Matrix Spike	*Source sample: 24D1748-07 (7. B1003-Rm B101-BF)							Prepared & Analyzed: 05/01/2024			
Lead		46.6		ug/L	50.0	0.036	93.2	75-125				
Matrix Spike (BE40056-MS2)	Matrix Spike	*Source sample: 24D1626-02 (Matrix Spike)							Prepared & Analyzed: 05/01/2024			
Lead		46.3		ug/L	50.0	0.075	92.4	75-125				
Batch BE40149 - EPA 200.8												
Blank (BE40149-BLK1)	Blank								Prepared & Analyzed: 05/02/2024			
Lead		ND	1.00	ug/L								
LCS (BE40149-BS1)	LCS								Prepared & Analyzed: 05/02/2024			
Lead		45.5		ug/L	50.0		91.1	85-115				
Duplicate (BE40149-DUP1)	Duplicate	*Source sample: 24D1748-27 (27. C2101-Rm C151-Sink (Home Economics)-Right)							Prepared & Analyzed: 05/02/2024			
Lead		ND	1.00	ug/L		ND					20	
Matrix Spike (BE40149-MS1)	Matrix Spike	*Source sample: 24D1748-27 (27. C2101-Rm C151-Sink (Home Economics)-Right)							Prepared & Analyzed: 05/02/2024			
Lead		52.5		ug/L	50.0	0.819	103	75-125				

Metals by ICP/MS - Quality Control Data

York Analytical Laboratories, Inc. - Stratford

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BE40149 - EPA 200.8											
Matrix Spike (BE40149-MS2) Matrix Spike	*Source sample: 24D1748-08 (8. B1002-Hallway at Boys Bathroom-WF)							Prepared & Analyzed: 05/02/2024			
Lead	52.3		ug/L	50.0	0.078	104	75-125				
Batch BE40150 - EPA 200.8											
Blank (BE40150-BLK1) Blank								Prepared & Analyzed: 05/02/2024			
Lead	ND	1.00	ug/L								
LCS (BE40150-BS1) LCS								Prepared & Analyzed: 05/02/2024			
Lead	47.4		ug/L	50.0		94.8	85-115				
Duplicate (BE40150-DUP1) Duplicate	*Source sample: 24D1748-47 (50. G1001 Hallway at Girls Bathroom-WF Left)							Prepared & Analyzed: 05/02/2024			
Lead	ND	1.00	ug/L		ND					20	
Matrix Spike (BE40150-MS1) Matrix Spike	*Source sample: 24D1748-47 (50. G1001 Hallway at Girls Bathroom-WF Left)							Prepared & Analyzed: 05/02/2024			
Lead	45.4		ug/L	50.0	0.057	90.7	75-125				
Matrix Spike (BE40150-MS2) Matrix Spike	*Source sample: 24D1748-28 (28. D2002-Hallway at Faculty Bathroom-WF)							Prepared & Analyzed: 05/02/2024			
Lead	49.4		ug/L	50.0	0.565	97.7	75-125				
Batch BE40151 - EPA 200.8											
Blank (BE40151-BLK1) Blank								Prepared & Analyzed: 05/02/2024			
Lead	ND	1.00	ug/L								
LCS (BE40151-BS1) LCS								Prepared & Analyzed: 05/02/2024			
Lead	40.8		ug/L	50.0		81.6	85-115	Low Bias			

Metals by ICP/MS - Quality Control Data

York Analytical Laboratories, Inc. - Stratford

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BE40151 - EPA 200.8											
Duplicate (BE40151-DUP1) Duplicate	*Source sample: 24D1748-64 (70. Field House-Garage-Hose)							Prepared & Analyzed: 05/02/2024			
Lead	ND	1.00	ug/L		ND					20	
Matrix Spike (BE40151-MS1) Matrix Spike	*Source sample: 24D1748-64 (70. Field House-Garage-Hose)							Prepared & Analyzed: 05/02/2024			
Lead	48.1		ug/L	50.0	0.208	95.8	75-125				
Matrix Spike (BE40151-MS2) Matrix Spike	*Source sample: 24D1723-01 (Matrix Spike)							Prepared & Analyzed: 05/02/2024			
Lead	46.1		ug/L	50.0	0.152	91.9	75-125				

Sample and Data Qualifiers Relating to This Work Order

PRES	Sample was received with no preservative and was preserved upon receipt at the laboratory. If for metals, the sample was allowed to sit for 18-24 hours before analysis.
M-PbEX	Lead result exceeds regulatory limit
M-CCV1	The recovery for this element in the Continuing Calibration Verification (CCV) was outside the 90-110% recovery criteria.
M-BS	The recovery for this element in the batch blank spike recovered slightly outside of control limits

Definitions and Other Explanations

*	Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
ND	NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
LOQ	LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
LOD	LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
MDL	METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
Reported to	This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.

For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.

LANGAN

300 Kimball Drive
Parsippany, NJ 07054
Phone: 973-560-4900
Fax: 973-560-4901

CHAIN OF CUSTODY RECORD / ANALYSIS REQUEST ..... OF .....

Black Sharpie pres. 10:00 24D0748

Project Name:	White Plains HS		
Address:	550 Post Road White Plains, NY 10606	Auth. By: Phone No:	Craig Napolitano 646-210-6500
Langan Job No.:	101061142	Sampling Date:	4/26/2024
Sampled By/License #:	Frank Acciarito Drew Cheskin		

Lab ID #	Sample ID	Description of Sample	Volume	Date/Time Sampled	Analysis Requested for Lead (EPA 200.8)
	1	A1020 - Rm A006 Kitchen - Sink	250 mL	4/26/2024 0414	X
	2	A2001 - Hallway @ Womens Faculty Bathroom - WF	250 mL	4/26/2024 0420	X
	3	A2001 - Hallway @ Womens Faculty Bathroom - BF	250 mL	4/26/2024 0420	X
	4	A2039 - Admin Office - BF	250 mL	4/26/2024 0422	X
	5	A3001 - Hallway @ Girls Bathroom - WF	250 mL	4/26/2024 0418	X
	6	A3001 - Hallway @ Girls Bathroom - BF	250 mL	4/26/2024 0418	X
	7	B1003 - Rm B101 - BF	250 mL	4/26/2024 04:52	X
	8	B1002 - Hallway @ Boys Bathroom - WF	250 mL	4/26/2024 04:54	X
	9	B1002 - Hallway @ Boys Bathroom - BF	250 mL	4/26/2024 04:54	X
	10	B1032 - Hallway @ Girls Bathroom - WF	250 mL	4/26/2024 04:53	X
	11	B1032 - Hallway @ Girls Bathroom - BF	250 mL	4/26/2024 04:53	X
	12	B2017 - Hallway @ Faculty Bathroom - WF	250 mL	4/26/2024 04:56	X
	13	B2017 - Hallway @ Faculty Bathroom - BF	250 mL	4/26/2024 04:56	X
	14	C1027 - Rm C001A - BF	250 mL	4/26/2024 05:10	X
	15	C1033 Hallway @ Rm C007 - WF	250 mL	4/26/2024 05:10	X
	16	C1033 Hallway @ Rm C007 - BF	250 mL	4/26/2024 05:10	X
	17	C1033 Hallway @ Rm C015B - WF	250 mL	4/26/2024 05:08	X

Total No. of Samples:	17	Request:	5 day	48 hours	72 hour
			x		

Laboratory Instructions: Please email results to dcheskin@langan.com; bfeury@langan.com and cnapolitano@langan.com
DW - drinking water fountain; WB - water bottle filler; CF - classroom sink faucet; KF - kitchen faucet; BF - bathroom sink faucet; NS - Nurse's office faucet

Relinquished By:	Frank Acciarito	4/26/2024	Time:	Date:
Company: LANGAN				

Laboratory Name: York Analytical

Marcel S. York 4/26/24 10:50 REC'D LAB: KMA 4/26/24 20:35 8.4

Marcel S. York 4/26/24 1830

Rec: Romin Duran 4/26/24 1830 R. Romin Duran 4/

LANGAN

300 Kimball Drive
Parsippany, NJ 07054
Phone: 973-560-4900
Fax: 973-560-4901

CHAIN OF CUSTODY RECORD / ANALYSIS REQUEST ..... OF .....

Project Name:	White Plains HS		
Address:	550 Post Road White Plains, NY 10606	Auth. By: Phone No:	Craig Napolitano 646-210-6500
Langan Job No.:	101061142	Sampling Date:	4/26/2024
Sampled By/License #:	Frank Acciarito Drew Cheskin		

Lab ID #	Sample ID	Description of Sample	Volume	Date/Time Sampled	Analysis Requested for Lead (EPA 200.8)
	18	C1033 Hallway @ Rm C015B - BF	250 mL	4/26/2024 05:08	X
	19	C2005 - Rm C141 - BF	250 mL	4/26/2024 04:36	X
	20	C2058 - Library - BF	250 mL	4/26/2024 04:50	X
	21	C2059 - Hallway @ Library Bathroom - WF	250 mL	4/26/2024 04:50	X
	22	C2086 - Hallway @ Rm C110 - WF	250 mL	4/26/2024 04:30	X
	23	C2086 - Hallway @ Rm C110 - BF	250 mL	4/26/2024 04:30	X
	24	C2086 - Hallway @ Rm C102 - WF	250 mL	4/26/2024 04:31	X
	25	C2086 - Hallway @ Rm C102 - BF	250 mL	4/26/2024 04:31	X
	26	C2101 - Rm C151 - Sink (Home Economics) - Left	250 mL	4/26/2024 04:35	X
	27	C2101 - Rm C151 - Sink (Home Economics) - Right	250 mL	4/26/2024 04:35	X
	28	D2002 - Hallway @ Faculty Bathroom - WF	250 mL	4/26/2024 05:14	X
	29	E1007 - Hallway @ Janitors Closet - WF	250 mL	4/26/2024 05:31	X
	30	E1007 - Hallway @ Janitors Closet - BF	250 mL	4/26/2024 05:31	X
	31	E1024C - Auxiliary Locker Rm Hallway - WF	250 mL	4/26/2024 05:36	X
	32	E1029 - Hallway @ Girls Locker Rm - WF	250 mL	4/26/2024 05:35	X
	33	E1029 - Hallway @ Girls Locker Rm - BF	250 mL	4/26/2024 05:35	X
	34	E2000 - North Gym Lobby/Stairwell Landing - WF	250 mL	4/26/2024 05:28	X

Total No. of Samples:	17	Request:	5 day	48 hours	72 hour
			x		

Laboratory Instructions: Please email results to dcheskin@langan.com; bfeury@langan.com and cnapolitano@langan.com
DW - drinking water fountain; WB - water bottle filler; CF - classroom sink faucet; KF - kitchen faucet; BF - bathroom sink faucet; NS - Nurse's office faucet

Relinquished By:	Frank Acciarito	4/26/2024	Time:	Date:
Company: **LANGAN**				

Laboratory Name: York Analytical RAC CAB KDM 4/26/24 20:35 5.4

LANGAN

300 Kimball Drive
Parsippany, NJ 07054
Phone: 973-560-4900
Fax: 973-560-4901

CHAIN OF CUSTODY RECORD / ANALYSIS REQUEST ..... OF .....

240178

Project Name:	White Plains HS		
Address:	550 Post Road White Plains, NY 10606	Auth. By: Phone No:	Craig Napolitano 646-210-6500
Langan Job No.:	101061142	Sampling Date:	4/26/2024
Sampled By/License #:	Frank Acciarito Drew Cheskin		

Lab ID #	Sample ID	Description of Sample	Volume	Date/Time Sampled	Analysis Requested for Lead (EPA 200.8)
	35	E2001 - North Gym Lobby/Stairwell Landing - WF	250 mL	4/26/2024 05:29	X
	36	E2002 - Hallway to North Gym Mechanical Rm - IM	250 mL	4/26/2024 05:29	X
	37	~~E2006 - North Gym Lobby/ Stairwell Landing - WF~~ No sample	250 mL	4/26/2024	X
	38	E2016 Hallway @ Pool Building Breezeway - WF	250 mL	4/26/2024 05:25	X
	39	E2016 Hallway @ Pool Building Breezeway - BF	250 mL	4/26/2024 05:25	X
	40	~~E2023 - South Gym Lobby/Stairwell Landing - WF~~ No sample	250 mL	4/26/2024 —	X
	41	~~E2027 - South Gym Lobby/Stairwell Landing - WF~~ No Sample	250 mL	4/26/2024 —	X
	42	E3000 - First Room, Left - IM (Hallway adj. N. Gym Ground Floor) – Trainers Room	250 mL	4/26/2024 05:18	X
	43	E3002 - Nurses Office - BF	250 mL	4/26/2024 05:19	X
	44	E3001 - Hallway @ Boys Bathroom - WF	250 mL	4/26/2024 05:21	X
	45	E3001 - Hallway @ Boys Bathroom - BF	250 mL	4/26/2024 05:21	X
	46	E3012 - Hallway @ Girls Bathroom - WF	250 mL	4/26/2024 05:21	X
	47	E3012 - Hallway @ Girls Bathroom - BF	250 mL	4/26/2024 05:21	X
	48	F2001 - Poolside @ Locker Rms - WF	250 mL	4/26/2024 05:34	X
	49	F2001 - Poolside @ Locker Rms - BF	250 mL	4/26/2024 05:34	X
	50	G1001 Hallway @ Girls Bathroom - WF Left	250 mL	4/26/2024 05:14	X
	51	G1001 Hallway @ Girls Bathroom - BF Left	250 mL	4/26/2024 05:14	X

Total No. of Samples:	17	Request:	5 day	48 hours	72 hour
			x		

Laboratory Instructions: Please email results to dcheskin@langan.com; bfeury@langan.com and cnapolitano@langan.com
DW - drinking water fountain; WB - water bottle filler; CF - classroom sink faucet; KF - kitchen faucet; BF - bathroom sink faucet; NS - Nurse's office faucet

Relinquished By:	Frank Acciarito	4/26/2024	Time:	Date:
Company: LANGAN				

Laboratory Name: York Analytical

Marcos York 4/26/24 10:50 REC LAB COPY
Marcos York 4/26/24 1850 4/29/24 8.9

Rec: Ramon Duran 4/28/24 1800 Rel - Ramon Duran 4/

LANGAN

300 Kimball Drive
Parsippany, NJ 07054
Phone: 973-560-4900
Fax: 973-560-4901

CHAIN OF CUSTODY RECORD / ANALYSIS REQUEST ..... OF .....

Project Name:	White Plains HS		
Address:	550 Post Road White Plains, NY 10606	Auth. By: Phone No:	Craig Napolitano 646-210-6500
Langan Job No.:	101061142	Sampling Date:	4/26/2024
Sampled By/License #:	Frank Acciarito Drew Cheskin		

Lab ID #	Sample ID	Description of Sample	Volume	Date/Time Sampled	Analysis Requested for Lead (EPA 200.8)
	52	G1001 Hallway @ Girls Bathroom - WF Right	250 mL	4/26/2024 05:15	X
	53	G1001 Hallway @ Girls Bathroom - BF Right	250 mL	4/26/2024 05:15	X
	54	H1004B - Cafeteria - WF - Left	250 mL	4/26/2024 05:06	X
	55	H1004B - Cafeteria - WF - Right	250 mL	4/26/2024 05:06	X
	56	H1004B - Cafeteria - BF	250 mL	4/26/2024 05:05	X
	57	H1006 - Kitchen - Food Prep - Sink (Rear of Kitchen)	250 mL	4/26/2024 05:01	X
	58	H1006 - Kitchen - Pasta Filler - Sink (Rear of Kitchen)	250 mL	4/26/2024 05:00	X
	59	H1006 - Kitchen - Fryer Filler - SPY (Rear of Kitchen) - Left	250 mL	4/26/2024 05:00	X
	60	H1006 - Kitchen - Fryer Filler - SPY (Rear of Kitchen) - Right	250 mL	4/26/2024 05:00	X
	61	H1006 - Kitchen - Food Prep - Sink (Front of Kitchen) - Rear	250 mL	4/26/2024 05:03	X
	62	H1006 - Kitchen - Food Prep - Sink (Front of Kitchen) - Front	250 mL	4/26/2024 05:03	X
Turned off	63	Field House - N. End - Ext. WF No Sample	250 mL	4/26/2024	X
Turned off	64	Field House - N. Locker Rm - WF No Sample	250 mL	4/26/2024	X
Turned off	65	Field House - Hall between N. & S. Locker Rms - WF No Sample	250 mL	4/26/2024	X
	66	Field House - S. Locker Rm - WF	250 mL	4/26/2024 0555	X
	67	Field House - Garage - IM	250 mL	4/26/2024 0600	X
	68	Field House - Garage - Sink	250 mL	4/26/2024 0600	X

Total No. of Samples: 17

Request:	5 day	48 hours	72 hour
	X		

Laboratory Instructions: Please email results to dcheskin@langan.com; bfeury@langan.com and cnapolitano@langan.com
DW - drinking water fountain; WB - water bottle filler; CF - classroom sink faucet; KF - kitchen faucet; BF - bathroom sink faucet; NS - Nurse's office faucet

Relinquished By:	Frank Acciarito	4/26/2024	Time:	Date:
Company: **LANGAN**				

Laboratory Name: York Analytical REC LAB KRM 4/26/24 20:35 8.4

LANGAN **CHAIN OF CUSTODY RECORD / ANALYSIS REQUEST**

LANGAN

300 Kimball Drive
Parsippany, NJ 07054
Phone: 973-560-4900
Fax: 973-560-4901

2401748 ..... OF .....

Project Name:	White Plains HS		
Address:	550 Post Road White Plains, NY 10606	Auth. By: Phone No:	Craig Napolitano 646-210-6500
Langan Job No.:	101061142	Sampling Date:	4/26/2024
Sampled By/License #:	Frank Acciarito Drew Cheskin		

Lab ID #	Sample ID	Description of Sample	Volume	Date/Time Sampled	Analysis Requested for Lead (EPA 200.8)
	69	Main Office Pantry / Kitchen CBPS-BF	250 mL	4/26/2024 09:45	X
	70	Field House - Garage - Hose	250 mL	4/26/2024 0601	X
	71		250 mL	4/26/2024	X
	72		250 mL	4/26/2024	X
	73		250 mL	4/26/2024	X
	74		250 mL	4/26/2024	X
	75		250 mL	4/26/2024	X
	76		250 mL	4/26/2024	X
	77		250 mL	4/26/2024	X
	78		250 mL	4/26/2024	X
	79		250 mL	4/26/2024	X
	80		250 mL	4/26/2024	X

Turnaround Request:	5 day	48 hours	72 hours
	x		

Total No. of Samples:

Laboratory Instructions: Please email results to dcheskin@langan.com; bfeury@langan.com and cnapolitano@langan.com
DW - drinking water fountain; WB - water bottle filler; CF - classroom sink faucet; KF - kitchen faucet; BF - bathroom sink faucet; NS - Nurse's office faucet

Relinquished By:	Frank Acciarito	4/26/2024	Time:	Date:
Company: LANGAN				
Laboratory Name: York Analytical	Marcee Stark 4/26/24	York Rec 4/26/24 10:38		

Rec - Roman Duran 4/26/24 1830

Rel - Roman Duran 4/26/24
REC LAB KMA 4/26/24 20:35 8.4

APPENDIX B

Certifications and Accreditations

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER

Expires 12:01 AM April 01, 2025
Issued April 01, 2024

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CATHERINE L. MOSHER
YORK ANALYTICAL LABORATORIES INC
120 RESEARCH DRIVE
STRATFORD, CT 06615

NY Lab Id No: 10854

is hereby APPROVED as an Environmental Laboratory in conformance with the National Environmental Laboratory Accreditation Conference Standards (2016) for the category ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:

Fuel Additives

Methyl tert-butyl ether	EPA 524.2
Naphthalene	EPA 524.2

Metals I

Arsenic, Total	EPA 200.8 Rev. 5.4
Barium, Total	EPA 200.7 Rev. 4.4
Cadmium, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Chromium, Total	EPA 200.7 Rev. 4.4
Copper, Total	EPA 200.7 Rev. 4.4
Iron, Total	EPA 200.7 Rev. 4.4
Lead, Total	EPA 200.8 Rev. 5.4
Manganese, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Mercury, Total	EPA 245.1 Rev. 3.0
Selenium, Total	EPA 200.8 Rev. 5.4
Silver, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Zinc, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4

Metals II

Aluminum, Total	EPA 200.7 Rev. 4.4
Antimony, Total	EPA 200.8 Rev. 5.4
Beryllium, Total	EPA 200.7 Rev. 4.4
Molybdenum, Total	EPA 200.8 Rev. 5.4
Nickel, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4

Serial No.: 68592

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/, by phone (518) 485-5570 or by email to elap@health.ny.gov.

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER

Expires 12:01 AM April 01, 2025
Issued April 01, 2024

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CATHERINE L. MOSHER
YORK ANALYTICAL LABORATORIES INC
120 RESEARCH DRIVE
STRATFORD, CT 06615

NY Lab Id No: 10854

is hereby APPROVED as an Environmental Laboratory in conformance with the National Environmental Laboratory Accreditation Conference Standards (2016) for the category ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:

Metals II

Thallium, Total	EPA 200.8 Rev. 5.4
Vanadium, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4

Metals III

Calcium, Total	EPA 200.7 Rev. 4.4
Magnesium, Total	EPA 200.7 Rev. 4.4
Potassium, Total	EPA 200.7 Rev. 4.4
Sodium, Total	EPA 200.7 Rev. 4.4

Miscellaneous

1,4-Dioxane	EPA 522
Turbidity	EPA 180.1 Rev. 2.0

Non-Metals

Alkalinity	SM 21-23 2320B (-97)
Calcium Hardness	EPA 200.7 Rev. 4.4
Chloride	EPA 300.0 Rev. 2.1
Color	SM 21-23 2120B (-01)
Fluoride, Total	EPA 300.0 Rev. 2.1
Orthophosphate (as P)	SM 19, 21-23 4500-P E (-99)
Solids, Total Dissolved	SM 21-23 2540C (-97)
Specific Conductance	EPA 120.1 Rev. 1982
Sulfate (as SO4)	EPA 300.0 Rev. 2.1

Volatile Aromatics

1,2,3-Trichlorobenzene	EPA 524.2
1,2,4-Trichlorobenzene	EPA 524.2
1,2,4-Trimethylbenzene	EPA 524.2
1,2-Dichlorobenzene	EPA 524.2

Serial No.: 68592

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/, by phone (518) 485-5570 or by email to elap@health.ny.gov.

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER

Expires 12:01 AM April 01, 2025
Issued April 01, 2024

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CATHERINE L. MOSHER
YORK ANALYTICAL LABORATORIES INC
120 RESEARCH DRIVE
STRATFORD, CT 06615

NY Lab Id No: 10854

is hereby APPROVED as an Environmental Laboratory in conformance with the National Environmental Laboratory Accreditation Conference Standards (2016) for the category ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:

Volatile Aromatics

1,3,5-Trimethylbenzene	EPA 524.2
1,3-Dichlorobenzene	EPA 524.2
1,4-Dichlorobenzene	EPA 524.2
2-Chlorotoluene	EPA 524.2
4-Chlorotoluene	EPA 524.2
Benzene	EPA 524.2
Bromobenzene	EPA 524.2
Chlorobenzene	EPA 524.2
Ethyl benzene	EPA 524.2
Hexachlorobutadiene	EPA 524.2
Isopropylbenzene	EPA 524.2
n-Butylbenzene	EPA 524.2
n-Propylbenzene	EPA 524.2
p-Isopropyltoluene (P-Cymene)	EPA 524.2
sec-Butylbenzene	EPA 524.2
Styrene	EPA 524.2
tert-Butylbenzene	EPA 524.2
Toluene	EPA 524.2
Total Xylenes	EPA 524.2

Volatile Halocarbons

1,1,1,2-Tetrachloroethane	EPA 524.2
1,1,1-Trichloroethane	EPA 524.2
1,1,2,2-Tetrachloroethane	EPA 524.2
1,1,2-Trichloroethane	EPA 524.2
1,1-Dichloroethane	EPA 524.2
1,1-Dichloroethene	EPA 524.2
1,1-Dichloropropene	EPA 524.2

Serial No.: 68592

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/, by phone (518) 485-5570 or by email to elap@health.ny.gov.

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER

Expires 12:01 AM April 01, 2025
Issued April 01, 2024

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CATHERINE L. MOSHER
YORK ANALYTICAL LABORATORIES INC
120 RESEARCH DRIVE
STRATFORD, CT 06615

NY Lab Id No: 10854

is hereby APPROVED as an Environmental Laboratory in conformance with the National Environmental Laboratory Accreditation Conference Standards (2016) for the category ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:

Volatile Halocarbons

1,2,3-Trichloropropane	EPA 524.2
1,2-Dichloroethane	EPA 524.2
1,2-Dichloropropane	EPA 524.2
1,3-Dichloropropane	EPA 524.2
2,2-Dichloropropane	EPA 524.2
Bromochloromethane	EPA 524.2
Bromomethane	EPA 524.2
Carbon tetrachloride	EPA 524.2
Chloroethane	EPA 524.2
Chloromethane	EPA 524.2
cis-1,2-Dichloroethene	EPA 524.2
cis-1,3-Dichloropropene	EPA 524.2
Dibromomethane	EPA 524.2
Dichlorodifluoromethane	EPA 524.2
Methylene chloride	EPA 524.2
Tetrachloroethene	EPA 524.2
trans-1,2-Dichloroethene	EPA 524.2
trans-1,3-Dichloropropene	EPA 524.2
Trichloroethene	EPA 524.2
Trichlorofluoromethane	EPA 524.2
Vinyl chloride	EPA 524.2

Serial No.: 68592

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/, by phone (518) 485-5570 or by email to elap@health.ny.gov.

APPENDIX C

Applicable vs Non-Applicable Outlet Inventory & Water Source Location Drawings

LANGAN

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
A1016	_	Laundry Room	Sink	N/A	_	_	
A1016	_	Laundry Room	Sink	N/A	_	_	
A1020	1	Room A006 Kitchen	Sink	App	ND	4/26/2024	
A1020	_	Room A006 Bathroom	Sink	N/A	_	_	
A1022	_	Janitor's Closet	Sink	N/A	_	_	
A1028	_	All Gender Bathroom	Sink	N/A	_	_	
A1030	_	All Gender Bathroom	Sink	N/A	_	_	
A2000	_	Faculty Bathroom	Sink	N/A	_	_	
A2004	_	Faculty Bathroom	Sink	N/A	_	_	
A2022	_	Boy's Bathroom	Sink	N/A	_	_	
A2022	_	Boy's Bathroom	Sink	N/A	_	_	
A2022	_	Hallway @ Boy's Bathroom	WF	N/A	_	_	turned off
A2030	_	Janitor's Closet	Sink	N/A	_	_	
A2033	_	Women's Faculty Bathroom	Sink	N/A	_	_	
A2001	2	Hallway @ Women's Faculty Bathroom	WF	App	ND	4/26/2024	
A2001	3	Hallway @ Women's Faculty Bathroom	BF	App	ND	4/26/2024	
A2035	_	Girl's Bathroom	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
A2035	_	Girl's Bathroom	Sink	N/A	_	_	
A2035	_	Girl's Bathroom	Sink	N/A	_	_	
A2039	4	Admin Office	BF	App	ND	4/26/2024	
A3002	_	Girl's Bathroom	Sink	N/A	_	_	
A3002	_	Girl's Bathroom	Sink	N/A	_	_	
A3001	5	Hallway @ Girl's Bathroom	WF	App	ND	4/26/2024	
A3001	6	Hallway @ Girl's Bathroom	BF	App	ND	4/26/2024	
A3004	_	Faculty Bathroom	Sink	N/A	_	_	
A3027	_	Faculty Bathroom	Sink	N/A	_	_	
A3031	_	Janitor's Closet	Sink	N/A	_	_	
A3034	_	Faculty Bathroom	Sink	N/A	_	_	
A3036	_	Boy's Bathroom	Sink	N/A	_	_	
A3036	_	Boy's Bathroom	Sink	N/A	_	_	
A3036	_	Hallway @ Boy's Bathroom	WF	N/A	_	_	turned off
B1003	7	Room B101	BF	App	ND	4/26/2024	
B1008	_	Boy's Bathroom	Sink	N/A	_	_	
B1008	_	Boy's Bathroom	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
B1002	8	Hallway @ Boy's Bathroom	WF	App	ND	4/26/2024	
B1002	9	Hallway @ Boy's Bathroom	BF	App	ND	4/26/2024	
B1010	_	Faculty Bathroom	Sink	N/A	_	_	
B1011	_	Women's Faculty Bathroom	Sink	N/A	_	_	
B1011	_	Women's Faculty Bathroom	Sink	N/A	_	_	
B1011	_	Women's Faculty Bathroom	Sink	N/A	_	_	
B1011	_	Women's Faculty Bathroom	Sink	N/A	_	_	
B1012	_	Janitor's Closet	Sink	N/A	_	_	
B1014	_	Serving Area - Slop Sink	Sink	N/A	_	_	
B1014	_	Serving Area - Hand Wash	Sink	N/A	_	_	
B1014	_	Serving Area - Hand Wash	Sink	N/A	_	_	
B1034	_	Faculty Bathroom	Sink	N/A	_	_	
B1036	_	Girl's Bathroom	Sink	N/A	_	_	
B1036	_	Girl's Bathroom	Sink	N/A	_	_	
B1036	_	Girl's Bathroom	Sink	N/A	_	_	
B1032	10	Hallway @ Girl's Bathroom	WF	App	ND	4/26/2024	
B1032	11	Hallway @ Girl's Bathroom	BF	App	ND	4/26/2024	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
B2007	_	Girl's Bathroom	Sink	N/A	_	_	
B2007	_	Girl's Bathroom	Sink	N/A	_	_	
B2007	_	Girl's Bathroom	Sink	N/A	_	_	
B2007	_	Girl's Bathroom	Sink	N/A	_	_	
B2009	_	Faculty Bathroom	Sink	N/A	_	_	
B2017	12	Hallway @ Faculty Bathroom	WF	App	ND	4/26/2024	
B2017	13	Hallway @ Faculty Bathroom	BF	App	ND	4/26/2024	
B2012	_	Janitor's Closet	Sink	N/A	_	_	
B2039	_	Faculty Bathroom	Sink	N/A	_	_	
B2041	_	Boy's Bathroom	Sink	N/A	_	_	
B2041	_	Boy's Bathroom	Sink	N/A	_	_	
B2041	_	Boy's Bathroom	Sink	N/A	_	_	
C1010	_	Janitor's Closet	Sink	N/A	_	_	
C1011	_	Faculty Bathroom	Sink	N/A	_	_	
C1013	_	Maintenance Garage	Sink	N/A	_	_	
C1013	_	Maintenance Garage	Sink	N/A	_	_	
C1013	_	Maintenance Garage	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
C1018	_	Room C002	Sink	N/A	_	_	
C1018	_	Room C002	Sink	N/A	_	_	
C1018	_	Room C002	Sink	N/A	_	_	
C1022	_	Faculty Bathroom	Sink	N/A	_	_	
C1024	_	Janitor's Closet	Sink	N/A	_	_	
C1025	_	Boy's Bathroom	Sink	N/A	_	_	
C1025	_	Boy's Bathroom	Sink	N/A	_	_	
C1025	_	Boy's Bathroom	Sink	N/A	_	_	
C1026	_	Room C001	Sink	N/A	_	_	
C1026	_	Room C001	Sink	N/A	_	_	
C1026	_	Room C001	Sink	N/A	_	_	
C1026	_	Room C001	Sink	N/A	_	_	
C1026	_	Room C001	Sink	N/A	_	_	
C1026	_	Room C001	Sink	N/A	_	_	
C1026	_	Room C001	Sink	N/A	_	_	
C1026	_	Room C001	Sink	N/A	_	_	
C1026	_	Room C001	Sink	N/A	_	_	
C1027	14	Room C001A	BF	App	ND	4/26/2024	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
C1032	_	Room C009	Sink	N/A	_	_	
C1032	_	Room C009	Sink	N/A	_	_	
C1032	_	Room C009	Sink	N/A	_	_	
C1032	_	Room C009	Sink	N/A	_	_	
C1033	15	Hallway @ Room C007	WF	App	ND	4/26/2024	
C1033	16	Hallway @ Room C007	BF	App	ND	4/26/2024	
C1033	_	Hallway @ Room C007	WF	N/A	_	_	turned off
C1034	_	Room C008	Sink	N/A	_	_	
C1034	_	Room C008	Sink	N/A	_	_	
C1034	_	Room C008	Sink	N/A	_	_	
C1034	_	Room C008	Sink	N/A	_	_	
C1035	_	Room C010 Dark Room	Sink	N/A	_	_	
C1035	_	Room C010 Dark Room	Sink	N/A	_	_	
C1036	_	Room C010	Sink	N/A	_	_	
C1036	_	Room C010	Sink	N/A	_	_	
C1036	_	Room C010	Sink	N/A	_	_	
C1036	_	Room C010	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
C1037	_	Room C011	Sink	N/A	_	_	
C1037	_	Room C011	Sink	N/A	_	_	
C1037	_	Room C011	Sink	N/A	_	_	
C1037	_	Room C011	Sink	N/A	_	_	
C1040	_	Room C015	Sink	N/A	_	_	
C1040	_	Room C015B	Sink	N/A	_	_	
C1033	17	Hallway @ Room C015B	WF	App	ND	4/26/2024	
C1033	18	Hallway @ Room C015B	BF	App	ND	4/26/2024	
C1033	_	Hallway @ Room C015B	WF	N/A	_	_	turned off
C1041	_	Room C014	Sink	N/A	_	_	
C1041	_	Room C014	Sink	N/A	_	_	
C1041	_	Room C014	Sink	N/A	_	_	
C1041	_	Room C014	Sink	N/A	_	_	
C1045	_	Girl's Bathroom	Sink	N/A	_	_	
C1045	_	Girl's Bathroom	Sink	N/A	_	_	
C1045	_	Girl's Bathroom	Sink	N/A	_	_	
C1046	_	Janitor's Closet	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
C1047	_	All Gender Student Bathroom	Sink	N/A	_	_	
C1055	_	Faculty Room Bathroom	Sink	N/A	_	_	
C2005	19	Room C141	BF	App	ND	4/26/2024	
C2028	_	Main Office Pantry	Sink	N/A	_	_	
C2028	69	Main Office Pantry	BF	App	ND	4/26/2024	
C2029	_	Faculty Bathroom	Sink	N/A	_	_	
C2030	_	Faculty Bathroom	Sink	N/A	_	_	
C2030	_	Hallway @ Faculty Bathroom	WF	N/A	_	_	turned off
C2030	_	Hallway @ Faculty Bathroom	WF	N/A	_	_	turned off
C2031	_	Faculty Bathroom	Sink	N/A	_	_	
C2031	_	Hallway @ Faculty Bathroom	WF	N/A	_	_	turned off
C2031	_	Hallway @ Faculty Bathroom	WF	N/A	_	_	turned off
C2032	_	Faculty Bathroom	Sink	N/A	_	_	
C2035	_	Janitor's Closet	Sink	N/A	_	_	
C2058	20	Library	BF	App	ND	4/26/2024	
C2066	_	Faculty Room	Sink	N/A	_	_	
C2067	_	Library Bathroom	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
C2059	21	Hallway @ Library Bathroom	WF	App	ND	4/26/2024	
C2072	_	Room C121	Sink	N/A	_	_	
C2072	_	Room C121	Sink	N/A	_	_	
C2072	_	Room C121	Sink	N/A	_	_	
C2072	_	Room C121	Sink	N/A	_	_	
C2072	_	Room C121	Sink	N/A	_	_	
C2072	_	Room C121	Sink	N/A	_	_	
C2073	_	Room C119 Prep Room	Sink	N/A	_	_	
C2074	_	Room C119	Sink	N/A	_	_	
C2074	_	Room C119	Sink	N/A	_	_	
C2074	_	Room C119	Sink	N/A	_	_	
C2074	_	Room C119	Sink	N/A	_	_	
C2074	_	Room C119	Sink	N/A	_	_	
C2074	_	Room C119	Sink	N/A	_	_	
C2074	_	Room C119	Sink	N/A	_	_	
C2074	_	Room C119	Sink	N/A	_	_	
C2074	_	Room C119	Sink	N/A	_	_	
C2077	_	Janitor's Closet	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
C2078	_	Room C117	Sink	N/A	_	_	
C2078	_	Room C117	Sink	N/A	_	_	
C2078	_	Room C117	Sink	N/A	_	_	
C2078	_	Room C117	Sink	N/A	_	_	
C2078	_	Room C117	Sink	N/A	_	_	
C2078	_	Room C117	Sink	N/A	_	_	
C2078	_	Room C117	Sink	N/A	_	_	
C2078	_	Room C117	Sink	N/A	_	_	
C2080	_	Room C112 Prep Room	Sink	N/A	_	_	
C2081	_	Room C112	Sink	N/A	_	_	
C2081	_	Room C112	Sink	N/A	_	_	
C2081	_	Room C112	Sink	N/A	_	_	
C2081	_	Room C112	Sink	N/A	_	_	
C2081	_	Room C112	Sink	N/A	_	_	
C2081	_	Room C112	Sink	N/A	_	_	
C2082	_	Faculty Bathroom	Sink	N/A	_	_	
C2084	_	Janitor's Closet	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
C2085	_	Boy's Bathroom	Sink	N/A	_	_	
C2085	_	Boy's Bathroom	Sink	N/A	_	_	
C2085	_	Boy's Bathroom	Sink	N/A	_	_	
C2086	24	Hallway @ Room C102	WF	App	ND	4/26/2024	
C2086	25	Hallway @ Room C102	BF	App	ND	4/26/2024	
C2086	_	Hallway @ Room C102	WF	N/A	_	_	turned off
C2086	22	Hallway @ Room C110	WF	App	ND	4/26/2024	
C2086	23	Hallway @ Room C110	BF	App	ND	4/26/2024	
C2086	_	Hallway @ Room C110	WF	N/A	_	_	turned off
C2087	_	Room C110	Sink	N/A	_	_	
C2088	_	Room C111	Sink	N/A	_	_	
C2088	_	Room C111	Sink	N/A	_	_	
C2088	_	Room C111	Sink	N/A	_	_	
C2088	_	Room C111	Sink	N/A	_	_	
C2092	_	Room C107	Sink	N/A	_	_	
C2092	_	Room C107	Sink	N/A	_	_	
C2092	_	Room C107	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
C2092	_	Room C107	Sink	N/A	_	_	
C2092	_	Room C107 Prep Room	Sink	N/A	_	_	turned off
C2094	_	Room C103	Sink	N/A	_	_	
C2101	26	Room C151	Sink	App	ND	4/26/2024	Left
C2101	27	Room C151	Sink	App	ND	4/26/2024	Right
C2104	_	Girl's Bathroom	Sink	N/A	_	_	
C2105	_	Janitor's Closet	Sink	N/A	_	_	
C2106	_	Women's Faculty Bathroom	Sink	N/A	_	_	
C2106	_	Women's Faculty Bathroom	Sink	N/A	_	_	
D1021	_	Janitor's Closet	Sink	N/A	_	_	
D1022	_	Faculty Bathroom	Sink	N/A	_	_	
D2002	28	Hallway @ Faculty Bathroom	WF	App	ND	4/26/2024	
D2003	_	Room D117	Sink	N/A	_	_	
D2006	_	Faculty Bathroom	Sink	N/A	_	_	
E1002	_	Boy's Bathroom	Sink	N/A	_	_	
E1003	_	Office E003 Bathroom	Sink	N/A	_	_	
E1005	_	Janitor's Closet	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
E1007	29	Hallway @ Janitor's Closet	WF	App	ND	4/26/2024	
E1007	30	Hallway @ Janitor's Closet	BF	App	ND	4/26/2024	
E1009	_	Laundry Room	Sink	N/A	_	_	
E1021	_	Boy's Locker Room Bathroom	Sink	N/A	_	_	
E1021	_	Boy's Locker Room Bathroom	Sink	N/A	_	_	
E1021	_	Boy's Locker Room Bathroom	Sink	N/A	_	_	
E1021	_	Boy's Locker Room Bathroom Janitor's Closet	Sink	N/A	_	_	
E1022	_	Boy's Pool Locker Room	Sink	N/A	_	_	
E1022	_	Boy's Pool Locker Room	Sink	N/A	_	_	
E1022	_	Boy's Pool Locker Room	Sink	N/A	_	_	
E1022	_	Boy's Pool Locker Room Janitor's Closet	Sink	N/A	_	_	
E1023	_	Girl's Pool Locker Room	Sink	N/A	_	_	
E1023	_	Girl's Pool Locker Room	Sink	N/A	_	_	
E1023	_	Girl's Pool Locker Room	Sink	N/A	_	_	
E1023	_	Girl's Pool Locker Room Janitor's Closet	Sink	N/A	_	_	
E1024A	_	Auxiliary Locker Room	Sink	N/A	_	_	
E1024B	_	Auxiliary Locker Room	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
E1024C	31	Auxiliary Locker Room Hallway	WF	App	30.6	4/26/2024	
E1024D	_	Auxiliary Locker Room	Sink	N/A	_	_	
E1025	_	Girl's Locker Room Janitor's Closet	Sink	N/A	_	_	
E1025	_	Girl's Locker Room Janitor's Closet	Sink	N/A	_	_	
E1025	_	Girl's Locker Room Janitor's Closet	Sink	N/A	_	_	
E1026	_	Girl's Locker Room Bathroom	Sink	N/A	_	_	
E1026	_	Girl's Locker Room Bathroom	Sink	N/A	_	_	
E1026	_	Girl's Locker Room Bathroom	Sink	N/A	_	_	
E1029	32	Hallway @ Girl's Locker Room	WF	App	ND	4/26/2024	
E1029	33	Hallway @ Girl's Locker Room	BF	App	ND	4/26/2024	
E2000	34	North Gym Lobby/Stairwell Landing	WF	App	3.9	4/26/2024	
E2001	35	North Gym Lobby/Stairwell Landing	WF	App	2.66	4/26/2024	
E2002	36	Hallway to North Gym Mechanical Room	IM	App	ND	4/26/2024	
E2002	_	Hallway to North Gym Mechanical Room	Sink	N/A	_	_	
E2006	_	North Gym Lobby/Stairwell Landing	WF	N/A	_	_	turned off
E2012	_	PE Office E108 Bathroom	Sink	N/A	_	_	
E2013	_	Boy's Locker Room Bathroom	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
E2013	_	Boy's Locker Room Bathroom	Sink	N/A	_	_	
E2013	_	Boy's Locker Room Janitor's Closet	Sink	N/A	_	_	
E2015	_	Boy's PE Office Bathroom	Sink	N/A	_	_	
E2016	38	Hallway @ Pool Building Breezeway	WF	App	ND	4/26/2024	
E2016	39	Hallway @ Pool Building Breezeway	BF	App	ND	4/26/2024	
E2019	_	Girl's PE Office Bathroom	Sink	N/A	_	_	
E2020	_	Girl's Locker Room Bathroom	Sink	N/A	_	_	next to space E2019
E2020	_	Girl's Locker Room Janitor's Closet	Sink	N/A	_	_	
E2020	_	Girl's Locker Room Bathroom	Sink	N/A	_	_	next to Janitor's Closet
E2022	_	Pe Office Bathroom	Sink	N/A	_	_	
E2023	_	South Gym Lobby/Stairwell Landing	WF	N/A	_	_	Out of Order
E2027	_	South Gym Lobby/Stairwell Landing	WF	N/A	_	_	turned off
E2027	_	South Gym Lobby/Stairwell Landing	WF	N/A	_	_	turned off
E3000	42	Trainer's Room	IM	App	ND	4/26/2024	hallway adjacent to North gym, ground floor level
E3000A	_	Faculty Bathroom	Sink	N/A	_	_	hallway adjacent to North gym, ground floor level
E3000A	_	Faculty Bathroom	Sink	N/A	_	_	hallway adjacent to North gym, ground floor level
E3002	43	Nurse's Office	BF	App	1.47	4/26/2024	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
E3002	_	Nurse's - Girl's Bathroom	Sink	N/A	_	_	
E3002	_	Nurse's Exam Room	Sink	N/A	_	_	
E3002	_	Nurse's - Boy's Bathroom	Sink	N/A	_	_	
E3004	_	Janitor's Closet	Sink	N/A	_	_	
E3006	_	Boy's Bathroom	Sink	N/A	_	_	
E3001	44	Hallway @ Boy's Bathroom	WF	App	ND	4/26/2024	
E3001	45	Hallway @ Boy's Bathroom	BF	App	ND	4/26/2024	
E3009	_	Girl's Bathroom	Sink	N/A	_	_	
E3009	_	Girl's Bathroom	Sink	N/A	_	_	
E3012	46	Hallway @ Girl's Bathroom	WF	App	ND	4/26/2024	
E3012	47	Hallway @ Girl's Bathroom	BF	App	ND	4/26/2024	
E3017	_	Boy's PE Office Bathroom	Sink	N/A	_	_	
E3018	_	Boy's Locker Room Bathroom	Sink	N/A	_	_	next to space E3019
E3018	_	Boy's Locker Room Bathroom	Sink	N/A	_	_	next to space E3017
E3019	_	Boy's PE Office Bathroom	Sink	N/A	_	_	
E3020	_	Girl's PE Office Bathroom	Sink	N/A	_	_	
E3021	_	Girl's Locker Room Bathroom	Sink	N/A	_	_	next to space E3022

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
E3021	_	Girl's Locker Room Bathroom	Sink	N/A	_	_	next to space E3020
E3022	_	Girl's PE Office Bathroom	Sink	N/A	_	_	
F2001	48	Poolside @ Locker Rooms	WF	App	ND	4/26/2024	
F2001	49	Poolside @ Locker Rooms	BF	App	ND	4/26/2024	
F2003	_	Poolside Janitor's Closet	Sink	N/A	_	_	
G1003	_	Boy's Bathroom	Sink	N/A	_	_	
G1003	_	Boy's Bathroom	Sink	N/A	_	_	
G1003	_	Boy's Bathroom	Sink	N/A	_	_	
G1005	_	Girl's Bathroom	Sink	N/A	_	_	
G1005	_	Girl's Bathroom	Sink	N/A	_	_	
G1005	_	Girl's Bathroom	Sink	N/A	_	_	
G1001	50	Hallway @ Girl's Bathroom	WF	App	ND	4/26/2024	left
G1001	51	Hallway @ Girl's Bathroom	BF	App	ND	4/26/2024	left
G1001	52	Hallway @ Girl's Bathroom	WF	App	ND	4/26/2024	right
G1001	53	Hallway @ Girl's Bathroom	BF	App	ND	4/26/2024	right
G1007	_	Janitor's Closet	Sink	N/A	_	_	
G1010	_	Room G009	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
G1010	_	Room G009	Sink	N/A	_	_	
G1010	_	Room G009	Sink	N/A	_	_	
G1010	_	Room G009	Sink	N/A	_	_	
G1010	_	Room G009	Sink	N/A	_	_	
G1010	_	Room G009	Sink	N/A	_	_	
G1010	_	Room G009	Sink	N/A	_	_	
G1010	_	Room G009	Sink	N/A	_	_	
G1011	_	Room G007	Sink	N/A	_	_	
G1011	_	Room G007	Sink	N/A	_	_	
G1011	_	Room G007	Sink	N/A	_	_	
G1011	_	Room G007	Sink	N/A	_	_	
G1011	_	Room G007	Sink	N/A	_	_	
G1011	_	Room G007	Sink	N/A	_	_	
G1011	_	Room G007	Sink	N/A	_	_	
G1011	_	Room G007	Sink	N/A	_	_	
G1012	_	Room G008	Sink	N/A	_	_	
G1012	_	Room G008	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
G1012	_	Room G008	Sink	N/A	_	_	
G1012	_	Room G008	Sink	N/A	_	_	
G1012	_	Room G008	Sink	N/A	_	_	
G1012	_	Room G008	Sink	N/A	_	_	
G1012	_	Room G008	Sink	N/A	_	_	
G1012	_	Room G008	Sink	N/A	_	_	
G1014	_	Room G006A	Sink	N/A	_	_	
G1016	_	Room G005	Sink	N/A	_	_	
G1016	_	Room G005	Sink	N/A	_	_	
G1016	_	Room G005	Sink	N/A	_	_	
G1016	_	Room G005	Sink	N/A	_	_	
G1016	_	Room G005	Sink	N/A	_	_	
G1016	_	Room G005	Sink	N/A	_	_	
G1016	_	Room G005	Sink	N/A	_	_	
G1016	_	Room G005	Sink	N/A	_	_	
G1016	_	Room G005	Sink	N/A	_	_	
G1017	_	Room G004	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
G1017	_	Room G004	Sink	N/A	_	_	
G1017	_	Room G004	Sink	N/A	_	_	
G1017	_	Room G004	Sink	N/A	_	_	
G1017	_	Room G004	Sink	N/A	_	_	
G1017	_	Room G004	Sink	N/A	_	_	
G1017	_	Room G004	Sink	N/A	_	_	
G1017	_	Room G004	Sink	N/A	_	_	
G1018	_	Room G003	Sink	N/A	_	_	
G1018	_	Room G003	Sink	N/A	_	_	
G1018	_	Room G003	Sink	N/A	_	_	
G1018	_	Room G003	Sink	N/A	_	_	
G1018	_	Room G003	Sink	N/A	_	_	
G1018	_	Room G003	Sink	N/A	_	_	
G1018	_	Room G003	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
G1018	_	Room G003	Sink	N/A	_	_	
G1019	_	Room G001	Sink	N/A	_	_	
G1019	_	Room G001	Sink	N/A	_	_	
G1019	_	Room G001	Sink	N/A	_	_	
G1019	_	Room G001	Sink	N/A	_	_	
G1019	_	Room G001	Sink	N/A	_	_	
G1019	_	Room G001	Sink	N/A	_	_	
G1021	_	Janitor's Closet	Sink	N/A	_	_	
G2001	_	Hall @ Faculty Bathrooms	WF	N/A	_	_	left, turned off
G2001	_	Hall @ Faculty Bathrooms	WF	N/A	_	_	right, turned off
G2004	_	Men's Faculty Bathroom	Sink	N/A	_	_	
G2004	_	Men's Faculty Bathroom	Sink	N/A	_	_	
G2004	_	Men's Faculty Bathroom	Sink	N/A	_	_	
G2005	_	Women's Faculty Bathroom	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
G2005	_	Women's Faculty Bathroom	Sink	N/A	_	_	
G2005	_	Women's Faculty Bathroom	Sink	N/A	_	_	
G2006	_	Girl's Bathroom	Sink	N/A	_	_	
G2006	_	Girl's Bathroom	Sink	N/A	_	_	
G2006	_	Girl's Bathroom	Sink	N/A	_	_	
G2011	_	Janitor's Closet	Sink	N/A	_	_	
G2014	_	Room G113	Sink	N/A	_	_	
G2014	_	Room G113	Sink	N/A	_	_	
G2014	_	Room G113	Sink	N/A	_	_	
G2014	_	Room G113	Sink	N/A	_	_	
G2014	_	Room G113	Sink	N/A	_	_	
G2014	_	Room G113	Sink	N/A	_	_	
G2014	_	Room G113	Sink	N/A	_	_	
G2014	_	Room G113	Sink	N/A	_	_	
G2014	_	Room G113	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
G2015	_	Room G111	Sink	N/A	_	_	
G2015	_	Room G111	Sink	N/A	_	_	
G2015	_	Room G111	Sink	N/A	_	_	
G2015	_	Room G111	Sink	N/A	_	_	
G2015	_	Room G111	Sink	N/A	_	_	
G2015	_	Room G111	Sink	N/A	_	_	
G2015	_	Room G111	Sink	N/A	_	_	
G2015	_	Room G111	Sink	N/A	_	_	
G2016	_	Room G112	Sink	N/A	_	_	
G2016	_	Room G112	Sink	N/A	_	_	
G2016	_	Room G112	Sink	N/A	_	_	
G2016	_	Room G112	Sink	N/A	_	_	
G2016	_	Room G112	Sink	N/A	_	_	
G2016	_	Room G112	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
G2016	_	Room G112	Sink	N/A	_	_	
G2016	_	Room G112	Sink	N/A	_	_	
G2018	_	Room G110A	Sink	N/A	_	_	
G2020	_	Room G108	Sink	N/A	_	_	
G2020	_	Room G108	Sink	N/A	_	_	
G2020	_	Room G108	Sink	N/A	_	_	
G2020	_	Room G108	Sink	N/A	_	_	
G2020	_	Room G108	Sink	N/A	_	_	
G2020	_	Room G108	Sink	N/A	_	_	
G2020	_	Room G108	Sink	N/A	_	_	
G2020	_	Room G108	Sink	N/A	_	_	
G2020	_	Room G108	Sink	N/A	_	_	
G2021	_	Room G109	Sink	N/A	_	_	
G2021	_	Room G109	Sink	N/A	_	_	
G2021	_	Room G109	Sink	N/A	_	_	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
G2021	_	Room G109	Sink	N/A	_	_	
G2021	_	Room G109	Sink	N/A	_	_	
G2021	_	Room G109	Sink	N/A	_	_	
G2021	_	Room G109	Sink	N/A	_	_	
G2021	_	Room G109	Sink	N/A	_	_	
G2022	_	Room G107	Sink	N/A	_	_	
G2022	_	Room G107	Sink	N/A	_	_	
G2022	_	Room G107	Sink	N/A	_	_	
G2022	_	Room G107	Sink	N/A	_	_	
G2022	_	Room G107	Sink	N/A	_	_	
G2022	_	Room G107	Sink	N/A	_	_	
G2022	_	Room G107	Sink	N/A	_	_	
G2022	_	Room G107	Sink	N/A	_	_	
G2024	_	Room G106	Sink	N/A	_	_	


Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
G2024	_	Room G106	Sink	N/A	_	_	
G2024	_	Room G106	Sink	N/A	_	_	
G2024	_	Room G106	Sink	N/A	_	_	
G2024	_	Room G106	Sink	N/A	_	_	
G2024	_	Room G106	Sink	N/A	_	_	
G2024	_	Room G106	Sink	N/A	_	_	
G2024	_	Room G106	Sink	N/A	_	_	
H1004	_	Cafeteria Serving Area - Dish Wash	Sink	N/A	_	_	
H1004	_	Cafeteria Serving Area - Dish Wash	Sink	N/A	_	_	
H1004	_	Cafeteria Serving Area - Hand Wash	Sink	N/A	_	_	
H1004	_	Cafeteria Serving Area - Hand Wash	Sink	N/A	_	_	
H1004A	_	Janitor's Closet	Sink	N/A	_	_	
H1004B	54	Cafeteria	WF	App	ND	4/26/2024	left
H1004B	55	Cafeteria	WF	App	ND	4/26/2024	right

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
H1004B	56	Cafeteria	BF	App	ND	4/26/2024	
H1004B	_	Faculty Bathroom	Sink	N/A	_	_	
H1004B	_	Faculty Bathroom	Sink	N/A	_	_	
H1004B	_	Faculty Bathroom	Sink	N/A	_	_	
H1004C	_	Girl's Bathroom	Sink	N/A	_	_	
H1004C	_	Girl's Bathroom	Sink	N/A	_	_	
H1004C	_	Girl's Bathroom	Sink	N/A	_	_	
H1004D	_	Janitor's Closet	Sink	N/A	_	_	
H1004E	_	Boy's Bathroom	Sink	N/A	_	_	
H1004E	_	Boy's Bathroom	Sink	N/A	_	_	
H1004E	_	Boy's Bathroom	Sink	N/A	_	_	
H1006	_	Kitchen - Dish Wash	Sink	N/A	_	_	rear of kitchen (to right when entering from serving station room)
H1006	_	Kitchen - Dish Wash	Sink	N/A	_	_	rear of kitchen (to right when entering from serving station room)
H1006	_	Kitchen - Sprayer	SPY	N/A	_	_	rear of kitchen (to right when entering from serving station room)

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
H1006	57	Kitchen - Food Prep	Sink	App	1.85	4/26/2024	rear of kitchen (to right when entering from serving station room)
H1006	_	Kitchen - Hand Wash	Sink	N/A	_	_	rear of kitchen (to right when entering from serving station room)
H1006	58	Kitchen - Pasta Filler	Sink	App	ND	4/26/2024	rear of kitchen (to right when entering from serving station room)
H1006	59	Kitchen - Fryer Filler	SPY	App	1.37	4/26/2024	left fryer. rear of kitchen (to right when entering from serving station room)
H1006	60	Kitchen - Fryer Filler	SPY	App	ND	4/26/2024	left fryer. rear of kitchen (to right when entering from serving station room)
H1006	_	Kitchen - Hand Wash	Sink	N/A	_	_	front of kitchen (space directly adjacent to serving station room)
H1006	61	Kitchen - Food Prep	Sink	App	ND	4/26/2024	rear faucet (further away from serving station room). front of kitchen (space directly adjacent to serving station room)
H1006	62	Kitchen - Food Prep	Sink	App	ND	4/26/2024	front facuet (closer to serving station room). front of kitchen (space directly adjacent to serving station room)
H1017	_	Janitor's Closet	Sink	N/A	_	_	
H1020	_	Kitchen Bathroom	Sink	N/A	_	_	
Athletic Bleachers	–	Boy's Bathroom	Sink	N/A	_	_	
Athletic Bleachers	–	Girl's Bathroom	Sink	N/A	_	_	
Field House	–	North End - Men's Exterior Gang Bathroom	Sink	N/A	_	_	
Field House	–	North End - Men's Exterior Gang Bathroom	Sink	N/A	_	_	


Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
Field House	–	North End - Men's Exterior Gang Bathroom	Sink	N/A	–	–	
Field House	–	North End - Men's Exterior Single Bathroom	Sink	N/A	–	–	
Field House	–	North End - Exterior Water Fountain	WF	N/A	–	–	turned off
Field House	–	North Locker Room - Bathrooms	Sink	N/A	–	–	
Field House	–	North Locker Room - Bathrooms	Sink	N/A	–	–	
Field House	–	North Locker Room - Bathrooms	Sink	N/A	–	–	
Field House	–	North Locker Room	WF	N/A	–	–	turned off
Field House	–	Hall between North & South Locker Rooms - Bathroom	Sink	N/A	–	–	
Field House	–	Hall between North & South Locker Rooms - Bathroom	Sink	N/A	–	–	
Field House	–	Hall between North & South Locker Rooms	WF	N/A	–	–	turned off
Field House	–	Hall between North & South Locker Rooms - Bathroom	Sink	N/A	–	–	
Field House	–	Hall between North & South Locker Rooms - Bathroom	Sink	N/A	–	–	
Field House	66	South Locker Room	WF	App	5.24	4/26/2024	
Field House	–	Mechanical Room	Sink	N/A	–	–	

Space #	Sample #	Sample Location	Fixture Type	App or N/A	Latest 1st Draw Results (ppb)	Latest 1st Draw Sampling Date	Remarks
Field House	–	South End - Women's Exterior Gang Bathroom	Sink	N/A	–	–	
Field House	–	South End - Women's Exterior Gang Bathroom	Sink	N/A	–	–	
Field House	–	South End - Women's Exterior Gang Bathroom	Sink	N/A	–	–	
Field House	67	Garage	IM	App	ND	4/26/2024	
Field House	68	Garage	Sink	App	1.28	4/26/2024	
Field House	70	Garage	Hose	App	ND	4/26/2024	

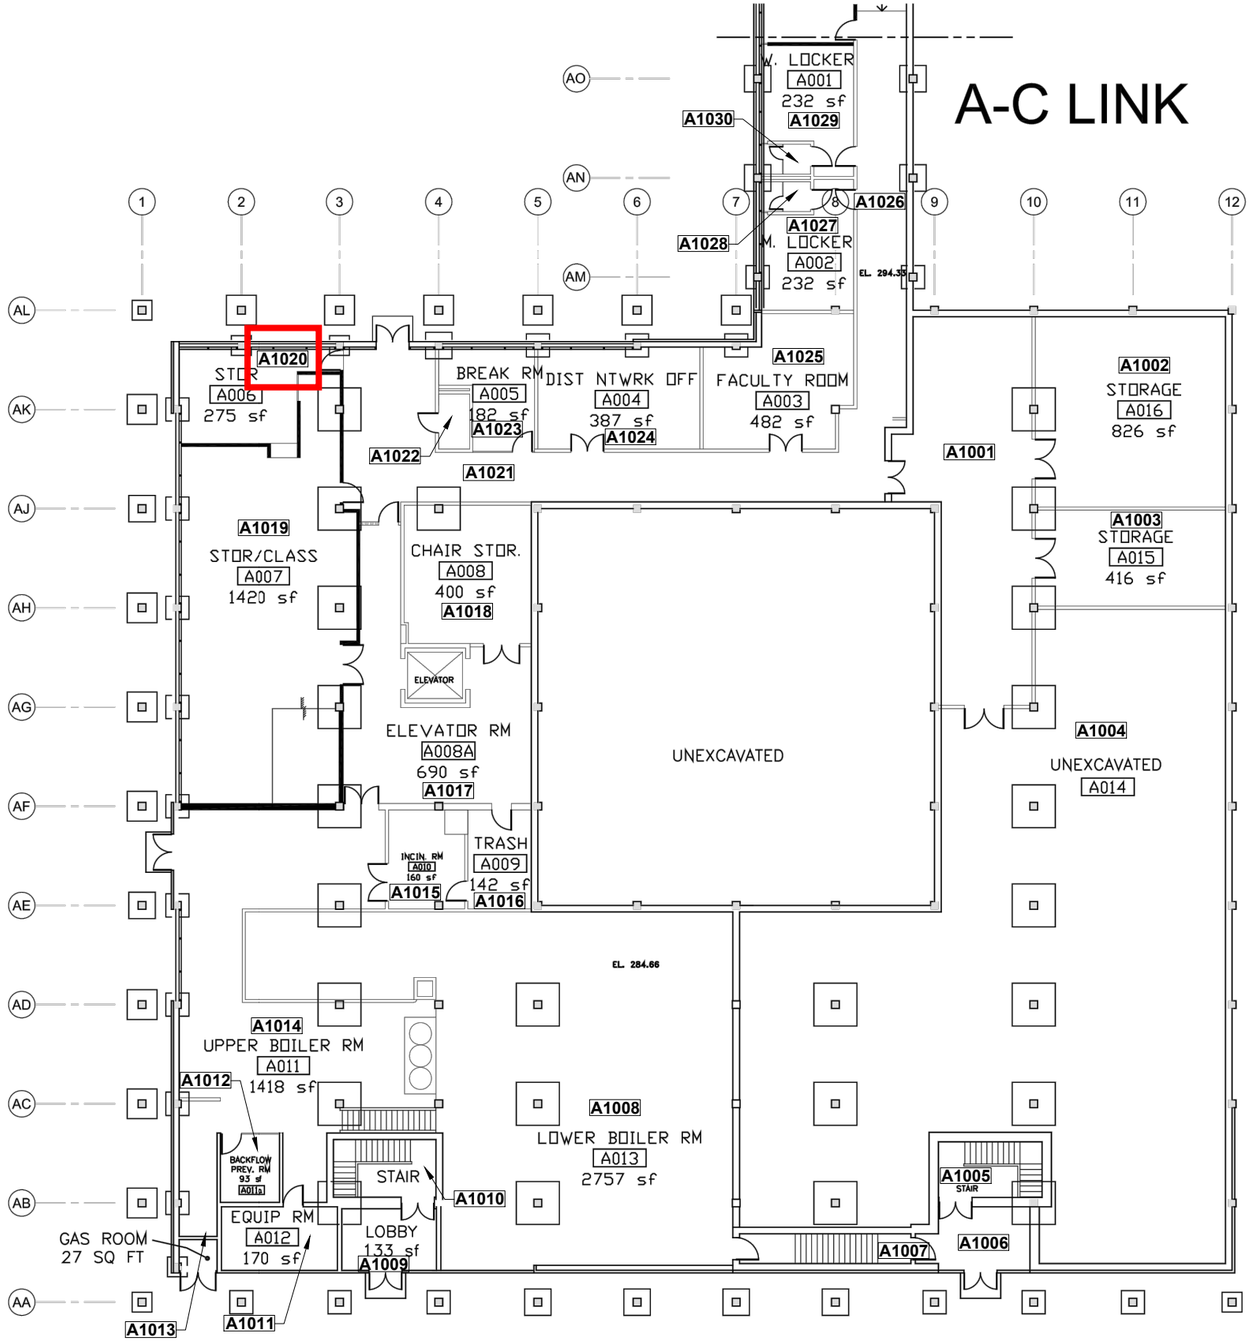

1 BUILDING A - GROUND FLOOR PARTIAL PLAN

SCALE: NTS

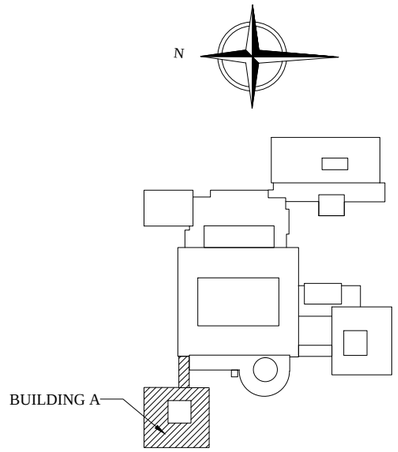

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING A
GROUND FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-001
Drawn by:	1 of 18
Checked by:	

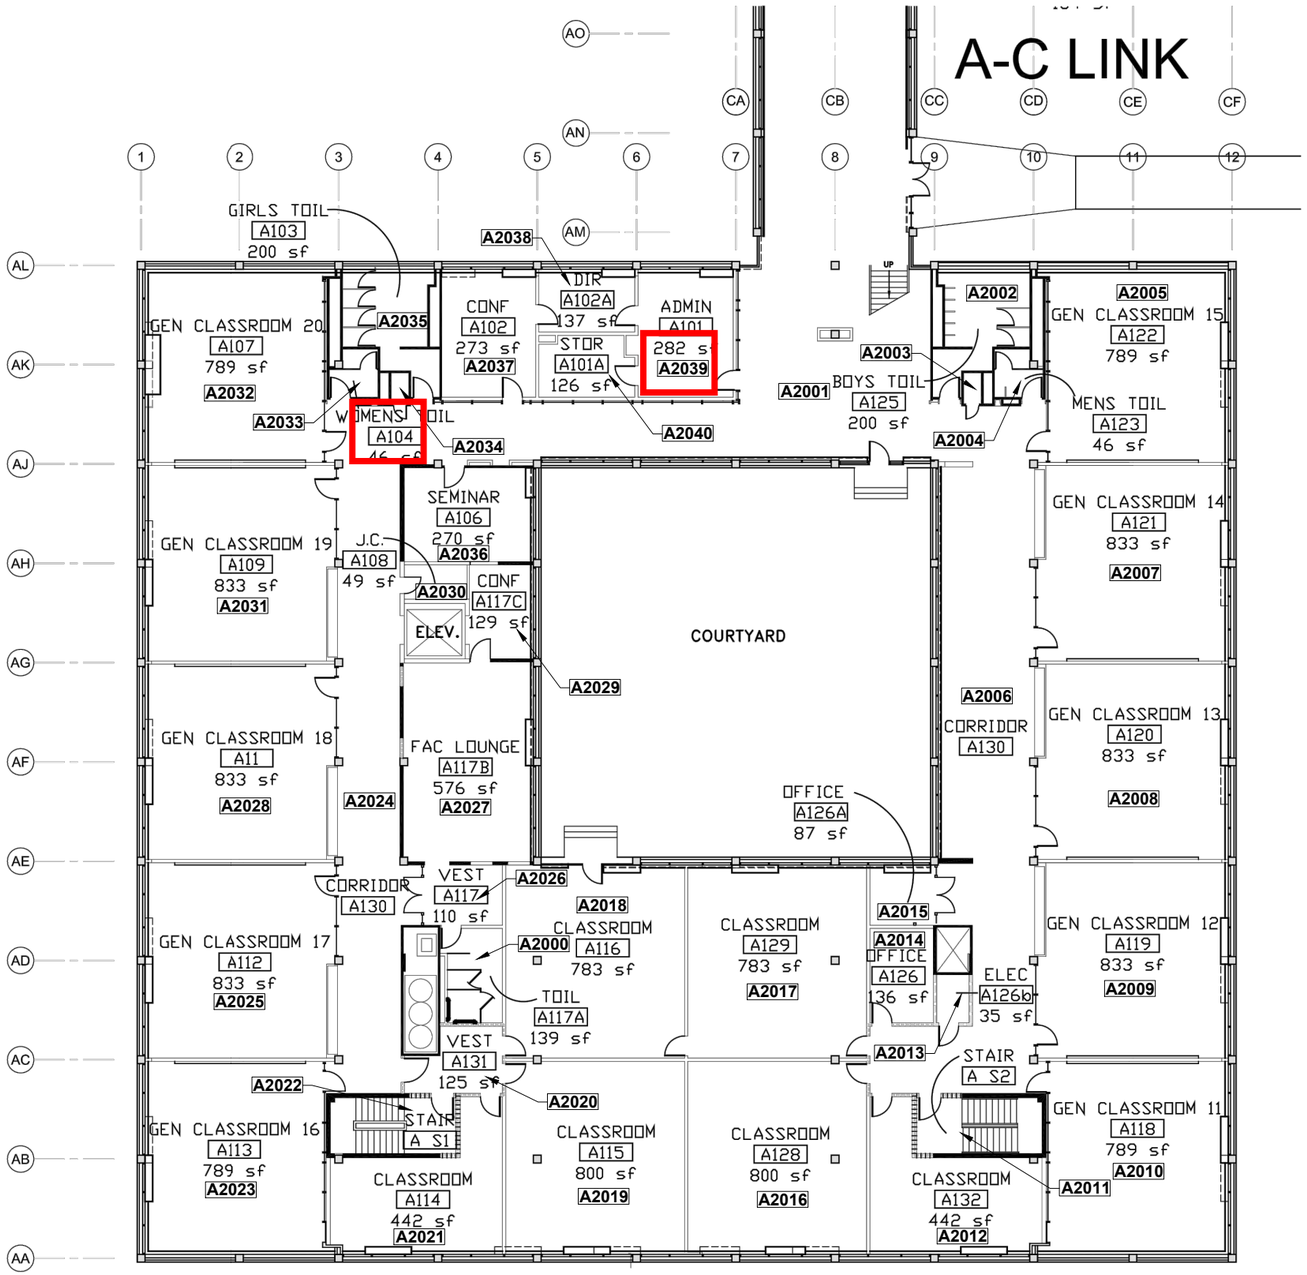

1 BUILDING A - FIRST FLOOR PARTIAL PLAN

SCALE: NTS

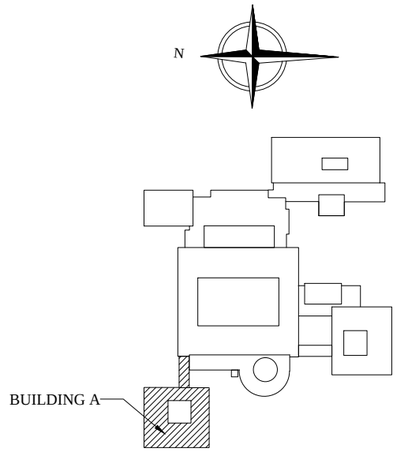

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING A
FIRST FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-002
Drawn by:	2 of 18
Checked by:	

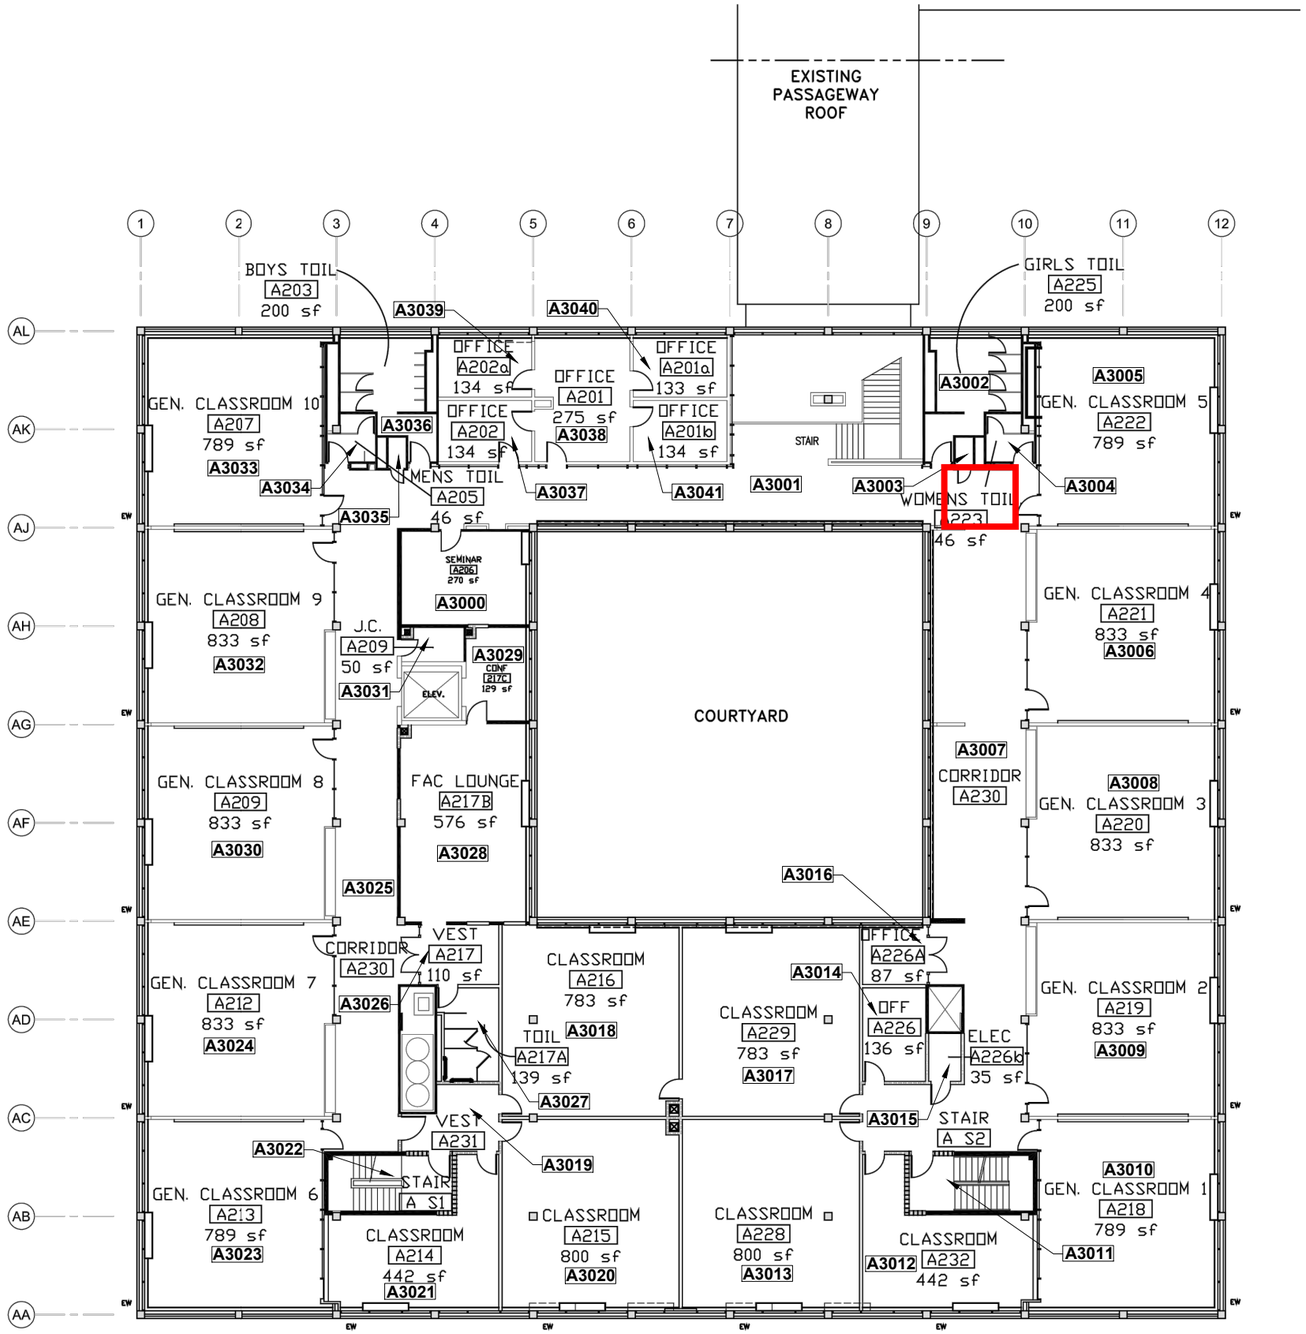

1 BUILDING A - SECOND FLOOR PARTIAL PLAN

SCALE: NTS

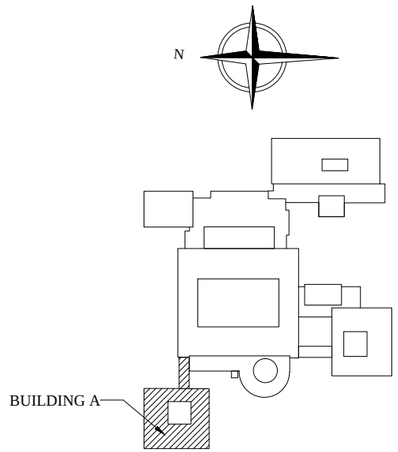

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING A
SECOND FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-003
Drawn by:	3 of 18
Checked by:	

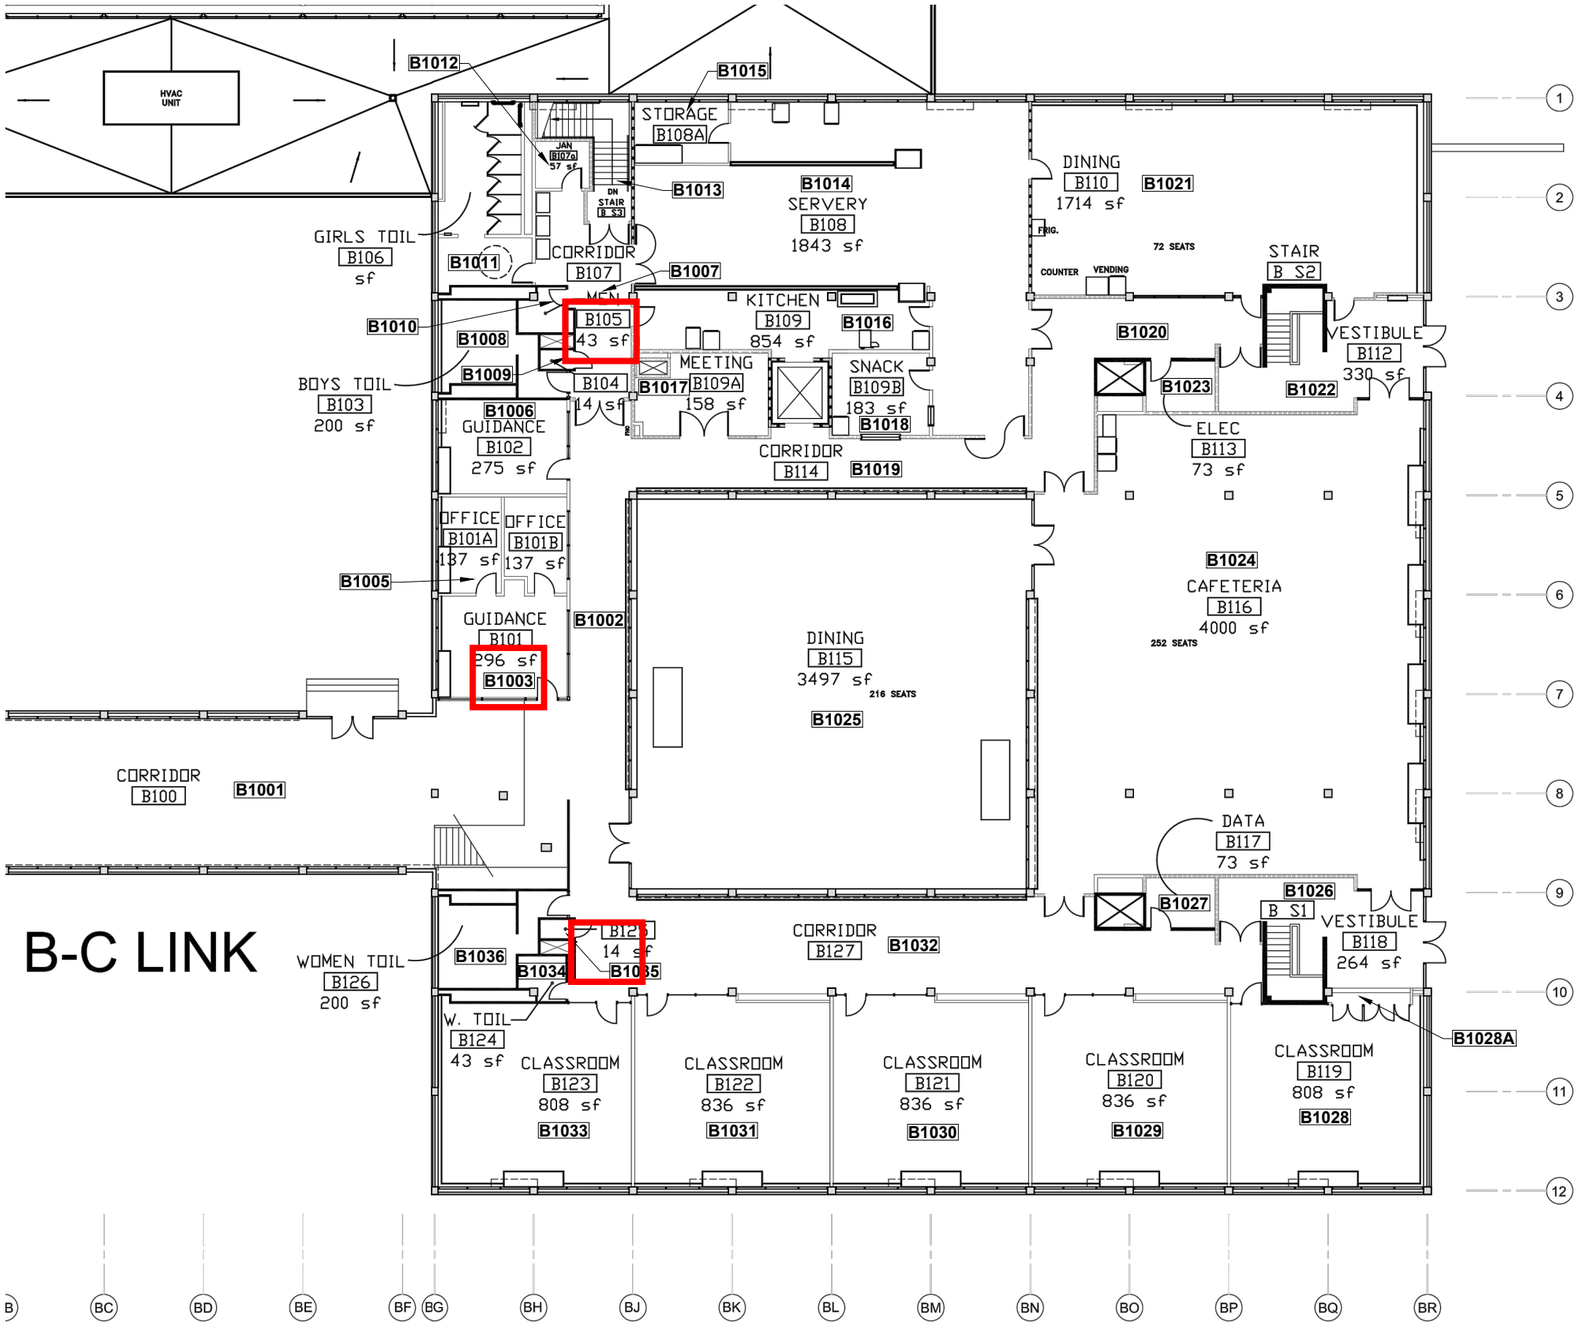

1 BUILDING B - FIRST FLOOR PARTIAL PLAN

SCALE: NTS

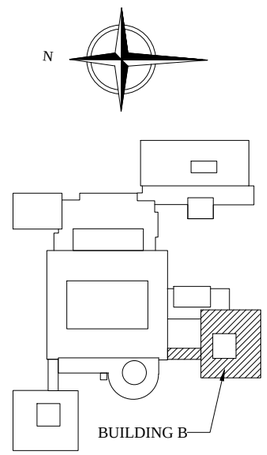

PROJECT KEY PLAN


WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING B
FIRST FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-004
Drawn by:	
Checked by:	4 of 18

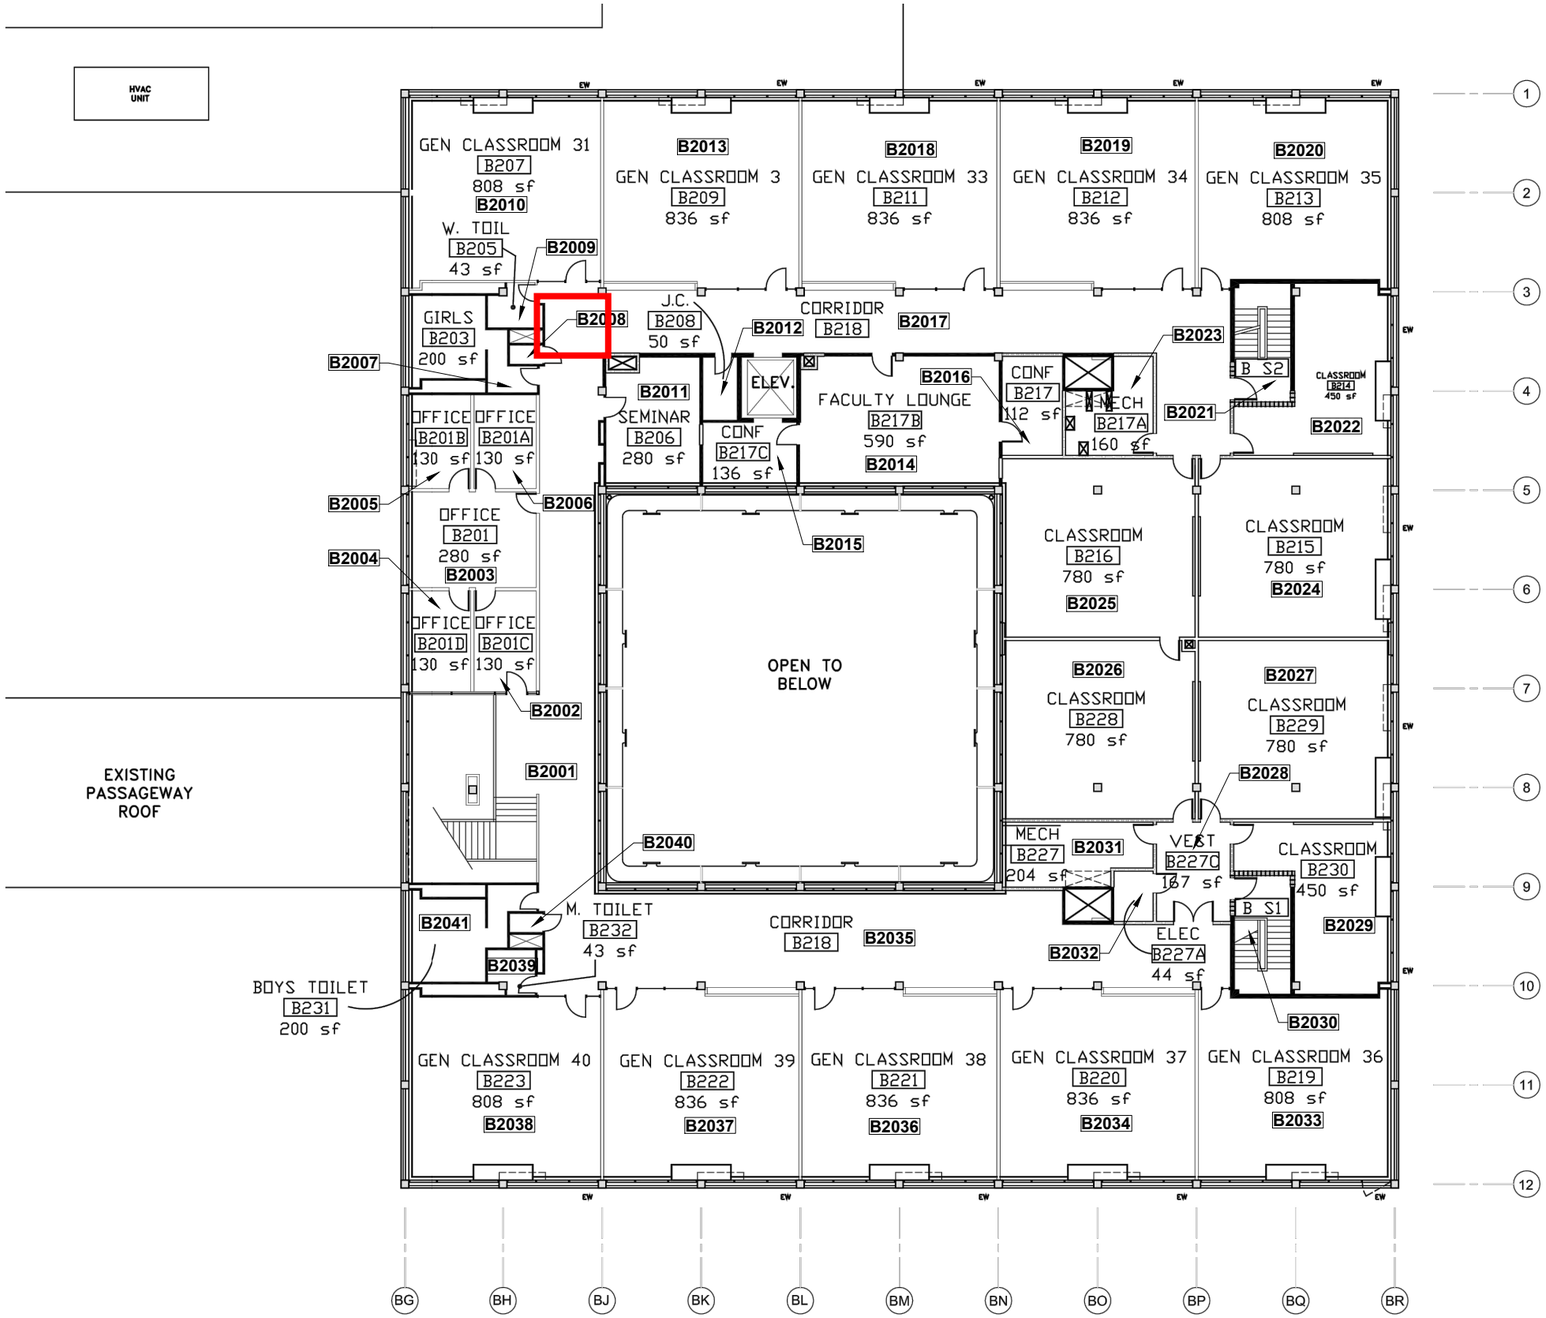

1 BUILDING B - SECOND FLOOR PARTIAL PLAN

SCALE: NTS

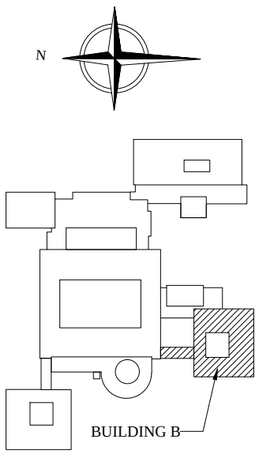

PROJECT KEY PLAN


WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING B
SECOND FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-005
Drawn by:	
Checked by:	5 of 18

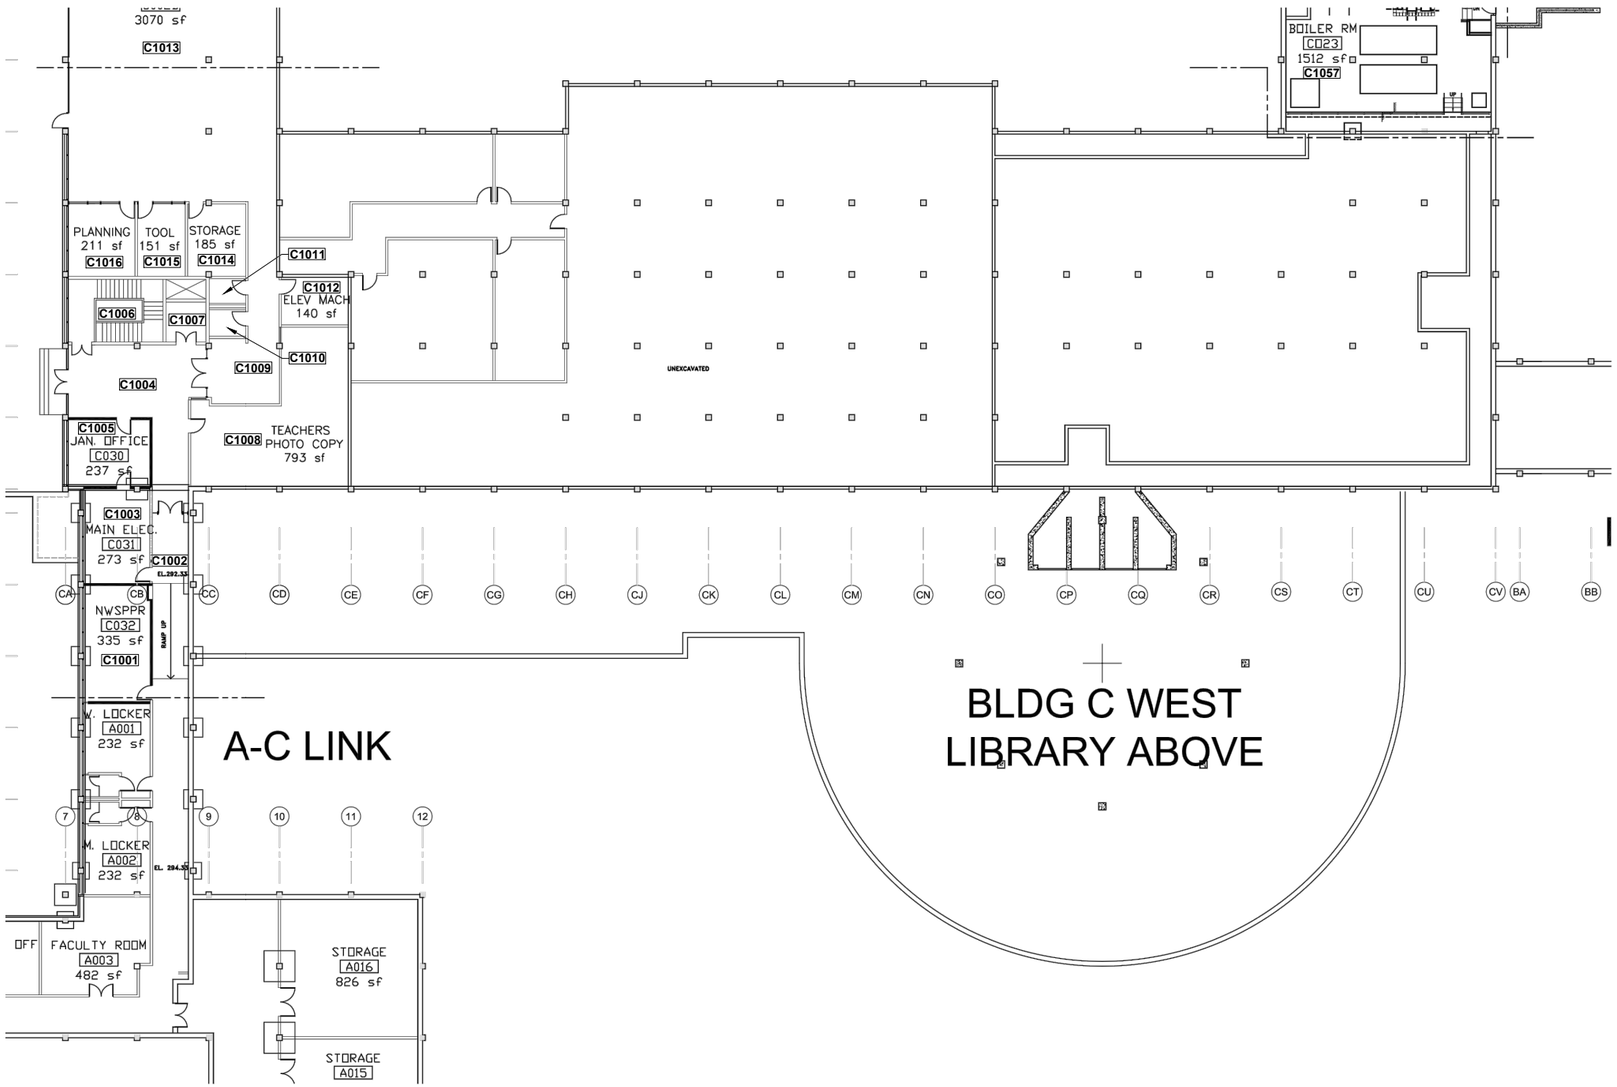

1 BUILDING C WEST- GROUND FLOOR PARTIAL PLAN

SCALE: NTS

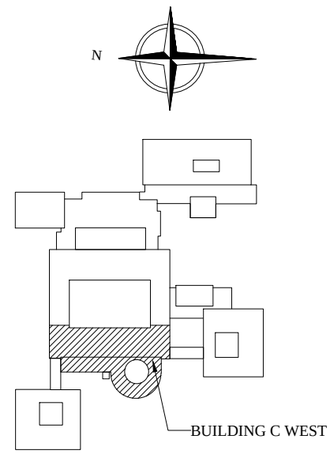

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING C WEST
GROUND FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-006
Drawn by:	6 of 18
Checked by:	

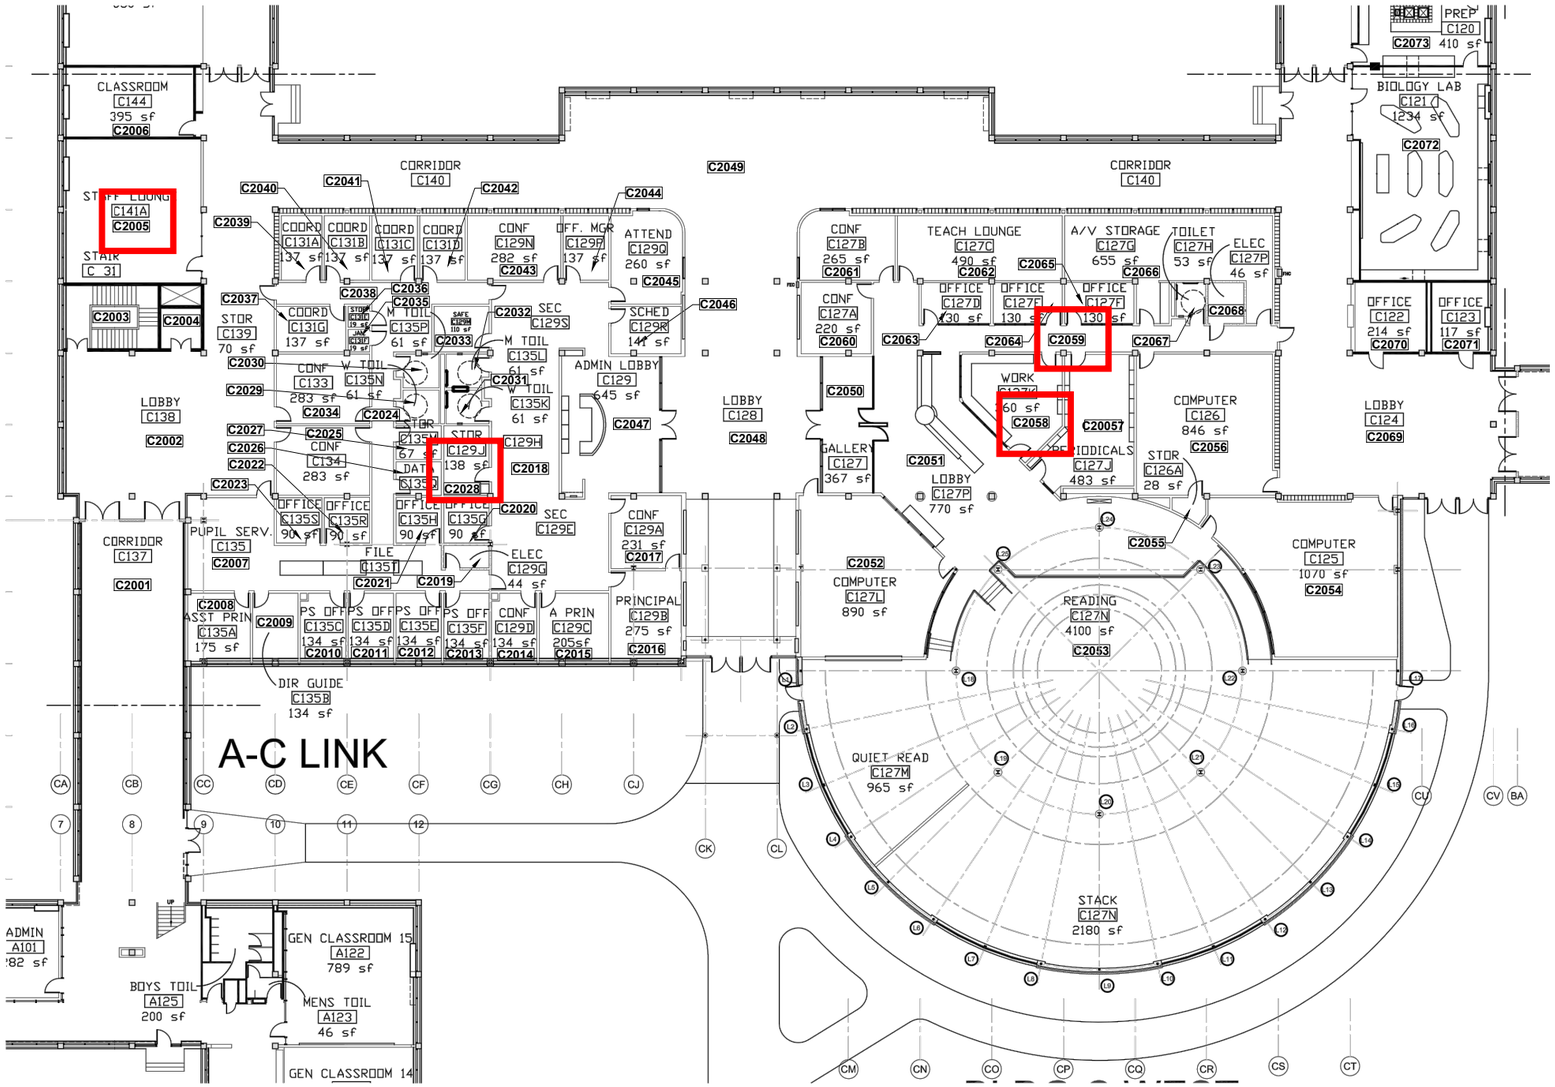

1 BUILDING C WEST- FIRST FLOOR PARTIAL PLAN

SCALE: NTS

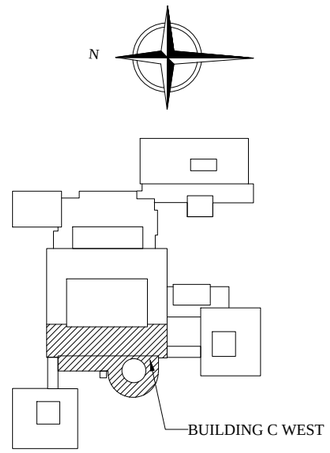

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING C WEST
FIRST FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-007
Drawn by:	7 of 18
Checked by:	

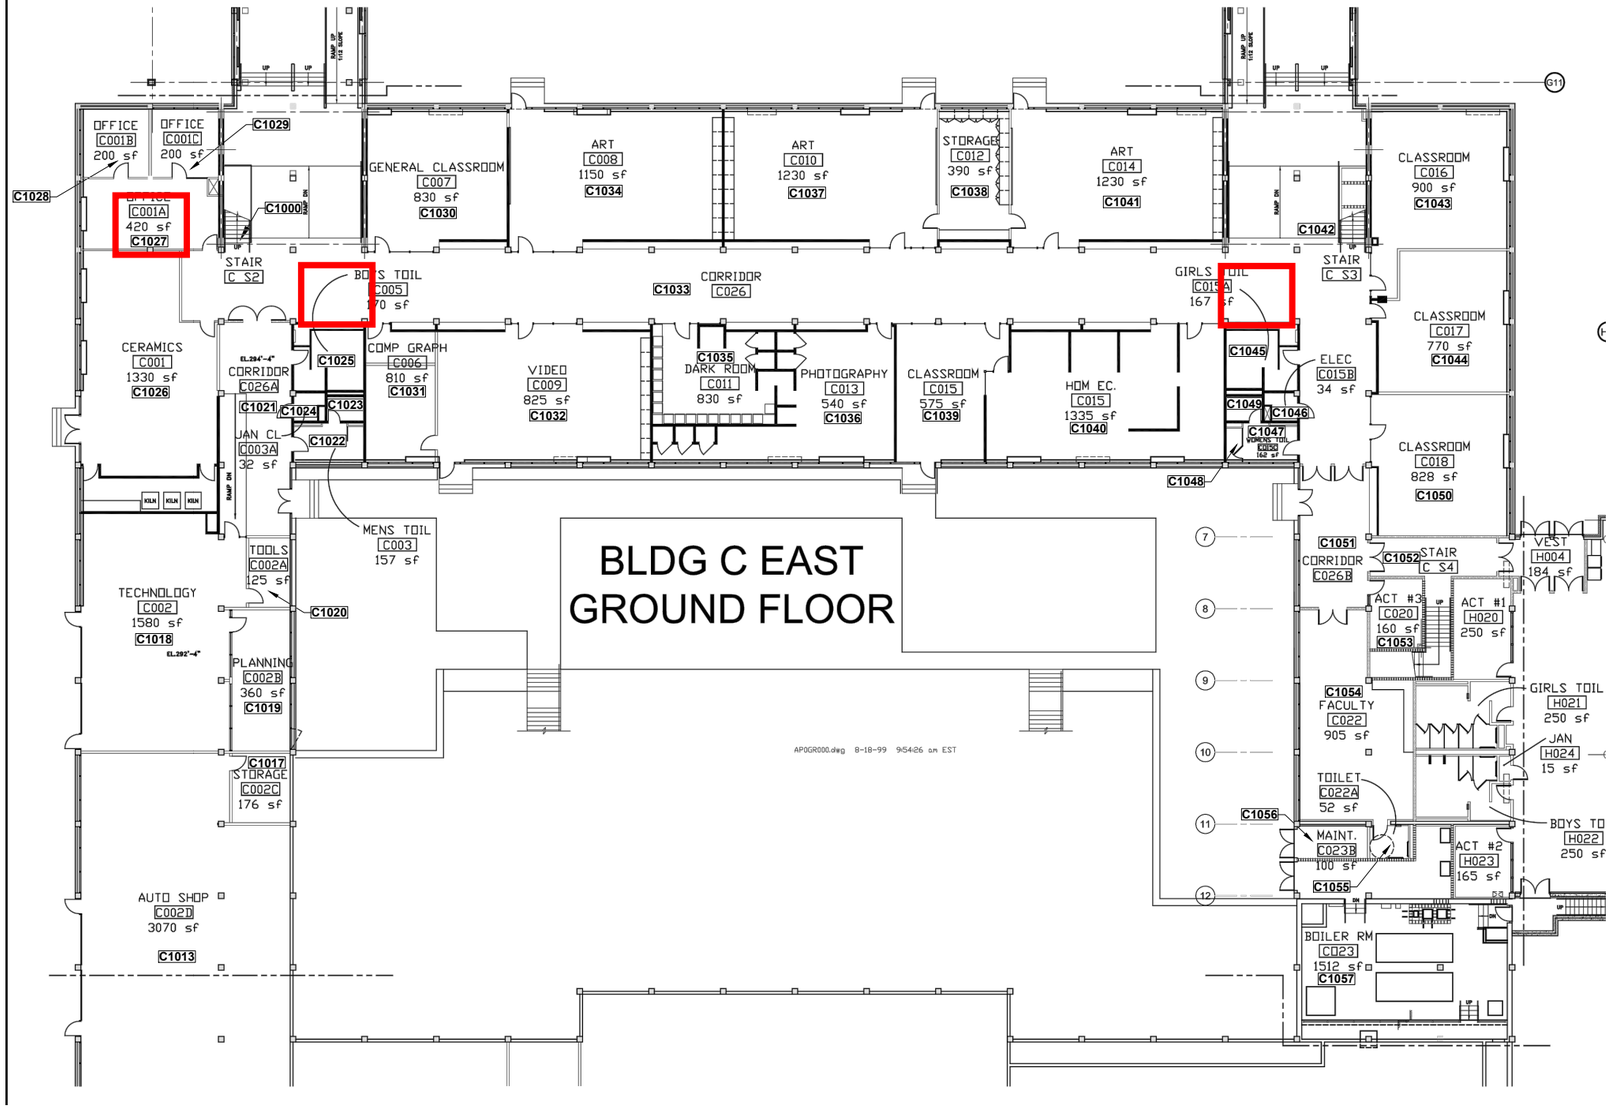

1 BUILDING C EAST- GROUND FLOOR PARTIAL PLAN

SCALE: NTS

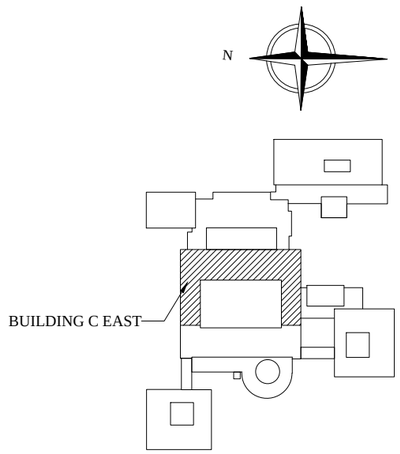

PROJECT KEY PLAN


WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:





No.	Date	Issue

Sheet Title

SITE PLAN
BUILDING C EAST
GROUND FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-008
Drawn by:	8 of 18
Checked by:	

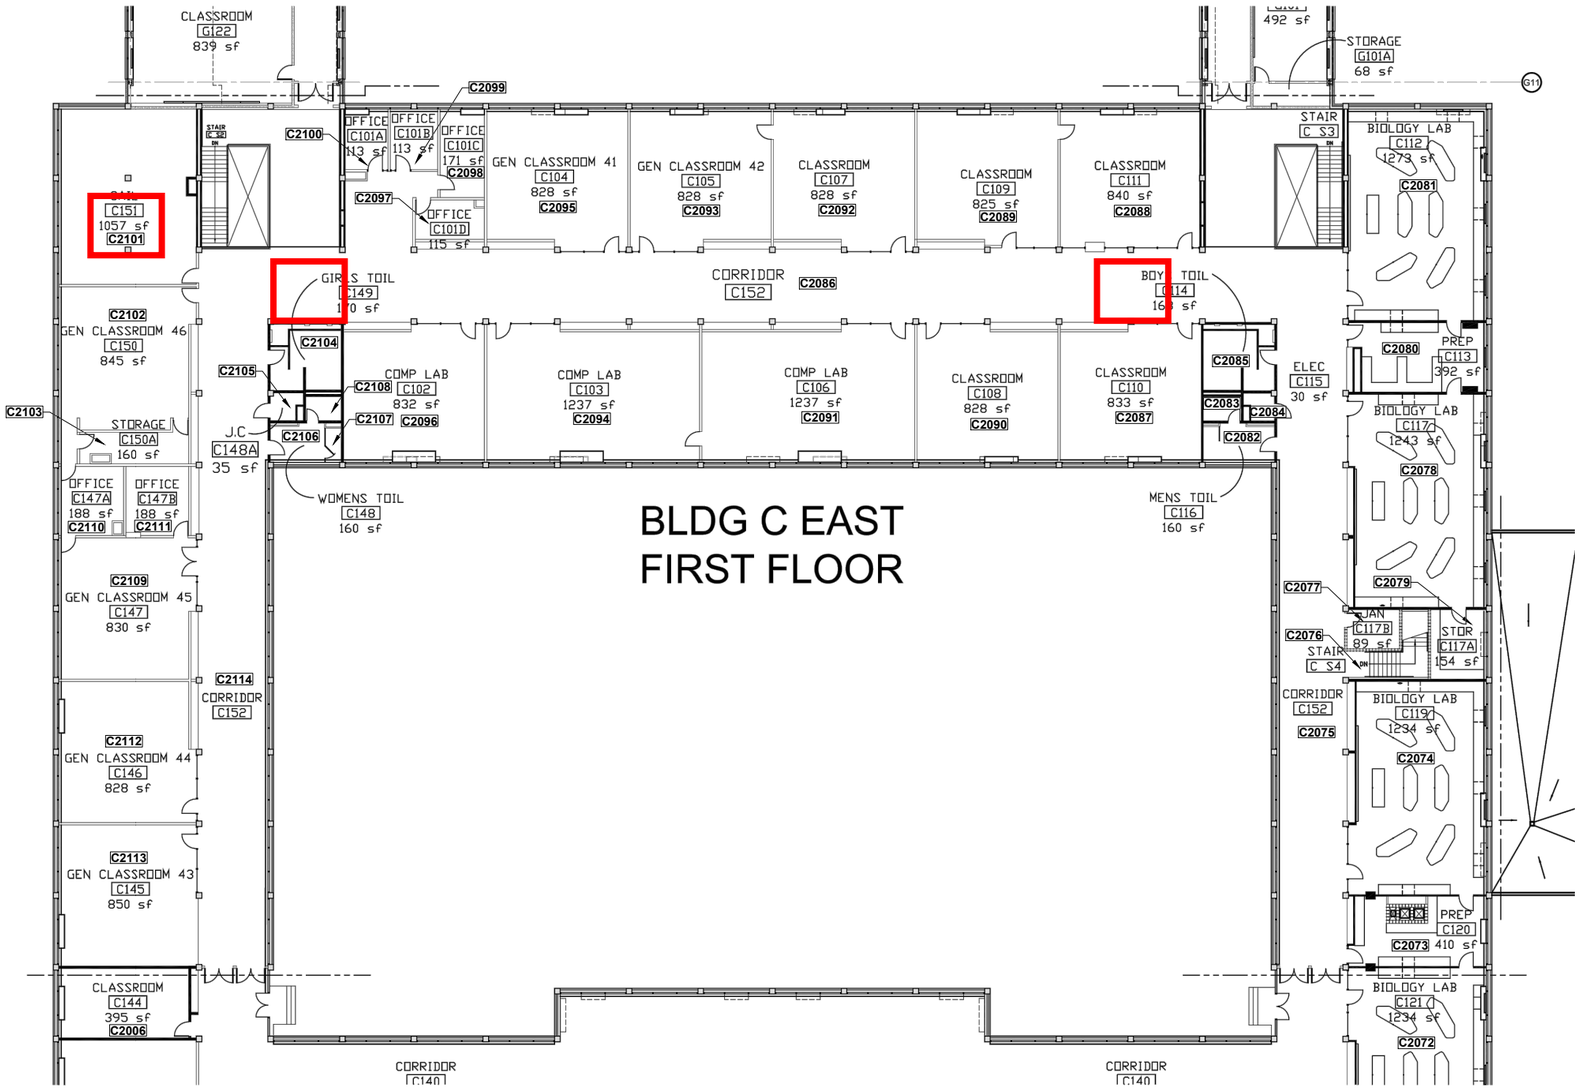

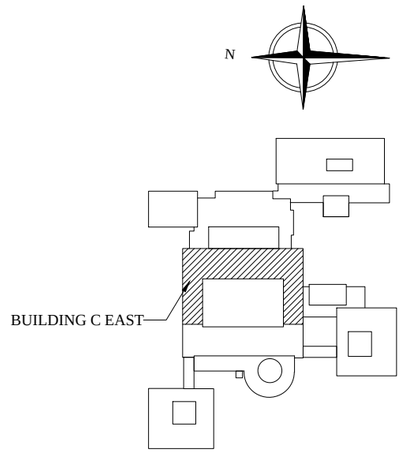

PROJECT KEY PLAN

1 BUILDING C EAST- FIRST FLOOR PARTIAL PLAN

SCALE: NTS

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING C EAST
FIRST FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-009
Drawn by:	9 of 18
Checked by:	

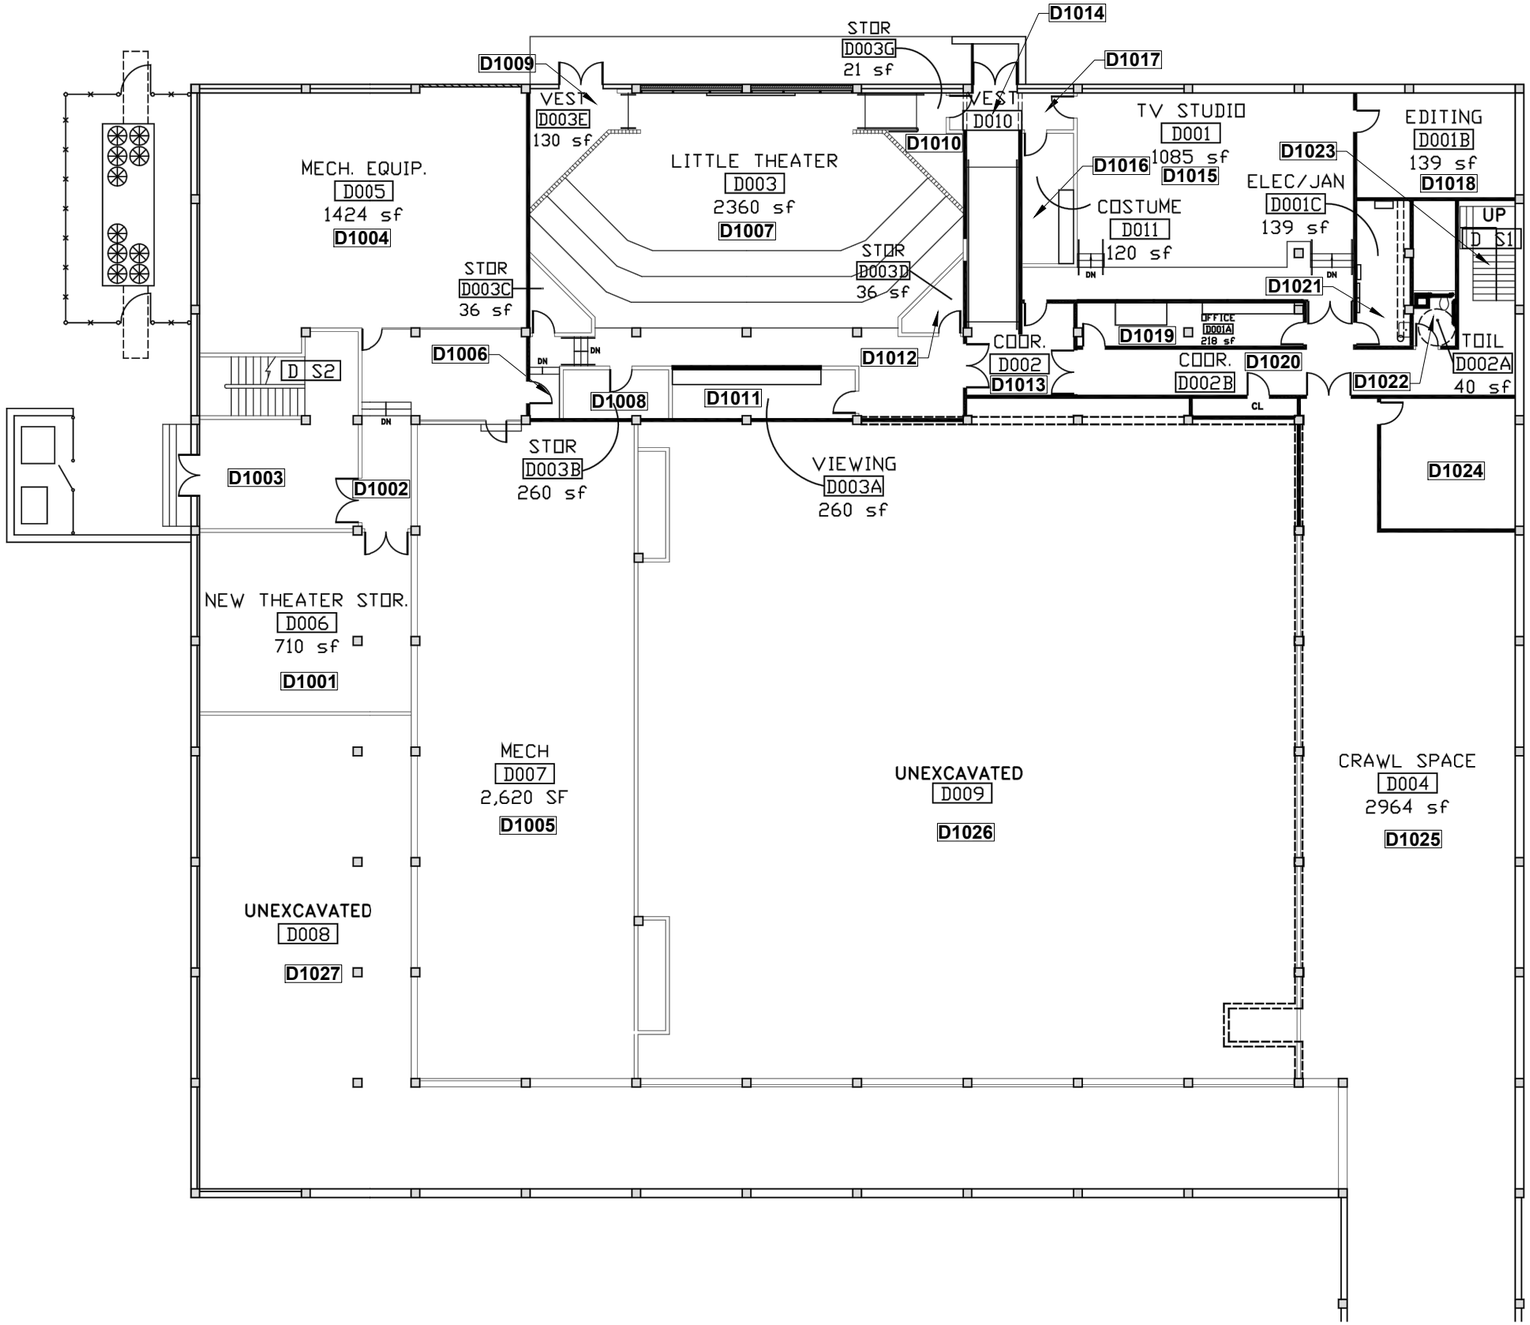

1 BUILDING D - LOWER FLOOR PARTIAL PLAN

SCALE: NTS

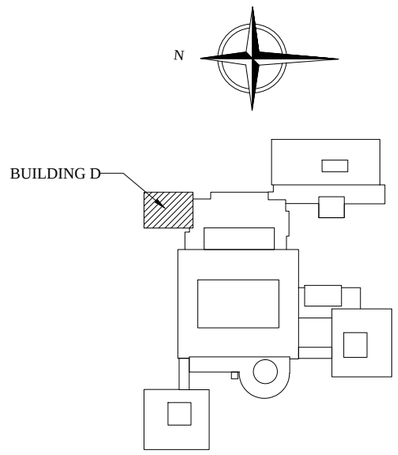

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING D
LOWER FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-010
Drawn by:	10 of 18
Checked by:	

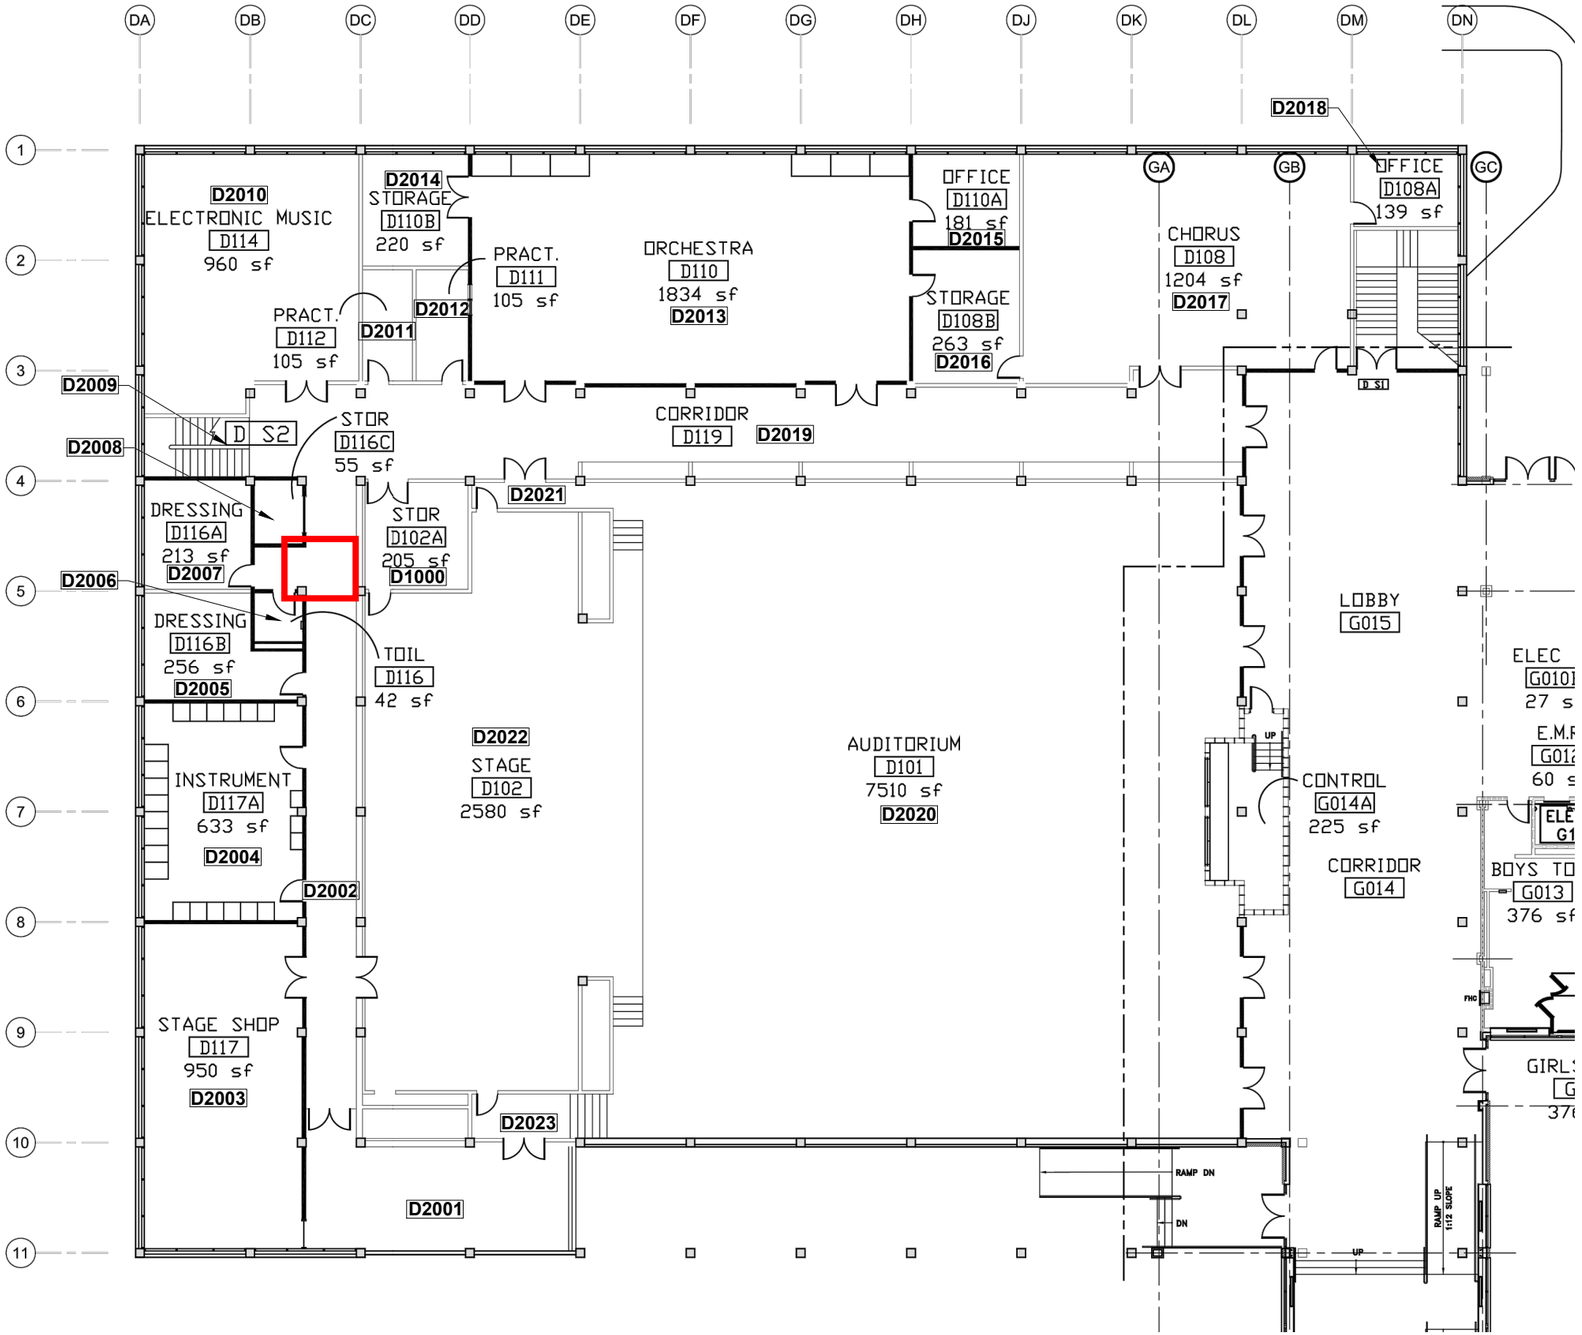

1 BUILDING D - GROUND FLOOR PARTIAL PLAN

SCALE: NTS

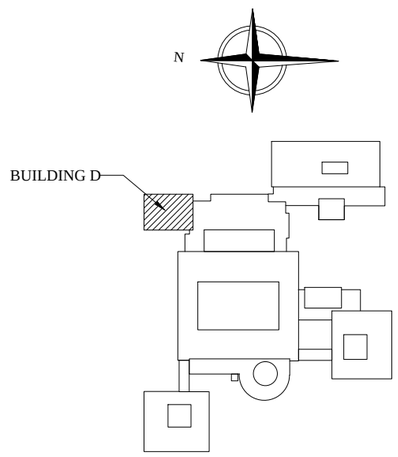

PROJECT KEY PLAN


WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING D
GROUND FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-011
Drawn by:	11 of 18
Checked by:	

BLDG F
POOL LEVEL

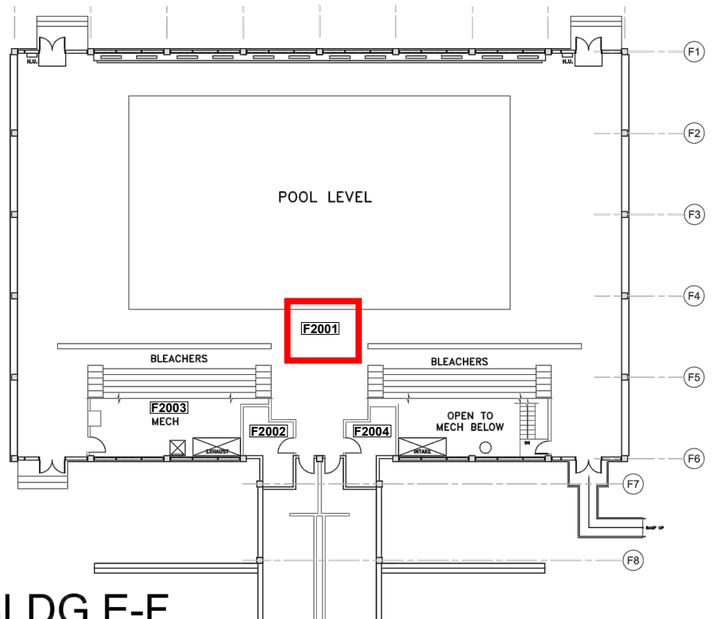


BLDG E-F
LINK
POOL LEVEL

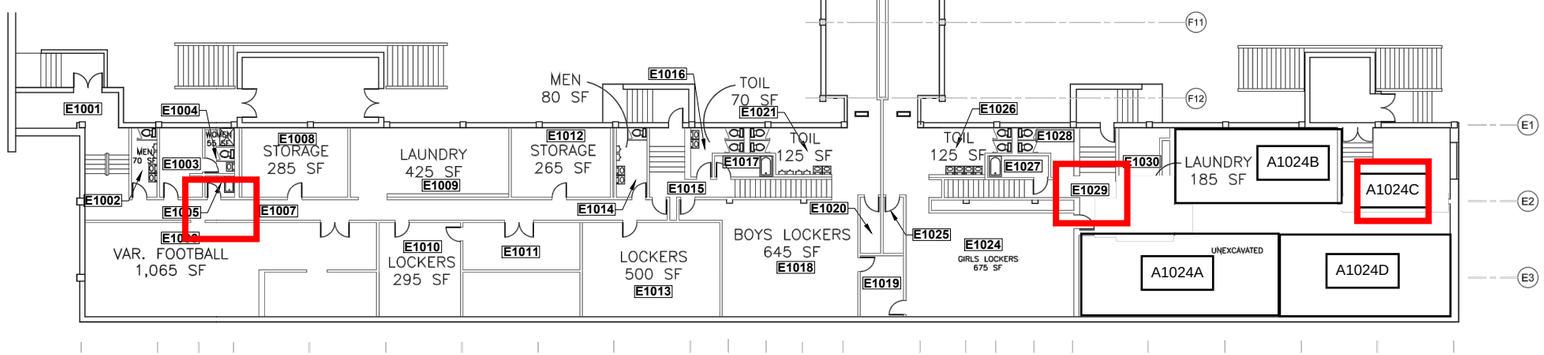

1 BUILDING E & F - POOL LEVEL PARTIAL PLAN

SCALE: NTS

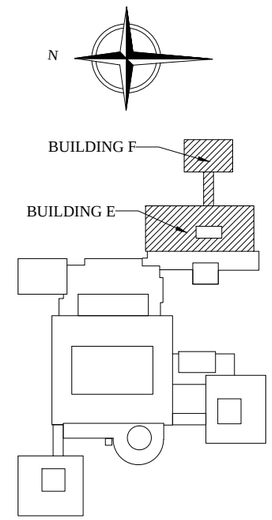

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING E & F
POOL LEVEL
PARTIAL

Job No.	Sheet No.
Date:	SP-012
Drawn by:	
Checked by:	12 of 18

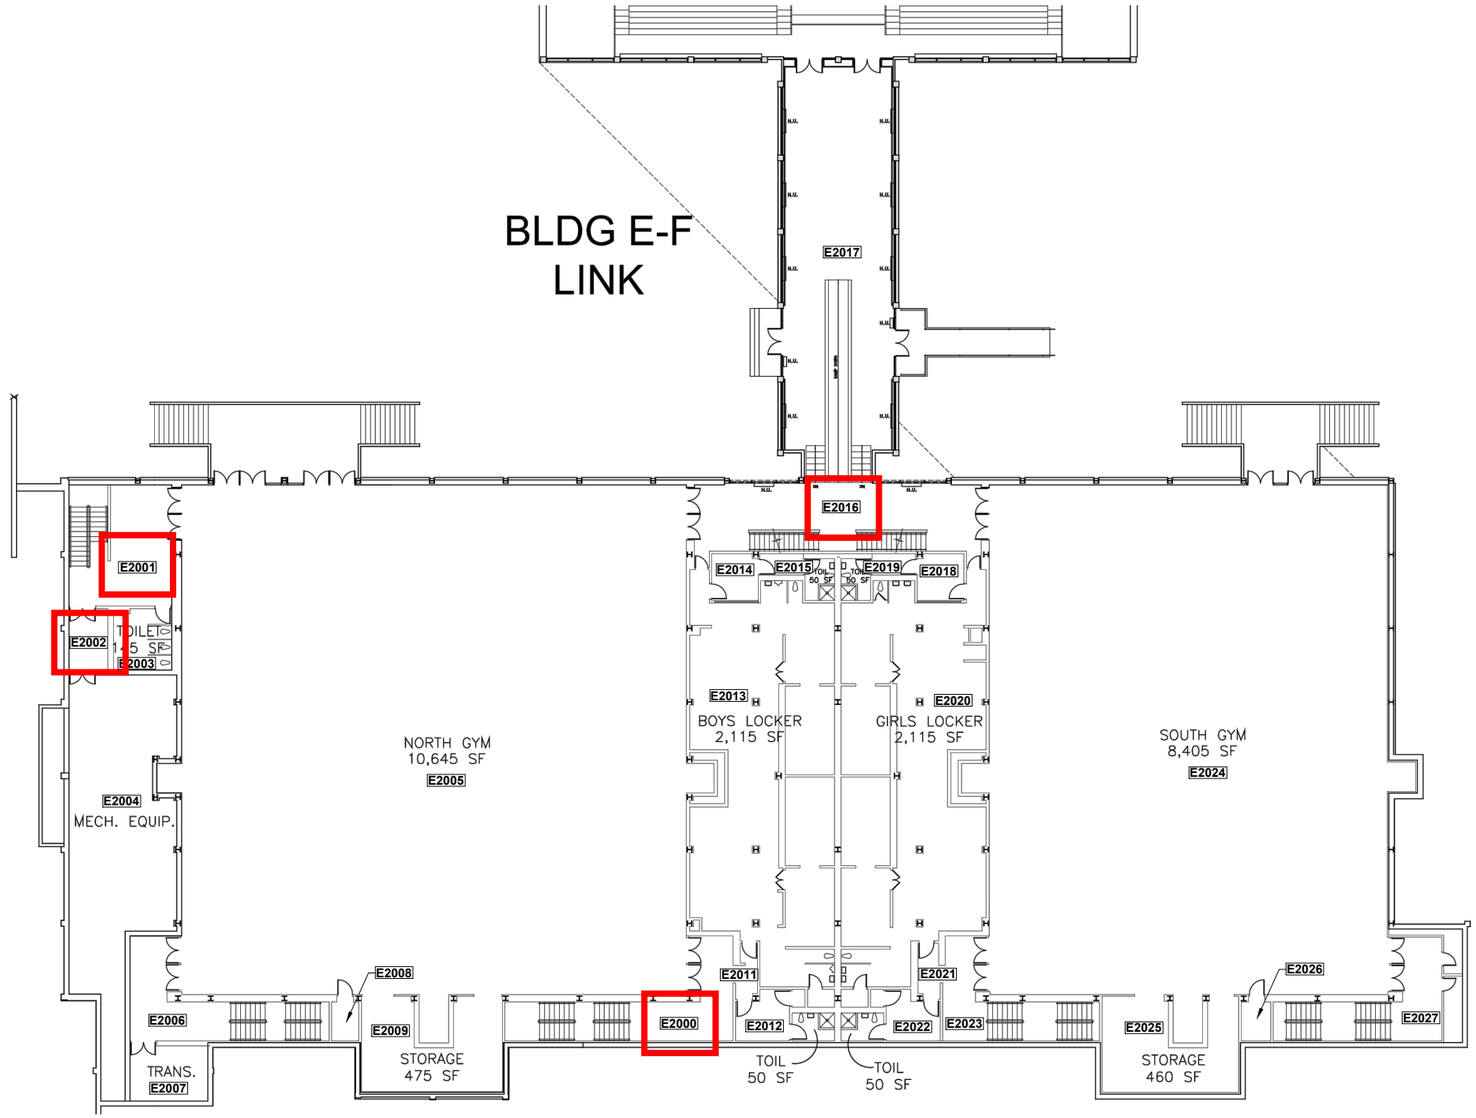

1 BUILDING E - GYM FLOOR PARTIAL PLAN

SCALE: NTS

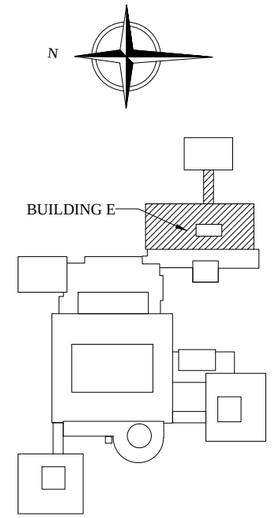

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SCHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title

SITE PLAN
BUILDING E
GYM FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-013
Drawn by:	13 of 18
Checked by:	

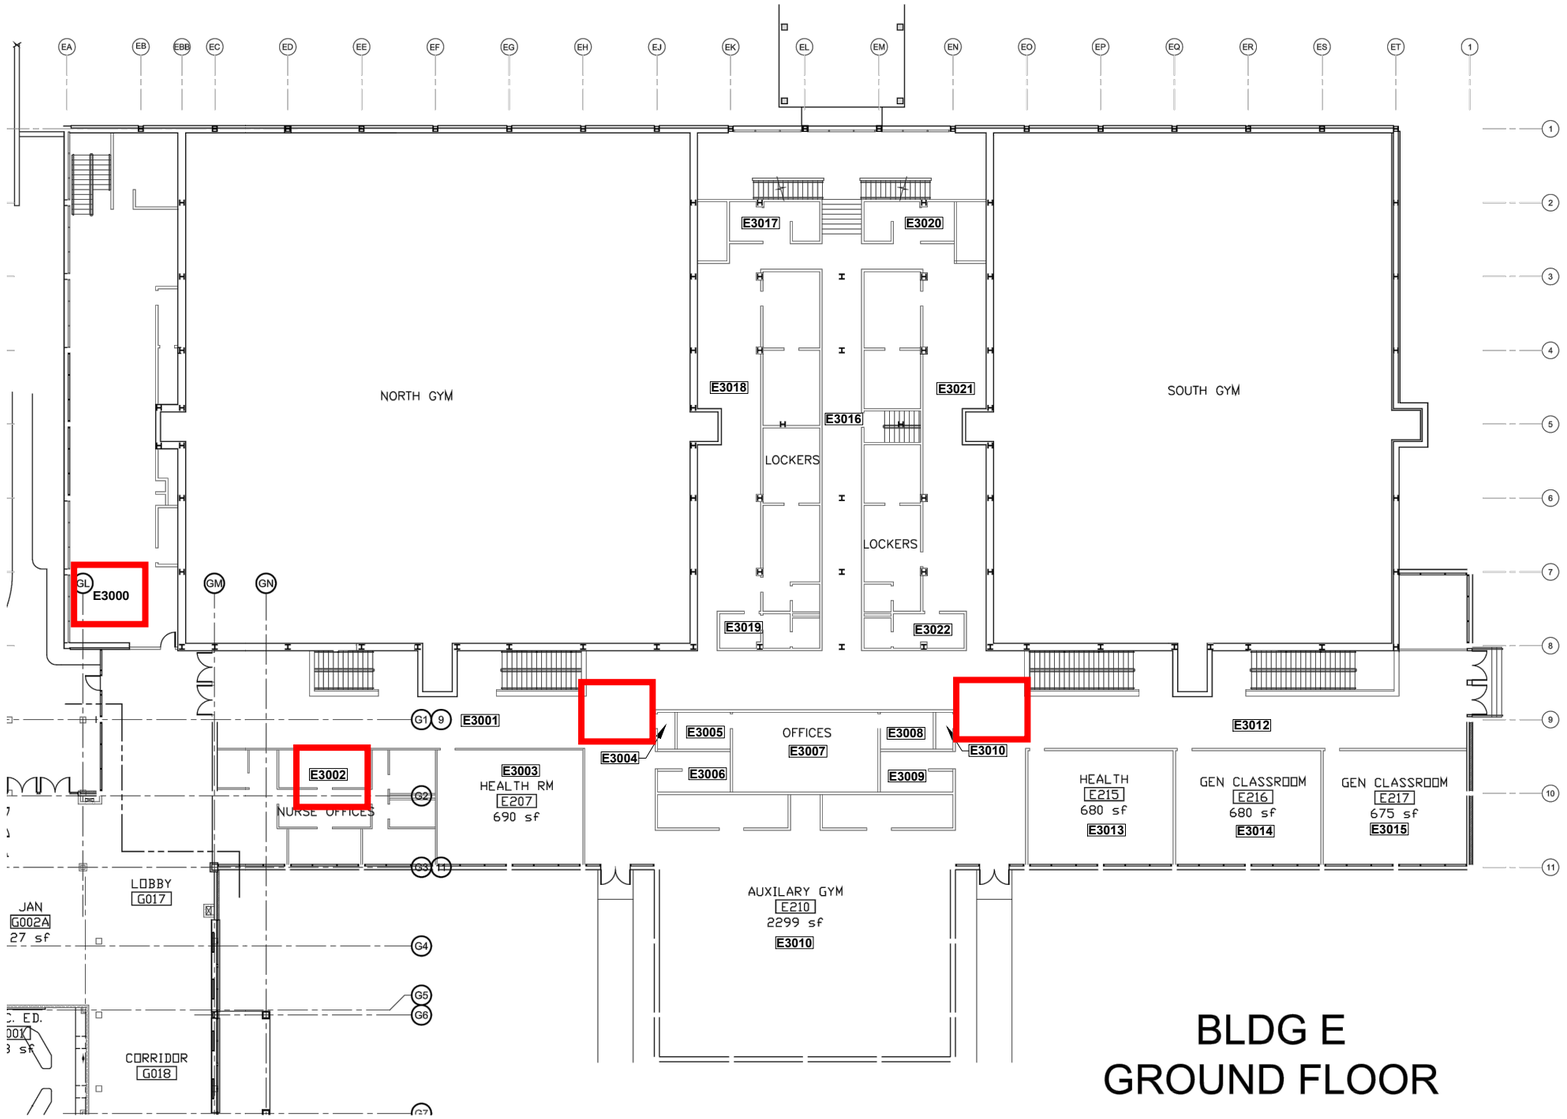


BLDG E
GROUND FLOOR

1 BUILDING E - GROUND FLOOR PARTIAL PLAN

SCALE: NTS



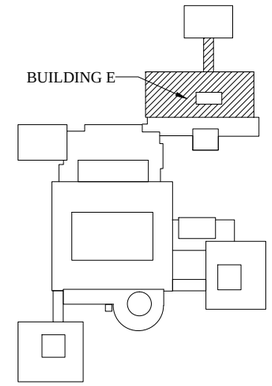

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING E
GROUND FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-014
Drawn by:	14 of 18
Checked by:	

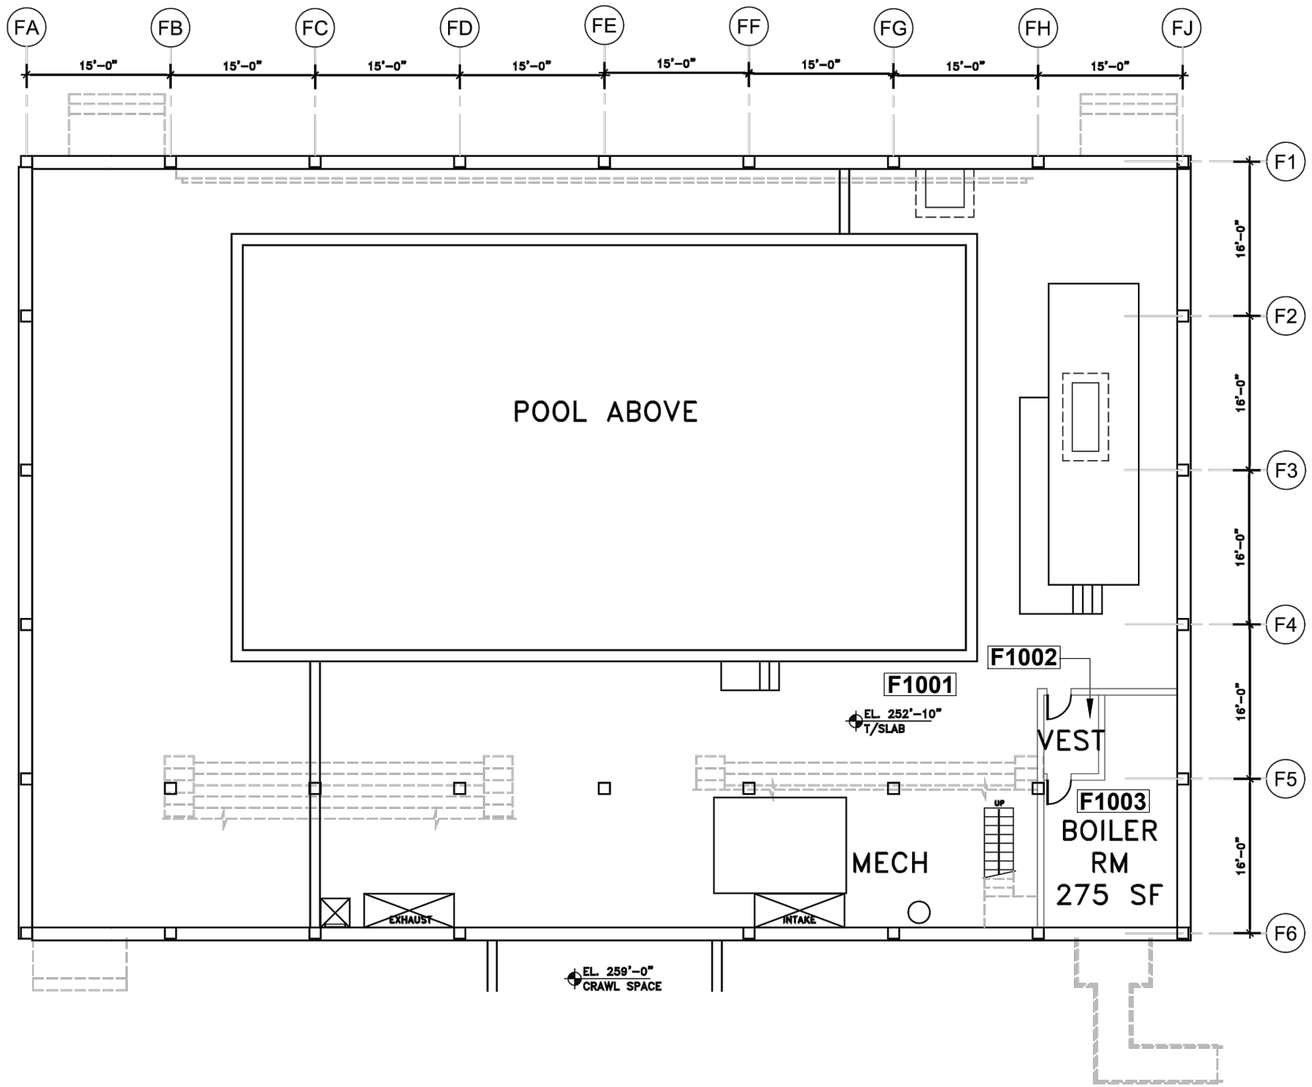

1 BUILDING F - BASEMENT LEVEL 3 PARTIAL PLAN

SCALE: NTS

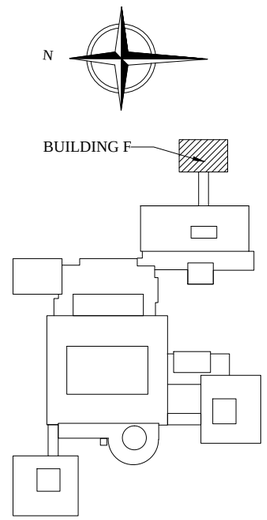

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING F
BASEMENT LEVEL 3
PARTIAL

Job No.	Sheet No.
Date:	SP-015
Drawn by:	15 of 18
Checked by:	

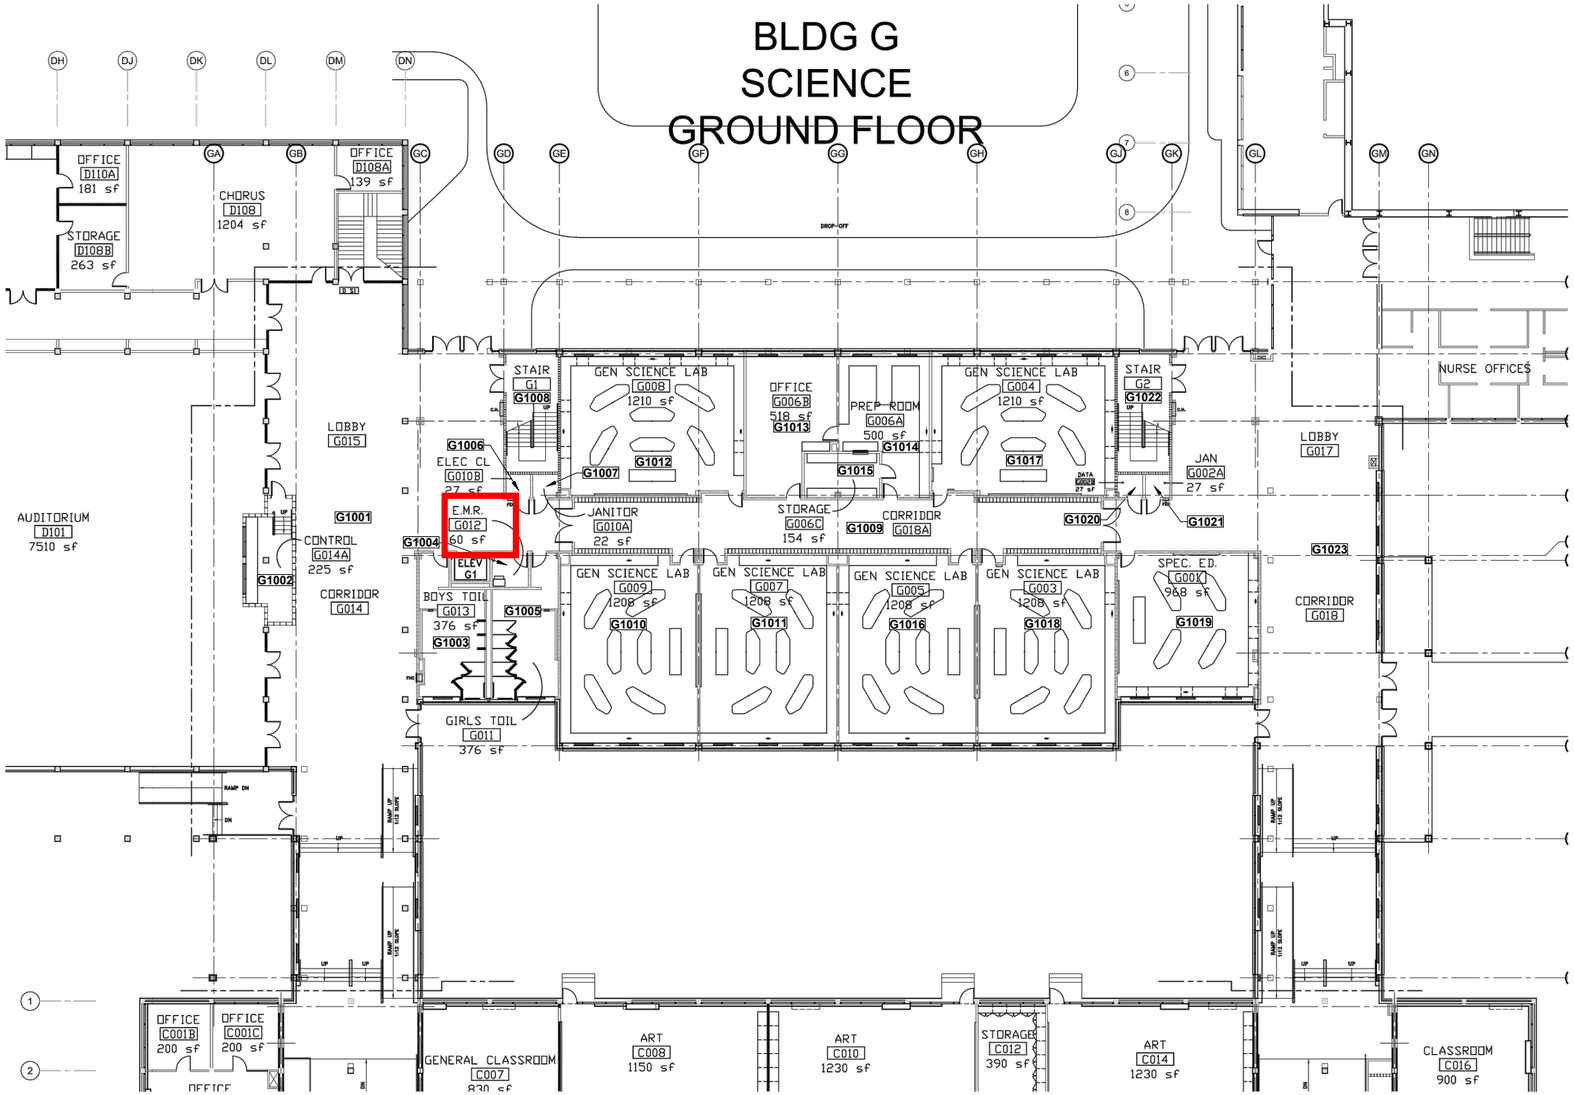

1 BUILDING G -GROUND FLOOR PARTIAL PLAN

SCALE: NTS

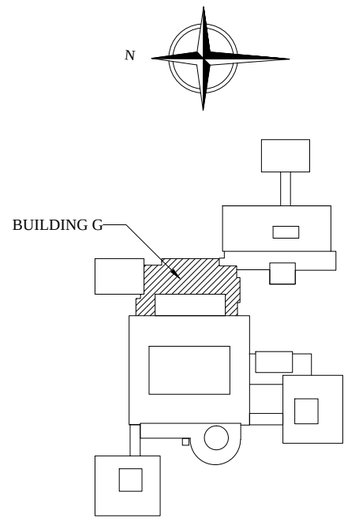

PROJECT KEY PLAN


WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING G
GROUND FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-016
Drawn by:	16 of 18
Checked by:	

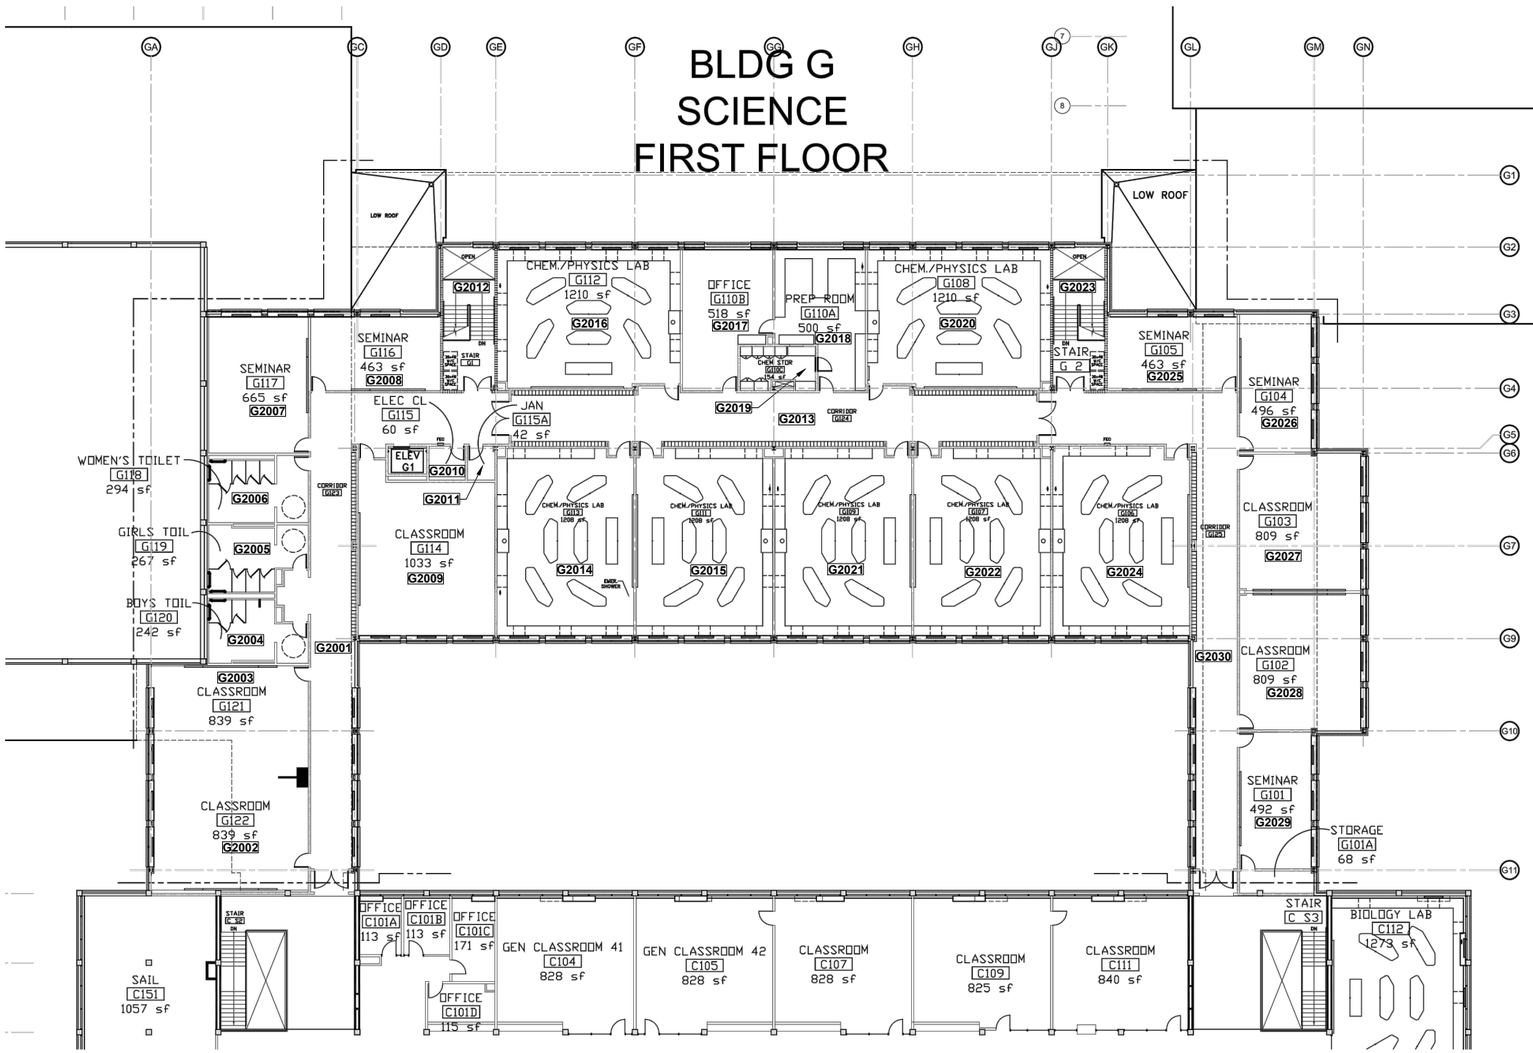

1 BUILDING G -FIRST FLOOR PARTIAL PLAN

SCALE: NTS

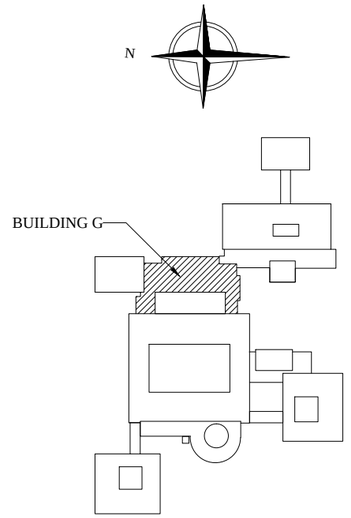

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:




No.	Date	Issue

Sheet Title


SITE PLAN
BUILDING G
FIRST FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-017
Drawn by:	17 of 18
Checked by:	

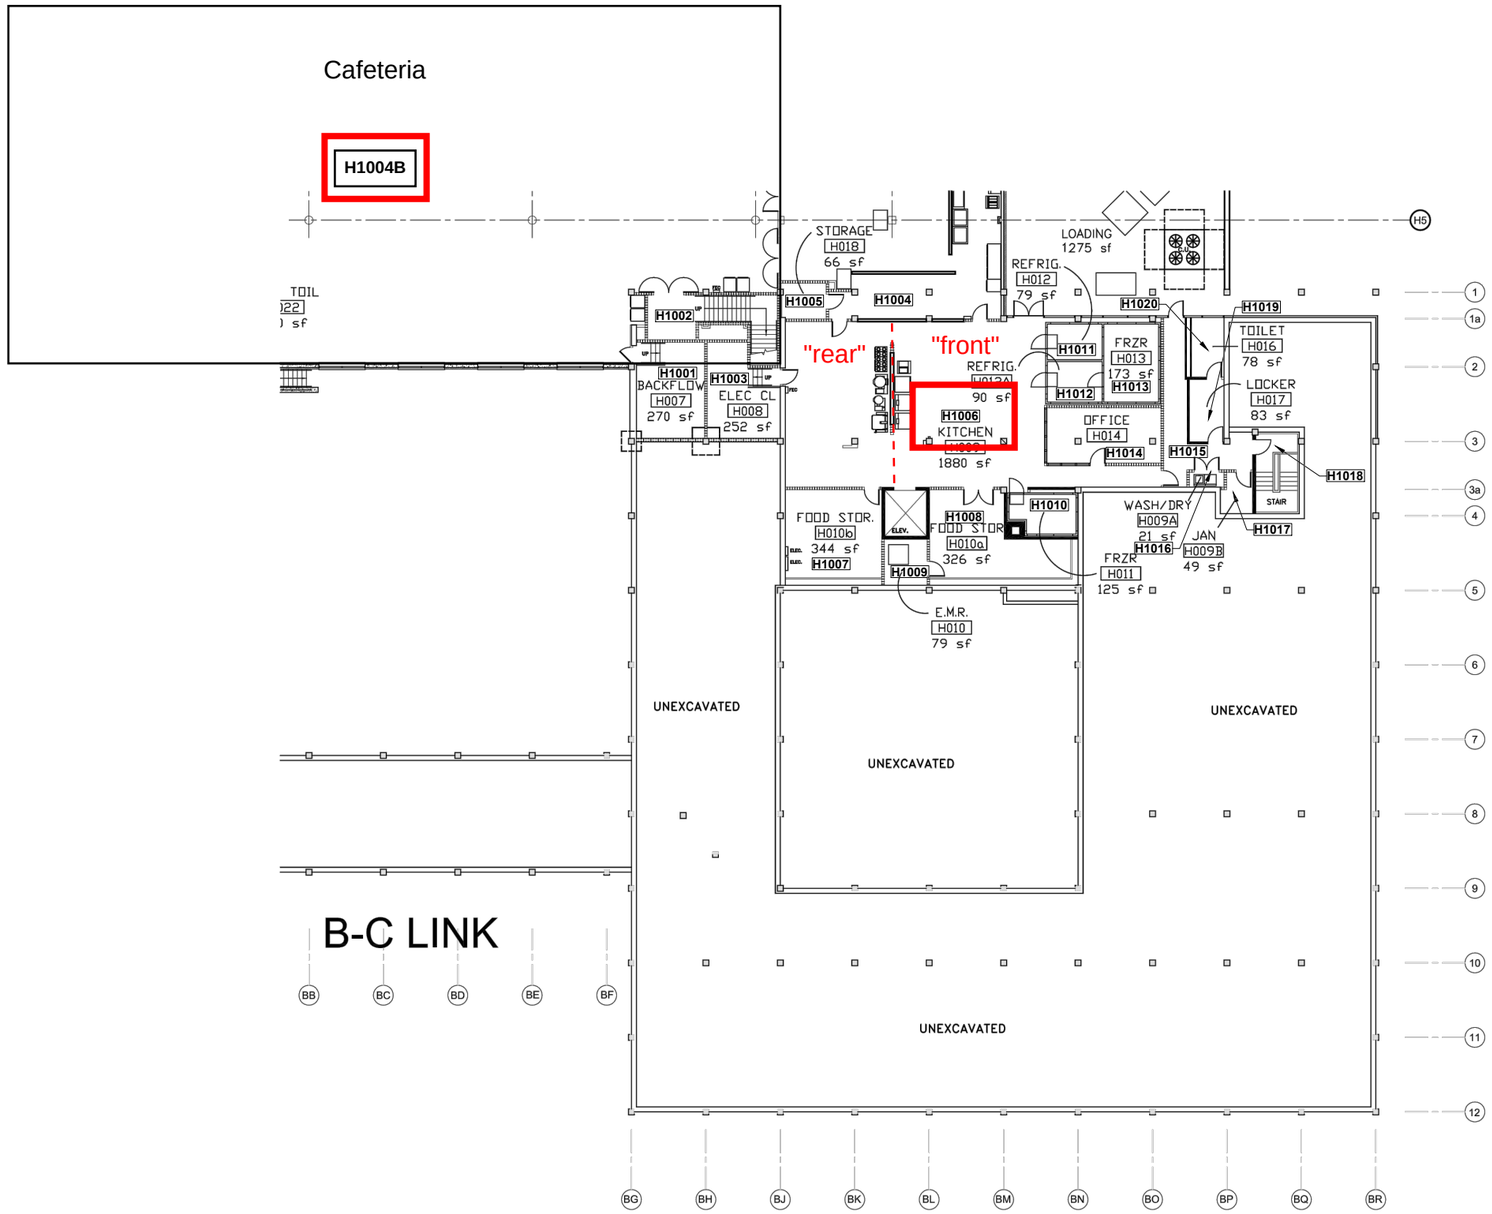

1 BUILDING H - GROUND FLOOR PARTIAL PLAN

SCALE: NTS

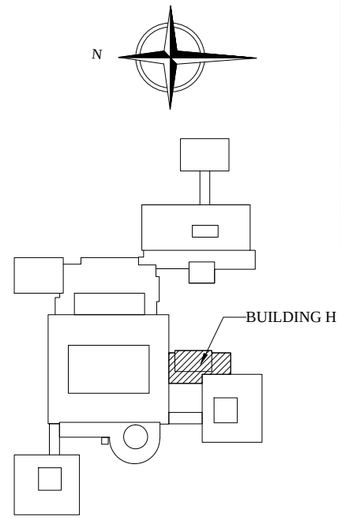

PROJECT KEY PLAN

WHITE PLAINS PUBLIC SHOOLS

WHITE PLAINS HIGH SCHOOL
550 NORTH STREET
WHITE PLAINS, NY 10605

AHERA SITE PLAN

LANGAN

KEY PLAN:



No.	Date	Issue

Sheet Title

SITE PLAN
BUILDING H
GROUND FLOOR
PARTIAL

Job No.	Sheet No.
Date:	SP-018
Drawn by:	18 of 18
Checked by:	

APPENDIX D

NYS DOH Lead Testing in School Drinking Water 2023 Compliance Requirements and NYS DOH Frequently Asked Questions (FAQs)

LANGAN

NEW YORK STATE | Department of Health

Lead Testing in School Drinking Water

10 NYCRR Subpart 67-4

Program Review and Updates

2023

Bureau of Water Supply Protection
NYS Department of Health

Background

- On September 6, 2016, Governor Cuomo signed into law a bill passed by the New York State Legislature (A10740/S8158).

- The law requires the New York State Department of Health (NYS DOH) to develop regulations to require all public school districts and Boards of Cooperative Educational Services (BOCES) - collectively, "schools" - to test all potable water outlets for lead contamination, and to take action if lead levels exceed 15 micrograms per liter.



NEW YORK STATE | Department of Health

Regulatory History

- The NYS DOH established a regulation to conform with the law - introduced as an emergency regulation, effective on September 6, 2016
- Title: ***Lead Testing in School Drinking Water***
  10 NYCRR Subpart 67-4 (Subpart 67-4)
- The regulation was adopted on May 9, 2018
- Public Health Law Section 1110 was amended by Governor Hochul on December 23, 2021, requiring changes to Subpart 67-4
- Revisions to the Public Health Law (PHL) Section 1110 went into effect on December 22, 2022





Summary of PHL Revisions

Monitoring

- Action Level lowered from 15 ppb to **5 ppb**
- Compliance monitoring will be every **3 years** (previously every 5 years)
- "**Lead-free" buildings no longer exempt** from testing requirements

Response

- All water provided to school staff/students in response to an outlet being taken out of service must be **free** of charge

Reporting

- Schools must now include copies of **lab reports** of the lead testing results on their websites

NEW YORK STATE | Department of Health

"Lead-Free" Buildings *No Longer Exempt*

The original legislation for 67-4 had an exemption from sampling for any school building, facility, addition, or wing with internal plumbing that met the new definition of "lead-free" (as defined by Section 1417 of the Federal Safe Drinking Water Act) from sampling.





A building was deemed lead-free if:

- The building was built after January 4, 2014, - OR -
- A NYS Professional Engineer or Architect certifies the building to be lead-free.

- The revisions to Public Health Law removes this exemption.
- All buildings will be required to conduct lead testing at all applicable outlets.

NEW YORK STATE | Department of Health

Changes to Key elements of Subpart 67-4

- **Action Level – now 5 ppb**
- **Sampling requirements – no change**
- **Response** - must supply water **free** of charge when appropriate
- **Public Notification –** no change
- **Reporting – must include lab reports on school website**
- **Recordkeeping – no change**



NEW YORK STATE | Department of Health

Compliance Period 2023 - 2025

Schools must complete *initial first-draw* sampling for the 2023-2025 Compliance Period between:

January 1, 2023 – December 31, 2025



NEW YORK STATE | Department of Health

Sampling Locations



"Applicable" sampling locations requiring sampling may be located anywhere on school property including external outlets (hose bibs) if the outlet may be used for drinking or cooking (including food preparation). Samples must be collected at all outlets used or potentially used for drinking or cooking.

NEW YORK STATE | Department of Health

“Applicable” vs. “Non-applicable” outlets

Superintendents or their designees have the responsibility to identify which outlets on a school property meet the regulation requirements for sampling (“applicable outlets”).

If a Superintendent or their designee determines they have some “non-applicable” outlets, the school must develop a plan that details how those outlets will not be accessed and/or utilized for drinking or cooking purposes.

Examples "Applicable“ Outlets

- bubblers/drinking fountains
- classroom sinks
- classroom combination sinks and drinking fountains
- kitchen sinks
- kitchen kettle filler outlets
- ice machines
- family and consumer sciences room sinks
- teachers’ lounge sinks
- nurse’s office sinks
- athletic field outlets
- Any other sink known to be or potentially used for consumption (e.g., used to make coffee in the office, etc.)

NEW YORK STATE | Department of Health

"Non-applicable outlets"

Rule of Thumb:

In general, any outlet in a room or office within a school that is not used by students (pre-kindergarten through grade 12) *and* does not provide water for drinking or cooking does not require sampling.

Examples of possible "Non-applicable outlets"

- **Dishwashing sinks:** If an outlet is designated for dish washing only and involves no opportunity for drinking or cooking (including food preparation), the outlet does not require sampling
- **Bus garage:** Outlets in bus garage buildings do not require sampling for lead unless the building is occupied by students (e.g., BOCES classes)
- **Point of entry:** Samples from the point of entry are not required under Subpart 67-4. Point of entry is the location where water *enters* the building from the distribution system of a public water system
- **Science/Art sinks:** Typically, classrooms in these settings prohibit eating and/or drinking. The school Superintendent has the authority to determine whether these outlets may be used for drinking or cooking and whether they require sampling

Guidance on Bathroom Sinks

Lavatory / Bathroom Sinks

Toilet rooms and bathrooms are building environments that can present unique challenges to water potability. These challenges are reflected in various code provisions that prohibit the installation of drinking facilities, drinking fountains, water coolers and water dispensers within toilet rooms and bathrooms.

NYS DOH would not object to designating these outlets nonapplicable where controls (e.g. education and signage) exist to prevent the consumption of water.

The school should include these outlets in the Remedial Action Plan with details on how their potential use will be mitigated.

NEW YORK STATE | Department of Health

Guidance for Classroom Sinks

Classroom sinks: If the outlet is used for drinking and/or cooking, it must be sampled.

However, if the school has controls in place to prevent the consumption of water, these outlets may be excluded from sampling. Superintendents, or their designees, have the responsibility to identify which outlets meet the regulation requirements for testing ("applicable outlets"). If a Superintendent or their designee determines that a school has outlets that fall outside the scope of the regulation (outlets not used or potentially used for drinking or cooking ("nonapplicable outlets"), the school must develop a Remedial Action Plan that includes details on how those outlets will not be accessed and utilized for drinking or cooking purposes.

Guidance on Tempered Outlets "Non-applicable outlets"

Tempered outlet: an outlet that provides water with a temperature between 80 -110°F; generally, applies to bathroom fixtures in schools, gymnasiums, hotels, airports, bus and railroad stations.

The DOH and the US EPA recommend that hot or tempered water ***not*** be used for drinking or cooking as warm or hot water increase the leaching of lead into the water.

Tempered outlets are not required to be sampled. However, all tempered water outlets should be clearly posted with signs ("Do Not Drink" or equivalent), education should be provided to the students and staff to ensure awareness, and the remedial action plan should address, document, and describe continued management of the controls in place for these outlets.

NEW YORK STATE | Department of Health

“First-draw” Samples

Any sample collected for compliance under Subpart 67-4 must be a “first-draw” sample.



First-draw sample:

- A water sample collected from a cold water outlet before any water is used from that outlet
- Water must be motionless in pipes for a minimum of 8 - 18 hours before sample collection
  - This timeframe represents water that would be consumed during normal operating conditions on any school day.
- Recommended sampling times
  - While school is in session; not during or immediately after weekends, vacations or routine flushing programs;
  - following normal operation of school (e.g. Tuesday – Saturday mornings)

NEW YORK STATE | Department of Health



Lead Action Level



The action level for lead in school drinking water is **5 micrograms per liter** (µg/L) or parts per billion (ppb).

- Lead test results ≤ 5 ppb do *not* exceed the lead action level, and therefore do not require further testing or remediation until the next compliance cycle.

- Lead test results > 5 ppb (i.e., 5.1 ppb, or greater) *exceeds* the lead action level, and will require the outlet to be taken out of service and a remediation action plan to be implemented.

NEW YORK STATE | Department of Health

Guidance for outlets with test results > 5 ppb from previous compliance testing

Sampling at outlets where results from previous compliance testing (prior to December 22,2022) have exceeded 5 ppb should be a priority.

First-draw tap testing at these outlets should be completed as soon as practicable and mitigation/remediation commenced where levels are detected above the new action level of 5 ppb.

NEW YORK STATE | Department of Health

Corrective Actions / Remediation Options

- Permanent removal of an outlet
- Outlet replacement with “lead-free” plumbing materials
- Pipe replacement with “lead-free” plumbing materials
- Remove other sources of lead (lead pipe, lead solder joints, and brass plumbing components with “lead-free” materials)
- Flushing (systematic flushing program)
- Point of Use (POU) Filters*
- Supervision
- Engineering controls
- Education
- Signage

If an outlet tested above the “action level”, can it still be used for cleaning and handwashing?

- Yes
- Signage must be placed at such outlets stating that the water should not be used for drinking (only handwashing and cleaning)
- Pictures should be used if there are small children using the water outlets, and staff should ensure the children understand what the signs mean and monitor the outlets to ensure they are not used for drinking



Corrective Actions / Remediation Options

Signage









Post-Remediation Testing

- Follow-up samples collected after an outlet has been remediated must also be “first-draw” samples. Schools may choose to perform additional sampling (i.e., 30-second flush, etc.) to determine the contribution of lead from plumbing to guide remediation decisions.

- Post-remediation tests results need to be reported:
  - In the DOH’s HERDS application on HCS
  - On the school’s website within the same reporting timeframes/ requirements as specified for the initial sampling

Public Notification Requirements

- Within 1 business day of receipt of laboratory reports:
  - ✓ Report all exceedances (lead result greater than 5 ppb) to the local health department
- Within 10 business days of receipt of laboratory reports:
  - ✓ Report all exceedances to all staff, parents, and guardians in writing.
  - ✓ Report test results (including post-remediation results) in the DOH's electronic reporting system, HERDS accessed through HCS. This information is posted on the DOH's's website for the public
- Within 6 weeks of receipt of laboratory reports:
  - ✓ Post copies of **lab reports** of test results and information about remediation actions taken to address outlets where lead exceeded the action level on the school's website. This should remain posted on the school's website for the duration of the compliance period (i.e. 2023-25)





Recordkeeping Requirements

- Per Subpart 67-4, schools must retain records for 10 years following document creation.

  Note: other agencies may have additional records retention requirements (i.e., SED, NYS Department of Labor)



- Copies of documents must be provided to the DOH, the SED, or the local health department upon request

NEW YORK STATE | Department of Health

Best Management Practices to Reduce Lead in Drinking Water

- Aerator cleaning
- Routine flushing practices (after vacations and long weekends)
- Use only certified lead-free materials when performing plumbing work
- Follow the manufacturer's recommendations for water softener settings to ensure an appropriate level of hardness
- Educating staff and students of the benefits of running water at a tap briefly prior to using it for drinking or food preparation. Letting the water run for 30-60 seconds or until the water feels cold can reduce the potential levels of lead in the drinking water


Electronic Reporting in HCS/HERDS

- Within 10 business days of receipt of laboratory reports
  Summary of data and sampling information must be reported in the DOH's electronic reporting system, **HERDS**, accessed through HCS. Summary data includes:
  - General information, website address
  - Number of outlets sampled, sampling information
  - Summary of Lead analysis results
  - Response and remediation status



- A new HERDS reporting form for the 2023-2025 compliance period is now live.

NEW YORK STATE | Department of Health

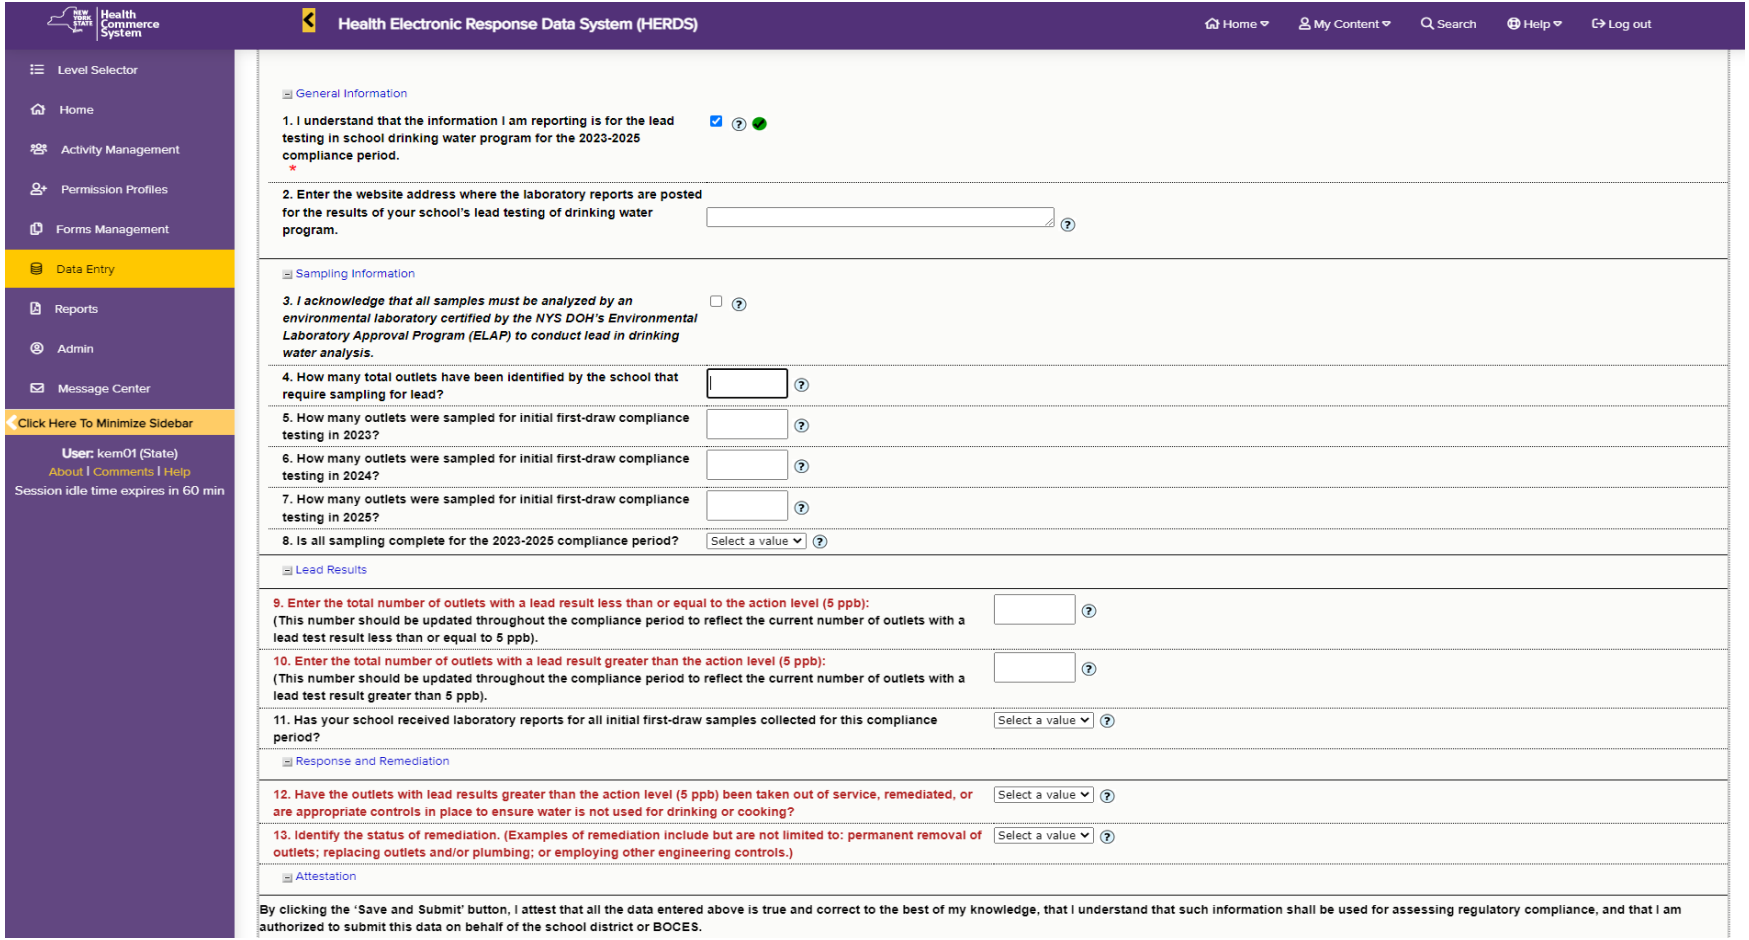
Health Commerce System
Health Electronic Response Data System (HERDS)
Home
My Content
Search
Help
Log out
Level Selector
Home
Activity Management
Permission Profiles
Forms Management
Data Entry
Reports
Admin
Message Center
Click Here To Minimize Sidebar
User: kem01 (State)
About | Comments | Help
Session idle time expires in 60 min
General Information
1. I understand that the information I am reporting is for the lead testing in school drinking water program for the 2023-2025 compliance period. *
2. Enter the website address where the laboratory reports are posted for the results of your school's lead testing of drinking water program.
Sampling Information
3. I acknowledge that all samples must be analyzed by an environmental laboratory certified by the NYS DOH's Environmental Laboratory Approval Program (ELAP) to conduct lead in drinking water analysis.
4. How many total outlets have been identified by the school that require sampling for lead?
5. How many outlets were sampled for initial first-draw compliance testing in 2023?
6. How many outlets were sampled for initial first-draw compliance testing in 2024?
7. How many outlets were sampled for initial first-draw compliance testing in 2025?
8. Is all sampling complete for the 2023-2025 compliance period?
Select a value
Lead Results
9. Enter the total number of outlets with a lead result less than or equal to the action level (5 ppb):
(This number should be updated throughout the compliance period to reflect the current number of outlets with a lead test result less than or equal to 5 ppb).
10. Enter the total number of outlets with a lead result greater than the action level (5 ppb):
(This number should be updated throughout the compliance period to reflect the current number of outlets with a lead test result greater than 5 ppb).
11. Has your school received laboratory reports for all initial first-draw samples collected for this compliance period?
Response and Remediation
12. Have the outlets with lead results greater than the action level (5 ppb) been taken out of service, remediated, or are appropriate controls in place to ensure water is not used for drinking or cooking?
13. Identify the status of remediation. (Examples of remediation include but are not limited to: permanent removal of outlets; replacing outlets and/or plumbing; or employing other engineering controls.)
Attestation
By clicking the 'Save and Submit' button, I attest that all the data entered above is true and correct to the best of my knowledge, that I understand that such information shall be used for assessing regulatory compliance, and that I am authorized to submit this data on behalf of the school district or BOCES.

Tying up Loose Ends

- **Report lead data for the 2020-21 compliance period *if not already done*.**
- **Update data in HERDS to reflect the current status**
- **Update Roles in HCS to reflect current staff assignments for reporting Lead data:**
  - **School Lead in Drinking Water Reporter role**
  - **HPN/HCS Coordinator**
- **The new 2023-25 compliance period is here!**
  - **Be sure to report data on School website with required timeframes**
- **Future webinars and outreach activities coming soon...**

NEW YORK STATE | Department of Health

Questions?

Email Contact:

lead.in.school.drinking.water@health.ny.gov

Phone: 518-402-7650

NEW YORK STATE | Department of Health

APPENDIX E

Draft Parent Letter

A NOTICE TO PARENTS, GUARDIANS, and STAFF

White Plains High School

Lead Testing of School Drinking Water

05/06/2024

Safe and healthy school environments can foster healthy and successful children. To protect public health, the Public Health Law and New York State Health Department (NYSDOH) regulations require that all public schools and boards of cooperative educational services (BOCES) test lead levels in water from every outlet that is being used, or could potentially be used, for drinking or cooking. If lead is found at any water outlet at levels above 5 parts per billion (ppb), the NYSDOH requires that the school take action to reduce the exposure to lead.

What is first draw testing of school drinking water for lead?

The "on-again, off-again" nature of water use at most schools can raise lead levels in school drinking water. Water that remains in pipes overnight, over a weekend, or over vacation periods stays in contact with lead pipes or lead solder and, as a result, could contain higher levels of lead. This is why schools are required to collect a sample after the water has been sitting in the plumbing system for a certain period of time. This "first draw" sample is likely to show higher levels of lead for that outlet than what you would see if you sampled after using the water continuously. However, even if the first draw sample does not reflect what you would see with continuous usage, it is still important because it can identify outlets that have elevated lead levels.

What are the results of the first draw testing?

White Plains High School – White Plains City School District				
Date	**Sample ID**	**Floor**	**Location**	**Lead Level (ppb)**
4/26/2024	31	P	Pool Level – E1024C – Auxiliary Locker Room Hallway - WF	30.6
4/26/2024	66	FH	Field House – S. Locker Room – WF	5.24

What is being done in response to the results?

Outlets that tested with lead levels above the action level (5 ppb) were removed from service, unless an outlet is a sink faucet needed for handwashing. In that case, a sign was posted at the outlet indicating that the sink is not to be used for drinking. Outlets that tested below the action level remain in service with no restrictions.

The District will institute engineering controls in the form of a routine flushing program to remove any stagnant water which could increase the amount of lead within the water. This flushing program will remain in place until additional testing indicates it is no longer necessary.

What are the health effects of lead?

Lead is a metal that can harm children and adults when it gets into their bodies. Lead is a known neurotoxin, particularly harmful to the developing brain and nervous system of children under 6 years old. Lead can harm a young child's growth, behavior, and ability to learn. Lead exposure during pregnancy may contribute to low birth weight and developmental delays in infants. There are many sources of lead exposure in the environment, and it is important to reduce all lead exposures as much as possible. Water testing helps identify and correct possible sources of lead that contribute to exposure from drinking water.

What are the other sources of lead exposure?

Lead is a metal that has been used for centuries for many purposes, resulting in widespread distribution in the environment. Major sources of lead exposure include lead-based paint in older housing, and lead that built up over decades in soil and dust due to historical use of lead in gasoline, paint, and manufacturing. Lead can also be found in a number of consumer products, including certain types of pottery, pewter, brass fixtures, foods, plumbing materials, and cosmetics. Lead seldom occurs naturally in water supplies but drinking water could become a possible source of lead exposure if the building's plumbing contains lead. The primary source of lead exposure for most children with elevated blood-lead levels is lead-based paint.

Should your child be tested for lead?

The risk to an individual child from past exposure to elevated lead in drinking water depends on many factors; for example, a child's age, weight, amount of water consumed, and the amount of lead in the water. Children may also be exposed to other significant sources of lead including paint, soil and dust. Since blood lead testing is the only way to determine a child's blood lead level, parents should discuss their child's health history with their child's physician to determine if blood lead testing is appropriate. Pregnant women or women of childbearing age should also consider discussing this matter with their physician.

Additional Resources

For more information regarding the testing program or sampling results,
contact *Xavier Hernandez at (914) 422-2206*, or go to our school website:
www.whiteplainspublicschools.org

For information about lead in school drinking water, go to:

http://www.health.ny.gov/environmental/water/drinking/lead/lead_testing_of_school_drinking_water.htm

http://www.p12.nysed.gov/facplan/LeadTestinginSchoolDrinkingWater.html

For information about NYS Department of Health Lead Poisoning Prevention, go to:
http://www.health.ny.gov/environmental/lead/

For more information on blood lead testing and ways to reduce your child's risk of exposure to lead, see "What Your Child's Blood Lead Test Means":
http://www.health.ny.gov/publications/2526/ (available in ten languages).