

---

June 24, 2024

Jeremie Kahler  
Park Hill School District  
9501 N. Seymour Ave,  
Kansas City, MO 64153

**RE: Drinking Water Sampling – Plaza Middle School**  
6501 NW 72<sup>nd</sup> Street, Kansas City, MO 64151  
**Project Number: 923386**

Mr. Kahler,

OCCU-TEC, Inc. (OCCU-TEC) is pleased to present the following report for drinking water sampling completed at Plaza Middle School in Kansas City, Missouri. The sampling was requested and approved by Mr. Jeremie Kahler of Park Hill School District (PHSD). OCCU-TEC completed drinking water sampling of all potential drinking water sources, sources used in food preparation, cleaning, and utensil cleaning. Drinking water sampling was completed in accordance with the requirements set forth in Missouri Senate Bill #681/662 known as the "Get the Lead Out of School Drinking Water Act".

## **METHODOLOGY**

On 12/31/2023 and 5/30/2024 Mr. Cole Dugan and Mr. Jay Hurst, respectively, of OCCU-TEC completed testing of ninety-six (96) sources throughout Plaza Middle School. Samples were collected as 'First Draw' samples after the fixtures had remained unused for a minimum period of eight (8) hours while not exceeding a maximum period of eighteen (18) hours. Samples were collected in dedicated 250 milliliter laboratory-provided plastic sample containers.

Samples were shipped to Pace Analytical Services, LLC (Pace) of Peoria, Illinois for analysis using Environmental Protection Agency (EPA) method 200.8. Pace is approved for sample analysis by the Missouri Department of Natural Resources (MDNR) under certification numbers 00236 and 00870. A copy of the laboratory analytical results and Chain of Custody documentation are attached to this report.

## RESULTS

Samples results were compared to the regulatory limit of 5 parts per billion (ppb) outlined in Missouri Senate Bill 681/662. Of the samples collected, eight (8) of the ninety-six (96) contained lead concentrations at or above 5 ppb. Below is a list of samples containing elevated concentrations of lead.

Sample ID	Location	Type	Result (ug/L)
386-PMS-41	Room 702	Sink	6.08
386-PMS-43	Room 706	Sink	17.2
386-PMS-44	Room 306	Sink	33.2
386-PMS-50	Room 405	Sink	5.38
386-PMS-51	Closet Between 604 & 608	Sink	14.1
386-PMS-60	Room 213	Sink	11.4
386-PMS-68	Room 208 Closet	Sink	9.34
386-PMS-97	Exterior Track	Yard Hydrant	5.97

## LIMITATIONS

At the request of PHSD, Lab sinks, janitorial sinks, eyewash stations, showers, and exterior spigots not identified as drinking water were excluded from sampling. In addition to the excluded sources, the following table identifies sources which were not operational at the time of sampling and therefore not sampled. In accordance with the requirements set forth in Missouri Bill 681/662, all sources not sampled during this assessment should be labeled to indicate that the source is not to be used for drinking water or sampled and compared to the regulatory limit of 5 ppb prior to bringing back into service.

Sample ID	Location	Type
386-PMS-79	Staff Dining Room 102	Ice Machine

## RECOMMENDATIONS

The following recommendations are in accordance with Senate Bill 681/662:

In accordance with the requirements set forth in Missouri Bill 681/662, fixtures exhibiting lead concentrations above 5 ppb must be remediated by replacement of lead-containing pipes, solder, fittings or fixtures with lead-free components, or the school shall install filtration at each point where water enters the building until such time as the source can be remediated. If installing a filter is not feasible, the school shall provide purified water at each outlet inventoried.

Additionally, any water coolers or drinking water outlets identified by the United States Environmental Protection Agency (EPA) as not being lead-free under the federal Lead Contamination Control Act of 1988 shall be replaced unless the unit has been tested and determined to have lead results under 5 ppb.

Within two weeks after receiving test results, the school shall make all testing results and any lead remediation plans available on the school's website. The school shall notify parents and staff via written notification within seven (7) business days after receiving test results exceeding 5 ppb. The notification shall include the following:

- Test results and a summary explaining the results.
- A description of any remedial steps taken.
- A description of the general health effects of lead contamination and community specific resources.
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.

For fixtures exhibiting results above 5 ppb, follow up random "Flush" sampling shall be conducted annually on at least 25 percent of the remediated outlets until all outlets have been remediated. Drinking water sampling shall be conducted annually and annual drinking water test results shall be submitted by the district to the Department of Health and Senior Services (MDHSS).

### **SIGNATURE(S)**

OCCU-TEC appreciates the opportunity to provide the above referenced consulting services to PHSD. If you have any questions regarding the contents of this report, please contact us at (816) 231-5580.

Respectfully,



Jay W. Hurst  
Vice President of Operations

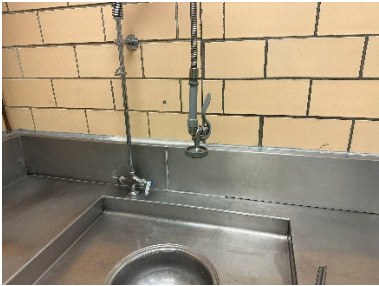



Jeff Smith  
Senior Project Manager (QA/QC)

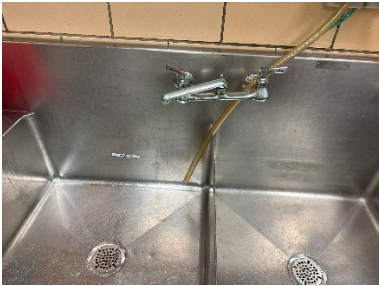
### **ATTACHMENTS**

Outlet Inventory with Analytical Results Summary  
Laboratory Analytical Results and COC Documentation


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-01	Location:	Kitchen	
Photo:		Manufacturer:	T&S Brass	
		Description:		
		Dish Sprayer - Southeast		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-02	Location:	Kitchen	
Photo:		Manufacturer:	Unknown	
		Description:		
		Hand Washing Sink - East Wall		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-03	Location:	Kitchen	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink - East Wall - Left Faucet		
		Result:	3.07	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

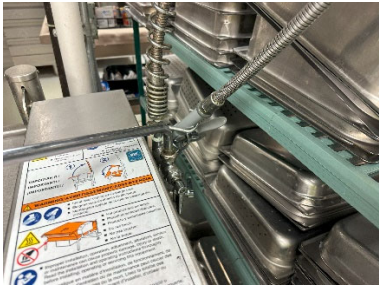
ID:	386-PMS-04	Location:	Kitchen	
Photo:		Manufacturer:	Unknown	
Description:				
Sink - East Wall - Right Faucet				
Result:		<1.0	ppb	
Date Sampled:	12/31/2023	By:	CD	
Recommended Action:				


ID:	386-PMS-05	Location:	Kitchen	
Photo:		Manufacturer:	Unknown	
Description:				
Sink - North Wall				
Result:		<1.0	ppb	
Date Sampled:	12/31/2023	By:	CD	
Recommended Action:				

ID:	386-PMS-06	Location:	Kitchen	
Photo:		Manufacturer:	Unknown	
Description:				
Hand Washing Sink - North Wall				
Result:		<1.0	ppb	
Date Sampled:	12/31/2023	By:	CD	
Recommended Action:				

Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-07	Location:	Kitchen	
Photo:		Manufacturer:	T&S Brass	
		Description:		
		Skillet Faucet		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				


ID:	386-PMS-08	Location:	Kitchen	
Photo:		Manufacturer:	T&S Brass	
		Description:		
		Skillet Dish Sprayer		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				


ID:	386-PMS-09	Location:	Kitchen	
Photo:		Manufacturer:	T&S Brass	
		Description:		
		Sink - West of Skillet		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				




Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-10	Location:	Kitchen RR	
Photo:		Manufacturer:	Delta	
		Description:		
		Hand Washing Sink		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-11	Location:	Cafeteria	
Photo:		Manufacturer:	Unknown	
		Description:		
		Hand Washing Sink - Northeast		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-12	Location:	Cafeteria	
Photo:		Manufacturer:	Unknown	
		Description:		
		Hand Washing Sink - Northwest		
		Result:	2.41	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-13	Location:	Cafeteria	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bubbler		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-14	Location:	Hall By 206	
Photo:		Manufacturer:	Elkay	
		Description:		
		Drinking Fountain Bubbler - PMS DF 005		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-15	Location:	Electrical Rm in 205	
Photo:		Manufacturer:	Unknown	
		Description:		
		Hand Washing Sink		
		Result:	2.12	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				




Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-16	Location:	Rm 203	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink - Left Faucet		
		Result:	1.49	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-17	Location:	Rm 203	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink - Right Faucet		
		Result:	1.13	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-18	Location:	Rm 201	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink		
		Result:	2.6	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-19	Location:	Womens Staff RR By LR		
Photo:		Manufacturer:	Delta		
		Description:			
		Hand Washing Sink			
		Result:	1.06	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					

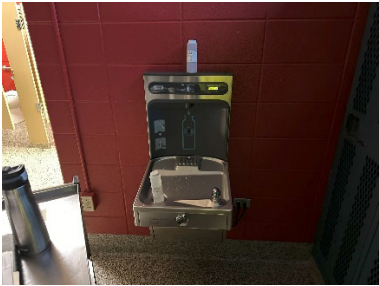
ID:	386-PMS-20	Location:	Mens Staff RR By LR		
Photo:		Manufacturer:	Delta		
		Description:			
		Hand Washing Sink			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					

ID:	386-PMS-21	Location:	Lactation Rm by LR		
Photo:		Manufacturer:	Delta		
		Description:			
		Hand Washing Sink			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					

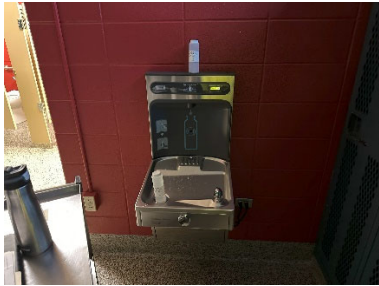
Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-22	Location:	Mens Locker Room RR	
Photo:		Manufacturer:	Delta	
		Description:		
		Hand Washing Sink - Left		
		Result:	1.32	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-23	Location:	Mens Locker Room RR	
Photo:		Manufacturer:	Delta	
		Description:		
		Hand Washing Sink - Right		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-24	Location:	Mens Locker Room	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bubbler		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-25	Location:	Mens Locker Room	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bottle Filler		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-26	Location:	Womens Locker Room	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bubbler		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-27	Location:	Womens Locker Room	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bottle Filler		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

ID:	386-PMS-28	Location:	Womens Locker Rm RR	
Photo:		Manufacturer:	Delta	
		Description:		
		Hand Washing Sink - Left		
		Result:	1.34	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				

ID:	386-PMS-29	Location:	Womens Locker Rm RR	
Photo:		Manufacturer:	Delta	
		Description:		
		Hand Washing Sink - Right		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				


ID:	386-PMS-30	Location:	Main Lobby By Office	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bubbler - PMS DF 001		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				





# Drinking Water Assessment

Plaza Middle School

Park Hill School District


ID:	386-PMS-31	Location:	Main Lobby By Office		
Photo:		Manufacturer:	Halsey Taylor		
		Description:			
		Drinking Fountain Bottle Filler - PMS DF 001			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					


ID:	386-PMS-32	Location:	Hall By Health Room		
Photo:		Manufacturer:	Halsey Taylor		
		Description:			
		Drinking Fountain Bubbler - PMS DF 002			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					


ID:	386-PMS-33	Location:	Hall By Health Room		
Photo:		Manufacturer:	Halsey Taylor		
		Description:			
		Drinking Fountain Bottle Filler - PMS DF 002			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					




Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-34	Location:	Work Room	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink		
		Result:	2.26	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-35	Location:	Health Room	
Photo:		Manufacturer:	Delta	
		Description:		
		Sink		
		Result:	1.82	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-36	Location:	Health Rm RR	
Photo:		Manufacturer:	Delta	
		Description:		
		Hand Washing Sink		
		Result:	1.39	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-37	Location:	Staff Restroom West
Photo:		Manufacturer:	Delta
		Description:	
		Hand Washing Sink	
		Result:	1.65
		Date Sampled:	12/31/2023 By: CD
Recommended Action:			


ID:	386-PMS-38	Location:	Staff Restroom East
Photo:		Manufacturer:	Delta
		Description:	
		Hand Washing Sink	
		Result:	1.43
		Date Sampled:	12/31/2023 By: CD
Recommended Action:			

ID:	386-PMS-39	Location:	Hall By 702
Photo:		Manufacturer:	Halsey Taylor
		Description:	
		Drinking Fountain Bubbler - PMS DF 010	
		Result:	<1.0
		Date Sampled:	12/31/2023 By: CD
Recommended Action:			

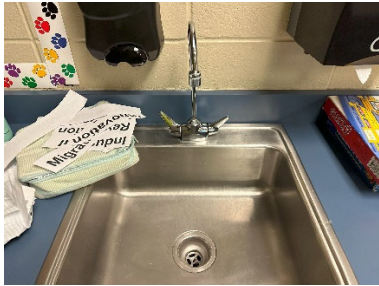
Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-40	Location:	Hall By 702	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bottle Filler - PMS DF 010		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-41	Location:	Rm 702	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink		
		Result:	<b>6.08</b>	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:		<b>Remove from Service / Label</b>		

ID:	386-PMS-42	Location:	Rm 704	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink		
		Result:	3.09	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

ID:	386-PMS-43	Location:	Rm 706		
Photo:		Manufacturer:	Unknown		
		Description:			
		Sink			
		Result:	17.2	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:		Remove from Service / Label			

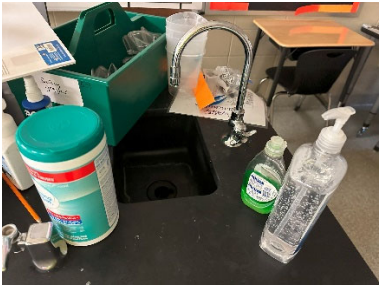
ID:	386-PMS-44	Location:	Rm 306		
Photo:		Manufacturer:	Unknown		
		Description:			
		Sink			
		Result:	33.3	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:		Remove from Service / Label			


ID:	386-PMS-45	Location:	Hall By 306		
Photo:		Manufacturer:	Elkay		
		Description:			
		Drinking Fountain Bubbler - PMS DF 009			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					


Drinking Water Assessment

Plaza Middle School

Park Hill School District


ID:	386-PMS-46	Location:	Rm 602	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink		
		Result:	4.87	ppb
Recommended Action:		Date Sampled:	12/31/2023	By: CD


ID:	386-PMS-47	Location:	Hall By 407	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bubbler - PMS DF 006		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	12/31/2023	By: CD


ID:	386-PMS-48	Location:	Hall By 407	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bottle Filler - PMS DF 006		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	12/31/2023	By: CD



Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

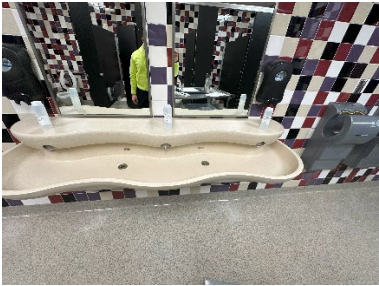
ID:	386-PMS-49	Location:	Rm 405	
Photo:		Manufacturer:	Unknown	
Description:				
Sink - Left				
Result:		2.68	ppb	
Date Sampled:	12/31/2023	By:	CD	
Recommended Action:				

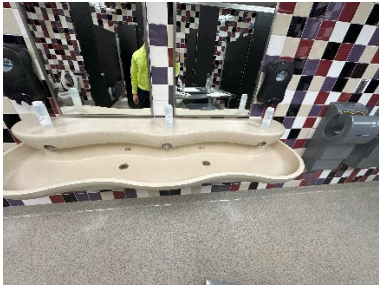
ID:	386-PMS-50	Location:	Rm 405	
Photo:		Manufacturer:	Unknown	
Description:				
Sink - Right				
Result:		5.38	ppb	
Date Sampled:	12/31/2023	By:	CD	
Recommended Action:		Remove from Service / Label		

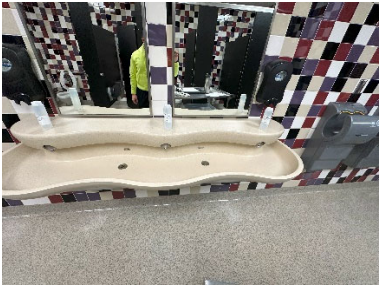
ID:	386-PMS-51	Location:	Closet Btwn 604 & 608	
Photo:		Manufacturer:	Unknown	
Description:				
Sink				
Result:		14.1	ppb	
Date Sampled:	12/31/2023	By:	CD	
Recommended Action:		Replace Fixture/Unit and Resample		




Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

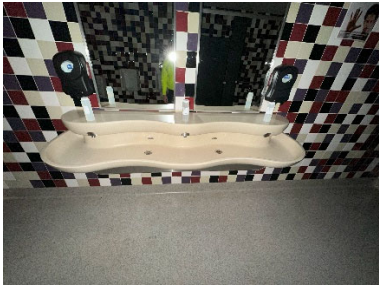
ID:	386-PMS-52	Location:	Womens RR By 500	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Left		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

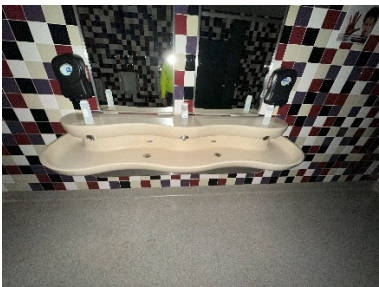
ID:	386-PMS-53	Location:	Womens RR By 500	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Center		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-54	Location:	Womens RR By 500	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Right		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-55	Location:	Mens RR By 500	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Left		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-56	Location:	Mens RR By 500	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Center		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-57	Location:	Mens RR By 500	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Right		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-58	Location:	Hall By 502		
Photo:		Manufacturer:	Halsey Taylor		
		Description:			
		Drinking Fountain Bubbler - PMS DF 008			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					


ID:	386-PMS-59	Location:	Hall By 502		
Photo:		Manufacturer:	Halsey Taylor		
		Description:			
		Drinking Fountain Bottle Filler - PMS DF 008			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					

ID:	386-PMS-60	Location:	Rm 213		
Photo:		Manufacturer:	Unknown		
		Description:			
		Sink			
		Result:	11.4	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:		Remove from Service / Label			


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-61	Location:	Rm 211	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink		
		Result:	3.23	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-62	Location:	Rm 209	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink		
		Result:	1.76	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-63	Location:	Rm 208	
Photo:		Manufacturer:	Chicago Faucet	
		Description:		
		Sink - Kitchen 1		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-64	Location:	Rm 208	
Photo:		Manufacturer:	Chicago Faucet	
		Description:		
		Sink - Kitchen 2		
		Result:	2.08	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-65	Location:	Rm 208	
Photo:		Manufacturer:	Chicago Faucet	
		Description:		
		Sink - Kitchen 3		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-66	Location:	Rm 208	
Photo:		Manufacturer:	Chicago Faucet	
		Description:		
		Sink - Kitchen 4		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				



Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

ID:	386-PMS-67	Location:	Rm 208	
Photo:		Manufacturer:	Chicago Faucet	
		Description:		
		Sink - Kitchen 5		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	12/31/2023	By: CD

ID:	386-PMS-68	Location:	Rm 208 Closet	
Photo:		Manufacturer:	Chicago Faucet	
		Description:		
		Sink		
		Result:	9.34	ppb
Recommended Action:		Date Sampled:	12/31/2023	By: CD


ID:	386-PMS-69	Location:	Rm 206	
Photo:		Manufacturer:	Unknown	
		Description:		
		Sink		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	12/31/2023	By: CD





Drinking Water Assessment

Plaza Middle School


Park Hill School District


ID:	386-PMS-70	Location:	Womens RR By 103		
Photo:		Manufacturer:	Sloan		
		Description:			
		Hand Washing Sink - Left - PMS Sink 001			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					


ID:	386-PMS-71	Location:	Womens RR By 103		
Photo:		Manufacturer:	Sloan		
		Description:			
		Hand Washing Sink - Center- PMS Sink 001			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					

ID:	386-PMS-72	Location:	Womens RR By 103		
Photo:		Manufacturer:	Sloan		
		Description:			
		Hand Washing Sink - Right - PMS Sink 001			
		Result:	<1.0	ppb	
		Date Sampled:	12/31/2023	By:	CD
Recommended Action:					

Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

ID:	386-PMS-73	Location:	Mens RR By 103	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Left - PMS Sink 002		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-74	Location:	Mens RR By 103	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Center - PMS Sink 002		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-75	Location:	Mens RR By 103	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Right - PMS Sink 002		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


Drinking Water Assessment

Plaza Middle School


Park Hill School District


ID:	386-PMS-76	Location:	Hall By Gym	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bubbler - Left - PMS DF 003		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-77	Location:	Hall By Gym	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bubbler - Right - PMS DF 003		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-78	Location:	Hall By Gym	
Photo:		Manufacturer:	Halsey Taylor	
		Description:		
		Drinking Fountain Bottle Filler - PMS DF 003		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-79	Location:	Staff Dining Rm 102
Photo:		Manufacturer:	Scotsman
Description:			
Ice Machine			
NOT WORKING - NOT SAMPLED			
		Result:	N/A
		Date Sampled:	12/31/2023 By: CD
Recommended Action:		Repair and Sample	


ID:	386-PMS-80	Location:	Staff Dining Rm 102
Photo:		Manufacturer:	Hoshizaki
Description:			
Ice Machine			
		Result:	<1.0
		Date Sampled:	12/31/2023 By: CD
Recommended Action:			

ID:	386-PMS-81	Location:	Staff Dining Rm 102
Photo:		Manufacturer:	Chicago Faucet
Description:			
Sink			
		Result:	<1.0
		Date Sampled:	12/31/2023 By: CD
Recommended Action:			

Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-82	Location:	Mens RR By 303	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Left - PMS Sink 006		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-83	Location:	Mens RR By 303	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Center - PMS Sink 006		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


ID:	386-PMS-84	Location:	Mens RR By 303	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Right - PMS Sink 006		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				



Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

ID:	386-PMS-85	Location:	Womens RR By 303	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Left - PMS Sink 007		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				

ID:	386-PMS-86	Location:	Womens RR By 303	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Center - PMS Sink 007		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				


ID:	386-PMS-87	Location:	Womens RR By 303	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Right - PMS Sink 007		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				





Drinking Water Assessment

Plaza Middle School


Park Hill School District

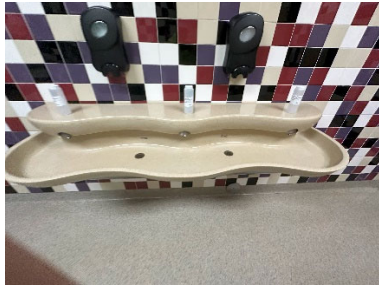
ID:	386-PMS-88	Location:	Rm 305	
Photo:		Manufacturer:	Chicago Faucet	
		Description:		
		Sink		
		Result:	2.14	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

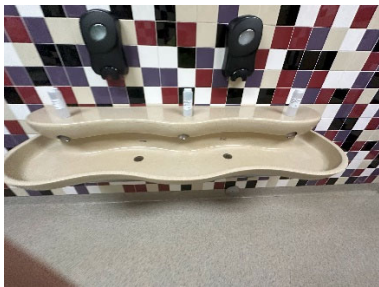
ID:	386-PMS-89	Location:	Hall By 512	
Photo:		Manufacturer:	Murdock	
		Description:		
		Drinking Fountain Bubbler - PMS DF 007		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-90	Location:	Hall By 512	
Photo:		Manufacturer:	Murdock	
		Description:		
		Drinking Fountain Bottle Filler - PMS DF 007		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District


ID:	386-PMS-91	Location:	Mens RR By 213	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Left - PMS Sink 004		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				


ID:	386-PMS-92	Location:	Mens RR By 213	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Center - PMS Sink 004		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				

ID:	386-PMS-93	Location:	Mens RR By 213	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Right - PMS Sink 004		
		Result:	<1.0	ppb
Date Sampled:		12/31/2023	By:	CD
Recommended Action:				


Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

ID:	386-PMS-94	Location:	Womens RR By 213	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Left - PMS Sink 003		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-95	Location:	Womens RR By 213	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Center - PMS Sink 003		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

ID:	386-PMS-96	Location:	Womens RR By 213	
Photo:		Manufacturer:	Sloan	
		Description:		
		Hand Washing Sink - Right - PMS Sink 003		
		Result:	<1.0	ppb
		Date Sampled:	12/31/2023	By: CD
Recommended Action:				

Drinking Water Assessment  
Plaza Middle School  
Park Hill School District

ID:	386-PMS-97	Location:	Ext Track		
Photo:		Manufacturer:	Woodford		
		Description:			
		Yard Hydrant			
		Result:	5.97	ppb	
		Date Sampled:	5/30/2024	By:	JH
Recommended Action:		Replace Fixture/Unit and Resample			



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

January 24, 2024

Jeremie Kahler  
Park Hill School District  
9501 N. Seymour Ave  
MO, MO 64153

RE: 923386 PLAZA MIDDLE SCHOOL

Dear Jeremie Kahler:

Please find enclosed the analytical results for the **95** sample(s) the laboratory received on **1/8/24 10:45 am** and logged in under work order **HA01137**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or [lisa.grant@pacelabs.com](mailto:lisa.grant@pacelabs.com).

A handwritten signature in black ink, appearing to read 'Chenise Lambert-Sykes'.

Chenise Lambert-Sykes  
Project Manager  
(314)432-0550  
[Chenise.Lambert-Sykes@pacelabs.com](mailto:Chenise.Lambert-Sykes@pacelabs.com)



**SAMPLE RECEIPT CHECK LIST**

Items not applicable will be marked as in compliance

---

---

Work Order      HA01137

---

---

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



## ANALYTICAL RESULTS

**Sample:** HA01137-01  
**Name:** 386-PMS-001  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 07:13  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:14	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-02  
**Name:** 386-PMS-002  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 07:16  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:15	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-03  
**Name:** 386-PMS-003  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 07:18  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	3.07	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:17	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-04  
**Name:** 386-PMS-004  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 07:18  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:18	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

Sample: HA01137-05  
Name: 386-PMS-005  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:21  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:23	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-06  
Name: 386-PMS-006  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:23  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:24	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-07  
Name: 386-PMS-007  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:24  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:26	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-08  
Name: 386-PMS-008  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:26  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:28	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

Sample: HA01137-09  
Name: 386-PMS-009  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:28  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:32	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-10  
Name: 386-PMS-010  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:30  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:34	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-11  
Name: 386-PMS-011  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:32  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:14	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-12  
Name: 386-PMS-012  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:34  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	2.41	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:15	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

Sample: HA01137-13  
Name: 386-PMS-013  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:38  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:17	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-14  
Name: 386-PMS-014  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:40  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:18	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-15  
Name: 386-PMS-015  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:43  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	2.12	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:23	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-16  
Name: 386-PMS-016  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:48  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	1.49	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:25	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------





## ANALYTICAL RESULTS

Sample: HA01137-17  
Name: 386-PMS-017  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:48  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	1.13	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:26	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-18  
Name: 386-PMS-018  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:51  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	2.60	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:28	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-19  
Name: 386-PMS-019  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:56  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	1.06	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:32	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-20  
Name: 386-PMS-020  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 07:59  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:34	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

Sample: HA01137-21  
Name: 386-PMS-021  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:01  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:35	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-22  
Name: 386-PMS-022  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:04  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	1.32	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:37	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-23  
Name: 386-PMS-023  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:04  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:38	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-24  
Name: 386-PMS-024  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:07  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:40	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-25  
**Name:** 386-PMS-025  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:07  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:45	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-26  
**Name:** 386-PMS-026  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:13  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:46	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-27  
**Name:** 386-PMS-027  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:13  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:51	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-28  
**Name:** 386-PMS-028  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:16  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	1.34	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:53	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-29  
**Name:** 386-PMS-029  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:16  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:54	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-30  
**Name:** 386-PMS-030  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:22  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:56	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-31  
**Name:** 386-PMS-031  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:22  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:57	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-32  
**Name:** 386-PMS-032  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:26  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 17:59	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

Sample: HA01137-33  
Name: 386-PMS-033  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:26  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 18:00	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-34  
Name: 386-PMS-034  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:31  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	2.26	ug/L		01/22/24 13:05	1	1.00	01/22/24 18:02	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-35  
Name: 386-PMS-035  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:32  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	1.82	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:35	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-36  
Name: 386-PMS-036  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:34  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	1.39	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:37	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------





## ANALYTICAL RESULTS

**Sample:** HA01137-37  
**Name:** 386-PMS-037  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:36  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	1.65	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:38	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-38  
**Name:** 386-PMS-038  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:36  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	1.43	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:40	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-39  
**Name:** 386-PMS-039  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:41  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:41	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-40  
**Name:** 386-PMS-040  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:41  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:43	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

Sample: HA01137-41  
Name: 386-PMS-041  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:47  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	6.08	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:45	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-42  
Name: 386-PMS-042  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:48  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	3.09	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:46	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-43  
Name: 386-PMS-043  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:50  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	17.2	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:51	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-44  
Name: 386-PMS-044  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 08:52  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	33.3	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:52	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-45  
**Name:** 386-PMS-045  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:54  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:57	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-46  
**Name:** 386-PMS-046  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 08:57  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	4.87	ug/L		01/22/24 13:05	1	1.00	01/23/24 09:59	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-47  
**Name:** 386-PMS-047  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:09  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 10:00	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-48  
**Name:** 386-PMS-048  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:09  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 10:02	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-49  
**Name:** 386-PMS-049  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:13  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	2.68	ug/L		01/22/24 13:05	1	1.00	01/23/24 10:03	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-50  
**Name:** 386-PMS-050  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:13  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	5.38	ug/L		01/22/24 13:05	1	1.00	01/23/24 10:05	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-51  
**Name:** 386-PMS-051  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:20  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	14.1	ug/L		01/22/24 13:05	1	1.00	01/23/24 10:10	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-52  
**Name:** 386-PMS-052  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:24  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/23/24 10:11	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-53  
**Name:** 386-PMS-053  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:24  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 18:47	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-54  
**Name:** 386-PMS-054  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:24  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 18:49	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-55  
**Name:** 386-PMS-055  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:28  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 18:54	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-56  
**Name:** 386-PMS-056  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:28  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 18:55	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------





## ANALYTICAL RESULTS

**Sample:** HA01137-57  
**Name:** 386-PMS-057  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:28  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 18:57	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-58  
**Name:** 386-PMS-058  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:34  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 18:58	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-59  
**Name:** 386-PMS-059  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:34  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 13:05	1	1.00	01/22/24 19:00	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-60  
**Name:** 386-PMS-060  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:38  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	11.4	ug/L		01/22/24 13:05	1	1.00	01/22/24 19:01	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

Sample: HA01137-61  
Name: 386-PMS-061  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 09:41  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	3.23	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:16	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-62  
Name: 386-PMS-062  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 09:43  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	1.76	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:19	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-63  
Name: 386-PMS-063  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 09:46  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:20	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-64  
Name: 386-PMS-064  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 09:46  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	2.08	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:22	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-65  
**Name:** 386-PMS-065  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:49  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:30	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-66  
**Name:** 386-PMS-066  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:49  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:31	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-67  
**Name:** 386-PMS-067  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:49  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:33	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-68  
**Name:** 386-PMS-068  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:55  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	9.34	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:34	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-69  
**Name:** 386-PMS-069  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 09:57  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:36	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-70  
**Name:** 386-PMS-070  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:02  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:38	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-71  
**Name:** 386-PMS-071  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:02  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:39	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-72  
**Name:** 386-PMS-072  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:02  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:41	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-73  
**Name:** 386-PMS-073  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:06  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:42	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-74  
**Name:** 386-PMS-074  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:06  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:44	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-75  
**Name:** 386-PMS-075  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:06  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:52	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-76  
**Name:** 386-PMS-076  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:12  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:53	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

Sample: HA01137-77  
Name: 386-PMS-077  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 10:12  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:55	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-78  
Name: 386-PMS-078  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 10:12  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:56	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-79  
Name: 386-PMS-080  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 10:20  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:58	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HA01137-80  
Name: 386-PMS-081  
Matrix: Drinking Water - Regular Sample

Sampled: 12/31/23 10:22  
Received: 01/08/24 10:45  
PO #: PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 10:59	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------





## ANALYTICAL RESULTS

**Sample:** HA01137-81  
**Name:** 386-PMS-082  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:25  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:01	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-82  
**Name:** 386-PMS-083  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:25  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:02	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-83  
**Name:** 386-PMS-084  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:25  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:07	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-84  
**Name:** 386-PMS-085  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:30  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:09	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-85  
**Name:** 386-PMS-086  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:30  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:13	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-86  
**Name:** 386-PMS-087  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:30  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:15	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-87  
**Name:** 386-PMS-088  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:34  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	2.14	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:17	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-88  
**Name:** 386-PMS-089  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:38  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:18	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-89  
**Name:** 386-PMS-080  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:38  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:20	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-90  
**Name:** 386-PMS-091  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:42  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:21	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-91  
**Name:** 386-PMS-092  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:42  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:26	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-92  
**Name:** 386-PMS-093  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:42  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:27	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## ANALYTICAL RESULTS

**Sample:** HA01137-93  
**Name:** 386-PMS-094  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:46  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:29	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-94  
**Name:** 386-PMS-095  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:46  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:31	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

**Sample:** HA01137-95  
**Name:** 386-PMS-096  
**Matrix:** Drinking Water - Regular Sample

**Sampled:** 12/31/23 10:46  
**Received:** 01/08/24 10:45  
**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

**Total Metals - PIA**

Lead	< 1.00	ug/L		01/22/24 14:10	1	1.00	01/23/24 11:35	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



## NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

\* Not a TNI accredited analyte

### Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Chenise Lambert-Sykes, Project Manager

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

## CHAIN OF CUSTODY RECORD

STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT Park Hill School District		PROJECT NUMBER 923386		PROJECT LOCATION Plaza Middle School		PURCHASE ORDER # PMS2324		3 ANALYSIS REQUESTED		4 (FOR LAB USE ONLY) LOGIN # <u>HA01137</u>	
ADDRESS 9501 N. Seymour Ave.		PHONE NUMBER 8163596731		E-MAIL KahlerJ@parkhill.k12.mo.us		DATE SHIPPED 1/4/2024		+ +		LOGGED BY: _____	
CITY STATE ZIP Kansas City, MO 64153		SAMPLER (PLEASE PRINT) Jay Hurst / C Dugan		SAMPLER'S SIGNATURE		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL- OIL SO- SOIL SOL- SOLID		DW Lead		CLIENT: Park Hill School District	
CONTACT PERSON Jeremie Kahler		SAMPLER'S SIGNATURE						Turb Check		PROJECT: Drinking Water Lead	
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED		TIME COLLECTED		SAMPLE TYPE GRAB COMP		MATRIX TYPE		BOTTLE COUNT	
										PRES CODE CLIENT PROVIDED	
386-PMS- 001		12/31/2023		0713		X		DW		1 6 X	
386-PMS- 002		12/31/2023		0716		X		DW		1 6 X	
386-PMS- 003		12/31/2023		0718		X		DW		1 6 X	
386-PMS- 004		12/31/2023		0718		X		DW		1 6 X	
386-PMS- 005		12/31/2023		0721		X		DW		1 6 X	
386-PMS- 006		12/31/2023		0723		X		DW		1 6 X	
386-PMS- 007		12/31/2023		0724		X		DW		1 6 X	
386-PMS- 008		12/31/2023		0726		X		DW		1 6 X	
386-PMS- 009		12/31/2023		0728		X		DW		1 6 X	
386-PMS- 010		12/31/2023		0730		X		DW		1 6 X	
386-PMS- 011		12/31/2023		0732		X		Dw		1 6 X	
CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER											
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) <u>NORMAL</u> RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)				DATE RESULTS NEEDED				6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.			
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE				PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____							
EMAIL IF DIFFERENT FROM ABOVE: _____				PHONE # IF DIFFERENT FROM ABOVE: _____							
7 RELINQUISHED BY: (SIGNATURE) 		DATE 1/4/24 TIME 0800		RECEIVED BY: (SIGNATURE)		DATE		8 COMMENTS: (FOR LAB USE ONLY)			
RELINQUISHED BY: (SIGNATURE)		DATE		RECEIVED BY: (SIGNATURE)		DATE		SAMPLE TEMPERATURE UPON RECEIPT <u>6.7</u> °C			
RELINQUISHED BY: (SIGNATURE)		DATE		RECEIVED BY: (SIGNATURE)		DATE		CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N			
		TIME				TIME		SAMPLE(S) RECEIVED ON ICE Y OR N			
		TIME				TIME		SAMPLE ACCEPTANCE NONCONFORMANT Y OR N			
		TIME				TIME		REPORT IS NEEDED Y OR N			
		TIME				TIME		DATE AND TIME TAKEN FROM SAMPLE BOTTLE			



REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

## CHAIN OF CUSTODY RECORD

STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

<b>1 CLIENT</b> Park Hill School District		<b>PROJECT NUMBER</b> 923386		<b>PROJECT LOCATION</b> Plaza Middle School		<b>PURCHASE ORDER #</b> PMS2324		<b>3 ANALYSIS REQUESTED</b> <div style="display: flex; justify-content: space-between;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">DW Lead</div> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">Turb Check</div> </div>				<b>4 (FOR LAB USE ONLY)</b> LOGIN # <u>HA01137</u> LOGGED BY: _____ CLIENT: <u>Park Hill School District</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____	
<b>ADDRESS</b> 9501 N. Seymour Ave.		<b>PHONE NUMBER</b> 8163596731		<b>E-MAIL</b> KahlerJ@parkhill.k12.mo.us		<b>DATE SHIPPED</b> 1/4/2024							
<b>CITY STATE ZIP</b> Kansas City, MO 64153		<b>SAMPLER (PLEASE PRINT)</b> Jay Hurst / C Dugan		<b>SAMPLER'S SIGNATURE</b> 		<b>MATRIX TYPES:</b> <small>           WW- WASTEWATER            DW- DRINKING WATER            GW- GROUND WATER            WWSL- SLUDGE            NAS- NON AQUEOUS SOLID            LCHT- LEACHATE            OIL- OIL            SO- SOIL            SOL- SOLID         </small>							
<b>CONTACT PERSON</b> Jeremie Kahler													

2 SAMPLE DESCRIPTION <small>(UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)</small>	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE <small>CLIENT PROVIDED</small>	DW Lead	Turb Check									REMARKS
			GRAB	COMP														
386-PMS- 012	12/31/2023	0734	X		DW	1	6	X										
386-PMS- 013	12/31/2023	0738	X		DW	1	6	X										
386-PMS- 014	12/31/2023	0740	X		DW	1	6	X										
386-PMS- 015	12/31/2023	0743	X		DW	1	6	X										
386-PMS- 016	12/31/2023	0748	X		DW	1	6	X										
386-PMS- 017	12/31/2023	0748	X		DW	1	6	X										
386-PMS- 018	12/31/2023	0751	X		DW	1	6	X										
386-PMS- 019	12/31/2023	0756	X		DW	1	6	X										
386-PMS- 020	12/31/2023	0759	X		DW	1	6	X										
386-PMS- 021	12/31/2023	0801	X		DW	1	6	X										
386-PMS- 022	12/31/2023	0804	X		Dw	1	6	X										

CHEMICAL PRESERVATION CODES: 1- HCL 2- H2SO4 3- HNO3 4- NAOH 5- NA2S2O3 6- UNPRESERVED 7- OTHER

**5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE)** NORMAL RUSH  
(RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)  
**RUSH RESULTS VIA (PLEASE CIRCLE)** EMAIL PHONE  
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:

**DATE RESULTS NEEDED**

**6** I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may **NOT** be acceptable to report to all regulatory authorities.  
 PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) \_\_\_\_\_

<b>7 RELINQUISHED BY: (SIGNATURE)</b> 		<b>DATE</b> <u>1/4/24</u> <b>TIME</b> <u>0800</u>		<b>RECEIVED BY: (SIGNATURE)</b> 		<b>DATE</b> <b>TIME</b>		<b>8 COMMENTS: (FOR LAB USE ONLY)</b> SAMPLE TEMPERATURE UPON RECEIPT <u>6.7</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____	
<b>RELINQUISHED BY: (SIGNATURE)</b> 		<b>DATE</b> <b>TIME</b>		<b>RECEIVED BY: (SIGNATURE)</b> 		<b>DATE</b> <b>TIME</b>			
<b>RELINQUISHED BY: (SIGNATURE)</b> 		<b>DATE</b> <b>TIME</b>		<b>RECEIVED BY: (SIGNATURE)</b> 		<b>DATE</b> <u>1/8/24</u> <b>TIME</b> <u>1045</u>			

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

**CHAIN OF CUSTODY RECORD**  
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

<b>1 CLIENT</b> Park Hill School District		<b>PROJECT NUMBER</b> 923386		<b>PROJECT LOCATION</b> Plaza Middle School		<b>PURCHASE ORDER #</b> PMS2324		<b>3 ANALYSIS REQUESTED</b> <div style="display: flex; justify-content: space-between;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">DW Lead</div> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">Turb Check</div> </div>				<b>4 (FOR LAB USE ONLY)</b> LOGIN # <u>H1A01137</u> LOGGED BY: _____ CLIENT: <u>Park Hill School District</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____	
<b>ADDRESS</b> 9501 N. Seymour Ave.		<b>PHONE NUMBER</b> 8163596731		<b>E-MAIL</b> KahlerJ@parkhill.k12.mo.us		<b>DATE SHIPPED</b> 1/4/2024							
<b>CITY STATE ZIP</b> Kansas City, MO 64153		<b>SAMPLER (PLEASE PRINT)</b> Jay Hurst / C Dugan		<b>SAMPLER'S SIGNATURE</b> 		<b>MATRIX TYPES:</b> WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOIL SOL- SOLID							
<b>CONTACT PERSON</b> Jeremie Kahler													

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE <small>GRAB COMP</small>	MATRIX TYPE	BOTTLE COUNT	PRES CODE <small>CLIENT PROVIDED</small>	DW Lead	Turb Check	REMARKS
386-PMS- 023		12/31/2023	0804	X	DW	1	6	X		
386-PMS- 024		12/31/2023	0807	X	DW	1	6	X		
386-PMS- 025		12/31/2023	0807	X	DW	1	6	X		
386-PMS- 026		12/31/2023	0813	X	DW	1	6	X		
386-PMS- 027		12/31/2023	0813	X	DW	1	6	X		
386-PMS- 028		12/31/2023	0816	X	DW	1	6	X		
386-PMS- 029		12/31/2023	0816	X	DW	1	6	X		
386-PMS- 030		12/31/2023	0822	X	DW	1	6	X		
386-PMS- 031		12/31/2023	0822	X	DW	1	6	X		
386-PMS- 032		12/31/2023	0826	X	DW	1	6	X		
386-PMS- 033		12/31/2023	0826	X	DW	1	6	X		

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER							
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) <b>NORMAL</b> RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:				6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may <u>NOT</u> be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____			

7 RELINQUISHED BY: (SIGNATURE) 		DATE <u>1/4/24</u> TIME <u>0800</u>		RECEIVED BY: (SIGNATURE) 		DATE TIME		8 COMMENTS: (FOR LAB USE ONLY)  SAMPLE TEMPERATURE UPON RECEIPT <u>6.7</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE	
RELINQUISHED BY: (SIGNATURE)		DATE TIME		RECEIVED BY: (SIGNATURE)		DATE TIME			
RELINQUISHED BY: (SIGNATURE)		DATE TIME		RECEIVED BY: (SIGNATURE) 		DATE <u>1/8/24</u> TIME <u>1045</u>			

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

**CHAIN OF CUSTODY RECORD**  
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

<b>1 CLIENT</b> Park Hill School District		<b>PROJECT NUMBER</b> 923386		<b>PROJECT LOCATION</b> Plaza Middle School		<b>PURCHASE ORDER #</b> PMS2324		<b>3 ANALYSIS REQUESTED</b> <div style="display: flex; justify-content: space-between;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">DW Lead</div> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">Turb Check</div> </div>				<b>4 (FOR LAB USE ONLY)</b> LOGIN # <u>HA01137</u> LOGGED BY: _____ CLIENT: <u>Park Hill School District</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____	
<b>ADDRESS</b> 9501 N. Seymour Ave.		<b>PHONE NUMBER</b> 8163596731		<b>E-MAIL</b> KahlerJ@parkhill.k12.mo.us		<b>DATE SHIPPED</b> 1/4/2024							
<b>CITY STATE ZIP</b> Kansas City, MO 64153		<b>SAMPLER (PLEASE PRINT)</b> Jay Hurst / C Dugan		<b>SAMPLER'S SIGNATURE</b> 		<b>MATRIX TYPES:</b> WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOIL SOL- SOLID							
<b>CONTACT PERSON</b> Jeremie Kahler													

2	SAMPLE DESCRIPTION <small>(UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)</small>	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE <small>CLIENT PROVIDED</small>	DW Lead	Turb Check							REMARKS
				GRAB	COMP												
	386-PMS-034	12/31/2023	0831	X		DW	1	6	X								
	386-PMS-035	12/31/2023	0832	X		DW	1	6	X								
	386-PMS-036	12/31/2023	0834	X		DW	1	6	X								
	386-PMS-037	12/31/2023	0836	X		DW	1	6	X								
	386-PMS-038	12/31/2023	0836	X		DW	1	6	X								
	386-PMS-039	12/31/2023	0841	X		DW	1	6	X								
	386-PMS-040	12/31/2023	0841	X		DW	1	6	X								
	386-PMS-041	12/31/2023	0847	X		DW	1	6	X								
	386-PMS-042	12/31/2023	0848	X		DW	1	6	X								
	386-PMS-043	12/31/2023	0850	X		DW	1	6	X								
	386-PMS-044	12/31/2023	0852	X		Dw	1	6	X								

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER

<b>5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE)</b> (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) NORMAL <input checked="" type="radio"/> RUSH <input type="radio"/> RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL <input type="radio"/> PHONE <input type="radio"/> EMAIL IF DIFFERENT FROM ABOVE: _____ PHONE # IF DIFFERENT FROM ABOVE: _____	<b>DATE RESULTS NEEDED</b> _____	<b>6</b> I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may <u>NOT</u> be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____
--	-------------------------------------	---

<b>7 RELINQUISHED BY: (SIGNATURE)</b> 		<b>DATE</b> <u>1/4/24</u> <b>TIME</b> <u>0800</u>		<b>RECEIVED BY: (SIGNATURE)</b> 		<b>DATE</b> _____ <b>TIME</b> _____	
<b>RELINQUISHED BY: (SIGNATURE)</b> _____		<b>DATE</b> _____ <b>TIME</b> _____		<b>RECEIVED BY: (SIGNATURE)</b> _____		<b>DATE</b> _____ <b>TIME</b> _____	
<b>RELINQUISHED BY: (SIGNATURE)</b> _____		<b>DATE</b> _____ <b>TIME</b> _____		<b>RECEIVED BY: (SIGNATURE)</b> 		<b>DATE</b> <u>1/5/24</u> <b>TIME</b> <u>1045</u>	

<b>8 COMMENTS: (FOR LAB USE ONLY)</b> _____ _____ SAMPLE TEMPERATURE UPON RECEIPT <u>6.7</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT <input type="checkbox"/> Y OR <input checked="" type="checkbox"/> N SAMPLE(S) RECEIVED ON ICE <input type="checkbox"/> Y OR <input checked="" type="checkbox"/> N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED <input type="checkbox"/> Y OR <input checked="" type="checkbox"/> N DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____
---



REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

# CHAIN OF CUSTODY RECORD

STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

<b>1 CLIENT</b> Park Hill School District		<b>PROJECT NUMBER</b> 923386		<b>PROJECT LOCATION</b> Plaza Middle School		<b>PURCHASE ORDER #</b> PMS2324		<b>3 ANALYSIS REQUESTED</b> <div style="display: flex; justify-content: space-between;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">DW Lead</div> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">Turb Check</div> </div>				<b>4 (FOR LAB USE ONLY)</b> LOGIN # <u>HA01137</u> LOGGED BY: _____ CLIENT: <u>Park Hill School District</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____	
<b>ADDRESS</b> 9501 N. Seymour Ave.		<b>PHONE NUMBER</b> 8163596731		<b>E-MAIL</b> KahlerJ@parkhill.k12.mo.us		<b>DATE SHIPPED</b> 1/4/2024							
<b>CITY STATE ZIP</b> Kansas City, MO 64153		<b>SAMPLER (PLEASE PRINT)</b> Jay Hurst / C Dugan				<b>MATRIX TYPES:</b> WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOIL SOL- SOLID							
<b>CONTACT PERSON</b> Jeremie Kahler		<b>SAMPLER'S SIGNATURE</b> 											
<b>2 SAMPLE DESCRIPTION</b> <small>(UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)</small>		<b>DATE COLLECTED</b>	<b>TIME COLLECTED</b>	<b>SAMPLE TYPE</b> <small>GRAB COMP</small>	<b>MATRIX TYPE</b>	<b>BOTTLE COUNT</b>	<b>PRES CODE</b> <small>CLIENT PROVIDED</small>					<b>REMARKS</b>	
386-PMS- <u>045</u>		12/31/2023	0854	X	DW	1	6	X					
386-PMS- <u>046</u>		12/31/2023	0857	X	DW	1	6	X					
386-PMS- <u>047</u>		12/31/2023	0909	X	DW	1	6	X					
386-PMS- <u>048</u>		12/31/2023	0904	X	DW	1	6	X					
386-PMS- <u>049</u>		12/31/2023	0913	X	DW	1	6	X					
386-PMS- <u>050</u>		12/31/2023	0913	X	DW	1	6	X					
386-PMS- <u>051</u>		12/31/2023	0920	X	DW	1	6	X					
386-PMS- <u>052</u>		12/31/2023	0924	X	DW	1	6	X					
386-PMS- <u>053</u>		12/31/2023	0924	X	DW	1	6	X					
386-PMS- <u>054</u>		12/31/2023	0924	X	DW	1	6	X					
386-PMS- <u>055</u>		12/31/2023	0928	X	DW	1	6	X					
<b>CHEMICAL PRESERVATION CODES:</b> 1 - HCL    2 - H2SO4    3 - HNO3    4 - NAOH    5 - NA2S2O3    6 - UNPRESERVED    7 - OTHER													
<b>5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE)</b> <u>NORMAL</u> RUSH <small>(RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)</small> <b>RUSH RESULTS VIA (PLEASE CIRCLE)</b> EMAIL    PHONE EMAIL IF DIFFERENT FROM ABOVE: _____ PHONE # IF DIFFERENT FROM ABOVE: _____						<b>DATE RESULTS NEEDED</b>		<b>6</b> I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____					
<b>7 RELINQUISHED BY: (SIGNATURE)</b> 		<b>DATE</b> 1/4/24 <b>TIME</b> 0800		<b>RECEIVED BY: (SIGNATURE)</b>  				<b>DATE</b>  <b>TIME</b> 		<b>8 COMMENTS: (FOR LAB USE ONLY)</b>  			
<b>RELINQUISHED BY: (SIGNATURE)</b>  		<b>DATE</b>  <b>TIME</b> 		<b>RECEIVED BY: (SIGNATURE)</b>  				<b>DATE</b>  <b>TIME</b> 		<b>SAMPLE TEMPERATURE UPON RECEIPT</b> <u>6.7</u> °C			
<b>RELINQUISHED BY: (SIGNATURE)</b>  		<b>DATE</b>  <b>TIME</b> 		<b>RECEIVED BY: (SIGNATURE)</b> 				<b>DATE</b> 1/8/24 <b>TIME</b> 1045		CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____			

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

**CHAIN OF CUSTODY RECORD**  
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)




1 CLIENT Park Hill School District		PROJECT NUMBER 923386		PROJECT LOCATION Plaza Middle School		PURCHASE ORDER # PMS2324		3 ANALYSIS REQUESTED		4 (FOR LAB USE ONLY) LOGIN # <u>HA01137</u>	
ADDRESS 9501 N. Seymour Ave.		PHONE NUMBER 8163596731		E-MAIL Kahler.J@parkhill.k12.mo.us		DATE SHIPPED 1/4/2024		+ +		LOGGED BY: _____	
CITY STATE ZIP Kansas City, MO 64153		SAMPLER (PLEASE PRINT) Jay Hurst / C Dugan		SAMPLER'S SIGNATURE 		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL- OIL SO- SOIL SOL- SOLID		DW Lead		CLIENT: Park Hill School District	
CONTACT PERSON Jeremie Kahler		SAMPLER'S SIGNATURE 		MATRIX TYPE		BOTTLE COUNT		PRES CODE CLIENT PROVIDED		PROJECT: Drinking Water Lead	
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED		TIME COLLECTED		SAMPLE TYPE GRAB COMP		MATRIX TYPE		PROJ. MGR.: Chenise Lambert-Sykes	
386-PMS- 056		12/31/2023		0928		X		DW		CUSTODY SEAL #: _____	
386-PMS- 057		12/31/2023		0928		X		DW		REMARKS	
386-PMS- 058		12/31/2023		0934		X		DW			
386-PMS- 059		12/31/2023		0934		X		DW			
386-PMS- 060		12/31/2023		0938		X		DW			
386-PMS- 061		12/31/2023		0941		X		DW			
386-PMS- 062		12/31/2023		0943		X		DW			
386-PMS- 063		12/31/2023		0946		X		DW			
386-PMS- 064		12/31/2023		0946		X		DW			
386-PMS- 065		12/31/2023		0949		X		DW			
386-PMS- 066		12/31/2023		0949		X		Dw			
CHEMICAL PRESERVATION CODES: 1- HCL 2- H2SO4 3- HNO3 4- NAOH 5- NA2S2O3 6- UNPRESERVED 7- OTHER											
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) <u>NORMAL</u> RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)				DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.					
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE				PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____							
7 RELINQUISHED BY: (SIGNATURE) 		DATE 1/4/24		TIME 0800		RECEIVED BY: (SIGNATURE)		DATE		8 COMMENTS: (FOR LAB USE ONLY)	
RELINQUISHED BY: (SIGNATURE)		DATE		TIME		RECEIVED BY: (SIGNATURE)		DATE		SAMPLE TEMPERATURE UPON RECEIPT <u>67</u> °C	
RELINQUISHED BY: (SIGNATURE)		DATE		TIME		RECEIVED BY: (SIGNATURE) 		DATE 1/8/24		CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N	
		DATE		TIME				DATE 1/8/24		DATE AND TIME TAKEN FROM SAMPLE BOTTLE 1045	

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

# CHAIN OF CUSTODY RECORD

STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

<b>1 CLIENT</b> Park Hill School District		<b>PROJECT NUMBER</b> 923386		<b>PROJECT LOCATION</b> Plaza Middle School		<b>PURCHASE ORDER #</b> PMS2324		<b>3 ANALYSIS REQUESTED</b> <div style="display: flex; justify-content: space-around;"> <div style="text-align: center;">+ DW Lead</div> <div style="text-align: center;">+ Turb Check</div> </div>		<b>4 (FOR LAB USE ONLY)</b> LOGIN # <u>HA01137</u> LOGGED BY: _____ CLIENT: <u>Park Hill School District</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____	
<b>ADDRESS</b> 9501 N. Seymour Ave.		<b>PHONE NUMBER</b> 8163596731		<b>E-MAIL</b> KahlerJ@parkhill.k12.mo.us		<b>DATE SHIPPED</b> 1/4/2024					
<b>CITY STATE ZIP</b> Kansas City, MO 64153		<b>SAMPLER (PLEASE PRINT)</b> Jay Hurst / C Dugan		<b>SAMPLER'S SIGNATURE</b> 		<b>MATRIX TYPES:</b> WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOIL SOL- SOLID					
<b>CONTACT PERSON</b> Jeremie Kahler											
<b>2 SAMPLE DESCRIPTION</b> (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		<b>DATE COLLECTED</b>	<b>TIME COLLECTED</b>	<b>SAMPLE TYPE</b> GRAB COMP	<b>MATRIX TYPE</b>	<b>BOTTLE COUNT</b>	<b>PRES CODE</b> CLIENT PROVIDED	<b>DW Lead</b>	<b>Turb Check</b>	<b>REMARKS</b>	
386-PMS-067		12/31/2023	0949	X	DW	1	6	X			
386-PMS-068		12/31/2023	0955	X	DW	1	6	X			
386-PMS-069		12/31/2023	0957	X	DW	1	6	X			
386-PMS-070		12/31/2023	1002	X	DW	1	6	X			
386-PMS-071		12/31/2023	1002	X	DW	1	6	X			
386-PMS-072		12/31/2023	1002	X	DW	1	6	X			
386-PMS-073 073		12/31/2023	1006	X	DW	1	6	X			
386-PMS-074		12/31/2023	1006	X	DW	1	6	X			
386-PMS-075		12/31/2023	1006	X	DW	1	6	X			
386-PMS-076		12/31/2023	1012	X	DW	1	6	X			
386-PMS-077		12/31/2023	1012	X	Dw	1	6	X			
<b>CHEMICAL PRESERVATION CODES:</b> 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER											
<b>5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE)</b> <u>NORMAL</u> RUSH RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:				<b>DATE RESULTS NEEDED</b>		<b>6</b> I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may <u>NOT</u> be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____					
<b>7 RELINQUISHED BY: (SIGNATURE)</b> 		<b>DATE</b> <u>1/4/2024</u> <b>TIME</b> <u>0800</u>		<b>RECEIVED BY: (SIGNATURE)</b> 		<b>DATE</b> <b>TIME</b>		<b>8 COMMENTS: (FOR LAB USE ONLY)</b> SAMPLE TEMPERATURE UPON RECEIPT <u>7.6</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N <u>Y</u> SAMPLE(S) RECEIVED ON ICE Y OR N <u>Y</u> SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N <u>Y</u> DATE AND TIME TAKEN FROM SAMPLE BOTTLE <u>1/8/24 1045</u>			
<b>RELINQUISHED BY: (SIGNATURE)</b>		<b>DATE</b> <b>TIME</b>		<b>RECEIVED BY: (SIGNATURE)</b>		<b>DATE</b> <b>TIME</b>					
<b>RELINQUISHED BY: (SIGNATURE)</b>		<b>DATE</b> <b>TIME</b>		<b>RECEIVED BY: (SIGNATURE)</b>		<b>DATE</b> <b>TIME</b>					





Pace Analytical Services  
WWW.PACELABS.COM

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

## CHAIN OF CUSTODY RECORD

STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

<b>1</b> CLIENT Park Hill School District		PROJECT NUMBER 923386		PROJECT LOCATION Plaza Middle School		PURCHASE ORDER # PMS2324		<b>3</b> ANALYSIS REQUESTED		<b>4</b> (FOR LAB USE ONLY) H1401137	
ADDRESS 9501 N. Seymour Ave.		PHONE NUMBER 8163596731		E-MAIL Kahler.J@parkhill.k12.mo.us		DATE SHIPPED 1/4/2024		<input checked="" type="checkbox"/> DW Lead <input checked="" type="checkbox"/> Turb Check		LOGIN # LOGGED BY: CLIENT: Park Hill School District PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:	
CITY STATE ZIP Kansas City, MO 64153		SAMPLER (PLEASE PRINT) Jay Hurst / C Dugan		SAMPLER'S SIGNATURE 		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOIL SOL- SOLID					
<b>2</b> SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB COMP		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED			REMARKS
386-PMS-078		12/31/2023	1012	X		DW	1	6	X		
386-PMS-080		12/31/2023	1020	X		DW	1	6	X		
386-PMS-081		12/31/2023	1022	X		DW	1	6	X		
386-PMS-082		12/31/2023	1025	X		DW	1	6	X		
386-PMS-083		12/31/2023	1025	X		DW	1	6	X		
386-PMS-084		12/31/2023	1025	X		DW	1	6	X		
386-PMS-085		12/31/2023	1030	X		DW	1	6	X		
386-PMS-086		12/31/2023	1030	X		DW	1	6	X		
386-PMS-087		12/31/2023	1030	X		DW	1	6	X		
386-PMS-088		12/31/2023	1034	X		DW	1	6	X		
386-PMS-089		12/31/2023	1038	X		Dw	1	6	X		
CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER											
<b>5</b> TURNAROUND TIME REQUESTED (PLEASE CIRCLE) <u>NORMAL</u> RUSH		DATE RESULTS NEEDED		<b>6</b> I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may <u>NOT</u> be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____							
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE		EMAIL IF DIFFERENT FROM ABOVE:		PHONE # IF DIFFERENT FROM ABOVE:							
<b>7</b> RELINQUISHED BY: (SIGNATURE) 		DATE 1/4/27 TIME 0800		RECEIVED BY: (SIGNATURE) 		DATE TIME		<b>8</b> COMMENTS: (FOR LAB USE ONLY)			
RELINQUISHED BY: (SIGNATURE)		DATE TIME		RECEIVED BY: (SIGNATURE)		DATE TIME		SAMPLE TEMPERATURE UPON RECEIPT <u>6-7</u> °C			
RELINQUISHED BY: (SIGNATURE)		DATE TIME		RECEIVED BY: (SIGNATURE) 		DATE 1/8/27 TIME 1045		CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE			

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

## CHAIN OF CUSTODY RECORD

STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

<b>1 CLIENT</b> Park Hill School District		<b>PROJECT NUMBER</b> 923386		<b>PROJECT LOCATION</b> Plaza Middle School		<b>PURCHASE ORDER #</b> DMS2324		<b>3 ANALYSIS REQUESTED</b> <div style="display: flex; justify-content: space-between;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">DW Lead</div> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">Turb Check</div> </div>				<b>4 (FOR LAB USE ONLY)</b> LOGIN # <u>HA01137</u> LOGGED BY: _____ CLIENT: <u>Park Hill School District</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____	
<b>ADDRESS</b> 9501 N. Seymour Ave.		<b>PHONE NUMBER</b> 8163596731		<b>E-MAIL</b> KahlerJ@parkhill.k12.mo.us		<b>DATE SHIPPED</b> 1/4/2024							
<b>CITY STATE ZIP</b> Kansas City, MO 64153		<b>SAMPLER (PLEASE PRINT)</b> Jay Hurst / C Dugan		<b>SAMPLER'S SIGNATURE</b> 		<b>MATRIX TYPES:</b> <small>           WW- WASTEWATER            DW- DRINKING WATER            GW- GROUND WATER            WWSL- SLUDGE            NAS- NON AQUEOUS SOLID            LCL- LEACHATE            OIL- OIL            SO- SOIL            SOL- SOLID         </small>							
<b>CONTACT PERSON</b> Jeremie Kahler													
<b>2 SAMPLE DESCRIPTION</b> <small>(UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)</small>		<b>DATE COLLECTED</b>	<b>TIME COLLECTED</b>	<b>SAMPLE TYPE</b> <small>GRAB COMP</small>	<b>MATRIX TYPE</b>	<b>BOTTLE COUNT</b>	<b>PRES CODE</b> <small>CLIENT PROVIDED</small>					<b>REMARKS</b>	
386-PMS- 090		12/31/2023	1038	X	DW	1	6	X					
386-PMS- 091		12/31/2023	1042	X	DW	1	6	X					
386-PMS- 092		12/31/2023	1042	X	DW	1	6	X					
386-PMS- 093		12/31/2023	1042	X	DW	1	6	X					
386-PMS- 094		12/31/2023	1046	X	DW	1	6	X					
386-PMS- 095		12/31/2023	1046	X	DW	1	6	X					
386-PMS- 096		12/31/2023	1046	X	DW	1	6	X					
386-PMS-		12/31/2023		X	DW	1	6	X					
386-PMS-		12/31/2023		X	DW	1	6	X					
386-PMS-		12/31/2023		X	DW	1	6	X					
386-PMS-		12/31/2023		X	Dw	1	6	X					
<b>CHEMICAL PRESERVATION CODES:</b>		1 - HCL	2 - H2SO4	3 - HNO3	4 - NAOH	5 - NA2S2O3	6 - UNPRESERVED	7 - OTHER					
<b>5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE)</b> (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) NORMAL RUSH <b>RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE</b> EMAIL IF DIFFERENT FROM ABOVE: _____ PHONE # IF DIFFERENT FROM ABOVE: _____		<b>DATE RESULTS NEEDED</b>		<b>6</b> I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____									
<b>RELINQUISHED BY: (SIGNATURE)</b> 		<b>DATE</b> 1/4/24	<b>RECEIVED BY: (SIGNATURE)</b> 		<b>DATE</b>		<b>8 COMMENTS: (FOR LAB USE ONLY)</b>						
<b>RELINQUISHED BY: (SIGNATURE)</b> 		<b>TIME</b> 0800	<b>RECEIVED BY: (SIGNATURE)</b> 		<b>TIME</b>		<b>SAMPLE TEMPERATURE UPON RECEIPT</b> <span style="border: 1px solid black; padding: 2px;">6.7</span> °C						
<b>RELINQUISHED BY: (SIGNATURE)</b> 		<b>DATE</b>	<b>RECEIVED BY: (SIGNATURE)</b> 		<b>DATE</b> 1/8/24		<b>CHILL PROCESS STARTED PRIOR TO RECEIPT</b> Y OR N <b>SAMPLE(S) RECEIVED ON ICE</b> Y OR N <b>SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED</b> Y OR N						
		<b>TIME</b>			<b>TIME</b> 1045		<b>DATE AND TIME TAKEN FROM SAMPLE BOTTLE</b>						



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

June 07, 2024

Jeremie Kahler  
Park Hill School District  
9501 N. Seymour Ave  
MO, MO 64153

RE: 923386-Plaza Middle School

Dear Jeremie Kahler:

Please find enclosed the analytical results for the **1** sample(s) the laboratory received on **6/3/24 10:45 am** and logged in under work order **HF00110**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or [lisa.grant@pacelabs.com](mailto:lisa.grant@pacelabs.com).

A handwritten signature in black ink, appearing to read 'Chenise Lambert-Sykes'.

Chenise Lambert-Sykes  
Project Manager  
(314)432-0550  
[Chenise.Lambert-Sykes@pacelabs.com](mailto:Chenise.Lambert-Sykes@pacelabs.com)



**SAMPLE RECEIPT CHECK LIST**

Items not applicable will be marked as in compliance

---

Work Order      HF00110

---

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

## ANALYTICAL RESULTS

**Sample:** HF00110-01

**Name:** 386-PMS-97

**Matrix:** Drinking Water - Grab

**Sampled:** 05/30/24 08:55

**Received:** 06/03/24 10:45

**PO #:** PMS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
<b><u>Total Metals - PIA</u></b>									
Lead	5.97	ug/L		06/05/24 11:29	1	1.00	06/05/24 18:28	BRS	EPA 200.8 REV 5.4



## NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

\* Not a TNI accredited analyte

### Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Chenise Lambert-Sykes, Project Manager



STATE WHERE SAMPLE COLLECTED MOPAGE 7 OF 7 3/3/2021

for ex