

Advantage Environmental Incorporated

Post Asbestos Removal Preliminary Air Clearance Sampling Information

Date 2/3/24

Advantage Environmental, Inc. (AEI) conducted PCM post asbestos abatement clearance air

sampling on (date) 2/3/24.

This post abatement clearance air sampling took place in work areas: Rm # 1, 4, 6, 10 & 12
15777 Boones Ferry Rd, Lake Oswego, OR 97035

Clearance samples were collected and analyzed by Advantage Environmental, Inc. Technician

Frankie Kuntz, a NIOSH 582 or equivalent certified analyst. Samples were analyzed by phase contrast microscopy utilizing the NIOSH 7400 method.

Circle one

Sampling was completed aggressively as per Oregon DEQ requirements:

☒ Yes

No

NA

Sampling was completed as per WAC 296-62-07709 requirements:

Yes

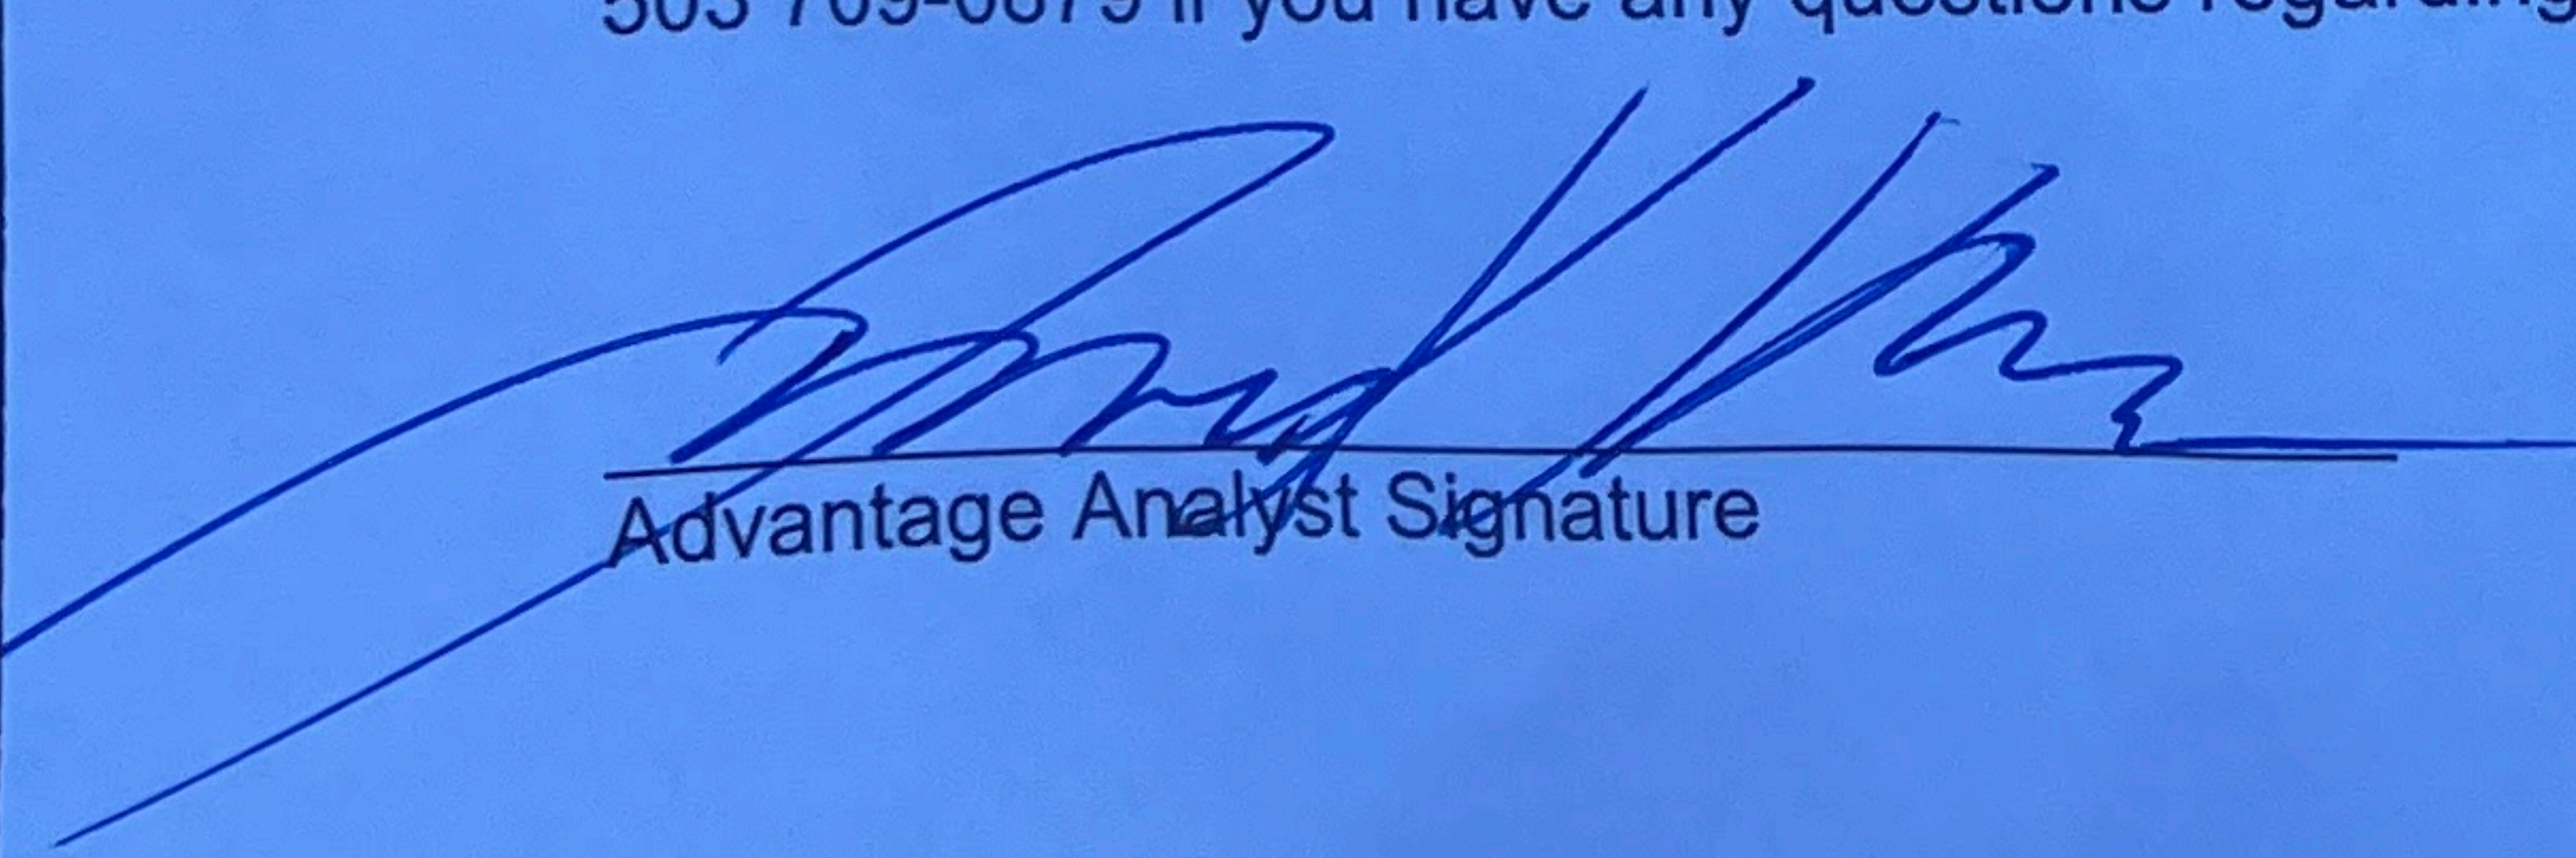
No

☒ NA

Sample/s were collected utilizing 25mm mixed cellulose-ester filter cassettes with a 50mm extension cowl. Sampling pumps were calibrated to flow rates specified by OSHA 29 CFR Parts 1910 and 1926, Occupational Exposure to Asbestos; Actinolite, Amosite, Anthophyllite, Chrysotile, Crocidolite, Tremolite Final Rules dated June 29, 1995.

Sample results indicate that airborne asbestos fibers inside the areas sampled are below the required limit of 0.01 fibers per cubic centimeter of air.

Thank you for choosing Advantage Environmental for this project. Please feel free to contact us at 503 709-0879 if you have any questions regarding this preliminary report.


Advantage Analyst Signature