

The Lotis Engineering Group, P.C.

6465 Transit Road – Suite 23
East Amherst, New York 14051-2232
716.276.8707

December 6, 2016

Mr. James V. Rozler II
Grand Island Central School District
2451 Baseline Road
Grand Island, New York 14072

Re: Lead Testing in School Drinking Water
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Dear Mr. Rozler:

On September 6, 2016, Governor Andrew M. Cuomo signed legislation (S.8158/A.10740) mandating that public schools in New York State test potable water for lead contamination. The New York State Department of Health (NYSDOH) also issued emergency regulations pursuant to the new legislation (NYCRR Title X, Subpart 67-4).

In accordance with the new law and regulations, the Grand Island Central School District (District) contracted The Lotis Engineering Group, P.C. (Lotis), to complete water testing in all district schools. This submission summarizes the analytical results of sampling completed on October 26, 2016 at Grand Island Senior High School.

Maintenance closets and showers are not required to be tested under the new state mandates and were not included under this scope of work. Per the emergency regulations issued by the NYSDOH, first-draw samples were collected from cold water outlets after water lay motionless in the pipes for a minimum of 8 hours, but not more than 18 hours. The school district was responsible for flushing outlets at least 8 hours prior to sample collection. Lotis was notified by the school district that flushing was completed over 8 hours prior to sampling. However, this could not be independently verified by Lotis.

Samples were collected by placing a sterile container under each outlet and turning on the water source, allowing Lotis to collect a first-draw cold water sample. Samples were collected in clean 250 mL containers containing the appropriate nitric acid preservative, as provided by the testing laboratory. Samples were then delivered to Microbac Laboratories (a certified Environmental Laboratory Approved Program) following standard chain of custody protocols.

The Lotis Engineering Group, P.C.

6465 Transit Road – Suite 23
East Amherst, New York 14051-2232
716.276.8707

A total of 278 outlets were sampled inside the building. To Lotis' knowledge, these represent every outlet within the building to which students and staff have regular access, with the exception of the following:

Table 1 – Outlets Not Sampled

Sample Location	Reason For Not Sampling
Three sinks in the girl's team locker room	Sink not in service
Girl's Bathroom Second Sink from the Door)	Sink not in service
Classroom 218 sink	Sink not in service
Girls bathroom by Room 223 first three sinks	Sinks not in service
Boys bathroom by Room 223 first three sinks	Sinks not in service

At Grand Island Senior High School, 27 samples exceeded the 15 parts per billion (ppb) action level set forth by the NYSDOH. A summary of these samples is included in the following table:

Table 2 – Samples Exceeding 15 ppb

Sample ID	Location Details	Results (ppb)
3A-GIH-123B-S1	Room 123B north sink – left faucet	18.6
5A-GIH-123B-WF1	Room 123B Water fountain	37.3
11A-GIH-Pool-WF1	Water fountain in pool area by girl's locker room	19.2
12A-GIH-Pool-WF2	Water fountain in pool area by boy's locker room	19.6
36A-GIH-113-BTLR- spigot	Room 113 spigot	15.3
41A-GIH-112-BTL-S1	Room 112 sink – boys team locker room storage	17.3
42A-GIH-112-BTL-S3	Room 112 Sink Coaches Office – between Room 113C and Room 112C	15.2
43A-GIH-110-Office A- S1	Room 110F Office A – hand washing sink	36.2
70A-GIH-152-S1	Room 152 sink	21.2
70B-GIH-171-S4	Room 171 – Front left lab bench – right faucet	18.3
78B-GIH-171-S12	Room 171 – Rear right lab bench – left faucet	16.4
35C-GIH-213-S15	Room 213 Hood faucet	674
38C-GIH-211-S17	Room 211 Hood faucet	35.9
62C-GIH-214-S15	Room 214 Hood faucet	93.6
79C-GIH-223-S15	Room 223 Hood faucet	73.8
82C-GIH-215-S17	Room 223 Hood faucet	72.5
84C-GIH-223A-S1	Room 223A Hood faucet	558
100C-GIH-216-S15	Room 216 Hood faucet	48.7
101C-GIH-216-S16	Room 216 right sink on rear wall	77.6
102C-GIH-216-S17	Room 216 left sink on rear wall	76.8
108C-GIH-217-S6	Room 217 Front left bench right faucet	39.1
109C-GIH-217-S7	Room 217 Front middle bench left faucet	42.4
114C-GIH-217-S12	Room 217 Rear middle bench right faucet	41.7
115C-GIH-217-S13	Room 217 Rear right bench left faucet	44.8
118C-GIH-217-S16	Room 217 Rear wall left faucet	17.7
120C-GIH-163-S1	Room 163 teachers desk sink	19.2
124C-GIH-162-S1	Room 162 teacher's desk sink	17.2

The Lotis Engineering Group, P.C.

6465 Transit Road – Suite 23
East Amherst, New York 14051-2232
716.276.8707

Included in this submission are the complete laboratory analytical reports, chain of custody logs, sample location maps and photos of sample locations that exceeded the action levels.

In accordance with the new legislation, use of the aforementioned outlets is prohibited until a lead remediation plan is implemented and new testing demonstrates that the resulting lead levels are below 15 ppb. Alternative water supplies may be necessary in impacted areas. The legislation requires that Grand Island Central School District provide these results to the NYSDOH within one business day of receipt. Further, notification to building staff, all persons in parental relation to students, the local health department and the State Education Department is required within 10 business days of receipt of these results. These results and any associated remedial plans must be posted on the District's website within six weeks of receipt and all records must be retained by the District for at least 10 years.


The NYSDOH recommends reviewing "3Ts for Reducing Lead in Drinking Water in Schools, Revised Technical Guidance" published by the United States Environmental Protection Agency (USEPA) to assist schools in assessing an appropriate remediation plan. A copy of this publication can be reviewed through the following hyperlink [3Ts for Reducing Lead in Drinking Water in Schools](#).

Lotis is available at your convenience to discuss this issue further.

Sincerely,



Kelly Reidy
Environmental Scientist

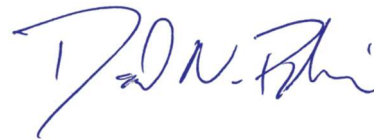

David N. Robinson, P.E.
President/CEO

Laboratory Analytical Results



November 30, 2016

The Lotis Engineering Group, P.C.
6465 Transit Road - Suite 23
East Amherst, NY 14051-2232

Work Order No.: 16K0100

Re: Grand Island High School

Dear Kelly Reidy:

Microbac Laboratories, Inc. - Chicagoland Division received 283 sample(s) on 10/28/2016 3:20:51PM for the analyses presented in the following report as Work Order 16K0100.

The enclosed results were obtained from and are applicable to the sample(s) as received at the laboratory. All sample results are reported on an "as received" basis unless otherwise noted.

All data included in this report have been reviewed and meet the applicable project specific and certification specific requirements, unless otherwise noted. A qualifications page is included in this report and lists the programs under which Microbac maintains certification.

This report has been paginated in its entirety and shall not be reproduced except in full, without the written approval of Microbac Laboratories.

We appreciate the opportunity to service your analytical needs. If you have any questions, please contact your project manager. For any feedback, please contact Robert Crookston, Managing Director, at robert.crookston@microbac.com.

Sincerely,
Microbac Laboratories, Inc.

A handwritten signature in black ink, appearing to read "Karen Ziolkowski", with a long horizontal line extending to the right.

Karen Ziolkowski
Senior Project Manager

[Microbac Laboratories, Inc.](http://www.microbac.com)

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

**WORK ORDER SAMPLE SUMMARY****Date:** Wednesday, November 30, 2016**Client:** The Lotis Engineering Group, P.C.**Project:** Grand Island High School**Lab Order:** 16K0100

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
16K0100-02	1A-GIH-124A-S1	Trainers office	10/26/2016 05:06	11/2/2016 9:18:03AM
16K0100-03	2A-GIH-214A-S2	Bathroom	10/26/2016 05:07	11/2/2016 9:18:03AM
16K0100-04	3A-GIH-123B-S1		10/26/2016 05:07	11/2/2016 9:18:03AM
16K0100-05	4A-GIH-123B-S2		10/26/2016 05:08	11/2/2016 9:18:03AM
16K0100-06	5A-GIH-123B-WF1		10/26/2016 05:09	11/2/2016 9:18:03AM
16K0100-07	6A-GIH-MC-WF1	by 123 MC=Main Corridor	10/26/2016 05:10	11/2/2016 9:18:03AM
16K0100-08	7A-GIH-118-GPLR-S1	GPLR=Girl Player Lock	10/26/2016 05:10	11/2/2016 9:18:03AM
16K0100-09	8A-GIH-118-GPLR-S2		10/26/2016 05:11	11/2/2016 9:18:03AM
16K0100-10	9A-GIH-118-GPLR-S3		10/26/2016 05:11	11/2/2016 9:18:03AM
16K0100-11	10A-GIH-118-GPLR-WF1		10/26/2016 05:11	11/2/2016 9:18:03AM
16K0100-12	11A-GIH-Pool-WF1		10/26/2016 05:13	11/2/2016 9:18:03AM
16K0100-13	12A-GIH-Pool-WF2		10/26/2016 05:13	11/2/2016 9:18:03AM
16K0100-14	13A-GIH-117-BPLR-S1	BPLR=Boy Player Lock	10/26/2016 05:15	11/2/2016 9:18:03AM
16K0100-15	14A-GIH-117-BPLR-S2		10/26/2016 05:15	11/2/2016 9:18:03AM
16K0100-16	15A-GIH-117-BPLR-WF1		10/26/2016 05:16	11/2/2016 9:18:03AM
16K0100-17	16A-GIH-117-BPLR-53	Coaches Bathroom	10/26/2016 05:19	11/2/2016 9:18:03AM
16K0100-18	17A-GIH-GTR-A+B-S1	GTR=Girl's Team Room	10/26/2016 05:22	11/2/2016 9:18:03AM
16K0100-19	18A-GIH-GTR-A+B-S2		10/26/2016 05:23	11/2/2016 9:18:03AM
16K0100-20	19A-GIH-GTR-A+B-S3		10/26/2016 05:23	11/2/2016 9:18:03AM
16K0100-21	20A-GIH-GTRB-S1	GTRB=Girl's Team Restroom	10/26/2016 05:25	11/2/2016 9:18:03AM
16K0100-22	21A-GIH-GTLR-A-S1		10/26/2016 05:25	11/2/2016 9:18:03AM
16K0100-23	22A-GIH-MC-WF2	by Girl's Team Room	10/26/2016 05:27	11/2/2016 9:18:03AM
16K0100-27	26A-GIH-GTLR-D-S1		10/26/2016 05:30	11/2/2016 9:18:04AM
16K0100-28	27A-GIH-GTLR-C-S1		10/26/2016 05:30	11/2/2016 9:18:04AM
16K0100-29	28A-GIH-Gym2-WF1	by Girl's Team Room	10/26/2016 05:31	11/2/2016 9:18:04AM
16K0100-30	29A-GIH-Gym2-WF2		10/26/2016 05:32	11/2/2016 9:18:04AM
16K0100-31	30A-GIH-PGym-WBR-S1	Pgym=Practice Gym W	10/26/2016 05:35	11/2/2016 9:18:04AM
16K0100-32	31A-GIH-PGym-WBR-S2		10/26/2016 05:35	11/2/2016 9:18:04AM
16K0100-33	32A-GIH-PGym-WBR-S3		10/26/2016 05:37	11/2/2016 9:18:04AM
16K0100-34	33A-GIH-113-BTR-S1	BTR=Boys Team Room	10/26/2016 05:37	11/2/2016 9:18:04AM
16K0100-35	34A-GIH-113-BTLR-S2	BTLR=Boy Team Locker	10/26/2016 05:37	11/2/2016 9:18:04AM
16K0100-36	35A-GIH-113-BTLR-WF	Football	10/26/2016 05:38	11/2/2016 9:18:04AM
16K0100-37	36A-GIH-113-BTLR-Spicket		10/26/2016 05:39	11/2/2016 9:18:04AM
16K0100-38	37A-GIH-TO-S1	Team Office by pool	10/26/2016 05:41	11/2/2016 9:18:04AM
16K0100-39	38A-GIH-TO-Ice Machine		10/26/2016 05:42	11/2/2016 9:18:04AM
16K0100-40	39A-GIH-MC-WF3		10/26/2016 05:45	11/2/2016 9:18:04AM
16K0100-41	40A-GIH-112-BTL-S2		10/26/2016 05:45	11/2/2016 9:18:04AM
16K0100-42	41A-GIH-112-BTL-S1	Coaches Office	10/26/2016 05:47	11/2/2016 9:18:04AM
16K0100-43	42A-GIH-112-BTL-S3		10/26/2016 05:48	11/2/2016 9:18:04AM
16K0100-44	43A-GIH-110-Office A- S1		10/26/2016 05:52	11/2/2016 9:18:04AM
16K0100-45	44A-GIH-MC-WBR-S1	By 108	10/26/2016 05:53	11/2/2016 9:18:04AM

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

WORK ORDER SAMPLE SUMMARY
Date: Wednesday, November 30, 2016

16K0100-46	45A-GIH-MC-WBR-S2	By 108	10/26/2016 05:55	11/2/2016 9:18:04AM
16K0100-47	46A-GIH-MC-MBR-S1	by 107	10/26/2016 05:56	11/2/2016 9:18:04AM
16K0100-48	47A-GIH-MC-MBR-S2	by 107	10/26/2016 05:57	11/2/2016 9:18:04AM
16K0100-49	48A-GIH-MC-WF4	by 107	10/26/2016 06:00	11/2/2016 9:18:04AM
16K0100-50	49A-GIH-DO-WF1		10/26/2016 06:05	11/2/2016 9:18:04AM
16K0100-51	50A-GIH-DO-S1	Kitchen	10/26/2016 06:06	11/2/2016 9:18:04AM
16K0100-52	51A-GIH-DO-WBR-S2		10/26/2016 06:06	11/2/2016 9:18:04AM
16K0100-53	52A-GIH-DO-AG-S3	AG=All Gender Bathrooms	10/26/2016 06:06	11/2/2016 9:18:04AM
16K0100-54	53A-GIH-DO-Sprayer	Kitchen	10/26/2016 06:09	11/2/2016 9:18:04AM
16K0100-55	54A-GIH-180-S1	Coaches Offices	10/26/2016 06:10	11/2/2016 9:18:04AM
16K0100-56	55A-GIH-122-S1		10/26/2016 06:11	11/2/2016 9:18:05AM
16K0100-57	56A-GIH-122-S2		10/26/2016 06:12	11/2/2016 9:18:05AM
16K0100-58	57A-GIH-122-S3		10/26/2016 06:12	11/2/2016 9:18:05AM
16K0100-59	58A-GIH-122-S4		10/26/2016 06:13	11/2/2016 9:18:05AM
16K0100-60	59A-GIH-122-S5		10/26/2016 06:15	11/2/2016 9:18:05AM
16K0100-61	60A-GIH-122-S6		10/26/2016 06:15	11/2/2016 9:18:05AM
16K0100-62	61A-GIH-122-WF1		10/26/2016 06:15	11/2/2016 9:18:05AM
16K0100-63	62A-GIH-121B-S1		10/26/2016 06:17	11/2/2016 9:18:05AM
16K0100-64	63A-GIH-121B-S2		10/26/2016 06:17	11/2/2016 9:18:05AM
16K0100-65	64A-GIH-121B-S3		10/26/2016 06:18	11/2/2016 9:18:05AM
16K0100-66	65A-GIH-121B-WF1		10/26/2016 06:18	11/2/2016 9:18:05AM
16K0100-67	66A-GIH-121A-S1		10/26/2016 06:20	11/2/2016 9:18:05AM
16K0100-68	67A-GIH-121A-S2		10/26/2016 06:21	11/2/2016 9:18:05AM
16K0100-69	68A-GIH-121A-S4		10/26/2016 06:21	11/2/2016 9:18:05AM
16K0100-70	69A-GIH-121A-S3		10/26/2016 06:22	11/2/2016 9:18:05AM
16K0100-71	70A-GIH-152-S1		10/26/2016 06:30	11/2/2016 9:18:05AM
16K0100-72	71A-GIH-MC-WF5		10/26/2016 06:31	11/2/2016 9:18:05AM
16K0100-73	1B-GIH-A-WBR-S1	A=Auditorium	10/26/2016 05:09	11/2/2016 9:18:05AM
16K0100-74	2B-GIH-A-WBR-S2		10/26/2016 05:09	11/2/2016 9:18:05AM
16K0100-75	3B-GIH-A-WBR-S3		10/26/2016 05:09	11/2/2016 9:18:05AM
16K0100-76	4B-GIH-A-MBR-S1		10/26/2016 05:10	11/2/2016 9:18:05AM
16K0100-77	5B-GIH-A-MBR-S2		10/26/2016 05:10	11/2/2016 9:18:05AM
16K0100-78	6B-GIH-A-MBR-S3		10/26/2016 05:10	11/2/2016 9:18:05AM
16K0100-79	7B-GIH-A-MBR-S4		10/26/2016 05:10	11/2/2016 9:18:05AM
16K0100-80	8B-GIH-A-MBR-S5		10/26/2016 05:10	11/2/2016 9:18:05AM
16K0100-81	9B-GIH-A-MBR-S6		10/26/2016 05:10	11/2/2016 9:18:05AM
16K0100-82	10B-GIH-A-WF		10/26/2016 05:13	11/2/2016 9:18:06AM
16K0100-83	11B-GIH-A-BF	BF=Bottle Filler	10/26/2016 05:14	11/2/2016 9:18:06AM
16K0100-84	12B-GIH-Café-S1		10/26/2016 05:20	11/2/2016 9:18:06AM
16K0100-85	13B-GIH-Café-Sprayer		10/26/2016 05:21	11/2/2016 9:18:06AM
16K0100-86	14B-GIH-Kitchen-S2		10/26/2016 05:22	11/2/2016 9:18:06AM
16K0100-87	15B-GIH-Kitchen-S3		10/26/2016 05:23	11/2/2016 9:18:06AM
16K0100-88	16B-GIH-Kitchen-PF	PF=Pot Filler	10/26/2016 05:24	11/2/2016 9:18:06AM
16K0100-89	17B-GIH-Kitchen-PF2		10/26/2016 05:24	11/2/2016 9:18:06AM
16K0100-90	18B-GIH-Kitchen-S4	Food Wash Only	10/26/2016 05:24	11/2/2016 9:18:06AM
16K0100-91	19B-GIH-Kitchen-S5		10/26/2016 05:24	11/2/2016 9:18:06AM

Microbac Laboratories, Inc.

WORK ORDER SAMPLE SUMMARY
Date: Wednesday, November 30, 2016

16K0100-92	20B-GIH-Kitchen-BR-S1		10/26/2016 05:27	11/2/2016 9:18:06AM
16K0100-93	21B-GIH-Kitchen-Sprayer2		10/26/2016 05:29	11/2/2016 9:18:06AM
16K0100-94	22B-GIH-Café-WF		10/26/2016 05:32	11/2/2016 9:18:06AM
16K0100-95	23B-GIH-GO-BreakR-S1	GO=Guidance Office	10/26/2016 05:35	11/2/2016 9:18:06AM
16K0100-96	24B-GIH-NO-S1	NO=Nurses Office	10/26/2016 05:37	11/2/2016 9:18:06AM
16K0100-97	25B-GIH-NO-S2		10/26/2016 05:38	11/2/2016 9:18:06AM
16K0100-98	26B-GIH-NO-BR-S1		10/26/2016 05:38	11/2/2016 9:18:06AM
16K0100-99	27B-GIH-NO-BR-S2		10/26/2016 05:39	11/2/2016 9:18:06AM
16K0100-AA	28B-GIH-NO-S3		10/26/2016 05:40	11/2/2016 9:18:06AM
16K0100-AB	29B-GIH-WSGBR-S1	WSGBR=Women's sta	10/26/2016 05:42	11/2/2016 9:18:06AM
16K0100-AC	30B-GIH-FWBR-S1	FWBR=Faculty Womar	10/26/2016 05:43	11/2/2016 9:18:06AM
16K0100-AD	31B-GIH-MFBR-S1	MFBR=Mens Faculty B	10/26/2016 05:45	11/2/2016 9:18:06AM
16K0100-AE	32B-GIH-FL-S1	FL=Faculty Lounge	10/26/2016 05:47	11/2/2016 9:18:06AM
16K0100-AF	33B-GIH-CC-S1	CC=Casey's Corner	10/26/2016 05:50	11/2/2016 9:18:06AM
16K0100-AG	34B-GIH-MO-Closet-S1	MO=Main Office	10/26/2016 05:55	11/2/2016 9:18:06AM
16K0100-AH	35B-GIH-MO-Kitchen-S1		10/26/2016 05:57	11/2/2016 9:18:06AM
16K0100-AI	36B-GIH-68-S1		10/26/2016 06:03	11/2/2016 9:18:06AM
16K0100-AJ	37B-GIH-69-S1		10/26/2016 06:04	11/2/2016 9:18:06AM
16K0100-AK	38B-GIH-70-S1		10/26/2016 06:04	11/2/2016 9:18:06AM
16K0100-AL	39B-GIH-72-S1		10/26/2016 06:06	11/2/2016 9:18:06AM
16K0100-AM	40B-GIH-66-S1		10/26/2016 06:07	11/2/2016 9:18:07AM
16K0100-AN	41B-GIH-FBR-S1	FBR=Faculty bathroom	10/26/2016 06:09	11/2/2016 9:18:07AM
16K0100-AO	42B-GIH-MBR-S1	by room 66	10/26/2016 06:12	11/2/2016 9:18:07AM
16K0100-AP	43B-GIH-MBR-S2	by room 66	10/26/2016 06:12	11/2/2016 9:18:07AM
16K0100-AQ	44B-GIH-WBR-S1	by room 66	10/26/2016 06:13	11/2/2016 9:18:07AM
16K0100-AR	45B-GIH-WBR-S2	by room 66	10/26/2016 06:13	11/2/2016 9:18:07AM
16K0100-AS	46B-GIH-High-WF	by room 66	10/26/2016 06:14	11/2/2016 9:18:07AM
16K0100-AT	47B-GIH-Low-WF	by room 66	10/26/2016 06:14	11/2/2016 9:18:07AM
16K0100-AU	48B-GIH-WF	by room 182	10/26/2016 06:17	11/2/2016 9:18:07AM
16K0100-AV	49B-GIH-169-S1		10/26/2016 06:20	11/2/2016 9:18:07AM
16K0100-AW	50B-GIH-169-S2		10/26/2016 06:20	11/2/2016 9:18:07AM
16K0100-AX	51B-GIH-169-S3		10/26/2016 06:20	11/2/2016 9:18:07AM
16K0100-AY	52B-GIH-169-S4		10/26/2016 06:21	11/2/2016 9:18:07AM
16K0100-AZ	53B-GIH-165-S1		10/26/2016 06:23	11/2/2016 9:18:07AM
16K0100-BA	54B-GIH-165-S2		10/26/2016 06:24	11/2/2016 9:18:07AM
16K0100-BB	55B-GIH-165-S3		10/26/2016 06:24	11/2/2016 9:18:07AM
16K0100-BC	56B-GIH-165-S4		10/26/2016 06:24	11/2/2016 9:18:07AM
16K0100-BD	57B-GIH-WF	Outside 165	10/26/2016 06:26	11/2/2016 9:18:07AM
16K0100-BE	58B-GIH-BF	Outside 165	10/26/2016 06:27	11/2/2016 9:18:07AM
16K0100-BF	59B-GIH-MBR-S1	Outside 165	10/26/2016 06:28	11/2/2016 9:18:07AM
16K0100-BG	60B-GIH-MBR-S2	Outside 165	10/26/2016 06:28	11/2/2016 9:18:07AM
16K0100-BH	61B-GIH-WBR-S1	Outside 165	10/26/2016 06:29	11/2/2016 9:18:07AM
16K0100-BI	62B-GIH-WBR-S2		10/26/2016 06:29	11/2/2016 9:18:07AM
16K0100-BJ	63B-GIH-WBR-S3	Outside 165	10/26/2016 06:29	11/2/2016 9:18:07AM
16K0100-BK	64B-GIH-WBR-S4	Outside 165	10/26/2016 06:29	11/2/2016 9:18:07AM
16K0100-BL	65B-GIH-WBR-S5	Outside 165	10/26/2016 06:29	11/2/2016 9:18:07AM

Microbac Laboratories, Inc.

WORK ORDER SAMPLE SUMMARY
Date: *Wednesday, November 30, 2016*

16K0100-BM	66B-GIH-WBR-S8		10/26/2016 06:37	11/2/2016 9:18:07AM
16K0100-BN	67B-GIH-172-S1		10/26/2016 06:40	11/2/2016 9:18:07AM
16K0100-BO	68B-GIH-171-S2		10/26/2016 06:40	11/2/2016 9:18:08AM
16K0100-BP	69B-GIH-171-S3		10/26/2016 06:41	11/2/2016 9:18:08AM
16K0100-BQ	70B-GIH-171-S4		10/26/2016 06:41	11/2/2016 9:18:08AM
16K0100-BR	71B-GIH-171-S5		10/26/2016 06:42	11/2/2016 9:18:08AM
16K0100-BS	72B-GIH-171-S6		10/26/2016 06:42	11/2/2016 9:18:08AM
16K0100-BT	73B-GIH-171-S7		10/26/2016 06:43	11/2/2016 9:18:08AM
16K0100-BU	74B-GIH-171-S8		10/26/2016 06:43	11/2/2016 9:18:08AM
16K0100-BV	75B-GIH-171-S9		10/26/2016 06:44	11/2/2016 9:18:08AM
16K0100-BW	76B-GIH-171-S10		10/26/2016 06:44	11/2/2016 9:18:08AM
16K0100-BX	77B-GIH-171-S11		10/26/2016 06:45	11/2/2016 9:18:08AM
16K0100-BY	78B-GIH-171-S12		10/26/2016 06:46	11/2/2016 9:18:08AM
16K0100-BZ	79B-GIH-171-S13		10/26/2016 06:46	11/2/2016 9:18:08AM
16K0100-CA	80B-GIH-171-S14		10/26/2016 06:46	11/2/2016 9:18:08AM
16K0100-CB	81B-GIH-171-S15		10/26/2016 06:47	11/2/2016 9:18:08AM
16K0100-CC	82B-GIH-171-S16		10/26/2016 06:48	11/2/2016 9:18:08AM
16K0100-CD	83B-GIH-MS. Eppers-S		10/26/2016 06:52	11/2/2016 9:18:08AM
16K0100-CE	84B-GIH-Library-S1		10/26/2016 06:52	11/2/2016 9:18:08AM
16K0100-CF	1C-GIH-HW-WF	By 203	10/26/2016 05:03	11/2/2016 9:18:08AM
16K0100-CG	2C-GIH-205-S1		10/26/2016 05:07	11/2/2016 9:18:08AM
16K0100-CH	3C-GIH-WB-S1	Faculty	10/26/2016 05:08	11/2/2016 9:18:08AM
16K0100-CI	4C-GIH-MB-S1	Faculty	10/26/2016 07:08	11/2/2016 9:18:08AM
16K0100-CJ	5C-GIH-211-S1		10/26/2016 05:10	11/2/2016 9:18:08AM
16K0100-CK	6C-GIH-211-S2		10/26/2016 05:10	11/2/2016 9:18:08AM
16K0100-CL	7C-GIH-211-S3		10/26/2016 05:11	11/2/2016 9:18:08AM
16K0100-CM	8C-GIH-211-S4		10/26/2016 05:12	11/2/2016 9:18:08AM
16K0100-CN	9C-GIH-211-S5		10/26/2016 05:12	11/2/2016 9:18:08AM
16K0100-CO	10C-GIH-211-S6		10/26/2016 05:14	11/2/2016 9:18:08AM
16K0100-CP	11C-GIH-211-S7		10/26/2016 07:13	11/2/2016 9:18:08AM
16K0100-CQ	12C-GIH-211-S8		10/26/2016 05:15	11/2/2016 9:18:08AM
16K0100-CR	13C-GIH-211-S9		10/26/2016 05:15	11/2/2016 9:18:09AM
16K0100-CS	14C-GIH-211-S10		10/26/2016 05:16	11/2/2016 9:18:09AM
16K0100-CT	15C-GIH-211-S11		10/26/2016 05:17	11/2/2016 9:18:09AM
16K0100-CU	16C-GIH-211-S12		10/26/2016 05:18	11/2/2016 9:18:09AM
16K0100-CV	17C-GIH-211-S13		10/26/2016 05:18	11/2/2016 9:18:09AM
16K0100-CW	18C-GIH-211-S14		10/26/2016 05:18	11/2/2016 9:18:09AM
16K0100-CX	19C-GIH-211-S19		10/26/2016 05:19	11/2/2016 9:18:09AM
16K0100-CY	20C-GIH-211-S20		10/26/2016 05:19	11/2/2016 9:18:09AM
16K0100-CZ	21C-GIH-213-S1		10/26/2016 05:21	11/2/2016 9:18:09AM
16K0100-DA	22C-GIH-213-S2		10/26/2016 05:22	11/2/2016 9:18:09AM
16K0100-DB	23C-GIH-213-S3		10/26/2016 05:23	11/2/2016 9:18:09AM
16K0100-DC	24C-GIH-213-S4		10/26/2016 05:23	11/2/2016 9:18:09AM
16K0100-DD	25C-GIH-213-S5		10/26/2016 05:24	11/2/2016 9:18:09AM
16K0100-DE	26C-GIH-213-S6		10/26/2016 05:24	11/2/2016 9:18:09AM
16K0100-DF	27C-GIH-213-S7		10/26/2016 05:25	11/2/2016 9:18:09AM

Microbac Laboratories, Inc.

WORK ORDER SAMPLE SUMMARY
Date: *Wednesday, November 30, 2016*

16K0100-DG	28C-GIH-213-S8		10/26/2016 05:25	11/2/2016 9:18:09AM
16K0100-DH	29C-GIH-213-S9		10/26/2016 05:26	11/2/2016 9:18:09AM
16K0100-DI	30C-GIH-213-S10		10/26/2016 05:26	11/2/2016 9:18:09AM
16K0100-DJ	31C-GIH-213-S11		10/26/2016 05:27	11/2/2016 9:18:09AM
16K0100-DK	32C-GIH-213-S12		10/26/2016 05:27	11/2/2016 9:18:09AM
16K0100-DL	33C-GIH-213-S13		10/26/2016 05:28	11/2/2016 9:18:09AM
16K0100-DM	34C-GIH-213-S14		10/26/2016 05:28	11/2/2016 9:18:09AM
16K0100-DN	35C-GIH-213-S15	Hood	10/26/2016 05:30	11/2/2016 9:18:09AM
16K0100-DO	36C-GIH-213-S16		10/26/2016 05:30	11/2/2016 9:18:09AM
16K0100-DP	37C-GIH-213-S17		10/26/2016 05:31	11/2/2016 9:18:09AM
16K0100-DQ	38C-GIH-211-S17		10/26/2016 05:37	11/2/2016 9:18:09AM
16K0100-DR	39C-GIH-BB-S1		10/26/2016 05:38	11/2/2016 9:18:09AM
16K0100-DS	40C-GIH-BB-S2		10/26/2016 05:42	11/2/2016 9:18:09AM
16K0100-DT	41C-GIH-BB-S3		10/26/2016 05:42	11/2/2016 9:18:09AM
16K0100-DU	42C-GIH-BB-S4		10/26/2016 05:43	11/2/2016 9:18:09AM
16K0100-DV	43C-GIH-HW-WF	Outside 214	10/26/2016 05:44	11/2/2016 9:18:09AM
16K0100-DW	44C-GIH-GB-S1		10/26/2016 05:45	11/2/2016 9:18:10AM
16K0100-DY	46C-GIH-GB-S3		10/26/2016 05:46	11/2/2016 9:18:10AM
16K0100-DZ	47C-GIH-GB-S4		10/26/2016 05:46	11/2/2016 9:18:10AM
16K0100-EA	48C-GIH-214-S1		10/26/2016 05:49	11/2/2016 9:18:10AM
16K0100-EB	49C-GIH-214-S2		10/26/2016 05:49	11/2/2016 9:18:10AM
16K0100-EC	50C-GIH-214-S3		10/26/2016 05:50	11/2/2016 9:18:10AM
16K0100-ED	51C-GIH-214-S4		10/26/2016 05:50	11/2/2016 9:18:10AM
16K0100-EE	52C-GIH-214-S5		10/26/2016 05:51	11/2/2016 9:18:10AM
16K0100-EF	53C-GIH-214-S6		10/26/2016 05:51	11/2/2016 9:18:10AM
16K0100-EG	54C-GIH-214-S7		10/26/2016 05:51	11/2/2016 9:18:10AM
16K0100-EH	55C-GIH-214-S8		10/26/2016 05:52	11/2/2016 9:18:10AM
16K0100-EI	56C-GIH-214-S9		10/26/2016 05:52	11/2/2016 9:18:10AM
16K0100-EJ	57C-GIH-214-S10		10/26/2016 05:53	11/2/2016 9:18:10AM
16K0100-EK	58C-GIH-214-S11		10/26/2016 05:53	11/2/2016 9:18:10AM
16K0100-EL	59C-GIH-214-S12		10/26/2016 05:53	11/2/2016 9:18:10AM
16K0100-EM	60C-GIH-214-S13		10/26/2016 05:54	11/2/2016 9:18:10AM
16K0100-EN	61C-GIH-214-S14		10/26/2016 05:59	11/2/2016 9:18:10AM
16K0100-EO	62C-GIH-214-S15	Hood	10/26/2016 05:55	11/2/2016 9:18:10AM
16K0100-EP	63C-GIH-214-S16		10/26/2016 05:55	11/2/2016 9:18:10AM
16K0100-EQ	64C-GIH-214-S17		10/26/2016 05:57	11/2/2016 9:18:10AM
16K0100-ER	65C-GIH-223-S1		10/26/2016 05:59	11/2/2016 9:18:10AM
16K0100-ES	66C-GIH-223-S2		10/26/2016 06:00	11/2/2016 9:18:10AM
16K0100-ET	67C-GIH-223-S3		10/26/2016 06:00	11/2/2016 9:18:10AM
16K0100-EU	68C-GIH-223-S4		10/26/2016 06:00	11/2/2016 9:18:10AM
16K0100-EV	69C-GIH-223-S5		10/26/2016 06:02	11/2/2016 9:18:10AM
16K0100-EW	70C-GIH-223-S5		10/26/2016 06:02	11/2/2016 9:18:10AM
16K0100-EX	71C-GIH-223-S7		10/26/2016 06:03	11/2/2016 9:18:10AM
16K0100-EY	72C-GIH-223-S8		10/26/2016 06:03	11/2/2016 9:18:10AM
16K0100-EZ	73C-GIH-223-S9		10/26/2016 06:04	11/2/2016 9:18:11AM
16K0100-FA	74C-GIH-223-S10		10/26/2016 06:04	11/2/2016 9:18:11AM

Microbac Laboratories, Inc.

**WORK ORDER SAMPLE SUMMARY****Date:** Wednesday, November 30, 2016

16K0100-FB	75C-GIH-223-S11		10/26/2016 06:05	11/2/2016 9:18:11AM
16K0100-FC	76C-GIH-223-S12		10/26/2016 06:05	11/2/2016 9:18:11AM
16K0100-FD	77C-GIH-223-S13		10/26/2016 06:05	11/2/2016 9:18:11AM
16K0100-FE	78C-GIH-223-S14		10/26/2016 06:06	11/2/2016 9:18:11AM
16K0100-FF	79C-GIH-223-S15		10/26/2016 06:07	11/2/2016 9:18:11AM
16K0100-FG	80C-GIH-223-S16		10/26/2016 06:07	11/2/2016 9:18:11AM
16K0100-FH	81C-GIH-223-S17		10/26/2016 06:07	11/2/2016 9:18:11AM
16K0100-FI	82C-GIH-223-S17		10/26/2016 06:11	11/2/2016 9:18:11AM
16K0100-FJ	83C-GIH-215-S2		10/26/2016 06:11	11/2/2016 9:18:11AM
16K0100-FK	84C-GIH-223A-S1	Hood	10/26/2016 06:12	11/2/2016 9:18:11AM
16K0100-FL	85C-GIH-223A-S2		10/26/2016 06:13	11/2/2016 9:18:11AM
16K0100-FM	86C-GIH-216-S1		10/26/2016 06:15	11/2/2016 9:18:11AM
16K0100-FN	87C-GIH-216-S2		10/26/2016 06:16	11/2/2016 9:18:11AM
16K0100-FO	88C-GIH-216-S3		10/26/2016 06:16	11/2/2016 9:18:11AM
16K0100-FP	89C-GIH-216-S4		10/26/2016 06:11	11/2/2016 9:18:11AM
16K0100-FQ	90C-GIH-216-S5		10/26/2016 06:17	11/2/2016 9:18:11AM
16K0100-FR	91C-GIH-216-S6		10/26/2016 06:17	11/2/2016 9:18:11AM
16K0100-FS	92C-GIH-216-S7		10/26/2016 06:18	11/2/2016 9:18:11AM
16K0100-FT	93C-GIH-216-S8		10/26/2016 06:18	11/2/2016 9:18:11AM
16K0100-FU	94C-GIH-216-S9		10/26/2016 06:19	11/2/2016 9:18:11AM
16K0100-FV	95C-GIH-216-S10		10/26/2016 06:19	11/2/2016 9:18:11AM
16K0100-FW	96C-GIH-216-S11		10/26/2016 06:20	11/2/2016 9:18:11AM
16K0100-FX	97C-GIH-216-S12		10/26/2016 06:20	11/2/2016 9:18:11AM
16K0100-FY	98C-GIH-216-S13		10/26/2016 06:20	11/2/2016 9:18:11AM
16K0100-FZ	99C-GIH-216-S14		10/26/2016 06:21	11/2/2016 9:18:11AM
16K0100-GA	100C-GIH-216-S15	Hood	10/26/2016 06:21	11/2/2016 9:18:11AM
16K0100-GB	101C-GIH-216-S16		10/26/2016 06:22	11/2/2016 9:18:11AM
16K0100-GC	102C-GIH-216-S17		10/26/2016 06:22	11/2/2016 9:18:12AM
16K0100-GD	103C-GIH-217-S1		10/26/2016 06:25	11/2/2016 9:18:12AM
16K0100-GE	104C-GIH-217-S2		10/26/2016 06:25	11/2/2016 9:18:12AM
16K0100-GF	105C-GIH-217-S3		10/26/2016 06:26	11/2/2016 9:18:12AM
16K0100-GG	106C-GIH-217-S4		10/26/2016 06:26	11/2/2016 9:18:12AM
16K0100-GH	107C-GIH-217-S5		10/26/2016 06:26	11/2/2016 9:18:12AM
16K0100-GI	108C-GIH-217-S6		10/26/2016 06:27	11/2/2016 9:18:12AM
16K0100-GJ	109C-GIH-217-S7		10/26/2016 06:27	11/2/2016 9:18:12AM
16K0100-GK	110C-GIH-217-S8		10/26/2016 06:27	11/2/2016 9:18:12AM
16K0100-GL	11C-GIH-217-S9		10/26/2016 06:23	11/2/2016 9:18:12AM
16K0100-GM	112C-GIH-217-S10		10/26/2016 06:28	11/2/2016 9:18:12AM
16K0100-GN	113C-GIH-217-S11		10/26/2016 06:29	11/2/2016 9:18:12AM
16K0100-GO	114C-GIH-217-S12		10/26/2016 06:29	11/2/2016 9:18:12AM
16K0100-GP	115C-GIH-217-S13		10/26/2016 06:29	11/2/2016 9:18:12AM
16K0100-GQ	116C-GIH-217-S14		10/26/2016 06:30	11/2/2016 9:18:12AM
16K0100-GR	117C-GIH-217-S15		10/26/2016 06:30	11/2/2016 9:18:12AM
16K0100-GS	118C-GIH-217-S16		10/26/2016 06:30	11/2/2016 9:18:12AM
16K0100-GT	119C-GIH-HW-WF	Outside 230	10/26/2016 06:33	11/2/2016 9:18:12AM
16K0100-GU	120C-GIH-163-S1		10/26/2016 06:47	11/2/2016 9:18:12AM

Microbac Laboratories, Inc.

**WORK ORDER SAMPLE SUMMARY****Date:** *Wednesday, November 30, 2016*

16K0100-GV	121C-GIH-163-S2	10/26/2016 06:47	11/2/2016 9:18:12AM
16K0100-GW	122C-GIH-163-S3	10/26/2016 06:48	11/2/2016 9:18:12AM
16K0100-GX	123C-GIH-163-S4	10/26/2016 06:48	11/2/2016 9:18:12AM
16K0100-GY	124C-GIH-162-S1	10/26/2016 06:51	11/2/2016 9:18:12AM
16K0100-GZ	125C-GIH-162-S2	10/26/2016 06:51	11/2/2016 9:18:12AM
16K0100-HA	126C-GIH-162-S3	10/26/2016 06:57	11/2/2016 9:18:12AM
16K0100-HB	127C-GIH-167-S4	10/26/2016 06:52	11/2/2016 9:18:12AM

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

CASE NARRATIVE**Date:** *Wednesday, November 30, 2016***Client:** The Lotis Engineering Group, P.C.**Project:** Grand Island High School**Lab Order:** 16K0100

The Matrix Spike Duplicate performed on the following sample failed the precision criteria for lead. The accuracy criteria were met by both the Matrix Spike and Matrix Spike Duplicate. This data is indicative of a bias related to sample matrix.

<u>Laboratory ID</u>	<u>Sample Name</u>
16K0100-22	21A-GIH-GTLR-A-S1

Analytical Results

Date: Wednesday, November 30, 2016

Client:	The Lotus Engineering Group, P.C.	Work Order:	16K0100
Client Project:	Grand Island High School	Received:	11/02/2016 9:18

Analyses	Certs	Result	Units	Qual	Analyzed	Tech	Method
02 1A-GIH-124A-S1 - Trainers office							Collected: 10/26/2016 05:06
Lead	gdmnoi	< 1.00	ug/L		11/18/2016 12:21	RPL	EPA 200.8 Rev 5.4
03 2A-GIH-214A-S2 - Bethroom							Collected: 10/26/2016 05:07
Lead	gdmnoi	< 1.00	ug/L		11/18/2016 12:22	RPL	EPA 200.8 Rev 5.4
04 3A-GIH-123B-S1							Collected: 10/26/2016 05:07
Lead	gdmnoi	18.6	ug/L		11/18/2016 12:23	RPL	EPA 200.8 Rev 5.4
05 4A-GIH-123B-S2							Collected: 10/26/2016 05:08
Lead	gdmnoi	7.36	ug/L		11/18/2016 12:25	RPL	EPA 200.8 Rev 5.4
06 5A-GIH-123B-WF1							Collected: 10/26/2016 05:09
Lead	gdmnoi	37.3	ug/L		11/18/2016 12:25	RPL	EPA 200.8 Rev 5.4
07 6A-GIH-MC-WF1 - by 123 MC=Main Corridor							Collected: 10/26/2016 05:10
Lead	gdmnoi	< 1.00	ug/L		11/18/2016 12:26	RPL	EPA 200.8 Rev 5.4
08 7A-GIH-118-GPLR-S1 - GPLR=Girl Player Locker Room							Collected: 10/26/2016 05:10
Lead	gdmnoi	9.98	ug/L		11/18/2016 12:27	RPL	EPA 200.8 Rev 5.4
09 8A-GIH-118-GPLR-S2							Collected: 10/26/2016 05:11
Lead	gdmnoi	< 1.00	ug/L		11/18/2016 12:29	RPL	EPA 200.8 Rev 5.4
10 9A-GIH-118-GPLR-S3							Collected: 10/26/2016 05:11
Lead	gdmnoi	< 1.00	ug/L		11/18/2016 12:29	RPL	EPA 200.8 Rev 5.4
11 10A-GIH-118-GPLR-WF1							Collected: 10/26/2016 05:11
Lead	gdmnoi	< 1.00	ug/L		11/18/2016 12:30	RPL	EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

12 11A-GIH-Pool-WF1 Collected: 10/26/2016 05:13

Lead gdmnoi 19.2 ug/L 11/18/2016 12:31 RPL EPA 200.8 Rev 5.4

13 12A-GIH-Pool-WF2 Collected: 10/26/2016 05:13

Lead gdmnoi 19.6 ug/L 11/18/2016 12:32 RPL EPA 200.8 Rev 5.4

14 13A-GIH-117-BPLR-S1 - BPLR=Boy Player Locker Room Collected: 10/26/2016 05:15

Lead gdmnoi < 1.00 ug/L 11/18/2016 12:34 RPL EPA 200.8 Rev 5.4

15 14A-GIH-117-BPLR-S2 Collected: 10/26/2016 05:15

Lead gdmnoi < 1.00 ug/L 11/18/2016 12:34 RPL EPA 200.8 Rev 5.4

16 15A-GIH-117-BPLR-WF1 Collected: 10/26/2016 05:16

Lead gdmnoi < 1.00 ug/L 11/18/2016 12:35 RPL EPA 200.8 Rev 5.4

17 16A-GIH-117-BPLR-53 - Coaches Bathroom Collected: 10/26/2016 05:19

Lead gdmnoi 2.48 ug/L 11/18/2016 12:37 RPL EPA 200.8 Rev 5.4

18 17A-GIH-GTR-A+B-S1 - GTR=Girl's Team Room Collected: 10/26/2016 05:22

Lead gdmnoi 7.71 ug/L 11/18/2016 12:38 RPL EPA 200.8 Rev 5.4

19 18A-GIH-GTR-A+B-S2 Collected: 10/26/2016 05:23

Lead gdmnoi 2.53 ug/L 11/18/2016 12:38 RPL EPA 200.8 Rev 5.4

20 19A-GIH-GTR-A+B-S3 Collected: 10/26/2016 05:23

Lead gdmnoi 3.29 ug/L 11/18/2016 12:39 RPL EPA 200.8 Rev 5.4

21 20A-GIH-GTRB-S1 - GTRB=Girl's Team Restroom Collected: 10/26/2016 05:25

Lead gdmnoi < 1.00 ug/L 11/18/2016 12:40 RPL EPA 200.8 Rev 5.4

22 21A-GIH-GTLR-A-S1 Collected: 10/26/2016 05:25

Lead gdmnoi < 1.00 ug/L 11/18/2016 12:40 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

23 22A-GIH-MC-WF2 - by Girl's Team Room Collected: 10/26/2016 05:27

Lead gdmnoi < 1.00 ug/L 11/18/2016 12:43 RPL EPA 200.8 Rev 5.4

27 26A-GIH-GTLR-D-S1 Collected: 10/26/2016 05:30

Lead gdmnoi < 1.00 ug/L 11/18/2016 12:43 RPL EPA 200.8 Rev 5.4

28 27A-GIH-GTLR-C-S1 Collected: 10/26/2016 05:30

Lead gdmnoi 1.54 ug/L 11/18/2016 13:44 RPL EPA 200.8 Rev 5.4

29 28A-GIH-Gym2-WF1 - by Girl's Team Room Collected: 10/26/2016 05:31

Lead gdmnoi < 1.00 ug/L 11/18/2016 13:45 RPL EPA 200.8 Rev 5.4

30 29A-GIH-Gym2-WF2 Collected: 10/26/2016 05:32

Lead gdmnoi < 1.00 ug/L 11/18/2016 13:47 RPL EPA 200.8 Rev 5.4

31 30A-GIH-PGym-WBR-S1 - Pgym=Practice Gym WBR=Women's bathroom Collected: 10/26/2016 05:35

Lead gdmnoi 5.86 ug/L 11/18/2016 13:47 RPL EPA 200.8 Rev 5.4

32 31A-GIH-PGym-WBR-S2 Collected: 10/26/2016 05:35

Lead gdmnoi < 1.00 ug/L 11/18/2016 13:48 RPL EPA 200.8 Rev 5.4

33 32A-GIH-PGym-WBR-S3 Collected: 10/26/2016 05:37

Lead gdmnoi < 1.00 ug/L 11/18/2016 13:49 RPL EPA 200.8 Rev 5.4

34 33A-GIH-113-BTR-S1 - BTR=Boys Team Room (football) Collected: 10/26/2016 05:37

Lead gdmnoi < 1.00 ug/L 11/18/2016 13:49 RPL EPA 200.8 Rev 5.4

35 34A-GIH-113-BTLR-S2 - BTLR=Boy Team Locker Room (Football) Collected: 10/26/2016 05:37

Lead gdmnoi 2.93 ug/L 11/18/2016 13:50 RPL EPA 200.8 Rev 5.4

36 35A-GIH-113-BTLR-WF - Football Collected: 10/26/2016 05:38

Lead gdmnoi 5.64 ug/L 11/18/2016 13:52 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

37 36A-GIH-113-BTLR-Spicket Collected: 10/26/2016 05:39

Lead gdmnoi **15.3** ug/L 11/18/2016 13:53 RPL EPA 200.8 Rev 5.4

38 37A-GIH-TO-S1 - Team Office by pool Collected: 10/26/2016 05:41

Lead gdmnoi **6.72** ug/L 11/18/2016 13:54 RPL EPA 200.8 Rev 5.4

39 38A-GIH-TO-Ice Machine Collected: 10/26/2016 05:42

Lead dgimno **10.6** ug/L 11/17/2016 12:25 SJE EPA 200.8 Rev 5.4

40 39A-GIH-MC-WF3 Collected: 10/26/2016 05:45

Lead gdmnoi **< 1.00** ug/L 11/18/2016 13:54 RPL EPA 200.8 Rev 5.4

41 40A-GIH-112-BTL-S2 Collected: 10/26/2016 05:45

Lead gdmnoi **7.89** ug/L 11/18/2016 13:55 RPL EPA 200.8 Rev 5.4

42 41A-GIH-112-BTL-S1 - Coaches Office Collected: 10/26/2016 05:47

Lead gdmnoi **17.3** ug/L 11/18/2016 13:57 RPL EPA 200.8 Rev 5.4

43 42A-GIH-112-BTL-S3 Collected: 10/26/2016 05:48

Lead gdmnoi **15.2** ug/L 11/18/2016 13:58 RPL EPA 200.8 Rev 5.4

44 43A-GIH-110-Office A- S1 Collected: 10/26/2016 05:52

Lead gdmnoi **36.2** ug/L 11/18/2016 13:58 RPL EPA 200.8 Rev 5.4

45 44A-GIH-MC-WBR-S1 - By 108 Collected: 10/26/2016 05:53

Lead gdmnoi **4.15** ug/L 11/18/2016 14:00 RPL EPA 200.8 Rev 5.4

46 45A-GIH-MC-WBR-S2 - By 108 Collected: 10/26/2016 05:55

Lead gdmnoi **2.50** ug/L 11/18/2016 14:01 RPL EPA 200.8 Rev 5.4

47 46A-GIH-MC-MBR-S1 - by 107 Collected: 10/26/2016 05:56

Lead gdmnoi **4.63** ug/L 11/18/2016 14:03 RPL EPA 200.8 Rev 5.4

[Microbac Laboratories, Inc.](#)

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

48 47A-GIH-MC-MBR-S2 - by 107 Collected: 10/26/2016 05:57

Lead gdmnoi 3.02 ug/L 11/18/2016 14:04 RPL EPA 200.8 Rev 5.4

49 48A-GIH-MC-WF4 - by 107 Collected: 10/26/2016 06:00

Lead gdmnoi 1.06 ug/L 11/18/2016 14:05 RPL EPA 200.8 Rev 5.4

50 49A-GIH-DO-WF1 Collected: 10/26/2016 06:05

Lead gdmnoi 3.80 ug/L 11/18/2016 14:05 RPL EPA 200.8 Rev 5.4

51 50A-GIH-DO-S1 - Kitchen Collected: 10/26/2016 06:06

Lead gdmnoi < 1.00 ug/L 11/18/2016 14:06 RPL EPA 200.8 Rev 5.4

52 51A-GIH-DO-WBR-S2 Collected: 10/26/2016 06:06

Lead gdmnoi 1.32 ug/L 11/18/2016 14:07 RPL EPA 200.8 Rev 5.4

53 52A-GIH-DO-AG-S3 - AG=All Gender Bathroom Collected: 10/26/2016 06:06

Lead gdmnoi 2.29 ug/L 11/18/2016 14:09 RPL EPA 200.8 Rev 5.4

54 53A-GIH-DO-Sprayer - Kitchen Collected: 10/26/2016 06:09

Lead gdmnoi 1.40 ug/L 11/18/2016 14:09 RPL EPA 200.8 Rev 5.4

55 54A-GIH-180-S1 - Coaches Offices Collected: 10/26/2016 06:10

Lead gdmnoi < 1.00 ug/L 11/18/2016 14:10 RPL EPA 200.8 Rev 5.4

56 55A-GIH-122-S1 Collected: 10/26/2016 06:11

Lead gdmnoi 2.18 ug/L 11/18/2016 14:11 RPL EPA 200.8 Rev 5.4

57 56A-GIH-122-S2 Collected: 10/26/2016 06:12

Lead gdmnoi 2.58 ug/L 11/18/2016 14:11 RPL EPA 200.8 Rev 5.4

58 57A-GIH-122-S3 Collected: 10/26/2016 06:12

Lead gdmnoi 7.82 ug/L 11/18/2016 14:12 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

59 58A-GIH-122-S4 Collected: 10/26/2016 06:13

Lead gdmnoi 10.1 ug/L 11/18/2016 14:13 RPL EPA 200.8 Rev 5.4

60 59A-GIH-122-S5 Collected: 10/26/2016 06:15

Lead gdmnoi 2.81 ug/L 11/18/2016 14:13 RPL EPA 200.8 Rev 5.4

61 60A-GIH-122-S6 Collected: 10/26/2016 06:15

Lead gdmnoi 3.19 ug/L 11/18/2016 14:14 RPL EPA 200.8 Rev 5.4

62 61A-GIH-122-WF1 Collected: 10/26/2016 06:15

Lead gdmnoi 2.48 ug/L 11/18/2016 14:15 RPL EPA 200.8 Rev 5.4

63 62A-GIH-121B-S1 Collected: 10/26/2016 06:17

Lead gdmnoi 5.04 ug/L 11/18/2016 14:17 RPL EPA 200.8 Rev 5.4

64 63A-GIH-121B-S2 Collected: 10/26/2016 06:17

Lead gdmnoi 12.9 ug/L 11/18/2016 14:18 RPL EPA 200.8 Rev 5.4

65 64A-GIH-121B-S3 Collected: 10/26/2016 06:18

Lead gdmnoi 1.59 ug/L 11/18/2016 14:18 RPL EPA 200.8 Rev 5.4

66 65A-GIH-121B-WF1 Collected: 10/26/2016 06:18

Lead gdmnoi 6.46 ug/L 11/18/2016 14:19 RPL EPA 200.8 Rev 5.4

67 66A-GIH-121A-S1 Collected: 10/26/2016 06:20

Lead gdmnoi 9.01 ug/L 11/18/2016 14:20 RPL EPA 200.8 Rev 5.4

68 67A-GIH-121A-S2 Collected: 10/26/2016 06:21

Lead gdmnoi 5.86 ug/L 11/18/2016 14:20 RPL EPA 200.8 Rev 5.4

69 68A-GIH-121A-S4 Collected: 10/26/2016 06:21

Lead gdmnoi 6.02 ug/L 11/18/2016 14:21 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

70 69A-GIH-121A-S3 Collected: 10/26/2016 06:22

Lead gdmnoi **6.70** ug/L 11/18/2016 14:22 RPL EPA 200.8 Rev 5.4

71 70A-GIH-152-S1 Collected: 10/26/2016 06:30

Lead gdmnoi **21.2** ug/L 11/18/2016 14:22 RPL EPA 200.8 Rev 5.4

72 71A-GIH-MC-WF5 Collected: 10/26/2016 06:31

Lead gdmnoi **1.41** ug/L 11/18/2016 14:23 RPL EPA 200.8 Rev 5.4

73 1B-GIH-A-WBR-S1 - A=Auditorium Collected: 10/26/2016 05:09

Lead gdmnoi **2.98** ug/L 11/18/2016 14:25 RPL EPA 200.8 Rev 5.4

74 2B-GIH-A-WBR-S2 Collected: 10/26/2016 05:09

Lead gdmnoi **2.25** ug/L 11/18/2016 14:26 RPL EPA 200.8 Rev 5.4

75 3B-GIH-A-WBR-S3 Collected: 10/26/2016 05:09

Lead gdmnoi **2.30** ug/L 11/18/2016 14:26 RPL EPA 200.8 Rev 5.4

76 4B-GIH-A-MBR-S1 Collected: 10/26/2016 05:10

Lead gdmnoi **< 1.00** ug/L 11/18/2016 14:27 RPL EPA 200.8 Rev 5.4

77 5B-GIH-A-MBR-S2 Collected: 10/26/2016 05:10

Lead gdmnoi **< 1.00** ug/L 11/18/2016 14:28 RPL EPA 200.8 Rev 5.4

78 6B-GIH-A-MBR-S3 Collected: 10/26/2016 05:10

Lead gdmnoi **< 1.00** ug/L 11/18/2016 14:29 RPL EPA 200.8 Rev 5.4

79 7B-GIH-A-MBR-S4 Collected: 10/26/2016 05:10

Lead gdmnoi **< 1.00** ug/L 11/18/2016 14:29 RPL EPA 200.8 Rev 5.4

80 8B-GIH-A-MBR-S5 Collected: 10/26/2016 05:10

Lead gdmnoi **< 1.00** ug/L 11/18/2016 14:30 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

81 9B-GIH-A-MBR-S6 Collected: 10/26/2016 05:10

Lead gdmnoi < 1.00 ug/L 11/18/2016 14:31 RPL EPA 200.8 Rev 5.4

82 10B-GIH-A-WF Collected: 10/26/2016 05:13

Lead gdmnoi < 1.00 ug/L 11/18/2016 14:31 RPL EPA 200.8 Rev 5.4

83 11B-GIH-A-BF - BF=Bottle Filler Collected: 10/26/2016 05:14

Lead gdmnoi < 1.00 ug/L 11/18/2016 14:33 RPL EPA 200.8 Rev 5.4

84 12B-GIH-Café-S1 Collected: 10/26/2016 05:20

Lead gdmnoi 1.58 ug/L 11/18/2016 14:34 RPL EPA 200.8 Rev 5.4

85 13B-GIH-Café-Sprayer Collected: 10/26/2016 05:21

Lead gdmnoi 4.35 ug/L 11/18/2016 14:35 RPL EPA 200.8 Rev 5.4

86 14B-GIH-Kitchen-S2 Collected: 10/26/2016 05:22

Lead gdmnoi 8.36 ug/L 11/18/2016 14:35 RPL EPA 200.8 Rev 5.4

87 15B-GIH-Kitchen-S3 Collected: 10/26/2016 05:23

Lead gdmnoi 6.19 ug/L 11/18/2016 14:36 RPL EPA 200.8 Rev 5.4

88 16B-GIH-Kitchen-PF - PF=Pot Filler Collected: 10/26/2016 05:24

Lead gdmnoi 7.15 ug/L 11/18/2016 14:37 RPL EPA 200.8 Rev 5.4

89 17B-GIH-Kitchen-PF2 Collected: 10/26/2016 05:24

Lead gdmnoi 12.2 ug/L 11/18/2016 14:37 RPL EPA 200.8 Rev 5.4

90 18B-GIH-Kitchen-S4 - Food Wash Only Collected: 10/26/2016 05:24

Lead gdmnoi 4.72 ug/L 11/18/2016 14:38 RPL EPA 200.8 Rev 5.4

91 19B-GIH-Kitchen-S5 Collected: 10/26/2016 05:24

Lead gdmnoi 9.43 ug/L 11/21/2016 10:22 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

92 20B-GIH-Kitchen-BR-S1 Collected: 10/26/2016 05:27

Lead gdmnoi 4.38 ug/L 11/21/2016 10:23 RPL EPA 200.8 Rev 5.4

93 21B-GIH-Kitchen-Sprayer2 Collected: 10/26/2016 05:29

Lead gdmnoi 1.23 ug/L 11/21/2016 10:24 RPL EPA 200.8 Rev 5.4

94 22B-GIH-Café-WF Collected: 10/26/2016 05:32

Lead gdmnoi 1.41 ug/L 11/21/2016 10:25 RPL EPA 200.8 Rev 5.4

95 23B-GIH-GO-BreakR-S1 - GO=Guidance Office Collected: 10/26/2016 05:35

Lead gdmnoi < 1.00 ug/L 11/21/2016 10:25 RPL EPA 200.8 Rev 5.4

96 24B-GIH-NO-S1 - NO=Nurses Office Collected: 10/26/2016 05:37

Lead gdmnoi < 1.00 ug/L 11/21/2016 10:28 RPL EPA 200.8 Rev 5.4

97 25B-GIH-NO-S2 Collected: 10/26/2016 05:38

Lead gdmnoi 1.06 ug/L 11/21/2016 10:29 RPL EPA 200.8 Rev 5.4

98 26B-GIH-NO-BR-S1 Collected: 10/26/2016 05:38

Lead gdmnoi 1.01 ug/L 11/21/2016 10:30 RPL EPA 200.8 Rev 5.4

99 27B-GIH-NO-BR-S2 Collected: 10/26/2016 05:39

Lead gdmnoi < 1.00 ug/L 11/21/2016 10:33 RPL EPA 200.8 Rev 5.4

AA 28B-GIH-NO-S3 Collected: 10/26/2016 05:40

Lead gdmnoi 5.68 ug/L 11/21/2016 10:34 RPL EPA 200.8 Rev 5.4

AB 29B-GIH-WSGBR-S1 - WSGBR=Women's staff guidance bathroom Collected: 10/26/2016 05:42

Lead gdmnoi < 1.00 ug/L 11/21/2016 10:37 RPL EPA 200.8 Rev 5.4

AC 30B-GIH-FWBR-S1 - FWBR=Faculty Woman's bathroom Collected: 10/26/2016 05:43

Lead gdmnoi 2.12 ug/L 11/21/2016 10:38 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

AD 31B-GIH-MFBR-S1 - MFBR=Mens Faculty Bathroom

Collected: 10/26/2016 05:45

Lead gdmnoi **1.91** ug/L 11/21/2016 10:39 RPL EPA 200.8 Rev 5.4

AE 32B-GIH-FL-S1 - FI=Faculty Lounge

Collected: 10/26/2016 05:47

Lead gdmnoi **8.53** ug/L 11/21/2016 10:40 RPL EPA 200.8 Rev 5.4

AF 33B-GIH-CC-S1 - CC=Casey's Corner

Collected: 10/26/2016 05:50

Lead gdmnoi **1.34** ug/L 11/23/2016 8:50 SA EPA 200.8 Rev 5.4

AG 34B-GIH-MO-Closet-S1 - MO=Main Office

Collected: 10/26/2016 05:55

Lead gdmnoi **1.13** ug/L 11/21/2016 10:46 RPL EPA 200.8 Rev 5.4

AH 35B-GIH-MO-Kitchen-S1

Collected: 10/26/2016 05:57

Lead gdmnoi **2.05** ug/L 11/21/2016 10:47 RPL EPA 200.8 Rev 5.4

AI 36B-GIH-68-S1

Collected: 10/26/2016 06:03

Lead gdmnoi **< 1.00** ug/L 11/21/2016 10:48 RPL EPA 200.8 Rev 5.4

AJ 37B-GIH-69-S1

Collected: 10/26/2016 06:04

Lead gdmnoi **< 1.00** ug/L 11/21/2016 10:49 RPL EPA 200.8 Rev 5.4

AK 38B-GIH-70-S1

Collected: 10/26/2016 06:04

Lead gdmnoi **< 1.00** ug/L 11/21/2016 10:50 RPL EPA 200.8 Rev 5.4

AL 39B-GIH-72-S1

Collected: 10/26/2016 06:06

Lead gdmnoi **< 1.00** ug/L 11/21/2016 10:53 RPL EPA 200.8 Rev 5.4

AM 40B-GIH-66-S1

Collected: 10/26/2016 06:07

Lead gdmnoi **< 1.00** ug/L 11/21/2016 10:54 RPL EPA 200.8 Rev 5.4

AN 41B-GIH-FBR-S1 - FBR=Faculty bathroom by room 66

Collected: 10/26/2016 06:09

Lead gdmnoi **< 1.00** ug/L 11/21/2016 10:57 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

AO 42B-GIH-MBR-S1 - by room 66

Collected: 10/26/2016 06:12

Lead gdmnoi < 1.00 ug/L 11/21/2016 11:00 RPL EPA 200.8 Rev 5.4

AP 43B-GIH-MBR-S2 - by room 66

Collected: 10/26/2016 06:12

Lead gdmnoi < 1.00 ug/L 11/21/2016 11:01 RPL EPA 200.8 Rev 5.4

AQ 44B-GIH-WBR-S1 - by room 66

Collected: 10/26/2016 06:13

Lead gdmnoi < 1.00 ug/L 11/21/2016 11:04 RPL EPA 200.8 Rev 5.4

AR 45B-GIH-WBR-S2 - by room 66

Collected: 10/26/2016 06:13

Lead gdmnoi < 1.00 ug/L 11/21/2016 11:05 RPL EPA 200.8 Rev 5.4

AS 46B-GIH-High-WF - by room 66

Collected: 10/26/2016 06:14

Lead gdmnoi < 1.00 ug/L 11/21/2016 11:06 RPL EPA 200.8 Rev 5.4

AT 47B-GIH-Low-WF - by room 66

Collected: 10/26/2016 06:14

Lead gdmnoi < 1.00 ug/L 11/21/2016 11:07 RPL EPA 200.8 Rev 5.4

AU 48B-GIH-WF - by room 182

Collected: 10/26/2016 06:17

Lead gdmnoi < 1.00 ug/L 11/21/2016 11:12 RPL EPA 200.8 Rev 5.4

AV 49B-GIH-169-S1

Collected: 10/26/2016 06:20

Lead gdmnoi 2.02 ug/L 11/21/2016 11:13 RPL EPA 200.8 Rev 5.4

AW 50B-GIH-169-S2

Collected: 10/26/2016 06:20

Lead gdmnoi 2.85 ug/L 11/21/2016 11:14 RPL EPA 200.8 Rev 5.4

AX 51B-GIH-169-S3

Collected: 10/26/2016 06:20

Lead gdmnoi 2.22 ug/L 11/21/2016 11:15 RPL EPA 200.8 Rev 5.4

AY 52B-GIH-169-S4

Collected: 10/26/2016 06:21

Lead gdmnoi 3.31 ug/L 11/21/2016 11:16 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

AZ 53B-GIH-165-S1 Collected: 10/26/2016 06:23

Lead	gdmnoi	8.33	ug/L	11/21/2016 11:17	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BA 54B-GIH-165-S2 Collected: 10/26/2016 06:24

Lead	gdmnoi	8.06	ug/L	11/21/2016 11:20	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BB 55B-GIH-165-S3 Collected: 10/26/2016 06:24

Lead	gdmnoi	5.33	ug/L	11/21/2016 11:23	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BC 56B-GIH-165-S4 Collected: 10/26/2016 06:24

Lead	gdmnoi	1.87	ug/L	11/21/2016 11:24	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BD 57B-GIH-WF - Outside 165 Collected: 10/26/2016 06:26

Lead	gdmnoi	< 1.00	ug/L	11/21/2016 11:25	RPL	EPA 200.8 Rev 5.4
------	--------	------------------	------	------------------	-----	-------------------

BE 58B-GIH-BF - Outside 165 Collected: 10/26/2016 06:27

Lead	gdmnoi	< 1.00	ug/L	11/21/2016 11:26	RPL	EPA 200.8 Rev 5.4
------	--------	------------------	------	------------------	-----	-------------------

BF 59B-GIH-MBR-S1 - Outside 165 Collected: 10/26/2016 06:28

Lead	gdmnoi	2.15	ug/L	11/21/2016 11:29	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BG 60B-GIH-MBR-S2 - Outside 165 Collected: 10/26/2016 06:28

Lead	gdmnoi	1.80	ug/L	11/21/2016 11:30	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BH 61B-GIH-WBR-S1 - Outside 165 Collected: 10/26/2016 06:29

Lead	gdmnoi	2.73	ug/L	11/21/2016 11:31	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BI 62B-GIH-WBR-S2 Collected: 10/26/2016 06:29

Lead	gdmnoi	8.72	ug/L	11/21/2016 11:36	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BJ 63B-GIH-WBR-S3 - Outside 165 Collected: 10/26/2016 06:29

Lead	gdmnoi	3.54	ug/L	11/21/2016 11:37	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

[Microbac Laboratories, Inc.](http://www.microbac.com)

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

BK 64B-GIH-WBR-S4 - Outside 165

Collected: 10/26/2016 06:29

Lead	gdmnoi	5.54	ug/L	11/21/2016 11:38	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BL 65B-GIH-WBR-S5 - Outside 165

Collected: 10/26/2016 06:29

Lead	gdmnoi	5.68	ug/L	11/21/2016 11:39	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BM 66B-GIH-WBR-S8

Collected: 10/26/2016 06:37

Lead	gdmnoi	6.76	ug/L	11/21/2016 11:40	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BN 67B-GIH-172-S1

Collected: 10/26/2016 06:40

Lead	gdmnoi	4.25	ug/L	11/21/2016 11:41	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BO 68B-GIH-171-S2

Collected: 10/26/2016 06:40

Lead	gdmnoi	7.06	ug/L	11/21/2016 11:42	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BP 69B-GIH-171-S3

Collected: 10/26/2016 06:41

Lead	gdmnoi	13.3	ug/L	11/23/2016 8:52	SA	EPA 200.8 Rev 5.4
------	--------	-------------	------	-----------------	----	-------------------

BQ 70B-GIH-171-S4

Collected: 10/26/2016 06:41

Lead	gdmnoi	18.3	ug/L	11/21/2016 11:44	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BR 71B-GIH-171-S5

Collected: 10/26/2016 06:42

Lead	gdmnoi	12.2	ug/L	11/21/2016 11:47	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BS 72B-GIH-171-S6

Collected: 10/26/2016 06:42

Lead	gdmnoi	11.8	ug/L	11/21/2016 11:48	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BT 73B-GIH-171-S7

Collected: 10/26/2016 06:43

Lead	gdmnoi	9.08	ug/L	11/21/2016 11:49	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

BU 74B-GIH-171-S8

Collected: 10/26/2016 06:43

Lead	gdmnoi	8.92	ug/L	11/21/2016 11:50	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

BV 75B-GIH-171-S9

Collected: 10/26/2016 06:44

Lead	gdmnoi	7.69	ug/L	11/21/2016 11:51	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

BW 76B-GIH-171-S10

Collected: 10/26/2016 06:44

Lead	gdmnoi	14.3	ug/L	11/21/2016 11:53	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

BX 77B-GIH-171-S11

Collected: 10/26/2016 06:45

Lead	gdmnoi	9.28	ug/L	11/21/2016 11:54	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

BY 78B-GIH-171-S12

Collected: 10/26/2016 06:46

Lead	gdmnoi	16.4	ug/L	11/21/2016 11:55	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

BZ 79B-GIH-171-S13

Collected: 10/26/2016 06:46

Lead	gdmnoi	10.7	ug/L	11/21/2016 11:56	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

CA 80B-GIH-171-S14

Collected: 10/26/2016 06:46

Lead	gdmnoi	12.3	ug/L	11/21/2016 11:57	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

CB 81B-GIH-171-S15

Collected: 10/26/2016 06:47

Lead	gdmnoi	3.74	ug/L	11/21/2016 12:02	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

CC 82B-GIH-171-S16

Collected: 10/26/2016 06:48

Lead	gdmnoi	4.99	ug/L	11/21/2016 12:03	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

CD 83B-GIH-MS. Eppers-S

Collected: 10/26/2016 06:52

Lead	gdmnoi	3.21	ug/L	11/21/2016 12:04	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

CE 84B-GIH-Library-S1

Collected: 10/26/2016 06:52

Lead	gdmnoi	14.9	ug/L	11/21/2016 12:05	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

CF 1C-GIH-HW-WF - By 203

Collected: 10/26/2016 05:03

Lead	gdmnoi	< 1.00	ug/L	11/21/2016 12:06	RPL	EPA 200.8 Rev 5.4
------	---------------	------------------	------	------------------	-----	-------------------

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

CG 2C-GIH-205-S1 Collected: 10/26/2016 05:07

Lead gdmnoi 2.38 ug/L 11/21/2016 12:09 RPL EPA 200.8 Rev 5.4

CH 3C-GIH-WB-S1 - Faculty Collected: 10/26/2016 05:08

Lead gdmnoi < 1.00 ug/L 11/21/2016 12:12 RPL EPA 200.8 Rev 5.4

CI 4C-GIH-MB-S1 - Faculty Collected: 10/26/2016 07:08

Lead gdmnoi < 1.00 ug/L 11/21/2016 12:13 RPL EPA 200.8 Rev 5.4

CJ 5C-GIH-211-S1 Collected: 10/26/2016 05:10

Lead gdmnoi 1.47 ug/L 11/21/2016 12:14 RPL EPA 200.8 Rev 5.4

CK 6C-GIH-211-S2 Collected: 10/26/2016 05:10

Lead gdmnoi 3.00 ug/L 11/21/2016 12:17 RPL EPA 200.8 Rev 5.4

CL 7C-GIH-211-S3 Collected: 10/26/2016 05:11

Lead gdmnoi 4.42 ug/L 11/21/2016 12:18 RPL EPA 200.8 Rev 5.4

CM 8C-GIH-211-S4 Collected: 10/26/2016 05:12

Lead gdmnoi 5.53 ug/L 11/21/2016 12:20 RPL EPA 200.8 Rev 5.4

CN 9C-GIH-211-S5 Collected: 10/26/2016 05:12

Lead gdmnoi 5.09 ug/L 11/21/2016 12:21 RPL EPA 200.8 Rev 5.4

CO 10C-GIH-211-S6 Collected: 10/26/2016 05:14

Lead gdmnoi 4.03 ug/L 11/21/2016 12:26 RPL EPA 200.8 Rev 5.4

CP 11C-GIH-211-S7 Collected: 10/26/2016 07:13

Lead gdmnoi 3.78 ug/L 11/23/2016 8:53 SA EPA 200.8 Rev 5.4

CQ 12C-GIH-211-S8 Collected: 10/26/2016 05:15

Lead gdmnoi 3.89 ug/L 11/21/2016 12:28 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

CR 13C-GIH-211-S9 Collected: 10/26/2016 05:15

Lead gdmnoi **6.58** ug/L 11/23/2016 8:55 SA EPA 200.8 Rev 5.4

CS 14C-GIH-211-S10 Collected: 10/26/2016 05:16

Lead gdmnoi **4.60** ug/L 11/21/2016 12:30 RPL EPA 200.8 Rev 5.4

CT 15C-GIH-211-S11 Collected: 10/26/2016 05:17

Lead gdmnoi **3.81** ug/L 11/21/2016 12:31 RPL EPA 200.8 Rev 5.4

CU 16C-GIH-211-S12 Collected: 10/26/2016 05:18

Lead gdmnoi **4.31** ug/L 11/21/2016 12:32 RPL EPA 200.8 Rev 5.4

CV 17C-GIH-211-S13 Collected: 10/26/2016 05:18

Lead gdmnoi **4.05** ug/L 11/21/2016 12:33 RPL EPA 200.8 Rev 5.4

CW 18C-GIH-211-S14 Collected: 10/26/2016 05:18

Lead gdmnoi **3.94** ug/L 11/21/2016 12:34 RPL EPA 200.8 Rev 5.4

CX 19C-GIH-211-S19 Collected: 10/26/2016 05:19

Lead gdmnoi **4.77** ug/L 11/21/2016 12:38 RPL EPA 200.8 Rev 5.4

CY 20C-GIH-211-S20 Collected: 10/26/2016 05:19

Lead gdmnoi **2.98** ug/L 11/21/2016 12:39 RPL EPA 200.8 Rev 5.4

CZ 21C-GIH-213-S1 Collected: 10/26/2016 05:21

Lead gdmnoi **2.45** ug/L 11/21/2016 12:40 RPL EPA 200.8 Rev 5.4

DA 22C-GIH-213-S2 Collected: 10/26/2016 05:22

Lead gdmnoi **8.94** ug/L 11/21/2016 12:41 RPL EPA 200.8 Rev 5.4

DB 23C-GIH-213-S3 Collected: 10/26/2016 05:23

Lead gdmnoi **11.4** ug/L 11/21/2016 12:42 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

DC 24C-GIH-213-S4 *Collected: 10/26/2016 05:23*

Lead	gdmnoi	7.45	ug/L	11/21/2016 12:43	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DD 25C-GIH-213-S5 *Collected: 10/26/2016 05:24*

Lead	gdmnoi	7.13	ug/L	11/21/2016 12:44	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DE 26C-GIH-213-S6 *Collected: 10/26/2016 05:24*

Lead	gdmnoi	6.86	ug/L	11/21/2016 12:45	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DF 27C-GIH-213-S7 *Collected: 10/26/2016 05:25*

Lead	gdmnoi	9.04	ug/L	11/21/2016 12:46	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DG 28C-GIH-213-S8 *Collected: 10/26/2016 05:25*

Lead	gdmnoi	7.46	ug/L	11/21/2016 12:47	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DH 29C-GIH-213-S9 *Collected: 10/26/2016 05:26*

Lead	gdmnoi	9.70	ug/L	11/21/2016 12:50	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DI 30C-GIH-213-S10 *Collected: 10/26/2016 05:26*

Lead	gdmnoi	9.25	ug/L	11/21/2016 12:51	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DJ 31C-GIH-213-S11 *Collected: 10/26/2016 05:27*

Lead	gdmnoi	11.6	ug/L	11/21/2016 12:52	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DK 32C-GIH-213-S12 *Collected: 10/26/2016 05:27*

Lead	gdmnoi	9.25	ug/L	11/21/2016 12:53	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DL 33C-GIH-213-S13 *Collected: 10/26/2016 05:28*

Lead	gdmnoi	9.30	ug/L	11/21/2016 12:54	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

DM 34C-GIH-213-S14 *Collected: 10/26/2016 05:28*

Lead	gdmnoi	9.75	ug/L	11/21/2016 12:55	RPL	EPA 200.8 Rev 5.4
------	--------	-------------	------	------------------	-----	-------------------

[Microbac Laboratories, Inc.](http://www.microbac.com)

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

DN 35C-GIH-213-S15 - Hood

Collected: 10/26/2016 05:30

Lead **dgimno** **674** ug/L E 11/18/2016 15:31 SJE EPA 200.8 Rev 5.4

DO 36C-GIH-213-S16

Collected: 10/26/2016 05:30

Lead **gdmnoi** **5.76** ug/L 11/21/2016 12:57 RPL EPA 200.8 Rev 5.4

DP 37C-GIH-213-S17

Collected: 10/26/2016 05:31

Lead **gdmnoi** **7.62** ug/L 11/21/2016 12:58 RPL EPA 200.8 Rev 5.4

DQ 38C-GIH-211-S17

Collected: 10/26/2016 05:37

Lead **gdmnoi** **35.9** ug/L 11/21/2016 12:59 RPL EPA 200.8 Rev 5.4

DR 39C-GIH-BB-S1

Collected: 10/26/2016 05:38

Lead **gdmnoi** **3.53** ug/L 11/21/2016 13:00 RPL EPA 200.8 Rev 5.4

DS 40C-GIH-BB-S2

Collected: 10/26/2016 05:42

Lead **gdmnoi** **2.66** ug/L 11/21/2016 13:03 RPL EPA 200.8 Rev 5.4

DT 41C-GIH-BB-S3

Collected: 10/26/2016 05:42

Lead **gdmnoi** **2.52** ug/L 11/21/2016 13:04 RPL EPA 200.8 Rev 5.4

DU 42C-GIH-BB-S4

Collected: 10/26/2016 05:43

Lead **gdmnoi** **2.30** ug/L 11/21/2016 13:05 RPL EPA 200.8 Rev 5.4

DV 43C-GIH-HW-WF - Outside 214

Collected: 10/26/2016 05:44

Lead **gdmnoi** **< 1.00** ug/L 11/21/2016 13:06 RPL EPA 200.8 Rev 5.4

DW 44C-GIH-GB-S1

Collected: 10/26/2016 05:45

Lead **gdmnoi** **< 1.00** ug/L 11/21/2016 13:07 RPL EPA 200.8 Rev 5.4

DY 46C-GIH-GB-S3

Collected: 10/26/2016 05:46

Lead **gdmnoi** **< 1.00** ug/L 11/21/2016 13:08 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

DZ 47C-GIH-GB-S4

Collected: 10/26/2016 05:46

Lead gdmnoi **1.09** ug/L 11/21/2016 13:09 RPL EPA 200.8 Rev 5.4

EA 48C-GIH-214-S1

Collected: 10/26/2016 05:49

Lead gdmnoi **3.23** ug/L 11/21/2016 13:10 RPL EPA 200.8 Rev 5.4

EB 49C-GIH-214-S2

Collected: 10/26/2016 05:49

Lead gdmnoi **3.19** ug/L 11/21/2016 13:12 RPL EPA 200.8 Rev 5.4

EC 50C-GIH-214-S3

Collected: 10/26/2016 05:50

Lead gdmnoi **6.01** ug/L 11/21/2016 13:13 RPL EPA 200.8 Rev 5.4

ED 51C-GIH-214-S4

Collected: 10/26/2016 05:50

Lead gdmnoi **3.01** ug/L 11/21/2016 13:16 RPL EPA 200.8 Rev 5.4

EE 52C-GIH-214-S5

Collected: 10/26/2016 05:51

Lead gdmnoi **4.30** ug/L 11/21/2016 13:17 RPL EPA 200.8 Rev 5.4

EF 53C-GIH-214-S6

Collected: 10/26/2016 05:51

Lead gdmnoi **3.15** ug/L 11/21/2016 13:18 RPL EPA 200.8 Rev 5.4

EG 54C-GIH-214-S7

Collected: 10/26/2016 05:51

Lead gdmnoi **6.97** ug/L 11/21/2016 13:19 RPL EPA 200.8 Rev 5.4

EH 55C-GIH-214-S8

Collected: 10/26/2016 05:52

Lead gdmnoi **5.29** ug/L 11/21/2016 13:20 RPL EPA 200.8 Rev 5.4

EI 56C-GIH-214-S9

Collected: 10/26/2016 05:52

Lead gdmnoi **4.50** ug/L 11/21/2016 13:21 RPL EPA 200.8 Rev 5.4

EJ 57C-GIH-214-S10

Collected: 10/26/2016 05:53

Lead gdmnoi **4.02** ug/L 11/21/2016 13:22 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

EK 58C-GIH-214-S11 *Collected: 10/26/2016 05:53*

Lead	gdmnoi	5.26	ug/L	11/21/2016 13:24	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

EL 59C-GIH-214-S12 *Collected: 10/26/2016 05:53*

Lead	gdmnoi	4.46	ug/L	11/21/2016 13:25	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

EM 60C-GIH-214-S13 *Collected: 10/26/2016 05:54*

Lead	gdmnoi	7.20	ug/L	11/21/2016 13:26	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

EN 61C-GIH-214-S14 *Collected: 10/26/2016 05:59*

Lead	gdmnoi	5.30	ug/L	11/21/2016 13:29	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

EO 62C-GIH-214-S15 - Hood *Collected: 10/26/2016 05:55*

Lead	gdmnoi	93.6	ug/L	11/21/2016 13:30	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

EP 63C-GIH-214-S16 *Collected: 10/26/2016 05:55*

Lead	gdmnoi	2.23	ug/L	11/21/2016 13:31	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

EQ 64C-GIH-214-S17 *Collected: 10/26/2016 05:57*

Lead	gdmnoi	2.34	ug/L	11/21/2016 13:32	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

ER 65C-GIH-223-S1 *Collected: 10/26/2016 05:59*

Lead	gdmnoi	3.50	ug/L	11/21/2016 13:33	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

ES 66C-GIH-223-S2 *Collected: 10/26/2016 06:00*

Lead	gdmnoi	4.19	ug/L	11/21/2016 13:34	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

ET 67C-GIH-223-S3 *Collected: 10/26/2016 06:00*

Lead	gdmnoi	8.05	ug/L	11/21/2016 13:36	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

EU 68C-GIH-223-S4 *Collected: 10/26/2016 06:00*

Lead	gdmnoi	5.58	ug/L	11/21/2016 13:37	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

EV 69C-GIH-223-S5

Collected: 10/26/2016 06:02

Lead gdmnoi **6.76** ug/L 11/21/2016 13:38 RPL EPA 200.8 Rev 5.4

EW 70C-GIH-223-S5

Collected: 10/26/2016 06:02

Lead gdmnoi **7.89** ug/L 11/21/2016 13:39 RPL EPA 200.8 Rev 5.4

EX 71C-GIH-223-S7

Collected: 10/26/2016 06:03

Lead gdmnoi **4.90** ug/L 11/21/2016 13:42 RPL EPA 200.8 Rev 5.4

EY 72C-GIH-223-S8

Collected: 10/26/2016 06:03

Lead gdmnoi **4.97** ug/L 11/21/2016 13:43 RPL EPA 200.8 Rev 5.4

EZ 73C-GIH-223-S9

Collected: 10/26/2016 06:04

Lead gdmnoi **8.49** ug/L 11/21/2016 13:44 RPL EPA 200.8 Rev 5.4

FA 74C-GIH-223-S10

Collected: 10/26/2016 06:04

Lead gdmnoi **6.04** ug/L 11/21/2016 15:18 RPL EPA 200.8 Rev 5.4

FB 75C-GIH-223-S11

Collected: 10/26/2016 06:05

Lead gdmnoi **10.5** ug/L 11/21/2016 15:22 RPL EPA 200.8 Rev 5.4

FC 76C-GIH-223-S12

Collected: 10/26/2016 06:05

Lead gdmnoi **13.4** ug/L 11/21/2016 15:23 RPL EPA 200.8 Rev 5.4

FD 77C-GIH-223-S13

Collected: 10/26/2016 06:05

Lead gdmnoi **11.1** ug/L 11/21/2016 15:24 RPL EPA 200.8 Rev 5.4

FE 78C-GIH-223-S14

Collected: 10/26/2016 06:06

Lead gdmnoi **10.7** ug/L 11/21/2016 15:25 RPL EPA 200.8 Rev 5.4

FF 79C-GIH-223-S15

Collected: 10/26/2016 06:07

Lead gdmnoi **73.8** ug/L 11/21/2016 15:26 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

FG 80C-GIH-223-S16 *Collected: 10/26/2016 06:07*

Lead	gdmnoi	3.72	ug/L	11/21/2016 15:30	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

FH 81C-GIH-223-S17 *Collected: 10/26/2016 06:07*

Lead	gdmnoi	3.54	ug/L	11/21/2016 15:31	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

FI 82C-GIH-223-S17 *Collected: 10/26/2016 06:11*

Lead	gdmnoi	72.5	ug/L	11/21/2016 15:35	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

FJ 83C-GIH-215-S2 *Collected: 10/26/2016 06:11*

Lead	gdmnoi	2.32	ug/L	11/21/2016 15:36	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

FK 84C-GIH-223A-S1 - Hood *Collected: 10/26/2016 06:12*

Lead	gdmnoi	558	ug/L	E	11/21/2016 15:37	RPL	EPA 200.8 Rev 5.4
------	---------------	------------	------	---	------------------	-----	-------------------

FL 85C-GIH-223A-S2 *Collected: 10/26/2016 06:13*

Lead	gdmnoi	8.75	ug/L	11/21/2016 15:38	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

FM 86C-GIH-216-S1 *Collected: 10/26/2016 06:15*

Lead	gdmnoi	8.31	ug/L	11/21/2016 15:39	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

FN 87C-GIH-216-S2 *Collected: 10/26/2016 06:16*

Lead	gdmnoi	4.18	ug/L	11/21/2016 15:45	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

FO 88C-GIH-216-S3 *Collected: 10/26/2016 06:16*

Lead	gdmnoi	8.21	ug/L	11/21/2016 15:46	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

FP 89C-GIH-216-S4 *Collected: 10/26/2016 06:11*

Lead	gdmnoi	7.11	ug/L	11/21/2016 15:47	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

FQ 90C-GIH-216-S5 *Collected: 10/26/2016 06:17*

Lead	gdmnoi	8.02	ug/L	11/21/2016 15:48	RPL	EPA 200.8 Rev 5.4
------	---------------	-------------	------	------------------	-----	-------------------

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

FR 91C-GIH-216-S6

Collected: 10/26/2016 06:17

Lead gdmnoi **8.46** ug/L 11/21/2016 15:50 RPL EPA 200.8 Rev 5.4

FS 92C-GIH-216-S7

Collected: 10/26/2016 06:18

Lead gdmnoi **10.7** ug/L 11/21/2016 15:51 RPL EPA 200.8 Rev 5.4

FT 93C-GIH-216-S8

Collected: 10/26/2016 06:18

Lead gdmnoi **12.2** ug/L 11/21/2016 15:52 RPL EPA 200.8 Rev 5.4

FU 94C-GIH-216-S9

Collected: 10/26/2016 06:19

Lead gdmnoi **10.2** ug/L 11/21/2016 15:58 RPL EPA 200.8 Rev 5.4

FV 95C-GIH-216-S10

Collected: 10/26/2016 06:19

Lead gdmnoi **9.13** ug/L 11/21/2016 15:59 RPL EPA 200.8 Rev 5.4

FW 96C-GIH-216-S11

Collected: 10/26/2016 06:20

Lead gdmnoi **10.2** ug/L 11/21/2016 16:00 RPL EPA 200.8 Rev 5.4

FX 97C-GIH-216-S12

Collected: 10/26/2016 06:20

Lead gdmnoi **7.83** ug/L 11/21/2016 16:02 RPL EPA 200.8 Rev 5.4

FY 98C-GIH-216-S13

Collected: 10/26/2016 06:20

Lead gdmnoi **12.7** ug/L 11/21/2016 16:03 RPL EPA 200.8 Rev 5.4

FZ 99C-GIH-216-S14

Collected: 10/26/2016 06:21

Lead gdmnoi **13.1** ug/L 11/21/2016 16:04 RPL EPA 200.8 Rev 5.4

GA 100C-GIH-216-S15 - Hood

Collected: 10/26/2016 06:21

Lead gdmnoi **48.7** ug/L 11/23/2016 8:56 SA EPA 200.8 Rev 5.4

GB 101C-GIH-216-S16

Collected: 10/26/2016 06:22

Lead gdmnoi **77.6** ug/L 11/21/2016 16:09 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

GC 102C-GIH-216-S17 Collected: 10/26/2016 06:22

Lead gdmnoi 76.8 ug/L 11/21/2016 16:12 RPL EPA 200.8 Rev 5.4

GD 103C-GIH-217-S1 Collected: 10/26/2016 06:25

Lead gdmnoi 6.67 ug/L 11/21/2016 16:13 RPL EPA 200.8 Rev 5.4

GE 104C-GIH-217-S2 Collected: 10/26/2016 06:25

Lead gdmnoi 3.59 ug/L 11/21/2016 16:14 RPL EPA 200.8 Rev 5.4

GF 105C-GIH-217-S3 Collected: 10/26/2016 06:26

Lead gdmnoi 3.46 ug/L 11/21/2016 16:16 RPL EPA 200.8 Rev 5.4

GG 106C-GIH-217-S4 Collected: 10/26/2016 06:26

Lead gdmnoi 11.1 ug/L 11/21/2016 16:17 RPL EPA 200.8 Rev 5.4

GH 107C-GIH-217-S5 Collected: 10/26/2016 06:26

Lead gdmnoi 10.0 ug/L 11/23/2016 8:58 SA EPA 200.8 Rev 5.4

GI 108C-GIH-217-S6 Collected: 10/26/2016 06:27

Lead gdmnoi 39.1 ug/L 11/21/2016 16:21 RPL EPA 200.8 Rev 5.4

GJ 109C-GIH-217-S7 Collected: 10/26/2016 06:27

Lead gdmnoi 42.4 ug/L 11/21/2016 16:23 RPL EPA 200.8 Rev 5.4

GK 110C-GIH-217-S8 Collected: 10/26/2016 06:27

Lead gdmnoi 10.5 ug/L 11/21/2016 16:26 RPL EPA 200.8 Rev 5.4

GL 11C-GIH-217-S9 Collected: 10/26/2016 06:23

Lead gdmnoi 11.1 ug/L 11/21/2016 16:27 RPL EPA 200.8 Rev 5.4

GM 112C-GIH-217-S10 Collected: 10/26/2016 06:28

Lead gdmnoi 12.6 ug/L 11/21/2016 16:28 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

GN 113C-GIH-217-S11 *Collected: 10/26/2016 06:29*

Lead **gdmnoi 11.8** ug/L 11/29/2016 13:16 SA EPA 200.8 Rev 5.4

GO 114C-GIH-217-S12 *Collected: 10/26/2016 06:29*

Lead **gdmnoi 41.7** ug/L 11/21/2016 16:33 RPL EPA 200.8 Rev 5.4

GP 115C-GIH-217-S13 *Collected: 10/26/2016 06:29*

Lead **gdmnoi 44.8** ug/L 11/21/2016 16:34 RPL EPA 200.8 Rev 5.4

GQ 116C-GIH-217-S14 *Collected: 10/26/2016 06:30*

Lead **gdmnoi 9.08** ug/L 11/21/2016 16:35 RPL EPA 200.8 Rev 5.4

GR 117C-GIH-217-S15 *Collected: 10/26/2016 06:30*

Lead **gdmnoi 9.73** ug/L 11/21/2016 16:37 RPL EPA 200.8 Rev 5.4

GS 118C-GIH-217-S16 *Collected: 10/26/2016 06:30*

Lead **gdmnoi 17.7** ug/L 11/21/2016 16:40 RPL EPA 200.8 Rev 5.4

GT 119C-GIH-HW-WF - Outside 230 *Collected: 10/26/2016 06:33*

Lead **gdmnoi 4.59** ug/L 11/21/2016 16:41 RPL EPA 200.8 Rev 5.4

GU 120C-GIH-163-S1 *Collected: 10/26/2016 06:47*

Lead **gdmnoi 19.2** ug/L 11/21/2016 16:43 RPL EPA 200.8 Rev 5.4

GV 121C-GIH-163-S2 *Collected: 10/26/2016 06:47*

Lead **gdmnoi 1.12** ug/L 11/21/2016 16:44 RPL EPA 200.8 Rev 5.4

GW 122C-GIH-163-S3 *Collected: 10/26/2016 06:48*

Lead **gdmnoi 6.31** ug/L 11/21/2016 16:45 RPL EPA 200.8 Rev 5.4

GX 123C-GIH-163-S4 *Collected: 10/26/2016 06:48*

Lead **gdmnoi 9.64** ug/L 11/21/2016 16:46 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Analytical Results

Date: Wednesday, November 30, 2016

GY 124C-GIH-162-S1

Collected: 10/26/2016 06:51

Lead gdmnoi 17.2 ug/L 11/21/2016 16:47 RPL EPA 200.8 Rev 5.4

GZ 125C-GIH-162-S2

Collected: 10/26/2016 06:51

Lead gdmnoi 3.71 ug/L 11/23/2016 9:04 SA EPA 200.8 Rev 5.4

HA 126C-GIH-162-S3

Collected: 10/26/2016 06:57

Lead gdmnoi 10.5 ug/L 11/21/2016 16:55 RPL EPA 200.8 Rev 5.4

HB 127C-GIH-167-S4

Collected: 10/26/2016 06:52

Lead gdmnoi 6.73 ug/L 11/21/2016 16:56 RPL EPA 200.8 Rev 5.4

FLAGS, FOOTNOTES AND ABBREVIATIONS (as needed)

B = Detected in the associated method Blank at a concentration above the routine RL
 b- = Detected in the associated method Blank at a concentration greater than 2.2 times the MDL
 b* = Detected in the associated method Blank at a concentration greater than half the RL
 CFU = Colony forming units
 D = Dilution performed on sample
 DF = Dilution Factor
 g = Gram
 E = Value above quantitation range
 H = Analyte was prepared and/or analyzed outside of the analytical method holding time
 I = Matrix Interference
 J = Analyte concentration detected between RL and MDL (Metals / Organics)
 LOD = Limit of Detection
 LOQ = Limit of Quantitation
 m3 = Meters cubed
 MDL = Method Detection Limit
 mg/Kg = Milligrams per Kilogram (ppm)
 mg/L = Milligrams per Liter (ppm)
 NA = Not Analyzed
 ND = Not Detected at the Reporting Limit (or the Method Detection Limit, if used)
 NR = Not Recovered
 R = RPD outside accepted recovery limits
 RL = Reporting Limit
 S = Spike recovery outside recovery limits
 Surr = Surrogate
 U = Undetected
 > = Greater than
 < = Less than
 % = Percent
 * = Result exceeds project specific limits

ANALYTE TYPES: (AT)

A,B = Target Analyte
 I = Internal Standard
 M = Summation Analyte
 S = Surrogate
 T = Tentatively Identified Compound (TIC, concentration estimated)

QC SAMPLE IDENTIFICATIONS

BLK = Method Blank	ICSA = Interference Check Standard "A"
DUP = Method Duplicate	ICSAB = Interference Check Standard "AB"
BS = Method Blank Spike	BSD = Method Blank Spike Duplicate
MS = Matrix Spike	MSD = Matrix Spike Duplicate
ICB = Initial Calibration Blank	ICV = Initial Calibration Verification
CCB = Continuing Calibration Blank	CCV = Continuing Calibration Verification
CRL = Client Required Reporting Limit	OPR = Ongoing Precision and Recovery Standard
PDS = Post Digestion Spike	SD = Serial Dilution
QCS = Quality Control Standard	

CERTIFICATIONS (Certs)

Below is a list of certifications maintained by the Microbac Merrillville Laboratory. All data included in this report has been reviewed for and meets all project specific and quality control requirements of the applicable accreditation, unless otherwise noted. Complete lists of individual analytes pursuant to each certification below are available upon request.

- ^d Illinois EPA drinking water, wastewater and solid waste analysis (#200064)
- ^g Indiana SDH chemical analysis of drinking water (#C-45-03)
- ⁱ Kansas Dept Health & Env. NELAP (#E-10397)
- ^m New York State Department of Health Wadsworth (#12006)
- ⁿ Pennsylvania Department of Environmental Protection (#68-04863)
- ^o Virginia Department of General Services Division of Consolidated Laboratory Services (#7990)



COOLER INSPECTION

Date: Wednesday, November 30, 2016
Client Name: The Lotis Engineering Group, P.C.
Date/Time Received: 10/28/2016 15:20
Work Order Number: 16K0100
Received by: Nicole Rainwater
Checklist completed by: 11/2/2016 9:18:02AM | Nicole Rainwater
Reviewed by: 11/4/2016 | KAZ
Carrier Name: Client Delivered

Cooler ID: Default Cooler

Container/Temp Blank Temperature: 20.7° C

After-Hour Arrival?	Yes	☐	No	☒	
Shipping container/cooler in good condition?	Yes	☒	No	☐	Not Present ☐
Custody seals intact on shipping container/cooler?	Yes	☐	No	☐	Not Present ☒
Custody seals intact on sample containers?	Yes	☐	No	☐	Not Present ☒
COC present?	Yes	☒	No	☐	
COC included sufficient client identification?	Yes	☒	No	☐	
COC included sufficient sample collector information?	Yes	☒	No	☐	
COC included a sample description?	Yes	☒	No	☐	
COC agrees with sample labels?	Yes	☒	No	☐	
COC identified the appropriate matrix?	Yes	☒	No	☐	
COC included date of collection?	Yes	☒	No	☐	
COC included time of collection?	Yes	☒	No	☐	
COC identified the appropriate number of containers?	Yes	☐	No	☒	
Samples in proper container/bottle?	Yes	☒	No	☐	
Sample containers intact?	Yes	☒	No	☐	
Sufficient sample volume for indicated test?	Yes	☒	No	☐	
All samples received within holding time?	Yes	☒	No	☐	
If the samples are preserved, are the preservatives identified?	Yes	☒	No	☐	

If No, adjusted by? _____

COC included the requested analyses?	Yes	☒	No	☐	
COC signed when relinquished and received?	Yes	☒	No	☐	
Samples received on ice?	Yes	☐	No	☒	
Samples properly preserved?	Yes	☒	No	☐	
Voa vials for aqueous samples have zero headspace?	Yes	☐	No	☐	No VOA vials submitted ☒

Cooler Comments: _____

ANY "NO" EVALUATION (excluding After-Hour Receipt) REQUIRES CLIENT NOTIFICATION.

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Sample ID	Client Sample ID	Comments
16K0100-01	Example Sample	
16K0100-02	1A-GIH-124A-S1	
16K0100-03	2A-GIH-214A-S2	
16K0100-04	3A-GIH-123B-S1	
16K0100-05	4A-GIH-123B-S2	
16K0100-06	5A-GIH-123B-WF1	
16K0100-07	6A-GIH-MC-WF1	
16K0100-08	7A-GIH-118-GPLR-S1	
16K0100-09	8A-GIH-118-GPLR-S2	
16K0100-10	9A-GIH-118-GPLR-S3	
16K0100-11	10A-GIH-118-GPLR-WF1	
16K0100-12	11A-GIH-Pool-WF1	
16K0100-13	12A-GIH-Pool-WF2	
16K0100-14	13A-GIH-117-BPLR-S1	
16K0100-15	14A-GIH-117-BPLR-S2	
16K0100-16	15A-GIH-117-BPLR-WF1	
16K0100-17	16A-GIH-117-BPLR-S3	
16K0100-18	17A-GIH-GTR-A+B-S1	
16K0100-19	18A-GIH-GTR-A+B-S2	
16K0100-20	19A-GIH-GTR-A+B-S3	
16K0100-21	20A-GIH-GTRB-S1	
16K0100-22	21A-GIH-GTLR-A-S1	
16K0100-23	22A-GIH-MC-WF2	
16K0100-24	23A-GIH-GTLR-C+D-S1	
16K0100-25	24A-GIH-GLTR-C+D-S2	
16K0100-26	25A-GIH-GTLR-C+D-S3	
16K0100-27	26A-GIH-GTLR-D-S1	
16K0100-28	27A-GIH-GTLR-C-S1	
16K0100-29	28A-GIH-Gym2-WF1	
16K0100-30	29A-GIH-Gym2-WF2	
16K0100-31	30A-GIH-PGym-WBR-S1	
16K0100-32	31A-GIH-PGym-WBR-S2	
16K0100-33	32A-GIH-PGym-WBR-S3	
16K0100-34	33A-GIH-113-BTR-S1	
16K0100-35	34A-GIH-113-BTLR-S2	
16K0100-36	35A-GIH-113-BTLR-WF	
16K0100-37	36A-GIH-113-BTLR-Spicket	
16K0100-38	37A-GIH-TO-S1	
16K0100-39	38A-GIH-TO-Ice Machine	
16K0100-40	39A-GIH-MC-WF3	
16K0100-41	40A-GIH-112-BTL-S2	
16K0100-42	41A-GIH-112-BTL-S1	
16K0100-43	42A-GIH-112-BTL-S3	
16K0100-44	43A-GIH-110-Office A- S1	
16K0100-45	44A-GIH-MC-WBR-S1	
16K0100-51	50A-GIH-DO-S1	
16K0100-52	51A-GIH-DO-WBR-S2	
16K0100-53	52A-GIH-DO-AG-S3	
16K0100-54	53A-GIH-DO-Sprayer	

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

16K0100-55	54A-GIH-180-S1
16K0100-61	60A-GIH-122-S6
16K0100-62	61A-GIH-122-WF1
16K0100-63	62A-GIH-121B-S1
16K0100-64	63A-GIH-121B-S2
16K0100-65	64A-GIH-121B-S3
16K0100-71	70A-GIH-152-S1
16K0100-72	71A-GIH-MC-WF5
16K0100-73	1B-GIH-A-WBR-S1
16K0100-74	2B-GIH-A-WBR-S2
16K0100-75	3B-GIH-A-WBR-S3
16K0100-81	9B-GIH-A-MBR-S6
16K0100-82	10B-GIH-A-WF
16K0100-83	11B-GIH-A-BF
16K0100-84	12B-GIH-Café-S1
16K0100-85	13B-GIH-Café-Sprayer
16K0100-91	19B-GIH-Kitchen-S5
16K0100-92	20B-GIH-Kitchen-BR-S1
16K0100-93	21B-GIH-Kitchen-Sprayer2
16K0100-94	22B-GIH-Café-WF
16K0100-95	23B-GIH-GO-BreakR-S1
16K0100-AB	29B-GIH-WSGBR-S1
16K0100-AC	30B-GIH-FWBR-S1
16K0100-AD	31B-GIH-MFBR-S1
16K0100-AE	32B-GIH-FL-S1
16K0100-AF	33B-GIH-CC-S1
16K0100-AL	39B-GIH-72-S1
16K0100-AM	40B-GIH-66-S1
16K0100-AN	41B-GIH-FBR-S1
16K0100-AO	42B-GIH-MBR-S1
16K0100-AP	43B-GIH-MBR-S2
16K0100-46	45A-GIH-MC-WBR-S2
16K0100-47	46A-GIH-MC-MBR-S1
16K0100-48	47A-GIH-MC-MBR-S2
16K0100-49	48A-GIH-MC-WF4
16K0100-50	49A-GIH-DO-WF1
16K0100-56	55A-GIH-122-S1
16K0100-57	56A-GIH-122-S2
16K0100-58	57A-GIH-122-S3
16K0100-59	58A-GIH-122-S4
16K0100-60	59A-GIH-122-S5
16K0100-66	65A-GIH-121B-WF1
16K0100-67	66A-GIH-121A-S1
16K0100-68	67A-GIH-121A-S2
16K0100-69	68A-GIH-121A-S4
16K0100-70	69A-GIH-121A-S3
16K0100-76	4B-GIH-A-MBR-S1
16K0100-77	5B-GIH-A-MBR-S2
16K0100-78	6B-GIH-A-MBR-S3
16K0100-79	7B-GIH-A-MBR-S4

Microbac Laboratories, Inc.

16K0100-80	8B-GIH-A-MBR-S5
16K0100-86	14B-GIH-Kitchen-S2
16K0100-87	15B-GIH-Kitchen-S3
16K0100-88	16B-GIH-Kitchen-PF
16K0100-89	17B-GIH-Kitchen-PF2
16K0100-90	18B-GIH-Kitchen-S4
16K0100-96	24B-GIH-NO-S1
16K0100-97	25B-GIH-NO-S2
16K0100-98	26B-GIH-NO-BR-S1
16K0100-99	27B-GIH-NO-BR-S2
16K0100-AA	28B-GIH-NO-S3
16K0100-AG	34B-GIH-MO-Closet-S1
16K0100-AH	35B-GIH-MO-Kitchen-S1
16K0100-AI	36B-GIH-68-S1
16K0100-AJ	37B-GIH-69-S1
16K0100-AK	38B-GIH-70-S1
16K0100-AQ	44B-GIH-WBR-S1
16K0100-AR	45B-GIH-WBR-S2
16K0100-AS	46B-GIH-High-WF
16K0100-AT	47B-GIH-Low-WF
16K0100-AU	48B-GIH-WF
16K0100-AV	49B-GIH-169-S1
16K0100-AW	50B-GIH-169-S2
16K0100-AX	51B-GIH-169-S3
16K0100-AY	52B-GIH-169-S4
16K0100-AZ	53B-GIH-165-S1
16K0100-BF	59B-GIH-MBR-S1
16K0100-BG	60B-GIH-MBR-S2
16K0100-BH	61B-GIH-WBR-S1
16K0100-BI	62B-GIH-WBR-S2
16K0100-BJ	63B-GIH-WBR-S3
16K0100-BP	69B-GIH-171-S3
16K0100-BQ	70B-GIH-171-S4
16K0100-BR	71B-GIH-171-S5
16K0100-BS	72B-GIH-171-S6
16K0100-BT	73B-GIH-171-S7
16K0100-BZ	79B-GIH-171-S13
16K0100-CA	80B-GIH-171-S14
16K0100-CB	81B-GIH-171-S15
16K0100-CC	82B-GIH-171-S16
16K0100-CD	83B-GIH-MS. Eppers-S
16K0100-CJ	5C-GIH-211-S1
16K0100-CK	6C-GIH-211-S2
16K0100-CL	7C-GIH-211-S3
16K0100-CM	8C-GIH-211-S4
16K0100-CN	9C-GIH-211-S5
16K0100-CT	15C-GIH-211-S11
16K0100-CU	16C-GIH-211-S12
16K0100-CV	17C-GIH-211-S13
16K0100-CW	18C-GIH-211-S14

Microbac Laboratories, Inc.

16K0100-CX	19C-GIH-211-S19
16K0100-DD	25C-GIH-213-S5
16K0100-DE	26C-GIH-213-S6
16K0100-DF	27C-GIH-213-S7
16K0100-DG	28C-GIH-213-S8
16K0100-DH	29C-GIH-213-S9
16K0100-DN	35C-GIH-213-S15
16K0100-DO	36C-GIH-213-S16
16K0100-DP	37C-GIH-213-S17
16K0100-DQ	38C-GIH-211-S17
16K0100-DR	39C-GIH-BB-S1
16K0100-BA	54B-GIH-165-S2
16K0100-BB	55B-GIH-165-S3
16K0100-BC	56B-GIH-165-S4
16K0100-BD	57B-GIH-WF
16K0100-BE	58B-GIH-BF
16K0100-BK	64B-GIH-WBR-S4
16K0100-BL	65B-GIH-WBR-S5
16K0100-BM	66B-GIH-WBR-S8
16K0100-BN	67B-GIH-172-S1
16K0100-BO	68B-GIH-171-S2
16K0100-BU	74B-GIH-171-S8
16K0100-BV	75B-GIH-171-S9
16K0100-BW	76B-GIH-171-S10
16K0100-BX	77B-GIH-171-S11
16K0100-BY	78B-GIH-171-S12
16K0100-CE	84B-GIH-Library-S1
16K0100-CF	1C-GIH-HW-WF
16K0100-CG	2C-GIH-205-S1
16K0100-CH	3C-GIH-WB-S1
16K0100-CI	4C-GIH-MB-S1
16K0100-CO	10C-GIH-211-S6
16K0100-CP	11C-GIH-211-S7
16K0100-CQ	12C-GIH-211-S8
16K0100-CR	13C-GIH-211-S9
16K0100-CS	14C-GIH-211-S10
16K0100-CY	20C-GIH-211-S20
16K0100-CZ	21C-GIH-213-S1
16K0100-DA	22C-GIH-213-S2
16K0100-DB	23C-GIH-213-S3
16K0100-DC	24C-GIH-213-S4
16K0100-DI	30C-GIH-213-S10
16K0100-DJ	31C-GIH-213-S11
16K0100-DK	32C-GIH-213-S12
16K0100-DL	33C-GIH-213-S13
16K0100-DM	34C-GIH-213-S14
16K0100-DS	40C-GIH-BB-S2
16K0100-DT	41C-GIH-BB-S3
16K0100-DU	42C-GIH-BB-S4
16K0100-DV	43C-GIH-HW-WF

Microbac Laboratories, Inc.

16K0100-DW	44C-GIH-GB-S1
16K0100-DX	45C-GIH-GB-S2
16K0100-DY	46C-GIH-GB-S3
16K0100-DZ	47C-GIH-GB-S4
16K0100-EA	48C-GIH-214-S1
16K0100-EB	49C-GIH-214-S2
16K0100-EH	55C-GIH-214-S8
16K0100-EI	56C-GIH-214-S9
16K0100-EJ	57C-GIH-214-S10
16K0100-EK	58C-GIH-214-S11
16K0100-EL	59C-GIH-214-S12
16K0100-ER	65C-GIH-223-S1
16K0100-ES	66C-GIH-223-S2
16K0100-ET	67C-GIH-223-S3
16K0100-EU	68C-GIH-223-S4
16K0100-EV	69C-GIH-223-S5
16K0100-FB	75C-GIH-223-S11
16K0100-FC	76C-GIH-223-S12
16K0100-FD	77C-GIH-223-S13
16K0100-FE	78C-GIH-223-S14
16K0100-FF	79C-GIH-223-S15
16K0100-FL	85C-GIH-223A-S2
16K0100-FM	86C-GIH-216-S1
16K0100-FN	87C-GIH-216-S2
16K0100-FO	88C-GIH-216-S3
16K0100-FP	89C-GIH-216-S4
16K0100-FV	95C-GIH-216-S10
16K0100-FW	96C-GIH-216-S11
16K0100-FX	97C-GIH-216-S12
16K0100-FY	98C-GIH-216-S13
16K0100-FZ	99C-GIH-216-S14
16K0100-GF	105C-GIH-217-S3
16K0100-GG	106C-GIH-217-S4
16K0100-GH	107C-GIH-217-S5
16K0100-GI	108C-GIH-217-S6
16K0100-GJ	109C-GIH-217-S7
16K0100-GP	115C-GIH-217-S13
16K0100-GQ	116C-GIH-217-S14
16K0100-GR	117C-GIH-217-S15
16K0100-GS	118C-GIH-217-S16
16K0100-GT	119C-GIH-HW-WF
16K0100-EC	50C-GIH-214-S3
16K0100-ED	51C-GIH-214-S4
16K0100-EE	52C-GIH-214-S5
16K0100-EF	53C-GIH-214-S6
16K0100-EG	54C-GIH-214-S7
16K0100-EM	60C-GIH-214-S13
16K0100-EN	61C-GIH-214-S14
16K0100-EO	62C-GIH-214-S15
16K0100-EP	63C-GIH-214-S16

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

16K0100-EQ	64C-GIH-214-S17
16K0100-EW	70C-GIH-223-S5
16K0100-EX	71C-GIH-223-S7
16K0100-EY	72C-GIH-223-S8
16K0100-EZ	73C-GIH-223-S9
16K0100-FA	74C-GIH-223-S10
16K0100-FG	80C-GIH-223-S16
16K0100-FH	81C-GIH-223-S17
16K0100-FI	82C-GIH-223-S17
16K0100-FJ	83C-GIH-215-S2
16K0100-FK	84C-GIH-223A-S1
16K0100-FQ	90C-GIH-216-S5
16K0100-FR	91C-GIH-216-S6
16K0100-FS	92C-GIH-216-S7
16K0100-FT	93C-GIH-216-S8
16K0100-FU	94C-GIH-216-S9
16K0100-GA	100C-GIH-216-S15
16K0100-GB	101C-GIH-216-S16
16K0100-GC	102C-GIH-216-S17
16K0100-GD	103C-GIH-217-S1
16K0100-GE	104C-GIH-217-S2
16K0100-GK	110C-GIH-217-S8
16K0100-GL	11C-GIH-217-S9
16K0100-GM	112C-GIH-217-S10
16K0100-GN	113C-GIH-217-S11
16K0100-GO	114C-GIH-217-S12
16K0100-GU	120C-GIH-163-S1
16K0100-GV	121C-GIH-163-S2
16K0100-GW	122C-GIH-163-S3
16K0100-GX	123C-GIH-163-S4
16K0100-GY	124C-GIH-162-S1
16K0100-GZ	125C-GIH-162-S2
16K0100-HA	126C-GIH-162-S3
16K0100-HB	127C-GIH-167-S4

16K0100

SampleID	Matrix	SampleName	SampleAlias	Sampled	SampledBy
1	Aqueous				
2	Aqueous				
3	Aqueous				
4	Aqueous				
5	Aqueous				
6	Aqueous				
7	Aqueous				
8	Aqueous				
9	Aqueous				
10	Aqueous				
11	Aqueous				
12	Aqueous				
13	Aqueous				
14	Aqueous				
15	Aqueous				
16	Aqueous				
17	Aqueous		Unlabeled Restroom		
18	Aqueous		OTR=Off's Team Room		
19	Aqueous				
20	Aqueous				
21	Aqueous		OTR=Off's Team Restroom		
22	Aqueous				
23	Aqueous		Off's Team Room		
24	Aqueous		No Sample taken sink not in service		
25	Aqueous		No Sample taken sink not in service		
26	Aqueous		No Sample taken sink not in service		
27	Aqueous				
28	Aqueous				
29	Aqueous				
30	Aqueous				
31	Aqueous				
32	Aqueous				
33	Aqueous				
34	Aqueous				
35	Aqueous				
36	Aqueous				
37	Aqueous				
38	Aqueous				
39	Aqueous				
40	Aqueous				
41	Aqueous				
42	Aqueous				
43	Aqueous				
44	Aqueous				
45	Aqueous				
46	Aqueous				
47	Aqueous				
48	Aqueous				
49	Aqueous				
50	Aqueous				
51	Aqueous				
52	Aqueous				
53	Aqueous		Adm W Gender Bathroom		
54	Aqueous		Kitchen		
55	Aqueous		Coaches Offices		
56	Aqueous				
57	Aqueous				
58	Aqueous				
59	Aqueous				
60	Aqueous				
61	Aqueous				
62	Aqueous				
63	Aqueous				
64	Aqueous				
65	Aqueous				
66	Aqueous				
67	Aqueous				
68	Aqueous				
69	Aqueous				
70	Aqueous				
71	Aqueous				
72	Aqueous				
73	Aqueous				
74	Aqueous				
75	Aqueous				
76	Aqueous				
77	Aqueous				
78	Aqueous				
79	Aqueous				
80	Aqueous				
81	Aqueous				

16K0100 Karen Ziolkowski
The Lotus Engineering Group, P.C. - East Amherst N
31H
10/28/2016



Box 4 ~~Box 3~~ 3

Page 45 of 51

Box 1

164 Aqueous
165 Aqueous
166 Aqueous
167 Aqueous
168 Aqueous
169 Aqueous
170 Aqueous
171 Aqueous
172 Aqueous
173 Aqueous
174 Aqueous
175 Aqueous
176 Aqueous
177 Aqueous
178 Aqueous
179 Aqueous
180 Aqueous
181 Aqueous
182 Aqueous
183 Aqueous
184 Aqueous
185 Aqueous
186 Aqueous
187 Aqueous
188 Aqueous
189 Aqueous
190 Aqueous
191 Aqueous
192 Aqueous
193 Aqueous
194 Aqueous
195 Aqueous
196 Aqueous
197 Aqueous
198 Aqueous
199 Aqueous
200 Aqueous
201 Aqueous
202 Aqueous
203 Aqueous
204 Aqueous
205 Aqueous
206 Aqueous
207 Aqueous
208 Aqueous
209 Aqueous
210 Aqueous
211 Aqueous
212 Aqueous
213 Aqueous
214 Aqueous
215 Aqueous
216 Aqueous
217 Aqueous
218 Aqueous
219 Aqueous
220 Aqueous
221 Aqueous
222 Aqueous
223 Aqueous
224 Aqueous
225 Aqueous
226 Aqueous
227 Aqueous
228 Aqueous
229 Aqueous
230 Aqueous
231 Aqueous
232 Aqueous
233 Aqueous
234 Aqueous
235 Aqueous
236 Aqueous
237 Aqueous
238 Aqueous
239 Aqueous
240 Aqueous
241 Aqueous
242 Aqueous
243 Aqueous
244 Aqueous
245 Aqueous

100-01H-210-S1		10/26/2016 08:14	Matt Green
100-01H-210-S2		10/26/2016 08:15	Matt Green
100-01H-210-S3		10/26/2016 08:16	Matt Green
100-01H-210-S4		10/26/2016 08:16	Matt Green
100-01H-210-S5		10/26/2016 08:17	Matt Green
100-01H-210-S6		10/26/2016 08:18	Matt Green
100-01H-210-S7		10/26/2016 08:18	Matt Green
100-01H-210-S8		10/26/2016 08:18	Matt Green
100-01H-210-S9		10/26/2016 08:19	Matt Green
100-01H-210-S10		10/26/2016 08:20	Matt Green
100-01H-210-S11		10/26/2016 08:20	Matt Green
100-01H-210-S12		10/26/2016 08:21	Matt Green
100-01H-210-S13		10/26/2016 08:22	Matt Green
100-01H-210-S14		10/26/2016 08:23	Matt Green
100-01H-210-S15		10/26/2016 08:23	Matt Green
100-01H-210-S16		10/26/2016 08:24	Matt Green
100-01H-210-S17		10/26/2016 08:24	Matt Green
100-01H-210-S18		10/26/2016 08:25	Matt Green
100-01H-210-S19		10/26/2016 08:25	Matt Green
100-01H-210-S20		10/26/2016 08:26	Matt Green
100-01H-210-S21		10/26/2016 08:26	Matt Green
100-01H-210-S22		10/26/2016 08:27	Matt Green
100-01H-210-S23		10/26/2016 08:27	Matt Green
100-01H-210-S24		10/26/2016 08:28	Matt Green
100-01H-210-S25		10/26/2016 08:28	Matt Green
100-01H-210-S26		10/26/2016 08:29	Matt Green
100-01H-210-S27		10/26/2016 08:29	Matt Green
100-01H-210-S28		10/26/2016 08:30	Matt Green
100-01H-210-S29		10/26/2016 08:30	Matt Green
100-01H-210-S30		10/26/2016 08:31	Matt Green
100-01H-210-S31		10/26/2016 08:31	Matt Green
100-01H-210-S32		10/26/2016 08:32	Matt Green
100-01H-210-S33		10/26/2016 08:32	Matt Green
100-01H-210-S34		10/26/2016 08:33	Matt Green
100-01H-210-S35		10/26/2016 08:33	Matt Green
100-01H-210-S36		10/26/2016 08:34	Matt Green
100-01H-210-S37		10/26/2016 08:34	Matt Green
100-01H-210-S38		10/26/2016 08:35	Matt Green
100-01H-210-S39		10/26/2016 08:35	Matt Green
100-01H-210-S40		10/26/2016 08:36	Matt Green
100-01H-210-S41		10/26/2016 08:36	Matt Green
100-01H-210-S42		10/26/2016 08:37	Matt Green
100-01H-210-S43		10/26/2016 08:37	Matt Green
100-01H-210-S44		10/26/2016 08:38	Matt Green
100-01H-210-S45		10/26/2016 08:38	Matt Green
100-01H-210-S46		10/26/2016 08:39	Matt Green
100-01H-210-S47		10/26/2016 08:39	Matt Green
100-01H-210-S48		10/26/2016 08:40	Matt Green
100-01H-210-S49		10/26/2016 08:40	Matt Green
100-01H-210-S50		10/26/2016 08:41	Matt Green
100-01H-210-S51		10/26/2016 08:41	Matt Green
100-01H-210-S52		10/26/2016 08:42	Matt Green
100-01H-210-S53		10/26/2016 08:42	Matt Green
100-01H-210-S54		10/26/2016 08:43	Matt Green
100-01H-210-S55		10/26/2016 08:43	Matt Green
100-01H-210-S56		10/26/2016 08:44	Matt Green
100-01H-210-S57		10/26/2016 08:44	Matt Green
100-01H-210-S58		10/26/2016 08:45	Matt Green
100-01H-210-S59		10/26/2016 08:45	Matt Green
100-01H-210-S60		10/26/2016 08:46	Matt Green
100-01H-210-S61		10/26/2016 08:46	Matt Green
100-01H-210-S62		10/26/2016 08:47	Matt Green
100-01H-210-S63		10/26/2016 08:47	Matt Green
100-01H-210-S64		10/26/2016 08:48	Matt Green
100-01H-210-S65		10/26/2016 08:48	Matt Green
100-01H-210-S66		10/26/2016 08:49	Matt Green
100-01H-210-S67		10/26/2016 08:49	Matt Green
100-01H-210-S68		10/26/2016 08:50	Matt Green
100-01H-210-S69		10/26/2016 08:50	Matt Green
100-01H-210-S70		10/26/2016 08:51	Matt Green
100-01H-210-S71		10/26/2016 08:51	Matt Green
100-01H-210-S72		10/26/2016 08:52	Matt Green
100-01H-210-S73		10/26/2016 08:52	Matt Green
100-01H-210-S74		10/26/2016 08:53	Matt Green
100-01H-210-S75		10/26/2016 08:53	Matt Green
100-01H-210-S76		10/26/2016 08:54	Matt Green
100-01H-210-S77		10/26/2016 08:54	Matt Green
100-01H-210-S78		10/26/2016 08:55	Matt Green
100-01H-210-S79		10/26/2016 08:55	Matt Green
100-01H-210-S80		10/26/2016 08:56	Matt Green
100-01H-210-S81		10/26/2016 08:56	Matt Green
100-01H-210-S82		10/26/2016 08:57	Matt Green
100-01H-210-S83		10/26/2016 08:57	Matt Green
100-01H-210-S84		10/26/2016 08:58	Matt Green
100-01H-210-S85		10/26/2016 08:58	Matt Green
100-01H-210-S86		10/26/2016 08:59	Matt Green
100-01H-210-S87		10/26/2016 08:59	Matt Green
100-01H-210-S88		10/26/2016 09:00	Matt Green
100-01H-210-S89		10/26/2016 09:00	Matt Green
100-01H-210-S90		10/26/2016 09:01	Matt Green
100-01H-210-S91		10/26/2016 09:01	Matt Green
100-01H-210-S92		10/26/2016 09:02	Matt Green
100-01H-210-S93		10/26/2016 09:02	Matt Green
100-01H-210-S94		10/26/2016 09:03	Matt Green
100-01H-210-S95		10/26/2016 09:03	Matt Green
100-01H-210-S96		10/26/2016 09:04	Matt Green
100-01H-210-S97		10/26/2016 09:04	Matt Green
100-01H-210-S98		10/26/2016 09:05	Matt Green
100-01H-210-S99		10/26/2016 09:05	Matt Green
100-01H-210-S100		10/26/2016 09:06	Matt Green
100-01H-210-S101		10/26/2016 09:06	Matt Green
100-01H-210-S102		10/26/2016 09:07	Matt Green
100-01H-210-S103		10/26/2016 09:07	Matt Green
100-01H-210-S104		10/26/2016 09:08	Matt Green
100-01H-210-S105		10/26/2016 09:08	Matt Green
100-01H-210-S106		10/26/2016 09:09	Matt Green
100-01H-210-S107		10/26/2016 09:09	Matt Green
100-01H-210-S108		10/26/2016 09:10	Matt Green
100-01H-210-S109		10/26/2016 09:10	Matt Green
100-01H-210-S110		10/26/2016 09:11	Matt Green
100-01H-210-S111		10/26/2016 09:11	Matt Green
100-01H-210-S112		10/26/2016 09:12	Matt Green
100-01H-210-S113		10/26/2016 09:12	Matt Green
100-01H-210-S114		10/26/2016 09:13	Matt Green
100-01H-210-S115		10/26/2016 09:13	Matt Green
100-01H-210-S116		10/26/2016 09:14	Matt Green
100-01H-210-S117		10/26/2016 09:14	Matt Green
100-01H-210-S118		10/26/2016 09:15	Matt Green
100-01H-210-S119		10/26/2016 09:15	Matt Green
100-01H-210-S120		10/26/2016 09:16	Matt Green
100-01H-210-S121		10/26/2016 09:16	Matt Green
100-01H-210-S122		10/26/2016 09:17	Matt Green
100-01H-210-S123		10/26/2016 09:17	Matt Green
100-01H-210-S124		10/26/2016 09:18	Matt Green
100-01H-210-S125		10/26/2016 09:18	Matt Green
100-01H-210-S126		10/26/2016 09:19	Matt Green
100-01H-210-S127		10/26/2016 09:19	Matt Green
100-01H-210-S128		10/26/2016 09:20	Matt Green
100-01H-210-S129		10/26/2016 09:20	Matt Green
100-01H-210-S130		10/26/2016 09:21	Matt Green
100-01H-210-S131		10/26/2016 09:21	Matt Green
100-01H-210-S132		10/26/2016 09:22	Matt Green
100-01H-210-S133		10/26/2016 09:22	Matt Green
100-01H-210-S134		10/26/2016 09:23	Matt Green
100-01H-210-S135		10/26/2016 09:23	Matt Green
100-01H-210-S136		10/26/2016 09:24	Matt Green
100-01H-210-S137		10/26/2016 09:24	Matt Green
100-01H-210-S138		10/26/2016 09:25	Matt Green
100-01H-210-S139		10/26/2016 09:25	Matt Green
100-01H-210-S140		10/26/2016 09:26	Matt Green
100-01H-210-S141		10/26/2016 09:26	Matt Green
100-01H-210-S142		10/26/2016 09:27	Matt Green
100-01H-210-S143		10/26/2016 09:27	Matt Green
100-01H-210-S144		10/26/2016 09:28	Matt Green
100-01H-210-S145		10/26/2016 09:28	Matt Green
100-01H-210-S146		10/26/2016 09:29	Matt Green
100-01H-210-S147		10/26/2016 09:29	Matt Green
100-01H-210-S148		10/26/2016 09:30	Matt Green
100-01H-210-S149		10/26/2016 09:30	Matt Green
100-01H-210-S150		10/26/2016 09:31	Matt Green
100-01H-210-S151		10/26/2016 09:31	Matt Green
100-01H-210-S152		10/26/2016 09:32	Matt Green
100-01H-210-S153		10/26/2016 09:32	Matt Green
100-01H-210-S154		10/26/2016 09:33	Matt Green
100-01H-210-S155		10/26/2016 09:33	Matt Green
100-01H-210-S156		10/26/2016 09:34	Matt Green
100-01H-210-S157		10/26/2016 09:34	Matt Green
100-01H-210-S158		10/26/2016 09:35	Matt Green
100-01H-210-S159		10/26/2016 09:35	Matt Green
100-01H-210-S160		10/26/2016 09:36	Matt Green
100-01H-210-S161		10/26/2016 09:36	Matt Green
100-01H-210-S162		10/26/2016 09:37	Matt Green
100-01H-210-S163		10/26/2016 09:37	Matt Green
100-01H-210-S164		10/26/2016 09:38	Matt Green
100-01H-210-S165		10/26/2016 09:38	Matt Green
100-01H-210-S166		10/26/2016 09:39	Matt Green
100-01H-210-S167		10/26/2016 09:39	Matt Green
100-01H-210-S168		10/26/2016 09:40	Matt Green
100-01H-210-S169		10/26/2016 09:40	Matt Green
100-01H-210-S170		10/26/2016 09:41	Matt Green
100-01H-210-S171		10/26/2016 09:41	Matt Green
100-01H-210-S172		10/26/2016 09:42	Matt Green
100-01H-210-S173		10/26/2016 09:42	Matt Green
100-01H-210-S174		10/26/2016 09:43	Matt Green
100-01H-210-S175		10/26/2016 09:43	Matt Green
100-01H-210-S176		10/26/2016 09:44	Matt Green
100-01H-210-S177		10/26/2016 09:44	Matt Green
100-01H-210-S178		10/26/2016 09:45	Matt Green
100-01H-210-S179		10/26/2016 09:45	Matt Green
100-01H-210-S180		10/26/2016 09:46	Matt Green
100-01H-210-S181		10/26/2016 09:46	Matt Green
100-01H-210-S182		10/26/2016 09:47	Matt Green
100-01H-210-S183		10/26/2016 09:47	Matt Green
100-01H-210-S184		10/26/2016 09:48	Matt Green
100-01H-210-S185		10/26/2016 09:48	Matt Green
100-01H-210-S186		10/26/2016 09:49	Matt Green
100-01H-210-S187		10/26/2016 09:49	Matt Green
100-01H-210-S188		10/26/2016 09:50	Matt Green
100-01H-210-S189		10/26/2016 09:50	Matt Green
100-01H-210-S190		10/26/2016 09:51	Matt Green
100-01H-210-S191		10/26/2016 09:51	Matt Green
100-01H-210-S192		10/26/2016 09:52	Matt Green
100-01H-210-S193		10/26/2016 09:52	Matt Green
100-01H-210-S194		10/26/2016 09:53	Matt Green
100-01H-210-S195		10/26/2016 09:53	Matt Green
100-01H-210-S196		10/26/2016 09:54	Matt Green
100-01H-210-S197		10/26/2016 09:54	Matt Green
100-01H-210-S198		10/26/2016 09:55	Matt Green
100-01H-210-S199		10/26/2016 09:55	Matt Green
100-01H-210-S200		10/26/2016 09:56	Matt Green
100-01H-210-S201		10/26/2016 09:56	Matt Green
100-01H-210-S202		10/26/2016 09:57	Matt Green
100-01H-210-S203		10/26/2016 09:57	Matt Green
100-01H-210-S204		10/26/2016 09:58	Matt Green
100-01H-210-S205		10/26/2016 09:58	Matt Green
100-01H-210-S206		10/26/2016 09:59	Matt Green
100-01H-210-S207		10/26/2016 09:59	Matt Green
100-01H-210-S208		10/26/2016 10:00	Matt Green
100-01H-210-S209		10/26/2016 10:00	Matt Green
100-01H-210-S210		10/26/2016 10:01	Matt Green
100-01H-210-S211		10/26/2016 10:01	Matt Green
100-01H-210-S212		10/26/2016 10:02	Matt Green
100-01H-210-S213		10/26/2016 10:02	Matt Green
100-01H-210-S214		10/26/2016 10:03	Matt Green
100-01H-210-S215		10/26/2016 10:03	Matt Green
100-01H-210-S216		10/26/2016 10:04	Matt Green
100-01H-210-S217		10/26/2016 10:04	Matt Green
100-01H-210-S218		10/26/2016 10:05	Matt Green
100-01H-210-S219		10/26/2016 10:05	Matt Green
100-01H-210-S220		10/26/2016 10:06	Matt Green
100-01H-210-S221		10/26/2016 10:06	Matt Green
100-01H-210-S222		10/26/2016 10:07	Matt Green
100-01H-210-S223		10/26/2016 10:07	Matt Green

10/26/2016	08:13	Math	Green
10/26/2016	08:14	Math	Green
10/26/2016	08:15	Math	Green
10/26/2016	08:16	Math	Green
10/26/2016	08:17	Math	Green
10/26/2016	08:18	Math	Green
10/26/2016	08:19	Math	Green
10/26/2016	08:20	Math	Green
10/26/2016	08:21	Math	Green
10/26/2016	08:22	Math	Green
10/26/2016	08:23	Math	Green
10/26/2016	08:24	Math	Green
10/26/2016	08:25	Math	Green
10/26/2016	08:26	Math	Green
10/26/2016	08:27	Math	Green
10/26/2016	08:28	Math	Green
10/26/2016	08:29	Math	Green
10/26/2016	08:30	Math	Green
10/26/2016	08:31	Math	Green
10/26/2016	08:32	Math	Green
10/26/2016	08:33	Math	Green
10/26/2016	08:34	Math	Green
10/26/2016	08:35	Math	Green
10/26/2016	08:36	Math	Green
10/26/2016	08:37	Math	Green
10/26/2016	08:38	Math	Green
10/26/2016	08:39	Math	Green
10/26/2016	08:40	Math	Green
10/26/2016	08:41	Math	Green
10/26/2016	08:42	Math	Green
10/26/2016	08:43	Math	Green
10/26/2016	08:44	Math	Green
10/26/2016	08:45	Math	Green
10/26/2016	08:46	Math	Green
10/26/2016	08:47	Math	Green
10/26/2016	08:48	Math	Green
10/26/2016	08:49	Math	Green
10/26/2016	08:50	Math	Green
10/26/2016	08:51	Math	Green
10/26/2016	08:52	Math	Green
10/26/2016	08:53	Math	Green
10/26/2016	08:54	Math	Green
10/26/2016	08:55	Math	Green
10/26/2016	08:56	Math	Green
10/26/2016	08:57	Math	Green
10/26/2016	08:58	Math	Green
10/26/2016	08:59	Math	Green
10/26/2016	09:00	Math	Green

[illegible]

Kelly Bray to Microbac 10/28 3:20

1520

NI 21.2
-0.5

19.7
19.7
20.7°C

Samp Mat	SampleName	SampleAlias	Sampled	SampledBy
1	Aqu 1A-GIH-124A-S1	Trainers office	10/26/2016 05:06	Kelly Reidy
2	Aqu 2A-GIH-214A-S2	Bathroom	10/26/2016 05:07	Kelly Reidy
3	Aqu 3A-GIH-123B-S1		10/26/2016 05:07	Kelly Reidy
4	Aqu 4A-GIH-123B-S2		10/26/2016 05:08	Kelly Reidy
5	Aqu 5A-GIH-123B-WF1		10/26/2016 05:09	Kelly Reidy
6	Aqu 6A-GIH-MC-WF1	by 123 MC=Main Corridor	10/26/2016 05:10	Kelly Reidy
7	Aqu 7A-GIH-118-GPLR-S1	GPLR=Girl Player Locker Room	10/26/2016 05:10	Kelly Reidy
8	Aqu 8A-GIH-118-GPLR-S2		10/26/2016 05:11	Kelly Reidy
9	Aqu 9A-GIH-118-GPLR-S3		10/26/2016 05:11	Kelly Reidy
10	Aqu 10A-GIH-118-GPLR-WF1		10/26/2016 05:11	Kelly Reidy
11	Aqu 11A-GIH-Pool-WF1		10/26/2016 05:13	Kelly Reidy
12	Aqu 12A-GIH-Pool-WF2		10/26/2016 05:13	Kelly Reidy
13	Aqu 13A-GIH-117-BPLR-S1	BPLR=Boy Player Locker Room	10/26/2016 05:15	Kelly Reidy
14	Aqu 14A-GIH-117-BPLR-S2		10/26/2016 05:15	Kelly Reidy
15	Aqu 15A-GIH-117-BPLR-WF1		10/26/2016 05:16	Kelly Reidy
16	Aqu 16A-GIH-117-BPLR-S3	Coaches Bathroom	10/26/2016 05:19	Kelly Reidy
17	Aqu 17A-GIH-GTR-A+B-S1	GTR=Girl's Team Room	10/26/2016 05:22	Kelly Reidy
18	Aqu 18A-GIH-GTR-A+B-S2		10/26/2016 05:23	Kelly Reidy
19	Aqu 19A-GIH-GTR-A+B-S3		10/26/2016 05:23	Kelly Reidy
20	Aqu 20A-GIH-GTRB-S1	GTRB=Girl's Team Restroom	10/26/2016 05:25	Kelly Reidy
21	Aqu 21A-GIH-GTLR-A-S1		10/26/2016 05:25	Kelly Reidy
22	Aqu 22A-GIH-MC-WF2	by Girl's Team Room	10/26/2016 05:27	Kelly Reidy
23	Aqu 23A-GIH-GTLR-C+D-S1	No Sample taken sink not in service	10/26/2016 00:00	Kelly Reidy
24	Aqu 24A-GIH-GLTR-C+D-S2	No Sample taken sink not in service	10/26/2016 00:00	Kelly Reidy
25	Aqu 25A-GIH-GTLR-C+D-S3	No Sample taken sink not in service	10/26/2016 00:00	Kelly Reidy
26	Aqu 26A-GIH-GTLR-D-S1		10/26/2016 05:30	Kelly Reidy
27	Aqu 27A-GIH-GTLR-C-S1		10/26/2016 05:30	Kelly Reidy
28	Aqu 28A-GIH-Gym2-WF1	by Girl's Team Room	10/26/2016 05:31	Kelly Reidy
29	Aqu 29A-GIH-Gym2-WF2		10/26/2016 05:32	Kelly Reidy
30	Aqu 30A-GIH-PGym-WBR-S1	Pgym=Practice Gym WBR=Women's bathroom	10/26/2016 05:35	Kelly Reidy
31	Aqu 31A-GIH-PGym-WBR-S2		10/26/2016 05:35	Kelly Reidy
32	Aqu 32A-GIH-PGym-WBR-S3		10/26/2016 05:37	Kelly Reidy
33	Aqu 33A-GIH-113-BTR-S1	BTR=Boys Team Room (football)	10/26/2016 05:37	Kelly Reidy
34	Aqu 34A-GIH-113-BTLR-S2	BTLR=Boy Team Locker Room (Football)	10/26/2016 05:37	Kelly Reidy
35	Aqu 35A-GIH-113-BTLR-WF	Football	10/26/2016 05:38	Kelly Reidy
36	Aqu 36A-GIH-113-BTLR-Spicket		10/26/2016 05:39	Kelly Reidy
37	Aqu 37A-GIH-TO-S1	Team Office by pool	10/26/2016 05:41	Kelly Reidy
38	Aqu 38A-GIH-TO-Ice Machine		10/26/2016 05:42	Kelly Reidy
39	Aqu 39A-GIH-MC-WF3		10/26/2016 05:45	Kelly Reidy
40	Aqu 40A-GIH-112-BTL-S2		10/26/2016 05:45	Kelly Reidy
41	Aqu 41A-GIH-112-BTL-S1	Coaches Office	10/26/2016 05:47	Kelly Reidy
42	Aqu 42A-GIH-112-BTL-S3		10/26/2016 05:48	Kelly Reidy
43	Aqu 43A-GIH-110-Office A- S1		10/26/2016 05:52	Kelly Reidy
44	Aqu 44A-GIH-MC-WBR-S1	By 108	10/26/2016 05:53	Kelly Reidy
45	Aqu 45A-GIH-MC-WBR-S2	By 108	10/26/2016 05:55	Kelly Reidy
46	Aqu 46A-GIH-MC-MBR-S1	by 107	10/26/2016 05:56	Kelly Reidy
47	Aqu 47A-GIH-MC-MBR-S2	by 107	10/26/2016 05:57	Kelly Reidy
48	Aqu 48A-GIH-MC-WF4	by 107	10/26/2016 06:00	Kelly Reidy
49	Aqu 49A-GIH-DO-WF1		10/26/2016 06:05	Kelly Reidy
50	Aqu 50A-GIH-DO-S1	Kitchen	10/26/2016 06:06	Kelly Reidy
51	Aqu 51A-GIH-DO-WBR-S2		10/26/2016 06:06	Kelly Reidy
52	Aqu 52A-GIH-DO-AG-S3	AG=All Gender Bathroom	10/26/2016 06:06	Kelly Reidy
53	Aqu 53A-GIH-DO-Sprayer	Kitchen	10/26/2016 06:09	Kelly Reidy
54	Aqu 54A-GIH-180-S1	Coaches Offices	10/26/2016 06:10	Kelly Reidy
55	Aqu 55A-GIH-122-S1		10/26/2016 06:11	Kelly Reidy
56	Aqu 56A-GIH-122-S2		10/26/2016 06:12	Kelly Reidy
57	Aqu 57A-GIH-122-S3		10/26/2016 06:12	Kelly Reidy
58	Aqu 58A-GIH-122-S4		10/26/2016 06:13	Kelly Reidy
59	Aqu 59A-GIH-122-S5		10/26/2016 06:15	Kelly Reidy
60	Aqu 60A-GIH-122-S6		10/26/2016 06:15	Kelly Reidy
61	Aqu 61A-GIH-122-WF1		10/26/2016 06:15	Kelly Reidy
62	Aqu 62A-GIH-121B-S1		10/26/2016 06:17	Kelly Reidy
63	Aqu 63A-GIH-121B-S2		10/26/2016 06:17	Kelly Reidy
64	Aqu 64A-GIH-121B-S3		10/26/2016 06:18	Kelly Reidy
65	Aqu 65A-GIH-121B-WF1		10/26/2016 06:18	Kelly Reidy
66	Aqu 66A-GIH-121A-S1		10/26/2016 06:20	Kelly Reidy
67	Aqu 67A-GIH-121A-S2		10/26/2016 06:21	Kelly Reidy
68	Aqu 68A-GIH-121A-S4		10/26/2016 06:21	Kelly Reidy
69	Aqu 69A-GIH-121A-S3		10/26/2016 06:22	Kelly Reidy
70	Aqu 70A-GIH-152-S1		10/26/2016 06:30	Kelly Reidy
71	Aqu 71A-GIH-MC-WF5		10/26/2016 06:31	Kelly Reidy
72	Aqu 1B-GIH-A-WBR-S1	A=Auditorium	10/26/2016 05:09	Tom Fowler
73	Aqu 2B-GIH-A-WBR-S2		10/26/2016 05:09	Tom Fowler
74	Aqu 3B-GIH-A-WBR-S3		10/26/2016 05:09	Tom Fowler
75	Aqu 4B-GIH-A-MBR-S1		10/26/2016 05:10	Tom Fowler
76	Aqu 5B-GIH-A-MBR-S2		10/26/2016 05:10	Tom Fowler
77	Aqu 6B-GIH-A-MBR-S3		10/26/2016 05:10	Tom Fowler
78	Aqu 7B-GIH-A-MBR-S4		10/26/2016 05:10	Tom Fowler
79	Aqu 8B-GIH-A-MBR-S5		10/26/2016 05:10	Tom Fowler
80	Aqu 9B-GIH-A-MBR-S6		10/26/2016 05:10	Tom Fowler
81	Aqu 10B-GIH-A-WF		10/26/2016 05:13	Tom Fowler

Grand Island HS

82 Aqu 11B-GIH-A-BF	BF=Bottle Filler	10/26/2016 05:14	Tom Fowler
83 Aqu 12B-GIH-Café-S1		10/26/2016 05:20	Tom Fowler
84 Aqu 13B-GIH-Café-Sprayer		10/26/2016 05:21	Tom Fowler
85 Aqu 14B-GIH-Kitchen-S2		10/26/2016 05:22	Tom Fowler
86 Aqu 15B-GIH-Kitchen-S3		10/26/2016 05:23	Tom Fowler
87 Aqu 16B-GIH-Kitchen-PF	PF=Pot Filler	10/26/2016 05:24	Tom Fowler
88 Aqu 17B-GIH-Kitchen-PF2		10/26/2016 05:24	Tom Fowler
89 Aqu 18B-GIH-Kitchen-S4	Food Wash Only	10/26/2016 05:24	Tom Fowler
90 Aqu 19B-GIH-Kitchen-S5		10/26/2016 05:24	Tom Fowler
91 Aqu 20B-GIH-Kitchen-BR-S1		10/26/2016 05:27	Tom Fowler
92 Aqu 21B-GIH-Kitchen-Sprayer2		10/26/2016 05:29	Tom Fowler
93 Aqu 22B-GIH-Café-WF		10/26/2016 05:32	Tom Fowler
94 Aqu 23B-GIH-GO-BreakR-S1	GO=Guidance Office	10/26/2016 05:35	Tom Fowler
95 Aqu 24B-GIH-NO-S1	NO=Nurses Office	10/26/2016 05:37	Tom Fowler
96 Aqu 25B-GIH-NO-S2		10/26/2016 05:38	Tom Fowler
97 Aqu 26B-GIH-NO-BR-S1		10/26/2016 05:38	Tom Fowler
98 Aqu 27B-GIH-NO-BR-S2		10/26/2016 05:39	Tom Fowler
99 Aqu 28B-GIH-NO-S3		10/26/2016 05:40	Tom Fowler
100 Aqu 29B-GIH-WSGBR-S1	WSGBR=Women's staff guidance bathroom	10/26/2016 05:42	Tom Fowler
101 Aqu 30B-GIH-FWBR-S1	FWBR=Faculty Woman's bathroom	10/26/2016 05:43	Tom Fowler
102 Aqu 31B-GIH-MFBR-S1	MFBR=Mens Faculty Bathroom	10/26/2016 05:45	Tom Fowler
103 Aqu 32B-GIH-FL-S1	FL=Faculty Lounge	10/26/2016 05:47	Tom Fowler
104 Aqu 33B-GIH-CC-S1	CC=Casey's Corner	10/26/2016 05:50	Tom Fowler
105 Aqu 34B-GIH-MO-Closet-S1	MO=Main Office	10/26/2016 05:55	Tom Fowler
106 Aqu 35B-GIH-MO-Kitchen-S1		10/26/2016 05:57	Tom Fowler
107 Aqu 36B-GIH-68-S1		10/26/2016 06:03	Tom Fowler
108 Aqu 37B-GIH-69-S1		10/26/2016 06:04	Tom Fowler
109 Aqu 38B-GIH-70-S1		10/26/2016 06:04	Tom Fowler
110 Aqu 39B-GIH-72-S1		10/26/2016 06:06	Tom Fowler
111 Aqu 40B-GIH-66-S1		10/26/2016 06:07	Tom Fowler
112 Aqu 41B-GIH-FBR-S1	FBR=Faculty bathroom by room 66	10/26/2016 06:09	Tom Fowler
113 Aqu 42B-GIH-MBR-S1	by room 66	10/26/2016 06:12	Tom Fowler
114 Aqu 43B-GIH-MBR-S2	by room 66	10/26/2016 06:12	Tom Fowler
115 Aqu 44B-GIH-WBR-S1	by room 66	10/26/2016 06:13	Tom Fowler
116 Aqu 45B-GIH-WBR-S2	by room 66	10/26/2016 06:13	Tom Fowler
117 Aqu 46B-GIH-High-WF	by room 66	10/26/2016 06:14	Tom Fowler
118 Aqu 47B-GIH-Low-WF	by room 66	10/26/2016 06:14	Tom Fowler
119 Aqu 48B-GIH-WF	by room 182	10/26/2016 06:17	Tom Fowler
120 Aqu 49B-GIH-169-S1		10/26/2016 06:20	Tom Fowler
121 Aqu 50B-GIH-169-S2		10/26/2016 06:20	Tom Fowler
122 Aqu 51B-GIH-169-S3		10/26/2016 06:20	Tom Fowler
123 Aqu 52B-GIH-169-S4		10/26/2016 06:21	Tom Fowler
124 Aqu 53B-GIH-165-S1		10/26/2016 06:23	Tom Fowler
125 Aqu 54B-GIH-165-S2		10/26/2016 06:24	Tom Fowler
126 Aqu 55B-GIH-165-S3		10/26/2016 06:24	Tom Fowler
127 Aqu 56B-GIH-165-S4		10/26/2016 06:24	Tom Fowler
128 Aqu 57B-GIH-WF	Outside 165	10/26/2016 06:26	Tom Fowler
129 Aqu 58B-GIH-BF	Outside 165	10/26/2016 06:27	Tom Fowler
130 Aqu 59B-GIH-MBR-S1	Outside 165	10/26/2016 06:28	Tom Fowler
131 Aqu 60B-GIH-MBR-S2	Outside 165	10/26/2016 06:28	Tom Fowler
132 Aqu 61B-GIH-WBR-S1	Outside 165	10/26/2016 06:29	Tom Fowler
133 Aqu 62B-GIH-WBR-S2		10/26/2016 06:29	Tom Fowler
134 Aqu 63B-GIH-WBR-S3	Outside 165	10/26/2016 06:29	Tom Fowler
135 Aqu 64B-GIH-WBR-S4	Outside 165	10/26/2016 06:29	Tom Fowler
136 Aqu 65B-GIH-WBR-S5	Outside 165	10/26/2016 06:29	Tom Fowler
137 Aqu 66B-GIH-WBR-S8		10/26/2016 06:37	Tom Fowler
138 Aqu 67B-GIH-172-S1		10/26/2016 06:40	Tom Fowler
139 Aqu 68B-GIH-171-S2		10/26/2016 06:40	Tom Fowler
140 Aqu 69B-GIH-171-S3		10/26/2016 06:41	Tom Fowler
141 Aqu 70B-GIH-171-S4		10/26/2016 06:41	Tom Fowler
142 Aqu 71B-GIH-171-S5		10/26/2016 06:42	Tom Fowler
143 Aqu 72B-GIH-171-S6		10/26/2016 06:42	Tom Fowler
144 Aqu 73B-GIH-171-S7		10/26/2016 06:43	Tom Fowler
145 Aqu 74B-GIH-171-S8		10/26/2016 06:43	Tom Fowler
146 Aqu 75B-GIH-171-S9		10/26/2016 06:44	Tom Fowler
147 Aqu 76B-GIH-171-S10		10/26/2016 06:44	Tom Fowler
148 Aqu 77B-GIH-171-S11		10/26/2016 06:45	Tom Fowler
149 Aqu 78B-GIH-171-S12		10/26/2016 06:46	Tom Fowler
150 Aqu 79B-GIH-171-S13		10/26/2016 06:46	Tom Fowler
151 Aqu 80B-GIH-171-S14		10/26/2016 06:46	Tom Fowler
152 Aqu 81B-GIH-171-S15		10/26/2016 06:47	Tom Fowler
153 Aqu 82B-GIH-171-S16		10/26/2016 06:48	Tom Fowler
154 Aqu 83B-GIH-MS. Eppers-S		10/26/2016 06:52	Tom Fowler
155 Aqu 84B-GIH-Library-S1		10/26/2016 06:52	Tom Fowler
156 Aqu 1C-GIH-HW-WF	By 203	10/26/2016 05:03	Matt Green
157 Aqu 2C-GIH-205-S1		10/26/2016 05:07	Matt Green
158 Aqu 3C-GIH-WB-S1	Faculty	10/26/2016 05:08	Matt Green
159 Aqu 4C-GIH-MB-S1	Faculty	10/26/2016 07:08	Matt Green
160 Aqu 5C-GIH-211-S1		10/26/2016 05:10	Matt Green
161 Aqu 6C-GIH-211-S2		10/26/2016 05:10	Matt Green
162 Aqu 7C-GIH-211-S3		10/26/2016 05:11	Matt Green
163 Aqu 8C-GIH-211-S4		10/26/2016 05:12	Matt Green

164 Aqu-9C-GIH-211-S5		10/26/2016 05:12	Matt Green
165 Aqu-10C-GIH-211-S6		10/26/2016 05:14	Matt Green
166 Aqu-11C-GIH-211-S7		10/26/2016 07:13	Matt Green
167 Aqu-12C-GIH-211-S8		10/26/2016 05:15	Matt Green
168 Aqu-13C-GIH-211-S9		10/26/2016 05:15	Matt Green
169 Aqu-14C-GIH-211-S10		10/26/2016 05:16	Matt Green
170 Aqu-15C-GIH-211-S11		10/26/2016 05:17	Matt Green
171 Aqu-16C-GIH-211-S12		10/26/2016 05:18	Matt Green
172 Aqu-17C-GIH-211-S13		10/26/2016 05:18	Matt Green
173 Aqu-18C-GIH-211-S14		10/26/2016 05:18	Matt Green
174 Aqu-19C-GIH-211-S19		10/26/2016 05:19	Matt Green
175 Aqu-20C-GIH-211-S20		10/26/2016 05:19	Matt Green
176 Aqu-21C-GIH-213-S1		10/26/2016 05:21	Matt Green
177 Aqu-22C-GIH-213-S2		10/26/2016 05:22	Matt Green
178 Aqu-23C-GIH-213-S3		10/26/2016 05:23	Matt Green
179 Aqu-24C-GIH-213-S4		10/26/2016 05:23	Matt Green
180 Aqu-25C-GIH-213-S5		10/26/2016 05:24	Matt Green
181 Aqu-26C-GIH-213-S6		10/26/2016 05:24	Matt Green
182 Aqu-27C-GIH-213-S7		10/26/2016 05:25	Matt Green
183 Aqu-28C-GIH-213-S8		10/26/2016 05:25	Matt Green
184 Aqu-29C-GIH-213-S9		10/26/2016 05:26	Matt Green
185 Aqu-30C-GIH-213-S10		10/26/2016 05:26	Matt Green
186 Aqu-31C-GIH-213-S11		10/26/2016 05:27	Matt Green
187 Aqu-32C-GIH-213-S12		10/26/2016 05:27	Matt Green
188 Aqu-33C-GIH-213-S13		10/26/2016 05:28	Matt Green
189 Aqu-34C-GIH-213-S14		10/26/2016 05:28	Matt Green
190 Aqu-35C-GIH-213-S15	Hood	10/26/2016 05:30	Matt Green
191 Aqu-36C-GIH-213-S16		10/26/2016 05:30	Matt Green
192 Aqu-37C-GIH-213-S17		10/26/2016 05:31	Matt Green
193 Aqu-38C-GIH-211-S17		10/26/2016 05:37	Matt Green
194 Aqu-39C-GIH-BB-S1		10/26/2016 05:38	Matt Green
195 Aqu-40C-GIH-BB-S2		10/26/2016 05:42	Matt Green
196 Aqu-41C-GIH-BB-S3		10/26/2016 05:42	Matt Green
197 Aqu-42C-GIH-BB-S4		10/26/2016 05:43	Matt Green
198 Aqu-43C-GIH-HW-WF	Outside 214	10/26/2016 05:44	Matt Green
199 Aqu-44C-GIH-GB-S1		10/26/2016 05:45	Matt Green
200 Aqu-45C-GIH-GB-S2	No Sample	10/26/2016 05:45	Matt Green
201 Aqu-46C-GIH-GB-S3		10/26/2016 05:46	Matt Green
202 Aqu-47C-GIH-GB-S4		10/26/2016 05:46	Matt Green
203 Aqu-48C-GIH-214-S1		10/26/2016 05:49	Matt Green
204 Aqu-49C-GIH-214-S2		10/26/2016 05:49	Matt Green
205 Aqu-50C-GIH-214-S3		10/26/2016 05:50	Matt Green
206 Aqu-51C-GIH-214-S4		10/26/2016 05:50	Matt Green
207 Aqu-52C-GIH-214-S5		10/26/2016 05:51	Matt Green
208 Aqu-53C-GIH-214-S6		10/26/2016 05:51	Matt Green
209 Aqu-54C-GIH-214-S7		10/26/2016 05:51	Matt Green
210 Aqu-55C-GIH-214-S8		10/26/2016 05:52	Matt Green
211 Aqu-56C-GIH-214-S9		10/26/2016 05:52	Matt Green
212 Aqu-57C-GIH-214-S10		10/26/2016 05:53	Matt Green
213 Aqu-58C-GIH-214-S11		10/26/2016 05:53	Matt Green
214 Aqu-59C-GIH-214-S12		10/26/2016 05:53	Matt Green
215 Aqu-60C-GIH-214-S13		10/26/2016 05:54	Matt Green
216 Aqu-61C-GIH-214-S14		10/26/2016 05:59	Matt Green
217 Aqu-62C-GIH-214-S15	Hood	10/26/2016 05:55	Matt Green
218 Aqu-63C-GIH-214-S16		10/26/2016 05:55	Matt Green
219 Aqu-64C-GIH-214-S17		10/26/2016 05:57	Matt Green
220 Aqu-65C-GIH-223-S1		10/26/2016 05:59	Matt Green
221 Aqu-66C-GIH-223-S2		10/26/2016 06:00	Matt Green
222 Aqu-67C-GIH-223-S3		10/26/2016 06:00	Matt Green
223 Aqu-68C-GIH-223-S4		10/26/2016 06:00	Matt Green
224 Aqu-69C-GIH-223-S5		10/26/2016 06:02	Matt Green
225 Aqu-70C-GIH-223-S5		10/26/2016 06:02	Matt Green
226 Aqu-71C-GIH-223-S7		10/26/2016 06:03	Matt Green
227 Aqu-72C-GIH-223-S8		10/26/2016 06:03	Matt Green
228 Aqu-73C-GIH-223-S9		10/26/2016 06:04	Matt Green
229 Aqu-74C-GIH-223-S10		10/26/2016 06:04	Matt Green
230 Aqu-75C-GIH-223-S11		10/26/2016 06:05	Matt Green
231 Aqu-76C-GIH-223-S12		10/26/2016 06:05	Matt Green
232 Aqu-77C-GIH-223-S13		10/26/2016 06:05	Matt Green
233 Aqu-78C-GIH-223-S14		10/26/2016 06:06	Matt Green
234 Aqu-79C-GIH-223-S15		10/26/2016 06:07	Matt Green
235 Aqu-80C-GIH-223-S16		10/26/2016 06:07	Matt Green
236 Aqu-81C-GIH-223-S17		10/26/2016 06:07	Matt Green
237 Aqu-82C-GIH-223-S17		10/26/2016 06:11	Matt Green
238 Aqu-83C-GIH-215-S2		10/26/2016 06:11	Matt Green
239 Aqu-84C-GIH-223A-S1	Hood	10/26/2016 06:12	Matt Green
240 Aqu-85C-GIH-223A-S2		10/26/2016 06:13	Matt Green
241 Aqu-86C-GIH-216-S1		10/26/2016 06:15	Matt Green
242 Aqu-87C-GIH-216-S2		10/26/2016 06:16	Matt Green
243 Aqu-88C-GIH-216-S3		10/26/2016 06:16	Matt Green
244 Aqu-89C-GIH-216-S4		10/26/2016 06:11	Matt Green
245 Aqu-90C-GIH-216-S5		10/26/2016 06:17	Matt Green

246 Aqu 91C-GIH-216-S6		10/26/2016 06:17	Matt Green
247 Aqu 92C-GIH-216-S7		10/26/2016 06:18	Matt Green
248 Aqu 93C-GIH-216-S8		10/26/2016 06:18	Matt Green
249 Aqu 94C-GIH-216-S9		10/26/2016 06:19	Matt Green
250 Aqu 95C-GIH-216-S10		10/26/2016 06:19	Matt Green
251 Aqu 96C-GIH-216-S11		10/26/2016 06:20	Matt Green
252 Aqu 97C-GIH-216-S12		10/26/2016 06:20	Matt Green
253 Aqu 98C-GIH-216-S13		10/26/2016 06:20	Matt Green
254 Aqu 99C-GIH-216-S14		10/26/2016 06:21	Matt Green
255 Aqu 100C-GIH-216-S15	Hood	10/26/2016 06:21	Matt Green
256 Aqu 101C-GIH-216-S16		10/26/2016 06:22	Matt Green
257 Aqu 102C-GIH-216-S17		10/26/2016 06:22	Matt Green
258 Aqu 103C-GIH-217-S1		10/26/2016 06:25	Matt Green
259 Aqu 104C-GIH-217-S2		10/26/2016 06:25	Matt Green
260 Aqu 105C-GIH-217-S3		10/26/2016 06:26	Matt Green
261 Aqu 106C-GIH-217-S4		10/26/2016 06:26	Matt Green
262 Aqu 107C-GIH-217-S5		10/26/2016 06:26	Matt Green
263 Aqu 108C-GIH-217-S6		10/26/2016 06:27	Matt Green
264 Aqu 109C-GIH-217-S7		10/26/2016 06:27	Matt Green
265 Aqu 110C-GIH-217-S8		10/26/2016 06:27	Matt Green
266 Aqu 11C-GIH-217-S9		10/26/2016 06:23	Matt Green
267 Aqu 112C-GIH-217-S10		10/26/2016 06:28	Matt Green
268 Aqu 113C-GIH-217-S11		10/26/2016 06:29	Matt Green
269 Aqu 114C-GIH-217-S12		10/26/2016 06:29	Matt Green
270 Aqu 115C-GIH-217-S13		10/26/2016 06:29	Matt Green
271 Aqu 116C-GIH-217-S14		10/26/2016 06:30	Matt Green
272 Aqu 117C-GIH-217-S15		10/26/2016 06:30	Matt Green
273 Aqu 118C-GIH-217-S16		10/26/2016 06:30	Matt Green
274 Aqu 119C-GIH-HW-WF	Outside 230	10/26/2016 06:33	Matt Green
275 Aqu 120C-GIH-163-S1		10/26/2016 06:47	Matt Green
276 Aqu 121C-GIH-163-S2		10/26/2016 06:47	Matt Green
277 Aqu 122C-GIH-163-S3		10/26/2016 06:48	Matt Green
278 Aqu 123C-GIH-163-S4		10/26/2016 06:48	Matt Green
279 Aqu 124C-GIH-162-S1		10/26/2016 06:51	Matt Green
280 Aqu 125C-GIH-162-S2		10/26/2016 06:51	Matt Green
281 Aqu 126C-GIH-162-S3		10/26/2016 06:57	Matt Green
282 Aqu 127C-GIH-167-S4		10/26/2016 06:52	Matt Green

Chain of Custody Log


SampleID	Matrix	SampleName	SampleAlias	Sampled	SampledBy
1	Aqueous	1A-GIH-124A-S1	Trainers office	10/26/2016 05:06	Kelly Reidy
2	Aqueous	2A-GIH-214A-S2	Bathroom	10/26/2016 05:07	Kelly Reidy
3	Aqueous	3A-GIH-123B-S1		10/26/2016 05:07	Kelly Reidy
4	Aqueous	4A-GIH-123B-S2		10/26/2016 05:08	Kelly Reidy
5	Aqueous	5A-GIH-123B-WF1		10/26/2016 05:09	Kelly Reidy
6	Aqueous	6A-GIH-MC-WF1	by 123 MC=Main Corridor	10/26/2016 05:10	Kelly Reidy
7	Aqueous	7A-GIH-118-GPLR-S1	GPLR=Girl Player Locker Room	10/26/2016 05:10	Kelly Reidy
8	Aqueous	8A-GIH-118-GPLR-S2		10/26/2016 05:11	Kelly Reidy
9	Aqueous	9A-GIH-118-GPLR-S3		10/26/2016 05:11	Kelly Reidy
10	Aqueous	10A-GIH-118-GPLR-WF1		10/26/2016 05:11	Kelly Reidy
11	Aqueous	11A-GIH-Pool-WF1		10/26/2016 05:13	Kelly Reidy
12	Aqueous	12A-GIH-Pool-WF2		10/26/2016 05:13	Kelly Reidy
13	Aqueous	13A-GIH-117-BPLR-S1	BPLR=Boy Player Locker Room	10/26/2016 05:15	Kelly Reidy
14	Aqueous	14A-GIH-117-BPLR-S2		10/26/2016 05:15	Kelly Reidy
15	Aqueous	15A-GIH-117-BPLR-WF1		10/26/2016 05:16	Kelly Reidy
16	Aqueous	16A-GIH-117-BPLR-S3	Coaches Bathroom	10/26/2016 05:19	Kelly Reidy
17	Aqueous	17A-GIH-GTR-A+B-S1	GTR=Girl's Team Room	10/26/2016 05:22	Kelly Reidy
18	Aqueous	18A-GIH-GTR-A+B-S2		10/26/2016 05:23	Kelly Reidy
19	Aqueous	19A-GIH-GTR-A+B-S3		10/26/2016 05:23	Kelly Reidy
20	Aqueous	20A-GIH-GTRB-S1	GTRB=Girl's Team Restroom	10/26/2016 05:25	Kelly Reidy
21	Aqueous	21A-GIH-GTLR-A-S1		10/26/2016 05:25	Kelly Reidy
22	Aqueous	22A-GIH-MC-WF2	by Girl's Team Room	10/26/2016 05:27	Kelly Reidy
23	Aqueous	23A-GIH-GTLR-C+D-S1	No Sample taken sink not in service	10/26/2016 00:00	Kelly Reidy
24	Aqueous	24A-GIH-GLTR-C+D-S2	No Sample taken sink not in service	10/26/2016 00:00	Kelly Reidy
25	Aqueous	25A-GIH-GTLR-C+D-S3	No Sample taken sink not in service	10/26/2016 00:00	Kelly Reidy
26	Aqueous	26A-GIH-GTLR-D-S1		10/26/2016 05:30	Kelly Reidy
27	Aqueous	27A-GIH-GTLR-C-S1		10/26/2016 05:30	Kelly Reidy
28	Aqueous	28A-GIH-Gym2-WF1	by Girl's Team Room	10/26/2016 05:31	Kelly Reidy
29	Aqueous	29A-GIH-Gym2-WF2		10/26/2016 05:32	Kelly Reidy
30	Aqueous	30A-GIH-PGym-WBR-S1	Pgym=Practice Gym WBR=Women's bathroom	10/26/2016 05:35	Kelly Reidy
31	Aqueous	31A-GIH-PGym-WBR-S2		10/26/2016 05:35	Kelly Reidy
32	Aqueous	32A-GIH-PGym-WBR-S3		10/26/2016 05:37	Kelly Reidy
33	Aqueous	33A-GIH-113-BTR-S1	BTR=Boys Team Room (football)	10/26/2016 05:37	Kelly Reidy
34	Aqueous	34A-GIH-113-BTLR-S2	BTLR=Boy Team Locker Room (Football)	10/26/2016 05:37	Kelly Reidy
35	Aqueous	35A-GIH-113-BTLR-WF	Football	10/26/2016 05:38	Kelly Reidy
36	Aqueous	36A-GIH-113-BTLR-Spicket		10/26/2016 05:39	Kelly Reidy
37	Aqueous	37A-GIH-TO-S1	Team Office by pool	10/26/2016 05:41	Kelly Reidy
38	Aqueous	38A-GIH-TO-Ice Machine		10/26/2016 05:42	Kelly Reidy
39	Aqueous	39A-GIH-MC-WF3		10/26/2016 05:45	Kelly Reidy
40	Aqueous	40A-GIH-112-BTL-S2		10/26/2016 05:45	Kelly Reidy
41	Aqueous	41A-GIH-112-BTL-S1	Coaches Office	10/26/2016 05:47	Kelly Reidy
42	Aqueous	42A-GIH-112-BTL-S3		10/26/2016 05:48	Kelly Reidy
43	Aqueous	43A-GIH-110-Office A- S1		10/26/2016 05:52	Kelly Reidy
44	Aqueous	44A-GIH-MC-WBR-S1	By 108	10/26/2016 05:53	Kelly Reidy
45	Aqueous	45A-GIH-MC-WBR-S2	By 108	10/26/2016 05:55	Kelly Reidy
46	Aqueous	46A-GIH-MC-MBR-S1	by 107	10/26/2016 05:56	Kelly Reidy
47	Aqueous	47A-GIH-MC-MBR-S2	by 107	10/26/2016 05:57	Kelly Reidy
48	Aqueous	48A-GIH-MC-WF4	by 107	10/26/2016 06:00	Kelly Reidy
49	Aqueous	49A-GIH-DO-WF1		10/26/2016 06:05	Kelly Reidy
50	Aqueous	50A-GIH-DO-S1	Kitchen	10/26/2016 06:06	Kelly Reidy
51	Aqueous	51A-GIH-DO-WBR-S2		10/26/2016 06:06	Kelly Reidy
52	Aqueous	52A-GIH-DO-AG-S3	AG=All Gender Bathroom	10/26/2016 06:06	Kelly Reidy
53	Aqueous	53A-GIH-DO-Sprayer	Kitchen	10/26/2016 06:09	Kelly Reidy
54	Aqueous	54A-GIH-180-S1	Coaches Offices	10/26/2016 06:10	Kelly Reidy
55	Aqueous	55A-GIH-122-S1		10/26/2016 06:11	Kelly Reidy
56	Aqueous	56A-GIH-122-S2		10/26/2016 06:12	Kelly Reidy
57	Aqueous	57A-GIH-122-S3		10/26/2016 06:12	Kelly Reidy
58	Aqueous	58A-GIH-122-S4		10/26/2016 06:13	Kelly Reidy
59	Aqueous	59A-GIH-122-S5		10/26/2016 06:15	Kelly Reidy
60	Aqueous	60A-GIH-122-S6		10/26/2016 06:15	Kelly Reidy
61	Aqueous	61A-GIH-122-WF1		10/26/2016 06:15	Kelly Reidy
62	Aqueous	62A-GIH-121B-S1		10/26/2016 06:17	Kelly Reidy
63	Aqueous	63A-GIH-121B-S2		10/26/2016 06:17	Kelly Reidy
64	Aqueous	64A-GIH-121B-S3		10/26/2016 06:18	Kelly Reidy
65	Aqueous	65A-GIH-121B-WF1		10/26/2016 06:18	Kelly Reidy
66	Aqueous	66A-GIH-121A-S1		10/26/2016 06:20	Kelly Reidy
67	Aqueous	67A-GIH-121A-S2		10/26/2016 06:21	Kelly Reidy
68	Aqueous	68A-GIH-121A-S4		10/26/2016 06:21	Kelly Reidy
69	Aqueous	69A-GIH-121A-S3		10/26/2016 06:22	Kelly Reidy
70	Aqueous	70A-GIH-152-S1		10/26/2016 06:30	Kelly Reidy
71	Aqueous	71A-GIH-MC-WF5		10/26/2016 06:31	Kelly Reidy
72	Aqueous	1B-GIH-A-WBR-S1	A=Auditorium	10/26/2016 05:09	Tom Fowler
73	Aqueous	2B-GIH-A-WBR-S2		10/26/2016 05:09	Tom Fowler
74	Aqueous	3B-GIH-A-WBR-S3		10/26/2016 05:09	Tom Fowler
75	Aqueous	4B-GIH-A-MBR-S1		10/26/2016 05:10	Tom Fowler
76	Aqueous	5B-GIH-A-MBR-S2		10/26/2016 05:10	Tom Fowler
77	Aqueous	6B-GIH-A-MBR-S3		10/26/2016 05:10	Tom Fowler
78	Aqueous	7B-GIH-A-MBR-S4		10/26/2016 05:10	Tom Fowler
79	Aqueous	8B-GIH-A-MBR-S5		10/26/2016 05:10	Tom Fowler
80	Aqueous	9B-GIH-A-MBR-S6		10/26/2016 05:10	Tom Fowler
81	Aqueous	10B-GIH-A-WF		10/26/2016 05:13	Tom Fowler

82 Aqueous	11B-GIH-A-BF	BF=Bottle Filler	10/26/2016 05:14	Tom Fowler
83 Aqueous	12B-GIH-Café-S1		10/26/2016 05:20	Tom Fowler
84 Aqueous	13B-GIH-Café-Sprayer		10/26/2016 05:21	Tom Fowler
85 Aqueous	14B-GIH-Kitchen-S2		10/26/2016 05:22	Tom Fowler
86 Aqueous	15B-GIH-Kitchen-S3		10/26/2016 05:23	Tom Fowler
87 Aqueous	16B-GIH-Kitchen-PF	PF=Pot Filler	10/26/2016 05:24	Tom Fowler
88 Aqueous	17B-GIH-Kitchen-PF2		10/26/2016 05:24	Tom Fowler
89 Aqueous	18B-GIH-Kitchen-S4	Food Wash Only	10/26/2016 05:24	Tom Fowler
90 Aqueous	19B-GIH-Kitchen-S5		10/26/2016 05:24	Tom Fowler
91 Aqueous	20B-GIH-Kitchen-BR-S1		10/26/2016 05:27	Tom Fowler
92 Aqueous	21B-GIH-Kitchen-Sprayer2		10/26/2016 05:29	Tom Fowler
93 Aqueous	22B-GIH-Café-WF		10/26/2016 05:32	Tom Fowler
94 Aqueous	23B-GIH-GO-BreakR-S1	GO=Guidance Office	10/26/2016 05:35	Tom Fowler
95 Aqueous	24B-GIH-NO-S1	NO=Nurses Office	10/26/2016 05:37	Tom Fowler
96 Aqueous	25B-GIH-NO-S2		10/26/2016 05:38	Tom Fowler
97 Aqueous	26B-GIH-NO-BR-S1		10/26/2016 05:38	Tom Fowler
98 Aqueous	27B-GIH-NO-BR-S2		10/26/2016 05:39	Tom Fowler
99 Aqueous	28B-GIH-NO-S3		10/26/2016 05:40	Tom Fowler
100 Aqueous	29B-GIH-WSGBR-S1	WSGBR=Women's staff guidance bathroom	10/26/2016 05:42	Tom Fowler
101 Aqueous	30B-GIH-FWBR-S1	FWBR=Faculty Woman's bathroom	10/26/2016 05:43	Tom Fowler
102 Aqueous	31B-GIH-MFBR-S1	MFBR=Mens Faculty Bathroom	10/26/2016 05:45	Tom Fowler
103 Aqueous	32B-GIH-FL-S1	Fl=Faculty Lounge	10/26/2016 05:47	Tom Fowler
104 Aqueous	33B-GIH-CC-S1	CC=Casey's Corner	10/26/2016 05:50	Tom Fowler
105 Aqueous	34B-GIH-MO-Closet-S1	MO=Main Office	10/26/2016 05:55	Tom Fowler
106 Aqueous	35B-GIH-MO-Kitchen-S1		10/26/2016 05:57	Tom Fowler
107 Aqueous	36B-GIH-68-S1		10/26/2016 06:03	Tom Fowler
108 Aqueous	37B-GIH-69-S1		10/26/2016 06:04	Tom Fowler
109 Aqueous	38B-GIH-70-S1		10/26/2016 06:04	Tom Fowler
110 Aqueous	39B-GIH-72-S1		10/26/2016 06:06	Tom Fowler
111 Aqueous	40B-GIH-66-S1		10/26/2016 06:07	Tom Fowler
112 Aqueous	41B-GIH-FBR-S1	FBR=Faculty bathroom by room 66	10/26/2016 06:09	Tom Fowler
113 Aqueous	42B-GIH-MBR-S1	by room 66	10/26/2016 06:12	Tom Fowler
114 Aqueous	43B-GIH-MBR-S2	by room 66	10/26/2016 06:12	Tom Fowler
115 Aqueous	44B-GIH-WBR-S1	by room 66	10/26/2016 06:13	Tom Fowler
116 Aqueous	45B-GIH-WBR-S2	by room 66	10/26/2016 06:13	Tom Fowler
117 Aqueous	46B-GIH-High-WF	by room 66	10/26/2016 06:14	Tom Fowler
118 Aqueous	47B-GIH-Low-WF	by room 66	10/26/2016 06:14	Tom Fowler
119 Aqueous	48B-GIH-WF	by room 182	10/26/2016 06:17	Tom Fowler
120 Aqueous	49B-GIH-169-S1		10/26/2016 06:20	Tom Fowler
121 Aqueous	50B-GIH-169-S2		10/26/2016 06:20	Tom Fowler
122 Aqueous	51B-GIH-169-S3		10/26/2016 06:20	Tom Fowler
123 Aqueous	52B-GIH-169-S4		10/26/2016 06:21	Tom Fowler
124 Aqueous	53B-GIH-165-S1		10/26/2016 06:23	Tom Fowler
125 Aqueous	54B-GIH-165-S2		10/26/2016 06:24	Tom Fowler
126 Aqueous	55B-GIH-165-S3		10/26/2016 06:24	Tom Fowler
127 Aqueous	56B-GIH-165-S4		10/26/2016 06:24	Tom Fowler
128 Aqueous	57B-GIH-WF	Outside 165	10/26/2016 06:26	Tom Fowler
129 Aqueous	58B-GIH-BF	Outside 165	10/26/2016 06:27	Tom Fowler
130 Aqueous	59B-GIH-MBR-S1	Outside 165	10/26/2016 06:28	Tom Fowler
131 Aqueous	60B-GIH-MBR-S2	Outside 165	10/26/2016 06:28	Tom Fowler
132 Aqueous	61B-GIH-WBR-S1	Outside 165	10/26/2016 06:29	Tom Fowler
133 Aqueous	62B-GIH-WBR-S2		10/26/2016 06:29	Tom Fowler
134 Aqueous	63B-GIH-WBR-S3	Outside 165	10/26/2016 06:29	Tom Fowler
135 Aqueous	64B-GIH-WBR-S4	Outside 165	10/26/2016 06:29	Tom Fowler
136 Aqueous	65B-GIH-WBR-S5	Outside 165	10/26/2016 06:29	Tom Fowler
137 Aqueous	66B-GIH-WBR-S8		10/26/2016 06:37	Tom Fowler
138 Aqueous	67B-GIH-172-S1		10/26/2016 06:40	Tom Fowler
139 Aqueous	68B-GIH-171-S2		10/26/2016 06:40	Tom Fowler
140 Aqueous	69B-GIH-171-S3		10/26/2016 06:41	Tom Fowler
141 Aqueous	70B-GIH-171-S4		10/26/2016 06:41	Tom Fowler
142 Aqueous	71B-GIH-171-S5		10/26/2016 06:42	Tom Fowler
143 Aqueous	72B-GIH-171-S6		10/26/2016 06:42	Tom Fowler
144 Aqueous	73B-GIH-171-S7		10/26/2016 06:43	Tom Fowler
145 Aqueous	74B-GIH-171-S8		10/26/2016 06:43	Tom Fowler
146 Aqueous	75B-GIH-171-S9		10/26/2016 06:44	Tom Fowler
147 Aqueous	76B-GIH-171-S10		10/26/2016 06:44	Tom Fowler
148 Aqueous	77B-GIH-171-S11		10/26/2016 06:45	Tom Fowler
149 Aqueous	78B-GIH-171-S12		10/26/2016 06:46	Tom Fowler
150 Aqueous	79B-GIH-171-S13		10/26/2016 06:46	Tom Fowler
151 Aqueous	80B-GIH-171-S14		10/26/2016 06:46	Tom Fowler
152 Aqueous	81B-GIH-171-S15		10/26/2016 06:47	Tom Fowler
153 Aqueous	82B-GIH-171-S16		10/26/2016 06:48	Tom Fowler
154 Aqueous	83B-GIH-MS. Eppers-S		10/26/2016 06:52	Tom Fowler
155 Aqueous	84B-GIH-Library-S1		10/26/2016 06:52	Tom Fowler
156 Aqueous	1C-GIH-HW-WF	By 203	10/26/2016 05:03	Matt Green
157 Aqueous	2C-GIH-205-S1		10/26/2016 05:07	Matt Green
158 Aqueous	3C-GIH-WB-S1	Faculty	10/26/2016 05:08	Matt Green
159 Aqueous	4C-GIH-MB-S1	Faculty	10/26/2016 07:08	Matt Green
160 Aqueous	5C-GIH-211-S1		10/26/2016 05:10	Matt Green
161 Aqueous	6C-GIH-211-S2		10/26/2016 05:10	Matt Green
162 Aqueous	7C-GIH-211-S3		10/26/2016 05:11	Matt Green
163 Aqueous	8C-GIH-211-S4		10/26/2016 05:12	Matt Green


164	Aqueous	9C-GIH-211-S5		10/26/2016 05:12	Matt Green
165	Aqueous	10C-GIH-211-S6		10/26/2016 05:14	Matt Green
166	Aqueous	11C-GIH-211-S7		10/26/2016 07:13	Matt Green
167	Aqueous	12C-GIH-211-S8		10/26/2016 05:15	Matt Green
168	Aqueous	13C-GIH-211-S9		10/26/2016 05:15	Matt Green
169	Aqueous	14C-GIH-211-S10		10/26/2016 05:16	Matt Green
170	Aqueous	15C-GIH-211-S11		10/26/2016 05:17	Matt Green
171	Aqueous	16C-GIH-211-S12		10/26/2016 05:18	Matt Green
172	Aqueous	17C-GIH-211-S13		10/26/2016 05:18	Matt Green
173	Aqueous	18C-GIH-211-S14		10/26/2016 05:18	Matt Green
174	Aqueous	19C-GIH-211-S19		10/26/2016 05:19	Matt Green
175	Aqueous	20C-GIH-211-S20		10/26/2016 05:19	Matt Green
176	Aqueous	21C-GIH-213-S1		10/26/2016 05:21	Matt Green
177	Aqueous	22C-GIH-213-S2		10/26/2016 05:22	Matt Green
178	Aqueous	23C-GIH-213-S3		10/26/2016 05:23	Matt Green
179	Aqueous	24C-GIH-213-S4		10/26/2016 05:23	Matt Green
180	Aqueous	25C-GIH-213-S5		10/26/2016 05:24	Matt Green
181	Aqueous	26C-GIH-213-S6		10/26/2016 05:24	Matt Green
182	Aqueous	27C-GIH-213-S7		10/26/2016 05:25	Matt Green
183	Aqueous	28C-GIH-213-S8		10/26/2016 05:25	Matt Green
184	Aqueous	29C-GIH-213-S9		10/26/2016 05:26	Matt Green
185	Aqueous	30C-GIH-213-S10		10/26/2016 05:26	Matt Green
186	Aqueous	31C-GIH-213-S11		10/26/2016 05:27	Matt Green
187	Aqueous	32C-GIH-213-S12		10/26/2016 05:27	Matt Green
188	Aqueous	33C-GIH-213-S13		10/26/2016 05:28	Matt Green
189	Aqueous	34C-GIH-213-S14		10/26/2016 05:28	Matt Green
190	Aqueous	35C-GIH-213-S15	Hood	10/26/2016 05:30	Matt Green
191	Aqueous	36C-GIH-213-S16		10/26/2016 05:30	Matt Green
192	Aqueous	37C-GIH-213-S17		10/26/2016 05:31	Matt Green
193	Aqueous	38C-GIH-211-S17		10/26/2016 05:37	Matt Green
194	Aqueous	39C-GIH-BB-S1		10/26/2016 05:38	Matt Green
195	Aqueous	40C-GIH-BB-S2		10/26/2016 05:42	Matt Green
196	Aqueous	41C-GIH-BB-S3		10/26/2016 05:42	Matt Green
197	Aqueous	42C-GIH-BB-S4		10/26/2016 05:43	Matt Green
198	Aqueous	43C-GIH-HW-WF	Outside 214	10/26/2016 05:44	Matt Green
199	Aqueous	44C-GIH-GB-S1		10/26/2016 05:45	Matt Green
200	Aqueous	45C-GIH-GB-S2	No Sample	10/26/2016 05:45	Matt Green
201	Aqueous	46C-GIH-GB-S3		10/26/2016 05:46	Matt Green
202	Aqueous	47C-GIH-GB-S4		10/26/2016 05:46	Matt Green
203	Aqueous	48C-GIH-214-S1		10/26/2016 05:49	Matt Green
204	Aqueous	49C-GIH-214-S2		10/26/2016 05:49	Matt Green
205	Aqueous	50C-GIH-214-S3		10/26/2016 05:50	Matt Green
206	Aqueous	51C-GIH-214-S4		10/26/2016 05:50	Matt Green
207	Aqueous	52C-GIH-214-S5		10/26/2016 05:51	Matt Green
208	Aqueous	53C-GIH-214-S6		10/26/2016 05:51	Matt Green
209	Aqueous	54C-GIH-214-S7		10/26/2016 05:51	Matt Green
210	Aqueous	55C-GIH-214-S8		10/26/2016 05:52	Matt Green
211	Aqueous	56C-GIH-214-S9		10/26/2016 05:52	Matt Green
212	Aqueous	57C-GIH-214-S10		10/26/2016 05:53	Matt Green
213	Aqueous	58C-GIH-214-S11		10/26/2016 05:53	Matt Green
214	Aqueous	59C-GIH-214-S12		10/26/2016 05:53	Matt Green
215	Aqueous	60C-GIH-214-S13		10/26/2016 05:54	Matt Green
216	Aqueous	61C-GIH-214-S14		10/26/2016 05:59	Matt Green
217	Aqueous	62C-GIH-214-S15	Hood	10/26/2016 05:55	Matt Green
218	Aqueous	63C-GIH-214-S16		10/26/2016 05:55	Matt Green
219	Aqueous	64C-GIH-214-S17		10/26/2016 05:57	Matt Green
220	Aqueous	65C-GIH-223-S1		10/26/2016 05:59	Matt Green
221	Aqueous	66C-GIH-223-S2		10/26/2016 06:00	Matt Green
222	Aqueous	67C-GIH-223-S3		10/26/2016 06:00	Matt Green
223	Aqueous	68C-GIH-223-S4		10/26/2016 06:00	Matt Green
224	Aqueous	69C-GIH-223-S5		10/26/2016 06:02	Matt Green
225	Aqueous	70C-GIH-223-S5		10/26/2016 06:02	Matt Green
226	Aqueous	71C-GIH-223-S7		10/26/2016 06:03	Matt Green
227	Aqueous	72C-GIH-223-S8		10/26/2016 06:03	Matt Green
228	Aqueous	73C-GIH-223-S9		10/26/2016 06:04	Matt Green
229	Aqueous	74C-GIH-223-S10		10/26/2016 06:04	Matt Green
230	Aqueous	75C-GIH-223-S11		10/26/2016 06:05	Matt Green
231	Aqueous	76C-GIH-223-S12		10/26/2016 06:05	Matt Green
232	Aqueous	77C-GIH-223-S13		10/26/2016 06:05	Matt Green
233	Aqueous	78C-GIH-223-S14		10/26/2016 06:06	Matt Green
234	Aqueous	79C-GIH-223-S15		10/26/2016 06:07	Matt Green
235	Aqueous	80C-GIH-223-S16		10/26/2016 06:07	Matt Green
236	Aqueous	81C-GIH-223-S17		10/26/2016 06:07	Matt Green
237	Aqueous	82C-GIH-223-S17		10/26/2016 06:11	Matt Green
238	Aqueous	83C-GIH-215-S2		10/26/2016 06:11	Matt Green
239	Aqueous	84C-GIH-223A-S1	Hood	10/26/2016 06:12	Matt Green
240	Aqueous	85C-GIH-223A-S2		10/26/2016 06:13	Matt Green
241	Aqueous	86C-GIH-216-S1		10/26/2016 06:15	Matt Green
242	Aqueous	87C-GIH-216-S2		10/26/2016 06:16	Matt Green
243	Aqueous	88C-GIH-216-S3		10/26/2016 06:16	Matt Green
244	Aqueous	89C-GIH-216-S4		10/26/2016 06:11	Matt Green
245	Aqueous	90C-GIH-216-S5		10/26/2016 06:17	Matt Green

246 Aqueous	91C-GIH-216-S6		10/26/2016 06:17	Matt Green
247 Aqueous	92C-GIH-216-S7		10/26/2016 06:18	Matt Green
248 Aqueous	93C-GIH-216-S8		10/26/2016 06:18	Matt Green
249 Aqueous	94C-GIH-216-S9		10/26/2016 06:19	Matt Green
250 Aqueous	95C-GIH-216-S10		10/26/2016 06:19	Matt Green
251 Aqueous	96C-GIH-216-S11		10/26/2016 06:20	Matt Green
252 Aqueous	97C-GIH-216-S12		10/26/2016 06:20	Matt Green
253 Aqueous	98C-GIH-216-S13		10/26/2016 06:20	Matt Green
254 Aqueous	99C-GIH-216-S14		10/26/2016 06:21	Matt Green
255 Aqueous	100C-GIH-216-S15	Hood	10/26/2016 06:21	Matt Green
256 Aqueous	101C-GIH-216-S16		10/26/2016 06:22	Matt Green
257 Aqueous	102C-GIH-216-S17		10/26/2016 06:22	Matt Green
258 Aqueous	103C-GIH-217-S1		10/26/2016 06:25	Matt Green
259 Aqueous	104C-GIH-217-S2		10/26/2016 06:25	Matt Green
260 Aqueous	105C-GIH-217-S3		10/26/2016 06:26	Matt Green
261 Aqueous	106C-GIH-217-S4		10/26/2016 06:26	Matt Green
262 Aqueous	107C-GIH-217-S5		10/26/2016 06:26	Matt Green
263 Aqueous	108C-GIH-217-S6		10/26/2016 06:27	Matt Green
264 Aqueous	109C-GIH-217-S7		10/26/2016 06:27	Matt Green
265 Aqueous	110C-GIH-217-S8		10/26/2016 06:27	Matt Green
266 Aqueous	111C-GIH-217-S9		10/26/2016 06:23	Matt Green
267 Aqueous	112C-GIH-217-S10		10/26/2016 06:28	Matt Green
268 Aqueous	113C-GIH-217-S11		10/26/2016 06:29	Matt Green
269 Aqueous	114C-GIH-217-S12		10/26/2016 06:29	Matt Green
270 Aqueous	115C-GIH-217-S13		10/26/2016 06:29	Matt Green
271 Aqueous	116C-GIH-217-S14		10/26/2016 06:30	Matt Green
272 Aqueous	117C-GIH-217-S15		10/26/2016 06:30	Matt Green
273 Aqueous	118C-GIH-217-S16		10/26/2016 06:30	Matt Green
274 Aqueous	119C-GIH-HW-WF	Outside 230	10/26/2016 06:33	Matt Green
275 Aqueous	120C-GIH-163-S1		10/26/2016 06:47	Matt Green
276 Aqueous	121C-GIH-163-S2		10/26/2016 06:47	Matt Green
277 Aqueous	122C-GIH-163-S3		10/26/2016 06:48	Matt Green
278 Aqueous	123C-GIH-163-S4		10/26/2016 06:48	Matt Green
279 Aqueous	124C-GIH-162-S1		10/26/2016 06:51	Matt Green
280 Aqueous	125C-GIH-162-S2		10/26/2016 06:51	Matt Green
281 Aqueous	126C-GIH-162-S3		10/26/2016 06:57	Matt Green
282 Aqueous	127C-GIH-167-S4		10/26/2016 06:52	Matt Green

Sample Location Map(s)

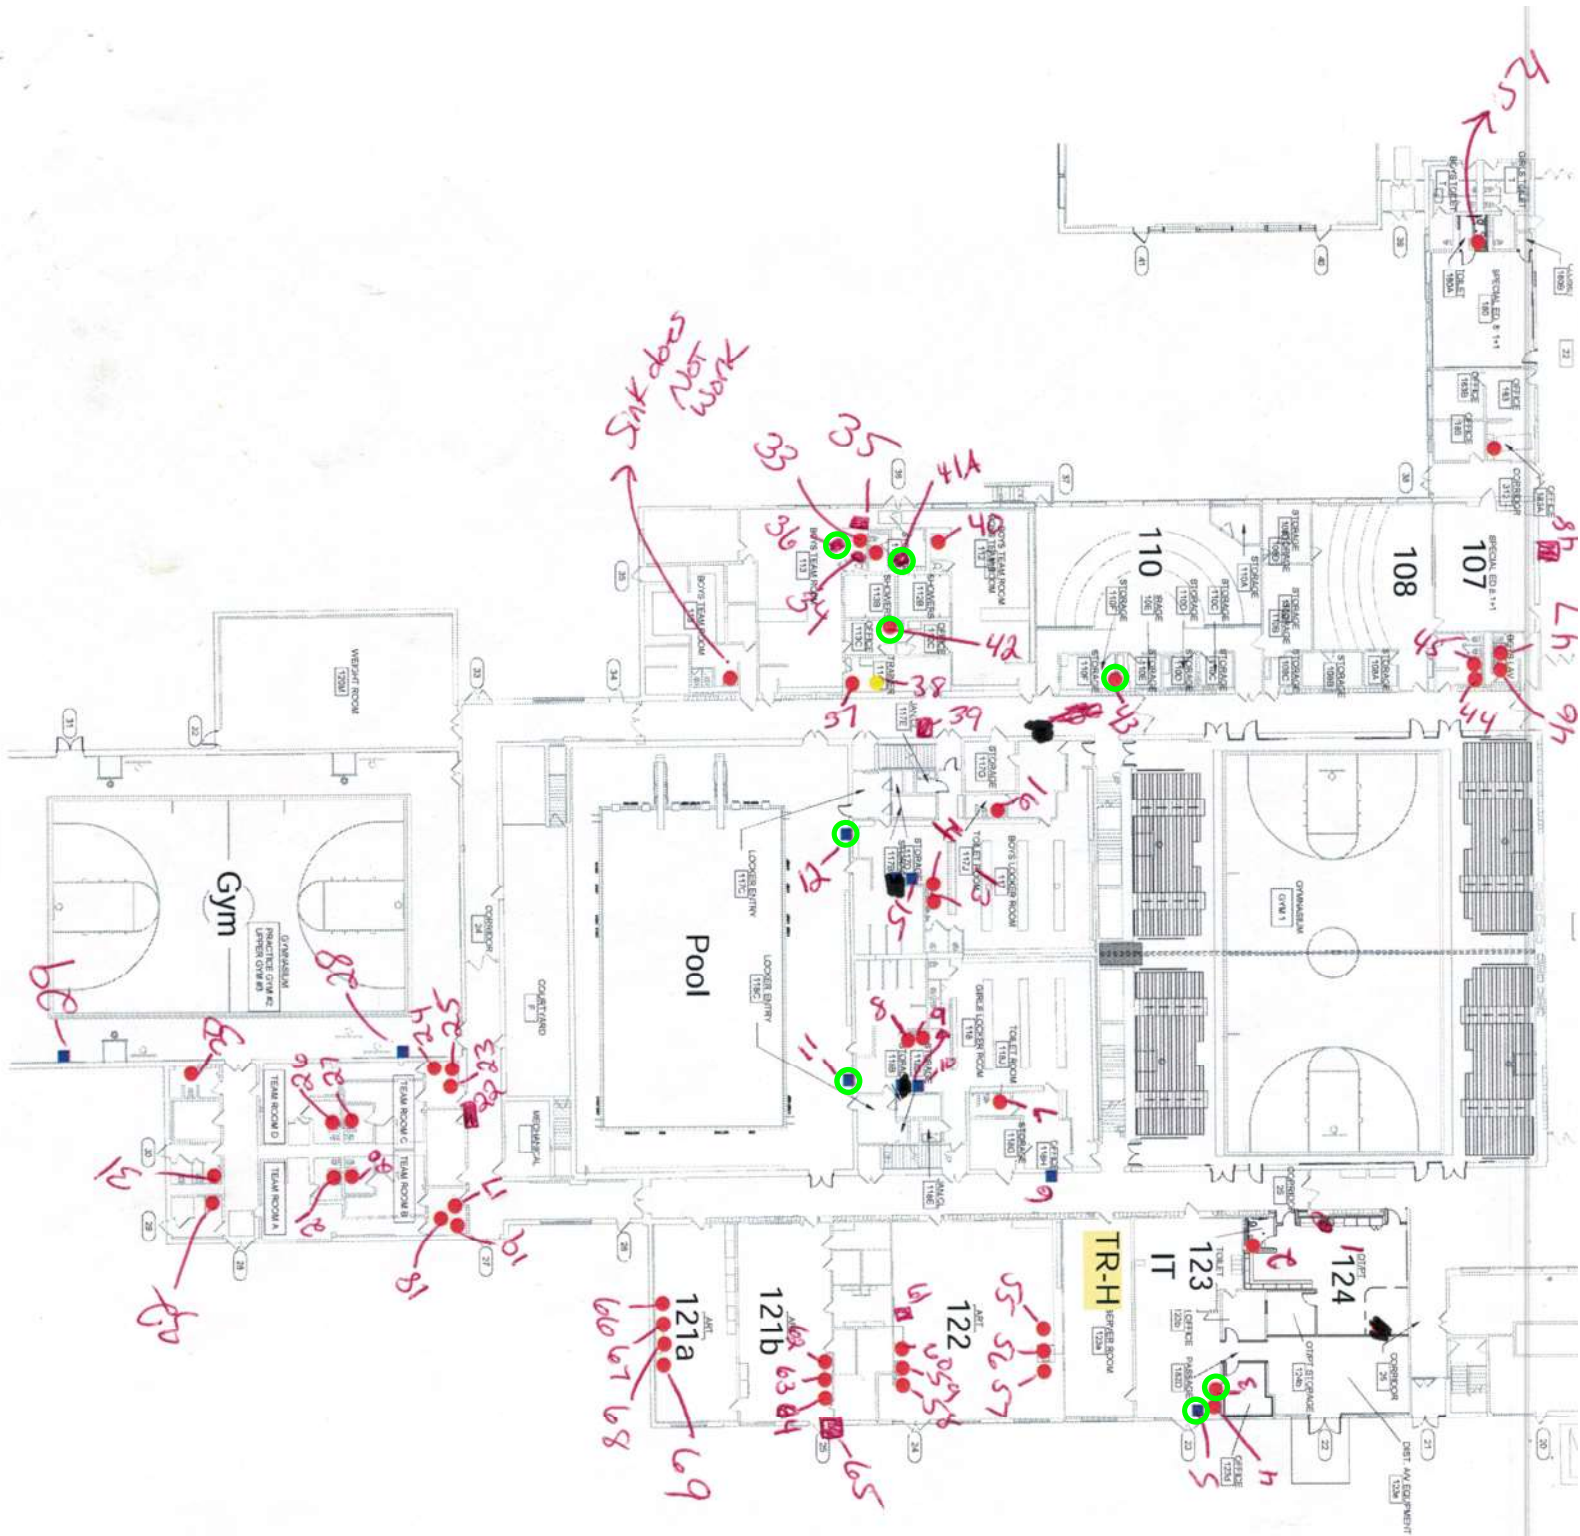

Map 3 A samples

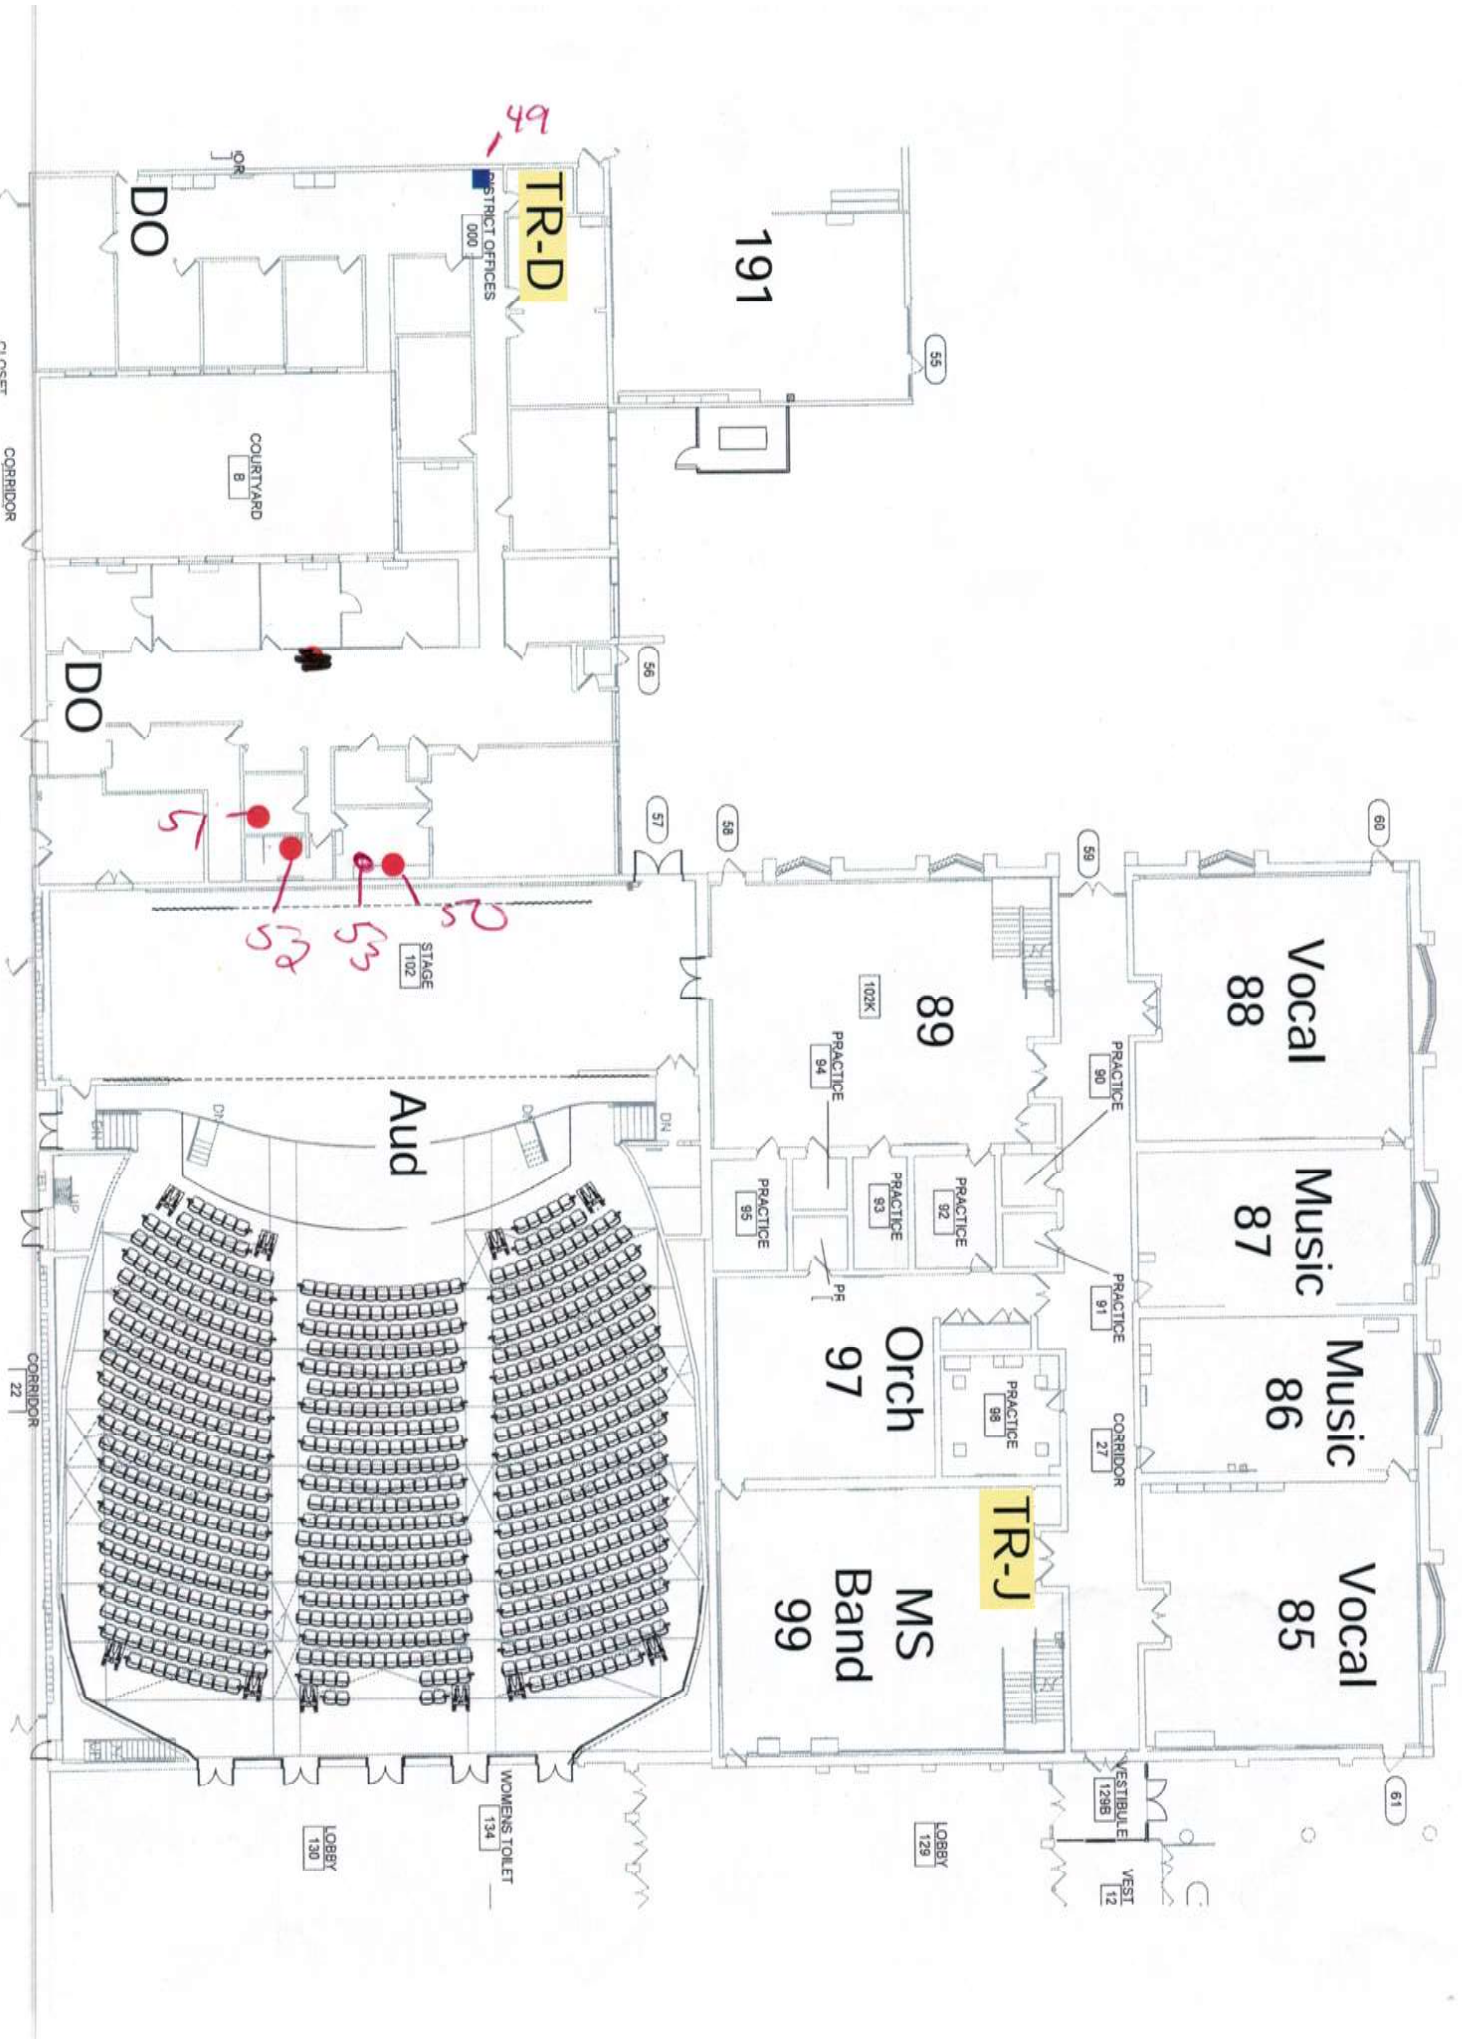


Team B

(Kitchen)

• Do cafe Then Move


~~other samples~~

~ 101 samples

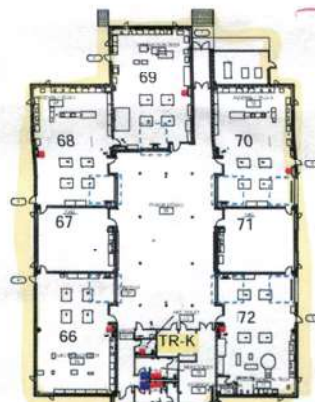


Map 1

Map 4

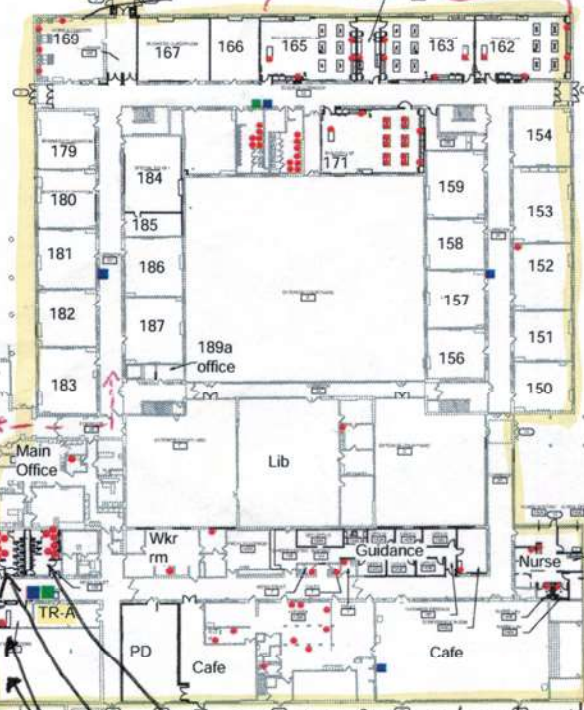


Map 2

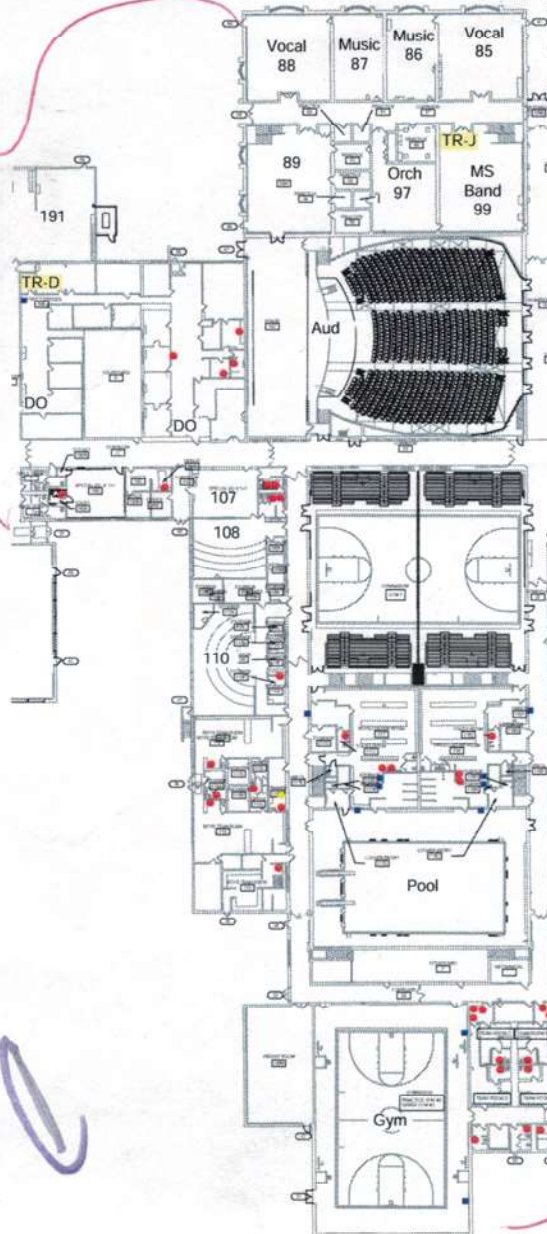

Map 5

Aud Bath mens (sinks 4-9)
 Aud Bath womens
 sinks (sinks 1-3)
 Aud WF (10)
 Aud Bottle filler (11)


Map 3

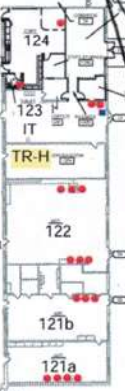




B Samples


B Samples

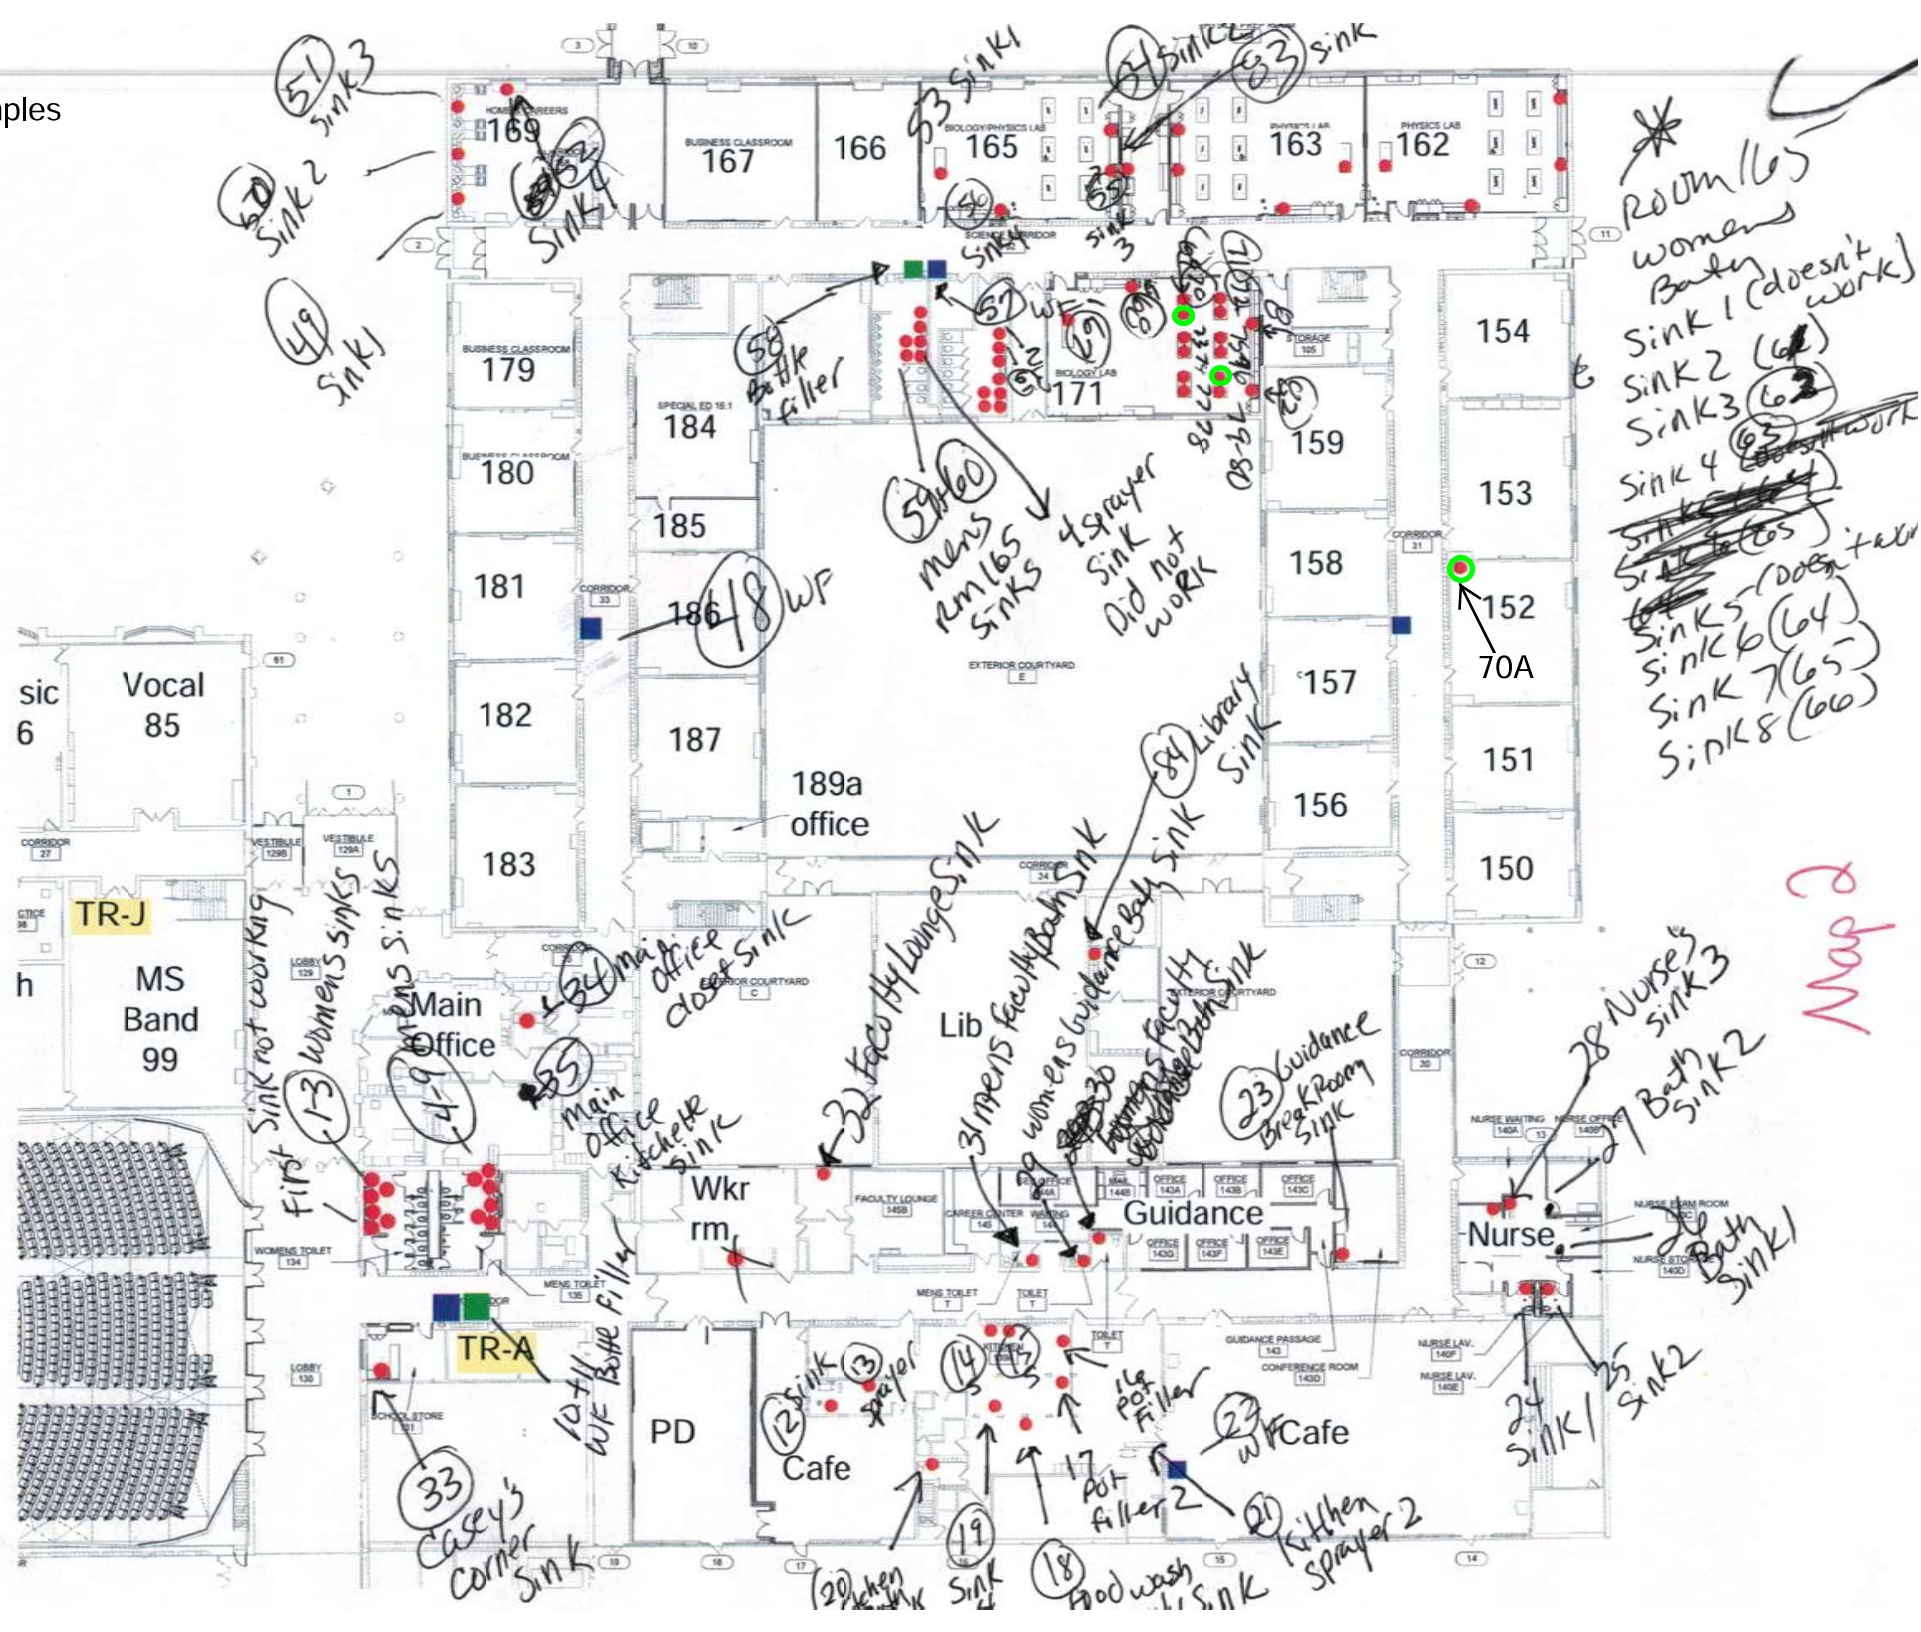



Level 02 Floor Plan

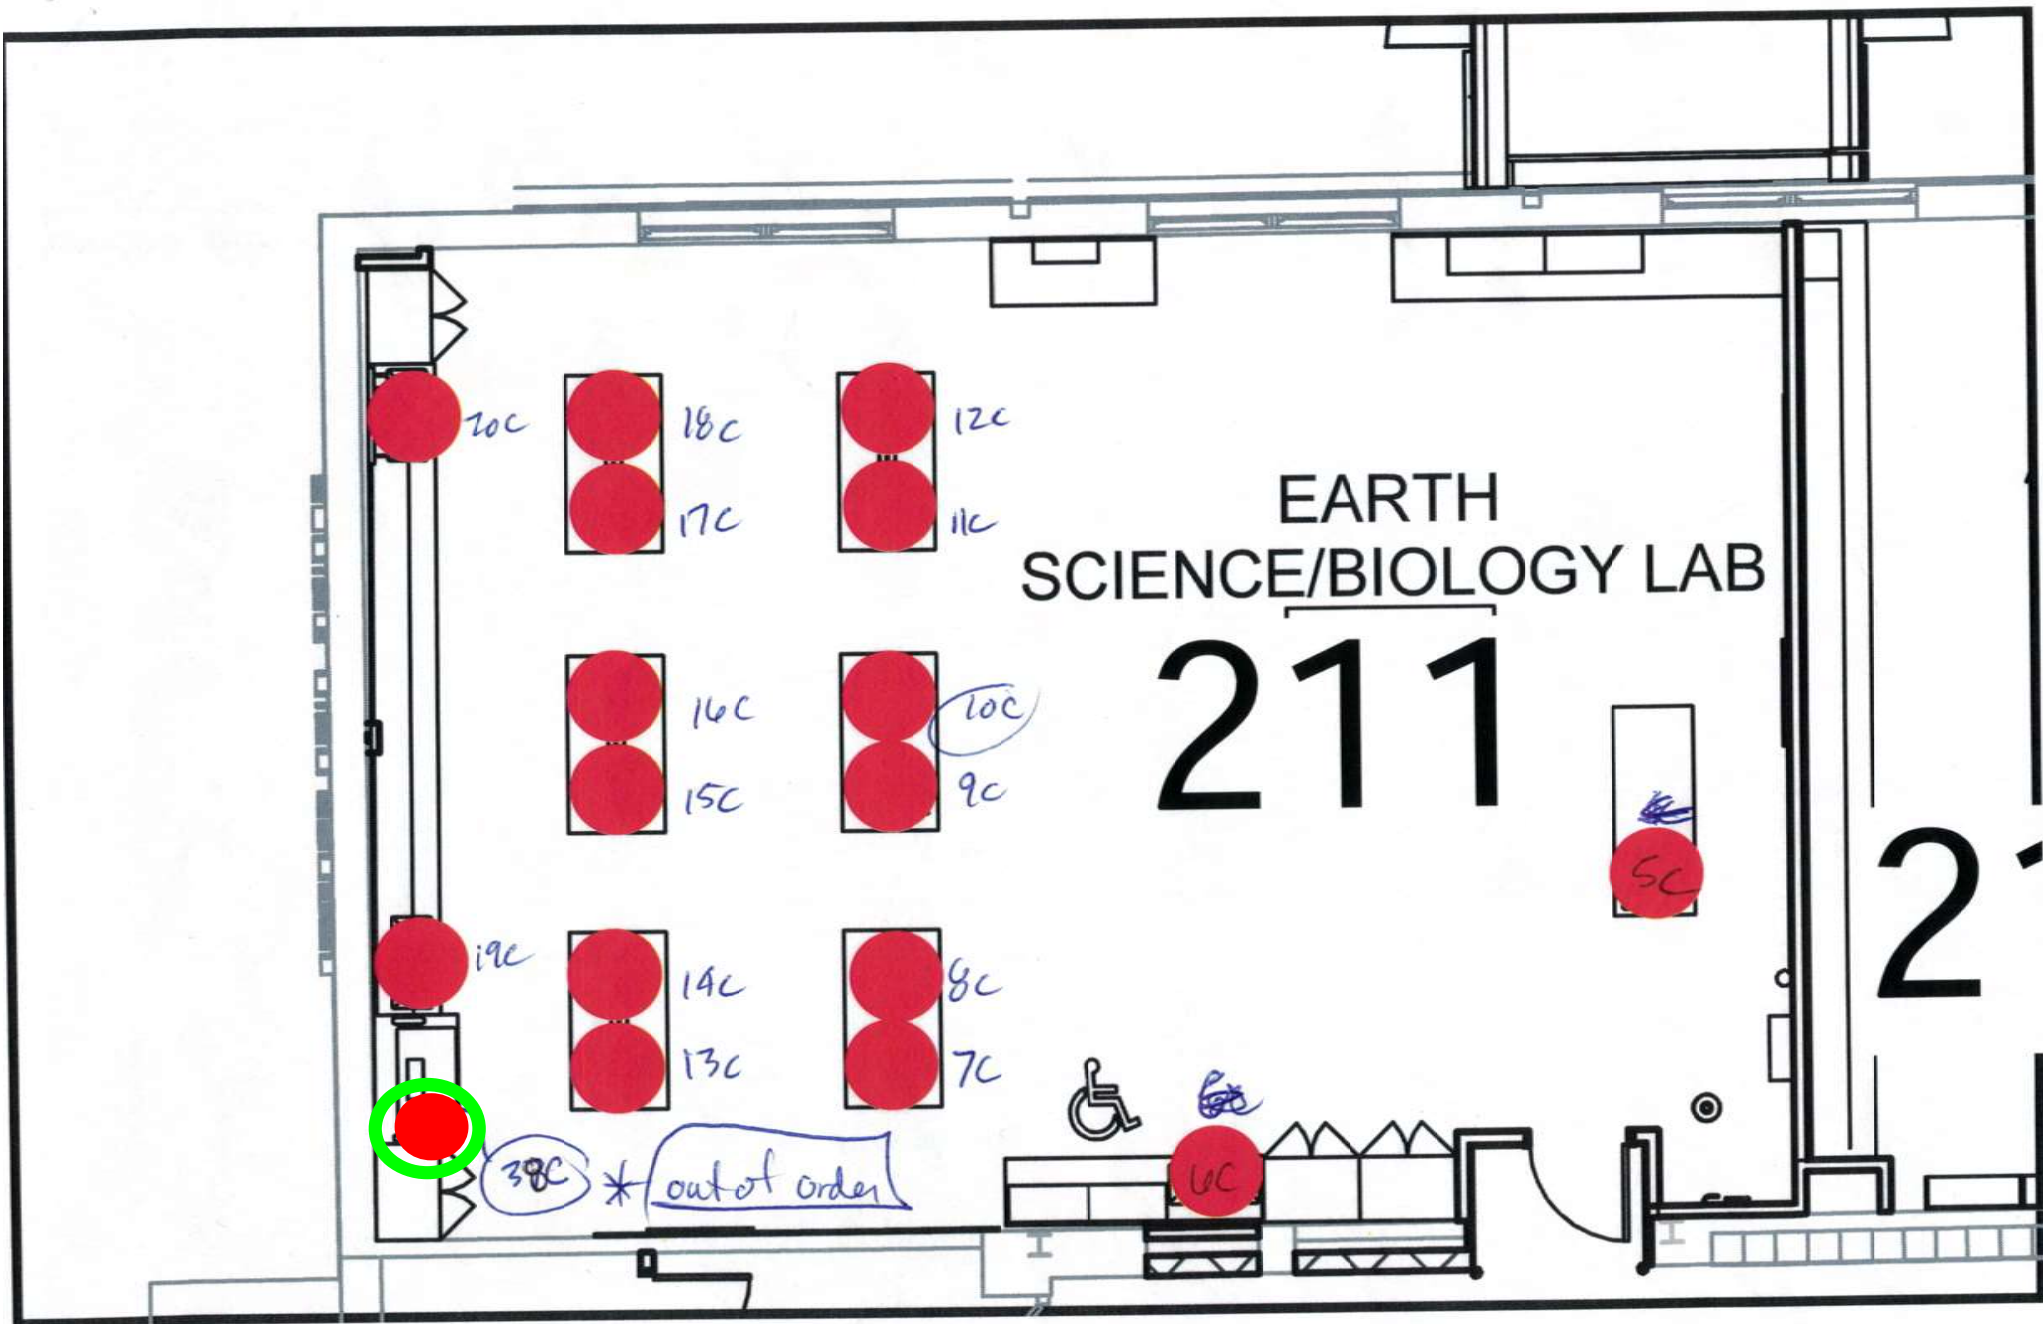


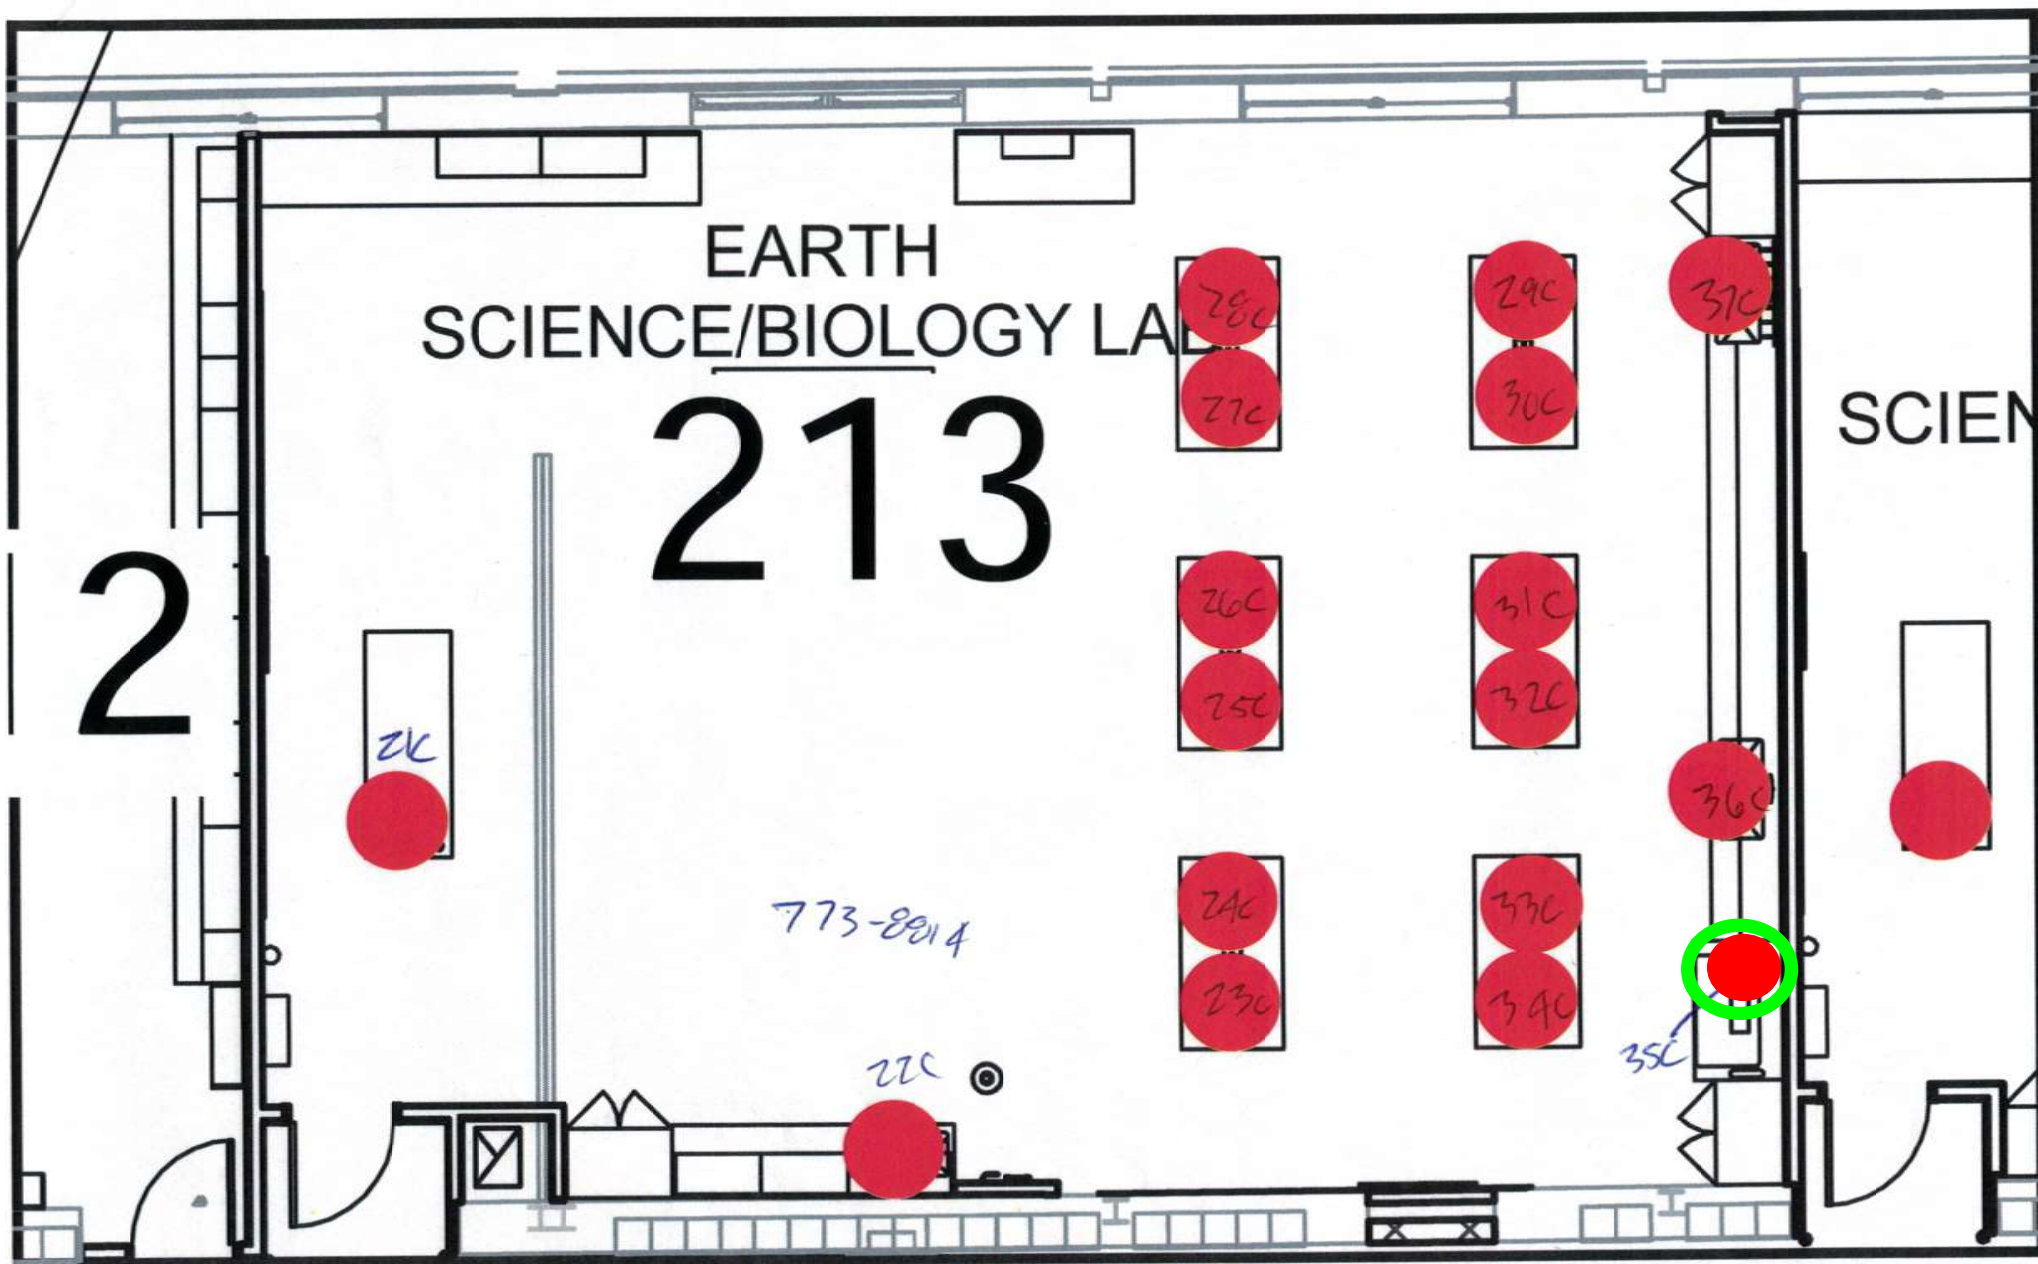



EARTH
SCIENCE/CHEMISTRY
LAB


214


215

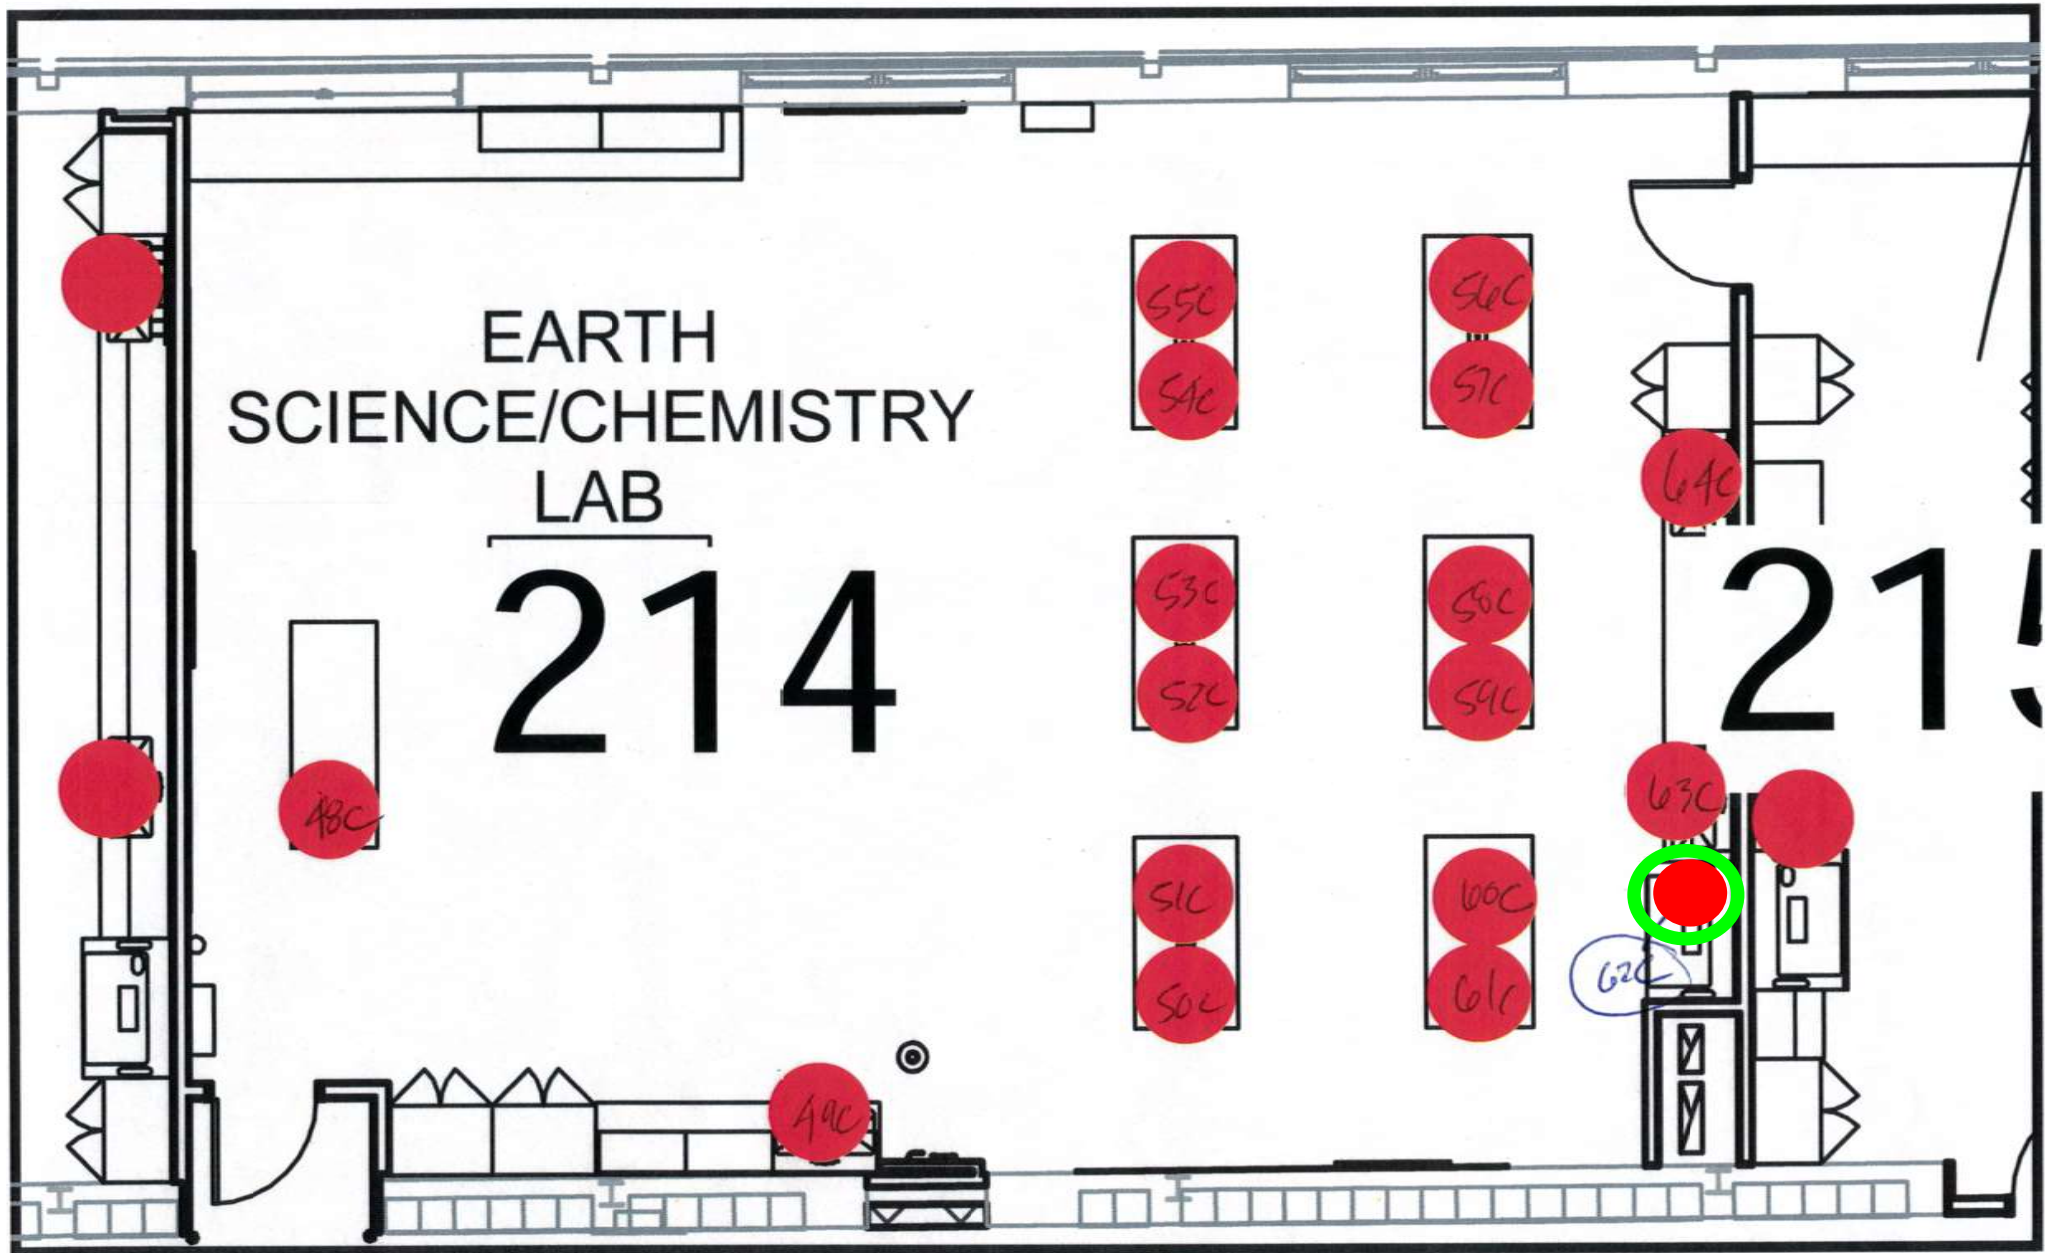

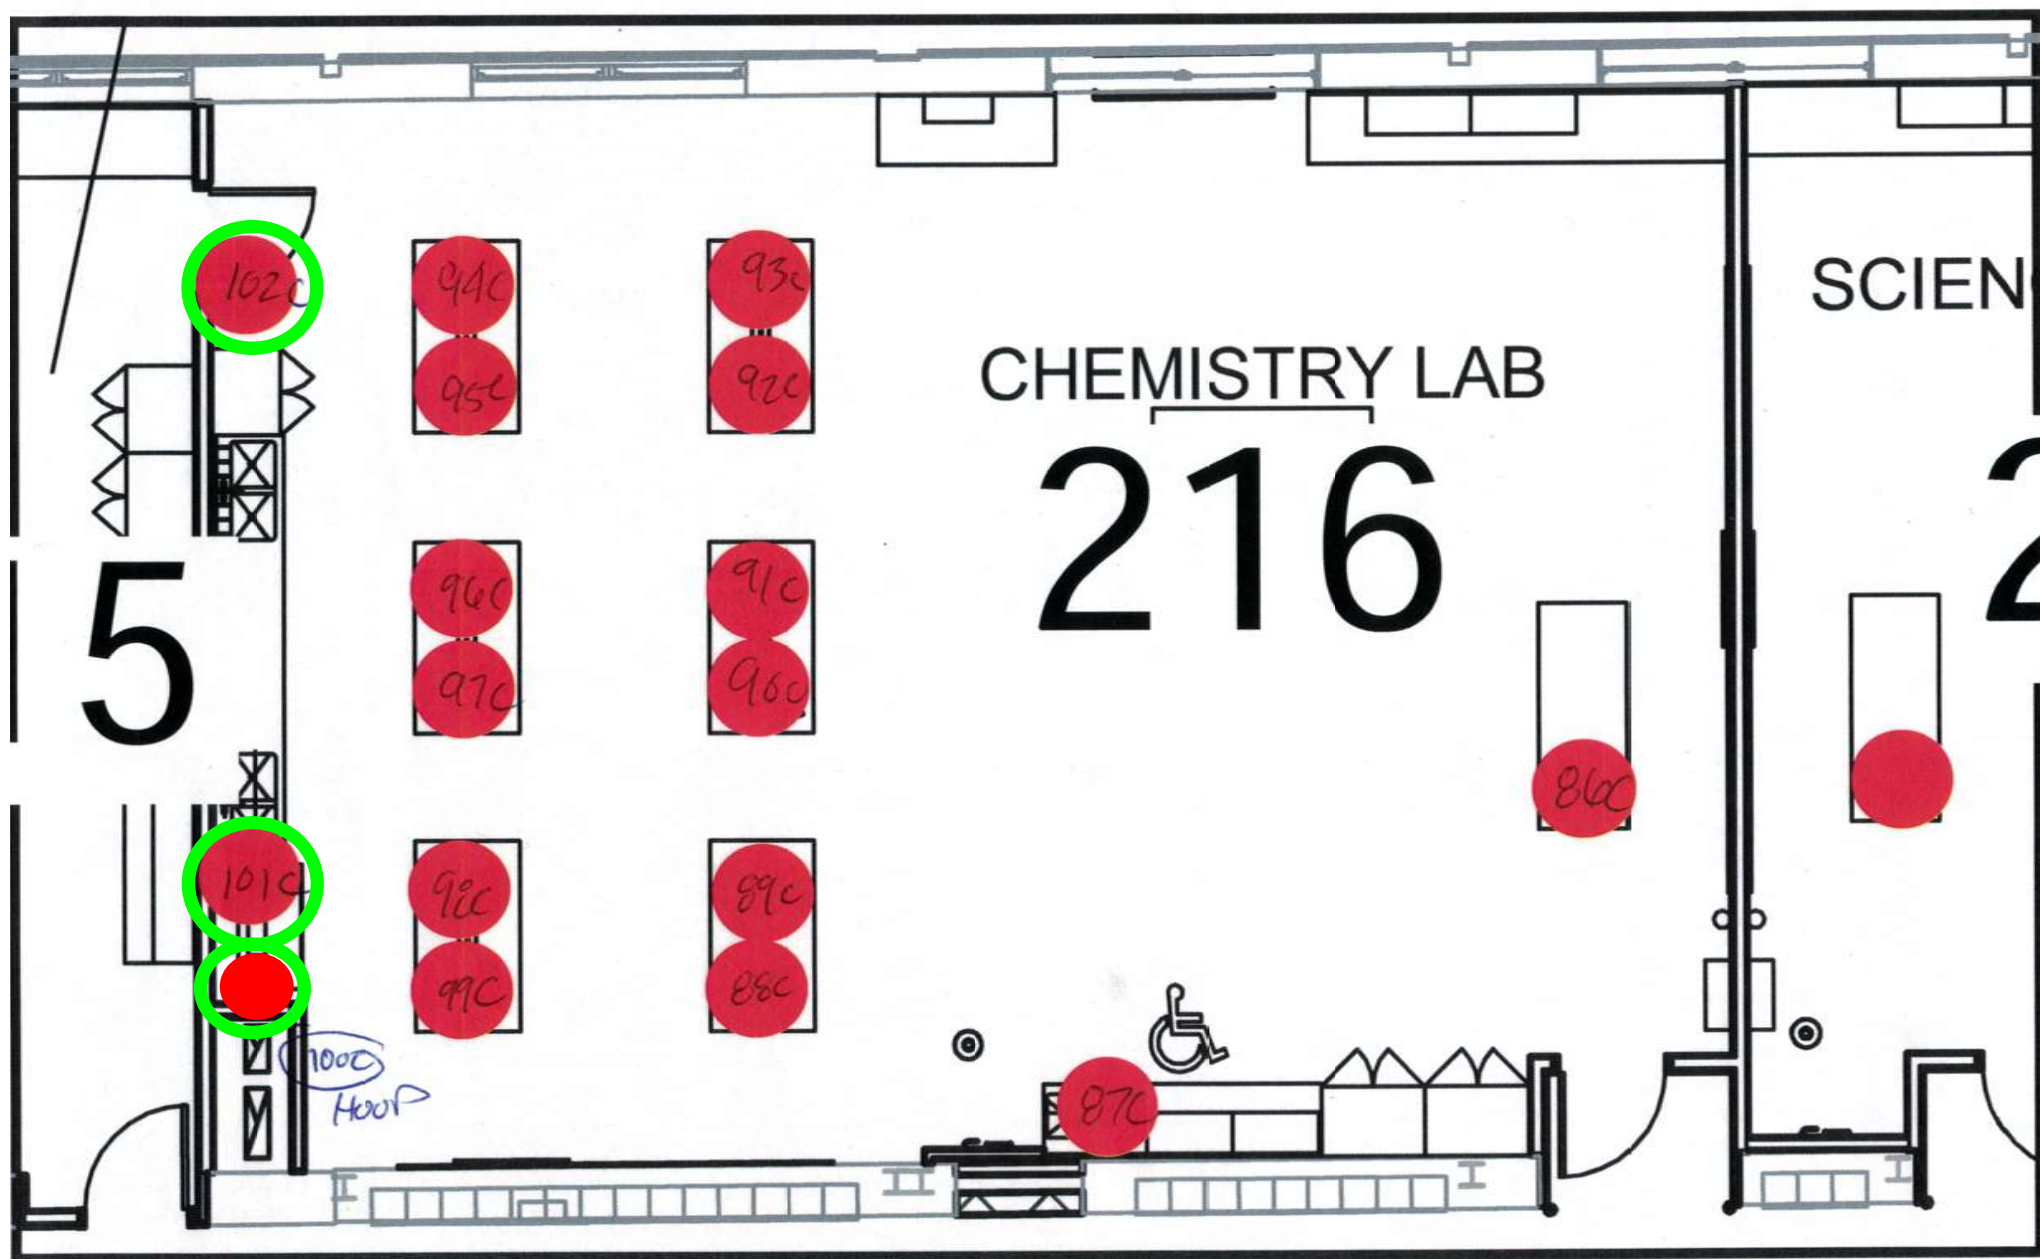

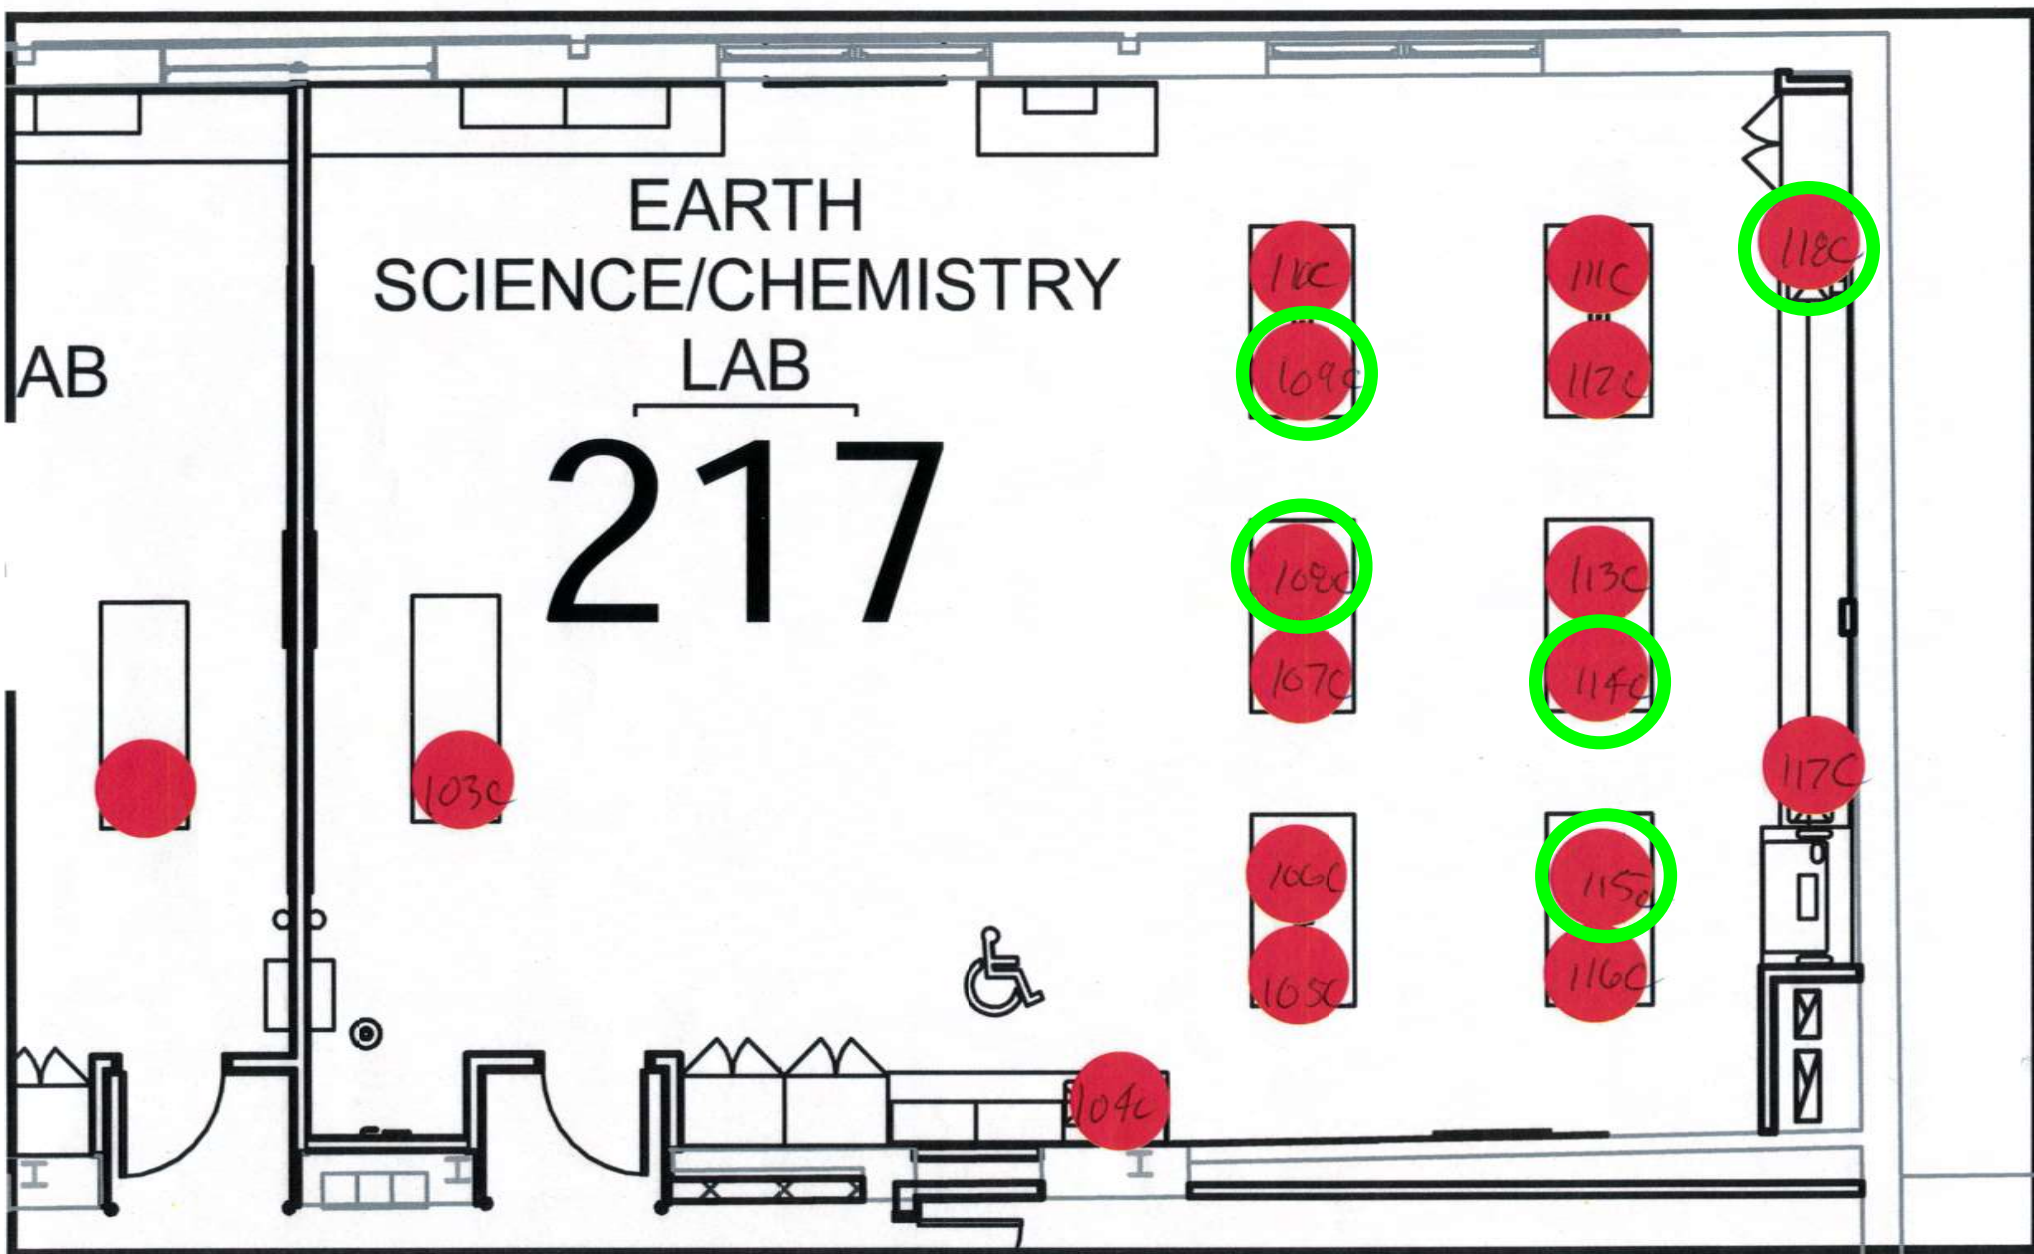

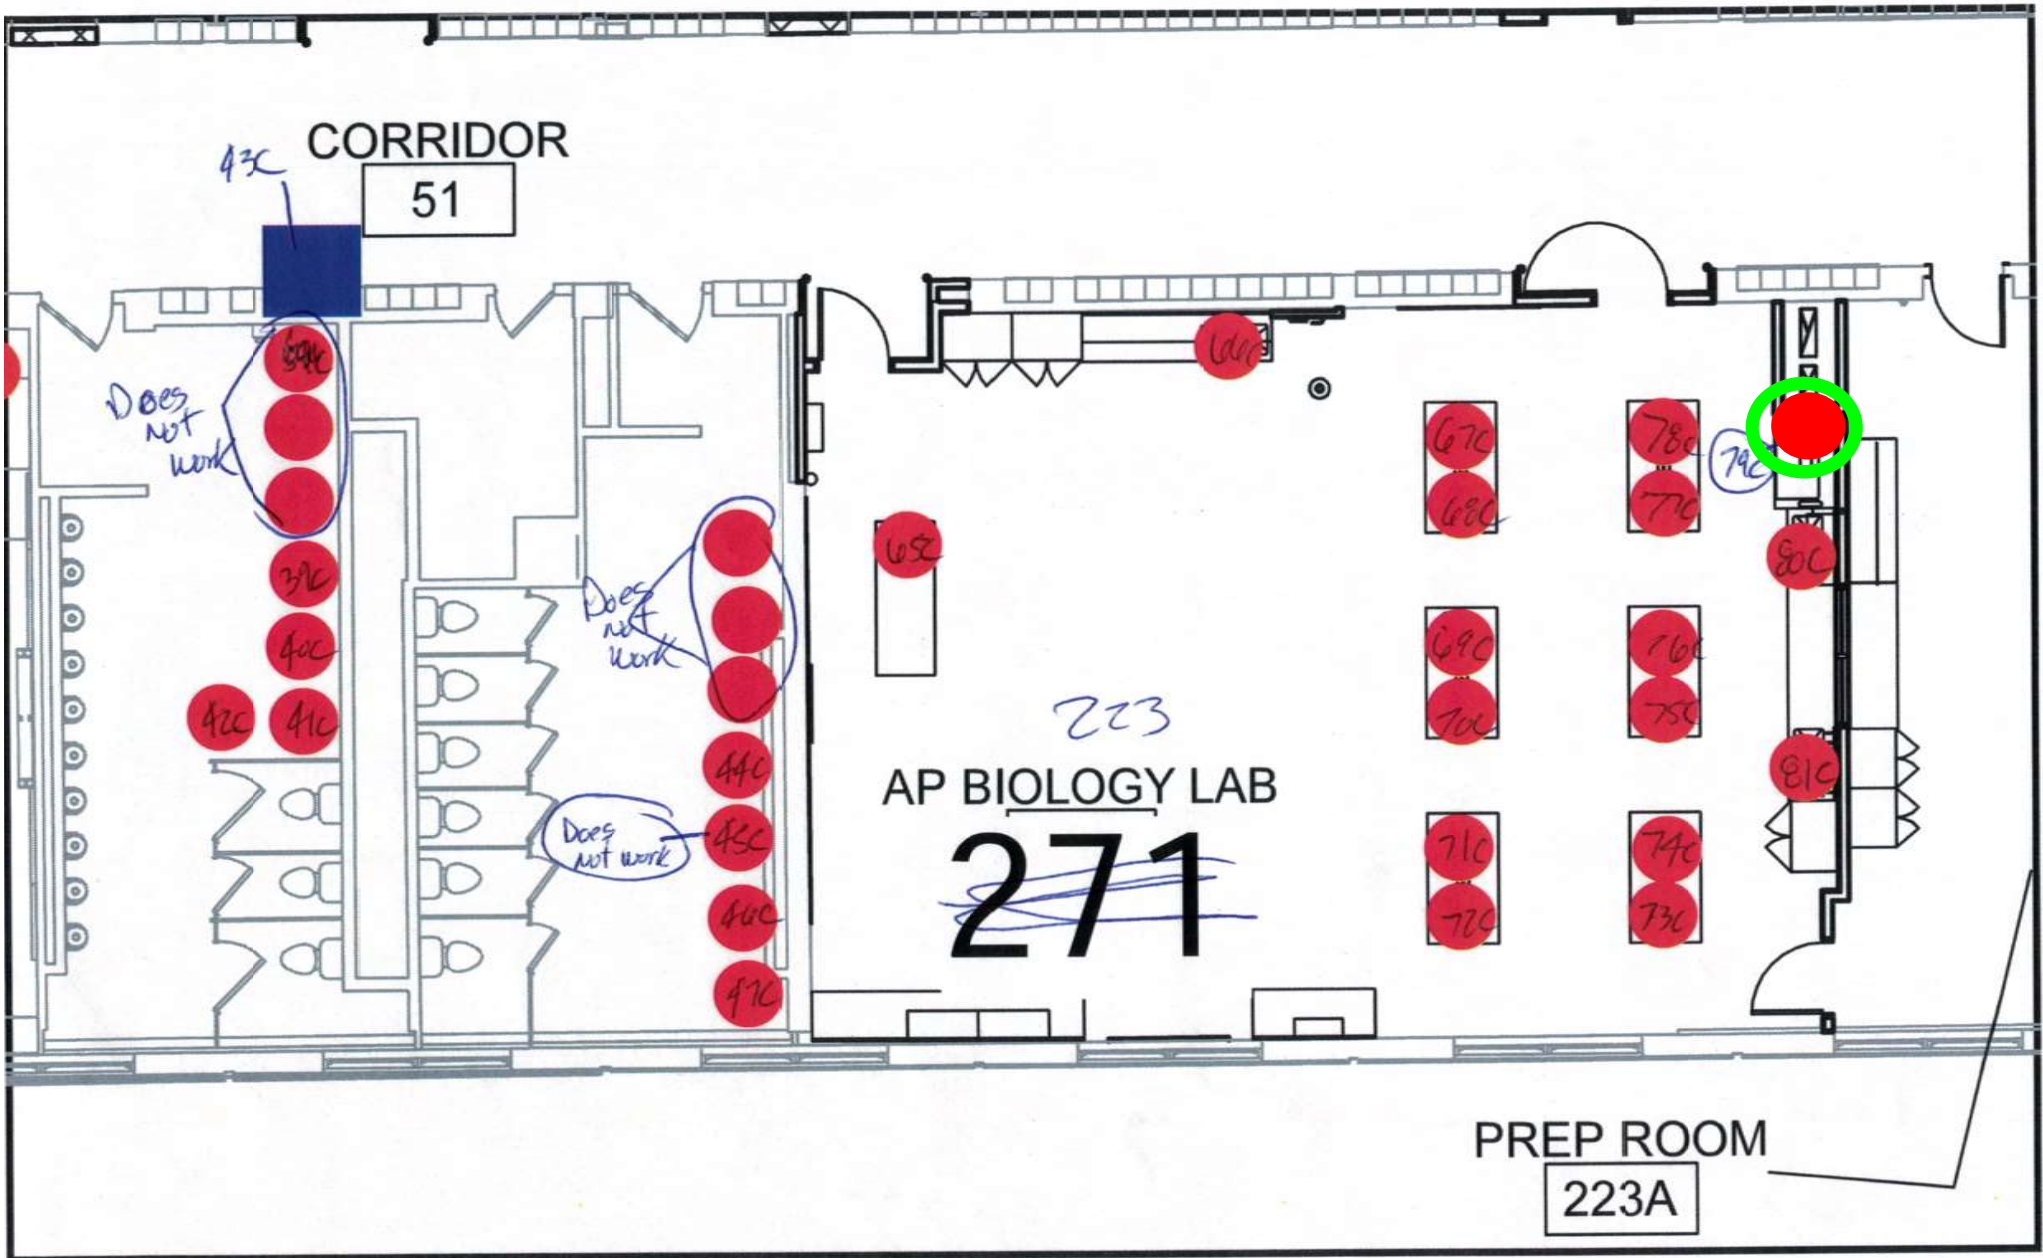

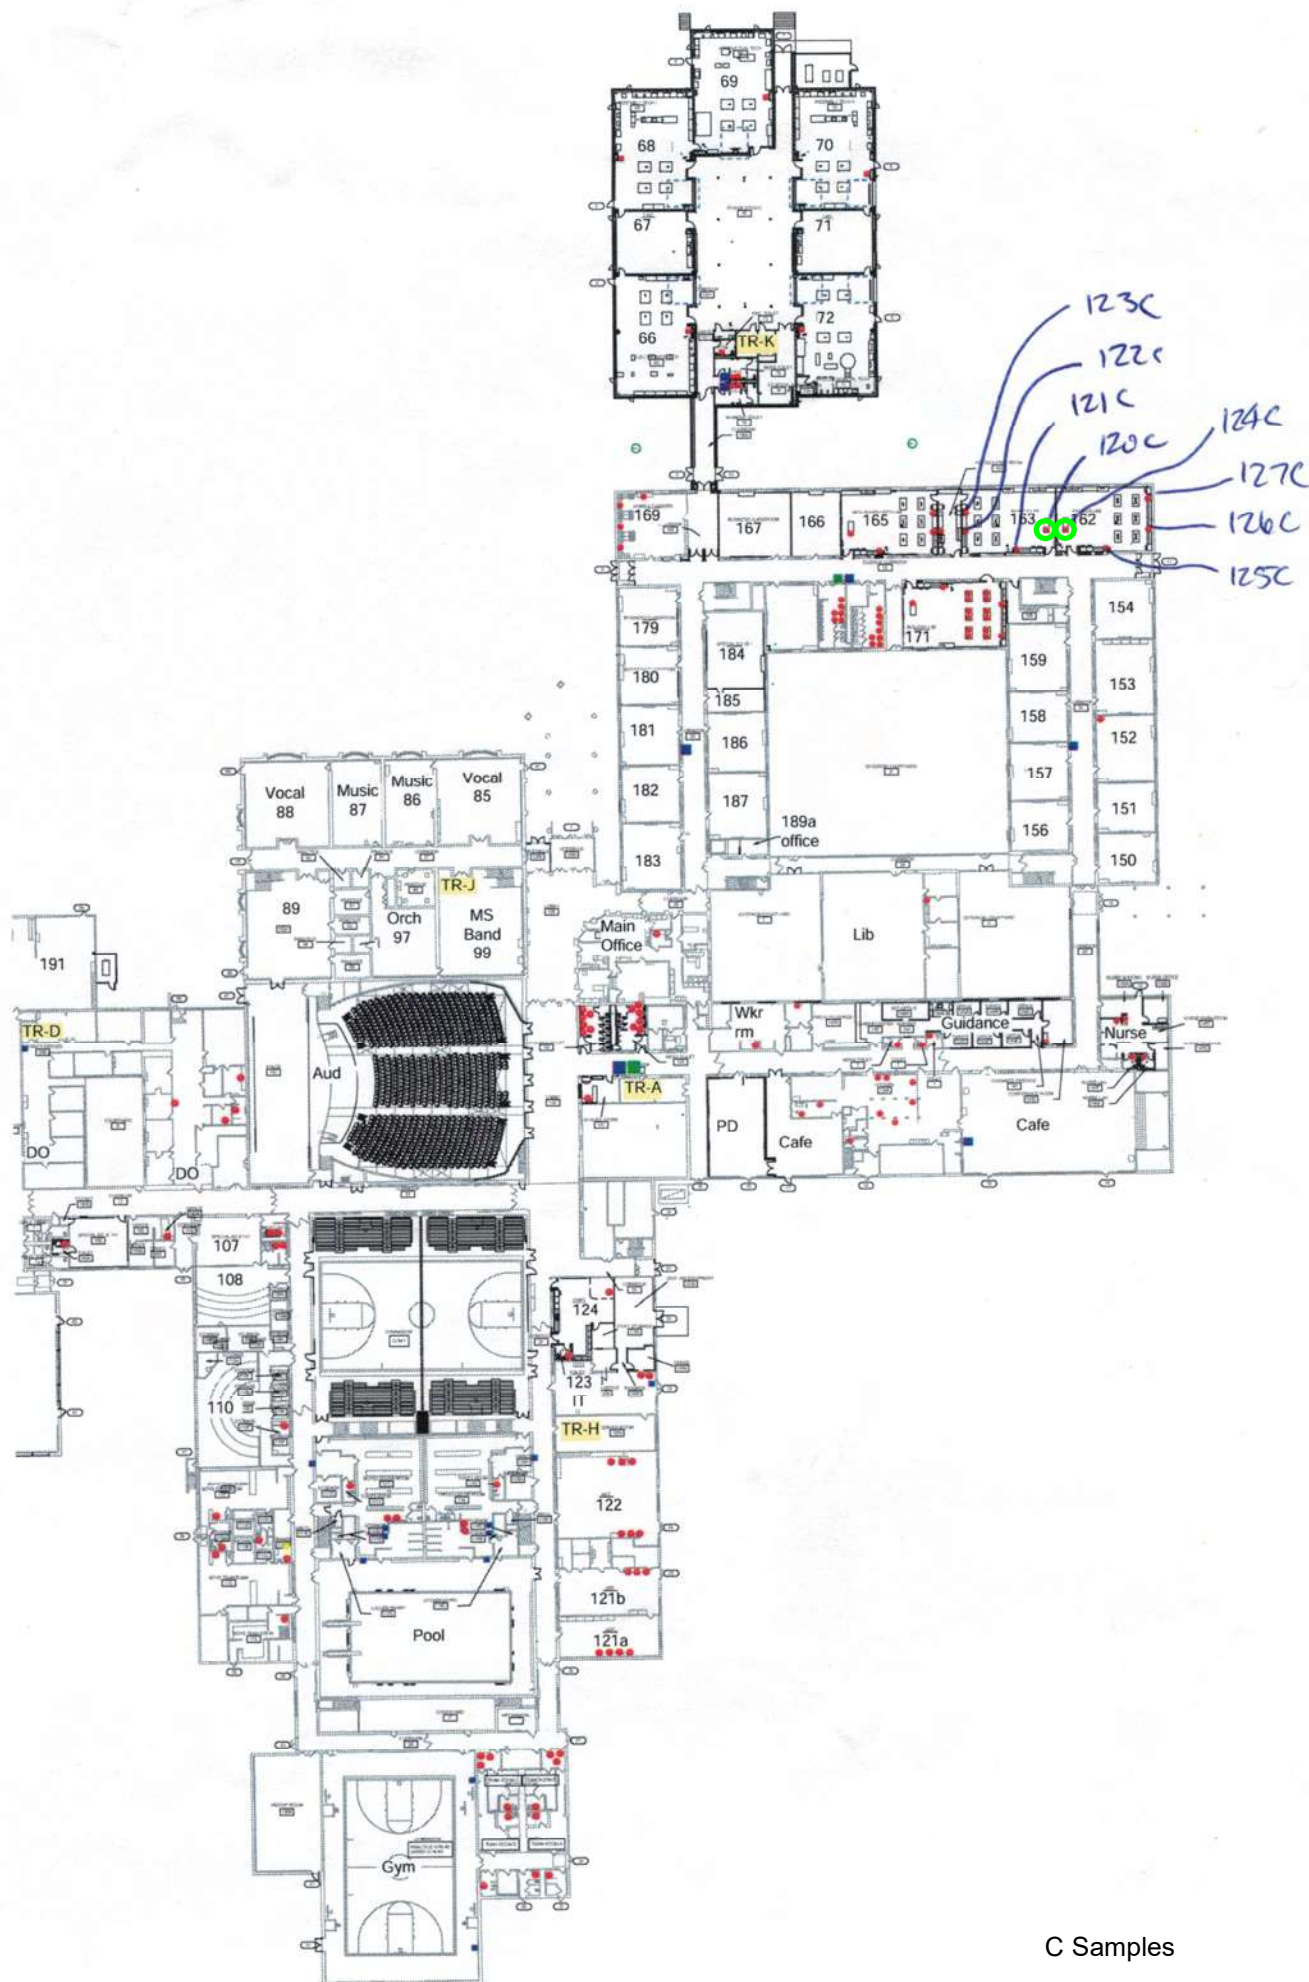

Photos of Samples Exceeding 15 ppb



12A-GIH-Pool-WF2




36A-GIH-113-BTLR-Spicket

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016





41A-GIH-112-BTL-S1



42A-GIH-112-BTL-S3

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016





43A-GIH-110-Office A- S1




70A-GIH-152-S1

Site Photographs


Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016





70B-GIH-171-S4

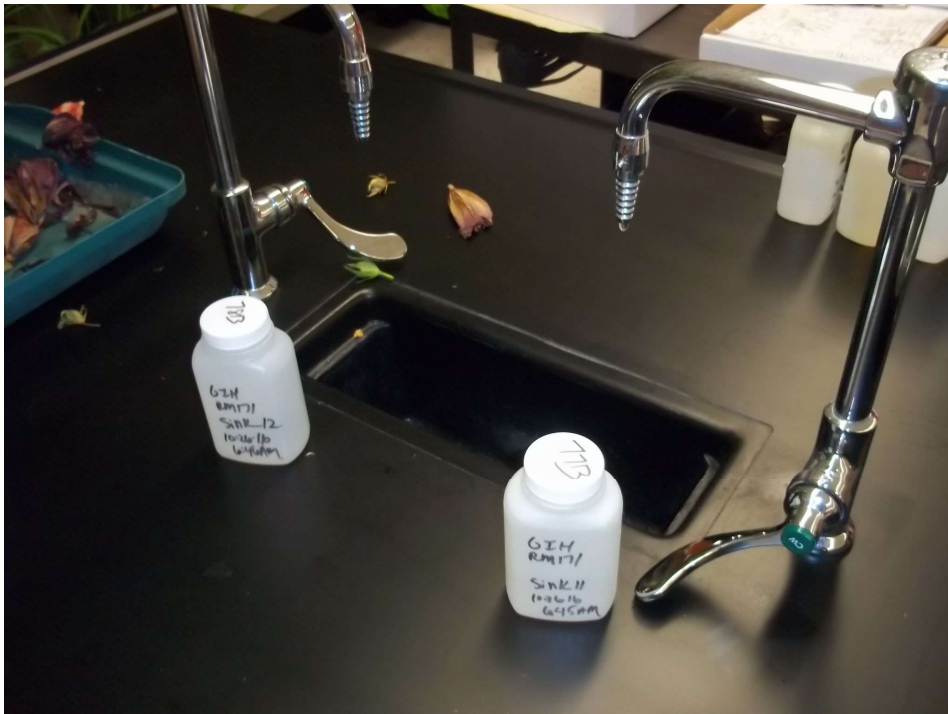


78B-GIH-171-S12

Site Photographs


Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016





35C-GIH-213-S15

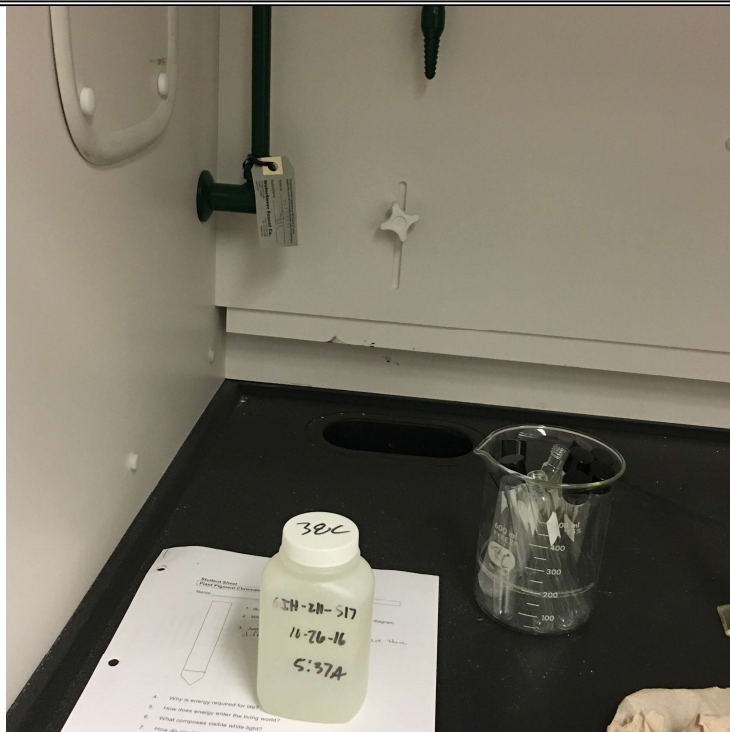


38C-GIH-211-S17

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016





62C-GIH-214-S15


No Picture Available

79C-GIH-223-S15

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016





82C-GIH-223-S17




84C-GIH-223A-S1

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016





100C-GIH-216-S15





101C-GIH-216-S16

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016



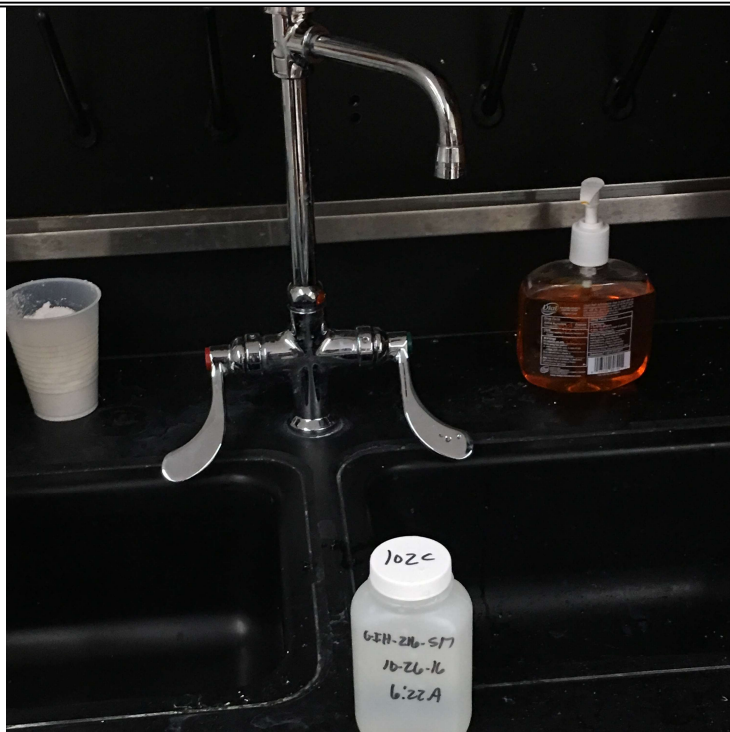

102C-GIH-216-S17




108C-GIH-217-S6

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016



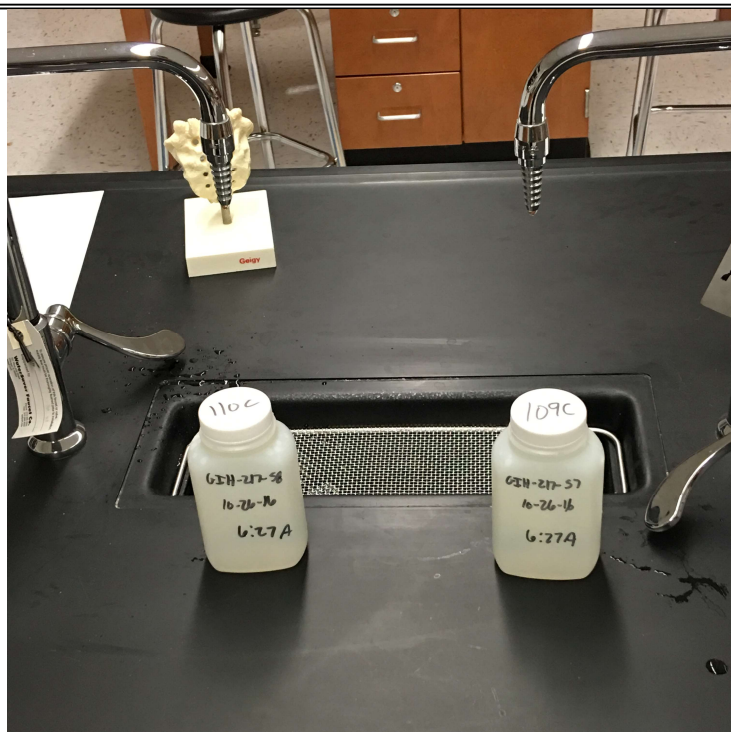

109C-GIH-217-S7





114C-GIH-217-S12

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016



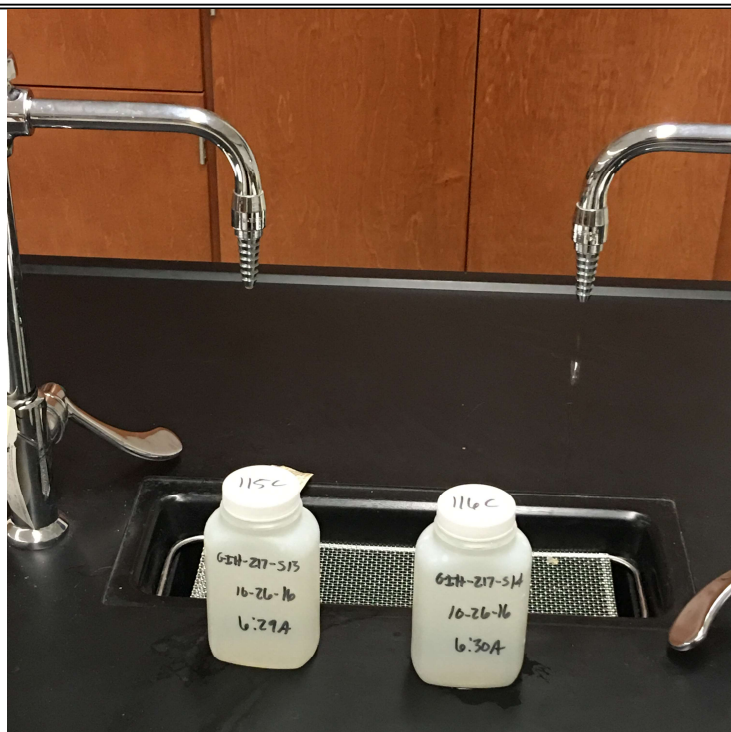

115C-GIH-217-S13





118C-GIH-217-S16

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016



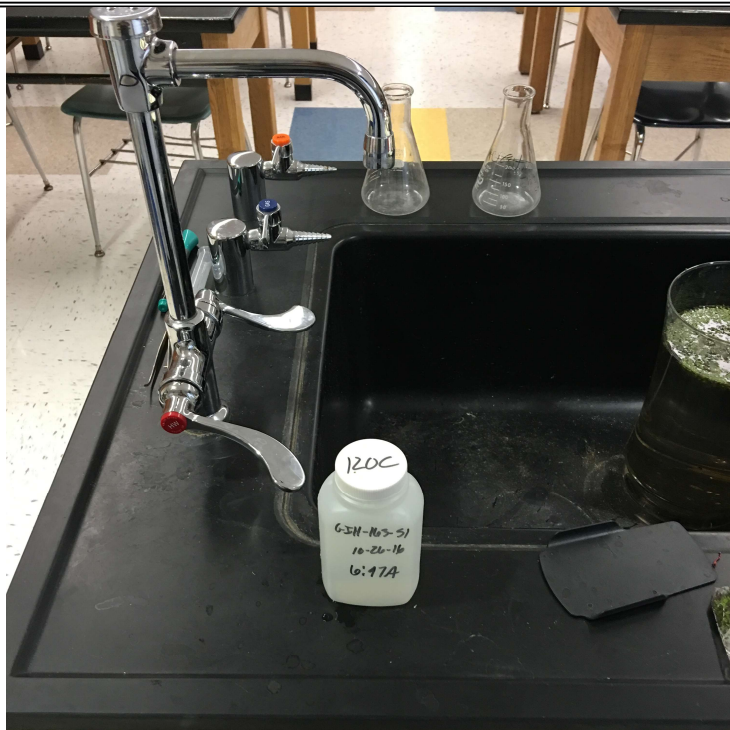

120C-GIH-163-S1



124C-GIH-162-S1

Site Photographs

Grand Island Central School District -
Grand Island Senior High School
1100 Ransom Road
Grand Island, NY 14072

Photographed:
October 26, 2016

