



ARCHITECTURE

T M P ARCHITECTURE INC
1191 WEST SQUARE LAKE ROAD · BLOOMFIELD HILLS · MICHIGAN · 48302
PH · 248.338.4561 FX · 248.338.0223 EM · INFO@TMP-ARCHITECTURE.COM

NEW SMITH MIDDLE SCHOOL
Troy School District - Troy, Michigan 48098

2022 BOND PROGRAM - BID BACKAGE 03B

Project Number 22102
CONSTRUCTION DOCUMENTS

CONSULTANTS:

CIVIL ENGINEER
PEA GROUP
1849 POND RUN
AUBURN HILLS, MICHIGAN 48326
PHONE: (248) 689-9090

STRUCTURAL ENGINEER
WILLIAM A. KIBBE & ASSOCIATES
1475 S. WASHINGTON AVE.
SAGINAW, MICHIGAN 48601
PHONE: (989) 752-5000 FAX: (512) 752-5002

MECHANICAL ENGINEER
PETER BASSO ASSOCIATES INC.
5145 LIVERNOIS ROAD, SUITE 100
TROY, MICHIGAN 48068-3276
PHONE: (248) 879-5666 FAX: (248) 879-0007

ELECTRICAL ENGINEER
PETER BASSO ASSOCIATES INC.
5145 LIVERNOIS ROAD, SUITE 100
TROY, MICHIGAN 48068-3276
PHONE: (248) 879-5666 FAX: (248) 879-0007

THEATRICAL CONSULTANT
GREAT LAKES THEATRICAL
3313 YELLOWSTONE DRIVE
ANN ARBOR, MI 48106
PHONE: (810) 813-4691

LIST OF DRAWINGS

GENERAL INFORMATION
TS.2-03B Cover Sheet Vol. 2 - Bid Package 03B
TG-1 General Information

MECHANICAL

- M0.1 MECHANICAL STANDARDS AND DRAWING INDEX
M1.1 FIRST LEVEL FIRE PROTECTION COMPOSITE PLAN
M1.2 SECOND LEVEL FIRE PROTECTION COMPOSITE PLAN
M2.0A UNDERGROUND PLUMBING PLAN - ZONE 'A'
M2.0B UNDERGROUND PLUMBING PLAN - ZONE 'B'
M2.0C UNDERGROUND PLUMBING PLAN - ZONE 'C'
M2.0D UNDERGROUND PLUMBING PLAN - ZONE 'D'
M2.0E UNDERGROUND PLUMBING PLAN - ZONE 'E'
M2.0F UNDERGROUND PLUMBING PLAN - ZONE 'F'
M2.1A FIRST LEVEL PLUMBING PLAN - ZONE 'A'
M2.1B FIRST LEVEL PLUMBING PLAN - ZONE 'B'
M2.1C FIRST LEVEL PLUMBING PLAN - ZONE 'C'
M2.1D FIRST LEVEL PLUMBING PLAN - ZONE 'D'
M2.1E FIRST LEVEL PLUMBING PLAN - ZONE 'E'
M2.1F FIRST LEVEL PLUMBING PLAN - ZONE 'F'
M2.2C MEZZANINE LEVEL PLUMBING PLAN - ZONE 'C'
M2.2D SECOND LEVEL PLUMBING PLAN - ZONE 'E'
M2.2E SECOND LEVEL PLUMBING PLAN - ZONE 'E'
M3.1A FIRST LEVEL HVAC PIPING PLAN - ZONE 'A'
M3.1B FIRST LEVEL HVAC PIPING PLAN - ZONE 'B'
M3.1C FIRST LEVEL HVAC PIPING PLAN - ZONE 'C'
M3.1D FIRST LEVEL HVAC PIPING PLAN - ZONE 'D'
M3.1E FIRST LEVEL HVAC PIPING PLAN - ZONE 'E'
M3.1F FIRST LEVEL HVAC PIPING PLAN - ZONE 'F'
M3.2C MEZZANINE LEVEL HVAC PIPING PLAN - ZONE 'C'
M3.2D SECOND LEVEL HVAC PIPING PLAN - ZONE 'E'
M3.2E SECOND LEVEL HVAC PIPING PLAN - ZONE 'E'
M4.1A FIRST LEVEL SHEET METAL PLAN - ZONE 'A'
M4.1B FIRST LEVEL SHEET METAL PLAN - ZONE 'B'
M4.1C FIRST LEVEL SHEET METAL PLAN - ZONE 'C'
M4.1D FIRST LEVEL SHEET METAL PLAN - ZONE 'D'
M4.1E FIRST LEVEL SHEET METAL PLAN - ZONE 'E'
M4.1F FIRST LEVEL SHEET METAL PLAN - ZONE 'F'
M4.2C MEZZANINE LEVEL SHEET METAL PLAN - ZONE 'C'

M4.2D

- SECOND LEVEL SHEET METAL PLAN - ZONE 'D'
M4.2E SECOND LEVEL SHEET METAL PLAN - ZONE 'E'
M5.1 ROOF MECHANICAL PLAN
M5.2 ENLARGED MECHANICAL PLANS
M6.1 MECHANICAL DETAILS
M6.2 MECHANICAL DETAILS
M6.3 MECHANICAL DETAILS
M6.4 MECHANICAL DETAILS
M6.5 MECHANICAL DETAILS
M6.6 MECHANICAL DETAILS
M7.1 MECHANICAL SCHEDULES
M7.2 MECHANICAL SCHEDULES
M7.3 MECHANICAL SCHEDULES
M7.4 MECHANICAL SCHEDULES
M7.5 MECHANICAL SCHEDULES
M7.6 MECHANICAL SCHEDULES
M7.7 MECHANICAL SCHEDULES
M8.1 TEMPERATURE CONTROL STANDARDS AND GENERAL NOTES
M8.2 TEMPERATURE CONTROLS
M8.3 TEMPERATURE CONTROLS
M8.4 TEMPERATURE CONTROLS
M8.5 TEMPERATURE CONTROLS
M8.6 TEMPERATURE CONTROLS
M8.7 TEMPERATURE CONTROLS
M8.8 TEMPERATURE CONTROLS
M8.9 TEMPERATURE CONTROLS
M8.10 TEMPERATURE CONTROLS
M8.11 TEMPERATURE CONTROLS

ELECTRICAL

E0.1

- ELECTRICAL STANDARDS AND DRAWING INDEX
E0.2 ELECTRICAL STANDARD SCHEDULES
E0.3 ELECTRICAL SITE NEW WORK PLAN
E0.4 FIRST LEVEL ELECTRICAL COMPOSITE PLAN
E0.5 SECOND LEVEL ELECTRICAL COMPOSITE PLAN
E0.6 ROOF LEVEL ELECTRICAL COMPOSITE PLAN
E2.1A FIRST LEVEL LIGHTING PLAN - ZONE 'A'
E2.1B FIRST LEVEL LIGHTING PLAN - ZONE 'B'
E2.1C FIRST LEVEL LIGHTING PLAN - ZONE 'C'
E2.1D FIRST LEVEL LIGHTING PLAN - ZONE 'D'
E2.1E FIRST LEVEL LIGHTING PLAN - ZONE 'E'
E2.1F FIRST LEVEL LIGHTING PLAN - ZONE 'F'
E2.2C MEZZANINE LEVEL LIGHTING PLAN - ZONE 'C'
E2.2D SECOND LEVEL LIGHTING PLAN - ZONE 'D'
E2.2E SECOND LEVEL LIGHTING PLAN - ZONE 'E'
E3.1A FIRST LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'A'
E3.1B FIRST LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'B'
E3.1C FIRST LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'C'
E3.1D FIRST LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'D'
E3.1E FIRST LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'E'
E3.1F FIRST LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'F'
E3.2C MEZZANINE LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'C'
E3.2D SECOND LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'D'
E3.2E SECOND LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'E'
E5.1 ONE LINE DIAGRAM
E5.2 PANEL SCHEDULES
E5.3 PANEL SCHEDULES
E5.4 PANEL SCHEDULES
E5.5 PANEL SCHEDULES
E6.1 ENLARGED ELECTRICAL PLAN
E6.2 ENLARGED ELECTRICAL PLAN
E7.1 ELECTRICAL DETAILS AND DIAGRAMS
E7.2 ELECTRICAL DETAILS AND DIAGRAMS


E7.3

- ELECTRICAL DETAILS AND DIAGRAMS
E7.4 ELECTRICAL DETAILS AND DIAGRAMS
E7.5 ELECTRICAL DETAILS AND DIAGRAMS
E7.6 ELECTRICAL DETAILS AND DIAGRAMS
E7.7 ELECTRICAL DETAILS AND DIAGRAMS

THEATRICAL

- TE1.1 Theatrical Electrical Location Plan View
TE1.2 Theatrical Electrical Location Section at Centerline and Details
TR1.1 Theatrical Rigging Plan View
TR1.2 Theatrical Rigging Section View at Centerline and Details

PROJECT DATA:
LOCATION MAP:

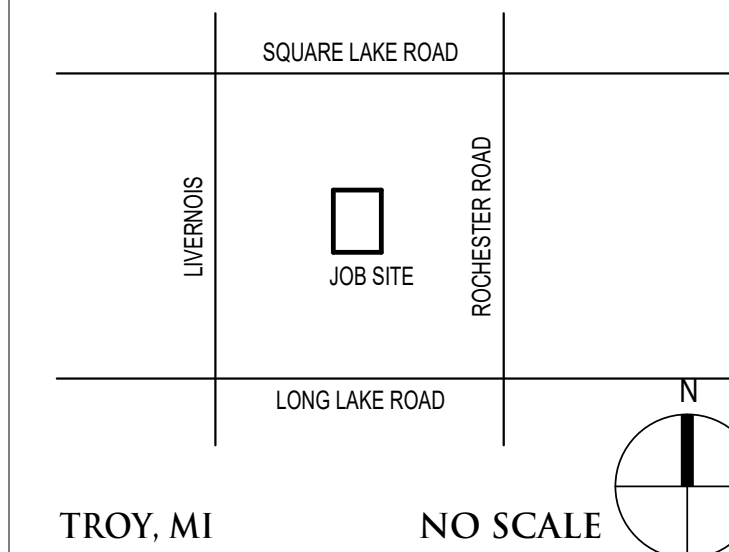

TROY, MI

NO SCALE

ADDRESS: NEW SMITH MIDDLE SCHOOL
5850 Livernois Road
Troy, Michigan 48098

BUILDING:

BUILDING AREA(S) = 103,803 SF (FIRST LEVEL)
810 SF (MEZZANINE)
21,312 SF (SECOND LEVEL)
125,725 SF (TOTAL)

CODE:

GOVERNING CODES:

- 2016 SCHOOL FIRE SAFETY RULES (2012 Life Safety Code, plus amendments)
2015 MICHIGAN BUILDING CODE
2021 MICHIGAN PLUMBING CODE
2015 MICHIGAN ENERGY CODE (ANSI/ASHRAE/IESNA Standard 90.1-2013)
2022 MICHIGAN ELECTRICAL CODE (ASME A17.1-2010, ASME A18.1-2011)
MICHIGAN BARRIER FREE CODE (Michigan Building Code 2015 and ICC A117.1-2009)
2013 MICHIGAN BOILER CODE RULES (ASME Boiler and Pressure Vessel Code, 2019 edition) (National Board Inspection Code (NBIC), 2019 edition)

USE GROUP CLASSIFICATION: "E" EDUCATION

CONSTRUCTION TYPE: TYPE II (000) LSC
TYPE II-B (MBC)

ISSUE DATES

Table with 2 columns: Issue Date, Description

06-18-2024 CONSTRUCTION DOCUMENTS

DATE: ISSUED FOR:

LICENSEE'S STATEMENT:

This Document has been prepared under the supervision of the Architect, as the person in Responsible Charge with the firm of TMP ARCHITECTURE, INC. An original embossed or rubber stamp seal and original signature of the Architect is required and shall be affixed to any copy of this Document submitted to a governmental agency for approval or record. This is in conformance with the State of Michigan's PA 299, Article 20 and the General Rules of the Board of Architects.

The Architect's seal provided hereon does not take responsibility for certain portions of the Documentation or project requiring the services of a licensed Professional Engineer or other design professional. An original embossed or rubber stamp seal and original signature of the Professional Engineer is required and shall be affixed to any copy of this or other Document submitted to a governmental agency for approval or record. The engineering firms associated with this document are listed above as Consultants.

REGISTRATION SEALS

COPYRIGHT

The "architectural work" displayed on these documents is owned exclusively by TMP Architecture, Inc. and may not be used for any purpose without their involvement or express written consent.

PROJECT TITLE
NEW SMITH MIDDLE SCHOOL

PROJECT NO.
22102
DRAWING NO.
TS.2-03B

REGISTRATION SEAL

CONSULTANT



Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-5275
Tel: 248-679-5666
Fax: 248-679-0007
www.PeterBassoAssociates.com
PBA Project No. 2023054

PROJECT TITLE
**NEW SMITH
MIDDLE SCHOOL**
Bid Package No. 03B

Troy School District
Troy, Michigan

DRAWING TITLE
MECHANICAL DETAILS

ISSUE DATES

06-18-2024 CONSTRUCTION DOCUMENTS

DATE ISSUED FOR:

DRAWN JRB

CHECKED KLH


APPROVED SVM

PROJECT NO.

22102


DRAWING NO.

M6.2

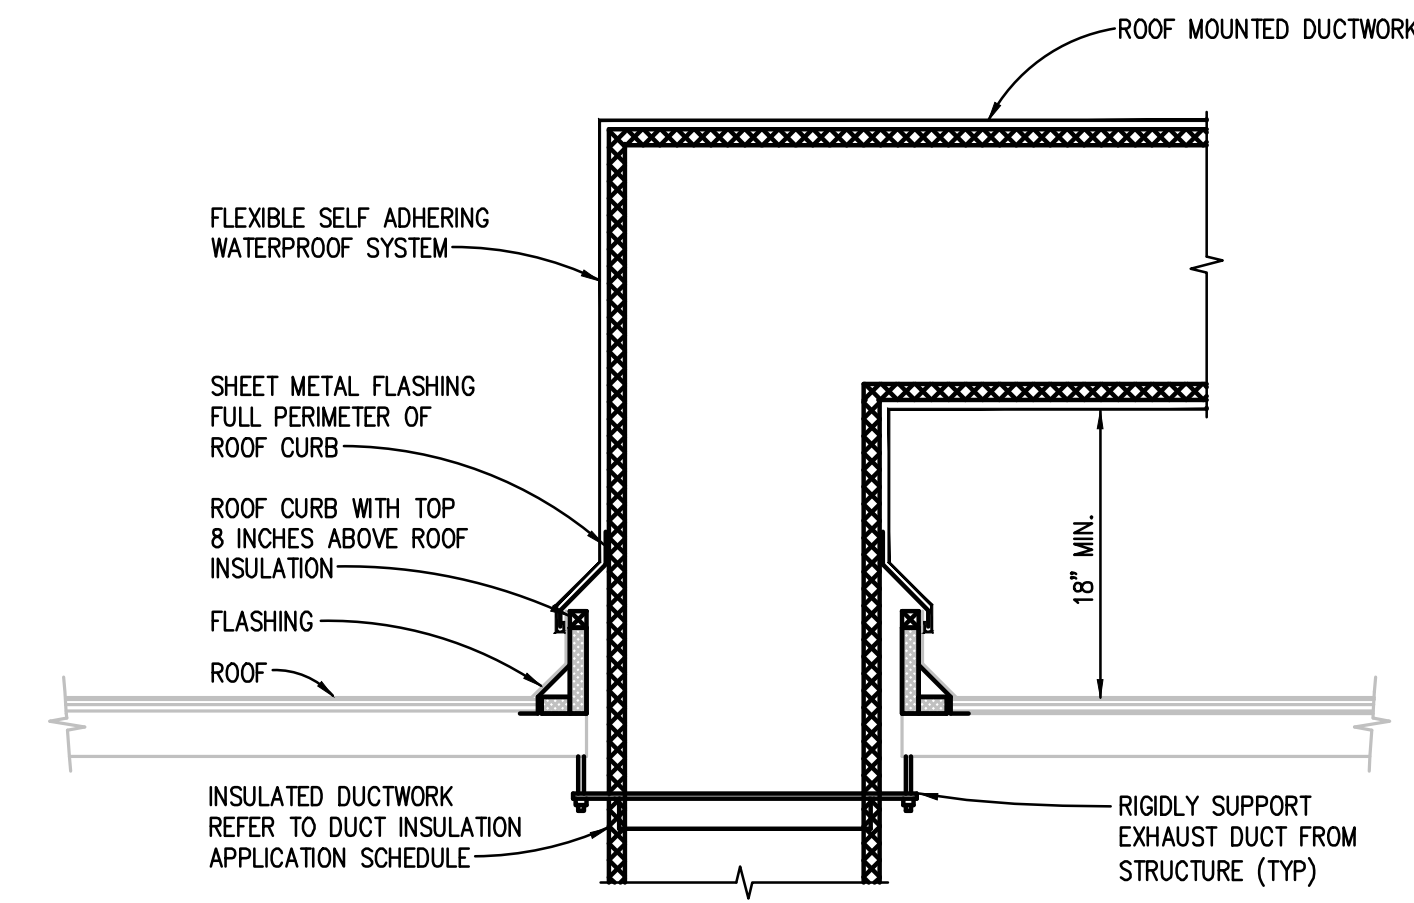

DUCT PENETRATION THROUGH ROOF DETAIL


NO SCALE

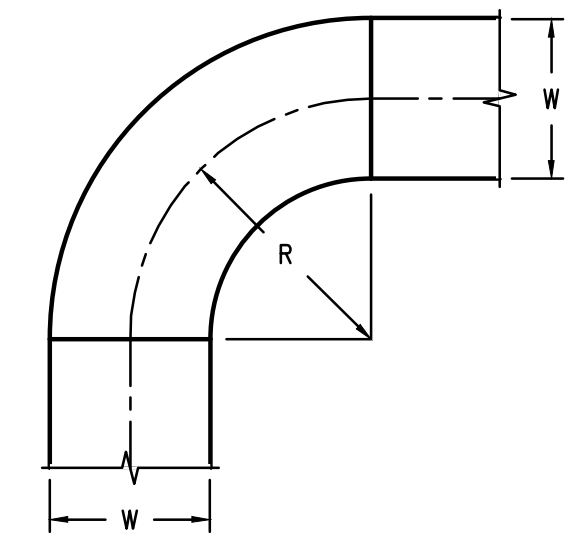

NOTES:


- R/W = 1.0 FOR VELOCITIES <= 2,000 FPM UNLESS OTHERWISE INDICATED, R/W = 1.5 FOR VELOCITIES > 2,000 FPM UNLESS OTHERWISE INDICATED.
- ALL CHANGES IN DIRECTION SHALL BE SMOOTH RADIUS ELBOW UNLESS OTHERWISE INDICATED.
- THIS DETAIL APPLIES TO CHANGES IN DIRECTION FOR ALL ANGLES.

SMOOTH RADIUS ELBOW DETAIL

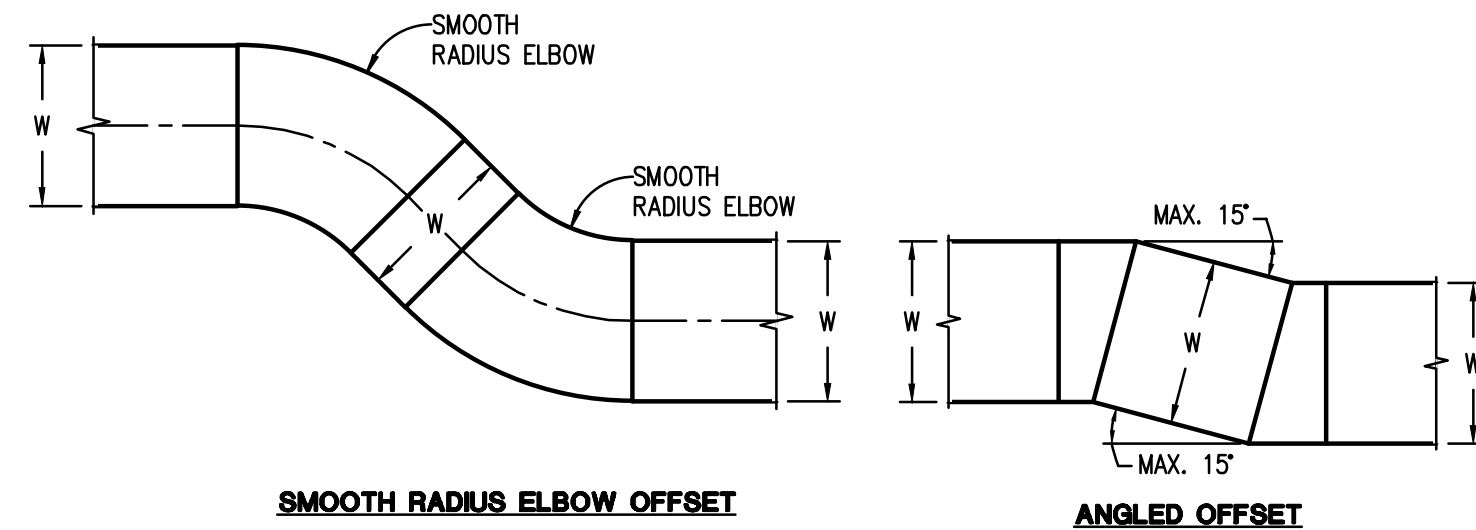


SMOOTH RADIUS ELBOW OFFSET

ANGLED OFFSET

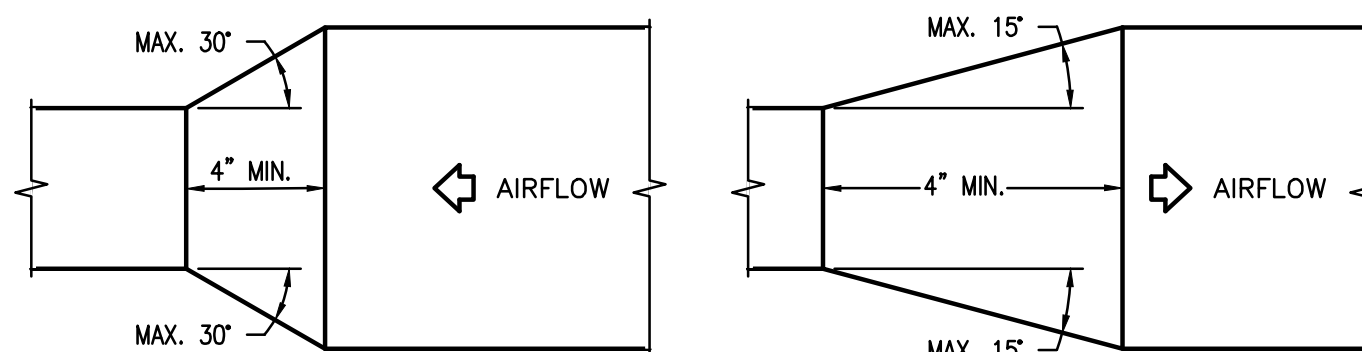

CONCENTRIC CONVERGING TRANSITION

CONCENTRIC DIVERGING TRANSITION

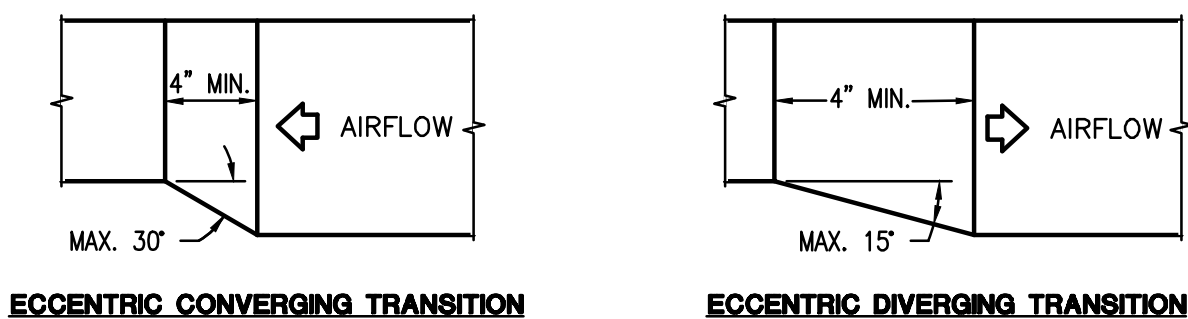

ECCENTRIC CONVERGING TRANSITION


ECCENTRIC DIVERGING TRANSITION

DUCT TRANSITION AND OFFSET DETAILS

NO SCALE


TYPE OF SYSTEM	S.P. AT DRAIN PAN (IN.) (NOTE A)	DIMENSION "A" (INCHES) MIN.	DIMENSION "B" (INCHES)	DIMENSION "C" (INCHES) (TRAP SEAL)	DIMENSION "D" (INCHES)	DIMENSION "E" (INCHES)	DIMENSION "F" (INCHES)			
							DRAIN PIPE SIZE (INCHES)			
							1 1/2	2	2 1/2	3
DRAW THROUGH	-2.1 TO -3	3.5	3.5	2	3	2	10.0	11.0	12.0	13.0
	UP TO -2	3.0	3.0	2	2	2	9.0	10.0	11.0	12.0
BLOW THROUGH	UP TO +2	4.0	2.0	2	2	4	9.0	10.0	11.0	12.0
	+2.1 TO +3	5.0	2.0	2	3	5	10.0	11.0	12.0	13.0

- NOTES:
- REFER TO EQUIPMENT SCHEDULES FOR (-) OR (+) STATIC PRESSURE AT DRAIN PAN.
 - BASE TRAP DIMENSIONS ON - S.P. FOR DRAW THROUGH UNITS AND + S.P. FOR BLOW THROUGH UNITS.
 - DRAIN PIPE SIZE SHALL BE SIZE OF DRAIN PAN OUTLET, MINIMUM 1".
 - DIMENSION "C" IS MIN: 3" FOR UP TO 1 1/2" DRAIN PIPE
4" FOR 2" DRAIN PIPE
5" FOR 2 1/2" OR 3" DRAIN PIPE
6" FOR 4" DRAIN PIPE

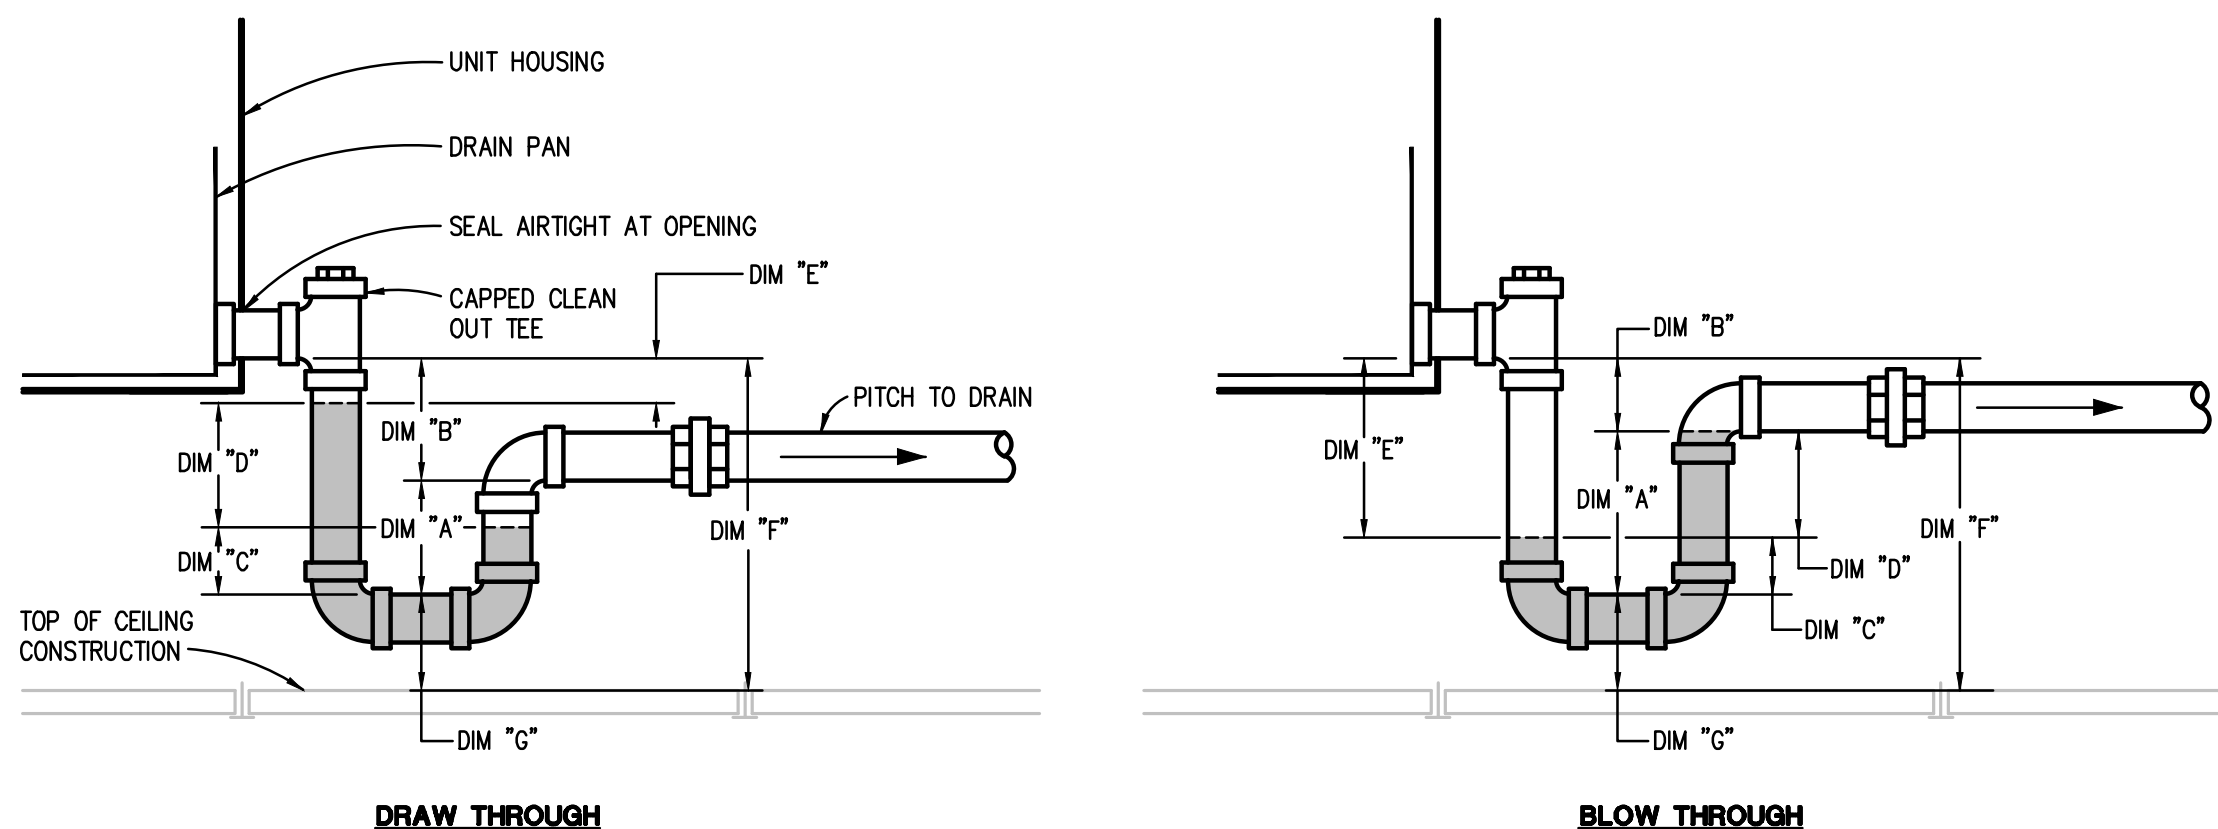


CONDENSATE DRAIN PAN TRAP DETAIL (UNITARY UNITS ABOVE CEILING)

NO SCALE

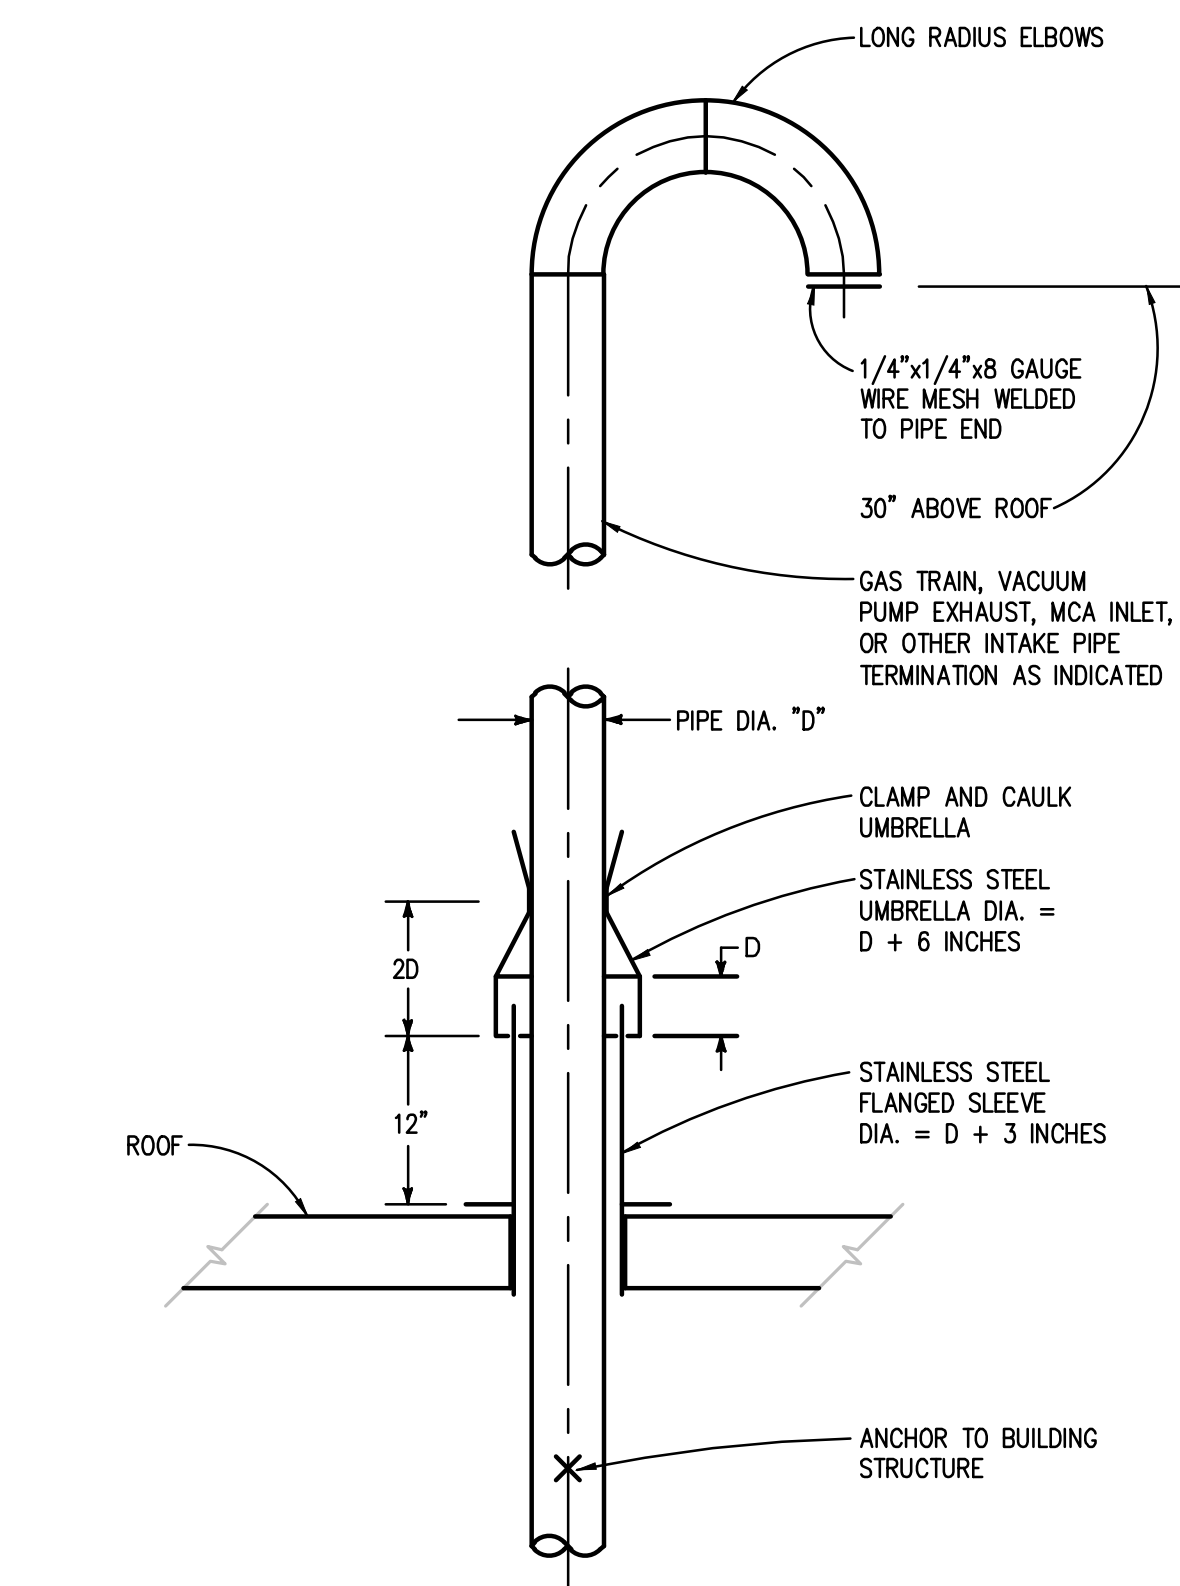


VENT / INTAKE PIPE TERMINATION DETAIL

NO SCALE

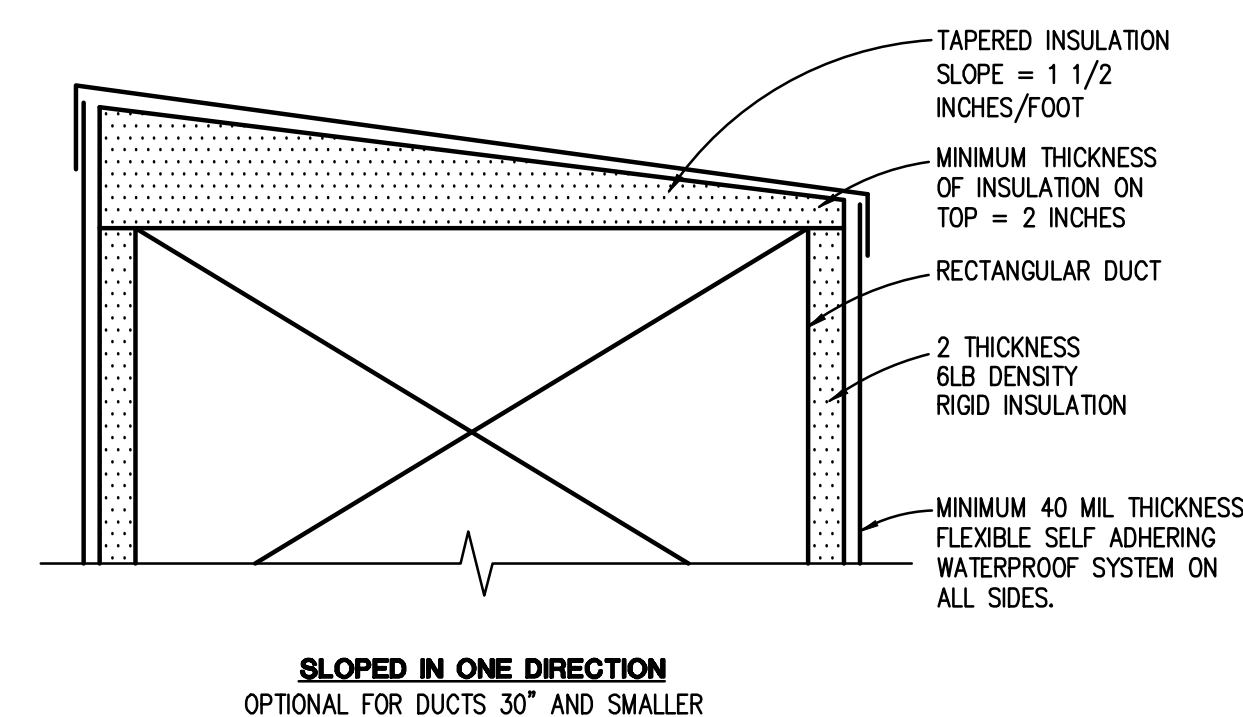

SLOPED IN ONE DIRECTION


OPTIONAL FOR DUCTS 30" AND SMALLER

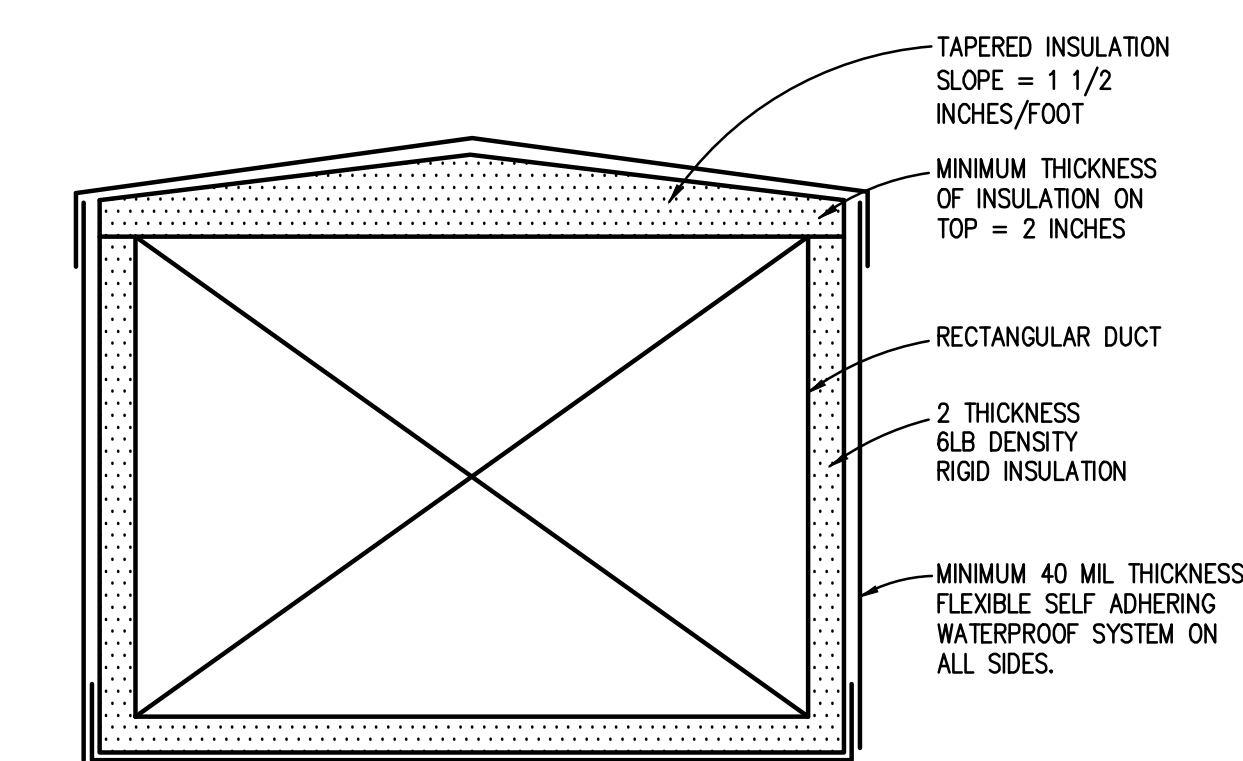


SLOPED IN TWO DIRECTIONS

OUTDOOR DUCT INSULATION DETAIL


NO SCALE

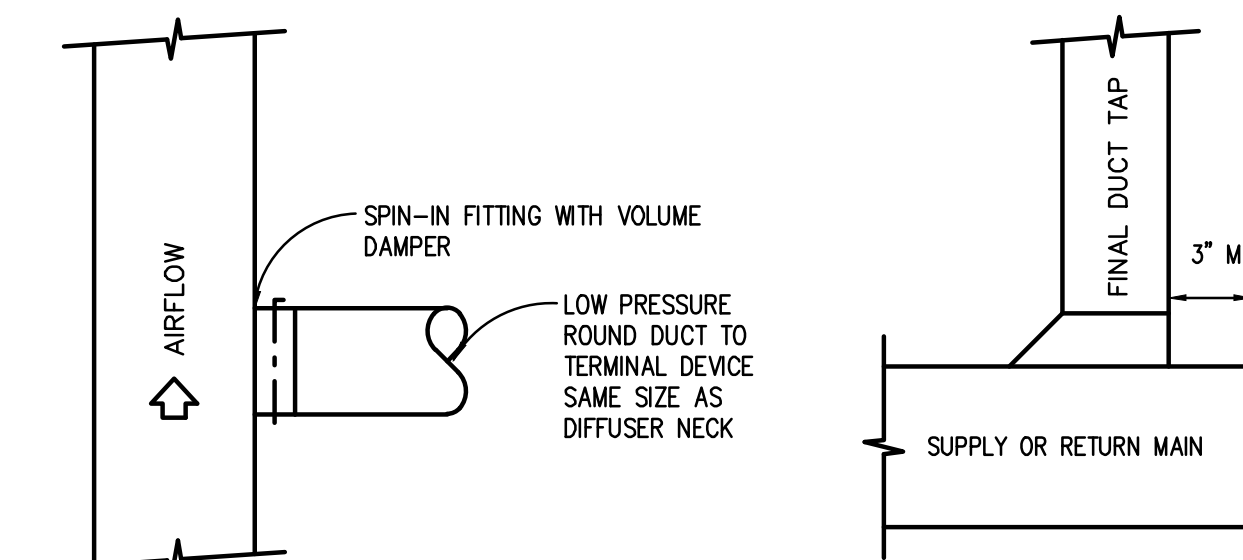


LOW PRESSURE INLET/OUTLET TO/FROM DIFFUSER, REGISTER OR GRILLE

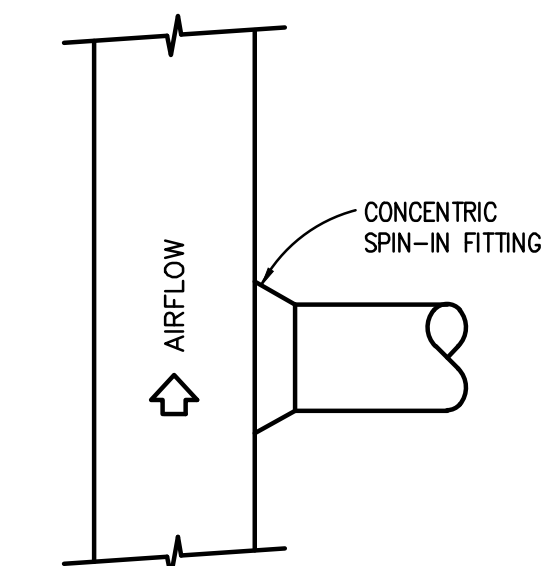


RECTANGULAR TO ROUND DUCT

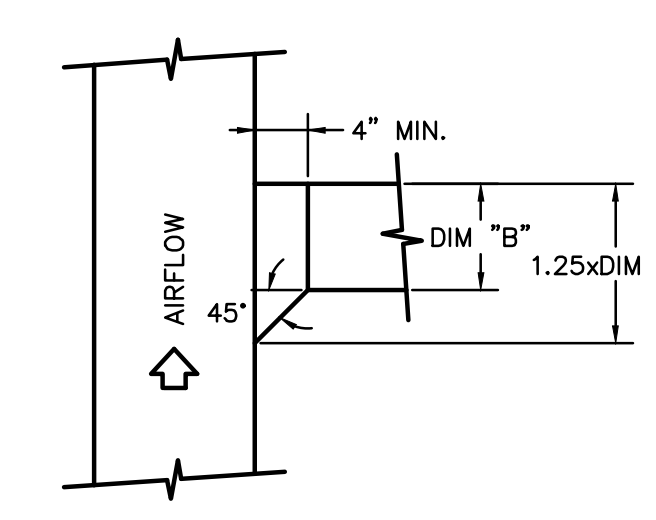


SUPPLY DUCT

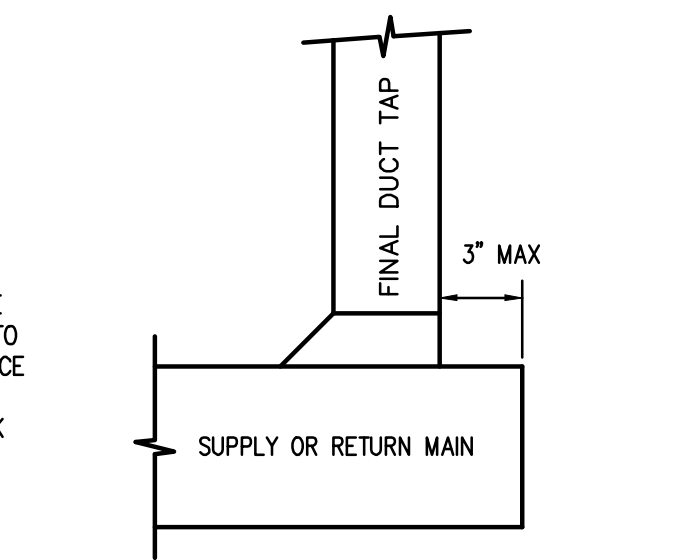

LOW PRESSURE END OF RUN

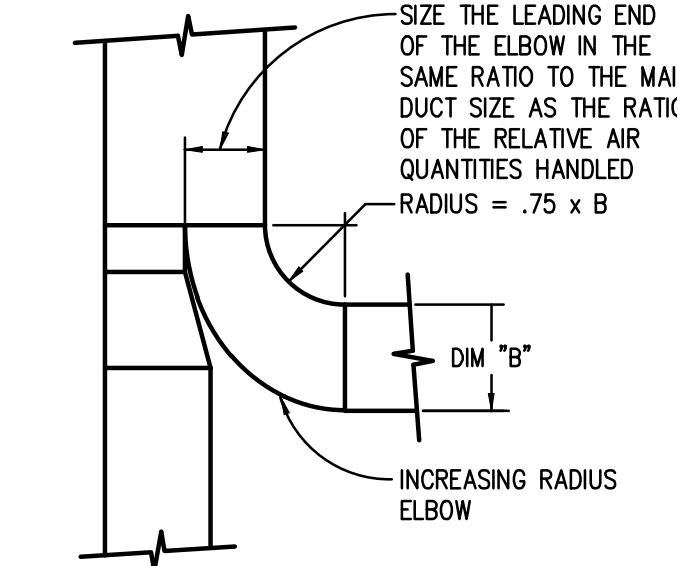

SUPPLY, RETURN OR EXHAUST DUCT

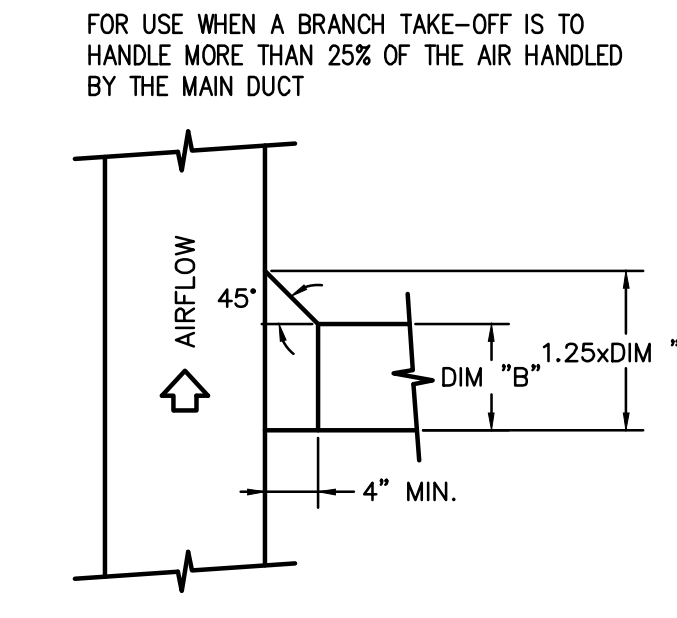


RETURN OR EXHAUST DUCT

RECTANGULAR DUCT BRANCH TAKE-OFF DETAILS

NO SCALE

TYPE OF SYSTEM	S.P. AT DRAIN PAN (IN.) (NOTE A)	DIMENSION "A" (INCHES) MIN.	DIMENSION "B" (INCHES)	DIMENSION "C" (INCHES) (TRAP SEAL)	DIMENSION "D" (INCHES)	DIMENSION "E" (INCHES)	DIMENSION "F" (INCHES)			
							DRAIN PIPE SIZE (INCHES)			
							1 1/2	2	2 1/2	3
DRAW THROUGH	-5.1 TO -6	5.0	5.0	2	6	2	13.0	14.0	15.0	16.0
	-4.1 TO -5	4.5	4.5	2	5	2	12.0	13.0	14.0	15.0
	-3.1 TO -4	4.0	4.0	2	4	2	11.0	12.0	13.0	14.0
	-2.1 TO -3	3.5	3.5	2	3	2	10.0	11.0	12.0	13.0
	UP TO -2	3.0	3.0	2	2	2	9.0	10.0	11.0	12.0
BLOW THROUGH	UP TO +2	4.0	2.0	2	2	4	9.0	10.0	11.0	12.0
	+2.1 TO +3	5.0	2.0	2	3	5	10.0	11.0	12.0	13.0
	+3.1 TO +4	6.0	2.0	2	4	6	11.0	12.0	13.0	14.0
	+4.1 TO +5	7.0	2.0	2	5	7	12.0	13.0	14.0	15.0
	+5.1 TO +6	8.0	2.0	2	6	8	13.0	14.0	15.0	16.0

- NOTES:
- REFER TO ROOFTOP AIR HANDLING UNIT (COMMERCIAL, UNITARY, MODULAR) SCHEDULE FOR (-) OR (+) STATIC PRESSURE AT DRAIN PAN.
 - CONDENSATE DRAIN PAN TRAP PIPING SERVING ENERGY RECOVERY UNIT HEAT EXCHANGER AND HUMIDIFIER SECTIONS, WHERE LOCATED OUTDOORS, SHALL BE INSULATED AND HEAT TRACED.
 - DIMENSION "G" IS MIN: 3" FOR UP TO 1 1/2" DRAIN PIPE
4" FOR 2" DRAIN PIPE
5" FOR 2 1/2" OR 3" DRAIN PIPE
6" FOR 4" DRAIN PIPE
 - PROVIDE ROOF CURB WITH ADEQUATE HEIGHT TO MEET DIMENSION "F"

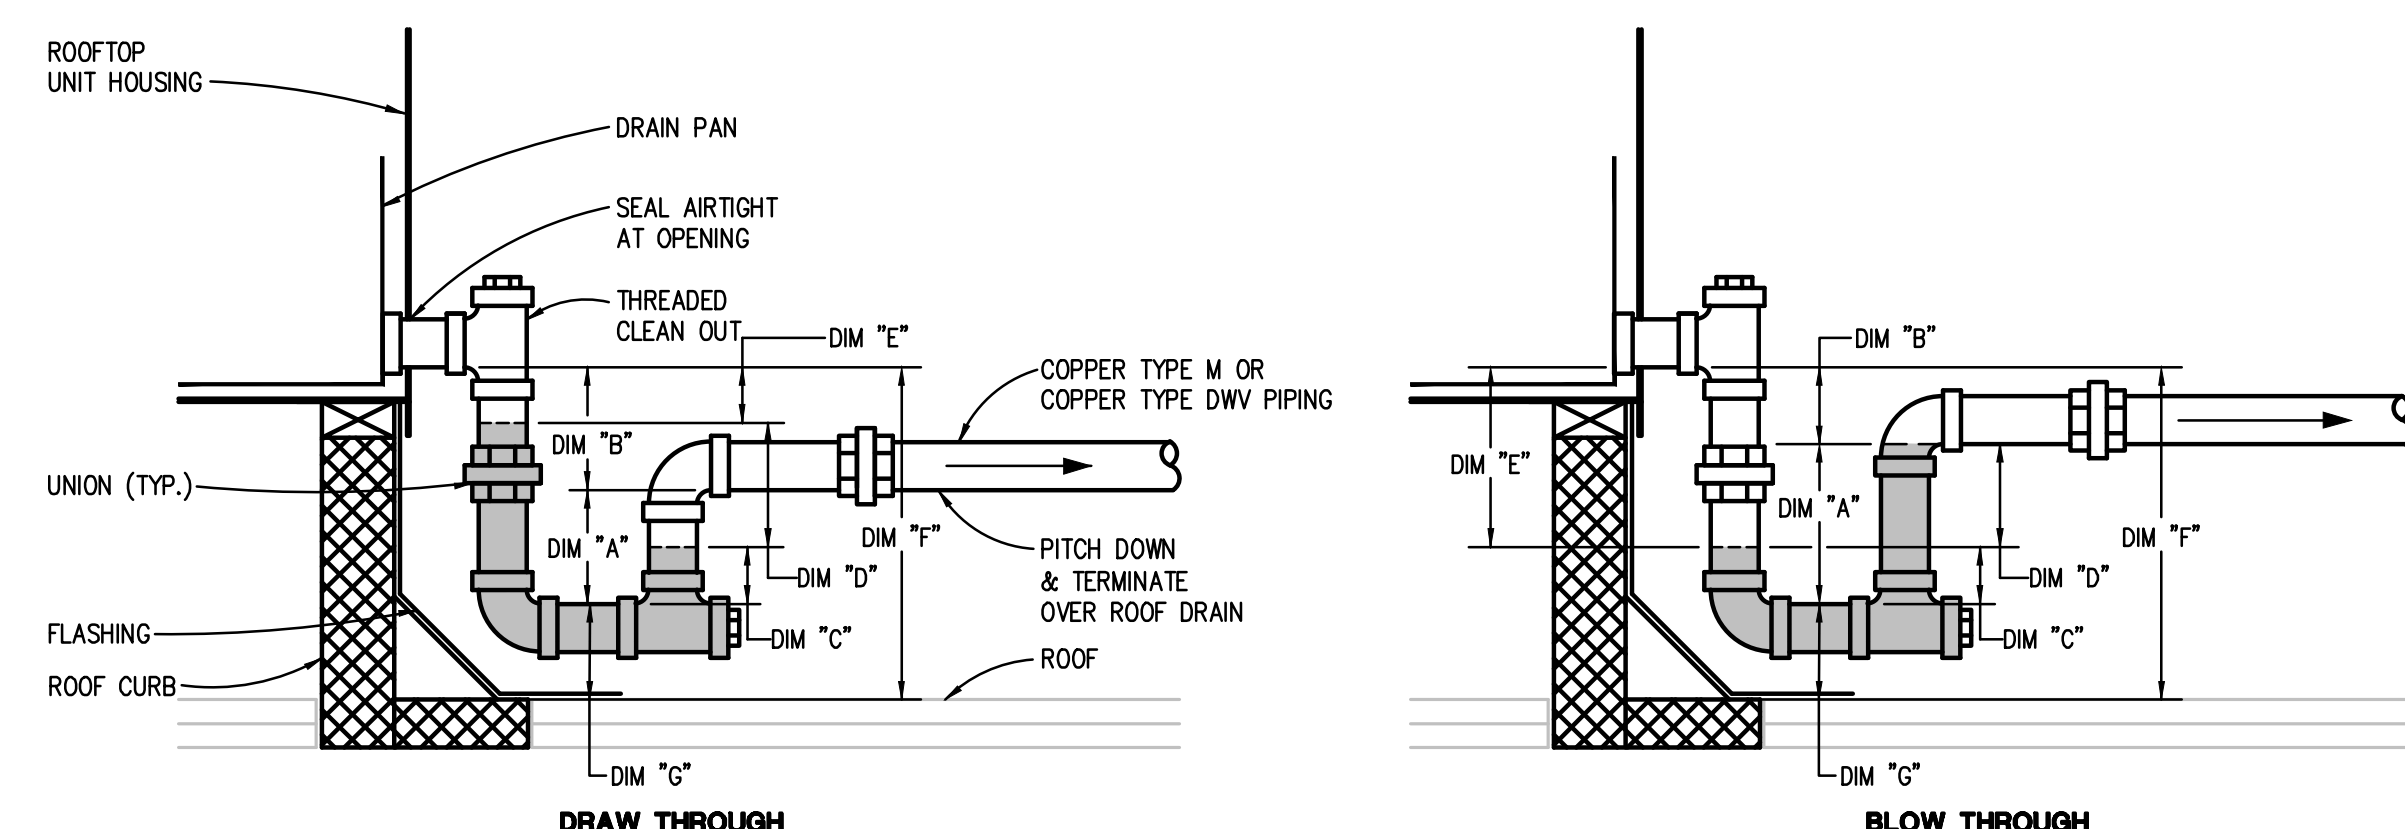

ROOFTOP AIR HANDLING/AIR CONDITIONING UNIT CONDENSATE DRAIN PAN TRAP DETAIL

NO SCALE



TMP ARCHITECTURE INC
1791 WEST SQUARE LAKE ROAD - BOX 289
BLOOMFIELD HILLS - MICHIGAN 48302
PH: 248-588-8041 FX: 248-588-0223
EM: INFO@TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-5275
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 20230354

PROJECT TITLE
**NEW SMITH
MIDDLE SCHOOL**
Bid Package No. 03B

Troy School District
Troy, Michigan

DRAWING TITLE
MECHANICAL DETAILS


ISSUE DATES

96-18-2024 CONSTRUCTION DOCUMENTS
DATE: ISSUED FOR:


DRAWN JRB
CHECKED KLH
APPROVED SVM

PROJECT NO.
22102


DRAWING NO.
M6.4

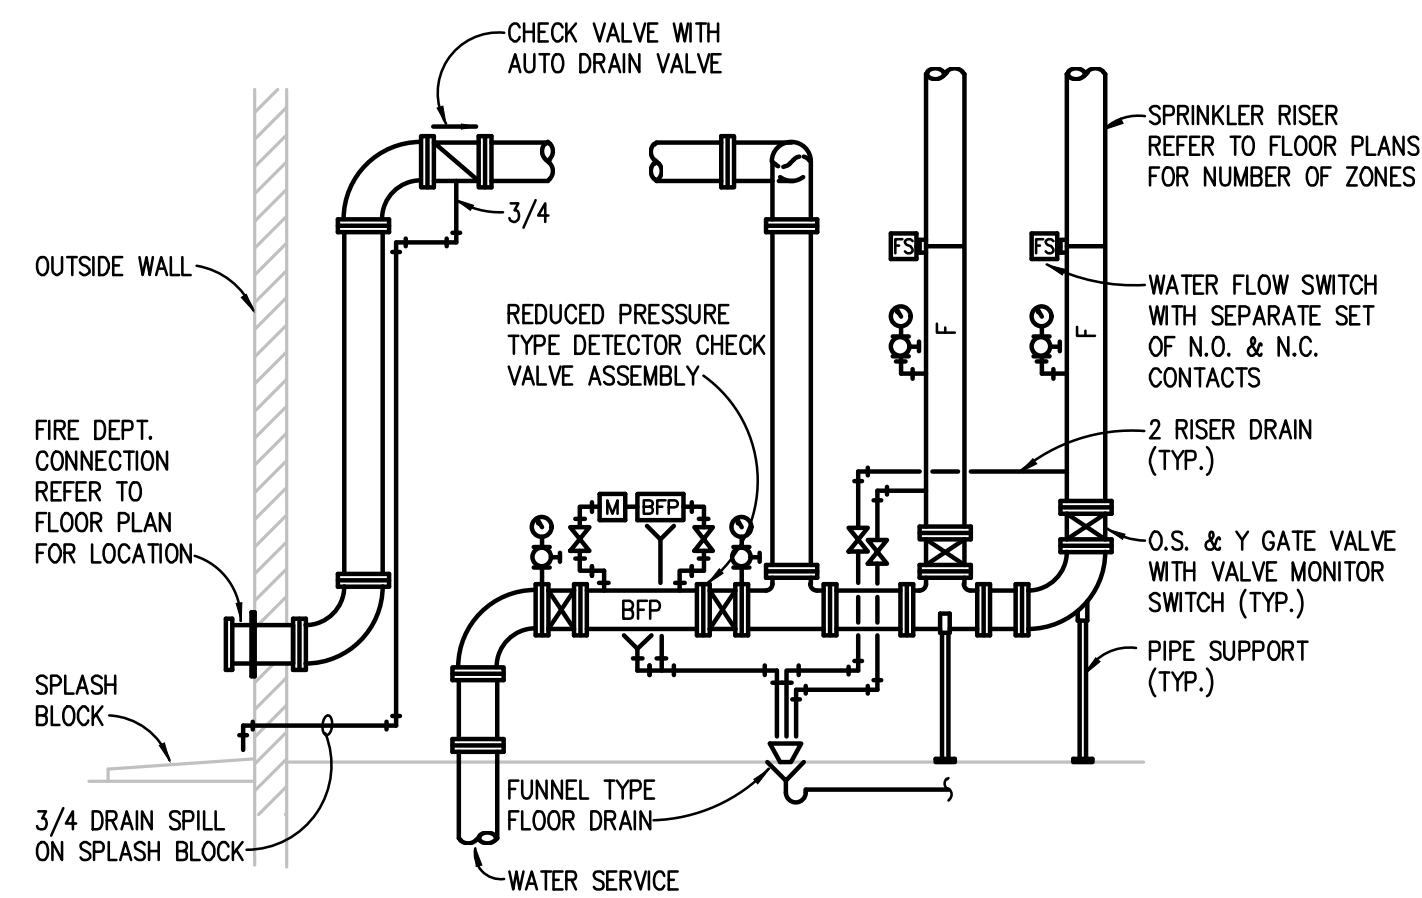


AUTOMATIC SPRINKLER RISER PIPING DIAGRAM
NO SCALE

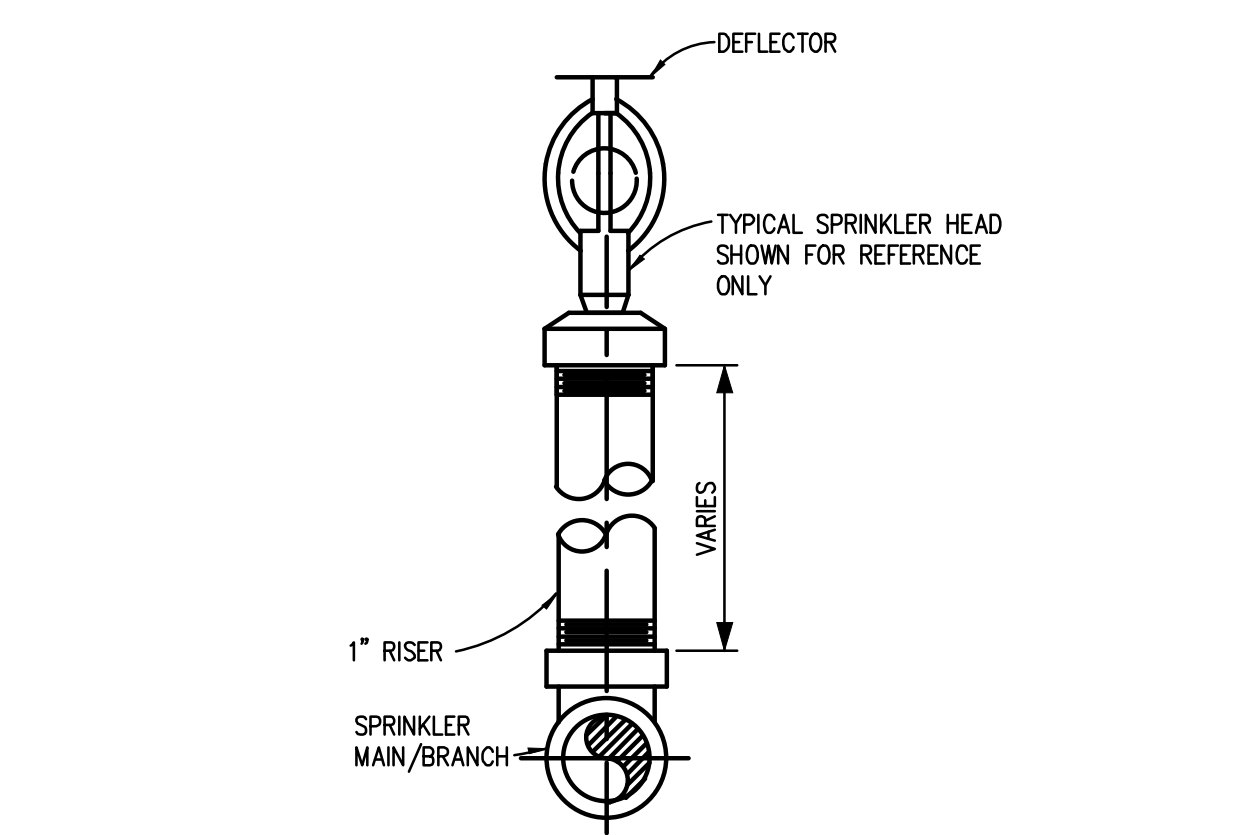


TYPICAL UPRIGHT SPRINKLER PIPING DETAIL
NO SCALE

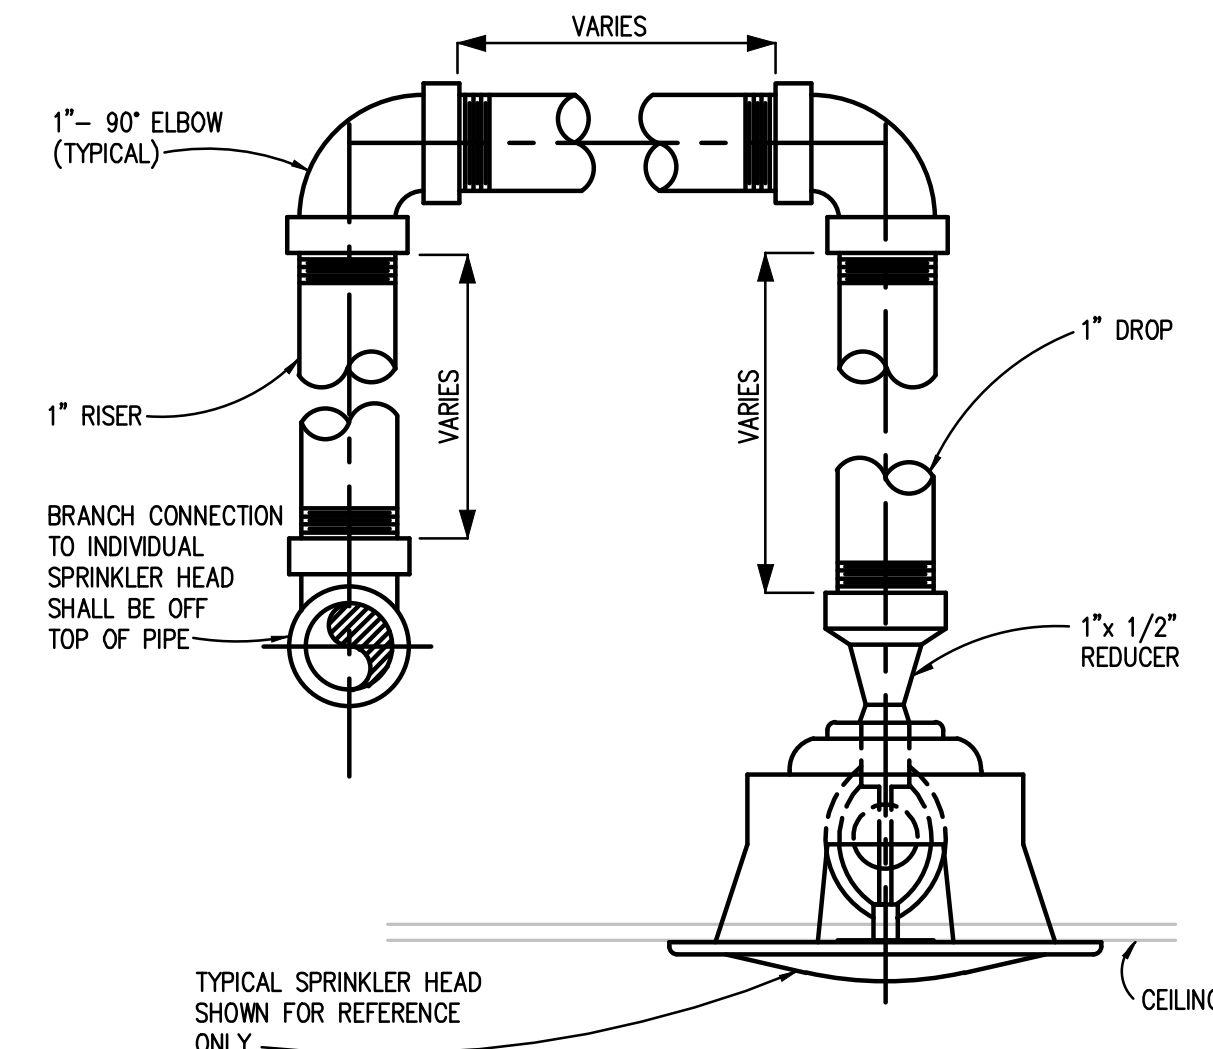


TYPICAL SPRINKLER PIPING DETAIL
NO SCALE

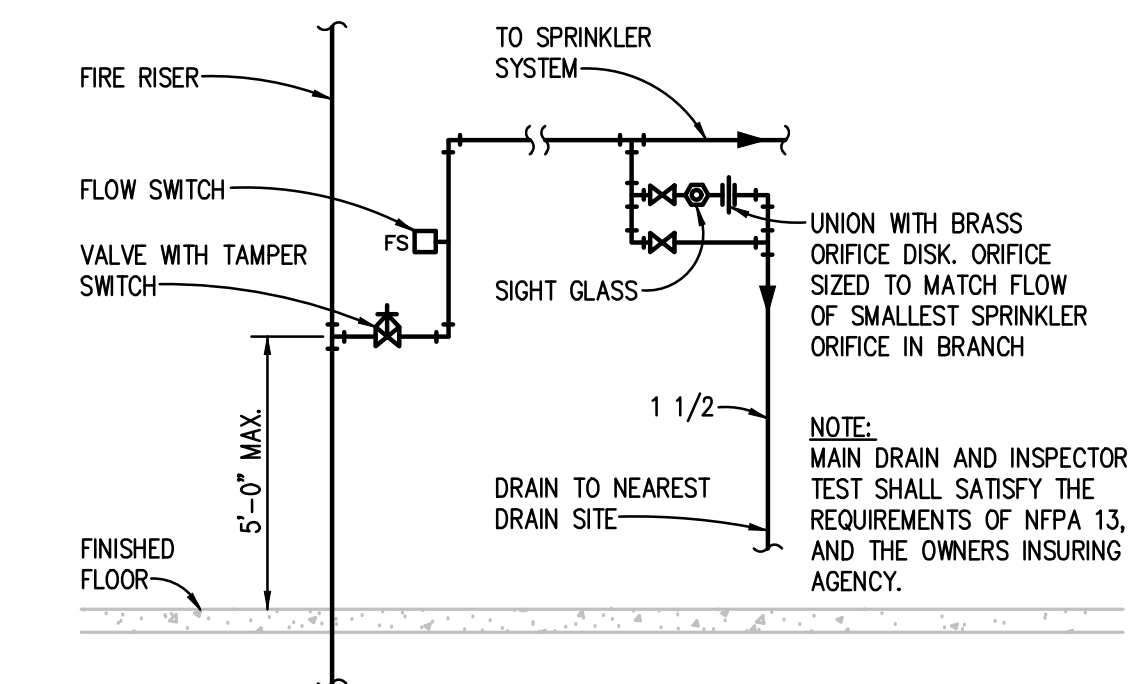


DRAIN/INSPECTORS TEST DETAIL
NO SCALE

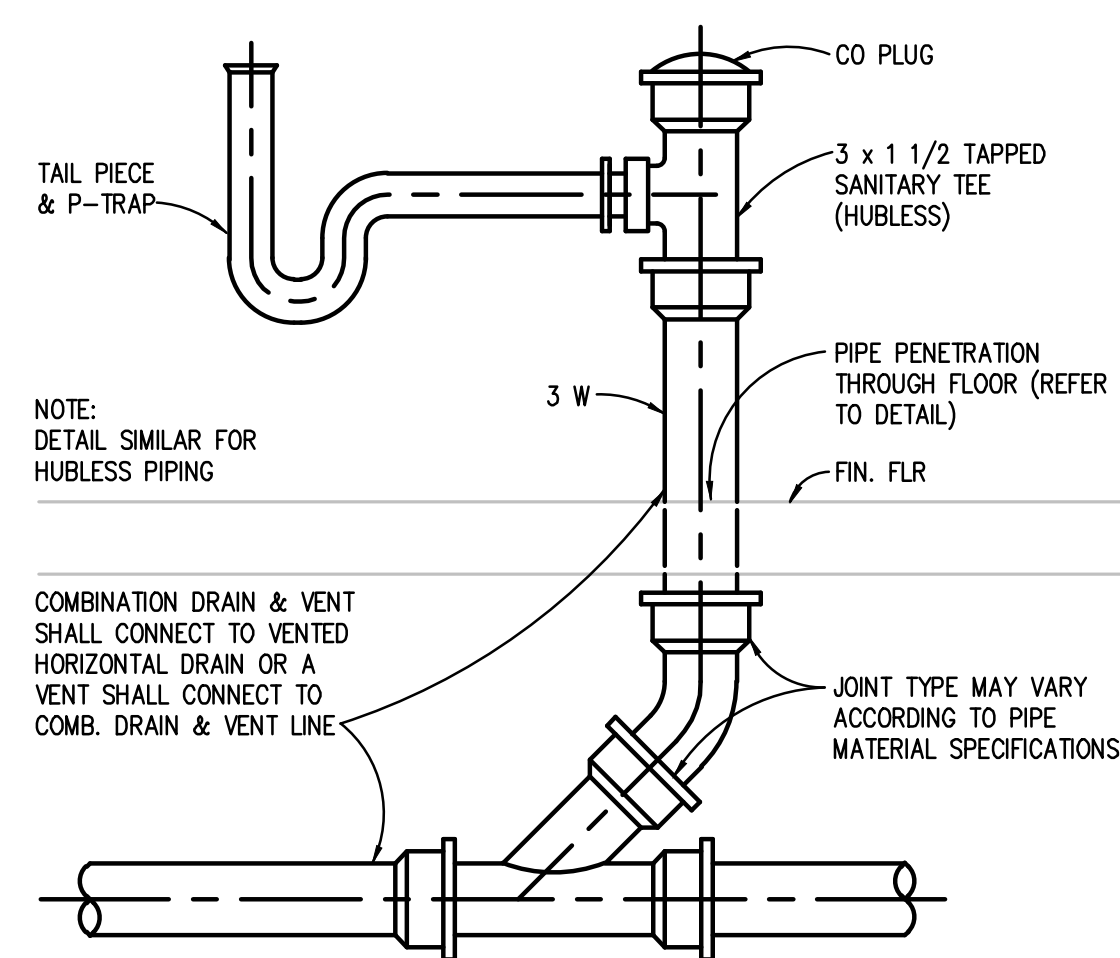



ISLAND SINK WASTE DETAIL FOR COMBINATION DRAIN & VENT SYSTEM
NO SCALE

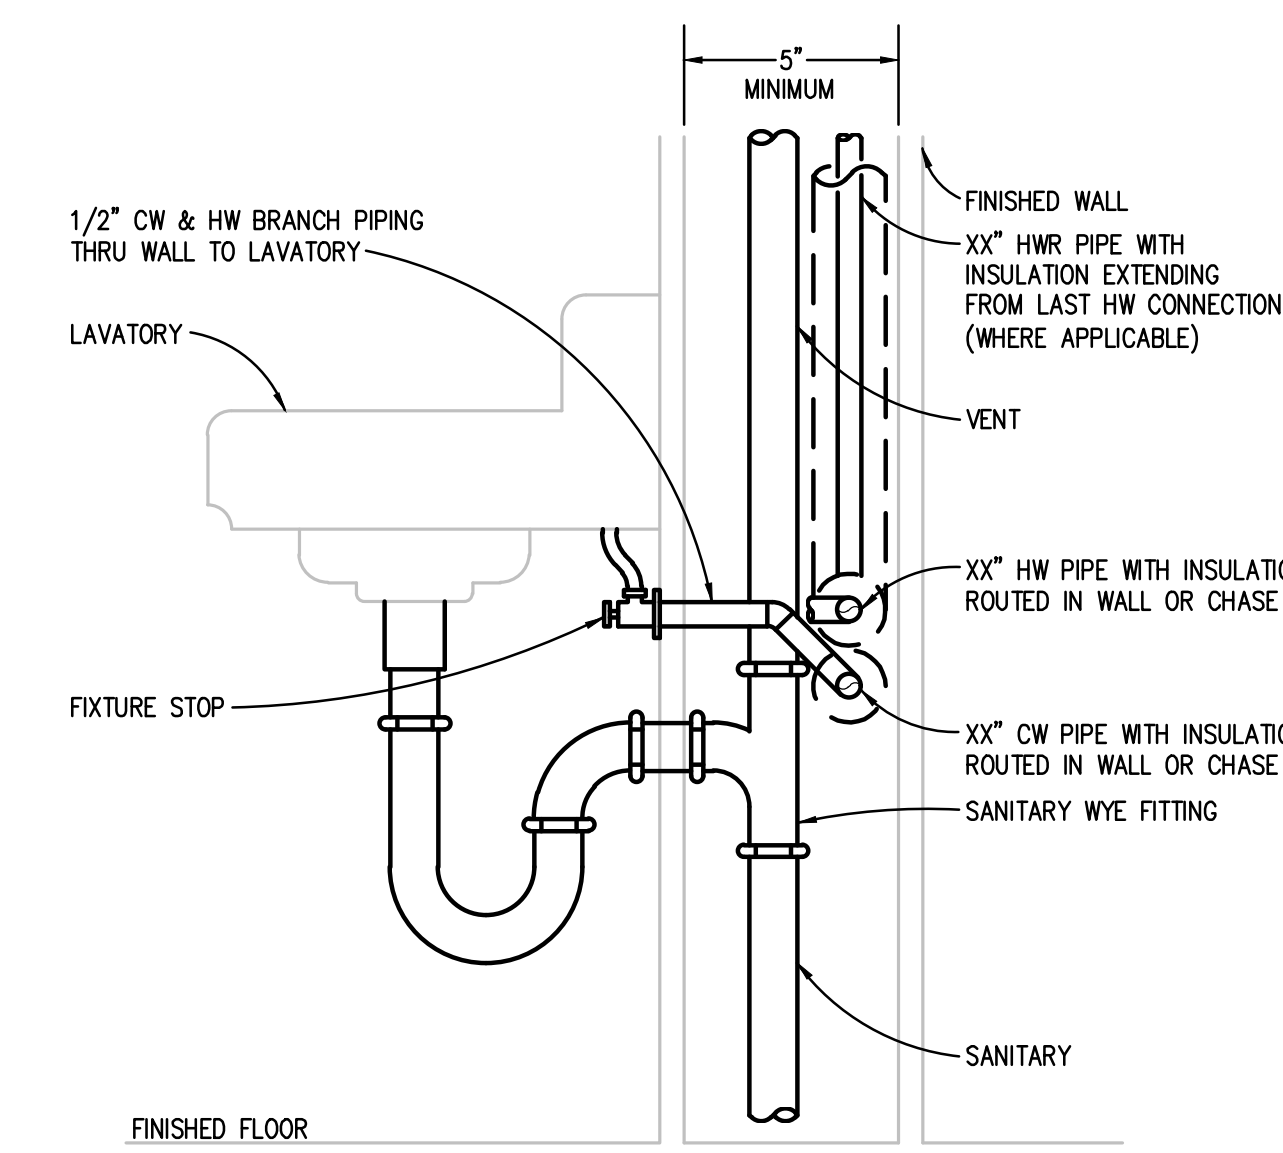


TYPICAL LAVATORY DETAIL
NO SCALE

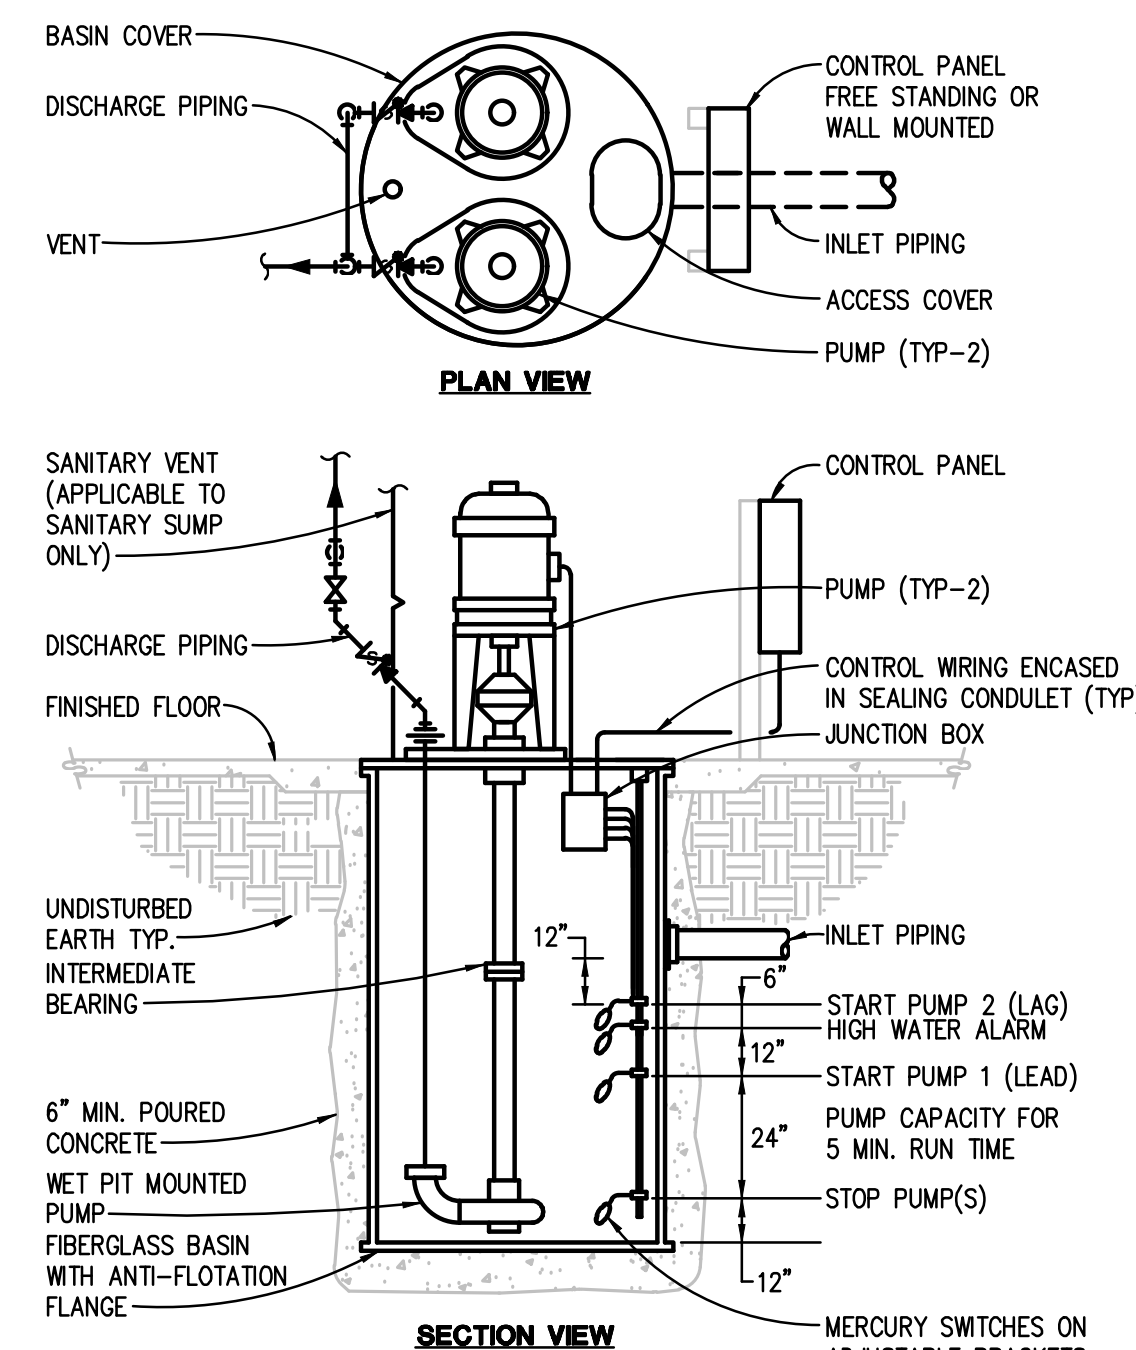

DUPLIX SUMP PUMP (SP-1) PIPING DIAGRAM
NO SCALE

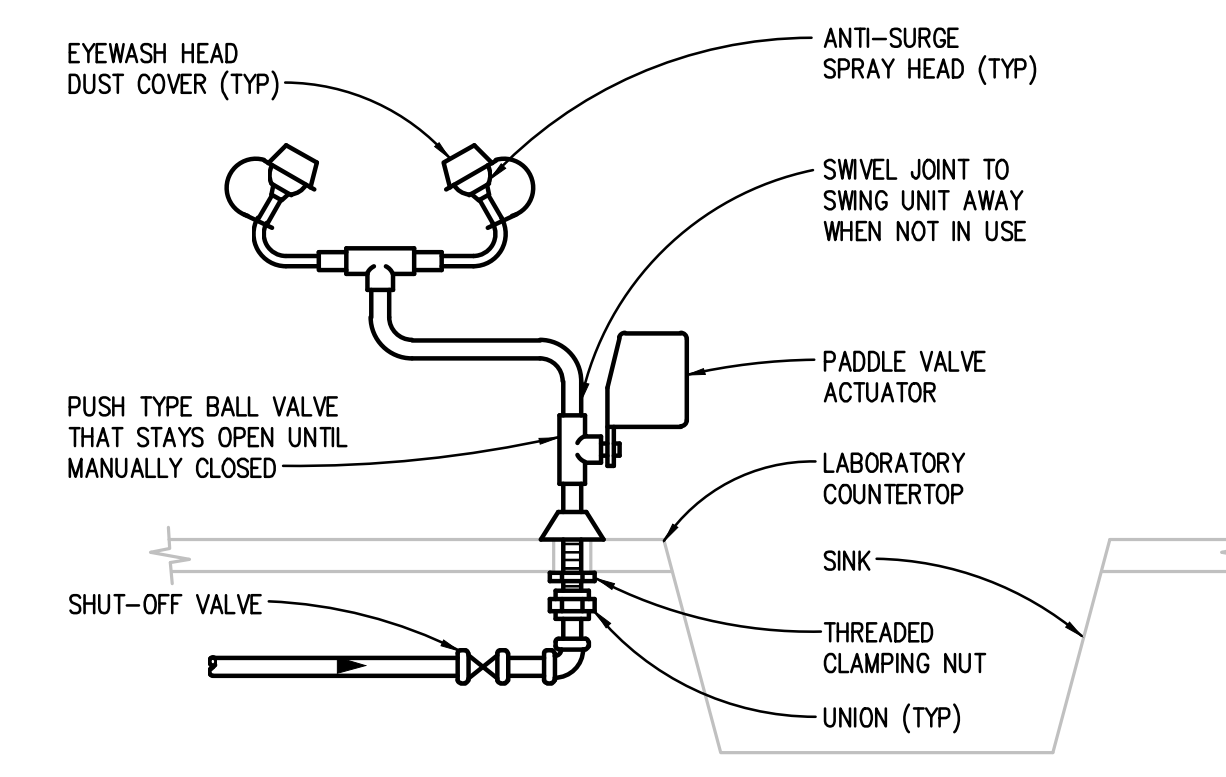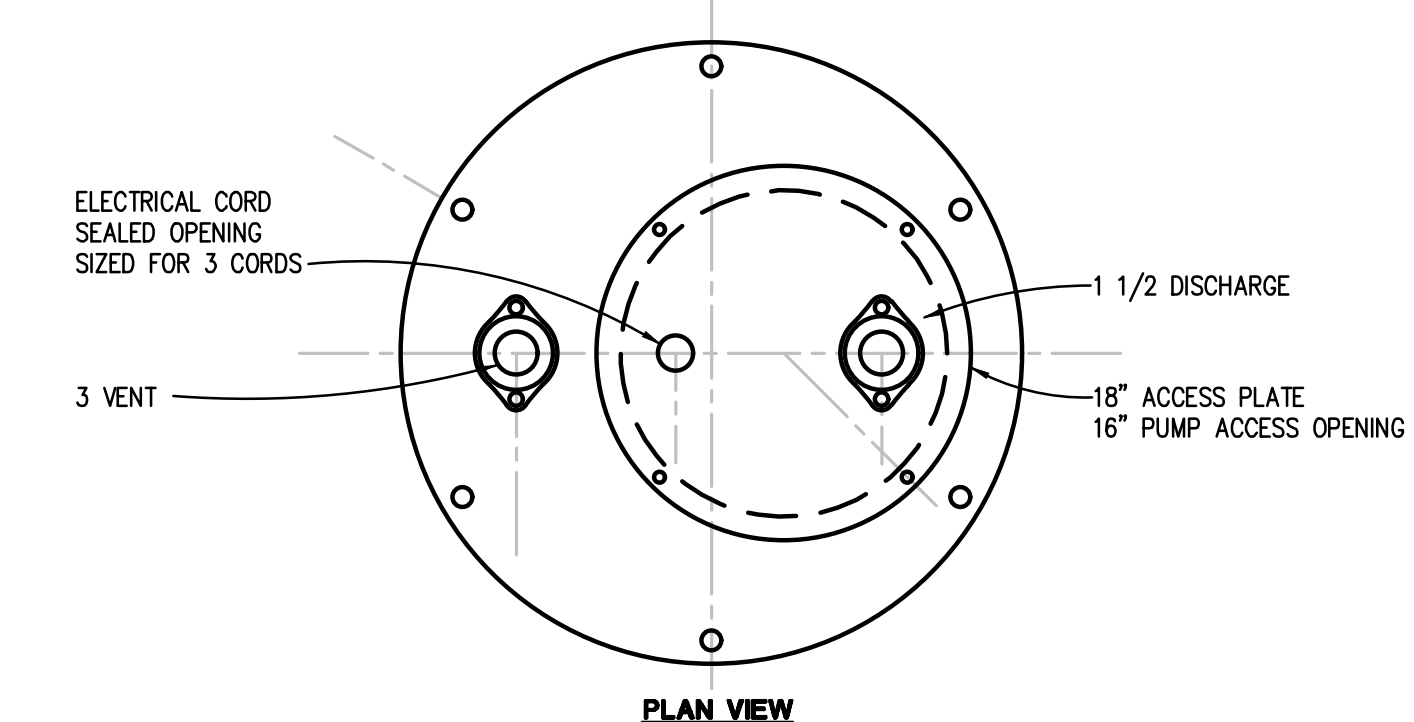

EMERGENCY EYEWASH PIPING DIAGRAM
NO SCALE

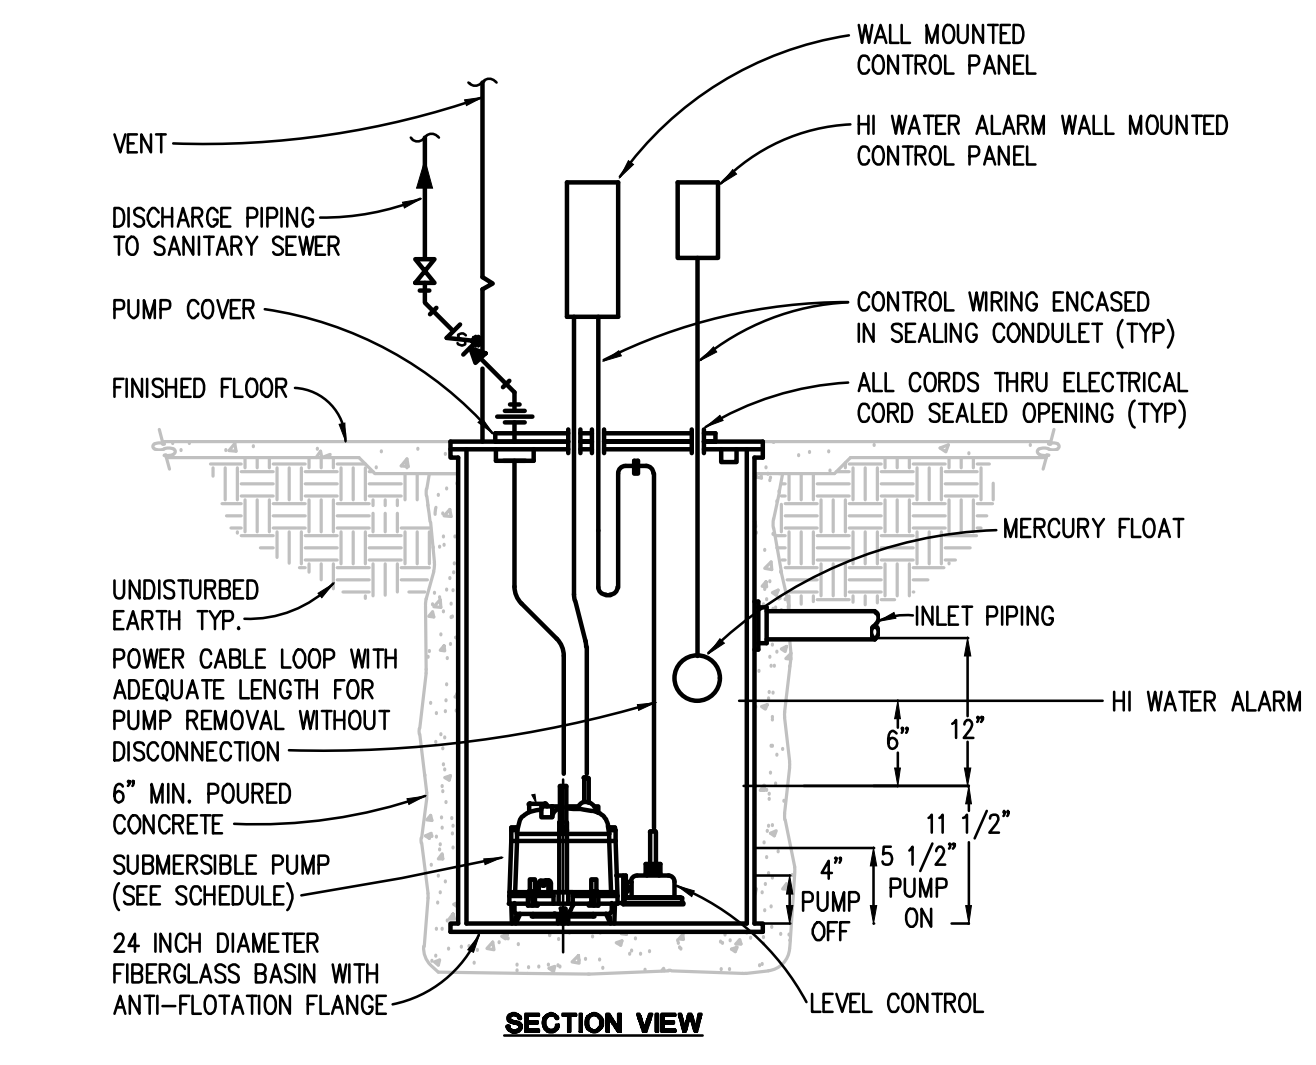


SIMPLEX SUMP PUMP (SP-2) PIPING DIAGRAM
NO SCALE

GAS LOAD SCHEDULE


ITEM	TOTAL CFH
EMERGENCY GAS GENERATOR	2600
BOILER 1	2000
BOILER 2	2000
WATER HEATER 1	500
WATER HEATER 2	125
MAKE-UP AIR UNIT 1	600
MAKE-UP AIR UNIT 2	198
KITCHEN EQUIPMENT	
OVEN STEAMER	164
OVEN STEAMER	164
CONVECTION OVEN	100
RANGE	143
CONNECTED GAS LOAD =	8594 @ 11 IN. W.C.

* GAS TRAIN PROVIDED BY EQUIPMENT MANUFACTURER - SEE SPECIFICATIONS
** GAS PRESSURE REGULATOR PROVIDED BY FOOD SERVICE MANUFACTURER
*** THE GAS SERVICE COMPONENTS SHALL BE RATED IN ACCORDANCE WITH THE FOLLOWING CHART

METER OUTLET PRESSURE (psig)	MINIMUM SYSTEM PRESSURE RATING (psig)
0.4	0.5
1 OR 2	10
3 OR 30	DELIVERY +10
33 TO 100	DELIVERY +20
101 TO 200	DELIVERY +30

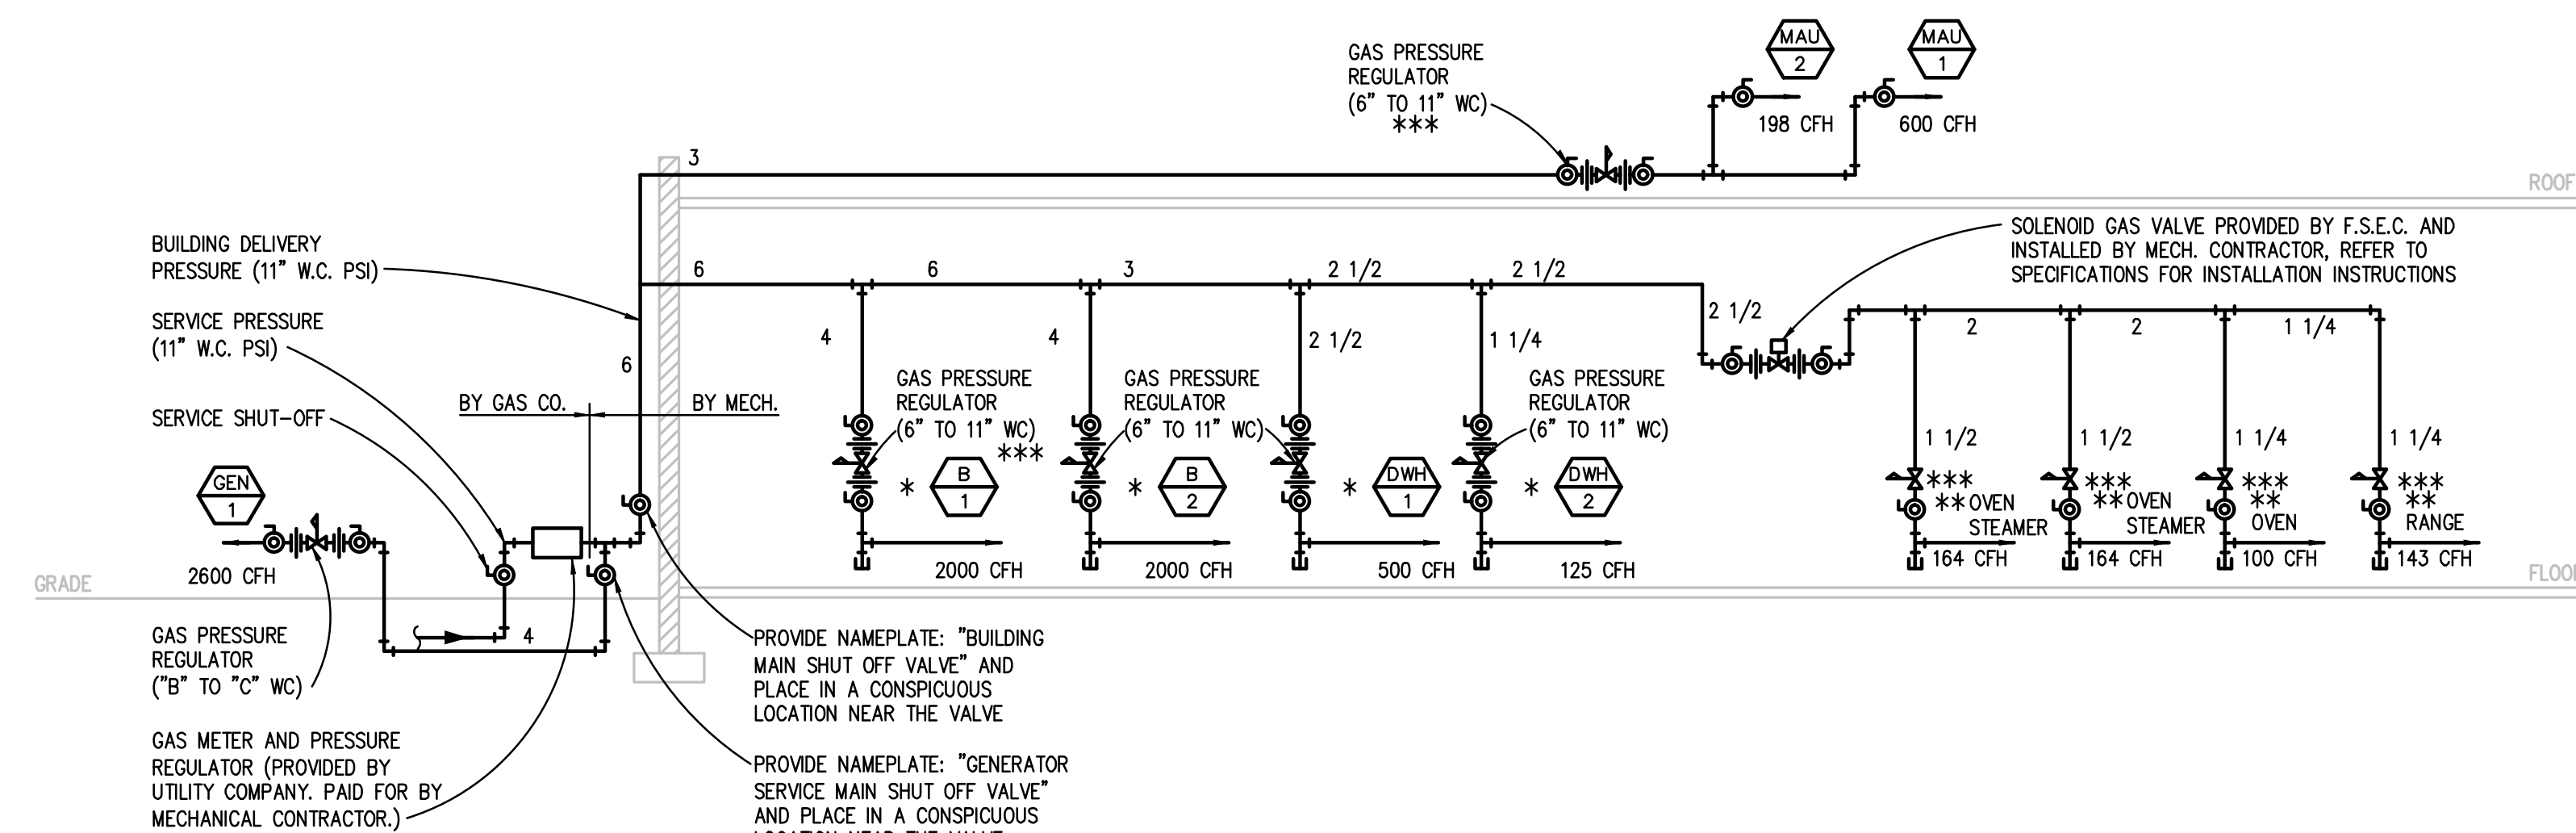

NATURAL GAS PIPING DIAGRAM
NO SCALE

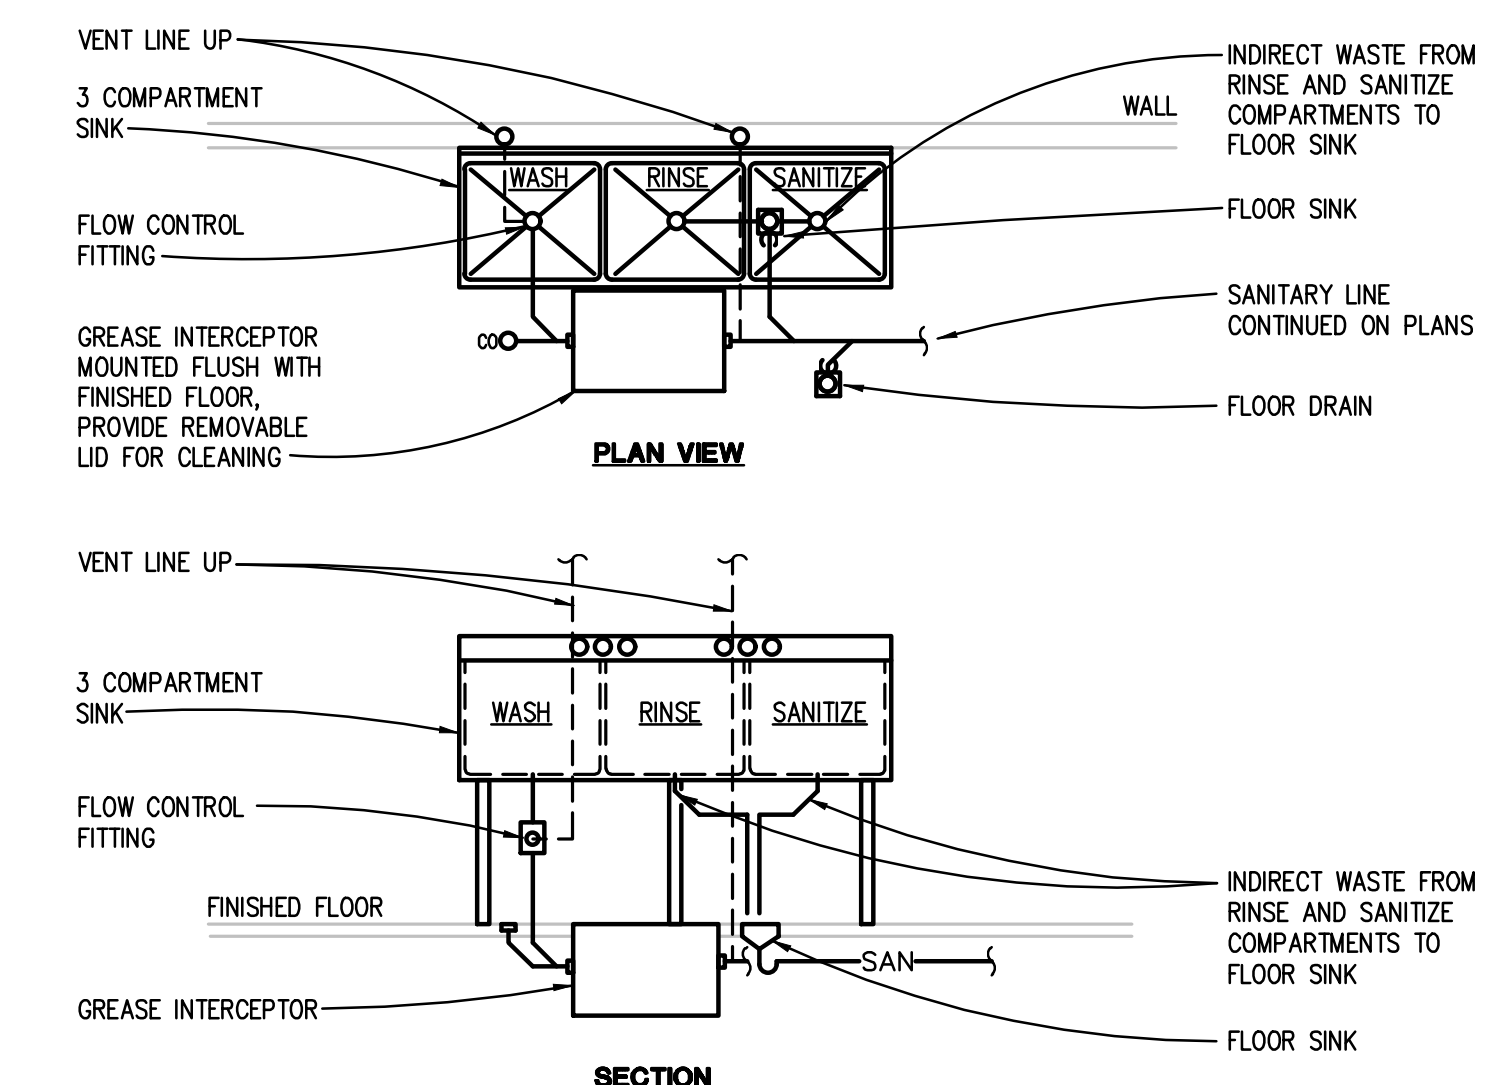

DEDICATED GREASE INTERCEPTOR DETAIL
NO SCALE

GRILLE, REGISTER, AND DIFFUSER SCHEDULE										
UNIT IDENTIFICATION		TYPE	FACE SIZE	NECKSIZE	FRAME TYPE	ACCESSORY	CONSTRUCTION	FINISH	MODEL NUMBER	KEYED NOTES
DES.	NO.									
S	1	DIFFUSER	24x24	SEE PLANS	NOTE 2	-	STEEL	WHITE	SCDA	1
S	2	DIFFUSER	24x24	SEE PLANS	NOTE 2	-	STEEL	WHITE	SCDA	2
S	3	DIFFUSER	48x4.5	SEE PLANS	NOTE 2	-	STEEL	WHITE	SDS75	3
S	4	DIFFUSER	72x4.5	SEE PLANS	NOTE 2	-	STEEL	WHITE	SDS75	3
S	5	DIFFUSER	48x5	SEE PLANS	NOTE 2	-	STEEL	WHITE	SDS100	3
S	6	DIFFUSER	72x5	SEE PLANS	NOTE 2	-	STEEL	WHITE	SDS100	3
S	7	DIFFUSER	48x5	SEE PLANS	NOTE 2	-	STEEL	METALIC GREY	SDS100	3, 4
S	8	GRILLE	NECK SIZE + 1-1/4"	SEE PLANS	NOTE 2	-	STEEL	WHITE	510	
S	9	DIFFUSER	-	SEE PLANS	DUCT MOUNTED	-	STEEL	WHITE	RCD	
S	10	DIFFUSER	24x24	SEE PLANS	NOTE 2	-	ALUMINIUM	WHITE	ASCDA	1
S	11	GRILLE	NECK SIZE + 1-1/4"	SEE PLANS	NOTE 2	-	ALUMINIUM	WHITE	610	
S	12	DIFFUSER	24x24	SEE PLANS	NOTE 2	-	STEEL	WHITE	VPD	
S	13	DIFFUSER	24x24	SEE PLANS	NOTE 2	-	STEEL	WHITE	RAVD	
R	1	GRILLE	24x24	SEE PLANS	NOTE 2	-	STEEL	WHITE	PDDR	
R	2	GRILLE	24x12	SEE PLANS	NOTE 2	-	STEEL	WHITE	PDDR	
R	3	GRILLE	NECK SIZE + 1-1/4"	SEE PLANS	NOTE 2	-	STEEL	WHITE	530	
R	4	GRILLE	NECK SIZE + 1-1/4"	SEE PLANS	NOTE 2	-	STEEL	NOTE 3	90	4
R	5	GRILLE	72x4	SEE PLANS	NOTE 2	SIGHT BAFFLE	STEEL	NOTE 3	SDR50	2, 4
T	1	GRILLE	NECK SIZE + 1-1/4"	SEE PLANS	NOTE 2	-	STEEL	WHITE	530	
E	1	GRILLE	24x24	SEE PLANS	NOTE 2	-	STEEL	WHITE	PDDR	
E	2	GRILLE	NECK SIZE + 1-1/4"	SEE PLANS	NOTE 2	-	STEEL	WHITE	530	
E	3	GRILLE	NECK SIZE + 1"	SEE PLANS	DUCT MOUNTED	-	ALUMINIUM	WHITE	SDGER	
E	4	GRILLE	24x24	SEE PLANS	NOTE 2	-	ALUMINIUM	WHITE	PDDR	
E	5	GRILLE	NECK SIZE + 1-1/4"	SEE PLANS	NOTE 2	-	ALUMINIUM	WHITE	630	

GENERAL NOTES:
1. MODEL NUMBERS ARE PRICE UNLESS OTHERWISE NOTED.
2. COORDINATE EXACT FRAME TYPE WITH ARCHITECTURAL TRADES.
3. COLOR SELECTION BY ARCHITECT.

KEYED NOTES:
1. HORIZONTAL THROW PATTERN
2. VERTICAL THROW PATTERN
3. 2 SLOT
4. PROVIDE COLOR SAMPLE TO ARCHITECT PRIOR TO ORDERING.

SEWAGE PUMP AND SUMP PUMP SCHEDULE																			
UNIT IDENTIFICATION		SYSTEM SERVED	SIMPLEX OR DUPLEX	PUMP					BASIN				ELECTRICAL				MODEL NUMBER	KEYED NOTES	
DES.	NO.			QUANTITY	FLOW EACH GPM	W.P.D. FT. HEAD	HP EACH	RPM	CONSTRUCTION	DIAMETER INCHES	DEPTH INCHES	COVER TYPE	MODULATION / CONTROL TYPE	VOLTS	PHASE	SCCR KA			OPTIONS / ACCESSORIES
SP	1	DRAIN TILE	DUPLEX	2	13.0	20.0	0.75	1750	FIBERGLASS	36	72	GRATE	AUTO	208	3	5		1607	
SP	2	ELEVATOR	SIMPLEX	1	50.0	20.0	0.75	1750	FIBERGLASS	36	36	GRATE	AUTO	208	3	5		1601	

GENERAL NOTES:
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE WELL UNLESS OTHERWISE NOTED.

FUEL FIRED DOMESTIC WATER HEATER SCHEDULE																		
UNIT IDENTIFICATION		STORAGE CAPACITY GALLONS	FUEL TYPE	MANUFACTURER REQUIRED INLET PRESSURE AT GAS TRAIN		INPUT MBH	RECOVERY GPH	E.W.T. °F	L.W.T. °F	MODULATION / CONTROL TYPE	VOLTS	PHASE	FLA	MOP	SCCR KA	OPTIONS / ACCESSORIES	MODEL NUMBER	KEYED NOTES
DES.	NO.			MIN	MAX													
DWH	1	650.0	NATURAL GAS	8	14	650	772	40	140	AUTO	120	1	0	0	5		AWH0650NPM	1
DWH	2	65.0	NATURAL GAS	8	14	125	145	40	140	AUTO	120	1	0	0	0		SWR125N	

GENERAL NOTES:
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE LOCHINVAR UNLESS OTHERWISE NOTED.

KEYED NOTES:
1. PROVIDE 650 GALLON HOT WATER STORAGE TANK.

DOMESTIC HOT WATER SYSTEM EXPANSION TANK SCHEDULE															
UNIT IDENTIFICATION		SYSTEM SERVED	ESTIMATED TOTAL SYSTEM VOLUME GALLONS	TYPE	OPERATING PRESSURES AT EXPANSION TANK			SYSTEM OPERATING TEMPERATURES		EXPANSION VOLUME GALLONS	MINIMUM TANK VOLUME GALLONS	DIMENSIONS		MODEL NUMBER	KEYED NOTES
DES.	NO.				INITIAL PSIG	PRE-CHARGE PSIG	MAX (OPERATING) PSIG	MINIMUM °F	MAXIMUM °F			DIAMETER INCHES	HEIGHT INCHES		
ET	1	DOMESTIC	80	BLADDER	40	40	125	40	240	80	60	24	55	WTA-448	
ET	2	KITCHEN	40	DIAPHRAGM	40	40	150	40	240	3.5	2.5	10	14	PTA-5	

GENERAL NOTES:
1. MODEL NUMBERS ARE BELL & GOSSETT UNLESS OTHERWISE NOTED.
2. THE CONTRACTOR SHALL PRE-CHARGE THE TANK TO THE VALUE INDICATED IN THE SCHEDULE. FOR TANKS THAT ARE SUPPLIED PRE-CHARGED BY THE MANUFACTURER, THE CONTRACTOR SHALL CONFIRM THE PRESSURE AND MAKE ADJUSTMENTS AS REQUIRED.

THERMOSTATIC MIXING VALVE SCHEDULE						
UNIT IDENTIFICATION		MINIMUM FLOW GPM	MAXIMUM FLOW GPM	PRESSURE DROP AT MAXIMUM FLOW PSIG	MODEL	KEYED NOTES
DES.	NO.					
MV	1	1	226	50.00	6NB-LF	

GENERAL NOTES:
1. MODEL NUMBERS ARE LEONARD UNLESS OTHERWISE NOTED.

DUCT SILENCER SCHEDULE																														
UNIT IDENTIFICATION		SYSTEM TYPE	SYSTEM SERVED	AIRFLOW CFM	A.P.D. IN. W.G.	MAX P.D. IN. W.G.	VELOCITY AT DIL RATING FPM	DYNAMIC INSERTION LOSS (DIL) dB								TARGET NOISE CRITERIA	DIMENSIONS								CONSTRUCTION				MODEL NUMBER	KEYED NOTES
DES.	NO.							63	125	250	500	1K	2K	4K	8K		W INCHES	H INCHES	L INCHES	TYPE	OUTER CASING TYPE	FILL MATERIAL	LINER	CASING MATERIAL						
DS	1R-A	RA	ERU-1	6150	0.16	0.25	769	7	14	25	40	42	35	24	16	25	48	24	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RL60/2D					
DS	1R-B	RA	ERU-1	6150	0.16	0.25	769	7	14	25	40	42	35	24	16	25	48	24	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RL60/2D					
DS	1S-A	SA	ERU-1	5125	0.19	0.25	941	6	12	21	38	43	38	25	18	25	28	28	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/2E					
DS	1S-B	SA	ERU-1	7175	0.21	0.25	879	7	12	22	38	40	35	24	17	25	42	28	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RL60/2D					
DS	2R-A	RA	ERU-2	11300	0.17	0.25	1529	5	7	15	33	36	29	20	16	30	36	42	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/1B					
DS	2R-B	RA	RF-101	1560	0.14	0.25	802	7	14	25	40	42	32	20	14	25	20	16	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/4E					
DS	2R-C	RA	RF-102	2390	0.15	0.25	1024	7	11	21	41	50	41	23	18	25	24	16	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/1D					
DS	2S-A	SA	ERU-2	11300	0.16	0.25	1529	5	8	15	31	40	30	23	17	30	38	28	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RH60/1D					
DS	2S-B	SA	FPB-101	1560	0.11	0.25	876	5	10	19	34	40	32	21	16	25	16	16	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/2D					
DS	2S-C	SA	FPB-102	2060	0.21	0.25	742	8	14	25	40	40	35	23	16	25	20	20	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RL60/4E					
DS	2S-D	SA	FPB-103	1800	0.21	0.25	720	8	15	25	43	44	39	25	17	25	20	18	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/4F					
DS	3R	RA	ERU-3	2550	0.17	0.25	900	7	14	25	39	44	34	22	15	30	34	12	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/3E					
DS	3S	SA	ERU-3	2550	0.16	0.25	937	6	10	20	37	41	33	25	17	30	28	14	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RH60/2F					
DS	4R	RA	ERU-4	11000	0.24	0.25	1269	7	12	21	41	51	41	23	18	40	48	26	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/1D					
DS	4S	SA	ERU-4	11000	0.24	0.25	1269	6	10	28	38	46	41	24	19	40	48	26	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/1D					
DS	5R	RA	ERU-5	2100	0.22	0.25	741	9	17	29	45	49	41	26	17	30	34	12	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/3F					
DS	5S	SA	ERU-5	2100	0.21	0.25	982	6	12	22	38	37	29	19	14	30	22	14	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/5E					
DS	6E	EA	ERU-6	1850	0.05	0.25	925	5	8	14	27	22	15	11	9	40	24	12	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/6B					
DS	6S	SA	ERU-6	1850	0.05	0.25	925	5	8	16	28	24	15	11	9	40	24	12	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/6B					
DS	7E	EA	ERU-7	6400	0.23	0.25	1067	7	13	25	36	35	25	18	13	40	48	18	60	RS	STANDARD	GLASS FIBER	NO	ALUMINIUM	RH60/6F					
DS	7S-A	SA	ERU-7	3400	0.19	0.25	920	7	11	20	40	48	45	29	21	30	38	14	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/1E					
DS	7S-B	SA	ERU-7	3000	0.19	0.25	1029	6	10	20	27	23	15	11	10	40	30	14	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RH60/9F					
DS	8R	RA	ERU-8	15000	0.18	0.25	1125	9	12	18	23	18	13	10	8	30	48	40	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RL60/XC					
DS	8S-A	SA	ERU-8	5760	0.19	0.25	1595	5	8	15	30	28	20	15	11	30	20	26	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RH60/4D					
DS	8S-B	SA	ERU-8	11470	0.19	0.25	1639	5	8	15	29	26	18	14	11	30	42	24	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RH60/5D					
DS	9R	RA	ERU-9	15000	0.14	0.25	1071	5	10	18	32	31	22	16	12	30	72	28	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RL60/3B					
DS	9S	SA	ERU-9	15000	0.21	0.25	1385	5	9	17	34	37	29	21	15	30	60	26	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RH60/2E					
DS	10R	RA	ERU-10	15000	0.18	0.25	1125	6	12	22	37	44	32	20	15	30	56	30	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RM60/2D					
DS	10S-A	SA	ERU-10	5760	0.19	0.25	1595	5	8	15	30	28	20	15	11	30	20	26	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RH60/4D					
DS	10S-B	SA	ERU-10	11470	0.16	0.25	1496	5	8	15	31	34	25	19	14	30	46	24	60	RS	STANDARD	GLASS FIBER	NO	22 GA GALVANIZED	RH60/2D					

GENERAL NOTES:
1. DUCT SILENCER MODEL NUMBERS ARE BASED ON VIBRO-Acoustics UNLESS OTHERWISE NOTED.
2. LENGTH SHOWN FOR ELBOW SILENCERS IS CENTERLINE LENGTH.
3. VELOCITY SHOWN IS + (FORWARD FLOW) OR - (REVERSE FLOW) AS DEFINED BY ASTM E477-99.
4. PRESSURE DROP, DYNAMIC INSERTION LOSS AND SELF GENERATED NOISE PER ASTM E477-99.
5. MAXIMUM PRESSURE DROP WITH SYSTEM EFFECTS = SILENCER PRESSURE DROP PER ASTM E477-99 + SYSTEM EFFECTS FOR NEARBY DUCT ELEMENTS.
6. TYPE: RS = RECTANGULAR STRAIGHT; RE = RECTANGULAR ELBOW; REC = RECTANGULAR EXTENDED ELBOW; CS = CIRCULAR STRAIGHT; CE = CIRCULAR ELBOW.
7. FABRICATE SILENCER CASINGS OF STAINLESS STEEL WHERE SILENCERS ARE CONNECTED TO A PVC COATED OR STAINLESS STEEL DUCT SYSTEM.

WATER SOURCE HEAT PUMP SCHEDULE																															
UNIT IDENTIFICATION		FAN				LOOP WATER		COOLING MODE (90 °F ENT. WATER TEMP.)						HEATING MODE (70 °F ENT. WATER TEMP.)						COMPRESSORS				ELECTRICAL						MODEL NUMBER	KEYED NOTES
DES.	NO.	NOMINAL SIZE (TONS)	AIRFLOW CFM	ESP IN. W.G.	HP	FLOW GPM	FLUID TYPE	MAX W.P.D. FT. HEAD	AIR		TOTAL CAPACITY MBH	SENS. CAPACITY MBH	THR MBH	MINIMUM E.E.R.	AIR		TOTAL CAPACITY MBH	THA MBH	MINIMUM C.O.P.	NO. OF COMP.	R.L.A. EA.	L.R.A. EA.	ARRANGEMENT	VOLTS	PHASE	FLA	MOP	SCCR KA	OPTIONS / ACCESSORIES		
HP	101	6	2000	0.5	1	18	PG30	16.55	80	57	67.3	48	83.7	14	55	8															

ENERGY RECOVERY UNIT WITH INTEGRAL HEAT PUMP SCHEDULE (A)

UNIT IDENTIFICATION		AREA/SYSTEM SERVED	SUPPLY FAN									EXHAUST FAN			HEAT EXCHANGER (SUMMER)						HEAT EXCHANGER (WINTER)															
DES.	NO.		CFM	MIN. OA CFM	ESP" TSP"	CONROL TYPE	QUANTITY	BHP	HP	CFM	ESP" TSP"	QUANTITY	BHP	HP	SUPPLY SIDE			EXHAUST SIDE			SUPPLY SIDE			EXHAUST SIDE												
															E.A.T. D.B. °F	E.A.T. W.B. °F	L.A.T. D.B. °F	L.A.T. W.B. °F	A.P.D. IN. WG.	E.A.T. D.B. °F	L.A.T. D.B. °F	L.A.T. W.B. °F	A.P.D. IN. WG.	E.A.T. D.B. °F	E.A.T. W.B. °F	L.A.T. D.B. °F	L.A.T. W.B. °F	A.P.D. IN. WG.	E.A.T. D.B. °F	L.A.T. D.B. °F	L.A.T. W.B. °F	A.P.D. IN. WG.	EFFIC. (%)			
ERU	1	GYMNASIUM	12300	7600	2.75	4.29	SZVAV	2	11.80	15.00	12300	1.25	2.78	2	8.40	10.00	91.0	74.0	76.4	63.7	0.53	72.0	86.6	71.0	0.53	77	-10.0	-10.9	52.9	43.8	0.53	72.0	9.1	8.9	0.53	77
ERU	2	CLASSROOMS	11300	6400	3.25	5.03	DAT-DSP VAV	2	13.00	15.00	11300	1.25	2.66	2	6.80	10.00	91.0	74.0	82.6	69.0	0.41	72.0	86.3	70.0	0.41	65	-10.0	-10.9	26.1	23.9	0.41	72.0	10.4	10.3	0.41	71
ERU	3	MEDIA CENTER	2560	1450	2.25	3.78	DAT-DSP VAV	1	2.20	3.00	2560	1.25	2.60	1	1.50	2.00	91.0	74.0	78.3	65.6	0.35	72.0	84.7	69.3	0.35	64	-10.0	-10.9	44.8	38.4	0.35	72.0	17.2	16.7	0.35	67
ERU	4	DINING COMMONS	11000	3900	3.25	4.99	SZVAV	2	12.60	15.00	11000	1.25	2.67	2	7.40	10.00	91.0	74.0	78.8	66.0	0.42	72.0	84.2	69.0	0.42	61	-10.0	-10.9	42.7	37.0	0.42	72.0	19.3	18.6	0.42	64
ERU	5	OFFICES	2100	800	2.25	3.76	DAT-DSP VAV	1	1.90	3.00	2100	1.25	2.53	1	1.20	1.50	91.0	74.0	78.6	65.7	0.28	72.0	86.0	70.0	0.28	71	-10.0	-10.9	43.3	37.3	0.28	72.0	11.7	11.6	0.28	73
ERU	6	KITCHEN	1850	1250	2.25	4.18	SZVAV	1	2.00	3.00	1850	1.25	2.69	1	1.10	2.00	91.0	74.0	79.6	67.0	0.44	72.0	84.3	68.8	0.44	58	-10.0	-10.9	39.0	33.8	0.44	72.0	18.8	18.7	0.44	64
ERU	7	LOCKER ROOMS	6400	6400	1.00	3.32	CAV-DAT	1	4.60	7.50	7040	1.25	2.88	1	4.60	7.50	91.0	74.0	76.9	64.3	0.63	72.0	86.1	63.6	0.63	73	-10.0	-10.9	51.0	42.4	0.63	72.0	11.0	10.9	0.63	74
ERU	8	CLASSROOMS	15000	8900	3.25	5.03	DAT-DSP VAV	2	16.80	20.00	15000	1.25	2.83	2	9.80	15.00	91.0	74.0	80.2	67.1	0.58	72.0	88.4	71.7	0.58	80	-10.0	-10.9	36.4	31.9	0.58	72.0	1.3	1.1	0.58	84
ERU	9	CLASSROOMS	15000	8900	3.25	5.03	DAT-DSP VAV	2	16.80	20.00	15000	1.25	2.58	2	9.80	15.00	91.0	74.0	79.3	66.1	0.33	72.0	89.4	72.9	0.33	80	-10.0	-10.9	40.5	35.4	0.33	72.0	-3.2	-4.0	0.33	84
ERU	10	CLASSROOMS	15000	8900	3.25	5.03	DAT-DSP VAV	2	16.80	20.00	15000	1.25	2.83	2	8.30	15.00	91.0	74.0	80.2	67.1	0.58	72.0	88.4	71.7	0.58	92	-10.0	-10.9	36.4	31.9	0.58	72.0	1.3	1.3	0.58	93

ENERGY RECOVERY UNIT WITH INTEGRAL HEAT PUMP SCHEDULE (B)

UNIT IDENTIFICATION		COOLING MODE										HEATING MODE															
DES.	NO.	AIR				TOTAL CAPACITY MBH	SENS. CAPACITY MBH	THR MBH	E.W.T. °F	L.W.T. °F	FLOW GPM	HOT GAS REHEAT		COOLING MODE			AIR			TOTAL CAPACITY MBH	THA MBH	E.W.T. °F	L.W.T. °F	FLOW GPM	HEATING MODE		CONTROL VALVE W.P.D. FT. HEAD
		E.A.T. D.B. °F	E.A.T. W.B. °F	L.A.T. D.B. °F	L.A.T. W.B. °F							MINIMUM E.E.R.	MAX W.P.D. FT. HEAD	CONTROL VALVE W.P.D. FT. HEAD	E.A.T. °F	L.A.T. °F	MINIMUM C.O.P.	MAX W.P.D. FT. HEAD									
ERU	1	74.7	62.4	54.8	53.5	318	268.3	418.6	90	100	87.4	Y	176.9	14.8	4.2	11.5	63.8	96.4	434.2	372.6	70	61	87.4	5.9	4.2	11.5	
ERU	2	78.0	65.4	55.3	54.4	377.2	280.9	457	90	100	95.4	N	-	15.7	7.1	11.5	52.5	89.6	454.2	411.3	70	61	95.4	6.5	7.1	11.5	
ERU	3	75.6	63.3	52.8	51.6	86.4	63.7	92.9	90	100	19.4	N	-	15.3	2.1	11.5	58.7	92.7	94	83.6	70	61	19.4	6.1	2.1	11.5	
ERU	4	74.4	62.3	55.1	54.0	263.8	232.8	330	90	100	68.9	Y	166.7	17.5	4.1	11.5	60.6	89.3	320.3	293.7	70	61	68.9	7.6	4.1	11.5	
ERU	5	74.8	62.6	55.0	54.1	51.9	45.5	66.6	90	100	13.9	N	-	17.8	2.8	11.5	55.5	85.1	67.3	61.3	70	61	13.9	8.2	2.8	11.5	
ERU	6	77.6	65.2	55.2	54.3	61.2	45.4	84.8	90	100	17.7	Y	29	16.1	6.5	11.5	47.1	88.9	83.7	73.8	70	61	17.7	6.8	6.5	11.5	
ERU	7	76.9	64.3	54.9	53.8	199.9	154	277.3	90	100	57.9	N	-	15.6	4.7	11.5	40.8	81.9	285	252.4	70	61	57.9	7.2	4.7	11.5	
ERU	8	76.9	64.4	55.4	54.5	446	353.9	555.2	90	100	115.9	N	-	15.6	6.8	11.5	23.5	58.7	572.5	538.5	70	60	115.9	8.2	6.8	11.5	
ERU	9	76.3	63.7	55.1	54.2	446	348.9	555.2	90	100	115.9	N	-	15.6	6.8	11.5	23.5	58.7	572.5	538.5	70	60	115.9	8.2	6.8	11.5	
ERU	10	76.9	64.4	55.4	54.5	423.8	343.9	555.2	90	100	115.9	N	-	15.6	6.8	11.5	23.5	58.7	572.5	538.5	70	60	115.9	8.2	6.8	11.5	

ENERGY RECOVERY UNIT WITH INTEGRAL HEAT PUMP SCHEDULE (C)

UNIT IDENTIFICATION		PRE-FILTERS		RETURN FILTERS		ELECTRICAL				MAXIMUM UNIT DIMENSIONS				MODEL NUMBER	KEYED NOTES		
DES.	NO.	EFF. (%)	SP" TOTAL	EFF. (%)	SP" TOTAL	VOLTS	PHASE	MCA	MOP	SCCR KA	OPTIONS / ACCESSORIES	UNIT WEIGHT (LBS.)	LENGTH INCHES			WIDTH INCHES	HEIGHT INCHES
ERU	1	85	0.7	85	0.70	480	3	84	90	0	B	20750	282.0	127.0	98.0	ERU-SS-WH-12300-HP-460	
ERU	2	85	0.7	85	0.70	480	3	89	110	0	B	16700	259.0	117.0	98.0	ERU-SS-WH-11300-HP-460	
ERU	3	85	0.7	85	0.70	480	3	22	30	0	B	10800	251.0	83.0	72.0	ERU-SS-WH-2600-HP-460	
ERU	4	85	0.7	85	0.70	480	3	74	90	0	B	18000	256.0	116.0	92.0	ERU-SS-WH-11000-HP-460	
ERU	5	85	0.7	85	0.70	480	3	19	25	0	B	8700	186.0	83.0	72.0	ERU-SS-WH-2100-HP-460	
ERU	6	85	0.7	85	0.70	480	3	20	25	0	B	10000	251.0	83.0	54.0	ERU-SS-WH-1800-HP-460	
ERU	7	85	0.7	85	0.70	480	3	51	60	0	B	14900	263.0	106.0	86.0	ERU-SS-WH-6400-HP-460	
ERU	8	85	0.7	85	0.70	480	3	108	125	0	B	19300	263.0	127.0	110.0	ERU-SS-WH-15000-HP-460	
ERU	9	85	0.7	85	0.70	480	3	108	125	0	B	19750	266.0	127.0	110.0	ERU-SS-WH-15000-HP-460	
ERU	10	85	0.7	85	0.70	480	3	108	125	0	B	19300	263.0	127.0	110.0	ERU-SS-WH-15000-HP-460	

- GENERAL NOTES:**
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE INNOVENT UNLESS OTHERWISE NOTED.
3. DESIGN MINIMUM OUTSIDE AIRFLOW CFM (VENTILATION) LISTED IS BASED ON THE ESTIMATED MAXIMUM OCCUPANT LOAD. REFER TO TEMPERATURE CONTROL DRAWINGS FOR OUTSIDE AIR CONTROL SEQUENCE.
4. MERV DESIGNATES THE "MINIMUM EFFICIENCY REPORTING VALUE" AS EVALUATED UNDER ASHRAE STANDARD 52.2 1999.
5. AIR HANDLING UNIT TOTAL STATIC PRESSURE FOR CONSTANT AIR VOLUME SYSTEMS IS BASED ON THE AVERAGE/MIDLIFE FILTER AIR PRESSURE DROP UNLESS NOTED OTHERWISE.

- KEYED NOTES:**
1. PROVIDE SINGLE POINT ELECTRICAL CONNECTION WITH MAIN DISCONNECT.

ELECTRIC PROPELLER FAN UNIT HEATER SCHEDULE

UNIT IDENTIFICATION		CAPACITY MBH	FAN		HEATING ELEMENT KW	FINAL AIR TEMPERATURE °F	MODULATION / CONTROL TYPE	ELECTRICAL				MODEL NUMBER	KEYED NOTES	
DES.	NO.		CFM	HP				VOLTS	PHASE	FLA	MOP			SCCR KA
EUH	101	11.2	400	3.3	26	AUTO	480	3	4.0	15	0	A	P3PUH03CA1	
EUH	102	17	400	5	40	AUTO	480	3	6.1	15	0	A	P3PUH05CA1	
EUH	103	11.2	400	3.3	26	AUTO	480	3	4.0	15	0	A	P3PUH03CA1	
EUH	104	11.2	400	3.3	26	AUTO	480	3	4.0	15	0	A	P3PUH03CA1	
EUH	201	17	400	5	40	AUTO	480	3	6.1	15	0	A	P3PUH05CA1	
EUH	202	11.2	400	3.3	26	AUTO	480	3	4.0	15	0	A	P3PUH03CA1	

- GENERAL NOTES:**
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE MARKEL UNLESS OTHERWISE NOTED.

ELECTRIC CENTRIFUGAL FAN CABINET UNIT HEATER SCHEDULE

UNIT IDENTIFICATION		CAPACITY MBH	AIR		FAN		HEATING ELEMENT TOTAL KW	DIMENSIONS			REGCESS DEPTH INCHES	FILTER		MODULATION / CONTROL TYPE	ELECTRICAL					MODEL NUMBER	KEYED NOTES		
DES.	NO.		AIRFLOW CFM	E.D.B. °F	L.D.B. °F	HP		RPM	LENGTH INCHES	HEIGHT INCHES		DEPTH INCHES	TYPE		AREA SQ. FT.	VOLTS	PHASE	FLA	MOP			SCCR KA	OPTIONS / ACCESSORIES
ECUH	101	27.3	500	60	111	0	0	8	46	26	10	4	THROWAWAY	-	AUTO	480	3	11.7	20	0	A	6346D084833	
ECUH	102	20.5	500	60	98	0	0	6	46	26	10	4	THROWAWAY	-	AUTO	480	3	8.1	15	0	A	6346D064833	
ECUH	103	34.1	500	60	123	0	0	10	46	26	10	4	THROWAWAY	-	AUTO	480	3	15.4	20	0	A	6346D104833	
ECUH	104	34.1	500	60	123	0	0	10	46	26	10	4	THROWAWAY	-	AUTO	480	3	15.4	20	0	A	6346D104833	
ECUH	105	27.3	500	60	111	0	0	8	46	26	10	4	THROWAWAY	-	AUTO	480	3	11.7	20	0	A	6346D084833	
ECUH	106	13.6	250	60	110	0	0	4	33	26	10	4	THROWAWAY	-	AUTO	480	3	6.0	15	0	A	6333D044833	
ECUH	107	13.6	250	60	110	0	0	4	33	26	10	4	THROWAWAY	-	AUTO	480	3	6.0	15	0	A	6333D044833	
ECUH	108	13.6	250	60	110	0	0	4	33	26	10	4	THROWAWAY	-	AUTO	480	3	6.0	15	0	A	6333D044833	

- GENERAL NOTES:**
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE MARKEL UNLESS OTHERWISE NOTED.



TMP ARCHITECTURE INC
1191 WEST SQUARE LAKE ROAD - BOX 289
BLOOMFIELD HILLS - MICHIGAN - 48302
TEL: 248-338-8901 FAX: 248-338-0223
EM: INFO@TMPARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-566

AIR TERMINAL TYPE									
DUCT CONNECTIONS		DISCHARGE SOUND POWER/RADIATED SOUND POWER - dB						MODEL NUMBER	KEYED NOTES
INLET SIZE INCHES	OUTLET SIZE INCHES	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz		
6Ø	12x8	73/66	69/63	62/52	56/42	53/40	49/36	SDV	A
8Ø	12x10	72/68	70/59	66/53	63/47	57/46	53/46	SDV	B
10Ø	14x12-1/2	78/71	70/61	65/56	61/50	58/47	53/45	SDV	C
12Ø	16x15	76/72	73/63	69/59	65/53	61/48	57/46	SDV	D
16Ø	24x18	78/70	73/63	70/58	68/53	64/52	59/50	SDV	E
24x16	38x18	83/74	81/69	76/63	74/54	73/48	68/41	SDV	F

- GENERAL NOTES:
1. MODEL NUMBERS ARE PRICE UNLESS OTHERWISE NOTED.
2. MAXIMUM SOUND POWER LEVEL BASED ON 2" PRESSURE DROP ACROSS UNIT WITH NO ALLOWANCE FOR EXTERNAL ATTENUATION.

- KEYED NOTES:
A. BASED ON 360 CFM
B. BASED ON 650 CFM
C. BASED ON 900 CFM
D. BASED ON 1500 CFM
E. BASED ON 2000 CFM
F. BASED ON 5300 CFM

ELECTRIC RADIANT WALL PANEL SCHEDULE										
UNIT IDENTIFICATION		CAPACITY WATTS	DIMENSIONS		ELECTRICAL				MODEL NUMBER	KEYED NOTES
DES.	NO.		LENGTH INCHES	WIDTH INCHES	VOLTS	PHASE	MOP	SCCR KA		
ERWP	101	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	102	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	103	879	72	4.5	208	1	15	0	EB3-208D	
ERWP	104	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	105	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	106	879	72	4.5	208	1	15	0	EB3-208D	
ERWP	107	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	108	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	109	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	110	1319	108	4.5	208	1	15	0	EB3-208D	
ERWP	111	1319	108	4.5	208	1	15	0	EB3-208D	
ERWP	112	1319	108	4.5	208	1	15	0	EB3-208D	
ERWP	113	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	114	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	115	440	36	4.5	208	1	15	0	EB3-208D	
ERWP	116	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	117	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	118	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	119	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	120	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	121	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	122	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	123	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	124	1172	96	4.5	208	1	15	0	EB3-208D	
ERWP	125	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	126	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	127	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	128	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	129	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	130	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	131	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	132	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	133	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	201	1172	96	4.5	208	1	15	0	EB3-208D	
ERWP	202	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	203	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	204	586	48	4.5	208	1	15	0	EB3-208D	
ERWP	205	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	206	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	207	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	208	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	209	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	210	1466	120	4.5	208	1	15	0	EB3-208D	
ERWP	211	586	48	4.5	208	1	15	0	EB3-208D	

- GENERAL NOTES:
1. REFER TO SCHEDULES GENERAL NOTES.
2. MODEL NUMBERS ARE RENTAL UNLESS OTHERWISE NOTED.

AIR TERMINAL UNIT WITH ELECTRIC COIL SCHEDULE																					
UNIT IDENTIFICATION				AIR FLOW				AIR				ELECTRICAL				MODEL NUMBER	KEYED NOTES	PBA Schedule ID			
DES.	NO.	INLET SIZE INCHES	AREA SERVED	UNIT SERVED FROM	COOLING MAXIMUM CFM	MINIMUM CFM	HEATING MAXIMUM CFM	MAXIMUM A.P.D. IN. W.G.	E.D.B. °F	L.D.B. °F	CAPACITY KW	CAPACITY MBH	NUMBER OF STAGES	VOLTS	PHASE				MCA	MOP	SCCR KA
TU	101	8Ø	B104 MEETING	ERU-5	380	145	180	0.75	55	73	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	102	6Ø	B119 CONFERENCE	ERU-5	150	80	150	0.75	55	76	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	103	6Ø	B105 ASST PRINCIPAL	ERU-5	125	80	125	0.75	55	80	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	104	6Ø	B106 PRINCIPAL	ERU-5	125	80	125	0.75	55	80	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	105	6Ø	B107 SPEECH	ERU-5	125	80	125	0.75	55	80	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	106	6Ø	B113 COUNSELING WAITING	ERU-5	200	80	150	0.75	55	76	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	107	6Ø	B108 PSYCHOLOGY	ERU-5	125	80	125	0.75	55	80	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	108	6Ø	B109 RECORDS & STORAGE	ERU-5	100	80	100	0.75	55	87	1.0	5.1	SCR	480	3	2.8	15.0	0	B	SDV	015
TU	109	6Ø	B112 COUNSELING	ERU-5	100	80	100	0.75	55	87	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	110	6Ø	B114 COUNSELING	ERU-5	100	80	100	0.75	55	87	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	111	6Ø	B129 OFFICE	ERU-5	100	80	100	0.75	55	87	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	112	6Ø	B124 WORKROOM	ERU-5	150	80	150	0.75	55	76	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	113	6Ø	B122 ZEN DEN	ERU-5	200	80	150	0.75	55	76	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	114	6Ø	B115 SOCIAL WORKER	ERU-5	100	80	100	0.75	55	87	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	115	6Ø	B116 CLINIC	ERU-5	100	80	100	0.75	55	87	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	116	6Ø	B102 WELCOME CENTER	ERU-5	300	90	200	0.75	55	87	2.0	6.8	SCR	480	3	3.3	15.0	0	B	SDV	015
TU	117	6Ø	B125 GALLERY	ERU-2	300	80	180	0.75	55	73	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	118	6Ø	B139 TEACHER COLLAB	ERU-2	300	80	200	0.75	55	87	2.0	6.8	SCR	480	3	3.3	15.0	0	B	SDV	015
TU	119	12Ø	B144 VISUAL ARTS	ERU-2	1120	785	1120	0.75	55	83	10.0	34.1	SCR	480	3	16.4	20.0	0	B	SDV	015
TU	120	8Ø	B126 PASSAGE	ERU-2	400	400	400	0.75	55	91	4.5	15.4	SCR	480	3	7.4	15.0	0	B	SDV	015
TU	121	12Ø	B135 STEM-TEACHING	ERU-2	1150	720	1150	0.75	55	78	8.5	29.0	SCR	480	3	13.9	15.0	0	B	SDV	015
TU	122	12Ø	B136 STEM TECH	ERU-2	950	480	700	0.75	55	80	5.5	18.8	SCR	480	3	9.0	15.0	0	B	SDV	015
TU	123	16Ø	C103 LIFE SKILLS	ERU-2	1780	1080	1080	0.75	55	84	10.0	34.1	SCR	480	3	16.4	20.0	0	B	SDV	015
TU	124	6Ø	C107 PRACTICE	ERU-2	160	80	160	0.75	55	75	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	125	6Ø	C108 PRACTICE	ERU-2	160	80	160	0.75	55	75	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	126	6Ø	C106 ENSEMBLE	ERU-2	230	135	180	0.75	55	73	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	127	6Ø	C109 ENSEMBLE	ERU-2	230	135	180	0.75	55	73	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	128	8Ø	D102 MEDIA CENTER	ERU-3	500	350	350	0.75	55	87	3.5	11.9	SCR	480	3	5.7	15.0	0	B	SDV	015
TU	129	6Ø	D105 SMALL GROUP	ERU-3	350	80	180	0.75	55	73	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	130	6Ø	D104 SMALL GROUP	ERU-3	350	80	180	0.75	55	73	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	131	6Ø	D108 OFFICE/STORAGE	ERU-3	100	80	100	0.75	55	87	1.0	3.4	SCR	480	1	2.8	15.0	0	B	SDV	015
TU	132	12Ø	D102 MEDIA CENTER	ERU-3	1480	920	920	0.75	55	83	8.0	27.3	SCR	480	3	13.1	15.0	0	B	SDV	015
TU	133	8Ø	F101 PASSAGE	ERU-8	550	400	550	0.75	55	84	5.0	17.1	SCR	480	3	8.2	15.0	0	B	SDV	015
TU	134	8Ø	F105 RESOURCE	ERU-8	500	300	370	0.75	55	89	4.0	13.6	SCR	480	3	6.6	15.0	0	B	SDV	015
TU	135	8Ø	F106 ESL	ERU-8	500	300	370	0.75	55	89	4.0	13.6	SCR	480	3	6.6	15.0	0	B	SDV	015
TU	136	12Ø	F138 ACTIVE LAB	ERU-8	1300	700	1300	0.75	55	79	10.0	32.4	SCR	480	3	16.4	20.0	0	B	SDV	015
TU	137	12Ø	F121 ACTIVE LAB	ERU-8	1200	700	1200	0.75	55	80	9.5	32.4	SCR	480	3	15.6	20.0	0	B	SDV	015
TU	138	12Ø	F109 LEARNING STUDIO	ERU-8	955	570	650	0.75	55	87	6.5	22.2	SCR	480	3	10.7	15.0	0	B	SDV	015
TU	139	16Ø	F115 LEARNING COMMONS	ERU-8	1800	1450	1450	0.75	55	79	11.0	37.5	SCR	480	3	18.0	20.0	0	B	SDV	015
TU	140	12Ø	F111 LEARNING STUDIO	ERU-8	955	570	650	0.75	55	87	6.5	22.2	SCR	480	3	10.7	15.0	0	B	SDV	015
TU	141	6Ø	F113 TEACHER COLLAB	ERU-8	350</																



REGISTRATION SEAL

CONSULTANT



PROJECT TITLE
NEW SMITH MIDDLE SCHOOL
Bid Package No. 03B

Troy School District
Troy, Michigan

DRAWING TITLE
TEMPERATURE CONTROLS

ISSUE DATES

06-18-2024 CONSTRUCTION DOCUMENTS

DATE: ISSUED FOR:

DRAWN DJT

CHECKED KLH

APPROVED SVM

PROJECT NO.

22102

DRAWING NO.

M8.2

SEQUENCE OF OPERATION

HEAT PUMP LOOP SYSTEM:

NOTE: ALL SETPOINTS, RESET SETPOINTS, DEADBANDS, DELAY TIMERS, MODE POINTS, ETC., INCLUDING TIME-OF-DAY HOURS OF OPERATION AND SETPOINTS DESCRIBED IN SEQUENCE SHALL BE ADJUSTABLE BY SYSTEM OPERATORS. APPROPRIATE DEADBANDS SHALL BE USED TO PREVENT SHORT CYCLING SITUATIONS. ALL MOTOR CONTROL SWITCHES SHALL BE IN "AUTO" POSITION. PROVIDE CONTROL STATEMENTS TO PREVENT "LOOP WINDUP".



- HEAT PUMP LOOP SYSTEM SHALL BE ACTIVATED FOR CONTINUOUS OPERATION EYAR ROUND.
- HEAT PUMP LOOP (HPL) ORC PUMPS CP-3 & CP-4 SHALL HAVE START/STOP CAPABILITY FROM THE DDC SYSTEM. ONE OF THE TWO PUMPS SHALL BE ACTIVATED BY DDC AS "LEAD" TO OPERATE CONTINUOUSLY. THE OTHER WILL SERVE AS "STANDBY" PUMP.
- DDC SHALL ALTERNATE HPL CP OPERATION AT THE BEGINNING OF EACH MONTH - OPERATOR SELECTABLE.
- DDC SHALL MONITOR OPERATING STATUS OF EACH HPL CP. UPON "LEAD" PUMP FAILURE, DDC SHALL ACTIVATE FAILURE ALARM AND AUTOMATICALLY START THE "STANDBY" PUMP. DDC SHALL TOTALIZE EACH PUMP'S RUN TIME HOURS OF OPERATION.
- VFC COMMON FAILURE ALARM FOR EACH HPL CP SHALL BE MONITORED BY DDC THRU VARIABLE FREQUENCY CONTROLLER (VFC) INTERFACE.
- DDC SHALL MODULATE THE VFC OF THE "ACTIVE" HPL CP TO MAINTAIN LOOP DIFFERENTIAL PRESSURE SETPOINT TO BE DETERMINED BY TAB CONTRACTOR. INITIAL SETPOINT SHALL BE 20 FEET HEAD DIFFERENTIAL PRESSURE.
- WHEN "ACTIVE" HPL CP SPEED IS REDUCED TO THE PUMP'S LOW FLOW LIMIT SETPOINT, BASED ON MFR'S PUMP CURVE, AND THE REMOTE DIFFERENTIAL PRESSURE (DP) IS ABOVE DP SETPOINT, DDC SHALL MODULATE THE HPL LOOP BYPASS VALVE TO ACHIEVE DP SETPOINT WHILE HPL CP SPEED MAINTAINS THE HPLS FLOW LOW LIMIT SETPOINT VIA HPL FLOW METER. WHEN HPL LOOP BYPASS VALVE MODULATES TO FULL CLOSED POSITION, AND DP IS LESS THAN DP SETPOINT, DDC MODULATES CP SPEED HIGHER TO MAINTAIN DP SETPOINT.
- THE HPL SUPPLY TEMPERATURE (T-1) SHALL BE MAINTAINED BETWEEN 70°F & 85°F BY DDC. THE FOLLOWING SETPOINTS SHALL BE USED TO ENABLE/DISABLE THE COOLING TOWER AND HHW SYSTEMS:
 - COOLING TOWER SYSTEM IS ENABLED WHEN T-1 RISES ABOVE 85°F.
 - COOLING TOWER SYSTEM IS DISABLED WHEN T-1 DROPS BELOW 80°F FOR A 30 MINUTE PERIOD.

COOLING TOWER (CT) CONTROL:

- CT FANS TF-1 & TF-2 SHALL HAVE START/STOP CAPABILITY FROM THE DDC SYSTEM. ONE OF THE TWO FANS SHALL BE ACTIVATED BY DDC AS "LEAD" TO OPERATE. THE OTHER WILL SERVE AS "LAG" PUMP.
- DDC SHALL MONITOR OPERATING STATUS OF EACH CT FAN. UPON "LEAD" CT FAN FAILURE, DDC SHALL ACTIVATE A FAILURE ALARM AND AUTOMATICALLY START THE "LAG" CT FAN. DDC SHALL TOTALIZE EACH FAN'S RUN TIME HOURS OF OPERATION.
- VFC COMMON FAILURE ALARM FOR CT FAN SHALL BE MONITORED BY DDC THRU RESPECTIVE VFC INTERFACE.
- WHEN CT SYSTEM IS ENABLED AND THE "LEAD" HPL CP IS PROVEN RUNNING VIA CURRENT SWITCH, DDC SHALL START THE CT SPRAY PUMP. START THE "LEAD" CT FAN, AND MODULATE "LEAD" CT FAN SPEED TO MAINTAIN CT LEAVING WATER (HPLS) TEMPERATURE SETPOINT OF 85°F. IF CT FAN SPEED DECREASES MINIMUM SPEED (BASED ON MFR. FAN CURVE) AND HPLS TEMPERATURE DROPS TO 80°F, DDC SYSTEM SHALL CYCLE "LEAD" CT FAN OFF UNTIL HPLR TEMPERATURE RISES ABOVE 85°F.
- UPON INCREASE IN HPLS TEMPERATURE, "LEAD" CT FAN SPEED MAY INCREASE TO 95% OF DESIGN SPEED. WHEN HPLS TEMPERATURE INCREASES ABOVE 90°F SETPOINT, DDC SHALL START THE "LAG" CT FAN. WHILE DECREASING "LEAD" CT FAN SPEED, DDC SHALL INCREASE "LAG" CT FAN SPEED, UNTIL BOTH FANS ARE CONTROLLED BY DDC AT THE SAME SPEED SIGNAL TO MAINTAIN HPLS TEMPERATURE SETPOINT OF 85°F. BOTH CT FANS MAY INCREASE TO MAXIMUM DESIGN SPEED TO MAINTAIN CT HPLS TEMPERATURE SETPOINT.

- UPON DECREASE OF HPLS TEMPERATURE BELOW 82°F SETPOINT, DDC SHALL RAMP BOTH CT FANS DOWN TO 45% DESIGN SPEED SIGNAL. UPON FURTHER DROP IN HPLS TEMPERATURE, DDC SHALL COMMAND THE "LAG" CT FAN OFF AND MAINTAIN HPLS TEMPERATURE SETPOINT WITH THE "LEAD" CT FAN.
- DDC SHALL MONITOR COOLING TOWER SPRAY PUMP OPERATION THRU CURRENT SWITCH. UPON PUMP FAILURE, DDC SHALL PROVIDE AN ALARM.
- WHEN COOLING TOWER IS DISABLED, DDC SHALL DEACTIVATE SPRAY PUMP.
- BASIN HEATER SHALL BE CONTROLLED BY PACKAGED THERMOSTAT. BASIN HEATER SHALL BE DISABLED THRU HARDWIRED CUT-OUT INTERLOCK WHENEVER SPRAY PUMP IS ACTIVATED.
- CT BASIN LEVEL IS CONTROLLED BY MFR'S BASIN WATER LEVEL CONTROL AND MAKE-UP WATER VALVE.
- DDC SHALL ENABLE THE HOT WATER HEATING (HHW) SYSTEM 24/7 YEAR-ROUND. MFR'S OA TEMP SENSOR SHALL BE WIRED ONLY IF THE BOILER SEQUENCING PANEL REQUIRES THE SENSOR INPUT FOR OPERATION. OTHERWISE IT IS NOT REQUIRED.
- THE BOILER SEQUENCING PANEL SHALL ACTIVATE OR DEACTIVATE BOILERS AND CONTROL BOILER STAGES/FIRING RATES AS REQUIRED TO MAINTAIN HPLS TEMPERATURE (T-1) SETPOINT OF 50°F.
- HHW SYSTEM IS DISABLED WHEN T-1 RISES ABOVE 55°F FOR A 30 MINUTE PERIOD WHEN OUTSIDE AIR TEMPERATURE IS GREATER THAN 55°F.
- BOILER ORC PUMPS CP-1 & CP-2 SHALL HAVE START/STOP CAPABILITY FROM THE RESPECTIVE BOILERS LOCAL CONTROL PANEL.
- THE BOILER SEQUENCING PANEL SHALL INCLUDE OPERATOR SELECTABLE BOILER LEAD/LAG OPERATION OR FIRST ON/FIRST OFF OPERATION.
- WHENEVER A BOILER CIRCUIT IS ACTIVATED, ITS RESPECTIVE ORC PUMP SHALL BE ACTIVATED BY FACTORY WIRED PUMP RELAY. BOILER SHALL NOT FIRE UNTIL FLOW IS PROVEN BY FLOW SWITCH.
- WHENEVER A BOILER IS DEACTIVATED, A BOILER SYSTEM CONTROLLED TIME DELAY SHALL KEEP PUMP RUNNING FOR A FEW MINUTES (TIME BASED ON BOILER MANUFACTURER RECOMMENDATION) TO DISSIPATE HEAT FROM THE DEACTIVATED BOILER.
- EACH BOILER SAFETY CONTROLS SHALL INCLUDE AN AUTO-RESET HI-LIMIT (BOILER OPERATOR) WITH SETPOINT AND A MANUAL-RESET HI-LIMIT WITH SETPOINT BASED ON BOILER SUPPLIER'S RECOMMENDATIONS.
- DDC SHALL MONITOR BOILER RUN STATUS AND COMMON ALARM FOR EACH BOILER THROUGH DRY CONTACTS AVAILABLE IN RESPECTIVE BOILER CONTROL PANEL.
- FOR DIAGNOSTIC PURPOSES, DDC SHALL MONITOR EACH BOILER'S SUPPLY TEMPERATURE BOILER COMMON HEADER SUPPLY AND RETURN, AND HPL SUPPLY AND RETURN TEMPERATURES.
- WHEN ONE OF THE REMOTE BOILER SHUTDOWN SWITCHES IS PUSHED, BURNER CONTROLS FOR ALL BOILERS SHALL BE DE-ENERGIZED THRU HARDWIRED INTERLOCK. DDC SHALL MONITOR SWITCH CIRCUIT AND ACTIVATE ALARM WHEN REMOTE BOILER SHUTDOWN CONDITION OCCURS.
- WHEN EACH COOLING TOWER'S VIBRATION SWITCH ALARM IS SENSED, DDC SHALL SHUTDOWN THE RESPECTIVE TOWER IN AN ORDERLY MANNER AND PROVIDE THE BAS WITH AN ALERT THAT "SYSTEM CAPACITY IS REDUCED." VIBRATION SWITCH SHALL BE HARDWIRED INTERLOCKED TO THE RESPECTIVE TOWER'S VFC SAFETY CIRCUIT.
- DDC SHALL MONITOR GLYCOL FILL STATION AND PROVIDE AN ALARM ON LOW PRESSURE.

INDICATED EQUIPMENT AND DDC/AUXILIARY PANELS SHALL HAVE POWER FROM EMERGENCY POWER PANELS.

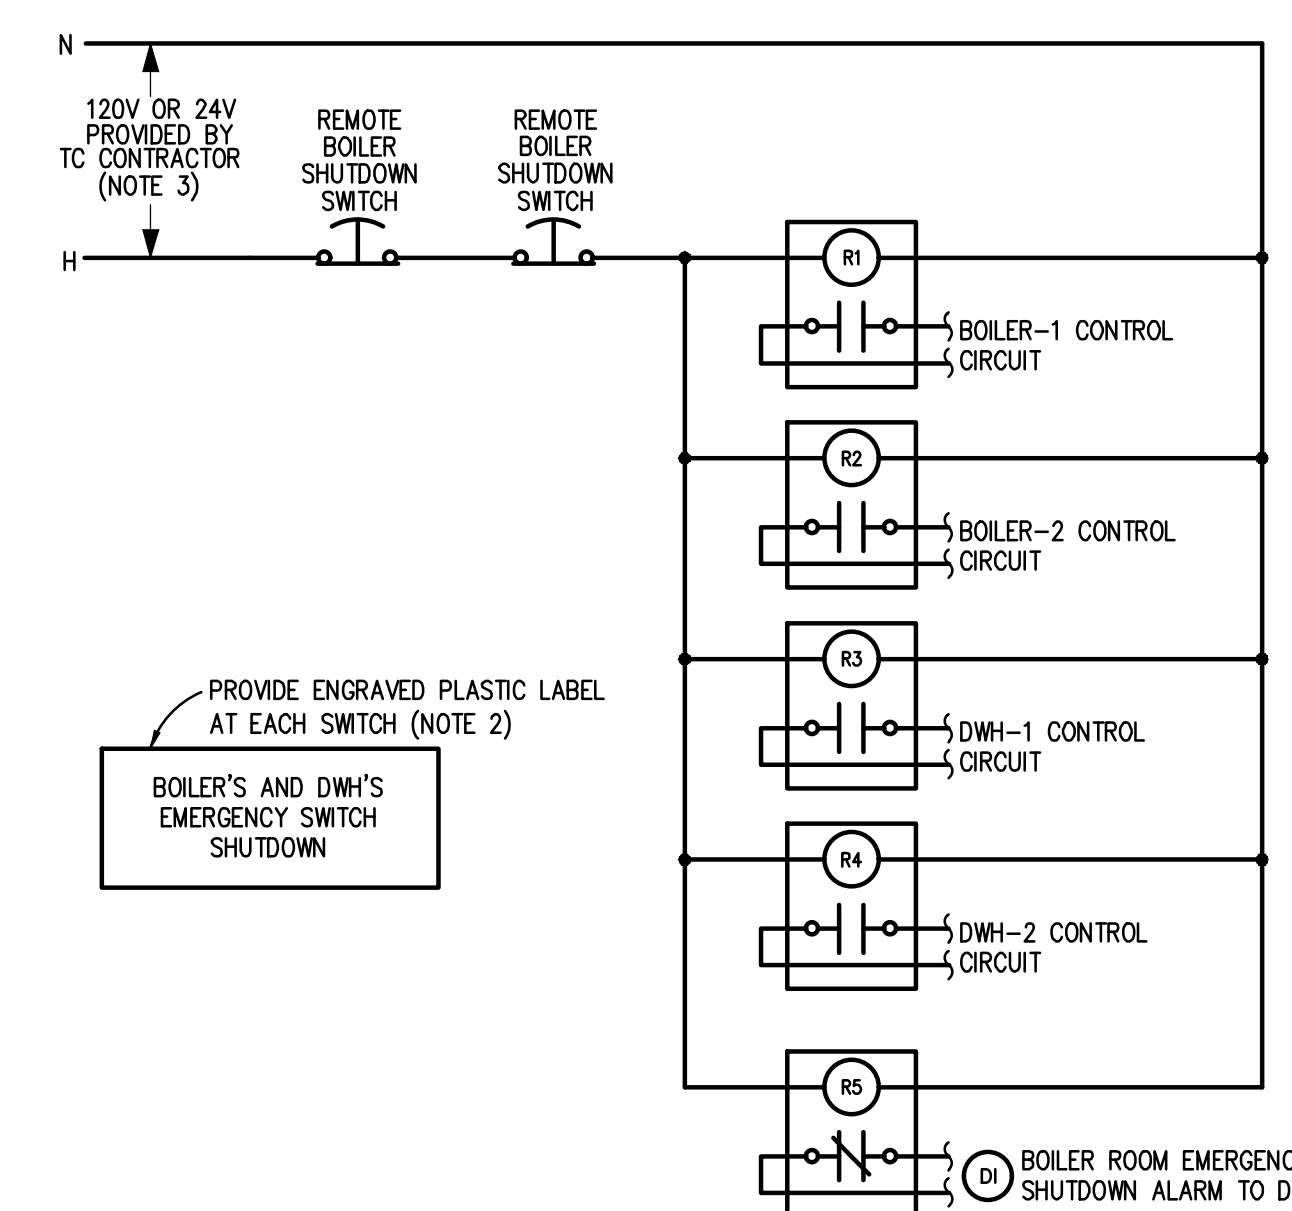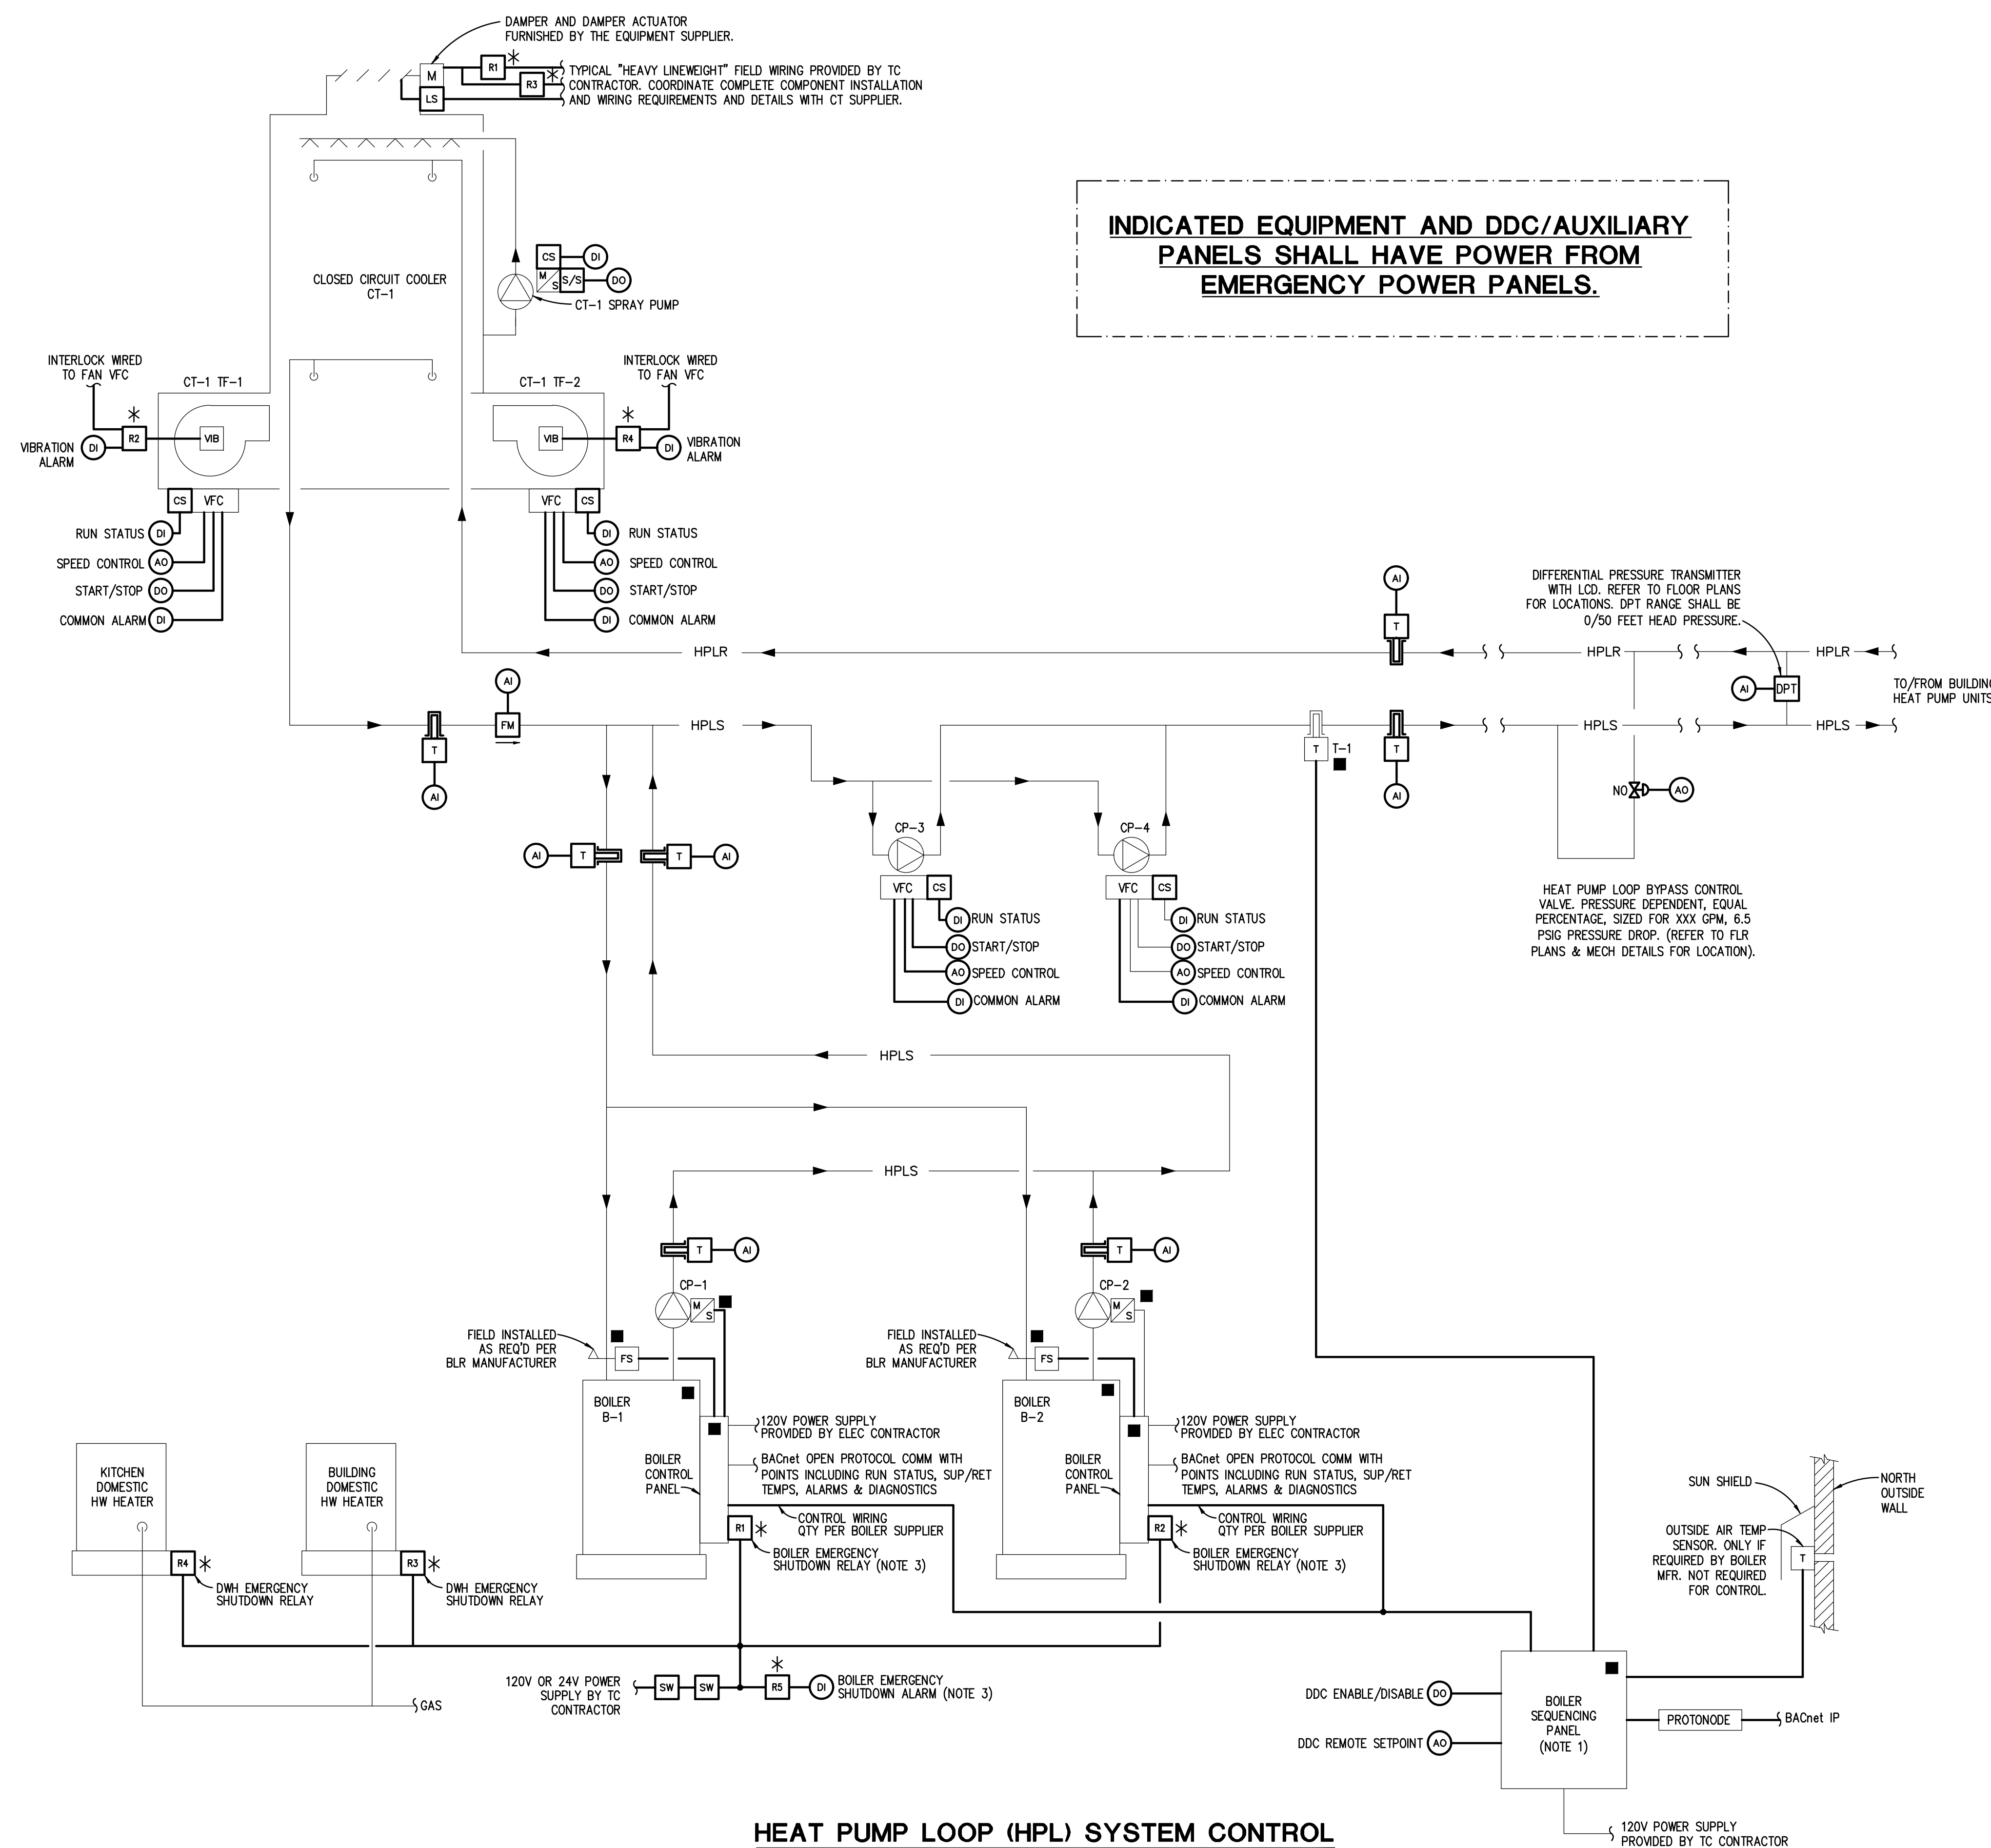

REMOTE BOILER ROOM EMERGENCY SHUTDOWN WIRING

- NOTES:
- LOCATE SWITCH AT EACH ENTRANCE OUTSIDE OF ROOM IF POSSIBLE; LOCATE JUST INSIDE ENTRANCE FOR EXTERIOR WALLS. REFER TO FLOOR PLANS FOR ENTRY LOCATIONS AND FIELD VERIFY INSTALLATION REQUIREMENTS.
 - TC CONTRACTOR SHALL PROVIDE SIGN (NAME PLATE) TO BE PLACED DIRECTLY ABOVE OR BELOW EACH PUSHBUTTON SWITCH THAT READS: "EMERGENCY BOILER SHUTDOWN". COORDINATE LOCATION WITH ALL OTHER TRADES.
 - TC CONTRACTOR SHALL SUPPLY POWER TO EMERGENCY CIRCUIT PUSHBUTTONS AND CONTROL RELAYS. REFER TO ELECTRICAL PANEL SCHEDULES AND COORDINATE WITH ELECTRICAL CONTRACTOR AS NECESSARY.
 - TC CONTRACTOR SHALL WIRE BOILERS' CONTROL CIRCUITS (POWER FROM SECONDARY SIDE OF CONTROL TRANSFORMERS) AND DOMESTIC HOT WATER HEATERS' SHUTDOWN CIRCUIT THRU NORMALLY OPEN RELAY CONTACTS. TC CONTRACTOR SHALL COORDINATE EXACT WIRING AND TERMINATION REQUIREMENTS WITH BOILER MANUFACTURER.
 - TC CONTRACTOR SHALL MOUNT SHUTDOWN CONTROL RELAYS IN AUXILIARY CONTROL PANEL.
 - TC CONTRACTOR SHALL PROVIDE PUSHBUTTON SWITCH (PUSH TO LATCH - TURN KEY TO RELEASE) WITH MUSHROOM HEAD OPERATOR, FLIP-UP PLASTIC GUARD, AND NORMALLY CLOSED (NC) CONTACTS. PROVIDE WITH PROPER ENCLOSURE.
- SEQUENCE OF OPERATION:
- UNDER NORMAL OPERATING CONDITIONS THE CIRCUIT SHALL BE ENERGIZED AND THE RELAY'S NORMALLY OPEN (NO) CONTACTS SHALL BE CLOSED. WHEN A SWITCH IS PUSHED (LATCHED) THE RELAY CONTACTS SHALL OPEN AND INTERRUPT BOILERS' CONTROL CIRCUIT AND DOMESTIC HOT WATER HEATERS' SHUTDOWN CIRCUIT. WHEN THE KEY IS TURNED TO RELEASE THE SWITCH, THE RELAYS SHALL BE ENERGIZED AND ITS NORMALLY OPEN CONTACTS SHALL CLOSE, RE-ENERGIZING ALL CONTROL CIRCUITS.
 - DDC SHALL ACTIVATE AN ALARM WHEN A REMOTE SWITCH HAS BEEN PUSHED.

HEAT PUMP LOOP (HPL) SYSTEM CONTROL

- NOTES:
- INDICATED COMPONENT FURNISHED BY BOILER SUPPLIER AND INSTALLED BY TC CONTRACTOR. DEPENDING ON BOILER MANUFACTURER, THE BOILER SEQUENCING FUNCTION MAY RESIDE WITH THE BOILER CONTROLLER THAT IS DESIGNATED AS THE "MASTER".
 - COORDINATE ALL WIRING AND TERMINATIONS WITH BOILER SUPPLIER.
 - TC CONTRACTOR SHALL PROVIDE BOILER ROOM EMERGENCY SHUTDOWN COMPONENTS AND WIRING. REFER TO REMOTE BOILER ROOM EMERGENCY SHUTDOWN WIRING DIAGRAM.
 - * INDICATES TEMPERATURE CONTROL PANEL MOUNTED COMPONENT.
 - TYPICAL "HEAVY LINEWEIGHT" FIELD WIRING PROVIDED BY TC CONTRACTOR. COORDINATE COMPLETE COMPONENT INSTALLATION AND WIRING REQUIREMENTS AN DETAILS WITH EQUIPMENT SUPPLIER.

GLYCOL FILL STATION MONITORING


- FOR HHW SYSTEM
- NOTE:
- PUMP CONTROL PRESSURE SWITCH AND ASSOCIATED CONTROL WIRING ARE PROVIDED WITH GLYCOL FILL STATION.
 - PRESSURE SWITCH FOR ALARM MONITORING SHALL BE FURNISHED BY TC CONTRACTOR AND INSTALLED BY MECHANICAL CONTRACTOR.
 - DRY CONTACTS FOR REMOTE MONITORING OF LOW TANK RESERVE ALARM PROVIDED WITH GLYCOL FILL STATION.

g:\2023\2023-0154-00\CAD\2023-0154-M8-CP.dwg, M8.2, 6/17/2024 12:49:00 PM, Rachael L. Wilson, None, 0309448, Peter Basso Associates, Inc.

ELECTRICAL SYMBOL LIST (NOTE: SOME SYMBOLS AND ABBREVIATIONS SHOWN MAY NOT APPLY TO THIS PROJECT.)

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
X (NL)	X DENOTES FIXTURE TYPE (NL INDICATES NIGHT LIGHT)	TWC	TWO-WAY COMMUNICATION SYSTEM CALL STATION	CP	CONTROL PANEL	F	MANUAL FIRE ALARM BOX	SB	SMOKE DETECTOR
[]	LIGHTING FIXTURE	TWCD	TWO-WAY COMMUNICATION SYSTEM AUTO DIALER	M	MOTOR	MD	MOTION DETECTOR	DD	DUCT SMOKE DETECTOR
[]	DIRECT/INDIRECT LIGHTING FIXTURE	TWCA	TWO-WAY COMMUNICATION SYSTEM ANNUNCIATOR & COMMUNICATION PANEL	VFC	VARIABLE FREQUENCY CONTROLLER	DK	SECURITY KEY SWITCH	CD	CARBON MONOXIDE DETECTOR
[]	FILL DENOTES EMERGENCY LIGHTING FIXTURE	TWCP	TWO-WAY COMMUNICATION SYSTEM POWER SUPPLY WITH BATTERY BACK-UP	MC	MAGNETIC CONTROLLER	KP	KEY PAD	RT	REMOTE TEST STATION (FOR DUCT DETECTOR)
[]	LIGHTING FIXTURE	TWCDP	TWO-WAY COMMUNICATION SYSTEM AUTO DIALER POWER SUPPLY WITH BATTERY BACK-UP	MC	COMBINATION MAGNETIC CONTROLLER	CR	CARD READER	TD	THERMAL DETECTOR
[]	WALL MOUNTED LIGHTING FIXTURE	RGP	REMOTE GENERATOR ANNUNCIATOR PANEL	NS	NON-FUSIBLE DISCONNECT SWITCH	DB	DURESS PUSH BUTTON STATION	BD	PROJECTED BEAM DETECTOR
[]	LIGHTING FIXTURE	ATS	AUTOMATIC TRANSFER SWITCH	FS	FUSIBLE DISCONNECT SWITCH	DE	DELAYED EGRESS	EA	FIRE ALARM BELL
[]	RECESSED OR SURFACE MOUNTED DIRECTIONAL LIGHTING FIXTURE	UPS	UNINTERRUPTIBLE POWER SUPPLY	CB	ENCLOSED CIRCUIT BREAKER	REX	REQUEST TO EXIT STATION	FA	FIRE ALARM AUDIBLE NOTIFICATION APPLIANCE
[]	PENDANT LIGHTING FIXTURE	LVCS	LOW VOLTAGE CONTROL STATION	J	JUNCTION BOX	PP	AUTOMATIC DOOR PUSH PAD OPERATOR	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	WALL SCIENCE	CSX	SINGLE / DUPLEX RECEPTACLE OUTLET "X" INDICATES TYPE	H	HARD WIRE POWER CONNECTION	DO	DOOR OPERATOR	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	LIGHTING TRACK	CSX	SINGLE / DUPLEX RECEPTACLE OUTLET CONTROLLED BY AUTOMATIC CONTROL DEVICE / SYSTEM	G	GROUND ROD	DA	DOOR ACTUATOR	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	TRACK LIGHTING FIXTURE	CSX	QUAD RECEPTACLE OUTLET	GR	GROUND CONNECTION	AC	ACCESS CONTROL STATION	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	POLE MOUNTED LIGHTING FIXTURE	CSX	ABOVE COUNTER DUPLEX RECEPTACLE OUTLET (SIMILAR FOR TAMPER RESISTANT, CONTROLLED, QUADS, EMERGENCY, UPS, USB, AND GFCI RECEPTACLE OUTLETS)	HH	HANDHOLE	ACCP	ACCESS CONTROL CONTROL PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	POLE MOUNTED LIGHTING FIXTURE - POST TOP	CSX	DUPLEX GROUND FAULT CIRCUIT INTERRUPTER RECEPTACLE OUTLET	CS	CONDUIT SLEEVE WITH BUSHINGS LENGTH AS REQUIRED	ACPS	ACCESS CONTROL POWER SUPPLY	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	BOLLARD LIGHTING FIXTURE	CSX	DEAD FRONT GROUND FAULT CIRCUIT INTERRUPTER	CS	CONDUIT UP	CS	CIRCUIT BREAKER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	EMERGENCY LIGHTING UNIT	CSX	DUPLEX EMERGENCY RECEPTACLE OUTLET	CS	CONDUIT DOWN	CS	DRAWOUT CIRCUIT BREAKER MANUALLY OPERATED	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	EXIT LIGHTING FIXTURE WITH DIRECTIONAL ARROWS (SHADED AREA INDICATES FACE)	CSX	DUPLEX TAMPER RESISTANT RECEPTACLE OUTLET	CS	EMPTY BOX FOR FUTURE TELECOMMUNICATION OUTLET	CS	DRAWOUT CIRCUIT BREAKER ELECTRICALLY OPERATED	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	EXIT LIGHTING FIXTURE WITH DIRECTIONAL ARROWS (SHADED AREA INDICATES FACE)	CSX	QUAD TAMPER RESISTANT RECEPTACLE OUTLET	CS	EMPTY BOX FOR FUTURE TELECOMMUNICATION OUTLET MOUNTED 8" ABOVE COUNTERTOP	CS	SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	EXIT LIGHTING FIXTURE - WALL MOUNTED	CSX	DUPLEX UPS RECEPTACLE OUTLET	CS	TELECOMMUNICATION OUTLET "X" INDICATES TYPE	CS	AUTOMATIC OR MANUAL TRANSFER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	EXIT/EMERGENCY LIGHTING COMBO	CSX	DUPLEX RECEPTACLE OUTLET WITH 2 USB PORTS	CS	TELECOMMUNICATION OUTLET MOUNTED 8" ABOVE COUNTERTOP "X" INDICATES TYPE	CS	FUSE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	AUTOMATIC LOAD CONTROL RELAY	CSX	USB 4 PORT CHARGING STATION	CS	TELECOMMUNICATION CEILING MOUNTED OUTLET "X" INDICATES TYPE	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	BRANCH CIRCUIT EMERGENCY LIGHTING TRANSFER SWITCH	CSX	CEILING MOUNTED DUPLEX / QUAD RECEPTACLE OUTLET	CS	TELECOMMUNICATION BACKBOARD	CS	CURRENT TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	LIGHTING CONTROL DEVICE - REFER TO LIGHTING CONTROL SCHEDULE	CSX	MULTI-OUTLET SURFACE RACEWAY	CS	TELECOMMUNICATION GROUNDING BUS BAR	CS	POTENTIAL TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	ROOM CONTROL DESIGNATION - REFER TO LIGHTING CONTROL SCHEDULE	CSX	POWER POLE	CS	TELECOMMUNICATION MAIN GROUNDING BUS BAR	CS	LIGHTING ARRESTOR	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	SINGLE POLE TOGGLE SWITCH	CSX	WALL / CEILING MOUNTED SPECIAL RECEPTACLE OUTLET - REFER TO ELECTRICAL STANDARD SCHEDULES	CS	INTERCOM OUTLET	CS	PANELBOARD "X" INDICATES PANELBOARD NAME	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	TWO POLE TOGGLE SWITCH	CSX	MULTI-SERVICE DROP SEE ELECTRICAL DETAILS AND DIAGRAMS SHEET "X" INDICATES TYPE	CS	SPEAKER	CS	GROUND	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	3 WAY TOGGLE SWITCH	CSX	POKE-THROUGH ASSEMBLY "X" INDICATES TYPE	CS	SPEAKER - WALL MOUNTED	CS	STRESS CONE TERMINATION	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	4 WAY TOGGLE SWITCH	CSX	FLOOR SERVICE FITTING "X" INDICATES TYPE	CS	MICROPHONE	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	KEY OPERATED SWITCH	CSX	ACCESS FLOOR SERVICE FITTING "X" INDICATES TYPE	CS	VOLUME CONTROL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	3 WAY KEY OPERATED SWITCH	CSX	CORD REEL "X" INDICATES TYPE	CS	SIGNALING BELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	4 WAY KEY OPERATED SWITCH	CSX	DUAL SWITCHING FOR INNER/OUTER LAMPS OF FLUORESCENT LIGHT FIXTURES	CS	SINGLE FACE CLOCK - CEILING MOUNTED	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	DIMMER SWITCH	CSX	3-WAY DUAL SWITCHING FOR INNER/OUTER LAMPS OF FLUORESCENT LIGHT FIXTURES	CS	SINGLE FACE CLOCK - WALL MOUNTED	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	DIMMER OCCUPANCY SENSOR SWITCH	CSX	4-WAY DUAL SWITCHING FOR INNER/OUTER LAMPS OF FLUORESCENT LIGHT FIXTURES	CS	DOUBLE FACE CLOCK - CEILING MOUNTED	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	LOW VOLTAGE DIMMER SWITCH	CSX	DIGITAL TIME SWITCH	CS	DOUBLE FACE CLOCK - WALL MOUNTED	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	3 WAY DIMMER SWITCH	CSX	ILLUMINATED TOGGLE SWITCH FOR CONTROL OF LIGHTING ON CRITICAL POWER-ILLUMINATED WHEN SWITCH IS IN "OFF" POSITION	CS	DOUBLE FACE COMBINATION CLOCK/SPEAKER CEILING MOUNTED	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]	PILOT SWITCH	CSX	LOW VOLTAGE SWITCH	CS	DOUBLE FACE COMBINATION CLOCK/SPEAKER WALL MOUNTED	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX	OCCUPANCY SENSOR	CS	TIME CLOCK	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX	OCCUPANCY SENSOR - REFER TO ELECTRICAL STANDARD SCHEDULES	CS	CONTACTOR	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX	OCCUPANCY SENSOR - REFER TO ELECTRICAL STANDARD SCHEDULES - "X" INDICATES TYPE	CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	LOAD CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MOTOR CONTROL CENTER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TRANSFORMER	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	DISTRIBUTION PANEL	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	ADDRESSABLE CONTROL MODULE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	TAMPER SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	FLOW SWITCH	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	MAGNETIC DOOR RELEASE	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL	CS	BRANCH CIRCUIT PANEL BOARD	XX	FIRE ALARM VISUAL NOTIFICATION APPLIANCE
[]		CSX		CS	PHOTOCELL</				

THE FOLLOWING DIMENSION EQUALS ONE INCH WHEN PRINTED TO SCALE.

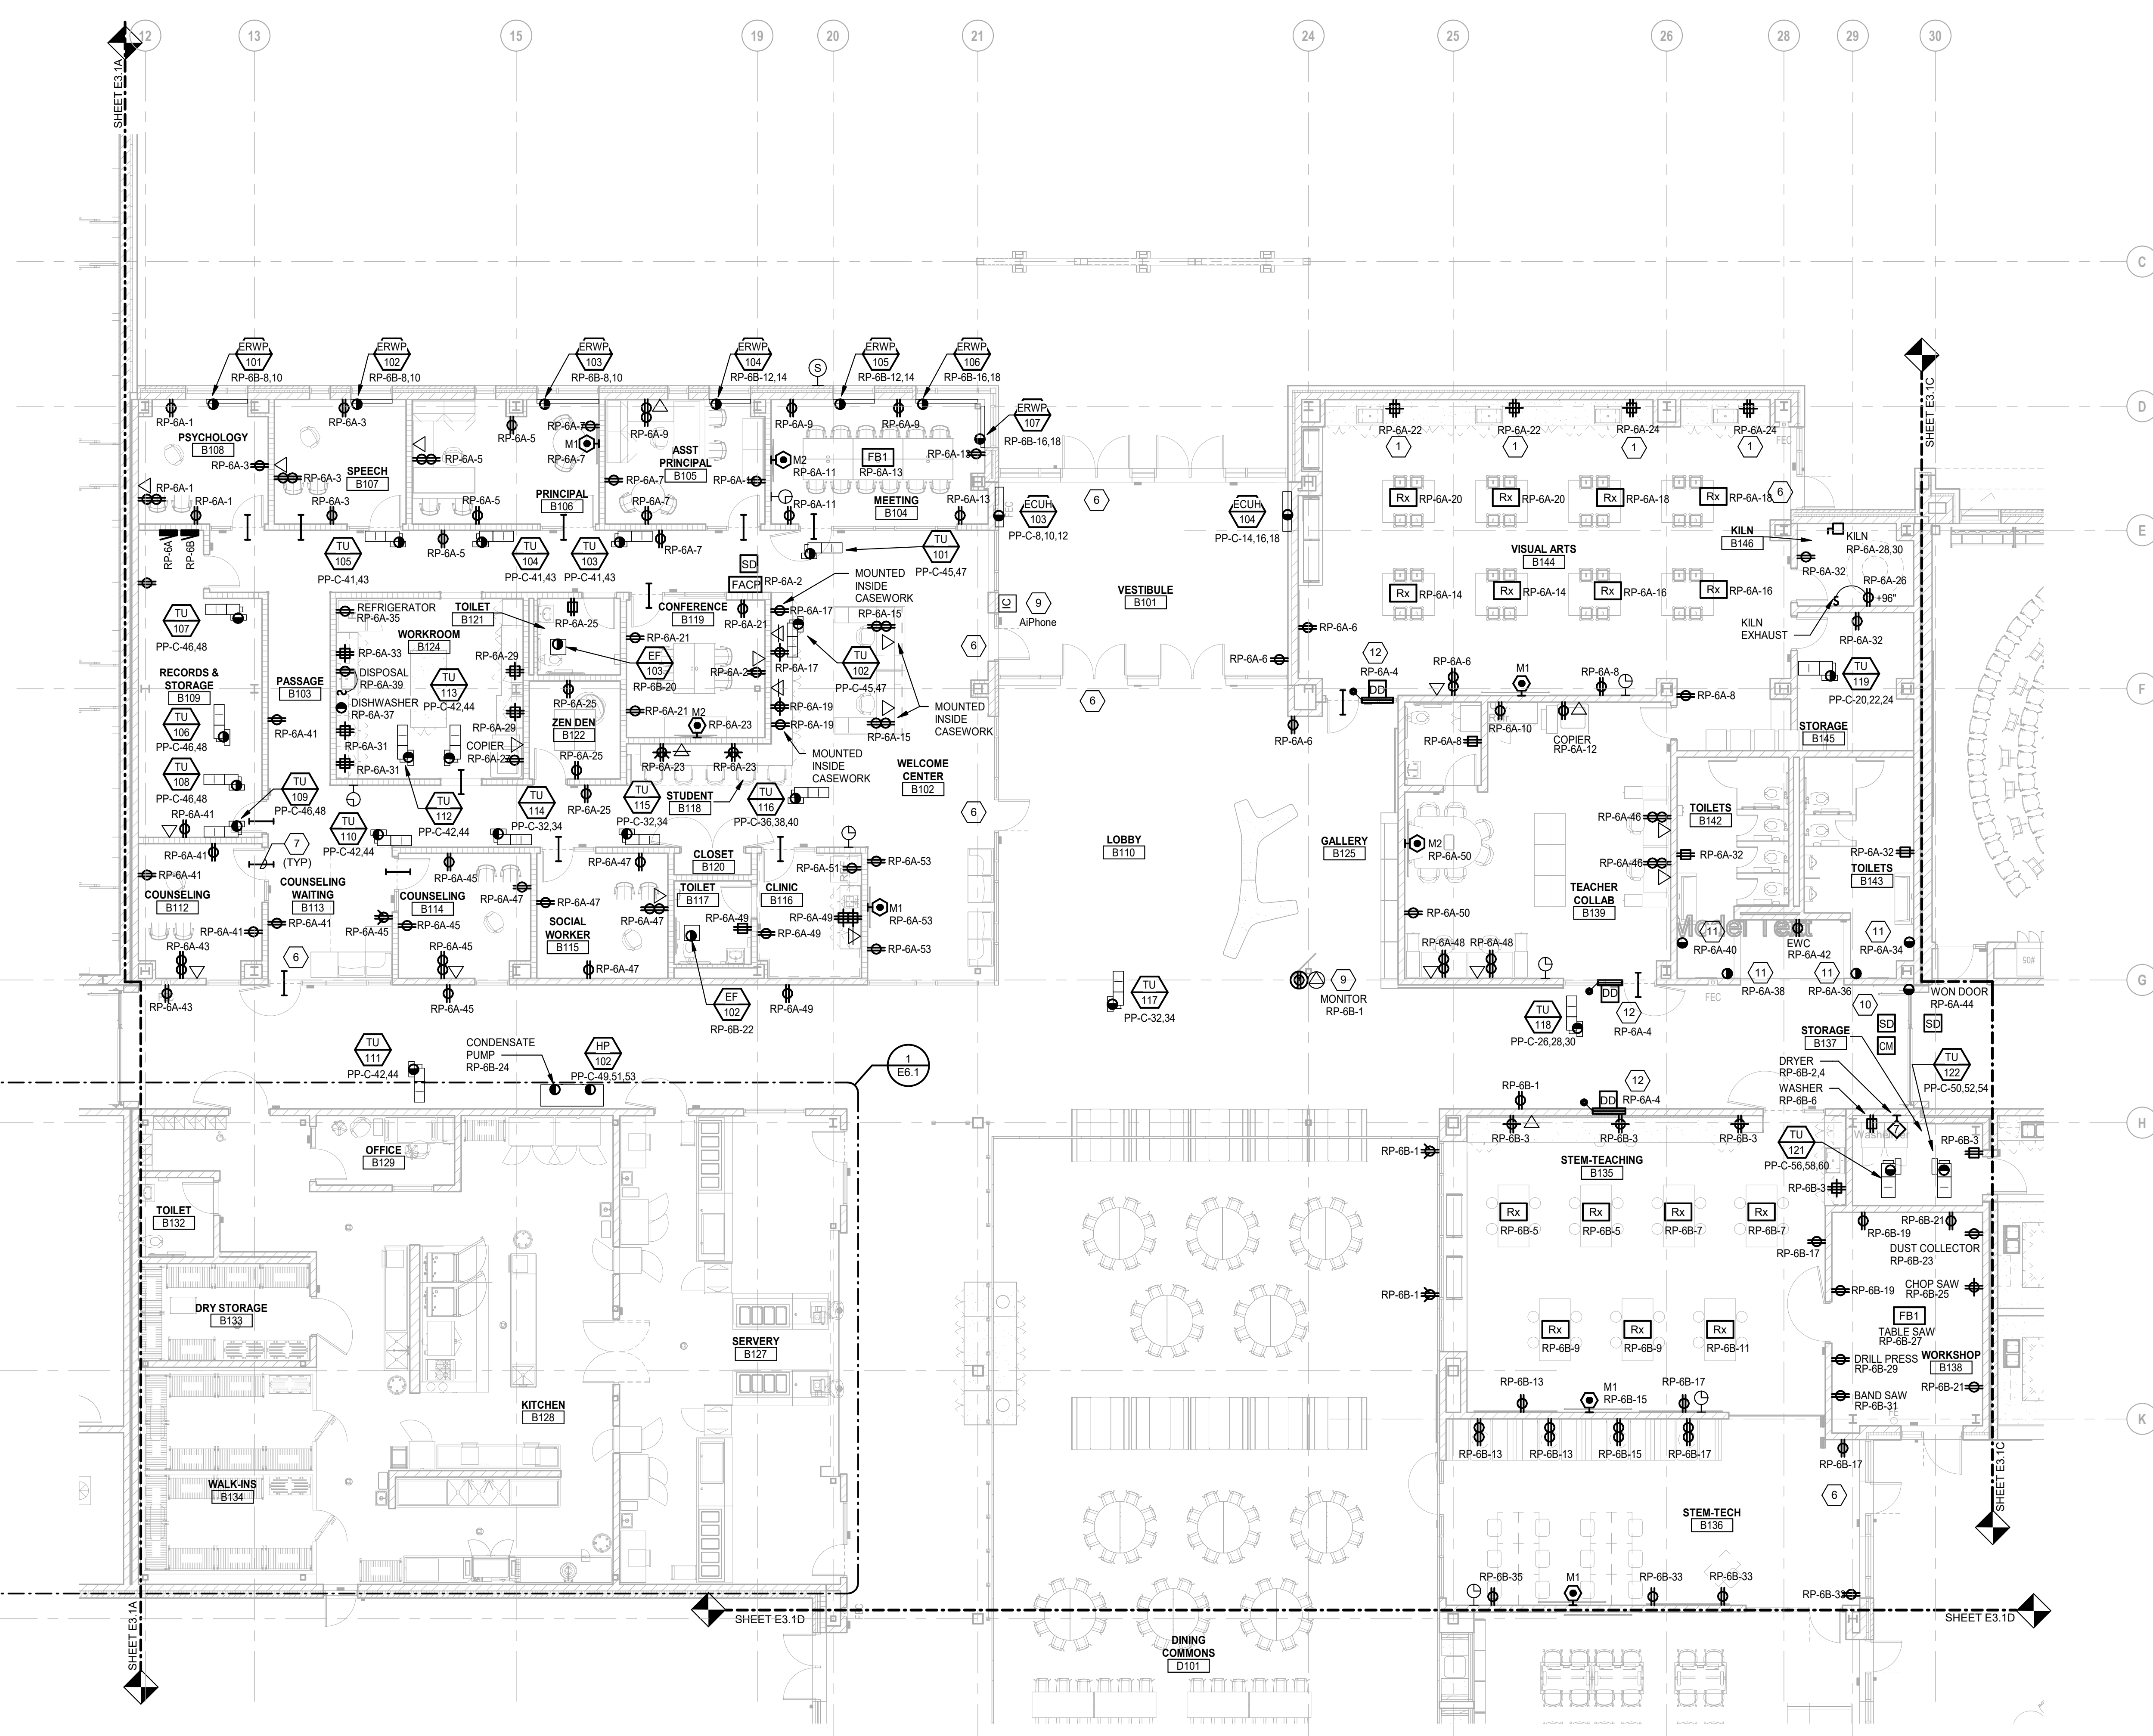

FIRST LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'B'
SCALE: 1/8" = 1'-0"

ELECTRICAL GENERAL NOTES:

- THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS. COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- INSTALL SYSTEMS SUCH THAT REQUIRED CLEARANCE AND SERVICE ACCESS SPACE IS PROVIDED AROUND ALL MECHANICAL AND ELECTRICAL EQUIPMENT, AND AROUND ANY COMPONENTS WHICH REQUIRE SERVICE ACCESS.
- COORDINATE AND PROVIDE ACCESS DOORS WITHIN INACCESSIBLE CEILING, SHAFT, AND CHASE AREAS FOR ALL COMPONENTS WHICH REQUIRE SERVICE ACCESS. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
- PROVIDE SUPPLEMENTARY STEEL AS REQUIRED FOR THE PROPER SUPPORT OF ALL SYSTEMS.
- TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH TRANSFORMER CIRCUIT SIZING SCHEDULE SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH MOTOR CIRCUIT SIZING SCHEDULES SHOWN ON "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS OTHERWISE NOTED.
- COORDINATE THE MOUNTING HEIGHTS OF DEVICES WITH ARCHITECTURAL ELEVATIONS AND THE TRADES INSTALLING THE WORK.
- COORDINATE EXACT LOCATIONS OF ALL FLOOR SERVICE FITTINGS AND POKE-THROUGH ASSEMBLIES WITH FINAL FURNITURE LAYOUT DRAWINGS.
- REFER TO MECHANICAL SCHEDULE SHEETS FOR ELECTRICAL REQUIREMENTS FOR MECHANICAL EQUIPMENT. PROVIDE ALL CONNECTIONS, STARTERS, DISCONNECTS, ETC. AS REQUIRED BY SCHEDULES AND WHERE NOTED ELSEWHERE. VERIFY REQUIREMENTS OF ALL MECHANICAL EQUIPMENT WITH SHOP DRAWINGS SUBMITTALS. NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN EQUIPMENT SUBMITTALS AND ELECTRICAL DRAWINGS. WHERE CIRCUIT SIZES ARE SHOWN ON THE ELECTRICAL DRAWINGS THAT DIFFER FROM WHAT IS INDICATED ON THE MECHANICAL SCHEDULES, PROVIDE THE CIRCUIT OF HIGHER AMPACITY.
- REFER TO TEMPERATURE CONTROLS SHEETS FOR REQUIRED FIRE ALARM CONTROL MODULES, DUCT SMOKE DETECTORS, AND MOTOR CONTROLLERS. PROVIDE ALL ACCESSORIES INDICATED.
- THE FIRE ALARM DEVICES SHOWN ON PLAN ARE A PARTIAL REPRESENTATION OF THE COMPLETE AND FUNCTIONAL FIRE ALARM SYSTEM IN ACCORDANCE WITH THE SPECIFICATIONS, DRAWINGS, AND ALL APPLICABLE CODES. THE FIRE ALARM VENDOR SHALL PROVIDE LAYOUT DRAWINGS INDICATING THE REQUIRED QUANTITIES AND LOCATIONS OF MANUAL PULL STATIONS, NOTIFICATION APPLIANCES, SMOKE AND HEAT DETECTORS, CONTROL MODULES, INTERFACE MODULES, MODULES FOR SPRINKLER FLOW AND TAMPER SWITCHES, ALL CONTROL PANELS, POWER SUPPLIES, AND ADDITIONAL DEVICES AND EQUIPMENT REQUIRED. COORDINATE WITH ARCHITECTURAL FINISHES AND REFLECTED CEILING PLANS, INCLUDING ADDITIONAL SMOKE AND HEAT DETECTORS REQUIRED FOR NON-SMOOTH CEILING APPLICATIONS. INCLUDE ALLOWANCES FOR ADJUSTMENT OF HEIGHT AS INDICATED ON THE TIME OF SUBMITTAL TO COORDINATE WITH BUILDING FINISHES AND OTHER CEILING ELEMENTS.
- REFER TO LIGHTING CONTROL SCHEDULE FOR ROOM CONTROL AND EMERGENCY LIGHTING CIRCUIT CONTROL REQUIREMENTS. DESIGNATION FOR ROOM IS INDICATED AS A LETTERED OVAL SYMBOL.
- CONNECT EXIST SIGNS TO EMERGENCY LIGHTING BRANCH CIRCUIT SERVICE THE AREA. CONNECT AHEAD OF ANY LIGHTING CONTROL DEVICE OR SYSTEM.
- PROVIDE SINGLE GANG JUNCTION BOX WITH 3/4" C. PULL STRING AND BUSHING TO ACCESSIBLE CEILING SPACE AT SPEAKER AND CLOCK LOCATIONS. COORDINATE MOUNTING HEIGHT WITH TECHNOLOGY CONTRACTOR.

CONSTRUCTION KEY NOTES:

- MOUNT RECEPTACLES HORIZONTALLY
- ELECTRICAL CONTRACTOR SHALL INSTALL 4" SQUARE JUNCTION BOX WITHIN 3'-0" OF ELECTRICAL BACKBOX WING UP IN CEILING SPACE. ALSO INSTALL 4" ROLL TWIST LOCK, SINGLE RECEPTACLE, PROVIDED BY WINCH MANUFACTURERS, INTO THE JUNCTION BOX.
- ELECTRICAL CONTRACTOR SHALL INSTALL ALL CONTROLS, PUSHBUTTONS, KEY SWITCHES ETC. (PROVIDED WITH EACH BASKETBALL BACKBOARD) FOR A COMPLETE OPERABLE SYSTEM. KEY SWITCHES GANGED IN Pairs IN ONE COVER PLATE TO CONTROL THE BACKSTOP SWING AND HEIGHT ADJUSTER.
- HEAT TRACE, BY OTHERS.
- DUCT SMOKE DETECTOR SHALL BE FURNISHED AND INSTALLED BY THE ELECTRICAL CONTRACTOR. COORDINATE MOUNTING LOCATION AND QUANTITY WITH THE MECHANICAL DUCTWORK CONTRACTOR. ELECTRICAL CONTRACTOR SHALL WIRE DUCT SMOKE DETECTOR SUPPLY/RETURN FAN MOTOR STARTER SO THAT UPON DETECTION OF SMOKE, THE SUPPLY/RETURN FAN WILL SHUT DOWN. THIS SHALL BE ACCOMPLISHED VIA THE FIRE ALARM CONTROL PANEL. PROVIDE ALL REQUIRED CONTROL MODULES AND RELAYS. COORDINATE WITH THE TEMPERATURE CONTROL/FIRE ALARM CONTRACTOR. PROVIDE WEATHER PROOF ENCLOSURES AS REQUIRED.
- REFER TO ARCHITECTURAL FLOOR PLANS, DOOR HARDWARE SCHEDULE ON ARCHITECTURAL DRAWINGS, ACCESS CONTROL SYSTEM SPECIFICATION SECTION AND ACCESS CONTROL DOOR DIAGRAM(S) ON E7 SERIES FOR RACEWAY AND BACK BOX REQUIREMENTS FOR DOOR OR BANK OF DOORS INDICATED. PROVIDE ALL RACEWAYS AND BACK BOXES REQUIRED. COORDINATE WITH DOOR HARDWARE AND SECURITY CONTRACTORS.
- PROVIDE 2" AND 1-1/4" O.D. CONDUITS FOR TECHNOLOGY AND AUXILIARY SYSTEM WIRE AS INDICATED. STUB CONDUITS FROM CEILING SPACE. PROVIDE PLASTIC BUSHINGS AT EACH END. PROVIDE REMOVABLE/RESEALABLE FIRE STOP PUTTY IN EACH CONDUIT AND FIRE STOP AROUND EACH CONDUIT. COORDINATE WITH TECHNOLOGY CONTRACTOR FOR EXACT LOCATION OF CONDUIT. PROVIDE MINIMUM OF 1" CONDUIT FOR ALL OTHER AREAS REQUIRING SLEEVES.
- PROVIDE 1/2" CONDUIT WITH PULL STRING AND BUSHINGS FOR TECHNOLOGY. ROUTE UNDER BUILDING AND TERMINATE AT EXTERIOR OF BUILDING.
- COORDINATE MOUNTING LOCATION WITH TECHNOLOGY CONTRACTOR.
- CONNECT FIRE ALARM DEVICES TO ELECTRIC COILING DOOR AND EXISTING FIRE ALARM SYSTEM. ROLL-UP DOOR SHALL CLOSE UPON ACTIVATION OF THE SMOKE DETECTORS ASSOCIATED WITH THE COILING FIRE DOOR. COORDINATE WITH COILING DOOR CONTRACTOR FOR ALL SMOKE DETECTORS AND CONTROL MODULES REQUIRED FOR A COMPLETE SYSTEM.
- HAND DRYERS FURNISHED BY OTHERS AND INSTALLED BY ELECTRICAL CONTRACTOR. COORDINATE MOUNTING HEIGHT WITH ARCHITECTURAL TRADES.
- SMOKE DAMPER DUCT SMOKE DETECTOR. SMOKE DETECTOR SHALL BE PROVIDED BY THE ELECTRICAL CONTRACTOR. COORDINATE INSTALLATION WITH MECHANICAL CONTRACTOR SO THAT UPON DETECTION OF SMOKE THE SUPPLY/RETURN FAN WILL SHUT DOWN. ELECTRICAL CONTRACTOR SHALL WIRE DUCT DETECTOR TO FIRE ALARM SYSTEM AND CIRCUIT DAMPER ACTUATOR. PROVIDE A 20A-1P SWITCH AT EACH ACTUATOR. CONTROL OF AIR HANDLING EQUIPMENT IS VIA THE FIRE ALARM CONTROL PANEL. PROVIDE ALL REQUIRED CONTROL MODULES AND RELAYS. COORDINATE WITH THE TEMPERATURE CONTROLS CONTRACTOR AND FIRE ALARM MANUFACTURER. DAMPER SHALL CLOSE UPON DETECTION OF SMOKE AND SHUT DOWN ASSOCIATED AIR HANDLER. DAMPER SHALL ALSO CLOSE UPON NORMAL SHUTDOWN OF AIR HANDLER.
- CARBON MONOXIDE DETECTOR. COORDINATE QUANTITY WITH FIRE MARSHAL.
- SCOREBOARD. COORDINATE EXACT LOCATION WITH ARCHITECT PRIOR TO ROUGH IN.
- WALL MOUNT TRANSFORMER.
- ELECTRIC RANGE. PROVIDE WALL MOUNTED GFCI MODULE ABOVE COUNTER.
- LIGHTING RELAY PANEL. COORDINATE WITH THEATRICAL CONSULTANT.



TMP ARCHITECTURE INC
1191 WEST SQUARE LAKE ROAD - BOX 289
BLOOMFIELD HILLS - MICHIGAN 48302
TEL: 248.338.6941 FAX: 248.338.0223
EM: INFO@TMPARCHITECTURE.COM

REGISTRATION SEAL


CONSULTANT

PBA
Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5666 Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2023.0154

PROJECT TITLE
NEW SMITH MIDDLE SCHOOL
Bid Package No. 03B

Troy School District
TROY, MI

DRAWING TITLE
FIRST LEVEL POWER AND AUXILIARY SYSTEMS PLAN - ZONE 'B'

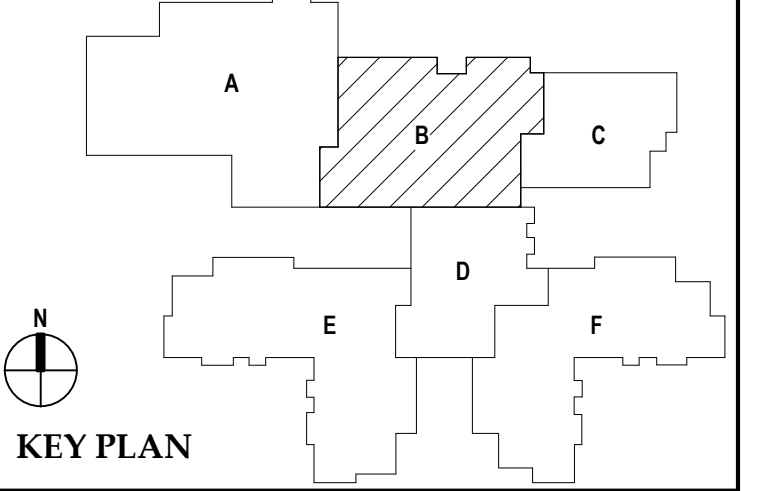

ISSUE DATES

DATE	ISSUED FOR:
06-16-2024	CONSTRUCTION DOCUMENTS
DATE:	ISSUED FOR:
DRAWN: DDB	
CHECKED: ZDB	
APPROVED: STP	

PROJECT NO.
22102
DRAWING NO.
E3.1B

g:\2023\2023-0154-00\CAD\2023-0154-00.dwg, E5.1, 6/17/2024 12:50:30 PM, Rachel L. Wilson, None_0.09448, Peter Basso Associates Inc.

CONSTRUCTION KEY NOTES:

- PORTABLE GENERATOR DOCKING STATION.
- LISTED 2 HOUR FIRE-RATED CONDUIT AND CABLING ASSEMBLY PER 700.10(D).
- SEPARATE VERTICAL SECTIONS PER 700.10(E)(6).
- PROVIDE GENERATOR PROTECTION RELAYS.
- PRE-PURCHASED EQUIPMENT COORDINATE WITH OWNER AND CONSTRUCTION MANAGER.

DIAGRAM GENERAL NOTES:

- THESE DRAWINGS REPRESENT THE GENERAL EXTENT AND ARRANGEMENT OF SYSTEMS, COORDINATE EXACT EQUIPMENT LOCATIONS, ELEVATIONS, AND FINAL CONNECTION REQUIREMENTS. PROVIDE EACH SYSTEM COMPLETE, INCLUDING ALL NECESSARY COMPONENTS, FITTINGS AND OFFSETS.
- FEEDER AND BRANCH CIRCUIT CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH THE "FEEDER AND BRANCH CIRCUIT SIZING SCHEDULE-GENERAL PURPOSE" ON THE "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS SPECIFICALLY NOTED OTHERWISE.
- TRANSFORMER SECONDARY CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH THE "TRANSFORMER CIRCUIT SIZING SCHEDULE-GENERAL PURPOSE" ON THE "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS SPECIFICALLY NOTED OTHERWISE.
- MOTOR CIRCUIT PROTECTION SHALL BE SIZED IN ACCORDANCE WITH THE MOTOR CIRCUIT SIZING SCHEDULES ON THE "ELECTRICAL STANDARD SCHEDULES DRAWING" UNLESS SPECIFICALLY NOTED OTHERWISE.
- BASIS OF DESIGN IS SQUARE D DISTRIBUTION EQUIPMENT AND ASCO TRANSFER SWITCHES. IF THE CONTRACTOR ELECTS TO PROVIDE EQUIPMENT FROM OTHER APPROVED MANUFACTURERS, THE CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE THE LAYOUT AND CLEARANCE REQUIREMENTS IN ALL SPACES CONTAINING ELECTRICAL EQUIPMENT AND PROVIDE EQUIPMENT MEETING THE SPECIFICATIONS AND ACHIEVING CODE REQUIRED CLEARANCES WITHIN THE SPACE PROVIDED.
- SELECTIVE COORDINATION (PER NEC ARTICLES 700.32 AND 701.27) IS BASED ON SQUARE D DISTRIBUTION EQUIPMENT AND ASCO TRANSFER SWITCHES. ELECTRICAL CONTRACTOR SHALL SUBMIT SELECTIVE COORDINATION STUDY WITH TIME CURRENT CHARACTERISTIC CURVES (AND TABLES FOR TESTED PAIR INSTANTANEOUS COORDINATION) FOR THE EMERGENCY SYSTEMS. ELECTRICAL CONTRACTORS SHALL RECEIVE APPROVED SHOP DRAWINGS BACK FROM ENGINEER OF RECORD PRIOR TO PURCHASING OR INSTALLING ANY ELECTRICAL DISTRIBUTION EQUIPMENT. BREAKERS MUST BE COORDINATED WITH AUTOMATIC TRANSFER SWITCHES. 3-CYCLE WITHSTAND RATING. ALTERNATE MANUFACTURERS SHALL MEET SELECTIVE COORDINATION CRITERIA AT NO ADDITIONAL COST TO THE PROJECT.
- VARIABLE FREQUENCY CONTROLLERS (VFC) FURNISHED BY MECHANICAL TRADES. ELECTRICAL CONTRACTOR SHALL INSTALL VFC, PROVIDE POWER FEEDER FROM DISTRIBUTION EQUIPMENT TO VFC AND PROVIDE POWER FEEDER FROM VFC TO MOTOR. REFER TO SPECIFICATIONS FOR APPLICATION OF VFC POWER CABLE FROM VFC TO MOTOR.



TMP ARCHITECTURE INC
1191 WEST SQUARE LAKE ROAD - BOX 289
BLOOMFIELD HILLS - MICHIGAN 48302
PH: 248-338-8841 FX: 248-338-0223
EM: INFO@TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 200
Troy, Michigan 48068-5276
Tel: 248-879-5666
Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 20230354

PROJECT TITLE
**NEW SMITH
MIDDLE SCHOOL**
Bid Package No. 03B

Troy School District
Troy, Michigan

DRAWING TITLE
ONE LINE DIAGRAM

ISSUE DATES

96-18-2024 CONSTRUCTION DOCUMENTS

DATE: ISSUED FOR:


DRAWN DDB

CHECKED ZDB

APPROVED STP

PROJECT NO.
22102

DRAWING NO.
E5.1

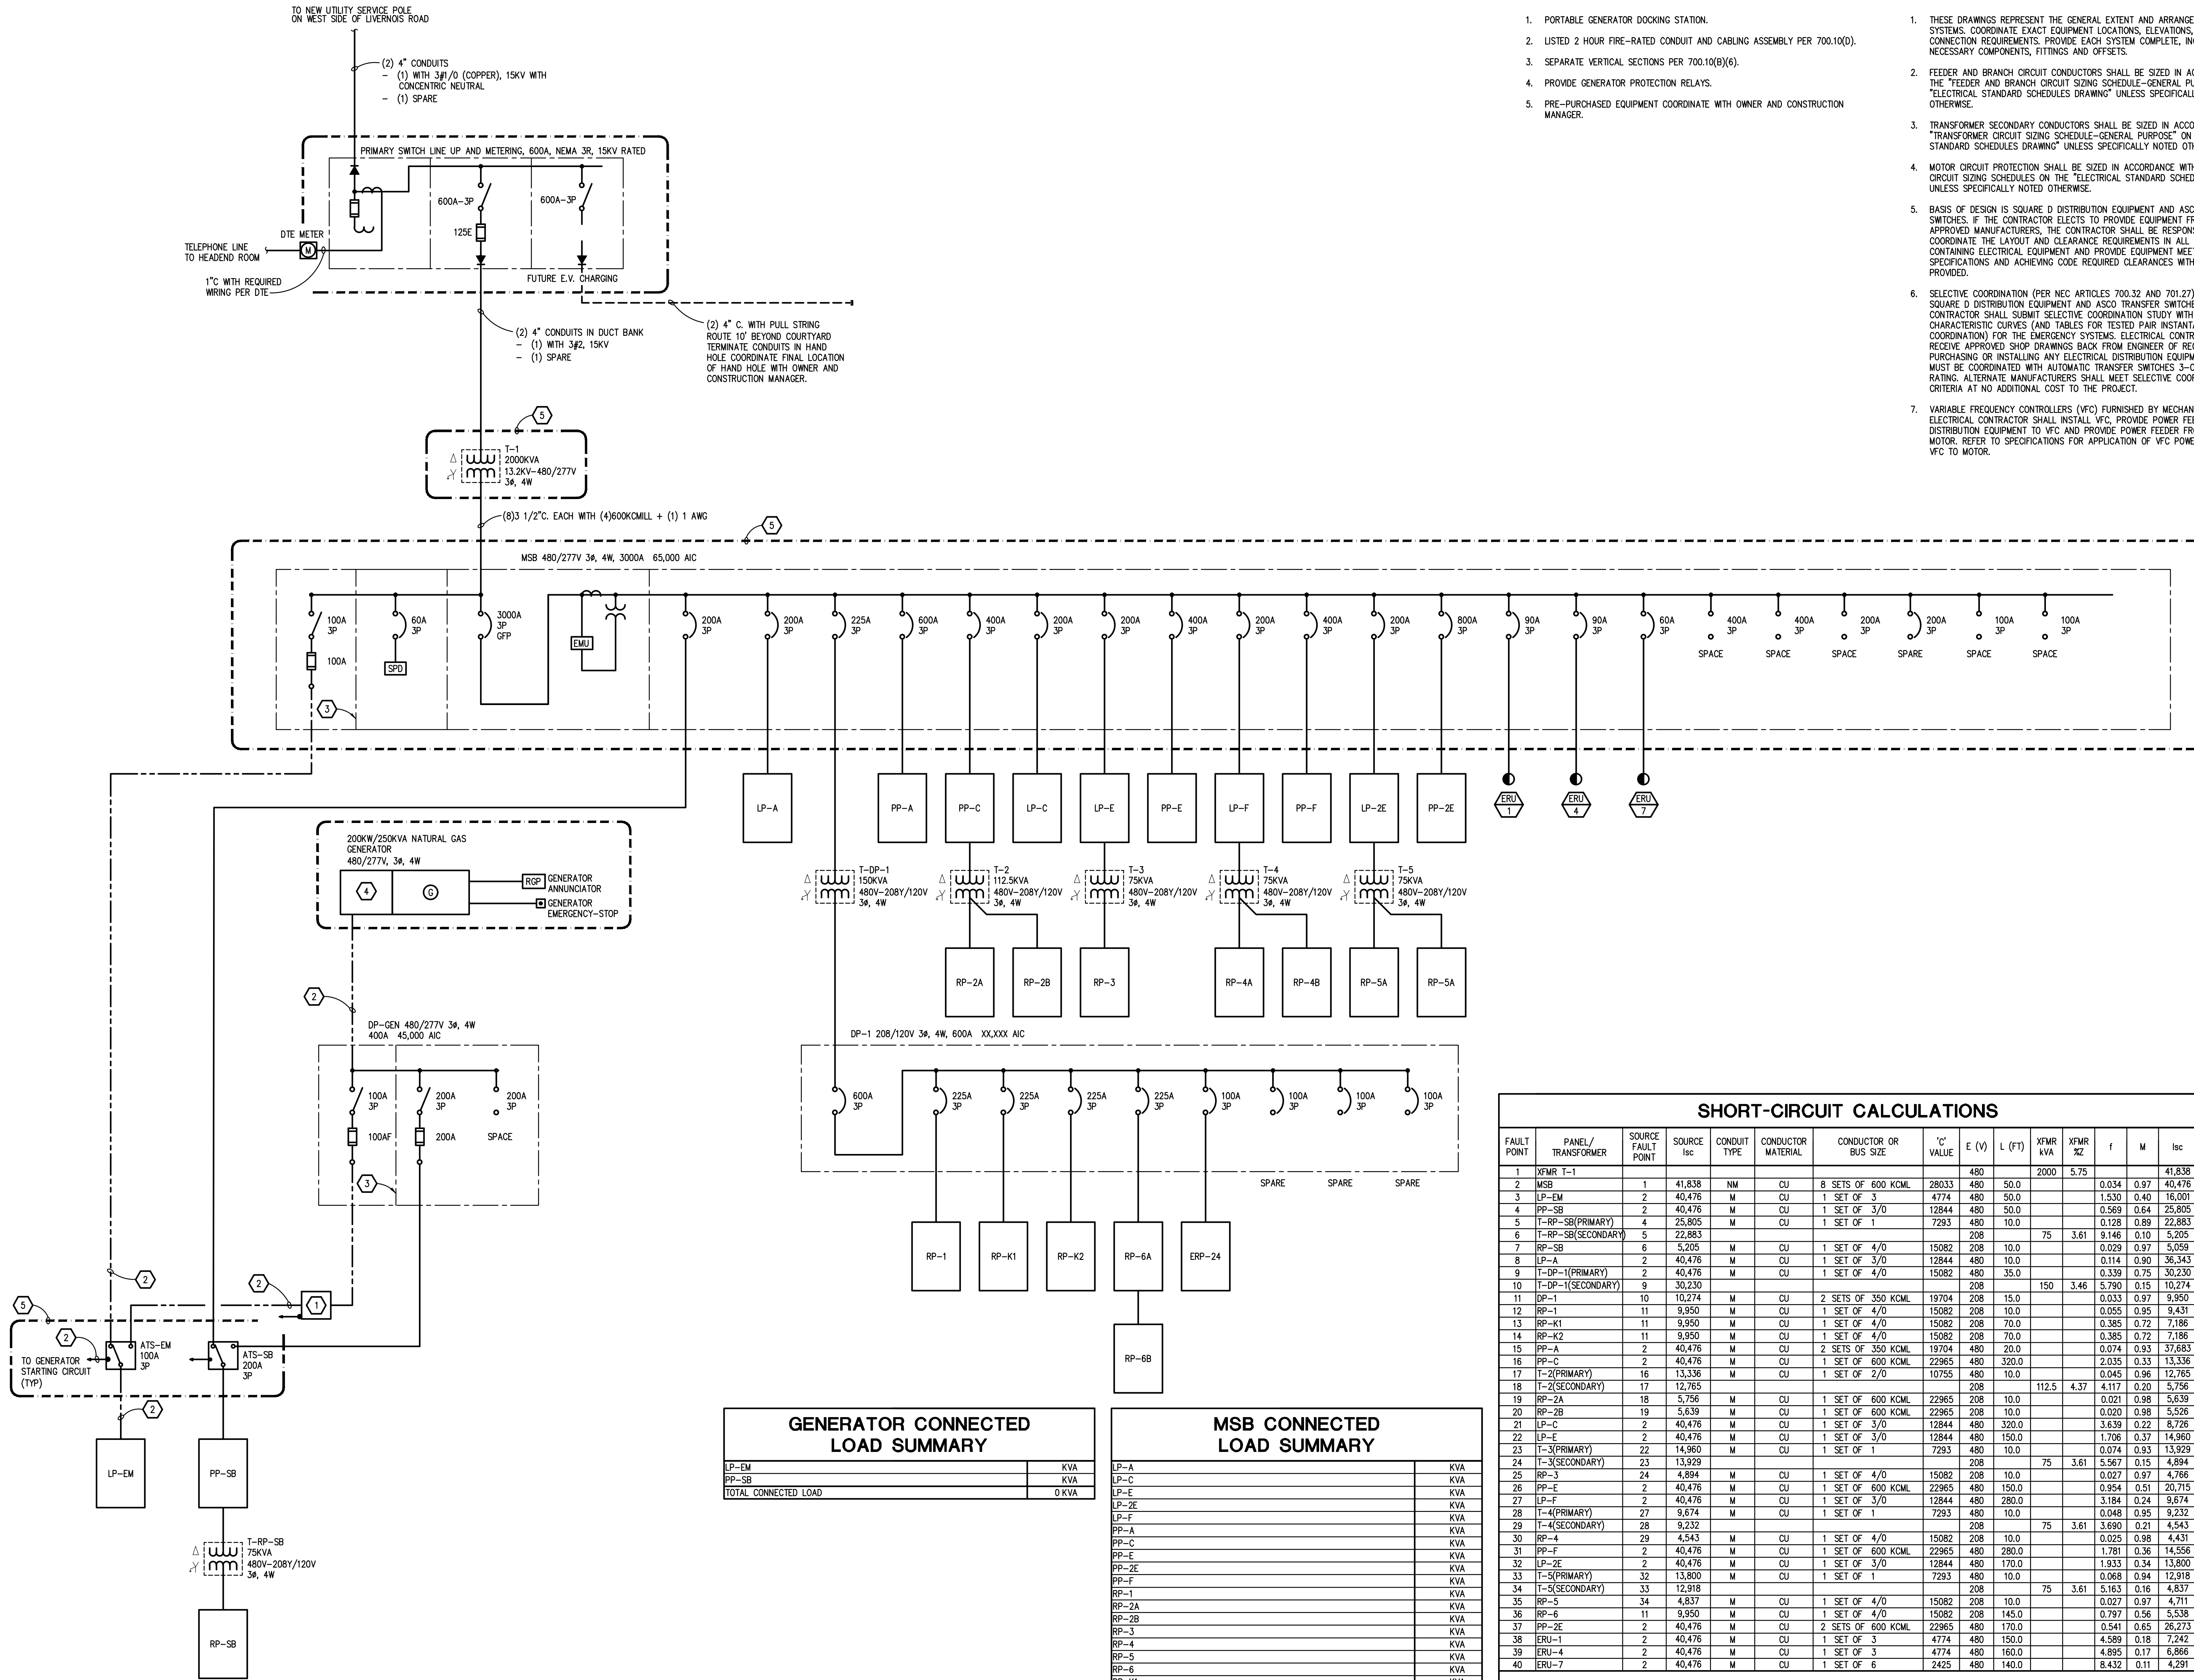

GENERATOR CONNECTED LOAD SUMMARY

LP-EM	KVA
PP-SB	KVA
TOTAL CONNECTED LOAD	0 KVA

MSB CONNECTED LOAD SUMMARY

LP-A	KVA
LP-C	KVA
LP-E	KVA
LP-F	KVA
LP-2E	KVA
PP-A	KVA
PP-C	KVA
PP-E	KVA
PP-F	KVA
PP-2E	KVA
RP-1	KVA
RP-2A	KVA
RP-2B	KVA
RP-3	KVA
RP-4	KVA
RP-5	KVA
RP-6	KVA
RP-K1	KVA
RP-K2	KVA
LP-EM	KVA
PP-SB	KVA
ERU-1	69.8 KVA
ERU-4	61.5 KVA
ERU-7	42.4 KVA
TOTAL CONNECTED LOAD	173.7 KVA

SHORT-CIRCUIT CALCULATIONS

FAULT POINT	PANEL/ TRANSFORMER	SOURCE FAULT POINT	SOURCE	CONDUIT TYPE	CONDUCTOR MATERIAL	CONDUCTOR OR BUS SIZE	C' VALUE	E (V)	L (FT)	XFMR KVA	XFMR %Z	f	M	Isc
1	XFMR T-1	1	41,838	NM	CU	8 SETS OF 600 KCMIL	28033	480	50.0	2000	5.75	0.034	0.97	41,838
2	MSB	2	40,476	M	CU	1 SET OF 3	4774	480	50.0			1.530	0.40	16,001
3	LP-EM	2	40,476	M	CU	1 SET OF 3/0	12844	480	50.0			0.569	0.64	25,805
4	PP-SB	2	40,476	M	CU	1 SET OF 3/0	12844	480	50.0			0.128	0.89	22,883
5	T-RP-SB(PRIMARY)	4	25,805	M	CU	1 SET OF 1	7293	480	10.0			0.128	0.89	22,883
6	T-RP-SB(SECONDARY)	5	22,883	M	CU	1 SET OF 1	7293	480	10.0			0.128	0.89	22,883
7	RP-SB	6	5,205	M	CU	1 SET OF 4/0	15082	208	10.0			0.029	0.97	5,059
8	LP-A	2	40,476	M	CU	1 SET OF 3/0	12844	480	10.0			0.114	0.30	35,343
9	T-DP-1(PRIMARY)	2	40,476	M	CU	1 SET OF 4/0	15082	480	35.0			0.339	0.75	30,230
10	T-DP-1(SECONDARY)	9	30,230	M	CU	1 SET OF 4/0	15082	208	150	3.46	5.790	0.15	10.274	
11	DP-1	10	10,274	M	CU	2 SETS OF 350 KCMIL	19704	208	15.0			0.033	0.97	9,950
12	RP-1	11	9,950	M	CU	1 SET OF 4/0	15082	208	10.0			0.055	0.95	9,431
13	RP-K1	11	9,950	M	CU	1 SET OF 4/0	15082	208	70.0			0.385	0.72	7,186
14	RP-K2	11	9,950	M	CU	1 SET OF 4/0	15082	208	70.0			0.385	0.72	7,186
15	PP-A	2	40,476	M	CU	2 SETS OF 350 KCMIL	19704	480	20.0			0.074	0.83	37,683
16	PP-C	2	40,476	M	CU	1 SET OF 600 KCMIL	22965	480	320.0			2.035	0.33	13,336
17	T-2(PRIMARY)	16	13,336	M	CU	1 SET OF 2/0	10755	480	10.0			0.045	0.96	12,765
18	T-2(SECONDARY)	17	12,765	M	CU	1 SET OF 2/0	10755	480	10.0			0.045	0.96	12,765
19	RP-2A	18	5,795	M	CU	1 SET OF 600 KCMIL	22965	208	10.0			0.021	0.98	5,639
20	RP-2B	19	5,639	M	CU	1 SET OF 600 KCMIL	22965	208	10.0			0.020	0.98	5,526
21	LP-C	2	40,476	M	CU	1 SET OF 3/0	12844	480	320.0			3.639	0.22	8,726
22	LP-E	2	40,476	M	CU	1 SET OF 3/0	12844	480	150.0			1.706	0.37	14,960
23	T-3(PRIMARY)	22	14,960	M	CU	1 SET OF 1	7293	480	10.0			0.074	0.93	13,929
24	T-3(SECONDARY)	23	13,929	M	CU	1 SET OF 1	7293	480	10.0			0.074	0.93	13,929
25	RP-3	24	4,894	M	CU	1 SET OF 4/0	15082	208	10.0			0.027	0.97	4,766
26	PP-E	2	40,476	M	CU	1 SET OF 600 KCMIL	22965	480	150.0			0.854	0.51	20,715
27	LP-F	2	40,476	M	CU	1 SET OF 3/0	12844	480	280.0			3.184	0.24	9,674
28	T-4(PRIMARY)	27	9,674	M	CU	1 SET OF 1	7293	480	10.0			0.048	0.95	9,232
29	T-4(SECONDARY)	28	9,232	M	CU	1 SET OF 1	7293	480	10.0			0.048	0.95	9,232
30	RP-4	29	4,543	M	CU	1 SET OF 4/0	15082	208	10.0			0.025	0.98	4,431
31	PP-F	2	40,476	M	CU	1 SET OF 600 KCMIL	22965	480	280.0			1.781	0.36	14,556
32	LP-2E	2	40,476	M	CU	1 SET OF 3/0	12844	480	170.0			1.933	0.34	13,800
33	T-5(PRIMARY)	32	13,800	M	CU	1 SET OF 1	7293	480	10.0			0.068	0.94	12,918
34	T-5(SECONDARY)	33	12,918	M	CU	1 SET OF 1	7293	480	10.0			0.068	0.94	12,918
35	RP-5	34	4,837	M	CU	1 SET OF 4/0	15082	208	10.0			0.027	0.97	4,711
36	RP-6	11	9,950	M	CU	1 SET OF 4/0	15082	208	145.0			0.797	0.56	5,538
37	RP-2E	2	40,476	M	CU	2 SETS OF 600 KCMIL	22965	480	170.0			0.541	0.65	26,713
38	ERU-1	2	40,476	M	CU	1 SET OF 3	4774	480	150.0			4.589	0.18	7,242
39	ERU-4	2	40,476	M	CU	1 SET OF 3	4774	480	160.0			4.895	0.17	6,866
40	ERU-7	2	40,476	M	CU	1 SET OF 6	2425	480	140.0			8.432	0.11	4,291

THE FOLLOWING THREE PHASE CALCULATIONS ARE BASED ON THE "POINT-BY-POINT" METHOD WHERE:
 $I_{sc} = I_{sc} \times M$
 $M = 1/(1+H)$
CONDUCTOR OR BUS: $f = \frac{1.732 \times L \times I_{sc}}{C \times n \times E}$
UTILITY XFMR: $I_{sc} = \frac{KVA \times 100,000}{E \times 1.732 \times \%Z}$
XFMR: $f = \frac{I_{sc} \times E_p \times 1.73 \times \%Z}{100,000 \times KVA}$
 $I_{sc} = \frac{E_p \times M \times I_{sc}}{E_s}$
L = LENGTH (FT) OF CONDUCTOR, C = CONSTANT FROM TABLE, n = NUMBER OF CONDUCTORS PER PHASE
Isc = AVAILABLE SHORT CIRCUIT (A), E = VOLTAGE OF CIRCUIT
©Copyright 2021 by Peter Basso Associates, Inc.



TMP ARCHITECTURE INC
1191 WEST SQUARE LAKE ROAD - BOX 289
BLOOMFIELD HILLS - MICHIGAN - 48302
PH: 248-338-6941 FX: 248-338-0223
EM: INFO@TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



Peter Basso Associates Inc
CONSULTING ENGINEERS
5145 Livernois, Suite 100
Troy, Michigan 48068-3276
Tel: 248-879-5566 Fax: 248-879-0007
www.PeterBassoAssociates.com
PBA Project No. 2023.0154

PROJECT TITLE
**NEW SMITH
MIDDLE SCHOOL**
Bid Package No. 03B

Troy School District
TROY, MI

DRAWING TITLE
PANEL SCHEDULES

ISSUE DATES

06-16-2024 CONSTRUCTION DOCUMENTS

DATE: ISSUED FOR:

DRAWN DDB

CHECKED ZDB

APPROVED STP

PROJECT NO.

22102

DRAWING NO.

E5.2

#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#	
1	L	L		20	2178	0	0	20	--	SPARE	L	2	
3	L	L		20	0	2400	0	20	--	SPARE	L	4	
5	L	L		20	0	0	1075	0	20	--	SPARE	L	6
7	L	L		20	891	0	0	20	--	SPARE	L	8	
9	L	L		20	0	925	0	20	--	SPARE	L	10	
11	L	L		20	0	0	1106	0	20	--	SPARE	L	12
13	L	L		20	909	0	0	20	--	SPARE	L	14	
15				20	0	0	0	20	--	SPARE		16	
17				20	0	0	0	20	--	SPARE		18	
19				20	0	0	0	20	--	SPARE		20	
21				20	0	0	0	20	--	SPARE		22	
23				20	0	0	0	20	--	SPARE		24	
25				20	0	0	0	20	--	SPARE		26	
27				20	0	0	0	20	--	SPARE		28	
29				20	0	0	0	20	--	SPARE		30	
31	--	SPARE	--	20	0	0	0	20	--	SPARE		32	
33	--	SPARE	--	20	0	0	0	20	--	SPARE		34	
35	--	SPARE	--	20	0	0	0	20	--	SPARE		36	
37	--	SPARE	--	20	0	0	0	20	--	SPARE		38	
39	--	SPARE	--	20	0	0	0	20	--	SPARE		40	
41	--	SPARE	--	20	0	0	0	20	--	SPARE		42	
					3977	3325	2181						
					0A	0B	0C						

PANELBOARD INFORMATION BRANCH CIRCUIT CONNECTED LOAD DEMAND FACTOR CALCULATED LOAD FEEDER AND OVERCURRENT... NOTES

VOLTAGE: 480Y/277V CONTINUOUS LOAD (C): 0 100% 0 125% 0

BUS AMPACITY: ELECTRIC HEAT (E): 0 100% 0 100% 0

MAIN TYPE: NON-CONTINUOUS LOAD (NC): 0 100% 0 100% 0

MINIMUM A.I.C.: KITCHEN LOAD (K): 0 0 100% 0

MOUNTING: SURFACE RECEPT BASE LOAD (R): 0 100% 0 100% 0

RECEPT DEMAND LOAD (R): 0 50% 0 100% 0

LIGHTING LOAD (L): 9483.55 100% 9483.55 125% 11854.44

ADDITIONAL TRACK LIGHTING... 100% 0

MOTORS, HIGHEST LOAD (M): 0 125 % 0 100% 0

MOTORS, REMAINING 0 100 % 0 100 % 0

PANELBOARD LOCATION NOTE: DEMAND AND SIZING INFORMATION IS CALCULATED... TOTAL (kVA): 9.48 TOTAL... 14.26

© Copr. 2022 by Peter Basso Associates,...

#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#	
1	L	LIGHTING		20	1548	1952	0	20	--	LIGHTING	L	2	
3	L	LIGHTING		20	0	1681	944	20	--	LIGHTING	L	4	
5	L	LIGHTING		20	0	0	1191	1027	20	EXTERIOR LIGHTING	L	6	
7	L	LIGHTING		20	2400	0	0	20	--	SPARE	L	8	
9	L	LIGHTING		20	0	2400	0	20	--	SPARE	L	10	
11	L	LIGHTING		20	0	0	1151	0	20	--	SPARE	L	12
13	M	ERU-5		25	5265	0	0	20	--	SPARE	M	14	
15	M	ERU-5		25	0	5265	0	20	--	SPARE	M	16	
17				20	0	0	5265	0	20	--	SPARE		18
19				20	5543	0	0	20	--	SPARE		20	
21	M	ERU-4		25	0	5543	0	20	--	SPARE	M	22	
23				20	0	0	5543	0	20	--	SPARE		24
25				20	0	0	0	20	--	SPARE		26	
27				20	0	0	0	20	--	SPARE		28	
29				20	0	0	0	20	--	SPARE		30	
31	--	SPARE	--	20	0	0	0	20	--	SPARE		32	
33	--	SPARE	--	20	0	0	0	20	--	SPARE		34	
35	--	SPARE	--	20	0	0	0	20	--	SPARE		36	
37	--	SPARE	--	20	0	0	0	20	--	SPARE		38	
39	--	SPARE	--	20	0	0	0	20	--	SPARE		40	
41	--	SPARE	--	20	0	0	0	20	--	SPARE		42	
					16708	15833	14177						
					0A	0B	0C						

PANELBOARD INFORMATION BRANCH CIRCUIT CONNECTED LOAD DEMAND FACTOR CALCULATED LOAD FEEDER AND OVERCURRENT... NOTES

VOLTAGE: 480Y/277V CONTINUOUS LOAD (C): 0 100% 0 125% 0

BUS AMPACITY: ELECTRIC HEAT (E): 0 100% 0 100% 0

MAIN TYPE: NON-CONTINUOUS LOAD (NC): 0 100% 0 100% 0

MINIMUM A.I.C.: KITCHEN LOAD (K): 0 0 100% 0

MOUNTING: SURFACE RECEPT BASE LOAD (R): 0 100% 0 100% 0

RECEPT DEMAND LOAD (R): 0 50% 0 100% 0

LIGHTING LOAD (L): 14293.85 100% 14293.85 125% 17867.31

ADDITIONAL TRACK LIGHTING... 100% 0

MOTORS, HIGHEST LOAD (M): 16627.69 125 % 20784.6125 100% 20784.6125

MOTORS, REMAINING 15796.3 100 % 15796.3 100 % 15796.3

PANELBOARD LOCATION NOTE: DEMAND AND SIZING INFORMATION IS CALCULATED... TOTAL (kVA): 60.87 TOTAL... 65.49

© Copr. 2022 by Peter Basso Associates,...

#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#	
1	L	LIGHTING		20	1440	0	0	20	--	SPARE	L	2	
3	L	LIGHTING		20	0	15250	0	20	--	SPARE	L	4	
5	L	LIGHTING		20	0	0	11730	0	20	--	SPARE	L	6
7	L	LIGHTING		20	1199	0	0	20	--	SPARE	L	8	
9	L	LIGHTING		20	0	1834	0	20	--	SPARE	L	10	
11	L	LIGHTING		20	0	0	1111	0	20	--	SPARE	L	12
13	L	LIGHTING		20	1494	0	0	20	--	SPARE	L	14	
15	L	LIGHTING		20	0	1236	0	20	--	SPARE	L	16	
17	L	LIGHTING		20	0	0	1067	0	20	--	SPARE	L	18
19	L	LIGHTING		20	1666	0	0	20	--	SPARE	L	20	
21	L	LIGHTING		20	0	0	0	20	--	SPARE	L	22	
23				20	0	0	0	20	--	SPARE		24	
25				20	0	0	0	20	--	SPARE		26	
27				20	0	0	0	20	--	SPARE		28	
29				20	0	0	0	20	--	SPARE		30	
31	--	SPARE	--	20	0	0	0	20	--	SPARE		32	
33	--	SPARE	--	20	0	0	0	20	--	SPARE		34	
35	--	SPARE	--	20	0	0	0	20	--	SPARE		36	
37	--	SPARE	--	20	0	0	0	20	--	SPARE		38	
39	--	SPARE	--	20	0	0	0	20	--	SPARE		40	
41	--	SPARE	--	20	0	0	0	20	--	SPARE		42	
					18499	18319	13907						
					0A	0B	0C						

PANELBOARD INFORMATION BRANCH CIRCUIT CONNECTED LOAD DEMAND FACTOR CALCULATED LOAD FEEDER AND OVERCURRENT... NOTES

VOLTAGE: 480Y/277V CONTINUOUS LOAD (C): 0 100% 0 125% 0

BUS AMPACITY: ELECTRIC HEAT (E): 0 100% 0 100% 0

MAIN TYPE: NON-CONTINUOUS LOAD (NC): 3500 100% 3500 100% 3500

MINIMUM A.I.C.: KITCHEN LOAD (K): 0 0 100% 0

MOUNTING: SURFACE RECEPT BASE LOAD (R): 10000 100% 10000 100% 10000

RECEPT DEMAND LOAD (R): 27620 50% 13810 100% 13810

LIGHTING LOAD (L): 9605.16 100% 9605.16 125% 12096.45

ADDITIONAL TRACK LIGHTING... 100% 0

MOTORS, HIGHEST LOAD (M): 0 125 % 0 100% 0

MOTORS, REMAINING 0 100 % 0 100 % 0

PANELBOARD LOCATION NOTE: DEMAND AND SIZING INFORMATION IS CALCULATED... TOTAL (kVA): 36.92 TOTAL... 44.40

© Copr. 2022 by Peter Basso Associates,...

#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#	
1	L	LIGHTING		20	3280	0	0	20	--	SPARE	L	2	
3	Other	T-RP-SB		20	0	2900	0	20	--	SPARE	L	4	
5	M	NC		70	9422	0	1880	0	20	--	SPARE	M	6
7	M	NC		70	0	9422	0	20	--	SPARE	M	8	
9	M	NC		70	582	0	0	20	--	SPARE	M	10	
11	M	NC		70	0	582	0	20	--	SPARE	M	12	
13				20	0	0	582	0	20	--	SPARE		14
15	M	NC		20	0	0	582	0	20	--	SPARE	M	16
17				20	0	0	0	20	--	SPARE		18	
19				20	0	0	0	20	--	SPARE		20	
21				20	0	0	0	20	--	SPARE		22	
23				20	0	0	0	20	--	SPARE		24	
25				20	0	0	0	20	--	SPARE		26	
27				20	0	0	0	20	--	SPARE		28	
29				20	0	0	0	20	--	SPARE		30	
31				20	0	0	0	20	--	SPARE		32	
33				20	0	0	0	20	--	SPARE		34	
35				20	0	0	0	20	--	SPARE		36	
37				20	0	0	0	20	--	SPARE		38	
39				20	0	0	0	20	--	SPARE		40	
41				20	0	0	0	20	--	SPARE		42	
					13284	12924	11884						
					0A	0B	0C						

PANELBOARD INFORMATION BRANCH CIRCUIT CONNECTED LOAD DEMAND FACTOR CALCULATED LOAD FEEDER AND OVERCURRENT... NOTES

VOLTAGE: 480Y/277V CONTINUOUS LOAD (C): 0 100% 0 125% 0

BUS AMPACITY: ELECTRIC HEAT (E): 0 100% 0 100% 0

MAIN TYPE: NON-CONTINUOUS LOAD (NC): 32092.98 100% 32092.98 100% 32092.98

MINIMUM A.I.C.: KITCHEN LOAD (K): 0 0 100% 0

MOUNTING: SURFACE RECEPT BASE LOAD (R): 900 100% 900 100% 900

RECEPT DEMAND LOAD (R): 0 50% 0 100% 0

LIGHTING LOAD (L): 0 100% 0 125% 0

ADDITIONAL TRACK LIGHTING... 100% 0

MOTORS, HIGHEST LOAD (M): 0 125 % 0 100% 0

MOTORS, REMAINING 0 100 % 0 100 % 0

PANELBOARD LOCATION NOTE: DEMAND AND SIZING INFORMATION IS CALCULATED... TOTAL (kVA): 32.99 TOTAL... 39.68

© Copr. 2022 by Peter Basso Associates,...

PANELBOARD RP-2B														
#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#		
1	NC	RANGE HOOD		20	600	600		20		RANGE HOOD	NC	2		
3	NC	RANGE HOOD		20		600	600	20		RANGE HOOD	NC	4		
5	K	ELECTRIC RANGE		50	3625	3625		50		ELECTRIC RANGE	K	6		
7	K	ELECTRIC RANGE		50		3625	3625	50		ELECTRIC RANGE	K	8		
9	K	ELECTRIC RANGE		50		3625	3625	50		ELECTRIC RANGE	K	10		
11	NC	RANGE HOOD		20	600	3625		20		ELECTRIC RANGE	K	14		
13	K	ELECTRIC RANGE		50		3625	3625	50		ELECTRIC RANGE	K	16		
15	K	ELECTRIC RANGE		50		3625	3625	50		RANGE HOOD	NC	18		
17	K	ELECTRIC RANGE		50	3625	175		15		RF-103	NC	20		
19	K	ELECTRIC RANGE		50		3625	175	15		RF-102	NC	24		
21	NC	RANGE HOOD		20			600	600	15	RF-101	NC	28		
23	NC	RANGE HOOD		20	300	560		15		RF-107	M	32		
25	NC	ERWP-109		20		300	560	15		-- SPARE	--	34		
27	NC	ERWP-109		20		300	560	15		-- SPARE	--	36		
29	NC	M		20		300	560	15		-- SPARE	--	38		
31	NC	M		20		300	560	15		-- SPARE	--	40		
33	M	EF-104		20			348	0	20	-- SPARE	--	42		
35	M	EF-105		20			264	0	20	-- SPARE	--	44		
37	NC	HEAT TRACE		20	250	0		0	20	-- SPARE	--	46		
39	R	SERVICE RECEPTACLE		20			360	0	20	-- SPARE	--	48		
41	M	EF-106		20			348	0	20	-- SPARE	--	50		
43	--	SPARE		20	0	0		0	20	-- SPARE	--	52		
45	--	SPARE		20	0	0		0	20	-- SPARE	--	54		
47	--	SPARE		20	0	0		0	20	-- SPARE	--	56		
49	--	SPARE		20	0	0		0	20	-- SPARE	--	58		
51	--	SPARE		20	0	0		0	20	-- SPARE	--	60		
53	--	SPARE		20	0	0		0	20	-- SPARE	--	62		
55	--	SPARE		20	0	0		0	20	-- SPARE	--	64		
57	--	SPARE		20	0	0		0	20	-- SPARE	--	66		
59	--	SPARE		20	0	0		0	20	-- SPARE	--	68		
					18041	21068	21357							
					GA	OB	OC							
PANELBOARD INFORMATION														
VOLTAGE:		208Y/120V	BRANCH CIRCUIT CONNECTED LOAD		CONTINUOUS LOAD (C):	0	100% 0	125% 0	FEEDER AND OVERCURRENT					NOTES
BUS AMPACITY:		400A	ELECTRIC HEAT (E)		0	100% 0	100% 0	100% 0						
MAIN TYPE:		400A MCB	NON-CONTINUOUS LOAD (NC):		8240	100% 8240	100% 8240	100% 8240						
MINIMUM A.I.C.:			KITCHEN LOAD (K):		50750	65.00% 32967.5	100% 32967.5							
MOUNTING:		SURFACE	RECEPT BASE LOAD (R):		360	100% 360	100% 0							
			RECEPT DEMAND LOAD (R):		0	50% 0	100% 0							
			LIGHTING LOAD (L):		0	100% 0	125% 0							
			ADDITIONAL TRACK LIGHTING:		0	100% 0	100% 0							
PANELBOARD LOCATION			MOTORS, HIGHEST LOAD (M):		348	125 % 435	100% 435							
			MOTORS, REMAINING		768	100 % 768	100 % 768							
					TOTAL (kVA): 42.79		TOTAL: 118.77							
NOTE: DEMAND AND SIZING INFORMATION IS CALCULATED...														

PANELBOARD PP-2E														
#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#		
1	NC	TU-201		20	833	29930		20		ERU-9	M	2		
3	NC	TU-201		20		833	29930	125	STB	ERU-9	M	4		
5	NC	TU-201		20		833	29930	125	--	SPARE	--	6		
7	NC	TU-202		20		2167	29930			ERU-8	M	10		
9	NC	TU-202		20		2167	29930	125		ERU-8	M	12		
11	NC	TU-203		20	833	29930		20		TU-211,213,214	NC	14		
13	NC	TU-203		20		833	1500			TU-212	NC	16		
15	NC	TU-204		20	1333	2333		20		TU-216	M	18		
17	NC	TU-204		20		1333	2333			TU-216	M	20		
19	NC	TU-205		20	2333	3667		20		TU-216	M	22		
21	NC	TU-205		20		2333	3667	20		TU-216	M	24		
23	NC	TU-206		20	3187	1109		20		EUH-202	M	26		
25	NC	TU-206		20		3167	1109	20		EUH-202	M	28		
27	NC	TU-207		20	3167	2167		20		TU-215	M	30		
29	NC	TU-207		20		3167	2167	20		TU-215	M	32		
31	NC	TU-208		20	2167	2167		20		TU-217	M	34		
33	NC	TU-208		20		2167	2167	20		TU-217	M	36		
35	NC	TU-209		20	3667	1500		20		TU-218,220,221	M	38		
37	NC	TU-209		20		3667	1500	20		TU-218,220,221	M	40		
39	NC	TU-210		20	2167	2333		20		TU-219	M	42		
41	NC	TU-210		20		2167	2333	20		TU-219	M	44		
43	NC	TU-210		20		2167	2333	20		SPARE	--	46		
45	NC	TU-210		20		2167	2333	20		SPARE	--	48		
47	NC	TU-210		20		2167	2333	20		SPARE	--	50		
49	NC	TU-210		20		2167	2333	20		SPARE	--	52		
51	NC	TU-210		20		2167	2333	20		SPARE	--	54		
53	NC	TU-210		20		2167	2333	20		SPARE	--	56		
55	NC	TU-210		20		2167	2333	20		SPARE	--	58		
57	NC	TU-210		20		2167	2333	20		SPARE	--	60		
59	NC	TU-210		20		2167	2333	20		SPARE	--	62		
					96968	98468	96968							
					GA	OB	OC							
PANELBOARD INFORMATION														
VOLTAGE:		480Y/277V	BRANCH CIRCUIT CONNECTED LOAD		CONTINUOUS LOAD (C):	0	100% 0	125% 0	FEEDER AND OVERCURRENT					NOTES
BUS AMPACITY:		800A	ELECTRIC HEAT (E)		0	100% 0	100% 0	100% 0						
MAIN TYPE:		MLO	NON-CONTINUOUS LOAD (NC):		75500	100% 75500	100% 75500							
MINIMUM A.I.C.:		42,000	KITCHEN LOAD (K):		0	0	0	100% 0						
MOUNTING:		SURFACE	RECEPT BASE LOAD (R):		0	100% 0	100% 0							
			RECEPT DEMAND LOAD (R):		0	50% 0	100% 0							
			LIGHTING LOAD (L):		0	100% 0	125% 0							
			ADDITIONAL TRACK LIGHTING:		0	100% 0	100% 0							
PANELBOARD LOCATION			MOTORS, HIGHEST LOAD (M):		89789.51	125 % 112236.8875	100% 112236.8875							
			MOTORS, REMAINING		127115.05	100 % 127115.05	100 % 127115.05							
					TOTAL (kVA): 314.81		TOTAL: 378.71							
NOTE: DEMAND AND SIZING INFORMATION IS CALCULATED...														

PANELBOARD PP-C														
#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#		
1	NC	EUH-201		20	333	3242		20		EUH-105	NC	2		
3	NC	EUH-201		20		333	3242	20		EUH-105	NC	4		
5	NC	EUH-201		20		333	3242	20		EUH-105	NC	6		
7	NC	TU-124,125,126,127		15	2880	4268		20		EUH-103	NC	10		
9	NC	TU-124,125,126,127		15		2880	4268	20		EUH-103	NC	12		
11	NC	FPB-101		25	5293	4268		20		EUH-104	NC	14		
13	NC	FPB-101		25		5293	4268	20		EUH-104	NC	16		
15	NC	FPB-102		35	7290	4540		20		TU-119	NC	18		
17	NC	FPB-102		35		7290	4540	20		TU-119	NC	20		
19	NC	FPB-103		20	7676	667		15		TU-118	NC	22		
21	NC	FPB-103		20		7676	667	15		TU-118	NC	24		
23	NC	TU-123		20	3333	2010		15		TU-114,115,117	NC	26		
25	NC	TU-123		20		3333	2010	15		TU-114,115,117	NC	28		
27	NC	TU-120		20	1500	667		20		TU-116	NC	30		
29	NC	TU-120		20		1500	667	20		TU-116	NC	32		
31	NC	TU-103,104,105		20	1500	2680		15		TU-110,111,112,113	NC	34		
33	NC	TU-103,104,105		20		1500	2680	15		TU-110,111,112,113	NC	36		
35	NC	TU-101,102		20		1000	2880	1000	2680	TU-106,107,108,109	NC	38		
37	NC	TU-101,102		20		1000	2880	1000	2680	TU-106,107,108,109	NC	40		
39	NC	HP-102		15	3293	2493		20		TU-122	NC	42		
41	NC	HP-102		15		3293	2493	20		TU-122	NC	44		
43	NC	ERU-2		110	24653	3850		20		TU-121	NC	46		
45	NC	ERU-2		110		24653	3850	20		TU-121	NC	48		
47	NC	ERU-2		110		24653	3850	20		TU-121	NC	50		
49	NC	ERU-2		110		24653	3850	20		TU-121	NC	52		
51	NC	ERU-2		110		24653	3850	20		TU-121	NC	54		
53	NC	ERU-2		110		24653	3850	20		TU-121	NC	56		
55	NC	ERU-2		110		24653	3850	20		TU-121	NC	58		
57	NC	ERU-2		110		24653	3850	20		TU-121	NC	60		
59	NC	ERU-2		110		24653	3850	20		TU-121	NC	62		
					86238	85738	85238							
					GA	OB	OC							
PANELBOARD INFORMATION														
VOLTAGE:		480Y/277V	BRANCH CIRCUIT CONNECTED LOAD		CONTINUOUS LOAD (C):	0	100% 0	125% 0	FEEDER AND OVERCURRENT					NOTES
BUS AMPACITY:		400A	ELECTRIC HEAT (E)		0	100% 0	100% 0	100% 0						
MAIN TYPE:		MLO	NON-CONTINUOUS LOAD (NC):		257203.19	100% 257203.19	100% 257203.19							
MINIMUM A.I.C.:		22,000	KITCHEN LOAD (K):		0	0	0	100% 0						
MOUNTING:		SURFACE	RECEPT BASE LOAD (R):		0	100% 0	100% 0							
			RECEPT DEMAND LOAD (R):		0	50% 0	100% 0							
			LIGHTING LOAD (L):		0	100% 0	125% 0							
			ADDITIONAL TRACK LIGHTING:		0	100% 0	100% 0							
PANELBOARD LOCATION			MOTORS, HIGHEST LOAD (M):		0	125 % 0	100% 0							
			MOTORS, REMAINING		0	100 % 0	100 % 0							
					TOTAL (kVA): 257									

#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#
1	R	R		20	180							2
3	R	R										4
5	R	R										6
7	R	R										8
9	R	R										10
11	R	R										12
13	R	R										14
15	R	R										16
17	R	R										18
19	R	R										20
21	R	R										22
23	R	R										24
25	R	R										26
27	R	R										28
29	R	R										30
31	R	R										32
33	R	R										34
35	R	R										36
37	R	R										38
39	R	R										40
41	R	R										42
43	R	R										44
45	R	R										46
47	R	R										48
49	R	R										50
51	R	R										52
53	R	R										54
55	R	R										56
57	R	R										58
59	R	R										60

PANELBOARD INFORMATION		BRANCH CIRCUIT CONNECTED LOAD		DEMAND FACTOR		CALCULATED LOAD		FEEDER AND OVERCURRENT		NOTES
VOLTAGE:	208Y120V	CONTINUOUS LOAD (C):	0	100%	0	125%	0	100%	0	
BUS AMPACITY:	225A	ELECTRIC HEAT (E)	0	100%	0	100%	0	100%	0	
MAIN TYPE:	MLO	NON-CONTINUOUS LOAD (NC):	0	100%	0	100%	0	100%	0	
MINIMUM A.I.C.:	10,000	KITCHEN LOAD (K):	0	100%	0	100%	0	100%	0	
MOUNTING:	FLUSH	RECEPT BASE LOAD (R):	180	100%	180	100%	180	100%	180	
		RECEPT DEMAND LOAD (R):	0	50%	0	100%	0	100%	0	
		LIGHTING LOAD (L):	0	100%	0	125%	0	100%	0	
		ADDITIONAL TRACK LIGHTING...	0	100%	0	100%	0	100%	0	
		MOTORS, HIGHEST LOAD (M):	0	125%	0	100%	0	100%	0	
		MOTORS, REMAINING	0	100%	0	100%	0	100%	0	
PANELBOARD LOCATION			TOTAL (kVA):		0.18		TOTAL...		0.50	
			TOTAL (kVA):		0.50		TOTAL...		0.50	

© Copr. 2022 by Peter Basso Associates, Inc.

#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#
1	R	R		20								2
3	R	R										4
5	R	R										6
7	R	R										8
9	R	R										10
11	R	R										12
13	R	R										14
15	R	R										16
17	R	R										18
19	R	R										20
21	R	R										22
23	R	R										24
25	R	R										26
27	R	R										28
29	R	R										30
31	R	R										32
33	R	R										34
35	R	R										36
37	R	R										38
39	R	R										40
41	R	R										42
43	R	R										44
45	R	R										46
47	R	R										48
49	R	R										50
51	R	R										52
53	R	R										54
55	R	R										56
57	R	R										58
59	R	R										60

PANELBOARD INFORMATION		BRANCH CIRCUIT CONNECTED LOAD		DEMAND FACTOR		CALCULATED LOAD		FEEDER AND OVERCURRENT		NOTES
VOLTAGE:	208Y120V	CONTINUOUS LOAD (C):	0	100%	0	125%	0	100%	0	
BUS AMPACITY:		ELECTRIC HEAT (E)	0	100%	0	100%	0	100%	0	
MAIN TYPE:		NON-CONTINUOUS LOAD (NC):	0	100%	0	100%	0	100%	0	
MINIMUM A.I.C.:		KITCHEN LOAD (K):	0	100%	0	100%	0	100%	0	
MOUNTING:	FLUSH	RECEPT BASE LOAD (R):	0	100%	0	100%	0	100%	0	
		RECEPT DEMAND LOAD (R):	0	50%	0	100%	0	100%	0	
		LIGHTING LOAD (L):	0	100%	0	125%	0	100%	0	
		ADDITIONAL TRACK LIGHTING...	0	100%	0	100%	0	100%	0	
		MOTORS, HIGHEST LOAD (M):	0	125%	0	100%	0	100%	0	
		MOTORS, REMAINING	0	100%	0	100%	0	100%	0	
PANELBOARD LOCATION			TOTAL (kVA):		0.00		TOTAL...		0.00	
			TOTAL (kVA):		0.00		TOTAL...		0.00	

© Copr. 2022 by Peter Basso Associates, Inc.

#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#
1	R	RECEPTACLES		20	720	45				LIGHTING	L	2
3	R	RECEPTACLES		20		900	90			LIGHTING	L	4
5	R	PROJECTION SCREEN		20			430	900	20	R	R	6
7	NC	WON DOOR		20	250	1080				R	R	8
9	NC	ERWP-201		20		600	360			CORD REELS	R	10
11	NC	ERWP-201		20			600	360	20	CORD REELS	R	12
13	NC	ERWP-202		20	750	360				CORD REELS	R	14
15	R	RECEPTACLES		20		750	360			CORD REELS	R	16
17	R	R		20			360	720	20	R	R	18
19	R	R		20	1080	180				REFRIGERATOR	R	20
21	R	R		20		1080	360			CORD REELS	R	22
23	R	R		20			720	360	20	CORD REELS	R	24
25	R	R		20	1080	360				CORD REELS	R	26
27	R	R		20		1080	360			CORD REELS	R	28
29	R	R		20			1080	720	20	R	R	30
31	R	R		20	1080	900				R	R	32
33	R	R		20		1080	720			R	R	34
35	R	R		20			900	720	20	R	R	36
37	R	R		20	180	900				R	R	38
39	R	R		20		720	900			R	R	40
41	R	R		20			180	900	20	R	R	42
43	R	R		20	720	900				R	R	44
45	R	R		20		720	900			R	R	46
47	R	R		20			900	720	20	R	R	48
49	R	R		20	720	900				R	R	50
51	R	R		20		900	900			R	R	52
53	R	R		20			900	180	20	REFRIGERATOR	R	54
55	R	R		20	720	180				COPIER	R	56
57	R	R		20		900	360			R	R	58
59	R	R		20			1080	1080	20	R	R	60
61	NC	M		20	750	1080				R	R	62
63	NC	M		20		750	900			R	R	64
65	NC	NC		20			750	720	20	R	R	66
67	NC	NC		20	750	180				EWIC	R	68
69	NC	NC		20		1050	36			M	M	70
71	NC	NC		20			1050	0	20	--	--	72

PANELBOARD INFORMATION		BRANCH CIRCUIT CONNECTED LOAD		DEMAND FACTOR		CALCULATED LOAD		FEEDER AND OVERCURRENT		NOTES
VOLTAGE:	208Y120V	CONTINUOUS LOAD (C):	0	100%	0	125%	0	100%	0	
BUS AMPACITY:		ELECTRIC HEAT (E)	0	100%	0	100%	0	100%	0	
MAIN TYPE:		NON-CONTINUOUS LOAD (NC):	8300	100%	8300	100%	8300	100%	8300	
MINIMUM A.I.C.:		KITCHEN LOAD (K):	0	100%	0	100%	0	100%	0	
MOUNTING:	SURFACE	RECEPT BASE LOAD (R):	10000	100%	10000	100%	10000	100%	10000	
		RECEPT DEMAND LOAD (R):	30500	50%	15250	100%	15250	100%	15250	
		LIGHTING LOAD (L):	135	100%	135	125%	168.75	100%	168.75	
		ADDITIONAL TRACK LIGHTING...	0	100%	0	100%	0	100%	0	
		MOTORS, HIGHEST LOAD (M):	36	125%	45	100%	45	100%	45	
		MOTORS, REMAINING	0	100%	0	100%	0	100%	0	
PANELBOARD LOCATION			TOTAL (kVA):		33.73		TOTAL...		93.72	
			TOTAL (kVA):		93.63		TOTAL...		93.72	

© Copr. 2022 by Peter Basso Associates, Inc.

#	LOAD TYPE	DESCRIPTION	CB TYPE	CB	A	B	C	CB	CB TYPE	DESCRIPTION	LOAD TYPE	#
1	R	RECEPTACLES		20	720	1080				RECEPTACLES	R	2
3	R	RECEPTACLES		20		1080	1080			RECEPTACLES	R	4
5	R	RECEPTACLES		20			720	1080		RECEPTACLES	R	6
7	R	RECEPTACLES		20	1080	720				RECEPTACLES	R	8
9	R	RECEPTACLES		20		1080	1260			RECEPTACLES	R	10
11	R	RECEPTACLES		20			540	360		CORD REELS	R	12
13	R	RECEPTACLES		20	1080	360				CORD REELS	R	14
15	NC	ERWP-113		20		750	360			CORD REELS	R	16
17	R	RECEPTACLES		20			750	360		CORD REELS	R	18
19	R	RECEPTACLES		20	1000	540				RECEPTACLES	R	20
21	NC	ERWP-114,115		20		1000	180			REFRIGERATOR	R	22
23	R	RECEPTACLES		20			720	360		CORD REELS	R	24
25	R	RECEPTACLES		20	720	360						



TMP ARCHITECTURE INC
 1191 WEST SQUARE LAKE ROAD
 BLOOMFIELD HILLS - MICHIGAN 48302
 PH: 248.338.4661 FX: 248.338.0223
 EM: INFO@TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



PROJECT TITLE
**NEW SMITH
 MIDDLE SCHOOL**
 Bid Package No. 03B

Troy School District
 Troy, Michigan

DRAWING TITLE
 New Smith Middle School
 Troy School District
 Troy, Mi.
 Theatrical Electrical
 Location Plan View

ISSUE DATES

06-18-24 CONSTRUCTION DOCUMENTS

DATE: ISSUED FOR:

DRAWN BE

CHECKED


APPROVED

PROJECT NO.

22102

DRAWING NO.

TE1.1

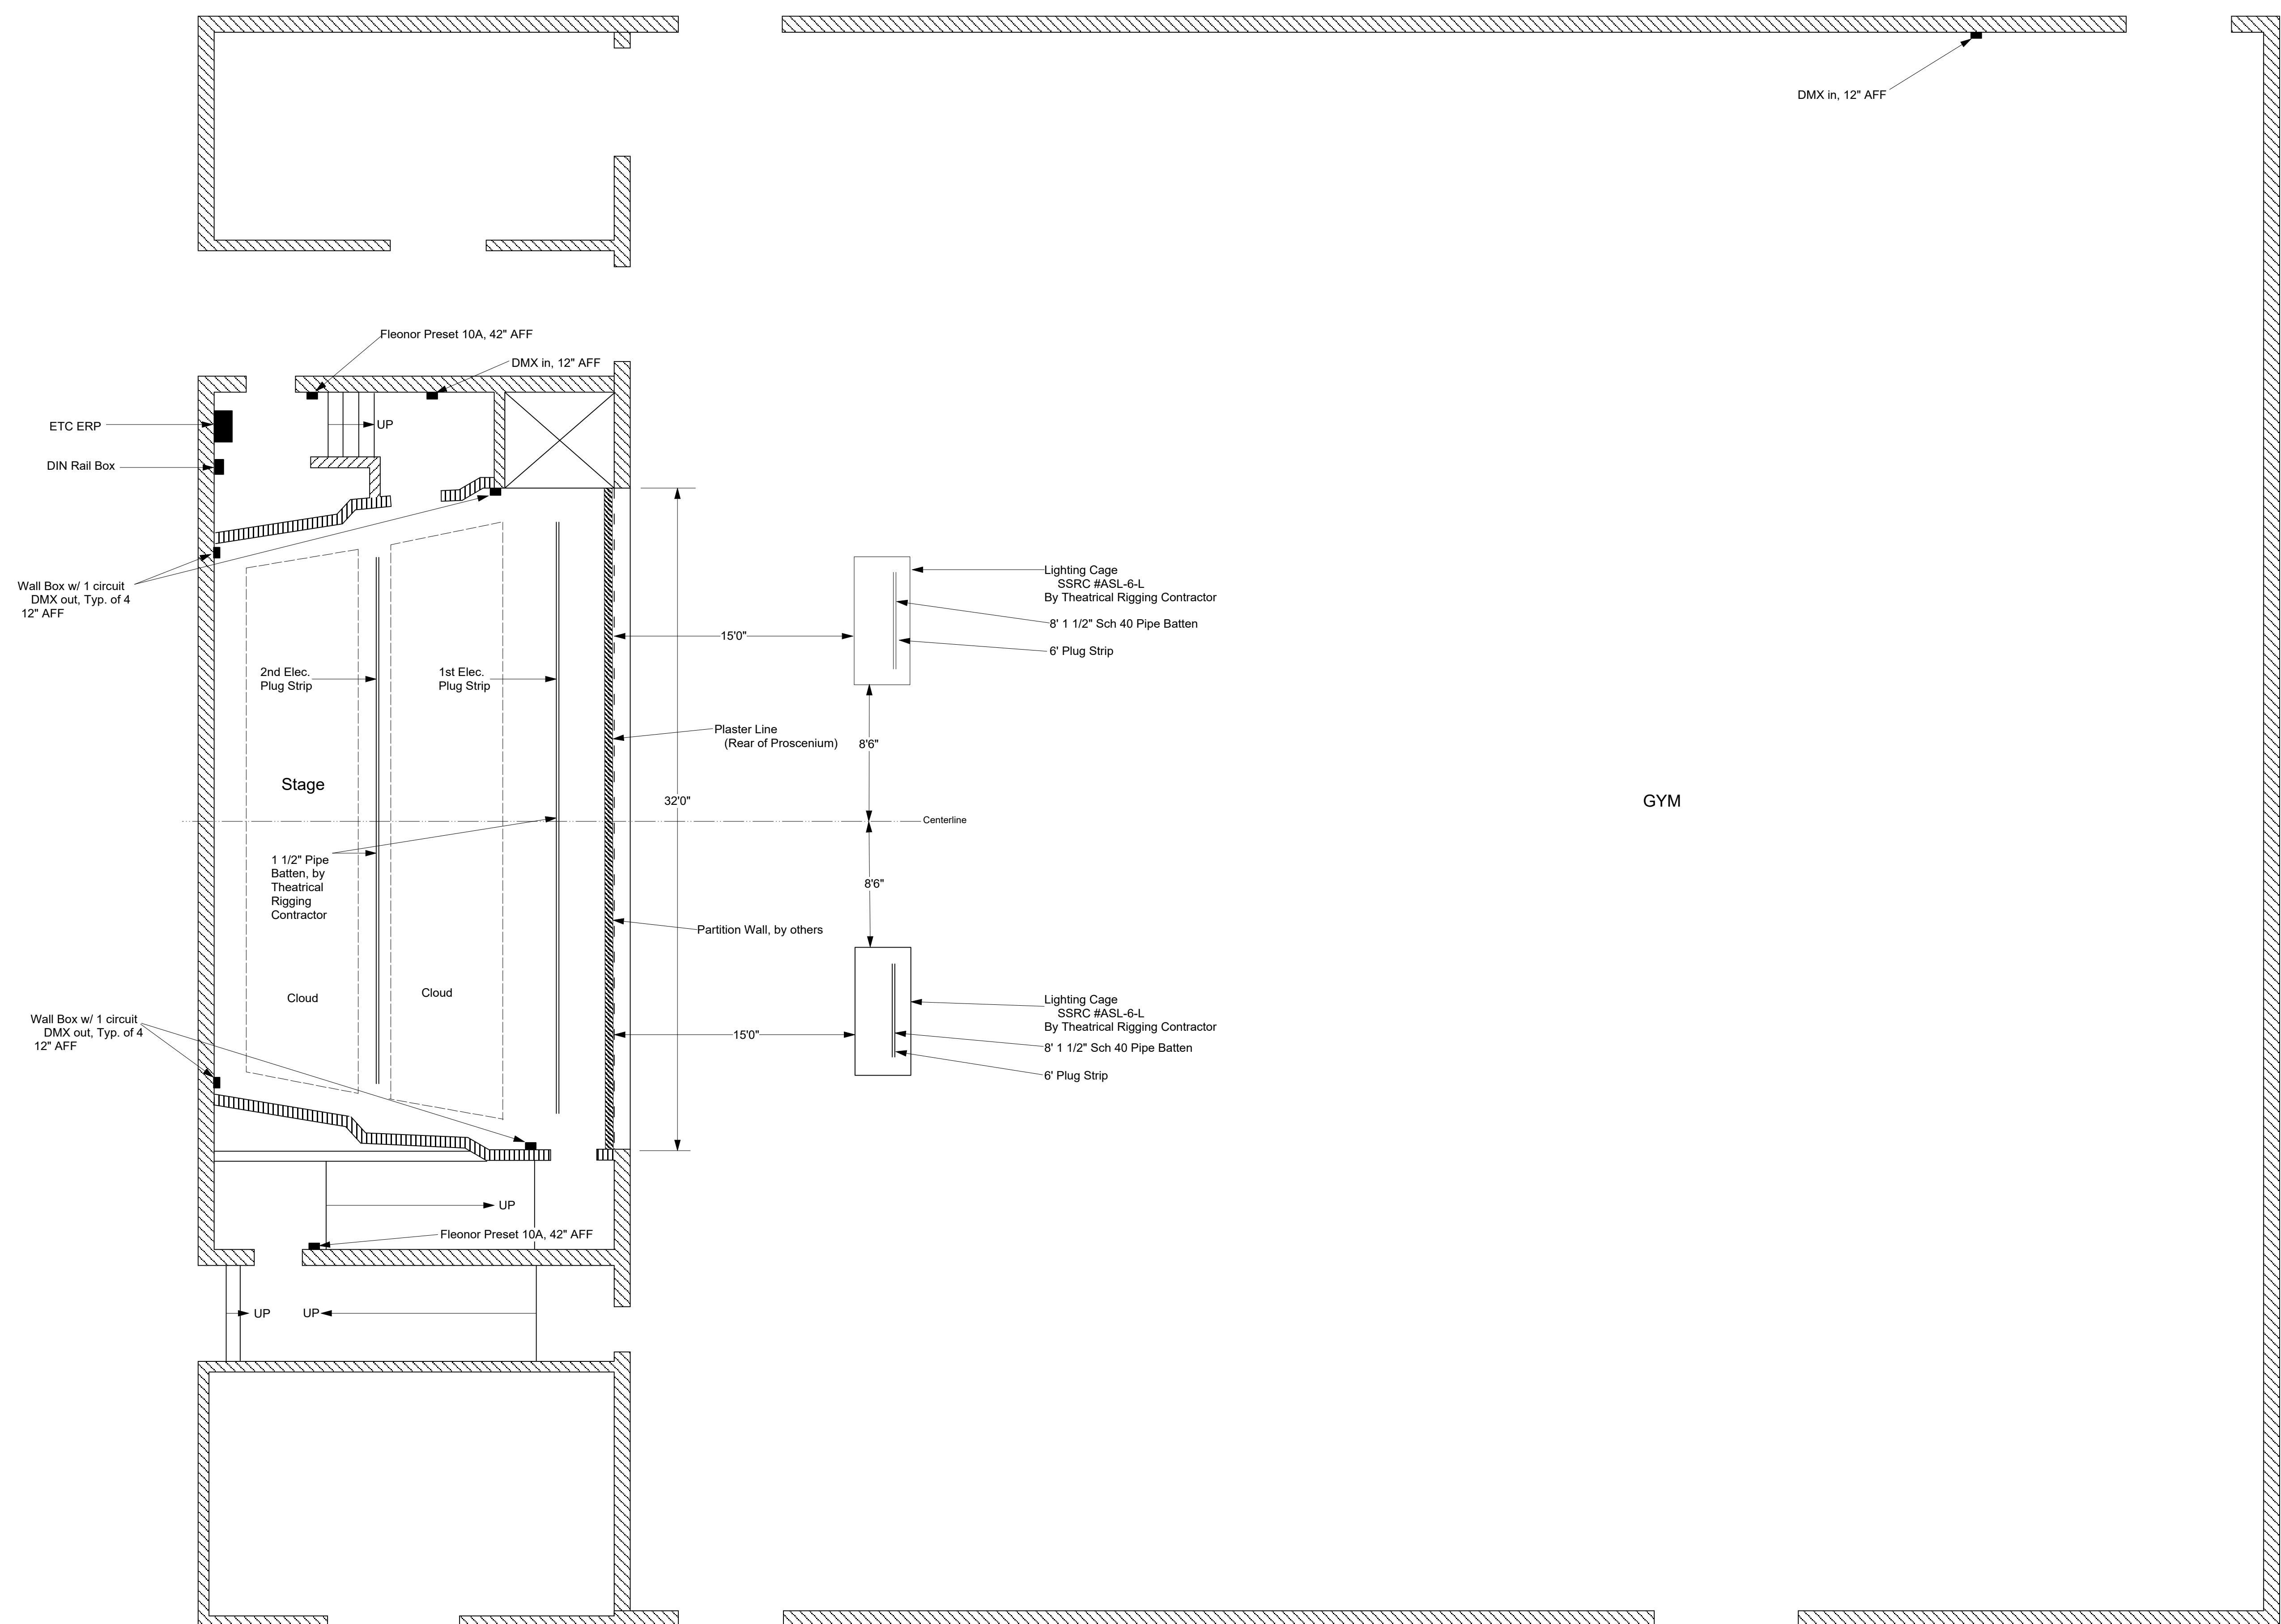

Theatrical Electrical Equipment Plan View

Scale: 3/16" = 1'0"

New Smith Middle School
 Troy School District
 Troy, Mi



TMP ARCHITECTURE INC

1191 WEST SQUARE LAKE ROAD
BLOOMFIELD HILLS - MICHIGAN 48302
PH: 248.338.4651 FX: 248.338.0223
EM: INFO@TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



3313 Yellowstone Dr • Ann Arbor, MI 48105 • Phone (810) 813-4691 • info@glc.us

PROJECT TITLE

**NEW SMITH
MIDDLE SCHOOL**
Bid Package No. 03B

Troy School District
Troy, Michigan

DRAWING TITLE

**New Smith Middle
School**
Troy School District
Troy, Mi.
Theatrical Electrical
Location Section at
Centerline and Details

ISSUE DATES

06-18-24 CONSTRUCTION DOCUMENTS

DATE: ISSUED FOR:



DRAWN BE
CHECKED
APPROVED

PROJECT NO.

22102

DRAWING NO.

TE1.2

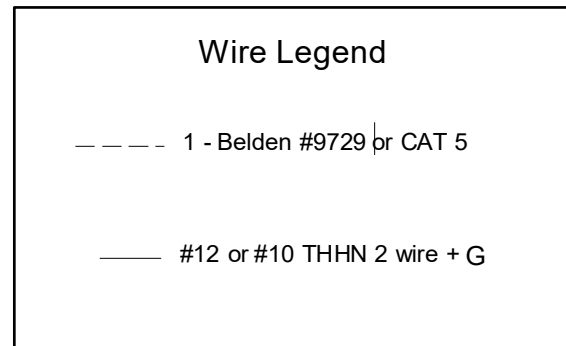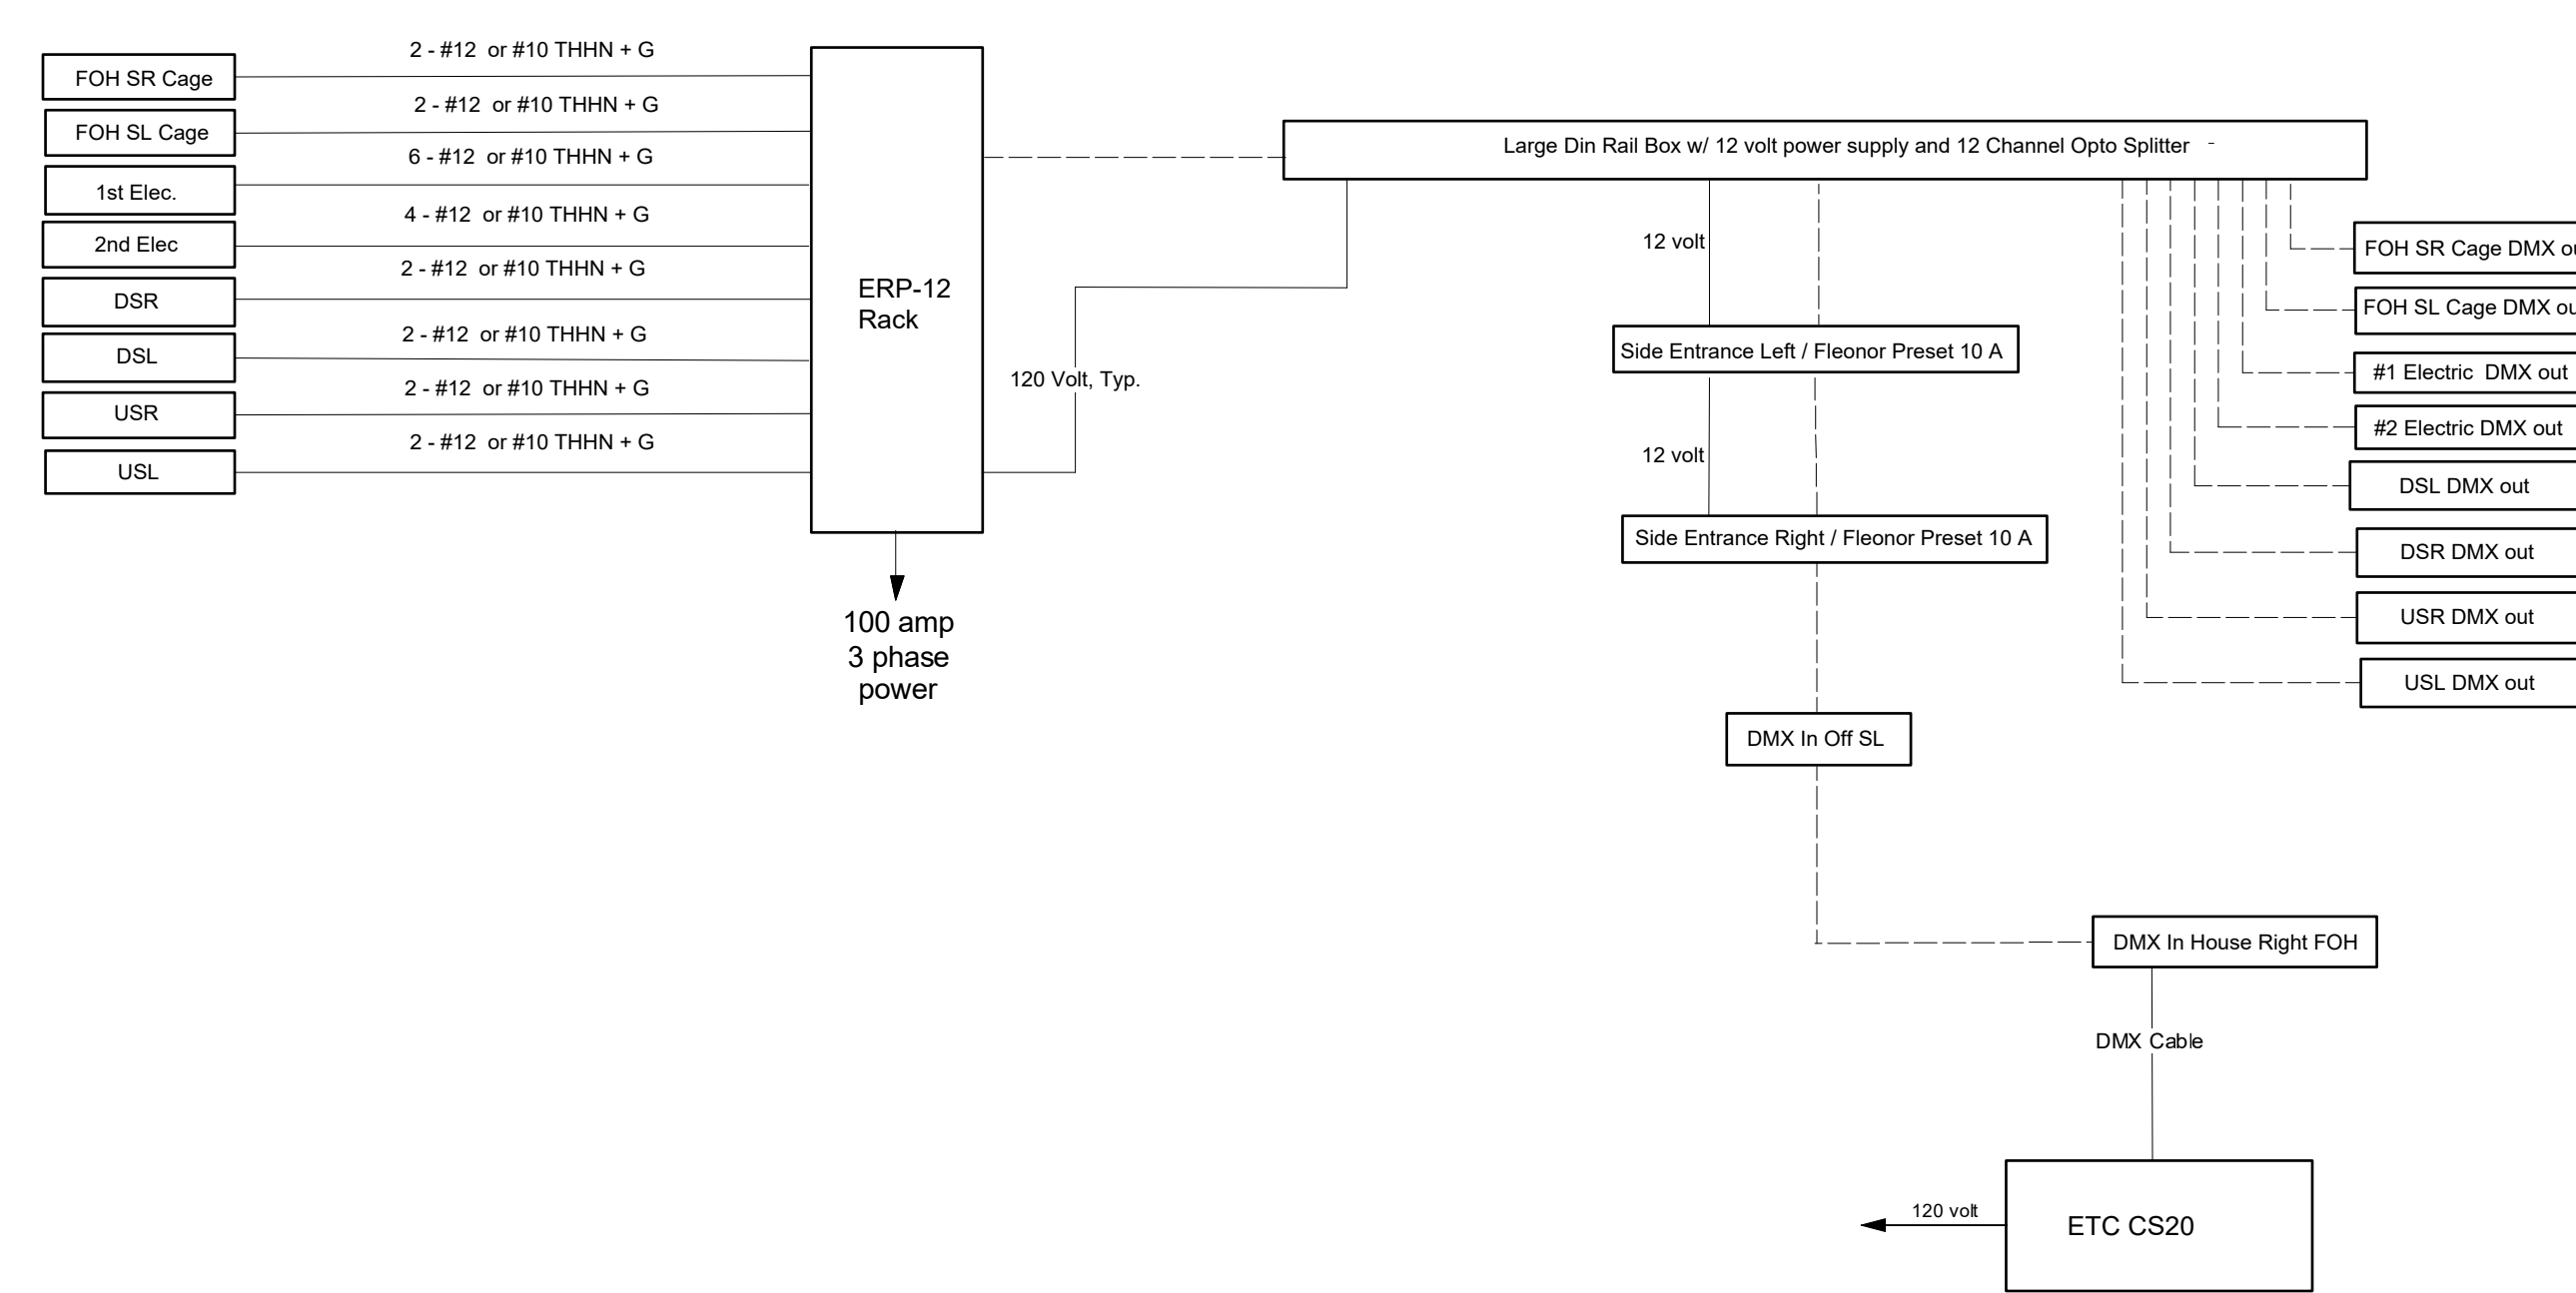

Loc #	Qty #	Module	Location
1	1	20 amp Relay	FOH SR Cage
2	2		FOH SL Cage
3	3		
4	4		1st Electric
5	5		
6	6		2nd Electric
7	7		
8	8		DSR
9	9		DSL
10	10		USR
11	11		USL
12	12		space future use
13	13	20 amp Breaker	DIN Box Power
14	14		
15	15		As Needed
16	16		
17	17		
18	18		

Relay / Breaker Schedule

- FOH - 1 / Relay #1
- FOH - 2 / Relay #2
- #1 Electric / Relay #3
- #1 Electric / Relay #4
- #1 Electric / Relay #5
- #2 Electric / Relay #6
- #2 Electric / Relay #7
- DSR / Relay #8
- DSL / Relay #9
- USR / Relay #10
- USL / Relay #11


Fixture Hang Position

- FOH SR Cage / 6 - CSSPOTy
- FOH SL Cage / 6 - CSSPOTy
- 1st Electric / 10 - CSPAR
- 2nd Electric / 4 - CSCYC
- Portable LED Followspot

Fixture Allocation

Fixture Count	
CSSPOTy	-12
CSPAR Medium	+10
CSCYC	-4
Followspot	-1

Theatrical Electrical Distribution and Control Riser Diagram

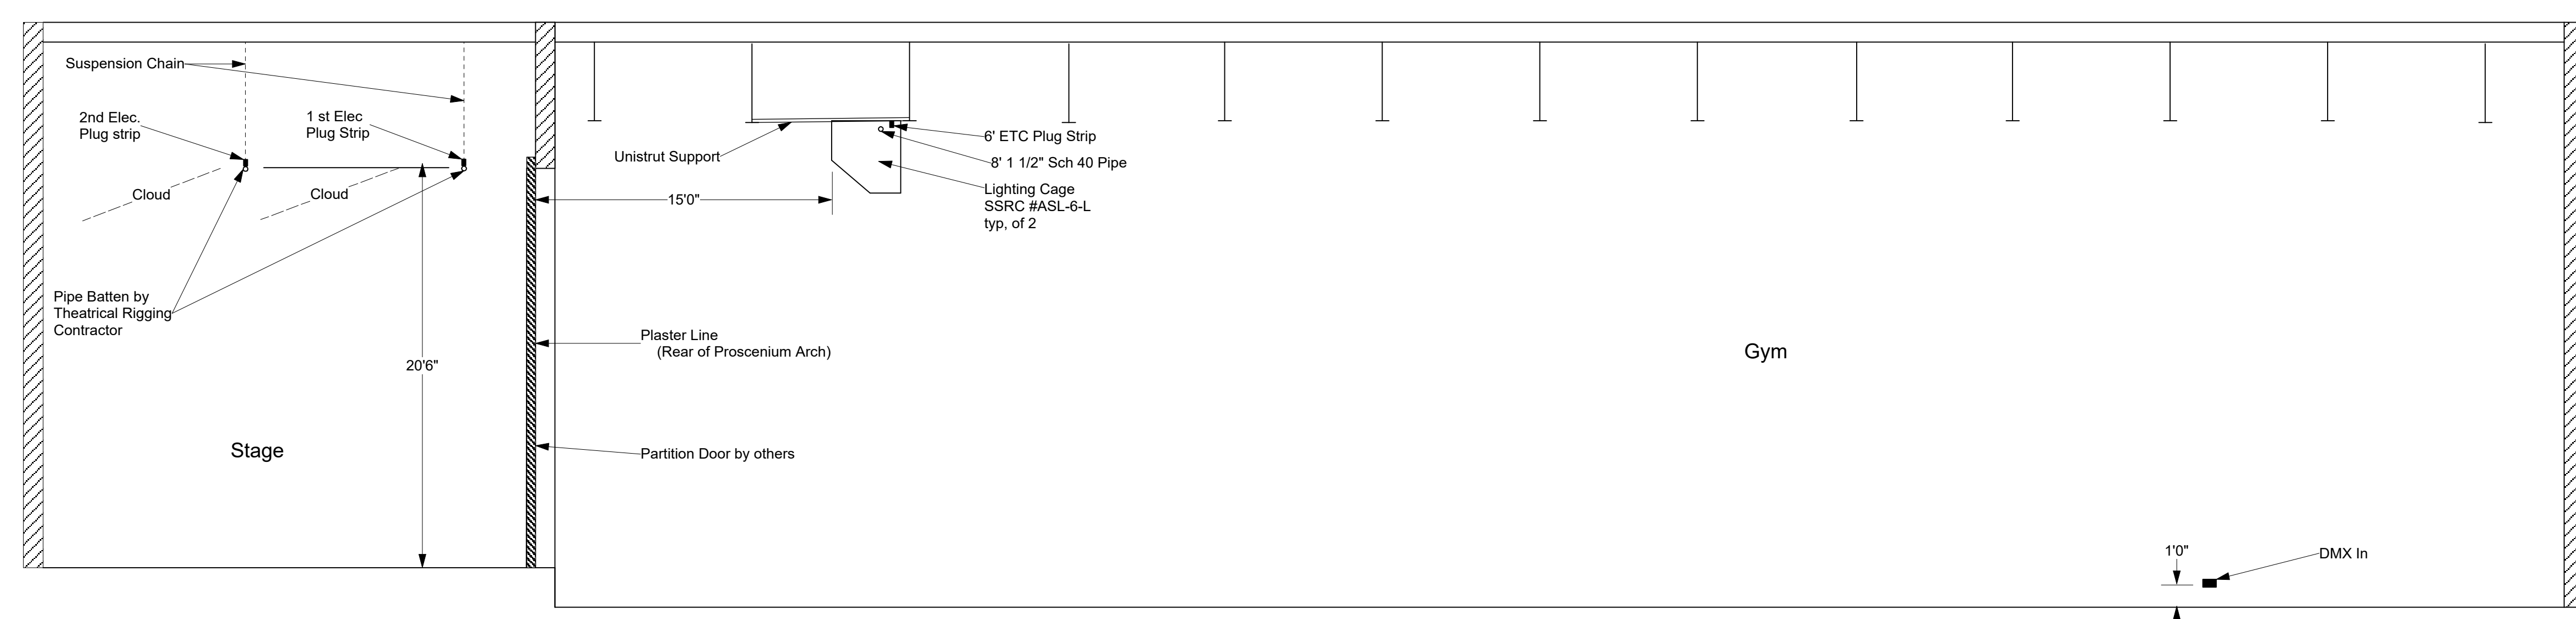

Theatrical Electrical Equipment Section at Centerline scale 3/16" = 1'0"

New Smith Middle School
Troy School District
Troy, Mi



TMP ARCHITECTURE INC
 1191 WEST SQUARE LAKE ROAD
 BLOOMFIELD HILLS - MICHIGAN 48302
 PH: 248.338.4661 FX: 248.338.0223
 EM: INFO@TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



PROJECT TITLE
NEW SMITH MIDDLE SCHOOL
 Bid Package No. 03B

Troy School District
 Troy, Michigan

DRAWING TITLE
 New Smith Middle School
 Troy School District
 Troy, Mi.
 Theatrical Rigging
 Plan View

ISSUE DATES

06-18-24 CONSTRUCTION DOCUMENTS

DATE: ISSUED FOR:

DRAWN BY: _____

CHECKED: _____


APPROVED: _____

PROJECT NO.

22102

DRAWING NO.

TR1.1

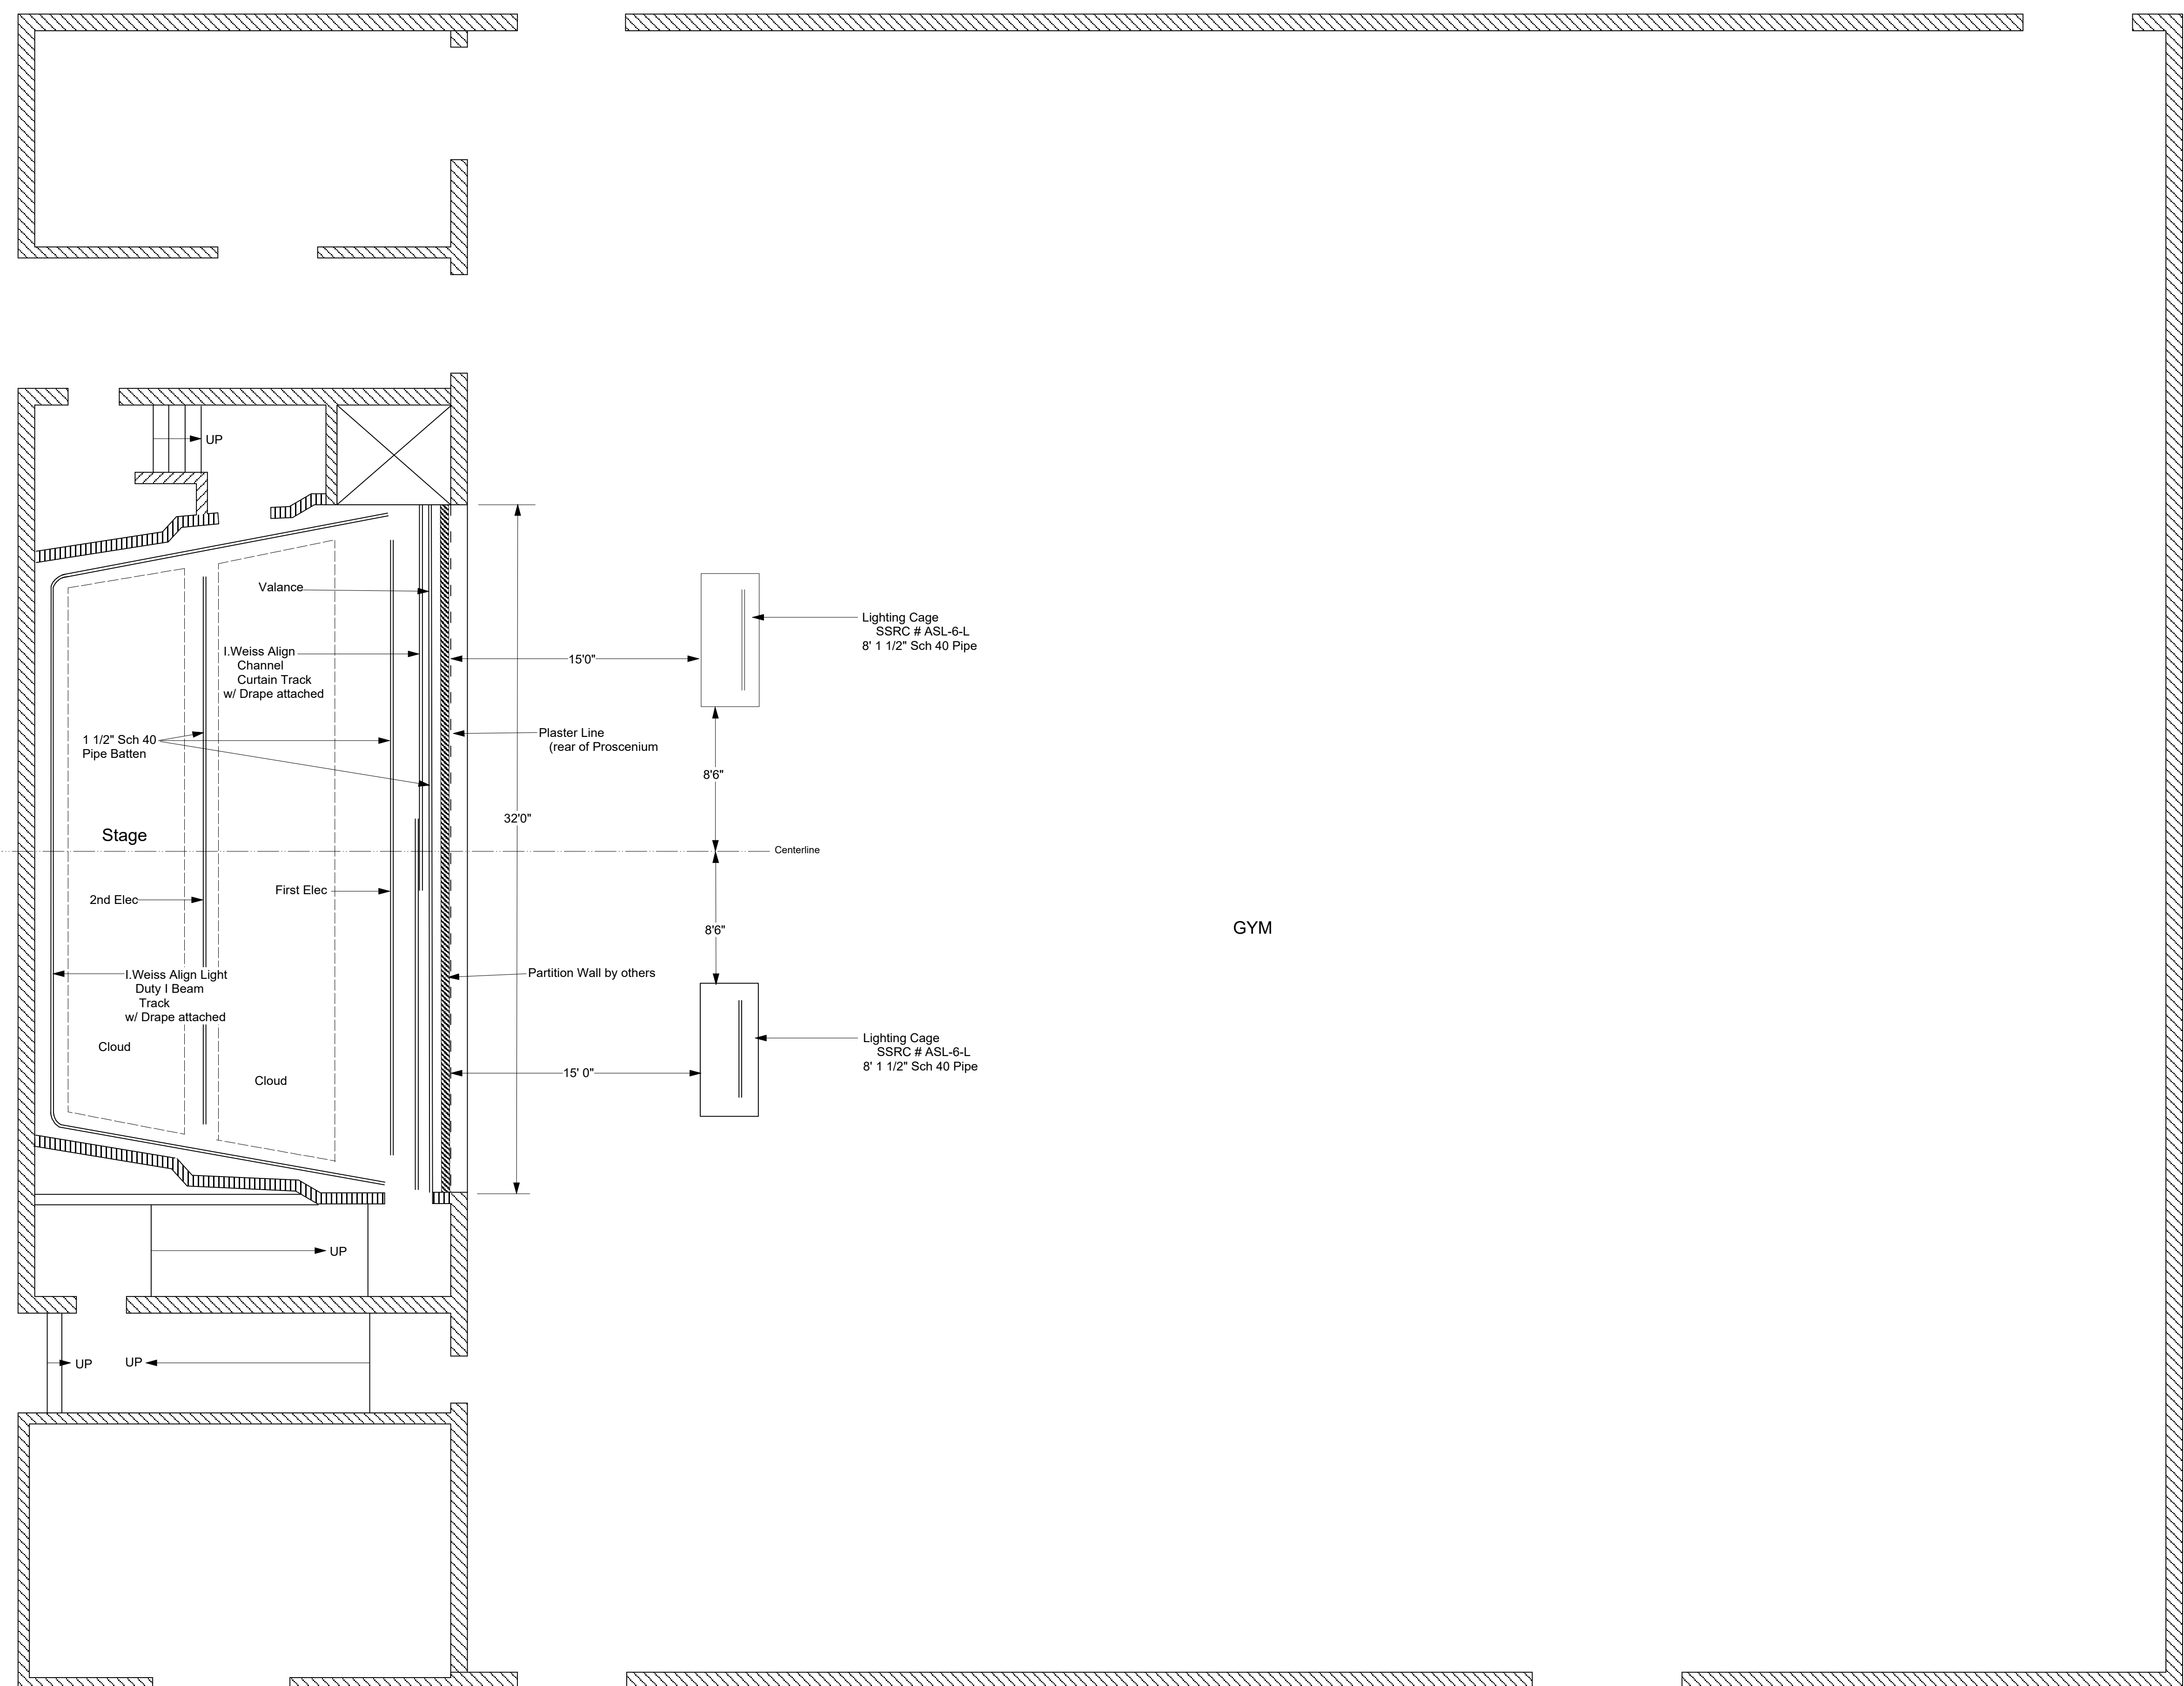

Theatrical Rigging Plan View

Scale : 3/16" = 1'0"

New Smith Middle School
 Troy School District
 Troy, Mi

