

November 17, 2016

Mr. Gerhard Leuer
Medina Central School District
One Mustang Drive
Medina, New York 14103

Re: Environmental Water Sampling – Medina High School

Dear Mr. Leuer,

Envoy Environmental was contracted on September 28, 2016 to perform Environmental Water Sampling at Medina High School located at 335 West Oak Orchard Street in Medina, New York. We understand the Medina Central School District is evaluating the data based on the NYS Department of Health (“NYSDOH”) Emergency Regulation, Lead Testing in School Drinking Water (Subpart 67-4) as well as the EPA’s 3T’s for Reducing Lead in Drinking Water in Schools Guidance Document. All sampling conducted was done in accordance with the NYSDOH regulations as it pertains to testing schools for lead in the drinking water.

Samples taken were based on both the direction of the client, and areas designated as high priority as outlined by the NYSDOH regulations. All water samples collected were 250 mL and taken as a “first draw” from each testing location. First draw samples are defined as a sample of tap water, collected in accordance with the NYSDOH regulations, that has been standing in plumbing pipes at least 8 hours and not more than 18 hours and is collected without prior flushing of the tap. The NYSDOH regulations identifies the Action Level at 15 ppb.

Water sampling analysis was contracted through Con-Test Analytical Laboratory located in Richmond, Virginia, a NYS ELAP approved laboratory. The sampling and analytical testing was conducted in compliance with the USEPA Requirements for Lead Sampling and Testing Protocols. The following USEPA Methodologies were used to prepare and analyze the drinking water samples for Lead:

Drinking Water Sample Preparation	USEPA Method 200.2
Lead by ICP-MS	USEPA Method 200.8

Each sample was preserved, at Con-Test Analytical Laboratory, with nitric acid to reduce the pH to less than 2 as per USEPA Method 200.2.

Chain of Custody (“COC”) forms are used to document the history of sample possession from the time the sample containers leave their point of origin to the time the samples are received by the laboratory.

In Table 1 of this report we have listed water samples that are above 15 ppb.

TABLE 1

Medina High School			
Sample ID	Water Source	Level Detected (PPB)	Remedial Suggestions
HS-2-CS-060	Classroom Sink	16	1. Take outlet out of service. 2. Do not use for drinking water purposes – adequate signage. 3. Clean aerator, re-test “first draw” and “flush” samples to identify if the problem is at the outlet or interior plumbing; and/or, 4. Replace outlet and re-test “first draw” and “flush” samples.
HS-2-CS-061	Classroom Sink	28	
HS-2-CS-068	Classroom Sink	92	
HS-2-CS-069	Classroom Sink	280	
HS-2-CS-080	Classroom Sink	760	
HS-2-CS-120	Classroom Sink	22	
HS-2-CS-127	Classroom Sink	27	
HS-2-CS-129	Classroom Sink	42	
HS-2-CS-130	Classroom Sink	17	
HS-2-CS-137	Classroom Sink	16	
HS-2-CS-141	Classroom Sink	16	

Solutions to lead problems need to be made on both a short-term and a permanent basis. Short-term measures could include flushing the pipes to bring fresh water to the source, removing the outlet from service or providing bottled water until the source of contamination is resolved. Permanent remedies can be implemented in order to eliminate the contaminant source. These options, outlined in the 3Ts guidance document include:

- Install corrosion control devices for individual buildings, known as point-of-entry devices.
- Install point-of-use devices that control lead at the tap.
- Find alternate grounding for electrical wires that are grounded to water pipes.
- Replace lead service lines and other lead pipes.
- Replace outlets where there is localized contamination with new, certified components. EPA recognizes NSF Standard 61, Section 9 as a performance standard. It limits leaching of lead into the drinking water. The standard regulates devices that dispense water for human ingestion.¹

¹<https://www.epa.gov/dwreginfo/testing-schools-and-child-care-centers-lead-drinking-water>

Routine control measures can also be implemented by Medina Central School District to properly address each situation, such as cleaning aerators regularly and placard sinks with notices that water should not be consumed, until appropriate permanent actions can be implemented, such as removing/replacing a fixture.

The remedial options are based on the 3Ts guidance document as referenced in the NYSDOH Emergency Regulation:

“The Environmental Protection Agency’s 3Ts for Reducing Lead in Drinking Water in Schools, Revised Technical Guidance will be used as a technical reference for implementation of the regulation.”

Please refer to the attached laboratory reports for specific analytical data and sample locations throughout the school. If you have any questions, please contact me at (585) 454-1060. We appreciate the opportunity to provide you with our professional services.

Sincerely,

A handwritten signature in purple ink, appearing to read 'TK', with a horizontal line extending to the left.

Ted Knapp
Project Manager
Envoy Environmental Consultants, Inc.

¹<https://www.epa.gov/dwreginfo/testing-schools-and-child-care-centers-lead-drinking-water>

Table of Contents

Sample Summary	7
Case Narrative	10
Sample Results	11
16J0214-01	11
16J0214-02	12
16J0214-03	13
16J0214-04	14
16J0214-05	15
16J0214-06	16
16J0214-07	17
16J0214-08	18
16J0214-09	19
16J0214-10	20
16J0214-11	21
16J0214-12	22
16J0214-13	23
16J0214-14	24
16J0214-15	25
16J0214-16	26
16J0214-17	27
16J0214-18	28
16J0214-19	29
16J0214-20	30
16J0214-21	31
16J0214-22	32

Table of Contents (continued)

16J0214-23	33
16J0214-24	34
16J0214-25	35
16J0214-26	36
16J0214-27	37
16J0214-28	38
16J0214-29	39
16J0214-30	40
16J0214-31	41
16J0214-32	42
16J0214-33	43
16J0214-34	44
16J0214-35	45
16J0214-36	46
16J0214-37	47
16J0214-38	48
16J0214-39	49
16J0214-40	50
16J0214-41	51
16J0214-42	52
16J0214-43	53
16J0214-44	54
16J0214-45	55
16J0214-46	56
16J0214-47	57

Table of Contents (continued)

16J0214-48	58
16J0214-49	59
16J0214-50	60
16J0214-51	61
16J0214-52	62
16J0214-53	63
16J0214-54	64
16J0214-55	65
16J0214-56	66
16J0214-57	67
16J0214-58	68
16J0214-59	69
16J0214-60	70
16J0214-61	71
16J0214-62	72
16J0214-63	73
16J0214-64	74
16J0214-65	75
16J0214-66	76
16J0214-67	77
16J0214-68	78
16J0214-69	79
16J0214-70	80
16J0214-71	81
16J0214-72	82

Table of Contents (continued)

16J0214-73	83
16J0214-74	84
16J0214-75	85
16J0214-76	86
16J0214-77	87
16J0214-78	88
16J0214-79	89
16J0214-80	90
16J0214-81	91
16J0214-82	92
16J0214-83	93
16J0214-84	94
16J0214-85	95
16J0214-86	96
16J0214-87	97
16J0214-88	98
16J0214-89	99
16J0214-90	100
16J0214-91	101
16J0214-92	102
16J0214-93	103
16J0214-94	104
16J0214-95	105
16J0214-96	106
16J0214-97	107

Table of Contents (continued)

16J0214-98	108
16J0214-99	109
Sample Preparation Information	110
QC Data	113
Metals Analyses (Total)	113
B160147	113
B160156	113
B160157	113
B160158	114
B160159	114
Flag/Qualifier Summary	116
Certifications	117
Chain of Custody/Sample Receipt	118

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Environmental Hazards Services, LLC
7469 White Pine Road
Richmond, VA 23237
ATTN: Greg Brown

REPORT DATE: 10/13/2016

PURCHASE ORDER NUMBER:

PROJECT NUMBER: [none]

ANALYTICAL SUMMARY

WORK ORDER NUMBER: 16J0214

The results of analyses performed on the following samples submitted to the CON-TEST Analytical Laboratory are found in this report.

PROJECT LOCATION: High School - 2 Mustang Drive., Medina, NY

FIELD SAMPLE #	LAB ID:	MATRIX	SAMPLE DESCRIPTION	TEST	SUB LAB
HS-1-KS-001	16J0214-01	Drinking Water	Kitchen Sink	EPA 200.8	
HS-1-KS-002	16J0214-02	Drinking Water	Kitchen Sink	EPA 200.8	
HS-1-KS-003	16J0214-03	Drinking Water	Kitchen Sink	EPA 200.8	
HS-1-KS-004	16J0214-04	Drinking Water	Kitchen Sink	EPA 200.8	
HS-1-BS-005	16J0214-05	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-KS-006	16J0214-06	Drinking Water	Kitchen Sink	EPA 200.8	
HS-1-DW-007	16J0214-07	Drinking Water	Drinking Water	EPA 200.8	
HS-1-CS-008	16J0214-08	Drinking Water	Classroom Sink	EPA 200.8	
HS-1-CS-009	16J0214-09	Drinking Water	Classroom Sink	EPA 200.8	
HS-1-CS-010	16J0214-10	Drinking Water	Classroom Sink	EPA 200.8	
HS-1-CS-011	16J0214-11	Drinking Water	Classroom Sink	EPA 200.8	
HS-1-NS-012	16J0214-12	Drinking Water	Nurse Sink	EPA 200.8	
HS-1-BS-013	16J0214-13	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-IM-014	16J0214-14	Drinking Water	Ice Maker	EPA 200.8	
HS-1-BS-015	16J0214-15	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-016	16J0214-16	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-017	16J0214-17	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-018	16J0214-18	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-019	16J0214-19	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-020	16J0214-20	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-021	16J0214-21	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-022	16J0214-22	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-DW-023	16J0214-23	Drinking Water	Drinking Water	EPA 200.8	
HS-1-DW-024	16J0214-24	Drinking Water	Drinking Water	EPA 200.8	
HS-1-BS-025	16J0214-25	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-026	16J0214-26	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-KS-027	16J0214-27	Drinking Water	Kitchen Sink	EPA 200.8	
HS-1-CS-028	16J0214-28	Drinking Water	Classroom Sink	EPA 200.8	
HS-1-DW-029	16J0214-29	Drinking Water	Drinking Water	EPA 200.8	
HS-1-BS-030	16J0214-30	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-031	16J0214-31	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-DW-032	16J0214-32	Drinking Water	Drinking Water	EPA 200.8	
HS-1-BS-033	16J0214-33	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-BS-034	16J0214-34	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-DW-035	16J0214-35	Drinking Water	Drinking Water	EPA 200.8	
HS-1-DW-036	16J0214-36	Drinking Water	Drinking Water	EPA 200.8	
HS-1-BS-037	16J0214-37	Drinking Water	Bathroom Water	EPA 200.8	
HS-1-BS-038	16J0214-38	Drinking Water	Bathroom Water	EPA 200.8	
HS-1-BS-039	16J0214-39	Drinking Water	Bathroom Water	EPA 200.8	
HS-1-BS-040	16J0214-40	Drinking Water	Bathroom Water	EPA 200.8	
HS-1-DW-041	16J0214-41	Drinking Water	Drinking Water	EPA 200.8	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Environmental Hazards Services, LLC
7469 White Pine Road
Richmond, VA 23237
ATTN: Greg Brown

REPORT DATE: 10/13/2016

PURCHASE ORDER NUMBER:

PROJECT NUMBER: [none]

ANALYTICAL SUMMARY

WORK ORDER NUMBER: 16J0214

The results of analyses performed on the following samples submitted to the CON-TEST Analytical Laboratory are found in this report.

PROJECT LOCATION: High School - 2 Mustang Drive., Medina, NY

FIELD SAMPLE #	LAB ID:	MATRIX	SAMPLE DESCRIPTION	TEST	SUB LAB
HS-1-CS-042	16J0214-42	Drinking Water	Classroom Sink	EPA 200.8	
HS-1-CS-043	16J0214-43	Drinking Water	Classroom Sink	EPA 200.8	
HS-1-CS-044	16J0214-44	Drinking Water	Classroom Sink	EPA 200.8	
HS-1-CS-045	16J0214-45	Drinking Water	Classroom Sink	EPA 200.8	
HS-1-CS-046	16J0214-46	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-CS-047	16J0214-47	Drinking Water	Bathroom Sink	EPA 200.8	
HS-1-CS-048	16J0214-48	Drinking Water	Bathroom Sink	EPA 200.8	
HS-2-CS-049	16J0214-49	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-050	16J0214-50	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-052	16J0214-51	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-053	16J0214-52	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-054	16J0214-53	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-055	16J0214-54	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-056	16J0214-55	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-057	16J0214-56	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-058	16J0214-57	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-DW-059	16J0214-58	Drinking Water	Drinking Water	EPA 200.8	
HS-2-CS-060	16J0214-59	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-061	16J0214-60	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-062	16J0214-61	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-063	16J0214-62	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-064	16J0214-63	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-065	16J0214-64	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-066	16J0214-65	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-067	16J0214-66	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-068	16J0214-67	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-069	16J0214-68	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-070	16J0214-69	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-071	16J0214-70	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-072	16J0214-71	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-073	16J0214-72	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-074	16J0214-73	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-075	16J0214-74	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-076	16J0214-75	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-077	16J0214-76	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-078	16J0214-77	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-079	16J0214-78	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-080	16J0214-79	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-081	16J0214-80	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-082	16J0214-81	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-083	16J0214-82	Drinking Water	Classroom Sink	EPA 200.8	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Environmental Hazards Services, LLC
7469 White Pine Road
Richmond, VA 23237
ATTN: Greg Brown

REPORT DATE: 10/13/2016

PURCHASE ORDER NUMBER:

PROJECT NUMBER: [none]

ANALYTICAL SUMMARY

WORK ORDER NUMBER: 16J0214

The results of analyses performed on the following samples submitted to the CON-TEST Analytical Laboratory are found in this report.

PROJECT LOCATION: High School - 2 Mustang Drive., Medina, NY

FIELD SAMPLE #	LAB ID:	MATRIX	SAMPLE DESCRIPTION	TEST	SUB LAB
HS-2-CS-084	16J0214-83	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-085	16J0214-84	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-086	16J0214-85	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-087	16J0214-86	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-088	16J0214-87	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-089	16J0214-88	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-090	16J0214-89	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-091	16J0214-90	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-BS-092	16J0214-91	Drinking Water	Bathroom Sink	EPA 200.8	
HS-2-BS-093	16J0214-92	Drinking Water	Bathroom Sink	EPA 200.8	
HS-2-BS-094	16J0214-93	Drinking Water	Bathroom Sink	EPA 200.8	
HS-2-DW-095	16J0214-94	Drinking Water	Drinking Water	EPA 200.8	
HS-2-BS-096	16J0214-95	Drinking Water	Bathroom Sink	EPA 200.8	
HS-2-BS-097	16J0214-96	Drinking Water	Bathroom Sink	EPA 200.8	
HS-2-BS-098	16J0214-97	Drinking Water	Bathroom Sink	EPA 200.8	
HS-2-BS-099	16J0214-98	Drinking Water	Bathroom Sink	EPA 200.8	
HS-2-BS-100	16J0214-99	Drinking Water	Bathroom Sink	EPA 200.8	

CASE NARRATIVE SUMMARY

All reported results are within defined laboratory quality control objectives unless listed below or otherwise qualified in this report.

The results of analyses reported only relate to samples submitted to the Con-Test Analytical Laboratory for testing.

I certify that the analyses listed above, unless specifically listed as subcontracted, if any, were performed under my direction according to the approved methodologies listed in this document, and that based upon my inquiry of those individuals immediately responsible for obtaining the information, the material contained in this report is, to the best of my knowledge and belief, accurate and complete.

A handwritten signature in black ink, appearing to read "Lisa Worthington", is written over a light pink rectangular background.

Lisa A. Worthington
Project Manager

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Kitchen Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-KS-001

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-01

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 1:20	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Kitchen Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-KS-002

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-02

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 1:42	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Kitchen Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-KS-003

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-03

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	0.90	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 1:46	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Kitchen Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-KS-004

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-04

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.6	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 1:50	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-005

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-05

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	9.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 1:54	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Kitchen Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-KS-006

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-06

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 1:59	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-DW-007

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-07

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:03	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-008

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-08

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	9.3	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:07	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-009

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-09

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:11	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-010

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-10

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	0.78	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:16	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-011

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-11

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	3.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:28	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Nurse Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-NS-012

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-12

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.9	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:33	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-013

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-13

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:37	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Ice Maker

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-IM-014

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-14

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:41	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-015

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-15

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:45	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-016

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-16

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:50	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-017

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-17

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	9.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:54	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-018

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-18

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.6	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 2:58	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-019

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-19

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 3:02	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-020

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-20

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/8/16 3:07	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-021

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-21

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.9	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 4:33	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-022

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-22

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	RL	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
			MA	ORSG					Prepared	Analyzed	
Lead	4.4	0.50	15		µg/L	1		EPA 200.8	10/7/16	10/10/16 4:46	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-DW-023

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-23

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 4:50	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-DW-024

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-24

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 4:55	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-025

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-25

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.8	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 4:59	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-026

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-26

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	0.75	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:12	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M

Sample Description: Kitchen Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-KS-027

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-27

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.6	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:16	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-028

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-28

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:20	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-DW-029

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-29

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:24	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-030

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-30

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.4	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:29	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-031

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-31

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.8	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:33	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-DW-032

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-32

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:37	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-033

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-33

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.3	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:41	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-034

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-34

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	9.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:46	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-DW-035

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-35

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	0.59	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 5:50	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-DW-036

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-36

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:03	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-037

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-37

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	6.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:07	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-038

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-38

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.4	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:11	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-039

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-39

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.4	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:15	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-040

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-40

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:20	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-DW-041

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-41

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:42	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-042

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-42

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:03	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-043

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-43

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:07	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-044

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-44

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	3.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:12	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-045

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-45

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	0.54	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:16	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-CS-046

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-46

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.4	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:20	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-047

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-47

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:24	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-1-BS-048

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-48

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	RL	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
			MA	ORSG					Prepared	Analyzed	
Lead	1.5	0.50	15		µg/L	1		EPA 200.8	10/7/16	10/10/16 7:29	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-049

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-49

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.2	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:33	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-050

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-50

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	8.8	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:37	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-052

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-51

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	5.9	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:50	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-053

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-52

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	15	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:54	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-054

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-53

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	0.63	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:58	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-055

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-54

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.5	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:03	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-056

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-55

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	3.9	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:07	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-057

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-56

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:11	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-058

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-57

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	0.99	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:15	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-DW-059

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-58

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:19	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-060

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-59

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	16	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:24	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-061

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-60

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	28	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:28	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-062

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-61

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	8.5	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:28	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-063

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-62

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	3.3	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:38	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-064

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-63

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.3	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:41	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-065

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-64

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.5	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:45	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-066

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-65

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	3.5	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:48	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-067

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-66

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	5.6	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 6:58	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-068

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-67

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	92	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:02	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-069

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-68

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	RL	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
			MA	ORSG					Prepared	Analyzed	
# Lead	280	0.50	15		µg/L	1		EPA 200.8	10/7/16	10/10/16 7:05	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-070

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-69

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	8.9	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:08	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-071

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-70

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	12	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:12	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-072

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-71

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	10	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:15	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-073

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-72

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	12	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:19	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-074

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-73

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	12	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:22	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-075

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-74

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	9.3	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:25	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-076

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-75

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	11	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:29	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-077

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-76

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	7.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:39	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-078

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-77

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	7.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:42	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-079

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-78

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	9.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:46	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-080

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-79

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	RL	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
			MA	ORSG					Prepared	Analyzed	
# Lead	760	0.50	15		µg/L	1		EPA 200.8	10/7/16	10/10/16 7:49	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-081

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-80

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	5.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:10	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-082

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-81

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.2	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 7:53	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-083

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-82

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	6.8	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:32	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-084

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-83

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.9	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:35	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-085

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-84

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.5	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:38	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-086

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-85

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	11	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:42	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-087

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-86

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	7.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:45	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-088

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-87

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	9.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:49	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-089

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-88

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	7.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:52	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-090

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-89

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.4	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 8:55	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-CS-091

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-90

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	12	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:05	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-BS-092

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-91

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	3.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:09	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-BS-093

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-92

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.9	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:12	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-BS-094

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-93

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.3	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:15	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Drinking Water

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-DW-095

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-94

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:19	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-BS-096

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-95

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.4	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:22	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-BS-097

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-96

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.3	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:25	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-BS-098

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-97

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:29	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-BS-099

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-98

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	6.8	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:32	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0214

Date Received: 10/6/2016

Field Sample #: HS-2-BS-100

Sampled: 9/28/2016 00:00

Sample ID: 16J0214-99

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:36	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Sample Extraction Data**Prep Method: EPA 200.8-EPA 200.8**

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0214-01 [HS-1-KS-001]	B160147	10.0	10.0	10/07/16
16J0214-02 [HS-1-KS-002]	B160147	10.0	10.0	10/07/16
16J0214-03 [HS-1-KS-003]	B160147	10.0	10.0	10/07/16
16J0214-04 [HS-1-KS-004]	B160147	10.0	10.0	10/07/16
16J0214-05 [HS-1-BS-005]	B160147	10.0	10.0	10/07/16
16J0214-06 [HS-1-KS-006]	B160147	10.0	10.0	10/07/16
16J0214-07 [HS-1-DW-007]	B160147	10.0	10.0	10/07/16
16J0214-08 [HS-1-CS-008]	B160147	10.0	10.0	10/07/16
16J0214-09 [HS-1-CS-009]	B160147	10.0	10.0	10/07/16
16J0214-10 [HS-1-CS-010]	B160147	10.0	10.0	10/07/16
16J0214-11 [HS-1-CS-011]	B160147	10.0	10.0	10/07/16
16J0214-12 [HS-1-NS-012]	B160147	10.0	10.0	10/07/16
16J0214-13 [HS-1-BS-013]	B160147	10.0	10.0	10/07/16
16J0214-14 [HS-1-IM-014]	B160147	10.0	10.0	10/07/16
16J0214-15 [HS-1-BS-015]	B160147	10.0	10.0	10/07/16
16J0214-16 [HS-1-BS-016]	B160147	10.0	10.0	10/07/16
16J0214-17 [HS-1-BS-017]	B160147	10.0	10.0	10/07/16
16J0214-18 [HS-1-BS-018]	B160147	10.0	10.0	10/07/16
16J0214-19 [HS-1-BS-019]	B160147	10.0	10.0	10/07/16
16J0214-20 [HS-1-BS-020]	B160147	10.0	10.0	10/07/16

Prep Method: EPA 200.8-EPA 200.8

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0214-21 [HS-1-BS-021]	B160156	10.0	10.0	10/07/16
16J0214-22 [HS-1-BS-022]	B160156	10.0	10.0	10/07/16
16J0214-23 [HS-1-DW-023]	B160156	10.0	10.0	10/07/16
16J0214-24 [HS-1-DW-024]	B160156	10.0	10.0	10/07/16
16J0214-25 [HS-1-BS-025]	B160156	10.0	10.0	10/07/16
16J0214-26 [HS-1-BS-026]	B160156	10.0	10.0	10/07/16
16J0214-27 [HS-1-KS-027]	B160156	10.0	10.0	10/07/16
16J0214-28 [HS-1-CS-028]	B160156	10.0	10.0	10/07/16
16J0214-29 [HS-1-DW-029]	B160156	10.0	10.0	10/07/16
16J0214-30 [HS-1-BS-030]	B160156	10.0	10.0	10/07/16
16J0214-31 [HS-1-BS-031]	B160156	10.0	10.0	10/07/16
16J0214-32 [HS-1-DW-032]	B160156	10.0	10.0	10/07/16
16J0214-33 [HS-1-BS-033]	B160156	10.0	10.0	10/07/16
16J0214-34 [HS-1-BS-034]	B160156	10.0	10.0	10/07/16
16J0214-35 [HS-1-DW-035]	B160156	10.0	10.0	10/07/16
16J0214-36 [HS-1-DW-036]	B160156	10.0	10.0	10/07/16
16J0214-37 [HS-1-BS-037]	B160156	10.0	10.0	10/07/16
16J0214-38 [HS-1-BS-038]	B160156	10.0	10.0	10/07/16
16J0214-39 [HS-1-BS-039]	B160156	10.0	10.0	10/07/16
16J0214-40 [HS-1-BS-040]	B160156	10.0	10.0	10/07/16

Prep Method: EPA 200.8-EPA 200.8

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0214-41 [HS-1-DW-041]	B160157	10.0	10.0	10/07/16
16J0214-42 [HS-1-CS-042]	B160157	10.0	10.0	10/07/16
16J0214-43 [HS-1-CS-043]	B160157	10.0	10.0	10/07/16
16J0214-44 [HS-1-CS-044]	B160157	10.0	10.0	10/07/16
16J0214-45 [HS-1-CS-045]	B160157	10.0	10.0	10/07/16

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Sample Extraction Data**Prep Method: EPA 200.8-EPA 200.8**

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0214-46 [HS-1-CS-046]	B160157	10.0	10.0	10/07/16
16J0214-47 [HS-1-BS-047]	B160157	10.0	10.0	10/07/16
16J0214-48 [HS-1-BS-048]	B160157	10.0	10.0	10/07/16
16J0214-49 [HS-2-CS-049]	B160157	10.0	10.0	10/07/16
16J0214-50 [HS-2-CS-050]	B160157	10.0	10.0	10/07/16
16J0214-51 [HS-2-CS-052]	B160157	10.0	10.0	10/07/16
16J0214-52 [HS-2-CS-053]	B160157	10.0	10.0	10/07/16
16J0214-53 [HS-2-CS-054]	B160157	10.0	10.0	10/07/16
16J0214-54 [HS-2-CS-055]	B160157	10.0	10.0	10/07/16
16J0214-55 [HS-2-CS-056]	B160157	10.0	10.0	10/07/16
16J0214-56 [HS-2-CS-057]	B160157	10.0	10.0	10/07/16
16J0214-57 [HS-2-CS-058]	B160157	10.0	10.0	10/07/16
16J0214-58 [HS-2-DW-059]	B160157	10.0	10.0	10/07/16
16J0214-59 [HS-2-CS-060]	B160157	10.0	10.0	10/07/16
16J0214-60 [HS-2-CS-061]	B160157	10.0	10.0	10/07/16

Prep Method: EPA 200.8-EPA 200.8

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0214-61 [HS-2-CS-062]	B160158	10.0	10.0	10/07/16
16J0214-62 [HS-2-CS-063]	B160158	10.0	10.0	10/07/16
16J0214-63 [HS-2-CS-064]	B160158	10.0	10.0	10/07/16
16J0214-64 [HS-2-CS-065]	B160158	10.0	10.0	10/07/16
16J0214-65 [HS-2-CS-066]	B160158	10.0	10.0	10/07/16
16J0214-66 [HS-2-CS-067]	B160158	10.0	10.0	10/07/16
16J0214-67 [HS-2-CS-068]	B160158	10.0	10.0	10/07/16
16J0214-68 [HS-2-CS-069]	B160158	10.0	10.0	10/07/16
16J0214-69 [HS-2-CS-070]	B160158	10.0	10.0	10/07/16
16J0214-70 [HS-2-CS-071]	B160158	10.0	10.0	10/07/16
16J0214-71 [HS-2-CS-072]	B160158	10.0	10.0	10/07/16
16J0214-72 [HS-2-CS-073]	B160158	10.0	10.0	10/07/16
16J0214-73 [HS-2-CS-074]	B160158	10.0	10.0	10/07/16
16J0214-74 [HS-2-CS-075]	B160158	10.0	10.0	10/07/16
16J0214-75 [HS-2-CS-076]	B160158	10.0	10.0	10/07/16
16J0214-76 [HS-2-CS-077]	B160158	10.0	10.0	10/07/16
16J0214-77 [HS-2-CS-078]	B160158	10.0	10.0	10/07/16
16J0214-78 [HS-2-CS-079]	B160158	10.0	10.0	10/07/16
16J0214-79 [HS-2-CS-080]	B160158	10.0	10.0	10/07/16
16J0214-81 [HS-2-CS-082]	B160158	10.0	10.0	10/07/16

Prep Method: EPA 200.8-EPA 200.8

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0214-80 [HS-2-CS-081]	B160159	10.0	10.0	10/07/16
16J0214-82 [HS-2-CS-083]	B160159	10.0	10.0	10/07/16
16J0214-83 [HS-2-CS-084]	B160159	10.0	10.0	10/07/16
16J0214-84 [HS-2-CS-085]	B160159	10.0	10.0	10/07/16
16J0214-85 [HS-2-CS-086]	B160159	10.0	10.0	10/07/16
16J0214-86 [HS-2-CS-087]	B160159	10.0	10.0	10/07/16
16J0214-87 [HS-2-CS-088]	B160159	10.0	10.0	10/07/16
16J0214-88 [HS-2-CS-089]	B160159	10.0	10.0	10/07/16
16J0214-89 [HS-2-CS-090]	B160159	10.0	10.0	10/07/16
16J0214-90 [HS-2-CS-091]	B160159	10.0	10.0	10/07/16

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332**Sample Extraction Data****Prep Method: EPA 200.8-EPA 200.8**

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0214-91 [HS-2-BS-092]	B160159	10.0	10.0	10/07/16
16J0214-92 [HS-2-BS-093]	B160159	10.0	10.0	10/07/16
16J0214-93 [HS-2-BS-094]	B160159	10.0	10.0	10/07/16
16J0214-94 [HS-2-DW-095]	B160159	10.0	10.0	10/07/16
16J0214-95 [HS-2-BS-096]	B160159	10.0	10.0	10/07/16
16J0214-96 [HS-2-BS-097]	B160159	10.0	10.0	10/07/16
16J0214-97 [HS-2-BS-098]	B160159	10.0	10.0	10/07/16
16J0214-98 [HS-2-BS-099]	B160159	10.0	10.0	10/07/16
16J0214-99 [HS-2-BS-100]	B160159	10.0	10.0	10/07/16

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Metals Analyses (Total) - Quality Control

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch B160147 - EPA 200.8										
Blank (B160147-BLK1)				Prepared: 10/07/16 Analyzed: 10/08/16						
Lead	ND	0.50	µg/L							
LCS (B160147-BS1)				Prepared & Analyzed: 10/07/16						
Lead	38.9	0.50	µg/L	40.0		97.3	85-115			
Duplicate (B160147-DUP1)				Source: 16J0214-01		Prepared: 10/07/16 Analyzed: 10/08/16				
Lead	ND	0.50	µg/L		ND			NC	20	
Duplicate (B160147-DUP2)				Source: 16J0214-02		Prepared: 10/07/16 Analyzed: 10/08/16				
Lead	ND	0.50	µg/L		ND			NC	20	
Matrix Spike (B160147-MS1)				Source: 16J0214-01		Prepared: 10/07/16 Analyzed: 10/08/16				
Lead	25.1	0.62	µg/L	25.0	0.364	98.8	70-130			
Matrix Spike (B160147-MS2)				Source: 16J0214-02		Prepared: 10/07/16 Analyzed: 10/08/16				
Lead	24.8	0.62	µg/L	25.0	0.246	98.1	70-130			
Batch B160156 - EPA 200.8										
Blank (B160156-BLK1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	ND	0.50	µg/L							
LCS (B160156-BS1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	39.3	0.50	µg/L	40.0		98.1	85-115			
Duplicate (B160156-DUP1)				Source: 16J0214-21		Prepared: 10/07/16 Analyzed: 10/10/16				
Lead	2.90	0.50	µg/L		2.90			0.0617	20	
Duplicate (B160156-DUP2)				Source: 16J0214-22		Prepared: 10/07/16 Analyzed: 10/10/16				
Lead	4.42	0.50	µg/L		4.39			0.726	20	
Matrix Spike (B160156-MS1)				Source: 16J0214-21		Prepared: 10/07/16 Analyzed: 10/10/16				
Lead	27.6	0.62	µg/L	25.0	2.90	98.6	70-130			
Matrix Spike (B160156-MS2)				Source: 16J0214-22		Prepared: 10/07/16 Analyzed: 10/10/16				
Lead	29.0	0.62	µg/L	25.0	4.39	98.6	70-130			
Batch B160157 - EPA 200.8										
Blank (B160157-BLK1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	ND	0.50	µg/L							

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Metals Analyses (Total) - Quality Control

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch B160157 - EPA 200.8										
LCS (B160157-BS1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	39.3	0.50	µg/L	40.0		98.1	85-115			
Duplicate (B160157-DUP1)				Source: 16J0214-41 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	ND	0.50	µg/L		ND			NC	20	
Duplicate (B160157-DUP2)				Source: 16J0214-42 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	ND	0.50	µg/L		ND			NC	20	
Matrix Spike (B160157-MS1)				Source: 16J0214-41 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	24.6	0.62	µg/L	25.0	ND	98.5	70-130			
Matrix Spike (B160157-MS2)				Source: 16J0214-42 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	24.7	0.62	µg/L	25.0	0.211	98.0	70-130			
Batch B160158 - EPA 200.8										
Blank (B160158-BLK1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	ND	0.50	µg/L							
LCS (B160158-BS1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	40.8	0.50	µg/L	40.0		102	85-115			
Duplicate (B160158-DUP1)				Source: 16J0214-61 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	8.53	0.50	µg/L		8.53			0.00902	20	
Duplicate (B160158-DUP2)				Source: 16J0214-62 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	3.30	0.50	µg/L		3.28			0.459	20	
Matrix Spike (B160158-MS1)				Source: 16J0214-61 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	33.9	0.62	µg/L	25.0	8.53	102	70-130			
Matrix Spike (B160158-MS2)				Source: 16J0214-62 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	28.9	0.62	µg/L	25.0	3.28	102	70-130			
Batch B160159 - EPA 200.8										
Blank (B160159-BLK1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	ND	0.50	µg/L							
LCS (B160159-BS1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	40.8	0.50	µg/L	40.0		102	85-115			

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Metals Analyses (Total) - Quality Control

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch B160159 - EPA 200.8										
Duplicate (B160159-DUP1)	Source: 16J0214-80			Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	5.16	0.50	µg/L		5.12			0.906	20	
Duplicate (B160159-DUP2)	Source: 16J0214-82			Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	6.82	0.50	µg/L		6.79			0.522	20	
Matrix Spike (B160159-MS1)	Source: 16J0214-80			Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	31.3	0.62	µg/L	25.0	5.12	105	70-130			
Matrix Spike (B160159-MS2)	Source: 16J0214-82			Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	32.3	0.62	µg/L	25.0	6.79	102	70-130			

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

FLAG/QUALIFIER SUMMARY

*	QC result is outside of established limits.
†	Wide recovery limits established for difficult compound.
‡	Wide RPD limits established for difficult compound.
#	Data exceeded client recommended or regulatory level
ND	Not Detected
RL	Reporting Limit
DL	Method Detection Limit
MCL	Maximum Contaminant Level
Percent recoveries and relative percent differences (RPDs) are determined by the software using values in the calculation which have not been rounded.	
No results have been blank subtracted unless specified in the case narrative section.	

CERTIFICATIONS

Certified Analyses included in this Report

Analyte	Certifications
---------	----------------

EPA 200.8 in Drinking Water

Lead NH,NY,MA,CT,RI,ME,VA

The CON-TEST Environmental Laboratory operates under the following certifications and accreditations:

Code	Description	Number	Expires
AIHA	AIHA-LAP, LLC - ISO17025:2005	100033	02/1/2018
MA	Massachusetts DEP	M-MA100	06/30/2017
CT	Connecticut Department of Public Health	PH-0567	09/30/2017
NY	New York State Department of Health	10899 NELAP	04/1/2017
NH-S	New Hampshire Environmental Lab	2516 NELAP	02/5/2017
RI	Rhode Island Department of Health	LAO00112	12/30/2016
NC	North Carolina Div. of Water Quality	652	12/31/2016
NJ	New Jersey DEP	MA007 NELAP	06/30/2017
FL	Florida Department of Health	E871027 NELAP	06/30/2017
VT	Vermont Department of Health Lead Laboratory	LL015036	07/30/2017
ME	State of Maine	2011028	06/9/2017
VA	Commonwealth of Virginia	460217	12/14/2016
NH-P	New Hampshire Environmental Lab	2557 NELAP	09/6/2017



EHS
Laboratories

Environmental Hazards Services, LLC
www.ehs-lab.com 7468 Whitepine Rd
(800) 347-4010 Richmond VA 23237
(804) 276-4007 (fax)

16J0214

WaterSmart® Pro
LEAD ONLY

Chain-of-Custody
Analysis by National Testing Laboratories

~For Lab Use Only~
SEND SAMPLES

TO:

556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name: Envoy Environmental Address: 57 Ambrose Street Rochester, NY 14608
Phone: () 585-454-1060 Fax: () 585-454-1062 E-mail: tknapp@envoyenv.com
Project Name/Testing Address: High School / a Mustang Drive Medina, NY Zip: 14103 Age of Property:
Collected by: Jeff Hertel Certification #: WellTag# (if applicable):

Purchase Order Number: Requisitioned by: Date:

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field PH	Field Chlorides	Temperature at Time of Collection
01	HS-1-KS-001	Kitchen Sink	9-28-16		Lead			
02	HS-1-KS-002				Lead			
03	HS-1-KS-003				Lead			
04	HS-1-KS-004				Lead			
05	HS-1-BS-005	Bathroom Sink			Lead			
06	HS-1-KS-006	Kitchen Sink			Lead			
07	HS-1-DW-007	Drinking Water			Lead			
08	HS-1-CS-008	Classroom Sink			Lead			
09	HS-1-CS-009				Lead			
10	HS-1-CS-010				Lead			

Received by:
Testing Number:

Date:
Temperature:

NIL Lab ID Number

*Paula TC 10.6.16 26.4 9:55

Page 1 of 15


EHS Laboratories

 Environmental Hazards Services, LLC
 www.ehs-lab.com 7455 Whitfield Rd
 (800) 947-0010 Richmond VA 23237
 (804) 276-0007 (fax)

Watersmart@Pro
LEAD ONLY
Chain-of-Custody
 Analysis by National Testing Laboratories

 ~For Lab Use Only ~
SEND SAMPLES
TO:

 556 S. Mansfield St.
 Ypsilanti, MI 48197

 Company Name: Envoy Environmental Address: 57 Ambrose Street City/State/Zip: Rochester, NY 14608
 Phone: () 585-454-1060 Fax: () 585-454-1062 Email: tknapp@envoyenv.com
 Project Name/Testing Address: High School / Mustang Drive City/State (Required): Medina, NY Zip: 14103 Age of Property: _____
 Collected by: Jeff Hertel Certification #: _____ Well Tag # (if applicable): _____
 Purchased Order Number: _____ Relinquished by: _____ Date: _____

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

 SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
 PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field pH	Field Chlorides	Temperature Times of Collection
11	HS-1-CS-011	Classroom Sink	9-28-16		Lead			
12	HS-1-BS-012	Nurse Sink			Lead			
13	HS-1-BS-013	Bathroom Sink			Lead			
14	HS-1-IM-014	Ice Maker			Lead			
15	HS-1-BS-015	Bathroom Sink			Lead			
16	HS-1-BS-016				Lead			
17	HS-1-BS-017				Lead			
18	HS-1-BS-018				Lead			
19	HS-1-BS-019				Lead			
20	HS-1-BS-020				Lead			

 Relinquished by: _____
 Well Tag Number: _____

 Date: _____
 Temperature: _____

NTL Lab ID Number

*Paula NQ 10.6.16 9:55

Page 2 of 15


EHS Laboratories

 Environmental Hazards Services, LLC
 www.ehs-lab.com 7400 Whitepine Rd
 (800) 947-4010 Richmond, VA 23237
 (804) 278-4007 (fax)

16J0214

Watersmart@Pro
LEAD ONLY
Chain-of-Custody
 Analysis by National Testing Laboratories

 ~For Lab Use Only ~
SEND SAMPLES
TO:

 556 S. Mansfield St.
 Ypsilanti, MI 48197

Company Name: Envoy Environmental Address: 57 Ambrose Street City/State/Zip: Rochester, NY 14608
 Phone: () 585-454-1060 Fax: () 585-454-1062 E-mail: tknapp@envoyenv.com Acct. Number:
 Project Name/Testing Address: High School / Mustang Drive City/State (Required): Medina, NY Zip: 14103 Age of Property:
 Collected by: Jeff Horvath Certification #: Well Tag # (if applicable):
 Purchased Order Number: Relinquished by: Date:

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

 SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
 PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (E.g. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field PH	Field Chlorine	Temperature at Time of Collection:
21	HS-1-BS-021	Bathroom Sink	9-28-16		Lead			
22	HS-1-BS-022	Bathroom Sink			Lead			
23	HS-1-DW-023	Drinking Water			Lead			
24	HS-1-DW-024	Drinking Water			Lead			
25	HS-1-BS-025	Bathroom Sink			Lead			
26	HS-1-BS-026	Bathroom Sink			Lead			
27	HS-1-KS-027	Kitchen Sink			Lead			
28	HS-1-CS-028	Classroom Sink			Lead			
29	HS-1-DW-029	Drinking Water			Lead			
30	HS-1-BS-030	Bathroom Sink	✓	✓	Lead			
Sealed by:		Date:		Time:		Time:		
Sealing Number:		Date:		Time:		Time:		

Page 3 of 15 * Paula P 10.6.16 9:55


EHS Laboratories

 Environmental Hazards Services, LLC
 www.ehs-lab.com
 (800) 947-0810
 (800) 278-0807 (fax)
 2459 Whitestone Rd
 Richmond, VA 23237

16J0214

WaterSmart@Pro
LEAD ONLY
Chain-of-Custody
 Analysis by National Testing Laboratories

 ~For Lab Use Only ~
SEND SAMPLES
TO:
 556 S. Mansfield St.
 Ypsilanti, MI 48197

 Company Name Envoy Environmental Address 57 Ambrose Street City/State/Zip Rochester, NY 14608
 Phone: () 585-454-1060 Fax: () 585-454-1062 E-mail: tknapp@envoyenv.com Acct. Number _____
 Project Name/Testing Address High School / a Mustang Drive City/State (Required) Medina, NY Zip 14103 Age of Property _____
 Collected by Jeff Horvath Certification # _____ Well Tag # (if applicable) _____
 Purchaser Order Number _____ Relinquished by _____ Date _____

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

 SAMPLES SUBMITTED ALL LEAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
 PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte Requested	Field Parameters		
						Field pH	Field Chlorine	Temperature at Time of Collection
31	HS-1-B5-031	Bathroom Sink	9-28-16		Lead			
32	HS-1-DW-032	Drinking Water			Lead			
33	HS-1-B5-033	Bathroom Sink			Lead			
34	HS-1-B5-034	Bathroom Sink			Lead			
35	HS-1-DW-035	Drinking Water			Lead			
36	HS-1-DW-036	Drinking Water			Lead			
37	HS-1-B5-037	Bathroom Water			Lead			
38	HS-1-B5-038	Bathroom Water			Lead			
39	HS-1-B5-039				Lead			
40	HS-1-B5-040				Lead			

Relinquished by _____ Date _____
 Date _____ Time _____
 NTL Lab ID Number _____

 Date: _____
 Temperature: _____

10.6.16 9:55

Page 4 of 15



EHS Laboratories

Environmental Hazards Services, LLC
www.ehs-lab.com 7400 Whitepine Rd
(800) 347-0110 Richmond, VA 23227
(804) 276-8807 (fax)

Watersmart@Pro
LEAD ONLY

Chain-of-Custody
Analysis by National Testing Laboratories

~For Lab Use Only ~
SEND SAMPLES

TO:

556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name: Envoy Environmental

Address: 57 Ambrose Street

Rochester, NY 14608

Phone: () 585-454-1060 Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

City/State/Zip: Rochester, NY 14608

Project Name/Testing Address: High School / Mustang Drive City/State (Required): Medina, NY Zip: 14103 Age of Property:

Collected by: Jeff Horvath Certification #: Well Tag # (if applicable):

Purchase Order Number: Relinquished by: Date:

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.

PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field Pb	Field Chlorine	Temperature at Time of Collection
41 1	HS-1-DW-041	Drinking Water	9-28-16		Lead			
42 2	HS-1-CS-042	Classroom Sink			Lead			
43 3	HS-1-CS-043				Lead			
44 4	HS-1-CS-044				Lead			
45 5	HS-1-CS-045				Lead			
46 6	HS-1-CS-046				Lead			
47 7	HS-1-CS-047	Bathroom Sink			Lead			
48 8	HS-1-CS-048	Bathroom Sink			Lead			
49 9	HS-2-CS-049	Classroom Sink			Lead			
50 10	HS-2-CS-050	Classroom Sink			Lead			
Received by:						Time:		
Testing Number:						NTL Lab ID Number		

Page 5 of 15 Paul D 10.6.16 9:55



EHS Laboratories

Environmental Hazards Services, LLC
www.ehsllc.com 7460 Whiteline Rd
(800) 347-4010 Richmond VA 23227
(804) 276-0007 (fax)

16J0214

WaterSmart@Pro
LEAD ONLY

Chain-of-Custody
Analyte by National Testing Laboratories

~For Lab Use Only~
SEND SAMPLES

TO:

556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name Envoy Environmental

Address 57 Ambrose Street

City/State/Zip Rochester, NY 14608

Phone: () 585-454-1060 Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Acct. Number

Project Name/Testing Address High School / Mustang Drive City/State (Required) Medina, NY Zip 14103 Age of Property

Collected by Jeff Horvath Certification # Wall Tag # (If applicable)

Purchase Order Number Reanalyzed by Date

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.

PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analyte Requested	Field Parameters		
						Field PbL	Field Chlorides	Temperature at Time of Collection
51	HS-2-CS-052	Classroom Sink	9-28-16		Lead			
52	HS-2-CS-053				Lead			
53	HS-2-CS-054				Lead			
54	HS-2-CS-055				Lead			
55	HS-2-CS-056				Lead			
56	HS-2-CS-057				Lead			
57	HS-2-CS-058				Lead			
58	HS-2-DW-059	Drinking Water			Lead			
59	HS-2-CS-060	Classroom Sink			Lead			
60	HS-2-CS-061	Classroom Sink			Lead			

Reanalyzed by Date

Temperature

NITL Lab ID Number

Page 6 of 15 Paul NO 10/6/16 9:55



EHS Laboratories

Environmental Hazards Services, LLC
www.ehs-lab.com 7489 Whitestone Rd
(800) 347-4010 Richmond VA 23237
(804) 276-0007 (fax)

WaterSmart® Pro
LEAD ONLY

Chain-of-Custody
Analysis by National Testing Laboratories

~For Lab Use Only~
SEND SAMPLES
TO:
556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip Rochester, NY 14608

Phone: () 585-454-1060 Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Acct. Number

Project Name/ Testing Address High School / Mustang Drive

City/State (Required) Medina, NY Zip 14103

Age of Property

Collected by: Jeff Horvath

Certification # Well Tag # (if applicable)

Purchase Order Number

Relinquished by

Date

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS. PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field pH	Field Chlorides	Temperature at Time of Collection
601	HS-2-CS-062	Classroom Sink	9-28-16		Lead			
602	HS-2-CS-063				Lead			
603	HS-2-CS-064				Lead			
604	HS-2-CS-065				Lead			
605	HS-2-CS-066				Lead			
606	HS-2-CS-067				Lead			
607	HS-2-CS-068				Lead			
608	HS-2-CS-069				Lead			
609	HS-2-CS-070				Lead			
7010	HS-2-CS-071				Lead			
Received by:						Time:		
Signing Number:						Temperature:		
Page 7 of 15 Paul X 10.6.16 9:55						NIL Lab ID Number		



EHS
Laboratories

Environmental Hazards Services, LLC
www.ehs-lab.com 7469 Whitepine Rd
(800) 347-4010 Richmond VA 23237
(804) 276-6907 (fax)

16J0214

WaterSmart@Pro
LEAD ONLY

Chain-of-Custody
Analysis by National Testing Laboratories

~For Lab Use Only~
SEND SAMPLES
TO:
556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone () 585-454-1060

Fax () 585-454-1062

E-mail: tknapp@envoyenv.com

Project Name/Testing Address: High School / Mustang Drive

City/State (Required): Medina, NY

Zip: 14103

Age of Property:

Collected by: Jeff Horne

Certification #:

Well Tag # (if applicable):

Purchase Order Number:

Relinquished by:

Date:

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		Temperature at Time of Collection:
						Field PbL	Field Chlorides	
71	HS-2-CS-072	Classroom Sink	9-28-16		Lead			
72	HS-2-CS-073				Lead			
73	HS-2-CS-074				Lead			
74	HS-2-CS-075				Lead			
75	HS-2-CS-076				Lead			
76	HS-2-CS-077				Lead			
77	HS-2-CS-078				Lead			
78	HS-2-CS-079				Lead			
79	HS-2-CS-080				Lead			
80	HS-2-CS-081				Lead			
Received by:						Time:		NTL Lab ID Number
Signature Number:								

Page 8 of 15 Paul D 10.6.16 9:55


EHS Laboratories

 Environmental Hazardous Services, LLC
 www.ehs-lab.com 7450 Whitlaine Rd
 (800) 347-4010 Richmond VA 23237
 (804) 276-4007 (fax)

WaterSmart® Pro
LEAD ONLY
Chain-of-Custody
 Analysis by National Testing Laboratories

 ~For Lab Use Only ~
SEND SAMPLES
TO:
 556 S. Mansfield St.
 Ypsilanti, MI 48197

 Company Name Envoy Environmental Address 57 Ambrose Street City/State/Zip Rochester, NY 14608
 Phone () 585-454-1060 Fax () 585-454-1062 E-mail tknapp@envoyenv.com Acct. Number _____
 Project Name/ Testing Address High School / Mustang Drive City/State (Required) Medina, NY Zip 14103 Age of Property _____
 Collected by Jeff Horvath Certification # _____ Well Tag # (If applicable) _____
 Purchase Order Number _____ Reimaged by _____ Date _____

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

 SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
 PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (EX: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Fish Pb	Field Chlorides	Temperature at Time of Collection
81	HS-2-CS-082	CLASSROOM SINK	9-28-16		Lead			
82	HS-2-CS-083				Lead			
83	HS-2-CS-084				Lead			
84	HS-2-CS-085				Lead			
85	HS-2-CS-086				Lead			
86	HS-2-CS-087				Lead			
87	HS-2-CS-088				Lead			
88	HS-2-CS-089				Lead			
89	HS-2-CS-090				Lead			
90	HS-2-CS-091				Lead			
Received by:		Date:		Time:		NTL Lab ID Number		
Selling Number:		Date:		Time:				

Page 9 of 15 * Paula VS 10.6.16 9:55

39 Spruce St.
East Longmeadow, MA. 01028
P: 413-525-2332
F: 413-525-6405
www.contestlabs.com



con-test
ANALYTICAL LABORATORY

Page 1 of 2

Sample Receipt Checklist

CLIENT NAME: EHS RECEIVED BY: PB DATE: 10.6.16

1) Was the chain(s) of custody relinquished and signed? Yes ☒ No ☐ No COC Incl.

2) Does the chain agree with the samples? Yes ☒ No ☐

If not, explain:

3) Are all the samples in good condition? Yes ☒ No ☐

If not, explain:

4) How were the samples received:

On Ice ☐ Direct from Sampling ☐ Ambient ☒ In Cooler(s) ☐

Were the samples received in Temperature Compliance of (2-6°C)? Yes ☐ No ☒ N/A ☐

Temperature °C by Temp blank ☐ Temperature °C by Temp gun 26.4

5) Are there Dissolved samples for the lab to filter? Yes ☐ No ☒

Who was notified ☐ Date ☐ Time ☐

6) Are there any RUSH or SHORT HOLDING TIME samples? Yes ☐ No ☒

Who was notified ☐ Date ☐ Time ☐

7) Location where samples are stored:

metals counter

Permission to subcontract samples? Yes No
(Walk-in clients only) if not already approved

Client Signature: ☐

8) Do all samples have the proper Acid pH: Yes ☐ No ☐ N/A ☒

9) Do all samples have the proper Base pH: Yes ☐ No ☐ N/A ☒

10) Was the FC notified of any discrepancies with the CoC vs the samples: Yes ☐ N/A ☒

Containers received at Con-Test

	# of containers		# of containers
1 Liter Amber		16 oz amber	
500 mL Amber		8 oz amber/clear jar	
250 mL Amber (8oz amber)		4 oz amber/clear jar	
1 Liter Plastic		2 oz amber/clear jar	
500 mL Plastic		Plastic Bag / Ziploc	
250 mL plastic	99	SOC Kit	
40 mL Vial - type listed below		Perchlorate Kit	
Colisure / bacteria bottle		Flashpoint bottle	
Dissolved Oxygen bottle		Other glass jar	
Encore		Other	

40 mL vials: # HCl ☐ # Methanol ☐

Time and Date Frozen: ☐

Doc# 277 # Bisulfate ☐ # DI Water ☐

Rev. 4 August 2013 # Thiosulfate ☐ Unpreserved ☐

Login Sample Receipt Checklist

(Rejection Criteria Listing - Using Sample Acceptance Policy)

Any False statement will be brought to the attention of Client

Question	Answer (True/False)	Comment
	T/F/NA	
1) The cooler's custody seal, if present, is intact.	NA	
2) The ^{Box} cooler or samples do not appear to have been compromised or tampered with.	T	
3) Samples were received on ice.	F	No cooler, No Ice
4) ^{Sample} Cooler Temperature is acceptable.	T	metals Analysis
5) ^{Box} Cooler Temperature is recorded.	T	
6) COC is filled out in ink and legible.	T	
7) COC is filled out with all pertinent information.	T	
8) Field Sampler's name present on COC.	T	
9) There are no discrepancies between the sample IDs on the container and the COC.	T	
10) Samples are received within Holding Time.	T	
11) Sample containers have legible labels.	T	
12) Containers are not broken or leaking.	T	
13) Air Cassettes are not broken/open.	NA	
14) Sample collection date/times are provided.	T	
15) Appropriate sample containers are used.	T	
16) Proper collection media used.	T	
17) No headspace sample bottles are completely filled.	NA	
18) There is sufficient volume for all requested analyses, including any requested MS/MSDs.	T	
19) Trip blanks provided if applicable.	NA	
20) VOA sample vials do not have head space or bubble is <6mm (1/4") in diameter.	NA	
21) Samples do not require splitting or compositing.	T	

Who notified of False statements?

Log-In Technician Initials: PB

Date/Time:

Date/Time: 10.6.16

9:55



1650214

WaterSmart Pro
LEAD ONLY



16-10-01545

EHS Laboratories

Environmental Remediation Services, LLC
www.ehs-lab.com 7689 Whitehouse Rd
Rochester, NY 14626
(800) 276-4807 (local)

Chain-of-Custody
Analysis by National Testing Laboratories

Due Date:
10/20/2016
(Thursday)
ER MC

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Anal. Number:

Project Name/Testing Address: High School / Mustang Drive

City/State/County: Medina, NY

Zip: 14103

Age of Property:

Collected by: Jeff Hordel

Certification:

Waiting # (if applicable):

Barcode Order Number:

Relinquished by:

Date:

ALL SAMPLES MUST BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED MUST HAVE THE SAMPLE PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.

PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES RECEIVED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field ID#	Field Collector	Temperature at Time of Collection
01	HS-1-KS-001	Kitchen Sink	9-28-16		Lead			
02	HS-1-KS-002				Lead			
03	HS-1-KS-003				Lead			
04	HS-1-KS-004				Lead			
05	HS-1-RS-005	Bathroom Sink			Lead			
06	HS-1-KS-006	Kitchen Sink			Lead			
07	HS-1-DW-007	Drinking Water			Lead			
08	HS-1-CS-008	Classroom Sink			Lead			
09	HS-1-CS-009				Lead			
10	HS-1-CS-010				Lead			

Tested by:

Date:

Time:

NTL Lab ID Number



1650214

WaterSmartPro
LEAD ONLY

Chain-of-Custody
Analyte by National Testing Laboratories

Environmental Resource Services, LLC
2009 Whitehouse Rd
Rochester, NY 14627
(800) 341-8919
(800) 278-4887 (fax)

~For Lab Use Only~
SEND SAMPLES
TO:
556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name: Envoy Environmental Address: 57 Ambrose Street City/State/Zip: Rochester, NY 14608
Phone: () 585-454-1060 Fax: () 585-454-1062 Email: tknapp@envoyenv.com Alt. Number:
Project Name/Testing Address: High School / a mustang drive City/State/Zip: Medina, NY Zip: 14103 Age of Property:
Collected by: Jeff Horrel Certification: Waiting # (if applicable):
Purchase Order Number: Registered by: Date:

ALL SAMPLES MUST BE STORED IN AVALIATED FOR LEAD IN DRINKING WATER
SAMPLERS SUBMITTER MUST HAVE THE NAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
PLEASE PROVIDE A SINGLE KEY FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						PH	Temp	Time of Collection
11	HS-1-CS-011	Classroom Sink	9-28-16		Lead			
12	HS-1-NS-012	Nurse Sink			Lead			
13	HS-1-RS-013	Bathroom Sink			Lead			
14	HS-1-IM-014	Ice Maker			Lead			
15	HS-1-RS-015	Bathroom Sink			Lead			
16	HS-1-RS-016				Lead			
17	HS-1-RS-017				Lead			
18	HS-1-RS-018				Lead			
19	HS-1-RS-019				Lead			
20	HS-1-RS-020				Lead			

Specified by:
Section/ID Number:
Date:
Time:
Temperature:
NTL Lab ID Number

Page 2 of 15
*Paula HQ 10.6.16 9:56

1545



1650214

WaterSmartPro
LEAD ONLYChain-of-Custody
Analysis by National Testing LaboratoriesEnvironmental Records Services, LLC
www.ehs-lab.com 7409 Wirthglen Dr
(800) 597-4019 Richmond VA 23267
(804) 276-6807 (fax)

Company Name Envoy Environmental

Address 57 Ambrose Street

City/State/Zip Rochester, NY 14608

Phone () 585-454-1060

Fax () 585-454-1062

E-mail tknapp@envoyenv.com

Acct Number

Project Name/Testing Address High School / Mustang Drive

City/State/County Medina, NY

Zip 14103

Age of Property

Collected by Jeff Horvath

Certificate #

Waiting / Graphical

Purchase Order Number

Relinquished by

Date

ALL SAMPLES MUST BE STORED IN THE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED AT THE ABOVE ADDRESS ARE ANALYZED FOR LEAD IN DRINKING WATER

PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field ID	Field Collection	Temperature at Time of Collection
21	HS-1-B5-021	Bathroom Sink	9-28-16		Lead			
22	HS-1-B5-022	Bathroom Sink			Lead			
23	HS-1-DW-023	Drinking Water			Lead			
24	HS-1-DW-024	Drinking Water			Lead			
25	HS-1-B5-025	Bathroom Sink			Lead			
26	HS-1-B5-026	Bathroom Sink			Lead			
27	HS-1-KS-027	Kitchen Sink			Lead			
28	HS-1-CS-028	Classroom Sink			Lead			
29	HS-1-DW-029	Drinking Water			Lead			
30	HS-1-B5-030	Bathroom Sink			Lead			

Specimen by:

Date:

Time:

Time:

NTL Lab ID Number

Page 3 of 15

* Paula R 10.10.16 9:55

1545



1650214

WaterSmartPro
LEAD ONLYChain-of-Custody
Analysis by National Testing LaboratoriesEnvironmental Records Services, LLC
www.ehsllabs.com 7609 Waltham Rd
(800) 347-4819 Richmond VA 23237
(800) 276-6807 (fax)

Company Name Envoy Environmental

Address 57 Ambrose Street

City/State/Zip Rochester, NY 14608

Phone: () 585-454-1060 Fax: () 585-454-1062 E-mail: tknapp@envoyenv.com

Acct Number

Project Name/Testing Address High School/2 Mustang Drive City/State/Zip/County Medina, NY Zip 14103 Age of Property

Collected by Jeff Horvath Certification # Waiting # (if applicable)

Purchase Order Number

Relinquished by

Date

ALL SAMPLES SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLER'S SIGNATURE AND PRINTED NAME REQUIRED. ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.

PLEASE PROVIDE A SINGLE RESPONSE FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (or Kitchen Sink)	Collection Date	Collection Time	Analyst Requested	Field Parameters		
						Field pH	Field Chlorine	Temperature at Time of Collection
31.1	HS-1-BS-031	Bathroom Sink	9-28-16		Lead			
32.2	HS-1-DW-032	Drinking Water			Lead			
33.3	HS-1-BS-033	Bathroom Sink			Lead			
34.4	HS-1-BS-034	Bathroom Sink			Lead			
35.5	HS-1-DW-035	Drinking Water			Lead			
36.6	HS-1-DW-036	Drinking Water			Lead			
37.7	HS-1-BS-037	Bathroom Water			Lead			
38.8	HS-1-BS-038	Bathroom Water			Lead			
39.9	HS-1-BS-039	Bathroom Water			Lead			
40.10	HS-1-BS-040				Lead			

Showered by:

Dressing Room Number

Date

Temperature

NTL Lab ID Number

Page 4 of 15

Paula XO

10.6.16 9:55

1545

~For Lab Use Only~
SEND SAMPLES
TO:
556 S. Mansfield St.
Ypsilanti, MI 48197



1650214

WaterSmartPro
LEAD ONLY

Chain-of-Custody

Analysis by National Testing Laboratories

Environmental Science Services, LLC
www.ehs-lab.com 268 Waltham St
Andover, MA 01810
(800) 276-1807 (Fax)

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060 Fax: () 585-454-1062 E-mail: tknapp@envoyenv.com

Alt. Number:

Project Name/Testing Address: High School / Mustang Drive City/State/Zip: Medina, NY Zip: 14103 Age of Building:

Collected by: Jeff Horvath Certified/Not: Yes/No: No

Reference Number:

Relinquished by:

Date:

ALL SAMPLES WILL ONLY BE USED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED AT ABOVE ADDRESS ARE ANALYZED FOR LEAD IN DRINKING WATER.

PLEASE PROVIDE A CHAIN OF CUSTODY FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						FIELDER	Field Collection	Temperature at Time of Collection
41	HS-1-DW-041	Drinking Water	9-28-16		Lead			
42	HS-1-CS-042	Classroom Sink			Lead			
43	HS-1-CS-043				Lead			
44	HS-1-CS-044				Lead			
45	HS-1-CS-045				Lead			
46	HS-1-CS-046				Lead			
47	HS-1-CS-047	Bathroom Sink			Lead			
48	HS-1-CS-048	Bathroom Sink			Lead			
49	HS-2-CS-049	Classroom Sink			Lead			
50	HS-2-CS-050	Classroom Sink			Lead			
Initiated by:						Date:	Time:	
Initiated by:						Date:	Time:	

NTL Lab ID Number

Page 5 of 15

Paula D 10.6.16 9:55

1545



1650214

WaterSense Pro
LEAD ONLY

EHS Laboratories
Environmental Remedial Services, LLC
www.ehs-lab.com 260 W. Main St.
(800) 547-4819 Richmond VA 23267
(804) 276-1807 (fax)

Chain-of-Custody
Analysis by National Testing Laboratories

~For Lab Use Only~
SEND SAMPLES
TO:
556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Alt. Number:

Project Name/Testing Address: High School / Ambrose Drive

City/State/Region: Medina, NY

Zip: 14103 Age of Property:

Collected by: Jeff Horvath

Certification #:

Waiting / Availability:

Reference Order Number:

Relinquished by:

Date:

NTL SAMPLES WILL ONLY BE USED IF THE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED AT THE ABOVE ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.

PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field ID#	Field Collection	Temperature at Time of Collection
51	HS-2-CS-052	Classroom Sink	9-28-16		Lead			
52	HS-2-CS-053				Lead			
53	HS-2-CS-054				Lead			
54	HS-2-CS-055				Lead			
55	HS-2-CS-056				Lead			
56	HS-2-CS-057				Lead			
57	HS-2-CS-058				Lead			
58	HS-2-DW-059	Drinking Water			Lead			
59	HS-2-CS-060	Classroom Sink			Lead			
60	HS-2-CS-061	Classroom Sink			Lead			

Collected by:

Date:

Time:

NTL Lab ID Number

Page 16 of 15 Paul 10/6/16 9:55

1545



1650214

WaterSmartPro
LEAD ONLY

Chain-of-Custody
Analysis by Mediamet Testing Laboratories

Environmental Records Services, LLC
mediamet@earthlink.net
(800) 347-4016 7400 Wintonbury
(609) 276-4007 (fax) Richmond VA 22807

Company Name Envoy Environmental

Address 57 Ambrose Street

City/State/Zip Rochester, NY 14608

Phone () 585-454-1060

Fax () 585-454-1062

E-mail tknapp@envoyenv.com

Account Number

Project Name/Testing Address High School/Armstrong Drive

City/State/County Medina, NY

Zip 14103 Age of Property

Collected by Jeff Horvath

Card Number

Wall Tag # 0709040101

Purchase Order Number

Relinquished by

Date

ALL SAMPLES MUST BE STORED IN A VIALIZED BOTTLE FOR LEAD IN DRINKING WATER

PLEASE PROVIDE A CHAIN-OF-CUSTODY REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN-OF-CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Fish pH	Fish Chlorine	Temperature at Time of Collection
611	HS-2-CS-062	Classroom Sink	9-28-16		Lead			
612	HS-2-CS-063				Lead			
613	HS-2-CS-064				Lead			
614	HS-2-CS-065				Lead			
615	HS-2-CS-066				Lead			
616	HS-2-CS-067				Lead			
617	HS-2-CS-068				Lead			
618	HS-2-CS-069				Lead			
619	HS-2-CS-070				Lead			
7010	HS-2-CS-071				Lead			

Analyst by:

Client Signature

Date

Temperature

Time

NTL Lab ID Number

Page 7 of 15

Paula XO

10.6.16 9:55

1545



1650214

WaterSmartPro

LEAD ONLY

Chain-of-Custody

Analyte by National Testing Laboratories

~For Lab Use Only~
SEND SAMPLES
TO:
556 S. Mansfield St.
Ypsilanti, MI 48197

Environmental Hazards Services, LLC
www.ehs-lab.com
(800) 547-4018
(313) 216-4007 (Fax)
2425 Witherby Rd
Farmington, VA 22041

Company Name Envoy Environmental
Address 57 Ambrose Street
City/State/Zip Rochester, NY 14608

Phone () 585-454-1060 Fax () 585-454-1062
Email: thnapp@envoyenv.com

Project Name/Testing Address High School / Mustang Drive
City/State/Zip/County Medina, NY
Page 14103 Age of Property

Collected by Jeff Horvath
Certificate #
Waiting/Dispatched

Revised Order Number
Relinquished by
Date

ALL SAMPLES MUST BE STORED IN THE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED AT ABOVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.

PLEASE PROVIDE A CHAIN-OF-CUSTODY FOR ALL SAMPLES INCLUDED ON THIS CHAIN-OF-CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analyte Requested	Field Parameters		
						Field pH	Field Chlorine	Temperature (Temp. of Collection)
71	HS-2-CS-072	CHSroom Sink	9-28-16		Lead			
72	HS-2-CS-073				Lead			
73	HS-2-CS-074				Lead			
74	HS-2-CS-075				Lead			
75	HS-2-CS-076				Lead			
76	HS-2-CS-077				Lead			
77	HS-2-CS-078				Lead			
78	HS-2-CS-079				Lead			
79	HS-2-CS-080				Lead			
80	HS-2-CS-081				Lead			

Specified by
Date
Time
Temperature

NTL Lab ID Number

Page 8 of 15
Paul Q 10.6.16 9:55

1545



11050214

WaterSmartPro
LEAD ONLY

Chain-of-Custody

Analyte by National Testing Laboratories

Environmental Hazards Services, LLC
www.ehs-lab.com
(800) 547-4916
(609) 276-4907 (fax)
2450 Waltham Rd
Rochester, NY 14626

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Account Number:

Project Name/Testing Address: High School/Armstrong Drive

City/State/Zip: Medina, NY

Zip: 14103 Age of Property:

Collected by: JESS Horvath

Certification:

Waiting # (if applicable):

Purchase Order Number:

Relinquished by:

Date:

ALL SAMPLES MUST BE STORED IN A CONTAINER Labeled FOR LEAD IN DRINKING WATER
SAMPLES SUBMITTED MUST HAVE THE NAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analyte Requested	Field Parameters		
						Field ID	Field Collection	Temperature at Time of Collection
811	HS-2-CS-082	Classroom Sink	9-28-16		Lead			
822	HS-2-CS-083				Lead			
833	HS-2-CS-084				Lead			
844	HS-2-CS-085				Lead			
855	HS-2-CS-086				Lead			
866	HS-2-CS-087				Lead			
877	HS-2-CS-088				Lead			
888	HS-2-CS-089				Lead			
899	HS-2-CS-090				Lead			
900	HS-2-CS-091				Lead			

Requested by:

Date:

Time:

Testing Method:

Temperature:

NIL Lab ID Number

Page 9 of 15

* Paula XO 10-6-16 9:55

1545



1650214

WaterSmartPro
LEAD ONLY

Chain-of-Custody

Analyte by National Testing Laboratories

Environmental Services, LLC
www.ntsllabs.com
(800) 347-4819
6803 276-4907 (fax)

~For Lab Use Only~
SEND SAMPLES TO:
556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Account Number:

Project Name/Testing Address: High School / Mustang Drive

City/State/Zip: Medina, NY

Zip: 14103

Age of Property:

Collected by: JESS Horvath

Certification:

Wet/Dry (if applicable):

Purchase Order Number:

Relayed by:

Date:

ALL SAMPLES MUST BE STORED IN A REFRIGERATOR FOR LEAD IN DRINKING WATER

SAMPLES MUST BE LABELED WITH THE NAME, PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.

PLEASE PROVIDE A CHAIN-OF-CUSTODY FOR ALL SAMPLES INCLUDED ON THIS CHAIN-OF-CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analyte Requested	Field Parameters		
						Field pH	Field Color	Temperature at Time of Collection
91	HS-2-B5-093	Backroom Sink	4-28-16		Lead			
90	HS-2-B5-093				Lead			
93	HS-2-B5-094				Lead			
94	HS-2-D10-095	Drinking Water Bathroom Sink			Lead			
95	HS-2-B5-096				Lead			
96	HS-2-B5-097				Lead			
97	HS-2-B5-098				Lead			
98	HS-2-B5-099				Lead			
99	HS-2-B5-100				Lead			
10	HS-2-B5-101				Lead			

Received by:

Date:

Temperature:

Time:

NIL Lab ID Number

Page 10 of 15

*Paula BLe 10.6.16 9:55

1545

Table of Contents

Sample Summary	5
Case Narrative	7
Sample Results	8
16J0225-01	8
16J0225-02	9
16J0225-03	10
16J0225-04	11
16J0225-05	12
16J0225-06	13
16J0225-07	14
16J0225-08	15
16J0225-09	16
16J0225-10	17
16J0225-11	18
16J0225-12	19
16J0225-13	20
16J0225-14	21
16J0225-15	22
16J0225-16	23
16J0225-17	24
16J0225-18	25
16J0225-19	26
16J0225-20	27
16J0225-21	28
16J0225-22	29

Table of Contents (continued)

16J0225-23	30
16J0225-24	31
16J0225-25	32
16J0225-26	33
16J0225-27	34
16J0225-28	35
16J0225-29	36
16J0225-30	37
16J0225-31	38
16J0225-32	39
16J0225-33	40
16J0225-34	41
16J0225-35	42
16J0225-36	43
16J0225-37	44
16J0225-38	45
16J0225-39	46
16J0225-40	47
16J0225-41	48
16J0225-42	49
Sample Preparation Information	50
QC Data	52
Metals Analyses (Total)	52
B160160	52
B160165	52

Table of Contents (continued)

B160229	52
B160244	53
Flag/Qualifier Summary	54
Certifications	55
Chain of Custody/Sample Receipt	56

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Environmental Hazards Services, LLC
7469 White Pine Road
Richmond, VA 23237
ATTN: Greg Brown

REPORT DATE: 10/13/2016

PURCHASE ORDER NUMBER:

PROJECT NUMBER: [none]

ANALYTICAL SUMMARY

WORK ORDER NUMBER: 16J0225

The results of analyses performed on the following samples submitted to the CON-TEST Analytical Laboratory are found in this report.

PROJECT LOCATION: High School - 2 Mustang Drive., Medina, NY

FIELD SAMPLE #	LAB ID:	MATRIX	SAMPLE DESCRIPTION	TEST	SUB LAB
HS-2-BS-101	16J0225-01	Drinking Water	Bathroom Sink	EPA 200.8	
HS-2-KS-102	16J0225-02	Drinking Water	Kitchen Sink	EPA 200.8	
HS-2-CS-103	16J0225-03	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-104	16J0225-04	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-105	16J0225-05	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-106	16J0225-06	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-107	16J0225-07	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-108	16J0225-08	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-109	16J0225-09	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-110	16J0225-10	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-111	16J0225-11	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-112	16J0225-12	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-113	16J0225-13	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-114	16J0225-14	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-115	16J0225-15	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-116	16J0225-16	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-117	16J0225-17	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-118	16J0225-18	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-119	16J0225-19	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-120	16J0225-20	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-121	16J0225-21	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-122	16J0225-22	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-123	16J0225-23	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-124	16J0225-24	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-125	16J0225-25	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-126	16J0225-26	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-127	16J0225-27	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-128	16J0225-28	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-129	16J0225-29	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-130	16J0225-30	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-131	16J0225-31	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-132	16J0225-32	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-133	16J0225-33	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-134	16J0225-34	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-135	16J0225-35	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-136	16J0225-36	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-137	16J0225-37	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-138	16J0225-38	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-139	16J0225-39	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-140	16J0225-40	Drinking Water	Classroom Sink	EPA 200.8	
HS-2-CS-141	16J0225-41	Drinking Water	Classroom Sink	EPA 200.8	

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Environmental Hazards Services, LLC
7469 White Pine Road
Richmond, VA 23237
ATTN: Greg Brown

REPORT DATE: 10/13/2016

PURCHASE ORDER NUMBER:

PROJECT NUMBER: [none]

ANALYTICAL SUMMARY

WORK ORDER NUMBER: 16J0225

The results of analyses performed on the following samples submitted to the CON-TEST Analytical Laboratory are found in this report.

PROJECT LOCATION: High School - 2 Mustang Drive., Medina, NY

FIELD SAMPLE #	LAB ID:	MATRIX	SAMPLE DESCRIPTION	TEST	SUB LAB
HS-2-CS-142	16J0225-42	Drinking Water	Classroom Sink	EPA 200.8	

CASE NARRATIVE SUMMARY

All reported results are within defined laboratory quality control objectives unless listed below or otherwise qualified in this report.

The results of analyses reported only relate to samples submitted to the Con-Test Analytical Laboratory for testing.

I certify that the analyses listed above, unless specifically listed as subcontracted, if any, were performed under my direction according to the approved methodologies listed in this document, and that based upon my inquiry of those individuals immediately responsible for obtaining the information, the material contained in this report is, to the best of my knowledge and belief, accurate and complete.

A handwritten signature in black ink, appearing to read "Lisa Worthington", is written over a light pink rectangular background.

Lisa A. Worthington
Project Manager

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Bathroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-BS-101

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-01

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.2	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:59	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M

Sample Description: Kitchen Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-KS-102

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-02

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	1.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:09	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-103

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-03

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	12	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:13	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-104

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-04

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	5.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:16	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-105

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-05

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.9	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:42	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-106

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-06

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	5.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:46	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-107

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-07

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	9.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:49	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-108

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-08

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	6.3	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:53	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-109

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-09

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	RL	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
			MA	ORSG					Prepared	Analyzed	
Lead	7.6	0.50	15		µg/L	1		EPA 200.8	10/7/16	10/10/16 10:56	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-110

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-10

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	7.2	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:59	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-111

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-11

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	8.2	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:03	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-112

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-12

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	11	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:06	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-113

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-13

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	12	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:09	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-114

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-14

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	6.0	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:13	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-115

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-15

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	11	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:23	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-116

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-16

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	ND	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:27	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-117

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-17

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.5	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:30	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-118

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-18

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	5.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:33	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-119

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-19

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	6.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:37	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-120

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-20

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	22	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 11:40	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-121

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-21

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	7.9	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:40	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-122

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-22

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	7.3	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:53	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-123

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-23

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	5.7	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 9:57	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-124

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-24

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	2.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:01	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-125

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-25

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	5.1	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:06	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-126

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-26

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	12	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:18	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-127

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-27

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	27	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:23	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-128

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-28

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	11	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:27	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-129

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-29

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	42	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:31	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-130

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-30

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	17	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:35	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-131

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-31

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	6.2	0.50	15	µg/L	1		EPA 200.8	10/7/16	10/10/16 10:40	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-132

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-32

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	10	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 6:53	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-133

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-33

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	14	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 7:05	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-134

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-34

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	15	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 7:06	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-135

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-35

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	8.9	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 7:08	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-136

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-36

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	12	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 7:10	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-137

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-37

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	RL	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
			MA	ORSG					Prepared	Analyzed	
# Lead	16	0.50	15		µg/L	1		EPA 200.8	10/10/16	10/11/16 7:11	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-138

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-38

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	11	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 7:13	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-139

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-39

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	7.5	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 7:15	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-140

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-40

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	14	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 7:16	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-141

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-41

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
# Lead	16	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 7:18	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Project Location: High School - 2 Mustang Drive., M Sample Description: Classroom Sink

Work Order: 16J0225

Date Received: 10/6/2016

Field Sample #: HS-2-CS-142

Sampled: 9/28/2016 00:00

Sample ID: 16J0225-42

Sample Matrix: Drinking Water

Metals Analyses (Total)

Analyte	Results	MCL/SMCL		Units	Dilution	Flag/Qual	Method	Date	Date/Time	Analyst
		RL	MA ORSG					Prepared	Analyzed	
Lead	4.6	0.50	15	µg/L	1		EPA 200.8	10/10/16	10/11/16 7:50	MJH

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Sample Extraction Data**Prep Method: EPA 200.8-EPA 200.8**

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0225-01 [HS-2-BS-101]	B160160	10.0	10.0	10/07/16
16J0225-02 [HS-2-KS-102]	B160160	10.0	10.0	10/07/16
16J0225-03 [HS-2-CS-103]	B160160	10.0	10.0	10/07/16
16J0225-04 [HS-2-CS-104]	B160160	10.0	10.0	10/07/16
16J0225-05 [HS-2-CS-105]	B160160	10.0	10.0	10/07/16
16J0225-06 [HS-2-CS-106]	B160160	10.0	10.0	10/07/16
16J0225-07 [HS-2-CS-107]	B160160	10.0	10.0	10/07/16
16J0225-08 [HS-2-CS-108]	B160160	10.0	10.0	10/07/16
16J0225-09 [HS-2-CS-109]	B160160	10.0	10.0	10/07/16
16J0225-10 [HS-2-CS-110]	B160160	10.0	10.0	10/07/16
16J0225-11 [HS-2-CS-111]	B160160	10.0	10.0	10/07/16
16J0225-12 [HS-2-CS-112]	B160160	10.0	10.0	10/07/16
16J0225-13 [HS-2-CS-113]	B160160	10.0	10.0	10/07/16
16J0225-14 [HS-2-CS-114]	B160160	10.0	10.0	10/07/16
16J0225-15 [HS-2-CS-115]	B160160	10.0	10.0	10/07/16
16J0225-16 [HS-2-CS-116]	B160160	10.0	10.0	10/07/16
16J0225-17 [HS-2-CS-117]	B160160	10.0	10.0	10/07/16
16J0225-18 [HS-2-CS-118]	B160160	10.0	10.0	10/07/16
16J0225-19 [HS-2-CS-119]	B160160	10.0	10.0	10/07/16
16J0225-20 [HS-2-CS-120]	B160160	10.0	10.0	10/07/16

Prep Method: EPA 200.8-EPA 200.8

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0225-21 [HS-2-CS-121]	B160165	10.0	10.0	10/07/16
16J0225-22 [HS-2-CS-122]	B160165	10.0	10.0	10/07/16
16J0225-23 [HS-2-CS-123]	B160165	10.0	10.0	10/07/16
16J0225-24 [HS-2-CS-124]	B160165	10.0	10.0	10/07/16
16J0225-25 [HS-2-CS-125]	B160165	10.0	10.0	10/07/16
16J0225-26 [HS-2-CS-126]	B160165	10.0	10.0	10/07/16
16J0225-27 [HS-2-CS-127]	B160165	10.0	10.0	10/07/16
16J0225-28 [HS-2-CS-128]	B160165	10.0	10.0	10/07/16
16J0225-29 [HS-2-CS-129]	B160165	10.0	10.0	10/07/16
16J0225-30 [HS-2-CS-130]	B160165	10.0	10.0	10/07/16
16J0225-31 [HS-2-CS-131]	B160165	10.0	10.0	10/07/16

Prep Method: EPA 200.8-EPA 200.8

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0225-32 [HS-2-CS-132]	B160229	10.0	10.0	10/10/16
16J0225-33 [HS-2-CS-133]	B160229	10.0	10.0	10/10/16
16J0225-34 [HS-2-CS-134]	B160229	10.0	10.0	10/10/16
16J0225-35 [HS-2-CS-135]	B160229	10.0	10.0	10/10/16
16J0225-36 [HS-2-CS-136]	B160229	10.0	10.0	10/10/16
16J0225-37 [HS-2-CS-137]	B160229	10.0	10.0	10/10/16
16J0225-38 [HS-2-CS-138]	B160229	10.0	10.0	10/10/16
16J0225-39 [HS-2-CS-139]	B160229	10.0	10.0	10/10/16
16J0225-40 [HS-2-CS-140]	B160229	10.0	10.0	10/10/16
16J0225-41 [HS-2-CS-141]	B160229	10.0	10.0	10/10/16

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

Sample Extraction Data

Prep Method: EPA 200.8-EPA 200.8

Lab Number [Field ID]	Batch	Initial [mL]	Final [mL]	Date
16J0225-42 [HS-2-CS-142]	B160244	10.0	10.0	10/10/16

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Metals Analyses (Total) - Quality Control

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch B160160 - EPA 200.8										
Blank (B160160-BLK1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	ND	0.50	µg/L							
LCS (B160160-BS1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	40.8	0.50	µg/L	40.0		102	85-115			
Duplicate (B160160-DUP1)				Source: 16J0225-01 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	1.26	0.50	µg/L		1.25			1.25	20	
Duplicate (B160160-DUP2)				Source: 16J0225-02 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	1.70	0.50	µg/L		1.69			0.987	20	
Matrix Spike (B160160-MS1)				Source: 16J0225-01 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	27.2	0.62	µg/L	25.0	1.25	104	70-130			
Matrix Spike (B160160-MS2)				Source: 16J0225-02 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	27.4	0.62	µg/L	25.0	1.69	103	70-130			
Batch B160165 - EPA 200.8										
Blank (B160165-BLK1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	ND	0.50	µg/L							
LCS (B160165-BS1)				Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	39.3	0.50	µg/L	40.0		98.1	85-115			
Duplicate (B160165-DUP1)				Source: 16J0225-21 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	7.98	0.50	µg/L		7.93			0.614	20	
Duplicate (B160165-DUP2)				Source: 16J0225-22 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	7.29	0.50	µg/L		7.29			0.0945	20	
Matrix Spike (B160165-MS1)				Source: 16J0225-21 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	32.3	0.62	µg/L	25.0	7.93	97.6	70-130			
Matrix Spike (B160165-MS2)				Source: 16J0225-22 Prepared: 10/07/16 Analyzed: 10/10/16						
Lead	31.8	0.62	µg/L	25.0	7.29	98.1	70-130			
Batch B160229 - EPA 200.8										
Blank (B160229-BLK1)				Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	ND	0.50	µg/L							

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

QUALITY CONTROL
Metals Analyses (Total) - Quality Control

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch B160229 - EPA 200.8										
LCS (B160229-BS1)				Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	41.8	0.50	µg/L	40.0		105	85-115			
Duplicate (B160229-DUP1)				Source: 16J0225-32 Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	10.5	0.50	µg/L		10.3			2.48	20	
Duplicate (B160229-DUP2)				Source: 16J0225-33 Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	14.0	0.50	µg/L		13.9			0.902	20	
Matrix Spike (B160229-MS1)				Source: 16J0225-32 Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	36.7	0.62	µg/L	25.0	10.3	106	70-130			
Matrix Spike (B160229-MS2)				Source: 16J0225-33 Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	40.1	0.62	µg/L	25.0	13.9	105	70-130			
Batch B160244 - EPA 200.8										
Blank (B160244-BLK1)				Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	ND	0.50	µg/L							
LCS (B160244-BS1)				Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	41.8	0.50	µg/L	40.0		105	85-115			
Duplicate (B160244-DUP1)				Source: 16J0225-42 Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	4.64	0.50	µg/L		4.61			0.495	20	
Matrix Spike (B160244-MS1)				Source: 16J0225-42 Prepared: 10/10/16 Analyzed: 10/11/16						
Lead	31.8	0.62	µg/L	25.0	4.61	109	70-130			

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

FLAG/QUALIFIER SUMMARY

*	QC result is outside of established limits.
†	Wide recovery limits established for difficult compound.
‡	Wide RPD limits established for difficult compound.
#	Data exceeded client recommended or regulatory level
ND	Not Detected
RL	Reporting Limit
DL	Method Detection Limit
MCL	Maximum Contaminant Level

Percent recoveries and relative percent differences (RPDs) are determined by the software using values in the calculation which have not been rounded.

No results have been blank subtracted unless specified in the case narrative section.

39 Spruce Street * East Longmeadow, MA 01028 * FAX 413/525-6405 * TEL. 413/525-2332

CERTIFICATIONS

Certified Analyses included in this Report

Analyte	Certifications
---------	----------------

EPA 200.8 in Drinking Water

Lead NH,NY,MA,CT,RI,ME,VA

The CON-TEST Environmental Laboratory operates under the following certifications and accreditations:

Code	Description	Number	Expires
AIHA	AIHA-LAP, LLC - ISO17025:2005	100033	02/1/2018
MA	Massachusetts DEP	M-MA100	06/30/2017
CT	Connecticut Department of Public Health	PH-0567	09/30/2017
NY	New York State Department of Health	10899 NELAP	04/1/2017
NH-S	New Hampshire Environmental Lab	2516 NELAP	02/5/2017
RI	Rhode Island Department of Health	LAO00112	12/30/2016
NC	North Carolina Div. of Water Quality	652	12/31/2016
NJ	New Jersey DEP	MA007 NELAP	06/30/2017
FL	Florida Department of Health	E871027 NELAP	06/30/2017
VT	Vermont Department of Health Lead Laboratory	LL015036	07/30/2017
ME	State of Maine	2011028	06/9/2017
VA	Commonwealth of Virginia	460217	12/14/2016
NH-P	New Hampshire Environmental Lab	2557 NELAP	09/6/2017


EHS Laboratories

 Environmental Hazards Services, LLC
 www.ehsllc.com 7489 Wilshire Rd
 (800) 347-0616 Richmond VA 23267
 (804) 276-4907 (fax)

Watersmart@Pro
LEAD ONLY
Chain-of-Custody

Analysis by National Testing Laboratories

 ~For Lab Use Only ~
SEND SAMPLES
TO:
 556 S. Mansfield St.
 Ypsilanti, MI 48197

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060 Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Acid Number:

Project Name/Testing Address: High School / Mustang Drive

City/State/Zip: Medina, NY 14103

Age of Property:

Collected by: Jeff Horvath

Certification #:

Well Tag # (if applicable):

Purchase Order Number:

Relinquished by:

Date:

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER
SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field pH	Field Chlorine	Temperature at Time of Collection
1	HS-2-BS-092	Bathroom Sink	9-28-16		Lead			
2	HS-2-BS-093	↓			Lead			
3	HS-2-BS-094	↓			Lead			
4	HS-2-DW-095	Drinking Water			Lead			
5	HS-2-BS-096	Bathroom Sink			Lead			
6	HS-2-BS-097	↓			Lead			
7	HS-2-BS-098	↓			Lead			
8	HS-2-BS-099	↓			Lead			
9	HS-2-BS-100	↓			Lead			
10	HS-2-BS-101	↓			Lead			
Received by:						Time:		
Testing Number:						Temperature:		

NTL Lab ID Number

Page 10 of 15

Paul NO

10.6.16 9:55

26.4


EHS Laboratories

 Environmental Hazards Services, LLC
 www.ehsllc.com 7469 Whitestone Rd
 (800) 347-4010 Richmond VA 23237
 (804) 275-4007 (fax)

Watersmart@Pro
LEAD ONLY
Chain-of-Custody
 Analysis by National Testing Laboratories

 ~For Lab Use Only~
SEND SAMPLES
TO:

 556 S. Mansfield St.
 Ypsilanti, MI 48197

Company Name Envoy Environmental

Address 57 Ambrose Street

City/State/Zip Rochester, NY 14608

Phone () 585-454-1060

Fax () 585-454-1062

E-mail: tknapp@envoyenv.com

Project Name/Testing Address High School / Mustang Drive

City/State/Zip Medina, NY 14103

Age of Property

Collected by Jeff Horte

Well Tag # (if applicable)

Purchase Order Number

Relinquished by

Date

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER
SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS. PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Fish Pb	Field Chlorides	Temperature at Time of Collection
1	HS-2-KS-102	Kitchen Sink	9-28-16		Lead			
2	HS-2-CS-103	Classroom Sink			Lead			
3	HS-2-CS-104				Lead			
4	HS-2-CS-105				Lead			
5	HS-2-CS-106				Lead			
6	HS-2-CS-107				Lead			
7	HS-2-CS-108				Lead			
8	HS-2-CS-109				Lead			
9	HS-2-CS-110				Lead			
10	HS-2-CS-111				Lead			
Relinquished by _____ Date _____						Date _____ Temperature _____		

NTL Lab ID Number

Page 11 of 15 Paul D 10.6.16 9:55


EHS Laboratories

 Environmental Hazards Services, LLC
 www.ehs-lab.com 7469 Whiteline Rd
 (800) 347-4010 Richmond VA 23237
 (804) 276-4007 (fax)

WaterSmart@Pro
LEAD ONLY
Chain-of-Custody

Analysis by National Testing Laboratories

 ~For Lab Use Only ~
SEND SAMPLES
TO:

 556 S. Mansfield St.
 Ypsilanti, MI 48197

Company Name Envoy Environmental

Address 57 Ambrose Street

City/State/Zip Rochester, NY 14608

Phone () 585-454-1060

Fax () 585-454-1062

E-mail tknapp@envoyenv.com

Asset Number

Project Name/Testing Address High School / Mustang Drive

City/State (Required) Medina, NY

Zip 14103

Age of Property

Collected by Jeff Horne

Certification #

Well Tag # (If applicable)

Purchase Order Number

Requisitioned by

Date

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER
SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS. PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field PB	Field Chlorine	Temperature at Time of Collection
1	HS-2-CS-112	Classroom Sink	9-28-16		Lead			
2	HS-2-CS-113				Lead			
3	HS-2-CS-114				Lead			
4	HS-2-CS-115				Lead			
5	HS-2-CS-116				Lead			
6	HS-2-CS-117				Lead			
7	HS-2-CS-118				Lead			
8	HS-2-CS-119				Lead			
9	HS-2-CS-120				Lead			
10	HS-2-CS-121				Lead			
Residual by						Time		
Testing Number						Temperature		

NTL Lab ID Number

Page 12 of 15 Para DE 10.6.16 9:55


Laboratories

Environmental Hazards Services, LLC
www.hazlab.com 7459 Whitaker Rd
(800) 347-4010 Richmond VA 23237
(804) 276-4007 (fax)

WaterSmart@Pro
LEAD ONLY
Chain-of-Custody

Analysis by National Testing Laboratories

~For Lab Use Only~

SEND SAMPLES
TO:

 556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060 Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Asset Number:

Project Name/Testing Address: High School / Mustang Drive City/State (Required): Medina, NY Zip: 14103 Age of Property:

Collected by: Jeff Horitel Certification #: Well Tag # (if applicable):

Purchaser Order Number: Reanalyzed by: Date:

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER
SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS. PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field PH	Field Chlorides	Temperature at Time of Collection:
1	HS-2-CS-122	Classroom Sink	9-28-16		Lead			
2	HS-2-CS-123				Lead			
3	HS-2-CS-124				Lead			
4	HS-2-CS-125				Lead			
5	HS-2-CS-126				Lead			
6	HS-2-CS-127				Lead			
7	HS-2-CS-128				Lead			
8	HS-2-CS-129				Lead			
9	HS-2-CS-130				Lead			
10	HS-2-CS-131				Lead			
Date: _____ Temperature: _____						Time: _____		
NTL Lab ID Number								

Received by:

Listing Number:

Page 13 of _____ Paula JD 10.6.16 9:55


Laboratories

 Environmental Hazards Services, LLC
 www.ehs-lab.com 7469 Whitepine Rd
 (800) 347-4010 Richmond VA 23237
 (804) 276-4907 (fax)

WaterSmart@Pro
LEAD ONLY
Chain-of-Custody
 Analysis by National Testing Laboratories

 ~For Lab Use Only ~
SEND SAMPLES
TO:

 556 S. Mansfield St.
 Ypsilanti, MI 48197

Company Name Envoy Environmental

Address 57 Ambrose Street

City/State/Zip Rochester, NY 14608

Phone () 585-454-1060

Fax () 585-454-1062

E-mail: tknapp@envoyenv.com

Project Name/Testing Address High School / Mustang Drive

City/State (Required) Medina, NY Zip 14103

Age of Property

Collected by Jeff Porter

Certification #

Well Tag # (if applicable)

Purchase Order Number

Relinquished by

Date

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER
SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS. PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field PEI	Field Chlorine	Temperature at Time of Collection
1	HS-2-CS-132	Classroom Sink	9-28-16		Lead			
2	HS-2-CS-133				Lead			
3	HS-2-CS-134				Lead			
4	HS-2-CS-135				Lead			
5	HS-2-CS-136				Lead			
6	HS-2-CS-137				Lead			
7	HS-2-CS-138				Lead			
8	HS-2-CS-139				Lead			
9	HS-2-CS-140				Lead			
10	HS-2-CS-141				Lead			
Revised by:								
Testing Number:								
Date:								
Temperature:								

NTL Lab ID Number

Page 14 of 15 Paula 10.6.16 9:55


EHS Laboratories

 Environmental Hazards Services, LLC
 www.ehsllc.com 7469 Whitlaine Rd
 (800) 347-4010 Richmond VA 23237
 (804) 275-4907 (fax)

Watersmart@Pro
LEAD ONLY
Chain-of-Custody
 Analysis by National Testing Laboratories

 ~For Lab Use Only~
SEND SAMPLES
TO:
 556 S. Mansfield St.
 Ypsilanti, MI 48197

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Project Name/Testing Address: High School / Mustang Drive

City/State (Required): Medina, NY Zip: 14103

Age of Property:

Collected by: Jeff Porter

Certification #:

Well Tag # (if applicable):

Purchase Order Number:

Requisitioned by:

Date:

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER
SAMPLES SUBMITTED ALL HAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS. PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Fish Pb:	Field Chlorine	Temperature at Time of Collection
1	HS-2-CS-142	Classroom Sink	9-28-16		Lead			
2					Lead			
3					Lead			
4					Lead			
5					Lead			
6					Lead			
7					Lead			
8					Lead			
9					Lead			
10					Lead			
Retained by: Testing Number:						Date:	Time:	Temperature:

NTL Lab ID Number

Page 15 of 15 Paul VO 10.6.16 9:55

39 Spruce St.
East Longmeadow, MA. 01028
P: 413-525-2332
F: 413-525-6405
www.contestlabs.com



Page 1 of 2

Sample Receipt Checklist

CLIENT NAME: EHS RECEIVED BY: PB DATE: 10.6.16

1) Was the chain(s) of custody relinquished and signed? Yes ☒ No ☐ No COC Incl.

2) Does the chain agree with the samples?

Yes ☒ No ☐

If not, explain:

3) Are all the samples in good condition?

Yes ☒ No ☐

If not, explain:

4) How were the samples received:

On Ice ☐ Direct from Sampling ☐ Ambient ☒ In Cooler(s) ☐

Were the samples received in Temperature Compliance of (2-6°C)? Yes ☐ No ☒ N/A ☐

Temperature °C by Temp blank ☐ Temperature °C by Temp gun 26.4

5) Are there Dissolved samples for the lab to filter?

Yes ☐ No ☒

Who was notified ☐ Date ☐ Time ☐

6) Are there any RUSH or SHORT HOLDING TIME samples?

Yes ☐ No ☒

Who was notified ☐ Date ☐ Time ☐

7) Location where samples are stored:

metals counter

Permission to subcontract samples? Yes No
(Walk-in clients only) if not already approved
Client Signature: ☐

8) Do all samples have the proper Acid pH: Yes ☐ No ☐ N/A ☒

9) Do all samples have the proper Base pH: Yes ☐ No ☐ N/A ☒

10) Was the PC notified of any discrepancies with the CoC vs the samples: Yes ☐ N/A ☒

Containers received at Con-Test

	# of containers		# of containers
1 Liter Amber		16 oz amber	
500 mL Amber		8 oz amber/clear jar	
250 mL Amber (8oz amber)		4 oz amber/clear jar	
1 Liter Plastic		2 oz amber/clear jar	
500 mL Plastic		Plastic Bag / Ziploc	
250 mL plastic	<u>42</u>	SOC Kit	
40 mL Vial - type listed below		Perchlorate Kit	
Colisure / bacteria bottle		Flashpoint bottle	
Dissolved Oxygen bottle		Other glass jar	
Encore		Other	

40 mL vials: # HCl ☐ # Methanol ☐

Time and Date Frozen: ☐

Doc# 277 # Bisulfate ☐ # DI Water ☐

Rev. 4 August 2013 # Thiosulfate ☐ Unpreserved ☐

Page 2 of 2

Login Sample Receipt Checklist

(Rejection Criteria Listing - Using Sample Acceptance Policy)
Any False statement will be brought to the attention of Client

Question	Any False statement will be brought to the attention of Client		Answer (True/False)	Comment
	T/F/NA			
1) The cooler's custody seal, if present, is intact.			NA	
2) The ^{Box} cooler or samples do not appear to have been compromised or tampered with.			T	
3) Samples were received on ice.			F	No cooler, No Ice
4) ^{Sample} Cooler Temperature is acceptable.			T	metals Analysis
5) ^{Box} Cooler Temperature is recorded.			T	
6) COC is filled out in ink and legible.			T	
7) COC is filled out with all pertinent information.			T	
8) Field Sampler's name present on COC.			T	
9) There are no discrepancies between the sample IDs on the container and the COC.			T	
10) Samples are received within Holding Time.			T	
11) Sample containers have legible labels.			T	
12) Containers are not broken or leaking.			T	
13) Air Cassettes are not broken/open.			NA	
14) Sample collection date/times are provided.			T	
15) Appropriate sample containers are used.			T	
16) Proper collection media used.			T	
17) No headspace sample bottles are completely filled.			NA	
18) There is sufficient volume for all requested analyses, including any requested MS/MSDs.			T	
19) Trip blanks provided if applicable.			NA	
20) VOA sample vials do not have head space or bubble is <6mm (1/4") in diameter.			NA	
21) Samples do not require splitting or compositing.			T	

Doc #277 Rev. 4 August 2013

Who notified of False statements?

Log-In Technician Initials: PB

Date/Time:

Date/Time: 10.6.16

9:55



EHS Laboratories

1650305

WaterSmart Pro

LEAD ONLY

Chain-of-Custody
Analysis by National Testing Laboratories

Environmental Services, LLC
7400 Whitehaven
Mechanicsville, VA 23103
(800) 270-4007 (fax)



16-10-01547

Due Date:

10/20/2016

(Thursday)

ER MC

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Acct. Number:

Project Name/Testing Address: High School / Mustang Drive

City/State/Zip: Medina, NY

Zip: 14103

Age of Property:

Collected by: JEFF HORTEL

Certification:

Waiting for results:

Permit Order Number:

Relayed by:

Date:

ALL SAMPLES WILL BE ANALYZED FOR LEAD IN DRINKING WATER

SAVES SUBMITTAL FEE. REQUEST FOR ANALYSIS. ADVISES AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.

PLEASE PROVIDE A CHAIN OF CUSTODY FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Room No.)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field ID	Field Collection	Temperature at Time of Collection
1	HS-2-B5-092	Bathroom Sink	9-28-16		Lead			
2	HS-2-B5-093				Lead			
3	HS-2-B5-094				Lead			
4	HS-2-D10-095	Drinking Water Bathroom Sink			Lead			
5	HS-2-B5-096				Lead			
6	HS-2-B5-097				Lead			
7	HS-2-B5-098				Lead			
8	HS-2-B5-099				Lead			
9	HS-2-B5-100				Lead			
10	HS-2-B5-101				Lead			
Total Log:						Total:		
Field ID:						Temperature:		
Field ID:						Time:		

NTE Lab ID Number

Page ID of 15

Paul D

10.6.16 9:55

26.4



1650025

WaterSmartPro

LEAD ONLY

Chain-of-Custody

Analyte by National Testing Laboratories

~For Lab Use Only~
SEND SAMPLES
TO:
556 S. Mansfield St.
Ypsilanti, MI 48197

Environmental Hazards Services, LLC
www.ehs-lab.com
(800) 347-4816
(248) 276-0807 (fax)
248 Witherby Rd
Farmington, MI 48334

Company Name Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

Email: thnapp@envoyenv.com

Account Number

Project Name/Testing Address: High School / Mustang Drive

City/State/County: Medina, NY

Zip: 14103

Age of Project

Collected by: Jeff Howell

Certification

Waiting (if applicable)

Purchase Order Number

Relinquished by

Date

ALL SAMPLES BELOW SHOULD BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED AT LEAVE THE NAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analyte Requested	Field Parameters		
						PH	PH	Temperature Time of Collection
03	1	HS-2-KS-103	Kitchen Sink	9-28-16	Lead			
06	2	HS-2-CS-103	Classroom Sink		Lead			
04	3	HS-2-CS-104			Lead			
05	4	HS-2-CS-105			Lead			
06	5	HS-2-CS-106			Lead			
07	6	HS-2-CS-107			Lead			
08	7	HS-2-CS-108			Lead			
09	8	HS-2-CS-109			Lead			
10	9	HS-2-CS-110			Lead			
11	10	HS-2-CS-111			Lead			

Collected by:

Signature/Number:

Date:

Temperature:

Time:

NTL Lab ID Number

Page 11 of 15

Paula

10.6.16 9:55

1547



EHS Laboratories

Environmental Research Services, LLC
4000 34th Avenue
Rochester, NY 14626
(800) 347-4010
(585) 276-4007 (fax)

WaterSmartPro
LEAD ONLY
Chain-of-Custody
Analyte by National Testing Laboratories

~For Lab Use Only~
SEND SAMPLES TO:
556 S. Mansfield St.
Ypsilanti, MI 48197

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Acct. Number:

Project Name/Testing Address: High School / 3rd Mustang Drive

City/State/County: Medina, NY

Per: 14103

Collected by: Jeff Hovetel

Certificate #:

Waiver # (if applicable):

Purchase Order Number:

Relinquished by:

Date:

ALL SAMPLES MUST BE STORED & ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED AT THE ABOVE ADDRESS AS ABOVE, WITH DIFFERENT APARTMENT NUMBERS, PLEASE PROVIDE A SEPARATE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analyte Requested	Field Parameters		
						Field pH	Field Coliform	Temperature at Time of Collection
1	HS-2-CS-112	Classroom Sink	9-28-16		Lead			
2	HS-2-CS-113				Lead			
3	HS-2-CS-114				Lead			
4	HS-2-CS-115				Lead			
5	HS-2-CS-116				Lead			
6	HS-2-CS-117				Lead			
7	HS-2-CS-118				Lead			
8	HS-2-CS-119				Lead			
9	HS-2-CS-120				Lead			
10	HS-2-CS-121				Lead			

Specified by:

Testing Method:

Date: _____
Time: _____

NIL Lab ID Number

Page 12 of 15
Paula De 10/6/16 9:55

1547



16J0325

WaterSmart Pro
LEAD ONLY

Chain-of-Custody
Analyte by National Testing Laboratories

~For Lab Use Only~
**SEND SAMPLES
TO:**
556 S. Mainfield St.
Ypsilanti, MI 48197

Environmental Services, LLC
2403 Withersford
Richmond VA 23267
(800) 347-4910
(800) 278-0907 (Toll)

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Project Name/Testing Address: High School / a Mustang Drive

City/State/County: Medina, NY

Acct. Number: 14103

Collected by: Jeff Horrel

Certification:

Waiting (if applicable):

Purchase Order Number:

Requisitioned by:

Date:

ALL SAMPLES WILL BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED AT THE ABOVE ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
PLEASE PROVIDE A SINGLE KEY FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field pH	Field Chlorine	Temperature at Time of Collection
1	HS-2-CS-128	Classroom Sink	9-28-16		Lead			
2	HS-2-CS-123				Lead			
3	HS-2-CS-124				Lead			
4	HS-2-CS-125				Lead			
5	HS-2-CS-126				Lead			
6	HS-2-CS-127				Lead			
7	HS-2-CS-128				Lead			
8	HS-2-CS-129				Lead			
9	HS-2-CS-130				Lead			
10	HS-2-CS-131				Lead			
Revised by:						Time:		
Signed/Initialed:						Temperature:		

NITL Lab ID Number

Age 13 of

Para XO 10.6.16 9:55

1547



1650225

WaterSense Pro

LEAD ONLY

Chain-of-Custody

Analyse by National Testing Laboratories

Environmental Research Services, LLC
www.ehsllc.com 2689 Whitehouse Rd
Rochester, NY 14626
800.276.0827 (toll)

~For Lab Use Only~
SEND SAMPLES
TO:
556 S. Mainfield St.
Ypsilanti, MI 48197

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060 Fax: () 585-454-1062 E-mail: tknapp@envoyenv.com

Project Name/Testing Address: High School / Armstrong Drive

City/State/Zip: Medina, NY

Acct Number: For 14103

Collected by: Jeff Horvath

Certificate #

Purchase Order Number

Relinquished by

Date

ALL SAMPLES HEREON PROVIDED ARE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED MUST BE KEPT IN THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.
PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (i.e. Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Field pH	Field Chlorine	Temperature at Time of Collection
32	HS-2-CS-132	CLASSROOM Sink	9-28-16		Lead			
33	HS-2-CS-133				Lead			
34	HS-2-CS-134				Lead			
35	HS-2-CS-135				Lead			
36	HS-2-CS-136				Lead			
37	HS-2-CS-137				Lead			
38	HS-2-CS-138				Lead			
39	HS-2-CS-139				Lead			
40	HS-2-CS-140				Lead			
41	HS-2-CS-141				Lead			

Revised by:

Revised by:

Date:

Time:

NIT Lab ID Number

Page 14 of 15

Paula R 10.6.16 9:55

1547



1650225

WaterSmartPro

LEAD ONLY

Chain-of-Custody

Analysis by National Testing Laboratories

~For Lab Use Only~
SEND SAMPLES TO:
556 S. Mansfield St.
Ypsilanti, MI 48197

Environmental Services, LLC
www.natlabs.com
(800) 347-4816
(248) 272-4887 (fax)
Rochester, NY 14608

Company Name: Envoy Environmental

Address: 57 Ambrose Street

City/State/Zip: Rochester, NY 14608

Phone: () 585-454-1060

Fax: () 585-454-1062

E-mail: tknapp@envoyenv.com

Acct. Number:

Project Name/Testing Address: High School / a Mustang Drive

City/State/Zip: Medina, NY

Zip: 14103 Age of Project:

Collected by: Jeff Hovetel

Certification:

What Tag # if applicable:

Purchase Order Number:

Relinquished by:

Date:

ALL SAMPLES MUST BE ANALYZED FOR LEAD IN DRINKING WATER

SAMPLES SUBMITTED AT LEAVE THE SAME PHYSICAL ADDRESS AS ABOVE WITH DIFFERENT APARTMENT NUMBERS.

PLEASE PROVIDE A SINGLE REPORT FOR ALL SAMPLES INCLUDED ON THIS CHAIN OF CUSTODY.

No.	Client Sample ID	Collection Location (ie Kitchen Sink)	Collection Date	Collection Time	Analysis Requested	Field Parameters		
						Fish PH	Fish Chlorine	Temperature at Time of Collection
1	HS-2-CS-143	Classroom Sink	9-28-16		Lead			
2					Lead			
3					Lead			
4					Lead			
5					Lead			
6					Lead			
7					Lead			
8					Lead			
9					Lead			
10					Lead			

Specified by:

Testing Number:


Date:

Temperature:

Time:


NIT Lab ID Number

High School 1st Floor South

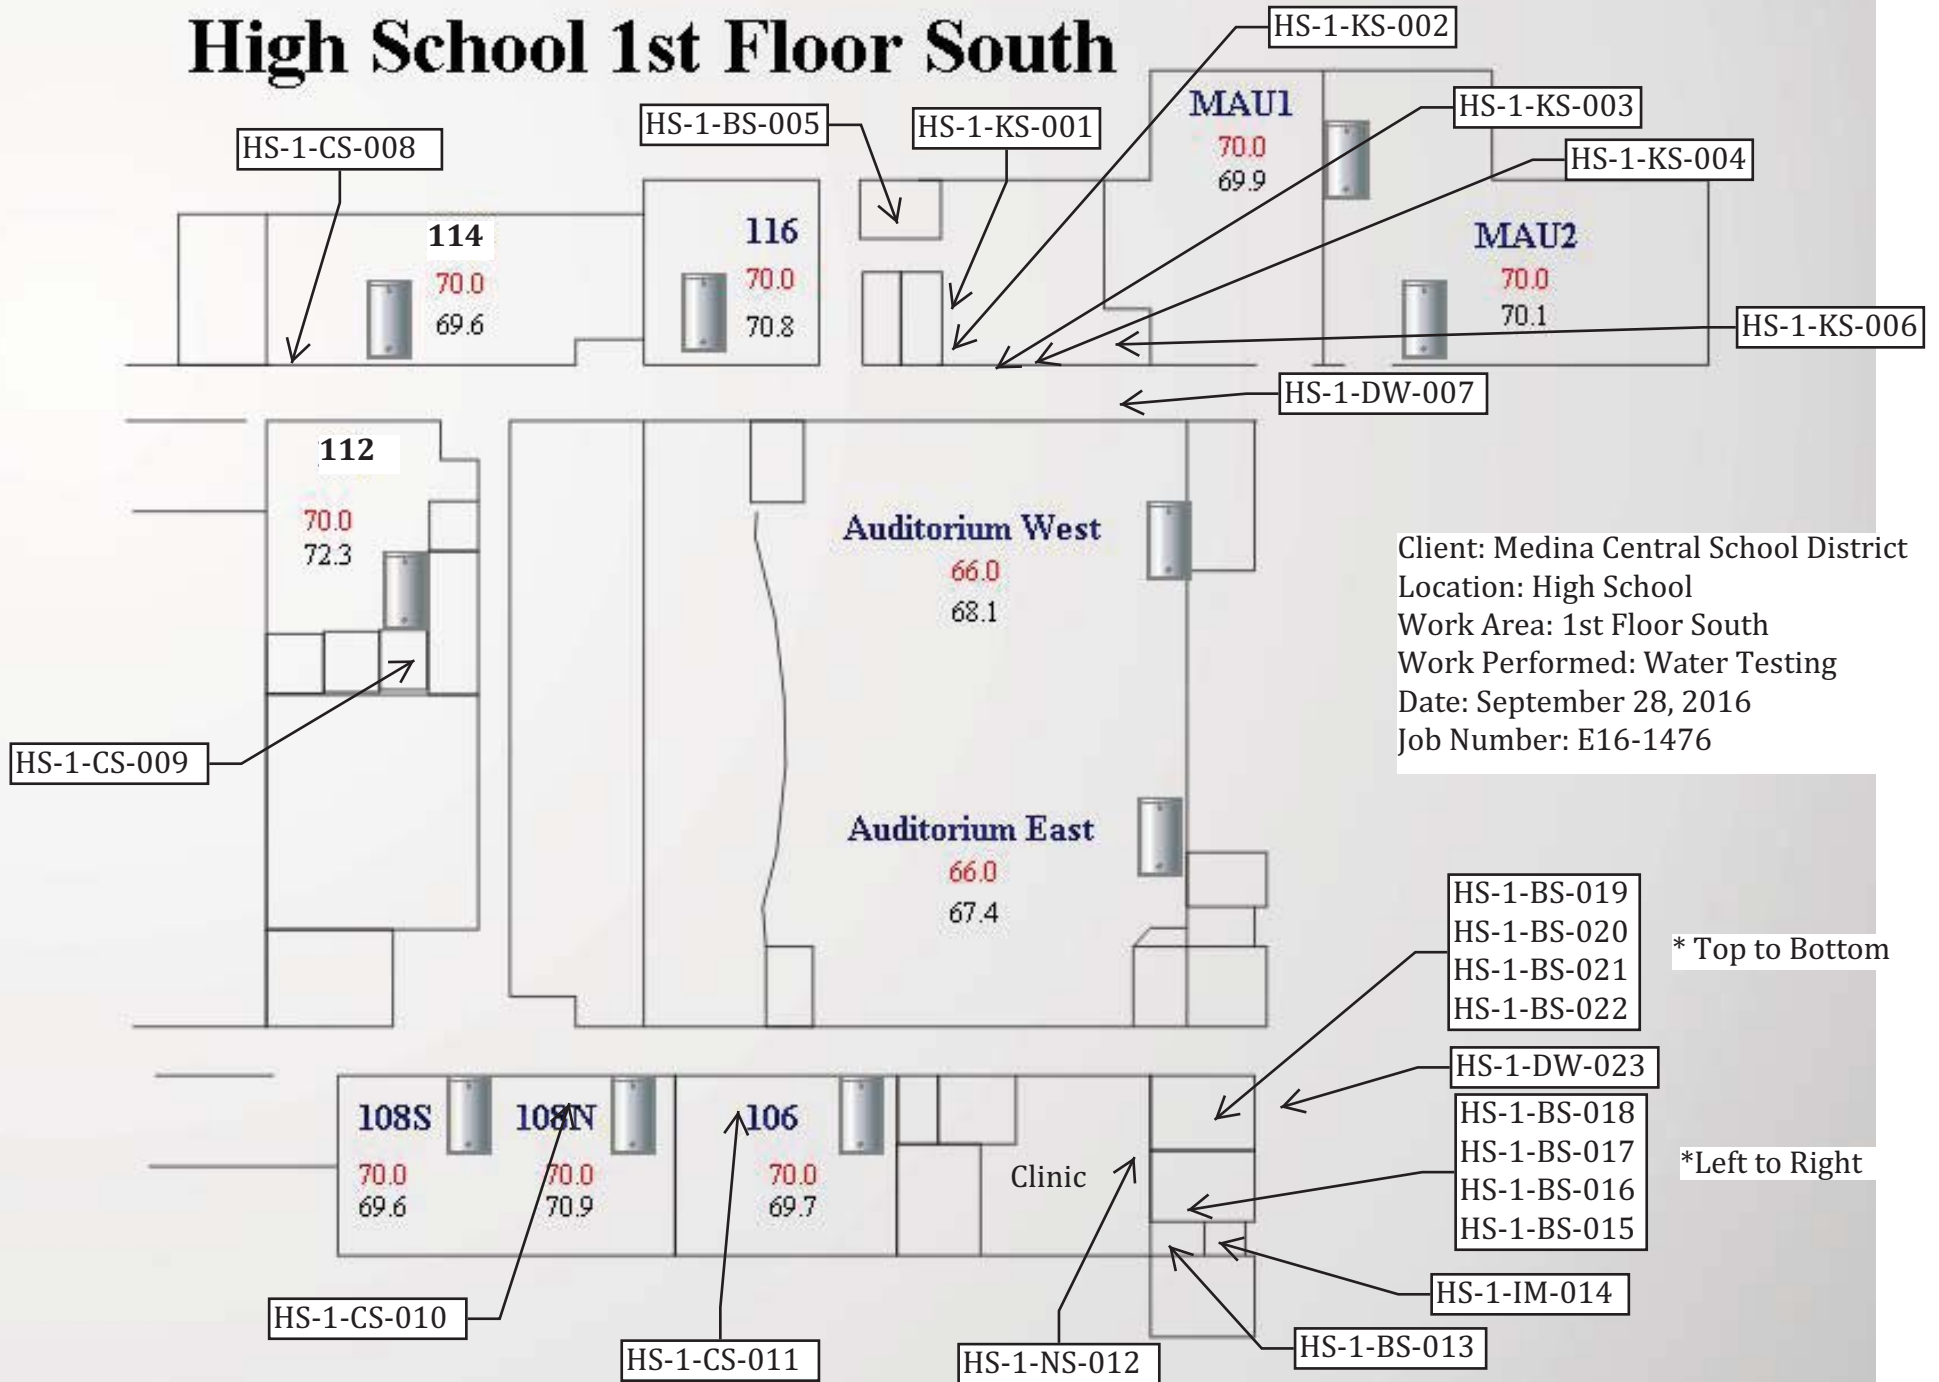


Client: Medina Central School District
Location: High School
Work Area: 1st Floor North
Work Performed: Water Testing
Date: September 28, 2016
Job Number: E16-1476

High School 1st Floor North

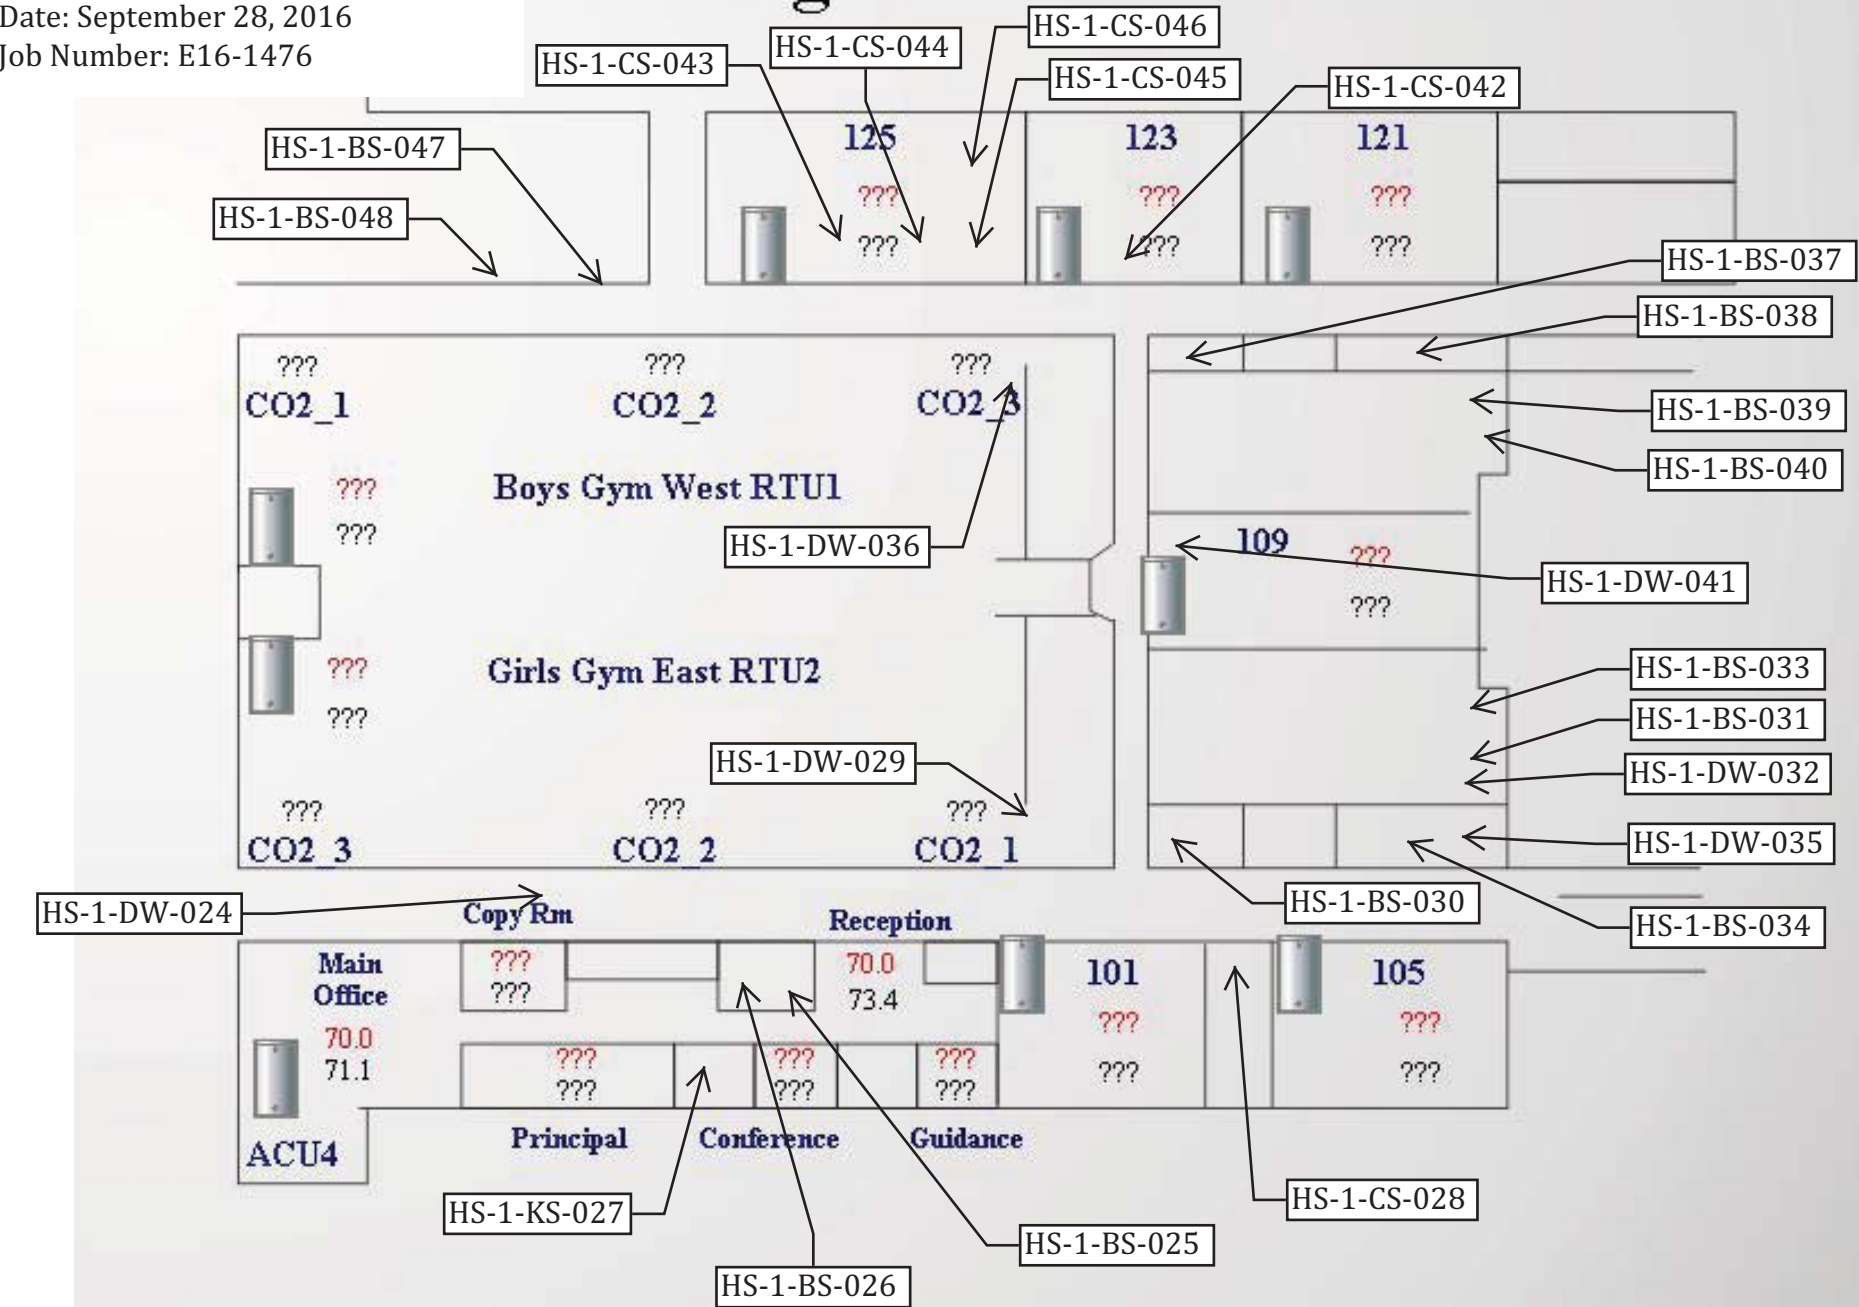


High School 2nd Floor South

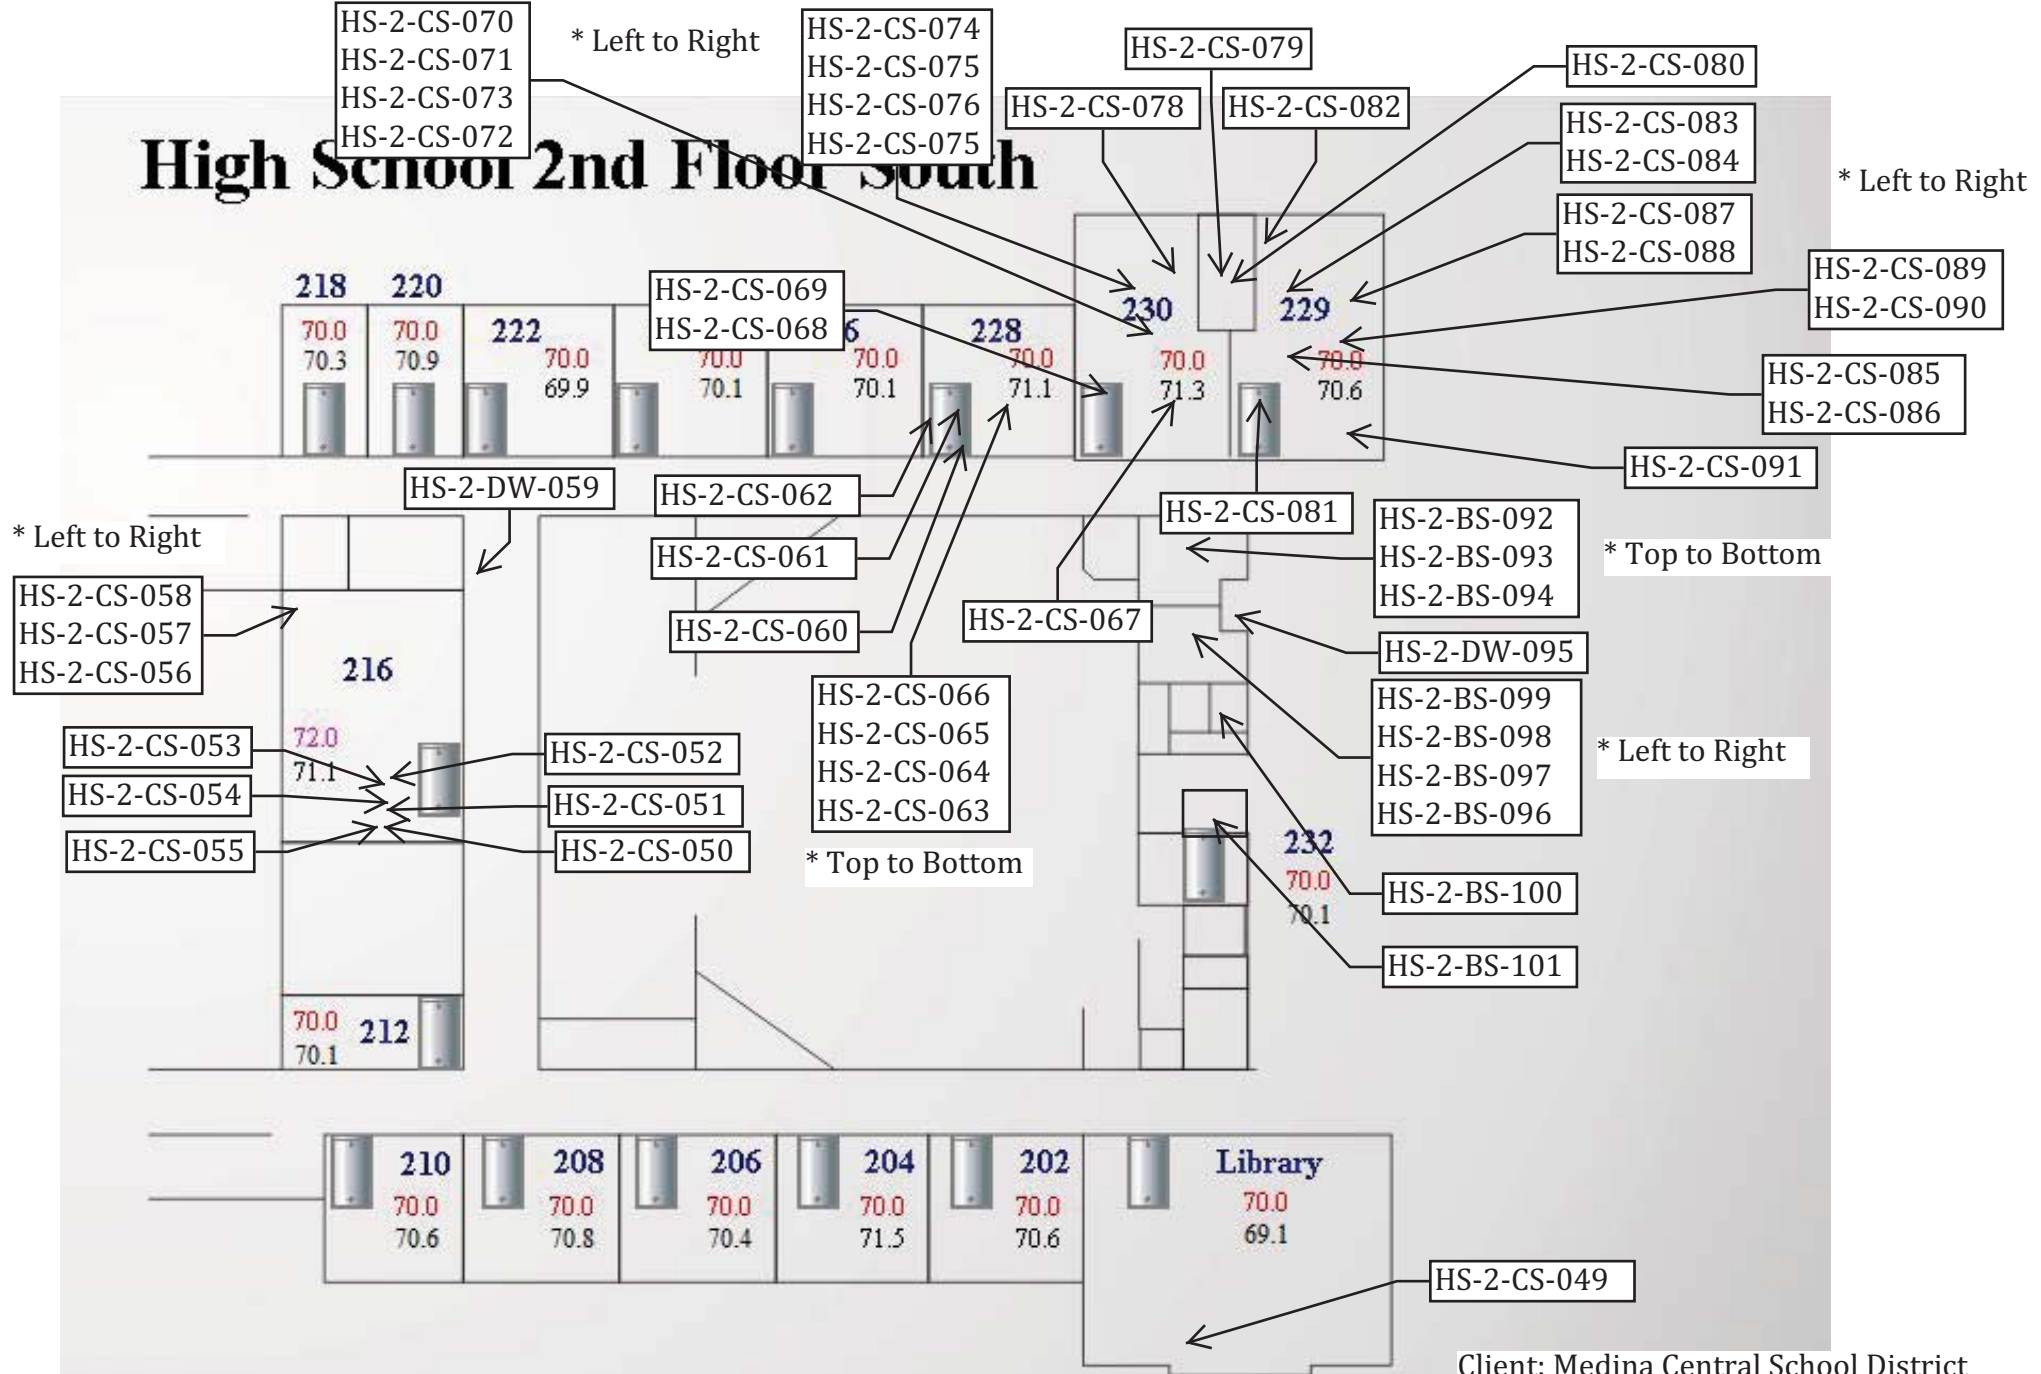

Client: Medina Central School District
 Location: High School
 Work Area: 2nd Floor South
 Work Performed: Water Testing
 Date: September 28, 2016
 Job Number: E16-1476

High School 2nd Floor North

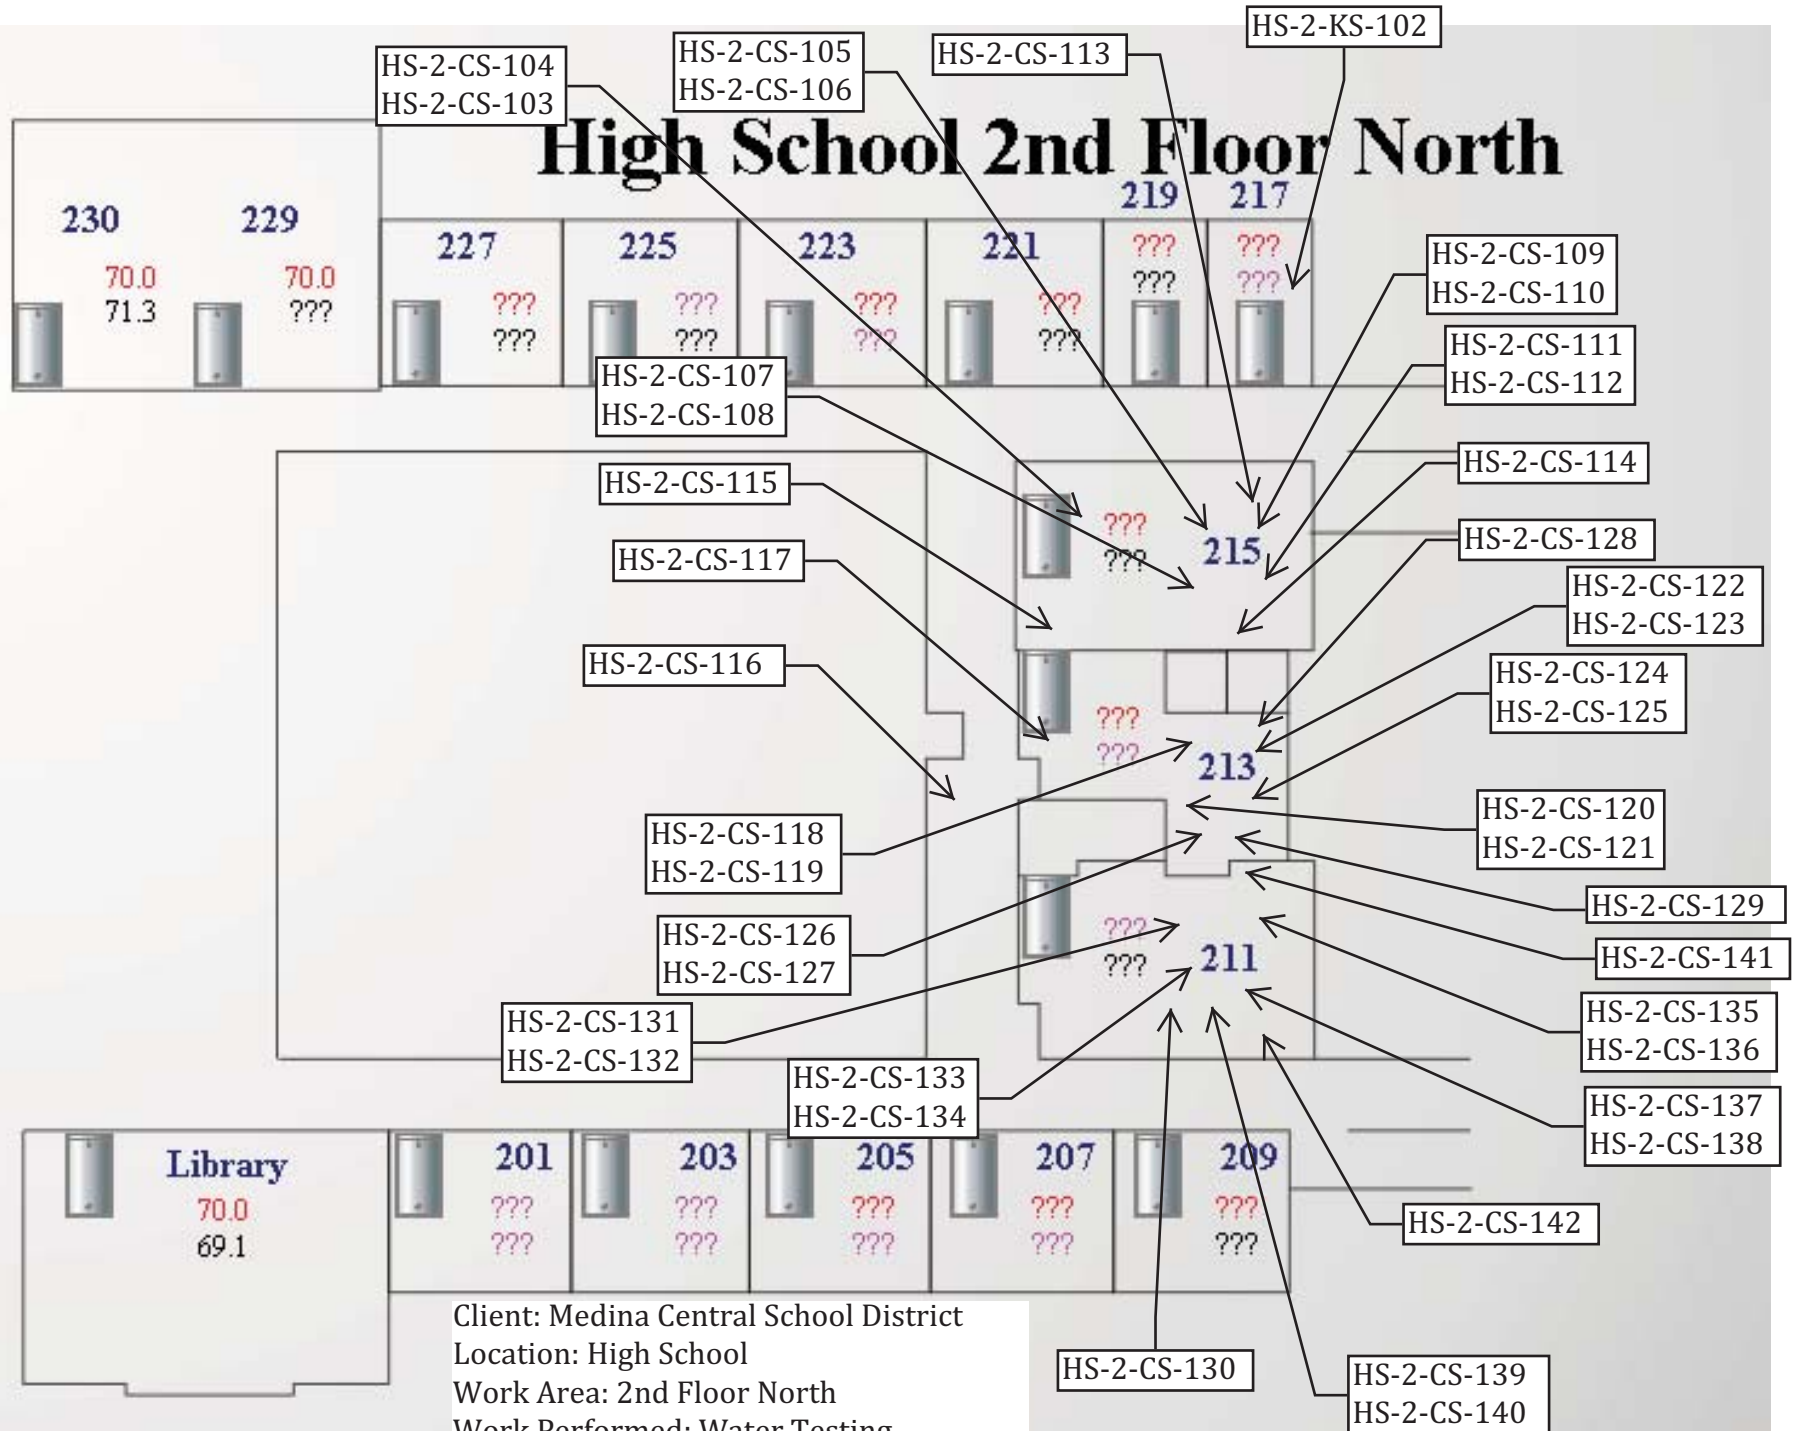

Client: Medina Central School District
 Location: High School
 Work Area: 2nd Floor North
 Work Performed: Water Testing
 Date: September 28, 2016
 Job Number: E16-1476