



August 14, 2024

Josh Hustad
Director of Facility Operations
Raytown School District
5911 Blue Ridge Boulevard
Raytown, Missouri 64133

Project: Limited Lead in Drinking Water Testing
Address: 6140 South Norfleet Road, Kansas City, Missouri 64133

Mr. Josh Hustad

On July 11, 2024, under the guidance of Jeff Hurst, Josh Milne, of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. A total of 38 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of "lead free" to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of "lead free" as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: <https://www.epa.gov/dwreginfo/lead-and-copper-rule>

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.

Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school's buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in **red text**.

July 11, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
6140-1-FD	Norfleet Elementary - Pump Room	Ice Machine	First Draw	0.6
6140-2-FD	Norfleet Elementary - Clinic	Sink Tap	First Draw	3.4
6140-3-FD	Norfleet Elementary - Near Clinic in Office	Sink Tap	First Draw	3.5
6140-4-FD	Norfleet Elementary - Teacher's Lounge Room 80	Sink Tap	First Draw	5.4
6140-5-FD	Norfleet Elementary - Across from Room 104	Bottle Filler	First Draw	1.1
6140-6-FD	Norfleet Elementary - Outside Gym	Drinking Fountain	First Draw	<0.4
6140-7-FD	Norfleet Elementary - Across from Room 114	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
6140-8-FD	Norfleet Elementary - Across from Cafeteria	Drinking Fountain	First Draw	<0.4
6140-9-FD	Norfleet Elementary - Outside Clinic	Drinking Fountain	First Draw	<0.4
6140-10-FD	Norfleet Elementary - Sprayer by Dishwasher	Sink Tap	First Draw	26.4
6140-11-FD	Norfleet Elementary - Triple Sink - Left	Sink Tap	First Draw	1
6140-12-FD	Norfleet Elementary - Triple Sink - Right	Sink Tap	First Draw	<0.4
6140-13-FD	Norfleet Elementary - Tilt Skillet	Sink Tap	First Draw	1.2
6140-14-FD	Norfleet Elementary - Prep Sink	Sink Tap	First Draw	4.3
6140-15-FD	Norfleet Elementary - Room 101A	Bubbler	First Draw	1.6
6140-16-FD	Norfleet Elementary - Room 102	Bubbler	First Draw	2.7
6140-17-FD	Norfleet Elementary - Room 103	Bubbler	First Draw	2
6140-18-FD	Norfleet Elementary - Room 104	Bubbler	First Draw	2.2
6140-19-FD	Norfleet Elementary - Room 106	Bubbler	First Draw	0.4
6140-20-FD	Norfleet Elementary - Room 107	Bubbler	First Draw	<0.4
6140-21-FD	Norfleet Elementary - Room 108	Bubbler	First Draw	0.9
6140-22-FD	Norfleet Elementary - Room 109	Bubbler	First Draw	0.8
6140-23-FD	Norfleet Elementary - Room 110	Bubbler	First Draw	2.6
6140-24-FD	Norfleet Elementary - Room 111	Bubbler	First Draw	1.3
6140-25-FD	Norfleet Elementary - Room 112	Bubbler	First Draw	2.1
6140-26-FD	Norfleet Elementary - Room 113	Bubbler	First Draw	2.4
6140-27-FD	Norfleet Elementary - Room 114	Bubbler	First Draw	6
6140-28-FD	Norfleet Elementary - Room 115	Bubbler	First Draw	1.7
6140-29-FD	Norfleet Elementary - Room 116	Bubbler	First Draw	2.6
6140-30-FD	Norfleet Elementary - Room 117	Bubbler	First Draw	67.8
6140-31-FD	Norfleet Elementary - Room 118	Bubbler	First Draw	3
6140-32-FD	Norfleet Elementary - Room 119	Bubbler	First Draw	2.4
6140-33-FD	Norfleet Elementary - Room 120	Bubbler	First Draw	1

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
6140-34-FD	Norfleet Elementary - Room 121	Bubbler	First Draw	0.7
6140-35-FD	Norfleet Elementary - Room 122	Bubbler	First Draw	1
6140-36-FD	Norfleet Elementary - Room 123	Bubbler	First Draw	1.5
6140-37-FD	Norfleet Elementary - Room 124	Bubbler	First Draw	0.8
6140-38-FD	Norfleet Elementary - Room 125	Bubbler	First Draw	1.7

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
 - The test results and a summary that explains such results;
 - A description of any remedial steps taken; and
 - A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



**Missouri Department of Health
and Senior Services**

Lead Occupation License - ID Badge

License Number:

000801-200166567

Lead Risk Assessor

**Jeffrey
Hurst**

Expiration Date: **8/1/2024**

Paula F. Nickelson

Paula F. Nickelson
Acting Director

Department of Health and Senior Services

Kansas City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.
- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

Appendix C

Laboratory Analytical Report



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HG0160

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 6140 S Norfleet Rd

Project / PO Number: 6140 S Norfleet Rd
Received: 07/18/2024
Reported: 08/08/2024

Work Order Special Information

Hurst, Jeff
6140 S Norfleet Rd

Analytical Testing Parameters

Client Sample ID:	6140-1-FD	Collected By:	Hurst, Jeff
Sample Matrix:	Drinking Water	Collection Date:	07/11/2024 13:44
Lab Sample ID:	3HG0160-01		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		08/06/24 1551	08/07/24 1357	RVV

Client Sample ID:	6140-2-FD	Collected By:	Hurst, Jeff
Sample Matrix:	Drinking Water	Collection Date:	07/11/2024 13:48
Lab Sample ID:	3HG0160-02		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.4	0.4	ppb	2		08/06/24 1551	08/07/24 1400	RVV

Client Sample ID:	6140-3-FD	Collected By:	Hurst, Jeff
Sample Matrix:	Drinking Water	Collection Date:	07/11/2024 13:50
Lab Sample ID:	3HG0160-03		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.5	0.4	ppb	2		08/06/24 1551	08/07/24 1403	RVV

Client Sample ID:	6140-4-FD	Collected By:	Hurst, Jeff
Sample Matrix:	Drinking Water	Collection Date:	07/11/2024 13:52
Lab Sample ID:	3HG0160-04		

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	5.4	0.4	ppb	2		08/06/24 1551	08/07/24 1412	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HG0160

Client Sample ID: 6140-5-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-05

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 13:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.1	0.4	ppb	2		08/06/24 1551	08/07/24 1415	RVV

Client Sample ID: 6140-6-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-06

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 13:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		08/06/24 1551	08/07/24 1418	RVV

Client Sample ID: 6140-7-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-07

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		08/06/24 1551	08/07/24 1421	RVV

Client Sample ID: 6140-8-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-08

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		08/06/24 1551	08/07/24 1424	RVV

Client Sample ID: 6140-9-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-09

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		08/06/24 1551	08/07/24 1427	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HG0160

Client Sample ID: 6140-10-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-10

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	26.4	0.4	ppb	2		08/06/24 1551	08/07/24 1436	RVV

Client Sample ID: 6140-11-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-11

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		08/06/24 1551	08/07/24 1451	RVV

Client Sample ID: 6140-12-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-12

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		08/06/24 1551	08/07/24 1454	RVV

Client Sample ID: 6140-13-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-13

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.2	0.4	ppb	2		08/06/24 1551	08/07/24 1457	RVV

Client Sample ID: 6140-14-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-14

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	4.3	0.4	ppb	2		08/06/24 1551	08/07/24 1500	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HG0160

Client Sample ID: 6140-15-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-15

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.6	0.4	ppb	2		08/06/24 1551	08/07/24 1503	RVV

Client Sample ID: 6140-16-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-16

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.7	0.4	ppb	2		08/06/24 1551	08/07/24 1506	RVV

Client Sample ID: 6140-17-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-17

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.0	0.4	ppb	2		08/06/24 1551	08/07/24 1508	RVV

Client Sample ID: 6140-18-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-18

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.2	0.4	ppb	2		08/06/24 1551	08/07/24 1511	RVV

Client Sample ID: 6140-19-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-19

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		08/06/24 1551	08/07/24 1514	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HG0160

Client Sample ID: 6140-20-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-20

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		08/06/24 1551	08/07/24 1523	RVV

Client Sample ID: 6140-21-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-21

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.9	0.4	ppb	2		08/06/24 1551	08/07/24 1526	RVV

Client Sample ID: 6140-22-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-22

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		08/06/24 1551	08/07/24 1529	RVV

Client Sample ID: 6140-23-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-23

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.6	0.4	ppb	2		08/06/24 1551	08/07/24 1532	RVV

Client Sample ID: 6140-24-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-24

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.3	0.4	ppb	2		08/06/24 1551	08/07/24 1535	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HG0160

Client Sample ID: 6140-25-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-25

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.1	0.4	ppb	2		08/06/24 1551	08/07/24 1538	RVV

Client Sample ID: 6140-26-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-26

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.4	0.4	ppb	2		08/06/24 1551	08/07/24 1541	RVV

Client Sample ID: 6140-27-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-27

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	6.0	0.4	ppb	2		08/06/24 1551	08/07/24 1544	RVV

Client Sample ID: 6140-28-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-28

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.7	0.4	ppb	2		08/06/24 1551	08/07/24 1547	RVV

Client Sample ID: 6140-29-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-29

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.6	0.4	ppb	2		08/06/24 1551	08/07/24 1550	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HG0160

Client Sample ID: 6140-30-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-30
Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	67.8	0.4	ppb	2		08/06/24 1551	08/07/24 1605	RVV

Client Sample ID: 6140-31-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-31
Collected By: Hurst, Jeff
Collection Date: 07/11/2024 14:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	3.0	0.4	ppb	2		08/06/24 1551	08/07/24 1614	RVV

Client Sample ID: 6140-32-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-32
Collected By: Hurst, Jeff
Collection Date: 07/11/2024 15:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.4	0.4	ppb	2		08/06/24 1551	08/07/24 1617	RVV

Client Sample ID: 6140-33-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-33
Collected By: Hurst, Jeff
Collection Date: 07/11/2024 15:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		08/06/24 1551	08/07/24 1620	RVV

Client Sample ID: 6140-34-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-34
Collected By: Hurst, Jeff
Collection Date: 07/11/2024 15:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		08/06/24 1551	08/07/24 1623	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HG0160

Client Sample ID: 6140-35-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-35

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 15:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.0	0.4	ppb	2		08/06/24 1551	08/07/24 1626	RVV

Client Sample ID: 6140-36-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-36

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 15:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.5	0.4	ppb	2		08/06/24 1551	08/07/24 1635	RVV

Client Sample ID: 6140-37-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-37

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 15:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.8	0.4	ppb	2		08/06/24 1551	08/07/24 1638	RVV

Client Sample ID: 6140-38-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HG0160-38

Collected By: Hurst, Jeff
Collection Date: 07/11/2024 15:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	1.7	0.4	ppb	2		08/06/24 1551	08/07/24 1641	RVV

Definitions

RL: Reporting Limit

Report Comments

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.

Reviewed and Approved By:

Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
08/08/24 13:40

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com

Page 8 of 14



600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

X

PRINT OR TYPE INFO BELOW:

SAMPLER: Jeff Hurst
SITE NAME: Norfleet Elementary
ADDRESS: 6140 S Norfleet Rd
CITY/ST/ZIP: Raytown, MO, 64133
PHONE:

REPORT TO:

NAME: Jeff Hurst
CO. NAME:
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

BILL TO:

NAME: Jeff Hurst
CO. NAME:
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	21.2
														Sample Condition	Sample #
6140-1-FD	7/11/2024	13:44	Norfleet Elementary - Ice Machine - Pump Room	1	Water	Grab	X								3H60160-01
6140-2-FD	7/11/2024	13:48	Norfleet Elementary - Sink Tap - Clinic	1	Water	Grab	X								02
6140-3-FD	7/11/2024	13:50	Norfleet Elementary - Sink Tap - Near Clinic in Office	1	Water	Grab	X								03
6140-4-FD	7/11/2024	13:52	Norfleet Elementary - Sink Tap - Teacher's Lounge Room 80	1	Water	Grab	X								04
6140-5-FD	7/11/2024	13:56	Norfleet Elementary - Bottle Filler - Across from Room 104	1	Water	Grab	X								05
6140-6-FD	7/11/2024	13:58	Norfleet Elementary - Drinking Fountain - Outside Gym	1	Water	Grab	X								06
6140-7-FD	7/11/2024	14:01	Norfleet Elementary - Drinking Fountain - Across from Room 114	1	Water	Grab	X								07

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	07/18/24	
	Time:		<i>Carolyn Jackson</i>	Time:	16:00	



3 H 6 0 1 6 0

AXIOM Service Professionals

PM: Carolyn Jackson



600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER: Jeff Hurst		NAME: Jeff Hurst		NAME: Jeff Hurst	
SITE NAME: Norfleet Elementary		CO. NAME:		CO. NAME:	
ADDRESS: 6140 S Norfleet Rd		ADDRESS: PO Box 47166		ADDRESS: PO Box 47166	
CITY/ST/ZIP: Raytown, MO, 64133		CITY/ST/ZIP: Kansas City, Missouri 64188		CITY/ST/ZIP: Kansas City, Missouri 64188	
PHONE:		PHONE: 816-678-7894		PHONE: 816-678-7894	
		EMAIL: jeffh@axiomservicepros.com		EMAIL: jeffh@axiomservicepros.com	

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	Lead	ANALYSES REQUIRED						LAB USE ONLY	
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
6140-8-FD	7/11/2024	14:06	Norfleet Elementary - Drinking Fountain - Across from Cafeteria	1	Water	Grab	X								3HGD160-08
6140-9-FD	7/11/2024	14:09	Norfleet Elementary - Drinking Fountain - Outside Clinic	1	Water	Grab	X								09
6140-10-FD	7/11/2024	14:13	Norfleet Elementary - Sink Tap - Sprayer by Dishwasher	1	Water	Grab	X								10
6140-11-FD	7/11/2024	14:16	Norfleet Elementary - Sink Tap - Triple Sink - Left	1	Water	Grab	X								11
6140-12-FD	7/11/2024	14:17	Norfleet Elementary - Sink Tap - Triple Sink - Right	1	Water	Grab	X								12
6140-13-FD	7/11/2024	14:17	Norfleet Elementary - Sink Tap - Tilt Skillet	1	Water	Grab	X								13
6140-14-FD	7/11/2024	14:19	Norfleet Elementary - Sink Tap - Prep Sink	1	Water	Grab	X								14

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H G 0 1 6 0

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone
LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER: Jeff Hurst		NAME: Jeff Hurst		NAME: Jeff Hurst	
SITE NAME: Norfleet Elementary		CO. NAME:		CO. NAME:	
ADDRESS: 6140 S Norfleet Rd		ADDRESS: PO Box 47166		ADDRESS: PO Box 47166	
CITY/ST/ZIP: Raytown, MO, 64133		CITY/ST/ZIP: Kansas City, Missouri 64188		CITY/ST/ZIP: Kansas City, Missouri 64188	
PHONE:		PHONE: 816-678-7894		PHONE: 816-678-7894	
		EMAIL: jeffh@axiomservicepros.com		EMAIL: jeffh@axiomservicepros.com	

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
6140-15-FD	7/11/2024	14:24	Norfleet Elementary - Bubbler - Room 101A	1	Water	Grab	X								3H60160-15
6140-16-FD	7/11/2024	14:39	Norfleet Elementary - Bubbler - Room 102	1	Water	Grab	X								16
6140-17-FD	7/11/2024	14:40	Norfleet Elementary - Bubbler - Room 103	1	Water	Grab	X								17
6140-18-FD	7/11/2024	14:42	Norfleet Elementary - Bubbler - Room 104	1	Water	Grab	X								18
6140-19-FD	7/11/2024	14:46	Norfleet Elementary - Bubbler - Room 106	1	Water	Grab	X								19
6140-20-FD	7/11/2024	14:47	Norfleet Elementary - Bubbler - Room 107	1	Water	Grab	X								20
6140-21-FD	7/11/2024	14:48	Norfleet Elementary - Bubbler - Room 108	1	Water	Grab	X								21

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	07/18/24	
	Time:		Carol Jackson	Time:	16:00	



3 H G 0 1 6 0

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone
LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

X

PRINT OR TYPE INFO BELOW:

SAMPLER: Jeff Hurst
SITE NAME: Norfleet Elementary
ADDRESS: 6140 S Norfleet Rd
CITY/ST/ZIP: Raytown, MO, 64133
PHONE:

REPORT TO:

NAME: Jeff Hurst
CO. NAME:
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

BILL TO:

NAME: Jeff Hurst
CO. NAME:
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp:	oC
														Sample Condition	Sample #
6140-22-FD	7/11/2024	14:50	Norfleet Elementary - Bubbler - Room 109	1	Water	Grab	X								3460160-22
6140-23-FD	7/11/2024	14:51	Norfleet Elementary - Bubbler - Room 110	1	Water	Grab	X								23
6140-24-FD	7/11/2024	14:52	Norfleet Elementary - Bubbler - Room 111	1	Water	Grab	X								24
6140-25-FD	7/11/2024	14:53	Norfleet Elementary - Bubbler - Room 112	1	Water	Grab	X								25
6140-26-FD	7/11/2024	14:54	Norfleet Elementary - Bubbler - Room 113	1	Water	Grab	X								26
6140-27-FD	7/11/2024	14:55	Norfleet Elementary - Bubbler - Room 114	1	Water	Grab	X								27
6140-28-FD	7/11/2024	14:56	Norfleet Elementary - Bubbler - Room 115	1	Water	Grab	X								28

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	07/18/24	
	Time:		<i>Carolyn Jackson</i>	Time:	16:00	



3 H G 0 1 6 0

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone
LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

X

PRINT OR TYPE INFO BELOW:

SAMPLER: Jeff Hurst
SITE NAME: Norfleet Elementary
ADDRESS: 6140 S Norfleet Rd
CITY/ST/ZIP: Raytown, MO, 64133
PHONE:

REPORT TO:

NAME: Jeff Hurst
CO. NAME:
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

BILL TO:

NAME: Jeff Hurst
CO. NAME:
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	
															Sample Condition	Sample #
6140-29-FD	7/11/2024	14:57	Norfleet Elementary - Bubbler - Room 116	1	Water	Grab	X									3460160
6140-30-FD	7/11/2024	14:58	Norfleet Elementary - Bubbler - Room 117	1	Water	Grab	X									30
6140-31-FD	7/11/2024	14:59	Norfleet Elementary - Bubbler - Room 118	1	Water	Grab	X									31
6140-32-FD	7/11/2024	15:00	Norfleet Elementary - Bubbler - Room 119	1	Water	Grab	X									32
6140-33-FD	7/11/2024	15:04	Norfleet Elementary - Bubbler - Room 120	1	Water	Grab	X									33
6140-34-FD	7/11/2024	15:05	Norfleet Elementary - Bubbler - Room 121	1	Water	Grab	X									34
6140-35-FD	7/11/2024	15:06	Norfleet Elementary - Bubbler - Room 122	1	Water	Grab	X									35

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	07/18/24	
	Time:		<i>Carsh L Jackson</i>	Time:	16:00	



3 H G 0 1 6 0

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone
LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:

SAMPLER: Jeff Hurst
SITE NAME: Norfleet Elementary
ADDRESS: 6140 S Norfleet Rd
CITY/ST/ZIP: Raytown, MO, 64133
PHONE:

REPORT TO:

NAME: Jeff Hurst
CO. NAME:
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

BILL TO:

NAME: Jeff Hurst
CO. NAME:
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
6140-36-FD	7/11/2024	15:08	Norfleet Elementary - Bubbler - Room 123	1	Water	Grab	X								3HG0160-36
6140-37-FD	7/11/2024	15:09	Norfleet Elementary - Bubbler - Room 124	1	Water	Grab	X								37
6140-38-FD	7/11/2024	15:10	Norfleet Elementary - Bubbler - Room 125	1	Water	Grab	X								38

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:	07/18/24	
	Time:		<i>Carolyn Jackson</i>	Time:	16:00	




3 H G 0 1 6 0

AXIOM Service Professionals

PM: Carolyn Jackson

Appendix D


Photo Log

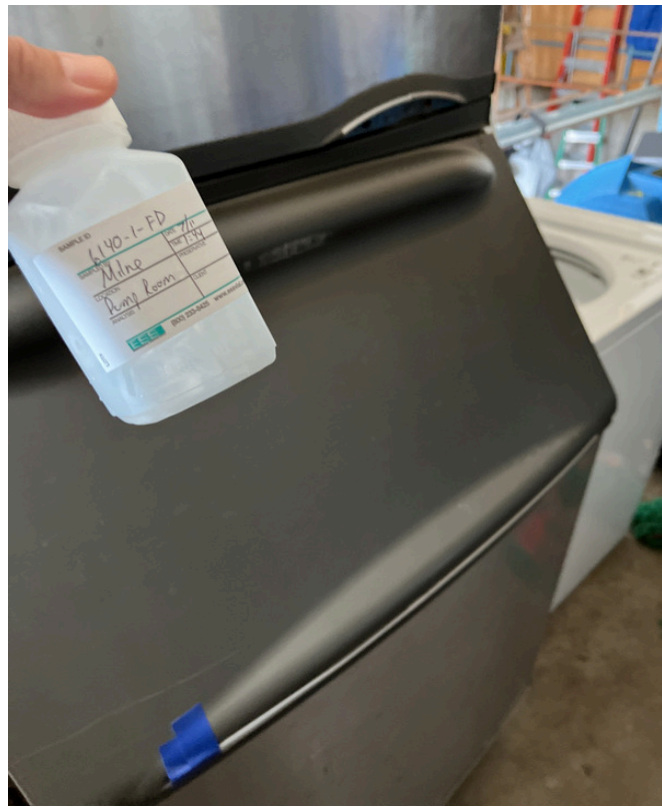

7/11/2024 - 6140-1 - Norfleet Elementary - Pump Room



7/11/2024 - 6140-2 - Norfleet Elementary - Clinic

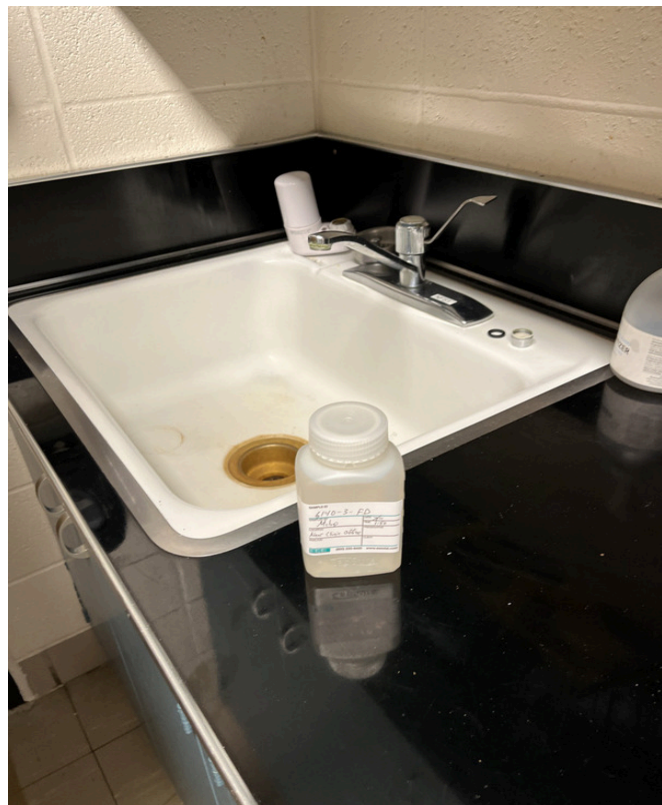

7/11/2024 - 6140-3 - Norfleet Elementary - Near Clinic in Office



7/11/2024 - 6140-4 - Norfleet Elementary - Teacher's Lounge Room 80



7/11/2024 - 6140-5 - Norfleet Elementary - Across from Room 104



7/11/2024 - 6140-6 - Norfleet Elementary - Outside Gym



7/11/2024 - 6140-7 - Norfleet Elementary - Across from Room 114



7/11/2024 - 6140-8 - Norfleet Elementary - Across from Cafeteria



7/11/2024 - 6140-9 - Norfleet Elementary - Outside Clinic



7/11/2024 - 6140-10 - Norfleet Elementary - Sprayer by Dishwasher



7/11/2024 - 6140-11 - Norfleet Elementary - Triple Sink - Left




7/11/2024 - 6140-12 - Norfleet Elementary - Triple Sink - Right



7/11/2024 - 6140-13 - Norfleet Elementary - Tilt Skillet



7/11/2024 - 6140-14 - Norfleet Elementary - Prep Sink

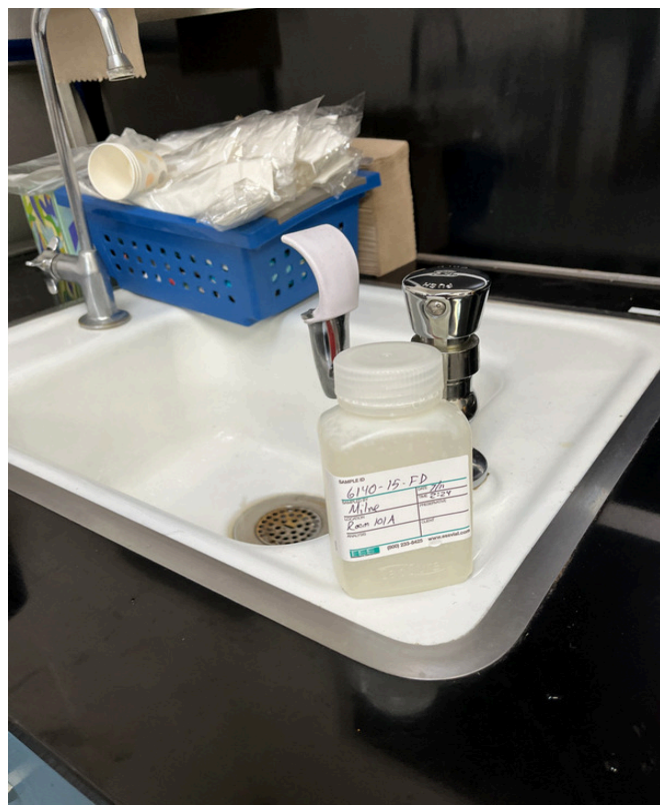

7/11/2024 - 6140-15 - Norfleet Elementary - Room 101A



7/11/2024 - 6140-16 - Norfleet Elementary - Room 102




7/11/2024 - 6140-17 - Norfleet Elementary - Room 103




7/11/2024 - 6140-18 - Norfleet Elementary - Room 104



7/11/2024 - 6140-19 - Norfleet Elementary - Room 106

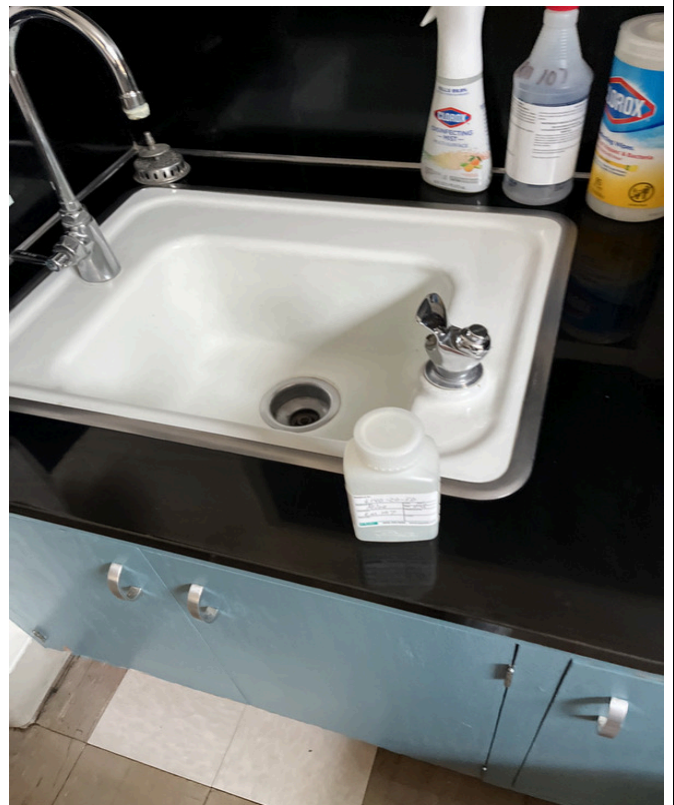

7/11/2024 - 6140-20 - Norfleet Elementary - Room 107

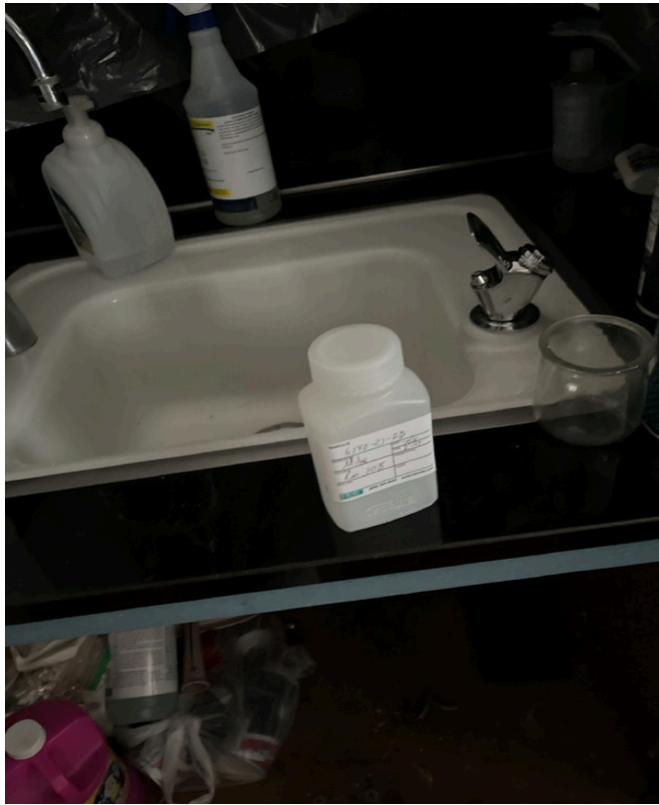


7/11/2024 - 6140-21 - Norfleet Elementary - Room 108



7/11/2024 - 6140-22 - Norfleet Elementary - Room 109



7/11/2024 - 6140-23 - Norfleet Elementary - Room 110

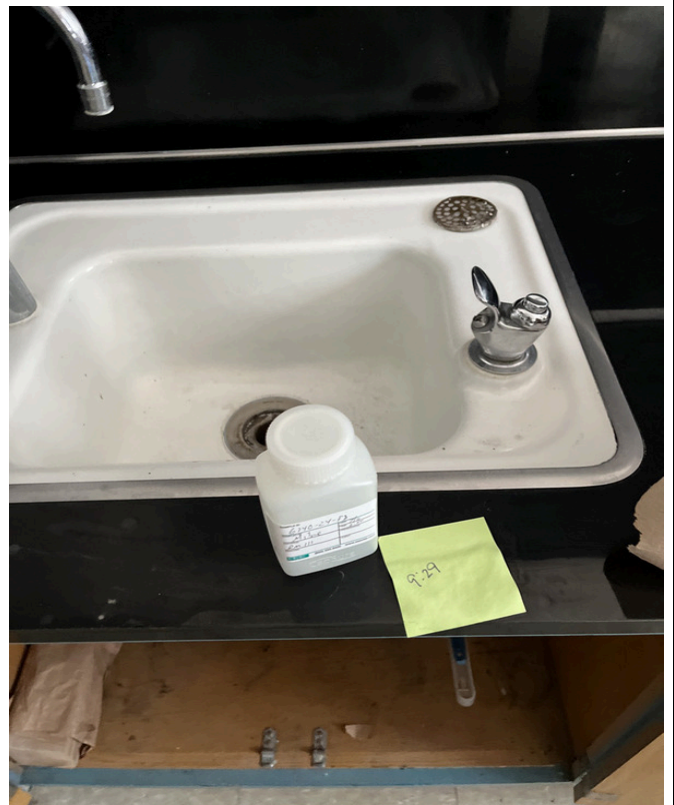

7/11/2024 - 6140-24 - Norfleet Elementary - Room 111



7/11/2024 - 6140-25 - Norfleet Elementary - Room 112



7/11/2024 - 6140-26 - Norfleet Elementary - Room 113




7/11/2024 - 6140-27 - Norfleet Elementary - Room 114



7/11/2024 - 6140-28 - Norfleet Elementary - Room 115



7/11/2024 - 6140-29 - Norfleet Elementary - Room 116

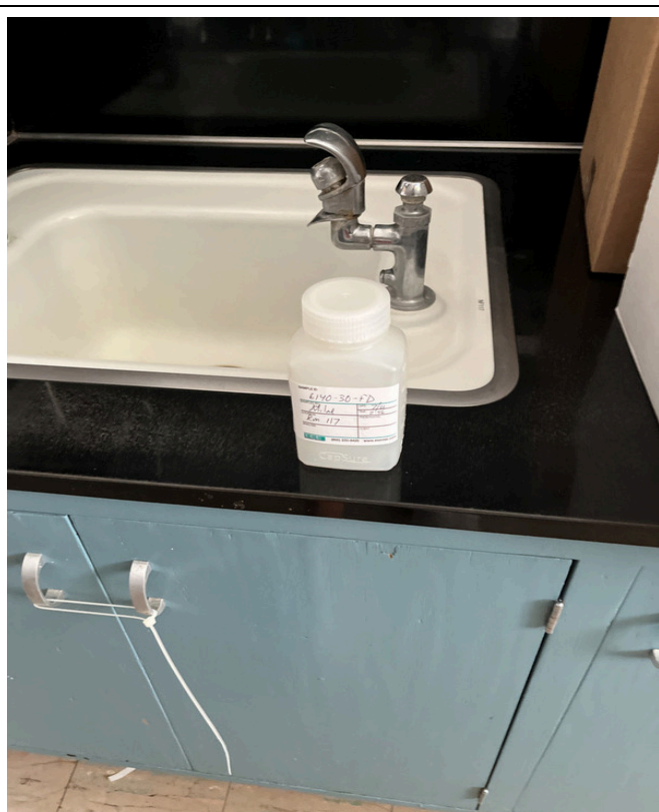

7/11/2024 - 6140-30 - Norfleet Elementary - Room 117




7/11/2024 - 6140-31 - Norfleet Elementary - Room 118



7/11/2024 - 6140-32 - Norfleet Elementary - Room 119




7/11/2024 - 6140-33 - Norfleet Elementary - Room 120

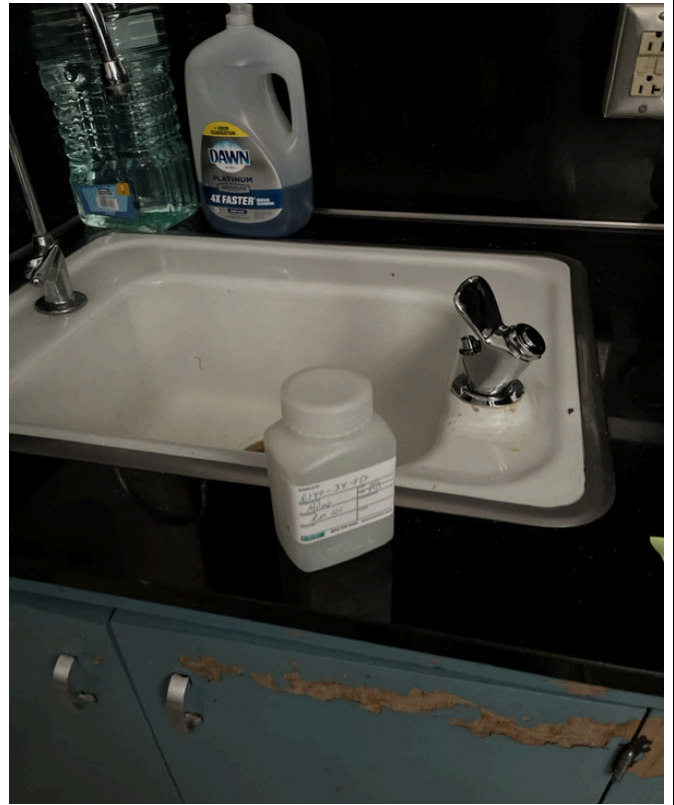

7/11/2024 - 6140-34 - Norfleet Elementary - Room 121




7/11/2024 - 6140-35 - Norfleet Elementary - Room 122

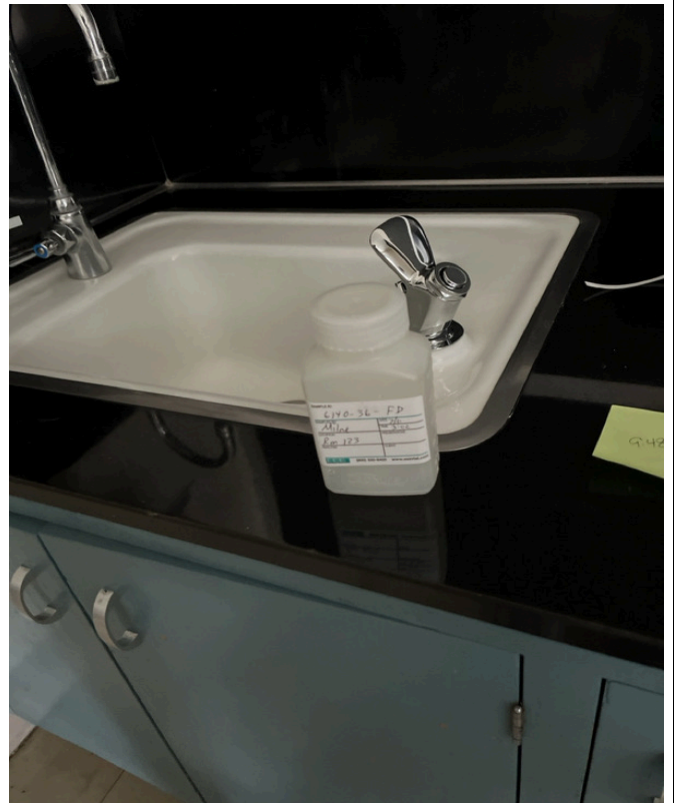

7/11/2024 - 6140-36 - Norfleet Elementary - Room 123



7/11/2024 - 6140-37 - Norfleet Elementary - Room 124

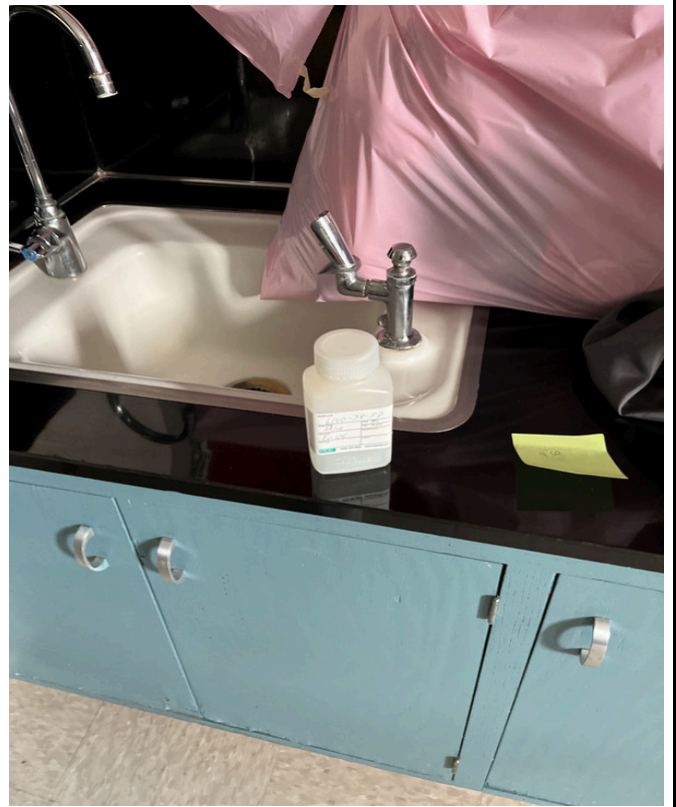

7/11/2024 - 6140-38 - Norfleet Elementary - Room 125

Appendix E

Source Identification Diagram

**ASP was provided sample locations by
Raytown School District**

(Please note that no sampling location maps are included in this report as floor plans were not supplied to ASP for this sampling event.)