



ENVIRONMENTAL • GEOTECHNICAL
BUILDING SCIENCES • MATERIALS TESTING

171 Commerce Street
Williston, VT 05495
Telephone 802-862-1980
Fax 737-207-8272
www.atcgroupservices.com

May 29, 2019

Mr. Kurt Proulx
5420 Shelburne Road
Shelburne, VT 05482

RE: Lead in Drinking Water Sampling
Shelburne Community School
Champlain Valley School District
Shelburne, VT 05482
ATC Project #280EM00349

Dear Kurt:

This report details the lead in drinking water sampling conducted at the Shelburne Community School, located in Shelburne, Vermont. ATC understands that the Shelburne Community School receives its water from the Champlain Water District.

Initial Sampling

On April 22, 2019, ATC Group Services (ATC) conducted sampling at 29 locations as directed by CVSD facilities personnel. Each sampling location consisted of two (2) samples (A & B), a first draw (A) collected from a system left unused for a minimum of 6 hours and a flush sample (B) collected after location had been flushed with moving water for a minimum of 30 seconds. One (1) Blank sample per day and two (2) duplicate samples per facility were also collected for quality control purposes.

Four (4) of the samples collected exceeded the Vermont Department of Health (VDH) Vermont Health Advisory (VHA) Drinking Water Guidance level of 15 ug/L for Lead. One (1) other sample was above laboratory detection limits, but below the VHA. All other samples collected were found to be below the laboratory detection limit of 1.0 ug/L.

The following table illustrates samples that contained a detectable concentration of lead.

Sample Number	Sample Location	Result (ug/L) (VHA Standard = 15 ug/L)
SCS-11A	B Wing Pod Classroom B-10 First Draw	16.8
SCS-15A	B Wing Pod Classroom B-6 First Draw	74.7
SCS-15B	B Wing Pod Classroom B-6 Flush	106
SCS-16A	B Wing Pod Classroom B-5 First Draw	24.6
SCS-16B	B Wing Pod Classroom B-5 Flush	8.0

Follow-Up Sampling

On May 13, 2019, ATC Group Services (ATC) conducted follow-up sampling at the 5 locations which contained detectable concentrations of lead. According to CVSD facilities personnel, unplanned plumbing activities had occurred in the B Wing prior to the initial sampling event.


NONE of the samples collected on May 13, 2019 exceeded the Vermont Department of Health (VDH) Vermont Health Advisory (VHA) Drinking Water Guidance level of 15 ug/L for Lead. All samples were found to be below the laboratory detection limit of 1.0 ug/L.

All lead in drinking water samples were submitted for analysis via EPA method SM 200.8B to Endyne Environmental Laboratories in Williston, Vermont. Laboratory analytical results are included in **Appendix A** and a sample location diagram is in **Appendix B**. Applicable certifications are included as **Appendix C**.


Thank you for selecting ATC for your environmental management needs. If you have any questions concerning this correspondence, please feel free to contact us at 862-1980.

Sincerely,

ATC Group Services, LLC

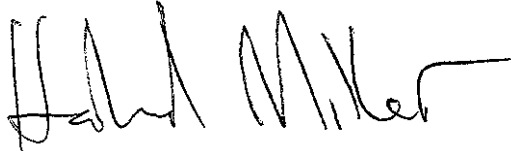

Harland Miller
Senior Environmental Technician
Direct Line +1 802-862-1980
Email: harland.miller@atcgs.com



Robert Montgomery
Senior Project Manager
Direct Line +1 802-862-1980
Email: rob.montgomery@atcgs.com

APPENDIX A

Lead in Drinking Water Laboratory Results



ATC Group Services
PO Box 1486 100043
Williston, VT 05495

Atten: Harland Miller

PROJECT: Shelburne Community School
WORK ORDER: **1904-08766**
DATE RECEIVED: April 23, 2019
DATE REPORTED: May 02, 2019
SAMPLER: Harland Miller

Laboratory Report

Enclosed please find the results of the analyses performed for the samples referenced on the attached chain of custody. All required method quality control elements including instrument calibration were performed in accordance with method requirements and determined to be acceptable unless otherwise noted.

The column labeled Lab/Tech in the accompanying report denotes the laboratory facility where the testing was performed and the technician who conducted the assay. A "W" designates the Williston, VT lab under NELAC certification ELAP 11263; "R" designates the Lebanon, NH facility under certification NH 2037 and "N" the Plattsburgh, NY lab under certification ELAP 11892. "Sub" indicates the testing was performed by a subcontracted laboratory. The accreditation status of the subcontracted lab is referenced in the corresponding NELAC and Qual fields.

The NELAC column also denotes the accreditation status of each laboratory for each reported parameter. "A" indicates the referenced laboratory is NELAC accredited for the parameter reported. "N" indicates the laboratory is not accredited. "U" indicates that NELAC does not offer accreditation for that parameter in that specific matrix. Test results denoted with an "A" meet all National Environmental Laboratory Accreditation Program requirements except where denoted by pertinent data qualifiers. Test results are representative of the samples as they were received at the laboratory

Endyne, Inc. warrants, to the best of its knowledge and belief, the accuracy of the analytical test results contained in this report, but makes no other warranty, expressed or implied, especially no warranties of merchantability or fitness for a particular purpose.

Reviewed by:

Harry B. Locker, Ph.D.
Laboratory Director

Laboratory Report

DATE REPORTED: 05/02/2019

CLIENT: ATC Group Services
PROJECT: Shelburne Community SchoolWORK ORDER: 1904-08766
DATE RECEIVED: 04/23/2019

001	Site: SCS-01A			Date Sampled: 4/22/19	Time: 16:01				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 15:28	W SJM	A			
002	Site: SCS-01B			Date Sampled: 4/22/19	Time: 16:03				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 15:31	W SJM	A			
003	Site: SCS-02A			Date Sampled: 4/22/19	Time: 16:05				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 15:33	W SJM	A			
004	Site: SCS-02B			Date Sampled: 4/22/19	Time: 16:07				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 15:36	W SJM	A			
005	Site: SCS-03A			Date Sampled: 4/22/19	Time: 16:09				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 15:38	W SJM	A			
006	Site: SCS-03B			Date Sampled: 4/22/19	Time: 16:12				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 15:41	W SJM	A			
007	Site: SCS-04A			Date Sampled: 4/22/19	Time: 16:14				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 15:44	W SJM	A			
008	Site: SCS-04B			Date Sampled: 4/22/19	Time: 16:16				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 15:46	W SJM	A			
009	Site: SCS-05A			Date Sampled: 4/22/19	Time: 16:18				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 15:56	W SJM	A			
010	Site: SCS-05B			Date Sampled: 4/22/19	Time: 16:21				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:04	W SJM	A			
011	Site: SCS-06A			Date Sampled: 4/22/19	Time: 16:22				

Laboratory Report

DATE REPORTED: 05/02/2019

CLIENT: ATC Group Services
PROJECT: Shelburne Community SchoolWORK ORDER: 1904-08766
DATE RECEIVED: 04/23/2019

011	Site: SCS-06A			Date Sampled: 4/22/19	Time: 16:22			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:07	W SJM	A		
012	Site: SCS-06B			Date Sampled: 4/22/19	Time: 16:23			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:09	W SJM	A		
013	Site: SCS-07A			Date Sampled: 4/22/19	Time: 16:25			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:12	W SJM	A		
014	Site: SCS-07B			Date Sampled: 4/22/19	Time: 16:27			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:14	W SJM	A		
015	Site: SCS-08A			Date Sampled: 4/22/19	Time: 16:31			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:17	W SJM	A		
016	Site: SCS-08B			Date Sampled: 4/22/19	Time: 16:32			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:19	W SJM	A		
017	Site: SCS-09A			Date Sampled: 4/22/19	Time: 16:34			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:22	W SJM	A		
018	Site: SCS-09B			Date Sampled: 4/22/19	Time: 16:36			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:25	W SJM	A		
019	Site: SCS-10A			Date Sampled: 4/22/19	Time: 16:40			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:32	W SJM	A		
020	Site: SCS-10B			Date Sampled: 4/22/19	Time: 16:42			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:40	W SJM	A		
021	Site: SCS-11A			Date Sampled: 4/22/19	Time: 16:45			

Laboratory Report

DATE REPORTED: 05/02/2019

CLIENT: ATC Group Services
 PROJECT: Shelburne Community School

WORK ORDER: 1904-08766
 DATE RECEIVED: 04/23/2019

021	Site: SCS-11A			Date Sampled: 4/22/19	Time: 16:45				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Metals Digestion HNO3-HCl	Digested		EPA 200.7/200.8	4/29/19	W SJM	A			
Lead, Total	0.0168	mg/L	EPA 200.8	5/1/19 12:15	W SJM	A			
022	Site: SCS-11B			Date Sampled: 4/22/19	Time: 16:47				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:43	W SJM	A			
023	Site: SCS-12A			Date Sampled: 4/22/19	Time: 16:49				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:45	W SJM	A			
024	Site: SCS-12B			Date Sampled: 4/22/19	Time: 16:50				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:48	W SJM	A			
025	Site: SCS-13A			Date Sampled: 4/22/19	Time: 16:53				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:50	W SJM	A			
026	Site: SCS-13B			Date Sampled: 4/22/19	Time: 16:55				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:53	W SJM	A			
027	Site: SCS-14A			Date Sampled: 4/22/19	Time: 17:01				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:56	W SJM	A			
028	Site: SCS-14B			Date Sampled: 4/22/19	Time: 17:03				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 16:58	W SJM	A			
029	Site: SCS-15A			Date Sampled: 4/22/19	Time: 17:04				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	0.0747	mg/L	EPA 200.8	4/25/19 17:01	W SJM	A			
030	Site: SCS-15B			Date Sampled: 4/22/19	Time: 17:06				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	0.106	mg/L	EPA 200.8	4/25/19 17:11	W SJM	A			

Laboratory Report

DATE REPORTED: 05/02/2019

CLIENT: ATC Group Services
 PROJECT: Shelburne Community School

WORK ORDER: 1904-08766
 DATE RECEIVED: 04/23/2019

031	Site: SCS-16A			Date Sampled: 4/22/19	Time: 17:08				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	0.0246	mg/L	EPA 200.8	4/25/19 17:19	W SJM	A			
032	Site: SCS-16B			Date Sampled: 4/22/19	Time: 17:10				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	0.0080	mg/L	EPA 200.8	4/25/19 17:21	W SJM	A			
033	Site: SCS-17A			Date Sampled: 4/22/19	Time: 17:13				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:24	W SJM	A			
034	Site: SCS-17B			Date Sampled: 4/22/19	Time: 17:15				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:26	W SJM	A			
035	Site: SCS-18A			Date Sampled: 4/22/19	Time: 17:19				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:29	W SJM	A			
036	Site: SCS-18B			Date Sampled: 4/22/19	Time: 17:22				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:32	W SJM	A			
037	Site: SCS-19A			Date Sampled: 4/22/19	Time: 17:27				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:34	W SJM	A			
038	Site: SCS-19B			Date Sampled: 4/22/19	Time: 17:30				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:37	W SJM	A			
039	Site: SCS-20A			Date Sampled: 4/22/19	Time: 17:32				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:39	W SJM	A			
040	Site: SCS-20B			Date Sampled: 4/22/19	Time: 17:34				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:47	W SJM	A			
041	Site: SCS-21A			Date Sampled: 4/22/19	Time: 17:36				

Laboratory Report

DATE REPORTED: 05/02/2019

CLIENT: ATC Group Services
 PROJECT: Shelburne Community School

WORK ORDER: 1904-08766
 DATE RECEIVED: 04/23/2019

041	Site: SCS-21A			Date Sampled: 4/22/19	Time: 17:36				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:55	W SJM	A			
042	Site: SCS-21B			Date Sampled: 4/22/19	Time: 17:37				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 17:58	W SJM	A			
043	Site: SCS-22A			Date Sampled: 4/22/19	Time: 17:39				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 18:00	W SJM	A			
044	Site: SCS-22B			Date Sampled: 4/22/19	Time: 17:41				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 18:03	W SJM	A			
045	Site: SCS-23A			Date Sampled: 4/22/19	Time: 17:43				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 18:05	W SJM	A			
046	Site: SCS-23B			Date Sampled: 4/22/19	Time: 17:45				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 18:08	W SJM	A			
047	Site: SCS-24A			Date Sampled: 4/22/19	Time: 17:49				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 18:11	W SJM	A			
048	Site: SCS-24B			Date Sampled: 4/22/19	Time: 17:51				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 18:13	W SJM	A			
049	Site: SCS-25A			Date Sampled: 4/22/19	Time: 17:53				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/25/19 18:16	W SJM	A			
050	Site: SCS-25B			Date Sampled: 4/22/19	Time: 17:55				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.		
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:09	W SJM	A			
051	Site: SCS-26A			Date Sampled: 4/22/19	Time: 17:59				

Laboratory Report

DATE REPORTED: 05/02/2019

CLIENT: ATC Group Services
 PROJECT: Shelburne Community School

WORK ORDER: 1904-08766
 DATE RECEIVED: 04/23/2019

051	Site: SCS-26A			Date Sampled: 4/22/19	Time: 17:59			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:16	W SJM	A		
052	Site: SCS-26B			Date Sampled: 4/22/19	Time: 18:01			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:19	W SJM	A		
053	Site: SCS-27A			Date Sampled: 4/22/19	Time: 18:03			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:22	W SJM	A		
054	Site: SCS-27B			Date Sampled: 4/22/19	Time: 18:04			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:24	W SJM	A		
055	Site: SCS-28A			Date Sampled: 4/22/19	Time: 18:08			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:27	W SJM	A		
056	Site: SCS-28B			Date Sampled: 4/22/19	Time: 18:06			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:30	W SJM	A		
057	Site: SCS-29A			Date Sampled: 4/22/19	Time: 18:10			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:32	W SJM	A		
058	Site: SCS-29B			Date Sampled: 4/22/19	Time: 18:12			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:35	W SJM	A		
059	Site: SCS-30A			Date Sampled: 4/22/19	Time: 18:10			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:38	W SJM	A		
060	Site: SCS-30B			Date Sampled: 4/22/19	Time: 18:12			
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.	
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:45	W SJM	A		
061	Site: SCS-30A			Date Sampled: 4/22/19	Time: 18:20			

Laboratory Report

DATE REPORTED: 05/02/2019

CLIENT: ATC Group Services

WORK ORDER: **1904-08766**

PROJECT: Shelburne Community School

DATE RECEIVED: 04/23/2019

061	Site: SCS-30A			Date Sampled: 4/22/19	Time: 18:20		
<u>Parameter</u>	<u>Result</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date/Time</u>	<u>Lab/Tech</u>	<u>NELAC</u>	<u>Qual.</u>
Lead, Total	< 0.0010	mg/L	EPA 200.8	4/26/19 8:53	W SJM	A	

CHAIN-OF-CUSTODY-RECORD

Special Reporting Instructions/PO#: 280 FEM 00349A

State of Origin: VT NY NH Other
 Endyne WO #

Client/Contact Name: ATC
 Phone #: 802 982 1980
 Mailing Address:

Sampler Name: Hatched Milk
 Phone #: 802 238 6167
 Billing Address:

Sample Location	Matrix	G R A B	G M Y	Date/Time Sampled	Sample Containers		Sample Preservation	Analysis Required	Field Results/Remarks	Due Date
					No.	Type/Size				
SCS-01A	W		X	1/23/19	1	11ur	Pb			
SCS-01B				1/23						
SCS-02A				1/23						
SCS-02B				1/23						
SCS-03A				1/23						
SCS-03B				1/23						
SCS-04A				1/23						
SCS-04B				1/23						
SCS-05A				1/23						
SCS-05B				1/23						

1904-08766

 1904-08766
 ATC Group Services
 Shelburne Community School

Relinquished by: <i>[Signature]</i>		Received by: <i>[Signature]</i>		Date/Time	Date/Time						
1	pH	6	TKN	11	Total Solids	16	Sulfate	21	1664 TPH/FOG	26	8270 PAH Only
2	Chloride	7	Total P	12	TSS	17	Coliform (Specify)	22	8015 GRO	27	8081 Pest
3	Ammonia N	8	Total Diss. P	13	TDS	18	COD	23	8015 DRO	28	8082 PCB
4	Nitrite N	9	BOD	14	Turbidity	19	VT PCF	24	8260B	29	PP13 Metals
5	Nitrate N	10	Alkalinity	15	Conductivity	20	VOC Halocarbons	25	8270 B/N or Acid	30	Total RCRA8
31	Metals (Total, Diss.) Ag, Al, As, B, Ba, Be, Ca, Cd, Co, Cr, Cu, Fe, Hg, K, Mg, Mn, Mo, Na, Ni, Pb, Sb, Se, Sn, Tl, U, V, Zn										
32	TCLP (volatiles, semi-volatiles, metals, pesticides, herbicides)										
34	Corrosivity	35	Ignitability	36	Reactivity	37	Other				
38	Other										

LAB USE ONLY
 Delivery: Client
 Temp: 14.4
 Comment:

CHAIN-OF-CUSTODY-RECORD

Special Reporting Instructions/PO#:

Project Name: **SCS**

State of Origin: VT NY NH Other

Endyne WO #

Client/Contact Name: _____
 Phone #: _____
 Mailing Address: _____

Sampler Name: _____
 Phone #: _____
 Billing Address: _____

Sample Location	Matrix	G R A B	C O M P	Date/Time Sampled	Sample Containers		Sample Preservation	Analysis Required	Field Results/Remarks	Due Date
					No.	Type/Size				
SCS-06A				4/22/17						
SCS-06B				1622						
SCS-07A				1623						
SCS-07B				1625						
SCS-08A				1627						
SCS-08B				1631						
SCS-09A				1632						
SCS-09B				1634						
SCS-10A				1636						
SCS-10B				1640						
				1642						

Relinquished by: *[Signature]* Date/Time: **4/23 0605**

Received by: **Stoomey** Date/Time: **4/23/19 @ 7:35**

Date/Time		Date/Time	
21	1664 TPH/FOG	26	8270 PAH Only
22	8015 GRO	27	8081 Pest
23	8015 DRO	28	8082 PCB
24	8260B	29	PP13 Metals
25	VOC Halocarbons	30	Total RCRA8

LAB USE ONLY
 Delivery: *Client*
 Temp: *144*
 Comment:

1	pH	6	TKN	11	Total Solids	16	Sulfate
2	Chloride	7	Total P	12	TSS	17	Coliform (Specify)
3	Ammonia N	8	Total Diss. P	13	TDS	18	COD
4	Nitrite N	9	BOD	14	Turbidity	19	VT PCF
5	Nitrate N	10	Alkalinity	15	Conductivity	20	VOC Halocarbons
31	Metals (Total, Diss.) Ag, Al, As, B, Ba, Be, Ca, Cd, Co, Cr, Cu, Fe, Hg, K, Mg, Mn, Mo, Na, Ni, Pb, Sb, Se, Sn, Ti, U, V, Zn						
32	TCLP (volatiles, semi-volatiles, metals, pesticides, herbicides)						
34	Corrosivity	35	Ignitability	36	Reactivity	37	Other
38	Other						Other

ENDYNE, INC.
 160 James Brown Drive
 Williston, Vermont 05495
 (802) 879-4333

CHAIN-OF-CUSTODY-RECORD

Special Reporting Instructions/PO#:

Project Name: **SCS**

State of Origin: VT NY NH Other

Endyne WO #

Client/Contact Name: _____
 Phone #: _____
 Mailing Address: _____

Sampler Name: _____
 Phone #: _____
 Billing Address: _____


Sample Location	Matrix	G R A B	C O M P	Date/Time Sampled	Sample Containers		Sample Preservation	Analysis Required	Field Results/Remarks	Due Date
					No.	Type/Size				
SCS-11A				4/22/19						
SCS-11B				1645						
SCS-12A				1647						
SCS-12B				1649						
SCS-13A				1650						
SCS-13B				1653						
SCS-14A				1655						
SCS-14B				1701						
SCS-15A				1703						
SCS-15B				1704						
				1706						

Relinquished by: LDW Date/Time: 4/23/19 800

Received by: STORNEY Date/Time: 4/23/19 @ 7:55

Date/Time		Date/Time	
1	pH	6	TKN
2	Chloride	7	Total P
3	Ammonia N	8	Total Diss. P
4	Nitrite N	9	BOD
5	Nitrate N	10	Alkalinity
31	Metals (Total, Diss.) Ag, Al, As, B, Ba, Be, Ca, Cd, Co, Cr, Cu, Fe, Hg, K, Mg, Mn, Mo, Na, Ni, Pb, Sb, Se, Sn, Ti, U, V, Zn	11	Total Solids
32	TCLP (volatiles, semi-volatiles, metals, pesticides, herbicides)	12	TSS
34	Corrosivity	13	TDS
38	Other	14	Turbidity
		15	Conductivity
		16	Sulfate
		17	Coliform (Specify)
		18	COD
		19	VT PCF
		20	VOC Halocarbons
		21	1664 TPH/FOG
		22	8015 GRO
		23	8015 DRO
		24	8260B
		25	8270 B/N or Acid
		26	8270 PAH Only
		27	8081 Pest
		28	8082 PCB
		29	PP13 Metals
		30	Total RCRA8
		33	Other
		36	Reactivity
		37	Other

LAB USE ONLY
 Delivery: Client
 Temp: 14.4
 Comment:



ENDYNE, INC.
 160 James Brown Drive
 Williston, Vermont 05495
 (802) 879-4333

CHAIN-OF-CUSTODY-RECORD

Special Reporting Instructions/PO#:

Project Name: **SCS**

State of Origin: VT NY NH Other

Endyne WO # _____

Client/Contact Name: _____

Phone #: _____

Mailing Address: _____

Sampler Name: _____

Phone #: _____

Billing Address: _____

Sample Location	Matrix	G R A B	C O M P	Date/Time Sampled	Sample Containers		Sample Preservation	Analysis Required	Field Results/Remarks	Due Date
					No.	Type/Size				
SCS-16A				1708						
SCS-16B				1710						
SCS-17A				1713						
SCS-17B				1715						
SCS-18A				1719						
SCS-18B				1722						
SCS-19A				1727						
SCS-19B				1732						
SCS-20A				1732						
SCS-20B				1734						

Relinquished by: **AKL** Date/Time: **4/13 0505** Received by: **STORMY** Date/Time: **4/23/19 @ 7:35**

No.	pH	TKN	6	Total Solids	11	Sulfate	16	21	1664 TPH/FOG	26	8270 PAH Only	27	8081 Pest	28	8082 PCB	29	PP13 Metals	30	Total RCRA8	LAB USE ONLY			
																				7	12	17	22
2	Chloride	Total P		TSS		Coliform (Specify)		8015 GRO		8015 DRO		8260B		8270 B/N or Acid							Client	144	
3	Ammonia N	Total Diss. P		TDS		VT PCF		VOC Halocarbons															
4	Nitrite N	BOD		Turbidity		Conductivity		33 Other															
5	Nitrate N	Alkalinity		34 Corrosivity		35 Ignitability		36 Reactivity															
31	Metals (Total, Diss.) Ag, Al, As, B, Ba, Be, Ca, Cd, Co, Cr, Cu, Fe, Hg, K, Mg, Mn, Mo, Na, Ni, Pb, Sb, Se, Sn, Ti, U, V, Zn																						
32	TCLP (volatiles, semi-volatiles, metals, pesticides, herbicides)																						
34	Other																						
38	Other																						

CHAIN-OF-CUSTODY-RECORD

Special Reporting Instructions/PO#:

Project Name: **SCS**

State of Origin: VT NY NH Other

Endyne WO #

Client/Contact Name: _____

Phone #: _____

Mailing Address: _____

Sampler Name: _____

Phone #: _____

Billing Address: _____

Sample Location	Matrix	G R A B	C O M P	Date/Time Sampled	Sample Containers		Sample Preservation	Analysis Required	Field Results/Remarks	Due Date
					No.	Type/Size				
SCS - 21A				4/22/19						
SCS - 21B				1736						
SCS - 22A				1737						
SCS - 22B				1738						
SCS - 23A				1741						
SCS - 23B				1743						
SCS - 24A				1745						
SCS - 24B				1749						
SCS - 25A				1751						
SCS - 25B				1753						
SCS - 25B				1755						

Relinquished by: *[Signature]* Date/Time: **4/23/19 0805**

Received by: **Stooney** Date/Time: **4/23/19 @ 7:53**

Date/Time		Date/Time	
16	Sulfate	21	1664 TPH/FOG
17	Coliform (Specify)	22	8015 GRO
18	COD	23	8015 DRO
19	VT PCF	24	8260B
20	VOC Halocarbons	25	8270 B/N or Acid
26	8270 PAH Only	27	8081 Pest
28	8082 PCB	29	PP13 Metals
30	Total RCRA8		


LAB USE ONLY

Delivery: **Client**

Temp: **14.4**

Comment:

11	Total Solids	16	Sulfate
12	TSS	17	Coliform (Specify)
13	TDS	18	COD
14	Turbidity	19	VT PCF
15	Conductivity	20	VOC Halocarbons
31	Metals (Total, Diss.) Ag, Al, As, B, Ba, Be, Ca, Cd, Co, Cr, Cu, Fe, Hg, K, Mg, Mn, Mo, Na, Ni, Pb, Sb, Se, Sn, Tl, U, V, Zn	33	Other
32	TCLP (volatiles, semi-volatiles, metals, pesticides, herbicides)	37	Other
35	Ignitability	36	Reactivity



ENDYNE, INC.

160 James Brown Drive
Williston, Vermont 05495
(802) 879-4333

CHAIN-OF-CUSTODY-RECORD

Special Reporting Instructions/PO#:

Project Name: SCS	Client/Contact Name:	Sampler Name:
State of Origin: VT NY NH Other	Phone #:	Phone #:
Endyne WO #	Mailing Address:	Billing Address:

Sample Location	Matrix	C R A B	C O M P	Date/Time Sampled	Sample Containers		Sample Preservation	Analysis Required	Field Results/Remarks	Due Date
					No.	Type/Size				
SCS - 26A				4/22/19						
SCS - 26B				1751						
SCS - 27A				1801						
SCS - 27B				1803						
SCS - 28A				1804						
SCS - 28B				1808						
SCS - 29A				1810						
SCS - 29B				1812						
SCS - 30A				1810						
SCS - 30B				1812						

Relinquished by: <i>[Signature]</i>	Date/Time: 4/25 0805	Received by: <i>[Signature]</i>	Date/Time: 4/23/19 @ 7:55
-------------------------------------	----------------------	---------------------------------	---------------------------

1	pH	6	TKN	11	Total Solids	16	Sulfate	21	1664 TPH/FOG	26	8270 PAH Only	LAB USE ONLY
3	Ammonia N	8	Total Diss. P	13	TDS	18	COD	23	8015 DRO	28	8082 PCB	Delivery: Client
4	Nitrite N	9	BOD	14	Turbidity	19	VT PCF	24	8260B	29	PP13 Metals	Temp: 14.4
5	Nitrate N	10	Alkalinity	15	Conductivity	20	VOC Halocarbons	25	8270 B/N or Acid	30	Total RCRA8	Comment:
31	Metals (Total, Diss.) Ag, Al, As, B, Ba, Be, Ca, Cd, Co, Cr, Cu, Fe, Hg, K, Mg, Mn, Mo, Na, Ni, Pb, Sb, Se, Sn, Ti, U, V, Zn											
32	TCLP (volatiles, semi-volatiles, metals, pesticides, herbicides)											
34	Corrosivity	35	Ignitability	36	Reactivity	37	Other	33	Other			
38	Other											



ATC Group Services
PO Box 1486 100043
Williston, VT 05495

Atten: Rob Montgomery

PROJECT: SCS
WORK ORDER: **1905-10568**
DATE RECEIVED: May 13, 2019
DATE REPORTED: May 15, 2019
SAMPLER: Harland Miller

Laboratory Report

Enclosed please find the results of the analyses performed for the samples referenced on the attached chain of custody. All required method quality control elements including instrument calibration were performed in accordance with method requirements and determined to be acceptable unless otherwise noted.

The column labeled Lab/Tech in the accompanying report denotes the laboratory facility where the testing was performed and the technician who conducted the assay. A "W" designates the Williston, VT lab under NELAC certification ELAP 11263; "R" designates the Lebanon, NH facility under certification NH 2037 and "N" the Plattsburgh, NY lab under certification ELAP 11892. "Sub" indicates the testing was performed by a subcontracted laboratory. The accreditation status of the subcontracted lab is referenced in the corresponding NELAC and Qual fields.

The NELAC column also denotes the accreditation status of each laboratory for each reported parameter. "A" indicates the referenced laboratory is NELAC accredited for the parameter reported. "N" indicates the laboratory is not accredited. "U" indicates that NELAC does not offer accreditation for that parameter in that specific matrix. Test results denoted with an "A" meet all National Environmental Laboratory Accreditation Program requirements except where denoted by pertinent data qualifiers. Test results are representative of the samples as they were received at the laboratory

Endyne, Inc. warrants, to the best of its knowledge and belief, the accuracy of the analytical test results contained in this report, but makes no other warranty, expressed or implied, especially no warranties of merchantability or fitness for a particular purpose.

Reviewed by:

Harry B. Locker, Ph.D.
Laboratory Director

Laboratory Report

DATE REPORTED: 05/15/2019

CLIENT: ATC Group Services
PROJECT: SCSWORK ORDER: **1905-10568**
DATE RECEIVED: 05/13/2019

001	Site: SCS - 11A-R1	Date Sampled: 5/13/19	Time: 6:35				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.
Lead, Total	< 0.0010	mg/L	EPA 200.8	5/15/19 9:42	W SJM	A	

002	Site: SCS - 11B-R1	Date Sampled: 5/13/19	Time: 6:36				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.
Lead, Total	< 0.0010	mg/L	EPA 200.8	5/15/19 9:53	W SJM	A	

003	Site: SCS - 15A-R1	Date Sampled: 5/13/19	Time: 6:41				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.
Lead, Total	< 0.0010	mg/L	EPA 200.8	5/15/19 9:57	W SJM	A	

004	Site: SCS - 15B-R1	Date Sampled: 5/13/19	Time: 6:42				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.
Lead, Total	< 0.0010	mg/L	EPA 200.8	5/15/19 10:00	W SJM	A	

005	Site: SCS - 16A-R1	Date Sampled: 5/13/19	Time: 6:47				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.
Lead, Total	< 0.0010	mg/L	EPA 200.8	5/15/19 10:04	W SJM	A	

006	Site: SCS - 16B-R1	Date Sampled: 5/13/19	Time: 6:48				
Parameter	Result	Units	Method	Analysis Date/Time	Lab/Tech	NELAC	Qual.
Lead, Total	< 0.0010	mg/L	EPA 200.8	5/15/19 10:08	W SJM	A	



CHAIN-OF-CUSTODY-RECORD

160 James Brown Drive
Williston, Vermont 05495
(802) 879-4333

Special Reporting Instructions/PO#: 280 FM 003499

Project Name: **SCS** Client/Contact Name: **Harland Miller** Sampler Name: **H. Miller**

State of Origin: VT ~~NY~~ NH Other Phone #: **802 862 1980**

Endyne WO # _____ Mailing Address: **Harland Miller C ategs.com**

Sample Location	Matrix	G R A B	C O M P	Sample Containers		Date/Time Sampled	Sample Preservation	Analysis Required	Field Results/Remarks	Due Date
				No.	Type/Size					
SCS-11A-R1	W	X		1	11#	5/13/19		PB		
SCS-11B-R1		X				0635				
SCS-15A-R1		X				0636				
SCS-15B-R1		X				0641				
SCS-16A-R1		X				0642				
SCS-16B-R1		X				0647				
						0648				

Relinquished by: **H. Miller 5/13/19 0845** Date/Time: _____ Received by: **Storney 5/13/19 8:45** Date/Time: _____


No.	Parameter	Result	Method	Sample No.	Date/Time	Received by
1	pH			21	1664 TPH/FOG	26 8270 PAH Only
2	Chloride			22	8015 GRO	27 8081 Pest
3	Ammonia N					
4	Nitrite N					
5	Nitrate N					
31	Metals (Total, Diss.) Ag, Al, As, B, Ba, Be, Ca, Cd, Co, Cr, Cu, Fe, Hg, K,					
32	TCCLP (volatiles, semi-volatiles, metals, pesticides, herbicides)					
34	Corrosivity					
35	Ignitability					
36	Reactivity					
37	Other					

1905-10568

1905-10568
ATC Group Services
SCS

LAB USE ONLY
Delivery: **Client**
Temp: **19.1**
Comment:

APPENDIX B
Sample Location Diagram

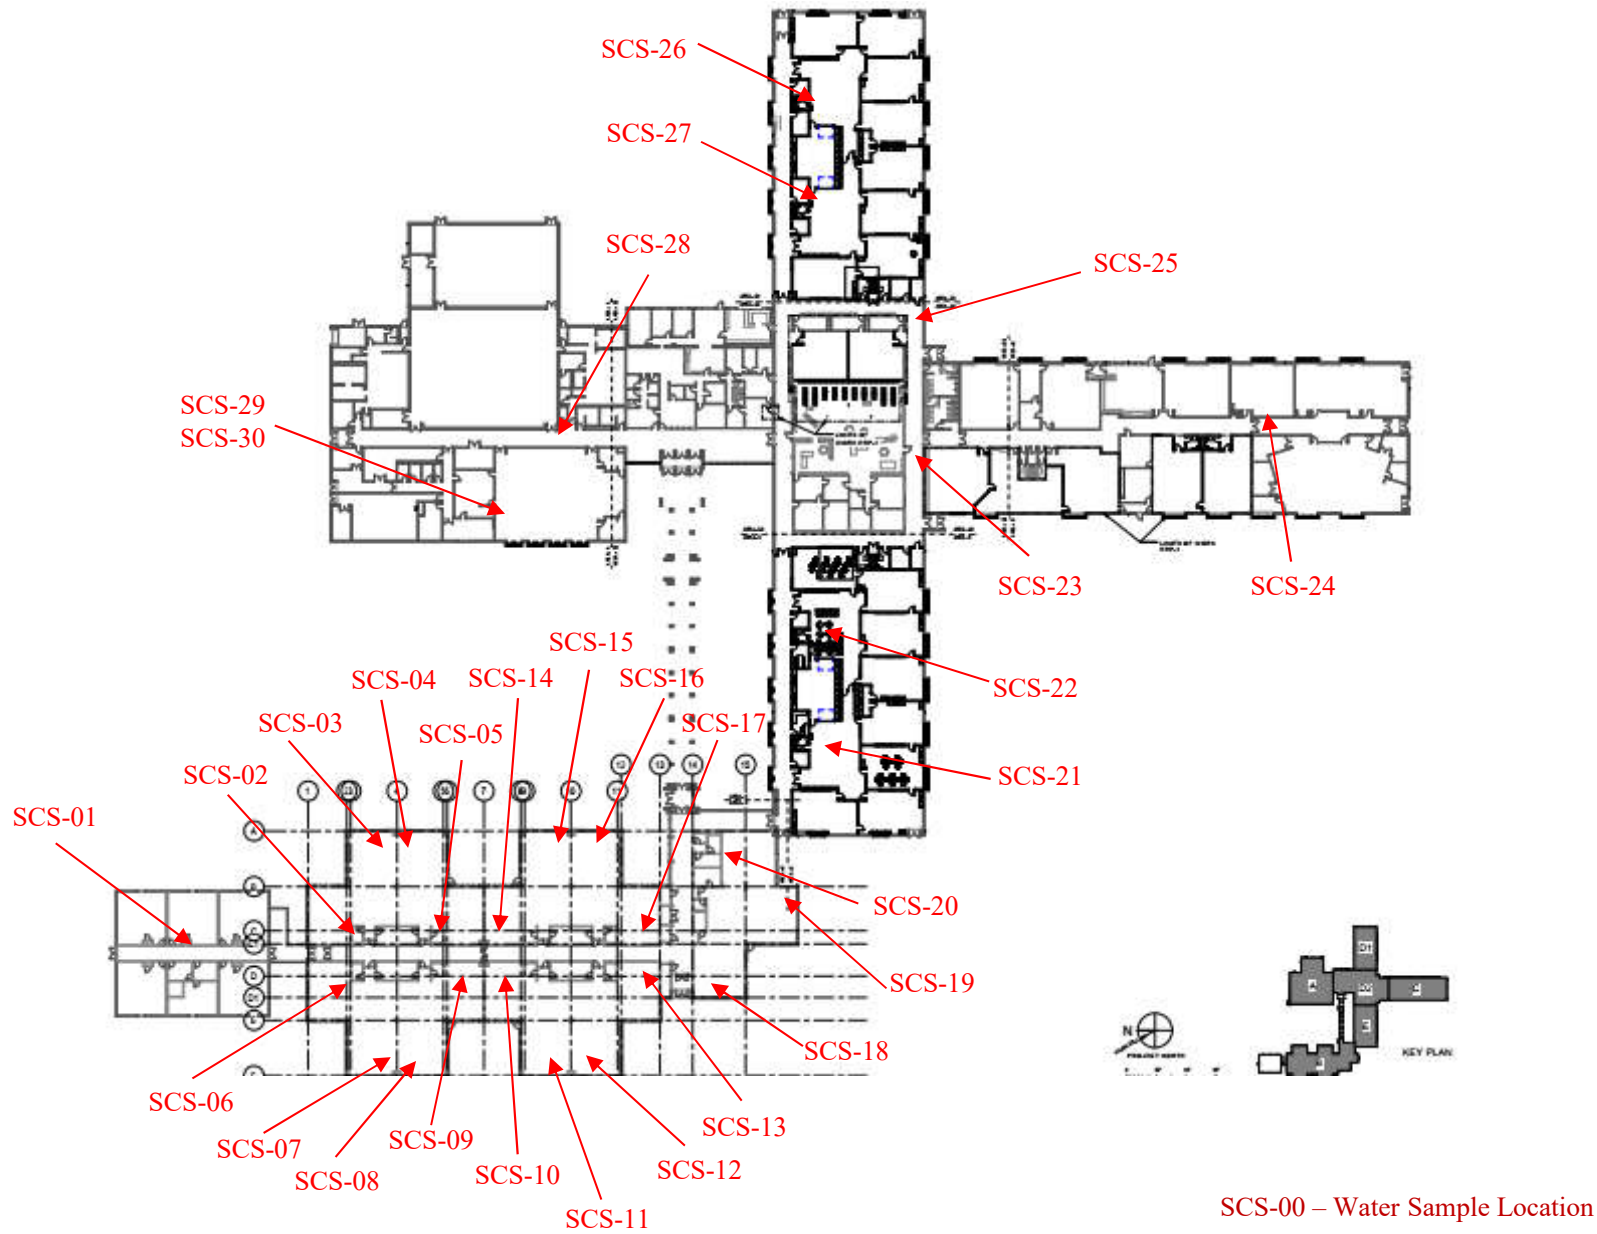

Water Sample Location Diagram – 4/22/19

Address: Shelburne Community School
Shelburne, Vermont

Project Number: 280EM00349



171 Commerce St. Williston, Vermont 05495
Phone: (802) 862-1980 Fax: (802) 862-1405

APPENDIX C
ATC and Laboratory Certifications

Vermont Drinking Water Certification
Analytical Methods
 Issued December 29, 2018 as provided for in 18 VSA 501b
 Expiration Date December 31, 2019
 This listing is not valid without accompanying Vermont Certificate
Endyne, Inc.
Williston, VT

DRINKING WATER MICROBIOLOGY

Total coliform and *E. coli* (SM 9223 B):

Colilert, P/A Colisure, P/A Colilert, QuantiTray

Uranium:

EPA 200.8

Vanadium:

EPA 200.8

Zinc:

EPA 200.7 EPA 200.8

DRINKING WATER METALS

Aluminum: EPA 200.7 EPA 200.8
 Antimony: EPA 200.8
 Arsenic: EPA 200.8
 Barium: EPA 200.7 EPA 200.8
 Beryllium: EPA 200.7 EPA 200.8
 Cadmium: EPA 200.7 EPA 200.8
 Calcium: EPA 200.7
 Chromium: EPA 200.7 EPA 200.8
 Copper: EPA 200.7 EPA 200.8
 Iron: EPA 200.7
 Lead: EPA 200.8
 Magnesium: EPA 200.7
 Manganese: EPA 200.7 EPA 200.8
 Mercury: EPA 200.8 EPA 245.1
 Molybdenum: EPA 200.8
 Nickel: EPA 200.7 EPA 200.8
 Selenium: EPA 200.8
 Silver: EPA 200.7 EPA 200.8
 Sodium: EPA 200.7
 Thallium: EPA 200.8

DRINKING WATER INORGANIC CONTAMINANTS

Chloride: EPA 300.0
 Color: SM 2120 B
 Conductivity (Specific Conductance):
 EPA 120.1
 Corrosivity (Langlier Index):
 SM 2330 B
 Fluoride: EPA 300.0
 Hardness (Calc.): EPA 200.7
 Nitrate-N: EPA 300.0
 Nitrite-N: EPA 300.0
 Odor: SM 2150 B
 Orthophosphate: EPA 300.0
 Residue, Total Filterable (TDS):
 SM 2540 C
 Sulfate: EPA 300.0
 Turbidity: EPA 180.1
 UV 254: SM 5910 B

DRINKING WATER ACIDS, BASE/NEUTRALS

Benzo(a)pyrene: EPA 525.2
 Di(2-ethylhexyl)adipate: EPA 525.2
 Di(2-ethylhexyl)phthalate: EPA 525.2

DRINKING WATER METALS

DRINKING WATER HERBICIDES

2,4-D: EPA 515.4
Dalapon: EPA 515.4
Dicamba: EPA 515.4
Dinoseb: EPA 515.4
Pentachlorophenol: EPA 515.4
Picloram: EPA 515.4
2,4-TP (Silvex): EPA 515.4

DRINKING WATER INSECTICIDES (PESTICIDES)

Alachlor: EPA 525.2
Aldrin: EPA 505
Atrazine: EPA 525.2
Butachlor: EPA 525.2
Chlordane: EPA 505
Dieldrin: EPA 505
Endrin: EPA 505
Heptachlor: EPA 505
Heptachlor Epoxide: EPA 505
Lindane: EPA 505
Methoxychlor: EPA 505
Metolachlor: EPA 525.2
Metribuzin: EPA 525.2
Propachlor: EPA 525.2
Simazine: EPA 525.2
Toxaphene: EPA 505

INDIVIDUAL DRINKING WATER ORGANIC CONTAMINANTS

DBCP: EPA 504.1
EDB: EPA 504.1
1,2,3 Trichloropropane: EPA 524.2

DRINKING WATER TRIHALOMETHANES

Bromodichloromethane: EPA 524.2

Bromoform: EPA 524.2
Chlorodibromomethane: EPA 524.2
Chloroform: EPA 524.2
Total Trihalomethanes: EPA 524.2

DRINKING WATER VOLATILE ORGANICS

Benzene: EPA 524.2
Bromobenzene: EPA 524.2
Bromochloromethane: EPA 524.2
Bromodichloromethane: EPA 524.2
Bromoform: EPA 524.2
Bromomethane: EPA 524.2
n-Butylbenzene: EPA 524.2
sec-Butylbenzene: EPA 524.2
tert-Butylbenzene: EPA 524.2
Carbon Tetrachloride: EPA 524.2
Chlorobenzene: EPA 524.2
Chloroethane: EPA 524.2
Chloroform: EPA 524.2
Chloromethane: EPA 524.2
2-Chlorotoluene: EPA 524.2
4-Chlorotoluene: EPA 524.2
Dibromochloromethane: EPA 524.2
Dibromomethane: EPA 524.2
1,2-Dichlorobenzene: EPA 524.2
1,3-Dichlorobenzene: EPA 524.2
1,4-Dichlorobenzene: EPA 524.2
Dichlorodifluoromethane: EPA 524.2
1,1-Dichloroethane: EPA 524.2
1,2-Dichloroethane: EPA 524.2
c-1,2-Dichloroethene: EPA 524.2
t 1,2-Dichloroethylene: EPA 524.2

DRINKING WATER VOLATILE ORGANICS (cont.)

1,1-Dichloroethylene: EPA 524.2

Dichloromethane:
EPA 524.2
1,2-Dichloropropane:
EPA 524.2
1,3-Dichloropropane:
EPA 524.2
2,2-Dichloropropane:
EPA 524.2
1,1-Dichloropropene:
EPA 524.2
c 1,3-Dichloropropene:
EPA 524.2
t 1,3-Dichloropropene:
EPA 524.2
Ethylbenzene:
EPA 524.2
Hexachlorbutadiene:
EPA 524.2
Isopropylbenzene:
EPA 524.2
4-Isopropyltoluene:
EPA 524.2
Methyl t-Butyl Ether (MTBE):
EPA 524.2
Naphthalene:
EPA 524.2
n-Propylbenzene:
EPA 524.2
Styrene:
EPA 524.2
1,1,1,2-Tetrachloroethane:
EPA 524.2
1,1,2,2-Tetrachloroethane:
EPA 524.2
Tetrachloroethylene:
EPA 524.2
Toluene:

1,2,3-Trichlorobenzene:
EPA 524.2
1,2,4-Trichlorobenzene:
EPA 524.2
1,1,1-Trichloroethane:
EPA 524.2
1,1,2-Trichloroethane:
EPA 524.2
Trichloroethylene:
EPA 524.2
Trichlorofluoromethane:
EPA 524.2
1,2,3 Trichloropropane:
EPA 524.2
1,2,4-Trimethylbenzene:
EPA 524.2
1,3,5-Trimethylbenzene:
EPA 524.2
Total Xylenes:
EPA 524.2
Vinyl Chloride:
EPA 524.2

**DRINKING WATER ORGANIC DISINFECTION BY-
PRODUCTS HALOACETIC ACIDS**

Bromoacetic Acid:
EPA 552.2
Chloroacetic Acid:
EPA 552.2
Dibromoacetic Acid:
EPA 552.2
Dichloroacetic Acid:
EPA 552.2
Trichloroacetic Acid:
EPA 552.2
Total Haloacetic Acids:
EPA 552.2

DRINKING WATER VOLATILE ORGANICS (cont.)
EPA 524.2

By:



William G. Mills
Certification Officer
Date signed and effective December 29, 2018

As of December 29, 2018, this listing supersedes all previous lists for this certificate number.
Vermont Certification is based in part upon current New York Accreditation Certificate of Approval NY lab ID **11263-58567**, April 1, 2018 – April 1, 2019 {Revised August 27, 2018}. Laboratories are certified in Vermont based, in part, upon its Primary Accrediting Body(ies) drinking water accreditation(s). Also, loss of drinking water primary accreditation (in part or whole) constitutes loss of certification in Vermont for the same drinking water tests.



DEPARTMENT OF HEALTH


*State of Vermont Department of Health
Drinking Water Laboratory Certification*

Endyne, Inc.
Williston, Vermont


Is certified to perform microbiological, inorganic and organic analyses on drinking water pursuant to the certification letter dated December 29, 2018.



Commissioner of Health



Laboratory Director



Laboratory Certification Officer

January 1, 2019
Date certified

VT - 2021
Laboratory Number

December 31, 2019
Certificate expiration date