

School Name: **Rutherford Elementary (RF)**Date: **11/14/2023**



Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer WF= Water Filter	Lead Result (ppb)	Copper Result (ppb)
Main Floor	-	Hallway	1-RF-Hallway-BF	BF	<0.5	43.5
Main Floor	-	Hallway	2-RF-Hall-WCR	WC	<0.5	42.4
Main Floor	-	Hallway	3-RF-Hall-WCL	WC	<0.5	36.4
Main Floor	-	Kitchen	4-RF-Kit-S	S	8.05	315
Main Floor	-	Kitchen	5-RF-Kit-SP	SP	4.16	379
Main Floor	-	Kitchen	6-RF-Kit-K	K	9.95	584
Main Floor	-	Kitchen	7-RF-Kit-S	S	2.42	495
Main Floor	-	Kitchen	8-RF-Kit-S	S	2.44	474
Main Floor	-	Kitchen	9-RF-Kit-SL	S	3.97	547
Main Floor	-	Kitchen	10-RF-Kit-SR	S	4.88	208
Main Floor	-	Kitchen	11-RF-Kit-SP	SP	1.66	454
Main Floor	-	Staff Lounge	12-RF-StaffLounge-S	S	1.66	416
Main Floor	-	Staff Lounge	13-RF-StaffLounge-WF	WF	<0.5	69.3
Main Floor	-	Music	14-RF-Music-S	S	14.1	425
Main Floor	-	Classroom	15-RF-Blue-WCL	WC	<0.5	229
Main Floor	-	Classroom	16-RF-Blue-BF	BF	<0.5	219
Main Floor	-	Classroom	17-RF-Blue-WCR	WC	<0.5	175
Main Floor	-	Classroom	18-RF-Blue-S	S	2.21	259
Main Floor	-	Classroom	19-RF-Blue-S	S	1.24	377
Main Floor	-	Classroom	20-RF-Blue-DF	DF	0.56	239
Main Floor	-	Classroom	21-RF-Red-BF	BF	<0.5	40.1
Main Floor	-	Classroom	22-RF-Red-WCL	WC	<0.5	38.7
Main Floor	-	Classroom	23-RF-Red-WCR	WC	<0.5	40.3
Main Floor	-	Classroom	24-RF-Red-S	S	1.8	198
Main Floor	-	Classroom	25-RF-Red-S	S	1.13	325
Main Floor	-	Classroom	26-RF-Red-DF	DF	<0.5	220
Main Floor	-	Classroom	27-RF-106A-S	S	2.2	388
Main Floor	-	Classroom	28-RF-ECFE-S	S	1.62	331
Main Floor	-	Classroom	29-RF-ECFE-DF	DF	0.6	137
Main Floor	-	Classroom	30-RF-Green-S	S	3.73	482
Main Floor	-	Classroom	31-RF-Green-DF	DF	3.32	177
Main Floor	-	Classroom	32-RF-Green-BF	BF	<0.5	34.9
Main Floor	-	Classroom	33-RF-Green-WC	WC	<0.5	30.8
Main Floor	-	Classroom	34-RF-Green-S	S	3.55	338
Main Floor	-	Classroom	35-RF-Green-S	S	2.18	382
Main Floor	-	Classroom	36-RF-Green-DF	DF	1.67	229
Main Floor	-	Classroom	37-RF-Green-S	S	3.07	380
Main Floor	-	Classroom	38-RF-Green-DF	DF	2.27	234
Main Floor	-	Classroom	39-RF-Green-S	S	6.17	531
Main Floor	-	Classroom	40-RF-Green-DF	DF	5.55	289
Lower Level	-	Classroom	41-RF-K1Red-BF	BF	<0.5	50.8
Lower Level	-	Classroom	42-RF-K1Red-WCL	WC	<0.5	47.5
Lower Level	-	Classroom	43-RF-K1Red-WCR	WC	<0.5	43.7
Lower Level	-	Classroom	44-RF-K1Red-S	S	1.35	456
Lower Level	-	Classroom	45-RF-K1Red-S	S	1.18	324
Lower Level	-	Classroom	46-RF-K1Red-DF	DF	<0.5	221
Lower Level	-	Media Center	47-RF-MediaCenter-BF	BF	<0.5	25.2
Lower Level	-	Media Center	48-RF-MC-WCR	WC	<0.5	24
Lower Level	-	Media Center	49-RF-MC-WCL	WC	<0.5	22.5

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer WF= Water Filter	Lead Result (ppb)	Copper Result (ppb)
Lower Level	-	Classroom	50-RF-5-6Blue-WCL	WC	<0.5	136
Lower Level	-	Classroom	51-RF-5-6Blue-WCR	WC	<0.5	119
Lower Level	-	Classroom	52-RF-5-6Blue-S	S	6.26	368
Lower Level	-	Classroom	53-RF-5-6Blue-S	S	2.34	291
Lower Level	-	Classroom	54-RF-5-6Blue-DF	DF	<0.5	234
Lower Level	-	Workroom	55-RF-WR-S	S	4.13	492
Main Floor	-	Nurse	56-RF-Nurse-S	S	1.67	383

Rutherford Elementary
Lower Level
Lead in Drinking Water
Project #23127

First Draw Sampling (2023)

- ◆ Lead \leq 20 ppb
- ◆ Lead $>$ 20 ppb

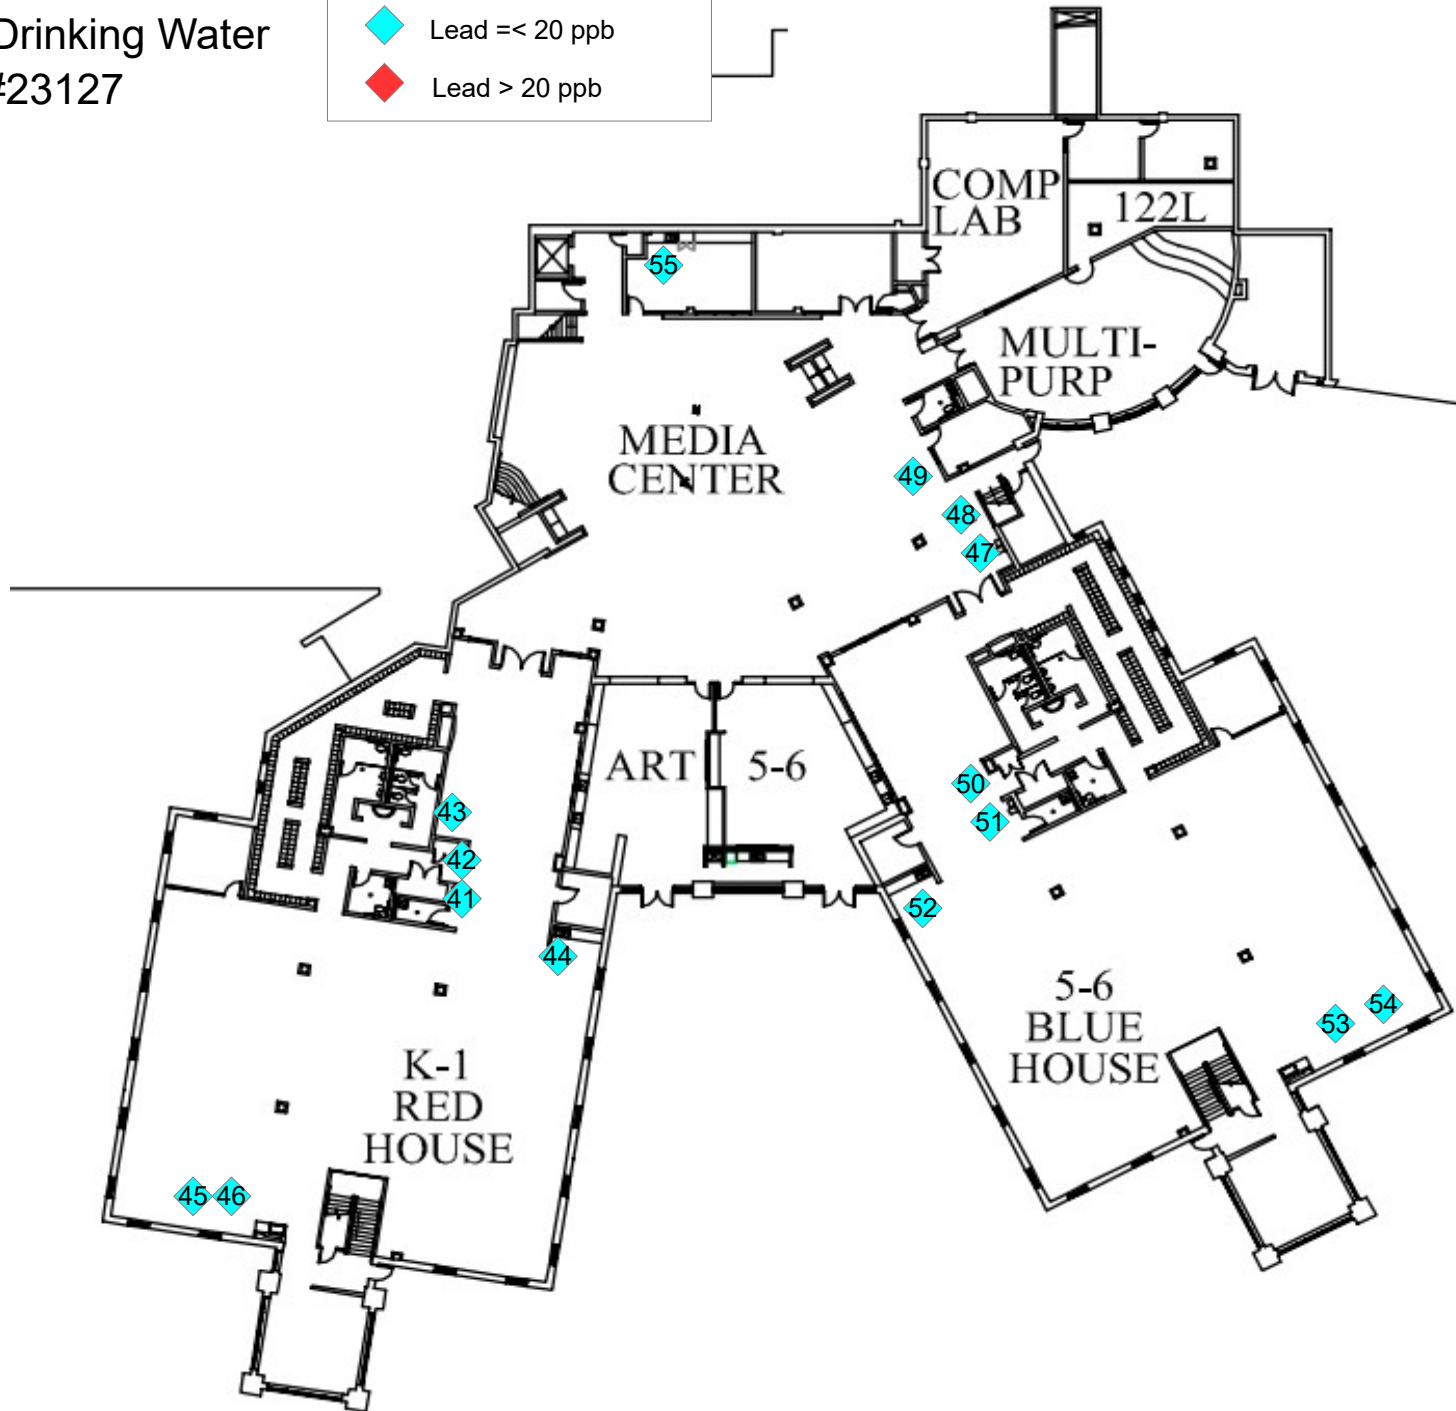

Rutherford Elementary
Main Level
Lead in Drinking Water
Project #23127

First Draw Sampling (2023)

- ◆ Lead \leq 20 ppb
- ◆ Lead $>$ 20 ppb

