

School Name: Stillwater Middle School (SMS)



Date: 11/14/2023

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler SP = Sprayer	Lead Result (ppb)	Copper Result (ppb)
First Floor	-	Hallway	1-SMS-CafeHall-WCL	WC	<0.5	35.4
First Floor	-	Hallway	2-SMS-CafeHall-BF	BF	<0.5	38.8
First Floor	-	Hallway	3-SMS-CafeHall-WCR	WC	<0.5	47.3
First Floor	-	Kitchen	4-SMS-Kit-S	S	3.79	216
First Floor	-	Kitchen	5-SMS-Kit-S	S	2.74	482
First Floor	-	Kitchen	6-SMS-Kit-S	S	2.03	479
First Floor	-	Kitchen	7-SMS-Kit-SP	SP	1.3	312
First Floor	-	Kitchen	8-SMS-Kit-S	S	1.43	285
First Floor	-	Dish Room	9-SMS-Dish-SPR	SP	1.69	509
First Floor	-	Dish Room	10-SMS-Dish-SPL	SP	2.21	517
First Floor	-	Hallway	11-SMS-W186Hall-WCL	WC	<0.5	167
First Floor	-	Hallway	12-SMS-W186Hall-WCR	WC	<0.5	169
First Floor	W190	Classroom	13-SMS-W190-S	S	11.9	270
First Floor	S113	Classroom	14-SMS-S113-S	S	1.41	257
First Floor	S113	Classroom	15-SMS-S113-S	S	1.92	249
First Floor	S112	Classroom	16-SMS-S112-S	S	5.91	240
First Floor	-	Hallway	17-SMS-HallS112-DF	DF	1.12	309
First Floor	S111	Classroom	18-SMS-S111-S	S	2.1	289
First Floor	S111	Classroom	19-SMS-S111-S	S	59.7	271
First Floor	S110	Classroom	20-SMS-S110-S	S	1.81	330
First Floor	S110	Classroom	21-SMS-S110-S	S	1.65	364
First Floor	-	Hallway	22-SMS-HallS109-WC	WC	2.16	389
First Floor	S108	Classroom	23-SMS-S108-S	S	0.95	406
First Floor	S107	Classroom	24-SMS-S107-S	S	2.29	368
First Floor	S104	Classroom	25-SMS-S104-S	S	9.11	379
First Floor	157E	Classroom	26-SMS-157E-S	S	2.64	435
First Floor	-	Hallway	27-SMS-HallE129-WCL	WC	<0.5	355
First Floor	-	Hallway	28-SMS-HallE129-WCR	WC	<0.5	330
First Floor	-	Hallway	29-SMS-HallE129-BF	BF	<0.5	324
First Floor	-	Hallway	30-SMS-HallE142-S	S	7.58	260
First Floor	-	Hallway	31-SMS-HallE126-S	S	14.5	317
First Floor	-	Hallway	32-SMS-HallE124-S	S	6.57	475
First Floor	-	Hallway	33-SMS-HallE122-S	S	3.73	479
First Floor	-	Hallway	34-SMS-HallE120-S	S	2.81	487
First Floor	-	Office Kitchen	35-SMS-OfficeKit-S	S	5.8	383
First Floor	-	Office Kitchen	36-SMS-OfficeKit-WC	WC	<0.5	<0.5
First Floor	-	Nurse	37-SMS-Nurse-SL	S	1.88	353
First Floor	-	Nurse	38-SMS-Nurse-SR	S	<0.5	0.83
First Floor	-	Hallway	39-SMS-MediaHall-WCL	WC	<0.5	226
First Floor	-	Hallway	40-SMS-MediaHall-BF	BF	<0.5	233
First Floor	-	Hallway	41-SMS-MediaHall-WCR	WC	<0.5	232
First Floor	W181	Classroom	42-SMS-W181-S	S	3.98	492
First Floor	W180	Classroom	43-SMS-W180-S	S	12.5	280
First Floor	W180	Classroom	44-SMS-W180-S	S	9.94	433
First Floor	W180	Classroom	45-SMS-W180-S	S	4.1	593
First Floor	W180	Classroom	46-SMS-W180-S	S	61.6	376
First Floor	W180	Classroom	47-SMS-W180-S	S	24.3	212
First Floor	W180	Classroom	48-SMS-W180-S	S	7.79	407
First Floor	W180	Classroom	49-SMS-W180-S	S	6.59	528
Lower Level	-	Hallway	50-SMS-LLHall-WC	WC	<0.5	53.3
Lower Level	-	Hallway	51-SMS-LLHall-BF	BF	<0.5	56.4
Lower Level	-	Hallway	52-SMS-LLHall-WC	WC	1.84	654
Lower Level	-	Gym	53-SMS-Gym101L-WC	WC	0.98	286
Lower Level	-	Pool	54-SMS-Pool-WC	WC	<0.5	281
Lower Level	-	Pool	55-SMS-Pool-BF	BF	<0.5	282
Lower Level	-	Boys Locker Room	56-SMS-BoysLocker-WC	WC	<0.5	307
Lower Level	-	Girls Locker Room	57-SMS-GirlsLocker-WC	WC	<0.5	318



Stillwater Middle School  
 First Floor  
 Lead in Drinking Water  
 Project #23127

First Draw Sampling (2023)

- ◆ Lead  $\leq$  20 ppb
- ◆ Lead  $>$  20 ppb

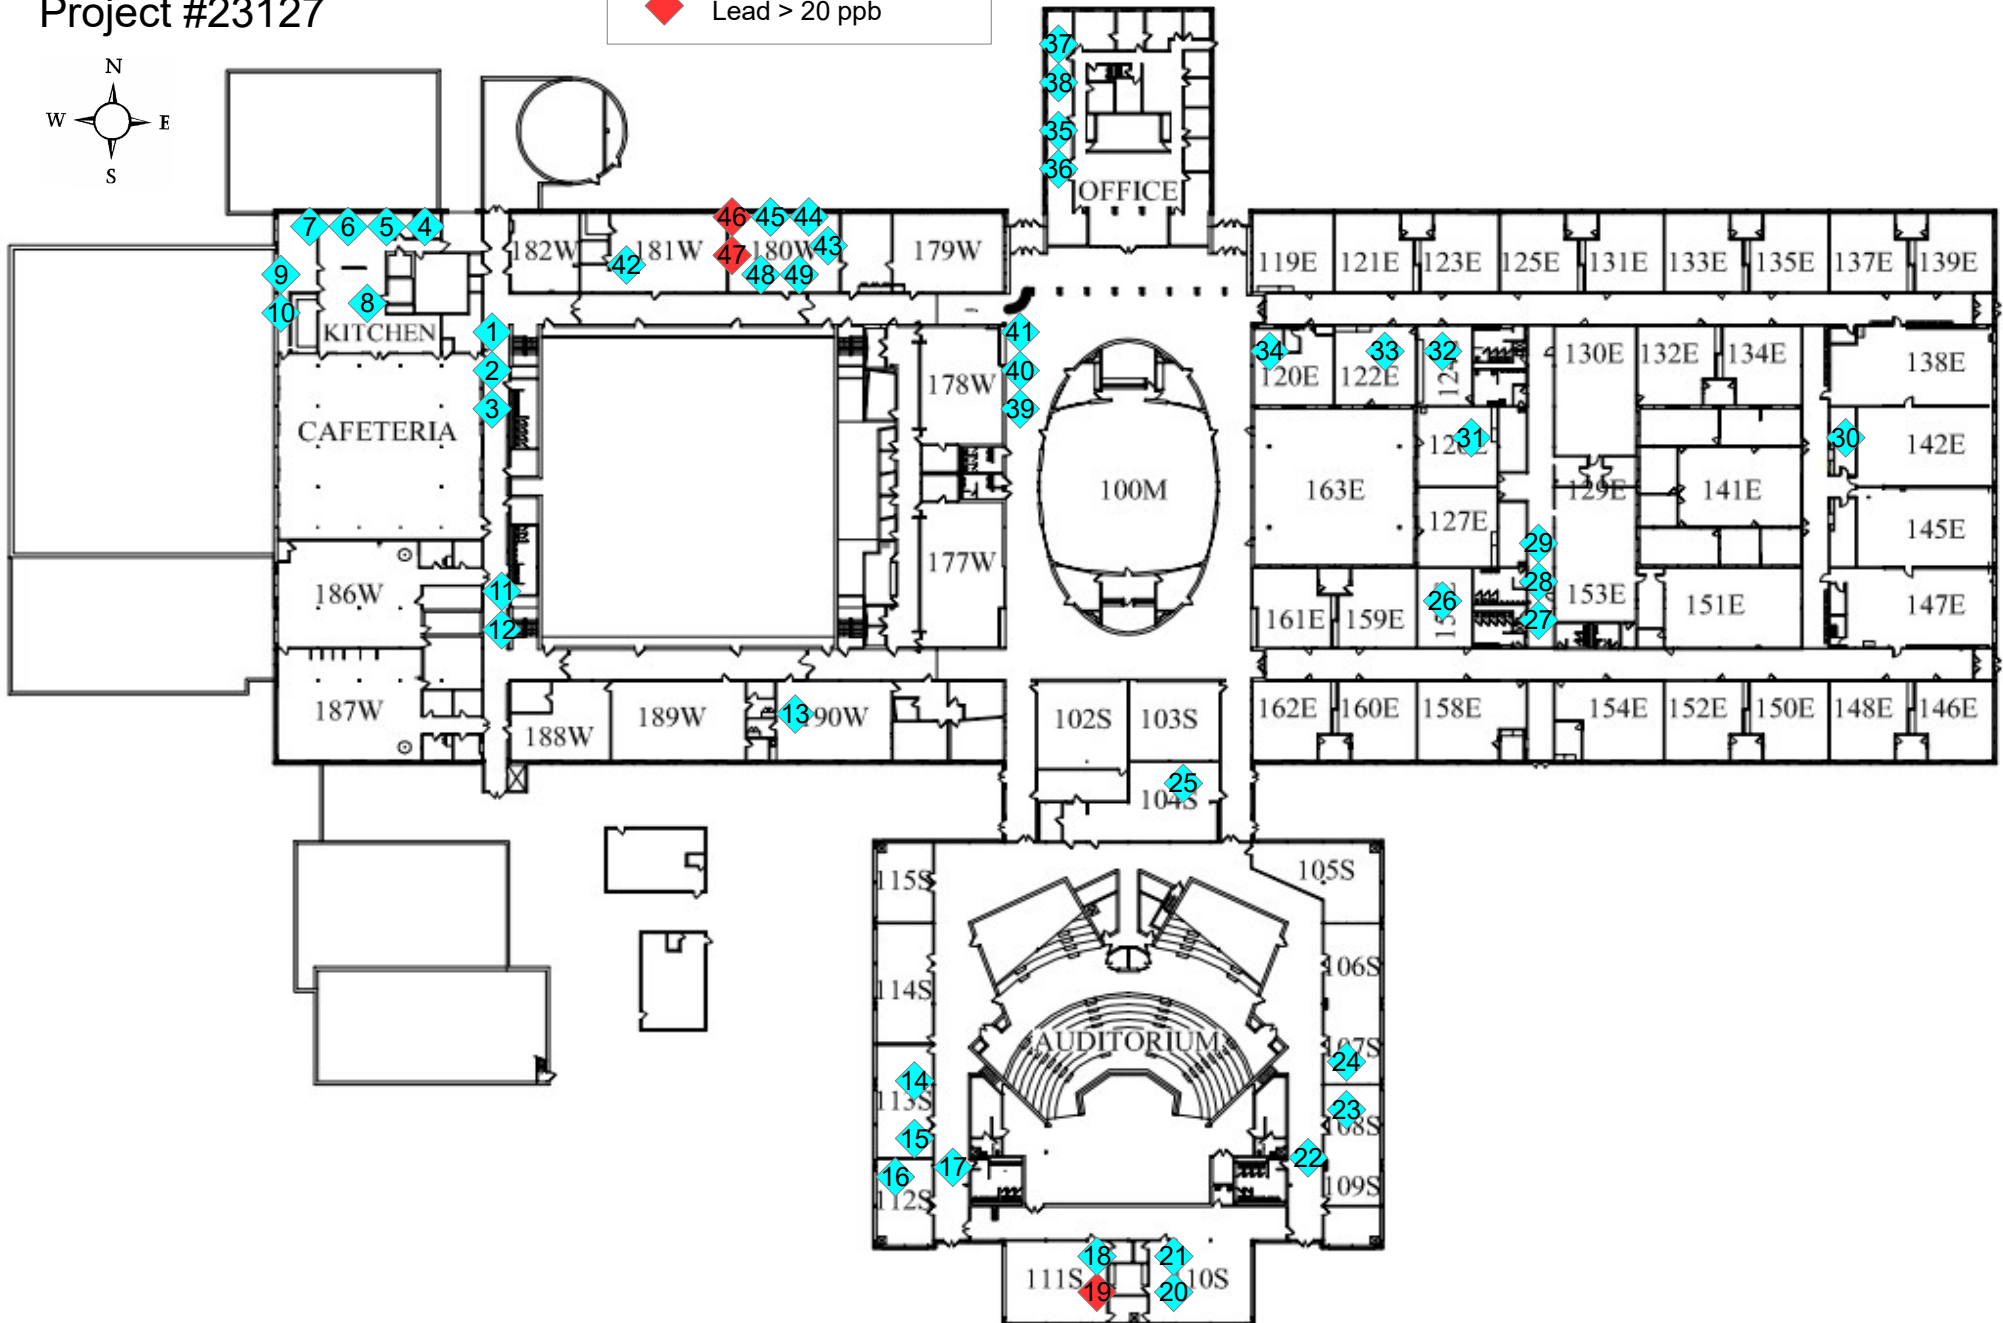

Stillwater Middle School  
Lower Level  
Lead in Drinking Water  
Project #23127

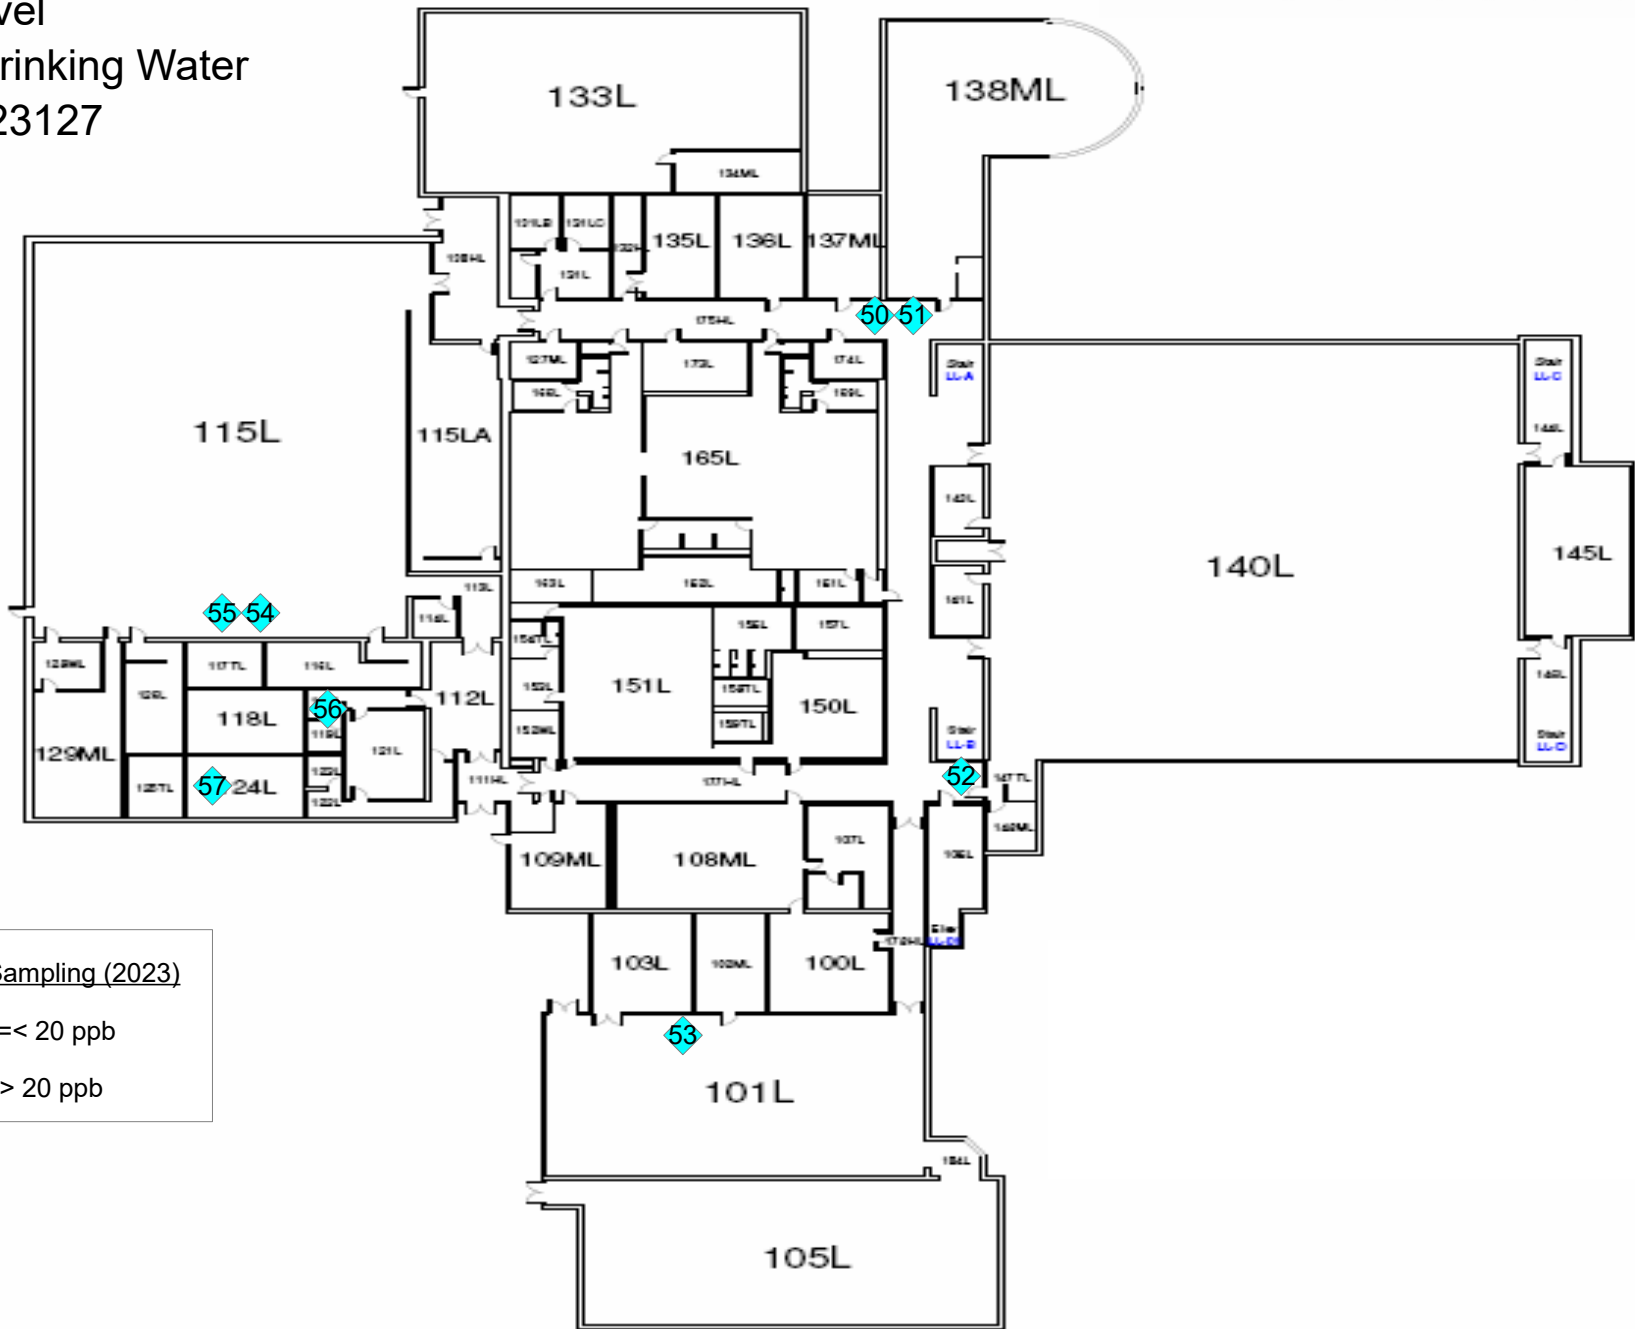

First Draw Sampling (2023)

- ◆ Lead  $\leq$  20 ppb
- ◆ Lead  $>$  20 ppb