

School Name: Stillwater Area High School (SAHS)

Date: 11/14/2023

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer Fridge = Fridge	Lead Result (ppb)	Copper Result (ppb)
First Floor	-	Kitchen	1-SAHS-Kit-S	S	1.47	409
First Floor	-	Kitchen	2-SAHS-Kit-SP	SP	1.91	360
First Floor	-	Kitchen	3-SAHS-Kit-S	S	30.2	366
First Floor	-	Kitchen	4-SAHS-Kit-K	K	15.2	792
First Floor	-	Kitchen	5-SAHS-Kit-SP	SP	1.35	503
First Floor	-	Kitchen	6-SAHS-Kit-S	S	1.48	397
First Floor	-	Kitchen	7-SAHS-Kit-S	S	2.19	463
First Floor	-	Kitchen	8-SAHS-Kit-S	S	4.25	651
First Floor	-	Kitchen	9-SAHS-Kit-SP	SP	1.24	571
First Floor	-	Kitchen	10-SAHS-Kit-SP	SP	<0.5	20.2
First Floor	-	Kitchen	11-SAHS-Kit-SP	SP	7.18	664
First Floor	-	Kitchen	12-SAHS-Kit-SP	SP	0.83	527
First Floor	-	Breakroom	13-SAHS-LR-S	S	6.59	501
First Floor	-	Cafeteria	14-SAHS-Café-WCR	WC	0.6	216
First Floor	-	Cafeteria	15-SAHS-Café-WCL	WC	0.98	341
First Floor	-	Kitchen	16-SAHS-Kit-SP	SP	1.56	510
First Floor	-	Kitchen	17-SAHS-Kit-SL	S	0.58	612
First Floor	-	Kitchen	18-SAHS-Kit-SR	S	1.81	461
First Floor	-	Kitchen	19-SAHS-Kit-S	S	1.28	522
First Floor	-	Hallway	20-SAHS-Hall-WCR	WC	0.92	141
First Floor	-	Hallway	21-SAHS-Hall-WCL	WC	0.65	94.7
First Floor	-	Hallway	22-SAHS-Hall-BF	BF	<0.5	76.4
First Floor	-	Hallway	23-SAHS-Hall-WCR	WC	<0.5	86.8
First Floor	-	Hallway	24-SAHS-Hall-WCL	WC	0.89	174
First Floor	E101	Classroom	25-SAHS-E101-S	S	8.55	486
First Floor	E121	Classroom	26-SAHS-E121-S	S	1.38	317
First Floor	-	Hallway	27-SAHS-Hall-BF	BF	<0.5	268
First Floor	-	Hallway	28-SAHS-Hall-WCL	WC	<0.5	274
First Floor	-	Hallway	29-SAHS-Hall-WCR	WC	<0.5	244
First Floor	-	Workroom	30-SAHS-WR-S	S	2.04	429
First Floor	D129	Classroom	31-SAHS-D129-S	S	5.22	249
First Floor	D109	Classroom	32-SAHS-D109-S	S	1.36	503
First Floor	D125	Classroom	33-SAHS-D125-SR	S	2.98	299
First Floor	D125	Classroom	34-SAHS-D125-SL	S	3.2	443
First Floor	D125	Classroom	35-SAHS-D125-S	S	0.52	441
First Floor	D103	Classroom	36-SAHS-D103-S	S	5.69	312
First Floor	D103	Classroom	37-SAHS-D103-Fridge	Fridge	0.77	85.9
First Floor	-	Copy Room	38-SAHS-Copy Room-S	S	3.84	643
First Floor	D100	Classroom	39-SAHS-D100-S	S	2.06	526
First Floor	D124	Classroom	40-SAHS-D124-S	S	1.71	500
First Floor	-	Hallway	41-SAHS-Hall-BF	BF	<0.5	57.3
First Floor	-	Hallway	42-SAHS-Hall-WCR	WC	<0.5	75.2
First Floor	-	Hallway	43-SAHS-Hall-WCL	WC	1.34	322
First Floor	C100	Classroom	44-SAHS-C100-S	S	1.47	298
First Floor	-	Hallway	45-SAHS-Hall-WCL	WC	2.05	376
First Floor	B108	Classroom	46-SAHS-B108-S	S	0.7	220
First Floor	-	Hallway	47-SAHS-Hall-WCL	WC	1.51	289
First Floor	-	Hallway	48-SAHS-Hall-WCR	WC	1.75	313
First Floor	-	Hallway	49-SAHS-Hall-WCL	WC	<0.5	72.6
First Floor	-	Hallway	50-SAHS-Hall-WCR	WC	1.16	388
First Floor	-	Hallway	51-SAHS-Hall-BF	BF	<0.5	65.1
First Floor	B113	Classroom	52-SAHS-B113-S	S	1.35	370
First Floor	B113	Classroom	53-SAHS-B113-BF	BF	<0.5	135
First Floor	B113	Classroom	54-SAHS-B113-WC	WC	<0.5	123
First Floor	B115	Classroom	55-SAHS-B115-BF	BF	1.6	163
First Floor	B115	Classroom	56-SAHS-B115-WC	WC	1.59	170
First Floor	B117	Classroom	57-SAHS-B117-S	S	3.13	379
First Floor	B117	Classroom	58-SAHS-B117-BF	BF	<0.5	97.3
First Floor	B117	Classroom	59-SAHS-B117-WC	WC	<0.5	111
First Floor	B120	Classroom	60-SAHS-B120-S	S	5.66	309
First Floor	-	Hallway	61-SAHS-Hall-BF	BF	<0.5	499
First Floor	-	Hallway	62-SAHS-Hall-WCL	WC	<0.5	453

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer Fridge = Fridge	Lead Result (ppb)	Copper Result (ppb)
First Floor	-	Hallway	63-SAHS-Hall-WCR	WC	<0.5	444
First Floor	-	Hallway	64-SAHS-Hall-BF	BF	1.28	77.1
First Floor	-	Hallway	65-SAHS-Hall-WCL	WC	<0.5	76.8
First Floor	-	Hallway	66-SAHS-Hall-WCR	WC	<0.5	72.8
Second Floor	-	Hallway	67-SAHS-Hall-BF	BF	<0.5	148
Second Floor	-	Hallway	68-SAHS-Hall-WCL	WC	<0.5	103
Second Floor	-	Hallway	69-SAHS-Hall-WCR	WC	<0.5	91.1
Second Floor	C217A	Classroom	70-SAHS-C217A-S	S	4.62	326
Second Floor	C217A	Classroom	71-SAHS-C217A-DF	DF	<0.5	1.74
Second Floor	-	Hallway	72-SAHS-Hall-WC	WC	1.38	179
Second Floor	-	Hallway	73-SAHS-Hall-WC	WC	0.8	142
Second Floor	-	Hallway	74-SAHS-Hall-BF	BF	<0.5	83.9
Second Floor	-	Hallway	75-SAHS-Hall-WC	WC	<0.5	99.2
Second Floor	D200	Classroom	76-SAHS-D200-S	S	6.75	430
Second Floor	-	Hallway	77-SAHS-Hall-BF	BF	<0.5	71.3
Second Floor	-	Hallway	78-SAHS-Hall-WC	WC	<0.5	74.1
Second Floor	-	Hallway	79-SAHS-Hall-BF	BF	<0.5	33.5
Second Floor	-	Hallway	80-SAHS-Hall-WC	WC	<0.5	33.2
Second Floor	-	Hallway	81-SAHS-Hall-WC	WC	1.56	154
Second Floor	E213	Classroom	82-SAHS-E213-S	S	4.01	310
Second Floor	-	Hallway	83-SAHS-Hall-BF	BF	<0.5	67.7
Second Floor	-	Hallway	84-SAHS-Hall-WCL	WC	<0.5	74.3
Second Floor	-	Hallway	85-SAHS-Hall-WCR	WC	<0.5	75
First Floor	-	Hallway	86-SAHS-Hall-BF	BF	<0.5	99.3
First Floor	-	Hallway	87-SAHS-Hall-WLC	WC	<0.5	115
First Floor	-	Hallway	88-SAHS-Hall-WCR	WC	0.75	240
First Floor	F100	Classroom	89-SAHS-F100-S	S	1.12	115
First Floor	F100	Classroom	90-SAHS-F100-DF	DF	<0.5	4.48
First Floor	-	Hallway	91-SAHS-Hall-BFL	BF	<0.5	106
First Floor	-	Hallway	92-SAHS-Hall-WCL	WC	<0.5	130
First Floor	-	Hallway	93-SAHS-Hall-WCR	WC	<0.5	231
First Floor	-	Hallway	94-SAHS-Hall-WCL	WC	<0.5	216
First Floor	-	Hallway	95-SAHS-Hall-BFR	BF	<0.5	215
First Floor	-	Hallway	96-SAHS-Hall-WCR	WC	<0.5	216
First Floor	G111	Classroom	97-SAHS-G111-WC	WC	2.47	281
First Floor	G109	Classroom	98-SAHS-G109-WC	WC	3.29	292
First Floor	G107	Classroom	99-SAHS-G107-WC	WC	3.09	299
First Floor	G113	Classroom	100-SAHS-G113-S	S	<0.5	83.9
First Floor	G117	Classroom	101-SAHS-G117-S	S	0.89	636
First Floor	G117	Classroom	102-SAHS-G117-SP	SP	<0.5	388
First Floor	G117	Classroom	103-SAHS-G117-BF	BF	0.65	460
Second Floor	-	Track	104-SAHS-Track-BF	BF	<0.5	602
Second Floor	-	Track	105-SAHS-Track-WCL	WC	<0.5	386
Second Floor	-	Track	106-SAHS-Track-WCR	WC	<0.5	379
First Floor	G119	Classroom	107-SAHS-G119-BF	BF	<0.5	349
First Floor	G119	Classroom	108-SAHS-G119-WCL	WC	<0.5	320
First Floor	G119	Classroom	109-SAHS-G119-WCR	WC	<0.5	286
First Floor	-	Concessions	110-SAHS-Concession-S	S	0.71	598
First Floor	-	Concessions	111-SAHS-Con-SP	SP	0.52	301
First Floor	-	Concessions	112-SAHS-Con-S	S	0.77	383
First Floor	-	Concessions	113-SAHS-Con-S	S	0.5	184
First Floor	-	Gym	114-SAHS-Gym-BF	BF	<0.5	253
First Floor	-	Gym	115-SAHS-Gym-WCL	WC	<0.5	263
First Floor	-	Gym	116-SAHS-Gym-WCR	WC	<0.5	259
First Floor	-	Gym	117-SAHS-Gym-WCL	WC	<0.5	221
First Floor	-	Gym	118-SAHS-Gym-WCR	WC	<0.5	223
First Floor	-	Gym	119-SAHS-Gym RR Girls-WCL	WC	<0.5	292
First Floor	-	Gym RR Girls	120-SAHS-GymRRGirls-BF	BF	<0.5	302
First Floor	-	Gym RR Girls	121-SAHS-GymRRGirls-WCR	WC	<0.5	289
First Floor	-	Gym RR Boys	122-SAHS-GymRRBoys-WCL	WC	<0.5	275
First Floor	-	Gym RR Boys	123-SAHS-GymRRBoys-BF	BF	<0.5	283
First Floor	-	Gym RR Boys	124-SAHS-GymRRBoys-WCR	WC	<0.5	287
Second Floor	-	Weight Room	125-SAHS-WtRM-WCL	WC	<0.5	284
Second Floor	-	Weight Room	126-SAHS-WtRM-BF	BF	<0.5	301
Second Floor	-	Weight Room	127-SAHS-WtRM-WCR	WC	<0.5	299


Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer      Fridge = Fridge	Lead Result (ppb)	Copper Result (ppb)
Second Floor	-	Cardio	128-SAHS-Cardio-WCL	WC	<0.5	302
Second Floor	-	Cardio	129-SAHS-Cardio-BF	BF	<0.5	318
Second Floor	-	Cardio	130-SAHS-Cardio-WCR	WC	<0.5	309



Stillwater Area High School  
 Second Floor  
 Lead in Drinking Water  
 Project #23127

First Draw Sampling (2023)

- ◆ Lead ≤ 20 ppb
- ◆ Lead > 20 ppb

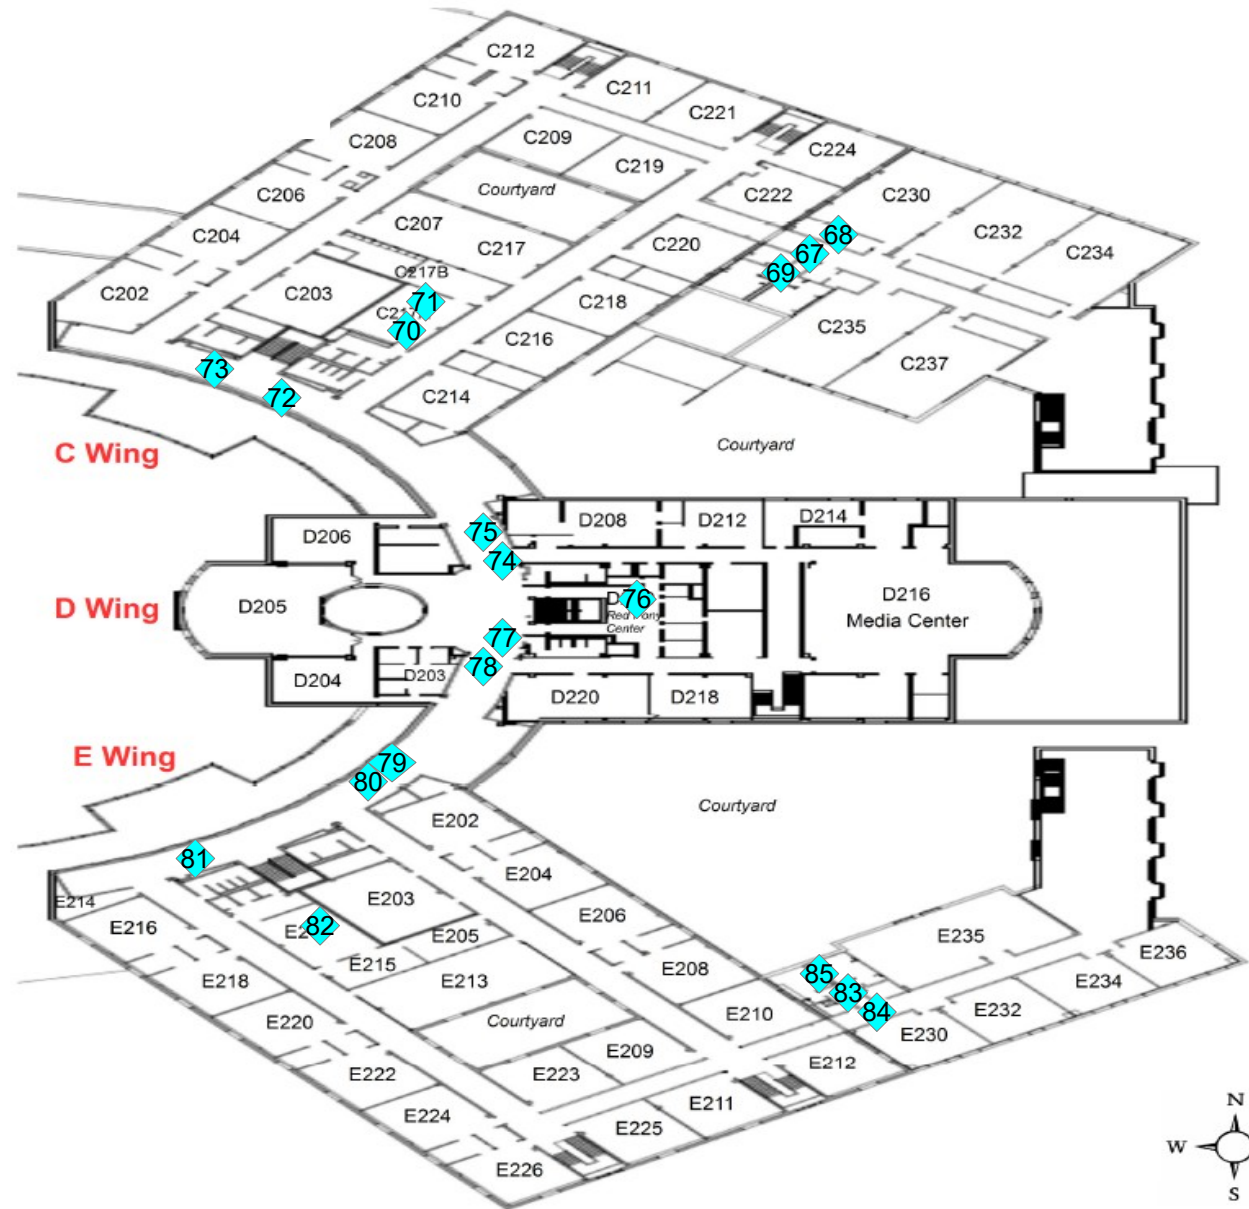

Stillwater Area High School  
Second Floor: Pony Activity Center  
Lead in Drinking Water  
Project #23127



First Draw Sampling (2023)

- ◆ Lead  $\leq$  20 ppb
- ◆ Lead  $>$  20 ppb

