



181 US Hwy 46
Mine Hill, NJ 07803
(908) 654-8068
(800) 783-0567
Fax 908-654-8069

LEAD IN DRINKING WATER REPORT

Performed At:

Mercer County Technical Schools
Trenton, NJ

Performed For:

Mercer County Technical Schools
1085 Old Trenton Road
Trenton, NJ, 08690

Prepared By:

LEW Environmental Services, LLC.
181 US Hwy 46
Mine Hill, NJ 07803

Phone (908) 654-8068
Fax (908) 654-8069
Website <http://www.LEWCorp.com>

Inspection Date: 09/29/2024
Project Number: 2324

Table of Contents

Contact Information	3
Introduction	4
Sampling Methodology	4
Drinking Water Results	5
Recommendations	5
Additional Recommendations	6

Appendices

Appendix A	Exceedances
Appendix B	Recommendations
Appendix C	All results
Appendix D	Floor Plan(S)
Appendix E	Laboratory Data

Contact Information

Education Agency

Client Contact:	Joey Cruz
Client Name:	Mercer County Technical Schools
Street Address	1085 Old Trenton Road, Trenton, NJ, 08690
Phone Number:	609.586.5144 ext 9680

Sampler(s)

Site Assessor(s):	Erick Ulloa
Signature:	
Date:	October 25, 2024

Firm

Organization:	LEW Environmental Services, LLC.
Certification #:	NJDCA 00015 E
Street:	181 US Hwy 46
City, State & Zip:	Mine Hill, NJ 07803
Phone Number:	908-654-8068
Web Address:	http://www.lewcorp.com

Laboratory

Organization:	Environmental Hazard Services, LLC
Street:	7469 Whitepine Road
City, State & Zip:	Richmond, VA 23237
NJDEP Certification #	VA008
Phone Number:	800-347-4010

Introduction

LEW Environmental Services, LLC. was contracted by Mercer County Technical Schools to test for the presence of lead in drinking water in two schools in the district.

Sampling Methodology

LEW Environmental Services, LLC. followed NJAC 6A:26. Full details on sampling practices can be found in Districts Sampling Plan.

All samples were collected in 250mL wide mouth plastic containers that was prepackaged by the analytical laboratory. The sample containers may contain nitric acid, if expedited analysis is required. If not, nitric acid will be added to each sample upon arrival at the laboratory. At each sample location, the first draw sample was taken after it was determined that the water had been standing in the plumbing system for greater than eight hours but less than forty-eight hours. If second draw samples were collected, they were collecting following a flushing protocol outlined in the District's Sampling Plan.

Drinking Water Results

On September 29, 2024, LEW Environmental Services, LLC. collected the following number of water samples:

Assunpink Center Campus

- 11 first draw samples collected
- 0 samples above the 15ppb action level

Sypek

- 32 first draw samples
- 2 samples above the 15ppb action level

The complete list of samples that exceeded the 15ppb limit can be found in Appendix A. The complete list of all sample results can be found in Appendix C. The laboratory results can be found in Appendix E.

Certain outlets could not or were not tested due to various reasons. The following table lists those locations and the reason why samples were not collected.

School	Sample Location	Reason for not testing.
Sypek	HALLWAY, SYP-A-4-DF-Hall	Not Operating
Sypek	C131-CA Kitchen, SYP-C-14-CM-C131	Not Operating
Sypek	C131-CA Kitchen, SYP-C-15-S-C131	Not Operating
Assunpink	Hallway, ASP-A-1a-DF-Hall	Not Operating
Assunpink	Hallway, ASP-A-2a-DF-Hall	Not Operating

Recommendations

Those outlets where the first draw sample tested below 15ppb are not considered to be elevated and no mitigation is necessary.

For those outlets where the first draw sample exceeds 15ppb the following steps are recommended:

- 1) Immediately discontinue use of the outlets.
- 2) Conduct second draw (flush) samples on these outlets to further delineate source of contamination.

A complete list of recommendations per outlet can be found in Appendix B.

Additional Recommendations

- 1) Follow-up samples should be collected after any remediation efforts in order to determine the efficacy of the work.
- 2) Any of the inoperable/non-functioning outlets listed above that are brought back into service should be sample.
- 3) Comply with all requirements set forth in NJAC 6A:26.

Appendix A Exceedances

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
SYPEK CENTER	09/29/2024	10/08/2024	SYP-C-2-CM-C144	C144 COFFEE MACHINE	75.4
SYPEK CENTER	09/29/2024	10/08/2024	SYP-C-11-STM-C131	C131 STEAMER	3890

Appendix B Recommendations

Building	Location	Remediation Recommendation
SYPEK CENTER	C144 COFFEE MACHINE	Discontinue use and perform second draw
SYPEK CENTER	C131 STEAMER	Discontinue use and perform second draw


Appendix C All Results

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
SYPEK CENTER	09/29/2024	10/07/2024	SYP-A-4-DF-HALL	HALLWAY DRINKING FOUNTAIN	1.70
SYPEK CENTER	09/29/2024	10/07/2024	SYP-A-2-DF	MAIN OFFICE DRINKING FOUNTAIN	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-A-1-BF	MAIN OFFICE BOTTLE FILLER	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-A-3-S	MAIN OFFICE KITCHEN SINK	5.72
SYPEK CENTER	09/29/2024	10/07/2024	SYP-A-6-S	FACULTY LOUNGE SINK	4.49
SYPEK CENTER	09/29/2024	10/07/2024	SYP-B-1-DF-B100	B100 DRINKING FOUNTAIN	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-B-2-DF-B110	B110 DRINKING FOUNTAIN	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-B-3-DF-B120	B120 DRINKING FOUNTAIN	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-B-6-DF-B144	B144 DRINKING FOUNTAIN	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-B-7-DF-B154	B154 DRINKING FOUNTAIN	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-B-5-DF-B132	B132 DRINKING FOUNTAIN	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-B-4-DF-B160	B160 DRINKING FOUNTAIN	<1.00
SYPEK CENTER	09/29/2024	10/08/2024	SYP-D-1-IM-D101	D101 ICE MAKER	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-D-2-S-D101	D101 SINK	<1.00
SYPEK CENTER	09/29/2024	10/08/2024	SYP-D-3-S-D101	D101 SINK	7.34
SYPEK CENTER	09/29/2024	10/07/2024	SYP-D-4-S-D101	D101 SINK	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-D-5-S-D101	D101 SINK	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-D-6-BF	HALL BOTTLE FILLER	1.12
SYPEK CENTER	09/29/2024	10/07/2024	SYP-D-7-DF	HALL DRINKING FOUNTAIN	2.43
SYPEK CENTER	09/29/2024	10/07/2024	SYP-C-1-S-C144	C144 SINK	<1.00
SYPEK CENTER	09/29/2024	10/08/2024	SYP-C-2-CM-C144	C144 COFFEE MACHINE	75.4
SYPEK CENTER	09/29/2024	10/07/2024	SYP-C-3-BF-HALL	HALL ACROSS C110 BOTTLE FILLER	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-C-4-DF-HALL	HALL ACROSS C110 DRINKING FOUNTAIN	<1.00
SYPEK CENTER	09/29/2024	10/07/2024	SYP-C-5-S-C131	C131 SINK	1.02
SYPEK CENTER	09/29/2024	10/07/2024	SYP-C-6-S-C131	C131 SINK	<1.00
SYPEK CENTER	09/29/2024	10/08/2024	SYP-C-7-K-C131	C131 KETTLE	10.8
SYPEK CENTER	09/29/2024	10/08/2024	SYP-C-8-K-C131	C131 KETTLE	9.22
SYPEK CENTER	09/29/2024	10/07/2024	SYP-C-9-S-C131	C131 SINK	2.28
SYPEK CENTER	09/29/2024	10/07/2024	SYP-C-10-S-C131	C131 SINK	<1.00
SYPEK CENTER	09/29/2024	10/08/2024	SYP-C-11-STM-C131	C131 STEAMER	3890
SYPEK CENTER	09/29/2024	10/08/2024	SYP-C-12-S-C131	C131 SINK	12.9
SYPEK CENTER	09/29/2024	10/07/2024	SYP-C-13IM-C131	C131 ICE MAKER	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-A-2-BF-HALL	HALLWAY BOTTLE FILLER	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-A-1-BF-HALL	HALLWAY BOTTLE FILLER	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-A-3-DF	ACROSS A170 DRINKING FOUNTAIN	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-B-1-DF-B108	B108 DRINKING FOUNTAIN	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-B-2-DF-B109	B109 DRINKING FOUNTAIN	1.20
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-B-3-DF-B131	B131 DRINKING FOUNTAIN	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-B-4-DF-B130	B130 DRINKING FOUNTAIN	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-C-1-DF	NEAR C108 DRINKING FOUNTAIN	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-C-2-DF	PLUMBING DRINKING FOUNTAIN	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-C-3-DF	CHRYSLER DRINKING FOUNTAIN	<1.00
ASSUNPINK CENTER	09/29/2024	10/05/2024	ASP-C-4-DF-C127	C127 DRINKING FOUNTAIN	<1.00


Appendix D Floor Plan(s)

Assunpink Center Campus Map


C Building

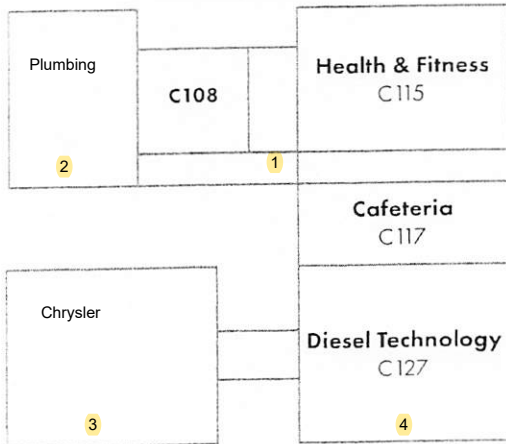


Exit

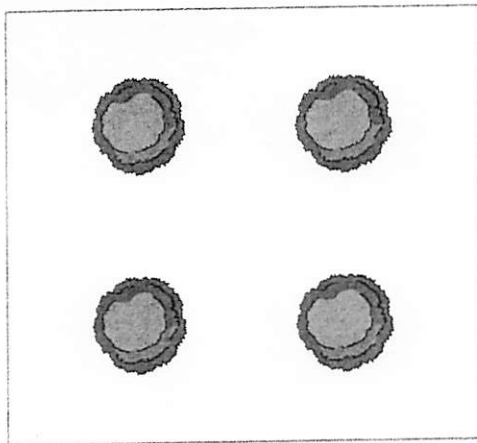


B Building

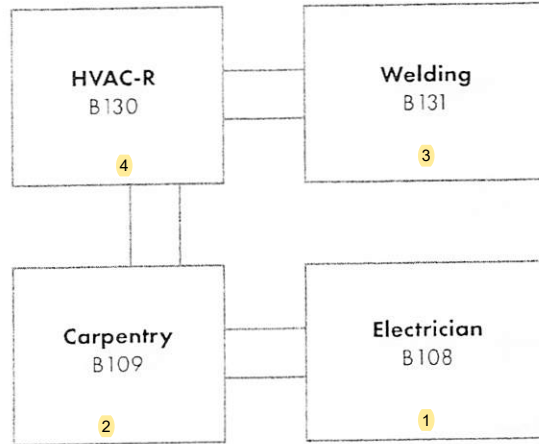

Parking

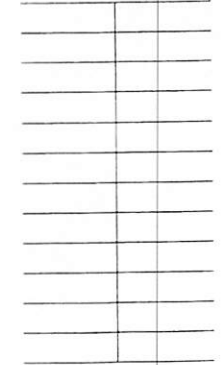

A Building

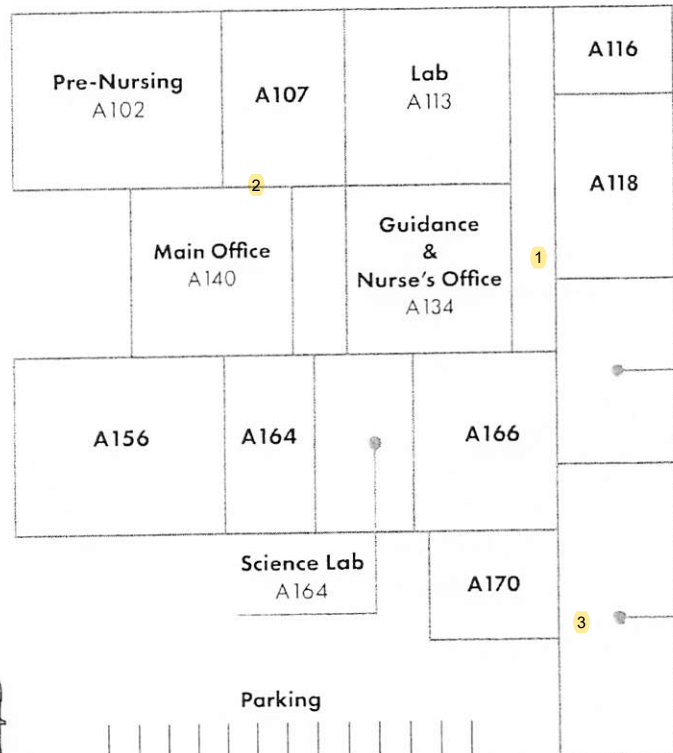

Entrance

Parking




1085 Old Trenton Road
Trenton, NJ 08690
609-586-5144

www.mcts.edu



Arthur R. Sypek Center Campus Map

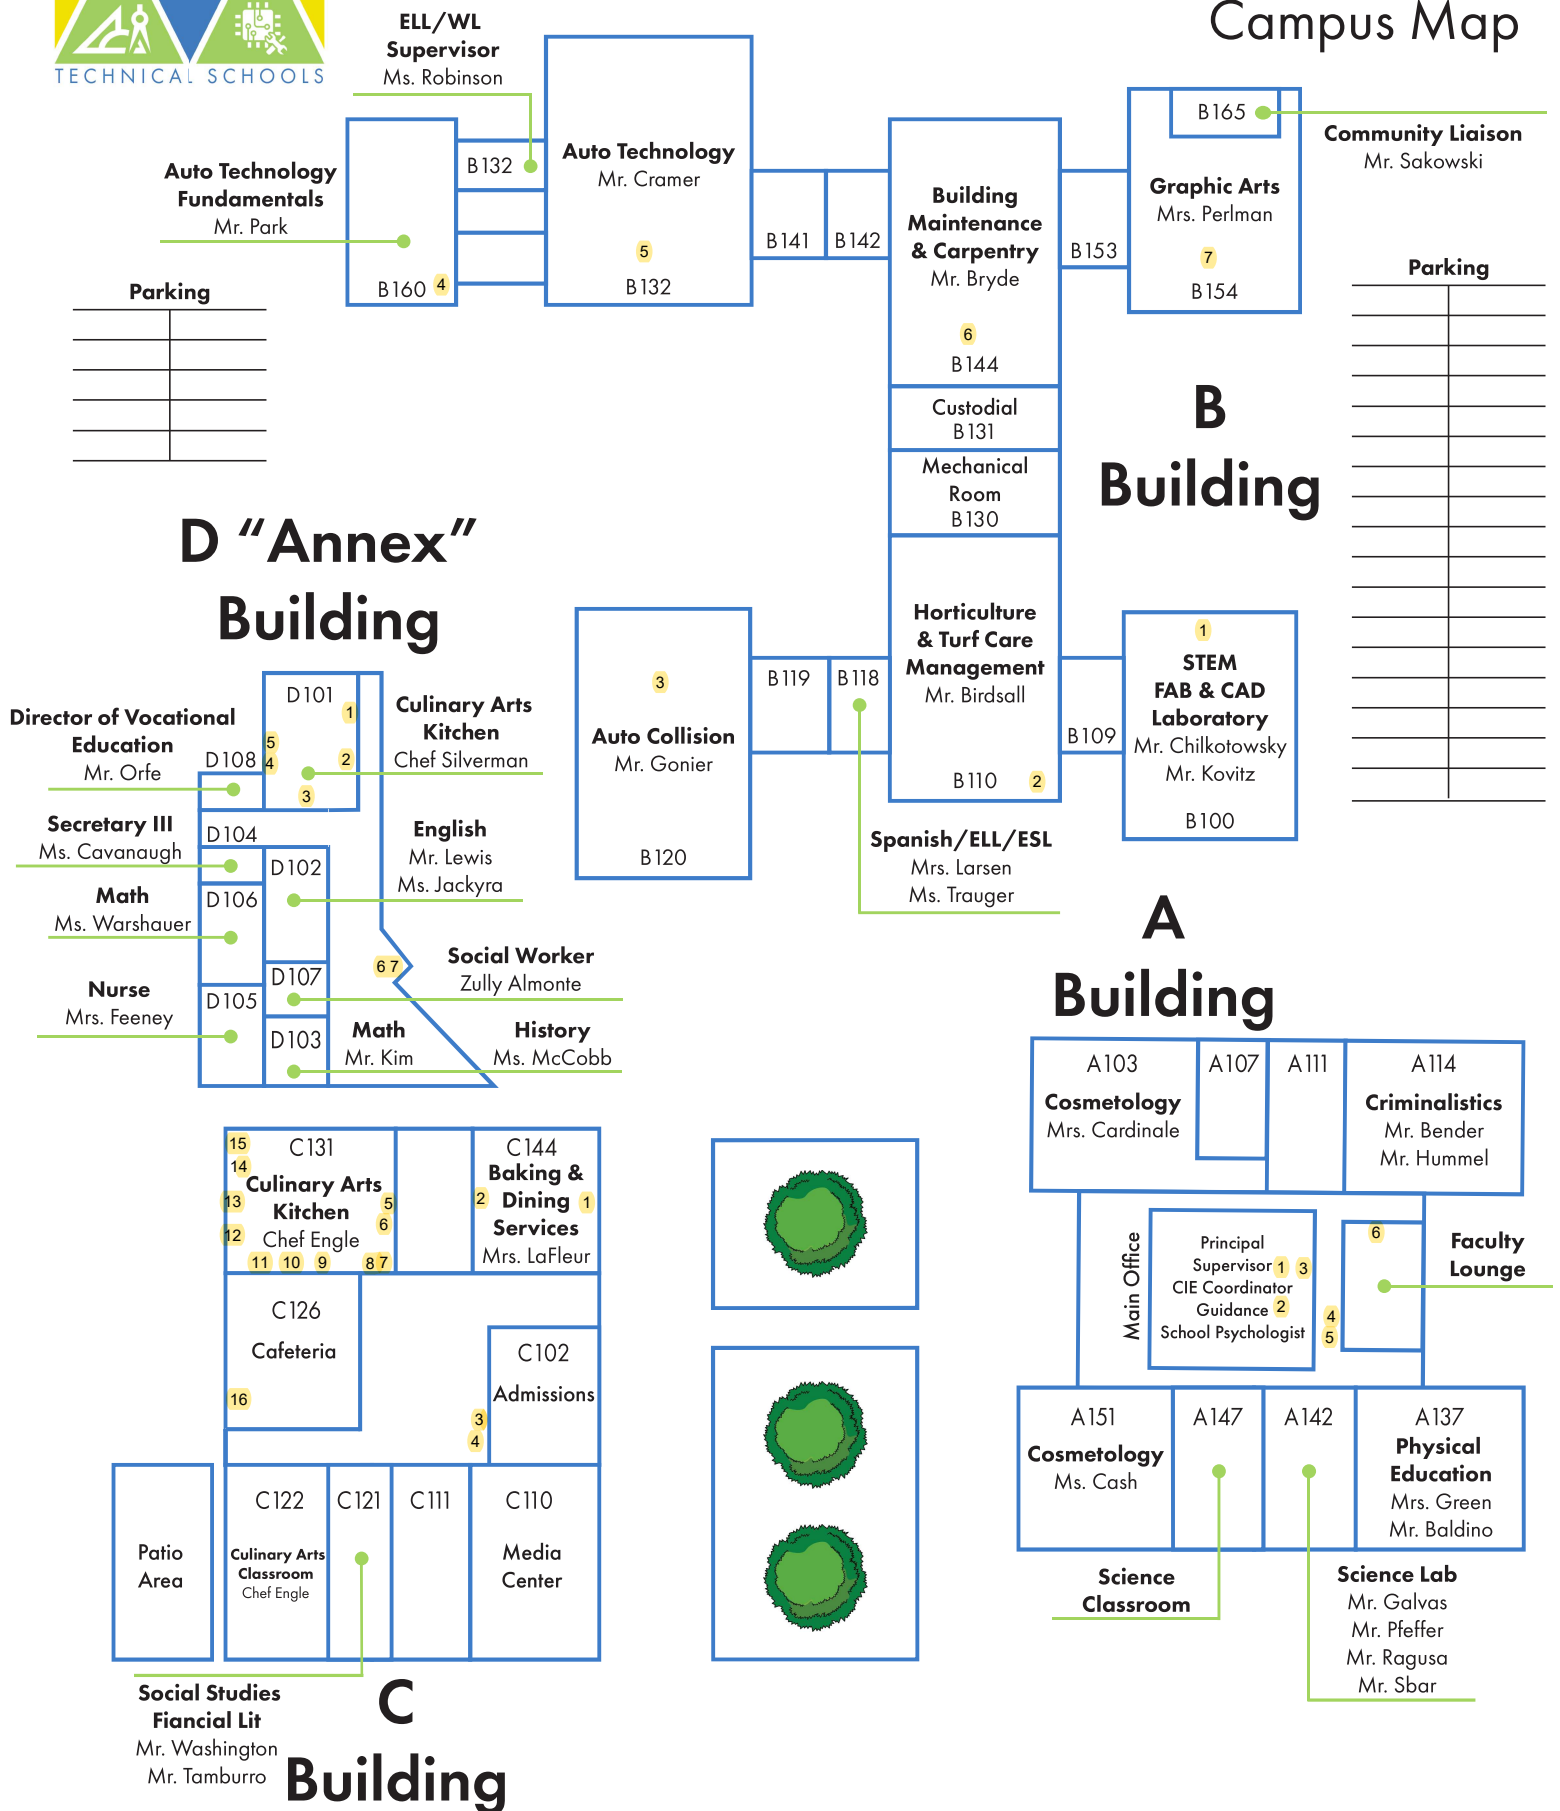

Appendix E Laboratory Data



7469 Whitepine Rd
North Chesterfield, VA 23237
Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Client: LEW Corp
181 US Hwy 46
Mine Hill, NJ 07803

Report Number: 24-10-00464

Received Date: 10/02/2024
Reported Date: 10/09/2024
Sampled By: Erick Ulloa
Tech Certification #:

Project/Test Address: 2324; 129 Bull Run Road; Pennington, NJ 08534

Client Number:
201327

Laboratory Results

Fax Number:
Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
24-10-00464-001	SYP-A-4-DF-HALL	09/29/2024	HALLWAY DRINKING FOUNTAIN	1.70	10/07/2024	
24-10-00464-002	SYP-A-2-DF	09/29/2024	MAIN OFFICE DRINKING FOUNTAIN	<1.00	10/07/2024	
24-10-00464-003	SYP-A-1-BF	09/29/2024	MAIN OFFICE BOTTLE FILLER	<1.00	10/07/2024	
24-10-00464-004	SYP-A-3-S	09/29/2024	MAIN OFFICE KITCHEN SINK	5.72	10/07/2024	
24-10-00464-005	SYP-A-6-S	09/29/2024	FACULTY LOUNGE SINK	4.49	10/07/2024	
24-10-00464-006	SYP-B-1-DF-B100	09/29/2024	B100 DRINKING FOUNTAIN	<1.00	10/07/2024	
24-10-00464-007	SYP-B-2-DF-B110	09/29/2024	B110 DRINKING FOUNTAIN	<1.00	10/07/2024	
24-10-00464-008	SYP-B-3-DF-B120	09/29/2024	B120 DRINKING FOUNTAIN	<1.00	10/07/2024	
24-10-00464-009	SYP-B-6-DF-B144	09/29/2024	B144 DRINKING FOUNTAIN	<1.00	10/07/2024	
24-10-00464-010	SYP-B-7-DF-B154	09/29/2024	B154 DRINKING FOUNTAIN	<1.00	10/07/2024	
24-10-00464-011	SYP-B-5-DF-B132	09/29/2024	B132 DRINKING FOUNTAIN	<1.00	10/07/2024	
24-10-00464-012	SYP-B-4-DF-B160	09/29/2024	B160 DRINKING FOUNTAIN	<1.00	10/07/2024	
24-10-00464-013	SYP-D-1-IM-D101	09/29/2024	D101 ICE MAKER	<1.00	10/08/2024	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 24-10-00464

Project/Test Address: 2324; 129 Bull Run Road; Pennington, NJ 08534

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
24-10-00464-014	SYP-D-2-S-D101	09/29/2024	D101 SINK	<1.00	10/07/2024	
24-10-00464-015	SYP-D-3-S-D101	09/29/2024	D101 SINK	7.34	10/08/2024	
24-10-00464-016	SYP-D-4-S-D101	09/29/2024	D101 SINK	<1.00	10/07/2024	
24-10-00464-017	SYP-D-5-S-D101	09/29/2024	D101 SINK	<1.00	10/07/2024	
24-10-00464-018	SYP-D-6-BF	09/29/2024	HALL BOTTLE FILLER	1.12	10/07/2024	
24-10-00464-019	SYP-D-7-DF	09/29/2024	HALL DRINKING FOUNTAIN	2.43	10/07/2024	
24-10-00464-020	SYP-C-1-S-C144	09/29/2024	C144 SINK	<1.00	10/07/2024	
24-10-00464-021	SYP-C-2-CM-C144	09/29/2024	C144 COFFEE MACHINE	75.4	10/08/2024	
24-10-00464-022	SYP-C-3-BF-HALL	09/29/2024	HALL ACROSS C110 BOTTLE FILLER	<1.00	10/07/2024	
24-10-00464-023	SYP-C-4-DF-HALL	09/29/2024	HALL ACROSS C110 DRINKING FOUNTAIN	<1.00	10/07/2024	
24-10-00464-024	SYP-C-5-S-C131	09/29/2024	C131 SINK	1.02	10/07/2024	
24-10-00464-025	SYP-C-6-S-C131	09/29/2024	C131 SINK	<1.00	10/07/2024	
24-10-00464-026	SYP-C-7-K-C131	09/29/2024	C131 KETTLE	10.8	10/08/2024	
24-10-00464-027	SYP-C-8-K-C131	09/29/2024	C131 KETTLE	9.22	10/08/2024	
24-10-00464-028	SYP-C-9-S-C131	09/29/2024	C131 SINK	2.28	10/07/2024	
24-10-00464-029	SYP-C-10-S-C131	09/29/2024	C131 SINK	<1.00	10/07/2024	
24-10-00464-030	SYP-C-11-STM-C131	09/29/2024	C131 STEAMER	3890	10/08/2024	
24-10-00464-031	SYP-C-12-S-C131	09/29/2024	C131 SINK	12.9	10/08/2024	
24-10-00464-032	SYP-C-13IM-C131	09/29/2024	C131 ICE MAKER	<1.00	10/07/2024	
24-10-00464-033	SYP-SUNROOM	09/29/2024	SUNROOM	<1.00	10/07/2024	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 24-10-00464

Project/Test Address: 2324; 129 Bull Run Road; Pennington, NJ 08534

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
----------------------	---------------------	--------------------	---------------------	-----------------------------	------------------	-----------------

Method: EPA 200.8

Analyst: Nicole Lyle

Accreditation #: NJ VA008

Reviewed By Authorized Signatory:



Tasha Eaddy

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion

**ENVIRONMENTAL HAZARDS SERVICES, LLC****WaterSmart® Lead Chain-of-Custody Form**

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907

www.leadlab.com

24-10-00464



Due Date:

10/09/2024

(Wednesday)

AE

10+

AD

Client Name: LEW CORP Account #: 201327Address: 181 US HIGHWAY 46City/State/Zip: MINE HILL, NJ 07803Phone: 908-654-8068Email Address: labresults@lewcorp.comProject Name/ Number: 2324Collection Address: 129 BULL RUN ROAD
(Required)City/State/Zip: PENNINGTON, NJ 08534
(Required)Approx. Age Of Property: _____ Collected By: ERICK ULLOAWater Source: (Check One) Public ☒ or Well _____

Well Tag # (if applicable): _____

Turn-Around Time

☒

5 Days

☐ 3 Days☐ 2 Days☐ 1 Day

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
1	SYP-A-4-DF-HALL	HALLWAY, DRINKING FOUNTAIN	09/29/2024	AM / PM	X	
2	SYP-A-2-DF	MAIN OFFICE, DRINKING FOUNTAIN		AM / PM	X	
3	SYP-A-1-BF	MAIN OFFICE, BOTTLE FILLER		AM / PM	X	
4	SYP-A-3-S	MAIN OFFICE KITCHEN, SINK		AM / PM	X	
5	SYP-A-6-S	FACULTY LOUNGE, SINK		AM / PM	X	
6	SYP-B-1-DF-B100	B100, DRINKING FOUNTAIN		AM / PM	X	
7	SYP-B-2-DF-B110	B110, DRINKING FOUNTAIN		AM / PM	X	
8	SYP-B-3-DF-B120	B120, DRINKING FOUNTAIN		AM / PM	X	
9	SYP-B-6-DF-B144	B144, DRINKING FOUNTAIN		AM / PM	X	
10	SYP-B-7-DF-B154	B154, DRINKING FOUNTAIN		AM / PM	X	
11	SYP-B-5-DF-B132	B132, DRINKING FOUNTAIN		AM / PM	X	
12	SYP-B-4-DF-B160	B160, DRINKING FOUNTAIN		AM / PM	X	
13	SYP-D-1-M-D101	D101, ICE MAKER		AM / PM	X	
14	SYP-D-2-S-D101	D101, SINK		AM / PM	X	
15	SYP-D-3-S-D101	D101, SINK		AM / PM	X	

Released by: ERICK ULLOA

Signature:

Date/Time: 09/30/2024Received by: ELIPISTINAS

Signature:

Date/Time: 10/2/24 103pm

Client Name: **LEW CORP** Account # **201327** Page **2** of **2**

Project Name: **2324**

Lab I.D. #: **0469**


No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
16	SYP-D-4-S-D101	D101, SINK	09/29/2024	AM / PM	X	
17	SYP-D-5-S-D101	D101, SINK		AM / PM	X	
18	SYP-D-6-BF	HALL, BOTTLE FILLER		AM / PM	X	
19	SYP-D-7-DF	HALL, DRINKING FOUNTAIN		AM / PM	X	
20	SYP-C-1-S-C144	C144, SINK		AM / PM	X	
21	SYP-C-2-CM-C144	C144, COFFEE MACHINE		AM / PM	X	
22	SYP-C-3-BF-HALL	HALL ACROSS C110, BOTTLE FILLER		AM / PM	X	
23	SYP-C-4-DF-HALL	HALL ACROSS C110, DRINKING FOUNTAIN		AM / PM	X	
24	SYP-C-5-S-C131	C131, SINK		AM / PM	X	
25	SYP-C-6-S-C131	C131, SINK		AM / PM	X	
26	SYP-C-7-K-C131	C131, KETTLE		AM / PM	X	
27	SYP-C-8-K-C131	C131, KETTLE		AM / PM	X	
28	SYP-C-9-S-C131	C131, SINK		AM / PM	X	
29	SYP-C-10-S-C131	C131, SINK		AM / PM	X	
30	SYP-C-11-STM-C131	C131, STEAMER		AM / PM	X	
31	SYP-C-12-S-C131	C131, SINK		AM / PM	X	
32	SYP-C-13-IM-C131	C131, ICE MAKER		AM / PM	X	
33	SYP-C-16-S-C126	C126, SINK <i>*sample not received</i>	<i>8cc 10/2</i>	AM / PM	X	
34	SYP-SUNROOM	Sunroom		AM / PM	X	
35				AM / PM	X	
36				AM / PM	X	
37				AM / PM	X	
38				AM / PM	X	
39				AM / PM	X	
40				AM / PM	X	
41				AM / PM	X	
42				AM / PM		
43				AM / PM		
44				AM / PM		
45				AM / PM		
46				AM / PM		
47				AM / PM		
48				AM / PM		
49				AM / PM		
50				AM / PM		

Released by: **ERICK ULLOA**

Signature: 

Date/Time: **09/30/2024**

Received by: **EL CHRISTMAS**

Signature: 

Date/Time: **10/2/24 103pm**



7469 Whitepine Rd
North Chesterfield, VA 23237
Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Client: LEW Corp
181 US Hwy 46
Mine Hill, NJ 07803

Report Number: 24-10-00459

Received Date: 10/02/2024
Reported Date: 10/07/2024
Sampled By: Erick Ulloa
Tech Certification #:

Project/Test Address: 2324; 1085 Old Trenton Rd; Trenton, NJ 08690

Client Number:
201327

Laboratory Results

Fax Number:
Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
24-10-00459-001	ASP-A-2-BF-HALL	09/29/2024	HALLWAY BOTTLE FILLER	<1.00	10/05/2024	
24-10-00459-002	ASP-A-1-BF-HALL	09/29/2024	HALLWAY BOTTLE FILLER	<1.00	10/05/2024	
24-10-00459-003	ASP-A-3-DF	09/29/2024	ACROSS A170 DRINKING FOUNTAIN	<1.00	10/05/2024	
24-10-00459-004	ASP-B-1-DF-B108	09/29/2024	B108 DRINKING FOUNTAIN	<1.00	10/05/2024	
24-10-00459-005	ASP-B-2-DF-B109	09/29/2024	B109 DRINKING FOUNTAIN	1.20	10/05/2024	
24-10-00459-006	ASP-B-3-DF-B131	09/29/2024	B131 DRINKING FOUNTAIN	<1.00	10/05/2024	
24-10-00459-007	ASP-B-4-DF-B130	09/29/2024	B130 DRINKING FOUNTAIN	<1.00	10/05/2024	
24-10-00459-008	ASP-C-1-DF	09/29/2024	NEAR C108 DRINKING FOUNTAIN	<1.00	10/05/2024	
24-10-00459-009	ASP-C-2-DF	09/29/2024	PLUMBING DRINKING FOUNTAIN	<1.00	10/05/2024	
24-10-00459-010	ASP-C-3-DF	09/29/2024	CHRYSLER DRINKING FOUNTAIN	<1.00	10/05/2024	
24-10-00459-011	ASP-C-4-DF-C127	09/29/2024	C127 DRINKING FOUNTAIN	<1.00	10/05/2024	
24-10-00459-012	ASP-SUNROO M	09/29/2024	SUNROOM	<1.00	10/05/2024	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 24-10-00459

Project/Test Address: 2324; 1085 Old Trenton Rd; Trenton, NJ 08690

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
----------------------	---------------------	--------------------	---------------------	-----------------------------	------------------	-----------------

Method: EPA 200.8

Analyst: Nicole Lyle

Accreditation #: NJ VA008

Reviewed By Authorized Signatory:

Melissa Kanode

Melissa Kanode

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion

**ENVIRONMENTAL HAZARDS SERVICES, LLC****WaterSmart® Lead Chain-of-Custody Form**Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
www.leadlab.com

24-10-00459



Due Date:

10/09/2024

(Wednesday)

AE

AD

10+

Phone: 908-654-8068

Client Name: LEW CORP Account #: 201327Address: 181 US HIGHWAY 46City/State/Zip: MINE HILL, NJ 07803Email Address: labresults@lewcorp.comProject Name/ Number: 2324Collection Address: 1085 OLD TRENTON RD. City/State/Zip: TRENTON, NJ 08690
(Required) (Required)Approx. Age Of Property: _____ Collected By: ERICK ULLOAWater Source: (Check One) Public ☒ or Well _____ Well Tag # (if applicable): _____

Turn-Around Time

☒

5 Days

☐ 3 Days☐ 2 Days☐ 1 Day

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
1	ASP-A-2-BF-HALL	HALLWAY, BOTTLE FILLER	09/29/2024	AM / PM	X	
2	ASP-A-1-BF-HALL	HALLWAY, BOTTLE FILLER		AM / PM	X	
3	ASP-A-3-DF	ACROSS A170, DRINKING FOUNTAIN		AM / PM	X	
4	ASP-B-1-DF-B108	B108, DRINKING FOUNTAIN		AM / PM	X	
5	ASP-B-2-DF-B109	B109, DRINKING FOUNTAIN		AM / PM	X	
6	ASP-B-3-DF-B131	B131, DRINKING FOUNTAIN		AM / PM	X	
7	ASP-B-4-DF-B130	B130, DRINKING FOUNTAIN		AM / PM	X	
8	ASP-C-1-DF	NEAR C108, DRINKING FOUNTAIN		AM / PM	X	
9	ASP-C-2-DF	PLUMBING, DRINKING FOUNTAIN		AM / PM	X	
10	ASP-C-3-DF	CHRYSLER, DRINKING FOUNTAIN		AM / PM	X	
11	ASP-C-4-DF-C127	C127, DRINKING FOUNTAIN		AM / PM	X	
12	ASP-SUNROOM	SUNROOM		AM / PM	X	
13				AM / PM	X	
14				AM / PM	X	
15				AM / PM	X	

Released by: ERICK ULLOA

Signature:

Date/Time: 09/29/2024

Received by:

Signature:

Date/Time: 10/2/24 100pm