

**FIRE ALARM SYSTEM OBSOLETE, DIFFICULT TO MAINTAIN.**

**TOILETS NOT ACCESSIBLE**

**KITCHEN FINISHES NOT COMPLIANT**

**LUNCHROOM UNDERSIZED FOR PK-12**

**BLEACHER RAILINGS AND STEPS NOT COMPLIANT**

**GYM HVAC NOT COMPLIANT FOR IAQ AND DOES NOT HAVE COOLING**

**ROUTE FROM ELEMENTARY TO LUNCHROOM AND PLAYGROUND NOT ACCESSIBLE**

**SCIENCE LABS DO NOT HAVE ACCESSIBLE LAB STATION. 2 EXITS REQUIRED**

**TOILETS AND SHOWERS NOT ACCESSIBLE**

**HEAD START ROOM IN HIGH SCHOOL. NO TOILET IN ROOM**

**TOILETS AND SHOWERS NOT ACCESSIBLE**

**WRESTLING HVAC NOT COMPLIANT FOR IAQ**

**ORIGINAL ELECTRICAL SERVICE SWITCHGEAR OBSOLETE**

**FIRE ALARM SYSTEM OBSOLETE, DIFFICULT TO MAINTAIN.**

**WOOD SHOP UNDERSIZED. NO EXTERIOR ACCESS FOR MATERIALS AND PROJECTS**

**SHOP LAYOUT DOES NOT SUPPORT DESIRED CURRICULUM**


**WELDING EXHAUST IN POOR CONDITION**

① BASEMENT Copy 1  
1" = 30'-0"

NOTE:  
THIS DOCUMENT AND THE IDEAS AND DESIGNS INCORPORATED HEREIN ARE AN INSTRUMENT OF PROFESSIONAL SERVICE. IT IS THE PROPERTY OF THE ARCHITECT AND ENGINEER AND IS NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF THE ARCHITECT AND ENGINEER. REPRODUCTION OR TRANSMISSION IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT AND ENGINEER IS PROHIBITED IN ACCORDANCE WITH STATE LAW, CODE AND RULES.

NO.	REVISIONS	DATE

OVERALL BASEMENT

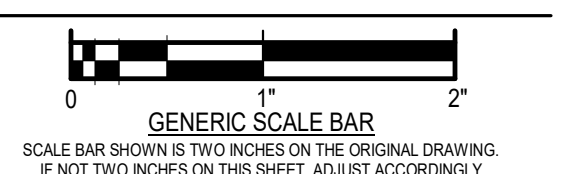

DATE	Issue Date

SCALE 1" = 30'-0"  
DWN Author CHK Checker  
PROJ No: 402402  
DWG No:

**A1001**

ENTRANCE / EXITS NOT ACCESSIBLE - TYPICAL AT ELEMENTARY

TOILETS NOT ACCESSIBLE - TYPICAL AT ELEMENTARY


CLASSROOM CASEWORK / SINKS IN POOR CONDITION - TYPICAL AT ELEMENTARY



SECURE ENTRY DIFFICULT TO SUPERVISE

- ADDITIONAL DEFICIENCIES**
- PARTIAL ROOFING NEEDS REPLACEMENT, BOTH BUILDINGS
  - WINDOWS IN POOR CONDITION BOTH BUILDINGS
  - HIGH SCHOOL LOCKERS IN POOR CONDITION
  - PLUMBING IN POOR CONDITION AT HS Y-WING
  - SOME ELECTRICAL PANELS OBSOLETE
  - PA SYSTEMS POOR IN BOTH BUILDINGS
  - EMERGENCY EXIT SIGNAGE POOR BOTH BUILDINGS
  - MISC LIGHTING HAS NOT BEEN CONVERTED TO LED
  - TRACK SURFACE IS FAILING
  - PAVING AT ELEMENTARY AND PLAYGROUND NEED MAINTENANCE
  - SOME SIDEWALKS CRACKING
  - LIMITED / INADEQUATE IRRIGATION AT ATHLETIC FIELDS


TOILETS NOT ACCESSIBLE - TYPICAL AT HIGH SCHOOL

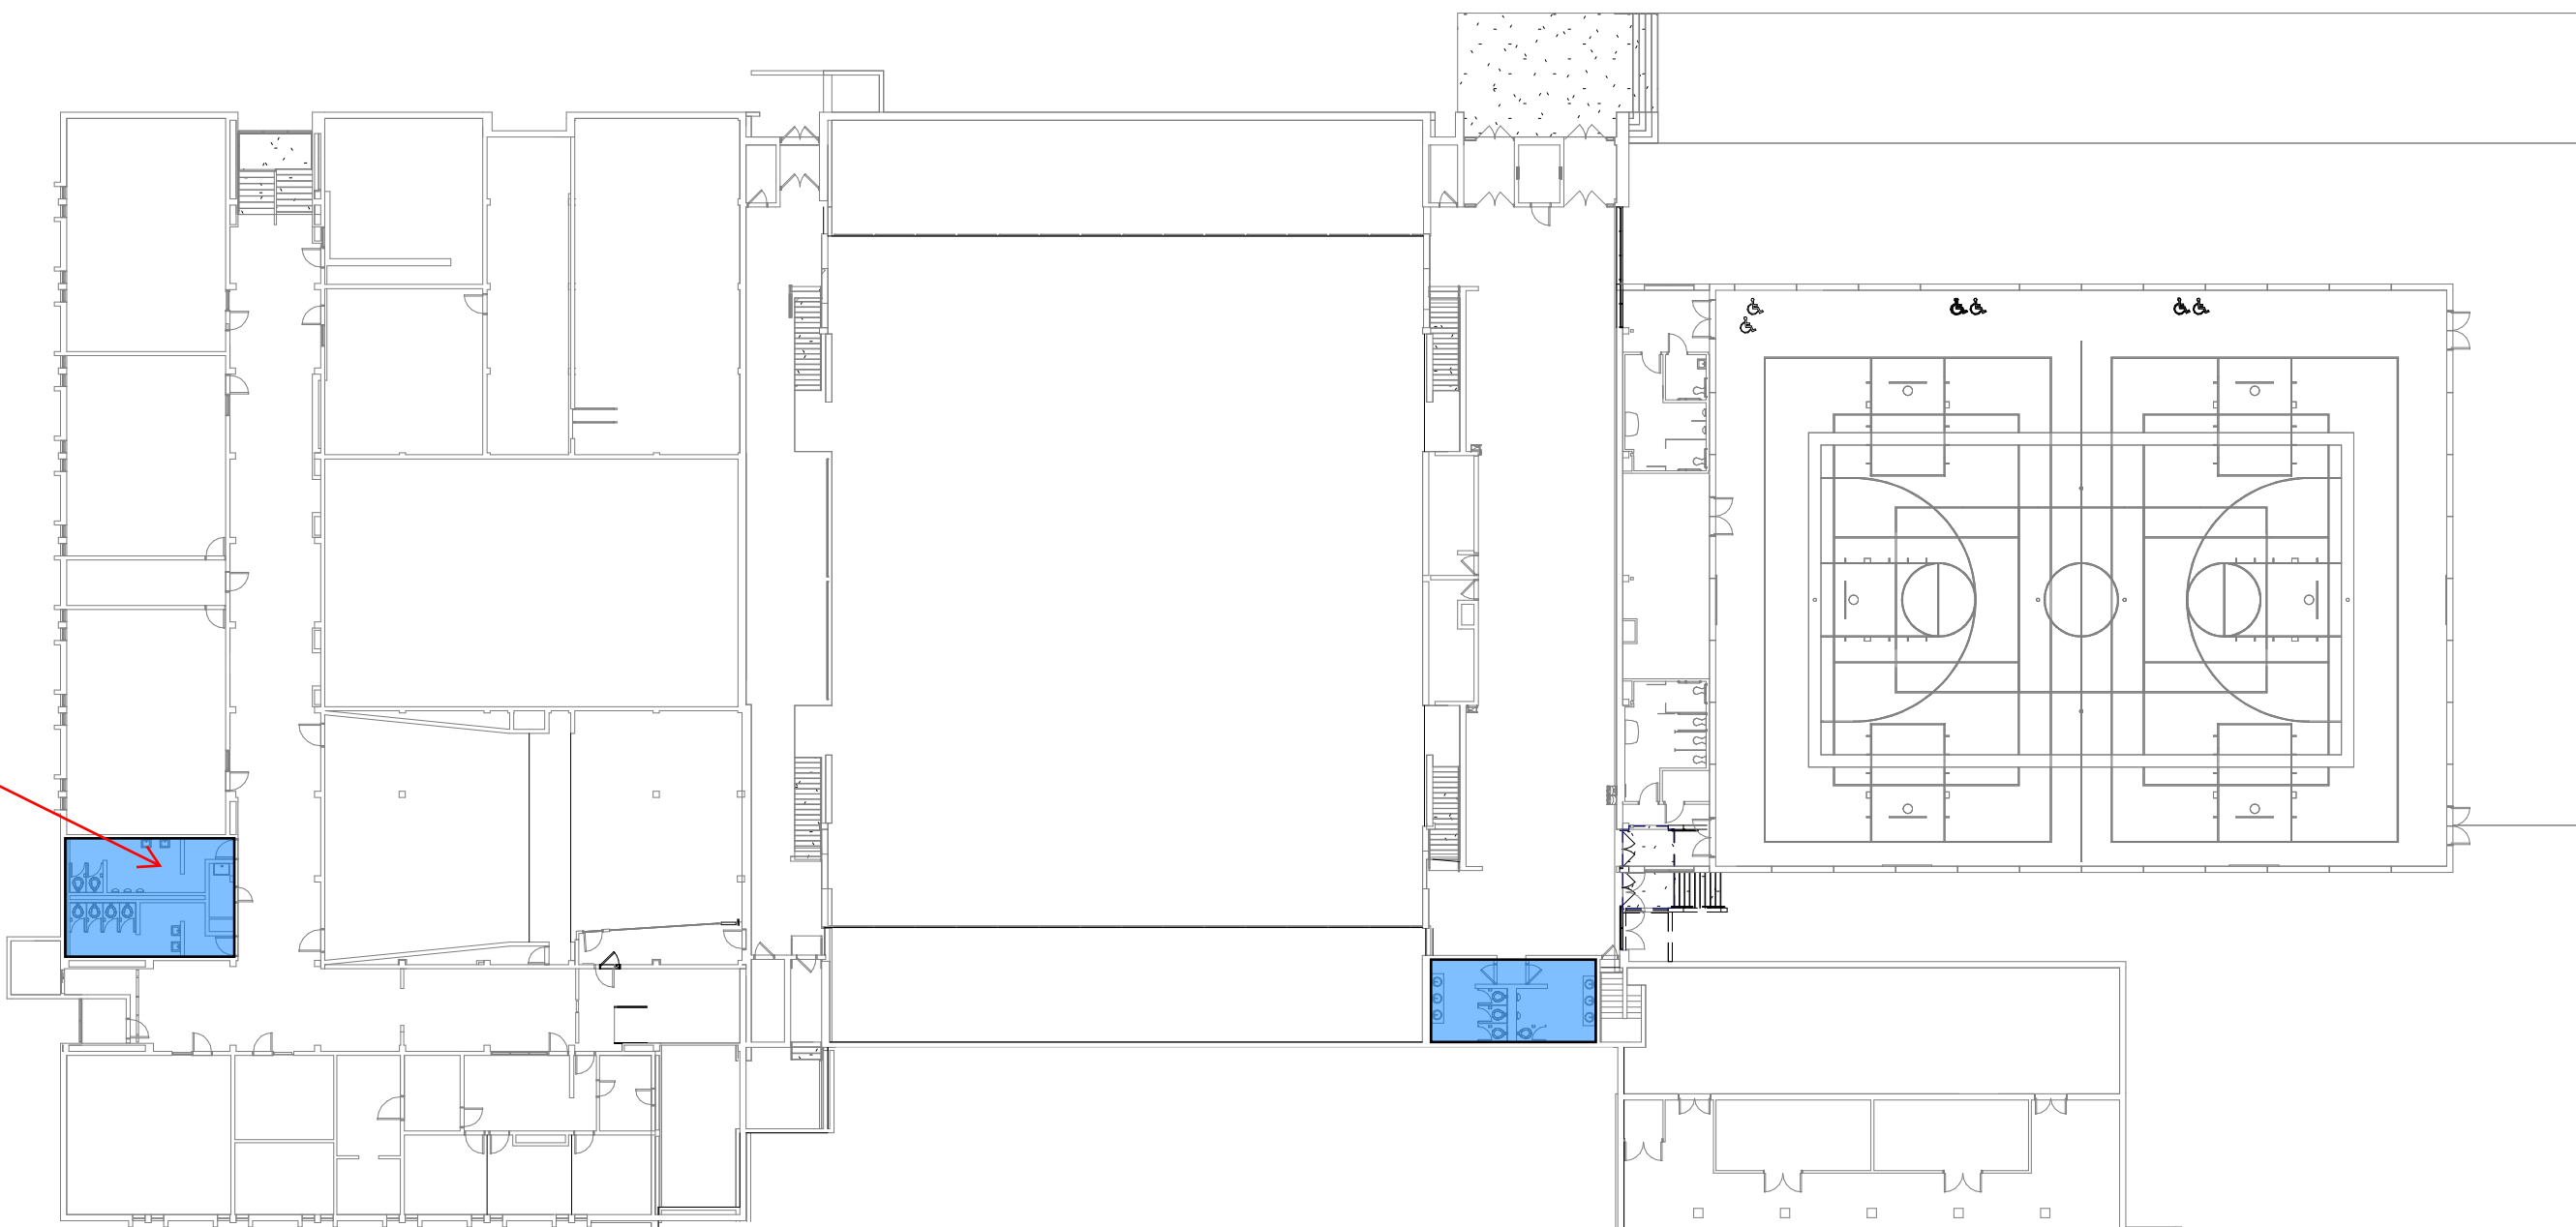

FOODS LABS DOES NOT HAVE ACCESSIBLE KITCHEN. 2 EXITS REQUIRED

FOODS LAB DESIGN DOES NOT SUPPORT DESIRED CURRICULUM

MASONRY DETERIORATED AT WEST WALL AND ENTRANCES OF Y-WING  
STEPS AT ENTRIES ARE IN POOR CONDITION

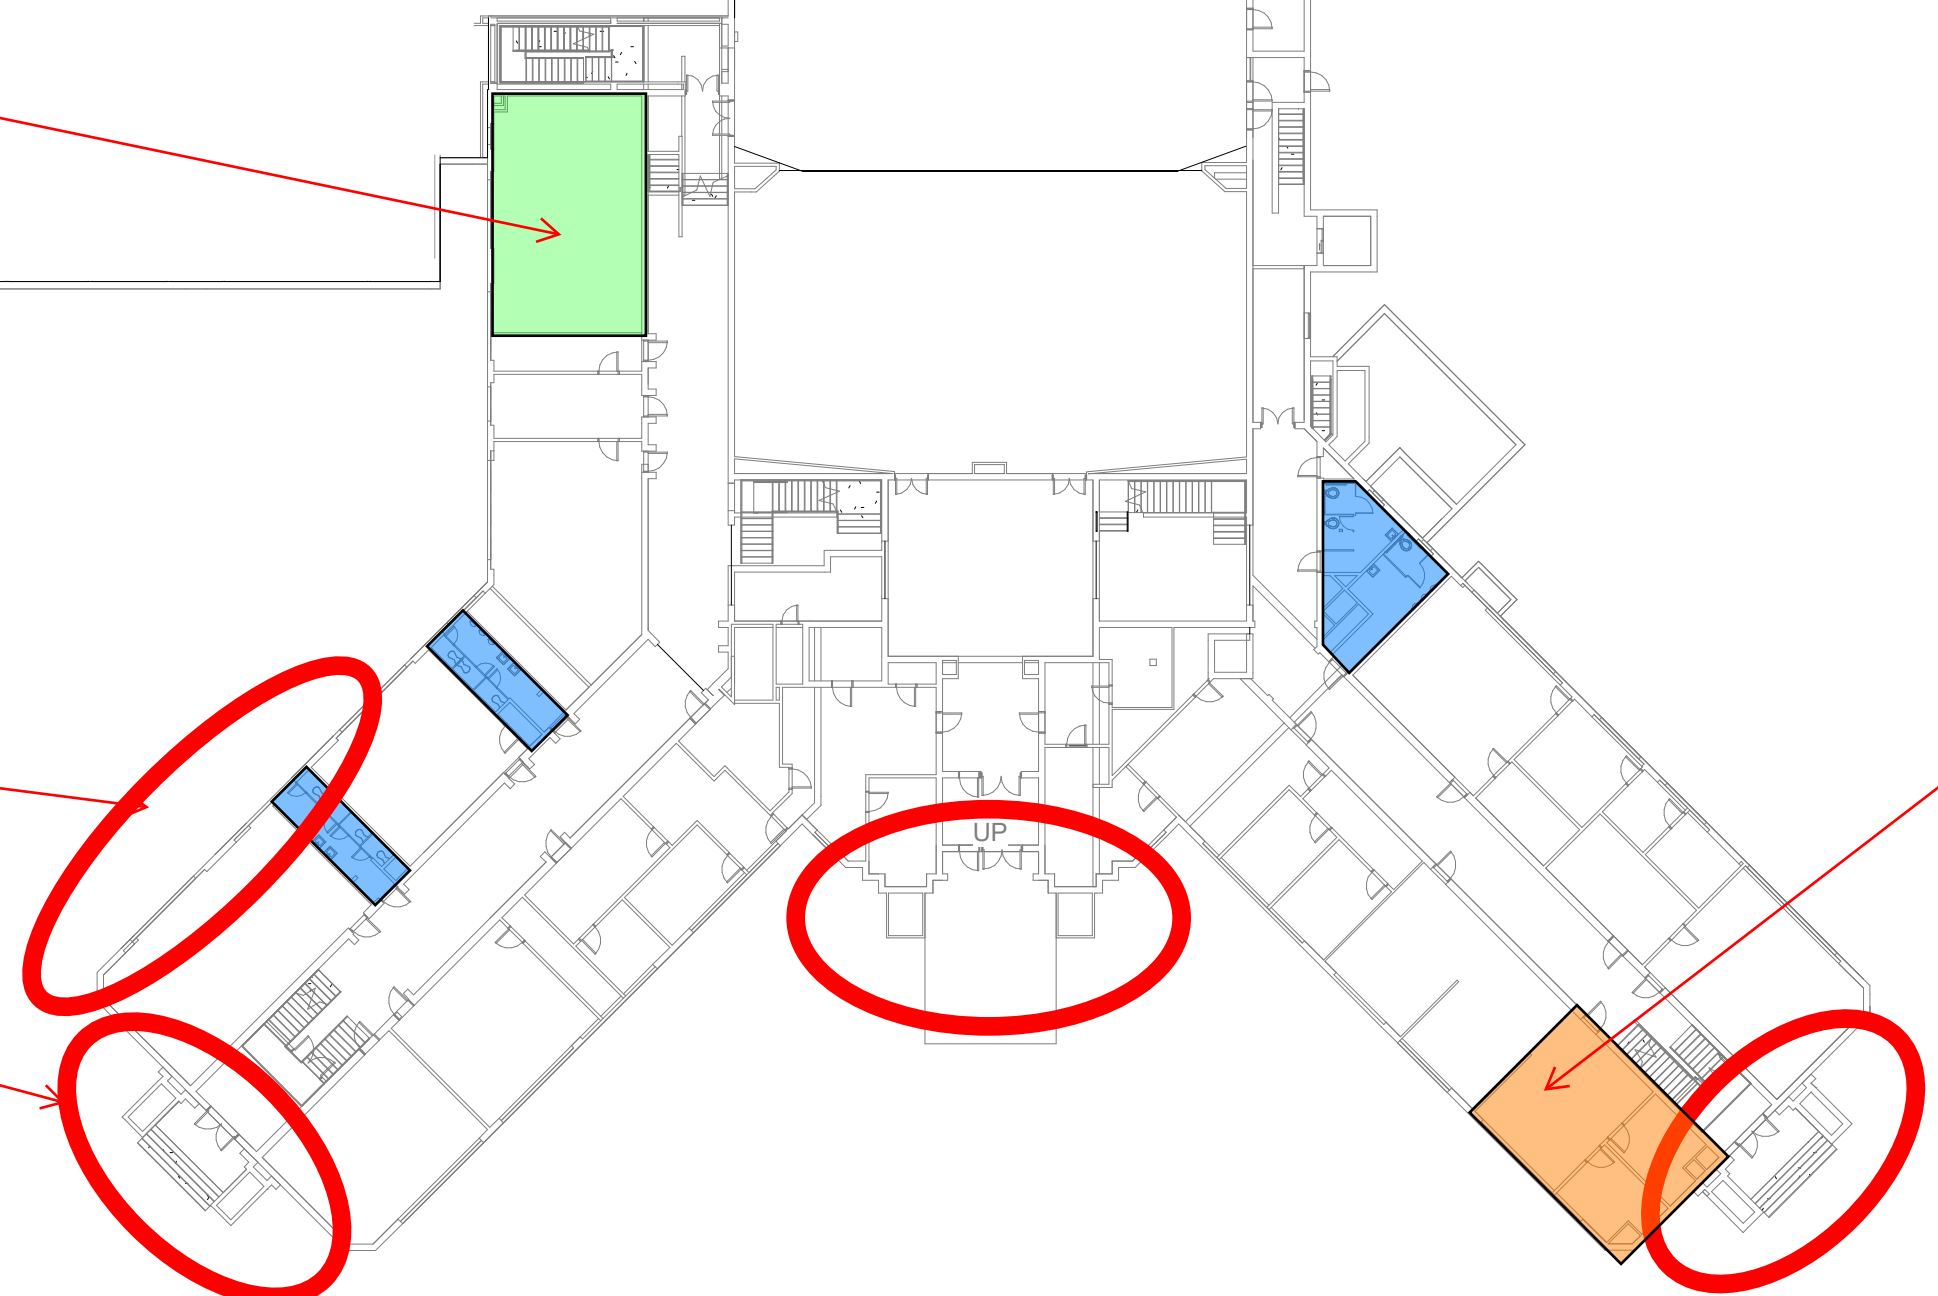

DISTRICT OFFICE LAYOUT NOT EFFICIENT


1 LEVEL 1  
1" = 30'-0"

NOTE:  
THIS DOCUMENT AND THE IDEAS AND DETAILS INCORPORATED HEREIN ARE AN INSTRUMENT OF PROFESSIONAL SERVICE. THE PROPERTY OF THE ARCHITECT AND ENGINEER AND IS NOT TO BE REPRODUCED OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF THE ARCHITECT AND ENGINEER. UNAUTHORIZED ALTERATION OR ADDITION TO ANY SURVEY, DRAWING, DESIGN, SPECIFICATION, PLAN OR REPORT IS PROHIBITED IN ACCORDANCE WITH STATE LAW, CODE AND RULES.

NO.	REVISIONS	DATE

OVERALL LEVEL 1

GENERIC SCALE BAR



SCALE BAR SHOWN IS TWO INCHES ON THE ORIGINAL DRAWING IF NOT TWO INCHES ON THIS SHEET, ADJUST ACCORDINGLY

DATE	Issue Date
SCALE	1" = 30'-0"
DWN.	Author
	CHK. Checker
PROJ. No.	402402
DWG. No.	



TOILETS NOT ACCESSIBLE  
- TYPICAL AT ELEMENTARY



CLASSROOM CASEWORK /  
SINKS IN POOR CONDITION-  
TYPICAL AT ELEMENTARY

MEDIA CENTER LAYOUT  
DOES NOT SUPPORT  
CURRENT PROGRAMS

MEDIA CENTER LAYOUT  
DOES NOT SUPPORT  
CURRENT PROGRAMS

TOILETS NOT ACCESSIBLE -  
TYPICAL AT HIGH SCHOOL

MASONRY DETERIORATED  
AT WEST WALL AND  
ENTRANCES OF Y-WING

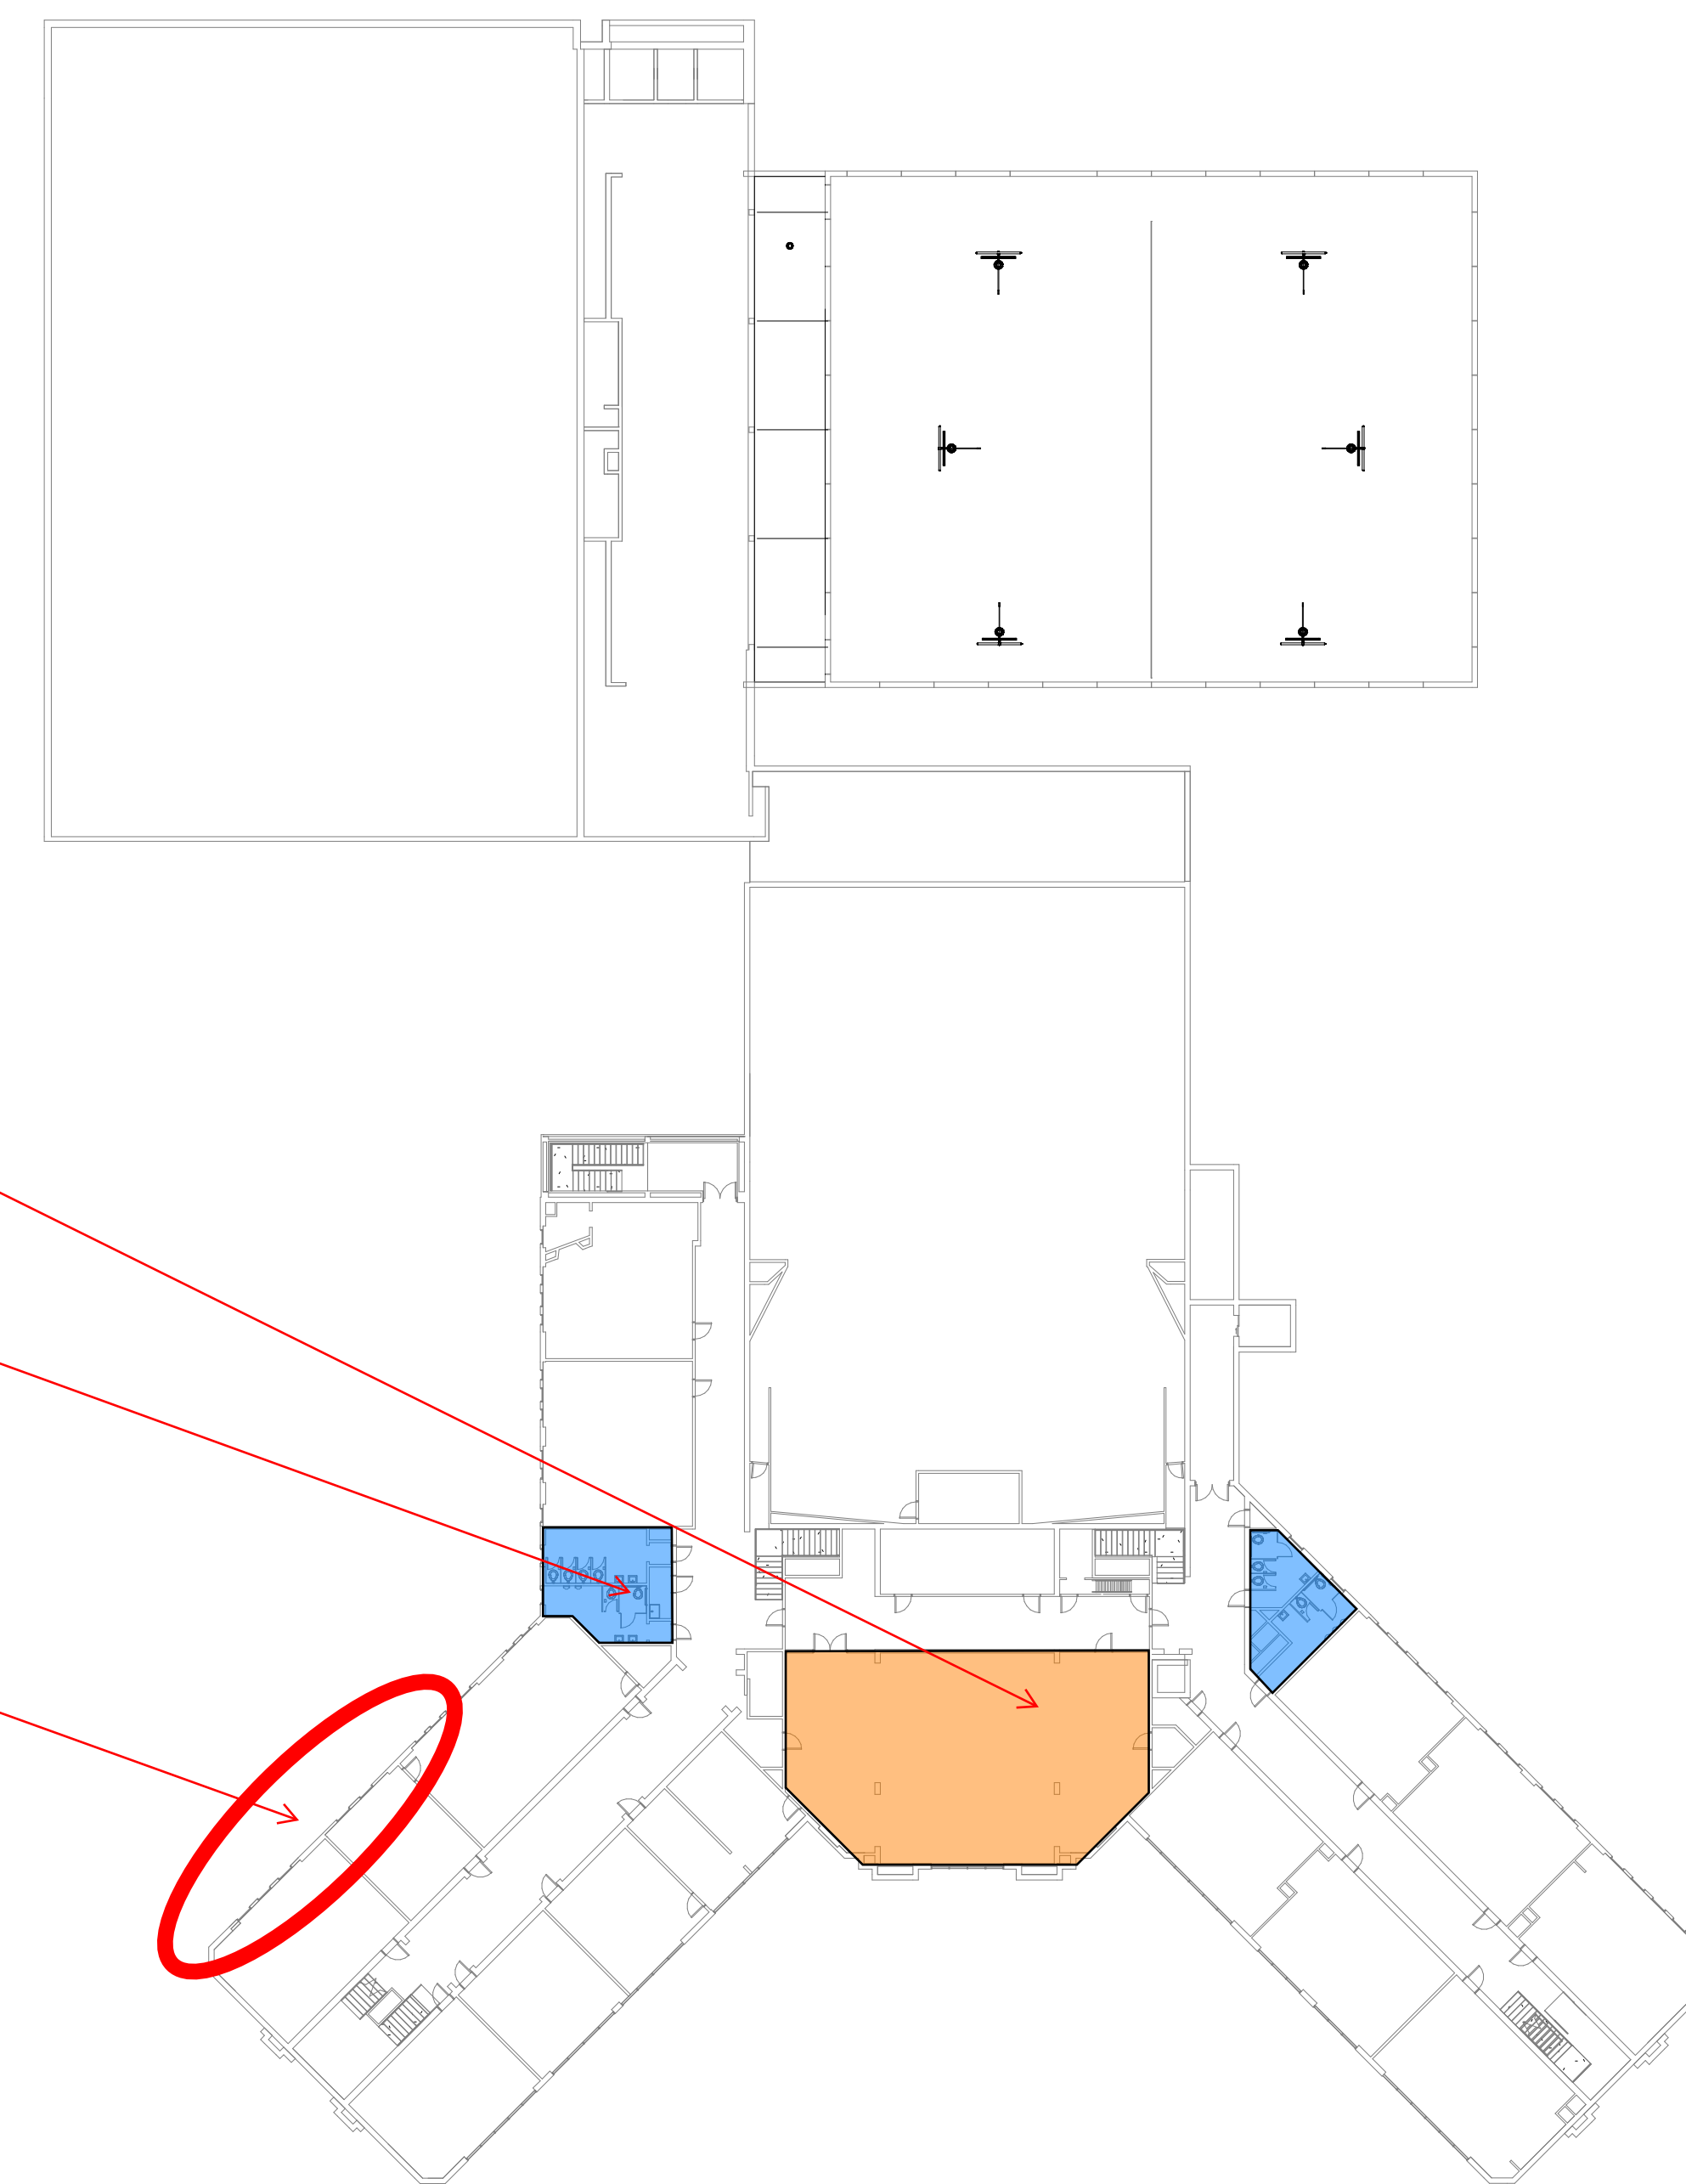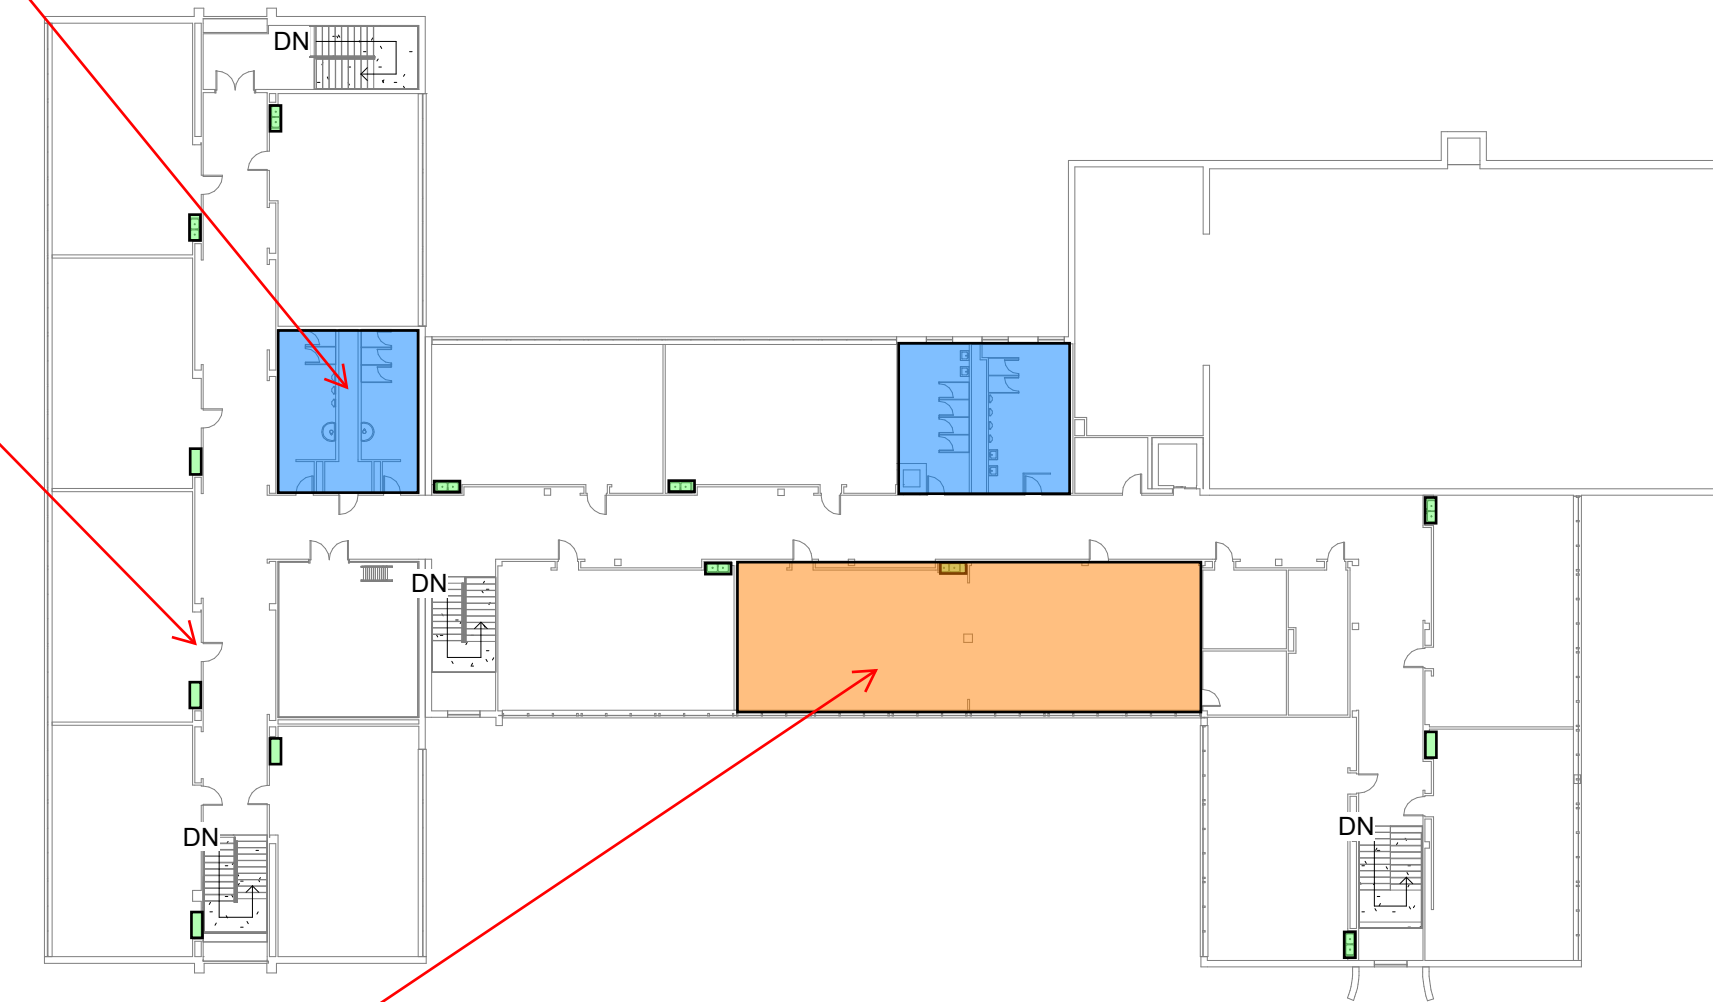


1 LEVEL 2 Copy 1  
1" = 30'-0"

NOTE:  
THIS DOCUMENT AND THE ISSUES AND RESOLUTIONS INCORPORATED HEREIN ARE AN INSTRUMENT OF PROFESSIONAL SERVICE AND IS THE PROPERTY OF THE ARCHITECT AND ENGINEER AND IS NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF THE ARCHITECT AND ENGINEER. UNAUTHORIZED ALTERATION OR ADDITION TO ANY SURVEY, DRAWING, DESIGN, SPECIFICATION, PLAN OR REPORT IS PROHIBITED IN ACCORDANCE WITH STATE LAW, CODE AND RULES.

NO.	REVISIONS	DATE

OVERALL LEVEL 2

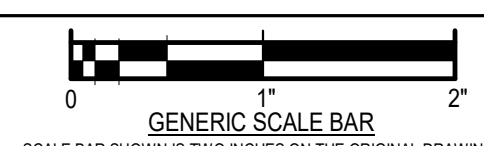

SCALE BAR SHOWN IS TWO INCHES ON THE ORIGINAL DRAWING  
IF NOT TWO INCHES ON THIS SHEET, ADJUST ACCORDINGLY

DATE	Issue Date
SCALE	1" = 30'-0"
DWN.	Author
CHK.	Checker
PROJ. No.	402402
DWG. No.	

A1003