140 Iowa Lane, Suite 102, Cary, NC 27511 O.919-342-4936 www.lrcresearch.com

November 24, 2024

Dare County Schools
Ian Adams
3020 S. Wrightsville Avenue
Nags Head, NC

Re: Limited Indoor Air Quality Sampling with Airborne Fungal Sampling at Manteo High School
LRC Project – 24-3282

At your request, on November 14, 2024, LRC Indoor Testing & Research, Inc. (LRC) performed a limited environmental fungal Indoor Air Quality (IAQ) sampling that included airborne fungal sampling at the property listed above.

LRC performs all water-damage and fungal investigations with sampling and recommendations in accordance with guidelines published in *Bioaerosols: Assessment and Control*, by the American Conference of Governmental Industrial Hygienists (ACGIH), in *Mold Remediation in Schools and Commercial Buildings* by the United States Environmental Protection Agency (USEPA), and in the currently recognized and accepted industry standards including the ANSI/IICRC S500 *Standard and Reference Guide for Professional Water Damage Restoration*, Fourth Edition (S500) and the ANSI/IICRC S520 *Standard and Reference Guide for Professional Mold Remediation*, Third Edition (S520).

Our inspection included the following:
1. Measure temperature and relative humidity indoors and outdoors.
2. Collect representative non-viable spore trap air samples indoors and one outdoors for comparison.
3. Collect representative Particle Counts, Carbon Dioxide and Carbon Monoxide counts at locations where air samples are collected.
4. Provide a written report describing the survey results and comparing those results to accepted guidelines and directives. This report includes a summary of data and Certificates of Laboratory Analysis.

BACKGROUND

This inspection was limited to non-viable spore trap air samples, particle counts, CO and CO^2 measurements that were collected from locations selected at random throughout the building. Descriptions in this report are based on looking at the structure from the street front. Moisture measurements and visual inspections were not conducted on this day.




Outdoor Air Sample



Air Sample in Classroom



Air Sample in Music Room

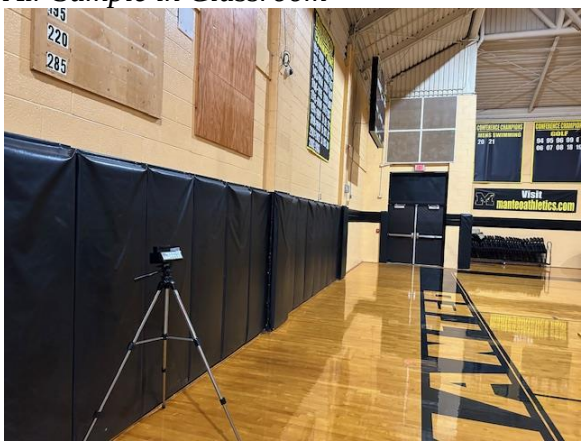

Air Sample in Gym



Air Sample in Hall



Air Sample in Classroom



Air Sample in Classroom



Air Sample in Auditorium

SAMPLING METHODOLOGY

Air Samples:

Currently there are no regulations regarding acceptable airborne fungal levels. Airborne fungal spores are ubiquitous in the outdoor and indoor environment. The guidelines followed in this report for the assessment and/or remediation of airborne and surface fungi are published in *Bioaerosols: Assessment and Control*, by the American Conference of Governmental Industrial Hygienists (ACGIH), in *Mold Remediation in Schools and Commercial Buildings* by the United States Environmental Protection Agency (USEPA), in *Recognition, Evaluation, and Control of Indoor Mold* by the American Industrial Hygiene Association (AIHA), and in the ANSI/IICRC S520 *Standard and Reference Guide for Professional Mold Remediation*, Third Edition (S520). Airborne fungal assessments are performed by comparing results from volumetric samples taken indoors to samples taken outdoors. Airborne fungi levels in non-problem indoor environments generally are less than or approximately the same as that outdoors and also show a similar composition and/or taxonomic predominance. Problems are usually implicated in the indoor air when one or more fungal genera or species are present in a much greater concentration indoors compared to outdoors. Sampling results are shown in the Certificates of Laboratory Analysis attached to this report. Results are discussed below.

Temperature and Relative Humidity

Temperature and relative humidity readings were recorded by the Lighthouse Handheld 3016 Particle Counter. ASHRAE Standard 55 for thermal comfort suggested that the indoor temperature should be between 73°F to 79°F in the summer and 68°F to 75°F in the winter and that the indoor relative humidity should be between 20% to 65%.

The temperature and relative humidity are summarized in Table A below. The relative humidity met the current ASHRAE Standard to maintain indoor relative humidity below 65%.

SAMPLING RESULTS

Total Non-Viable Spore Air Sample Results:

Representative samples were taken for total airborne fungal spores with a calibrated Buck spore trap. Total airborne fungal spore sample volumes were 75-liters. The outdoor total fungal spore level (Sample 27) was measured at 1053 Spores/m^3 and was comprised of *Cladosporium* (30%), *Curvularia* (14%), *Penicillium/Aspergillus* group (13%), Ascospores (8%), Smuts (8%), *Dreschera/Bipolaris* (8%), Basidiospores (6%), and 4% or less of various other fungal spores. The air sample results are summarized below in Table A.

Sample #	Location	Total Airborne Spore Count (Spores/m^3)	*Non-Fungal Background Particulate Level	Temperature ^oF	Relative Humidity %
01	Advancement Center	213	Low-moderate	68	56
02	Hall at 201	200	Moderate	69	57
03	C 201	507	Moderate	71	57
04	D202	173	Low-moderate	72	55
05	Hall at 202	253	Moderate	75	51
06	D 200	280	Low-moderate	74	55
07	Hall at CR 207	293	Low-moderate	75	51
08	CR 207	133	Low-moderate	75	50
09	Hall at 209	147	Low-moderate	76	47
10	Hall at 216	147	Low-moderate	75	49
11	CR 218	67	Low	74	50
12	Hall at 201	147	Low	73	53
13	Hall at Band Room	533	Moderate	74	49
14	Band Room	227	Low-moderate	74	49
15	Hall at A 103	453	Moderate	75	49
16	Gymnasium	253	Low	75	47
17	Cafeteria	360	Moderate	74	52
18	Hall at C 101	387	Low-moderate	73	50
19	Media Center	307	Low-moderate	74	50
20	Hall at D100	200	Low-moderate	75	54
21	CR D 102	240	Moderate	75	54
22	Hall at C104	200	Low-moderate	76	49
23	Hall at V 102	227	Low-moderate	75	49
24	CR C 106	253	Low-moderate	74	53
25	Auditorium	53	Low	75	48
26	First Floor Offices-across from Elevator	147	Low	75	56
27	Outdoor Air	1,053	Low	76	47

*The Background Particulate Level refers to non-fungal debris seen in the air sample; such as skin cells, hair, fibers, dust, dirt, etc.

The total fungal spore counts in the areas sampled indoors were lower than that found in the outdoor air. The types of fungal spores found in the indoor air samples were all common outdoor-type fungi present in low concentrations with no spikes in water loss fungi. Therefore, the results suggested a normal indoor fungal ecology in the areas sampled.

The particulate in the indoor air samples was in the Low-moderate-heavy range. The particulate that we see in the microscope at the magnification used is usually called 'course particulate' and consist of many things and can include the following: dirt, dust, mold, pollen, fiber, hair, skin cells, dust mites and other insects. Fine particulates (to include VOC's – volatile organic compounds) are not seen with the magnification used for these samples.

PARTICLE COUNT METHODOLOGY

A Lighthouse Handheld 3016 Particle Counter was used to measure the levels of airborne particulates. Airborne particles are solids suspended in the air. In a commercial setting, particle levels should be less than outside readings due to better filtration. Particle counts can vary in a school building due to occupant activity, including ingress/egress from outside. For this project, the particle count results are used to compare those results to locations where the air sample results suggest an altered environment.

PARTICLE COUNT RESULTS

Table B below summarizes the minimum, maximum, and average particle count in the building in each size category during the sampling period. Each time one liter of air was drawn into the Particle Counter, and the Particle Counter calculated all particles that are greater than or equal to the particle size indicated in the size categories.

Table B – Indoor Particle Count Sampling Results

	0.3 micron	0.5 micron	1.0 micron	2.5 micron	5.0 micron	10.0 micron
Minimum	2,169	491	81	3	0	0
Maximum	45,647	11,775	677	193	85	24
Average	11,259	2,588	283	89	28	9

Table C below summarizes the average particle count in the outdoor air at the time of sampling. Each time one liter of air was drawn into the Particle Counter, and the Particle Counter calculated all particles that are greater than or equal to the particle size indicated in the size categories. In addition, temperature and relative humidity information were included.

Table C – Outdoor Particle Count Sampling Results

	0.3 micron	0.5 micron	1.0 micron	2.5 micron	5.0 micron	10.0 micron
Outdoor Air Average	5,791	2,861	1,116	278	14	1

CARBON MONOXIDE AND CARBON DIOXIDE METHODOLOGY

A TSI IAQ-Calc Indoor Air Quality Meter (Model 7545) was used to measure the concentrations of CO and CO_2. CO is a dangerous gas caused by incomplete combustion. The level of CO in an indoor environment should be low (none detected to 4 parts per million [ppm] depending on fuel sources used indoors) or same as outdoors. CO_2 is commonly used as an indicator of ventilation adequacy. American Society of Heating, Refrigeration, and Air Conditioning Engineers (ASHRAE) Standard 62.1 stated that the indoor concentration of CO_2 should be less than 700 ppm over the outdoor ambient air, which typically is around 400 ppm.

CARBON MONOXIDE AND CARBON DIOXIDE RESULTS

The average CO^2 concentration indoors was similar to the CO^2 concentration outdoors. In addition, the indoor CO^2 concentrations were measured at low ppm in all locations. Therefore, the results suggested that the indoor CO^2 concentrations were within normal ranges. Therefore, the results suggested that the ventilation in the areas sampled was adequate. Individual test results are available upon request.

CONCLUSIONS

Results as reported by LRC apply only to the day of this inspection. LRC cannot and does not warranty that other parts of the structure were completely free or that the structure will remain free in the future from hidden sources of moisture or fungal contamination.

This inspection was limited to indoor air quality parameters. The indoor air samples did not show a fungal amplification or an altered indoor fungal ecology on this day. Relative humidity was in the recommended range. Particle counts were generally lower or similar than that found in the outdoor air. Carbon Dioxide and Carbon Monoxide levels were within the normal recommended range.

This inspection was limited to indoor air quality.

If you have any questions or concerns, please do not hesitate to contact us.

Sincerely,

Tony Richmond, BBA, CAI, WRT
LRC Indoor Testing & Research

Mitchell Richmond, B.A PMP, CMI
LRC Indoor Testing & Research