


REPORT OF DRINKING WATER SAMPLING FOR LEAD CONTENT:

**HAZELWOOD EAST HIGH SCHOOL
11300 DUNN ROAD
ST. LOUIS, MO 63138**

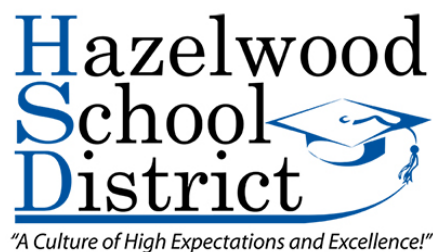

PREPARED FOR:

**MR. DAVID DUDLEY
DIRECTOR OF MAINTENANCE
HAZELWOOD SCHOOL DISTRICT
15875 NEW HALLS FERRY RD
FLORISSANT, MISSOURI 63031**

PREPARED BY:

**ENPAQ, LLC
3130 GRAVOIS AVENUE
ST. LOUIS, MISSOURI 63139**

JULY 2023

DOCUMENT TO BE RETAINED INDEFINITELY

TABLE OF CONTENTS

23-170

Drinking Water Sampling for Lead
Hazelwood School District
Hazelwood East High School
11300 Dunn Road
St. Louis, MO 63138

EXECUTIVE SUMMARY

APPENDIX A Sample Locations/Results

APPENDIX B Laboratory Analysis

APPENDIX C Credentials

EXECUTIVE SUMMARY

ENPAQ, LLC performed lead testing of multiple drinking fountain water sources at the Hazelwood East High School located at 11300 Dunn Road in St. Louis, Missouri. The sampling was performed by trained and licensed personnel in accordance with USEPA, HUD, and State of Missouri Regulations and Guidelines.

All inspectors involved with sampling activities had EPA-approved training in Lead. Credentials for our firm and the inspector collecting the samples are included in Attachment C to this document.

All samples were collected on a “first draw” basis. “First draw” is achieved by allowing the water system to rest for at least eight hours prior to sampling in order to collect any existing debris or settlement within the sample. The intent of this sampling is to replicate “worst-case scenario” conditions. As such, ENPAQ inspectors met at the school to collect water samples before the systems were used by staff or students. A second sample from each water source was collected as a “follow-up” sample basis. “Follow-up” sampling is achieved by allowing the water system to run for thirty (30) seconds after the first draw sampling. The intent of this sampling is to determine if lead contamination may be in the water lines connected to the water sources and not just at the fixture. The sampling was completed in accordance with the Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* requirements. The Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* and other regulatory agencies recommend that water sources run for at least thirty seconds and as long as two minutes prior to use to avoid settling within the water system.

Drinking water samples were collected from fifty-three (53) different locations throughout Hazelwood East High School during the sampling event. The water samples were collected from drinking fountains utilized for drinking activities at the campus. After sample collection, samples were immediately delivered to Teklab, Inc. located in Collinsville, Illinois following strict chain of custody procedures. Teklab is a NELAP-accredited and State of Missouri-licensed laboratory specializing in drinking water analysis. Detailed sampling locations and sample results are located in Attachment A of this report.

Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.

The following results require written notification per the Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* for samples reported above 5.0 ppb.

“First Draw” Sampling

Sample ID 04A	Kitchen 1 Bay Prep- Fries Station	(<1.0 ppb)
----------------------	--	----------------------

“Follow-Up” Sampling

Sample ID 04B	Kitchen 1 Bay Prep- Fries Station	(5.7 ppb)
----------------------	--	------------------

“First Draw” Sampling

Sample ID 28A Room C216 Station 6 (10.6 ppb)

“Follow-Up” Sampling

Sample ID 28B Room C216 Station 6 (<1.0 ppb)

CONCLUSION/RECOMMENDATIONS

At this time, ENPAQ recommends that all water sources testing at 5.0 ppb or above be removed from service. These sources are subject to additional maintenance activities and remediation prior to use. Before being put back into service, it is recommended these sources be re-tested to confirm compliance with acceptable levels.

Remediation includes decreasing lead concentrations below 5 parts per billion using methods such as replacement of plumbing, solder, fittings, or fixtures, installation of filters and filter devices, or other effective methods in accordance with Missouri SB681 *Get the Lead Out of Schools Drinking Water Act*.

In addition, all sources will be subject to an ongoing maintenance program and re-testing at appropriate intervals. **Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.**

Although no additional samples were identified above the action level, ENPAQ recommends that all water sources run for at least thirty seconds prior to use as recommended by the USEPA.

APPENDIX A

SAMPLE LOCATIONS & RESULTS

Prep Day: 7/26/23

Sample Day: 7/27/23

To Lab -----> 7/27/23

* Reporting Limit

# Disabled =	9
# of Samples =	106
# > 10.0 ppb =	1
# > 5.0 ppb =	1

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
01	(A)	S	Kitchen 3 Bay- Left		1.0	<1.0 ppb
	(B)	S	Kitchen 3 Bay- Left		1.0	<1.0 ppb
	(C)				1.0	N/A ppb
02	(A)	S	Kitchen 3 Bay- Right		1.0	<1.0 ppb
	(B)	S	Kitchen 3 Bay- Right		1.0	<1.0 ppb
03	(A)	S	Kitchen 2 Bay Prep- Salad Station		1.0	1.2 ppb
	(B)	S	Kitchen 2 Bay Prep- Salad Station		1.0	<1.0 ppb
04	(A)	S	Kitchen 1 Bay Prep- Fries Station		1.0	<1.0 ppb
	(B)	S	Kitchen 1 Bay Prep- Fries Station		1.0	<1.0 ppb
05	(A)	S	Pot Filler		1.0	5.7 ppb
	(B)	S	Pot Filler		1.0	<1.0 ppb
06	(A)	S	Kitchen Rinse Off Station		1.0	<1.0 ppb
	(B)	S	Kitchen Rinse Off Station		1.0	<1.0 ppb
07	(A)	F	O/S Exit Door 26- Bottle Filler		1.0	<1.0 ppb
	(B)	F	O/S Exit Door 26- Bottle Filler		1.0	<1.0 ppb
08	(A)	F	O/S Activities Office- Left		1.0	N/A ppb
	(B)	F	(Inactive)		1.0	N/A ppb
09	(A)	F	O/S Activities Office - Center		1.0	N/A ppb
	(B)	F	(Inactive)		1.0	N/A ppb
10	(A)	F	O/S Activities Office- Right		1.0	N/A ppb
	(B)	F	(Inactive)		1.0	N/A ppb
11	(A)	F	Fountain O/S Mens RR by Activities		1.0	<1.0 ppb
	(B)	F	Office		1.0	<1.0 ppb

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
12	(A)	S	Nurses Room		1.0	<1.0 ppb
	(B)	S	Nurses Room		1.0	<1.0 ppb
13	(A)	S	Rm B101, Front Office Work Room		1.0	<1.0 ppb
	(B)	S	Rm B101, Front Office Work Room		1.0	<1.0 ppb
14	(A)	F	Gym- Main Gym		1.0	<1.0 ppb
	(B)	F	Gym- Main Gym		1.0	<1.0 ppb
15	(A)	F	Small East Gym O/S Womens		1.0	<1.0 ppb
	(B)	F	Locker Rm- Left		1.0	<1.0 ppb
16	(A)	F	Small East Gym O/S Womens		1.0	<1.0 ppb
	(B)	F	Locker Rm- Right		1.0	<1.0 ppb
17	(A)	F	Small East Gym O/S Mens Locker		1.0	<1.0 ppb
	(B)	F	Rm- Left		1.0	<1.0 ppb
18	(A)	F	Small East Gym O/S Mens Locker		1.0	<1.0 ppb
	(B)	F	Rm- Right		1.0	<1.0 ppb
19	(A)	S	A013 Sink		1.0	<1.0 ppb
	(B)	S	A013 Sink		1.0	<1.0 ppb
20	(A)	I	A013 Ice Machine		1.0	<1.0 ppb
	(B)	I	A013 Ice Machine		1.0	<1.0 ppb
21	(A)	F	Boys Locker Room- Ground Level		1.0	N/A ppb
	(B)	F	(Inactive)		1.0	N/A ppb
22	(A)	F	Girls Locker Room- Ground Level		1.0	<1.0 ppb
	(B)	F	Girls Locker Room- Ground Level		1.0	<1.0 ppb
23	(A)	S	Room C216 Station 1		1.0	<1.0 ppb
	(B)	S	Room C216 Station 1		1.0	<1.0 ppb
24	(A)	S	Room C216 Station 2		1.0	<1.0 ppb
	(B)	S	Room C216 Station 2		1.0	<1.0 ppb
25	(A)	S	Room C216 Station 3		1.0	<1.0 ppb
	(B)	S	Room C216 Station 3		1.0	<1.0 ppb

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
26	(A)	S	Room C216 Station 4		1.0	<1.0 ppb
	(B)	S	Room C216 Station 4		1.0	<1.0 ppb
27	(A)	S	Room C216 Station 5		1.0	<1.0 ppb
	(B)	S	Room C216 Station 5		1.0	<1.0 ppb
28	(A)	S	Room C216 Station 6		1.0	10.6 ppb
	(B)	S	Room C216 Station 6		1.0	<1.0 ppb
29	(A)	S	Room C215 Station 1		1.0	<1.0 ppb
	(B)	S	Room C215 Station 1		1.0	<1.0 ppb
30	(A)	S	Room C215 Station 2		1.0	<1.0 ppb
	(B)	S	Room C215 Station 2		1.0	<1.0 ppb
31	(A)	S	Room C215 Station 3		1.0	2.0 ppb
	(B)	S	Room C215 Station 3		1.0	<1.0 ppb
32	(A)	S	Room C215 Station 4		1.0	<1.0 ppb
	(B)	S	Room C215 Station 4		1.0	<1.0 ppb
33	(A)	S	Room C215 Station 5		1.0	<1.0 ppb
	(B)	S	Room C215 Station 5		1.0	<1.0 ppb
34	(A)	S	Room C215 Station 6		1.0	1.9 ppb
	(B)	S	Room C215 Station 6		1.0	<1.0 ppb
35	(A)	F	Fountain O/S D102		1.0	<1.0 ppb
	(B)	F	Fountain O/S D102		1.0	<1.0 ppb
36	(A)	F	Fountain O/S D110 by RR		1.0	<1.0 ppb
	(B)	F	Fountain O/S D110 by RR		1.0	<1.0 ppb
37	(A)	F	Fountain O/S D107- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S D107- Left		1.0	<1.0 ppb
38	(A)	F	Fountain O/S D107- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S D107- Right		1.0	<1.0 ppb
39	(A)	F	Fountain O/S D207		1.0	<1.0 ppb
	(B)	F	Fountain O/S D207		1.0	1.7 ppb

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
40	(A)	F	Fountain O/S D204- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S D204- Left		1.0	<1.0 ppb
41	(A)	F	Fountain O/S D204- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S D204- Right		1.0	<1.0 ppb
42	(A)	F	Fountain O/S D202		1.0	<1.0 ppb
	(B)	F	Fountain O/S D202		1.0	<1.0 ppb
43	(A)	F	Fountain O/S C312- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S C312- Left		1.0	<1.0 ppb
44	(A)	F	Fountain O/S C312- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S C312- Right		1.0	<1.0 ppb
45	(A)	S	Room C312		1.0	<1.0 ppb
	(B)	S	Room C312		1.0	<1.0 ppb
46	(A)	F	Fountain O/S C347- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S C347- Left		1.0	<1.0 ppb
47	(A)	F	Fountain O/S C347- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S C347- Right		1.0	<1.0 ppb
48	(A)	F	West Set 2nd Fl. Dining Area-		1.0	<1.0 ppb
	(B)	F	Left		1.0	<1.0 ppb
49	(A)	F	West Set 2nd Fl. Dining Area-		1.0	<1.0 ppb
	(B)	F	Center		1.0	<1.0 ppb
50	(A)	F	West Set 2nd Fl. Dining Area-		1.0	<1.0 ppb
	(B)	F	Right		1.0	<1.0 ppb
51	(A)	F	2nd Fl. Dining Area West-		1.0	<1.0 ppb
	(B)	F	Bottle Filler		1.0	<1.0 ppb
52	(A)	F	East Set 2nd Fl. Dining Area-		1.0	N/A ppb
	(B)	F	Left- (inactive)		1.0	N/A ppb
53	(A)	F	East Set 2nd Fl. Dining Area-		1.0	N/A ppb
	(B)	F	Center (Inactive)		1.0	N/A ppb

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
54	(A)	F	East Set 2nd Fl. Dining Area-		1.0	N/A ppb
	(B)	F	Right (Inactive)		1.0	N/A ppb
55	(A)	F	2nd Floor Dining Area East-		1.0	<1.0 ppb
	(B)	F	Bottle Filler		1.0	<1.0 ppb
56	(A)	S	Clinic Sink		1.0	<1.0 ppb
	(B)	S	Clinic Sink		1.0	<1.0 ppb
57	(A)	F	O/S Exit Door 26- Left (Inactive)		1.0	N/A ppb
	(B)	F	O/S Exit Door 26- Left (Inactive)		1.0	N/A ppb
58	(A)	F	O/S Exit Door 26- Center (Inactive)		1.0	N/A ppb
	(B)	F	O/S Exit Door 26- Center (Inactive)		1.0	N/A ppb
59	(A)	F	O/S Exit Door 26- Right (Inactive)		1.0	N/A ppb
	(B)	F	O/S Exit Door 26- Right (Inactive)		1.0	N/A ppb
60	(A)	F	Library- Left		1.0	<1.0 ppb
	(B)	F	Library- Left		1.0	<1.0 ppb
61	(A)	F	Library- Right		1.0	<1.0 ppb
	(B)	F	Library- Right		1.0	<1.0 ppb
62	(A)	S	F102 Sink		1.0	<1.0 ppb
	(B)	S	F102 Sink		1.0	<1.0 ppb

Sample ID Coding Key:


F = Fountain

S = Sink


(A) = 1st Sample

(B) = 2nd Sample (30 Seconds Later)

(C) = 3rd Sample (3 Minutes Later)

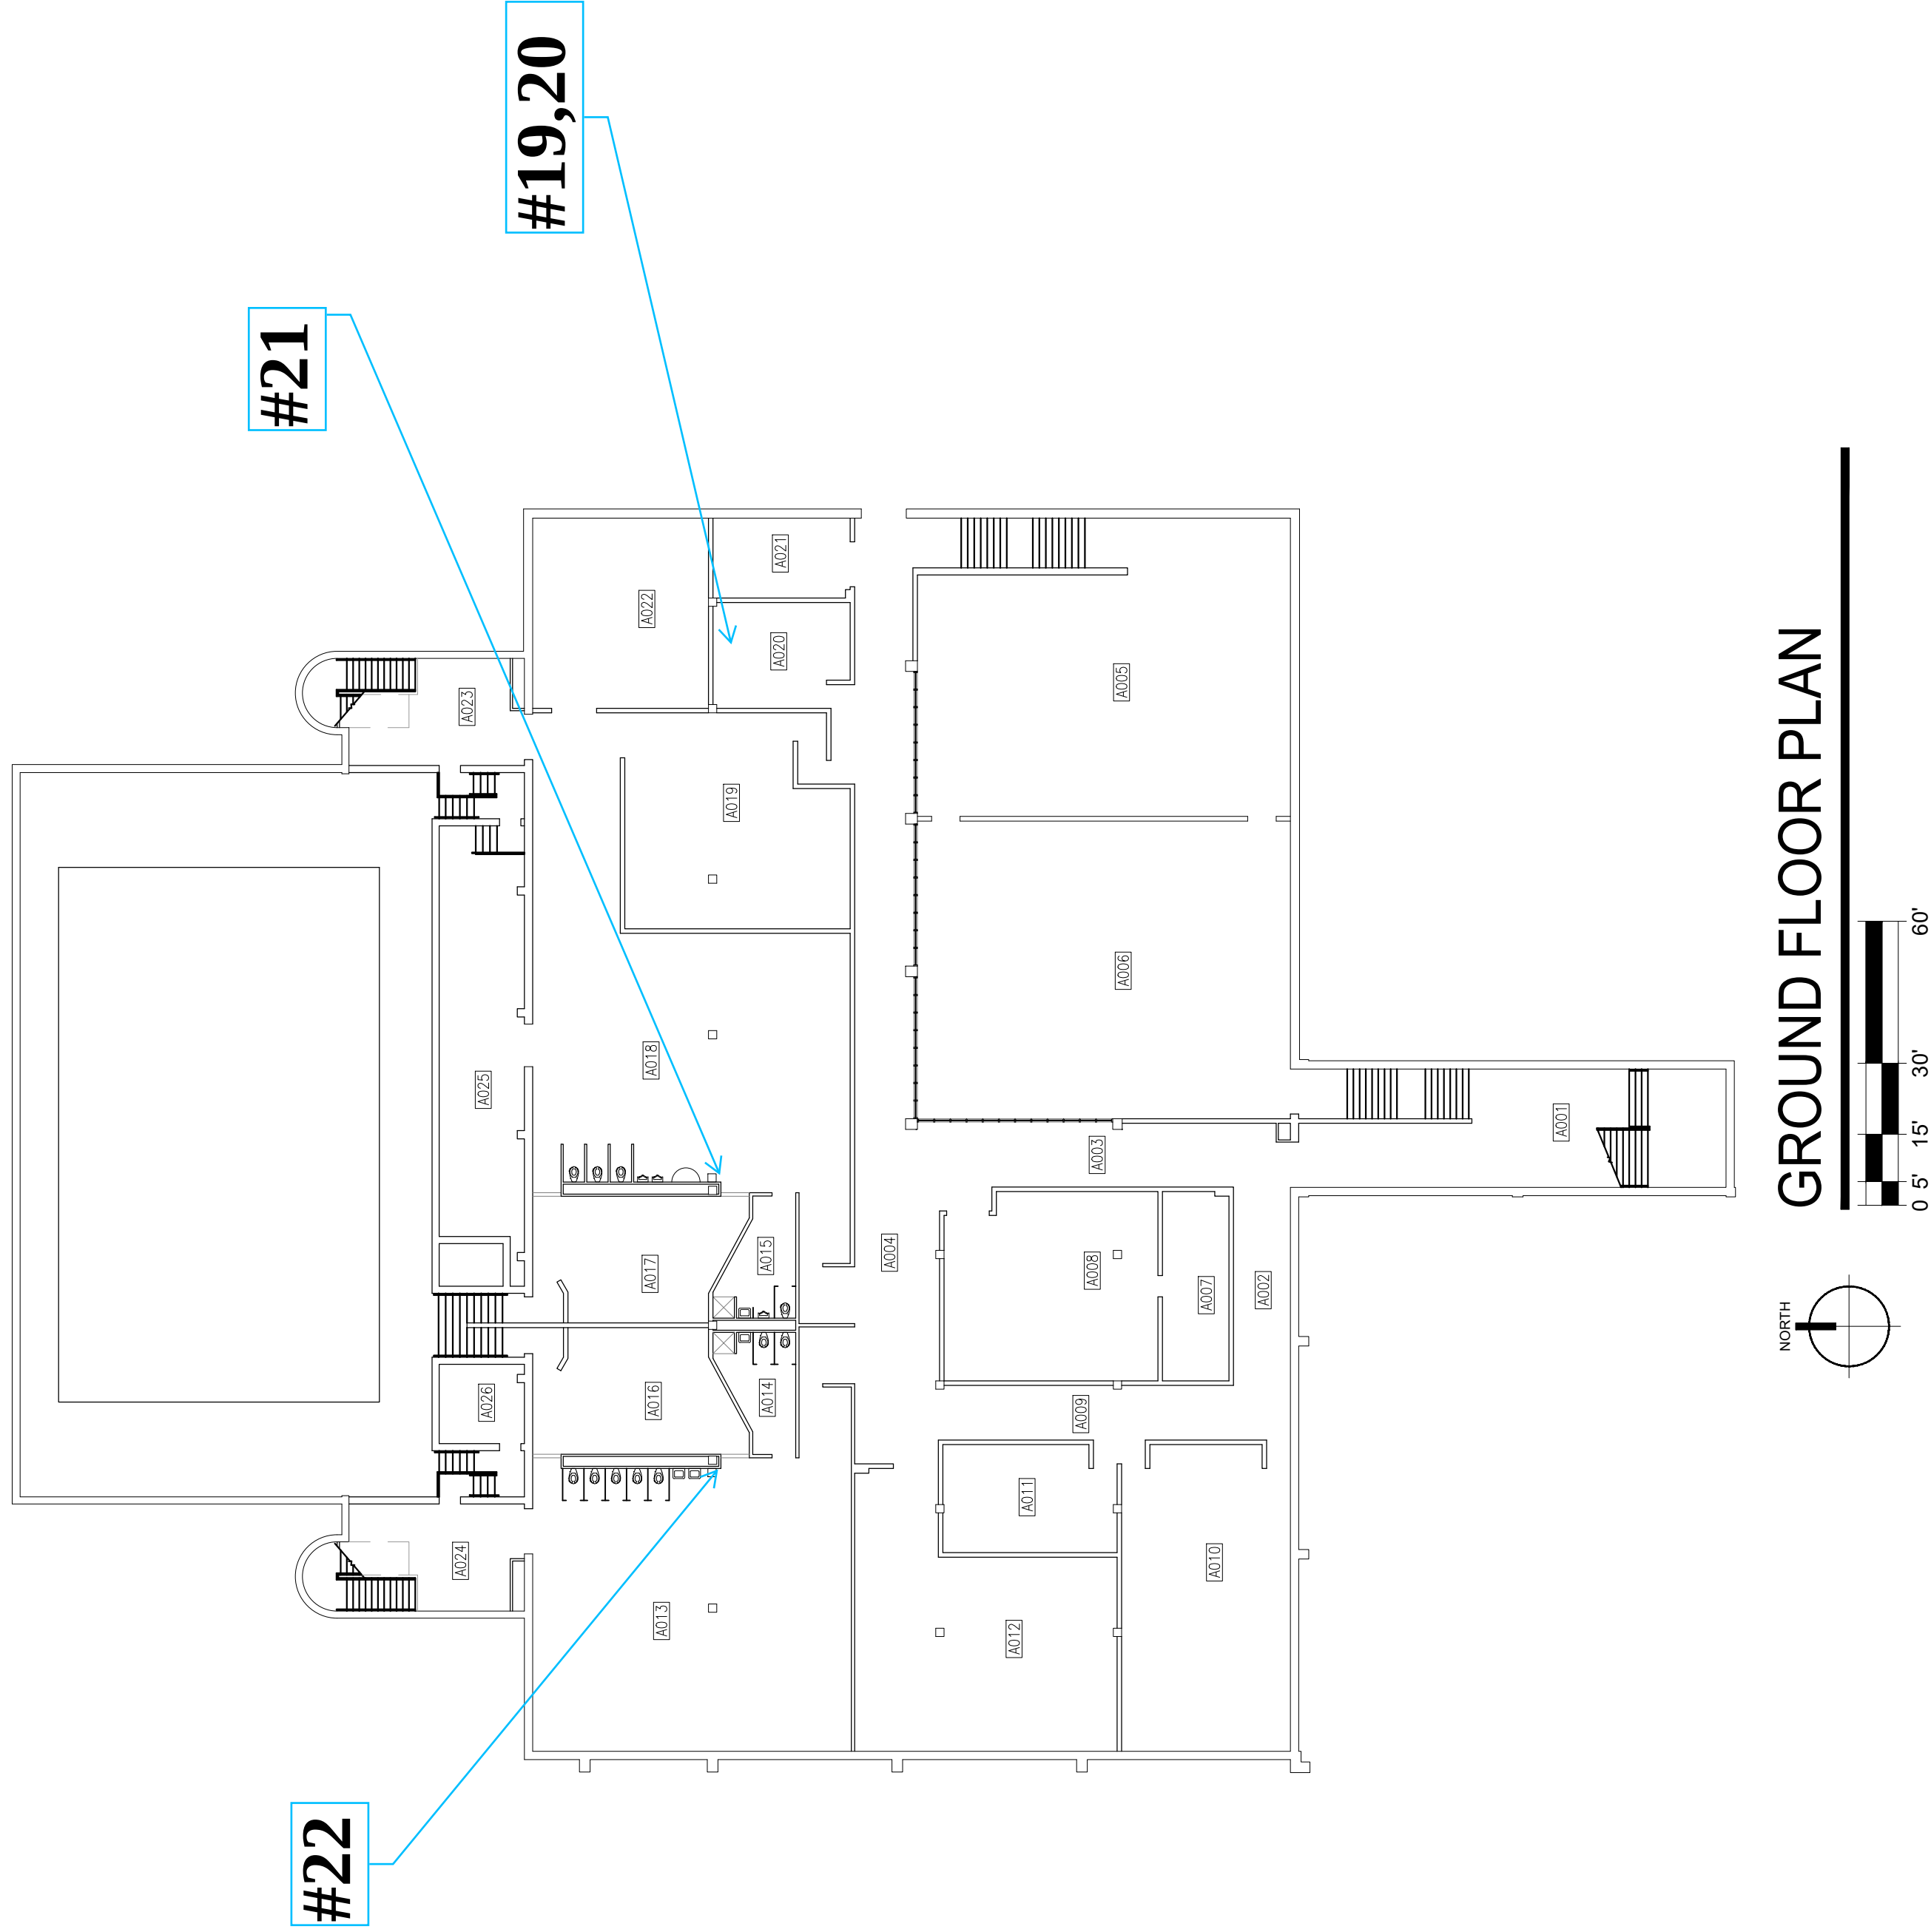


GROUND FLOOR PLAN

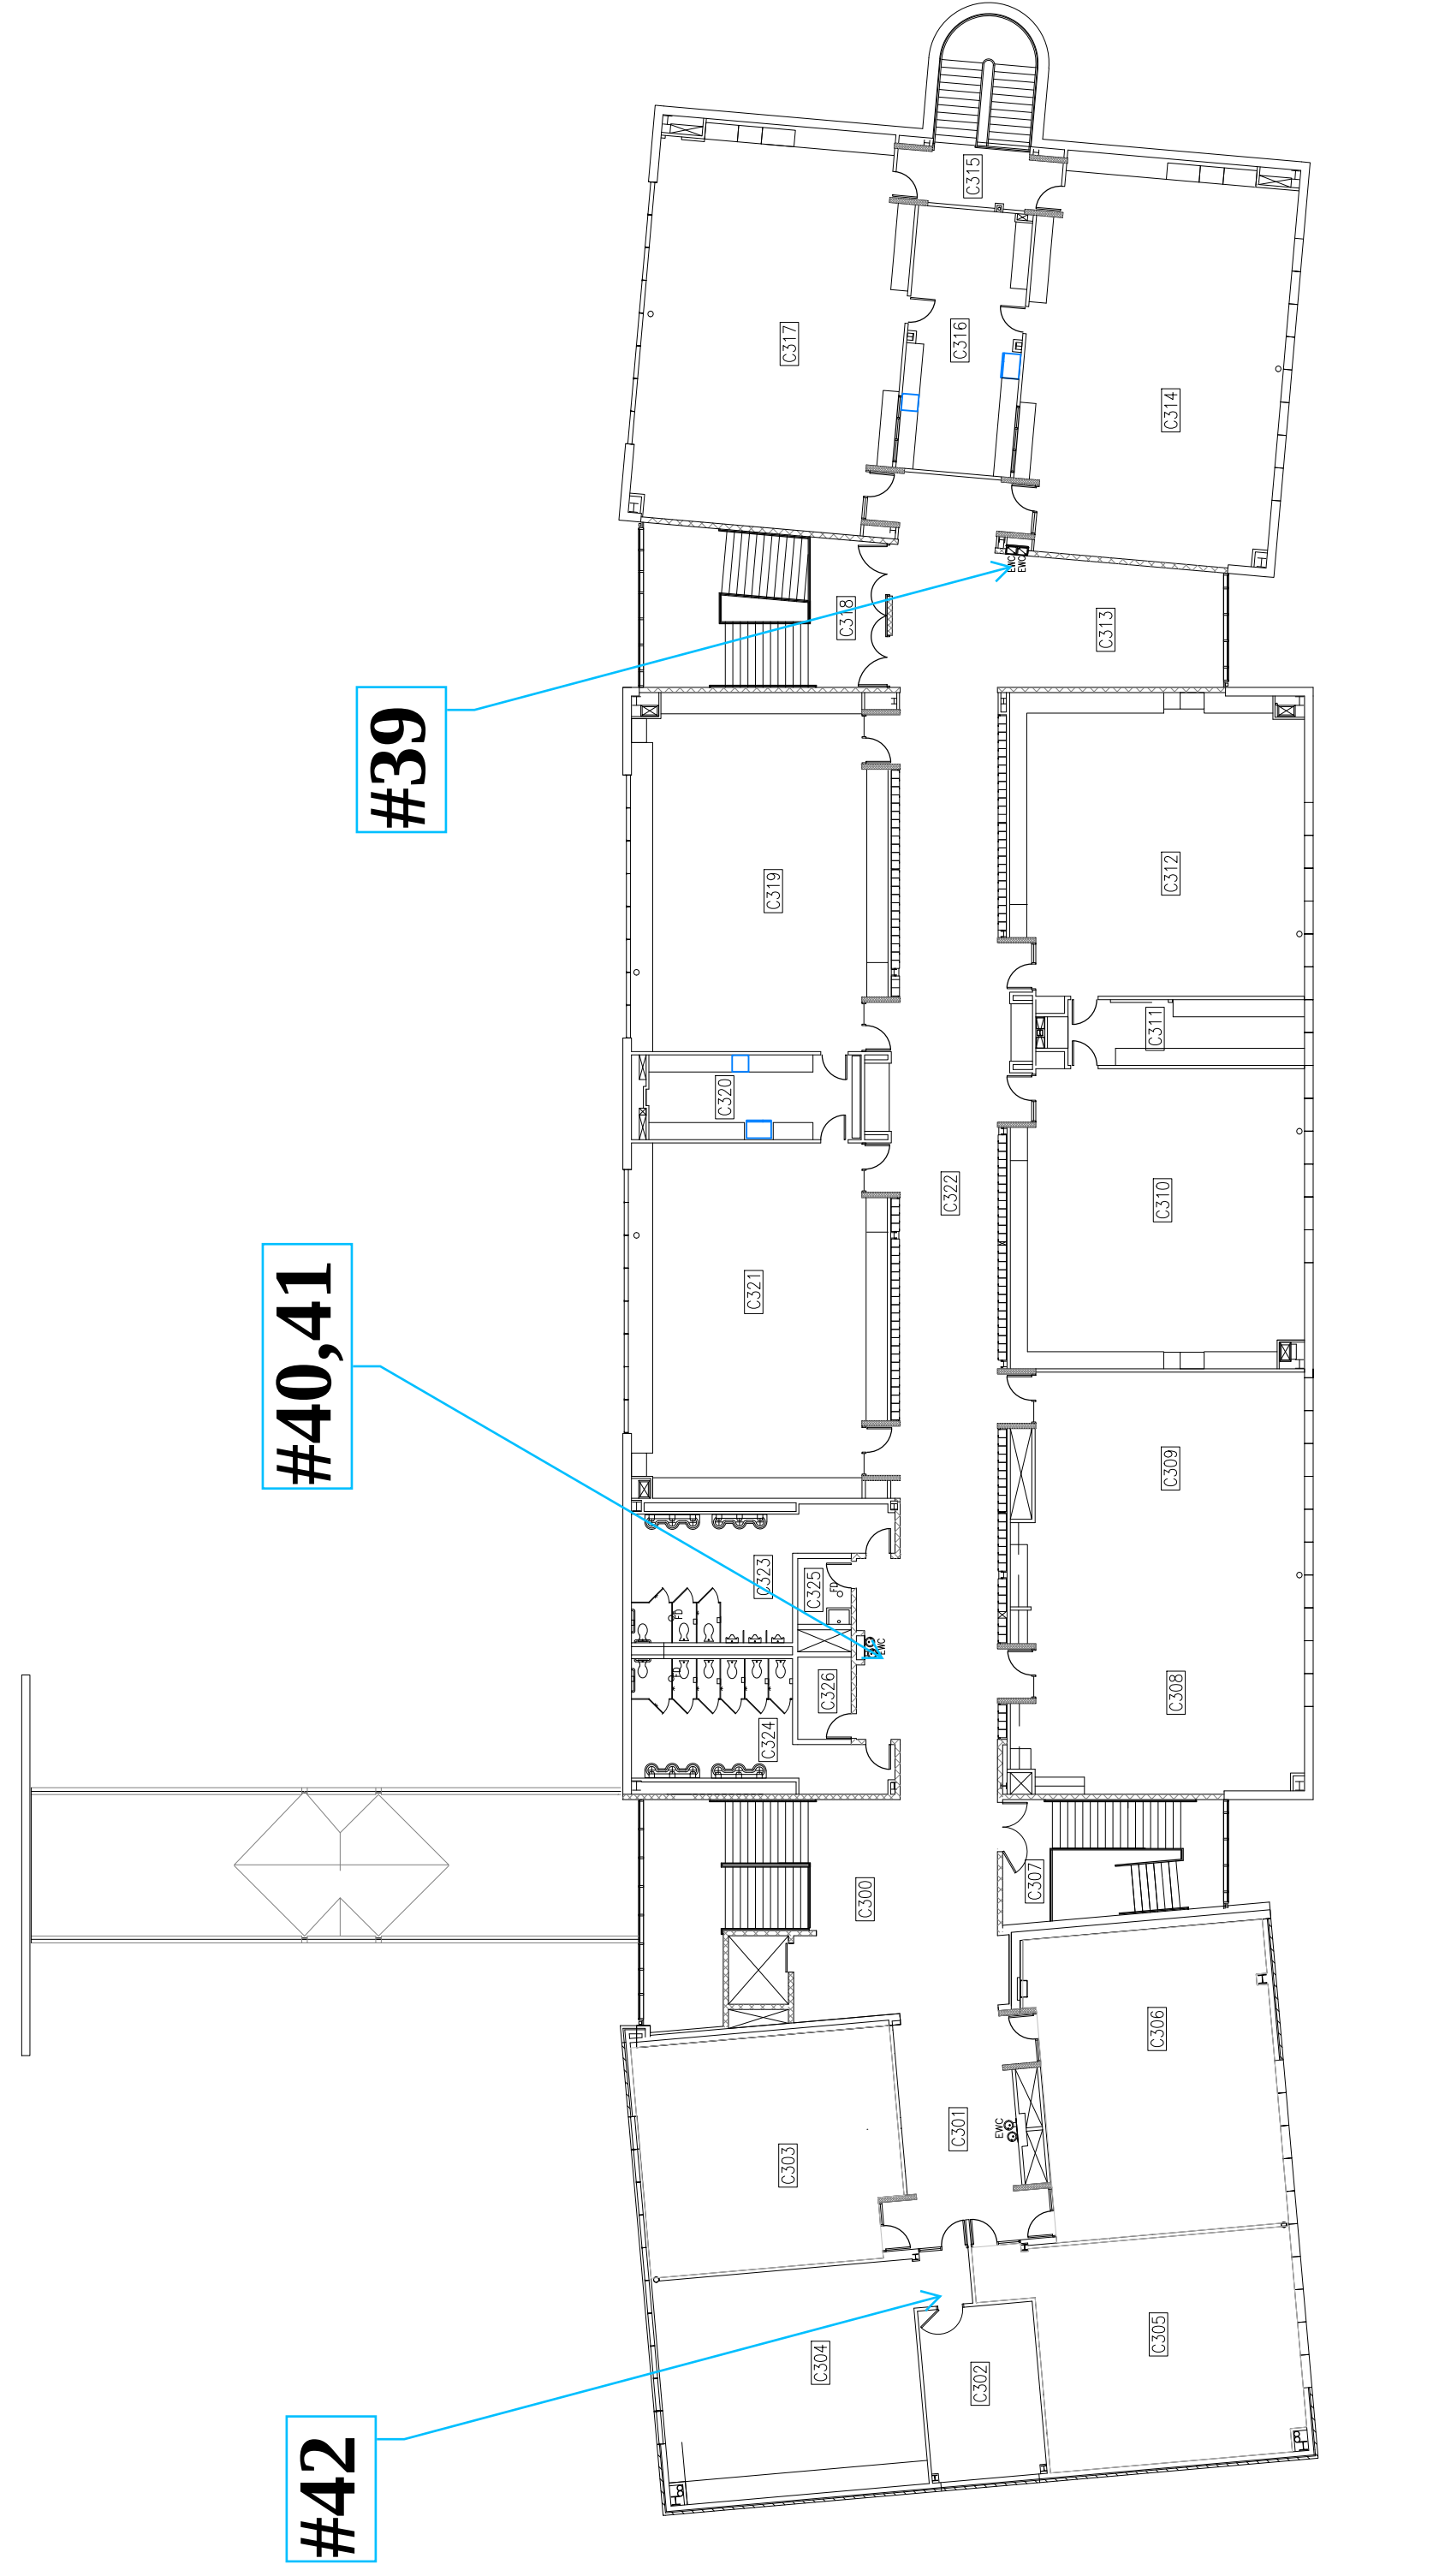

4TH FLOOR PLAN

EAST HIGH SCHOOL



HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI
21-100 03-09-2021

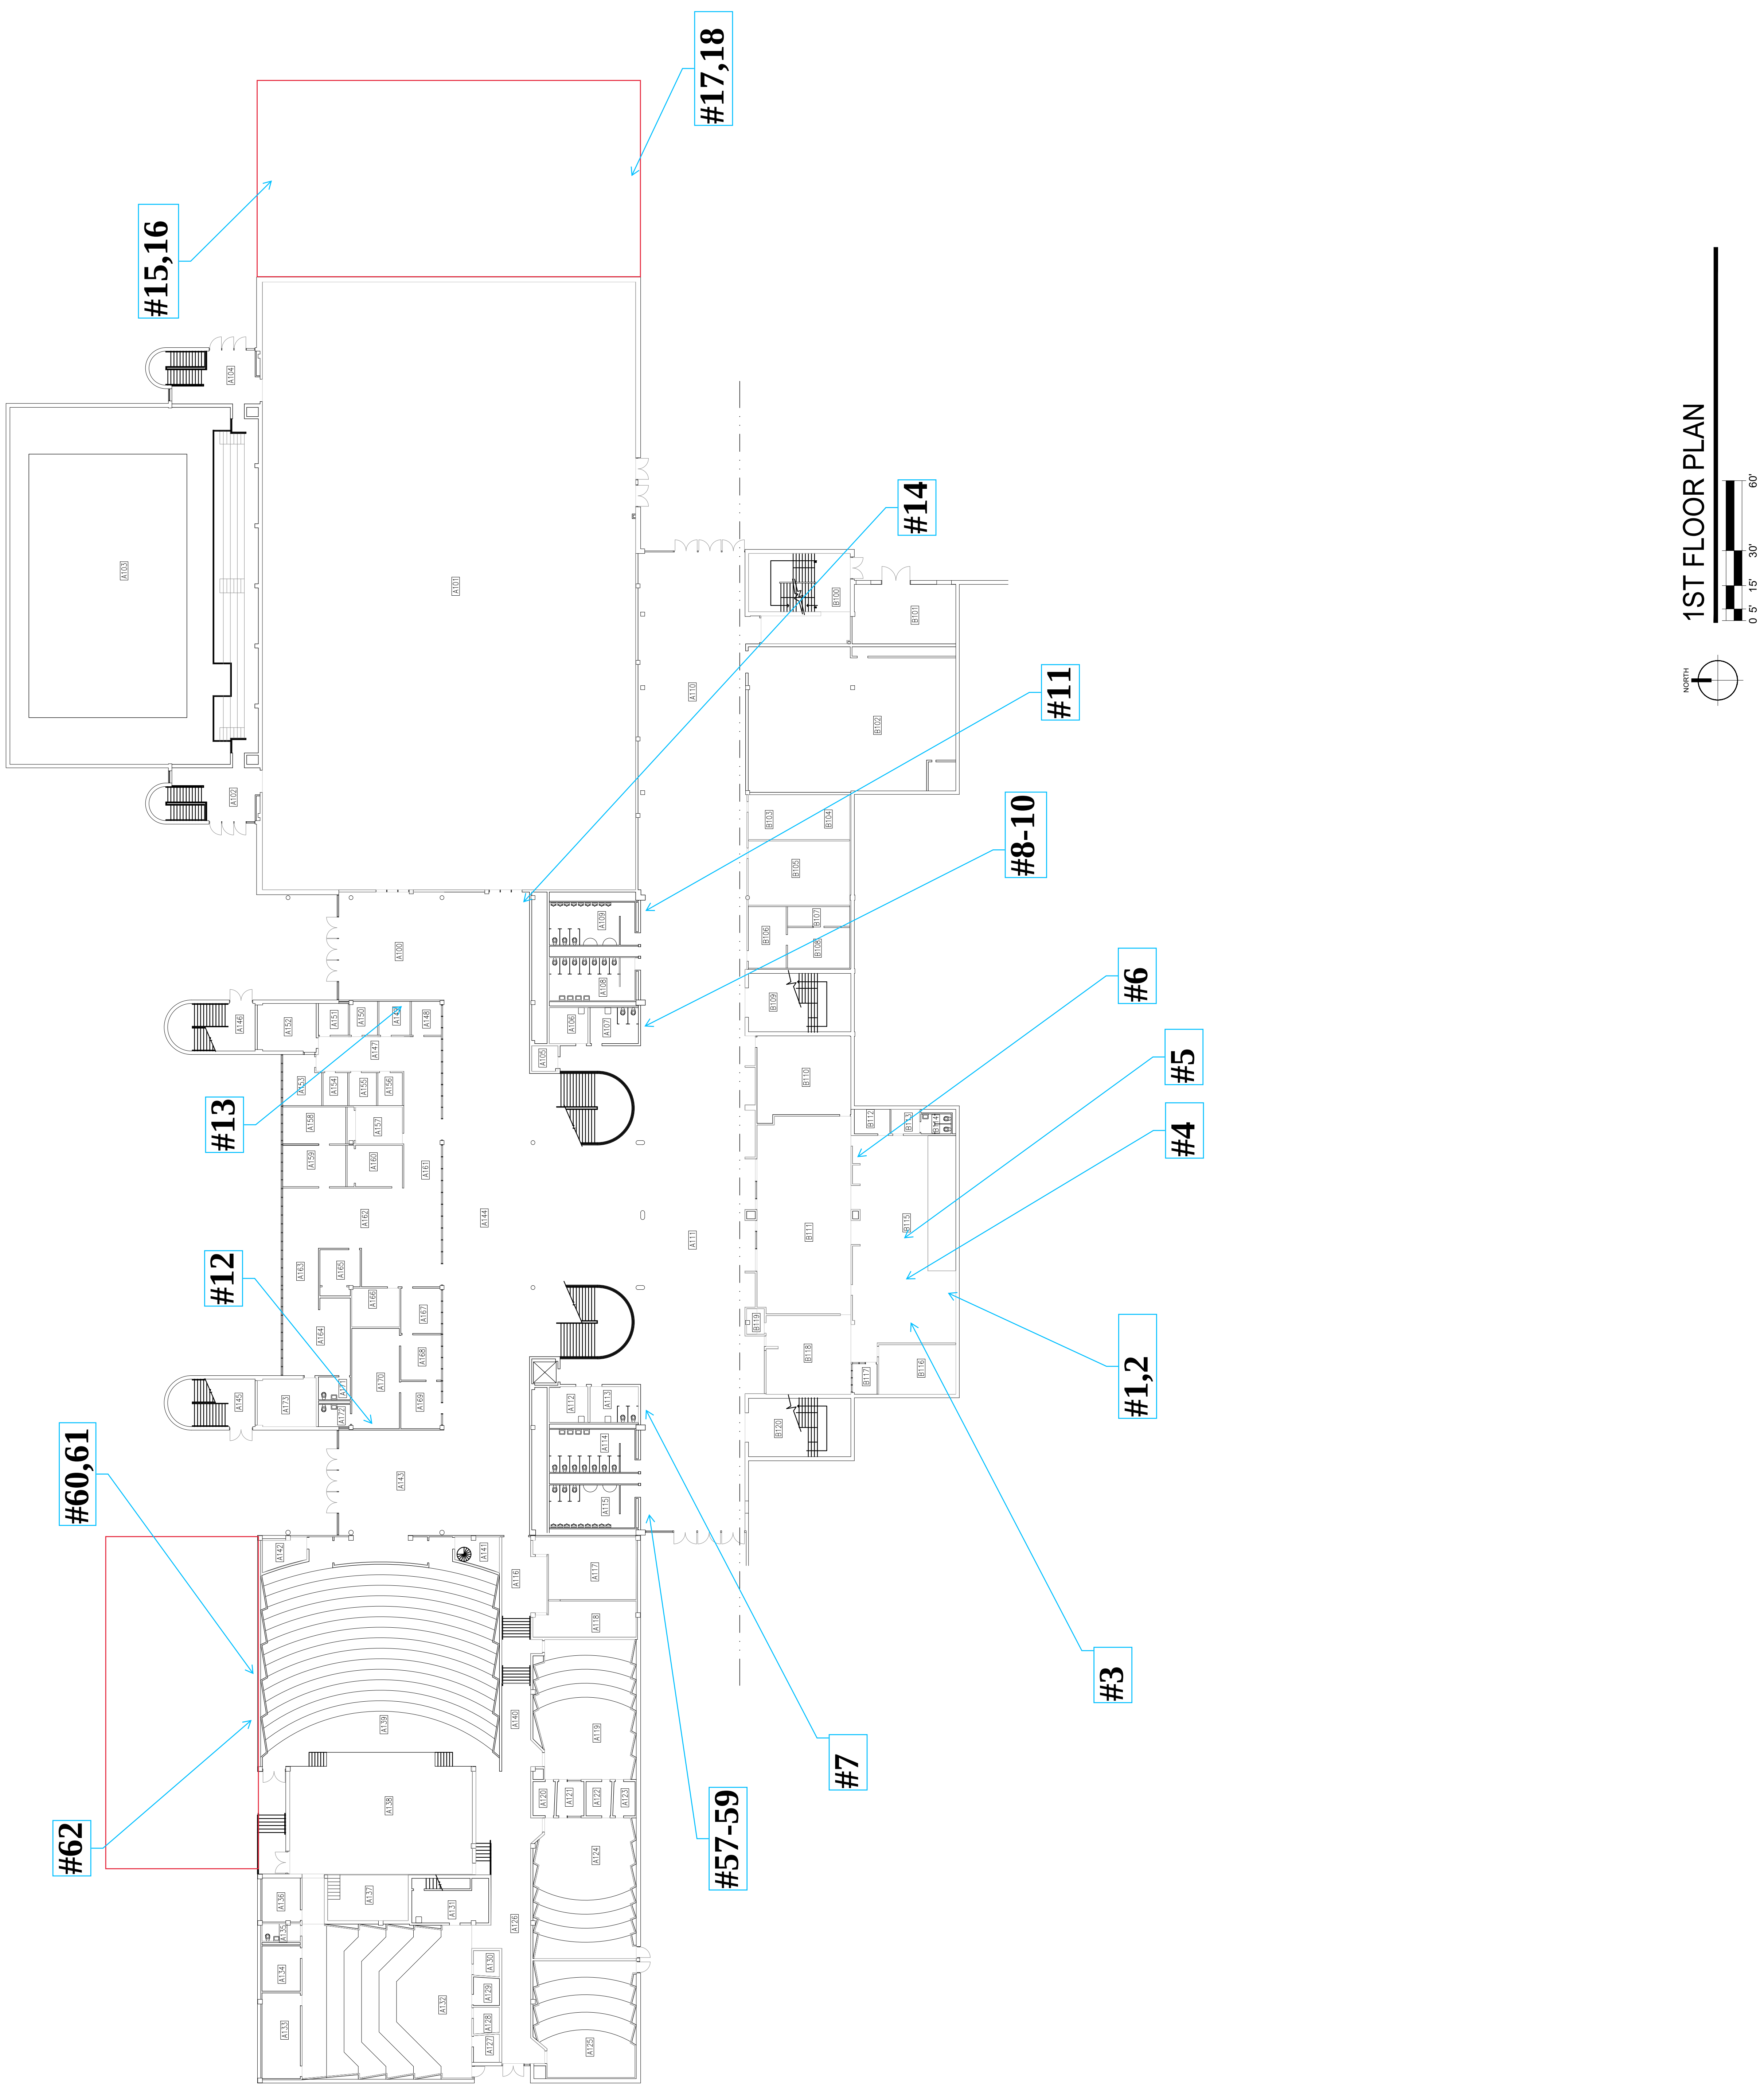


1ST FLOOR PLAN

EAST HIGH SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI
21-100
03-09-2021

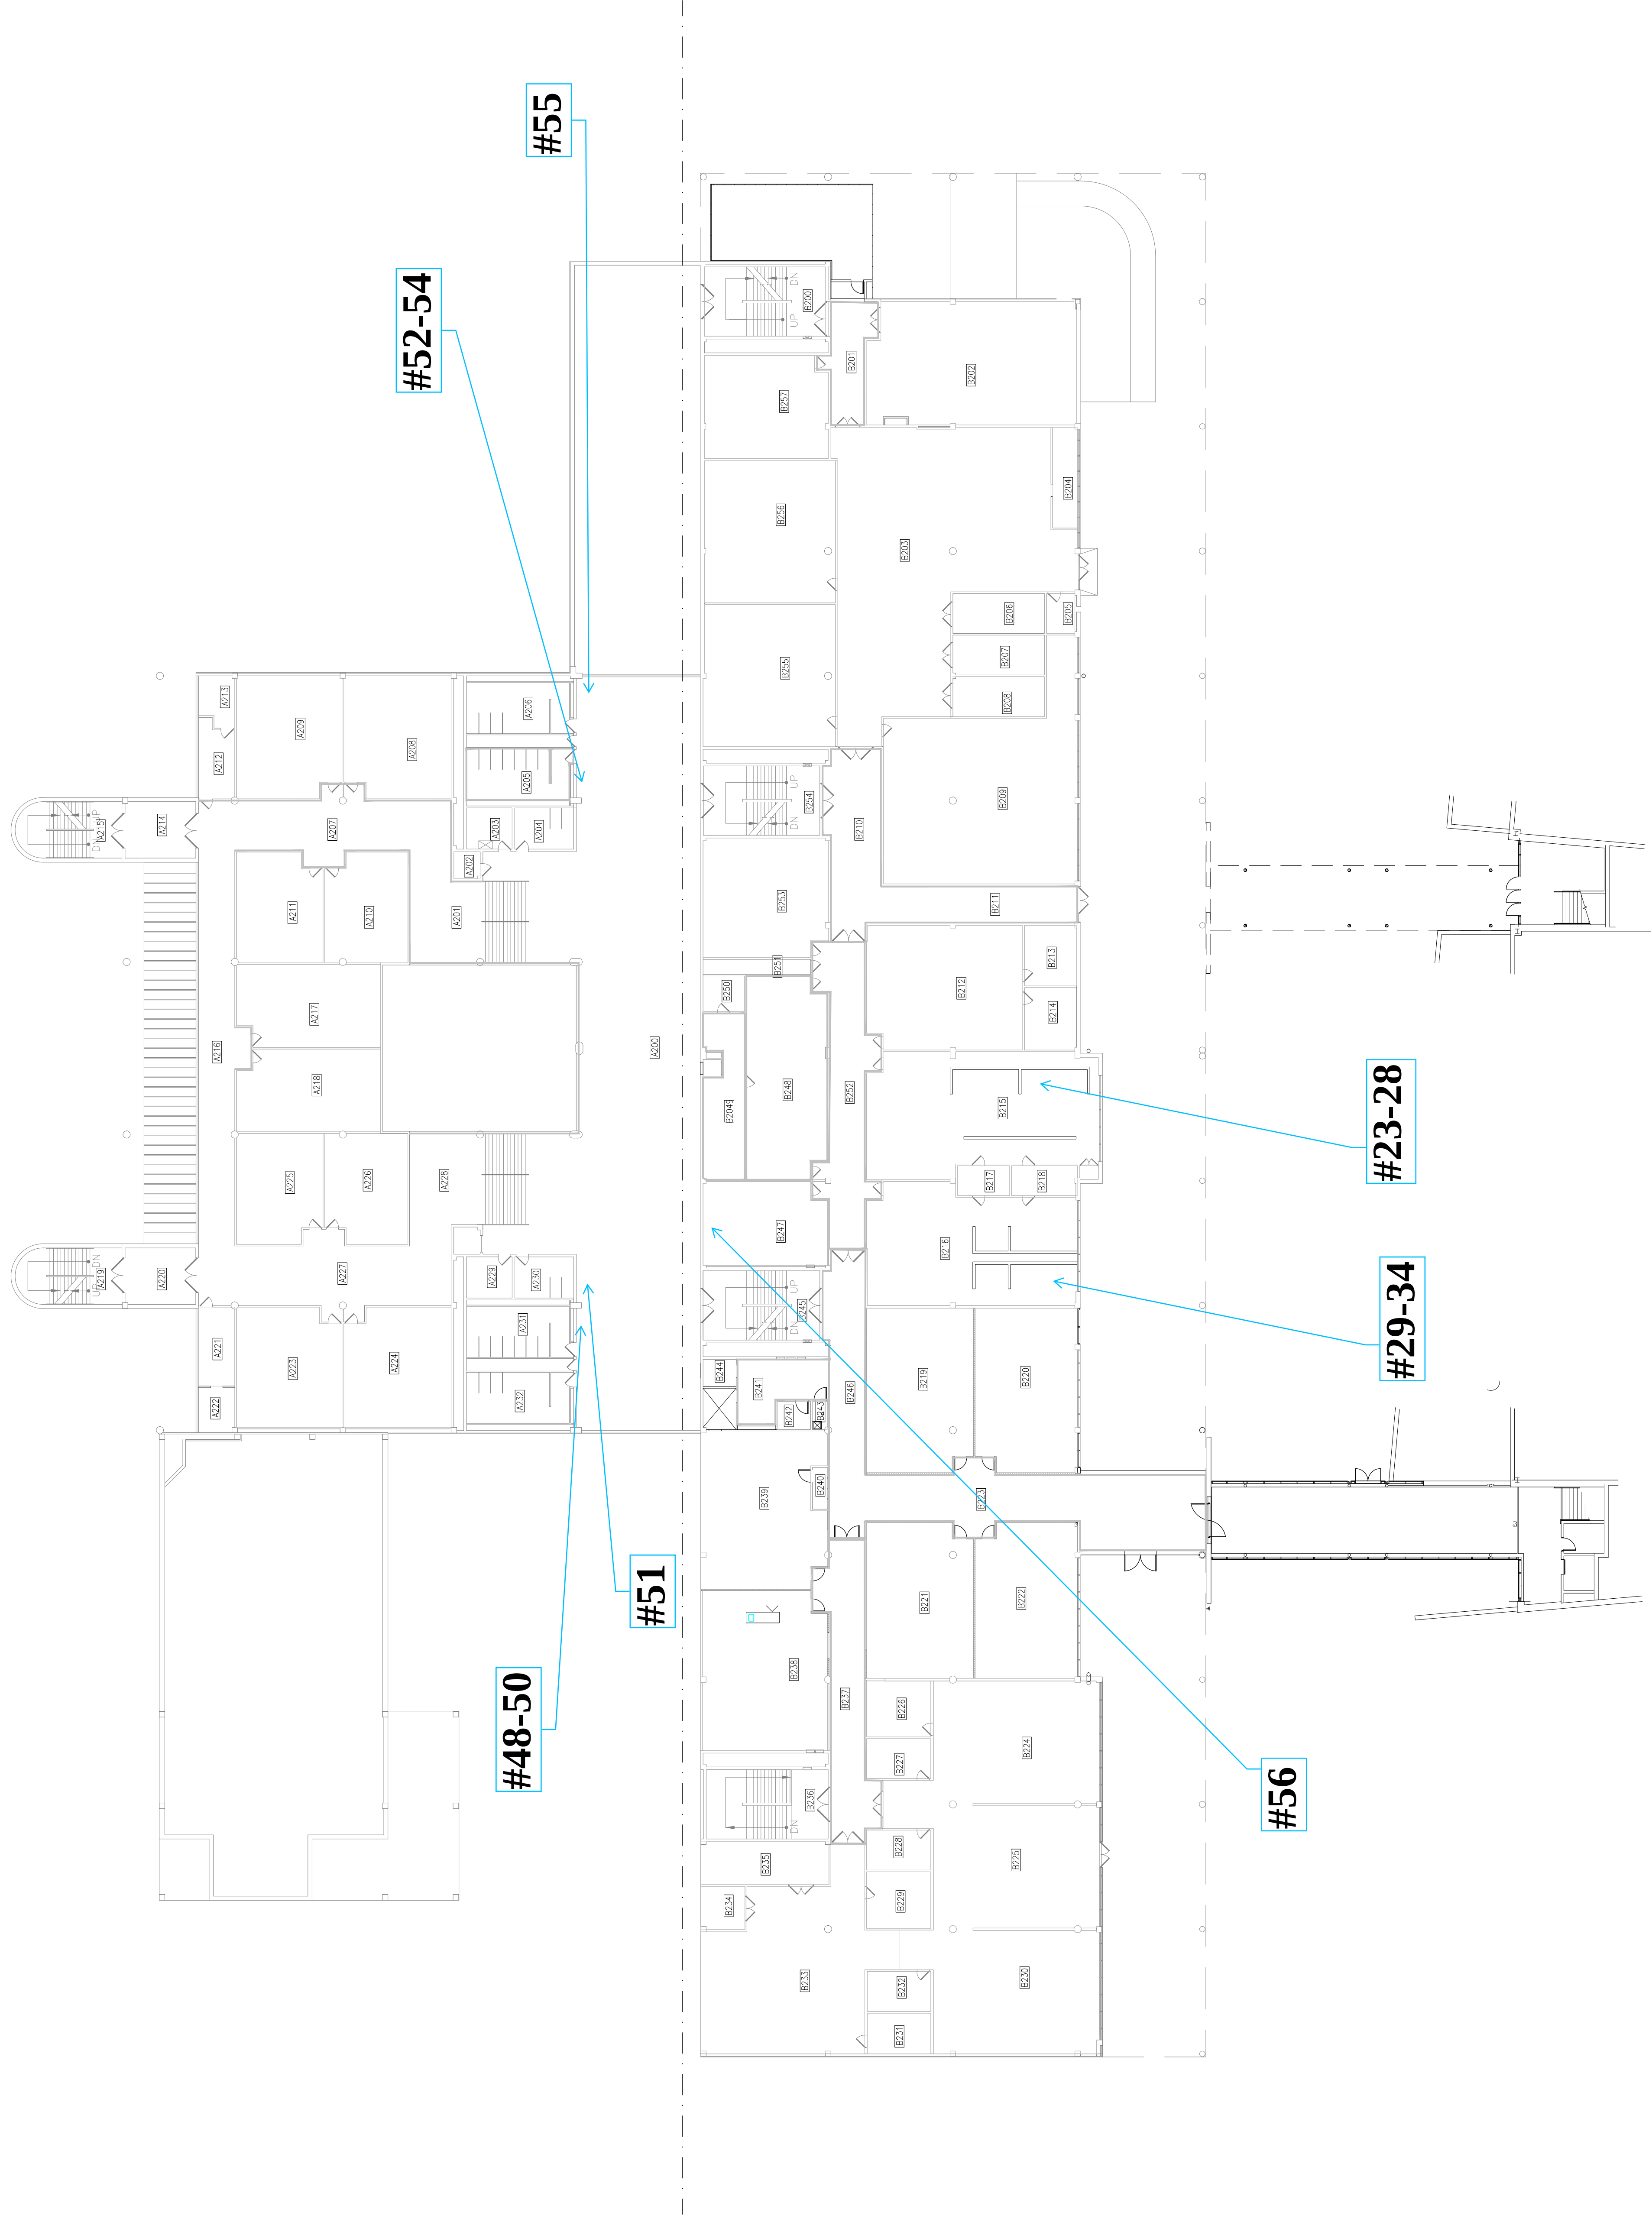

2ND FLOOR PLAN



EAST HIGH SCHOOL



EAST HIGH SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI
21-100
03-09-2021

APPENDIX B

LABORATORY ANALYSIS

September 12, 2023

Tony Hagerty
ENPAQ, LLC
3130 Gravois Ave
St. Louis, MO 63118
TEL: (314) 449-1976
FAX:



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

RE: Hazelwood SD/ 23-170 Hazelwood East HS

WorkOrder: 23072000

Dear Tony Hagerty:

TEKLAB, INC received 104 samples on 7/27/2023 3:55:00 PM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Marvin L. Darling
Project Manager
(618)344-1004 ex 41
mdarling@teklabinc.com

Client: ENPAQ, LLC

Work Order: 23072000

Client Project: Hazelwood SD/ 23-170 Hazelwood East HS

Report Date: 12-Sep-23

This reporting package includes the following:

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Receiving Check List	10
Chain of Custody	Appended

Client: ENPAQ, LLC

Work Order: 23072000

Client Project: Hazelwood SD/ 23-170 Hazelwood East HS

Report Date: 12-Sep-23

Abbr Definition

* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count (> 200 CFU)

Client: ENPAQ, LLC

Work Order: 23072000

Client Project: Hazelwood SD/ 23-170 Hazelwood East HS

Report Date: 12-Sep-23

Qualifiers

- | | |
|---|--|
| # - Unknown hydrocarbon | B - Analyte detected in associated Method Blank |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range |
| H - Holding times exceeded | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits | M - Manual Integration used to determine area response |
| ND - Not Detected at the Reporting Limit | R - RPD outside accepted recovery limits |
| S - Spike Recovery outside recovery limits | T - TIC(Tentatively identified compound) |
| X - Value exceeds Maximum Contaminant Level | |



Case Narrative

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23072000

Client Project: Hazelwood SD/ 23-170 Hazelwood East HS

Report Date: 12-Sep-23

Cooler Receipt Temp: NA °C

Locations

Collinsville

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email jhriley@teklabinc.com

Collinsville Air

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email EHurley@teklabinc.com

Springfield

Address 3920 Pintail Dr
Springfield, IL 62711-9415
Phone (217) 698-1004
Fax (217) 698-1005
Email KKlostermann@teklabinc.com

Chicago

Address 1319 Butterfield Rd.
Downers Grove, IL 60515
Phone (630) 324-6855
Fax
Email arenner@teklabinc.com

Kansas City

Address 8421 Nieman Road
Lenexa, KS 66214
Phone (913) 541-1998
Fax (913) 541-1998
Email jhriley@teklabinc.com

Client: ENPAQ, LLC**Work Order:** 23072000**Client Project:** Hazelwood SD/ 23-170 Hazelwood East HS**Report Date:** 12-Sep-23

State	Dept	Cert #	NELAP	Exp Date	Lab
Illinois	IEPA	100226	NELAP	1/31/2024	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2024	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2024	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2024	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2023	Collinsville
Arkansas	ADEQ	88-0966		3/14/2024	Collinsville
Illinois	IDPH	17584		5/31/2025	Collinsville
Iowa	IDNR	430		6/1/2024	Collinsville
Kentucky	UST	0073		1/31/2024	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23072000

Client Project: Hazelwood SD/ 23-170 Hazelwood East HS

Report Date: 12-Sep-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)									
Lead									
23072000-001A	01A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 2:33	07/27/2023 0:00
23072000-002A	01B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 2:37	07/27/2023 0:00
23072000-003A	02A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 2:40	07/27/2023 0:00
23072000-004A	02B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 2:44	07/27/2023 0:00
23072000-005A	03A	NELAP		1.0	1.2	µg/L	1	09/06/2023 2:48	07/27/2023 0:00
23072000-006A	03B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 2:51	07/27/2023 0:00
23072000-007A	04A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 3:13	07/27/2023 0:00
23072000-008A	04B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 3:17	07/27/2023 0:00
23072000-009A	05A	NELAP		1.0	5.7	µg/L	1	09/06/2023 3:20	07/27/2023 0:00
23072000-010A	05B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 3:24	07/27/2023 0:00
23072000-011A	06A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 3:28	07/27/2023 0:00
23072000-012A	06B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 3:31	07/27/2023 0:00
23072000-013A	07A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 3:35	07/27/2023 0:00
23072000-014A	07B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 3:39	07/27/2023 0:00
23072000-015A	11A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 3:42	07/27/2023 0:00
23072000-016A	11B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 3:57	07/27/2023 0:00
23072000-017A	12A	NELAP		1.0	< 1.0	µg/L	5	09/11/2023 12:37	07/27/2023 0:00
23072000-018A	12B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 4:01	07/27/2023 0:00
23072000-019A	13A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 4:12	07/27/2023 0:00
23072000-020A	13B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 4:15	07/27/2023 0:00
23072000-021A	14A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 11:47	07/27/2023 0:00
23072000-022A	14B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 11:51	07/27/2023 0:00
23072000-023A	15A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 11:54	07/27/2023 0:00
23072000-024A	15B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:05	07/27/2023 0:00
23072000-025A	16A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:10	07/27/2023 0:00
23072000-026A	16B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:14	07/27/2023 0:00
23072000-027A	17A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:29	07/27/2023 0:00
23072000-028A	17B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:32	07/27/2023 0:00
23072000-029A	18A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:36	07/27/2023 0:00
23072000-030A	18B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:40	07/27/2023 0:00
23072000-031A	19A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:43	07/27/2023 0:00
23072000-032A	19B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:47	07/27/2023 0:00
23072000-033A	20A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:51	07/27/2023 0:00
23072000-034A	20B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 12:54	07/27/2023 0:00
23072000-035A	22A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 13:16	07/27/2023 0:00
23072000-036A	22B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 13:20	07/27/2023 0:00
23072000-037A	23A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 13:24	07/27/2023 0:00
23072000-038A	23B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 13:27	07/27/2023 0:00
23072000-039A	24A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 13:31	07/27/2023 0:00
23072000-040A	24B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 13:34	07/27/2023 0:00
23072000-041A	25A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 13:38	07/27/2023 0:00
23072000-042A	25B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 13:42	07/27/2023 0:00
23072000-043A	26A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 13:45	07/27/2023 0:00
23072000-044A	26B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:07	07/27/2023 0:00
23072000-045A	27A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:11	07/27/2023 0:00
23072000-046A	27B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:15	07/27/2023 0:00
23072000-047A	28A	NELAP		1.0	10.6	µg/L	1	09/07/2023 14:18	07/27/2023 0:00
23072000-048A	28B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:22	07/27/2023 0:00



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23072000

Client Project: Hazelwood SD/ 23-170 Hazelwood East HS

Report Date: 12-Sep-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)									
Lead									
23072000-049A	29A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:26	07/27/2023 0:00
23072000-050A	29B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:29	07/27/2023 0:00
23072000-051A	30A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:33	07/27/2023 0:00
23072000-052A	30B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:37	07/27/2023 0:00
23072000-053A	31A	NELAP		1.0	2.0	µg/L	1	09/07/2023 14:51	07/27/2023 0:00
23072000-054A	31B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:55	07/27/2023 0:00
23072000-055A	32A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 14:59	07/27/2023 0:00
23072000-056A	32B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 15:10	07/27/2023 0:00
23072000-057A	33A	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 15:13	07/27/2023 0:00
23072000-058A	33B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 15:17	07/27/2023 0:00
23072000-059A	34A	NELAP		1.0	1.9	µg/L	5	09/05/2023 13:59	07/27/2023 0:00
23072000-060A	34B	NELAP		1.0	< 1.0	µg/L	1	09/07/2023 15:21	07/27/2023 0:00
23072000-061A	35A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 8:43	07/27/2023 0:00
23072000-062A	35B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 8:47	07/27/2023 0:00
23072000-063A	36A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 8:50	07/27/2023 0:00
23072000-064A	36B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:01	07/27/2023 0:00
23072000-065A	37A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:05	07/27/2023 0:00
23072000-066A	37B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:20	07/27/2023 0:00
23072000-067A	38A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:23	07/27/2023 0:00
23072000-068A	38B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:27	07/27/2023 0:00
23072000-069A	39A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:31	07/27/2023 0:00
23072000-070A	39B	NELAP		1.0	1.7	µg/L	1	09/06/2023 9:34	07/27/2023 0:00
23072000-071A	40A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:38	07/27/2023 0:00
23072000-072A	40B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:42	07/27/2023 0:00
23072000-073A	41A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:45	07/27/2023 0:00
23072000-074A	41B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:49	07/27/2023 0:00
23072000-075A	42A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 9:53	07/27/2023 0:00
23072000-076A	42B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 10:07	07/27/2023 0:00
23072000-077A	43A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 10:18	07/27/2023 0:00
23072000-078A	43B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 10:22	07/27/2023 0:00
23072000-079A	44A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 10:26	07/27/2023 0:00
23072000-080A	44B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 10:29	07/27/2023 0:00
23072000-081A	45A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 10:34	07/27/2023 0:00
23072000-082A	45B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 10:38	07/27/2023 0:00
23072000-083A	46A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 10:42	07/27/2023 0:00
23072000-084A	46B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 10:56	07/27/2023 0:00
23072000-085A	47A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:00	07/27/2023 0:00
23072000-086A	47B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:04	07/27/2023 0:00
23072000-087A	48A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:07	07/27/2023 0:00
23072000-088A	48B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:18	07/27/2023 0:00
23072000-089A	49A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:22	07/27/2023 0:00
23072000-090A	49B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:26	07/27/2023 0:00
23072000-091A	50A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:29	07/27/2023 0:00
23072000-092A	50B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:44	07/27/2023 0:00
23072000-093A	51A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:48	07/27/2023 0:00
23072000-094A	51B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:51	07/27/2023 0:00
23072000-095A	55A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:55	07/27/2023 0:00
23072000-096A	55B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 11:59	07/27/2023 0:00



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23072000

Client Project: Hazelwood SD/ 23-170 Hazelwood East HS

Report Date: 12-Sep-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)									
Lead									
23072000-097A	56A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 12:10	07/27/2023 0:00
23072000-098A	56B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 12:13	07/27/2023 0:00
23072000-099A	60A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 12:17	07/27/2023 0:00
23072000-100A	60B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 12:32	07/27/2023 0:00
23072000-101A	61A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 12:35	07/27/2023 0:00
23072000-102A	61B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 12:39	07/27/2023 0:00
23072000-103A	62A	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 12:50	07/27/2023 0:00
23072000-104A	62B	NELAP		1.0	< 1.0	µg/L	1	09/06/2023 12:54	07/27/2023 0:00



Receiving Check List

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23072000

Client Project: Hazelwood SD/ 23-170 Hazelwood East HS

Report Date: 12-Sep-23

Carrier: Anthony Hagerty

Received By: MBP

Completed by:

Reviewed by:

On:

On:

31-Jul-23

01-Aug-23

Allison Colin

Ellie Hopkins

Pages to follow: Chain of custody

Extra pages included

Shipping container/cooler in good condition?	Yes ☒	No ☐	Not Present ☐	Temp °C NA
Type of thermal preservation?	None ☒	Ice ☐	Blue Ice ☐	Dry Ice ☐
Chain of custody present?	Yes ☒	No ☐		
Chain of custody signed when relinquished and received?	Yes ☒	No ☐		
Chain of custody agrees with sample labels?	Yes ☒	No ☐		
Samples in proper container/bottle?	Yes ☒	No ☐		
Sample containers intact?	Yes ☒	No ☐		
Sufficient sample volume for indicated test?	Yes ☒	No ☐		
All samples received within holding time?	Yes ☒	No ☐		
Reported field parameters measured:	Field ☐	Lab ☐	NA ☒	
Container/Temp Blank temperature in compliance?	Yes ☒	No ☐		

When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.

Water – at least one vial per sample has zero headspace?	Yes ☐	No ☐	No VOA vials ☒
Water - TOX containers have zero headspace?	Yes ☐	No ☐	No TOX containers ☒
Water - pH acceptable upon receipt?	Yes ☒	No ☐	NA ☐
NPDES/CWA TCN interferences checked/treated in the field?	Yes ☐	No ☐	NA ☒

Any No responses must be detailed below or on the COC.

Samples were checked for turbidity and then preserved with nitric acid upon arrival in the laboratory.

CHAIN OF CUSTODY

Pg 1 of 11 Workorder # 23072000

TEKLAB INC. 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC		Samples on: ☐ ICE ☐ BLUE ICE ☒ NO ICE NA °C	
Address: 3130 Gravois Ave.		Preserved in: ☒ LAB ☐ FIELD FOR LAB USE ONLY TE Put	
City/State/Zip: Collinsville, IL 62234		LAB NOTES: No Sample For 28A/28B/33A/33B. Put 7/13	
Contact: Anthony Hagerty	Phone: (314) 449-1976		
Email: tony.hagerty@enpaqconsulting.com	Fax:	Client Comments: Please Report in PPB Hazelwood East HS	
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No			
Are these samples known to be hazardous? ☐ Yes ☒ No			
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No			
PROJECT NAME/NUMBER Hazelwood SD/ 23-170	SAMPLE COLLECTOR'S NAME Anthony Hagerty	# and Type of Containers	INDICATE ANALYSIS REQUESTED
RESULTS REQUESTED ☒ Standard ☐ 1-2 Day (100% Surcharge) ☐ Other ☐ 3 Day (50% Surcharge)		BILLING INSTRUCTIONS	
Lab Use Only	Sample ID	Date/Time Sampled	Matrix
03072000 001	01 A	7/27/23	Aqueous
002	01 B		Aqueous
003	02 A		Aqueous
004	02 B		Aqueous
005	03 A		Aqueous
006	03 B		Aqueous
007	04 A		Aqueous
008	04 B		Aqueous
009	05 A		Aqueous
010	05 B		Aqueous
			Aqueous
Relinquished By Anthony Hagerty		Date/Time 7/27/23	Received By Morgan Peltier
			Date/Time 7/27/23 1555

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.tekiabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg ___ of ___ Workorder # 23072000

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC				Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE _____ °C											
Address: 3130 Gravois Ave.				Preserved in: ☐ LAB ☐ FIELD <u>FOR LAB USE ONLY</u>											
City/State/Zip: Collinsville, IL 62234				LAB NOTES:											
Contact: Anthony Hagerty Phone: (314) 449-1976				Client Comments:											
Email: tony.hagerty@enpaqconsulting.com Fax:				Please Report in PPB											
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No				Hazelwood East HS											
Are these samples known to be hazardous? ☐ Yes ☒ No															
Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in the comment section: ☒ Yes ☐ No															
PROJECT NAME/NUMBER				SAMPLE COLLECTOR'S NAME				# and Type of Containers				INDICATE ANALYSIS REQUESTED			
Hazelwood SD/ 23-170				<i>Anthony Hagerty</i>											
RESULTS REQUESTED				BILLING INSTRUCTIONS				UNP							
☒ Standard ☐ 1-2 Day (100% Surcharge)								HNO3							
☐ Other ☐ 3 Day (50% Surcharge)								NaOH							
Lab Use Only		Sample ID		Date/Time Sampled		Matrix		H2SO4							
23072000 011		06 A		7/27/23		Aqueous		HCL							
012		06 B				Aqueous		MeOH							
013		07 A				Aqueous		NaHSO4							
014		07 B				Aqueous		TSP							
015		11 A				Aqueous		Other							
016		11 B				Aqueous									
017		12 A				Aqueous									
018		12 B				Aqueous									
019		13 A				Aqueous									
020		13 B				Aqueous									
						Aqueous									
Relinquished By				Date/Time				Received By				Date/Time			
<i>A Hagerty</i>				7/27/23				<i>Morgan Peterson</i>				7/27/23 1555			

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg ____ of ____ Workorder # 23072000

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: <u>ENPAQ, LLC</u>				Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE ☐ °C								
Address: <u>3130 Gravois Ave.</u>				Preserved in: ☐ LAB ☐ FIELD <u>FOR LAB USE ONLY</u>								
City/State/Zip: <u>Collinsville, IL 62234</u>				LAB NOTES:								
Contact: <u>Anthony Hagerty</u>		Phone: <u>(314) 449-1976</u>		Client Comments:								
Email: <u>tony.hagerty@enpaqconsulting.com</u>		Fax:		Please Report in PPB								
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No				<u>Hazelwood East HS</u>								
Are these samples known to be hazardous? ☐ Yes ☒ No												
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No												
PROJECT NAME/NUMBER		SAMPLE COLLECTOR'S NAME		# and Type of Containers		INDICATE ANALYSIS REQUESTED						
<u>Hazelwood SD/ 23-170</u>		<u>Anthony Hagerty</u>										
RESULTS REQUESTED		BILLING INSTRUCTIONS										
☒ Standard ☐ 1-2 Day (100% Surcharge)												
☐ Other ☐ 3 Day (50% Surcharge)												
Lab Use Only	Sample ID	Date/Time Sampled	Matrix	UNP	HNO3	NaOH	H2SO4	HCL	MeOH	NaHSO4	TSP	Other
<u>23072000 031</u>	<u>19A</u>	<u>7/27/23</u>	<u>Aqueous</u>	<u>X</u>								
<u>032</u>	<u>19B</u>		<u>Aqueous</u>	<u>X</u>								
<u>033</u>	<u>20A</u>		<u>Aqueous</u>	<u>X</u>								
<u>034</u>	<u>20B</u>		<u>Aqueous</u>	<u>X</u>								
<u>035</u>	<u>22A</u>		<u>Aqueous</u>	<u>X</u>								
<u>036</u>	<u>22B</u>		<u>Aqueous</u>	<u>X</u>								
<u>037</u>	<u>23A</u>		<u>Aqueous</u>	<u>X</u>								
<u>038</u>	<u>23B</u>		<u>Aqueous</u>	<u>X</u>								
<u>039</u>	<u>24A</u>		<u>Aqueous</u>	<u>X</u>								
<u>040</u>	<u>24B</u>		<u>Aqueous</u>	<u>X</u>								
Relinquished By		Date/Time		Received By		Date/Time						
<u>A. Hagerty</u>		<u>7/27/23</u>		<u>Morgan Pinner</u>		<u>7/27/23 1555</u>						

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg ____ of ____ Workorder # 73072000

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC				Samples on:	☐ ICE	☐ BLUE ICE	☐ NO ICE _____ °C
Address: 3130 Gravois Ave.				Preserved in:	☐ LAB	☐ FIELD	<u>FOR LAB USE ONLY</u>
City/State/Zip: Collinsville, IL 62234				LAB NOTES:			
Contact: Anthony Hagerty		Phone: (314) 449-1976		Client Comments:			
Email: tony.hagerty@enpaqconsulting.com		Fax:		Please Report in PPB Hazelwood East HS			
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No							
Are these samples known to be hazardous? ☐ Yes ☒ No							
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No							
PROJECT NAME/NUMBER Hazelwood SD/ 23-170		SAMPLE COLLECTOR'S NAME Anthony Hagerty		# and Type of Containers		INDICATE ANALYSIS REQUESTED	
RESULTS REQUESTED ☒ Standard ☐ 1-2 Day (100% Surcharge) ☐ Other ☐ 3 Day (50% Surcharge)		BILLING INSTRUCTIONS		UNP	HNO ₃	NaOH	H ₂ SO ₄
Lab Use Only	Sample ID	Date/Time Sampled	Matrix	HCL	MeOM	NaHSO ₄	TSP
23072000 041	25A	7/27/23	Aqueous	X			
042	25B	↓	Aqueous	X			
043	26A		Aqueous	X			
044	26B		Aqueous	X			
045	27A		Aqueous	X			
046	27B		Aqueous	X			
047	28A		Aqueous	K			
048	28B		Aqueous	X			
049	29A		Aqueous	X			
050	29B		Aqueous	X			
				Aqueous			
Relinquished By AHagerty		Date/Time 7/27/23		Received By Morgan Peter		Date/Time 7/27/23 SSS	

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg ___ of ___ Workorder # 13072000

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: <u>ENPAQ, LLC</u>				Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE _____ °C																	
Address: <u>3130 Gravois Ave.</u>				Preserved in: ☐ LAB ☐ FIELD <u>FOR LAB USE ONLY</u>																	
City/State/Zip: <u>Collinsville, IL 62234</u>				LAB NOTES:																	
Contact: <u>Anthony Hagerty</u> Phone: <u>(314) 449-1976</u>				Client Comments:																	
Email: <u>tony.hagerty@enpaqconsulting.com</u> Fax: _____				Please Report in PPB																	
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No				<u>Hazelwood East HS</u>																	
Are these samples known to be hazardous? ☐ Yes ☒ No																					
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No																					
PROJECT NAME/NUMBER		SAMPLE COLLECTOR'S NAME		# and Type of Containers																	
<u>Hazelwood SD/ 23-170</u>		<u>Anthony Hagerty</u>		INDICATE ANALYSIS REQUESTED																	
RESULTS REQUESTED		BILLING INSTRUCTIONS																			
☒ Standard ☐ 1-2 Day (100% Surcharge)		☐ Other ☐ 3 Day (50% Surcharge)																			
Lab Use Only		Sample ID	Date/Time Sampled	Matrix	UNP	HNO3	NaOH	H2SO4	HCL	MeOH	NaHSO4	TSP	Other								
<u>23072000 051</u>		<u>30A</u>	<u>7/27/23</u>	Aqueous	X																
<u>052</u>		<u>30B</u>	↓	Aqueous	X																
<u>053</u>		<u>31A</u>		Aqueous	X																
<u>054</u>		<u>31B</u>		Aqueous	X																
<u>055</u>		<u>32A</u>		Aqueous	X																
<u>056</u>		<u>32B</u>		Aqueous	X																
<u>057</u>		<u>33A</u>		Aqueous	X																
<u>058</u>		<u>33B</u>		Aqueous	X																
<u>059</u>		<u>34A</u>		Aqueous	X																
<u>060</u>		<u>34B</u>		Aqueous	X																
					Aqueous																
Relinquished By			Date/Time	Received By			Date/Time														
<u>A. Hagerty</u>			<u>7/27/23</u>	<u>Morgan Petre</u>			<u>7/27/23 1555</u>														

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC

Address: 3130 Gravois Ave.

City/State/Zip: Collinsville, IL 62234

Contact: Anthony Hagerty

Email: tony.hagerty@enpaqconsulting.com

Phone: (314) 449-1976

Fax:

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No

Are these samples known to be hazardous? ☐ Yes ☒ No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No

PROJECT NAME/NUMBER

Hazelwood SD/ 23-170

SAMPLE COLLECTOR'S NAME

Anthony Hagerty

RESULTS REQUESTED

☒ Standard ☐ 1-2 Day (100% Surcharge)
☐ Other ☐ 3 Day (50% Surcharge)

BILLING INSTRUCTIONS

Lab Use Only	Sample ID	Date/Time Sampled	Matrix
23072000 001	35A	7/27/23	Aqueous
002	35B		Aqueous
003	36A		Aqueous
004	36B		Aqueous
005	37A		Aqueous
006	37B		Aqueous
007	38A		Aqueous
008	38B		Aqueous
009	39A		Aqueous
070	39B	✓	Aqueous
			Aqueous

Relinquished By

Anthony Hagerty

Date/Time

7/27/23

Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE °C

Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY

LAB NOTES:

Client Comments:

Please Report in PPB

Hazelwood East HS

# and Type of Containers	INDICATE ANALYSIS REQUESTED
UNP	
HNO3	
NaOH	
H2SO4	
HCL	
MeOH	
NaHSO4	
TSP	
Other	

Received By

Morgan Peterson

Date/Time

7/27/23 1555

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg ____ of ____ Workorder # 13072000

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC				Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE _____ °C								
Address: 3130 Gravois Ave.				Preserved in: ☐ LAB ☐ FIELD <u>FOR LAB USE ONLY</u>								
City/State/Zip: Collinsville, IL 62234				LAB NOTES:								
Contact: Anthony Hagerty		Phone: (314) 449-1976		Client Comments:								
Email: tony.hagerty@enpaqconsulting.com		Fax:		Please Report in PPB								
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No				Hazelwood East HS								
Are these samples known to be hazardous? ☐ Yes ☒ No												
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No												
PROJECT NAME/NUMBER Hazelwood SD/ 23-170		SAMPLE COLLECTOR'S NAME <i>Anthony Hagerty</i>		# and Type of Containers		INDICATE ANALYSIS REQUESTED						
RESULTS REQUESTED		BILLING INSTRUCTIONS										
☒ Standard ☐ Other _____		☐ 1-2 Day (100% Surcharge) ☐ 3 Day (50% Surcharge)										
Lab Use Only	Sample ID	Date/Time Sampled	Matrix	UNP	HNO3	NaOH	H2SO4	HCL	MeOH	NaHSO4	TSP	Other
2307200 071	40A	7/27/23	Aqueous	X								
072	40B	↓	Aqueous	X								
073	41A		Aqueous	X								
074	41B		Aqueous	X								
075	42A		Aqueous	X								
076	42B		Aqueous	X								
077	43A		Aqueous	X								
078	43B		Aqueous	X								
079	44A		Aqueous	X								
080	44B		Aqueous	X								
				Aqueous								
Relinquished By <i>A. Hagerty</i>		Date/Time 7/27/23		Received By <i>Morgan Perich</i>				Date/Time 7/27/23 1555				

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg ___ of ___ Workorder # 73072000

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC			
Address: 3130 Gravois Ave.			
City/State/Zip: Collinsville, IL 62234			
Contact: Anthony Hagerty		Phone: (314) 449-1976	
Email: tony.hagerty@enpaqconsulting.com		Fax:	
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No Are these samples known to be hazardous? ☐ Yes ☒ No Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No			
PROJECT NAME/NUMBER Hazelwood SD/ 23-170		SAMPLE COLLECTOR'S NAME <i>Anthony Hagerty</i>	
RESULTS REQUESTED ☒ Standard ☐ 1-2 Day (100% Surcharge) ☐ Other ☐ 3 Day (50% Surcharge)		BILLING INSTRUCTIONS	
Lab Use Only	Sample ID	Date/Time Sampled	Matrix
23072000 081	45A	7/27/23	Aqueous
082	45B		Aqueous
083	46 A		Aqueous
084	46 B		Aqueous
085	47 A		Aqueous
086	47B		Aqueous
087	48A		Aqueous
088	48B		Aqueous
089	49A		Aqueous
090	49B		Aqueous
Relinquished By <i>A Hagerty</i>		Date/Time 7/27/23	
Received By <i>Morgan Petter</i>		Date/Time 7/27/23 SS	

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg ____ of ____ Workorder # 23572000

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ. LLC			
Address: 3130 Gravois Ave.			
City/State/Zip: Collinsville, IL 62234			
Contact: Anthony Hagerty		Phone: (314) 449-1976	
Email: tony.hagerty@enpaqconsulting.com		Fax:	
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No			
Are these samples known to be hazardous? ☐ Yes ☒ No			
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No			
PROJECT NAME/NUMBER Hazelwood SD/ 23-170		SAMPLE COLLECTOR'S NAME <i>Anthony Hagerty</i>	
RESULTS REQUESTED ☒ Standard ☐ 1-2 Day (100% Surcharge) ☐ Other _____ ☐ 3 Day (50% Surcharge)		BILLING INSTRUCTIONS	
Lab Use Only	Sample ID	Date/Time Sampled	Matrix
23072000 091	50 A	7/27/23	Aqueous
092	50 B	↓	Aqueous
093	51A		Aqueous
094	51B		Aqueous
095	55A		Aqueous
096	55B		Aqueous
097	56A		Aqueous
098	56B		Aqueous
099	60A		Aqueous
100	60B		Aqueous
Relinquished By <i>A. Hagerty</i>		Date/Time 7/27/23	
Received By <i>Maryann Perton</i>		Date/Time 7/27/23 1555	

Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE °C
Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY
LAB NOTES:
Client Comments:
Please Report in PPB
Hazelwood East HS

# and Type of Containers	INDICATE ANALYSIS REQUESTED
UNP	
HNO ₃	
NaOH	
H ₂ SO ₄	
HCL	
MeOH	
NaHSO ₄	
TSP	
Other	

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg ____ of ____ Workorder # 23072000

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

[illegible]

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions



ENPAQ, LLC

Prep Day: 7/26/23

Sample Day: 7/27/23

To Lab -----> 7/27/23

* Reporting Limit

to Test = _____
 # Disabled = _____
 # of Samples = _____
 # > 10.0 ppb = _____
 # > 0.5 ppb = _____

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
01	(A)	S	Kitchen 3 Bay- Left		1.0	ppb
	(B)	S	Kitchen 3 Bay- Left		1.0	ppb
	(C)				1.0	ppb
02	(A)	S	Kitchen 3 Bay- Right		1.0	ppb
	(B)	S	Kitchen 3 Bay- Right		1.0	ppb
03	(A)	S	Kitchen 2 Bay Prep- Salad Station		1.0	ppb
	(B)	S	Kitchen 2 Bay Prep- Salad Station		1.0	ppb
04	(A)	S	Kitchen 1 Bay Prep- Fries Station		1.0	ppb
	(B)	S	Kitchen 1 Bay Prep- Fries Station		1.0	ppb
05	(A)	S	Pot Filler		1.0	ppb
	(B)	S	Pot Filler		1.0	ppb
06	(A)	S	Kitchen Rinse Off Station		1.0	ppb
	(B)	S	Kitchen Rinse Off Station		1.0	ppb
07	(A)	F	O/S Exit Door 26- Bottle Filler		1.0	ppb
	(B)	F	O/S Exit Door 26- Bottle Filler		1.0	ppb
08	(A)	F	O/S Activities Office- Left		1.0	ppb
	(B)	F	(Inactive)		1.0	ppb
09	(A)	F	O/S Activities Office - Center		1.0	ppb
	(B)	F	(Inactive)		1.0	ppb
10	(A)	F	O/S Activities Office- Right		1.0	ppb
	(B)	F	(Inactive)		1.0	ppb
11	(A)	F	Fountain O/S Mens RR by Activities		1.0	ppb
	(B)	F	Office		1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
12	(A)	S	Nurses Room		1.0	ppb
	(B)	S	Nurses Room		1.0	ppb
13	(A)	S	Rm B101, Front Office Work Room		1.0	ppb
	(B)	S	Rm B101, Front Office Work Room		1.0	ppb
14	(A)	F	Gym- Main Gym		-	ppb
	(B)	F	Gym- Main Gym		-	ppb
15	(A)	F	Small East Gym O/S Womens		1.0	ppb
	(B)	F	Locker Rm- Left		1.0	ppb
16	(A)	F	Small East Gym O/S Womens		1.0	ppb
	(B)	F	Locker Rm- Right		1.0	ppb
17	(A)	F	Small East Gym O/S Mens Locker		1.0	ppb
	(B)	F	Rm- Left		1.0	ppb
18	(A)	F	Small East Gym O/S Mens Locker		1.0	ppb
	(B)	F	Rm- Right		1.0	ppb
19	(A)	S	A013 Sink		1.0	ppb
	(B)	S	A013 Sink		1.0	ppb
20	(A)	I	A013 Ice Machine		1.0	ppb
	(B)	I	A013 Ice Machine		1.0	ppb
21	(A)	F	Boys Locker Room- Ground Level		1.0	ppb
	(B)	F	(Inactive)		1.0	ppb
22	(A)	F	Girls Locker Room- Ground Level		1.0	ppb
	(B)	F	Girls Locker Room- Ground Level		1.0	ppb
23	(A)	S	Room C216 Station 1		1.0	ppb
	(B)	S	Room C216 Station 1		1.0	ppb
24	(A)	S	Room C216 Station 2		1.0	ppb
	(B)	S	Room C216 Station 2		1.0	ppb
25	(A)	S	Room C216 Station 3		1.0	ppb
	(B)	S	Room C216 Station 3		1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
--------	-------------	-------------	-----------------	--------------	------	------------------

125072000

26	(A)	S	Room C216 Station 4	1.0	ppb
	(B)	S	Room C216 Station 4	1.0	ppb
27	(A)	S	Room C216 Station 5	1.0	ppb
	(B)	S	Room C216 Station 5	1.0	ppb
28	(A)	S	Room C216 Station 6	1.0	ppb
	(B)	S	Room C216 Station 6	1.0	ppb
29	(A)	S	Room C215 Station 1	-	ppb
	(B)	S	Room C215 Station 1	-	ppb
30	(A)	S	Room C215 Station 2	-	ppb
	(B)	S	Room C215 Station 2	-	ppb
31	(A)	S	Room C215 Station 3	2.0	ppb
	(B)	S	Room C215 Station 3	1.0	ppb
32	(A)	S	Room C215 Station 4	-	ppb
	(B)	S	Room C215 Station 4	-	ppb
33	(A)	S	Room C215 Station 5	1.0	ppb
	(B)	S	Room C215 Station 5	1.0	ppb
34	(A)	S	Room C215 Station 6	1.0	ppb
	(B)	S	Room C215 Station 6	1.0	ppb
35	(A)	F	Fountain O/S D102	1.0	ppb
	(B)	F	Fountain O/S D102	1.0	ppb
36	(A)	F	Fountain O/S D110 by RR	1.0	ppb
	(B)	F	Fountain O/S D110 by RR	1.0	ppb
37	(A)	F	Fountain O/S D107- Left	1.0	ppb
	(B)	F	Fountain O/S D107- Left	1.0	ppb
38	(A)	F	Fountain O/S D107- Right	1.0	ppb
	(B)	F	Fountain O/S D107- Right	1.0	ppb
39	(A)	F	Fountain O/S D207	1.0	ppb
	(B)	F	Fountain O/S D207	1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
40	(A)	F	Fountain O/S D204- Left		1.0	ppb

23072000

	(B)	F	Fountain O/S D204- Left	1.0	ppb
41	(A)	F	Fountain O/S D204- Right	1.0	ppb
	(B)	F	Fountain O/S D204- Right	1.0	ppb
42	(A)	F	Fountain O/S D202	1.0	ppb
	(B)	F	Fountain O/S D202	1.0	ppb
43	(A)	F	Fountain O/S C312- Left	1.0	ppb
	(B)	F	Fountain O/S C312- Left	1.0	ppb
44	(A)	F	Fountain O/S C312- Right	1.0	ppb
	(B)	F	Fountain O/S C312- Right	1.0	ppb
45	(A)	S	Room C312	1.0	ppb
	(B)	S	Room C312	1.0	ppb
46	(A)	F	Fountain O/S C347- Left	1.0	ppb
	(B)	F	Fountain O/S C347- Left	1.0	ppb
47	(A)	F	Fountain O/S C347- Right	1.0	ppb
	(B)	F	Fountain O/S C347- Right	1.0	ppb
48	(A)	F	West Set 2nd Fl. Dining Area-	1.0	ppb
	(B)	F	Left	1.0	ppb
49	(A)	F	West Set 2nd Fl. Dining Area-	1.0	ppb
	(B)	F	Center	1.0	ppb
50	(A)	F	West Set 2nd Fl. Dining Area-	1.0	ppb
	(B)	F	Right	1.0	ppb
51	(A)	F	2nd Fl. Dining Area West-	1.0	ppb
	(B)	F	Bottle Filler	1.0	ppb
52	(A)	F	East Set 2nd Fl. Dining Area-	1.0	ppb
	(B)	F	Left- (inactive)	1.0	ppb
53	(A)	F	East Set 2nd Fl. Dining Area-	1.0	ppb
	(B)	F	Center (Inactive)	1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
54	(A)	F	East Set 2nd Fl. Dining Area-		1.0	ppb
	(B)	F	Right (Inactive)		1.0	ppb

123072000

55	(A)	F	2nd Floor Dining Area East-	1.0	ppb
	(B)	F	Bottle Filler	1.0	ppb
56	(A)	S	Clinic Sink	1.0	ppb
	(B)	S	Clinic Sink	1.0	ppb
57	(A)	F	O/S Exit Door 26- Left (Inactive)	1.0	ppb
	(B)	F	O/S Exit Door 26- Left (Inactive)	1.0	ppb
58	(A)	F	O/S Exit Door 26- Center (Inactive)	1.0	ppb
	(B)	F	O/S Exit Door 26- Center (Inactive)	1.0	ppb
59	(A)	F	O/S Exit Door 26- Right (Inactive)	1.0	ppb
	(B)	F	O/S Exit Door 26- Right (Inactive)	1.0	ppb
60	(A)	F	Library- Left	1.0	ppb
	(B)	F	Library- Left	1.0	ppb
61	(A)	F	Library- Right	1.0	ppb
	(B)	F	Library- Right	1.0	ppb
62	(A)	S	F102 Sink	1.0	ppb
	(B)	S	F102 Sink	1.0	ppb
63	(A)			1.0	ppb
	(B)			1.0	ppb
64	(A)			1.0	ppb
	(B)			1.0	ppb
65	(A)			1.0	ppb
	(B)			1.0	ppb
66	(A)			1.0	ppb
	(B)			1.0	ppb
67	(A)			1.0	ppb
	(B)			1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
68	(A)				1.0	ppb
	(B)				1.0	ppb

28072000

Sample ID Coding Key:

- F = Fountain
- S = Sink
- (A) = 1st Sample
- (B) = 2nd Sample (30 Seconds Later)
- (C) = 3rd Sample (3 Minutes Later)

1230712000

APPENDIX C

CREDENTIALS

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

Lead Abatement Contractor License


The person, firm or corporation whose name appears on this certificate is licensed as a Lead Abatement Contractor as set forth in the Missouri Revised Statutes 701.300-701.338 and 19 CSR 30-70.180, as long as not suspended or revoked, and is hereby authorized to engage in lead-bearing substance activities.

Issued to:

ENPAQ, LLC

**2321 Rutger Street, Unit F
St. Louis, MO 63104**

Issuance Date: 2/10/2023
Expiration Date: 2/26/2025
License Number: 190226-004574

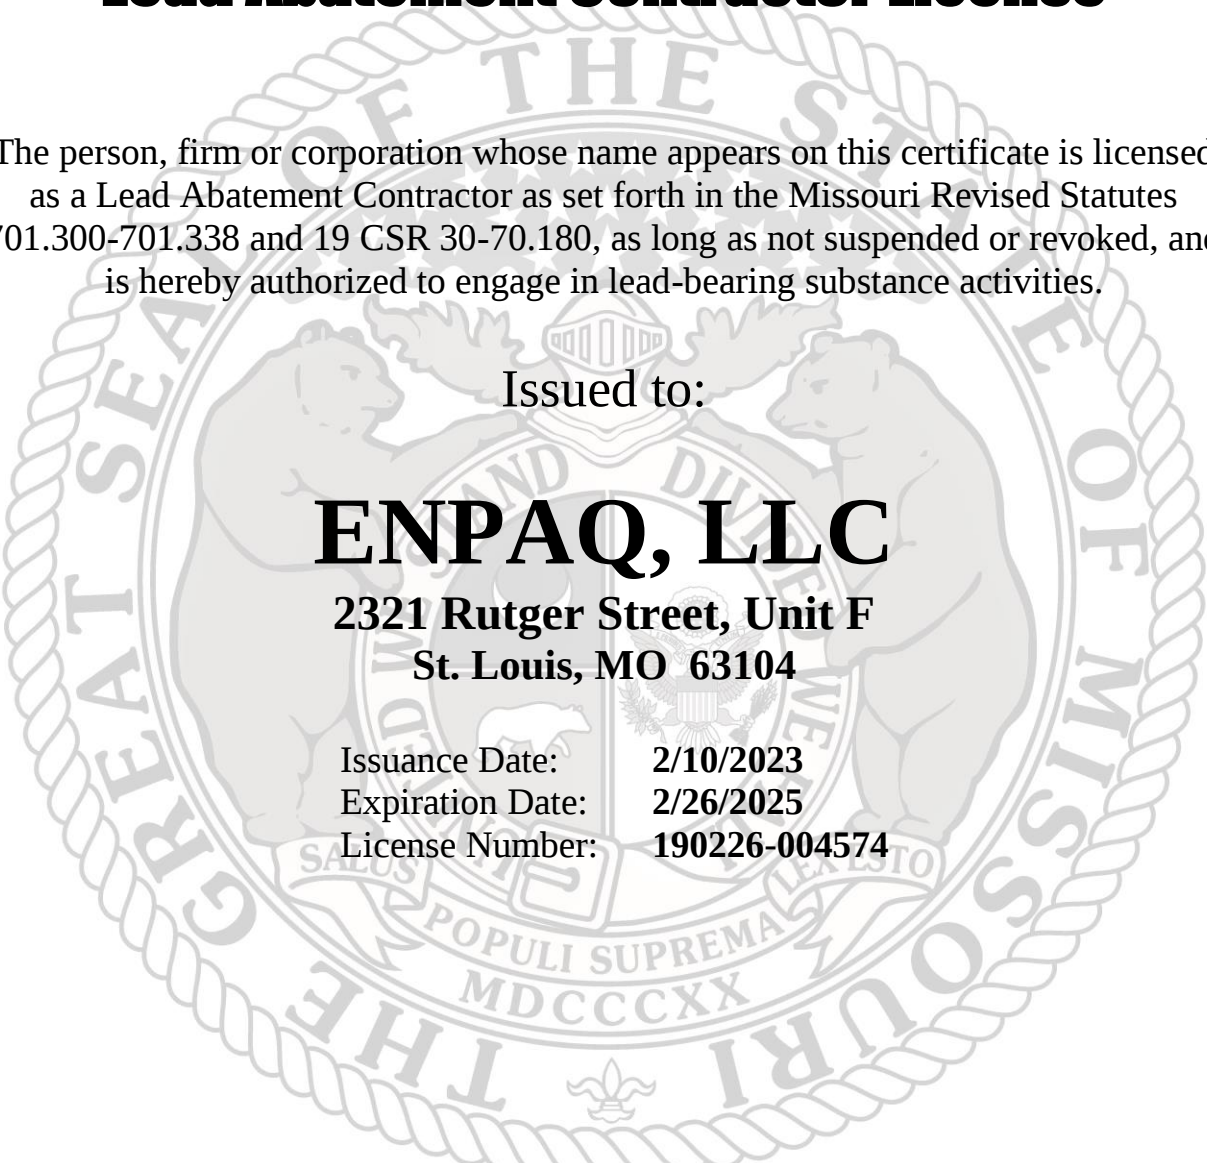

Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Anthony W. Hagerty

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **10/17/2022**
Expiration Date: **10/31/2024**
License Number: **161031-300005062**



Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

Anthony Hagerty

3959 McDonald Ave, St. Louis, MO 63116

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 190510

Examination Date: 3/7/2022

CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104
(314) 977-8256 slu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

Christopher C. King
Christopher C. King PhD
Director, Center for Environmental
Education and Training

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

James T. Earle

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **7/30/2022**
Expiration Date: **7/30/2024**
License Number: **180730-300005561**



Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

James Earle

7484 Ahern Ct., University City, MO 63130

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117401
Examination Date: 3/7/2022
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104
(314) 977-8256 sltu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

Christopher C. King
Christopher C. King PhD
Director, Center for Environmental
Education and Training

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Zachary A. Haselhorst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **3/1/2022**
Expiration Date: **3/1/2024**
License Number: **160229-300004899**



A handwritten signature in black ink, appearing to read "Richard W. Moore", is positioned above the printed name.

Richard W. Moore
Acting Director
Department of Health and Senior Services

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

Zachary Haselhorst

209 E 5th St, Trenton, IL 62293

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117400
Examination Date: 3/7/2022
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104
(314) 977-8256 slu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

Christopher C. King
Christopher C. King PhD
Director, Center for Environmental
Education and Training

State of Missouri
Department of Natural Resources

Certificate of Approval
for Chemical Laboratory Service

This is to certify that

Teklab, Incorporated

is hereby approved to perform the analysis of drinking water as specified on the
Certified Parameter List, which must accompany this certificate to be valid.


Certification Number 930

Date Issued December 13, 2021

Expiration Date January 31, 2025



Laboratory Certification Authority, Public Drinking Water Branch
Missouri Department of Natural Resources



Laboratory Certification Officer, Environmental Services Program
Missouri Department of Natural Resources

MISSOURI DEPARTMENT OF NATURAL RESOURCES
DRINKING WATER LABORATORY
CERTIFIED PARAMETER LIST

This is to certify that

Teklab, Incorporated

located at

5445 Horseshoe Lake Road, Collinsville, IL 62234

has been approved to perform the indicated procedures on drinking water under the Missouri Public Drinking Water Regulations (10 CSR 60-5.020). Specific method numbers or references are included in parenthesis when appropriate.

INORGANIC

EPA 335.4

Total Cyanide

EPA 353.2

Nitrate, Nitrite, Total Nitrate and Nitrite

EPA 245.1

Mercury

EPA 200.7

Barium, Beryllium, Cadmium, Chromium, Copper, Nickel

EPA 200.8

Antimony, Arsenic, Barium, Beryllium, Cadmium, Chromium, Copper, Lead, Nickel, Selenium, Thallium

SM4500F-C

Fluoride

SM4500NO2-B

Nitrite

Teklab, Incorporated

Expiration Date: January 31, 2025

Missouri Certificate No.: 930

Original Certifying State: Illinois