


REPORT OF DRINKING WATER SAMPLING FOR LEAD CONTENT:

**HAZELWOOD WEST HIGH SCHOOL
#1 WILDCAT LANE
HAZELWOOD, MO 63042**

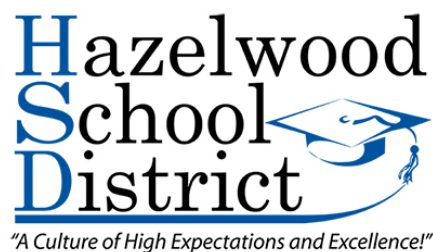

PREPARED FOR:

**MR. DAVID DUDLEY
DIRECTOR OF MAINTENANCE
HAZELWOOD SCHOOL DISTRICT
15875 NEW HALLS FERRY RD
FLORISSANT, MISSOURI 63031**

PREPARED BY:

**ENPAQ, LLC
3130 GRAVOIS AVENUE
ST. LOUIS, MISSOURI 63139**

JULY 2023

DOCUMENT TO BE RETAINED INDEFINITELY

TABLE OF CONTENTS

23-170

Drinking Water Sampling for Lead
Hazelwood School District
Hazelwood West High School
#1 Wildcat Lane
Hazelwood, MO 63042

EXECUTIVE SUMMARY

APPENDIX A Sample Locations/Results

APPENDIX B Laboratory Analysis

APPENDIX C Credentials

EXECUTIVE SUMMARY

ENPAQ, LLC performed lead testing of multiple drinking fountain water sources at the Hazelwood West High School located at #1 Wildcat Lane in Hazelwood, Missouri. The sampling was performed by trained and licensed personnel in accordance with USEPA, HUD, and State of Missouri Regulations and Guidelines.

All inspectors involved with sampling activities had EPA-approved training in Lead. Credentials for our firm and the inspector collecting the samples are included in Attachment C to this document.

All samples were collected on a “first draw” basis. “First draw” is achieved by allowing the water system to rest for at least eight hours prior to sampling in order to collect any existing debris or settlement within the sample. The intent of this sampling is to replicate “worst-case scenario” conditions. As such, ENPAQ inspectors met at the school to collect water samples before the systems were used by staff or students. A second sample from each water source was collected as a “follow-up” sample basis. “Follow-up” sampling is achieved by allowing the water system to run for thirty (30) seconds after the first draw sampling. The intent of this sampling is to determine if lead contamination may be in the water lines connected to the water sources and not just at the fixture. The sampling was completed in accordance with the Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* requirements. The Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* and other regulatory agencies recommend that water sources run for at least thirty seconds and as long as two minutes prior to use to avoid settling within the water system.

Drinking water samples were collected from fifty-four (54) different locations throughout Hazelwood West High School during the sampling event. The water samples were collected from drinking fountains utilized for drinking activities at the campus. After sample collection, samples were immediately delivered to Teklab, Inc. located in Collinsville, Illinois following strict chain of custody procedures. Teklab is a NELAP-accredited and State of Missouri-licensed laboratory specializing in drinking water analysis. Detailed sampling locations and sample results are located in Attachment A of this report.

Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.

The following results require written notification per the Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* for samples reported above 5.0 ppb.

“First Draw” Sampling

Sample ID 02A	3 Bay Sink O/S Office – Right	(5.3 ppb)
----------------------	--------------------------------------	------------------

“Follow-Up” Sampling

Sample ID 02B	3 Bay Sink O/S Office – Right	(<1.0 ppb)
----------------------	--------------------------------------	----------------------

“First Draw” Sampling

Sample ID 20A Fountain O/S Custodial Closet Rm 132 (5.8 ppb)

“Follow-Up” Sampling

Sample ID 20B Fountain O/S Custodial Closet Rm 132 (<1.0 ppb)

“First Draw” Sampling

Sample ID 26A Fountain O/S Rm 223 (6.5 ppb)

“Follow-Up” Sampling

Sample ID 26B Fountain O/S Rm 223 (<1.0 ppb)

“First Draw” Sampling

Sample ID 34A Sink RM CR006 – Station 1 (19.4 ppb)

“Follow-Up” Sampling

Sample ID 34B Sink RM CR006 – Station 1 (<1.0 ppb)

“First Draw” Sampling

Sample ID 43A Sink RM CR016 – Station 1 (288.0 ppb)

“Follow-Up” Sampling

Sample ID 43B Sink RM CR016 – Station 1 (1.1 ppb)

“First Draw” Sampling

Sample ID 44A Sink RM CR016 – Station 2 (35.3 ppb)

“Follow-Up” Sampling

Sample ID 44B Sink RM CR016 – Station 2 (<1.0 ppb)

“First Draw” Sampling

Sample ID 45A Sink RM CR016 – Station 3 (367.0 ppb)

“Follow-Up” Sampling

Sample ID 45B Sink RM CR016 – Station 3 (13.0 ppb)

“First Draw” Sampling

Sample ID 46A Sink RM CR016 – Station 4 (132.0 ppb)

“Follow-Up” Sampling

Sample ID 46B Sink RM CR016 – Station 4 (<1.0 ppb)

“First Draw” Sampling

Sample ID 47A Sink RM CR016 – Station 5 (39.5 ppb)

“Follow-Up” Sampling

Sample ID 47B Sink RM CR016 – Station 5 (<1.0 ppb)

“First Draw” Sampling

Sample ID 54A Fountain O/S Rm 122 (11.4 ppb)

“Follow-Up” Sampling

Sample ID 54B Fountain O/S Rm 122 (<1.0 ppb)

CONCLUSION/RECOMMENDATIONS

At this time, ENPAQ recommends that all water sources testing at 5.0 ppb or above be removed from service. These sources are subject to additional maintenance activities and remediation prior to use. Before being put back into service, it is recommended these sources be re-tested to confirm compliance with acceptable levels.

Remediation includes decreasing lead concentrations below 5 parts per billion using methods such as replacement of plumbing, solder, fittings, or fixtures, installation of filters and filter devices, or other effective methods in accordance with Missouri SB681 *Get the Lead Out of Schools Drinking Water Act*.

In addition, all sources will be subject to an ongoing maintenance program and re-testing at appropriate intervals. **Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.**

Although no additional samples were identified above the action level, ENPAQ recommends that all water sources run for at least thirty seconds prior to use as recommended by the USEPA.

APPENDIX A

SAMPLE LOCATIONS & RESULTS

Prep Day: 7/25/23

Sample Day: 7/26/23

To Lab -----> 7/26/23

* Reporting Limit

# Disabled =	2
# of Samples =	108
# > 10.0 ppb =	8
# > 5.0 ppb =	3

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
01	(A)	S	3 Bay Sink O/S Office- Left		1.0	4.4 ppb
	(B)	S	3 Bay Sink O/S Office- Left		1.0	<1.0 ppb
	(C)	S			1.0	N/A ppb
02	(A)	S	3 Bay Sink O/S Office - Right		1.0	5.3 ppb
	(B)	S	3 Bay Sink O/S Office - Right		1.0	<1.0 ppb
03	(A)	S	1 Bay Sink by Mixer		1.0	2.3 ppb
	(B)	S	1 Bay Sink by Mixer		1.0	<1.0 ppb
04	(A)	S	1 Bay Sink by Freezer		1.0	2.0 ppb
	(B)	S	1 Bay Sink by Freezer		1.0	<1.0 ppb
05	(A)	S	Pot Filler		1.0	<1.0 ppb
	(B)	S	Pot Filler		1.0	<1.0 ppb
06	(A)	S	1 Bay Sink Dishwashing Station		1.0	<1.0 ppb
	(B)	S	1 Bay Sink Dishwashing Station		1.0	<1.0 ppb
07	(A)	F	Fountain Café O/S Girls RR		1.0	<1.0 ppb
	(B)	F	Fountain Café O/S Girls RR		1.0	<1.0 ppb
08	(A)	F	Fountain Café O/S Boys RR		1.0	<1.0 ppb
	(B)	F	Fountain Café O/S Boys RR		1.0	<1.0 ppb
09	(A)	F	Fountain O/S Theater Rm		1.0	1.4 ppb
	(B)	F	Fountain O/S Theater Rm		1.0	<1.0 ppb
10	(A)	F	Fountain O/S Rm 157		1.0	<1.0 ppb
	(B)	F	Fountain O/S Rm 157		1.0	<1.0 ppb
11	(A)	F	Fountain Gym		1.0	<1.0 ppb
	(B)	F	Fountain Gym		1.0	<1.0 ppb

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
12	(A)	F	Fountain O/S Trainers Office		1.0	<1.0 ppb
	(B)	F	Fountain O/S Trainers Office		1.0	<1.0 ppb
13	(A)	F	Fountain O/S Gym by Storage (Inactive)		1.0	ppb
	(B)	F	Fountain O/S Gym by Storage (Inactive)		1.0	ppb
14	(A)	F	Fountain - Girls Locker Rm (Pool)		1.0	1.5 ppb
	(B)	F	Fountain - Girls Locker Rm (Pool)		1.0	<1.0 ppb
15	(A)	F	Fountain - Boys Locker Rm (Pool)		1.0	3.3 ppb
	(B)	F	Fountain - Boys Locker Rm (Pool)		1.0	<1.0 ppb
16	(A)	F	Fountain - Pool Area		1.0	<1.0 ppb
	(B)	F	Fountain - Pool Area		1.0	<1.0 ppb
17	(A)	S	Athletic Trainers Office		1.0	<1.0 ppb
	(B)	S	Athletic Trainers Office		1.0	<1.0 ppb
18	(A)	F	Fountain O/S P.E. Office		1.0	4.4 ppb
	(B)	F	Fountain O/S P.E. Office		1.0	<1.0 ppb
19	(A)	F	Fountain O/S Wrestling Rm		1.0	<1.0 ppb
	(B)	F	Fountain O/S Wrestling Rm		1.0	<1.0 ppb
20	(A)	F	Fountain O/S Custodial Closet Rm 132		1.0	5.8 ppb
	(B)	F	Fountain O/S Custodial Closet Rm 132		1.0	<1.0 ppb
21	(A)	S	Teachers Work Room (Front Office)		1.0	<1.0 ppb
	(B)	S	Teachers Work Room (Front Office)		1.0	<1.0 ppb
22	(A)	F	Fountain - Band Wing - 2nd Floor		1.0	<1.0 ppb
	(B)	F	Fountain - Band Wing - 2nd Floor		1.0	<1.0 ppb
23	(A)	F	Fountain O/S Rm CR245 - Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S Rm CR245 - Left		1.0	<1.0 ppb
24	(A)	F	Fountain O/S Rm CR245 - Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Rm CR245 - Right		1.0	<1.0 ppb
25	(A)	F	Fountain O/S Rm 259		1.0	<1.0 ppb
	(B)	F	Fountain O/S Rm 259		1.0	<1.0 ppb

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
26	(A)	F	Fountain O/S Rm 223		1.0	6.5 ppb
	(B)	F	Fountain O/S Rm 223		1.0	<1.0 ppb
27	(A)	F	Fountain O/S Rm 208		1.0	<1.0 ppb
	(B)	F	Fountain O/S Rm 208		1.0	<1.0 ppb
28	(A)	F	Fountain O/S Rm 219		1.0	2.4 ppb
	(B)	F	Fountain O/S Rm 219		1.0	<1.0 ppb
29	(A)	S	Sink - Rm 223 (Work Room)		1.0	<1.0 ppb
	(B)	S	Sink - Rm 223 (Work Room)		1.0	<1.0 ppb
30	(A)	S	Teachers Toolbox Rm CR009		1.0	<1.0 ppb
	(B)	S	Teachers Toolbox Rm CR009		1.0	<1.0 ppb
31	(A)	F	Fountain O/S Rm CR009		1.0	<1.0 ppb
	(B)	F	Fountain O/S Rm CR009		1.0	<1.0 ppb
32	(A)	F	Fountain O/S Rm CR013 - Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S Rm CR013 - Left		1.0	<1.0 ppb
33	(A)	F	Fountain O/S Rm CR013 - Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Rm CR013 - Right		1.0	<1.0 ppb
34	(A)	S	Sink Rm CR006 - Station 1		1.0	19.4 ppb
	(B)	S	Sink Rm CR006 - Station 1		1.0	<1.0 ppb
35	(A)	S	Sink Rm CR006 - Station 2		1.0	3.9 ppb
	(B)	S	Sink Rm CR006 - Station 2		1.0	<1.0 ppb
36	(A)	S	Sink Rm CR006 - Station 3		1.0	1.7 ppb
	(B)	S	Sink Rm CR006 - Station 3		1.0	<1.0 ppb
37	(A)	S	Sink Rm CR006 - Station 4		1.0	3.3 ppb
	(B)	S	Sink Rm CR006 - Station 4		1.0	<1.0 ppb
38	(A)	S	Sink Rm CR006 - Station 5		1.0	2.6 ppb
	(B)	S	Sink Rm CR006 - Station 5		1.0	<1.0 ppb
39	(A)	S	Sink Rm CR005 - 1 Bay - Prep		1.0	<1.0 ppb
	(B)	S	Sink Rm CR005 - 1 Bay - Prep		1.0	<1.0 ppb

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
40	(A)	S	Sink Rm CR005 - 3 Bay - Dishwash Station		1.0	3.6 ppb
	(B)	S	Sink Rm CR005 - 3 Bay - Dishwash Station		1.0	<1.0 ppb
41	(A)	F	Fountain O/S Rm CR005		1.0	<1.0 ppb
	(B)	F	Fountain O/S Rm CR005		1.0	1.2 ppb
42	(A)	F	Fountain O/S Rm CR017		1.0	3.9 ppb
	(B)	F	Fountain O/S Rm CR017		1.0	<1.0 ppb
43	(A)	S	Sink Rm CR016 - Station 1		1.0	288.0 ppb
	(B)	S	Sink Rm CR016 - Station 1		1.0	1.1 ppb
44	(A)	S	Sink Rm CR016 - Station 2		1.0	35.3 ppb
	(B)	S	Sink Rm CR016 - Station 2		1.0	<1.0 ppb
45	(A)	S	Sink Rm CR016 - Station 3		1.0	367.0 ppb
	(B)	S	Sink Rm CR016 - Station 3		1.0	13.0 ppb
46	(A)	S	Sink Rm CR016 - Station 4		1.0	132.0 ppb
	(B)	S	Sink Rm CR016 - Station 4		1.0	<1.0 ppb
47	(A)	S	Sink Rm CR016 - Station 5		1.0	39.5 ppb
	(B)	S	Sink Rm CR016 - Station 5		1.0	<1.0 ppb
48	(A)	F	Fountain O/S Storage Closet 210 - Left		1.0	1.5 ppb
	(B)	F	Fountain O/S Storage Closet 210 - Left		1.0	<1.0 ppb
49	(A)	F	Fountain O/S Storage Closet 210 - Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Storage Closet 210 - Right		1.0	<1.0 ppb
50	(A)	S	Nurse's Office		1.0	1.5 ppb
	(B)	S	Nurse's Office		1.0	<1.0 ppb
51	(A)	F	Fountain O/S Rm 132 (Inactive)		1.0	ppb
	(B)	F	Fountain O/S Rm 132 (Inactive)		1.0	ppb
52	(A)	F	Fountain O/S Rm 126		1.0	1.6 ppb
	(B)	F	Fountain O/S Rm 126		1.0	<1.0 ppb
53	(A)	S	Teachers Lounge		1.0	<1.0 ppb
	(B)	S	Teachers Lounge		1.0	<1.0 ppb

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
54	(A)	F	Fountain O/S Rm 122		1.0	11.4 ppb
	(B)	F	Fountain O/S Rm 122		1.0	<1.0 ppb
55	(A)	F	Fountain O/S Custodial Closet Rm 112		1.0	<1.0 ppb
	(B)	F	Fountain O/S Custodial Closet Rm 112		1.0	<1.0 ppb
56	(A)	F	Fountain O/S Rm 109		1.0	2.0 ppb
	(B)	F	Fountain O/S Rm 109		1.0	<1.0 ppb

Sample ID Coding Key:


F = Fountain

S = Sink

(A) = 1st Sample

(B) = 2nd Sample (30 Seconds Later)

(C) = 3rd Sample (3 Minutes Later)

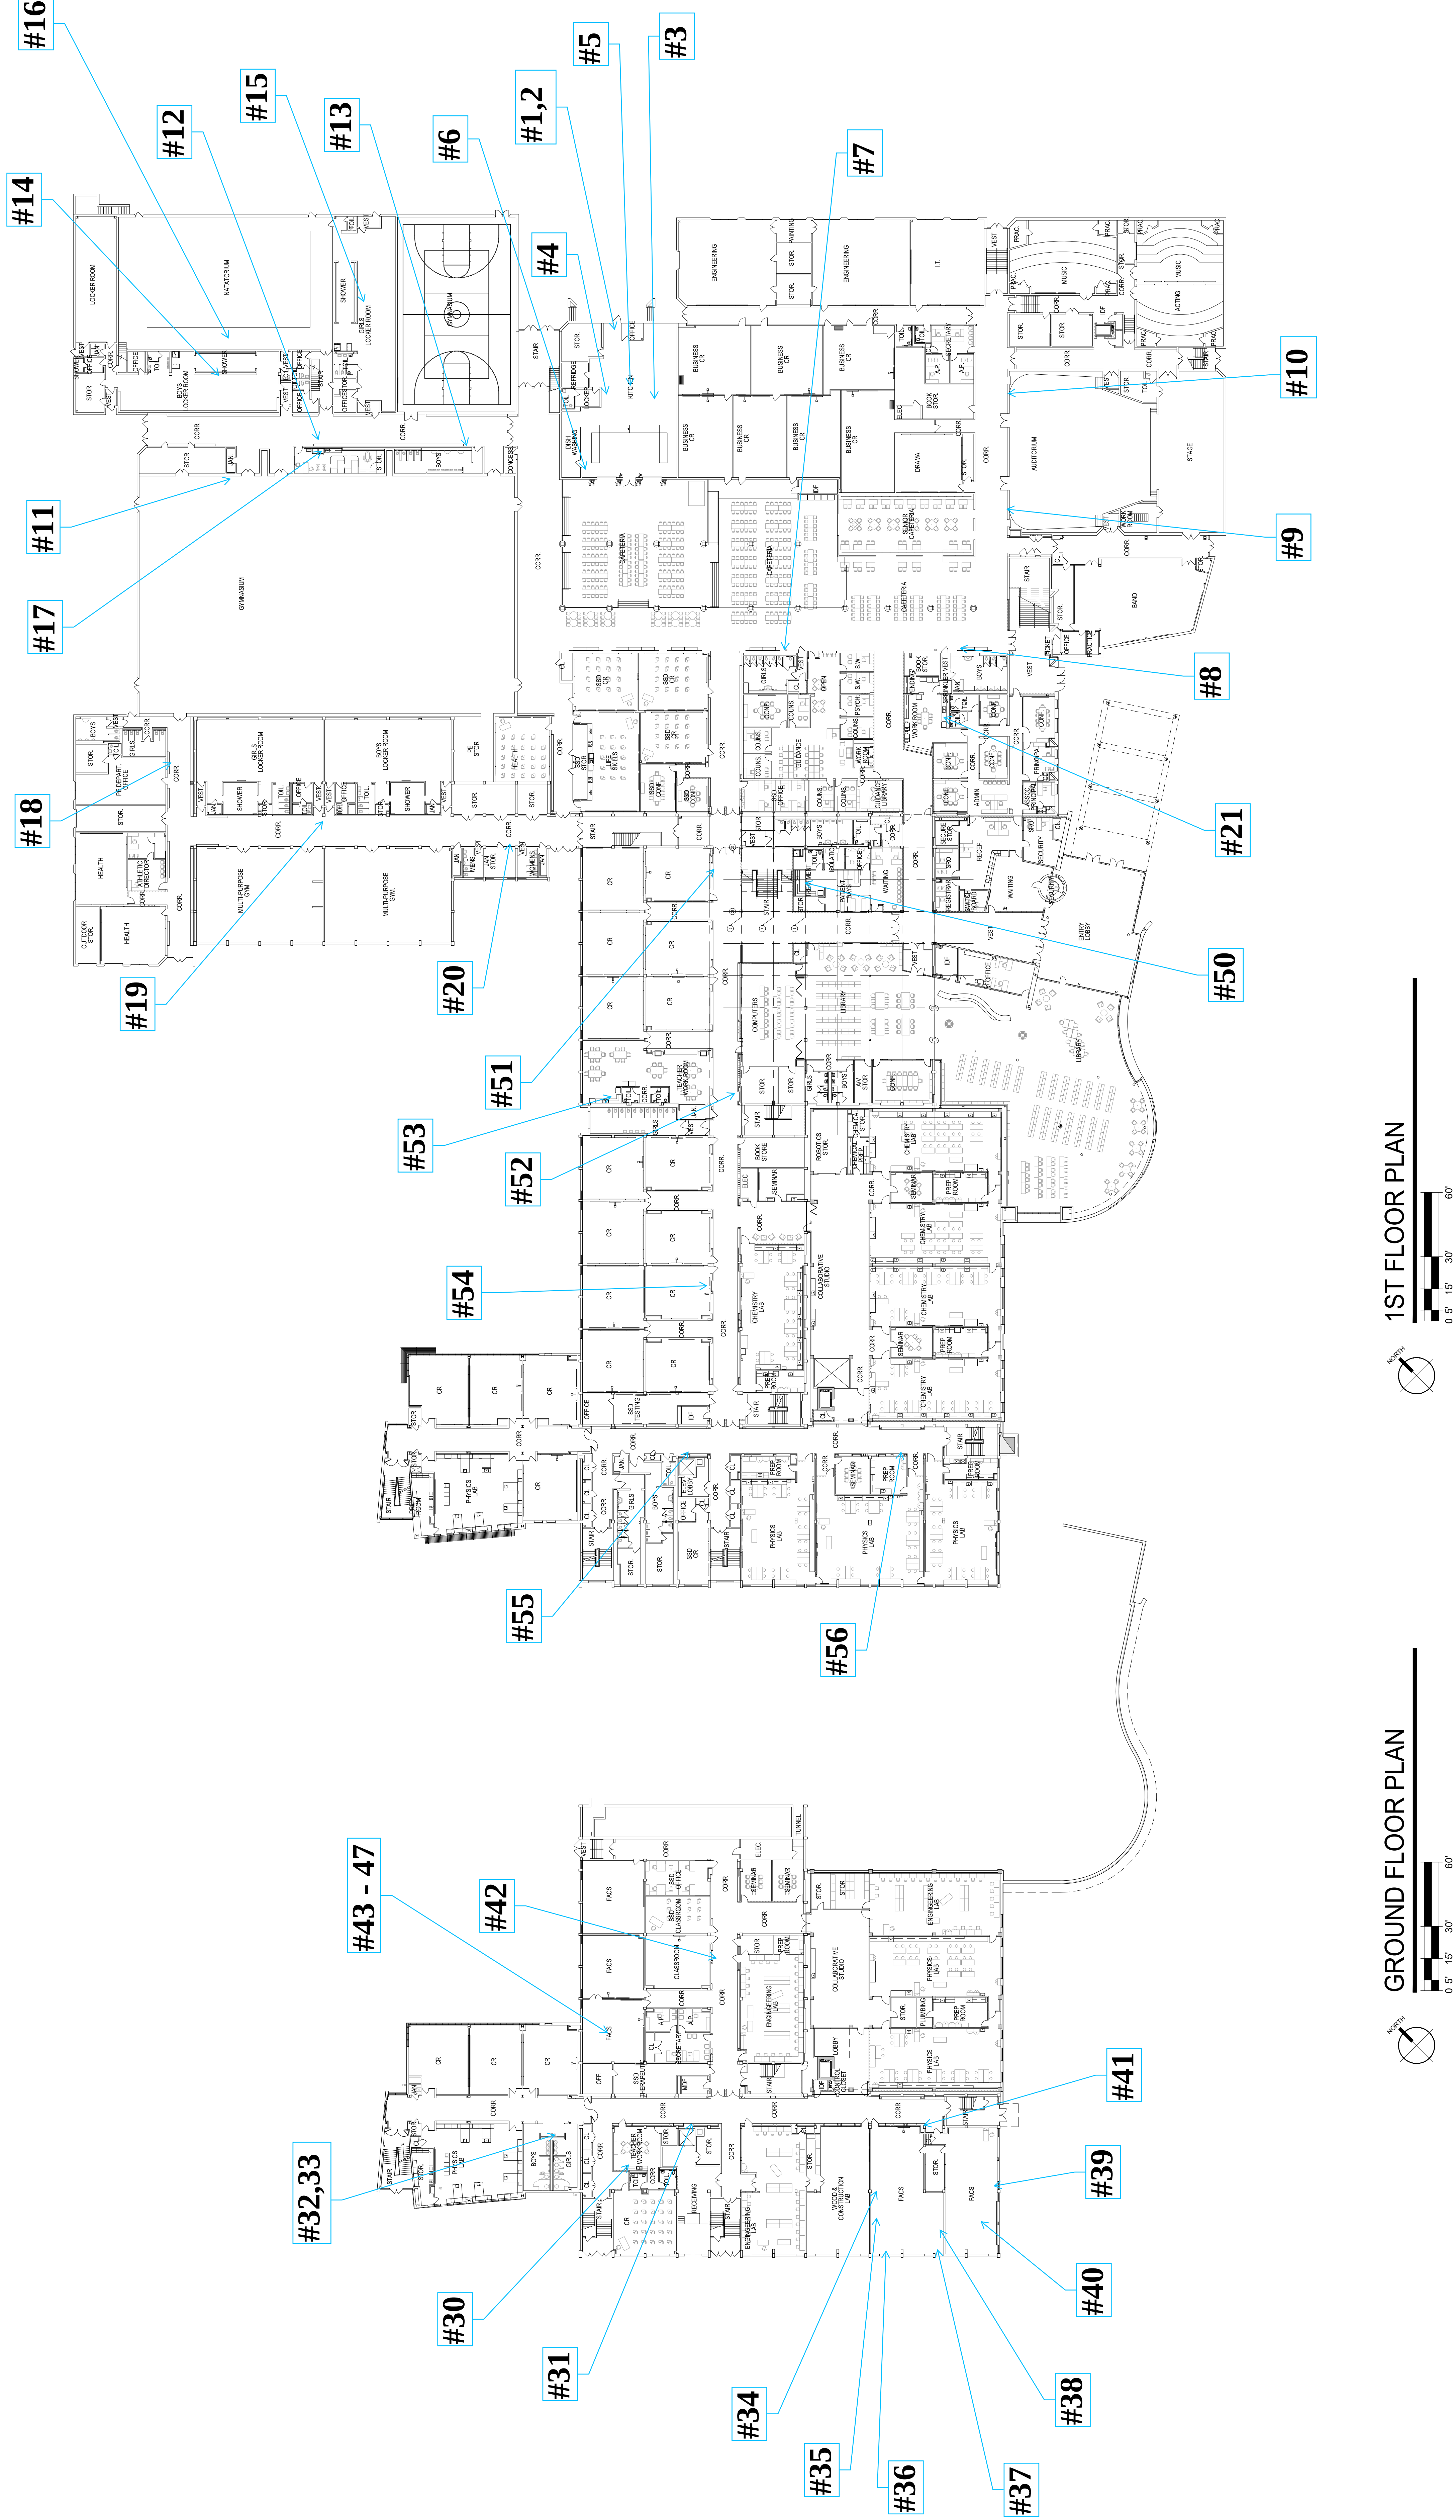


GROUND FLOOR PLAN

1ST FLOOR PLAN

WEST HIGH SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI
21-100
03-09-2021

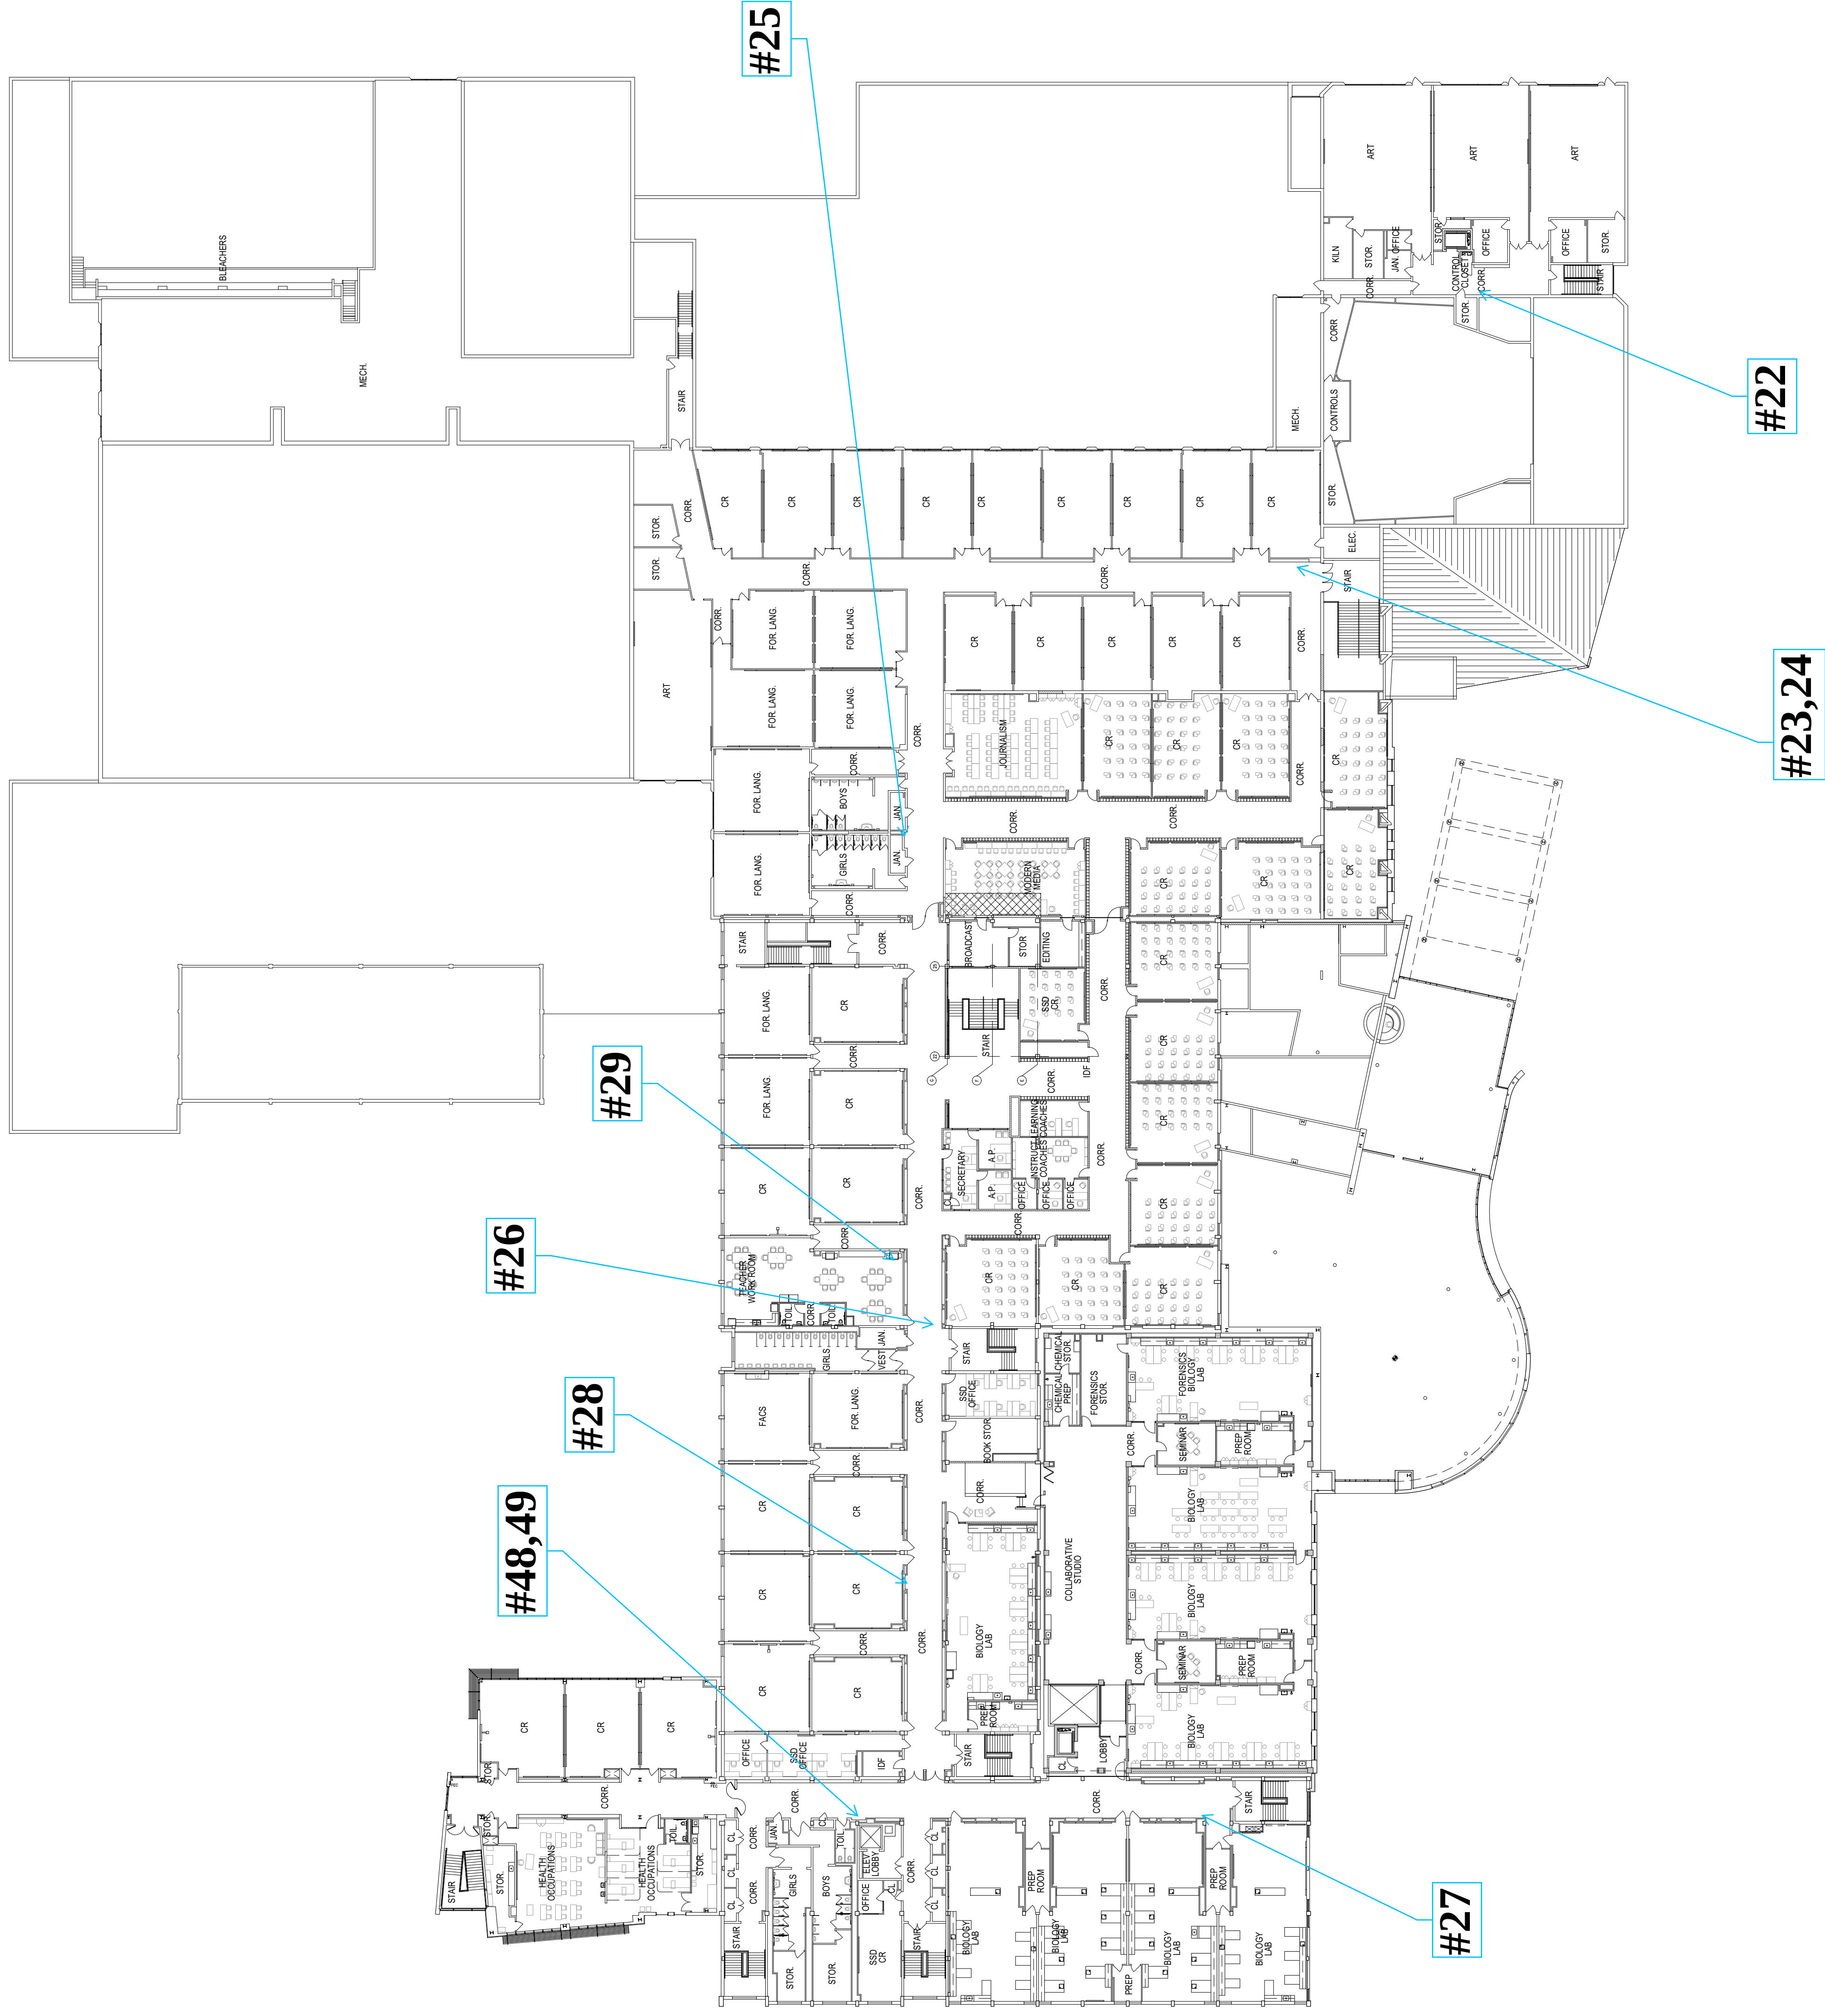

2ND FLOOR PLAN

WEST HIGH SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI
21-100
03-09-2021

APPENDIX B

LABORATORY ANALYSIS

September 06, 2023

Tony Hagerty
ENPAQ, LLC
3130 Gravois Ave
St. Louis, MO 63118
TEL: (314) 449-1976
FAX:



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

RE: Hazelwood SD/ 23-170 Hazelwood West H.S.

WorkOrder: 23071867

Dear Tony Hagerty:

TEKLAB, INC received 108 samples on 7/26/2023 12:27:00 PM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Marvin L. Darling
Project Manager
(618)344-1004 ex 41
mdarling@teklabinc.com



Report Contents

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071867

Client Project: Hazelwood SD/ 23-170 Hazelwood West H.S.

Report Date: 06-Sep-23

This reporting package includes the following:

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Receiving Check List	10
Chain of Custody	Appended

Client: ENPAQ, LLC

Work Order: 23071867

Client Project: Hazelwood SD/ 23-170 Hazelwood West H.S.

Report Date: 06-Sep-23

Abbr Definition

* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count (> 200 CFU)

Client: ENPAQ, LLC

Work Order: 23071867

Client Project: Hazelwood SD/ 23-170 Hazelwood West H.S.

Report Date: 06-Sep-23

Qualifiers

- | | |
|---|--|
| # - Unknown hydrocarbon | B - Analyte detected in associated Method Blank |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range |
| H - Holding times exceeded | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits | M - Manual Integration used to determine area response |
| ND - Not Detected at the Reporting Limit | R - RPD outside accepted recovery limits |
| S - Spike Recovery outside recovery limits | T - TIC(Tentatively identified compound) |
| X - Value exceeds Maximum Contaminant Level | |



Case Narrative

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071867

Client Project: Hazelwood SD/ 23-170 Hazelwood West H.S.

Report Date: 06-Sep-23

Cooler Receipt Temp: N/A °C

Locations

Collinsville

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email jhriley@teklabinc.com

Collinsville Air

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email EHurley@teklabinc.com

Springfield

Address 3920 Pintail Dr
Springfield, IL 62711-9415
Phone (217) 698-1004
Fax (217) 698-1005
Email KKlostermann@teklabinc.com

Chicago

Address 1319 Butterfield Rd.
Downers Grove, IL 60515
Phone (630) 324-6855
Fax
Email arenner@teklabinc.com

Kansas City

Address 8421 Nieman Road
Lenexa, KS 66214
Phone (913) 541-1998
Fax (913) 541-1998
Email jhriley@teklabinc.com

Client: ENPAQ, LLC**Work Order:** 23071867**Client Project:** Hazelwood SD/ 23-170 Hazelwood West H.S.**Report Date:** 06-Sep-23

State	Dept	Cert #	NELAP	Exp Date	Lab
Illinois	IEPA	100226	NELAP	1/31/2024	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2024	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2024	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2024	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2023	Collinsville
Arkansas	ADEQ	88-0966		3/14/2024	Collinsville
Illinois	IDPH	17584		5/31/2025	Collinsville
Iowa	IDNR	430		6/1/2024	Collinsville
Kentucky	UST	0073		1/31/2024	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071867

Client Project: Hazelwood SD/ 23-170 Hazelwood West H.S.

Report Date: 06-Sep-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)									
Lead									
23071867-001A	01A	NELAP		1.0	4.4	µg/L	1	08/29/2023 18:49	07/26/2023 0:00
23071867-002A	01B	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 18:53	07/26/2023 0:00
23071867-003A	02A	NELAP		1.0	5.3	µg/L	1	08/29/2023 18:58	07/26/2023 0:00
23071867-004A	02B	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 19:03	07/26/2023 0:00
23071867-005A	03A	NELAP		1.0	2.3	µg/L	1	08/29/2023 19:07	07/26/2023 0:00
23071867-006A	03B	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 19:12	07/26/2023 0:00
23071867-007A	04A	NELAP		1.0	2.0	µg/L	1	08/31/2023 9:55	07/26/2023 0:00
23071867-008A	04B	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 19:48	07/26/2023 0:00
23071867-009A	05A	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 19:16	07/26/2023 0:00
23071867-010A	05B	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 19:52	07/26/2023 0:00
23071867-011A	06A	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 19:57	07/26/2023 0:00
23071867-012A	06B	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 20:01	07/26/2023 0:00
23071867-013A	07A	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 20:06	07/26/2023 0:00
23071867-014A	07B	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 20:10	07/26/2023 0:00
23071867-015A	08A	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 20:15	07/26/2023 0:00
23071867-016A	08B	NELAP		1.0	< 1.0	µg/L	1	08/29/2023 20:19	07/26/2023 0:00
23071867-017A	09A	NELAP		1.0	1.4	µg/L	1	08/29/2023 20:24	07/26/2023 0:00
23071867-018A	09B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 9:59	07/26/2023 0:00
23071867-019A	10A	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 11:38	07/26/2023 0:00
23071867-020A	10B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 10:25	07/26/2023 0:00
23071867-021A	11A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 3:58	07/26/2023 0:00
23071867-022A	11B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 4:02	07/26/2023 0:00
23071867-023A	12A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 4:05	07/26/2023 0:00
23071867-024A	12B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 4:09	07/26/2023 0:00
23071867-025A	14A	NELAP		1.0	1.5	µg/L	1	09/03/2023 4:13	07/26/2023 0:00
23071867-026A	14B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 4:35	07/26/2023 0:00
23071867-027A	15A	NELAP		1.0	3.3	µg/L	1	09/03/2023 4:38	07/26/2023 0:00
23071867-028A	15B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 4:42	07/26/2023 0:00
23071867-029A	16A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 4:46	07/26/2023 0:00
23071867-030A	16B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 4:49	07/26/2023 0:00
23071867-031A	17A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 4:53	07/26/2023 0:00
23071867-032A	17B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 4:57	07/26/2023 0:00
23071867-033A	18A	NELAP		1.0	4.4	µg/L	1	09/03/2023 5:00	07/26/2023 0:00
23071867-034A	18B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 5:04	07/26/2023 0:00
23071867-035A	19A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 5:08	07/26/2023 0:00
23071867-036A	19B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 5:30	07/26/2023 0:00
23071867-037A	20A	NELAP		1.0	5.8	µg/L	1	09/03/2023 5:33	07/26/2023 0:00
23071867-038A	20B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 5:37	07/26/2023 0:00
23071867-039A	21A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 5:41	07/26/2023 0:00
23071867-040A	21B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 5:44	07/26/2023 0:00
23071867-041A	22A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 5:48	07/26/2023 0:00
23071867-042A	22B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 5:52	07/26/2023 0:00
23071867-043A	23A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 5:55	07/26/2023 0:00
23071867-044A	23B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 6:10	07/26/2023 0:00
23071867-045A	24A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 6:21	07/26/2023 0:00
23071867-046A	24B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 6:25	07/26/2023 0:00
23071867-047A	25A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 6:28	07/26/2023 0:00
23071867-048A	25B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 6:32	07/26/2023 0:00



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071867

Client Project: Hazelwood SD/ 23-170 Hazelwood West H.S.

Report Date: 06-Sep-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)									
Lead									
23071867-049A	26A	NELAP		1.0	6.5	µg/L	1	09/03/2023 6:36	07/26/2023 0:00
23071867-050A	26B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 6:39	07/26/2023 0:00
23071867-051A	27A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 6:43	07/26/2023 0:00
23071867-052A	27B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 6:57	07/26/2023 0:00
23071867-053A	28A	NELAP		1.0	2.4	µg/L	1	09/03/2023 7:01	07/26/2023 0:00
23071867-054A	28B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 7:05	07/26/2023 0:00
23071867-055A	29A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 7:08	07/26/2023 0:00
23071867-056A	29B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 7:19	07/26/2023 0:00
23071867-057A	30A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 7:23	07/26/2023 0:00
23071867-058A	30B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 7:27	07/26/2023 0:00
23071867-059A	31A	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 7:30	07/26/2023 0:00
23071867-060A	31B	NELAP		1.0	< 1.0	µg/L	1	09/03/2023 7:45	07/26/2023 0:00
23071867-061A	32A	NELAP		1.0	< 1.0	µg/L	1	09/05/2023 10:48	07/26/2023 0:00
23071867-062A	32B	NELAP		1.0	< 1.0	µg/L	1	09/05/2023 10:52	07/26/2023 0:00
23071867-063A	33A	NELAP		1.0	< 1.0	µg/L	1	09/05/2023 11:06	07/26/2023 0:00
23071867-064A	33B	NELAP		1.0	< 1.0	µg/L	1	09/05/2023 11:12	07/26/2023 0:00
23071867-065A	34A	NELAP		1.0	19.4	µg/L	1	09/05/2023 11:23	07/26/2023 0:00
23071867-066A	34B	NELAP		1.0	< 1.0	µg/L	1	09/05/2023 11:27	07/26/2023 0:00
23071867-067A	35A	NELAP		1.0	3.9	µg/L	5	09/05/2023 11:56	07/26/2023 0:00
23071867-068A	35B	NELAP		1.0	< 1.0	µg/L	1	09/05/2023 11:31	07/26/2023 0:00
23071867-069A	36A	NELAP		1.0	1.7	µg/L	1	08/31/2023 12:57	07/26/2023 0:00
23071867-070A	36B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 13:26	07/26/2023 0:00
23071867-071A	37A	NELAP		1.0	3.3	µg/L	1	08/31/2023 13:04	07/26/2023 0:00
23071867-072A	37B	NELAP		1.0	< 1.0	µg/L	5	09/05/2023 12:00	07/26/2023 0:00
23071867-073A	38A	NELAP		1.0	2.6	µg/L	1	08/31/2023 13:07	07/26/2023 0:00
23071867-074A	38B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 13:11	07/26/2023 0:00
23071867-075A	39A	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 13:15	07/26/2023 0:00
23071867-076A	39B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 13:18	07/26/2023 0:00
23071867-077A	40A	NELAP		1.0	3.6	µg/L	5	09/05/2023 13:04	07/26/2023 0:00
23071867-078A	40B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 13:22	07/26/2023 0:00
23071867-079A	41A	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 13:48	07/26/2023 0:00
23071867-080A	41B	NELAP		1.0	1.2	µg/L	1	08/31/2023 13:51	07/26/2023 0:00
23071867-081A	42A	NELAP		1.0	3.9	µg/L	1	08/31/2023 13:55	07/26/2023 0:00
23071867-082A	42B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 13:59	07/26/2023 0:00
23071867-083A	43A	NELAP		10.0	288	µg/L	10	09/01/2023 15:31	07/26/2023 0:00
23071867-084A	43B	NELAP		1.0	1.1	µg/L	1	08/31/2023 14:13	07/26/2023 0:00
23071867-085A	44A	NELAP		1.0	35.3	µg/L	1	08/31/2023 14:06	07/26/2023 0:00
23071867-086A	44B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 14:10	07/26/2023 0:00
23071867-087A	45A	NELAP		10.0	367	µg/L	10	09/01/2023 15:34	07/26/2023 0:00
23071867-088A	45B	NELAP		1.0	13.0	µg/L	1	08/31/2023 14:39	07/26/2023 0:00
23071867-089A	46A	NELAP		10.0	132	µg/L	10	09/01/2023 15:38	07/26/2023 0:00
23071867-090A	46B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 14:46	07/26/2023 0:00
23071867-091A	47A	NELAP		1.0	39.5	µg/L	1	08/31/2023 15:01	07/26/2023 0:00
23071867-092A	47B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 14:50	07/26/2023 0:00
23071867-093A	48A	NELAP		1.0	1.5	µg/L	1	08/31/2023 14:53	07/26/2023 0:00
23071867-094A	48B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 14:57	07/26/2023 0:00
23071867-095A	49A	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 15:23	07/26/2023 0:00
23071867-096A	49B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 15:26	07/26/2023 0:00



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071867

Client Project: Hazelwood SD/ 23-170 Hazelwood West H.S.

Report Date: 06-Sep-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)									
Lead									
23071867-097A	50A	NELAP		1.0	1.5	µg/L	5	09/05/2023 13:08	07/26/2023 0:00
23071867-098A	50B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 15:30	07/26/2023 0:00
23071867-099A	52A	NELAP		1.0	1.6	µg/L	1	08/31/2023 15:34	07/26/2023 0:00
23071867-100A	52B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 15:37	07/26/2023 0:00
23071867-101A	53A	NELAP		1.0	< 1.0	µg/L	5	09/05/2023 13:11	07/26/2023 0:00
23071867-102A	53B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 15:41	07/26/2023 0:00
23071867-103A	54A	NELAP		1.0	11.4	µg/L	5	09/05/2023 13:15	07/26/2023 0:00
23071867-104A	54B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 15:48	07/26/2023 0:00
23071867-105A	55A	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 15:45	07/26/2023 0:00
23071867-106A	55B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 16:10	07/26/2023 0:00
23071867-107A	56A	NELAP		1.0	2.0	µg/L	1	08/31/2023 16:14	07/26/2023 0:00
23071867-108A	56B	NELAP		1.0	< 1.0	µg/L	1	08/31/2023 16:18	07/26/2023 0:00



Receiving Check List

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071867

Client Project: Hazelwood SD/ 23-170 Hazelwood West H.S.

Report Date: 06-Sep-23

Carrier: Anthony Hagerty

Received By: MBP

Completed by:

Reviewed by:

On:

On:

27-Jul-23

27-Jul-23

Lindsey Maddox

Ellie Hopkins

Pages to follow: Chain of custody

Extra pages included

Shipping container/cooler in good condition?	Yes ☒	No ☐	Not Present ☐	Temp °C	N/A
Type of thermal preservation?	None ☒	Ice ☐	Blue Ice ☐	Dry Ice	☐
Chain of custody present?	Yes ☒	No ☐			
Chain of custody signed when relinquished and received?	Yes ☒	No ☐			
Chain of custody agrees with sample labels?	Yes ☒	No ☐			
Samples in proper container/bottle?	Yes ☒	No ☐			
Sample containers intact?	Yes ☒	No ☐			
Sufficient sample volume for indicated test?	Yes ☒	No ☐			
All samples received within holding time?	Yes ☒	No ☐			
Reported field parameters measured:	Field ☐	Lab ☐	NA ☒		
Container/Temp Blank temperature in compliance?	Yes ☒	No ☐			

When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.

Water – at least one vial per sample has zero headspace?	Yes ☐	No ☐	No VOA vials ☒
Water - TOX containers have zero headspace?	Yes ☐	No ☐	No TOX containers ☒
Water - pH acceptable upon receipt?	Yes ☒	No ☐	NA ☐
NPDES/CWA TCN interferences checked/treated in the field?	Yes ☐	No ☐	NA ☒

Any No responses must be detailed below or on the COC.

Samples were checked for turbidity and then preserved with nitric acid upon arrival in the laboratory. - lmaddox - 7/27/2023 2:52:00 PM

CHAIN OF CUSTODY

Pg 1 of 11 Workorder # 23071867

TEKLAB INC. 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC Address: 3130 Gravois Ave. City/State/Zip: Collinsville, IL 62234 Contact: Anthony Hagerty Phone: (314) 449-1976 Email: tony.hagerty@enpaqconsulting.com Fax:				Samples on: ☐ ICE ☐ BLUE ICE ☒ NO ICE NA °C Preserved in: ☒ LAB ☐ FIELD FOR LAB USE ONLY LAB NOTES: 								
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No Are these samples known to be hazardous? ☐ Yes ☒ No Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No				Client Comments: Please Report in PPB Hazelwood West High School								
PROJECT NAME/NUMBER Hazelwood SD/ 23-170		SAMPLE COLLECTOR'S NAME <i>Anthony Hagerty</i>		# and Type of Containers				INDICATE ANALYSIS REQUESTED				
RESULTS REQUESTED ☒ Standard ☐ 1-2 Day (100% Surcharge) ☐ Other ☐ 3 Day (50% Surcharge)		BILLING INSTRUCTIONS		UNP	HNO3	NaOH	H2SO4	HCL	MeOH	NaHSO4	TSP	Other
Lab Use Only	Sample ID	Date/Time Sampled	Matrix									
<i>23071067</i>	<i>-U1 01 A</i>	<i>7/26/23</i>	Aqueous	X								
	<i>002 01 B</i>		Aqueous									
	<i>003 02 A</i>		Aqueous									
	<i>004 02 B</i>		Aqueous									
	<i>005 03 A</i>		Aqueous									
	<i>006 03 B</i>		Aqueous									
	<i>007 04 A</i>		Aqueous									
	<i>008 04 B</i>		Aqueous									
	<i>009 05 A</i>		Aqueous									
	<i>010 05 B</i>		Aqueous									
			Aqueous									
Relinquished By		Date/Time		Received By				Date/Time				
<i>A. Hagerty</i>		<i>7/26/23</i>		<i>Morgan Perkin</i>				<i>7/26/23/227</i>				

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg 2 of 11 Workorder # 23071867

TEKLAB INC. 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC				Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE _____ °C			
Address: 3130 Gravois Ave.				Preserved in: ☐ LAB ☐ FIELD <u>FOR LAB USE ONLY</u>			
City/State/Zip: Collinsville, IL 62234				LAB NOTES:			
Contact: Anthony Hagerty		Phone: (314) 449-1976		Client Comments:			
Email: tony.hagerty@enpaqconsulting.com		Fax:		Please Report in PPB			
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No				Hazelwood West High School			
Are these samples known to be hazardous? ☐ Yes ☒ No							
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No							
PROJECT NAME/NUMBER Hazelwood SD/ 23-170		SAMPLE COLLECTOR'S NAME Anthony Hagerty		# and Type of Containers		INDICATE ANALYSIS REQUESTED	
RESULTS REQUESTED ☒ Standard ☐ 1-2 Day (100% Surcharge) ☐ Other ☐ 3 Day (50% Surcharge)		BILLING INSTRUCTIONS		UNP	HNO ₃	NaOH	H ₂ SO ₄
Lab Use Only	Sample ID	Date/Time Sampled	Matrix	HCL	MeOH	NaHSO ₄	TSP
23071867 011 06 A		7/26/23	Aqueous	X			
012 06 B			Aqueous				
013 07 A			Aqueous				
014 07 B			Aqueous				
015 08 A			Aqueous				
016 08 B			Aqueous				
017 09 A			Aqueous				
018 09 B			Aqueous				
019 10 A			Aqueous				
020 10 B			Aqueous				
Relinquished By A Hagerty		Date/Time 7/26/23		Received By Morgan Petrucci		Date/Time 7/26/23/227	

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabin.com for terms and conditions

CHAIN OF CUSTODY

Pg 4 of 11 Workorder # 23071867

TEKLAB INC. 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC		Samples on: ☐ ICE ☐ BLUE ICE ☒ NO ICE _____ °C										
Address: 3130 Gravois Ave.		Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY										
City/State/Zip: Collinsville, IL 62234		LAB NOTES:										
Contact: Anthony Hagerty Phone: (314) 449-1976		Client Comments: Please Report in PPB Hazelwood West High School										
Email: tony.hagerty@enpaqconsulting.com Fax:												
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No												
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No												
PROJECT NAME/NUMBER Hazelwood SD/ 23-170	SAMPLE COLLECTOR'S NAME <i>Anthony Hagerty</i>	# and Type of Containers	INDICATE ANALYSIS REQUESTED									
RESULTS REQUESTED ☒ Standard ☐ 1-2 Day (100% Surcharge) ☐ Other _____ ☐ 3 Day (50% Surcharge)		BILLING INSTRUCTIONS										
Lab Use Only	Sample ID	Date/Time Sampled	Matrix	UNP	HNO ₃	NaOH	H ₂ SO ₄	HCl	MeOH	NaHSO ₄	TSP	Other
0301 B67	031 17 A	7/26/23	Aqueous	X								
	032 17 B		Aqueous									
	033 18 A		Aqueous									
	034 18 B		Aqueous									
	035 19 A		Aqueous									
	036 19 B		Aqueous									
	037 20 A		Aqueous									
	038 20 B		Aqueous									
	039 21 A		Aqueous									
	040 21 B		Aqueous									
			Aqueous									
Relinquished By <i>A. Hagerty</i>		Date/Time 7/26/23		Received By <i>Morgan Perkin</i>		Date/Time 7/26/23 [initials]						

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg 5 of 11 Workorder # 23071867

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: <u>ENPAQ, LLC</u>				Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE _____ °C			
Address: <u>3130 Gravois Ave.</u>				Preserved in: ☐ LAB ☐ FIELD <u>FOR LAB USE ONLY</u>			
City/State/Zip: <u>Collinsville, IL 62234</u>				LAB NOTES:			
Contact: <u>Anthony Hagerty</u>		Phone: <u>(314) 449-1976</u>		Client Comments:			
Email: <u>tony.hagerty@enpaqconsulting.com</u>		Fax:		Please Report in PPB			
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No				<u>Hazelwood West High School</u>			
Are these samples known to be hazardous? ☐ Yes ☒ No							
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No							
PROJECT NAME/NUMBER <u>Hazelwood SD/ 23-170</u>		SAMPLE COLLECTOR'S NAME <u>Anthony Hagerty</u>		# and Type of Containers		INDICATE ANALYSIS REQUESTED	
RESULTS REQUESTED		BILLING INSTRUCTIONS		UNP	HNO3	NaOH	H2SO4
☒ Standard	☐ 1-2 Day (100% Surcharge)						
☐ Other _____	☐ 3 Day (50% Surcharge)						
Lab Use Only	Sample ID	Date/Time Sampled	Matrix				
<u>23071807 -041</u>	<u>22 A</u>	<u>7/26/23</u>	Aqueous	X			
<u>042</u>	<u>22 B</u>		Aqueous				
<u>043</u>	<u>23 A</u>		Aqueous				
<u>044</u>	<u>23 B</u>		Aqueous				
<u>045</u>	<u>24 A</u>		Aqueous				
<u>046</u>	<u>24 B</u>		Aqueous				
<u>047</u>	<u>25 A</u>		Aqueous				
<u>048</u>	<u>25 B</u>		Aqueous				
<u>049</u>	<u>26 A</u>		Aqueous				
<u>050</u>	<u>26 B</u>		Aqueous				
<u>051</u>			Aqueous				
Relinquished By <u>A. Hagerty</u>		Date/Time <u>7/26/23</u>		Received By <u>Morgan Dean</u>		Date/Time <u>7/26/23 1227</u>	

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg 9 of 11 Workorder # 23071867

TEKLAB INC. 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

[illegible]

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg 8 of 11 Workorder # 23071867

TEKLAB INC. 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC Address: 3130 Gravois Ave. City/State/Zip: Collinsville, IL 62234 Contact: Anthony Hagerty Phone: (314) 449-1976 Email: tony.hagerty@enpaqconsulting.com Fax:				Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE _____ °C Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY LAB NOTES: Client Comments: Please Report in PPB <i>Hazelwood West High School</i>															
Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No Are these samples known to be hazardous? ☐ Yes ☒ No Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No																			
PROJECT NAME/NUMBER Hazelwood SD/ 23-170				SAMPLE COLLECTOR'S NAME <i>Anthony Hagerty</i>				# and Type of Containers				INDICATE ANALYSIS REQUESTED							
RESULTS REQUESTED ☒ Standard ☐ 1-2 Day (100% Surcharge) ☐ Other ☐ 3 Day (50% Surcharge)				BILLING INSTRUCTIONS				UNP HNO3 NaOH H2SO4 HCL MeOH NaHSO4 TSP Other											
Lab Use Only		Sample ID		Date/Time Sampled		Matrix													
23071801 -071 072001		37 A		7/26/23		Aqueous		X											
-072 073002		37 B				Aqueous													
073 074003		38 A				Aqueous													
074 075004		38 B				Aqueous													
075 076005		39 A				Aqueous													
076 077006		39 B				Aqueous													
077 078007		40 A				Aqueous													
078 079008		40 B				Aqueous													
079 080009		41 A				Aqueous													
080 081010		41 B				Aqueous													
ERH 7/27/23						Aqueous													
Relinquished By <i>A. Hagerty</i>				Date/Time 7/26/23				Received By <i>Morgan Ketchum</i>				Date/Time 7/26/23 [22]							

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg 10 of 11 Workorder # 23071867

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: ENPAQ, LLC
 Address: 3130 Gravois Ave.
 City/State/Zip: Collinsville, IL 62234
 Contact: Anthony Hagerty Phone: (314) 449-1976
 Email: tony.hagerty@enpaqconsulting.com Fax:

Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE _____ °C
 Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY
 LAB NOTES:

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No
 Are these samples known to be hazardous? ☐ Yes ☒ No
 Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in the comment section: ☒ Yes ☐ No

Client Comments:
 Please Report in PPB

Hazelwood West High School

PROJECT NAME/NUMBER		SAMPLE COLLECTOR'S NAME		# and Type of Containers		INDICATE ANALYSIS REQUESTED																		
Hazelwood SD/ 23-170		<u>Anthony Hagerty</u>		UNP	HNO3	NaOH	H2SO4	HCL	MeOH	NaHSO4	TSP	Other												
RESULTS REQUESTED ☒ Standard ☐ 1-2 Day (100% Surcharge) ☐ Other ☐ 3 Day (50% Surcharge)				BILLING INSTRUCTIONS																				
Lab Use Only	Sample ID	Date/Time Sampled	Matrix	UNP	HNO3	NaOH	H2SO4	HCL	MeOH	NaHSO4	TSP	Other												
<u>3071867-091</u>	<u>47 A</u>	<u>7/26/23</u>	<u>Aqueous</u>	X																				
<u>-092-093082</u>	<u>47 B</u>		<u>Aqueous</u>																					
<u>-093-094083</u>	<u>48 A</u>		<u>Aqueous</u>																					
<u>-094-095084</u>	<u>48 B</u>		<u>Aqueous</u>																					
<u>-095-096085</u>	<u>49 A</u>		<u>Aqueous</u>																					
<u>-096-097086</u>	<u>49 B</u>		<u>Aqueous</u>																					
<u>-097-098087</u>	<u>50 A</u>		<u>Aqueous</u>																					
<u>-098-099088</u>	<u>50 B</u>		<u>Aqueous</u>																					
<u>-099-100089</u>	<u>52 A</u>		<u>Aqueous</u>																					
<u>100-101090</u>	<u>52 B</u>		<u>Aqueous</u>																					

Relinquished By	Date/Time	Received By	Date/Time
<u>A Hagerty</u>	<u>7/26/23</u>	<u>Monique Vera</u>	<u>7/26/23 1227</u>

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg 11 of 11 Workorder # 23071867

TEKLAB INC. 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

[illegible]

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

Prep Day: 7/25/23

Sample Day: 7/26/23

To Lab -----> 7/26/23

* Reporting Limit

to Test = _____
 # Disabled = _____
 # of Samples = _____
 # > 10.0 ppb = _____
 # > 0.5 ppb = _____

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
01	(A)	S	3 Bay Sink O/S Office- Left		1.0	ppb
	(B)	S	3 Bay Sink O/S Office- Left		1.0	1.0 ppb
	(C)	S			1.0	22.0 ppb
02	(A)	S	3 Bay Sink O/S Office - Right		1.0	135.0 ppb
	(B)	S	3 Bay Sink O/S Office - Right		1.0	ppb
03	(A)	S	1 Bay Sink by Mixer		1.0	ppb
	(B)	S	1 Bay Sink by Mixer		1.0	ppb
04	(A)	S	1 Bay Sink by Freezer		1.0	ppb
	(B)	S	1 Bay Sink by Freezer		1.0	ppb
05	(A)	S	Pot Filler		1.0	ppb
	(B)	S	Pot Filler		1.0	ppb
06	(A)	S	1 Bay Sink Dishwashing Station		1.0	ppb
	(B)	S	1 Bay Sink Dishwashing Station		1.0	ppb
07	(A)	F	Fountain Café O/S Girls RR		1.0	ppb
	(B)	F	Fountain Café O/S Girls RR		1.0	ppb
08	(A)	F	Fountain Café O/S Boys RR		1.0	ppb
	(B)	F	Fountain Café O/S Boys RR		1.0	ppb
09	(A)	F	Fountain O/S Theater Rm		1.0	ppb
	(B)	F	Fountain O/S Theater Rm		1.0	ppb
10	(A)	F	Fountain O/S Rm 157		1.0	ppb
	(B)	F	Fountain O/S Rm 157		1.0	ppb
11	(A)	F	Fountain Gym		1.0	ppb

28071807

(B)	F	Fountain Gym	1.0	ppb
-----	---	--------------	-----	-----

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
12	(A)	F	Fountain O/S Trainers Office		1.0	ppb
	(B)	F	Fountain O/S Trainers Office		1.0	ppb
13	(A)	F	Fountain O/S Gym by Storage (Inactive)		1.0	ppb
	(B)	F	Fountain O/S Gym by Storage (Inactive)		1.0	ppb
14	(A)	F	Fountain - Girls Locker Rm (Pool)		-	ppb
	(B)	F	Fountain - Girls Locker Rm (Pool)		-	ppb
15	(A)	F	Fountain - Boys Locker Rm (Pool)		1.0	ppb
	(B)	F	Fountain - Boys Locker Rm (Pool)		1.0	ppb
16	(A)	F	Fountain - Pool Area		1.0	ppb
	(B)	F	Fountain - Pool Area		1.0	ppb
17	(A)	S	Athletic Trainers Office		1.0	ppb
	(B)	S	Athletic Trainers Office		1.0	ppb
18	(A)	F	Fountain O/S P.E. Office		1.0	ppb
	(B)	F	Fountain O/S P.E. Office		1.0	ppb
19	(A)	F	Fountain O/S Wrestling Rm		1.0	ppb
	(B)	F	Fountain O/S Wrestling Rm		1.0	ppb
20	(A)	F	Fountain O/S Custodial Closet Rm 132		1.0	ppb
	(B)	F	Fountain O/S Custodial Closet Rm 132		1.0	ppb
21	(A)	S	Teachers Work Room (Front Office)		1.0	ppb
	(B)	S	Teachers Work Room (Front Office)		1.0	ppb
22	(A)	F	Fountain - Band Wing - 2nd Floor		1.0	ppb
	(B)	F	Fountain - Band Wing - 2nd Floor		1.0	ppb
23	(A)	F	Fountain O/S Rm CR245 - Left		1.0	ppb
	(B)	F	Fountain O/S Rm CR245 - Left		1.0	ppb
24	(A)	F	Fountain O/S Rm CR245 - Right		1.0	ppb
	(B)	F	Fountain O/S Rm CR245 - Right		1.0	ppb

23071807

25	(A)	F	Fountain O/S Rm 259		1.0	ppb
	(B)	F	Fountain O/S Rm 259		1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
26	(A)	F	Fountain O/S Rm 223		1.0	ppb
	(B)	F	Fountain O/S Rm 223		1.0	ppb
27	(A)	F	Fountain O/S Rm 208		1.0	ppb
	(B)	F	Fountain O/S Rm 208		1.0	ppb
28	(A)	F	Fountain O/S Rm 219		1.0	ppb
	(B)	F	Fountain O/S Rm 219		1.0	ppb
29	(A)	S	Sink - Rm 223 (Work Room)		-	ppb
	(B)	S	Sink - Rm 223 (Work Room)		-	ppb
30	(A)	S	Teachers Toolbox Rm CR009		-	ppb
	(B)	S	Teachers Toolbox Rm CR009		-	ppb
31	(A)	F	Fountain O/S Rm CR009		2.0	ppb
	(B)	F	Fountain O/S Rm CR009		1.0	ppb
32	(A)	F	Fountain O/S Rm CR013 - Left		-	ppb
	(B)	F	Fountain O/S Rm CR013 - Left		-	ppb
33	(A)	F	Fountain O/S Rm CR013 - Right		1.0	ppb
	(B)	F	Fountain O/S Rm CR013 - Right		1.0	ppb
34	(A)	S	Sink Rm CR006 - Station 1		1.0	ppb
	(B)	S	Sink Rm CR006 - Station 1		1.0	ppb
35	(A)	S	Sink Rm CR006 - Station 2		1.0	ppb
	(B)	S	Sink Rm CR006 - Station 2		1.0	ppb
36	(A)	S	Sink Rm CR006 - Station 3		1.0	ppb
	(B)	S	Sink Rm CR006 - Station 3		1.0	ppb
37	(A)	S	Sink Rm CR006 - Station 4		1.0	ppb
	(B)	S	Sink Rm CR006 - Station 4		1.0	ppb
38	(A)	S	Sink Rm CR006 - Station 5		1.0	ppb

23071807

	(B)	S	Sink Rm CR006 - Station 5		1.0	ppb
39	(A)	S	Sink Rm CR005 - 1 Bay - Prep		1.0	ppb
	(B)	S	Sink Rm CR005 - 1 Bay - Prep		1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
40	(A)	S	Sink Rm CR005 - 3 Bay - Dishwash Station		1.0	ppb
	(B)	S	Sink Rm CR005 - 3 Bay - Dishwash Station		1.0	ppb
41	(A)	F	Fountain O/S Rm CR005		1.0	ppb
	(B)	F	Fountain O/S Rm CR005		1.0	ppb
42	(A)	F	Fountain O/S Rm CR017		1.0	ppb
	(B)	F	Fountain O/S Rm CR017		1.0	ppb
43	(A)	S	Sink Rm CR016 - Station 1		1.0	ppb
	(B)	S	Sink Rm CR016 - Station 1		1.0	ppb
44	(A)	S	Sink Rm CR016 - Station 2		1.0	ppb
	(B)	S	Sink Rm CR016 - Station 2		1.0	ppb
45	(A)	S	Sink Rm CR016 - Station 3		1.0	ppb
	(B)	S	Sink Rm CR016 - Station 3		1.0	ppb
46	(A)	S	Sink Rm CR016 - Station 4		1.0	ppb
	(B)	S	Sink Rm CR016 - Station 4		1.0	ppb
47	(A)	S	Sink Rm CR016 - Station 5		1.0	ppb
	(B)	S	Sink Rm CR016 - Station 5		1.0	ppb
48	(A)	F	Fountain O/S Storage Closet 210 - Left		1.0	ppb
	(B)	F	Fountain O/S Storage Closet 210 - Left		1.0	ppb
49	(A)	F	Fountain O/S Storage Closet 210 - Right		1.0	ppb
	(B)	F	Fountain O/S Storage Closet 210 - Right		1.0	ppb
50	(A)	S	Nurse's Office		1.0	ppb
	(B)	S	Nurse's Office		1.0	ppb
51	(A)	F	Fountain O/S Rm 132 (Inactive)		1.0	ppb
	(B)	F	Fountain O/S Rm 132 (Inactive)		1.0	ppb

2307184

52	(A)	F	Fountain O/S Rm 126	1.0	ppb
	(B)	F	Fountain O/S Rm 126	1.0	ppb
53	(A)	S	Teachers Lounge	1.0	ppb
	(B)	S	Teachers Lounge	1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
54	(A)	F	Fountain O/S Rm 122		1.0	ppb
	(B)	F	Fountain O/S Rm 122		1.0	ppb
55	(A)	F	Fountain O/S Custodial Closet Rm 112		1.0	ppb
	(B)	F	Fountain O/S Custodial Closet Rm 112		1.0	ppb
56	(A)	F	Fountain O/S Rm 109		1.0	ppb
	(B)	F	Fountain O/S Rm 109		1.0	ppb
57	(A)				1.0	ppb
	(B)				1.0	ppb
58	(A)				1.0	ppb
	(B)				1.0	ppb
59	(A)				1.0	ppb
	(B)				1.0	ppb
60	(A)				1.0	ppb
	(B)				1.0	ppb
61	(A)				1.0	ppb
	(B)				1.0	ppb
62	(A)				1.0	ppb
	(B)				1.0	ppb
63	(A)				1.0	ppb
	(B)				1.0	ppb
64	(A)				1.0	ppb
	(B)				1.0	ppb
65	(A)				1.0	ppb

23071807

APPENDIX C

CREDENTIALS

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

Lead Abatement Contractor License


The person, firm or corporation whose name appears on this certificate is licensed as a Lead Abatement Contractor as set forth in the Missouri Revised Statutes 701.300-701.338 and 19 CSR 30-70.180, as long as not suspended or revoked, and is hereby authorized to engage in lead-bearing substance activities.

Issued to:

ENPAQ, LLC

**2321 Rutger Street, Unit F
St. Louis, MO 63104**

Issuance Date: **2/10/2023**
Expiration Date: **2/26/2025**
License Number: **190226-004574**

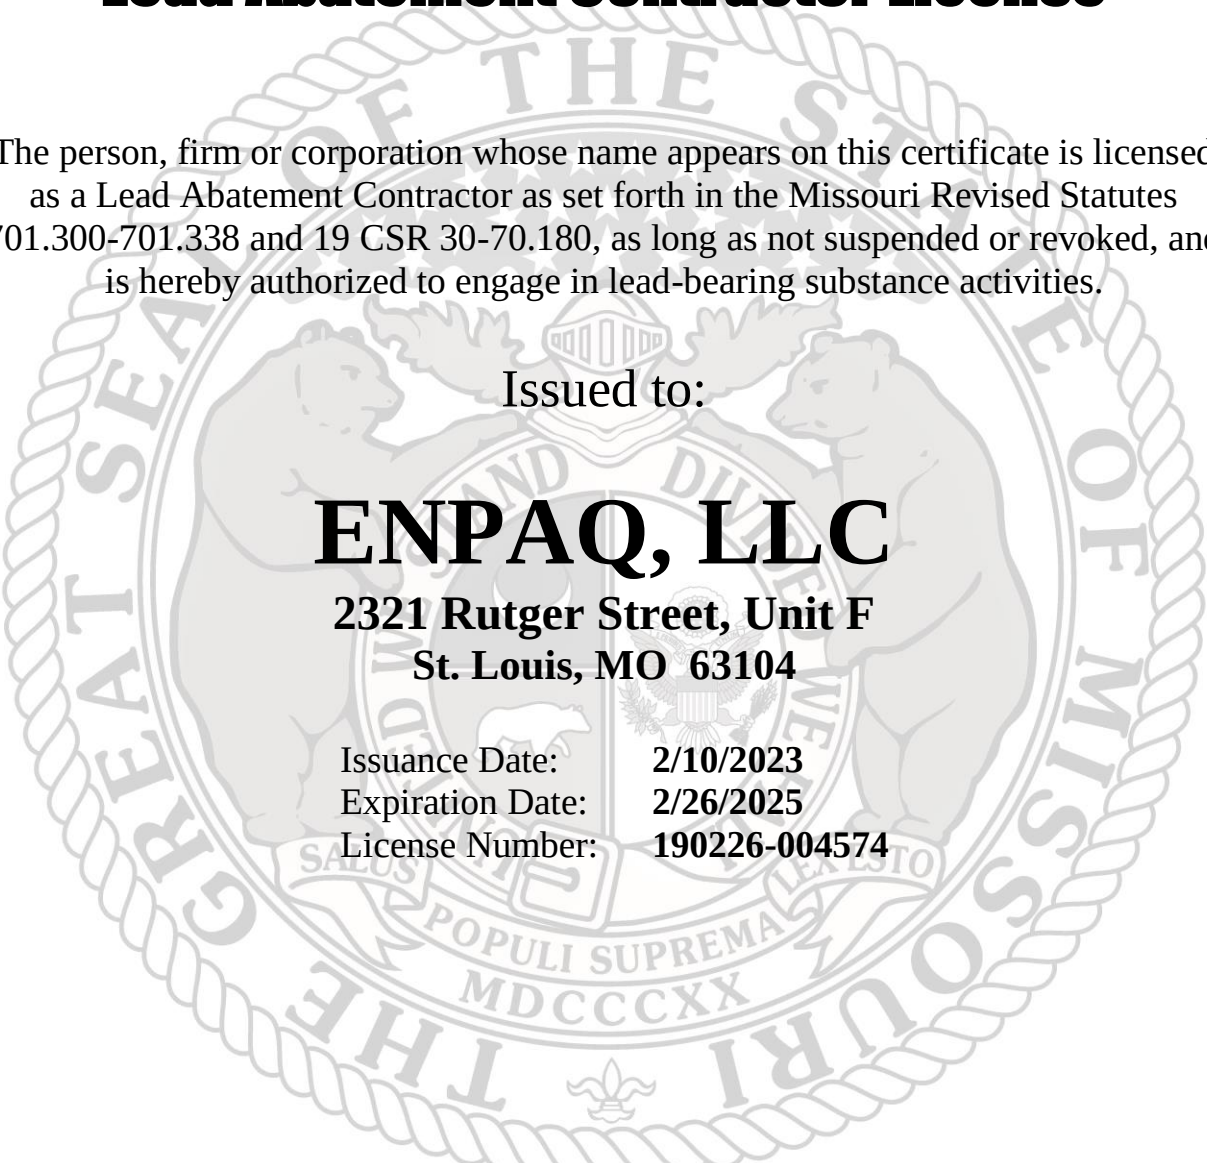

Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Anthony W. Hagerty

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **10/17/2022**
Expiration Date: **10/31/2024**
License Number: **161031-300005062**



Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

Anthony Hagerty

3959 McDonald Ave, St. Louis, MO 63116

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 190510

Examination Date: 3/7/2022

CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104
(314) 977-8256 slu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

Christopher C. King
Christopher C. King PhD
Director, Center for Environmental
Education and Training

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

James T. Earle

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **7/30/2022**
Expiration Date: **7/30/2024**
License Number: **180730-300005561**



Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

James Earle

7484 Ahern Ct., University City, MO 63130

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117401
Examination Date: 3/7/2022
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104
(314) 977-8256 slu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

Christopher C. King
Christopher C. King PhD
Director, Center for Environmental
Education and Training

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Zachary A. Haselhorst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **3/1/2022**
Expiration Date: **3/1/2024**
License Number: **160229-300004899**



A handwritten signature in black ink, appearing to read 'Richard W. Moore', is positioned above the printed name.

Richard W. Moore
Acting Director
Department of Health and Senior Services

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

Zachary Haselhorst

209 E 5th St, Trenton, IL 62293

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117400
Examination Date: 3/7/2022
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104
(314) 977-8256 slu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

Christopher C. King
Christopher C. King PhD
Director, Center for Environmental
Education and Training

State of Missouri
Department of Natural Resources

Certificate of Approval
for Chemical Laboratory Service

This is to certify that

Teklab, Incorporated

is hereby approved to perform the analysis of drinking water as specified on the
Certified Parameter List, which must accompany this certificate to be valid.


Certification Number 930

Date Issued December 13, 2021

Expiration Date January 31, 2025



Laboratory Certification Authority, Public Drinking Water Branch
Missouri Department of Natural Resources



Laboratory Certification Officer, Environmental Services Program
Missouri Department of Natural Resources

MISSOURI DEPARTMENT OF NATURAL RESOURCES
DRINKING WATER LABORATORY
CERTIFIED PARAMETER LIST

This is to certify that

Teklab, Incorporated

located at

5445 Horseshoe Lake Road, Collinsville, IL 62234

has been approved to perform the indicated procedures on drinking water under the Missouri Public Drinking Water Regulations (10 CSR 60-5.020). Specific method numbers or references are included in parenthesis when appropriate.

INORGANIC

EPA 335.4

Total Cyanide

EPA 353.2

Nitrate, Nitrite, Total Nitrate and Nitrite

EPA 245.1

Mercury

EPA 200.7

Barium, Beryllium, Cadmium, Chromium, Copper, Nickel

EPA 200.8

Antimony, Arsenic, Barium, Beryllium, Cadmium, Chromium, Copper, Lead, Nickel, Selenium, Thallium

SM4500F-C

Fluoride

SM4500NO2-B

Nitrite

Teklab, Incorporated

Expiration Date: January 31, 2025

Missouri Certificate No.: 930

Original Certifying State: Illinois