May 31, 2024

Steve Aldrich
Director of Facilities and Grounds
Liberty School District
801 Kent Street
Liberty, Missouri 64068

Project: Limited Lead in Drinking Water Testing
Address: 800 Midjay Drive, Liberty, Missouri 64068

Mr. Steve Aldrich

On April 2, 2024 and April 30, 2024, Becca McWhorter and/or Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 160 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of “lead free” to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of “lead free” as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: https://www.epa.gov/dwreginfo/lead-and-copper-rule

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.
Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school’s buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in red text.

April 2, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
800-1-FD	Discovery Middle - 004133-Nurse's Office-Across From Restroom	Sink Tap	First Draw	0.7
800-2-FD	Discovery Middle - 004134-Nurse's Office-Across From Desk	Sink Tap	First Draw	<0.4
800-3-FD	Discovery Middle - 004131-Nurse's Office-Restroom	Sink Tap	First Draw	<0.4
800-4-FD	Discovery Middle - 004132-Nurse's Office-Restroom	Sink Tap	First Draw	0.5
800-5-FD	Discovery Middle - 004250-Lounge-Restroom	Sink Tap	First Draw	<0.4
800-6-FD	Discovery Middle - 004251-Lounge	Sink Tap	First Draw	0.6

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
800-7-FD	Discovery Middle - 004252-Lounge-Restroom	Sink Tap	First Draw	0.4
800-8-FD	Discovery Middle - 004791-Room 124	Sink Tap	First Draw	0.7
800-9-FD	Discovery Middle - 004792-Room 124	Bubbler	First Draw	0.5
800-10-FD	Discovery Middle - 004793-Room 123	Sink Tap	First Draw	0.8
800-11-FD	Discovery Middle - 004794-Room 123	Bubbler	First Draw	<0.4
800-12-FD	Discovery Middle - 004128-Room 100	Sink Tap	First Draw	0.4
800-13-FD	Discovery Middle - 004129-Room 100	Bubbler	First Draw	<0.4
800-14-FD	Discovery Middle - 004126-Room 101	Sink Tap	First Draw	<0.4
800-15-FD	Discovery Middle - 004127-Room 101	Bubbler	First Draw	0.7
800-16-FD	Discovery Middle - 004114-Room 104	Sink Tap	First Draw	0.4
800-17-FD	Discovery Middle - 004113-Room 104	Bubbler	First Draw	0.4
800-18-FD	Discovery Middle - 004108-Room 105	Sink Tap	First Draw	0.8
800-19-FD	Discovery Middle - 004107-Room 105	Bubbler	First Draw	0.8
800-20-FD	Discovery Middle - 004112-Room 106	Sink Tap	First Draw	0.9
800-21-FD	Discovery Middle - 004111-Room 106	Bubbler	First Draw	0.4
800-22-FD	Discovery Middle - 004110-Room 107	Sink Tap	First Draw	0.4
800-23-FD	Discovery Middle - 004109-Room 107	Bubbler	First Draw	<0.4
800-24-FD	Discovery Middle - 004106-Room 108	Sink Tap	First Draw	0.5
800-25-FD	Discovery Middle - 004102-100 Hall-Girls-Right Sink	Sink Tap	First Draw	0.7
800-26-FD	Discovery Middle - 004101-100 Hall-Girls-Middle Sink	Sink Tap	First Draw	0.7
800-27-FD	Discovery Middle - 004300-100 Hall-Girls-Left Sink	Sink Tap	First Draw	<0.4
800-28-FD	Discovery Middle - 004103-100 Hall-Boys-Right Sink	Sink Tap	First Draw	0.4
800-29-FD	Discovery Middle - 004104-100 Hall-Boys-Middle Sink	Sink Tap	First Draw	<0.4
800-30-FD	Discovery Middle - 003204-100 Hall-Boys-Left Sink	Sink Tap	First Draw	0.6
800-31-FD	Discovery Middle - 004298-100 Hall	Drinking Fountain	First Draw	<0.4
800-32-	Discovery Middle - 004299-100 Hall Out of Order	Drinking Fountain	Not Tested	Not Sampled

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
800-33-	Discovery Middle - 004299F-By 100 Hall Out of Order	Bottle Filler	Not Tested	Not Sampled
800-34-FD	Discovery Middle - 004295-Room 109	Sink Tap	First Draw	5.1
800-35-FD	Discovery Middle - 004294-Room 109	Bubbler	First Draw	<0.4
800-36-FD	Discovery Middle - 004293-Room 110	Sink Tap	First Draw	3.2
800-37-FD	Discovery Middle - 004292-Room 110	Bubbler	First Draw	<0.4
800-38-FD	Discovery Middle - 004290-Room 111	Sink Tap	First Draw	4.2
800-39-FD	Discovery Middle - 004291-Room 111	Bubbler	First Draw	<0.4
800-40-FD	Discovery Middle - 004297-Room 112	Sink Tap	First Draw	5.3
800-41-FD	Discovery Middle - 004296-Room 112	Bubbler	First Draw	0.4
800-42-FD	Discovery Middle - 004288-Room 113	Sink Tap	First Draw	6.7
800-43-FD	Discovery Middle - 004289-Room 113	Bubbler	First Draw	0.4
800-44-FD	Discovery Middle - 004275-Room 116	Sink Tap	First Draw	2.4
800-45-FD	Discovery Middle - 004276-Room 116	Bubbler	First Draw	<0.4
800-46-FD	Discovery Middle - 004274-Room 118	Sink Tap	First Draw	3.6
800-47-FD	Discovery Middle - 004273-Room 118	Bubbler	First Draw	0.7
800-48-FD	Discovery Middle - 004797-Room 119	Sink Tap	First Draw	0.9
800-49-FD	Discovery Middle - 004798-Room 119	Bubbler	First Draw	<0.4
800-50-FD	Discovery Middle - 004795-Room 120	Sink Tap	First Draw	1.1
800-51-FD	Discovery Middle - 004796-Room 120	Bubbler	First Draw	0.4
800-52-FD	Discovery Middle - 004267-Room 203-Far Left Sink	Sink Tap	First Draw	0.4
800-53-FD	Discovery Middle - 004268-Room 203	Sink Tap	First Draw	<0.4
800-54-FD	Discovery Middle - 004269-Room 203	Sink Tap	First Draw	<0.4
800-55-FD	Discovery Middle - 004270-Room 203	Sink Tap	First Draw	4.2
800-56-FD	Discovery Middle - 004271-Room 203	Sink Tap	First Draw	<0.4
800-57-FD	Discovery Middle - 004272-Room 203	Sink Tap	First Draw	1.8
800-58-FD	Discovery Middle - 004259-Room 204	Sink Tap	First Draw	14.9

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
800-59-FD	Discovery Middle - 004260-Room 204	Bubbler	First Draw	<0.4
800-60-FD	Discovery Middle - 004265-Room 205-Right Sink	Sink Tap	First Draw	32.2
800-61-FD	Discovery Middle - 004266-Room 205-Left Sink	Sink Tap	First Draw	37.2
800-62-FD	Discovery Middle - 003202-Room 207-Far Left Sink	Sink Tap	First Draw	35.1
800-63-FD	Discovery Middle - 004261-Room 207	Sink Tap	First Draw	49.7
800-64-FD	Discovery Middle - 004262-Room 207	Sink Tap	First Draw	31.3
800-65-FD	Discovery Middle - 004263-Room 207	Sink Tap	First Draw	31.2
800-66-FD	Discovery Middle - 004264-Room 207	Sink Tap	First Draw	36.2
800-67-FD	Discovery Middle - 004253-Room 206-Kitchen 1	Sink Tap	First Draw	1.4
800-68-FD	Discovery Middle - 004254-Room 206-Kitchen 2	Sink Tap	First Draw	32.2
800-69-FD	Discovery Middle - 004255-Room 206-Kitchen 3	Sink Tap	First Draw	24.2
800-70-FD	Discovery Middle - 004256-Room 206-Kitchen 4	Sink Tap	First Draw	36.2
800-71-FD	Discovery Middle - 004257-Room 206-Kitchen 5	Sink Tap	First Draw	44.6
800-72-FD	Discovery Middle - 004258-Room 206-Kitchen 6	Sink Tap	First Draw	45.6
800-73-FD	Discovery Middle - 004781-Room 319	Sink Tap	First Draw	0.4
800-74-FD	Discovery Middle - 004799-Room 318	Sink Tap	First Draw	8.5
800-75-FD	Discovery Middle - 004800-Room 318	Bubbler	First Draw	0.4
800-76-FD	Discovery Middle - 004247-Room 315	Sink Tap	First Draw	1.9
800-77-FD	Discovery Middle - 004246-Room 315	Bubbler	First Draw	<0.4
800-78-FD	Discovery Middle - 004242-Room 316	Sink Tap	First Draw	7.1
800-79-FD	Discovery Middle - 004243-Room 316	Bubbler	First Draw	<0.4
800-80-FD	Discovery Middle - 004245-Room 314	Sink Tap	First Draw	4.1
800-81-FD	Discovery Middle - 004244-Room 314	Bubbler	First Draw	<0.4
800-82-FD	Discovery Middle - 004230-Room 311	Sink Tap	First Draw	<0.4
800-83-FD	Discovery Middle - 004229-Room 311	Bubbler	First Draw	<0.4
800-84-FD	Discovery Middle - 004231-Room 310	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
800-85-FD	Discovery Middle - 004232-Room 310	Bubbler	First Draw	<0.4
800-86-FD	Discovery Middle - 004227-Room 309	Sink Tap	First Draw	0.6
800-87-FD	Discovery Middle - 004228-Room 309	Bubbler	First Draw	<0.4
800-88-FD	Discovery Middle - 004226-Room 308	Sink Tap	First Draw	0.6
800-89-FD	Discovery Middle - 004225-Room 308	Bubbler	First Draw	<0.4
800-90-FD	Discovery Middle - 004224-Room 307	Sink Tap	First Draw	0.6
800-91-FD	Discovery Middle - 004223-Room 307	Bubbler	First Draw	<0.4
800-92-FD	Discovery Middle - 004782-300 Hall-Girls-Left Sink	Sink Tap	First Draw	2.2
800-93-FD	Discovery Middle - 004783-300 Hall-Girls-Middle Sink	Sink Tap	First Draw	2.3
800-94-FD	Discovery Middle - 004784-300 Hall-Girls-Right Sink	Sink Tap	First Draw	0.5
800-95-FD	Discovery Middle - 004785-300 Hall-Boys-Left Sink	Sink Tap	First Draw	0.6
800-96-FD	Discovery Middle - 004786-300 Hall-Boys-Middle Sink	Sink Tap	First Draw	1
800-97-FD	Discovery Middle - 004787-300 Hall-Boys-Right Sink	Sink Tap	First Draw	1.3
800-98-FD	Discovery Middle - 004130-300 Hall-By Girls Restroom	Drinking Fountain	First Draw	<0.4
800-99-FD	Discovery Middle - 004221B-300 Hall	Drinking Fountain	First Draw	<0.4
800-100-FD	Discovery Middle - 004221F-300 Hall	Bottle Filler	First Draw	<0.4
800-101-FD	Discovery Middle - 004222-Across from 301	Drinking Fountain	First Draw	<0.4
800-102-FD	Discovery Middle - 004219-Room 306	Sink Tap	First Draw	0.7
800-103-FD	Discovery Middle - 004220-Room 306	Bubbler	First Draw	<0.4
800-104-FD	Discovery Middle - 004218-Room 303	Sink Tap	First Draw	0.9
800-105-FD	Discovery Middle - 004217-Room 303	Bubbler	First Draw	<0.4
800-106-FD	Discovery Middle - 004216-Room 303	Sink Tap	First Draw	<0.4
800-107-FD	Discovery Middle - 004215-Band Storage Next to 301	Drinking Fountain	First Draw	<0.4
800-108-FD	Discovery Middle - 004214-Room 300	Sink Tap	First Draw	0.4
800-109-FD	Discovery Middle - 004790-Library-Maker Space	Sink Tap	First Draw	0.7
800-110-FD	Discovery Middle - 004789-Library Restroom	Sink Tap	First Draw	0.5

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
800-111-FD	Discovery Middle - 004788-Library	Drinking Fountain	First Draw	<0.4
800-112-FD	Discovery Middle - 004776-Commons-Girls	Sink Tap	First Draw	0.6
800-113-FD	Discovery Middle - 004777-Commons-Girls	Sink Tap	First Draw	0.5
800-114-FD	Discovery Middle - 004778-Commons-Girls	Sink Tap	First Draw	0.4
800-115-FD	Discovery Middle - 004201-Commons-Boys	Sink Tap	First Draw	<0.4
800-116-FD	Discovery Middle - 003206-Commons-Boys	Sink Tap	First Draw	0.4
800-117-FD	Discovery Middle - 004779-Commons-Boys	Sink Tap	First Draw	0.8
800-118-FD	Discovery Middle - 004773-Commons-Right	Drinking Fountain	First Draw	<0.4
800-119-FD	Discovery Middle - 004774-Commons-Middle	Drinking Fountain	First Draw	<0.4
800-120-FD	Discovery Middle - 004775B-Commons	Drinking Fountain	First Draw	<0.4
800-121-FD	Discovery Middle - 004775F-Commons	Bottle Filler	First Draw	<0.4
800-122-FD	Discovery Middle - 003205-Commons-Left	Drinking Fountain	First Draw	<0.4
800-123-FD	Discovery Middle - 004204-Gym	Bottle Filler	First Draw	<0.4
800-124-FD	Discovery Middle - 004206-Gym	Drinking Fountain	First Draw	<0.4
800-125-FD	Discovery Middle - 004202-Gym-Restroom	Sink Tap	First Draw	0.4
800-126-FD	Discovery Middle - 004203-Gym-Restroom-Right Sink	Sink Tap	First Draw	<0.4
800-127-	Discovery Middle - 004205-Gym Out of Order	Drinking Fountain	Not Tested	Not Sampled
800-128-FD	Discovery Middle - 004211-Girls Locker Room	Sink Tap	First Draw	2.1
800-129-FD	Discovery Middle - 004212-Girls Locker Room	Sink Tap	First Draw	1.1
800-130-FD	Discovery Middle - 004213-Girls Locker Room	Sink Tap	First Draw	1.5
800-131-FD	Discovery Middle - 003210-Girls Locker Room-Office	Sink Tap	First Draw	<0.4
800-132-FD	Discovery Middle - 003209-Girls Locker Room	Drinking Fountain	First Draw	<0.4
800-133-FD	Discovery Middle - 004207-Boys Locker Room	Sink Tap	First Draw	3.5
800-134-FD	Discovery Middle - 004208-Boys Locker Room	Sink Tap	First Draw	2.6
800-135-FD	Discovery Middle - 004210-Boys Locker Room-Coach Office	Sink Tap	First Draw	0.5

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
800-136-FD	Discovery Middle - 004209-Boys Locker Room	Drinking Fountain	First Draw	<0.4
800-137-FD	Discovery Middle - 003208-Weight Room-Restroom	Sink Tap	First Draw	0.5
800-138-FD	Discovery Middle - 003207-Weight Room	Drinking Fountain	First Draw	<0.4
800-139-FD	Discovery Middle - 004685-Kitchen Outside Office	Sink Tap	First Draw	0.9
800-140-FD	Discovery Middle - 004686-Kitchen Outside Office	Sink Tap	First Draw	0.7
800-141-FD	Discovery Middle - 004687-Kitchen-Handwashing-Next to Air Hood	Sink Tap	First Draw	4
800-142-FD	Discovery Middle - 004688-Kitchen-Handwashing-Dry Storage	Sink Tap	First Draw	1.8
800-143-FD	Discovery Middle - 004691-Kitchen-Across from Lounge	Sink Tap	First Draw	<0.4
800-144-FD	Discovery Middle - 004692-Kitchen-Across from Freezer	Sink Tap	First Draw	2.4
800-145-FD	Discovery Middle - 004693-Kitchen-East Wall	Sink Tap	First Draw	1.1
800-146-FD	Discovery Middle - 004694-Kitchen-East Wall	Sink Tap	First Draw	8.1
800-147-FD	Discovery Middle - 004695-Kitchen-East Wall	Sink Tap	First Draw	3.3
800-148-FD	Discovery Middle - 004696-Kitchen-East Wall	Sink Tap	First Draw	8.4
800-149-FD	Discovery Middle - 004689-Kitchen-Handwashing-East Wall	Sink Tap	First Draw	2.5
800-150-FD	Discovery Middle - 004679-Kitchen-Dishwasher Room	Sink Tap	First Draw	1.6
800-151-FD	Discovery Middle - 004680-Kitchen-Dishwasher Room	Sink Tap	First Draw	1.3
800-152-FD	Discovery Middle - 004681-Kitchen-Handwashing-Dish Room	Sink Tap	First Draw	0.8
800-153-FD	Discovery Middle - 004682-Kitchen-Three Bay Sink	Sink Tap	First Draw	1.2
800-154-FD	Discovery Middle - 004683-Kitchen-Three Bay Sink	Sink Tap	First Draw	1.6
800-155-FD	Discovery Middle - 004684-Kitchen-Three Bay Sink	Sink Tap	First Draw	3.8
800-156-FD	Discovery Middle - 004690-Kitchen-Next to Pizza Cooker	Sink Tap	First Draw	3.5
800-157-FD	Discovery Middle - 004697-Kitchen-Restroom	Sink Tap	First Draw	1.2
800-158-FD	Discovery Middle - 000136-Kitchen	Pot Filler	First Draw	0.9
800-159-FD	Discovery Middle - 000137-Kitchen	Pot Filler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
800-160-FD	Discovery Middle - 000944-Kitchen	Ice Machine	First Draw	2.6

April 30, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
800-32-FD	Discovery Middle - 004299B-100 Hall	Drinking Fountain	First Draw	<0.4
800-33-FD	Discovery Middle - 004299F-100 Hall	Bottle Filler	First Draw	<0.4
800-127-FD	Discovery Middle - 004205-Gym	Drinking Fountain	First Draw	<0.4

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A
Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



Paula F. Nickelson
Acting Director
t of Health and Senior Services

son City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date:	**10/4/2023**
Expiration Date:	**10/4/2025**
License Number:	**211004-300006201**

Paula F. Nickelson
Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.

- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

PO Box 47166 Kansas City, MO 64188 • 816-678-7894 • www.axiomservicepros.com

Appendix C
Laboratory Analytical Report

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HD0078

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 800 Midjay Drive

Project / PO Number: 800 Midjay Drive
Received: 04/05/2024
Reported: 04/24/2024

Analytical Testing Parameters

Client Sample ID: 800-1-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-01
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/23/24 1056	04/23/24 1520	JAR

Client Sample ID: 800-2-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-02
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1529	JAR

Client Sample ID: 800-3-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-03
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1532	JAR

Client Sample ID: 800-4-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-04
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/23/24 1056	04/23/24 1535	JAR

Client Sample ID: 800-5-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-05
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1543	JAR

Client Sample ID: 800-6-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-06
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/23/24 1056	04/23/24 1546	JAR

Client Sample ID: 800-7-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-07
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1549	JAR

Client Sample ID: 800-8-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-08
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/23/24 1056	04/23/24 1552	JAR

Client Sample ID: 800-9-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-09
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/23/24 1056	04/23/24 1555	JAR

CERTIFICATE OF ANALYSIS

3HD0078

Client Sample ID: 800-10-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-10
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/23/24 1056	04/23/24 1558	JAR

Client Sample ID: 800-11-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-11
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1601	JAR

Client Sample ID: 800-12-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-12
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1604	JAR

Client Sample ID: 800-13-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-13
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1607	JAR

Client Sample ID: 800-14-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-14
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1610	JAR

Client Sample ID: 800-15-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-15
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/23/24 1056	04/23/24 1619	JAR

Client Sample ID: 800-16-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-16
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1622	JAR

Client Sample ID: 800-17-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-17
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1625	JAR

Client Sample ID: 800-18-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-18
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/23/24 1056	04/23/24 1628	JAR

Client Sample ID: 800-19-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-19
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/23/24 1056	04/23/24 1631	JAR

Client Sample ID: 800-20-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-20
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/23/24 1056	04/23/24 1634	JAR

Client Sample ID: 800-21-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-21
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1643	JAR

Client Sample ID: 800-22-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-22
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1658	JAR

Client Sample ID: 800-23-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-23
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1701	JAR

Client Sample ID: 800-24-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-24
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/23/24 1056	04/23/24 1704	JAR

Client Sample ID: 800-25-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-25
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/23/24 1056	04/23/24 1707	JAR

Client Sample ID: 800-26-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-26
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/23/24 1056	04/23/24 1710	JAR

Client Sample ID: 800-27-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-27
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1713	JAR

Client Sample ID: 800-28-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-28
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1716	JAR

Client Sample ID: 800-29-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-29
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1719	JAR

Client Sample ID: 800-30-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-30
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/23/24 1056	04/23/24 1722	JAR

Client Sample ID: 800-31-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-31
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1731	JAR

Client Sample ID: 800-34-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-32
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**5.1**	0.4	ppb	2		04/23/24 1056	04/23/24 1734	JAR

Client Sample ID: 800-35-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-33
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1737	JAR

Client Sample ID: 800-36-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-34
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.2**	0.4	ppb	2		04/23/24 1056	04/23/24 1740	JAR

Client Sample ID: 800-37-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-35
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1743	JAR

Client Sample ID: 800-38-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-36
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.2**	0.4	ppb	2		04/23/24 1056	04/23/24 1746	JAR

Client Sample ID: 800-39-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-37
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1749	JAR

Client Sample ID: 800-40-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-38
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**5.3**	0.4	ppb	2		04/23/24 1056	04/23/24 1752	JAR

Client Sample ID: 800-41-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-39
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1755	JAR

Client Sample ID: 800-42-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-40
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**6.7**	0.4	ppb	2		04/23/24 1056	04/23/24 1758	JAR

Client Sample ID: 800-43-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-41
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1813	JAR

Client Sample ID: 800-44-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-42
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1822	JAR

Client Sample ID: 800-45-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-43
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1825	JAR

Client Sample ID: 800-46-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-44
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.6**	0.4	ppb	2		04/23/24 1056	04/23/24 1828	JAR

Client Sample ID: 800-47-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-45
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/23/24 1056	04/23/24 1830	JAR

Client Sample ID: 800-48-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-46
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/23/24 1056	04/23/24 1833	JAR

Client Sample ID: 800-49-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-47
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1842	JAR

Client Sample ID: 800-50-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-48
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/23/24 1056	04/23/24 1845	JAR

Client Sample ID: 800-51-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-49
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1848	JAR

CERTIFICATE OF ANALYSIS

3HD0078

Client Sample ID: 800-52-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-50
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 1851	JAR

Client Sample ID: 800-53-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-51
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1854	JAR

Client Sample ID: 800-54-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-52
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1857	JAR

Client Sample ID: 800-55-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-53
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.2**	0.4	ppb	2		04/23/24 1056	04/23/24 1900	JAR

Client Sample ID: 800-56-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-54
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1903	JAR

CERTIFICATE OF ANALYSIS

3HD0078

Client Sample ID: 800-57-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-55
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/23/24 1056	04/23/24 1906	JAR

Client Sample ID: 800-58-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-56
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**14.9**	0.4	ppb	2		04/23/24 1056	04/23/24 1909	JAR

Client Sample ID: 800-59-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-57
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 1918	JAR

Client Sample ID: 800-60-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-58
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**32.2**	0.4	ppb	2		04/23/24 1056	04/23/24 1921	JAR

Client Sample ID: 800-61-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-59
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**37.2**	0.4	ppb	2		04/23/24 1056	04/23/24 1924	JAR

Client Sample ID: 800-62-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-60
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**35.1**	0.4	ppb	2		04/23/24 1056	04/23/24 1927	JAR

Client Sample ID: 800-63-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-61
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**49.7**	0.4	ppb	2		04/23/24 1056	04/23/24 1936	JAR

Client Sample ID: 800-64-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-62
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**31.3**	0.4	ppb	2		04/23/24 1056	04/23/24 1945	JAR

Client Sample ID: 800-65-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-63
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**31.2**	0.4	ppb	2		04/23/24 1056	04/23/24 1954	JAR

Client Sample ID: 800-66-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-64
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**36.2**	0.4	ppb	2		04/23/24 1056	04/23/24 1957	JAR

Client Sample ID: 800-67-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-65
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.4**	0.4	ppb	2		04/23/24 1056	04/23/24 2000	JAR

Client Sample ID: 800-68-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-66
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**32.2**	0.4	ppb	2		04/23/24 1056	04/23/24 2003	JAR

Client Sample ID: 800-69-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-67
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**24.2**	0.4	ppb	2		04/23/24 1056	04/23/24 2006	JAR

Client Sample ID: 800-70-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-68
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**36.2**	0.4	ppb	2		04/23/24 1056	04/23/24 2009	JAR

Client Sample ID: 800-71-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-69
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**44.6**	0.4	ppb	2		04/23/24 1056	04/23/24 2012	JAR

Client Sample ID: 800-72-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-70
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**45.6**	0.4	ppb	2		04/23/24 1056	04/23/24 2015	JAR

Client Sample ID: 800-73-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-71
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 2018	JAR

Client Sample ID: 800-74-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-72
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**8.5**	0.4	ppb	2		04/23/24 1056	04/23/24 2021	JAR

Client Sample ID: 800-75-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-73
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 2030	JAR

Client Sample ID: 800-76-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-74
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.9**	0.4	ppb	2		04/23/24 1056	04/23/24 2033	JAR

Client Sample ID: 800-77-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-75
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2036	JAR

Client Sample ID: 800-78-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-76
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**7.1**	0.4	ppb	2		04/23/24 1056	04/23/24 2039	JAR

Client Sample ID: 800-79-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-77
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2042	JAR

Client Sample ID: 800-80-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-78
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.1**	0.4	ppb	2		04/23/24 1056	04/23/24 2045	JAR

Client Sample ID: 800-81-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-79
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2048	JAR

Client Sample ID: 800-82-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-80
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2051	JAR

Client Sample ID: 800-83-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-81
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2106	JAR

Client Sample ID: 800-84-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-82
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2115	JAR

Client Sample ID: 800-85-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-83
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 22:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2118	JAR

Client Sample ID: 800-86-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-84
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/23/24 1056	04/23/24 2121	JAR

Client Sample ID: 800-87-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-85
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2124	JAR

Client Sample ID: 800-88-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-86
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/23/24 1056	04/23/24 2127	JAR

Client Sample ID: 800-89-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-87
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2130	JAR

Client Sample ID: 800-90-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-88
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/23/24 1056	04/23/24 2133	JAR

Client Sample ID: 800-91-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-89
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2142	JAR

Client Sample ID: 800-92-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-90
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.2**	0.4	ppb	2		04/23/24 1056	04/23/24 2145	JAR

Client Sample ID: 800-93-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-91
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.3**	0.4	ppb	2		04/23/24 1056	04/23/24 2148	JAR

Client Sample ID: 800-94-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-92
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/23/24 1056	04/23/24 2151	JAR

Client Sample ID: 800-95-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-93
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/23/24 1056	04/23/24 2154	JAR

Client Sample ID: 800-96-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-94
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/23/24 1056	04/23/24 2157	JAR

Client Sample ID: 800-97-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-95
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/23/24 1056	04/23/24 2200	JAR

Client Sample ID: 800-98-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-96
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2203	JAR

Client Sample ID: 800-99-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-97
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2206	JAR

Client Sample ID: 800-100-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-98
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2209	JAR

Client Sample ID: 800-101-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-99
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2218	JAR

CERTIFICATE OF ANALYSIS

3HD0078

Client Sample ID:	800-102-FD		
Sample Matrix:	Drinking Water	**Collected By:**	McWhorter, Becca
Lab Sample ID:	3HD0078-AA	**Collection Date:**	04/02/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/23/24 1056	04/23/24 2221	JAR

Client Sample ID:	800-103-FD		
Sample Matrix:	Drinking Water	**Collected By:**	McWhorter, Becca
Lab Sample ID:	3HD0078-AB	**Collection Date:**	04/02/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2230	JAR

Client Sample ID:	800-104-FD		
Sample Matrix:	Drinking Water	**Collected By:**	McWhorter, Becca
Lab Sample ID:	3HD0078-AC	**Collection Date:**	04/02/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/23/24 1056	04/23/24 2239	JAR

Client Sample ID:	800-105-FD		
Sample Matrix:	Drinking Water	**Collected By:**	McWhorter, Becca
Lab Sample ID:	3HD0078-AD	**Collection Date:**	04/02/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2242	JAR

Client Sample ID:	800-106-FD		
Sample Matrix:	Drinking Water	**Collected By:**	McWhorter, Becca
Lab Sample ID:	3HD0078-AE	**Collection Date:**	04/02/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2245	JAR

CERTIFICATE OF ANALYSIS

3HD0078

Client Sample ID: 800-107-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AF
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2254	JAR

Client Sample ID: 800-108-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AG
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 2257	JAR

Client Sample ID: 800-109-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AH
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/23/24 1056	04/23/24 2300	JAR

Client Sample ID: 800-110-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AI
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/23/24 1056	04/23/24 2303	JAR

Client Sample ID: 800-111-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AJ
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2306	JAR

Client Sample ID: 800-112-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AK
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/23/24 1056	04/23/24 2309	JAR

Client Sample ID: 800-113-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AL
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/23/24 1056	04/23/24 2312	JAR

Client Sample ID: 800-114-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AM
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 2315	JAR

Client Sample ID: 800-115-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AN
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2318	JAR

Client Sample ID: 800-116-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AO
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/23/24 2321	JAR

Client Sample ID: 800-117-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AP
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/23/24 1056	04/23/24 2330	JAR

Client Sample ID: 800-118-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AQ
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2333	JAR

Client Sample ID: 800-119-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AR
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2336	JAR

Client Sample ID: 800-120-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AS
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2339	JAR

Client Sample ID: 800-121-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AT
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2342	JAR

CERTIFICATE OF ANALYSIS

3HD0078

Client Sample ID: 800-122-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AU
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2345	JAR

Client Sample ID: 800-123-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AV
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/23/24 2354	JAR

Client Sample ID: 800-124-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AW
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/24/24 0009	JAR

Client Sample ID: 800-125-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AX
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/23/24 1056	04/24/24 0012	JAR

Client Sample ID: 800-126-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AY
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/24/24 0015	JAR

Client Sample ID: 800-128-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-AZ
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.1**	0.4	ppb	2		04/23/24 1056	04/24/24 0018	JAR

Client Sample ID: 800-129-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BA
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/23/24 1056	04/24/24 0021	JAR

Client Sample ID: 800-130-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BB
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/23/24 1056	04/24/24 0024	JAR

Client Sample ID: 800-131-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BC
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/24/24 0027	JAR

Client Sample ID: 800-132-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BD
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/24/24 0030	JAR

Client Sample ID: 800-133-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BE
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.5**	0.4	ppb	2		04/23/24 1056	04/24/24 0033	JAR

Client Sample ID: 800-134-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BF
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.6**	0.4	ppb	2		04/23/24 1056	04/24/24 0042	JAR

Client Sample ID: 800-135-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BG
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/23/24 1056	04/24/24 0045	JAR

Client Sample ID: 800-136-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BH
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/24/24 0048	JAR

Client Sample ID: 800-137-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BI
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/23/24 1056	04/24/24 0051	JAR

CERTIFICATE OF ANALYSIS

3HD0078

Client Sample ID: 800-138-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BJ
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/24/24 0054	JAR

Client Sample ID: 800-139-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BK
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/23/24 1056	04/24/24 0057	JAR

Client Sample ID: 800-140-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BL
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/23/24 1056	04/24/24 0100	JAR

Client Sample ID: 800-141-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BM
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.0**	0.4	ppb	2		04/23/24 1056	04/24/24 0103	JAR

Client Sample ID: 800-142-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BN
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/23/24 1056	04/24/24 0106	JAR

CERTIFICATE OF ANALYSIS

3HD0078

Client Sample ID: 800-143-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BO
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/24/24 0109	JAR

Client Sample ID: 800-144-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BP
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/23/24 1056	04/24/24 0118	JAR

Client Sample ID: 800-145-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BQ
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/23/24 1056	04/24/24 0127	JAR

Client Sample ID: 800-146-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BR
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**8.1**	0.4	ppb	2		04/23/24 1056	04/24/24 0135	JAR

Client Sample ID: 800-147-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BS
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.3**	0.4	ppb	2		04/23/24 1056	04/24/24 0138	JAR

Client Sample ID: 800-148-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BT
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**8.4**	0.4	ppb	2		04/23/24 1056	04/24/24 0141	JAR

Client Sample ID: 800-149-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BU
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.5**	0.4	ppb	2		04/23/24 1056	04/24/24 0144	JAR

Client Sample ID: 800-150-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BV
Collected By: McWhorter, Becca
Collection Date: 04/02/2024 23:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/23/24 1056	04/24/24 0153	JAR

Client Sample ID: 800-151-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BW
Collected By: McWhorter, Becca
Collection Date: 04/02/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/23/24 1056	04/24/24 0156	JAR

Client Sample ID: 800-152-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BX
Collected By: McWhorter, Becca
Collection Date: 04/02/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/23/24 1056	04/24/24 0159	JAR

Client Sample ID: 800-153-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BY
Collected By: McWhorter, Becca
Collection Date: 04/02/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/23/24 1056	04/24/24 0202	JAR

Client Sample ID: 800-154-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-BZ
Collected By: McWhorter, Becca
Collection Date: 04/02/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/23/24 1056	04/24/24 0205	JAR

Client Sample ID: 800-155-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-CA
Collected By: McWhorter, Becca
Collection Date: 04/02/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.8**	0.4	ppb	2		04/23/24 1056	04/24/24 0208	JAR

Client Sample ID: 800-156-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-CB
Collected By: McWhorter, Becca
Collection Date: 04/02/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.5**	0.4	ppb	2		04/23/24 1056	04/24/24 0211	JAR

Client Sample ID: 800-157-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0078-CC
Collected By: McWhorter, Becca
Collection Date: 04/02/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/23/24 1056	04/24/24 0214	JAR

CERTIFICATE OF ANALYSIS

3HD0078

Client Sample ID:	800-158-FD		
Sample Matrix:	Drinking Water	**Collected By:**	McWhorter, Becca
Lab Sample ID:	3HD0078-CD	**Collection Date:**	04/02/2024 23:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/23/24 1056	04/24/24 0217	JAR

Client Sample ID:	800-159-FD		
Sample Matrix:	Drinking Water	**Collected By:**	McWhorter, Becca
Lab Sample ID:	3HD0078-CE	**Collection Date:**	04/02/2024 23:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/23/24 1056	04/24/24 0220	JAR

Client Sample ID:	800-160-FD		
Sample Matrix:	Drinking Water	**Collected By:**	McWhorter, Becca
Lab Sample ID:	3HD0078-CF	**Collection Date:**	04/02/2024 23:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.6**	0.4	ppb	2		04/23/24 1056	04/24/24 0229	JAR

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
04/24/24 13:02

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

3HD0078 AXIOM Service Professionals
04/19/24 17:00 Carolyn Jackson DW
Lead Analysis $26
800 Midjay Drive A = N S

Cooler ID: BOX
Custody Seal: —
IR Gun # 8
Delivered By: UPS / Fed Ex / Spee Dee / Mail
(Walk-in) / Via / Courier / Other:_____
Packing material: Bubble/ Foam/ Paper/Other

DW Coding Verified:_____

DW Data to SDWIS: ☐

Sample Receipt Discrepancies: O No O Yes (if Yes, see detail below)

O Container Problems:	O COC Problems
O Label Absent	O Chain of Custody not present
O Incorrect Containers for tests indicated	O Chain of Custody not present: Info obtained from PO or Letter
O Insufficient amount of sample for tests indicated	O COC missing time sampled, time obtained from sample container.
O Broken or leaking containers: _____	O COC missing date sampled, date obtained from sample container
O Air bubbles in VOA vials:_____	O Sample excluded from COC:_____
O Analyses outside of hold: _____	O Sample listed on COC not received: _____
	O Sample description on container different from COC: _____

Detailed Description/comments: 15.5° & 17.3° & 16.6° 3 boxes

Client contacted regarding cooler/sample receipt conditions: Yes / No Contacted by_____Date/Time:_____

Who was contacted:_____Remarks: See Comments on Element WO page

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-1-FD	4/2/2024	22:15	Discovery Middle - Sink Tap - 004133-Nurse Office-Across from bathroom	1	Wt	Grab	X								01
800-2-FD	4/2/2024	22:15	Discovery Middle - Sink Tap - 004134-Nurse Office-Across from Desk	1	Wt	Grab	X								02
800-3-FD	4/2/2024	22:15	Discovery Middle - Sink Tap - 004131-Nurse Office-Bathroom	1	Wt	Grab	X								03
800-4-FD	4/2/2024	22:15	Discovery Middle - Sink Tap - 004132-Nurse Office-Bathroom	1	Wt	Grab	X								04
800-5-FD	4/2/2024	22:16	Discovery Middle - Sink Tap - 004250-Lounge-Bathroom	1	Wt	Grab	X								05
800-6-FD	4/2/2024	22:16	Discovery Middle - Sink Tap - 004251-Lounge	1	Wt	Grab	X								06
800-7-FD	4/2/2024	22:17	Discovery Middle - Sink Tap - 004252-Lounge-Bathroom	1	Wt	Grab	X								07

LAB USE ONLY
Wk Order #: 3HD0078
Short Hold:
Rush:
Temp: oC 15.5/17.3/16.6

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				10:00		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-8-FD	4/2/2024	22:18	Discovery Middle - Sink Tap - 004791-Room 124	1	Wt	Grab	X								08
800-9-FD	4/2/2024	22:18	Discovery Middle - Bubbler - 004792-Room 124	1	Wt	Grab	X								09
800-10-FD	4/2/2024	22:18	Discovery Middle - Sink Tap - 004793-Room 123	1	Wt	Grab	X								10
800-11-FD	4/2/2024	22:18	Discovery Middle - Bubbler - 004794-Room 123	1	Wt	Grab	X								11
800-12-FD	4/2/2024	22:19	Discovery Middle - Sink Tap - 004128-Room 100	1	Wt	Grab	X								12
800-13-FD	4/2/2024	22:19	Discovery Middle - Bubbler - 004129-Room 100	1	Wt	Grab	X								13
800-14-FD	4/2/2024	22:19	Discovery Middle - Sink Tap - 004126-Room 101	1	Wt	Grab	X								14

LAB USE ONLY
Wk Order #: 3HD0078
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 7 8
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-15-FD	4/2/2024	22:20	Discovery Middle - Bubbler - 004127-Room 101	1	Wt	Grab	X								15
800-16-FD	4/2/2024	22:20	Discovery Middle - Sink Tap - 004114-Room 104	1	Wt	Grab	X								16
800-17-FD	4/2/2024	22:20	Discovery Middle - Bubbler - 004113-Room 104	1	Wt	Grab	X								17
800-18-FD	4/2/2024	22:21	Discovery Middle - Sink Tap - 004108-Room 105	1	Wt	Grab	X								18
800-19-FD	4/2/2024	22:20	Discovery Middle - Bubbler - 004107-Room 105	1	Wt	Grab	X								19
800-20-FD	4/2/2024	22:21	Discovery Middle - Sink Tap - 004112-Room 106	1	Wt	Grab	X								20
800-21-FD	4/2/2024	22:21	Discovery Middle - Bubbler - 004111-Room 106	1	Wt	Grab	X								21

LAB USE ONLY
Wk Order #: 3HD0078
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 7 8
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-22-FD	4/2/2024	22:22	Discovery Middle - Sink Tap - 004110-Room 107	1	Wt	Grab	X								22
800-23-FD	4/2/2024	22:22	Discovery Middle - Bubbler - 004109-Room 107	1	Wt	Grab	X								23
800-24-FD	4/2/2024	22:22	Discovery Middle - Sink Tap - 004106-Room 108	1	Wt	Grab	X								24
800-25-FD	4/2/2024	22:23	Discovery Middle - Sink Tap - 004102-100 Hall-Girls-Right	1	Wt	Grab	X								25
800-26-FD	4/2/2024	22:23	Discovery Middle - Sink Tap - 004101-100 Hall-Girls-Middle	1	Wt	Grab	X								26
800-27-FD	4/2/2024	22:23	Discovery Middle - Sink Tap - 004300-100 Hall-Girls-Left	1	Wt	Grab	X								27
800-28-FD	4/2/2024	22:24	Discovery Middle - Sink Tap - 004103-100 Hall-Boys-Right	1	Wt	Grab	X								28

LAB USE ONLY: Wk Order #: 3HD0078; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 7 8
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-29-FD	4/2/2024	22:29	Discovery Middle - Sink Tap - 004104-100 Hall-Boys-Middle	1	Wt	Grab	X								29
800-30-FD	4/2/2024	22:24	Discovery Middle - Sink Tap - 003204-100 Hall-Boys-Left	1	Wt	Grab	X								30
800-31-FD	4/2/2024	22:25	Discovery Middle - Drinking Fountain - 004298-100 Hall	1	Wt	Grab	X								31
800-34-FD	4/2/2024	22:26	Discovery Middle - Sink Tap - 004295-Room 109	1	Wt	Grab	X								32
800-35-FD	4/2/2024	22:26	Discovery Middle - Bubbler - 004294-Room 109	1	Wt	Grab	X								33
800-36-FD	4/2/2024	22:26	Discovery Middle - Sink Tap - 004293-Room 110	1	Wt	Grab	X								34
800-37-FD	4/2/2024	22:27	Discovery Middle - Bubbler - 004292-Room 110	1	Wt	Grab	X								35

LAB USE ONLY
Wk Order #: 3HD0078
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:		Jesse Thompson	4/5/24 Time: 1000		

3 H D 0 0 7 8

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-38-FD	4/2/2024	22:28	Discovery Middle - Sink Tap - 004290-Room 111	1	Wt	Grab	X								36
800-39-FD	4/2/2024	22:28	Discovery Middle - Bubbler - 004291-Room 111	1	Wt	Grab	X								37
800-40-FD	4/2/2024	22:29	Discovery Middle - Sink Tap - 004297-Room 112	1	Wt	Grab	X								38
800-41-FD	4/2/2024	22:29	Discovery Middle - Bubbler - 004296-Room 112	1	Wt	Grab	X								39
800-42-FD	4/2/2024	22:30	Discovery Middle - Sink Tap - 004288-Room 113	1	Wt	Grab	X								40
800-43-FD	4/2/2024	22:30	Discovery Middle - Bubbler - 004289-Room 113	1	Wt	Grab	X								41
800-44-FD	4/2/2024	22:32	Discovery Middle - Sink Tap - 004275-Room 116	1	Wt	Grab	X								42

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sara Thompson	Time:		
				1000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-45-FD	4/2/2024	22:32	Discovery Middle - Bubbler - 004276-Room 116	1	Wt	Grab	X								43
800-46-FD	4/2/2024	22:33	Discovery Middle - Sink Tap - 004274-Room 118	1	Wt	Grab	X								44
800-47-FD	4/2/2024	22:33	Discovery Middle - Bubbler - 004273-Room 118	1	Wt	Grab	X								45
800-48-FD	4/2/2024	22:44	Discovery Middle - Sink Tap - 004797-Room 119	1	Wt	Grab	X								46
800-49-FD	4/2/2024	22:44	Discovery Middle - Bubbler - 004798-Room 119	1	Wt	Grab	X								47
800-50-FD	4/2/2024	22:46	Discovery Middle - Sink Tap - 004795-Room 120	1	Wt	Grab	X								48
800-51-FD	4/2/2024	22:46	Discovery Middle - Bubbler - 004796-Room 120	1	Wt	Grab	X								49

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time: 1000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-52-FD	4/2/2024	22:48	Discovery Middle - Sink Tap - 004267-Room 203-Far Left	1	Wt	Grab	X								S0
800-53-FD	4/2/2024	22:48	Discovery Middle - Sink Tap - 004268-Room 203	1	Wt	Grab	X								S1
800-54-FD	4/2/2024	22:48	Discovery Middle - Sink Tap - 004269-Room 203	1	Wt	Grab	X								S2
800-55-FD	4/2/2024	22:48	Discovery Middle - Sink Tap - 004270-Room 203	1	Wt	Grab	X								S3
800-56-FD	4/2/2024	22:49	Discovery Middle - Sink Tap - 004271-Room 203	1	Wt	Grab	X								S4
800-57-FD	4/2/2024	22:49	Discovery Middle - Sink Tap - 004272-Room 203	1	Wt	Grab	X								S5
800-58-FD	4/2/2024	22:49	Discovery Middle - Sink Tap - 004259-Room 204	1	Wt	Grab	X								S6

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-59-FD	4/2/2024	22:49	Discovery Middle - Bubbler - 004260-Room 204	1	Wt	Grab	X								57
800-60-FD	4/2/2024	22:50	Discovery Middle - Sink Tap - 004265-Room 205-Right	1	Wt	Grab	X								58
800-61-FD	4/2/2024	22:50	Discovery Middle - Sink Tap - 004266-Room 205-Left	1	Wt	Grab	X								59
800-62-FD	4/2/2024	22:50	Discovery Middle - Sink Tap - 003202-Room 207-Far Left	1	Wt	Grab	X								60
800-63-FD	4/2/2024	22:51	Discovery Middle - Sink Tap - 004261-Room 207	1	Wt	Grab	X								61
800-64-FD	4/2/2024	22:51	Discovery Middle - Sink Tap - 004262-Room 207	1	Wt	Grab	X								62
800-65-FD	4/2/2024	22:51	Discovery Middle - Sink Tap - 004263-Room 207	1	Wt	Grab	X								63

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	
	Time:					

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-66-FD	4/2/2024	22:51	Discovery Middle - Sink Tap - 004264-Room 207	1	Wt	Grab	X								64
800-67-FD	4/2/2024	22:52	Discovery Middle - Sink Tap - 004253-Room 206-Kitchen 1	1	Wt	Grab	X								65
800-68-FD	4/2/2024	22:52	Discovery Middle - Sink Tap - 004254-Room 206-Kitchen 2	1	Wt	Grab	X								66
800-69-FD	4/2/2024	22:52	Discovery Middle - Sink Tap - 004255-Room 206-Kitchen 3	1	Wt	Grab	X								67
800-70-FD	4/2/2024	22:52	Discovery Middle - Sink Tap - 004256-Room 206-Kitchen 4	1	Wt	Grab	X								68
800-71-FD	4/2/2024	22:53	Discovery Middle - Sink Tap - 004257-Room 206-Kitchen 5	1	Wt	Grab	X								69
800-72-FD	4/2/2024	22:53	Discovery Middle - Sink Tap - 004258-Room 206-Kitchen 6	1	Wt	Grab	X								70

LAB USE ONLY: Wk Order #: 3HD0078; Short Hold: ; Rush: ; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-73-FD	4/2/2024	22:55	Discovery Middle - Sink Tap - 004781-Room 319	1	Wt	Grab	X								71
800-74-FD	4/2/2024	22:55	Discovery Middle - Sink Tap - 004799-Room 318	1	Wt	Grab	X								72
800-75-FD	4/2/2024	22:55	Discovery Middle - Bubbler - 004800-Room 318	1	Wt	Grab	X								73
800-76-FD	4/2/2024	22:56	Discovery Middle - Sink Tap - 004247-Room 315	1	Wt	Grab	X								74
800-77-FD	4/2/2024	22:56	Discovery Middle - Bubbler - 004246-Room 315	1	Wt	Grab	X								75
800-78-FD	4/2/2024	22:57	Discovery Middle - Sink Tap - 004242-Room 316	1	Wt	Grab	X								76
800-79-FD	4/2/2024	22:57	Discovery Middle - Bubbler - 004243-Room 316	1	Wt	Grab	X								77

LAB USE ONLY: Wk Order #: 3HD0078; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				800		

3 H D 0 0 7 8
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-80-FD	4/2/2024	22:57	Discovery Middle - Sink Tap - 004245-Room 314	1	Wt	Grab	X								78
800-81-FD	4/2/2024	22:57	Discovery Middle - Bubbler - 004244-Room 314	1	Wt	Grab	X								79
800-82-FD	4/2/2024	22:58	Discovery Middle - Sink Tap - 004230-Room 311	1	Wt	Grab	X								80
800-83-FD	4/2/2024	22:58	Discovery Middle - Bubbler - 004229-Room 311	1	Wt	Grab	X								81
800-84-FD	4/2/2024	22:59	Discovery Middle - Sink Tap - 004231-Room 310	1	Wt	Grab	X								82
800-85-FD	4/2/2024	22:59	Discovery Middle - Bubbler - 004232-Room 310	1	Wt	Grab	X								83
800-86-FD	4/2/2024	23:00	Discovery Middle - Sink Tap - 004227-Room 309	1	Wt	Grab	X								84

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				0000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	3HD00078
														Short Hold:	
														Rush:	
														Temp: oC	
800-87-FD	4/2/2024	23:00	Discovery Middle - Bubbler - 004228-Room 309	1	Wt	Grab	X								85
800-88-FD	4/2/2024	23:00	Discovery Middle - Sink Tap - 004226-Room 308	1	Wt	Grab	X								86
800-89-FD	4/2/2024	23:00	Discovery Middle - Bubbler - 004225-Room 308	1	Wt	Grab	X								87
800-90-FD	4/2/2024	23:01	Discovery Middle - Sink Tap - 004224-Room 307	1	Wt	Grab	X								88
800-91-FD	4/2/2024	23:01	Discovery Middle - Bubbler - 004223-Room 307	1	Wt	Grab	X								89
800-92-FD	4/2/2024	23:02	Discovery Middle - Sink Tap - 004782-300 Hall-Girls-Left	1	Wt	Grab	X								90
800-93-FD	4/2/2024	23:02	Discovery Middle - Sink Tap - 004783-300 Hall-Girls-Middle	1	Wt	Grab	X								91

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3HD00078

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-94-FD	4/2/2024	23:02	Discovery Middle - Sink Tap - 004784-300 Hall-Girls-Right	1	Wt	Grab	X								92
800-95-FD	4/2/2024	23:03	Discovery Middle - Sink Tap - 004785-300 Hall-Boys-Left	1	Wt	Grab	X								93
800-96-FD	4/2/2024	23:03	Discovery Middle - Sink Tap - 004786-300 Hall-Boys-Middle	1	Wt	Grab	X								94
800-97-FD	4/2/2024	23:03	Discovery Middle - Sink Tap - 004787-300 Hall-Boys-Right	1	Wt	Grab	X								95
800-98-FD	4/2/2024	23:04	Discovery Middle - Drinking Fountain - 004130-300 Hall-By Girls RR	1	Wt	Grab	X								96
800-99-FD	4/2/2024	23:04	Discovery Middle - Drinking Fountain - 004221B-300 Hall	1	Wt	Grab	X								97
800-100-FD	4/2/2024	23:05	Discovery Middle - Bottle Filler - 004221F-300 Hall	1	Wt	Grab	X								98

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-101-FD	4/2/2024	23:05	Discovery Middle - Drinking Fountain - 004222-Across from 301	1	Wt	Grab	X								99
800-102-FD	4/2/2024	23:06	Discovery Middle - Sink Tap - 004219-Room 306	1	Wt	Grab	X								AA
800-103-FD	4/2/2024	23:06	Discovery Middle - Bubbler - 004220-Room 306	1	Wt	Grab	X								AB
800-104-FD	4/2/2024	23:07	Discovery Middle - Sink Tap - 004218-Room 303	1	Wt	Grab	X								AC
800-105-FD	4/2/2024	23:06	Discovery Middle - Bubbler - 004217-Room 303	1	Wt	Grab	X								AD
800-106-FD	4/2/2024	23:06	Discovery Middle - Sink Tap - 004216-Room 303	1	Wt	Grab	X								AE
800-107-FD	4/2/2024	23:08	Discovery Middle - Drinking Fountain - 004215-Band Storage Next to 301	1	Wt	Grab	X								AF

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-108-FD	4/2/2024	23:08	Discovery Middle - Sink Tap - 004214-Room 300	1	Wt	Grab	X								AG
800-109-FD	4/2/2024	23:10	Discovery Middle - Sink Tap - 004790-Library-Maker Space	1	Wt	Grab	X								AH
800-110-FD	4/2/2024	23:10	Discovery Middle - Sink Tap - 004789-Library Bathroom	1	Wt	Grab	X								AI
800-111-FD	4/2/2024	23:10	Discovery Middle - Drinking Fountain - 004788-Library	1	Wt	Grab	X								AJ
800-112-FD	4/2/2024	23:13	Discovery Middle - Sink Tap - 004776-Commons-Girls	1	Wt	Grab	X								AK
800-113-FD	4/2/2024	23:13	Discovery Middle - Sink Tap - 004777-Commons-Girls	1	Wt	Grab	X								AL
800-114-FD	4/2/2024	23:13	Discovery Middle - Sink Tap - 004778-Commons-Girls	1	Wt	Grab	X								AM

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-115-FD	4/2/2024	23:14	Discovery Middle - Sink Tap - 004201-Commons-Boys	1	Wt	Grab	X								AN
800-116-FD	4/2/2024	23:14	Discovery Middle - Sink Tap - 003206-Commons-Boys	1	Wt	Grab	X								AO
800-117-FD	4/2/2024	23:14	Discovery Middle - Sink Tap - 004779-Commons-Boys	1	Wt	Grab	X								AP
800-118-FD	4/2/2024	23:16	Discovery Middle - Drinking Fountain - 004773-Commons-Right	1	Wt	Grab	X								AQ
800-119-FD	4/2/2024	23:16	Discovery Middle - Drinking Fountain - 004774-Commons-Middle	1	Wt	Grab	X								AR
800-120-FD	4/2/2024	23:16	Discovery Middle - Drinking Fountain - 004775B-Commons	1	Wt	Grab	X								AS
800-121-FD	4/2/2024	23:17	Discovery Middle - Bottle Filler - 004775F-Commons	1	Wt	Grab	X								AT

LAB USE ONLY: Wk Order #: 3HD00078; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date: 4/5/24	
	Time:		Sue Thompson	Time: 1000	

3 H D 0 0 7 8
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HD00078
														Short Hold:	
														Rush:	
														Temp: oC	
800-122-FD	4/2/2024	23:17	Discovery Middle - Drinking Fountain - 003205-Commons-Left	1	Wt	Grab	X								AU
800-123-FD	4/2/2024	23:19	Discovery Middle - Bottle Filler - 004204-Gym	1	Wt	Grab	X								AV
800-124-FD	4/2/2024	23:19	Discovery Middle - Drinking Fountain - 004206-Gym	1	Wt	Grab	X								AW
800-125-FD	4/2/2024	23:19	Discovery Middle - Sink Tap - 004202-Gym-Bathroom	1	Wt	Grab	X								AX
800-126-FD	4/2/2024	23:19	Discovery Middle - Sink Tap - 004203-Gym-Bathroom-Right	1	Wt	Grab	X								AY
800-128-FD	4/2/2024	23:22	Discovery Middle - Sink Tap - 004211-Girls Locker Room	1	Wt	Grab	X								AZ
800-129-FD	4/2/2024	23:22	Discovery Middle - Sink Tap - 004212-Girls Locker Room	1	Wt	Grab	X								BA

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	
	Time:					

3HD00078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-130-FD	4/2/2024	23:22	Discovery Middle - Sink Tap - 004213-Girls Locker Room	1	Wt	Grab	X								BB
800-131-FD	4/2/2024	23:23	Discovery Middle - Sink Tap - 003210-Girls Locker Room-Office	1	Wt	Grab	X								BC
800-132-FD	4/2/2024	23:23	Discovery Middle - Drinking Fountain - 003209-Girls Locker Room	1	Wt	Grab	X								BD
800-133-FD	4/2/2024	23:25	Discovery Middle - Sink Tap - 004207-Boys Locker Room	1	Wt	Grab	X								BE
800-134-FD	4/2/2024	23:25	Discovery Middle - Sink Tap - 004208-Boys Locker Room	1	Wt	Grab	X								BF
800-135-FD	4/2/2024	23:25	Discovery Middle - Sink Tap - 004210-Boys Locker Room-Coach Office	1	Wt	Grab	X								BG
800-136-FD	4/2/2024	23:26	Discovery Middle - Drinking Fountain - 004209-Boys Locker Room	1	Wt	Grab	X								BH

LAB USE ONLY
Wk Order #: 3HD0078
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date: 4/5/24	
	Time:		Sue Thompson	Time: 1080	

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
800-137-FD	4/2/2024	23:27	Discovery Middle - Sink Tap - 003208-Weight Room-Bathroom	1	Wt	Grab	X								BI
800-138-FD	4/2/2024	23:27	Discovery Middle - Drinking Fountain - 003207-Weight Room	1	Wt	Grab	X								BJ
800-139-FD	4/2/2024	23:30	Discovery Middle - Sink Tap - 004685-Kitchen Outside Office	1	Wt	Grab	X								BK
800-140-FD	4/2/2024	23:30	Discovery Middle - Sink Tap - 004686-Kitchen Outside Office	1	Wt	Grab	X								BL
800-141-FD	4/2/2024	23:30	Discovery Middle - Sink Tap - 004687-Kitchen-Handwashing-Next to Air Hood	1	Wt	Grab	X								BM
800-142-FD	4/2/2024	23:31	Discovery Middle - Sink Tap - 004688-Kitchen-Handwashing-Dry Storage	1	Wt	Grab	X								BN
800-143-FD	4/2/2024	23:31	Discovery Middle - Sink Tap - 004691-Kitchen-Across from Lounge	1	Wt	Grab	X								BO

LAB USE ONLY: Wk Order #: 3HD0078; Short Hold: ; Rush: ; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 7 8
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-144-FD	4/2/2024	23:32	Discovery Middle - Sink Tap - 004692-Kitchen-Across from Freezer	1	Wt	Grab	X								BP
800-145-FD	4/2/2024	23:32	Discovery Middle - Sink Tap - 004693-Kitchen-East Wall	1	Wt	Grab	X								BQ
800-146-FD	4/2/2024	23:32	Discovery Middle - Sink Tap - 004694-Kitchen-East Wall	1	Wt	Grab	X								BR
800-147-FD	4/2/2024	23:33	Discovery Middle - Sink Tap - 004695-Kitchen-East Wall	1	Wt	Grab	X								BS
800-148-FD	4/2/2024	23:33	Discovery Middle - Sink Tap - 004696-Kitchen-East Wall	1	Wt	Grab	X								BT
800-149-FD	4/2/2024	23:33	Discovery Middle - Sink Tap - 004689-Kitchen-Handwashing-East Wall	1	Wt	Grab	X								BU
800-150-FD	4/2/2024	23:34	Discovery Middle - Sink Tap - 004679-Kitchen-Dishwasher Room	1	Wt	Grab	X								BV

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

CHAIN OF CUSTODY RECORD

Keystone LABORATORIES
A Microbac Company

____ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	____ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	____ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-151-FD	4/2/2024	23:34	Discovery Middle - Sink Tap - 004680-Kitchen-Dishwasher Room	1	Wt	Grab	X								BB,BC
800-152-FD	4/2/2024	23:34	Discovery Middle - Sink Tap - 004681-Kitchen-Handwashing-Dish Room	1	Wt	Grab	X								BX
800-153-FD	4/2/2024	23:35	Discovery Middle - Sink Tap - 004682-Kitchen-3 Bay Sink	1	Wt	Grab	X								BY
800-154-FD	4/2/2024	23:35	Discovery Middle - Sink Tap - 004683-Kitchen-3 Bay Sink	1	Wt	Grab	X								BZ
800-155-FD	4/2/2024	23:35	Discovery Middle - Sink Tap - 004684-Kitchen-3 Bay	1	Wt	Grab	X								CA
800-156-FD	4/2/2024	23:36	Discovery Middle - Sink Tap - 004690-Kitchen-Next to Pizza Cooker	1	Wt	Grab	X								CB
800-157-FD	4/2/2024	23:36	Discovery Middle - Sink Tap - 004697-Kitchen-Bathroom	1	Wt	Grab	X								CC

Relinquied by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
Bradly Young	4/4/2024			
	Time:		Time:	
Relinquied by: (Signature)	Date:	Received by: (Signature)	Date: 4/5/24	
	Time:	Sue Thompson	Time: 1000	

3 H D 0 0 7 8
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0078	
														Short Hold:	
														Rush:	
														Temp: oC	
800-158-FD	4/2/2024	23:36	Discovery Middle - Pot Filler - 000136-Kitchen	1	Wt	Grab	X							CD	~~BW~~
800-159-FD	4/2/2024	23:38	Discovery Middle - Pot Filler - 000137-Kitchen	1	Wt	Grab	X							CE	~~BX~~
800-160-FD	4/2/2024	23:38	Discovery Middle - Ice Machine - 000944-Kitchen	1	Wt	Grab	X							CF	~~BY~~

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3HD0078
AXIOM Service Professionals
PM: Carolyn Jackson

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HE0028

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: Discovery Middle School

Project / PO Number: Discovery Middle School
Received: 05/02/2024
Reported: 05/10/2024

Work Order Special Information

Young, Bradly
Discovery Middle School

Analytical Testing Parameters

Client Sample ID: 800-32-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0028-01
Collected By: Young, Bradly
Collection Date: 04/30/2024 22:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0142	RVV

Client Sample ID: 800-33-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0028-02
Collected By: Young, Bradly
Collection Date: 04/30/2024 22:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0148	RVV

Client Sample ID: 800-127-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0028-03
Collected By: Young, Bradly
Collection Date: 04/30/2024 22:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0154	RVV

Definitions

RL: Reporting Limit

CERTIFICATE OF ANALYSIS

3HE0028

Report Comments

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
05/10/24 13:14

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	~~Jeff Hurst~~ Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	800 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead						
800-32-FD	4/30/2024	22:15	Discovery Middle - Drinking Fountain - 004299B-100 Hall	1	Wt	Grab	X						
800-33-FD	4/30/2024	22:15	Discovery Middle - Bottle Filler - 004299F-100 Hall	1	Wt	Grab	X						
800-127-FD	4/30/2024	22:17	Discovery Middle - Drinking Fountain - 004205-Gym	1	Wt	Grab	X						

LAB USE ONLY		
Wk Order #:	3HE0028	
Short Hold:		
Rush:		
Temp:	oC	20.0
Sample Condition	Sample #	
	3HE0028-01	
	02	
	03	

3HE0028

AXIOM Service Professionals

PM: Carolyn Jackson

Relinquied by: (Signature)	Date:	5/2/2024	Received by: (Signature)	Date:	
Bradly Young					
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	05/02/24
			Carolyn Jackson		
	Time:			Time:	12:00

Remarks:


Appendix D
Photo Log



4/2/2024 - 800-1 - Discovery Middle - 004133-Nurse's Office-Across From Restroom



4/2/2024 - 800-2 - Discovery Middle - 004134-Nurse's Office-Across From Desk

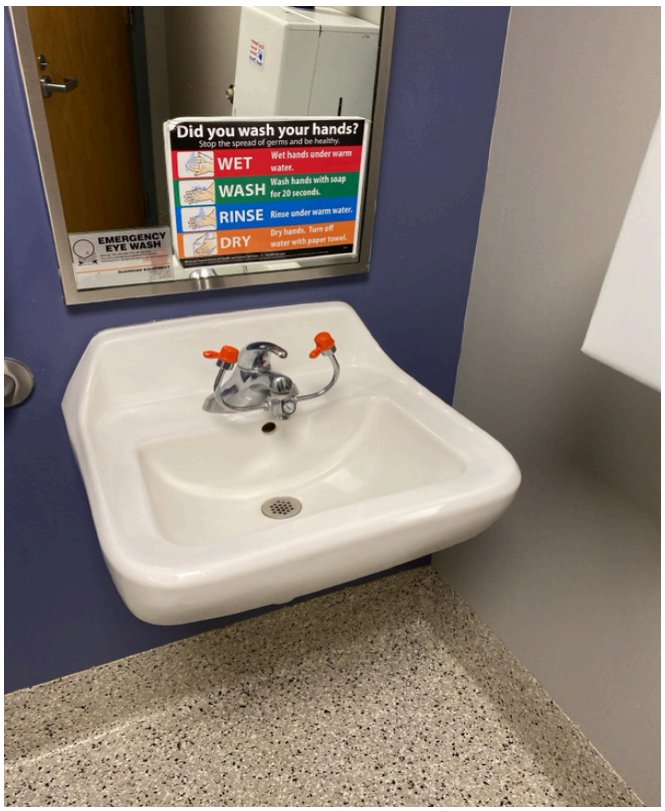

4/2/2024 - 800-3 - Discovery Middle - 004131-Nurse's Office-Restroom



4/2/2024 - 800-4 - Discovery Middle - 004132-Nurse's Office-Restroom



4/2/2024 - 800-5 - Discovery Middle - 004250-Lounge-Restroom



4/2/2024 - 800-6 - Discovery Middle - 004251-Lounge



4/2/2024 - 800-7 - Discovery Middle - 004252-Lounge-Restroom



4/2/2024 - 800-8 - Discovery Middle - 004791-Room 124



4/2/2024 - 800-9 - Discovery Middle - 004792-Room 124




4/2/2024 - 800-10 - Discovery Middle - 004793-Room 123



4/2/2024 - 800-11 - Discovery Middle - 004794-Room 123



4/2/2024 - 800-12 - Discovery Middle - 004128-Room 100

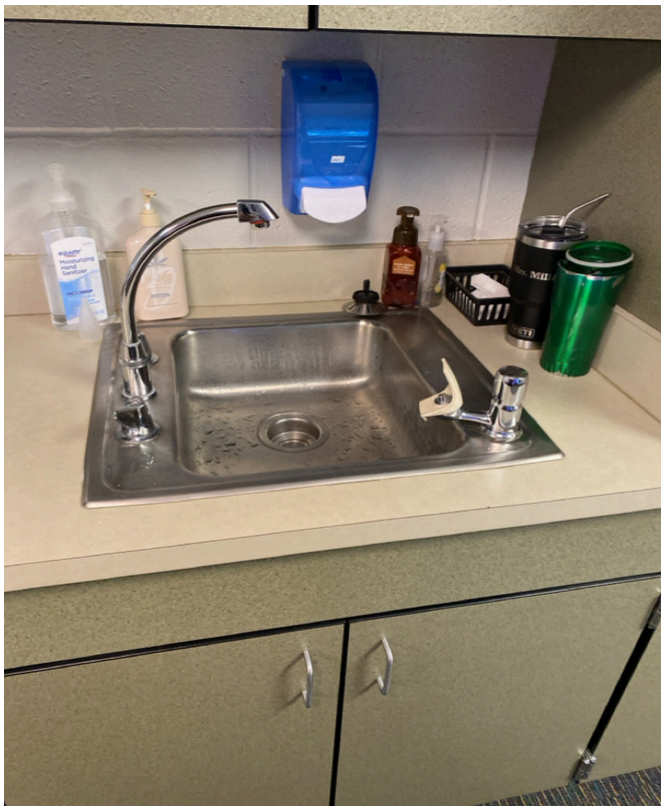

4/2/2024 - 800-13 - Discovery Middle - 004129- Room 100



4/2/2024 - 800-14 - Discovery Middle - 004126- Room 101



4/2/2024 - 800-15 - Discovery Middle - 004127- Room 101



4/2/2024 - 800-16 - Discovery Middle - 004114- Room 104



4/2/2024 - 800-17 - Discovery Middle - 004113- Room 104



4/2/2024 - 800-18 - Discovery Middle - 004108- Room 105



4/2/2024 - 800-19 - Discovery Middle - 004107- Room 105



4/2/2024 - 800-20 - Discovery Middle - 004112- Room 106



4/2/2024 - 800-21 - Discovery Middle - 004111- Room 106



4/2/2024 - 800-22 - Discovery Middle - 004110- Room 107



4/2/2024 - 800-23 - Discovery Middle - 004109- Room 107



4/2/2024 - 800-24 - Discovery Middle - 004106- Room 108



4/2/2024 - 800-25 - Discovery Middle - 004102-100 Hall-Girls-Right Sink



4/2/2024 - 800-26 - Discovery Middle - 004101-100 Hall-Girls-Middle Sink



4/2/2024 - 800-27 - Discovery Middle - 004300-100 Hall-Girls-Left Sink



4/2/2024 - 800-28 - Discovery Middle - 004103-100 Hall-Boys-Right Sink



4/2/2024 - 800-29 - Discovery Middle - 004104-100 Hall-Boys-Middle Sink



4/2/2024 - 800-30 - Discovery Middle - 003204-100 Hall-Boys-Left Sink



4/2/2024 - 800-31 - Discovery Middle - 004298-100 Hall



4/2/2024 - 800-34 - Discovery Middle - 004295-Room 109



4/2/2024 - 800-35 - Discovery Middle - 004294- Room 109



4/2/2024 - 800-36 - Discovery Middle - 004293- Room 110




4/2/2024 - 800-37 - Discovery Middle - 004292- Room 110



4/2/2024 - 800-38 - Discovery Middle - 004290- Room 111




4/2/2024 - 800-39 - Discovery Middle - 004291- Room 111

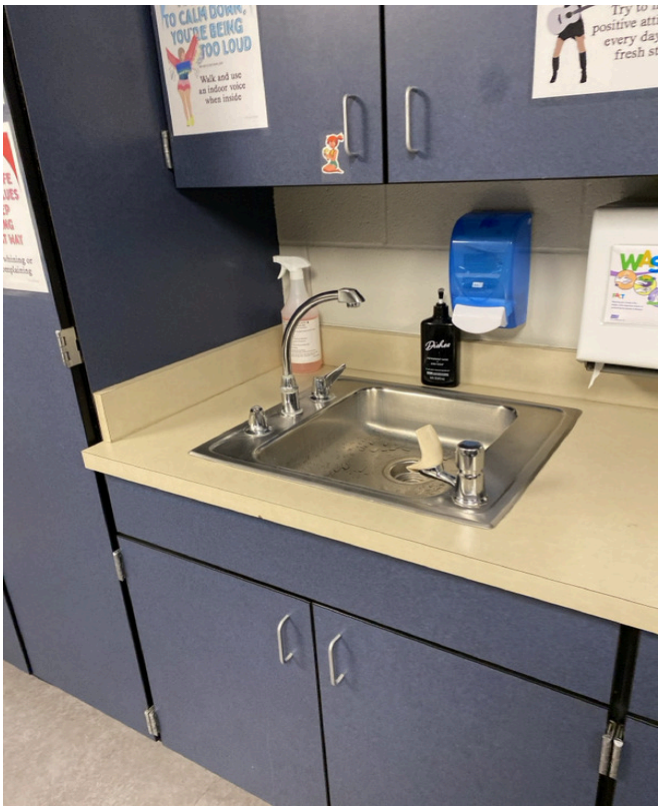

4/2/2024 - 800-40 - Discovery Middle - 004297- Room 112



4/2/2024 - 800-41 - Discovery Middle - 004296- Room 112

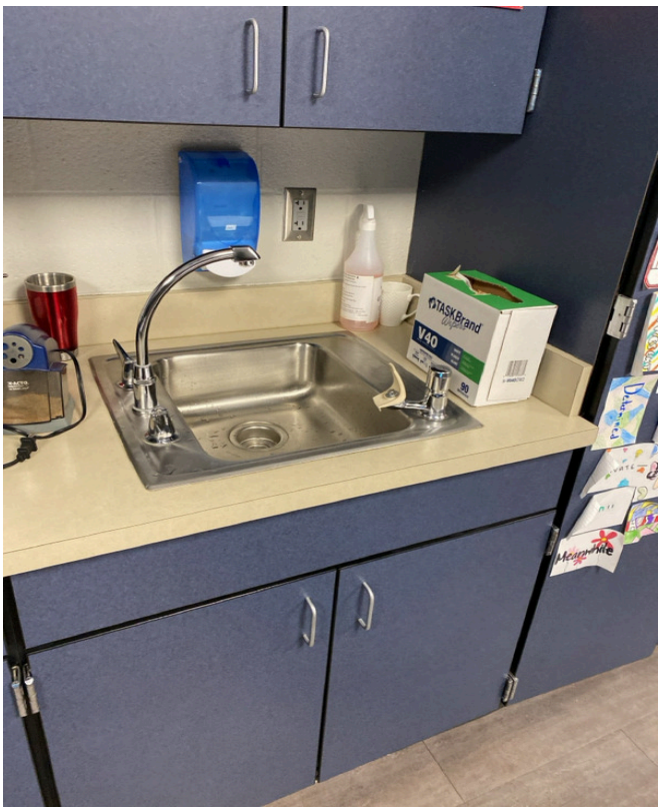

4/2/2024 - 800-42 - Discovery Middle - 004288- Room 113



4/2/2024 - 800-43 - Discovery Middle - 004289- Room 113



4/2/2024 - 800-44 - Discovery Middle - 004275- Room 116




4/2/2024 - 800-45 - Discovery Middle - 004276- Room 116



4/2/2024 - 800-46 - Discovery Middle - 004274- Room 118



4/2/2024 - 800-47 - Discovery Middle - 004273- Room 118

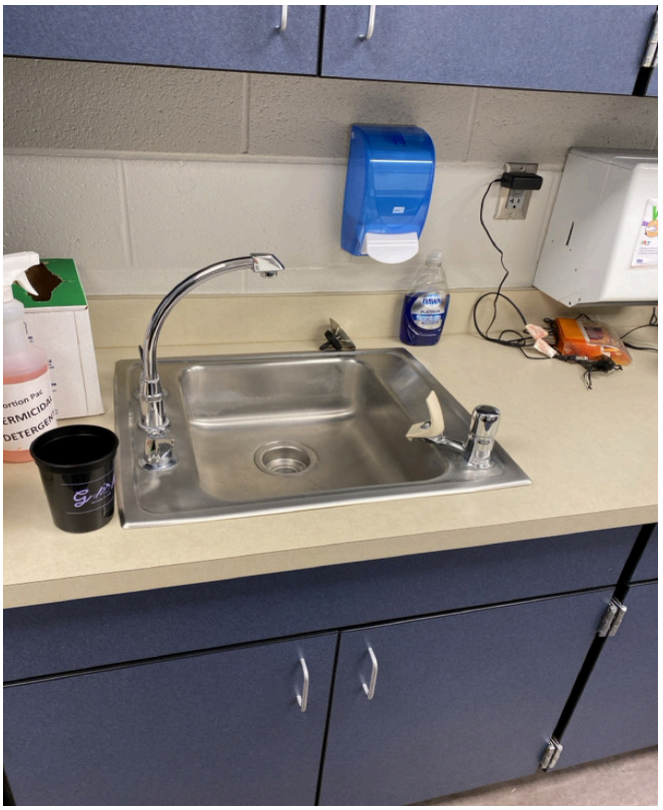

4/2/2024 - 800-48 - Discovery Middle - 004797- Room 119




4/2/2024 - 800-49 - Discovery Middle - 004798- Room 119




4/2/2024 - 800-50 - Discovery Middle - 004795- Room 120




4/2/2024 - 800-51 - Discovery Middle - 004796- Room 120

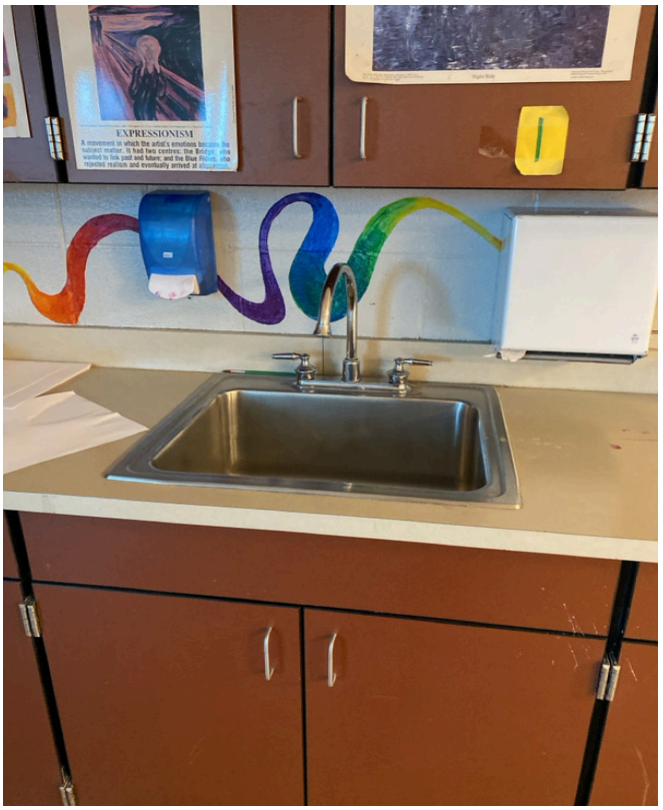


4/2/2024 - 800-52 - Discovery Middle - 004267- Room 203-Far Left Sink

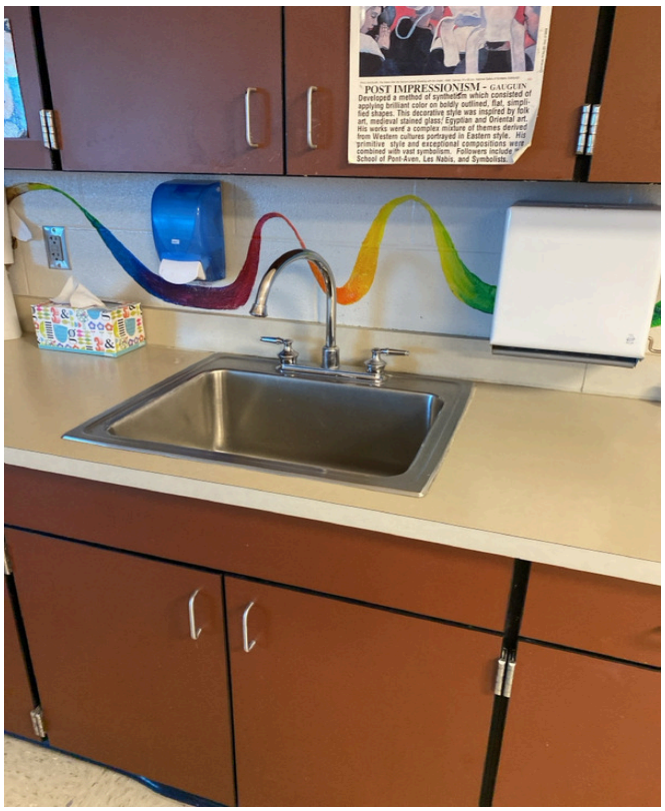

4/2/2024 - 800-53 - Discovery Middle - 004268- Room 203

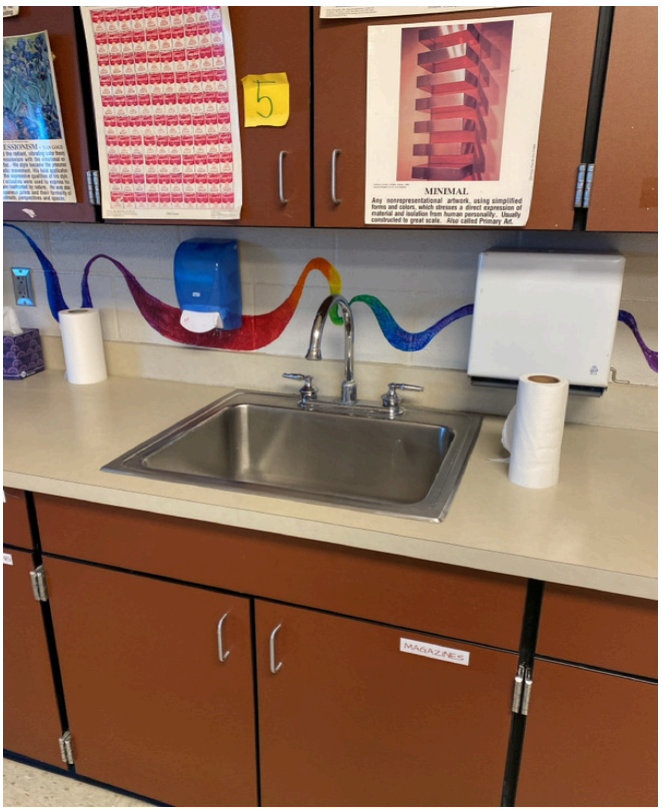


4/2/2024 - 800-54 - Discovery Middle - 004269- Room 203

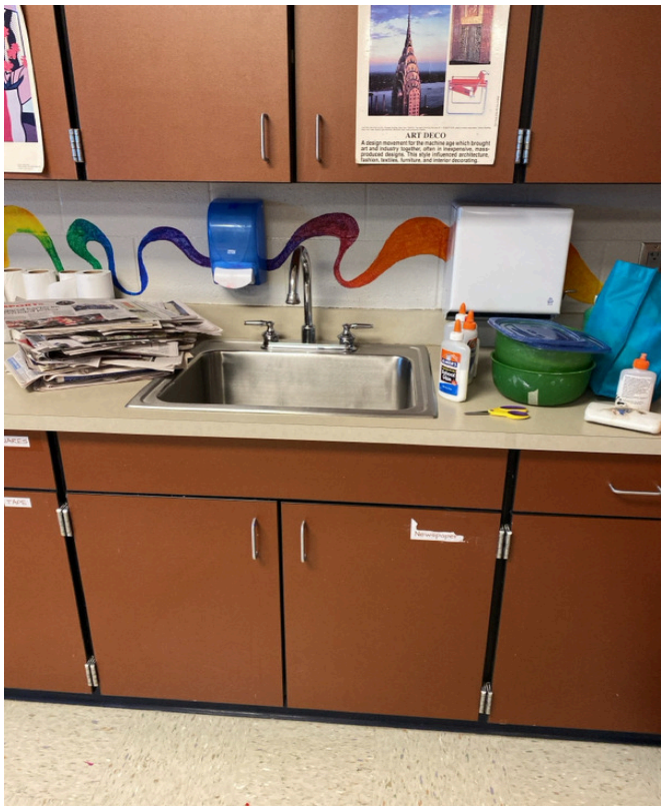


4/2/2024 - 800-55 - Discovery Middle - 004270- Room 203




4/2/2024 - 800-56 - Discovery Middle - 004271- Room 203

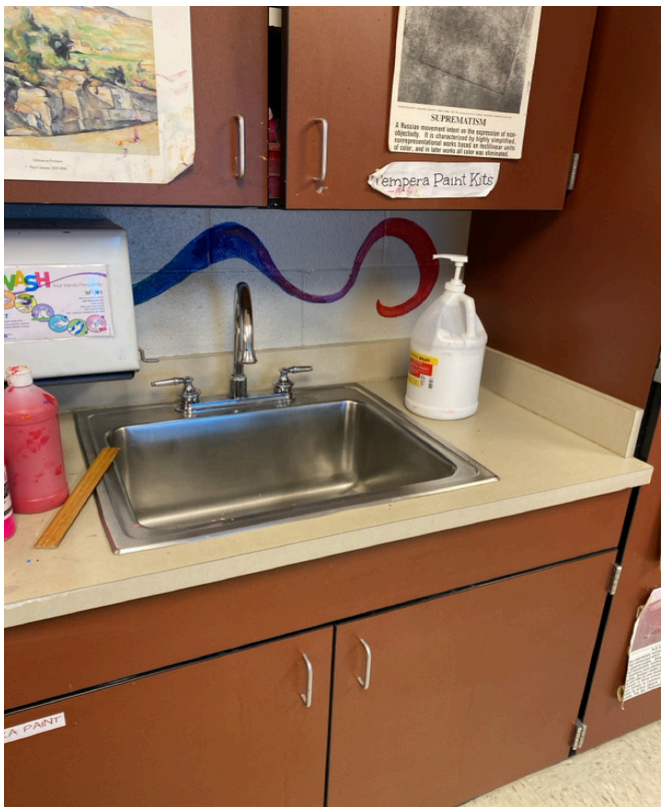


4/2/2024 - 800-57 - Discovery Middle - 004272- Room 203

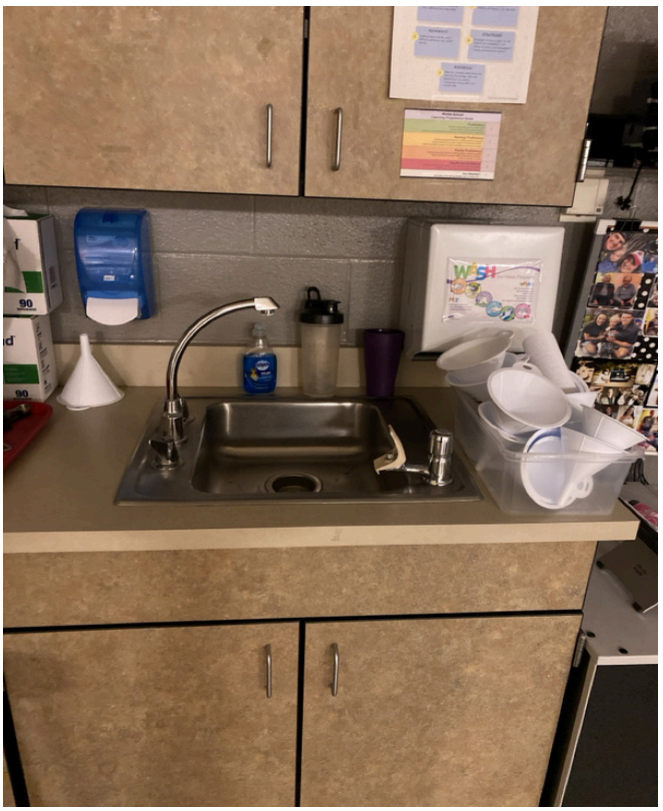


4/2/2024 - 800-58 - Discovery Middle - 004259- Room 204

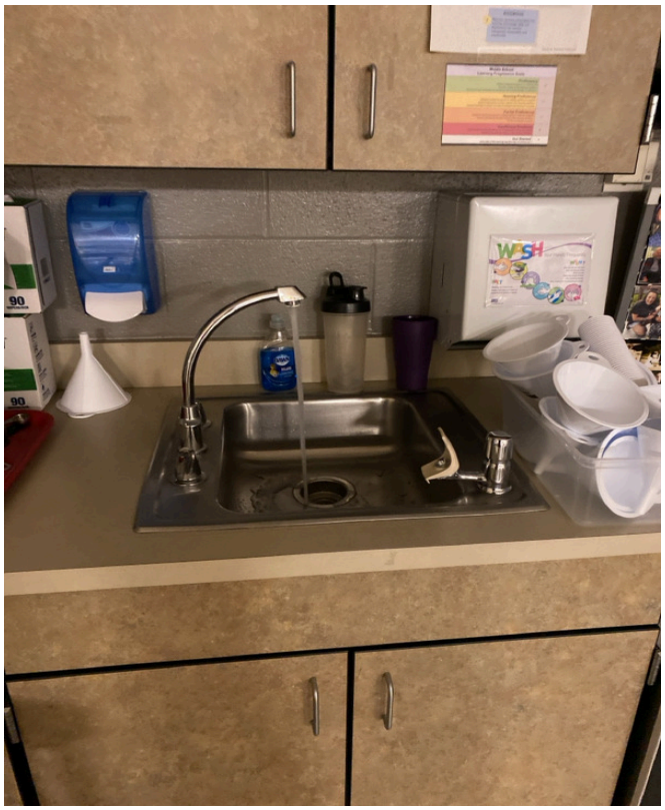


4/2/2024 - 800-59 - Discovery Middle - 004260- Room 204

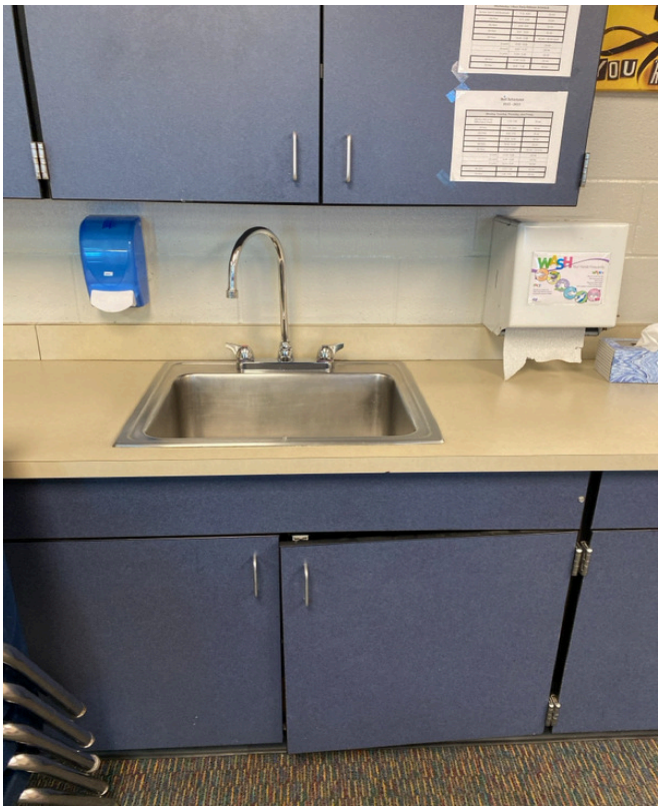

4/2/2024 - 800-60 - Discovery Middle - 004265- Room 205-Right Sink

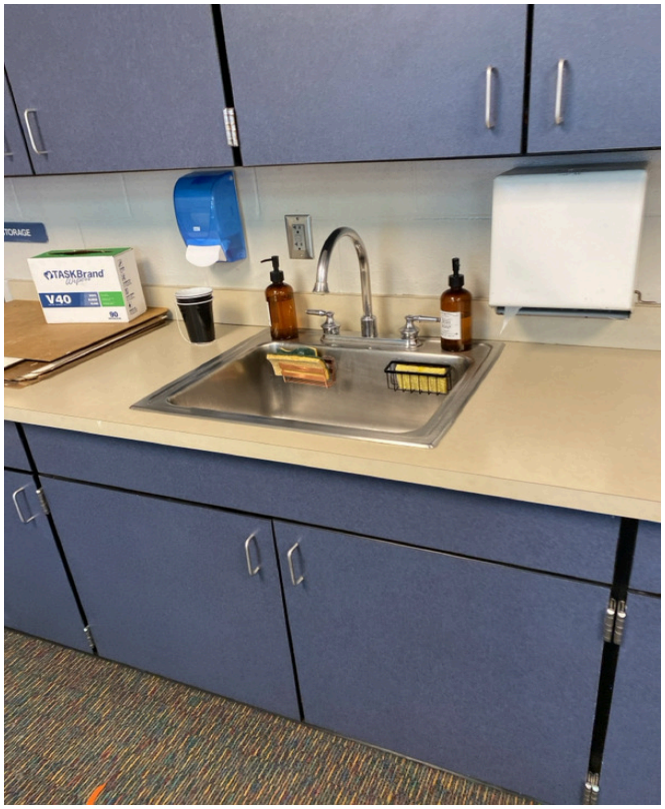

4/2/2024 - 800-61 - Discovery Middle - 004266- Room 205-Left Sink

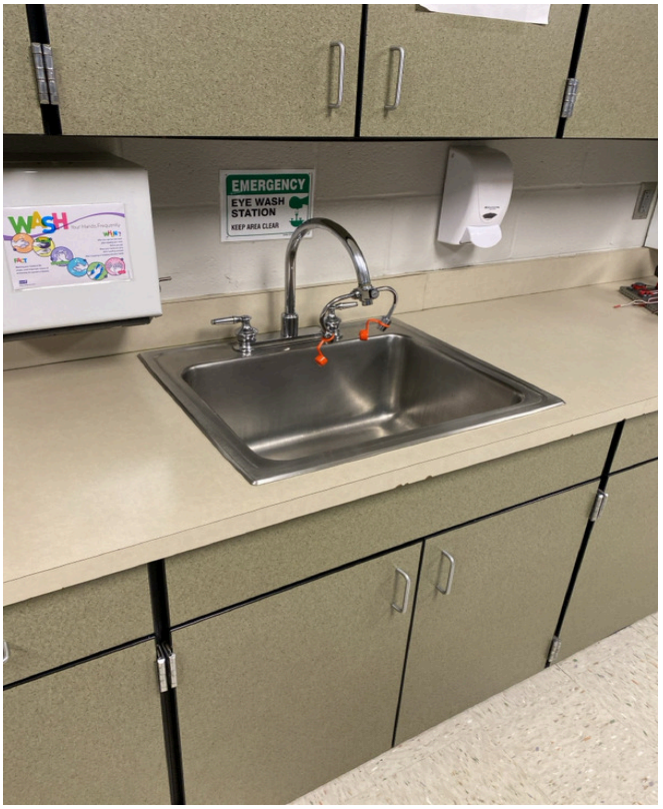


4/2/2024 - 800-62 - Discovery Middle - 003202- Room 207-Far Left Sink




4/2/2024 - 800-63 - Discovery Middle - 004261- Room 207



4/2/2024 - 800-64 - Discovery Middle - 004262- Room 207

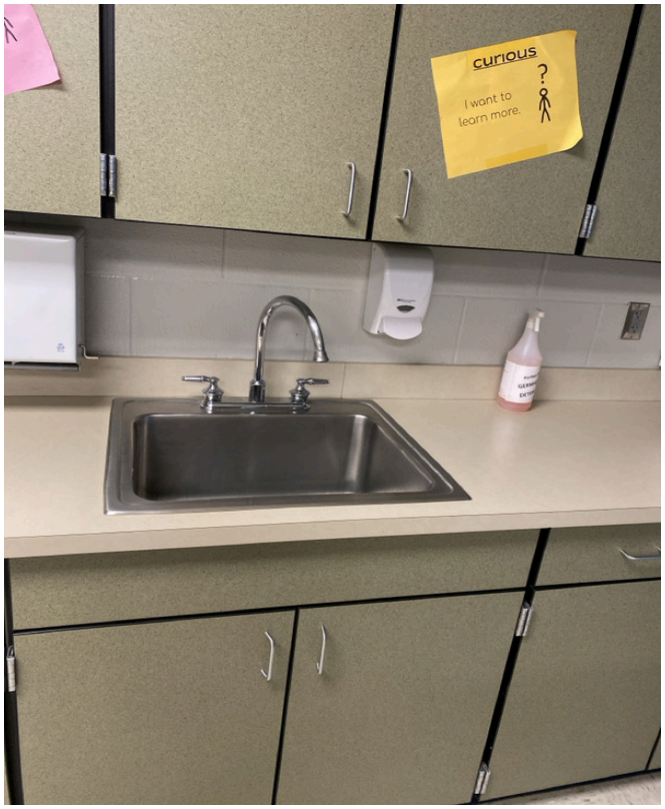

4/2/2024 - 800-65 - Discovery Middle - 004263- Room 207

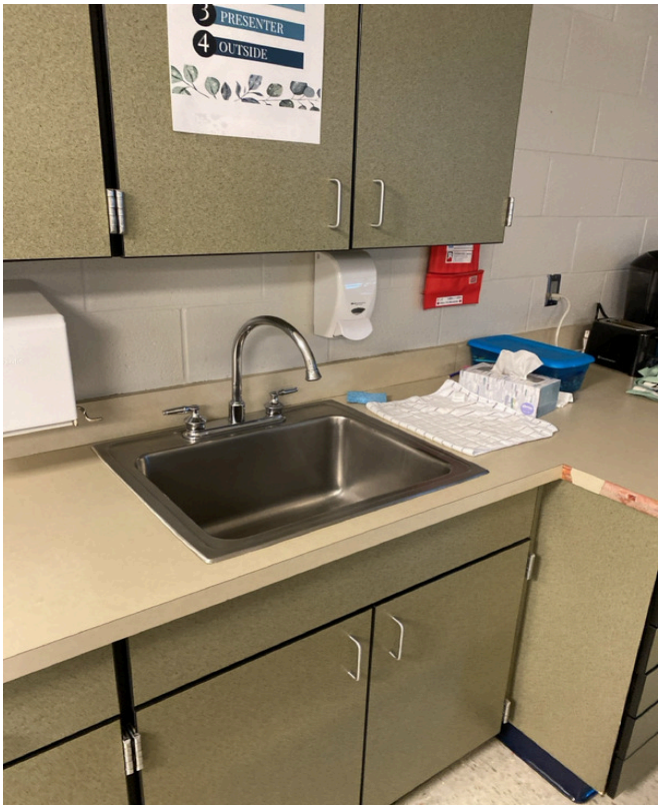

4/2/2024 - 800-66 - Discovery Middle - 004264- Room 207



4/2/2024 - 800-67 - Discovery Middle - 004253-Room 206-Kitchen 1



4/2/2024 - 800-68 - Discovery Middle - 004254-Room 206-Kitchen 2



4/2/2024 - 800-69 - Discovery Middle - 004255-Room 206-Kitchen 3




4/2/2024 - 800-70 - Discovery Middle - 004256-Room 206-Kitchen 4




4/2/2024 - 800-71 - Discovery Middle - 004257-Room 206-Kitchen 5



4/2/2024 - 800-72 - Discovery Middle - 004258-Room 206-Kitchen 6

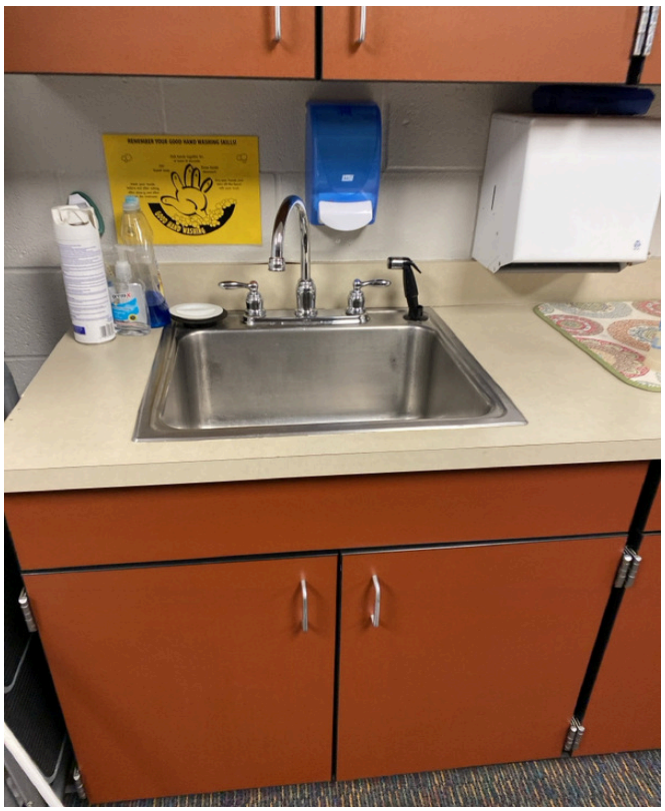

4/2/2024 - 800-73 - Discovery Middle - 004781-Room 319

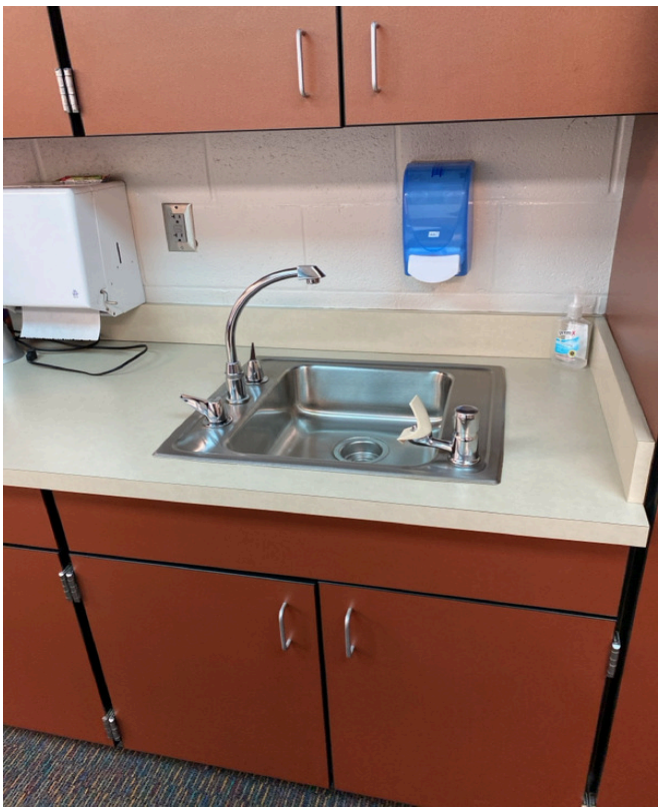

4/2/2024 - 800-74 - Discovery Middle - 004799-Room 318



4/2/2024 - 800-75 - Discovery Middle - 004800-Room 318



4/2/2024 - 800-76 - Discovery Middle - 004247-Room 315



4/2/2024 - 800-77 - Discovery Middle - 004246-Room 315



4/2/2024 - 800-78 - Discovery Middle - 004242-Room 316



4/2/2024 - 800-79 - Discovery Middle - 004243- Room 316



4/2/2024 - 800-80 - Discovery Middle - 004245- Room 314



4/2/2024 - 800-81 - Discovery Middle - 004244- Room 314



4/2/2024 - 800-82 - Discovery Middle - 004230- Room 311



4/2/2024 - 800-83 - Discovery Middle - 004229- Room 311



4/2/2024 - 800-84 - Discovery Middle - 004231- Room 310



4/2/2024 - 800-85 - Discovery Middle - 004232- Room 310



4/2/2024 - 800-86 - Discovery Middle - 004227- Room 309



4/2/2024 - 800-87 - Discovery Middle - 004228- Room 309



4/2/2024 - 800-88 - Discovery Middle - 004226- Room 308




4/2/2024 - 800-89 - Discovery Middle - 004225- Room 308



4/2/2024 - 800-90 - Discovery Middle - 004224- Room 307



4/2/2024 - 800-91 - Discovery Middle - 004223-Room 307

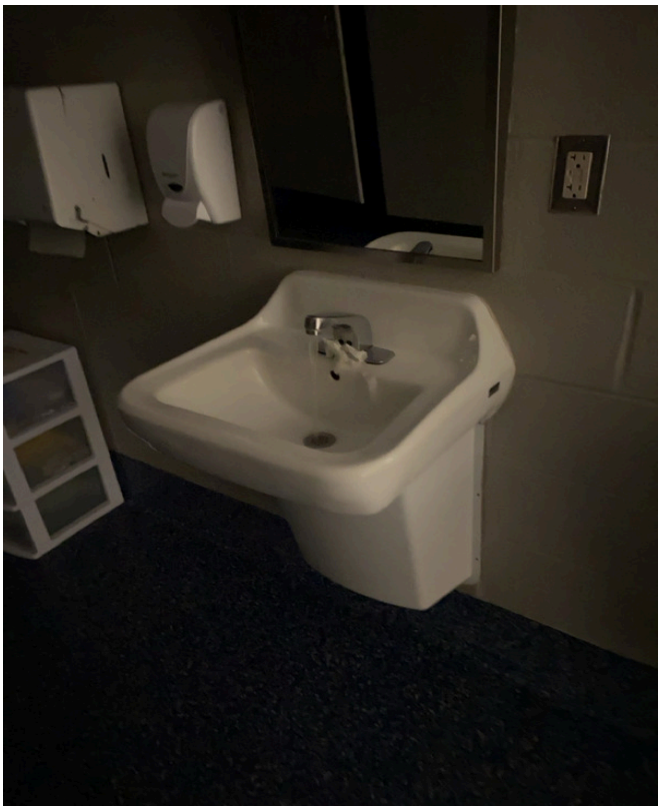

4/2/2024 - 800-92 - Discovery Middle - 004782-300 Hall-Girls-Left Sink



4/2/2024 - 800-93 - Discovery Middle - 004783-300 Hall-Girls-Middle Sink



4/2/2024 - 800-94 - Discovery Middle - 004784-300 Hall-Girls-Right Sink



4/2/2024 - 800-95 - Discovery Middle - 004785-300 Hall-Boys-Left Sink



4/2/2024 - 800-96 - Discovery Middle - 004786-300 Hall-Boys-Middle Sink



4/2/2024 - 800-97 - Discovery Middle - 004787-300 Hall-Boys-Right Sink



4/2/2024 - 800-98 - Discovery Middle - 004130-300 Hall-By Girls Restroom



4/2/2024 - 800-99 - Discovery Middle - 004221B-300 Hall



4/2/2024 - 800-100 - Discovery Middle - 004221F-300 Hall




4/2/2024 - 800-101 - Discovery Middle - 004222-Across from 301



4/2/2024 - 800-102 - Discovery Middle - 004219-Room 306



4/2/2024 - 800-103 - Discovery Middle - 004220-Room 306

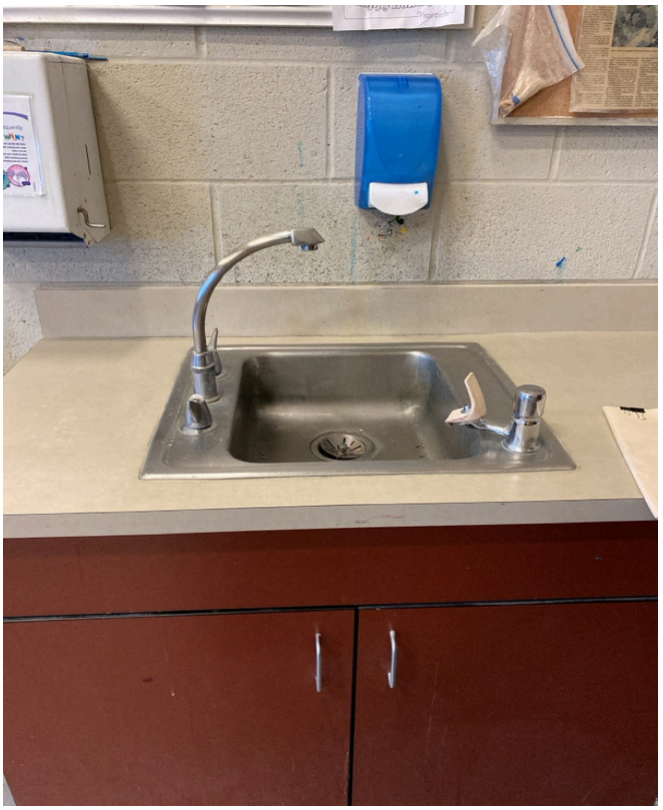

4/2/2024 - 800-104 - Discovery Middle - 004218-Room 303



4/2/2024 - 800-105 - Discovery Middle - 004217-Room 303



4/2/2024 - 800-106 - Discovery Middle - 004216-Room 303



4/2/2024 - 800-107 - Discovery Middle - 004215-Band Storage Next to 301



4/2/2024 - 800-108 - Discovery Middle - 004214-Room 300



4/2/2024 - 800-109 - Discovery Middle - 004790-Library-Maker Space




4/2/2024 - 800-110 - Discovery Middle - 004789-Library Restroom



4/2/2024 - 800-111 - Discovery Middle - 004788-Library



4/2/2024 - 800-112 - Discovery Middle - 004776-Commons-Girls

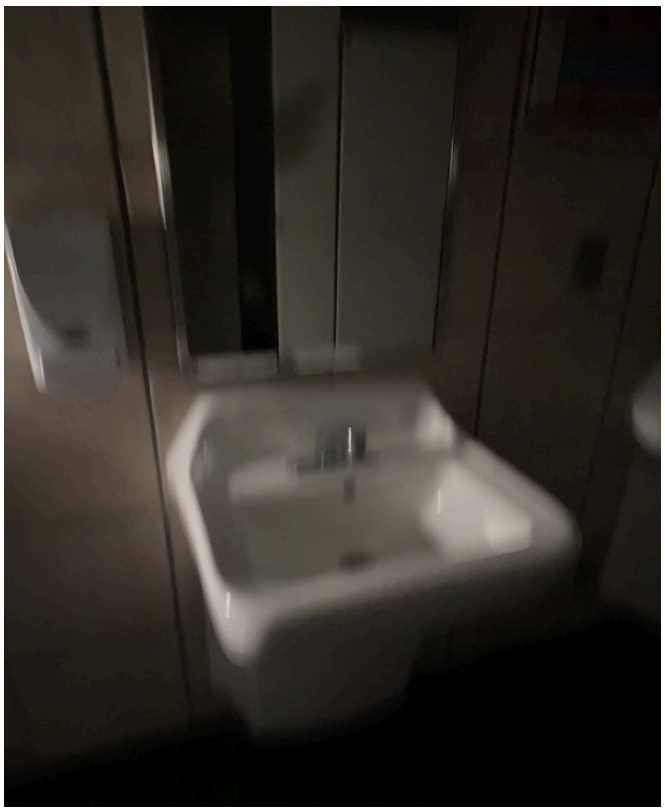

4/2/2024 - 800-113 - Discovery Middle - 004777-Commons-Girls



4/2/2024 - 800-114 - Discovery Middle - 004778-Commons-Girls



4/2/2024 - 800-115 - Discovery Middle - 004201-Commons-Boys



4/2/2024 - 800-116 - Discovery Middle - 003206-Commons-Boys



4/2/2024 - 800-117 - Discovery Middle - 004779-Commons-Boys



4/2/2024 - 800-118 - Discovery Middle - 004773-Commons-Right



4/2/2024 - 800-119 - Discovery Middle - 004774-Commons-Middle



4/2/2024 - 800-120 - Discovery Middle - 004775B-Commons



4/2/2024 - 800-121 - Discovery Middle - 004775F-Commons



4/2/2024 - 800-122 - Discovery Middle - 003205-Commons-Left



4/2/2024 - 800-123 - Discovery Middle - 004204-Gym



4/2/2024 - 800-124 - Discovery Middle - 004206-Gym



4/2/2024 - 800-125 - Discovery Middle - 004202-Gym-Restroom




4/2/2024 - 800-126 - Discovery Middle - 004203-Gym-Restroom-Right Sink



4/2/2024 - 800-127 - Discovery Middle - 004205- Gym Out of Order




4/2/2024 - 800-128 - Discovery Middle - 004211- Girls Locker Room

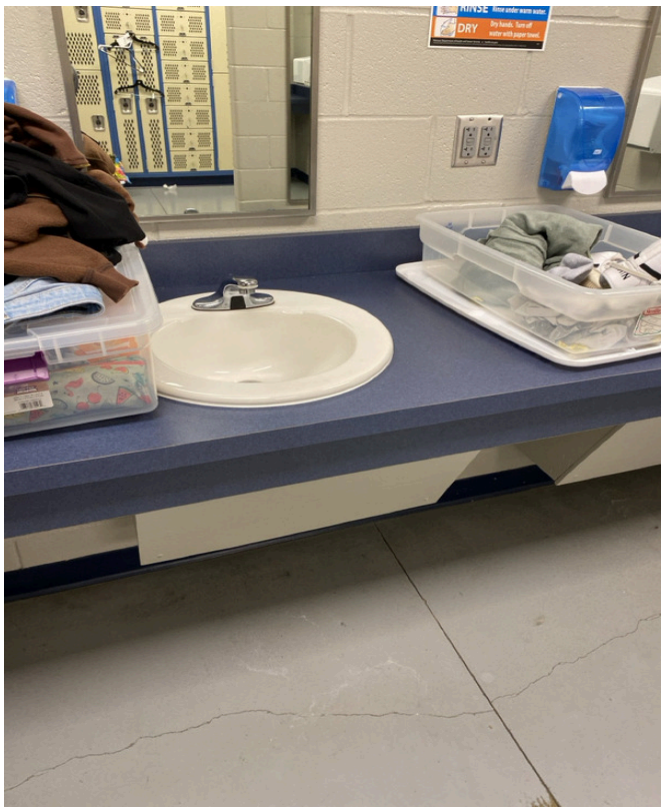

4/2/2024 - 800-129 - Discovery Middle - 004212- Girls Locker Room



4/2/2024 - 800-130 - Discovery Middle - 004213- Girls Locker Room

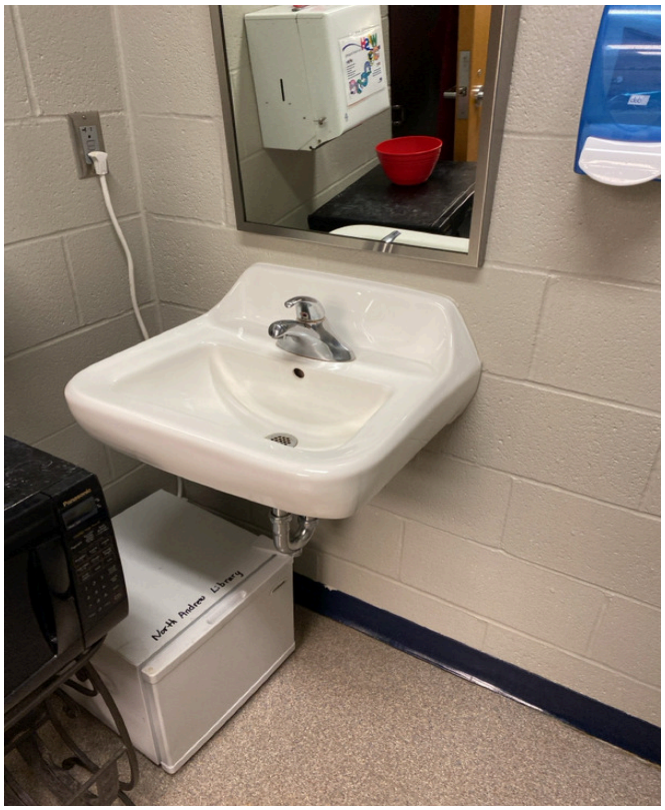

4/2/2024 - 800-131 - Discovery Middle - 003210-Girls Locker Room-Office



4/2/2024 - 800-132 - Discovery Middle - 003209-Girls Locker Room



4/2/2024 - 800-133 - Discovery Middle - 004207-Boys Locker Room



4/2/2024 - 800-134 - Discovery Middle - 004208-Boys Locker Room



4/2/2024 - 800-135 - Discovery Middle - 004210-Boys Locker Room-Coach Office



4/2/2024 - 800-136 - Discovery Middle - 004209-Boys Locker Room



4/2/2024 - 800-137 - Discovery Middle - 003208-Weight Room-Restroom



4/2/2024 - 800-138 - Discovery Middle - 003207-Weight Room



4/2/2024 - 800-139 - Discovery Middle - 004685-Kitchen Outside Office



4/2/2024 - 800-140 - Discovery Middle - 004686-Kitchen Outside Office



4/2/2024 - 800-141 - Discovery Middle - 004687-Kitchen-Handwashing-Next to Air Hood



4/2/2024 - 800-142 - Discovery Middle - 004688-Kitchen-Handwashing-Dry Storage



4/2/2024 - 800-143 - Discovery Middle - 004691- Kitchen-Across from Lounge



4/2/2024 - 800-144 - Discovery Middle - 004692- Kitchen-Across from Freezer



4/2/2024 - 800-145 - Discovery Middle - 004693- Kitchen-East Wall



4/2/2024 - 800-146 - Discovery Middle - 004694- Kitchen-East Wall



4/2/2024 - 800-147 - Discovery Middle - 004695-Kitchen-East Wall



4/2/2024 - 800-148 - Discovery Middle - 004696-Kitchen-East Wall



4/2/2024 - 800-149 - Discovery Middle - 004689-Kitchen-Handwashing-East Wall



4/2/2024 - 800-150 - Discovery Middle - 004679-Kitchen-Dishwasher Room



4/2/2024 - 800-151 - Discovery Middle - 004680-Kitchen-Dishwasher Room



4/2/2024 - 800-152 - Discovery Middle - 004681-Kitchen-Handwashing-Dish Room



4/2/2024 - 800-153 - Discovery Middle - 004682-Kitchen-Three Bay Sink



4/2/2024 - 800-154 - Discovery Middle - 004683-Kitchen-Three Bay Sink



4/2/2024 - 800-155 - Discovery Middle - 004684-Kitchen-Three Bay Sink



4/2/2024 - 800-156 - Discovery Middle - 004690-Kitchen-Next to Pizza Cooker



4/2/2024 - 800-157 - Discovery Middle - 004697-Kitchen-Restroom



4/2/2024 - 800-158 - Discovery Middle - 000136-Kitchen



4/2/2024 - 800-159 - Discovery Middle - 000137-Kitchen



4/2/2024 - 800-160 - Discovery Middle - 000944-Kitchen



4/30/2024 - 800-32 - Discovery Middle - 004299B-100 Hall




4/30/2024 - 800-33 - Discovery Middle - 004299F-100 Hall



4/30/2024 - 800-127 - Discovery Middle - 004205-Gym

Appendix E
Source Identification Diagram

ASP was provided sample locations by
Liberty School District

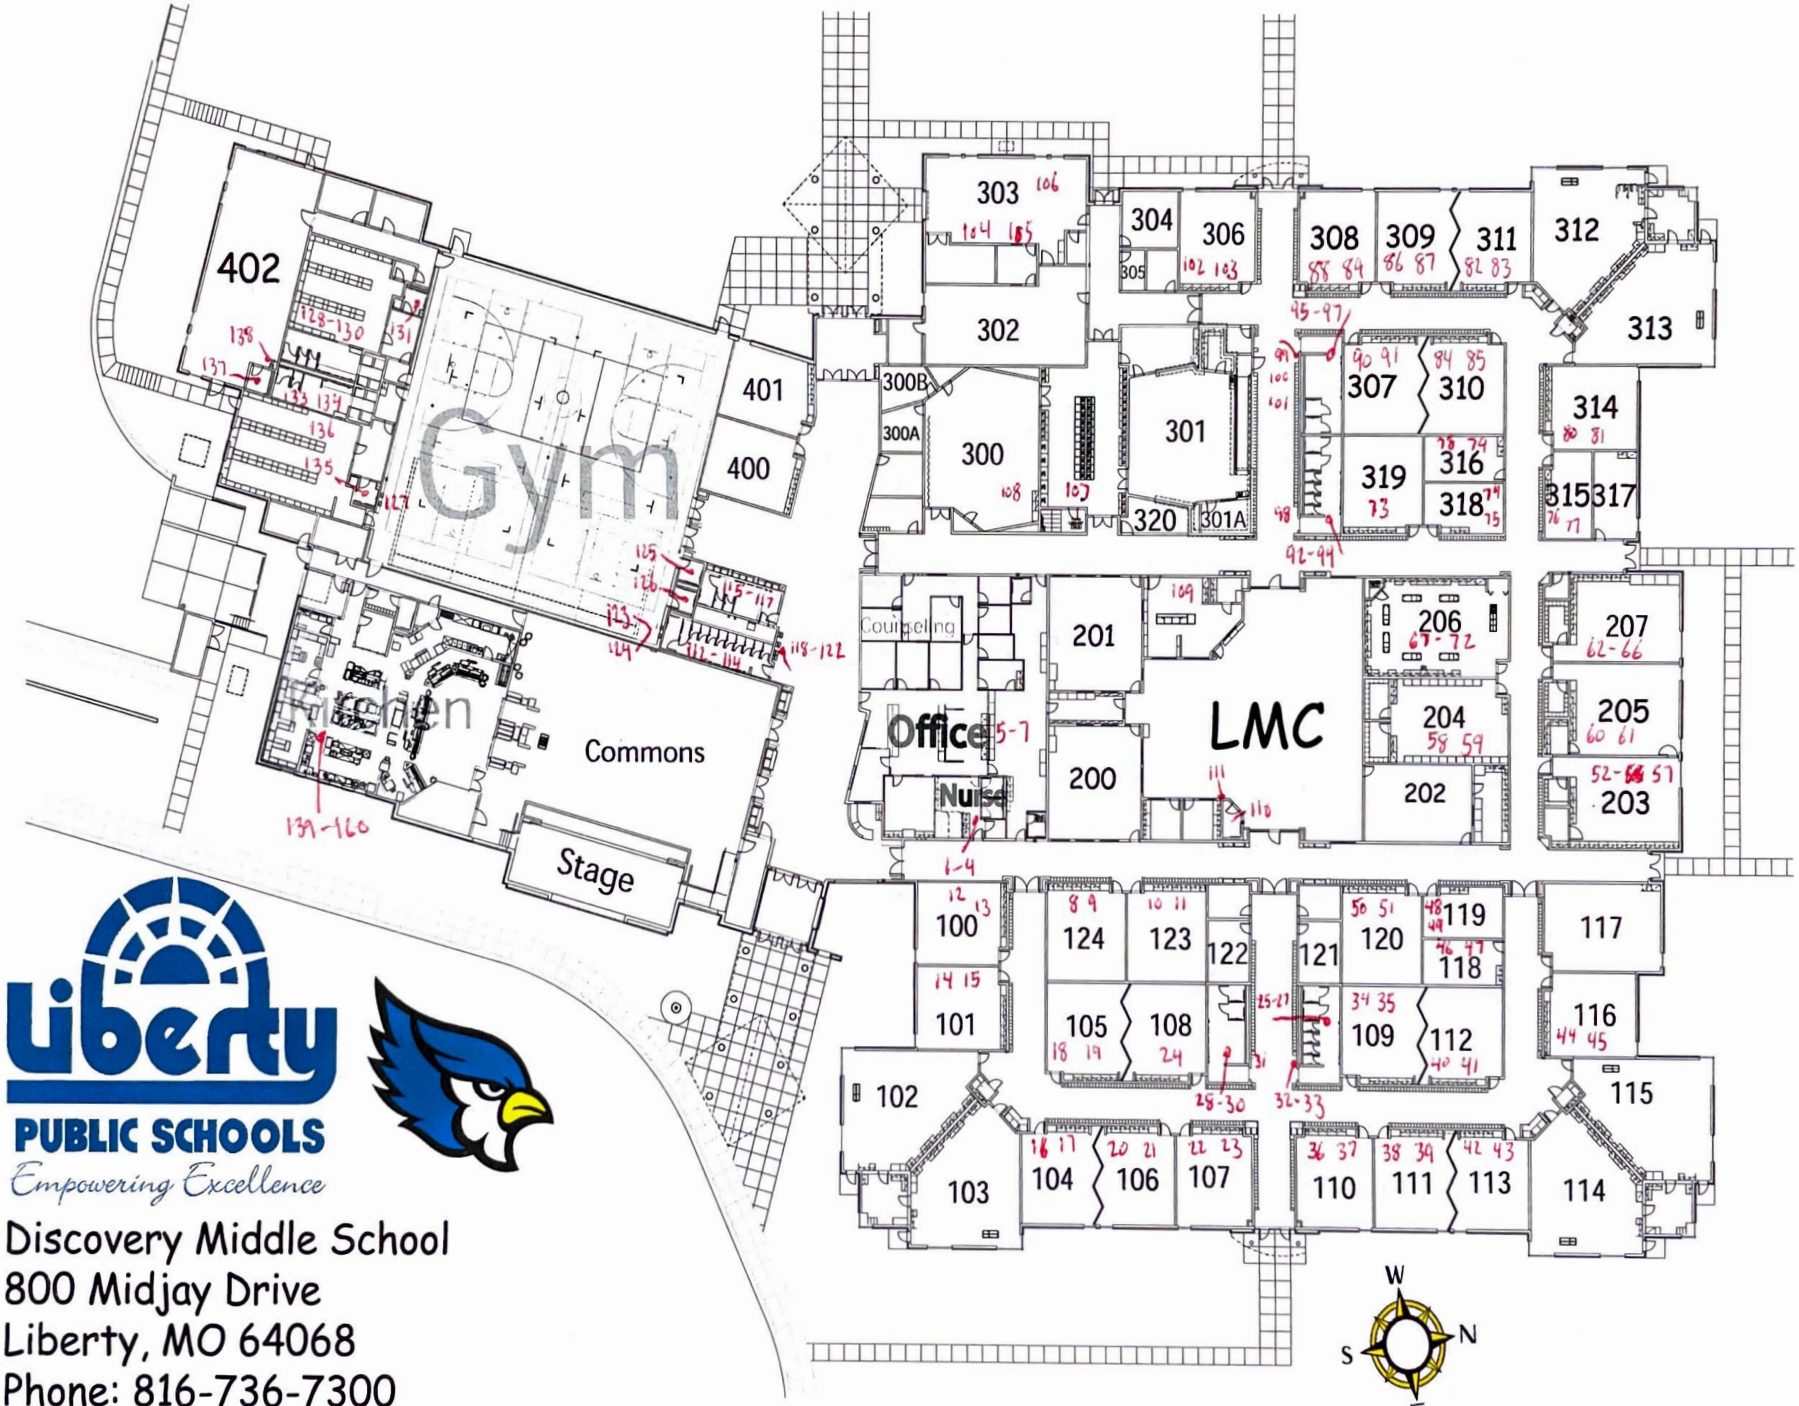

Liberty Public Schools
Empowering Excellence

Discovery Middle School
800 Midjay Drive
Liberty, MO 64068
Phone: 816-736-7300

Map Design by: Curt Laven
Last Updated: 05/16/2023