June 3, 2024

Steve Aldrich
Director of Facilities and Grounds
Liberty School District
801 Kent Street
Liberty, Missouri 64068

Project: Limited Lead in Drinking Water Testing
Address: 1500 South Withers Road, Liberty, Missouri 64068

Mr. Steve Aldrich

On April 4, 2024 and April 30, 2024, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 175 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of “lead free” to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of “lead free” as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: https://www.epa.gov/dwreginfo/lead-and-copper-rule

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.
Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school’s buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in red text.

April 4, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1500-1-FD	Liberty Middle School - 004330-Nurse's Office	Sink Tap	First Draw	0.4
1500-2-FD	Liberty Middle School - 004331-Nurse's Office-Left Restroom	Sink Tap	First Draw	0.6
1500-3-FD	Liberty Middle School - 004332-Nurse's Office-Right Restroom	Sink Tap	First Draw	0.6
1500-4-FD	Liberty Middle School - 004333-Lounge	Sink Tap	First Draw	<0.4
1500-5-FD	Liberty Middle School - 004334-Lounge	Bubbler	First Draw	2.8
1500-6-FD	Liberty Middle School - 004335-Lounge-Restroom	Sink Tap	First Draw	0.5

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1500-7-FD	Liberty Middle School - 004336-Lounge-Restroom	Sink Tap	First Draw	5.9
1500-8-FD	Liberty Middle School - 004359B-By Room 100	Drinking Fountain	First Draw	<0.4
1500-9-FD	Liberty Middle School - 004539F-By Room 100	Bottle Filler	First Draw	<0.4
1500-10-FD	Liberty Middle School - 004365-By Room 100-Girls-Far Right	Sink Tap	First Draw	0.5
1500-11-FD	Liberty Middle School - 004366-By Room 100-Girls	Sink Tap	First Draw	0.7
1500-12-FD	Liberty Middle School - 004367-By Room 100-Girls	Sink Tap	First Draw	0.7
1500-13-FD	Liberty Middle School - 004368-By Room 100-Girls	Sink Tap	First Draw	0.5
1500-14-FD	Liberty Middle School - 004369-By Room 100-Girls	Sink Tap	First Draw	2.5
1500-15-FD	Liberty Middle School - 004360-By Room 100-Boys-Far Right	Sink Tap	First Draw	2
1500-16-FD	Liberty Middle School - 004361-By Room 100-Boys	Sink Tap	First Draw	0.9
1500-17-FD	Liberty Middle School - 004362-By Room 100-Boys	Sink Tap	First Draw	2.9
1500-18-FD	Liberty Middle School - 004363-By Room 100-Boys	Sink Tap	First Draw	0.6
1500-19-FD	Liberty Middle School - 004364-By Room 100-Boys	Sink Tap	First Draw	1.1
1500-20-FD	Liberty Middle School - 003171-Across from 107-By Girls	Sink Tap	First Draw	3.1
1500-21-FD	Liberty Middle School - 003172-Across from 107-Boys	Sink Tap	First Draw	4.1
1500-22-FD	Liberty Middle School - 004470-Room 101	Sink Tap	First Draw	9.9
1500-23-FD	Liberty Middle School - 004471-Room 101	Bubbler	First Draw	2.2
1500-24-FD	Liberty Middle School - 004472-Room 102	Sink Tap	First Draw	1.5
1500-25-FD	Liberty Middle School - 004473-Room 102	Bubbler	First Draw	0.9
1500-26-FD	Liberty Middle School - 004468-Room 103	Sink Tap	First Draw	4.4
1500-27-FD	Liberty Middle School - 004469-Room 103	Sink Tap	First Draw	0.8
1500-28-FD	Liberty Middle School - 004458-Room 106	Sink Tap	First Draw	2.9
1500-29-	Liberty Middle School - 004459-Room 106 - Out of Order	Bubbler	Not Tested	Not Sampled
1500-30-FD	Liberty Middle School - 004456-Room 107	Sink Tap	First Draw	3.1

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1500-31-FD	Liberty Middle School - 004457-Room 107	Bubbler	First Draw	1.3
1500-32-FD	Liberty Middle School - 004454-Room 108	Sink Tap	First Draw	3.5
1500-33-FD	Liberty Middle School - 004455-Room 108	Bubbler	First Draw	1.5
1500-34-FD	Liberty Middle School - 004452-Room 109	Sink Tap	First Draw	3
1500-35-FD	Liberty Middle School - 004453-Room 109	Bubbler	First Draw	2.1
1500-36-FD	Liberty Middle School - 004442-Room 111	Sink Tap	First Draw	2.9
1500-37-FD	Liberty Middle School - 004443-Room 111	Bubbler	First Draw	1.3
1500-38-FD	Liberty Middle School - 004440-Room 113	Sink Tap	First Draw	2
1500-39-FD	Liberty Middle School - 004441-Room 113	Bubbler	First Draw	2.9
1500-40-FD	Liberty Middle School - 004438-Room 114	Sink Tap	First Draw	3.5
1500-41-FD	Liberty Middle School - 004439-Room 114	Bubbler	First Draw	3.5
1500-42-FD	Liberty Middle School - 003178-Room 403	Sink Tap	First Draw	1.3
1500-43-FD	Liberty Middle School - 003179-Room 403	Bubbler	First Draw	1.4
1500-44-FD	Liberty Middle School - 003176-Room 402	Sink Tap	First Draw	2
1500-45-FD	Liberty Middle School - 003177-Room 402	Bubbler	First Draw	3.9
1500-46-FD	Liberty Middle School - 003174-Room 401	Sink Tap	First Draw	4.8
1500-47-FD	Liberty Middle School - 003175-Room 401	Bubbler	First Draw	1
1500-48-FD	Liberty Middle School - 004349-By Room 300-Girls-Far Right	Sink Tap	First Draw	4.2
1500-49-FD	Liberty Middle School - 004350-By Room 300-Girls	Sink Tap	First Draw	0.9
1500-50-FD	Liberty Middle School - 004351-By Room 300-Girls	Sink Tap	First Draw	0.6
1500-51-FD	Liberty Middle School - 004352-By Room 300-Girls	Sink Tap	First Draw	<0.4
1500-52-FD	Liberty Middle School - 004353-By Room 300-Girls	Sink Tap	First Draw	<0.4
1500-53-FD	Liberty Middle School - 004348-By 300	Drinking Fountain	First Draw	<0.4
1500-54-FD	Liberty Middle School - 004348-By 300	Bottle Filler	First Draw	<0.4
1500-55-FD	Liberty Middle School - 004354-By 300-Boys-Far Right	Sink Tap	First Draw	4.7

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1500-56-FD	Liberty Middle School - 004355-By 300-Boys	Sink Tap	First Draw	1.5
1500-57-FD	Liberty Middle School - 004356-By 300-Boys	Sink Tap	First Draw	3.6
1500-58-FD	Liberty Middle School - 004357-By 300-Boys	Sink Tap	First Draw	2
1500-59-FD	Liberty Middle School - 004358-By 300-Boys	Sink Tap	First Draw	1.7
1500-60-FD	Liberty Middle School - 003121-By 403-Restroom	Sink Tap	First Draw	9.3
1500-61-FD	Liberty Middle School - 003180-By 403-Restroom	Sink Tap	First Draw	5.3
1500-62-FD	Liberty Middle School - 004437-Room 302	Sink Tap	First Draw	2.5
1500-63-FD	Liberty Middle School - 004438-Room 302	Bubbler	First Draw	1.3
1500-64-FD	Liberty Middle School - 004434-Room 301	Sink Tap	First Draw	1.6
1500-65-FD	Liberty Middle School - 004435-Room 301	Bubbler	First Draw	2
1500-66-FD	Liberty Middle School - 004432-Room 303	Sink Tap	First Draw	1.4
1500-67-FD	Liberty Middle School - 004433-Room 303	Bubbler	First Draw	1.8
1500-68-FD	Liberty Middle School - 004422-Room 312	Sink Tap	First Draw	2.4
1500-69-FD	Liberty Middle School - 004423-Room 312	Bubbler	First Draw	2.6
1500-70-FD	Liberty Middle School - 004420-Room 313	Sink Tap	First Draw	7.4
1500-71-FD	Liberty Middle School - 004421-Room 313	Bubbler	First Draw	1.8
1500-72-FD	Liberty Middle School - 004418-Room 314	Sink Tap	First Draw	3.4
1500-73-FD	Liberty Middle School - 004419-Room 314	Bubbler	First Draw	1.6
1500-74-FD	Liberty Middle School - 004416-Room 214	Sink Tap	First Draw	3.7
1500-75-FD	Liberty Middle School - 004417-Room 214	Bubbler	First Draw	1.2
1500-76-FD	Liberty Middle School - 004414-Room 213	Sink Tap	First Draw	1.8
1500-77-FD	Liberty Middle School - 004415-Room 213	Bubbler	First Draw	1.3
1500-78-FD	Liberty Middle School - 004412-Room 211	Sink Tap	First Draw	1.6
1500-79-FD	Liberty Middle School - 004412-Room 211	Bubbler	First Draw	0.6
1500-80-FD	Liberty Middle School - 004402-Room 209	Sink Tap	First Draw	2.4
1500-81-FD	Liberty Middle School - 004403-Room 209	Bubbler	First Draw	1.3

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1500-82-FD	Liberty Middle School - 004401-Room 208	Sink Tap	First Draw	2.1
1500-83-FD	Liberty Middle School - 004600-Room 208	Bubbler	First Draw	1
1500-84-FD	Liberty Middle School - 004598-Room 207	Sink Tap	First Draw	2.3
1500-85-FD	Liberty Middle School - 004599-Room 207	Bubbler	First Draw	1.5
1500-86-FD	Liberty Middle School - 004596-Room 206	Sink Tap	First Draw	3
1500-87-FD	Liberty Middle School - 004597-Room 206	Bubbler	First Draw	0.9
1500-88-FD	Liberty Middle School - 004586-Room 203	Sink Tap	First Draw	2.6
1500-89-FD	Liberty Middle School - 004587-Room 203	Bubbler	First Draw	1.3
1500-90-FD	Liberty Middle School - 004584-Room 201	Sink Tap	First Draw	2.2
1500-91-FD	Liberty Middle School - 004585-Room 201	Bubbler	First Draw	1.3
1500-92-FD	Liberty Middle School - 004582-Room 202	Sink Tap	First Draw	4.9
1500-93-FD	Liberty Middle School - 004583-Room 202	Bubbler	First Draw	0.8
1500-94-FD	Liberty Middle School - 004338-By 200-Boys-Far Right	Sink Tap	First Draw	0.4
1500-95-FD	Liberty Middle School - 004439-By 200-Boys	Sink Tap	First Draw	0.8
1500-96-FD	Liberty Middle School - 004340-By 200-Boys	Sink Tap	First Draw	0.6
1500-97-FD	Liberty Middle School - 004341-By 200-Boys	Sink Tap	First Draw	0.6
1500-98-FD	Liberty Middle School - 004342-By 200-Boys	Sink Tap	First Draw	1
1500-99-FD	Liberty Middle School - 003173-By Room 208-Restroom	Sink Tap	First Draw	3.5
1500-100-FD	Liberty Middle School - 004337-By 200	Drinking Fountain	First Draw	<0.4
1500-101-FD	Liberty Middle School - 004337-By 200	Bottle Filler	First Draw	<0.4
1500-102-FD	Liberty Middle School - 004343-By 200–Girls-Far Right	Sink Tap	First Draw	1
1500-103-FD	Liberty Middle School - 004344-By 200-Girls	Sink Tap	First Draw	0.7
1500-104-FD	Liberty Middle School - 004345-By 200-Girls	Sink Tap	First Draw	0.5
1500-105-FD	Liberty Middle School - 004346-By 200-Girls	Sink Tap	First Draw	0.6
1500-106-FD	Liberty Middle School - 004347-By 200-Girls	Sink Tap	First Draw	0.5

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1500-107-FD	Liberty Middle School - 000637-L-Kitchen	Ice Machine	First Draw	1.2
1500-108-FD	Liberty Middle School - 000814-L-Kitchen	Steam Kettle	First Draw	0.7
1500-109-FD	Liberty Middle School - 003184-Kitchen-By Ice Machine	Sink Tap	First Draw	3.2
1500-110-FD	Liberty Middle School - 003183-Kitchen-Restroom	Sink Tap	First Draw	1.2
1500-111-FD	Liberty Middle School - 003186-Kitchen-By Ovens	Sink Tap	First Draw	<0.4
1500-112-FD	Liberty Middle School - 003187-Kitchen-By Mixer	Sink Tap	First Draw	0.8
1500-113-FD	Liberty Middle School - 003188-Kitchen-By Freezer	Sink Tap	First Draw	0.7
1500-114-FD	Liberty Middle School - 003189-Kitchen-By Mixer	Sink Tap	First Draw	0.7
1500-115-FD	Liberty Middle School - 003190-Kitchen	Sink Tap	First Draw	37.1
1500-116-FD	Liberty Middle School - 003191-Kitchen	Sink Tap	First Draw	2
1500-117-FD	Liberty Middle School - 003192-Kitchen-Handwashing-Dish Area	Sink Tap	First Draw	<0.4
1500-118-FD	Liberty Middle School - 003193-Kitchen	Sink Tap	First Draw	<0.4
1500-119-FD	Liberty Middle School - 003194-Kitchen	Sink Tap	First Draw	<0.4
1500-120-FD	Liberty Middle School - 003195-Kitchen	Sink Tap	First Draw	3.4
1500-121-FD	Liberty Middle School - 003196-Kitchen	Sink Tap	First Draw	<0.4
1500-122-FD	Liberty Middle School - 003197-Kitchen	Sink Tap	First Draw	<0.4
1500-123-FD	Liberty Middle School - 003198-Kitchen-Dish Area-Sprayer	Sink Tap	First Draw	1.1
1500-124-FD	Liberty Middle School - 004310-Gym	Drinking Fountain	First Draw	0.4
1500-125-FD	Liberty Middle School - 004310-Gym	Bottle Filler	First Draw	0.5
1500-126-FD	Liberty Middle School - 004311-Gym	Drinking Fountain	First Draw	<0.4
1500-127-FD	Liberty Middle School - 004311-Gym	Bottle Filler	First Draw	<0.4
1500-128-FD	Liberty Middle School - 004309-Gym Office-Boys	Sink Tap	First Draw	0.9
1500-129-FD	Liberty Middle School - 004312-Boys Lockers	Sink Tap	First Draw	2.8
1500-130-FD	Liberty Middle School - 004313-Boys Lockers	Sink Tap	First Draw	10
1500-131-FD	Liberty Middle School - 004314-Boys Lockers	Sink Tap	First Draw	9.8

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1500-132-	Liberty Middle School - 004315-Boys Lockers - Out of Order	Sink Tap	Not Tested	Not Sampled
1500-133-FD	Liberty Middle School - 004316-Boys Lockers	Sink Tap	First Draw	8.4
1500-134-FD	Liberty Middle School - 004317-Boys Lockers	Sink Tap	First Draw	1.6
1500-135-FD	Liberty Middle School - 004304-Girls Lockers	Sink Tap	First Draw	6.3
1500-136-FD	Liberty Middle School - 004303-Girls Lockers	Sink Tap	First Draw	3.4
1500-137-FD	Liberty Middle School - 003199-Girls Lockers	Sink Tap	First Draw	3.8
1500-138-FD	Liberty Middle School - 004302-Girls Lockers	Sink Tap	First Draw	9.1
1500-139-FD	Liberty Middle School - 004301-Girls Lockers	Sink Tap	First Draw	4.3
1500-140-	Liberty Middle School - 003200-Girls Lockers - Out of Order	Sink Tap	Not Tested	Not Sampled
1500-141-FD	Liberty Middle School - 004308-Gym Office-Girls	Sink Tap	First Draw	1.2
1500-142-FD	Liberty Middle School - 004305-Room 604	Sink Tap	First Draw	1.5
1500-143-FD	Liberty Middle School - 004306-Room 604	Bubbler	First Draw	2.9
1500-144-FD	Liberty Middle School - 004307B-Weight Room	Drinking Fountain	First Draw	1.3
1500-145-FD	Liberty Middle School - 004307F-Weight Room	Bubbler	First Draw	1.1
1500-146-FD	Liberty Middle School - 004318-By 500-Boys-Far Right	Sink Tap	First Draw	0.5
1500-147-FD	Liberty Middle School - 004319-By 500-Boys	Sink Tap	First Draw	0.5
1500-148-FD	Liberty Middle School - 004320-By 500-Boys	Sink Tap	First Draw	0.4
1500-149-FD	Liberty Middle School - 004321-By 500-Boys	Sink Tap	First Draw	0.5
1500-150-FD	Liberty Middle School - 004322-By 500-Boys	Sink Tap	First Draw	0.4
1500-151-FD	Liberty Middle School - 004328-By 500	Bottle Filler	First Draw	<0.4
1500-152-FD	Liberty Middle School - 004329-By 500	Drinking Fountain	First Draw	<0.4
1500-153-FD	Liberty Middle School - 004323-By Room 500-Girls-Far Left	Sink Tap	First Draw	0.4
1500-154-FD	Liberty Middle School - 004324-By 500-Girls	Sink Tap	First Draw	0.5
1500-155-FD	Liberty Middle School - 004325-By 500-Girls	Sink Tap	First Draw	0.6
1500-156-FD	Liberty Middle School - 004326-By 500-Girls	Sink Tap	First Draw	0.5

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1500-157-FD	Liberty Middle School - 004327-By 500-Girls	Sink Tap	First Draw	0.5
1500-158-FD	Liberty Middle School - 004499-Room 506	Sink Tap	First Draw	3.7
1500-159-FD	Liberty Middle School - 004500-Room 506	Sink Tap	First Draw	1.2
1500-160-FD	Liberty Middle School - 004492/93-Room 505	Sink Tap	First Draw	0.4
1500-161-FD	Liberty Middle School - 004494/95-Room 505	Sink Tap	First Draw	0.5
1500-162-FD	Liberty Middle School - 004496/97-Room 505	Sink Tap	First Draw	1.4
1500-163-FD	Liberty Middle School - 004480/81-Room 504	Sink Tap	First Draw	0.5
1500-164-FD	Liberty Middle School - 004482/83-Room 504	Sink Tap	First Draw	1
1500-165-FD	Liberty Middle School - 004484/85-Room 504	Sink Tap	First Draw	1
1500-166-FD	Liberty Middle School - 004486/87-Room 504	Sink Tap	First Draw	0.9
1500-167-FD	Liberty Middle School - 004488/89-Room 504	Sink Tap	First Draw	0.6
1500-168-FD	Liberty Middle School - 004490/91-Room 504	Sink Tap	First Draw	0.5
1500-169-FD	Liberty Middle School - 004474-Room 502	Sink Tap	First Draw	1.6
1500-170-FD	Liberty Middle School - 004475-Room 502	Bubbler	First Draw	0.5
1500-171-FD	Liberty Middle School - 004476-Room 502	Sink Tap	First Draw	1.9
1500-172-FD	Liberty Middle School - 004477-Room 502	Bubbler	First Draw	3.9
1500-173-FD	Liberty Middle School - 004498-500 Hall-Staff Restroom	Sink Tap	First Draw	2.8
1500-174-FD	Liberty Middle School - 004478-Room 501	Sink Tap	First Draw	11.3
1500-175-FD	Liberty Middle School - 004479-Room 501	Bubbler	First Draw	0.9

April 30, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1500-29-FD	Liberty Middle School - 004459-Room 106	Bubbler	First Draw	2.9
1500-132-FD	Liberty Middle School - 004315-Boys Locker Room	Sink Tap	First Draw	7.5
1500-140-FD	Liberty Middle School - 003200-Girls Locker Room	Sink Tap	First Draw	3.0

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A
Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date:	**10/4/2023**
Expiration Date:	**10/4/2025**
License Number:	**211004-300006201**

Paula F. Nickelson
Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



Paula F. Nickelson
Acting Director
t of Health and Senior Services

son City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.

- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

PO Box 47166 Kansas City, MO 64188 • 816-678-7894 • www.axiomservicepros.com

Appendix C
Laboratory Analytical Report

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HD0080

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 1500 South Withers Road

Project / PO Number: 1500 South Withers Road
Received: 04/05/2024
Reported: 04/29/2024

Analytical Testing Parameters

Client Sample ID: 1500-1-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-01
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/24/24 1155	04/24/24 2222	JAR

Client Sample ID: 1500-2-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-02
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/24/24 1155	04/24/24 2225	JAR

Client Sample ID: 1500-3-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-03
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/24/24 1155	04/24/24 2228	JAR

Client Sample ID: 1500-4-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-04
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/24/24 1155	04/24/24 2231	JAR

Client Sample ID: 1500-5-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-05
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.8**	0.4	ppb	2		04/24/24 1155	04/24/24 2234	JAR

Client Sample ID: 1500-6-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-06
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/24/24 1155	04/24/24 2237	JAR

Client Sample ID: 1500-7-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-07
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**5.9**	0.4	ppb	2		04/24/24 1155	04/24/24 2246	JAR

Client Sample ID: 1500-8-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-08
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/24/24 1155	04/24/24 2300	JAR

Client Sample ID: 1500-9-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-09
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/24/24 1155	04/24/24 2303	JAR

Client Sample ID: 1500-10-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-10
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/24/24 1155	04/24/24 2306	JAR

Client Sample ID: 1500-11-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-11
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/24/24 1155	04/24/24 2309	JAR

Client Sample ID: 1500-12-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-12
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/24/24 1155	04/24/24 2312	JAR

Client Sample ID: 1500-13-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-13
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/24/24 1155	04/24/24 2315	JAR

Client Sample ID: 1500-14-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-14
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.5**	0.4	ppb	2		04/24/24 1155	04/24/24 2318	JAR

Client Sample ID: 1500-15-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-15
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/24/24 1155	04/24/24 2321	JAR

Client Sample ID: 1500-16-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-16
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/24/24 1155	04/24/24 2324	JAR

Client Sample ID: 1500-17-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-17
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.9**	0.4	ppb	2		04/24/24 1155	04/24/24 2333	JAR

Client Sample ID: 1500-18-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-18
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/24/24 1155	04/24/24 2336	JAR

Client Sample ID: 1500-19-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-19
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/24/24 1155	04/24/24 2339	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID: 1500-20-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-20
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.1**	0.4	ppb	2		04/24/24 1155	04/24/24 2342	JAR

Client Sample ID: 1500-21-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-21
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.1**	0.4	ppb	2		04/24/24 1155	04/24/24 2345	JAR

Client Sample ID: 1500-22-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-22
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**9.9**	0.4	ppb	2		04/24/24 1155	04/24/24 2348	JAR

Client Sample ID: 1500-23-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-23
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.2**	0.4	ppb	2		04/24/24 1155	04/24/24 2351	JAR

Client Sample ID: 1500-24-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-24
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/24/24 1155	04/24/24 2354	JAR

Client Sample ID: 1500-25-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-25
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/24/24 1155	04/24/24 2357	JAR

Client Sample ID: 1500-26-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-26
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.4**	0.4	ppb	2		04/24/24 1155	04/25/24 0000	JAR

Client Sample ID: 1500-27-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-27
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/24/24 1155	04/25/24 0015	JAR

Client Sample ID: 1500-28-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-28
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.9**	0.4	ppb	2		04/24/24 1155	04/25/24 0024	JAR

Client Sample ID: 1500-30-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-29
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.1**	0.4	ppb	2		04/24/24 1155	04/25/24 0027	JAR

Client Sample ID: 1500-31-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-30
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0030	JAR

Client Sample ID: 1500-32-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-31
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.5**	0.4	ppb	2		04/24/24 1155	04/25/24 0033	JAR

Client Sample ID: 1500-33-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-32
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/24/24 1155	04/25/24 0036	JAR

Client Sample ID: 1500-34-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-33
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0045	JAR

Client Sample ID: 1500-35-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-34
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.1**	0.4	ppb	2		04/24/24 1155	04/25/24 0048	JAR

Client Sample ID: 1500-36-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-35
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.9**	0.4	ppb	2		04/24/24 1155	04/25/24 0051	JAR

Client Sample ID: 1500-37-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-36
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0054	JAR

Client Sample ID: 1500-38-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-37
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0057	JAR

Client Sample ID: 1500-39-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-38
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.9**	0.4	ppb	2		04/24/24 1155	04/25/24 0100	JAR

Client Sample ID: 1500-40-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-39
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.5**	0.4	ppb	2		04/24/24 1155	04/25/24 0103	JAR

Client Sample ID: 1500-41-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-40
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.5**	0.4	ppb	2		04/24/24 1155	04/25/24 0106	JAR

Client Sample ID: 1500-42-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-41
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0109	JAR

Client Sample ID: 1500-43-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-42
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.4**	0.4	ppb	2		04/24/24 1155	04/25/24 0112	JAR

Client Sample ID: 1500-44-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-43
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0121	JAR

Client Sample ID: 1500-45-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-44
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.9**	0.4	ppb	2		04/24/24 1155	04/25/24 0124	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID: 1500-46-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-45
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.8**	0.4	ppb	2		04/24/24 1155	04/25/24 0127	JAR

Client Sample ID: 1500-47-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-46
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0130	JAR

Client Sample ID: 1500-48-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-47
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.2**	0.4	ppb	2		04/24/24 1155	04/25/24 0139	JAR

Client Sample ID: 1500-49-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-48
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/24/24 1155	04/25/24 0148	JAR

Client Sample ID: 1500-50-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-49
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0157	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID: 1500-51-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-50
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/24/24 1155	04/25/24 0200	JAR

Client Sample ID: 1500-52-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-51
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/24/24 1155	04/25/24 0203	JAR

Client Sample ID: 1500-53-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-52
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/24/24 1155	04/25/24 0206	JAR

Client Sample ID: 1500-54-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-53
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/24/24 1155	04/25/24 0209	JAR

Client Sample ID: 1500-55-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-54
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.7**	0.4	ppb	2		04/24/24 1155	04/25/24 0212	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID:	1500-56-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0080-55	**Collection Date:**	04/04/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/24/24 1155	04/25/24 0215	JAR

Client Sample ID:	1500-57-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0080-56	**Collection Date:**	04/04/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0218	JAR

Client Sample ID:	1500-58-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0080-57	**Collection Date:**	04/04/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0221	JAR

Client Sample ID:	1500-59-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0080-58	**Collection Date:**	04/04/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.7**	0.4	ppb	2		04/24/24 1155	04/25/24 0224	JAR

Client Sample ID:	1500-60-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0080-59	**Collection Date:**	04/04/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**9.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0233	JAR

Client Sample ID: 1500-61-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-60
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**5.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0236	JAR

Client Sample ID: 1500-62-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-61
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.5**	0.4	ppb	2		04/24/24 1155	04/25/24 0239	JAR

Client Sample ID: 1500-63-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-62
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0242	JAR

Client Sample ID: 1500-64-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-63
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0245	JAR

Client Sample ID: 1500-65-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-64
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0248	JAR

Client Sample ID: 1500-66-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-65
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.4**	0.4	ppb	2		04/24/24 1155	04/25/24 0251	JAR

Client Sample ID: 1500-67-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-66
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/24/24 1155	04/25/24 0254	JAR

Client Sample ID: 1500-68-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-67
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/24/24 1155	04/25/24 0309	JAR

Client Sample ID: 1500-69-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-68
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0318	JAR

Client Sample ID: 1500-70-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-69
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**7.4**	0.4	ppb	2		04/24/24 1155	04/25/24 0321	JAR

Client Sample ID: 1500-71-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-70
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/24/24 1155	04/25/24 0324	JAR

Client Sample ID: 1500-72-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-71
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.4**	0.4	ppb	2		04/24/24 1155	04/25/24 0327	JAR

Client Sample ID: 1500-73-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-72
Collected By: Young, Bradly
Collection Date: 04/04/2024 22:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0330	JAR

Client Sample ID: 1500-74-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-73
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.7**	0.4	ppb	2		04/24/24 1155	04/25/24 0333	JAR

Client Sample ID: 1500-75-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-74
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/24/24 1155	04/25/24 0336	JAR

Client Sample ID: 1500-76-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-75
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/24/24 1155	04/25/24 0345	JAR

Client Sample ID: 1500-77-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-76
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0348	JAR

Client Sample ID: 1500-78-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-77
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0351	JAR

Client Sample ID: 1500-79-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-78
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0354	JAR

Client Sample ID: 1500-80-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-79
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/24/24 1155	04/25/24 0357	JAR

Client Sample ID: 1500-81-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-80
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0400	JAR

Client Sample ID: 1500-82-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-81
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.1**	0.4	ppb	2		04/24/24 1155	04/25/24 0403	JAR

Client Sample ID: 1500-83-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-82
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0406	JAR

Client Sample ID: 1500-84-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-83
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0409	JAR

Client Sample ID: 1500-85-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-84
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/24/24 1155	04/25/24 0412	JAR

Client Sample ID: 1500-86-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-85
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0421	JAR

Client Sample ID: 1500-87-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-86
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/24/24 1155	04/25/24 0424	JAR

Client Sample ID: 1500-88-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-87
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0433	JAR

Client Sample ID: 1500-89-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-88
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0442	JAR

Client Sample ID: 1500-90-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-89
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.2**	0.4	ppb	2		04/24/24 1155	04/25/24 0445	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID: 1500-91-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-90
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/24/24 1155	04/25/24 0448	JAR

Client Sample ID: 1500-92-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-91
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.9**	0.4	ppb	2		04/24/24 1155	04/25/24 0457	JAR

Client Sample ID: 1500-93-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-92
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/24/24 1155	04/25/24 0500	JAR

Client Sample ID: 1500-94-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-93
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/24/24 1155	04/25/24 0503	JAR

Client Sample ID: 1500-95-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-94
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/24/24 1155	04/25/24 0506	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID: 1500-96-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-95
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0509	JAR

Client Sample ID: 1500-97-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-96
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/24/24 1155	04/25/24 0512	JAR

Client Sample ID: 1500-98-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-97
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0515	JAR

Client Sample ID: 1500-99-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-98
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.5**	0.4	ppb	2		04/24/24 1155	04/25/24 0518	JAR

Client Sample ID: 1500-100-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-99
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/24/24 1155	04/25/24 0521	JAR

Client Sample ID: 1500-101-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AA
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/24/24 1155	04/25/24 0524	JAR

Client Sample ID: 1500-102-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AB
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/24/24 1155	04/25/24 0533	JAR

Client Sample ID: 1500-103-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AC
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1207	JAR

Client Sample ID: 1500-104-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AD
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1216	JAR

Client Sample ID: 1500-105-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AE
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/25/24 1332	04/26/24 1219	JAR

Client Sample ID: 1500-106-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AF
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1222	JAR

Client Sample ID: 1500-107-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AG
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 1231	JAR

Client Sample ID: 1500-108-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AH
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1234	JAR

Client Sample ID: 1500-109-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AI
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.2**	0.4	ppb	2		04/25/24 1332	04/26/24 1237	JAR

Client Sample ID: 1500-110-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AJ
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 1240	JAR

Client Sample ID: 1500-111-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AK
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1243	JAR

Client Sample ID: 1500-112-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AL
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1246	JAR

Client Sample ID: 1500-113-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AM
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1249	JAR

Client Sample ID: 1500-114-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AN
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1252	JAR

Client Sample ID: 1500-115-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AO
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**37.1**	0.4	ppb	2		04/25/24 1332	04/26/24 1255	JAR

Client Sample ID: 1500-116-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AP
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/25/24 1332	04/26/24 1258	JAR

Client Sample ID: 1500-117-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AQ
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1307	JAR

Client Sample ID: 1500-118-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AR
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1310	JAR

Client Sample ID: 1500-119-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AS
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1313	JAR

Client Sample ID: 1500-120-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AT
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1316	JAR

Client Sample ID: 1500-121-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AU
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1319	JAR

Client Sample ID: 1500-122-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AV
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1322	JAR

Client Sample ID: 1500-123-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AW
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/25/24 1332	04/26/24 1331	JAR

Client Sample ID: 1500-124-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AX
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1346	JAR

Client Sample ID: 1500-125-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AY
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1349	JAR

Client Sample ID: 1500-126-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-AZ
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1352	JAR

Client Sample ID: 1500-127-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BA
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1354	JAR

Client Sample ID: 1500-128-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BB
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/25/24 1332	04/26/24 1357	JAR

Client Sample ID: 1500-129-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BC
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1400	JAR

Client Sample ID: 1500-130-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BD
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**10.0**	0.4	ppb	2		04/25/24 1332	04/26/24 1403	JAR

Client Sample ID: 1500-131-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BE
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**9.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1406	JAR

Client Sample ID: 1500-133-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BF
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**8.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1409	JAR

Client Sample ID: 1500-134-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BG
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/25/24 1332	04/26/24 1418	JAR

Client Sample ID: 1500-135-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BH
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**6.3**	0.4	ppb	2		04/25/24 1332	04/26/24 1421	JAR

Client Sample ID: 1500-136-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BI
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1424	JAR

Client Sample ID: 1500-137-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BJ
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1427	JAR

Client Sample ID: 1500-138-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BK
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**9.1**	0.4	ppb	2		04/25/24 1332	04/26/24 1430	JAR

Client Sample ID: 1500-139-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BL
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.3**	0.4	ppb	2		04/25/24 1332	04/26/24 1433	JAR

Client Sample ID: 1500-141-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BM
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 1436	JAR

Client Sample ID: 1500-142-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BN
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1439	JAR

Client Sample ID: 1500-143-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BO
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.9**	0.4	ppb	2		04/25/24 1332	04/26/24 1442	JAR

Client Sample ID: 1500-144-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BP
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/25/24 1332	04/26/24 1445	JAR

Client Sample ID: 1500-145-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BQ
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/25/24 1332	04/26/24 1500	JAR

Client Sample ID: 1500-146-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BR
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1509	JAR

Client Sample ID: 1500-147-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BS
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1512	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID: 1500-148-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BT
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1515	JAR

Client Sample ID: 1500-149-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BU
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1518	JAR

Client Sample ID: 1500-150-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BV
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1521	JAR

Client Sample ID: 1500-151-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BW
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1530	JAR

Client Sample ID: 1500-152-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BX
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1533	JAR

Client Sample ID: 1500-153-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BY
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1536	JAR

Client Sample ID: 1500-154-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-BZ
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1539	JAR

Client Sample ID: 1500-155-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CA
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/25/24 1332	04/26/24 1542	JAR

Client Sample ID: 1500-156-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CB
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1545	JAR

Client Sample ID: 1500-157-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CC
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1548	JAR

Client Sample ID: 1500-158-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CD
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1551	JAR

Client Sample ID: 1500-159-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CE
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 1554	JAR

Client Sample ID: 1500-160-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CF
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1557	JAR

Client Sample ID: 1500-161-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CG
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1606	JAR

Client Sample ID: 1500-162-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CH
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1609	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID: 1500-163-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CI
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1612	JAR

Client Sample ID: 1500-164-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CJ
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1332	04/26/24 1615	JAR

Client Sample ID: 1500-165-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CK
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1332	04/26/24 1624	JAR

Client Sample ID: 1500-166-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CL
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/25/24 1332	04/26/24 1633	JAR

Client Sample ID: 1500-167-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CM
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/25/24 1332	04/26/24 1642	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID: 1500-168-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CN
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1645	JAR

Client Sample ID: 1500-169-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CO
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/25/24 1332	04/26/24 1648	JAR

Client Sample ID: 1500-170-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CP
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1651	JAR

Client Sample ID: 1500-171-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CQ
Collected By: Young, Bradly
Collection Date: 04/04/2024 23:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.9**	0.4	ppb	2		04/25/24 1332	04/26/24 1654	JAR

Client Sample ID: 1500-172-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0080-CR
Collected By: Young, Bradly
Collection Date: 04/04/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.9**	0.4	ppb	2		04/25/24 1332	04/26/24 1657	JAR

CERTIFICATE OF ANALYSIS

3HD0080

Client Sample ID:	1500-173-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0080-CS	**Collection Date:**	04/04/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1700	JAR

Client Sample ID:	1500-174-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0080-CT	**Collection Date:**	04/04/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**11.3**	0.4	ppb	2		04/25/24 1332	04/26/24 1703	JAR

Client Sample ID:	1500-175-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0080-CU	**Collection Date:**	04/04/2024

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/25/24 1332	04/26/24 1706	JAR

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
04/29/24 11:49

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Cooler ID: Box
Custody Seal: —
IR Gun # 8
Delivered By: UPS / Fed Ex / Spee Dee / Mail
Walk-in / Via / Courier / Other:_____
Packing material: Bubble/ Foam/ Paper/Other

DW Coding Verified:_____

DW Data to SDWIS: ☐

3HD0080 AXIOM Service Professionals
04/25/24 17:00 Carolyn Jackson DW
$26:
Lead Analysis
1500 South Withers Road A : N S

Sample Receipt Discrepancies: O No O Yes (if Yes, see detail below)

O Container Problems:	O COC Problems
O Label Absent	O Chain of Custody not present
O Incorrect Containers for tests indicated	O Chain of Custody not present: Info obtained from PO or Letter
O Insufficient amount of sample for tests indicated	O COC missing time sampled, time obtained from sample container.
O Broken or leaking containers: _____	O COC missing date sampled, date obtained from sample container
O Air bubbles in VOA vials:_____	O Sample excluded from COC:_____
O Analyses outside of hold: _____	O Sample listed on COC not received: _____
	O Sample description on container different from COC: _____

Detailed Description/comments: 3 Boxes 14.6° ; 15.4° & 15.6°

Client contacted regarding cooler/sample receipt conditions: Yes / No Contacted by_____Date/Time:_____

Who was contacted:_____Remarks: See Comments on Element WO page

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-1-FD	4/4/2024	22:30	Liberty Middle - Sink Tap - 004330-Nurse Office	1	Wt	Grab	X								01
1500-2-FD	4/4/2024	22:30	Liberty Middle - Sink Tap - 004331-Nurse Office-Left Bathroom	1	Wt	Grab	X								02
1500-3-FD	4/4/2024	22:30	Liberty Middle - Sink Tap - 004332-Nurse Office-Right Bathroom	1	Wt	Grab	X								03
1500-4-FD	4/4/2024	22:31	Liberty Middle - Sink Tap - 004333-Lounge	1	Wt	Grab	X								04
1500-5-FD	4/4/2024	22:31	Liberty Middle - Bubbler - 004334-Lounge	1	Wt	Grab	X								05
1500-6-FD	4/4/2024	22:31	Liberty Middle - Sink Tap - 004335-Lounge-Bathroom	1	Wt	Grab	X								06
1500-7-FD	4/4/2024	22:32	Liberty Middle - Sink Tap - 004336-Lounge-Bathroom	1	Wt	Grab	X								07

LAB USE ONLY
Wk Order #: 3HD0080
Short Hold:
Rush:
Temp: oC 14.6/15.4/15.6

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Jue Thompson	4/5/24		
	Time:			Time:		
				10:00		

3 H D 0 0 8 0

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0080	
														Short Hold:	
														Rush:	
														Temp: oC	
1500-8-FD	4/4/2024	22:32	Liberty Middle - Drinking Fountain - 004359B-By Room 100	1	Wt	Grab	X								08
1500-9-FD	4/4/2024	22:33	Liberty Middle - Bottle Filler - 004539F-By Room 100	1	Wt	Grab	X								09
1500-10-FD	4/4/2024	22:33	Liberty Middle - Sink Tap - 004365-By Room 100-Girls-Far Right	1	Wt	Grab	X								10
1500-11-FD	4/4/2024	22:33	Liberty Middle - Sink Tap - 004366-By Room 100-Girls	1	Wt	Grab	X								11
1500-12-FD	4/4/2024	22:33	Liberty Middle - Sink Tap - 004367-By Room 100-Girls	1	Wt	Grab	X								12
1500-13-FD	4/4/2024	22:34	Liberty Middle - Sink Tap - 004368-By Room 100-Girls	1	Wt	Grab	X								13
1500-14-FD	4/4/2024	22:34	Liberty Middle - Sink Tap - 004369-By Room 100-Girls	1	Wt	Grab	X								14

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0080	
														Short Hold:	
														Rush:	
														Temp: oC	
1500-15-FD	4/4/2024	22:34	Liberty Middle - Sink Tap - 004360-By Room 100-Boys-Far Right	1	Wt	Grab	X								15
1500-16-FD	4/4/2024	22:34	Liberty Middle - Sink Tap - 004361-By Room 100-Boys	1	Wt	Grab	X								16
1500-17-FD	4/4/2024	22:34	Liberty Middle - Sink Tap - 004362-By Room 100-Boys	1	Wt	Grab	X								17
1500-18-FD	4/4/2024	22:35	Liberty Middle - Sink Tap - 004363-By Room 100-Boys	1	Wt	Grab	X								18
1500-19-FD	4/4/2024	22:35	Liberty Middle - Sink Tap - 004364-By Room 100-Boys	1	Wt	Grab	X								19
1500-20-FD	4/4/2024	22:35	Liberty Middle - Sink Tap - 003171-Across from 107-By Girls	1	Wt	Grab	X								20
1500-21-FD	4/4/2024	22:35	Liberty Middle - Sink Tap - 003172-Across from 107-Boys	1	Wt	Grab	X								21

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3HD0080
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HD0080	
														Short Hold:	
														Rush:	
														Temp: oC	
1500-22-FD	4/4/2024	22:36	Liberty Middle - Sink Tap - 004470-Room 101	1	Wt	Grab	X								22
1500-23-FD	4/4/2024	22:36	Liberty Middle - Bubbler - 004471-Room 101	1	Wt	Grab	X								23
1500-24-FD	4/4/2024	22:36	Liberty Middle - Sink Tap - 004472-Room 102	1	Wt	Grab	X								24
1500-25-FD	4/4/2024	22:36	Liberty Middle - Bubbler - 004473-Room 102	1	Wt	Grab	X								25
1500-26-FD	4/4/2024	22:37	Liberty Middle - Sink Tap - 004468-Room 103	1	Wt	Grab	X								26
1500-27-FD	4/4/2024	22:37	Liberty Middle - Sink Tap - 004469-Room 103	1	Wt	Grab	X								27
1500-28-FD	4/4/2024	22:38	Liberty Middle - Sink Tap - 004458-Room 106	1	Wt	Grab	X								28

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				0000		

3HD0080
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0080	
														Short Hold:	
														Rush:	
														Temp: oC	
1500-30-FD	4/4/2024	22:38	Liberty Middle - Sink Tap - 004456-Room 107	1	Wt	Grab	X								29
1500-31-FD	4/4/2024	22:38	Liberty Middle - Bubbler - 004457-Room 107	1	Wt	Grab	X								30
1500-32-FD	4/4/2024	22:39	Liberty Middle - Sink Tap - 004454-Room 108	1	Wt	Grab	X								31
1500-33-FD	4/4/2024	22:39	Liberty Middle - Bubbler - 004455-Room 108	1	Wt	Grab	X								32
1500-34-FD	4/4/2024	22:39	Liberty Middle - Sink Tap - 004452-Room 109	1	Wt	Grab	X								33
1500-35-FD	4/4/2024	22:40	Liberty Middle - Bubbler - 004453-Room 109	1	Wt	Grab	X								34
1500-36-FD	4/4/2024	22:41	Liberty Middle - Sink Tap - 004442-Room 111	1	Wt	Grab	X								35

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date: 4/5/24		
	Time:		Sue Thompson	Time: 1000		

3HD00080
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-37-FD	4/4/2024	22:41	Liberty Middle - Bubbler - 004443-Room 111	1	Wt	Grab	X								36
1500-38-FD	4/4/2024	22:42	Liberty Middle - Sink Tap - 004440-Room 113	1	Wt	Grab	X								37
1500-39-FD	4/4/2024	22:42	Liberty Middle - Bubbler - 004441-Room 113	1	Wt	Grab	X								38
1500-40-FD	4/4/2024	22:42	Liberty Middle - Sink Tap - 004438-Room 114	1	Wt	Grab	X								39
1500-41-FD	4/4/2024	22:42	Liberty Middle - Bubbler - 004439-Room 114	1	Wt	Grab	X								40
1500-42-FD	4/4/2024	22:44	Liberty Middle - Sink Tap - 003178-Room 403	1	Wt	Grab	X								41
1500-43-FD	4/4/2024	22:44	Liberty Middle - Bubbler - 003179-Room 403	1	Wt	Grab	X								42

LAB USE ONLY
Wk Order #: 3HD0080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
	Time:		Sue Thompson	Time:	1000	

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HD0080
														Short Hold:	
														Rush:	
														Temp: oC	
1500-44-FD	4/4/2024	22:45	Liberty Middle - Sink Tap - 003176-Room 402	1	Wt	Grab	X								43
1500-45-FD	4/4/2024	22:45	Liberty Middle - Bubbler - 003177-Room 402	1	Wt	Grab	X								44
1500-46-FD	4/4/2024	22:46	Liberty Middle - Sink Tap - 003174-Room 401	1	Wt	Grab	X								45
1500-47-FD	4/4/2024	22:46	Liberty Middle - Bubbler - 003175-Room 401	1	Wt	Grab	X								46
1500-48-FD	4/4/2024	22:48	Liberty Middle - Sink Tap - 004349-By Room 300-Girls-Far Right	1	Wt	Grab	X								47
1500-49-FD	4/4/2024	22:48	Liberty Middle - Sink Tap - 004350-By Room 300-Girls	1	Wt	Grab	X								48
1500-50-FD	4/4/2024	22:48	Liberty Middle - Sink Tap - 004351-By Room 300-Girls	1	Wt	Grab	X								49

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Steve Thompson	4/5/24		
	Time:			Time:		
				1000		

3HD0080
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-51-FD	4/4/2024	22:49	Liberty Middle - Sink Tap - 004352-By Room 300-Girls	1	Wt	Grab	X								S0
1500-52-FD	4/4/2024	22:49	Liberty Middle - Sink Tap - 004353-By Room 300-Girls	1	Wt	Grab	X								S1
1500-53-FD	4/4/2024	22:49	Liberty Middle - Drinking Fountain - 004348-By 300	1	Wt	Grab	X								S2
1500-54-FD	4/4/2024	22:49	Liberty Middle - Bottle Filler - 004348-By 300	1	Wt	Grab	X								S3
1500-55-FD	4/4/2024	22:50	Liberty Middle - Sink Tap - 004354-By 300-Boys-Far Right	1	Wt	Grab	X								S4
1500-56-FD	4/4/2024	22:50	Liberty Middle - Sink Tap - 004355-By 300-Boys	1	Wt	Grab	X								S5
1500-57-FD	4/4/2024	22:50	Liberty Middle - Sink Tap - 004356-By 300-Boys	1	Wt	Grab	X								S6

LAB USE ONLY
Wk Order #: 3HD0080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Susie Thompson	Time:	800	
	Time:					

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HD00080
														Short Hold:	
														Rush:	
														Temp: oC	
1500-58-FD	4/4/2024	22:51	Liberty Middle - Sink Tap - 004357-By 300-Boys	1	Wt	Grab	X								57
1500-59-FD	4/4/2024	22:51	Liberty Middle - Sink Tap - 004358-By 300-Boys	1	Wt	Grab	X								58
1500-60-FD	4/4/2024	22:51	Liberty Middle - Sink Tap - 003121-By 403-Bathroom	1	Wt	Grab	X								59
1500-61-FD	4/4/2024	22:51	Liberty Middle - Sink Tap - 003180-By 403-Bathroom	1	Wt	Grab	X								60
1500-62-FD	4/4/2024	22:52	Liberty Middle - Sink Tap - 004437-Room 302	1	Wt	Grab	X								61
1500-63-FD	4/4/2024	22:53	Liberty Middle - Bubbler - 004438-Room 302	1	Wt	Grab	X								62
1500-64-FD	4/4/2024	22:53	Liberty Middle - Sink Tap - 004434-Room 301	1	Wt	Grab	X								63

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	

3HD00080
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-65-FD	4/4/2024	22:54	Liberty Middle - Bubbler - 004435-Room 301	1	Wt	Grab	X								64
1500-66-FD	4/4/2024	22:54	Liberty Middle - Sink Tap - 004432-Room 303	1	Wt	Grab	X								65
1500-67-FD	4/4/2024	22:54	Liberty Middle - Bubbler - 004433-Room 303	1	Wt	Grab	X								66
1500-68-FD	4/4/2024	22:56	Liberty Middle - Sink Tap - 004422-Room 312	1	Wt	Grab	X								67
1500-69-FD	4/4/2024	22:56	Liberty Middle - Bubbler - 004423-Room 312	1	Wt	Grab	X								68
1500-70-FD	4/4/2024	22:57	Liberty Middle - Sink Tap - 004420-Room 313	1	Wt	Grab	X								69
1500-71-FD	4/4/2024	22:57	Liberty Middle - Bubbler - 004421-Room 313	1	Wt	Grab	X								70

LAB USE ONLY
Wk Order #: 3HD0080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-72-FD	4/4/2024	22:58	Liberty Middle - Sink Tap - 004418-Room 314	1	Wt	Grab	X								71
1500-73-FD	4/4/2024	22:58	Liberty Middle - Bubbler - 004419-Room 314	1	Wt	Grab	X								72
1500-74-FD	4/4/2024	23:02	Liberty Middle - Sink Tap - 004416-Room 214	1	Wt	Grab	X								73
1500-75-FD	4/4/2024	23:02	Liberty Middle - Bubbler - 004417-Room 214	1	Wt	Grab	X								74
1500-76-FD	4/4/2024	23:03	Liberty Middle - Sink Tap - 004414-Room 213	1	Wt	Grab	X								75
1500-77-FD	4/4/2024	23:03	Liberty Middle - Bubbler - 004415-Room 213	1	Wt	Grab	X								76
1500-78-FD	4/4/2024	23:04	Liberty Middle - Sink Tap - 004412-Room 211	1	Wt	Grab	X								77

LAB USE ONLY
Wk Order #: 3H70080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-79-FD	4/4/2024	23:04	Liberty Middle - Bubbler - 004412-Room 211	1	Wt	Grab	X								78
1500-80-FD	4/4/2024	23:05	Liberty Middle - Sink Tap - 004402-Room 209	1	Wt	Grab	X								79
1500-81-FD	4/4/2024	23:05	Liberty Middle - Bubbler - 004403-Room 209	1	Wt	Grab	X								80
1500-82-FD	4/4/2024	23:06	Liberty Middle - Sink Tap - 004401-Room 208	1	Wt	Grab	X								81
1500-83-FD	4/4/2024	23:06	Liberty Middle - Bubbler - 004600-Room 208	1	Wt	Grab	X								82
1500-84-FD	4/4/2024	23:07	Liberty Middle - Sink Tap - 004598-Room 207	1	Wt	Grab	X								83
1500-85-FD	4/4/2024	23:07	Liberty Middle - Bubbler - 004599-Room 207	1	Wt	Grab	X								84

LAB USE ONLY
Wk Order #: 3HD00080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date: 4/5/24		
			Steve Thompson	Time: 1000		
	Time:					

3 H D 0 0 0 8 0

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-86-FD	4/4/2024	23:08	Liberty Middle - Sink Tap - 004596-Room 206	1	Wt	Grab	X								85
1500-87-FD	4/4/2024	23:08	Liberty Middle - Bubbler - 004597-Room 206	1	Wt	Grab	X								86
1500-88-FD	4/4/2024	23:11	Liberty Middle - Sink Tap - 004586-Room 203	1	Wt	Grab	X								87
1500-89-FD	4/4/2024	23:11	Liberty Middle - Bubbler - 004587-Room 203	1	Wt	Grab	X								88
1500-90-FD	4/4/2024	23:12	Liberty Middle - Sink Tap - 004584-Room 201	1	Wt	Grab	X								89
1500-91-FD	4/4/2024	23:12	Liberty Middle - Bubbler - 004585-Room 201	1	Wt	Grab	X								90
1500-92-FD	4/4/2024	23:13	Liberty Middle - Sink Tap - 004582-Room 202	1	Wt	Grab	X								91

LAB USE ONLY
Wk Order #: 3HD00080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	
	Time:					

3 H D 0 0 8 0

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-93-FD	4/4/2024	23:13	Liberty Middle - Bubbler - 004583-Room 202	1	Wt	Grab	X								92
1500-94-FD	4/4/2024	23:16	Liberty Middle - Sink Tap - 004338-By 200-Boys-Far Right	1	Wt	Grab	X								93
1500-95-FD	4/4/2024	23:16	Liberty Middle - Sink Tap - 004439-By 200-Boys	1	Wt	Grab	X								94
1500-96-FD	4/4/2024	23:16	Liberty Middle - Sink Tap - 004340-By 200-Boys	1	Wt	Grab	X								95
1500-97-FD	4/4/2024	23:17	Liberty Middle - Sink Tap - 004341-By 200-Boys	1	Wt	Grab	X								96
1500-98-FD	4/4/2024	23:17	Liberty Middle - Sink Tap - 004342-By 200-Boys	1	Wt	Grab	X								97
1500-99-FD	4/4/2024	23:17	Liberty Middle - Sink Tap - 003173-By Room 208-Bathroom	1	Wt	Grab	X								98

LAB USE ONLY: Wk Order #: 3HD0080; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3HD0080
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0080	
														Short Hold:	
														Rush:	
														Temp: oC	
1500-100-FD	4/4/2024	23:18	Liberty Middle - Drinking Fountain - 004337-By 200	1	Wt	Grab	X								99
1500-101-FD	4/4/2024	23:18	Liberty Middle - Bottle Filler - 004337-By 200	1	Wt	Grab	X								AA
1500-102-FD	4/4/2024	23:18	Liberty Middle - Sink Tap - 004343-By 200–Girls-Far Right	1	Wt	Grab	X								AB
1500-103-FD	4/4/2024	23:18	Liberty Middle - Sink Tap - 004344-By 200-Girls	1	Wt	Grab	X								AC
1500-104-FD	4/4/2024	23:19	Liberty Middle - Sink Tap - 004345-By 200-Girls	1	Wt	Grab	X								AD
1500-105-FD	4/4/2024	23:19	Liberty Middle - Sink Tap - 004346-By 200-Girls	1	Wt	Grab	X								AE
1500-106-FD	4/4/2024	23:19	Liberty Middle - Sink Tap - 004347-By 200-Girls	1	Wt	Grab	X								AF

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-107-FD	4/4/2024	23:22	Liberty Middle - Ice Machine - 000637-L-Kitchen	1	Wt	Grab	X								AG
1500-108-FD	4/4/2024	23:22	Liberty Middle - Steam Kettle - 000814-L-Kitchen	1	Wt	Grab	X								AH
1500-109-FD	4/4/2024	23:22	Liberty Middle - Sink Tap - 003184-Kitchen-By Ice Machine	1	Wt	Grab	X								AI
1500-110-FD	4/4/2024	23:23	Liberty Middle - Sink Tap - 003183-Kitchen-Bathroom	1	Wt	Grab	X								AJ
1500-111-FD	4/4/2024	23:23	Liberty Middle - Sink Tap - 003186-Kitchen-By Ovens	1	Wt	Grab	X								AK
1500-112-FD	4/4/2024	23:23	Liberty Middle - Sink Tap - 003187-Kitchen-By Mixer	1	Wt	Grab	X								AL
1500-113-FD	4/4/2024	23:24	Liberty Middle - Sink Tap - 003188-Kitchen-By Freezer	1	Wt	Grab	X								AM

LAB USE ONLY: Wk Order #: 3HD0080; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Steve Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-114-FD	4/4/2024	23:24	Liberty Middle - Sink Tap - 003189-Kitchen-By Mixer	1	Wt	Grab	X								AN
1500-115-FD	4/4/2024	23:25	Liberty Middle - Sink Tap - 003190-Kitchen	1	Wt	Grab	X								AO
1500-116-FD	4/4/2024	23:25	Liberty Middle - Sink Tap - 003191-Kitchen	1	Wt	Grab	X								AP
1500-117-FD	4/4/2024	23:25	Liberty Middle - Sink Tap - 003192-Kitchen-Handwashing-Dish Area	1	Wt	Grab	X								AQ
1500-118-FD	4/4/2024	23:26	Liberty Middle - Sink Tap - 003193-Kitchen	1	Wt	Grab	X								AR
1500-119-FD	4/4/2024	23:26	Liberty Middle - Sink Tap - 003194-Kitchen	1	Wt	Grab	X								AS
1500-120-FD	4/4/2024	23:26	Liberty Middle - Sink Tap - 003195-Kitchen	1	Wt	Grab	X								AT

LAB USE ONLY
Wk Order #: 3HD00080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Steve Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HD0080
														Short Hold:	
														Rush:	
														Temp: oC	
1500-121-FD	4/4/2024	23:27	Liberty Middle - Sink Tap - 003196-Kitchen	1	Wt	Grab	X								AU
1500-122-FD	4/4/2024	23:27	Liberty Middle - Sink Tap - 003197-Kitchen	1	Wt	Grab	X								AV
1500-123-FD	4/4/2024	23:27	Liberty Middle - Sink Tap - 003198-Kitchen-Dish Area-Sprayer	1	Wt	Grab	X								AW
1500-124-FD	4/4/2024	23:30	Liberty Middle - Drinking Fountain - 004310-Gym	1	Wt	Grab	X								AX
1500-125-FD	4/4/2024	23:30	Liberty Middle - Bottle Filler - 004310-Gym	1	Wt	Grab	X								AY
1500-126-FD	4/4/2024	23:30	Liberty Middle - Drinking Fountain - 004311-Gym	1	Wt	Grab	X								AZ
1500-127-FD	4/4/2024	23:30	Liberty Middle - Bottle Filler - 004311-Gym	1	Wt	Grab	X								BA

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	
	Time:					

3HD0080
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-128-FD	4/4/2024	23:32	Liberty Middle - Sink Tap - 004309-Gym Office-Boys	1	Wt	Grab	X								BB
1500-129-FD	4/4/2024	23:32	Liberty Middle - Sink Tap - 004312-Boys Lockers-	1	Wt	Grab	X								BC
1500-130-FD	4/4/2024	23:32	Liberty Middle - Sink Tap - 004313-Boys Lockers	1	Wt	Grab	X								BD
1500-131-FD	4/4/2024	23:33	Liberty Middle - Sink Tap - 004314-Boys Lockers	1	Wt	Grab	X								BE
1500-133-FD	4/4/2024	23:33	Liberty Middle - Sink Tap - 004316-Boys Lockers-	1	Wt	Grab	X								BF
1500-134-FD	4/4/2024	23:33	Liberty Middle - Sink Tap - 004317-Boys Lockers	1	Wt	Grab	X								BG
1500-135-FD	4/4/2024	23:34	Liberty Middle - Sink Tap - 004304-Girls Lockers-	1	Wt	Grab	X								BH

LAB USE ONLY
Wk Order #: 3HD0080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson			
	Time:			Time:	1000	

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0080	
														Short Hold:	
														Rush:	
														Temp: oC	
1500-136-FD	4/4/2024	23:34	Liberty Middle - Sink Tap - 004303-Girls Lockers-	1	Wt	Grab	X								BI
1500-137-FD	4/4/2024	23:34	Liberty Middle - Sink Tap - 003199-Girls Lockers-	1	Wt	Grab	X								BJ
1500-138-FD	4/4/2024	23:34	Liberty Middle - Sink Tap - 004302-Girls Lockers	1	Wt	Grab	X								BK
1500-139-FD	4/4/2024	23:35	Liberty Middle - Sink Tap - 004301-Girls Lockers	1	Wt	Grab	X								BL
1500-141-FD	4/4/2024	23:35	Liberty Middle - Sink Tap - 004308-Gym Office-Girls	1	Wt	Grab	X								BM
1500-142-FD	4/4/2024	23:36	Liberty Middle - Sink Tap - 004305-Room 604	1	Wt	Grab	X								BN
1500-143-FD	4/4/2024	23:36	Liberty Middle - Bubbler - 004306-Room 604	1	Wt	Grab	X								BO

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0080	
														Short Hold:	
														Rush:	
														Temp: oC	
1500-144-FD	4/4/2024	23:36	Liberty Middle - Drinking Fountain - 004307B-Weight Room	1	Wt	Grab	X								BP
1500-145-FD	4/4/2024	23:37	Liberty Middle - Bubbler - 004307F-Weight Room	1	Wt	Grab	X								BQ
1500-146-FD	4/4/2024	23:40	Liberty Middle - Sink Tap - 004318-By 500-Boys-Far Right	1	Wt	Grab	X								BR
1500-147-FD	4/4/2024	23:40	Liberty Middle - Sink Tap - 004319-By 500-Boys	1	Wt	Grab	X								BS
1500-148-FD	4/4/2024	23:40	Liberty Middle - Sink Tap - 004320-By 500-Boys	1	Wt	Grab	X								BT
1500-149-FD	4/4/2024	23:41	Liberty Middle - Sink Tap - 004321-By 500-Boys	1	Wt	Grab	X								BU
1500-150-FD	4/4/2024	23:41	Liberty Middle - Sink Tap - 004322-By 500-Boys	1	Wt	Grab	X								BV

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	
	Time:					

3HD0080
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-151-FD	4/4/2024	23:41	Liberty Middle - Bottle Filler - 004328-By 500	1	Wt	Grab	X								BW
1500-152-FD	4/4/2024	23:41	Liberty Middle - Drinking Fountain - 004329-By 500	1	Wt	Grab	X								BX
1500-153-FD	4/4/2024	23:42	Liberty Middle - Sink Tap - 004323-By Room 500-Girls-Far Left	1	Wt	Grab	X								BY
1500-154-FD	4/4/2024	23:42	Liberty Middle - Sink Tap - 004324-By 500-Girls	1	Wt	Grab	X								BZ
1500-155-FD	4/4/2024	23:42	Liberty Middle - Sink Tap - 004325-By 500-Girls	1	Wt	Grab	X								CBA
1500-156-FD	4/4/2024	23:42	Liberty Middle - Sink Tap - 004326-By 500-Girls	1	Wt	Grab	X								CBB
1500-157-FD	4/4/2024	23:42	Liberty Middle - Sink Tap - 004327-By 500-Girls	1	Wt	Grab	X								CBC

LAB USE ONLY
Wk Order #: 3HD00080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3 H D 0 0 0 8 0
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HD0080	
														Short Hold:	
														Rush:	
														Temp: oC	
1500-158-FD	4/4/2024	23:44	Liberty Middle - Sink Tap - 004499-Room 506	1	Wt	Grab	X								CD
1500-159-FD	4/4/2024	23:44	Liberty Middle - Sink Tap - 004500-Room 506	1	Wt	Grab	X								CE
1500-160-FD	4/4/2024	23:45	Liberty Middle - Sink Tap - 004492-Room 505	1	Wt	Grab	X								CF
1500-161-FD	4/4/2024	23:45	Liberty Middle - Sink Tap - 004494-Room 505	1	Wt	Grab	X								CG
1500-162-FD	4/4/2024	23:45	Liberty Middle - Sink Tap - 004496-Room 505	1	Wt	Grab	X								CH
1500-163-FD	4/4/2024	23:47	Liberty Middle - Sink Tap - 004480/81-Room 504	1	Wt	Grab	X								CI
1500-164-FD	4/4/2024	23:47	Liberty Middle - Sink Tap - 004482/83-Room 504	1	Wt	Grab	X								CJ

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3HD0080
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-165-FD	4/4/2024	23:47	Liberty Middle - Sink Tap - 004484/85-Room 504	1	Wt	Grab	X								CK
1500-166-FD	4/4/2024	23:48	Liberty Middle - Sink Tap - 004486/87-Room 504	1	Wt	Grab	X								CL
1500-167-FD	4/4/2024	23:48	Liberty Middle - Sink Tap - 004488/89-Room 504	1	Wt	Grab	X								CM
1500-168-FD	4/4/2024	23:48	Liberty Middle - Sink Tap - 004490/91-Room 504	1	Wt	Grab	X								CN
1500-169-FD	4/4/2024	23:50	Liberty Middle - Sink Tap - 004474-Room 502	1	Wt	Grab	X								CO
1500-170-FD	4/4/2024	23:50	Liberty Middle - Bubbler - 004475-Room 502	1	Wt	Grab	X								CP
1500-171-FD	4/4/2024	23:50	Liberty Middle - Sink Tap - 004476-Room 502	1	Wt	Grab	X								CQ

LAB USE ONLY
Wk Order #: 3HD00080
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	
	Time:					

3 H D 0 0 0 8 0

AXIOM Service Professionals

PM: Carolyn Jackson

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HE0031

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: Liberty Middle School

Project / PO Number: Liberty Middle School
Received: 05/02/2024
Reported: 05/10/2024

Work Order Special Information

Young, Bradly
Liberty Middle School

Analytical Testing Parameters

Client Sample ID: 1500-29-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0031-01
Collected By: Young, Bradly
Collection Date: 04/30/2024 22:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.9**	0.4	ppb	2		05/07/24 1516	05/09/24 0217	RVV

Client Sample ID: 1500-132-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0031-02
Collected By: Young, Bradly
Collection Date: 04/30/2024 22:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**7.5**	0.4	ppb	2		05/07/24 1516	05/09/24 0223	RVV

Client Sample ID: 1500-140-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0031-03
Collected By: Young, Bradly
Collection Date: 04/30/2024 22:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.0**	0.4	ppb	2		05/07/24 1516	05/09/24 0229	RVV

Definitions

RL: Reporting Limit

CERTIFICATE OF ANALYSIS

3HE0031

Report Comments

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
05/10/24 13:18

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1500 South Withers Road	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1500-29-FD	4/30/2024	22:41	Liberty Middle School - Bubbler - 004459-Room 106	1	Wt	Grab	X								3HE0031-01
1500-132-FD	4/30/2024	22:43	Liberty Middle School - Sink Tap - 004315-Boys Locker Room	1	Wt	Grab	X								02
1500-140-FD	4/30/2024	22:44	Liberty Middle School - Sink Tap - 003200-Girls Locker Room	1	Wt	Grab	X								03

LAB USE ONLY
Wk Order #: 3HE0031
Short Hold:
Rush:
Temp: oC 20.0

3 H E 0 0 3 1

AXIOM Service Professionals
PM: Carolyn Jackson

Relinquied by: (Signature)	Date:	Time:	Received by: (Signature)	Date:	Time:
Bradly Young	~~4/#/2024~~ 5/2/24				
Relinquied by: (Signature)	Date:	Time:	Received by: (Signature)	Date:	Time:
			Carolyn Jackson	05/02/24	12:00

Appendix D
Photo Log



4/4/2024 - 1500-1 - Liberty Middle School - 004330-Nurse's Office



4/4/2024 - 1500-2 - Liberty Middle School - 004331-Nurse's Office-Left Restroom



4/4/2024 - 1500-3 - Liberty Middle School - 004332-Nurse's Office-Right Restroom



4/4/2024 - 1500-4 - Liberty Middle School - 004333-Lounge



4/4/2024 - 1500-5 - Liberty Middle School - 004334-Lounge



4/4/2024 - 1500-6 - Liberty Middle School - 004335-Lounge-Restroom



4/4/2024 - 1500-7 - Liberty Middle School - 004336-Lounge-Restroom



4/4/2024 - 1500-8 - Liberty Middle School - 004359B-By Room 100



4/4/2024 - 1500-9 - Liberty Middle School - 004539F-By Room 100



4/4/2024 - 1500-10 - Liberty Middle School - 004365-By Room 100-Girls-Far Right



4/4/2024 - 1500-11 - Liberty Middle School - 004366-By Room 100-Girls



4/4/2024 - 1500-12 - Liberty Middle School - 004367-By Room 100-Girls



4/4/2024 - 1500-13 - Liberty Middle School - 004368-By Room 100-Girls



4/4/2024 - 1500-14 - Liberty Middle School - 004369-By Room 100-Girls



4/4/2024 - 1500-15 - Liberty Middle School - 004360-By Room 100-Boys-Far Right



4/4/2024 - 1500-16 - Liberty Middle School - 004361-By Room 100-Boys



4/4/2024 - 1500-17 - Liberty Middle School - 004362-By Room 100-Boys



4/4/2024 - 1500-18 - Liberty Middle School - 004363-By Room 100-Boys



4/4/2024 - 1500-19 - Liberty Middle School - 004364-By Room 100-Boys



4/4/2024 - 1500-20 - Liberty Middle School - 003171-Across from 107-By Girls



4/4/2024 - 1500-21 - Liberty Middle School - 003172-Across from 107-Boys



4/4/2024 - 1500-22 - Liberty Middle School - 004470-Room 101



4/4/2024 - 1500-23 - Liberty Middle School - 004471-Room 101



4/4/2024 - 1500-24 - Liberty Middle School - 004472-Room 102



4/4/2024 - 1500-25 - Liberty Middle School - 004473-Room 102



4/4/2024 - 1500-26 - Liberty Middle School - 004468-Room 103



4/4/2024 - 1500-27 - Liberty Middle School - 004469-Room 103



4/4/2024 - 1500-28 - Liberty Middle School - 004458-Room 106



4/4/2024 - 1500-29 - Liberty Middle School - 004459-Room 106 - Out of Order



4/4/2024 - 1500-30 - Liberty Middle School - 004456-Room 107



4/4/2024 - 1500-31 - Liberty Middle School - 004457-Room 107



4/4/2024 - 1500-32 - Liberty Middle School - 004454-Room 108



4/4/2024 - 1500-33 - Liberty Middle School - 004455-Room 108



4/4/2024 - 1500-34 - Liberty Middle School - 004452-Room 109



4/4/2024 - 1500-35 - Liberty Middle School - 004453-Room 109



4/4/2024 - 1500-36 - Liberty Middle School - 004442-Room 111




4/4/2024 - 1500-37 - Liberty Middle School - 004443-Room 111



4/4/2024 - 1500-38 - Liberty Middle School - 004440-Room 113



4/4/2024 - 1500-39 - Liberty Middle School - 004441-Room 113

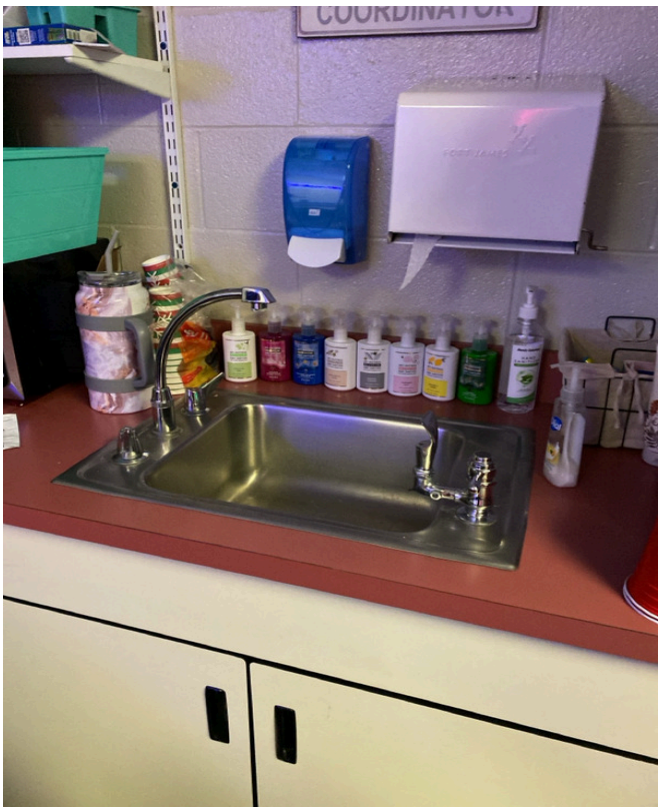

4/4/2024 - 1500-40 - Liberty Middle School - 004438-Room 114




4/4/2024 - 1500-41 - Liberty Middle School - 004439-Room 114




4/4/2024 - 1500-42 - Liberty Middle School - 003178-Room 403




4/4/2024 - 1500-43 - Liberty Middle School - 003179-Room 403

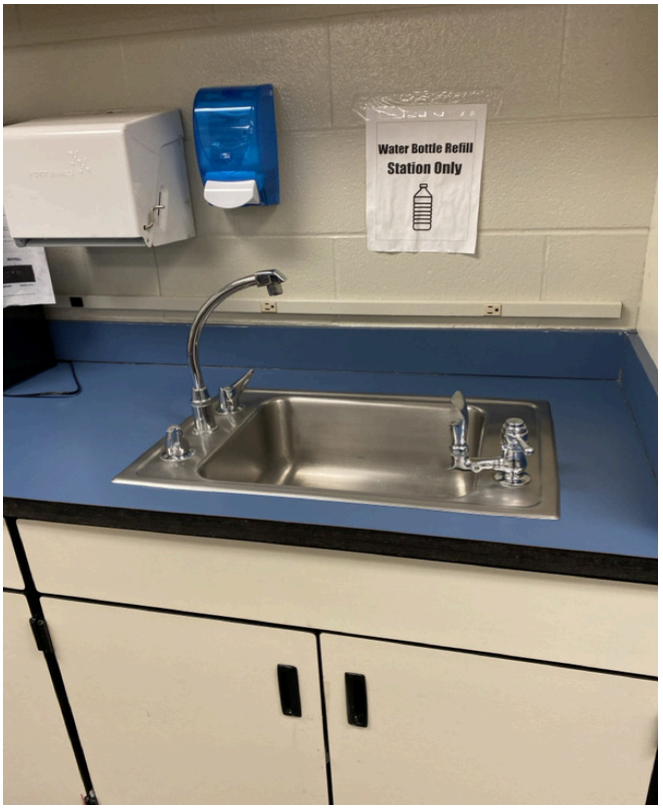

4/4/2024 - 1500-44 - Liberty Middle School - 003176-Room 402

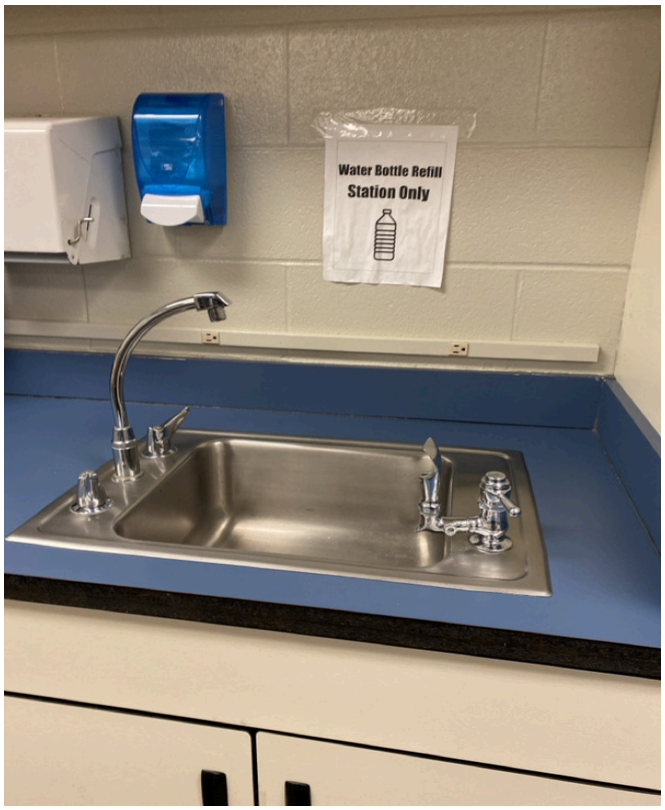

4/4/2024 - 1500-45 - Liberty Middle School - 003177-Room 402

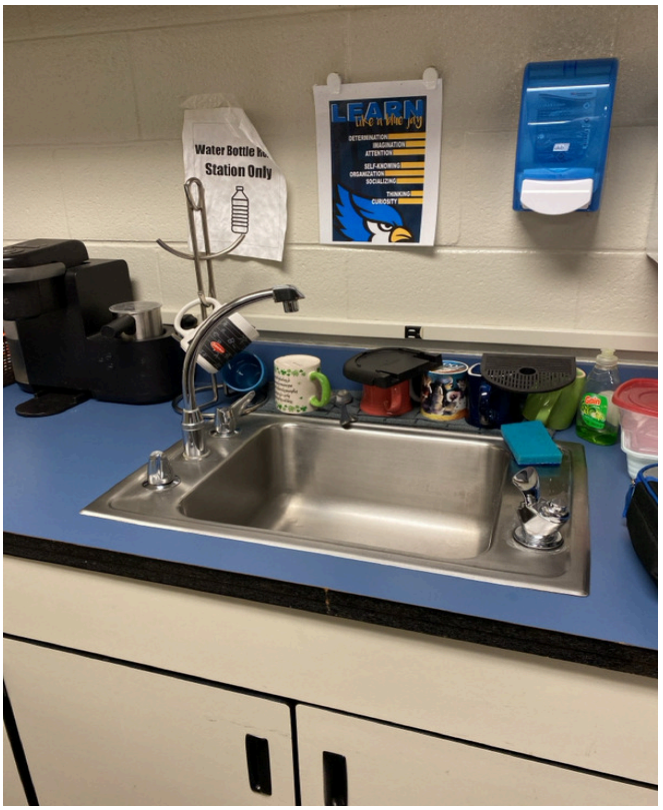


4/4/2024 - 1500-46 - Liberty Middle School - 003174-Room 401




4/4/2024 - 1500-47 - Liberty Middle School - 003175-Room 401




4/4/2024 - 1500-48 - Liberty Middle School - 004349-By Room 300-Girls-Far Right

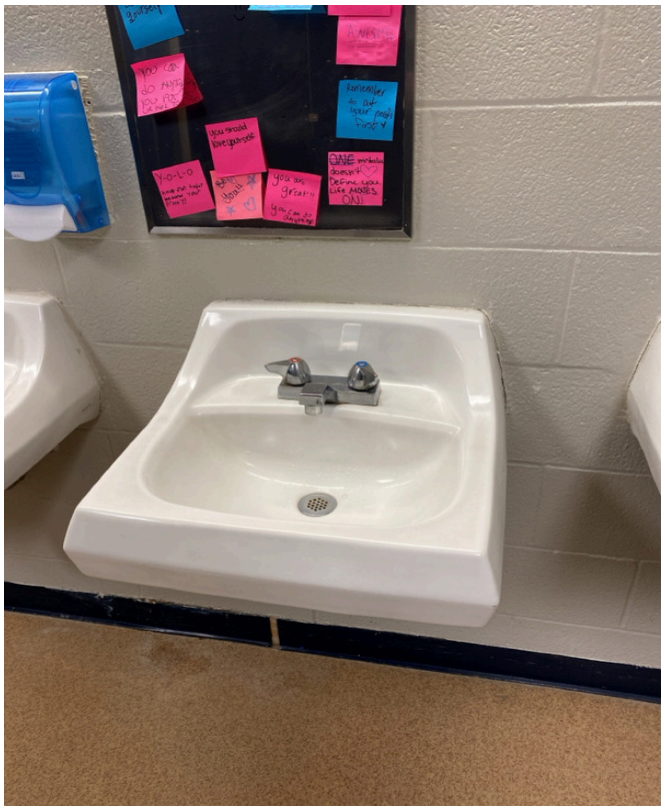


4/4/2024 - 1500-49 - Liberty Middle School - 004350-By Room 300-Girls

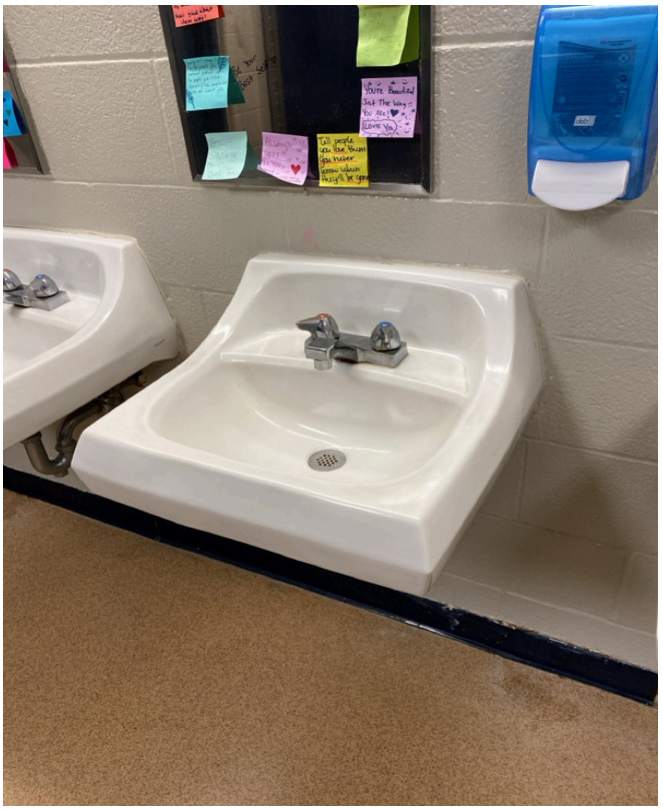

4/4/2024 - 1500-50 - Liberty Middle School - 004351-By Room 300-Girls

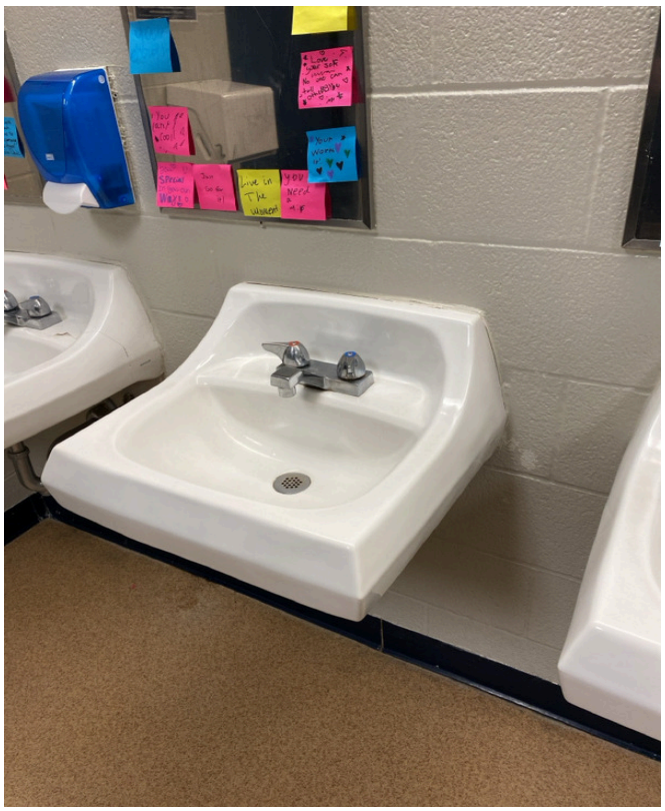

4/4/2024 - 1500-51 - Liberty Middle School - 004352-By Room 300-Girls

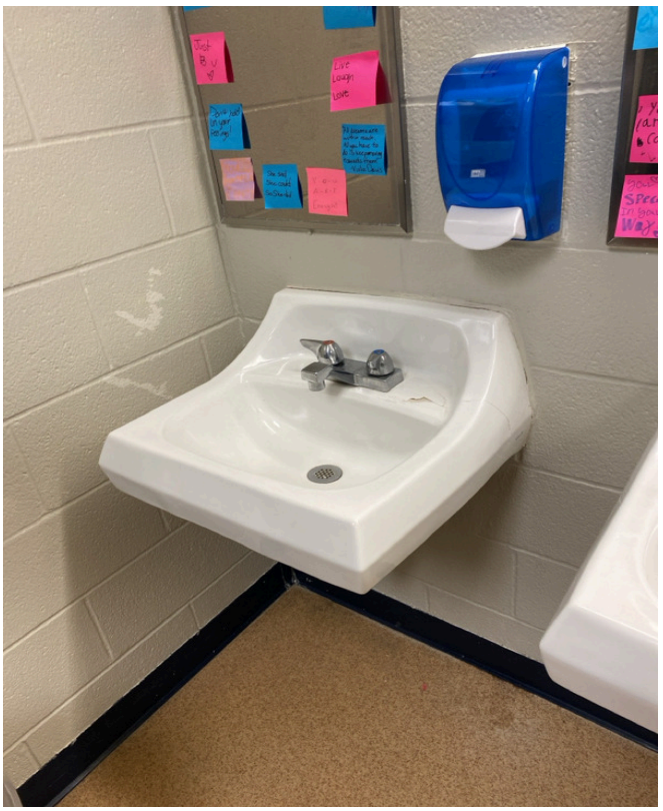

4/4/2024 - 1500-52 - Liberty Middle School - 004353-By Room 300-Girls



4/4/2024 - 1500-53 - Liberty Middle School - 004348-By 300



4/4/2024 - 1500-54 - Liberty Middle School - 004348-By 300



4/4/2024 - 1500-55 - Liberty Middle School - 004354-By 300-Boys-Far Right



4/4/2024 - 1500-56 - Liberty Middle School - 004355-By 300-Boys



4/4/2024 - 1500-57 - Liberty Middle School - 004356-By 300-Boys



4/4/2024 - 1500-58 - Liberty Middle School - 004357-By 300-Boys




4/4/2024 - 1500-59 - Liberty Middle School - 004358-By 300-Boys



4/4/2024 - 1500-60 - Liberty Middle School - 003121-By 403-Restroom



4/4/2024 - 1500-61 - Liberty Middle School - 003180-By 403-Restroom

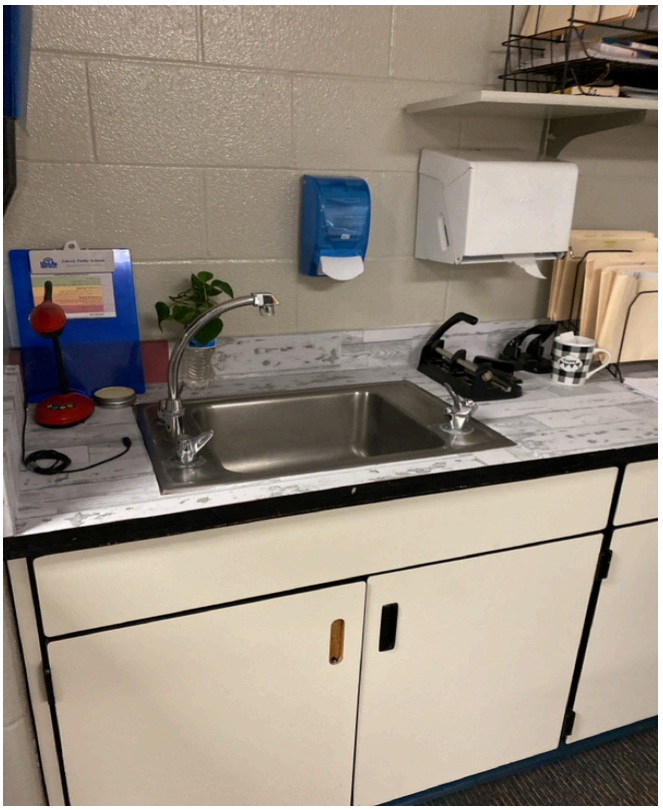

4/4/2024 - 1500-62 - Liberty Middle School - 004437-Room 302



4/4/2024 - 1500-63 - Liberty Middle School - 004438-Room 302



4/4/2024 - 1500-64 - Liberty Middle School - 004434-Room 301



4/4/2024 - 1500-65 - Liberty Middle School - 004435-Room 301



4/4/2024 - 1500-66 - Liberty Middle School - 004432-Room 303



4/4/2024 - 1500-67 - Liberty Middle School - 004433-Room 303



4/4/2024 - 1500-68 - Liberty Middle School - 004422-Room 312




4/4/2024 - 1500-69 - Liberty Middle School - 004423-Room 312




4/4/2024 - 1500-70 - Liberty Middle School - 004420-Room 313



4/4/2024 - 1500-71 - Liberty Middle School - 004421-Room 313

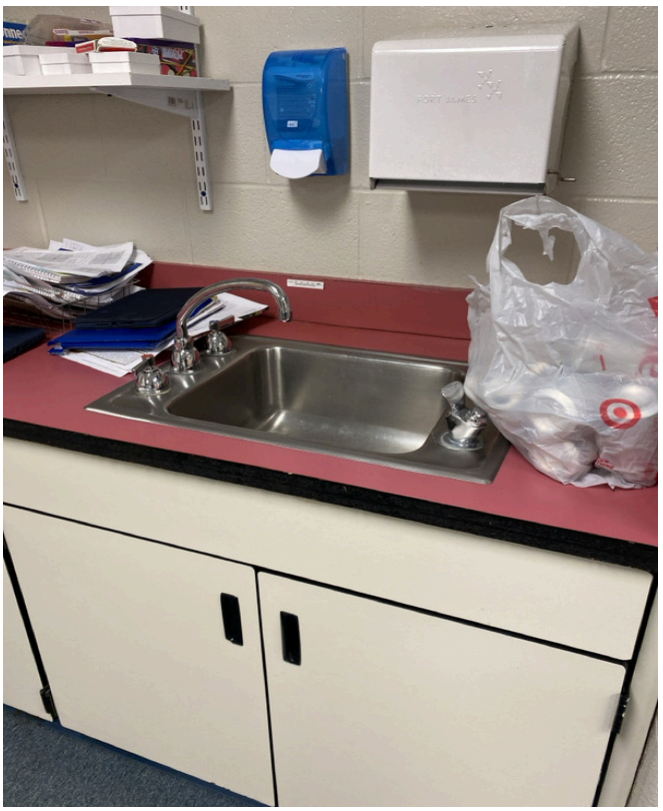


4/4/2024 - 1500-72 - Liberty Middle School - 004418-Room 314

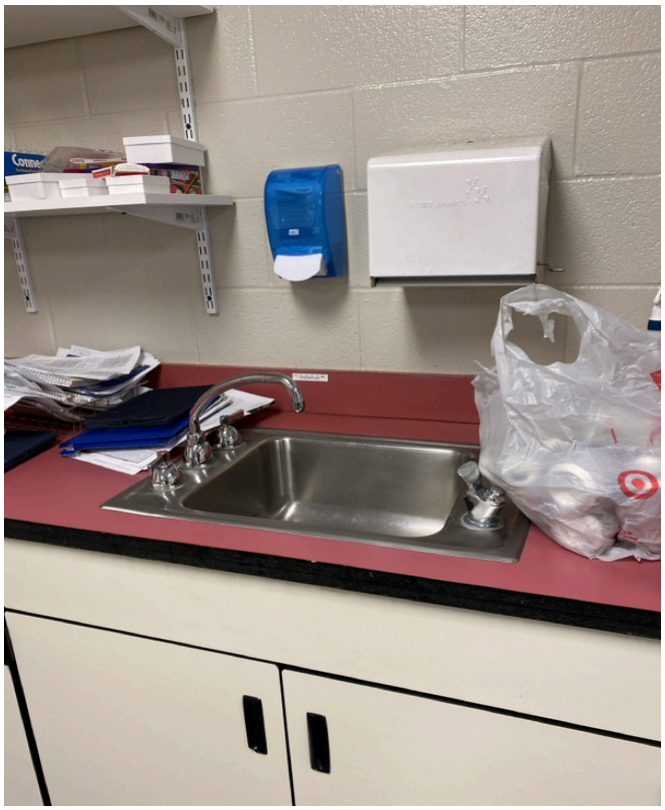

4/4/2024 - 1500-73 - Liberty Middle School - 004419-Room 314



4/4/2024 - 1500-74 - Liberty Middle School - 004416-Room 214

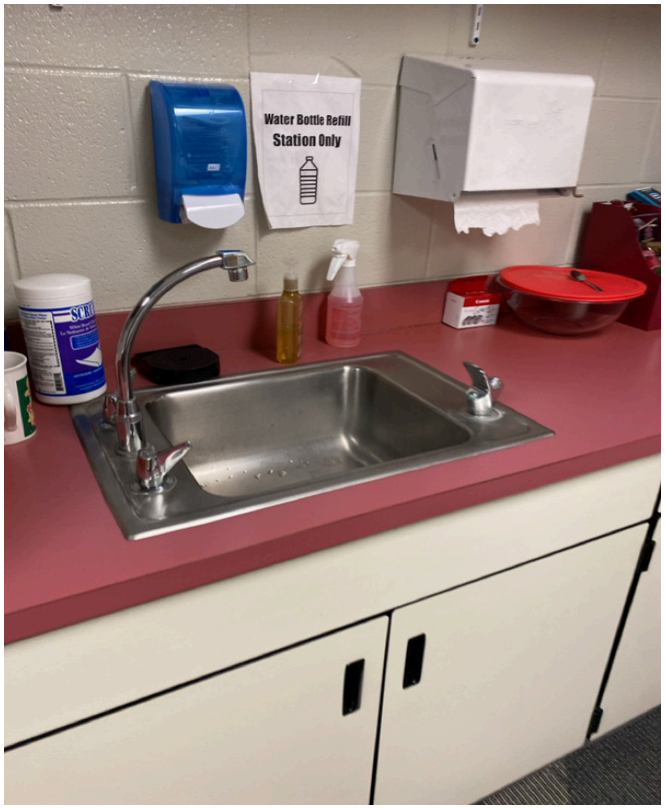

4/4/2024 - 1500-75 - Liberty Middle School - 004417-Room 214



4/4/2024 - 1500-76 - Liberty Middle School - 004414-Room 213



4/4/2024 - 1500-77 - Liberty Middle School - 004415-Room 213




4/4/2024 - 1500-78 - Liberty Middle School - 004412-Room 211



4/4/2024 - 1500-79 - Liberty Middle School - 004412-Room 211



4/4/2024 - 1500-80 - Liberty Middle School - 004402-Room 209

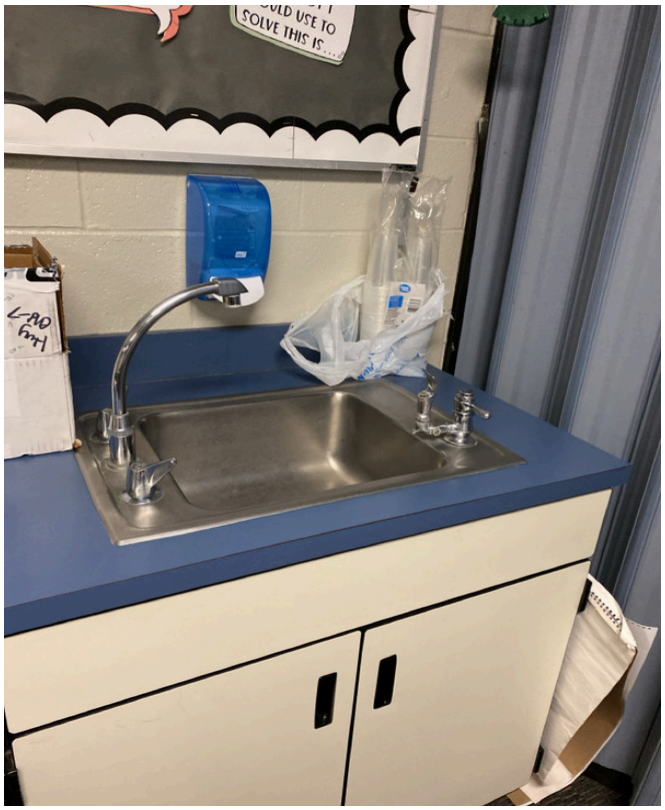

4/4/2024 - 1500-81 - Liberty Middle School - 004403-Room 209



4/4/2024 - 1500-82 - Liberty Middle School - 004401-Room 208



4/4/2024 - 1500-83 - Liberty Middle School - 004600-Room 208



4/4/2024 - 1500-84 - Liberty Middle School - 004598-Room 207



4/4/2024 - 1500-85 - Liberty Middle School - 004599-Room 207



4/4/2024 - 1500-86 - Liberty Middle School - 004596-Room 206



4/4/2024 - 1500-87 - Liberty Middle School - 004597-Room 206



4/4/2024 - 1500-88 - Liberty Middle School - 004586-Room 203



4/4/2024 - 1500-89 - Liberty Middle School - 004587-Room 203




4/4/2024 - 1500-90 - Liberty Middle School - 004584-Room 201



4/4/2024 - 1500-91 - Liberty Middle School - 004585-Room 201



4/4/2024 - 1500-92 - Liberty Middle School - 004582-Room 202

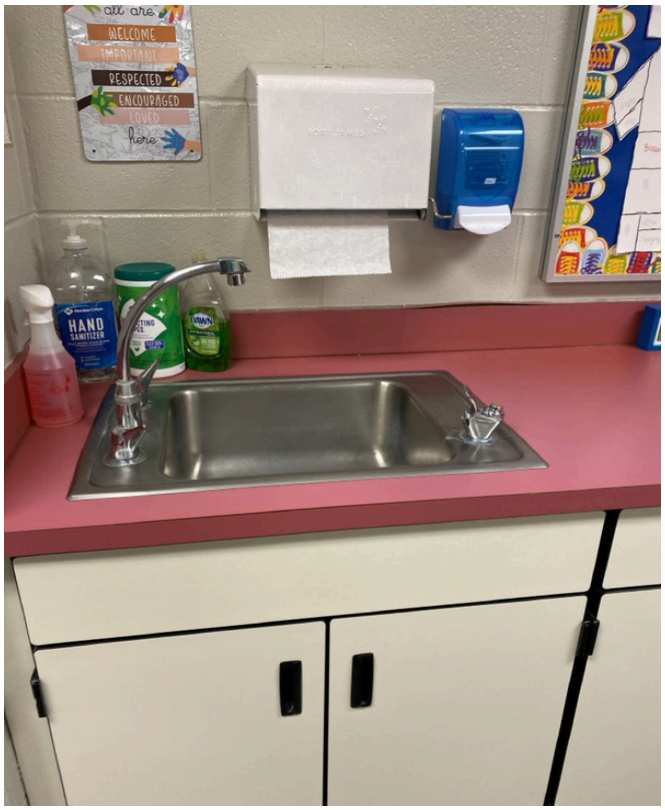

4/4/2024 - 1500-93 - Liberty Middle School - 004583-Room 202



4/4/2024 - 1500-94 - Liberty Middle School - 004338-By 200-Boys-Far Right



4/4/2024 - 1500-95 - Liberty Middle School - 004439-By 200-Boys



4/4/2024 - 1500-96 - Liberty Middle School - 004340-By 200-Boys



4/4/2024 - 1500-97 - Liberty Middle School - 004341-By 200-Boys



4/4/2024 - 1500-98 - Liberty Middle School - 004342-By 200-Boys



4/4/2024 - 1500-99 - Liberty Middle School - 003173-By Room 208-Restroom



4/4/2024 - 1500-100 - Liberty Middle School - 004337-By 200



4/4/2024 - 1500-101 - Liberty Middle School - 004337-By 200



4/4/2024 - 1500-102 - Liberty Middle School - 004343-By 200–Girls-Far Right



4/4/2024 - 1500-103 - Liberty Middle School - 004344-By 200-Girls



4/4/2024 - 1500-104 - Liberty Middle School - 004345-By 200-Girls



4/4/2024 - 1500-105 - Liberty Middle School - 004346-By 200-Girls



4/4/2024 - 1500-106 - Liberty Middle School - 004347-By 200-Girls



4/4/2024 - 1500-107 - Liberty Middle School - 000637-L-Kitchen



4/4/2024 - 1500-108 - Liberty Middle School - 000814-L-Kitchen



4/4/2024 - 1500-109 - Liberty Middle School - 003184-Kitchen-By Ice Machine



4/4/2024 - 1500-110 - Liberty Middle School - 003183-Kitchen-Restroom



4/4/2024 - 1500-111 - Liberty Middle School - 003186-Kitchen-By Ovens




4/4/2024 - 1500-112 - Liberty Middle School - 003187-Kitchen-By Mixer



4/4/2024 - 1500-113 - Liberty Middle School - 003188-Kitchen-By Freezer



4/4/2024 - 1500-114 - Liberty Middle School - 003189-Kitchen-By Mixer

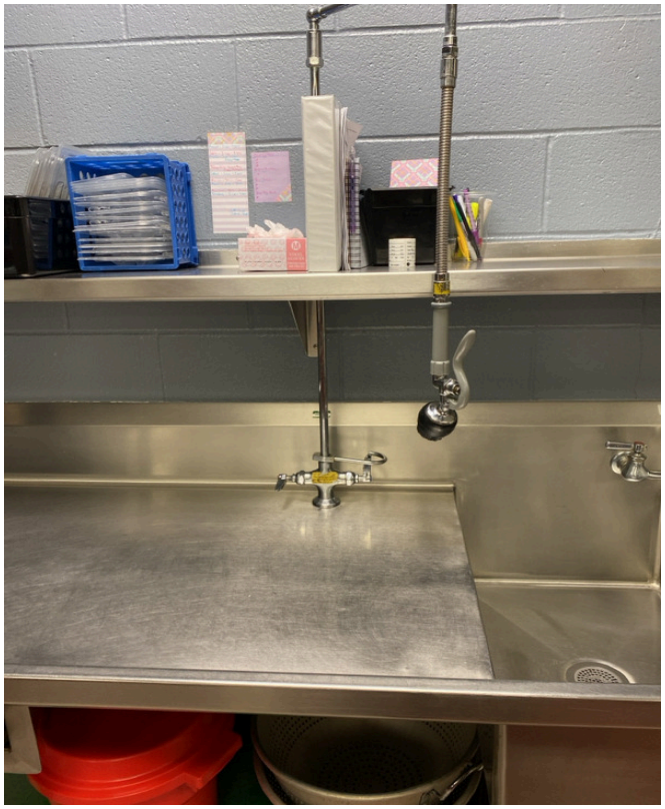

4/4/2024 - 1500-115 - Liberty Middle School - 003190-Kitchen



4/4/2024 - 1500-116 - Liberty Middle School - 003191-Kitchen



4/4/2024 - 1500-117 - Liberty Middle School - 003192-Kitchen-Handwashing-Dish Area



4/4/2024 - 1500-118 - Liberty Middle School - 003193-Kitchen



4/4/2024 - 1500-119 - Liberty Middle School - 003194-Kitchen



4/4/2024 - 1500-120 - Liberty Middle School - 003195-Kitchen



4/4/2024 - 1500-121 - Liberty Middle School - 003196-Kitchen



4/4/2024 - 1500-122 - Liberty Middle School - 003197-Kitchen



4/4/2024 - 1500-123 - Liberty Middle School - 003198-Kitchen-Dish Area-Sprayer



4/4/2024 - 1500-124 - Liberty Middle School - 004310-Gym



4/4/2024 - 1500-125 - Liberty Middle School - 004310-Gym



4/4/2024 - 1500-126 - Liberty Middle School - 004311-Gym



4/4/2024 - 1500-127 - Liberty Middle School - 004311-Gym



4/4/2024 - 1500-128 - Liberty Middle School - 004309-Gym Office-Boys



4/4/2024 - 1500-129 - Liberty Middle School - 004312-Boys Lockers



4/4/2024 - 1500-130 - Liberty Middle School - 004313-Boys Lockers



4/4/2024 - 1500-131 - Liberty Middle School - 004314-Boys Lockers



4/4/2024 - 1500-132 - Liberty Middle School - 004315-Boys Lockers - Out of Order



4/4/2024 - 1500-133 - Liberty Middle School - 004316-Boys Lockers



4/4/2024 - 1500-134 - Liberty Middle School - 004317-Boys Lockers



4/4/2024 - 1500-135 - Liberty Middle School - 004304-Girls Lockers



4/4/2024 - 1500-136 - Liberty Middle School - 004303-Girls Lockers



4/4/2024 - 1500-137 - Liberty Middle School - 003199-Girls Lockers



4/4/2024 - 1500-138 - Liberty Middle School - 004302-Girls Lockers



4/4/2024 - 1500-139 - Liberty Middle School - 004301-Girls Lockers



4/4/2024 - 1500-140 - Liberty Middle School - 003200-Girls Lockers - Out of Order



4/4/2024 - 1500-141 - Liberty Middle School - 004308-Gym Office-Girls



4/4/2024 - 1500-142 - Liberty Middle School - 004305-Room 604




4/4/2024 - 1500-143 - Liberty Middle School - 004306-Room 604



4/4/2024 - 1500-144 - Liberty Middle School - 004307B-Weight Room



4/4/2024 - 1500-145 - Liberty Middle School - 004307F-Weight Room

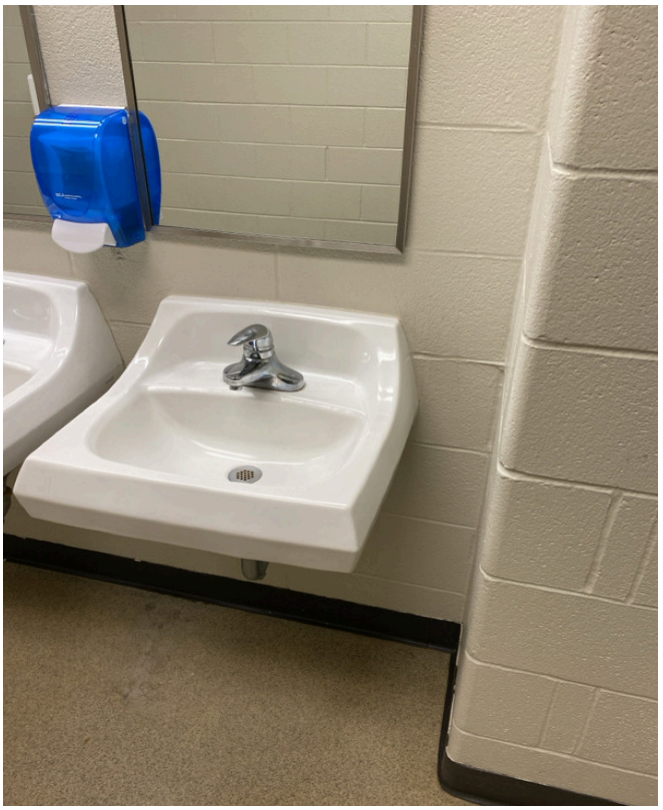

4/4/2024 - 1500-146 - Liberty Middle School - 004318-By 500-Boys-Far Right



4/4/2024 - 1500-147 - Liberty Middle School - 004319-By 500-Boys



4/4/2024 - 1500-148 - Liberty Middle School - 004320-By 500-Boys



4/4/2024 - 1500-149 - Liberty Middle School - 004321-By 500-Boys



4/4/2024 - 1500-150 - Liberty Middle School - 004322-By 500-Boys



4/4/2024 - 1500-151 - Liberty Middle School - 004328-By 500



4/4/2024 - 1500-152 - Liberty Middle School - 004329-By 500



4/4/2024 - 1500-153 - Liberty Middle School - 004323-By Room 500-Girls-Far Left



4/4/2024 - 1500-154 - Liberty Middle School - 004324-By 500-Girls



4/4/2024 - 1500-155 - Liberty Middle School - 004325-By 500-Girls



4/4/2024 - 1500-156 - Liberty Middle School - 004326-By 500-Girls



4/4/2024 - 1500-157 - Liberty Middle School - 004327-By 500-Girls



4/4/2024 - 1500-158 - Liberty Middle School - 004499-Room 506



4/4/2024 - 1500-159 - Liberty Middle School - 004500-Room 506




4/4/2024 - 1500-160 - Liberty Middle School - 004492/93-Room 505




4/4/2024 - 1500-161 - Liberty Middle School - 004494/95-Room 505



4/4/2024 - 1500-162 - Liberty Middle School - 004496/97-Room 505

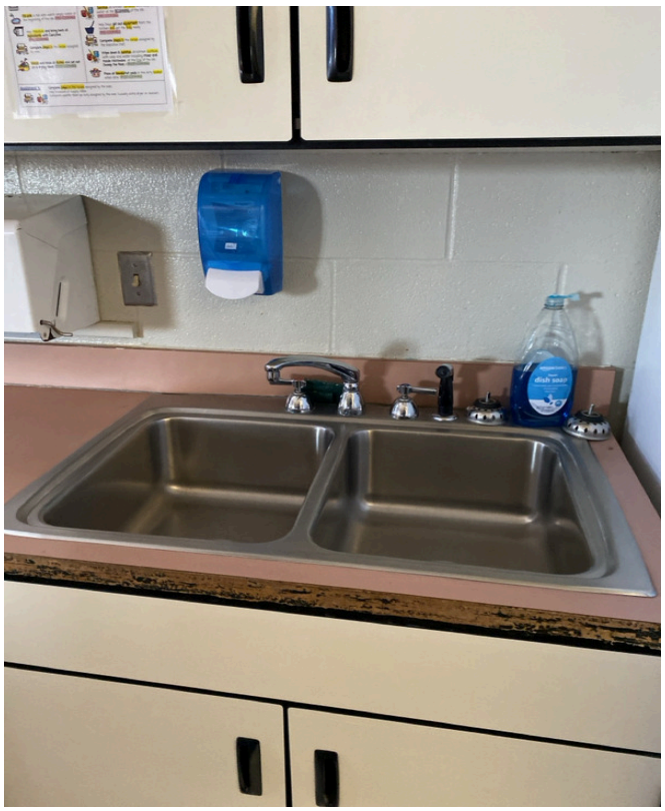

4/4/2024 - 1500-163 - Liberty Middle School - 004480/81-Room 504

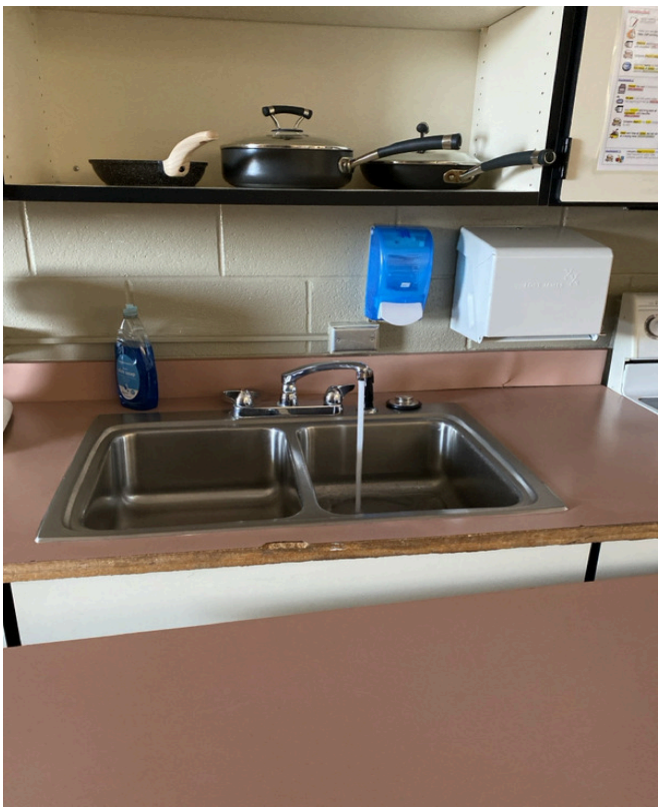

4/4/2024 - 1500-164 - Liberty Middle School - 004482/83-Room 504



4/4/2024 - 1500-165 - Liberty Middle School - 004484/85-Room 504



4/4/2024 - 1500-166 - Liberty Middle School - 004486/87-Room 504



4/4/2024 - 1500-167 - Liberty Middle School - 004488/89-Room 504



4/4/2024 - 1500-168 - Liberty Middle School - 004490/91-Room 504



4/4/2024 - 1500-169 - Liberty Middle School - 004474-Room 502



4/4/2024 - 1500-170 - Liberty Middle School - 004475-Room 502



4/4/2024 - 1500-171 - Liberty Middle School - 004476-Room 502



4/4/2024 - 1500-172 - Liberty Middle School - 004477-Room 502



4/4/2024 - 1500-173 - Liberty Middle School - 004498-500 Hall-Staff Restroom




4/4/2024 - 1500-174 - Liberty Middle School - 004478-Room 501



4/4/2024 - 1500-175 - Liberty Middle School - 004479-Room 501



4/30/2024 - 1500-29 - Liberty Middle School - 004459-Room 106

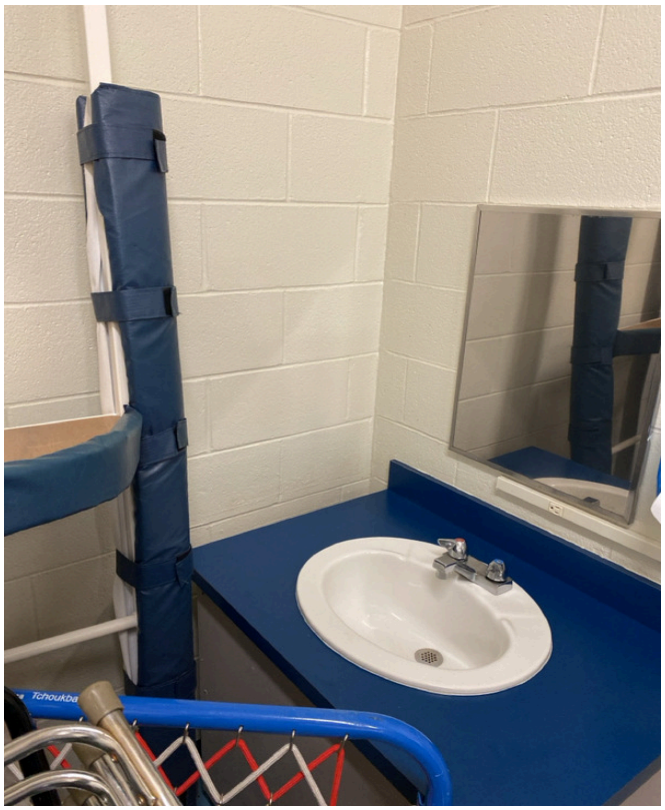

4/30/2024 - 1500-132 - Liberty Middle School - 004315-Boys Locker Room




4/30/2024 - 1500-140 - Liberty Middle School - 003200-Girls Locker Room

Appendix E
Source Identification Diagram

ASP was provided sample locations by
Liberty School District

Liberty Middle School
1500 S. Withers
Liberty, MO 64068
Phone: 816.736.5410

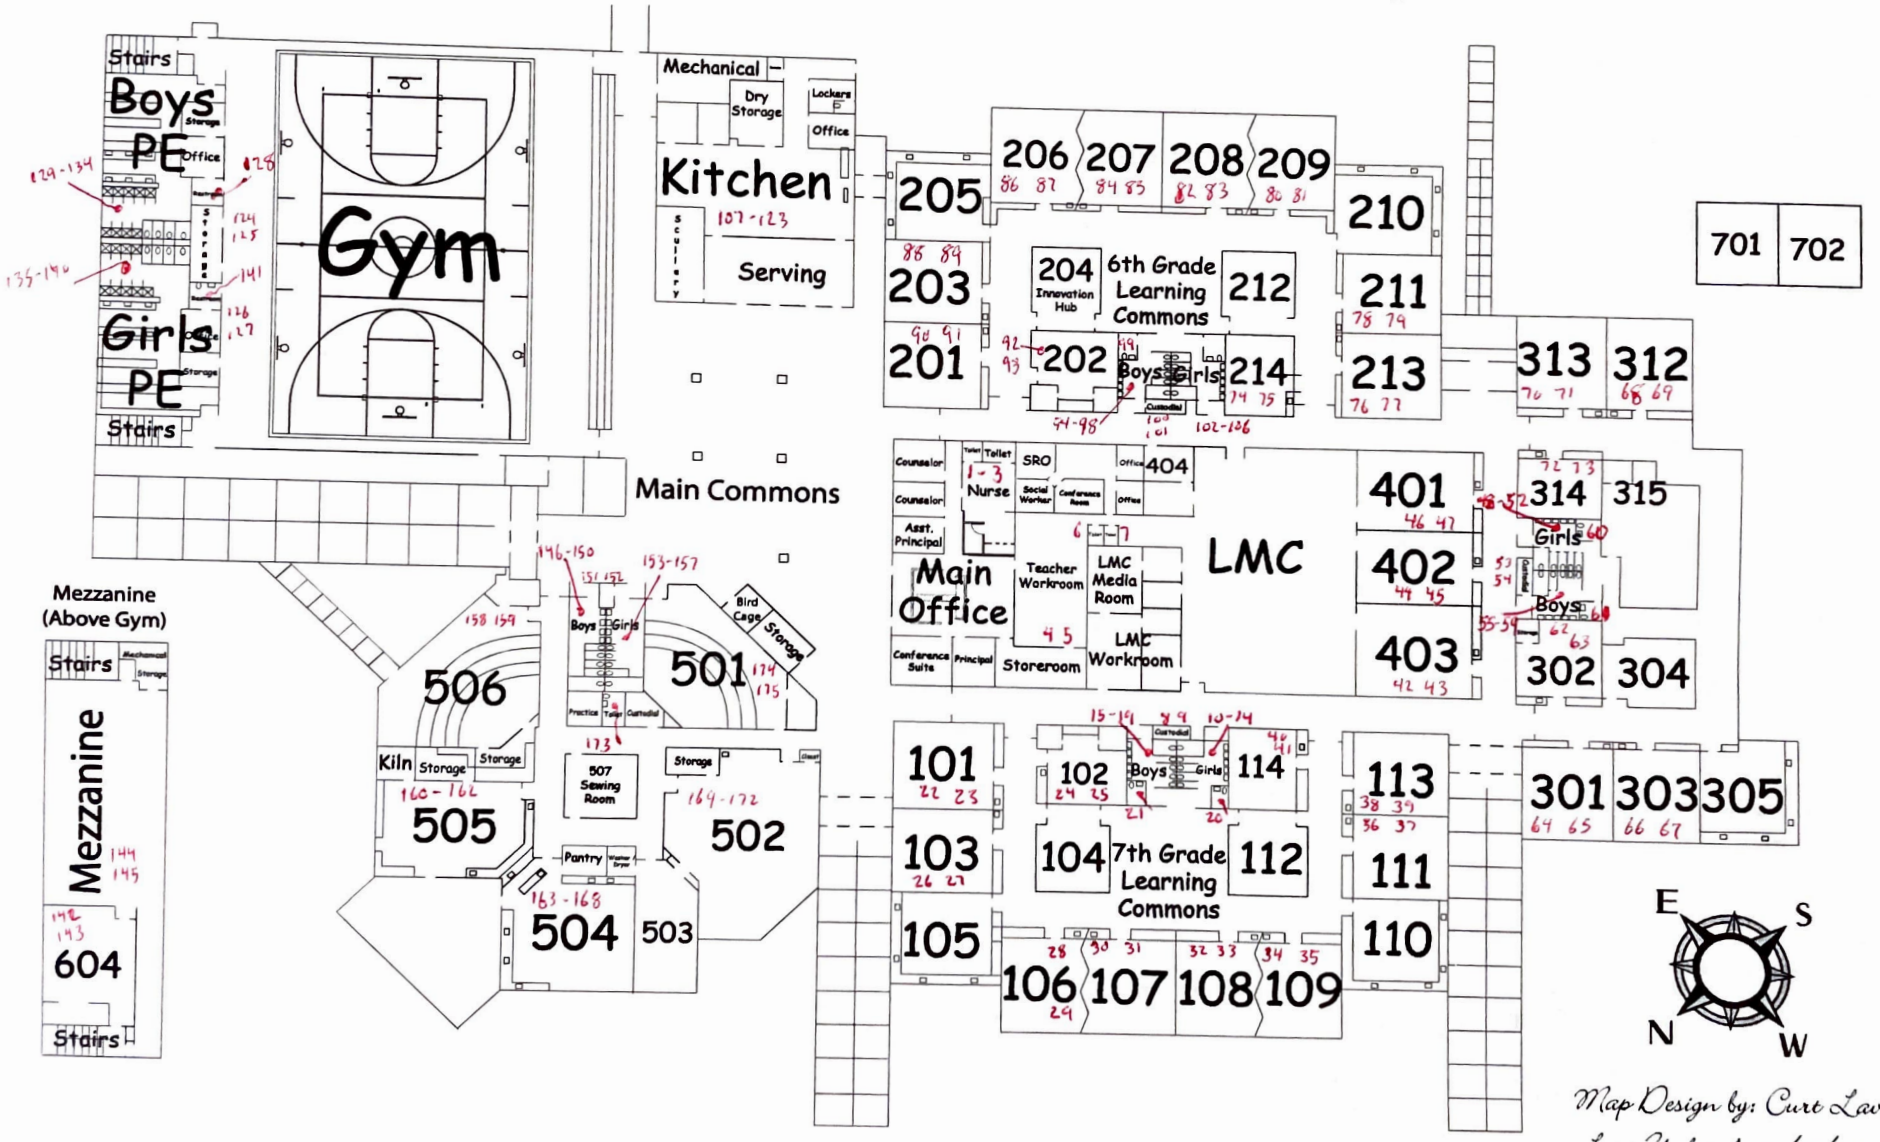

Map Design by: Curt Laven
Last Updated: 06/17/2021