May 31, 2024

Steve Aldrich
Director of Facilities and Grounds
Liberty School District
801 Kent Street
Liberty, Missouri 64068

Project: Limited Lead in Drinking Water Testing
Address: 1000 Northeast 104th Street, Liberty, Missouri 64068

Mr. Steve Aldrich

On March 27, 2024 and May 1, 2024, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 371 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of “lead free” to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of “lead free” as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: https://www.epa.gov/dwreginfo/lead-and-copper-rule

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.
Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school’s buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in red text.

March 27, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-1-FD	Liberty North - 003976-Main Office	Sink Tap	First Draw	<0.4
1000-2-FD	Liberty North - 002301/3977-Main Office-Staff Restroom-Girls	Sink Tap	First Draw	<0.4
1000-3-FD	Liberty North - 003978-Hallway by Main Office	Sink Tap	First Draw	<0.4
1000-4-FD	Liberty North - 003994-Old 100 Hall-Boys-Left	Drinking Fountain	First Draw	<0.4
1000-5-FD	Liberty North - 003995-Old 100 Hall-Boys-Right	Drinking Fountain	First Draw	<0.4
1000-6-FD	Liberty North - 03990-Old 100 Hall-Boys-Far Left	Sink Tap	First Draw	0.4
1000-7-FD	Liberty North - 003991-Old 100 Hall-Boys	Sink Tap	First Draw	0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-8-FD	Liberty North - 003992-Old 100 Hall-Boys	Sink Tap	First Draw	<0.4
1000-9-FD	Liberty North - 003993-Old 100 Hallway-Boys	Sink Tap	First Draw	<0.4
1000-10-FD	Liberty North - 003801-Old 100 Hall-Girls-Left	Drinking Fountain	First Draw	<0.4
1000-11-FD	Liberty North - 004000-Old 100 Hall-Girls-Right	Drinking Fountain	First Draw	<0.4
1000-12-FD	Liberty North - 003996-Old 100 Hall-Girls-Far Left	Sink Tap	First Draw	<0.4
1000-13-FD	Liberty North - 003997-Old 100 Hall-Girls	Sink Tap	First Draw	<0.4
1000-14-FD	Liberty North - 003998-Old 100 Hall-Girls	Sink Tap	First Draw	0.4
1000-15-FD	Liberty North - 003999-Old 100 Hall-Girls-Far Right	Sink Tap	First Draw	<0.4
1000-16-FD	Liberty North - 003979-Room 110-Southeast Corner	Sink Tap	First Draw	<0.4
1000-17-FD	Liberty North - 003980-Room 110-South Middle	Sink Tap	First Draw	<0.4
1000-18-FD	Liberty North - 003981-Room 110-Southwest Corner	Sink Tap	First Draw	<0.4
1000-19-FD	Liberty North - 003982-Room 110-Northwest Corner	Sink Tap	First Draw	<0.4
1000-20-FD	Liberty North - 003983-Room 110-North Middle	Sink Tap	First Draw	<0.4
1000-21-FD	Liberty North - 003984-Room 110-Northeast corner	Sink Tap	First Draw	<0.4
1000-22-FD	Liberty North - 000932-L-Room 110	Ice Machine	First Draw	1.1
1000-23-FD	Liberty North - 003987-Room 109	Sink Tap	First Draw	<0.4
1000-24-FD	Liberty North - 003988-Room 109	Sink Tap	First Draw	<0.4
1000-25-FD	Liberty North - 003989-Room 109	Sink Tap	First Draw	<0.4
1000-26-FD	Liberty North - 002579-Room 109	Ice Machine	First Draw	<0.4
1000-27-FD	Liberty North - 003986-Room 111	Sink Tap	First Draw	<0.4
1000-28-FD	Liberty North - 003985-Room 111	Bubbler	First Draw	0.6
1000-29-FD	Liberty North - 002580-Room 113	Sink Tap	First Draw	<0.4
1000-30-FD	Liberty North - 002581-Room 113	Bubbler	First Draw	3.8
1000-31-FD	Liberty North - 003819-Between Old/New 100 Hall	Drinking Fountain	First Draw	1.4
1000-32-FD	Liberty North - 003820-Between Old/New 100 Hall	Drinking Fountain	First Draw	0.4
1000-33-FD	Liberty North - 003821-Between Old/New 100 Hall	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-34-FD	Liberty North - 003822-Between Old/New 100 Hall	Drinking Fountain	First Draw	<0.4
1000-35-FD	Liberty North - 003802-Room 115	Sink Tap	First Draw	<0.4
1000-36-FD	Liberty North - 003803-Room 115	Sink Tap	First Draw	<0.4
1000-37-FD	Liberty North - 003804-Room 115	Sink Tap	First Draw	<0.4
1000-38-FD	Liberty North - 003805-Room 115-Three Bay Right	Sink Tap	First Draw	<0.4
1000-39-FD	Liberty North - 003806-Room 115-Three Bay Middle	Sink Tap	First Draw	<0.4
1000-40-FD	Liberty North - 003807-Room 115-Three Bay Left	Sink Tap	First Draw	<0.4
1000-41-FD	Liberty North - 003808-Room 115 Next to Room 116A	Sink Tap	First Draw	<0.4
1000-42-FD	Liberty North - 003809-Room 115 By windows-Left	Sink Tap	First Draw	<0.4
1000-43-FD	Liberty North - 003810-Room 115 By windows	Sink Tap	First Draw	<0.4
1000-44-FD	Liberty North - 003811-Room 115	Sink Tap	First Draw	<0.4
1000-45-FD	Liberty North - 003812-Room 116B	Ice Machine	First Draw	0.4
1000-46-FD	Liberty North - 003813-New 100 Hall	Drinking Fountain	First Draw	<0.4
1000-47-FD	Liberty North - 003814B-New 100 Hall	Drinking Fountain	First Draw	<0.4
1000-48-FD	Liberty North - 003814F-New 100 Hall	Bottle Filler	First Draw	<0.4
1000-49-FD	Liberty North - 003815-Between Restrooms-New 100 Hall	Sink Tap	First Draw	<0.4
1000-50-FD	Liberty North - 003816-Between Restrooms-New 100 Hall	Sink Tap	First Draw	<0.4
1000-51-FD	Liberty North - 003817-Between Restrooms-New 100 Hall	Sink Tap	First Draw	<0.4
1000-52-FD	Liberty North - 003818-Between Restrooms-New 100 Hall-Far Right	Sink Tap	First Draw	<0.4
1000-53-FD	Liberty North - 002582-Room 133	Sink Tap	First Draw	<0.4
1000-54-FD	Liberty North - 002583-Room 133 Restroom	Sink Tap	First Draw	<0.4
1000-55-FD	Liberty North - 002584-Room 133B/Lactation Room	Sink Tap	First Draw	0.5
1000-56-FD	Liberty North - 004039-By 202	Drinking Fountain	First Draw	<0.4
1000-57-FD	Liberty North - 004038-By 202	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-58-FD	Liberty North - 004037-Room 212 by Coffee Shop	Sink Tap	First Draw	<0.4
1000-59-FD	Liberty North - 004036-Library by Coffee Shop	Drinking Fountain	First Draw	<0.4
1000-60-FD	Liberty North - 004035-Library	Coffee Pot	First Draw	<0.4
1000-61-FD	Liberty North - 004034-Library	Coffee Pot	First Draw	0.5
1000-62-FD	Liberty North - 004033-Library	Coffee Pot	First Draw	<0.4
1000-63-FD	Liberty North - 004032-Library Coffee Shop	Sink Tap	First Draw	0.9
1000-64-FD	Liberty North - 004031-Library Coffee Shop	Sink Tap	First Draw	<0.4
1000-65-FD	Liberty North - 003836-Old 300 Hall-Girls	Drinking Fountain	First Draw	<0.4
1000-66-FD	Liberty North - 003837-Old 300 Hall-Girls-Right	Drinking Fountain	First Draw	<0.4
1000-67-FD	Liberty North - 003839-Old 300 Hall-Girls-Far Left	Sink Tap	First Draw	<0.4
1000-68-FD	Liberty North - 003840-Old 300 Hall-Girls	Sink Tap	First Draw	0.5
1000-69-FD	Liberty North - 003838-Old 300 Hall-Girls-Right Middle	Sink Tap	First Draw	<0.4
1000-70-FD	Liberty North - 003841-Old 300 Hall-Girls-Far Right	Sink Tap	First Draw	<0.4
1000-71-FD	Liberty North - 003835-Old 300 Hall-Boys-Left	Drinking Fountain	First Draw	<0.4
1000-72-FD	Liberty North - 003834-Old 300 Hall-Boys-Right	Drinking Fountain	First Draw	<0.4
1000-73-FD	Liberty North - 003830-Old 300 Hall-Boys-Far Left	Sink Tap	First Draw	<0.4
1000-74-FD	Liberty North - 003831-Old 300 Hall-Boys-Left Middle	Sink Tap	First Draw	<0.4
1000-75-FD	Liberty North - 003832-Old 300 Hall-Boys-Right Middle	Sink Tap	First Draw	0.5
1000-76-FD	Liberty North - 003833-Old 300 Hall-Boys-Far Right	Sink Tap	First Draw	0.6
1000-77-FD	Liberty North - 002550-Room 307	Sink Tap	First Draw	0.9
1000-78-FD	Liberty North - 003842-Room 307	Sink Tap	First Draw	1.1
1000-79-FD	Liberty North - 003843-Room 307	Sink Tap	First Draw	1.3
1000-80-FD	Liberty North - 003844-Room 310 Prep, Inside 307	Sink Tap	First Draw	0.7
1000-81-FD	Liberty North - 003826-Between Old/New 300 Hall-Far Right	Drinking Fountain	First Draw	<0.4
1000-82-FD	Liberty North - 003827-Between Old/New 300 Hall-Right Middle	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-83-FD	Liberty North - 003828-Between Old/New 300 Hall-Left Middle	Drinking Fountain	First Draw	<0.4
1000-84-FD	Liberty North - 003829-Between Old/New 300 Hall-Far Left	Drinking Fountain	First Draw	<0.4
1000-85-FD	Liberty North - 004021-Room 322	Sink Tap	First Draw	<0.4
1000-86-FD	Liberty North - 004020-Room 324	Sink Tap	First Draw	<0.4
1000-87-FD	Liberty North - 004022-New 300 Hall-Right	Drinking Fountain	First Draw	<0.4
1000-88-FD	Liberty North - 004022-New 300 Hall	Bubbler	First Draw	<0.4
1000-89-FD	Liberty North - 004023-New 300 Hall-Left	Drinking Fountain	First Draw	<0.4
1000-90-FD	Liberty North - 004024-Room 326	Sink Tap	First Draw	0.8
1000-91-FD	Liberty North - 004025-Room 331	Sink Tap	First Draw	0.6
1000-92-FD	Liberty North - 004026-Next to 331	Sink Tap	First Draw	<0.4
1000-93-FD	Liberty North - 002346-Basement Below 300s-Boys-Left	Sink Tap	First Draw	<0.4
1000-94-FD	Liberty North - 002347-Basement Below 300s-Boys-Right	Sink Tap	First Draw	2.2
1000-95-FD	Liberty North - 002348-Basement Below 300s-Girls-Left	Sink Tap	First Draw	<0.4
1000-96-FD	Liberty North - 002349-Basement Below 300s-Girls-Right	Sink Tap	First Draw	<0.4
1000-97-FD	Liberty North - 002344-Basement Below 300s-Left	Drinking Fountain	First Draw	<0.4
1000-98-FD	Liberty North - 002345-Basement Below 300s-Right	Drinking Fountain	First Draw	<0.4
1000-99-FD	Liberty North - 003943-Great Hall-Far Left	Drinking Fountain	First Draw	<0.4
1000-100-FD	Liberty North - 003943F-Great Hall	Bottle Filler	First Draw	<0.4
1000-101-FD	Liberty North - 003944-Great Hall	Drinking Fountain	First Draw	<0.4
1000-102-FD	Liberty North - 003945-Great Hall	Drinking Fountain	First Draw	<0.4
1000-103-FD	Liberty North - 003946-Great Hall	Drinking Fountain	First Draw	<0.4
1000-104-FD	Liberty North - 003947-Great Hall	Drinking Fountain	First Draw	<0.4
1000-105-FD	Liberty North - 003948-Great Hall	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-106-FD	Liberty North - 003949-Great Hall-Far Right	Drinking Fountain	First Draw	<0.4
1000-107-FD	Liberty North - 003949F-Great Hall	Bottle Filler	First Draw	<0.4
1000-108-FD	Liberty North - 003931-Room 403-Boys	Sink Tap	First Draw	<0.4
1000-109-FD	Liberty North - 003932-Room 403-Boys	Sink Tap	First Draw	<0.4
1000-110-FD	Liberty North - 003933-Room 403-Handwashing	Sink Tap	First Draw	<0.4
1000-111-FD	Liberty North - 003934-Room 403-Handwashing	Sink Tap	First Draw	<0.4
1000-114-FD	Liberty North - 003937-Room 404-Girls-Far Left	Sink Tap	First Draw	<0.4
1000-115-FD	Liberty North - 003938-Room 404-Girls-Left Middle	Sink Tap	First Draw	<0.4
1000-116-FD	Liberty North - 003939-Room 404-Girls	Sink Tap	First Draw	<0.4
1000-117-FD	Liberty North - 003940-Room 404-Girls	Sink Tap	First Draw	<0.4
1000-120-FD	Liberty North - 003913-Room 411-Boys	Sink Tap	First Draw	<0.4
1000-121-FD	Liberty North - 003914-Room 411-Boys	Sink Tap	First Draw	<0.4
1000-122-FD	Liberty North - 003915-Room 411-Boys	Sink Tap	First Draw	<0.4
1000-123-FD	Liberty North - 003916-Room 411-Boys Lockers	Drinking Fountain	First Draw	<0.4
1000-124-FD	Liberty North - 003917-Room 411-Boys Lockers	Drinking Fountain	First Draw	<0.4
1000-125-FD	Liberty North - 003918-Room 411-Boys Lockers-Left	Sink Tap	First Draw	0.4
1000-126-FD	Liberty North - 003919-Room 411-Boys Lockers-Right	Sink Tap	First Draw	<0.4
1000-127-FD	Liberty North - 003920-Room 411-Boys Lockers	Drinking Fountain	First Draw	<0.4
1000-128-FD	Liberty North - 003921-Room 411-Boys Lockers	Drinking Fountain	First Draw	<0.4
1000-129-FD	Liberty North - 003922-Next to 409-Girls Lockers	Drinking Fountain	First Draw	<0.4
1000-130-FD	Liberty North - 003923-Next to 409-Girls Lockers	Drinking Fountain	First Draw	<0.4
1000-132-FD	Liberty North - 003925-Girls Locker Room	Sink Tap	First Draw	<0.4
1000-133-FD	Liberty North - 003926-Girls Locker Room	Sink Tap	First Draw	<0.4
1000-134-FD	Liberty North - 003927-Room 410-Girls Lockers	Drinking Fountain	First Draw	<0.4
1000-135-FD	Liberty North - 003928-Room 410-Girls Lockers	Drinking Fountain	First Draw	<0.4
1000-136-FD	Liberty North - 003929-Rook 410-Girls Lockers	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-137-FD	Liberty North - 003930-Room 410-Girls Lockers	Sink Tap	First Draw	<0.4
1000-138-FD	Liberty North - 003912-Room 415	Sink Tap	First Draw	0.8
1000-139-FD	Liberty North - 003909-Concessions-By 401	Sink Tap	First Draw	<0.4
1000-140-FD	Liberty North - 003910-Concessions By 421	Sink Tap	First Draw	<0.4
1000-141-FD	Liberty North - 003911-Concessions By 421	Sink Tap	First Draw	<0.4
1000-142-FD	Liberty North - 000788-L-Concession Stand	Ice Machine	First Draw	1.2
1000-143-FD	Liberty North - 004189-Fieldhouse Upstairs-Boys	Drinking Fountain	First Draw	<0.4
1000-144-FD	Liberty North - 004188-Fieldhouse Upstairs-Boys	Drinking Fountain	First Draw	<0.4
1000-145-FD	Liberty North - 004180-Fieldhouse Upstairs-Boys	Sink Tap	First Draw	0.4
1000-146-FD	Liberty North - 004181-Fieldhouse Upstairs-Boys	Sink Tap	First Draw	<0.4
1000-147-FD	Liberty North - 004182-Fieldhouse Upstairs-Boys	Sink Tap	First Draw	0.4
1000-148-FD	Liberty North - 004183-Fieldhouse Upstairs-Boys	Sink Tap	First Draw	<0.4
1000-149-FD	Liberty North - 004184-Fieldhouse Upstairs-Boys	Sink Tap	First Draw	0.6
1000-150-FD	Liberty North - 004185-Fieldhouse Upstairs-Boys	Sink Tap	First Draw	0.4
1000-151-FD	Liberty North - 004186-Fieldhouse Upstairs-Boys	Sink Tap	First Draw	0.7
1000-152-FD	Liberty North - 004187-Fieldhouse Upstairs-Boys	Sink Tap	First Draw	0.8
1000-153-FD	Liberty North - 004178-Fieldhouse Upstairs-Girls	Drinking Fountain	First Draw	<0.4
1000-154-FD	Liberty North - 004179-Fieldhouse Upstairs-Girls	Drinking Fountain	First Draw	<0.4
1000-155-FD	Liberty North - 004170-Fieldhouse Upstairs-Girls	Sink Tap	First Draw	<0.4
1000-156-FD	Liberty North - 004171-Fieldhouse Upstairs-Girls	Sink Tap	First Draw	<0.4
1000-157-FD	Liberty North - 004172-Fieldhouse Upstairs-Girls	Sink Tap	First Draw	<0.4
1000-158-FD	Liberty North - 004173-Fieldhouse Upstairs-Girls	Sink Tap	First Draw	<0.4
1000-159-FD	Liberty North - 004174-Fieldhouse Upstairs-Girls	Sink Tap	First Draw	0.4
1000-160-FD	Liberty North - 004175-Fieldhouse Upstairs-Girls	Sink Tap	First Draw	<0.4
1000-161-FD	Liberty North - 004176-Fieldhouse Upstairs-Girls	Sink Tap	First Draw	0.5
1000-162-FD	Liberty North - 004177-Fieldhouse Upstairs-Girls	Sink Tap	First Draw	0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-163-FD	Liberty North - 004166-Room 510	Sink Tap	First Draw	9.4
1000-164-FD	Liberty North - 004167-Room 510	Sink Tap	First Draw	<0.4
1000-165-FD	Liberty North - 004168-Room 510	Sink Tap	First Draw	<0.4
1000-166-FD	Liberty North - 004169-Room 510	Sink Tap	First Draw	<0.4
1000-167-FD	Liberty North - 004158-500 Hall	Drinking Fountain	First Draw	<0.4
1000-168-FD	Liberty North - 004159-500 Hall	Drinking Fountain	First Draw	<0.4
1000-169-FD	Liberty North - 004160-500 Hall-Boys	Sink Tap	First Draw	0.5
1000-170-FD	Liberty North - 004161-500 Hall-Boys	Sink Tap	First Draw	<0.4
1000-171-FD	Liberty North - 004162-500 Hall-Boys	Sink Tap	First Draw	<0.4
1000-172-FD	Liberty North - 004163-500 Hall-Girls	Sink Tap	First Draw	<0.4
1000-173-FD	Liberty North - 004164-500 Hall-Girls	Sink Tap	First Draw	<0.4
1000-174-FD	Liberty North - 004165-500 Hall-Girls	Sink Tap	First Draw	<0.4
1000-175-FD	Liberty North - 002577-Room 515	Sink Tap	First Draw	3.7
1000-176-FD	Liberty North - 004154-Room 514	Sink Tap	First Draw	<0.4
1000-177-FD	Liberty North - 004155-Room 514	Sink Tap	First Draw	<0.4
1000-178-FD	Liberty North - 004156-Room 514	Sink Tap	First Draw	<0.4
1000-179-FD	Liberty North - 004157-Room 514	Sink Tap	First Draw	<0.4
1000-180-FD	Liberty North - 004151-Room 516	Sink Tap	First Draw	0.9
1000-181-FD	Liberty North - 004152-Room 516	Bubbler	First Draw	0.4
1000-182-FD	Liberty North - 004153-Room 516	Sink Tap	First Draw	1.7
1000-183-FD	Liberty North - 004147-Room 517	Sink Tap	First Draw	<0.4
1000-184-FD	Liberty North - 004146-Room 517-Restroom	Sink Tap	First Draw	<0.4
1000-185-FD	Liberty North - 004149-Room 520	Sink Tap	First Draw	0.5
1000-186-FD	Liberty North - 004148-Room 520	Bubbler	First Draw	0.7
1000-187-FD	Liberty North - 004150-Room 520	Sink Tap	First Draw	<0.4
1000-188-FD	Liberty North - 004143-Room 521 #4	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-189-FD	Liberty North - 004142-Room 521 #3	Sink Tap	First Draw	<0.4
1000-190-FD	Liberty North - 004144-Room 521 #2	Sink Tap	First Draw	<0.4
1000-191-FD	Liberty North - 004145-Room 521 #1	Sink Tap	First Draw	<0.4
1000-192-FD	Liberty North - 004141-Room 523	Sink Tap	First Draw	<0.4
1000-193-FD	Liberty North - 004139-Room 523 By Entry	Sink Tap	First Draw	<0.4
1000-194-FD	Liberty North - 004140-Room 523 By Entry	Sink Tap	First Draw	0.8
1000-195-FD	Liberty North - 004196-Fieldhouse Downstairs-Boys	Sink Tap	First Draw	<0.4
1000-196-FD	Liberty North - 004197-Fieldhouse Downstairs-Boys	Sink Tap	First Draw	<0.4
1000-197-FD	Liberty North - 004195-Fieldhouse	Drinking Fountain	First Draw	<0.4
1000-199-FD	Liberty North - 004193-Fieldhouse	Drinking Fountain	First Draw	<0.4
1000-200-FD	Liberty North - 004192-Fieldhouse	Drinking Fountain	First Draw	<0.4
1000-201-FD	Liberty North - 004190-Fieldhouse Downstairs-Girls	Sink Tap	First Draw	<0.4
1000-202-FD	Liberty North - 004191-Fieldhouse Downstairs-Girls	Sink Tap	First Draw	0.4
1000-203-FD	Liberty North - 002592-Coaches Office	Sink Tap	First Draw	1
1000-204-FD	Liberty North - 003908- Room 11	Drinking Fountain	First Draw	<0.4
1000-205-FD	Liberty North - 003907-Room 11-Girls Lockers	Sink Tap	First Draw	<0.4
1000-206-FD	Liberty North - 003906-Room 11-Girls Lockers	Sink Tap	First Draw	<0.4
1000-207-FD	Liberty North - 002591-Room 012B-Restroom	Sink Tap	First Draw	<0.4
1000-208-FD	Liberty North - 003905-Coaches Office-014B	Sink Tap	First Draw	<0.4
1000-209-FD	Liberty North - 003904-Field House-Boys Lockers	Sink Tap	First Draw	<0.4
1000-210-FD	Liberty North - 003903-Fieldhouse-Boys Lockers	Sink Tap	First Draw	<0.4
1000-211-FD	Liberty North - 004199-Fieldhouse	Drinking Fountain	First Draw	<0.4
1000-212-FD	Liberty North - 004198-Fieldhouse	Drinking Fountain	First Draw	<0.4
1000-213-FD	Liberty North - 004200-Room 15	Sink Tap	First Draw	<0.4
1000-214-FD	Liberty North - 003902-Room 15	Whirlpool	First Draw	<0.4
1000-215-FD	Liberty North - 003901-Room 15	Ice Machine	First Draw	0.5

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-216-FD	Liberty North - 004040-Old 900 Hall-Girls	Drinking Fountain	First Draw	<0.4
1000-217-FD	Liberty North - 004041-Old 900 Hall-Girls	Drinking Fountain	First Draw	<0.4
1000-218-FD	Liberty North - 004042-Old 900 Hall-Girls	Sink Tap	First Draw	<0.4
1000-219-FD	Liberty North - 004043-Old 900 Hall-Girls	Sink Tap	First Draw	<0.4
1000-220-FD	Liberty North - 004044-Old 900 Hall-Girls	Sink Tap	First Draw	<0.4
1000-221-FD	Liberty North - 004045-Old 900 Hall-Girls	Sink Tap	First Draw	<0.4
1000-222-FD	Liberty North - 002350-Old 900 Hall-Boys	Drinking Fountain	First Draw	<0.4
1000-223-FD	Liberty North - 002351-Old 900 Hall-Boys	Drinking Fountain	First Draw	<0.4
1000-224-FD	Liberty North - 002352-Old 900 Hall-Boys	Sink Tap	First Draw	<0.4
1000-225-FD	Liberty North - 002353-Old 900 Hall-Boys	Sink Tap	First Draw	<0.4
1000-226-FD	Liberty North - 002354-Old 900 Hall-Boys	Sink Tap	First Draw	<0.4
1000-227-FD	Liberty North - 002355-Old 900 Hall-Boys	Sink Tap	First Draw	<0.4
1000-228-FD	Liberty North - 004076-Room 902	Sink Tap	First Draw	<0.4
1000-229-FD	Liberty North - 004077-Room 902	Bubbler	First Draw	1.2
1000-230-FD	Liberty North - 002603-Room 904	Sink Tap	First Draw	<0.4
1000-231-FD	Liberty North - 002604-Room 904	Bubbler	First Draw	<0.4
1000-232-FD	Liberty North - 004078-Room 909	Sink Tap	First Draw	0.6
1000-233-FD	Liberty North - 004079-Room 909	Bubbler	First Draw	0.8
1000-234-FD	Liberty North - 004080-Room 910	Sink Tap	First Draw	0.5
1000-235-FD	Liberty North - 004081-Room 910	Bubbler	First Draw	0.8
1000-236-FD	Liberty North - 004084-Room 915	Sink Tap	First Draw	<0.4
1000-237-FD	Liberty North - 004085-Room 915-Restroom	Sink Tap	First Draw	<0.4
1000-238-FD	Liberty North - 004082-Room 916	Sink Tap	First Draw	<0.4
1000-239-FD	Liberty North - 004083-Room 916	Bubbler	First Draw	1.9
1000-240-FD	Liberty North - 004064-Between Old/New 900 Hall	Drinking Fountain	First Draw	<0.4
1000-241-FD	Liberty North - 004065-Between Old/New 900 Hall	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-242-FD	Liberty North - 004066-Between Old/New 900 Hall	Drinking Fountain	First Draw	<0.4
1000-243-FD	Liberty North - 004067-Between Old/New 900 Hall	Drinking Fountain	First Draw	<0.4
1000-244-FD	Liberty North - 004086-Room 919	Sink Tap	First Draw	<0.4
1000-245-FD	Liberty North - 004087-Room 919-Restroom	Sink Tap	First Draw	<0.4
1000-257-FD	Liberty North - 004095-Room 914	Sink Tap	First Draw	<0.4
1000-258-FD	Liberty North - 004094-Room 914	Bubbler	First Draw	3.6
1000-259-FD	Liberty North - 004098-Room 912	Sink Tap	First Draw	<0.4
1000-260-FD	Liberty North - 004097-Room 912	Bubbler	First Draw	5.2
1000-261-FD	Liberty North - 004096-Room 908	Sink Tap	First Draw	<0.4
1000-262-FD	Liberty North - 004099-Room 907	Sink Tap	First Draw	<0.4
1000-263-FD	Liberty North - 004100-Room 907	Bubbler	First Draw	<0.4
1000-264-FD	Liberty North - 002602-Room 905	Sink Tap	First Draw	0.8
1000-265-FD	Liberty North - 002601-Room 905	Bubbler	First Draw	0.4
1000-266-FD	Liberty North - 004050-New 800 Hall-Boys	Sink Tap	First Draw	<0.4
1000-267-FD	Liberty North - 004051-New 800 Hall-Boys	Sink Tap	First Draw	<0.4
1000-268-FD	Liberty North - 004052-New 800 Hall-Girls	Sink Tap	First Draw	<0.4
1000-269-FD	Liberty North - 004053-New 800 Hall-Girls	Sink Tap	First Draw	<0.4
1000-270-FD	Liberty North - 002626B-New 800 Hall	Drinking Fountain	First Draw	<0.4
1000-271-FD	Liberty North - 002626F-New 800 Hall	Bottle Filler	First Draw	<0.4
1000-272-FD	Liberty North - 002627-New 800 Hall	Drinking Fountain	First Draw	<0.4
1000-273-FD	Liberty North - 004060-Between Old/New 800 Hall	Drinking Fountain	First Draw	0.6
1000-274-FD	Liberty North - 004061-Between Old/New 800 Hall	Drinking Fountain	First Draw	<0.4
1000-277-FD	Liberty North - 002615-Room 822	Sink Tap	First Draw	<0.4
1000-278-FD	Liberty North - 002616-Room 822	Bubbler	First Draw	1.8
1000-279-FD	Liberty North - 002617-Room 813	Sink Tap	First Draw	<0.4
1000-280-FD	Liberty North - 002619-Room 817	Sink Tap	First Draw	1.1

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-281-FD	Liberty North - 002618-Room 817	Bubbler	First Draw	<0.4
1000-282-FD	Liberty North - 002621-Room 812	Sink Tap	First Draw	1
1000-283-FD	Liberty North - 002620-Room 812	Bubbler	First Draw	0.5
1000-284-FD	Liberty North - 002622-Room 810	Sink Tap	First Draw	<0.4
1000-285-FD	Liberty North - 002623-Room 810	Bubbler	First Draw	<0.4
1000-286-FD	Liberty North - 002625-Room 809	Sink Tap	First Draw	<0.4
1000-287-FD	Liberty North - 002624-Room 809-Handwashing	Sink Tap	First Draw	<0.4
1000-288-FD	Liberty North - 004058-Old 800 Hall-Girls	Drinking Fountain	First Draw	<0.4
1000-289-FD	Liberty North - 004059-Old 800 Hall-Girls	Drinking Fountain	First Draw	<0.4
1000-290-FD	Liberty North - 004055-Old 800 Hall-Girls	Sink Tap	First Draw	<0.4
1000-291-FD	Liberty North - 004054-Old 800 Hall-Girls	Sink Tap	First Draw	<0.4
1000-292-FD	Liberty North - 004057-Old 800 Hall-Girls	Sink Tap	First Draw	<0.4
1000-293-FD	Liberty North - 004056-Old 800 Hall-Girls	Sink Tap	First Draw	<0.4
1000-296-FD	Liberty North - 002587-Old 800 Hall-Boys	Sink Tap	First Draw	<0.4
1000-297-FD	Liberty North - 002588-Old 800 Hall-Boys	Sink Tap	First Draw	<0.4
1000-298-FD	Liberty North - 002589-Old 800 Hall-Boys	Sink Tap	First Draw	<0.4
1000-299-FD	Liberty North - 002590-Old 800 Hall-Boys	Sink Tap	First Draw	<0.4
1000-300-FD	Liberty North - 002606-Room 808	Sink Tap	First Draw	<0.4
1000-301-FD	Liberty North - 002605-Room 808	Bubbler	First Draw	<0.4
1000-302-FD	Liberty North - 002608-Room 815	Sink Tap	First Draw	<0.4
1000-303-FD	Liberty North - 002607-Room 815	Bubbler	First Draw	<0.4
1000-304-FD	Liberty North - 002610-Room 816	Sink Tap	First Draw	<0.4
1000-305-FD	Liberty North - 002609-Room 816	Bubbler	First Draw	<0.4
1000-306-FD	Liberty North - 002611-Room 820	Sink Tap	First Draw	<0.4
1000-307-FD	Liberty North - 002612-Room 820	Bubbler	First Draw	<0.4
1000-308-FD	Liberty North - 002614-Room 821	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-309-FD	Liberty North - 002613-Room 821-Restroom	Sink Tap	First Draw	<0.4
1000-310-FD	Liberty North - 003965-600 Hall	Drinking Fountain	First Draw	<0.4
1000-311-FD	Liberty North - 003965F-600 Hall	Bottle Filler	First Draw	<0.4
1000-312-FD	Liberty North - 003966-600 Hall	Drinking Fountain	First Draw	<0.4
1000-313-FD	Liberty North - 003969-600 Hall-Girls	Sink Tap	First Draw	<0.4
1000-314-FD	Liberty North - 003968-600 Hall-Girls	Sink Tap	First Draw	<0.4
1000-315-FD	Liberty North - 003967-600 Hall-Girls	Sink Tap	First Draw	<0.4
1000-316-FD	Liberty North - 003962-600 Hall-Boys	Sink Tap	First Draw	<0.4
1000-317-FD	Liberty North - 003963-600 Hall-Boys	Sink Tap	First Draw	<0.4
1000-318-FD	Liberty North - 003964-600 Hall-Boys	Sink Tap	First Draw	<0.4
1000-319-FD	Liberty North - 003971-Room 604	Sink Tap	First Draw	1.3
1000-320-FD	Liberty North - 003970-Room 604	Sink Tap	First Draw	0.4
1000-321-FD	Liberty North - 003975-Room 608A	Sink Tap	First Draw	<0.4
1000-322-FD	Liberty North - 002578-Room 608A	Ice Machine	First Draw	<0.4
1000-323-FD	Liberty North - 003972-Room 609E	Sink Tap	First Draw	0.4
1000-324-FD	Liberty North - 003973-Room 617C	Sink Tap	First Draw	<0.4
1000-325-FD	Liberty North - 003974-Room 617C	Bubbler	First Draw	<0.4
1000-326-FD	Liberty North - 003961-Nurse's Office	Sink Tap	First Draw	<0.4
1000-327-FD	Liberty North - 003960-Room 723	Sink Tap	First Draw	<0.4
1000-328-FD	Liberty North - 003959-Room 723	Sink Tap	First Draw	<0.4
1000-329-FD	Liberty North - 000957-L-Room 723	Ice Machine	First Draw	0.9
1000-330-FD	Liberty North - 003957-Room 600E	Sink Tap	First Draw	<0.4
1000-331-FD	Liberty North - 003958-Between 600F/600E	Drinking Fountain	First Draw	<0.4
1000-332-FD	Liberty North - 003058F-Between 600E/600F	Bottle Filler	First Draw	<0.4
1000-333-FD	Liberty North - 003956-Room 600F	Sink Tap	First Draw	<0.4
1000-334-FD	Liberty North - 002571-Room 505	Ice Machine	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-335-FD	Liberty North - 004135-Staff Lounge-Boys Restroom	Sink Tap	First Draw	<0.4
1000-336-FD	Liberty North - 004136-Staff Lounge-Girls Restroom	Sink Tap	First Draw	<0.4
1000-337-FD	Liberty North - 004137-Room 505-Between Restrooms	Sink Tap	First Draw	0.8
1000-338-FD	Liberty North - 004138-Room 505-By Refrigerator	Sink Tap	First Draw	<0.4
1000-339-FD	Liberty North - 003955-Cafeteria-Boys	Sink Tap	First Draw	4.7
1000-340-FD	Liberty North - 003951-Cafeteria-Boys	Sink Tap	First Draw	1.9
1000-341-FD	Liberty North - 003950-Cafeteria-Boys	Sink Tap	First Draw	14.5
1000-342-FD	Liberty North - 003952-Cafeteria-Girls	Sink Tap	First Draw	1.9
1000-343-FD	Liberty North - 003953-Cafeteria-Girls	Sink Tap	First Draw	1.8
1000-344-FD	Liberty North - 003954-Cafeteria-Girls	Sink Tap	First Draw	1.3
1000-345-FD	Liberty North - 004615-Kitchen	Sink Tap	First Draw	<0.4
1000-346-FD	Liberty North - 002574-Kitchen	Ice Machine	First Draw	1
1000-347-FD	Liberty North - 004610-Kitchen	Sink Tap	First Draw	0.5
1000-348-FD	Liberty North - 004609-Kitchen	Sink Tap	First Draw	<0.4
1000-349-FD	Liberty North - 004607-Kitchen-Three Bay Sink	Sink Tap	First Draw	3.5
1000-350-FD	Liberty North - 004608-Kitchen	Sink Tap	First Draw	0.4
1000-351-FD	Liberty North - 004611-Kitchen-Handwashing By Three Bay Sink	Sink Tap	First Draw	<0.4
1000-352-FD	Liberty North - 004605-Kitchen-Across From Freezer	Sink Tap	First Draw	1.1
1000-353-FD	Liberty North - 004606-Kitchen-Across From Freezer	Sink Tap	First Draw	2.9
1000-354-FD	Liberty North - 004603-Kitchen-Across From Kettle	Sink Tap	First Draw	0.5
1000-355-FD	Liberty North - 004604-Kitchen-Next to Kettle	Sink Tap	First Draw	4.8
1000-356-FD	Liberty North - 002368-Kitchen	Steam Kettle	First Draw	<0.4
1000-357-FD	Liberty North - 002367-Kitchen	Steam Kettle	First Draw	<0.4
1000-358-FD	Liberty North - 002366-Kitchen	Steam Kettle	First Draw	<0.4
1000-359-FD	Liberty North - 002572-Kitchen by 507D	Sink Tap	First Draw	0.5

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-360-FD	Liberty North - 004601-Kitchen-Handwashing By Office	Sink Tap	First Draw	0.9
1000-361-FD	Liberty North - 002365-Kitchen	Steam Kettle	First Draw	<0.4
1000-362-FD	Liberty North - 004602-Kitchen-Handwashing By Office	Sink Tap	First Draw	<0.4
1000-363-FD	Liberty North - 004870-Kitchen-Across From Office	Sink Tap	First Draw	<0.4
1000-364-FD	Liberty North - 004868-Kitchen-Restroom	Sink Tap	First Draw	<0.4
1000-365-FD	Liberty North - 004869-Kitchen-Restroom	Sink Tap	First Draw	<0.4
1000-366-FD	Liberty North - 004616-Kitchen-By Eagle Cafe Logo	Sink Tap	First Draw	0.8
1000-367-FD	Liberty North - 002575-Kitchen	Sink Tap	First Draw	<0.4
1000-368-FD	Liberty North - 004617-Kitchen-Middle Serving Line	Sink Tap	First Draw	0.4
1000-369-FD	Liberty North - 004613-Kitchen-Dishwasher Room	Sink Tap	First Draw	<0.4
1000-370-FD	Liberty North - 004614-Kitchen-Dishwasher Room	Sink Tap	First Draw	<0.4
1000-371-FD	Liberty North - 004618-Kitchen-Serving Line	Sink Tap	First Draw	<0.4
1000-372-FD	Liberty North - 004612-Kitchen	Sink Tap	First Draw	0.7
1000-373-FD	Liberty North - 002573-Kitchen	Drinking Fountain	First Draw	<0.4

May 1, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-112-FD	Liberty North - 003935-Boys By 403-Right	Drinking Fountain	First Draw	<0.4
1000-113-FD	Liberty North - 003936-Boys By 403-Left	Drinking Fountain	First Draw	<0.4
1000-118-FD	Liberty North - 003941-Girls By 403-Right	Drinking Fountain	First Draw	<0.4
1000-119-FD	Liberty North - 003942-Girls By 403-Left	Drinking Fountain	First Draw	<0.4
1000-131-FD	Liberty North - 003924-Girls Locker Room By 409-Right	Sink Tap	First Draw	<0.4
1000-198-FD	Liberty North - 004194-Fieldhouse	Drinking Fountain	First Draw	<0.4
1000-246-FD	Liberty North - 004088-New 900 Hall-Left	Drinking Fountain	First Draw	<0.4
1000-247-FD	Liberty North - 004089B-New 900 Hall-Right	Drinking Fountain	First Draw	<0.4
1000-248-FD	Liberty North - 004089-New 900 Hall	Bottle Filler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-249-FD	Liberty North - 004090-New 900 Hall-Boys-Far Left	Sink Tap	First Draw	<0.4
1000-250-FD	Liberty North - 004091-New 900 Hall-Boys-Left Middle	Sink Tap	First Draw	<0.4
1000-251-FD	Liberty North - 004092-New 900 Hall-Boys-Right Middle	Sink Tap	First Draw	<0.4
1000-252-FD	Liberty North - 004093-New 900 Hall-Boys-Far Right	Sink Tap	First Draw	<0.4
1000-253-FD	Liberty North - 004046-New 900 Hall-Girls-Far Right	Sink Tap	First Draw	<0.4
1000-254-FD	Liberty North - 004047-New 900 Hall-Girls-Right Middle	Sink Tap	First Draw	<0.4
1000-255-FD	Liberty North - 004048-New 900 Hall-Girls-Left Middle	Sink Tap	First Draw	<0.4
1000-256-FD	Liberty North - 004049-New 900 Hall-Girls-Far Left	Sink Tap	First Draw	<0.4
1000-275-FD	Liberty North - 004062-Between Old/New 800 Hall-Left Middle	Drinking Fountain	First Draw	<0.4
1000-276-FD	Liberty North - 004063-Between Old/New 800 Hall-Far Left	Drinking Fountain	First Draw	<0.4

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A
Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date:	**10/4/2023**
Expiration Date:	**10/4/2025**
License Number:	**211004-300006201**

Paula F. Nickelson
Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



Paula F. Nickelson
Acting Director
t of Health and Senior Services

son City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.

- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

PO Box 47166 Kansas City, MO 64188 • 816-678-7894 • www.axiomservicepros.com

Appendix C
Laboratory Analytical Report

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HD0051

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 1000 Northeast 104th Street

Project / PO Number: 1000 Northeast 104th Street
Received: 04/01/2024
Reported: 04/22/2024

Analytical Testing Parameters

Client Sample ID: 1000-1-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-01
Collected By: Bradley Young
Collection Date: 03/27/2024 13:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1603	JAR

Client Sample ID: 1000-2-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-02
Collected By: Bradley Young
Collection Date: 03/27/2024 13:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1606	JAR

Client Sample ID: 1000-3-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-03
Collected By: Bradley Young
Collection Date: 03/27/2024 13:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1609	JAR

Client Sample ID: 1000-4-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-04
Collected By: Bradley Young
Collection Date: 03/27/2024 13:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1612	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-5-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-05
Collected By: Bradley Young
Collection Date: 03/27/2024 13:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1615	JAR

Client Sample ID: 1000-6-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-06
Collected By: Bradley Young
Collection Date: 03/27/2024 13:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/19/24 1618	JAR

Client Sample ID: 1000-7-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-07
Collected By: Bradley Young
Collection Date: 03/27/2024 13:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/19/24 1621	JAR

Client Sample ID: 1000-8-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-08
Collected By: Bradley Young
Collection Date: 03/27/2024 13:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1624	JAR

Client Sample ID: 1000-9-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-09
Collected By: Bradley Young
Collection Date: 03/27/2024 13:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1639	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-10-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-10
Collected By: Bradley Young
Collection Date: 03/27/2024 13:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1648	JAR

Client Sample ID: 1000-11-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-11
Collected By: Bradley Young
Collection Date: 03/27/2024 13:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1651	JAR

Client Sample ID: 1000-12-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-12
Collected By: Bradley Young
Collection Date: 03/27/2024 13:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1654	JAR

Client Sample ID: 1000-13-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-13
Collected By: Bradley Young
Collection Date: 03/27/2024 1:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1657	JAR

Client Sample ID: 1000-14-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-14
Collected By: Bradley Young
Collection Date: 03/27/2024 13:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/19/24 1700	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-15-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-15
Collected By: Bradley Young
Collection Date: 03/27/2024 13:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1708	JAR

Client Sample ID: 1000-16-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-16
Collected By: Bradley Young
Collection Date: 03/27/2024 13:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1711	JAR

Client Sample ID: 1000-17-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-17
Collected By: Bradley Young
Collection Date: 03/27/2024 13:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1714	JAR

Client Sample ID: 1000-18-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-18
Collected By: Bradley Young
Collection Date: 03/27/2024 13:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1717	JAR

Client Sample ID: 1000-19-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-19
Collected By: Bradley Young
Collection Date: 03/27/2024 13:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1720	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-20-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-20
Collected By: Bradley Young
Collection Date: 03/27/2024 13:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1723	JAR

Client Sample ID: 1000-21-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-21
Collected By: Bradley Young
Collection Date: 03/27/2024 13:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1726	JAR

Client Sample ID: 1000-22-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-22
Collected By: Bradley Young
Collection Date: 03/27/2024 13:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/18/24 1457	04/19/24 1729	JAR

Client Sample ID: 1000-23-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-23
Collected By: Bradley Young
Collection Date: 03/27/2024 13:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1732	JAR

Client Sample ID: 1000-24-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-24
Collected By: Bradley Young
Collection Date: 03/27/2024 13:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1735	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-25-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-25
Collected By: Bradley Young
Collection Date: 03/27/2024 13:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1744	JAR

Client Sample ID: 1000-26-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-26
Collected By: Bradley Young
Collection Date: 03/27/2024 13:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1747	JAR

Client Sample ID: 1000-27-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-27
Collected By: Bradley Young
Collection Date: 03/27/2024 13:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1750	JAR

Client Sample ID: 1000-28-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-28
Collected By: Bradley Young
Collection Date: 03/27/2024 13:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/18/24 1457	04/19/24 1753	JAR

Client Sample ID: 1000-29-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-29
Collected By: Bradley Young
Collection Date: 03/27/2024 13:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1802	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-30-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-30
Collected By: Bradley Young
Collection Date: 03/27/2024 13:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.8**	0.4	ppb	2		04/18/24 1457	04/19/24 1811	JAR

Client Sample ID: 1000-31-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-31
Collected By: Bradley Young
Collection Date: 03/27/2024 13:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.4**	0.4	ppb	2		04/18/24 1457	04/19/24 1820	JAR

Client Sample ID: 1000-32-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-32
Collected By: Bradley Young
Collection Date: 03/27/2024 13:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/19/24 1823	JAR

Client Sample ID: 1000-33-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-33
Collected By: Bradley Young
Collection Date: 03/27/2024 13:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1826	JAR

Client Sample ID: 1000-34-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-34
Collected By: Bradley Young
Collection Date: 03/27/2024 13:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1829	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-35-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-35
Collected By: Bradley Young
Collection Date: 03/27/2024 13:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1832	JAR

Client Sample ID: 1000-36-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-36
Collected By: Bradley Young
Collection Date: 03/27/2024 13:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1835	JAR

Client Sample ID: 1000-37-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-37
Collected By: Bradley Young
Collection Date: 03/27/2024 13:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1838	JAR

Client Sample ID: 1000-38-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-38
Collected By: Bradley Young
Collection Date: 03/27/2024 13:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1841	JAR

Client Sample ID: 1000-39-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-39
Collected By: Bradley Young
Collection Date: 03/27/2024 13:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1844	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-40-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-40
Collected By: Bradley Young
Collection Date: 03/27/2024 13:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1847	JAR

Client Sample ID: 1000-41-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-41
Collected By: Bradley Young
Collection Date: 03/27/2024 13:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1856	JAR

Client Sample ID: 1000-42-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-42
Collected By: Bradley Young
Collection Date: 03/27/2024 13:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1859	JAR

Client Sample ID: 1000-43-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-43
Collected By: Bradley Young
Collection Date: 03/27/2024 13:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1902	JAR

Client Sample ID: 1000-44-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-44
Collected By: Bradley Young
Collection Date: 03/27/2024 13:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1905	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-45-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-45
Collected By: Bradley Young
Collection Date: 03/27/2024 13:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/19/24 1908	JAR

Client Sample ID: 1000-46-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-46
Collected By: Bradley Young
Collection Date: 03/27/2024 13:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1911	JAR

Client Sample ID: 1000-47-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-47
Collected By: Bradley Young
Collection Date: 03/27/2024 13:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1914	JAR

Client Sample ID: 1000-48-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-48
Collected By: Bradley Young
Collection Date: 03/27/2024 13:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1917	JAR

Client Sample ID: 1000-49-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-49
Collected By: Bradley Young
Collection Date: 03/27/2024 13:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1932	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID:	1000-50-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-50	**Collection Date:**	03/27/2024 13:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1941	JAR

Client Sample ID:	1000-51-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-51	**Collection Date:**	03/27/2024 13:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1944	JAR

Client Sample ID:	1000-52-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-52	**Collection Date:**	03/27/2024 13:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1947	JAR

Client Sample ID:	1000-53-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-53	**Collection Date:**	03/27/2024 13:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1950	JAR

Client Sample ID:	1000-54-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-54	**Collection Date:**	03/27/2024 13:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1953	JAR

Client Sample ID: 1000-55-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-55
Collected By: Bradley Young
Collection Date: 03/27/2024 13:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1457	04/19/24 1956	JAR

Client Sample ID: 1000-56-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-56
Collected By: Bradley Young
Collection Date: 03/27/2024 13:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 1959	JAR

Client Sample ID: 1000-57-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-57
Collected By: Bradley Young
Collection Date: 03/27/2024 13:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2008	JAR

Client Sample ID: 1000-58-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-58
Collected By: Bradley Young
Collection Date: 03/27/2024 13:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2011	JAR

Client Sample ID: 1000-59-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-59
Collected By: Bradley Young
Collection Date: 03/27/2024 13:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2014	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-60-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-60
Collected By: Bradley Young
Collection Date: 03/27/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2017	JAR

Client Sample ID: 1000-61-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-61
Collected By: Bradley Young
Collection Date: 03/27/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1457	04/19/24 2020	JAR

Client Sample ID: 1000-62-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-62
Collected By: Bradley Young
Collection Date: 03/27/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2023	JAR

Client Sample ID: 1000-63-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-63
Collected By: Bradley Young
Collection Date: 03/27/2024 13:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/18/24 1457	04/19/24 2026	JAR

Client Sample ID: 1000-64-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-64
Collected By: Bradley Young
Collection Date: 03/27/2024 13:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2029	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-65-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-65
Collected By: Bradley Young
Collection Date: 03/27/2024 13:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2032	JAR

Client Sample ID: 1000-66-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-66
Collected By: Bradley Young
Collection Date: 03/27/2024 13:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2035	JAR

Client Sample ID: 1000-67-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-67
Collected By: Bradley Young
Collection Date: 03/27/2024 13:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2044	JAR

Client Sample ID: 1000-68-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-68
Collected By: Bradley Young
Collection Date: 03/27/2024 13:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1457	04/19/24 2047	JAR

Client Sample ID: 1000-69-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-69
Collected By: Bradley Young
Collection Date: 03/27/2024 13:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2056	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-70-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-70
Collected By: Bradley Young
Collection Date: 03/27/2024 13:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2105	JAR

Client Sample ID: 1000-71-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-71
Collected By: Bradley Young
Collection Date: 03/27/2024 13:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2108	JAR

Client Sample ID: 1000-72-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-72
Collected By: Bradley Young
Collection Date: 03/27/2024 13:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2111	JAR

Client Sample ID: 1000-73-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-73
Collected By: Bradley Young
Collection Date: 03/27/2024 13:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2120	JAR

Client Sample ID: 1000-74-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-74
Collected By: Bradley Young
Collection Date: 03/27/2024 13:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2123	JAR

Client Sample ID: 1000-75-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-75
Collected By: Bradley Young
Collection Date: 03/27/2024 14:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1457	04/19/24 2126	JAR

Client Sample ID: 1000-76-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-76
Collected By: Bradley Young
Collection Date: 03/27/2024 14:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/18/24 1457	04/19/24 2129	JAR

Client Sample ID: 1000-77-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-77
Collected By: Bradley Young
Collection Date: 03/27/2024 14:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/18/24 1457	04/19/24 2132	JAR

Client Sample ID: 1000-78-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-78
Collected By: Bradley Young
Collection Date: 03/27/2024 14:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/18/24 1457	04/19/24 2135	JAR

Client Sample ID: 1000-79-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-79
Collected By: Bradley Young
Collection Date: 03/27/2024 14:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/18/24 1457	04/19/24 2138	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-80-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-80
Collected By: Bradley Young
Collection Date: 03/27/2024 14:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/18/24 1457	04/19/24 2141	JAR

Client Sample ID: 1000-81-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-81
Collected By: Bradley Young
Collection Date: 03/27/2024 14:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2144	JAR

Client Sample ID: 1000-82-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-82
Collected By: Bradley Young
Collection Date: 03/27/2024 14:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2147	JAR

Client Sample ID: 1000-83-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-83
Collected By: Bradley Young
Collection Date: 03/27/2024 14:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2156	JAR

Client Sample ID: 1000-84-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-84
Collected By: Bradley Young
Collection Date: 03/27/2024 14:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2159	JAR

Client Sample ID: 1000-85-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-85
Collected By: Bradley Young
Collection Date: 03/27/2024 14:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2202	JAR

Client Sample ID: 1000-86-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-86
Collected By: Bradley Young
Collection Date: 03/27/2024 14:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2205	JAR

Client Sample ID: 1000-87-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-87
Collected By: Bradley Young
Collection Date: 03/27/2024 14:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2208	JAR

Client Sample ID: 1000-88-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-88
Collected By: Bradley Young
Collection Date: 03/27/2024 14:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2211	JAR

Client Sample ID: 1000-89-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-89
Collected By: Bradley Young
Collection Date: 03/27/2024 14:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2220	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-90-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-90
Collected By: Bradley Young
Collection Date: 03/27/2024 14:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/18/24 1457	04/19/24 2235	JAR

Client Sample ID: 1000-91-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-91
Collected By: Bradley Young
Collection Date: 03/27/2024 14:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/18/24 1457	04/19/24 2238	JAR

Client Sample ID: 1000-92-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-92
Collected By: Bradley Young
Collection Date: 03/27/2024 14:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2241	JAR

Client Sample ID: 1000-93-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-93
Collected By: Bradley Young
Collection Date: 03/27/2024 14:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2244	JAR

Client Sample ID: 1000-94-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-94
Collected By: Bradley Young
Collection Date: 03/27/2024 14:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.2**	0.4	ppb	2		04/18/24 1457	04/19/24 2247	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID:	1000-95-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-95	**Collection Date:**	03/27/2024 14:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2250	JAR

Client Sample ID:	1000-96-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-96	**Collection Date:**	03/27/2024 14:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2253	JAR

Client Sample ID:	1000-97-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-97	**Collection Date:**	03/27/2024 14:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2256	JAR

Client Sample ID:	1000-98-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-98	**Collection Date:**	03/27/2024 14:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2259	JAR

Client Sample ID:	1000-99-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-99	**Collection Date:**	03/27/2024 14:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2308	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-100-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AA
Collected By: Bradley Young
Collection Date: 03/27/2024 14:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2311	JAR

Client Sample ID: 1000-101-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AB
Collected By: Bradley Young
Collection Date: 03/27/2024 14:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2314	JAR

Client Sample ID: 1000-102-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AC
Collected By: Bradley Young
Collection Date: 03/27/2024 14:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2317	JAR

Client Sample ID: 1000-103-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AD
Collected By: Bradley Young
Collection Date: 03/27/2024 14:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2320	JAR

Client Sample ID: 1000-104-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AE
Collected By: Bradley Young
Collection Date: 03/27/2024 14:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2323	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-105-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AF
Collected By: Bradley Young
Collection Date: 03/27/2024 14:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2326	JAR

Client Sample ID: 1000-106-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AG
Collected By: Bradley Young
Collection Date: 03/27/2024 14:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2329	JAR

Client Sample ID: 1000-107-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AH
Collected By: Bradley Young
Collection Date: 03/27/2024 14:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2332	JAR

Client Sample ID: 1000-108-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AI
Collected By: Bradley Young
Collection Date: 03/27/2024 14:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2334	JAR

Client Sample ID: 1000-109-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AJ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2349	JAR

Client Sample ID: 1000-110-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AK
Collected By: Bradley Young
Collection Date: 03/27/2024 14:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/19/24 2358	JAR

Client Sample ID: 1000-111-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AL
Collected By: Bradley Young
Collection Date: 03/27/2024 14:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0001	JAR

Client Sample ID: 1000-114-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AM
Collected By: Bradley Young
Collection Date: 03/27/2024 14:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0004	JAR

Client Sample ID: 1000-115-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AN
Collected By: Bradley Young
Collection Date: 03/27/2024 14:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0007	JAR

Client Sample ID: 1000-116-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AO
Collected By: Bradley Young
Collection Date: 03/27/2024 14:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0010	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-117-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AP
Collected By: Bradley Young
Collection Date: 03/27/2024 14:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0019	JAR

Client Sample ID: 1000-120-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AQ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0022	JAR

Client Sample ID: 1000-121-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AR
Collected By: Bradley Young
Collection Date: 03/27/2024 14:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0025	JAR

Client Sample ID: 1000-122-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AS
Collected By: Bradley Young
Collection Date: 03/27/2024 14:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0028	JAR

Client Sample ID: 1000-123-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AT
Collected By: Bradley Young
Collection Date: 03/27/2024 14:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0031	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-124-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AU
Collected By: Bradley Young
Collection Date: 03/27/2024 14:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0034	JAR

Client Sample ID: 1000-125-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AV
Collected By: Bradley Young
Collection Date: 03/27/2024 14:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/20/24 0037	JAR

Client Sample ID: 1000-126-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AW
Collected By: Bradley Young
Collection Date: 03/27/2024 14:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0040	JAR

Client Sample ID: 1000-127-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AX
Collected By: Bradley Young
Collection Date: 03/27/2024 14:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0043	JAR

Client Sample ID: 1000-128-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AY
Collected By: Bradley Young
Collection Date: 03/27/2024 14:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0046	JAR

Client Sample ID: 1000-129-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-AZ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0055	JAR

Client Sample ID: 1000-130-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BA
Collected By: Bradley Young
Collection Date: 03/27/2024 14:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0058	JAR

Client Sample ID: 1000-132-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BB
Collected By: Bradley Young
Collection Date: 03/27/2024 14:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0101	JAR

Client Sample ID: 1000-133-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BC
Collected By: Bradley Young
Collection Date: 03/27/2024 14:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0104	JAR

Client Sample ID: 1000-134-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BD
Collected By: Bradley Young
Collection Date: 03/27/2024 14:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0113	JAR

Client Sample ID: 1000-135-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BE
Collected By: Bradley Young
Collection Date: 03/27/2024 14:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0122	JAR

Client Sample ID: 1000-136-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BF
Collected By: Bradley Young
Collection Date: 03/27/2024 14:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0131	JAR

Client Sample ID: 1000-137-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BG
Collected By: Bradley Young
Collection Date: 03/27/2024 14:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0134	JAR

Client Sample ID: 1000-138-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BH
Collected By: Bradley Young
Collection Date: 03/27/2024 14:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/18/24 1457	04/20/24 0137	JAR

Client Sample ID: 1000-139-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BI
Collected By: Bradley Young
Collection Date: 03/27/2024 14:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0140	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-140-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BJ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0143	JAR

Client Sample ID: 1000-141-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BK
Collected By: Bradley Young
Collection Date: 03/27/2024 14:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0146	JAR

Client Sample ID: 1000-142-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BL
Collected By: Bradley Young
Collection Date: 03/27/2024 14:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/18/24 1457	04/20/24 0149	JAR

Client Sample ID: 1000-143-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BM
Collected By: Bradley Young
Collection Date: 03/27/2024 14:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0152	JAR

Client Sample ID: 1000-144-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BN
Collected By: Bradley Young
Collection Date: 03/27/2024 14:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0155	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-145-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BO
Collected By: Bradley Young
Collection Date: 03/27/2024 14:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/20/24 0158	JAR

Client Sample ID: 1000-146-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BP
Collected By: Bradley Young
Collection Date: 03/27/2024 14:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0207	JAR

Client Sample ID: 1000-147-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BQ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/20/24 0210	JAR

Client Sample ID: 1000-148-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BR
Collected By: Bradley Young
Collection Date: 03/27/2024 14:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0213	JAR

Client Sample ID: 1000-149-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BS
Collected By: Bradley Young
Collection Date: 03/27/2024 14:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/18/24 1457	04/20/24 0216	JAR

Client Sample ID: 1000-150-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BT
Collected By: Bradley Young
Collection Date: 03/27/2024 14:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/20/24 0219	JAR

Client Sample ID: 1000-151-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BU
Collected By: Bradley Young
Collection Date: 03/27/2024 14:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/18/24 1457	04/20/24 0222	JAR

Client Sample ID: 1000-152-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BV
Collected By: Bradley Young
Collection Date: 03/27/2024 14:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/18/24 1457	04/20/24 0225	JAR

Client Sample ID: 1000-153-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BW
Collected By: Bradley Young
Collection Date: 03/27/2024 14:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0228	JAR

Client Sample ID: 1000-154-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BX
Collected By: Bradley Young
Collection Date: 03/27/2024 14:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0243	JAR

Client Sample ID: 1000-155-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BY
Collected By: Bradley Young
Collection Date: 03/27/2024 14:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0252	JAR

Client Sample ID: 1000-156-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-BZ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0255	JAR

Client Sample ID: 1000-157-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CA
Collected By: Bradley Young
Collection Date: 03/27/2024 14:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0258	JAR

Client Sample ID: 1000-158-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CB
Collected By: Bradley Young
Collection Date: 03/27/2024 14:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0301	JAR

Client Sample ID: 1000-159-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CC
Collected By: Bradley Young
Collection Date: 03/27/2024 14:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/20/24 0304	JAR

Client Sample ID: 1000-160-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CD
Collected By: Bradley Young
Collection Date: 03/27/2024 14:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0307	JAR

Client Sample ID: 1000-161-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CE
Collected By: Bradley Young
Collection Date: 03/27/2024 14:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1457	04/20/24 0310	JAR

Client Sample ID: 1000-162-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CF
Collected By: Bradley Young
Collection Date: 03/27/2024 14:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/20/24 0319	JAR

Client Sample ID: 1000-163-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CG
Collected By: Bradley Young
Collection Date: 03/27/2024 14:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**9.4**	0.4	ppb	2		04/18/24 1457	04/20/24 0322	JAR

Client Sample ID: 1000-164-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CH
Collected By: Bradley Young
Collection Date: 03/27/2024 14:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0325	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-165-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CI
Collected By: Bradley Young
Collection Date: 03/27/2024 14:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0328	JAR

Client Sample ID: 1000-166-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CJ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0331	JAR

Client Sample ID: 1000-167-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CK
Collected By: Bradley Young
Collection Date: 03/27/2024 14:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0334	JAR

Client Sample ID: 1000-168-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CL
Collected By: Bradley Young
Collection Date: 03/27/2024 14:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0337	JAR

Client Sample ID: 1000-169-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CM
Collected By: Bradley Young
Collection Date: 03/27/2024 14:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1457	04/20/24 0340	JAR

Client Sample ID: 1000-170-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CN
Collected By: Bradley Young
Collection Date: 03/27/2024 14:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0343	JAR

Client Sample ID: 1000-171-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CO
Collected By: Bradley Young
Collection Date: 03/27/2024 14:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0346	JAR

Client Sample ID: 1000-172-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CP
Collected By: Bradley Young
Collection Date: 03/27/2024 14:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0355	JAR

Client Sample ID: 1000-173-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CQ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0358	JAR

Client Sample ID: 1000-174-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CR
Collected By: Bradley Young
Collection Date: 03/27/2024 14:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0407	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-175-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CS
Collected By: Bradley Young
Collection Date: 03/27/2024 14:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.7**	0.4	ppb	2		04/18/24 1457	04/20/24 0416	JAR

Client Sample ID: 1000-176-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CT
Collected By: Bradley Young
Collection Date: 03/27/2024 14:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0419	JAR

Client Sample ID: 1000-177-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CU
Collected By: Bradley Young
Collection Date: 03/27/2024 14:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0422	JAR

Client Sample ID: 1000-178-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CV
Collected By: Bradley Young
Collection Date: 03/27/2024 14:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0431	JAR

Client Sample ID: 1000-179-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CW
Collected By: Bradley Young
Collection Date: 03/27/2024 14:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0434	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-180-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CX
Collected By: Bradley Young
Collection Date: 03/27/2024 14:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/18/24 1457	04/20/24 0437	JAR

Client Sample ID: 1000-181-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CY
Collected By: Bradley Young
Collection Date: 03/27/2024 14:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1457	04/20/24 0440	JAR

Client Sample ID: 1000-182-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-CZ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.7**	0.4	ppb	2		04/18/24 1457	04/20/24 0443	JAR

Client Sample ID: 1000-183-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DA
Collected By: Bradley Young
Collection Date: 03/27/2024 14:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0446	JAR

Client Sample ID: 1000-184-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DB
Collected By: Bradley Young
Collection Date: 03/27/2024 14:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0449	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-185-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DC
Collected By: Bradley Young
Collection Date: 03/27/2024 14:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1457	04/20/24 0452	JAR

Client Sample ID: 1000-186-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DD
Collected By: Bradley Young
Collection Date: 03/27/2024 14:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/18/24 1457	04/20/24 0455	JAR

Client Sample ID: 1000-187-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DE
Collected By: Bradley Young
Collection Date: 03/27/2024 14:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0458	JAR

Client Sample ID: 1000-188-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DF
Collected By: Bradley Young
Collection Date: 03/27/2024 14:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1457	04/20/24 0507	JAR

Client Sample ID: 1000-189-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DG
Collected By: Bradley Young
Collection Date: 03/27/2024 14:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1117	JAR

Client Sample ID: 1000-190-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DH
Collected By: Bradley Young
Collection Date: 03/27/2024 14:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1126	JAR

Client Sample ID: 1000-191-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DI
Collected By: Bradley Young
Collection Date: 03/27/2024 14:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1129	JAR

Client Sample ID: 1000-192-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DJ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1132	JAR

Client Sample ID: 1000-193-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DK
Collected By: Bradley Young
Collection Date: 03/27/2024 14:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1141	JAR

Client Sample ID: 1000-194-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DL
Collected By: Bradley Young
Collection Date: 03/27/2024 14:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/18/24 1526	04/20/24 1144	JAR

Client Sample ID: 1000-195-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DM
Collected By: Bradley Young
Collection Date: 03/27/2024 14:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1147	JAR

Client Sample ID: 1000-196-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DN
Collected By: Bradley Young
Collection Date: 03/27/2024 14:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1150	JAR

Client Sample ID: 1000-197-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DO
Collected By: Bradley Young
Collection Date: 03/27/2024 14:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1153	JAR

Client Sample ID: 1000-199-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DP
Collected By: Bradley Young
Collection Date: 03/27/2024 14:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1156	JAR

Client Sample ID: 1000-200-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DQ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1159	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-201-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DR
Collected By: Bradley Young
Collection Date: 03/27/2024 14:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1202	JAR

Client Sample ID: 1000-202-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DS
Collected By: Bradley Young
Collection Date: 03/27/2024 14:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1526	04/20/24 1205	JAR

Client Sample ID: 1000-203-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DT
Collected By: Bradley Young
Collection Date: 03/27/2024 14:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/18/24 1526	04/20/24 1208	JAR

Client Sample ID: 1000-204-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DU
Collected By: Bradley Young
Collection Date: 03/27/2024 14:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1216	JAR

Client Sample ID: 1000-205-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DV
Collected By: Bradley Young
Collection Date: 03/27/2024 14:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1219	JAR

Client Sample ID: 1000-206-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DW
Collected By: Bradley Young
Collection Date: 03/27/2024 14:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1222	JAR

Client Sample ID: 1000-207-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DX
Collected By: Bradley Young
Collection Date: 03/27/2024 14:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1225	JAR

Client Sample ID: 1000-208-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DY
Collected By: Bradley Young
Collection Date: 03/27/2024 14:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1228	JAR

Client Sample ID: 1000-209-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-DZ
Collected By: Bradley Young
Collection Date: 03/27/2024 14:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1231	JAR

Client Sample ID: 1000-210-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EA
Collected By: Bradley Young
Collection Date: 03/27/2024 14:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1240	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-211-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EB
Collected By: Bradley Young
Collection Date: 03/27/2024 14:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1255	JAR

Client Sample ID: 1000-212-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EC
Collected By: Bradley Young
Collection Date: 03/27/2024 14:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1258	JAR

Client Sample ID: 1000-213-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-ED
Collected By: Bradley Young
Collection Date: 03/27/2024 14:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1301	JAR

Client Sample ID: 1000-214-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EE
Collected By: Bradley Young
Collection Date: 03/27/2024 14:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1304	JAR

Client Sample ID: 1000-215-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EF
Collected By: Bradley Young
Collection Date: 03/27/2024 14:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1526	04/20/24 1307	JAR

Client Sample ID: 1000-216-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EG
Collected By: Bradley Young
Collection Date: 03/27/2024 14:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1310	JAR

Client Sample ID: 1000-217-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EH
Collected By: Bradley Young
Collection Date: 03/27/2024 14:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1313	JAR

Client Sample ID: 1000-218-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EI
Collected By: Bradley Young
Collection Date: 03/27/2024 15:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1316	JAR

Client Sample ID: 1000-219-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EJ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1319	JAR

Client Sample ID: 1000-220-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EK
Collected By: Bradley Young
Collection Date: 03/27/2024 15:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1328	JAR

Client Sample ID: 1000-221-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EL
Collected By: Bradley Young
Collection Date: 03/27/2024 15:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1331	JAR

Client Sample ID: 1000-222-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EM
Collected By: Bradley Young
Collection Date: 03/27/2024 15:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1334	JAR

Client Sample ID: 1000-223-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EN
Collected By: Bradley Young
Collection Date: 03/27/2024 15:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1337	JAR

Client Sample ID: 1000-224-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EO
Collected By: Bradley Young
Collection Date: 03/27/2024 15:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1340	JAR

Client Sample ID: 1000-225-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EP
Collected By: Bradley Young
Collection Date: 03/27/2024 15:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1342	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-226-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EQ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1345	JAR

Client Sample ID: 1000-227-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-ER
Collected By: Bradley Young
Collection Date: 03/27/2024 15:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1348	JAR

Client Sample ID: 1000-228-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-ES
Collected By: Bradley Young
Collection Date: 03/27/2024 15:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1351	JAR

Client Sample ID: 1000-229-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-ET
Collected By: Bradley Young
Collection Date: 03/27/2024 15:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/18/24 1526	04/20/24 1354	JAR

Client Sample ID: 1000-230-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EU
Collected By: Bradley Young
Collection Date: 03/27/2024 15:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1409	JAR

Client Sample ID: 1000-231-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EV
Collected By: Bradley Young
Collection Date: 03/27/2024 15:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/22/24 0819	JAR

Client Sample ID: 1000-232-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EW
Collected By: Bradley Young
Collection Date: 03/27/2024 15:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/18/24 1526	04/20/24 1421	JAR

Client Sample ID: 1000-233-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EX
Collected By: Bradley Young
Collection Date: 03/27/2024 15:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/18/24 1526	04/20/24 1424	JAR

Client Sample ID: 1000-234-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EY
Collected By: Bradley Young
Collection Date: 03/27/2024 15:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1526	04/20/24 1427	JAR

Client Sample ID: 1000-235-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-EZ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/18/24 1526	04/20/24 1430	JAR

Client Sample ID: 1000-236-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FA
Collected By: Bradley Young
Collection Date: 03/27/2024 15:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1439	JAR

Client Sample ID: 1000-237-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FB
Collected By: Bradley Young
Collection Date: 03/27/2024 15:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1442	JAR

Client Sample ID: 1000-238-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FC
Collected By: Bradley Young
Collection Date: 03/27/2024 15:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1445	JAR

Client Sample ID: 1000-239-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FD
Collected By: Bradley Young
Collection Date: 03/27/2024 15:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.9**	0.4	ppb	2		04/18/24 1526	04/20/24 1448	JAR

Client Sample ID: 1000-240-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FE
Collected By: Bradley Young
Collection Date: 03/27/2024 15:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1451	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-241-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FF
Collected By: Bradley Young
Collection Date: 03/27/2024 15:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1454	JAR

Client Sample ID: 1000-242-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FG
Collected By: Bradley Young
Collection Date: 03/27/2024 15:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1457	JAR

Client Sample ID: 1000-243-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FH
Collected By: Bradley Young
Collection Date: 03/27/2024 15:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1500	JAR

Client Sample ID: 1000-244-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FI
Collected By: Bradley Young
Collection Date: 03/27/2024 15:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1503	JAR

Client Sample ID: 1000-245-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FJ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1506	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-257-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FK
Collected By: Bradley Young
Collection Date: 03/27/2024 15:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1515	JAR

Client Sample ID: 1000-258-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FL
Collected By: Bradley Young
Collection Date: 03/27/2024 15:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.6**	0.4	ppb	2		04/18/24 1526	04/20/24 1518	JAR

Client Sample ID: 1000-259-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FM
Collected By: Bradley Young
Collection Date: 03/27/2024 15:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1521	JAR

Client Sample ID: 1000-260-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FN
Collected By: Bradley Young
Collection Date: 03/27/2024 15:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**5.2**	0.4	ppb	2		04/18/24 1526	04/20/24 1524	JAR

Client Sample ID: 1000-261-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FO
Collected By: Bradley Young
Collection Date: 03/27/2024 15:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1533	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-262-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FP
Collected By: Bradley Young
Collection Date: 03/27/2024 15:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1541	JAR

Client Sample ID: 1000-263-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FQ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1550	JAR

Client Sample ID: 1000-264-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FR
Collected By: Bradley Young
Collection Date: 03/27/2024 15:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/18/24 1526	04/20/24 1553	JAR

Client Sample ID: 1000-265-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FS
Collected By: Bradley Young
Collection Date: 03/27/2024 15:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1526	04/20/24 1556	JAR

Client Sample ID: 1000-266-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FT
Collected By: Bradley Young
Collection Date: 03/27/2024 15:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1559	JAR

Client Sample ID: 1000-267-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FU
Collected By: Bradley Young
Collection Date: 03/27/2024 15:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1602	JAR

Client Sample ID: 1000-268-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FV
Collected By: Bradley Young
Collection Date: 03/27/2024 15:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1605	JAR

Client Sample ID: 1000-269-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FW
Collected By: Bradley Young
Collection Date: 03/27/2024 15:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1608	JAR

Client Sample ID: 1000-270-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FX
Collected By: Bradley Young
Collection Date: 03/27/2024 15:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1611	JAR

Client Sample ID: 1000-271-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FY
Collected By: Bradley Young
Collection Date: 03/27/2024 15:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1614	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-272-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-FZ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1617	JAR

Client Sample ID: 1000-273-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GA
Collected By: Bradley Young
Collection Date: 03/27/2024 15:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/18/24 1526	04/20/24 1626	JAR

Client Sample ID: 1000-274-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GB
Collected By: Bradley Young
Collection Date: 03/27/2024 15:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1629	JAR

Client Sample ID: 1000-277-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GC
Collected By: Bradley Young
Collection Date: 03/27/2024 15:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1632	JAR

Client Sample ID: 1000-278-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GD
Collected By: Bradley Young
Collection Date: 03/27/2024 15:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/18/24 1526	04/20/24 1635	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-279-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GE
Collected By: Bradley Young
Collection Date: 03/27/2024 15:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1638	JAR

Client Sample ID: 1000-280-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GF
Collected By: Bradley Young
Collection Date: 03/27/2024 15:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/18/24 1526	04/20/24 1641	JAR

Client Sample ID: 1000-281-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GG
Collected By: Bradley Young
Collection Date: 03/27/2024 15:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1644	JAR

Client Sample ID: 1000-282-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GH
Collected By: Bradley Young
Collection Date: 03/27/2024 15:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/18/24 1526	04/20/24 1647	JAR

Client Sample ID: 1000-283-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GI
Collected By: Bradley Young
Collection Date: 03/27/2024 15:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1526	04/20/24 1702	JAR

Client Sample ID: 1000-284-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GJ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1711	JAR

Client Sample ID: 1000-285-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GK
Collected By: Bradley Young
Collection Date: 03/27/2024 15:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1714	JAR

Client Sample ID: 1000-286-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GL
Collected By: Bradley Young
Collection Date: 03/27/2024 15:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1717	JAR

Client Sample ID: 1000-287-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GM
Collected By: Bradley Young
Collection Date: 03/27/2024 15:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1720	JAR

Client Sample ID: 1000-288-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GN
Collected By: Bradley Young
Collection Date: 03/27/2024 15:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1723	JAR

Client Sample ID: 1000-289-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GO
Collected By: Bradley Young
Collection Date: 03/27/2024 15:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1726	JAR

Client Sample ID: 1000-290-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GP
Collected By: Bradley Young
Collection Date: 03/27/2024 15:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1729	JAR

Client Sample ID: 1000-291-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GQ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1738	JAR

Client Sample ID: 1000-292-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GR
Collected By: Bradley Young
Collection Date: 03/27/2024 15:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1741	JAR

Client Sample ID: 1000-293-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GS
Collected By: Bradley Young
Collection Date: 03/27/2024 15:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1744	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-296-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GT
Collected By: Bradley Young
Collection Date: 03/27/2024 15:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1747	JAR

Client Sample ID: 1000-297-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GU
Collected By: Bradley Young
Collection Date: 03/27/2024 15:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1750	JAR

Client Sample ID: 1000-298-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GV
Collected By: Bradley Young
Collection Date: 03/27/2024 15:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1753	JAR

Client Sample ID: 1000-299-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GW
Collected By: Bradley Young
Collection Date: 03/27/2024 15:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1756	JAR

Client Sample ID: 1000-300-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GX
Collected By: Bradley Young
Collection Date: 03/27/2024 15:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1759	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-301-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GY
Collected By: Bradley Young
Collection Date: 03/27/2024 15:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1802	JAR

Client Sample ID: 1000-302-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-GZ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1805	JAR

Client Sample ID: 1000-303-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HA
Collected By: Bradley Young
Collection Date: 03/27/2024 15:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1814	JAR

Client Sample ID: 1000-304-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HB
Collected By: Bradley Young
Collection Date: 03/27/2024 15:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1817	JAR

Client Sample ID: 1000-305-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HC
Collected By: Bradley Young
Collection Date: 03/27/2024 15:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1826	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-306-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HD
Collected By: Bradley Young
Collection Date: 03/27/2024 15:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1835	JAR

Client Sample ID: 1000-307-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HE
Collected By: Bradley Young
Collection Date: 03/27/2024 15:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1838	JAR

Client Sample ID: 1000-308-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HF
Collected By: Bradley Young
Collection Date: 03/27/2024 15:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1841	JAR

Client Sample ID: 1000-309-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HG
Collected By: Bradley Young
Collection Date: 03/27/2024 15:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1850	JAR

Client Sample ID: 1000-310-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HH
Collected By: Bradley Young
Collection Date: 03/27/2024 15:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1853	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID:	1000-311-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-HI	**Collection Date:**	03/27/2024 15:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1856	JAR

Client Sample ID:	1000-312-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-HJ	**Collection Date:**	03/27/2024 15:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1859	JAR

Client Sample ID:	1000-313-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-HK	**Collection Date:**	03/27/2024 15:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1902	JAR

Client Sample ID:	1000-314-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-HL	**Collection Date:**	03/27/2024 15:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1905	JAR

Client Sample ID:	1000-315-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-HM	**Collection Date:**	03/27/2024 15:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1908	JAR

Client Sample ID: 1000-316-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HN
Collected By: Bradley Young
Collection Date: 03/27/2024 15:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1911	JAR

Client Sample ID: 1000-317-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HO
Collected By: Bradley Young
Collection Date: 03/27/2024 15:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1914	JAR

Client Sample ID: 1000-318-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HP
Collected By: Bradley Young
Collection Date: 03/27/2024 15:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1526	04/20/24 1917	JAR

Client Sample ID: 1000-319-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HQ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/18/24 1526	04/20/24 1926	JAR

Client Sample ID: 1000-320-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HR
Collected By: Bradley Young
Collection Date: 03/27/2024 15:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1543	04/21/24 1201	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-321-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HS
Collected By: Bradley Young
Collection Date: 03/27/2024 15:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1214	JAR

Client Sample ID: 1000-322-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HT
Collected By: Bradley Young
Collection Date: 03/27/2024 15:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1219	JAR

Client Sample ID: 1000-323-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HU
Collected By: Bradley Young
Collection Date: 03/27/2024 15:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1543	04/21/24 1223	JAR

Client Sample ID: 1000-324-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HV
Collected By: Bradley Young
Collection Date: 03/27/2024 15:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1228	JAR

Client Sample ID: 1000-325-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HW
Collected By: Bradley Young
Collection Date: 03/27/2024 15:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1232	JAR

Client Sample ID: 1000-326-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HX
Collected By: Bradley Young
Collection Date: 03/27/2024 15:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1237	JAR

Client Sample ID: 1000-327-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HY
Collected By: Bradley Young
Collection Date: 03/27/2024 15:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1241	JAR

Client Sample ID: 1000-328-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-HZ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1246	JAR

Client Sample ID: 1000-329-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IA
Collected By: Bradley Young
Collection Date: 03/27/2024 15:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/18/24 1543	04/21/24 1250	JAR

Client Sample ID: 1000-330-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IB
Collected By: Bradley Young
Collection Date: 03/27/2024 15:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1255	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-331-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IC
Collected By: Bradley Young
Collection Date: 03/27/2024 15:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1308	JAR

Client Sample ID: 1000-332-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-ID
Collected By: Bradley Young
Collection Date: 03/27/2024 15:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1313	JAR

Client Sample ID: 1000-333-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IE
Collected By: Bradley Young
Collection Date: 03/27/2024 15:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1317	JAR

Client Sample ID: 1000-334-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IF
Collected By: Bradley Young
Collection Date: 03/27/2024 15:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1322	JAR

Client Sample ID: 1000-335-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IG
Collected By: Bradley Young
Collection Date: 03/27/2024 15:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1326	JAR

Client Sample ID: 1000-336-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IH
Collected By: Bradley Young
Collection Date: 03/27/2024 15:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1331	JAR

Client Sample ID: 1000-337-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-II
Collected By: Bradley Young
Collection Date: 03/27/2024 15:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/18/24 1543	04/21/24 1335	JAR

Client Sample ID: 1000-338-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IJ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1349	JAR

Client Sample ID: 1000-339-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IK
Collected By: Bradley Young
Collection Date: 03/27/2024 15:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.7**	0.4	ppb	2		04/18/24 1543	04/21/24 1412	JAR

Client Sample ID: 1000-340-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IL
Collected By: Bradley Young
Collection Date: 03/27/2024 15:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.9**	0.4	ppb	2		04/18/24 1543	04/21/24 1416	JAR

Client Sample ID: 1000-341-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IM
Collected By: Bradley Young
Collection Date: 03/27/2024 15:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**14.5**	0.4	ppb	2		04/18/24 1543	04/21/24 1421	JAR

Client Sample ID: 1000-342-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IN
Collected By: Bradley Young
Collection Date: 03/27/2024 15:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.9**	0.4	ppb	2		04/18/24 1543	04/21/24 1425	JAR

Client Sample ID: 1000-343-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IO
Collected By: Bradley Young
Collection Date: 03/27/2024 15:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/18/24 1543	04/21/24 1430	JAR

Client Sample ID: 1000-344-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IP
Collected By: Bradley Young
Collection Date: 03/27/2024 15:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/18/24 1543	04/21/24 1434	JAR

Client Sample ID: 1000-345-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IQ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1439	JAR

Client Sample ID: 1000-346-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IR
Collected By: Bradley Young
Collection Date: 03/27/2024 15:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/18/24 1543	04/21/24 1443	JAR

Client Sample ID: 1000-347-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IS
Collected By: Bradley Young
Collection Date: 03/27/2024 15:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1543	04/21/24 1457	JAR

Client Sample ID: 1000-348-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IT
Collected By: Bradley Young
Collection Date: 03/27/2024 15:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1501	JAR

Client Sample ID: 1000-349-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IU
Collected By: Bradley Young
Collection Date: 03/27/2024 15:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.5**	0.4	ppb	2		04/18/24 1543	04/21/24 1506	JAR

Client Sample ID: 1000-350-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IV
Collected By: Bradley Young
Collection Date: 03/27/2024 15:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1543	04/21/24 1510	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-351-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IW
Collected By: Bradley Young
Collection Date: 03/27/2024 15:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1515	JAR

Client Sample ID: 1000-352-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IX
Collected By: Bradley Young
Collection Date: 03/27/2024 15:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/18/24 1543	04/21/24 1519	JAR

Client Sample ID: 1000-353-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IY
Collected By: Bradley Young
Collection Date: 03/27/2024 15:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.9**	0.4	ppb	2		04/18/24 1543	04/21/24 1524	JAR

Client Sample ID: 1000-354-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-IZ
Collected By: Bradley Young
Collection Date: 03/27/2024 15:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1543	04/21/24 1528	JAR

Client Sample ID: 1000-355-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JA
Collected By: Bradley Young
Collection Date: 03/27/2024 16:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.8**	0.4	ppb	2		04/18/24 1543	04/21/24 1533	JAR

Client Sample ID: 1000-356-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JB
Collected By: Bradley Young
Collection Date: 03/27/2024 16:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1538	JAR

Client Sample ID: 1000-357-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JC
Collected By: Bradley Young
Collection Date: 03/27/2024 16:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1551	JAR

Client Sample ID: 1000-358-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JD
Collected By: Bradley Young
Collection Date: 03/27/2024 16:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1605	JAR

Client Sample ID: 1000-359-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JE
Collected By: Bradley Young
Collection Date: 03/27/2024 16:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/18/24 1543	04/21/24 1618	JAR

Client Sample ID: 1000-360-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JF
Collected By: Bradley Young
Collection Date: 03/27/2024 16:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/18/24 1543	04/21/24 1623	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID: 1000-361-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JG
Collected By: Bradley Young
Collection Date: 03/27/2024 16:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1627	JAR

Client Sample ID: 1000-362-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JH
Collected By: Bradley Young
Collection Date: 03/27/2024 16:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1632	JAR

Client Sample ID: 1000-363-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JI
Collected By: Bradley Young
Collection Date: 03/27/2024 16:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1645	JAR

Client Sample ID: 1000-364-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JJ
Collected By: Bradley Young
Collection Date: 03/27/2024 16:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1650	JAR

Client Sample ID: 1000-365-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JK
Collected By: Bradley Young
Collection Date: 03/27/2024 16:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1654	JAR

Client Sample ID: 1000-366-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JL
Collected By: Bradley Young
Collection Date: 03/27/2024 16:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/18/24 1543	04/21/24 1659	JAR

Client Sample ID: 1000-367-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JM
Collected By: Bradley Young
Collection Date: 03/27/2024 16:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1703	JAR

Client Sample ID: 1000-368-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JN
Collected By: Bradley Young
Collection Date: 03/27/2024 16:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/18/24 1543	04/21/24 1708	JAR

Client Sample ID: 1000-369-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JO
Collected By: Bradley Young
Collection Date: 03/27/2024 16:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1713	JAR

Client Sample ID: 1000-370-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0051-JP
Collected By: Bradley Young
Collection Date: 03/27/2024 16:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1717	JAR

CERTIFICATE OF ANALYSIS

3HD0051

Client Sample ID:	1000-371-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-JQ	**Collection Date:**	03/27/2024 16:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1722	JAR

Client Sample ID:	1000-372-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-JR	**Collection Date:**	03/27/2024 16:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/18/24 1543	04/21/24 1726	JAR

Client Sample ID:	1000-373-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0051-JS	**Collection Date:**	03/27/2024 16:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/18/24 1543	04/21/24 1740	JAR

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
04/22/24 12:06

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-1-FD	3/27/2024	13:31	Liberty North - Sink Tap - 003976-Main Office	1	Wt	Grab	X								01
1000-2-FD	3/27/2024	13:32	Liberty North - Sink Tap - 002301/3977-Main Office-Staff Bathroom-Girls	1	Wt	Grab	X								02
1000-3-FD	3/27/2024	13:32	Liberty North - Sink Tap - 003978-Hallway by Main Office	1	Wt	Grab	X								03
1000-4-FD	3/27/2024	13:33	Liberty North - Drinking Fountain - 003994-Old 100 Hall-Boys-Left	1	Wt	Grab	X								04
1000-5-FD	3/27/2024	13:33	Liberty North - Drinking Fountain - 003995-Old 100 Hall-Boys-Right	1	Wt	Grab	X								05
1000-6-FD	3/27/2024	13:33	Liberty North - Sink Tap - 03990-Old 100 Hall-Boys-Far Left	1	Wt	Grab	X								06
1000-7-FD	3/27/2024	13:34	Liberty North - Sink Tap - 003991-Old 100 Hall-Boys	1	Wt	Grab	X								07

LAB USE ONLY
Wk Order #: 3HD0051
Short Hold:
Rush:
Temp: oC 20.2

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/1/24	
				Time:	10:00	
	Time:					

3HD0051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-8-FD	3/27/2024	13:34	Liberty North - Sink Tap - 003992-Old 100 Hall-Boys	1	Wt	Grab	X								08
1000-9-FD	3/27/2024	13:35	Liberty North - Sink Tap - 003993-Old 100 Hallway-Boys	1	Wt	Grab	X								09
1000-10-FD	3/27/2024	13:35	Liberty North - Drinking Fountain - 003801-Old 100 Hall-Girls-Left	1	Wt	Grab	X								10
1000-11-FD	3/27/2024	13:35	Liberty North - Drinking Fountain - 004000-Old 100 Hall-Girls-Right	1	Wt	Grab	X								11
1000-12-FD	3/27/2024	13:36	Liberty North - Sink Tap - 003996-Old 100 Hall-Girls-Far Left	1	Wt	Grab	X								12
1000-13-FD	3/27/2024	01:36	Liberty North - Sink Tap - 003997-Old 100 Hall-Girls	1	Wt	Grab	X								13
1000-14-FD	3/27/2024	13:37	Liberty North - Sink Tap - 003998-Old 100 Hall-Girls	1	Wt	Grab	X								14

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-15-FD	3/27/2024	13:37	Liberty North - Sink Tap - 003999-Old 100 Hall-Girls-Far Right	1	Wt	Grab	X								15
1000-16-FD	3/27/2024	13:37	Liberty North - Sink Tap - 003979-Room 110-Southeast Corner	1	Wt	Grab	X								16
1000-17-FD	3/27/2024	13:37	Liberty North - Sink Tap - 003980-Room 110-South Middle	1	Wt	Grab	X								17
1000-18-FD	3/27/2024	13:38	Liberty North - Sink Tap - 003981-Room 110-Southwest Corner	1	Wt	Grab	X								18
1000-19-FD	3/27/2024	13:38	Liberty North - Sink Tap - 003982-Room 110-Northwest Corner	1	Wt	Grab	X								19
1000-20-FD	3/27/2024	13:39	Liberty North - Sink Tap - 003983-Room 110-North Middle	1	Wt	Grab	X								20
1000-21-FD	3/27/2024	13:39	Liberty North - Sink Tap - 003984-Room 110-Northeast corner	1	Wt	Grab	X								21

LAB USE ONLY: Wk Order #: ___ Short Hold: ___ Rush: ___ Temp: oC ___

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-22-FD	3/27/2024	13:39	Liberty North - Ice Machine - 000932-L-Room 110	1	Wt	Grab	X								22
1000-23-FD	3/27/2024	13:40	Liberty North - Sink Tap - 003987-Room 109	1	Wt	Grab	X								23
1000-24-FD	3/27/2024	13:40	Liberty North - Sink Tap - 003988-Room 109	1	Wt	Grab	X								24
1000-25-FD	3/27/2024	13:40	Liberty North - Sink Tap - 003989-Room 109	1	Wt	Grab	X								25
1000-26-FD	3/27/2024	13:40	Liberty North - Ice Machine - 002579-Room 109	1	Wt	Grab	X								26
1000-27-FD	3/27/2024	13:41	Liberty North - Sink Tap - 003986-Room 111	1	Wt	Grab	X								27
1000-28-FD	3/27/2024	13:41	Liberty North - Bubbler - 003985-Room 111	1	Wt	Grab	X								28

LAB USE ONLY: Wk Order #: ___ Short Hold: ___ Rush: ___ Temp: oC ___

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-29-FD	3/27/2024	13:41	Liberty North - Sink Tap - 002580-Room 113	1	Wt	Grab	X								29
1000-30-FD	3/27/2024	13:42	Liberty North - Bubbler - 002581-Room 113	1	Wt	Grab	X								30
1000-31-FD	3/27/2024	13:42	Liberty North - Drinking Fountain - 003819- Between Old/New 100 Hall	1	Wt	Grab	X								31
1000-32-FD	3/27/2024	13:42	Liberty North - Drinking Fountain - 003820- Between Old/New 100 Hall	1	Wt	Grab	X								32
1000-33-FD	3/27/2024	13:43	Liberty North - Drinking Fountain - 003821- Between Old/New 100 Hall	1	Wt	Grab	X								33
1000-34-FD	3/27/2024	13:43	Liberty North - Drinking Fountain - 003822- Between old/new 100 Hall	1	Wt	Grab	X								34
1000-35-FD	3/27/2024	13:45	Liberty North - Sink Tap - 003802-Room 115	1	Wt	Grab	X								35

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-36-FD	3/27/2024	13:45	Liberty North - Sink Tap - 003803-Room 115	1	Wt	Grab	X								36
1000-37-FD	3/27/2024	13:45	Liberty North - Sink Tap - 003804-Room 115	1	Wt	Grab	X								37
1000-38-FD	3/27/2024	13:46	Liberty North - Sink Tap - 003805-Room 115-3 Bay Right	1	Wt	Grab	X								38
1000-39-FD	3/27/2024	13:46	Liberty North - Sink Tap - 003806-Room 115-3 Bay Middle	1	Wt	Grab	X								39
1000-40-FD	3/27/2024	13:46	Liberty North - Sink Tap - 003807-Room 115-3 Bay Left	1	Wt	Grab	X								40
1000-41-FD	3/27/2024	13:46	Liberty North - Sink Tap - 003808-Room 115 next to 116A	1	Wt	Grab	X								41
1000-42-FD	3/27/2024	13:46	Liberty North - Sink Tap - 003809-Room 115 by windows-Left	1	Wt	Grab	X								42

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-43-FD	3/27/2024	13:46	Liberty North - Sink Tap - 003810-Room 115 by windows	1	Wt	Grab	X								43
1000-44-FD	3/27/2024	13:47	Liberty North - Sink Tap - 003811-Room 115	1	Wt	Grab	X								44
1000-45-FD	3/27/2024	13:47	Liberty North - Ice Machine - 003812-Room 116B	1	Wt	Grab	X								45
1000-46-FD	3/27/2024	13:47	Liberty North - Drinking Fountain - 003813-New 100 Hall	1	Wt	Grab	X								46
1000-47-FD	3/27/2024	13:47	Liberty North - Drinking Fountain - 003814B-New 100 Hall	1	Wt	Grab	X								47
1000-48-FD	3/27/2024	13:48	Liberty North - Bottle Filler - 003814F-New 100 Hall	1	Wt	Grab	X								48
1000-49-FD	3/27/2024	13:48	Liberty North - Sink Tap - 003815-Between Bathrooms New 100 Hall	1	Wt	Grab	X								49

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-50-FD	3/27/2024	13:48	Liberty North - Sink Tap - 003816-Between Bathroom New 100 Hall	1	Wt	Grab	X								50
1000-51-FD	3/27/2024	13:48	Liberty North - Sink Tap - 003817-Between Bathroom New 100 Hall	1	Wt	Grab	X								51
1000-52-FD	3/27/2024	13:49	Liberty North - Sink Tap - 003818-Between Bathroom New 100 Hall-Far Right	1	Wt	Grab	X								52
1000-53-FD	3/27/2024	13:49	Liberty North - Sink Tap - 002582-Room 133	1	Wt	Grab	X								53
1000-54-FD	3/27/2024	13:50	Liberty North - Sink Tap - 002583-Room 133 Bathroom	1	Wt	Grab	X								54
1000-55-FD	3/27/2024	13:50	Liberty North - Sink Tap - 002584-Room 133B/Lactation Room	1	Wt	Grab	X								55
1000-56-FD	3/27/2024	13:53	Liberty North - Drinking Fountain - 004039-By 202	1	Qt	Grab	X								56

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-57-FD	3/27/2024	13:53	Liberty North - Sink Tap - 004038-By 202	1	Wt	Grab	X								57
1000-58-FD	3/27/2024	13:54	Liberty North - Sink Tap - 004037-Rm 212 by Coffee Shop	1	Wt	Grab	X								58
1000-59-FD	3/27/2024	13:54	Liberty North - Drinking Fountain - 004036-Library by Coffee Shop	1	Wt	Grab	X								59
1000-60-FD	3/27/2024	13:55	Liberty North - Coffee Pot - 004035-Library	1	Qt	Grab	X								60
1000-61-FD	3/27/2024	13:55	Liberty North - Coffee Pot - 004034-Library	1	Wt	Grab	X								61
1000-62-FD	3/27/2024	13:55	Liberty North - Coffee Pot - 004033-Library	1	Wt	Grab	X								62
1000-63-FD	3/27/2024	13:53	Liberty North - Sink Tap - 004032-Library Coffee Shop	1	Wt	Grab	X								63

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-64-FD	3/27/2024	13:54	Liberty North - Sink Tap - 004031-Library Coffee Shop	1	Wt	Grab	X								64
1000-65-FD	3/27/2024	13:57	Liberty North - Drinking Fountain - 003836-Old 300 Hall-Girls	1	Wt	Grab	X								65
1000-66-FD	3/27/2024	13:57	Liberty North - Drinking Fountain - 003837-Old 300 Hall-Girls-Right	1	Wt	Grab	X								66
1000-67-FD	3/27/2024	13:57	Liberty North - Sink Tap - 003839-Old 300 Hall-Girls-Far Left	1	Wt	Grab	X								67
1000-68-FD	3/27/2024	13:58	Liberty North - Sink Tap - 003840-Old 300 Hall-Girls	1	Wt	Grab	X								68
1000-69-FD	3/27/2024	13:58	Liberty North - Sink Tap - 003838-Old 300 Hall-Girls-Right Middle	1	Wt	Grab	X								69
1000-70-FD	3/27/2024	13:58	Liberty North - Sink Tap - 003841-Old 300 Hall-Girls-Far Right	1	Wt	Grab	X								70

LAB USE ONLY
Wk Order #:
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-71-FD	3/27/2024	13:59	Liberty North - Drinking Fountain - 003835-Old 300 Hall-Boys-Left	1	Wt	Grab	X								71
1000-72-FD	3/27/2024	13:59	Liberty North - Drinking Fountain - 003834-Old 300 Hall-Boys-Right	1	Wt	Grab	X								72
1000-73-FD	3/27/2024	13:59	Liberty North - Sink Tap - 003830-Old 300 Hall-Boys-far left	1	Wt	Grab	X								73
1000-74-FD	3/27/2024	13:59	Liberty North - Sink Tap - 003831-Old 300 Hall-Boys-left middle	1	Wt	Grab	X								74
1000-75-FD	3/27/2024	14:00	Liberty North - Sink Tap - 003832-Old 300 Hall-Boys-right middle	1	Wt	Grab	X								75
1000-76-FD	3/27/2024	14:00	Liberty North - Sink Tap - 003833-Old 300 Hall-Boys-far right	1	Wt	Grab	X								76
1000-77-FD	3/27/2024	14:01	Liberty North - Sink Tap - 002550-Room 307	1	Wt	Grab	X								77

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-78-FD	3/27/2024	14:01	Liberty North - Sink Tap - 003842-Room 307	1	Wt	Grab	X								78
1000-79-FD	3/27/2024	14:01	Liberty North - Sink Tap - 003843-Room 307	1	Wt	Grab	X								79
1000-80-FD	3/27/2024	14:01	Liberty North - Sink Tap - 003844-Room 310 Prep, Inside 307	1	Wt	Grab	X								80
1000-81-FD	3/27/2024	14:02	Liberty North - Drinking Fountain - 003826- Between Old/New 300 Hall-far right	1	Wt	Grab	X								81
1000-82-FD	3/27/2024	14:02	Liberty North - Drinking Fountain - 003827- Between Old/New 300 Hall-right middle	1	Wt	Grab	X								82
1000-83-FD	3/27/2024	14:02	Liberty North - Drinking Fountain - 003828- Between Old/New 300 Hall-left middle	1	Wt	Grab	X								83
1000-84-FD	3/27/2024	14:03	Liberty North - Drinking Fountain - 003829- Between Old/New 300 Hall-far left	1	Wt	Grab	X								84

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-85-FD	3/27/2024	14:03	Liberty North - Sink Tap - 004021-Room 322	1	Wt	Grab	X								85
1000-86-FD	3/27/2024	14:03	Liberty North - Sink Tap - 004020-Room 324	1	Wt	Grab	X								86
1000-87-FD	3/27/2024	14:04	Liberty North - Drinking Fountain - 004022-New 300 Hall-right	1	Wt	Grab	X								87
1000-88-FD	3/27/2024	14:04	Liberty North - Bubbler - 004022-New 300 Hall	1	Wt	Grab	X								88
1000-89-FD	3/27/2024	14:04	Liberty North - Drinking Fountain - 004023-New 300 Hall-left	1	Wt	Grab	X								89
1000-90-FD	3/27/2024	14:05	Liberty North - Sink Tap - 004024-Room 326	1	Wt	Grab	X								90
1000-91-FD	3/27/2024	14:06	Liberty North - Sink Tap - 004025-Room 331	1	Wt	Grab	X								91

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___	600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___	3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X	835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___	205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-92-FD	3/27/2024	14:06	Liberty North - Sink Tap - 004026-Next to 331	1	Wt	Grab	X								92
1000-93-FD	3/27/2024	14:08	Liberty North - Sink Tap - 002346-Basement Below 300s-Boys-left	1	Wt	Grab	X								93
1000-94-FD	3/27/2024	14:08	Liberty North - Sink Tap - 002347-Basement Below 300s-Boys-right	1	Wt	Grab	X								94
1000-95-FD	3/27/2024	14:09	Liberty North - Sink Tap - 002348-Basement Below 300s-Girls-left	1	Wt	Grab	X								95
1000-96-FD	3/27/2024	14:09	Liberty North - Sink Tap - 002349-Basement below 300s-Girls-right	1	Wt	Grab	X								96
1000-97-FD	3/27/2024	14:09	Liberty North - Drinking Fountain - 002344-Basement Below 300s-left	1	Qt	Grab	X								97
1000-98-FD	3/27/2024	14:09	Liberty North - Drinking Fountain - 002345-Basement below 300s-right	1	Wt	Grab	X								98

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-99-FD	3/27/2024	14:12	Liberty North - Drinking Fountain - 003943-Great Hall-far left	1	Wt	Grab	X								99
1000-100-FD	3/27/2024	14:12	Liberty North - Bottle Filler - 003943F-Great Hall	1	Wt	Grab	X								A A
1000-101-FD	3/27/2024	14:12	Liberty North - Drinking Fountain - 003944-Great Hall	1	Wt	Grab	X								A B
1000-102-FD	3/27/2024	14:13	Liberty North - Drinking Fountain - 003945-Great Hall	1	Wt	Grab	X								A C
1000-103-FD	3/27/2024	14:13	Liberty North - Drinking Fountain - 003946-Great Hall	1	Wt	Grab	X								A D
1000-104-FD	3/27/2024	14:13	Liberty North - Drinking Fountain - 003947-Great Hall	1	Wt	Grab	X								A E
1000-105-FD	3/27/2024	14:13	Liberty North - Drinking Fountain - 003948-Great Hall	1	Wt	Grab	X								A F

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

Remarks:

3HD0051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-106-FD	3/27/2024	14:14	Liberty North - Drinking Fountain - 003949-Great Hall-far right	1	Wt	Grab	X								A G
1000-107-FD	3/27/2024	14:14	Liberty North - Bottle Filler - 003949F-Great Hall	1	Wt	Grab	X								A H
1000-108-FD	3/27/2024	14:14	Liberty North - Sink Tap - 003931-Room 403-Boys	1	Wt	Grab	X								A I
1000-109-FD	3/27/2024	14:14	Liberty North - Sink Tap - 003932-Room 403-Boys	1	Wt	Grab	X								A J
1000-110-FD	3/27/2024	14:15	Liberty North - Sink Tap - 003933-Room 403-Handwashing	1	Qt	Grab	X								A K
1000-111-FD	3/27/2024	14:15	Liberty North - Sink Tap - 003934-Room 403-Handwashing	1	Wt	Grab	X								A L
1000-114-FD	3/27/2024	14:14	Liberty North - Sink Tap - 003937-Room 404-Girls-far left	1	Wt	Grab	X								A M

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3 H D 0 0 5 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-115-FD	3/27/2024	14:15	Liberty North - Sink Tap - 003938-Room 404-Girls-left middle	1	Wt	Grab	X								AN
1000-116-FD	3/27/2024	14:15	Liberty North - Sink Tap - 003939-Room 404-Girls	1	Wt	Grab	X								AO
1000-117-FD	3/27/2024	14:15	Liberty North - Sink Tap - 003940-Room 404-Girls	1	Wt	Grab	X								AP
1000-120-FD	3/27/2024	14:18	Liberty North - Sink Tap - 003913-Room 411-Boys	1	Wt	Grab	X								AQ
1000-121-FD	3/27/2024	14:18	Liberty North - Sink Tap - 003914-Room 411-Boys	1	Wt	Grab	X								AR
1000-122-FD	3/27/2024	14:18	Liberty North - Sink Tap - 003915-Room 411-Boys	1	Wt	Grab	X								AS
1000-123-FD	3/27/2024	14:19	Liberty North - Drinking Fountain - 003916-Room 411-Boys Lockers	1	Wt	Grab	X								AT

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
1000-124-FD	3/27/2024	14:19	Liberty North - Drinking Fountain - 003917-Room 411-Boys Lockers	1	Wt	Grab	X								AU
1000-125-FD	3/27/2024	14:19	Liberty North - Sink Tap - 003918-Room 411-Boys Lockers-left	1	Wt	Grab	X								AV
1000-126-FD	3/27/2024	14:19	Liberty North - Sink Tap - 003919-Room 411-Boys Lockers-right	1	Wt	Grab	X								AW
1000-127-FD	3/27/2024	14:20	Liberty North - Drinking Fountain - 003920-Room 411-Boys Lockers	1	Wt	Grab	X								AX
1000-128-FD	3/27/2024	14:20	Liberty North - Drinking Fountain - 003921-Room 411-Boys Lockers	1	Wt	Grab	X								AY
1000-129-FD	3/27/2024	14:21	Liberty North - Drinking Fountain - 003922-Next to 409-Girls Lockers	1	Wt	Grab	X								AZ
1000-130-FD	3/27/2024	14:21	Liberty North - Drinking Fountain - 003923-Next to 409-Girls Lockers	1	Wt	Grab	X								BA

LAB USE ONLY: Wk Order #: ___ Short Hold: ___ Rush: ___ Temp: oC ___

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-132-FD	3/27/2024	14:22	Liberty North - Sink Tap - 003925-Girls Locker Room	1	Wt	Grab	X								BB
1000-133-FD	3/27/2024	14:22	Liberty North - Sink Tap - 003926-Girls Locker Room	1	Wt	Grab	X								BC
1000-134-FD	3/27/2024	14:23	Liberty North - Drinking Fountain - 003927-Room 410-Girls Lockers	1	Wt	Grab	X								BD
1000-135-FD	3/27/2024	14:23	Liberty North - Drinking Fountain - 003928-Room 410-Girls Lockers	1	Wt	Grab	X								BE
1000-136-FD	3/27/2024	14:23	Liberty North - Sink Tap - 003929-Rook 410-Girls Lockers	1	Wt	Grab	X								BF
1000-137-FD	3/27/2024	14:24	Liberty North - Sink Tap - 003930-Room 410-Girls Lockers	1	Wt	Grab	X								BG
1000-138-FD	3/27/2024	14:25	Liberty North - Sink Tap - 003912-Room 415	1	Wt	Grab	X								BH

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-139-FD	3/27/2024	14:25	Liberty North - Sink Tap - 003909-Concessions-By 401	1	Wt	Grab	X								BI
1000-140-FD	3/27/2024	14:25	Liberty North - Sink Tap - 003910-Concessions by 421	1	Wt	Grab	X								BJ
1000-141-FD	3/27/2024	14:25	Liberty North - Sink Tap - 003911-Concessions by 421	1	Wt	Grab	X								BK
1000-142-FD	3/27/2024	14:25	Liberty North - Ice Machine - 000788-L-Concession Stand	1	Wt	Grab	X								BL
1000-143-FD	3/27/2024	14:27	Liberty North - Drinking Fountain - 004189-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BM
1000-144-FD	3/27/2024	14:27	Liberty North - Drinking Fountain - 004188-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BN
1000-145-FD	3/27/2024	14:27	Liberty North - Sink Tap - 004180-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BO

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___	600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___	3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X	835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___	205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-146-FD	3/27/2024	14:28	Liberty North - Sink Tap - 004181-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BP
1000-147-FD	3/27/2024	14:28	Liberty North - Sink Tap - 004182-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BQ
1000-148-FD	3/27/2024	14:28	Liberty North - Sink Tap - 004183-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BR
1000-149-FD	3/27/2024	14:29	Liberty North - Sink Tap - 004184-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BS
1000-150-FD	3/27/2024	14:29	Liberty North - Sink Tap - 004185-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BT
1000-151-FD	3/27/2024	14:29	Liberty North - Sink Tap - 004186-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BU
1000-152-FD	3/27/2024	14:30	Liberty North - Sink Tap - 004187-Fieldhouse Upstairs-Boys	1	Wt	Grab	X								BV

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-153-FD	3/27/2024	14:30	Liberty North - Drinking Fountain - 004178-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								BW
1000-154-FD	3/27/2024	14:30	Liberty North - Drinking Fountain - 004179-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								BX
1000-155-FD	3/27/2024	14:31	Liberty North - Sink Tap - 004170-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								BY
1000-156-FD	3/27/2024	14:31	Liberty North - Sink Tap - 004171-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								BZ
1000-157-FD	3/27/2024	14:31	Liberty North - Sink Tap - 004172-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								CA
1000-158-FD	3/27/2024	14:32	Liberty North - Sink Tap - 004173-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								CB
1000-159-FD	3/27/2024	14:32	Liberty North - Sink Tap - 004174-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								CC

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-160-FD	3/27/2024	14:32	Liberty North - Sink Tap - 004175-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								CD
1000-161-FD	3/27/2024	14:33	Liberty North - Sink Tap - 004176-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								CE
1000-162-FD	3/27/2024	14:33	Liberty North - Sink Tap - 004177-Fieldhouse Upstairs-Girls	1	Wt	Grab	X								CF
1000-163-FD	3/27/2024	14:36	Liberty North - Sink Tap - 004166-Room 510	1	Wt	Grab	X								CG
1000-164-FD	3/27/2024	14:36	Liberty North - Sink Tap - 004167-Room 510	1	Qt	Grab	X								CH
1000-165-FD	3/27/2024	14:36	Liberty North - Sink Tap - 004168-Room 510	1	Wt	Grab	X								CI
1000-166-FD	3/27/2024	14:37	Liberty North - Sink Tap - 004169-Room 510	1	Wt	Grab	X								CJ

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-167-FD	3/27/2024	14:38	Liberty North - Drinking Fountain - 004158-500 Hall	1	Qt	Grab	X								CK
1000-168-FD	3/27/2024	14:38	Liberty North - Drinking Fountain - 004159-500 Hall	1	Wt	Grab	X								CL
1000-169-FD	3/27/2024	14:38	Liberty North - Sink Tap - 004160-500 Hall-Boys	1	Wt	Grab	X								CM
1000-170-FD	3/27/2024	14:39	Liberty North - Sink Tap - 004161-500 Hall-Boys	1	Wt	Grab	X								CN
1000-171-FD	3/27/2024	14:39	Liberty North - Sink Tap - 004162-500 Hall-Boys	1	Qt	Grab	X								CO
1000-172-FD	3/27/2024	14:40	Liberty North - Sink Tap - 004163-500 Hall-Girls	1	Wt	Grab	X								CP
1000-173-FD	3/27/2024	14:40	Liberty North - Sink Tap - 004164-500 Hall-Girls	1	Wt	Grab	X								CQ

LAB USE ONLY: Wk Order #: ; Short Hold: ; Rush: ; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-174-FD	3/27/2024	14:40	Liberty North - Sink Tap - 004165-500 Hall-Girls	1	Wt	Grab	X								CR
1000-175-FD	3/27/2024	14:40	Liberty North - Sink Tap - 002577-Room 515	1	Wt	Grab	X								CS
1000-176-FD	3/27/2024	14:41	Liberty North - Sink Tap - 004154-Room 514	1	Wt	Grab	X								CT
1000-177-FD	3/27/2024	14:41	Liberty North - Sink Tap - 004155-Room 514	1	Wt	Grab	X								CU
1000-178-FD	3/27/2024	14:41	Liberty North - Sink Tap - 004156-Room 514	1	Wt	Grab	X								CV
1000-179-FD	3/27/2024	14:41	Liberty North - Sink Tap - 004157-Room 514	1	Wt	Grab	X								CW
1000-180-FD	3/27/2024	14:41	Liberty North - Sink Tap - 004151-Room 516	1	Wt	Grab	X								CX

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD0051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-181-FD	3/27/2024	14:42	Liberty North - Bubbler - 004152-Room 516	1	Wt	Grab	X								CY
1000-182-FD	3/27/2024	14:42	Liberty North - Sink Tap - 004153-Room 516	1	Wt	Grab	X								CZ
1000-183-FD	3/27/2024	14:42	Liberty North - Sink Tap - 004147-Room 517	1	Wt	Grab	X								DA
1000-184-FD	3/27/2024	14:42	Liberty North - Sink Tap - 004146-Room 517-Bathroom	1	Wt	Grab	X								DB
1000-185-FD	3/27/2024	14:43	Liberty North - Sink Tap - 004149-Room 520	1	Wt	Grab	X								DC
1000-186-FD	3/27/2024	14:43	Liberty North - Bubbler - 004148-Room 520	1	Wt	Grab	X								DD
1000-187-FD	3/27/2024	14:43	Liberty North - Sink Tap - 004150-Room 520	1	Wt	Grab	X								DE

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-188-FD	3/27/2024	14:44	Liberty North - Sink Tap - 004143-Room 521 #4	1	Wt	Grab	X								DF
1000-189-FD	3/27/2024	14:44	Liberty North - Sink Tap - 004142-Room 521 #3	1	Wt	Grab	X								DG
1000-190-FD	3/27/2024	14:44	Liberty North - Sink Tap - 004144-Room 521 #2	1	Wt	Grab	X								DH
1000-191-FD	3/27/2024	14:44	Liberty North - Sink Tap - 004145-Room 521 #1	1	Wt	Grab	X								DI
1000-192-FD	3/27/2024	14:45	Liberty North - Sink Tap - 004141-Room 523	1	Wt	Grab	X								DJ
1000-193-FD	3/27/2024	14:45	Liberty North - Sink Tap - 004139-Room 523 by Entry	1	Wt	Grab	X								DK
1000-194-FD	3/27/2024	14:46	Liberty North - Sink Tap - 004140-Room 523 by Entry	1	Wt	Grab	X								DL

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-195-FD	3/27/2024	14:50	Liberty North - Sink Tap - 004196-Fieldhouse Downstairs-Boys	1	Wt	Grab	X								DM
1000-196-FD	3/27/2024	14:50	Liberty North - Sink Tap - 004197-Fieldhouse Downstairs-Boys	1	Wt	Grab	X								DN
1000-197-FD	3/27/2024	14:50	Liberty North - Drinking Fountain - 004195-Fieldhouse	1	Wt	Grab	X								DO
1000-199-FD	3/27/2024	14:51	Liberty North - Drinking Fountain - 004193-Fieldhouse	1	Wt	Grab	X								DP
1000-200-FD	3/27/2024	14:51	Liberty North - Drinking Fountain - 004192-Fieldhouse	1	Wt	Grab	X								DQ
1000-201-FD	3/27/2024	14:51	Liberty North - Sink Tap - 004190-Fieldhouse Downstairs-Girls	1	Wt	Grab	X								DR
1000-202-FD	3/27/2024	14:51	Liberty North - Sink Tap - 004191-Fieldhouse Downstairs-Girls	1	Wt	Grab	X								DS

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-203-FD	3/27/2024	14:52	Liberty North - Sink Tap - 002592-Coaches Office	1	Wt	Grab	X								DT
1000-204-FD	3/27/2024	14:52	Liberty North - Drinking Fountain - 003908-Room 11	1	Wt	Grab	X								DU
1000-205-FD	3/27/2024	14:52	Liberty North - Sink Tap - 003907-Room 11-Girls Lockers	1	Wt	Grab	X								DV
1000-206-FD	3/27/2024	14:53	Liberty North - Sink Tap - 003906-Room 11-Girls Lockers	1	Wt	Grab	X								DW
1000-207-FD	3/27/2024	14:53	Liberty North - Sink Tap - 002591-Room 012B-Bathroom	1	Wt	Grab	X								DX
1000-208-FD	3/27/2024	14:54	Liberty North - Sink Tap - 003905-Coaches Office-014B	1	Wt	Grab	X								DY
1000-209-FD	3/28/2024	14:54	Liberty North - Sink Tap - 003904-Field House-Boys Lockers	1	Wt	Grab	X								DZ

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X
835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
1000-210-FD	3/27/2024	14:55	Liberty North - Sink Tap - 003903-Fieldhouse-Boys Lockers	1	Wt	Grab	X								EA
1000-211-FD	3/27/2024	14:55	Liberty North - Drinking Fountain - 004199-Fieldhouse	1	Wt	Grab	X								EB
1000-212-FD	3/27/2024	14:55	Liberty North - Drinking Fountain - 004198-Fieldhouse	1	Wt	Grab	X								EC
1000-213-FD	3/27/2024	14:56	Liberty North - Sink Tap - 004200-Room 15	1	Wt	Grab	X								ED
1000-214-FD	3/27/2024	14:56	Liberty North - Whirlpool - 003902-Room 15	1	Wt	Grab	X								EE
1000-215-FD	3/27/2024	14:56	Liberty North - Ice Machine - 003901-Room 15	1	Wt	Grab	X								EF
1000-216-FD	3/27/2024	14:59	Liberty North - Drinking Fountain - 004040-Old 900 Hall-Girls	1	Wt	Grab	X								EG

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-217-FD	3/27/2024	14:59	Liberty North - Drinking Fountain - 004041-Old 900 Hall-Girls	1	Wt	Grab	X								EH
1000-218-FD	3/27/2024	15:00	Liberty North - Sink Tap - 004042-Old 900 Hall-Girls	1	Wt	Grab	X								EI
1000-219-FD	3/27/2024	15:00	Liberty North - Sink Tap - 004043-Old 900 Hall-Girls	1	Wt	Grab	X								EJ
1000-220-FD	3/27/2024	15:00	Liberty North - Sink Tap - 004044-Old 900 Hall-Girls	1	Wt	Grab	X								EK
1000-221-FD	3/27/2024	15:00	Liberty North - Sink Tap - 004045-Old 900 Hall-Girls	1	Wt	Grab	X								EL
1000-222-FD	3/27/2024	15:01	Liberty North - Drinking Fountain - 002350-Old 900 Hall-Boys	1	Wt	Grab	X								EM
1000-223-FD	3/27/2024	15:01	Liberty North - Drinking Fountain - 002351-Old 900 Hall-Boys	1	Wt	Grab	X								EN

LAB USE ONLY
Wk Order #:
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

Remarks:

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-224-FD	3/27/2024	15:01	Liberty North - Sink Tap - 002352-Old 900 Hall-Boys	1	Wt	Grab	X								EO
1000-225-FD	3/27/2024	15:02	Liberty North - Sink Tap - 002353-Old 900 Hall-Boys	1	Wt	Grab	X								EP
1000-226-FD	3/27/2024	15:02	Liberty North - Sink Tap - 002354-Old 900 Hall-Boys	1	Wt	Grab	X								EQ
1000-227-FD	3/27/2024	15:02	Liberty North - Sink Tap - 002355-Old 900 Hall-Boys	1	Wt	Grab	X								ER
1000-228-FD	3/27/2024	15:04	Liberty North - Sink Tap - 004076-Room 902	1	Wt	Grab	X								ES
1000-229-FD	3/27/2024	15:04	Liberty North - Bubbler - 004077-Room 902	1	Wt	Grab	X								ET
1000-230-FD	3/27/2024	15:04	Liberty North - Sink Tap - 002603-Room 904	1	Wt	Grab	X								EU

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-231-FD	3/27/2024	15:04	Liberty North - Bubbler - 002604-Room 904	1	Wt	Grab	X								EV
1000-232-FD	3/27/2024	15:05	Liberty North - Sink Tap - 004078-Room 909	1	Wt	Grab	X								EW
1000-233-FD	3/27/2024	15:05	Liberty North - Bubbler - 004079-Room 909	1	Wt	Grab	X								EX
1000-234-FD	3/27/2024	15:05	Liberty North - Sink Tap - 004080-Room 910	1	Wt	Grab	X								EY
1000-235-FD	3/27/2024	15:05	Liberty North - Bubbler - 004081-Room 910	1	Wt	Grab	X								EZ
1000-236-FD	3/27/2024	15:06	Liberty North - Sink Tap - 004084-Room 915	1	Wt	Grab	X								FA
1000-237-FD	3/27/2024	15:06	Liberty North - Sink Tap - 004085-Room 915-Bathroom	1	Wt	Grab	X								BFB

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD0051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-238-FD	3/27/2024	15:07	Liberty North - Sink Tap - 004082-Room 916	1	Wt	Grab	X								FC
1000-239-FD	3/27/2024	15:07	Liberty North - Bubbler - 004083-Room 916	1	Wt	Grab	X								FD
1000-240-FD	3/27/2024	15:08	Liberty North - Drinking Fountain - 004064- Between old/new 900 hall	1	Wt	Grab	X								FE
1000-241-FD	3/27/2024	15:08	Liberty North - Drinking Fountain - 004065- Between old/new 900 hall	1	Wt	Grab	X								FF
1000-242-FD	3/27/2024	15:08	Liberty North - Drinking Fountain - 004066- Between old/new 900 hall	1	Wt	Grab	X								FG
1000-243-FD	3/27/2024	15:09	Liberty North - Drinking Fountain - 004067- Between old/new 900 hall	1	Wt	Grab	X								FH
1000-244-FD	3/27/2024	15:09	Liberty North - Sink Tap - 004086-Room 919	1	Wt	Grab	X								FI

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-245-FD	3/27/2024	15:09	Liberty North - Sink Tap - 004087-Room 919-Bathroom	1	Wt	Grab	X								FJ
1000-257-FD	3/27/2024	15:11	Liberty North - Sink Tap - 004095-Room 914	1	Wt	Grab	X								FK
1000-258-FD	3/27/2024	15:11	Liberty North - Bubbler - 004094-Room 914	1	Wt	Grab	X								FL
1000-259-FD	3/27/2024	15:12	Liberty North - Sink Tap - 004098-Room 912	1	Wt	Grab	X								FM
1000-260-FD	3/27/2024	15:12	Liberty North - Bubbler - 004097-Room 912	1	Wt	Grab	X								FN
1000-261-FD	3/27/2024	15:12	Liberty North - Sink Tap - 004096-Room 908	1	Wt	Grab	X								FO
1000-262-FD	3/27/2024	15:13	Liberty North - Sink Tap - 004099-Room 907	1	Wt	Grab	X								FP

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-263-FD	3/27/2024	15:13	Liberty North - Bubbler - 004100-Room 907	1	Wt	Grab	X								FQ
1000-264-FD	3/27/2024	15:14	Liberty North - Sink Tap - 002602-Room 905	1	Wt	Grab	X								FR
1000-265-FD	3/27/2024	15:14	Liberty North - Bubbler - 002601-Room 905	1	Wt	Grab	X								FS
1000-266-FD	3/27/2024	15:17	Liberty North - Sink Tap - 004050-New 800 Hall-Boys	1	Wt	Grab	X								FT
1000-267-FD	3/27/2024	15:17	Liberty North - Sink Tap - 004051-New 800 Hall-Boys	1	Wt	Grab	X								FU
1000-268-FD	3/27/2024	15:17	Liberty North - Sink Tap - 004052-New 800 Hall-Girls	1	Wt	Grab	X								FV
1000-269-FD	3/27/2024	15:17	Liberty North - Sink Tap - 004053-New 800 Hall-Girls	1	Wt	Grab	X								FW

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-270-FD	3/27/2024	15:18	Liberty North - Drinking Fountain - 002626B-New 800 Hall	1	Wt	Grab	X								FX
1000-271-FD	3/27/2024	15:18	Liberty North - Bottle Filler - 002626F-New 800 Hall	1	Wt	Grab	X								FY
1000-272-FD	3/27/2024	15:18	Liberty North - Drinking Fountain - 002627-New 800 Hall	1	Wt	Grab	X								FZ
1000-273-FD	3/27/2024	15:19	Liberty North - Drinking Fountain - 004060-Between Old/New 800 Halls	1	Wt	Grab	X								GA
1000-274-FD	3/27/2024	15:19	Liberty North - Drinking Fountain - 004061-Between old/new 800 Hall	1	Wt	Grab	X								GB
1000-277-FD	3/27/2024	15:21	Liberty North - Sink Tap - 002615-Room 822	1	Wt	Grab	X								GC
1000-278-FD	3/27/2024	15:21	Liberty North - Bubbler - 002616-Room 822	1	Wt	Grab	X								GD

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-279-FD	3/27/2024	15:22	Liberty North - Sink Tap - 002617-Room 813	1	Wt	Grab	X								G E
1000-280-FD	3/27/2024	15:22	Liberty North - Sink Tap - 002619-Room 817	1	Wt	Grab	X								G F
1000-281-FD	3/27/2024	15:22	Liberty North - Bubbler - 002618-Room 817	1	Wt	Grab	X								G G
1000-282-FD	3/27/2024	15:23	Liberty North - Sink Tap - 002621-Room 812	1	Wt	Grab	X								G H
1000-283-FD	3/27/2024	15:23	Liberty North - Bubbler - 002620-Room 812	1	Wt	Grab	X								G I
1000-284-FD	3/27/2024	15:24	Liberty North - Sink Tap - 002622-Room 810	1	Wt	Grab	X								G J
1000-285-FD	3/27/2024	15:24	Liberty North - Bubbler - 002623-Room 810	1	Wt	Grab	X								G K

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3 H D 0 0 5 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-286-FD	3/27/2024	15:26	Liberty North - Sink Tap - 002625-Room 809	1	Wt	Grab	X								GL
1000-287-FD	3/27/2024	15:26	Liberty North - Sink Tap - 002624-Room 809-Handwashing	1	Wt	Grab	X								GM
1000-288-FD	3/27/2024	15:27	Liberty North - Drinking Fountain - 004058-Old 800 Hall-Girls	1	Wt	Grab	X								GN
1000-289-FD	3/27/2024	15:27	Liberty North - Drinking Fountain - 004059-Old 800 Hall-Girls	1	Wt	Grab	X								GO
1000-290-FD	3/27/2024	15:28	Liberty North - Sink Tap - 004055-Old 800 Hall-Girls	1	Wt	Grab	X								GP
1000-291-FD	3/27/2024	15:28	Liberty North - Sink Tap - 004054-Old 800 Hall-Girls	1	Wt	Grab	X								GQ
1000-292-FD	3/27/2024	15:28	Liberty North - Sink Tap - 004057-Old 800 Hall-Girls	1	Wt	Grab	X								GR

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

Remarks:

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-293-FD	3/27/2024	15:28	Liberty North - Sink Tap - 004056-Old 800 Hall-Girls	1	Wt	Grab	X								GS
1000-296-FD	3/27/2024	15:29	Liberty North - Sink Tap - 002587-Old 800 Hall-Boys	1	Wt	Grab	X								GT
1000-297-FD	3/27/2024	15:29	Liberty North - Sink Tap - 002588-Old 800 Hall-Boys	1	Wt	Grab	X								GU
1000-298-FD	3/27/2024	15:29	Liberty North - Sink Tap - 002589-Old 800 Hall-Boys	1	Wt	Grab	X								GV
1000-299-FD	3/27/2024	15:30	Liberty North - Sink Tap - 002590-Old 800 Hall-Boys	1	Wt	Grab	X								GW
1000-300-FD	3/27/2024	15:31	Liberty North - Sink Tap - 002606-Room 808	1	Wt	Grab	X								GX
1000-301-FD	3/27/2024	15:31	Liberty North - Bubbler - 002605-Room 808	1	Wt	Grab	X								GY

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date: / Time:		Received by: (Signature)	Date: / Time:	Remarks:
Relinquied by: (Signature)	Date: / Time:		Received by: (Signature)	Date: / Time:	

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-302-FD	3/27/2024	15:32	Liberty North - Sink Tap - 002608-Room 815	1	Wt	Grab	X								GZ
1000-303-FD	3/27/2024	15:33	Liberty North - Bubbler - 002607-Room 815	1	Wt	Grab	X								HA
1000-304-FD	3/27/2024	15:33	Liberty North - Sink Tap - 002610-Room 816	1	Wt	Grab	X								HB
1000-305-FD	3/27/2024	15:33	Liberty North - Bubbler - 002609-Room 816	1	Wt	Grab	X								HC
1000-306-FD	3/27/2024	15:34	Liberty North - Sink Tap - 002611-Room 820	1	Wt	Grab	X								HD
1000-307-FD	3/27/2024	15:34	Liberty North - Bubbler - 002612-Room 820	1	Wt	Grab	X								HE
1000-308-FD	3/27/2024	15:35	Liberty North - Sink Tap - 002614-Room 821	1	Wt	Grab	X								HF

LAB USE ONLY:
Wk Order #:
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-309-FD	3/27/2024	15:35	Liberty North - Sink Tap - 002613-Room 821-Bathroom	1	Wt	Grab	X								HG
1000-310-FD	3/27/2024	15:38	Liberty North - Drinking Fountain - 003965-600 Hall	1	Wt	Grab	X								HH
1000-311-FD	3/27/2024	15:38	Liberty North - Bottle Filler - 003965F-600 Hall	1	Wt	Grab	X								HI
1000-312-FD	3/27/2024	15:38	Liberty North - Drinking Fountain - 003966-600 Hall	1	Wt	Grab	X								HJ
1000-313-FD	3/27/2024	15:39	Liberty North - Sink Tap - 003969-600 Hall-Girls	1	Wt	Grab	X								HK
1000-314-FD	3/27/2024	15:39	Liberty North - Sink Tap - 003968-600 Hall-Girls	1	Wt	Grab	X								HL
1000-315-FD	3/27/2024	15:39	Liberty North - Sink Tap - 003967-600 Hall-Girls	1	Wt	Grab	X								HM

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-316-FD	3/27/2024	15:40	Liberty North - Sink Tap - 003962-600 Hall-Boys	1	Wt	Grab	X								HN
1000-317-FD	3/27/2024	15:40	Liberty North - Sink Tap - 003963-600 Hall-Boys	1	Wt	Grab	X								HO
1000-318-FD	3/27/2024	15:40	Liberty North - Sink Tap - 003964-600 Hall-Boys	1	Wt	Grab	X								HP
1000-319-FD	3/27/2024	15:41	Liberty North - Sink Tap - 003971-Room 604	1	Wt	Grab	X								HQ
1000-320-FD	3/27/2024	15:41	Liberty North - Sink Tap - 003970-Room 604	1	Wt	Grab	X								HR
1000-321-FD	3/27/2024	15:42	Liberty North - Sink Tap - 003975-Room 608A	1	Wt	Grab	X								HS
1000-322-FD	3/27/2024	15:42	Liberty North - Ice Machine - 002578-Room 608A	1	Wt	Grab	X								HT

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-323-FD	3/27/2024	15:43	Liberty North - Sink Tap - 003972-Room 609E	1	Wt	Grab	X								HU
1000-324-FD	3/27/2024	15:44	Liberty North - Sink Tap - 003973-Room 617C	1	Wt	Grab	X								HV
1000-325-FD	3/27/2024	15:44	Liberty North - Bubbler - 003974-Room 617C	1	Wt	Grab	X								HW
1000-326-FD	3/27/2024	15:48	Liberty North - Sink Tap - 003961-Nurse Office	1	Wt	Grab	X								HX
1000-327-FD	3/27/2024	15:48	Liberty North - Sink Tap - 003960-Room 723	1	Wt	Grab	X								HY
1000-328-FD	3/27/2024	15:48	Liberty North - Sink Tap - 003959-Room 723	1	Wt	Grab	X								HZ
1000-329-FD	3/27/2024	15:48	Liberty North - Ice Machine - 000957-L-Room 723	1	Wt	Grab	X								IA

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-330-FD	3/27/2024	15:45	Liberty North - Sink Tap - 003957-Room 600E	1	Wt	Grab	X								1B
1000-331-FD	3/27/2024	15:45	Liberty North - Drinking Fountain - 003958-Between 600F/600E	1	Wt	Grab	X								1C
1000-332-FD	3/27/2024	15:45	Liberty North - Bottle Filler - 003058F-Between 600E/600F	1	Wt	Grab	X								1D
1000-333-FD	3/27/2024	15:46	Liberty North - Sink Tap - 003956-Room 600F	1	Wt	Grab	X								1E
1000-334-FD	3/27/2024	15:50	Liberty North - Ice Machine - 002571-Room 505	1	Wt	Grab	X								1F
1000-335-FD	3/27/2024	15:50	Liberty North - Sink Tap - 004135-Staff Lounge-Boys RR	1	Wt	Grab	X								1G
1000-336-FD	3/27/2024	15:51	Liberty North - Sink Tap - 004136-Staff Lounge-Girls RR	1	Wt	Grab	X								1H

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___	600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___	3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X	835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___	205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023
---	---	---	---	---	---	---	---

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-337-FD	3/27/2024	15:51	Liberty North - Sink Tap - 004137-Room 505- Between Bathrooms	1	Wt	Grab	X								11
1000-338-FD	3/27/2024	15:52	Liberty North - Sink Tap - 004138-Room 505-By Refrigerator	1	Wt	Grab	X								1J
1000-339-FD	3/27/2024	15:54	Liberty North - Sink Tap - 003955-Cafeteria-Boys	1	Wt	Grab	X								1K
1000-340-FD	3/27/2024	15:54	Liberty North - Sink Tap - 003951-Cafeteria-Boys	1	Wt	Grab	X								1L
1000-341-FD	3/27/2024	15:54	Liberty North - Sink Tap - 003950-Cafeteria-Boys	1	Wt	Grab	X								1M
1000-342-FD	3/27/2024	15:55	Liberty North - Sink Tap - 003952-Cafeteria-Girls	1	Wt	Grab	X								1N
1000-343-FD	3/27/2024	15:55	Liberty North - Sink Tap - 003953-Cafeteria-Girls	1	Wt	Grab	X								1O

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-344-FD	3/27/2024	15:55	Liberty North - Sink Tap - 003954-Cafeteria-Girls	1	Wt	Grab	X								1P
1000-345-FD	3/27/2024	15:57	Liberty North - Sink Tap - 004615-Kitchen	1	Wt	Grab	X								1Q
1000-346-FD	3/27/2024	15:57	Liberty North - Ice Machine - 002574-Kitchen	1	Wt	Grab	X								1R
1000-347-FD	3/27/2024	15:57	Liberty North - Sink Tap - 004610-Kitchen	1	Wt	Grab	X								1S
1000-348-FD	3/27/2024	15:57	Liberty North - Sink Tap - 004609-Kitchen	1	Wt	Grab	X								1T
1000-349-FD	3/27/2024	15:58	Liberty North - Sink Tap - 004607-Kitchen-3 Bay Sink	1	Wt	Grab	X								1U
1000-350-FD	3/27/2024	15:58	Liberty North - Sink Tap - 004608-Kitchen	1	Wt	Grab	X								1V

LAB USE ONLY:
Wk Order #:
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-351-FD	3/27/2024	15:58	Liberty North - Sink Tap - 004611-Kitchen-Handwashing by 3 Bay Sink	1	Wt	Grab	X								1W
1000-352-FD	3/27/2024	15:59	Liberty North - Sink Tap - 004605-Kitchen-Across from freezer	1	Wt	Grab	X								1X
1000-353-FD	3/27/2024	15:59	Liberty North - Sink Tap - 004606-Kitchen-Across from freezer	1	Wt	Grab	X								1Y
1000-354-FD	3/27/2024	15:59	Liberty North - Sink Tap - 004603-Kitchen-Across from Kettle	1	Wt	Grab	X								1Z
1000-355-FD	3/27/2024	16:00	Liberty North - Sink Tap - 004604-Kitchen-Next to Kettle	1	Wt	Grab	X								JA
1000-356-FD	3/27/2024	16:00	Liberty North - Steam Kettle - 002368-Kitchen	1	Wt	Grab	X								JB
1000-357-FD	3/27/2024	16:00	Liberty North - Steam Kettle - 002367-Kitchen	1	Wt	Grab	X								JC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-358-FD	3/27/2024	16:01	Liberty North - Steam Kettle - 002366-Kitchen	1	Wt	Grab	X								JD
1000-359-FD	3/27/2024	16:01	Liberty North - Sink Tap - 002572-Kitchen by 507D	1	Wt	Grab	X								JE
1000-360-FD	3/27/2024	16:01	Liberty North - Sink Tap - 004601-Kitchen-Handwashing by Office	1	Wt	Grab	X								JF
1000-361-FD	3/27/2024	16:02	Liberty North - Steam Kettle - 002365-Kitchen	1	Wt	Grab	X								JG
1000-362-FD	3/27/2024	16:02	Liberty North - Sink Tap - 004602-Kitchen-Handwashing by Office	1	Wt	Grab	X								JH
1000-363-FD	3/27/2024	16:02	Liberty North - Sink Tap - 004870-Kitchen-Across from Office	1	Wt	Grab	X								JI
1000-364-FD	3/27/2024	16:03	Liberty North - Sink Tap - 004868-Kitchen-Bathroom	1	Wt	Grab	X								JJ

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date: / Time:		Received by: (Signature)	Date: / Time:	
					Remarks:
Relinquied by: (Signature)	Date: / Time:		Received by: (Signature)	Date: / Time:	

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-365-FD	3/27/2024	16:03	Liberty North - Sink Tap - 004869-Kitchen-Bathroom	1	Wt	Grab	X								JK
1000-366-FD	3/27/2024	16:04	Liberty North - Sink Tap - 004616-Kitchen-By Eagle Cafe Logo	1	Wt	Grab	X								JL
1000-367-FD	3/27/2024	16:04	Liberty North - Sink Tap - 002575-Kitchen	1	Wt	Grab	X								JM
1000-368-FD	3/27/2024	16:04	Liberty North - Sink Tap - 004617-Kitchen-Middle serving line	1	Wt	Grab	X								JN
1000-369-FD	3/27/2024	16:05	Liberty North - Sink Tap - 004613-Kitchen-Dishwasher Room	1	Wt	Grab	X								JO
1000-370-FD	3/27/2024	16:05	Liberty North - Sink Tap - 004614-Kitchen-Dishwasher Room	1	Wt	Grab	X								JP
1000-371-FD	3/27/2024	16:05	Liberty North - Sink Tap - 004618-Kitchen-Serving line	1	Wt	Grab	X								JQ

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00051

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-372-FD	3/27/2024	16:06	Liberty North - Sink Tap - 004612-Kitchen	1	Wt	Grab	X								JR
1000-373-FD	3/27/2024	16:07	Liberty North - Drinking Fountain - 002573-Kitchen	1	Wt	Grab	X								JS

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD0051

AXIOM Service Professionals

PM: Carolyn Jackson

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HE0037

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: Liberty North

Project / PO Number: Liberty North
Received: 05/02/2024
Reported: 05/10/2024

Work Order Special Information

Young, Bradly
Liberty North

Analytical Testing Parameters

Client Sample ID: 1000-112-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-01
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0422	RVV

Client Sample ID: 1000-113-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-02
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0428	RVV

Client Sample ID: 1000-118-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-03
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0434	RVV

Client Sample ID: 1000-119-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-04
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0440	RVV

CERTIFICATE OF ANALYSIS

3HE0037

Client Sample ID: 1000-131-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-05
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0445	RVV

Client Sample ID: 1000-198-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-06
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0451	RVV

Client Sample ID: 1000-246-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-07
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0509	RVV

Client Sample ID: 1000-247-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-08
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0515	RVV

Client Sample ID: 1000-248-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-09
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0521	RVV

CERTIFICATE OF ANALYSIS

3HE0037

Client Sample ID: 1000-249-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-10
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0527	RVV

Client Sample ID: 1000-250-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-11
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0533	RVV

Client Sample ID: 1000-251-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-12
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0539	RVV

Client Sample ID: 1000-252-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-13
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0545	RVV

Client Sample ID: 1000-253-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-14
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0603	RVV

CERTIFICATE OF ANALYSIS

3HE0037

Client Sample ID: 1000-254-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-15
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0632	RVV

Client Sample ID: 1000-255-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-16
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0638	RVV

Client Sample ID: 1000-256-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-17
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0644	RVV

Client Sample ID: 1000-275-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-18
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0650	RVV

Client Sample ID: 1000-276-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HE0037-19
Collected By: Young, Bradly
Collection Date: 05/01/2024 22:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0656	RVV

Definitions

RL: Reporting Limit

Report Comments

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
05/10/24 13:21

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HE0037
														Short Hold:	
														Rush:	
														Temp: oC	20.0
1000-112-FD	5/1/2024	22:40	Liberty North - Drinking Fountain - 003935-Boys by 403-Right	1	Wt	Grab	X								3HE0037-01
1000-113-FD	5/1/2024	22:40	Liberty North - Drinking Fountain - 003936-Boys by 403-Left	1	Wt	Grab	X								02
1000-118-FD	5/1/2024	22:41	Liberty North - Drinking Fountain - 003941-Girls by 403-Right	1	Wt	Grab	X								03
1000-119-FD	5/1/2024	22:41	Liberty North - Drinking Fountain - 003942-Girls by 403-Left	1	Wt	Grab	X								04
1000-131-FD	5/1/2024	22:43	Liberty North - Sink Tap - 003924-Girls Locker Room by 409-Right	1	Wt	Grab	X								05
1000-198-FD	5/1/2024	22:47	Liberty North - Drinking Fountain - 004194-Fieldhouse	1	Wt	Grab	X								06
1000-246-FD	5/1/2024	22:51	Liberty North - Drinking Fountain - 004088-New 900 Hall-Left	1	Wt	Grab	X								07

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	05/02/24
	Time:			Time:	12:00

3 H E 0 0 3 7

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Northeast 104th Street	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-254-FD	5/1/2024	22:53	Liberty North - Sink Tap - 004047-New 900 Hall-Girls-Right Middle	1	Wt	Grab	X								3HE0037-15
1000-255-FD	5/1/2024	22:54	Liberty North - Sink Tap - 004048-New 900 Hall-Girls-Left Middle	1	Wt	Grab	X								16
1000-256-FD	5/1/2024	22:54	Liberty North - Sink Tap - 004049-New 900 Hall-Girls-Far Left	1	Wt	Grab	X								17
1000-275-FD	5/1/2024	22:56	Liberty North - Drinking Fountain - 004062-Between Old/New 800 Hall-Left Middle	1	Wt	Grab	X								18
1000-276-FD	5/1/2024	22:56	Liberty North - Drinking Fountain - 004063-Between Old/New 800 Hall-Far Left	1	Wt	Grab	X								19

LAB USE ONLY
Wk Order #: 3HE0037
Short Hold:
Rush:
Temp: oC 20.0

3HE0037

AXIOM Service Professionals
PM: Carolyn Jackson

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	05/02/24
			Carolyn Jackson		
	Time:			Time:	12:00

Appendix D
Photo Log



3/27/2024 - 1000-1 - Liberty North - 003976-Main Office



3/27/2024 - 1000-2 - Liberty North - 002301/3977-Main Office-Staff Restroom-Girls



3/27/2024 - 1000-3 - Liberty North - 003978-Hallway by Main Office



3/27/2024 - 1000-4 - Liberty North - 003994-Old 100 Hall-Boys-Left



3/27/2024 - 1000-5 - Liberty North - 003995-Old 100 Hall-Boys-Right



3/27/2024 - 1000-6 - Liberty North - 03990-Old 100 Hall-Boys-Far Left



3/27/2024 - 1000-7 - Liberty North - 003991-Old 100 Hall-Boys



3/27/2024 - 1000-8 - Liberty North - 003992-Old 100 Hall-Boys



3/27/2024 - 1000-9 - Liberty North - 003993-Old 100 Hallway-Boys



3/27/2024 - 1000-10 - Liberty North - 003801-Old 100 Hall-Girls-Left



3/27/2024 - 1000-11 - Liberty North - 004000-Old 100 Hall-Girls-Right



3/27/2024 - 1000-12 - Liberty North - 003996-Old 100 Hall-Girls-Far Left



3/27/2024 - 1000-13 - Liberty North - 003997-Old 100 Hall-Girls



3/27/2024 - 1000-14 - Liberty North - 003998-Old 100 Hall-Girls



3/27/2024 - 1000-15 - Liberty North - 003999-Old 100 Hall-Girls-Far Right



3/27/2024 - 1000-16 - Liberty North - 003979-Room 110-Southeast Corner



3/27/2024 - 1000-17 - Liberty North - 003980-
Room 110-South Middle



3/27/2024 - 1000-18 - Liberty North - 003981-
Room 110-Southwest Corner



3/27/2024 - 1000-19 - Liberty North - 003982-
Room 110-Northwest Corner



3/27/2024 - 1000-20 - Liberty North - 003983-
Room 110-North Middle



3/27/2024 - 1000-21 - Liberty North - 003984-Room 110-Northeast corner



3/27/2024 - 1000-22 - Liberty North - 000932-L-Room 110



3/27/2024 - 1000-23 - Liberty North - 003987-Room 109



3/27/2024 - 1000-24 - Liberty North - 003988-Room 109



3/27/2024 - 1000-25 - Liberty North - 003989- Room 109




3/27/2024 - 1000-26 - Liberty North - 002579- Room 109



3/27/2024 - 1000-27 - Liberty North - 003986- Room 111



3/27/2024 - 1000-28 - Liberty North - 003985- Room 111

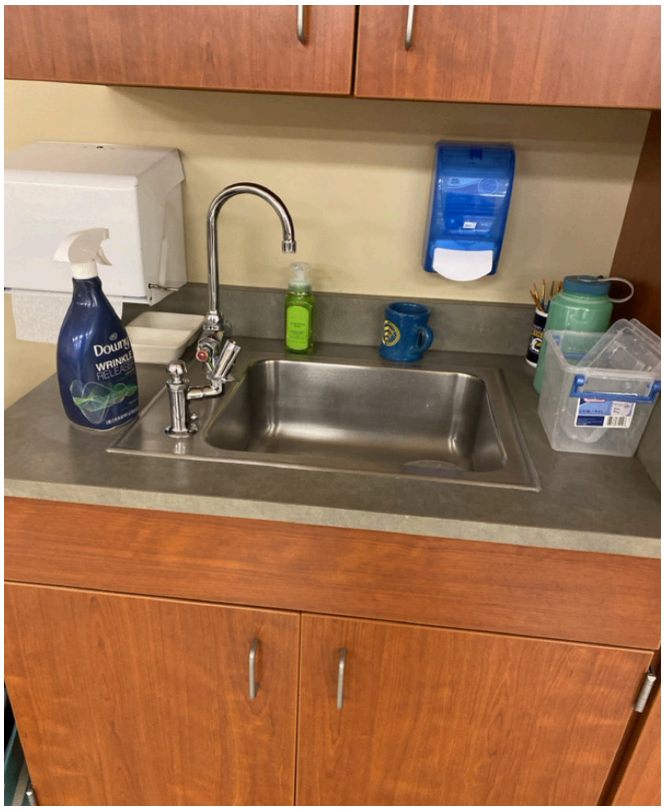


3/27/2024 - 1000-29 - Liberty North - 002580- Room 113



3/27/2024 - 1000-30 - Liberty North - 002581- Room 113



3/27/2024 - 1000-31 - Liberty North - 003819- Between Old/New 100 Hall

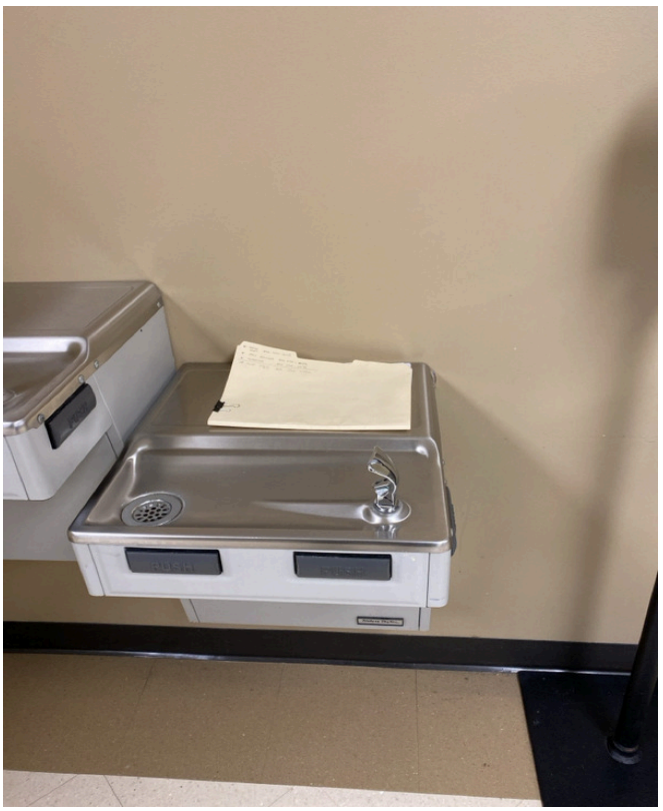

3/27/2024 - 1000-32 - Liberty North - 003820- Between Old/New 100 Hall



3/27/2024 - 1000-33 - Liberty North - 003821- Between Old/New 100 Hall



3/27/2024 - 1000-34 - Liberty North - 003822- Between Old/New 100 Hall



3/27/2024 - 1000-35 - Liberty North - 003802- Room 115



3/27/2024 - 1000-36 - Liberty North - 003803- Room 115



3/27/2024 - 1000-37 - Liberty North - 003804-Room 115



3/27/2024 - 1000-38 - Liberty North - 003805-Room 115-Three Bay Right



3/27/2024 - 1000-39 - Liberty North - 003806-Room 115-Three Bay Middle



3/27/2024 - 1000-40 - Liberty North - 003807-Room 115-Three Bay Left



3/27/2024 - 1000-41 - Liberty North - 003808-
Room 115 Next to Room 116A



3/27/2024 - 1000-42 - Liberty North - 003809-
Room 115 By windows-Left



3/27/2024 - 1000-43 - Liberty North - 003810-
Room 115 By windows



3/27/2024 - 1000-44 - Liberty North - 003811-
Room 115



3/27/2024 - 1000-45 - Liberty North - 003812-Room 116B



3/27/2024 - 1000-46 - Liberty North - 003813-New 100 Hall



3/27/2024 - 1000-47 - Liberty North - 003814B-New 100 Hall



3/27/2024 - 1000-48 - Liberty North - 003814F-New 100 Hall



3/27/2024 - 1000-49 - Liberty North - 003815-Between Restrooms-New 100 Hall



3/27/2024 - 1000-50 - Liberty North - 003816-Between Restrooms-New 100 Hall



3/27/2024 - 1000-51 - Liberty North - 003817-Between Restrooms-New 100 Hall



3/27/2024 - 1000-52 - Liberty North - 003818-Between Restrooms-New 100 Hall-Far Right



3/27/2024 - 1000-53 - Liberty North - 002582-Room 133



3/27/2024 - 1000-54 - Liberty North - 002583-Room 133 Restroom



3/27/2024 - 1000-55 - Liberty North - 002584-Room 133B/Lactation Room



3/27/2024 - 1000-56 - Liberty North - 004039-By 202



3/27/2024 - 1000-57 - Liberty North - 004038-By 202



3/27/2024 - 1000-58 - Liberty North - 004037-Room 212 by Coffee Shop



3/27/2024 - 1000-59 - Liberty North - 004036-Library by Coffee Shop



3/27/2024 - 1000-60 - Liberty North - 004035-Library



3/27/2024 - 1000-61 - Liberty North - 004034-Library



3/27/2024 - 1000-62 - Liberty North - 004033-Library



3/27/2024 - 1000-63 - Liberty North - 004032-Library Coffee Shop



3/27/2024 - 1000-64 - Liberty North - 004031-Library Coffee Shop



3/27/2024 - 1000-65 - Liberty North - 003836-Old 300 Hall-Girls



3/27/2024 - 1000-66 - Liberty North - 003837-Old 300 Hall-Girls-Right



3/27/2024 - 1000-67 - Liberty North - 003839-Old 300 Hall-Girls-Far Left



3/27/2024 - 1000-68 - Liberty North - 003840-Old 300 Hall-Girls



3/27/2024 - 1000-69 - Liberty North - 003838-Old 300 Hall-Girls-Right Middle



3/27/2024 - 1000-70 - Liberty North - 003841-Old 300 Hall-Girls-Far Right



3/27/2024 - 1000-71 - Liberty North - 003835-Old 300 Hall-Boys-Left



3/27/2024 - 1000-72 - Liberty North - 003834-Old 300 Hall-Boys-Right



3/27/2024 - 1000-73 - Liberty North - 003830-Old 300 Hall-Boys-Far Left



3/27/2024 - 1000-74 - Liberty North - 003831-Old 300 Hall-Boys-Left Middle



3/27/2024 - 1000-75 - Liberty North - 003832-Old 300 Hall-Boys-Right Middle



3/27/2024 - 1000-76 - Liberty North - 003833-Old 300 Hall-Boys-Far Right




3/27/2024 - 1000-77 - Liberty North - 002550- Room 307



3/27/2024 - 1000-78 - Liberty North - 003842- Room 307



3/27/2024 - 1000-79 - Liberty North - 003843- Room 307

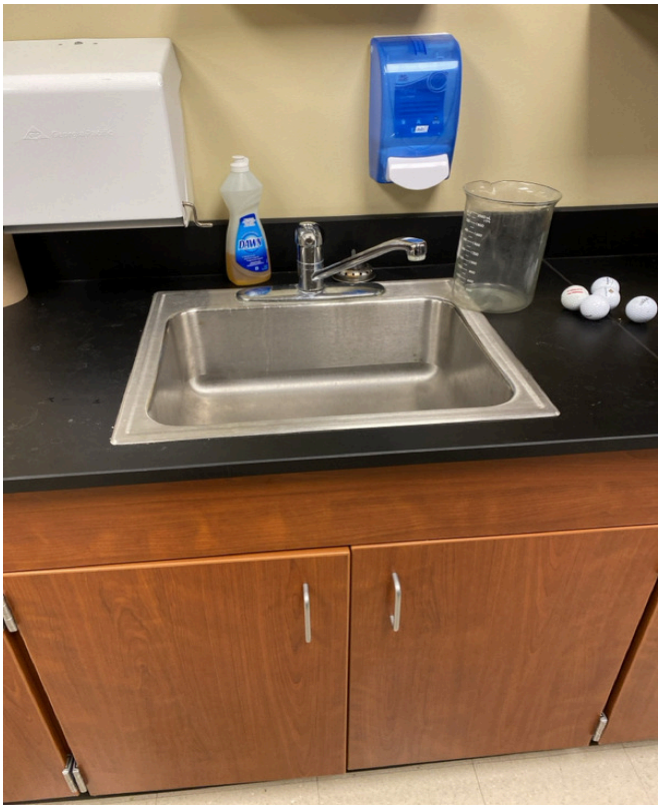

3/27/2024 - 1000-80 - Liberty North - 003844- Room 310 Prep, Inside 307



3/27/2024 - 1000-81 - Liberty North - 003826- Between Old/New 300 Hall-Far Right




3/27/2024 - 1000-82 - Liberty North - 003827- Between Old/New 300 Hall-Right Middle




3/27/2024 - 1000-83 - Liberty North - 003828- Between Old/New 300 Hall-Left Middle



3/27/2024 - 1000-84 - Liberty North - 003829- Between Old/New 300 Hall-Far Left

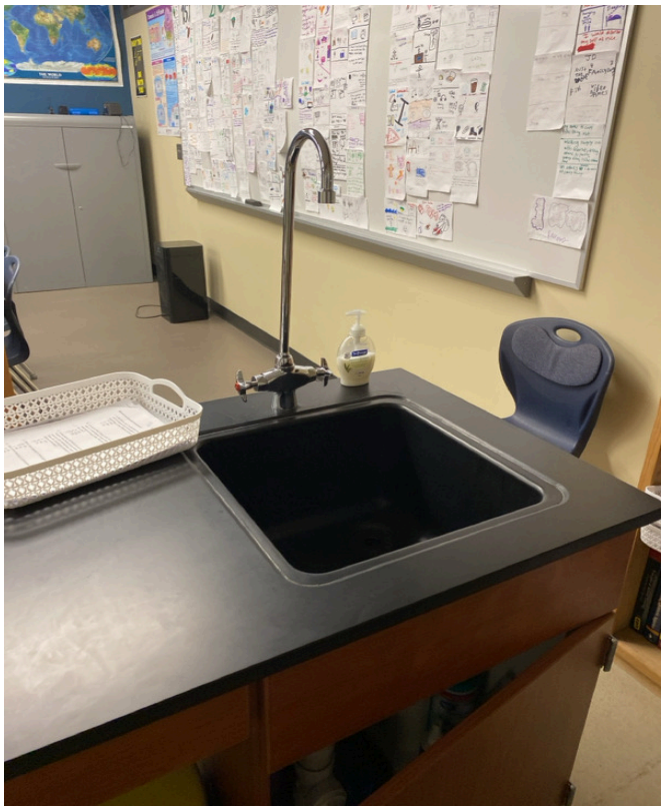

3/27/2024 - 1000-85 - Liberty North - 004021-Room 322

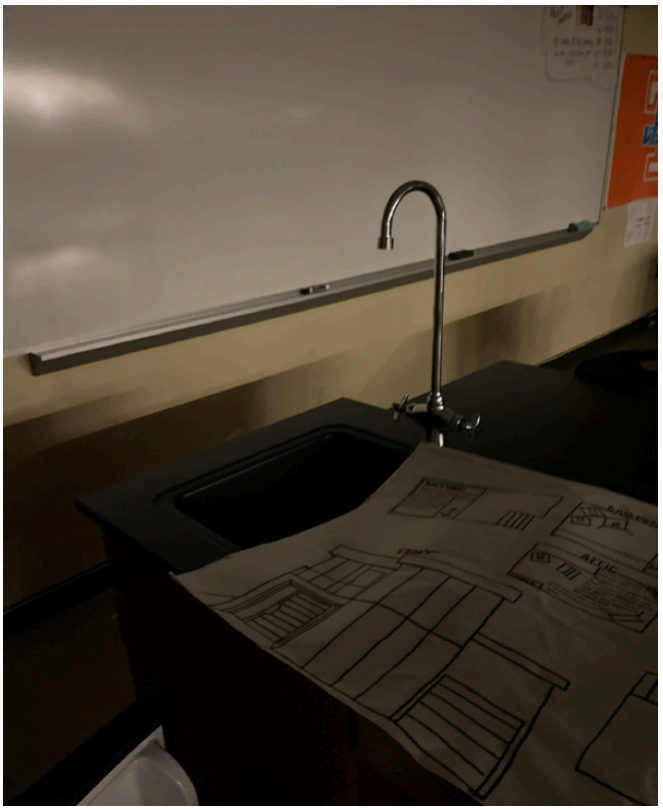

3/27/2024 - 1000-86 - Liberty North - 004020-Room 324




3/27/2024 - 1000-87 - Liberty North - 004022-New 300 Hall-Right



3/27/2024 - 1000-88 - Liberty North - 004022-New 300 Hall



3/27/2024 - 1000-89 - Liberty North - 004023-New 300 Hall-Left

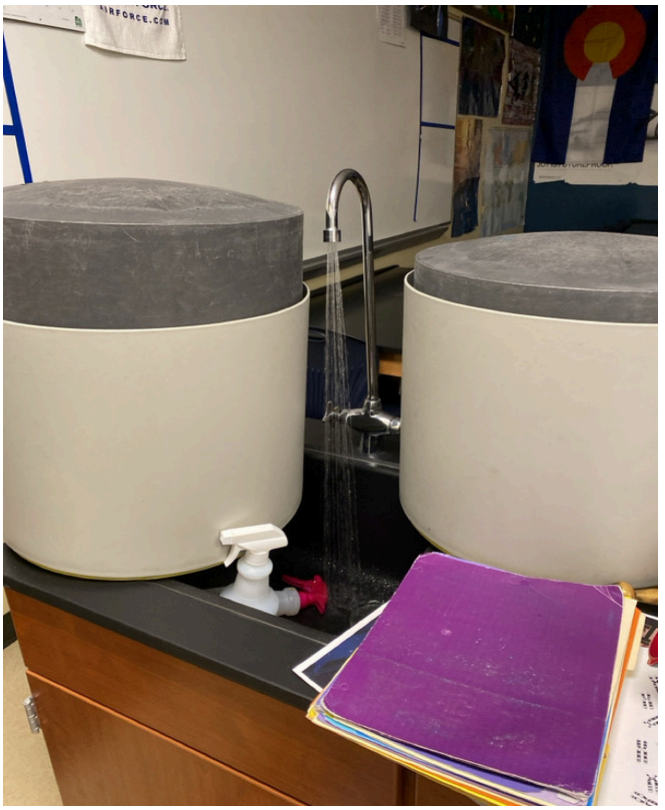

3/27/2024 - 1000-90 - Liberty North - 004024-Room 326



3/27/2024 - 1000-91 - Liberty North - 004025-Room 331



3/27/2024 - 1000-92 - Liberty North - 004026-Next to 331



3/27/2024 - 1000-93 - Liberty North - 002346-Basement Below 300s-Boys-Left



3/27/2024 - 1000-94 - Liberty North - 002347-Basement Below 300s-Boys-Right



3/27/2024 - 1000-95 - Liberty North - 002348-Basement Below 300s-Girls-Left



3/27/2024 - 1000-96 - Liberty North - 002349-Basement Below 300s-Girls-Right



3/27/2024 - 1000-97 - Liberty North - 002344-Basement Below 300s-Left



3/27/2024 - 1000-98 - Liberty North - 002345-Basement Below 300s-Right



3/27/2024 - 1000-99 - Liberty North - 003943-Great Hall-Far Left



3/27/2024 - 1000-100 - Liberty North - 003943F-Great Hall



3/27/2024 - 1000-101 - Liberty North - 003944- Great Hall



3/27/2024 - 1000-102 - Liberty North - 003945- Great Hall



3/27/2024 - 1000-103 - Liberty North - 003946- Great Hall



3/27/2024 - 1000-104 - Liberty North - 003947- Great Hall



3/27/2024 - 1000-105 - Liberty North - 003948-Great Hall



3/27/2024 - 1000-106 - Liberty North - 003949-Great Hall-Far Right



3/27/2024 - 1000-107 - Liberty North - 003949F-Great Hall



3/27/2024 - 1000-108 - Liberty North - 003931-Room 403-Boys



3/27/2024 - 1000-109 - Liberty North - 003932-
Room 403-Boys



3/27/2024 - 1000-110 - Liberty North - 003933-
Room 403-Handwashing



3/27/2024 - 1000-111 - Liberty North - 003934-
Room 403-Handwashing



3/27/2024 - 1000-114 - Liberty North - 003937-
Room 404-Girls-Far Left



3/27/2024 - 1000-115 - Liberty North - 003938-
Room 404-Girls-Left Middle



3/27/2024 - 1000-116 - Liberty North - 003939-
Room 404-Girls



3/27/2024 - 1000-117 - Liberty North - 003940-
Room 404-Girls



3/27/2024 - 1000-120 - Liberty North - 003913-
Room 411-Boys



3/27/2024 - 1000-121 - Liberty North - 003914-Room 411-Boys



3/27/2024 - 1000-122 - Liberty North - 003915-Room 411-Boys



3/27/2024 - 1000-123 - Liberty North - 003916-Room 411-Boys Lockers



3/27/2024 - 1000-124 - Liberty North - 003917-Room 411-Boys Lockers



3/27/2024 - 1000-125 - Liberty North - 003918-Room 411-Boys Lockers-Left



3/27/2024 - 1000-126 - Liberty North - 003919-Room 411-Boys Lockers-Right



3/27/2024 - 1000-127 - Liberty North - 003920-Room 411-Boys Lockers



3/27/2024 - 1000-128 - Liberty North - 003921-Room 411-Boys Lockers



3/27/2024 - 1000-129 - Liberty North - 003922- Next to 409-Girls Lockers



3/27/2024 - 1000-130 - Liberty North - 003923- Next to 409-Girls Lockers



3/27/2024 - 1000-132 - Liberty North - 003925- Girls Locker Room



3/27/2024 - 1000-133 - Liberty North - 003926- Girls Locker Room



3/27/2024 - 1000-134 - Liberty North - 003927-Room 410-Girls Lockers




3/27/2024 - 1000-135 - Liberty North - 003928-Room 410-Girls Lockers



3/27/2024 - 1000-136 - Liberty North - 003929-Rook 410-Girls Lockers




3/27/2024 - 1000-137 - Liberty North - 003930-Room 410-Girls Lockers

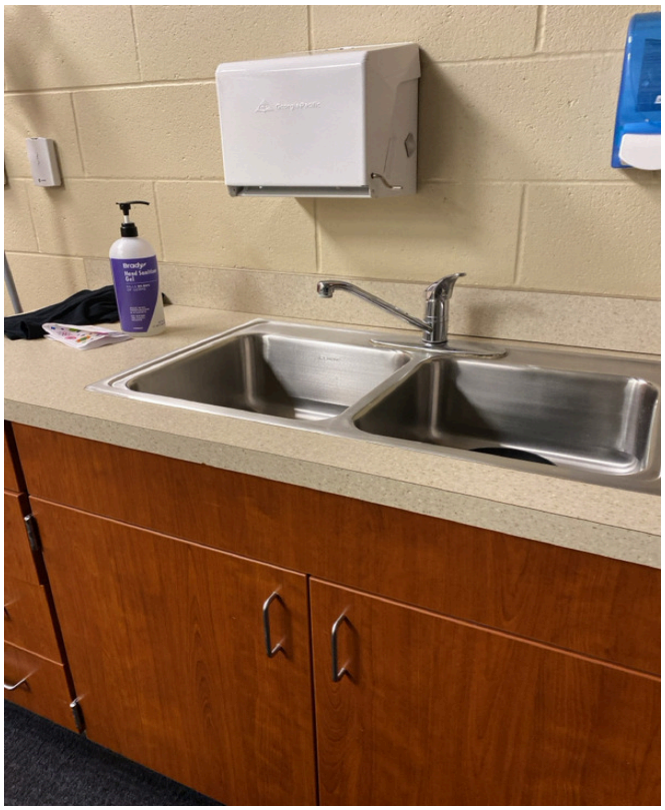

3/27/2024 - 1000-138 - Liberty North - 003912- Room 415



3/27/2024 - 1000-139 - Liberty North - 003909- Concessions-By 401

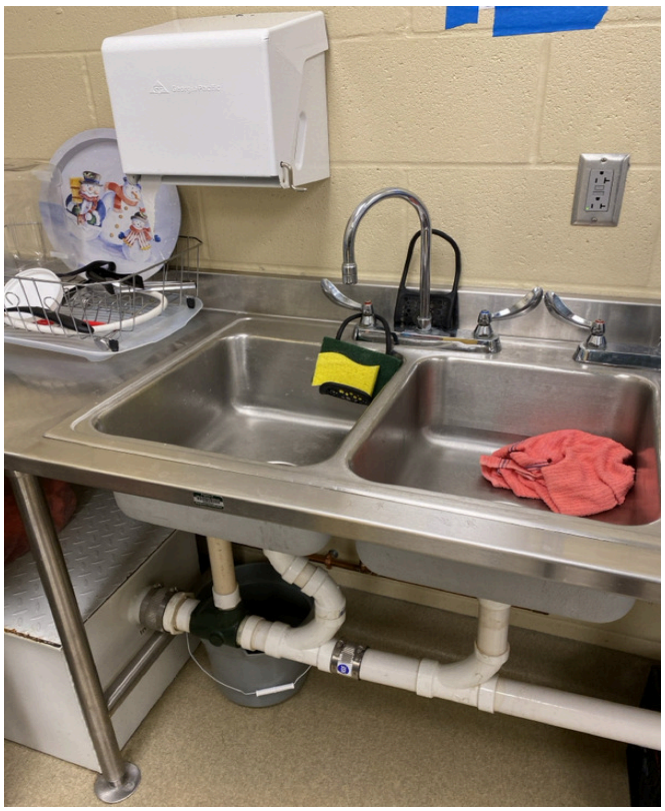

3/27/2024 - 1000-140 - Liberty North - 003910- Concessions By 421



3/27/2024 - 1000-141 - Liberty North - 003911- Concessions By 421



3/27/2024 - 1000-142 - Liberty North - 000788-L-Concession Stand



3/27/2024 - 1000-143 - Liberty North - 004189-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-144 - Liberty North - 004188-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-145 - Liberty North - 004180-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-146 - Liberty North - 004181-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-147 - Liberty North - 004182-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-148 - Liberty North - 004183-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-149 - Liberty North - 004184-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-150 - Liberty North - 004185-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-151 - Liberty North - 004186-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-152 - Liberty North - 004187-Fieldhouse Upstairs-Boys



3/27/2024 - 1000-153 - Liberty North - 004178-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-154 - Liberty North - 004179-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-155 - Liberty North - 004170-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-156 - Liberty North - 004171-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-157 - Liberty North - 004172-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-158 - Liberty North - 004173-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-159 - Liberty North - 004174-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-160 - Liberty North - 004175-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-161 - Liberty North - 004176-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-162 - Liberty North - 004177-Fieldhouse Upstairs-Girls



3/27/2024 - 1000-163 - Liberty North - 004166-Room 510



3/27/2024 - 1000-164 - Liberty North - 004167-Room 510



3/27/2024 - 1000-165 - Liberty North - 004168-Room 510



3/27/2024 - 1000-166 - Liberty North - 004169-Room 510



3/27/2024 - 1000-167 - Liberty North - 004158-500 Hall



3/27/2024 - 1000-168 - Liberty North - 004159-500 Hall



3/27/2024 - 1000-169 - Liberty North - 004160-500 Hall-Boys



3/27/2024 - 1000-170 - Liberty North - 004161-500 Hall-Boys



3/27/2024 - 1000-171 - Liberty North - 004162-500 Hall-Boys



3/27/2024 - 1000-172 - Liberty North - 004163-500 Hall-Girls



3/27/2024 - 1000-173 - Liberty North - 004164-500 Hall-Girls



3/27/2024 - 1000-174 - Liberty North - 004165-500 Hall-Girls



3/27/2024 - 1000-175 - Liberty North - 002577-Room 515



3/27/2024 - 1000-176 - Liberty North - 004154-Room 514



3/27/2024 - 1000-177 - Liberty North - 004155-Room 514



3/27/2024 - 1000-178 - Liberty North - 004156- Room 514



3/27/2024 - 1000-179 - Liberty North - 004157- Room 514




3/27/2024 - 1000-180 - Liberty North - 004151- Room 516



3/27/2024 - 1000-181 - Liberty North - 004152- Room 516



3/27/2024 - 1000-182 - Liberty North - 004153-Room 516

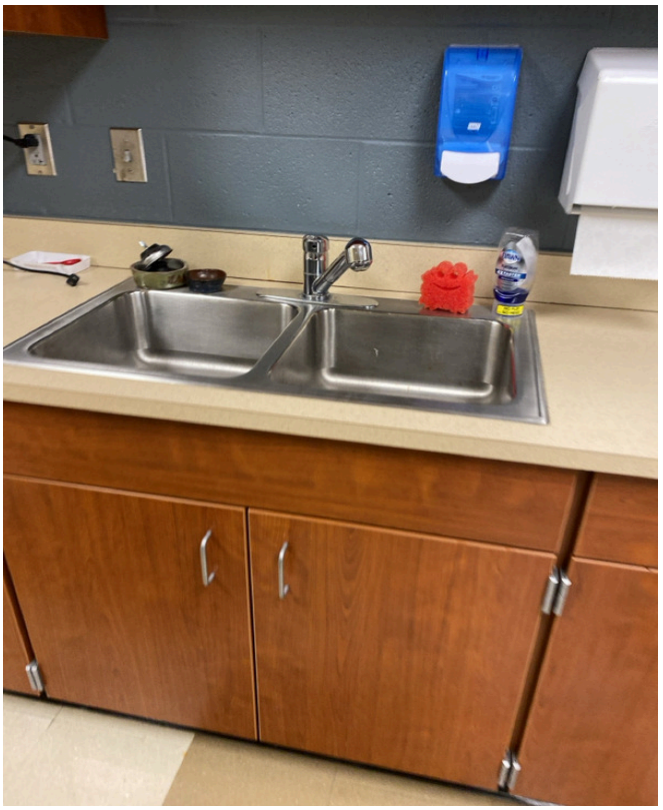

3/27/2024 - 1000-183 - Liberty North - 004147-Room 517



3/27/2024 - 1000-184 - Liberty North - 004146-Room 517-Restroom



3/27/2024 - 1000-185 - Liberty North - 004149-Room 520



3/27/2024 - 1000-186 - Liberty North - 004148- Room 520



3/27/2024 - 1000-187 - Liberty North - 004150- Room 520



3/27/2024 - 1000-188 - Liberty North - 004143- Room 521 #4



3/27/2024 - 1000-189 - Liberty North - 004142- Room 521 #3



3/27/2024 - 1000-190 - Liberty North - 004144- Room 521 #2



3/27/2024 - 1000-191 - Liberty North - 004145- Room 521 #1




3/27/2024 - 1000-192 - Liberty North - 004141- Room 523



3/27/2024 - 1000-193 - Liberty North - 004139- Room 523 By Entry



3/27/2024 - 1000-194 - Liberty North - 004140-Room 523 By Entry

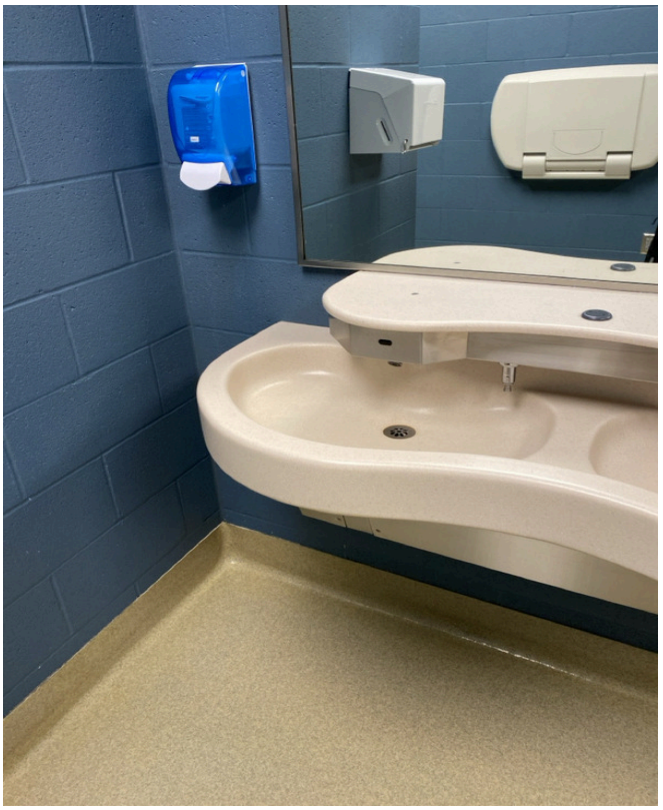

3/27/2024 - 1000-195 - Liberty North - 004196-Fieldhouse Downstairs-Boys



3/27/2024 - 1000-196 - Liberty North - 004197-Fieldhouse Downstairs-Boys




3/27/2024 - 1000-197 - Liberty North - 004195-Fieldhouse




3/27/2024 - 1000-199 - Liberty North - 004193-Fieldhouse



3/27/2024 - 1000-200 - Liberty North - 004192-Fieldhouse

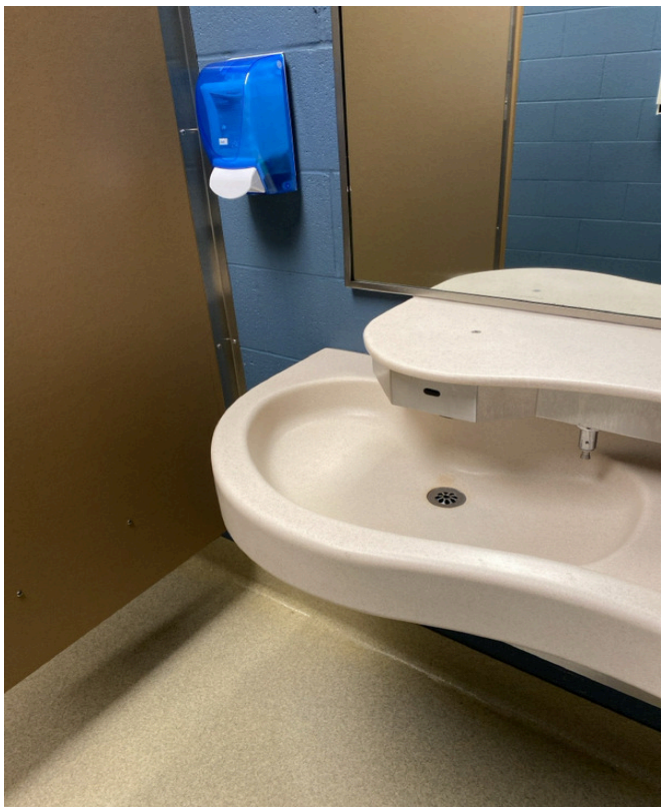

3/27/2024 - 1000-201 - Liberty North - 004190-Fieldhouse Downstairs-Girls

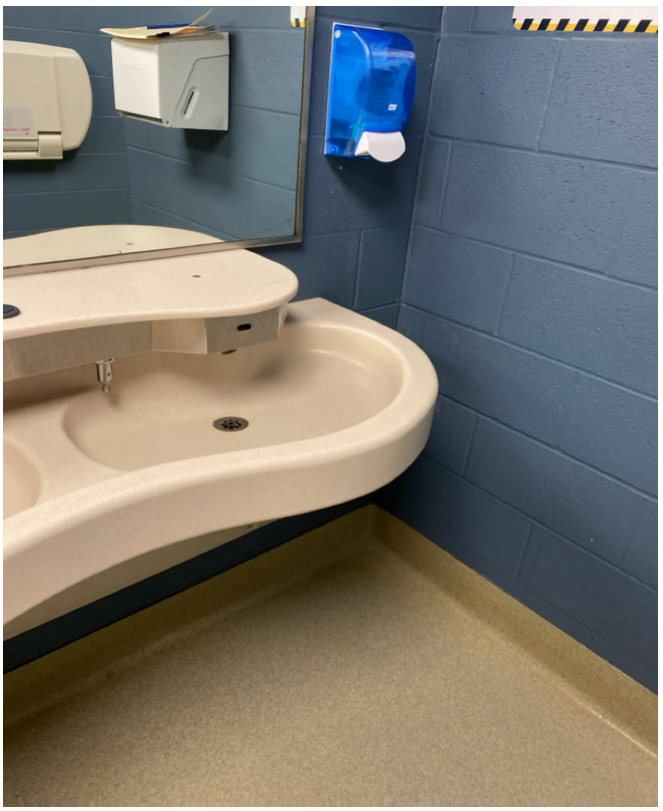

3/27/2024 - 1000-202 - Liberty North - 004191-Fieldhouse Downstairs-Girls



3/27/2024 - 1000-203 - Liberty North - 002592- Coaches Office



3/27/2024 - 1000-204 - Liberty North - 003908- Room 11



3/27/2024 - 1000-205 - Liberty North - 003907- Room 11-Girls Lockers



3/27/2024 - 1000-206 - Liberty North - 003906- Room 11-Girls Lockers



3/27/2024 - 1000-207 - Liberty North - 002591-Room 012B-Restroom



3/27/2024 - 1000-208 - Liberty North - 003905-Coaches Office-014B



3/27/2024 - 1000-209 - Liberty North - 003904-Field House-Boys Lockers



3/27/2024 - 1000-210 - Liberty North - 003903-Fieldhouse-Boys Lockers



3/27/2024 - 1000-211 - Liberty North - 004199- Fieldhouse



3/27/2024 - 1000-212 - Liberty North - 004198- Fieldhouse



3/27/2024 - 1000-213 - Liberty North - 004200- Room 15



3/27/2024 - 1000-214 - Liberty North - 003902- Room 15



3/27/2024 - 1000-215 - Liberty North - 003901-Room 15



3/27/2024 - 1000-216 - Liberty North - 004040-Old 900 Hall-Girls



3/27/2024 - 1000-217 - Liberty North - 004041-Old 900 Hall-Girls



3/27/2024 - 1000-218 - Liberty North - 004042-Old 900 Hall-Girls



3/27/2024 - 1000-219 - Liberty North - 004043-Old 900 Hall-Girls



3/27/2024 - 1000-220 - Liberty North - 004044-Old 900 Hall-Girls



3/27/2024 - 1000-221 - Liberty North - 004045-Old 900 Hall-Girls



3/27/2024 - 1000-222 - Liberty North - 002350-Old 900 Hall-Boys



3/27/2024 - 1000-223 - Liberty North - 002351-Old 900 Hall-Boys



3/27/2024 - 1000-224 - Liberty North - 002352-Old 900 Hall-Boys



3/27/2024 - 1000-225 - Liberty North - 002353-Old 900 Hall-Boys



3/27/2024 - 1000-226 - Liberty North - 002354-Old 900 Hall-Boys



3/27/2024 - 1000-227 - Liberty North - 002355-Old 900 Hall-Boys



3/27/2024 - 1000-228 - Liberty North - 004076-Room 902



3/27/2024 - 1000-229 - Liberty North - 004077-Room 902



3/27/2024 - 1000-230 - Liberty North - 002603-Room 904



3/27/2024 - 1000-231 - Liberty North - 002604- Room 904



3/27/2024 - 1000-232 - Liberty North - 004078- Room 909




3/27/2024 - 1000-233 - Liberty North - 004079- Room 909



3/27/2024 - 1000-234 - Liberty North - 004080- Room 910



3/27/2024 - 1000-235 - Liberty North - 004081- Room 910

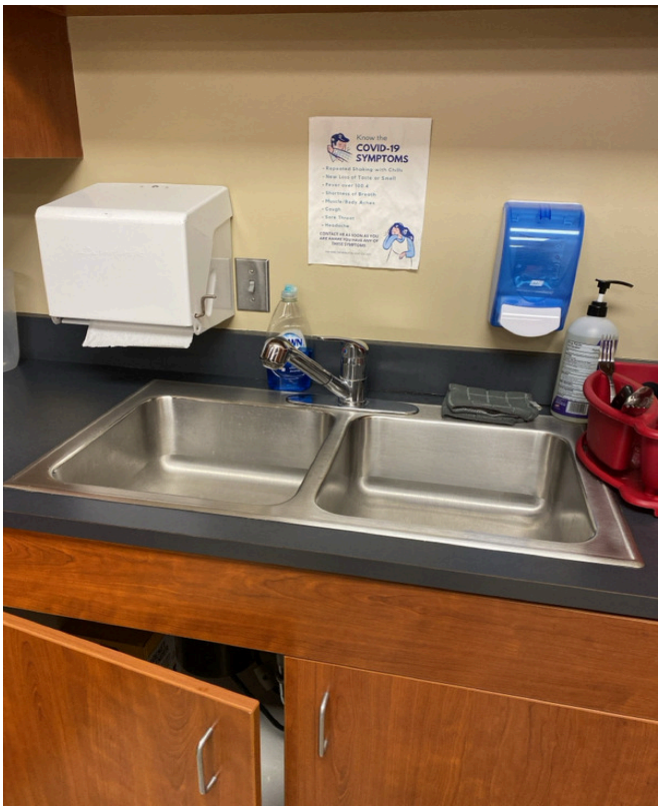


3/27/2024 - 1000-236 - Liberty North - 004084- Room 915



3/27/2024 - 1000-237 - Liberty North - 004085- Room 915-Restroom



3/27/2024 - 1000-238 - Liberty North - 004082- Room 916

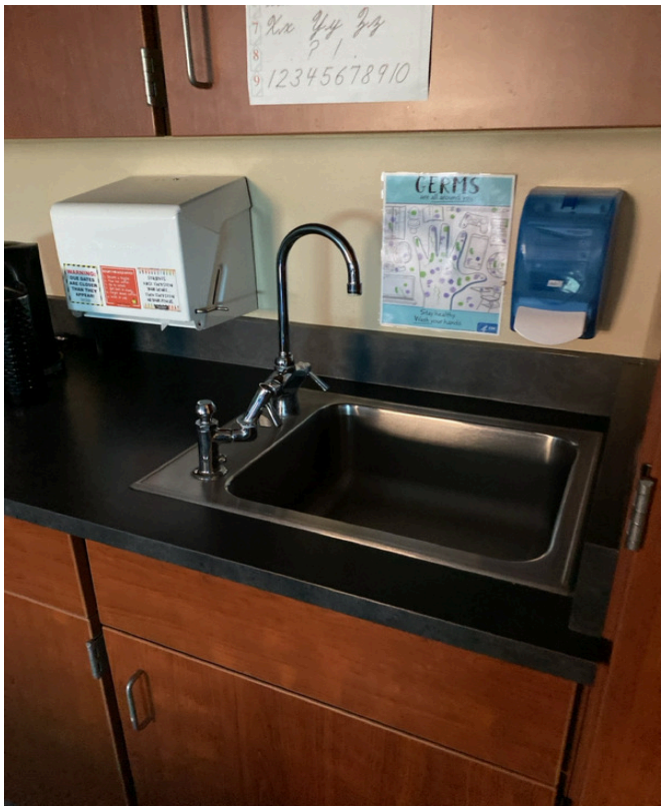

3/27/2024 - 1000-239 - Liberty North - 004083- Room 916



3/27/2024 - 1000-240 - Liberty North - 004064- Between Old/New 900 Hall



3/27/2024 - 1000-241 - Liberty North - 004065- Between Old/New 900 Hall



3/27/2024 - 1000-242 - Liberty North - 004066- Between Old/New 900 Hall



3/27/2024 - 1000-243 - Liberty North - 004067- Between Old/New 900 Hall



3/27/2024 - 1000-244 - Liberty North - 004086- Room 919



3/27/2024 - 1000-245 - Liberty North - 004087- Room 919-Restroom



3/27/2024 - 1000-257 - Liberty North - 004095- Room 914



3/27/2024 - 1000-258 - Liberty North - 004094- Room 914



3/27/2024 - 1000-259 - Liberty North - 004098- Room 912



3/27/2024 - 1000-260 - Liberty North - 004097- Room 912



3/27/2024 - 1000-261 - Liberty North - 004096- Room 908



3/27/2024 - 1000-262 - Liberty North - 004099- Room 907



3/27/2024 - 1000-263 - Liberty North - 004100- Room 907



3/27/2024 - 1000-264 - Liberty North - 002602- Room 905




3/27/2024 - 1000-265 - Liberty North - 002601- Room 905



3/27/2024 - 1000-266 - Liberty North - 004050- New 800 Hall-Boys



3/27/2024 - 1000-267 - Liberty North - 004051- New 800 Hall-Boys

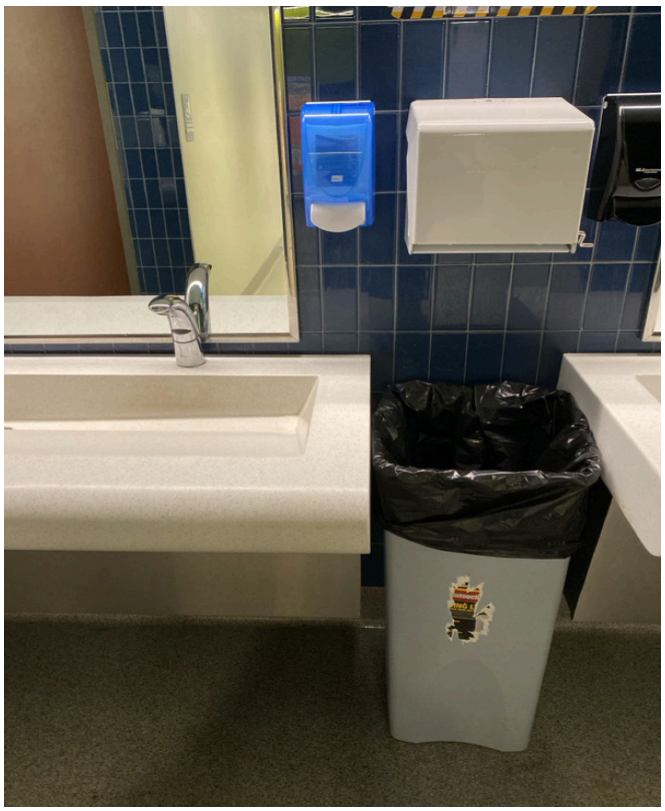

3/27/2024 - 1000-268 - Liberty North - 004052- New 800 Hall-Girls



3/27/2024 - 1000-269 - Liberty North - 004053- New 800 Hall-Girls



3/27/2024 - 1000-270 - Liberty North - 002626B- New 800 Hall



3/27/2024 - 1000-271 - Liberty North - 002626F- New 800 Hall



3/27/2024 - 1000-272 - Liberty North - 002627- New 800 Hall



3/27/2024 - 1000-273 - Liberty North - 004060- Between Old/New 800 Hall



3/27/2024 - 1000-274 - Liberty North - 004061- Between Old/New 800 Hall



3/27/2024 - 1000-277 - Liberty North - 002615- Room 822



3/27/2024 - 1000-278 - Liberty North - 002616- Room 822



3/27/2024 - 1000-279 - Liberty North - 002617- Room 813



3/27/2024 - 1000-280 - Liberty North - 002619- Room 817



3/27/2024 - 1000-281 - Liberty North - 002618- Room 817



3/27/2024 - 1000-282 - Liberty North - 002621- Room 812



3/27/2024 - 1000-283 - Liberty North - 002620- Room 812



3/27/2024 - 1000-284 - Liberty North - 002622- Room 810



3/27/2024 - 1000-285 - Liberty North - 002623- Room 810



3/27/2024 - 1000-286 - Liberty North - 002625- Room 809



3/27/2024 - 1000-287 - Liberty North - 002624- Room 809-Handwashing



3/27/2024 - 1000-288 - Liberty North - 004058-Old 800 Hall-Girls



3/27/2024 - 1000-289 - Liberty North - 004059-Old 800 Hall-Girls



3/27/2024 - 1000-290 - Liberty North - 004055-Old 800 Hall-Girls



3/27/2024 - 1000-291 - Liberty North - 004054-Old 800 Hall-Girls




3/27/2024 - 1000-292 - Liberty North - 004057-Old 800 Hall-Girls



3/27/2024 - 1000-293 - Liberty North - 004056-Old 800 Hall-Girls



3/27/2024 - 1000-294 - Liberty North - 002585-Old 800 Hall-Boys

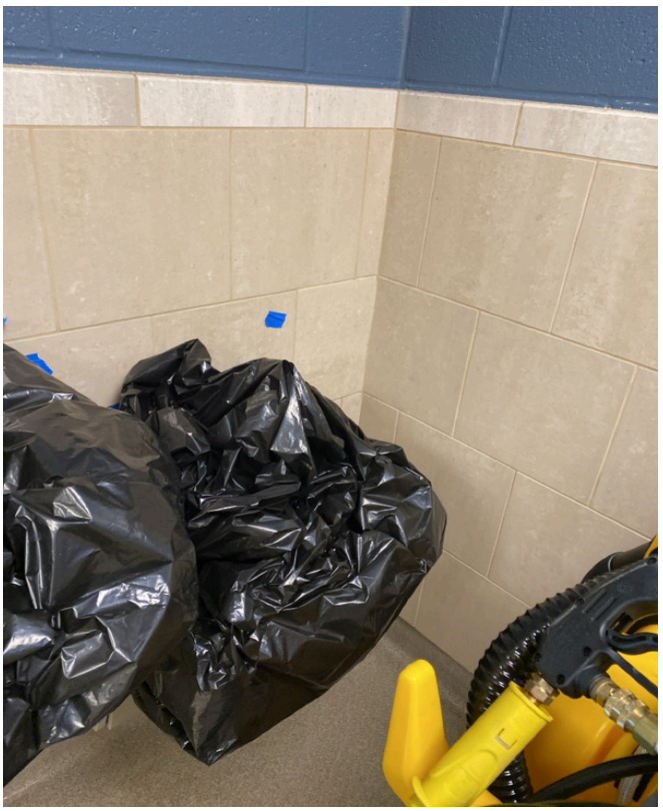

3/27/2024 - 1000-295 - Liberty North - 002586-Old 800 Hall-Boys



3/27/2024 - 1000-296 - Liberty North - 002587-Old 800 Hall-Boys



3/27/2024 - 1000-297 - Liberty North - 002588-Old 800 Hall-Boys



3/27/2024 - 1000-298 - Liberty North - 002589-Old 800 Hall-Boys



3/27/2024 - 1000-299 - Liberty North - 002590-Old 800 Hall-Boys



3/27/2024 - 1000-300 - Liberty North - 002606- Room 808



3/27/2024 - 1000-301 - Liberty North - 002605- Room 808



3/27/2024 - 1000-302 - Liberty North - 002608- Room 815



3/27/2024 - 1000-303 - Liberty North - 002607- Room 815



3/27/2024 - 1000-304 - Liberty North - 002610- Room 816



3/27/2024 - 1000-305 - Liberty North - 002609- Room 816



3/27/2024 - 1000-306 - Liberty North - 002611- Room 820



3/27/2024 - 1000-307 - Liberty North - 002612- Room 820



3/27/2024 - 1000-308 - Liberty North - 002614-Room 821



3/27/2024 - 1000-309 - Liberty North - 002613-Room 821-Restroom



3/27/2024 - 1000-310 - Liberty North - 003965-600 Hall



3/27/2024 - 1000-311 - Liberty North - 003965F-600 Hall



3/27/2024 - 1000-312 - Liberty North - 003966-600 Hall



3/27/2024 - 1000-313 - Liberty North - 003969-600 Hall-Girls



3/27/2024 - 1000-314 - Liberty North - 003968-600 Hall-Girls



3/27/2024 - 1000-315 - Liberty North - 003967-600 Hall-Girls



3/27/2024 - 1000-316 - Liberty North - 003962-600 Hall-Boys



3/27/2024 - 1000-317 - Liberty North - 003963-600 Hall-Boys




3/27/2024 - 1000-318 - Liberty North - 003964-600 Hall-Boys




3/27/2024 - 1000-319 - Liberty North - 003971-Room 604



3/27/2024 - 1000-320 - Liberty North - 003970-Room 604

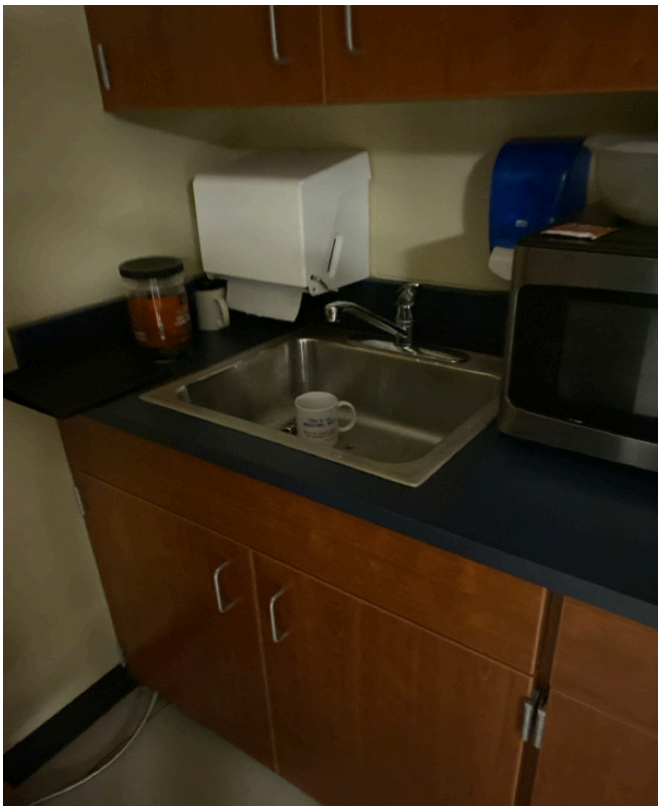

3/27/2024 - 1000-321 - Liberty North - 003975-Room 608A

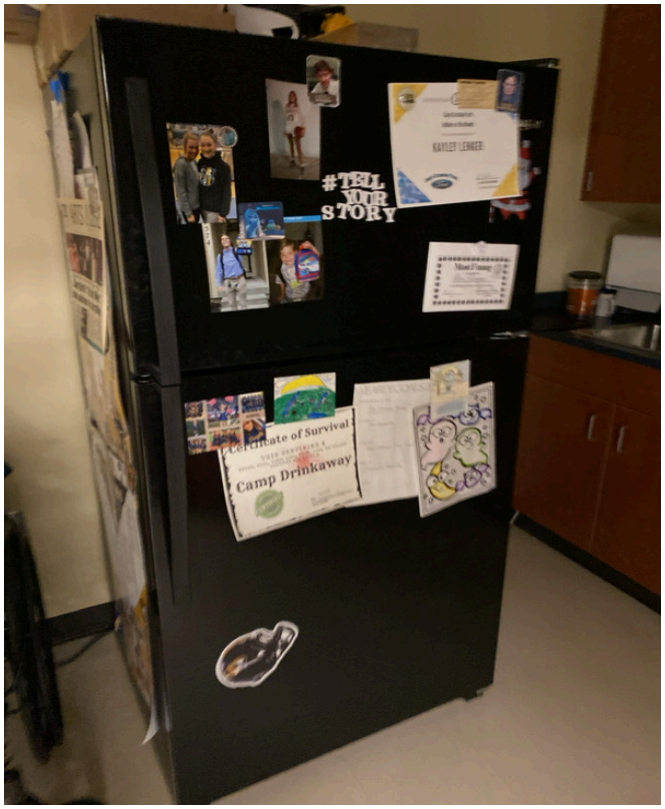

3/27/2024 - 1000-322 - Liberty North - 002578-Room 608A



3/27/2024 - 1000-323 - Liberty North - 003972-Room 609E



3/27/2024 - 1000-324 - Liberty North - 003973- Room 617C



3/27/2024 - 1000-325 - Liberty North - 003974- Room 617C



3/27/2024 - 1000-326 - Liberty North - 003961- Nurse's Office



3/27/2024 - 1000-327 - Liberty North - 003960- Room 723



3/27/2024 - 1000-328 - Liberty North - 003959- Room 723



3/27/2024 - 1000-329 - Liberty North - 000957-L- Room 723



3/27/2024 - 1000-330 - Liberty North - 003957- Room 600E



3/27/2024 - 1000-331 - Liberty North - 003958- Between 600F/600E



3/27/2024 - 1000-332 - Liberty North - 003058F- Between 600E/600F



3/27/2024 - 1000-332 - Liberty North - 003058F- Between 600E/600F



3/27/2024 - 1000-333 - Liberty North - 003956- Room 600F



3/27/2024 - 1000-334 - Liberty North - 002571- Room 505



3/27/2024 - 1000-335 - Liberty North - 004135-Staff Lounge-Boys Restroom



3/27/2024 - 1000-336 - Liberty North - 004136-Staff Lounge-Girls Restroom



3/27/2024 - 1000-337 - Liberty North - 004137-Room 505-Between Restrooms



3/27/2024 - 1000-338 - Liberty North - 004138-Room 505-By Refrigerator



3/27/2024 - 1000-339 - Liberty North - 003955-Cafeteria-Boys



3/27/2024 - 1000-340 - Liberty North - 003951-Cafeteria-Boys



3/27/2024 - 1000-341 - Liberty North - 003950-Cafeteria-Boys



3/27/2024 - 1000-342 - Liberty North - 003952-Cafeteria-Girls



3/27/2024 - 1000-343 - Liberty North - 003953-Cafeteria-Girls



3/27/2024 - 1000-344 - Liberty North - 003954-Cafeteria-Girls



3/27/2024 - 1000-345 - Liberty North - 004615-Kitchen



3/27/2024 - 1000-346 - Liberty North - 002574-Kitchen



3/27/2024 - 1000-347 - Liberty North - 004610-Kitchen



3/27/2024 - 1000-348 - Liberty North - 004609-Kitchen



3/27/2024 - 1000-349 - Liberty North - 004607-Kitchen-Three Bay Sink



3/27/2024 - 1000-350 - Liberty North - 004608-Kitchen



3/27/2024 - 1000-351 - Liberty North - 004611-Kitchen-Handwashing By Three Bay Sink



3/27/2024 - 1000-352 - Liberty North - 004605-Kitchen-Across From Freezer



3/27/2024 - 1000-353 - Liberty North - 004606-Kitchen-Across From Freezer



3/27/2024 - 1000-354 - Liberty North - 004603-Kitchen-Across From Kettle



3/27/2024 - 1000-355 - Liberty North - 004604-Kitchen-Next to Kettle



3/27/2024 - 1000-356 - Liberty North - 002368-Kitchen



3/27/2024 - 1000-357 - Liberty North - 002367-Kitchen



3/27/2024 - 1000-358 - Liberty North - 002366-Kitchen



3/27/2024 - 1000-359 - Liberty North - 002572-Kitchen by 507D



3/27/2024 - 1000-360 - Liberty North - 004601-Kitchen-Handwashing By Office



3/27/2024 - 1000-361 - Liberty North - 002365-Kitchen



3/27/2024 - 1000-362 - Liberty North - 004602-Kitchen-Handwashing By Office



3/27/2024 - 1000-363 - Liberty North - 004870-Kitchen-Across From Office



3/27/2024 - 1000-364 - Liberty North - 004868-Kitchen-Restroom



3/27/2024 - 1000-365 - Liberty North - 004869-Kitchen-Restroom



3/27/2024 - 1000-366 - Liberty North - 004616-Kitchen-By Eagle Cafe Logo



3/27/2024 - 1000-367 - Liberty North - 002575-Kitchen



3/27/2024 - 1000-368 - Liberty North - 004617-Kitchen-Middle Serving Line



3/27/2024 - 1000-369 - Liberty North - 004613-Kitchen-Dishwasher Room



3/27/2024 - 1000-370 - Liberty North - 004614-Kitchen-Dishwasher Room



3/27/2024 - 1000-371 - Liberty North - 004618-Kitchen-Serving Line



3/27/2024 - 1000-372 - Liberty North - 004612-Kitchen



3/27/2024 - 1000-373 - Liberty North - 002573-Kitchen



5/1/2024 - 1000-112 - Liberty North - 003935-Boys By 403-Right



5/1/2024 - 1000-113 - Liberty North - 003936-Boys By 403-Left



5/1/2024 - 1000-118 - Liberty North - 003941-Girls By 403-Right



5/1/2024 - 1000-119 - Liberty North - 003942-Girls By 403-Left



5/1/2024 - 1000-131 - Liberty North - 003924-Girls Locker Room By 409-Right



5/1/2024 - 1000-198 - Liberty North - 004194-Fieldhouse



5/1/2024 - 1000-246 - Liberty North - 004088-New 900 Hall-Left



5/1/2024 - 1000-247 - Liberty North - 004089B-New 900 Hall-Right



5/1/2024 - 1000-248 - Liberty North - 004089-New 900 Hall



5/1/2024 - 1000-249 - Liberty North - 004090-New 900 Hall-Boys-Far Left



5/1/2024 - 1000-250 - Liberty North - 004091-New 900 Hall-Boys-Left Middle



5/1/2024 - 1000-251 - Liberty North - 004092-New 900 Hall-Boys-Right Middle



5/1/2024 - 1000-252 - Liberty North - 004093-New 900 Hall-Boys-Far Right



5/1/2024 - 1000-253 - Liberty North - 004046-New 900 Hall-Girls-Far Right



5/1/2024 - 1000-254 - Liberty North - 004047-New 900 Hall-Girls-Right Middle



5/1/2024 - 1000-255 - Liberty North - 004048-New 900 Hall-Girls-Left Middle



5/1/2024 - 1000-256 - Liberty North - 004049-New 900 Hall-Girls-Far Left



5/1/2024 - 1000-275 - Liberty North - 004062- Between Old/New 800 Hall-Left Middle




5/1/2024 - 1000-276 - Liberty North - 004063- Between Old/New 800 Hall-Far Left

Appendix E
Source Identification Diagram

ASP was provided sample locations by
Liberty School District

Liberty North High School
1000 NE 104th St
LIberty, MO 64068
816-736-5500

Map Legend for Carl Lucas
Last Updated 08/17/2021

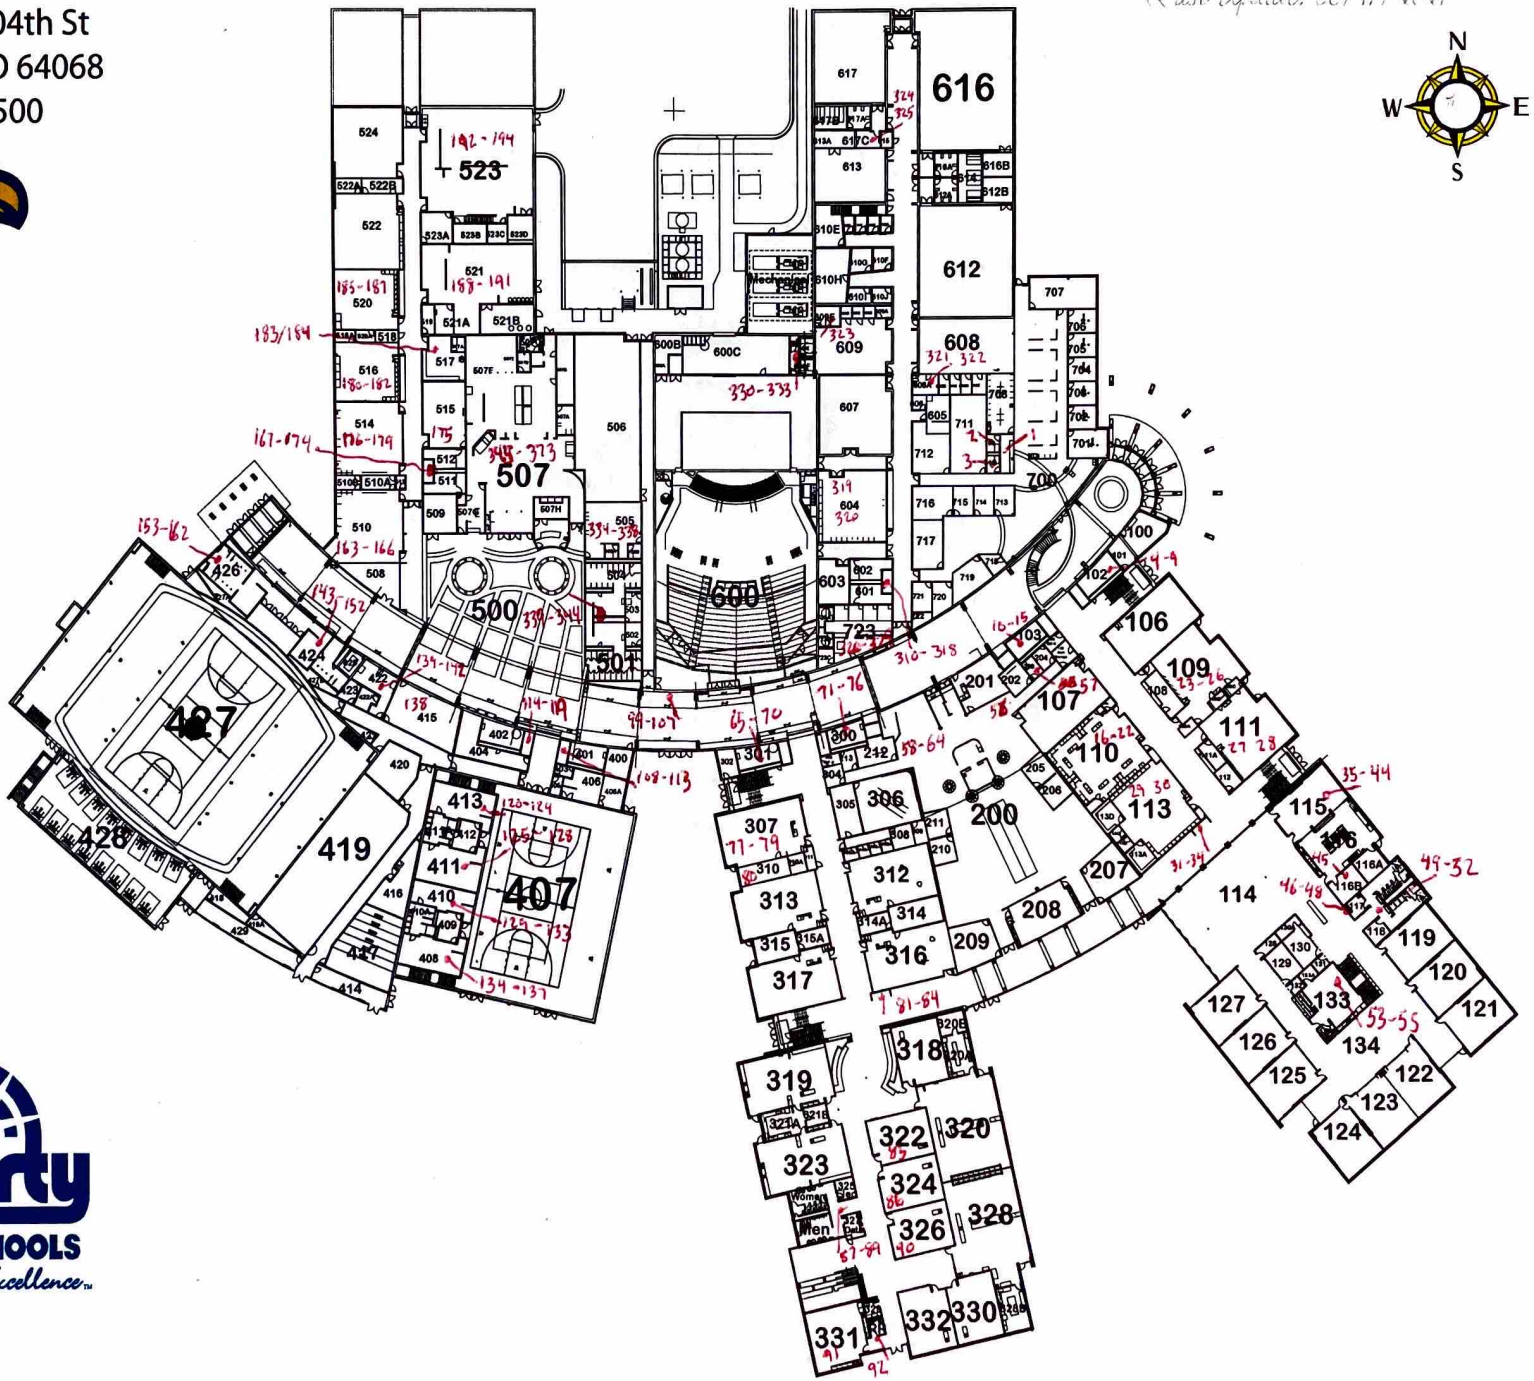

Liberty PUBLIC SCHOOLS
Empowering Excellence™

Liberty North High School
1000 NE 104th St
LIberty, MO 64068
816-736-5500

Map layout by: Curt Laven
Last Update: 06/17/2021

