May 31, 2024

Steve Aldrich
Director of Facilities and Grounds
Liberty School District
801 Kent Street
Liberty, Missouri 64068

Project: Limited Lead in Drinking Water Testing
Address: 425 Claywoods Parkway, Liberty, Missouri 64068

Mr. Steve Aldrich

On March 29, 2024, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 168 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of “lead free” to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of “lead free” as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: https://www.epa.gov/dwreginfo/lead-and-copper-rule

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.
Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school’s buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in red text.

March 29, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
425-1-FD	Lillian Schumaker - 001778-By Room 311-Boys	Sink Tap	First Draw	<0.4
425-2-FD	Lillian Schumaker - 001779-By 311-Boys	Sink Tap	First Draw	1.3
425-3-FD	Lillian Schumaker - 001780-By 311-Boys	Sink Tap	First Draw	<0.4
425-4-FD	Lillian Schumaker - 001781-By 311-Boys	Sink Tap	First Draw	<0.4
425-5-FD	Lillian Schumaker - 001782-By 311-Boys	Sink Tap	First Draw	0.4
425-6-FD	Lillian Schumaker - 001783-By 311-Girls	Sink Tap	First Draw	<0.4
425-7-FD	Lillian Schumaker - 001784-By 311-Girls	Sink Tap	First Draw	2.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
425-8-FD	Lillian Schumaker - 001785-By 311-Girls	Sink Tap	First Draw	2
425-9-FD	Lillian Schumaker - 001786-By 311-Girls	Sink Tap	First Draw	2.6
425-10-FD	Lillian Schumaker - 001787-By 311-Girls	Sink Tap	First Draw	2.1
425-11-FD	Lillian Schumaker - 001776-By 311	Drinking Fountain	First Draw	<0.4
425-12-FD	Lillian Schumaker - 001777B-By 311	Drinking Fountain	First Draw	<0.4
425-13-FD	Lillian Schumaker - 001777F-By 311	Bottle Filler	First Draw	<0.4
425-14-FD	Lillian Schumaker - 001788-Room 313	Sink Tap	First Draw	1.8
425-15-FD	Lillian Schumaker - 001789-Room 313	Sink Tap	First Draw	<0.4
425-16-FD	Lillian Schumaker - 001798-Room 312	Sink Tap	First Draw	<0.4
425-17-FD	Lillian Schumaker - 001799-Room 312	Bubbler	First Draw	<0.4
425-18-FD	Lillian Schumaker - 001796-Room 314	Sink Tap	First Draw	0.5
425-19-FD	Lillian Schumaker - 001797-Room 314	Bubbler	First Draw	<0.4
425-20-FD	Lillian Schumaker - 001790-Room 315	Sink Tap	First Draw	0.9
425-21-FD	Lillian Schumaker - 001791-Room 315	Bubbler	First Draw	<0.4
425-22-FD	Lillian Schumaker - 001792-Room 317	Sink Tap	First Draw	0.6
425-23-FD	Lillian Schumaker - 001793-Room 317	Sink Tap	First Draw	<0.4
425-24-FD	Lillian Schumaker - 001794-Room 316	Sink Tap	First Draw	0.7
425-25-FD	Lillian Schumaker - 001795-Room 316	Bubbler	First Draw	<0.4
425-26-FD	Lillian Schumaker - 001341-By 211-Boys	Sink Tap	First Draw	<0.4
425-27-FD	Lillian Schumaker - 001342-By 211-Boys	Sink Tap	First Draw	<0.4
425-28-FD	Lillian Schumaker - 001343-By 211-Boys	Sink Tap	First Draw	0.4
425-29-FD	Lillian Schumaker - 001344-By 211-Boys	Sink Tap	First Draw	0.5
425-30-FD	Lillian Schumaker - 001345-By 211-Boys	Sink Tap	First Draw	0.7
425-31-FD	Lillian Schumaker - 001346-By 211-Girls	Sink Tap	First Draw	<0.4
425-32-FD	Lillian Schumaker - 001347-By 211-Girls	Sink Tap	First Draw	<0.4
425-33-FD	Lillian Schumaker - 001348-By 211-Girls	Sink Tap	First Draw	1.1

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
425-34-FD	Lillian Schumaker - 001349-By 211-Girls	Sink Tap	First Draw	0.6
425-35-FD	Lillian Schumaker - 001350-By 211-Girls	Sink Tap	First Draw	0.5
425-36-FD	Lillian Schumaker - 001351B-By 211	Drinking Fountain	First Draw	<0.4
425-37-FD	Lillian Schumaker - 001351F-By 211	Bottle Filler	First Draw	<0.4
425-38-FD	Lillian Schumaker - 001352-By 211	Drinking Fountain	First Draw	<0.4
425-39-FD	Lillian Schumaker - 001353-Room 213	Sink Tap	First Draw	<0.4
425-40-FD	Lillian Schumaker - 001353B-Room 213	Bubbler	First Draw	<0.4
425-41-FD	Lillian Schumaker - 001361-Room 214	Sink Tap	First Draw	1
425-42-FD	Lillian Schumaker - 001362-Room 214	Bubbler	First Draw	<0.4
425-43-FD	Lillian Schumaker - 001355-Room 215	Sink Tap	First Draw	0.9
425-44-FD	Lillian Schumaker - 001356-Room 215	Bubbler	First Draw	<0.4
425-45-FD	Lillian Schumaker - 001357-Room 217	Sink Tap	First Draw	1
425-46-FD	Lillian Schumaker - 001358-Room 217	Bubbler	First Draw	<0.4
425-47-FD	Lillian Schumaker - 001359-Room 216	Sink Tap	First Draw	<0.4
425-48-FD	Lillian Schumaker - 001360-Room 216	Bubbler	First Draw	<0.4
425-49-FD	Lillian Schumaker - 001365-By 200-Boys	Sink Tap	First Draw	<0.4
425-50-FD	Lillian Schumaker - 001366-By 200-Boys	Sink Tap	First Draw	0.4
425-51-FD	Lillian Schumaker - 001367-By 200-Boys	Sink Tap	First Draw	<0.4
425-52-FD	Lillian Schumaker - 2261-By 200	Drinking Fountain	First Draw	<0.4
425-53-FD	Lillian Schumaker - 002262B-By 200	Drinking Fountain	First Draw	<0.4
425-54-FD	Lillian Schumaker - 002262F-By 200	Bottle Filler	First Draw	<0.4
425-55-FD	Lillian Schumaker - 001368-By 200-Girls	Sink Tap	First Draw	<0.4
425-56-FD	Lillian Schumaker - 001369-By 200-Girls	Sink Tap	First Draw	<0.4
425-57-FD	Lillian Schumaker - 001370-By 200-Girls	Sink Tap	First Draw	<0.4
425-58-FD	Lillian Schumaker - 001388-Room 201	Sink Tap	First Draw	2
425-59-FD	Lillian Schumaker - 001389-Room 201	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
425-60-FD	Lillian Schumaker - 001386-Room 203	Sink Tap	First Draw	0.7
425-61-FD	Lillian Schumaker - 001387-Room 203	Bubbler	First Draw	<0.4
425-62-FD	Lillian Schumaker - 001384-Room 205	Sink Tap	First Draw	36.8
425-63-FD	Lillian Schumaker - 001385-Room 205	Bubbler	First Draw	<0.4
425-64-FD	Lillian Schumaker - 001382-Room 207	Sink Tap	First Draw	<0.4
425-65-FD	Lillian Schumaker - 001383-Room 207	Bubbler	First Draw	<0.4
425-66-FD	Lillian Schumaker - 001380-Room 208	Sink Tap	First Draw	2.4
425-67-FD	Lillian Schumaker - 001381-Room 208	Bubbler	First Draw	<0.4
425-68-FD	Lillian Schumaker - 001378-Room 206	Sink Tap	First Draw	<0.4
425-69-FD	Lillian Schumaker - 001379-Room 206	Bubbler	First Draw	<0.4
425-70-FD	Lillian Schumaker - 001376-Room 204	Sink Tap	First Draw	<0.4
425-71-FD	Lillian Schumaker - 001377-Room 204	Bubbler	First Draw	1.9
425-72-FD	Lillian Schumaker - 001374-Room 202	Sink Tap	First Draw	<0.4
425-73-FD	Lillian Schumaker - 001375-Room 202	Bubbler	First Draw	<0.4
425-74-FD	Lillian Schumaker - 001372-Room 200	Sink Tap	First Draw	1.5
425-75-FD	Lillian Schumaker - 001373-Room 200	Bubbler	First Draw	<0.4
425-76-FD	Lillian Schumaker - 001371-Room 200-Staff Bathroom	Sink Tap	First Draw	<0.4
425-77-FD	Lillian Schumaker - 002263-Lounge	Ice Machine	First Draw	<0.4
425-78-FD	Lillian Schumaker - 002264-Lounge	Ice Machine	First Draw	<0.4
425-79-FD	Lillian Schumaker - 001775-Lounge	Sink Tap	First Draw	<0.4
425-80-FD	Lillian Schumaker - 001773-Office-Staff Restroom	Sink Tap	First Draw	<0.4
425-81-FD	Lillian Schumaker - 001774-Office-Staff Restroom	Sink Tap	First Draw	<0.4
425-82-FD	Lillian Schumaker - 001772-Office-Lactation Room	Sink Tap	First Draw	<0.4
425-83-FD	Lillian Schumaker - 001390-Nurse's Office	Sink Tap	First Draw	<0.4
425-84-FD	Lillian Schumaker - 001771-Nurse's Office-Restroom	Sink Tap	First Draw	1.2
425-85-FD	Lillian Schumaker - 001802-By 111-Boys	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
425-86-FD	Lillian Schumaker - 001803-By 111-Boys	Sink Tap	First Draw	1
425-87-FD	Lillian Schumaker - 001804-By 111-Boys	Sink Tap	First Draw	1.1
425-88-FD	Lillian Schumaker - 001805-By 111-Boys	Sink Tap	First Draw	1.8
425-89-FD	Lillian Schumaker - 001806-By 111-Boys	Sink Tap	First Draw	0.4
425-90-FD	Lillian Schumaker - 001807-By 111-Girls	Sink Tap	First Draw	1.1
425-91-FD	Lillian Schumaker - 001808-By 111-Girls	Sink Tap	First Draw	<0.4
425-92-FD	Lillian Schumaker - 001809-By 111-Girls	Sink Tap	First Draw	1.9
425-93-FD	Lillian Schumaker - 001810-By 111-Girls	Sink Tap	First Draw	1.1
425-94-FD	Lillian Schumaker - 001811-By 111-Girls	Sink Tap	First Draw	1.3
425-95-FD	Lillian Schumaker - 001800-By 111	Drinking Fountain	First Draw	<0.4
425-96-FD	Lillian Schumaker - 001801-By 111	Drinking Fountain	First Draw	<0.4
425-97-FD	Lillian Schumaker - 001812-Room 113	Sink Tap	First Draw	1
425-98-FD	Lillian Schumaker - 001813-Room 113	Bubbler	First Draw	<0.4
425-99-FD	Lillian Schumaker - 001814-Room 115	Sink Tap	First Draw	3.7
425-100-FD	Lillian Schumaker - 001815-Room 115	Bubbler	First Draw	<0.4
425-101-FD	Lillian Schumaker - 001816-Room 117	Sink Tap	First Draw	4.1
425-102-FD	Lillian Schumaker - 001817-Room 117	Bubbler	First Draw	<0.4
425-103-FD	Lillian Schumaker - 001818-Room 116	Sink Tap	First Draw	4
425-104-FD	Lillian Schumaker - 001819-Room 116	Bubbler	First Draw	<0.4
425-105-FD	Lillian Schumaker - 001820-Room 114	Sink Tap	First Draw	2.4
425-106-FD	Lillian Schumaker - 001821-Room 114	Bubbler	First Draw	<0.4
425-107-FD	Lillian Schumaker - 001822-Room 112	Sink Tap	First Draw	0.5
425-108-FD	Lillian Schumaker - 001823-Room 112	Bubbler	First Draw	<0.4
425-109-FD	Lillian Schumaker - 001824-By 103-Boys	Sink Tap	First Draw	<0.4
425-110-FD	Lillian Schumaker - 001825-By 103-Boys	Sink Tap	First Draw	0.4
425-111-FD	Lillian Schumaker - 001826-By 103-Boys	Sink Tap	First Draw	0.5

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
425-112-FD	Lillian Schumaker - 001827-By 103-Girls	Sink Tap	First Draw	1.7
425-113-FD	Lillian Schumaker - 001828-By 103-Girls	Sink Tap	First Draw	<0.4
425-114-FD	Lillian Schumaker - 001829-By 103-Girls	Sink Tap	First Draw	<0.4
425-115-FD	Lillian Schumaker - 001830-Room 104	Sink Tap	First Draw	1.5
425-116-FD	Lillian Schumaker - 001831-Room 104	Bubbler	First Draw	<0.4
425-117-FD	Lillian Schumaker - 001832-Room 106	Sink Tap	First Draw	50.9
425-118-FD	Lillian Schumaker - 001833-Room 106	Bubbler	First Draw	<0.4
425-119-FD	Lillian Schumaker - 002270-Room 106	Sink Tap	First Draw	126
425-120-FD	Lillian Schumaker - 002269-Room 106	Bubbler	First Draw	0.9
425-121-FD	Lillian Schumaker - 001834-Room 106-Bathroom	Sink Tap	First Draw	16.7
425-122-FD	Lillian Schumaker - 001835-Room 108	Sink Tap	First Draw	6.5
425-123-FD	Lillian Schumaker - 001836-Room 108	Bubbler	First Draw	0.4
425-124-FD	Lillian Schumaker - 001837-Room 108	Sink Tap	First Draw	8.4
425-125-FD	Lillian Schumaker - 001838-Room 108	Bubbler	First Draw	<0.4
425-126-FD	Lillian Schumaker - 002267-Room 108-Bathroom	Sink Tap	First Draw	1.9
425-127-FD	Lillian Schumaker - 001839-Room 109	Sink Tap	First Draw	27
425-128-FD	Lillian Schumaker - 001840-Room 109	Bubbler	First Draw	0.6
425-129-FD	Lillian Schumaker - 001841-Room 109	Sink Tap	First Draw	13.9
425-130-FD	Lillian Schumaker - 001842-Room 109	Bubbler	First Draw	0.4
425-131-FD	Lillian Schumaker - 002268-Room 109-Restroom	Sink Tap	First Draw	2.6
425-132-FD	Lillian Schumaker - 001843-Room 107	Sink Tap	First Draw	<0.4
425-133-FD	Lillian Schumaker - 001844-Room 107	Bubbler	First Draw	<0.4
425-134-FD	Lillian Schumaker - 001845-Room 107	Sink Tap	First Draw	4.1
425-136-FD	Lillian Schumaker - 001847-Room 107-Restroom	Sink Tap	First Draw	2.5
425-137-FD	Lillian Schumaker - 001848-Room 105	Sink Tap	First Draw	1.3
425-138-FD	Lillian Schumaker - 001849-Room 105	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
425-139-FD	Lillian Schumaker - 001850-Room 103	Sink Tap	First Draw	1.3
425-140-FD	Lillian Schumaker - 001851-Room 103	Bubbler	First Draw	1.5
425-141-FD	Lillian Schumaker - 001857-Room 102	Sink Tap	First Draw	3.8
425-142-FD	Lillian Schumaker - 001858-Room 102	Sink Tap	First Draw	3.9
425-143-FD	Lillian Schumaker - 001859-Room 102	Sink Tap	First Draw	2.4
425-144-FD	Lillian Schumaker - 001860-Room 102	Sink Tap	First Draw	5.6
425-145-FD	Lillian Schumaker - 001856-By Gym	Drinking Fountain	First Draw	<0.4
425-146-FD	Lillian Schumaker - 001852-Gym-Boys	Sink Tap	First Draw	0.6
425-147-FD	Lillian Schumaker - 001853-Gym-Boys	Sink Tap	First Draw	0.6
425-148-FD	Lillian Schumaker - 001854-Gym-Girls	Sink Tap	First Draw	1.5
425-149-FD	Lillian Schumaker - 001855-Gym-Girls	Sink Tap	First Draw	<0.4
425-150-FD	Lillian Schumaker - 002570B-Cafeteria	Drinking Fountain	First Draw	<0.4
425-151-FD	Lillian Schumaker - 002570F-Cafeteria	Bottle Filler	First Draw	<0.4
425-152-FD	Lillian Schumaker - 001927-Kitchen	Sink Tap	First Draw	0.6
425-153-FD	Lillian Schumaker - 001928-Kitchen	Sink Tap	First Draw	<0.4
425-154-FD	Lillian Schumaker - 001929-Kitchen	Sink Tap	First Draw	0.5
425-155-FD	Lillian Schumaker - 001930-Kitchen	Sink Tap	First Draw	<0.4
425-156-FD	Lillian Schumaker - 004501-Kitchen	Sink Tap	First Draw	0.8
425-157-FD	Lillian Schumaker - 004502-Kitchen	Sink Tap	First Draw	2
425-158-FD	Lillian Schumaker - 004503-Kitchen	Sink Tap	First Draw	0.5
425-159-FD	Lillian Schumaker - 004504-Kitchen	Sink Tap	First Draw	0.4
425-160-FD	Lillian Schumaker - 004505-Kitchen	Sink Tap	First Draw	<0.4
425-161-FD	Lillian Schumaker - 004506-Kitchen	Sink Tap	First Draw	<0.4
425-162-FD	Lillian Schumaker - 004507-Kitchen	Sink Tap	First Draw	<0.4
425-163-FD	Lillian Schumaker - 004508-Kitchen	Sink Tap	First Draw	1
425-164-FD	Lillian Schumaker - 004509-Kitchen	Sink Tap	First Draw	0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
425-165-FD	Lillian Schumaker - 004510-Kitchen	Sink Tap	First Draw	0.4
425-166-FD	Lillian Schumaker - 000355-Kitchen	Pot Filler	First Draw	2.7
425-167-FD	Lillian Schumaker - 000356-Kitchen	Pot Filler	First Draw	0.4
425-168-FD	Lillian Schumaker - 004511-Kitchen Bathroom	Sink Tap	First Draw	<0.4
425-169-FD	Lillian Schumaker - 000950-Kitchen	Ice Machine	First Draw	0.5

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A
Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date:	**10/4/2023**
Expiration Date:	**10/4/2025**
License Number:	**211004-300006201**

Paula F. Nickelson
Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



Paula F. Nickelson
Acting Director
t of Health and Senior Services

son City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.

- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

PO Box 47166 Kansas City, MO 64188 • 816-678-7894 • www.axiomservicepros.com

Appendix C
Laboratory Analytical Report

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HD0020

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 425 Claywoods Parkway

Project / PO Number: 425 Claywoods Parkway
Received: 04/01/2024
Reported: 04/17/2024

Analytical Testing Parameters

Client Sample ID: 425-1-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-01
Collected By: Bradley Young
Collection Date: 03/29/2024 13:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1432	RVV

Client Sample ID: 425-2-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-02
Collected By: Bradley Young
Collection Date: 03/29/2024 13:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/15/24 1519	04/16/24 1441	RVV

Client Sample ID: 425-3-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-03
Collected By: Bradley Young
Collection Date: 03/29/2024 13:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1444	RVV

Client Sample ID: 425-4-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-04
Collected By: Bradley Young
Collection Date: 03/29/2024 13:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1447	RVV

Client Sample ID: 425-5-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-05
Collected By: Bradley Young
Collection Date: 03/29/2024 13:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/16/24 1456	RVV

Client Sample ID: 425-6-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-06
Collected By: Bradley Young
Collection Date: 03/29/2024 13:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1459	RVV

Client Sample ID: 425-7-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-07
Collected By: Bradley Young
Collection Date: 03/29/2024 13:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/15/24 1519	04/16/24 1502	RVV

Client Sample ID: 425-8-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-08
Collected By: Bradley Young
Collection Date: 03/29/2024 13:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/15/24 1519	04/16/24 1505	RVV

Client Sample ID: 425-9-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-09
Collected By: Bradley Young
Collection Date: 03/29/2024 13:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.6**	0.4	ppb	2		04/15/24 1519	04/16/24 1508	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-10-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-10
Collected By: Bradley Young
Collection Date: 03/29/2024 13:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.1**	0.4	ppb	2		04/15/24 1519	04/16/24 1511	RVV

Client Sample ID: 425-11-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-11
Collected By: Bradley Young
Collection Date: 03/29/2024 13:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1514	RVV

Client Sample ID: 425-12-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-12
Collected By: Bradley Young
Collection Date: 03/29/2024 13:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1517	RVV

Client Sample ID: 425-13-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-13
Collected By: Bradley Young
Collection Date: 03/29/2024 13:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1520	RVV

Client Sample ID: 425-14-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-14
Collected By: Bradley Young
Collection Date: 03/29/2024 13:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/15/24 1519	04/16/24 1523	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-15-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-15
Collected By: Bradley Young
Collection Date: 03/29/2024 13:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1532	RVV

Client Sample ID: 425-16-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-16
Collected By: Bradley Young
Collection Date: 03/29/2024 13:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1535	RVV

Client Sample ID: 425-17-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-17
Collected By: Bradley Young
Collection Date: 03/29/2024 13:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1538	RVV

Client Sample ID: 425-18-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-18
Collected By: Bradley Young
Collection Date: 03/29/2024 13:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/15/24 1519	04/16/24 1541	RVV

Client Sample ID: 425-19-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-19
Collected By: Bradley Young
Collection Date: 03/29/2024 13:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1544	RVV

Client Sample ID: 425-20-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-20
Collected By: Bradley Young
Collection Date: 03/29/2024 13:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/15/24 1519	04/16/24 1547	RVV

Client Sample ID: 425-21-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-21
Collected By: Bradley Young
Collection Date: 03/29/2024 13:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1556	RVV

Client Sample ID: 425-22-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-22
Collected By: Bradley Young
Collection Date: 03/29/2024 13:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/15/24 1519	04/16/24 1610	RVV

Client Sample ID: 425-23-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-23
Collected By: Bradley Young
Collection Date: 03/29/2024 13:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1613	RVV

Client Sample ID: 425-24-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-24
Collected By: Bradley Young
Collection Date: 03/29/2024 13:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/15/24 1519	04/16/24 1616	RVV

Client Sample ID: 425-25-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-25
Collected By: Bradley Young
Collection Date: 03/29/2024 13:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1619	RVV

Client Sample ID: 425-26-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-26
Collected By: Bradley Young
Collection Date: 03/29/2024 13:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1622	RVV

Client Sample ID: 425-27-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-27
Collected By: Bradley Young
Collection Date: 03/29/2024 13:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1625	RVV

Client Sample ID: 425-28-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-28
Collected By: Bradley Young
Collection Date: 03/29/2024 13:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/16/24 1628	RVV

Client Sample ID: 425-29-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-29
Collected By: Bradley Young
Collection Date: 03/29/2024 13:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/15/24 1519	04/16/24 1631	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-30-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-30
Collected By: Bradley Young
Collection Date: 03/29/2024 13:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/15/24 1519	04/16/24 1634	RVV

Client Sample ID: 425-31-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-31
Collected By: Bradley Young
Collection Date: 03/29/2024 13:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1643	RVV

Client Sample ID: 425-32-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-32
Collected By: Bradley Young
Collection Date: 03/29/2024 13:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1646	RVV

Client Sample ID: 425-33-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-33
Collected By: Bradley Young
Collection Date: 03/29/2024 13:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/15/24 1519	04/16/24 1649	RVV

Client Sample ID: 425-34-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-34
Collected By: Bradley Young
Collection Date: 03/29/2024 13:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/15/24 1519	04/16/24 1652	RVV

Client Sample ID: 425-35-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-35
Collected By: Bradley Young
Collection Date: 03/29/2024 13:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/15/24 1519	04/16/24 1655	RVV

Client Sample ID: 425-36-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-36
Collected By: Bradley Young
Collection Date: 03/29/2024 13:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1658	RVV

Client Sample ID: 425-37-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-37
Collected By: Bradley Young
Collection Date: 03/29/2024 13:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1701	RVV

Client Sample ID: 425-38-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-38
Collected By: Bradley Young
Collection Date: 03/29/2024 13:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1704	RVV

Client Sample ID: 425-39-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-39
Collected By: Bradley Young
Collection Date: 03/29/2024 13:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1707	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-40-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-40
Collected By: Bradley Young
Collection Date: 03/29/2024 13:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1710	RVV

Client Sample ID: 425-41-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-41
Collected By: Bradley Young
Collection Date: 03/29/2024 13:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/15/24 1519	04/16/24 1725	RVV

Client Sample ID: 425-42-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-42
Collected By: Bradley Young
Collection Date: 03/29/2024 13:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1734	RVV

Client Sample ID: 425-43-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-43
Collected By: Bradley Young
Collection Date: 03/29/2024 13:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/15/24 1519	04/16/24 1737	RVV

Client Sample ID: 425-44-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-44
Collected By: Bradley Young
Collection Date: 03/29/2024 13:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1740	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-45-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-45
Collected By: Bradley Young
Collection Date: 03/29/2024 13:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/15/24 1519	04/16/24 1743	RVV

Client Sample ID: 425-46-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-46
Collected By: Bradley Young
Collection Date: 03/29/2024 13:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1746	RVV

Client Sample ID: 425-47-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-47
Collected By: Bradley Young
Collection Date: 03/29/2024 13:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1755	RVV

Client Sample ID: 425-48-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-48
Collected By: Bradley Young
Collection Date: 03/29/2024 13:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1758	RVV

Client Sample ID: 425-49-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-49
Collected By: Bradley Young
Collection Date: 03/29/2024 13:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1801	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID:	425-50-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-50	**Collection Date:**	03/29/2024 13:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/16/24 1804	RVV

Client Sample ID:	425-51-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-51	**Collection Date:**	03/29/2024 13:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1807	RVV

Client Sample ID:	425-52-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-52	**Collection Date:**	03/29/2024 13:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1810	RVV

Client Sample ID:	425-53-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-53	**Collection Date:**	03/29/2024 13:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1813	RVV

Client Sample ID:	425-54-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-54	**Collection Date:**	03/29/2024 13:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1815	RVV

Client Sample ID: 425-55-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-55
Collected By: Bradley Young
Collection Date: 03/29/2024 13:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1818	RVV

Client Sample ID: 425-56-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-56
Collected By: Bradley Young
Collection Date: 03/29/2024 13:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1821	RVV

Client Sample ID: 425-57-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-57
Collected By: Bradley Young
Collection Date: 03/29/2024 13:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1830	RVV

Client Sample ID: 425-58-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-58
Collected By: Bradley Young
Collection Date: 03/29/2024 13:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/15/24 1519	04/16/24 1833	RVV

Client Sample ID: 425-59-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-59
Collected By: Bradley Young
Collection Date: 03/29/2024 13:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1836	RVV

Client Sample ID: 425-60-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-60
Collected By: Bradley Young
Collection Date: 03/29/2024 13:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/15/24 1519	04/16/24 1839	RVV

Client Sample ID: 425-61-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-61
Collected By: Bradley Young
Collection Date: 03/29/2024 13:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1848	RVV

Client Sample ID: 425-62-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-62
Collected By: Bradley Young
Collection Date: 03/29/2024 13:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**36.8**	0.4	ppb	2		04/15/24 1519	04/16/24 1857	RVV

Client Sample ID: 425-63-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-63
Collected By: Bradley Young
Collection Date: 03/29/2024 13:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1906	RVV

Client Sample ID: 425-64-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-64
Collected By: Bradley Young
Collection Date: 03/29/2024 13:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1909	RVV

Client Sample ID: 425-65-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-65
Collected By: Bradley Young
Collection Date: 03/29/2024 13:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1912	RVV

Client Sample ID: 425-66-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-66
Collected By: Bradley Young
Collection Date: 03/29/2024 13:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/15/24 1519	04/16/24 1915	RVV

Client Sample ID: 425-67-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-67
Collected By: Bradley Young
Collection Date: 03/29/2024 13:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1918	RVV

Client Sample ID: 425-68-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-68
Collected By: Bradley Young
Collection Date: 03/29/2024 13:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1921	RVV

Client Sample ID: 425-69-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-69
Collected By: Bradley Young
Collection Date: 03/29/2024 13:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1924	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-70-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-70
Collected By: Bradley Young
Collection Date: 03/29/2024 13:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1927	RVV

Client Sample ID: 425-71-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-71
Collected By: Bradley Young
Collection Date: 03/29/2024 13:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.9**	0.4	ppb	2		04/15/24 1519	04/16/24 1930	RVV

Client Sample ID: 425-72-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-72
Collected By: Bradley Young
Collection Date: 03/29/2024 13:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1933	RVV

Client Sample ID: 425-73-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-73
Collected By: Bradley Young
Collection Date: 03/29/2024 13:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1942	RVV

Client Sample ID: 425-74-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-74
Collected By: Bradley Young
Collection Date: 03/29/2024 13:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/15/24 1519	04/16/24 1945	RVV

Client Sample ID: 425-75-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-75
Collected By: Bradley Young
Collection Date: 03/29/2024 13:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1948	RVV

Client Sample ID: 425-76-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-76
Collected By: Bradley Young
Collection Date: 03/29/2024 13:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1951	RVV

Client Sample ID: 425-77-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-77
Collected By: Bradley Young
Collection Date: 03/29/2024 13:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1954	RVV

Client Sample ID: 425-78-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-78
Collected By: Bradley Young
Collection Date: 03/29/2024 13:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 1957	RVV

Client Sample ID: 425-79-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-79
Collected By: Bradley Young
Collection Date: 03/29/2024 13:49

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2000	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-80-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-80
Collected By: Bradley Young
Collection Date: 03/29/2024 13:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2003	RVV

Client Sample ID: 425-81-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-81
Collected By: Bradley Young
Collection Date: 03/29/2024 13:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2018	RVV

Client Sample ID: 425-82-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-82
Collected By: Bradley Young
Collection Date: 03/29/2024 13:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2027	RVV

Client Sample ID: 425-83-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-83
Collected By: Bradley Young
Collection Date: 03/29/2024 13:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2030	RVV

Client Sample ID: 425-84-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-84
Collected By: Bradley Young
Collection Date: 03/29/2024 13:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/15/24 1519	04/16/24 2033	RVV

Client Sample ID: 425-85-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-85
Collected By: Bradley Young
Collection Date: 03/29/2024 13:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2036	RVV

Client Sample ID: 425-86-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-86
Collected By: Bradley Young
Collection Date: 03/29/2024 13:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/15/24 1519	04/16/24 2039	RVV

Client Sample ID: 425-87-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-87
Collected By: Bradley Young
Collection Date: 03/29/2024 13:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/15/24 1519	04/16/24 2042	RVV

Client Sample ID: 425-88-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-88
Collected By: Bradley Young
Collection Date: 03/29/2024 13:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/15/24 1519	04/16/24 2045	RVV

Client Sample ID: 425-89-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-89
Collected By: Bradley Young
Collection Date: 03/29/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/17/24 0837	RVV

Client Sample ID: 425-90-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-90
Collected By: Bradley Young
Collection Date: 03/29/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/15/24 1519	04/17/24 0840	RVV

Client Sample ID: 425-91-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-91
Collected By: Bradley Young
Collection Date: 03/29/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0843	RVV

Client Sample ID: 425-92-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-92
Collected By: Bradley Young
Collection Date: 03/29/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.9**	0.4	ppb	2		04/15/24 1519	04/17/24 0846	RVV

Client Sample ID: 425-93-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-93
Collected By: Bradley Young
Collection Date: 03/29/2024 13:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/15/24 1519	04/17/24 0849	RVV

Client Sample ID: 425-94-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-94
Collected By: Bradley Young
Collection Date: 03/29/2024 13:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/15/24 1519	04/17/24 0852	RVV

Client Sample ID: 425-95-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-95
Collected By: Bradley Young
Collection Date: 03/29/2024 13:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0855	RVV

Client Sample ID: 425-96-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-96
Collected By: Bradley Young
Collection Date: 03/29/2024 13:53

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0858	RVV

Client Sample ID: 425-97-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-97
Collected By: Bradley Young
Collection Date: 03/29/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/15/24 1519	04/17/24 0901	RVV

Client Sample ID: 425-98-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-98
Collected By: Bradley Young
Collection Date: 03/29/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0904	RVV

Client Sample ID: 425-99-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-99
Collected By: Bradley Young
Collection Date: 03/29/2024 13:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.7**	0.4	ppb	2		04/15/24 1519	04/16/24 2130	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-100-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AA
Collected By: Bradley Young
Collection Date: 03/29/2024 13:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2133	RVV

Client Sample ID: 425-101-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AB
Collected By: Bradley Young
Collection Date: 03/29/2024 13:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.1**	0.4	ppb	2		04/15/24 1519	04/16/24 2142	RVV

Client Sample ID: 425-102-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AC
Collected By: Bradley Young
Collection Date: 03/29/2024 13:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2151	RVV

Client Sample ID: 425-103-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AD
Collected By: Bradley Young
Collection Date: 03/29/2024 13:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.0**	0.4	ppb	2		04/15/24 1519	04/16/24 2154	RVV

Client Sample ID: 425-104-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AE
Collected By: Bradley Young
Collection Date: 03/29/2024 13:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2157	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-105-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AF
Collected By: Bradley Young
Collection Date: 03/29/2024 13:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/15/24 1519	04/16/24 2206	RVV

Client Sample ID: 425-106-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AG
Collected By: Bradley Young
Collection Date: 03/29/2024 13:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2209	RVV

Client Sample ID: 425-107-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AH
Collected By: Bradley Young
Collection Date: 03/29/2024 13:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/15/24 1519	04/16/24 2212	RVV

Client Sample ID: 425-108-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AI
Collected By: Bradley Young
Collection Date: 03/29/2024 13:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2215	RVV

Client Sample ID: 425-109-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AJ
Collected By: Bradley Young
Collection Date: 03/29/2024 14:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2218	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-110-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AK
Collected By: Bradley Young
Collection Date: 03/29/2024 14:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/16/24 2221	RVV

Client Sample ID: 425-111-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AL
Collected By: Bradley Young
Collection Date: 03/29/2024 14:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/15/24 1519	04/16/24 2224	RVV

Client Sample ID: 425-112-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AM
Collected By: Bradley Young
Collection Date: 03/29/2024 14:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.7**	0.4	ppb	2		04/15/24 1519	04/16/24 2227	RVV

Client Sample ID: 425-113-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AN
Collected By: Bradley Young
Collection Date: 03/29/2024 14:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2230	RVV

Client Sample ID: 425-114-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AO
Collected By: Bradley Young
Collection Date: 03/29/2024 14:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2233	RVV

Client Sample ID: 425-115-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AP
Collected By: Bradley Young
Collection Date: 03/29/2024 14:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/15/24 1519	04/17/24 0908	RVV

Client Sample ID: 425-116-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AQ
Collected By: Bradley Young
Collection Date: 03/29/2024 14:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0920	RVV

Client Sample ID: 425-117-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AR
Collected By: Bradley Young
Collection Date: 03/29/2024 14:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**50.9**	0.4	ppb	2		04/15/24 1519	04/17/24 0923	RVV

Client Sample ID: 425-118-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AS
Collected By: Bradley Young
Collection Date: 03/29/2024 14:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0926	RVV

Client Sample ID: 425-119-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AT
Collected By: Bradley Young
Collection Date: 03/29/2024 14:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**126**	0.4	ppb	2		04/15/24 1519	04/17/24 0929	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID:	425-120-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-AU	**Collection Date:**	03/29/2024 14:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/15/24 1519	04/17/24 0932	RVV

Client Sample ID:	425-121-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-AV	**Collection Date:**	03/29/2024 14:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**16.7**	0.4	ppb	2		04/15/24 1519	04/17/24 0941	RVV

Client Sample ID:	425-122-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-AW	**Collection Date:**	03/29/2024 14:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**6.5**	0.4	ppb	2		04/15/24 1519	04/16/24 2321	RVV

Client Sample ID:	425-123-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-AX	**Collection Date:**	03/29/2024 14:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/16/24 2324	RVV

Client Sample ID:	425-124-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-AY	**Collection Date:**	03/29/2024 14:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**8.4**	0.4	ppb	2		04/15/24 1519	04/16/24 2327	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-125-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-AZ
Collected By: Bradley Young
Collection Date: 03/29/2024 14:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2330	RVV

Client Sample ID: 425-126-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BA
Collected By: Bradley Young
Collection Date: 03/29/2024 14:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.9**	0.4	ppb	2		04/15/24 1519	04/16/24 2333	RVV

Client Sample ID: 425-127-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BB
Collected By: Bradley Young
Collection Date: 03/29/2024 14:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**27.0**	0.4	ppb	2		04/15/24 1519	04/16/24 2336	RVV

Client Sample ID: 425-128-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BC
Collected By: Bradley Young
Collection Date: 03/29/2024 14:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/15/24 1519	04/16/24 2339	RVV

Client Sample ID: 425-129-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BD
Collected By: Bradley Young
Collection Date: 03/29/2024 14:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**13.9**	0.4	ppb	2		04/15/24 1519	04/16/24 2342	RVV

Client Sample ID: 425-130-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BE
Collected By: Bradley Young
Collection Date: 03/29/2024 14:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/16/24 2345	RVV

Client Sample ID: 425-131-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BF
Collected By: Bradley Young
Collection Date: 03/29/2024 14:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.6**	0.4	ppb	2		04/15/24 1519	04/16/24 2354	RVV

Client Sample ID: 425-132-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BG
Collected By: Bradley Young
Collection Date: 03/29/2024 14:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/16/24 2357	RVV

Client Sample ID: 425-133-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BH
Collected By: Bradley Young
Collection Date: 03/29/2024 14:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0000	RVV

Client Sample ID: 425-134-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BI
Collected By: Bradley Young
Collection Date: 03/29/2024 14:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.1**	0.4	ppb	2		04/15/24 1519	04/17/24 0003	RVV

Client Sample ID: 425-136-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BJ
Collected By: Bradley Young
Collection Date: 03/29/2024 14:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.5**	0.4	ppb	2		04/15/24 1519	04/17/24 0006	RVV

Client Sample ID: 425-137-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BK
Collected By: Bradley Young
Collection Date: 03/29/2024 14:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/15/24 1519	04/17/24 0009	RVV

Client Sample ID: 425-138-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BL
Collected By: Bradley Young
Collection Date: 03/29/2024 14:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0012	RVV

Client Sample ID: 425-139-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BM
Collected By: Bradley Young
Collection Date: 03/29/2024 14:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/15/24 1519	04/17/24 0014	RVV

Client Sample ID: 425-140-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BN
Collected By: Bradley Young
Collection Date: 03/29/2024 14:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/15/24 1519	04/17/24 0017	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-141-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BO
Collected By: Bradley Young
Collection Date: 03/29/2024 14:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.8**	0.4	ppb	2		04/15/24 1519	04/17/24 0020	RVV

Client Sample ID: 425-142-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BP
Collected By: Bradley Young
Collection Date: 03/29/2024 14:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.9**	0.4	ppb	2		04/15/24 1519	04/17/24 0035	RVV

Client Sample ID: 425-143-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BQ
Collected By: Bradley Young
Collection Date: 03/29/2024 14:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/15/24 1519	04/17/24 0044	RVV

Client Sample ID: 425-144-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BR
Collected By: Bradley Young
Collection Date: 03/29/2024 14:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**5.6**	0.4	ppb	2		04/15/24 1519	04/17/24 0047	RVV

Client Sample ID: 425-145-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BS
Collected By: Bradley Young
Collection Date: 03/29/2024 14:12

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0050	RVV

Client Sample ID: 425-146-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BT
Collected By: Bradley Young
Collection Date: 03/29/2024 14:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/15/24 1519	04/17/24 0053	RVV

Client Sample ID: 425-147-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BU
Collected By: Bradley Young
Collection Date: 03/29/2024 14:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/15/24 1519	04/17/24 0056	RVV

Client Sample ID: 425-148-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BV
Collected By: Bradley Young
Collection Date: 03/29/2024 14:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/15/24 1519	04/17/24 0105	RVV

Client Sample ID: 425-149-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BW
Collected By: Bradley Young
Collection Date: 03/29/2024 14:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0108	RVV

Client Sample ID: 425-150-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BX
Collected By: Bradley Young
Collection Date: 03/29/2024 14:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0111	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-151-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BY
Collected By: Bradley Young
Collection Date: 03/29/2024 14:15

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0114	RVV

Client Sample ID: 425-152-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-BZ
Collected By: Bradley Young
Collection Date: 03/29/2024 14:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/15/24 1519	04/17/24 0117	RVV

Client Sample ID: 425-153-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CA
Collected By: Bradley Young
Collection Date: 03/29/2024 14:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0120	RVV

Client Sample ID: 425-154-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CB
Collected By: Bradley Young
Collection Date: 03/29/2024 14:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/15/24 1519	04/17/24 0123	RVV

Client Sample ID: 425-155-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CC
Collected By: Bradley Young
Collection Date: 03/29/2024 14:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0126	RVV

Client Sample ID: 425-156-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CD
Collected By: Bradley Young
Collection Date: 03/29/2024 14:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/15/24 1519	04/17/24 0129	RVV

Client Sample ID: 425-157-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CE
Collected By: Bradley Young
Collection Date: 03/29/2024 14:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/15/24 1519	04/17/24 0132	RVV

Client Sample ID: 425-158-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CF
Collected By: Bradley Young
Collection Date: 03/29/2024 14:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/15/24 1519	04/17/24 0141	RVV

Client Sample ID: 425-159-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CG
Collected By: Bradley Young
Collection Date: 03/29/2024 14:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/17/24 0144	RVV

Client Sample ID: 425-160-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CH
Collected By: Bradley Young
Collection Date: 03/29/2024 14:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0147	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID: 425-161-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CI
Collected By: Bradley Young
Collection Date: 03/29/2024 14:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0150	RVV

Client Sample ID: 425-162-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CJ
Collected By: Bradley Young
Collection Date: 03/29/2024 14:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0159	RVV

Client Sample ID: 425-163-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CK
Collected By: Bradley Young
Collection Date: 03/29/2024 14:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/15/24 1519	04/17/24 0208	RVV

Client Sample ID: 425-164-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CL
Collected By: Bradley Young
Collection Date: 03/29/2024 14:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/17/24 0217	RVV

Client Sample ID: 425-165-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HD0020-CM
Collected By: Bradley Young
Collection Date: 03/29/2024 14:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/17/24 0220	RVV

CERTIFICATE OF ANALYSIS

3HD0020

Client Sample ID:	425-166-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-CN	**Collection Date:**	03/29/2024 14:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.7**	0.4	ppb	2		04/15/24 1519	04/17/24 0223	RVV

Client Sample ID:	425-167-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-CO	**Collection Date:**	03/29/2024 14:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/15/24 1519	04/17/24 0226	RVV

Client Sample ID:	425-168-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-CP	**Collection Date:**	03/29/2024 14:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/15/24 1519	04/17/24 0229	RVV

Client Sample ID:	425-169-FD		
Sample Matrix:	Drink Wtr	**Collected By:**	Bradley Young
Lab Sample ID:	3HD0020-CQ	**Collection Date:**	03/29/2024 14:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/15/24 1519	04/17/24 0232	RVV

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
04/17/24 12:53

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HD0020
														Short Hold:	
														Rush:	
														Temp: oC	20.3
425-1-FD	3/29/2024	13:15	Lillian Schumaker - Sink Tap - 001778-By Room 311-Boys	1	Wt	Grab	X								01
425-2-FD	3/29/2024	13:15	Lillian Schumaker - Sink Tap - 001779-By 311-Boys	1	Wt	Grab	X								02
425-3-FD	3/29/2024	13:15	Lillian Schumaker - Sink Tap - 001780-By 311-Boys	1	Wt	Grab	X								03
425-4-FD	3/29/2024	13:15	Lillian Schumaker - Sink Tap - 001781-By 311-Boys	1	Wt	Grab	X								04
425-5-FD	3/29/2024	13:16	Lillian Schumaker - Sink Tap - 001782-By 311-Boys	1	Wt	Grab	X								05
425-6-FD	3/29/2024	13:16	Lillian Schumaker - Sink Tap - 001783-By 311-Girls	1	Wt	Grab	X								06
425-7-FD	3/29/2024	13:16	Lillian Schumaker - Sink Tap - 001784-By 311-Girls	1	Wt	Grab	X								07

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/1/24		
	Time:			Time:		
				10:00		

3 H D 0 0 2 0

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-8-FD	3/29/2024	13:16	Lillian Schumaker - Sink Tap - 001785-By 311-Girls	1	Wt	Grab	X								08
425-9-FD	3/29/2024	13:16	Lillian Schumaker - Sink Tap - 001786-By 311-Girls	1	Wt	Grab	X								09
425-10-FD	3/29/2024	13:17	Lillian Schumaker - Sink Tap - 001787-By 311-Girls	1	Wt	Grab	X								10
425-11-FD	3/29/2024	13:17	Lillian Schumaker - Drinking Fountain - 001776-By 311	1	Wt	Grab	X								11
425-12-FD	3/29/2024	13:17	Lillian Schumaker - Drinking Fountain - 001777B-By 311	1	Wt	Grab	X								12
425-13-FD	3/29/2024	13:17	Lillian Schumaker - Bottle Filler - 001777F-By 311	1	Wt	Grab	X								13
425-14-FD	3/29/2024	13:18	Lillian Schumaker - Sink Tap - 001788-Room 313	1	Wt	Grab	X								14

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	Remarks:
	Time:			Time:	
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	
	Time:			Time:	

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
425-15-FD	3/29/2024	13:18	Lillian Schumaker - Sink Tap - 001789-Room 313	1	Wt	Grab	X								15
425-16-FD	3/29/2024	13:19	Lillian Schumaker - Sink Tap - 001798-Room 312	1	Wt	Grab	X								16
425-17-FD	3/29/2024	13:19	Lillian Schumaker - Bubbler - 001799-Room 312	1	Wt	Grab	X								17
425-18-FD	3/29/2024	13:20	Lillian Schumaker - Sink Tap - 001796-Room 314	1	Wt	Grab	X								18
425-19-FD	3/29/2024	13:20	Lillian Schumaker - Bubbler - 001797-Room 314	1	Wt	Grab	X								19
425-20-FD	3/29/2024	13:21	Lillian Schumaker - Sink Tap - 001790-Room 315	1	Wt	Grab	X								20
425-21-FD	3/29/2024	13:21	Lillian Schumaker - Bubbler - 001791-Room 315	1	Wt	Grab	X								21

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
425-22-FD	3/29/2024	13:22	Lillian Schumaker - Sink Tap - 001792-Room 317	1	Wt	Grab	X								22
425-23-FD	3/29/2024	13:22	Lillian Schumaker - Sink Tap - 001793-Room 317	1	Wt	Grab	X								23
425-24-FD	3/29/2024	13:23	Lillian Schumaker - Sink Tap - 001794-Room 316	1	Wt	Grab	X								24
425-25-FD	3/29/2024	13:23	Lillian Schumaker - Bubbler - 001795-Room 316	1	Wt	Grab	X								25
425-26-FD	3/29/2024	13:26	Lillian Schumaker - Sink Tap - 001341-By 211-Boys	1	Wt	Grab	X								26
425-27-FD	3/29/2024	13:26	Lillian Schumaker - Sink Tap - 001342-By 211-Boys	1	Wt	Grab	X								27
425-28-FD	3/29/2024	13:26	Lillian Schumaker - Sink Tap - 001343-By 211-Boys	1	Wt	Grab	X								28

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00220

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___	600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___	3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X	835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___	205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-29-FD	3/29/2024	13:26	Lillian Schumaker - Sink Tap - 001344-By 211-Boys	1	Wt	Grab	X								29
425-30-FD	3/29/2024	13:27	Lillian Schumaker - Sink Tap - 001345-By 211-Boys	1	Wt	Grab	X								30
425-31-FD	3/29/2024	13:27	Lillian Schumaker - Sink Tap - 001346-By 211-Girls	1	Wt	Grab	X								31
425-32-FD	3/29/2024	13:27	Lillian Schumaker - Sink Tap - 001347-By 211-Girls	1	Wt	Grab	X								32
425-33-FD	3/29/2024	13:27	Lillian Schumaker - Sink Tap - 001348-By 211-Girls	1	Wt	Grab	X								33
425-34-FD	3/29/2024	13:28	Lillian Schumaker - Sink Tap - 001349-By 211-Girls	1	Wt	Grab	X								34
425-35-FD	3/29/2024	13:28	Lillian Schumaker - Sink Tap - 001350-By 211-Girls	1	Wt	Grab	X								35

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-36-FD	3/29/2024	13:28	Lillian Schumaker - Drinking Fountain - 001351B-By 211	1	Wt	Grab	X								36
425-37-FD	3/29/2024	13:28	Lillian Schumaker - Bottle Filler - 001351F-By 211	1	Wt	Grab	X								37
425-38-FD	3/29/2024	13:29	Lillian Schumaker - Drinking Fountain - 001352-By 211	1	Wt	Grab	X								38
425-39-FD	3/29/2024	13:29	Lillian Schumaker - Sink Tap - 001353-Room 213	1	Wt	Grab	X								39
425-40-FD	3/29/2024	13:29	Lillian Schumaker - Bubbler - 001353B-Room 213	1	Wt	Grab	X								40
425-41-FD	3/29/2024	13:30	Lillian Schumaker - Sink Tap - 001361-Room 214	1	Wt	Grab	X								41
425-42-FD	3/29/2024	13:30	Lillian Schumaker - Bubbler - 001362-Room 214	1	Wt	Grab	X								42

LAB USE ONLY: Wk Order #: ___ Short Hold: ___ Rush: ___ Temp: oC ___

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-43-FD	3/29/2024	13:31	Lillian Schumaker - Sink Tap - 001355-Room 215	1	Wt	Grab	X								43
425-44-FD	3/29/2024	13:32	Lillian Schumaker - Bubbler - 001356-Room 215	1	Wt	Grab	X								44
425-45-FD	3/29/2024	13:32	Lillian Schumaker - Sink Tap - 001357-Room 217	1	Wt	Grab	X								45
425-46-FD	3/29/2024	13:32	Lillian Schumaker - Bubbler - 001358-Room 217	1	Wt	Grab	X								46
425-47-FD	3/29/2024	13:33	Lillian Schumaker - Sink Tap - 001359-Room 216	1	Wt	Grab	X								47
425-48-FD	3/29/2024	13:34	Lillian Schumaker - Bubbler - 001360-Room 216	1	Wt	Grab	X								48
425-49-FD	3/29/2024	13:37	Lillian Schumaker - Sink Tap - 001365-By 200-Boys	1	Wt	Grab	X								49

LAB USE ONLY: Wk Order #: ; Short Hold: ; Rush: ; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-50-FD	3/29/2024	13:37	Lillian Schumaker - Sink Tap - 001366-By 200-Boys	1	Wt	Grab	X								50
425-51-FD	3/29/2024	13:37	Lillian Schumaker - Sink Tap - 001367-By 200-Boys	1	Wt	Grab	X								51
425-52-FD	3/29/2024	13:37	Lillian Schumaker - Drinking Fountain - 2261-By 200	1	Wt	Grab	X								52
425-53-FD	3/29/2024	13:38	Lillian Schumaker - Drinking Fountain - 002262B-By 200	1	Wt	Grab	X								53
425-54-FD	3/29/2024	13:38	Lillian Schumaker - Bottle Filler - 002262F-By 200	1	Wt	Grab	X								54
425-55-FD	3/29/2024	13:38	Lillian Schumaker - Sink Tap - 001368-By 200-Girls	1	Wt	Grab	X								55
425-56-FD	3/29/2024	13:39	Lillian Schumaker - Sink Tap - 001369-By 200-Girls	1	Wt	Grab	X								56

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-57-FD	3/29/2024	13:39	Lillian Schumaker - Sink Tap - 001370-By 200-Girls	1	Wt	Grab	X								57
425-58-FD	3/29/2024	13:40	Lillian Schumaker - Sink Tap - 001388-Room 201	1	Wt	Grab	X								58
425-59-FD	3/29/2024	13:40	Lillian Schumaker - Bubbler - 001389-Room 201	1	Wt	Grab	X								59
425-60-FD	3/29/2024	13:41	Lillian Schumaker - Sink Tap - 001386-Room 203	1	Wt	Grab	X								60
425-61-FD	3/29/2024	13:41	Lillian Schumaker - Bubbler - 001387-Room 203	1	Wt	Grab	X								61
425-62-FD	3/29/2024	13:42	Lillian Schumaker - Sink Tap - 001384-Room 205	1	Wt	Grab	X								62
425-63-FD	3/29/2024	13:42	Lillian Schumaker - Bubbler - 001385-Room 205	1	Wt	Grab	X								63

LAB USE ONLY:
Wk Order #:
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-64-FD	3/29/2024	13:43	Lillian Schumaker - Sink Tap - 001382-Room 207	1	Wt	Grab	X								64
425-65-FD	3/29/2024	13:43	Lillian Schumaker - Bubbler - 001383-Room 207	1	Wt	Grab	X								65
425-66-FD	3/29/2024	13:44	Lillian Schumaker - Sink Tap - 001380-Room 208	1	Wt	Grab	X								66
425-67-FD	3/29/2024	13:44	Lillian Schumaker - Bubbler - 001381-Room 208	1	Wt	Grab	X								67
425-68-FD	3/29/2024	13:45	Lillian Schumaker - Sink Tap - 001378-Room 206	1	Wt	Grab	X								68
425-69-FD	3/29/2024	13:45	Lillian Schumaker - Bubbler - 001379-Room 206	1	Wt	Grab	X								69
425-70-FD	3/29/2024	13:46	Lillian Schumaker - Sink Tap - 001376-Room 204	1	Wt	Grab	X								70

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-71-FD	3/29/2024	13:46	Lillian Schumaker - Bubbler - 001377-Room 204	1	Wt	Grab	X								71
425-72-FD	3/29/2024	13:47	Lillian Schumaker - Sink Tap - 001374-Room 202	1	Wt	Grab	X								72
425-73-FD	3/29/2024	13:47	Lillian Schumaker - Bubbler - 001375-Room 202	1	Wt	Grab	X								73
425-74-FD	3/29/2024	13:48	Lillian Schumaker - Sink Tap - 001372-Room 200	1	Wt	Grab	X								74
425-75-FD	3/29/2024	13:48	Lillian Schumaker - Bubbler - 001373-Room 200	1	Wt	Grab	X								75
425-76-FD	3/29/2024	13:48	Lillian Schumaker - Sink Tap - 001371-Room 200-Staff Bathroom	1	Wt	Grab	X								76
425-77-FD	3/29/2024	13:49	Lillian Schumaker - Ice Machine - 002263-Lounge	1	Wt	Grab	X								77

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3 H D 0 0 2 0

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-78-FD	3/29/2024	13:49	Lillian Schumaker - Ice Machine - 002264-Lounge	1	Wt	Grab	X								78
425-79-FD	3/29/2024	13:49	Lillian Schumaker - Sink Tap - 001775-Lounge	1	Wt	Grab	X								79
425-80-FD	3/29/2024	13:50	Lillian Schumaker - Sink Tap - 001773-Office-Staff Bathroom	1	Wt	Grab	X								80
425-81-FD	3/29/2024	13:50	Lillian Schumaker - Sink Tap - 001774-Office-Staff Bathroom	1	Wt	Grab	X								81
425-82-FD	3/29/2024	13:50	Lillian Schumaker - Sink Tap - 001772-Office-Lactation Room	1	Wt	Grab	X								82
425-83-FD	3/29/2024	13:51	Lillian Schumaker - Sink Tap - 001390-Nurse Office	1	Wt	Grab	X								83
425-84-FD	3/29/2024	13:51	Lillian Schumaker - Sink Tap - 001771-Nurse Office-Bathroom	1	Wt	Grab	X								84

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-85-FD	3/29/2024	13:54	Lillian Schumaker - Sink Tap - 001802-By 111-Boys	1	Wt	Grab	X								85
425-86-FD	3/29/2024	13:54	Lillian Schumaker - Sink Tap - 001803-By 111-Boys	1	Wt	Grab	X								86
425-87-FD	3/29/2024	13:54	Lillian Schumaker - Sink Tap - 001804-By 111-Boys	1	Wt	Grab	X								87
425-88-FD	3/29/2024	13:54	Lillian Schumaker - Sink Tap - 001805-By 111-Boys	1	Wt	Grab	X								88
425-89-FD	3/29/2024	13:55	Lillian Schumaker - Sink Tap - 001806-By 111-Boys	1	Wt	Grab	X								89
425-90-FD	3/29/2024	13:55	Lillian Schumaker - Sink Tap - 001807-By 111-Girls	1	Wt	Grab	X								90
425-91-FD	3/29/2024	13:55	Lillian Schumaker - Sink Tap - 001808-By 111-Girls	1	Wt	Grab	X								91

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-92-FD	3/29/2024	13:55	Lillian Schumaker - Sink Tap - 001809-By 111-Girls	1	Wt	Grab	X								92
425-93-FD	3/29/2024	13:53	Lillian Schumaker - Sink Tap - 001810-By 111-Girls	1	Wt	Grab	X								93
425-94-FD	3/29/2024	13:53	Lillian Schumaker - Sink Tap - 001811-By 111-Girls	1	Wt	Grab	X								94
425-95-FD	3/29/2024	13:53	Lillian Schumaker - Drinking Fountain - 001800-By 111-	1	Wt	Grab	X								95
425-96-FD	3/29/2024	13:53	Lillian Schumaker - Drinking Fountain - 001801-By 111	1	Wt	Grab	X								96
425-97-FD	3/29/2024	13:55	Lillian Schumaker - Sink Tap - 001812-Room 113	1	Wt	Grab	X								97
425-98-FD	3/29/2024	13:55	Lillian Schumaker - Bubbler - 001813-Room 113	1	Wt	Grab	X								98

LAB USE ONLY:
Wk Order #:
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-99-FD	3/29/2024	13:55	Lillian Schumaker - Sink Tap - 001814-Room 115	1	Wt	Grab	X								99
425-100-FD	3/29/2024	13:56	Lillian Schumaker - Bubbler - 001815-Room 115	1	Wt	Grab	X								AA
425-101-FD	3/29/2024	13:56	Lillian Schumaker - Sink Tap - 001816-Room 117	1	Wt	Grab	X								AB
425-102-FD	3/29/2024	13:56	Lillian Schumaker - Bubbler - 001817-Room 117	1	Wt	Grab	X								AC
425-103-FD	3/29/2024	13:56	Lillian Schumaker - Sink Tap - 001818-Room 116	1	Wt	Grab	X								AD
425-104-FD	3/29/2024	13:57	Lillian Schumaker - Bubbler - 001819-Room 116	1	Wt	Grab	X								AE
425-105-FD	3/29/2024	13:57	Lillian Schumaker - Sink Tap - 001820-Room 114	1	Wt	Grab	X								AF

LAB USE ONLY:
Wk Order #:
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-106-FD	3/29/2024	13:57	Lillian Schumaker - Bubbler - 001821-Room 114	1	Wt	Grab	X								A G
425-107-FD	3/29/2024	13:58	Lillian Schumaker - Sink Tap - 001822-Room 112	1	Wt	Grab	X								A H
425-108-FD	3/29/2024	13:58	Lillian Schumaker - Bubbler - 001823-Room 112	1	Wt	Grab	X								A I
425-109-FD	3/29/2024	14:00	Lillian Schumaker - Sink Tap - 001824-By 103-Boys	1	Wt	Grab	X								A J
425-110-FD	3/29/2024	14:00	Lillian Schumaker - Sink Tap - 001825-By 103-Boys	1	Wt	Grab	X								A K
425-111-FD	3/29/2024	14:01	Lillian Schumaker - Sink Tap - 001826-By 103-Boys	1	Wt	Grab	X								A L
425-112-FD	3/29/2024	14:01	Lillian Schumaker - Sink Tap - 001827-By 103-Girls	1	Wt	Grab	X								A M

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3 H D 0 0 2 0

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-113-FD	3/29/2024	14:01	Lillian Schumaker - Sink Tap - 001828-By 103-Girls	1	Wt	Grab	X								AN
425-114-FD	3/29/2024	14:01	Lillian Schumaker - Sink Tap - 001829-By 103-Girls	1	Wt	Grab	X								AO
425-115-FD	3/29/2024	14:02	Lillian Schumaker - Sink Tap - 001830-Room 104	1	Wt	Grab	X								AP
425-116-FD	3/29/2024	14:02	Lillian Schumaker - Bubbler - 001831-Room 104	1	Wt	Grab	X								AQ
425-117-FD	3/29/2024	14:03	Lillian Schumaker - Sink Tap - 001832-Room 106	1	Wt	Grab	X								AR
425-118-FD	3/29/2024	14:03	Lillian Schumaker - Bubbler - 001833-Room 106	1	Wt	Grab	X								AS
425-119-FD	3/29/2024	14:03	Lillian Schumaker - Sink Tap - 002270-Room 106	1	Wt	Grab	X								AT

LAB USE ONLY:
Wk Order #:
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-120-FD	3/29/2024	14:03	Lillian Schumaker - Bubbler - 002269-Room 106	1	Wt	Grab	X								AU
425-121-FD	3/29/2024	14:04	Lillian Schumaker - Sink Tap - 001834-Room 106-Bathroom	1	Wt	Grab	X								AV
425-122-FD	3/29/2024	14:04	Lillian Schumaker - Sink Tap - 001835-Room 108	1	Wt	Grab	X								AW
425-123-FD	3/29/2024	14:04	Lillian Schumaker - Bubbler - 001836-Room 108	1	Wt	Grab	X								AX
425-124-FD	3/29/2024	14:03	Lillian Schumaker - Sink Tap - 001837-Room 108	1	Wt	Grab	X								AY
425-125-FD	3/29/2024	14:04	Lillian Schumaker - Bubbler - 001838-Room 108	1	Wt	Grab	X								AZ
425-126-FD	3/29/2024	14:04	Lillian Schumaker - Sink Tap - 002267-Room 108-Bathroom	1	Wt	Grab	X								BA

LAB USE ONLY: Wk Order #: ___ Short Hold: ___ Rush: ___ Temp: ___ oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:	REPORT TO:	BILL TO:
SAMPLER:	NAME: Jeff Hurst	NAME: Jeff Hurst
SITE NAME:	CO. NAME:	CO. NAME:
ADDRESS: 425 Claywoods Parkway	ADRESS: PO Box 47166	ADDRESS: PO Box 47166
CITY/ST/ZIP: Liberty, Missouri 64068	CITY/ST/ZIP: Kansas City, Missouri 64188	CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-522-2275	PHONE: 816-678-7894	PHONE: 816-678-7894
	EMAIL: jeffh@axiomservicepros.com	EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
425-127-FD	3/29/2024	14:05	Lillian Schumaker - Sink Tap - 001839-Room 109	1	Wt	Grab	X								BB
425-128-FD	3/29/2024	14:05	Lillian Schumaker - Bubbler - 001840-Room 109	1	Wt	Grab	X								BC
425-129-FD	3/29/2024	14:05	Lillian Schumaker - Sink Tap - 001841-Room 109	1	Wt	Grab	X								BD
425-130-FD	3/29/2024	14:05	Lillian Schumaker - Bubbler - 001842-Room 109	1	Wt	Grab	X								BE
425-131-FD	3/29/2024	14:06	Lillian Schumaker - Sink Tap - 002268-Room 109-Bathroom	1	Wt	Grab	X								BF
425-132-FD	3/29/2024	14:06	Lillian Schumaker - Sink Tap - 001843-Room 107	1	Wt	Grab	X								BG
425-133-FD	3/29/2024	14:06	Lillian Schumaker - Bubbler - 001844-Room 107	1	Wt	Grab	X								BH

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
425-134-FD	3/29/2024	14:06	Lillian Schumaker - Sink Tap - 001845-Room 107	1	Wt	Grab	X								B1
425-136-FD	3/29/2024	14:06	Lillian Schumaker - Sink Tap - 001847-Room 107-Bathroom	1	Wt	Grab	X								BJ
425-137-FD	3/29/2024	14:07	Lillian Schumaker - Sink Tap - 001848-Room 105	1	Wt	Grab	X								BK
425-138-FD	3/29/2024	14:07	Lillian Schumaker - Bubbler - 001849-Room 105	1	Wt	Grab	X								BL
425-139-FD	3/29/2024	14:08	Lillian Schumaker - Sink Tap - 001850-Room 103	1	Wt	Grab	X								BM
425-140-FD	3/29/2024	14:08	Lillian Schumaker - Bubbler - 001851-Room 103	1	Wt	Grab	X								BN
425-141-FD	3/29/2024	14:10	Lillian Schumaker - Sink Tap - 001857-Room 102	1	Wt	Grab	X								BO

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00220

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-142-FD	3/29/2024	14:10	Lillian Schumaker - Sink Tap - 001858-Room 102	1	Wt	Grab	X								BP
425-143-FD	3/29/2024	14:10	Lillian Schumaker - Sink Tap - 001859-Room 102	1	Wt	Grab	X								BQ
425-144-FD	3/29/2024	14:10	Lillian Schumaker - Sink Tap - 001860-Room 102	1	Wt	Grab	X								BR
425-145-FD	3/29/2024	14:12	Lillian Schumaker - Drinking Fountain - 001856-By Gym	1	Wt	Grab	X								BS
425-146-FD	3/29/2024	14:13	Lillian Schumaker - Sink Tap - 001852-Gym-Boys	1	Wt	Grab	X								BT
425-147-FD	3/29/2024	14:13	Lillian Schumaker - Sink Tap - 001853-Gym-Boys	1	Wt	Grab	X								BU
425-148-FD	3/29/2024	14:13	Lillian Schumaker - Sink Tap - 001854-Gym-Girls	1	Wt	Grab	X								BV

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
425-149-FD	3/29/2024	14:13	Lillian Schumaker - Sink Tap - 001855-Gym-Girls	1	Wt	Grab	X								BW
425-150-FD	3/29/2024	14:15	Lillian Schumaker - Drinking Fountain - 002570B-Cafeteria	1	Wt	Grab	X								BX
425-151-FD	3/29/2024	14:15	Lillian Schumaker - Bottle Filler - 002570F-Cafeteria	1	Wt	Grab	X								BY
425-152-FD	3/29/2024	14:17	Lillian Schumaker - Sink Tap - 001927-Kitchen	1	Wt	Grab	X								BZ
425-153-FD	3/29/2024	14:17	Lillian Schumaker - Sink Tap - 001928-Kitchen	1	Wt	Grab	X								CA
425-154-FD	3/29/2024	14:17	Lillian Schumaker - Sink Tap - 001929-Kitchen	1	Wt	Grab	X								CB
425-155-FD	3/29/2024	14:18	Lillian Schumaker - Sink Tap - 001930-Kitchen	1	Wt	Grab	X								CC

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-156-FD	3/29/2024	14:18	Lillian Schumaker - Sink Tap - 004501-Kitchen	1	Wt	Grab	X								CD
425-157-FD	3/29/2024	14:18	Lillian Schumaker - Sink Tap - 004502-Kitchen	1	Wt	Grab	X								CE
425-158-FD	3/29/2024	14:19	Lillian Schumaker - Sink Tap - 004503-Kitchen	1	Wt	Grab	X								CF
425-159-FD	3/29/2024	14:19	Lillian Schumaker - Sink Tap - 004504-Kitchen	1	Wt	Grab	X								CG
425-160-FD	3/29/2024	14:19	Lillian Schumaker - Sink Tap - 004505-Kitchen	1	Wt	Grab	X								CH
425-161-FD	3/29/2024	14:20	Lillian Schumaker - Sink Tap - 004506-Kitchen	1	Wt	Grab	X								CI
425-162-FD	3/29/2024	14:21	Lillian Schumaker - Sink Tap - 004507-Kitchen	1	Wt	Grab	X								CJ

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	425 Claywoods Parkway	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
425-163-FD	3/29/2024	14:21	Lillian Schumaker - Sink Tap - 004508-Kitchen	1	Wt	Grab	X								CK
425-164-FD	3/29/2024	14:21	Lillian Schumaker - Sink Tap - 004509-Kitchen	1	Wt	Grab	X								CL
425-165-FD	3/29/2024	14:21	Lillian Schumaker - Sink Tap - 004510-Kitchen	1	Wt	Grab	X								CM
425-166-FD	3/29/2024	14:22	Lillian Schumaker - Pot Filler - 000355-Kitchen	1	Wt	Grab	X								CN
425-167-FD	3/29/2024	14:22	Lillian Schumaker - Pot Filler - 000356-Kitchen	1	Wt	Grab	X								CO
425-168-FD	3/29/2024	14:22	Lillian Schumaker - Sink Tap - 004511-Kitchen Bathroom	1	Wt	Grab	X								CP
425-169-FD	3/29/2024	14:23	Lillian Schumaker - Ice Machine - 000950-Kitchen	1	Wt	Grab	X								CQ

LAB USE ONLY: Wk Order #: | Short Hold: | Rush: | Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		

3HD00020

AXIOM Service Professionals

PM: Carolyn Jackson

Appendix D
Photo Log



3/29/2024 - 425-1 - Lillian Schumaker - 001778-
By Room 311-Boys



3/29/2024 - 425-2 - Lillian Schumaker - 001779-
By 311-Boys



3/29/2024 - 425-3 - Lillian Schumaker - 001780-
By 311-Boys



3/29/2024 - 425-4 - Lillian Schumaker - 001781-
By 311-Boys



3/29/2024 - 425-5 - Lillian Schumaker - 001782- By 311-Boys



3/29/2024 - 425-6 - Lillian Schumaker - 001783- By 311-Girls



3/29/2024 - 425-7 - Lillian Schumaker - 001784- By 311-Girls



3/29/2024 - 425-8 - Lillian Schumaker - 001785- By 311-Girls



3/29/2024 - 425-9 - Lillian Schumaker - 001786-By 311-Girls



3/29/2024 - 425-10 - Lillian Schumaker - 001787-By 311-Girls




3/29/2024 - 425-11 - Lillian Schumaker - 001776-By 311




3/29/2024 - 425-12 - Lillian Schumaker - 001777B-By 311




3/29/2024 - 425-13 - Lillian Schumaker - 001777F-By 311

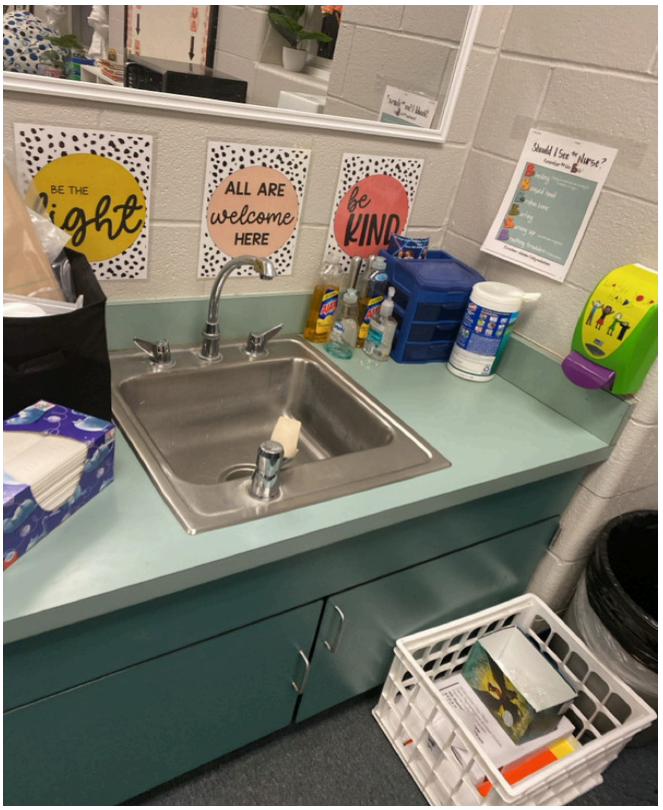


3/29/2024 - 425-14 - Lillian Schumaker - 001788-Room 313

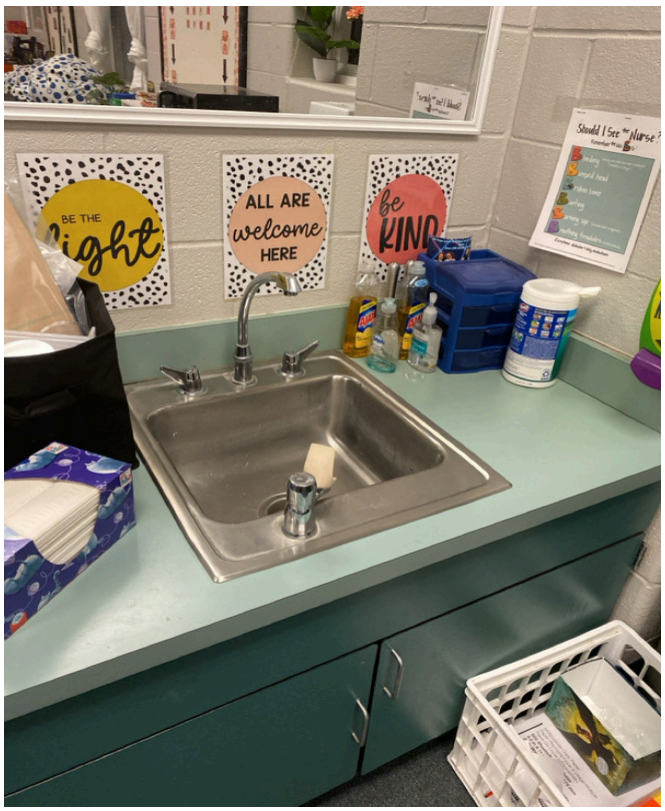


3/29/2024 - 425-15 - Lillian Schumaker - 001789-Room 313

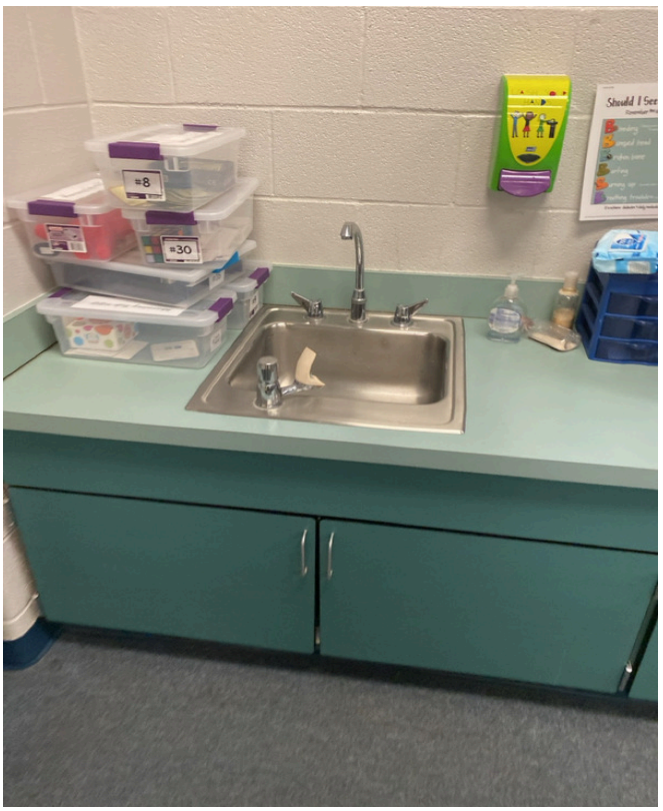


3/29/2024 - 425-16 - Lillian Schumaker - 001798-Room 312

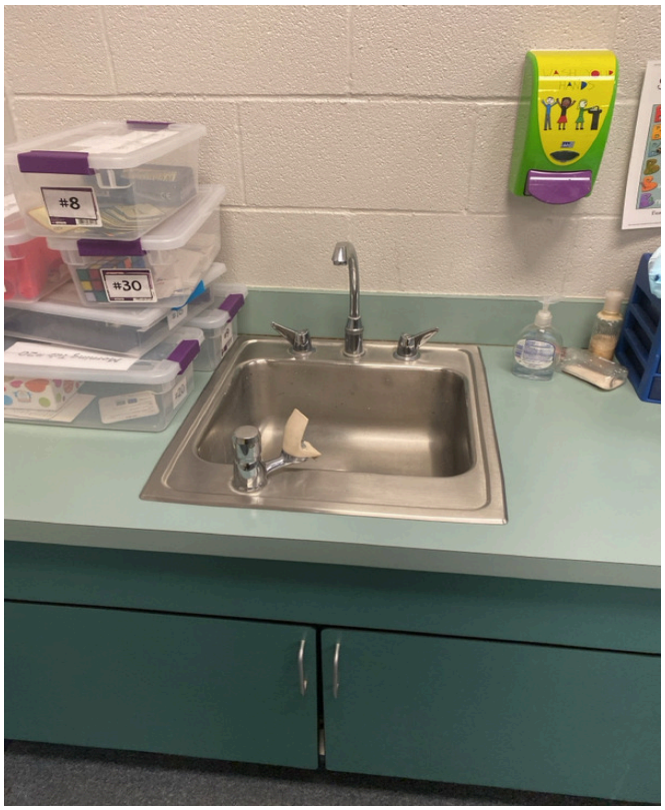

3/29/2024 - 425-17 - Lillian Schumaker - 001799- Room 312

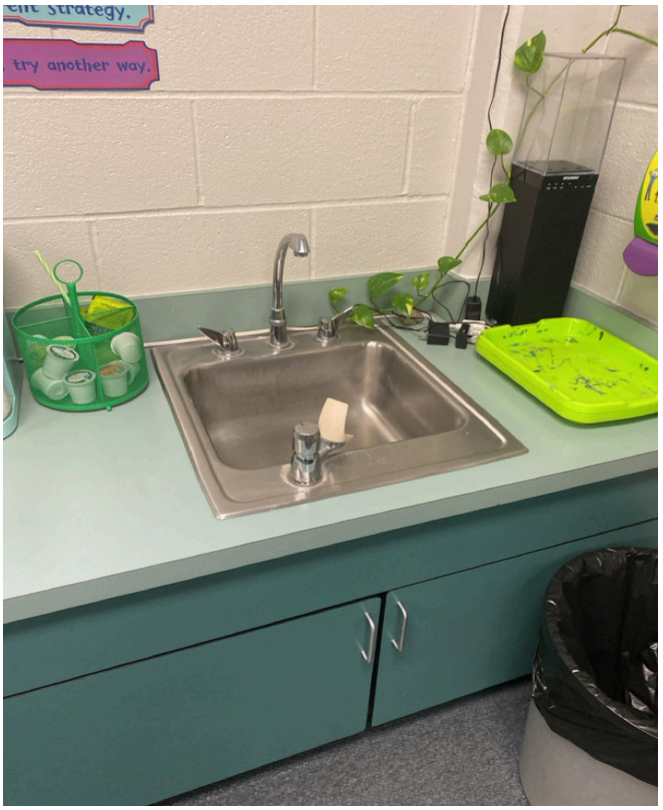

3/29/2024 - 425-18 - Lillian Schumaker - 001796- Room 314

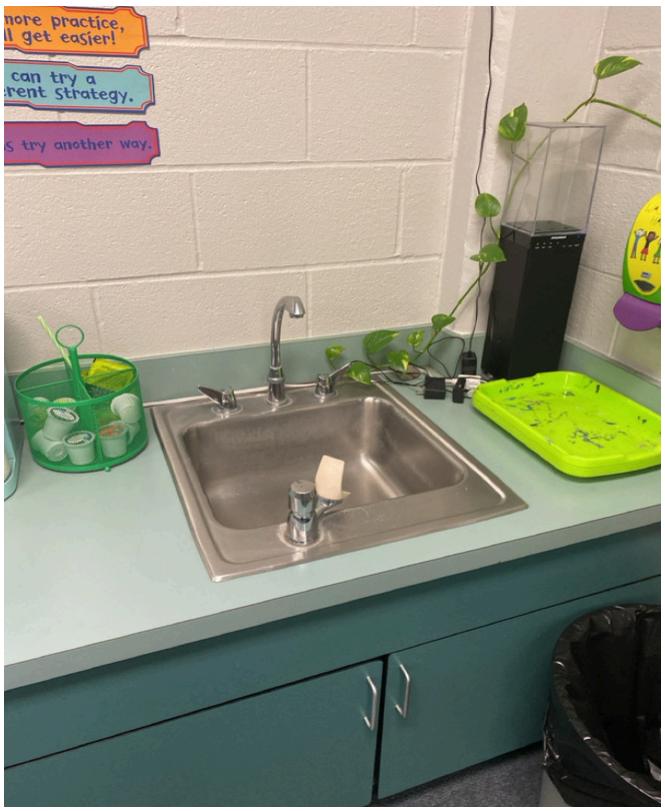

3/29/2024 - 425-19 - Lillian Schumaker - 001797- Room 314



3/29/2024 - 425-20 - Lillian Schumaker - 001790- Room 315




3/29/2024 - 425-21 - Lillian Schumaker - 001791- Room 315



3/29/2024 - 425-22 - Lillian Schumaker - 001792- Room 317




3/29/2024 - 425-23 - Lillian Schumaker - 001793- Room 317

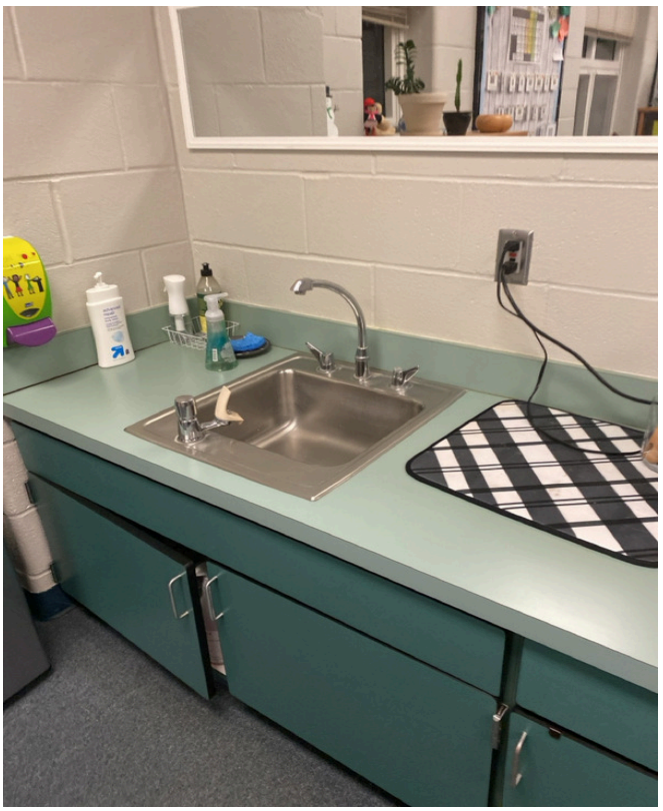

3/29/2024 - 425-24 - Lillian Schumaker - 001794- Room 316




3/29/2024 - 425-25 - Lillian Schumaker - 001795- Room 316

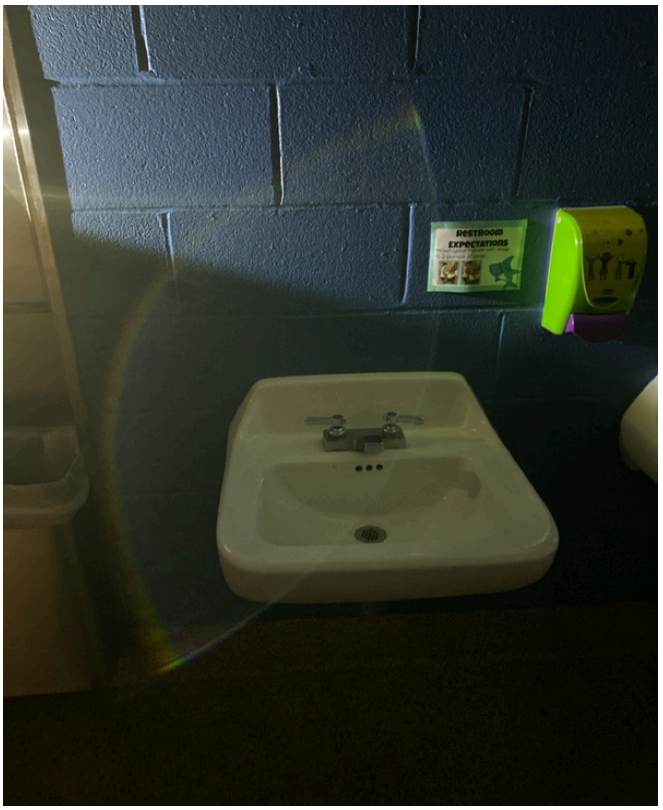

3/29/2024 - 425-26 - Lillian Schumaker - 001341- By 211-Boys




3/29/2024 - 425-27 - Lillian Schumaker - 001342- By 211-Boys

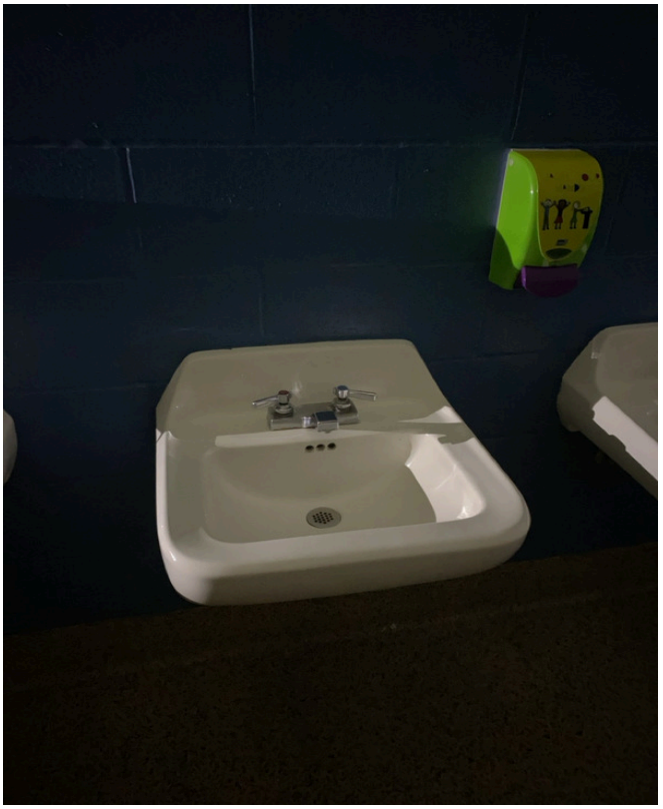


3/29/2024 - 425-28 - Lillian Schumaker - 001343- By 211-Boys



3/29/2024 - 425-29 - Lillian Schumaker - 001344-By 211-Boys

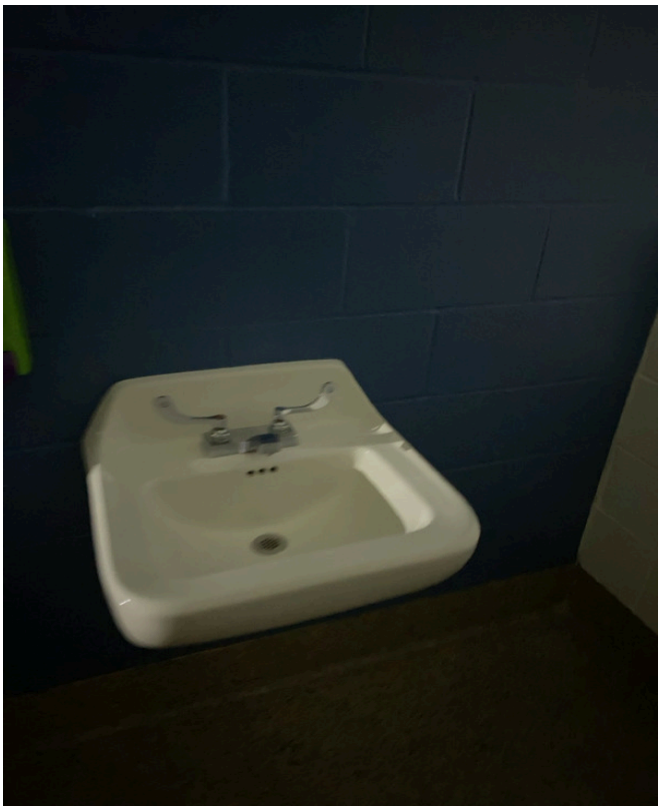

3/29/2024 - 425-30 - Lillian Schumaker - 001345-By 211-Boys

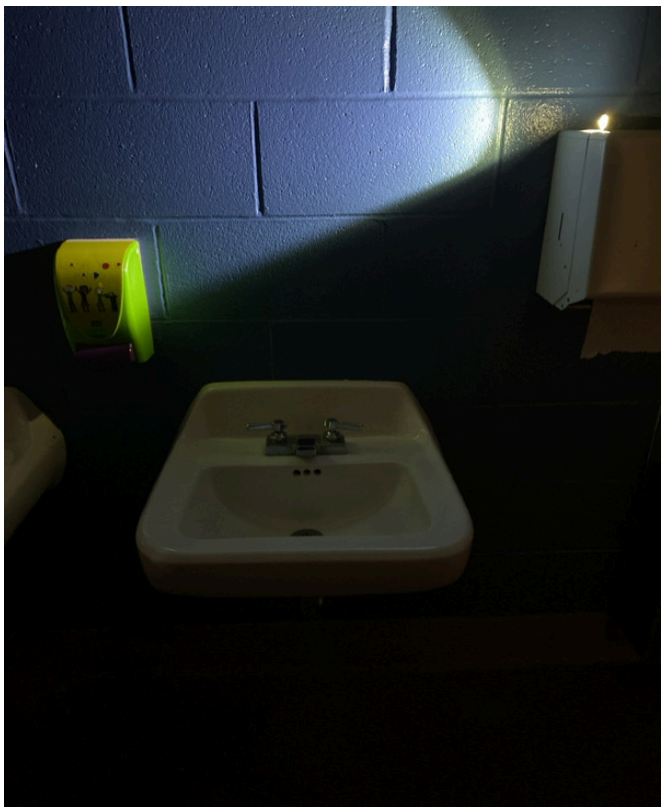

3/29/2024 - 425-31 - Lillian Schumaker - 001346-By 211-Girls



3/29/2024 - 425-32 - Lillian Schumaker - 001347-By 211-Girls



3/29/2024 - 425-33 - Lillian Schumaker - 001348-By 211-Girls



3/29/2024 - 425-34 - Lillian Schumaker - 001349-By 211-Girls



3/29/2024 - 425-35 - Lillian Schumaker - 001350-By 211-Girls



3/29/2024 - 425-36 - Lillian Schumaker - 001351B-By 211




3/29/2024 - 425-37 - Lillian Schumaker - 001351F-By 211



3/29/2024 - 425-38 - Lillian Schumaker - 001352-By 211



3/29/2024 - 425-39 - Lillian Schumaker - 001353-Room 213

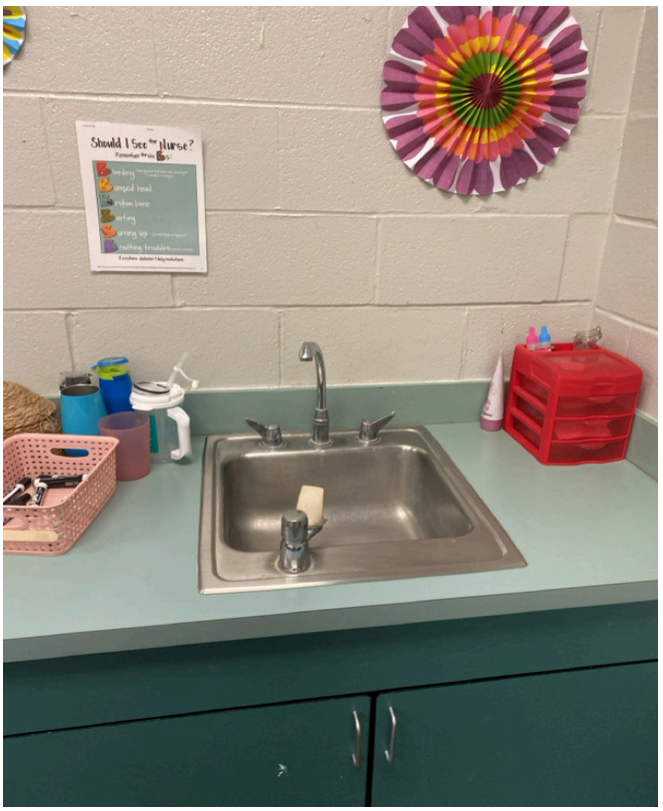


3/29/2024 - 425-40 - Lillian Schumaker - 001353B-Room 213




3/29/2024 - 425-41 - Lillian Schumaker - 001361- Room 214




3/29/2024 - 425-42 - Lillian Schumaker - 001362- Room 214

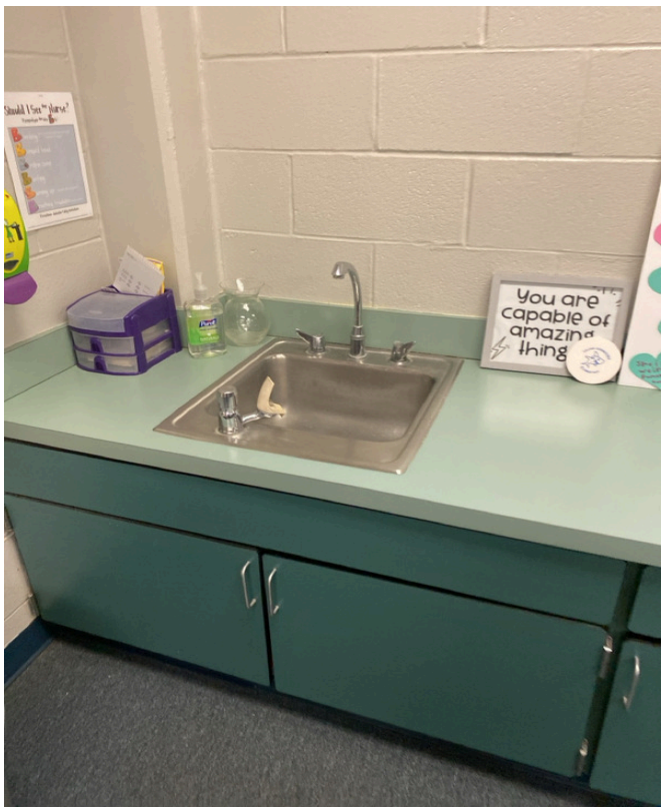


3/29/2024 - 425-43 - Lillian Schumaker - 001355- Room 215

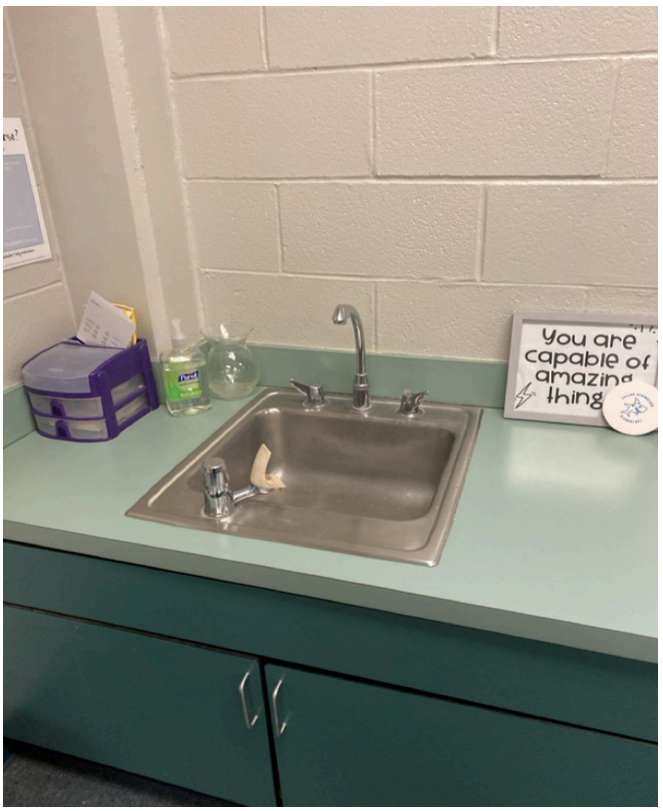


3/29/2024 - 425-44 - Lillian Schumaker - 001356- Room 215

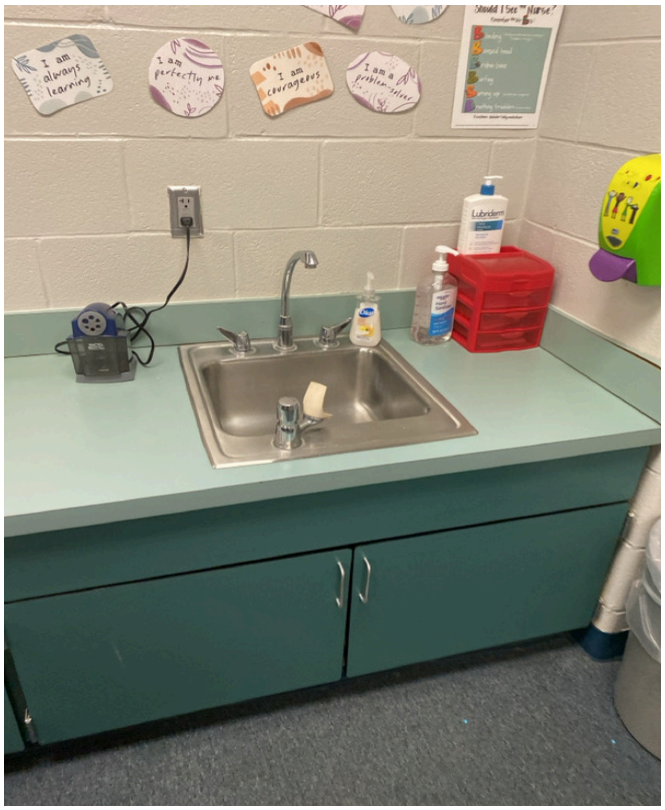

3/29/2024 - 425-45 - Lillian Schumaker - 001357-Room 217

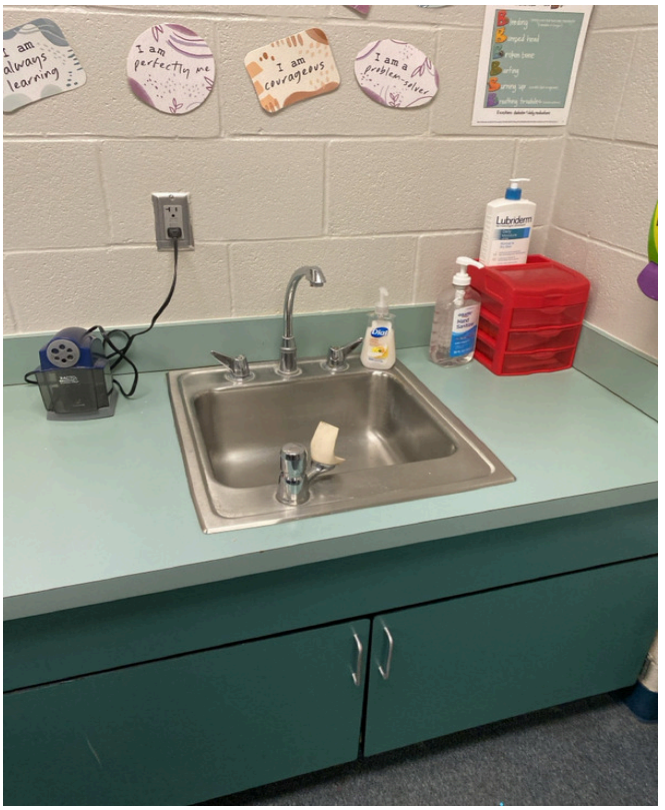


3/29/2024 - 425-46 - Lillian Schumaker - 001358-Room 217

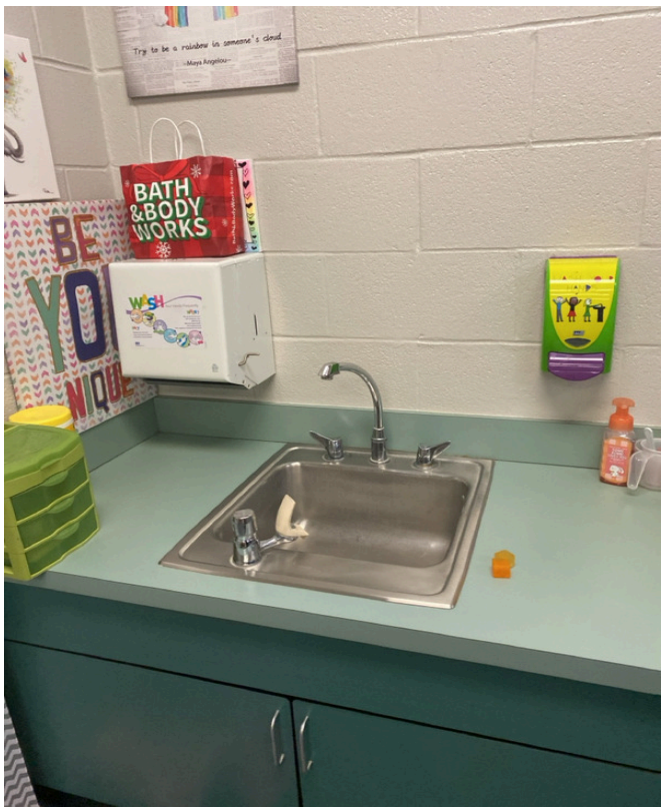

3/29/2024 - 425-47 - Lillian Schumaker - 001359-Room 216



3/29/2024 - 425-48 - Lillian Schumaker - 001360-Room 216

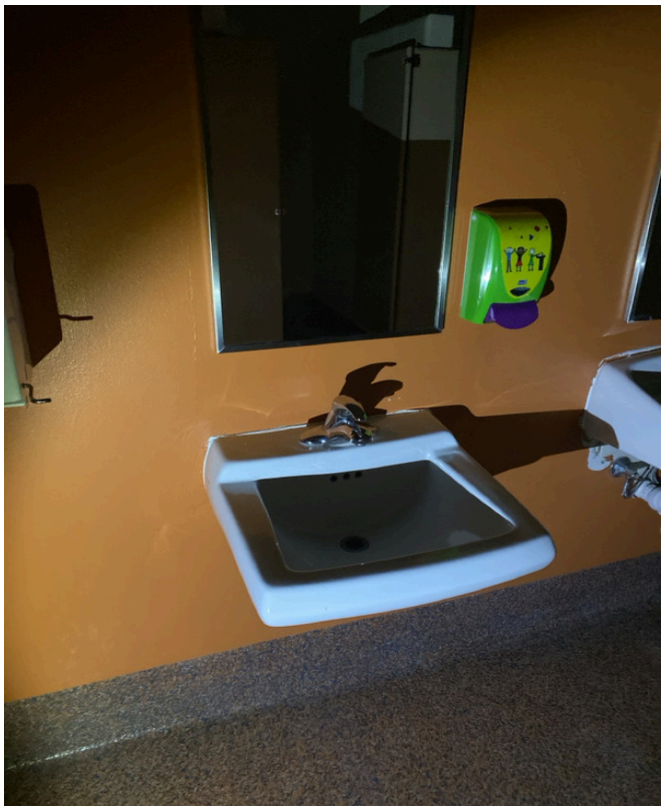


3/29/2024 - 425-49 - Lillian Schumaker - 001365-By 200-Boys




3/29/2024 - 425-50 - Lillian Schumaker - 001366-By 200-Boys




3/29/2024 - 425-51 - Lillian Schumaker - 001367-By 200-Boys

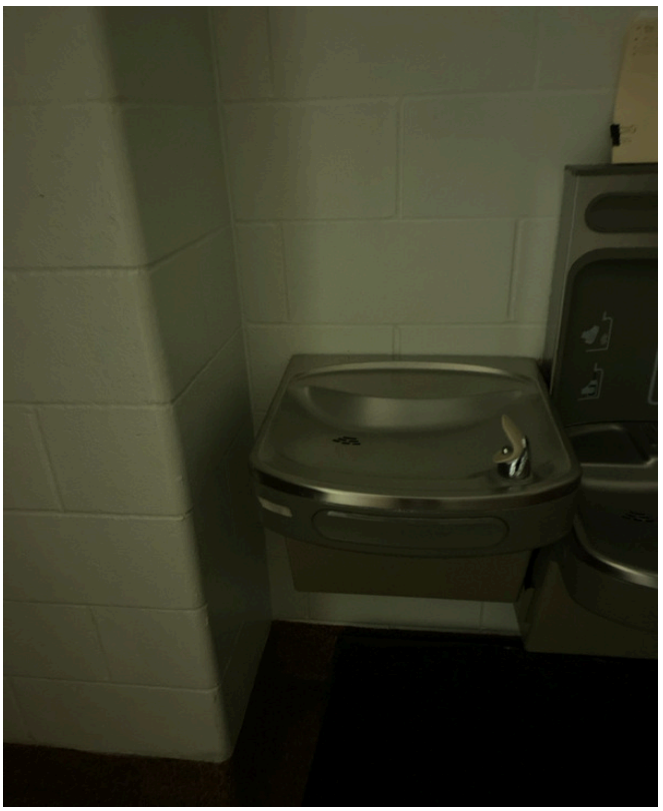

3/29/2024 - 425-52 - Lillian Schumaker - 2261-By 200

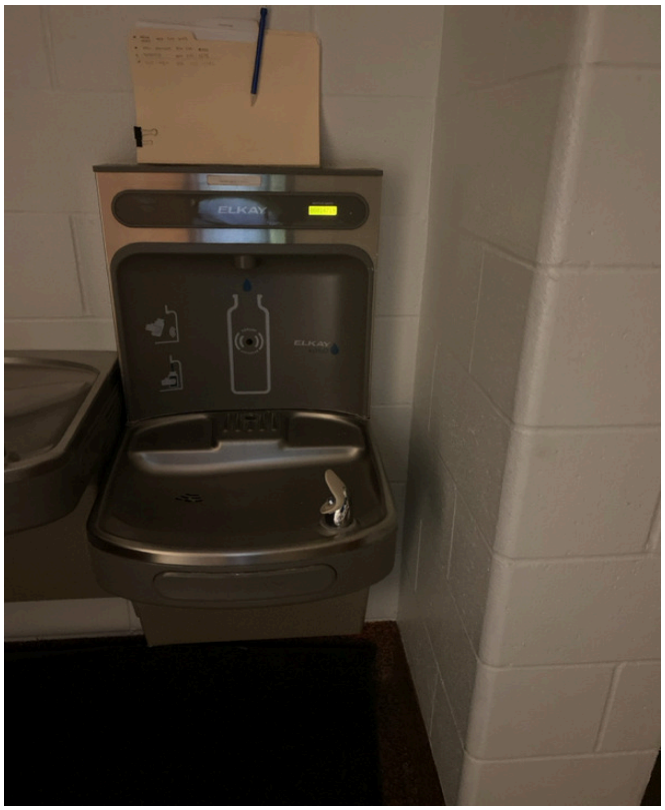


3/29/2024 - 425-53 - Lillian Schumaker - 002262B-By 200

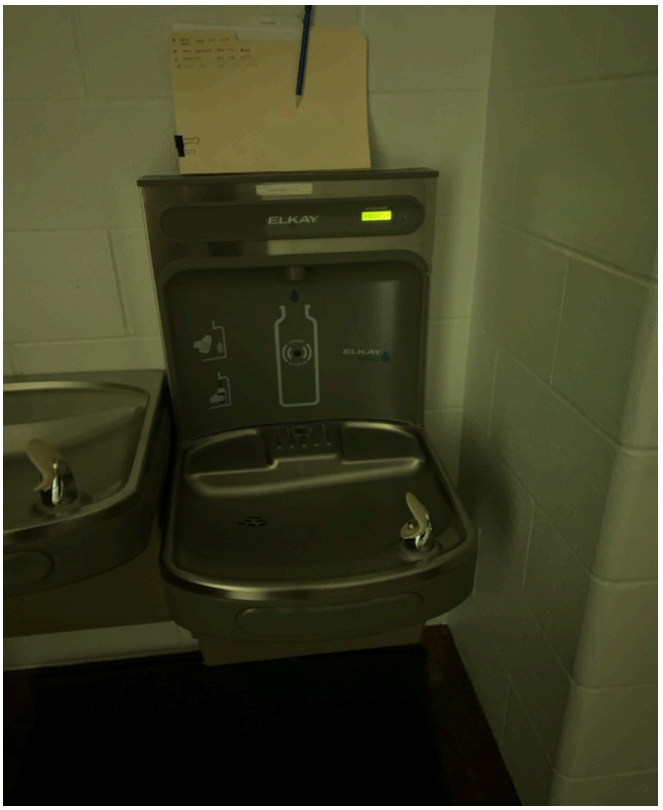

3/29/2024 - 425-54 - Lillian Schumaker - 002262F-By 200




3/29/2024 - 425-55 - Lillian Schumaker - 001368-By 200-Girls

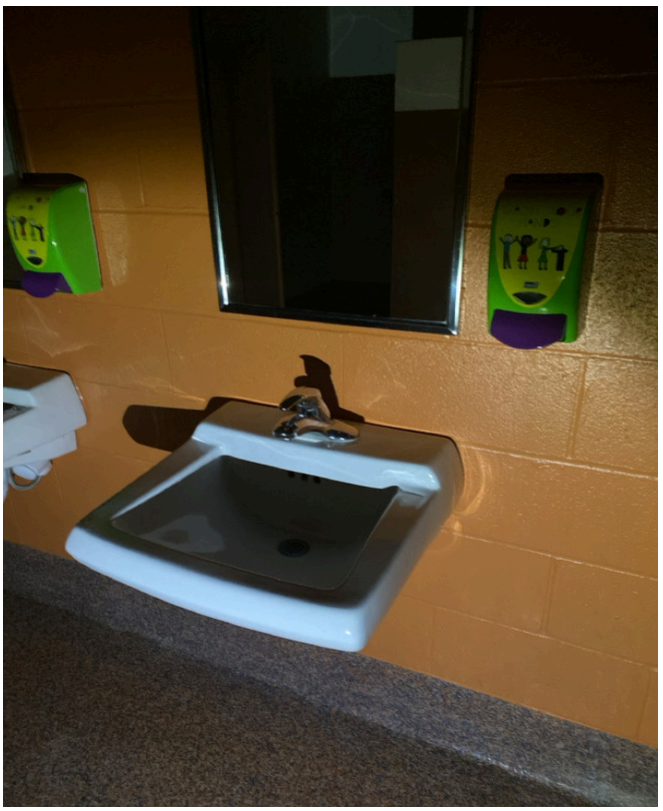

3/29/2024 - 425-56 - Lillian Schumaker - 001369-By 200-Girls



3/29/2024 - 425-57 - Lillian Schumaker - 001370-By 200-Girls

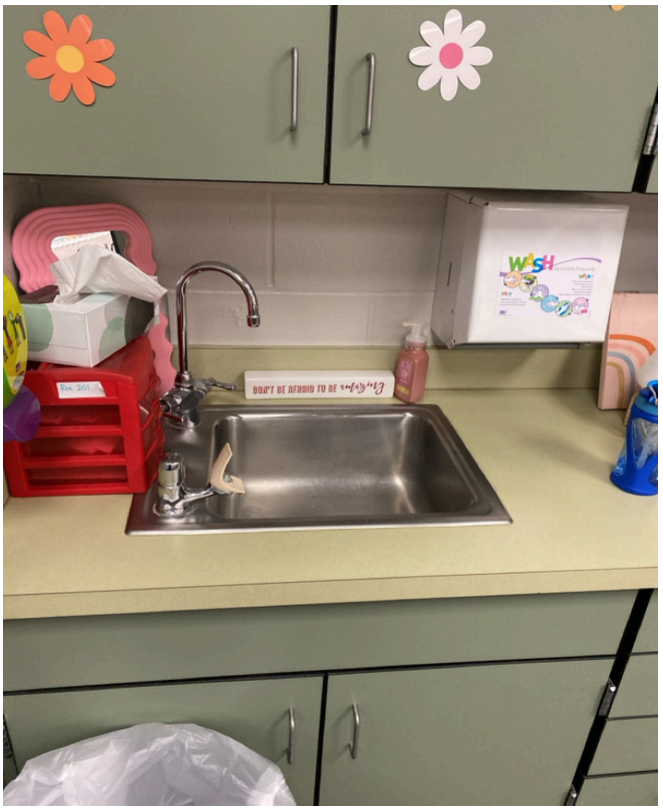


3/29/2024 - 425-58 - Lillian Schumaker - 001388-Room 201




3/29/2024 - 425-59 - Lillian Schumaker - 001389-Room 201



3/29/2024 - 425-60 - Lillian Schumaker - 001386-Room 203

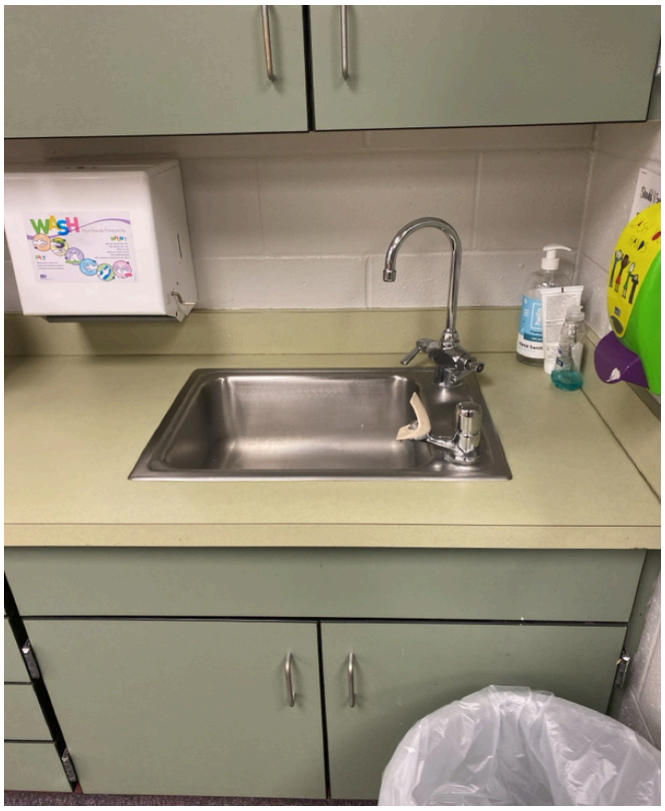


3/29/2024 - 425-61 - Lillian Schumaker - 001387-Room 203

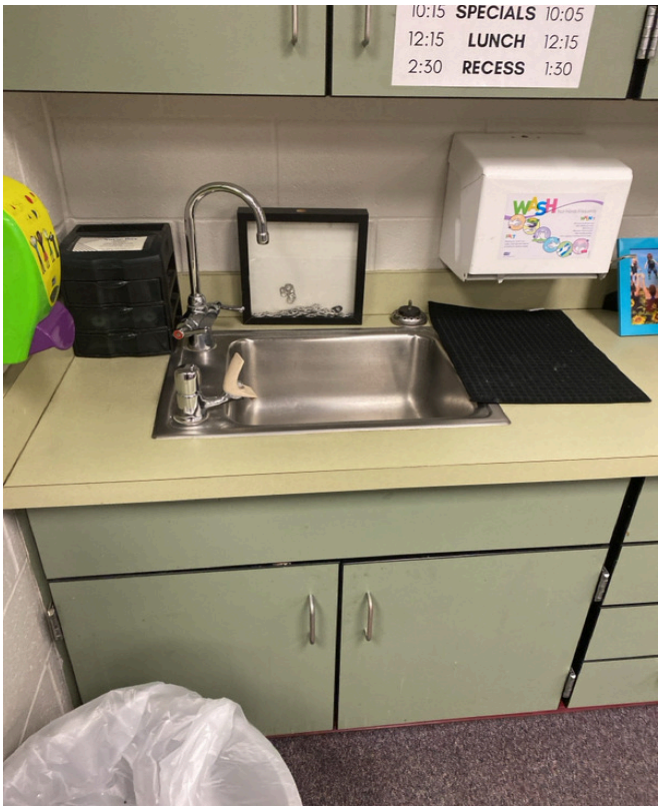

3/29/2024 - 425-62 - Lillian Schumaker - 001384-Room 205



3/29/2024 - 425-63 - Lillian Schumaker - 001385-Room 205

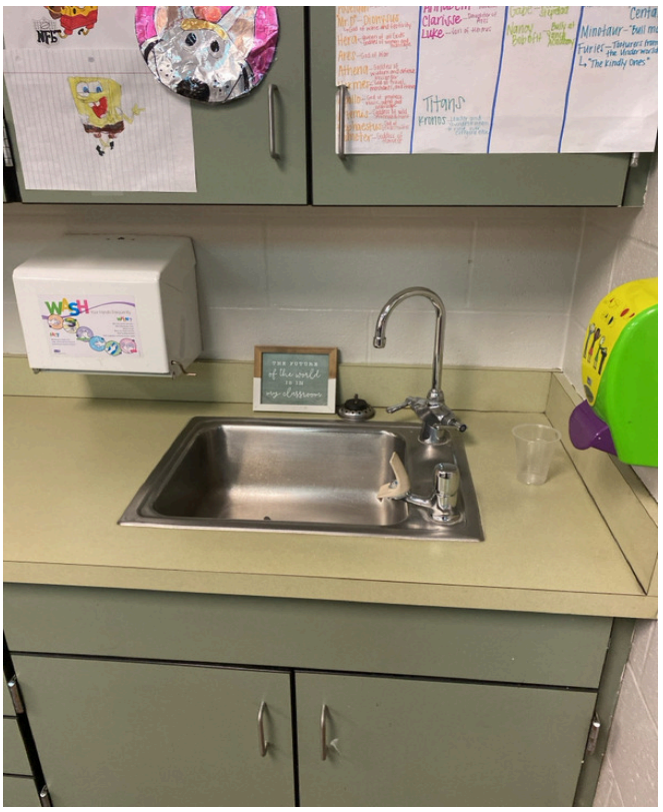

3/29/2024 - 425-64 - Lillian Schumaker - 001382-Room 207



3/29/2024 - 425-65 - Lillian Schumaker - 001383- Room 207



3/29/2024 - 425-66 - Lillian Schumaker - 001380- Room 208




3/29/2024 - 425-67 - Lillian Schumaker - 001381- Room 208



3/29/2024 - 425-68 - Lillian Schumaker - 001378- Room 206



3/29/2024 - 425-69 - Lillian Schumacher - 001379-Room 206

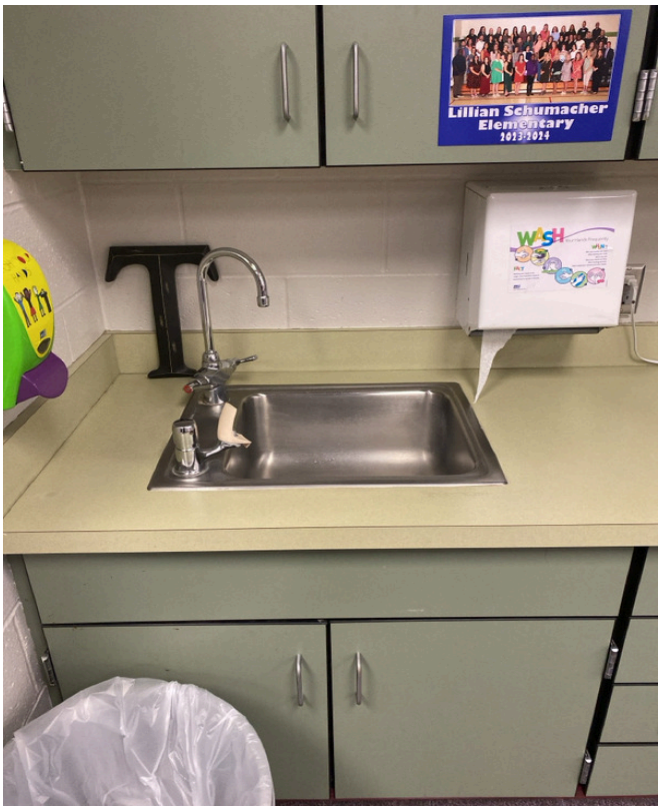


3/29/2024 - 425-70 - Lillian Schumacher - 001376-Room 204



3/29/2024 - 425-71 - Lillian Schumacher - 001377-Room 204



3/29/2024 - 425-72 - Lillian Schumacher - 001374-Room 202

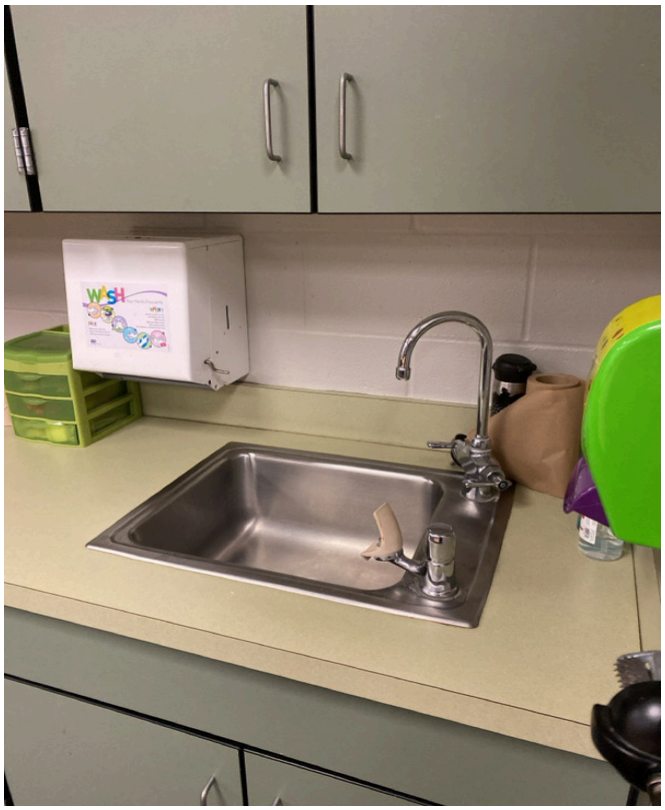

3/29/2024 - 425-73 - Lillian Schumaker - 001375- Room 202



3/29/2024 - 425-74 - Lillian Schumaker - 001372- Room 200



3/29/2024 - 425-75 - Lillian Schumaker - 001373- Room 200



3/29/2024 - 425-76 - Lillian Schumaker - 001371- Room 200-Staff Bathroom



3/29/2024 - 425-77 - Lillian Schumaker - 002263-Lounge



3/29/2024 - 425-78 - Lillian Schumaker - 002264-Lounge



3/29/2024 - 425-79 - Lillian Schumaker - 001775-Lounge



3/29/2024 - 425-80 - Lillian Schumaker - 001773-Office-Staff Restroom



3/29/2024 - 425-81 - Lillian Schumaker - 001774-Office-Staff Restroom




3/29/2024 - 425-82 - Lillian Schumaker - 001772-Office-Lactation Room




3/29/2024 - 425-83 - Lillian Schumaker - 001390-Nurse's Office




3/29/2024 - 425-84 - Lillian Schumaker - 001771-Nurse's Office-Restroom

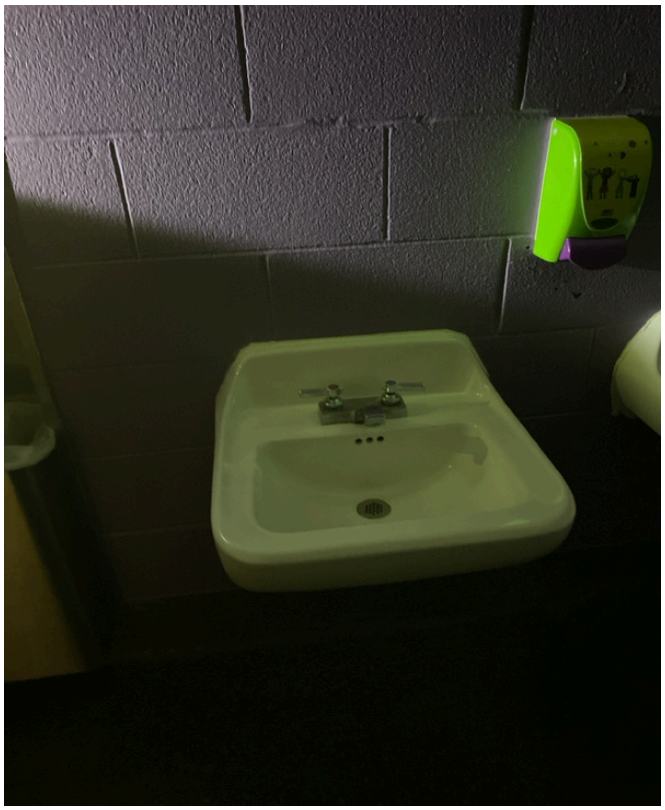


3/29/2024 - 425-85 - Lillian Schumaker - 001802-By 111-Boys

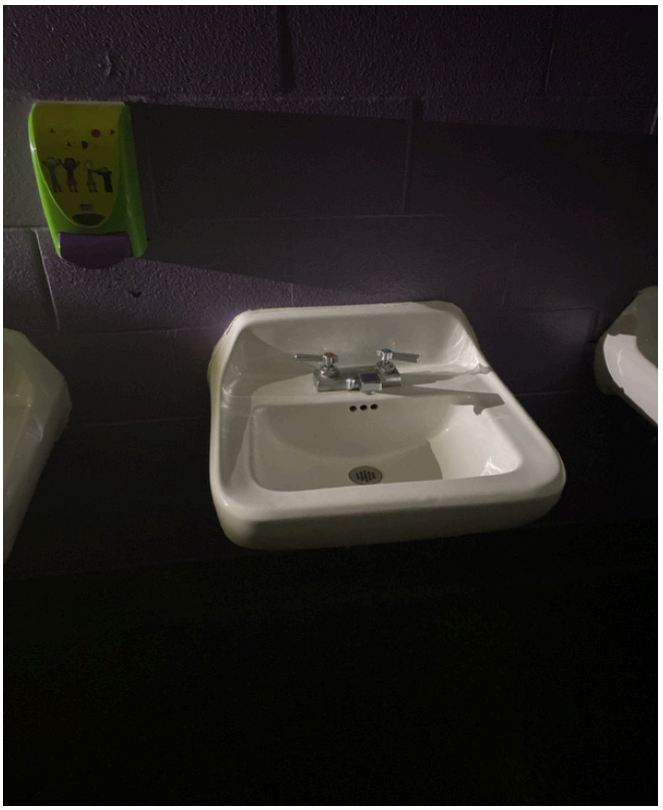


3/29/2024 - 425-86 - Lillian Schumaker - 001803-By 111-Boys

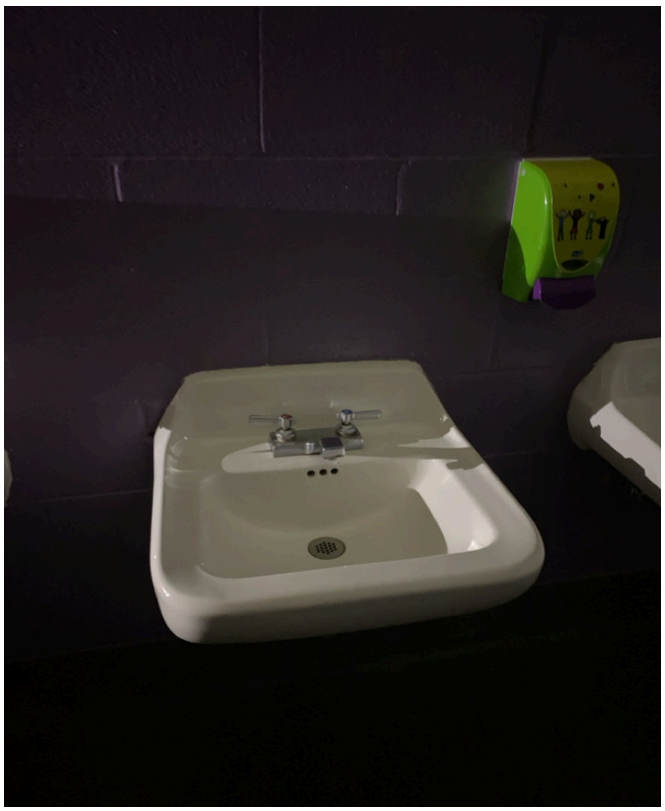


3/29/2024 - 425-87 - Lillian Schumaker - 001804-By 111-Boys

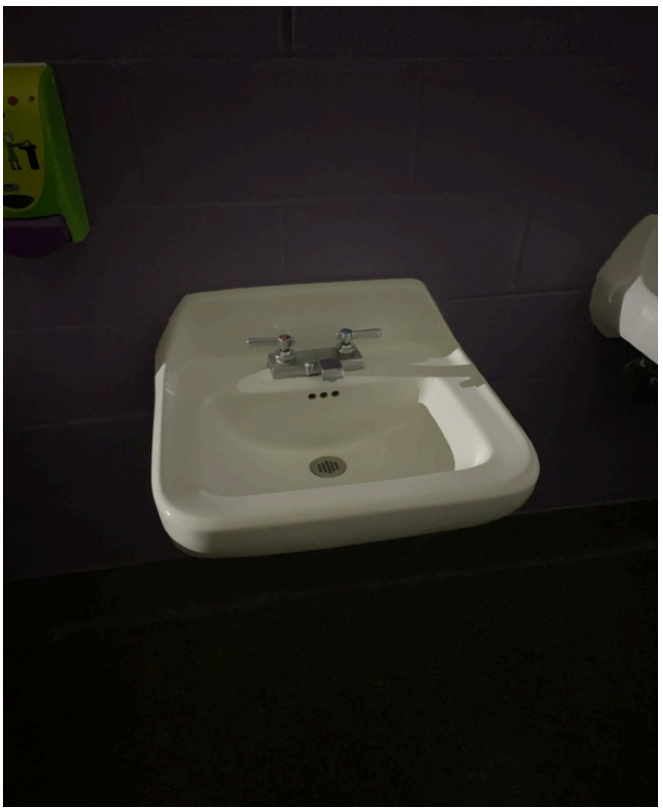


3/29/2024 - 425-88 - Lillian Schumaker - 001805-By 111-Boys

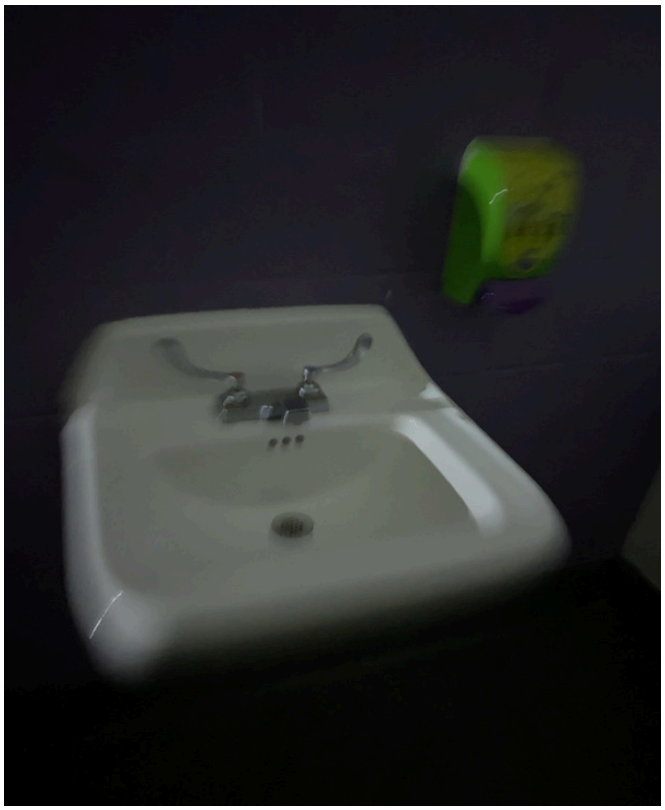


3/29/2024 - 425-89 - Lillian Schumaker - 001806-By 111-Boys

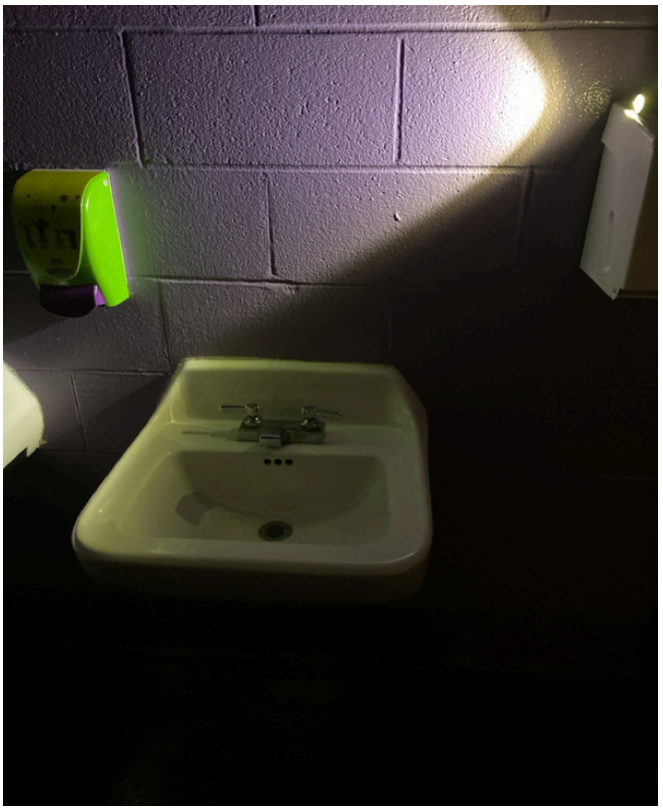

3/29/2024 - 425-90 - Lillian Schumaker - 001807-By 111-Girls

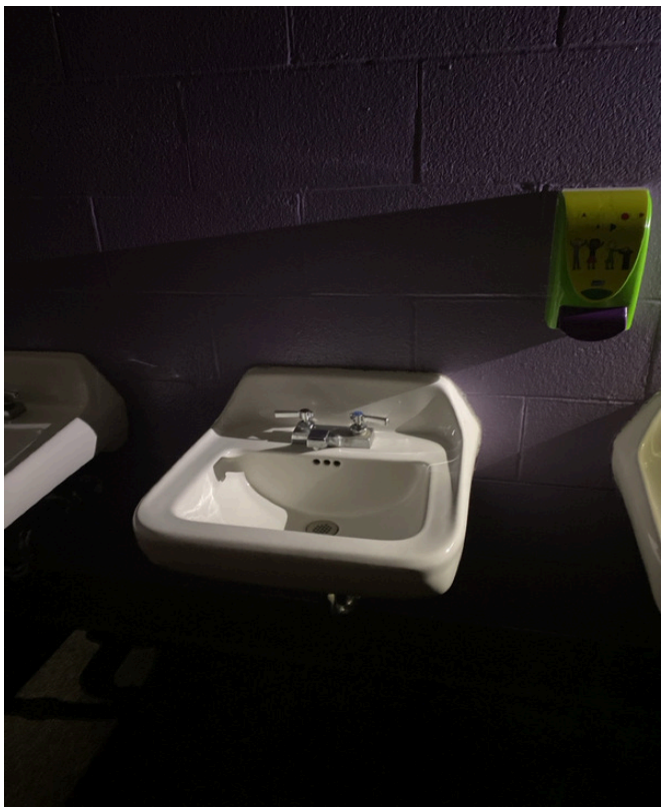

3/29/2024 - 425-91 - Lillian Schumaker - 001808-By 111-Girls

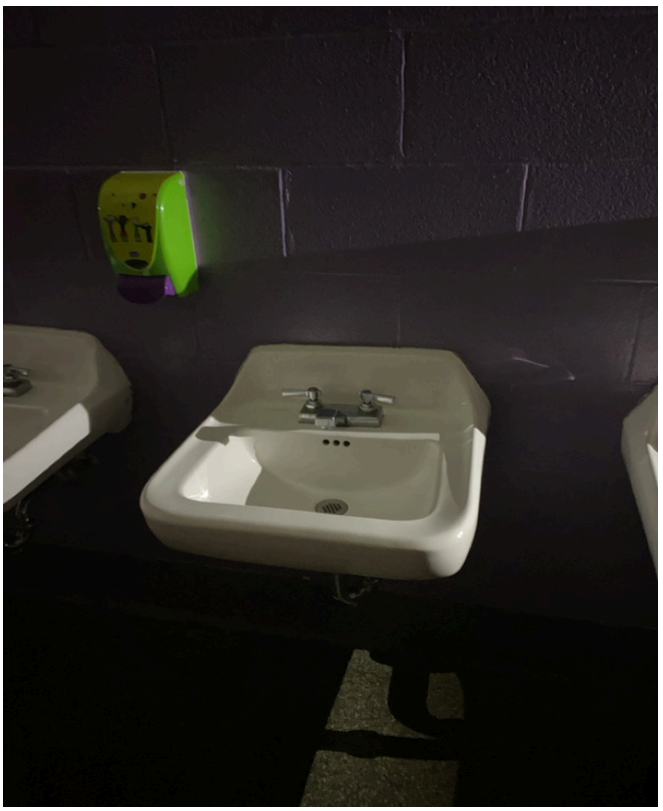

3/29/2024 - 425-92 - Lillian Schumaker - 001809-By 111-Girls



3/29/2024 - 425-93 - Lillian Schumaker - 001810-By 111-Girls



3/29/2024 - 425-94 - Lillian Schumaker - 001811-By 111-Girls



3/29/2024 - 425-95 - Lillian Schumaker - 001800-By 111



3/29/2024 - 425-96 - Lillian Schumaker - 001801-By 111



3/29/2024 - 425-97 - Lillian Schumaker - 001812-Room 113



3/29/2024 - 425-98 - Lillian Schumaker - 001813-Room 113




3/29/2024 - 425-99 - Lillian Schumaker - 001814-Room 115



3/29/2024 - 425-100 - Lillian Schumaker - 001815-Room 115




3/29/2024 - 425-101 - Lillian Schumaker - 001816-Room 117

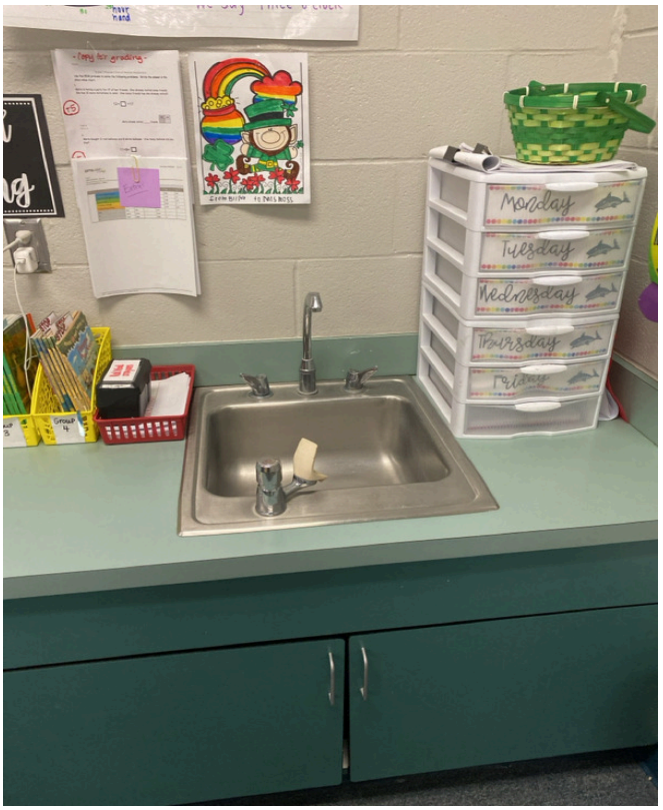

3/29/2024 - 425-102 - Lillian Schumaker - 001817-Room 117



3/29/2024 - 425-103 - Lillian Schumaker - 001818-Room 116

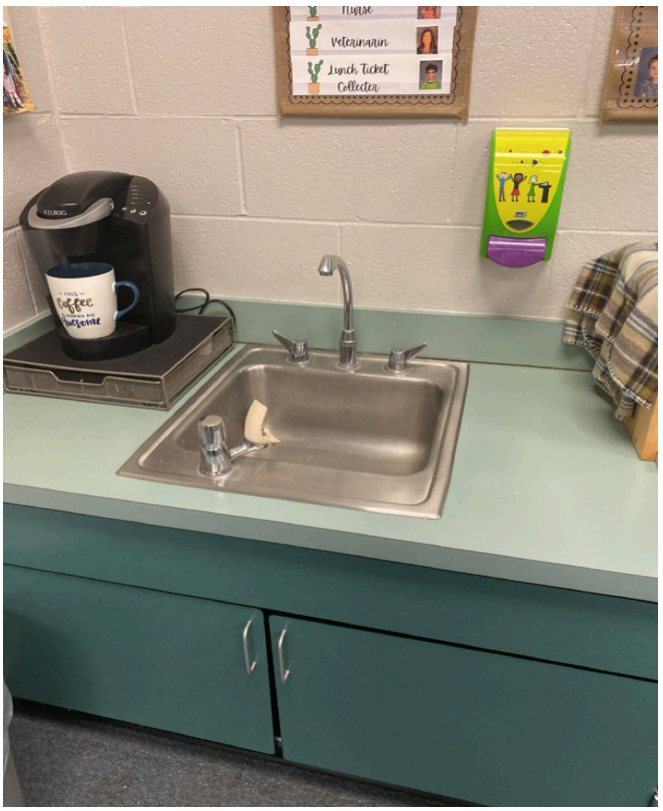

3/29/2024 - 425-104 - Lillian Schumaker - 001819-Room 116



3/29/2024 - 425-105 - Lillian Schumaker - 001820-Room 114



3/29/2024 - 425-106 - Lillian Schumaker - 001821-Room 114



3/29/2024 - 425-107 - Lillian Schumaker - 001822-Room 112



3/29/2024 - 425-108 - Lillian Schumaker - 001823-Room 112



3/29/2024 - 425-109 - Lillian Schumaker - 001824-By 103-Boys



3/29/2024 - 425-110 - Lillian Schumaker - 001825-By 103-Boys



3/29/2024 - 425-111 - Lillian Schumaker - 001826-By 103-Boys



3/29/2024 - 425-112 - Lillian Schumaker - 001827-By 103-Girls



3/29/2024 - 425-113 - Lillian Schumaker - 001828-By 103-Girls



3/29/2024 - 425-114 - Lillian Schumaker - 001829-By 103-Girls



3/29/2024 - 425-115 - Lillian Schumaker - 001830-Room 104



3/29/2024 - 425-116 - Lillian Schumaker - 001831-Room 104




3/29/2024 - 425-117 - Lillian Schumaker - 001832-Room 106



3/29/2024 - 425-118 - Lillian Schumaker - 001833-Room 106



3/29/2024 - 425-119 - Lillian Schumaker - 002270-Room 106

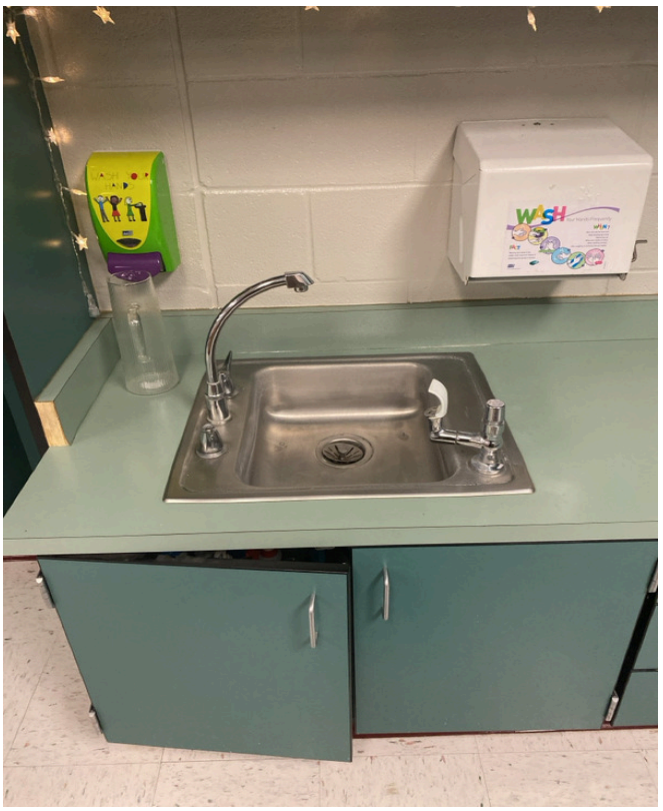

3/29/2024 - 425-120 - Lillian Schumaker - 002269-Room 106




3/29/2024 - 425-121 - Lillian Schumaker - 001834-Room 106-Bathroom



3/29/2024 - 425-122 - Lillian Schumaker - 001835-Room 108



3/29/2024 - 425-123 - Lillian Schumaker - 001836-Room 108

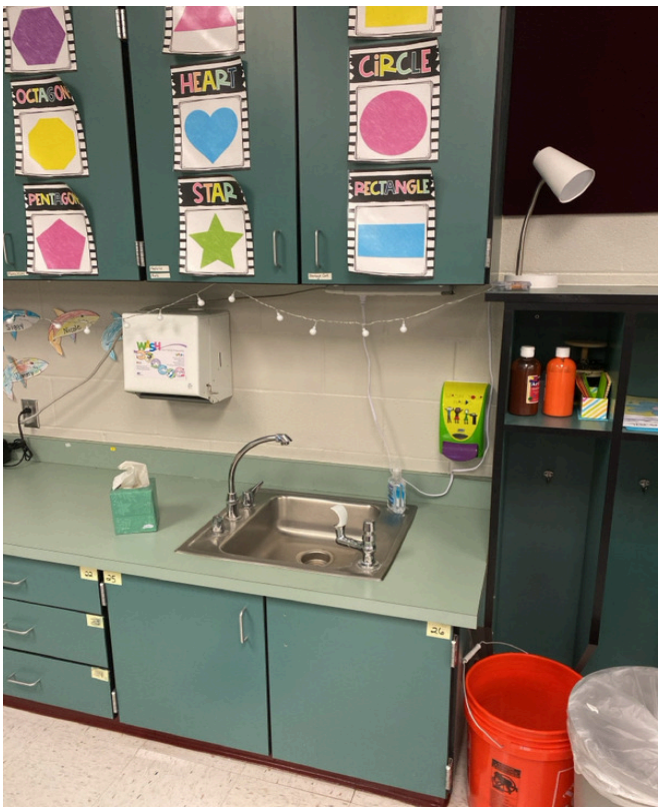


3/29/2024 - 425-124 - Lillian Schumaker - 001837-Room 108




3/29/2024 - 425-125 - Lillian Schumaker - 001838-Room 108




3/29/2024 - 425-126 - Lillian Schumaker - 002267-Room 108-Bathroom

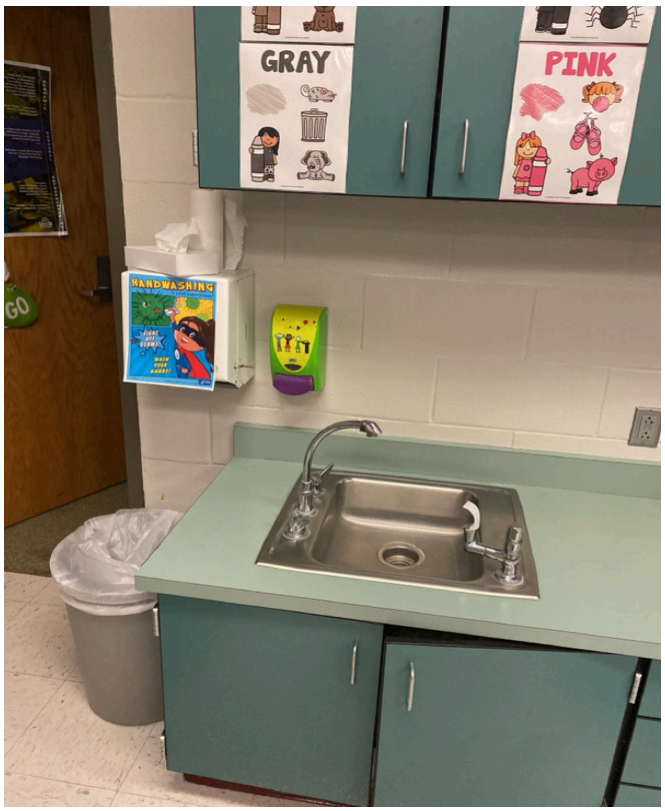


3/29/2024 - 425-127 - Lillian Schumaker - 001839-Room 109

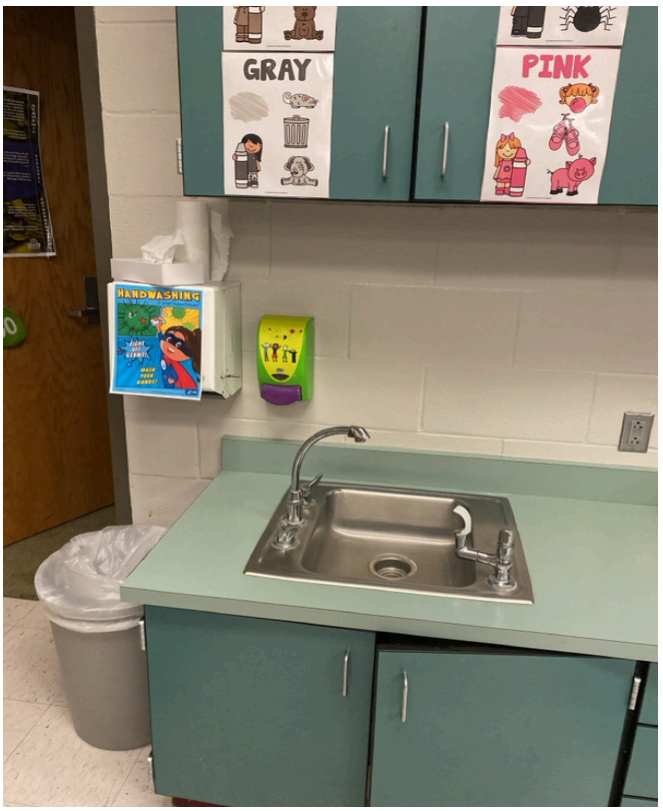

3/29/2024 - 425-128 - Lillian Schumaker - 001840-Room 109

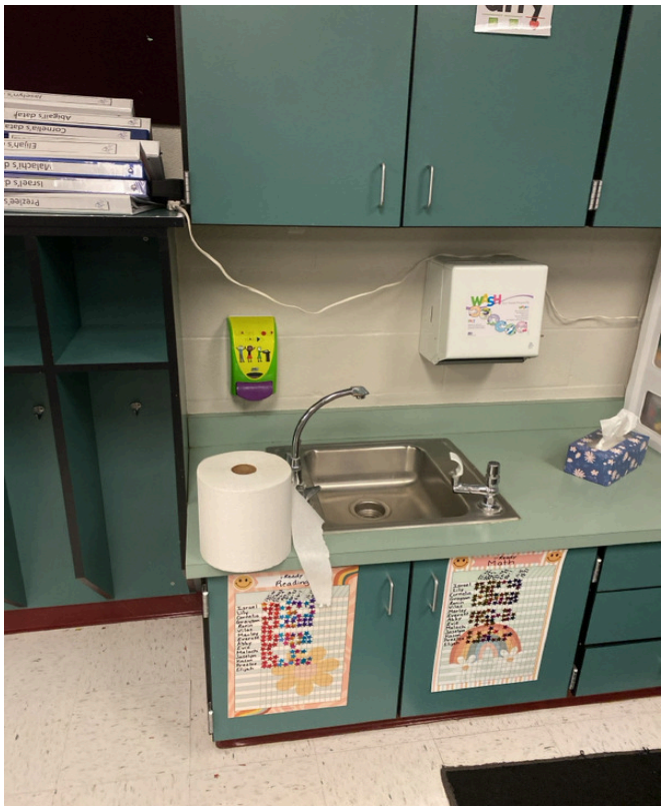

3/29/2024 - 425-129 - Lillian Schumaker - 001841-Room 109

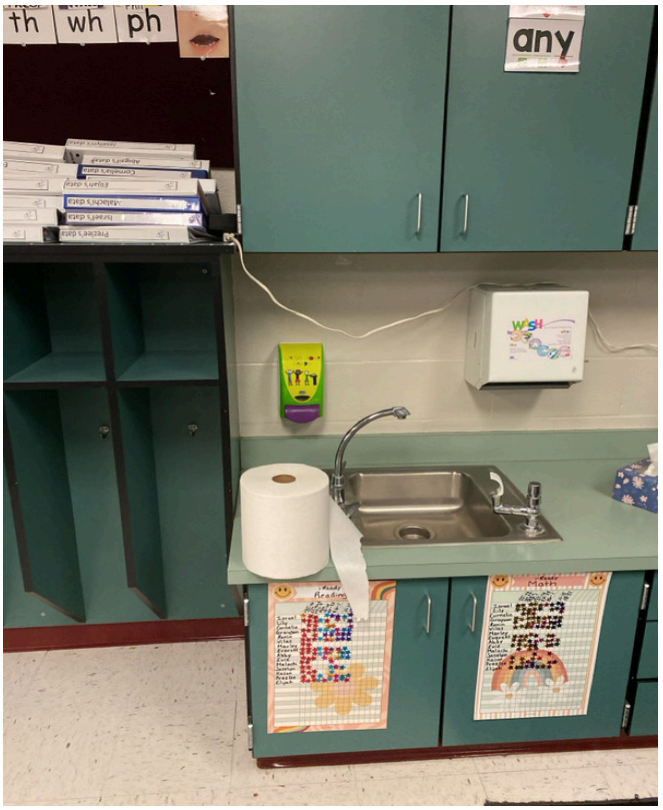


3/29/2024 - 425-130 - Lillian Schumaker - 001842-Room 109



3/29/2024 - 425-131 - Lillian Schumaker -002268-Room 109-Restroom




3/29/2024 - 425-132 - Lillian Schumaker - 001843-Room 107

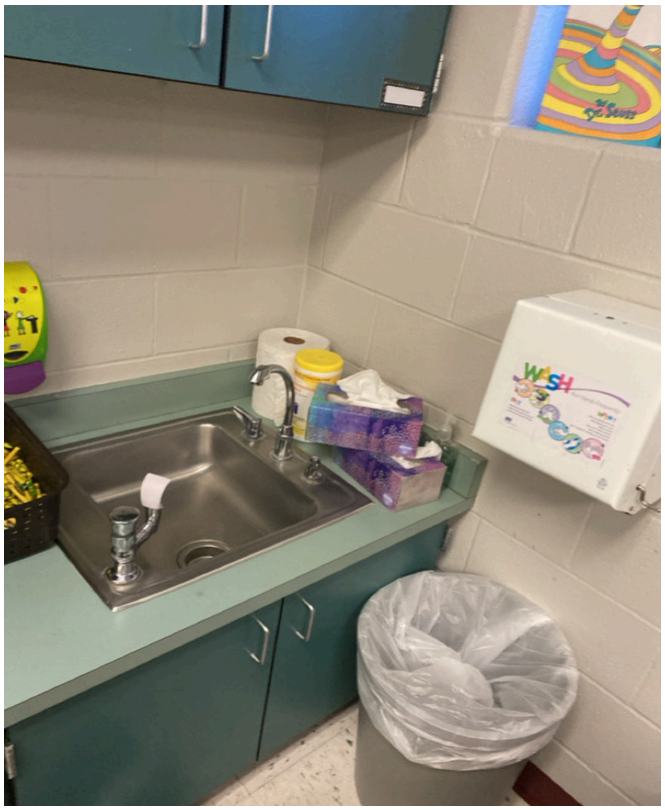

3/29/2024 - 425-133 - Lillian Schumaker - 001844-Room 107



3/29/2024 - 425-134 - Lillian Schumaker - 001845-Room 107

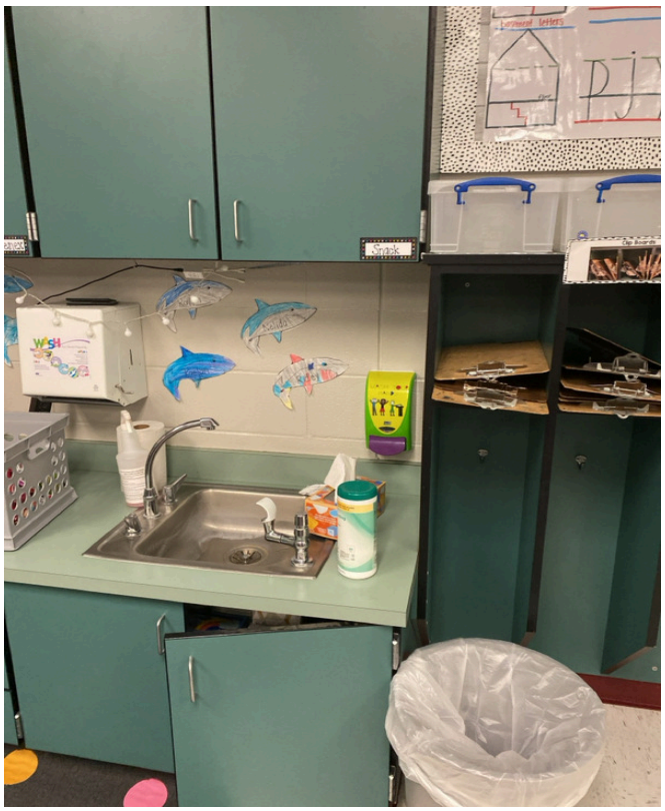

3/29/2024 - 425-135 - Lillian Schumaker - 001846-Room 107



3/29/2024 - 425-136 - Lillian Schumaker -001847-Room 107-Restroom



3/29/2024 - 425-137 - Lillian Schumaker - 001848-Room 105




3/29/2024 - 425-138 - Lillian Schumaker - 001849-Room 105



3/29/2024 - 425-139 - Lillian Schumaker - 001850-Room 103



3/29/2024 - 425-140 - Lillian Schumaker - 001851-Room 103

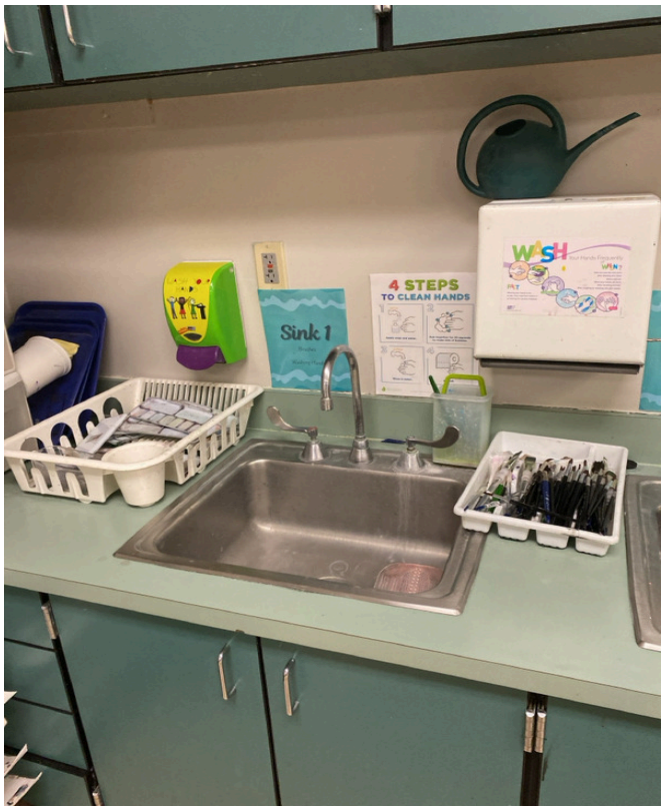


3/29/2024 - 425-141 - Lillian Schumaker - 001857-Room 102



3/29/2024 - 425-142 - Lillian Schumaker - 001858-Room 102



3/29/2024 - 425-143 - Lillian Schumaker - 001859-Room 102

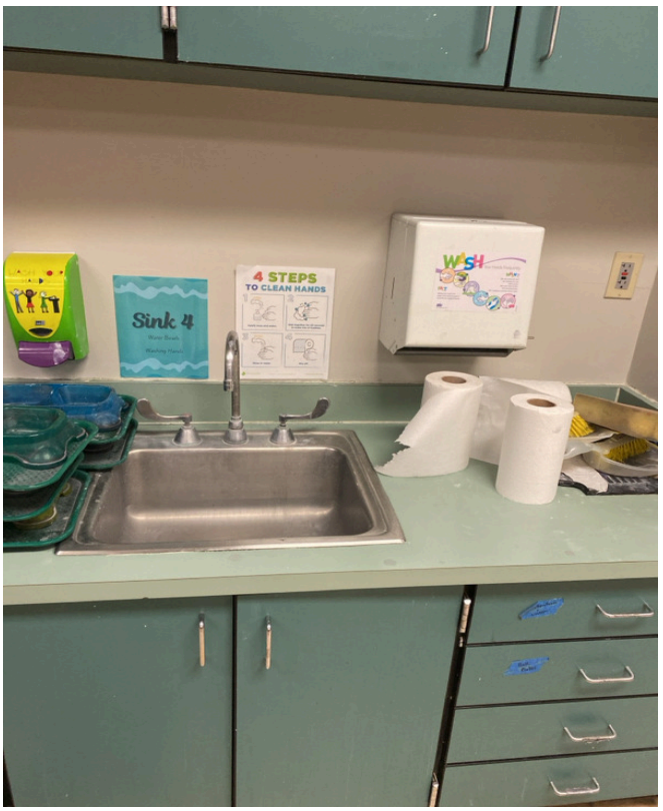

3/29/2024 - 425-144 - Lillian Schumaker - 001860-Room 102



3/29/2024 - 425-145 - Lillian Schumaker - 001856-By Gym



3/29/2024 - 425-146 - Lillian Schumaker - 001852-Gym-Boys



3/29/2024 - 425-147 - Lillian Schumaker - 001853-Gym-Boys



3/29/2024 - 425-148 - Lillian Schumaker - 001854-Gym-Girls



3/29/2024 - 425-149 - Lillian Schumaker - 001855-Gym-Girls



3/29/2024 - 425-150 - Lillian Schumaker - 002570B-Cafeteria



3/29/2024 - 425-151 - Lillian Schumaker - 002570F-Cafeteria



3/29/2024 - 425-152 - Lillian Schumaker - 001927-Kitchen



3/29/2024 - 425-153 - Lillian Schumaker - 001928-Kitchen



3/29/2024 - 425-154 - Lillian Schumaker - 001929-Kitchen



3/29/2024 - 425-155 - Lillian Schumaker - 001930-Kitchen



3/29/2024 - 425-156 - Lillian Schumaker - 004501-Kitchen



3/29/2024 - 425-157 - Lillian Schumaker - 004502-Kitchen



3/29/2024 - 425-158 - Lillian Schumaker - 004503-Kitchen



3/29/2024 - 425-159 - Lillian Schumaker - 004504-Kitchen



3/29/2024 - 425-160 - Lillian Schumaker - 004505-Kitchen



3/29/2024 - 425-161 - Lillian Schumaker - 004506-Kitchen



3/29/2024 - 425-162 - Lillian Schumaker - 004507-Kitchen



3/29/2024 - 425-163 - Lillian Schumaker - 004508-Kitchen



3/29/2024 - 425-164 - Lillian Schumaker - 004509-Kitchen



3/29/2024 - 425-165 - Lillian Schumaker - 004510-Kitchen



3/29/2024 - 425-166 - Lillian Schumaker - 000355-Kitchen



3/29/2024 - 425-167 - Lillian Schumaker - 000356-Kitchen



3/29/2024 - 425-168 - Lillian Schumaker - 004511-Kitchen Bathroom



3/29/2024 - 425-169 - Lillian Schumaker - 000950-Kitchen


Appendix E
Source Identification Diagram

ASP was provided sample locations by
Liberty School District

Second Floor

Lillian Schumacher Elementary
425 Claywoods Parkway
Liberty MO, 64068

Liberty PUBLIC SCHOOLS
Empowering Excellence

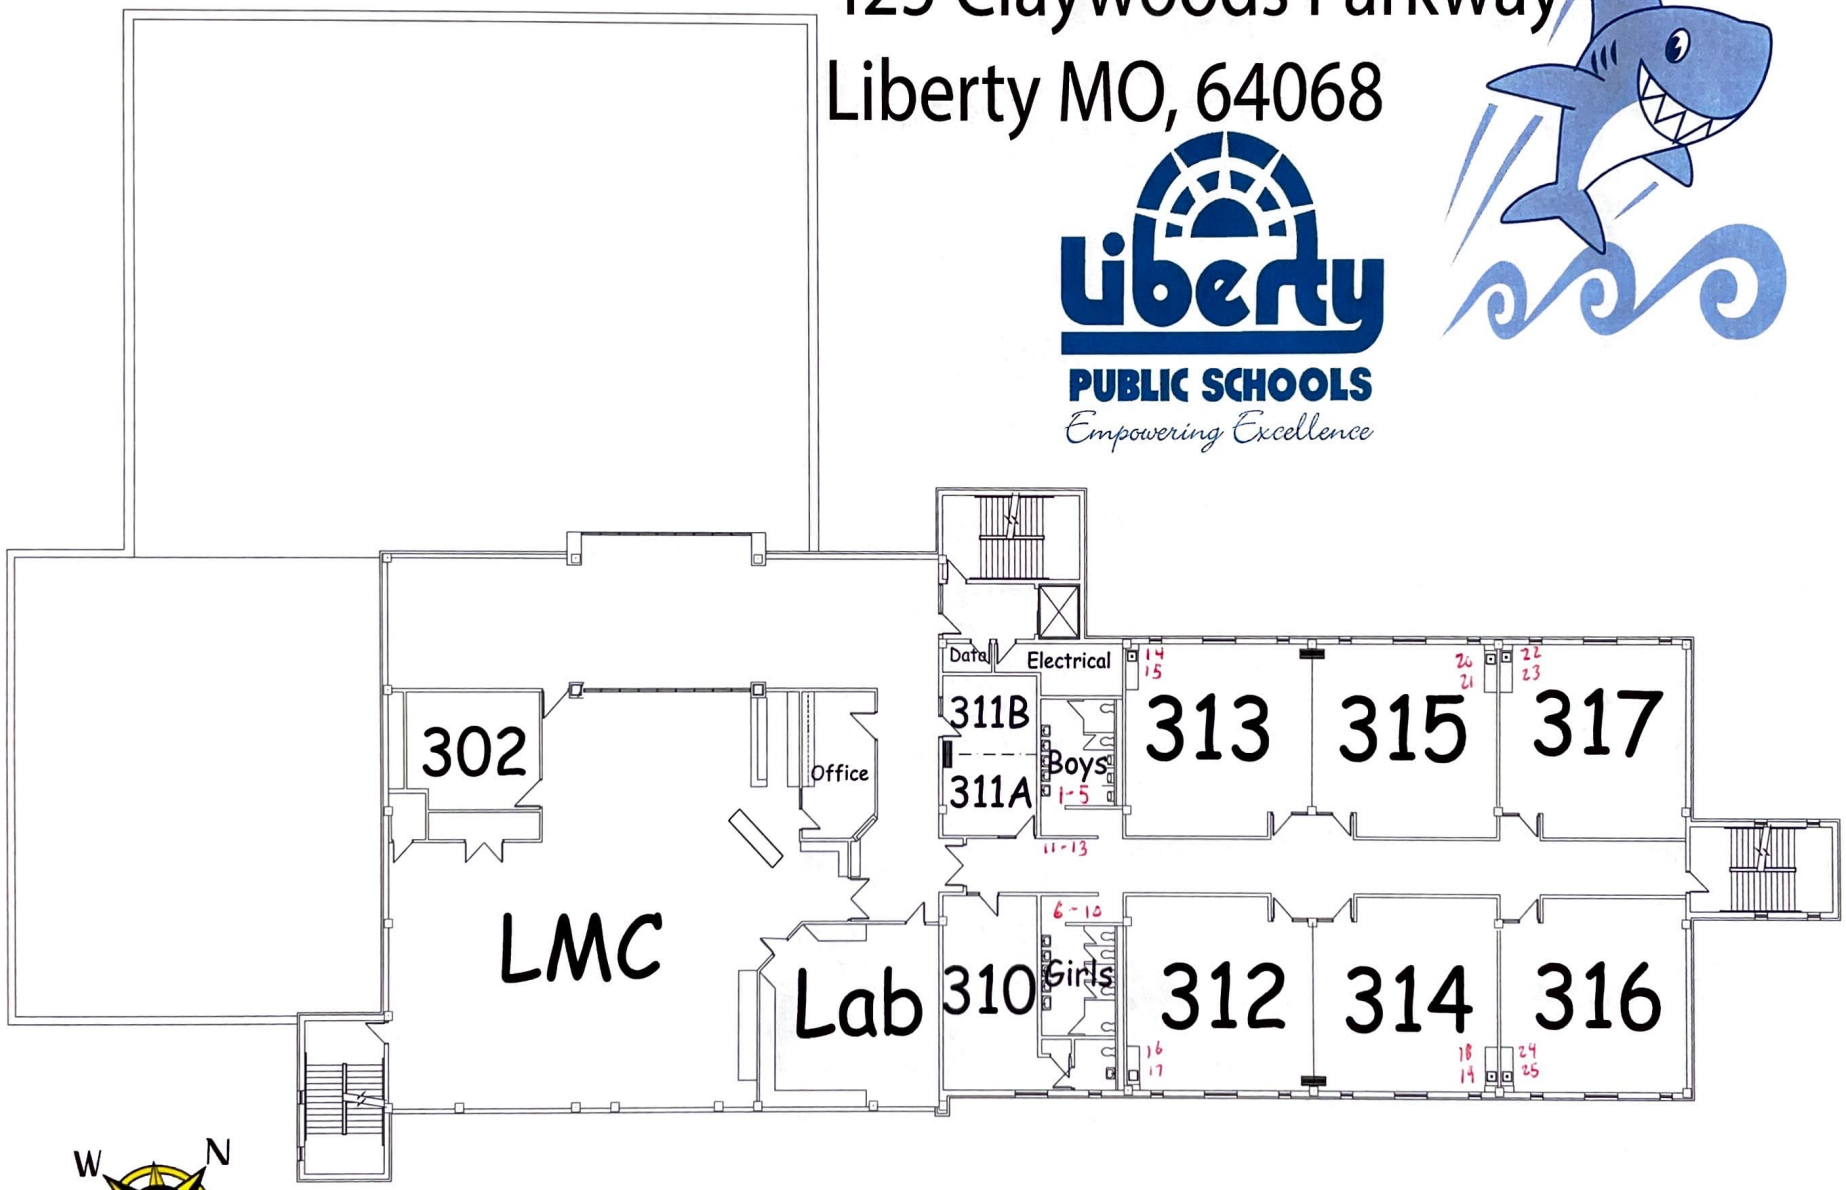


Map Design by: Curt Laven
Last Updated: 06/17/2021

First Floor

Lillian Schumacher Elementary
425 Claywoods Parkway
Liberty MO, 64068



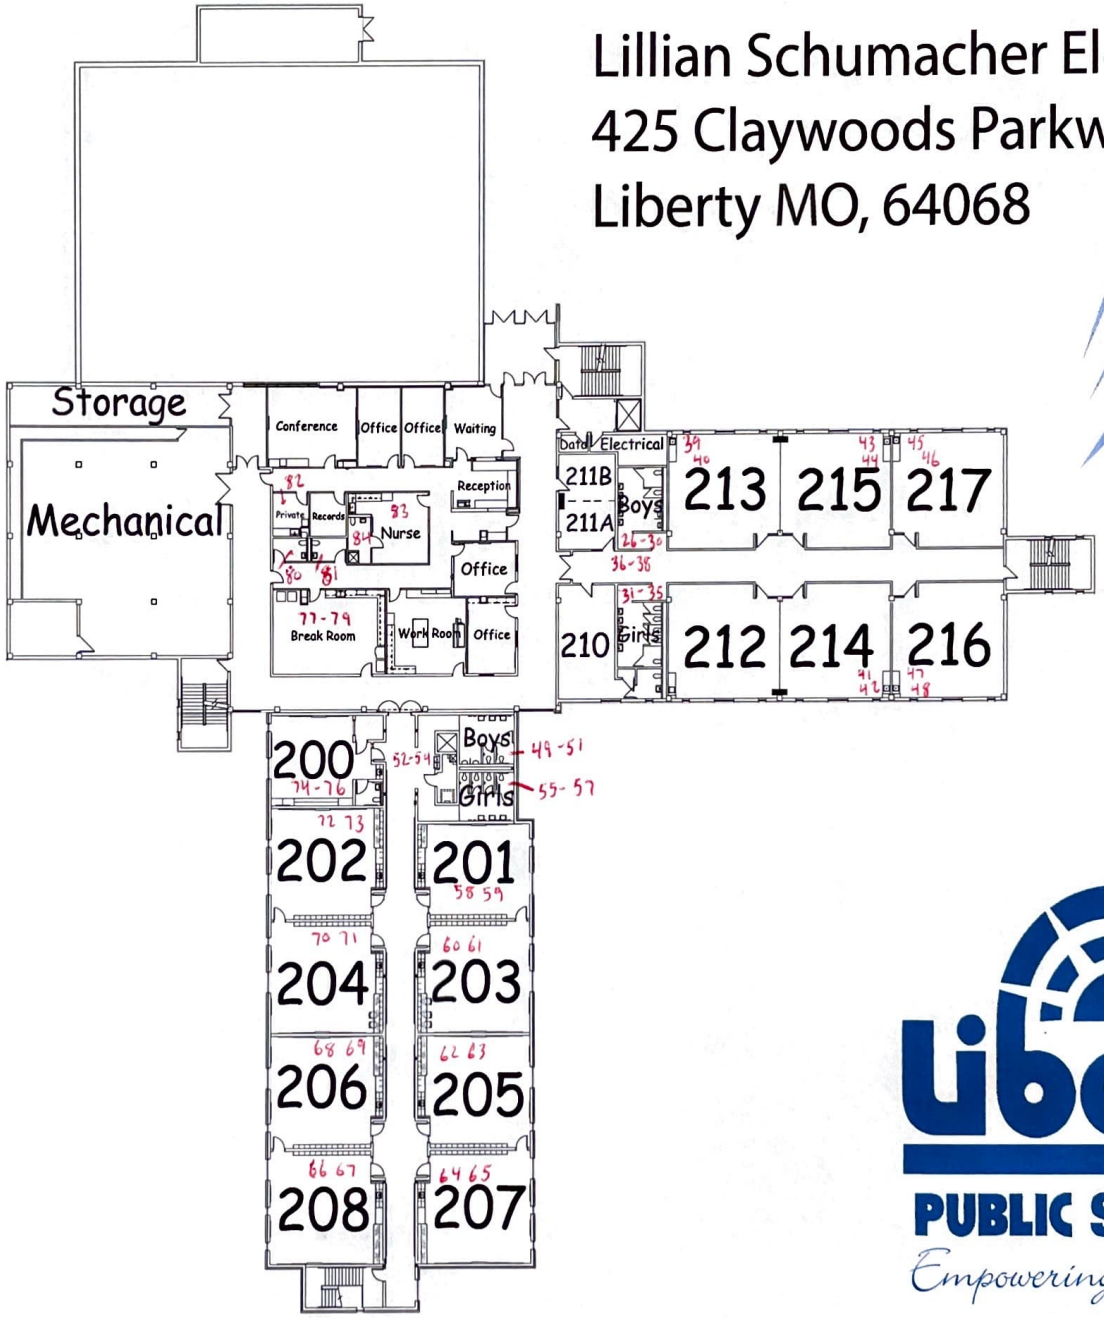



Map Design by: Curt Laven
Last Updated: 06/17/2021

Liberty PUBLIC SCHOOLS
Empowering Excellence

Ground Floor

Lillian Schumacher Elementary
425 Claywoods Parkway
Liberty MO, 64068



Liberty PUBLIC SCHOOLS
Empowering Excellence

Map Design by: Curt Laven
Last Updated: 06/17/2021