May 31, 2024

Steve Aldrich
Director of Facilities and Grounds
Liberty School District
801 Kent Street
Liberty, Missouri 64068

Project: Limited Lead in Drinking Water Testing
Address: 1000 Midjay Drive, Liberty, Missouri 64068

Mr. Steve Aldrich

On April 3, 2024 and April 30, 2024, Bradly Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 153 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of “lead free” to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of “lead free” as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: https://www.epa.gov/dwreginfo/lead-and-copper-rule

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.
Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school’s buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in red text.

April 3, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-1-FD	South Valley - 002120-Nurse's Office	Sink Tap	First Draw	1.8
1000-2-FD	South Valley - 002121-Nurse's Office	Bubbler	First Draw	2.7
1000-3-FD	South Valley - 002123-Nurse's Office	Sink Tap	First Draw	0.9
1000-4-FD	South Valley - 002122-Nurse's Office	Bubbler	First Draw	0.5
1000-5-FD	South Valley - 002124-Nurse's Office-Restroom	Sink Tap	First Draw	0.6
1000-6-FD	South Valley - 002125-Nurse's Office-Restroom	Sink Tap	First Draw	0.7
1000-7-FD	South Valley - 002126-Staff Workroom-Restroom	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-8-FD	South Valley - 002127-Lounge	Sink Tap	First Draw	0.5
1000-9-FD	South Valley - 002128-Lounge	Bubbler	First Draw	0.5
1000-10-FD	South Valley - 002129-Staff Workroom-Restroom	Sink Tap	First Draw	0.7
1000-11-FD	South Valley - 003113-Lounge	Ice Machine	First Draw	<0.4
1000-12-FD	South Valley - 002130-Room 200	Sink Tap	First Draw	1.9
1000-13-FD	South Valley - 002131-Room 200	Sink Tap	First Draw	<0.4
1000-14-FD	South Valley - 002134-Room 201	Sink Tap	First Draw	0.8
1000-15-FD	South Valley - 002135-Room 201	Bubbler	First Draw	0.4
1000-16-FD	South Valley - 002133-Room 202	Sink Tap	First Draw	1.1
1000-17-FD	South Valley - 002132-Room 202	Bubbler	First Draw	<0.4
1000-18-FD	South Valley - 002148-Room 208	Sink Tap	First Draw	1.8
1000-19-FD	South Valley - 002147-Room 208	Bubbler	First Draw	<0.4
1000-20-FD	South Valley - 002149-Room 210	Sink Tap	First Draw	1
1000-21-FD	South Valley - 002150-Room 210	Bubbler	First Draw	<0.4
1000-22-FD	South Valley - 002152-Room 209	Sink Tap	First Draw	0.8
1000-23-FD	South Valley - 002151-Room 209	Bubbler	First Draw	<0.4
1000-24-FD	South Valley - 002153-Room 211	Sink Tap	First Draw	0.7
1000-25-FD	South Valley - 002154-Room 211	Bubbler	First Draw	<0.4
1000-26-FD	South Valley - 002155-By 210-Boys	Sink Tap	First Draw	0.7
1000-27-FD	South Valley - 002156-By 210-Boys	Sink Tap	First Draw	0.8
1000-28-FD	South Valley - 002157-By 210-Boys-Right	Sink Tap	First Draw	<0.4
1000-29-FD	South Valley - 002158/3160-By 214-Girls	Sink Tap	First Draw	<0.4
1000-30-FD	South Valley - 002159-By 214-Girls	Sink Tap	First Draw	1
1000-31-FD	South Valley - 002160-By 214-Girls	Sink Tap	First Draw	0.6
1000-32-FD	South Valley - 002165-Room 213	Sink Tap	First Draw	1.2
1000-33-FD	South Valley - 002166-Room 213	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-34-FD	South Valley - 002168-Room 215	Sink Tap	First Draw	0.8
1000-35-FD	South Valley - 002167-Room 215	Bubbler	First Draw	<0.4
1000-36-FD	South Valley - 002161-Room 214	Sink Tap	First Draw	1.2
1000-37-FD	South Valley - 002162-Room 214	Bubbler	First Draw	<0.4
1000-38-FD	South Valley - 002164-Room 216	Sink Tap	First Draw	1
1000-39-FD	South Valley - 002163-Room 216	Bubbler	First Draw	<0.4
1000-40-FD	South Valley - 002183-Room 222	Sink Tap	First Draw	8.4
1000-41-FD	South Valley - 002182-Room 222	Bubbler	First Draw	<0.4
1000-42-FD	South Valley - 002184-Room 224	Sink Tap	First Draw	7.2
1000-43-	South Valley - 002185-Room 224 - Out Of Order	Bubbler	Not Tested	Not Sampled
1000-44-FD	South Valley - 002181-Room 225	Sink Tap	First Draw	1.6
1000-45-FD	South Valley - 002180-Room 225	Bubbler	First Draw	<0.4
1000-46-FD	South Valley - 002199-Room 227	Sink Tap	First Draw	1.3
1000-47-FD	South Valley - 002200-Room 227	Sink Tap	First Draw	0.9
1000-48-FD	South Valley - 002186-Room 318-Kitchen 1	Sink Tap	First Draw	1.5
1000-49-FD	South Valley - 002187-Room 318-Kitchen 2	Sink Tap	First Draw	1
1000-50-FD	South Valley - 002188-Room 318-Kitchen 3	Sink Tap	First Draw	1.1
1000-51-FD	South Valley - 002189-Room 318-Kitchen 4	Sink Tap	First Draw	1.4
1000-52-FD	South Valley - 002190-Room 318-Kitchen 5	Sink Tap	First Draw	1.2
1000-53-FD	South Valley - 002191-Room 318-Kitchen 6	Sink Tap	First Draw	1.2
1000-54-FD	South Valley - 002192-Room 316	Sink Tap	First Draw	0.7
1000-55-FD	South Valley - 002193-Room 316	Sink Tap	First Draw	1.6
1000-56-FD	South Valley - 002194-Room 316	Sink Tap	First Draw	3.6
1000-57-FD	South Valley - 002196-Room 314	Sink Tap	First Draw	0.9
1000-58-FD	South Valley - 002195-Room 314	Bubbler	First Draw	1.2
1000-59-FD	South Valley - 004701-By 314-Staff Restroom	Sink Tap	First Draw	0.7

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-60-FD	South Valley - 004702-By 314-Girls	Sink Tap	First Draw	0.4
1000-61-FD	South Valley - 004703-By 314-Girls	Sink Tap	First Draw	0.7
1000-62-FD	South Valley - 004704-By 314	Drinking Fountain	First Draw	<0.4
1000-63-FD	South Valley - 004705-By 313	Drinking Fountain	First Draw	<0.4
1000-64-FD	South Valley - 004706-By 313-Boys	Sink Tap	First Draw	1.6
1000-65-FD	South Valley - 004707-By 313-Boys	Sink Tap	First Draw	0.9
1000-66-FD	South Valley - 004708-By 313-Staff Restroom	Sink Tap	First Draw	0.7
1000-67-FD	South Valley - 004709-Room 317	Sink Tap	First Draw	0.7
1000-68-FD	South Valley - 004710-Room 317	Bubbler	First Draw	<0.4
1000-69-FD	South Valley - 003181F-Room 315	Sink Tap	First Draw	1
1000-70-FD	South Valley - 003181B-Room 315	Bubbler	First Draw	0.4
1000-71-FD	South Valley - 004714-Room 124	Sink Tap	First Draw	13.3
1000-72-FD	South Valley - 004715-Room 124	Bubbler	First Draw	<0.4
1000-73-FD	South Valley - 004719-Room 125	Sink Tap	First Draw	11.8
1000-74-FD	South Valley - 004718-Room 125	Bubbler	First Draw	<0.4
1000-75-FD	South Valley - 004716-Room 122	Sink Tap	First Draw	10.3
1000-76-FD	South Valley - 004717-Room 122	Bubbler	First Draw	<0.4
1000-77-FD	South Valley - 004731-Room 116	Sink Tap	First Draw	2.8
1000-78-FD	South Valley - 004732-Room 116	Bubbler	First Draw	<0.4
1000-79-FD	South Valley - 004733-Room 114	Sink Tap	First Draw	2.7
1000-80-FD	South Valley - 004734-Room 114	Bubbler	First Draw	<0.4
1000-81-FD	South Valley - 004737-Room 115	Sink Tap	First Draw	2.4
1000-82-FD	South Valley - 004738-Room 115	Bubbler	First Draw	<0.4
1000-83-FD	South Valley - 004735-Room 113	Sink Tap	First Draw	3.7
1000-84-FD	South Valley - 004736-Room 113	Bubbler	First Draw	1
1000-85-FD	South Valley - 004741-By 114-Girls	Sink Tap	First Draw	1

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-86-FD	South Valley - 004739-By 114-Girls	Sink Tap	First Draw	0.7
1000-87-FD	South Valley - 004740-By 114-Girls	Sink Tap	First Draw	0.7
1000-88-FD	South Valley - 004744-By 110-Boys	Sink Tap	First Draw	0.8
1000-89-FD	South Valley - 004743-By 110-Boys	Sink Tap	First Draw	1.2
1000-90-FD	South Valley - 004742-By 110-Boys	Sink Tap	First Draw	0.8
1000-91-FD	South Valley - 004745-Room 111	Sink Tap	First Draw	14
1000-92-FD	South Valley - 004746-Room 111	Bubbler	First Draw	0.8
1000-93-FD	South Valley - 004747-Room 109	Sink Tap	First Draw	16.1
1000-94-FD	South Valley - 004748-Room 109	Bubbler	First Draw	<0.4
1000-95-FD	South Valley - 004749-Room 110	Sink Tap	First Draw	3.6
1000-96-FD	South Valley - 004750-Room 110	Bubbler	First Draw	0.4
1000-97-FD	South Valley - 004751-Room 108	Sink Tap	First Draw	1.6
1000-98-FD	South Valley - 004752-Room 108	Bubbler	First Draw	0.9
1000-99-FD	South Valley - 004764-Room 102	Sink Tap	First Draw	2.1
1000-100-FD	South Valley - 004765-Room 102	Bubbler	First Draw	0.7
1000-101-FD	South Valley - 004768B-Room 100	Drinking Fountain	First Draw	<0.4
1000-102-FD	South Valley - 004768F-Room 100	Bottle Filler	First Draw	<0.4
1000-103-FD	South Valley - 004767-Room 101	Sink Tap	First Draw	1.8
1000-104-FD	South Valley - 004766-Room 101	Bubbler	First Draw	<0.4
1000-105-FD	South Valley - 004769-Library Workroom	Sink Tap	First Draw	2.4
1000-106-FD	South Valley - 004770-Library Workroom	Bubbler	First Draw	<0.4
1000-107-FD	South Valley - 004772B-Library	Drinking Fountain	First Draw	<0.4
1000-108-FD	South Valley - 004772F-Library	Bottle Filler	First Draw	<0.4
1000-109-FD	South Valley - 004771-Library	Sink Tap	First Draw	0.6
1000-110-FD	South Valley - 002198-Room 302	Sink Tap	First Draw	5
1000-111-FD	South Valley - 002197-Room 302	Bubbler	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-112-FD	South Valley - 003114-Gym-Restroom-Right	Sink Tap	First Draw	<0.4
1000-113-FD	South Valley - 003115-Gym-Restroom-Left	Sink Tap	First Draw	<0.4
1000-114-FD	South Valley - 002104-Gym-Left	Drinking Fountain	First Draw	<0.4
1000-115-FD	South Valley - 002105-Gym	Drinking Fountain	First Draw	<0.4
1000-116-FD	South Valley - 002106-Gym	Drinking Fountain	First Draw	<0.4
1000-117-FD	South Valley - 002107-Locker Room-Girls	Sink Tap	First Draw	0.9
1000-118-FD	South Valley - 002108-Locker Room-Girls	Sink Tap	First Draw	1.5
1000-119-FD	South Valley - 002109-Locker Room-Girls	Sink Tap	First Draw	1.2
1000-120-FD	South Valley - 002110-Girls Lockers-Coaches Office	Sink Tap	First Draw	0.5
1000-121-FD	South Valley - 002101-Locker Room-Boys	Sink Tap	First Draw	0.5
1000-122-FD	South Valley - 002102-Locker Room-Boys	Sink Tap	First Draw	2.2
1000-123-FD	South Valley - 002103-Boys Lockers-Office	Sink Tap	First Draw	<0.4
1000-124-FD	South Valley - 002117-Commons-Girls-Left	Sink Tap	First Draw	0.4
1000-125-FD	South Valley - 002118-Commons-Girls	Sink Tap	First Draw	0.7
1000-126-FD	South Valley - 002119-Commons-Girls	Sink Tap	First Draw	<0.4
1000-127-FD	South Valley - 002111-Commons-Boys	Sink Tap	First Draw	0.4
1000-128-FD	South Valley - 002112-Commons-Boys	Sink Tap	First Draw	0.6
1000-129-FD	South Valley - 002113-Commons-Boys	Sink Tap	First Draw	0.8
1000-130-FD	South Valley - 002114-Commons	Drinking Fountain	First Draw	<0.4
1000-131-FD	South Valley - 002115-Commons	Drinking Fountain	First Draw	<0.4
1000-132-FD	South Valley - 002116-Commons-Left	Drinking Fountain	First Draw	<0.4
1000-133-FD	South Valley - 002116B-Commons-Right	Drinking Fountain	First Draw	<0.4
1000-134-FD	South Valley - 002116F-Commons	Bottle Filler	First Draw	<0.4
1000-135-FD	South Valley - 004655-Kitchen-Handwashing By Dish Room	Sink Tap	First Draw	0.4
1000-136-FD	South Valley - 004656-Kitchen-Dishwasher Room	Sink Tap	First Draw	0.7
1000-137-FD	South Valley - 004657-Kitchen-Dishwasher Room	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-138-FD	South Valley - 004658-Kitchen-Three Bay Sink	Sink Tap	First Draw	0.4
1000-139-FD	South Valley - 004659-Kitchen-Three Bay Sink	Sink Tap	First Draw	1.7
1000-140-FD	South Valley - 004660-Kitchen-Three Bay Sink	Sink Tap	First Draw	4.5
1000-141-FD	South Valley - 004650-Kitchen-Handwashing By Air Hood	Sink Tap	First Draw	<0.4
1000-142-FD	South Valley - 004671-Kitchen-In Front Of Office	Sink Tap	First Draw	0.5
1000-143-FD	South Valley - 004672-Kitchen-In Front Of Office	Sink Tap	First Draw	0.8
1000-144-FD	South Valley - 004673-Kitchen-Next To Freezer	Sink Tap	First Draw	0.4
1000-145-FD	South Valley - 004674-Kitchen-Next To Freezer	Sink Tap	First Draw	<0.4
1000-146-FD	South Valley - 004675-Kitchen-Across From Oven	Sink Tap	First Draw	0.5
1000-147-FD	South Valley - 004676-Kitchen-Across From Oven	Sink Tap	First Draw	1
1000-148-FD	South Valley - 004677-Kitchen-Next To Fridge	Sink Tap	First Draw	5.3
1000-149-FD	South Valley - 004678-Kitchen-Restroom	Sink Tap	First Draw	0.4
1000-150-FD	South Valley - 004649-Kitchen-Handwashing By Oven	Sink Tap	First Draw	0.4
1000-151-FD	South Valley - 000105-Kitchen-Left	Pot Filler	First Draw	2
1000-152-FD	South Valley - 000106-Kitchen-Right	Pot Filler	First Draw	1.7
1000-153-FD	South Valley - 000545-Kitchen	Ice Machine	First Draw	3.5

April 30, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
1000-43-FD	South Valley - 002185-Room 224	Bubbler	First Draw	<0.4

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Short-Term Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Take immediate steps to prevent use from the failed source(s).
- Shut-off problem outlets
- Post “Not for Drinking/Cooking” at Problem Outlets. If initial sample results from an outlet(s) exceed the remediation trigger level, but are not routinely used for human ingestion (e.g., handwashing), clear signage can be posted to notify people that the outlet is not to be used for drinking or cooking until the problem is resolved.
- Consider performing follow-up flush testing in order to attempt to identify what component within the system is the source of the elevated lead concentration. This testing will assist to pinpoint where lead is getting into drinking water (i.e., fixtures versus interior plumbing) so that appropriate corrective measures can be taken.
- Shut-off or disconnection of problem outlets can provide a permanent solution. If the outlet is frequently used, this likely is not a practical long-term solution.
- Provide point-of-use (POU) filters at problem taps. Filters need routine maintenance (e.g., cartridge filter units need to be replaced periodically) to remain effective.

Permanent Control Measures

- Per the State of Missouri Senate Bills Nos. 681 & 662, a remediation plan should be developed and executed.
- Replacement of Problem Outlets and any identified upstream plumbing components (e.g., valves, leaded solder) to permanently address the problem. EPA's revised March 2015 guidance, How to Identify Lead-Free Certification Marks for Drinking Water System & Plumbing Products, can be a useful resource selecting leadfree plumbing.
- Provide point-of-use filters (POU) at problem taps as a long-term or permanent control measure. When doing this, facilities should be sure to create maintenance schedules and identify a point of contact to be in charge of making sure they are properly maintained.
- Reconfigure Plumbing. Ongoing renovation of school or childcare buildings may provide an opportunity to modify the plumbing system to redirect water supplied for drinking or cooking to bypass sources of lead contamination. Before undertaking such an alternative, be certain that you have properly identified all of the sources of lead contamination in drinking water.
- Remove and replace any drinking water coolers or drinking water outlets that the United States Environmental Protection Agency has determined are not lead-free under the federal Lead Contamination Control Act of 1988, as amended; except the school shall not be required to replace those drinking water outlets or water coolers that tested in accordance with state regulations and have been determined to be dispensing drinking water with a lead concentration less than five (5) part per billion (ppb); however, such drinking water outlet or water cooler shall be subject to all testing requirements and shall not be excluded from testing under subsection 10 of the Missouri Senate Bills Nos. 681 & 662, Section 160.077.
- Consider filtration of incoming water at the point of entry (POE) to the building.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
- The test results and a summary that explains such results;
- A description of any remedial steps taken; and
- A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A
Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date:	**10/4/2023**
Expiration Date:	**10/4/2025**
License Number:	**211004-300006201**

Paula F. Nickelson
Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



Paula F. Nickelson
Acting Director
t of Health and Senior Services

son City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.

- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

PO Box 47166 Kansas City, MO 64188 • 816-678-7894 • www.axiomservicepros.com

Appendix C
Laboratory Analytical Report

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HD0081

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 1000 Midjay Drive

Project / PO Number: 1000 Midjay Drive
Received: 04/05/2024
Reported: 04/29/2024

Analytical Testing Parameters

Client Sample ID: 1000-1-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-01
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1709	JAR

Client Sample ID: 1000-2-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-02
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1717	JAR

Client Sample ID: 1000-3-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-03
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:16

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/25/24 1332	04/26/24 1720	JAR

Client Sample ID: 1000-4-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-04
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1724	JAR

Client Sample ID: 1000-5-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-05
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/25/24 1332	04/26/24 1727	JAR

Client Sample ID: 1000-6-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-06
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1730	JAR

Client Sample ID: 1000-7-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-07
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1733	JAR

Client Sample ID: 1000-8-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-08
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1736	JAR

Client Sample ID: 1000-9-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-09
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/26/24 1739	JAR

CERTIFICATE OF ANALYSIS

3HD0081

Client Sample ID: 1000-10-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-10
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1753	JAR

Client Sample ID: 1000-11-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-11
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1803	JAR

Client Sample ID: 1000-12-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-12
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.9**	0.4	ppb	2		04/25/24 1332	04/26/24 1806	JAR

Client Sample ID: 1000-13-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-13
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1809	JAR

Client Sample ID: 1000-14-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-14
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1812	JAR

CERTIFICATE OF ANALYSIS

3HD0081

Client Sample ID: 1000-15-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-15
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/26/24 1815	JAR

Client Sample ID: 1000-16-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-16
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/25/24 1332	04/26/24 1818	JAR

Client Sample ID: 1000-17-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-17
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1821	JAR

Client Sample ID: 1000-18-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-18
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1830	JAR

Client Sample ID: 1000-19-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-19
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:23

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1833	JAR

Client Sample ID: 1000-20-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-20
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1332	04/26/24 1836	JAR

Client Sample ID: 1000-21-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-21
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1839	JAR

Client Sample ID: 1000-22-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-22
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1842	JAR

Client Sample ID: 1000-23-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-23
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1845	JAR

Client Sample ID: 1000-24-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-24
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1848	JAR

Client Sample ID: 1000-25-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-25
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1851	JAR

Client Sample ID: 1000-26-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-26
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 1854	JAR

Client Sample ID: 1000-27-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-27
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1857	JAR

Client Sample ID: 1000-28-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-28
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:29

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1906	JAR

Client Sample ID: 1000-29-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-29
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1909	JAR

Client Sample ID: 1000-30-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-30
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1332	04/26/24 1918	JAR

Client Sample ID: 1000-31-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-31
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/25/24 1332	04/26/24 1927	JAR

Client Sample ID: 1000-32-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-32
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 1930	JAR

Client Sample ID: 1000-33-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-33
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1933	JAR

Client Sample ID: 1000-34-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-34
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/26/24 1942	JAR

Client Sample ID: 1000-35-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-35
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1945	JAR

Client Sample ID: 1000-36-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-36
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 1948	JAR

Client Sample ID: 1000-37-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-37
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:34

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1951	JAR

Client Sample ID: 1000-38-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-38
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1332	04/26/24 1954	JAR

Client Sample ID: 1000-39-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-39
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 1957	JAR

Client Sample ID: 1000-40-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-40
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**8.4**	0.4	ppb	2		04/25/24 1332	04/26/24 2000	JAR

Client Sample ID: 1000-41-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-41
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2003	JAR

Client Sample ID: 1000-42-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-42
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**7.2**	0.4	ppb	2		04/25/24 1332	04/26/24 2006	JAR

Client Sample ID: 1000-44-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-43
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/25/24 1332	04/26/24 2009	JAR

Client Sample ID: 1000-45-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-44
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2018	JAR

Client Sample ID: 1000-46-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-45
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.3**	0.4	ppb	2		04/25/24 1332	04/26/24 2021	JAR

Client Sample ID: 1000-47-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-46
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/25/24 1332	04/26/24 2024	JAR

Client Sample ID: 1000-48-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-47
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/25/24 1332	04/26/24 2027	JAR

Client Sample ID: 1000-49-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-48
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1332	04/26/24 2030	JAR

Client Sample ID: 1000-50-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-49
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.1**	0.4	ppb	2		04/25/24 1332	04/26/24 2033	JAR

Client Sample ID: 1000-51-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-50
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.4**	0.4	ppb	2		04/25/24 1332	04/26/24 2042	JAR

Client Sample ID: 1000-52-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-51
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 2057	JAR

Client Sample ID: 1000-53-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-52
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 2100	JAR

Client Sample ID: 1000-54-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-53
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 2103	JAR

Client Sample ID: 1000-55-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-54
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/25/24 1332	04/26/24 2106	JAR

Client Sample ID: 1000-56-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-55
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.6**	0.4	ppb	2		04/25/24 1332	04/26/24 2109	JAR

Client Sample ID: 1000-57-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-56
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/25/24 1332	04/26/24 2112	JAR

Client Sample ID: 1000-58-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-57
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:47

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 2114	JAR

Client Sample ID: 1000-59-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-58
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 2117	JAR

Client Sample ID: 1000-60-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-59
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/26/24 2120	JAR

CERTIFICATE OF ANALYSIS

3HD0081

Client Sample ID:	1000-61-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0081-60	**Collection Date:**	04/03/2024 22:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 2129	JAR

Client Sample ID:	1000-62-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0081-61	**Collection Date:**	04/03/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2132	JAR

Client Sample ID:	1000-63-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0081-62	**Collection Date:**	04/03/2024 22:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2135	JAR

Client Sample ID:	1000-64-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0081-63	**Collection Date:**	04/03/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/25/24 1332	04/26/24 2138	JAR

Client Sample ID:	1000-65-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0081-64	**Collection Date:**	04/03/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/25/24 1332	04/26/24 2141	JAR

Client Sample ID: 1000-66-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-65
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 2144	JAR

Client Sample ID: 1000-67-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-66
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 2147	JAR

Client Sample ID: 1000-68-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-67
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2150	JAR

Client Sample ID: 1000-69-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-68
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1332	04/26/24 2153	JAR

Client Sample ID: 1000-70-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-69
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/26/24 2156	JAR

Client Sample ID: 1000-71-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-70
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**13.3**	0.4	ppb	2		04/25/24 1332	04/26/24 2211	JAR

Client Sample ID: 1000-72-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-71
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:58

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2220	JAR

Client Sample ID: 1000-73-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-72
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**11.8**	0.4	ppb	2		04/25/24 1332	04/26/24 2223	JAR

Client Sample ID: 1000-74-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-73
Collected By: Young, Bradly
Collection Date: 04/03/2024 22:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2226	JAR

Client Sample ID: 1000-75-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-74
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**10.3**	0.4	ppb	2		04/25/24 1332	04/26/24 2229	JAR

Client Sample ID: 1000-76-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-75
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2232	JAR

Client Sample ID: 1000-77-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-76
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:02

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.8**	0.4	ppb	2		04/25/24 1332	04/26/24 2241	JAR

Client Sample ID: 1000-78-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-77
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2244	JAR

Client Sample ID: 1000-79-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-78
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.7**	0.4	ppb	2		04/25/24 1332	04/26/24 2247	JAR

Client Sample ID: 1000-80-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-79
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2250	JAR

Client Sample ID: 1000-81-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-80
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/25/24 1332	04/26/24 2253	JAR

Client Sample ID: 1000-82-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-81
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2256	JAR

Client Sample ID: 1000-83-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-82
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.7**	0.4	ppb	2		04/25/24 1332	04/26/24 2259	JAR

Client Sample ID: 1000-84-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-83
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:04

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1332	04/26/24 2302	JAR

Client Sample ID: 1000-85-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-84
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1332	04/26/24 2305	JAR

Client Sample ID: 1000-86-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-85
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 2308	JAR

Client Sample ID: 1000-87-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-86
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:06

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/26/24 2317	JAR

Client Sample ID: 1000-88-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-87
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/26/24 2320	JAR

Client Sample ID: 1000-89-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-88
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/26/24 2323	JAR

Client Sample ID: 1000-90-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-89
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/26/24 2326	JAR

Client Sample ID: 1000-91-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-90
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**14.0**	0.4	ppb	2		04/25/24 1332	04/26/24 2335	JAR

Client Sample ID: 1000-92-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-91
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/26/24 2344	JAR

Client Sample ID: 1000-93-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-92
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**16.1**	0.4	ppb	2		04/25/24 1332	04/26/24 2352	JAR

Client Sample ID: 1000-94-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-93
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:09

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/26/24 2355	JAR

Client Sample ID: 1000-95-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-94
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.6**	0.4	ppb	2		04/25/24 1332	04/26/24 2358	JAR

Client Sample ID: 1000-96-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-95
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/27/24 0001	JAR

Client Sample ID: 1000-97-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-96
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.6**	0.4	ppb	2		04/25/24 1332	04/27/24 0004	JAR

Client Sample ID: 1000-98-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-97
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:11

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/25/24 1332	04/27/24 0007	JAR

Client Sample ID: 1000-99-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-98
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.1**	0.4	ppb	2		04/25/24 1332	04/27/24 0010	JAR

Client Sample ID: 1000-100-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-99
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/27/24 0014	JAR

Client Sample ID: 1000-101-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AA
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:13

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0016	JAR

Client Sample ID: 1000-102-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AB
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0020	JAR

Client Sample ID: 1000-103-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AC
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.8**	0.4	ppb	2		04/25/24 1332	04/27/24 0028	JAR

Client Sample ID: 1000-104-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AD
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:14

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0031	JAR

Client Sample ID: 1000-105-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AE
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.4**	0.4	ppb	2		04/25/24 1332	04/27/24 0034	JAR

Client Sample ID: 1000-106-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AF
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0037	JAR

Client Sample ID: 1000-107-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AG
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:17

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0040	JAR

Client Sample ID: 1000-108-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AH
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0043	JAR

Client Sample ID: 1000-109-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AI
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/25/24 1332	04/27/24 0046	JAR

Client Sample ID: 1000-110-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AJ
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**5.0**	0.4	ppb	2		04/25/24 1332	04/27/24 0049	JAR

Client Sample ID: 1000-111-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AK
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0104	JAR

Client Sample ID: 1000-112-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AL
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0113	JAR

Client Sample ID: 1000-113-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AM
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0116	JAR

Client Sample ID: 1000-114-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AN
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0119	JAR

Client Sample ID: 1000-115-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AO
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0122	JAR

Client Sample ID: 1000-116-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AP
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0125	JAR

Client Sample ID: 1000-117-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AQ
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.9**	0.4	ppb	2		04/25/24 1332	04/27/24 0128	JAR

Client Sample ID: 1000-118-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AR
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.5**	0.4	ppb	2		04/25/24 1332	04/27/24 0131	JAR

Client Sample ID: 1000-119-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AS
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.2**	0.4	ppb	2		04/25/24 1332	04/27/24 0140	JAR

Client Sample ID: 1000-120-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AT
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/27/24 0143	JAR

Client Sample ID: 1000-121-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AU
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/27/24 0146	JAR

Client Sample ID: 1000-122-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AV
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:26

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.2**	0.4	ppb	2		04/25/24 1332	04/27/24 0149	JAR

Client Sample ID: 1000-123-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AW
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0152	JAR

Client Sample ID: 1000-124-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AX
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/27/24 0155	JAR

Client Sample ID: 1000-125-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AY
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/27/24 0158	JAR

Client Sample ID: 1000-126-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-AZ
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0201	JAR

Client Sample ID: 1000-127-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BA
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/27/24 0204	JAR

Client Sample ID: 1000-128-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BB
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.6**	0.4	ppb	2		04/25/24 1332	04/27/24 0207	JAR

Client Sample ID: 1000-129-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BC
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/27/24 0216	JAR

Client Sample ID: 1000-130-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BD
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0219	JAR

Client Sample ID: 1000-131-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BE
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0228	JAR

Client Sample ID: 1000-132-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BF
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0237	JAR

Client Sample ID: 1000-133-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BG
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0241	JAR

Client Sample ID: 1000-134-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BH
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0244	JAR

Client Sample ID: 1000-135-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BI
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/27/24 0252	JAR

Client Sample ID: 1000-136-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BJ
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.7**	0.4	ppb	2		04/25/24 1332	04/27/24 0255	JAR

Client Sample ID: 1000-137-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BK
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:36

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0258	JAR

Client Sample ID: 1000-138-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BL
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/27/24 0301	JAR

Client Sample ID: 1000-139-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BM
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.7**	0.4	ppb	2		04/25/24 1332	04/27/24 0304	JAR

Client Sample ID: 1000-140-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BN
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:38

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**4.5**	0.4	ppb	2		04/25/24 1332	04/27/24 0307	JAR

Client Sample ID: 1000-141-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BO
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:39

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0311	JAR

Client Sample ID: 1000-142-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BP
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1332	04/27/24 0314	JAR

Client Sample ID: 1000-143-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BQ
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.8**	0.4	ppb	2		04/25/24 1332	04/27/24 0317	JAR

Client Sample ID: 1000-144-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BR
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1332	04/27/24 0320	JAR

Client Sample ID: 1000-145-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BS
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		04/25/24 1332	04/27/24 0328	JAR

Client Sample ID: 1000-146-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BT
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.5**	0.4	ppb	2		04/25/24 1401	04/27/24 1001	JAR

Client Sample ID: 1000-147-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BU
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.0**	0.4	ppb	2		04/25/24 1401	04/27/24 1010	JAR

Client Sample ID: 1000-148-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BV
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**5.3**	0.4	ppb	2		04/25/24 1401	04/27/24 1013	JAR

Client Sample ID: 1000-149-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BW
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:42

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1401	04/27/24 1016	JAR

Client Sample ID: 1000-150-FD
Sample Matrix: Drinking Water
Lab Sample ID: 3HD0081-BX
Collected By: Young, Bradly
Collection Date: 04/03/2024 23:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**0.4**	0.4	ppb	2		04/25/24 1401	04/27/24 1025	JAR

Client Sample ID:	1000-151-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0081-BY	**Collection Date:**	04/03/2024 23:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**2.0**	0.4	ppb	2		04/25/24 1401	04/27/24 1028	JAR

Client Sample ID:	1000-152-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0081-BZ	**Collection Date:**	04/03/2024 23:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**1.7**	0.4	ppb	2		04/25/24 1401	04/27/24 1031	JAR

Client Sample ID:	1000-153-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HD0081-CA	**Collection Date:**	04/03/2024 23:45

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	**3.5**	0.4	ppb	2		04/25/24 1401	04/27/24 1034	JAR

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
04/29/24 11:51

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

3HD0081 AXIOM Service Professionals
04/26/24 17:00 Carolyn Jackson DW
Lead Analysis $26
1000 Midjay Drive A = N S

Cooler ID: BOX
Custody Seal: —
IR Gun # 8
Delivered By: UPS / Fed Ex / Spee Dee / Mail
Walk-in / Via / Courier / Other:_____
Packing material: Bubble/ Foam/ Paper/Other

DW Coding Verified:_____

DW Data to SDWIS: ☐

Sample Receipt Discrepancies: O No O Yes (if Yes, see detail below)

O Container Problems:	O COC Problems
O Label Absent	O Chain of Custody not present
O Incorrect Containers for tests indicated	O Chain of Custody not present: Info obtained from PO or Letter
O Insufficient amount of sample for tests indicated	O COC missing time sampled, time obtained from sample container.
O Broken or leaking containers: _____	O COC missing date sampled, date obtained from sample container .
O Air bubbles in VOA vials:_____	O Sample excluded from COC:_____
O Analyses outside of hold: _____	O Sample listed on COC not received: _____
	O Sample description on container different from COC: _____

Detailed Description/comments: 3 COOLERS . 14.9° 14.8° 15.3°

Client contacted regarding cooler/sample receipt conditions: Yes / No Contacted by_____Date/Time:_____

Who was contacted:_____Remarks: See Comments on Element WO page



Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Bradly Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-1-FD	4/3/2024	22:16	South Valley - Sink Tap - 002120-Nurse Office	1	Wt	Grab	X								01
1000-2-FD	4/3/2024	22:16	South Valley - Bubbler - 002121-Nurse Office	1	Wt	Grab	X								02
1000-3-FD	4/3/2024	22:16	South Valley - Sink Tap - 002123-Nurse Office	1	Wt	Grab	X								03
1000-4-FD	4/3/2024	22:17	South Valley - Bubbler - 002122-Nurse Office	1	Wt	Grab	X								04
1000-5-FD	4/3/2024	22:17	South Valley - Sink Tap - 002124-Nurse Office-Bathroom	1	Wt	Grab	X								05
1000-6-FD	4/3/2024	22:17	South Valley - Sink Tap - 002125-Nurse Office-Bathroom	1	Wt	Grab	X								06
1000-7-FD	4/3/2024	22:18	South Valley - Sink Tap - 002126-Staff Workroom-Bathroom	1	Wt	Grab	X								07

LAB USE ONLY: Wk Order #: 3HD0081; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date: 4/5/24		
	Time:		Sue Thompson	Time: 1000		

3 H D 0 0 8 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-8-FD	4/3/2024	22:18	South Valley - Sink Tap - 002127-Lounge	1	Wt	Grab	X								08
1000-9-FD	4/3/2024	22:18	South Valley - Bubbler - 002128-Lounge	1	Wt	Grab	X								09
1000-10-FD	4/3/2024	22:19	South Valley - Sink Tap - 002129-Staff Workroom-Bathroom	1	Wt	Grab	X								10
1000-11-FD	4/3/2024	22:19	South Valley - Ice Machine - 003113-Lounge	1	Wt	Grab	X								11
1000-12-FD	4/3/2024	22:20	South Valley - Sink Tap - 002130-Room 200	1	Wt	Grab	X								12
1000-13-FD	4/3/2024	22:20	South Valley - Sink Tap - 002131-Room 200	1	Wt	Grab	X								13
1000-14-FD	4/3/2024	22:20	South Valley - Sink Tap - 002134-Room 201	1	Wt	Grab	X								14

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-15-FD	4/3/2024	22:21	South Valley - Bubbler - 002135-Room 201	1	Wt	Grab	X								15
1000-16-FD	4/3/2024	22:21	South Valley - Sink Tap - 002133-Room 202	1	Wt	Grab	X								16
1000-17-FD	4/3/2024	22:22	South Valley - Bubbler - 002132-Room 202	1	Wt	Grab	X								17
1000-18-FD	4/3/2024	22:23	South Valley - Sink Tap - 002148-Room 208	1	Wt	Grab	X								18
1000-19-FD	4/3/2024	22:23	South Valley - Bubbler - 002147-Room 208	1	Wt	Grab	X								19
1000-20-FD	4/3/2024	22:24	South Valley - Sink Tap - 002149-Room 210	1	Wt	Grab	X								20
1000-21-FD	4/3/2024	22:24	South Valley - Bubbler - 002150-Room 210	1	Wt	Grab	X								21

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-22-FD	4/3/2024	22:26	South Valley - Sink Tap - 002152-Room 209	1	Wt	Grab	X								22
1000-23-FD	4/3/2024	22:26	South Valley - Bubbler - 002151-Room 209	1	Wt	Grab	X								23
1000-24-FD	4/3/2024	22:27	South Valley - Sink Tap - 002153-Room 211	1	Wt	Grab	X								24
1000-25-FD	4/3/2024	22:27	South Valley - Bubbler - 002154-Room 211	1	Wt	Grab	X								25
1000-26-FD	4/3/2024	22:29	South Valley - Sink Tap - 002155-By 210-Boys	1	Wt	Grab	X								26
1000-27-FD	4/3/2024	22:29	South Valley - Sink Tap - 002156-By 210-Boys	1	Wt	Grab	X								27
1000-28-FD	4/3/2024	22:29	South Valley - Sink Tap - 002157-By 210-Boys-Right	1	Wt	Grab	X								28

LAB USE ONLY
Wk Order #: 3H20081
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3 H D 0 0 8 1
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HD0081
														Short Hold:	
														Rush:	
														Temp: oC	
1000-29-FD	4/3/2024	22:30	South Valley - Sink Tap - 002158/3160-By 214-Girls	1	Wt	Grab	X								29
1000-30-FD	4/3/2024	22:30	South Valley - Sink Tap - 002159-By 214-Girls	1	Wt	Grab	X								30
1000-31-FD	4/3/2024	22:30	South Valley - Sink Tap - 002160-By 214-Girls	1	Wt	Grab	X								31
1000-32-FD	4/3/2024	22:32	South Valley - Sink Tap - 002165-Room 213	1	Wt	Grab	X								32
1000-33-FD	4/3/2024	22:32	South Valley - Bubbler - 002166-Room 213	1	Wt	Grab	X								33
1000-34-FD	4/3/2024	22:33	South Valley - Sink Tap - 002168-Room 215	1	Wt	Grab	X								34
1000-35-FD	4/3/2024	22:33	South Valley - Bubbler - 002167-Room 215	1	Wt	Grab	X								35

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD00081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-36-FD	4/3/2024	22:34	South Valley - Sink Tap - 002161-Room 214	1	Wt	Grab	X								36
1000-37-FD	4/3/2024	22:34	South Valley - Bubbler - 002162-Room 214	1	Wt	Grab	X								37
1000-38-FD	4/3/2024	22:36	South Valley - Sink Tap - 002164-Room 216	1	Wt	Grab	X								38
1000-39-FD	4/3/2024	22:36	South Valley - Bubbler - 002163-Room 216	1	Wt	Grab	X								39
1000-40-FD	4/3/2024	22:38	South Valley - Sink Tap - 002183-Room 222	1	Wt	Grab	X								40
1000-41-FD	4/3/2024	22:38	South Valley - Bubbler - 002182-Room 222	1	Wt	Grab	X								41
1000-42-FD	4/3/2024	22:39	South Valley - Sink Tap - 002184-Room 224	1	Wt	Grab	X								42

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date: 4/5/24		
	Time:		Sue Thompson	Time: 1000		

3HD00081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S Newton, IA 50208 Phone: 641-792-8451	___ 3012 Ansborough Ave Waterloo, IA 50701 Phone: 319-235-4440	X 835 S St. Paul Kansas City, KS 66105 Phone: 913-321-7856	___ 205 E Van Buren St Centerville, IA 52544 Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-44-FD	4/3/2024	22:41	South Valley - Sink Tap - 002181-Room 225	1	Wt	Grab	X								43
1000-45-FD	4/3/2024	22:41	South Valley - Bubbler - 002180-Room 225	1	Wt	Grab	X								44
1000-46-FD	4/3/2024	22:41	South Valley - Sink Tap - 002199-Room 227	1	Wt	Grab	X								45
1000-47-FD	4/3/2024	22:41	South Valley - Sink Tap - 002200-Room 227	1	Wt	Grab	X								46
1000-48-FD	4/3/2024	22:43	South Valley - Sink Tap - 002186-Room 318-Kitchen 1	1	Wt	Grab	X								47
1000-49-FD	4/3/2024	22:43	South Valley - Sink Tap - 002187-Room 318-Kitchen 2	1	Wt	Grab	X								48
1000-50-FD	4/3/2024	22:43	South Valley - Sink Tap - 002188-Room 318-Kitchen 3	1	Wt	Grab	X								49

LAB USE ONLY
Wk Order #: 3HD0081
Short Hold:
Rush:
Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
			Sue Thompson	4/5/24		
	Time:			Time:		
				1000		

3 H D 0 0 8 1
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HD0081
														Short Hold:	
														Rush:	
														Temp: oC	
1000-51-FD	4/3/2024	22:43	South Valley - Sink Tap - 002189-Room 318-Kitchen 4	1	Wt	Grab	X								S0
1000-52-FD	4/3/2024	22:44	South Valley - Sink Tap - 002190-Room 318-Kitchen 5	1	Wt	Grab	X								S1
1000-53-FD	4/3/2024	22:44	South Valley - Sink Tap - 002191-Room 318-Kitchen 6	1	Wt	Grab	X								S2
1000-54-FD	4/3/2024	22:45	South Valley - Sink Tap - 002192-Room 316	1	Wt	Grab	X								S3
1000-55-FD	4/3/2024	22:45	South Valley - Sink Tap - 002193-Room 316	1	Wt	Grab	X								S4
1000-56-FD	4/3/2024	22:45	South Valley - Sink Tap - 002194-Room 316	1	Wt	Grab	X								S5
1000-57-FD	4/3/2024	22:47	South Valley - Sink Tap - 002196-Room 314	1	Wt	Grab	X								S6

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sara Thompson	Time:	1000	
	Time:					

3HD0081

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-58-FD	4/3/2024	22:47	South Valley - Bubbler - 002195-Room 314	1	Wt	Grab	X								57
1000-59-FD	4/3/2024	22:48	South Valley - Sink Tap - 004701-By 314-Staff Bathroom	1	Wt	Grab	X								58
1000-60-FD	4/3/2024	22:50	South Valley - Sink Tap - 004702-By 314-Girls	1	Wt	Grab	X								59
1000-61-FD	4/3/2024	22:50	South Valley - Sink Tap - 004703-By 314-Girls	1	Wt	Grab	X								60
1000-62-FD	4/3/2024	22:51	South Valley - Drinking Fountain - 004704-By 314	1	Wt	Grab	X								61
1000-63-FD	4/3/2024	22:51	South Valley - Drinking Fountain - 004705-By 313	1	Wt	Grab	X								62
1000-64-FD	4/3/2024	22:52	South Valley - Sink Tap - 004706-By 313-Boys	1	Wt	Grab	X								63

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-65-FD	4/3/2024	22:52	South Valley - Sink Tap - 004707-By 313-Boys	1	Wt	Grab	X								64
1000-66-FD	4/3/2024	22:52	South Valley - Sink Tap - 004708-By 313-Staff Bathroom	1	Wt	Grab	X								65
1000-67-FD	4/3/2024	22:54	South Valley - Sink Tap - 004709-Room 317	1	Wt	Grab	X								66
1000-68-FD	4/3/2024	22:54	South Valley - Bubbler - 004710-Room 317	1	Wt	Grab	X								67
1000-69-FD	4/3/2024	22:55	South Valley - Sink Tap - 003181F-Room 315	1	Wt	Grab	X								68
1000-70-FD	4/3/2024	22:55	South Valley - Bubbler - 003181B-Room 315	1	Wt	Grab	X								69
1000-71-FD	4/3/2024	22:58	South Valley - Sink Tap - 004714-Room 124	1	Wt	Grab	X								70

LAB USE ONLY: Wk Order #: 3HD00081; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD00081

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-72-FD	4/3/2024	22:58	South Valley - Bubbler - 004715-Room 124	1	Wt	Grab	X								71
1000-73-FD	4/3/2024	22:59	South Valley - Sink Tap - 004719-Room 125	1	Wt	Grab	X								72
1000-74-FD	4/3/2024	22:59	South Valley - Bubbler - 004718-Room 125	1	Wt	Grab	X								73
1000-75-FD	4/3/2024	23:00	South Valley - Sink Tap - 004716-Room 122	1	Wt	Grab	X								74
1000-76-FD	4/3/2024	23:00	South Valley - Bubbler - 004717-Room 122	1	Wt	Grab	X								75
1000-77-FD	4/3/2024	23:02	South Valley - Sink Tap - 004731-Room 116	1	Wt	Grab	X								76
1000-78-FD	4/3/2024	23:02	South Valley - Bubbler - 004732-Room 116	1	Wt	Grab	X								77

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-79-FD	4/3/2024	23:03	South Valley - Sink Tap - 004733-Room 114	1	Wt	Grab	X								78
1000-80-FD	4/3/2024	23:03	South Valley - Bubbler - 004734-Room 114	1	Wt	Grab	X								79
1000-81-FD	4/3/2024	23:03	South Valley - Sink Tap - 004737-Room 115	1	Wt	Grab	X								80
1000-82-FD	4/3/2024	23:03	South Valley - Bubbler - 004738-Room 115	1	Wt	Grab	X								81
1000-83-FD	4/3/2024	23:04	South Valley - Sink Tap - 004735-Room 113	1	Wt	Grab	X								82
1000-84-FD	4/3/2024	23:04	South Valley - Bubbler - 004736-Room 113	1	Wt	Grab	X								83
1000-85-FD	4/3/2024	23:06	South Valley - Sink Tap - 004741-By 114-Girls	1	Wt	Grab	X								84

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date: 4/5/24		
	Time:		Sue Thompson	Time: 1000		

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HD0081
														Short Hold:	
														Rush:	
														Temp: oC	
1000-86-FD	4/3/2024	23:06	South Valley - Sink Tap - 004739-By 114-Girls	1	Wt	Grab	X								85
1000-87-FD	4/3/2024	23:06	South Valley - Sink Tap - 004740-By 114-Girls	1	Wt	Grab	X								86
1000-88-FD	4/3/2024	23:07	South Valley - Sink Tap - 004744-By 110-Boys	1	Wt	Grab	X								87
1000-89-FD	4/3/2024	23:07	South Valley - Sink Tap - 004743-By 110-Boys	1	Wt	Grab	X								88
1000-90-FD	4/3/2024	23:07	South Valley - Sink Tap - 004742-By 110-Boys	1	Wt	Grab	X								89
1000-91-FD	4/3/2024	23:09	South Valley - Sink Tap - 004745-Room 111	1	Wt	Grab	X								90
1000-92-FD	4/3/2024	23:09	South Valley - Bubbler - 004746-Room 111	1	Wt	Grab	X								91

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	8000	
	Time:					

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-93-FD	4/3/2024	23:09	South Valley - Sink Tap - 004747-Room 109	1	Wt	Grab	X								92
1000-94-FD	4/3/2024	23:09	South Valley - Bubbler - 004748-Room 109	1	Wt	Grab	X								93
1000-95-FD	4/3/2024	23:10	South Valley - Sink Tap - 004749-Room 110	1	Wt	Grab	X								94
1000-96-FD	4/3/2024	23:10	South Valley - Bubbler - 004750-Room 110	1	Wt	Grab	X								95
1000-97-FD	4/3/2024	23:11	South Valley - Sink Tap - 004751-Room 108	1	Wt	Grab	X								96
1000-98-FD	4/3/2024	23:11	South Valley - Bubbler - 004752-Room 108	1	Wt	Grab	X								97
1000-99-FD	4/3/2024	23:13	South Valley - Sink Tap - 004764-Room 102	1	Wt	Grab	X								98

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0081

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-100-FD	4/3/2024	23:13	South Valley - Bubbler - 004765-Room 102	1	Wt	Grab	X								99
1000-101-FD	4/3/2024	23:13	South Valley - Drinking Fountain - 004768B-Room 100	1	Wt	Grab	X								AA
1000-102-FD	4/3/2024	23:14	South Valley - Bottle Filler - 004768F-Room 100	1	Wt	Grab	X								AB
1000-103-FD	4/3/2024	23:14	South Valley - Sink Tap - 004767-Room 101	1	Wt	Grab	X								AC
1000-104-FD	4/3/2024	23:14	South Valley - Bubbler - 004766-Room 101	1	Wt	Grab	X								AD
1000-105-FD	4/3/2024	23:17	South Valley - Sink Tap - 004769-Library Workroom	1	Wt	Grab	X								AE
1000-106-FD	4/3/2024	23:17	South Valley - Bubbler - 004770-Library Workroom	1	Wt	Grab	X								AF

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3 H D 0 0 8 1

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #:	3HD0081
														Short Hold:	
														Rush:	
														Temp: oC	
1000-107-FD	4/3/2024	23:17	South Valley - Drinking Fountain - 004772B-Library	1	Wt	Grab	X								AG
1000-108-FD	4/3/2024	23:18	South Valley - Bottle Filler - 004772F-Library	1	Wt	Grab	X								AH
1000-109-FD	4/3/2024	23:18	South Valley - Sink Tap - 004771-Library	1	Wt	Grab	X								AI
1000-110-FD	4/3/2024	23:18	South Valley - Sink Tap - 002198-Room 302	1	Wt	Grab	X								AJ
1000-111-FD	4/3/2024	23:18	South Valley - Bubbler - 002197-Room 302	1	Wt	Grab	X								AK
1000-112-FD	4/3/2024	23:21	South Valley - Sink Tap - 003114-Gym-Bathroom-Right	1	Wt	Grab	X								AL
1000-113-FD	4/3/2024	23:21	South Valley - Sink Tap - 003115-Gym-Bathroom-Left	1	Wt	Grab	X								AM

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-114-FD	4/3/2024	23:22	South Valley - Drinking Fountain - 002104-Gym-Left	1	Wt	Grab	X								AN
1000-115-FD	4/3/2024	23:22	South Valley - Drinking Fountain - 002105-Gym	1	Wt	Grab	X								AO
1000-116-FD	4/3/2024	23:22	South Valley - Drinking Fountain - 002106-Gym	1	Wt	Grab	X								AP
1000-117-FD	4/3/2024	23:24	South Valley - Sink Tap - 002107-Locker Room-Girls	1	Wt	Grab	X								AQ
1000-118-FD	4/3/2024	23:24	South Valley - Sink Tap - 002108-Locker Room-Girls	1	Wt	Grab	X								AR
1000-119-FD	4/3/2024	23:24	South Valley - Sink Tap - 002109-Locker Room-Girls	1	Wt	Grab	X								AS
1000-120-FD	4/3/2024	23:25	South Valley - Sink Tap - 002110-Girls Lockers-Coach Office	1	Wt	Grab	X								AT

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	
	Time:					

3HD0081

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

___ 3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

___ 205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-121-FD	4/3/2024	23:26	South Valley - Sink Tap - 002101-Locker Room-Boys	1	Wt	Grab	X								AU
1000-122-FD	4/3/2024	23:26	South Valley - Sink Tap - 002102-Locker Room-Boys	1	Wt	Grab	X								AV
1000-123-FD	4/3/2024	23:27	South Valley - Sink Tap - 002103-Boys Lockers-Office	1	Wt	Grab	X								AW
1000-124-FD	4/3/2024	23:30	South Valley - Sink Tap - 002117-Commons-Girls-Left	1	Wt	Grab	X								AX
1000-125-FD	4/3/2024	23:30	South Valley - Sink Tap - 002118-Commons-Girls	1	Wt	Grab	X								AY
1000-126-FD	4/3/2024	23:30	South Valley - Sink Tap - 002119-Commons-Girls	1	Wt	Grab	X								AZ
1000-127-FD	4/3/2024	23:31	South Valley - Sink Tap - 002111-Commons-Boys	1	Wt	Grab	X								BA

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	
	Time:					

3HD0081

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X 835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	LAB USE ONLY: Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-128-FD	4/3/2024	23:31	South Valley - Sink Tap - 002112-Commons-Boys	1	Wt	Grab	X								BB
1000-129-FD	4/3/2024	23:31	South Valley - Sink Tap - 002113-Commons-Boys	1	Wt	Grab	X								BC
1000-130-FD	4/3/2024	23:32	South Valley - Drinking Fountain - 002114-Commons	1	Wt	Grab	X								BD
1000-131-FD	4/3/2024	23:32	South Valley - Drinking Fountain - 002115-Commons	1	Wt	Grab	X								BE
1000-132-FD	4/3/2024	23:33	South Valley - Drinking Fountain - 002116-Commons-Left	1	Wt	Grab	X								BF
1000-133-FD	4/3/2024	23:33	South Valley - Drinking Fountain - 002116B-Commons-Right	1	Wt	Grab	X								BG
1000-134-FD	4/3/2024	23:33	South Valley - Bottle Filler - 002116F-Commons	1	Wt	Grab	X								BH

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
			Sue Thompson	Time:	1000	
	Time:					

3HD0081

AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-135-FD	4/3/2024	23:36	South Valley - Sink Tap - 004655-Kitchen-Handwashing by Dish Room	1	Wt	Grab	X								BI
1000-136-FD	4/3/2024	23:36	South Valley - Sink Tap - 004656-Kitchen-Dishwasher Room	1	Wt	Grab	X								BJ
1000-137-FD	4/3/2024	23:36	South Valley - Sink Tap - 004657-Kitchen-Dishwasher Room	1	Wt	Grab	X								BK
1000-138-FD	4/3/2024	23:38	South Valley - Sink Tap - 004658-Kitchen-3 Bay Sink	1	Wt	Grab	X								BL
1000-139-FD	4/3/2024	23:38	South Valley - Sink Tap - 004659-Kitchen-3 Bay Sink	1	Wt	Grab	X								BM
1000-140-FD	4/3/2024	23:38	South Valley - Sink Tap - 004660-Kitchen-3 Bay Sink	1	Wt	Grab	X								BN
1000-141-FD	4/3/2024	23:39	South Valley - Sink Tap - 004650-Kitchen-Handwashing by Air Hood	1	Wt	Grab	X								BO

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		
				4/5/24		
	Time:		Sue Thompson	Time:		
				1000		

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
														Wk Order #: 3HD0081	
														Short Hold:	
														Rush:	
														Temp: oC	
1000-142-FD	4/3/2024	23:40	South Valley - Sink Tap - 004671-Kitchen-In Front of Office	1	Wt	Grab	X								BP
1000-143-FD	4/3/2024	23:40	South Valley - Sink Tap - 004672-Kitchen-In Front of Office	1	Wt	Grab	X								BQ
1000-144-FD	4/3/2024	23:40	South Valley - Sink Tap - 004673-Kitchen-Next to Freezer	1	Wt	Grab	X								BR
1000-145-FD	4/3/2024	23:41	South Valley - Sink Tap - 004674-Kitchen-Next to Freezer	1	Wt	Grab	X								BS
1000-146-FD	4/3/2024	23:41	South Valley - Sink Tap - 004675-Kitchen-Across from Oven	1	Wt	Grab	X								BT
1000-147-FD	4/3/2024	23:41	South Valley - Sink Tap - 004676-Kitchen-Across from Oven	1	Wt	Grab	X								BU
1000-148-FD	4/3/2024	23:42	South Valley - Sink Tap - 004677-Kitchen-Next to Fridge	1	Wt	Grab	X								BV

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	4/5/24	
	Time:		Sue Thompson	Time:	1000	

3HD0081
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY: Sample Condition	Sample #
1000-149-FD	4/3/2024	23:42	South Valley - Sink Tap - 004678-Kitchen-Bathroom	1	Wt	Grab	X								BW
1000-150-FD	4/3/2024	23:43	South Valley - Sink Tap - 004649-Kitchen-Handwashing By Oven	1	Wt	Grab	X								BX
1000-151-FD	4/3/2024	23:45	South Valley - Pot Filler - 000105-Kitchen-Left	1	Wt	Grab	X								BY
1000-152-FD	4/3/2024	23:45	South Valley - Pot Filler - 000106-Kitchen-Right	1	Wt	Grab	X								BZ
1000-153-FD	4/3/2024	23:45	South Valley - Ice Machine - 000545-Kitchen	1	Wt	Grab	X								CA
															B

LAB USE ONLY: Wk Order #: 3H70081; Short Hold:; Rush:; Temp: oC

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date: 4/5/24		
	Time:		Sue Thompson	Time: 1000		

3 H D 0 0 8 1

AXIOM Service Professionals

PM: Carolyn Jackson

MICROBAC®

Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HE0029

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: South Valley

Project / PO Number: South Valley
Received: 05/02/2024
Reported: 05/10/2024

Work Order Special Information

Young, Bradly
South Valley

Analytical Testing Parameters

Client Sample ID:	1000-43-FD		
Sample Matrix:	Drinking Water	**Collected By:**	Young, Bradly
Lab Sample ID:	3HE0029-01	**Collection Date:**	04/30/2024 22:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		05/07/24 1516	05/09/24 0159	RVV

Definitions

RL: Reporting Limit

Report Comments

Reviewed and Approved By:



Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
05/10/24 13:15

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. ***The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.***

Keystone LABORATORIES
A Microbac Company

___ 600 E. 17th St. S, Newton, IA 50208, Phone: 641-792-8451
___ 3012 Ansborough Ave, Waterloo, IA 50701, Phone: 319-235-4440
X 835 S St. Paul, Kansas City, KS 66105, Phone: 913-321-7856
___ 205 E Van Buren St, Centerville, IA 52544, Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:	Brody Young	NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	1000 Midjay Drive	ADRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Liberty, Missouri 64068	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-522-2275	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED: Lead							LAB USE ONLY
1000-43-FD	4/30/2024	22:20	South Valley - Bubbler - 002185-Room 224	1	Wt	Grab	X							Wk Order #: 3HE0029
														Short Hold:
														Rush:
														Temp: oC 20.0
														Sample Condition / Sample #: 3HE0029-01

3HE0029

AXIOM Service Professionals
PM: Carolyn Jackson

Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquied by: (Signature)	Date:		Received by: (Signature)	Date:	05/02/24	
			Carolyn Jackson			
	Time:			Time:	12:00	

Appendix D
Photo Log



4/3/2024 - 1000-1 - South Valley - 002120-Nurse's Office



4/3/2024 - 1000-2 - South Valley - 002121-Nurse's Office



4/3/2024 - 1000-3 - South Valley - 002123-Nurse's Office



4/3/2024 - 1000-4 - South Valley - 002122-Nurse's Office



4/3/2024 - 1000-5 - South Valley - 002124-Nurse's Office-Restroom



4/3/2024 - 1000-6 - South Valley - 002125-Nurse's Office-Restroom



4/3/2024 - 1000-7 - South Valley - 002126-Staff Workroom-Restroom



4/3/2024 - 1000-8 - South Valley - 002127-Lounge



4/3/2024 - 1000-9 - South Valley - 002128-Lounge



4/3/2024 - 1000-10 - South Valley - 002129-Staff Workroom-Restroom



4/3/2024 - 1000-11 - South Valley - 003113-Lounge



4/3/2024 - 1000-12 - South Valley - 002130-Room 200



4/3/2024 - 1000-13 - South Valley - 002131-Room 200



4/3/2024 - 1000-14 - South Valley - 002134-Room 201



4/3/2024 - 1000-15 - South Valley - 002135-Room 201



4/3/2024 - 1000-16 - South Valley - 002133-Room 202



4/3/2024 - 1000-17 - South Valley - 002132-Room 202




4/3/2024 - 1000-18 - South Valley - 002148-Room 208



4/3/2024 - 1000-19 - South Valley - 002147-Room 208



4/3/2024 - 1000-20 - South Valley - 002149-Room 210

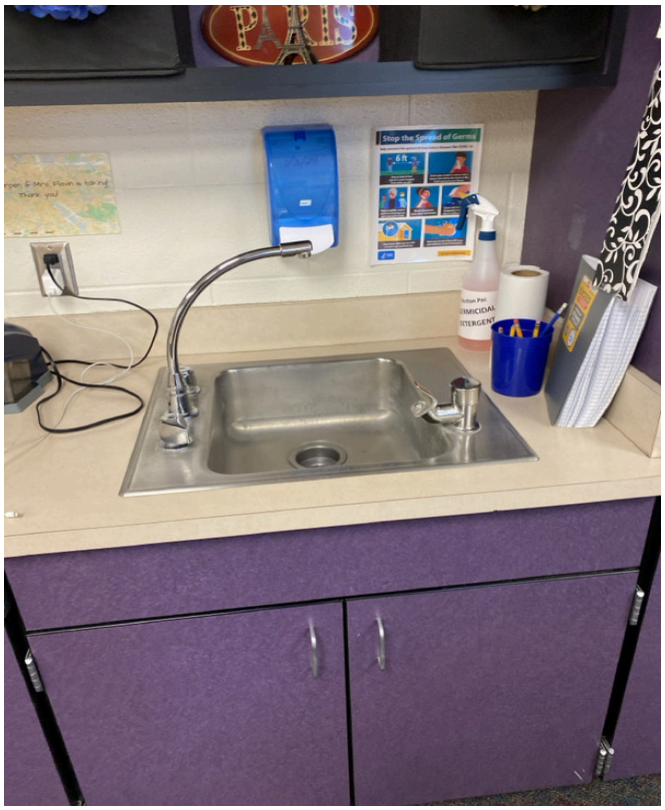

4/3/2024 - 1000-21 - South Valley - 002150-Room 210



4/3/2024 - 1000-22 - South Valley - 002152-Room 209



4/3/2024 - 1000-23 - South Valley - 002151-Room 209



4/3/2024 - 1000-24 - South Valley - 002153-Room 211



4/3/2024 - 1000-25 - South Valley - 002154-Room 211



4/3/2024 - 1000-26 - South Valley - 002155-By 210-Boys



4/3/2024 - 1000-27 - South Valley - 002156-By 210-Boys



4/3/2024 - 1000-28 - South Valley - 002157-By 210-Boys-Right



4/3/2024 - 1000-29 - South Valley - 002158/3160-By 214-Girls



4/3/2024 - 1000-30 - South Valley - 002159-By 214-Girls



4/3/2024 - 1000-31 - South Valley - 002160-By 214-Girls



4/3/2024 - 1000-32 - South Valley - 002165-Room 213




4/3/2024 - 1000-33 - South Valley - 002166-Room 213



4/3/2024 - 1000-34 - South Valley - 002168-Room 215



4/3/2024 - 1000-35 - South Valley - 002167-Room 215

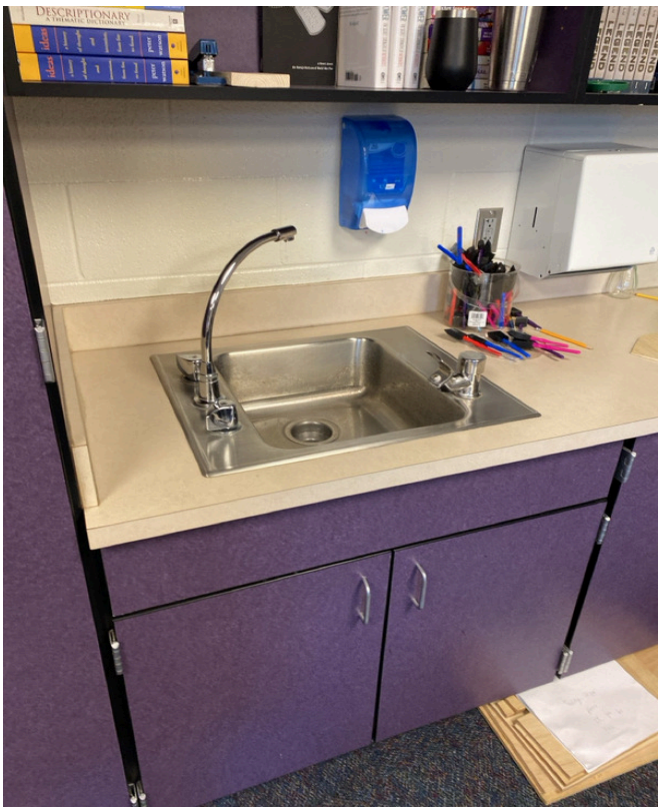

4/3/2024 - 1000-36 - South Valley - 002161-Room 214



4/3/2024 - 1000-37 - South Valley - 002162-Room 214



4/3/2024 - 1000-38 - South Valley - 002164-Room 216



4/3/2024 - 1000-39 - South Valley - 002163-Room 216




4/3/2024 - 1000-40 - South Valley - 002183-Room 222



4/3/2024 - 1000-41 - South Valley - 002182-Room 222



4/3/2024 - 1000-42 - South Valley - 002184-Room 224

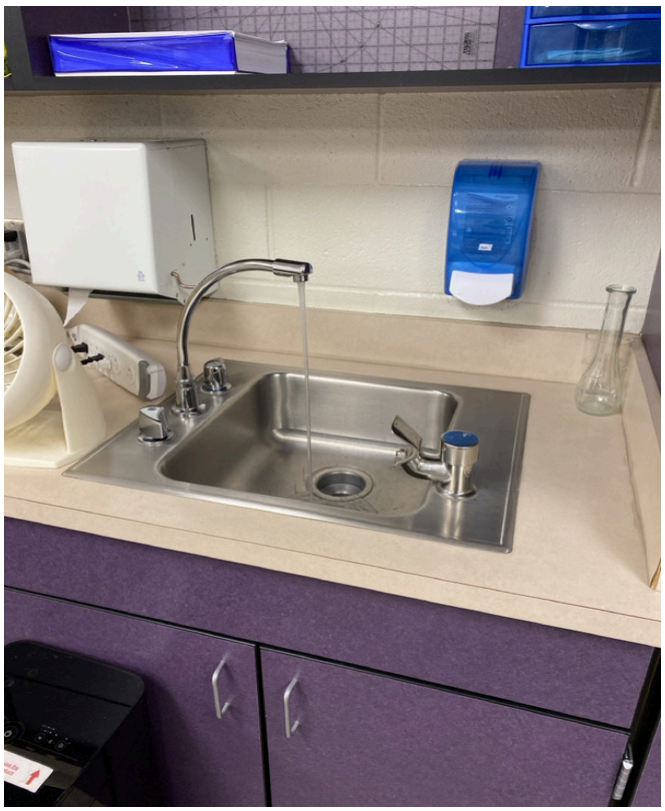

4/3/2024 - 1000-43 - South Valley - 002185-Room 224 - Out Of Order



4/3/2024 - 1000-44 - South Valley - 002181-Room 225



4/3/2024 - 1000-45 - South Valley - 002180-Room 225



4/3/2024 - 1000-46 - South Valley - 002199-Room 227



4/3/2024 - 1000-47 - South Valley - 002200-Room 227



4/3/2024 - 1000-48 - South Valley - 002186-Room 318-Kitchen 1



4/3/2024 - 1000-49 - South Valley - 002187-Room 318-Kitchen 2



4/3/2024 - 1000-50 - South Valley - 002188-Room 318-Kitchen 3



4/3/2024 - 1000-51 - South Valley - 002189-Room 318-Kitchen 4



4/3/2024 - 1000-52 - South Valley - 002190-Room 318-Kitchen 5



4/3/2024 - 1000-53 - South Valley - 002191-Room 318-Kitchen 6



4/3/2024 - 1000-54 - South Valley - 002192-Room 316



4/3/2024 - 1000-55 - South Valley - 002193-Room 316



4/3/2024 - 1000-56 - South Valley - 002194-Room 316



4/3/2024 - 1000-57 - South Valley - 002196-Room 314



4/3/2024 - 1000-58 - South Valley - 002195-Room 314



4/3/2024 - 1000-59 - South Valley - 004701-By 314-Staff Restroom



4/3/2024 - 1000-60 - South Valley - 004702-By 314-Girls



4/3/2024 - 1000-61 - South Valley - 004703-By 314-Girls



4/3/2024 - 1000-62 - South Valley - 004704-By 314



4/3/2024 - 1000-63 - South Valley - 004705-By 313



4/3/2024 - 1000-64 - South Valley - 004706-By 313-Boys



4/3/2024 - 1000-65 - South Valley - 004707-By 313-Boys




4/3/2024 - 1000-66 - South Valley - 004708-By 313-Staff Restroom




4/3/2024 - 1000-67 - South Valley - 004709-Room 317



4/3/2024 - 1000-68 - South Valley - 004710-Room 317

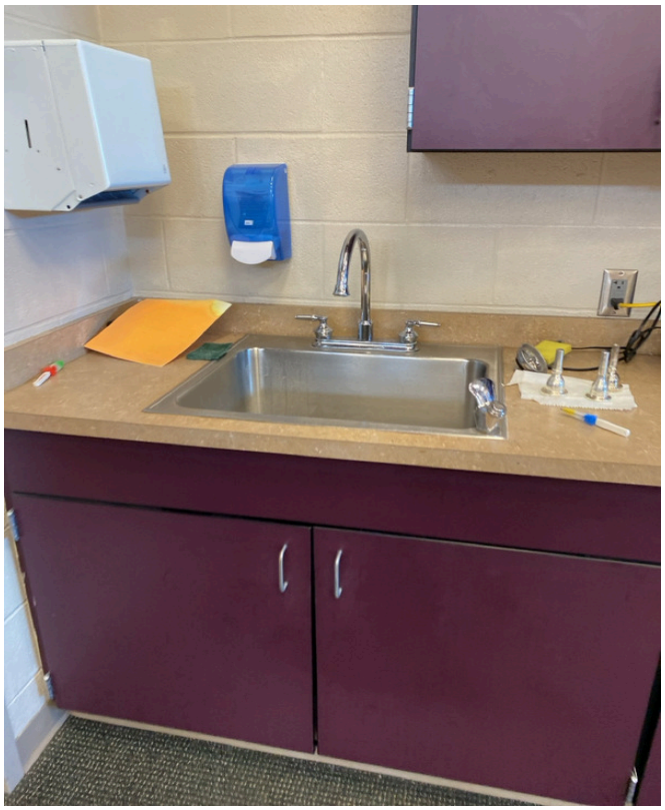

4/3/2024 - 1000-69 - South Valley - 003181F-Room 315

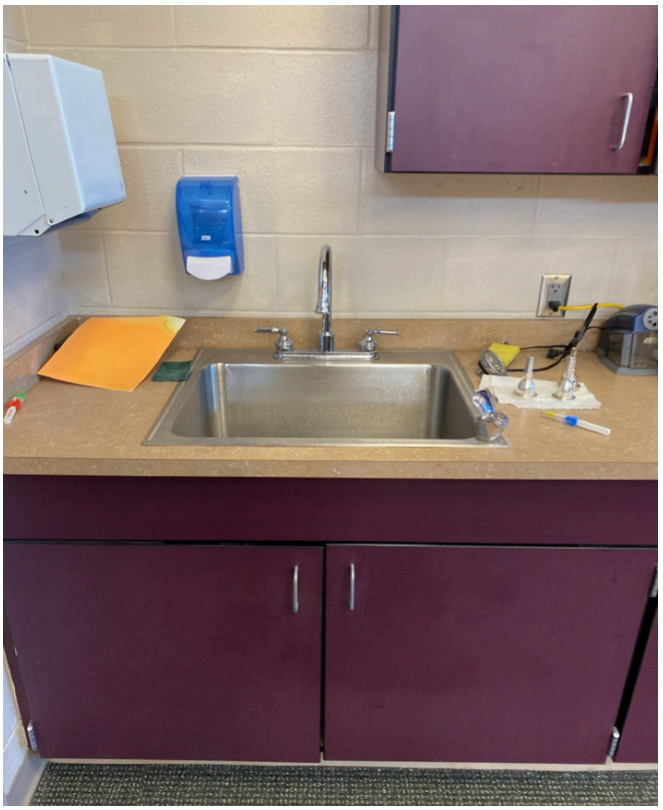


4/3/2024 - 1000-70 - South Valley - 003181B-Room 315



4/3/2024 - 1000-71 - South Valley - 004714-Room 124



4/3/2024 - 1000-72 - South Valley - 004715-Room 124

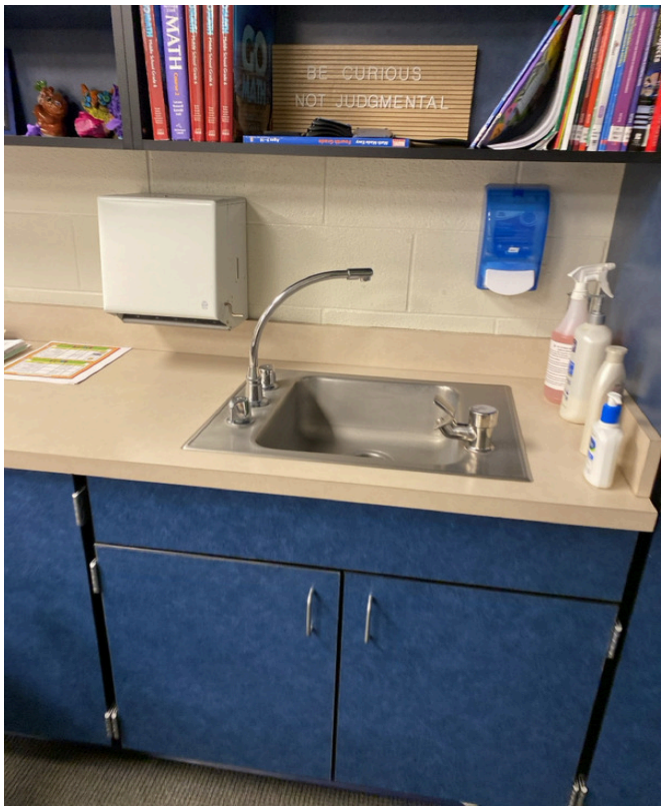


4/3/2024 - 1000-73 - South Valley - 004719-Room 125




4/3/2024 - 1000-74 - South Valley - 004718-Room 125



4/3/2024 - 1000-75 - South Valley - 004716-Room 122

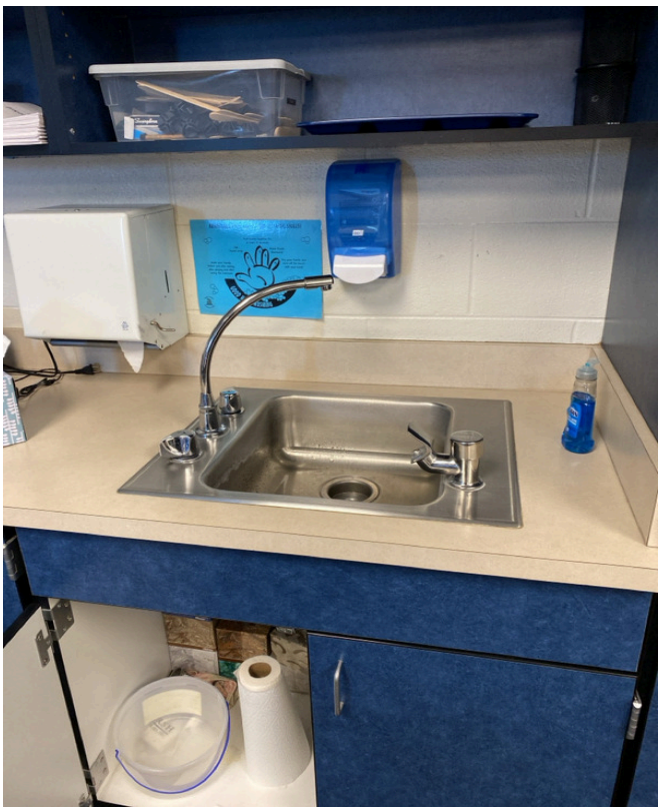


4/3/2024 - 1000-76 - South Valley - 004717-Room 122

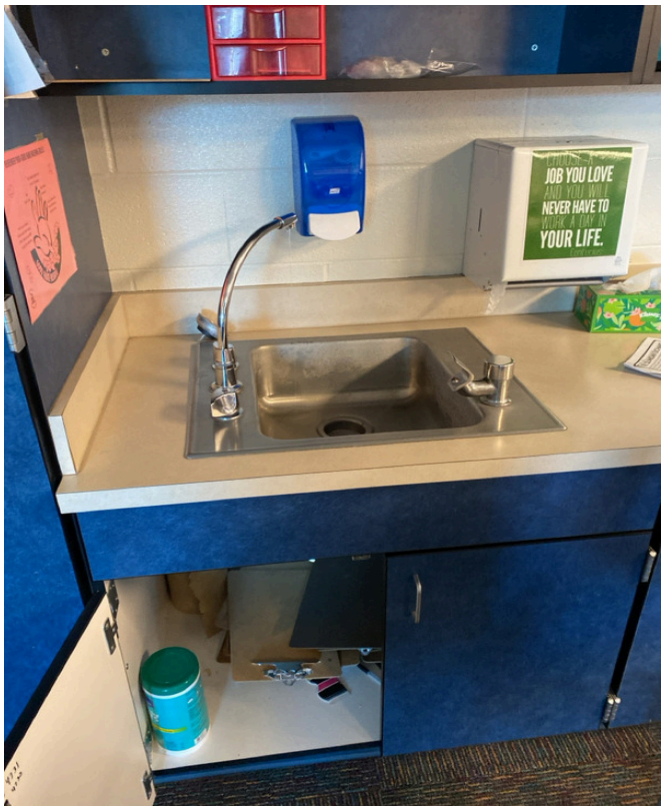


4/3/2024 - 1000-77 - South Valley - 004731-Room 116




4/3/2024 - 1000-78 - South Valley - 004732-Room 116

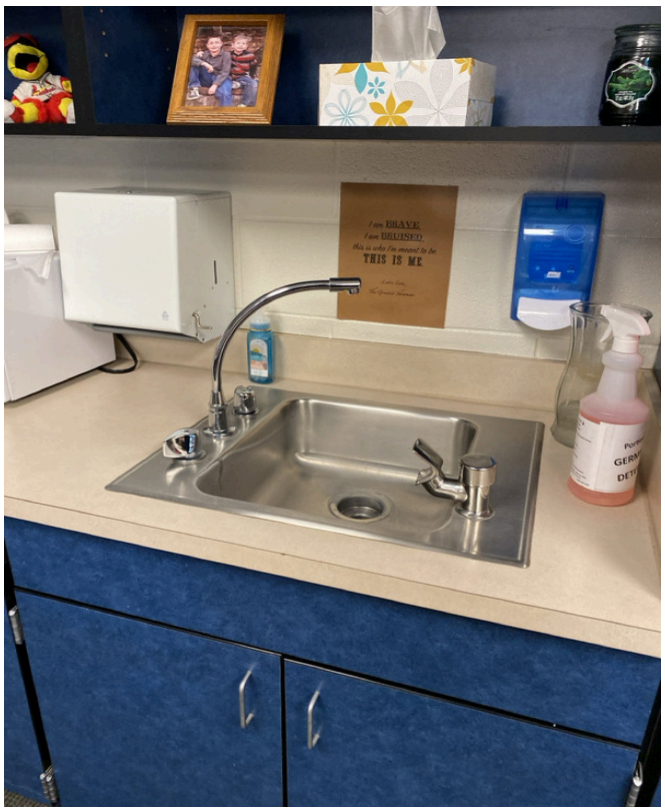

4/3/2024 - 1000-79 - South Valley - 004733-Room 114

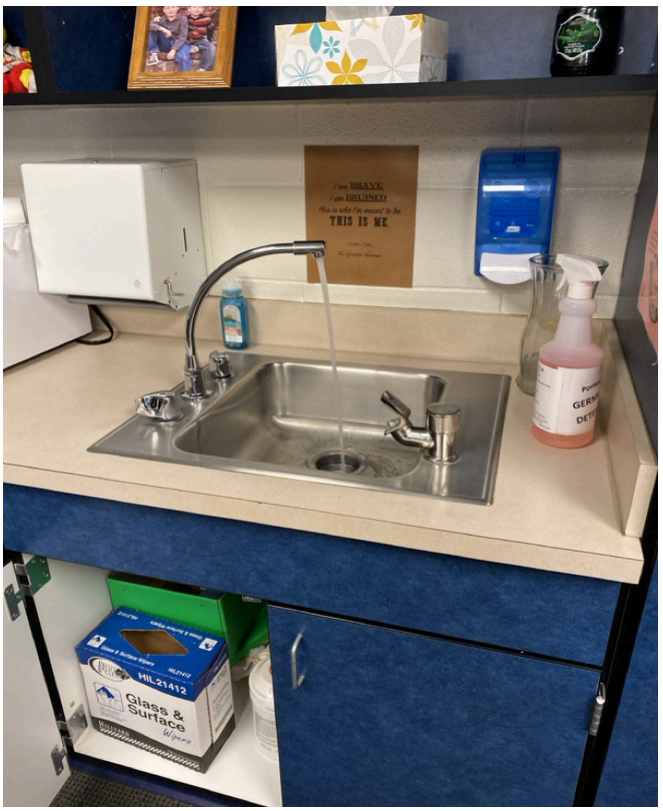


4/3/2024 - 1000-80 - South Valley - 004734-Room 114

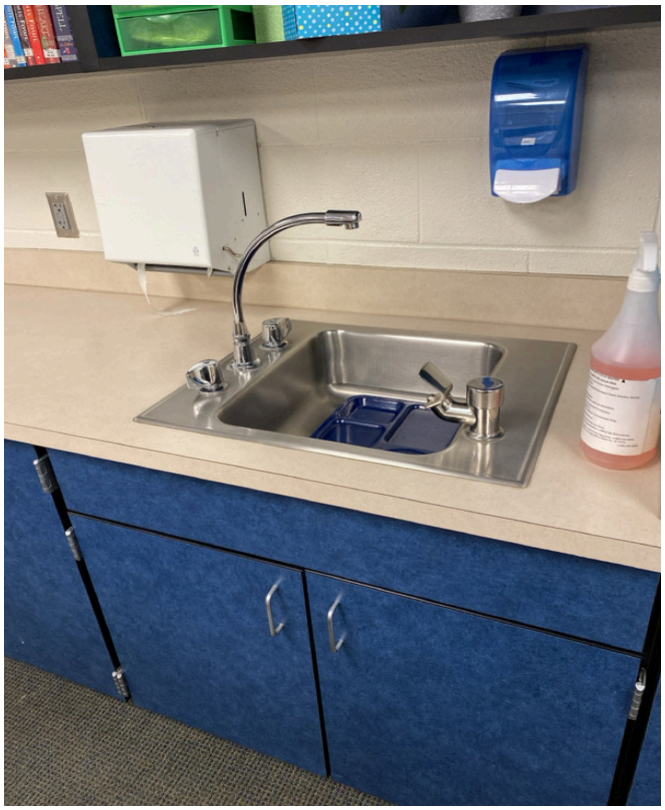


4/3/2024 - 1000-81 - South Valley - 004737-Room 115



4/3/2024 - 1000-82 - South Valley - 004738-Room 115

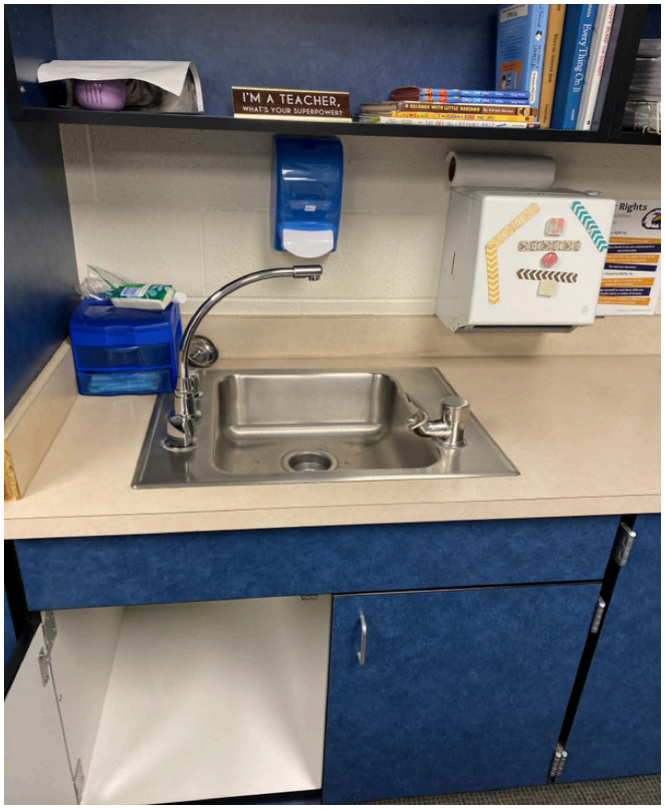

4/3/2024 - 1000-83 - South Valley - 004735-Room 113

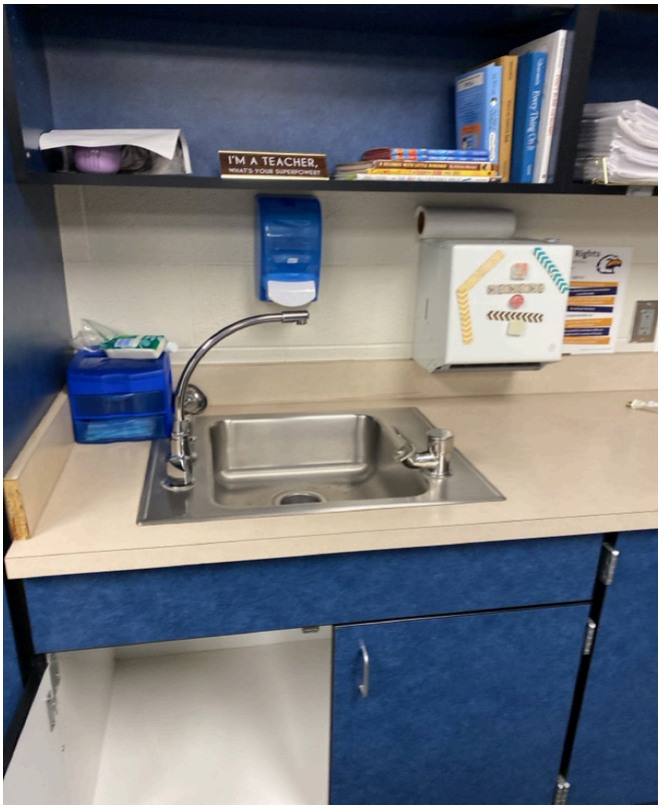

4/3/2024 - 1000-84 - South Valley - 004736-Room 113



4/3/2024 - 1000-85 - South Valley - 004741-By 114-Girls



4/3/2024 - 1000-86 - South Valley - 004739-By 114-Girls



4/3/2024 - 1000-87 - South Valley - 004740-By 114-Girls



4/3/2024 - 1000-88 - South Valley - 004744-By 110-Boys




4/3/2024 - 1000-89 - South Valley - 004743-By 110-Boys




4/3/2024 - 1000-90 - South Valley - 004742-By 110-Boys




4/3/2024 - 1000-90 - South Valley - 004742-By 110-Boys

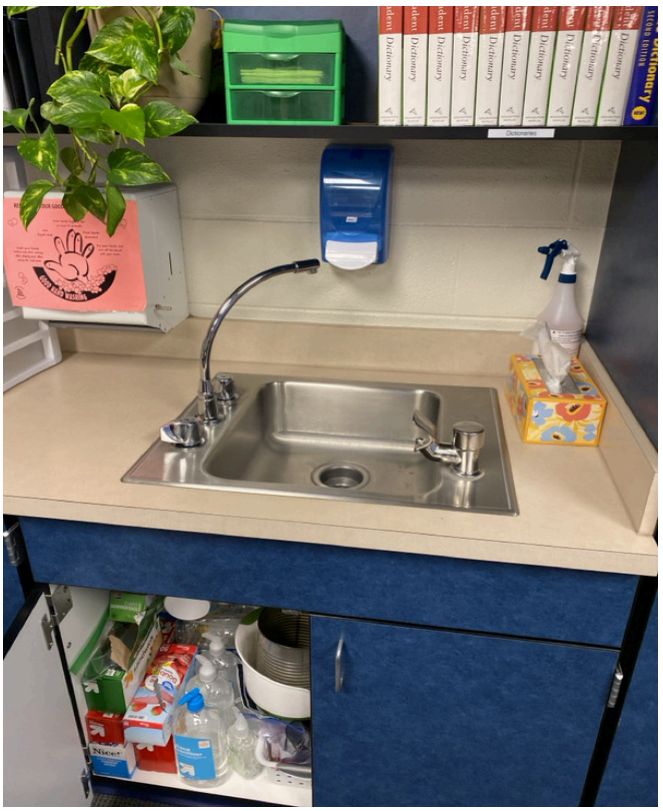

4/3/2024 - 1000-91 - South Valley - 004745-Room 111

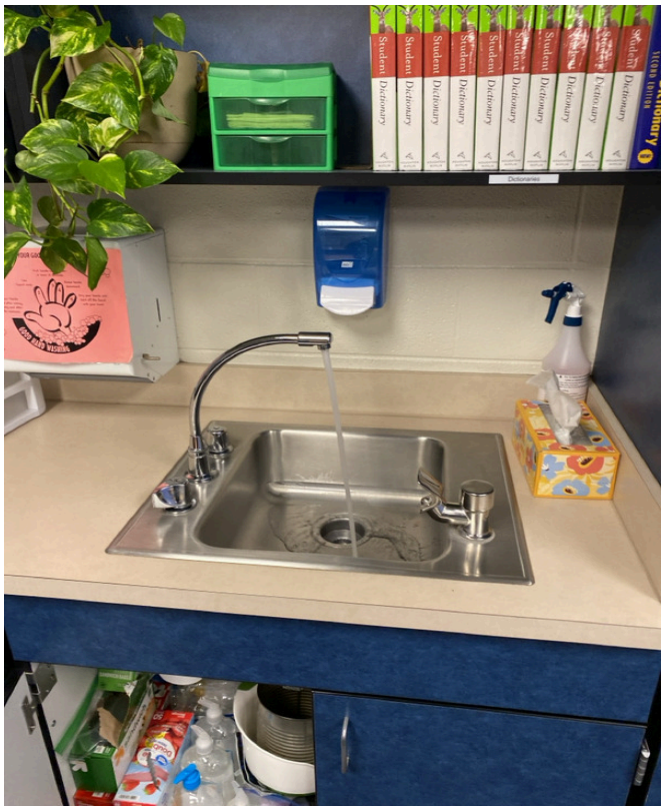

4/3/2024 - 1000-92 - South Valley - 004746-Room 111

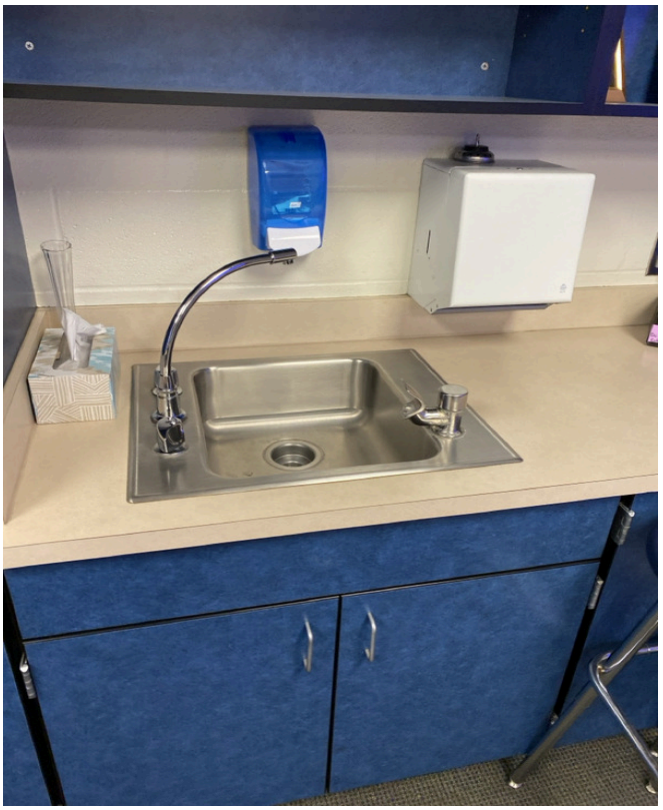

4/3/2024 - 1000-93 - South Valley - 004747-Room 109



4/3/2024 - 1000-94 - South Valley - 004748-Room 109



4/3/2024 - 1000-95 - South Valley - 004749-Room 110



4/3/2024 - 1000-96 - South Valley - 004750-Room 110



4/3/2024 - 1000-97 - South Valley - 004751-Room 108



4/3/2024 - 1000-98 - South Valley - 004752-Room 108



4/3/2024 - 1000-99 - South Valley - 004764-Room 102



4/3/2024 - 1000-100 - South Valley - 004765-Room 102



4/3/2024 - 1000-101 - South Valley - 004768B-Room 100



4/3/2024 - 1000-102 - South Valley - 004768F-Room 100



4/3/2024 - 1000-103 - South Valley - 004767-Room 101



4/3/2024 - 1000-104 - South Valley - 004766-Room 101



4/3/2024 - 1000-105 - South Valley - 004769-Library Workroom



4/3/2024 - 1000-106 - South Valley - 004770-Library Workroom



4/3/2024 - 1000-107 - South Valley - 004772B-Library



4/3/2024 - 1000-108 - South Valley - 004772F-Library



4/3/2024 - 1000-109 - South Valley - 004771-Library




4/3/2024 - 1000-110 - South Valley - 002198-Room 302



4/3/2024 - 1000-111 - South Valley - 002197-Room 302



4/3/2024 - 1000-112 - South Valley - 003114-Gym-Restroom-Right

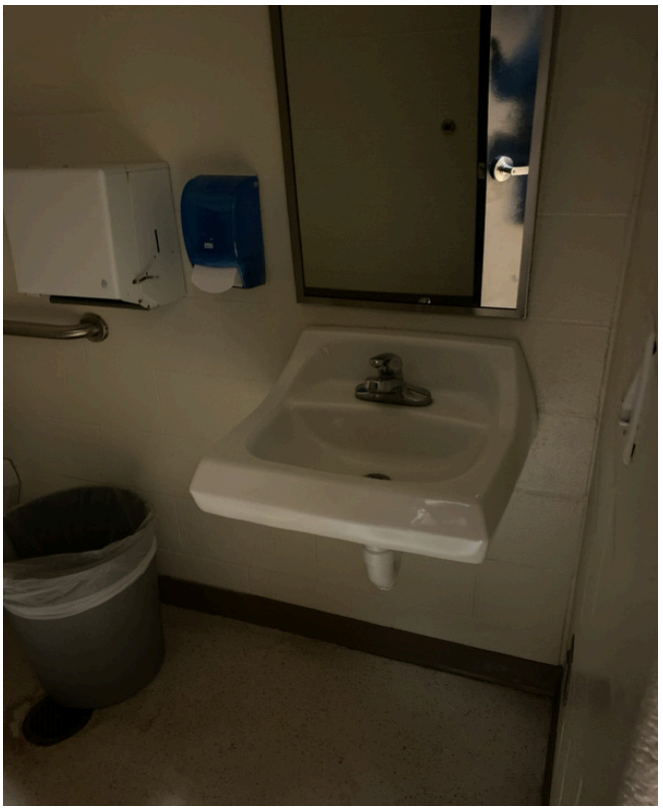

4/3/2024 - 1000-113 - South Valley - 003115-Gym-Restroom-Left



4/3/2024 - 1000-114 - South Valley - 002104-Gym-Left



4/3/2024 - 1000-115 - South Valley - 002105-Gym



4/3/2024 - 1000-116 - South Valley - 002106-Gym



4/3/2024 - 1000-117 - South Valley - 002107-Locker Room-Girls



4/3/2024 - 1000-118 - South Valley - 002108-Locker Room-Girls



4/3/2024 - 1000-118 - South Valley - 002108-Locker Room-Girls



4/3/2024 - 1000-119 - South Valley - 002109-Locker Room-Girls



4/3/2024 - 1000-120 - South Valley - 002110-Girls Lockers-Coaches Office



4/3/2024 - 1000-121 - South Valley - 002101-Locker Room-Boys



4/3/2024 - 1000-122 - South Valley - 002102-Locker Room-Boys



4/3/2024 - 1000-123 - South Valley - 002103-Boys Lockers-Office



4/3/2024 - 1000-124 - South Valley - 002117-Commons-Girls-Left



4/3/2024 - 1000-125 - South Valley - 002118-Commons-Girls



4/3/2024 - 1000-126 - South Valley - 002119-Commons-Girls



4/3/2024 - 1000-127 - South Valley - 002111-Commons-Boys



4/3/2024 - 1000-128 - South Valley - 002112-Commons-Boys



4/3/2024 - 1000-129 - South Valley - 002113-Commons-Boys



4/3/2024 - 1000-130 - South Valley - 002114-Commons



4/3/2024 - 1000-131 - South Valley - 002115-Commons



4/3/2024 - 1000-132 - South Valley - 002116-Commons-Left



4/3/2024 - 1000-133 - South Valley - 002116B-Commons-Right




4/3/2024 - 1000-135 - South Valley - 004655-Kitchen-Handwashing By Dish Room



4/3/2024 - 1000-136 - South Valley - 004656-Kitchen-Dishwasher Room



4/3/2024 - 1000-137 - South Valley - 004657-Kitchen-Dishwasher Room

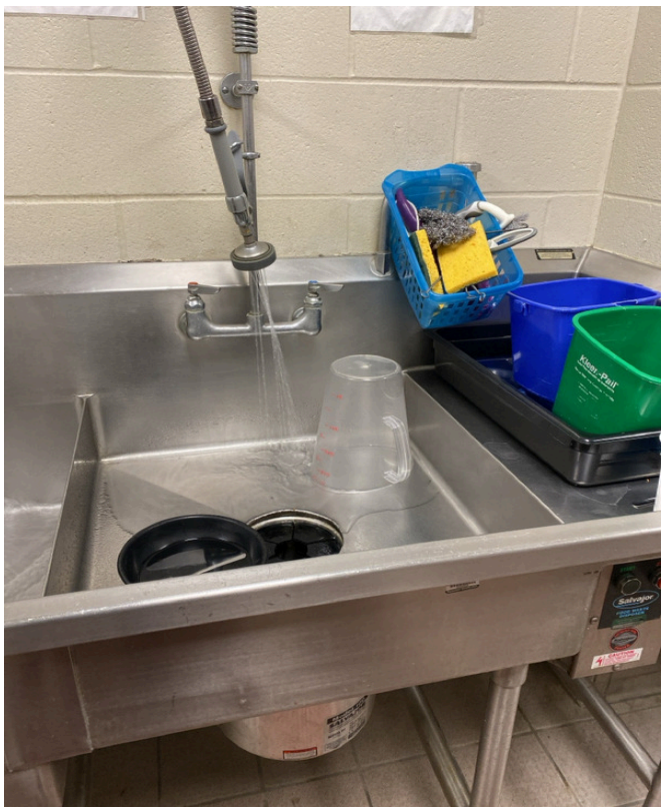

4/3/2024 - 1000-138 - South Valley - 004658-Kitchen-Three Bay Sink



4/3/2024 - 1000-139 - South Valley - 004659-Kitchen-Three Bay Sink



4/3/2024 - 1000-140 - South Valley - 004660-Kitchen-Three Bay Sink



4/3/2024 - 1000-141 - South Valley - 004650-Kitchen-Handwashing By Air Hood



4/3/2024 - 1000-142 - South Valley - 004671-Kitchen-In Front Of Office



4/3/2024 - 1000-143 - South Valley - 004672-Kitchen-In Front Of Office



4/3/2024 - 1000-144 - South Valley - 004673-Kitchen-Next To Freezer



4/3/2024 - 1000-145 - South Valley - 004674-Kitchen-Next To Freezer



4/3/2024 - 1000-146 - South Valley - 004675-Kitchen-Across From Oven



4/3/2024 - 1000-147 - South Valley - 004676-Kitchen-Across From Oven



4/3/2024 - 1000-148 - South Valley - 004677-Kitchen-Next To Fridge



4/3/2024 - 1000-149 - South Valley - 004678-Kitchen-Restroom



4/3/2024 - 1000-150 - South Valley - 004649-Kitchen-Handwashing By Oven



4/3/2024 - 1000-151 - South Valley - 000105-Kitchen-Left



4/3/2024 - 1000-152 - South Valley - 000106-Kitchen-Right




4/3/2024 - 1000-153 - South Valley - 000545-Kitchen



4/30/2024 - 1000-43 - South Valley - 002185-Room 224

Appendix E
Source Identification Diagram

ASP was provided sample locations by
Liberty School District

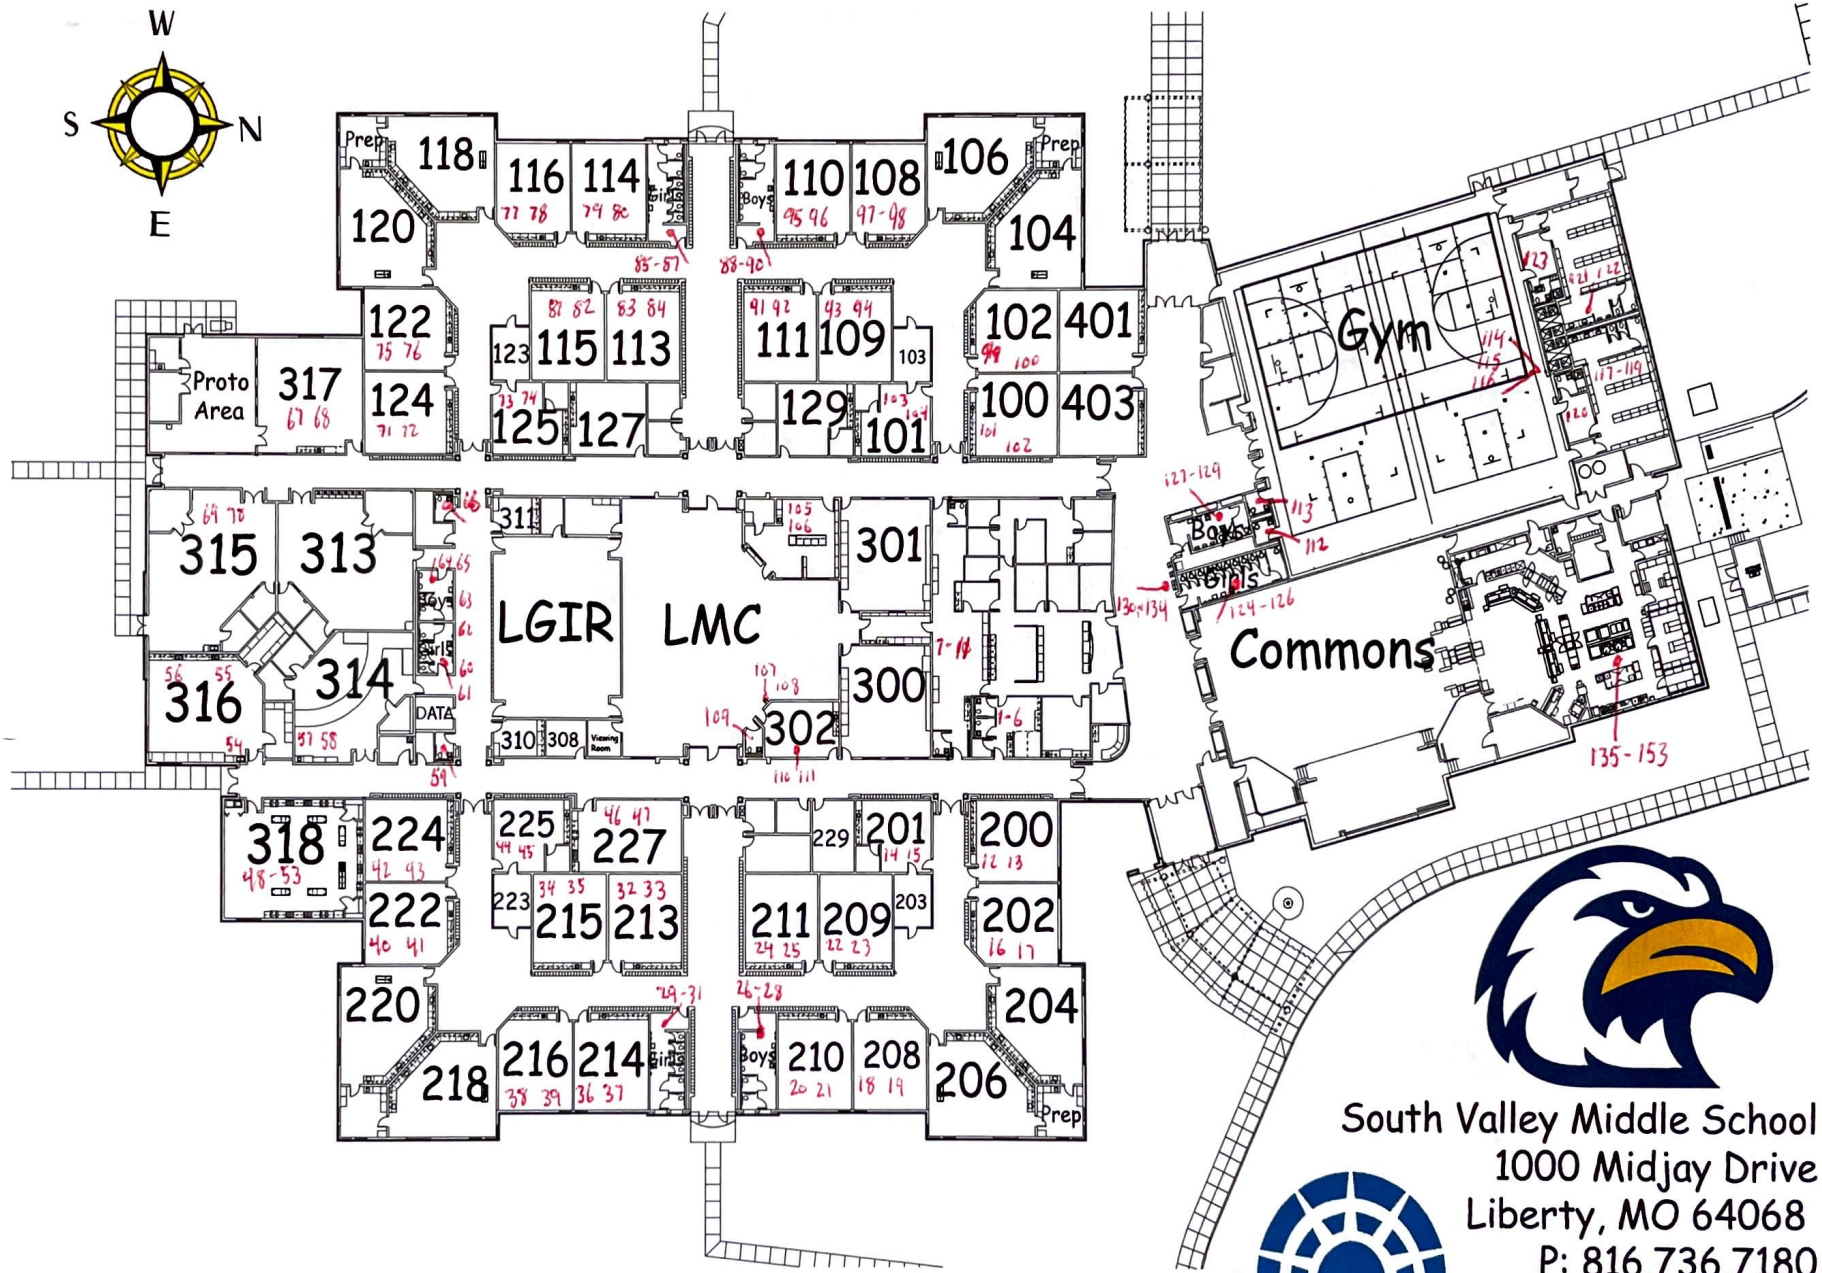

South Valley Middle School
1000 Midjay Drive
Liberty, MO 64068
P: 816.736.7180
F:816.736.7185

Liberty PUBLIC SCHOOLS
Empowering Excellence

Map Design by: Curt Laven
Last Updated: 06/17/2021