



181 US Hwy 46
Mine Hill, NJ 07803
(908) 654-8068
(800) 783-0567
Fax 908-654-8069

LEAD IN DRINKING WATER REPORT

Performed At:

Sayreville Public Schools

Performed For:

Sayreville Public Schools
James Kolmansperger
150 Lincoln St, South Amboy, NJ, 08879

Prepared By:

LEW Environmental Services, LLC.
181 US Hwy 46
Mine Hill, NJ 07803

Phone (908) 654-8068

Fax (908) 654-8069

Website <http://www.LEWCorp.com>

Inspection Date: 12/21/2024

Project Number: 2689

Table of Contents

Contact Information	4
Introduction	5
Sampling Methodology	5
Drinking Water Results	6
Recommendations	8

Appendices

Appendix A	Exceedances
Appendix B	Recommendations+
Appendix C	All results
Appendix D	Floor Plan(S)
Appendix E	Water Outlet Inventory(ies)
Appendix F	Laboratory Data

Contact Information

Education Agency

Client Contact:	James Kolmansperger
Client Name:	Sayreville Public Schools
Street Address	150 Lincoln St, South Amboy, NJ, 08879
Phone Number:	(732) 525-5200 4

Sampler(s)

Site Assessor(s):	Marvin Ayumbi
Signature:	
Date:	January 26th, 2025

Firm

Organization:	LEW Environmental Services, LLC.
Certification #:	NJDCA 00015 E
Street:	181 US Hwy 46
City, State & Zip:	Mine Hill, NJ 07803
Phone Number:	908-654-8068
Web Address:	http://www.lewcorp.com

Laboratory

Organization:	Environmental Hazard Services, LLC
Street:	7469 Whitepine Road
City, State & Zip:	Richmond, VA 23237
NJDEP Certification #	VA008
Phone Number:	800-347-4010

Introduction

LEW Environmental Services, LLC. was contracted by Sayreville Public Schools to test for the presence of lead in drinking water in nine facilities in the district.

Sampling Methodology

LEW Environmental Services, LLC. followed NJAC 6A:26. Full details on sampling practices can be found in Districts Sampling Plan.

All samples were collected in 250mL wide mouth plastic containers that was prepackaged by the analytical laboratory. The sample containers may contain nitric acid, if expedited analysis is required. If not, nitric acid will be added to each sample upon arrival at the laboratory. At each sample location, the first draw sample was taken after it was determined that the water had been standing in the plumbing system for greater than eight hours but less than forty-eight hours. If second draw samples were collected, they were collecting following a flushing protocol outlined in the District's Sampling Plan.

Drinking Water Results

On December 21-22, 2024, LEW Environmental Services, LLC. collected the following number of water samples:

Cheesequake Elementary School

- 6 first draw samples collected plus 1 QAQC blank sample
- 0 samples above the 15ppb action level

E. Arleth Elementary School

- 13 first draw samples collected plus 1 QAQC blank sample
- 0 samples above the 15ppb action level

Eisenhower Elementary School

- 7 first draw samples collected plus 1 QAQC blank sample
- 1 sample above the 15ppb action level

H. S. Truman Elementary School

- 14 first draw samples collected plus 1 QAQC blank sample
- 0 samples above the 15ppb action level

Jesse Selover School

- 6 first draw samples collected plus 1 QAQC blank sample
- 0 samples above the 15ppb action level

Samsel Upper Elementary School

- 27 first draw samples collected plus 1 QAQC blank sample
- 0 samples above the 15ppb action level

Sayreville Middle School

- 22 first draw samples collected plus 1 QAQC blank sample
- 0 samples above the 15ppb action level

Sayreville High School

- 54 first draw samples collected plus 1 QAQC blank sample
- 0 samples above the 15ppb action level

Woodrow Wilson Elementary School

- 13 first draw samples collected plus 1 QAQC blank sample
- 0 samples above the 15ppb action level

The complete list of samples that exceeded the 15ppb limit can be found in Appendix A. The complete list of all sample results can be found in Appendix C. The laboratory results can be found in Appendix F.

Certain outlets could not or were not tested due to various reasons. The following table lists those locations and the reason why samples were not collected.

School	Sample Location	Reason for not testing.
Cheesequake Elementary	Hall across Rm 107	Not functional
Cheesequake Elementary	Hall across Rm 207	Not functional
Eisenhower Elementary	Kitchen Sink 2	Out of order
Eisenhower Elementary	Hall by Rm 16 BF	Not functional
Eisenhower Elementary	Room 7-13	sealed
Eisenhower Elementary	Main Office Rm 34	Not functional
Eisenhower Elementary	Nurse's Sink	Hand washing only
Eisenhower Elementary	By Exit B2 Hallway, Rm 16 - 32	Sealed
Truman Elementary	A Cluster, A Cluster A7	Hand washing only
Truman Elementary	Room C-1 – C-4	Sealed
Truman Elementary	Main Hallway Water fountain	Out of order
Samsel Upper Elementary	Room 233 - 236	Sealed
Samsel Upper Elementary	Rooms 335,348,358	Sealed
Sayreville Middle School	Hall by Boys Locker Room	Out of order
Sayreville High School	Hall by Rm D-17	Out of order
Sayreville High School	Nurse's Office	Out of order
Sayreville High School	Hall by Rm G-130	Out of order
Woodrow Wilson Elementary	Hall by Room 27	Out of order

Recommendations

On December 21-22, 2024, LEW Environmental Services, LLC. collected the first draw samples. We recommend the following actions.

Those outlets where the first draw sample tested below 15ppb are not considered to be elevated and no remediation is necessary.

For those outlets where the first draw sample exceeds 15ppb the following steps are recommended:

- 1) Immediately discontinue use of the outlets.
- 2) Conduct second draw (flush) samples on these outlets to further delineate source of contamination.

A complete list of recommendations per outlet can be found in Appendix B.

Additional Recommendations

- 1) Follow-up samples should be collected after any remediation efforts in order to determine the efficacy of the work.
- 2) Any of the inoperable/non-functioning outlets listed above that are brought back into service should be sampled.
- 3) Comply with all requirements set forth in NJAC 6A:26.

Appendix A Exceedances

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Eisenhower Elementary School	12/21/2024	1/8/2025	4	EES-S-4	33.3

Appendix B Recommendations

Building	Location	Remediation Recommendation
Eisenhower Elementary School	EES-S-4	Discontinue use and perform second draw sampling

Appendix C All Results

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Cheesequake Elementary School	12/22/2024	1/7/2025	1	CES-S-1	<1.00
Cheesequake Elementary School	12/22/2024	1/7/2025	2	CES-S-2	9.02
Cheesequake Elementary School	12/22/2024	1/7/2025	3	CES-S-3	1.25
Cheesequake Elementary School	12/22/2024	1/7/2025	4	CES-DW-4	<1.00
Cheesequake Elementary School	12/22/2024	1/7/2025	6	CES-DW-6	2.92
Cheesequake Elementary School	12/22/2024	1/7/2025	8	CES-S-8	7.63
Cheesequake Elementary School	12/22/2024	1/7/2025	9	CES-DW-SR	<1.00

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
E. Arleth Elementary School	12/21/2024	1/9/2025	1	EAE-S-1	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	2	EAE-FW-2	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	3	EAE-FW-3	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	4	EAE-WC-4	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	5	EAE-BF-5	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	6	EAE-S-6	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	7	EAE-S-7	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	8	EAE-WC-8	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	9	EAE-WC-9	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	10	EAE-BF-10	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	11	EAE-WC-11	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	12	EAE-BF-12	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	13	EAE-S-13	<1.00
E. Arleth Elementary School	12/21/2024	1/9/2025	14	EAE-WC-SR	<1.00

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Eisenhower Elementary School	12/21/2024	1/8/2025	1	EES-S-1	<1.00
Eisenhower Elementary School	12/21/2024	1/8/2025	3	EES-S-3	7.8
Eisenhower Elementary School	12/21/2024	1/8/2025	4	EES-S-4	33.3
Eisenhower Elementary School	12/21/2024	1/8/2025	5	EES-FW-5	<1.00
Eisenhower Elementary School	12/21/2024	1/8/2025	6	EES-WC-6	<1.00
Eisenhower Elementary School	12/21/2024	1/8/2025	15	EES-WC-15	<1.00
Eisenhower Elementary School	12/21/2024	1/8/2025	16	EES-BF-16	<1.00
Eisenhower Elementary School	12/21/2024	1/8/2025	37	EES-WC-SR	<1.00

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
H. S. Truman Elementary School	12/21/2024	1/8/2025	1	HTE-WC-1	<1.00
H. S. Truman Elementary School	12/21/2024	1/8/2025	2	HTE-BF-2	<1.00
H. S. Truman Elementary School	12/21/2024	1/8/2025	3	HTE-FW-3	<1.00
H. S. Truman Elementary School	12/21/2024	1/8/2025	4	HTE-S-4	2.74
H. S. Truman Elementary School	12/21/2024	1/8/2025	5	HTE-S-5	8.42
H. S. Truman Elementary School	12/21/2024	1/8/2025	6	HTE-WC-6	<1.00
H. S. Truman Elementary School	12/21/2024	1/8/2025	7	HTE-BF-7	<1.00
H. S. Truman Elementary School	12/21/2024	1/8/2025	8	HTE-S-8	3.9
H. S. Truman Elementary School	12/21/2024	1/8/2025	9	HTE-S-9	3.79
H. S. Truman Elementary School	12/21/2024	1/8/2025	10	HTE-S-10	3.32
H. S. Truman Elementary School	12/21/2024	1/8/2025	11	HTE-WC-11	<1.00
H. S. Truman Elementary School	12/21/2024	1/8/2025	12	HTE-BF-12	<1.00
H. S. Truman Elementary School	12/21/2024	1/8/2025	13	HTE-WC-13	<1.00
H. S. Truman Elementary School	12/21/2024	1/8/2025	14	HTE-BF-14	<1.00
H. S. Truman Elementary School	12/21/2024	1/8/2025	15	HTE-WC-SR	<1.00

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Jesse Selover School	12/21/2024	1/8/2025	1	SES-S-1	3.88
Jesse Selover School	12/21/2024	1/8/2025	2	SES-WC-2	<1.00
Jesse Selover School	12/21/2024	1/8/2025	3	SES-BF-3	<1.00
Jesse Selover School	12/21/2024	1/8/2025	4	SES-WC-4	<1.00
Jesse Selover School	12/21/2024	1/8/2025	5	SES-BF-5	<1.00
Jesse Selover School	12/21/2024	1/8/2025	6	SES-WC-SR	<1.00

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Samsel Upper Elementary	12/22/2024	1/9/2025	5	SUE-S-5	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	6	SUE-S-6	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	7	SUE-S-7	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	8	SUE-WC-8	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	9	SUE-BF-9	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	10	SUE-WC-10	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	11	SUE-BF-11	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	12	SUE-WC-12	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	13	SUE-BF-13	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	14	SUE-S-14	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	15	SUE-S-15	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	17	SUE-FW-17	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	18	SUE-WC-18	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	19	SUE-BF-19	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	20	SUE-WC-20	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	21	SUE-BF-21	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	24	SUE-WC-24	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	25	SUE-WC-25	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	26	SUE-BF-26	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	27	SUE-S-27	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	28	SUE-S-28	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	29	SUE-S-29	6.54
Samsel Upper Elementary	12/22/2024	1/9/2025	30	SUE-WC-30	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	31	SUE-WC-31	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	32	SUE-BF-32	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	33	SUE-WC-33	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	34	SUE-BF-34	<1.00
Samsel Upper Elementary	12/22/2024	1/9/2025	35	SUE-WC-SR	<1.00


Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
SayrevillenHigh School	12/22/2024	1/10/2025	1	MHS-WC-1	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	2	MHS-BF-2	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	3	MHS-WC-3	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	4	MHS-BF-4	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	5	MHS-WC-5	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	6	MHS-BF-6	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	7	MHS-S-7	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	8	MHS-S-8	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	9	MHS-S-9	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	10	MHS-S-10	2.44
SayrevillenHigh School	12/22/2024	1/10/2025	11	MHS-S-11	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	12	MHS-S-12	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	13	MHS-S-13	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	14	MHS-S-14	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	15	MHS-S-15	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	16	MHS-S-16	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	17	MHS-S-17	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	18	MHS-S-18	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	19	MHS-S-19	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	20	MHS-S-20	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	21	MHS-S-21	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	22	MHS-WC-22	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	24	MHS-WC-24	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	25	MHS-IM-25	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	26	MHS-WC-26	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	28	MHS-BF-28	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	29	MHS-WC-29	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	30	MHS-BF-30	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	31	MHS-WC-31	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	32	MHS-BF-32	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	33	MHS-WC-33	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	34	MHS-BF-34	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	35	MHS-FW-35	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	36	MHS-WC-36	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	37	MHS-BF-37	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	38	MHS-FW-38	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	39	MHS-WC-39	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	40	MHS-BF-40	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	41	MHS-WC-41	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	42	MHS-BF-42	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	45	MHS-WC-45	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	46	MHS-BF-46	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	47	MHS-WC-47	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	48	MHS-BF-48	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	49	MHS-WC-49	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	50	MHS-WC-50	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	51	MHS-S-51	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	52	MHS-FW-52	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	53	MHS-FW-53	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	54	MHS-WC-54	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	55	MHS-BF-55	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	56	MHS-WC-56	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	57	MHS-BF-57	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	60	MHS-S-60	<1.00
SayrevillenHigh School	12/22/2024	1/10/2025	61	MHS-WC-SR	<1.00

Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Sayreville Middle School	12/21/2024	1/8/2025	2	SMS-WC-2	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	3	SMS-BF-3	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	4	SMS-S-4	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	5	SMS-WC-5	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	6	SMS-BF-6	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	7	SMS-FP-7	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	8	SMS-WC-8	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	9	SMS-BF-9	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	10	SMS-WC-10	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	11	SMS-BF-11	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	12	SMS-WC-12	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	13	SMS-BF-13	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	14	SMS-WC-14	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	15	SMS-BF-15	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	16	SMS-WC-16	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	17	SMS-WC-17	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	18	SMS-WC-18	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	19	SMS-BF-19	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	20	SMS-WC-20	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	21	SMS-BF-21	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	23	SMS-IM-23	<1.00
Sayreville Middle School	12/21/2024	1/8/2025	24	SMS-WC-SR	<1.00


Building	DateCollected	AnalysisDate	Sample ID	Sample Description	Concentration (ppb)
Wilson Elementary School	12/21/2024	1/8/2025	1	WE-WC-1	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	2	WE-BF-2	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	3	WE-WC-3	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	4	WE-BF-4	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	5	WE-S-5	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	6	WE-S-6	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	7	WE-S-7	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	8	WE-WC-8	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	9	WE-BF-9	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	10	WE-WC-10	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	11	WE-BF-11	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	12	WE-WC-12	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	13	WE-BF-13	<1.00
Wilson Elementary School	12/21/2024	1/8/2025	15	WE-WC-SR	<1.00

Appendix D Floor Plan(s)

ARLETH

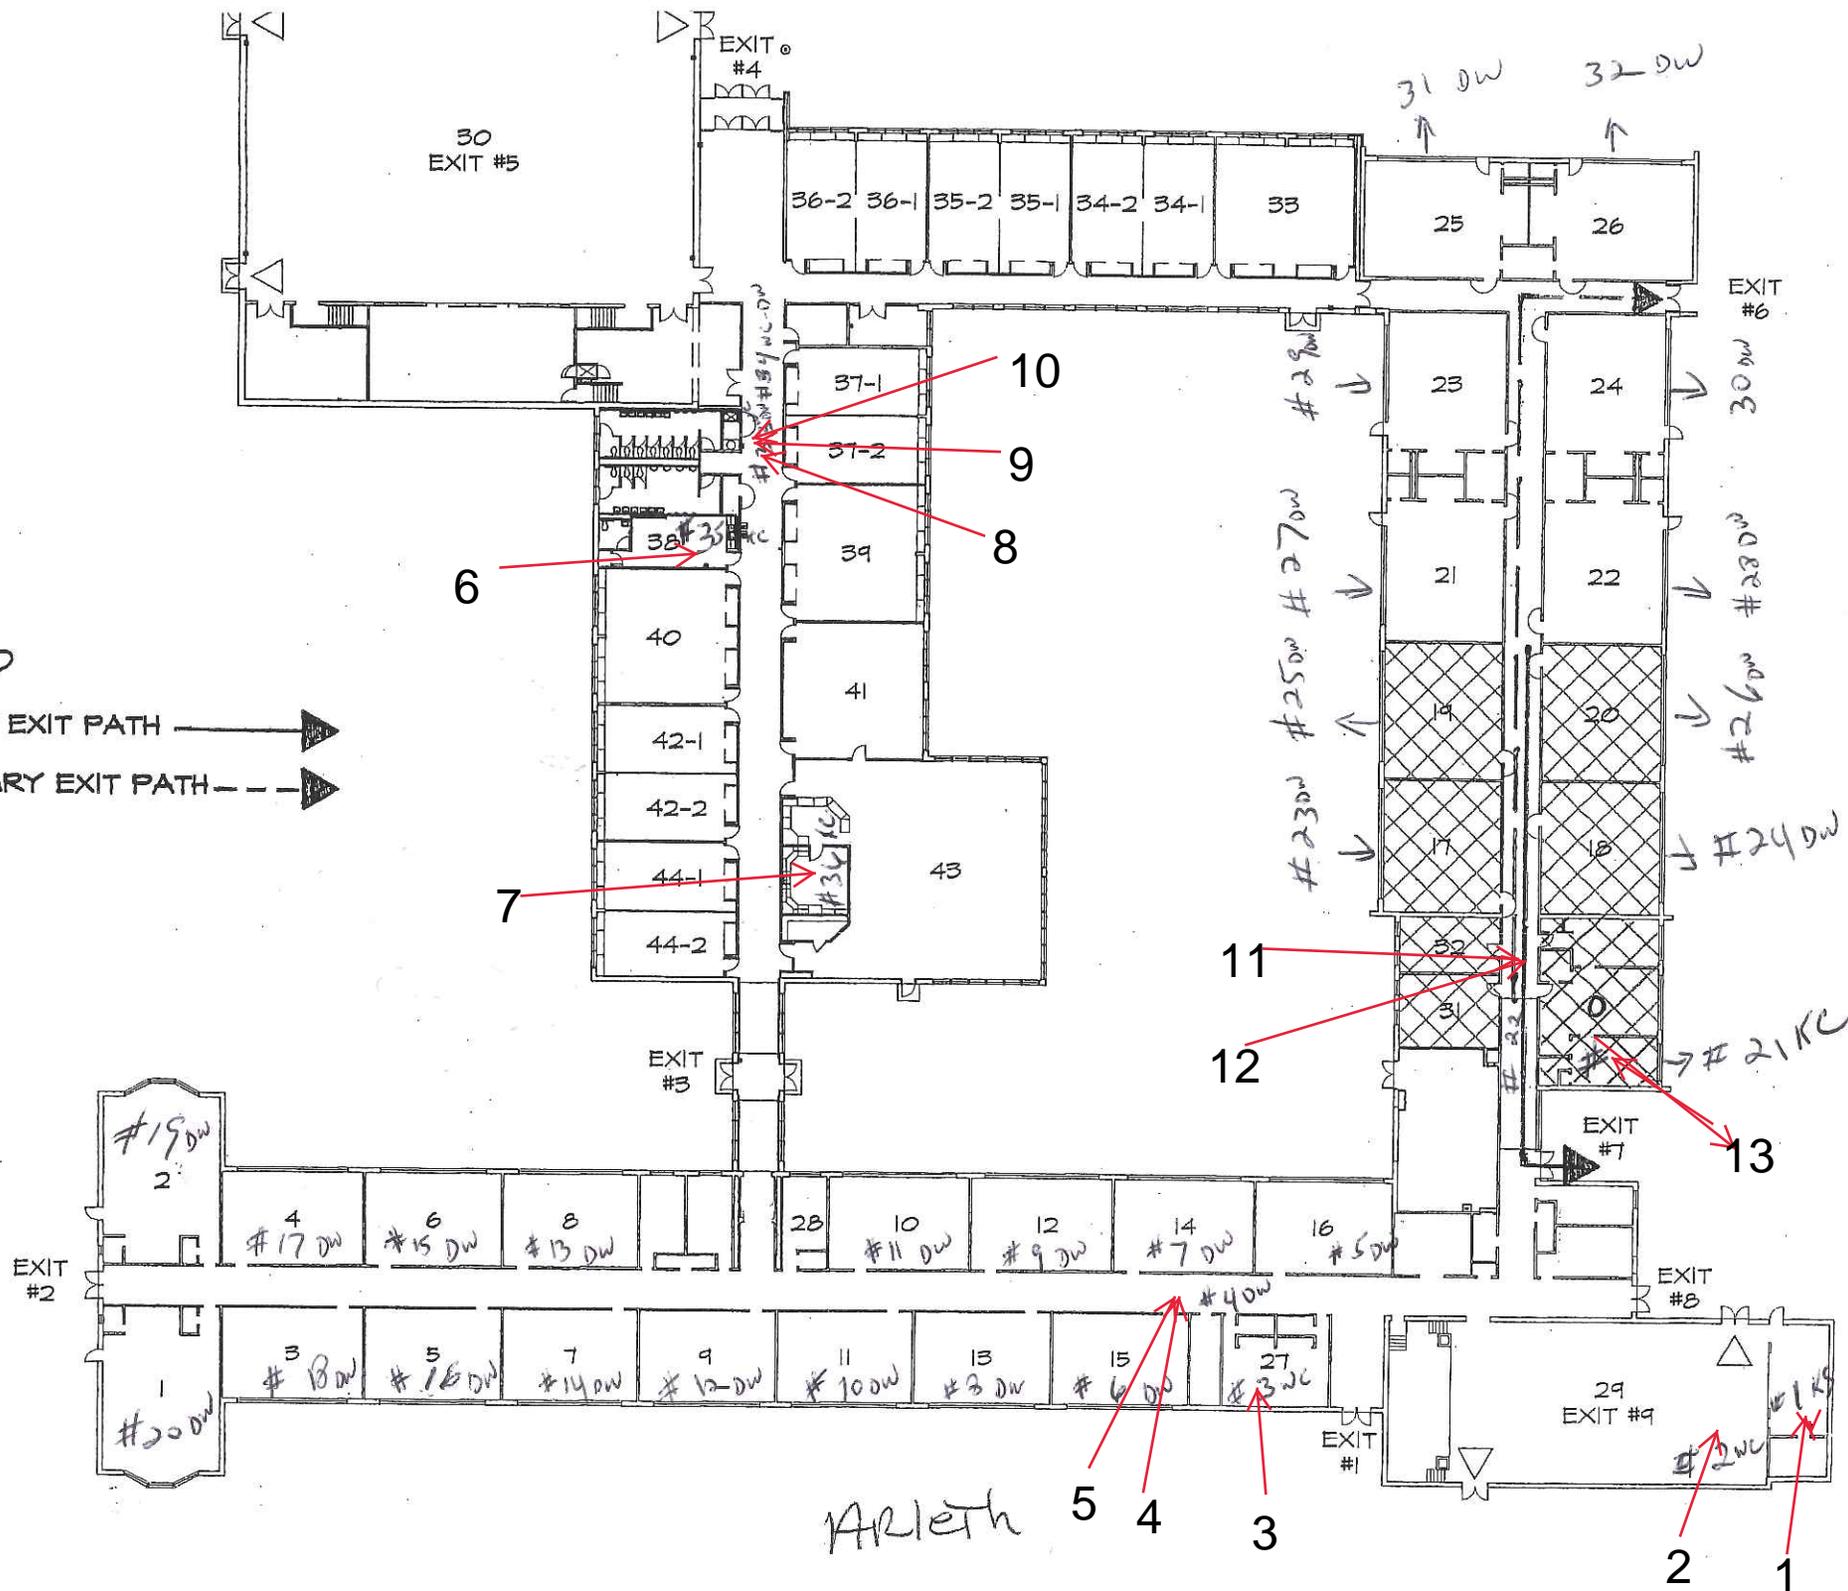

ARLETH

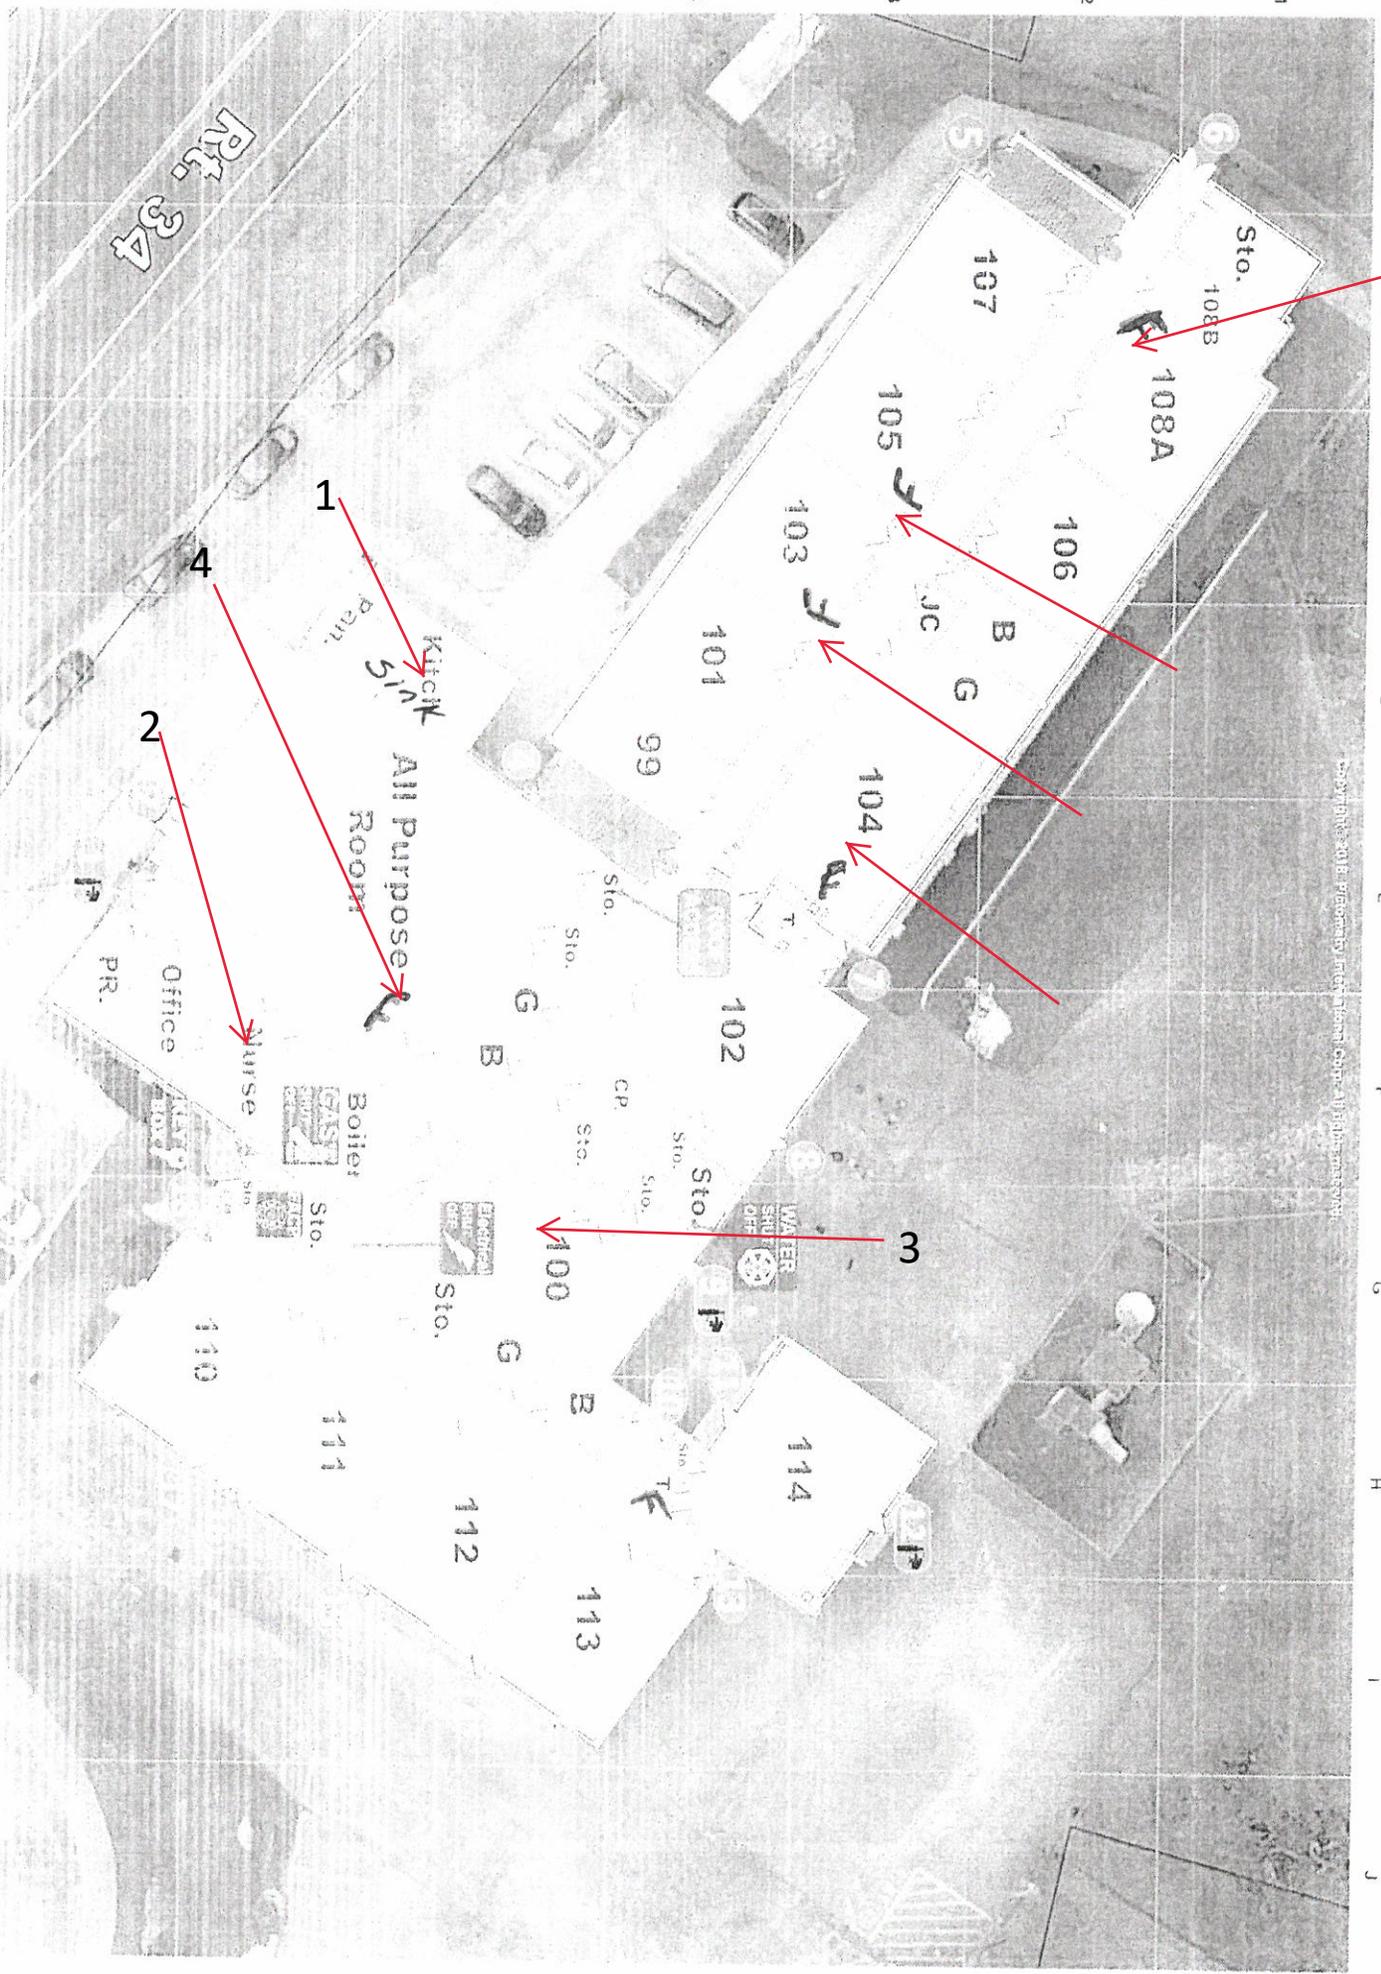

10 YARD GRID

First Floor
Cheesequake Elementary School
111 N1 Route 34 Malawan N107727

F = Water Fountain





Copyright © 2018, Plans.com, Inc. All rights reserved.

10 YARD GRID



Second Floor
Cheesequake Elementary School
111 N1 Route 34 Matawan NJ 07747

F = Water Fountain



Dwight D. Eisenhower School


601 ERNSTON ROAD
PARLIN, NEW JERSEY 08859

FIRE DRILL *****

Last Teacher Out In
Each Area Must Close
All Doors!

Turn Off Lights &
All Electrical Equip.

FIRE DRILL EXITS

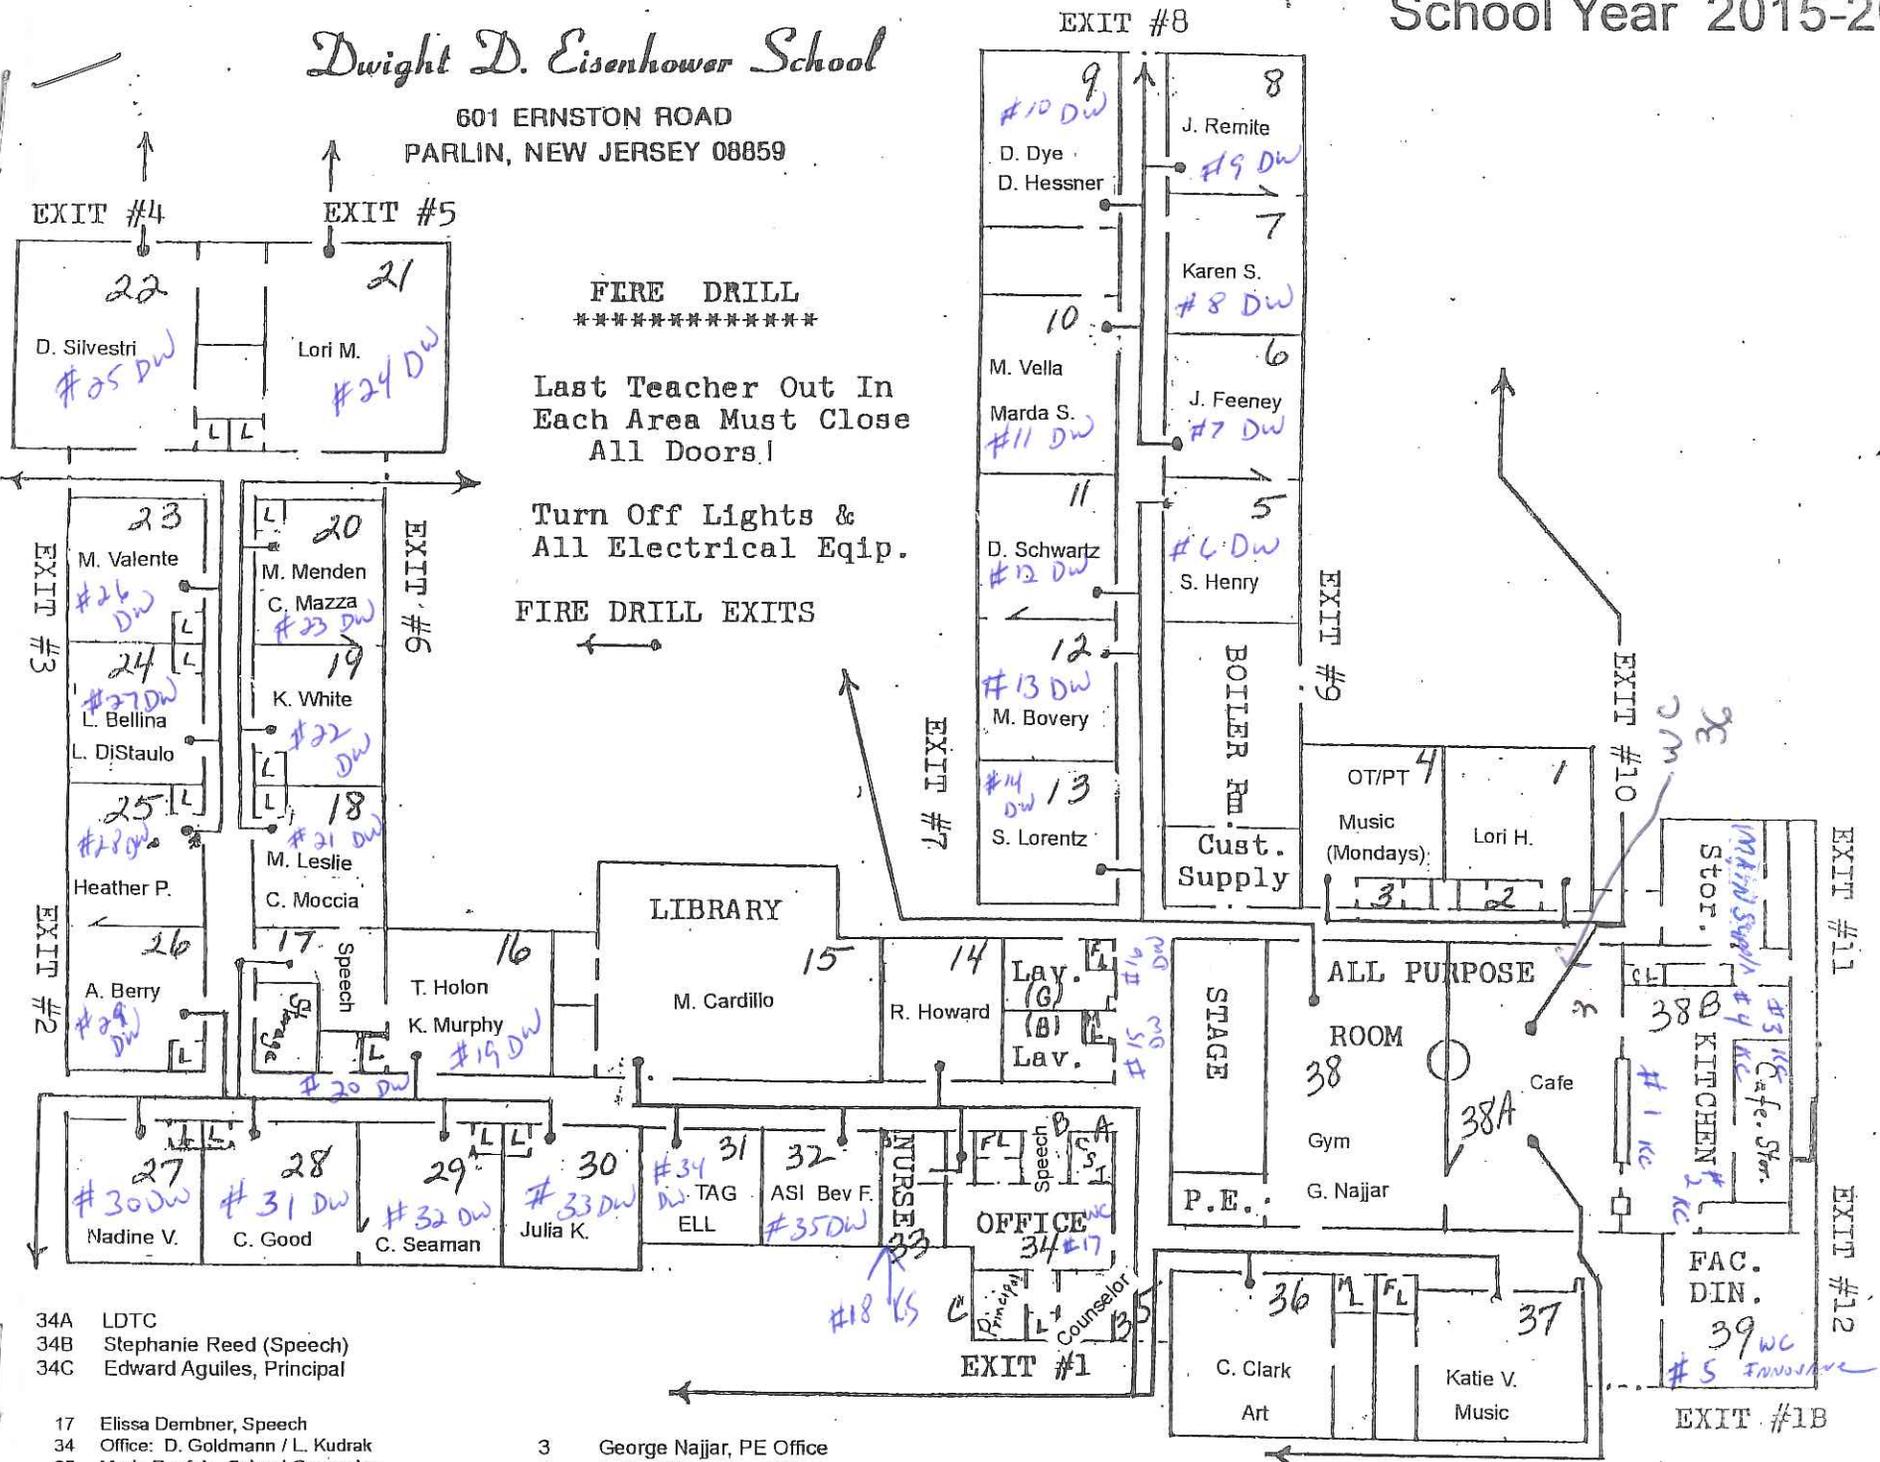

- 34A LDTC
- 34B Stephanie Reed (Speech)
- 34C Edward Aguiles, Principal

- 17 Elissa Dembner, Speech
- 34 Office: D. Goldmann / L. Kudrak
- 35 Maria Runfola, School Counselor
- 2 Walter Pabon, Tech

- 3 George Najjar, PE Office
- 4 Laura Mihalenko, TAG
- 4 Stephanie Gottdenker, ELL


2004 Professional Address:
 2815 S. 20th St.
 Charlotte, NC 28216
 Phone: (704) 541-1000
 Fax: (704) 541-1001
 Website: www.harsco.com

2004 Professional Address:
 2815 S. 20th St.
 Charlotte, NC 28216
 Phone: (704) 541-1000
 Fax: (704) 541-1001
 Website: www.harsco.com



SAYREVILLE
 BOARD OF
 EDUCATION
 APPROVED
 WADSWORTH
 HIGH SCHOOL
 PROJECT NO. 03-0000

DATE	DESCRIPTION

SECOND FLOOR PLAN
 SCALE: AS SHOWN (1/8" = 1'-0")
 DRAWN BY: [Name]
 A0.2

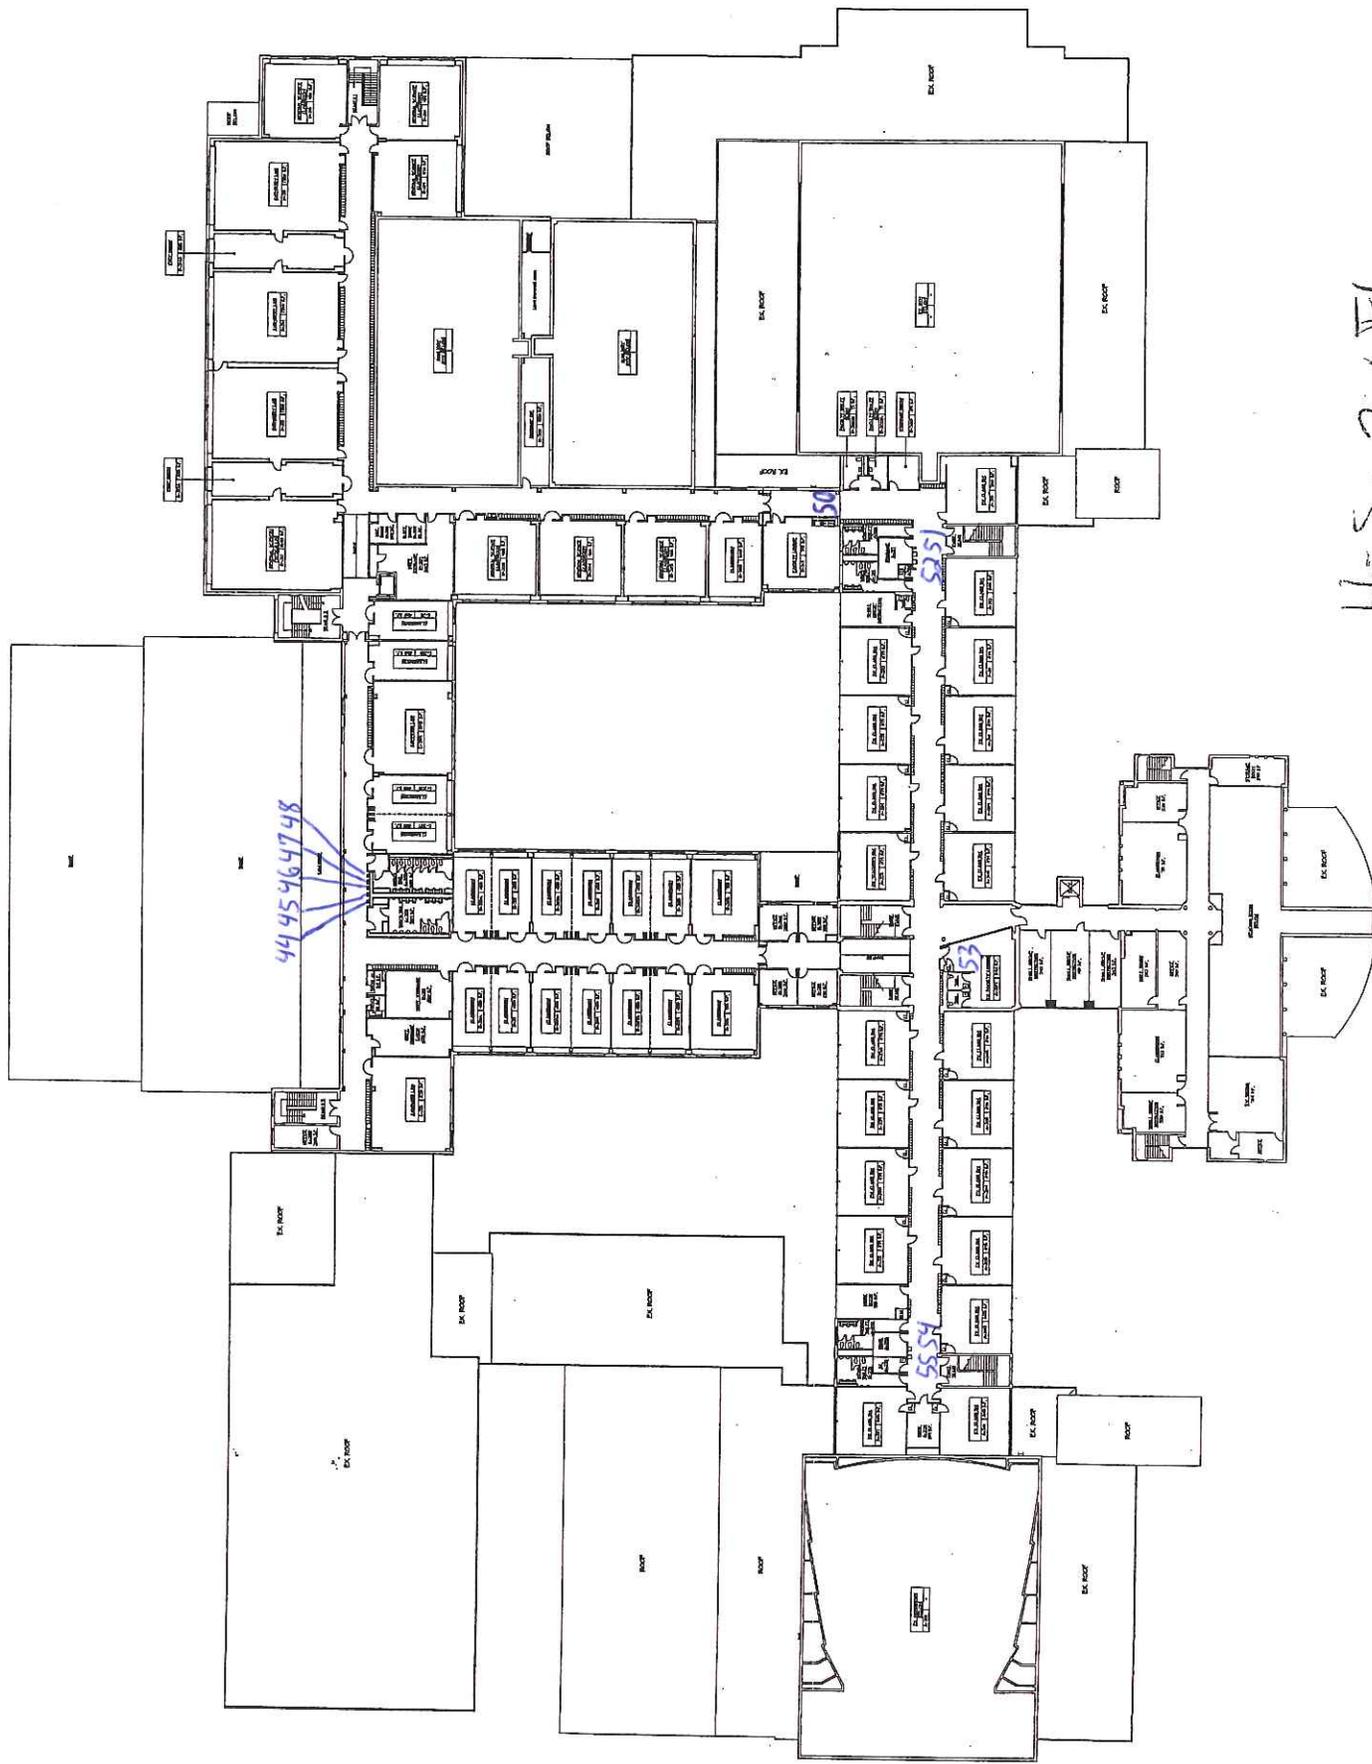

H.S. 2nd FL

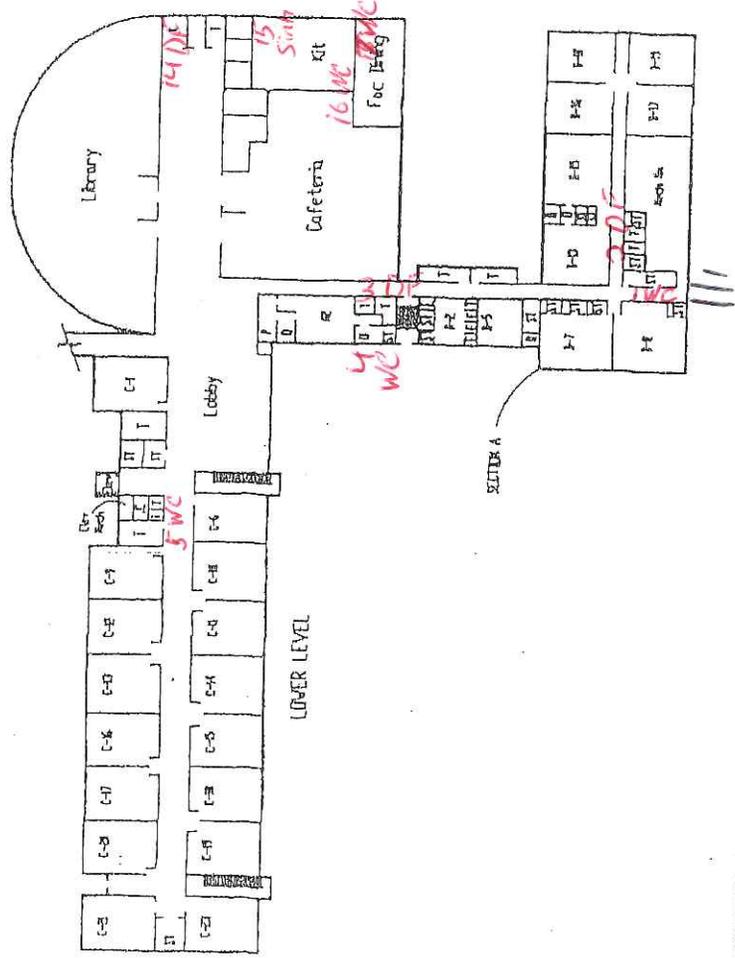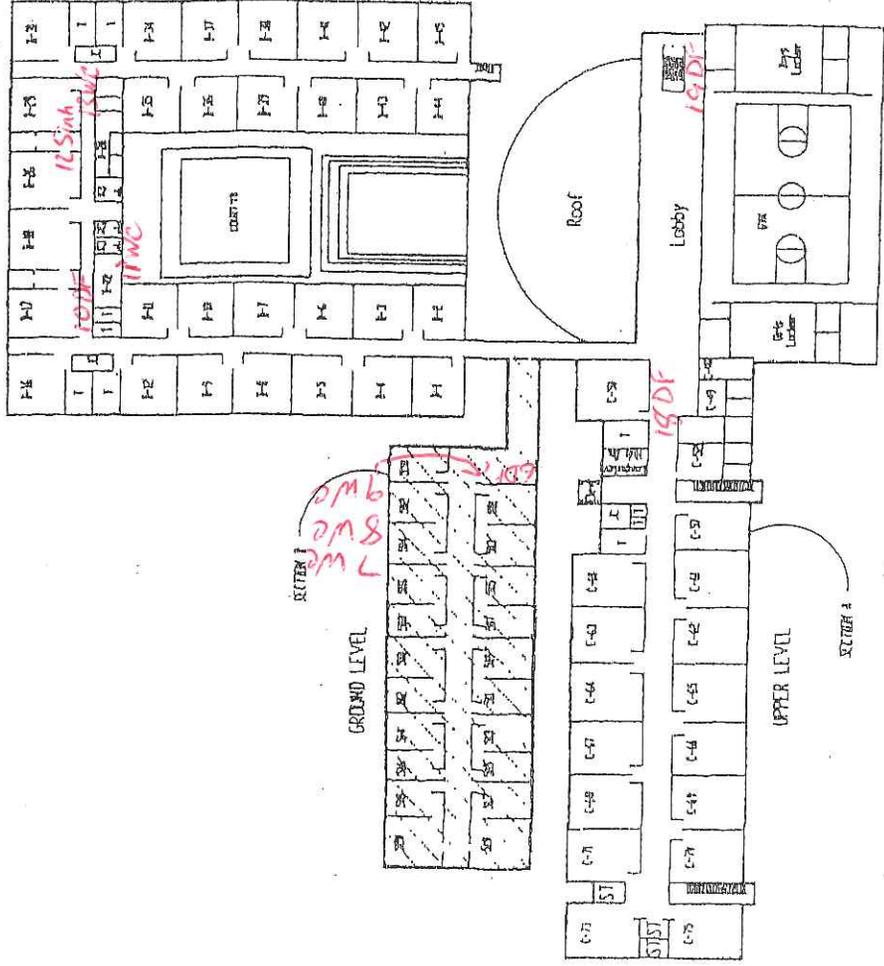

MS

RIVARDO - SCHNITZER - CAPAZZI
 ARCHITECTS
 508 ANDERSON AVENUE, SUITE 202
 CLIFFSIDE PARKING 07040

PROJECT NAME:

LRFP - SAYREVILLE DISTRICT

SKETCH TITLE:

MIDDLE SCHOOL

JOB NO. 21-00-000

SCALE: NTS

DATE: 12/14/00

DRAWN: GAC

CHECKED: GAC

SKETCH NO.:

SK-3

EXIT TO GRADE

STAIR-2

①
JES


EXIT TO GRADE

CAFETERIA
527-OCCUPANTS

EXIT TO GRADE

EXIT TO GRADE


STAIR-1

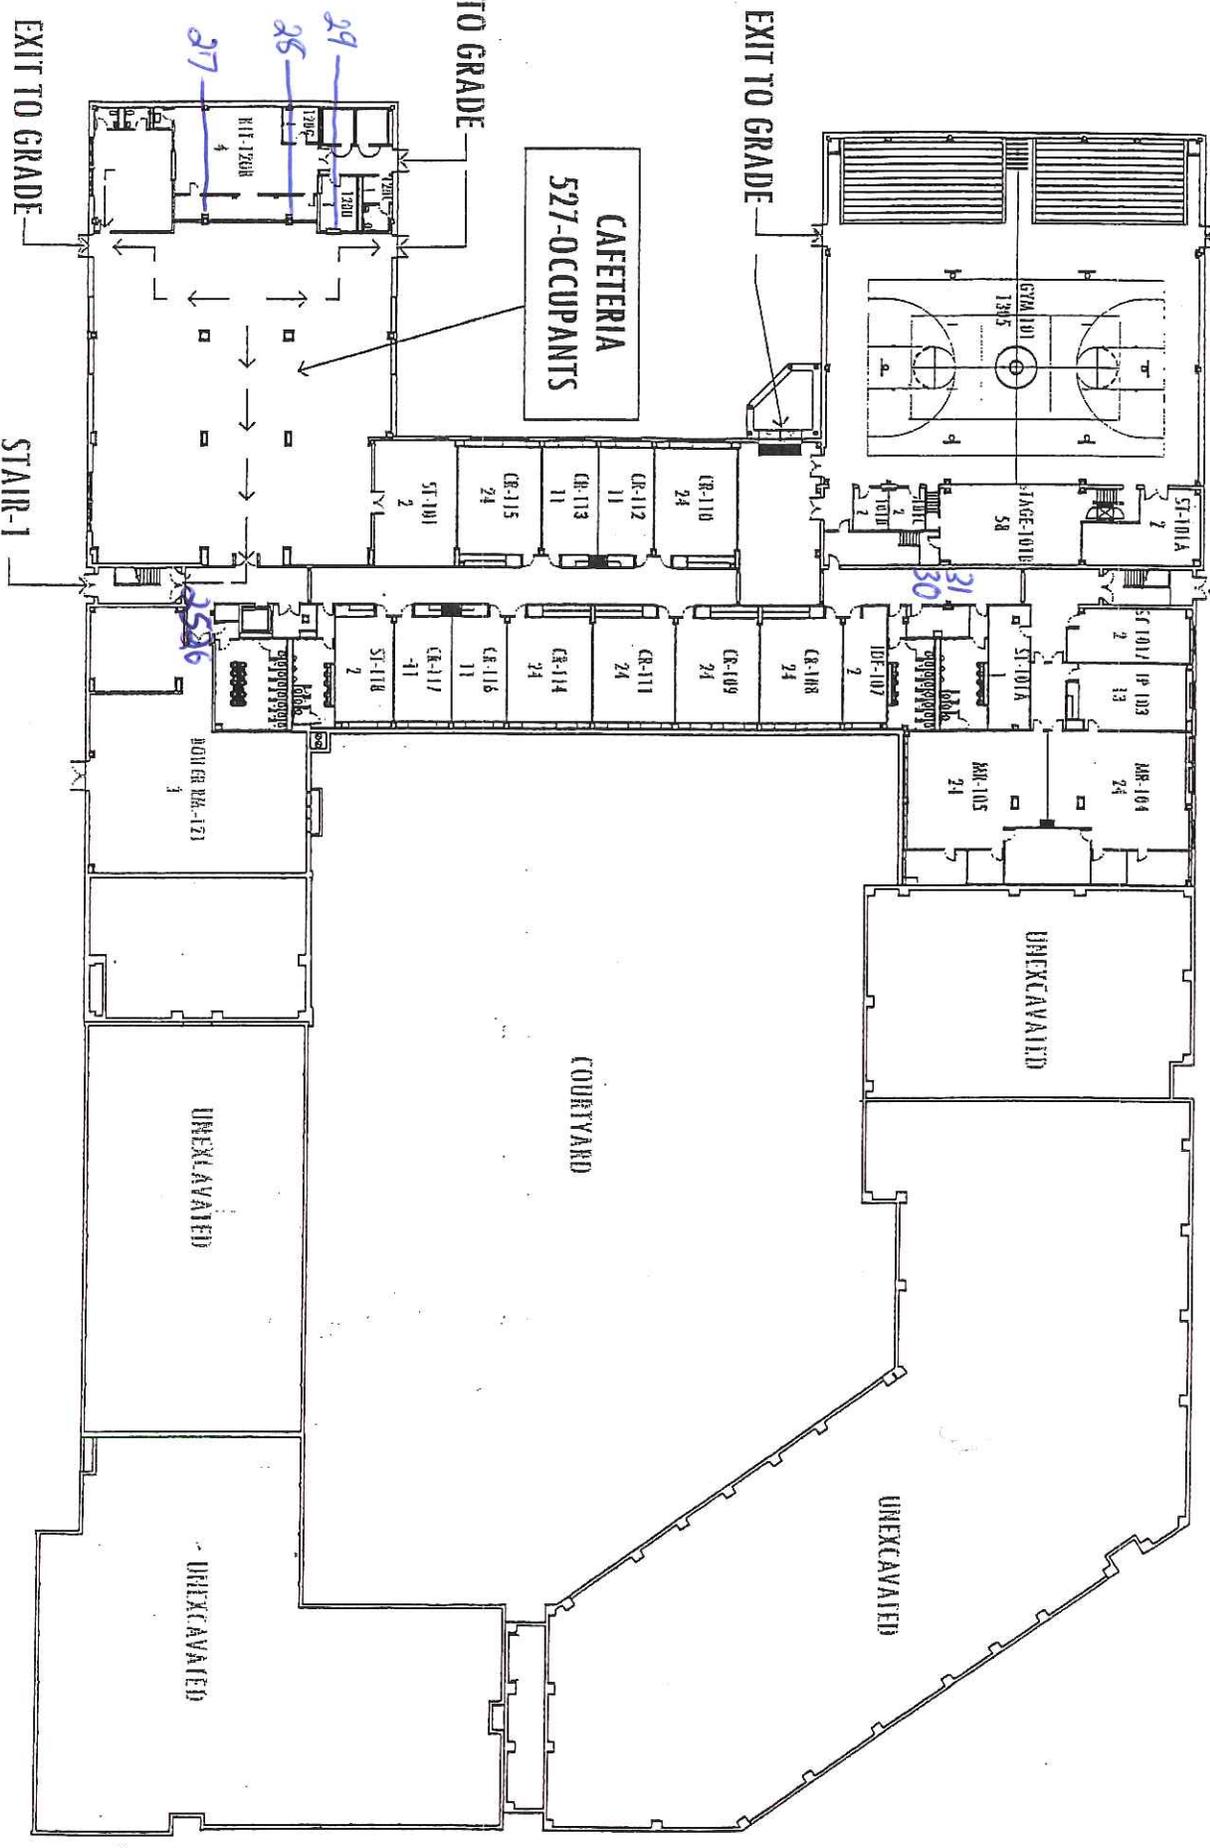

SOES

201
11-OC

201
11-OCCUPANTS

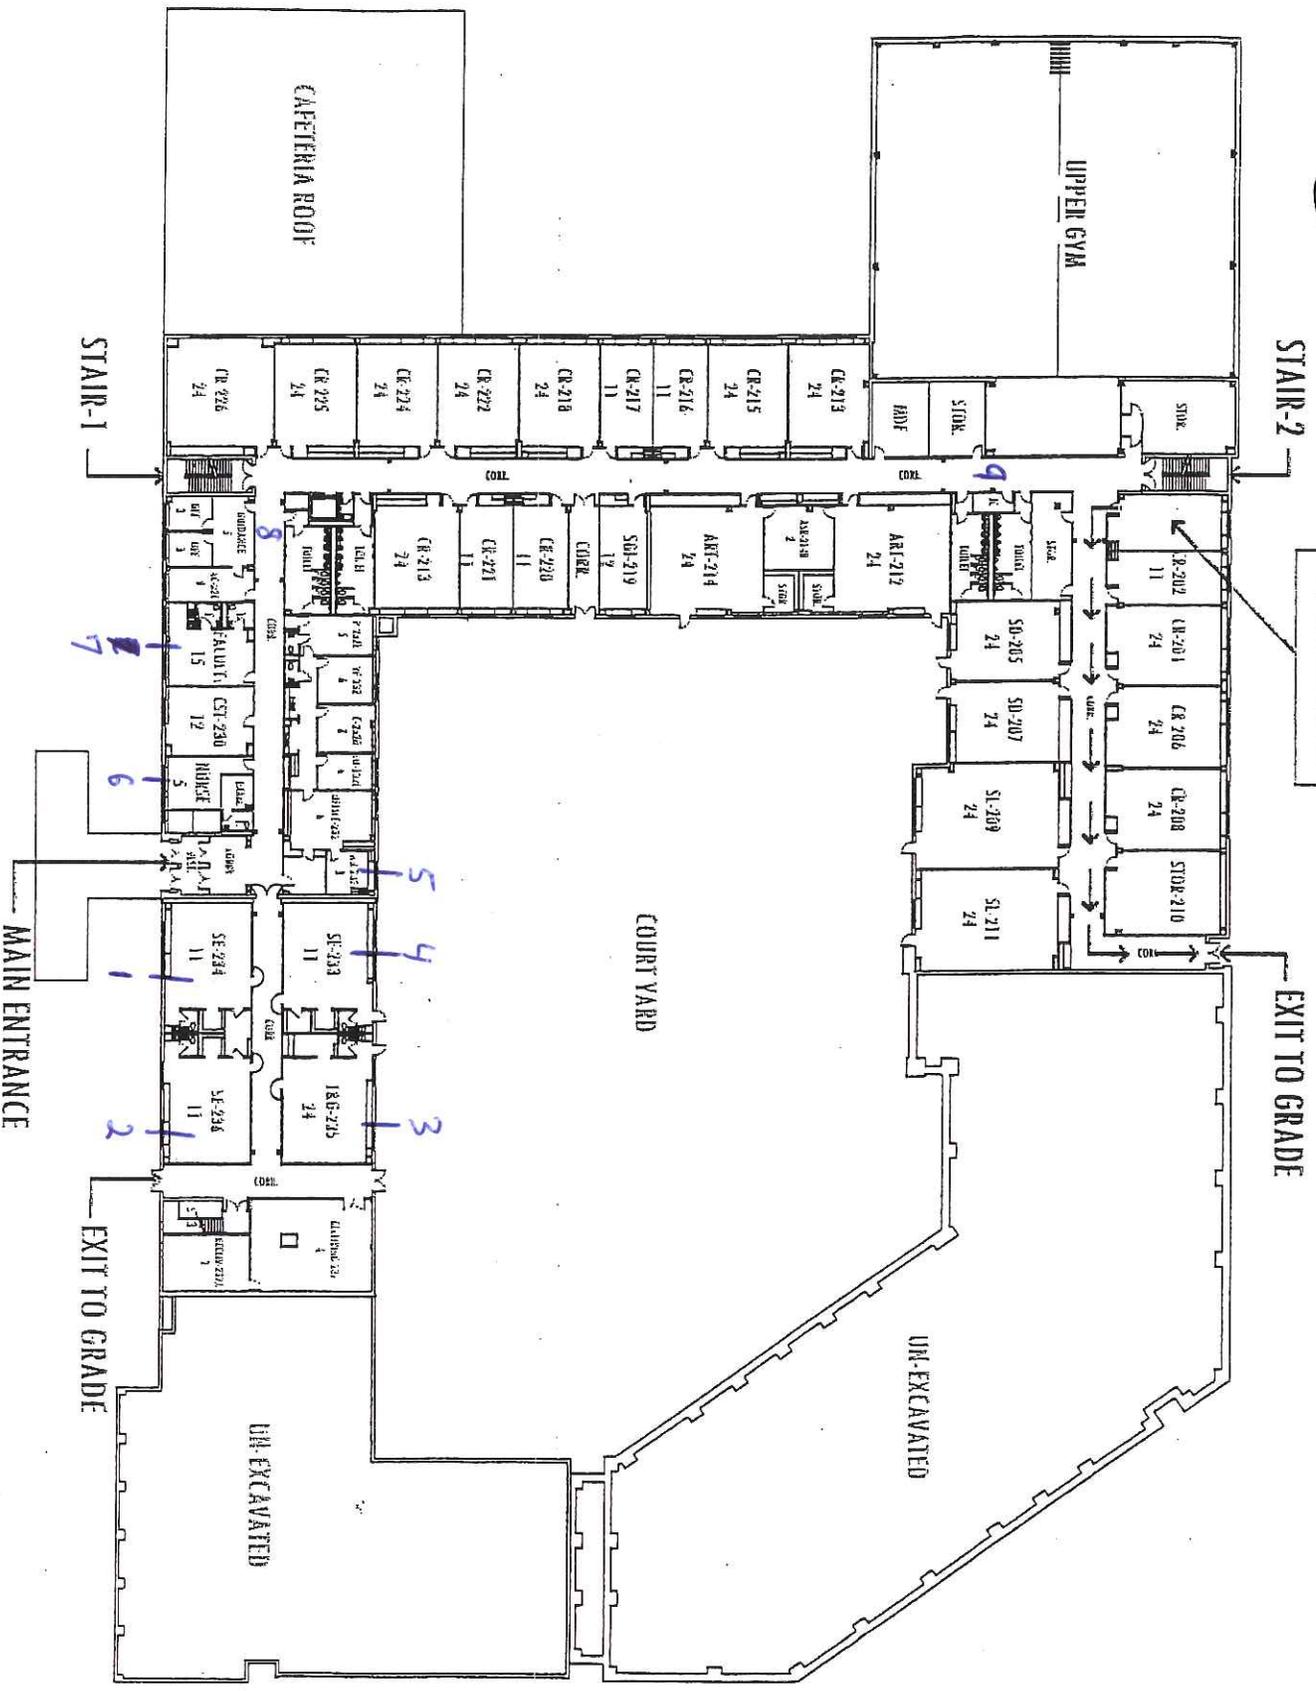

STAIR-1

STAIR-2

MAIN ENTRANCE

EXIT TO GRADE

EXIT TO GRADE

CATERERIA ROOF

UPPER GYM

COURTYARD

UN-EXCAVATED

UN-EXCAVATED

STAIR-1

STAIR-2

MAIN ENTRANCE

EXIT TO GRADE

EXIT TO GRADE

CATERERIA ROOF

UPPER GYM

COURTYARD


UN-EXCAVATED


UN-EXCAVATED

3
V/S


see floor plans

302
11-OCCUPANTS

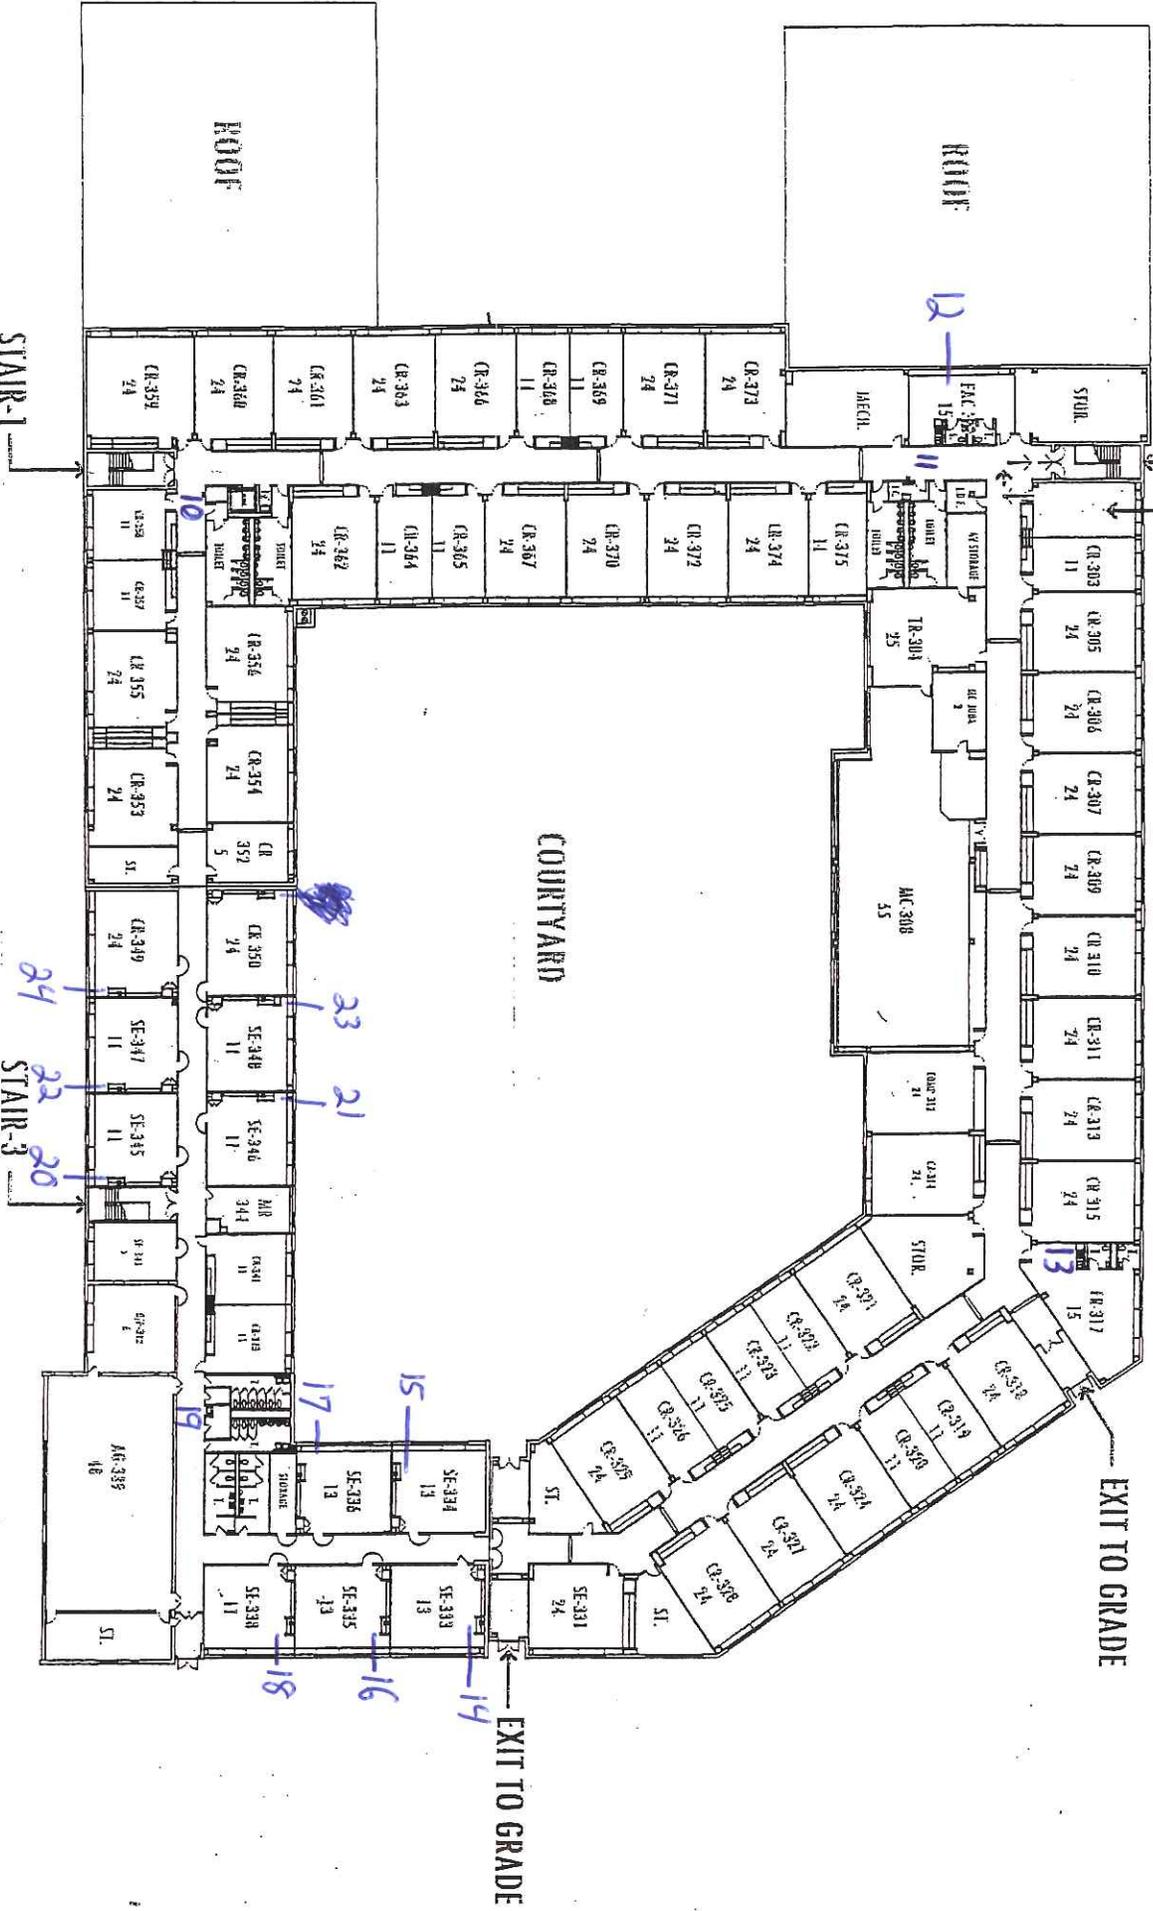

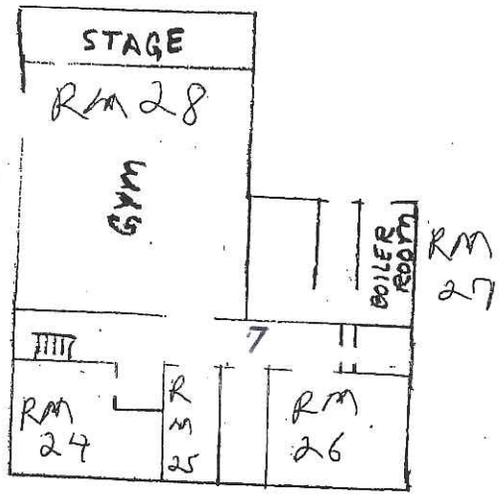

LOWER FLOOR

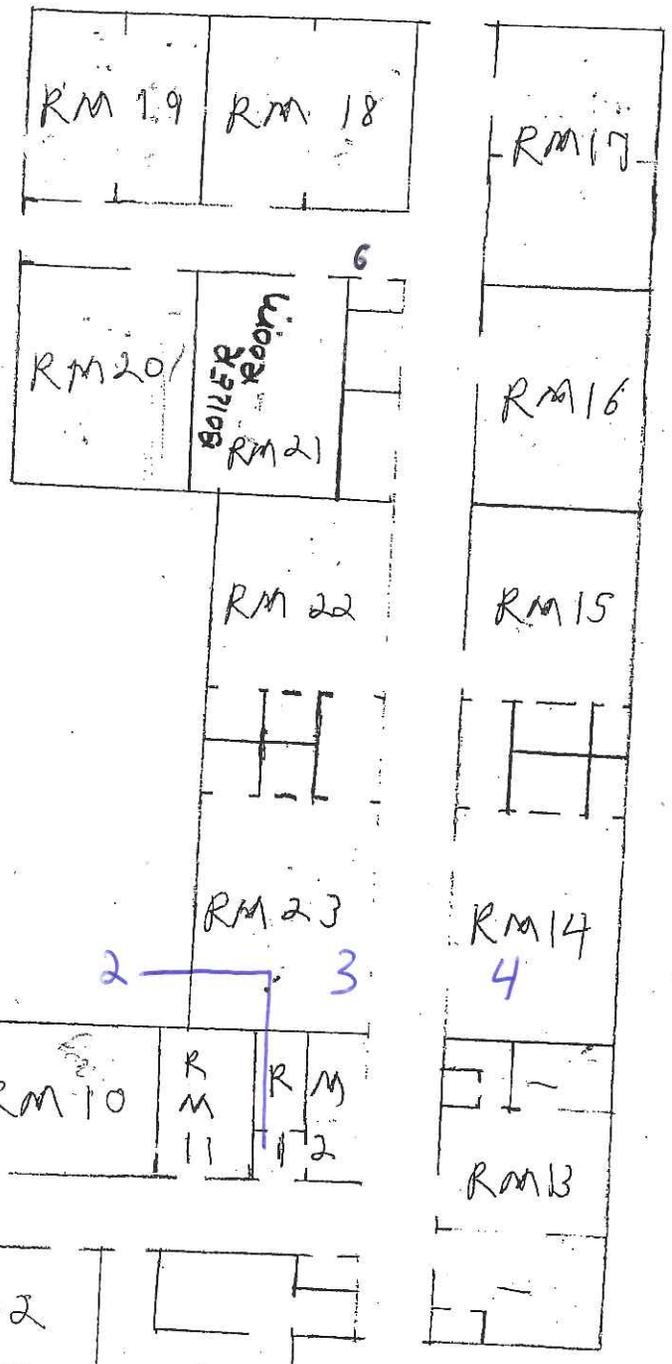

FIRST FLOOR

SELOVER SCHOOL

SECTION A





Truman

RIVARDO • SCHNITZER • CAPAZZI ARCHITECTS • PLANNERS 898 ANDERSON AVENUE, SUITE 302 CLIFFSIDE PARK, NJ 07010	PROJECT NAME: LRFP - SAYREVILLE DISTRICT		SKETCH NO. 	
	SKETCH TITLE: TRUMAN SCHOOL			
JOB NO. 21-00-000	SCALE: NTS	DATE: 12/14/00	DRAWN: GAC	CHECKED: GAC

SK-T

SECTION A

SECTION A

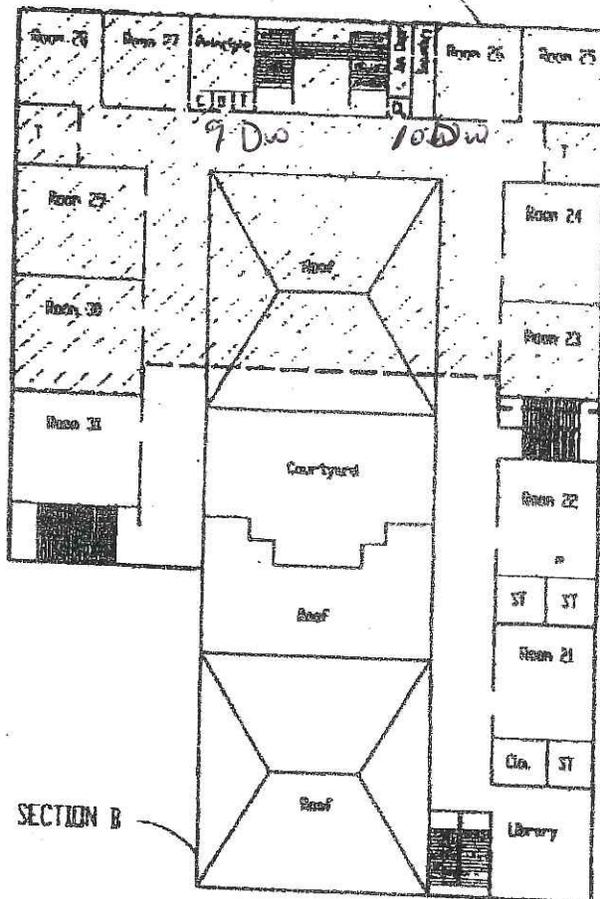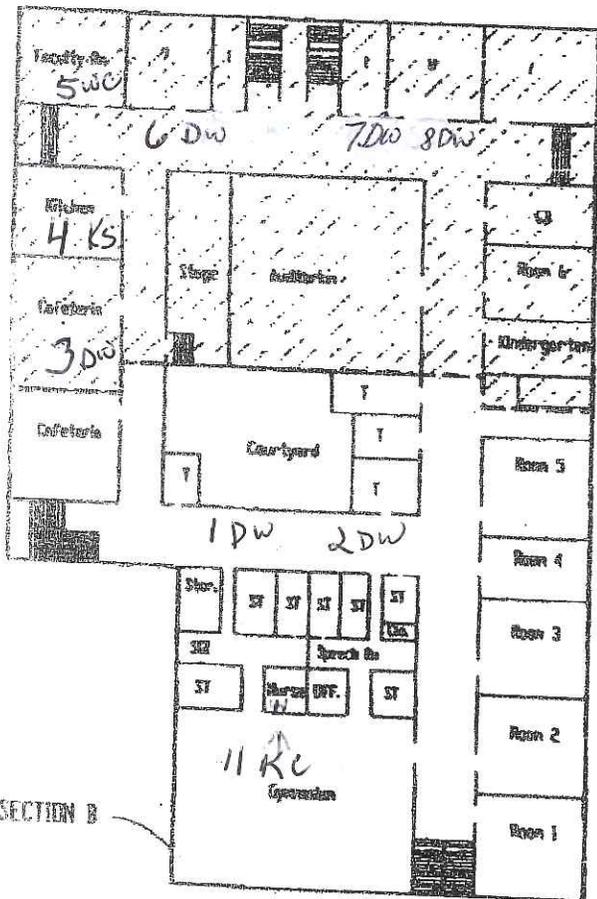

FIRST FLOOR

SECOND FLOOR

FRIVARDO - SCHNITZER - CAPAZZI
 ARCHITECTS PLANNERS
 300 ANDERSON AVENUE, SUITE 200
 CLIFFSIDE PARK, N.J. 07010

PROJECT NAME
LRFP - SAYREVILLE DISTRICT
 SKETCH TITLE
WILSON SCHOOL

SKETCH NO.

AK-8

Appendix E Water Outlet Inventory(ies)

Attachment C - Drinking Water Outlet Inventory

(To be completed for each school)

Name of School: Samsel Upper Elementary

Address: 298 Ernston Road, Sayreville NJ

Grade Levels: 4-5

Year School Constructed: 1960

Renovations/Additions: 2004

Individual school project officer Name/Signature: _____

Date completed: _____

#[1]	Type	Location	Code	Operational [2] (Y/N)	Signs of Corrosion [3] (Y/N)	Filter [4] (Y/N)	Brass Fittings, Faucets or valves? (Y/N)	Aerator/ Screen (Y/N)	Motion Activated (Y/N)	Chiller (Y/N)	Water Cooler		Comments
											Make	Model	
1	Bubbler	Room 234	SUE-B-1	Yes	No	No	Yes	Yes	No	No	bubbler		Sealed
2	Bubbler	Room 236	SUE-B-2	Yes	No	No	Yes	Yes	No	No	Bubbler		Sealed
3	Bubbler	Room 235	SUE-B-3	Yes	No	No	Yes	Yes	No	No	Bubbler		Sealed
4	Bubbler	Room 233	SUE-B-4	Yes	No	No	Yes	Yes	No	No	Bubbler		Sealed
5	Sink	Office	SUE-S-5	Yes	No	No	Yes	Yes	No	No			
6	Sink	Nurse's Office	SUE-S-6	Yes	No	No	Yes	Yes	No	No			
7	Sink	Faculty Room 229	SUE-S-7	Yes	No	No	Yes	Yes	No	No			
8	Water fountain	Hall by Rm 227	SUE-WC-8	Yes	No	No	No	Yes	No	Yes	Elkay	EZFS8-1D	
9	Bottle Filler	Hall by Rm 227	SUE-BF-9	Yes	No	Yes	No	Yes	No	Yes	Elkay	EZFS8-1A	
10	Water fountain	Hall across Rm 238	SUE-WC-10	Yes	No	No	No	Yes	No	Yes	Elkay	EZFS8-1A	
11	Bottle Filler	Hall across Rm 238	SUE-BF-11	Yes	No	Yes	No	Yes	No	Yes	Elkay	EZFS8-1A	
12	Water fountain	Hall across Rm 376	SUE-WC-12	Yes	No	No	Yes	Yes	No	No			
13	Bottle Filler	Hall across Rm 376	SUE-BF-13	Yes	No	Yes	Yes	Yes	No	No			
14	Sink	Faculty Room 377	SUE-S-14	Yes	No	No	Yes	Yes	No	No			
15	Sink	Faculty Room 317	SUE-S-15	Yes	No	No	Yes	Yes	No	No			
16	Bubbler	Rm 335	SUE-B-16	Yes	No	No	Yes	Yes	No	No	Bubbler		Sealed
17	Filtered Water	Rm 336	SUE-FW-17	Yes	No	Yes	Yes	Yes	No	No	Quench		
18	Water fountain	Hall across Rm 339	SUE-WC-18	Yes	No	No	Yes	Yes	No	No	Bubbler		
19	Bottle Filler	Hall across Rm 339	SUE-BF-19	Yes	No	Yes	Yes	Yes	No	No	Elkay		
20	Water fountain	Hall across Rm 358	SUE-WC-20	Yes	No	No	Yes	Yes	No	No	Bubbler		
21	Bottle Filler	Hall across Rm 358	SUE-BF-21	Yes	No	Yes	Yes	Yes	No	No	Elkay		
22	water fountain	Rm 358	22	Yes	No	No	Yes	Yes	No	No	Bubbler		Sealed
23	Water fountain	Rm 348	23	Yes	No	No	Yes	Yes	No	No	Bubbler		Sealed
24	Water fountain	Hall by Rm 121	SUE-WC-24	Yes	No	No	Yes	Yes	No	No	Bubbler		
25	Water fountain	Hall by Rm 121	SUE-WC-25	Yes	No	No	No	Yes	No	Yes	Elkay	WC-EZFSTL 8	
26	Bottle Filler	Hall by Rm 121	SUE-BF-26	Yes	No	No	No	Yes	No	Yes	Elkay	WC-EZFSTL 8	
27	Sink	Kitchen	SUE-S-27	Yes	No	No	Yes	Yes	No	No			
28	Sink	Kitchen	SUE-S-28	Yes	No	No	Yes	Yes	No	No			
29	Sink	Kitchen	SUE-S-29	Yes	No	No	Yes	Yes	No	No			
30	Water fountain	Hall by gym	SUE-WC-30	Yes	No	No	No	No	No	Yes	Elkay	WC- EZFSTL8	

Attachment C - Drinking Water Outlet Inventory

(To be completed for each school)

Name of School: Sayreville War Memorial High School

Address: 820 Washington Road.

Grade Levels: 9-12

1962

Renovations/Additions: 1978 1991 2010

Individual school project officer Name/Signature: _____

Date completed: _____

#[1]	Type	Location	Code	Operational [2] (Y/N)	Signs of Corrosion [3] (Y/N)	Filter [4] (Y/N)	Brass Fittings, Faucets or valves? (Y/N)	Aerator/Screen (Y/N)	Motion Activated (Y/N)	Chiller (Y/N)	Water Cooler		Comments
											Make	Model	
1	Water cooler	Hall across cafe	MHS-WC-1	Yes	No	No	No	Yes	No	Yes			
2	Bottle Filler	Hall across cafe	MHS-BF-2	Yes	No	No	No	Yes	No	Yes	Elkay		
3	Water cooler	Hall across cafe	MHS-WC-3	Yes	No	No	No	Yes	No	Yes			
4	Bottle Filler	Hall across cafe	MHS-BF-4	Yes	No	No	No	Yes	No	Yes	Elkay		
5	Water cooler	Hall across cafe	MHS-WC-5	Yes	No	No	No	Yes	No	Yes			
6	Bottle Filler	Hall across cafe	MHS-BF-6	Yes	No	No	No	Yes	No	Yes	Elkay		
7	Sink	Faculty Dining (Rm B17)	MHS-S-7	Yes	No	No	No	Yes	No	Yes			
8	KitchenSink	Kitchen	MHS-S-8	Yes	No	No	Yes	Yes	No	No			
9	Kitchensink	Kitchen	MHS-S-9	Yes	No	No	Yes	Yes	No	No			
10	Kitchensink	Kitchen	MHS-S-10	Yes	No	No	Yes	Yes	No	No			
11	Kitchensink	Kitchen	MHS-S-11	Yes	No	No	Yes	Yes	No	No			
12	Kitchensink	Kitchen	MHS-S-12	Yes	No	No	Yes	Yes	No	No			
13	Kitchensink	Kitchen	MHS-S-13	Yes	No	No	Yes	Yes	No	No			
14	Kitchensink	Kitchen	MHS-S-14	Yes	No	No	Yes	Yes	No	No			
15	Kitchensink	Room D14	MHS-S-15	Yes	No	No	Yes	Yes	No	No			
16	Kitchensink	Room D14	MHS-S-16	Yes	No	No	Yes	Yes	No	No			
17	Kitchensink	Room D14	MHS-S-17	Yes	No	No	Yes	Yes	No	No			
18	Kitchensink	Room D14	MHS-S-18	Yes	No	No	Yes	Yes	No	No			
19	Kitchensink	Room D14	MHS-S-19	Yes	No	No	Yes	Yes	No	No			
20	Kitchensink	Room D14	MHS-S-20	Yes	No	No	Yes	Yes	No	No			
21	Kitchensink	Room D14	MHS-S-21	Yes	No	No	Yes	Yes	No	No			
22	Water fountain	Hall by Rm D-17	MHS-WC-22	Yes	No	No	Yes	Yes	No	No	Elkay	EZFS8-1B	
23	Water fountain	Hall by Rm D-17	MHS-WC-23	Yes	No	No	Yes	Yes	No	Yes	Elkay	EZFST8-1B	Out of order
24	Water fountain	Hall across A104	MHS-WC-24	Yes	No	No	Yes	Yes	No	Yes			
25	Ice machine	Room A107	MHS-IM-25	Yes	No	No	Yes	Yes	No	No	Elkay	EWCD A-B	
26	Water fountain	Hall across A107	MHS-WC-26	Yes	No	No	Yes	Yes	No	No	Bubbler		
27	Water fountain	A108	MHS-WC-27	Yes	No	No	Yes	No	No	Yes	HOSHIZAKI	KM-630M-WF	Removed
28	Bottle Filler	Girls Locker Rm (A96)	MHS-BF-28	Yes	No	No	Yes	Yes	No	No	Elkay	EWCD A-B	
29	Water fountain	Gym hall	MHS-WC-29	Yes	No	No	Yes	Yes	No	No	Bubbler		
30	Bottle Filler	Gym hall	MHS-BF-30	Yes	No	Yes	No	Yes	No	No	Elkay	EZFST L8-1C	
31	Water fountain	Gym hall	MHS-WC-31	Yes	No	No	No	Yes	No	No	Elkay	EZFST L8-1C	
32	Bottle Filler	Boys Locker Rm	MHS-BF-32	Yes	No	No	Yes	Yes	No	No	Bubbler		
33	Water fountain	Hall by copy center	MHS-WC-33	Yes	No	No	Yes	Yes	No	No	Bubbler		
34	Bottle Filler	Hall by copy center	MHS-BF-34	Yes	No	Yes	No	No	No	Yes	Elkay		
35	Filtered water	Copy Center	MHS-FW-35	Yes	No	No	No	Yes	No	Yes	Innowave	12chcu	
36	Water fountain	Hall by A5	MHS-WC-36	Yes	No	No	Yes	No	No	Yes	Acorn Aqua	A1111 08F	
37	Water cooler	Hall by A5	MHS-BF-37	Yes	No	Yes	No	No	No	Yes	Innowave	12chcu	
38	Filtered water	Main Office A13	MHS-FW-38	Yes	No	Yes	No	Yes	No	Yes	Quench	740	
39	Water fountain	Hall across Auditorium	MHS-WC-39	Yes	No	Yes	No	Yes	No	Yes			
40	Bottle Filler	Hall across Auditorium	MHS-BF-40	Yes	No	Yes	No	No	No	Yes			
41	Water fountain	Hall across Auditorium	MHS-WC-41	Yes	No	No	Yes	Yes	No	No	Bubbler		
42	Bottle Filler	Hall across Auditorium	MHS-BF-42	Yes	No	No	Yes	Yes	No	No	Bubbler		
43	Water fountain	Nurse	MHS-WC-43	Yes	No	No	Yes	Yes	No	No	Elkay	FD700 3#	Out of order
44	Water fountain	Hall by G130	MHS-WC-44	Yes	No	No	No	Yes	No	Yes	Elkay		Out of order

Appendix F Laboratory Data



7469 Whitepine Rd
 North Chesterfield, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 25-01-00277

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 01/03/2025
 Reported Date: 01/09/2025
 Sampled By: Marvin Ayumbi
 Tech Certification #:

Project/Test Address: 2689; Cheesequake Elementary; 111 NJ 34; Matawan, NJ

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00277-001	1	12/22/2024	CES-S-1	<1.00	01/07/2025	
25-01-00277-002	2	12/22/2024	CES-S-2	9.02	01/07/2025	
25-01-00277-003	3	12/22/2024	CES-S-3	1.25	01/07/2025	
25-01-00277-004	4	12/22/2024	CES-DW-4	<1.00	01/07/2025	
25-01-00277-005	6	12/22/2024	CES-DW-6	2.92	01/07/2025	
25-01-00277-006	8	12/22/2024	CES-S-8	7.63	01/07/2025	
25-01-00277-007	9	12/22/2024	CES-DW-SR	<1.00	01/07/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 25-01-00277

Project/Test Address: 2689; Cheesequake Elementary; 111 NJ 34; Matawan, NJ

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
-------------------	------------------	-----------------	---------------------	--------------------------	---------------	--------------

Method: EPA 200.8
Analyst: Nicole Holloway
Accreditation #: NJ VA008

Reviewed By Authorized Signatory: *Melissa Kanode*

Melissa Kanode

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



ENVIRONMENTAL HAZARDS SERVICES, LLC

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237

Phone: (800) 347-4010 FAX: (804) 275-4907

25-01-00277



Due Date:

01/10/2025

(Friday)

AE

Company Name: LEW Environmental Services LLC

Account #: 201327

Address: 181 US Highway 46

City/State/Zip: Mine Hill, NJ 07803

Phone: (908) 654-8068

Email: labresults@lewenvironmental.com

Fax: 908-654-8069

Project Name / Collection Address: (Required)

Chesapeake Elementary / 119 NT 34

City/State/Zip: (Required)

Matawan, NJ

Project #: 2689

Sampled By: Marvyn Ayumbi

License # (If Required):

Water Source: (Check One) Public Well

Well Tag # (If Applicable):

5 Day Turnaround
 3 Day Turnaround
 2 Day Turnaround
 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals		Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	
1	1	CES-S-1	12/22/24	AM/PM	✓				
2	2	CES-S-2		AM/PM	✓				
3	3	CES-S-3		AM/PM	✓				
4	4	CES-DW-4		AM/PM	✓				
5	6	CES-DW-6		AM/PM	✓				
6				AM/PM	✓				
7	8	CES-S-8		AM/PM	✓				
8	9	CES-DW-SR	12/22/24	AM/PM	✓				
9				AM/PM					
10				AM/PM					

Released by: Marvyn Ayumbi

Signature: *[Signature]*

Date/Time: 12/26/24

Released by: Ava Smart

Signature: *[Signature]*

Date/Time: 01/03/25 1:24 PM



7469 Whitepine Rd
North Chesterfield, VA 23237
Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 25-01-00278

Client: LEW Corp
181 US Hwy 46
Mine Hill, NJ 07803

Received Date: 01/03/2025
Reported Date: 01/09/2025
Sampled By: Marvin Ayumbi
Tech Certification #:

Project/Test Address: 2689; Selover; 150 Lincoln St; Sayerville, NJ

Client Number:
201327

Laboratory Results

Fax Number:
Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00278-001	1	12/21/2024	SES-S-1	3.88	01/08/2025	
25-01-00278-002	2	12/21/2024	SES-WC-2	<1.00	01/08/2025	
25-01-00278-003	3	12/21/2024	SES-BF-3	<1.00	01/08/2025	
25-01-00278-004	4	12/21/2024	SES-WC-4	<1.00	01/08/2025	
25-01-00278-005	5	12/21/2024	SES-BF-5	<1.00	01/08/2025	
25-01-00278-006	6	12/21/2024	SES-WC-SR	<1.00	01/08/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 25-01-00278

Project/Test Address: 2689; Selover; 150 Lincoln St; Sayerville, NJ

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
-------------------	------------------	-----------------	---------------------	--------------------------	---------------	--------------

Method: EPA 200.8
Analyst: Nicole Holloway
Accreditation #: NJ VA008

Reviewed By Authorized Signatory: *Melissa Kanode*

Melissa Kanode

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



ENVIRONMENTAL HAZARDS SERVICES, LLC

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237

Phone: (800) 347-4010 FAX: (804) 275-4907

25-01-00278



Due Date:

01/10/2025

(Friday)

AE

Company Name: LEW Environmental Services LLC

Account #: 201327

Address: 181 US Highway 46

City/State/Zip: Mine Hill, NJ 07803

Phone: (908) 654-8068

Email: labresults@lewenvironmental.com

Fax: 908-654-8069

Project Name / Collection Address: Selover / 150 Lincoln St

Selover / 150 Lincoln St

City/State/Zip: Sayreville, NJ

Sayreville, NJ

Project #: 2689

Sampled By: Marrin Ayumbi

Marrin Ayumbi

License # (If Required):

Water Source: (Check One) Public Well

Well Tag # (If Applicable):

5 Day Turnaround

3 Day Turnaround

2 Day Turnaround

1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	1	SES-S-1	12/21/24							
2	2	SES-WC-2								
3	3	SES-BF-3								
4	4	SES-WC-4								
5	5	SES-BF-5								
6	6	SES-WC-SR	12/21/24							
7										
8										
9										
10										

Released by: Marrin Ayumbi

Signature: [Signature]

[Signature]

Date/Time: 12/26/24

Released by: A SWART

Signature: [Signature]

[Signature]

Date/Time: 01/03/25 1:32 PM



7469 Whitepine Rd
 North Chesterfield, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 25-01-00279

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 01/03/2025
 Reported Date: 01/09/2025
 Sampled By: Marvin Ayumbi
 Tech Certification #:

Project/Test Address: 2689; Eisenhower; 601 Ernston Rd; Sayerville, NJ

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00279-001	1	12/21/2024	EES-S-1	<1.00	01/08/2025	
25-01-00279-002	3	12/21/2024	EES-S-3	7.80	01/08/2025	
25-01-00279-003	4	12/21/2024	EES-S-4	33.3	01/08/2025	
25-01-00279-004	5	12/21/2024	EES-FW-5	<1.00	01/08/2025	
25-01-00279-005	6	12/21/2024	EES-WC-6	<1.00	01/08/2025	
25-01-00279-006	15	12/21/2024	EES-WC-15	<1.00	01/08/2025	
25-01-00279-007	16	12/21/2024	EES-BF-16	<1.00	01/08/2025	
25-01-00279-008	37	12/21/2024	EES-WC-SR	<1.00	01/08/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 25-01-00279

Project/Test Address: 2689; Eisenhower; 601 Ernston Rd; Sayerville, NJ

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
-------------------	------------------	-----------------	---------------------	--------------------------	---------------	--------------

Method: EPA 200.8
Analyst: Nicole Holloway
Accreditation #: NJ VA008

Reviewed By Authorized Signatory: *Melissa Kanode*

Melissa Kanode

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

25-01-00279



Due Date:
01/10/2025
(Friday)
AE

Company Name: LEW Environmental Services LLC Account #: 201327

Address: 181 US Highway 46 City/State/Zip: Mine Hill, NJ 07803

Phone: (908) 654-8068 Email: labresults@lewenvironmental.com Fax: 908-654-8069

Project Name / Collection Address: Eisenhower / 601 Emston Rd City/State/Zip: Sayreville NJ

Project #: 2689 Sampled By: Marvin Ayummbi License # (If Required):

Water Source: (Check One) Public Well Well Tag # (If Applicable):

5 Day Turnaround
 3 Day Turnaround
 2 Day Turnaround
 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	1	EES-S-1	12/21/24		✓					
2	3	EES-S-3			✓					
3	4	EES-S-4			✓					
4	5	EES-FW-5			✓					
5	6	EES-WC-6			✓					
6	15	EES-WC-15			✓					
7	16	EES-BF-16			✓					
8	37	EES-WC-SR	12/21/24		✓					
9										
10										

Released by: Marvin Ayummbi Signature: *[Signature]* Date/Time: 12/24/24

Released by: A Swartz Signature: *[Signature]* Date/Time: 1/3/25

1:20 PM



7469 Whitepine Rd
 North Chesterfield, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 25-01-00283

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 01/03/2025
 Reported Date: 01/09/2025
 Sampled By: Marvin Ayumbi
 Tech Certification #:

Project/Test Address: 2689; Wilson Elementary School; 65 Dane Street; Sayreville, NJ

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00283-001	1	12/21/2024	WE-WC-1	<1.00	01/08/2025	
25-01-00283-002	2	12/21/2024	WE-BF-2	<1.00	01/08/2025	
25-01-00283-003	3	12/21/2024	WE-WC-3	<1.00	01/08/2025	
25-01-00283-004	4	12/21/2024	WE-BF-4	<1.00	01/08/2025	
25-01-00283-005	5	12/21/2024	WE-S-5	<1.00	01/08/2025	
25-01-00283-006	6	12/21/2024	WE-S-6	<1.00	01/08/2025	
25-01-00283-007	7	12/21/2024	WE-S-7	<1.00	01/08/2025	
25-01-00283-008	8	12/21/2024	WE-WC-8	<1.00	01/08/2025	
25-01-00283-009	9	12/21/2024	WE-BF-9	<1.00	01/08/2025	
25-01-00283-010	10	12/21/2024	WE-WC-10	<1.00	01/08/2025	
25-01-00283-011	11	12/21/2024	WE-BF-11	<1.00	01/08/2025	
25-01-00283-012	12	12/21/2024	WE-WC-12	<1.00	01/08/2025	
25-01-00283-013	13	12/21/2024	WE-BF-13	<1.00	01/08/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327
Project/Test Address: 2689; Wilson Elementary School; 65 Dane Street;
Sayreville, NJ

Report Number: 25-01-00283

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00283-014	15	12/21/2024	WE-WC-SR	<1.00	01/08/2025	

Method: EPA 200.8
Analyst: Nicole Holloway
Accreditation #: NJ VA008

Reviewed By Authorized Signatory: Melissa Kanode

Melissa Kanode
QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



ENVIRONMENTAL HAZARDS SERVICES, LLC

WaterSmart® Lead Chain-of-Custody Form

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
www.leadlab.com

25-01-00283



Due Date:
01/10/2025
(Friday)
AE

Client Name: LEW Environmental Services Account #: 201327

Address: 181 US HWY 46

City/State/Zip: Mine Hill NJ 07803

10+
Phone: 908-654-2067

Email Address: labresults@lewenvironmental.com

Project Name/Number: Wilson Elementary / 2689

Collection Address: 65 Dane Street City/State/Zip: Sayreville NJ
(Required) (Required)

Approx. Age Of Property: _____ Collected By: Marvin Ayumbi

Water Source: (Check One) Public or Well _____ Well Tag # (if applicable): _____

Turn-Around Time X 5 Days _____ 3 Days _____ 2 Days _____ 1 Day

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
1	1	WE-WC-1	12/21/24	AM / PM	✓	
2	2	WE-BF-2		AM / PM	✓	
3	3	WE-WC-3		AM / PM	✓	
4	4	WE-BF-4		AM / PM	✓	
5	5	WE-S-5		AM / PM	✓	
6	6	WE-S-6		AM / PM	✓	
7	7	WE-S-7		AM / PM	✓	
8	8	WE-WC-8		AM / PM	✓	
9	9	WE-BF-9		AM / PM	✓	
10	10	WE-WC-10		AM / PM	✓	
11	11	WE-BF-11		AM / PM	✓	
12	12	WE-WC-12		AM / PM	✓	
13	13	WE-BF-13		AM / PM	✓	
14	15	WE-WC-SR	12/21/24	AM / PM	✓	
15				AM / PM		

Released by: Marvin Ayumbi Signature: [Signature] Date/Time: 12/21/24
Received by: ELMURISTANAS Signature: [Signature] Date/Time: 1/3/25 10:30am



7469 Whitepine Rd
 North Chesterfield, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 25-01-00285

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 01/03/2025
 Reported Date: 01/10/2025
 Sampled By: Marvin Ayumbi
 Tech Certification #:

Project/Test Address: 2689; Emma Arleth Elementary; 3198 Washington Road; Sayreville, NJ

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00285-001	1	12/21/2024	EAE-S-1	<1.00	01/09/2025	
25-01-00285-002	2	12/21/2024	EAE-FW-2	<1.00	01/09/2025	
25-01-00285-003	3	12/21/2024	EAE-FW-3	<1.00	01/09/2025	
25-01-00285-004	4	12/21/2024	EAE-WC-4	<1.00	01/09/2025	
25-01-00285-005	5	12/21/2024	EAE-BF-5	<1.00	01/09/2025	
25-01-00285-006	6	12/21/2024	EAE-S-6	<1.00	01/09/2025	
25-01-00285-007	7	12/21/2024	EAE-S-7	<1.00	01/09/2025	
25-01-00285-008	8	12/21/2024	EAE-WC-8	<1.00	01/09/2025	
25-01-00285-009	9	12/21/2024	EAE-WC-9	<1.00	01/09/2025	
25-01-00285-010	10	12/21/2024	EAE-BF-10	<1.00	01/09/2025	
25-01-00285-011	11	12/21/2024	EAE-WC-11	<1.00	01/09/2025	
25-01-00285-012	12	12/21/2024	EAE-BF-12	<1.00	01/09/2025	
25-01-00285-013	13	12/21/2024	EAE-S-13	<1.00	01/09/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327
Project/Test Address: 2689; Emma Arleth Elementary; 3198 Washington Road; Sayreville, NJ

Report Number: 25-01-00285

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00285-014	14	12/21/2024	EAE-WC-SR	<1.00	01/09/2025	

Method: EPA 200.8
Analyst: Nicole Holloway
Accreditation #: NJ VA008

Reviewed By Authorized Signatory: Melissa Kanode

Melissa Kanode
QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



ENVIRONMENTAL HAZARDS SERVICES, LLC

WaterSmart® Lead Chain-of-Custody Form

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
www.leadlab.com

25-01-00285



Due Date:
01/10/2025
(Friday)
AE

Client Name: LEW Environmental services Account #: 201327

Address: 181 US HWY 46

City/State/Zip: Mine Hill NJ 07803 Phone: 908-654-8069

Email Address: labresults@lewenvironmental.com

Project Name/ Number: Emma Arbeth Elementary / 2689

Collection Address: 3198 Washington Road City/State/Zip: Sayreville, NJ
(Required) (Required)

Approx. Age Of Property: _____ Collected By: Marvin Ayumbi

Water Source: (Check One) Public or Well _____ Well Tag # (if applicable): _____

Turn-Around Time X 5 Days _____ 3 Days _____ 2 Days _____ 1 Day

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
1	1	EAE-S-1	12/21/24	AM / PM	✓	
2	2	EAE-FW-2		AM / PM	✓	
3	3	EAE-FW-3		AM / PM	✓	
4	4	EAE-WC-4		AM / PM	✓	
5	5	EAE-BF-5		AM / PM	✓	
6	6	EAE-S-6		AM / PM	✓	
7	7	EAE-S-7		AM / PM	✓	
8	8	EAE-WC-8		AM / PM	✓	
9	9	EAE-WC-9		AM / PM	✓	
10	10	EAE-BF-10		AM / PM	✓	
11	11	EAE-WC-11		AM / PM	✓	
12	12	EAE-BF-12		AM / PM	✓	
13	13	EAE-S-13		AM / PM	✓	
14	14	EAE-WC-SR	12/21/24	AM / PM	✓	
15				AM / PM		

Released by: Marvin Ayumbi Signature: Date/Time: 12/26/24
 Received by: EL CHRISTMAS Signature: Date/Time: 1/3/25 109pm



7469 Whitepine Rd
 North Chesterfield, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 25-01-00286

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 01/03/2025
 Reported Date: 01/09/2025
 Sampled By: Marvin Ayumbi
 Tech Certification #:

Project/Test Address: 2689; Harry S Truman; 1 Taft Place; Parlin, NJ

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00286-001	1	12/21/2024	HTE-WC-1	<1.00	01/08/2025	
25-01-00286-002	2	12/21/2024	HTE-BF-2	<1.00	01/08/2025	
25-01-00286-003	3	12/21/2024	HTE-FW-3	<1.00	01/08/2025	
25-01-00286-004	4	12/21/2024	HTE-S-4	2.74	01/08/2025	
25-01-00286-005	5	12/21/2024	HTE-S-5	8.42	01/08/2025	
25-01-00286-006	6	12/21/2024	HTE-WC-6	<1.00	01/08/2025	
25-01-00286-007	7	12/21/2024	HTE-BF-7	<1.00	01/08/2025	
25-01-00286-008	8	12/21/2024	HTE-S-8	3.90	01/08/2025	
25-01-00286-009	9	12/21/2024	HTE-S-9	3.79	01/08/2025	
25-01-00286-010	10	12/21/2024	HTE-S-10	3.32	01/08/2025	
25-01-00286-011	11	12/21/2024	HTE-WC-11	<1.00	01/08/2025	
25-01-00286-012	12	12/21/2024	HTE-BF-12	<1.00	01/08/2025	
25-01-00286-013	13	12/21/2024	HTE-WC-13	<1.00	01/08/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 25-01-00286

Project/Test Address: 2689; Harry S Truman; 1 Taft Place; Parlin, NJ

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00286-014	14	12/21/2024	HTE-BF-14	<1.00	01/08/2025	
25-01-00286-015	15	12/21/2024	HTE-WC-SR	<1.00	01/08/2025	

Method: EPA 200.8
Analyst: Nicole Holloway
Accreditation #: NJ VA008

Reviewed By Authorized Signatory:



Melissa Kanode

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion




ENVIRONMENTAL HAZARDOUS SERVICES, LLC

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd., Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907

25-01-00286



Due Date:
01/10/2025
(Friday)
AE

Company Name: LEW Environmental Services LLC

Account #: 201327

Address: 181 US Highway 46

City/State/Zip: Mine Hill, NJ 07803

Phone: (908) 654-8068

Email: labresults@lewenvironmental.com

Fax: 908-654-8069

107

Project Name / Collection Address: Harrys Trueman / 1 Tapt Place

City/State/Zip: Parsippany NJ

Project #: 2689

Sampled By: Marvyn Ayummbi

License # (If Required):

Water Source: (Check One) Public Well

Well Tag # (If Applicable):

5 Day Turnaround
 3 Day Turnaround
 2 Day Turnaround
 1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1		HTE-WC-1	12/21/24		✓					
2		HTE-BF-2			✓					
3		HTE-FW-3			✓					
4		HTE-S-4			✓					
5		HTE-S-5			✓					
6		HTE-WC-6			✓					
7		HTE-BF-7			✓					
8		HTE-S-8			✓					
9		HTE-S-9			✓					
10		HTE-S-10	12/21/24		✓					

Released by: Marvyn Ayummbi

Signature: [Signature]

Date/Time: 12/26/24

Released by: [Signature]

Signature: [Signature]

Date/Time: 1/3/25 10pm

Project Name: _____

Lab I.D. #: 00286

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
16	11	HTE-WC-11	12/21/24	AM / PM	✓	
17	12	HTE-BF-12	↓	AM / PM	✓	
18	13	HTE-WC-13		AM / PM	✓	
19	14	HTE-BF-14		AM / PM	✓	
20	15	HTE-WC-SR		12/21/24	AM / PM	✓
21				AM / PM		
22				AM / PM		
23				AM / PM		
24				AM / PM		
25				AM / PM		
26				AM / PM		
27				AM / PM		
28				AM / PM		
29				AM / PM		
30				AM / PM		
31				AM / PM		
32				AM / PM		
33				AM / PM		
34				AM / PM		
35				AM / PM		
36				AM / PM		
37				AM / PM		
38				AM / PM		
39				AM / PM		
40				AM / PM		
41				AM / PM		
42				AM / PM		
43				AM / PM		
44				AM / PM		
45				AM / PM		
46				AM / PM		
47				AM / PM		
48				AM / PM		
49				AM / PM		
50				AM / PM		

Released by: _____ Signature: _____ Date/Time: _____
 Received by: E. CHRISTMAS Signature: _____ Date/Time: 1/3/25 10pm



7469 Whitepine Rd
 North Chesterfield, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 25-01-00292

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 01/03/2025
 Reported Date: 01/10/2025
 Sampled By: Marvin Ayumbi
 Tech Certification #:

Project/Test Address: 2689; Samsel Upper Elementary; 298 Ernston Road; Sayreville, NJ

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00292-001	5	12/22/2024	SUE-S-5	<1.00	01/09/2025	
25-01-00292-002	6	12/22/2024	SUE-S-6	<1.00	01/09/2025	
25-01-00292-003	7	12/22/2024	SUE-S-7	<1.00	01/09/2025	
25-01-00292-004	8	12/22/2024	SUE-WC-8	<1.00	01/09/2025	
25-01-00292-005	9	12/22/2024	SUE-BF-9	<1.00	01/09/2025	
25-01-00292-006	10	12/22/2024	SUE-WC-10	<1.00	01/09/2025	
25-01-00292-007	11	12/22/2024	SUE-BF-11	<1.00	01/09/2025	
25-01-00292-008	12	12/22/2024	SUE-WC-12	<1.00	01/09/2025	
25-01-00292-009	13	12/22/2024	SUE-BF-13	<1.00	01/09/2025	
25-01-00292-010	14	12/22/2024	SUE-S-14	<1.00	01/09/2025	
25-01-00292-011	15	12/22/2024	SUE-S-15	<1.00	01/09/2025	
25-01-00292-012	17	12/22/2024	SUE-FW-17	<1.00	01/09/2025	
25-01-00292-013	18	12/22/2024	SUE-WC-18	<1.00	01/09/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 25-01-00292

Project/Test Address: 2689; Samsel Upper Elementary; 298 Ernston Road;
Sayreville, NJ

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00292-014	19	12/22/2024	SUE-BF-19	<1.00	01/09/2025	
25-01-00292-015	20	12/22/2024	SUE-WC-20	<1.00	01/09/2025	
25-01-00292-016	21	12/22/2024	SUE-BF-21	<1.00	01/09/2025	
25-01-00292-017	24	12/22/2024	SUE-WC-24	<1.00	01/09/2025	
25-01-00292-018	25	12/22/2024	SUE-WC-25	<1.00	01/09/2025	
25-01-00292-019	26	12/22/2024	SUE-BF-26	<1.00	01/09/2025	
25-01-00292-020	27	12/22/2024	SUE-S-27	<1.00	01/09/2025	
25-01-00292-021	28	12/22/2024	SUE-S-28	<1.00	01/09/2025	
25-01-00292-022	29	12/22/2024	SUE-S-29	6.54	01/09/2025	
25-01-00292-023	30	12/22/2024	SUE-WC-30	<1.00	01/09/2025	
25-01-00292-024	31	12/22/2024	SUE-WC-31	<1.00	01/09/2025	
25-01-00292-025	32	12/22/2024	SUE-BF-32	<1.00	01/09/2025	
25-01-00292-026	33	12/22/2024	SUE-WC-33	<1.00	01/09/2025	
25-01-00292-027	34	12/22/2024	SUE-BF-34	<1.00	01/09/2025	
25-01-00292-028	35	12/22/2024	SUE-WC-SR	<1.00	01/09/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 25-01-00292

Project/Test Address: 2689; Samsel Upper Elementary; 298 Ernston Road;
Sayreville, NJ

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
-------------------	------------------	-----------------	---------------------	--------------------------	---------------	--------------

Method: EPA 200.8
Analyst: Nicole Holloway
Accreditation #: NJ VA008

Reviewed By Authorized Signatory: *Melissa Kanode*

Melissa Kanode

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



ENVIRONMENTAL HAZARDS SERVICES, LLC

WaterSmart® Lead Chain-of-Custody Form

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
www.leadlab.com

25-01-00292



Due Date:
01/10/2025
(Friday)
AE

Client Name: LEW Environmental Services Account #: 201327

Address: 181 US HWY 46

City/State/Zip: Mine Hill NJ 07803 Phone: 908-654-8069

Email Address: labresults@lewenvironmental.com

Project Name/ Number: Samsel Upper Elementary / 2689

Collection Address: 298 Emston Road City/State/Zip: Sayreville NJ
(Required) (Required)

Approx. Age Of Property: _____ Collected By: Marvin Ayumbi

Water Source: (Check One) Public or Well _____ Well Tag # (if applicable): _____

Turn-Around Time 5 Days 3 Days 2 Days 1 Day

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte		
					Pb	Cu	
1	5	SUE-S-5	12/22/24	AM / PM	✓		
2	6	SUE-S-6	↓	AM / PM	✓		
3	7	SUE-S-7		AM / PM	✓		
4	8	SUE-WC-8		AM / PM	✓		
5	9	SUE-BF-9		AM / PM	✓		
6	10	SUE-WC-10		AM / PM	✓		
7	11	SUE-BF-11		AM / PM	✓		
8	12	SUE-WC-12		AM / PM	✓		
9	13	SUE-BF-13		AM / PM	✓		
10	14	SUE-S-14		AM / PM	✓		
11	15	SUE-S-15		AM / PM	✓		
12	17	SUE-FW-17		AM / PM	✓		
13	18	SUE-WC-18		AM / PM	✓		
14	19	SUE-BF-19		AM / PM	✓		
15	20	SUE-WC-20		12/22/24	AM / PM	✓	

Released by: Marvin Ayumbi Signature: [Signature] Date/Time: 12/26/24
Received by: [Signature] Signature: [Signature] Date/Time: 1/3/25 11pm

Project Name: _____

Lab I.D. #: 00292

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte		
					Pb	Cu	
16	21	SUE-BF-21	12/22/24	AM / PM	✓		
17	24	SUE-WC-24	↓	AM / PM	✓		
18	25	SUE-WC-25		AM / PM	✓		
19	26	SUE-BF-26		AM / PM	✓		
20	27	SUE-S-27		AM / PM	✓		
21	28	SUE-S-28		AM / PM	✓		
22	29	SUE-S-29		AM / PM	✓		
23	30	SUE-WC-30		AM / PM	✓		
24	31	SUE-WC-31		AM / PM	✓		
25	32	SUE-BF-32		AM / PM	✓		
26	33	SUE-WC-33		AM / PM	✓		
27	34	SUE-BF-34		AM / PM	✓		
28	35	SUE-WC-SR		12/22/24	AM / PM	✓	
29					AM / PM		
30					AM / PM		
31				AM / PM			
32				AM / PM			
33				AM / PM			
34				AM / PM			
35				AM / PM			
36				AM / PM			
37				AM / PM			
38				AM / PM			
39				AM / PM			
40				AM / PM			
41				AM / PM			
42				AM / PM			
43				AM / PM			
44				AM / PM			
45				AM / PM			
46				AM / PM			
47				AM / PM			
48				AM / PM			
49				AM / PM			
50				AM / PM			

Released by: _____ Signature: _____ Date/Time: _____
 Received by: GEORGIAS Signature: [Signature] Date/Time: 1/3/25 11:17pm



7469 Whitepine Rd
 North Chesterfield, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 25-01-00293

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 01/03/2025
 Reported Date: 01/09/2025
 Sampled By: Marvin Ayumbi
 Tech Certification #:

Project/Test Address: 2689; Sayreville Middle School; 800 Washington Rd; Sayreville, NJ 08859

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00293-001	2	12/21/2024	SMS-WC-2	<1.00	01/08/2025	
25-01-00293-002	3	12/21/2024	SMS-BF-3	<1.00	01/08/2025	
25-01-00293-003	4	12/21/2024	SMS-S-4	<1.00	01/08/2025	
25-01-00293-004	5	12/21/2024	SMS-WC-5	<1.00	01/08/2025	
25-01-00293-005	6	12/21/2024	SMS-BF-6	<1.00	01/08/2025	
25-01-00293-006	7	12/21/2024	SMS-FP-7	<1.00	01/08/2025	
25-01-00293-007	8	12/21/2024	SMS-WC-8	<1.00	01/08/2025	
25-01-00293-008	9	12/21/2024	SMS-BF-9	<1.00	01/08/2025	
25-01-00293-009	10	12/21/2024	SMS-WC-10	<1.00	01/08/2025	
25-01-00293-010	11	12/21/2024	SMS-BF-11	<1.00	01/08/2025	
25-01-00293-011	12	12/21/2024	SMS-WC-12	<1.00	01/08/2025	
25-01-00293-012	13	12/21/2024	SMS-BF-13	<1.00	01/08/2025	
25-01-00293-013	14	12/21/2024	SMS-WC-14	<1.00	01/08/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327
 Project/Test Address: 2689; Sayreville Middle School; 800 Washington Rd;
 Sayreville, NJ 08859

Report Number: 25-01-00293

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00293-014	15	12/21/2024	SMS-BF-15	<1.00	01/08/2025	
25-01-00293-015	16	12/21/2024	SMS-WC-16	<1.00	01/08/2025	
25-01-00293-016	17	12/21/2024	SMS-WC-17	<1.00	01/08/2025	
25-01-00293-017	18	12/21/2024	SMS-WC-18	<1.00	01/08/2025	
25-01-00293-018	19	12/21/2024	SMS-BF-19	<1.00	01/08/2025	
25-01-00293-019	20	12/21/2024	SMS-WC-20	<1.00	01/08/2025	
25-01-00293-020	21	12/21/2024	SMS-BF-21	<1.00	01/08/2025	
25-01-00293-021	23	12/21/2024	SMS-IM-23	<1.00	01/08/2025	
25-01-00293-022	24	12/21/2024	SMS-WC-SR	<1.00	01/08/2025	

Method: EPA 200.8
 Analyst: Nicole Holloway
 Accreditation #: NJ VA008

Reviewed By Authorized Signatory: *Melissa Kanode*

Melissa Kanode
 QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



ENVIRONMENTAL HAZARDS SERVICES, LLC

WaterSmart® Lead Chain-of-Custody Form

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
www.leadlab.com

25-01-00293



Due Date:
01/10/2025
(Friday)
AE

Client Name: LEW Environmental Services Account #: 201327

Address: 181 US HWY 46

City/State/Zip: Mine Hill NJ 07803

Phone: 908-654-8069

Email Address: labresults@lewenvironmental.com

Project Name/ Number: Sayreville Middle School / 2689

Collection Address: 800 Washington Rd City/State/Zip: Sayreville, NJ 08859
(Required) (Required)

Approx. Age Of Property: _____ Collected By: Marvin Ayumbi

Water Source: (Check One) Public or Well _____ Well Tag # (if applicable): _____

Turn-Around Time 5 Days 3 Days 2 Days 1 Day

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
1	2	SMS-WC-2	12/21/24	AM / PM	✓	
2	3	SMS-BF-3		AM / PM	✓	
3	4	SMS-S-4		AM / PM	✓	
4	5	SMS-WC-5		AM / PM	✓	
5	6	SMS-BF-6		AM / PM	✓	
6	7	SMS-FP-7		AM / PM	✓	
7	8	SMS-WC-8		AM / PM	✓	
8	9	SMS-BF-9		AM / PM	✓	
9	10	SMS-WC-10		AM / PM	✓	
10	11	SMS-BF-11		AM / PM	✓	
11	12	SMS-WC-12		AM / PM	✓	
12	13	SMS-BF-13		AM / PM	✓	
13	14	SMS-WC-14		AM / PM	✓	
14	15	SMS-BF-15		AM / PM	✓	
15	16	SMS-WC-16	12/21/24	AM / PM	✓	

Released by: Marvin Ayumbi Signature: [Signature] Date/Time: 12/26/24
Received by: [Signature] Signature: [Signature] Date/Time: 1/3/25 11:00am

Project Name: _____

00293

Lab I.D. #: _____

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
16	17	SMS-WC-17	12/21/24	AM / PM	✓	
17	18	SMS-WC-18	↓	AM / PM	✓	
18	19	SMS-BF-19		AM / PM	✓	
19	20	SMS-WC-20		AM / PM	✓	
20	21	SMS-BF-21		AM / PM	✓	
21	23	SMS-IM-23		AM / PM	✓	
22	24	SMS-WC-SR	12/21/24	AM / PM	✓	
23				AM / PM		
24				AM / PM		
25				AM / PM		
26				AM / PM		
27				AM / PM		
28				AM / PM		
29				AM / PM		
30				AM / PM		
31				AM / PM		
32				AM / PM		
33				AM / PM		
34				AM / PM		
35				AM / PM		
36				AM / PM		
37				AM / PM		
38				AM / PM		
39				AM / PM		
40				AM / PM		
41				AM / PM		
42				AM / PM		
43				AM / PM		
44				AM / PM		
45				AM / PM		
46				AM / PM		
47				AM / PM		
48				AM / PM		
49				AM / PM		
50				AM / PM		

Released by: _____ Signature: _____ Date/Time: _____

Received by: ELPRISTINA Signature: [Signature] Date/Time: 1/3/25 11:19pm



7469 Whitepine Rd
 North Chesterfield, VA 23237
 Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Report Number: 25-01-00301

Client: LEW Corp
 181 US Hwy 46
 Mine Hill, NJ 07803

Received Date: 01/03/2025
 Reported Date: 01/10/2025
 Sampled By: Marvin Ayumbi
 Tech Certification #:

Project/Test Address: 2689; Sayreville High School; 820 Washington Road; Sayreville, NJ

Client Number:
 201327

Laboratory Results

Fax Number:
 Ext 18 Melissa

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00301-001	1	12/22/2024	MHS-WC-1	<1.00	01/10/2025	
25-01-00301-002	2	12/22/2024	MHS-BF-2	<1.00	01/10/2025	
25-01-00301-003	3	12/22/2024	MHS-WC-3	<1.00	01/10/2025	
25-01-00301-004	4	12/22/2024	MHS-BF-4	<1.00	01/10/2025	
25-01-00301-005	5	12/22/2024	MHS-WC-5	<1.00	01/10/2025	
25-01-00301-006	6	12/22/2024	MHS-BF-6	<1.00	01/10/2025	
25-01-00301-007	7	12/22/2024	MHS-S-7	<1.00	01/10/2025	
25-01-00301-008	8	12/22/2024	MHS-S-8	<1.00	01/10/2025	
25-01-00301-009	9	12/22/2024	MHS-S-9	<1.00	01/10/2025	
25-01-00301-010	10	12/22/2024	MHS-S-10	2.44	01/10/2025	
25-01-00301-011	11	12/22/2024	MHS-S-11	<1.00	01/10/2025	
25-01-00301-012	12	12/22/2024	MHS-S-12	<1.00	01/10/2025	
25-01-00301-013	13	12/22/2024	MHS-S-13	<1.00	01/10/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 25-01-00301

Project/Test Address: 2689; Sayreville High School; 820 Washington Road;
Sayreville, NJ

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00301-014	14	12/22/2024	MHS-S-14	<1.00	01/10/2025	
25-01-00301-015	15	12/22/2024	MHS-S-15	<1.00	01/10/2025	
25-01-00301-016	16	12/22/2024	MHS-S-16	<1.00	01/10/2025	
25-01-00301-017	17	12/22/2024	MHS-S-17	<1.00	01/10/2025	
25-01-00301-018	18	12/22/2024	MHS-S-18	<1.00	01/10/2025	
25-01-00301-019	19	12/22/2024	MHS-S-19	<1.00	01/10/2025	
25-01-00301-020	20	12/22/2024	MHS-S-20	<1.00	01/10/2025	
25-01-00301-021	21	12/22/2024	MHS-S-21	<1.00	01/10/2025	
25-01-00301-022	22	12/22/2024	MHS-WC-22	<1.00	01/10/2025	
25-01-00301-023	24	12/22/2024	MHS-WC-24	<1.00	01/10/2025	
25-01-00301-024	25	12/22/2024	MHS-IM-25	<1.00	01/10/2025	
25-01-00301-025	26	12/22/2024	MHS-WC-26	<1.00	01/10/2025	
25-01-00301-026	28	12/22/2024	MHS-BF-28	<1.00	01/10/2025	
25-01-00301-027	29	12/22/2024	MHS-WC-29	<1.00	01/10/2025	
25-01-00301-028	30	12/22/2024	MHS-BF-30	<1.00	01/10/2025	
25-01-00301-029	31	12/22/2024	MHS-WC-31	<1.00	01/10/2025	
25-01-00301-030	32	12/22/2024	MHS-BF-32	<1.00	01/10/2025	
25-01-00301-031	33	12/22/2024	MHS-WC-33	<1.00	01/10/2025	
25-01-00301-032	34	12/22/2024	MHS-BF-34	<1.00	01/10/2025	
25-01-00301-033	35	12/22/2024	MHS-FW-35	<1.00	01/10/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 25-01-00301

Project/Test Address: 2689; Sayreville High School; 820 Washington Road;
Sayreville, NJ

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00301-034	36	12/22/2024	MHS-WC-36	<1.00	01/10/2025	
25-01-00301-035	37	12/22/2024	MHS-BF-37	<1.00	01/10/2025	
25-01-00301-036	38	12/22/2024	MHS-FW-38	<1.00	01/10/2025	
25-01-00301-037	39	12/22/2024	MHS-WC-39	<1.00	01/10/2025	
25-01-00301-038	40	12/22/2024	MHS-BF-40	<1.00	01/10/2025	
25-01-00301-039	41	12/22/2024	MHS-WC-41	<1.00	01/10/2025	
25-01-00301-040	42	12/22/2024	MHS-BF-42	<1.00	01/10/2025	
25-01-00301-041	45	12/22/2024	MHS-WC-45	<1.00	01/10/2025	
25-01-00301-042	46	12/22/2024	MHS-BF-46	<1.00	01/10/2025	
25-01-00301-043	47	12/22/2024	MHS-WC-47	<1.00	01/10/2025	
25-01-00301-044	48	12/22/2024	MHS-BF-48	<1.00	01/10/2025	
25-01-00301-045	49	12/22/2024	MHS-WC-49	<1.00	01/10/2025	
25-01-00301-046	50	12/22/2024	MHS-WC-50	<1.00	01/10/2025	
25-01-00301-047	51	12/22/2024	MHS-S-51	<1.00	01/10/2025	
25-01-00301-048	52	12/22/2024	MHS-FW-52	<1.00	01/10/2025	
25-01-00301-049	53	12/22/2024	MHS-FW-53	<1.00	01/10/2025	
25-01-00301-050	54	12/22/2024	MHS-WC-54	<1.00	01/10/2025	
25-01-00301-051	55	12/22/2024	MHS-BF-55	<1.00	01/10/2025	
25-01-00301-052	56	12/22/2024	MHS-WC-56	<1.00	01/10/2025	
25-01-00301-053	57	12/22/2024	MHS-BF-57	<1.00	01/10/2025	

Environmental Hazards Services, L.L.C

Client Number: 201327
Project/Test Address: 2689; Sayreville High School; 820 Washington Road;
Sayreville, NJ

Report Number: 25-01-00301

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
25-01-00301-054	60	12/22/2024	MHS-S-60	<1.00	01/10/2025	
25-01-00301-055	61	12/22/2024	MHS-WC-SR	<1.00	01/10/2025	

Method: EPA 200.8
Analyst: Nicole Holloway
Accreditation #: NJ VA008

Reviewed By Authorized Signatory: *Melissa Kanode*

Melissa Kanode
QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



ENVIRONMENTAL HAZARDS SERVICES, LLC

WaterSmart® Lead Chain-of-Custody Form

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
www.leadlab.com

25-01-00301



Due Date:
01/10/2025
(Friday)
AE

Client Name: LEW Environmental Services Account #: 201327

Address: 181 US HWY 46

City/State/Zip: Mine Hill, NJ 07803

10F

Phone: 908-654-8069

Email Address: labresults@lewenvironmental.com

Project Name/ Number: Sayreville High School / 2689

Collection Address: 820 Washington Road City/State/Zip: Sayreville NJ
(Required) (Required)

Approx. Age Of Property: _____ Collected By: Marvin Ayumbi

Water Source: (Check One) Public or Well _____ Well Tag # (if applicable): _____

Turn-Around Time _____ 5 Days _____ 3 Days _____ 2 Days _____ 1 Day

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
1	1	MHS-WC-1	12/22/24	AM / PM	✓	
2	2	MHS-BF-2		AM / PM	✓	
3	3	MHS-WC-3		AM / PM	✓	
4	4	MHS-BF-4		AM / PM	✓	
5	5	MHS-WC-5		AM / PM	✓	
6	6	MHS-BF-6		AM / PM	✓	
7	7	MHS-S-7		AM / PM	✓	
8	8	MHS-S-8		AM / PM	✓	
9	9	MHS-S-9		AM / PM	✓	
10	10	MHS-S-10		AM / PM	✓	
11	11	MHS-S-11		AM / PM	✓	
12	12	MHS-S-12		AM / PM	✓	
13	13	MHS-S-13		AM / PM	✓	
14	14	MHS-S-14		AM / PM	✓	
15	15	MHS-S-15		AM / PM	✓	

Released by: Marvin Ayumbi Signature: [Signature] Date/Time: 12/24/24
 Received by: [Signature] Signature: [Signature] Date/Time: 1/3/25 131p

Project Name: _____

Lab I.D. #: 00301

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
16	16	MHS-S-16	12/22/24	AM/PM	✓	
17	17	MHS-S-17		AM/PM	✓	
18	18	MHS-S-18		AM/PM	✓	
19	19	MHS-S-19		AM/PM	✓	
20	20	MHS-S-20		AM/PM	✓	
21	21	MHS-S-21		AM/PM	✓	
22	22	MHS-WC-22		AM/PM	✓	
23	24	MHS-WC-24		AM/PM	✓	
24	25	MHS-IM-25		AM/PM	✓	
25	26	MHS-WC-26		AM/PM	✓	
26	28	MHS-BF-28		AM/PM	✓	
27	29	MHS-WC-29		AM/PM	✓	
28	30	MHS-BF-30		AM/PM	✓	
29	31	MHS-WC-31		AM/PM	✓	
30	32	MHS-BF-32		AM/PM	✓	
31	33	MHS-WC-33		AM/PM	✓	
32	34	MHS-BF-34		AM/PM	✓	
33	35	MHS-FW-35		AM/PM	✓	
34	36	MHS-WC-36		AM/PM	✓	
35	37	MHS-BF-37		AM/PM	✓	
36	38	MHS-FW-38		AM/PM	✓	
37	39	MHS-WC-39		AM/PM	✓	
38	40	MHS-BF-40		AM/PM	✓	
39	41	MHS-WC-41		AM/PM	✓	
40	42	MHS-BF-42		AM/PM	✓	
41	45	MHS-WC-45		AM/PM	✓	
42	46	MHS-BF-46		AM/PM	✓	
43	47	MHS-WC-47		AM/PM	✓	
44	48	MHS-BF-48		AM/PM	✓	
45	49	MHS-WC-49		AM/PM	✓	
46	50	MHS-WC-50		AM/PM	✓	
47	51	MHS-S-51		AM/PM	✓	
48	52	MHS-FW-52		AM/PM	✓	
49	53	MHS-FW-53		AM/PM	✓	
50	54	MHS-WC-54	12/22/24	AM/PM	✓	

Released by: _____ Signature: _____ Date/Time: _____
 Received by: [Signature] Signature: [Signature] Date/Time: 1/2/25 13:00

Project Name: _____

Lab I.D. #: 00301

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Analyte	
					Pb	Cu
16	55	MHS-BF-55	12/22/24	AM / PM	✓	
17	56	MHS-WC-56	↓	AM / PM	✓	
18	57	MHS-BF-57		AM / PM	✓	
19	60	MHS-S-60		AM / PM	✓	
20	61	MHS-WC-SR	12/22/24	AM / PM	✓	
21				AM / PM		
22				AM / PM		
23				AM / PM		
24				AM / PM		
25				AM / PM		
26				AM / PM		
27				AM / PM		
28				AM / PM		
29				AM / PM		
30				AM / PM		
31				AM / PM		
32				AM / PM		
33				AM / PM		
34				AM / PM		
35				AM / PM		
36				AM / PM		
37				AM / PM		
38				AM / PM		
39				AM / PM		
40				AM / PM		
41				AM / PM		
42				AM / PM		
43				AM / PM		
44				AM / PM		
45				AM / PM		
46				AM / PM		
47				AM / PM		
48				AM / PM		
49				AM / PM		
50				AM / PM		

Released by: _____ Signature: _____ Date/Time: _____
 Received by: ELMCRISTMAS Signature: [Signature] Date/Time: 1/3/25 13/pm