

BID ADDENDUM NO. 3

OWNER: EDGEMONT UNION FREE SCHOOL DISTRICT

PROJECT NAME: ADMINISTRATION BUILDING ADDITION,
SITE IMPROVEMENTS & RELATED WORK

This Addendum is hereby included in and made a part of the Contract Documents, dated February 28, 2025 whether or not attached thereto.

All requirements of the original project specifications and drawings shall remain in force except as amended by this addendum.

DATE: March 21, 2025

This addendum consists of two (2) pages plus revised Milestone Schedule, revised drawings L001, L101, L102, AD M100, AD M101, AD M400, AD E101 and AD E200.

THE FOLLOWING ARE MODIFICATIONS, CLARIFICATIONS, DELETIONS OR ADDITIONS TO THE SPECIFICATIONS:

01 1000 – SUMMARY OF CONTRACTS

ADD revised Milestone Schedule attached to this addendum.

THE FOLLOWING ARE MODIFICATIONS, CLARIFICATIONS, DELETIONS OR ADDITIONS TO THE DRAWINGS:

DRAWING A825 – FINISH LEGEND, FINISH SCHEDULE AND DETAILS

Finish Schedule, Line 12, Dry 320 **REVISE** ceiling material from ACT-3to P-3.

Finish Schedule, Line 16, Storage 350 **DELETE** ceiling material.

Finish Schedule, Line 18, Stair #1

4DELETE ceiling material.

DRAWING AD M100 – “ADMIN.” BUILDING LOWER LEVEL MECHANICAL PLAN

REVISE ductwork as shown on revised drawing attached to this addendum.

DRAWING AD M101 – “ADMIN.” BUILDING LOWER LEVEL MECHANICAL PLAN

REVISE size of RTU-1 as shown on revised drawing attached to this addendum.

DRAWING AD M400 – MECHANICAL SCHEDULES

REVISE RTU characteristics as shown on revised drawing attached to this addendum.

DRAWING AD E101 – ROOF ELECTRICAL PLAN

REVISE RTU electrical information as shown on revised drawing attached to this addendum.

DRAWING AD E200 – ELECTRICAL ONE LINE DIAGRAM

REVISE one line diagram as shown on revised drawing attached to this addendum.

END OF SED ADDENDUM NO. 2

The following attachments are being provided for informational purposes:

Bidder RFI Responses (In the event of a discrepancy between these responses and the contract documents, the contract documents shall prevail unless modified by addendum.)


Bid RFI-#002 dated 3/13/2025 (1 page).


Bid RFI-#003 undated (1 page).

Bid RFI-#004 dated 3/17/2025 (1 page).

Bid RFI-#005 dated 3/18/2025 (3 pages).

Bid RFI-#006 dated 3/19/2025 (1 page).

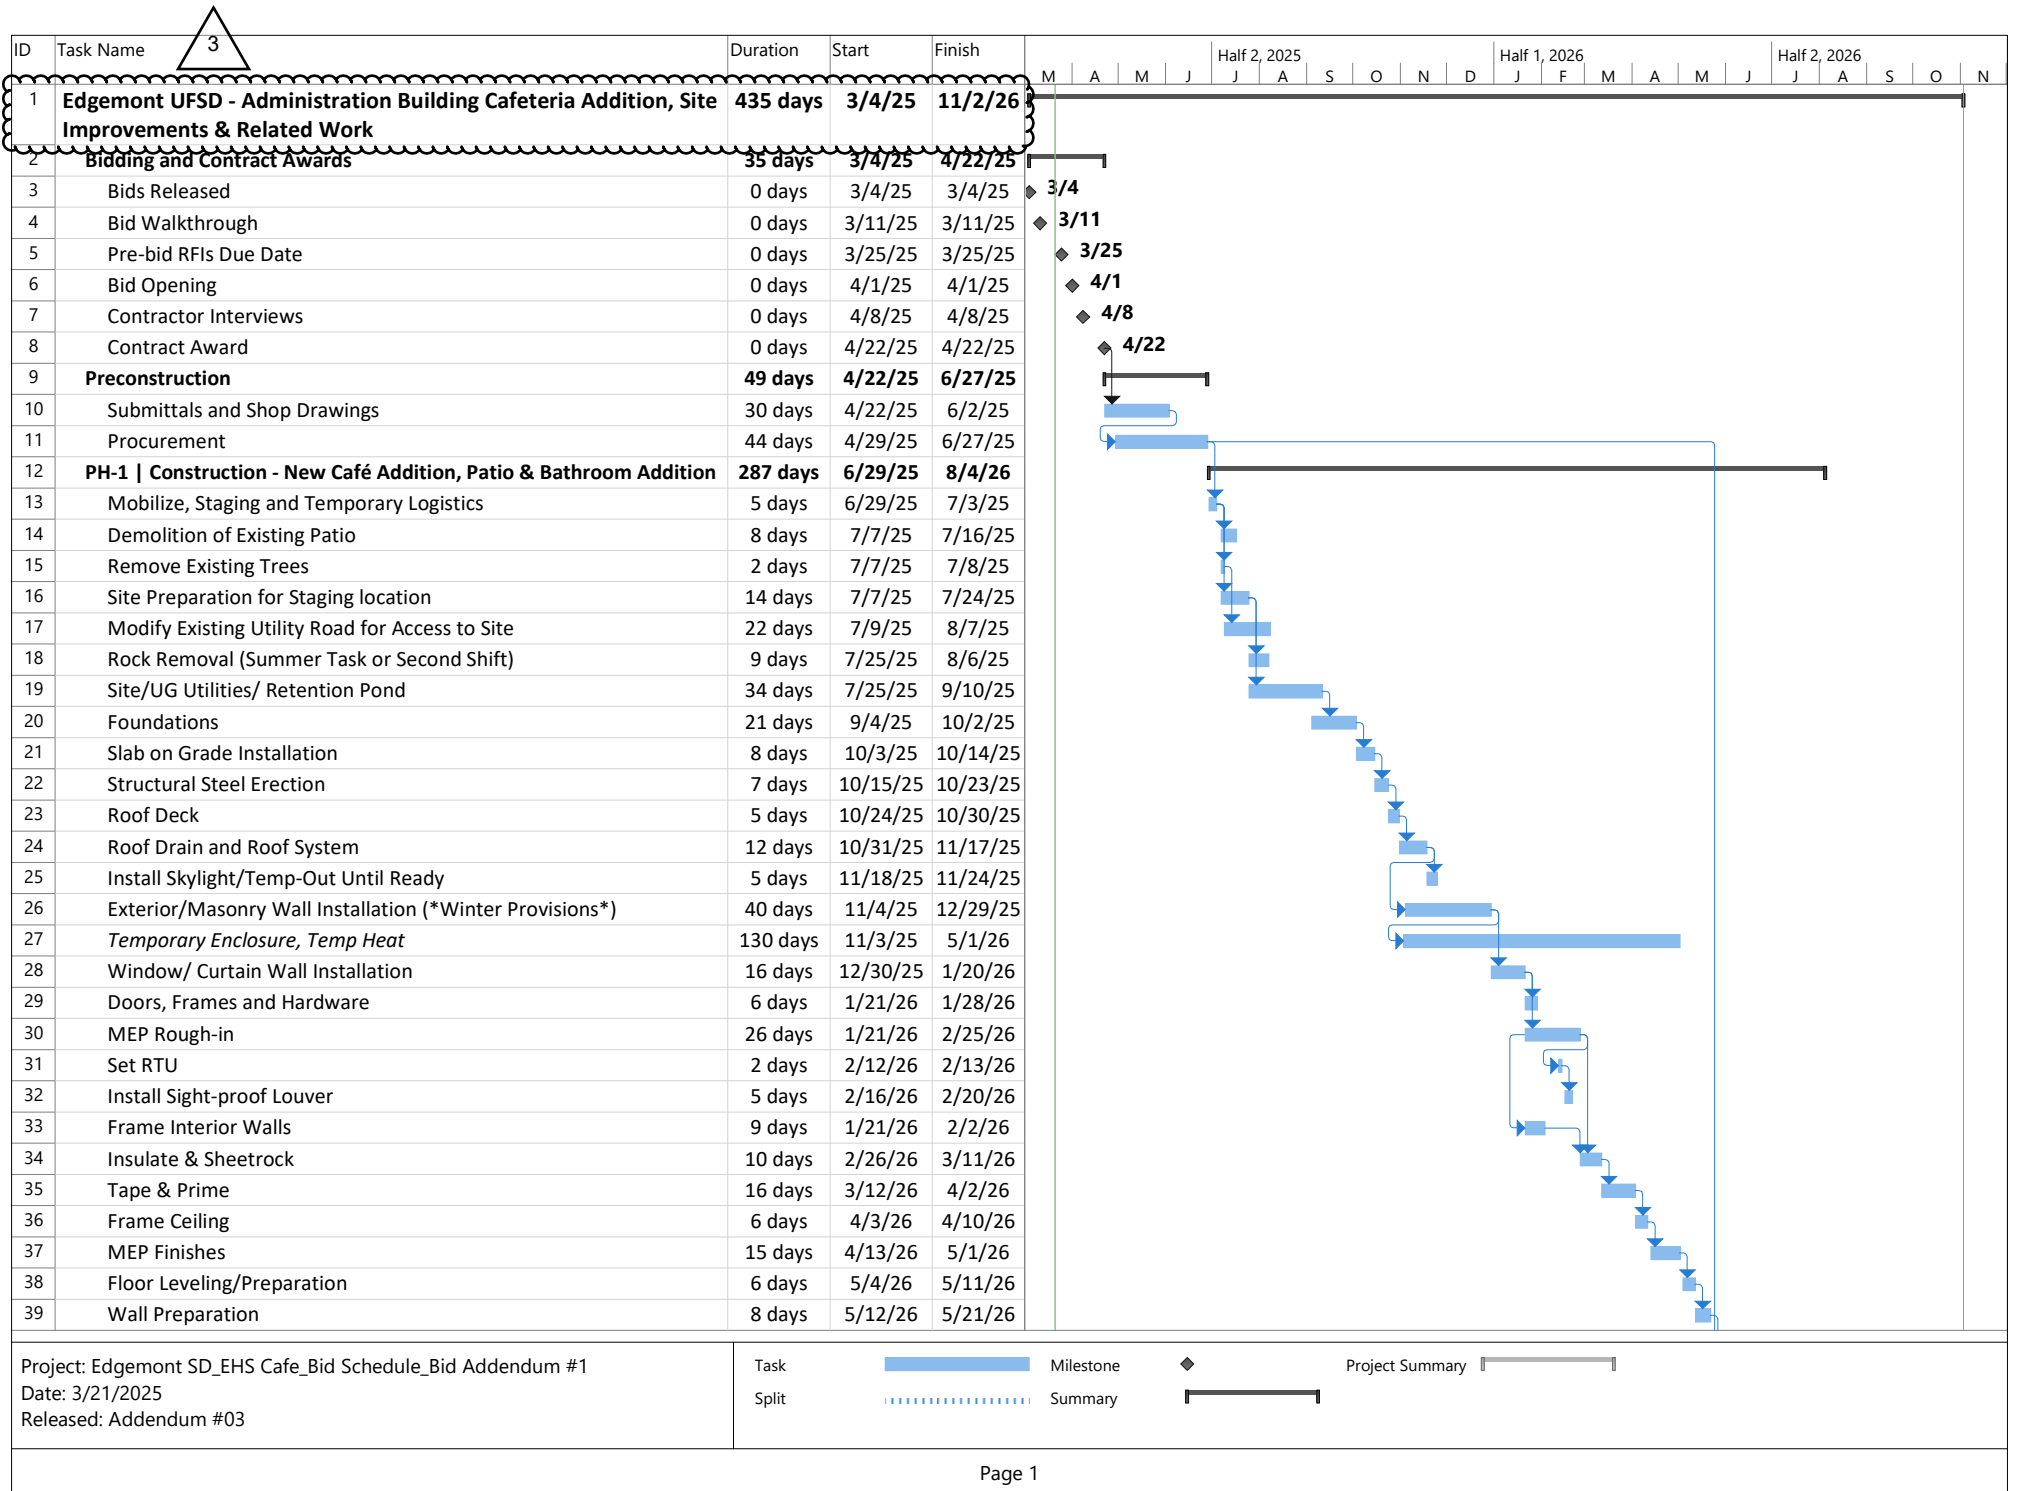

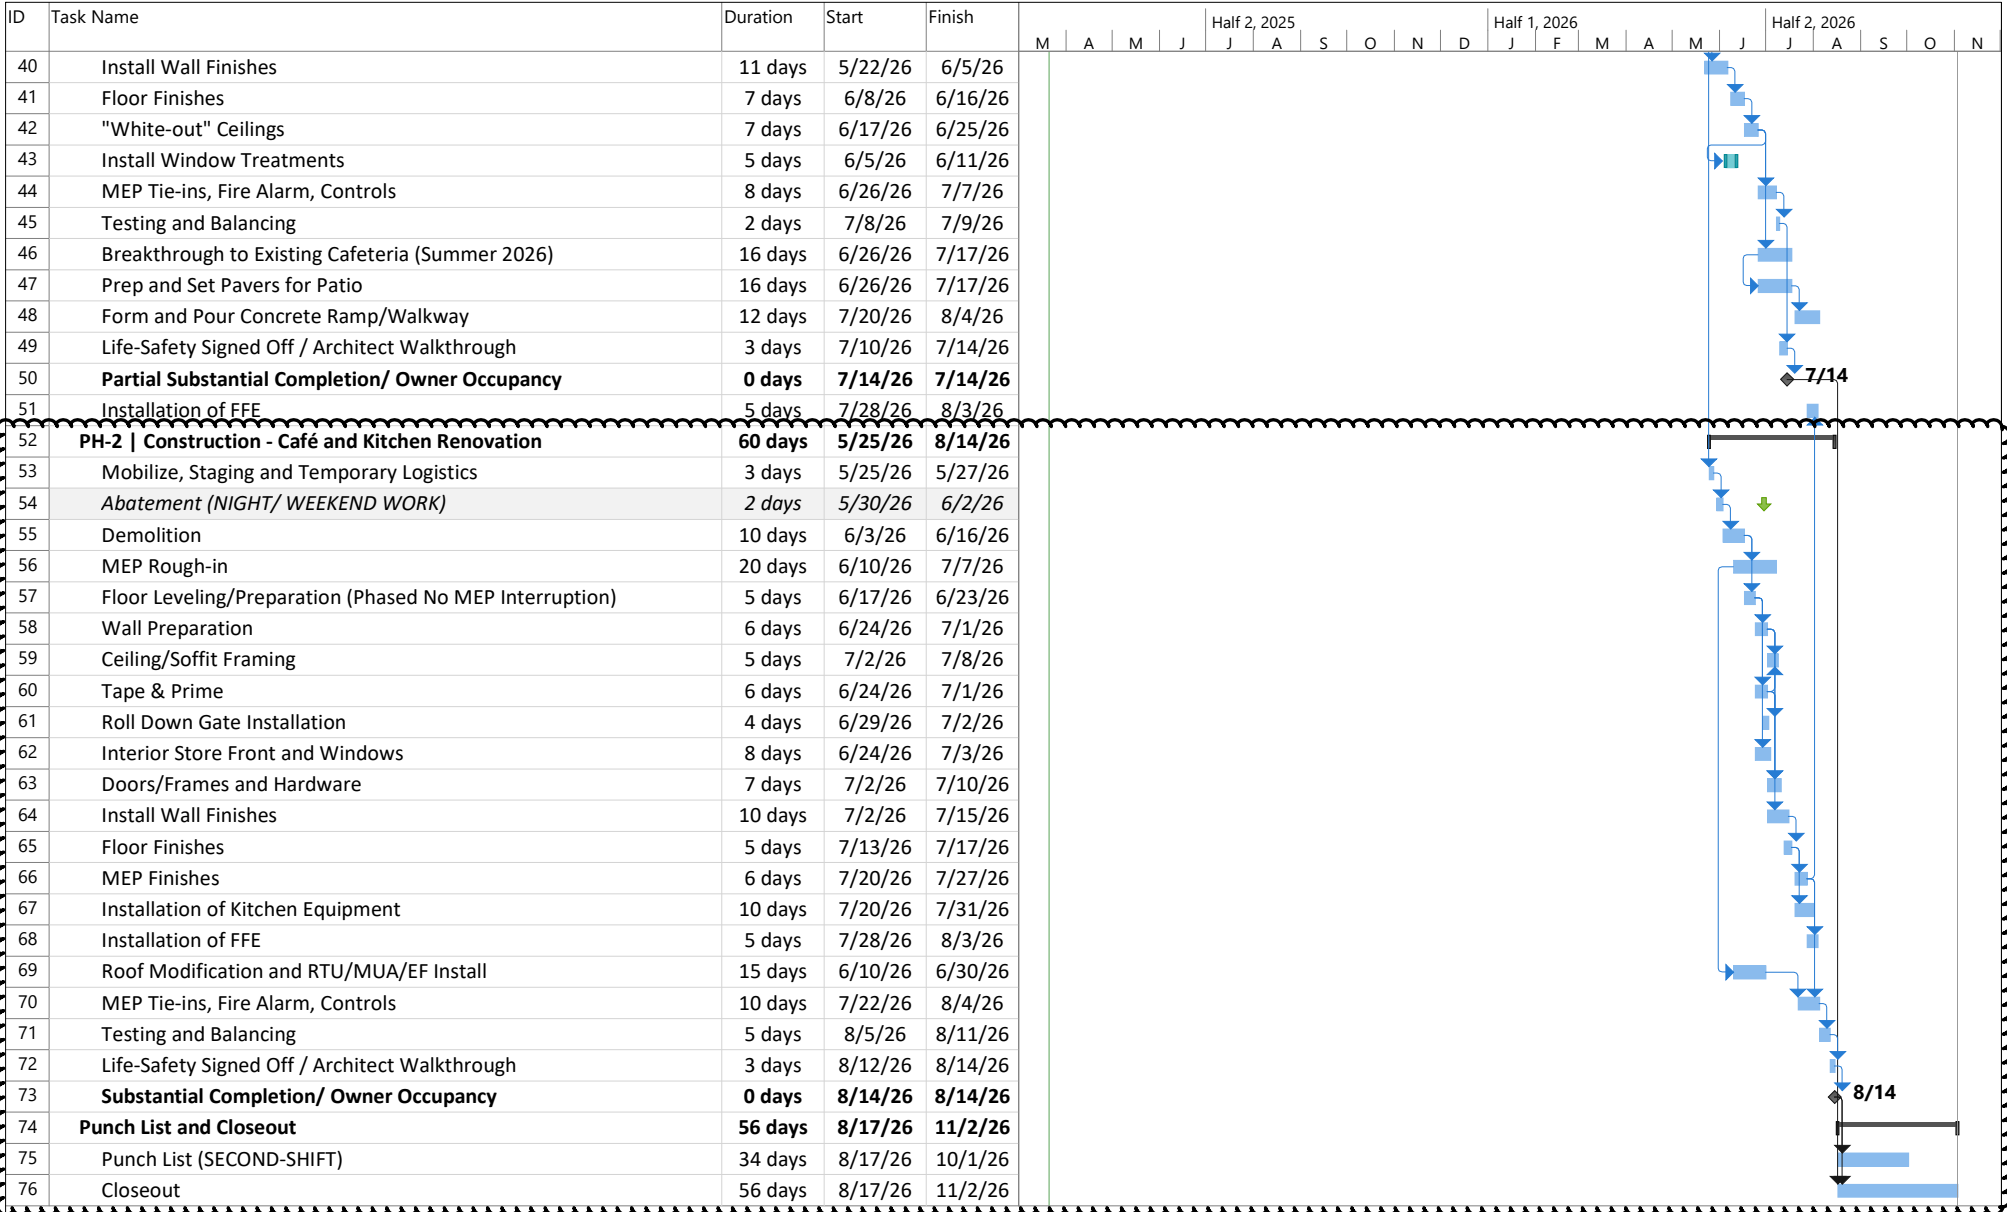


PLOT DATE: February 28, 2025 -- 8:10am

NOTES:

1. FABRIC: ASTM A392, 2" MESH, 6 GAUGE STEEL CHAIN LINK FENCE FABRIC, HOT DIPPED GALVANIZED AFTER WEAVING TO 1.2 OZ/SF.
2. TOP AND BRACE RAILS: ASTM F1043 1.66" O.D. (1.84 LBS./FT.) SS40 STEEL PIPE, HOT DIPPED GALVANIZED TO 1.8 OZ/SF IN ACCORDANCE WITH ASTM A123.
3. LINE POSTS: ASTM F1043 2.375" O.D. (3.12 LBS./FT.) SS40 STEEL PIPE, HOT DIPPED GALVANIZED TO 1.8 OZ/SF IN ACCORDANCE WITH ASTM A123.
4. END, CORNER & PULL POSTS: ASTM F1043 2.875" O.D. (4.64 LBS./FT.) SS40 STEEL PIPE, HOT DIPPED GALVANIZED TO 1.8 OZ/SF IN ACCORDANCE WITH ASTM A123.
5. FITTINGS AND ACCESSORIES: ASTM F626 MALLEABLE OR PRESSED STEEL, HOT DIPPED GALVANIZED TO 1.2 OZ/SF.
6. BOTTOM TENSION WIRE: ASTM A824 NO. 7 GAUGE STEEL-MARCELLED WIRE, HOT DIPPED GALVANIZED TO 1.2 OZ/SF.
7. STRETCHER BAR: 3/16" x 3/4" PRESSED STEEL, HOT DIPPED GALVANIZED TO 1.2 OZ/SF.
8. WHERE FENCING NEEDS TO BE ADJUSTABLE, PORTABLE FENCE BASES ARE ACCEPTABLE WITH SAND BAGS RATED PER THE DRIVEN POST SPECIFICATIONS.
9. ALL CHAINLINK FENCING AND GATING SHALL BE COVERED WITH 500 LBS/FT² 175GSM WINDSCREEN WITH 90% SHADE PERCENTAGE, AND NFPA 701 TEST METHOD II RATED.

2 Chain Link Fence - Galvanized - 6' Height

SCALE: NTS

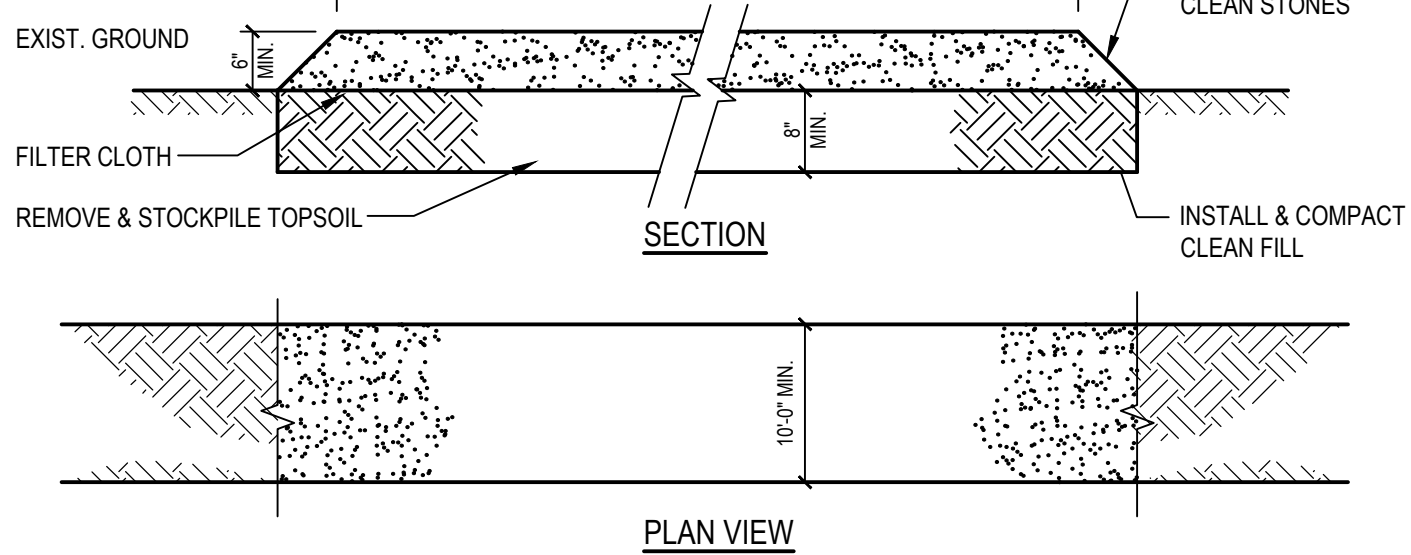

CONSTRUCTION SPECIFICATIONS:

1. STONE SIZE - USE 3' - 4" DIAMETER STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT
2. LENGTH - AS SHOWN OR AS DIRECTED BY THE CONSTRUCTION MANAGER
3. THICKNESS - NOT LESS THAN SIX (6) INCHES
4. WIDTH - TEN (10) FOOT MINIMUM, BUT NOT LESS THAN THE DULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS
5. FILTER CLOTH - WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING THE STONE
6. MAINTENANCE - THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEAN OUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
7. WASHING - WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS-OF-WAYS. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO APPROVED SEDIMENT TRAPPING DEVICE.
8. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RUN
9. LOCATION - AS SHOWN ON PLANS OR AS DIRECTED BY THE CONSTRUCTION MANAGER
10. AT JOBS COMPLETION THE GENERAL CONTRACTOR IS TO REMOVE THE TEMPORARY CONSTRUCTION ROAD & COMPACTED FILL AND INSTALL STOCKPILE TOPSOIL, GRADE AND SEED

5 Temporary Construction Road/
Temporary Drop Off/ Laydown Area

SCALE: NTS

CONTRACTOR'S RESPONSIBILITY FOR TEMPORARY WALLS AND PROTECTION

PURPOSE: TO ENSURE THE SAFETY AND COMFORT OF OCCUPANTS IN ADJACENT BUILDINGS DURING CONSTRUCTION ACTIVITIES BY PROVIDING NECESSARY TEMPORARY WALLS AND PROTECTION.

SCOPE: THIS NOTE APPLIES TO ALL CONSTRUCTION ACTIVITIES THAT INTERSECT WITH OR ARE IN CLOSE PROXIMITY TO OCCUPIED PORTIONS OF ADJACENT BUILDINGS.

SAFETY CONSIDERATIONS:

1.BARRIER INSTALLATION: INSTALL TEMPORARY WALLS AND BARRIERS TO SEPARATE CONSTRUCTION AREAS FROM OCCUPIED SPACES. THESE BARRIERS SHOULD BE STURDY, DUST-PROOF, AND SOUND-INSULATING TO MINIMIZE DISRUPTION.

2.ACCESS CONTROL: ENSURE THAT TEMPORARY WALLS INCLUDE SECURE ACCESS POINTS FOR AUTHORIZED PERSONNEL ONLY, PREVENTING UNAUTHORIZED ENTRY INTO CONSTRUCTION ZONES.

3.SIGNAGE: PLACE CLEAR AND VISIBLE SIGNAGE INDICATING CONSTRUCTION ZONES, RESTRICTED AREAS, AND SAFE PATHWAYS FOR OCCUPANTS.

4.ENVIRONMENTAL CONTROLS: IMPLEMENT MEASURES TO CONTROL DUST, NOISE, AND VIBRATIONS TO PROTECT THE HEALTH AND COMFORT OF BUILDING OCCUPANTS.

CONTRACTOR RESPONSIBILITIES:

1.PRE-WORK PLANNING: DEVELOP A DETAILED PLAN FOR THE INSTALLATION OF TEMPORARY WALLS AND PROTECTION MEASURES BEFORE STARTING CONSTRUCTION ACTIVITIES. THIS PLAN SHOULD INCLUDE THE TYPE OF BARRIERS TO BE USED, THEIR LOCATIONS, AND INSTALLATION PROCEDURES.

2.CONTINUOUS MONITORING: REGULARLY INSPECT TEMPORARY WALLS AND BARRIERS TO ENSURE THEY REMAIN EFFECTIVE AND INTACT THROUGHOUT THE CONSTRUCTION PERIOD. ADDRESS ANY ISSUES OR DAMAGES PROMPTLY.

3.COORDINATION: COORDINATE WITH BUILDING MANAGEMENT AND OCCUPANTS TO MINIMIZE DISRUPTION AND ENSURE THAT TEMPORARY PROTECTION MEASURES MEET THEIR NEEDS AND CONCERNS.

4.COMPLIANCE: ENSURE THAT ALL TEMPORARY WALLS AND PROTECTION MEASURES COMPLY WITH RELEVANT SAFETY REGULATIONS AND BUILDING CODES.

APPROVAL PROCESS:

1.PLAN SUBMISSION: SUBMIT THE TEMPORARY PROTECTION PLAN TO THE CONSTRUCTION MANAGER, ARCHITECT, AND OWNER FOR REVIEW AND APPROVAL BEFORE COMMENCING ANY WORK.

2.ONGOING COMMUNICATION: MAINTAIN OPEN LINES OF COMMUNICATION WITH ALL STAKEHOLDERS TO ADDRESS ANY CONCERNS OR ADJUSTMENTS NEEDED DURING THE CONSTRUCTION PROCESS.

3.INCIDENT REPORTING: REPORT ANY INCIDENTS OR BREACHES OF TEMPORARY PROTECTION MEASURES TO THE CONSTRUCTION MANAGER IMMEDIATELY AND TAKE CORRECTIVE ACTIONS TO PREVENT RECURRENCE.

FOR FURTHER INFORMATION, REVIEW PROJECT'S SPECIFICATIONS.

ATTENTION !

AUTHORIZED PERSONNEL ONLY
SAFETY STARTS HERE

Jobsite Requirements:

- All visitors must check in at the project office where identification badges will be issued.
- All accidents must be reported to Construction Manager immediately.
- Material Safety Data Sheets are required for all materials brought onto the jobsite.

Jobsite Rules:

- Possessing and/or working under the influence of drugs and/or alcohol is prohibited.
- No firearms or weapons of any kind are permitted on site.
- Hard hats must be worn at all times.
- Protective eye wear is required.
- No smoking.
- No loitering.
- ALL trade persons must wear shirts with sleeves, long pants, and proper footwear.

ANY PERSONS FOUND IN VIOLATION OF THESE REQUIREMENTS WILL BE REMOVED FROM THE JOBSITE AT THE DISCRETION OF THE PROJECT MANAGER

1 CONSTRUCTION GATE SIGN

SCALE: N.T.S.

CONTRACTOR'S RESPONSIBILITY TO PROTECT OPEN TRENCHES

THE FOLLOWING OUTLINES THE RESPONSIBILITIES OF CONTRACTORS IN ENSURING THE SAFETY AND PROTECTION OF OPEN TRENCHES DURING CONSTRUCTION ACTIVITIES.

THE FOLLOWING NOTES APPLY TO ALL CONSTRUCTION ACTIVITIES INVOLVING OPEN TRENCHES ON AND AROUND THE WORK SITE.

SAFETY CONSIDERATIONS:

1.TRENCH STABILITY: ENSURE THAT ALL TRENCHES ARE PROPERLY SHORED OR SLOPED TO PREVENT COLLAPSES. REGULARLY INSPECT TRENCH WALLS FOR SIGNS OF INSTABILITY.

2.ACCESS AND EGRESS: PROVIDE SAFE MEANS OF ACCESS AND EGRESS FOR WORKERS, SUCH AS LADDERS, STEPS, OR RAMPS, WITHIN 25 FEET OF ALL WORKERS IN THE TRENCH, OR PER FEDERAL/STATE LAW (OSHA, NIOSH, ETC..)

3.BARRICADES AND SIGNAGE: ERECT STURDY BARRICADES AROUND OPEN TRENCHES TO PREVENT ACCIDENTAL FALLS. PLACE CLEAR AND VISIBLE WARNING SIGNS TO ALERT WORKERS AND THE PUBLIC OF THE HAZARD.

4.PROTECTIVE SYSTEMS: USE PROTECTIVE SYSTEMS SUCH AS TRENCH BOXES OR SHIELDS TO SAFEGUARD WORKERS FROM CAVE-INS.

5.WEATHER CONDITIONS: MONITOR WEATHER CONDITIONS AND TAKE NECESSARY PRECAUTIONS TO PROTECT TRENCHES FROM FLOODING OR EROSION.

CONTRACTOR RESPONSIBILITIES:

1.PRE-WORK PLANNING: DEVELOP A COMPREHENSIVE TRENCH SAFETY PLAN BEFORE STARTING ANY EXCAVATION WORK. THIS PLAN SHOULD INCLUDE DETAILS ON PROTECTIVE SYSTEMS, ACCESS AND EGRESS, AND EMERGENCY PROCEDURES.

2.DAILY INSPECTIONS: CONDUCT DAILY INSPECTIONS OF OPEN TRENCHES BY A COMPETENT PERSON TO ENSURE COMPLIANCE WITH SAFETY STANDARDS AND IDENTIFY ANY POTENTIAL HAZARDS.

3.TRAINING: PROVIDE TRAINING TO ALL WORKERS ON TRENCH SAFETY, INCLUDING THE PROPER USE OF PROTECTIVE SYSTEMS AND EMERGENCY RESPONSE PROCEDURES.

4.COMMUNICATION: MAINTAIN CLEAR COMMUNICATION WITH ALL SITE PERSONNEL REGARDING THE LOCATION AND STATUS OF OPEN TRENCHES. USE VISUAL AIDS SUCH AS MAPS AND MARKERS TO INDICATE TRENCH LOCATIONS.

5.EMERGENCY PREPAREDNESS: ESTABLISH AND COMMUNICATE EMERGENCY RESPONSE PROCEDURES IN CASE OF A TRENCH COLLAPSE OR OTHER INCIDENTS. ENSURE THAT ALL WORKERS ARE FAMILIAR WITH THESE PROCEDURES.

APPROVAL PROCESS:

1.SAFETY PLAN SUBMISSION: SUBMIT THE TRENCH SAFETY PLAN TO THE CONSTRUCTION MANAGER AND ARCHITECT FOR REVIEW AND APPROVAL BEFORE COMMENCING EXCAVATION WORK.

2.ONGOING MONITORING: CONTINUOUSLY MONITOR TRENCH CONDITIONS AND SAFETY MEASURES THROUGHOUT THE CONSTRUCTION PROCESS. MAKE ADJUSTMENTS AS NEEDED TO ADDRESS ANY EMERGING RISKS.

3.INCIDENT REPORTING: REPORT ANY INCIDENTS OR NEAR-MISSES INVOLVING OPEN TRENCHES TO THE CONSTRUCTION MANAGER AND TAKE IMMEDIATE CORRECTIVE ACTIONS TO PREVENT RECURRENCE.

FOR FURTHER INFORMATION, REVIEW PROJECT'S SPECIFICATIONS.

CRANE USE NEAR EXISTING BUILDINGS

THE FOLLOWING NOTE ARE TO HELP ENSURE SAFE AND EFFICIENT USE OF CRANES IN AND AROUND THE WORK SITE, PARTICULARLY NEAR EXISTING BUILDINGS, WHILE MINIMIZING RISKS TO OCCUPANTS AND PROPERTY.

THIS NOTE APPLIES TO ALL CRANE OPERATIONS CONDUCTED WITHIN THE VICINITY OF EXISTING BUILDINGS ON THE WORK SITE.

SAFETY CONSIDERATIONS:

1.SITE ASSESSMENT: CONDUCT A THOROUGH ASSESSMENT OF THE WORK SITE TO IDENTIFY POTENTIAL HAZARDS, INCLUDING PROXIMITY TO EXISTING BUILDINGS, OVERHEAD POWER LINES, AND UNDERGROUND UTILITIES.

2.LOAD CAPACITY: ENSURE THAT THE CRANE'S LOAD CAPACITY IS APPROPRIATE FOR THE TASKS AT HAND AND THAT ALL LOADS ARE SECURELY FASTENED.

3.WEATHER CONDITIONS: MONITOR WEATHER CONDITIONS CLOSELY, AS ADVERSE WEATHER CAN IMPACT CRANE STABILITY AND SAFETY.

4.COMMUNICATION: ESTABLISH CLEAR COMMUNICATION PROTOCOLS BETWEEN CRANE OPERATORS, GROUND PERSONNEL, AND SITE SUPERVISORS TO ENSURE COORDINATED AND SAFE OPERATIONS.

5.EXCLUSION ZONES: DESIGNATE EXCLUSION ZONES AROUND THE CRANE'S OPERATING AREA TO PREVENT UNAUTHORIZED ACCESS AND ENSURE THE SAFETY OF ALL PERSONNEL.

APPROVAL PROCESS:

1.PRE-WORK REVIEW: ALL CRANE OPERATIONS MUST BE REVIEWED WITH THE CONSTRUCTION MANAGER, ARCHITECT, AND OWNER PRIOR TO COMMENCING. THIS REVIEW SHOULD INCLUDE A DETAILED DISCUSSION OF THE PLANNED ACTIVITIES, POTENTIAL RISKS, AND MITIGATION MEASURES.

2.WORK-PLAN SUBMISSION: A COMPREHENSIVE WORK-PLAN OUTLINING THE CRANE OPERATIONS MUST BE SUBMITTED IN WRITING TO THE CONSTRUCTION MANAGER AND ARCHITECT. THIS PLAN SHOULD INCLUDE:

- o A DETAILED DESCRIPTION OF THE CRANE'S SPECIFICATIONS AND CAPABILITIES.
- o A STEP-BY-STEP OUTLINE OF THE PLANNED CRANE ACTIVITIES.
- o RISK ASSESSMENT AND MITIGATION STRATEGIES.
- o EMERGENCY RESPONSE PROCEDURES.

3.APPROVAL: THE SUBMITTED WORK-PLAN IS SUBJECT TO APPROVAL BY THE CONSTRUCTION MANAGER AND ARCHITECT. NO CRANE OPERATIONS MAY COMMENCE UNTIL WRITTEN APPROVAL IS OBTAINED.

4.ONGOING MONITORING: ONCE APPROVED, CRANE OPERATIONS MUST BE CONTINUOUSLY MONITORED TO ENSURE COMPLIANCE WITH THE APPROVED WORK-PLAN AND TO ADDRESS ANY EMERGING SAFETY CONCERNS PROMPTLY.

FOR FURTHER INFORMATION, REVIEW PROJECT'S SPECIFICATIONS.

AS PER USA CONGRESS ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT OF 1990 ALL IDEAS AND DESIGNS INCLUDING DERIVATIVES THEREOF, ALL DRAWINGS AND SPECIFICATIONS CONSTITUTE THE ORIGINAL COPYRIGHT WORK BY FULLER AND DANKELO, P.C. (F&D). THE DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE BY F&D ARE CREATED BY F&D FOR THIS PROJECT ONLY AND REMAIN THE PRODUCT AND PROPERTY OF F&D. ANY REPRODUCTION WITHOUT THE PRIOR CONSENT OF F&D IS PROHIBITED.

Landscape Architect/Engineer
Barton & Loguidice
247A ROUTE 100, SUITE 2007, SOMERS, NEW YORK 10589
914.232.3646 PHONE
WWW.BARTONANDLOGUIDICE.COM

ALTERATION OF THESE DOCUMENTS EXCEPT BY A VOTATION OF NEW YORK STATE EDUCATION LAW.

48 ENCLWOOD ROAD ELMSFORD NEW YORK 10523
TEL 914.898.4444 FAX 914.898.1919
WWW.FULLERDANGELO.COM
Copyright 2025 All Rights Reserved By FULLER & DANKELO, P.C.

FULLER
DANGELO
P.C.
ARCHITECTS
PLANNERS

TRITON
CONSTRUCTION

Triton Construction Company
Main Office | 550 7th Ave., 4th Floor
New York, New York 10018
Uptown Office | 1275 Route 300 1st
Floor Newburgh, New York 12550
office 212.388.5700 | mobile
516.427.2560

S.E.C. CONTROL NUMBER
HIGH SCHOOL ADMINISTRATION BUILDING
66-04-00-00-001-0015

PROJECT: EGEDMONT SCHOOL DISTRICT
ADMINISTRATION BUILDING ADDITION, SITE
IMPROVEMENTS & RELATED WORK
300 WHITE OAK LANE, SCARSDALE, NY 10583

DRAWING TITLE
LOGISTICS GENERAL NOTES AND DETAILS

03-25-2025
DATE

ADDENDUM #02
ISSUED TO


SHEET SIZE
30"x42"

SCALE
AS NOTED

DRAWN BY
TCC



FILE NO.
24529.02

DRAWING NO.
L001

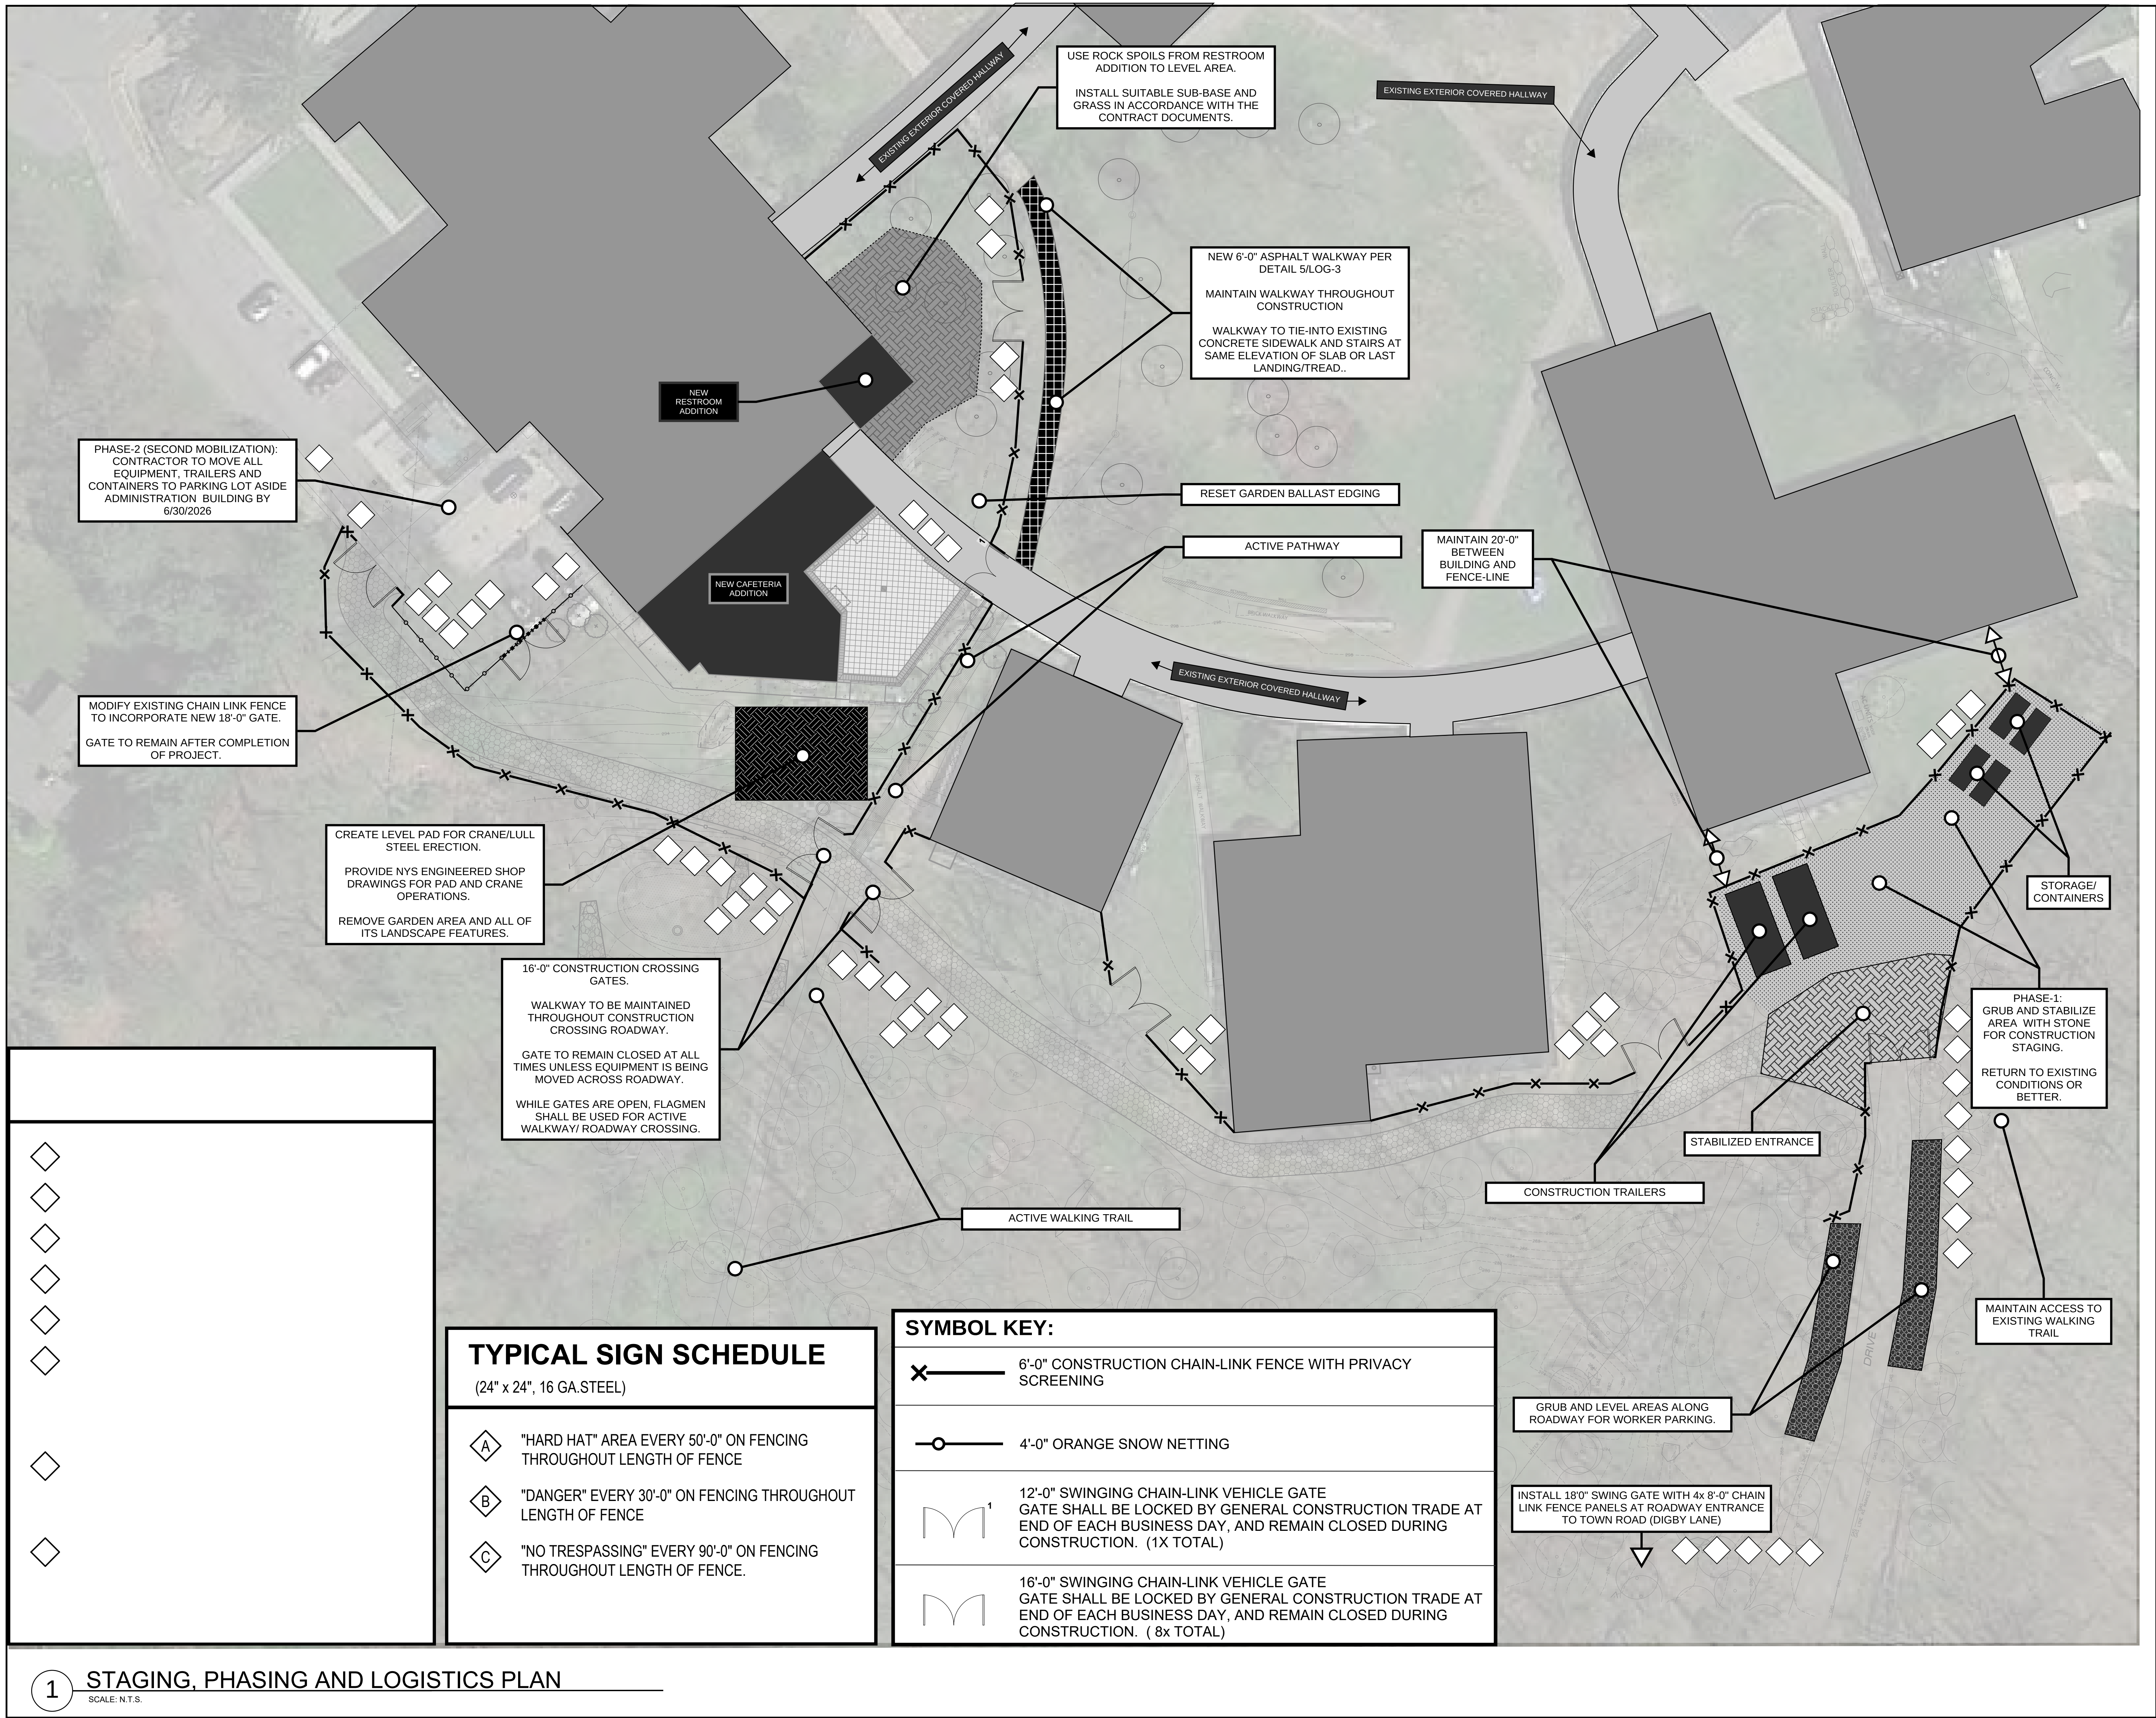

PLOT DATE: February 28, 2025 -- 8:10am

FILE: Z:\BL-Vault\ID2\18217AD2-1C71-4823-8927-99D5C4054147\0\3277000-3277999\3277624\L\L\2062006_EHS_Civil_Design_2025 (ID 3277624).dwg

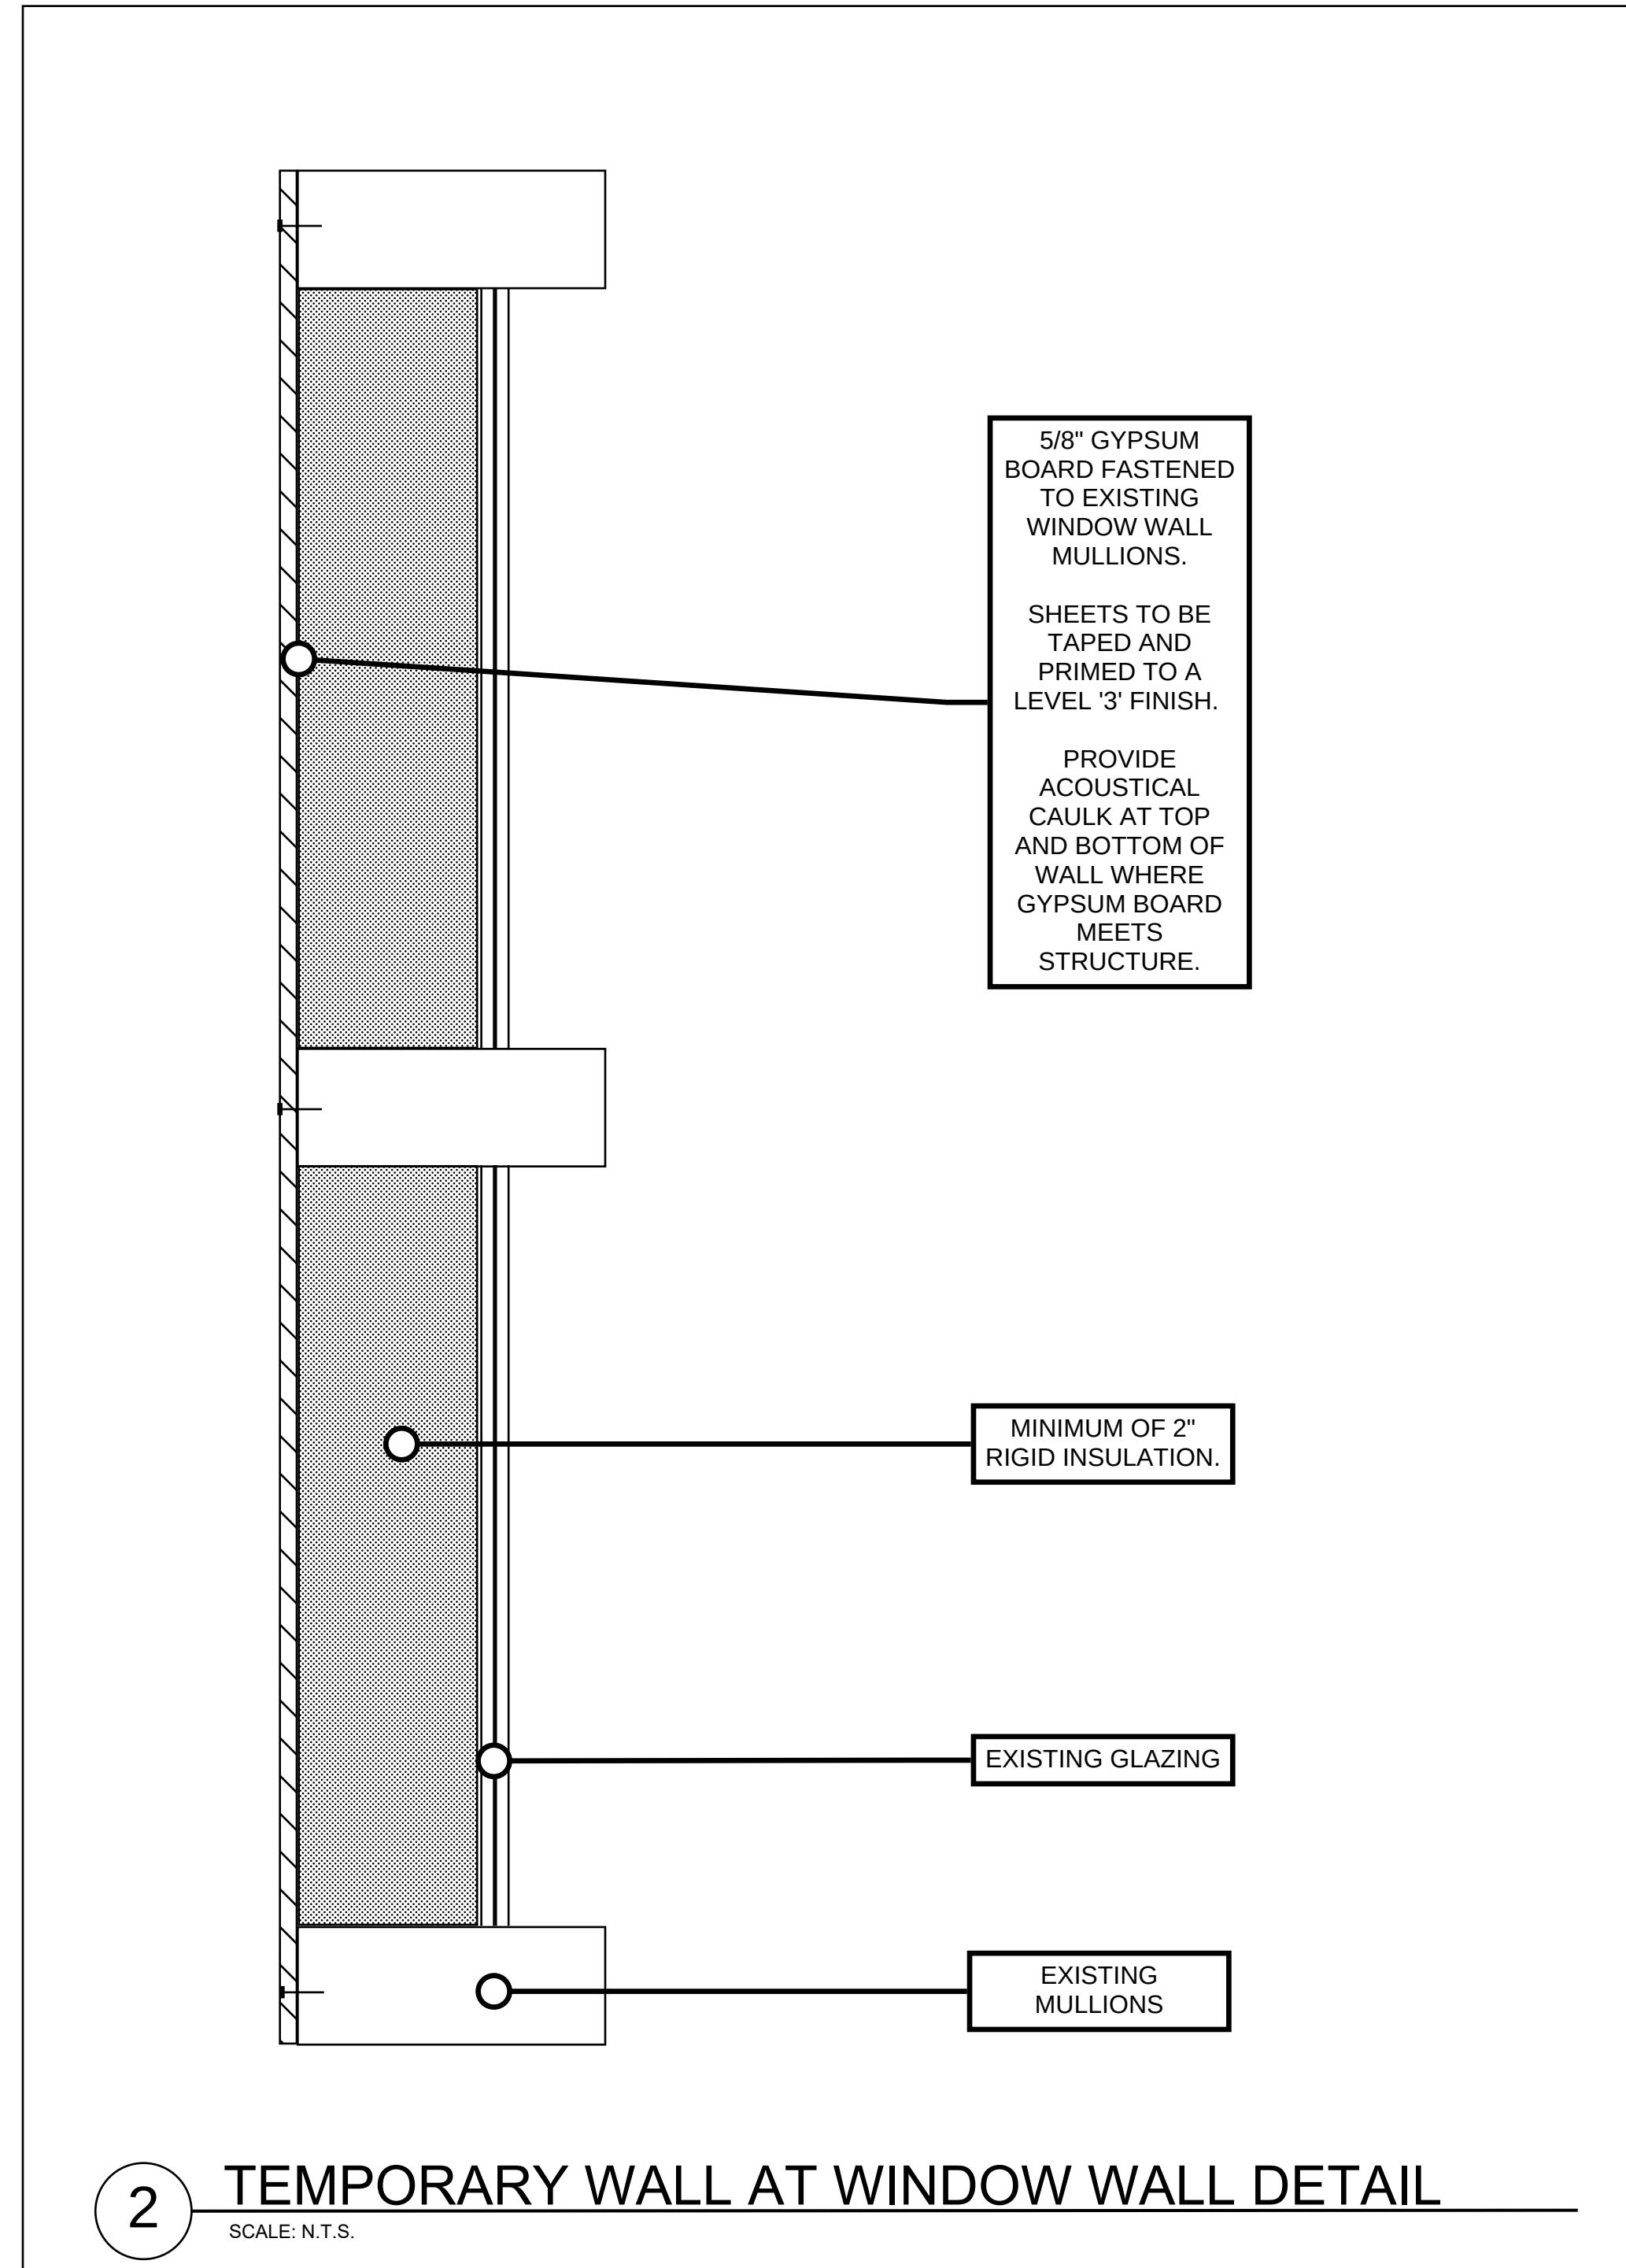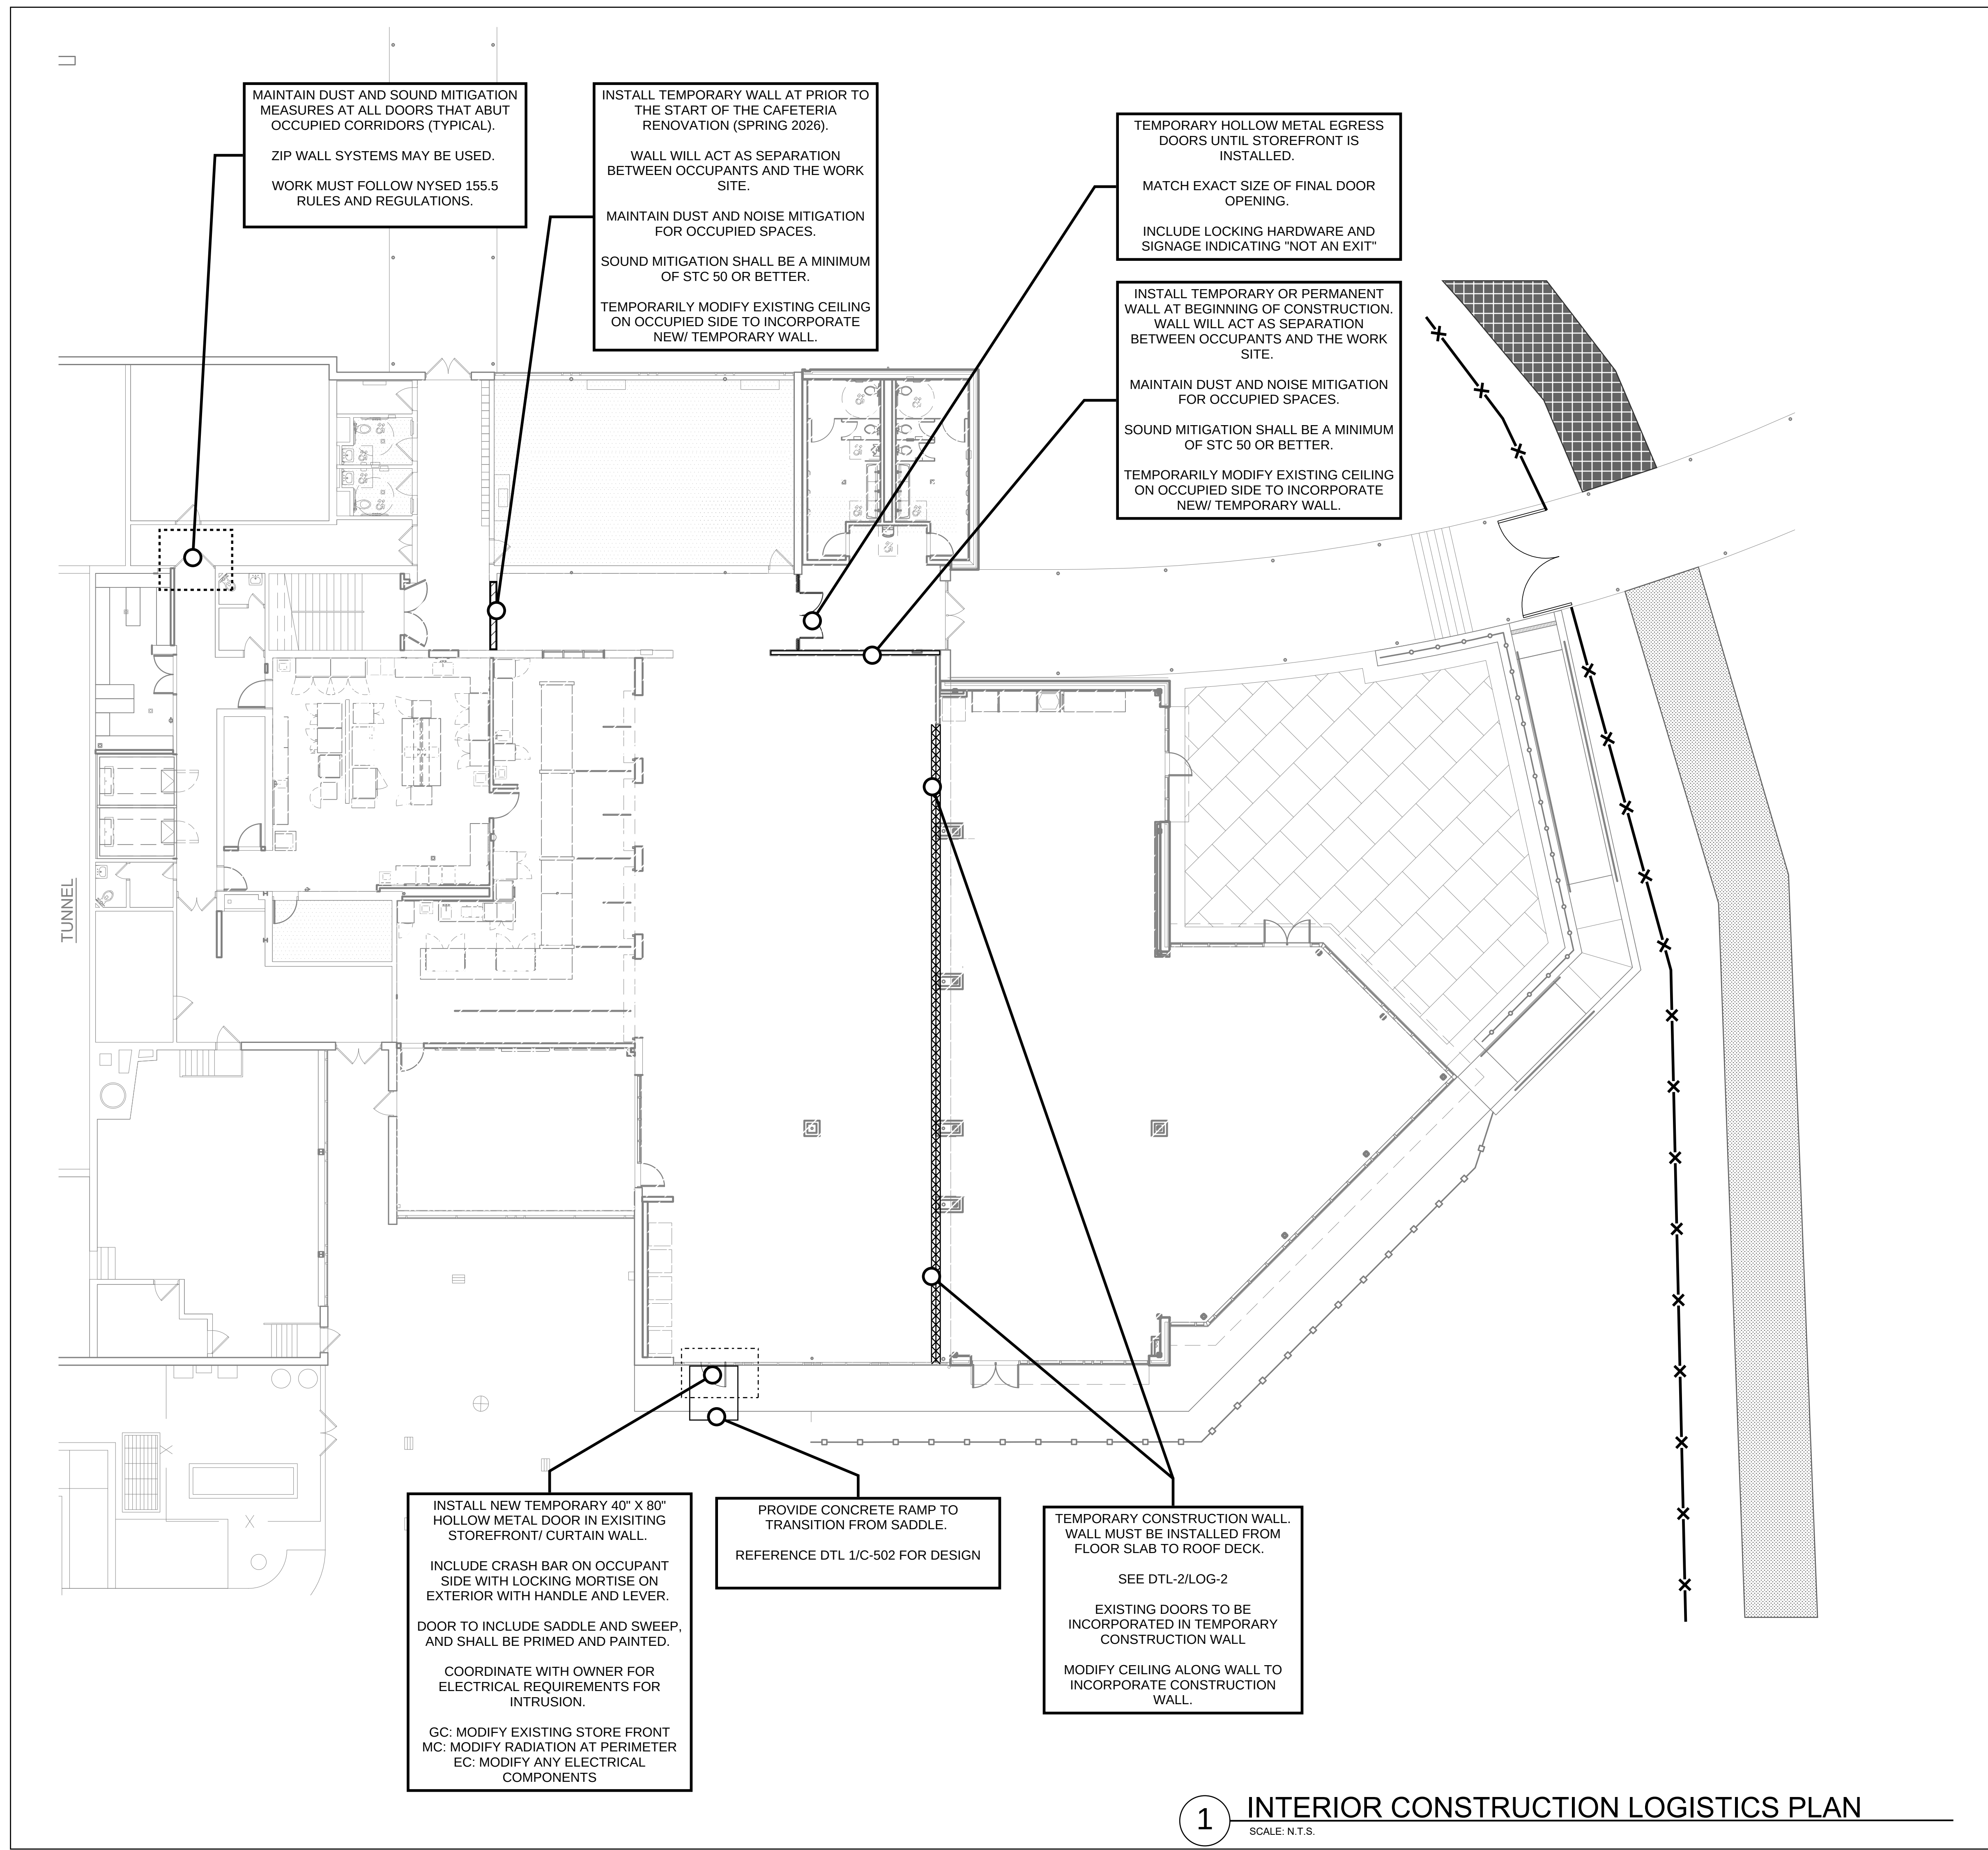

AS PER USA CONGRESS ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT OF 1990 ALL IDEAS AND DESIGNS INCLUDING DERIVATIVES THEREOF, ALL DRAWINGS AND SPECIFICATIONS CONSTITUTE THE ORIGINAL COPYRIGHT WORK BY FULLER AND DANIELO, P.C. (F&D). THE DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE BY F&D ARE CREATED BY F&D FOR THIS PROJECT ONLY AND REMAIN THE PRODUCT AND PROPERTY OF F&D. ANY REPRODUCTION WITHOUT THE PRIOR CONSENT OF F&D IS PROHIBITED.

Landscape Architect/Engineer
Barton & Loguidice
247A ROUTE 100, SUITE 2007, SOMERS, NEW YORK 10589
914.232.3646 PHONE WWW.BARTONANDLOGUIDICE.COM

ALTERATION OF THESE DOCUMENTS EXCEPT BY A SEPARATE DOCUMENT IS A VIOLATION OF NEW YORK STATE EDUCATION LAW.
48 ENCLWOOD ROAD ENCLAYWOOD NEW YORK 10923
TEL 914.899.4444 FAX 914.899.1917
Copyright 2025 All Rights Reserved by FULLER & DANIELO P.C.


FULLER
D'ANGELO
P.C.
ARCHITECTS
PLANNERS

TRITON CONSTRUCTION
Triton Construction Company
Main Office | 550 7th Ave., 4th Floor
New York, New York 10018
Uptown Office | 1275 Route 300 1st
Floor Newburgh, New York 12550
office 212.388.5700 | mobile
516.427.2160

S.E.C. CONTROL NUMBER
HIGH SCHOOL ADMINISTRATION BUILDING
66-04-05-03-001-015

PROJECT
EDGE MONT SCHOOL DISTRICT
ADMINISTRATION BUILDING ADDITION, SITE
IMPROVEMENTS & RELATED WORK
300 WHITE OAK LANE, SCARSDALE, NY 10583
DRAWING TITLE
INTERIOR LOGISTICS PLAN AT CAFETERIA

05-25-2025	ADDENDUM #03
DATE	ISSUED TO
SHEET SIZE 30"x42"	DRAWING NO. L102
SCALE AS NOTED	FILE NO. 24529.02
DRAWN BY TCC	

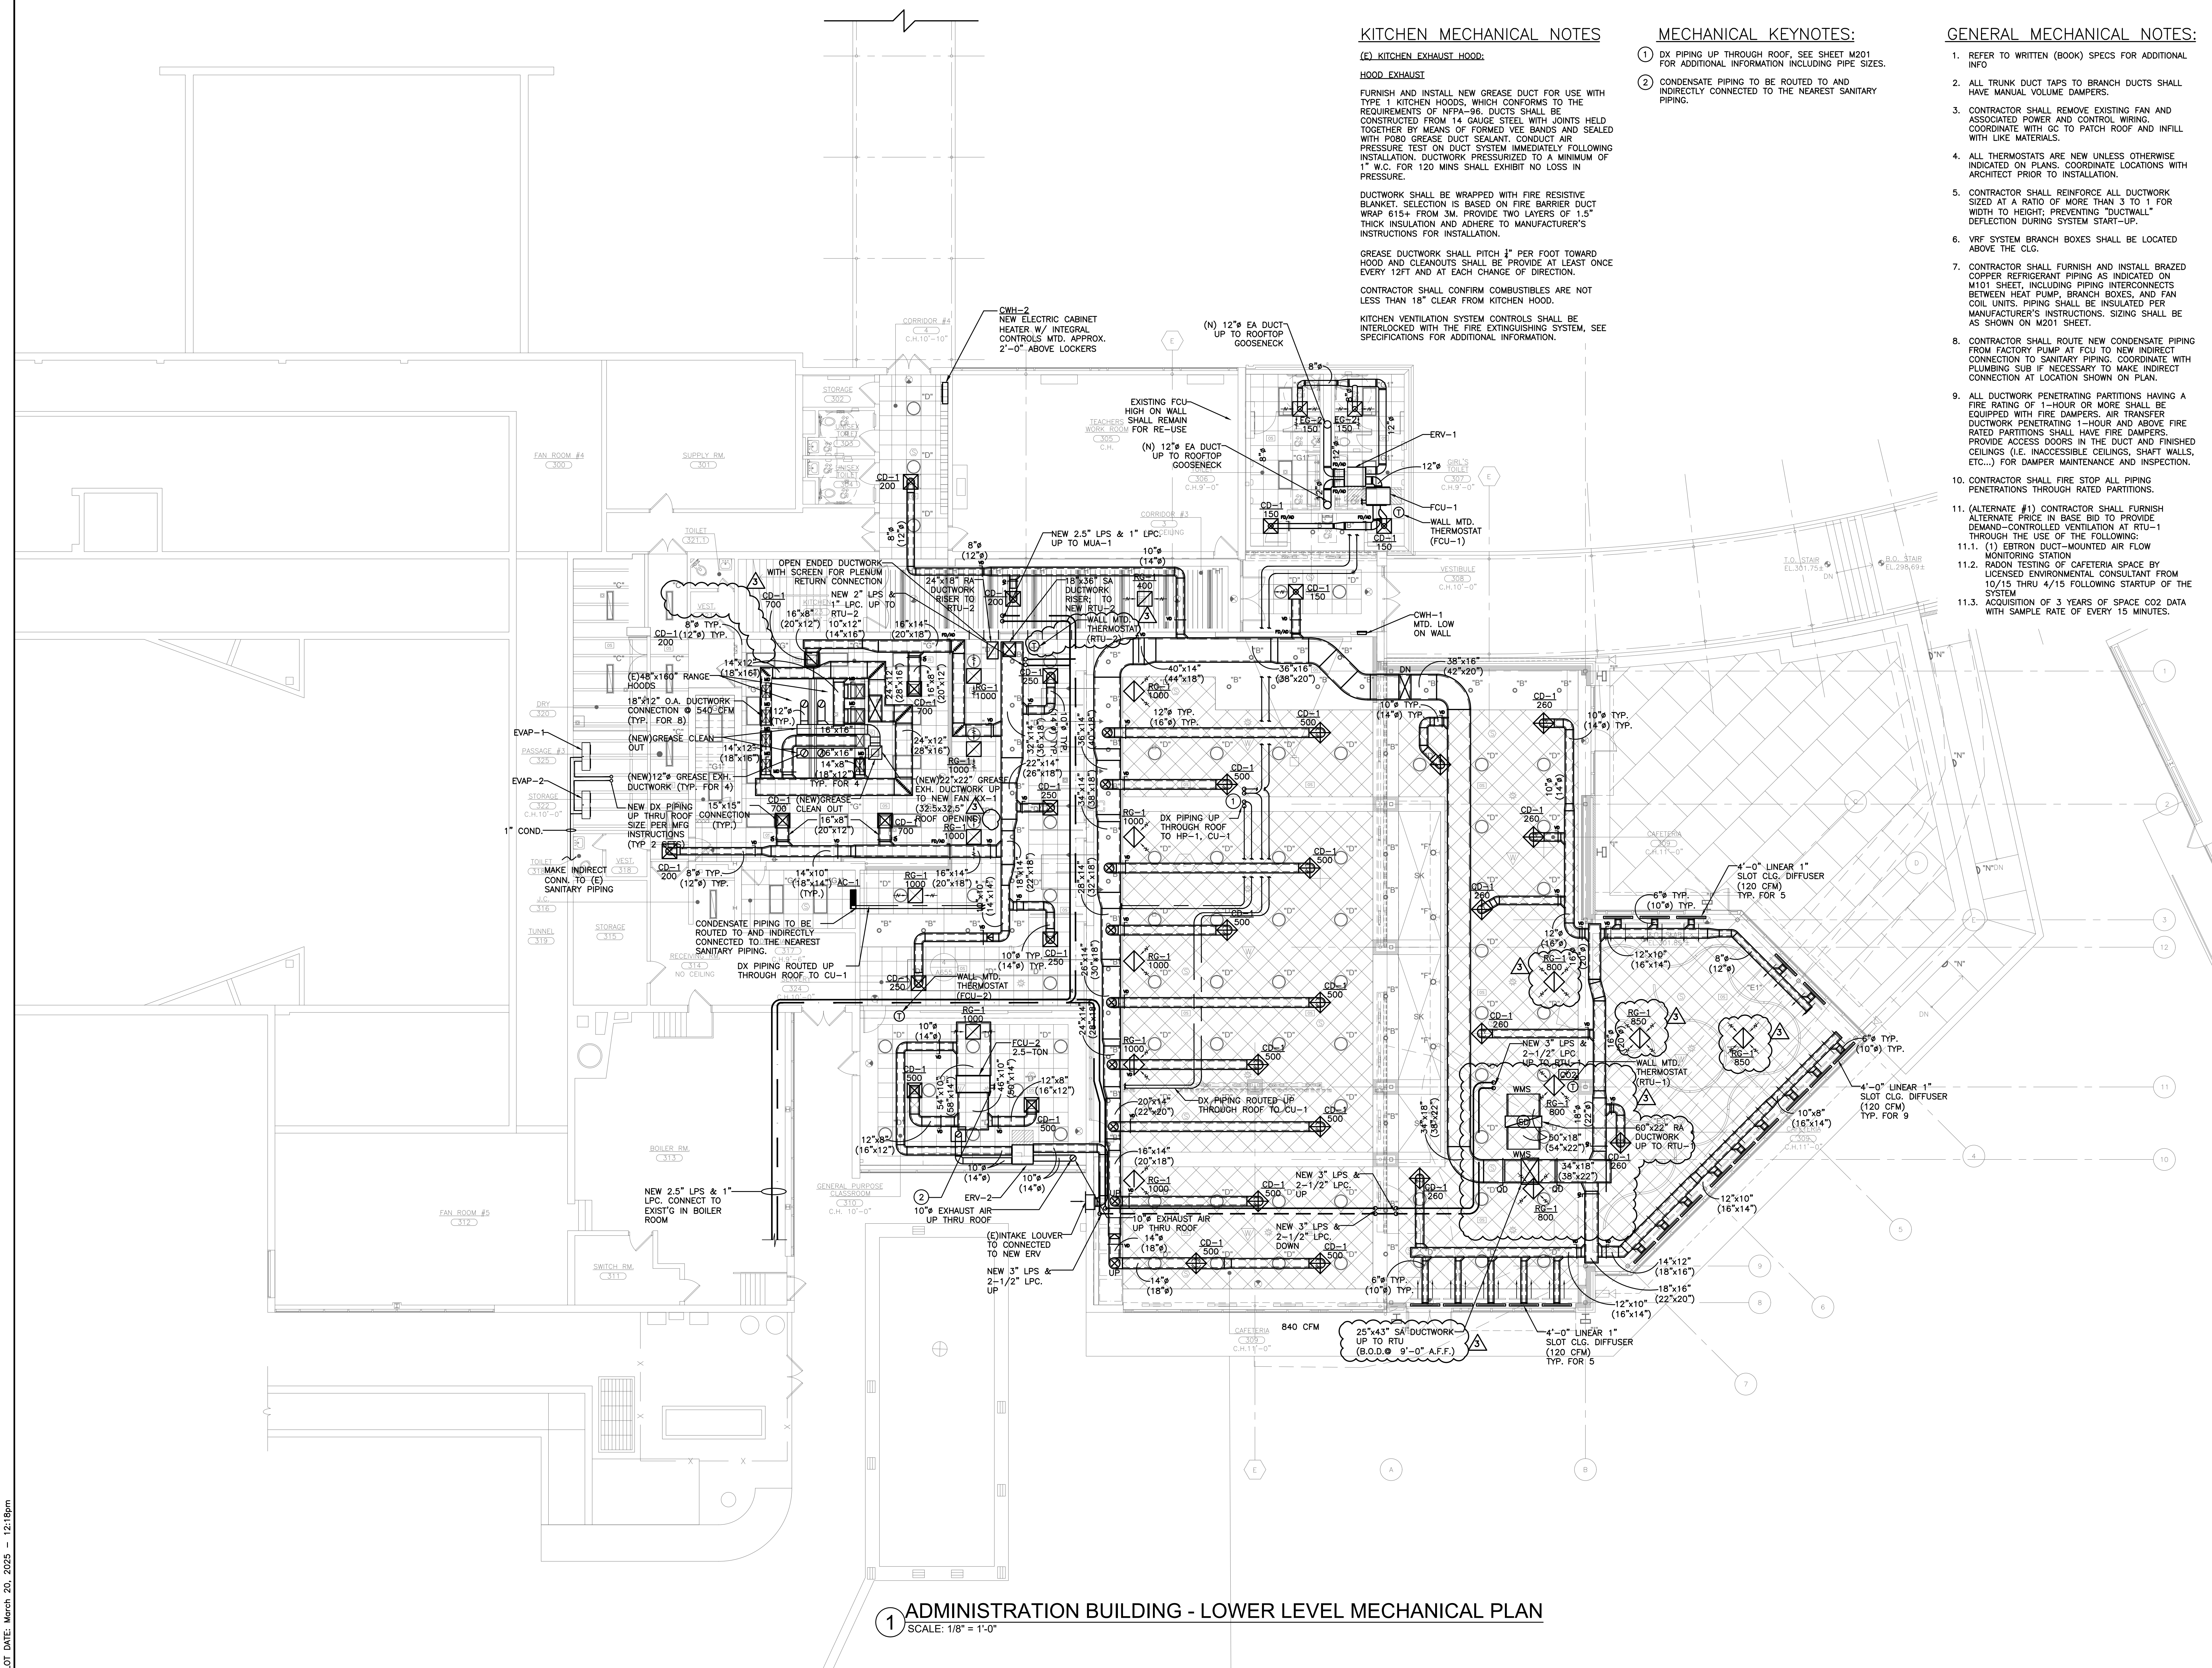

KITCHEN MECHANICAL NOTES

(E) KITCHEN EXHAUST HOOD:

HOOD EXHAUST

FURNISH AND INSTALL NEW GREASE DUCT FOR USE WITH TYPE 1 KITCHEN HOODS, WHICH CONFORMS TO THE REQUIREMENTS OF NFPA-96. DUCTS SHALL BE CONSTRUCTED FROM 14 GAUGE STEEL WITH JOINTS HELD TOGETHER BY MEANS OF FORMED VEE BANDS AND SEALED WITH P080 GREASE DUCT SEALANT. CONDUCT AIR PRESSURE TEST ON DUCT SYSTEM IMMEDIATELY FOLLOWING INSTALLATION. DUCTWORK PRESSURIZED TO A MINIMUM OF 1" W.C. FOR 120 MINS SHALL EXHIBIT NO LOSS IN PRESSURE.

DUCTWORK SHALL BE WRAPPED WITH FIRE RESISTIVE BLANKET. SELECTION IS BASED ON FIRE BARRIER DUCT WRAP 6154 FROM 3M. PROVIDE TWO LAYERS OF 1.5" THICK INSULATION AND ADHERE TO MANUFACTURER'S INSTRUCTIONS FOR INSTALLATION.

GREASE DUCTWORK SHALL PITCH 1/2" PER FOOT TOWARD HOOD AND CLEANOUTS SHALL BE PROVIDED AT LEAST ONCE EVERY 12FT AND AT EACH CHANGE OF DIRECTION.

CONTRACTOR SHALL CONFIRM COMBUSTIBLES ARE NOT LESS THAN 18" CLEAR FROM KITCHEN HOOD.

KITCHEN VENTILATION SYSTEM CONTROLS SHALL BE INTERLOCKED WITH THE FIRE EXTINGUISHING SYSTEM, SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.

MECHANICAL KEYNOTES:

1. DX PIPING UP THROUGH ROOF. SEE SHEET M201 FOR ADDITIONAL INFORMATION INCLUDING PIPE SIZES.
2. CONDENSATE PIPING TO BE ROUTED TO AND INDIRECTLY CONNECTED TO THE NEAREST SANITARY PIPING.

GENERAL MECHANICAL NOTES:

1. REFER TO WRITTEN (BOOK) SPECS FOR ADDITIONAL INFO
2. ALL TRUNK DUCT TAPS TO BRANCH DUCTS SHALL HAVE MANUAL VOLUME DAMPERS
3. CONTRACTOR SHALL REMOVE EXISTING FAN AND ASSOCIATED POWER AND CONTROL WIRING. COORDINATE WITH GC TO PATCH ROOF AND INFILL WITH LIKE MATERIALS.
4. ALL THERMOSTATS ARE NEW UNLESS OTHERWISE INDICATED ON PLANS. COORDINATE LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION.
5. CONTRACTOR SHALL REINFORCE ALL DUCTWORK SIZED AT A RATIO OF MORE THAN 3 TO 1 FOR WIDTH TO HEIGHT, PREVENTING "DUCTWALL" DEFLECTION DURING SYSTEM START-UP.
6. VRF SYSTEM BRANCH BOXES SHALL BE LOCATED ABOVE THE CLG.
7. CONTRACTOR SHALL FURNISH AND INSTALL BRAZED COPPER REFRIGERANT PIPING AS INDICATED ON M101 SHEET, INCLUDING PIPING INTERCONNECTS BETWEEN HEAT PUMP, BRANCH BOXES, AND FAN COIL UNITS. PIPING SHALL BE INSULATED PER MANUFACTURER'S INSTRUCTIONS. SIZING SHALL BE AS SHOWN ON M201 SHEET.
8. CONTRACTOR SHALL ROUTE NEW CONDENSATE PIPING FROM FACTORY PUMP AT FCU TO NEW INDIRECT CONNECTION TO SANITARY PIPING. COORDINATE WITH PLUMBING SUB IF NECESSARY TO MAKE INDIRECT CONNECTION AT LOCATION SHOWN ON PLAN.
9. ALL DUCTWORK PENETRATING PARTITIONS HAVING A FIRE RATING OF 1-HOUR OR MORE SHALL BE EQUIPPED WITH FIRE DAMPERS. AIR TRANSFER DUCTWORK PENETRATING 1-HOUR AND ABOVE FIRE RATED PARTITIONS SHALL HAVE FIRE DAMPERS. PROVIDE ACCESS DOORS IN THE DUCT AND FINISHED CEILINGS (I.E. INACCESSIBLE CEILINGS, SHAFT WALLS, ETC...) FOR DAMPER MAINTENANCE AND INSPECTION.
10. CONTRACTOR SHALL FIRE STOP ALL PIPING PENETRATIONS THROUGH RATED PARTITIONS.
11. (ALTERNATE #1) CONTRACTOR SHALL FURNISH ALTERNATE PRICE IN BASE BID TO PROVIDE DEMAND-CONTROLLED VENTILATION AT RTU-1 THROUGH THE USE OF THE FOLLOWING:
 - 11.1. (1) ETRON DUCT-MOUNTED AIR FLOW MONITORING STATION
 - 11.2. RADON TESTING OF CAFETERIA SPACE BY LICENSED ENVIRONMENTAL CONSULTANT FROM 10/15 THRU 4/15 FOLLOWING STARTUP OF THE SYSTEM
 - 11.3. ACQUISITION OF 3 YEARS OF SPACE CO2 DATA WITH SAMPLE RATE OF EVERY 15 MINUTES.

AS PER USA CONGRESS ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT OF 1990 ALL IDEAS AND DESIGNS INCLUDING DERIVATIVES THEREOF, ALL DRAWINGS AND SPECIFICATIONS CONSTITUTE THE ORIGINAL COPYRIGHT WORK BY FULLER AND DANKELO, P.C. (F&D). THE DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE BY F&D ARE CREATED BY F&D FOR THIS PROJECT ONLY AND REMAIN THE PROPERTY OF F&D. ANY REPRODUCTION WITHOUT THE PRIOR CONSENT OF F&D IS PROHIBITED.

ARTS

KEY PLAN

LANDMARK FACILITIES GROUP, INC.

252 East Avenue
Newark, NJ 07102
(201) 462-4622 T/F
(201) 462-4619 Fax

ALTERATION OF THESE DOCUMENTS WITHOUT THE WRITTEN CONSENT OF FULLER & DANKELO, P.C. IS PROHIBITED.

408 HANCOCK STREET
ELIZABETH, NJ 07208
TEL: 973-888-4444
Copyright 2025. All Rights Reserved by FULLER & DANKELO, P.C.

EDUCATION DISTRICT
ADMINISTRATION BUILDING ADDITION
IMPROVEMENTS & RELATED WORK
300 WHITE OAK LANE, CARSDALE, NY 10503


DRAWING TITLE
"ADMIN" BUILDING
LOWER LEVEL
MECHANICAL PLAN

03-20-2025	ADDENDUM #3
03-18-2025	ADDENDUM #2
03-12-2025	ADDENDUM #1
02-28-2025	BID SET
06-10-2022	S.E.D. SUBMISSION
DATE	ISSUED TO

SHEET SIZE 30"x42"	DRAWING NO. AD M100
SCALE AS NOTED	FILE NO. 24529.02
DRAWN BY LFG	


PLOT DATE: March 20, 2025 - 12:18pm

FILE: C:\Users\EHansen\AppData\Local\Temp\AcPublish_21116\EDGE JR-SR ADMIN_MECH New RTUs.dwg

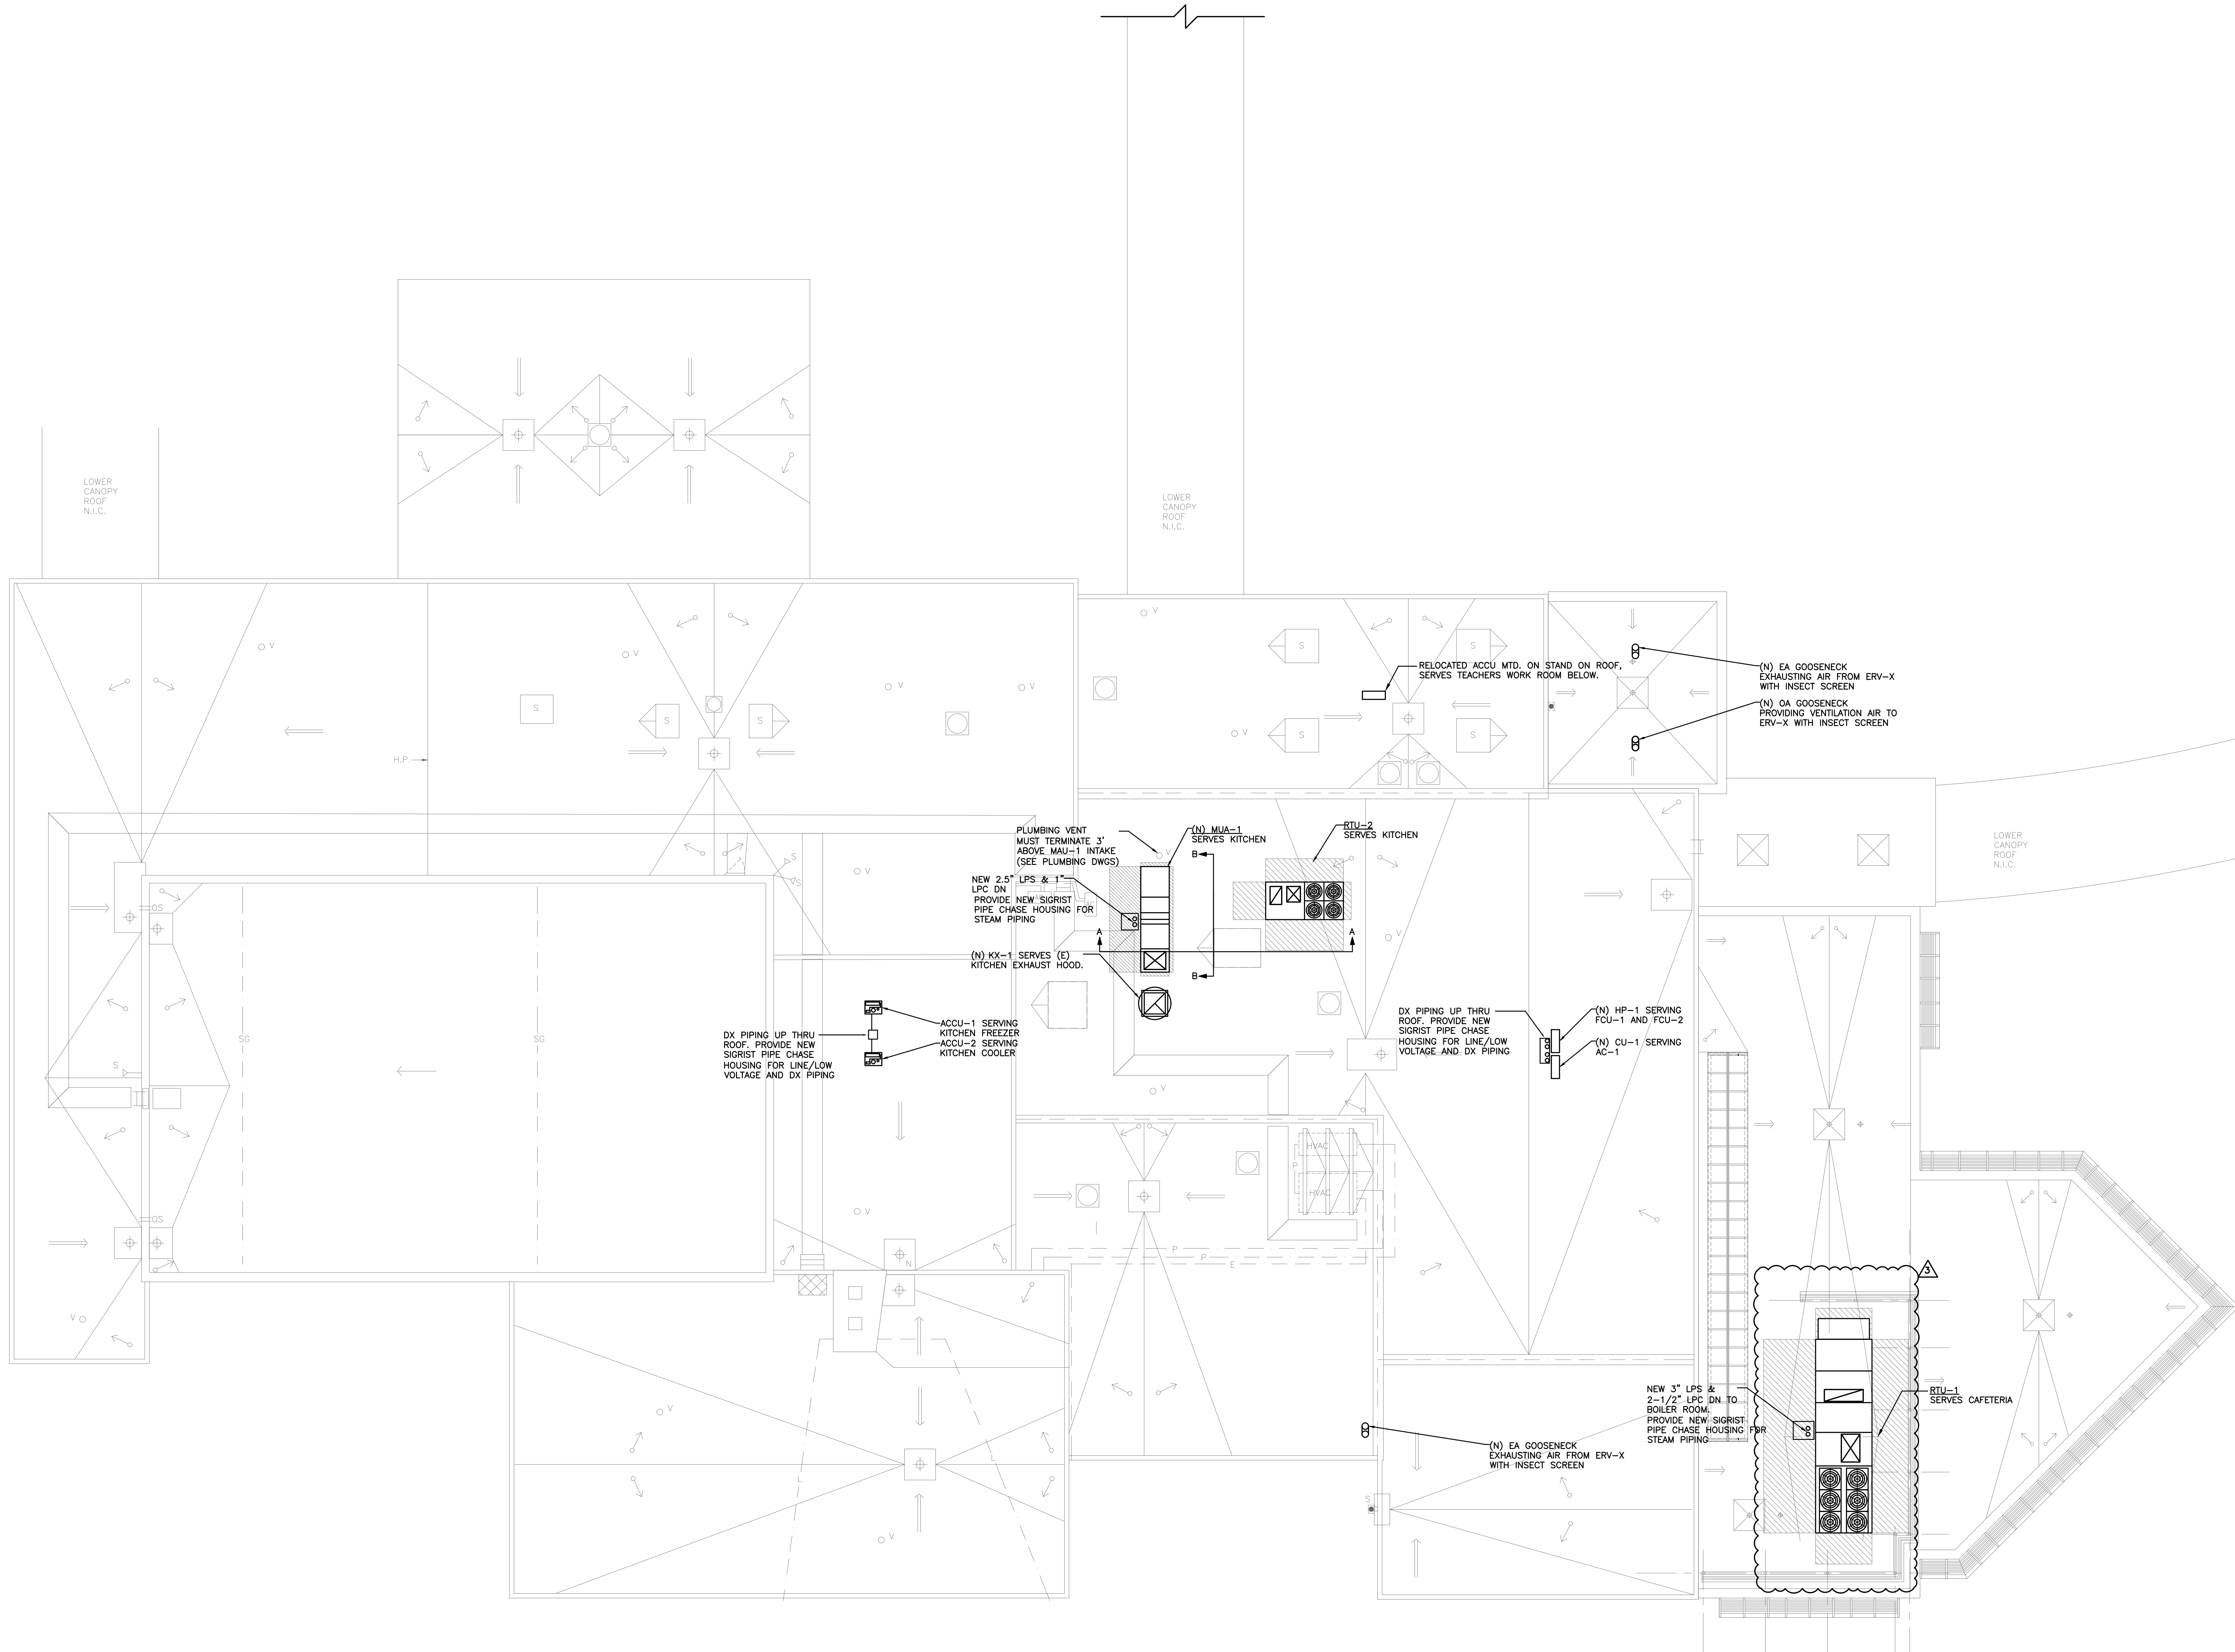

1 ADMINISTRATION BUILDING - ROOF LEVEL MECHANICAL PLAN
SCALE: 1/8" = 1'-0"

AS PER USA CONGRESS ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT OF 1990 ALL IDEAS AND DESIGNS INCLUDING DERIVATIVES THEREOF, ALL DRAWINGS AND SPECIFICATIONS CONSTITUTE THE ORIGINAL COPYRIGHT WORK BY FULLER AND DANKELO, P.C. (F&D). THE DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE BY F&D ARE CREATED BY F&D FOR THIS PROJECT ONLY AND REMAIN THE PROPERTY OF F&D. ANY REPRODUCTION WITHOUT THE PRIOR CONSENT OF F&D IS PROHIBITED.

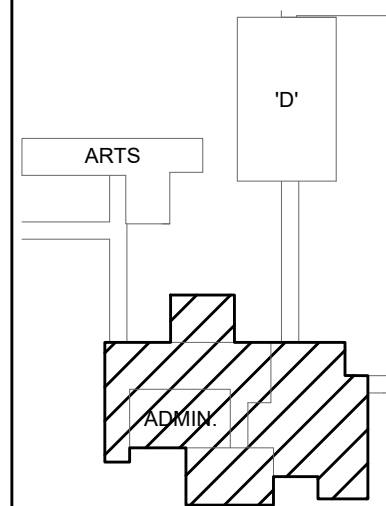

KEY PLAN



252 East Avenue
New York, NY 10002
(212) 666-4625 T/F
(212) 666-4617 F

ALTERATION OF THESE DOCUMENTS WITHOUT THE WRITTEN CONSENT OF FULLER & DANKELO, P.C. IS PROHIBITED.
FULLER & DANKELO, P.C.
ARCHITECTS
PLANNERS

408 CLEVELAND ROAD
ELMISTON, NEW YORK 10829
TEL: 914-898-4444 FAX: 914-898-1313
Copyright 2025. All Rights Reserved by FULLER & DANKELO, P.C.

S.E.D. CONTROL NUMBER
HIGH SCHOOL ADMINISTRATION BUILDING
66-04-00-00-001-015

PROJECT TITLE
EDGEMONT SCHOOL DISTRICT
ADMINISTRATION BUILDING ADDITION, SITE
IMPROVEMENTS & RELATED WORK
300 WHITE OAK LANE, SCARSDALE, NY 10583

DRAWING TITLE
"ADMIN" BUILDING
ROOF LEVEL
MECHANICAL PLAN

03-20-2025 ADDENDUM #3
03-18-2025 ADDENDUM #2
03-12-2025 ADDENDUM #1
02-28-2025 BID SET
06-10-2022 S.E.D. SUBMISSION

SHEET SIZE
30"x42"
SCALE
AS NOTED
DRAWN BY
LFG

DRAWING NO.
AD
M101
FILE NO.
24529.02

NEW ROOF TOP ERV SCHEDULE				
MARK		RTU-1		
MANUFACTURER		YORK		
MODEL		JRMVA360D6D2EABHG1B65AKF0000 0EELCDM300SNU3AABGT0EBDC		
SUPPLY FAN	ESP (in wc)	1		
	TSP (in wc)	3.74		
	FAN BHP	8.65		
	FAN RPM	1927		
EXHAUST FAN	ESP (in wc)	0.25		
	TSP (in wc)	1.28		
	FAN BHP	1.25		
	FAN RPM	1506		
WEIGHT		7329 LBS		
ENERGY RECOVERY WHEEL (ECW 484)		OUTDOOR AIR	RETURN AIR	FRESH AIR
	CFM	5915	3585	9500
	COOLING DB/WB	91/76	75/62	83/69.9
	HEATING DB/WB	0/0	75/62	32.2/32.7
	TOTAL COOLING CAPACITY	142.96 MBH		
	TOTAL HEATING CAPACITY	296.12 MBH		
	SUPPLY AIR FLOW (CFM)	9500		
COOLING COIL	REFRIGERANT	R-454b		
	EAT (DB/WB)	80/67		
	LAT (DB/WB)	54/53.9		
	AIR PD (in wc)	0.36		
	SENSIBLE CAPACITY	265.2 MBH		
	TOTAL CAPACITY	372.1 MBH		
HEATING COIL	EER	14.3		
	HEAT SOURCE	STEAM		
	MODEL	5JA1002C - 46.5 x 40.5		
	GAUGE PRESSURE	5 PSI		
	CONDENSATE	1220 LBM/H		
	LAT (DB/WB)	113.3		
	AIR PD (in wc)	0.5495		
ELECTRICAL	TOTAL CAPACITY	1172 MBH		
	VOLT/PH/Hz	208/3/60		
	UNIT FLA	170.4		
	MCA	201.4		
NOTES	MOCp	225		
	1. UNIT SHALL INCLUDE FACTORY MOTORIZED DAMPERS AT OUTDOOR AND EXHAUST AIR CONNECTIONS. 2. UNIT SHALL BE FURNISHED WITH BACNET CARD. 3. INSTALL AND FURNISH ISOLATION CURB BY MANUFACTURER (NOVA TYPE OR EQUAL.) UNLESS OTHERWISE NOTED.			

ROOFTOP UNIT SCHEDULE			
MARK		RTU-2	MUJ-1
AREA SERVED		KITCHEN	KITCHEN
MODEL		KT120C0052BFFCD6E1	MSX-P116-H22-MF
MANUFACTURER		JOHNSON CONTROLS	GREENHECK
COOLING CAPACITY (MBH)		129.5	N/A
SENSIBLE CAPACITY (MBH)		92.6	N/A
REFRIGERANT		R-454B	N/A
HEAT SOURCE		STEAM	STEAM
HEAT CAPACITY (MBH)		179.1	283
SUPPLY AIRFLOW (CFM)		4000	4320
A I R	ESP (in. wc.)	1	1
	FAN RPM	1227	1718
	FAN BHP	3	1.71
	EAT (DB / WB)	79.0 / 65.9	5.0 / -
E L E C	LAT (DB / WB)	57.6 / 55.4	65.5 / -
	VOLTAGE	230	208
	PHASE	3	3
	MOTOR FLA	32.7	3
EER	MCA	68.7	13.7
	MOCp	80	20
	EER	13.2	13.5
	UNIT WEIGHT (lbs)	1555	1551
NOTES:		1, 2, 3, 4	
NOTES:			
1. UNITS SHALL BE SET ON SPRING ISOLATORS WITH 1" STATIC DEFLECTION			
2. UNITS SHALL BE FURNISHED WITH FACTORY BACNET CARD. 2.			
3. FURNISH AND INSTALL ON ISOLATION CURB BY CAMBRIDGE PORT. CURB SHALL BE INSULATED TO R-12 MINIMUM. MINIMUM CURB HEIGHT SHALL BE 24 INCHES.			
4. SEE VENTILATION TABLE ON M400 FOR OUTSIDE AIRFLOW RATES.			

ERV SCHEDULE		
MARK	ERV-1	ERV-2
MODEL	VAM300GVJU	VAM470GVJU
MANUFACTURER	DAIKIN	DAIKIN
AIRFLOW	300	405
VOLTAGE	208	208
PHASE	1	1
MCA	1.6	1.6
MOCp	15	15
WEIGHT	71	121
NOTES	1, 2, 3	1, 2, 3

BRANCH DUCT SCHEDULE		
AIR FLOW (cfm)	ROUND DUCT SIZE (in.)	SQUARE DUCT SIZE (in.)
0-105	6	6x6
106-160	7	8x6
161-230	8	10x6
231-320	9	12x6
321-420	10	12x8
NOTES:		
1. WHETHER OR NOT INDICATED ON PLANS, CONTRACTOR SHALL FURNISH AND INSTALL MANUAL VOLUME DAMPERS IN ALL SUPPLY AND RETURN BRANCH DUCTS.		

AIR OUTLET SCHEDULE					
TAG	MFG	MODEL	AIRFLOW (CFM)	SIZE	NOTES
CD-1	TITUS	TDC	SEE DWGS	12"x12"	1
CD-2		350RL		24"x24"	
RG-1		50FF		6"x6"	
RG-2				24"x24"	
EG-1					
EG-2					
NOTES:					
1. ALL AIR OUTLETS SHALL BE WHITE UNLESS OTHERWISE NOTED ON PLANS					

HP SCHEDULE	
MARK	HP-1
MODEL	RXTA60AAVJU
MANU.	DAIKIN
	COOLING CAPACITY (MBH)
	57
	HEATING CAPACITY (MBH)
COOLING OA TEMP (DB/WB)	80 / 67
	HEATING OA TEMP (DB/WB)
	70 / 60
	VOLTAGE
PHASE	208
	1
	MCA
	34.6
MOP	35
	SEER/EER
	16 / 8.5
	WEIGHT
NOTES:	220
	1. FURNISH AND INSTALL FACTORY 18" STAND.

FAN COIL UNIT SCHEDULE											
MARK	TYPE	MODEL	MANU.	AIRFLOW (CFM)	NOMINAL TONNAGE	COOLING CAPACITY (MBH)	HEATING CAPACITY (MBH)	VOLTAGE	PHASE	MCA	MOCp
FCU-1	DUCTED	FXMA2AAAVJU	DAIKIN	500	2.0	24	27	208	1	1.9	15
FCU-2	DUCTED	FXMA30AAVJU	DAIKIN	1000	2.5	30	34	208	1	3	15
NOTES:											
1. UNIT SHALL INCLUDE FACTORY FILTER BOXES.											
2. REFER TO FAN COIL HANGING DETAIL FOR ADDITIONAL INFORMATION.											
3. UNITS SHALL BE FURNISHED WITH FACTORY BACNET CARD.											
4. PROVIDE FACTORY CONDENSATE PUMP FOR EACH FAN COIL CONNECTED TO UNIT POWER.											
5. DX PIPE SIZES SHALL FOLLOW MANUFACTURER RECOMMENDATIONS.											

SPLIT SYSTEM SCHEDULE											
MARK	TYPE	MODEL	MANU.	AIRFLOW (CFM)	NOMINAL TONNAGE	COOLING CAPACITY (MBH)	VOLTAGE	PHASE	MCA	MOCp	NOTES
AC-1	WALL MOUNTED	FTKF09AXCJU	DAIKIN	460	2.0	9	POWERED BY CU-1				1,2,3,4
CU-1	OUTDOOR ACCU	RFK09AXVJU	DAIKIN	-	2.5	9	208	1	9.1	15	1,2,3,4
NOTES:											
1. UNIT SHALL INCLUDE FACTORY FILTERS.											
2. UNITS SHALL BE FURNISHED WITH FACTORY BACNET CARD.											
3. PROVIDE FACTORY CONDENSATE PUMP FOR EACH FAN COIL CONNECTED TO UNIT POWER.											
4. DX PIPE SIZES SHALL FOLLOW MANUFACTURER RECOMMENDATIONS.											

VENTILATION AIR REQUIREMENTS									
Project: Edgemont Jr/Sr High - Administration Building			State: New York		Relevant Code: IMC2018				
HVAC ZONE	AREA SERVED	OCCUPANCY CLASSIFICATION	OCCUPANT DENSITY (#/1000 SQFT)	OCCUPANT LOAD Pz (Aq)	REQUIRED VENTILATION Rp / Ra	ZONE AIR DIST. EFFECTIVENESS (Ez)	O.A./E.A. REQUIRED (CFM) Vz	O.A./E.A. DESIGN (CFM)	REMARKS
RTU-1	CAFETERIA	Cafeteria	100	456 (7183.6 SF)	7.5 CFM/PERSON 0.18 CFM/SF	0.8	5891	5895	
	VESTIBULE	Corridors	0	- (256.3 SF)	- CFM/PERSON 0.06 CFM/SF	0.8	19	20	
	Total						5911	5915	
RTU-2	KITCHEN	Kitchens (cooking)	20	18 (877.8 SF)	7.5 CFM/PERSON 0.12 CFM/SF	0.8	300	305	
	SERVING	Cafeteria	100	56 (1154.9 SF)	7.5 CFM/PERSON 0.18 CFM/SF	0.8	785	785	
	Total						1085	1090	
ERV-1	BOY'S TOILET	Toilet rooms - public (continuous fan)	0	10 (201 SF)	150 CFM EXHAUST AIR	0.8	150	150	
	GIRL'S TOILET	Toilet rooms - public (continuous fan)	0	10 (200.4 SF)	150 CFM EXHAUST AIR	0.8	150	150	
	Total						300	300	
ERV-2	310 GEN PURPOSE CLASSROOM	Classrooms (ages 9 plus)	35	24 (672.8 SF)	10 CFM/PERSON 0.12 CFM/SF	0.8	401	405	
	Total						401	405	
AC-1	317 DIET/CAF OFFICE	Office spaces	5	1 (47 SF)	5 CFM/PERSON 0.06 CFM/SF	0.8	10	10	1
	Total						10	10	
REMARKS:									
1. CONTRACTOR SHALL FIELD VERIFY THAT EXISTING DUCTWORK SATIFIES OA REQUIREMENTS FOR THE SPACE. REBALANCE AS NEEDED.									

AS PER USA CONGRESS ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT OF 1990 ALL IDEAS AND DESIGNS INCLUDING DERIVATIVES THEREOF, ALL DRAWINGS AND SPECIFICATIONS CONSTITUTE THE ORIGINAL COPYRIGHT WORK BY FULLER AND DANKELO, P.C. (F&D). THE DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE BY F&D ARE CREATED BY F&D FOR THIS PROJECT ONLY AND REMAIN THE PRODUCT AND PROPERTY OF F&D. ANY REPRODUCTION WITHOUT THE PRIOR CONSENT OF F&D IS PROHIBITED.



ALTERATION OF THESE DOCUMENTS WITHOUT THE WRITTEN PERMISSION OF NEW YORK STATE EDUCATION LAW.

408 SHELLENBURGH ROAD
ELMHURST NEW YORK 11003
TEL: 914-898-4444 FAX: 914-898-1171
Copyright 2025 All Rights Reserved by FULLER & DANKELO P.C.

FULLER
D'ANGELO
P.C.
ARCHITECTS
PLANNERS

S.E.D. CONTROL NUMBER
HIGH SCHOOL ADMINISTRATION BUILDING
66-04-06-03-011-0115

PROJECT: EDGEMONT SCHOOL DISTRICT
ADMINISTRATION BUILDING ADDITION, SITE
IMPROVEMENTS & RELATED WORK
300 WHITE OAK LANE, SCARSDALE, NY 10583


DRAWING TITLE
MECHANICAL SCHEDULES

03-20-2025	ADDENDUM #3
03-18-2025	ADDENDUM #2
03-12-2025	ADDENDUM #1
02-28-2025	BID SET
06-10-2022	S.E.D. SUBMISSION
DATE	ISSUED TO

SHEET SIZE 30"x42"	DRAWING NO. AD M400
SCALE AS NOTED	
DRAWN BY LFG	FILE NO. 24529.02

PLOT DATE: March 20, 2025 - 10:18am

FILE: N:\Edgemont School District\Edgemont Jr-Sr High\2025 Cafeteria\ACAD\Electrical\EDGE JR-SR ADMIN_E100_E400.dwg

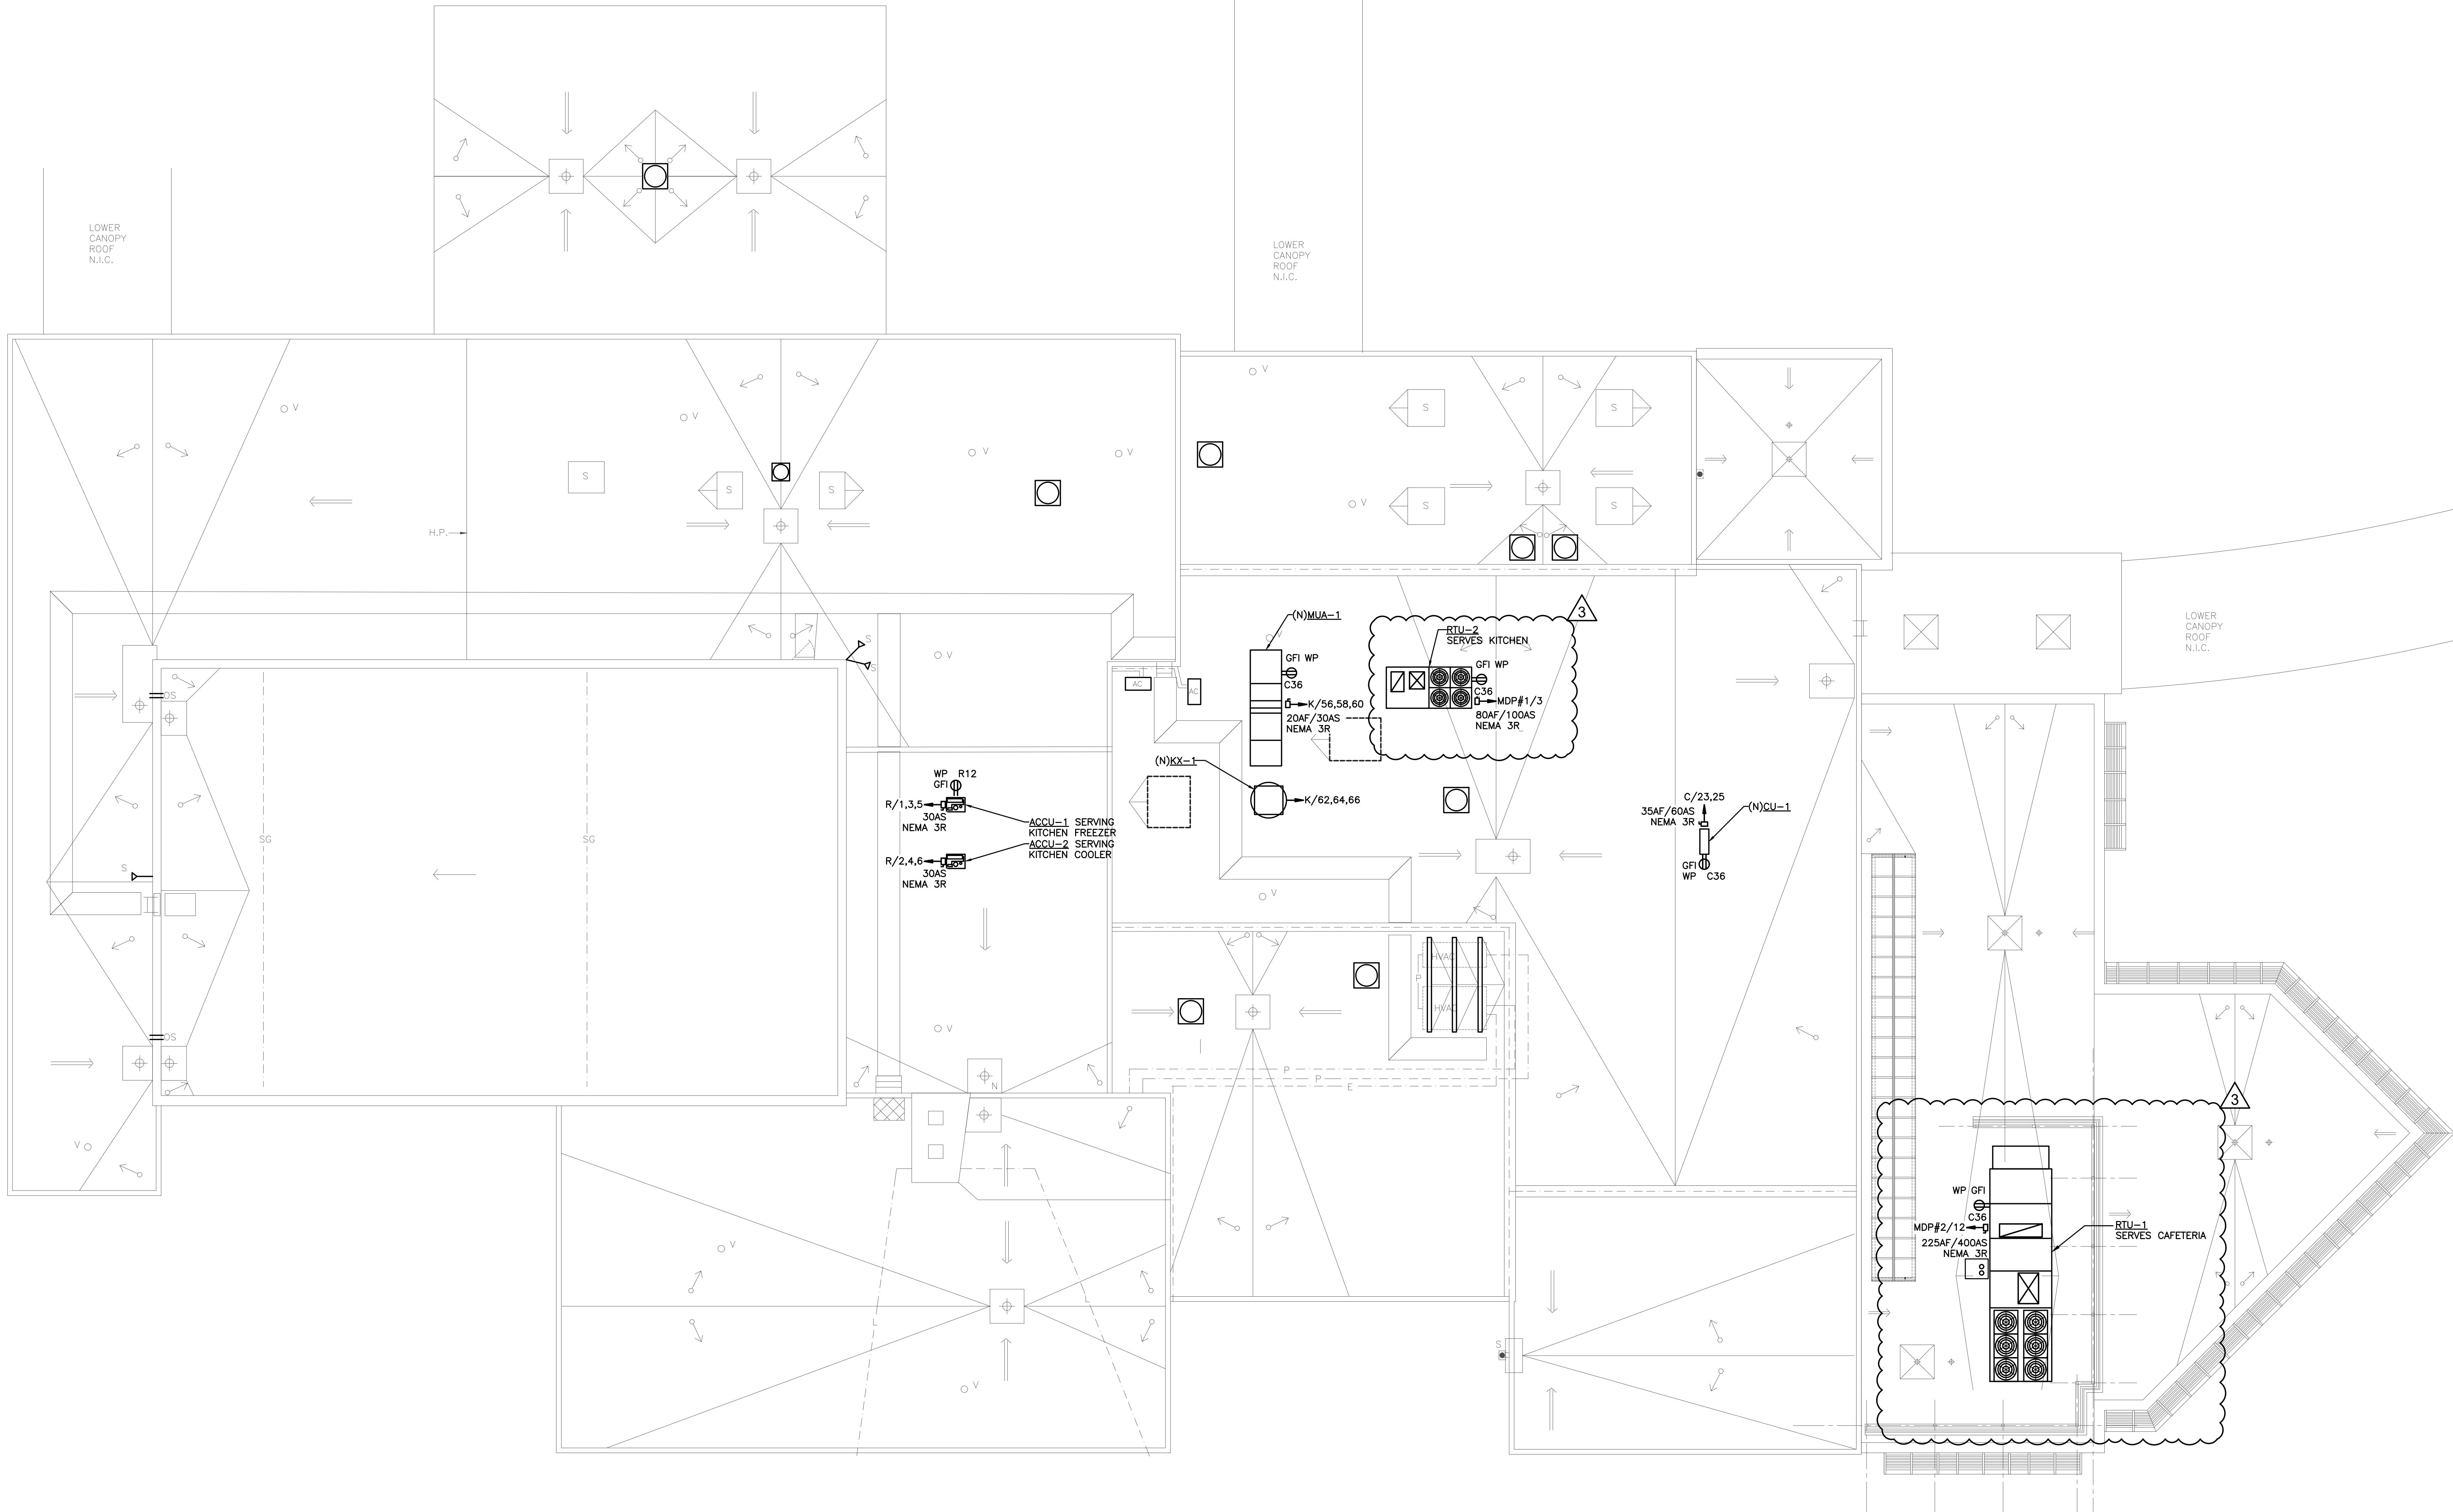

1 ADMINISTRATION BUILDING - ROOF PLAN
SCALE: 1/8" = 1'-0"

AS PER USA CONGRESS ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT OF 1990 ALL IDEAS AND DESIGNS INCLUDING DERIVATIVES THEREOF, ALL DRAWINGS AND SPECIFICATIONS CONSTITUTE THE ORIGINAL COPYRIGHT WORK BY FULLER AND DANKELO, P.C. (F&D). THE DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE BY F&D ARE CREATED BY F&D FOR THIS PROJECT ONLY AND REMAIN THE PROPERTY OF F&D. ANY REPRODUCTION WITHOUT THE PRIOR CONSENT OF F&D IS PROHIBITED.




ALTERATION OF THESE DOCUMENTS WITHOUT THE WRITTEN CONSENT OF FULLER & DANKELO, P.C. IS PROHIBITED.
408 SHELLEWOOD ROAD, ELLENFIELD, NJ 07033
TEL: 973-888-4444 FAX: 973-888-1979
Copyright 2025. All Rights Reserved by FULLER & DANKELO, P.C.

FULLER & DANKELO, P.C.
ARCHITECTS & PLANNERS

S.E.D. CONTROL NUMBER
HIGH SCHOOL ADMINISTRATION BUILDING
66-04-00-001-015

PROJECT NAME
EDGEMONT SCHOOL DISTRICT
ADMINISTRATION BUILDING ADDITION, SITE
IMPROVEMENTS & RELATED WORK
300 WHITE OAK LANE, SCARSDALE, NY 10583
DRAWING TITLE
ROOF ELECTRICAL PLAN

03-20-2025	ADDENDUM #3
03-18-2025	ADDENDUM #2
03-12-2025	ADDENDUM #1
02-28-2025	BID SET
06-10-2022	S.E.D. SUBMISSION
DATE	ISSUED TO
SHEET SIZE 30"x42"	DRAWING NO. AD E101
SCALE AS NOTED	FILE NO. 24529.02
DRAWN BY LFG	

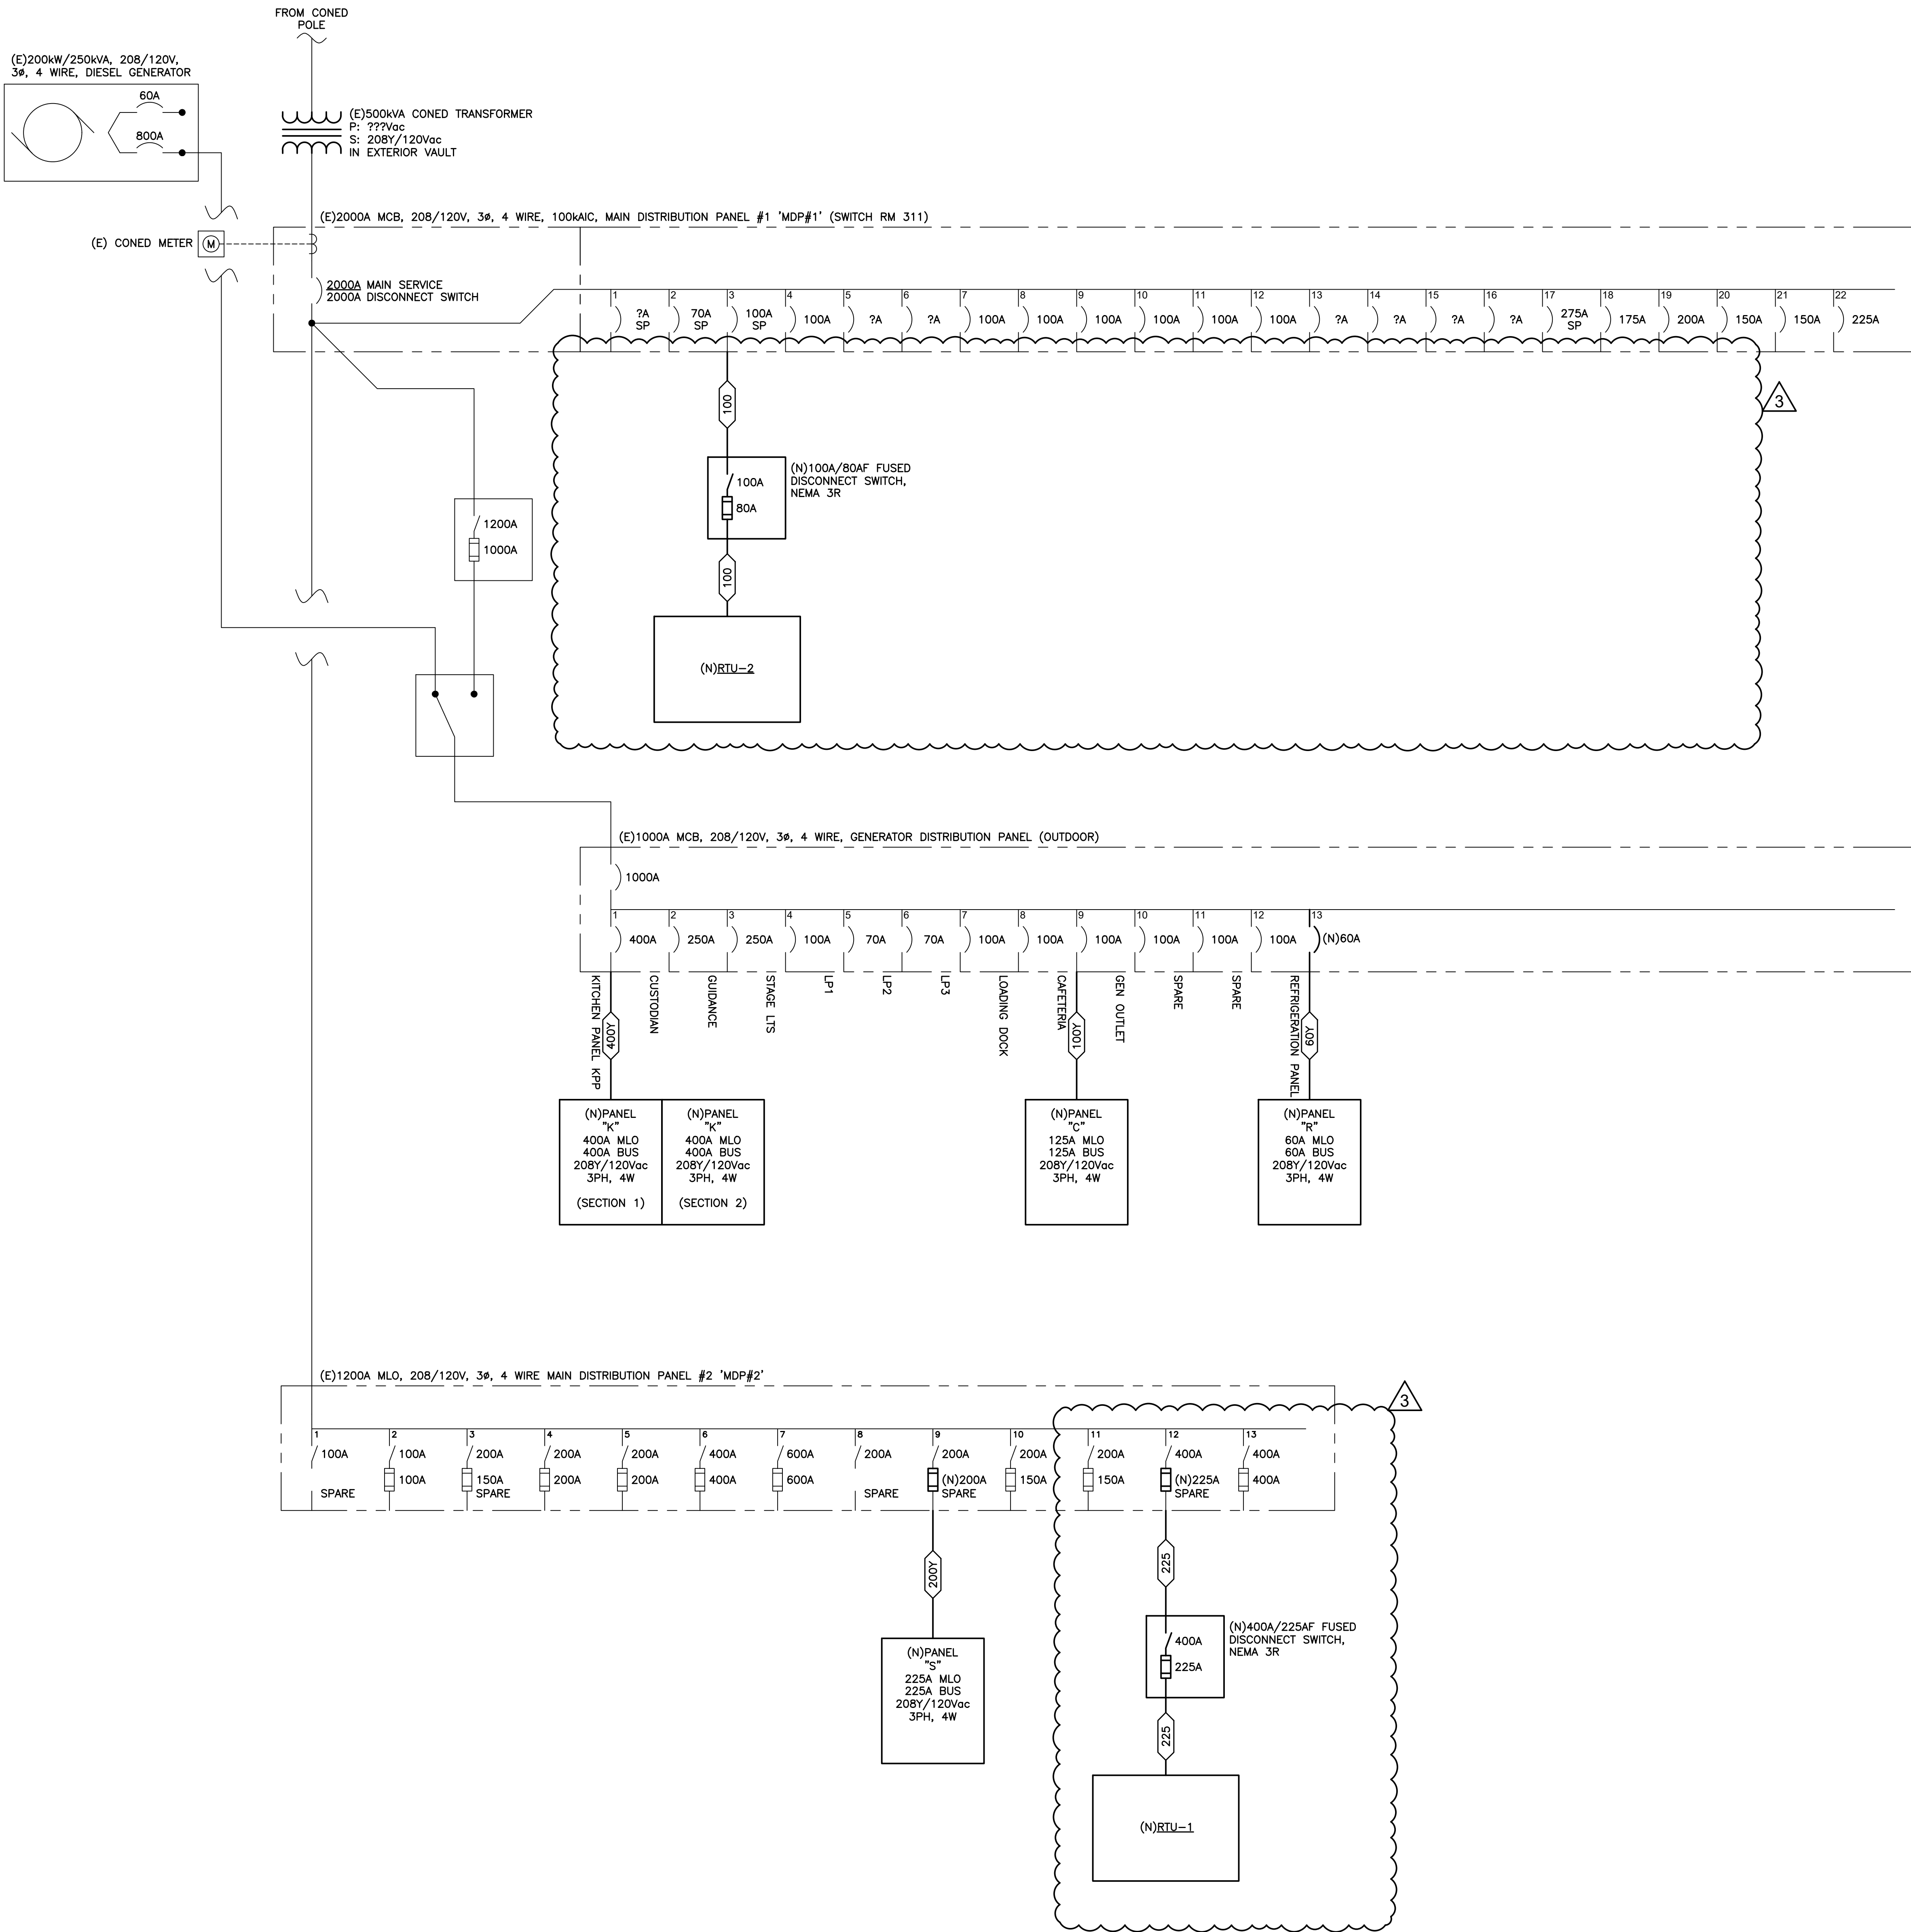

LEGEND OF FEEDER SIZES			
75°C COPPER CONDUCTORS			
NOMINAL AMPERE RATING	FEEDER TAG & MODIFICATIONS	CONDUCTORS	MINIMUM RACEWAY SIZE
15	15*	3-#12 AWG; 1-#12 AWG GND	1/2"
	Y	3-#12 AWG; 1-#12 AWG N; 1-#12 AWG GND	1/2"
	K	CHANGE NEUTRAL TO 2-#12 AWG	1/2"
20	20*	3-#12 AWG; 1-#12 AWG GND	1/2"
	Y	3-#12 AWG; 1-#12 AWG N; 1-#12 AWG GND	1/2"
	K	CHANGE NEUTRAL TO 2-#12 AWG	1/2"
25	25*	3-#10 AWG; 1-#10 AWG GND	1/2"
	Y	3-#10 AWG; 1-#10 AWG N; 1-#10 AWG GND	1/2"
	K	CHANGE NEUTRAL TO 2-#10 AWG	1/2"
30	30*	3-#10 AWG; 1-#10 AWG GND	3/4"
	Y	3-#10 AWG; 1-#10 AWG N; 1-#10 AWG GND	3/4"
	K	CHANGE NEUTRAL TO 2-#10 AWG	3/4"
35	35*	3-#8 AWG; 1-#8 AWG GND	3/4"
	Y	3-#8 AWG; 1-#8 AWG N; 1-#10 AWG GND	3/4"
	K	CHANGE NEUTRAL TO 2-#8 AWG	1"
40	40*	3-#8 AWG; 1-#8 AWG GND	1"
	Y	3-#8 AWG; 1-#8 AWG N; 1-#10 AWG GND	1"
	K	CHANGE NEUTRAL TO 2-#8 AWG	1"
45	45*	3-#6 AWG; 1-#6 AWG GND	1"
	Y	3-#6 AWG; 1-#6 AWG N; 1-#10 AWG GND	1"
	K	CHANGE NEUTRAL TO 2-#6 AWG	1"
50	50*	3-#6 AWG; 1-#6 AWG GND	1"
	Y	3-#6 AWG; 1-#6 AWG N; 1-#10 AWG GND	1"
	K	CHANGE NEUTRAL TO 2-#6 AWG	1"
60	60*	3-#4 AWG; 1-#4 AWG GND	1"
	Y	3-#4 AWG; 1-#4 AWG N; 1-#10 AWG GND	1"
	K	CHANGE NEUTRAL TO 2-#4 AWG	1"
70	70*	3-#4 AWG; 1-#4 AWG GND	1-1/4"
	Y	3-#4 AWG; 1-#4 AWG N; 1-#8 AWG GND	1-1/4"
	K	CHANGE NEUTRAL TO 2-#4 AWG	1-1/4"
100	100*	3-#3 AWG; 1-#3 AWG GND	1-1/4"
	Y	3-#3 AWG; 1-#3 AWG N; 1-#8 AWG GND	1-1/4"
	K	CHANGE NEUTRAL TO 2-#3 AWG	1-1/4"
125	125*	3-#1 AWG; 1-#1 AWG GND	1-1/2"
	Y	3-#1 AWG; 1-#1 AWG N; 1-#6 AWG GND	1-1/2"
	K	CHANGE NEUTRAL TO 2-#1 AWG	2"
150	150*	3-#1/0 AWG; 1-#1/0 AWG GND	2"
	Y	3-#1/0 AWG; 1-#1/0 AWG N; 1-#6 AWG GND	2"
	K	CHANGE NEUTRAL TO 2-#1/0 AWG	2"
175	175*	3-#2/0 AWG; 1-#2/0 AWG GND	2"
	Y	3-#2/0 AWG; 1-#2/0 AWG N; 1-#6 AWG GND	2"
	K	CHANGE NEUTRAL TO 2-#2/0 AWG	2"
200	200*	3-#3/0 AWG; 1-#3/0 AWG GND	2-1/2"
	Y	3-#3/0 AWG; 1-#3/0 AWG N; 1-#6 AWG GND	2-1/2"
	K	CHANGE NEUTRAL TO 2-#3/0 AWG	2-1/2"
225	225*	3-#4 AWG; 1-#4 AWG GND	2"
	Y	3-#4 AWG; 1-#4 AWG N; 1-#4 AWG GND	2-1/2"
	K	CHANGE NEUTRAL TO 2-#4 AWG	2-1/2"
250	250*	3-250MCM; 1-#4 AWG GND	2-1/2"
	Y	3-250MCM; 1-250MCM N; 1-#4 AWG GND	2-1/2"
	K	CHANGE NEUTRAL TO 2-250MCM	2-1/2"
300	300*	3-350MCM; 1-#4 AWG GND	3"
	Y	3-350MCM; 1-350MCM N; 1-#4 AWG GND	3"
	K	CHANGE NEUTRAL TO 2-350MCM	3"
350	350*	3-500MCM; 1-#3 AWG GND	3-1/2"
	Y	3-500MCM; 1-500MCM N; 1-#3 AWG GND	3-1/2"
	K	CHANGE NEUTRAL TO 2-500MCM	3"
400	400*	3-500MCM; 1-#3 AWG GND	3-1/2"
	Y	3-500MCM; 1-500MCM N; 1-#3 AWG GND	3-1/2"
	K	CHANGE NEUTRAL TO 2-500MCM	3-1/2"
450	450*	(2 SETS OF) 3-#4/0 AWG; 1-#2 AWG GND	(2) 2"
	Y	(2 SETS OF) 3-#4/0 AWG; 1-#4/0 AWG N; 1-#2 AWG GND	(2) 2-1/2"
	K	CHANGE NEUTRAL TO 2-#2 AWG GND	(2) 2-1/2"
500	500*	(2 SETS OF) 3-250MCM; 1-250MCM N; 1-#2 AWG GND	(2) 2-1/2"
	Y	(2 SETS OF) 3-250MCM; 1-250MCM N; 1-#2 AWG GND	(2) 2-1/2"
	K	CHANGE NEUTRAL TO 2-#2 AWG GND	(2) 2-1/2"
600	600*	(2 SETS OF) 3-350MCM; 1-350MCM N; 1-#1 AWG GND	(2) 2-1/2"
	Y	(2 SETS OF) 3-350MCM; 1-350MCM N; 1-#1 AWG GND	(2) 2-1/2"
	K	CHANGE NEUTRAL TO 2-#1 AWG GND	(2) 2-1/2"
700	700*	(2 SETS OF) 3-500MCM; 1-500MCM N; 1-#1/0 AWG GND	(2) 3"
	Y	(2 SETS OF) 3-500MCM; 1-500MCM N; 1-#1/0 AWG GND	(2) 3"
	K	CHANGE NEUTRAL TO 2-#1/0 AWG GND	(2) 3"
800	800*	(2 SETS OF) 3-600MCM; 1-600MCM N; 1-#1/0 AWG GND	(2) 3"
	Y	(2 SETS OF) 3-600MCM; 1-600MCM N; 1-#1/0 AWG GND	(2) 3"
	K	CHANGE NEUTRAL TO 2-#1/0 AWG GND	(2) 3"
1000	1000*	(3 SETS OF) 3-400MCM; 1-#2/0 AWG GND	(3) 3"
	Y	(3 SETS OF) 3-400MCM; 1-400MCM N; 1-#2/0 AWG GND	(3) 3"
	K	CHANGE NEUTRAL TO 2-#2/0 AWG GND	(3) 3"
1200	1200*	(4 SETS OF) 3-350MCM; 1-350MCM N; 1-#3/0 AWG GND	(4) 3"
	Y	(4 SETS OF) 3-350MCM; 1-350MCM N; 1-#3/0 AWG GND	(4) 3"
	K	CHANGE NEUTRAL TO 2-#3/0 AWG GND	(4) 3"
1600	1600*	(5 SETS OF) 3-400MCM; 1-400MCM N; 1-#4/0 AWG GND	(5) 3"
	Y	(5 SETS OF) 3-400MCM; 1-400MCM N; 1-#4/0 AWG GND	(5) 3"
	K	CHANGE NEUTRAL TO 2-#4/0 AWG GND	(5) 3"
2000	2000*	(6 SETS OF) 3-400MCM; 1-250MCM GND	(6) 3"
	Y	(6 SETS OF) 3-400MCM; 1-400MCM N; 1-250MCM GND	(6) 3"
	K	CHANGE NEUTRAL TO 2-250MCM GND	(6) 3"
2500	2500*	(7 SETS OF) 3-500MCM; 1-350MCM GND	(7) 3"
	Y	(7 SETS OF) 3-500MCM; 1-500MCM N; 1-350MCM GND	(7) 3"
	K	CHANGE NEUTRAL TO 2-350MCM GND	(7) 3"
3000	3000*	(8 SETS OF) 3-500MCM; 1-500MCM N; 1-400MCM GND	(8) 3"
	Y	(8 SETS OF) 3-500MCM; 1-500MCM N; 1-400MCM GND	(8) 3"
	K	CHANGE NEUTRAL TO 2-400MCM GND	(8) 3"
3500	3500*	(10 SETS OF) 3-500MCM; 1-500MCM GND	(10) 3"
	Y	(10 SETS OF) 3-500MCM; 1-500MCM N; 1-500MCM GND	(10) 3"
	K	CHANGE NEUTRAL TO 2-500MCM GND	(10) 3"
4000	4000*	(11 SETS OF) 3-500MCM; 1-500MCM N; 1-500MCM GND	(11) 3"
	Y	(11 SETS OF) 3-500MCM; 1-500MCM N; 1-500MCM GND	(11) 3"
	K	CHANGE NEUTRAL TO 2-500MCM GND	(11) 3"

DESIGNATIONS

THE ASTERISK ABOVE IS FILLED IN WITH ONE OR MORE OF THE FOLLOWING DESIGNATIONS ON THE ONE LINE DIAGRAM.

Y - THREE PHASE FOUR WIRE FEEDER
K - THREE PHASE FEEDER WITH OVERSIZED NEUTRAL
G - THREE PHASE FEEDER WITH ISOLATED GROUND

NOTES:

1. ALL AMPACITIES ARE BASED ON 75°C TEMPERATURE RATING OF A COPPER CONDUCTOR AS LISTED IN THE NATIONAL ELECTRIC CODE.

AS PER USA CONGRESS ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT OF 1990 ALL IDEAS AND DESIGNS INCLUDING DERIVATIVES THEREOF, ALL DRAWINGS AND SPECIFICATIONS CONSTITUTE THE ORIGINAL COPYRIGHT WORK BY FULLER AND DANKELO, P.C. (F&D). THE DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE BY F&D ARE CREATED BY F&D FOR THIS PROJECT ONLY AND REMAIN THE PRODUCT AND PROPERTY OF F&D. ANY REPRODUCTION WITHOUT THE PRIOR CONSENT OF F&D IS PROHIBITED.



ALTERATION OF THESE DOCUMENTS WITHOUT THE WRITTEN CONSENT OF FULLER & DANKELO, P.C. IS A VIOLATION OF NEW YORK STATE EDUCATION LAW.

408 KILLBUCK ROAD, ELIZABETH, NJ 07208
TEL: 908-486-4444 FAX: 908-486-1919
WWW.FULLERDANKELO.COM
Copyright 2025. All Rights Reserved by FULLER & DANKELO, P.C.

FULLER
DANKELO
P.C.
ARCHITECTS
PLANNERS

S.E.D. CONTROL NUMBER
HIGH SCHOOL ADMINISTRATION BUILDING
06-04-00-001-015

PROJECT TITLE
EDGEMONT SCHOOL DISTRICT
ADMINISTRATION BUILDING ADDITION, SITE
IMPROVEMENTS & RELATED WORK
300 WHITE OAK LANE, SCARSDALE, NY 10583

DRAWING TITLE
ELECTRICAL ONE LINE DIAGRAM

03-20-2025	ADDENDUM #3
03-18-2025	ADDENDUM #2
03-12-2025	ADDENDUM #1
02-28-2025	BID SET
06-10-2022	S.E.D. SUBMISSION
DATE	ISSUED TO
SHEET SIZE 30"x42"	DRAWING NO. AD E200
SCALE AS NOTED	FILE NO. 24529.02
DRAWN BY LFG	

CONTRACTOR'S REQUEST FOR INTERPRETATION NO. 02 F&D RFI NO: 002 (F&D USE)

NAME OF PROJECT: Administration Building Cafeteria Addition

NAME OF OWNER: Edgemont School District

FACILITY: Edgemont Jr./Sr. High School

DATE: 03/13/25

A/E PROJECT NO: 24529.02

ARCHITECT: Fuller and D'Angelo, P.C.

45 Knollwood Road, Elmsford, NY 10523

Tel: 914-592-4444; Fax: 914-592-1717

William Means, RA WilliamM@fullerdangelo.com

Refer to Section 00 2113 Par 1.13 for additional requirements.

FROM (CO. NAME): Piazza Inc

CONTACT NAME: Joe Piazza Tel: 914-741-4435 X16

Tel: _____ E-mail: Joe@Piazzabrothers.com

SUBJECT: Food Service Equipment

DISCIPLINE/TRADE: _____

DWG./SPEC. REFERENCE: _____

QUESTION: Where will the condensers be located, and how far away from the walk in
boxes will they be?

___ FIELD CONDITION _____

___ DRAWING/SPEC _____

___ DISCREPANCY _____


___ OWNER CHANGE _____

___ CLARIFICATION _____

___ CONTRACTOR'S SUGGESTION (IF APPLICABLE): _____

ANSWER

Condensers are on the roof.

ARCHITECT'S SIGNATURE:  _____

DATE: 3/13/2025

Note: review and any responses to this request for information by the architect/engineer is strictly for design intent only and does not constitute acknowledgement or acceptance of any cost or schedule implications unless specifically presented by the contractor. By submission of this request for information, the contractor assumes all responsibility in the absence of an approved change order or work directive.

END OF SECTION

FULLER AND D'ANGELO, P.C.
ARCHITECTS AND PLANNERS

CONTRACTOR'S REQUEST FOR INTERPRETATION NO. 1 F&D RFI NO: 003 (F&D USE)

NAME OF PROJECT: Administration Building Cafeteria Addition

NAME OF OWNER: Edgemont School District

FACILITY: Edgemont Jr./Sr. High School

DATE: _____

A/E PROJECT NO: 24529.02

ARCHITECT: Fuller and D'Angelo, P.C.

45 Knollwood Road, Elmsford, NY 10523

Tel: 914-592-4444; Fax: 914-592-1717

William Means, RA WilliamM@fullerdangelo.com

Refer to Section 00 2113 Par 1.13 for additional requirements.

FROM (CO. NAME): allstate electrical group

CONTACT NAME: chris hand Tel: 9148791160

Tel: _____ E-mail: ch@aegny.com

SUBJECT: fire alarm vendor

DISCIPLINE/TRADE: electric

DWG./SPEC. REFERENCE: _____

QUESTION: please provide the schools fire alarm vendor information ,Thanks

FIELD CONDITION _____

DRAWING/SPEC _____

DISCREPANCY _____

OWNER CHANGE _____

CLARIFICATION _____

CONTRACTOR'S SUGGESTION (IF APPLICABLE): _____

ANSWER

Open Systems Metro, Sean Werlau, (914)640-9314.

ARCHITECT'S SIGNATURE:  RA

DATE: 3/17/2025

Note: review and any responses to this request for information by the architect/engineer is strictly for design intent only and does not constitute acknowledgement or acceptance of any cost or schedule implications unless specifically presented by the contractor. By submission of this request for information, the contractor assumes all responsibility in the absence of an approved change order or work directive.

END OF SECTION

FULLER AND D'ANGELO, P.C.
ARCHITECTS AND PLANNERS

CONTRACTOR'S REQUEST FOR INTERPRETATION NO. 01 F&D RFI NO: 04 (F&D USE)

NAME OF PROJECT: Administration Building Cafeteria Addition

NAME OF OWNER: Edgemont School District

FACILITY: Edgemont Jr./Sr. High School

DATE: 3/17/25

A/E PROJECT NO: 24529.02

ARCHITECT: Fuller and D'Angelo, P.C.

45 Knollwood Road, Elmsford, NY 10523

Tel: 914-592-4444; Fax: 914-592-1717

William Means, RA WilliamM@fullerdangelo.com

Refer to Section 00 2113 Par 1.13 for additional requirements.

FROM (CO. NAME): Pierotti Corp.

CONTACT NAME: Tony Monaco Tel: 914-233-9990

Tel: E-mail: tonym@pierotticorp.com

SUBJECT: Resinous Flooring

DISCIPLINE/TRADE:

DWG./SPEC. REFERENCE: 096723

QUESTION: Is Dur A Flex Dur a Quartz with a Sherwin Williams
3741 Novolac topcoat in lieu of the specified Palma system
acceptable?

<https://www.dur-a-flex.com/products/dur-a-quartz/>

FIELD CONDITION

DRAWING/SPEC

DISCREPANCY


OWNER CHANGE

CLARIFICATION

CONTRACTOR'S SUGGESTION (IF APPLICABLE):

ANSWER

We do not review substitution requests during bidding but what you are proposing would not be an equal to the specified product.

ARCHITECT'S SIGNATURE: 

DATE: 3/17/2025

Note: review and any responses to this request for information by the architect/engineer is strictly for design intent only and does not constitute acknowledgement or acceptance of any cost or schedule implications unless specifically presented by the contractor. By submission of this request for information, the contractor assumes all responsibility in the absence of an approved change order or work directive.

END OF SECTION

FULLER AND D'ANGELO, P.C.
ARCHITECTS AND PLANNERS

CONTRACTOR'S REQUEST FOR INTERPRETATION NO. 03 F&D RFI NO: 005 (F&D USE)

NAME OF PROJECT: Administration Building Cafeteria Addition

NAME OF OWNER: Edgemont School District

FACILITY: Edgemont Jr./Sr. High School

DATE: 03/18/2025

A/E PROJECT NO: 24529.02

ARCHITECT: Fuller and D'Angelo, P.C.

45 Knollwood Road, Elmsford, NY 10523

Tel: 914-592-4444; Fax: 914-592-1717

William Means, RA WilliamM@fullerdangelo.com

Refer to Section 00 2113 Par 1.13 for additional requirements.

FROM (CO. NAME): Piazza Inc

CONTACT NAME: Joe Piazza Tel: 914-741-4435

Tel: 914-439-6453 E-mail: Joe@piazabrothers.com

SUBJECT: Discrepancies between the RCP and Finish Schedule

DISCIPLINE/TRADE: _____

DWG./SPEC. REFERENCE: A200 & A825

QUESTION: Classroom 310: Finish Schedule lists ACT-2, but the Legend indicates ACT-1 in Classrooms

Dry 320: RCP shows open ceiling, Schedule lists ACT-3

Storage 350: not shown on the RCP, Schedule calls for ACT-4. The Legend states ACT-4 is designated for Cafeteria Corridors

Stair #1: not shown on the RCP

FIELD CONDITION _____

DRAWING/SPEC _____

DISCREPANCY _____

OWNER CHANGE _____

CLARIFICATION _____

CONTRACTOR'S SUGGESTION (IF APPLICABLE): _____

ANSWER

1. Classroom 310 has ACT-2 ceiling as per the Finish Schedule Legend on A825.

2. Dry 320 will be changed to P-3.

3. No ceiling work for Storage 350.

4. Stair #1 is patch to match.

ARCHITECT'S SIGNATURE: _____ DATE: _____

Note: review and any responses to this request for information by the architect/engineer is strictly for design intent only and does not constitute acknowledgement or acceptance of any cost or schedule implications unless specifically presented by the contractor. By submission of this request for information, the contractor assumes all responsibility in the absence of an approved change order or work directive.

END OF SECTION

FULLER AND D'ANGELO, P.C.
ARCHITECTS AND PLANNERS

PLOT DATE: February 26, 2025 -- 1:51pm


FILE: I:\24529.02 Edgemont High School Cafeteria Addition\DRAWINGS\CURRENT\1-F&D\A200.dwg
LOWER LEVEL REFLECTED CEILING PLAN (100% of Scale); Takeoff in Active Area: All Areas; Edgemont School District Administration Bldg Addition; OST 2025P; 3/17/2025 03:57 PM

WORKSCOPE NOTES:


- WS1 PROVIDE NEW DOOR IN EXISTING FRAME AND HARDWARE. SEE DOOR DETAILS & DOOR SCHEDULE.
- WS2 PROVIDE TOILET PARTITION COMPARTMENTS. SEE FINISH SCHEDULE, SPECIFICATION & 4.5/65/A651.
- WS3 PIPE TRENCH INFILL. SEE DETAILS 1/A651.
- WS4 PROVIDE CMU PARTITION TOOTH INTO ADJACENT MASONRY / INFILL CMU THICK TO MATCH EXISTING. BLOCK FILL, PRIME & PAINT.
- WS5 PROVIDE NEW DOOR MARBLE THRESHOLD. DEPTH TO MATCH DOOR FRAME. SEE DETAIL 9/A700.
- WS6 PROVIDE CERAMIC TILE FLOOR. SEE FINISH SCHEDULE, SPECIFICATION & DETAIL 2&3/A651.
- WS7 PROVIDE GLAZED CERAMIC WALL TILE. SEE FINISH SCHEDULE, SPECIFICATION & DETAIL 2&3/A651.
- WS8 PROVIDE CEMENT-BASED SELF-LEVELING UNDERLAYMENT TO ACHIEVE FLUSH CONDITION WITH ADJACENT FLOOR(S) ON 100% FLOOR SURFACE.
- WS9 PROVIDE FLOOR FINISH. SEE FINISH SCHEDULE AND FINISH PLANS.
- WS10 PROVIDE SUSPENDED ACOUSTICAL CEILING SYSTEM & ALL RELATED ITEMS. ELECTRICAL CONTRACTOR TO PROVIDE NEW LIGHT FIXTURES & CEILING MOUNTED DEVICES. COORDINATE INSTALLATION. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION. SEE DETAILS A652.
- WS11 PLUMBING FIXTURE. SEE P-DWGS.
- WS12 GRID DOWN EXISTING BRICK LEVEL WITH CMU WALLS AND SKIM COAT ENTIRE WALL TO PROVIDE SMOOTH SURFACE FOR CERAMIC TILE INSTALLATION AND PAINTED SURFACES.
- WS13 INSTALL NEW ALUMINUM THERMALLY BROKEN CURTAIN WALL ASSEMBLY AND RELATED ITEMS AS PER DETAILS AND SPECIFICATIONS.
- WS14 INSTALL FRP DOOR, ALUMINUM THERMALLY BROKEN DOOR FRAME AND HARDWARE. SEE DOOR DETAILS & SCHEDULE.
- WS15 PROVIDE ROLLER SHADE ASSEMBLY, ONE PER WINDOW BAY (TYPICAL). SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- WS16 ABRASE EXISTING PLASTER & CMU WALLS AND SKIM COAT TO PROVIDE SMOOTH SURFACE FOR CERAMIC TILE INSTALLATION AND PAINTED SURFACES.
- WS17 GRIND OUT EXISTING CRACKS IN CONCRETE FLOOR SLAB W/ 4" DIAMETER Y-BLADE GRINDER WITH HEPA VACUUM ATTACHMENT 1/4" WIDE X 1/4" DEEP. PROVIDE CLEAN PLAY SAND EMBEDDED IN CRACK FILLER. INCLUDE 30 L.P. OF CRACK REPAIR IN BASE BID PER ROOM.
- WS18 PROVIDE MOISTURE MITIGATION MEMBRANE ON 100% FLOOR SURFACE.
- WS19 REMOVE ANY REMAINING FASTENERS, ANCHORS OR SIMILAR ITEMS. FILL ALL HOLES, CRACKS AND DEPRESSIONS IN EXISTING CMU WALLS, PRIME & PAINT.
- WS20 GENERAL CONSTRUCTION CONTRACTOR TO PROVIDE SLOT IN EXISTING WALL FOR INSTALLATION OF NEW WIRING AND CONDUIT BY ELECTRICAL CONTRACTOR PATCH SLOTS. PROVIDE SMOOTH AND LEVEL TRANSITION TO ADJACENT SURFACE.
- WS21 PROVIDE CONCRETE FILL W/ #3 DOWELS INTO EXISTING SLAB, TO LEVEL OF ADJACENT CONCRETE SLAB AT EXISTING MECHANICAL & PLUMBING OPENINGS. ATTACH CLOSURE GALVANIZED STEEL PLATE TO BOTTOM OF EXISTING SLAB WHERE CRAWLSPACE IS AVAILABLE.
- WS22 INFILL OPENING WITH BRICK, INSULATION, CMU BACK-UP BLOCK AND GYPSUM BOARD, PRIME & PAINT, TOOTH MASONRY INTO EXISTING ADJACENT MASONRY. PROVIDE ALL MASONRY TIES (GALVANIZED), BRICK TO MATCH EXISTING ADJACENT COLOR/TEXTURE.
- WS23 PROVIDE MAGNETIC HOLD OPEN DEVICE. CONNECT TO EXISTING FIRE ALARM SYSTEM AND PROGRAM. RUN ALL WIRES CONCEALED IN WALLS OR ABOVE CEILINGS.

CEILING LEGEND

- 6"x4" RECESSED GRID MOUNTED LIGHT FIXTURE
- 2"x2" RECESSED MOUNTED LIGHT FIXTURE
- 2"x4" RECESSED MOUNTED LIGHT FIXTURE
- RECESSED CAN LIGHT FIXTURE
- SURFACE MOUNTED LIGHT FIXTURE
- CEILING MOUNTED TRACK LIGHTING
- WALL MOUNTED LIGHT FIXTURE.
- WALL MOUNTED AREA LIGHT FIXTURE
- SECURITY CAMERA
- FIRE ALARM SMOKE DETECTOR
- HEAT DETECTOR
- CEILING SPEAKER
- OCCUPANCY SENSOR
- CEILING REGISTER, SIZE VARIES. SEE MECHANICAL DRAWINGS.
- CEILING DIFFUSER, SIZE VARIES. SEE MECHANICAL DRAWINGS.
- CEILING CASSETTE, SIZE VARIES. SEE MECHANICAL DRAWINGS.
- CEILING MOUNTED EXIT SIGN W/ DIRECTIONAL ARROW
- WALL MOUNTED EXIT SIGN W/ DIRECTIONAL ARROW
- 2"x2" OR 2"x4" ACOUSTICAL CEILING TILE AND SUSPENSION SYSTEM
- GYPSUM BOARD OR SOFFIT
- WIRELESS INTERNET HUB
- FAN COIL UNIT ABOVE. SEE MECHANICAL DRAWINGS.
- CEILING MOUNTED PROJECTOR. SEE DETAIL 9/A653.

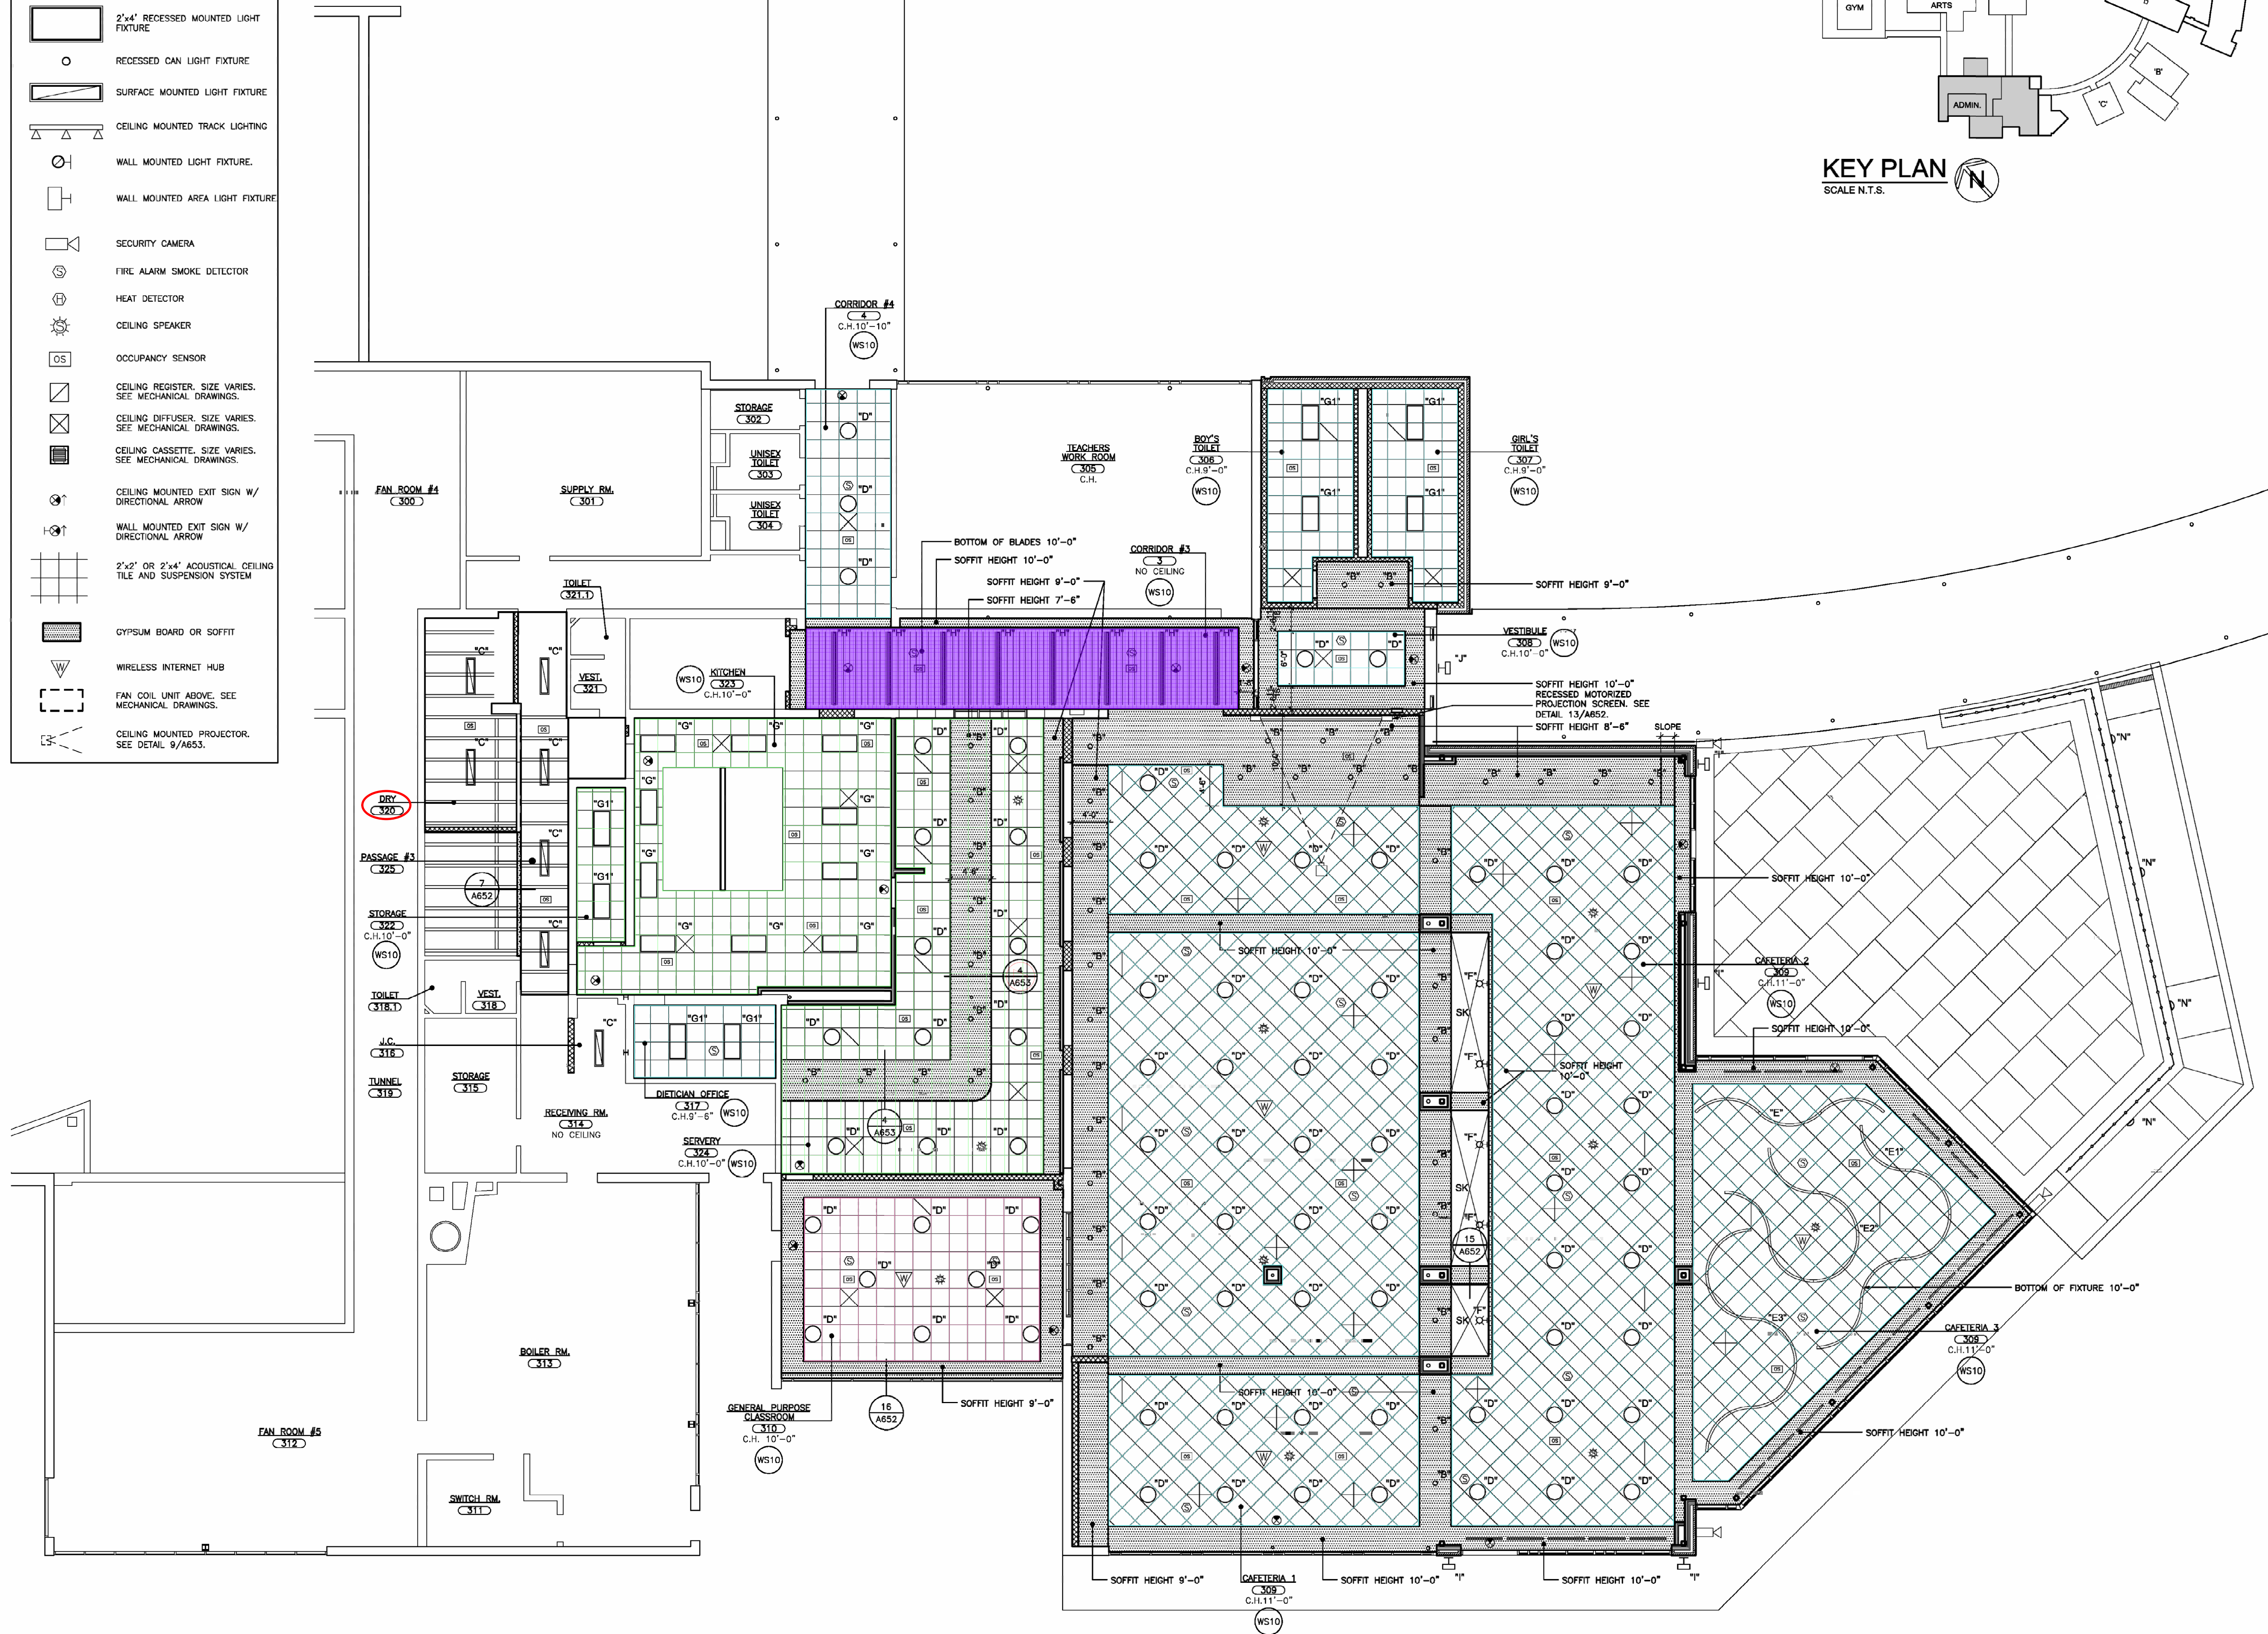

1 LOWER LEVEL REFLECTED CEILING PLAN
SCALE: 1/8" = 1'-0"

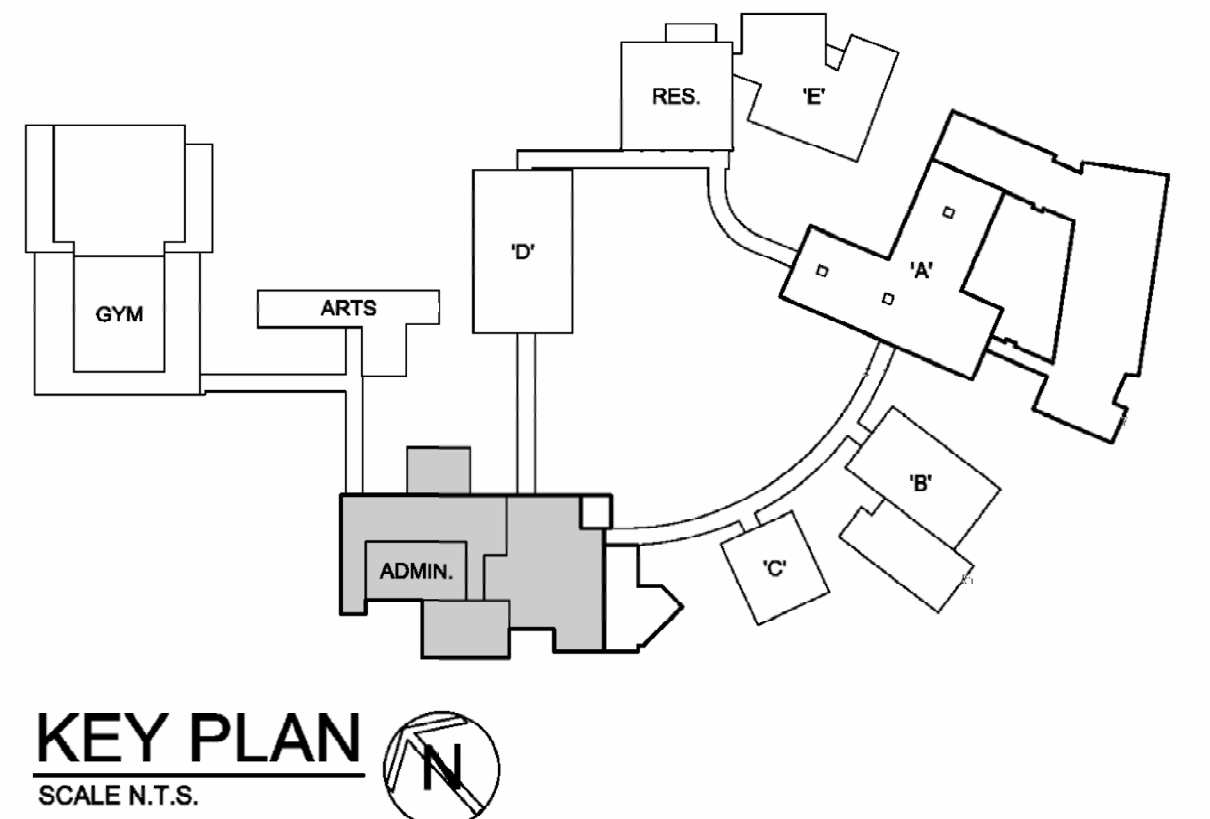

AS PER USA CONGRESS ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT OF 1990 ALL IDEAS AND DESIGNS INCLUDING DERIVATIVES THEREOF, ALL DRAWINGS AND SPECIFICATIONS CONSTITUTE THE ORIGINAL COPYRIGHT WORK BY FULLER AND DANKELO, P.C. (F&D). THE DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE BY F&D ARE CREATED BY F&D FOR THIS PROJECT ONLY AND REMAIN THE PROPERTY OF F&D. ANY REPRODUCTION WITHOUT THE PRIOR CONSENT OF F&D IS PROHIBITED.

ALTERNATION OF THESE DOCUMENT EXCEPT BY A SEPARATE DOCUMENT OR BY A SEPARATE DOCUMENT OF NEW YORK STATE EDUCATION LAW.

48 HOLLWOOD ROAD ELMSFORD NEW YORK 10523
TEL 914.899.4444 FAX 914.899.1919
Copyright 2025. All Rights Reserved by FULLER & DANKELO, P.C.

FULLER
DANKELO
P.C.
ARCHITECTS
PLANNERS

S.E.D. CONTROL NUMBER
HIGH SCHOOL ADMINISTRATION BUILDING:
1604-05-03-011-015

PROJECT: EDGEMONT SCHOOL DISTRICT
ADMINISTRATION BUILDING ADDITION, SITE
IMPROVEMENTS & RELATED WORK
DRAWING TITLE:
LOWER LEVEL REFLECTED CEILING PLAN

02-28-2025 BID
06-10-2022 S.E.D. SUBMISSION
DATE ISSUED TO

SHEET 8 OF 7
30"x42"

SCALE
AS NOTED





DRAWN BY
F & D

DRAWING NO.
A200

FILE NO.
24529.02

FINISH SCHEDULE														WALL INDICATIONS ON PLAN	
BLDG.	LEVEL	LINE	DESIGNATION	FLOOR	BASE (MAT.)	WALL 1	WALL 2	WALL 3	WALL 4	CLG.	TRIM DOORS	DOOR FRAMES	CASEWORK CABINETS COUNTER TOPS	EDGING	REMARKS
ADMINISTRATION BUILDING	FIRST FLOOR	01	CORRIDOR #3	QHT-2	RB-3	P-6	P-6	GLT-1.5, 6.7.8 P-6	P-6	ACT-1/2	—	P-3	—	—	SCH-1 FOR CORNERS / WQHT-1
		02	CORRIDOR #4	QHT-2	RB-3	P-6	P-6	P-6	P-6	ACT-2/2	—	P-3	—	—	SCH-1 FOR CORNERS / WQHT-1
		03	BOY'S TOILET/306	CT-1	GLT-2	GLT-1,3,4	GLT-1,3,4	GLT-1,3,4	GLT-1,3,4	ACT-2	—	P-3	—	—	
		04	GIRL'S TOILET/306	CT-1	GLT-2	GLT-1,3,4	GLT-1,3,4	GLT-1,3,4	GLT-1,3,4	ACT-2	—	P-3	—	—	
		05	VESTIBULE/308	QHT-2	RB-3	GLT-1.9 P-6	GLT-1 P-6	GLT-1 P-6	GLT-1 P-6	ACT-2/2	—	P-3	—	—	SCH-1 FOR CORNERS / WQHT-1
		06	CAFETERIA 1/309	QHT-1,2,3	RB-3	GLT-1.5, 6.7.8 P-6	GLT-1.5, 6.7.8 P-6	GLT-1.5, 6.7.8 P-6	GLT-1.5, 6.7.8 P-6	ACT-2/2	—	P-3	—	—	SCH-1 FOR CORNERS / WQHT-1
		07	CAFETERIA 2/309	QHT-1,2,3	RB-3	GLT-1.5, 6.7.8 P-6	GLT-1.5, 6.7.8 P-6	GLT-1.5, 6.7.8 P-6	GLT-1.5, 6.7.8 P-6	ACT-2/2	—	P-3	CAB-1	—	SCH-1 FOR CORNERS / WQHT-1
		08	CAFETERIA 3/309	QHT-1,2,3	RB-3	GLT-1.5, 6.7.8 P-6	GLT-1.5, 6.7.8 P-6	GLT-1.5, 6.7.8 P-6	GLT-1.5, 6.7.8 P-6	ACT-2/2	—	P-3	—	—	SCH-1 FOR CORNERS / WQHT-1
		09	CLASSROOM/310	QHT-1,2	RB-3	P-6	P-6	P-6	P-6	ACT-2/2	—	P-3	—	—	WQHT-1
		10	JANITOR CLOSET/316	P-4	RB-3	P-6	P-6	P-6	P-6	—	—	P-3	—	—	
		11	DIETITIAN OFFICE/317	HVT-1	RB-3	P-6	P-6	P-6	P-6	ACT-2	—	P-3	—	—	
		12	DRY/320	EPOXY-1	EPOXY-1	P-6	P-6	P-6	P-6	ACT-3	—	P-3	—	—	
		13	STORAGE/322	EPOXY-1	EPOXY-1	P-6	P-6	P-6	P-6	ACT-3	—	P-3	—	—	
		14	KITCHEN/323	EPOXY-1	EPOXY-1	P-9	GLT-1 P-9	GLT-1 P-9	GLT-1 P-9	ACT-3	—	P-3	CAB-1	—	SCH-1 FOR CORNERS
		15	SERVERY/324	EPOXY-1	EPOXY-1	GLT-1.5, 6.7.8	GLT-1.5, 6.7.8	GLT-1.5, 6.7.8	GLT-1.5, 6.7.8	ACT-3/2	—	P-3	—	—	SCH-1 FOR CORNERS
		16	STORAGE / 350	QHT-2	RB-3	P-6	P-6	P-6	P-6	ACT-4	—	P-3	—	—	WQHT-1
		17	PASSAGE #3/325	HVT-1	RB-3	P-6	P-6	P-6	P-6	—	—	P-3	—	—	
		18	STAIR #1	QHT-2	RB-3	P-6	P-6	P-6	P-6	ACT-2	—	P-3	—	—	WQHT-1
		19													
		20													
		21													
		22													
		23													
		24													
		25													
		26													
		27													
		28													
		29													
		30													
		31													
		32													
		33													
		34													
		35													
		36													
		37													
		38													
		39													
		40													
		41													
		42													
		43													
		44													
		45													
		46													
		47													
		48													
		49													
		50													
		51													
		52													
		53													
		54													
		55													
		56													
		57													
		58													
		59													
		60													
		61													
		62													
		63													
		64													
		65													
		66													
		67													
		68													
		69													
		70													
		71													
		72													
		73													
		74													
		75													
		76													
		77													
		78													

FINISH SCHEDULE LEGEND					
LEGEND	SIZE	MANUFACTURER	SERIES/MODEL NO / COLOR	DESCRIPTION	LOCATION / REMARKS
P-1	—	SHERWIN WILLIAMS	SW7006 / EXTRA WHITE	EGGSHELL PAINT	CLASSROOM
P-2	—	SHERWIN WILLIAMS	SW7757 / HIGH REFLECTIVE WHITE	FLAT PAINT	SOFFITS & CEILINGS
P-3	—	SHERWIN WILLIAMS	SW2837 / AURORA BROWN	SEMI-GLOSS DOOR FRAMES	DOOR FRAMES
P-4	—	SHERWIN WILLIAMS	COLOR TO BE SELECTED BY ARCHITECT	FLOOR PAINT	FLOOR PAINT
P-5	—	SHERWIN WILLIAMS	SW6511 / SNOWDROP	EGGSHELL PAINT	ACCENT WALL PAINT
P-6	—	SHERWIN WILLIAMS	SW7102 / WHITE FLOUR	EGGSHELL PAINT	CAFETERIA WALL PAINT
P-7	—	SHERWIN WILLIAMS	SW6892 / CARNAVAL	EGGSHELL PAINT	ACCENT WALL PAINT
P-8	—	SHERWIN WILLIAMS	SW6485 / RAINDROP	EGGSHELL PAINT	ACCENT WALL PAINT
P-9	—	SHERWIN WILLIAMS	SW7102 / WHITE FLOUR	EPOXY WALL PAINT	KITCHEN
ACT-1	2'x4"x $\frac{5}{8}$ "	ROCKFON	ALASKA / 10101 / LAY-IN	ACOUSTICAL CEILING TILE	CLASSROOMS
ACT-2	2'x2"x $\frac{5}{8}$ "	ROCKFON	ALASKA / 10100 / LAY-IN	ACOUSTICAL CEILING TILE	CORRIDOR OFFICE & TOILET
ACT-3	2'x2"x $\frac{5}{8}$ "	ROCKFON	HYGIENIC PLUS / 31100 / LAY-IN	ACOUSTICAL CEILING TILE	KITCHEN & SERVING
ACT-4	8'-0"	ARMSTRONG	INFUSION BLADE CONCEPT ALTERNATING DIRECTION/ REFINED LAGOON & REFINED TANGERINE	CEILING BLADE	CAFETERIA CORRIDORS — INSTALL IN ALTERNATING DIRECTION & ALTERNATING COLORS
EPOXY-1	6" HIGH BASE	PALMA INC	NOVALAC 185 / ADOBE	EPOXY FLOOR PAINT W/ 6" HIGH BASE	KITCHEN & SERVING
HVT-1	18"x18"	TOLI	TERRALINE / SANDSTONE 7002	HOMOGENOUS VINYL TILE	OFFICE
QHT-1	36"x36"	PATCRAFT	ADMIX / WHITE CORAL 00100	HOMOGENOUS TERRAZZO VINYL TILE	CAFETERIA FIELD COLOR
QHT-2	36"x36"	PATCRAFT	ADMIX / SEA STAR 00120	HOMOGENOUS TERRAZZO VINYL TILE	CAFETERIA FIELD COLOR
QHT-3	36"x36"	PATCRAFT	ADMIX ENDURE / PYRITE 00105	HOMOGENOUS TERRAZZO VINYL TILE	CAFETERIA ACCENT COLOR
WQHT-1	—	PATCRAFT	CG802 WHITE	WELD ROD	CAFETERIA SEAM WELDS
GLT-1	6"x18"	DALTILE	BISCUIT K175	GLAZED CERAMIC WALL TILE	TOILET WALLS, CAFETERIA & SERVERY
GLT-2	6"x6"	DALTILE	BISCUIT K175	GLAZED COVE BASE	TOILET WALLS
GLT-3	6"x6"	DALTILE	BISCUIT K175	GLAZED BULLNOSE	TOILET WALLS
GLT-4	3"x6"	DALTILE	OCEAN BLUE 1049	GLAZED CERAMIC WALL TILE	TOILETS ACCENT
GLT-5	6"x6"	DALTILE	CURRENT SH17	GLAZED CERAMIC WALL TILE	SERVERY ACCENT
GLT-6	6"x6"	DALTILE	ORANGE BURST 1097	GLAZED CERAMIC WALL TILE	SERVERY ACCENT
GLT-7	6"x6"	DALTILE	MUSTARD 1012	GLAZED CERAMIC WALL TILE	SERVERY ACCENT
GLT-8	6"x6"	DALTILE	CORNSILK 0180	GLAZED CERAMIC WALL TILE	SERVERY ACCENT
GLT-9	6"x18"	DALTILE	OCEAN BLUE 1049	GLAZED CERAMIC WALL TILE	TOILET CORRIDOR WALL FIELD
GLT-10	3"x6"	DALTILE	BISCUIT K175	GLAZED CERAMIC WALL TILE	TOILET CORRIDOR ACCENT
CT-1	12"x24"	CASALGRANDE PADANA	BASALTINA / PANTELLERA / NATURAL MATT	PORCELAN FLOOR TILE	TOILET FLOORS FIELD / JOINTS @ 1/3 POINTS OF TILE
GROUT-1	—	MAPEI	ULTRACOLOR PLUS FA / 06 HARVEST	WALL GROUT	WALL TILE
GROUT-2	—	MAPEI	ULTRACOLOR PLUS FA / 02 PEWTER	FLOOR GROUT	FLOOR TILE
SCH-1	1 $\frac{1}{2}$ "	SCHLUTER	ECK-E / 8-E37 V2A EB 80/300 / BRUSHED STAINLESS STEEL	CORNER TRIM	CORNER TRIM FOR CAFETERIA & SERVERY ONLY
SCH-2	—	NOT USED			
SCH-3	—	SCHLUTER	DILEX-EKSB-25-PQ-VAA	MOVEMENT JOINT	FLOORING MOVEMENT JOINT CAFETERIA
RB-1	4" HIGH	JOHNSONITE	45 SANDALWOOD WB	RUBBER BASE	CLASSROOM
RB-2	4" HIGH	JOHNSONITE	VMS DREAM TEAL	RUBBER BASE	CORRIDORS
RB-3	4" HIGH	JOHNSONITE	TAT RUSTY NAIL	RUBBER BASE	CAFETERIA
RTS-1	—	JOHNSONITE	COLOR TO BE SELECTED BY ARCHITECT	RUBBER TRANSITION STRIPS	CLASSROOM
TOILET-1	—	SCRANTON PRODUCTS	SOLID PLASTIC / NICKLE / HAMMERED	TOILET PARTITION	TOILET PARTITIONS
VAN-1	—	BRADLEY	EXPRESS ELX-3 / MOONDUST	LAVATORY SYSTEM	TOILETS
CAB-1	—	FORMICA	0164-15 / QUILTED STAINLESS	CABINET LAMINATE	SERVERY
COT-1	—	WILSONART	FRENCH BLUE MELANGE	SOLID SURFACE COUNTERTOPS & STOOLS	CLASSROOM

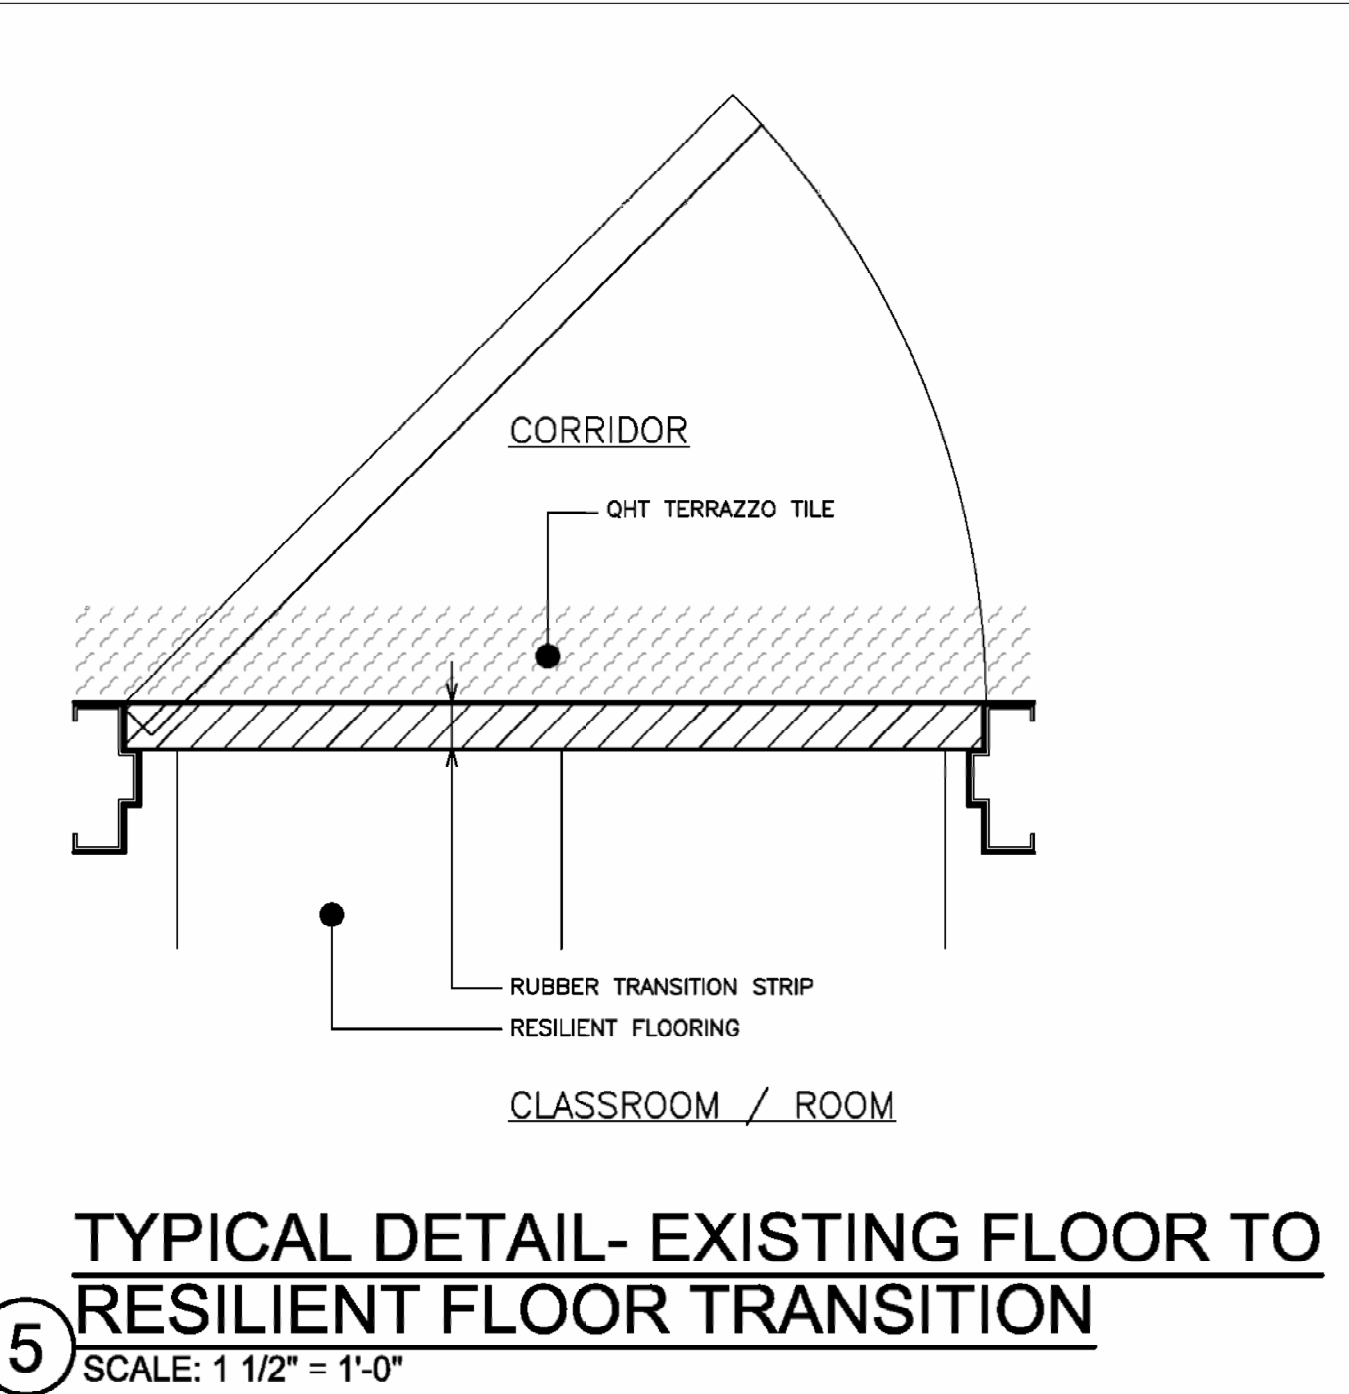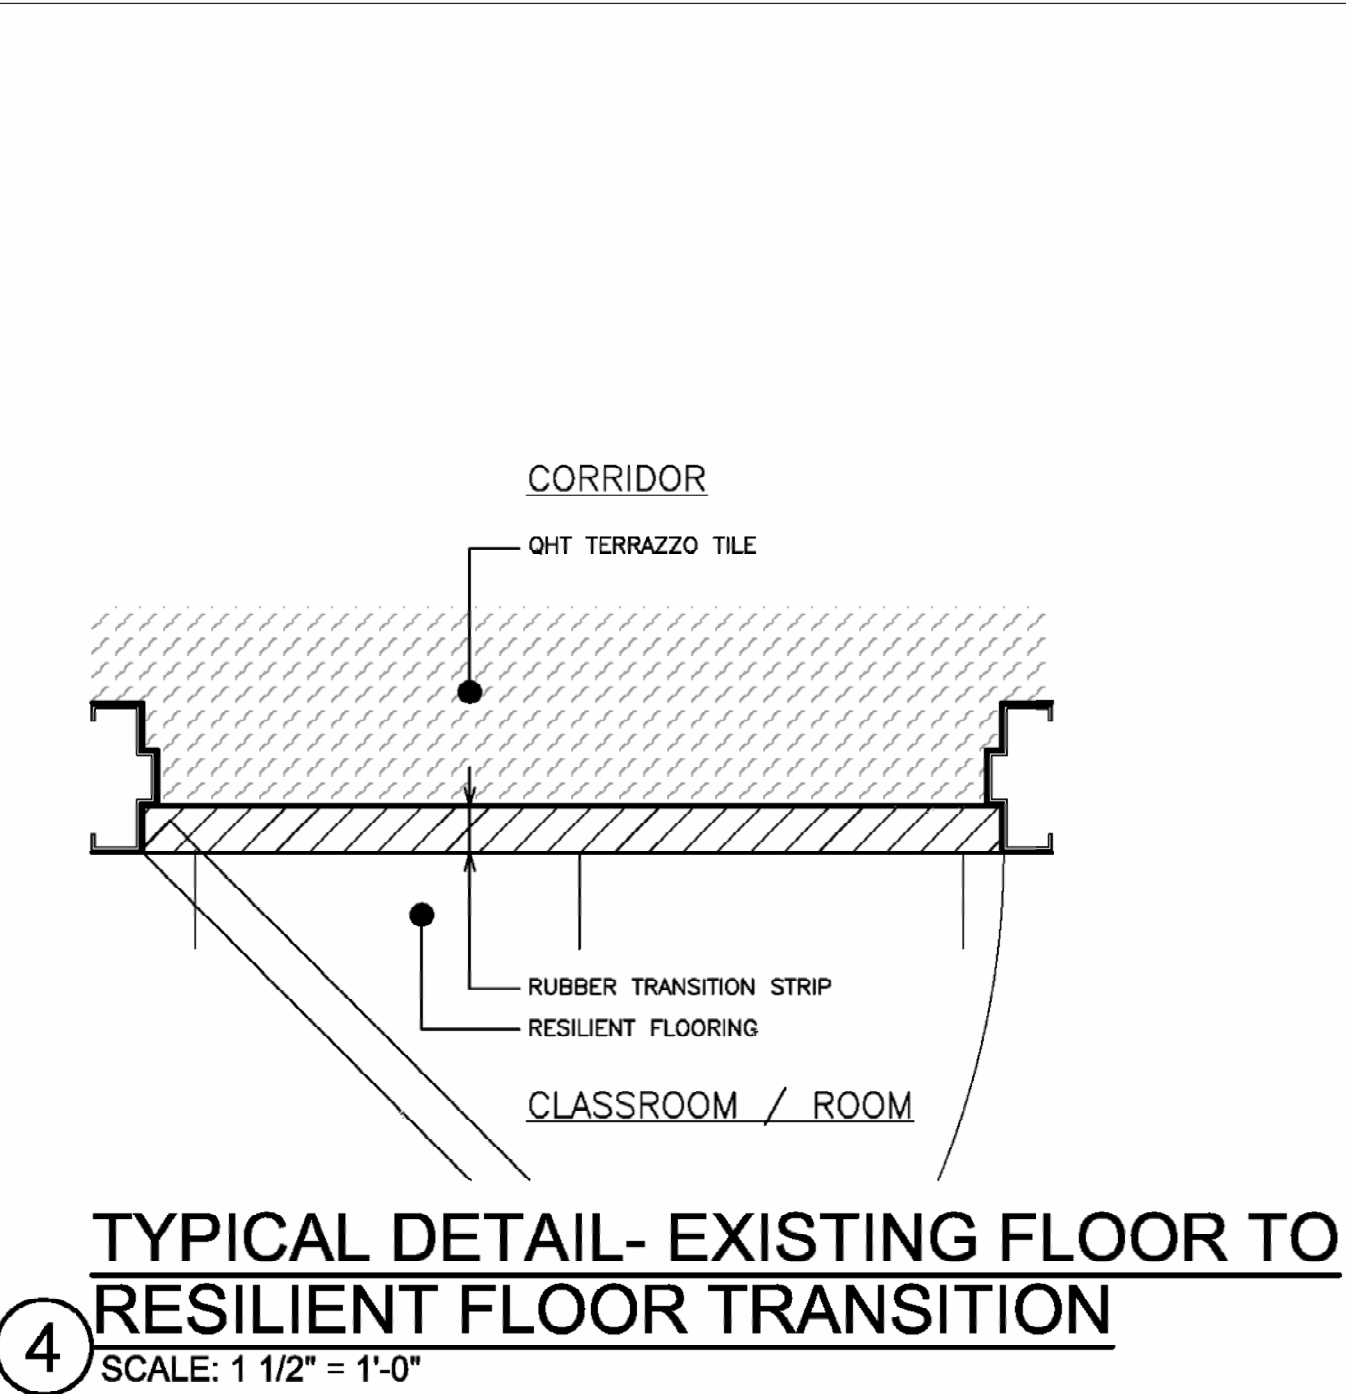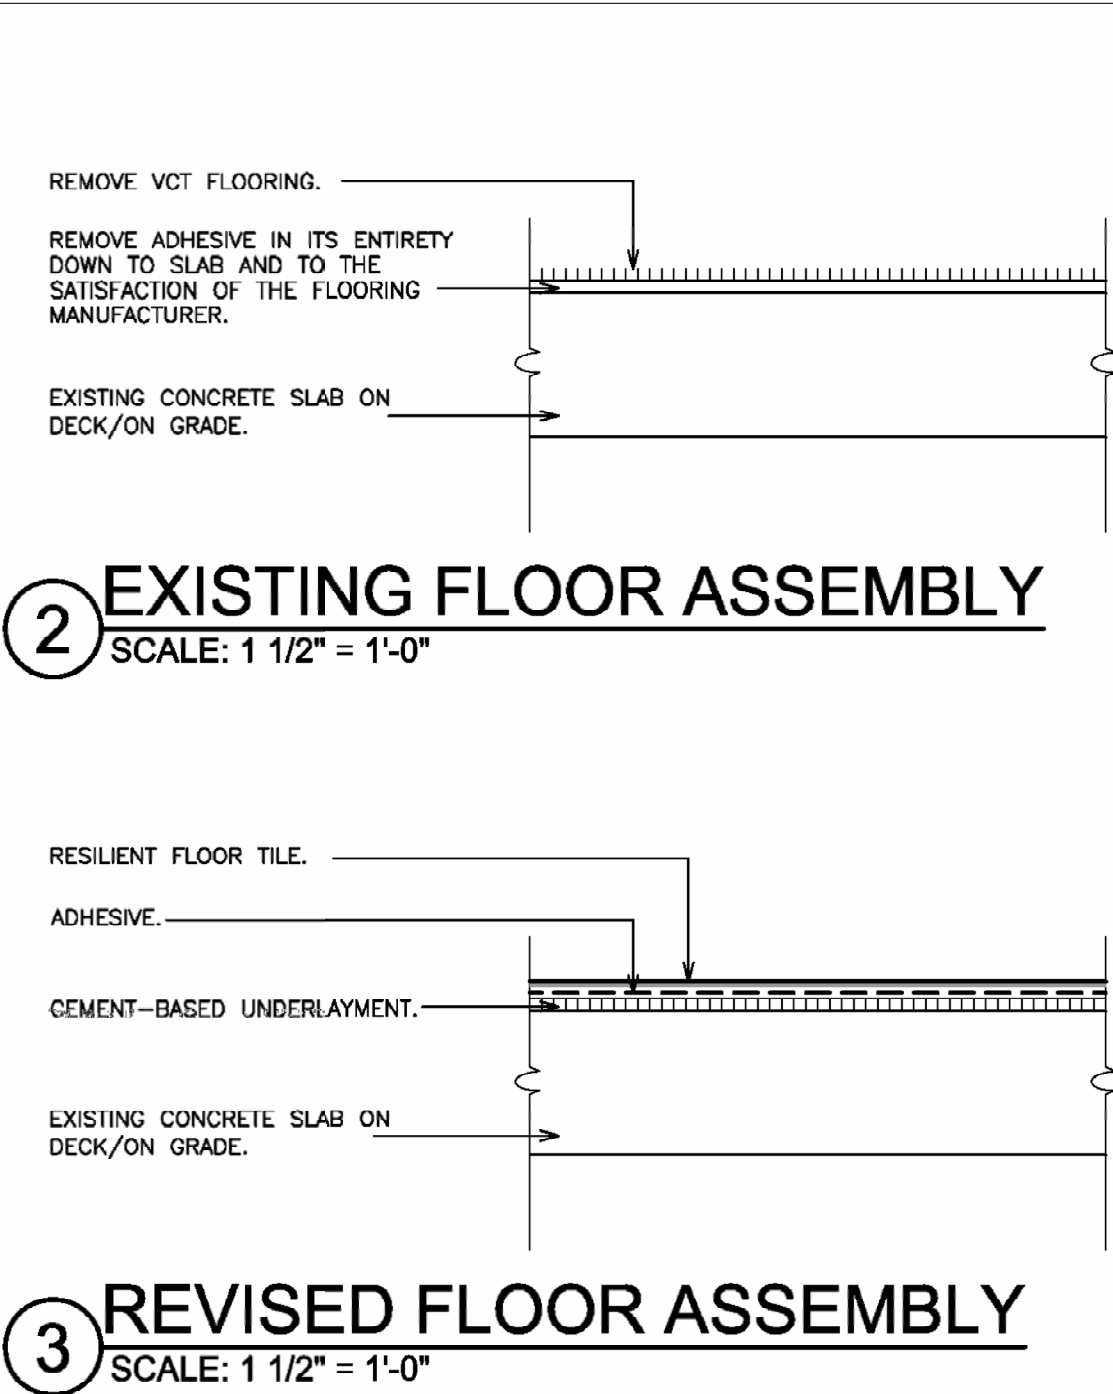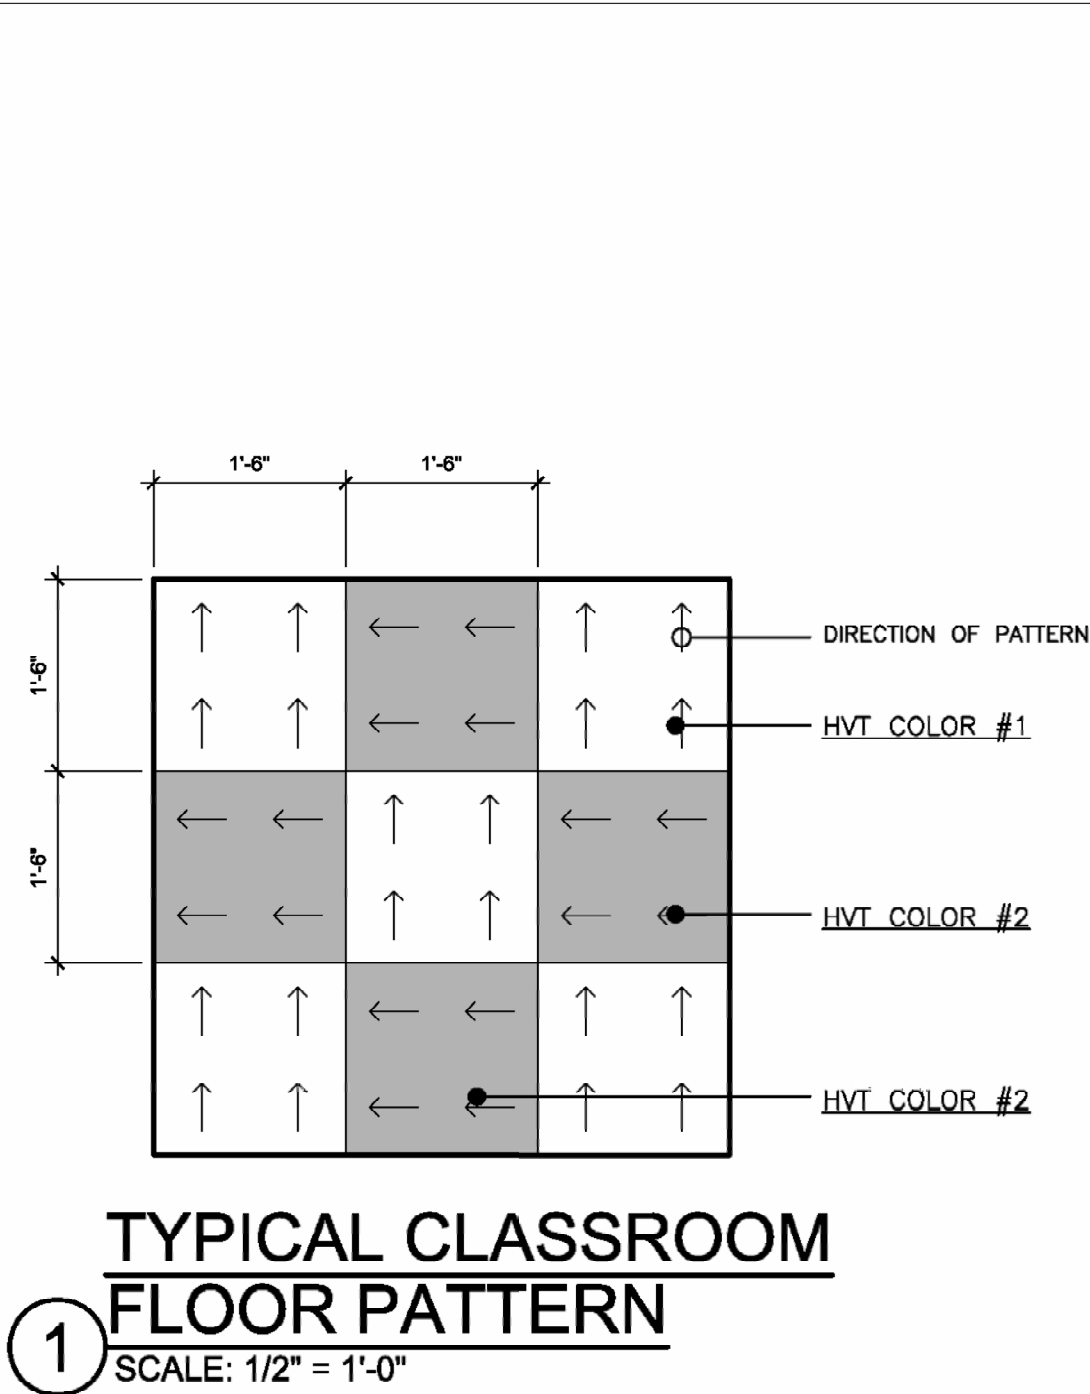

AS PER USA CONGRESS ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT OF 1990 ALL IDEAS AND DESIGNS INCLUDING DERIVATIVES THEREOF, ALL DRAWINGS AND SPECIFICATIONS CONSTITUTE THE ORIGINAL COPYRIGHT WORK BY FULLER & DANIELO, P.C. (F&D). THE DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE BY F&D ARE CREATED BY F&D FOR THIS PROJECT ONLY AND REMAIN THE PROPERTY OF F&D. ANY REPRODUCTION WITHOUT THE PRIOR CONSENT OF F&D IS PROHIBITED.

ALTERATION OF THESE DOCUMENTS EXCEPT BY A REGISTERED PROFESSIONAL ARCHITECT IN VIOLATION OF NEW YORK STATE EDUCATION LAW.

48 INGLEWOOD ROAD ELMSFORD NEW YORK 10523
TEL 914.899.4444 FAX 914.899.1919
Copyright 2022 All Rights Reserved by FULLER & DANIELO P.C.

FULLER
DANIELO
P.C.
ARCHITECTS
PLANNERS

S.E.D. CONTROL NUMBER
110H180100L ADMINISTRATION BUILDING
1804-08-03-0011-0015

PROJECT
EDGEMONT SCHOOL DISTRICT
ADMINISTRATION BUILDING ADDITION
IMPROVEMENTS & RELATED WORK
300 WHITE OAK LANE SCARSDALE, NY 10583

DRAWING TITLE
FINISH LEGEND, FINISH SCHEDULE AND
DETAILS

02-28-2025	BID
06-10-2022	S.E.D. SUBMISSION
DATE	ISSUED TO

SHEET SIZE 30"x42"	DRAWING NO.
SCALE AS NOTED	A825
DRAWN BY F & D	FILE NO. 24529.02

006

CONTRACTOR'S REQUEST FOR INTERPRETATION NO. _____ F&D RFI NO: 01 (F&D USE)

NAME OF PROJECT: Administration Building Cafeteria Addition

NAME OF OWNER: Edgemont School District

FACILITY: Edgemont Jr./Sr. High School

DATE: 03/19/2025

A/E PROJECT NO: 24529.02

ARCHITECT: Fuller and D'Angelo, P.C.

45 Knollwood Road, Elmsford, NY 10523

Tel: 914-592-4444; Fax: 914-592-1717

William Means, RA WilliamM@fullerdangelo.com

Refer to Section 00 2113 Par 1.13 for additional requirements.

FROM (CO. NAME): ACS System Associates Inc.

CONTACT NAME: Beneesh Thomas Tel: 516-681-1350

Tel: _____ E-mail: estimating@acssystem.com

SUBJECT: RFI

DISCIPLINE/TRADE: HVAC

DWG./SPEC. REFERENCE: AD M100

QUESTION: Alternate#1: Alternate #1 details are missing from Bid form ?

Work hours : Regular / Overtime hours?

Project Duration : Please provide project duration ?

EVAP Schedule : As per Plan AD M100 there are evaporator shown on the plan . But as per schedule details are missing ?

FIELD CONDITION

DRAWING/SPEC

DISCREPANCY


OWNER CHANGE

CLARIFICATION

CONTRACTOR'S SUGGESTION (IF APPLICABLE):

ANSWER

See Addendum #3

ARCHITECT'S SIGNATURE: 

DATE: 3/21/2025

Note: review and any responses to this request for information by the architect/engineer is strictly for design intent only and does not constitute acknowledgement or acceptance of any cost or schedule implications unless specifically presented by the contractor. By submission of this request for information, the contractor assumes all responsibility in the absence of an approved change order or work directive.

END OF SECTION

FULLER AND D'ANGELO, P.C.
ARCHITECTS AND PLANNERS