

# J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



August 8, 2024

Mr. Anthony Gagliano  
East Islip Union Free School District  
Administrative Office  
1 Craig B. Gariepy Avenue  
Islip Terrace, New York 11752

Re: **Lead Testing in School Drinking Water  
Remedial Action Plan  
2023-25 Compliance 10 NYCRR Subpart 67-4**

JCB#: **22-50983**

Dear Mr. Gagliano:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 5 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead in Water Remediation Plan  
Attachment 2: Outlet Inventory and Lead Testing Results  
Attachment 3: Laboratory Analytical Reports  
Attachment 4: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.

Sincerely,

A handwritten signature in black ink, appearing to read 'Tara Ricker', is located below the 'Sincerely,' text.

Tara Ricker  
J C Broderick & Associates, Inc.

Attachment 1:

Lead in Water  
Remediation Plan


**J.C. Broderick & Associates, Inc.**

*Environmental Consulting & Testing*

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

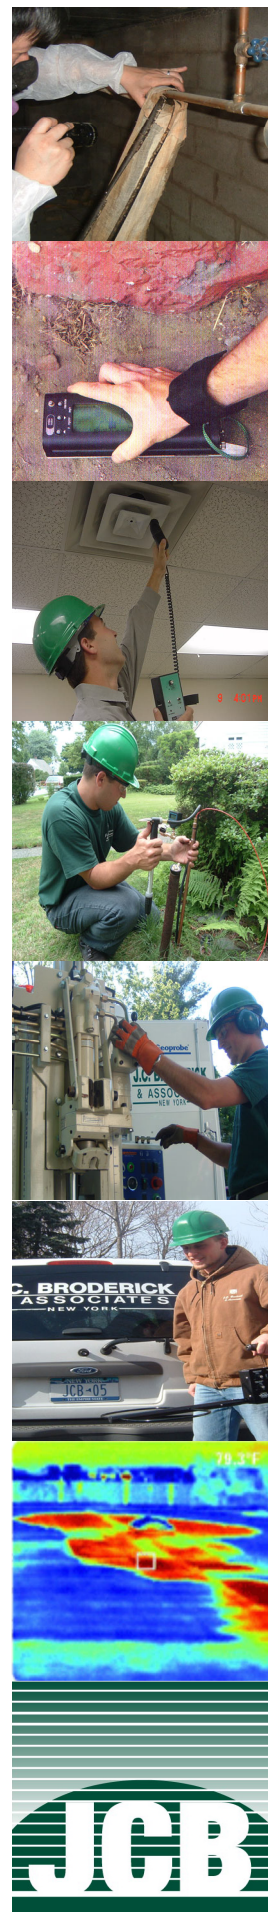

# Lead in Water Remediation Plan

Section 67-4.4 Response of the New York State Department of Health (NYS DOH) Title 10 of the Official Compilation of the Codes, Rules and Regulations of the State of New York requires:

*If the lead concentration of water at an outlet exceeds the action level, the school shall:*

*(a) prohibit use of the outlet until:*

*(1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and*

*(2) test results indicate that the lead levels are at or below the action level;*

As historical sampling results have indicated, the concentrations of lead are more likely attributable to the individual fixtures and/or their immediately adjoining plumbing, and not with the building-wide plumbing. Based upon this information, the following remedial steps are recommended:

## **Step 1A: Potable Outlets** (Outlets intended to be used for drinking/cooking)

Immediately remove the fixture from service. If necessary, provide an adequate supply of potable water for drinking/cooking to this location at no cost to the occupants. If an outlet is seldomly used or is unnecessary, the district may consider permanent removal of the outlet and capping of its supply line.

## **Step 1B: Non-Potable Outlets** (Outlets not intended for drinking/cooking)


See Step 1A OR Placard the outlet for non-drinking use. Signs must be clearly visible and in close proximity to the affected outlet. Example signage is provided at: [https://www.health.ny.gov/environmental/water/drinking/lead/docs/donotdrinksigns\\_lead.pdf](https://www.health.ny.gov/environmental/water/drinking/lead/docs/donotdrinksigns_lead.pdf).



Do not use for drinking



Hand washing only

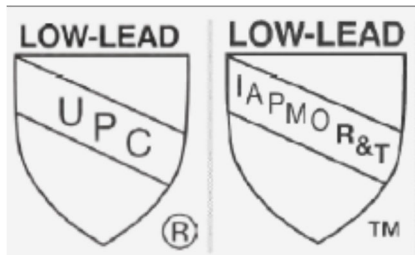

## **Step 2: Service & Repair or Outlet Replacement**

The school district's plumber should evaluate the outlet to determine if any components require service or repair. Depending on the extent of service/repair necessary, age of the fixture, and or overall costs, the district may consider replacing the outlet entirely. Any newly installed components shall be certified lead free. (i.e. NSF/ANSI 61, NSF/ANSI-273). If servicing involves installing/replacing a point-of-use filtration system, this filter shall be certified for its lead reduction capability (i.e. NSF/ANSI 53). Follow all manufacturer's instructions for all component installations. OUTLET RESTRICTIONS MUST REMAIN IN PLACE UNTIL SATISFACTORY TEST RESULTS ARE RECEIVED. See Step 3.

## **Step 3: Retesting & Return to Service**

Schedule a retest of the outlet. Outlet restrictions must remain in place until lead testing results at or below the action level are received. Once satisfactory results are received, the outlet may be returned to normal service. Note: It is recommended that "Do Not Drink" signage remain in place for all non-potable and non-applicable outlet types.

Attachment 2:

Outlet Inventory and  
Lead Testing Results


**J.C. Broderick & Associates, Inc.**

*Environmental Consulting & Testing*

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

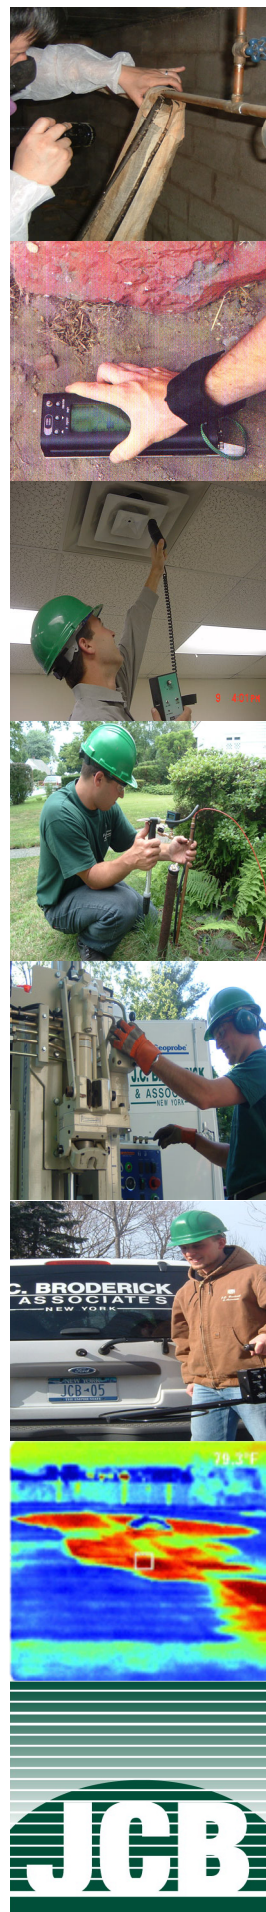



# Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-50983

## East Islip Union Free School District

### East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0001	Kitchen North Serving Area	1006A	Hand Wash Only	Non-Potable	6/8/2024	4.3			Result Below Action Level Continue O&M
EIUFSD-0002	Kitchen South Serving Area	1006J	Hand Wash Only	Non-Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0003	Kitchen	1006	Kitchen Faucet (Cold)	Non-Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0004	Kitchen	1006	Kitchen Faucet (Cold)	Non-Potable	6/8/2024	1.3			Result Below Action Level Continue O&M
EIUFSD-0005	Kitchen	1006	Kitchen Faucet (Cold)	Non-Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0006	Kitchen	1006	Spray Nozzle	Non-Applicable	6/8/2024	8.4			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-0007	Kitchen	1006	Hand Wash Only	Non-Potable	6/8/2024	1.7			Result Below Action Level Continue O&M
EIUFSD-0008	Kitchen	1006	Kitchen Faucet (Cold)	Potable	6/8/2024	3.3			Result Below Action Level Continue O&M
EIUFSD-0009	Kitchen	1006	Kitchen Faucet (Cold)	Potable	6/8/2024	2.5			Result Below Action Level Continue O&M
EIUFSD-0010	Kitchen	1006	Hand Wash Only	Non-Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0011	Kitchen	1006	Hand Wash Only	Non-Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0013	Kitchen	1006	Hand Wash Only	Non-Applicable	6/8/2024	23.9			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-0014	Kitchen	1006	Hand Wash Only	Non-Potable	6/8/2024	2.4			Result Below Action Level Continue O&M
EIUFSD-0015	Kitchen Storage	1006G	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0016	Kitchen Storage	1006G	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0022	Kitchen Faculty Lounge	1006I	Hand Wash Only	Non-Potable	6/8/2024	2.5			Result Below Action Level Continue O&M



# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0023	Laundry And Ice Room	1004	Ice Machine	Non-Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0034	1st Floor Corridor Main Lobby To Room 100 (Across Main	1050	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0035	1st Floor Corridor Main Lobby To Room 100 (Across Main	1050	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0036	1st Floor Corridor Main Lobby To Room 100 (Across Main	1050	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0041	Main Office Bathroom	1042B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0044	Main Office Storage	1044	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0045	Director Of Careers Vestibule	1048	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0046	Director Of Careers Vestibule	1048	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0047	Nurses Suite Office	1053B	Nurse's Office Sink	Non-Potable	6/8/2024	1.1			Result Below Action Level Continue O&M
EIUFSD-0048	Nurse's Suite Office Bathroom	1053B2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0050	Art Office	1054B	Kitchen Faucet (Cold)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0052	Art Room Room 104	1055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0053	Art Room Room 104	1055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0054	Art Room Room 104	1055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0058	Art Room 106B	1058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0062	Art Room 108	1057	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0063	Art Room 112	1060	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0064	Art Room 112	1060	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0065	Art Room 112	1060	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0066	Library Office	1008A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0070	1st Floor Corridor Room 128 to Nurse's Office (Across	1078	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0071	1st Floor Corridor Room 128 to Nurse's Office (Across	1078	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0072	1st Floor Corridor Room 128 to Nurse's Office (Across	1078	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0078	Clearly School Office 114A	1066	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0080	Cosmetology Room 120	1072	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0081	Cosmetology Room 120	1072	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0082	Cosmetology Room 120	1072	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0083	Cosmetology Room 120	1072	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0084	Cosmetology Room 120	1072	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0085	Cosmetology Room 120	1072	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0086	Cosmetology Room 120	1072	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0087	Cosmetology Room 120 Storage	1072A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0088	Cosmetology Room 120 Storage	1072A	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0089	Cosmetology Room 120 Storage	1072A	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0091	Room 118 B	1070A	Bottled Water Dispenser (Hot)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0092	Room 118 B	1070A	Bottled Water Dispenser (Cold)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0093	Room 122	1073	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0094	Science Prep Room 101	1108A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0095	Greenhouse	1108B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0096	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0097	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0098	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0099	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0100	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0101	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0102	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0103	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0104	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0105	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0107	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0108	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0109	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0110	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0111	Science Room 103	1107	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0112	Science Room 103	1107	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0113	Science Room 103	1107	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0114	Science Room 103	1107	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0115	Science Room 103	1107	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0116	Science Room 103	1107	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0118	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use



# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0119	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0120	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0121	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0122	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0123	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0124	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0125	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0126	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0127	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0128	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0129	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0130	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0131	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0132	Science Room 105	1106	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0134	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0135	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0136	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0137	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0138	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0139	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0141	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0142	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0143	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0144	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0145	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0146	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0147	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0148	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0149	Science Room 107	1105	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0151	Science Room 107	1105	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0152	Science Room 107	1105	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0153	Science Room 107	1105	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0154	Science Room 107	1105	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0155	Science Room 107	1105	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0156	Science Room 109	1103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0157	Science Room 109	1103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0158	Science Room 109	1103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0159	Science Room 109	1103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0160	Science Room 109	1103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0161	Science Room 109	1103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0162	Science Room 109	1103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0164	Science Room 113	1099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0165	Science Room 113	1099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0167	Science Room 113	1099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0168	Science Room 113	1099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0169	Science Room 113	1099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0178	1st Floor Corridor Room 101 to Room 133 (Across Science	1110	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0179	1st Floor Corridor Room 101 to Room 133 (Across Science	1110	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0180	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0181	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0182	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0183	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0184	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0185	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0186	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0187	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0188	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0189	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0190	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0191	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0192	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0193	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0194	Science Room 117	1094	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0195	Room 121 Prep Room	1093A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0199	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0200	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0201	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0202	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0204	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0206	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0208	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0210	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0212	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0213	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0214	Science Room 119	1092	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0215	Science Room 119	1092	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0216	Science Room 119	1092	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0217	Prep Room	1091	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0218	Science Room 127	1090	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0219	Science Room 127	1090	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0220	Science Room 127	1090	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0221	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0222	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0223	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0224	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0225	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0226	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0227	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0228	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0229	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0230	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0231	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0232	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0234	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0235	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0236	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0237	Science Room 129 Storage Prep	1088A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0238	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0239	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0240	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0241	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0242	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0243	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0244	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0246	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0247	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0248	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0249	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0250	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0251	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0252	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0253	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0254	Science Room 131	1087	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0255	Science Room 131	1087	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0256	Science Room 131	1087	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0257	Science Room 131	1087	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0258	Science Room 131	1087	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0259	Science Room 131	1087	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0260	Science Room 131	1087	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0261	Science Prep Room 135	1086	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use



# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0262	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0263	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0264	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0265	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0266	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0267	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0268	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0269	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0270	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0271	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0272	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0273	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0274	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0275	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0276	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0277	Science Room 133	1082	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0278	Science Room 133 Storage	1082A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0279	Science Room 133 Storage	1082A	Water Fountain-No Chiller	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0280	1st Floor New Construction Girls Gang Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0281	1st Floor New Construction Girls Gang Bathroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0284	Room 144	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0285	Custodial Closet in New Wing	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0286	1st Floor New Construction Mens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0287	1st Floor New Construction Womens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0288	Home Economics Room 140	New Construct	Home Economics Faucet (Cold)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0289	Home Economics Room 140	New Construct	Home Economics Faucet (Cold)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0290	Home Economics Room 140	New Construct	Home Economics Faucet (Cold)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0291	Home Economics Room 140	New Construct	Home Economics Faucet (Cold)	Potable	6/8/2024	1.0			Result Below Action Level Continue O&M
EIUFSD-0292	Home Economics Room 140	New Construct	Home Economics Faucet (Cold)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0293	Home Economics Room 140	New Construct	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0294	Auto Shop	1020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0295	Auto Shop	1020	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0298	Auto Shop	1020	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0302	Room 130	1018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0303	Room 132	1017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0304	Home Economics Room 134	1016	Home Economics Faucet (Cold)	Potable	6/8/2024	6.5			Removed From Service, Pending Remediation
EIUFSD-0305	Home Economics Room 134	1016	Home Economics Faucet (Cold)	Potable	6/8/2024	5.0			Result Below Action Level Continue O&M
EIUFSD-0306	Home Economics Room 134	1016	Spray Nozzle	Non-Applicable	6/8/2024	16.4			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-0307	Home Economics Room 134	1016	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0308	Home Economics Room 134	1016	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0309	Room 134B Training Room	1015B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0315	1st Floor Corridor Gym Lobby to Little Theater (Near	1022	Water Fountain-No Chiller	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0316	1st Floor Corridor Gym Lobby to Little Theater (Near	1022	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0317	1st Floor Corridor Gym Lobby to Little Theater (Near	1022	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0318	Custodial Closet	1012A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0325	Room 210	2056	Bottled Water Dispenser (Cold)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0328	Faculty Lounge	2051A	Kitchen Faucet (Cold)	Non-Potable	6/8/2024	1.4			Result Below Action Level Continue O&M
EIUFSD-0335	2nd Floor Corridor Room 200 to Room 244 (Across Room	2062	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0336	2nd Floor Corridor Room 200 to Room 244 (Across Room	2062	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0341	Custodial Closet	2045	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0342	2nd Floor New Construction Corridor (Across Room 250)	New Construct	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0343	2nd Floor New Construction Corridor (Across Room 250)	New Construct	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0344	2nd Floor New Construction Corridor (Across Room 250)	New Construct	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0345	1st Floor New Construction Boys Gang Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0346	1st Floor New Construction Boys Gang Bathroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0347	2nd Floor New Construction Womens' Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0348	2nd Floor New Construction Mens' Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0349	Custodial Closet in New Wing	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0353	2nd Floor New Construction Boys Gang Bathroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0355	2nd Floor New Construction Girls Gang Bathroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0356	Custodial Closet	2013	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0361	2nd Floor Corridor Room 201 to Room 245 (Across Room	2063	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0362	2nd Floor Corridor Room 201 to Room 245 (Across Room	2063	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0363	2nd Floor Corridor Room 201 to Room 245 (Across Room	2063	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-0368	Room 219	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0369	Room 211	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0370	Room 211	2004	Bottled Water Dispenser (Hot)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0371	Room 211	2004	Bottled Water Dispenser (Cold)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0374	Exterior Courtyard (Near Room 104 - 1055)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0375	Exterior Courtyard (Director of Careers's Office - 1048B)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0379	Exterior Courtyard by New Construction	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0381	Exterior (Near Team Lockers - New Construction)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0382	Exterior (Outside Home Economics Room 140 - New	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0383	Exterior (Near Science Room 129 - 1088)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0384	Exterior (Outside Science Room 117 - 1094)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0386	Exterior (Near Science Room 103 - 1107)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0389	Exterior (Outside Main Lobby - 1038)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0390	Exterior (Near Auditorium - 1035)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1399	Kitchen	1006	Spray Nozzle	Non-Applicable	6/8/2024	19.4			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-1401	1st Floor New Construction Corridor (Across Room 152)	New Construct	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1402	1st Floor Girls Bathroom (Across Office 114A)	1065A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1403	1st Floor Girls Bathroom (Across Office 114A)	1065A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1404	1st Floor Girls Bathroom (Across Office 114A)	1065A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1405	1st Floor Girls Bathroom (Across Office 114A)	1065A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1406	1st Floor Girls Bathroom (Across Office 114A)	1065A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1407	1st Floor Boys Bathroom (Across Office 114A)	1064A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1408	1st Floor Boys Bathroom (Across Office 114A)	1064A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1409	1st Floor Boys Bathroom (Across Office 114A)	1064A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1410	1st Floor Boys Bathroom (Across Office 114A)	1064A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1411	1st Floor Boys Bathroom (Across Office 114A)	1064A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1414	2nd Floor New Construction Corridor (Across Room 274)	New Construct	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1415	2nd Floor New Construction Corridor (Across Room 274)	New Construct	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1416	Room 210	2056	Bottled Water Dispenser (Hot)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1417	1st Floor Boys Bathroom (Across Office 114A)	2048B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1418	1st Floor Boys Bathroom (Across Office 114A)	2048B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1419	1st Floor Boys Bathroom (Across Office 114A)	2048B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1420	1st Floor Boys Bathroom (Across Office 114A)	2048B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1421	1st Floor Boys Bathroom (Across Office 114A)	2048B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1422	1st Floor Girls Bathroom (Across Office 114A)	2047A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1423	1st Floor Girls Bathroom (Across Office 114A)	2047A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1424	1st Floor Girls Bathroom (Across Office 114A)	2047A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1425	1st Floor Girls Bathroom (Across Office 114A)	2047A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1426	1st Floor Girls Bathroom (Across Office 114A)	2047A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1428	Kitchen	1006	Coffe Pot	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1429	Kitchen	1006	Pasta Pot/Steam Kettle	Potable	6/8/2024	14.2			Removed From Service, Pending Remediation
EIUFSD-1430	Kitchen Custodial Closet	1006H	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1431	Kitchen Ladies Bathroom	1006E	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1432	Kitchen Ladies Bathroom	1006E	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1433	Kitchen Ladies Bathroom	1006E	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1434	Music Offices	1024I	Bottled Water Dispenser (Hot)	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1435	Music Offices	1024I	Bottled Water Dispenser	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1436	Music Offices	1024I	Bottled Water Dispenser (Cold)	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1437	Custodial Closet	1031	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1438	Mens Bathroom	1040A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1439	Mens Bathroom	1040A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1440	Mens Bathroom	1040A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1441	Custodial Closet	1040B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1442	Womens Bathroom	1041C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1443	Womens Bathroom	1041C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1444	Womens Bathroom	1041C	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use



# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1445	Career Center	1049A	Bottled Water Dispenser	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1446	Career Center	1049A	Bottled Water Dispenser	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1447	Art Office	1054B	Ice Machine	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1448	Art Room 106	1056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1449	Art Room 106	1056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1450	Art Room 106	1056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1451	Art Room 106B	1058	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1452	Custodial Closet	1067	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1453	Cosmetology Room 120	1072	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1454	Science Room 101	1108	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1455	Science Room 101	1108	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1456	Science Room 103	1107	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1457	Science Room 105	1106	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1458	Room 111 Prep	1104A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1459	Science Room 111	1104	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1460	Science Room 111	1104	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1461	Science Room 107	1105	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1462	Science Room 107	1105	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1463	Science Room 109	1103	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1464	Science Room 113	1099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1465	Science Room 113	1099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1466	Science Room 113	1099	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1467	1st Floor Girls Bathroom in Science Wing	1097A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1468	1st Floor Girls Bathroom in Science Wing	1097A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1469	1st Floor Girls Bathroom in Science Wing	1097A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1470	1st Floor Girls Bathroom in Science Wing	1097A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1471	1st Floor Boys Bathroom in Science Wing	1096B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1472	1st Floor Boys Bathroom in Science Wing	1096B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1473	1st Floor Boys Bathroom in Science Wing	1096B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1474	1st Floor Boys Bathroom in Science Wing	1096B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1475	Custodial Closet	1095	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1476	Science Room 121	1094	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1477	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1478	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1479	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1480	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1481	Science Room 121	1093	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1482	Science Room 121	1093	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1483	Science Room 119	1092	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1484	Science Room 127	1090	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1485	Science Room 125	1089	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1486	Science Room 125	1089	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1487	Science Room 129	1088	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1488	Science Room 129	1088	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1489	Science Room 131	1087	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1490	Science Room 131	1087	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1491	Science Prep Room 135	1086	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1492	Science Prep Room 135	1086	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1493	Science Prep Room 135	1086	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1494	Science Prep Room 135	1086	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1495	Science Room 133	1082	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1496	1st Floor New Construction Corridor (Across Room 152)	New Construct	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1497	Back Wood Shop	1019C	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1498	Former Exterior Outlet (Now Inside New Construction Area)	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1499	Home Economics Room 134	1016	Bottle Fill Station	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1500	Home Economics Room 134	1016	Ice Machine	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1501	1st Floor Girls Bathroom (Near Cafeteria & Gym)	1013A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1502	1st Floor Girls Bathroom (Near Cafeteria & Gym)	1013A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1503	1st Floor Girls Bathroom (Near Cafeteria & Gym)	1013A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1504	1st Floor Girls Bathroom (Near Cafeteria & Gym)	1013A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1505	1st Floor Boys Bathroom (Near Cafeteria & Gym)	1012B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1506	1st Floor Boys Bathroom (Near Cafeteria & Gym)	1012B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1507	1st Floor Boys Bathroom (Near Cafeteria & Gym)	1012B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1508	1st Floor Boys Bathroom (Near Cafeteria & Gym)	1012B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1509	Boy's Locker Room Bathroom	1003A7	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1510	Boy's Locker Room Bathroom	1003A7	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1511	Boy's Locker Room Bathroom	1003A7	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1512	Boy's Locker Room Bathroom	1003A7	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1513	Boy's Locker Room Bathroom	1003A7	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1514	Boy's Locker Room	1003A	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1515	Boy's Locker Room	1003A	Bottle Fill Station	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1516	Boy's Locker Room	1003A	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1517	Boy's Locker Room Bathroom	1003A7	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1518	Boy's Locker Room Showers	1003A5	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1519	Boy's Locker Room Showers	1003A5	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1520	Boy's Locker Room Showers	1003A5	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1521	Boy's Locker Room Showers	1003A5	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1522	Boy's Locker Room Showers	1003A5	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1523	Boy's Locker Room Showers	1003A5	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1524	Boy's Locker Room Custodian Closet	1003A2	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1525	Boy's Locker Room Office Locker Area Bathroom	1003A1A 1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1526	Boy's Locker Room Office Locker Area Bathroom	1003A1A 1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1527	Wrestling Room	1003B1	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1528	Athletic Trainer Office	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1529	Girl's Locker Room	1003K	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1530	Girl's Locker Room Office Locker Area Bathroom	1003K2B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1531	Girl's Locker Room Office Locker Area Bathroom	1003K2B	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1532	Girl's Locker Room	1003K	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1533	Girl's Locker Room	1003K	Bottle Fill Station	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1534	Girl's Locker Room	1003K	Water Cooler	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1535	Girl's Locker Room Bathroom	1003K4	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1536	Girl's Locker Room Bathroom	1003K4	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1537	Girl's Locker Room Bathroom	1003K4	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1538	Girl's Locker Room Bathroom	1003K4	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1539	Girl's Locker Room Bathroom	1003K4	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1540	Girl's Locker Room Shower	1003K1	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1541	Girl's Locker Room Shower	1003K1	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1542	Girl's Locker Room Shower	1003K1	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1543	Girl's Locker Room Shower	1003K1	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1544	Girl's Locker Room Shower	1003K1	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use

# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1545	Girl's Locker Room Shower	1003K1	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1546	Girl's Locker Room Storage Adjacent Showers	1003K3	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1547	Custodian Bathroom	1000B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1548	Custodian Bathroom	1000B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1549	Receiving	1000	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1550	Boiler Room	1000E	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1551	Room 212A	2054	Bottled Water Dispenser (Hot)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1552	Room 212A	2054	Bottled Water Dispenser (Cold)	Potable	6/8/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1561	Faculty Lounge	2051A	Bottle Fill Station	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1562	Faculty Lounge	2051A	Ice Machine	Potable	6/8/2024	OOS			Testing Required Before Return to Service
EIUFSD-1563	2nd Floor Faculty Bathroom (Adjacent to Room 214)	2051C1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1564	2nd Floor Faculty Bathroom (Adjacent to Room 214)	2051C1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1565	2nd Floor Faculty Room Bathroom (In Boys Bathroom)	2048A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1566	2nd Floor Faculty Room Bathroom (In Boys Bathroom)	2048A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1567	2nd Floor Faculty Room Bathroom (In Boys Bathroom)	2048A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1568	2nd Floor New Construction Boys Gang Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1569	2nd Floor New Construction Girls Gang Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1570	2nd Floor Boys Bathroom (Across Room 221)	2012B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1571	2nd Floor Boys Bathroom (Across Room 221)	2012B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1572	2nd Floor Boys Bathroom (Across Room 221)	2012B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use



# East Islip High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1573	2nd Floor Boys Bathroom (Across Room 221)	2012B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1574	2nd Floor Girls Bathroom (Across Room 221)	2011A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1575	2nd Floor Girls Bathroom (Across Room 221)	2011A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1576	2nd Floor Girls Bathroom (Across Room 221)	2011A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1577	2nd Floor Girls Bathroom (Across Room 221)	2011A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1578	Exterior Courtyard (Outside Library - 1008)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1579	Exterior Courtyard (Near Assistant Principal Office)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1580	Exterior Courtyard (Outside Room 130 - 1018)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1581	Exterior Courtyard (Near Cafeteria - 1005)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1582	Exterior Courtyard (Near Science Room 119 - 1092)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1583	Exterior (Outside Receiving Area - 1000)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1584	Exterior (Near Science Room 101 - 1108)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1585	Exterior (Near Nurse's Office - 1053)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1586	Exterior (Outside Guidance Offices - 1049)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1587	Exterior (Outside Stage - 1035C)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1588	Exterior (Near Band Room - 1023)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1589	Exterior (Near Kitchen - 1006)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0395	Principal Office Vestibule Bathroom	1032B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0398	1st Floor Girls Gang Bathroom (Across Main Office)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0399	1st Floor Girls Gang Bathroom (Across Main Office)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0400	1st Floor Girls Gang Bathroom (Across Main Office)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0401	1st Floor Girls Gang Bathroom (Across Main Office)	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0402	1st Floor Boys Gang Bathroom (Across Main	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0403	1st Floor Boys Gang Bathroom (Across Main	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0404	1st Floor Boys Gang Bathroom (Across Main	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0405	1st Floor Boys Gang Bathroom (Across Main	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0408	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0410	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0411	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0412	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0413	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0415	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0416	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0417	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0418	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0419	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0420	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0421	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0422	Prep Room Between Room 125 & Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0423	Prep Room Between Room 125 & Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0428	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0431	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0436	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0437	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0438	1st Floor Science Wing Womens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0439	1st Floor Science Wing Womens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0440	1st Floor Science Wing Womens Faculty Bathroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0442	1st Floor Science Wing Mens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0443	1st Floor Science Wing Mens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0444	1st Floor Science Wing Mens Faculty Bathroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0447	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0448	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0450	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0451	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0452	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0453	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0454	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0456	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0457	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0458	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0459	Prep Room Between Room 129 & Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0460	Prep Room Between Room 129 & Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0461	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0463	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0465	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0467	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0469	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0471	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0474	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0475	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0477	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0479	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0481	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0482	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0484	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0485	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0488	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0489	Prep Room Between Room 131 & Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0492	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0493	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0494	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0495	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0496	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0498	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0500	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0501	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0503	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0504	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0505	Library Work Room 147C	New Construct	Kitchen Faucet (Cold)	Potable	6/15/2024	1.2			Result Below Action Level Continue O&M
EIUFSD-0506	Nurse's Room	1018	Bottled Water Dispenser (Hot)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0507	Nurse's Room	1018	Bottled Water Dispenser (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0508	Nurse's Room	1018	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0510	1st Floor Mens Faculty Bathroom (Across Room 111)	1014	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0511	1st Floor Mens Faculty Bathroom (Across Room 111)	1014	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0512	1st Floor Womens Faculty Bathroom (Across Room 111)	1013A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0513	1st Floor Womens Faculty Bathroom (Across Room 111)	1013A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0514	Custodial Closet	1012	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

# East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0519	Art Room Photo Lab	1010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0523	1st Floor Corridor Gym to Room 113 (Across Room 109 -	1019	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0525	Home Economics Room 102	1004	Home Economics Faucet (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0526	Home Economics Room 102	1004	Home Economics Faucet (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0527	Home Economics Room 102	1004	Home Economics Faucet (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0528	Home Economics Room 102	1004	Home Economics Faucet (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0529	Home Economics Room 102	1004	Home Economics Faucet (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0530	Home Economics Room 102	1004	Home Economics Faucet (Cold)	Potable	6/15/2024	2.6			Result Below Action Level Continue O&M
EIUFSD-0531	Home Economics Room 102 Back Storage	1004B	Home Economics Faucet (Cold)	Potable	6/15/2024	12.1			Removed From Service, Pending Remediation
EIUFSD-0532	Room 102 Prep Room Storage	1004B	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0533	Room 102 Prep Room Storage	1004B	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0534	Auxillary Gym Vestibule	1068A	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0535	Auxillary Gym Vestibule	1068A	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-0536	Weight Room	New Construct	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-0557	Kitchen	1056	Kitchen Faucet (Cold)	Potable	6/15/2024	59.8			Removed From Service, Pending Remediation
EIUFSD-0558	Kitchen	1056	Kitchen Faucet (Cold)	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-0559	Kitchen	1056	Kitchen Faucet (Cold)	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-0560	Kitchen	1056	Hand Wash Only	Non-Potable	6/15/2024	1.9			Result Below Action Level Continue O&M
EIUFSD-0561	Kitchen	1056	Kitchen Faucet (Cold)	Non-Potable	6/15/2024	4.4			Result Below Action Level Continue O&M
EIUFSD-0562	Kitchen	1056	Kitchen Faucet (Cold)	Non-Potable	6/15/2024	9.4			Placarded for Non-Drinking Use Until Remediated

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0563	Kitchen	1056	Kitchen Faucet (Cold)	Non-Potable	6/15/2024	2.5			Result Below Action Level Continue O&M
EIUFSD-0564	Kitchen	1056	Kitchen Faucet (Cold)	Potable	6/15/2024	4.3			Result Below Action Level Continue O&M
EIUFSD-0565	Cafeteria Office	1057A	Kitchen Faucet (Cold)	Non-Potable	6/15/2024	2.2			Result Below Action Level Continue O&M
EIUFSD-0570	North Dining	1054	Hand Wash Only	Non-Potable	6/15/2024	4.0			Result Below Action Level Continue O&M
EIUFSD-0571	North Dining	1054	Hand Wash Only	Non-Applicable	6/15/2024	6.5			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-0572	North Dining	1054	Kitchen Faucet (Cold)	Non-Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0573	North Dining	1054	Hand Wash Only	Non-Potable	6/15/2024	1.5			Result Below Action Level Continue O&M
EIUFSD-0574	North Dining	1054	Kitchen Faucet (Cold)	Non-Potable	6/15/2024	2.6			Result Below Action Level Continue O&M
EIUFSD-0577	1st Floor Corridor (Across North Dining; Cafeteria - 1054)	1058	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0578	1st Floor Corridor (Across North Dining; Cafeteria - 1054)	1058	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-0583	Custodial Closet	1051	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0584	Custodial Receiving Area/Vestibule	1050	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0585	Custodial Receiving Area/Vestibule	1050	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0586	Custodial Receiving Area/Vestibule	1050	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0587	Custodial Receiving Area/Vestibule	1050	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0588	Technology Room 114	1048	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0589	Technology Room 114	1048	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0592	Custodial Closet	1044	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0593	Band Room M1	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0594	Orchestra Room M4	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use



## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0595	Woodshop Room 120	1041	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0596	Woodshop Room 118	1040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0599	1st Floor Corridor (Across Auditorium - 1034)	1058	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-0600	1st Floor Corridor (Across Auditorium - 1034)	1058	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-0601	Support Center Guidance Vestibule	1027	Kitchen Faucet (Cold)	Non-Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0602	Faculty Lounge	1022	Kitchen Faucet (Cold)	Non-Potable	6/15/2024	1.4			Result Below Action Level Continue O&M
EIUFSD-0607	2nd Floor Girls Gang Bathroom (Across Room 220)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0608	2nd Floor Girls Gang Bathroom (Across Room 220)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0609	2nd Floor Girls Gang Bathroom (Across Room 220)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0610	2nd Floor Girls Gang Bathroom (Across Room 220)	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0611	2nd Floor Boys Gang Bathroom (Across Room 220)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0612	2nd Floor Boys Gang Bathroom (Across Room 220)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0613	2nd Floor Boys Gang Bathroom (Across Room 220)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0614	2nd Floor Boys Gang Bathroom (Across Room 220)	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0617	Home Economics Room 225	New Construct	Home Economics Faucet (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0618	Home Economics Room 225	New Construct	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0619	Home Economics Room 225	New Construct	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0620	2nd Floor Science Wing Womens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0621	2nd Floor Science Wing Womens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0622	2nd Floor Science Wing Womens Faculty Bathroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0624	2nd Floor Science Wing Mens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0625	2nd Floor Science Wing Mens Faculty Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0626	2nd Floor Science Wing Mens Faculty Bathroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0627	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0628	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0629	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0630	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0631	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0632	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0634	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0635	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0636	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0637	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0638	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0639	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0640	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0642	Prep Room Between Room 229 & Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0643	Science Room 209 Storage	2011A	Bottled Water Dispenser (Hot)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0644	Science Room 209 Storage	2011A	Bottled Water Dispenser	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0645	Science Room 209 Storage	2011A	Bottled Water Dispenser (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0646	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0647	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0648	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0649	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0650	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0652	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0653	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0654	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0656	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0657	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0658	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0659	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0660	Art Room 231	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0661	Art Room 231	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0662	Art Room 231	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0663	Art Room 231	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0664	Art Room 231	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0665	Art Room 235	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0666	Art Room 235	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0667	Art Room 235	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0668	Art Room 235	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0669	Art Room 235	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0670	Science Room 211	2015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0671	Science Room 211	2015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0672	Science Room 211	2015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0673	Science Room 211 Storage	2011A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0674	Science Room 209	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0675	Science Room 209	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0676	Science Room 209	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0677	2nd Floor Mens Faculty Bathroom (Across Science	2014	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0678	2nd Floor Mens Faculty Bathroom (Across Science	2014	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0679	2nd Floor Womens Faculty Bathroom (Across Science	2013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0680	2nd Floor Womens Faculty Bathroom (Across Science	2013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0681	Custodial Closet	2012	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0690	2nd Floor Corridor Room 211 to Room 201 (Across Room	2016	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-0691	Science Room 207	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0692	Science Room 207	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0693	Science Room 207	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0694	Science Room 207 Prep Room	2008A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0695	Exterior Courtyard (Near Nurse's Office - 1018)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0696	Exterior Courtyard (On Science Wing Side; Near	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0697	Exterior Courtyard (On Science Wing Side; Near	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0698	Field House Men's Restroom	3001	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0699	Field House Women's Restroom	3000	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0701	Exterior (Near Custodial Receiving Area/Vestibule -	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0703	Exterior (Near Orchestra Room M1)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0704	Exterior (Near Music/Chrous Room - 1042F)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0705	Exterior (Near Auditorium - 1034)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0706	Exterior (On New Construction Side; Near Gang	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0707	Exterior (Near New Construction Room 130)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0708	Exterior (Near New Construction Room 128)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0709	Exterior (Outside Science Room 125)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0710	Exterior (Outside Science Room 131)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0711	Exterior (Outside Science Room 135)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0712	Exterior (Near Library/Media Center)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0715	Exterior (Near Auxiliary Gym & Girl's Team Locker Room)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0716	Exterior (Near Boy's Team Locker Room)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1366	1st Floor Boys Bathroom (Across North Dining;	1053B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1367	1st Floor Boys Bathroom (Across North Dining;	1053B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1368	1st Floor Boys Bathroom (Across North Dining;	1053B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1369	1st Floor Boys Bathroom (Across North Dining;	1053B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1370	1st Floor Girls Bathroom (Across North Dining;	1052A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1371	1st Floor Girls Bathroom (Across North Dining;	1052A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1372	1st Floor Girls Bathroom (Across North Dining;	1052A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1373	1st Floor Girls Bathroom (Across North Dining;	1052A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1374	1st Floor Corridor Gym To Room 113 (Across Room 109 -	1019	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-1375	1st Floor Girls Gang Bathroom (Across Room 109)	1009A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1376	1st Floor Girls Gang Bathroom (Across Room 109)	1009A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1377	1st Floor Girls Gang Bathroom (Across Room 109)	1009A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1378	1st Floor Girls Gang Bathroom (Across Room 109)	1009A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1379	1st Floor Boys Gang Bathroom (Across Room 109)	1011A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1382	1st Floor Boys Gang Bathroom (Across Room 109)	1011A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1383	1st Floor Corridor Room 130 to Main Office (Across Room	New Construct	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1384	1st Floor Corridor Room 130 to Main Office (Across Room	New Construct	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-1387	2nd Floor Science Wing Corridor (Across Room 225)	New Construct	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1388	2nd Floor Science Wing Corridor (Across Room 225)	New Construct	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-1389	2nd Floor Corridor Room 211 to Room 201 (Across Room	2016	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1390	2nd Floor Corridor Room 211 to Room 201 (Across Room	2016	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
EIUFSD-1391	2nd Floor Girls' Bathroom by Room 208	2009A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1392	2nd Floor Girls' Bathroom by Room 208	2009A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1393	2nd Floor Girls' Bathroom by Room 208	2009A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1394	2nd Floor Girls' Bathroom by Room 208	2009A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1398	2nd Floor Boys Gang Bathroom (Across Room 207)	2010A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1590	1st Floor Science Wing Corridor (Across Room 125)	New Construct	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1591	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1592	Science Room 125	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1593	Science Room 125	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1594	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1595	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1596	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1597	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1598	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1599	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1600	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1601	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1602	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1603	Science Room 127	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1604	Science Room 127	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1605	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1606	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use



## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1607	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1608	Science Room 129	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1609	Science Room 129	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1610	1st Floor Science Wing Custodial Closet	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1611	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1612	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1613	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1614	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1615	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1616	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1617	Science Room 133	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1618	Science Room 133	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1619	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1620	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1621	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1622	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1623	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1624	Science Room 131	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1625	Science Room 131	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1626	Prep Room Between Room 131 & Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1627	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1628	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1629	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1630	Science Room 135	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1631	Science Room 135	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1632	Nurse's Room Bathroom	1018A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1633	Nurse's Room Bathroom	1018A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1634	1st Floor Boys Gang Bathroom (Across Room 109)	1011A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1635	1st Floor Boys Gang Bathroom (Across Room 109)	1011A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1636	Cafeteria	1057	Bottle Fill Station	Potable	6/15/2024	4.0			Result Below Action Level Continue O&M
EIUFSD-1637	Kitchen Bathroom	1056F	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1638	Kitchen Custodian Closet	1056E	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1639	1st Floor Corridor (Across North Dining; Cafeteria - 1054)	1058	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1640	Faculty Lounge	1022	Bottled Water Dispenser (Hot)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1641	Faculty Lounge	1022	Bottled Water Dispenser (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1642	2nd Floor Corridor Room 230 to Room 220 (Across Room	New Construct	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1643	2nd Floor Science Wing Custodial Closet	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1644	Science Room 229	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1645	Science Room 229	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1646	Prep Room Between Room 229 & Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1647	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1648	Science Room 233	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1649	Science Room 233	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1650	Science Room 211	2015	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1651	Science Room 209	2011	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1652	Boys Bathroom	2010A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1653	Boys Bathroom	2010A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1654	Boys Bathroom	2010A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1655	Science Room 207	2008	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1656	Boys Locker Room Showers (Formerly Girls)	1064C	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1657	Boys Locker Room Showers (Formerly Girls)	1064C	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1658	Boys Locker Room Showers (Formerly Girls)	1064C	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1659	Boys Locker Room Showers (Formerly Girls)	1064C	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1660	Boys Locker Room Showers (Formerly Girls)	1064C	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1661	Boys Locker Room (Formerly Girls)	1064	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1662	Boys Locker Room (Formerly Girls)	1064	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1663	Boys Locker Room (Formerly Girls)	1064	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1664	Boys Locker Room Bathroom (Formerly Girls)	1064A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1665	Boys Locker Room Bathroom (Formerly Girls)	1064A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1666	Boys Locker Room Bathroom (Formerly Girls)	1064A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1667	Boys Locker Room Bathroom (Formerly Girls)	1064A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1668	Boys Locker Room Office Bathroom (Formerly Girls)	1064E1A	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1669	Boys Locker Room Office Bathroom (Formerly Girls)	1064E1A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1670	Girls Locker Room (Formerly Boys)	1063	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1671	Girls Locker Room (Formerly Boys)	1063	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1672	Girls Locker Room (Formerly Boys)	1063	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1673	Girls Locker Room Showers (Formerly Boys)	1063E	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1674	Girls Locker Room Showers (Formerly Boys)	1063E	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1675	Girls Locker Room Showers (Formerly Boys)	1063E	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1676	Girls Locker Room Showers (Formerly Boys)	1063E	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1677	Girls Locker Room Showers (Formerly Boys)	1063E	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1678	Girls Locker Room Showers (Formerly Boys)	1063E	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1679	Girls Locker Room Bathroom (Formerly Boys)	1063G	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1680	Girls Locker Room Bathroom (Formerly Boys)	1063G	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1681	Girls Locker Room Bathroom (Formerly Boys)	1063G	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1682	Girls Locker Room Bathroom (Formerly Boys)	1063G	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1683	Girls Locker Room Bathroom (Formerly Boys)	1063G	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1684	Girls Locker Room Coach's Office Bathroom	1063B	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1685	Girls Locker Room Coach's Office Bathroom	1063B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1686	Storage Room A (Across Girls Locker Room)	1060	Ice Machine	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M

## East Islip Middle School & Field House

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1687	Exterior Courtyard (Outside Boys Bathroom - 1053B)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1688	Exterior (Near Boiler Room - 1039)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1689	Exterior (Outside Room 111 - 1015)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1690	Exterior (Outside Room 103 - 1003)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1691	Field House Exterior (Near Womens Bathroom)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# Ruth C. Kinney Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0717	Old Art Room (Currently Storage)	0003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0718	Old Art Room (Currently Storage)	0003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0719	Library Office	New Construct	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0720	Library Office	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0721	1st Floor Custodial Closet (Near Library)	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0723	1st Floor Staff Bathroom (Near Library)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0724	Room 194/195	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0725	Room 194/195	New Construct	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0726	Room 194/195	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0727	Room 194/195	New Construct	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0728	1st Floor Bathroom (Across Room 9)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0729	Room 102	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0730	Room 102	New Construct	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0731	Room 102 Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0732	Faculty Room	1028	Kitchen Faucet (Cold)	Non-Potable	6/7/2024	1.3			Result Below Action Level Continue O&M
EIUFSD-0733	Room 105	1026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0734	Room 105	1026	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0735	Room 104	1027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0736	Room 104	1027	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0737	Room 107	1025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# Ruth C. Kinney Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0738	Room 107	1025	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0739	Room 106	1024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0740	Room 106	1024	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0741	Room 109	1022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0742	Room 109	1022	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0743	Room 108	1023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0744	Room 108	1023	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0745	Room 111	1021	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0746	Room 111	1021	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0747	Room 110	1020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0748	Room 110	1020	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0749	Room 112	1018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0750	Room 112	1018	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0751	Room 113	1017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0752	Room 113	1017	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0753	Room 114	1016	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0754	Room 114	1016	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0755	Nurse's Suite Office	1015B	Nurse's Office Sink	Potable	6/7/2024	1.8			Result Below Action Level Continue O&M
EIUFSD-0759	1st Floor Corridor Cafeteria Stage to Womens Bathroom	1008	Bottle Fill Station	Potable	6/7/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0760	1st Floor Corridor Cafeteria Stage to Womens Bathroom	1008	Water Cooler	Potable	6/7/2024	OOS			Testing Required Before Return to Service



# Ruth C. Kinney Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0761	1st Floor Corridor Cafeteria Stage to Womens Bathroom	1008	Bottle Fill Station	Potable	6/7/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0762	1st Floor Corridor Cafeteria Stage to Womens Bathroom	1008	Water Cooler	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0763	Mens Bathroom Vestibule Custodial Closet	1006A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0765	Kitchen	1001	Hand Wash Only	Non-Applicable	6/7/2024	685			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-0766	Kitchen	1001	Kitchen Faucet (Cold)	Non-Potable	6/7/2024	1.7			Result Below Action Level Continue O&M
EIUFSD-0767	Kitchen	1001	Kitchen Faucet (Cold)	Non-Potable	6/7/2024	5.0			Placarded for Non-Drinking Use Until Remediated
EIUFSD-0768	Kitchen	1001	Hand Wash Only	Non-Potable	6/7/2024	2.1			Result Below Action Level Continue O&M
EIUFSD-0771	Cafeteria	1000	Bottle Fill Station	Potable	6/7/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0772	Cafeteria	1000	Water Cooler	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0777	2nd Floor Bathroom (Inner Hallway Between Room 200	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0778	Art Room 201	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0779	Art Room 201	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0780	Art Room 201	New Construct	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0781	2nd Floor Main Corridor (Adjacent to Book Room -	2017	Bottle Fill Station	Potable	6/7/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0782	2nd Floor Main Corridor (Adjacent to Book Room -	2017	Water Cooler	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0783	Book Room (Formerly Storage Room)	2000	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0784	Room 203	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0785	Room 203	2002	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0786	Room 202	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0787	Room 202	2001	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service

# Ruth C. Kinney Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0788	Room 205	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0789	Room 205	2003	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0790	Room 204	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0791	Room 204	2004	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0792	Room 207	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0794	Room 206	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0795	Room 206	2006	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0796	Room 209	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0797	Room 209	2008	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0799	Room 208	2007	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0800	Room 210	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0801	Room 210	2009	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0802	Room 211	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0803	Room 211	2010	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0804	Room 212	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0805	Room 212	2011	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0806	Room 213	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0807	Room 213	2012	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-0808	Room 214	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0809	Room 214	2013	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service

# Ruth C. Kinney Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0810	Science Lab 215	2014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0811	Science Lab 215	2014	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0812	Science Lab 215	2014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0813	Science Lab 215 Prep Room	2014B	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0814	Science Lab 215 Bathroom	2014A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0815	Custodial Closet	2015	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0817	Exterior (Outside Boiler Room - 1003B)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0818	Exterior (Near Cafeteria - 1000)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0820	Exterior (Near Boy's Locker Room - 1002A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0821	Exterior (Near Room 13 -New Construcion)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1341	New Mens Faculty Bathroom (Former Boys LR Bathroom)	1002A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1342	New Mens Faculty Bathroom (Former Boys LR Bathroom)	1002A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1343	New Mens Faculty Bathroom (Former Boys LR Bathroom)	1002A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1344	New Mens Faculty Bathroom (Former Boys LR Bathroom)	1002A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1345	New Womens Faculty Bathroom (Former Girls LR	1002D1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1346	New Womens Faculty Bathroom (Former Girls LR	1002D1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1347	New Womens Faculty Bathroom (Former Girls LR	1002D1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1348	New Womens Faculty Bathroom (Former Girls LR	1002D1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1349	1st Floor Corridor Library to Room 13 (Across Room 194)	New Construct	Bottle Fill Station	Potable	6/7/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1350	1st Floor Corridor Library to Room 13 (Across Room 194)	New Construct	Water Cooler	Potable	6/7/2024	OOS			Testing Required Before Return to Service

# Ruth C. Kinney Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1692	Room 107 Bathroom	1025A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1693	Room 107 Bathroom	1025A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1694	Room 106 Bathroom	1024A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1695	Room 106 Bathroom	1024A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1696	Room 111 Bathroom	1021A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1697	Room 111 Bathroom	1021A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1698	Room 110 Bathroom	1020A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1699	Room 110 Bathroom	1020A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1700	Room 114 Bathroom	1016A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1701	Room 114 Bathroom	1016A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1702	Nurse's Suite Office Bathroom	1015B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1703	Conference Room	1012	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1704	1st Floor Girls Bathroom (Near Main Office)	1007B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1705	1st Floor Girls Bathroom (Near Main Office)	1007B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1706	1st Floor Girls Bathroom (Near Main Office)	1007B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1707	1st Floor Boys Bathroom (Near Main Office)	1006B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1708	1st Floor Boys Bathroom (Near Main Office)	1006B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1709	1st Floor Boys Bathroom (Near Main Office)	1006B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1710	Room 205 Bathroom	2002A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1711	Room 205 Bathroom	2002A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

## Ruth C. Kinney Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1712	Room 202 Bathroom	2001A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1713	Room 202 Bathroom	2001A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1714	Room 207	2005	Water Fountain-No Chiller	Potable	6/7/2024	OOS			Testing Required Before Return to Service
EIUFSD-1715	Room 207 Bathroom	2005A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1716	Room 207 Bathroom	2005A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1717	Room 206 Bathroom	2006A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1718	Room 206 Bathroom	2006A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1719	Room 208	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1720	Room 210 Bathroom	2009A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1721	Room 210 Bathroom	2009A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1722	Room 211 Bathroom	2010A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1723	Room 211 Bathroom	2010A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1724	xterior (Near Corridor Cafeteria Stage to Women's	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1725	Exterior (Near Girls Locker Room - 1002D)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1726	Exterior (Near Library/Media Center - New Construction)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1727	Exterior (Adjacent to Main Lobby Exit Vestibule - 1009A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

## Early Childhood Center & Administration

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0830	Boiler Room	0005	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0831	Room 133	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0832	Room 133	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0833	Room 134	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0834	Room 134	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	2.5			Result Below Action Level Continue O&M
EIUFSD-0835	Room 132	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0836	Room 132	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0837	Room 131	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0838	Room 131	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	3.0			Result Below Action Level Continue O&M
EIUFSD-0839	South Shore Childcare Side Restroom (Between Rooms)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0840	Room 130	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0841	Room 130	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0842	Room 128	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0843	Room 128	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0844	Room 127	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0845	Room 127	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0846	South Shore Side Custodial Closet	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0847	South Shore Childcare Side Restroom (Between Rooms)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0848	Room 126	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0849	Room 126	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	3.7			Result Below Action Level Continue O&M

## Early Childhood Center & Administration

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0850	Room 125	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0851	Room 125	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0852	Room 123	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0853	Room 123	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0854	Room 124	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0855	Room 124	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0856	Room 121	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0857	Room 121	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	1.2			Result Below Action Level Continue O&M
EIUFSD-0858	Room 122	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0859	Room 122	New Construct	Water Fountain-No Chiller	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0860	Exterior Courtyard (Outside Room 123 - South Shore	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0861	Exterior Courtyard (Near Room 125 - South Shore	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0863	Exterior Courtyard (Near Faculty Room - 1035)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0866	Room 112	1000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0867	Room 112	1000	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0868	Room 112 Bathroom	1000A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0869	Room 112 Bathroom	1000A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0870	Room 112 Bathroom	1000A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0871	Room 112 Bathroom	1000A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0872	Room 113	1001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use



## Early Childhood Center & Administration

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0873	Room 113	1001	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0874	Room 113 Bathroom	1001A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0875	Room 113 Bathroom	1001A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0876	Room 113 Bathroom	1001A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0877	Room 113 Bathroom	1001A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0878	Room 114	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0880	Room 114	1003	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0881	Room 114 Bathroom	1003A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0882	Room 114 Bathroom	1003A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0883	Room 114 Bathroom	1003A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0884	Room 114 Bathroom	1003A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0885	Room 115	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0886	Room 115	1004	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0887	Room 115 Cubby Bathroom	1004A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0888	Room 115 Cubby Bathroom	1004A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0889	Room 115 Cubby Bathroom	1004A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0890	Room 115 Cubby Bathroom	1004A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0892	CPSE Meeting Room	1009	Bottled Water Dispenser (Hot)	Potable	6/13/2024				Outlet Permanently Removed
EIUFSD-0893	CPSE Meeting Room	1009	Bottled Water Dispenser (Cold)	Potable	6/13/2024				Outlet Permanently Removed
EIUFSD-0894	Room 105	1030	Bottled Water Dispenser (Hot)	Potable	6/14/2024				Outlet Permanently Removed

## Early Childhood Center & Administration

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0895	Room 105	1030	Bottled Water Dispenser (Cold)	Potable	6/14/2024				Outlet Permanently Removed
EIUFSD-0896	CPSE Meeting Room Bathroom	1009A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0897	Custodial Office	1012	Bottled Water Dispenser (Hot)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0898	Custodial Office	1012	Bottled Water Dispenser (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0899	Custodial Office	1012	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0900	1st Floor Corridor Main Lobby to Outside Gym Music Room	1020	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0901	1st Floor Corridor Main Lobby to Outside Gym Music Room	1020	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0902	Cafeteria	1019	Water Cooler	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0903	Cafeteria	1019	Water Cooler	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0904	Kitchen	1019B	Pasta Pot/Steam Kettle	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0905	Kitchen	1019B	Hand Wash Only	Non-Potable	6/14/2024	65.3			Placarded for Non-Drinking Use Until Remediated
EIUFSD-0906	Kitchen	1019B	Kitchen Faucet (Cold)	Non-Potable	6/13/2024	32.7			Placarded for Non-Drinking Use Until Remediated
EIUFSD-0907	Kitchen	1019B	Kitchen Faucet (Cold)	Non-Potable	6/13/2024	64.9			Placarded for Non-Drinking Use Until Remediated
EIUFSD-0908	Kitchen	1019B	Hand Wash Only	Non-Potable	6/13/2024	51.0			Placarded for Non-Drinking Use Until Remediated
EIUFSD-0909	Kitchen	1019B	Kitchen Faucet (Cold)	Potable	6/13/2024	2.0			Result Below Action Level Continue O&M
EIUFSD-0911	Kitchen Custodial Closet	1019B2	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0912	Kitchen Bathroom	1019B3A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0913	Gym Teacher's Bathroom (Left)	1015C1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0914	Building & Grounds Shop Room (Old Locker Room)	1006	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0915	Former Boys Locker Room Bathroom	1006A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

## Early Childhood Center & Administration

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0916	Former Boys Locker Room Bathroom	1006A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0917	1st Floor Custodial Closet	1016	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0918	1st Floor Womens Bathroom (Near Gym)	1017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0919	1st Floor Womens Bathroom (Near Gym)	1017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0920	1st Floor Mens Bathroom (Near Gym)	1018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0921	1st Floor Mens Bathroom (Near Gym)	1018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0922	Room 111	1022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0923	Room 110 Computer Services	1024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0924	Room 110 Computer Services	1024	Bottled Water Dispenser (Hot)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0925	Room 110 Computer Services	1024	Bottled Water Dispenser (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0926	Personnel Room 108	1025	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0929	Room 107	1027	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0930	Room 107	1027	Bottled Water Dispenser (Hot)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0931	Room 107	1027	Bottled Water Dispenser (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0932	Room 106	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0933	Room 104	1032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0934	1st Floor Womens Faculty Bathroom (Across Room 103)	1036	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0935	Room 103	1034	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0936	Terrace Room (Faculty Room)	1035B	Kitchen Faucet (Cold)	Potable	6/13/2024	2.2			Result Below Action Level Continue O&M
EIUFSD-0938	Room 102	1038	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service

## Early Childhood Center & Administration

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0939	Room 101	1037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0940	Room 100	1039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0941	Room 109	1023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0942	Former Girls Locker Room Bathroom	1033C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0943	Former Girls Locker Room Bathroom	1033C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0944	Conference Room	2000B	Bottled Water Dispenser (Hot)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0945	Conference Room	2000B	Bottled Water Dispenser (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0946	2nd Floor Corridor (Adjacent Superintendent Inner)	2027	Water Cooler	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0947	Superintendent's Bathroom	2001B1B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0948	Conference Room A	2009A	Kitchen Faucet (Cold)	Potable	6/13/2024	3.4			Result Below Action Level Continue O&M
EIUFSD-0949	2nd Floor Custodial Closet	2013A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0954	2nd Floor Corridor (Across Administration Reception -	2027	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0955	2nd Floor Corridor (Across Administration Reception -	2027	Bottled Water Dispenser	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0956	2nd Floor Corridor (Across Administration Reception -	2027	Water Cooler	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0957	2nd Floor Corridor (Adjacent Math and Science	2027	Water Cooler	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-0963	Buildings & Grounds Office	2017A	Bottled Water Dispenser	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0966	Break Room	2022A	Bottled Water Dispenser (Hot)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0967	Break Room	2022A	Bottled Water Dispenser (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0973	Exterior (Near Room 133 - South Shore Childcare Side)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0974	Exterior (Near Room 134 - South Shore Childcare Side)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

## Early Childhood Center & Administration

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0975	Exterior (Near Room 130 - South Shore Childcare Side)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0976	Exterior (Near Room 128 - South Shore Childcare Side)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0977	Exterior (Near Room 122 - South Shore Childcare Side)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1337	Room 132	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1338	Gym Teacher's Bathroom (Right)	1015B2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1339	Tech Services	1026	Bottled Water Dispenser (Hot)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1340	Tech Services	1026	Bottled Water Dispenser (Cold)	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1728	Room 131 Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1729	Office in Lobby	New Construct	Bottled Water Dispenser	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1730	Office in Lobby	New Construct	Bottled Water Dispenser	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1731	Room 114	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1732	Nurses Room	1005	Bottled Water Dispenser	Potable	6/13/2024				Outlet Permanently Removed
EIUFSD-1733	Nurses Room	1005	Bottled Water Dispenser	Potable	6/13/2024				Outlet Permanently Removed
EIUFSD-1734	Nurses Room Bathroom	1005B2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1735	Old Girls Locker Room	1033	Water Fountain-No Chiller	Potable	6/13/2024	OOS			Testing Required Before Return to Service
EIUFSD-1736	Room 109	1023	Bottled Water Dispenser	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1737	Room 109	1023	Bottled Water Dispenser	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1738	Room 105	1030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1739	Room 102	1038	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1740	Superintendents Bathroom	2001B1B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

## Early Childhood Center & Administration

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1741	2nd Floor Mens Bathroom	2013B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1742	2nd Floor Mens Bathroom	2013B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1743	2nd Floor Mens Bathroom	2013B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1744	2nd Floor Mens Bathroom	2013B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1745	2nd Floor Mens Bathroom	2013B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1746	2nd Floor Womens Bathroom	2014A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1747	2nd Floor Womens Bathroom	2014A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1748	2nd Floor Womens Bathroom	2014A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1749	2nd Floor Womens Bathroom	2014A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1750	2nd Floor Womens Bathroom	2014A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1751	Lunch Room	2018A	Kitchen Faucet (Cold)	Potable	6/13/2024	1.7			Result Below Action Level Continue O&M
EIUFSD-1752	Lunch Room	2018A	Spray Nozzle	Non-Potable	6/13/2024	1.2			Result Below Action Level Continue O&M
EIUFSD-1753	Special Education Side Office	2021E	Bottled Water Dispenser	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1754	Exterior Courtyard (Near Room 115 - 1004)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1755	Exterior (Near Room 110 - 1024)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1756	Exterior (Outside Room 111 - 1022)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1757	Exterior (Near Cafeteria - 1019)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1758	Exterior (Near Custodial Office - 1012)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1759	Exterior (Outside CPSE Meeting Room - 1009)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1760	Exterior (Outside Room 115 - 1003)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

## Early Childhood Center & Administration

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1761	Exterior (Near Office Room 135 - South Shore Childcare)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1762	Exterior (Outside Special Education Room 101 - 1037)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1763	Exterior (Outside Room 105 - 1030)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1764	Exterior (Outside Room 107 - 1027)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1765	New Field House Exterior	New Construct	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1766	New Field House Exterior	New Construct	Bottle Fill Station	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1767	New Field House Exterior	New Construct	Water Cooler	Potable	6/13/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1768	New Field House Mens' Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1769	New Field House Mens' Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1770	New Field House Men's Bathroom Custodial	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1771	New Field House Womens' Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1772	New Field House Womens' Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1773	New Field House Exterior	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use



Grounds Garage

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFS-0828	Exterior (Near Electrical Room - 1003)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-0829	Exterior (Near Wood Working Area - 1006)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# Connetquot Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-0981	Library Office	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0982	Room 134 (All Purpose Room)	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0983	Room 134 (All Purpose Room)	New Construct	Water Fountain-No Chiller	Potable	6/14/2024	5.0			Result Below Action Level Continue O&M
EIUFSD-0984	New Construction Custodial Closet	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0993	New Construction Boys Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0994	New Construction Boys Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0995	Corridor New Construction Bathrooms to Library (Across	New Construct	Bottle Fill Station	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-0996	Corridor New Construction Bathrooms to Library (Across	New Construct	Water Cooler	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-0997	New Construction Girls Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0998	New Construction Girls Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-0999	Gym Girls Bathroom	1009C2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1000	Gym Boys Bathroom	1009B2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1001	Room 125	1002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1002	Room 124	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1003	Cafeteria	1000	Bottle Fill Station	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1004	Cafeteria	1000	Water Cooler	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1005	Kitchen	1000C	Kitchen Faucet (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1006	Kitchen	1000C	Kitchen Faucet (Cold)	Potable	6/14/2024	1.2			Result Below Action Level Continue O&M
EIUFSD-1007	Kitchen	1000C	Hand Wash Only	Non-Applicable	6/14/2024	11.1			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-1008	Kitchen	1000C	Kitchen Faucet (Cold)	Potable	6/14/2024	2.9			Result Below Action Level Continue O&M

# Connetquot Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1009	Kitchen	1000C	Pasta Pot/Steam Kettle	Potable	6/14/2024	62.2			Removed From Service, Pending Remediation
EIUFSD-1010	Room 123A	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1011	Nurse's General Office	1007	Nurse's Office Sink	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1015	Boy's Bathroom Vestibule Custodian Closet	1006B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1016	Corridor Room 102 to Nurse's Office (Adjacent to Girl's	1018A	Water Cooler	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1017	Corridor Room 102 to Nurse's Office (Adjacent to Girl's	1018A	Bottle Fill Station	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1018	Corridor Room 102 to Nurse's Office (Adjacent to Girl's	1018A	Water Cooler	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1022	Room 113	1036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1023	Room 114	1035	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1024	Room 115	1037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1025	Room 116	1038	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1026	Room 117	1039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1027	Room 118	1040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1028	Room 100	1015	Bottled Water Dispenser (Hot)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1029	Room 100	1015	Bottled Water Dispenser (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1032	Custodian Closet S-3	1042	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1033	Corridor Room 122 to Women's Bathroom (Across	1049	Water Cooler	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1034	Corridor Room 122 to Women's Bathroom (Across	1049	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1038	Room 119	1045	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1039	Room 120	1046	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# Connetquot Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1040	Room 121	1047	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1042	Nurse's General Office	1007	Bottled Water Dispenser (Hot)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1043	Nurse's General Office	1007	Bottled Water Dispenser (Cold)	Potable	6/14/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1044	Room 123 (Former Library)	1005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1045	Room 123 (Former Library)	1005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1046	Kindergarten 1 Special Ed	1017A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1047	Kindergarten 1 Special Ed	1017A	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1049	Art Room	1016	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1051	Room 101	1014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1052	Room 100	1015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1053	Room 100	1015	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1054	Faculty Copy Room	1013	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1055	Room 102	1012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1056	Room 102	1012	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1058	Custodial Closet	1019A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1060	Room 104	1022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1061	Room 104	1022	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1062	Room 103	1023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1063	Room 103	1023	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1064	Room 105	1024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# Connetquot Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1065	Room 105	1024	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1066	Room 106	1025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1067	Room 106	1025	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1068	Room 108	1026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1069	Room 108	1026	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1070	Room 107	1027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1071	Room 107	1027	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1072	Room 109	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1073	Room 109	1028	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1075	Room 110	1029	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1076	Room 112	1030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1077	Room 112	1030	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1078	Room 111	1031	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1079	Room 111	1031	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1080	Exterior (Outside Boiler Room - 1001)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1083	Exterior (Near Girl's Bathroom [Across Custodial	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1084	Exterior (Near Room 133 - New Construction)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1085	Exterior (Near Library - New Construction)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1086	Exterior (Outside Room 111 - 1031)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1088	Exterior (Near Art Room - 1016)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# Connetquot Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1089	Exterior (Near Rom 101 - 1014)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1090	Exterior (Outside Science Room 123 - 1005)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1332	Room 102	1012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1333	Room 101	1014	Water Fountain-No Chiller	Potable	6/14/2024	OOS			Testing Required Before Return to Service
EIUFSD-1334	Room 100	1015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1818	Nurse's Bathroom	1007B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1819	Nurse's Bathroom	1007B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1820	Boys Bathroom (Across Science Room 123)	1006A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1821	Boys Bathroom (Across Science Room 123)	1006A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1822	Boys Bathroom (Across Science Room 123)	1006A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1823	Boys Bathroom (Across Science Room 123)	1006A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1824	Girls Bathroom (Adjacent to Room 113)	1034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1825	Girls Bathroom (Adjacent to Room 113)	1034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1826	Girls Bathroom (Adjacent to Room 113)	1034	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1827	Boys Bathroom (Across Custodial Office/Garage)	1041	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1828	Boys Bathroom (Across Custodial Office/Garage)	1041	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1829	Boys Bathroom (Across Custodial Office/Garage)	1041	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1830	Girls Bathroom (Across Custodial Office/Garage)	1044	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1831	Girls Bathroom (Across Custodial Office/Garage)	1044	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1832	Girls Bathroom (Across Custodial Office/Garage)	1044	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# Connetquot Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1833	Girls Bathroom (Across Custodial Office/Garage)	1044	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1834	Room 122	1048	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1835	Kindergarten 1 Bathroom	1017A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1836	Art Room Bathroom	1016B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1837	Room 102 Left Bathroom	1012A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1838	Room 102 Left Bathroom	1012A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1839	Mens Bathroom (Adjacent to Room 104)	1019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1840	Mens Bathroom (Adjacent to Room 104)	1019	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1841	Womens Bathroom (Adjacent to Room 104)	1021	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1842	Womens Bathroom (Adjacent to Room 104)	1021	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1843	Room 106 Bathroom	1022A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1844	Room 106 Bathroom	1022A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1845	Room 105 Bathroom	1023A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1846	Room 105 Bathroom	1023A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1847	Room 111 Bathroom	1028A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1848	Room 111 Bathroom	1028A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1849	Room 110	1029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1850	Room 110 Bathroom	1029A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1851	Room 110 Bathroom	1029A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1852	Exterior (Near Custodial Office/Garage - 1043)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use



# Connetquot Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFS-1853	Exterior (Near Room 122 - 1048)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1854	Exterior (Near Room 106 - 1025)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1855	Exterior (Near Cafeteria - 1000)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# Timber Point Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1092	Custodial Garage	1023	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1093	Room 112	1025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1094	Room 112	1025	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1095	Room 111	1021	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1096	Room 111	1021	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1097	Room 110	1020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1098	Room 110	1020	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1099	Room 109	1018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1100	Room 109	1018	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1101	Room 108	1016	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1102	Room 108	1016	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1103	Room 107	1015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1104	Room 107	1015	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1105	Custodian Closet C-2	1014	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1106	All Purpose Room	1010	Kitchen Faucet (Cold)	Non-Potable	6/11/2024	3.0			Result Below Action Level Continue O&M
EIUFSD-1107	All Purpose Room	1010	Spray Nozzle	Non-Applicable	6/11/2024	10.4			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-1109	Room 106	1009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1110	Room 106	1009	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1111	Room 105	1008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1112	Room 105	1008	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service

# Timber Point Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1113	Room 104	1007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1114	Room 104	1007	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1115	Room 103	1006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1116	Room 103	1006	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1117	Room 102	1005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1118	Room 102	1005	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1119	Room 101	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1120	Room 101	1004	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1121	Room 100	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1122	Room 100	1003	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1123	Room 96 Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1124	Room 94 Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1125	Community Center	New Construct	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1126	Community Center	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1127	New Construction Boy's Bathroom (Across Community	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1128	New Construction Boy's Bathroom (Across Community	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1129	New Construction Boy's Bathroom (Across Community	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1130	New Construction Girl's Bathroom (Across Community	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1131	New Construction Girl's Bathroom (Across Community	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1132	New Construction Girl's Bathroom (Across Community	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# Timber Point Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1133	Library Office	New Construct	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1134	Library Office	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1136	New Construction Staff Bathroom 1 (Near Library)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1137	New Construction Staff Bathroom 2 (Near Library)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1138	Music Room (Formerly Kindergarten Room 88)	1047	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1142	Art Room (Formerly Kindergarten Room 89)	1046	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1143	Art Room (Formerly Kindergarten Room 89)	1046	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1146	Nurse's Suite Office	1045A	Nurse's Office Sink	Potable	6/11/2024	2.4			Result Below Action Level Continue O&M
EIUFSD-1148	Gym Office (Right) Bathroom	1033C1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1149	Custodial Closet C-1	1042	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1150	Main Office Principal's Bathroom	1039B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1151	1st Floor Corridor Lobby To Storage (Across Counselor's	1038	Water Cooler	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1152	1st Floor Corridor Lobby To Storage (Across Counselor's	1038	Bottle Fill Station	Potable	6/11/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1153	1st Floor Corridor Lobby To Storage (Across Counselor's	1038	Water Cooler	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1154	Gym Office (Left) Bathroom	1033A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1157	Kitchen	1032	Kitchen Faucet (Cold)	Potable	6/11/2024	15.5			Removed From Service, Pending Remediation
EIUFSD-1158	Kitchen	1032	Pasta Pot/Steam Kettle	Potable	6/11/2024	45.5			Removed From Service, Pending Remediation
EIUFSD-1159	Kitchen	1032	Kitchen Faucet (Cold)	Non-Potable	6/11/2024	3.9			Result Below Action Level Continue O&M
EIUFSD-1160	Kitchen	1032	Kitchen Non Potable	Non-Applicable	6/11/2024	9.3			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-1161	Kitchen	1032	Kitchen Non Potable	Non-Applicable	6/11/2024	15.7			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use

# Timber Point Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1162	Kitchen	1032	Hand Wash Only	Non-Applicable	6/11/2024	17.0			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-1163	Kitchen Bathroom	10320	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1164	Kitchen Custodian Closet	1032D	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1165	Kitchen Storage	1032C	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1166	Kitchen Storage	1032C	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1168	1st Floor Mens Faculty Bathroom	1028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1169	1st Floor Mens Faculty Bathroom	1028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1170	1st Floor Womens Faculty Bathroom	1029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1171	1st Floor Womens Faculty Bathroom	1029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1173	Room 211	2026	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1174	Room 212	2025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1175	Room 212	2025	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1176	Room 210	2024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1177	Room 210	2024	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1178	Room 209	2023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1179	Room 209	2023	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1180	2nd Floor Custodian Closet C-4	2021	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1181	Room 208	2022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1182	Room 208	2022	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1183	Room 207	2019	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# Timber Point Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1184	Room 207	2019	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1185	S-14 Teachers Room	2018	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1186	Room 206	2016	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1187	Room 206	2016	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1188	Room 205	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1189	Room 205	2013	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1190	2nd Floor Corridor (Across Room 204 - 2006)	2027	Bottle Fill Station	Potable	6/11/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1193	Room 204	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1194	Room 204	2006	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1195	Room 203	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1196	Room 203	2005	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1197	Room 200A	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1198	Room 200A	2002	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1199	Room 202	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1200	Room 202	2003	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1201	Room 201	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1202	Room 201	2001	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1204	Room 200	2000	Water Fountain-No Chiller	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1205	Science Room 200B	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1206	Science Room 200B	2004	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use

# Timber Point Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1207	Science Room 200B	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1209	New Construction Custodial Closet	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1210	Exterior Courtyard (Near Room 100 - 1003)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1211	Exterior Courtyard (Near Art Room [Former Kindergarden	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1212	Exterior (Outside Custodian Garage - 1023)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1213	Exterior (Near Room 108 - 1016)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1214	Exterior (Outside Room 106 - 1009)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1216	Exterior (Near Room 98 - New Construction)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1217	Exterior (Near Music Room [Former Kindergarden Room	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1219	Exterior (Near Kitchen - 1032)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1327	1st Floor New Construction Library to Room 98 (Across	New Construct	Bottle Fill Station	Potable	6/11/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1328	1st Floor New Construction Library to Room 98 (Across	New Construct	Water Cooler	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1329	Auditorium/Cafeteria	1031	Bottle Fill Station	Potable	6/11/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1330	Auditorium/Cafeteria	1031	Water Cooler	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1331	Room 211	2026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1856	Room 210 Bathroom	2024A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1857	Room 210 Bathroom	2024A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1858	Room 209 Bathroom	2023A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1859	Room 209 Bathroom	2023A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1860	Room 207 Bathroom	2019A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use



# Timber Point Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1861	Room 207 Bathroom	2019A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1862	Room 205 Bathroom	2013A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1863	Room 205 Bathroom	2013A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1864	2nd Floor Faculty Bathroom 1	2009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1865	2nd Floor Faculty Bathroom 1	2009	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1866	2nd Floor Faculty Bathroom 2	2008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1867	2nd Floor Faculty Bathroom 2	2008	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1868	Room 203 Bathroom	2005A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1869	Room 203 Bathroom	2005A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1870	Science Room 200B Bathroom	2004A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1871	Room 200 Bathroom	2000A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1872	Room 200 Bathroom	2000A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1873	Room 200	2000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1874	Room 201 Bathroom	2001A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1875	Room 201 Bathroom	2001A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1876	Kindergarten Room 88 Cubby Room Bathroom	1047B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1877	Kindergarten Room 88 Cubby Room Bathroom	1047B1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1878	Art Room (Formerly Kindergarten Room 89) Cubby	1046B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1879	Art Room (Formerly Kindergarten Room 89) Cubby	1046B1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1880	Nurse's Suite	1045	Bottled Water Dispenser (Hot)	Potable	6/11/2024	<1.00 ND			Result Below Action Level Continue O&M

# Timber Point Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1881	Nurse's Suite	1045	Bottled Water Dispenser (Cold)	Potable	6/11/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1882	Nurse's Suite Office Bathroom (Formerly Closet)	1045A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1883	Nurse's Suite Office Bathroom (Formerly Closet)	1045A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1884	1st Floor Faculty Bathroom 1 (Formerly Showers)	1043A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1885	1st Floor Faculty Bathroom 1 (Formerly Showers)	1043A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1886	1st Floor Faculty Bathroom 2 (Formerly Showers)	1043A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1887	1st Floor Faculty Bathroom 2 (Formerly Showers)	1043A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1888	Kitchen	1032	Pasta Pot/Steam Kettle	Potable	6/11/2024	OOS			Testing Required Before Return to Service
EIUFSD-1889	Kitchen Rear Vestibule	1032A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1890	Kitchen Rear Vestibule	1032A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1891	Kitchen Rear Vestibule	1032A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1892	Kitchen Rear Vestibule	1032A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1893	1st Floor Womens Faculty Bathroom (Near Gym)	1029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1894	1st Floor Womens Faculty Bathroom (Near Gym)	1029	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1895	1st Floor Mens Faculty Bathroom (Near Gym)	1028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1896	1st Floor Mens Faculty Bathroom (Near Gym)	1028	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1897	Room 111 Bathroom	1021A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1898	Room 111 Bathroom	1021A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1899	Room 109 Bathroom	1018A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1900	Room 109 Bathroom	1018A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# Timber Point Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1901	Room 107 Bathroom	1015A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1902	Room 107 Bathroom	1015A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1903	All Purpose Room Bathroom	1010A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1904	All Purpose Room Bathroom	1010A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1905	Room 105/106 Bathroom	1008A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1906	Room 105/106 Bathroom	1008A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1907	Room 101/103 Bathroom	1004A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1908	Room 101/103 Bathroom	1004A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1909	Room 100/102 Bathroom	1003A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1910	Room 100/102 Bathroom	1003A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1911	Exterior (Outside Room 103 - 1006)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1912	Exterior (Outside Main Lobby Vestibule - 1037A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# John F. Kennedy Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1224	Cafeteria	1001	Bottle Fill Station	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1225	Cafeteria	1001	Water Cooler	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1226	Cafeteria Kitchen	1001C	Kitchen Faucet (Cold)	Non-Potable	6/12/2024	35.8			Placarded for Non-Drinking Use Until Remediated
EIUFSD-1227	Cafeteria Kitchen	1001C	Kitchen Faucet (Cold)	Non-Potable	6/12/2024	5.1			Placarded for Non-Drinking Use Until Remediated
EIUFSD-1228	Cafeteria Kitchen	1001C	Hand Wash Only	Non-Applicable	6/12/2024	6.2			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-1231	Cafeteria Kitchen	1001C	Pasta Pot/Steam Kettle	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1234	1st Floor Corridor Cafeteria to Women's Bathroom (Near	1007	Water Cooler	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1239	Nurse's Office	1015	Nurse's Office Sink	Potable	6/12/2024	4.2			Result Below Action Level Continue O&M
EIUFSD-1240	Room 114	1017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1241	Room 114	1017	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1242	Room 113	1018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1243	Room 113	1018	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1244	Room 112	1019	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1245	Room 112	1019	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1246	Faculty Room 111	1021	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1247	Faculty Room 111	1021	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1248	Room 110	1022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1249	Room 110	1022	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1251	Room 109	1023	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1252	Room 108	1024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# John F. Kennedy Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFS-1253	Room 108	1024	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFS-1254	Room 107	1025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1255	Room 107	1025	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFS-1256	Room 106	1026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1257	Room 106	1026	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFS-1258	Room 105	1027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1259	Room 105	1027	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFS-1260	Room 104	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1261	Room 104	1028	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFS-1262	Faculty Lounge (Custodial Office)	1029	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1263	Room 102	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1264	Room 102	New Construct	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFS-1265	Room 102 Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1266	Library Office	New Construct	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1267	Library Office	New Construct	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1268	New Construction Custodial Closet (Near Library)	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1270	Classroom Adjacent to Computer Room	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1271	Classroom Adjacent to Computer Room	New Construct	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFS-1272	1st Floor Restroom (Closest to Library)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFS-1273	1st Floor Restroom (Across Community Room)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# John F. Kennedy Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1274	Community Room	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1275	Community Room	New Construct	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1276	Room 200	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1277	Room 200	New Construct	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1278	2nd Floor Restroom (Between Room 201 & Room 200)	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1279	Art Room 201	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1280	Art Room 201	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1281	Art Room 201	New Construct	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1282	2nd Floor Corridor (Adjacent to ESL Room 203 - 2000)	2018	Bottle Fill Station	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1283	2nd Floor Corridor (Adjacent to ESL Room 203 - 2000)	2018	Water Cooler	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1284	Room 203	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1285	Room 203	2001	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1286	Room 202	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1287	Room 202	2002	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1288	Room 205	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1289	Room 205	2003	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1290	Room 204	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1291	Room 204	2004	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1293	Room 207	2005	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1295	Room 206	2006	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service

# John F. Kennedy Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1297	Room 209	2007	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1298	Room 208	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1299	Room 208	2008	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1300	Room 210	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1301	Room 210	2009	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1302	Room 211	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1303	Room 211	2010	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1304	Room 212	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1305	Room 212	2011	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1306	Room 213	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1307	Room 213	2012	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1308	Room 214	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1309	Room 214	2013	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1310	Room 215	2014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1311	Room 215	2014	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1312	Room 215	2014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1313	Room 215	2014	Water Fountain-No Chiller	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1314	Room 215 Storage	2014B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1315	Room 215 Bathroom	2014A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1316	Custodial Closet	2015	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use



# John F. Kennedy Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1317	2nd Floor Office Vestibule	2016A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1319	Exterior (Near Boiler Room - 1002B)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1321	Exterior (Near Library - New Construction)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1323	Exterior (Near Community Room - New Construction)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1351	New Mens Staff Bathroom (Former Boys LR Bathroom)	1000C1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1352	New Mens Staff Bathroom (Former Boys LR Bathroom)	1000C1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1353	New Mens Staff Bathroom (Former Boys LR Bathroom)	1000C1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1354	New Mens Staff Bathroom (Former Boys LR Bathroom)	1000C1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1355	New Womens Staff Bathroom (Former Girls LR Bathroom)	1000B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1356	New Womens Staff Bathroom (Former Girls LR Bathroom)	1000B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1357	New Womens Staff Bathroom (Former Girls LR Bathroom)	1000B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1358	New Womens Staff Bathroom (Former Girls LR Bathroom)	1000B1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1359	1st Floor Corridor Cafeteria to Women's Bathroom (Near	1007	Bottle Fill Station	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1360	1st Floor Corridor Cafeteria to Women's Bathroom (Near	1007	Water Cooler	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1363	1st Floor Corridor Library to Community Room (Across	New Construct	Bottle Fill Station	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1364	1st Floor Corridor Library to Community Room (Across	New Construct	Water Cooler	Potable	6/12/2024	OOS			Testing Required Before Return to Service
EIUFSD-1365	Room 207	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1774	Custodial Closet	1005A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1775	Boys Gang Bathroom (Near Main Lobby)	1005B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1776	Boys Gang Bathroom (Near Main Lobby)	1005B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# John F. Kennedy Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1777	Boys Gang Bathroom (Near Main Lobby)	1005B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1778	Girls Gang Bathroom (Near Main Lobby)	1006B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1779	Girls Gang Bathroom (Near Main Lobby)	1006B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1780	Girls Gang Bathroom (Near Main Lobby)	1006B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1781	Conference Room	1010	Kitchen Non Potable	Non-Applicable	6/12/2024	8.1			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
EIUFSD-1782	Nurse's Office	1015	Bottled Water Dispenser	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1783	Nurse's Office	1015	Bottled Water Dispenser	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1784	Nurse's Office	1015	Bottled Water Dispenser	Potable	6/12/2024	<1.00 ND			Result Below Action Level Continue O&M
EIUFSD-1785	Nurse's Office Bathroom	1015B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1786	Nurse's Office Bathroom	1015B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1787	Room 114 Bathroom	1017A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1788	Room 114 Bathroom	1017A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1789	Room 110 Bathroom	1022A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1790	Room 110 Bathroom	1022A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1791	Room 109	1023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1792	Room 111 Bathroom	1021A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1793	Room 111 Bathroom	1021A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1794	Room 107 Bathroom	1025A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1795	Room 107 Bathroom	1025A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1796	Room 106 Bathroom	1026A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

# John F. Kennedy Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFSD-1797	Room 106 Bathroom	1026A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1798	Room 203 Bathroom	2001A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1799	Room 203 Bathroom	2001A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1800	Room 202 Bathroom	2002A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1801	Room 202 Bathroom	2002A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1802	Room 207 Bathroom	2005A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1803	Room 207 Bathroom	2005A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1804	Room 209	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1805	Room 206	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1806	Room 206 Bathroom	2006A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1807	Room 206 Bathroom	2006A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1808	Room 210 Bathroom	2009A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1809	Room 210 Bathroom	2009A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1810	Room 211 Bathroom	2010A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1811	Room 211 Bathroom	2010A2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1812	Exterior (Outside Main Lobby - 1008)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1813	Exterior (Near Library - New Construction)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1814	Exterior (Outside Gym - 1000)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1815	Exterior (Outside Boys Locker Room - 1000C)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EIUFSD-1816	Exterior (Near Cafeteria Stage - 1001A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EIUFS-1817	Exterior (Near Cafeteria - 1001)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

# Attachment 3:

## Laboratory Analytical Reports


**J.C. Broderick & Associates, Inc.**


*Environmental Consulting & Testing*

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

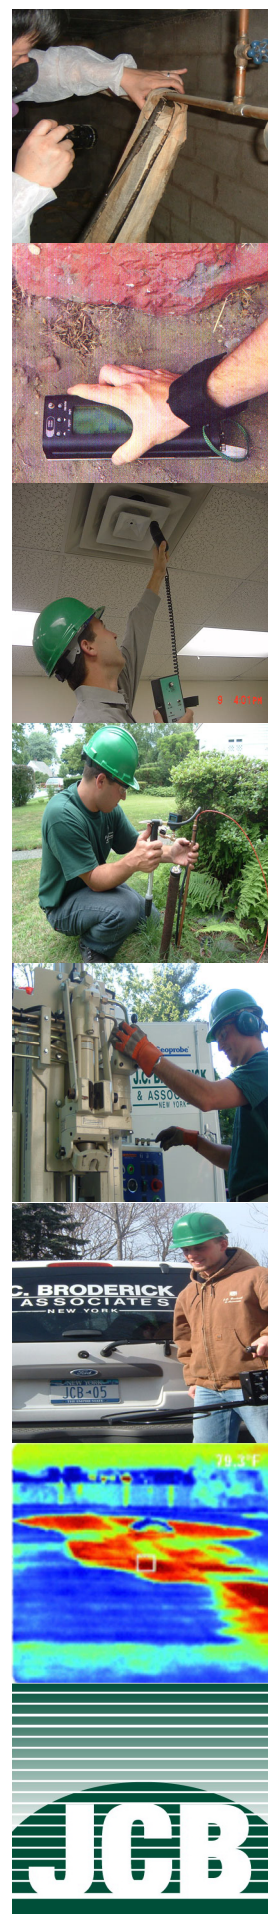



# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-50983  
Building: East Islip High School  
EIHS

EC54122

Client:  
East Islip Union Free School District

Retest/New Install ☐  
Turn Around: Normal 1 wk Rush \_\_\_\_\_

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-0001	KI	1006A	Kitchen North Serving Area	HW	6/8/2024	6:12:00 AM
EIUFSD-0002	KI	1006J	Kitchen South Serving Area	HW	6/8/2024	6:14:00 AM
EIUFSD-0003	KI	1006	Kitchen	KC	6/8/2024	6:23:00 AM
EIUFSD-0004	KI	1006	Kitchen	KC	6/8/2024	6:23:00 AM
EIUFSD-0005	KI	1006	Kitchen	KC	6/8/2024	6:22:00 AM
EIUFSD-0006	KI	1006	Kitchen	SN	6/8/2024	6:20:00 AM
EIUFSD-0007	KI	1006	Kitchen	HW	6/8/2024	6:19:00 AM
EIUFSD-0008	KI	1006	Kitchen	KC	6/8/2024	6:18:00 AM
EIUFSD-0009	KI	1006	Kitchen	KC	6/8/2024	6:18:00 AM
EIUFSD-0010	KI	1006	Kitchen	HW	6/8/2024	6:15:00 AM
EIUFSD-0011	KI	1006	Kitchen	HW	6/8/2024	6:13:00 AM
EIUFSD-0013	KI	1006	Kitchen	HW	6/8/2024	6:15:00 AM
EIUFSD-0014	KI	1006	Kitchen	HW	6/8/2024	6:22:00 AM
EIUFSD-0022	FL	1006I	Kitchen Faculty Lounge	HW	6/8/2024	6:26:00 AM
EIUFSD-0023	ST	1004	Laundry And Ice Room	IM	6/8/2024	6:47:00 AM
EIUFSD-0034	HA	1050	1st Floor Corridor Main Lobby To Room 100 (Across Main Office - 1042)	WF	6/8/2024	5:58:00 AM
EIUFSD-0047	NO	1053B	Nurses Suite Office	NS	6/8/2024	7:26:00 AM
EIUFSD-0050	ST	1054B	Art Office	KC	6/8/2024	7:22:00 AM

## Building Address

1 Redmen Street  
Islip Terrace, NY 11752

Analysis Type: ELAP 200.5

Lab Received: 6/19/24, 13:08


Signature: KARLYN WAGNER

Samplers Name: Tara Ricker

Samplers Signature: Tara Ricker

JCB Project Manager: Tara Ricker

Control



# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-50983  
Building: East Islip High School  
EIHs

EC 54122

Client: East Islip Union Free School District

Retest/New Install ☐  
Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-0071	HA	1078	1st Floor Corridor Room 128 to Nurse's Office (Across Office 114A - 1066)	WF	6/8/2024	7:17:00 AM
EIUFSD-0091	OF	1070A	Room 118 B	BWH	6/8/2024	7:14:00 AM
EIUFSD-0092	OF	1070A	Room 118 B	BWC	6/8/2024	7:14:00 AM
EIUFSD-0178	HA	1110	1st Floor Corridor Room 101 to Room 133 (Across Science Room 117 - 1094)	WF	6/8/2024	7:10:00 AM
EIUFSD-0288	HE	New Construction	Home Economics Room 140	EC	6/8/2024	6:58:00 AM
EIUFSD-0289	HE	New Construction	Home Economics Room 140	EC	6/8/2024	6:58:00 AM
EIUFSD-0290	HE	New Construction	Home Economics Room 140	EC	6/8/2024	6:59:00 AM
EIUFSD-0291	HE	New Construction	Home Economics Room 140	EC	6/8/2024	7:01:00 AM
EIUFSD-0292	HE	New Construction	Home Economics Room 140	EC	6/8/2024	7:02:00 AM
EIUFSD-0304	HE	1016	Home Economics Room 134	EC	6/8/2024	6:54:00 AM
EIUFSD-0305	HE	1016	Home Economics Room 134	EC	6/8/2024	6:52:00 AM
EIUFSD-0306	HE	1016	Home Economics Room 134	SN	6/8/2024	6:53:00 AM
EIUFSD-0316	HA	1022	1st Floor Corridor Gym Lobby to Little Theater (Near Cafeteria - 1005)	WF	6/8/2024	6:35:00 AM
EIUFSD-0325	OF	2056	Room 210	BWC	6/8/2024	7:40:00 AM
EIUFSD-0328	FL	2051A	Faculty Lounge	KC	6/8/2024	7:34:00 AM
EIUFSD-0335	HA	2062	2nd Floor Corridor Room 200 to Room 244 (Across Room 222 - 2046)	WF	6/8/2024	7:32:00 AM
EIUFSD-0343	HA	New Construction	2nd Floor New Construction Corridor (Across Room 250)	WF	6/8/2024	7:51:00 AM
EIUFSD-0361	HA	2063	2nd Floor Corridor Room 201 to Room 245 (Across Room 221 - 2014)	WF	6/8/2024	7:48:00 AM

## Building Address

1 Redmen Street  
Islip Terrace, NY 11752

Analysis Type: ELAP 200.5

Lab Received: 6/19/24 13:08


Signature:

KARLYN WAGNER

Samplers Name: Tara Ricker

Samplers Signature: Tara Ricker

JCB Project Manager: Tara Ricker



# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-50983

Building: East Islip High School

EIHS

Client:

East Islip Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

EC54122

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-0370	OF	2004	Room 211	BWH	6/8/2024	7:45:00 AM
EIUFSD-0371	OF	2004	Room 211	BWC	6/8/2024	7:45:00 AM
EIUFSD-1399	KI	1006	Kitchen	SN	6/8/2024	6:15:00 AM
EIUFSD-1414	HA	New Construction	2nd Floor New Construction Corridor (Across Room 274)	WF	6/8/2024	7:49:00 AM
EIUFSD-1416	OF	2056	Room 210	BWH	6/8/2024	7:40:00 AM
EIUFSD-1428	KI	1006	Kitchen	CP	6/8/2024	6:24:00 AM
EIUFSD-1429	KI	1006	Kitchen	PK	6/8/2024	6:16:00 AM
EIUFSD-1445	OF	1049A	Career Center	BW	6/8/2024	7:58:00 AM
EIUFSD-1446	OF	1049A	Career Center	BW	6/8/2024	7:59:00 AM
EIUFSD-1447	ST	1054B	Art Office	IM	6/8/2024	7:23:00 AM
EIUFSD-1496	HA	New Construction	1st Floor New Construction Corridor (Across Room 152)	WF	6/8/2024	7:04:00 AM
EIUFSD-1515	LR	1003A	Boy's Locker Room	WF	6/8/2024	6:30:00 AM
EIUFSD-1551	OF	2054	Room 212A	BWH	6/8/2024	7:37:00 AM
EIUFSD-1552	OF	2054	Room 212A	BWC	6/8/2024	7:37:00 AM

Samples Submitted 50

RECEIVED  
ENSL ANALYTICAL, INC.  
CARLE PLACE, NY  
2024 JUN 19 P 1:08

## Building Address

1 Redmen Street  
Islip Terrace, NY 11752

Analysis Type: ELAP 200.5

Lab Received: 6/19/24 13:08

Signature: [Signature]

Samplers Name: Tara Ricker

Samplers Signature: [Signature]

JCB Project Manager: Tara Ricker



**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454122**LIMS Reference ID:** EC54122**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip High School: 1 Redmen Street, Islip  
Terrace, NY 11752: East Islip Union Free  
School District: Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:08

**Reported:**

07/05/2024 12:56

**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD-0001</b> Lims Reference ID: EC54122-01 Matrix: Drinking Water <b>Sampled: 06/08/24 06:12:00</b>									
<b>Metals</b>									
Lead	4.3		1	1.0	µg/L	07/02/24 16:35	07/02/24 16:35	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0002</b> Lims Reference ID: EC54122-02 Matrix: Drinking Water <b>Sampled: 06/08/24 06:14:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 16:39	07/02/24 16:39	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0003</b> Lims Reference ID: EC54122-03 Matrix: Drinking Water <b>Sampled: 06/08/24 06:23:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 16:40	07/02/24 16:40	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0004</b> Lims Reference ID: EC54122-04 Matrix: Drinking Water <b>Sampled: 06/08/24 06:23:00</b>									
<b>Metals</b>									
Lead	1.3		1	1.0	µg/L	07/02/24 16:42	07/02/24 16:42	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0005</b> Lims Reference ID: EC54122-05 Matrix: Drinking Water <b>Sampled: 06/08/24 06:22:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 16:43	07/02/24 16:43	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0006</b> Lims Reference ID: EC54122-06 Matrix: Drinking Water <b>Sampled: 06/08/24 06:20:00</b>									
<b>Metals</b>									
Lead	8.4		1	1.0	µg/L	07/02/24 16:47	07/02/24 16:47	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0007</b> Lims Reference ID: EC54122-07 Matrix: Drinking Water <b>Sampled: 06/08/24 06:19:00</b>									
<b>Metals</b>									
Lead	1.7		1	1.0	µg/L	07/02/24 16:48	07/02/24 16:48	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0008</b> Lims Reference ID: EC54122-08 Matrix: Drinking Water <b>Sampled: 06/08/24 06:18:00</b>									
<b>Metals</b>									
Lead	3.3		1	1.0	µg/L	07/02/24 16:49	07/02/24 16:49	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0009</b> Lims Reference ID: EC54122-09 Matrix: Drinking Water <b>Sampled: 06/08/24 06:18:00</b>									
<b>Metals</b>									
Lead	2.5		1	1.0	µg/L	07/02/24 16:51	07/02/24 16:51	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454122**LIMS Reference ID:** EC54122**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip High School: 1 Redmen Street, Islip  
Terrace, NY 11752: East Islip Union Free  
School District: Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:08

**Reported:**

07/05/2024 12:56

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD-0010 <b>Lims Reference ID:</b> EC54122-10 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:15:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 16:52	07/02/24 16:52	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0011 <b>Lims Reference ID:</b> EC54122-11 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:22:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 16:53	07/02/24 16:53	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0013 <b>Lims Reference ID:</b> EC54122-12 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:26:00									
<b>Metals</b>									
Lead	23.9		1	1.0	µg/L	07/02/24 16:57	07/02/24 16:57	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0014 <b>Lims Reference ID:</b> EC54122-13 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:47:00									
<b>Metals</b>									
Lead	2.4		1	1.0	µg/L	07/02/24 16:59	07/02/24 16:59	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0022 <b>Lims Reference ID:</b> EC54122-14 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 05:58:00									
<b>Metals</b>									
Lead	2.5		1	1.0	µg/L	07/02/24 17:03	07/02/24 17:03	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0023 <b>Lims Reference ID:</b> EC54122-15 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:26:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 17:04	07/02/24 17:04	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0034 <b>Lims Reference ID:</b> EC54122-16 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:22:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 17:05	07/02/24 17:05	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0047 <b>Lims Reference ID:</b> EC54122-17 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:17:00									
<b>Metals</b>									
Lead	1.1		1	1.0	µg/L	07/02/24 17:07	07/02/24 17:07	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0050 <b>Lims Reference ID:</b> EC54122-18 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:14:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 17:08	07/02/24 17:08	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454122**LIMS Reference ID:** EC54122**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip High School: 1 Redmen Street, Islip  
Terrace, NY 11752: East Islip Union Free  
School District: Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:08

**Reported:**

07/05/2024 12:56

### Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD-0071 <b>Lims Reference ID:</b> EC54122-19 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:14:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 17:09	07/02/24 17:09	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0091 <b>Lims Reference ID:</b> EC54122-20 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:10:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/02/24 17:11	07/02/24 17:11	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0092 <b>Lims Reference ID:</b> EC54122-21 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:58:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 14:31	07/03/24 14:31	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0178 <b>Lims Reference ID:</b> EC54122-22 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:58:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 14:38	07/03/24 14:38	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0288 <b>Lims Reference ID:</b> EC54122-23 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:59:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 14:39	07/03/24 14:39	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0289 <b>Lims Reference ID:</b> EC54122-24 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:01:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 14:40	07/03/24 14:40	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0290 <b>Lims Reference ID:</b> EC54122-25 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:02:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 14:42	07/03/24 14:42	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0291 <b>Lims Reference ID:</b> EC54122-26 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:54:00									
<b>Metals</b>									
Lead	1.0		1	1.0	µg/L	07/03/24 14:43	07/03/24 14:43	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0292 <b>Lims Reference ID:</b> EC54122-27 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:52:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 14:44	07/03/24 14:44	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454122**LIMS Reference ID:** EC54122**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip High School: 1 Redmen Street, Islip  
Terrace, NY 11752: East Islip Union Free  
School District: Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:08

**Reported:**

07/05/2024 12:56

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD-0304 <b>Lims Reference ID:</b> EC54122-28 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:23:00									
<b>Metals</b>									
Lead	6.5		1	1.0	µg/L	07/03/24 14:46	07/03/24 14:46	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0305 <b>Lims Reference ID:</b> EC54122-29 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 06:35:00									
<b>Metals</b>									
Lead	5.0		1	1.0	µg/L	07/03/24 14:47	07/03/24 14:47	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0306 <b>Lims Reference ID:</b> EC54122-30 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:40:00									
<b>Metals</b>									
Lead	16.4		1	1.0	µg/L	07/03/24 14:48	07/03/24 14:48	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0316 <b>Lims Reference ID:</b> EC54122-31 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:34:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 14:52	07/03/24 14:52	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0325 <b>Lims Reference ID:</b> EC54122-32 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:32:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 14:56	07/03/24 14:56	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0328 <b>Lims Reference ID:</b> EC54122-33 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:51:00									
<b>Metals</b>									
Lead	1.4		1	1.0	µg/L	07/03/24 14:58	07/03/24 14:58	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0335 <b>Lims Reference ID:</b> EC54122-34 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:48:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 14:59	07/03/24 14:59	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0343 <b>Lims Reference ID:</b> EC54122-35 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:45:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:00	07/03/24 15:00	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0361 <b>Lims Reference ID:</b> EC54122-36 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/08/24 07:45:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:01	07/03/24 15:01	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454122**LIMS Reference ID:** EC54122**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip High School: 1 Redmen Street, Islip  
Terrace, NY 11752: East Islip Union Free  
School District: Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:08

**Reported:**

07/05/2024 12:56

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD-0370</b> Lims Reference ID: EC54122-37 Matrix: Drinking Water <b>Sampled: 06/08/24 06:15:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:03	07/03/24 15:03	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0371</b> Lims Reference ID: EC54122-38 Matrix: Drinking Water <b>Sampled: 06/08/24 07:49:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:04	07/03/24 15:04	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1399</b> Lims Reference ID: EC54122-39 Matrix: Drinking Water <b>Sampled: 06/08/24 07:40:00</b>									
<b>Metals</b>									
Lead	19.4		1	1.0	µg/L	07/03/24 15:08	07/03/24 15:08	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1414</b> Lims Reference ID: EC54122-40 Matrix: Drinking Water <b>Sampled: 06/08/24 06:24:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:09	07/03/24 15:09	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1416</b> Lims Reference ID: EC54122-41 Matrix: Drinking Water <b>Sampled: 06/08/24 06:16:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:52	07/03/24 15:52	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1428</b> Lims Reference ID: EC54122-42 Matrix: Drinking Water <b>Sampled: 06/08/24 07:58:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:56	07/03/24 15:56	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1429</b> Lims Reference ID: EC54122-43 Matrix: Drinking Water <b>Sampled: 06/08/24 07:59:00</b>									
<b>Metals</b>									
Lead	14.2		1	1.0	µg/L	07/03/24 15:57	07/03/24 15:57	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1445</b> Lims Reference ID: EC54122-44 Matrix: Drinking Water <b>Sampled: 06/08/24 07:23:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:58	07/03/24 15:58	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1446</b> Lims Reference ID: EC54122-45 Matrix: Drinking Water <b>Sampled: 06/08/24 07:04:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:00	07/03/24 16:00	BP	EPA 200.8 (DA)/EPA 200.8

**Attention:** Tara Ricker

J.C. Broderick & Associates [JC BR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip High School: 1 Redmen Street, Islip  
Terrace, NY 11752: East Islip Union Free  
School District: Project# 22-50983

**Customer PO:**

**EMSL Sales Rep:**

Jeromy Bish

Received:

06/19/2024 13:08

**Reported:**

07/05/2024 12:56

### Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EIUFSD-1447									
Lims Reference ID:				EC54122-46		Matrix: Drinking Water		Sampled: 06/08/24 06:30:00	
Metals									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:01	07/03/24 16:01	BP	EPA 200.8 (DA)/EPA 200.8
Sample: EIUFSD-1496									
Lims Reference ID:				EC54122-47		Matrix: Drinking Water		Sampled: 06/08/24 07:37:00	
Metals									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:02	07/03/24 16:02	BP	EPA 200.8 (DA)/EPA 200.8
Sample: EIUFSD-1515									
Lims Reference ID:				EC54122-48		Matrix: Drinking Water		Sampled: 06/08/24 07:37:00	
Metals									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:06	07/03/24 16:06	BP	EPA 200.8 (DA)/EPA 200.8
Sample: EIUFSD-1551									
Lims Reference ID:				EC54122-49		Matrix: Drinking Water		Sampled: 06/08/24 00:00:00	
Metals									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:08	07/03/24 16:08	BP	EPA 200.8 (DA)/EPA 200.8
Sample: EIUFSD-1552									
Lims Reference ID:				EC54122-50		Matrix: Drinking Water		Sampled: 06/08/24 00:00:00	
Metals									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:12	07/03/24 16:12	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454122**LIMS Reference ID:** EC54122**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip High School: 1 Redmen Street, Islip  
Terrace, NY 11752: East Islip Union Free  
School District: Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:08

**Reported:**

07/05/2024 12:56

**Certified Analyses included in this Report**

Analyte	Certifications
<b><i>EPA 200.8 in Drinking Water</i></b>	
Lead	06-NYSELAP

**List of Certifications**

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on [www.emsl.com](http://www.emsl.com) <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454122**LIMS Reference ID:** EC54122**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip High School: 1 Redmen Street, Islip  
Terrace, NY 11752: East Islip Union Free  
School District: Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:08

**Reported:**

07/05/2024 12:56

**Notes and Definitions**


Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.





# Lead in Water: Chain of Custody for

EC54171

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-50983  
Building: East Islip Middle School & Field House  
EIMS

Client: East Islip Union Free School District  
Retest/New Install [ ]  
Turn Around: Normal 1 wk Rush \_\_\_\_\_

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-0505	OF	New Construction	Library Work Room 147C	KC	6/15/2024	6:41:00 AM
EIUFSD-0506	NO	1018	Nurse's Room	BWH	6/15/2024	7:11:00 AM
EIUFSD-0507	NO	1018	Nurse's Room	BWC	6/15/2024	7:11:00 AM
EIUFSD-0523	HA	1019	1st Floor Corridor Gym to Room 113 (Across Room 109 - 1008)	WF	6/15/2024	6:35:00 AM
EIUFSD-0525	HE	1004	Home Economics Room 102	EC	6/15/2024	6:28:00 AM
EIUFSD-0526	HE	1004	Home Economics Room 102	EC	6/15/2024	6:29:00 AM
EIUFSD-0527	HE	1004	Home Economics Room 102	EC	6/15/2024	6:30:00 AM
EIUFSD-0528	HE	1004	Home Economics Room 102	EC	6/15/2024	6:31:00 AM
EIUFSD-0529	HE	1004	Home Economics Room 102	EC	6/15/2024	6:32:00 AM
EIUFSD-0530	HE	1004	Home Economics Room 102	EC	6/15/2024	2024 JUN 19 6:33:00 AM
EIUFSD-0531	ST	1004B	Home Economics Room 102 Back Storage	EC	6/15/2024	2024 JUN 19 6:33:00 AM
EIUFSD-0534	HA	1068A	Auxillary Gym Vestibule	WF	6/15/2024	2024 JUN 19 6:25:00 AM
EIUFSD-0557	KI	1056	Kitchen	KC	6/15/2024	2024 JUN 19 6:14:00 AM
EIUFSD-0560	KI	1056	Kitchen	HW	6/15/2024	2024 JUN 19 6:10:00 AM
EIUFSD-0561	KI	1056	Kitchen	KC	6/15/2024	2024 JUN 19 6:11:00 AM
EIUFSD-0562	KI	1056	Kitchen	KC	6/15/2024	6:11:00 AM
EIUFSD-0563	KI	1056	Kitchen	KC	6/15/2024	6:12:00 AM
EIUFSD-0564	KI	1056	Kitchen	KC	6/15/2024	6:12:00 AM

**Building Address**  
100 Redmen Street  
Islip Terrace, NY 11752

**Analysis Type:** ELAP 200.5

**Lab Received:** 6/19/24 13:05

**Signature:** *[Signature]* KARYN WAGNER

**Samplers Name:** Alexandria Orlassino

**Samplers Signature:** *[Signature]* A Orlassino

**JCB Project Manager:** Tara Rickert

Counter



# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-50983

Building: East Islip Middle School & Field House

EIMS

Client:

East Islip Union Free School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-0565	FL	1057A	Cafeteria Office	KC	6/15/2024	6:16:00 AM
EIUFSD-0570	KI	1054	North Dining	HW	6/15/2024	6:18:00 AM
EIUFSD-0571	KI	1054	North Dining	HW	6/15/2024	6:19:00 AM
EIUFSD-0572	KI	1054	North Dining	KC	6/15/2024	6:19:00 AM
EIUFSD-0573	KI	1054	North Dining	HW	6/15/2024	6:20:00 AM
EIUFSD-0574	KI	1054	North Dining	KC	6/15/2024	6:20:00 AM
EIUFSD-0577	HA	1058	1st Floor Corridor (Across North Dining; Cafeteria - 1054)	WF	6/15/2024	6:22:00 AM
EIUFSD-0601	OF	1027	Support Center Guidance Vestibule	KC	6/15/2024	6:48:00 AM
EIUFSD-0602	FL	1022	Faculty Lounge	KC	6/15/2024	6:50:00 AM
EIUFSD-0617	HE	New Construction	Home Economics Room 225	EC	6/15/2024	7:02:00 AM
EIUFSD-0643	ST	2011A	Science Room 209 Storage	BWH	6/15/2024	7:08:00 AM
EIUFSD-0644	ST	2011A	Science Room 209 Storage	BW	6/15/2024	7:09:00 AM
EIUFSD-0645	ST	2011A	Science Room 209 Storage	BWC	6/15/2024	7:09:00 AM
EIUFSD-1383	HA	New Construction	1st Floor Corridor Room 130 to Main Office (Across Room 122)	WF	6/15/2024	6:45:00 AM
EIUFSD-1387	HA	New Construction	2nd Floor Science Wing Corridor (Across Room 225)	WF	6/15/2024	6:56:00 AM
EIUFSD-1389	HA	2016	2nd Floor Corridor Room 211 to Room 201 (Across Room 207 - 2008)	WF	6/15/2024	7:05:00 AM
EIUFSD-1590	HA	New Construction	1st Floor Science Wing Corridor (Across Room 125)	WF	6/15/2024	6:44:00 AM
EIUFSD-1636	CA	1057	Cafeteria	WF	6/15/2024	6:16:00 AM

## Building Address

100 Redmen Street  
Islip Terrace, NY 11752

Analysis Type: ELAP 200.5

Lab Received: 6/19/24 13:05


Signature:

KATLYN WAGNER

Samplers Name: Alexandria Orlassino

Samplers Signature: Alex Orlassino

JCB Project Manager: Tara Ricker



# Lead in Water: Chain of Custody for

6-5471

J. C. BRODERICK AND ASSOCIATES, INC.

JCB #:

22-50983

Client:

East Islip Union Free School District

1775 Expressway North Hauppauge, NY 11788

Building:

East Islip Middle School & Field House

Retest/New Install [ ]

TEL: (631) 584-5492 FAX: (631) 584-3395

EIMS

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-1639	HA	1058	1st Floor Corridor (Across North Dining; Cafeteria - 1054)	WF	6/15/2024	6:22:00 AM
EIUFSD-1640	FL	1022	Faculty Lounge	BWH	6/15/2024	6:51:00 AM
EIUFSD-1641	FL	1022	Faculty Lounge	BWC	6/15/2024	6:51:00 AM
EIUFSD-1642	HA	New Construction	2nd Floor Corridor Room 230 to Room 220 (Across Room 222)	WF	6/15/2024	7:25:00 AM
EIUFSD-1661	LR	1064	Boys Locker Room (Formerly Girls)	WC	6/15/2024	7:14:00 AM
EIUFSD-1662	LR	1064	Boys Locker Room (Formerly Girls)	WF	6/15/2024	7:15:00 AM
EIUFSD-1663	LR	1064	Boys Locker Room (Formerly Girls)	WC	6/15/2024	7:14:00 AM
EIUFSD-1670	LR	1063	Girls Locker Room (Formerly Boys)	WC	6/15/2024	7:19:00 AM
EIUFSD-1671	LR	1063	Girls Locker Room (Formerly Boys)	WF	6/15/2024	7:19:00 AM
EIUFSD-1672	LR	1063	Girls Locker Room (Formerly Boys)	WC	6/15/2024	7:20:00 AM
EIUFSD-1686	ST	1060	Storage Room A (Across Girls Locker Room)	IM	6/15/2024	7:22:00 AM

Samples Submitted 47

RECEIVED  
EAST ANALYTICAL, INC.  
CARLE PLACE, NY  
2024 JUN 19 P 1:05

## Building Address

100 Redmen Street

Islip Terrace, NY 11752

Analysis Type: ELAP 200.5

Lab Received 6/12/24 13:06

Signature: [Signature]

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Tara Ricker

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454171**LIMS Reference ID:** EC54171**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip Middle School & Field House; 100  
Redmen Street, Islip Terrace, NY 11752; East  
Islip Union Free School District; Project#  
22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:05

**Reported:**

07/10/2024 11:33

**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD-0505</b> <b>Lims Reference ID: EC54171-01</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/15/24 06:41:00</b>									
<b>Metals</b>									
Lead	1.2		1	1.0	µg/L	07/03/24 11:11	07/03/24 11:11	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0506</b> <b>Lims Reference ID: EC54171-02</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/15/24 07:11:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 11:15	07/03/24 11:15	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0507</b> <b>Lims Reference ID: EC54171-03</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/15/24 07:11:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 11:16	07/03/24 11:16	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0523</b> <b>Lims Reference ID: EC54171-04</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/15/24 06:35:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 11:18	07/03/24 11:18	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0525</b> <b>Lims Reference ID: EC54171-05</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/15/24 06:28:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 11:19	07/03/24 11:19	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0526</b> <b>Lims Reference ID: EC54171-06</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/15/24 06:29:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 11:23	07/03/24 11:23	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0527</b> <b>Lims Reference ID: EC54171-07</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/15/24 06:30:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 11:24	07/03/24 11:24	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0528</b> <b>Lims Reference ID: EC54171-08</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/15/24 06:31:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 11:26	07/03/24 11:26	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0529</b> <b>Lims Reference ID: EC54171-09</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/15/24 06:32:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 11:27	07/03/24 11:27	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454171**LIMS Reference ID:** EC54171**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip Middle School & Field House; 100  
Redmen Street, Islip Terrace, NY 11752; East  
Islip Union Free School District; Project#  
22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:05

**Reported:**

07/10/2024 11:33

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD-0530 <b>Lims Reference ID:</b> EC54171-10 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:33:00									
<b>Metals</b>									
Lead	2.6		1	1.0	µg/L	07/03/24 11:28	07/03/24 11:28	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0531 <b>Lims Reference ID:</b> EC54171-11 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:33:00									
<b>Metals</b>									
Lead	12.1		1	1.0	µg/L	07/03/24 11:30	07/03/24 11:30	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0534 <b>Lims Reference ID:</b> EC54171-12 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:25:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 11:33	07/03/24 11:33	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0557 <b>Lims Reference ID:</b> EC54171-13 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:14:00									
<b>Metals</b>									
Lead	59.8		2	2.0	µg/L	07/01/24 11:24	07/01/24 11:24	BP	EPA 200.8 (Dig)/EPA 200.8
<b>Sample:</b> EIUFSD-0560 <b>Lims Reference ID:</b> EC54171-14 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:10:00									
<b>Metals</b>									
Lead	1.9		1	1.0	µg/L	07/03/24 11:35	07/03/24 11:35	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0561 <b>Lims Reference ID:</b> EC54171-15 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:11:00									
<b>Metals</b>									
Lead	4.4		1	1.0	µg/L	07/03/24 11:58	07/03/24 11:58	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0562 <b>Lims Reference ID:</b> EC54171-16 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:11:00									
<b>Metals</b>									
Lead	9.4		1	1.0	µg/L	07/03/24 11:59	07/03/24 11:59	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0563 <b>Lims Reference ID:</b> EC54171-17 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:12:00									
<b>Metals</b>									
Lead	2.5		1	1.0	µg/L	07/03/24 12:01	07/03/24 12:01	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0564 <b>Lims Reference ID:</b> EC54171-18 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:12:00									
<b>Metals</b>									
Lead	4.3		1	1.0	µg/L	07/03/24 12:02	07/03/24 12:02	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454171  
**LIMS Reference ID:** EC54171  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** East Islip Middle School & Field House; 100  
Redmen Street, Islip Terrace, NY 11752; East  
Islip Union Free School District; Project#  
22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:05  
**Reported:** 07/10/2024 11:33

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD-0565 <b>Lims Reference ID:</b> EC54171-19 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:16:00									
<b>Metals</b>									
Lead	2.2		1	1.0	µg/L	07/03/24 12:03	07/03/24 12:03	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0570 <b>Lims Reference ID:</b> EC54171-20 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:18:00									
<b>Metals</b>									
Lead	4.0		1	1.0	µg/L	07/03/24 12:05	07/03/24 12:05	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0571 <b>Lims Reference ID:</b> EC54171-21 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:19:00									
<b>Metals</b>									
Lead	6.5		1	1.0	µg/L	07/03/24 12:06	07/03/24 12:06	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0572 <b>Lims Reference ID:</b> EC54171-22 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:19:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:27	07/03/24 12:27	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0573 <b>Lims Reference ID:</b> EC54171-23 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:20:00									
<b>Metals</b>									
Lead	1.5		1	1.0	µg/L	07/03/24 12:31	07/03/24 12:31	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0574 <b>Lims Reference ID:</b> EC54171-24 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:20:00									
<b>Metals</b>									
Lead	2.6		1	1.0	µg/L	07/03/24 12:32	07/03/24 12:32	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0577 <b>Lims Reference ID:</b> EC54171-25 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:22:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:33	07/03/24 12:33	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0601 <b>Lims Reference ID:</b> EC54171-26 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:48:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:35	07/03/24 12:35	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0602 <b>Lims Reference ID:</b> EC54171-27 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:50:00									
<b>Metals</b>									
Lead	1.4		1	1.0	µg/L	07/03/24 12:39	07/03/24 12:39	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454171  
**LIMS Reference ID:** EC54171  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** East Islip Middle School & Field House; 100  
Redmen Street, Islip Terrace, NY 11752; East  
Islip Union Free School District; Project#  
22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:05  
**Reported:** 07/10/2024 11:33

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD-0617 <b>Lims Reference ID:</b> EC54171-28 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:02:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:40	07/03/24 12:40	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0643 <b>Lims Reference ID:</b> EC54171-29 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:08:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:41	07/03/24 12:41	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0644 <b>Lims Reference ID:</b> EC54171-30 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:09:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:43	07/03/24 12:43	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-0645 <b>Lims Reference ID:</b> EC54171-31 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:09:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:44	07/03/24 12:44	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1383 <b>Lims Reference ID:</b> EC54171-32 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:45:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:45	07/03/24 12:45	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1387 <b>Lims Reference ID:</b> EC54171-33 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:56:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:49	07/03/24 12:49	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1389 <b>Lims Reference ID:</b> EC54171-34 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:05:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:51	07/03/24 12:51	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1590 <b>Lims Reference ID:</b> EC54171-35 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:44:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:55	07/03/24 12:55	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1636 <b>Lims Reference ID:</b> EC54171-36 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:16:00									
<b>Metals</b>									
Lead	4.0		1	1.0	µg/L	07/03/24 12:56	07/03/24 12:56	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454171**LIMS Reference ID:** EC54171**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip Middle School & Field House; 100  
Redmen Street, Islip Terrace, NY 11752; East  
Islip Union Free School District; Project#  
22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:05

**Reported:**

07/10/2024 11:33

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD-1639 <b>Lims Reference ID:</b> EC54171-37 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:22:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:57	07/03/24 12:57	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1640 <b>Lims Reference ID:</b> EC54171-38 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:51:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 12:58	07/03/24 12:58	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1641 <b>Lims Reference ID:</b> EC54171-39 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 06:51:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 13:00	07/03/24 13:00	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1642 <b>Lims Reference ID:</b> EC54171-40 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:25:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 13:01	07/03/24 13:01	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1661 <b>Lims Reference ID:</b> EC54171-41 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:14:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 13:02	07/03/24 13:02	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1662 <b>Lims Reference ID:</b> EC54171-42 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:15:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:13	07/03/24 16:13	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1663 <b>Lims Reference ID:</b> EC54171-43 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:14:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:14	07/03/24 16:14	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1670 <b>Lims Reference ID:</b> EC54171-44 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:19:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:16	07/03/24 16:16	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1671 <b>Lims Reference ID:</b> EC54171-45 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/15/24 07:19:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 16:17	07/03/24 16:17	BP	EPA 200.8 (DA)/EPA 200.8



**Attention:** Tara Ricker

J.C. Broderick & Associates [JC BR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip Middle School & Field House; 100  
Redmen Street, Islip Terrace, NY 11752; East  
Islip Union Free School District; Project#  
22-50983

**Customer PO:**

Jeromy Bish

**EMSL Sales Rep:**

06/19/2024 13:05

## Received:

07/10/2024 11:33

**Reported:**

## Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	--------------------	--------------------	------------------	-------------------------

**Sample: EIUFSD-1672**

**Lims Reference ID: EC54171-46 Matrix: Drinking Water**

Sampled: 06/15/24 07:20:00

## Metals

Lead	<1.0	1	1.0	µg/L	07/03/24 16:18	07/03/24 16:18	BP	EPA 200.8 (DA)/EPA 200.8
------	------	---	-----	------	----------------	----------------	----	--------------------------

**Sample: EIUFSD-1686**

**Lims Reference ID: EC54171-47 Matrix: Drinking Water**

Sampled: 06/15/24 07:22:00

## Metals

Lead	<1.0	1	1.0	µg/L	07/03/24 16:19	07/03/24 16:19	BP	EPA 200.8 (DA)/EPA 200.8
------	------	---	-----	------	----------------	----------------	----	--------------------------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454171**LIMS Reference ID:** EC54171**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

East Islip Middle School & Field House; 100  
Redmen Street, Islip Terrace, NY 11752; East  
Islip Union Free School District; Project#  
22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:05

**Reported:**

07/10/2024 11:33

**Certified Analyses included in this Report**

Analyte	Certifications
<b><i>EPA 200.8 in Drinking Water</i></b>	
Lead	06-NYSELAP

**List of Certifications**

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on [www.emsl.com](http://www.emsl.com) <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454171  
**LIMS Reference ID:** EC54171  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** East Islip Middle School & Field House; 100  
Redmen Street, Islip Terrace, NY 11752; East  
Islip Union Free School District; Project#  
22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:05  
**Reported:** 07/10/2024 11:33

### Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-50983  
Building: Ruth C. Kinney Elementary School  
RCKES

Client: East Islip Union Free School District  
Retest/New Install ☐  
Turn Around: Normal 1 wk Rush         

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-0732	FL	1028	Faculty Room	KC	6/7/2024	6:44:00 AM
EIUFSD-0755	NO	1015B	Nurse's Suite Office	NS	6/7/2024	6:50:00 AM
EIUFSD-0759	HA	1008	1st Floor Corridor Cafeteria Stage to Womens Bathroom (Near Main Lobby - 1009)	WF	6/7/2024	6:31:00 AM
EIUFSD-0761	HA	1008	1st Floor Corridor Cafeteria Stage to Womens Bathroom (Near Main Lobby - 1009)	WF	6/7/2024	6:33:00 AM
EIUFSD-0765	KI	1001	Kitchen	KC	6/7/2024	6:25:00 AM
EIUFSD-0766	KI	1001	Kitchen	KC	6/7/2024	6:25:00 AM
EIUFSD-0767	KI	1001	Kitchen	KC	6/7/2024	6:26:00 AM
EIUFSD-0768	KI	1001	Kitchen	HW	6/7/2024	6:26:00 AM
EIUFSD-0771	CA	1000	Cafeteria	WF	6/7/2024	6:28:00 AM
EIUFSD-0781	HA	2017	2nd Floor Main Corridor (Adjacent to Book Room - 2000)	WF	6/7/2024	6:57:00 AM
EIUFSD-1349	HA	New Construction	1st Floor Corridor Library to Room 13 (Across Room 194)	WF	6/7/2024	6:48:00 AM

Samples Submitted 11



RECEIVED  
CHSL ANALYTICAL, INC.  
CARLE PLACE, NY  
2024 JUN 19 P 1:07

**Building Address**  
1 Spur Drive South  
Islip Terrace, NY 11752

Analysis Type: ELAP 200.5  
Lab Received: 6/19/24 13:07  
Signature: KATELYN WAGNER

Samplers Name: Tara Ricker  
Samplers Signature: Tara Ricker  
JCB Project Manager: Tara Ricker

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454120  
**LIMS Reference ID:** EC54120  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** Ruth C. Kinney Elementary School: 1 Spur  
Drive South, Islip Terrace, NY 11752: East  
Islip Union Free School District: Project#  
22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:07  
**Reported:** 07/10/2024 11:10

**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD-0732</b> <b>Lims Reference ID: EC54120-01</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/20/24 00:00:00</b>									
<b>Metals</b>									
Lead	1.3		1	1.0	µg/L	07/05/24 14:04	07/05/24 14:04	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0755</b> <b>Lims Reference ID: EC54120-02</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/20/24 00:00:00</b>									
<b>Metals</b>									
Lead	1.8		1	1.0	µg/L	07/05/24 14:08	07/05/24 14:08	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0759</b> <b>Lims Reference ID: EC54120-03</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/20/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 14:09	07/05/24 14:09	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0761</b> <b>Lims Reference ID: EC54120-04</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/20/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 14:10	07/05/24 14:10	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0765</b> <b>Lims Reference ID: EC54120-05</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/20/24 00:00:00</b>									
<b>Metals</b>									
Lead	685		10	10.0	µg/L	07/05/24 14:46	07/05/24 14:46	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0766</b> <b>Lims Reference ID: EC54120-06</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/20/24 00:00:00</b>									
<b>Metals</b>									
Lead	1.7		1	1.0	µg/L	07/05/24 15:10	07/05/24 15:10	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0767</b> <b>Lims Reference ID: EC54120-07</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/20/24 00:00:00</b>									
<b>Metals</b>									
Lead	5.0		1	1.0	µg/L	07/05/24 15:13	07/05/24 15:13	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0768</b> <b>Lims Reference ID: EC54120-08</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/20/24 00:00:00</b>									
<b>Metals</b>									
Lead	2.1		1	1.0	µg/L	07/05/24 15:15	07/05/24 15:15	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0771</b> <b>Lims Reference ID: EC54120-09</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/20/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:16	07/05/24 15:16	BP	EPA 200.8 (DA)/EPA 200.8



**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax:856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454120  
**LIMS Reference ID:** EC54120  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** Ruth C. Kinney Elementary School: 1 Spur Drive South, Islip Terrace, NY 11752: East Islip Union Free School District: Project# 22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:07  
**Reported:** 07/10/2024 11:10

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD-0781 <b>Lims Reference ID:</b> EC54120-10 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/20/24 00:00:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:20	07/05/24 15:20	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1349 <b>Lims Reference ID:</b> EC54120-11 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/20/24 00:00:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:21	07/05/24 15:21	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454120**LIMS Reference ID:** EC54120**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

Ruth C. Kinney Elementary School: 1 Spur  
Drive South, Islip Terrace, NY 11752: East  
Islip Union Free School District: Project#  
22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:07

**Reported:**

07/10/2024 11:10

**Certified Analyses included in this Report**

Analyte	Certifications
<b><i>EPA 200.8 in Drinking Water</i></b>	
Lead	06-NYSELAP

**List of Certifications**

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on [www.emsl.com](http://www.emsl.com) <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454120  
**LIMS Reference ID:** EC54120  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** Ruth C. Kinney Elementary School: 1 Spur  
Drive South, Islip Terrace, NY 11752: East  
Islip Union Free School District: Project#  
22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:07  
**Reported:** 07/10/2024 11:10

### Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.





# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-50983

Building: Early Childhood Center & Administration

ECCA

Client:

East Islip Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush \_\_\_\_\_

EC54106

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-0832	CR	New Construction	Room 133	DW	6/13/2024	6:28:00 AM
EIUFSD-0834	CR	New Construction	Room 134	DW	6/13/2024	6:27:00 AM
EIUFSD-0836	CR	New Construction	Room 132	DW	6/13/2024	6:25:00 AM
EIUFSD-0838	CR	New Construction	Room 131	DW	6/13/2024	6:26:00 AM
EIUFSD-0841	CR	New Construction	Room 130	DW	6/13/2024	6:24:00 AM
EIUFSD-0843	CR	New Construction	Room 128	DW	6/13/2024	6:34:00 AM
EIUFSD-0845	CR	New Construction	Room 127	DW	6/13/2024	6:32:00 AM
EIUFSD-0849	CR	New Construction	Room 126	DW	6/13/2024	6:35:00 AM
EIUFSD-0851	CR	New Construction	Room 125	DW	6/13/2024	6:33:00 AM
EIUFSD-0853	CR	New Construction	Room 123	DW	6/13/2024	6:37:00 AM
EIUFSD-0855	CR	New Construction	Room 124	DW	6/13/2024	6:38:00 AM
EIUFSD-0857	CR	New Construction	Room 121	DW	6/13/2024	6:41:00 AM
EIUFSD-0859	CR	New Construction	Room 122	DW	6/13/2024	6:40:00 AM
EIUFSD-0897	OF	1012	Custodial Office	BWH	6/13/2024	7:30:00 AM
EIUFSD-0898	OF	1012	Custodial Office	BWC	6/13/2024	7:30:00 AM
EIUFSD-0905	KI	1019B	Kitchen	HW	6/14/2024	7:13:00 AM
EIUFSD-0906	KI	1019B	Kitchen	KC	6/13/2024	6:48:00 AM
EIUFSD-0907	KI	1019B	Kitchen	KC	6/13/2024	6:48:00 AM

## Building Address

1 Craig B. Gariepy avenue

Islip Terrace, NY 11752

Analysis Type: ELAP 200.5

Lab Received:

Signature:


6/19/24 1:09 PM

Samplers Name: Tara Ricker

Samplers Signature:

JCB Project Manager: Tara Ricker





# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-50983

Building: Early Childhood Center & Administration

EC54106

Client:

East Islip Union Free School District

Retest/New Install [ ]

Turn Around: (Normal 1 wk) Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-0908	KI	1019B	Kitchen	HW	6/13/2024	6:49:00 AM
EIUFSD-0909	KI	1019B	Kitchen	KC	6/13/2024	6:47:00 AM
EIUFSD-0924	OF	1024	Room 110 Computer Services	BWH	6/13/2024	7:10:00 AM
EIUFSD-0925	OF	1024	Room 110 Computer Services	BWC	6/13/2024	7:10:00 AM
EIUFSD-0930	OF	1027	Room 107	BWH	6/13/2024	7:03:00 AM
EIUFSD-0931	OF	1027	Room 107	BWC	6/13/2024	7:03:00 AM
EIUFSD-0936	FL	1035B	Terrace Room (Faculty Room)	KC	6/13/2024	6:44:00 AM
EIUFSD-0944	OF	2000B	Conference Room	BWH	6/13/2024	7:13:00 AM
EIUFSD-0945	OF	2000B	Conference Room	BWC	6/13/2024	7:13:00 AM
EIUFSD-0948	OF	2009A	Conference Room A	KC	6/13/2024	7:00:00 AM
EIUFSD-0955	HA	2027	2nd Floor Corridor (Across Administration Reception - 2012)	BW	6/13/2024	7:20:00 AM
EIUFSD-0963	OF	2017A	Buildings & Grounds Office	BW	6/13/2024	7:24:00 AM
EIUFSD-0966	OF	2022A	Break Room	BWH	6/13/2024	7:25:00 AM
EIUFSD-0967	OF	2022A	Break Room	BWC	6/13/2024	7:25:00 AM
EIUFSD-1339	OF	1026	Tech Services	BWH	6/13/2024	7:05:00 AM
EIUFSD-1340	OF	1026	Tech Services	BWC	6/13/2024	7:05:00 AM
EIUFSD-1729	OF	New Construction	Office in Lobby	BW	6/13/2024	6:30:00 AM
EIUFSD-1730	OF	New Construction	Office in Lobby	BW	6/13/2024	6:30:00 AM

## Building Address

1 Craig B. Gariepy avenue  
Islip Terrace, NY 11752

Analysis Type: ELAP 200.5

Lab Received:


Signature:

6/19/24 1:09 pm

Samplers Name: Tara Ricker

Samplers Signature: *Tara Ricker*

JCB Project Manager: Tara Ricker



# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-50983

Building: Early Childhood Center & Administration

EC54106  
ECCA

Client:

East Islip Union Free School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-1736	OF	1023	Room 109	BW	6/13/2024	7:10:00 AM
EIUFSD-1737	OF	1023	Room 109	BW	6/13/2024	7:03:00 AM
EIUFSD-1751	FL	2018A	Lunch Room	KC	6/13/2024	7:21:00 AM
EIUFSD-1752	FL	2018A	Lunch Room	SN	6/13/2024	7:22:00 AM
EIUFSD-1753	OF	2021E	Special Education Side Office	BW	6/13/2024	7:24:00 AM
EIUFSD-1765	EX	New Construction	New Field House Exterior	WC	6/13/2024	7:38:00 AM
EIUFSD-1766	EX	New Construction	New Field House Exterior	WF	6/13/2024	7:39:00 AM
EIUFSD-1767	EX	New Construction	New Field House Exterior	WC	6/13/2024	7:38:00 AM

Samples Submitted 44

RECEIVED  
ENSL ANALYTICAL INC.  
CARLE PLACE, NY  
2024 JUN 19 P 1:09

## Building Address

1 Craig B. Gariepy avenue  
Islip Terrace, NY 11752

Analysis Type: ELAP 200.5

Lab Received: A. Minniford

Signature: A. Minniford  
6/19/24 1:09 pm

Samplers Name: Tara Ricker

Samplers Signature: Tara Ricker

JCB Project Manager: Tara Ricker

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454106  
**LIMS Reference ID:** EC54106  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** 22-50983, Early Childhood Center &  
Administration, ECCA, East Islip Union Free  
School District, 1 Craig B. Garipey Avenue Islip  
Terrace, NY 11752  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:09  
**Reported:** 07/10/2024 10:58

**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD- 0832</b> <b>Lims Reference ID: EC54106-01</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:26	07/09/24 12:26	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0834</b> <b>Lims Reference ID: EC54106-02</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	2.5		1	1.0	µg/L	07/09/24 12:33	07/09/24 12:33	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0836</b> <b>Lims Reference ID: EC54106-03</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:35	07/09/24 12:35	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0838</b> <b>Lims Reference ID: EC54106-04</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	3.0		1	1.0	µg/L	07/09/24 12:36	07/09/24 12:36	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0841</b> <b>Lims Reference ID: EC54106-05</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:37	07/09/24 12:37	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0843</b> <b>Lims Reference ID: EC54106-06</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:42	07/09/24 12:42	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0845</b> <b>Lims Reference ID: EC54106-07</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:43	07/09/24 12:43	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0849</b> <b>Lims Reference ID: EC54106-08</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	3.7		3	3.0	µg/L	07/09/24 13:30	07/09/24 13:30	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0851</b> <b>Lims Reference ID: EC54106-09</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:45	07/09/24 12:45	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454106  
**LIMS Reference ID:** EC54106  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

22-50983, Early Childhood Center &  
Administration, ECCA, East Islip Union Free  
School District, 1 Craig B. Garipey Avenue Islip  
Terrace, NY 11752

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:09

**Reported:**

07/10/2024 10:58

### Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD- 0853 <b>Lims Reference ID:</b> EC54106-10 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/19/24 00:00:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:47	07/09/24 12:47	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD- 0855 <b>Lims Reference ID:</b> EC54106-11 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/19/24 00:00:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:48	07/09/24 12:48	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD- 0857 <b>Lims Reference ID:</b> EC54106-12 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/19/24 00:00:00									
<b>Metals</b>									
Lead	1.2		1	1.0	µg/L	07/09/24 12:52	07/09/24 12:52	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD- 0859 <b>Lims Reference ID:</b> EC54106-13 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/19/24 00:00:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:53	07/09/24 12:53	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD- 0897 <b>Lims Reference ID:</b> EC54106-14 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/19/24 00:00:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:57	07/09/24 12:57	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD- 0898 <b>Lims Reference ID:</b> EC54106-15 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/19/24 00:00:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/09/24 12:58	07/09/24 12:58	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD- 0905 <b>Lims Reference ID:</b> EC54106-16 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/19/24 00:00:00									
<b>Metals</b>									
Lead	65.3		3	3.0	µg/L	07/09/24 13:32	07/09/24 13:32	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD- 0906 <b>Lims Reference ID:</b> EC54106-17 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/19/24 00:00:00									
<b>Metals</b>									
Lead	32.7		3	3.0	µg/L	07/09/24 13:33	07/09/24 13:33	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD- 0907 <b>Lims Reference ID:</b> EC54106-18 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/19/24 00:00:00									
<b>Metals</b>									
Lead	64.9		10	10.0	µg/L	07/09/24 13:42	07/09/24 13:42	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454106  
**LIMS Reference ID:** EC54106  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** 22-50983, Early Childhood Center &  
Administration, ECCA, East Islip Union Free  
School District, 1 Craig B. Garipey Avenue Islip  
Terrace, NY 11752  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:09  
**Reported:** 07/10/2024 10:58

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD- 0908</b> <b>Lims Reference ID: EC54106-19</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	51.0		3	3.0	µg/L	07/09/24 13:36	07/09/24 13:36	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0909</b> <b>Lims Reference ID: EC54106-20</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	2.0		1	1.0	µg/L	07/09/24 13:37	07/09/24 13:37	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0924</b> <b>Lims Reference ID: EC54106-21</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:03	07/05/24 12:03	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0925</b> <b>Lims Reference ID: EC54106-22</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:10	07/05/24 12:10	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0930</b> <b>Lims Reference ID: EC54106-23</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:11	07/05/24 12:11	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0931</b> <b>Lims Reference ID: EC54106-24</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:12	07/05/24 12:12	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0936</b> <b>Lims Reference ID: EC54106-25</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	2.2		1	1.0	µg/L	07/05/24 12:13	07/05/24 12:13	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0944</b> <b>Lims Reference ID: EC54106-26</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:15	07/05/24 12:15	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0945</b> <b>Lims Reference ID: EC54106-27</b> <b>Matrix: Drinking Water</b> <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:16	07/05/24 12:16	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454106**LIMS Reference ID:** EC54106**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

22-50983, Early Childhood Center &  
Administration, ECCA, East Islip Union Free  
School District, 1 Craig B. Garipey Avenue Islip  
Terrace, NY 11752

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:09

**Reported:**

07/10/2024 10:58

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD- 0948</b> Lims Reference ID: EC54106-28 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	3.4		1	1.0	µg/L	07/05/24 12:17	07/05/24 12:17	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0955</b> Lims Reference ID: EC54106-29 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:18	07/05/24 12:18	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0963</b> Lims Reference ID: EC54106-30 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:20	07/05/24 12:20	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0966</b> Lims Reference ID: EC54106-31 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:24	07/05/24 12:24	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 0967</b> Lims Reference ID: EC54106-32 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:27	07/05/24 12:27	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1339</b> Lims Reference ID: EC54106-33 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:29	07/05/24 12:29	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1340</b> Lims Reference ID: EC54106-34 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:30	07/05/24 12:30	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1729</b> Lims Reference ID: EC54106-35 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:31	07/05/24 12:31	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1730</b> Lims Reference ID: EC54106-36 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:32	07/05/24 12:32	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454106**LIMS Reference ID:** EC54106**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

22-50983, Early Childhood Center &  
Administration, ECCA, East Islip Union Free  
School District, 1 Craig B. Garipey Avenue Islip  
Terrace, NY 11752

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:09

**Reported:**

07/10/2024 10:58

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD- 1736</b> Lims Reference ID: EC54106-37 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:34	07/05/24 12:34	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1737</b> Lims Reference ID: EC54106-38 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 12:35	07/05/24 12:35	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1751</b> Lims Reference ID: EC54106-39 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	1.7		1	1.0	µg/L	07/05/24 12:39	07/05/24 12:39	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1752</b> Lims Reference ID: EC54106-40 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	1.2		1	1.0	µg/L	07/05/24 12:40	07/05/24 12:40	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1753</b> Lims Reference ID: EC54106-41 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:44	07/03/24 15:44	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1765</b> Lims Reference ID: EC54106-42 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:48	07/03/24 15:48	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1766</b> Lims Reference ID: EC54106-43 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:49	07/03/24 15:49	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD- 1767</b> Lims Reference ID: EC54106-44 Matrix: Drinking Water <b>Sampled: 06/19/24 00:00:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 15:51	07/03/24 15:51	BP	EPA 200.8 (DA)/EPA 200.8



**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454106**LIMS Reference ID:** EC54106**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

22-50983, Early Childhood Center &  
Administration, ECCA, East Islip Union Free  
School District, 1 Craig B. Garipey Avenue Islip  
Terrace, NY 11752

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:09

**Reported:**

07/10/2024 10:58

**Certified Analyses included in this Report**

Analyte	Certifications
<b><i>EPA 200.8 in Drinking Water</i></b>	
Lead	06-NYSELAP

**List of Certifications**

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on [www.emsl.com](http://www.emsl.com) <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454106**LIMS Reference ID:** EC54106**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

22-50983, Early Childhood Center &  
Administration, ECCA, East Islip Union Free  
School District, 1 Craig B. Garipey Avenue Islip  
Terrace, NY 11752

**Customer PO:**

Jeromy Bish

**EMSL Sales Rep:****Received:**

06/19/2024 13:09

**Reported:**

07/10/2024 10:58


**Notes and Definitions**

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-50983  
Building: Connetquot Elementary School  
CES

Client:  
East Islip Union Free School District

Retest/New Install [ ]  
Turn Around: Normal 1 wk Rush \_\_\_\_\_

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-0983	CR	New Construction	Room 134 (All Purpose Room)	DW	6/14/2024	6:57:00 AM
EIUFSD-0995	HA	New Construction	Corridor New Construction Bathrooms to Library (Across Main Office)	WF	6/14/2024	6:55:00 AM
EIUFSD-1003	CA	1000	Cafeteria	WF	6/14/2024	6:35:00 AM
EIUFSD-1005	KI	1000C	Kitchen	KC	6/14/2024	6:37:00 AM
EIUFSD-1006	KI	1000C	Kitchen	KC	6/14/2024	6:36:00 AM
EIUFSD-1007	KI	1000C	Kitchen	HW	6/14/2024	6:37:00 AM
EIUFSD-1008	KI	1000C	Kitchen	KC	6/14/2024	6:37:00 AM
EIUFSD-1009	KI	1000C	Kitchen	PK	6/14/2024	6:38:00 AM
EIUFSD-1011	NO	1007	Nurse's General Office	NS	6/14/2024	6:41:00 AM
EIUFSD-1017	HA	1018A	Corridor Room 102 to Nurse's Office (Adjacent to Girl's Bathroom [Near Room 113] - 1034)	WF	6/14/2024	6:40:00 AM
EIUFSD-1028	OF	1015	Room 100	BWH	6/14/2024	6:46:00 AM
EIUFSD-1029	OF	1015	Room 100	BWC	6/14/2024	6:46:00 AM
EIUFSD-1042	NO	1007	Nurse's General Office	BWH	6/14/2024	6:42:00 AM
EIUFSD-1043	NO	1007	Nurse's General Office	BWC	6/14/2024	6:42:00 AM

Samples Submitted 14

RECEIVED  
JUL 19 2024  
EAST ISLIP UNION FREE SCHOOL DISTRICT  
P 1:07

## Building Address

1 Merrick Street  
Islip Terrace, NY 11752

Analysis Type: ELAP 200.5

Lab Received: 6/19/24 13:07

Signature: *[Signature]*

Samplers Name: Tara Ricker

Samplers Signature: *[Signature]*

JCB Project Manager: Tara Ricker

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454121  
**LIMS Reference ID:** EC54121  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** Connetquot Elementary School: 1 Merrick Street, Islip Terrace, NY 11752: East Islip Union Free School District: Project# 22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:07  
**Reported:** 07/10/2024 11:16

**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD-0983</b> Lims Reference ID: EC54121-01 Matrix: Drinking Water <b>Sampled: 06/14/24 06:57:00</b>									
<b>Metals</b>									
Lead	5.0		1	1.0	µg/L	07/05/24 15:23	07/05/24 15:23	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-0995</b> Lims Reference ID: EC54121-02 Matrix: Drinking Water <b>Sampled: 06/14/24 06:55:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:24	07/05/24 15:24	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1003</b> Lims Reference ID: EC54121-03 Matrix: Drinking Water <b>Sampled: 06/14/24 06:35:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:25	07/05/24 15:25	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1005</b> Lims Reference ID: EC54121-04 Matrix: Drinking Water <b>Sampled: 06/14/24 06:37:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:27	07/05/24 15:27	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1006</b> Lims Reference ID: EC54121-05 Matrix: Drinking Water <b>Sampled: 06/14/24 06:36:00</b>									
<b>Metals</b>									
Lead	1.2		1	1.0	µg/L	07/05/24 15:28	07/05/24 15:28	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1007</b> Lims Reference ID: EC54121-06 Matrix: Drinking Water <b>Sampled: 06/14/24 06:37:00</b>									
<b>Metals</b>									
Lead	11.1		1	1.0	µg/L	07/05/24 15:32	07/05/24 15:32	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1008</b> Lims Reference ID: EC54121-07 Matrix: Drinking Water <b>Sampled: 06/14/24 06:37:00</b>									
<b>Metals</b>									
Lead	2.9		1	1.0	µg/L	07/05/24 15:36	07/05/24 15:36	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1009</b> Lims Reference ID: EC54121-08 Matrix: Drinking Water <b>Sampled: 06/14/24 06:38:00</b>									
<b>Metals</b>									
Lead	62.2		1	1.0	µg/L	07/05/24 15:37	07/05/24 15:37	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1011</b> Lims Reference ID: EC54121-09 Matrix: Drinking Water <b>Sampled: 06/14/24 06:41:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:39	07/05/24 15:39	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454121  
**LIMS Reference ID:** EC54121  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** Connetquot Elementary School: 1 Merrick Street, Islip Terrace, NY 11752: East Islip Union Free School District: Project# 22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:07  
**Reported:** 07/10/2024 11:16

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample:</b> EIUFSD-1017 <b>Lims Reference ID:</b> EC54121-10 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/14/24 06:40:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:40	07/05/24 15:40	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1028 <b>Lims Reference ID:</b> EC54121-11 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/14/24 06:46:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:41	07/05/24 15:41	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1029 <b>Lims Reference ID:</b> EC54121-12 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/14/24 06:46:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:43	07/05/24 15:43	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1042 <b>Lims Reference ID:</b> EC54121-13 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/14/24 06:42:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:44	07/05/24 15:44	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample:</b> EIUFSD-1043 <b>Lims Reference ID:</b> EC54121-14 <b>Matrix:</b> Drinking Water <b>Sampled:</b> 06/14/24 06:42:00									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 15:45	07/05/24 15:45	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454121**LIMS Reference ID:** EC54121**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

Connetquot Elementary School: 1 Merrick  
Street, Islip Terrace, NY 11752: East Islip  
Union Free School District: Project#  
22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:07

**Reported:**

07/10/2024 11:16

**Certified Analyses included in this Report**

Analyte	Certifications
<b><i>EPA 200.8 in Drinking Water</i></b>	
Lead	06-NYSELAP

**List of Certifications**

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on [www.emsl.com](http://www.emsl.com) <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454121  
**LIMS Reference ID:** EC54121  
**EMSL Customer ID:** JCBR50

**Attention:** Tara Ricker  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:** Connetquot Elementary School: 1 Merrick Street, Islip Terrace, NY 11752: East Islip Union Free School District: Project# 22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:07  
**Reported:** 07/10/2024 11:16


### Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-50983

Building: Timber Point Elementary School

TPES

Client:

East Islip Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush \_\_\_\_\_

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-1106	CR	1010	All Purpose Room	KC	6/11/2024	7:00:00 AM
EIUFSD-1107	CR	1010	All Purpose Room	SN	6/11/2024	7:00:00 AM
EIUFSD-1146	NO	1045A	Nurse's Suite Office	NS	6/11/2024	6:48:00 AM
EIUFSD-1152	HA	1038	1st Floor Corridor Lobby To Storage (Across Counselor's Office - 1034)	WF	6/11/2024	6:45:00 AM
EIUFSD-1157	KI	1032	Kitchen	KC	6/11/2024	6:42:00 AM
EIUFSD-1158	KI	1032	Kitchen	PK	6/11/2024	6:39:00 AM
EIUFSD-1159	KI	1032	Kitchen	KC	6/11/2024	6:38:00 AM
EIUFSD-1160	KI	1032	Kitchen	KC	6/11/2024	6:38:00 AM
EIUFSD-1161	KI	1032	Kitchen	KC	6/11/2024	6:37:00 AM
EIUFSD-1162	KI	1032	Kitchen	HW	6/11/2024	6:36:00 AM
EIUFSD-1190	HA	2027	2nd Floor Corridor (Across Room 204 - 2006)	WF	6/11/2024	7:09:00 AM
EIUFSD-1327	HA	New Construction	1st Floor New Construction Library to Room 98 (Across Staff Bathrooms)	WF	6/11/2024	6:51:00 AM
EIUFSD-1329	CA	1031	Auditorium/Cafeteria	WF	6/11/2024	6:43:00 AM
EIUFSD-1880	NO	1045	Nurse's Suite	BWH	6/11/2024	6:47:00 AM
EIUFSD-1881	NO	1045	Nurse's Suite	BWC	6/11/2024	6:47:00 AM

2024 JUN 11 PM 1:05  
JCB  
631-584-5492  
631-584-3395



## Building Address

200 Timber Point Road

East Islip, NY 11730

Analysis Type: ELAP 200.5

Lab Received: 6/19/24 13:00


Signature: [Signature] KARLYN WAGNER

Samplers Name: Tara Ricker

Samplers Signature: [Signature]

JCB Project Manager: Tara Ricker





# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-50983

Building: Timber Point Elementary School

TPES

Client:

East Islip Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush         

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 15

RECEIVED  
EMSL ANALYTICAL, INC.  
CARLE PLACE, NY  
2024 JUN 19 PM 1:06

## Building Address

200 Timber Point Road  
East Islip, NY 11730

Analysis Type: ELAP 200.5

Lab Received: 6/19/24 13:06

Signature: KARLYN WAGNER

Samplers Name: Tara Ricker

Samplers Signature: Tara Ricker

JCB Project Manager: Tara Ricker

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454172**LIMS Reference ID:** EC54172**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

Timber Point Elementary School; 200 Timber  
Point Road, East Islip, NY 11730; East Islip  
Union Free School District; Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:06

**Reported:**

07/05/2024 15:04

**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD-1106</b> Lims Reference ID: EC54172-01 Matrix: Drinking Water <b>Sampled: 06/11/24 07:00:00</b>									
<b>Metals</b>									
Lead	3.0		1	1.0	µg/L	07/05/24 14:16	07/05/24 14:16	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1107</b> Lims Reference ID: EC54172-02 Matrix: Drinking Water <b>Sampled: 06/11/24 07:00:00</b>									
<b>Metals</b>									
Lead	10.4		1	1.0	µg/L	07/05/24 14:17	07/05/24 14:17	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1146</b> Lims Reference ID: EC54172-03 Matrix: Drinking Water <b>Sampled: 06/11/24 06:48:00</b>									
<b>Metals</b>									
Lead	2.4		1	1.0	µg/L	07/05/24 14:18	07/05/24 14:18	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1152</b> Lims Reference ID: EC54172-04 Matrix: Drinking Water <b>Sampled: 06/11/24 06:45:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 14:20	07/05/24 14:20	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1157</b> Lims Reference ID: EC54172-05 Matrix: Drinking Water <b>Sampled: 06/11/24 06:42:00</b>									
<b>Metals</b>									
Lead	15.5		1	1.0	µg/L	07/05/24 14:21	07/05/24 14:21	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1158</b> Lims Reference ID: EC54172-06 Matrix: Drinking Water <b>Sampled: 06/11/24 06:39:00</b>									
<b>Metals</b>									
Lead	45.5		1	1.0	µg/L	07/05/24 14:22	07/05/24 14:22	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1159</b> Lims Reference ID: EC54172-07 Matrix: Drinking Water <b>Sampled: 06/11/24 06:38:00</b>									
<b>Metals</b>									
Lead	3.9		1	1.0	µg/L	07/05/24 14:26	07/05/24 14:26	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1160</b> Lims Reference ID: EC54172-08 Matrix: Drinking Water <b>Sampled: 06/11/24 06:38:00</b>									
<b>Metals</b>									
Lead	9.3		1	1.0	µg/L	07/05/24 14:27	07/05/24 14:27	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1161</b> Lims Reference ID: EC54172-09 Matrix: Drinking Water <b>Sampled: 06/11/24 06:37:00</b>									
<b>Metals</b>									
Lead	15.7		1	1.0	µg/L	07/05/24 14:31	07/05/24 14:31	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454172**LIMS Reference ID:** EC54172**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

Timber Point Elementary School; 200 Timber  
Point Road, East Islip, NY 11730; East Islip  
Union Free School District; Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:06

**Reported:**

07/05/2024 15:04

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD-1162</b> Lims Reference ID: EC54172-10 Matrix: Drinking Water <b>Sampled: 06/11/24 06:36:00</b>									
<b>Metals</b>									
Lead	17.0		1	1.0	µg/L	07/05/24 14:33	07/05/24 14:33	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1190</b> Lims Reference ID: EC54172-11 Matrix: Drinking Water <b>Sampled: 06/11/24 07:09:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 14:34	07/05/24 14:34	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1327</b> Lims Reference ID: EC54172-12 Matrix: Drinking Water <b>Sampled: 06/11/24 06:51:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 14:35	07/05/24 14:35	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1329</b> Lims Reference ID: EC54172-13 Matrix: Drinking Water <b>Sampled: 06/11/24 06:43:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 14:37	07/05/24 14:37	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1880</b> Lims Reference ID: EC54172-14 Matrix: Drinking Water <b>Sampled: 06/11/24 06:47:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 14:38	07/05/24 14:38	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1881</b> Lims Reference ID: EC54172-15 Matrix: Drinking Water <b>Sampled: 06/11/24 06:47:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/05/24 14:39	07/05/24 14:39	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454172**LIMS Reference ID:** EC54172**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

Timber Point Elementary School; 200 Timber  
Point Road, East Islip, NY 11730; East Islip  
Union Free School District; Project# 22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:06

**Reported:**

07/05/2024 15:04

**Certified Analyses included in this Report**

Analyte	Certifications
<b><i>EPA 200.8 in Drinking Water</i></b>	
Lead	06-NYSELAP

**List of Certifications**

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on [www.emsl.com](http://www.emsl.com) <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454172**LIMS Reference ID:** EC54172**EMSL Customer ID:** JCBR50**Attention:** Tara Ricker

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
tricker@jcbroderick.com

**Project Name:**

Timber Point Elementary School; 200 Timber  
Point Road, East Islip, NY 11730; East Islip  
Union Free School District; Project# 22-50983

**Customer PO:**

Jeromy Bish

**EMSL Sales Rep:****Received:**

06/19/2024 13:06

**Reported:**

07/05/2024 15:04

**Notes and Definitions**

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



# Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.  
1775 Expressway North Hauppauge, NY 11788  
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-50983

Building: John F. Kennedy Elementary School

JFKES

Client:

East Islip Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush \_\_\_\_\_

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EIUFSD-1224	CA	1001	Cafeteria	WF	6/12/2024	6:32:00 AM
EIUFSD-1226	KI	1001C	Cafeteria Kitchen	KC	6/12/2024	6:27:00 AM
EIUFSD-1227	KI	1001C	Cafeteria Kitchen	KC	6/12/2024	6:28:00 AM
EIUFSD-1228	KI	1001C	Cafeteria Kitchen	HW	6/12/2024	6:28:00 AM
EIUFSD-1239	NO	1015	Nurse's Office	NS	6/12/2024	6:38:00 AM
EIUFSD-1282	HA	2018	2nd Floor Corridor (Adjacent to ESL Room 203 - 2000)	WF	6/12/2024	6:56:00 AM
EIUFSD-1283	HA	2018	2nd Floor Corridor (Adjacent to ESL Room 203 - 2000)	WC	6/12/2024	6:56:00 AM
EIUFSD-1359	HA	1007	1st Floor Corridor Cafeteria to Women's Bathroom (Near Main Lobby - 1008)	WF	6/12/2024	6:35:00 AM
EIUFSD-1360	HA	1007	1st Floor Corridor Cafeteria to Women's Bathroom (Near Main Lobby - 1008)	WC	6/12/2024	6:34:00 AM
EIUFSD-1363	HA	New Construction	1st Floor Corridor Library to Community Room (Across Room 12)	WF	6/12/2024	6:51:00 AM
EIUFSD-1781	OF	1010	Conference Room	KC	6/12/2024	6:37:00 AM
EIUFSD-1782	NO	1015	Nurse's Office	BW	6/12/2024	6:39:00 AM
EIUFSD-1783	NO	1015	Nurse's Office	BW	6/12/2024	6:40:00 AM
EIUFSD-1784	NO	1015	Nurse's Office	BW	6/12/2024	6:40:00 AM

Samples Submitted 14

## Building Address

94 Woodland Drive  
East Islip, NY 11730

Analysis Type: ELAP 200.5

Lab Received: 6/19/24 13:06


Signature: [Signature] KARYN WAGNER

Samplers Name: Tara Ricker

Samplers Signature: [Signature]

JCB Project Manager: Tara Ricker

RECEIVED  
EHS ANALYTICAL  
CARLE PLACE  
2024 JUN 19 PM



**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454170  
**LIMS Reference ID:** EC54170  
**EMSL Customer ID:** JCBR50

**Attention:** Select Contact - JCBR50  
J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
elementsupport@emsl.com

**Project Name:** John F. Kennedy Elementary School: 94  
Woodland Drive, East Islip, NY 11730: East  
Islip Union Free School District: Project#  
22-50983  
**Customer PO:**  
**EMSL Sales Rep:** Jeromy Bish  
**Received:** 06/19/2024 13:06  
**Reported:** 07/03/2024 16:21

**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD-1224</b> Lims Reference ID: EC54170-01 Matrix: Drinking Water <b>Sampled: 06/12/24 06:32:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 08:35	07/03/24 08:35	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1226</b> Lims Reference ID: EC54170-02 Matrix: Drinking Water <b>Sampled: 06/12/24 06:27:00</b>									
<b>Metals</b>									
Lead	35.8		1	1.0	µg/L	07/03/24 08:36	07/03/24 08:36	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1227</b> Lims Reference ID: EC54170-03 Matrix: Drinking Water <b>Sampled: 06/12/24 06:28:00</b>									
<b>Metals</b>									
Lead	5.1		1	1.0	µg/L	07/03/24 08:38	07/03/24 08:38	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1228</b> Lims Reference ID: EC54170-04 Matrix: Drinking Water <b>Sampled: 06/12/24 06:28:00</b>									
<b>Metals</b>									
Lead	6.2		1	1.0	µg/L	07/03/24 08:39	07/03/24 08:39	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1239</b> Lims Reference ID: EC54170-05 Matrix: Drinking Water <b>Sampled: 06/12/24 06:38:00</b>									
<b>Metals</b>									
Lead	4.2		1	1.0	µg/L	07/03/24 08:40	07/03/24 08:40	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1282</b> Lims Reference ID: EC54170-06 Matrix: Drinking Water <b>Sampled: 06/12/24 06:56:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 08:44	07/03/24 08:44	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1283</b> Lims Reference ID: EC54170-07 Matrix: Drinking Water <b>Sampled: 06/12/24 06:56:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 08:46	07/03/24 08:46	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1359</b> Lims Reference ID: EC54170-08 Matrix: Drinking Water <b>Sampled: 06/12/24 06:35:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 08:50	07/03/24 08:50	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1360</b> Lims Reference ID: EC54170-09 Matrix: Drinking Water <b>Sampled: 06/12/24 06:34:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 08:51	07/03/24 08:51	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454170**LIMS Reference ID:** EC54170**EMSL Customer ID:** JCBR50**Attention:** Select Contact - JCBR50

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
elementsupport@emsl.com

**Project Name:**

John F. Kennedy Elementary School: 94  
Woodland Drive, East Islip, NY 11730: East  
Islip Union Free School District: Project#  
22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:06

**Reported:**

07/03/2024 16:21

**Analytical Results**  
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
<b>Sample: EIUFSD-1363</b> Lims Reference ID: EC54170-10 Matrix: Drinking Water <b>Sampled: 06/12/24 06:51:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 08:52	07/03/24 08:52	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1781</b> Lims Reference ID: EC54170-11 Matrix: Drinking Water <b>Sampled: 06/12/24 06:37:00</b>									
<b>Metals</b>									
Lead	8.1		1	1.0	µg/L	07/03/24 08:54	07/03/24 08:54	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1782</b> Lims Reference ID: EC54170-12 Matrix: Drinking Water <b>Sampled: 06/12/24 06:39:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 08:55	07/03/24 08:55	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1783</b> Lims Reference ID: EC54170-13 Matrix: Drinking Water <b>Sampled: 06/12/24 06:40:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 08:56	07/03/24 08:56	BP	EPA 200.8 (DA)/EPA 200.8
<b>Sample: EIUFSD-1784</b> Lims Reference ID: EC54170-14 Matrix: Drinking Water <b>Sampled: 06/12/24 06:40:00</b>									
<b>Metals</b>									
Lead	<1.0		1	1.0	µg/L	07/03/24 08:57	07/03/24 08:57	BP	EPA 200.8 (DA)/EPA 200.8



**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454170**LIMS Reference ID:** EC54170**EMSL Customer ID:** JCBR50**Attention:** Select Contact - JCBR50

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
elementsupport@emsl.com

**Project Name:**

John F. Kennedy Elementary School: 94  
Woodland Drive, East Islip, NY 11730: East  
Islip Union Free School District: Project#  
22-50983

**Customer PO:****EMSL Sales Rep:**

Jeromy Bish

**Received:**

06/19/2024 13:06

**Reported:**

07/03/2024 16:21

**Certified Analyses included in this Report**

Analyte	Certifications
<b><i>EPA 200.8 in Drinking Water</i></b>	
Lead	06-NYSELAP

**List of Certifications**

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on [www.emsl.com](http://www.emsl.com) <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514  
Telephone: 516.997.7251 Fax: 856-786-5974  
EMSL-CP-06

**EMSL Order ID:** 062454170**LIMS Reference ID:** EC54170**EMSL Customer ID:** JCBR50**Attention:** Select Contact - JCBR50

J.C. Broderick & Associates [JCBR50]  
1775 Expressway Drive North, Suite 1  
Hauppauge, NY 11788  
(631) 584-5492  
elementsupport@emsl.com

**Project Name:**

John F. Kennedy Elementary School: 94  
Woodland Drive, East Islip, NY 11730: East  
Islip Union Free School District: Project#  
22-50983

**Customer PO:****EMSL Sales Rep:****Received:****Reported:**

Jeromy Bish

06/19/2024 13:06

07/03/2024 16:21

**Notes and Definitions**

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.

## Attachment 4:

## Laboratory Certifications


**J.C. Broderick & Associates, Inc.**

*Environmental Consulting & Testing*

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

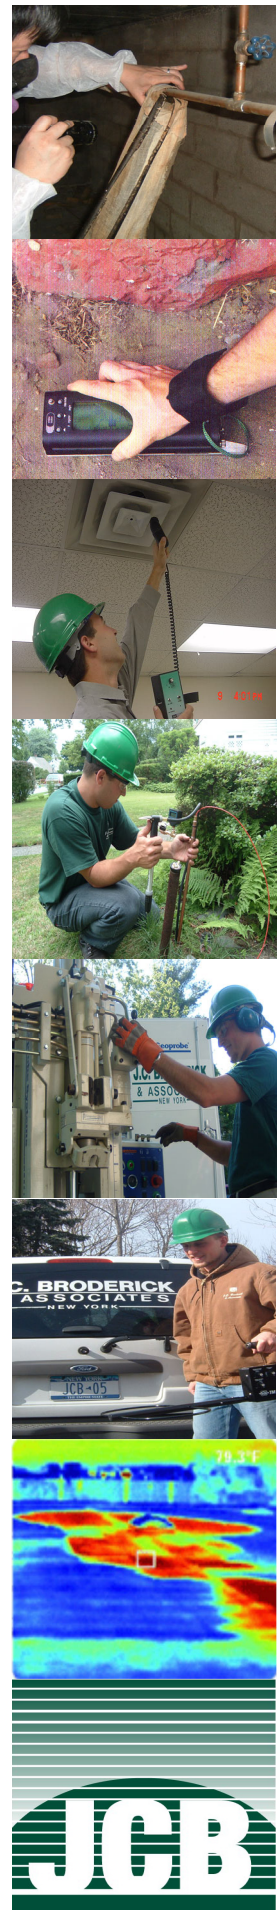

NEW YORK STATE DEPARTMENT OF HEALTH  
WADSWORTH CENTER



Expires 12:01 AM April 01, 2025  
Issued April 01, 2024

**CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE**

*Issued in accordance with and pursuant to section 502 Public Health Law of New York State*

MR. DANIEL CLARKE  
EMSL ANALYTICAL, INC.  
528 MINEOLA AVE.  
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the  
National Environmental Laboratory Accreditation Conference Standards (2016) for the category  
ENVIRONMENTAL ANALYSES POTABLE WATER  
All approved analytes are listed below:*

**Bacteriology**

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Heterotrophic Plate Count	SM 20, 21-23 9215B (-04)

**Metals I**

Lead, Total	EPA 200.5 EPA 200.8 Rev. 5.4
-------------	---------------------------------

**Miscellaneous**

Asbestos	EPA 100.2
----------	-----------



Serial No.: 68787

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at <https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/>, by phone (518) 485-5570 or by email to [elap@health.ny.gov](mailto:elap@health.ny.gov).

