

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



August 1, 2025

Mr. Russ Costa
Seaford Union Free School District
Administrative Building
1600 Washington Avenue
Seaford, New York 11783

Re: **Lead Testing in School Drinking Water
Remedial Action Plan
2023-2025 Compliance 10 NYCRR Subpart 67-4**

JCB#: **22-53407**

Dear Mr. Costa:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 5 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead in Water Remediation Plan
Attachment 2: Outlet Inventory and Lead Testing Results
Attachment 3: Laboratory Analytical Reports
Attachment 4: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.

Sincerely,

Paul J. Fazio

Paul J. Fazio

J.C. BRODERICK & ASSOCIATES, INC.

Attachment 1:

Lead in Water
Remediation Plan


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

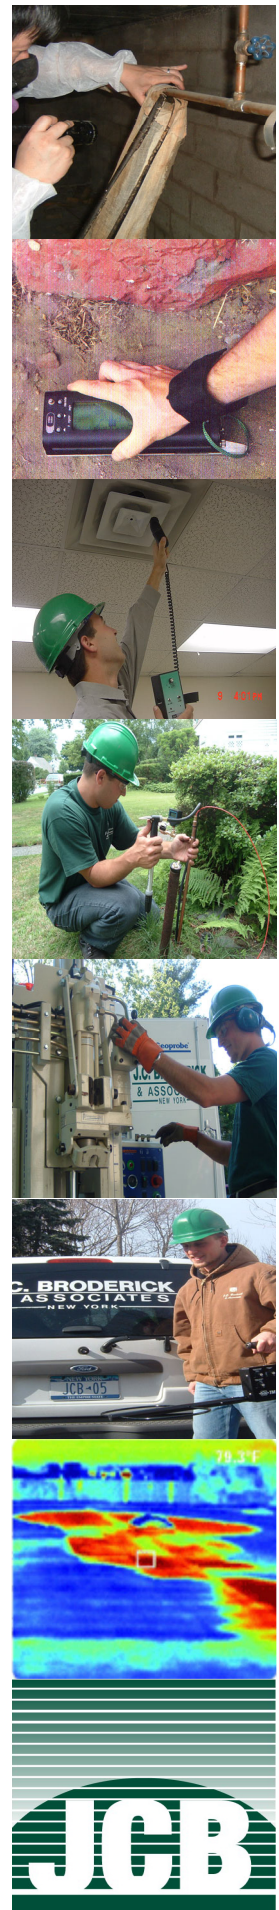

Lead in Water Remediation Plan

Section 67-4.4 Response of the New York State Department of Health (NYS DOH) Title 10 of the Official Compilation of the Codes, Rules and Regulations of the State of New York requires:

If the lead concentration of water at an outlet exceeds the action level, the school shall:

(a) prohibit use of the outlet until:

(1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and

(2) test results indicate that the lead levels are at or below the action level;

As historical sampling results have indicated, the concentrations of lead are more likely attributable to the individual fixtures and/or their immediately adjoining plumbing, and not with the building-wide plumbing. Based upon this information, the following remedial steps are recommended:

Step 1A: Potable Outlets (Outlets intended to be used for drinking/cooking)

Immediately remove the fixture from service. If necessary, provide an adequate supply of potable water for drinking/cooking to this location at no cost to the occupants. If an outlet is seldomly used or is unnecessary, the district may consider permanent removal of the outlet and capping of its supply line.

Step 1B: Non-Potable Outlets (Outlets not intended for drinking/cooking)


See Step 1A OR Placard the outlet for non-drinking use. Signs must be clearly visible and in close proximity to the affected outlet. Example signage is provided at: https://www.health.ny.gov/environmental/water/drinking/lead/docs/donotdrinksigns_lead.pdf.



Do not use for drinking



Hand washing only

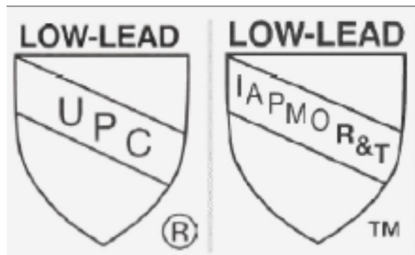

Step 2: Service & Repair or Outlet Replacement

The school district's plumber should evaluate the outlet to determine if any components require service or repair. Depending on the extent of service/repair necessary, age of the fixture, and or overall costs, the district may consider replacing the outlet entirely. Any newly installed components shall be certified lead free. (i.e. NSF/ANSI 61, NSF/ANSI-273). If servicing involves installing/replacing a point-of-use filtration system, this filter shall be certified for its lead reduction capability (i.e. NSF/ANSI 53). Follow all manufacturer's instructions for all component installations. OUTLET RESTRICTIONS MUST REMAIN IN PLACE UNTIL SATISFACTORY TEST RESULTS ARE RECEIVED. See Step 3.

Step 3: Retesting & Return to Service

Schedule a retest of the outlet. Outlet restrictions must remain in place until lead testing results at or below the action level are received. Once satisfactory results are received, the outlet may be returned to normal service. Note: It is recommended that "Do Not Drink" signage remain in place for all non-potable and non-applicable outlet types.

Attachment 2:

Outlet Inventory and
Lead Testing Results


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

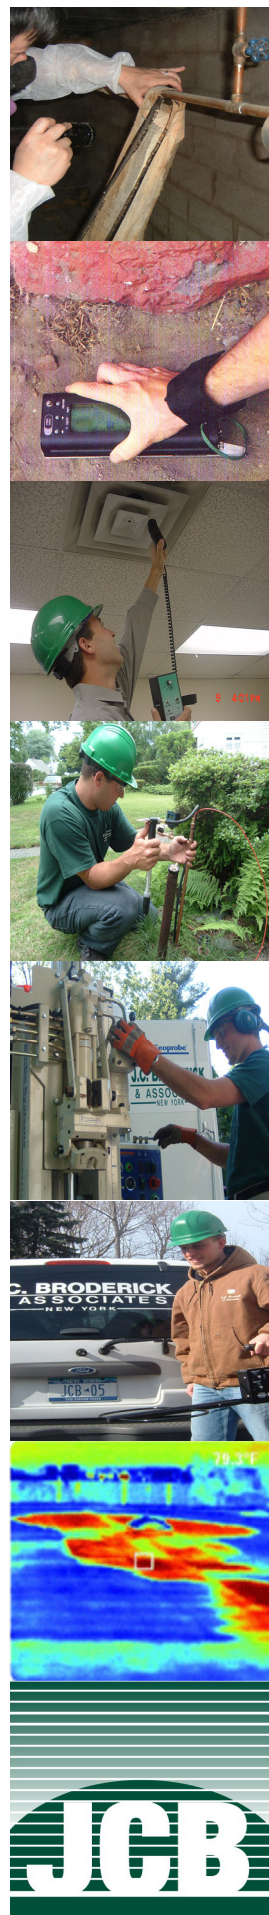



Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53407

Seaford Union Free School District

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0001	Maintenance Room	1018	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0002	Maintenance Room	1018	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0003	Maintenance Room	1018	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0004	Maintenance Room	1018	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0005	Maintenance Room Bathroom	1018A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0006	Maintenance Room	1018	Bottled Water Dispenser	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0007	Maintenance Room	1018	Bottled Water Dispenser	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0008	Outside Wrestling Room	1023	Water Cooler	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0009	Outside Auditorium	2208	Water Cooler	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0010	Custodial Closet	2211	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0011	Men's Bathroom	2210	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0012	Women's Bathroom	2209	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0016	Main Office Bathroom	2201	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0017	Outside Boiler Room	2180	Water Cooler	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0018	Shop Room 104	2153	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0019	Shop Room 104	2153	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0020	Dark Room	2155	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0021	Dark Room	2155	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0022	Woodshoop Room 103	2158	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0023	Room 102	2161	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0024	Room 102	2161	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0025	Room 102	2161	Water Fountain-No Chiller	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0026	Autobody Shop Room 101	2163	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0027	Autobody Shop Room 101	2163	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0029	Restroom Left	2168	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0030	Restroom Left	2168	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0031	Restroom Right	2169	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0032	Restroom Right	2169	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0033	Band Room	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0034	Across Room 103	2180	Water Fountain-No Chiller	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0035	Special Education Office Nook	2171	Kitchen Faucet (Cold)	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0037	Faculty Lounge	2119	Kitchen Faucet (Cold)	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0039	Faculty Bathroom	2111	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0042	Boy's Bathroom	2125	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0043	Boy's Bathroom	2125	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0044	Boy's Bathroom	2125	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0045	Boy's Bathroom	2125	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0046	Boy's Bathroom	2125	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0047	Boy's Bathroom	2125	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0048	Boy's Bathroom	2125	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0049	Custodial Closet	2126	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0050	Girl's Bathroom	2127	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0051	Girl's Bathroom	2127	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0052	Girl's Bathroom	2127	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0053	Girl's Bathroom	2127	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0054	Girl's Bathroom	2127	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0055	Girl's Bathroom	2127	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0056	Art Room	2132	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0058	Art Room	2132	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0059	Art Room	2132	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0060	Home Economics Room	2135A	Home Economics Faucet (Cold)	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0061	Home Economics Room	2135	Home Economics Faucet (Cold)	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0063	Home Economics Room	2135	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0064	Home Economics Room	2135	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0065	Outside Home Economics Room	2147	Water Fountain-No Chiller	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0066	Cafeteria Right of Kitchen	2090	Bottle Fill Station	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0068	Serving Area Left	2082	Hand Wash Only	Potable	6/11/2025	1.4			Result Below Action Level Continue O&M
SUFSD-0069	Serving Area Right	2082	Hand Wash Only	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0070	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	18.5			Removed From Service, Pending Remediation
SUFSD-0071	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0075	Kitchen	2082	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0076	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0077	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0078	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	1.9			Result Below Action Level Continue O&M
SUFSD-0079	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0080	Kitchen	2082	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0081	Kitchen	2082	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0082	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0083	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0084	Kitchen Bathroom	2083	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0085	Kitchen Bathroom	2083	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0087	Athletic Trainer	2030	Ice Machine	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0088	Cafeteria Left of Kitchen	2081	Bottle Fill Station	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0089	Cafeteria Left of Kitchen	2081	Water Cooler	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0090	Guidance Office	2103	Kitchen Faucet (Cold)	Potable	6/11/2025	4.2			Result Below Action Level Continue O&M
SUFSD-0092	Guidance Bathroom	2103A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0093	Outside Guidance Office	2114	Water Cooler	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0094	Nurse's Office	2095	Nurse's Office Sink	Potable	6/11/2025	5.2			Removed From Service, Pending Remediation
SUFSD-0095	Nurse Bathroom	2098	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0096	Boy's Bathroom	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0097	Boy's Bathroom	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0098	Boy's Bathroom	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0099	Boy's Bathroom	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0100	Boy's Bathroom	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0101	Boy's Bathroom	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0102	Custodial Closet	2025	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0103	Girl's Bathroom	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0104	Girl's Bathroom	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0105	Girl's Bathroom	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0106	Girl's Bathroom	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0107	Girl's Bathroom	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0108	Girl's Bathroom	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0109	Girl's Bathroom	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0112	Room 230	2042	Water Cooler	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0113	School Store	2038	Kitchen Faucet (Cold)	Potable	6/11/2025	1.5			Result Below Action Level Continue O&M
SUFSD-0114	School Store	2038	Bottled Water Dispenser	Potable	6/11/2025	OOS			Testing Required Before Return to Service

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0115	School Store	2038	Bottled Water Dispenser	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0119	Custodial Closet	2069	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0123	Girl's LR Vestibule	2071	Spit Station	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0124	Girl's LR Vestibule	2071	Water Fountain-No Chiller	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0125	Girl's Coache's Office BR	2073	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0126	Girl's Locker Room	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0127	Girl's Locker Room	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0128	Girl's Locker Room Bathroom	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0137	Girl's Locker Room	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0138	Girl's Locker Room	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0139	Girl's Locker Room	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0140	Girl's Locker Room	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0141	Boy's LR Vestibule	2044	Spit Station	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0142	Boy's LR Vestibule	2044	Water Fountain-No Chiller	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0143	Boy's Coache's Office BR	2053	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0144	Boy's Locker Room	2046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0145	Boy's Locker Room	2046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0146	Boy's Locker Room	2046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0147	Boy's Locker Room	2046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0148	Team Locker Room	1037	Water Cooler	Potable	6/11/2025	OOS			Testing Required Before Return to Service

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0149	Team Locker Room	1033	Water Cooler	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0150	Custodial Office Bathroom	2150	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0151	Principal Office Bathroom	2205	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0152	Custodial Closet	2051	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0153	Team Locker Room	1035	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0154	Team Locker Room	1035	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0155	Custodial Closet	1036	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0156	Team Locker Room	1035	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0157	Team Locker Room	1035	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0158	Room 206	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0159	Room 206	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0160	Room 206	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0161	Room 206	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0162	Room 206	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0163	Outside Room 206	3089	Water Cooler	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0172	Outside Room 210	3089	Bottle Fill Station	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0173	Outside Room 210	3089	Water Cooler	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0182	Girl's Bathroom	3078	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0183	Girl's Bathroom	3078	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0184	Girl's Bathroom	3078	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0185	Custodial Closet	3077	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0186	Boy's Bathroom	3076	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0187	Boy's Bathroom	3076	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0188	Boy's Bathroom	3076	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0189	Room 212	3074	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0190	Room 212	3074	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0191	Room 212	3074	Dish Washer	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0192	Room 212	3074	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0193	Room 212	3074	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0194	Room 212	3074	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0197	Library Office	3041	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0199	Custodial Closet	3037	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0200	Faculty Bathroom	3035	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0201	Room 218	3031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0202	Room 218	3031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0206	Room 218	3031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0209	Room 218	3031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0210	Prep Room Between 218 and 219	3029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0211	Prep Room Between 218 and 219	3029	Dish Washer	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0212	Room 219	3027	Bottled Water Dispenser	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0213	Room 219	3027	Bottled Water Dispenser	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0214	Room 219	3027	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0215	Room 219	3027	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0216	Room 219	3027	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0217	Room 219	3027	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0218	Room 219	3027	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0219	Room 222	3017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0220	Room 222	3017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0221	Room 222	3017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0222	Room 222	3017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0223	Room 222	3017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0224	Room 222	3017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0225	Outside Science Storage Room	3042	Water Fountain-No Chiller	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0226	Science Storage	3019	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0232	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0237	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0242	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0247	Exterior o/s AHERA 2009	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0248	Exterior o/s AHERA 2145	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0249	Exterior o/s AHERA 2216	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0250	Exterior o/s AHERA 2216	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0251	Exterior o/s Band Wing	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0252	Exterior o/s Band Wing	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0253	Exterior o/s 2160	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0755	Corridor 105 to 118	2042	Bottle Fill Station	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0756	Corridor 105 to 118	2042	Water Cooler	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0757	Corridor 123 to 130	2147	Bottle Fill Station	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0758	Corridor 123 to 130	2147	Water Cooler	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0759	Chorus Room	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0776	Team Locker Room Showers	1038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0777	Team Locker Room Showers	1038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0778	Team Locker Room Showers	1038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0779	Team Locker Room Showers	1038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0780	Team Locker Room Showers	1038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0781	Team Locker Room Showers	1038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0782	Team Locker Room Showers	1038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0783	Team Locker Room Showers	1038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0784	Team Locker Room Showers	1038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0785	Team Locker Room Showers	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0786	Team Locker Room Showers	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0787	Team Locker Room Showers	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0788	Team Locker Room Showers	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0789	Team Locker Room Showers	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0790	Team Locker Room Showers	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0791	Team Locker Room Showers	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0792	Team Locker Room Showers	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0793	Team Locker Room Showers	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0794	Corridor Boy's Bathroom to Women's Locker Room	2067	Bottle Fill Station	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0795	Corridor Boy's Bathroom to Women's Locker Room	2067	Water Cooler	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0796	Girl's Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0797	Girl's Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0798	Boy's Bathroom	2070	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0799	Boy's Bathroom	2070	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0800	Art Room 109	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0801	Art Room 109	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0802	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0803	Kitchen	2082	Kitchen Faucet (Cold)	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0804	Faculty Lounge	2084	Kitchen Faucet (Cold)	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0805	Faculty Lounge	2084	Ice Machine	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0806	Faculty Lounge	2084	Coffe Pot	Potable	6/11/2025	1.7			Result Below Action Level Continue O&M

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0807	Faculty Lounge	2084	Coffe Pot	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0808	Faculty Lounge	2084	Coffe Pot	Potable	6/11/2025	OOS			Testing Required Before Return to Service
SUFSD-0809	Kitchen	2082	Pasta Pot/Steam Kettle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0810	Cafeteria	2090	Water Cooler	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0811	Art Room	2132	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0812	Autobody Shop	2163	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0813	Custodial Closey	2166	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0814	Main Office Break Room	2196	Kitchen Faucet (Cold)	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0815	Guidance Bathroom	2103A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0816	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0817	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0818	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0819	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0820	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0821	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0822	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0823	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0824	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0825	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0826	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0827	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0828	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0829	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0830	Room 220	3023	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0831	Room 218	3031	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0832	Room 218	3031	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0833	Room 218	3031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0834	Room 218	3031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0835	Room 218	3031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0836	Room 218	3031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0837	Room 218	3031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0838	Corridor 220 to 226	3042	Bottle Fill Station	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0839	Corridor 220 to 226	3042	Water Cooler	Potable	6/11/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0840	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0841	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0842	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0843	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0844	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0845	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0846	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0847	Room 204	3065	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0848	Room 204	3065	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0857	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0858	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0859	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0860	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0861	Room 204	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0862	Prep Room 204/205	3068/3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0863	Room 205	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0864	Room 205	3069	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0865	Room 205	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0866	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0254	Custodial Office Bathroom	2138	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0255	Cafeteria	2132	Bottle Fill Station	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0256	Cafeteria	2132	Water Cooler	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0257	Cafeteria	2132	Bottle Fill Station	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0258	Cafeteria	2132	Water Cooler	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0259	Kitchen Serving Area	2121	Hand Wash Only	Potable	6/10/2025	3.9			Result Below Action Level Continue O&M
SUFSD-0263	Kitchen	2119	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0264	Kitchen	2119	Kitchen Faucet (Cold)	Potable	6/10/2025	16.9			Removed From Service, Pending Remediation
SUFSD-0265	Kitchen	2119	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0266	Kitchen	2119	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0267	Kitchen	2119	Kitchen Faucet (Cold)	Potable	6/10/2025	2.0			Result Below Action Level Continue O&M
SUFSD-0268	Kitchen Serving Area	2123	Hand Wash Only	Potable	6/10/2025	6.1			Removed From Service, Pending Remediation
SUFSD-0269	Kitchen Bathroom	2124	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0270	Kitchen Backroom	2128	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0271	Kitchen Backroom	2128	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0273	Women's Bathroom	2133B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0274	Women's Bathroom	2133B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0275	Women's Bathroom	2133B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0276	Women's Bathroom	2133B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0277	Men's Bathroom	2133A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0278	Men's Bathroom	2133A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0279	Men's Bathroom	2133A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0280	Men's Bathroom	2133A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0281	Outside Gym	2116	Water Fountain-No Chiller	Potable	6/10/2025	1.8			Result Below Action Level Continue O&M
SUFSD-0282	Custodial Closet Across from Band JC-5	2116A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0283	Girl's Coache's Office BR	2099	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0284	Girl's Locker Room	2089	Spit Station	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0285	Girl's Locker Room	2089	Water Fountain-No Chiller	Potable	6/10/2025	28.8			Removed From Service, Pending Remediation
SUFSD-0286	CC in Girl's Locker Room	2092	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0287	Room 231	2094	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0288	Room 231	2094	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0289	Room 231	2094	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0290	Room 231	2094	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0291	Boy's Coache's Office BR	2078	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0292	Boy's Locker Room	2080	Water Fountain-No Chiller	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0293	CC in Boy's Locker Room	2084	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0294	Stairwell Adjacent To Room 247	2086	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0295	Boy's Locker Room Bathroom	2080	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0296	Stairwell Adjacent To Room 247	2086	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0297	Boy's Locker Room Bathroom	2080	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0298	Outside Gym	2133	Water Fountain-No Chiller	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0299	Faculty Lounge	2034	Kitchen Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0300	Women's Bathroom	2036	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0301	Men's Bathroom	2074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0302	Woodshop	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0303	Woodshop	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0304	Woodshop	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0305	Woodshop	2001	Water Fountain-No Chiller	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0306	Tech	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0307	Tech	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0308	Tech	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0309	Room 223	2015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0310	Room 223	2015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0313	Room 223	2015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0314	Room 223	2015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0315	Corridor To Cafeteria	2033	Water Fountain-No Chiller	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0316	Nurse's Office	2018	Nurse's Office Sink	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0317	Nurse's Office Bathroom	2019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0319	2nd Floor Lobby	2017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0320	2nd Floor Lobby	2017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0321	Guidance	2030	Bottled Water Dispenser	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0322	Guidance	2030	Bottled Water Dispenser	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0323	Main Office	2042	Water Cooler	Potable	6/10/2025	46.7			Removed From Service, Pending Remediation
SUFSD-0324	Main Office Kitchen	2045	Kitchen Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0327	Principal's Office Bathroom	2050	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0328	Women's Bathroom	2031	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0329	Women's Bathroom	2031	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0330	Men's Bathroom	2032	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0331	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0332	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0333	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0334	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0335	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0336	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0337	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0338	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0339	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0340	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0341	Girl's Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0342	Girl's Bathroom	2037	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0343	Across Bathrooms	2052	Water Fountain-No Chiller	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0344	Room 202	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0345	Room 202	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0346	Room 202	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0347	Room 202	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0348	Room 202	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0349	Room 202	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0350	Room 202	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0351	Room 202	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0352	Room 202	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0353	Room 202	2038	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0355	Connected to Rm 101	2057	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0356	Connected to Rm 101	2057	Water Fountain-No Chiller	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0357	Room 101	2056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0358	Room 101	2056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0359	Room 101	2056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0361	Room 103	2059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0362	Room 103	2059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0363	Room 103	2059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0364	Rm 103 Storage	2060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0365	Room 104	2063	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0366	Room 104	2063	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0367	Room 104	2063	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0368	Rm 104 Storage	2064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0377	Room 104 Science Storage Room	2065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0378	Room 106	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0379	Room 106	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0380	Room 106	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0381	Room 106	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0382	Room 220	2066	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0383	Room 220	2066	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0384	Room 220	2066	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0385	Room 220	2066	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0386	Room 220	2066	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0387	Chemical Storage Room	2061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0388	Auditorium I	2073	Water Fountain-No Chiller	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0389	Room 108	2069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0390	Room 108	2069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0391	Room 108	2068	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0392	Room 108	2069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0393	Room 108 Storage	270	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0395	Room 203	3007	Home Economics Faucet (Cold)	Potable	6/10/2025	3.1			Result Below Action Level Continue O&M
SUFSD-0396	Room 203	3007	Home Economics Faucet (Cold)	Potable	6/10/2025	2.8			Result Below Action Level Continue O&M
SUFSD-0397	Room 203	3007	Home Economics Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0398	Room 203	3007	Dish Washer	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0399	Room 201	3012	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0400	Room 201	3012	Dish Washer	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0401	Room 201	3012	Home Economics Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0402	Room 201	3012	Home Economics Faucet (Cold)	Potable	6/10/2025	1.7			Result Below Action Level Continue O&M
SUFSD-0403	Room 201	3012	Dish Washer	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0404	Room 201	3012	Home Economics Faucet (Cold)	Potable	6/10/2025	1.7			Result Below Action Level Continue O&M
SUFSD-0405	Outside Room 202	3019	Water Fountain-No Chiller	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0406	Art Room Storage	2016	Classroom Faucet	Non-Applicable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0407	Custodial Storage Room	3021	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0408	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0409	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0410	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0411	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0412	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0413	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0414	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0415	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0416	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0417	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0418	Boy's Bathroom	3022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0419	Boy's Bathroom	3022	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0420	Between Bathrooms	3025	Water Fountain-No Chiller	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0421	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0422	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0423	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0424	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0425	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0426	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0427	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0428	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0429	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0430	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0431	Girl's Bathroom	3023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0432	Girl's Bathroom	3023	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0433	Room 215	3026	Home Economics Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0434	Room 215	3026	Home Economics Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0435	Room 215	3026	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0436	Room 215	3026	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0437	Men's Faculty Bathroom	3029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0438	Women's Faculty Bathroom	3030	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0439	Women's Faculty Bathroom	3030	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0441	Outside Room 231	3045	Water Fountain-No Chiller	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0442	Exterior o/s AHERA 2127	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0443	Exterior o/s AHERA 2119	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0444	Exterior o/s AHERA 2126	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0445	Exterior o/s AHERA 2113	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0446	Exterior o/s AHERA 2102	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0447	Exterior o/s AHERA 2079	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0448	Exterior o/s AHERA 2037	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0449	Exterior o/s AHERA 2066	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0450	Exterior o/s AHERA 2070	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0452	Exterior o/s AHERA 2053	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0453	Exterior o/s AHERA 2018	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0454	Exterior o/s AHERA 2007	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0455	Exterior o/s AHERA 2001	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0456	Exterior o/s AHERA 2000	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0457	Exterior o/s AHERA 2132	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0762	Corridor from Room 100 to 109	2073	Bottle Fill Station	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0763	Corridor from Room 100 to 109	2073	Water Cooler	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0764	Corridor from Room 200 to Stairwell Across Room 209	3019	Bottle Fill Station	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0765	Corridor from Room 200 to Stairwell Across Room 209	3019	Water Cooler	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0766	Corridor Fan Room to 231	3045	Bottle Fill Station	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0767	Corridor Fan Room to 231	3045	Water Cooler	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-1033	Room 203	3007	Dish Washer	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1034	Custodial Closet JC-1	2040	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1035	Room 123	2015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1036	Room 123	2015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1037	Boy's Gym Office Bathroom	2078	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1038	Girl's Locker Room Office Bathroom	2099	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1039	Kitchen	2119	Ice Machine	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-1040	Kitchen Washer/Dryer Room	2128	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1041	Kitchen	2119	Kitchen Faucet (Cold)	Potable	6/10/2025	3.4			Result Below Action Level Continue O&M
SUFSD-1042	Kitchen	2119	Kitchen Faucet (Cold)	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-1043	Kitchen	2119	Kitchen Faucet (Cold)	Potable	6/10/2025	2950			Removed From Service, Pending Remediation
SUFSD-1044	Kitchen	2119	Dish Washer	Non-Applicable					Placarded for Non-Drinking Use

Seaford Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-1045	Custodial Office Bathroom	2138	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1046	Courtyard	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1047	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1048	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1049	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1050	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1051	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1052	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1053	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1054	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1055	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1056	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1057	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1058	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1059	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-1060	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Seaford Manor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0459	RM 37C BR	2139	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0460	Women's	2136B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0461	Women's	2136B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0462	Room 29C	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0463	Room 29C	2009	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0464	Room 30C	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0465	Room 30C	2008	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0466	Room 28C	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0467	Room 28C	2010	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0468	Room 31C	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0469	Room 31C	2007	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0470	Room 27C	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0471	Room 27C	2011	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0473	Room 32C	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0474	Room 32C	2006	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0475	Room 26C	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0476	Room 26C	2012	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0477	Room 33C	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0478	Room 33C	2005	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0481	Room 34C	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Manor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0482	Room 34C	2004	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0485	Room 35C	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0486	Room 35C	2003	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0487	Room 23C	2015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0488	Room 23C	2015	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0489	Outside Room 35C	2018	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0490	Room 36C	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0491	Room 36C	2002	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0495	Boy's BR	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0497	Boy's BR	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0499	Boy's BR	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0500	Boy's BR	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0501	Girl's Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0502	Girl's Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0503	Girl's Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0504	Girl's Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0505	Girl's Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0506	Girl's Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0507	Girl's Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0508	Girl's Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Manor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0509	Custodial Closet	2018A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0510	Coache's Office BR	2128	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0511	Speech Classroom	2123	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0512	Speech Classroom	2123	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0513	Speech Classroom	2123	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0514	Outside Speech	2132	Bottle Fill Station	Potable	6/5/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0515	Outside Speech	2132	Water Cooler	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0516	Room 15B	2030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0517	Room 15B	2030	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0518	Room 16B	2029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0519	Room 16B	2029	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0520	Room 14B	2031	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0521	Room 14B	2031	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0522	Room 17B	2028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0523	Room 17B	2028	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0524	Room 13B	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0525	Room 13B	2032	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0529	Boy's Bathroom	2033	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0530	Boy's Bathroom	2033	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0531	Boy's Bathroom	2033	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Manor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0532	Boy's Bathroom	2033	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0533	Boy's Bathroom	2033	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0534	Boy's Bathroom	2033	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0535	Boy's Bathroom	2033	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0536	Boy's Bathroom	2033	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0537	Girl's Bathroom	2034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0538	Girl's Bathroom	2034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0539	Girl's Bathroom	2034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0540	Girl's Bathroom	2034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0541	Girl's Bathroom	2034	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0547	Room 20B Bathroom	2024A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0548	Across Room 11B	2038	Water Fountain-No Chiller	Potable	6/5/2025	12.4			Removed From Service, Pending Remediation
SUFSD-0549	Room 11B	2037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0550	Room 11B	2037	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0551	Room 21B	2023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0552	Room 21B	2023	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0553	Library Office	2021	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0554	Custodial Closet	2020	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0555	Custodial Office Bathroom	2121	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0557	Hallway Fountain	2132	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service

Seaford Manor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0558	Kitchen	2114	Kitchen Faucet (Cold)	Potable	6/10/2025	1.4			Result Below Action Level Continue O&M
SUFSD-0559	Kitchen	2114	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0560	Kitchen	2114	Kitchen Faucet (Cold)	Potable	6/10/2025	2.3			Result Below Action Level Continue O&M
SUFSD-0561	Kitchen	2114	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0562	Kitchen	2114	Kitchen Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0563	Kitchen	2114	Pasta Pot/Steam Kettle	Potable	6/10/2025	OOS			Testing Required Before Return to Service
SUFSD-0564	Kitchen	2114	Kitchen Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0567	Kitchen Bathroom	2115	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0568	Kitchen Bathroom	2115	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0569	Women's Bathroom	2042	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0570	Women's Bathroom	2042	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0571	Custodial Closet	2043	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0572	Men's Bathroom	2045	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0573	Women's Bathroom	2095	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0574	Faculty Lounge	2096	Kitchen Faucet (Cold)	Potable	6/5/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0575	Faculty Lounge Storage	2097	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0576	Hallway Fountain	2113	Bottle Fill Station	Potable	6/5/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0577	Hallway Fountain	2113	Water Cooler	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0578	Bathroom	2103	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0579	Art Room SCOPE	2101	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Manor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0580	Art Room SCOPE	2101	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0583	Principal's Bathroom	2091	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0584	Room 10A	2047	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0585	Room 10A	2047	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0586	Room 10A Bathroom	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0587	Room 10A Bathroom	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0588	Hallway Fountain	2093	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0589	Room 9A	2049	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0590	Room 9A	2049	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0591	Room 9A Bathroom	2050	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0592	Nurse	2083	Tempered Water Outlet	Potable	6/5/2025	1.6			Result Below Action Level Continue O&M
SUFSD-0593	Nurse's Bathroom	2084	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0594	Main Office Bathroom	2079	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0595	Room 8A	2051	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0596	Room 8A	2051	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0597	Room 8A Bathroom	2052	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0598	Room 8A Bathroom	2052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0600	Room 7A	2053	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0601	Room 7A	2053	Water Fountain-No Chiller	Potable	6/5/2025	3800			Removed From Service, Pending Remediation
SUFSD-0602	Room 7A Bathroom	2054	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Manor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0603	Room 7A Bathroom	2054	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0604		2073	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0605	4 A Bathroom	2072	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0606	4 A Bathroom	2072	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0608	Office Bathroom	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0617	Office Bathroom	2066	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0629	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0630	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0890	Corridor o/s Room 32C	2018	Bottle Fill Station	Potable	6/5/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0891	Corridor o/s Room 32C	2018	Water Cooler	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0892	Room 25C	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0893	Room 25C	2013	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0894	Room 24C	2014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0895		2014	Water Fountain-No Chiller	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0896	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0907	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0908	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0909	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0910	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0913	Room 18B Bathroom	2027	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Manor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0914	Room 18B Bathroom	2027	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0915	Corridor o/s Room 18B	2038	Bottle Fill Station	Potable	6/5/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0916	Corridor o/s Room 18B	2038	Water Cooler	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0917	Room 128B Bathroom	2039	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0918	Room 128B Bathroom	2039	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0919	Corridor	2093	Water Cooler	Potable	6/5/2025	OOS			Testing Required Before Return to Service
SUFSD-0920	Vestibule Outside Men's Bathroom	2064	Bottled Water Dispenser	Potable	6/5/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0921	School Facilities Kitchen	2078	Bottled Water Dispenser	Potable	6/5/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0922	Kitchen	2114	Kitchen Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0923	Kitchen	2115	Kitchen Faucet (Cold)	Potable	6/10/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0924	Custodial Office	2119	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0925	Custodial Office	2119	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0926	Custodial Office Bathroom	2121	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0927	Coach Office Bathroom	2128	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0928	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0929	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0930	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0931	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0932	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0933	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Seaford Manor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0934	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0935	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0936	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0937	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0938	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Seaford Harbor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0631	Kitchen	2111	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0632	Kitchen	2111	Kitchen Faucet (Cold)	Potable	6/4/2025	2.0			Result Below Action Level Continue O&M
SUFSD-0635	Kitchen	2111	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0636	Kitchen	2111	Kitchen Faucet (Cold)	Potable	6/4/2025	4.9			Result Below Action Level Continue O&M
SUFSD-0637	Kitchen	2111	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0638	Kitchen	2111	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0639	Kitchen	2108	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0640	Serving Area	2109	Hand Wash Only	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0641	Serving Area	2109	Hand Wash Only	Potable	6/4/2025	1.6			Result Below Action Level Continue O&M
SUFSD-0642	Kitchen Vestibule	2112	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0643	Kitchen BR	2113	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0644	Cafeteria	2106	Bottle Fill Station	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0645	Cafeteria	2106	Water Cooler	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0646	Room 136	2099	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0647	Room 136 BR	2100A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0648	Faculty Bathroom	2103	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0649	Room 115	2075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0650	Room 115	2075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0651	Coache's Office BR	2088	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0652	Room 142	2091	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service

Seaford Harbor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0653	Room 142 Vestibule BR	2092A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0655	Custodial Closet	2078	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0657	Boy's Bathrom	2086	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0658	Girl's Bathroom	2087	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0659	Girl's Bathroom	2087	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0660	Girl's Bathroom	2087	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0661	Custodial Office BR	2119	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0662	Principal BR	2032	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0665	Main Office Kitchen	2038	Kitchen Faucet (Cold)	Potable	6/4/2025	1.0			Result Below Action Level Continue O&M
SUFSD-0666	Nurse's Office	2040	Nurse's Office Sink	Potable	6/4/2025	1.0			Result Below Action Level Continue O&M
SUFSD-0667	Nurse's Office Bathroom	2041	Bathroom Faucet	Non-Potable					Placarded for Non-Drinking Use"
SUFSD-0668	Custodial Closet	2049	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0672	Faculty Bathroom	2047	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0673	Between Bathrooms	2071	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0674	Faculty Bathroom	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0675	Room 108	2050	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0676	Room 105	2054	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0677	Room 105	2054	Water Fountain-No Chiller	Potable					Placarded for Non-Drinking Use"
SUFSD-0679	Room 106	2052	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0680	Room 104	2065	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Harbor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0682	Room 103	2058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0683	Room 103	2058	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0684	Room 103 Bathroom	2059	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0685	Room 102	2067	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0686	Room 101	2062	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0687	Room 101	2062	Water Fountain-No Chiller	Potable	6/4/2025	48.2			Removed From Service, Pending Remediation
SUFSD-0688	Room 101 Bathroom	2063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0689	Room 100	2069	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0690	Custodial Closet	2026	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0691	Room 110	2023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0692	Room 110	2023	Water Fountain-No Chiller	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0694	Room 112	2021	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0695	Hallway Fountain	2027	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0697	Room 114	2016	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0698	Room 107	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0699	Room 116	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0700	Room 109	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0701	Room 118	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0702	Hallway Fountain	2027	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0704	Room 111	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Seaford Harbor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0705	Room 120	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0706	Room 113	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0708	Room 211	3015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0709	Room 209	3014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0710	Room 210	3013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0712	Hallway Fountain	3018	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0713	Room 207	3012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0714	Room 208	3011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0715	Room 205	3012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0716	Room 206	3009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0717	Room 203	3008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0718	Hallway Fountain	3018	Bottle Fill Station	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0719	Hallway Fountain	3018	Water Cooler	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0720	Hallway Fountain	3018	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0721	Room 204	3007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0722	Room 202	3004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0728	Custodial Closet	3002	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0736	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0737	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0738	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Seaford Harbor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0739	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0740	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0741	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0742	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0743	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0744	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0745	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0746	Exterior	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0768	Corridor Library to Room 120	2027	Bottle Fill Station	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0769	Corridor Library to Room 120	2027	Water Cooler	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0770	Corridor from Kitchen to Gym	2115	Bottle Fill Station	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0771	Corridor from Kitchen to Gym	2115	Water Cooler	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0772	Outside Room 104	2071	Bottle Fill Station	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0773	Outside Room 104	2071	Water Cooler	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0774	Faculty Work Room Lounge	2046	Kitchen Faucet (Cold)	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0775	Faculty Work Room Lounge	2046	Kitchen Non Potable	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0869	Hallway	2027	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0870	Room 105 Bathroom	2055	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0871	Boys Bathroom	2086	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0872	Kitchen	2111	Kitchen Faucet (Cold)	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M

Seaford Harbor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0873	Kitchen	2111	Kitchen Faucet (Cold)	Potable	6/4/2025	<1.00 ND			Result Below Action Level Continue O&M
SUFSD-0874	Kitchen Vestibule	2112	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0875	Courtyard	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0876	Courtyard	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0877	Girls Bathroom	3001	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0878	Girls Bathroom	3001	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0879	Girls Bathroom	3001	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0880	Girls Bathroom	3001	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0881	Girls Bathroom	3001	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0882	Boys Bathroom	3003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0883	Boys Bathroom	3003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0884	Boys Bathroom	3003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0885	Boys Bathroom	3003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0886	Boys Bathroom	3003	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0887	Room 212	3017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0888	Corridor	3018	Water Fountain-No Chiller	Potable	6/4/2025	OOS			Testing Required Before Return to Service
SUFSD-0889	Reading Lab Room 201	3006A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0897	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0898	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0899	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Seaford Harbor Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SUFSD-0900	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0901	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0902	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0903	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0904	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0905	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SUFSD-0906	Exterior Hose Bib	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Attachment 3:

Laboratory Analytical Reports

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Lead in Water: Chain of Custody for

ED53133

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53407

Building: Seafood Harbor Elementary School

SHES

Client:

Seafood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SUFSD-0632	KI	2111	Kitchen	KC	6/4/2025	6:51:00 AM
SUFSD-0636	KI	2111	Kitchen	KC	6/4/2025	6:51:00 AM
SUFSD-0640	KI	2109	Serving Area	HW	6/4/2025	6:54:00 AM
SUFSD-0641	KI	2109	Serving Area	HW	6/4/2025	6:53:00 AM
SUFSD-0644	CA	2106	Cafeteria	WF	6/4/2025	7:00:00 AM
SUFSD-0665	OF	2038	Main Office Kitchen	KC	6/4/2025	7:18:00 AM
SUFSD-0666	NO	2040	Nurse's Office	NS	6/4/2025	7:16:00 AM
SUFSD-0687	CR	2062	Room 101	DW	6/4/2025	7:13:00 AM
SUFSD-0692	CR	2023	Room 110	DW	6/4/2025	7:21:00 AM
SUFSD-0718	HA	3018	Hallway Fountain	WF	6/4/2025	7:28:00 AM
SUFSD-0768	HA	2027	Corridor Library to Room 120	WF	6/4/2025	7:23:00 AM
SUFSD-0770	HA	2115	Corridor from Kitchen to Gym	WF	6/4/2025	7:04:00 AM
SUFSD-0772	HA	2071	Outside Room 104	WF	6/4/2025	7:13:00 AM
SUFSD-0774	FL	2046	Faculty Work Room Lounge	KC	6/4/2025	7:08:00 AM
SUFSD-0872	KI	2111	Kitchen	KC	6/4/2025	6:55:00 AM
SUFSD-0873	KI	2111	Kitchen	KC	6/4/2025	6:55:00 AM

RECEIVED
ENGLAND ANALYTICAL, INC.
Carle Place, NY
JUN 11 25, PM 01:16

Building Address

3500 Bayview Street

Seafood, NY 11783



Analysis Type: ELAP 200.5


Lab Received: 6/11/25 13:16

Signature: [Signature]

Samplers Name: Maisha Yaseen

Samplers Signature: [Signature]

JCB Project Manager: Paul Fazio



Lead in Water: Chain of Custody for

ED53133

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53407

Building:

Seaford Harbor Elementary School

SHES

Client:

Seaford Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted

16

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 11 25, PM 01:16

Building Address

3500 Bayview Street

Seaford, NY 11783

Analysis Type: ELAP 200.5

Lab Received: 6/11/25 13:10

Signature: [Signature] / KAY WATKINS

Samplers Name: Maisha Yaseen

Samplers Signature: [Signature]

JCB Project Manager: Paul Fazio

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553133**LIMS Reference ID:** ED53133**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Harbor Elementary School: 3500
Bayview Street, Seaford, NY 11783: Seaford
Union Free School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:16

Reported:

06/24/2025 08:56

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0632 Lims Reference ID: ED53133-01 Matrix: Drinking Water Sampled: 06/04/25 06:51:00									
Metals									
Lead	2.0		1	1.0	µg/L	06/16/25 18:34	06/16/25 18:34	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: SUFSD-0636 Lims Reference ID: ED53133-02 Matrix: Drinking Water Sampled: 06/04/25 06:51:00									
Metals									
Lead	4.9		1	1.0	µg/L	06/15/25 09:13	06/15/25 09:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0640 Lims Reference ID: ED53133-03 Matrix: Drinking Water Sampled: 06/04/25 06:54:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:17	06/15/25 09:17	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0641 Lims Reference ID: ED53133-04 Matrix: Drinking Water Sampled: 06/04/25 06:53:00									
Metals									
Lead	1.6		1	1.0	µg/L	06/15/25 09:21	06/15/25 09:21	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0644 Lims Reference ID: ED53133-05 Matrix: Drinking Water Sampled: 06/04/25 07:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:22	06/15/25 09:22	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0665 Lims Reference ID: ED53133-06 Matrix: Drinking Water Sampled: 06/04/25 07:18:00									
Metals									
Lead	1.0		1	1.0	µg/L	06/15/25 09:23	06/15/25 09:23	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0666 Lims Reference ID: ED53133-07 Matrix: Drinking Water Sampled: 06/04/25 07:16:00									
Metals									
Lead	1.0		1	1.0	µg/L	06/15/25 09:25	06/15/25 09:25	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0687 Lims Reference ID: ED53133-08 Matrix: Drinking Water Sampled: 06/04/25 07:13:00									
Metals									
Lead	48.2		1	1.0	µg/L	06/15/25 09:26	06/15/25 09:26	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0692 Lims Reference ID: ED53133-09 Matrix: Drinking Water Sampled: 06/04/25 07:21:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:27	06/15/25 09:27	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553133**LIMS Reference ID:** ED53133**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Harbor Elementary School: 3500
Bayview Street, Seaford, NY 11783: Seaford
Union Free School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:16

Reported:

06/24/2025 08:56

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0718 Lims Reference ID: ED53133-10 Matrix: Drinking Water Sampled: 06/04/25 07:28:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:29	06/15/25 09:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0768 Lims Reference ID: ED53133-11 Matrix: Drinking Water Sampled: 06/04/25 07:23:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:30	06/15/25 09:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0770 Lims Reference ID: ED53133-12 Matrix: Drinking Water Sampled: 06/04/25 07:04:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:46	06/15/25 09:46	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0772 Lims Reference ID: ED53133-13 Matrix: Drinking Water Sampled: 06/04/25 07:13:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:50	06/15/25 09:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0774 Lims Reference ID: ED53133-14 Matrix: Drinking Water Sampled: 06/04/25 07:08:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:51	06/15/25 09:51	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0872 Lims Reference ID: ED53133-15 Matrix: Drinking Water Sampled: 06/04/25 06:55:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:52	06/15/25 09:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0873 Lims Reference ID: ED53133-16 Matrix: Drinking Water Sampled: 06/04/25 06:55:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:54	06/15/25 09:54	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553133**LIMS Reference ID:** ED53133**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Harbor Elementary School: 3500
Bayview Street, Seaford, NY 11783: Seaford
Union Free School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:16

Reported:

06/24/2025 08:56

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553133**LIMS Reference ID:** ED53133**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Harbor Elementary School: 3500
Bayview Street, Seaford, NY 11783: Seaford
Union Free School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:16

Reported:

06/24/2025 08:56


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53407

Building:

Seaford Manor Elementary School

SMES

Client:

Seaford Union Free School District

Retest/New Install ☐

Turn Around: Normal ~~Lwk~~ Rush

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SUFSD-0514	HA	2132	Outside Speech	WF	6/5/2025	7:30:00 AM
SUFSD-0548	HA	2038	Across Room 11B	DW	6/5/2025	7:42:00 AM
SUFSD-0558	KI	2114	Kitchen	KC	6/10/2025	6:50:00 AM
SUFSD-0560	KI	2114	Kitchen	KC	6/10/2025	6:50:00 AM
SUFSD-0562	KI	2114	Kitchen	KC	6/10/2025	6:51:00 AM
SUFSD-0564	KI	2114	Kitchen	KC	6/10/2025	6:52:00 AM
SUFSD-0574	FL	2096	Faculty Lounge	KC	6/5/2025	7:09:00 AM
SUFSD-0576	HA	2113	Hallway Fountain	WF	6/5/2025	7:10:00 AM
SUFSD-0592	NO	2083	Nurse	TM	6/5/2025	7:14:00 AM
SUFSD-0601	CR	2053	Room 7A	DW	6/5/2025	7:21:00 AM
SUFSD-0890	HA	2018	Corridor o/s Room 32C	WF	6/5/2025	7:25:00 AM
SUFSD-0915	HA	2038	Corridor o/s Room 18B	WF	6/5/2025	7:36:00 AM
SUFSD-0920	OF	2064	Vestibule Outside Men's Bathroom	BW	6/5/2025	7:17:00 AM
SUFSD-0921	OF	2078	School Facilities Kitchen	BW	6/5/2025	7:26:00 AM
SUFSD-0922	KI	2114	Kitchen	KC	6/10/2025	6:53:00 AM
SUFSD-0923	KI	2115	Kitchen	KC	6/10/2025	6:52:00 AM

Building Address

1590 Washington Avenue

Seaford, NY 11783



Analysis Type: ELAP 200.5

Lab Received: 6/11/25 13:17


Signature: [Signature]

Samplers Name: Maisha Yaseen

Samplers Signature: [Signature]

JCB Project Manager: Paul Fazio

REQUIRED
 EML ANALYTICAL INC.
 Carle Place, NY
 JUN 11 25 PM 01:17



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53407

Building:

Seaford Manor Elementary School

SMES

Client:

Seaford Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Page 2 of 2

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 16

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 11 25 PM 01:18

Building Address

1590 Washington Avenue

Seaford, NY 11783

Analysis Type: ELAP 200.5

Lab Received:

Colletts 13:17

Signature:

Kay KACZMAREK

Sampler's Name:

Maisha Yasten

Sampler's Signature:

Maisha Yasten

JCB Project Manager:

Paul Fazio

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553135
LIMS Reference ID: ED53135
EMSL Customer ID: JCBR50

Attention: Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Manor Elementary School: 1590
Washington Avenue, Seaford, NY 11783:
Seaford Union Free School District: Project#
22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:17

Reported:

06/24/2025 08:57

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0514 Lims Reference ID: ED53135-01 Matrix: Drinking Water Sampled: 06/05/25 07:30:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 09:58	06/15/25 09:58	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0548 Lims Reference ID: ED53135-02 Matrix: Drinking Water Sampled: 06/05/25 07:45:00									
Metals									
Lead	12.4		1	1.0	µg/L	06/15/25 09:59	06/15/25 09:59	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0558 Lims Reference ID: ED53135-03 Matrix: Drinking Water Sampled: 06/05/25 06:50:00									
Metals									
Lead	1.4		1	1.0	µg/L	06/15/25 10:00	06/15/25 10:00	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0560 Lims Reference ID: ED53135-04 Matrix: Drinking Water Sampled: 06/05/25 06:50:00									
Metals									
Lead	2.3		1	1.0	µg/L	06/15/25 10:01	06/15/25 10:01	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0562 Lims Reference ID: ED53135-05 Matrix: Drinking Water Sampled: 06/05/25 06:51:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:03	06/15/25 10:03	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0564 Lims Reference ID: ED53135-06 Matrix: Drinking Water Sampled: 06/05/25 06:52:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:04	06/15/25 10:04	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0574 Lims Reference ID: ED53135-07 Matrix: Drinking Water Sampled: 06/05/25 07:09:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:08	06/15/25 10:08	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0576 Lims Reference ID: ED53135-08 Matrix: Drinking Water Sampled: 06/05/25 07:10:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:09	06/15/25 10:09	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0592 Lims Reference ID: ED53135-09 Matrix: Drinking Water Sampled: 06/05/25 07:14:00									
Metals									
Lead	1.6		1	1.0	µg/L	06/15/25 10:13	06/15/25 10:13	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553135**LIMS Reference ID:** ED53135**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Manor Elementary School: 1590
Washington Avenue, Seaford, NY 11783:
Seaford Union Free School District: Project#
22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:17

Reported:

06/24/2025 08:57

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0601 Lims Reference ID: ED53135-10 Matrix: Drinking Water Sampled: 06/05/25 07:21:00									
Metals									
Lead	3800		50	50.0	µg/L	06/16/25 19:27	06/16/25 19:27	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: SUFSD-0890 Lims Reference ID: ED53135-11 Matrix: Drinking Water Sampled: 06/05/25 07:25:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:15	06/15/25 10:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0915 Lims Reference ID: ED53135-12 Matrix: Drinking Water Sampled: 06/05/25 07:36:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:16	06/15/25 10:16	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0920 Lims Reference ID: ED53135-13 Matrix: Drinking Water Sampled: 06/05/25 07:17:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:17	06/15/25 10:17	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0921 Lims Reference ID: ED53135-14 Matrix: Drinking Water Sampled: 06/05/25 07:26:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:19	06/15/25 10:19	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0922 Lims Reference ID: ED53135-15 Matrix: Drinking Water Sampled: 06/05/25 06:53:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:20	06/15/25 10:20	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0923 Lims Reference ID: ED53135-16 Matrix: Drinking Water Sampled: 06/05/25 06:52:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:21	06/15/25 10:21	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553135**LIMS Reference ID:** ED53135**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Manor Elementary School: 1590
Washington Avenue, Seaford, NY 11783:
Seaford Union Free School District: Project#
22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:17

Reported:

06/24/2025 08:57

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553135**LIMS Reference ID:** ED53135**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Manor Elementary School: 1590
Washington Avenue, Seaford, NY 11783:
Seaford Union Free School District: Project#
22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:17

Reported:

06/24/2025 08:57


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53407

Building:

Seaford Middle School

SMS

Client:

Seaford Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

ED53 B8

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SUFSD-0255	CA	2132	Cafeteria	WF	6/10/2025	7:14:00 AM
SUFSD-0256	CA	2132	Cafeteria	WC	6/10/2025	7:15:00 AM
SUFSD-0257	CA	2132	Cafeteria	WF	6/10/2025	7:18:00 AM
SUFSD-0258	CA	2132	Cafeteria	WC	6/10/2025	7:19:00 AM
SUFSD-0259	KI	2121	Kitchen Serving Area	HW	6/10/2025	7:07:00 AM
SUFSD-0264	KI	2119	Kitchen	KC	6/10/2025	7:09:00 AM
SUFSD-0267	KI	2119	Kitchen	KC	6/10/2025	7:07:00 AM
SUFSD-0268	KI	2123	Kitchen Serving Area	HW	6/10/2025	7:09:00 AM
SUFSD-0281	HA	2116	Outside Gym	DW	6/10/2025	7:20:00 AM
SUFSD-0285	LR	2089	Girl's Locker Room	DW	6/10/2025	7:37:00 AM
SUFSD-0299	FL	2034	Faculty Lounge	KC	6/10/2025	7:30:00 AM
SUFSD-0316	NO	2018	Nurse's Office	NS	6/10/2025	7:49:00 AM
SUFSD-0323	OF	2042	Main Office	WC	6/10/2025	7:41:00 AM
SUFSD-0324	OF	2045	Main Office Kitchen	KC	6/10/2025	7:41:00 AM
SUFSD-0395	HE	3007	Room 203	EC	6/10/2025	7:26:00 AM
SUFSD-0396	HE	3007	Room 203	EC	6/10/2025	7:27:00 AM
SUFSD-0397	HE	3007	Room 203	EC	6/10/2025	7:27:00 AM
SUFSD-0401	HE	3012	Room 201	EC	6/10/2025	7:34:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 11 25, PM 1:13

Building Address

3940 Sunset Avenue

Seaford, NY 11783



Analysis Type: ELAP 200.5

Lab Received: 6/11/25 13:13

Signature: [Signature]

Samplers Name: Maisha Yaseen

Samplers Signature: [Signature]

JCB Project Manager: Paul Fazio



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53407

Building: Seafood Middle School

SMS

Client:

Seafood Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SUFSD-0402	HE	3012	Room 201	EC	6/10/2025	7:33:00 AM
SUFSD-0404	HE	3012	Room 201	EC	6/10/2025	7:33:00 AM
SUFSD-0405	HA	3019	Outside Room 202	DW	6/10/2025	7:30:00 AM
SUFSD-0433	HE	3026	Room 215	EC	6/10/2025	8:06:00 AM
SUFSD-0434	HE	3026	Room 215	EC	6/10/2025	8:06:00 AM
SUFSD-0762	HA	2073	Corridor from Room 100 to 109	WF	6/10/2025	8:33:00 AM
SUFSD-0763	HA	2073	Corridor from Room 100 to 109	WC	6/10/2025	8:33:00 AM
SUFSD-0764	HA	3019	Corridor from Room 200 to Stairwell Across Room 209	WF	6/10/2025	7:23:00 AM
SUFSD-0765	HA	3019	Corridor from Room 200 to Stairwell Across Room 209	WC	6/10/2025	7:24:00 AM
SUFSD-0766	HA	3045	Corridor Fan Room to 231	WF	6/10/2025	7:39:00 AM
SUFSD-0767	HA	3045	Corridor Fan Room to 231	WC	6/10/2025	7:39:00 AM
SUFSD-1041	KI	2119	Kitchen	KC	6/10/2025	7:08:00 AM
SUFSD-1043	KI	2119	Kitchen	KC	6/10/2025	7:10:00 AM

Samples Submitted 31

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 11 25, PM 01:14

Building Address

3940 Sunset Avenue

Seafood, NY 11783

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553138**LIMS Reference ID:** ED53138**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Middle School: 3940 Sunset Avenue,
Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:13

Reported:

06/24/2025 08:58

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0255 Lims Reference ID: ED53138-01 Matrix: Drinking Water Sampled: 06/10/25 07:14:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:38	06/15/25 10:38	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0256 Lims Reference ID: ED53138-02 Matrix: Drinking Water Sampled: 06/10/25 07:15:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:42	06/15/25 10:42	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0257 Lims Reference ID: ED53138-03 Matrix: Drinking Water Sampled: 06/10/25 07:18:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:43	06/15/25 10:43	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0258 Lims Reference ID: ED53138-04 Matrix: Drinking Water Sampled: 06/10/25 07:19:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:44	06/15/25 10:44	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0259 Lims Reference ID: ED53138-05 Matrix: Drinking Water Sampled: 06/10/25 07:07:00									
Metals									
Lead	3.9		1	1.0	µg/L	06/15/25 10:46	06/15/25 10:46	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0264 Lims Reference ID: ED53138-06 Matrix: Drinking Water Sampled: 06/10/25 07:09:00									
Metals									
Lead	16.9		1	1.0	µg/L	06/15/25 10:50	06/15/25 10:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0267 Lims Reference ID: ED53138-07 Matrix: Drinking Water Sampled: 06/10/25 07:07:00									
Metals									
Lead	2.0		1	1.0	µg/L	06/15/25 10:51	06/15/25 10:51	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0268 Lims Reference ID: ED53138-08 Matrix: Drinking Water Sampled: 06/10/25 07:09:00									
Metals									
Lead	6.1		1	1.0	µg/L	06/15/25 10:52	06/15/25 10:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0281 Lims Reference ID: ED53138-09 Matrix: Drinking Water Sampled: 06/10/25 07:20:00									
Metals									
Lead	1.8		1	1.0	µg/L	06/15/25 10:54	06/15/25 10:54	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553138**LIMS Reference ID:** ED53138**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Middle School: 3940 Sunset Avenue,
Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:13

Reported:

06/24/2025 08:58

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0285 Lims Reference ID: ED53138-10 Matrix: Drinking Water Sampled: 06/10/25 07:37:00									
Metals									
Lead	28.8		1	1.0	µg/L	06/15/25 10:55	06/15/25 10:55	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0299 Lims Reference ID: ED53138-11 Matrix: Drinking Water Sampled: 06/10/25 07:30:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 10:56	06/15/25 10:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0316 Lims Reference ID: ED53138-12 Matrix: Drinking Water Sampled: 06/10/25 07:49:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 11:00	06/15/25 11:00	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0323 Lims Reference ID: ED53138-13 Matrix: Drinking Water Sampled: 06/10/25 07:41:00									
Metals									
Lead	46.7		1	1.0	µg/L	06/15/25 11:02	06/15/25 11:02	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0324 Lims Reference ID: ED53138-14 Matrix: Drinking Water Sampled: 06/10/25 07:42:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 11:06	06/15/25 11:06	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0395 Lims Reference ID: ED53138-15 Matrix: Drinking Water Sampled: 06/10/25 07:26:00									
Metals									
Lead	3.1		1	1.0	µg/L	06/15/25 11:07	06/15/25 11:07	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0396 Lims Reference ID: ED53138-16 Matrix: Drinking Water Sampled: 06/10/25 07:27:00									
Metals									
Lead	2.8		1	1.0	µg/L	06/15/25 11:08	06/15/25 11:08	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0397 Lims Reference ID: ED53138-17 Matrix: Drinking Water Sampled: 06/10/25 07:27:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 11:10	06/15/25 11:10	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0401 Lims Reference ID: ED53138-18 Matrix: Drinking Water Sampled: 06/10/25 07:34:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 11:11	06/15/25 11:11	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553138**LIMS Reference ID:** ED53138**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Middle School: 3940 Sunset Avenue,
Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:13

Reported:

06/24/2025 08:58

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0402 Lims Reference ID: ED53138-19 Matrix: Drinking Water Sampled: 06/10/25 07:33:00									
Metals									
Lead	1.7		1	1.0	µg/L	06/15/25 11:12	06/15/25 11:12	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0404 Lims Reference ID: ED53138-20 Matrix: Drinking Water Sampled: 06/10/25 07:33:00									
Metals									
Lead	1.7		1	1.0	µg/L	06/15/25 11:14	06/15/25 11:14	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0405 Lims Reference ID: ED53138-21 Matrix: Drinking Water Sampled: 06/10/25 07:30:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:20	06/15/25 12:20	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0433 Lims Reference ID: ED53138-22 Matrix: Drinking Water Sampled: 06/10/25 08:06:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:24	06/15/25 12:24	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0434 Lims Reference ID: ED53138-23 Matrix: Drinking Water Sampled: 06/10/25 08:06:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:25	06/15/25 12:25	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0762 Lims Reference ID: ED53138-24 Matrix: Drinking Water Sampled: 06/10/25 08:33:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:26	06/15/25 12:26	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0763 Lims Reference ID: ED53138-25 Matrix: Drinking Water Sampled: 06/10/25 08:33:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:28	06/15/25 12:28	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0764 Lims Reference ID: ED53138-26 Matrix: Drinking Water Sampled: 06/10/25 07:23:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:32	06/15/25 12:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0765 Lims Reference ID: ED53138-27 Matrix: Drinking Water Sampled: 06/10/25 07:24:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:33	06/15/25 12:33	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553138**LIMS Reference ID:** ED53138**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Middle School: 3940 Sunset Avenue,
Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:13

Reported:

06/24/2025 08:58

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0766 Lims Reference ID: ED53138-28 Matrix: Drinking Water Sampled: 06/10/25 07:39:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:34	06/15/25 12:34	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0767 Lims Reference ID: ED53138-29 Matrix: Drinking Water Sampled: 06/10/25 07:39:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:36	06/15/25 12:36	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-1041 Lims Reference ID: ED53138-30 Matrix: Drinking Water Sampled: 06/10/25 07:08:00									
Metals									
Lead	3.4		1	1.0	µg/L	06/15/25 12:37	06/15/25 12:37	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-1043 Lims Reference ID: ED53138-31 Matrix: Drinking Water Sampled: 06/10/25 07:10:00									
Metals									
Lead	2950		50	50.0	µg/L	06/16/25 19:16	06/16/25 19:16	KT1	EPA 200.8 (Dig)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553138**LIMS Reference ID:** ED53138**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Middle School: 3940 Sunset Avenue,
Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:13

Reported:

06/24/2025 08:58

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553138**LIMS Reference ID:** ED53138**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford Middle School: 3940 Sunset Avenue,
Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:13

Reported:

06/24/2025 08:58

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53407

Building:

Seaford High School

SHS

Client:

Seaford Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Page 1 of 3

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SUFSD-0035	OF	2171	Special Education Office Nook	KC	6/11/2025	7:27:00 AM
SUFSD-0037	FL	2119	Faculty Lounge	KC	6/11/2025	7:11:00 AM
SUFSD-0060	HE	2135A	Home Economics Room	EC	6/11/2025	7:37:00 AM
SUFSD-0061	HE	2135	Home Economics Room	EC	6/11/2025	7:36:00 AM
SUFSD-0066	CA	2090	Cafeteria Right of Kitchen	WF	6/11/2025	6:39:00 AM
SUFSD-0068	KI	2082	Serving Area Left	HW	6/11/2025	6:26:00 AM
SUFSD-0069	KI	2082	Serving Area Right	HW	6/11/2025	6:26:00 AM
SUFSD-0070	KI	2082	Kitchen	KC	6/11/2025	6:26:00 AM
SUFSD-0078	KI	2082	Kitchen	KC	6/11/2025	6:30:00 AM
SUFSD-0079	KI	2082	Kitchen	KC	6/11/2025	6:31:00 AM
SUFSD-0087	SP	2030	Athletic Trainer	IM	6/11/2025	6:48:00 AM
SUFSD-0088	CA	2081	Cafeteria Left of Kitchen	WF	6/11/2025	6:41:00 AM
SUFSD-0089	CA	2081	Cafeteria Left of Kitchen	WC	6/11/2025	6:42:00 AM
SUFSD-0090	OF	2103	Guidance Office	KC	6/11/2025	7:15:00 AM
SUFSD-0094	NO	2095	Nurse's Office	NS	6/11/2025	6:54:00 AM
SUFSD-0113	SP	2038	School Store	KC	6/11/2025	6:56:00 AM
SUFSD-0172	HA	3089	Outside Room 210	WF	6/11/2025	7:07:00 AM
SUFSD-0212	SC	3027	Room 219	BW	6/11/2025	7:16:00 AM

Building Address

1575 Seamans Neck Road

Seaford, NY 11783

Analysis Type: ELAP 200.5

Lab Received: 6/11/25 13:15

Signature: [Signature]

Samplers Name: Maisha Yaseen

Samplers Signature: [Signature]

JCB Project Manager: Paul Fazio

RECEIVED

EWGL ANALYTICAL, INC.

Carle Place, NY

JUN 11 25, PM 01:15



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53407

Building: Seafood High School

SHS

Client:

Seafood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

EDS3139

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SUFSD-0213	SC	3027	Room 219	BW	6/11/2025	7:16:00 AM
SUFSD-0755	HA	2042	Corridor 105 to 118	WF	6/11/2025	6:52:00 AM
SUFSD-0756	HA	2042	Corridor 105 to 118	WC	6/11/2025	6:52:00 AM
SUFSD-0757	HA	2147	Corridor 123 to 130	WF	6/11/2025	7:22:00 AM
SUFSD-0758	HA	2147	Corridor 123 to 130	WC	6/11/2025	7:23:00 AM
SUFSD-0794	HA	2067	Corridor Boy's Bathroom to Women's Locker Room	WF	6/11/2025	7:05:00 AM
SUFSD-0795	HA	2067	Corridor Boy's Bathroom to Women's Locker Room	WC	6/11/2025	7:05:00 AM
SUFSD-0802	KI	2082	Kitchen	KC	6/11/2025	6:28:00 AM
SUFSD-0803	KI	2082	Kitchen	KC	6/11/2025	6:28:00 AM
SUFSD-0804	FL	2084	Faculty Lounge	KC	6/11/2025	6:30:00 AM
SUFSD-0805	FL	2084	Faculty Lounge	IM	6/11/2025	6:30:00 AM
SUFSD-0806	FL	2084	Faculty Lounge	CP	6/11/2025	6:34:00 AM
SUFSD-0807	FL	2084	Faculty Lounge	CP	6/11/2025	6:33:00 AM
SUFSD-0810	CA	2090	Cafeteria	WC	6/11/2025	6:40:00 AM
SUFSD-0814	FL	2196	Main Office Break Room	KC	6/11/2025	7:23:00 AM
SUFSD-0838	HA	3042	Corridor 220 to 226	WF	6/11/2025	7:12:00 AM
SUFSD-0839	HA	3042	Corridor 220 to 226	WC	6/11/2025	7:33:00 AM

RECEIVED
EHS ANALYTICAL, INC.
Carle Place, NY
JUN 11 25, PM 01:15

Building Address

1575 Seamans Neck Road

Seafood, NY 11783



Analysis Type: ELAP 200.5


Lab Received: 6/11/25, 13:15

Signature: [Signature]

Samplers Name: Maisha Yaseen

Samplers Signature: [Signature]

JCB Project Manager: Paul Fazio



Lead in Water: Chain of Custody for

ED53139

Page 3 of 3

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53407

Building:

Seaford High School

SHS

Client:

Seaford Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 35

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 11 25, PM 01:15

Building Address

1575 Seamans Neck Road

Seaford, NY 11783

Analysis Type: ELAP 200.5

Lab Received: 6/11/25 13:15

Signature: Kari Wagner

Samplers Name: Maisha Yaseen

Samplers Signature: Maisha Yaseen

JCB Project Manager: Paul Fazio

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553139**LIMS Reference ID:** ED53139**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford High School: 1575 Seamans Neck
Road, Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:15

Reported:

06/24/2025 09:00

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0035 Lims Reference ID: ED53139-01 Matrix: Drinking Water Sampled: 06/11/25 07:27:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:38	06/15/25 12:38	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0037 Lims Reference ID: ED53139-02 Matrix: Drinking Water Sampled: 06/11/25 07:11:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:42	06/15/25 12:42	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0060 Lims Reference ID: ED53139-03 Matrix: Drinking Water Sampled: 06/11/25 07:37:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:44	06/15/25 12:44	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0061 Lims Reference ID: ED53139-04 Matrix: Drinking Water Sampled: 06/11/25 07:36:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:48	06/15/25 12:48	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0066 Lims Reference ID: ED53139-05 Matrix: Drinking Water Sampled: 06/11/25 06:39:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:49	06/15/25 12:49	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0068 Lims Reference ID: ED53139-06 Matrix: Drinking Water Sampled: 06/11/25 06:26:00									
Metals									
Lead	1.4		1	1.0	µg/L	06/15/25 12:50	06/15/25 12:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0069 Lims Reference ID: ED53139-07 Matrix: Drinking Water Sampled: 06/11/25 06:26:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:52	06/15/25 12:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0070 Lims Reference ID: ED53139-08 Matrix: Drinking Water Sampled: 06/11/25 06:26:00									
Metals									
Lead	18.5		1	1.0	µg/L	06/15/25 12:53	06/15/25 12:53	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0078 Lims Reference ID: ED53139-09 Matrix: Drinking Water Sampled: 06/11/25 06:30:00									
Metals									
Lead	1.9		1	1.0	µg/L	06/15/25 12:54	06/15/25 12:54	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553139**LIMS Reference ID:** ED53139**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford High School: 1575 Seamans Neck
Road, Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:15

Reported:

06/24/2025 09:00

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0079 Lims Reference ID: ED53139-10 Matrix: Drinking Water Sampled: 06/11/25 06:31:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 12:56	06/15/25 12:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0087 Lims Reference ID: ED53139-11 Matrix: Drinking Water Sampled: 06/11/25 06:48:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 18:36	06/16/25 18:36	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: SUFSD-0088 Lims Reference ID: ED53139-12 Matrix: Drinking Water Sampled: 06/11/25 06:41:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:07	06/15/25 13:07	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0089 Lims Reference ID: ED53139-13 Matrix: Drinking Water Sampled: 06/11/25 06:42:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:11	06/15/25 13:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0090 Lims Reference ID: ED53139-14 Matrix: Drinking Water Sampled: 06/11/25 07:15:00									
Metals									
Lead	4.2		1	1.0	µg/L	06/15/25 13:12	06/15/25 13:12	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0094 Lims Reference ID: ED53139-15 Matrix: Drinking Water Sampled: 06/11/25 06:54:00									
Metals									
Lead	5.2		1	1.0	µg/L	06/15/25 13:13	06/15/25 13:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0113 Lims Reference ID: ED53139-16 Matrix: Drinking Water Sampled: 06/11/25 06:56:00									
Metals									
Lead	1.5		1	1.0	µg/L	06/15/25 13:15	06/15/25 13:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0172 Lims Reference ID: ED53139-17 Matrix: Drinking Water Sampled: 06/11/25 07:07:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:19	06/15/25 13:19	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0212 Lims Reference ID: ED53139-18 Matrix: Drinking Water Sampled: 06/11/25 07:16:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:20	06/15/25 13:20	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553139**LIMS Reference ID:** ED53139**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford High School: 1575 Seamans Neck
Road, Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:15

Reported:

06/24/2025 09:00

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0213 Lims Reference ID: ED53139-19 Matrix: Drinking Water Sampled: 06/11/25 07:16:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:21	06/15/25 13:21	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0755 Lims Reference ID: ED53139-20 Matrix: Drinking Water Sampled: 06/11/25 06:52:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:23	06/15/25 13:23	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0756 Lims Reference ID: ED53139-21 Matrix: Drinking Water Sampled: 06/11/25 06:52:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:24	06/15/25 13:24	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0757 Lims Reference ID: ED53139-22 Matrix: Drinking Water Sampled: 06/11/25 07:22:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:25	06/15/25 13:25	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0758 Lims Reference ID: ED53139-23 Matrix: Drinking Water Sampled: 06/11/25 07:23:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:29	06/15/25 13:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0794 Lims Reference ID: ED53139-24 Matrix: Drinking Water Sampled: 06/11/25 07:05:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:31	06/15/25 13:31	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0795 Lims Reference ID: ED53139-25 Matrix: Drinking Water Sampled: 06/11/25 07:05:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:35	06/15/25 13:35	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0802 Lims Reference ID: ED53139-26 Matrix: Drinking Water Sampled: 06/11/25 06:28:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:36	06/15/25 13:36	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0803 Lims Reference ID: ED53139-27 Matrix: Drinking Water Sampled: 06/11/25 06:28:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:37	06/15/25 13:37	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553139**LIMS Reference ID:** ED53139**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford High School: 1575 Seamans Neck
Road, Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:15

Reported:

06/24/2025 09:00

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SUFSD-0804 Lims Reference ID: ED53139-28 Matrix: Drinking Water Sampled: 06/11/25 06:30:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:39	06/15/25 13:39	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0805 Lims Reference ID: ED53139-29 Matrix: Drinking Water Sampled: 06/11/25 06:30:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:40	06/15/25 13:40	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0806 Lims Reference ID: ED53139-30 Matrix: Drinking Water Sampled: 06/11/25 06:34:00									
Metals									
Lead	1.7		1	1.0	µg/L	06/16/25 18:41	06/16/25 18:41	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: SUFSD-0807 Lims Reference ID: ED53139-31 Matrix: Drinking Water Sampled: 06/11/25 06:33:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 18:45	06/16/25 18:45	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: SUFSD-0810 Lims Reference ID: ED53139-32 Matrix: Drinking Water Sampled: 06/11/25 06:40:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:41	06/15/25 13:41	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0814 Lims Reference ID: ED53139-33 Matrix: Drinking Water Sampled: 06/11/25 07:23:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:43	06/15/25 13:43	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0838 Lims Reference ID: ED53139-34 Matrix: Drinking Water Sampled: 06/11/25 07:12:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:54	06/15/25 13:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SUFSD-0839 Lims Reference ID: ED53139-35 Matrix: Drinking Water Sampled: 06/11/25 07:33:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/15/25 13:58	06/15/25 13:58	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553139**LIMS Reference ID:** ED53139**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford High School: 1575 Seamans Neck
Road, Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:15

Reported:

06/24/2025 09:00

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553139**LIMS Reference ID:** ED53139**EMSL Customer ID:** JCBR50**Attention:** Paul Fazio

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
PFazio@JCBroderick.com

Project Name:

Seaford High School: 1575 Seamans Neck
Road, Seaford, NY 11783: Seaford Union Free
School District: Project# 22-53407

Customer PO:**EMSL Sales Rep:**

Jeromy Bish

Received:

06/11/2025 13:15

Reported:

06/24/2025 09:00

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.


Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Attachment 4:

Laboratory Certifications

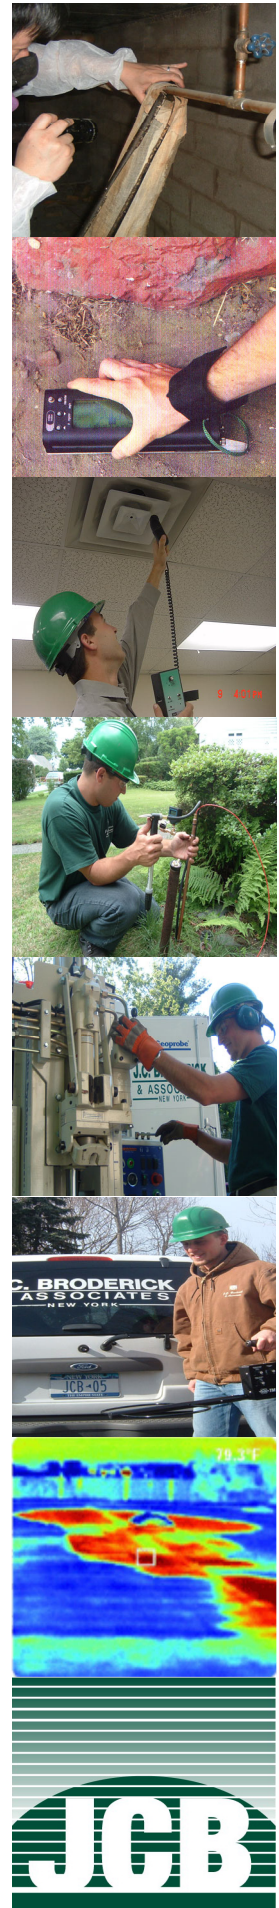

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2025
Issued April 01, 2024
Revised April 02, 2024

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Heterotrophic Plate Count	SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.8 Rev. 5.4
-------------	--------------------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------



Serial No.: 69238

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at <https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/>, by phone (518) 485-5570 or by email to elap@health.ny.gov.

