

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



August 13, 2025

Mr. Andrew Ward
Plainview-Old Bethpage Central School District
Administration Building
117 Central Park Road
Plainview, New York 11803

Re: **Lead Testing in School Drinking Water
Remedial Action Plan
2023-25 Compliance 10 NYCRR Subpart 67-4**

JCB#: **24-57432**

Dear Mr. Ward:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 5 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead in Water Remediation Plan
Attachment 2: Outlet Inventory and Lead Testing Results
Attachment 3: Laboratory Analytical Reports
Attachment 4: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.

Sincerely,

A handwritten signature in black ink, appearing to read 'George Greve', is positioned above the printed name.

George Greve
J C Broderick & Associates, Inc.

Attachment 1:

Lead in Water
Remediation Plan


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

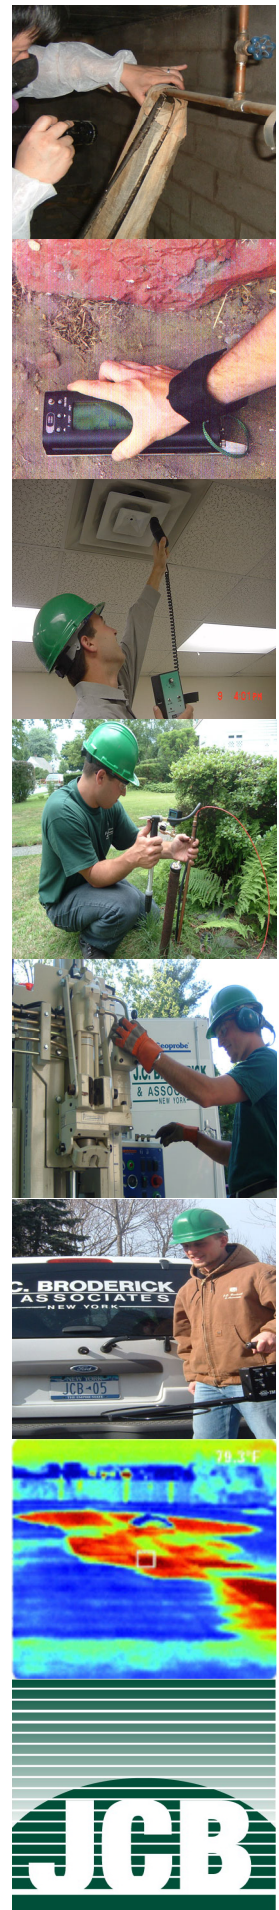

Lead in Water Remediation Plan

Section 67-4.4 Response of the New York State Department of Health (NYS DOH) Title 10 of the Official Compilation of the Codes, Rules and Regulations of the State of New York requires:

If the lead concentration of water at an outlet exceeds the action level, the school shall:

(a) prohibit use of the outlet until:

(1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and

(2) test results indicate that the lead levels are at or below the action level;

As historical sampling results have indicated, the concentrations of lead are more likely attributable to the individual fixtures and/or their immediately adjoining plumbing, and not with the building-wide plumbing. Based upon this information, the following remedial steps are recommended:

Step 1A: Potable Outlets (Outlets intended to be used for drinking/cooking)

Immediately remove the fixture from service. If necessary, provide an adequate supply of potable water for drinking/cooking to this location at no cost to the occupants. If an outlet is seldomly used or is unnecessary, the district may consider permanent removal of the outlet and capping of its supply line.

Step 1B: Non-Potable Outlets (Outlets not intended for drinking/cooking)


See Step 1A OR Placard the outlet for non-drinking use. Signs must be clearly visible and in close proximity to the affected outlet. Example signage is provided at: https://www.health.ny.gov/environmental/water/drinking/lead/docs/donotdrinksigns_lead.pdf.



Do not use for drinking



Hand washing only

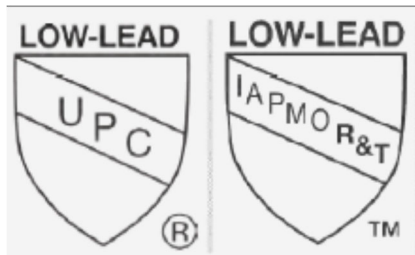

Step 2: Service & Repair or Outlet Replacement

The school district's plumber should evaluate the outlet to determine if any components require service or repair. Depending on the extent of service/repair necessary, age of the fixture, and or overall costs, the district may consider replacing the outlet entirely. Any newly installed components shall be certified lead free. (i.e. NSF/ANSI 61, NSF/ANSI-273). If servicing involves installing/replacing a point-of-use filtration system, this filter shall be certified for its lead reduction capability (i.e. NSF/ANSI 53). Follow all manufacturer's instructions for all component installations. OUTLET RESTRICTIONS MUST REMAIN IN PLACE UNTIL SATISFACTORY TEST RESULTS ARE RECEIVED. See Step 3.

Step 3: Retesting & Return to Service

Schedule a retest of the outlet. Outlet restrictions must remain in place until lead testing results at or below the action level are received. Once satisfactory results are received, the outlet may be returned to normal service. Note: It is recommended that "Do Not Drink" signage remain in place for all non-potable and non-applicable outlet types.

Attachment 2:

Outlet Inventory and Lead Testing Results


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

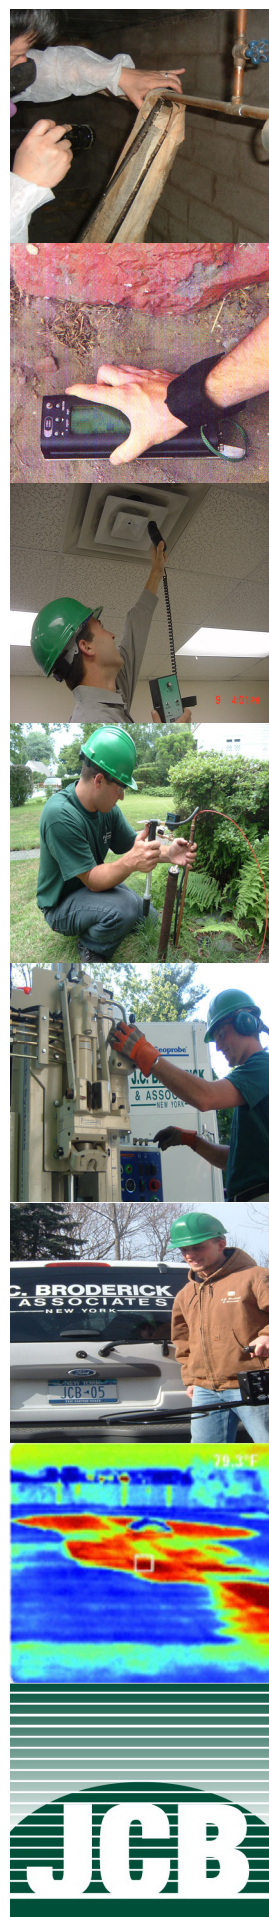



Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-57432

Plainview-Old Bethpage Central School District

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0002	Weight Room Bathroom Closet	1012	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0004	Gym Storage Room 2	2024	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0007	Custodial Old Incinerator Room	2010	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0008	Main Office Small Womens Bathroom	2104	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0009	Main Office Small Mens Bathroom	2103	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0010	Main Office Copy Room (Duplicating Room)	2093	Water Cooler	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0011	Main Office Copy Room (Duplicating Room)	2093	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0012	Guidance/Main Office Corridor	2064	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0014	Nurses Office	2101	Nurse's Office Sink	Potable	6/25/2025	3.3			Result Below Action Level Continue O&M
POB-0015	Nurses Office Suite Bathroom	2099	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0016	Guidance/Main Office Corridor	2064	Water Cooler	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0017	Guidance/Main Office Corridor	2064	Bottled Water Dispenser	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0019	Guidance/Main Office Corridor	2064	Water Cooler	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0020	Room 106 Girls PE Office Bathroom	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0021	Corridor Outside School Store	2136	Water Fountain-No Chiller	Potable	6/25/2025	3.5			Result Below Action Level Continue O&M
POB-0022	Cafeteria	2199	Water Cooler	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0023	Cafeteria	2199	Water Cooler	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0024	Cafeteria	2199	Bottled Water Dispenser	Potable	6/25/2025	1.6			Result Below Action Level Continue O&M
POB-0025	Kitchen Serving Area	2204	Kitchen Faucet (Cold)	Potable	6/25/2025	2.7			Result Below Action Level Continue O&M
POB-0026	Kitchen	2203	Ice Machine	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0027	Kitchen	2203	Kitchen Faucet (Cold)	Potable	6/25/2025	27.8			Removed From Service, Pending Remediation
POB-0028	Kitchen	2203	Coffe Pot	Non-Applicable					Placarded for Non-Drinking Use
POB-0029	Kitchen	2203	Coffe Pot	Non-Applicable					Placarded for Non-Drinking Use
POB-0030	Kitchen	2203	Kitchen Faucet (Cold)	Non-Applicable					Placarded for Non-Drinking Use
POB-0031	Kitchen	2203	Kitchen Faucet (Cold)	Potable	6/25/2025	24.2			Removed From Service, Pending Remediation
POB-0033	Kitchen	2203	Kitchen Faucet (Cold)	Potable	6/25/2025	2.6			Result Below Action Level Continue O&M
POB-0037	Kitchen Cafeteria Personnel	2265	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0038	Kitchen Disposal	2264	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0039	Kitchen	2203	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0042	Room 108	2211	Home Economics Faucet (Cold)	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0043	Room 108	2211	Home Economics Faucet (Cold)	Potable	6/25/2025	2.8			Result Below Action Level Continue O&M
POB-0044	Room 108	2211	Home Economics Faucet (Cold)	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0045	Room 108	2211	Home Economics Faucet (Cold)	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0047	Girls Bathroom	2111	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0051	Women's Bathroom	2113	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0052	Women's Bathroom	2113	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0053	Room 170	2179	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0054	Room 170	2179	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
POB-0055	Band Room Corridor	2026	Water Fountain-No Chiller	Potable	6/25/2025	7.0			Removed From Service, Pending Remediation
POB-0056	Custodial Closet	2133	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0057	Room 135	2161	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0058	Room 165 Darkroom	2189	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0059	Room 165	2190	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0060	Room 165	2190	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0061	Room 165	2190	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0062	Room 168 (Including Loft)	2191	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0063	Room 167	2194	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0064	Room 167	2194	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0065	Room 164	2196	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0066	Room 164	2196	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0067	Art Room 161	2198	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0068	Art Room 161	2198	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0069	Art Room 161	2198	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0070	Faculty Bathroom	2126	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0072	Library Office	2144	Hand Wash Only	Non-Potable	6/25/2025	3.2			Result Below Action Level Continue O&M
POB-0074	Girls Bathroom	2214	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0075	Girls Bathroom	2214	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0076	Girls Bathroom	2214	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0077	Girls Bathroom	2214	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0078	Custodial Closet	2217	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0079	Boys Bathroom	2218	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0080	Boys Bathroom	2218	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0081	Boys Bathroom	2218	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0082	Corridor From Room 142 To 159	2230	Water Fountain-No Chiller	Potable	6/25/2025	13.9			Removed From Service, Pending Remediation
POB-0083	New Wing Custodian Closet	New Construct	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0084	New Wing Corridor Rooms 195-198	New Construct	Water Cooler	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0085	New Wing Corridor Rooms 195-198	New Construct	Bottled Water Dispenser	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0086	New Wing Faculty Bathroom Adjacent to room 195A	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0087	Boys Phys. Ed Office Bathroom	2028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0089	Pool Room 105 Office Bathroom	2047	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0090	Custodial Closet A1	2054	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0091	Pool Room 105 Filter Room	2040	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0093	Custodial Closet	2029	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0094	Band Room Corridor	2026	Water Cooler	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0095	Band Room Corridor	2026	Bottled Water Dispenser	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0096	Boys Locker Room (Space Renovated)	2030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0097	Boys Locker Room (Space Renovated)	2030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0098	Boys Locker Room (Space Renovated)	2030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0099	Girls Locker Room (Space Renovated)	2055	Water Cooler	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0100	Girls Locker Room (Space Renovated)	2055	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0101	Girls Locker Room (Space Renovated)	2055	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0102	Girls Locker Room Bathroom	2056	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0103	Girls Locker Room Bathroom	2056	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0104	Girls Locker Room Bathroom	2056	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0105	Girls Team Locker Room (Now Part Of Space 2060)	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0106	Girls Team Locker Room (Now Part Of Space 2060)	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0107	Girls Team Locker Room (Formerly Pool Room 105)	2043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0108	Girls Team Locker Room (Formerly Pool Room 105)	2043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0110	OUTSIDE 2179	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0114	OUTSIDE 2245	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0116	OUTSIDE 2136	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0117	Guidance Office/Main Office Inner Connecting Hallway	2105	Water Fountain-No Chiller	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0118	Social Studies Dept. Room 113	2140	Classroom Faucet	Non-Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0119	Corridor Rooms 134-138	2168	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0120	Corridor Room 120 To 130	2253	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0121	Men's Faculty Bathroom	2249	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0122	Men's Faculty Bathroom	2249	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0123	Custodial Closet	2251	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0124	Ladies Faculty Bathroom	2252	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0125	Ladies Faculty Bathroom	2252	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0127	Math Dept. Room 207	3003	Kitchen Faucet (Cold)	Potable	6/25/2025	14.5			Removed From Service, Pending Remediation
POB-0130	Corridor Room 200-238	3076	Water Fountain-No Chiller	Potable	6/25/2025	5.0			Result Below Action Level Continue O&M
POB-0131	Boys Bathroom	3077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0132	Boys Bathroom	3077	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0133	Lounge Bathroom	3018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0134	Lounge Bathroom	3018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0135	Lounge Bathroom	3018	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0136	Room 212A	3019A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0137	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0138	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0139	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0140	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0141	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0142	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0143	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0144	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0145	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0146	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0147	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0148	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0149	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0150	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0151	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0152	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0153	Room 228	3045	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-0154	Man Faculty Bathroom	3051	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0155	Man Faculty Bathroom	3051	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0156	Man Faculty Bathroom	3051	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0157	Science Dept. Room 226	3052	Kitchen Faucet (Cold)	Potable	6/25/2025	1.1			Result Below Action Level Continue O&M
POB-0160	Custodial Closet	3055	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0161	Boys Bathroom	3056	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0163	Corridor Room 200-238	3076	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0164	Room 229	3075	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0165	Room 229	3075	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0166	Room 229	3075	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0167	Room 229	3075	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0168	Room 229	3075	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0169	Room 229	3075	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0170	Room 229	3075	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0171	Room 229	3075	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0172	Room 229	3075	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-0173	Room 229	3075	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-0174	Prep Room 231	3073	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0193	Room 230	3059	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-0196	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0197	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0198	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0199	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0200	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0201	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0202	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0203	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0204	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0205	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0206	Room 233	3072	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0207	Room 233	3072	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0208	Room 234	3062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0209	Room 234	3062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0212	Room 234	3062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0213	Room 234	3062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0214	Room 234	3062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0217	Room 234	3062	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-0218	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0219	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0220	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0221	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0222	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0223	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0224	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0225	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0226	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0227	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0228	Room 236	3071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0229	Room 236	3071	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-0248	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0250	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0251	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0252	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0253	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0254	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0255	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0256	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0258	Room 238	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0259	Room 238	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0260	Room 238	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0261	Room 238	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0262	Room 238	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0263	Room 238	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0264	Room 238	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0265	Room 238	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0267	Room 238	3069	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-0268	Corridor Room 200-238	3076	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0270	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0273	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0274	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0275	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0278	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0279	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0280	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0281	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0282	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0283	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0285	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0286	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0288	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0289	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0291	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0292	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0293	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0294	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0295	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0296	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0297	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0298	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0299	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0300	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0301	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0302	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0303	297	New Construct	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-0305	296P	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0306	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0307	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0308	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0309	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0310	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0311	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0312	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0313	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0314	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0315	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0316	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0317	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0318	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0319	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0320	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0321	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0322	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0323	296	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0324	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0325	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0326	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0327	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0328	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0329	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0331	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0332	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0333	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0334	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0335	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0336	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0337	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0338	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0339	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0340	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0341	295	New Construct	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-0342	CORRIDOR OUTSIDE 295	New Construct	Water Fountain-No Chiller	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0343	CORRIDOR OUTSIDE 296	New Construct	Water Fountain-No Chiller	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0344	Bathroom Close to 3037	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0357	Room 224	3041	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0358	Corridor Room 217-223	3039	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0359	Room 221	3034	Hand Wash Only	Non-Potable	6/25/2025	13.5			Placarded for Non-Drinking Use Until Remediated
POB-0360	IN COURT YARD OUTSIDE 2157	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1796	Boys Bathroom	2112	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1843	Left Bathroom	Comfort Station	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1844	Exterior	Comfort Station	Water Cooler	Non-Applicable					Placarded for Non-Drinking Use
POB-1845	Exterior	Comfort Station	Water Cooler	Non-Applicable					Placarded for Non-Drinking Use
POB-1846	Right Bathroom	Comfort Station	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1847	Kitchen	Comfort Station	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1848	Kitchen	Comfort Station	Kitchen Faucet (Cold)	Potable	6/25/2025	8.2			Removed From Service, Pending Remediation
POB-1849	Exterior	Comfort Station	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1850	Exterior	Comfort Station	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1855	Band Room 178 Instrument Storage	2000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1856	Weight Room (Space Renovated)	1000	Bottle Fill Station	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1857	Weight Room (Space Renovated)	1000	Water Cooler	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1858	Storage Room	1020	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1859	Custodial Old Incinerator Room	2010	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1860	Kitchen	2203	Kitchen Faucet (Cold)	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1861	Kitchen	2203	Kitchen Faucet (Cold)	Potable	6/25/2025	3.3			Result Below Action Level Continue O&M
POB-1862	Kitchen	2203	Kitchen Faucet (Cold)	Potable	6/25/2025	1.1			Result Below Action Level Continue O&M
POB-1863	Kitchen	2203	Kitchen Faucet (Cold)	Potable	6/25/2025	3.6			Result Below Action Level Continue O&M
POB-1864	Kitchen	2203	Pasta Pot/Steam Kettle	Non-Applicable					Placarded for Non-Drinking Use
POB-1865	Kitchen	2203	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1866	Room 110	2207	Water Cooler	Non-Applicable					Placarded for Non-Drinking Use
POB-1867	Room 109C Room 109C	2209A	Home Economics Faucet (Cold)	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1868	Room 109C	2209A	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
POB-1869	Girls Bathroom	2111	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1870	Boys Bathroom	2112	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1871	Boys Bathroom	2112	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1872	Women's Bathroom Personal Bathroom	2117	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1873	English Office	2149	Hand Wash Only	Non-Potable	6/25/2025	4.9			Result Below Action Level Continue O&M
POB-1874	Corridor Outside Room 140 & 141	2171	Water Cooler	Non-Applicable					Placarded for Non-Drinking Use
POB-1875	New Wing Facultt Bathroom Adjacent to Room 195A	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1876	Courtyard Adjacent to New Wing 195-198	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1877	Courtyard Outside Room 132	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1878	B Wing Locker Area	2064	Bottle Fill Station	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1879	Trainers Room/Nurse Room 103	2097	Ice Machine	Potable	6/25/2025	1.1			Result Below Action Level Continue O&M

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1880	Pool Room 105	2045	Water Fountain-No Chiller	Potable	6/25/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1881	Pool Room 105	2045	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1882	Boys Locker Room Football Bathroom	2039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1883	Boys Locker Room Football Bathroom	2039	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1884	Girls Bathroom	3005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1885	Girls Bathroom	3005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1886	Girls Bathroom	3005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1887	Custodial Closet	3006	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1888	Room 228	3045	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1889	Girls Bathroom	3054	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1890	Girls Bathroom	3054	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1891	Boys Bathroom	3056	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1892	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1893	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1894	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1895	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1896	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1897	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1898	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1899	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1900	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1901	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1902	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1903	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1904	Room 230	3059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1905	Room 232	3060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1906	Room 232	3060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1907	Room 234	3062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1908	Room 234	3062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1909	Room 234	3062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1910	Room 234	3062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1911	Prep Room 237	3070	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1912	Room 235	3063	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1913	Room 235	3063	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1914	Room 235	3063	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1915	Room 235	3063	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1916	Room 235	3063	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1917	Room 235	3063	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1918	Room 235	3063	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-1919	235-239 Prep Room	3065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1920	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1921	Room 239	3064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1922	Room 238	3069	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1923	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1924	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1925	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1926	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1927	298	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1928	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1929	297	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1930	295	New Construct	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1931	Room 225	3042	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1932	Room 225	3042	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1933	Room 225	3042	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1934	Room 225	3042	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1935	Room 225	3042	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1936	Room 225	3042	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1937	Outside 2196	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1938	Outside 2229	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1939	Outside Room 195	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

John F. Kennedy High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1940	Outside 2163	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1941	Outside Room 193	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1942	Outside 2255	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1943	Outside 2207 Outside 2063	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1944	Outside 2087	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1945	Outside 2063	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1946	Outside 2002 Outside 2002	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1947	Outside 2179	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0361	Room 100	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0362	Room 101	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0363	Room 103	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0364	Room 105	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0365	Room 107	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0366	Room 109	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0367	Corridor Room 100 To 109	2019	Water Cooler	Potable	6/19/2025	1.2			Result Below Action Level Continue O&M
POB-0368	Room 110	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0369	Room 108	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0370	Room 106	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0371	Room 104	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0372	Room 102	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0373	Corridor Room 100 To 109	2019	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0374	Girls Bathroom	2013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0375	Girls Bathroom	2013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0376	Girls Bathroom	2013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0377	Slop Sink Closet	2015	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0378	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0379	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0380	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0381	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0382	Men's Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0383	Women's Bathroom	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0384	Room 309	2023	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0385	Corridor Room 300 To 309	2057	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0386	Corridor Room 300 To 309	2057	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0387	Auditorium Bathroom	2051C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0388	Boiler Room	1001	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0389	Corridor Room 303 To Auditorium	2056	Water Fountain-No Chiller	Potable	6/19/2025	1.7			Result Below Action Level Continue O&M
POB-0390	Custodial Room Bathroom	2054	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0391	Custodial Room Bathroom	2054	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0392	Chorus Room 301/302 Book Storage Room	2042	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0393	Corridor Room 303 To Auditorium	2056	Water Fountain-No Chiller	Potable	6/19/2025	2.4			Result Below Action Level Continue O&M
POB-0394	Women's Bathroom	2035	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0395	Men's Bathroom	2034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0396	Main Office	2059	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0397	Main Office	2059	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0398	Faculty Lounge 130	2082	Hand Wash Only	Non-Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0399	Nurses Office	2087	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0400	Nurses Office Bathroom	2088	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0401	Corridor Room 112 To 120	2127	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0402	Boys Bathroom	2114	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0403	Boys Bathroom	2114	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0404	Boys Bathroom	2114	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0405	Boys Bathroom	2114	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0406	Custodial Closet	2109	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0407	Girls Bathroom	2115	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0408	Girls Bathroom	2115	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0409	Girls Bathroom	2115	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0410	Room 111	2112	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0411	Room 113	2117	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0412	Room 115	2121	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0413	Room 117	2123	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0414	Room 120	2124	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0415	Room 118	2120	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0416	Room 116	2116A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0417	Faculty Office Room 114	2110	Hand Wash Only	Non-Potable	6/19/2025	3.0			Result Below Action Level Continue O&M
POB-0418	Room 112 Office	2107	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0419	Cafeteria Girls Bathroom	2095A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0420	Cafeteria Boys Bathroom	2095A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0421	Cafeteria	2095	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0422	Cafeteria	2095	Water Cooler	Potable	6/19/2025	1.1			Result Below Action Level Continue O&M
POB-0423	Cafeteria	2095	Water Cooler	Potable	6/19/2025	1.0			Result Below Action Level Continue O&M
POB-0424	Kitchen	2097	Kitchen Faucet (Cold)	Potable	6/19/2025	7.5			Removed From Service, Pending Remediation
POB-0425	Kitchen	2097	Kitchen Faucet (Cold)	Potable	6/19/2025	2.8			Result Below Action Level Continue O&M
POB-0426	Kitchen	2097	Kitchen Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0427	Kitchen	2097	Kitchen Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0428	Kitchen	2097	Kitchen Faucet (Cold)	Potable	6/19/2025	4.0			Result Below Action Level Continue O&M
POB-0429	Kitchen	2097	Kitchen Faucet (Cold)	Potable	6/19/2025	15.4			Removed From Service, Pending Remediation
POB-0430	Kitchen	2097	Kitchen Faucet (Cold)	Potable	6/19/2025	4.8			Result Below Action Level Continue O&M
POB-0431	Kitchen Bathroom	2099	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0432	Kitchen Slop Sink	2098	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0433	Kitchen Slop Sink	2098	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0434	Kitchen Slop Sink	2098	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0435	Recreation Room Slop Sink Closet	2170	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0436	Recreation Room Hallway To Gym	2159	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0437	Recreation Room Bathroom	2160	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0438	Recreation Room Bathroom	2160	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0439	Gym Locker Room Rear Vestibule	2151	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0440	Entrance Lobby By Gym	2128	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0441	Kindergarten Nurse Bathroom	2138	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0442	Custodial Storage Room Maintenance Locker Room	2078	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0443	Old Library	3003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0446	Room 228/230 Bathroom	3009A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0449	School Psychologist	3011	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0450	ESL	3047B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0451	Room 203	3055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0452	Room 205	3061	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0453	Corridor Room 201 To 210A	3086	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0454	Room 207	3063	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0455	Room 209	3067	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0456	Room 211	3071	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0457	Room 213	3075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0459	Room 215	3079	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0460	Room 210	3077	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0461	Room 208	3082	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0462	Room 206	3073	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0463	Room 204	3069	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0464	Room 202	3065	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0465	Girls Bathroom	3060	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0466	Girls Bathroom	3060	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0467	Girls Bathroom	3060	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0468	Girls Bathroom	3060	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0469	Girls Bathroom	3060	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0470	Main Office	2059	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0471	Boys Bathroom	3058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0472	Boys Bathroom	3058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0473	Boys Bathroom	3058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0474	Boys Bathroom	3058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0475	Corridor Room 214 To 227	3044	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0476	Men's Bathroom	3017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0477	Men's Bathroom	3017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0478	Men's Bathroom	3017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0479	Men's Bathroom	3017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0480	Custodial Closet	3018	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0481	Women's Bathroom	3019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0482	Women's Bathroom	3019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0483	Women's Bathroom	3019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0484	Women's Bathroom	3019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0485	Women's Bathroom	3019	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0486	Room 217	3024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0487	Room 219	3026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0488	Room 221	3030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0489	Room 223	3034	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0490	Room 225	3038	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0491	Art Room 226	3039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0492	Room 224	3036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0493	Room 222	3032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0494	Room 220	3028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0495	Room 218	3022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0496	Room 216	3020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0497	Room 214	3015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0498	Gym Office Bathroom	2168	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0499	Large Gym	2133	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0500	Corridor Mens Bathroom	2137	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0501	Gym Office Bathroom	2142	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0502	K. Cafeteria	2104	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0503	K. Cafeteria	2104	Water Cooler	Potable	6/19/2025	3.2			Result Below Action Level Continue O&M
POB-0504	K. Cafeteria	2104	Water Cooler	Potable	6/19/2025	3.5			Result Below Action Level Continue O&M
POB-0505	Room 303	2029	Hand Wash Only	Non-Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1788	Gym Locker Room Rear Vestibule	2151	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1789	Girls Locker Room Bathrrom	2149	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1790	Girls Locker Room Bathrrom	2149	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1837	Large Gym	2133	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2049	Girls Bathroom	2013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2050	Girls Bathroom	2013	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-2051	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2052	Boys Bathroom	2016	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-2055	Nurses Office	2087	Nurse's Office Sink	Potable	6/19/2025	5.8			Removed From Service, Pending Remediation
POB-2056	Nurses Office	2087	Nurse's Office Sink	Potable	6/19/2025	2.1			Result Below Action Level Continue O&M
POB-2057	Nurses Office Bathroom	2088	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2058	Nurses Office Bathroom	2088	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-2059	Girls Bathroom	2115	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2060	Girls Bathroom	2115	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2061	Girls Bathroom	2115	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2062	Boys Bathroom	2114	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2063	Boys Bathroom	2114	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2064	Boys Bathroom	2114	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2067	Kitchen	2096/2097	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
POB-2068	Kitchen	2096/2097	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-2069	Kitchen	2096/2097	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-2070	Corridor Mens Bathroom	2137	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2071	Room 228	3010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2072	Room 228	3010	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-2073	Room 230	3009A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2074	Room 230	3009A	Water Fountain-No Chiller	Potable	6/19/2025	40.5			Removed From Service, Pending Remediation
POB-2075	Book Storage Room	3052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2076	Corridor Room 201 To 210A	3086	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2077	Room 210	3077	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2078	Girls Bathroom	3060	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2079	Girls Bathroom	3060	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2080	Girls Bathroom	3060	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2081	Boys Bathroom	3058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2082	Boys Bathroom	3058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2083	Boys Bathroom	3058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2084	Boys Bathroom	3058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2085	Men's Bathroom	3017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2086	Men's Bathroom	3017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2087	Men's Bathroom	3017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2088	Men's Bathroom	3017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Stratford Road Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-2089	Women's Bathroom	3019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2090	Women's Bathroom	3019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2091	Women's Bathroom	3019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2094	Room 221	3030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2095	Room 224	3036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2096	Room 225	3038	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Parkway Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0506	Room 37	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0507	Room 38	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0508	Room 35	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0509	Room 36	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0510	Corridor Room 31 To 38	2014	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0511	Boys Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0512	Boys Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0514	Boys Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0515	Boys Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0516	Boys Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0517	Girls Bathroom	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0518	Girls Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0519	Girls Bathroom	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0520	Girls Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0521	Girls Bathroom	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0522	Girls Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0523	Girls Bathroom	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0524	Girls Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0525	Girls Bathroom	2005	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0527	Room 33 Vestibule	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Parkway Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0528	Room 34	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0529	Room 31	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0530	Room 32	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0531	Main Corridor	2052	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0532	Main Corridor	2052	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0533	Main Corridor	2052	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0534	Room 22	2020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0535	Room 21	2022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0536	Room 24	2024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0537	Room 23	2023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0539	Girls Bathroom	2025	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0540	Girls Bathroom	2025	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0541	Girls Bathroom	2025	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0542	Boys Bathroom	2026	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0543	Boys Bathroom	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0544	Boys Bathroom	2026	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0545	Boys Bathroom	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0546	Boys Bathroom	2026	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0547	Boys Bathroom	2026	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0548	Corridor Room 21 To 28	2032	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use

Parkway Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0549	Room 26	2027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0550	Room 25	2028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0551	Room 28	2030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0552	Room 27	2029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0553	Room 12	2033B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0554	Room 11	2035A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0555	Room 11	2035A	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0556	Room 14	2037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0557	Room 14	2037	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0558	Room 14 Bathroom	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0559	Room 13	2039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0560	Room 13	2039	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0561	Room 13 Bathroom	2040	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0562	Room 13 Bathroom	2040	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0563	Boys Bathroom	2043	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0564	Boys Bathroom	2043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0565	Boys Bathroom	2043	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0566	Boys Bathroom	2043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0567	Boys Bathroom	2043	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0568	Girls Bathroom	2044	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Parkway Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0569	Girls Bathroom	2044	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0570	Girls Bathroom	2044	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0571	Girls Bathroom	2044	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0572	Girls Bathroom	2044	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0573	Girls Bathroom	2044	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0574	Girls Bathroom	2044	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0575	Room 16A (Interior Walls Removed)	2045A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0576	Room 16A (Interior Walls Removed)	2045A	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0577	Room 15	2046	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0578	Room 15	2046	Water Fountain-No Chiller	Potable	6/19/2025	2.8			Result Below Action Level Continue O&M
POB-0579	Art Room 18	2047	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0580	Art Room 18	2047	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0581	Room 17	2048	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0582	Library Storage	New Construct	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0585	Main Office Kitchen	2060	Kitchen Faucet (Cold)	Potable	6/19/2025	2.5			Result Below Action Level Continue O&M
POB-0586	Principle's Office Bathroom	2067	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0587	Womens Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0588	Womens Bathroom	2068	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0589	Mens Bathroom	2069	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0590	Mens Bathroom	2069	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Parkway Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0591	Nurses Office	2071/2072	Nurse's Office Sink	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0592	Nurses Office Bathroom	2070	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0593	Room 20	2078	Kitchen Faucet (Cold)	Non-Applicable					Placarded for Non-Drinking Use
POB-0594	Room 20	2078		Non-Applicable					Placarded for Non-Drinking Use
POB-0595	Custodial Closet Adjacent Room 20	2077	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0596	Art Room 01	2085	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0597	Art Room 01	2085	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0598	Art Room 01	2085	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0599	Art Room 01	2087	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0600	Faculty Room 1 Bathroom	2087	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0601	Music Room 2 Bathroom	2090	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0602	Music Room 2 Bathroom	2090	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0603	Music Room 2 Closet	2089	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0604	Kitchen	2099	Hand Wash Only	Non-Potable	6/19/2025	2.0			Result Below Action Level Continue O&M
POB-0605	Kitchen	2099	Hand Wash Only	Non-Potable	6/19/2025	1.6			Result Below Action Level Continue O&M
POB-0606	Kitchen	2099	Kitchen Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0607	Kitchen	2099	Kitchen Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0608	Kitchen	2099	Kitchen Faucet (Cold)	Potable	6/19/2025	4.0			Result Below Action Level Continue O&M
POB-0609	Kitchen	2099	Kitchen Faucet (Cold)	Potable	6/19/2025	25.1			Removed From Service, Pending Remediation
POB-0610	Kitchen	2099	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Parkway Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0611	Kitchen	2099	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0612	Kitchen	2099	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0613	Kitchen Locker Room Bathroom	2093	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0614	Kitchen Locker Room Bathroom	2093	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0615	Cafeteria/Auditorium	2100	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0616	Cafeteria/Auditorium	2100	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0617	Cafeteria/Auditorium	2100	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0618	Boys Bathroom	2111	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0619	Boys Bathroom	2111	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0620	Girls Bathroom	2111	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0621	Girls Bathroom	2111	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0622	Girls Bathroom	2111	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0623	PE Office	2113	Hand Wash Only	Non-Potable	6/19/2025	1.9			Result Below Action Level Continue O&M
POB-0624	Corridor Outside Gymnasium & PE Rooms	2105/2107/2122	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0625	Music Room/Special Ed Room 3	2123	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0626	Art Room 4	2124B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0627	Art Room 4	2124B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0628	Faculty Room	2118	Hand Wash Only	Non-Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0629	Custodial Closet #2	2012	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0630	Boiler Room Balcony Area	2130/2131	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

Parkway Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0631		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0632		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0633		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0634		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0635		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0636		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0637		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0638		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0639		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1793	Boys Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1794	Main Office & AP Office Area	2055	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1795	Main Office & AP Office Area	2055	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0640	Corridor Room 314 To 328	3022	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0641	Women's Faculty Restroom	3003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0642	Women's Faculty Restroom	3003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0643	Men's Faculty Restroom	3004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0644	Men's Faculty Restroom	3004	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0645	Boys Bathroom	3005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0646	Boys Bathroom	3005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0647	Boys Bathroom	3005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0648	Boys Bathroom	3005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0649	Boys Bathroom	3005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0650	Custodial Closet	3006	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0651	Girls Bathroom	3008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0652	Girls Bathroom	3008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0653	Girls Bathroom	3008	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0654	Girls Bathroom	3008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0655	Girls Bathroom	3008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0656	Girls Bathroom	3008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0657	Girls Bathroom	3008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0658	Girls Bathroom	3008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0659	Corridor Room 314 To 328	3022	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0660	Corridor Room 301 To Boys Bathroom	3055	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0661	Boys Bathroom	3034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0662	Boys Bathroom	3034	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0663	Boys Bathroom	3034	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0664	Boys Bathroom	3034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0665	Boys Bathroom	3034	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0666	Boys Bathroom	3034	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0667	Custodial Closet	3035	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0669	Girls Bathroom	3037	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0670	Girls Bathroom	3037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0671	Girls Bathroom	3037	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0672	Girls Bathroom	3037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0673	Girls Bathroom	3037	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0674	Girls Bathroom	3037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0675	Girls Bathroom	3037	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0676	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0677	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0678	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0679	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0680	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0681	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0683	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0684	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0685	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0686	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0687	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0688	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0689	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0690	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0691	Room 302	3052	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
POB-0692	Room 302/304 Prep Room	3050	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0693	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0694	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0695	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0696	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0698	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0699	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0700	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0701	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0702	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0703	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0704	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0705	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0706	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0707	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0709	Room 301/303 Prep Room	3048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0710	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0711	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0712	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0713	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0714	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0715	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0716	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0717	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0718	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0719	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0720	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0721	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0722	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0723	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0724	Room 304	3049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0725	Room 304	3049	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
POB-0726	Room 307 Math Office	3042	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0728	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0729	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0730	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0731	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0732	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0733	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0734	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0735	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0736	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0737	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0738	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0739	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0740	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0741	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0742	Room 309	3038	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0743	Fan Room Corridor	3062	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0744	Fan Room Corridor	3062	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0745	Room 309	3038	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
POB-0747	Boys Bathroom	2002	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0748	Boys Bathroom	2002	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0749	Boys Bathroom	2002	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0750	Boys Bathroom	2002	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0751	Boys Bathroom	2002	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0752	Custodial Closet	2003	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0753	Girls Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0754	Girls Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0755	Girls Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0756	Girls Bathroom	2005	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0757	Principals Office Bathroom	2029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0758	Guidance Office Conference Room	2027	Kitchen Faucet (Cold)	Non-Applicable					Placarded for Non-Drinking Use
POB-0759	Main Office Bathroom	2033	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0760	Art Room 206	2072	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0763	Men's Faculty Bathroom	2074	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0764	Men's Faculty Bathroom	2074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0765	Men's Faculty Bathroom	2074	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0766	Men's Faculty Bathroom	2074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0767	Women's Faculty Bathroom	2075	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0768	Women's Faculty Bathroom	2075	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0769	Women's Faculty Bathroom	2075	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0770	Girls Locker Room	2077	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0771	Girls Locker Room	2077	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0772	Girls Locker Room	2077	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0773	Girls Locker Room	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0774	Girls Locker Room	2077	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0775	Girls Locker Room	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0776	Girls Locker Room	2077	Water Fountain-No Chiller	Potable	6/19/2025	2.1			Result Below Action Level Continue O&M
POB-0777	Girls Locker Room	2077	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0778	Boys Locker Room Bathroom	2088	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0779	Boys Locker Room Bathroom	2098	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0780	Boys Locker Room Bathroom	2098	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0781	Boys Locker Room Bathroom	2098	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0783	Boys Locker Room Bathroom	2098	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0784	Boys Locker Room Office	2105	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0786	Women's Faculty Bathroom	2182	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0787	Corridor From Tract Center To Stairwell	2192	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0788	Men's Faculty Bathroom	2183	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0789	Men's Faculty Bathroom	2183	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0790	Girls Bathroom	2186	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0791	Girls Bathroom	2186	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0792	Girls Bathroom	2186	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0793	Girls Bathroom	2186	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0794	Girls Bathroom	2186	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0795	Girls Bathroom	2186	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0796	Girls Bathroom	2186	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0797	Women's Bathroom	1006	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0798	Women's Bathroom	1006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0799	Women's Bathroom	1006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0800	Corridor Outside Room 109 & 111	1008	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0801	Men's Bathroom	1007	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0802	Men's Bathroom	1007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0803	Men's Bathroom	1007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0804	Room 111	1002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0805	Room 111	1002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0806	Pool	2118	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0807	Pool Girls Locker	2110	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0808	Pool Girls Locker	2110	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0809	Pool Girls Locker	2110	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0810	Pool Girls Locker	2110	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0811	Pool Girls Locker	2110	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0812	Pool Boys Locker	2113	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0813	Pool Boys Locker	2113	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0814	Pool Boys Locker	2113	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0815	Pool Boys Locker	2113	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0816	Pool Boys Locker	2113	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0817	Cafeteria	2051	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0818	Cafeteria	2051	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0819	Cafeteria	2051	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0820	Room 204	2068	Home Economics Faucet (Cold)	Potable	6/19/2025	10.7			Removed From Service, Pending Remediation
POB-0821	Room 204	2068	Home Economics Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0822	Room 204	2068	Home Economics Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0823	Room 204	2068	Home Economics Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0824	Room 204 TV Storage Room	2070	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0825	Room 204 TV Storage Room	2070	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0826	Room 202	2067	Home Economics Faucet (Cold)	Potable	6/19/2025	1.3			Result Below Action Level Continue O&M
POB-0827	Room 202	2067	Home Economics Faucet (Cold)	Potable	6/19/2025	1.2			Result Below Action Level Continue O&M
POB-0828	Room 202	2067	Home Economics Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0829	Room 202	2067	Home Economics Faucet (Cold)	Potable	6/19/2025	3.0			Result Below Action Level Continue O&M

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0830	Kitchen Serving Area	2052	Hand Wash Only	Non-Potable	6/19/2025	2.4			Result Below Action Level Continue O&M
POB-0831	Kitchen Serving Area	2052	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0832	Kitchen Serving Area	2052	Kitchen Faucet (Cold)	Potable	6/19/2025	1.0			Result Below Action Level Continue O&M
POB-0833	Kitchen Serving Area	2052	Kitchen Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0834	Kitchen Serving Area	2052	Kitchen Faucet (Cold)	Potable	6/19/2025	4.3			Result Below Action Level Continue O&M
POB-0836	Kitchen Serving Area	2052	Hand Wash Only	Non-Potable	6/19/2025	9.7			Placarded for Non-Drinking Use Until Remediated
POB-0837	Nurses Office Bathroom	2012	Nurse's Office Sink	Potable	6/19/2025	7.4			Removed From Service, Pending Remediation
POB-0838	Nurses Office Bathroom	2012	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0839	Corridor Along Right Side Of Auditorium	2137	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-0840	Room 231 Storage Room	2162	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0841	Corridor Outside Room 231	2163	Water Fountain-No Chiller	Potable	6/19/2025	5.5			Removed From Service, Pending Remediation
POB-0842	Women's Bathroom	2152	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0843	Women's Bathroom	2152	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0844	Women's Bathroom	2152	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0845	Women's Bathroom	2152	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0846	Men's Faculty Bathroom	2154	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0847	Men's Faculty Bathroom	2154	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0848	Men's Faculty Bathroom	2154	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0849	Men's Faculty Bathroom	2154	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0850	Art Room 225	2203	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0851	Art Room 225	2203	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0852	Art Room 225	2203	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0853	Art Room 225	2203	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0854	Art Room 225	2203	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0855	Art Room 225	2203	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0856	Art Room 223	2206	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0857	Art Room 223	2206	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0858	Art Room 223	2206	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0859	Art Room 223	2206	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0860	Art Room 223	2206	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0861	Art Room 223	2206	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0862	Corridor Art Gallery To Room 225	2213	Water Fountain-No Chiller	Potable	6/19/2025	9.6			Removed From Service, Pending Remediation
POB-0863	Custodial Closet	2187	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0864	Boys Bathroom	2189	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0865	Boys Bathroom	2189	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0866	Boys Bathroom	2189	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0867	Boys Bathroom	2189	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0868	Boys Bathroom	2189	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0869	Boys Bathroom	2189	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0870	Boys Bathroom	2189	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0871	Room 233	2123	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0872	Room 235	2127	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0873	Room 224 Assistant Principal	2125	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0875	Room 309 Closet	3039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0876	Room 309 Closet	3039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0877	Room 300 Class Room	3058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0878	Girls Locker Room Closet	2080	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0879	Corridor Outside Boiler Room & Custodial Shop	1017	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0880	Women's Bathroom	1037	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0881	Women's Bathroom	1037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0882	Women's Bathroom	1037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0883	Women's Bathroom	1037	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0884	Women's Bathroom	1037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0885	Corridor Room 101 To 107	1058	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0886	Custodial Closet	1038	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0887	Men's Bathroom	1040	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0888	Men's Bathroom	1040	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0889	Men's Bathroom	1040	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0890	Men's Bathroom	1040	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0891	Men's Bathroom	1040	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0892	Men's Bathroom	1040	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0893	Men's Bathroom	1040	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0894	General/Automotive Room 105	1041	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0895	General/Automotive Room 105	1041	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
POB-0896	Industrial Room 103	1047	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0897	Industrial Room 103	1047	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0898	Faculty Room	1051	Kitchen Faucet (Cold)	Potable	6/19/2025	1.7			Result Below Action Level Continue O&M
POB-0899	Woodworking Room 101	1053	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0902	Building And Grounds	1052	Kitchen Faucet (Cold)	Potable	6/19/2025	2.4			Result Below Action Level Continue O&M
POB-0903	Building And Grounds	1052	Spray Nozzle	Potable	6/19/2025	1.4			Result Below Action Level Continue O&M
POB-0904	Central Technology Office/Electrical Room 107	1033	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-0907		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0908		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0909		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0910		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0911		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0912		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0913		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0914		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0915		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Plainview-Old Bethpage Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0916		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0917		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0918		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0919		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1829	Gym Corridor	2120	Bottle Fill Station	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1830	Corridor Storage Room S5 To Room 239	2044	Bottle Fill Station	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1831	Corridor Storage Room S5 To Room 239	2044	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2185	Room 302	3052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2186	Room 301	3053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2187	Room 301	3053	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-2188	Ladies Bathroom	2066	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2189	Ladies Bathroom	2066	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2190	Kitchen Serving Area	2052	Kitchen Faucet (Cold)	Potable	6/19/2025	24.7			Removed From Service, Pending Remediation
POB-2191	Kitchen Serving Area	2052	Kitchen Faucet (Cold)	Potable	6/19/2025	6.8			Removed From Service, Pending Remediation
POB-2192	Women's Faculty Bathroom	2075	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-2193	Custodial Lounge Bathroom	1019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2194	Custodial Lounge Bathroom	1019	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-2195	Woodworking Room 101	1053	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2196	Woodworking Room 101	1053	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0920	Storage Room	1004	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0921	Custodial Locker Room	1010	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0922	Custodial Locker Room	1010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0923	Corridor Adjacent Girls Locker Room	1029	Water Cooler	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0924	Corridor Adjacent Girls Locker Room	1029	Bottled Water Dispenser	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0925	Corridor Adjacent Girls Locker Room	1029	Water Cooler	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0926	Corridor Adjacent Girls Locker Room	1029	Bottled Water Dispenser	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0927	Custodial Closet Near D27	2002	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-0929	Womens Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0930	Womens Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0931	Womens Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0932	Womens Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0933	Womens Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0934	Womens Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0935	Womens Bathroom	2006	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0939	Corridor Room D 28 To D 33	2026	Water Fountain-No Chiller	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-0940	Mens Bathroom	2028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0941	Mens Bathroom	2028	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0942	Mens Bathroom	2028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0943	Mens Bathroom	2028	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0944	Mens Bathroom	2028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0945	Mens Bathroom	2028	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0946	Mens Bathroom	2028	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-0947	Corridor Room D 1 To D 3	1150	Bottle Fill Station	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-0949	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0950	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0951	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0952	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0953	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0954	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0955	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0956	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0957	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0958	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0959	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0960	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0961	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0965	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0966	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0967	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-0968	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0969	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0970	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0971	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0972	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0973	Room D 2 (previously separate rooms now merged)	1146A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0974	Room D 2 (previously separate rooms now merged)	1146A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0975	Room D 2 (previously separate rooms now merged)	1146A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0976	Room D 2 (previously separate rooms now merged)	1146A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0978	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0980	Room D 1	1143	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0984	Room D 1	1143	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0985	Room D 1	1143	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0986	Room D 1	1143	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0987	Room D 1	1143	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0988	Room D 1	1143	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0989	Room D 1	1143	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0997	Ladies Faculty Bathroom	1173	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-0998	Ladies Faculty Bathroom	1173	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-0999	Ladies Faculty Bathroom	1173	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1000	Ladies Faculty Bathroom	1173	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1001	Mens Faculty Bathroom	1174	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1002	Mens Faculty Bathroom	1174	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1003	Mens Faculty Bathroom	1174	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1006	Room D 5	1157	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1009	Room D 5	1157	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1010	Room D 5	1157	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1011	Room D 5	1157	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1012	Room D 5	1157	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1013	Room Across Room D 6 (Kitchenette)	1170	Kitchen Faucet (Cold)	Potable	6/27/2025	11.5			Removed From Service, Pending Remediation
POB-1015	Room D 6	1158	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1016	Room D 6	1158	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1017	Room D 6	1158	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1018	Room D 6	1158	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1019	Room D 6	1158	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1020	Room D 6	1158	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1021	Room D 6	1158	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1022	Room D 6	1158	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1023	Room D 6	1158	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1024	Room D 7 Rear Storage Room	1160	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1025	Custodial Room A 2	2194	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1026	Mens Bathroom	2062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1027	Mens Bathroom	2062	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1028	Mens Bathroom	2062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1029	Mens Bathroom	2062	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1030	Mens Bathroom	2062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1031	Mens Bathroom	2062	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1032	Mens Bathroom	2062	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1033	Atrium (Space Renovated)	2055	Water Fountain-No Chiller	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-1034	Slop Sink Closet	2041	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1035	Womens Bathroom	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1036	Womens Bathroom	2061	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1037	Womens Bathroom	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1038	Womens Bathroom	2061	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1039	Womens Bathroom	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1040	Womens Bathroom	2061	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1041	Womens Bathroom	2061	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1042	Room C 7	1091	Home Economics Faucet (Cold)	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1047	Room C5-C6 Rear Closet	1087	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1048	Gallery Storage	1077	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1049	Art Room C 5	1086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1050	Art Room C 5	1086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1051	Art Room C 5	1086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1052	Art Room C 4	1084	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1053	Art Room C 4	1084	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1063	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1064	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1065	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1066	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1067	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1068	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1069	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1070	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1071	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1072	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1073	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1074	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1076	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1077	Corridor From C 1 To C 3	1068	Bottled Water Dispenser	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1085	Science Room C 2/C 3 Front Prep Room	1065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1087	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1088	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1089	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1090	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1091	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1092	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1093	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1094	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1095	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1096	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1097	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1098	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1099	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1101	Science Room C 1/C 2 Rear Prep Room	1062	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1102	Science Prep	1075	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1105	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1106	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1107	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1108	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1109	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1110	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1111	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1112	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1113	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1114	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1115	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1116	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1117	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1126	Corridor Room B 1 To B 3	1114	Water Fountain-No Chiller	Potable	6/27/2025	5.6			Removed From Service, Pending Remediation
POB-1128	Custodial Closet	1128	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1136	Mens Faculty Bathroom	1126	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1137	Mens Faculty Bathroom	1126	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1138	Mens Faculty Bathroom	1126	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1139	Womens Faculty Bathroom	1125	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1140	Womens Faculty Bathroom	1125	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1141	Womens Faculty Bathroom	1125	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1142	Womens Faculty Bathroom	1125	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1145	Board Room Break Room	1122	Kitchen Faucet (Cold)	Potable	6/27/2025	1.1			Result Below Action Level Continue O&M
POB-1147	Corridor From Room B 28 To B 33	2080	Water Fountain-No Chiller	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1156	Custodial Closet By Room B 26	2087	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1170	Corridor Main Office To Nurses Office (Includes 2169	2189	Water Fountain-No Chiller	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-1172	Principals Office Bathroom	2163	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1173	Music Wing Corridor	2151	Water Fountain-No Chiller	Potable	6/27/2025	6.6			Removed From Service, Pending Remediation
POB-1175	Womens Faculty Bathroom	2154	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1176	Womens Faculty Bathroom	2154	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1177	Womens Faculty Bathroom	2154	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1178	Womens Faculty Bathroom	2154	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1179	Mens Faculty Bathroom	2150	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1180	Mens Faculty Bathroom	2150	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1181	Mens Faculty Bathroom	2150	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1182	Band Room Uniform Storage	2141	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1183	Custodial Closet A3	2157	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1184	Girls Bathroom	2158	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1185	Girls Bathroom	2158	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1186	Girls Bathroom	2158	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1187	Girls Bathroom	2158	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1188	Girls Bathroom	2158	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1189	Girls Bathroom	2158	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1190	Girls Bathroom	2158	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1192	Kitchen Room A1/A2	2120	Kitchen Faucet (Cold)	Potable	6/27/2025	2.1			Result Below Action Level Continue O&M

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1193	Kitchen Room A1/A2	2120	Kitchen Faucet (Cold)	Potable	6/27/2025	1.1			Result Below Action Level Continue O&M
POB-1194	Kitchen Room A1/A2	2120	Kitchen Faucet (Cold)	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1196	Kitchen Room A1/A2	2120	Kitchen Faucet (Cold)	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1197	Kitchen Room A1/A2	2120	Kitchen Faucet (Cold)	Potable	6/27/2025	22.7			Removed From Service, Pending Remediation
POB-1200	Cafeteria	2135	Water Cooler	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1201	Cafeteria	2135	Water Cooler	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-1202	Library Storage Area Kitchen	2175	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1203	Library Handicap Mens Bathroom	2179	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1204	Library Handicap Mens Bathroom	2179	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1205	Library Handicap Mens Bathroom	2179	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1206	Library Handicap Mens Bathroom	2179	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1207	Library Handicap Mens Bathroom	2179	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1208	Library Handicap Mens Bathroom	2179	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1209	Corridor From Stairwell To Band Room	2119	Water Fountain-No Chiller	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-1210	Handicap Womens Bathroom	2200	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1211	Handicap Womens Bathroom	2200	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1212	Handicap Womens Bathroom	2200	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1213	Handicap Womens Bathroom	2200	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1214	Handicap Womens Bathroom	2200	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1215	Handicap Womens Bathroom	2200	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1216	Music Room B Storage	2199	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1217	Corridor From Stairwell To Band Room	2115	Water Fountain-No Chiller	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-1219	Tech C Room	2108	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1220	Music Room (Former Tech B)	2103	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1223	Custodial Closet A1	2118	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1224	Boys Bathroom	2117	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1225	Boys Bathroom	2117	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1226	Boys Bathroom	2117	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1227	Boys Bathroom	2117	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1228	Boys Bathroom	2117	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1229	Boys Bathroom	2117	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1230	Boys Bathroom	2117	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1231	Tech A Room	2100	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1232	Behind Garage Door	1025	Ice Machine	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-1233	Corridor Adjacent Boys Locker Room	1025	Water Cooler	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1234	Corridor Adjacent Boys Locker Room	1025	Bottled Water Dispenser	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1235	Corridor Adjacent Boys Locker Room	1025	Water Cooler	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1236	Corridor Adjacent Boys Locker Room	1025	Bottled Water Dispenser	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1237	Boys Locker Room Bathroom	1019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1238	Boys Locker Room Bathroom	1019	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1239	Boys Locker Room Bathroom	1019	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1241	Boys Locker Room Bathroom	1017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1242	Boys Locker Room Bathroom	1017	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1243	Boys Locker Room Bathroom	1017	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1244	Girls Coach Office Bathroom	1037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1245	Girls Locker Room Bathroom 2	1044	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1246	Girls Locker Room Bathroom 2	1044	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1247	Girls Locker Room	1038	Water Fountain-No Chiller	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-1248	Girls Locker Room Bathroom	1042	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1250	Pal Room (Former Nurses Office)	1046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1251	Pal Room (Former Nurses Office)	1046	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1252	Boys Locker Room Custodial Closet	1018	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1253	Boys Locker Room Office Bathroom	1024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1254	Girls Locker Room Custodial Closet	1043	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1255	Electrical Room	1052	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1256	Health Suite Vestibule (Space Reconstructed)	2191	Nurse's Office Sink	Potable	6/27/2025	1.4			Result Below Action Level Continue O&M
POB-1257	Nurses Office Bathroom	2191C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1263	PTA Storage A3	2131	Kitchen Faucet (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-1264	Storage A5	2128	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1265	Kitchen Room A1/A2	2120	Pasta Pot/Steam Kettle	Potable	6/27/2025	OOS			Testing Required Before Return to Service

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1266	Kitcehn Locker Room Bathroom	2122	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1267	Room D 1/D 2 Rear Storage Room	1144	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1268		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1269		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1270		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1271		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1272		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1273		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1274		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1275		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1276		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1277		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1278		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1298	Ladies Faculty Bathroom	1069	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1299	Ladies Faculty Bathroom	1069	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1300	Ladies Faculty Bathroom	1069	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1301	Ladies Faculty Bathroom	1069	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1302	Mens Faculty Bathroom	1080	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1774	Pal Room (Former Nurses Office)	1046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1775	Ladies Faculty Bathroom	1069	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1776	Mens Bathroom	1074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1777	Mens Bathroom	1074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1778	Mens Faculty Bathroom	1178	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1779	Mens Faculty Bathroom	1178	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1780	Womens Faculty Bathroom	1179	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1781	Boys Bathroom	2081	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1782	Boys Bathroom	2081	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1783	Girls Bathroom	2085	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1784	Ladies Bathroom	1130	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1785	Mens Bathroom	1129	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1786	Mens Bathroom	1129	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1802	Corridor Room B 4 To B 7	1106	Water Fountain-No Chiller	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-1948	Boys Locker Room	1013	Water Fountain-No Chiller	Potable	6/27/2025	2.6			Result Below Action Level Continue O&M
POB-1949	Girls Locker Room Bathroom	1042	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1950	Corridor Room D 1 To D 3	1150	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-1951	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1952	Room D 3	1149	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1953	Room D 2/D 3 Storage Room	1148	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1954	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1955	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1956	Room D 2	1146	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1998	Custodial Closet (Across From D4 & D5)	1177	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1999		1058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2000	Room D 21	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2001	Room D 31	2022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2002	Room D 28	2025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2003	Room C 7	1091	Home Economics Faucet (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-2004	Room C 6	1088	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2005	Room C 6	1088	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2006	Room C 6	1088	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2007	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2008	Room C 3	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2009	Room C 3	1067	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-2010	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2011	Science Room C 2	1064	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2012	Science Room C 2	1064	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-2013	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2014	Science Room C 1	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2015	Room B 3/Superintendent Reception	1107	Bottled Water Dispenser (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-2016	Room B 3/Superintendent Reception	1107	Bottled Water Dispenser (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-2017	Superintendent Office Bathroom	1110	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2018	Room B 2 Office Kitchen	1108	Kitchen Faucet (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-2019	Room B 27	2086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2020	Corridor From Room B 21 To B 26	2096	Bottled Water Dispenser	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2021	Family & Consumer Sciences Room A1	2180	Home Economics Faucet (Cold)	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2022	Family & Consumer Sciences Room A1	2180	Home Economics Faucet (Cold)	Potable	6/27/2025	1.4			Result Below Action Level Continue O&M
POB-2023	Family & Consumer Sciences Room A1	2180	Home Economics Faucet (Cold)	Potable	6/27/2025	7.0			Removed From Service, Pending Remediation
POB-2024	Family & Consumer Sciences Room A1	2180	Spray Nozzle	Non-Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-2025	Family & Consumer Sciences Room A1	2180	Home Economics Faucet (Cold)	Potable	6/27/2025	10.6			Removed From Service, Pending Remediation
POB-2026	Family & Consumer Sciences Room A1	2180	Home Economics Faucet (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-2027	Family & Consumer Sciences Room A1	2180	Home Economics Faucet (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-2028	Family & Consumer Sciences Room A2	2186	Home Economics Faucet (Cold)	Potable	6/27/2025	1.1			Result Below Action Level Continue O&M
POB-2029	Family & Consumer Sciences Room A2	2186	Home Economics Faucet (Cold)	Potable	6/27/2025	1.8			Result Below Action Level Continue O&M
POB-2030	Family & Consumer Sciences Room A2	2186	Home Economics Faucet (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-2031	Family & Consumer Sciences Room A2	2186	Home Economics Faucet (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-2032	Family & Consumer Sciences Room A2	2186	Home Economics Faucet (Cold)	Potable	6/27/2025	OOS			Testing Required Before Return to Service
POB-2033	Main Office Lunch Room	2160	Kitchen Faucet (Cold)	Non-Potable	6/27/2025	3.7			Result Below Action Level Continue O&M
POB-2034	Faculty Dining Room	2155	Kitchen Faucet (Cold)	Non-Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2035	Kitchen Room A1/A2	2120	Hand Wash Only	Non-Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2036	Kitchen Room A1/A2	2120	Kitchen Faucet (Cold)	Non-Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M

Howard B. Mattlin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-2037	Cafeteria	2135	Water Cooler	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2038	Cafeteria	2135	Bottled Water Dispenser	Potable	6/27/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2039	Tech C Room	2108	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2040	Music Room (Former Tech B)	2103	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2041	Music Room (Former Tech B)	2103	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2042		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-2043		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-2044		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-2045		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-2046		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-2048		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Old Bethpage Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1279	ROOM 107	New Construct	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1280	ROOM 107	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1281	ROOM 106	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1282	ROOM 106	New Construct	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1283	NURSE OFFICE	New Construct	Nurse's Office Sink	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1284	NURSE OFFICE Bathroom	New Construct	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1285	Room 1	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1286	Room 1	2001	Water Fountain-No Chiller	Potable	6/19/2025	9.0			Removed From Service, Pending Remediation
POB-1287	Room 1 Bathroom	2002	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1288	Room 1 Bathroom	2002	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1289	Room 2 Music Room	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1290	Room 2 Music Room	2005	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1291	Room 2 Music Room Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1292	Room 2 Music Room Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1293	Conference Room Bathroom	2011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1294	Conference Room Bathroom	2011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1295	Conference Room Bathroom	2011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1296	Room 25 Bathroom	2096	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1297	Room 23	2089	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1303	Room 21	2088	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Old Bethpage Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1304	Corridor Exit Vestibule To Room 23	2091	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1305	Room 19	2086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1306	Room 17	2084	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1307	Room 18	2083	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1308	Corridor Exit Vestibule To Room 23	2091	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1309	Room 15	2082	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1310	Room 16	2081	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1311	Room 13	2078	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1312	Room 14	2077	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1314	Room 12	2075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1315	Room 10	2072	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1316	Boys Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1317	Boys Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1318	Boys Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1319	Boys Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1320	Boys Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1321	Boys Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1322	Boys Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1324	Orchestra Room Bathroom	2059	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1325	Orchestra Room Bathroom	2059	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Old Bethpage Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1328	Girls Coach Office Bathroom	2056	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1329	Art Room/Room 9	2047	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1330	Art Room/Room 9	2047	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1331	Art Room Bathroom	2050	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1332	Room 7	2044	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1333	Room 7	2044	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1334	Room 8	2043	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1335	Room 8	2043	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1338	Corridor Music Room To Room 7	2046	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1339	Corridor Music Room To Room 7	2046	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1340	Room 6	2040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1341	Room 6	2040	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1342	Room 3	2038	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1343	Room 3	2038	Water Fountain-No Chiller	Potable	6/19/2025	2.4			Result Below Action Level Continue O&M
POB-1344	Room 4	2037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1345	Room 4	2037	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1346	Head Custodian Office Bathroom	2034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1350	Cafeteria/Multi Purpose Room	2026	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1351	Cafeteria/Multi Purpose Room	2026	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1352	Faculty Room	2029	Kitchen Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M

Old Bethpage Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1353	Corridor Music Room To Room 7	2046	Water Fountain-No Chiller	Potable	6/19/2025	61.6			Removed From Service, Pending Remediation
POB-1354	Faculty Room Bathroom	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1355	Girls Bathroom	2023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1356	Girls Bathroom	2023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1360	Custodial Closet	2022	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1361	Boys Bathroom	2021	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1362	Boys Bathroom	2021	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1363	Boys Bathroom	2021	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1364	Boys Bathroom	2021	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1365	Boys Bathroom	2021	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1366	Custodial Closet	2069	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1367	Room 12S Bathroom	2074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1368	Room 12S Bathroom	2074	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1369	Classroom 20B	2085A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1501	Girls Bathroom	2070	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1502	Girls Bathroom	2070	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1503	Girls Bathroom	2070	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1504	Girls Bathroom	2070	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1505	Girls Bathroom	2070	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1506	Girls Bathroom	2070	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Old Bethpage Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1507	Corridor Exit Vestibule To Room 23	2091	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1508	Corridor Exit Vestibule To Room 23	2091	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1509	Room 16	2081	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1726		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1727		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1732		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1737		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1739		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1741		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1742		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1743		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1792	Library Office	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1957	Corridor Exit Vestibule To Room 23	2091	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1958	Boys Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1959	Faculty Bathroom Vestibule	2064	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1960	Room 5	2041	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1961	Room 5	2041	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1962	Kitchen	2030	Kitchen Faucet (Cold)	Potable	6/19/2025	3.3			Result Below Action Level Continue O&M
POB-1963	Kitchen	2030	Kitchen Faucet (Cold)	Potable	6/19/2025	7.7			Removed From Service, Pending Remediation
POB-1964	Kitchen	2030	Hand Wash Only	Non-Potable	6/19/2025	11.8			Placarded for Non-Drinking Use Until Remediated

Old Bethpage Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1965	Girls Bathroom	2023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1966	Girls Bathroom	2023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1967	Girls Bathroom	2023	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1968		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1969		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1970		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1971		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1972		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1973		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1974		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1975		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1976		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1977		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1978		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Pasadena Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1370	Room 2	2042	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1371	Room 1	2026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1372	Room 3	2028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1373	Room 3 Bathroom	2029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1374	Room 3 Bathroom	2029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1375	Room 4	2040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1376	Room 4 Bathroom	2039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1377	Room 4 Bathroom	2039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1378	Girls Bathroom	2031	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1379	Girls Bathroom	2031	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1380	Girls Bathroom	2031	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1381	Girls Bathroom	2031	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1382	Boys Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1383	Boys Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1384	Boys Bathroom	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1385	Room 6	2036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1386	Room 5	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1387	Room 7A (Interior Wall Removed)	2033	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1388	Music Room Bathroom	2127	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1389	Music Room Bathroom	2127	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Pasadena Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1394	Art Room Bathroom	2130	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1395	Art Room Bathroom	2130	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1398	Nurses Office	2008	Nurse's Office Sink	Potable	6/19/2025	1.9			Result Below Action Level Continue O&M
POB-1399	Nurses Office Bathroom	2009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1400	Custodial Closet	2006	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1401	Instrumental Music Room	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1402	Principals Office Bathroom	2013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1403	Main Office Kitchen	2016	Kitchen Faucet (Cold)	Potable	6/19/2025	1.6			Result Below Action Level Continue O&M
POB-1404	Men's Faculty Bathroom	2023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1405	Men's Bathroom	2023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1406	Men's Faculty Bathroom	2023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1407	Men's Bathroom	2023	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1408	Men's Bathroom	2023	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1409	Women's Bathroom	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1410	Women's Faculty Bathroom	2043	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1411	Women's Faculty Bathroom	2043	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1412	Women's Faculty Bathroom	2043	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1413	Boiler Room Hallway	2001	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1414	Kitchen	2044	Hand Wash Only	Non-Potable	6/19/2025	4.9			Result Below Action Level Continue O&M
POB-1415	Kitchen	2044	Hand Wash Only	Non-Potable	6/19/2025	2.8			Result Below Action Level Continue O&M

Pasadena Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1419	Kitchen Locker Room	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1420	Corridor Outside Kitchen	2049	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1421	Corridor Outside Kitchen	2049	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1423	All Purpose Room/Cafeteria	2052	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1424	All Purpose Room/Cafeteria	2052	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1425	Room 10	2117	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1426	Room 9	2100	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1427	Room 12	2112	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1428	Room 11	2101	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1429	Girls Bathroom	2102	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1430	Girls Bathroom	2102	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1431	Girls Bathroom	2102	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1432	Girls Bathroom	2102	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1433	Girls Bathroom	2102	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1434	Girls Bathroom	2102	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1435	Boys Bathroom	2107	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1436	Boys Bathroom	2107	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1437	Boys Bathroom	2107	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1438	Boys Bathroom	2107	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1440	Boys Bathroom	2107	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Pasadena Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1441	Corridor Room 9 To 16	2120	Water Fountain-No Chiller	Potable	6/19/2025	3.1			Result Below Action Level Continue O&M
POB-1442	Room 14	2106	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1443	Room 13	2103	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1444	Room 15	2104	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1445	Room 16	2105	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1446	Main Corridor	2081	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1447	Custodial Closet 2	2083	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1448	Room 18	2087	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1449	Room 17	2096	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1450	Room 20	2088	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1451	Room 19	2095	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1452	Girls Bathroom	2094	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1453	Girls Bathroom	2094	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1454	Girls Bathroom	2094	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1455	Girls Bathroom	2094	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1456	Girls Bathroom	2094	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1457	Girls Bathroom	2094	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1458	Girls Bathroom	2094	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1459	Boys Bathroom	2089	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1460	Boys Bathroom	2089	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Pasadena Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1462	Boys Bathroom	2089	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1463	Boys Bathroom	2089	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1464	Boys Bathroom	2089	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1465	Boys Bathroom	2089	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1466	Corridor Room 18 To 24	2084	Bottled Water Dispenser	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1467	Room 22 A	2090	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1468	Room 21	2093	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1469	Room 23B	2092	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1470	Library Storage	New Construct	Classroom Faucet	Non-Potable	6/19/2025	13.1			Placarded for Non-Drinking Use Until Remediated
POB-1471	Corridor Outside Gym & Faculty Lounge	2075	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1472	Faculty Lounge	2074	Kitchen Faucet (Cold)	Potable	6/19/2025	4.2			Result Below Action Level Continue O&M
POB-1474	Staff Bathroom	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1477	Room 8	2035	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1761		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1832	Art Room	New Construct	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1833	Art Room	New Construct	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1834	Art Room	New Construct	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1835	All Gender Restroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1836	New Construction Corridor	New Construct	Bottle Fill Station	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1838	Music Inst. Room	New Construct	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Pasadena Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1839	All Gender Restroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1840	Exterior	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1841	Exterior Bathroom	New Construct	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1842	Exterior Bathroom	New Construct	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1851	Corridor Main Office To Art Vestibule	2022	Bottle Fill Station	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1852	Art Room	2128	Bottle Fill Station	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1853	Art Room	2128	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1854	Music Room	2125	Bottle Fill Station	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1980	Kitchen	2044	Kitchen Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1981	Kitchen	2044	Kitchen Faucet (Cold)	Potable	6/19/2025	1.1			Result Below Action Level Continue O&M
POB-1982	Kitchen	2044	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1983	All Purpose Room/Cafeteria	2052	Water Cooler	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1984	Boys Bathroom	2107	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1986	Girls Bathroom	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1987	Boys Bathroom	2068	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1988	PE Office/Storage	2067	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1989		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1990		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1991		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1992		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Pasadena Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1993		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1994		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1995		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1996		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1997		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1479	Playroom 1	2128	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1480	Playroom 2	2123	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1482	Playroom Corridor	2130	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1483	Playroom 2 Bathroom	2124	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1484	Playroom 3	2119	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1486	Custodial Office Bathroom	2116	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1490	Old Main Office Safe	2108	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1491	Kitchen	2089	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
POB-1492	Kitchen	2089	Kitchen Faucet (Cold)	Potable	6/19/2025	8.9			Removed From Service, Pending Remediation
POB-1493	Kitchen	2089	Kitchen Faucet (Cold)	Potable	6/19/2025	6.9			Removed From Service, Pending Remediation
POB-1494	Kitchen	2089	Kitchen Faucet (Cold)	Potable	6/19/2025	1.9			Result Below Action Level Continue O&M
POB-1495	Kitchen	2089	Kitchen Faucet (Cold)	Potable	6/19/2025	5.0			Result Below Action Level Continue O&M
POB-1498	Mens/Womens Bathroom	2086A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1499	Mens Bathroom	2080	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1500	Gym Corridor	2114	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1511	Nursery/Day Care Bathroom/Storage	2083	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1512	Nursery/Day Care Bathroom/Storage	2083	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1514	Bathroom/Storage	2078	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1515	Bathroom/Storage	2078	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1516	Bathroom/Storage	2078	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1520	Blue Room 104 Bathroom	2074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1525	Green Bathroom	2072	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1526	Green Bathroom	2072	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1530	Red Room 105	2063	Water Fountain-No Chiller	Potable	6/19/2025	1.4			Result Below Action Level Continue O&M
POB-1531	Red Room 105 Bathroom	2062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1532	Red Room 105 Bathroom	2062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1539	Kitchen	2061	Hand Wash Only	Non-Potable	6/19/2025	38.8			Placarded for Non-Drinking Use Until Remediated
POB-1540	Bathroom Between Teal & Orange Rooms	2056	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1541	Corridor Outside Red Room 105	2069	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1544	Teal Room	2058B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1545	Grey Room Closet	2050	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1552	Brown Room Bathroom	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1553	Brown Room Bathroom	2048	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1555	Faculty Room Bathroom	2044	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1556	Faculty Room Bathroom	2044	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1558	Purple Room Bathroom	2039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1559	Purple Room Bathroom	2039	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1564	Boys Bathroom	2015	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1565	Boys Bathroom	2015	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1566	Boys Bathroom	2015	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1567	Slop Sink Closet	2016	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1568	Room 115	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1569	Girls Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1570	Girls Bathroom	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1571	Girls Bathroom	2017	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1573	Corridor Room 2 To Boys Bathroom	2029	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1574	Room 113	2012	Kitchen Faucet (Cold)	Potable	6/19/2025	3.9			Result Below Action Level Continue O&M
POB-1575	Room 113	2012	Kitchen Faucet (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-1586	Corridor Room 2 To Boys Bathroom	2029	Water Cooler	Non-Applicable					Placarded for Non-Drinking Use
POB-1587	Multi Purpose Room	2001A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1588	Hallway Between Director Office & Room 1	2028	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1598	Corridor Room 215 To 220	3014/3034	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1600	Boys Bathroom	3027	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1601	Boys Bathroom	3027	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1602	Boys Bathroom	3027	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1603	Boys Bathroom	3027	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1604	Custodial Closet 5	3028	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1605	Girls Bathroom	3029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1606	Girls Bathroom	3029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1607	Girls Bathroom	3029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1608	Girls Bathroom	3029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1625	Corridor Room 200 To 203	3068	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-1626	Custodial Closet 4	3061	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
POB-1627	Room 204	3055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1628	Room 204	3055	Water Fountain-No Chiller	Potable	6/19/2025	43.7			Removed From Service, Pending Remediation
POB-1629	Room 204	3055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1630	Mens Bathroom	3062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1631	Reading Room	3062	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1632	Mens Bathroom	3062	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1633	Reading Room	3062	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1634	Womens Bathroom	3064	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1635	Womens Bathroom	3064	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1636	Womens Bathroom	3064	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1637	Womens Bathroom	3064	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1638	Womens Bathroom	3064	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1639	Womens Bathroom	3064	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1640	Womens Bathroom	3064	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1641	Room 201	3065	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1642	Room 201	3065	Water Fountain-No Chiller	Potable	6/19/2025	33.9			Removed From Service, Pending Remediation
POB-1643	Room 202	3059	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-1644	Room 202	3059	Water Fountain-No Chiller	Potable	6/19/2025	14.4			Removed From Service, Pending Remediation
POB-1645	Art Room	2103	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
POB-1646	Boys Gym Office Bathroom	2096	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1647	Boys Gym Office Bathroom	2096	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
POB-1744		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1745		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1746		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1747		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1748		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1749		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1750		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1751		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1752		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1753		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-1797	Nursery/Day Care	2082	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1798	Green Room 103	2075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1799	White Room	2051	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1800	Room 205	3052	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-1801	Room 205	3052	Water Fountain-No Chiller	Potable	6/19/2025	167			Removed From Service, Pending Remediation
POB-2097	Playroom 1	2127	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-2098	Playroom 2 Bathroom	2124	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2099	Playroom 2	2123	Bottled Water Dispenser (Cold)	Non-Applicable					Placarded for Non-Drinking Use
POB-2100	Playroom 2	2123	Bottled Water Dispenser (Hot)	Non-Applicable					Placarded for Non-Drinking Use
POB-2101	Playroom 3 Bathroom	2120	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2102	Boiler Room	1023	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
POB-2103	Boiler Room	1023	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
POB-2104	Conference Room (Former Principal Office)	2110	Bottled Water Dispenser (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2105	Conference Room (Former Principal Office)	2110	Bottled Water Dispenser (Hot)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2106	Conference Room Closet	2111	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2107	Old Main Office	2107	Water Fountain-No Chiller	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2108	Kitchen	2089	Ice Machine	Potable	6/19/2025	1.2			Result Below Action Level Continue O&M
POB-2109	Kitchen Elevator Room Bathroom	2091	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2110	Day Care Main Office	2079	Bottled Water Dispenser (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2111	Day Care Main Office	2079	Bottled Water Dispenser (Hot)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2112	Nursery/Day Care	2082	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2113	Green Room 103	2075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2114	Green Room 103	2075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2115	Blue Room 104	2073	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2116	Blue Room Kitchen	2073A	Kitchen Faucet (Cold)	Potable	6/19/2025	3.9			Result Below Action Level Continue O&M
POB-2117	Blue Room Kitchen	2073A	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-2118	Blue Room Kitchen	2073A	Kitchen Faucet (Cold)	Potable	6/19/2025	241			Removed From Service, Pending Remediation
POB-2119	Blue Room Kitchen	2073A	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
POB-2120	Red Room 105	2063	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2121	Red Room 105	2063	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-2122	Pink Room	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2123	Yellow Room	2058A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2124	Yellow Room	2058A	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
POB-2125	Yellow Room	2058A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2126	Kitchen	2061	Kitchen Faucet (Cold)	Potable	6/19/2025	3.3			Result Below Action Level Continue O&M
POB-2127	Kitchen	2061	Kitchen Faucet (Cold)	Potable	6/19/2025	2.9			Result Below Action Level Continue O&M
POB-2128	Teal Room	2058B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2129	Teal Room	2058B	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
POB-2130	Orange Room	2055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2131	White Room	2051	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2132	White Room	2051	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2133	Grey Room	2049	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2134	Grey Room	2049	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2135	Brown Room	2046	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2136	Faculty Room (Former Health Office)	2040	Kitchen Faucet (Cold)	Potable	6/19/2025	1.6			Result Below Action Level Continue O&M
POB-2137	Purple Room	2037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-2138	Pink Room	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2139	Teal Room	2058B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2140	Infant B Room	2031	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2141	Faculty Bathroom	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2142	Room 112	2021	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2143	Room 112	2021	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2144	Room 105	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2145	Small Nursery/Inside Room 109(Interior Wall Removed,	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2146	Room 110	2022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2147	Room 110 Inner Room	2019	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2148	Room 106	2023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2149	Room 103C	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2150	Room 103C	2002	Bottled Water Dispenser (Cold)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2151	Room 103C	2002	Bottled Water Dispenser (Hot)	Potable	6/19/2025	<1.00 ND			Result Below Action Level Continue O&M
POB-2152	Room 103	2001	Classroom Faucet	Non-Potable	6/19/2025	1.0			Result Below Action Level Continue O&M
POB-2153	Director Office Inner Room	2025	Classroom Faucet	Non-Potable	6/19/2025	1.0			Result Below Action Level Continue O&M
POB-2154	Room 220/215	3004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2155	Room 220/215	3004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2156	Room 219	3007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2157	Room 219	3007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-2158	Room 221	3010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2159	Room 218	3015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2160	Room 218	3015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2161	Room 214	3017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2162	Room 217	3018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2163	Room 217	3018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2164	Room 216	3022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2165	Room 216	3030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2166	Room 216	3030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2167	Room 213	3036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2168	Room 211	3037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2169	Room 209	3040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2170	Room 210	3042	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2171	Room 210	3042	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-2172	Room 207	3045	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2173	Room 207	3045	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-2174	Room 208	3047	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2175	Room 208	3047	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-2176	Room 205	3052	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2177	Room 205	3052	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use

Jamaica Avenue School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
POB-2178	Room 206	3050	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2179	Room 206	3050	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
POB-2180	Room 203	3057	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
POB-2181	Room 203	3057	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use

Attachment 3:

Laboratory Analytical Reports

J.C. Broderick & Associates, Inc.


Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: John F. Kennedy High School

JFK

ED54281

Client:

Plainview-Old Bethpage Central School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-0010	ST	2093	Main Office Copy Room (Duplicating Room)	WC	6/25/2025	6:04:00 AM
POB-0014	NO	2101	Nurses Office	NS	6/25/2025	6:05:00 AM
POB-0016	HA	2064	Guidance/Main Office Corridor	WC	6/25/2025	6:10:00 AM
POB-0017	HA	2064	Guidance/Main Office Corridor	BW	6/25/2025	6:10:00 AM
POB-0019	HA	2064	Guidance/Main Office Corridor	WC	6/25/2025	6:11:00 AM
POB-0021	HA	2136	Corridor Outside School Store	DW	6/25/2025	6:14:00 AM
POB-0022	CA	2199	Cafeteria	WC	6/25/2025	7:21:00 AM
POB-0023	CA	2199	Cafeteria	WC	6/25/2025	7:20:00 AM
POB-0024	CA	2199	Cafeteria	BW	6/25/2025	7:20:00 AM
POB-0025	KI	2204	Kitchen Serving Area	KC	6/25/2025	6:28:00 AM
POB-0026	KI	2203	Kitchen	IM	6/25/2025	6:25:00 AM
POB-0027	KI	2203	Kitchen	KC	6/25/2025	6:26:00 AM
POB-0031	KI	2203	Kitchen	KC	6/25/2025	6:25:00 AM
POB-0033	KI	2203	Kitchen	KC	6/25/2025	6:33:00 AM
POB-0042	HE	2211	Room 108	EC	6/25/2025	6:15:00 AM
POB-0043	HE	2211	Room 108	EC	6/25/2025	6:16:00 AM
POB-0044	HE	2211	Room 108	EC	6/25/2025	6:17:00 AM
POB-0045	HE	2211	Room 108	EC	6/25/2025	6:18:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM 4:01

Building Address

50 Kennedy Drive
Plainview, NY 11803



Analysis Type: ELAP 200.5


Lab Received: DAVID WHARTON 7/16/25 4:01 PM

Signature: David Wharton

Samplers Name: Andrew Schreck

Samplers Signature: Andrew Schreck

JCB Project Manager: George Gieve



Lead in Water: Chain of Custody for

ED54281

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-57432
Building: John F. Kennedy High School
JFK

Client: Plainview-Old Bethpage Central School District
Retest/New Install[]
Turn Around: Normal 1-wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-0055	HA	2026	Band Room Corridor	DW	6/25/2025	7:06:00 AM
POB-0072	LI	2144	Library Office	HW	6/25/2025	6:48:00 AM
POB-0082	HA	2230	Corridor From Room 142 To 159	DW	6/25/2025	6:46:00 AM
POB-0084	HA	New	New Wing Corridor Rooms 195-198	WC	6/25/2025	6:41:00 AM
POB-0085	HA	New	New Wing Corridor Rooms 195-198	BW	6/25/2025	6:41:00 AM
POB-0094	HA	2026	Band Room Corridor	WC	6/25/2025	7:08:00 AM
POB-0095	HA	2026	Band Room Corridor	BW	6/25/2025	7:08:00 AM
POB-0099	LR	2055	Girls Locker Room (Space Renovated)	WC	6/25/2025	7:17:00 AM
POB-0117	HA	2105	Guidance Office/Main Office Inner Connecting Hallway	DW	6/25/2025	6:37:00 AM
POB-0118	CR	2140	Social Studies Dept. Room 113	CF	6/25/2025	6:54:00 AM
POB-0127	OF	3003	Math Dept. Room 207	KC	6/25/2025	6:54:00 AM
POB-0130	HA	3076	Corridor Room 200-238	DW	6/25/2025	6:53:00 AM
POB-0157	OF	3052	Science Dept. Room 226	KC	6/25/2025	6:51:00 AM
POB-0342	HA		CORRIDOR OUTSIDE 295	DW	6/25/2025	6:58:00 AM
POB-0343	HA		CORRIDOR OUTSIDE 296	DW	6/25/2025	6:58:00 AM
POB-0359	FL	3034	Room 221	HW	6/25/2025	7:00:00 AM
POB-1848	CS	Comfort Station	Kitchen	KC	6/25/2025	7:48:00 AM
POB-1856	SP	1000	Weight Room (Space Renovated)	WF	6/25/2025	7:13:00 AM

Building Address
50 Kennedy Drive
Plainview, NY 11803

Analysis Type: ELAP 200.5

Lab Received: DAVID WHARTON 7/16/25 4:01 PM


Signature: David Wharton

Samplers Name: Andrew Schreck

Samplers Signature: Andrew Schreck

JCB Project Manager: George Greve

RECEIVED
ENGL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM 4:01



Lead in Water: Chain of Custody for

ED54281

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: John F. Kennedy High School

JFK

Client:

Plainview-Old Bethpage Central School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-1857	SP	1000	Weight Room (Space Renovated)	WC	6/25/2025	7:13:00 AM
POB-1860	KI	2203	Kitchen	KC	6/25/2025	6:24:00 AM
POB-1861	KI	2203	Kitchen	KC	6/25/2025	6:31:00 AM
POB-1862	KI	2203	Kitchen	KC	6/25/2025	6:31:00 AM
POB-1863	KI	2203	Kitchen	KC	6/25/2025	6:32:00 AM
POB-1867	HE	2209A	Room 109C Room 109C	EC	6/25/2025	6:22:00 AM
POB-1873	OF	2149	English Office	HW	6/25/2025	6:44:00 AM
POB-1878	HA	2064	B Wing Locker Area	WF	6/25/2025	6:11:00 AM
POB-1879	NO	2097	Trainers Room/Nurse Room 103	IM	6/25/2025	6:06:00 AM
POB-1880	GY	2045	Pool Room 105	DW	6/25/2025	7:10:00 AM

Samples Submitted 46

RECEIVED

EMSL ANALYTICAL, INC.

Carle Place, NY

JUL 16 25, PM 04:02

Building Address

50 Kennedy Drive

Plainview, NY 11803

Analysis Type: ELAP 200.5

Lab Received: DAVID WHARTON 7/16/25 4:00 PM

Signature: David Wharton

Samplers Name: Andrew Schreck

Samplers Signature: Andrew Schreck

JCB Project Manager: George Glave

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554281

LIMS Reference ID: ED54281

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 24-57432, Plainview-Old Bethpage Central School District, John F. Kennedy High School JFK, 50 Kennedy Drive, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 07/16/2025 16:01

Reported: 08/12/2025 09:07

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0010 Lims Reference ID: ED54281-01 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 11:22	07/22/25 11:22	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0014 Lims Reference ID: ED54281-02 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	3.3		1	1.0	µg/L	07/22/25 11:26	07/22/25 11:26	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0016 Lims Reference ID: ED54281-03 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/25/25 14:10	07/25/25 14:10	SEH	EPA 200.8 (Dig)/EPA 200.8
Sample: POB-0017 Lims Reference ID: ED54281-04 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 11:27	07/22/25 11:27	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0019 Lims Reference ID: ED54281-05 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 11:29	07/22/25 11:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0021 Lims Reference ID: ED54281-06 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	3.5		1	1.0	µg/L	07/22/25 11:33	07/22/25 11:33	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0022 Lims Reference ID: ED54281-07 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 11:34	07/22/25 11:34	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0023 Lims Reference ID: ED54281-08 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 11:35	07/22/25 11:35	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0024 Lims Reference ID: ED54281-09 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554281

LIMS Reference ID: ED54281

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, John F. Kennedy High School JFK, 50
Kennedy Drive, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:07

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: POB-0024 (Continued)

Lims Reference ID: ED54281-09 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals (Continued)

Lead	1.6		1	1.0	µg/L	07/22/25 11:37	07/22/25 11:37	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0025

Lims Reference ID: ED54281-10 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	2.7		1	1.0	µg/L	07/22/25 11:38	07/22/25 11:38	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0026

Lims Reference ID: ED54281-11 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 11:39	07/22/25 11:39	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0027

Lims Reference ID: ED54281-12 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	27.8		1	1.0	µg/L	07/22/25 11:41	07/22/25 11:41	SEH	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0031

Lims Reference ID: ED54281-13 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	24.2		1	1.0	µg/L	07/22/25 11:45	07/22/25 11:45	SEH	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0033

Lims Reference ID: ED54281-14 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	2.6		1	1.0	µg/L	07/22/25 11:49	07/22/25 11:49	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0042

Lims Reference ID: ED54281-15 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 11:50	07/22/25 11:50	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0043

Lims Reference ID: ED54281-16 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	2.8		1	1.0	µg/L	07/22/25 11:51	07/22/25 11:51	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0044

Lims Reference ID: ED54281-17 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554281

LIMS Reference ID: ED54281

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 24-57432, Plainview-Old Bethpage Central School
District, John F. Kennedy High School JFK, 50
Kennedy Drive, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 07/16/2025 16:01

Reported: 08/12/2025 09:07

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0044 (Continued) Lims Reference ID: ED54281-17 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/22/25 11:53	07/22/25 11:53	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0045 Lims Reference ID: ED54281-18 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 11:54	07/22/25 11:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0055 Lims Reference ID: ED54281-19 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	7.0		1	1.0	µg/L	07/22/25 11:55	07/22/25 11:55	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0072 Lims Reference ID: ED54281-20 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	3.2		1	1.0	µg/L	07/22/25 11:57	07/22/25 11:57	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0082 Lims Reference ID: ED54281-21 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	13.9		1	1.0	µg/L	07/22/25 11:58	07/22/25 11:58	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0084 Lims Reference ID: ED54281-22 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 12:10	07/22/25 12:10	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0085 Lims Reference ID: ED54281-23 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 12:13	07/22/25 12:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0094 Lims Reference ID: ED54281-24 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 12:15	07/22/25 12:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0095 Lims Reference ID: ED54281-25 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554281

LIMS Reference ID: ED54281

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, John F. Kennedy High School JFK, 50
Kennedy Drive, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:07

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: POB-0095 (Continued)

Lims Reference ID: ED54281-25 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	07/22/25 12:16	07/22/25 12:16	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0099

Lims Reference ID: ED54281-26 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 12:17	07/22/25 12:17	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0117

Lims Reference ID: ED54281-27 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 12:21	07/22/25 12:21	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0118

Lims Reference ID: ED54281-28 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 12:23	07/22/25 12:23	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0127

Lims Reference ID: ED54281-29 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	14.5		1	1.0	µg/L	07/22/25 12:24	07/22/25 12:24	SEH	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0130

Lims Reference ID: ED54281-30 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	5.0		1	1.0	µg/L	07/22/25 12:25	07/22/25 12:25	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0157

Lims Reference ID: ED54281-31 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	1.1		1	1.0	µg/L	07/22/25 12:27	07/22/25 12:27	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0342

Lims Reference ID: ED54281-32 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 12:28	07/22/25 12:28	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0343

Lims Reference ID: ED54281-33 Matrix: Drinking Water

Sampled: 06/25/25 00:00:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554281

LIMS Reference ID: ED54281

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, John F. Kennedy High School JFK, 50
Kennedy Drive, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:07

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0343 (Continued) Lims Reference ID: ED54281-33 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/22/25 12:32	07/22/25 12:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0359 Lims Reference ID: ED54281-34 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	13.5		1	1.0	µg/L	07/22/25 12:33	07/22/25 12:33	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1848 Lims Reference ID: ED54281-35 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	8.2		1	1.0	µg/L	07/25/25 14:11	07/25/25 14:11	SEH	EPA 200.8 (Dig)/EPA 200.8
Sample: POB-1856 Lims Reference ID: ED54281-36 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 12:37	07/22/25 12:37	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1857 Lims Reference ID: ED54281-37 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 12:39	07/22/25 12:39	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1860 Lims Reference ID: ED54281-38 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 12:40	07/22/25 12:40	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1861 Lims Reference ID: ED54281-39 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	3.3		1	1.0	µg/L	07/22/25 12:41	07/22/25 12:41	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1862 Lims Reference ID: ED54281-40 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	07/22/25 12:43	07/22/25 12:43	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1863 Lims Reference ID: ED54281-41 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554281

LIMS Reference ID: ED54281

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, John F. Kennedy High School JFK, 50
Kennedy Drive, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:07

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1863 (Continued) Lims Reference ID: ED54281-41 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals (Continued)									
Lead	3.6		1	1.0	µg/L	07/22/25 12:44	07/22/25 12:44	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1867 Lims Reference ID: ED54281-42 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 12:45	07/22/25 12:45	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1873 Lims Reference ID: ED54281-43 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	4.9		1	1.0	µg/L	07/22/25 13:44	07/22/25 13:44	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1878 Lims Reference ID: ED54281-44 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:48	07/22/25 13:48	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1879 Lims Reference ID: ED54281-45 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	07/22/25 13:49	07/22/25 13:49	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1880 Lims Reference ID: ED54281-46 Matrix: Drinking Water Sampled: 06/25/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:50	07/22/25 13:50	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554281

LIMS Reference ID: ED54281

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, John F. Kennedy High School JFK, 50
Kennedy Drive, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:07

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554281**LIMS Reference ID:** ED54281**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, John F. Kennedy High School JFK, 50
Kennedy Drive, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:07

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Stratford Road Elementary School

SRE

ED54295

Client:

Plainview-Old Bethpage Central School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-0428	KI	2097	Kitchen	KC	6/19/2025	12:23:00 PM
POB-0429	KI	2097	Kitchen	KC	6/19/2025	12:24:00 PM
POB-0430	KI	2097	Kitchen	KC	6/19/2025	12:24:00 PM
POB-0439	LR	2151	Gym Locker Room Rear Vestibule	BW	6/19/2025	12:34:00 PM
POB-0453	HA	3086	Corridor Room 201 To 210A	WC	6/19/2025	12:50:00 PM
POB-0475	HA	3044	Corridor Room 214 To 227	WC	6/19/2025	12:45:00 PM
POB-0499	GY	2133	Large Gym	DW	6/19/2025	12:36:00 PM
POB-0502	CA	2104	K. Cafeteria	BW	6/19/2025	12:34:00 PM
POB-0503	CA	2104	K. Cafeteria	WC	6/19/2025	12:34:00 PM
POB-0504	CA	2104	K. Cafeteria	WC	6/19/2025	12:34:00 PM
POB-0505	FL	2029	Room 303	HW	6/19/2025	12:55:00 PM
POB-1788	LR	2151	Gym Locker Room Rear Vestibule	WC	6/19/2025	12:44:00 PM
POB-1837	GY	2133	Large Gym	BW	6/19/2025	12:35:00 PM
POB-2055	NO	2087	Nurses Office	NS	6/19/2025	12:11:00 PM
POB-2056	NO	2087	Nurses Office	NS	6/19/2025	12:11:00 PM
POB-2074	CR	3009A	Room 230	DW	6/19/2025	12:48:00 PM
POB-2076	HA	3086	Corridor Room 201 To 210A	WC	6/19/2025	12:52:00 PM

RECEIVED
ENSI ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM 4:00 PM

Building Address

33 Bedford Road

Plainview, NY 11803

Analysis Type: ELAP 200.5

Lab Received:

ASTanley 7/16/25

Signature:

 4:03pm

Samplers Name:


Andrew Schreck

Samplers Signature:



JCB Project Manager:

George Greve



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building:

Stratford Road Elementary School

SRE

Client:

Plainview-Old Bethpage Central School District

Retest/New Install ☐

Turn Around: (Normal 1/wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-0367	HA	2019	Corridor Room 100 To 109	WC	6/19/2025	11:57:00 AM
POB-0373	HA	2019	Corridor Room 100 To 109	WC	6/19/2025	11:55:00 AM
POB-0385	HA	2057	Corridor Room 300 To 309	BW	6/19/2025	12:00:00 PM
POB-0386	HA	2057	Corridor Room 300 To 309	WC	6/19/2025	12:00:00 PM
POB-0389	HA	2056	Corridor Room 303 To Auditorium	DW	6/19/2025	12:02:00 PM
POB-0393	HA	2056	Corridor Room 303 To Auditorium	DW	6/19/2025	12:04:00 PM
POB-0396	OF	2059	Main Office	BW	6/19/2025	12:06:00 PM
POB-0397	OF	2059	Main Office	WC	6/19/2025	12:06:00 PM
POB-0398	FL	2082	Faculty Lounge 130	HW	6/19/2025	12:09:00 PM JUL 16 25, PM 4:03
POB-0401	HA	2127	Corridor Room 112 To 120	BW	6/19/2025	12:15:00 PM
POB-0417	FL	2110	Faculty Office Room 114	HW	6/19/2025	RECEIVED 12:17:00 PM FMS ANALYTICAL, INC. Carle Place, NY
POB-0421	CA	2095	Cafeteria	BW	6/19/2025	12:18:00 PM JUL 16 25, PM 4:03 PM
POB-0422	CA	2095	Cafeteria	WC	6/19/2025	12:18:00 PM
POB-0423	CA	2095	Cafeteria	WC	6/19/2025	12:18:00 PM
POB-0424	KI	2097	Kitchen	KC	6/19/2025	12:21:00 PM
POB-0425	KI	2097	Kitchen	KC	6/19/2025	12:21:00 PM
POB-0426	KI	2097	Kitchen	KC	6/19/2025	12:22:00 PM
POB-0427	KI	2097	Kitchen	KC	6/19/2025	12:22:00 PM

Building Address

33 Bedford Road
Plainview, NY 11803



Analysis Type: ELAP 200.5

Lab Received:

Ashtanley 7/16/25

Signature:

[Signature] 4:03pm

Samplers Name: Andrew Schreck


Samplers Signature:

[Signature]

JCB Project Manager:

George Greve

EDS4295

**Lead in Water: Chain of Custody for**

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building:

Stratford Road Elementary School

SRE

Client:

Plainview-Old Bethpage Central School District

Retest/New Install ☐**Turn Around:** Normal 1 wk, Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 35

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM04:03

Building Address

33 Bedford Road
Plainview, NY 11803

Analysis Type: ELAP 200.5**Lab Received:** AB Stanley 7/16/25**Signature:** [Signature] 4103fr**Samplers Name:** _____**Samplers Signature:** _____**JCB Project Manager:** _____

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554295

LIMS Reference ID: ED54295

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Stratford Road Elementary School, SRE,
Plainview- Old Behtpage Central School District, 33
Bedford Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:03

Reported:

08/12/2025 09:16

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0367									
Lims Reference ID:				ED54295-01		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	1.2		1	1.0	µg/L	07/25/25 14:15	07/25/25 14:15	SEH	EPA 200.8 (Dig)/EPA 200.8
Sample: POB-0373									
Lims Reference ID:				ED54295-02		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 12:56	07/22/25 12:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0385									
Lims Reference ID:				ED54295-03		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:00	07/22/25 13:00	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0386									
Lims Reference ID:				ED54295-04		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:02	07/22/25 13:02	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0389									
Lims Reference ID:				ED54295-05		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	1.7		1	1.0	µg/L	07/22/25 13:03	07/22/25 13:03	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0393									
Lims Reference ID:				ED54295-06		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	2.4		1	1.0	µg/L	07/22/25 13:04	07/22/25 13:04	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0396									
Lims Reference ID:				ED54295-07		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:08	07/22/25 13:08	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0397									
Lims Reference ID:				ED54295-08		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:10	07/22/25 13:10	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0398									
Lims Reference ID:				ED54295-09		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554295

LIMS Reference ID: ED54295

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 24-57432, Stratford Road Elementary School, SRE,
Plainview- Old Behtpage Central School District, 33
Bedford Road, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 07/16/2025 16:03

Reported: 08/12/2025 09:16

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0398 (Continued) Lims Reference ID: ED54295-09 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:11	07/22/25 13:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0401 Lims Reference ID: ED54295-10 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:12	07/22/25 13:12	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0417 Lims Reference ID: ED54295-11 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	3.0		1	1.0	µg/L	07/22/25 13:14	07/22/25 13:14	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0421 Lims Reference ID: ED54295-12 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:15	07/22/25 13:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0422 Lims Reference ID: ED54295-13 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	07/22/25 13:19	07/22/25 13:19	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0423 Lims Reference ID: ED54295-14 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.0		1	1.0	µg/L	07/22/25 13:20	07/22/25 13:20	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0424 Lims Reference ID: ED54295-15 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	7.5		1	1.0	µg/L	07/22/25 13:24	07/22/25 13:24	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0425 Lims Reference ID: ED54295-16 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	2.8		1	1.0	µg/L	07/22/25 13:25	07/22/25 13:25	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0426 Lims Reference ID: ED54295-17 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554295

LIMS Reference ID: ED54295

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 24-57432, Stratford Road Elementary School, SRE,
Plainview- Old Behtpage Central School District, 33
Bedford Road, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 07/16/2025 16:03

Reported: 08/12/2025 09:16

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0426 (Continued) Lims Reference ID: ED54295-17 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:27	07/22/25 13:27	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0427 Lims Reference ID: ED54295-18 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:28	07/22/25 13:28	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0428 Lims Reference ID: ED54295-19 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	4.0		1	1.0	µg/L	07/22/25 13:29	07/22/25 13:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0429 Lims Reference ID: ED54295-20 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	15.4		1	1.0	µg/L	07/22/25 13:31	07/22/25 13:31	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0430 Lims Reference ID: ED54295-21 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	4.8		1	1.0	µg/L	07/22/25 13:32	07/22/25 13:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0439 Lims Reference ID: ED54295-22 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:52	07/22/25 13:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0453 Lims Reference ID: ED54295-23 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:56	07/22/25 13:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0475 Lims Reference ID: ED54295-24 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 13:57	07/22/25 13:57	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0499 Lims Reference ID: ED54295-25 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554295

LIMS Reference ID: ED54295

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 24-57432, Stratford Road Elementary School, SRE,
Plainview- Old Behtpage Central School District, 33
Bedford Road, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 07/16/2025 16:03

Reported: 08/12/2025 09:16

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: POB-0499 (Continued)

Lims Reference ID: ED54295-25 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	07/22/25 13:58	07/22/25 13:58	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0502

Lims Reference ID: ED54295-26 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 13:59	07/22/25 13:59	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0503

Lims Reference ID: ED54295-27 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	3.2		1	1.0	µg/L	07/22/25 14:01	07/22/25 14:01	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0504

Lims Reference ID: ED54295-28 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	3.5		1	1.0	µg/L	07/22/25 14:02	07/22/25 14:02	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0505

Lims Reference ID: ED54295-29 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 14:06	07/22/25 14:06	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-1788

Lims Reference ID: ED54295-30 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 14:07	07/22/25 14:07	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-1837

Lims Reference ID: ED54295-31 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/22/25 14:11	07/22/25 14:11	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-2055

Lims Reference ID: ED54295-32 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	5.8		1	1.0	µg/L	07/22/25 14:13	07/22/25 14:13	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-2056

Lims Reference ID: ED54295-33 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554295

LIMS Reference ID: ED54295

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Stratford Road Elementary School, SRE,
Plainview- Old Behtpage Central School District, 33
Bedford Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeremy Bish

Received:

07/16/2025 16:03

Reported:

08/12/2025 09:16

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-2056 (Continued)									
			Lims Reference ID:		ED54295-33		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00
Metals (Continued)									
Lead	2.1		1	1.0	µg/L	07/22/25 14:14	07/22/25 14:14	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2074									
			Lims Reference ID:		ED54295-34		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00
Metals									
Lead	40.5		1	1.0	µg/L	07/22/25 14:15	07/22/25 14:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2076									
			Lims Reference ID:		ED54295-35		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00
Metals									
Lead	< 1.0		1	1.0	µg/L	07/22/25 14:17	07/22/25 14:17	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554295**LIMS Reference ID:** ED54295**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Stratford Road Elementary School, SRE,
Plainview- Old Behtpage Central School District, 33
Bedford Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:03

Reported:

08/12/2025 09:16

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554295**LIMS Reference ID:** ED54295**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Stratford Road Elementary School, SRE,
Plainview- Old Behtpage Central School District, 33
Bedford Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:03

Reported:

08/12/2025 09:16

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED54296



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Parkway Elementary School

PAR

Client:

Plainview-Old Bethpage Central School District

Retest/New Install []

Turn Around: Normal 1 Wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-0510	HA	2014	Corridor Room 31 To 38	BW	6/19/2025	1:53:00 PM
POB-0532	HA	2052	Main Corridor	WC	6/19/2025	1:47:00 PM
POB-0533	HA	2052	Main Corridor	BW	6/19/2025	1:47:00 PM
POB-0578	CR	2046	Room 15	DW	6/19/2025	1:58:00 PM
POB-0585	KI	2060	Main Office Kitchen	KC	6/19/2025	1:36:00 PM
POB-0591	NO	2071/2072	Nurses Office	NS	6/19/2025	1:35:00 PM
POB-0604	KI	2099	Kitchen	HW	6/19/2025	1:40:00 PM
POB-0605	KI	2099	Kitchen	HW	6/19/2025	1:39:00 PM
POB-0606	KI	2099	Kitchen	KC	6/19/2025	1:43:00 PM
POB-0607	KI	2099	Kitchen	KC	6/19/2025	1:38:00 PM
POB-0608	KI	2099	Kitchen	KC	6/19/2025	1:40:00 PM
POB-0609	KI	2099	Kitchen	KC	6/19/2025	1:40:00 PM
POB-0615	CA	2100	Cafeteria/Auditorium	WC	6/19/2025	1:45:00 PM
POB-0616	CA	2100	Cafeteria/Auditorium	WC	6/19/2025	1:45:00 PM
POB-0617	CA	2100	Cafeteria/Auditorium	BW	6/19/2025	1:45:00 PM
POB-0623	OF	2113	PE Office	HW	6/19/2025	1:49:00 PM
POB-0624	HA	2105/2107/2122	Corridor Outside Gymnasium & PE Rooms	DW	6/19/2025	1:52:00 PM
POB-0628	FL	2118	Faculty Room	HW	6/19/2025	1:50:00 PM

RECEIVED
 EMSL ANALYTICAL, INC.
 Carle Place, NY
 JUL 16 25 PM 4:05

Building Address

300 Manetto Hill Road
 Plainview, NY 11803



Analysis Type: ELAP 200.5

Lab Received:

Signature:


ASTANLEY 7/16/25
 4:05pm

Samplers Name:

Samplers Signature:

JCB Project Manager:

Andrew Schrock
 Andrew Schrock
 George Greve



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Parkway Elementary School

PAR

ED54296

Client:

Plainview-Old Bethpage Central School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-1794	OF	2055	Main Office & AP Office Area	WC	6/19/2025	1:36:00 PM
POB-1795	OF	2055	Main Office & AP Office Area	BW	6/19/2025	1:36:00 PM

Samples Submitted 20

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM04:05

Building Address

300 Manetto Hill Road

Plainview, NY 11803

Analysis Type: ELAP 200.5

Lab Received: AS Stanley 7/16/25

Signature: [Signature] 4:05p

Samplers Name: Andrew Schreck

Samplers Signature: [Signature]

JCB Project Manager: Gorge Greve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554296

LIMS Reference ID: ED54296

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Parkway Elementary School, PAR,
Plainview-Old Bethpage Central School District, 300
Manetto Hill Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:05

Reported:

08/12/2025 09:20

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0510 Lims Reference ID: ED54296-01 Matrix: Drinking Water Sampled: 07/15/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:42	07/21/25 12:42	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0532 Lims Reference ID: ED54296-02 Matrix: Drinking Water Sampled: 07/15/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:46	07/21/25 12:46	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0533 Lims Reference ID: ED54296-03 Matrix: Drinking Water Sampled: 07/15/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:47	07/21/25 12:47	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0578 Lims Reference ID: ED54296-04 Matrix: Drinking Water Sampled: 07/15/25 00:00:00									
Metals									
Lead	2.8		1	1.0	µg/L	07/21/25 12:49	07/21/25 12:49	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0585 Lims Reference ID: ED54296-05 Matrix: Drinking Water Sampled: 07/15/25 00:00:00									
Metals									
Lead	2.5		1	1.0	µg/L	07/21/25 12:50	07/21/25 12:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0591 Lims Reference ID: ED54296-06 Matrix: Drinking Water Sampled: 07/15/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:54	07/21/25 12:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0604 Lims Reference ID: ED54296-07 Matrix: Drinking Water Sampled: 07/15/25 00:00:00									
Metals									
Lead	2.0		1	1.0	µg/L	07/21/25 12:55	07/21/25 12:55	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0605 Lims Reference ID: ED54296-08 Matrix: Drinking Water Sampled: 07/15/25 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	07/21/25 12:57	07/21/25 12:57	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0606 Lims Reference ID: ED54296-09 Matrix: Drinking Water Sampled: 07/15/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554296

LIMS Reference ID: ED54296

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Parkway Elementary School, PAR,
Plainview-Old Bethpage Central School District, 300
Manetto Hill Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:05

Reported:

08/12/2025 09:20

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: POB-0606 (Continued)

Lims Reference ID: ED54296-09 Matrix: Drinking Water

Sampled: 07/15/25 00:00:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	07/21/25 12:58	07/21/25 12:58	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0607

Lims Reference ID: ED54296-10 Matrix: Drinking Water

Sampled: 07/15/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/21/25 12:59	07/21/25 12:59	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0608

Lims Reference ID: ED54296-11 Matrix: Drinking Water

Sampled: 07/15/25 00:00:00

Metals

Lead	4.0		1	1.0	µg/L	07/21/25 13:00	07/21/25 13:00	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0609

Lims Reference ID: ED54296-12 Matrix: Drinking Water

Sampled: 07/15/25 00:00:00

Metals

Lead	25.1		1	1.0	µg/L	07/21/25 13:04	07/21/25 13:04	SEH	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0615

Lims Reference ID: ED54296-13 Matrix: Drinking Water

Sampled: 07/15/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/21/25 13:06	07/21/25 13:06	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0616

Lims Reference ID: ED54296-14 Matrix: Drinking Water

Sampled: 07/15/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/21/25 13:10	07/21/25 13:10	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0617

Lims Reference ID: ED54296-15 Matrix: Drinking Water

Sampled: 07/15/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/21/25 13:11	07/21/25 13:11	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0623

Lims Reference ID: ED54296-16 Matrix: Drinking Water

Sampled: 07/15/25 00:00:00

Metals

Lead	1.9		1	1.0	µg/L	07/21/25 13:12	07/21/25 13:12	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0624

Lims Reference ID: ED54296-17 Matrix: Drinking Water

Sampled: 07/15/25 00:00:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554296

LIMS Reference ID: ED54296

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Parkway Elementary School, PAR,
Plainview-Old Bethpage Central School District, 300
Manetto Hill Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:05

Reported:

08/12/2025 09:20

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0624 (Continued)									
Lims Reference ID:				ED54296-17 Matrix: Drinking Water				Sampled: 07/15/25 00:00:00	
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/21/25 13:14	07/21/25 13:14	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0628									
Lims Reference ID:				ED54296-18 Matrix: Drinking Water				Sampled: 07/15/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 13:15	07/21/25 13:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1794									
Lims Reference ID:				ED54296-19 Matrix: Drinking Water				Sampled: 07/15/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 13:27	07/21/25 13:27	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1795									
Lims Reference ID:				ED54296-20 Matrix: Drinking Water				Sampled: 07/15/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 13:28	07/21/25 13:28	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554296

LIMS Reference ID: ED54296

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Parkway Elementary School, PAR,
Plainview-Old Bethpage Central School District, 300
Manetto Hill Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeremy Bish

Received:

07/16/2025 16:05

Reported:

08/12/2025 09:20

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554296

LIMS Reference ID: ED54296

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Parkway Elementary School, PAR,
Plainview-Old Bethpage Central School District, 300
Manetto Hill Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:05

Reported:

08/12/2025 09:20

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Plainview-Old Bethpage Middle School

POBM

Client:

Plainview-Old Bethpage Central School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

ED 54317

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-0743	HA	3062	Fan Room Corridor	WC	6/19/2025	7:54:00 AM
POB-0744	HA	3062	Fan Room Corridor	BW	6/19/2025	7:54:00 AM
POB-0776	BR	2077	Girls Locker Room	DW	6/19/2025	9:03:00 AM
POB-0787	HA	2192	Corridor From Tract Center To Stairwell	BW	6/19/2025	7:39:00 AM
POB-0800	HA	1008	Corridor Outside Room 109 & 111	BW	6/19/2025	9:37:00 AM
POB-0817	CA	2051	Cafeteria	WC	6/19/2025	7:43:00 AM
POB-0818	CA	2051	Cafeteria	WC	6/19/2025	7:44:00 AM
POB-0819	CA	2051	Cafeteria	BW	6/19/2025	7:44:00 AM
POB-0820	HE	2068	Room 204	EC	6/19/2025	9:11:00 AM
POB-0821	HE	2068	Room 204	EC	6/19/2025	9:11:00 AM
POB-0822	HE	2068	Room 204	EC	6/19/2025	9:12:00 AM
POB-0823	HE	2068	Room 204	EC	6/19/2025	9:12:00 AM
POB-0826	HE	2067	Room 202	EC	6/19/2025	9:13:00 AM
POB-0827	HE	2067	Room 202	EC	6/19/2025	9:13:00 AM
POB-0828	HE	2067	Room 202	EC	6/19/2025	9:13:00 AM
POB-0829	HE	2067	Room 202	EC	6/19/2025	9:14:00 AM
POB-0830	KI	2052	Kitchen Serving Area	HW	6/19/2025	9:17:00 AM
POB-0832	KI	2052	Kitchen Serving Area	KC	6/19/2025	7:46:00 AM

RECEIVED
EWS ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM 4:04

Building Address

121 Central Park Road
Plainview, NY 11803



Analysis Type: ELAP 200.5


Lab Received:

Signature:

Samplers Name: Andrew Schreck

Samplers Signature: Andrew Schreck

JCB Project Manager: George Grove



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Plainview-Old Bethpage Middle School

POBM

ED 54317

Client:

Plainview-Old Bethpage Central School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-0833	KI	2052	Kitchen Serving Area	KC	6/19/2025	7:46:00 AM
POB-0834	KI	2052	Kitchen Serving Area	KC	6/19/2025	7:19:00 AM
POB-0836	KI	2052	Kitchen Serving Area	HW	6/19/2025	7:48:00 AM
POB-0837	NO	2012	Nurses Office Bathroom	NS	6/19/2025	9:20:00 AM
POB-0841	HA	2163	Corridor Outside Room 231	DW	6/19/2025	7:37:00 AM
POB-0862	HA	2213	Corridor Art Gallery To Room 225	DW	6/19/2025	9:24:00 AM
POB-0873	HA	2125	Room 224 Assistant Principal	WC	6/19/2025	7:33:00 AM
POB-0885	HA	1058	Corridor Room 101 To 107	BW	6/19/2025	7:26:00 AM
POB-0898	FL	1051	Faculty Room	KC	6/19/2025	9:30:00 AM
POB-0902	OF	1052	Building And Grounds	KC	6/19/2025	9:32:00 AM
POB-0903	OF	1052	Building And Grounds	SN	6/19/2025	9:32:00 AM
POB-1829	HA	2120	Gym Corridor	WF	6/19/2025	7:41:00 AM
POB-1830	HA	2044	Corridor Storage Room S5 To Room 239	WF	6/19/2025	7:28:00 AM
POB-1831	HA	2044	Corridor Storage Room S5 To Room 239	WC	6/19/2025	7:28:00 AM
POB-2190	KI	2052	Kitchen Serving Area	KC	6/19/2025	9:14:00 AM
POB-2191	KI	2052	Kitchen Serving Area	KC	6/19/2025	9:17:00 AM
POB-2196	CR	1053	Woodworking Room 101	DW	6/19/2025	9:32:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25 PM 04:04

Building Address

121 Central Park Road

Plainview, NY 11803

Analysis Type: ELAP 200.5


Lab Received:

Signature:

Samplers Name: Andrew Schreck

Samplers Signature: Andrew Schreck

JCB Project Manager: George Greve



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Plainview-Old Bethpage Middle School

POBM

ED 54317

Client:

Plainview-Old Bethpage Central School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 35

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM 04:04

Building Address

121 Central Park Road

Plainview, NY 11803

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: _____

Samplers Signature: _____

JCB Project Manager: _____

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554317

LIMS Reference ID: ED54317

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: JCB#: 24-57432, Plainview-Old Bethpage Middle School, Plainview-Old Bethpage Central School District, 121 Central Park Road, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 07/16/2025 16:04

Reported: 08/12/2025 09:21

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0743 Lims Reference ID: ED54317-01 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 11:55	07/21/25 11:55	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0744 Lims Reference ID: ED54317-02 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 11:59	07/21/25 11:59	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0776 Lims Reference ID: ED54317-03 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	2.1		1	1.0	µg/L	07/21/25 12:00	07/21/25 12:00	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0787 Lims Reference ID: ED54317-04 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:01	07/21/25 12:01	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0800 Lims Reference ID: ED54317-05 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:03	07/21/25 12:03	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0817 Lims Reference ID: ED54317-06 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:06	07/21/25 12:06	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0818 Lims Reference ID: ED54317-07 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:08	07/21/25 12:08	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0819 Lims Reference ID: ED54317-08 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:09	07/21/25 12:09	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0820 Lims Reference ID: ED54317-09 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554317

LIMS Reference ID: ED54317

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Plainview-Old Bethpage Middle
School, Plainview-Old Bethpage Central School
District, 121 Central Park Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:04

Reported:

08/12/2025 09:21

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: POB-0820 (Continued)

Lims Reference ID: ED54317-09 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals (Continued)

Lead	10.7		1	1.0	µg/L	07/21/25 12:10	07/21/25 12:10	SEH	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0821

Lims Reference ID: ED54317-10 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/21/25 12:12	07/21/25 12:12	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0822

Lims Reference ID: ED54317-11 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/21/25 12:13	07/21/25 12:13	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0823

Lims Reference ID: ED54317-12 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/21/25 12:17	07/21/25 12:17	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0826

Lims Reference ID: ED54317-13 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	1.3		1	1.0	µg/L	07/21/25 12:18	07/21/25 12:18	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0827

Lims Reference ID: ED54317-14 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	1.2		1	1.0	µg/L	07/21/25 12:22	07/21/25 12:22	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0828

Lims Reference ID: ED54317-15 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	07/21/25 12:24	07/21/25 12:24	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0829

Lims Reference ID: ED54317-16 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

Lead	3.0		1	1.0	µg/L	07/21/25 12:25	07/21/25 12:25	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: POB-0830

Lims Reference ID: ED54317-17 Matrix: Drinking Water

Sampled: 06/19/25 00:00:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554317

LIMS Reference ID: ED54317

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Plainview-Old Bethpage Middle
School, Plainview-Old Bethpage Central School
District, 121 Central Park Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:04

Reported:

08/12/2025 09:21

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0830 (Continued) Lims Reference ID: ED54317-17 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals (Continued)									
Lead	2.4		1	1.0	µg/L	07/21/25 12:26	07/21/25 12:26	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0832 Lims Reference ID: ED54317-18 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.0		1	1.0	µg/L	07/21/25 12:28	07/21/25 12:28	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0833 Lims Reference ID: ED54317-19 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 12:29	07/21/25 12:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0834 Lims Reference ID: ED54317-20 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	4.3		1	1.0	µg/L	07/21/25 12:30	07/21/25 12:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0836 Lims Reference ID: ED54317-21 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	9.7		1	1.0	µg/L	07/21/25 15:16	07/21/25 15:16	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0837 Lims Reference ID: ED54317-22 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	7.4		1	1.0	µg/L	07/21/25 15:17	07/21/25 15:17	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0841 Lims Reference ID: ED54317-23 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	5.5		1	1.0	µg/L	07/21/25 15:21	07/21/25 15:21	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0862 Lims Reference ID: ED54317-24 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	9.6		1	1.0	µg/L	07/21/25 15:22	07/21/25 15:22	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0873 Lims Reference ID: ED54317-25 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554317

LIMS Reference ID: ED54317

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Plainview-Old Bethpage Middle
School, Plainview-Old Bethpage Central School
District, 121 Central Park Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:04

Reported:

08/12/2025 09:21

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0873 (Continued) Lims Reference ID: ED54317-25 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/21/25 15:26	07/21/25 15:26	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0885 Lims Reference ID: ED54317-26 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 15:27	07/21/25 15:27	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0898 Lims Reference ID: ED54317-27 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.7		1	1.0	µg/L	07/21/25 15:29	07/21/25 15:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0902 Lims Reference ID: ED54317-28 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	2.4		1	1.0	µg/L	07/21/25 15:30	07/21/25 15:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0903 Lims Reference ID: ED54317-29 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	07/21/25 15:31	07/21/25 15:31	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1829 Lims Reference ID: ED54317-30 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 15:33	07/21/25 15:33	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1830 Lims Reference ID: ED54317-31 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 15:34	07/21/25 15:34	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1831 Lims Reference ID: ED54317-32 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/25/25 14:16	07/25/25 14:16	SEH	EPA 200.8 (Dig)/EPA 200.8
Sample: POB-2190 Lims Reference ID: ED54317-33 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554317

LIMS Reference ID: ED54317

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Plainview-Old Bethpage Middle
School, Plainview-Old Bethpage Central School
District, 121 Central Park Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeremy Bish

Received:

07/16/2025 16:04

Reported:

08/12/2025 09:21

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-2190 (Continued)									
			Lims Reference ID:		ED54317-33		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00
Metals (Continued)									
Lead	24.7		1	1.0	µg/L	07/25/25 14:18	07/25/25 14:18	SEH	EPA 200.8 (Dig)/EPA 200.8
Sample: POB-2191									
			Lims Reference ID:		ED54317-34		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00
Metals									
Lead	6.8		1	1.0	µg/L	07/22/25 10:36	07/22/25 10:36	SEH	EPA 200.8 (Dig)/EPA 200.8
Sample: POB-2196									
			Lims Reference ID:		ED54317-35		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00
Metals									
Lead	< 1.0		1	1.0	µg/L	07/25/25 14:19	07/25/25 14:19	SEH	EPA 200.8 (Dig)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554317**LIMS Reference ID:** ED54317**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Plainview-Old Bethpage Middle
School, Plainview-Old Bethpage Central School
District, 121 Central Park Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:04

Reported:

08/12/2025 09:21

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554317**LIMS Reference ID:** ED54317**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Plainview-Old Bethpage Middle
School, Plainview-Old Bethpage Central School
District, 121 Central Park Road, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:04

Reported:

08/12/2025 09:21

Notes and Definitions


Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

062553967



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Howard B. Mattlin Middle School

HBM

Client:

Plainview-Old Bethpage Central School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-0923	GY	1029	Corridor Adjacent Girls Locker Room	WC	6/27/25	6:20
POB-0924	GY	1029	Corridor Adjacent Girls Locker Room	BW	6/27/25	6:20
POB-0925	GY	1029	Corridor Adjacent Girls Locker Room	WC	6/27/25	6:20
POB-0926	GY	1029	Corridor Adjacent Girls Locker Room	BW	6/27/25	6:20
POB-0939	HA	2026	Corridor Room D 28 To D 33	DW	6/27/25	~~01515~~ 01515
POB-0947	HA	1150	Corridor Room D 1 To D 3	WF	6/27/25	6:50
POB-1013	SP	1170	Room Across Room D 6 (Kitchenette)	KC	6/27/25	6:55
POB-1033	HA	2055	Atrium (Space Renovated)	DW	6/27/25	01515
POB-1042	HE	1091	Room C 7	EC	6/27/25	7:03
POB-1077	HA	1068	Corridor From C 1 To C 3	BW	6/27/25	7:00
POB-1126	HA	1114	Corridor Room B 1 To B 3	DW	6/27/25	7:30
POB-1145	SP	1122	Board Room Break Room	KC	6/27/25	7:22
POB-1147	HA	2080	Corridor From Room B 28 To B 33	DW	6/27/25	7:20
POB-1170	HA	2189	Corridor Main Office To Nurses Office (Includes 2169 & 2170)	DW	6/27/25	01515
POB-1173	HA	2151	Music Wing Corridor	DW	6/27/25	7:12
POB-1192	KI	2120	Kitchen Room A1/A2	KC	6/27/25	6:36
POB-1193	KI	2120	Kitchen Room A1/A2	KC	6/27/25	6:36
POB-1194	KI	2120	Kitchen Room A1/A2	KC	6/27/25	6:36

Building Address

100 Washington Ave

Plainview, NY 11803

Analysis Type: ELAP 200.5


Lab Received:

Signature:

Samplers Name: Erika Wilson

Samplers Signature:

JCB Project Manager: George Greve



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Howard B. Mattlin Middle School

HBM

Client:

Plainview-Old Bethpage Central School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

062553967

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-1196	KI	2120	Kitchen Room A1/A2	KC	6/27/25	6:32
POB-1197	KI	2120	Kitchen Room A1/A2	KC	6/27/25	6:36
POB-1200	CA	2135	Cafeteria	WC	6/27/25	6:41
POB-1201	CA	2135	Cafeteria	WC	6/27/25	O/S/S
POB-1209	HA	2119		DW	6/27/25	O/S/S
POB-1217	HA	2115		DW	6/27/25	O/S/S
POB-1232	GY	1025	Behind Garage Door	IM	6/27/25	O/S/S
POB-1233	GY	1025	Corridor Adjacent Boys Locker Room	WC	6/27/25	6:12
POB-1234	GY	1025	Corridor Adjacent Boys Locker Room	BW	6/27/25	6:12
POB-1235	GY	1025	Corridor Adjacent Boys Locker Room	WC	6/27/25	6:12
POB-1236	GY	1025	Corridor Adjacent Boys Locker Room	BW	6/27/25	6:12
POB-1247	LR	1038	Girls Locker Room	DW	6/27/25	~~6:12~~ O/S/S
POB-1256	NO	2191	Health Suite Vestibule (Space Reconstructed)	NS	6/27/25	7:05
POB-1263	KI	2131	PTA Storage A3	KC	6/27/25	O/S/S
POB-1265	KI	2120	Kitchen Room A1/A2	PK	6/27/25	~~6:12~~ O/S/S
POB-1802	HA	1106	Corridor Room B 4 To B 7	DW	6/27/25	~~6:12~~ O/S/S
POB-1948	LR	1013	Boys Locker Room	DW	6/27/25	~~6:12~~ O/S/S
POB-2003	HE	1091	Room C 7	EC	6/27/25	~~6:12~~ O/S/S

Building Address

100 Washington Ave

Plainview, NY 11803

Analysis Type: ELAP 200.5

Lab Received:


Signature:

Samplers Name: Erika Wilson

Samplers Signature:

JCB Project Manager:

George Grove



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building:

Howard B. Mattlin Middle School

HBM

Client:

Plainview-Old Bethpage Central School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

062553967

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-2015	SP	1107	Room B 3/Superintendent Reception	BWC	6/27/25	01515
POB-2016	SP	1107	Room B 3/Superintendent Reception	BWC	6/27/25	01515
POB-2018	SP	1108	Room B 2 Office Kitchen	KC	6/27/25	01515
POB-2020	HA	2096	Corridor From Room B 21 To B 26	BW	6/27/25	7:18
POB-2021	HE	2180	Family & Consumer Sciences Room A1	EC	6/27/25	7:45
POB-2022	HE	2180	Family & Consumer Sciences Room A1	EC	6/27/25	7:45
POB-2023	HE	2180	Family & Consumer Sciences Room A1	EC	6/27/25	7:49
POB-2024	HE	2180	Family & Consumer Sciences Room A1	SN	6/27/25	01515
POB-2025	HE	2180	Family & Consumer Sciences Room A1	EC	6/27/25	7:50
POB-2026	HE	2180	Family & Consumer Sciences Room A1	EC	6/27/25	01515
POB-2027	HE	2180	Family & Consumer Sciences Room A1	EC	6/27/25	01515
POB-2028	HE	2186	Family & Consumer Sciences Room A2	EC	6/27/25	7:40
POB-2029	HE	2186	Family & Consumer Sciences Room A2	EC	6/27/25	7:40
POB-2030	HE	2186	Family & Consumer Sciences Room A2	EC	6/27/25	01515
POB-2031	HE	2186	Family & Consumer Sciences Room A2	EC	6/27/25	01515
POB-2032	HE	2186	Family & Consumer Sciences Room A2	EC	6/27/25	01515
POB-2033	OF	2160	Main Office Lunch Room	KC	6/27/25	7:10
POB-2034	FL	2155	Faculty Dining Room	KC	6/27/25	7:14

Building Address

100 Washington Ave
Plainview, NY 11803



Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Erika Wilson

Samplers Signature: [Signature]

JCB Project Manager:

George Greve



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building:

Howard B. Mattlin Middle School

HBM

Client:

Plainview-Old Bethpage Central School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-2035	KI	2120	Kitchen Room A1/A2	HW	6/27/25	6:40
POB-2036	KI	2120	Kitchen Room A1/A2	KC	6/27/25	6:33
POB-2037	CA	2135	Cafeteria	WC	6/27/25	6:41
POB-2038	CA	2135	Cafeteria	BW	6/27/25	6:41

Samples Submitted

58

RECEIVED
EWSL ANALYTICAL, INC.
Carle Place, NY
JUL 07 25, PM01:27

Building Address

100 Washington Ave
Plainview, NY 11803

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Erika Wilson

Samplers Signature:

JCB Project Manager:

George Greve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553967

LIMS Reference ID: ED53967

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: JCB#: 24-57432, Howard B. Mattlin Middle School,
Plainview-Old Bethpage Central School District, 100
Washington Ave, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 06/27/2025 13:27**Reported:** 08/12/2025 08:52**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-0923 Lims Reference ID: ED53967-01 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:16	07/13/25 09:16	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0924 Lims Reference ID: ED53967-02 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:20	07/13/25 09:20	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0925 Lims Reference ID: ED53967-03 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:21	07/13/25 09:21	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0926 Lims Reference ID: ED53967-04 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:22	07/13/25 09:22	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-0947 Lims Reference ID: ED53967-06 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:26	07/13/25 09:26	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1013 Lims Reference ID: ED53967-07 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	11.5		1	1.0	µg/L	07/18/25 19:52	07/18/25 19:52	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: POB-1042 Lims Reference ID: ED53967-09 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:28	07/13/25 09:28	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1077 Lims Reference ID: ED53967-10 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:29	07/13/25 09:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1126 Lims Reference ID: ED53967-11 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553967

LIMS Reference ID: ED53967

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: JCB#: 24-57432, Howard B. Mattlin Middle School,
Plainview-Old Bethpage Central School District, 100
Washington Ave, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 06/27/2025 13:27**Reported:** 08/12/2025 08:52

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1126 (Continued) Lims Reference ID: ED53967-11 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals (Continued)									
Lead	5.6		1	1.0	µg/L	07/13/25 09:30	07/13/25 09:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1145 Lims Reference ID: ED53967-12 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	07/13/25 09:32	07/13/25 09:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1147 Lims Reference ID: ED53967-13 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:33	07/13/25 09:33	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1173 Lims Reference ID: ED53967-15 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	6.6		1	1.0	µg/L	07/13/25 09:34	07/13/25 09:34	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1192 Lims Reference ID: ED53967-16 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	2.1		1	1.0	µg/L	07/13/25 09:38	07/13/25 09:38	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1193 Lims Reference ID: ED53967-17 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	07/13/25 09:42	07/13/25 09:42	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1194 Lims Reference ID: ED53967-18 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:43	07/13/25 09:43	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1196 Lims Reference ID: ED53967-19 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:45	07/13/25 09:45	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1197 Lims Reference ID: ED53967-20 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553967

LIMS Reference ID: ED53967

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: JCB#: 24-57432, Howard B. Mattlin Middle School,
Plainview-Old Bethpage Central School District, 100
Washington Ave, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 06/27/2025 13:27**Reported:** 08/12/2025 08:52**Analytical Results**
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1197 (Continued) Lims Reference ID: ED53967-20 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals (Continued)									
Lead	22.7		1	1.0	µg/L	07/18/25 19:57	07/18/25 19:57	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: POB-1200 Lims Reference ID: ED53967-21 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:46	07/13/25 09:46	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1233 Lims Reference ID: ED53967-26 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:47	07/13/25 09:47	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1234 Lims Reference ID: ED53967-27 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:49	07/13/25 09:49	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1235 Lims Reference ID: ED53967-28 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 09:50	07/13/25 09:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1236 Lims Reference ID: ED53967-29 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 10:03	07/13/25 10:03	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1256 Lims Reference ID: ED53967-31 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	07/13/25 10:07	07/13/25 10:07	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1948 Lims Reference ID: ED53967-35 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	2.6		1	1.0	µg/L	07/13/25 10:08	07/13/25 10:08	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2020 Lims Reference ID: ED53967-40 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553967

LIMS Reference ID: ED53967

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Howard B. Mattlin Middle School,
Plainview-Old Bethpage Central School District, 100
Washington Ave, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/27/2025 13:27

Reported:

08/12/2025 08:52

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-2020 (Continued) Lims Reference ID: ED53967-40 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/13/25 10:09	07/13/25 10:09	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2021 Lims Reference ID: ED53967-41 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 10:11	07/13/25 10:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2022 Lims Reference ID: ED53967-42 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	07/13/25 10:15	07/13/25 10:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2023 Lims Reference ID: ED53967-43 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	7.0		1	1.0	µg/L	07/13/25 10:16	07/13/25 10:16	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2025 Lims Reference ID: ED53967-45 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	10.6		1	1.0	µg/L	07/18/25 19:59	07/18/25 19:59	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: POB-2028 Lims Reference ID: ED53967-48 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	07/13/25 10:17	07/13/25 10:17	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2029 Lims Reference ID: ED53967-49 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	1.8		1	1.0	µg/L	07/13/25 10:18	07/13/25 10:18	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2033 Lims Reference ID: ED53967-53 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	3.7		1	1.0	µg/L	07/13/25 10:20	07/13/25 10:20	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2034 Lims Reference ID: ED53967-54 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553967

LIMS Reference ID: ED53967

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Howard B. Mattlin Middle School,
Plainview-Old Bethpage Central School District, 100
Washington Ave, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/27/2025 13:27

Reported:

08/12/2025 08:52

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-2034 (Continued) Lims Reference ID: ED53967-54 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/13/25 10:21	07/13/25 10:21	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2035 Lims Reference ID: ED53967-55 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 10:25	07/13/25 10:25	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2036 Lims Reference ID: ED53967-56 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 10:26	07/13/25 10:26	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2037 Lims Reference ID: ED53967-57 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 10:30	07/13/25 10:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2038 Lims Reference ID: ED53967-58 Matrix: Drinking Water Sampled: 06/27/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/13/25 10:32	07/13/25 10:32	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553967

LIMS Reference ID: ED53967

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Howard B. Mattlin Middle School,
Plainview-Old Bethpage Central School District, 100
Washington Ave, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/27/2025 13:27

Reported:

08/12/2025 08:52

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062553967**LIMS Reference ID:** ED53967**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 24-57432, Howard B. Mattlin Middle School,
Plainview-Old Bethpage Central School District, 100
Washington Ave, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/27/2025 13:27

Reported:

08/12/2025 08:52


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Old Bethpage Elementary School

OBE

Client:

Plainview-Old Bethpage Central School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

ED54294

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-1279	CR		ROOM 107	DW	6/19/2025	2:48:00 PM
POB-1282	CR		ROOM 106	DW	6/19/2025	2:46:00 PM
POB-1283	NO		NURSE OFFICE	NS	6/19/2025	2:45:00 PM
POB-1286	CR	2001	Room 1	DW	6/19/2025	2:44:00 PM
POB-1333	CR	2044	Room 7	DW	6/19/2025	2:30:00 PM
POB-1335	CR	2043	Room 8	DW	6/19/2025	2:31:00 PM
POB-1338	HA	2046	Corridor Music Room To Room 7	WC	6/19/2025	2:26:00 PM
POB-1339	HA	2046	Corridor Music Room To Room 7	BW	6/19/2025	2:26:00 PM
POB-1343	CR	2038	Room 3	DW	6/19/2025	2:28:00 PM
POB-1345	CR	2037	Room 4	DW	6/19/2025	2:30:00 PM
POB-1350	CA	2026	Cafeteria/Multi Purpose Room	WC	6/19/2025	2:20:00 PM
POB-1351	CA	2026	Cafeteria/Multi Purpose Room	BW	6/19/2025	2:20:00 PM
POB-1352	FL	2029	Faculty Room	KC	6/19/2025	2:20:00 PM
POB-1353	HA	2046	Corridor Music Room To Room 7	DW	6/19/2025	2:36:00 PM
POB-1507	HA	2091	Corridor Exit Vestibule To Room 23	WC	6/19/2025	2:34:00 PM
POB-1508	HA	2091	Corridor Exit Vestibule To Room 23	BW	6/19/2025	2:34:00 PM
POB-1962	KI	2030	Kitchen	KC	6/19/2025	2:22:00 PM
POB-1963	KI	2030	Kitchen	KC	6/19/2025	2:22:00 PM

RECEIVED
ENSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM 03:59

Building Address

1191 Round Swamp Road
Old Bethpage, NY 11804



Analysis Type: ELAP 200.5


Lab Received: 7/16/25 15:54

Signature: [Signature]

Samplers Name: Andrew Schreck

Samplers Signature: [Signature]

JCB Project Manager: George Grove



Lead in Water: Chain of Custody for

ED54294

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-57432
Building: Old Bethpage Elementary School
OBE

Client: Plainview-Old Bethpage Central School District
Retest/New Install ☐
Turn Around: Normal 1-wk Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-1964	KI	2030	Kitchen	HW	6/19/2025	2:23:00 PM

Samples Submitted 19

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM03:59

Building Address

1191 Round Swamp Road
Old Bethpage, NY 11804

Analysis Type: ELAP 200.5

Lab Received: 7/16/25 15:54

Signature: [Signature]

Samplers Name: Andrew Schreck

Samplers Signature: [Signature]

JCB Project Manager: George Gieve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554294

LIMS Reference ID: ED54294

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Old Bethpage Elementary School: Plainview-Old
Bethpage Central School District: 1191 Round
Swamp Road, Old Bethpage, NY 11804: Project#
24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 15:59

Reported:

08/12/2025 09:15

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1279 Lims Reference ID: ED54294-01 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 13:52	07/21/25 13:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1282 Lims Reference ID: ED54294-02 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 13:56	07/21/25 13:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1283 Lims Reference ID: ED54294-03 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 13:57	07/21/25 13:57	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1286 Lims Reference ID: ED54294-04 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	9.0		1	1.0	µg/L	07/21/25 13:59	07/21/25 13:59	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1333 Lims Reference ID: ED54294-05 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:00	07/21/25 14:00	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1335 Lims Reference ID: ED54294-06 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:04	07/21/25 14:04	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1338 Lims Reference ID: ED54294-07 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:05	07/21/25 14:05	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1339 Lims Reference ID: ED54294-08 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:07	07/21/25 14:07	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1343 Lims Reference ID: ED54294-09 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554294

LIMS Reference ID: ED54294

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Old Bethpage Elementary School: Plainview-Old
Bethpage Central School District: 1191 Round
Swamp Road, Old Bethpage, NY 11804: Project#
24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 15:59

Reported:

08/12/2025 09:15

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1343 (Continued) Lims Reference ID: ED54294-09 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals (Continued)									
Lead	2.4		1	1.0	µg/L	07/21/25 14:08	07/21/25 14:08	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1345 Lims Reference ID: ED54294-10 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:09	07/21/25 14:09	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1350 Lims Reference ID: ED54294-11 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:11	07/21/25 14:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1351 Lims Reference ID: ED54294-12 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:15	07/21/25 14:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1352 Lims Reference ID: ED54294-13 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:16	07/21/25 14:16	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1353 Lims Reference ID: ED54294-14 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	61.6		1	1.0	µg/L	07/21/25 14:20	07/21/25 14:20	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1507 Lims Reference ID: ED54294-15 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:21	07/21/25 14:21	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1508 Lims Reference ID: ED54294-16 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 14:23	07/21/25 14:23	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1962 Lims Reference ID: ED54294-17 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554294

LIMS Reference ID: ED54294

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Old Bethpage Elementary School: Plainview-Old
Bethpage Central School District: 1191 Round
Swamp Road, Old Bethpage, NY 11804: Project#
24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 15:59

Reported:

08/12/2025 09:15

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1962 (Continued)									
Lims Reference ID:				ED54294-17		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals (Continued)									
Lead	3.3		1	1.0	µg/L	07/21/25 14:24	07/21/25 14:24	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1963									
Lims Reference ID:				ED54294-18		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	7.7		1	1.0	µg/L	07/21/25 14:25	07/21/25 14:25	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1964									
Lims Reference ID:				ED54294-19		Matrix: Drinking Water		Sampled: 06/19/25 00:00:00	
Metals									
Lead	11.8		1	1.0	µg/L	07/21/25 14:27	07/21/25 14:27	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554294

LIMS Reference ID: ED54294

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Old Bethpage Elementary School: Plainview-Old
Bethpage Central School District: 1191 Round
Swamp Road, Old Bethpage, NY 11804: Project#
24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 15:59

Reported:

08/12/2025 09:15

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554294

LIMS Reference ID: ED54294

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Old Bethpage Elementary School: Plainview-Old
Bethpage Central School District: 1191 Round
Swamp Road, Old Bethpage, NY 11804: Project#
24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 15:59

Reported:

08/12/2025 09:15


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

ED54293

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-57432
Building: Pasadena Elementary School
PAS

Client: Plainview-Old Bethpage Central School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-1398	NO	2008	Nurses Office	NS	6/19/2025	9:55:00 AM
POB-1403	KI	2016	Main Office Kitchen	KC	6/19/2025	9:56:00 AM
POB-1414	KI	2044	Kitchen	HW	6/19/2025	10:00:00 AM
POB-1415	KI	2044	Kitchen	HW	6/19/2025	10:00:00 AM
POB-1420	HA	2049	Corridor Outside Kitchen	WC	6/19/2025	10:06:00 AM
POB-1421	HA	2049	Corridor Outside Kitchen	BW	6/19/2025	10:06:00 AM
POB-1423	CA	2052	All Purpose Room/Cafeteria	WC	6/19/2025	10:01:00 AM
POB-1424	CA	2052	All Purpose Room/Cafeteria	BW	6/19/2025	10:03:00 AM
POB-1441	HA	2120	Corridor Room 9 To 16	DW	6/19/2025	10:07:00 AM
POB-1446	HA	2081	Main Corridor	DW	6/19/2025	10:08:00 AM
POB-1466	HA	2084	Corridor Room 18 To 24	BW	6/19/2025	10:10:00 AM
POB-1470	LI		LIBRARY STORAGE	CF	6/19/2025	10:17:00 AM
POB-1472	FL	2074	Faculty Lounge	KC	6/19/2025	10:15:00 AM
POB-1836	HA	New Construction	New Construction Corridor	WF	6/19/2025	10:16:00 AM
POB-1851	HA	2022	Corridor Main Office To Art Vestibule	WF	6/19/2025	10:16:00 AM
POB-1852	CR	2128	Art Room	WF	6/19/2025	10:22:00 AM
POB-1854	CR	2125	Music Room	WF	6/19/2025	10:22:00 AM
POB-1980	KI	2044	Kitchen	KC	6/19/2025	10:02:00 AM

RECEIVED
10:15:00 AM
FMS ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM 4:40

Building Address

3 Richard Court
Plainview, NY 11803




Analysis Type: ELAP 200.5

Lab Received: 7/14/25 16:00

Signature: Kay W...

Samplers Name: Andrew Schreck
Samplers Signature: Andrew Schreck
JCB Project Manager: George Greve



Lead in Water: Chain of Custody for

EDS 4293

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building:

Pasadena Elementary School

PAS

Client:

Plainview-Old Bethpage Central School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-1981	KI	2044	Kitchen	KC	6/19/2025	10:03:00 AM
POB-1983	CA	2052	All Purpose Room/Cafeteria	WC	6/19/2025	10:04:00 AM

Samples Submitted 20

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM 04:00

Building Address

3 Richard Court

Plainview, NY 11803

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Andrew Schreck

Andrew Schreck

George Greve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554293

LIMS Reference ID: ED54293

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Pasadena Elementary School: Plainview-Old
Bethpage Central School District: 3 Richard Court,
Plainview, NY 11803: Project# 24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:00

Reported:

08/12/2025 09:14

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1398 Lims Reference ID: ED54293-01 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.9		1	1.0	µg/L	07/21/25 09:41	07/21/25 09:41	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1403 Lims Reference ID: ED54293-02 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	07/21/25 09:45	07/21/25 09:45	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1414 Lims Reference ID: ED54293-03 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	4.9		1	1.0	µg/L	07/21/25 09:46	07/21/25 09:46	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1415 Lims Reference ID: ED54293-04 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	2.8		1	1.0	µg/L	07/21/25 09:48	07/21/25 09:48	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1420 Lims Reference ID: ED54293-05 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 09:49	07/21/25 09:49	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1421 Lims Reference ID: ED54293-06 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 09:53	07/21/25 09:53	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1423 Lims Reference ID: ED54293-07 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 09:54	07/21/25 09:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1424 Lims Reference ID: ED54293-08 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 09:56	07/21/25 09:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1441 Lims Reference ID: ED54293-09 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554293

LIMS Reference ID: ED54293

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Pasadena Elementary School: Plainview-Old
Bethpage Central School District: 3 Richard Court,
Plainview, NY 11803: Project# 24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:00

Reported:

08/12/2025 09:14

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1441 (Continued) Lims Reference ID: ED54293-09 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals (Continued)									
Lead	3.1		1	1.0	µg/L	07/21/25 09:57	07/21/25 09:57	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1446 Lims Reference ID: ED54293-10 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 09:58	07/21/25 09:58	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1466 Lims Reference ID: ED54293-11 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 10:00	07/21/25 10:00	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1470 Lims Reference ID: ED54293-12 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	13.1		1	1.0	µg/L	07/21/25 10:04	07/21/25 10:04	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1472 Lims Reference ID: ED54293-13 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	4.2		1	1.0	µg/L	07/21/25 10:05	07/21/25 10:05	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1836 Lims Reference ID: ED54293-14 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 10:09	07/21/25 10:09	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1851 Lims Reference ID: ED54293-15 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 10:10	07/21/25 10:10	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1852 Lims Reference ID: ED54293-16 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 10:12	07/21/25 10:12	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1854 Lims Reference ID: ED54293-17 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554293

LIMS Reference ID: ED54293

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Pasadena Elementary School: Plainview-Old
Bethpage Central School District: 3 Richard Court,
Plainview, NY 11803: Project# 24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:00

Reported:

08/12/2025 09:14

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1854 (Continued)									
Lims Reference ID:				ED54293-17 Matrix: Drinking Water				Sampled: 06/19/25 00:00:00	
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/21/25 10:13	07/21/25 10:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1980									
Lims Reference ID:				ED54293-18 Matrix: Drinking Water				Sampled: 06/19/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 10:14	07/21/25 10:14	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1981									
Lims Reference ID:				ED54293-19 Matrix: Drinking Water				Sampled: 06/19/25 00:00:00	
Metals									
Lead	1.1		1	1.0	µg/L	07/21/25 10:16	07/21/25 10:16	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1983									
Lims Reference ID:				ED54293-20 Matrix: Drinking Water				Sampled: 06/19/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 10:17	07/21/25 10:17	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554293

LIMS Reference ID: ED54293

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Pasadena Elementary School: Plainview-Old
Bethpage Central School District: 3 Richard Court,
Plainview, NY 11803: Project# 24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:00

Reported:

08/12/2025 09:14

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554293

LIMS Reference ID: ED54293

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Pasadena Elementary School: Plainview-Old
Bethpage Central School District: 3 Richard Court,
Plainview, NY 11803: Project# 24-57432

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:00

Reported:

08/12/2025 09:14

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-57432
Building: Jamaica Avenue School
JAS

ED54275

Page 1 of 2

Client: Plainview-Old Bethpage Central School District

Retest/New Install []
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-1492	KI	2089	Kitchen	KC	6/19/2025	10:36:00 AM
POB-1493	KI	2089	Kitchen	KC	6/19/2025	10:37:00 AM
POB-1494	KI	2089	Kitchen	KC	6/19/2025	10:38:00 AM
POB-1495	KI	2089	Kitchen	KC	6/19/2025	10:39:00 AM
POB-1530	CR	2063	Red Room 105	DW	6/19/2025	10:47:00 AM
POB-1539	KI	2061	Kitchen	HW	6/19/2025	10:45:00 AM
POB-1574	KI	2012	Room 113	KC	6/19/2025	11:01:00 AM
POB-1575	KI	2012	Room 113	KC	6/19/2025	11:01:00 AM
POB-1628	CR	3055	Room 204	DW	6/19/2025	11:08:00 AM
POB-1642	CR	3065	Room 201	DW	6/19/2025	11:10:00 AM
POB-1644	CR	3059	Room 202	DW	6/19/2025	11:09:00 AM
POB-1801	CR	3052	Room 205	DW	6/19/2025	11:15:00 AM
POB-2104	OF	2110	Conference Room (Former Principal Office)	BWC	6/19/2025	11:16:00 AM
POB-2105	OF	2110	Conference Room (Former Principal Office)	BWH	6/19/2025	11:34:00 AM
POB-2107	HA	2107	Old Main Office	DW	6/19/2025	10:34:00 AM
POB-2108	KI	2089	Kitchen	IM	6/19/2025	10:35:00 AM
POB-2110	OF	2079	Day Care Main Office	BWC	6/19/2025	11:31:00 AM
POB-2111	OF	2079	Day Care Main Office	BWH	6/19/2025	11:31:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25 PM 04:01

Building Address
85 Jamaica Avenue
Plainview, NY 11803




Analysis Type: ELAP 200.5

Lab Received: DAVID WHARTON 7/16/25 4:01 PM

Signature: *David Wharton*

Samplers Name: Andrew Schreck
Samplers Signature: *Andrew Schreck*
JCB Project Manager: George Greve



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-57432

Building: Jamaica Avenue School

JAS

ED54275

Client:

Plainview-Old Bethpage Central School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
POB-2116	KI	2073A	Blue Room Kitchen	KC	6/19/2025	10:50:00 AM
POB-2118	KI	2073A	Blue Room Kitchen	KC	6/19/2025	10:51:00 AM
POB-2126	KI	2061	Kitchen	KC	6/19/2025	10:44:00 AM
POB-2127	KI	2061	Kitchen	KC	6/19/2025	10:44:00 AM
POB-2136	FL	2040	Faculty Room (Former Health Office)	KC	6/19/2025	11:28:00 AM
POB-2150	CR	2002	Room 103C	BWC	6/19/2025	11:24:00 AM
POB-2151	CR	2002	Room 103C	BWH	6/19/2025	11:23:00 AM
POB-2152	CR	2001	Room 103	CF	6/19/2025	11:22:00 AM
POB-2153	OF	2025	Director Office Inner Room	CF	6/19/2025	11:26:00 AM

Samples Submitted 27

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUL 16 25, PM04:01

Building Address

85 Jamaica Avenue
Plainview, NY 11803

Analysis Type: ELAP 200.5

Lab Recieved: DAVID WHARTON 7/16/25 4:01 PM

Signature: David Wharton

Samplers Name: Andrew Schreck

Samplers Signature: Andrew Schreck

JCB Project Manager: George Greve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554275

LIMS Reference ID: ED54275

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, Jamaica Avenue School JAS, 85 Jamaica
Avenue, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:06

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1492 Lims Reference ID: ED54275-01 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	8.9		1	1.0	µg/L	07/21/25 10:59	07/21/25 10:59	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1493 Lims Reference ID: ED54275-02 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	6.9		1	1.0	µg/L	07/21/25 11:03	07/21/25 11:03	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1494 Lims Reference ID: ED54275-03 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.9		1	1.0	µg/L	07/21/25 11:05	07/21/25 11:05	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1495 Lims Reference ID: ED54275-04 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	5.0		1	1.0	µg/L	07/21/25 11:06	07/21/25 11:06	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1530 Lims Reference ID: ED54275-05 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	07/21/25 11:07	07/21/25 11:07	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1539 Lims Reference ID: ED54275-06 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	38.8		1	1.0	µg/L	07/21/25 11:11	07/21/25 11:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1574 Lims Reference ID: ED54275-07 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	3.9		1	1.0	µg/L	07/21/25 11:13	07/21/25 11:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1575 Lims Reference ID: ED54275-08 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 11:14	07/21/25 11:14	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1628 Lims Reference ID: ED54275-09 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554275

LIMS Reference ID: ED54275

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, Jamaica Avenue School JAS, 85 Jamaica
Avenue, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:06

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-1628 (Continued) Lims Reference ID: ED54275-09 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals (Continued)									
Lead	43.7		1	1.0	µg/L	07/21/25 11:15	07/21/25 11:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1642 Lims Reference ID: ED54275-10 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	33.9		1	1.0	µg/L	07/21/25 11:17	07/21/25 11:17	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1644 Lims Reference ID: ED54275-11 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	14.4		1	1.0	µg/L	07/21/25 11:18	07/21/25 11:18	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-1801 Lims Reference ID: ED54275-12 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	167		5	5.0	µg/L	07/21/25 11:42	07/21/25 11:42	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2104 Lims Reference ID: ED54275-13 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 11:23	07/21/25 11:23	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2105 Lims Reference ID: ED54275-14 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 11:27	07/21/25 11:27	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2107 Lims Reference ID: ED54275-15 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 11:28	07/21/25 11:28	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2108 Lims Reference ID: ED54275-16 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.2		1	1.0	µg/L	07/21/25 11:30	07/21/25 11:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2110 Lims Reference ID: ED54275-17 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554275

LIMS Reference ID: ED54275

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, Jamaica Avenue School JAS, 85 Jamaica
Avenue, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:06

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-2110 (Continued) Lims Reference ID: ED54275-17 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/21/25 11:31	07/21/25 11:31	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2111 Lims Reference ID: ED54275-18 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 11:32	07/21/25 11:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2116 Lims Reference ID: ED54275-19 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	3.9		1	1.0	µg/L	07/21/25 11:34	07/21/25 11:34	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2118 Lims Reference ID: ED54275-20 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	241		5	5.0	µg/L	07/21/25 11:43	07/21/25 11:43	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2126 Lims Reference ID: ED54275-21 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	3.3		1	1.0	µg/L	07/21/25 15:04	07/21/25 15:04	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2127 Lims Reference ID: ED54275-22 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	2.9		1	1.0	µg/L	07/21/25 15:05	07/21/25 15:05	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2136 Lims Reference ID: ED54275-23 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	07/21/25 15:06	07/21/25 15:06	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2150 Lims Reference ID: ED54275-24 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	07/21/25 15:10	07/21/25 15:10	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2151 Lims Reference ID: ED54275-25 Matrix: Drinking Water Sampled: 06/19/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554275

LIMS Reference ID: ED54275

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, Jamaica Avenue School JAS, 85 Jamaica
Avenue, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:06

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: POB-2151 (Continued)									
			Lims Reference ID:	ED54275-25 Matrix: Drinking Water				Sampled: 06/19/25 00:00:00	
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	07/21/25 15:12	07/21/25 15:12	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2152									
			Lims Reference ID:	ED54275-26 Matrix: Drinking Water				Sampled: 06/19/25 00:00:00	
Metals									
Lead	1.0		1	1.0	µg/L	07/21/25 15:13	07/21/25 15:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: POB-2153									
			Lims Reference ID:	ED54275-27 Matrix: Drinking Water				Sampled: 06/19/25 00:00:00	
Metals									
Lead	1.0		1	1.0	µg/L	07/21/25 15:14	07/21/25 15:14	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062554275

LIMS Reference ID: ED54275

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, Jamaica Avenue School JAS, 85 Jamaica
Avenue, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:06

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062554275**LIMS Reference ID:** ED54275**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

24-57432, Plainview-Old Bethpage Central School
District, Jamaica Avenue School JAS, 85 Jamaica
Avenue, Plainview, NY 11803

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

07/16/2025 16:01

Reported:

08/12/2025 09:06

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Attachment 4:

Laboratory Certifications


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

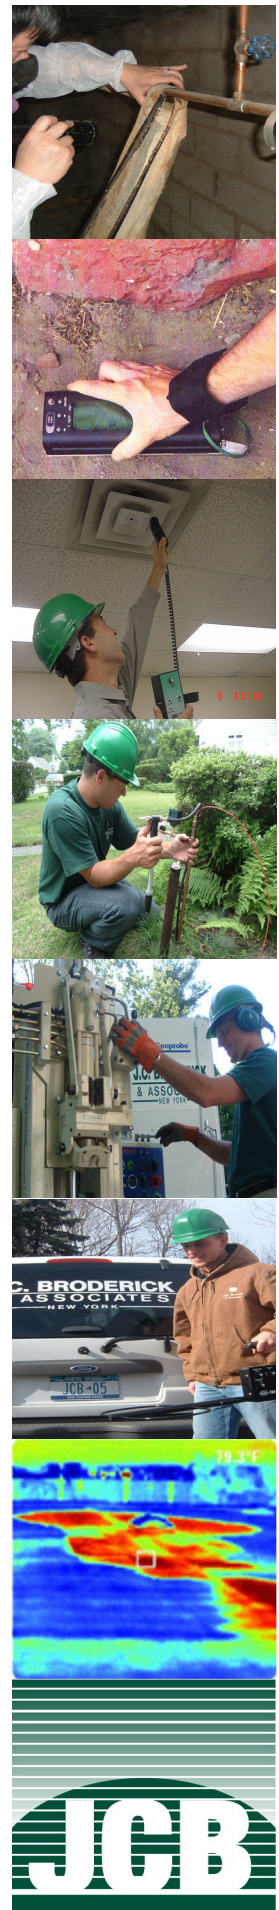

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2026
Issued April 01, 2025

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Heterotrophic Plate Count	SM 20, 21-23 9215B (-04)

Metals I

Copper, Total	EPA 200.8 Rev. 5.4
Lead, Total	EPA 200.8 Rev. 5.4
Silver, Total	EPA 200.8 Rev. 5.4

Miscellaneous

Asbestos	EPA 100.2
----------	-----------



Serial No.: 70480

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at <https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/>, by phone (518) 485-5570 or by email to elap@health.ny.gov.

