

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



September 4, 2024

Mr. Russ Randazzo
Baldwin Union Free School District
Administration Building
960 Hastings Street
Baldwin, New York 11510

Re: **Lead Testing in School Drinking Water
Remedial Action Plan – Update to Initial Report Dated 8/12/2024
2023-2025 Compliance 10 NYCRR Subpart 67-4**

JCB#: **22-53302**

Dear Mr. Randazzo:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 5 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead in Water Remediation Plan
Attachment 2: Outlet Inventory and Lead Testing Results
Attachment 3: Laboratory Analytical Reports
Attachment 4: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.

Sincerely,

A handwritten signature in black ink, appearing to read 'Meghan Gwynn', is positioned above the printed name.

Meghan Gwynn
J C Broderick & Associates, Inc.

Attachment 1:

Lead in Water
Remediation Plan


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

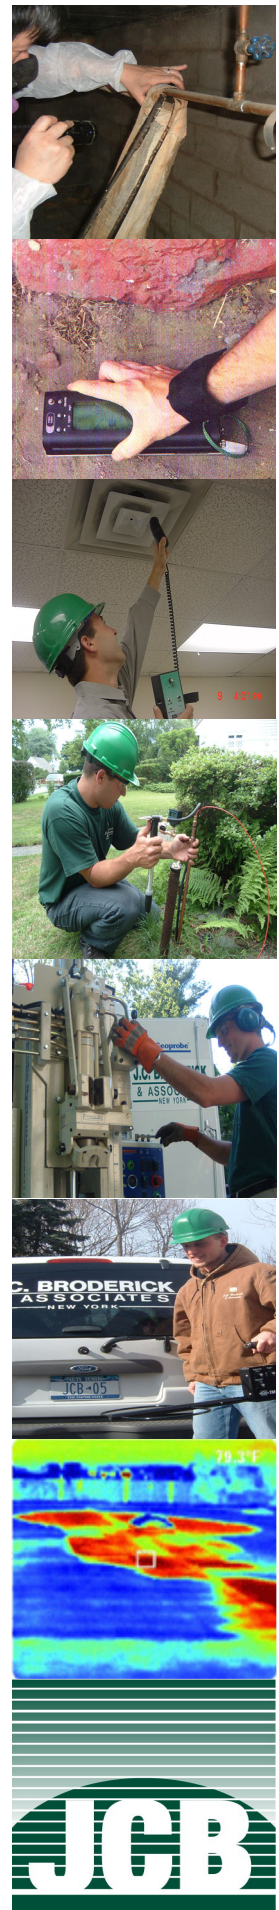

Lead in Water Remediation Plan

Section 67-4.4 Response of the New York State Department of Health (NYS DOH) Title 10 of the Official Compilation of the Codes, Rules and Regulations of the State of New York requires:

If the lead concentration of water at an outlet exceeds the action level, the school shall:

(a) prohibit use of the outlet until:

(1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and

(2) test results indicate that the lead levels are at or below the action level;

As historical sampling results have indicated, the concentrations of lead are more likely attributable to the individual fixtures and/or their immediately adjoining plumbing, and not with the building-wide plumbing. Based upon this information, the following remedial steps are recommended:

Step 1A: Potable Outlets (Outlets intended to be used for drinking/cooking)

Immediately remove the fixture from service. If necessary, provide an adequate supply of potable water for drinking/cooking to this location at no cost to the occupants. If an outlet is seldomly used or is unnecessary, the district may consider permanent removal of the outlet and capping of its supply line.

Step 1B: Non-Potable Outlets (Outlets not intended for drinking/cooking)


See Step 1A OR Placard the outlet for non-drinking use. Signs must be clearly visible and in close proximity to the affected outlet. Example signage is provided at: https://www.health.ny.gov/environmental/water/drinking/lead/docs/donotdrinksigns_lead.pdf.



Do not use for drinking



Hand washing only

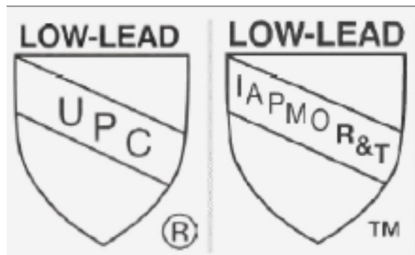

Step 2: Service & Repair or Outlet Replacement

The school district's plumber should evaluate the outlet to determine if any components require service or repair. Depending on the extent of service/repair necessary, age of the fixture, and or overall costs, the district may consider replacing the outlet entirely. Any newly installed components shall be certified lead free. (i.e. NSF/ANSI 61, NSF/ANSI-273). If servicing involves installing/replacing a point-of-use filtration system, this filter shall be certified for its lead reduction capability (i.e. NSF/ANSI 53). Follow all manufacturer's instructions for all component installations. OUTLET RESTRICTIONS MUST REMAIN IN PLACE UNTIL SATISFACTORY TEST RESULTS ARE RECEIVED. See Step 3.

Step 3: Retesting & Return to Service

Schedule a retest of the outlet. Outlet restrictions must remain in place until lead testing results at or below the action level are received. Once satisfactory results are received, the outlet may be returned to normal service. Note: It is recommended that "Do Not Drink" signage remain in place for all non-potable and non-applicable outlet types.

Attachment 2:

Outlet Inventory and
Lead Testing Results


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

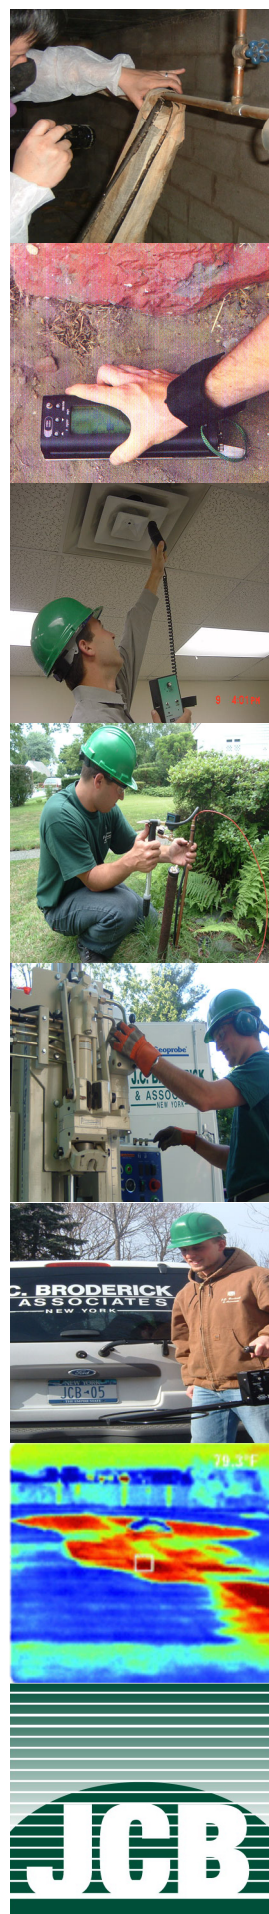



Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53302

Baldwin Union Free School District

Brookside Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0001	Room 207	1000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0002	Corridor O/S Room 208 (1001)	1010	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0003	Corridor O/S Room 208 (1001)	1010	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0005	Room 208	1001	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0006	Room 205	1002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0007	Room 206	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0008	Room 206	1003	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0009	Room 203	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0010	Room 204	1005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0011	Room 204	1005	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0012	Room 201	1006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0013	Room 202	1007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0014	Girls Bathroom	1009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0015	Girls Bathroom	1009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0016	Room 17 Custodial Closet	1014C	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0020	Gymnasium	1017	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service

Brookside Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0022	Gymnasium	1017	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0024	Corridor O/S Room H-4 (1019)	1022	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0025	Corridor O/S Room H-4 (1019)	1022	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0026	Room 12 Primary Learning Center	1020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0027	Room 12 Primary Learning Center	1020	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0028	Principal's Bathroom 2A	1024B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0029	Health Services	1024	Nurse's Office Sink	Potable	6/22/2024	3.6			Result Below Action Level Continue O&M
BALD-0030	Women's Bathroom	1025	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0031	Men's Bathroom	1026	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0032	Faculty Room 7	1027	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0033	Faculty Room Bathroom 7-B	1027A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0034	Faculty Room Bathroom 7-B	1027A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0035	Room 106	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0037	Room 105	1031	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0038	Room 104	1032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0039	Room 104	1032	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0040	Room 103	1033	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0041	Room 102	1034	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0042	Room 102	1034	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0043	Room 101	1035	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Brookside Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0044	Room 101	1035	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0045	Room 100	1036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0046	Room 100	1036	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0047	Room 9 Custodial Closet	1030	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0048	Storage/Vestibule B-3/B-3A	0001	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0049	Exterior of Room 14 (1016)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0050	Exterior of Main Office (1023)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0051	Exterior of Room 13 (1021)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0052	Exterior of Outside Shed Across From Gym (1018)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0968	Girls Bathroom	1009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0969	Faculty Room Bathroom 7B	1027A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0970	Faculty Room Bathroom 7B	1027A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1342	Room 208	1001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1343	Boys Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1344	Boys Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1345	Boys Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1346	Room 11 Kitchen	1019B	Kitchen Faucet (Cold)	Potable	6/22/2024	1.3			Result Below Action Level Continue O&M
BALD-1347	Room 11 Kitchen	1019B	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-1348	Room 11 Kitchen	1019B	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-1349	Room 105	1031	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Lenox Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0053	Cafeteria Custodial Closet 110	1002C	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0054	Cafeteria	1002	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0055	Cafeteria	1002	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0059	Girls Bathroom	1004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0060	Girls Bathroom	1004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0061	Girls Bathroom	1004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0062	Boys Bathroom	1005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0063	Boys Bathroom	1005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0064	Boys Bathroom	1005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0065	Room 104 Bathroom	1008B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0066	Room 103 Bathroom	1007B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0067	Corridor O/S Room 102 (1009)	1015	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0068	Corridor O/S Room 102 (1009)	1015	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0069	Room 102 Bathroom	1009B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0070	Room 101 Bathroom	1010B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0071	Principal's Bathroom	1011A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0072	Main Office Bathroom	1013B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0073	Room 107 Bathroom	1016B1B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0074	Room 107 Bathroom	1016B1B	Water Fountain-No Chiller	RFI	6/22/2024	12.9			Outlet Permanently Removed
BALD-0075	Room 107	1016B1	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Lenox Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0076	Room 19 Bathroom	1018B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0078	Room 19	1018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0079	Custodial Closet 18	1019	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0080	Men's Bathroom	1020	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0081	Women's Bathroom	1021	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0082	Nurse's Office	1022B	Nurse's Office Sink	Non-Applicable	6/22/2024	11.4			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0083	Corridor O/S Gymnasium (1023)	1024	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0084	Corridor O/S Gymnasium (1023)	1024	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0085	Room 207	2015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0086	Room 208	2014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0087	Room 205	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0088	Room 206	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0089	Room 204	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0090	Room 203	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0091	Custodial Closet 37	2008	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0092	Girls Bathroom	2009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0093	Girls Bathroom	2009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0096	Corridor O/S Room 202 (2005)	2017	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0097	Corridor O/S Room 202 (2005)	2017	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0098	Room 202	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Lenox Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0099	Room 201	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0100	Faculty Room Bathroom 35A	2003A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0101	Room 33	2002	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0102	Room 200	2000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0103	Custodial Office Bathroom 4B	0001B2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0104	Boiler Room	0001D1	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0105	Basement Storage 2	0001C	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0107	Exterior of Gymnasium (1023)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0108	Exterior of Room 103 (1007)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0683	Room 19 Bathroom	1018B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0684	Boys Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0685	Boys Bathroom	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0687	Girls Bathroom	2009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1327	Cafeteria	1002	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-1328	Cafeteria	1002	Kitchen Faucet (Cold)	Potable	6/22/2024	3.6			Result Below Action Level Continue O&M
BALD-1329	Cafeteria	1002	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-1330	Classroom 107	1016B1	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-1331	Classroom 107 Bathroom	1016B1B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1332	Room 19	1018	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-1333	Room 19 Bathroom	1018B	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service

Lenox Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1334	Room 36 Boys Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1335	Room 36 Boys Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1336	Room 36 Boys Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1337	Room 36 Boys Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1338	Room 39 Girls Bathroom	2009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1339	Room 35A Faculty Room Bathroom	2003A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1340	Exterior of Gymnasium (1023)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1341	Exterior of Stage (1023A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Meadow Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0110	Room 117	1030	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0111	Room 117	1030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0112	Room 118 Bathroom	1029D	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0114	Room 118	1029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0115	Room 116	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0116	Room 115	1027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0117	Room 114	1026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0118	Corridor O/S Room 114 (1026)	1031	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0119	Corridor O/S Room 114 (1026)	1031	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0120	Room 113	1025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0122	Corridor O/S Room 111 (1023)	1031	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0123	Corridor O/S Room 111 (1023)	1031	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0124	Room 111	1023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0125	Custodial Closet 20	1022	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0126	Women's Bathroom 19	1021	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0127	Custodial Closet	1016	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0128	Room 14	1015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0129	Room 119	1013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0130	Corridor O/S Room 120 (1012)	1014	Water Cooler	Potable	6/22/2024	1.6			Result Below Action Level Continue O&M
BALD-0131	Corridor O/S Room 120 (1012)	1014	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M

Meadow Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0132	Room 120	1012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0133	Room 121	1011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0134	Room 122	1010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0135	Room 123	1009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0136	Room 124	1008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0137	Room 125	1007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0138	Corridor O/S Room 124 (1008)	1014	Water Cooler	Potable	6/22/2024	2.8			Result Below Action Level Continue O&M
BALD-0139	Corridor O/S Room 124 (1008)	1014	Bottle Fill Station	Potable	6/22/2024	1.0			Result Below Action Level Continue O&M
BALD-0140	Room 126	1006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0141	Room 127	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0142	Women's Faculty Bathroom	1003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0143	Room 128 Bathroom	1002A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0144	Corridor O/S Room 130 (1002)	1014	Water Cooler	Potable	6/22/2024	2.7			Result Below Action Level Continue O&M
BALD-0145	Corridor O/S Room 130 (1002)	1014	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0146	Room 130 Bathroom	1002B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0147	Room 131	1000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0148	Room 131	1000	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0149	Room 131	1000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0150	Room 131 Bathroom	1000A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0152	Women's Bathroom	1066	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Meadow Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0153	Women's Bathroom	1066	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0154	Corridor O/S Women's Bathroom (1066)	1068	Water Cooler	Potable	6/22/2024	3.9			Result Below Action Level Continue O&M
BALD-0155	Corridor O/S Women's Bathroom (1066)	1068	Bottle Fill Station	Potable	6/22/2024	1.6			Result Below Action Level Continue O&M
BALD-0156	Men's Bathroom	1067	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0157	Custodial Office	1070	Water Cooler	Potable	6/22/2024	3.8			Result Below Action Level Continue O&M
BALD-0158	Custodial Office	1070	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0159	Custodial Office Bathroom	1070B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0161	Kitchen	1073A	Kitchen Faucet (Cold)	Non-Applicable	6/22/2024	31.7			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0162	Corridor O/S Music Room (1060)	1061	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0163	Corridor O/S Music Room (1060)	1061	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0164	Music Room Bathroom	1060A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0165	OT/PT Room 22	1058	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0167	Principal's Bathroom	1054C1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0168	Nurse's Office	1052	Nurse's Office Sink	Non-Applicable	6/22/2024	5.4			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0169	Room 24A Nurse's Bathroom	1051	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0172	Custodial Closet	1047	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0173	Faculty Room	1048	Kitchen Faucet (Cold)	Potable	6/22/2024	4.3			Result Below Action Level Continue O&M
BALD-0180	Room 28 Bathroom	1045	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0181	Room 102	1044	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0182	Art Room 104	1042	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Meadow Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0183	Room 103	1041	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0184	Room 105	1040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0185	Corridor O/S Room 105 (1040)	1056	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0186	Corridor O/S Room 105 (1040)	1056	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0187	Room 108	1036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0188	Corridor O/S Room 107 (1035)	1056	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0189	Corridor O/S Room 107 (1035)	1056	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0190	Faculty Bathroom	2018	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0191	Custodial Closet	2017	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0192	Corridor O/S Custodial Closet (2017)	2021	Water Cooler	Potable	6/22/2024	1.0			Result Below Action Level Continue O&M
BALD-0193	Corridor O/S Custodial Closet (2017)	2021	Bottle Fill Station	Potable	6/22/2024	2.8			Result Below Action Level Continue O&M
BALD-0195	Room 211	2014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0196	Corridor O/S Room 209 (2012)	2021	Water Cooler	Potable	6/22/2024	1.3			Result Below Action Level Continue O&M
BALD-0197	Corridor O/S Room 209 (2012)	2021	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0198	Room 209	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0199	Room 207	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0200	Room 208	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0201	Room 205	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0202	Room 206	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0203	Girls Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Meadow Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0204	Girls Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0205	Girls Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0206	Girls Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0208	Boys Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0209	Boys Bathroom	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0210	Boys Bathroom	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0211	Boys Bathroom	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0212	Room 203	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0215	Room 204	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0216	Room 201	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0217	Room 202	2000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0221	Exterior of Main Office (1054)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0224	Exterior of Room 118 (1029)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0230	Exterior of Room 126 (1006)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1256	Boys Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1257	Boys Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1258	Boys Bathroom	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1259	Girls Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1260	Girls Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1261	Girls Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Meadow Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1262	Room 41 Psychologist's Office	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1264	Faculty Bathroom	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1265	Room 30 Boys Bathroom	1049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1267	Women's Bathroom	1066	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1272	Room 117 Bathroom	1030B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1305	Exterior of Room 109 (1034)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1306	Exterior of Room 107 (1035)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1455	Room 30 Boys Bathroom	1049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1456	Room 30 Boys Bathroom	1049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1457	Faculty Room Bathroom	1048B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1458	Faculty Room Bathroom	1048B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1459	Room 31 Girls Bathroom	1046	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1460	Room 31 Girls Bathroom	1046	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1461	Girl's Bathroom	2007	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1462	Room 36 Boys Bathroom	2005	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1463	Corridor (Room 201 - Room 214)	2021	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1464	Corridor (Room 201 - Room 214)	2021	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1465	Kitchen	1073A	Kitchen Faucet (Cold)	Potable	6/22/2024	1.1			Result Below Action Level Continue O&M
BALD-1466	Kitchen	1073A	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-1467	Room 112	1024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Meadow Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1468	Room 118	1029	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-1469	Exterior of Custodial Office (1070)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1470	Exterior of Room 106 (1038)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1471	Exterior of Room 105 (1040)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1472	Exterior of Faculty Room (1048)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1473	Exterior of Room 18 (1020)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1474	Exterior of Room 115 (1027)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1475	Exterior of Room 127 (1004)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1476	Exterior of Room 131 (1000)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1477	Exterior of Room 16 (1001)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1478	Exterior of Room 16 (1001)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1479	Exterior of Room 16 (1001)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1480	Exterior of Room 14 (1015)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1481	Exterior of Kitchen Office (1073A1)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1482	Exterior of Boiler Room (1071)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0234	Faculty Men's Bathroom 63D	3020	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0235	Faculty Women's Bathroom 63E	3019	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0236	Corridor O/S Room 639A/639B (3017/3018)	3021	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0237	Corridor O/S Room 639A/639B (3017/3018)	3021	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0238	Room 639B	3018	Kitchen Faucet (Cold)	Potable	6/15/2024	1.8			Result Below Action Level Continue O&M
BALD-0239	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0240	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0241	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0242	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0243	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0244	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0245	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0246	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0247	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0248	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0249	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0250	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0251	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0252	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0253	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0254	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0255	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0256	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0257	Room 639	3014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0258	Room 638	3016	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0259	Room 638	3016	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0260	Room 638	3016	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0261	Room 638	3016	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0262	Room 638	3016	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0263	Room 636	3015	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0264	Room 634	3013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0265	Room 634	3013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0266	Room 634	3013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0267	Room 634	3013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0268	Room 634	3013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0269	Prep Room 637	3012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0270	Prep Room 637	3012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0271	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0272	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0273	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0274	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0275	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0276	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0277	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0278	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0279	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0280	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0281	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0282	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0283	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0284	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0285	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0286	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0287	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0288	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0289	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0290	Room 635	3009	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0291	Men's Bathroom 63C	3011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0292	Men's Bathroom 63C	3011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0293	Men's Bathroom 63C	3011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0294	Men's Bathroom 63C	3011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0295	Men's Bathroom 63C	3011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0296	Men's Bathroom 63C	3011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0297	Men's Bathroom 63C	3011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0298	Women's Bathroom 63A	3010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0299	Women's Bathroom 63A	3010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0300	Women's Bathroom 63A	3010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0301	Women's Bathroom 63A	3010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0302	Women's Bathroom 63A	3010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0303	Women's Bathroom 63A	3010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0304	Women's Bathroom 63A	3010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0305	Custodial Closet 63F	3006	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0306	Room 633B	3007	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0307	Room 632	3005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0308	Room 632	3005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0309	Room 630	3001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0310	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0311	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0312	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0313	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0314	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0315	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0316	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0317	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0318	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0319	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0320	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0321	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0322	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0323	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0324	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0325	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0326	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0327	Room 631	3000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0328	Room 631 Closet	3000A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0329	Corridor O/S Room 631 (3000)	3021	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0330	Corridor O/S Room 631 (3000)	3021	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0331	Office 629A	2014	Kitchen Faucet (Cold)	Potable	6/15/2024	6.0	8/28/2024	<1.0	Outlet Remediated and Returned to Service Continue O&M
BALD-0332	Corridor O/S Office 629A (3021)	2015	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0333	Corridor O/S Office 629A (3021)	2015	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0334	Room 626	2013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0335	Room 626	2013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0336	Room 626	2013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0337	Room 626	2013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0338	Room 626	2013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0339	Room 626A Storage	2013A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0340	Room 624A	2010	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0341	Room 624A	2010	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0342	Room 629	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0343	Room 629	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0344	Room 629	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0345	Room 629	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0346	Room 629	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0347	Room 627A	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0348	Custodial Closet 62D	2009	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0349	Room 624	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0350	Room 624	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0351	Room 624	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0352	Room 624	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0353	Room 624	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0354	Room 627	2007	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0355	Room 627	2007	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0372	Room 625	2004	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0373	Room 625	2004	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0374	Room 625	2004	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0375	Room 623	2003	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0376	Room 623	2003	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0377	Room 623	2003	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0378	Room 623	2003	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0379	Room 623	2003	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0380	Room 620	2001	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0381	Room 620	2001	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0382	Room 620	2001	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0383	Room 620	2001	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0384	Room 620	2001	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0385	Storage Room 620A	2001A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0386	Corridor O/S Room 621 (2000)	2015	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0387	Corridor O/S Room 621 (2000)	2015	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0388	Room 621	2000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0389	Room 621	2000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0390	Room 621	2000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0391	Room 621	2000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0392	Room 621	2000	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0393	Corridor O/S Room 619 (1001)	1023	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0394	Corridor O/S Room 619 (1001)	1023	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0407	Men's Bathroom 61D	1015	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0408	Men's Bathroom 61D	1015	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0409	Women's Bathroom 61E	1016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0410	Women's Bathroom 61E	1016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0411	Women's Bathroom 61E	1016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0412	Women's Bathroom 61E	1016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0413	Custodial Closet 61G	1018	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0415	Kitchen B	1020	Kitchen Non Potable	Non-Applicable	6/15/2024	19.2			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0416	Kitchen B	1020	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-0417	Kitchen B	1020	Ice Machine	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0418	Kitchen B	1020	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0419	Kitchen B	1020	Kitchen Faucet (Cold)	Potable	6/15/2024	3.6			Result Below Action Level Continue O&M
BALD-0420	Kitchen B	1020	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0421	Corridor O/S Kitchen B (1020)	1023	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0422	Corridor O/S Kitchen B (1020)	1023	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0423	Floor Tile Storage	0014	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0424	Basement Corridor Outside Floor Tile Storage	0016	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0425	Cafeteria A	1025	Ice Machine	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0426	Cafeteria A Kitchen	1034	Kitchen Faucet (Cold)	Potable	6/15/2024	11.9	8/28/2024	<1.0	Outlet Remediated and Returned to Service Continue O&M
BALD-0427	Cafeteria A Kitchen	1034	Kitchen Non Potable	Non-Applicable	6/15/2024	100			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0428	Cafeteria A Kitchen	1034	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0429	Cafeteria A Kitchen	1034	Kitchen Non Potable	Non-Applicable	6/15/2024	7.2			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0430	Cafeteria A Kitchen	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-0431	Cafeteria A Kitchen	1034	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-0432	Cafeteria A Kitchen	1034	Kitchen Faucet (Cold)	Potable	6/15/2024	1.5			Result Below Action Level Continue O&M
BALD-0433	Cafeteria A Kitchen	1034	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0434	Cafeteria A Kitchen Custodial Closet	1034F	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0435	Corridor O/S Gym (1028)	1029	Water Cooler	Potable	6/15/2024	2.3			Result Below Action Level Continue O&M
BALD-0436	Corridor O/S Gym (1028)	1029	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0438	Room 914E Weight Room	1026B	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0439	Room 914E Weight Room	1026B	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0440	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0441	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0442	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0443	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0444	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0445	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0446	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0447	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0448	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0449	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0450	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0451	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0452	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0453	Room 922 Girls Locker Room	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0454	Room 922 Girls Locker Room	2016	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0455	Room 922 Girls Locker Room Custodial Closet	2016A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0456	Room 92A Women's Bathroom	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0457	Room 92B Men's Bathroom	2019	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0459	Room 721 Dean of Students Opposite Office	2022B	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0461	Women's Bathroom (Off Main Lobby)	1030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0462	Women's Bathroom (Off Main Lobby)	1030	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0463	Men's Bathroom (Off Main Lobby)	1032	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0464	Men's Bathroom (Off Main Lobby)	1032	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0465	Men's Bathroom (Off Main Lobby)	1032	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0466	Custodial Vestibule Bathroom	1035A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0467	Stage Dressing Room 812C Bathroom	1045A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0468	Basement Locker Room 211E	0003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0469	Stage Dressing Room 812D Bathroom	1045B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0470	Music Room 215	1044C	Water Fountain-No Chiller	RFI	6/15/2024	68.8			Outlet Permanently Removed
BALD-0472	Faculty Women's Bathroom 21C	1043	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0473	Faculty Women's Bathroom 21C	1043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0474	Faculty Women's Bathroom 21C	1043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0475	Custodial Closet 21D	1042	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0476	Men's Bathroom 21E	1041	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0477	Men's Bathroom 21E	1041	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0478	Technology Room 216	1037	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0479	Technology Room 216	1037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0480	Corridor Outside Room 217A&B (1040)	1047	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0481	Corridor Outside Room 217A&B (1040)	1047	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0482	Technology Room 217B	1040C	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0483	Custodial Storage Room 218	1038	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0484	Custodial Storage Room 218	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0485	Carpentry Room 219	1039	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0486	Corridor Outside Room 114D (1050)	1055	Water Cooler	Potable	6/15/2024	2.0			Result Below Action Level Continue O&M

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0487	Corridor Outside Room 114D (1050)	1055	Bottle Fill Station	Potable	6/15/2024	4.0			Result Below Action Level Continue O&M
BALD-0488	File Room 114D Bathroom	1050A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0489	Health Office Room 116	1051	Nurse's Office Sink	Non-Applicable	6/15/2024	6.1			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0490	Health Office Bathroom 116A	1051C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0491	Custodial Closet 11C	1053	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0492	Art Room 113	1056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0493	Art Room 113	1056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0494	Men's Bathroom	1058	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0495	Men's Bathroom	1058	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0496	Men's Bathroom	1058	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0497	Men's Bathroom	1058	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0498	Men's Bathroom Custodial Closet	1058A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0499	Home Economics Room 312	1059	Home Economics Faucet (Cold)	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0500	Home Economics Room 312	1059	Home Economics Faucet (Cold)	Potable	6/15/2024	1.2			Result Below Action Level Continue O&M
BALD-0501	Home Economics Room 312	1059	Home Economics Faucet (Cold)	Potable	6/15/2024	17.0	8/28/2024	5.2	Removed From Service, Pending Remediation
BALD-0502	Home Economics Room 312	1059	Home Economics Faucet (Cold)	Potable	6/15/2024	3.8			Result Below Action Level Continue O&M
BALD-0503	Home Economics Room 312	1059	Home Economics Faucet (Cold)	Potable	6/15/2024	3.1			Result Below Action Level Continue O&M
BALD-0504	Women's Bathroom 31B	1062	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0505	Women's Bathroom 31B	1062	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0506	Women's Bathroom 31B	1062	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0507	Women's Bathroom 31B	1062	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0508	Room 314	1061	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0509	Room 315	1063	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0510	Room 315	1063	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0511	Room 316	1064	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0512	Room 316	1064	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-0513	Men's Bathroom 51D	1071	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0514	Men's Bathroom 51D	1071	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0515	Men's Bathroom 51D	1071	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0516	Men's Bathroom 51D	1071	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0517	Men's Bathroom 51D Custodial Closet	1071A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0518	Corridor Outside Room 514 (1075)	1082	Water Cooler	Potable	6/15/2024	1.4			Result Below Action Level Continue O&M
BALD-0519	Corridor Outside Room 514 (1075)	1082	Bottle Fill Station	Potable	6/15/2024	1.4			Result Below Action Level Continue O&M
BALD-0520	Women's Bathroom	1076	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0521	Women's Bathroom	1076	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0522	Women's Bathroom	1076	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0523	Women's Bathroom	1076	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0526	Corridor Outside Bathroom 11A (1085)	1090	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0527	Corridor Outside Bathroom 11A (1085)	1090	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0528	Women's Faculty Bathroom 11A	1085	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0529	Room 111	1087	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0530	Men's Faculty Bathroom 11B	1086	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0531	Women's Bathroom 41D	1092	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0532	Women's Bathroom 41D	1092	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0533	Women's Bathroom 41D	1092	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0534	Women's Bathroom 41D	1092	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0535	Women's Bathroom 41D	1092	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0536	Women's Bathroom 41D	1092	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0537	Men's Bathroom 41C	1093	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0538	Men's Bathroom 41C	1093	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0539	Men's Bathroom 41C	1093	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0540	Men's Bathroom 41C	1093	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0541	Men's Bathroom 41C	1093	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0542	Men's Bathroom 41C	1093	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0543	Men's Bathroom 41C Custodial Closet	1093A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0544	Room 415 (Interior Walls Removed)	1098	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0546	Art Room 416A	1099	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0547	Art Room 416A	1099	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0548	Art Room 416A	1099	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0549	Art Room 416A	1099	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0550	Art Room 416A	1099	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0551	Art Room 416A	1099	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0552	Art Room 419	1100	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0553	Art Room 419	1100	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0554	Art Room 419	1100	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0555	Art Room 419	1100	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0556	Art Room 419	1100	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0557	Art Room 419	1100	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0558	Art Room 417	1102	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0559	Art Room 417	1102	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0560	Art Room 417	1102	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0561	Art Room 417	1102	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0562	Art Room 417	1102	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0563	Art Room 417	1102	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0564	Faculty Lounge 122	2052B	Kitchen Non Potable	Non-Applicable	6/15/2024	76.1			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0565	Faculty Lounge 122	2052B	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-0566	Men's Bathroom 12A	2052C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0567	Rooms 123 & 124 Vestibule Women's Faculty Bathroom	2037A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0568	Rooms 123 & 124 Vestibule Women's Faculty Bathroom	2037A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0569	Men's Bathroom	2042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0570	Men's Bathroom	2042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0571	Men's Bathroom	2042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0572	Men's Bathroom	2042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0573	Men's Bathroom Custodial Closet	2042A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0574	Corridor Outside Women's Bathroom (2047)	2051	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0575	Corridor Outside Women's Bathroom (2047)	2051	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0576	Women's Bathroom	2047	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0577	Women's Bathroom	2047	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0578	Women's Bathroom	2047	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0579	Women's Bathroom	2047	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0582	Room 33A Women's Bathroom	3034	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0583	Room 33A Women's Bathroom	3034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0584	Room 33A Women's Bathroom	3034	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0585	Room 33A Women's Bathroom	3034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0586	Corridor Outside Room 333 (3035)	3039	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0587	Corridor Outside Room 333 (3035)	3039	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0588	Men's Bathroom 33C	3038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0589	Men's Bathroom 33C	3038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0590	Men's Bathroom 33C	3038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0591	Men's Bathroom 33C	3038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0592	Men's Bathroom 33C Custodial Closet	3038A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0593	Library Room 127A Bathroom	2071C1	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0594	Men's Bathroom 52C	2035	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0595	Men's Bathroom 52C	2035	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0596	Men's Bathroom 52C	2035	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0597	Men's Bathroom 52C	2035	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0598	Men's Bathroom 52C Custodial Closet	2035A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0599	Corridor Outside Room 523 (2030)	2036	Water Cooler	Potable	6/15/2024	1.8			Result Below Action Level Continue O&M
BALD-0600	Corridor Outside Room 523 (2030)	2036	Bottle Fill Station	Potable	6/15/2024	2.9			Result Below Action Level Continue O&M
BALD-0601	Women's Bathroom 52A	2032	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0602	Women's Bathroom 52A	2032	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0603	Women's Bathroom 52A	2032	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0604	Women's Bathroom 52A	2032	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0605	Women's Bathroom	3026	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0606	Women's Bathroom	3026	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0607	Women's Bathroom	3026	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0609	Corridor Outside Women's Bathroom (3026)	3030	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0610	Corridor Outside Women's Bathroom (3026)	3030	Bottle Fill Station	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0611	Men's Bathroom	3029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0612	Men's Bathroom	3029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0613	Men's Bathroom	3029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0614	Men's Bathroom	3029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0615	Men's Bathroom Custodial Closet	3029A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0616	Women's Bathroom 42D	2054	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0617	Women's Bathroom 42D	2054	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0618	Women's Bathroom 42D	2054	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0620	Women's Bathroom 42D	2054	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0621	Women's Bathroom 42D	2054	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0622	Men's Bathroom 42C	2055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0623	Men's Bathroom 42C	2055	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0624	Men's Bathroom 42C	2055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0625	Men's Bathroom 42C	2055	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0626	Men's Bathroom 42C	2055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0627	Men's Bathroom 42C	2055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0629	Corridor Outside Room 42A (2059)	2066	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0630	Corridor Outside Room 42A (2059)	2066	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0631	Athletic Trainer's Office	1116	Nurse's Office Sink	Non-Applicable	6/15/2024	385			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0632	Nurse's Bathroom	1051B2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0633	Boys Locker Room Bathroom	1118A5	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0634	Boys Locker Room Bathroom	1118A5	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0635	Boys Locker Room Bathroom	1118A5	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0638	Boys Coach's Office Bathroom 913H	1118A6B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0639	Wrestling Room Locker Room	2067A	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0640	Wrestling Room Locker Room Bathroom	2067A3	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0641	Wrestling Room Locker Room Bathroom	2067A3	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0642	Wrestling Room Locker Room Bathroom	2067A3	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0643	Wrestling Room Locker Room Bathroom	2067A3	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0644	Wrestling Room Locker Room Custodial Closet	2067A2	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0645	Girls Locker Room	1107	Water Fountain-No Chiller	RFI	6/15/2024	111			Outlet Permanently Removed
BALD-0646	Girls Locker Room	1107	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0647	Girls Locker Room	1107	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0648	Girls Locker Room	1107	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0649	Girls Locker Room	1107	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0650	Girls Locker Room	1107	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0651	Girls Locker Room	1107	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0652	Girls Locker Room Custodial Closet 916D	1107A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0653	Girls Locker Room	1107	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0654	Girls Locker Room	1107	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0655	Boys Locker Room 915B	1110	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0656	Boys Locker Room 915B	1110	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0657	Boys Locker Room 915B	1110	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0658	Boys Locker Room 915B	1110	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0659	Boys Locker Room 915B	1110	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0661	Boys Locker Room Custodial Closet 915C	1110A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0663	Exterior Women's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0664	Exterior Men's Bathroom	N/A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0665	Exterior of (Exterior Men & Women's Bathroom Near	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0666	Concession Stand	N/A	Kitchen Faucet (Cold)	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0667	Exterior of (Exterior Men & Women's Bathroom Near	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0669	Exterior of Room 315 (1063)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0670	Exterior of Room 514 (1075)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0671	Exterior of Guidance Office (105411)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0678	Exterior of Room 610A (1021A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0679	Exterior of Cafeteria A Kitchen Storage Closet (1034C)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1384	Women's Bathroom	3026	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1385	Room 336 Social Studies Office	3033	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-1386	Room 336 Social Studies Office	3033	Bottled Water Dispenser	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1387	Room 42D Women's Bathroom	2054	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1388	Room 42C Men's Bathroom Custodial Closet	2055A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1389	Corridor (Room 417 - Room 110D)	1104	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1390	Corridor (Room 417 - Room 110D)	1104	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1391	Room 416 A	1099	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1392	Room 416 A	1099	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1393	Room 416 A	1099	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1394	Faculty Men's Bathroom 63D	3020	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1395	Faculty Women's Bathroom 63E	3019	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1396	Room 62C Men's Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1397	Room 62C Men's Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1398	Room 62C Men's Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1399	Room 62C Men's Bathroom	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1400	Room 62A Girl's Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1401	Room 62A Girl's Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1402	Room 62A Girl's Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1403	Room 62A Girl's Bathroom	2005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1404	Room 61A Handicapped Men's Bathroom	1010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1405	Room 61A Handicapped Men's Bathroom	1010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1406	Room 61A Handicapped Men's Bathroom	1010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1407	Room 61C Girl's Bathroom	1013	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1408	Room 61C Girl's Bathroom	1013	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1409	Room 61C Girl's Bathroom	1013	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Senior High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1411	Room 610A	1021A	Bottled Water Dispenser	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1412	Bathroom 914D	1026A1A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1413	Nurse Office Room 914B	1026A2	Nurse's Office Sink	Non-Applicable	6/15/2024	114			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-1414	Room 721 Dean of Students Opposite Office	2022B	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-1415	Women's Bathroom (Off Main Lobby)	1030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1416	Boy's Locker Room Bathroom	1118A5	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1417	Boy's Locker Room 913A Custodial Closet	1118A1	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1418	Room 915B Boy's Locker Room	1110	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-1419	Principal Office 114A Bathroom	1050C1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1420	Exterior of Principal's Office 114A (1050C)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1421	Exterior of Auxiliary Gym (1108)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1422	Exterior of Girls Locker Room (1107)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1423	Exterior of Room 61C Women's Bathroom (1013)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1424	Exterior of Room 618 Office (1002A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1425	Exterior of Room 619/617B (1001/1003)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1426	Exterior of Room 615A Back Office (1007A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1427	Exterior of Room 219F (1039E)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1428	Exterior of Stage (1045)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0688	Custodial Office Bathroom	1085A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0689	Boiler Room 145D	1085D	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0690	Technology Room 147	1087	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0691	Technology Room 147	1087	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0692	Technology Room 147	1087	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0693	Room 147 Office 147B	1087B	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0694	Room 147 Office 147B	1087B	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0695	Technology Room 149	1086	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0696	Technology Room 149	1086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0697	Technology Room 149	1086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0698	Technology Room 149	1086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0699	Corridor Outside Custodial Office (1085)	1092	Water Cooler	Potable	6/15/2024	1.1			Result Below Action Level Continue O&M
BALD-0700	Corridor Outside Custodial Office (1085)	1092	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0701	Girls Bathroom	1089	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0702	Custodial Closet JC1	1090	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0703	Boys Bathroom	1091	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0704	Boys Bathroom	1091	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0705	Corridor Outside Boys Bathroom (1091)	1092	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0706	Corridor Outside Boys Bathroom (1091)	1092	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0707	Cafeteria	1088	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0708	Cafeteria	1088	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0709	Cafeteria	1088	Kitchen Non Potable	Non-Applicable	6/15/2024	14.8			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0710	Cafeteria	1088	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0711	Cafeteria	1088	Ice Machine	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0713	Kitchen (New Construction)	1088A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0714	Kitchen (New Construction)	1088A	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-0715	Kitchen (New Construction)	1088A	Pasta Pot/Steam Kettle	RFI	6/15/2024	407			Outlet Permanently Removed
BALD-0716	Kitchen (New Construction)	1088A	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-0717	Kitchen (New Construction)	1088A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-0718	Kitchen Dishwashing Room (New Construction)	1088A1	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-0719	Kitchen Dishwashing Room (New Construction)	1088A1	Kitchen Non Potable	Non-Applicable	6/15/2024	22.0			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0720	Kitchen Dishwashing Room (New Construction)	1088A1	Kitchen Non Potable	Non-Applicable	6/15/2024	7.1			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0721	Kitchen Dishwashing Room (New Construction)	1088A1	Kitchen Non Potable	Non-Applicable	6/15/2024	5.2			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0722	Kitchen Bathroom (New Construction)	1088A4	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0723	Kitchen (New Construction)	1088A	Kitchen Non Potable	Non-Applicable	6/15/2024	8.9			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0724	Kitchen (New Construction)	1088A	Kitchen Non Potable	Non-Applicable	6/15/2024	11.8			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0726	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0727	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0728	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0729	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0730	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0731	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0732	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0733	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0734	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0735	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0736	Corridor Outside Auditorium (1095)	1084	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0737	Corridor Outside Auditorium (1095)	1084	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0738	Room 505	1075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0739	Corridor Outside Band Room (1078)	1080	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0740	Corridor Outside Band Room (1078)	1080	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0741	Men's Bathroom	1082	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0742	Women's Bathroom	1083	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0743	Women's Bathroom	1083	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0746	Boys Locker Room Custodial Closet JC6	1100B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0747	Boys Locker Room	1100	Water Cooler	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0748	Boys Locker Room Bathroom Area	1100C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0749	Boys Locker Room Bathroom Area	1100C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0750	Gymnasium	1098	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0751	Gymnasium	1098	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0752	Gymnasium Vestibule Boys Bathroom (New Construction)	1098E3	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0753	Gymnasium Vestibule Boys Bathroom (New Construction)	1098E3	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0754	Gymnasium Vestibule Boys Bathroom (New Construction)	1098E3	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0755	Gymnasium Vestibule (New Construction)	1098E	Water Cooler	Potable	6/15/2024	1.2			Result Below Action Level Continue O&M
BALD-0756	Gymnasium Vestibule (New Construction)	1098E	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0757	Gymnasium Vestibule Girls Bathroom (New Construction)	1098E2	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0758	Gymnasium Vestibule Girls Bathroom (New Construction)	1098E2	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0759	Gymnasium Vestibule Girls Bathroom (New Construction)	1098E2	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0760	Gymnasium	1098	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0761	Gymnasium	1098	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0762	Girls Locker Room Custodial Closet JC7	1105C	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0763	Girls Locker Room	1105	Water Fountain-No Chiller	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0765	Girls Locker Room	1105	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0767	Girls Locker Room	1105	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0769	Girls Locker Room	1105	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0770	Girls Locker Room Coach's Office	1098B	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0771	Girls Locker Room Coach's Office	1098B	Bottled Water Dispenser	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0772	Girls Coach's Office Bathroom	1098B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0773	Corridor Outside Health Office (1069A)	1070	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0774	Corridor Outside Health Office (1069A)	1070	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0775	Health Services Office Room 113A	1069A	Nurse's Office Sink	Non-Potable	6/15/2024	2.4			Result Below Action Level Continue O&M
BALD-0776	Health Services Office Bathroom	1069A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0777	Corridor Outside Room 118 (1048)	1056	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0778	Corridor Outside Room 118 (1048)	1056	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0779	Corridor Outside Room 123 (1054)	1056	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0780	Corridor Outside Room 123 (1054)	1056	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0781	Girls Bathroom	1061	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0782	Girls Bathroom	1061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0783	Girls Bathroom	1061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0784	Girls Bathroom	1061	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0786	Girls Bathroom	1061	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0788	Room 125	1062	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0793	Library Custodial Closet (JC3)	1067A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0794	Library Bathroom	1067B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0795	Faculty Women's Bathroom	1046	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0796	Faculty Women's Bathroom	1046	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0797	Faculty Men's Bathroom	1043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0798	Faculty Men's Bathroom	1043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0799	Corridor Outside Men's Bathroom (1043)	1070	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0800	Corridor Outside Men's Bathroom (1043)	1070	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0801	Girls Bathroom	1041	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0802	Girls Bathroom	1041	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0803	Girls Bathroom	1041	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0804	Girls Bathroom	1041	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0805	Girls Bathroom	1041	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0806	Girls Bathroom	1041	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0807	Custodial Closet JC2	1040	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0808	Women's Bathroom	1039	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0809	Women's Bathroom	1039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0810	Women's Bathroom	1039	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0811	Women's Bathroom	1039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0812	Women's Bathroom	1039	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0813	Women's Bathroom	1039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0814	Women's Bathroom	1039	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0815	Women's Bathroom	1039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0816	Women's Bathroom	1039	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0817	Women's Bathroom	1039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0818	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0819	Room 142 Stairway	1074	Bottled Water Dispenser	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0820	Main Office Bathroom 112F	1037D2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0821	Corridor Outside Room 105 (1030)	1034	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0822	Corridor Outside Room 105 (1030)	1034	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0823	Corridor Outside Room 111 (1024)	1034	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0824	Corridor Outside Room 111 (1024)	1034	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0825	Bathroom (New Construction)	1003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0826	Custodial Closet (New Construction)	1004	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0827	Corridor Outside Room 163 (1005 - New Construction)	1017	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0828	Corridor Outside Room 163 (1005 - New Construction)	1017	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0832	Girls Bathroom (New Construction)	1009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0834	Girls Bathroom (New Construction)	1009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0835	Room 233 (New Construction)	2031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0836	Room 233 (New Construction)	2031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0837	Room 233 (New Construction)	2031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0838	Room 233 (New Construction)	2031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0839	Room 233 (New Construction)	2031	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0840	Room 235 Office (New Construction)	2030A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0841	Room 235 (New Construction)	2030	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0842	Room 235 (New Construction)	2030	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0843	Room 235 (New Construction)	2030	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0844	Room 235 (New Construction)	2030	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0845	Room 235 (New Construction)	2030	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0846	Custodial Closet JC4 (New Construction)	2028	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0847	Corridor Outside Room 237 (New Construction)	2067	Water Cooler	Potable	6/15/2024	1.3			Result Below Action Level Continue O&M
BALD-0848	Corridor Outside Room 237 (New Construction)	2067	Bottle Fill Station	Potable	6/15/2024	1.4			Result Below Action Level Continue O&M
BALD-0849	Corridor Outside Room 243 (New Construction)	2067	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0850	Corridor Outside Room 243 (New Construction)	2067	Bottle Fill Station	Potable	6/15/2024	OOS			Testing Required Before Return to Service
BALD-0851	Men's Bathroom	2020	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0853	Men's Bathroom	2020	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0854	Men's Bathroom	2020	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0855	Women's Bathroom	2019A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0856	Women's Bathroom	2019A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0857	Custodial Closet (New Construction)	2004	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0858	Room 262 (New Construction)	2002	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0859	Room 262 (New Construction)	2002	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0860	Corridor Outside Room 263 (New Construction)	2004	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0861	Corridor Outside Room 263 (New Construction)	2004	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0862	Bathroom (New Construction)	2003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0866	Girls Bathroom (New Construction)	2008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0869	Room 266 (New Construction)	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0870	Room 266 (New Construction)	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0871	Corridor Outside Room 201 (2064)	2066	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0872	Corridor Outside Room 201 (2064)	2066	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0873	Corridor Outside Room 209 (2055)	2066	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0874	Corridor Outside Room 209 (2055)	2066	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0875	Art Room 209	2055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0876	Art Room 209	2055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0877	Art Room Storage 209B	2055B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0878	Art Room Storage 209B	2055B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0879	Art Room Storage 209B	2055B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0880	Art Room 207	2056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0881	Art Room 207	2056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0882	Art Room 207	2056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0883	Girls Bathroom	2049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0884	Girls Bathroom	2049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0885	Girls Bathroom	2049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0886	Girls Bathroom	2049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0887	Girls Bathroom	2049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0888	Girls Bathroom	2049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0889	Girls Bathroom	2049	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0890	Girls Bathroom	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0891	Girls Bathroom	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0892	Custodial Closet JC5	2050	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0893	Boys Bathroom	2052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0894	Boys Bathroom	2052	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0895	Boys Bathroom	2052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0896	Boys Bathroom	2052	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0898	Boys Bathroom	2052	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0899	Boys Bathroom	2052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0900	Corridor Outside Room 215A (2046)	2054	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0901	Corridor Outside Room 215A (2046)	2054	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0902	Science Room 219	2041	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0903	Science Room 219	2041	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0904	Science Room 219	2041	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0905	Science Room 219	2041	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0906	Science Room 219	2041	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0907	Science Room 219	2041	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0908	Science Room 219A	2039A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0909	Science Room 223	2039	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0910	Science Room 223	2039	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0911	Science Room 223	2039	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0912	Science Room 223	2039	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0913	Corridor Outside Room 219 (2041)	2038	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0914	Corridor Outside Room 219 (2041)	2038	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0915	Room 220 Bathroom	2037A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0916	Science Room 225	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0917	Science Room 225	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0918	Science Room 225	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0919	Science Room 225	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0920	Science Room 225	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0921	Science Room 227	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0922	Science Room 229	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0923	Science Room 229	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0924	Science Room 229	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0925	Science Room 229	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0926	Science Room 229	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0927	Corridor Outside Room 229 (2033)	2038	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0928	Corridor Outside Room 229 (2033)	2038	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0929	Room 231	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0930	Room 232	2023	Kitchen Non Potable	Non-Applicable	6/15/2024	70.0			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0931	Room 232	2023	Kitchen Faucet (Cold)	Potable	6/15/2024	29.8	8/28/2024	2.9	Outlet Remediated and Returned to Service Continue O&M

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0932	Room 232	2023	Kitchen Non Potable	Non-Applicable	6/15/2024	7.5			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0933	Room 232	2023	Kitchen Non Potable	Non-Applicable	6/15/2024	160			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-0934	Home Economics Room 123	1054	Home Economics Faucet (Cold)	Potable	6/15/2024	5.9	8/28/2024	<1.0	Outlet Remediated and Returned to Service Continue O&M
BALD-0935	Home Economics Room 123	1054	Home Economics Faucet (Cold)	Potable	6/15/2024	5.9	8/28/2024	3.1	Outlet Remediated and Returned to Service Continue O&M
BALD-0936	Home Economics Room 123	1054	Home Economics Faucet (Cold)	Potable	6/15/2024	6.3	8/28/2024	1.6	Outlet Remediated and Returned to Service Continue O&M
BALD-0937	Home Economics Room 123	1054	Home Economics Faucet (Cold)	Potable	6/15/2024	5.9	8/28/2024	6.3	Removed From Service, Pending Remediation
BALD-0938	Home Economics Room 121	1051	Home Economics Faucet (Cold)	Potable	6/15/2024	10.3	8/28/2024	7.1	Removed From Service, Pending Remediation
BALD-0939	Home Economics Room 121	1051	Home Economics Faucet (Cold)	Potable	6/15/2024	6.9	8/28/2024	10.0	Removed From Service, Pending Remediation
BALD-0940	Home Economics Room 121	1051	Home Economics Faucet (Cold)	Potable	6/15/2024	5.6	8/28/2024	3.4	Outlet Remediated and Returned to Service Continue O&M
BALD-0941	Home Economics Room 121	1051	Home Economics Faucet (Cold)	Potable	6/15/2024	8.6	8/28/2024	1.6	Outlet Remediated and Returned to Service Continue O&M
BALD-0942	Room 120	1050	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0943	Exterior of Stairwell Adjacent Room 122 (1055)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0944	Exterior of Girls Bathroom (1041)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0945	Room 162 (New Construction)	1002	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0946	Room 162 (New Construction)	1002	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0947	Room 166 (New Construction)	1013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0948	Room 166 (New Construction)	1013	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0949	Corridor Outside Gymnasium (1098)	1101	Water Cooler	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0950	Corridor Outside Gymnasium (1098)	1101	Bottle Fill Station	Potable	6/15/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0951	Gymnasium Boys Coach's Office Bathroom	1098F1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0952	Exterior of Custodial Office Small Office (1085B)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0953	Exterior of Room 508 (1081)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0954	Exterior of Room 508 (1081)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0955	Exterior of Room 501 (1072)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0956	Exterior of School Store (1071)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0957	Exterior of Room 168 (1015)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0958	Exterior of Room 165 (1011)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0959	Exterior of Room 112 Office (1019A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0960	Exterior of Library Professional Library (1067E)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0961	Exterior of Room 123 (1054)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0962	Exterior of Boys Locker Room Team Room (1100A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0963	Exterior of Kitchen (1088A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1487	Cafeteria Kitchen	1088A	Kitchen Service Area	Non-Applicable					Placarded for Non-Drinking Use
BALD-1488	Room 151 Bathroom (Area Reconstructed)	1102	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1489	Boys Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1490	Boys Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1491	Boys Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1492	Boys Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1493	Boys Bathroom	1008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1494	Boys Bathroom	1008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1495	Boys Bathroom	1008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1496	Girls Bathroom	1009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1497	Girls Bathroom	2008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1498	Girls Bathroom	2008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1499	Boys Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1500	Boys Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1501	Boys Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1502	Women's Bathroom	2019A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1503	Boys Bathroom	2052	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Bus Garage

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0964	Bathroom	1002	Water Cooler	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0965	Bathroom	1002	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0966	Garage	1001	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0967	Tool Garage	1000	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1350	Tool Garage	1000	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1351	Office (Now Half A Bathroom)	1004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1352	Bathroom	1002	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1353	Bathroom	1002	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Steele Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-0971	Gym Kitchen 32D	0016E	Kitchen Non Potable	RFI	6/22/2024	60.5			Outlet Permanently Removed
BALD-0972	Gym Kitchen 32D	0016E	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-0973	Room 31C Custodial Closet	0015D	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0976	Vestibule 30 Outside Pump Room	0013	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0977	Vestibule 30 Outside Pump Room	0013	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0978	Corridor Outside Stairwell (1013)	0009	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0980	Boiler Room	0008A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0981	Boiler Room Bathroom	0008A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0984	Custodial Office 8	0008B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0985	Custodial Office 8	0008B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-0991	Room 3D Custodial Closet	0005B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-0996	Corridor Outside Stairwell (1003)	0004	Water Cooler	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-0997	Corridor Outside Stairwell (1003)	0004	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-0998	Room 1B	0001B1	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-0999	Room 1B	0001B1	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1001	Nurse's Office Bathroom	1008B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1002	Custodial Closet	1009	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1003	Corridor Outside Stairwell (1013)	1014	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1005	Room 14	1015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1006	Faculty Room Bathroom 17A	1017A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Steele Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1007	Faculty Room 17	1017	Kitchen Faucet (Cold)	Potable	6/22/2024	3.6			Result Below Action Level Continue O&M
BALD-1008	Library Room 16	1018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1009	Library Room 16	1018	Water Fountain-No Chiller	Potable	6/22/2024	OOS			Testing Required Before Return to Service
BALD-1010	Library Room 16 Bathroom	1018A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1012	Room 24	2014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1013	Men's Bathroom 47A	1013F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1014	Men's Bathroom 47A	1013F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1016	Men's Bathroom 47A	1013F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1017	Men's Bathroom 47A	1013F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1018	Men's Bathroom 47A	1013F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1019	Corridor Outside Men's Bathroom 47A (1013F)	2013	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1021	Custodial Closet 39	2009	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1022	Room 40 Bathroom 40A	2008B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1023	Room 29 Storage Closet	2005A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1025	Women's Bathroom 48A	1003F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1026	Women's Bathroom 48A	1003F	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1027	Women's Bathroom 48A	1003F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1028	Women's Bathroom 48A	1003F	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1029	Women's Bathroom 48A	1003F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1030	Women's Bathroom 48A	1003F	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Steele Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1031	Exterior of Gym Stage (0016A)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1033	Exterior of Multipurpose Room (0005)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1429	Gym Vestibule Men's Bathroom	0015E	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1430	Gym Vestibule Men's Bathroom	0015E	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1431	Gym Vestibule Women's Bathroom 31B	0015A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1432	Gym Vestibule Women's Bathroom 31B	0015A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1433	Room 4A (Interior Wall Removed)	0011A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1434	Corridor (Bottom Of Stairs & Outside Custodial Vestibule)	0009	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1435	Room 9 Boys Lavatory	0008C	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1436	Room 9 Boys Lavatory	0008C	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1437	Room 9 Boys Lavatory	0008C	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1438	Room 2/Room 3	0005	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-1439	Room 2/Room 3	0005	Kitchen Faucet (Cold)	Potable	6/22/2024	2.7			Result Below Action Level Continue O&M
BALD-1440	Room 2/Room 3	0005	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-1441	Room 6 Girls Bathroom	0006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1442	Room 6 Girls Bathroom	0006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1443	Room 6 Girls Bathroom	0006	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1444	Stairwell Landing Adjacent To Room 11	1004	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1445	Stairwell Landing Adjacent To Room 11	1004	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1446	Stairwell Landing Adjacent To Room 14	1014	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M

Steele Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1447	Library Room 16 Bathroom	1018A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1448	Stairwell Upstairs Men's Bathroom	1013F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1449	Stairwell Upstairs Men's Bathroom	1013F	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1450	Stairwell Landing Adjacent Boys Bathroom	2013	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1451	Stairwell Landing Adjacent Girls Bathroom	2003	Water Cooler	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1452	Stairwell Landing Adjacent Girls Bathroom	2003	Bottle Fill Station	Potable	6/22/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1453	Exterior Near Garden (Fenced In)	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1454	Exterior of Gym Kitchen (0016E)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Shubert Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1034	Basement Vestibule	0002	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1035	Boiler Room	0005	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1036	Nurse's Office Bathroom	1000A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1037	Nurse's Office Bathroom	1000A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1038	Corridor Outside Nurse's Office (1000)	1012	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1039	Corridor Outside Nurse's Office (1000)	1012	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1040	Custodial Closet	1002	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1041	Boys Bathroom	1003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1042	Boys Bathroom	1003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1043	Boys Bathroom	1003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1044	Boys Bathroom	1003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1045	Room 109/110	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1046	Room 109/110	1004	Water Fountain-No Chiller	Potable	6/21/2024	4.8			Result Below Action Level Continue O&M
BALD-1047	Faculty Kitchen (Room 111/112)	1007	Kitchen Faucet (Cold)	Potable	6/21/2024	1.5			Result Below Action Level Continue O&M
BALD-1048	Custodial Closet	1008	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1049	Girls Bathroom	1010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1050	Girls Bathroom	1010	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1051	Girls Bathroom	1010	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1052	Vestibule Corridor Outside Stage	1014	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1053	Vestibule Corridor Outside Stage	1014	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M

Shubert Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1054	Room 117B Bathroom	1014B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1055	Room 117B Bathroom	1014B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1056	Room 117A	1014A1	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1057	Principal's Office Bathroom	1015B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1058	Principal's Office Bathroom	1015B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1061	Kindergarten Room 101 Bathroom	1019A1	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1062	Boys Bathroom	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1063	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1064	Boys Bathroom	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1065	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1066	Boys Bathroom	2016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1067	Boys Bathroom	2016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1068	Nurse's Bathroom	2013B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1070	Girls Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1071	Girls Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1072	Girls Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1073	Girls Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1074	Girls Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1075	Girls Bathroom	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1076	Corridor Outside Room 206 (2005)	2008	Water Cooler	Potable	6/21/2024	1.4			Result Below Action Level Continue O&M

Shubert Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1077	Corridor Outside Room 206 (2005)	2008	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1078	Cosmetology Room 208	2002	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-1079	Faculty Men's Bathroom	2001	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1080	Faculty Men's Bathroom	2001	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1081	Faculty Men's Bathroom	2001	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1082	Faculty Men's Bathroom	2001	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1083	Room 209 Storage Custodial	2000A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1084	Custodial Closet	2017	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1085	Corridor Outside Gymnasium (1022)	1025	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1086	Corridor Outside Gymnasium (1022)	1025	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1087	Men's Bathroom	1024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1089	Exterior of Kindergarten Room 101 Closet 2 (1019A3)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1090	Exterior of Room 109/110 (1004)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1091	Exterior of Boys Bathroom (1003)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1097	Vestibule to Cafeteria	1027	Water Fountain-No Chiller	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1098	Cafeteria Large Storage	1027A4	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1254	Cafeteria Girls Bathroom	1027A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1255	Cafeteria Boys Bathroom	1027A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1485	Kindergarten Room 101 Bathroom	1019A1	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1486	Faculty Bathroom	1024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Plaza Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1092	Room 24 Bathroom (Room 27)	0004A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1093	Room 24 Bathroom (Room 27)	0004A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1094	Room 24 Bathroom (Room 27)	0004A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1095	Room 24 Bathroom (Room 27)	0004A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1096	Room 24 Custodial Closet 26	0004B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1099	Exterior of Room 105 (1009)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1100	Room 20 Bathroom (Room 23)	0003B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1101	Room 20 Bathroom (Room 23)	0003B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1102	Room 20 Bathroom (Room 23)	0003B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1103	Room 20 Bathroom (Room 23)	0003B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1104	Room 20 Custodial Closet (Room 22)	0003C	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1106	Corridor Outside Gymnasium (1047)	1053	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1107	Corridor Outside Gymnasium (1047)	1053	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1108	Room 83 Custodial Closet	1050	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1125	Boys Bathroom Custodial Closet	1043A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1126	Room 71 Music Office	1049A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1127	Room 71 Music Office	1049A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1129	Faculty Room	1035A	Kitchen Faucet (Cold)	Potable	6/21/2024	2.2			Result Below Action Level Continue O&M
BALD-1130	Faculty Room	1035A	Bottled Water Dispenser	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1131	Faculty Room	1035A	Bottled Water Dispenser	Potable	6/21/2024	OOS			Testing Required Before Return to Service

Plaza Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1132	Faculty Room Bathroom	1035A1	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1133	Faculty Room Bathroom	1035A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1134	Room 65 Principal Office Bathroom	1032B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1135	Room 65 Principal Office Bathroom	1032B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1136	Room 62A Custodial Closet	1028	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1137	Health Services Bathroom	1027B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1138	Health Services Bathroom	1027B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1139	Cafeteria	1026	Kitchen Non Potable	Non-Applicable	6/21/2024	6.7			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-1141	Custodial Office 57 Bathroom	1021A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1142	Custodial Office 57 Bathroom	1021A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1143	Room 117	1020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1144	Room 117	1020	Water Fountain-No Chiller	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1145	Room 56 Bathroom	1019A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1146	Room 56 Bathroom	1019A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1149	Corridor Outside Rm 108 Vestibule (1024A)	1024	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1150	Corridor Outside Rm 108 Vestibule (1024A)	1024	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1151	Boiler Room	0008	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1152	Girls Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1153	Girls Bathroom	1011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1154	Girls Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Plaza Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1155	Girls Bathroom	1011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1158	Custodial Closet	1009	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1160	Boys Bathroom 49	1007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1162	Boys Bathroom 49	1007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1164	Boys Bathroom 49	1007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1165	Faculty Bathroom	1005	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1166	Faculty Bathroom	1005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1167	Room 112	1006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1168	Room 114	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1169	Room 114	1003	Water Fountain-No Chiller	RFI	6/21/2024	571			Outlet Permanently Removed
BALD-1170	Room 113	1002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1171	Room 113 Front Bathroom	1002A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1172	Room 113 Front Bathroom	1002A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1173	Room 113 Rear Bathroom	1002B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1174	Room 113 Rear Bathroom	1002B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1175	Room 115	1001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1176	Room 113	1002	Water Fountain-No Chiller	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1177	Room 115 Girls Bathroom	1001B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1178	Room 115 Girls Bathroom	1001B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1179	Room 115 Boys Bathroom	1001A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Plaza Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1180	Room 115 Boys Bathroom	1001A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1181	Room 116	1000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1182	Room 216	2000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1183	Room 216	2000	Water Fountain-No Chiller	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1184	Room 215	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1185	Room 86 Educational Services Bathroom	2002C	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1186	Room 86 Educational Services Bathroom	2002C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1187	Room 214	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1188	Room 88 Custodial	2006	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1189	Room 212	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1190	Boys Bathroom	2008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1191	Boys Bathroom	2008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1193	Boys Bathroom	2008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1194	Boys Bathroom	2008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1195	Boys Bathroom	2008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1196	Custodial Closet	2010	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1197	Custodial Closet	2010	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1198	Girls Bathroom	2011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1199	Girls Bathroom	2011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1200	Girls Bathroom	2011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Plaza Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1201	Girls Bathroom	2011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1202	Girls Bathroom	2011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1204	Corridor Outside Room 211 (2014)	2021	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1205	Corridor Outside Room 211 (2014)	2021	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1206	Room 45	2023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1207	Exterior of Room 80 Girls Bathroom (1044)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1208	Exterior of Room 80 Girls Bathroom (1044)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1209	Exterior of Health Services (1027)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1210	Exterior of Room 117 (1020)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1354	Girls Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1355	Girls Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1356	Boys Bathroom 49	1007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1357	Boys Bathroom 49	1007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1358	Boys Bathroom 49	1007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1359	Corridor From Room 112 To Room 116	1008	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1360	Corridor From Room 112 To Room 116	1008	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1361	Corridor (Room 216 - Boys Bath)	2009	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1362	Corridor (Room 216 - Boys Bath)	2009	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1363	Boys Bathroom	2008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1364	Girls Bathroom	2011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Plaza Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1365	Cafeteria	1026	Kitchen Service Area	Non-Applicable					Placarded for Non-Drinking Use
BALD-1366	Cafeteria	1026	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
BALD-1367	Corridor (Room 43 Custodial Closet - Room 55)	1034	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1368	Corridor (Room 43 Custodial Closet - Room 55)	1034	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1369	Corridor (Faculty Room - Room 80 Girls Bath)	1045	Water Cooler	Potable	6/21/2024	3.4			Result Below Action Level Continue O&M
BALD-1370	Corridor (Faculty Room - Room 80 Girls Bath)	1045	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1371	Boys Bathroom	1043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1372	Boys Bathroom	1043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1373	Boys Bathroom	1043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1374	Boys Bathroom	1043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1375	Boys Bathroom	1043	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1376	Room 80 Girls Bathroom	1044	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1377	Room 80 Girls Bathroom	1044	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1378	Room 80 Girls Bathroom	1044	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1379	Room 82 Men's Bathroom	1051	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1380	Room 82 Men's Bathroom	1051	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1381	Room 81 Women's Bathroom	1052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1382	Room 81 Women's Bathroom	1052	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1383	Exterior of Room 55 Office (1025)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Milburn Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1212	Men's Faculty Bathroom 17	1017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1213	Custodial Closet 16	1016	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1214	Room 1 General Purpose Room	1015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1215	Room 3 Staff Women's Bathroom	1008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1216	Room 4 Girls Bathroom	1007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1217	Room 4 Girls Bathroom	1007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1218	Room 11 Clinic Room	1006	Nurse's Office Sink	Non-Applicable	6/18/2024	52.1			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-1219	Principal's Bathroom	1010A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1220	Corridor Outside Boys Bathroom (1004)	1011	Water Fountain-No Chiller	Potable	6/18/2024	4.6			Result Below Action Level Continue O&M
BALD-1221	Room 5 Boys Bathrooom	1004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1222	Room 5 Boys Bathrooom	1004	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1223	Room 10	1005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1224	Room 6	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1225	Room 6	1003	Water Fountain-No Chiller	Potable	6/18/2024	OOS			Testing Required Before Return to Service
BALD-1226	Room 9	1002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1227	Room 9	1002	Water Fountain-No Chiller	Potable	6/18/2024	OOS			Testing Required Before Return to Service
BALD-1228	Room 7	1001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1229	Room 7	1001	Water Fountain-No Chiller	Potable	6/18/2024	OOS			Testing Required Before Return to Service
BALD-1230	Corridor Outside Room 7 (1001)	1011	Water Fountain-No Chiller	Potable	6/18/2024	OOS			Testing Required Before Return to Service
BALD-1231	Room 8	1000	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Milburn Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1232	Girls Restroom 18	1021	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1233	Exterior Bathroom 40	1022B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1234	Room 25	1024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1235	Room 25	1024	Water Fountain-No Chiller	Potable	6/18/2024	OOS			Testing Required Before Return to Service
BALD-1236	Room 19 Custodial	1025	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1237	Room 24	1027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1238	Room 24	1027	Water Fountain-No Chiller	Potable	6/18/2024	OOS			Testing Required Before Return to Service
BALD-1239	Room 24	1027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1240	Room 21	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1241	Room 21	1028	Water Fountain-No Chiller	Potable	6/18/2024	OOS			Testing Required Before Return to Service
BALD-1242	Room 23B	1029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1243	Room 23B	1029	Water Fountain-No Chiller	Potable	6/18/2024	OOS			Testing Required Before Return to Service
BALD-1245	Room 22	1030	Water Fountain-No Chiller	Potable	6/18/2024	OOS			Testing Required Before Return to Service
BALD-1246	Room 22	1030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1247	Classroom 30 (Area Reconstructed)	1033	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1248	Classroom 30 Bathroom (Area Reconstructed)	1034A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1249	Storage Corridor Shower Room	0006A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1250	Boiler Room 32	0004	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1251	Exterior of Gym Exit Vestibule (1019B)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1252	Exterior of Room 1 General Purpose Room (1015)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Milburn Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1253	Exterior of Room 8 (1000)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1484	Room 22	1030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Administration Building

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1273	Room 48 Men's Bathroom	1012	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1274	Room 49 Women's Bathroom	1018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1275	Room H4A	1019	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1276	Room 44 Bathroom	1020	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1277	Corridor Outside Assistant Superintendent (1022)	1028	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1278	Corridor Outside Assistant Superintendent (1022)	1028	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1279	Corridor Outside Room H2B & H2C (1029/1030)	1034	Water Fountain-No Chiller	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1280	Custodial Vestibule Bathroom	1032C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1281	Room 25A PAL Office	1032A	Bottled Water Dispenser	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1282	Room 25A PAL Office	1032A	Bottled Water Dispenser	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1283	Room 22 Bathroom	1024A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1284	Room 4 Conference Room Bathroom 4C	1036C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1285	Boys Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1286	Boys Bathroom	1038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1287	Room H2A Custodial Closet	1039	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1288	Girls Bathroom	1040	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1289	Girls Bathroom	1040	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1290	Teacher Center Bathroom Vestibule 14A	1050A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1291	Room 17 Assistant Business Manager Office 17B	1043A	Kitchen Non Potable	Non-Applicable	6/21/2024	26.0			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-1292	Buildings & Grounds Entrance Vestibule	1045	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Administration Building

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1293	Buildings & Grounds Entrance Vestibule	1045	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1294	Buildings & Grounds Entrance Vestibule	1045	Kitchen Non Potable	Non-Applicable	6/21/2024	21.0			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-1295	Buildings & Grounds Entrance Vestibule	1045	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
BALD-1298	Public Relations Office Room 10A Bathroom	1046A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1299	Board Of Education Vestibule	1047	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1300	Board Of Education Meeting Room 12C	1047B	Coffe Pot	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1301	Custodial Closet H1A	1049	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
BALD-1302	Corridor Outside Custodial Closet H1A (1049)	1053	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1303	Corridor Outside Custodial Closet H1A (1049)	1053	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1304	Exterior of Room 49 Women's Bathroom (1011)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1307	Room 37	1001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1308	Room 36	1000	Kitchen Non Potable	Non-Applicable	6/21/2024	84.1			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-1309	Room 35	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1310	Room 34	1002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1311	Corridor Outside Room 34 (1002)	1010	Water Fountain-No Chiller	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1312	Corridor Outside Room 35 (1003)	1010	Water Fountain-No Chiller	Potable	6/21/2024	OOS			Testing Required Before Return to Service
BALD-1313	Corridor Outside Room 29 (1009)	1010	Water Cooler	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1314	Corridor Outside Room 29 (1009)	1010	Bottle Fill Station	Potable	6/21/2024	<1.00 ND			Result Below Action Level Continue O&M
BALD-1315	Room 29	1009	Kitchen Non Potable	Non-Applicable	6/21/2024	35.2			Further Investigation Determined Outlet Function as Non-Applicable, Placarded for Non-Drinking Use
BALD-1316	Women's Bathroom	1011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Baldwin Administration Building

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
BALD-1317	Women's Bathroom	1011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1318	Women's Bathroom	1011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1319	Men's Bathroom	1012	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1320	Men's Bathroom	1012	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
BALD-1321	Exterior of Room 33 (1004)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1322	Exterior of Room 17C Business Manager Office	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1323	Exterior of Public Relations Office Room 10E (1046B)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1324	Exterior of Teacher Center Office 14E (1050C)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1326	Exterior of Room 36 (1000)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
BALD-1483	Exterior of Room 24 (1022)	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Attachment 3:

Laboratory Analytical Reports

J.C. Broderick & Associates, Inc.


Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Brookside Elementary School

BES

EC54238

Client:

Baldwin Union Free School District

Retest/New Install: ☐

Turn Around: Normal 1 wk / Rush ☐

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0002	Hallway	1010	Corridor O/S Room 208 (1001)	WC	6/22/2024	6:44:00 AM
BALD-0003	Hallway	1010	Corridor O/S Room 208 (1001)	WF	6/22/2024	6:44:00 AM
BALD-0024	Hallway	1022	Corridor O/S Room H-4 (1019)	WC	6/22/2024	6:51:00 AM
BALD-0025	Hallway	1022	Corridor O/S Room H-4 (1019)	WF	6/22/2024	6:51:00 AM
BALD-0029	Nurse Office	1024	Health Services	NS	6/22/2024	6:53:00 AM
BALD-1346	KI	1019B	Room 11 Kitchen	KC	6/22/2024	7:02:00 AM

Samples Submitted 6

RECEIVED
EHS ANALYTICAL, INC.
CARLE PLACE, NY
JUN 25 PM 6:32

Building Address

940 E Stanton Ave
Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:

6/25/24 6:32 pm

Samplers Name:

Samplers Signature:

JCB Project Manager:

Aileen McNamee

Aileen M.

Meghan Gwynn

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454238**LIMS Reference ID:** EC54238**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Brookside Elementary School,
BES, Baldwin Union Free School District, 940 E
Stanton Ave Baldwin , NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:32
Reported: 07/13/2024 14:48

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0002 Lims Reference ID: EC54238-01 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:18	07/06/24 11:18	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0003 Lims Reference ID: EC54238-02 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:19	07/06/24 11:19	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0024 Lims Reference ID: EC54238-03 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:21	07/06/24 11:21	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0025 Lims Reference ID: EC54238-04 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/05/24 11:31	07/05/24 11:31	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0029 Lims Reference ID: EC54238-05 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	3.6		1	1.0	µg/L	07/05/24 11:35	07/05/24 11:35	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1346 Lims Reference ID: EC54238-06 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	1.3		1	1.0	µg/L	07/05/24 11:36	07/05/24 11:36	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454238**LIMS Reference ID:** EC54238**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Brookside Elementary School,
BES, Baldwin Union Free School District, 940 E
Stanton Ave Baldwin , NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:32
Reported: 07/13/2024 14:48

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454238**LIMS Reference ID:** EC54238**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Brookside Elementary School,
BES, Baldwin Union Free School District, 940 E
Stanton Ave Baldwin , NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:32
Reported: 07/13/2024 14:48


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Lenox Elementary School

LES

Client:

Baldwin Union Free School District

Retest/New Install: ☒

Turn Around: Normal 1 wk Rush

EC54245

Walk In

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0054	Cafeteria	1002	Cafeteria	WC	6/22/2024	6:09:00 AM
BALD-0055	Cafeteria	1002	Cafeteria	WF	6/22/2024	6:09:00 AM
BALD-0067	Hallway	1015	Corridor O/S Room 102 (1009)	WC	6/22/2024	6:13:00 AM
BALD-0068	Hallway	1015	Corridor O/S Room 102 (1009)	WF	6/22/2024	6:13:00 AM
BALD-0074	Bathroom	1016B1B	Room 107 Bathroom	DW	6/22/2024	6:17:00 AM
BALD-0082	Nurse Office	1022B	Nurse's Office	NS	6/22/2024	6:21:00 AM
BALD-0083	Hallway	1024	Corridor O/S Gymnasium (1023)	WC	6/22/2024	6:22:00 AM
BALD-0084	Hallway	1024	Corridor O/S Gymnasium (1023)	WF	6/22/2024	6:23:00 AM
BALD-0096	Hallway	2017	Corridor O/S Room 202 (2005)	WC	6/22/2024	6:15:00 AM
BALD-0097	Hallway	2017	Corridor O/S Room 202 (2005)	WF	6/22/2024	6:15:00 AM
BALD-1328	CA	1002	Cafeteria	KC	6/22/2024	6:10:00 AM

Samples Submitted 11

RECEIVED
JUN 25 P 6:33
JCB PROJECT MGR.

Building Address

551 Lenox Road

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received: A. Minnifield

Signature: A. Minnifield
6/25/24 6:33PM

Samplers Name: Aileen McNamara

Samplers Signature: Aileen M.

JCB Project Manager: Meghan Gwynn

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454245
LIMS Reference ID: EC54245
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302, Lenox Elementary School, LES,
Baldwin Union Free School District, 551 Lenox
Road Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:33
Reported: 07/13/2024 14:53

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0054 Lims Reference ID: EC54245-01 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:23	07/01/24 15:23	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0055 Lims Reference ID: EC54245-02 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:27	07/01/24 15:27	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0067 Lims Reference ID: EC54245-03 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:28	07/01/24 15:28	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0068 Lims Reference ID: EC54245-04 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:33	07/01/24 15:33	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0074 Lims Reference ID: EC54245-05 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	12.9		1	1.0	µg/L	07/01/24 15:34	07/01/24 15:34	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0082 Lims Reference ID: EC54245-06 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	11.4		1	1.0	µg/L	07/01/24 15:36	07/01/24 15:36	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0083 Lims Reference ID: EC54245-07 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:37	07/01/24 15:37	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0084 Lims Reference ID: EC54245-08 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:39	07/01/24 15:39	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0096 Lims Reference ID: EC54245-09 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:40	07/01/24 15:40	BP	EPA 200.8 (DA)/EPA 200.8



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062454245
LIMS Reference ID: EC54245
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302, Lenox Elementary School, LES,
Baldwin Union Free School District, 551 Lenox
Road Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:33
Reported: 07/13/2024 14:53

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0097 Lims Reference ID: EC54245-10 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:41	07/01/24 15:41	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1328 Lims Reference ID: EC54245-11 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	3.6		1	1.0	µg/L	07/01/24 15:43	07/01/24 15:43	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454245**LIMS Reference ID:** EC54245**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302, Lenox Elementary School, LES,
Baldwin Union Free School District, 551 Lenox
Road Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:33
Reported: 07/13/2024 14:53

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454245**LIMS Reference ID:** EC54245**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302, Lenox Elementary School, LES,
Baldwin Union Free School District, 551 Lenox
Road Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:33
Reported: 07/13/2024 14:53


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53302
Building: Meadow Elementary School
MES

EC54248

Client: Baldwin Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0118	Hallway	1031	Corridor O/S Room 114 (1026)	WC	6/22/2024	6:47:00 AM
BALD-0119	Hallway	1031	Corridor O/S Room 114 (1026)	WF	6/22/2024	6:48:00 AM
BALD-0122	Hallway	1031	Corridor O/S Room 111 (1023)	WC	6/22/2024	6:50:00 AM
BALD-0123	Hallway	1031	Corridor O/S Room 111 (1023)	WF	6/22/2024	6:50:00 AM
BALD-0130	Hallway	1014	Corridor O/S Room 120 (1012)	WC	6/22/2024	6:52:00 AM
BALD-0131	Hallway	1014	Corridor O/S Room 120 (1012)	WF	6/22/2024	6:52:00 AM
BALD-0138	Hallway	1014	Corridor O/S Room 124 (1008)	WC	6/22/2024	6:54:00 AM
BALD-0139	Hallway	1014	Corridor O/S Room 124 (1008)	WF	6/22/2024	6:54:00 AM
BALD-0144	Hallway	1014	Corridor O/S Room 130 (1002)	WC	6/22/2024	6:56:00 AM
BALD-0145	Hallway	1014	Corridor O/S Room 130 (1002)	WF	6/22/2024	6:56:00 AM
BALD-0154	Hallway	1068	Corridor O/S Women's Bathroom (1066)	WC	6/22/2024	6:43:00 AM
BALD-0155	Hallway	1068	Corridor O/S Women's Bathroom (1066)	WF	6/22/2024	6:43:00 AM
BALD-0157	Office	1070	Custodial Office	WC	6/22/2024	6:42:00 AM
BALD-0161	Kitchen	1073A	Kitchen	KC	6/22/2024	6:45:00 AM
BALD-0162	Hallway	1061	Corridor O/S Music Room (1060)	WC	6/22/2024	7:04:00 AM
BALD-0163	Hallway	1061	Corridor O/S Music Room (1060)	WF	6/22/2024	7:04:00 AM
BALD-0168	Nurse Office	1052	Nurse's Office	NS	6/22/2024	7:06:00 AM
BALD-0173	Faculty Lounge	1048	Faculty Room	KC	6/22/2024	7:06:00 AM

Building Address
880 Jackson Street
Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Recieved:

Signature:

A. Minnifield
[Signature]

Samplers Name: Donelle Balaguer

Samplers Signature:

JCB Project Manager:

[Signature]
Meghan Cuyon



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Meadow Elementary School

MES

EC54248

Client:

Baldwin Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0185	Hallway	1056	Corridor O/S Room 105 (1040)	WC	6/22/2024	7:07:00 AM
BALD-0186	Hallway	1056	Corridor O/S Room 105 (1040)	WF	6/22/2024	7:07:00 AM
BALD-0188	Hallway	1056	Corridor O/S Room 107 (1035)	WC	6/22/2024	7:10:00 AM
BALD-0189	Hallway	1056	Corridor O/S Room 107 (1035)	WF	6/22/2024	7:11:00 AM
BALD-0192	Hallway	2021	Corridor O/S Custodial Closet (2017)	WC	6/22/2024	7:12:00 AM
BALD-0193	Hallway	2021	Corridor O/S Custodial Closet (2017)	WF	6/22/2024	7:12:00 AM
BALD-0196	Hallway	2021	Corridor O/S Room 209 (2012)	WC	6/22/2024	7:14:00 AM
BALD-0197	Hallway	2021	Corridor O/S Room 209 (2012)	WF	6/22/2024	7:14:00 AM
BALD-1463	HA	2021	Corridor (Room 201 - Room 214)	WC	6/22/2024	7:15:00 AM
BALD-1464	HA	2021	Corridor (Room 201 - Room 214)	WF	6/22/2024	7:16:00 AM
BALD-1465	KI	1073A	Kitchen	KC	6/22/2024	6:59:00 AM

Samples Submitted

29

RECEIVED
ANALYTICAL, INC.
ON 25 JUN 25 10 54

Building Address

880 Jackson Street

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:

A. Minnifield
A. Minnifield

Samplers Name:

Danielle Bolandini

Samplers Signature:

[Signature]

JCB Project Manager:

Meghan Guyan

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454248
LIMS Reference ID: EC54248
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Meadow Elementary School, MES,
Baldwin Union Free School District, 880
Jackson Street Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:34
Reported: 07/13/2024 14:54

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0118 Lims Reference ID: EC54248-01 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:08	07/01/24 14:08	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0119 Lims Reference ID: EC54248-02 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:12	07/01/24 14:12	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0122 Lims Reference ID: EC54248-03 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:14	07/01/24 14:14	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0123 Lims Reference ID: EC54248-04 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:18	07/01/24 14:18	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0130 Lims Reference ID: EC54248-05 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	07/01/24 14:20	07/01/24 14:20	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0131 Lims Reference ID: EC54248-06 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:21	07/01/24 14:21	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0138 Lims Reference ID: EC54248-07 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	2.8		1	1.0	µg/L	07/01/24 14:23	07/01/24 14:23	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0139 Lims Reference ID: EC54248-08 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	1.0		1	1.0	µg/L	07/01/24 14:24	07/01/24 14:24	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0144 Lims Reference ID: EC54248-09 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	2.7		1	1.0	µg/L	07/01/24 14:25	07/01/24 14:25	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454248
LIMS Reference ID: EC54248
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Meadow Elementary School, MES,
Baldwin Union Free School District, 880
Jackson Street Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:34
Reported: 07/13/2024 14:54

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0145 Lims Reference ID: EC54248-10 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:27	07/01/24 14:27	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0154 Lims Reference ID: EC54248-11 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	3.9		1	1.0	µg/L	07/01/24 14:28	07/01/24 14:28	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0155 Lims Reference ID: EC54248-12 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	07/01/24 14:36	07/01/24 14:36	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0157 Lims Reference ID: EC54248-13 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	3.8		1	1.0	µg/L	07/01/24 14:37	07/01/24 14:37	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0161 Lims Reference ID: EC54248-14 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	31.7		1	1.0	µg/L	07/01/24 14:38	07/01/24 14:38	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0162 Lims Reference ID: EC54248-15 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:40	07/01/24 14:40	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0163 Lims Reference ID: EC54248-16 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:41	07/01/24 14:41	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0168 Lims Reference ID: EC54248-17 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	5.4		1	1.0	µg/L	07/01/24 14:43	07/01/24 14:43	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0173 Lims Reference ID: EC54248-18 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	4.3		1	1.0	µg/L	07/01/24 14:44	07/01/24 14:44	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454248**LIMS Reference ID:** EC54248**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Meadow Elementary School, MES,
Baldwin Union Free School District, 880
Jackson Street Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:34
Reported: 07/13/2024 14:54

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0185 Lims Reference ID: EC54248-19 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:46	07/01/24 14:46	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0186 Lims Reference ID: EC54248-20 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 14:47	07/01/24 14:47	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0188 Lims Reference ID: EC54248-21 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:50	07/01/24 15:50	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0189 Lims Reference ID: EC54248-22 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:52	07/01/24 15:52	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0192 Lims Reference ID: EC54248-23 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	1.0		1	1.0	µg/L	07/01/24 15:53	07/01/24 15:53	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0193 Lims Reference ID: EC54248-24 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	2.8		1	1.0	µg/L	07/01/24 15:54	07/01/24 15:54	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0196 Lims Reference ID: EC54248-25 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	1.3		1	1.0	µg/L	07/01/24 15:56	07/01/24 15:56	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0197 Lims Reference ID: EC54248-26 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:57	07/01/24 15:57	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1463 Lims Reference ID: EC54248-27 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/01/24 15:59	07/01/24 15:59	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454248**LIMS Reference ID:** EC54248**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Meadow Elementary School, MES,
Baldwin Union Free School District, 880
Jackson Street Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:34
Reported: 07/13/2024 14:54

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: BALD-1464**Lims Reference ID:** EC54248-28 **Matrix:** Drinking Water**Sampled:** 06/22/24 00:00:00**Metals**

Lead	<1.0	1	1.0	µg/L	07/01/24 16:00	07/01/24 16:00	BP	EPA 200.8 (DA)/EPA 200.8
------	------	---	-----	------	----------------	----------------	----	--------------------------

Sample: BALD-1465**Lims Reference ID:** EC54248-29 **Matrix:** Drinking Water**Sampled:** 06/22/24 00:00:00**Metals**

Lead	1.1	1	1.0	µg/L	07/01/24 16:02	07/01/24 16:02	BP	EPA 200.8 (DA)/EPA 200.8
------	-----	---	-----	------	----------------	----------------	----	--------------------------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454248**LIMS Reference ID:** EC54248**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Meadow Elementary School, MES,
Baldwin Union Free School District, 880
Jackson Street Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:34
Reported: 07/13/2024 14:54

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454248**LIMS Reference ID:** EC54248**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Meadow Elementary School, MES,
Baldwin Union Free School District, 880
Jackson Street Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:34
Reported: 07/13/2024 14:54


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building:

Baldwin Senior High School

BSHS

EC54232



Client:

Baldwin Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0236	Hallway	3021	Corridor O/S Room 639A/639B (3017/3018)	WC	6/15/2024	5:40:00 AM
BALD-0237	Hallway	3021	Corridor O/S Room 639A/639B (3017/3018)	WF	6/15/2024	5:40:00 AM
BALD-0238	Office	3018	Room 639B	KC	6/15/2024	5:41:00 AM
BALD-0329	Hallway	3021	Corridor O/S Room 631 (3000)	WC	6/15/2024	5:43:00 AM
BALD-0330	Hallway	3021	Corridor O/S Room 631 (3000)	WF	6/15/2024	5:43:00 AM
BALD-0331	Office	2014	Office 629A	KC	6/15/2024	5:47:00 AM
BALD-0332	Hallway	2015	Corridor O/S Office 629A (3021)	WC	6/15/2024	5:46:00 AM
BALD-0333	Hallway	2015	Corridor O/S Office 629A (3021)	WF	6/15/2024	5:46:00 AM
BALD-0386	Hallway	2015	Corridor O/S Room 621 (2000)	WC	6/15/2024	5:44:00 AM
BALD-0387	Hallway	2015	Corridor O/S Room 621 (2000)	WF	6/15/2024	4:44:00 AM
BALD-0393	Hallway	1023	Corridor O/S Room 619 (1001)	WC	6/15/2024	5:50:00 AM
BALD-0394	Hallway	1023	Corridor O/S Room 619 (1001)	WF	6/15/2024	5:50:00 AM
BALD-0415	Kitchen	1020	Kitchen B	KC	6/15/2024	5:56:00 AM
BALD-0417	Kitchen	1020	Kitchen B	IM	6/15/2024	5:56:00 AM
BALD-0419	Kitchen	1020	Kitchen B	KC	6/15/2024	5:57:00 AM
BALD-0421	Hallway	1023	Corridor O/S Kitchen B (1020)	WC	6/15/2024	5:52:00 AM
BALD-0422	Hallway	1023	Corridor O/S Kitchen B (1020)	WF	6/15/2024	5:52:00 AM
BALD-0425	Cafeteria	1025	Cafeteria A	IM	6/15/2024	5:59:00 AM

RECEIVED
ENSLA ANALYTICAL
LABORATORY, INC.
JUN 17 2024
3:00 PM

Building Address

841 Ethel T. Kloberg

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:


James Han 6/25/24
6/26/24

Samplers Name: Aileen McNamee

Samplers Signature:

JCB Project Manager:

Aileen McNamee
Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Baldwin Senior High School

BSHS

Client:

Baldwin Union Free School District

Retest/New Install ☐

Turn Around: Normal 1-wk Rush

EL54232

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0426	Kitchen	1034	Cafeteria A Kitchen	KC	6/15/2024	6:00:00 AM
BALD-0427	Kitchen	1034	Cafeteria A Kitchen	KC	6/15/2024	6:00:00 AM
BALD-0429	Kitchen	1034	Cafeteria A Kitchen	KC	6/15/2024	6:01:00 AM
BALD-0432	Kitchen	1034	Cafeteria A Kitchen	KC	6/15/2024	6:01:00 AM
BALD-0435	Hallway	1029	Corridor O/S Gym (1028)	WC	6/15/2024	6:16:00 AM
BALD-0436	Hallway	1029	Corridor O/S Gym (1028)	WF	6/15/2024	6:16:00 AM
BALD-0438	Special	1026B	Room 914E Weight Room	WC	6/15/2024	6:20:00 AM
BALD-0439	Special	1026B	Room 914E Weight Room	WF	6/15/2024	6:20:00 AM
BALD-0470	Classroom	1044C	Music Room 215	DW	6/15/2024	6:05:00 AM
BALD-0480	Hallway	1047	Corridor Outside Room 217A&B (1040)	WC	6/15/2024	6:04:00 AM
BALD-0481	Hallway	1047	Corridor Outside Room 217A&B (1040)	WF	6/15/2024	6:04:00 AM
BALD-0486	Hallway	1055	Corridor Outside Room 114D (1050)	WC	6/15/2024	6:30:00 AM
BALD-0487	Hallway	1055	Corridor Outside Room 114D (1050)	WF	6/15/2024	6:31:00 AM
BALD-0489	Nurse Office	1051	Health Office Room 116	NS	6/15/2024	6:31:00 AM
BALD-0499	Home Economics	1059	Home Economics Room 312	EC	6/15/2024	6:34:00 AM
BALD-0500	Home Economics	1059	Home Economics Room 312	EC	6/15/2024	6:34:00 AM
BALD-0501	Home Economics	1059	Home Economics Room 312	EC	6/15/2024	6:35:00 AM
BALD-0502	Home Economics	1059	Home Economics Room 312	EC	6/15/2024	6:35:00 AM

Building Address

841 Ethel T. Kloberg
Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Aileen McNamee

Aileen McNamee

Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building:

Baldwin Senior High School

BSHS

Client:

Baldwin Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

EC54232

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0503	Home Economics	1059	Home Economics Room 312	EC	6/15/2024	6:36:00 AM
BALD-0518	Hallway	1082	Corridor Outside Room 514 (1075)	WC	6/15/2024	7:00:00 AM
BALD-0519	Hallway	1082	Corridor Outside Room 514 (1075)	WF	6/15/2024	7:00:00 AM
BALD-0526	Hallway	1090	Corridor Outside Bathroom 11A (1085)	WC	6/15/2024	6:40:00 AM
BALD-0527	Hallway	1090	Corridor Outside Bathroom 11A (1085)	WF	6/15/2024	6:40:00 AM
BALD-0564	Faculty Lounge	2052B	Faculty Lounge 122	KC	6/15/2024	6:53:00 AM
BALD-0574	Hallway	2051	Corridor Outside Women's Bathroom (2047)	WC	6/15/2024	6:38:00 AM
BALD-0575	Hallway	2051	Corridor Outside Women's Bathroom (2047)	WF	6/15/2024	6:38:00 AM
BALD-0586	Hallway	3039	Corridor Outside Room 333 (3035)	WC	6/15/2024	6:40:00 AM
BALD-0587	Hallway	3039	Corridor Outside Room 333 (3035)	WF	6/15/2024	6:40:00 AM
BALD-0599	Hallway	2036	Corridor Outside Room 523 (2030)	WC	6/15/2024	6:56:00 AM
BALD-0600	Hallway	2036	Corridor Outside Room 523 (2030)	WF	6/15/2024	6:56:00 AM
BALD-0629	Hallway	2066	Corridor Outside Room 42A (2059)	WC	6/15/2024	6:51:00 AM
BALD-0630	Hallway	2066	Corridor Outside Room 42A (2059)	WF	6/15/2024	6:52:00 AM
BALD-0631	Office	1116	Athletic Trainer's Office	NS	6/15/2024	6:28:00 AM
BALD-0645	Locker Room	1107	Girls Locker Room	DW	6/15/2024	6:21:00 AM
BALD-1386	OF	3033	Room 336 Social Studies Office	BW	6/15/2024	6:39:00 AM
BALD-1389	HA	1104	Corridor (Room 417 - Room 110D)	WC	6/15/2024	6:48:00 AM

Building Address

841 Ethel T. Kloberg
Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Aileen McNamee

Samplers Signature:

JCB Project Manager:

Meghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building:

Baldwin Senior High School

BSHS

Client:

Baldwin Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-1390	HA	1104	Corridor (Room 417 - Room 110D)	WF	6/15/2024	6:48:00 AM
BALD-1411	OF	1021A	Room 610A	BW	6/15/2024	5:53:00 AM
BALD-1413	NO	1026A2	Nurse Office Room 914B	NS	6/15/2024	6:17:00 AM

Samples Submitted 57

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 JUN 25 P 6:36

Building Address

841 Ethel T. Kloberg

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

James H. Greshy
6/15/24
6:36pm

Aileen McNamee

Aileen McNamee

Meaghan Gwynn

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232**LIMS Reference ID:** EC54232**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302 - Baldwin Senior High School BSBS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:36
Reported: 07/13/2024 13:49

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0236 Lims Reference ID: EC54232-01 Matrix: Drinking Water Sampled: 06/15/24 05:40:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 14:53	07/06/24 14:53	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0237 Lims Reference ID: EC54232-02 Matrix: Drinking Water Sampled: 06/15/24 05:40:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 14:57	07/06/24 14:57	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0238 Lims Reference ID: EC54232-03 Matrix: Drinking Water Sampled: 06/15/24 05:41:00									
Metals									
Lead	1.8		1	1.0	µg/L	07/06/24 14:58	07/06/24 14:58	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0329 Lims Reference ID: EC54232-04 Matrix: Drinking Water Sampled: 06/15/24 05:43:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:00	07/06/24 15:00	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0330 Lims Reference ID: EC54232-05 Matrix: Drinking Water Sampled: 06/15/24 05:43:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:01	07/06/24 15:01	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0331 Lims Reference ID: EC54232-06 Matrix: Drinking Water Sampled: 06/15/24 05:47:00									
Metals									
Lead	6.0		1	1.0	µg/L	07/06/24 15:05	07/06/24 15:05	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0332 Lims Reference ID: EC54232-07 Matrix: Drinking Water Sampled: 06/15/24 05:46:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:06	07/06/24 15:06	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0333 Lims Reference ID: EC54232-08 Matrix: Drinking Water Sampled: 06/15/24 05:46:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:08	07/06/24 15:08	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0386 Lims Reference ID: EC54232-09 Matrix: Drinking Water Sampled: 06/15/24 05:44:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:09	07/06/24 15:09	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232
LIMS Reference ID: EC54232
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302 - Baldwin Senior High School BSBS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:36
Reported: 07/13/2024 13:49

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0387 Lims Reference ID: EC54232-10 Matrix: Drinking Water Sampled: 06/15/24 05:44:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:10	07/06/24 15:10	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0393 Lims Reference ID: EC54232-11 Matrix: Drinking Water Sampled: 06/15/24 05:50:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:12	07/06/24 15:12	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0394 Lims Reference ID: EC54232-12 Matrix: Drinking Water Sampled: 06/15/24 05:50:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:16	07/06/24 15:16	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0415 Lims Reference ID: EC54232-13 Matrix: Drinking Water Sampled: 06/15/24 05:56:00									
Metals									
Lead	19.2		1	1.0	µg/L	07/06/24 15:17	07/06/24 15:17	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0417 Lims Reference ID: EC54232-14 Matrix: Drinking Water Sampled: 06/15/24 05:56:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:21	07/06/24 15:21	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0419 Lims Reference ID: EC54232-15 Matrix: Drinking Water Sampled: 06/15/24 05:57:00									
Metals									
Lead	3.6		1	1.0	µg/L	07/06/24 15:22	07/06/24 15:22	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0421 Lims Reference ID: EC54232-16 Matrix: Drinking Water Sampled: 06/15/24 05:52:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:23	07/06/24 15:23	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0422 Lims Reference ID: EC54232-17 Matrix: Drinking Water Sampled: 06/15/24 05:52:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:25	07/06/24 15:25	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0425 Lims Reference ID: EC54232-18 Matrix: Drinking Water Sampled: 06/15/24 05:59:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:26	07/06/24 15:26	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232
LIMS Reference ID: EC54232
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302 - Baldwin Senior High School BSHS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:36
Reported: 07/13/2024 13:49

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0426 Lims Reference ID: EC54232-19 Matrix: Drinking Water Sampled: 06/15/24 06:00:00									
Metals									
Lead	11.9		1	1.0	µg/L	07/06/24 15:27	07/06/24 15:27	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0427 Lims Reference ID: EC54232-20 Matrix: Drinking Water Sampled: 06/15/24 06:00:00									
Metals									
Lead	100		10	10.0	µg/L	07/06/24 15:35	07/06/24 15:35	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0429 Lims Reference ID: EC54232-21 Matrix: Drinking Water Sampled: 06/15/24 06:01:00									
Metals									
Lead	7.2		1	1.0	µg/L	07/06/24 15:47	07/06/24 15:47	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0432 Lims Reference ID: EC54232-22 Matrix: Drinking Water Sampled: 06/15/24 06:01:00									
Metals									
Lead	1.5		1	1.0	µg/L	07/06/24 15:51	07/06/24 15:51	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0435 Lims Reference ID: EC54232-23 Matrix: Drinking Water Sampled: 06/15/24 06:16:00									
Metals									
Lead	2.3		1	1.0	µg/L	07/06/24 15:52	07/06/24 15:52	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0436 Lims Reference ID: EC54232-24 Matrix: Drinking Water Sampled: 06/15/24 06:16:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:53	07/06/24 15:53	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0438 Lims Reference ID: EC54232-25 Matrix: Drinking Water Sampled: 06/15/24 06:20:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:54	07/06/24 15:54	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0439 Lims Reference ID: EC54232-26 Matrix: Drinking Water Sampled: 06/15/24 06:20:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 15:58	07/06/24 15:58	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0470 Lims Reference ID: EC54232-27 Matrix: Drinking Water Sampled: 06/15/24 06:05:00									
Metals									
Lead	68.8		1	1.0	µg/L	07/06/24 16:00	07/06/24 16:00	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232
LIMS Reference ID: EC54232
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302 - Baldwin Senior High School BSBS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:36
Reported: 07/13/2024 13:49

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0480 Lims Reference ID: EC54232-28 Matrix: Drinking Water Sampled: 06/15/24 06:04:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 16:01	07/06/24 16:01	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0481 Lims Reference ID: EC54232-29 Matrix: Drinking Water Sampled: 06/15/24 06:04:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 16:02	07/06/24 16:02	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0486 Lims Reference ID: EC54232-30 Matrix: Drinking Water Sampled: 06/15/24 06:30:00									
Metals									
Lead	2.0		1	1.0	µg/L	07/06/24 16:04	07/06/24 16:04	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0487 Lims Reference ID: EC54232-31 Matrix: Drinking Water Sampled: 06/15/24 06:31:00									
Metals									
Lead	4.0		1	1.0	µg/L	07/06/24 16:05	07/06/24 16:05	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0489 Lims Reference ID: EC54232-32 Matrix: Drinking Water Sampled: 06/15/24 06:31:00									
Metals									
Lead	6.1		1	1.0	µg/L	07/06/24 16:09	07/06/24 16:09	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0499 Lims Reference ID: EC54232-33 Matrix: Drinking Water Sampled: 06/15/24 06:34:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 16:10	07/06/24 16:10	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0500 Lims Reference ID: EC54232-34 Matrix: Drinking Water Sampled: 06/15/24 06:34:00									
Metals									
Lead	1.2		1	1.0	µg/L	07/06/24 16:14	07/06/24 16:14	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0501 Lims Reference ID: EC54232-35 Matrix: Drinking Water Sampled: 06/15/24 06:35:00									
Metals									
Lead	17.0		5	5.0	µg/L	07/06/24 16:25	07/06/24 16:25	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0502 Lims Reference ID: EC54232-36 Matrix: Drinking Water Sampled: 06/15/24 06:35:00									
Metals									
Lead	3.8		1	1.0	µg/L	07/06/24 16:18	07/06/24 16:18	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232
LIMS Reference ID: EC54232
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302 - Baldwin Senior High School BSBS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:36
Reported: 07/13/2024 13:49

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0503 Lims Reference ID: EC54232-37 Matrix: Drinking Water Sampled: 06/15/24 06:36:00									
Metals									
Lead	3.1		1	1.0	µg/L	07/06/24 16:20	07/06/24 16:20	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0518 Lims Reference ID: EC54232-38 Matrix: Drinking Water Sampled: 06/15/24 07:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	07/06/24 16:21	07/06/24 16:21	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0519 Lims Reference ID: EC54232-39 Matrix: Drinking Water Sampled: 06/15/24 07:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	07/06/24 16:22	07/06/24 16:22	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0526 Lims Reference ID: EC54232-40 Matrix: Drinking Water Sampled: 06/15/24 06:40:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 16:24	07/06/24 16:24	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0527 Lims Reference ID: EC54232-41 Matrix: Drinking Water Sampled: 06/15/24 06:40:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 10:45	07/06/24 10:45	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0564 Lims Reference ID: EC54232-42 Matrix: Drinking Water Sampled: 06/15/24 06:53:00									
Metals									
Lead	76.1		1	1.0	µg/L	07/06/24 10:49	07/06/24 10:49	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0574 Lims Reference ID: EC54232-43 Matrix: Drinking Water Sampled: 06/15/24 06:38:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 10:50	07/06/24 10:50	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0575 Lims Reference ID: EC54232-44 Matrix: Drinking Water Sampled: 06/15/24 06:38:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 10:52	07/06/24 10:52	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0586 Lims Reference ID: EC54232-45 Matrix: Drinking Water Sampled: 06/15/24 06:40:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 10:53	07/06/24 10:53	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232**LIMS Reference ID:** EC54232**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302 - Baldwin Senior High School BSHS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:36
Reported: 07/13/2024 13:49

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0587 Lims Reference ID: EC54232-46 Matrix: Drinking Water Sampled: 06/15/24 06:40:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 10:57	07/06/24 10:57	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0599 Lims Reference ID: EC54232-47 Matrix: Drinking Water Sampled: 06/15/24 06:56:00									
Metals									
Lead	1.8		1	1.0	µg/L	07/06/24 10:58	07/06/24 10:58	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0600 Lims Reference ID: EC54232-48 Matrix: Drinking Water Sampled: 06/15/24 06:56:00									
Metals									
Lead	2.9		1	1.0	µg/L	07/06/24 10:59	07/06/24 10:59	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0629 Lims Reference ID: EC54232-49 Matrix: Drinking Water Sampled: 06/15/24 06:51:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:01	07/06/24 11:01	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0630 Lims Reference ID: EC54232-50 Matrix: Drinking Water Sampled: 06/15/24 06:52:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:02	07/06/24 11:02	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0631 Lims Reference ID: EC54232-51 Matrix: Drinking Water Sampled: 06/15/24 06:28:00									
Metals									
Lead	385		10	10.0	µg/L	07/06/24 11:30	07/06/24 11:30	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0645 Lims Reference ID: EC54232-52 Matrix: Drinking Water Sampled: 06/15/24 06:21:00									
Metals									
Lead	111		10	10.0	µg/L	07/11/24 15:12	07/11/24 15:12	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1386 Lims Reference ID: EC54232-53 Matrix: Drinking Water Sampled: 06/15/24 06:39:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:09	07/06/24 11:09	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1389 Lims Reference ID: EC54232-54 Matrix: Drinking Water Sampled: 06/15/24 06:48:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:13	07/06/24 11:13	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232**LIMS Reference ID:** EC54232**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302 - Baldwin Senior High School BSHS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:36
Reported: 07/13/2024 13:49

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-1390 Lims Reference ID: EC54232-55 Matrix: Drinking Water Sampled: 06/15/24 06:48:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:14	07/06/24 11:14	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1411 Lims Reference ID: EC54232-56 Matrix: Drinking Water Sampled: 06/15/24 05:53:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:15	07/06/24 11:15	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1413 Lims Reference ID: EC54232-57 Matrix: Drinking Water Sampled: 06/15/24 06:17:00									
Metals									
Lead	114		10	10.0	µg/L	07/06/24 11:34	07/06/24 11:34	JH	EPA 200.8 (DA)/EPA 200.8



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232

LIMS Reference ID: EC54232

EMSL Customer ID: JCBR50

Attention: Meghan Gwynn

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name:

22-53302 - Baldwin Senior High School BSHS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510

Customer PO:

Jeromy Bish

EMSL Sales Rep:

Received:

06/25/2024 18:36

Reported:

07/13/2024 13:49

Work Order Case Narrative

Elevated analyte greater than 4x spike amount; MS/MSD not evaluated

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232**LIMS Reference ID:** EC54232**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302 - Baldwin Senior High School BSHS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:36
Reported: 07/13/2024 13:49

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454232**LIMS Reference ID:** EC54232**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: 22-53302 - Baldwin Senior High School BSHS -
Baldwin Union Free School District - 841 Ethel
T. Kloborg Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:36
Reported: 07/13/2024 13:49


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building:

Baldwin Senior High School

BSHS

EC55807

Client:

Baldwin Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush 48 hours

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0331	Office	2014	Office 629A	KC	8/28/2024	6:50 am
BALD-0426	Kitchen	1034	Cafeteria A Kitchen	KC	8/28/2024	6:53 am
BALD-0501	Home Economics	1059	Home Economics Room 312	EC	8/28/2024	7:00 am

Samples Submitted 3

Pb 200.8
Below 8/28/24

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 28 2024 AM08:28

Building Address

841 Ethel T. Kloberg

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Danielk Bulginski

Samplers Signature: [Signature]

JCB Project Manager: Stephen Ferguson

Walk In

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455807**LIMS Reference ID:** EC55807**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Baldwin Senior High School,
Baldwin Union Free School District, 841 Ethel
T. Kloberg, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 08/28/2024 08:28
Reported: 08/30/2024 09:15

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0331 Lims Reference ID: EC55807-01 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	08/28/24 17:52	08/28/24 17:52	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0426 Lims Reference ID: EC55807-02 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	08/28/24 17:53	08/28/24 17:53	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0501 Lims Reference ID: EC55807-03 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	5.2		1	1.0	µg/L	08/28/24 17:57	08/28/24 17:57	BA	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455807**LIMS Reference ID:** EC55807**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Baldwin Senior High School,
Baldwin Union Free School District, 841 Ethel
T. Kloborg, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 08/28/2024 08:28
Reported: 08/30/2024 09:15

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455807**LIMS Reference ID:** EC55807**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Baldwin Senior High School,
Baldwin Union Free School District, 841 Ethel
T. Kloborg, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 08/28/2024 08:28
Reported: 08/30/2024 09:15


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Baldwin Middle School

BMS

EC54230

Client:

Baldwin Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0699	Hallway	1092	Corridor Outside Custodial Office (1085)	WC	6/15/2024	6:00:00 AM
BALD-0700	Hallway	1092	Corridor Outside Custodial Office (1085)	WF	6/15/2024	6:00:00 AM
BALD-0705	Hallway	1092	Corridor Outside Boys Bathroom (1091)	WC	6/15/2024	6:03:00 AM
BALD-0706	Hallway	1092	Corridor Outside Boys Bathroom (1091)	WF	6/15/2024	6:03:00 AM
BALD-0709	Cafeteria	1088	Cafeteria	KC	6/15/2024	6:06:00 AM
BALD-0711	Cafeteria	1088	Cafeteria	IM	6/15/2024	6:08:00 AM
BALD-0715	Kitchen	1088A	Kitchen (New Construction)	PK	6/15/2024	6:12:00 AM
BALD-0719	Kitchen	1088A1	Kitchen Dishwashing Room (New Construction)	KC	6/15/2024	6:17:00 AM
BALD-0720	Kitchen	1088A1	Kitchen Dishwashing Room (New Construction)	KC	6/15/2024	6:17:00 AM
BALD-0721	Kitchen	1088A1	Kitchen Dishwashing Room (New Construction)	KC	6/15/2024	6:17:00 AM
BALD-0723	Kitchen	1088A	Kitchen (New Construction)	KC	6/15/2024	6:15:00 AM
BALD-0724	Kitchen	1088A	Kitchen (New Construction)	KC	6/15/2024	6:15:00 AM
BALD-0736	Hallway	1084	Corridor Outside Auditorium (1095)	WC	6/15/2024	6:40:00 AM
BALD-0737	Hallway	1084	Corridor Outside Auditorium (1095)	WF	6/15/2024	6:40:00 AM
BALD-0739	Hallway	1080	Corridor Outside Band Room (1078)	WC	6/15/2024	6:44:00 AM
BALD-0740	Hallway	1080	Corridor Outside Band Room (1078)	WF	6/15/2024	6:44:00 AM
BALD-0750	Gymnasium	1098	Gymnasium	WC	6/15/2024	6:25:00 AM
BALD-0751	Gymnasium	1098	Gymnasium	WF	6/15/2024	6:26:00 AM

Building Address

3211 Schreiber Place

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received: A. Minnifield

Signature: A. Minnifield

6/25/24 6:31 PM

Samplers Name: Danielle Beliziani

Samplers Signature: [Signature]

JCB Project Manager: Margaret Egan



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Baldwin Middle School

BMS

Client:

Baldwin Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

EC54230

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0755	Hallway	1098E	Gymnasium Vestibule (New Construction)	WC	6/15/2024	6:28:00 AM
BALD-0756	Hallway	1098E	Gymnasium Vestibule (New Construction)	WF	6/15/2024	6:28:00 AM
BALD-0760	Gymnasium	1098	Gymnasium	WC	6/15/2024	6:30:00 AM
BALD-0761	Gymnasium	1098	Gymnasium	WF	6/15/2024	6:30:00 AM
BALD-0771	Office	1098B	Girls Locker Room Coach's Office	BW	6/15/2024	6:35:00 AM
BALD-0773	Hallway	1070	Corridor Outside Health Office (1069A)	WC	6/15/2024	6:45:00 AM
BALD-0774	Hallway	1070	Corridor Outside Health Office (1069A)	WF	6/15/2024	6:45:00 AM
BALD-0775	Nurse Office	1069A	Health Services Office Room 113A	NS	6/15/2024	6:50:00 AM
BALD-0777	Hallway	1056	Corridor Outside Room 118 (1048)	WC	6/15/2024	6:51:00 AM
BALD-0778	Hallway	1056	Corridor Outside Room 118 (1048)	WF	6/15/2024	6:51:00 AM
BALD-0779	Hallway	1056	Corridor Outside Room 123 (1054)	WC	6/15/2024	6:52:00 AM
BALD-0780	Hallway	1056	Corridor Outside Room 123 (1054)	WF	6/15/2024	6:52:00 AM
BALD-0799	Hallway	1070	Corridor Outside Men's Bathroom (1043)	WC	6/15/2024	7:01:00 AM
BALD-0800	Hallway	1070	Corridor Outside Men's Bathroom (1043)	WF	6/15/2024	7:01:00 AM
BALD-0821	Hallway	1034	Corridor Outside Room 105 (1030)	WC	6/15/2024	7:40:00 AM
BALD-0822	Hallway	1034	Corridor Outside Room 105 (1030)	WF	6/15/2024	7:41:00 AM
BALD-0823	Hallway	1034	Corridor Outside Room 111 (1024)	WC	6/15/2024	7:46:00 AM
BALD-0824	Hallway	1034	Corridor Outside Room 111 (1024)	WF	6/15/2024	7:46:00 AM

Building Address

3211 Schreiber Place

Baldwin, NY 11510

Analysis Type: ELAP 200.5


Lab Received: A. Minnifield

Signature: A. Minnifield

Samplers Name: Denielle DeLeonis

Samplers Signature: Denielle DeLeonis

JCB Project Manager: Heather Anglin



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Baldwin Middle School

BMS

EC54230

Client:

Baldwin Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0827	Hallway	1017	Corridor Outside Room 163 (1005 - New Construction)	WC	6/15/2024	7:50:00 AM
BALD-0828	Hallway	1017	Corridor Outside Room 163 (1005 - New Construction)	WF	6/15/2024	7:50:00 AM
BALD-0847	Hallway	2067	Corridor Outside Room 237 (New Construction)	WC	6/15/2024	7:30:00 AM
BALD-0848	Hallway	2067	Corridor Outside Room 237 (New Construction)	WF	6/15/2024	7:30:00 AM
BALD-0849	Hallway	2067	Corridor Outside Room 243 (New Construction)	WC	6/15/2024	7:22:00 AM
BALD-0860	Hallway	2004	Corridor Outside Room 263 (New Construction)	WC	6/15/2024	7:34:00 AM
BALD-0861	Hallway	2004	Corridor Outside Room 263 (New Construction)	WF	6/15/2024	7:34:00 AM
BALD-0871	Hallway	2066	Corridor Outside Room 201 (2064)	WC	6/15/2024	7:17:00 AM
BALD-0872	Hallway	2066	Corridor Outside Room 201 (2064)	WF	6/15/2024	7:17:00 AM
BALD-0873	Hallway	2066	Corridor Outside Room 209 (2055)	WC	6/15/2024	7:15:00 AM
BALD-0874	Hallway	2066	Corridor Outside Room 209 (2055)	WF	6/15/2024	7:15:00 AM
BALD-0900	Hallway	2054	Corridor Outside Room 215A (2046)	WC	6/15/2024	7:12:00 AM
BALD-0901	Hallway	2054	Corridor Outside Room 215A (2046)	WF	6/15/2024	7:12:00 AM
BALD-0913	Hallway	2038	Corridor Outside Room 219 (2041)	WC	6/15/2024	7:09:00 AM
BALD-0914	Hallway	2038	Corridor Outside Room 219 (2041)	WF	6/15/2024	7:09:00 AM
BALD-0927	Hallway	2038	Corridor Outside Room 229 (2033)	WC	6/15/2024	7:06:00 AM
BALD-0928	Hallway	2038	Corridor Outside Room 229 (2033)	WF	6/15/2024	7:06:00 AM
BALD-0930	FL	2023	Room 232	KC	6/15/2024	7:24:00 AM

Building Address

3211 Schreiber Place

Baldwin, NY 11510

Analysis Type: ELAP 200.5


Lab Received:

Signature:

Samplers Name: Darvik Bahgani

Samplers Signature: [Signature]

JCB Project Manager: Maghan Gwynn



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 22-53302
Building: Baldwin Middle School
BMS

EC54230

Client: Baldwin Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush ☐

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0931	FL	2023	Room 232	KC	6/15/2024	7:24:00 AM
BALD-0932	FL	2023	Room 232	KC	6/15/2024	7:25:00 AM
BALD-0933	FL	2023	Room 232	KC	6/15/2024	7:25:00 AM
BALD-0934	Home Economics	1054	Home Economics Room 123	EC	6/15/2024	7:01:00 AM
BALD-0935	Home Economics	1054	Home Economics Room 123	EC	6/15/2024	7:00:00 AM
BALD-0936	Home Economics	1054	Home Economics Room 123	EC	6/15/2024	6:59:00 AM
BALD-0937	Home Economics	1054	Home Economics Room 123	EC	6/15/2024	6:59:00 AM
BALD-0938	Home Economics	1051	Home Economics Room 121	EC	6/15/2024	6:55:00 AM
BALD-0939	Home Economics	1051	Home Economics Room 121	EC	6/15/2024	6:55:00 AM
BALD-0940	Home Economics	1051	Home Economics Room 121	EC	6/15/2024	6:56:00 AM
BALD-0941	Home Economics	1051	Home Economics Room 121	EC	6/15/2024	6:57:00 AM
BALD-0949	Hallway	1101	Corridor Outside Gymnasium (1098)	WC	6/15/2024	6:21:00 AM
BALD-0950	Hallway	1101	Corridor Outside Gymnasium (1098)	WF	6/15/2024	6:21:00 AM

Samples Submitted

RECEIVED
ANALYTICAL, INC.
679 JUN 25 P 6:31

Building Address
3211 Schreiber Place
Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received: A. Minnick

Signature: A. Minnick

Samplers Name: Danielle Bologna

Samplers Signature: Danielle Bologna

JCB Project Manager: Heather Gwynn

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230**LIMS Reference ID:** EC54230**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0699 Lims Reference ID: EC54230-01 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	1.1		1	1.0	µg/L	07/06/24 11:45	07/06/24 11:45	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0700 Lims Reference ID: EC54230-02 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:49	07/06/24 11:49	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0705 Lims Reference ID: EC54230-03 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:50	07/06/24 11:50	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0706 Lims Reference ID: EC54230-04 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 11:52	07/06/24 11:52	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0709 Lims Reference ID: EC54230-05 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	14.8		1	1.0	µg/L	07/06/24 11:53	07/06/24 11:53	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0711 Lims Reference ID: EC54230-06 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/08/24 12:38	07/08/24 12:38	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0715 Lims Reference ID: EC54230-07 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	407		10	10.0	µg/L	07/06/24 11:58	07/06/24 11:58	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0719 Lims Reference ID: EC54230-08 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	22.0		1	1.0	µg/L	07/06/24 12:00	07/06/24 12:00	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0720 Lims Reference ID: EC54230-09 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	7.1		1	1.0	µg/L	07/06/24 12:01	07/06/24 12:01	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230
LIMS Reference ID: EC54230
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0721 Lims Reference ID: EC54230-10 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	5.2		1	1.0	µg/L	07/06/24 12:02	07/06/24 12:02	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0723 Lims Reference ID: EC54230-11 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	8.9		1	1.0	µg/L	07/06/24 12:04	07/06/24 12:04	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0724 Lims Reference ID: EC54230-12 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	11.8		1	1.0	µg/L	07/06/24 12:07	07/06/24 12:07	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0736 Lims Reference ID: EC54230-13 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:09	07/06/24 12:09	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0737 Lims Reference ID: EC54230-14 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:13	07/06/24 12:13	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0739 Lims Reference ID: EC54230-15 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:14	07/06/24 12:14	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0740 Lims Reference ID: EC54230-16 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:15	07/06/24 12:15	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0750 Lims Reference ID: EC54230-17 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:17	07/06/24 12:17	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0751 Lims Reference ID: EC54230-18 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:18	07/06/24 12:18	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230**LIMS Reference ID:** EC54230**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0755 Lims Reference ID: EC54230-19 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	1.2		1	1.0	µg/L	07/06/24 12:19	07/06/24 12:19	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0756 Lims Reference ID: EC54230-20 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:21	07/06/24 12:21	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0760 Lims Reference ID: EC54230-21 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:40	07/06/24 12:40	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0761 Lims Reference ID: EC54230-22 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:44	07/06/24 12:44	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0771 Lims Reference ID: EC54230-23 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:45	07/06/24 12:45	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0773 Lims Reference ID: EC54230-24 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:46	07/06/24 12:46	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0774 Lims Reference ID: EC54230-25 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:48	07/06/24 12:48	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0775 Lims Reference ID: EC54230-26 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	2.4		1	1.0	µg/L	07/06/24 12:52	07/06/24 12:52	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0777 Lims Reference ID: EC54230-27 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:53	07/06/24 12:53	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230**LIMS Reference ID:** EC54230**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0778 Lims Reference ID: EC54230-28 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:54	07/06/24 12:54	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0779 Lims Reference ID: EC54230-29 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:56	07/06/24 12:56	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0780 Lims Reference ID: EC54230-30 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:57	07/06/24 12:57	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0799 Lims Reference ID: EC54230-31 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 12:58	07/06/24 12:58	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0800 Lims Reference ID: EC54230-32 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:02	07/06/24 13:02	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0821 Lims Reference ID: EC54230-33 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:04	07/06/24 13:04	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0822 Lims Reference ID: EC54230-34 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:08	07/06/24 13:08	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0823 Lims Reference ID: EC54230-35 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:09	07/06/24 13:09	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0824 Lims Reference ID: EC54230-36 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:10	07/06/24 13:10	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230**LIMS Reference ID:** EC54230**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0827 Lims Reference ID: EC54230-37 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:11	07/06/24 13:11	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0828 Lims Reference ID: EC54230-38 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:13	07/06/24 13:13	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0847 Lims Reference ID: EC54230-39 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	1.3		1	1.0	µg/L	07/06/24 13:14	07/06/24 13:14	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0848 Lims Reference ID: EC54230-40 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	07/06/24 13:15	07/06/24 13:15	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0849 Lims Reference ID: EC54230-41 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:28	07/06/24 13:28	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0860 Lims Reference ID: EC54230-42 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:32	07/06/24 13:32	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0861 Lims Reference ID: EC54230-43 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:34	07/06/24 13:34	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0871 Lims Reference ID: EC54230-44 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:35	07/06/24 13:35	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0872 Lims Reference ID: EC54230-45 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:36	07/06/24 13:36	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230
LIMS Reference ID: EC54230
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0873 Lims Reference ID: EC54230-46 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:40	07/06/24 13:40	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0874 Lims Reference ID: EC54230-47 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:42	07/06/24 13:42	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0900 Lims Reference ID: EC54230-48 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:43	07/06/24 13:43	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0901 Lims Reference ID: EC54230-49 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:44	07/06/24 13:44	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0913 Lims Reference ID: EC54230-50 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:45	07/06/24 13:45	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0914 Lims Reference ID: EC54230-51 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:47	07/06/24 13:47	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0927 Lims Reference ID: EC54230-52 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:51	07/06/24 13:51	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0928 Lims Reference ID: EC54230-53 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 13:52	07/06/24 13:52	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0930 Lims Reference ID: EC54230-54 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	70.0		1	1.0	µg/L	07/06/24 13:56	07/06/24 13:56	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230
LIMS Reference ID: EC54230
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0931 Lims Reference ID: EC54230-55 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	29.8		1	1.0	µg/L	07/06/24 13:57	07/06/24 13:57	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0932 Lims Reference ID: EC54230-56 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	7.5		1	1.0	µg/L	07/06/24 13:59	07/06/24 13:59	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0933 Lims Reference ID: EC54230-57 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	160		10	10.0	µg/L	07/06/24 14:11	07/06/24 14:11	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0934 Lims Reference ID: EC54230-58 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	5.9		1	1.0	µg/L	07/06/24 14:01	07/06/24 14:01	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0935 Lims Reference ID: EC54230-59 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	5.9		1	1.0	µg/L	07/06/24 14:03	07/06/24 14:03	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0936 Lims Reference ID: EC54230-60 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	6.3		1	1.0	µg/L	07/06/24 14:04	07/06/24 14:04	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0937 Lims Reference ID: EC54230-61 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	5.9		1	1.0	µg/L	07/05/24 10:58	07/05/24 10:58	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0938 Lims Reference ID: EC54230-62 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	10.3		1	1.0	µg/L	07/05/24 11:04	07/05/24 11:04	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0939 Lims Reference ID: EC54230-63 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	6.9		1	1.0	µg/L	07/05/24 11:06	07/05/24 11:06	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230
LIMS Reference ID: EC54230
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0940 Lims Reference ID: EC54230-64 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	5.6		1	1.0	µg/L	07/05/24 11:07	07/05/24 11:07	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0941 Lims Reference ID: EC54230-65 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	8.6		1	1.0	µg/L	07/05/24 11:08	07/05/24 11:08	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0949 Lims Reference ID: EC54230-66 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/05/24 11:10	07/05/24 11:10	BP	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0950 Lims Reference ID: EC54230-67 Matrix: Drinking Water Sampled: 06/15/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/05/24 11:11	07/05/24 11:11	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230**LIMS Reference ID:** EC54230**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454230**LIMS Reference ID:** EC54230**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Middle School BMS,
Baldwin Union Free School District, 3211
Schreiber Place Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:31
Reported: 07/13/2024 13:43


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Baldwin Middle School

BMS

EC55806

Client:

Baldwin Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush 48 hours

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0931	FL	2023	Room 232	KC	8/28/2024	7:36 am
BALD-0934	Home Economics	1054	Home Economics Room 123	EC	8/28/2024	7:28 am
BALD-0935	Home Economics	1054	Home Economics Room 123	EC	8/28/2024	7:29 am
BALD-0936	Home Economics	1054	Home Economics Room 123	EC	8/28/2024	7:32 am
BALD-0937	Home Economics	1054	Home Economics Room 123	EC	8/28/2024	7:33 am
BALD-0938	Home Economics	1051	Home Economics Room 121	EC	8/28/2024	7:21 am
BALD-0939	Home Economics	1051	Home Economics Room 121	EC	8/28/2024	7:24 am
BALD-0940	Home Economics	1051	Home Economics Room 121	EC	8/28/2024	7:25 am
BALD-0941	Home Economics	1051	Home Economics Room 121	EC	8/28/2024	7:26 am

Samples Submitted 9

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 28 2024 AM08:28

Building Address

3211 Schreiber Place

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Danielle Bologna

Samplers Signature:

JCB Project Manager:

McGowan

Walk-In

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455806
LIMS Reference ID: EC55806
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Baldwin Middle School,
Baldwin Union Free School District, 3211
Schreiber Place, Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 08/28/2024 08:28
Reported: 08/30/2024 09:13

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0931 Lims Reference ID: EC55806-01 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	2.9		1	1.0	µg/L	08/28/24 17:19	08/28/24 17:19	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0934 Lims Reference ID: EC55806-02 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	08/28/24 17:22	08/28/24 17:22	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0935 Lims Reference ID: EC55806-03 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	3.1		1	1.0	µg/L	08/28/24 17:24	08/28/24 17:24	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0936 Lims Reference ID: EC55806-04 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	08/28/24 17:25	08/28/24 17:25	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0937 Lims Reference ID: EC55806-05 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	6.3		1	1.0	µg/L	08/28/24 17:26	08/28/24 17:26	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0938 Lims Reference ID: EC55806-06 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	7.1		1	1.0	µg/L	08/28/24 17:47	08/28/24 17:47	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0939 Lims Reference ID: EC55806-07 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	10.0		1	1.0	µg/L	08/28/24 17:48	08/28/24 17:48	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0940 Lims Reference ID: EC55806-08 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	3.4		1	1.0	µg/L	08/28/24 17:49	08/28/24 17:49	BA	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0941 Lims Reference ID: EC55806-09 Matrix: Drinking Water Sampled: 08/28/24 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	08/28/24 17:50	08/28/24 17:50	BA	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455806**LIMS Reference ID:** EC55806**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Baldwin Middle School,
Baldwin Union Free School District, 3211
Schreiber Place, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 08/28/2024 08:28
Reported: 08/30/2024 09:13

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062455806**LIMS Reference ID:** EC55806**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Baldwin Middle School,
Baldwin Union Free School District, 3211
Schreiber Place, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 08/28/2024 08:28
Reported: 08/30/2024 09:13


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Steele Elementary School

SES

Client:

Baldwin Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

EC54236

Walk In

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-0971	Storage	0016E	Gym Kitchen 32D	KC	6/22/2024	6:01:00 AM
BALD-0976	Hallway	0013	Vestibule 30 Outside Pump Room	WC	6/22/2024	5:59:00 AM
BALD-0977	Hallway	0013	Vestibule 30 Outside Pump Room	WF	6/22/2024	5:59:00 AM
BALD-0978	Hallway	0009	Corridor Outside Stairwell (1013)	WC	6/22/2024	6:04:00 AM
BALD-0997	Hallway	0004	Corridor Outside Stairwell (1003)	WF	6/22/2024	6:08:00 AM
BALD-1003	Hallway	1014	Corridor Outside Stairwell (1013)	WC	6/22/2024	6:12:00 AM
BALD-1007	Faculty Lounge	1017	Faculty Room 17	KC	6/22/2024	6:27:00 AM
BALD-1019	Hallway	2013	Corridor Outside Men's Bathroom 47A (1013F)	WC	6/22/2024	6:19:00 AM
BALD-1434	HA	0009	Corridor (Bottom Of Stairs & Outside Custodial Vestibule)	WF	6/22/2024	6:04:00 AM
BALD-1439	CA	0005	Room 2/Room 3	KC	6/22/2024	6:06:00 AM
BALD-1444	HA	1004	Stairwell Landing Adjacent To Room 11	WC	6/22/2024	6:11:00 AM
BALD-1445	HA	1004	Stairwell Landing Adjacent To Room 11	WF	6/22/2024	6:11:00 AM
BALD-1446	HA	1014	Stairwell Landing Adjacent To Room 14	WF	6/22/2024	6:12:00 AM
BALD-1450	HA	2013	Stairwell Landing Adjacent Boys Bathroom	WF	6/22/2024	6:20:00 AM
BALD-1451	HA	2003	Stairwell Landing Adjacent Girls Bathroom	WC	6/22/2024	6:22:00 AM
BALD-1452	HA	2003	Stairwell Landing Adjacent Girls Bathroom	WF	6/22/2024	6:22:00 AM

Building Address

860 Church Street

Baldwin, NY 11510

Analysis Type: ELAP 200.5


Lab Received: OK

Signature: [Signature]

Samplers Name: Danielle Pellegrini

Samplers Signature: [Signature]

JCB Project Manager: Meghan Guzman



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building:

Steele Elementary School

SES

EL 54236

Client:

Baldwin Union Free School District

Retest/New Install:

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 16

RECEIVED
ENSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 JUN 25 P 6:29

Building Address

860 Church Street

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Donelle Holman

Samplers Signature:

JCB Project Manager:

Meghan Guyon

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454236**LIMS Reference ID:** EC54236**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Steel Elementary School,
Baldwin Union Free School District, 860
Church Street, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:29
Reported: 07/13/2024 14:47

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-0971 Lims Reference ID: EC54236-01 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	60.5		1	1.0	µg/L	07/06/24 09:31	07/06/24 09:31	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0976 Lims Reference ID: EC54236-02 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:32	07/06/24 09:32	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0977 Lims Reference ID: EC54236-03 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:33	07/06/24 09:33	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0978 Lims Reference ID: EC54236-04 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:37	07/06/24 09:37	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-0997 Lims Reference ID: EC54236-05 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:39	07/06/24 09:39	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1003 Lims Reference ID: EC54236-06 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:40	07/06/24 09:40	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1007 Lims Reference ID: EC54236-07 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	3.6		1	1.0	µg/L	07/06/24 09:41	07/06/24 09:41	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1019 Lims Reference ID: EC54236-08 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:43	07/06/24 09:43	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1434 Lims Reference ID: EC54236-09 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:44	07/06/24 09:44	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454236**LIMS Reference ID:** EC54236**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Steel Elementary School,
Baldwin Union Free School District, 860
Church Street, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:29
Reported: 07/13/2024 14:47

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-1439 Lims Reference ID: EC54236-10 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	2.7		1	1.0	µg/L	07/06/24 09:48	07/06/24 09:48	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1444 Lims Reference ID: EC54236-11 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:49	07/06/24 09:49	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1445 Lims Reference ID: EC54236-12 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:53	07/06/24 09:53	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1446 Lims Reference ID: EC54236-13 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:54	07/06/24 09:54	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1450 Lims Reference ID: EC54236-14 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:56	07/06/24 09:56	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1451 Lims Reference ID: EC54236-15 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:57	07/06/24 09:57	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1452 Lims Reference ID: EC54236-16 Matrix: Drinking Water Sampled: 06/22/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	07/06/24 09:58	07/06/24 09:58	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454236**LIMS Reference ID:** EC54236**EMSL Customer ID:** JCBR50**Attention:** Meghan Gwynn

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name:

JCB#: 22-53302, Steel Elementary School,
Baldwin Union Free School District, 860
Church Street, Baldwin, NY 11510

Customer PO:

Jeromy Bish

EMSL Sales Rep:**Received:**

06/25/2024 18:29

Reported:

07/13/2024 14:47

Work Order Case Narrative

Elevated analyte greater than 4x spike amount; MS/MSD not evaluated

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454236**LIMS Reference ID:** EC54236**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Steel Elementary School,
Baldwin Union Free School District, 860
Church Street, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:29
Reported: 07/13/2024 14:47

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454236**LIMS Reference ID:** EC54236**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Steel Elementary School,
Baldwin Union Free School District, 860
Church Street, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeremy Bish

Received: 06/25/2024 18:29
Reported: 07/13/2024 14:47


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Shubert Elementary School

SHU

EL5 4234

Client:

Baldwin Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-1038	Hallway	1012	Corridor Outside Nurse's Office (1000)	WC	6/21/2024	7:15:00 AM
BALD-1039	Hallway	1012	Corridor Outside Nurse's Office (1000)	WF	6/21/2024	7:15:00 AM
BALD-1046	Classroom	1004	Room 109/110	DW	6/21/2024	7:18:00 AM
BALD-1047	Faculty Lounge	1007	Faculty Kitchen (Room 111/112)	KC	6/21/2024	7:20:00 AM
BALD-1052	Hallway	1014	Vestibule Corridor Outside Stage	WC	6/21/2024	7:22:00 AM
BALD-1053	Hallway	1014	Vestibule Corridor Outside Stage	WF	6/21/2024	7:22:00 AM
BALD-1076	Hallway	2008	Corridor Outside Room 206 (2005)	WC	6/21/2024	7:27:00 AM
BALD-1077	Hallway	2008	Corridor Outside Room 206 (2005)	WF	6/21/2024	7:27:00 AM
BALD-1085	Hallway	1025	Corridor Outside Gymnasium (1022)	WC	6/21/2024	7:24:00 AM
BALD-1086	Hallway	1025	Corridor Outside Gymnasium (1022)	WF	6/21/2024	7:24:00 AM

Samples Submitted 10

RECEIVED
ENVIRONMENTAL ANALYTICAL, INC.
ORLEANS PLACE, NY
2024 JUN 25 PM 6:35

Building Address

835 Centennial Avenue
Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Aileen McNamee

Samplers Signature: Aileen McNamee

JCB Project Manager: Meghan Gwynn

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454234**LIMS Reference ID:** EC54234**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Shubert Elementary School,
Baldwin Union Free School District, 835
Centennial Avenue, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:35
Reported: 07/13/2024 13:52

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-1038 Lims Reference ID: EC54234-01 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 16:27	06/28/24 16:27	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1039 Lims Reference ID: EC54234-02 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 16:31	06/28/24 16:31	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1046 Lims Reference ID: EC54234-03 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	4.8		1	1.0	µg/L	06/28/24 16:32	06/28/24 16:32	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1047 Lims Reference ID: EC54234-04 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	1.5		1	1.0	µg/L	06/28/24 16:34	06/28/24 16:34	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1052 Lims Reference ID: EC54234-05 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 16:35	06/28/24 16:35	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1053 Lims Reference ID: EC54234-06 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 16:39	06/28/24 16:39	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1076 Lims Reference ID: EC54234-07 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	06/28/24 16:40	06/28/24 16:40	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1077 Lims Reference ID: EC54234-08 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 16:41	06/28/24 16:41	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1085 Lims Reference ID: EC54234-09 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 16:43	06/28/24 16:43	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454234**LIMS Reference ID:** EC54234**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Shubert Elementary School,
Baldwin Union Free School District, 835
Centennial Avenue, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:35
Reported: 07/13/2024 13:52

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-1086 Lims Reference ID: EC54234-10 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 16:44	06/28/24 16:44	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454234**LIMS Reference ID:** EC54234**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Shubert Elementary School,
Baldwin Union Free School District, 835
Centennial Avenue, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:35
Reported: 07/13/2024 13:52

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454234**LIMS Reference ID:** EC54234**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: JCB#: 22-53302, Shubert Elementary School,
Baldwin Union Free School District, 835
Centennial Avenue, Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:35
Reported: 07/13/2024 13:52

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

EC54240

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building: Plaza Elementary School

PES

Client:

Baldwin Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-1106	Hallway	1053	Corridor Outside Gymnasium (1047)	WC	6/21/2024	6:14:00 AM
BALD-1107	Hallway	1053	Corridor Outside Gymnasium (1047)	WF	6/21/2024	6:14:00 AM
BALD-1129	Faculty Lounge	1035A	Faculty Room	KC	6/21/2024	6:16:00 AM
BALD-1139	Cafeteria	1026	Cafeteria	KC	6/21/2024	6:25:00 AM
BALD-1149	Hallway	1024	Corridor Outside Rm 108 Vestibule (1024A)	WC	6/21/2024	6:29:00 AM
BALD-1150	Hallway	1024	Corridor Outside Rm 108 Vestibule (1024A)	WF	6/21/2024	6:29:00 AM
BALD-1169	Classroom	1003	Room 114	DW	6/21/2024	6:46:00 AM
BALD-1204	Hallway	2021	Corridor Outside Room 211 (2014)	WC	6/21/2024	6:36:00 AM
BALD-1205	Hallway	2021	Corridor Outside Room 211 (2014)	WF	6/21/2024	6:36:00 AM
BALD-1359	HA	1008	Corridor From Room 112 To Room 116	WC	6/21/2024	6:32:00 AM
BALD-1360	HA	1008	Corridor From Room 112 To Room 116	WF	6/21/2024	6:32:00 AM
BALD-1361	HA	2009	Corridor (Room 216 - Boys Bath)	WC	6/21/2024	6:39:00 AM
BALD-1362	HA	2009	Corridor (Room 216 - Boys Bath)	WF	6/21/2024	6:39:00 AM
BALD-1367	HA	1034	Corridor (Room 43 Custodial Closet - Room 55)	WC	6/21/2024	6:22:00 AM
BALD-1368	HA	1034	Corridor (Room 43 Custodial Closet - Room 55)	WF	6/21/2024	6:22:00 AM
BALD-1369	HA	1045	Corridor (Faculty Room - Room 80 Girls Bath)	WC	6/21/2024	7:18:00 AM
BALD-1370	HA	1045	Corridor (Faculty Room - Room 80 Girls Bath)	WF	6/21/2024	7:18:00 AM

Building Address

501 Seaman Avenue

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received: A. Minnick

Signature: A. Minnick
6/25/24 6:31pm

Samplers Name: Danielle Belongini

Samplers Signature: [Signature]

JCB Project Manager: Meghan Emery



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building:

Plaza Elementary School

PES

Client:

Baldwin-Union Free School District

Retest/New Install: ☒

Turn Around: Normal 1 wk Rush

EC54240

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 17

RECEIVED
EHSL ANALYTICAL, INC.
CARLE PLACE, NY
2024 JUN 25 PM 6:31

Building Address

501 Seaman Avenue

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received:

A Minnick

Signature:

A Minnick

6/25/24 6:31pm

Samplers Name:

Danielle Bolognini

Samplers Signature:

Danielle Bolognini

JCB Project Manager:

Heather Gwynn

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454240**LIMS Reference ID:** EC54240**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Plaza Elementary School, PES,
Baldwin Union Free School District, 501
Seaman Avenue Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 14:50

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-1106 Lims Reference ID: EC54240-01 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:17	06/29/24 12:17	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1107 Lims Reference ID: EC54240-02 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:21	06/29/24 12:21	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1129 Lims Reference ID: EC54240-03 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	2.2		1	1.0	µg/L	06/29/24 12:22	06/29/24 12:22	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1139 Lims Reference ID: EC54240-04 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	6.7		1	1.0	µg/L	06/29/24 12:24	06/29/24 12:24	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1149 Lims Reference ID: EC54240-05 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:25	06/29/24 12:25	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1150 Lims Reference ID: EC54240-06 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:29	06/29/24 12:29	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1169 Lims Reference ID: EC54240-07 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	571		10	10.0	µg/L	06/29/24 12:46	06/29/24 12:46	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1204 Lims Reference ID: EC54240-08 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:32	06/29/24 12:32	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1205 Lims Reference ID: EC54240-09 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:33	06/29/24 12:33	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454240**LIMS Reference ID:** EC54240**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Plaza Elementary School, PES,
Baldwin Union Free School District, 501
Seaman Avenue Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:31
Reported: 07/13/2024 14:50

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-1359 Lims Reference ID: EC54240-10 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:34	06/29/24 12:34	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1360 Lims Reference ID: EC54240-11 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:36	06/29/24 12:36	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1361 Lims Reference ID: EC54240-12 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:40	06/29/24 12:40	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1362 Lims Reference ID: EC54240-13 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:41	06/29/24 12:41	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1367 Lims Reference ID: EC54240-14 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:47	06/29/24 12:47	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1368 Lims Reference ID: EC54240-15 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:48	06/29/24 12:48	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1369 Lims Reference ID: EC54240-16 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	3.4		1	1.0	µg/L	06/29/24 12:50	06/29/24 12:50	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1370 Lims Reference ID: EC54240-17 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/29/24 12:51	06/29/24 12:51	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454240**LIMS Reference ID:** EC54240**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Plaza Elementary School, PES,
Baldwin Union Free School District, 501
Seaman Avenue Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:31
Reported: 07/13/2024 14:50

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454240**LIMS Reference ID:** EC54240**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Plaza Elementary School, PES,
Baldwin Union Free School District, 501
Seaman Avenue Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:31
Reported: 07/13/2024 14:50


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building:

Milburn Elementary School

MIL

EC54235

Client:

Baldwin Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-1218	Nurse Office	1006	Room-11 Clinic Room	NS	6/18/2024	7:28:00 AM
BALD-1220	Hallway	1011	Corridor Outside Boys Bathroom (1004)	DW	6/18/2024	7:35:00 AM

Samples Submitted 2

RECEIVED
ENSL ANALYTICAL INC.
OF RYE PLACE, NY
2021 JUN 25 PM 5:32

Building Address

2501 Milburn Avenue

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Recieved: A. Minnifield

Signature: A. Minnifield

Samplers Name: Danick Balogun

Samplers Signature: Danick Balogun

JCB Project Manager: Neghan Gargan



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062454235
LIMS Reference ID: EC54235
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Milburn Elementary School MIL,
Baldwin Union Free School District, 2501
Milburn Avenue Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:32
Reported: 07/13/2024 14:43

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-1218 Lims Reference ID: EC54235-01 Matrix: Drinking Water Sampled: 06/18/24 00:00:00									
Metals									
Lead	52.1		1	1.0	µg/L	07/06/24 09:25	07/06/24 09:25	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1220 Lims Reference ID: EC54235-02 Matrix: Drinking Water Sampled: 06/18/24 00:00:00									
Metals									
Lead	4.6		1	1.0	µg/L	07/06/24 09:29	07/06/24 09:29	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454235**LIMS Reference ID:** EC54235**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name:

#22-53302, Milburn Elementary School MIL,
Baldwin Union Free School District, 2501
Milburn Avenue Baldwin, NY 11510

Customer PO:

Jeromy Bish

EMSL Sales Rep:**Received:**

06/25/2024 18:32

Reported:

07/13/2024 14:43

Work Order Case Narrative

Elevated analyte greater than 4x spike amount; MS/MSD not evaluated

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454235**LIMS Reference ID:** EC54235**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Milburn Elementary School MIL,
Baldwin Union Free School District, 2501
Milburn Avenue Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:32
Reported: 07/13/2024 14:43

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454235**LIMS Reference ID:** EC54235**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Milburn Elementary School MIL,
Baldwin Union Free School District, 2501
Milburn Avenue Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:32
Reported: 07/13/2024 14:43


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

22-53302

Building:

Baldwin Administration Building

BAB

Client:

Baldwin Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
BALD-1277	Hallway	1028	Corridor Outside Assistant Superintendent (1022)	WC	6/21/2024	6:46:00 AM
BALD-1278	Hallway	1028	Corridor Outside Assistant Superintendent (1022)	WF	6/21/2024	6:46:00 AM
BALD-1291	Office	1043A	Room 17 Assistant Business Manager Office 17B	KC	6/21/2024	6:38:00 AM
BALD-1293	Office	1045	Buildings & Grounds Entrance Vestibule	WF	6/21/2024	6:40:00 AM
BALD-1294	Office	1045	Buildings & Grounds Entrance Vestibule	KC	6/21/2024	6:41:00 AM
BALD-1302	Hallway	1053	Corridor Outside Custodial Closet H1A (1049)	WC	6/21/2024	6:42:00 AM
BALD-1303	Hallway	1053	Corridor Outside Custodial Closet H1A (1049)	WF	6/21/2024	6:43:00 AM
BALD-1308	Office	1000	Room 36	KC	6/21/2024	6:50:00 AM
BALD-1313	Hallway	1010	Corridor Outside Room 29 (1009)	WC	6/21/2024	6:47:00 AM
BALD-1314	Hallway	1010	Corridor Outside Room 29 (1009)	WF	6/21/2024	6:47:00 AM
BALD-1315	Office	1009	Room 29	KC	6/21/2024	6:48:00 AM

Samples Submitted 11



2024 JUN 25 12 6:37

RECEIVED
ANALYTICAL, INC.
CARLE PLACE, CT

Building Address

960 Hastings Street

Baldwin, NY 11510

Analysis Type: ELAP 200.5

Lab Received: A. Minnifield

Signature: A. Minnifield

6/25/24 6:37pm

Samplers Name: Aileen McNamee

Samplers Signature: Aileen McNamee

JCB Project Manager: Meghan Gwynn

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454231
LIMS Reference ID: EC54231
EMSL Customer ID: JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Administration Building
BAB, Baldwin Union Free School District, 960
Hastings Street Baldwin, NY 11510
Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:37
Reported: 07/13/2024 13:46

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-1277 Lims Reference ID: EC54231-01 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 12:36	06/29/24 11:31	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1278 Lims Reference ID: EC54231-02 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 12:36	06/29/24 11:35	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1291 Lims Reference ID: EC54231-03 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	26.0		1	1.0	µg/L	06/29/24 11:37	06/29/24 11:37	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1293 Lims Reference ID: EC54231-04 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 12:36	06/29/24 11:38	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1294 Lims Reference ID: EC54231-05 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	21.0		1	1.0	µg/L	06/29/24 11:39	06/29/24 11:39	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1302 Lims Reference ID: EC54231-06 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 12:36	06/29/24 11:43	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1303 Lims Reference ID: EC54231-07 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 12:36	06/29/24 11:45	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1308 Lims Reference ID: EC54231-08 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	84.1		1	1.0	µg/L	06/29/24 11:46	06/29/24 11:46	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1313 Lims Reference ID: EC54231-09 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 12:36	06/29/24 11:47	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454231**LIMS Reference ID:** EC54231**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Administration Building
BAB, Baldwin Union Free School District, 960
Hastings Street Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 06/25/2024 18:37
Reported: 07/13/2024 13:46

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: BALD-1314 Lims Reference ID: EC54231-10 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	<1.0		1	1.0	µg/L	06/28/24 12:36	06/29/24 11:48	JH	EPA 200.8 (DA)/EPA 200.8
Sample: BALD-1315 Lims Reference ID: EC54231-11 Matrix: Drinking Water Sampled: 06/21/24 00:00:00									
Metals									
Lead	35.2		1	1.0	µg/L	06/29/24 11:50	06/29/24 11:50	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454231**LIMS Reference ID:** EC54231**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Administration Building
BAB, Baldwin Union Free School District, 960
Hastings Street Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:37
Reported: 07/13/2024 13:46

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062454231**LIMS Reference ID:** EC54231**EMSL Customer ID:** JCBR50

Attention: Meghan Gwynn
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
mgwynn@jcbroderick.com

Project Name: #22-53302, Baldwin Administration Building
BAB, Baldwin Union Free School District, 960
Hastings Street Baldwin, NY 11510

Customer PO:
EMSL Sales Rep: Jeromy Bish

Received: 06/25/2024 18:37
Reported: 07/13/2024 13:46

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.

Attachment 4:

Laboratory Certifications


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

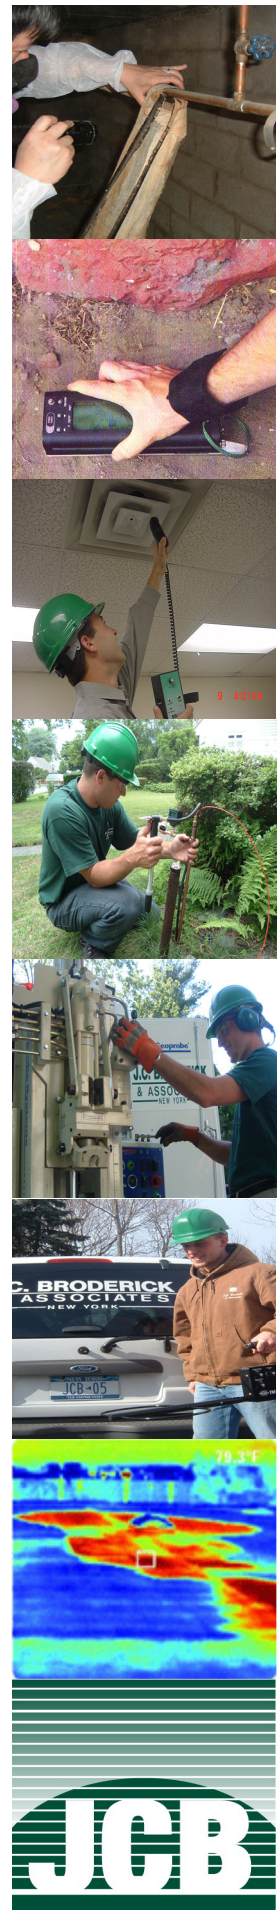

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2025
Issued April 01, 2024

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Heterotrophic Plate Count	SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5 EPA 200.8 Rev. 5.4
-------------	---------------------------------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------



Serial No.: 68787

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at <https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/>, by phone (518) 485-5570 or by email to elap@health.ny.gov.

