
September 26, 2024

Jeremie Kahler
Park Hill School District
9501 N. Seymour Ave.
Kansas City, MO 64153

**RE: Drinking Water Sampling – Park Hill High School -Post Remediation
Sampling**
7701 NW Barry Road, Kansas City, MO 64153
Project Number: 923386

Mr. Kahler,

OCCU-TEC, Inc. (OCCU-TEC) is pleased to present the following report for post-remediation drinking water sampling completed on recently replaced sources at Park Hill High School in Kansas City, Missouri. The sampling was requested and approved by Mr. Jeremie Kahler of Park Hill School District (PHSD). OCCU-TEC completed sampling of sources that contained concentrations of lead above 5.0 parts per billion (ppb) and where fixtures had been subsequently replaced or repaired. Drinking water sampling was completed in accordance with the requirements set forth in Missouri Senate Bill #681/662 known as the "Get the Lead Out of School Drinking Water Act".

METHODOLOGY

On July 3, 2024, August 6, 2024, and September 11, 2024, Mr. Jay Hurst of OCCU-TEC completed testing of nine (9) sources at Park Hill High School. Samples were collected as 'First Draw' samples after the fixtures had remained unused for a minimum period of eight (8) hours while not exceeding a maximum period of eighteen (18) hours. Samples were collected in dedicated 250 milliliter laboratory-provided plastic sample containers.

Samples were shipped to Pace Analytical Services, LLC (Pace) of Peoria, Illinois for analysis using Environmental Protection Agency (EPA) method 200.8. Pace is approved for sample analysis by the Missouri Department of Natural Resources (MDNR) under certification numbers 00236 and 00870. A copy of the laboratory analytical results and Chain of Custody documentation are attached to this report.

RESULTS

Sample results were compared to the regulatory limit of 5.0 parts per billion (ppb) or micrograms per liter (ug/L) outlined in Missouri Senate Bill 681/662. Below is a list of samples collected and the associated analytical results.

Sample ID	Location	Type	Result (ppb or ug/L)
386-PHHS-28R (Original Sample 386-PHHS-28)	Room 405	Sink	17.6
386-PHHS-29R (Original Sample 386-PHHS-29)	Room 404	Sink	2.35
386-PHHS-64R (Original Sample 386-PHHS-64)	SRO Office	Sink	<1.0
386-PHHS-90R (Original Sample 386-PHHS-90)	Kitchen	Sink	4.5
386-PHHS-176R (Original Sample 386-PHHS-176)	Athletic Training Dance	Sink	<1.0
386-PHHS-178R (Original Sample 386-PHHS-178)	Room 24	Sink	<1.0
386-PHHS-136A (Previously Out of Service)	Hall by Women's Locker Room	Drinking Fountain Bubbler	<1.0
386-PHHS-136B (Previously Out of Service)	Hall by Women's Locker Room	Drinking Fountain Bottle Filler	<1.0
386-PHHS-182R (Original Sample 386-PHHS-182)	Lactation Room by 344	Sink	4.40

Note: Samples were not collected from sources which had been removed from service or labeled as non-drinking water.

RECOMMENDATIONS

The following recommendations are in accordance with Senate Bill 681/662.

In accordance with the requirements set forth in Missouri Bill 681/662, fixtures exhibiting lead concentrations above 5.0 ppb must be remediated by replacement of lead-containing pipes, solder, fittings or fixtures with lead-free components. Until such time as the source of the contamination has been remediated, the school shall install a filter that reduces the lead in drinking water on each water outlet inventoried with results above 5.0 ppb to ensure lead concentrations are below 5.0 ppb.

Within two weeks after receiving test results, the school shall make all testing results and any lead remediation plans available on the school's website. The school shall notify parents and staff via written notification within seven (7) business days after receiving test results exceeding 5.0 ppb. The notification shall include the following:

- Test results and a summary explaining the results.
- A description of any remedial steps taken.
- A description of the general health effects of lead contamination and community specific resources.
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.

For fixtures exhibiting results above 5.0 ppb, follow up random "Flush" sampling shall be conducted annually on at least 25-percent of the remediated outlets until all outlets have been remediated. Drinking water sampling shall be conducted annually and annual drinking water test results shall be submitted by the district to the Department of Health and Senior Services (MDHSS).

LIMITATIONS

OCCU-TEC did not complete remediation of the sources sampled and cannot verify the completeness of remediation.

SIGNATURE(S)

OCCU-TEC appreciates the opportunity to provide the above referenced consulting services to PHSD. If you have any questions regarding the contents of this report, please contact us at (816) 231-5580.

Respectfully,



Jay W. Hurst
Vice President of Operations



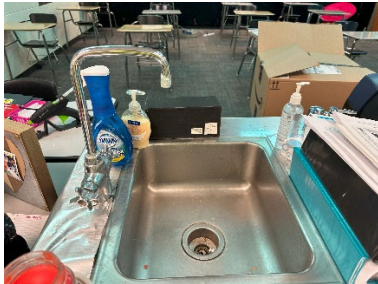
Jeff Smith
Senior Project Manager (QA/QC)

ATTACHMENTS

Outlet Inventory with Analytical Results Summary
Laboratory Analytical Results and COC Documentation

Drinking Water Assessment
Park Hill High School
Park Hill School District

ID:	386-PHHS-28R	Location:	Rm 405		
Photo:		Manufacturer:	Chicago Faucet		
		Description:			
		Sink			
		Result:	17.6	ppb	
Recommended Action:		Date Sampled:	7/3/2024	By:	JH
		Remove from Service / Label as Non-Drinking Water			

ID:	386-PHHS-29R	Location:	Rm 404		
Photo:		Manufacturer:	Chicago Faucet		
		Description:			
		Sink			
		Result:	2.35	ppb	
Recommended Action:		Date Sampled:	7/3/2024	By:	JH

ID:	386-PHHS-64R	Location:	SRO Office		
Photo:		Manufacturer:	Unknown		
		Description:			
		Sink			
		Result:	<1.0	ppb	
Recommended Action:		Date Sampled:	7/3/2024	By:	JH

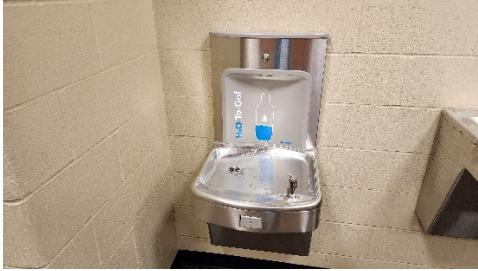
Drinking Water Assessment
Park Hill High School
Park Hill School District

ID:	386-PHHS-90R	Location:	Kitchen		
Photo:		Manufacturer:	Elkay		
		Description:			
		Hand Washing Sink - East of Coffee Bar			
		Result:	4.5	ppb	
Recommended Action:		Date Sampled:	7/3/2024	By:	JH

ID:	386-PHHS-176R	Location:	Ath Training Dance		
Photo:		Manufacturer:	Chicago Faucet		
		Description:			
		Sink			
		Result:	<1.0	ppb	
Recommended Action:		Date Sampled:	12/29/2023	By:	CD

ID:	386-PHHS-178R	Location:	Rm 24		
Photo:		Manufacturer:	Chicago Faucet		
		Description:			
		Sink			
		Result:	<1.0	ppb	
Recommended Action:		Date Sampled:	7/3/2024	By:	JH

Drinking Water Assessment
Park Hill High School
Park Hill School District

ID:	386-PHHS-136A	Location:	Hall By Wmns Lckr Rm	
Photo:		Manufacturer:	Murdock	
		Description:		
		Drinking Fountain Bubbler (Left)		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	8/6/2024	By: JH

ID:	386-PHHS-136B	Location:	Hall By Wmns Lckr Rm	
Photo:		Manufacturer:	Murdock	
		Description:		
		Drinking Fountain Bottle Filler (Left)		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	8/6/2024	By: JH

ID:	386-PHHS-182R	Location:	Lactation Rm by 344	
Photo:		Manufacturer:	Moen	
		Description:		
		Hand Washing Sink		
		Result:	4.4	ppb
Recommended Action:		Date Sampled:	8/16/2024	By: JH



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

July 18, 2024

Jeremie Kahler
Park Hill School District
9501 N. Seymour Ave
MO, MO 64153

RE: Drinking Water Lead

Dear Jeremie Kahler:

Please find enclosed the analytical results for the **6** sample(s) the laboratory received on **7/10/24 10:25 am** and logged in under work order **HG01784**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read 'Chenise Lambert-Sykes'.

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com

**SAMPLE RECEIPT CHECK LIST**

Items not applicable will be marked as in compliance

Work Order HG01784

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
YES	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



ANALYTICAL RESULTS

Sample: HG01784-01
Name: 386-PHHS-28R
Matrix: Drinking Water - Grab

Sampled: 07/03/24 10:41
Received: 07/10/24 10:25

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	17.6	ug/L		07/17/24 08:13	1	1.00	07/17/24 11:09	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HG01784-02
Name: 386-PHHS-29R
Matrix: Drinking Water - Grab

Sampled: 07/03/24 10:47
Received: 07/10/24 10:25

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	2.35	ug/L		07/17/24 08:13	1	1.00	07/17/24 11:10	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HG01784-03
Name: 386-PHHS-64R
Matrix: Drinking Water - Grab

Sampled: 07/03/24 10:53
Received: 07/10/24 10:25

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		07/17/24 08:13	1	1.00	07/17/24 11:12	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HG01784-04
Name: 386-PHHS-90R
Matrix: Drinking Water - Grab

Sampled: 07/03/24 10:58
Received: 07/10/24 10:25

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	4.50	ug/L		07/17/24 08:13	1	1.00	07/17/24 11:13	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------



ANALYTICAL RESULTS

Sample: HG01784-05
Name: 386-PHHS-176R
Matrix: Drinking Water - Grab

Sampled: 07/03/24 11:07

Received: 07/10/24 10:25

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		07/17/24 08:13	1	1.00	07/17/24 11:14	BRS	EPA 200.8 REV 5.4

Sample: HG01784-06
Name: 386-PHHS-178R
Matrix: Drinking Water - Grab

Sampled: 07/03/24 11:10

Received: 07/10/24 10:25

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		07/17/24 08:13	1	1.00	07/17/24 11:16	BRS	EPA 200.8 REV 5.4



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Jon Robert Handshy For Chenise Lambert-Sykes, Project Manager



Pace Analytical Services
WWW.PACELABS.COM

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT Park Hill School District		PROJECT NUMBER 923386		PROJECT LOCATION Park Hill High School		PURCHASE ORDER # PHHS2324		3 ANALYSIS REQUESTED		4 (FOR LAB USE ONLY)	
ADDRESS 9501 N. Seymour Ave.		PHONE NUMBER 8163596731		E-MAIL KahlerJ@parkhill.k12.mo.us		DATE SHIPPED 7/8/2024		☒ DW Lead ☒ Turb Check		LOGIN # <u>HG01784</u> LOGGED BY: <u>MK</u> CLIENT: <u>Park Hill School District</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____	
CITY STATE ZIP Kansas City, MO 64153		SAMPLER (PLEASE PRINT) Jay Hurst		SAMPLER'S SIGNATURE 		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWBL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL- OIL SO- SOIL SOL- SOLID					
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB	COMP	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED			REMARKS
386-PHHS- 28R		7/3/2024	1041	X		DW	1	6	X		
386-PHHS- 29R		7/3/2024	1047	X		DW	1	6	X		
386-PHHS- 64R		7/3/2024	1053	X		DW	1	6	X		
386-PHHS- 90R		7/3/2024	1058	X		DW	1	6	X		
386-PHHS- 176R		7/3/2024	1007	X		DW	1	6	X		
386-PHHS- 178R		7/3/2024	1110	X		DW	1	6	X		
386-PHHS-		7/3/2024		X		DW	1	6	X		
386-PHHS-		7/3/2024		X		DW	1	6	X		
386-PHHS-		7/3/2024		X		DW	1	6	X		
386-PHHS-		7/3/2024		X		DW	1	6	X		
386-PHHS-		7/3/2024		X		DW	1	6	X		
386-PHHS-		7/3/2024		X		DW	1	6	X		
386-PHHS-		7/3/2024		X		DW	1	6	X		
CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER											
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may <u>NOT</u> be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____							
7 RELINQUISHED BY: (SIGNATURE) 		DATE 7/8/24	TIME 1130 AM	RECEIVED BY: (SIGNATURE) 				DATE 7-10-24	TIME 10:25	8 COMMENTS: (FOR LAB USE ONLY)	
RELINQUISHED BY: (SIGNATURE)		DATE	TIME	RECEIVED BY: (SIGNATURE)				DATE	TIME	SAMPLE TEMPERATURE UPON RECEIPT <u>22</u> °C	
RELINQUISHED BY: (SIGNATURE)		DATE	TIME	RECEIVED BY: (SIGNATURE)				DATE	TIME	CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE	



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

August 23, 2024

Jeremie Kahler
Park Hill School District
9501 N. Seymour Ave
MO, MO 64153

RE: 923386-Park Hill High School

Dear Jeremie Kahler:

Please find enclosed the analytical results for the **2** sample(s) the laboratory received on **8/12/24 9:30 am** and logged in under work order **HH02219**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read 'Chenise Lambert-Sykes'.

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com



SAMPLE RECEIPT CHECK LIST

Items not applicable will be marked as in compliance

Work Order HH02219

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



ANALYTICAL RESULTS

Sample: HH02219-01
Name: 386-PHHS-136A
Matrix: Drinking Water - Grab

Sampled: 08/06/24 07:46
Received: 08/12/24 09:30
PO #: PHHS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		08/21/24 09:59	1	1.00	08/21/24 15:03	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------

Sample: HH02219-02
Name: 386-PHHS-136B
Matrix: Drinking Water - Grab

Sampled: 08/06/24 07:46
Received: 08/12/24 09:30
PO #: PHHS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	< 1.00	ug/L		08/21/24 09:59	1	1.00	08/21/24 15:04	BRS	EPA 200.8 REV 5.4
------	--------	------	--	----------------	---	------	----------------	-----	-------------------



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050

Certified by: Chenise Lambert-Sykes, Project Manager





CHAIN OF CUSTODY RECORD
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

QUALTRAX 3219 REV 5



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

September 20, 2024

Jeremie Kahler
Park Hill School District
9501 N. Seymour Ave
MO, MO 64153

RE: 923386-Park Hill High School

Dear Jeremie Kahler:

Please find enclosed the analytical results for the **1** sample(s) the laboratory received on **9/12/24 9:35 am** and logged in under work order **HI02322**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read 'Chenise Lambert-Sykes'.

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com



SAMPLE RECEIPT CHECK LIST

Items not applicable will be marked as in compliance

Work Order HI02322

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

ANALYTICAL RESULTS

Sample: HI02322-01

Name: 386-PHHS-182R

Matrix: Drinking Water - Grab

Sampled: 09/11/24 07:16

Received: 09/12/24 09:35

PO #: PHHS2324

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Total Metals - PIA

Lead	4.40	ug/L		09/18/24 12:42	1	1.00	09/18/24 19:12	BRS	EPA 200.8 REV 5.4
------	------	------	--	----------------	---	------	----------------	-----	-------------------



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050

Certified by: Chenise Lambert-Sykes, Project Manager



