J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing

1775 Expressway Drive North
Hauppauge, NY 11788
631.584.5492
Fax: 631.584.3395
www.jcbroderick.com

September 12, 2025

Mr. Severino Fasulo
Syosset Central School District
99 Pell Lane
Syosset, New York 11791

Re: **Lead Testing in School Drinking Water**
Remedial Action Plan
2023 Compliance 10 NYCRR Subpart 67-4

JCB#: **23-53856-2**

Dear Mr. Fasulo:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 5 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead in Water Remediation Plan
Attachment 2: Outlet Inventory and Lead Testing Results
Attachment 3: Laboratory Analytical Reports
Attachment 4: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.

Sincerely,

Bryan Ezelius
J C Broderick & Associates, Inc.

Attachment 1:

Lead in Water Remediation Plan

J.C. Broderick & Associates, Inc.
Environmental Consulting & Testing
1775 Expressway Drive North
Hauppauge, New York 11788
631.584.5492 fax 631.584.3395

Lead in Water Remediation Plan

Section 67-4.4 Response of the New York State Department of Health (NYS DOH) Title 10 of the Official Compilation of the Codes, Rules and Regulations of the State of New York requires:

If the lead concentration of water at an outlet exceeds the action level, the school shall:
(a) prohibit use of the outlet until:
(1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and
(2) test results indicate that the lead levels are at or below the action level;

As historical sampling results have indicated, the concentrations of lead are more likely attributable to the individual fixtures and/or their immediately adjoining plumbing, and not with the building-wide plumbing. Based upon this information, the following remedial steps are recommended:

Step 1A: Potable Outlets (Outlets intended to be used for drinking/cooking)

Immediately remove the fixture from service. If necessary, provide an adequate supply of potable water for drinking/cooking to this location at no cost to the occupants. If an outlet is seldomly used or is unnecessary, the district may consider permanent removal of the outlet and capping of its supply line.

Step 1B: Non-Potable Outlets (Outlets not intended for drinking/cooking)

See Step 1A OR Placard the outlet for non-drinking use. Signs must be clearly visible and in close proximity to the affected outlet. Example signage is provided at: https://www.health.ny.gov/environmental/water/drinking/lead/docs/donotdrinksigns_lead .pdf.

Do not use for drinking

Hand washing only

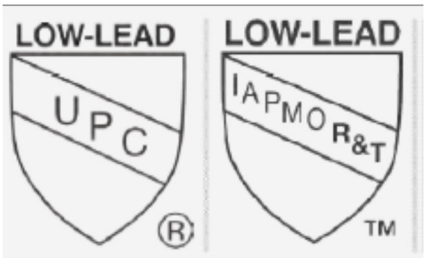

Step 2: Service & Repair or Outlet Replacement

The school district's plumber should evaluate the outlet to determine if any components require service or repair. Depending on the extent of service/repair necessary, age of the fixture, and or overall costs, the district may consider replacing the outlet entirely. Any newly installed components shall be certified lead free. (i.e. NSF/ANSI 61, NSF/ANSI-273). If servicing involves installing/replacing a point-of-use filtration system, this filter shall be certified for its lead reduction capability (i.e. NSF/ANSI 53). Follow all manufacturer's instructions for all component installations. OUTLET RESTRICTIONS MUST REMAIN IN PLACE UNTIL SATISFACTORY TEST RESULTS ARE RECEIVED. See Step 3.

Step 3: Retesting & Return to Service

Schedule a retest of the outlet. Outlet restrictions must remain in place until lead testing results at or below the action level are received. Once satisfactory results are received, the outlet may be returned to normal service. Note: It is recommended that "Do Not Drink" signage remain in place for all non-potable and non-applicable outlet types.

Attachment 2:

Outlet Inventory and Lead Testing Results

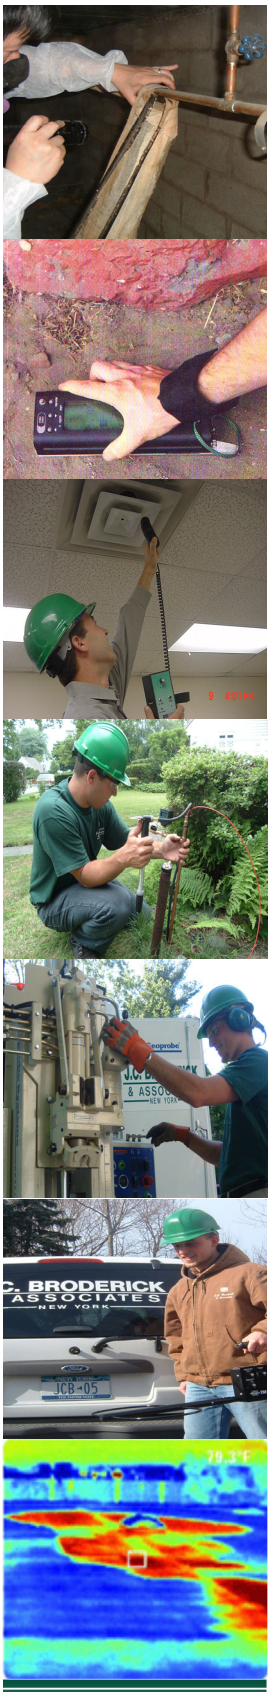

J.C. Broderick & Associates, Inc.
Environmental Consulting & Testing
1775 Expressway Drive North
Hauppauge, New York 11788
631.584.5492 fax 631.584.3395

Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Syosset Central School District

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0001	**Custodial Lounge Head Office Bathroom**	2360	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0002	**Custodial Lounge**	2362	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0003	**S03**	2364	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0004	**S03**	2364	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0005	**Men's Bathroom Adjacent S03**	2365	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0006	**S02**	2367	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0007	**S01**	2371	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0008	**S01**	2371	Water Fountain-No Chiller	Potable	**5/31/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0009	**Band Room**	2376	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0010	**HE 2 Bathroom**	2382	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0011	**HE 2**	2381	Home Economics Faucet (Cold)	Potable	**5/31/2025**	**1.9**			Result Below Action Level Continue O&M
SCSD-0012	**HE 2**	2381	Home Economics Faucet (Cold)	Potable	**5/31/2025**	**1.9**			Result Below Action Level Continue O&M
SCSD-0013	**HE 3**	2380	Home Economics Faucet (Cold)	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0014	**HE 3**	2380	Home Economics Faucet (Cold)	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0015	**HE 3**	2380	Home Economics Faucet (Cold)	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0016	**HE 3**	2380	Home Economics Faucet (Cold)	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service RFI = Removed from Inventory

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0017	**HE 3**	2380	Home Economics Faucet (Cold)	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0018	**Auditorium Corridor**	2340	Bottle Fill Station	RFI					Outlet Permanently Removed
SCSD-0019	**Auditorium Corridor**	2340	Water Cooler	RFI					Outlet Permanently Removed
SCSD-0020	**Women's Bathroom B6**	2344	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0021	**Women's Bathroom B6**	2344	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0022	**Men's Bathroom Custodial Closet**	2334A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0023	**Men's Bathroom**	2334	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0024	**Art Room**	2251	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0025	**Art Room**	2251	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0026	**Photography Room**	2250	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0027	**Photography Room**	2250	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0028	**Photography Room**	2250	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0029	**Dark Room**	2249	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0030	**Art Room**	2245	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0031	**Art Room**	2245	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0032	**Art Room**	2245	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0033	**Art Room**	2245	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0034	**Art Room**	2245	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0035	**Art Room**	2245	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0036	**Chorus Girl's Bathroom (Left)**	2353	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0037	**Chorus Men's Room (Right)**	2352	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0038	**Chemical Storage**	2348	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0039	**Corridor In Front Of 1st Floor Cafeteria**	1001	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0040	**Corridor In Front Of 1st Floor Cafeteria**	1001	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0041	**Cafeteria East Office/Snack Area**	2244A	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0042	**Cafeteria East**	2244	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0043	**Cafeteria East**	2244	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0044	**Cafeteria East Custodial Closet**	2243	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0045	**Serving Area East**	2240	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**9.3**	8/13/2025	4.3	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0046	**Kitchen**	2242	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**1.2**			Result Below Action Level Continue O&M
SCSD-0047	**Kitchen**	2242	Hand Wash Only	Non-Potable	**5/31/2025**	**2.7**			Result Below Action Level Continue O&M
SCSD-0048	**Kitchen**	2242	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**3.5**			Result Below Action Level Continue O&M
SCSD-0049	**Kitchen**	2242	Ice Machine	Potable	**5/31/2025**	**3.0**			Result Below Action Level Continue O&M
SCSD-0050	**Kitchen**	2242	Pasta Pot/Steam Kettle	RFI					Outlet Permanently Removed
SCSD-0051	**Attached Hose**	2242	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0052	**Kitchen**	2242	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0053	**Kitchen**	2242	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0054	**Kitchen**	2242	Pasta Pot/Steam Kettle	Potable	**5/31/2025**	**2.1**			Result Below Action Level Continue O&M
SCSD-0055	**Kitchen**	2242	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0056	**Serving Area West**	2237	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**2.9**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0057	**Cafeteria West**	2234	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1448
SCSD-0058	**Cafeteria West**	2234	Water Cooler	RFI					Outlet Replaced by Sticker No. 1449
SCSD-0059	**Faculty Men's Bathroom**	2231	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0060	**Women's Faculty Bathroom**	2228	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0061	**Boy's Bathroom**	2084	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0062	**Boy's Bathroom**	2084	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0063	**Boy's Bathroom**	2084	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0064	**Boy's Bathroom**	2084	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0065	**Boy's Bathroom**	2084	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0066	**Art Office**	2075	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0067	**Men's Bathroom (now all gender restroom)**	2082A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0068	**Kitchen**	2082	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0069	**New Women's Faculty Bathroom (Former Room CD6**	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0070	**New Women's Faculty Bathroom (Former Room CD6**	2061	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0071	**New Men's Faculty Bathroom (Former Room CD4 Chorus**	2060	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0072	**Girl's Bathroom**	2081	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0073	**Girl's Bathroom**	2081	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0074	**Girl's Bathroom**	2081	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0075	**Girl's Bathroom**	2081	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0076	**Girl's Bathroom**	2081	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0077	**Room C3A**	2067A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0078	**Year Book Room**	2067B	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0079	**Corridor From Room 243 To Room 230**	2058	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0080	**Corridor D Wing to Cafeteria**	2045	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1450
SCSD-0081	**Corridor D Wing to Cafeteria**	2045	Water Cooler	RFI					Outlet Replaced by Sticker No. 1451
SCSD-0082	**Art Room**	2057	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0083	**Art Room**	2057	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0084	**Art Room**	2052	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0085	**Art Room**	2052	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0086	**Room 217 Office**	2023B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0087	**Room 217 Office**	2023B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0088	**Room 217 Office**	2023B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0089	**Corridor Room D6A to D10 o/s 105B Office**	2033	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1452
SCSD-0090	**Corridor Room D6A to D10 o/s 105B Office**	2033	Water Cooler	RFI					Outlet Replaced by Sticker No. 1453
SCSD-0091	**105B**	2032	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0092	**Women's Bathroom (all-gender restroom)**	2023A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0093	**107 Closet**	2021	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0094	**Room 215**	2020	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0095	**Room 215**	2020	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0096	**Room 215**	2020	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0097	**Room 215**	2020	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0098	**Room 215**	2020	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0099	**Room D4A**	2014B	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0100	**Room 206**	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0101	**E104**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0102	**E104**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0103	**E104**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0104	**E104**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0105	**E104**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0106	**E104**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0107	**E104**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0108	**E104**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0109	**E104**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0110	**E103**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0111	**E103**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0112	**E103**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0113	**E103**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0114	**E103**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0115	**E103**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0116	**E103**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0117	**E103**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0118	**E103**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0119	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0120	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0121	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0122	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0123	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0124	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0125	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0126	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0127	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0128	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0129	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0130	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0131	**E99**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0132	**Corridor (E90's)**	NA	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1513
SCSD-0133	**Corridor (E90's)**	NA	Water Cooler	RFI					Outlet Replaced by Sticker No. 1514
SCSD-0134	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0135	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0136	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0137	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0138	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0139	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0140	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0141	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0142	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0143	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0144	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0145	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0146	**E98**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0147	**E97**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0148	**E97**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0149	**E97**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0150	**Science Storage Adj. to E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0151	**Science Storage Adj. to E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0152	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0153	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0154	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0155	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0156	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0157	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0158	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0159	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0160	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0161	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0162	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0163	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0164	**E96**	NA	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0165	**Corridor (E30's)**	NA	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1454
SCSD-0166	**Corridor (E30's)**	NA	Water Cooler	RFI					Outlet Replaced by Sticker No. 1453
SCSD-0167	**127**	2130	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0168	**127**	2130	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0169	**127**	2130	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0170	**Room E10**	2098	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0171	**Room E10**	2098	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0172	**Room E10**	2098	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0173	**Room E10**	2098	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0174	**Room E10**	2098	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0175	**Room E10**	2098	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0176	**Room E10**	2098	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0177	**Passage From E9-E10**	2098B	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0178	**Room E9**	2098A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0179	**Room E9**	2098A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0180	**Room E9**	2098A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0181	**Room E9**	2098A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0182	**Room E9**	2098A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0183	**Room E9**	2098A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0184	**Room E9**	2098A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0185	**120 Storage**	2133	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0186	**120 Storage**	2133	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0187	**120 Storage**	2133	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0188	**Room E8**	2099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0189	**Room E8**	2099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0190	**Room E8**	2099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0191	**Room E8**	2099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0192	**Room E8**	2099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0193	**Room E8**	2099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0194	**Room E8**	2099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0195	**Passage From E7-E8**	2099A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0196	**Room E7**	2102	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0197	**Room E7**	2102	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0198	**Room E7**	2102	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0199	**Room E7**	2102	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0200	**Room E7**	2102	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0201	**Room E7**	2102	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0202	**Room E7**	2102	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0203	**Room E6**	2103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0204	**Room E6**	2103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0205	**Room E6**	2103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0206	**Room E6**	2103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0207	**Room E6**	2103	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0208	**Corridor E6-E11**	2131	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0209	**Corridor E6-E11**	2131	Water Cooler	Potable	**5/31/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0210	**E Wing Downstairs Men's Room**	2106	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0211	**E Wing Downstairs Men's Room**	2106	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0212	**E Wing Downstairs Men's Room**	2106	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0213	**Slop Sink Area**	2107	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0214	**E Wing Downstairs Girl's Bathroom**	2109	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0215	**E Wing Downstairs Girl's Bathroom**	2109	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0216	**E Wing Downstairs Girl's Bathroom**	2109	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0217	**Copy Room**	2112	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0218	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0219	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0220	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0221	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0222	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0223	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0224	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0225	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0226	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0227	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0228	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0229	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0230	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0231	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0232	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0233	**Room E5**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0234	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0235	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0236	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0237	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0238	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0239	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0240	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0241	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0242	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0243	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0244	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0245	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0246	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0247	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0248	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0249	**Room E4**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0250	**Basement Stairwell Adjacent 130**	2115	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0251	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0252	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0253	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0254	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0255	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0256	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0257	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0258	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0259	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0260	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0261	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0262	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0263	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0264	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0265	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0266	**Room E3**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0267	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0268	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0269	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0270	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0271	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0272	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0273	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0274	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0275	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0276	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0277	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0278	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0279	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0280	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0281	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0282	**Room E2**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0283	**Faculty Lounge**	2119	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0284	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0285	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0286	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0287	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0288	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0289	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0290	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0291	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0292	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0293	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0294	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0295	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0296	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0297	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0298	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0299	**Faculty Lounge Phone Booth 2**	2121	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0300	**Corridor E1-E5**	2136	Water Fountain-No Chiller	Potable	**5/31/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0301	**Faculty Lounge Phone Booth 1**	2120	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0302	**130**	2116	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0303	**Science Office**	2125	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**2.1**			Result Below Action Level Continue O&M
SCSD-0304	**Room E22**	3395	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0305	**Room E22**	3395	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0306	**Room E22**	3395	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0307	**Room E22**	3395	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0308	**Room E21**	3396	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0309	**Room E21**	3396	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0310	**Room E21**	3396	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0311	**Room E21 Prep Room**	3396A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0312	**Room E21 Prep Room**	3396A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0313	**E Wing Men's Faculty Bathroom**	3419B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0314	**Faculty Room (Interior Wall Removed)**	3426A	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**2.0**			Result Below Action Level Continue O&M
SCSD-0315	**E Wing Boy's Bathroom**	3405	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0316	**E Wing Boy's Bathroom**	3405	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0317	**E Wing Boy's Bathroom**	3405	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0318	**E Wing Custodial Closet**	3405A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0319	**Corridor E12-E15**	3431	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0320	**Corridor E12-E15**	3431	Water Cooler	Potable	**5/31/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0321	**E Wing Girl's Bathroom**	3407	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0322	**E Wing Girl's Bathroom**	3407	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0323	**E Wing Girl's Bathroom**	3407	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0324	**E Wing Upstairs Faculty Women's Bathroom**	3422B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0325	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0326	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0327	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0328	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0329	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0330	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0331	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0332	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0333	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0334	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0335	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0336	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0337	**Room E12**	3415	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0338	**Room E12 Closet**	3415A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0339	**Room E11**	3416	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0340	**Room E11**	3416	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0341	**Room E11**	3416	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0342	**Room E11**	3416	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0343	**Room E11A**	3417	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0344	**Room E11A**	3417	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0345	**Science Copy Room**	2132	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0346	**Inside Fume Hood**	2099	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0347	**Inside Fume Hood**	2113	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0348	**Inside Fume Hood**	2114	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0349	**Inside Fume Hood**	2117	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0350	**Inside Fume Hood**	2118	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0351	**Room B6A**	2224	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0352	**Room B6A**	2224	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0353	**Room B6A**	2224	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0354	**Room B6A**	2224	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0355	**Room B6A**	2224	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0356	**Room B12A AV Tech Large Office**	2203	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed

OOS= Out of Service RFI = Removed from Inventory

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0357	**Custodial Closet**	2211	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0358	**Room B6B**	2222	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0359	**Room B6B**	2222	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0360	**Room B6B**	2222	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0361	**Room B6B**	2222	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0362	**Room B6B**	2222	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0363	**Auditorium Closet**	2219	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0364	**Auditorium Closet**	2219	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0365	**Auditorium Closet**	2219	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0366	**Auditorium Closet**	2219	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0367	**Auditorium Closet**	2219	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0368	**B Wing Boy's Bathroom**	2213	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0369	**B Wing Boy's Bathroom**	2213	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0370	**B Wing Boy's Bathroom**	2213	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0371	**B Wing Boy's Bathroom**	2213	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0372	**B-Wing Single Toilet Room**	2213A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0373	**Faculty Women's Bathroom**	2210	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0374	**Faculty Women's Bathroom**	2210	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0375	**Room B3A**	2194A	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0376	**Library Office**	2189	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**2.3**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0377	**Quarter Mile Corridor South**	2191	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0378	**Quarter Mile Corridor South**	2191	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0379	**Nurse Bathroom**	2269	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0380	**Nurse's Office**	2274	Nurse's Office Sink	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0381	**Nurse's Office**	2274	Nurse's Office Sink	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0382	**Nurse Storage Room**	2274A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0383	**Main Hall Copy Room**	2265B	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**1.6**			Result Below Action Level Continue O&M
SCSD-0384	**Attendance Office Kitchen/Copy Room**	2272	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0385	**Main Entrance Corridor**	2257	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0386	**Main Entrance Corridor**	2257	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0387	**Main Entrance Women's Room**	2258	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0388	**Main Entrance Men's Room**	2259	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0389	**Quarter Mile Corridor South**	2191	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0390	**Quarter Mile Corridor South**	2191	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0391	**Business Education Office**	2281	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0392	**Room A14 (Alarmed)**	2285	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0393	**Guidance Office Kitchen G10**	2178A	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**2.8**			Result Below Action Level Continue O&M
SCSD-0394	**Men's Faculty A Wing Bathroom**	2170A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0395	**Men's Faculty A Wing Bathroom**	2170A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0396	**Men's Faculty A Wing Bathroom**	2170A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0397	**A Wing Custodial Closet**	2168	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0398	**Women's Faculty A Wing Bathroom**	2170	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0399	**A Wing Corridor**	2147	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0400	**A Wing Corridor**	2147	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0401	**Custodial Office Bathroom**	2150	Kitchen Faucet (Cold)	RFI					Outlet Permanently Removed
SCSD-0402	**Girl's Bathroom A Wing**	2167	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0403	**Girl's Bathroom A Wing**	2167	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0404	**Coach's Office Bathroom**	2295A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0405	**Courtyard o/s 2178**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0406	**Courtyard o/s 2099**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0407	**Courtyard Greenhouse o/s 2052**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0408	**Courtyard Greenhouse o/s 2052**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0409	**Courtyard o/s 2117**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0410	**Courtyard o/s 2190A**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0411	**Courtyard o/s 2188**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0412	**Courtyard o/s 2256**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0413	**Exterior o/s 2285**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0414	**Exterior o/s 2262**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0415	**Exterior o/s 2332**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0416	**Exterior o/s 2332**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0417	**Exterior o/s 2319**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0418	**Exterior o/s E96**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0419	**Exterior o/s 2017**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0420	**Exterior o/s 2019**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0421	**Exterior o/s 2085**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0422	**Exterior o/s 2351**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0423	**Exterior o/s 2362**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0424	**Exterior o/s 2380**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0425	**Exterior o/s 2340**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0426	**Exterior o/s 2257**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1214	**Main Gym Lobby Men's Bathroom**	2302	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1215	**Girl's Locker Room**	2331	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1216	**Girl's Locker Room**	2331	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1217	**Girl's Locker Room**	2331	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1218	**Girl's Locker Room**	2331	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1219	**Girl's Locker Room**	2331	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1220	**Girl's Locker Room**	2331	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1221	**Girl's Locker Room**	2331	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1222	**Girl's Locker Room**	2331	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1223	**Girl's Locker Room Custodial Closet**	2331B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1224	**Girl's Locker Room**	2331	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1225	**Auxiliary Gym Electrical Equipment Room**	2329	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1226	**Auxiliary Gym**	2332	Water Fountain-No Chiller	Potable	**5/31/2025**	**3.9**			Result Below Action Level Continue O&M
SCSD-1227	**Boy's Locker Room B2**	2306I	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1228	**Boy's Locker Room B4**	2306P	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1229	**Boy's Locker Room B3**	2306L	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1230	**Boy's Pool Locker Room**	2312	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1231	**Corridor Between Gym & Locker Rooms**	2308	Bottle Fill Station	RFI					Outlet Replaced with Sticker No. 1515
SCSD-1232	**Corridor Between Gym & Locker Rooms**	2308	Water Cooler	RFI					Outlet Replaced with Sticker No. 1516
SCSD-1233	**Boy's Locker Room B1**	2306B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1234	**Main Gym Lobby Women's Bathroom**	2303	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1235	**Exit Vestibule Bathroom Adjacent Athletic Director 1**	2314	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1236	**Laundry Room**	2315	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1237	**Laundry Room**	2319	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1238	**Men's Bathroom Near Pool**	2322A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1239	**Girl's Pool Bathroom**	2322B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1278	**Boy's Pool Locker Room Shower/Bathroom**	2327A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1279	**Main Gym**	2293	Water Fountain-No Chiller	RFI					Outlet Replaced by Sticker No. 1456
SCSD-1280	**Trainer's Office and Part of Locker Room share a Space ID**	2306A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1286	**Trainer's Office and Part of Locker Room share a Space ID**	2306A	Ice Machine	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1287	**Trainer's Office and Part of Locker Room share a Space ID**	2306A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1288	**Main Gym**	2293	Water Fountain-No Chiller	Potable	**5/31/2025**	**2.5**			Result Below Action Level Continue O&M
SCSD-1348	**Boy's Bathroom by Room 19**	2064	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1378	**Auxiliary Gym**	2332	Water Fountain-No Chiller	Potable	**5/31/2025**	**102**	8/13/2025	52.5	Removed From Service, Pending Remediation
SCSD-1380	**Room D3A Office**	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1381	**Room D3A Office**	2013	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1383	**Men's Bathroom (Fitness Center); Tempered**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1384	**Corridor (Fitness Center)**	NA	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1385	**Corridor (Fitness Center)**	NA	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1386	**Corridor (Fitness Center)**	NA	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1387	**Women's Bathroom (Fitness Center); Tempered**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1388	**Men's Bathroom (Fitness Center)**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1389	**Women's Bathroom (Fitness Center)**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1390	**Custodial Closet (Fitness Center)**	NA	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1391	**Admin Office (Fitness Center)**	NA	Kitchen Faucet (Cold)	Potable	**5/31/2025**	**1.8**			Result Below Action Level Continue O&M
SCSD-1392	**Fitness Center**	NA	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1393	**Fitness Center**	NA	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1394	**Fitness Center**	NA	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1395	**Girls' Locker Room (Fitness Center); Tempered**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1396	**Girls' Locker Room (Fitness Center); Tempered**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service RFI = Removed from Inventory

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1397	**Girls' Locker Room (Fitness Center); Tempered**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1398	**Girls' Locker Room (Fitness Center)**	NA	Shower Head	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1399	**Girls' Locker Room (Fitness Center)**	NA	Shower Head	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1400	**Girls' Locker Room (Fitness Center)**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1401	**Boys' Locker Room (Fitness Center)**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1402	**Boys' Locker Room (Fitness Center)**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1403	**Boys' Locker Room (Fitness Center)**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1404	**Boys' Locker Room (Fitness Center)**	NA	Shower Head	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1405	**Boys' Locker Room (Fitness Center)**	NA	Shower Head	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1406	**Boys' Locker Room (Fitness Center)**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1407	**Exterior Girls' Bathroom (Fitness Center)**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1408	**Exterior Girls' Bathroom (Fitness Center)**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1409	**Exterior Girls' Bathroom (Fitness Center)**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1410	**Exterior Boys' Bathroom (Fitness Center)**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1411	**Exterior Boys' Bathroom (Fitness Center)**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1412	**Exterior Boys' Bathroom (Fitness Center)**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1413	**Exterior o/s Fitness Center**	NA	Bottle Fill Station	RFI					Outlet Permanently Removed
SCSD-1414	**Exterior o/s Fitness Center**	NA	Water Fountain-No Chiller	RFI					Outlet Permanently Removed
SCSD-1448	**Cafeteria West**	2234	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1449	**Cafeteria West**	2234	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Syosset High School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1450	**Corridor D Wing to Cafeteria**	2045	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1451	**Corridor D Wing to Cafeteria**	2045	Water Cooler	Potable	**5/31/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1452	**Corridor Room D6A to D10 o/s 105B Office**	2033	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1453	**Corridor Room D6A to D10 o/s 105B Office**	2033	Water Cooler	Potable	**5/31/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1454	**Corridor E30's**	N/A	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1455	**Corridor E30's**	N/A	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1456	**Main Gym**	2293	Water Fountain-No Chiller	Potable	**5/31/2025**	**1.2**			Result Below Action Level Continue O&M
SCSD-1513	**Corridor (E90's)**	NA	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1514	**Corridor (E90's)**	NA	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1515	**Corridor Between Gym & Locker Rooms**	2308	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1516	**Corridor Between Gym & Locker Rooms**	2308	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1777	**Exterior of Barn**	N/A	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1778	**Exterior of Barn**	N/A	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1779	**Exterior o/s Fitness Center**	N/A	Bottle Fill Station	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1780	**Exterior o/s Fitness Center**	N/A	Water Cooler	Potable	**5/31/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

South Woods Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0427	**Gym Girl's Locker Room**	2091	Water Fountain-No Chiller	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0428	**Gym Girl's Locker Room**	2091	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0429	**Gym Girl's Locker Room**	2091	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0430	**Gym Girl's Locker Room Custodial Storage**	2091A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0431	**Gym Girl's Coach Office Bathroom**	2093A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0432	**Gym Boy's Locker Room**	2095	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0433	**Gym Boy's Locker Room**	2095	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0434	**Gym Boy's Locker Room Coach Office Bathroom**	2094A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0435	**Corridor North Cafeteria to Boy's Bathroom**	2143	Bottle Fill Station	Potable	**6/6/2025**	**1.4**			Result Below Action Level Continue O&M
SCSD-0436	**Corridor North Cafeteria to Boy's Bathroom**	2143	Water Cooler	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0437	**Boy's Bathroom**	3201	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0438	**Boy's Bathroom**	3201	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0439	**Boy's Bathroom**	3201	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0440	**Custodial Closet O**	3202	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0441	**Girl's Bathroom**	3200	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0442	**Girl's Bathroom**	3200	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0443	**Girl's Bathroom**	3200	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0444	**Corridor Room 200 to 210**	3192	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1517
SCSD-0445	**Corridor Room 200 to 210**	3192	Water Cooler	RFI					Outlet Replaced by Sticker No. 1518
SCSD-0446	**Art Room**	3191	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

South Woods Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0447	**Art Room**	3191	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0448	**Art Room**	3191	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0449	**Art Room**	3191	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0450	**Art Room**	3189	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0451	**Art Room**	3189	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0452	**Art Room**	3189	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0453	**Art Room**	3189	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0454	**Art Room**	3189	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0455	**Art Room**	3189	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0456	**Room 204**	3187	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0457	**Room 204**	3187	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0458	**Room 204**	3187	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**1.5**			Result Below Action Level Continue O&M
SCSD-0459	**Room 204**	3187	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0460	**Room 204**	3187	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**2.2**			Result Below Action Level Continue O&M
SCSD-0461	**Corridor Room 200 to 210**	3192	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0462	**Room 202**	3186	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**10.1**	9/6/2025	1.2	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0463	**Room 202**	3186	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0464	**Room 202**	3186	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0465	**Room 202**	3186	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**1.3**			Result Below Action Level Continue O&M
SCSD-0466	**Room 202**	3186	Home Economics Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

South Woods Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0467	**Art Room**	3185	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0468	**Art Room**	3185	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0469	**Art Room**	3185	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0470	**Art Room**	3185	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0471	**Art Room**	3185	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0472	**Art Room**	3185	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0473	**Men's Faculty Bathroom**	2131	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0474	**Men's Faculty Bathroom**	2131	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0475	**Faculty Women's Bathroom**	2129	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0476	**Faculty Women's Bathroom**	2129	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0477	**Main Office Kitchen**	2165	Kitchen Faucet (Cold)	RFI					Outlet Replaced by Sticker No. 1440
SCSD-0478	**Corridor Main Entrance to Exterior Exit by Copy Room**	2157	Bottle Fill Station	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0479	**Corridor Main Entrance to Exterior Exit by Copy Room**	2157	Water Cooler	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0480	**Nurse's Office Bathroom**	2175	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0481	**Nurse's Sick Room**	2173	Nurse's Office Sink	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0482	**Nurse's Sick Room Side Room**	2173B	Nurse's Office Sink	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0483	**Girl's Restroom**	2041	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0484	**Boy's Restroom**	2040	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0485	**Women's Faculty Restroom**	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0486	**Women's Faculty Restroom**	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

South Woods Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0487	**Women's Faculty Restroom**	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0488	**Custodial Closet**	2036	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0489	**Faculty Men**	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0490	**Faculty Men**	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0491	**Faculty Men**	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0492	**Corridor Library to Room 102**	2060	Water Cooler	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0493	**Room 114**	2047	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0494	**Room 114**	2047	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0495	**Room 114**	2047	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0496	**Room 114**	2047	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0497	**Corridor Library to Room 102**	2060	Water Fountain-No Chiller	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0498	**Room 113**	2049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0499	**Room 113**	2049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0500	**Room 116**	2053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0501	**Room 116**	2053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0502	**Room 116**	2053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0503	**Room 116**	2053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0504	**Room 115**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0505	**Room 115**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0506	**Room 115**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

South Woods Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0507	**Room 116 Prep Room**	2055	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0508	**Room 118**	2059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0509	**Room 118**	2059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0510	**Room 118**	2059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0511	**Room 118**	2059	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0512	**Room 120**	2065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0513	**Room 120**	2065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0514	**Room 120**	2065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0515	**Room 120**	2065	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0516	**Room 120 Prep Room**	2066	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0517	**Room 119**	2061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0518	**Room 119**	2061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0519	**Room 119**	2061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0520	**Room 122**	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0521	**Room 122**	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0522	**Room 122**	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0523	**Room 122**	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0524	**Room 122**	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0525	**Room 122**	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0526	**Room 122**	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

South Woods Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0527	**Room 122**	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0528	**Room 122**	2067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0529	**Corridor Library to Room 102**	2060	Bottle Fill Station	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0530	**Corridor Library to Room 102**	2060	Water Cooler	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0531	**Custodial Closet by A2**	NA	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0532	**Boys' Bathroom by A2**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0533	**Boys' Bathroom by A2**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0534	**Boys' Bathroom by A2**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0535	**Girls' Bathroom by A2**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0536	**Girls' Bathroom by A2**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0537	**Girls' Bathroom by A2**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0538	**Faculty Bathroom by A2**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0539	**Corridor by Locker Rooms**	NA	Water Cooler	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0540	**Corridor by Locker Rooms**	NA	Water Cooler	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0541	**Boy's Bathroom**	2100	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0542	**Boy's Bathroom**	2100	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0543	**Boy's Bathroom**	2100	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0544	**Girl's Bathroom**	2008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0545	**Girl's Bathroom**	2008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0546	**Girl's Bathroom**	2008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

South Woods Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0547	**Tech-shop room**	2111A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0548	**Tech-shop room**	2111A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0549	**Tech-shop room**	2111A	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0550	**Room 129A Wood Shop**	2099A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0551	**Gym Boy's Locker Room Coach Office**	2095B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0552	**Gym Boy's Locker Room Coach Office**	2095B	Ice Machine	RFI					Outlet Replaced by Sticker No. 1459
SCSD-0553	**Psychological Conference Room & Personnel Services**	2112B	Water Fountain-No Chiller	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0554	**Room 133 Chorus**	2103	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0555	**Head Custodial Office Bathroom**	2125A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0556	**Basement Bathroom in 0009**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0557	**Basement Garage Open Area**	0020	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0558	**Corridor North Cafeteria to Boy's Bathroom**	2143	Water Fountain-No Chiller	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0559	**South Cafeteria**	2132	Bottle Fill Station	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0560	**South Cafeteria**	2132	Water Cooler	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0561	**Kitchen**	2136	Kitchen Faucet (Cold)	Potable	**6/6/2025**	**1.1**			Result Below Action Level Continue O&M
SCSD-0562	**Kitchen**	2136	Kitchen Faucet (Cold)	RFI					Outlet Replaced by Sticker No.1457
SCSD-0563	**Kitchen**	2136	Kitchen Faucet (Cold)	RFI					Outlet Replaced by Sticker No.1458
SCSD-0564	**Kitchen**	2136	Kitchen Faucet (Cold)	Potable	**6/6/2025**	**1.5**			Result Below Action Level Continue O&M
SCSD-0565	**Kitchen**	2136	Pasta Pot/Steam Kettle	Potable	**6/6/2025**	**2330**	8/13/2025	479	Outlet Permanently Removed
SCSD-0566	**Kitchen**	2136	Ice Machine	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

South Woods Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0567	**Kitchen Pantry**	2136A	Hand Wash Only	Non-Potable	**6/6/2025**	**19.4**	8/13/2025	111	Removed From Service, Pending Remediation
SCSD-0568	**Kitchen Laundry Room Bathroom**	2138	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0569	**Kitchen Custodial Room**	2135	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0570	**Kitchen Custodial Room**	2135	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0571	**Kitchen Custodial Room**	2135	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0572	**North Cafeteria**	2142	Water Cooler	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0573	**Faculty Lounge**	2139	Kitchen Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0574	**Superintendent's Kitchen**	2179B	Kitchen Faucet (Cold)	Potable	**6/6/2025**	**1.2**			Result Below Action Level Continue O&M
SCSD-0575	**Courtyard o/s 2067**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0576	**Courtyard o/s 2128**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0577	**Walkway o/s 2095**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0578	**Exterior o/s 2139**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0579	**Exterior o/s 2111A**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0580	**Exterior o/s 2095**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0581	**Exterior o/s 2037**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0582	**Exterior o/s 2056**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0583	**Exterior o/s 2017**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1419	**Corridor Library to Room 102**	2060	Bottle Fill Station	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1420	**Corridor Library to Room 102**	2060	Water Cooler	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1421	**Main Entrance Corridor**	2157	Bottle Fill Station	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

South Woods Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1422	**Main Entrance Corridor**	2157	Water Cooler	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1423	**South Cafeteria**	2132	Bottle Fill Station	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1424	**South Cafeteria**	2132	Water Cooler	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1429	**Basement Open Storage/Copy Area**	010	Bottle Fill Station	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1430	**Basement Open Storage/Copy Area**	010	Water Cooler	Potable	**6/6/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1439	**Library**	2011	Kitchen Faucet (Cold)	Potable	**6/6/2025**	**4.9**			Result Below Action Level Continue O&M
SCSD-1440	**Main Office Kitchen**	2165	Kitchen Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1457	**Kitchen**	2136	Kitchen Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1458	**Kitchen**	2136	Kitchen Faucet (Cold)	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1459	**Gym Boy's Locker Room Coach Office**	2095B	Ice Machine	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1489	**Kitchen**	2136	Hand Wash Only	Non-Potable	**9/10/2025**	**4.8**			Result Below Action Level Continue O&M
SCSD-1517	**Corridor Room 200 to 210**	3192	Bottle Fill Station	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1518	**Corridor Room 200 to 210**	3192	Water Cooler	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1783	**North Cafeteria**	2142	Bottle Fill Station	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1784	**North Cafeteria**	2142	Water Cooler	Potable	**6/6/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Berry Hill Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0584	**Nurse's Bathroom**	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0585	**D3 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0586	**D4 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0587	**Girls' Bathroom by D5**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0588	**Girls' Bathroom by D5**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0589	**Girls' Bathroom by D5**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0590	**Girls' Bathroom by D5**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0591	**Custodial Closet by D5**	NA	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0592	**Corridor by D5**	NA	Water Cooler	RFI					Outlet Replaced by Sticker No. 1425
SCSD-0593	**Corridor by D5**	NA	Water Cooler	RFI					Outlet Replaced by Sticker No. 1426
SCSD-0594	**Boys' Bathroom by D5**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0595	**Boys' Bathroom by D5**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0596	**Boys' Bathroom by D5**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0597	**Boys' Bathroom by D5**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0598	**Room 10 ESL (Now C1)**	2049A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0599	**Room 9 (Now Room C2)**	2074	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0600	**Room 9 (Now Room C2)**	2074	Water Fountain-No Chiller	Potable	**6/2/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0601	**Room 8 (Now C3)**	2050	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0602	**Room 8 (Now C3)**	2050	Water Fountain-No Chiller	Potable	**6/2/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0603	**Room 7 (Now Room C4)**	2071	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Berry Hill Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0604	**Room 7 (Now Room C4)**	2071	Water Fountain-No Chiller	Potable	**6/2/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0605	**Room 6 (Now C5)**	2053	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0606	**Room 6 (Now C5)**	2053	Water Fountain-No Chiller	Potable	**6/2/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0607	**Room 5 (Now Room C6)**	2068	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0608	**Room 5 (Now Room C6)**	2068	Water Fountain-No Chiller	Potable	**6/2/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0609	**Room 4 (Now C7)**	2057	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0610	**Room 4 (Now C7)**	2057	Water Fountain-No Chiller	Potable	**6/2/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0611	**Room 4 Bathroom**	2058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0612	**Room 3 (Now C8)**	2065	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0613	**Room 3 (Now C8)**	2065	Water Fountain-No Chiller	Potable	**6/2/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0614	**Room 3 Bathroom**	2067	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0615	**Multi Purpose Room Corridor**	2063	Bottle Fill Station	Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0616	**Multi Purpose Room Corridor**	2063	Water Cooler	Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0617	**Multi Purpose Room Corridor**	2063	Hand Wash Only	Non-Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0618	**Multi Purpose Room Corridor**	2063	Hose Bib	Non-Potable	**6/2/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0619	**Multi-purpose Room**	2061	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0620	**Kitchen Room**	2063A	Kitchen Faucet (Cold)	Potable	**6/2/2025**	**1.2**			Result Below Action Level Continue O&M
SCSD-0621	**Corridor Coach's Office to Main Entrance**	2081	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1433
SCSD-0622	**Corridor Coach's Office to Main Entrance**	2081	Water Cooler	RFI					Outlet Replaced by Sticker No. 1434
SCSD-0623	**Men's Bathroom**	2044	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Berry Hill Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0624	**Women's Bathroom**	2043	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0625	**Library**	2039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0626	**Room E/Gym Office**	2034	Kitchen Faucet (Cold)	Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0627	**Room 11 (Now A1)**	2029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0628	**Young Gentlemen's Bathroom**	2027	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0629	**Young Gentlemen's Bathroom**	2027	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0630	**Young Gentlemen's Bathroom**	2027	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0631	**Young Gentlemen's Bathroom**	2027	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0632	**Custodial Closet F**	2028	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0633	**Young Ladies Bathroom**	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0634	**Young Ladies Bathroom**	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0635	**Young Ladies Bathroom**	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0636	**Young Ladies Bathroom**	2026	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0637	**Room 13 (Now A3)**	2024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0638	**Room 12 (Now A2)**	2022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0639	**Room 15 (Now A5)**	2020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0640	**Room 14 (Now A4)**	2018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0641	**Room 17 (Now A7)**	2014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0642	**Room 16 Closet**	2017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0643	**Corridor Room A7 (17) To Boiler Room**	2082	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1435

OOS= Out of Service **RFI = Removed from Inventory**

Berry Hill Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0644	**Corridor Room A7 (17) To Boiler Room**	2082	Water Cooler	RFI					Outlet Replaced by Sticker No. 1436
SCSD-0645	**Art Room**	2083	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0646	**Art Room**	2083	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0647	**Room 1 Bathroom**	2083A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0648	**Room 18 Bathroom**	2012	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0649	**Room 19 Bathroom**	2010	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0650	**Room 20 Bathroom**	2008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0651	**Room 2 Bathroom**	2085A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0652	**Courtyard o/s 2071**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0653	**Exterior o/s 2029**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0654	**Exterior o/s 2061**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0655	**Exterior o/s 2053**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0656	**Exterior o/s 2039**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1425	**Corridor by D5**	NA	Bottle Fill Station	Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1426	**Corridor by D5**	NA	Water Cooler	Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1433	**Corridor Coach's Office to Main Entrance**	2081	Bottle Fill Station	Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1434	**Corridor Coach's Office to Main Entrance**	2081	Water Cooler	Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1435	**Corridor**	2082	Bottle Fill Station	Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1436	**Corridor**	2082	Water Cooler	Potable	**6/2/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Village Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0657	**Kindergarten 17 Bathroom**	2010B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0658	**Kindergarten 17 (Now Room 12)**	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0659	**Kindergarten 17 (Now Room 12)**	2010	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0660	**Kindergarten 16 Bathroom**	2009A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0661	**Kindergarten 16 (Now Room 11)**	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0662	**Kindergarten 16 (Now Room 11)**	2009	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0663	**Room 15 (Now Room 13)**	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0664	**Room 15 (Now Room 13)**	2011	Water Fountain-No Chiller	RFI					Outlet Permanently Removed
SCSD-0665	**Room 14 (Now Room 10)**	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0666	**Room 14 (Now Room 10)**	2008	Water Fountain-No Chiller	RFI					Outlet Permanently Removed
SCSD-0667	**Room 13 (Now Room 14)**	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0668	**Room 13 (Now Room 14)**	2012	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0669	**Room 12 (Now Room 9)**	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0670	**Room 12 (Now Room 9)**	2007	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0671	**Room 18 Bathroom**	2005A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0672	**Room 19 Bathroom**	2004A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0673	**Room 20 Bathroom**	2003A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0674	**Room 21 Bathroom**	2001A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0675	**Corridor Multi Purpose Room to Library**	2045	Bottle Fill Station	Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0676	**Corridor Multi Purpose Room to Library**	2045	Water Cooler	Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Village Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0677	**Library Office**	2014A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0678	**Room 2 (Now Room 3)**	2016	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0679	**Room 2 (Now Room 3)**	2016	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0680	**Room 3 (Now Room 2)**	2017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0681	**Room 3 (Now Room 2)**	2017	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0682	**Room 4 (Now Room 1)**	2018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0683	**Room 4 (Now Room 1)**	2018	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0684	**Corridor Multi Purpose Room to Library**	2045	Bottle Fill Station	Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0685	**Corridor Multi Purpose Room to Library**	2045	Water Cooler	Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0686	**Unisex Bathroom**	2022B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0687	**Custodial Closet**	2033	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0688	**Nurse's Office**	2022D	Nurse's Office Sink	Potable	**5/29/2025**	**1.7**			Result Below Action Level Continue O&M
SCSD-0689	**Nurse's Office Bathroom**	2022C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0690	**Room 5 (Now Room 19)**	2023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0691	**Room 5 (Now Room 19)**	2023	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0692	**Coach's Office**	2032	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0693	**Music Room Bathroom**	2031A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0694	**Room 6 (Now Room 20)**	2024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0695	**Room 6 (Now Room 20)**	2024	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0696	**Room 7 (Now Room 21)**	2025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Village Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0697	**Room 7 (Now Room 21)**	2025	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0698	**Girl's Bathroom**	2029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0699	**Girl's Bathroom**	2029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0700	**Girl's Bathroom**	2029	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0701	**Room 8 (Now Room 22)**	2026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0702	**Room 8 (Now Room 22)**	2026	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0703	**Band/Orchestra Room Bathroom**	2035B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0704	**Band/Orchestra Room**	2035	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0705	**Boy's Bathroom**	2028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0706	**Boy's Bathroom**	2028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0707	**Boy's Bathroom**	2028	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0708	**Multi Purpose Room**	2047	Hand Wash Only	Non-Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0709	**Multi Purpose Room**	2047	Bottle Fill Station	Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0710	**Multi Purpose Room**	2047	Water Cooler	Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0711	**Kitchen**	2047A	Kitchen Faucet (Cold)	Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0712	**Multi Purpose Room**	2047	Hand Wash Only	Non-Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0713	**Room 26**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0714	**Room 26 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0715	**Room 27**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0716	**Room 27 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Village Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0717	**Boiler Room 2**	NA	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0718	**Room 35**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0719	**Room 35**	NA	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0720	**Room 35 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0721	**Room 28**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0722	**Room 28**	NA	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0723	**Room 28 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0724	**Room 34**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0725	**Room 34**	NA	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0726	**Room 34 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0727	**Room 29**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0728	**Room 29**	NA	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0729	**Room 29 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0730	**Room 33**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0731	**Room 33**	NA	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0732	**Room 33 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0733	**Room 30**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0734	**Room 30**	NA	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0735	**Room 30 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0736	**Room 32**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Village Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0737	**Room 32**	NA	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0738	**Room 32 Bathroom - tempered**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0739	**Room 31**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0740	**Room 31**	NA	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0741	**Room 31 Bathroom - tempered**	NA	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0742	**Faculty Lounge**	2038	Kitchen Faucet (Cold)	Potable	**5/29/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0743	**Faculty Lounge Bathroom**	2038B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0744	**Room 9 Art Room (Now Room 23)**	2027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0745	**Room 9 Art Room (Now Room 23)**	2027	Water Fountain-No Chiller	Potable	**5/29/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0746	**Courtyard o/s 2047**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0747	**Exterior o/s Room 35**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0748	**Exterior o/s Room 32**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0749	**Exterior o/s 2040**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0750	**Exterior o/s 2011**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0751	**Exterior o/s 2008**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0752	**Exterior o/s 2017**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0753	**Exterior o/s 2024**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0754	**Exterior o/s 2025**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Thompson Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0755	**Server Room Vestibule**	2175	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0756	**Head Custodian Office Bathroom**	2177A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0757	**Art Room**	2082	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0758	**Art Room**	2082	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0759	**Room 116**	2074	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0760	**Science Prep Room C**	2073	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0761	**Room 120**	2086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0762	**Room 120**	2086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0763	**Room 115**	2071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0764	**Room 115**	2071	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0765	**Room 121**	2088	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0766	**Room 121**	2088	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0767	**Room 121**	2088	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0768	**Corridor Custodial - Gym**	2092	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0769	**Corridor Custodial - Gym**	2092	Water Cooler	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0770	**Faculty Men's Bathroom**	2093B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0771	**Boy's Bathroom**	2095	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0772	**Boy's Bathroom**	2095	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0773	**Boy's Bathroom**	2095	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0774	**Boy's Bathroom**	2095	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Thompson Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0775	**Custodial Closet**	2178	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0776	**Girl's Bathroom**	2096	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0777	**Girl's Bathroom**	2096	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0778	**Girl's Bathroom**	2096	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0779	**Girl's Bathroom**	2096	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0780	**FCSC Family & Consumer Service C Room 99**	2097	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0781	**FCSB Family & Consumer Service B**	2098	Home Economics Faucet (Cold)	Potable	**5/30/2025**	**21.4**	8/26/2025	1.2	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0782	**FCSB Family & Consumer Service B**	2098	Home Economics Faucet (Cold)	Potable	**5/30/2025**	**5.8**	8/12/2025	3.1	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0783	**FCSB Family & Consumer Service B**	2098	Home Economics Faucet (Cold)	Potable	**5/30/2025**	**5.6**	8/26/2025	1.6	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0784	**FCSA Family & Consumer Service A**	2099	Home Economics Faucet (Cold)	Potable	**5/30/2025**	**1.9**			Result Below Action Level Continue O&M
SCSD-0785	**FCSA Family & Consumer Service A**	2099	Home Economics Faucet (Cold)	Potable	**5/30/2025**	**2.2**			Result Below Action Level Continue O&M
SCSD-0786	**FCSA Family & Consumer Service A**	2099	Home Economics Faucet (Cold)	Potable	**5/30/2025**	**6.2**	9/6/2025	< 1.0	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0787	**FCSA Family & Consumer Service A**	2099	Home Economics Faucet (Cold)	Potable	**5/30/2025**	**7.7**	9/6/2025	1.4	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0788	**Room 108**	2030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0789	**Room 108**	2030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0790	**Room 108**	2030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0791	**Room 108**	2030	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0792	**Room 114**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0793	**Room 114**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0794	**Room 114**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Thompson Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0795	**Room 114**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0796	**Room 114**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0797	**Room 114**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0798	**Room 114**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0799	**Room 114**	2051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0800	**Room 113 Prep Room**	2050	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0801	**Room 113 Prep Room**	2050	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0802	**Room 109**	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0803	**Room 109**	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0804	**Corridor Rooms 108-114**	2090	Water Fountain-No Chiller	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0805	**Room 113**	2048	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0806	**Art Room**	2036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0807	**Art Room**	2036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0808	**Corridor Custodial - Gym**	2092	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0809	**Corridor Custodial - Gym**	2092	Water Cooler	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0810	**Faculty Men's Bathroom**	2102	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0811	**Faculty Men's Bathroom**	2102	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0812	**Faculty Men's Bathroom**	2102	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0813	**Custodial Closet**	2103	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0814	**Women's Faculty Bathroom**	2104	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Thompson Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0815	**Women's Faculty Bathroom**	2104	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0816	**Women's Faculty Bathroom**	2104	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0817	**Women's Faculty Bathroom**	2104	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0818	**Room 101**	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0819	**Room 101**	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0820	**Room 101**	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0821	**Room 107**	2019	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0822	**Room 107**	2019	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0823	**Room 107**	2019	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0824	**Room 106 Prep Room**	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0825	**Room 106**	2016	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0826	**Room 102**	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0827	**Room 102**	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0828	**Room 102**	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0829	**Art Room**	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0830	**Art Room**	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0831	**Corridor North Gym - South Gym**	2182	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0832	**Corridor North Gym - South Gym**	2182	Water Cooler	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0833	**Girl's Locker Room Vestibule**	2106A	Water Fountain-No Chiller	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0834	**Girl's Locker Room Vestibule**	2106A	Water Fountain-No Chiller	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service

OOS= Out of Service **RFI = Removed from Inventory**

Thompson Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0835	**Girls Coach's Office Bathroom**	2107	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0836	**Girl's Locker Room**	2111	Water Fountain-No Chiller	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0837	**Girl's Locker Room**	2111	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0838	**Girl's Locker Room**	2111	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0839	**Girl's Locker Room**	2111	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0840	**Girl's Locker Room Slop Sink**	2111B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0841	**Nurse's Vestibule Bathroom**	2126	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0842	**Nurse's Office**	2125	Nurse's Office Sink	Potable	**5/30/2025**	**15.9**	8/26/2025	2.7	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0843	**Main Office Conference Room**	2132	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**16.4**	8/26/2025	< 1.0	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0844	**Main Office Principal Bathroom**	2134	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0845	**Main Entrance Corridor**	2180	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0846	**Main Entrance Corridor**	2180	Water Cooler	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0847	**Vestibule**	2118A	Water Fountain-No Chiller	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0848	**Vestibule**	2118A	Water Fountain-No Chiller	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0849	**Boys Coach's Office Bathroom**	2118B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0850	**Boy's Locker Room Bathroom**	2117A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0851	**Boy's Locker Room Bathroom**	2117A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0852	**Boy's Locker Room Bathroom**	2117A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0853	**Boy's Locker Room Bathroom**	2117A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0854	**Boys Locker Room Bathroom Slop Sink**	2117A1	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Thompson Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0855	**Women's Bathroom Near Main Office**	2180B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0856	**Women's Faculty Bathroom**	2146	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0857	**Custodial Closet**	2145	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0858	**Men's Faculty Bathroom**	2144	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0859	**Main Entrance Corridor**	2180	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0860	**Main Entrance Corridor**	2180	Water Cooler	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0861	**Men's Faculty Bathroom**	2152	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0862	**Snack Shop**	2154C	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**11.2**	8/26/2025	1.6	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0863	**North Cafeteria**	2154A	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0864	**North Cafeteria**	2154A	Water Cooler	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0865	**South Cafeteria**	2154B	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0866	**South Cafeteria**	2154B	Water Cooler	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0867	**Faculty Lounge**	2155	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**46.9**	8/12/2025	< 1.0	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0868	**Faculty Lounge**	2155	Spray Nozzle	Non-Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0869	**Kitchen**	2156	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**3.1**			Result Below Action Level Continue O&M
SCSD-0870	**Kitchen**	2156	Spray Nozzle	Non-Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0871	**Kitchen**	2156	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0872	**Kitchen**	2156	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0873	**Kitchen**	2156	Ice Machine	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0874	**Kitchen**	2156	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**1.9**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Thompson Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0875	**Kitchen**	2156	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**1.5**			Result Below Action Level Continue O&M
SCSD-0876	**Kitchen**	2156	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0877	**Kitchen Bathroom/Laundry Room**	2160	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0878	**Kitchen Can Wash Room**	2159	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0879	**Boy's Bathroom**	2151	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0880	**Boy's Bathroom**	2151	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0881	**Girl's Bathroom**	2150	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0882	**Fan Room Across Tech C**	2149	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0883	**Tech C**	2164	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0884	**Room ITB Tech B Wood Shop**	2167A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0885	**Room ITA Tech A Wood Shop**	2170A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0886	**Room ITA Tech A Wood Shop**	2170A	Spray Nozzle	Non-Potable	**5/30/2025**	**7.9**			Outlet Permanently Removed
SCSD-0887	**Art Room**	3183	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0888	**Art Room**	3183	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0889	**Art Room**	3183	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0890	**Art Room**	3183	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0891	**Corridor Room 224 to 228**	3277	Water Cooler	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0892	**2nd Floor Main Corridor**	3280	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0893	**2nd Floor Main Corridor**	3280	Water Cooler	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0894	**Boy's Bathroom**	3215	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Thompson Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0895	**Boy's Bathroom**	3215	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0896	**Boy's Bathroom**	3215	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0897	**Boy's Bathroom**	3215	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0898	**Custodial Closet**	3217	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0899	**Girl's Bathroom**	3216	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0900	**Girl's Bathroom**	3216	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0901	**Girl's Bathroom**	3216	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0902	**Girl's Bathroom**	3216	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0903	**Corridor Room 211 to 215**	3278	Water Fountain-No Chiller	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0904	**Men's Faculty Bathroom**	3272	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0905	**Men's Faculty Bathroom**	3272	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0906	**Men's Faculty Bathroom**	3272	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0907	**2nd Floor Main Corridor**	3280	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0908	**2nd Floor Main Corridor**	3280	Water Cooler	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0909	**Custodial Closet**	3273	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0910	**Women's Faculty Bathroom**	3271	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0911	**Women's Faculty Bathroom**	3271	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0912	**Women's Faculty Bathroom**	3271	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0913	**Women's Faculty Bathroom**	3271	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0914	**Corridor Room 201 to 205**	3281	Water Fountain-No Chiller	Potable	**5/30/2025**	**OOS**			Testing Required Before Return to Service

OOS= Out of Service **RFI = Removed from Inventory**

Thompson Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0915	**Courtyard**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0916	**Courtyard**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0917	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0918	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0919	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0920	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0921	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0922	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0923	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0924	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0925	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0926	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0927	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0928	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0929	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1282	**Women's Faculty Bathroom**	2093A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1377	**Women's Faculty Bathroom**	2093A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Willits Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0930	**Cafeteria**	NA	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**21.3**	8/13/2025	1.9	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0931	**Cafeteria**	NA	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**5.7**	8/13/2025	1.4	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0932	**Room 207 Psychologist Office**	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0933	**Room 14**	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0934	**Room 13**	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0935	**Girls Bathroom Vestibule (Space Reconstructed)**	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0936	**Room 214 Speech Therapist Office**	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0937	**Library**	2021	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0938	**Stairwell**	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0939	**Stairwell**	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0940	**Stairwell**	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0941	**Stairwell**	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0942	**Stairwell**	2019	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0943	**Corridor Room 211 To Room 219**	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0944	**Corridor Room 211 To Room 219**	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0945	**Corridor Room 211 To Room 219**	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0946	**Corridor Room 211 To Room 219**	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0947	**Gym Kitchen**	2042	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**5.6**	8/26/2025	1.4	Outlet Remediated Result Below Action Level Continue O&M
SCSD-0948	**Room 18**	2026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0949	**Room 17**	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Willits Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0950	**Room 20**	2027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0951	**Room 19**	2031	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0952	**Room 210**	2028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0953	**Room 21**	2030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0954	**Corridor Room 21 to Gym**	2029	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0955	**Corridor Room 21 to Gym**	2029	Water Cooler	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0956	**Faculty Room**	2038	Kitchen Faucet (Cold)	Potable	**5/30/2025**	**1.3**			Result Below Action Level Continue O&M
SCSD-0957	**Faculty Room**	2038	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0958	**Women's Bathroom**	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0959	**Corridor Boiler Room to Main Entrance**	2037	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0960	**Corridor Boiler Room to Main Entrance**	2037	Water Cooler	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0961	**Men's Bathroom**	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0962	**Nurse's Bathroom**	2045	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0963	**Room 8**	2073	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0964	**Room 8**	2073	Water Fountain-No Chiller	Potable	**5/31/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0965	**Room 6**	2069	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0966	**Room 6**	2069	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0967	**Room 4/GT Room**	2065	Water Fountain-No Chiller	Potable	**5/31/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0968	**Computer Room 3**	2056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0969	**Computer Room 3**	2056	Water Fountain-No Chiller	Potable	**5/31/2025**	**OOS**			Testing Required Before Return to Service

OOS= Out of Service **RFI = Removed from Inventory**

Willits Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0970	**Room 2**	2062	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0971	**Room 2**	2062	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0972	**Room 2 Bathroom**	2063	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0973	**Room 1**	2070	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0974	**Room 1 Bathroom**	2058	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0975	**4N**	NA	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0976	**7N**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0977	**8N**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0978	**10N**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0979	**11N**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0980	**17N**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0981	**14N**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0982	**18N**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0983	**21N**	21N	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0984	**Boiler Room**	2022	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0985	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0986	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0987	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0988	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0989	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service RFI = Removed from Inventory

Willits Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0990	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0991	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1283	**6N**	NA	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1284	**6N**	NA	Water Cooler	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1431	**Corridor Boiler Room to Main Entrance o/s 2019**	2037	Bottle Fill Station	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1432	**Corridor Boiler Room to Main Entrance o/s 2019**	2037	Water Cooler	Potable	**5/30/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

South Grove Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-0992	**Room 32**	2086	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0993	**Room 31**	2081	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0994	**Room 31 Bathroom**	2082	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0995	**Room 33**	2089	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0996	**Room 30**	2078	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-0997	**Multi Purpose Room**	2092	Bottle Fill Station	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-0998	**Multi Purpose Room**	2092	Water Cooler	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-0999	**Multi Purpose Room**	2092	Kitchen Faucet (Cold)	Potable	**6/3/2025**	**1.5**			Result Below Action Level Continue O&M
SCSD-1000	**Multi Purpose Room**	2092	Kitchen Faucet (Cold)	Potable	**6/3/2025**	**1.6**			Result Below Action Level Continue O&M
SCSD-1001	**Room 29**	2075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1002	**Room 28**	2071	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1003	**Men's Bathroom**	2094	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1004	**Women's Bathroom**	2095	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1005	**Custodial Office**	2096	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1006	**14A-Music Room**	2068	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1007	**14B-Band/Orchestra Room**	2068B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1008	**Faculty Lounge - Room 15**	2044	Kitchen Faucet (Cold)	Potable	**6/3/2025**	**4.3**			Result Below Action Level Continue O&M
SCSD-1009	**Room 18 Closet**	2064	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1010	**Boy's Bathroom**	2047	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1011	**Boy's Bathroom**	2047	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

South Grove Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1012	**Boy's Bathroom**	2047	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1013	**Custodial Closet 20**	2048	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1014	**Girl's Bathroom**	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1015	**Girl's Bathroom**	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1016	**Girl's Bathroom**	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1017	**Room 22**	2060	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1018	**Room 22**	2060	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1019	**Room 23**	2050	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1020	**Room 23**	2050	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1021	**Room 24**	2058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1022	**Room 24**	2058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1023	**Room 25**	2052	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1024	**Room 25**	2052	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1025	**Room 26**	2056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1026	**Room 26**	2056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1027	**Room 27**	2054	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1028	**Room 27**	2054	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1029	**Corridor Main Office to Boiler Room**	2046	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1441
SCSD-1030	**Corridor Main Office to Boiler Room**	2046	Water Cooler	RFI					Outlet Replaced by Sticker No. 1442
SCSD-1031	**Nurse's Office Bathroom**	2034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

South Grove Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1032	**Men's Staff Bathroom**	2037	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1033	**Library**	2018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1034	**Room 7**	2023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1035	**Room 7**	2023	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1036	**Library Bathroom**	2019	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1037	**Library Bathroom**	2019	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1038	**Room 5**	2015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1039	**Room 5**	2015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1040	**Room 3**	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1041	**Room 3**	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1042	**Learning Center Bathroom**	2003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1043	**Room 1 Art**	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1044	**Room 1 Art**	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1045	**Room 1 Art**	2005	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1046	**Room 1 Bathroom/Kiln room**	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1071	**Corridor Room 32 - Main Entrance**	2098	Water Fountain-No Chiller	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1246	**Boys Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1247	**Boys Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1248	**Girls Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1249	**Girls Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

South Grove Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1250	**Custodial Closet**	NA	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1251	**Gym Hallway**	NA	Bottle Fill Station	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1252	**Gym Hallway**	NA	Water Cooler	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1253	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1254	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1255	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1256	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1257	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1260	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1261	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1262	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1441	**Corridor Main Office to Boiler Room**	2046	Bottle Fill Station	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1442	**Corridor Main Office to Boiler Room**	2046	Water Cooler	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1443	**Corridor Room 32 - Main Entrance**	2098	Bottle Fill Station	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1444	**Corridor Room 32 - Main Entrance**	2098	Water Cooler	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1445	**Multi Purpose Room**	2092	Kitchen Faucet (Cold)	Potable	**6/3/2025**	**7.8**	8/26/2025	2.0	Outlet Remediated Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

South Grove Annex

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1047	**Nurse Bathroom**	2014	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1048	**Scope Bathroom**	2008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1049	**Corridor near Boiler Room**	2034	Bottle Fill Station	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1050	**Corridor near Boiler Room**	2034	Water Cooler	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1051	**Women's Bathroom**	2007	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1052	**Kitchen**	2006	Kitchen Faucet (Cold)	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1053	**Kitchen**	2006	Kitchen Faucet (Cold)	Potable	**6/3/2025**	**1.4**			Result Below Action Level Continue O&M
SCSD-1054	**Room 1**	2016	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1055	**Room 1**	2016	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1056	**Room 2**	2018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1057	**Room 2**	2018	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1058	**Corridor Rooms 1-3**	2032	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1059	**Room 3**	2020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1060	**Room 3**	2020	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1061	**Faculty Room**	2024	Classroom Faucet	Non-Potable	**8/13/2025**	**7.1**	9/6/2025	< 1.0	Outlet Remediated Returned to Service Continue O&M
SCSD-1062	**Faculty Room**	2024	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1063	**Classroom 7**	2029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1064	**Classroom 7**	2029	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1065	**Corridor Room 5-7**	2033	Bottle Fill Station	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1066	**Corridor Room 5-7**	2033	Water Cooler	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

South Grove Annex

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1067	**Classroom 6**	2027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1068	**Classroom 6**	2027	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1069	**Classroom 5**	2025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1070	**Classroom 5**	2025	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1240	**Room 8**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1241	**Room 8**	NA	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1242	**Room 8 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1243	**Room 9**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1244	**Room 9**	NA	Water Fountain-No Chiller	Potable	**6/3/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1245	**Room 9 Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1258	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1259	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1379	**Multi Purpose Room**	2031	Hand Wash Only	Non-Potable	**6/3/2025**	**2.4**			Result Below Action Level Continue O&M
SCSD-1446	**Corridor Rooms 1-3**	2032	Bottle Fill Station	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1447	**Corridor Rooms 1-3**	2032	Water Cooler	Potable	**6/3/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Baylis Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1072	**Corridor Room 9 to 14**	2084	Bottle Fill Station	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1073	**Corridor Room 9 to 14**	2084	Water Cooler	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1074	**Classroom 15**	2068	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1075	**Classroom 14 (Now Room C5)**	2070	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1076	**Classroom 10 (Now Room C1)**	2073	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1077	**Classroom 13 (Now Room C6)**	2065	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1078	**Classroom 10 (Now Room C1)**	2073	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1079	**Classroom 11 (Now Room C4)**	2063	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1080	**Classroom 9 (Now Room C2)**	2061	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1081	**Girl's Bathroom**	2075	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1082	**Girl's Bathroom**	2075	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1083	**Girl's Bathroom**	2075	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1084	**Girl's Bathroom**	2075	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1085	**Custodial Closet E**	2078	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1086	**Boy's Bathroom**	2076	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1087	**Boy's Bathroom**	2076	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1088	**Boy's Bathroom**	2076	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1089	**Boy's Bathroom**	2076	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1090	**Corridor Fish Bowl to Stage**	2079	Bottle Fill Station	RFI					Outlet Replaced by Sticker No. 1486
SCSD-1091	**Corridor Fish Bowl to Stage**	2079	Water Cooler	RFI					Outlet Replaced by Sticker No. 1487

OOS= Out of Service **RFI = Removed from Inventory**

Baylis Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1092	**Girl's Bathroom**	2051	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1093	**Men's Room**	2052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1094	**Nurse's Bathroom**	2056	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1095	**Library Room 8**	2044	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1096	**Custodial Closet**	2026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1097	**Women's Bathroom Entrance**	2029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1098	**Classroom 4 - Faculty Lounge**	2041	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1099	**218**	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1100	**Classroom 1 (Now Room B7)**	2035	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1101	**Classroom 1 Bathroom**	2034	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1102	**Classroom 2 (Now Room B4)**	2038	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1103	**Corridor 206 To 214**	2036	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1104	**2BES**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1105	**4BES**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1106	**Boy's Bathroom**	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1107	**Boy's Bathroom**	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1108	**Boy's Bathroom**	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1109	**Men's Bathroom**	2019	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1110	**Girl's Bathroom**	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1111	**Girl's Bathroom**	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Baylis Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1112	**Girl's Bathroom**	2017	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1113	**205**	2015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1114	**Room 16 (Now Room A2)**	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1115	**Room 19 (Now Room A3)**	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1116	**Room 19 (Now Room A3)**	2012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1117	**Room 21 (Now Room A5)**	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1118	**211**	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1119	**212**	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1120	**Room 22 (Now Room A8)**	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1121	**213**	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1122	**216**	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1123	**Corridor Main Office to Cafeteria**	2083	Bottle Fill Station	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1124	**Corridor Main Office to Cafeteria**	2083	Water Cooler	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1125	**Cafeteria**	2002	Kitchen Faucet (Cold)	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1126	**Cafeteria**	2002	Kitchen Faucet (Cold)	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1127	**Cafeteria**	2002	Kitchen Faucet (Cold)	Potable	**6/5/2025**	**1.7**			Result Below Action Level Continue O&M
SCSD-1271	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1272	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1273	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1274	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Baylis Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1275	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1276	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1277	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1437	**Corridor Fish Bowl to Stage**	2079	Bottle Fill Station	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1438	**Corridor Fish Bowl to Stage**	2079	Water Cooler	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1486	**Corridor Fish Bowl to Stage o/s 2046**	2079	Bottle Fill Station	Potable	**6/27/2025**	**< 1.0**			Result Below Action Level Continue O&M
SCSD-1487	**Corridor Fish Bowl to Stage o/s 2046**	2079	Water Cooler	Potable	**6/27/2025**	**< 1.0**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Robbins Lane Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1128	**Faculty Room**	2030	Kitchen Faucet (Cold)	Potable	**5/28/2025**	**1.7**			Result Below Action Level Continue O&M
SCSD-1129	**Faculty Room**	2030	Spray Nozzle	Non-Potable	**5/28/2025**	**6.5**	8/12/2025	6.5	Removed from Service Pending Remediation
SCSD-1130	**Room 12**	2029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1131	**Room 12**	2029	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1132	**Nurse Vestibule**	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1133	**Nurse's Office**	2022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1134	**Room 8**	2018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1135	**Room 8**	2018	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1136	**Corridor Room 10 to Main Entrance**	2028	Water Fountain-No Chiller	RFI					Outlet Permanently Removed
SCSD-1137	**Male/Female Bathroom**	2019A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1138	**Room 6**	2017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1139	**Room 6**	2017	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1140	**Room 5**	2015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1141	**Room 5**	2015	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1142	**Room 4**	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1143	**Room 4**	2011	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1144	**Room 7 (Now Room 3)**	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1145	**Room 7 (Now Room 3)**	2013	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1146	**Room 2**	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1147	**Room 2**	2004	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service

OOS= Out of Service **RFI = Removed from Inventory**

Robbins Lane Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1148	**Room 1&2 Vestibule Toilet Room 2**	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1149	**Room 1 & 2 Vestibule Toilet Room**	2006	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1150	**Room 9 (Now Room 1)**	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1151	**Room 9 (Now Room 1)**	2003	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1152	**Room 12 (Now Room 15)**	2037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1153	**Room 11 (Now Room 16)**	2032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1154	**Room 14 (Now Room 17)**	2036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1155	**Corridor Room 10 to Main Entrance**	2028	Water Fountain-No Chiller	RFI					Outlet Permanently Removed
SCSD-1156	**Room 13 (Now Room 18)**	2033	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1157	**Room 13 (Now Room 18)**	2033	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1158	**Room 16 (Now Room 19)**	2035	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1159	**Room 16 (Now Room 19)**	2035	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1160	**Room 15 (Now Room 20)**	2034	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1161	**Room 15 (Now Room 20)**	2034	Water Fountain-No Chiller	Potable	**5/28/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1162	**Room 21**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1163	**Room 22**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1164	**Room 23**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1165	**Girls Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1166	**Girls Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1167	**Girls Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Robbins Lane Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1168	**Custodial Closet**	NA	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1169	**Boys Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1170	**Boys Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1171	**Boys Bathroom**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1172	**Room 24**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1173	**Room 25**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1174	**Room 26**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1175	**Corridor Speech - Room 31**	2052	Bottle Fill Station	Potable	**5/28/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1176	**Corridor Speech - Room 31**	2052	Water Cooler	Potable	**5/28/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1177	**Room 30 (Now Room 27)**	2051	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1178	**Room 31 (Now Room 28)**	2053	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1179	**Room 28 (Now Room 29)**	2050	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1180	**Room 29 (Now Room 30)**	2054	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1181	**Room 26 (Now Room 31)**	2049	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1182	**Room 27 (Now Room 32)**	2055	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1183	**Girl's Bathroom**	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1184	**Girl's Bathroom**	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1185	**Girl's Bathroom**	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1186	**Girl's Bathroom**	2048	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1187	**Custodial Closet**	2045	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Robbins Lane Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1188	**Boy's Room Opposite Room 33**	2046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1189	**Boy's Room Opposite Room 33**	2046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1190	**Boy's Room Opposite Room 33**	2046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1191	**Boy's Room Opposite Room 33**	2046	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1192	**Room 25 (Now Room 33)**	2056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1193	**Room 24 (Now Room 34)**	2057	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1194	**Room 23 Art Room (Now Room 35)**	2058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1195	**Room 23 Art Room (Now Room 35)**	2058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1196	**Adult Bathroom**	2066	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1197	**Resource Room 22 (Now Room 38)**	2067	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1198	**Learning Center Room 21 (Now Room 40)**	2068	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1199	**Cafeteria**	2076	Water Fountain-No Chiller	RFI					Outlet Permanently Removed
SCSD-1200	**Men's Kitchen Bathroom & Vestibule**	2079	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1201	**Kitchen**	2080	Hand Wash Only	Non-Potable	**5/28/2025**	**1.4**			Result Below Action Level Continue O&M
SCSD-1202	**Kitchen**	2080	Kitchen Faucet (Cold)	Potable	**5/28/2025**	**6.9**	8/12/2025	4.5	Outlet Remediated Result Below Action Level Continue O&M
SCSD-1203	**Gymnasium**	2083	Water Fountain-No Chiller	RFI					Outlet Permanently Removed
SCSD-1204	**Corridor Boy's Room to Resource Room**	2071	Bottle Fill Station	Potable	**5/28/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1205	**Corridor Boy's Room to Resource Room**	2071	Water Cooler	Potable	**5/28/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1206	**Girl's Room by Gym**	2039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1207	**Girl's Room by Gym**	2039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service RFI = Removed from Inventory

Robbins Lane Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1208	**Custodial Closet by Gym**	2040	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1209	**Boy's Room by Gym**	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1210	**Boy's Room by Gym**	2038	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1211	**Boiler Room (New)**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1212	**Boiler Room (New)**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1213	**Boiler Room 2**	2062	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1263	**Courtyard**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1264	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1265	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1266	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1267	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1268	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1269	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1270	**Exterior**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1281	**Faculty Bathroom Next To Space# 2073**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1285	**Room 26 (Now Room 31)**	2049	Water Fountain-No Chiller	RFI					Outlet Permanently Removed
SCSD-1481	**Corridor Room 10 to Main Entrance**	2028	Bottle Fill Station	Potable	**5/28/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1482	**Corridor Room 10 to Main Entrance**	2028	Water Cooler	Potable	**5/28/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1483	**Cafeteria**	2076	Bottle Fill Station	Potable	**5/28/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1484	**Cafeteria**	2076	Water Cooler	Potable	**5/28/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Robbins Lane Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1485	**Gymnasium**	2083	Water Fountain-No Chiller	Potable	**5/28/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Maintenance Building

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1289	**Locker/Common Room**	1003	Bottle Fill Station	RFI					Outlet Permanently Removed
SCSD-1290	**Locker/Common Room**	1003	Water Cooler	RFI					Outlet Permanently Removed
SCSD-1291	**Storage Area**	1005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1292	**Women's Bathroom**	1002	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1293	**Garage**	1009	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1427	**Locker/Common Room**	1003	Bottle Fill Station	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1428	**Locker/Common Room**	1003	Water Cooler	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Walt Whitman Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1294	**Room 11**	2055B	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1295	**Room 6**	2026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1296	**Room 6 Bathroom**	2024	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1297	**Corridor Room 2 to Room 6**	2068	Bottle Fill Station	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1298	**Corridor Room 2 to Room 6**	2068	Water Cooler	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1299	**Room 5**	2022	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1300	**Room 5 Bathroom**	2027	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1301	**Nurse's Office Bathroom**	2030	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1302	**Custodial Closet**	2032	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1303	**Women's Bathroom**	2031	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1304	**Women's Bathroom**	2031	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1305	**Room 4**	2020	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1306	**Room 4 Bathroom**	2021	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1307	**Room 3**	2015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1308	**Room 3 Bathroom**	2018	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1309	**Room 2**	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1310	**Room 2**	2013	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1311	**Room 2 Bathroom**	2011	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1312	**Room 1**	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1313	**Room 1**	2007	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service

OOS= Out of Service **RFI = Removed from Inventory**

Walt Whitman Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1314	**Room 1 Bathroom**	2009	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1315	**Modular Room A**	2076	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1316	**Modular Room B**	2077	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1317	**Corridor to Room A-C**	2075	Bottle Fill Station	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1318	**Corridor to Room A-C**	2075	Water Cooler	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1319	**Modular Room C**	2078	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1320	**Room 8**	2036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1321	**Room 8**	2036	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1322	**Library Room 7**	2035	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1323	**Gymnasium**	2037	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1324	**Girl's Bathroom**	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1325	**Girl's Bathroom**	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1326	**Girl's Bathroom**	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1327	**Girl's Bathroom**	2049	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1328	**Boy's Bathroom**	2052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1329	**Boy's Bathroom**	2052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1330	**Boy's Bathroom**	2052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1331	**Custodial Closet**	2080	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1332	**Room 9**	2053	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1333	**Faculty Lounge**	2028	Kitchen Faucet (Cold)	Potable	**6/5/2025**	**4.3**			Result Below Action Level Continue O&M

OOS= Out of Service **RFI = Removed from Inventory**

Walt Whitman Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1334	**Room 13**	2057	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1335	**Room 13**	2057	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1336	**Corridor from Room 19 to Boy's Bathroom**	2067	Bottle Fill Station	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1337	**Corridor from Room 19 to Boy's Bathroom**	2067	Water Cooler	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1338	**Room 15**	2059	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1339	**Room 15**	2059	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1340	**Room 17**	2061	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1341	**Room 17**	2061	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1342	**Room 19**	2063	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1343	**Room 19**	2063	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1344	**Room 21**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1345	**Room 21**	NA	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1346	**Room 22, Art Room**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1347	**Room 22, Art Room**	NA	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1349	**Boy's Bathroom by Room 19**	2064	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1350	**Psychologist Room**	2066	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1351	**Girl's Bathroom**	2065	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1352	**Girl's Bathroom**	2065	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1353	**Room 18**	2062	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1354	**Room 18**	2062	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service

OOS= Out of Service **RFI = Removed from Inventory**

Walt Whitman Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1355	**Room 16**	2060	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1356	**Room 16**	2060	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1357	**Room 14**	2058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1358	**Room 14**	2058	Water Fountain-No Chiller	Potable	**6/5/2025**	**OOS**			Testing Required Before Return to Service
SCSD-1359	**Room 12**	2056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1360	**Room 10**	2054	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1361	**Kitchen/Serving Area**	2043	Hand Wash Only	Non-Potable	**6/5/2025**	**2.0**			Result Below Action Level Continue O&M
SCSD-1362	**Kitchen/Serving Area**	2043	Kitchen Faucet (Cold)	Potable	**6/5/2025**	**3.6**			Result Below Action Level Continue O&M
SCSD-1363	**Corridor Music Room to Main Office**	2069A	Bottle Fill Station	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1364	**Corridor Music Room to Main Office**	2069A	Water Cooler	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1365	**Unisex Bathroom**	2045	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1366	**Boiler Room**	1001	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1367	**Exterior o/s 2013**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1368	**Exterior o/s 2015**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1369	**Exterior o/s 2035**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1370	**Exterior o/s 1370**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1371	**Exterior o/s 2066**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1372	**Exterior o/s Room 21**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1373	**Exterior o/s 2053**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1374	**Exterior o/s 2074**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service **RFI = Removed from Inventory**

Walt Whitman Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1375	**Exterior o/s 2044**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1376	**Exterior o/s 2022**	NA	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service RFI = Removed from Inventory

Maintenance Garage

Outlet Number	Room Name	Space ID	Outlet Type	Potable/ Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
SCSD-1415	**Wood Storage (Barn)**	NA	Bottled Water Dispenser	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1416	**Wood Storage (Barn)**	NA	Water Cooler	Potable	**6/5/2025**	**<1.00 ND**			Result Below Action Level Continue O&M
SCSD-1417	**Wood Storage (Barn)**	NA	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
SCSD-1418	**Men's Bathroom (Barn)**	NA	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

OOS= Out of Service RFI = Removed from Inventory

Attachment 3:

Laboratory Analytical Reports

J.C. Broderick & Associates, Inc.
Environmental Consulting & Testing
1775 Expressway Drive North
Hauppauge, New York 11788
631.584.5492 fax 631.584.3395

ED53001

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-53856

Building: Robbins Lane Elementary School

RLE

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1128	FL	2030	Faculty Room	KC	5/28/2025	5:43:00 AM
SCSD-1129	FL	2030	Faculty Room	SN	5/28/2025	5:43:00 AM
SCSD-1175	HA	2052	Corridor Speech - Room 31	WF	5/28/2025	6:04:00 AM
SCSD-1176	HA	2052	Corridor Speech - Room 31	WC	5/28/2025	6:05:00 AM
SCSD-1201	KI	2080	Kitchen	HW	5/28/2025	6:23:00 AM
SCSD-1202	KI	2080	Kitchen	KC	5/28/2025	6:23:00 AM
SCSD-1204	HA	2071	Corridor Boy's Room to Resource Room	WF	5/28/2025	6:07:00 AM
SCSD-1205	HA	2071	Corridor Boy's Room to Resource Room	WC	5/28/2025	6:08:00 AM
SCSD-1481	HA	2028	Corridor Room 10 to Main Entrance	WF	5/28/2025	5:49:00 AM
SCSD-1482	HA	2028	Corridor Room 10 to Main Entrance	WC	5/28/2025	5:49:00 AM
SCSD-1483	CA	2076	Cafeteria	WF	5/28/2025	6:12:00 AM
SCSD-1484	CA	2076	Cafeteria	WC	5/28/2025	6:12:00 AM
SCSD-1485	GY	2083	Gymnasium	DW	5/28/2025	6:16:00 AM

Samples Submitted 42

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 06 25, PM03:53

Walk In

Pb200.8 6/9/25

Building Address
157 Robbins Lane
Syosset , NY 11791

Analysis Type: ELAP 200.5

Lab Recieved: A Stanley 6/6/25

Signature: 3:53pm

Samplers Name: Jevan George

Samplers Signature:

JCB Project Manager: Bryan Ezelus

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553001
LIMS Reference ID: ED53001
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 24-53856, Robbins Lane Elementary School, RLE, Syosset Central School District , 157 Robbins Lane Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/06/2025 15:53
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1128		**Lims Reference ID:**		**ED53001-01**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	**1.7**		1	1.0	µg/L	06/09/25 12:40	06/09/25 12:40	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1129		**Lims Reference ID:**		**ED53001-02**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	**6.5**		1	1.0	µg/L	06/09/25 12:44	06/09/25 12:44	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1175		**Lims Reference ID:**		**ED53001-03**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 12:46	06/09/25 12:46	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1176		**Lims Reference ID:**		**ED53001-04**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 12:47	06/09/25 12:47	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1201		**Lims Reference ID:**		**ED53001-05**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	**1.4**		1	1.0	µg/L	06/09/25 12:48	06/09/25 12:48	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1202		**Lims Reference ID:**		**ED53001-06**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	**6.9**		1	1.0	µg/L	06/09/25 12:52	06/09/25 12:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1204		**Lims Reference ID:**		**ED53001-07**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 12:54	06/09/25 12:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1205		**Lims Reference ID:**		**ED53001-08**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 12:55	06/09/25 12:55	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1481		**Lims Reference ID:**		**ED53001-09**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553001
LIMS Reference ID: ED53001
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 24-53856, Robbins Lane Elementary School, RLE, Syosset Central School District , 157 Robbins Lane Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/06/2025 15:53
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1481 (Continued)		**Lims Reference ID:**		**ED53001-09**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/09/25 12:56	06/09/25 12:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1482		**Lims Reference ID:**		**ED53001-10**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 12:58	06/09/25 12:58	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1483		**Lims Reference ID:**		**ED53001-11**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 12:59	06/09/25 12:59	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1484		**Lims Reference ID:**		**ED53001-12**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 13:03	06/09/25 13:03	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1485		**Lims Reference ID:**		**ED53001-13**	**Matrix: Drinking Water**			**Sampled:**	**05/28/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 13:04	06/09/25 13:04	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553001

LIMS Reference ID: ED53001

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 24-53856, Robbins Lane Elementary School, RLE, Syosset Central School District , 157 Robbins Lane Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/06/2025 15:53

Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553001

LIMS Reference ID: ED53001

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 24-53856, Robbins Lane Elementary School, RLE, Syosset Central School District , 157 Robbins Lane Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/06/2025 15:53

Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED 53003

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-53856

Building: Village Elementary School

VES

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0675	HA	2045	Corridor Multi Purpose Room to Library	WF	5/29/2025	5:56:00 AM
SCSD-0676	HA	2045	Corridor Multi Purpose Room to Library	WC	5/29/2025	5:56:00 AM
SCSD-0684	HA	2045	Corridor Multi Purpose Room to Library	WF	5/29/2025	6:20:00 AM
SCSD-0685	HA	2045	Corridor Multi Purpose Room to Library	WC	5/29/2025	6:20:00 AM
SCSD-0688	NO	2022D	Nurse's Office	NS	5/29/2025	6:25:00 AM
SCSD-0708	CA	2047	Multi Purpose Room	HW	5/29/2025	6:41:00 AM
SCSD-0709	CA	2047	Multi Purpose Room	WF	5/29/2025	6:40:00 AM
SCSD-0710	CA	2047	Multi Purpose Room	WC	5/29/2025	6:40:00 AM
SCSD-0711	KI	2047A	Kitchen	KC	5/29/2025	6:42:00 AM
SCSD-0712	CA	2047	Multi Purpose Room	HW	5/29/2025	6:44:00 AM
SCSD-0742	FL	2038	Faculty Lounge	KC	5/29/2025	6:22:00 AM

Samples Submitted 11

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 06 25, PM03:53

Walk In

Building Address
90 Convent Road
Syosset , NY 11791

Analysis Type: ELAP 200.5

Lab Recieved: AStanley 6/6/25 3:53pm

Signature:

Samplers Name: Tom George

Samplers Signature:

JCB Project Manager: Bryan Fzelin

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553003
LIMS Reference ID: ED53003
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 24-53856, Village Elementary School, VES, Syosset Central School District, 90 Convent Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/06/2025 15:53
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0675		**Lims Reference ID:**		**ED53003-01**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 13:08	06/09/25 13:08	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0676		**Lims Reference ID:**		**ED53003-02**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 13:09	06/09/25 13:09	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0684		**Lims Reference ID:**		**ED53003-03**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 13:11	06/09/25 13:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0685		**Lims Reference ID:**		**ED53003-04**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 13:12	06/09/25 13:12	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0688		**Lims Reference ID:**		**ED53003-05**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**1.7**		1	1.0	µg/L	06/09/25 13:13	06/09/25 13:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0708		**Lims Reference ID:**		**ED53003-06**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 13:15	06/09/25 13:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0709		**Lims Reference ID:**		**ED53003-07**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 13:16	06/09/25 13:16	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0710		**Lims Reference ID:**		**ED53003-08**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 14:05	06/09/25 14:05	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0711		**Lims Reference ID:**		**ED53003-09**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553003
LIMS Reference ID: ED53003
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 24-53856, Village Elementary School, VES, Syosset Central School District, 90 Convent Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/06/2025 15:53
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0711 (Continued)		**Lims Reference ID:**		**ED53003-09**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals (Continued)									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 14:06	06/09/25 14:06	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0712		**Lims Reference ID:**		**ED53003-10**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 14:08	06/09/25 14:08	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0742		**Lims Reference ID:**		**ED53003-11**	**Matrix: Drinking Water**			**Sampled:**	**05/29/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 14:09	06/09/25 14:09	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553003

LIMS Reference ID: ED53003

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 24-53856, Village Elementary School, VES, Syosset Central School District, 90 Convent Road, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/06/2025 15:53

Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553003

LIMS Reference ID: ED53003

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 24-53856, Village Elementary School, VES, Syosset Central School District, 90 Convent Road, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/06/2025 15:53

Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Lead in Water: Chain of Custody for ED52884

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Willits Elementary School
WES

Client: Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush_____

Walk In

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0930	CA	NA	Cafeteria	KC	5/30/2025	6:48:00 AM
SCSD-0931	CA	NA	Cafeteria	KC	5/30/2025	6:49:00 AM
SCSD-0947	ST	2042	Gym Kitchen	KC	5/30/2025	6:40:00 AM
SCSD-0954	HA	2029	Corridor Room 21 to Gym	WF	5/30/2025	6:52:00 AM
SCSD-0955	HA	2029	Corridor Room 21 to Gym	WC	5/30/2025	6:52:00 AM
SCSD-0956	FL	2038	Faculty Room	KC	5/30/2025	6:44:00 AM
SCSD-0959	HA	2037	Corridor Boiler Room to Main Entrance	WF	5/30/2025	6:55:00 AM
SCSD-0960	HA	2037	Corridor Boiler Room to Main Entrance	WC	5/30/2025	6:55:00 AM
SCSD-1283	HA	NA	6N	WF	5/30/2025	7:00:00 AM
SCSD-1284	HA	NA	6N	WC	5/30/2025	7:00:00 AM
SCSD-1431	HA	2037	Corridor Boiler Room to Main Entrance o/s 2019	WF	5/30/2025	7:00:00 AM
SCSD-1432	HA	2037	Corridor Boiler Room to Main Entrance o/s 2019	WC	5/30/2025	7:01:00 AM

Samples Submitted 12

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 04 25, AM11:53

tb 200.8 Kathleen Jones 6/6/25

Building Address
99 Nana Place
Syosset , NY 11791

Analysis Type: ELAP 200.5
Lab Recieved: A. Minnifield
Signature: A. Minnifield

Samplers Name: Joey George
Samplers Signature:
JCB Project Manager: Bryan Fzelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552884
LIMS Reference ID: ED52884
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Willits Elementary School, WES, Syosset Central School District, 99 Nana Place, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:53
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0930		**Lims Reference ID:**		**ED52884-01**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**21.3**		1	1.0	µg/L	06/06/25 20:32	06/06/25 20:32	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0931		**Lims Reference ID:**		**ED52884-02**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**5.7**		1	1.0	µg/L	06/06/25 20:33	06/06/25 20:33	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0947		**Lims Reference ID:**		**ED52884-03**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**5.6**		1	1.0	µg/L	06/06/25 20:34	06/06/25 20:34	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0954		**Lims Reference ID:**		**ED52884-04**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 20:36	06/06/25 20:36	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0955		**Lims Reference ID:**		**ED52884-05**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 20:51	06/06/25 20:51	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0956		**Lims Reference ID:**		**ED52884-06**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**1.3**		1	1.0	µg/L	06/06/25 20:55	06/06/25 20:55	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0959		**Lims Reference ID:**		**ED52884-07**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 20:56	06/06/25 20:56	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0960		**Lims Reference ID:**		**ED52884-08**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 20:58	06/06/25 20:58	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1283		**Lims Reference ID:**		**ED52884-09**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552884
LIMS Reference ID: ED52884
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Willits Elementary School, WES, Syosset Central School District, 99 Nana Place, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:53
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1283 (Continued)		**Lims Reference ID:**		**ED52884-09**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals (Continued)									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 20:59	06/06/25 20:59	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1284		**Lims Reference ID:**		**ED52884-10**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 21:03	06/06/25 21:03	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1431		**Lims Reference ID:**		**ED52884-11**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 21:04	06/06/25 21:04	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1432		**Lims Reference ID:**		**ED52884-12**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 21:05	06/06/25 21:05	KT	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552884
LIMS Reference ID: ED52884
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Willits Elementary School, WES, Syosset Central School District, 99 Nana Place, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:53
Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552884
LIMS Reference ID: ED52884
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Willits Elementary School, WES, Syosset Central School District, 99 Nana Place, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:53
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED52890

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Thompson Middle School
TMS

Client: Syosset Central School District

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY

Retest/New Install [ ]
Turn Around: Normal 1-wk-Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0768	HA	2092	Corridor Custodial - Gym	WF	5/30/2025	5:57:00 AM
SCSD-0769	HA	2092	Corridor Custodial - Gym	WC	5/30/2025	5:57:00 AM
SCSD-0781	HE	2098	FCSB Family & Consumer Service B	EC	5/30/2025	6:17:00 AM
SCSD-0782	HE	2098	FCSB Family & Consumer Service B	EC	5/30/2025	6:18:00 AM
SCSD-0783	HE	2098	FCSB Family & Consumer Service B	EC	5/30/2025	6:18:00 AM
SCSD-0784	HE	2099	FCSA Family & Consumer Service A	EC	5/30/2025	6:20:00 AM
SCSD-0785	HE	2099	FCSA Family & Consumer Service A	EC	5/30/2025	6:21:00 AM
SCSD-0786	HE	2099	FCSA Family & Consumer Service A	EC	5/30/2025	6:22:00 AM
SCSD-0787	HE	2099	FCSA Family & Consumer Service A	EC	5/30/2025	6:23:00 AM
SCSD-0808	HA	2092	Corridor Custodial - Gym	WF	5/30/2025	5:59:00 AM
SCSD-0809	HA	2092	Corridor Custodial - Gym	WC	5/30/2025	5:59:00 AM
SCSD-0831	HA	2182	Corridor North Gym - South Gym	WF	5/30/2025	5:21:00 AM
SCSD-0842	NO	2125	Nurse's Office	NS	5/30/2025	6:12:00 AM
SCSD-0843	OF	2132	Main Office Conference Room	KC	5/30/2025	6:14:00 AM
SCSD-0845	HA	2180	Main Entrance Corridor	WF	5/30/2025	5:29:00 AM
SCSD-0859	HA	2180	Main Entrance Corridor	WF	5/30/2025	5:31:00 AM
SCSD-0862	CA	2154C	Snack Shop	KC	5/30/2025	5:52:00 AM
SCSD-0863	CA	2154A	North Cafeteria	WF	5/30/2025	5:35:00 AM

Building Address
98 Ann Drive
Syosset , NY 11791

Analysis Type: ELAP 200.5
Lab Recieved: S. Cherofsky 6/4/25
Signature: S. Cherofsky 11:47am

Samplers Name: Jean George
Samplers Signature:
JCB Project Manager: Bryan Eccles

ED52890

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Thompson Middle School
TMS

Client:
Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0865	CA	2154B	South Cafeteria	WF	5/30/2025	5:33:00 AM
SCSD-0867	FL	2155	Faculty Lounge	KC	5/30/2025	5:46:00 AM
SCSD-0868	FL	2155	Faculty Lounge	SN	5/30/2025	5:46:00 AM
SCSD-0869	KI	2156	Kitchen	KC	5/30/2025	5:37:00 AM
SCSD-0874	KI	2156	Kitchen	KC	5/30/2025	5:39:00 AM
SCSD-0875	KI	2156	Kitchen	KC	5/30/2025	5:42:00 AM
SCSD-0886	CR	2170A	Room ITA Tech A Wood Shop	SN	5/30/2025	5:56:00 AM
SCSD-0892	HA	3280	2nd Floor Main Corridor	WF	5/30/2025	6:04:00 AM
SCSD-0907	HA	3280	2nd Floor Main Corridor	WF	5/30/2025	6:03:00 AM

Samples Submitted 27

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 04 25, AM11:47

Building Address
98 Ann Drive
Syosset, NY 11791

Analysis Type: ELAP 200.5
Lab Recieved: S. Cherofsky 6/4/25
Signature: S. Cherofsky 11:47am

Samplers Name: Jeevan George
Samplers Signature:
JCB Project Manager: Bryan Ezdras

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552890
LIMS Reference ID: ED52890
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Thompson Middle School TMS, 98 Ann Drive, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:47
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0768		**Lims Reference ID:**		**ED52890-01**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:07	06/06/25 21:07	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0769		**Lims Reference ID:**		**ED52890-02**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:08	06/06/25 21:08	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0781		**Lims Reference ID:**		**ED52890-03**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	21.4		1	1.0	µg/L	06/06/25 21:09	06/06/25 21:09	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0782		**Lims Reference ID:**		**ED52890-04**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	5.8		1	1.0	µg/L	06/06/25 21:13	06/06/25 21:13	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0783		**Lims Reference ID:**		**ED52890-05**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	5.6		1	1.0	µg/L	06/06/25 21:15	06/06/25 21:15	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0784		**Lims Reference ID:**		**ED52890-06**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	1.9		1	1.0	µg/L	06/06/25 21:19	06/06/25 21:19	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0785		**Lims Reference ID:**		**ED52890-07**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	2.2		1	1.0	µg/L	06/06/25 21:20	06/06/25 21:20	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0786		**Lims Reference ID:**		**ED52890-08**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	6.2		1	1.0	µg/L	06/06/25 21:21	06/06/25 21:21	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0787		**Lims Reference ID:**		**ED52890-09**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552890
LIMS Reference ID: ED52890
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Thompson Middle School TMS, 98 Ann Drive, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:47
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0787 (Continued)		**Lims Reference ID:**		**ED52890-09**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals (Continued)									
Lead	7.7		1	1.0	µg/L	06/06/25 21:23	06/06/25 21:23	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0808		**Lims Reference ID:**		**ED52890-10**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:24	06/06/25 21:24	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0809		**Lims Reference ID:**		**ED52890-11**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:25	06/06/25 21:25	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0831		**Lims Reference ID:**		**ED52890-12**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:27	06/06/25 21:27	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0842		**Lims Reference ID:**		**ED52890-13**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	15.9		1	1.0	µg/L	06/06/25 21:41	06/06/25 21:41	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0843		**Lims Reference ID:**		**ED52890-14**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	16.4		1	1.0	µg/L	06/06/25 21:44	06/06/25 21:44	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0845		**Lims Reference ID:**		**ED52890-15**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:46	06/06/25 21:46	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0859		**Lims Reference ID:**		**ED52890-16**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:47	06/06/25 21:47	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0862		**Lims Reference ID:**		**ED52890-17**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552890
LIMS Reference ID: ED52890
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Thompson Middle School TMS, 98 Ann Drive, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:47
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0862 (Continued)		**Lims Reference ID:**		**ED52890-17**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals (Continued)									
Lead	11.2		1	1.0	µg/L	06/06/25 21:48	06/06/25 21:48	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0863		**Lims Reference ID:**		**ED52890-18**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:52	06/06/25 21:52	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0865		**Lims Reference ID:**		**ED52890-19**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:54	06/06/25 21:54	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0867		**Lims Reference ID:**		**ED52890-20**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	46.9		1	1.0	µg/L	06/16/25 18:19	06/16/25 18:19	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: SCSD-0868		**Lims Reference ID:**		**ED52890-21**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 21:55	06/06/25 21:55	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0869		**Lims Reference ID:**		**ED52890-22**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	3.1		1	1.0	µg/L	06/06/25 21:56	06/06/25 21:56	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0874		**Lims Reference ID:**		**ED52890-23**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	1.9		1	1.0	µg/L	06/06/25 21:58	06/06/25 21:58	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0875		**Lims Reference ID:**		**ED52890-24**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	1.5		1	1.0	µg/L	06/06/25 21:59	06/06/25 21:59	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0886		**Lims Reference ID:**		**ED52890-25**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552890
LIMS Reference ID: ED52890
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Thompson Middle School TMS, 98 Ann Drive, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:47
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0886 (Continued)		**Lims Reference ID:**		**ED52890-25**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals (Continued)									
Lead	**7.9**		1	1.0	µg/L	06/06/25 22:03	06/06/25 22:03	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0892		**Lims Reference ID:**		**ED52890-26**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 22:04	06/06/25 22:04	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0907		**Lims Reference ID:**		**ED52890-27**	**Matrix: Drinking Water**			**Sampled:**	**05/30/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 22:08	06/06/25 22:08	KT	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552890
LIMS Reference ID: ED52890
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Thompson Middle School TMS, 98 Ann Drive, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:47
Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552890
LIMS Reference ID: ED52890
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Thompson Middle School TMS, 98 Ann Drive, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:47
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Lead in Water: Chain of Custody for ED52900

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: Syosset High School

SHS

Client: Syosset Central School District

Walk In

RECEIVED
EASE ANALYTICAL, INC.
Carle Place, NY
JUN 04 2025

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0011	HE	2381	HE 2	EC	5/31/2025	5:40:00 AM
SCSD-0012	HE	2381	HE 2	EC	5/31/2025	5:41:00 AM
SCSD-0013	HE	2380	HE 3	EC	5/31/2025	5:42:00 AM
SCSD-0014	HE	2380	HE 3	EC	5/31/2025	5:43:00 AM
SCSD-0015	HE	2380	HE 3	EC	5/31/2025	5:44:00 AM
SCSD-0016	HE	2380	HE 3	EC	5/31/2025	5:45:00 AM
SCSD-0017	HE	2380	HE 3	EC	5/31/2025	5:46:00 AM
SCSD-0041	OF	2244A	Cafeteria East Office/Snack Area	KC	5/31/2025	6:04:00 AM
SCSD-0042	HA	2244	Cafeteria East	WF	5/31/2025	6:02:00 AM
SCSD-0043	HA	2244	Cafeteria East	WC	5/31/2025	6:03:00 AM
SCSD-0045	KI	2240	Serving Area East	KC	5/31/2025	6:05:00 AM
SCSD-0046	KI	2242	Kitchen	KC	5/31/2025	6:06:00 AM
SCSD-0047	KI	2242	Kitchen	HW	5/31/2025	6:07:00 AM
SCSD-0048	KI	2242	Kitchen	KC	5/31/2025	6:10:00 AM
SCSD-0049	KI	2242	Kitchen	IM	5/31/2025	6:13:00 AM
SCSD-0054	KI	2242	Kitchen	PK	5/31/2025	6:10:00 AM
SCSD-0055	KI	2242	Kitchen	KC	5/31/2025	6:07:00 AM
SCSD-0056	KI	2237	Serving Area West	KC	5/31/2025	6:17:00 AM

Building Address
70 South Woods Road
Syosset , NY 11791

Analysis Type: ELAP 200.5

Lab Recieved: DAVID WHARTON 6/4/25 6:54 PM

Signature: David Wharton

Samplers Name: Jeffrey George

Samplers Signature:

JCB Project Manager: Bryan Ezelius

PB200.8 AS 6/12/25

PB200.8 AS 6/9/25

Lead in Water: Chain of Custody for ED52900

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Syosset High School
SHS

Client:
Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk **Rush**_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0208	HA	2131	127 Closet	WF	5/31/2025	6:53:00 AM
SCSD-0303	OF	2125	Science Office	KC	5/31/2025	6:57:00 AM
SCSD-0314	FA	3426A	Faculty Room (Interior Wall Removed)	KC	5/31/2025	7:01:00 AM
SCSD-0319	HA	3431	Corridor E12-E15	WF	5/31/2025	7:04:00 AM
SCSD-0376	OF	2189	Library Office	KC	5/31/2025	7:18:00 AM
SCSD-0377	HA	2191	Quarter Mile Corridor South	WF	5/31/2025	7:10:00 AM
SCSD-0378	HA	2191	Quarter Mile Corridor South	WC	5/31/2025	7:10:00 AM
SCSD-0380	NO	2274	Nurse's Office	NS	5/31/2025	7:23:00 AM
SCSD-0381	NO	2274	Nurse's Office	NS	5/31/2025	7:24:00 AM
SCSD-0383	FA	2265B	Main Hall Copy Room	KC	5/31/2025	7:31:00 AM
SCSD-0385	HA	2257	Main Entrance Corridor	WF	5/31/2025	7:53:00 AM
SCSD-0386	HA	2257	Main Entrance Corridor	WC	5/31/2025	7:34:00 AM
SCSD-0389	HA	2191	Quarter Mile Corridor South	WF	5/31/2025	7:40:00 AM
SCSD-0390	HA	2191.	Quarter Mile Corridor South	WC	5/31/2025	7:40:00 AM
SCSD-0391	OF	2281	Business Education Office	KC	5/31/2025	7:43:00 AM
SCSD-0393	FA	2178A	Guidance Office Kitchen G10	KC	5/31/2025	7:45:00 AM
SCSD-0399	HA	2147	A Wing Corridor	WF	5/31/2025	7:46:00 AM
SCSD-0400	HA	2147	A Wing Corridor	WC	5/31/2025	7:47:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 04 25

Building Address
70 South Woods Road
Syosset , NY 11791

Analysis Type: ELAP 200.5
Lab Recieved: DAVID WHARTON 6/4/25 6:54 PM
Signature: David Wharton

Samplers Name: Jeevan George
Samplers Signature:
JCB Project Manager: Bryan Frelicos

PB 200.8 6/12/25
PB 200.8 6/19/25

Lead in Water: Chain of Custody for ED52900

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: Syosset High School
SHS

Client: Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1221	LR	2331	Girl's Locker Room	WF	5/31/2025	8:15:00 AM
SCSD-1222	LR	2331	Girl's Locker Room	WC	5/31/2025	8:15:00 AM
SCSD-1226	GY	2332	Auxiliary Gym	DW	5/31/2025	8:11:00 AM
SCSD-1286	OF/LR	2306A	Trainer's Office and Part of Locker Room share a Space ID	IM	5/31/2025	7:57:00 AM
SCSD-1288	GY	2293	Main Gym	DW	5/31/2025	7:59:00 AM
SCSD-1378	GY	2332	Auxiliary Gym	DW	5/31/2025	8:24:00 AM
SCSD-1384	HA	NA	Corridor (Fitness Center)	WF	5/31/2025	8:27:00 AM
SCSD-1385	HA	NA	Corridor (Fitness Center)	WC	5/31/2025	8:27:00 AM
SCSD-1386	HA	NA	Corridor (Fitness Center)	WC	5/31/2025	8:27:00 AM
SCSD-1391	OF	NA	Admin Office (Fitness Center)	KC	5/31/2025	8:30:00 AM
SCSD-1392	GY	NA	Fitness Center	WF	5/31/2025	8:31:00 AM
SCSD-1393	GY	NA	Fitness Center	WC	5/31/2025	8:32:00 AM
SCSD-1394	GY	NA	Fitness Center	WC	5/31/2025	8:33:00 AM
SCSD-1448	CA	2234	Cafeteria West	WF	5/31/2025	6:18:00 AM
SCSD-1449	CA	2234	Cafeteria West	WC	5/31/2025	6:18:00 AM
SCSD-1450	LR	2045	Corridor D Wing to Cafeteria	WF	5/31/2025	6:29:00 AM
SCSD-1452	HA	2033	Corridor Room D6A to D10 o/s 105B Office	WF	5/31/2025	6:35:00 AM
SCSD-1454	HA	N/A	Corridor E30's	WF	5/31/2025	6:50:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 04 25, PM06:54

Building Address
70 South Woods Road
Syosset , NY 11791

Analysis Type: ELAP 200.5
Lab Recieved: DAVID WHARTON 6/4/25 6:54 PM
Signature: David Wharton

Samplers Name: Jeevan George
Samplers Signature:
JCB Project Manager: Bryan Feelus

PB200.8 6/4/25 PB200.8 6/12/25

Lead in Water: Chain of Custody for ED52900

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: Syosset High School

SHS

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1455	HA	N/A	Corridor E30's	WC	5/31/2025	6:50:00 AM
SCSD-1456	GY	2293	Main Gym	DW	5/31/2025	8:00:00 AM
SCSD-1513	HA	NA	Corridor (E90's)	WF	5/31/2025	6:46:00 AM
SCSD-1514	HA	NA	Corridor (E90's)	WC	5/31/2025	6:46:00 AM
SCSD-1515	HA	2308	Corridor Between Gym & Locker Rooms	WF	5/31/2025	8:06:00 AM
SCSD-1516	HA	2308	Corridor Between Gym & Locker Rooms	WC	5/31/2025	8:07:00 AM
SCSD-1777	EX	N/A	Exterior of Barn	WF	5/31/2025	8:45:00 AM
SCSD-1778	EX	N/A	Exterior of Barn	WC	5/31/2025	8:45:00 AM
SCSD-1779	EX	N/A	Exterior o/s Fitness Center	WF	5/31/2025	8:45:00 AM
SCSD-1780	EX	N/A	Exterior o/s Fitness Center	WC	5/31/2025	8:46:00 AM

Samples Submitted 64

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 04 25, PM06:54

PB200-8 SK 6/12/25

PB200-8 SK 6/6/25

Building Address
70 South Woods Road
Syosset , NY 11791

Analysis Type: ELAP 200.5

Lab Recieved: DAVID WHARTON 6/4/25 6:54 PM

Signature: David Wharton

Samplers Name: Folvan George

Samplers Signature:

JCB Project Manager: Bryan Fabius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0011		**Lims Reference ID:**		**ED52900-01**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**1.9**		1	1.0	µg/L	06/09/25 14:58	06/09/25 14:58	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0012		**Lims Reference ID:**		**ED52900-02**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**1.9**		1	1.0	µg/L	06/09/25 15:00	06/09/25 15:00	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0013		**Lims Reference ID:**		**ED52900-03**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 15:01	06/09/25 15:01	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0014		**Lims Reference ID:**		**ED52900-04**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 15:02	06/09/25 15:02	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0015		**Lims Reference ID:**		**ED52900-05**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 15:26	06/09/25 15:26	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0016		**Lims Reference ID:**		**ED52900-06**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 15:30	06/09/25 15:30	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0017		**Lims Reference ID:**		**ED52900-07**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 15:31	06/09/25 15:31	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0041		**Lims Reference ID:**		**ED52900-08**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 15:32	06/09/25 15:32	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0042		**Lims Reference ID:**		**ED52900-09**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0042 (Continued)		**Lims Reference ID:**		**ED52900-09**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/09/25 15:34	06/09/25 15:34	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0043		**Lims Reference ID:**		**ED52900-10**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 15:38	06/09/25 15:38	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0045		**Lims Reference ID:**		**ED52900-11**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	9.3		1	1.0	µg/L	06/09/25 15:39	06/09/25 15:39	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0046		**Lims Reference ID:**		**ED52900-12**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	1.2		1	1.0	µg/L	06/09/25 15:40	06/09/25 15:40	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0047		**Lims Reference ID:**		**ED52900-13**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	2.7		1	1.0	µg/L	06/09/25 15:42	06/09/25 15:42	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0048		**Lims Reference ID:**		**ED52900-14**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	3.5		1	1.0	µg/L	06/09/25 15:43	06/09/25 15:43	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0049		**Lims Reference ID:**		**ED52900-15**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	3.0		1	1.0	µg/L	06/10/25 15:00	06/10/25 15:00	BP	EPA 200.8 (Dig)/EPA 200.8
Sample: SCSD-0054		**Lims Reference ID:**		**ED52900-16**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	2.1		1	1.0	µg/L	06/09/25 15:44	06/09/25 15:44	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0055		**Lims Reference ID:**		**ED52900-17**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0055 (Continued)		**Lims Reference ID:**		**ED52900-17**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/09/25 15:48	06/09/25 15:48	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0056		**Lims Reference ID:**		**ED52900-18**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	2.9		1	1.0	µg/L	06/09/25 15:50	06/09/25 15:50	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0208		**Lims Reference ID:**		**ED52900-19**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 15:54	06/09/25 15:54	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0303		**Lims Reference ID:**		**ED52900-20**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	2.1		1	1.0	µg/L	06/09/25 15:55	06/09/25 15:55	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0314		**Lims Reference ID:**		**ED52900-21**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	2.0		1	1.0	µg/L	06/09/25 15:56	06/09/25 15:56	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0319		**Lims Reference ID:**		**ED52900-22**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 15:58	06/09/25 15:58	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0376		**Lims Reference ID:**		**ED52900-23**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	2.3		1	1.0	µg/L	06/09/25 15:59	06/09/25 15:59	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0377		**Lims Reference ID:**		**ED52900-24**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:00	06/09/25 16:00	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0378		**Lims Reference ID:**		**ED52900-25**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0378 (Continued)		**Lims Reference ID:**		**ED52900-25**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:02	06/09/25 16:02	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0380		**Lims Reference ID:**		**ED52900-26**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:17	06/09/25 16:17	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0381		**Lims Reference ID:**		**ED52900-27**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:21	06/09/25 16:21	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0383		**Lims Reference ID:**		**ED52900-28**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	1.6		1	1.0	µg/L	06/09/25 16:22	06/09/25 16:22	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0385		**Lims Reference ID:**		**ED52900-29**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:24	06/09/25 16:24	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0386		**Lims Reference ID:**		**ED52900-30**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:25	06/09/25 16:25	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0389		**Lims Reference ID:**		**ED52900-31**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:29	06/09/25 16:29	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0390		**Lims Reference ID:**		**ED52900-32**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:30	06/09/25 16:30	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0391		**Lims Reference ID:**		**ED52900-33**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0391 (Continued)		**Lims Reference ID:**		**ED52900-33**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:32	06/09/25 16:32	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0393		**Lims Reference ID:**		**ED52900-34**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	2.8		1	1.0	µg/L	06/09/25 16:33	06/09/25 16:33	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0399		**Lims Reference ID:**		**ED52900-35**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:34	06/09/25 16:34	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0400		**Lims Reference ID:**		**ED52900-36**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:36	06/09/25 16:36	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1221		**Lims Reference ID:**		**ED52900-37**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:40	06/09/25 16:40	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1222		**Lims Reference ID:**		**ED52900-38**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:41	06/09/25 16:41	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1226		**Lims Reference ID:**		**ED52900-39**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	3.9		1	1.0	µg/L	06/09/25 16:45	06/09/25 16:45	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1286		**Lims Reference ID:**		**ED52900-40**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 16:46	06/09/25 16:46	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1288		**Lims Reference ID:**		**ED52900-41**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1288 (Continued)		**Lims Reference ID:**		**ED52900-41**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals (Continued)									
Lead	**2.5**		1	1.0	µg/L	06/09/25 16:47	06/09/25 16:47	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1378		**Lims Reference ID:**		**ED52900-42**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**102**		10	10.0	µg/L	06/10/25 15:24	06/10/25 15:24	BP	EPA 200.8 (Dig)/EPA 200.8
Sample: SCSD-1384		**Lims Reference ID:**		**ED52900-43**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 16:49	06/09/25 16:49	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1385		**Lims Reference ID:**		**ED52900-44**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 16:50	06/09/25 16:50	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1386		**Lims Reference ID:**		**ED52900-45**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 16:51	06/09/25 16:51	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1391		**Lims Reference ID:**		**ED52900-46**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**1.8**		1	1.0	µg/L	06/09/25 16:53	06/09/25 16:53	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1392		**Lims Reference ID:**		**ED52900-47**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 13:24	06/12/25 13:24	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1393		**Lims Reference ID:**		**ED52900-48**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 13:28	06/12/25 13:28	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1394		**Lims Reference ID:**		**ED52900-49**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1394 (Continued)		**Lims Reference ID:**		**ED52900-49**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:29	06/12/25 13:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1448		**Lims Reference ID:**		**ED52900-50**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:30	06/12/25 13:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1449		**Lims Reference ID:**		**ED52900-51**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:32	06/12/25 13:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1450		**Lims Reference ID:**		**ED52900-52**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:36	06/12/25 13:36	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1452		**Lims Reference ID:**		**ED52900-53**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:37	06/12/25 13:37	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1454		**Lims Reference ID:**		**ED52900-54**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:38	06/12/25 13:38	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1455		**Lims Reference ID:**		**ED52900-55**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:40	06/12/25 13:40	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1456		**Lims Reference ID:**		**ED52900-56**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	1.2		1	1.0	µg/L	06/12/25 13:41	06/12/25 13:41	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1513		**Lims Reference ID:**		**ED52900-57**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1513 (Continued)		**Lims Reference ID:**		**ED52900-57**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:42	06/12/25 13:42	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1514		**Lims Reference ID:**		**ED52900-58**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:46	06/12/25 13:46	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1515		**Lims Reference ID:**		**ED52900-59**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:48	06/12/25 13:48	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1516		**Lims Reference ID:**		**ED52900-60**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:52	06/12/25 13:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1777		**Lims Reference ID:**		**ED52900-61**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:53	06/12/25 13:53	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1778		**Lims Reference ID:**		**ED52900-62**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:54	06/12/25 13:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1779		**Lims Reference ID:**		**ED52900-63**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:56	06/12/25 13:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1780		**Lims Reference ID:**		**ED52900-64**	**Matrix: Drinking Water**			**Sampled:**	**05/31/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/12/25 13:57	06/12/25 13:57	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552900
LIMS Reference ID: ED52900
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Syosset High School SHS, 70 South Woods Road, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 18:54
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED53084

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: Berry Hill Elementary School

BHE

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0615	HA	2063	Multi Purpose Room Corridor	WF	6/2/2025	5:49:00 AM
SCSD-0616	HA	2063	Multi Purpose Room Corridor	WC	6/2/2025	5:49:00 AM
SCSD-0617	HA	2063	Multi Purpose Room Corridor	HW	6/2/2025	5:49:00 AM
SCSD-0620	KI	2063A	Kitchen Room	KC	6/2/2025	5:46:00 AM
SCSD-0626	FA	2034	Room E/Gym Office	KC	6/2/2025	6:01:00 AM
SCSD-1425	HA	NA	Corridor by D5	WF	6/2/2025	5:42:00 AM
SCSD-1426	HA	NA	Corridor by D5	WC	6/2/2025	5:42:00 AM
SCSD-1433	HA	2081	Corridor Coach's Office to Main Entrance	WF	6/2/2025	5:57:00 AM
SCSD-1434	HA	2081	Corridor Coach's Office to Main Entrance	WC	6/2/2025	5:57:00 AM
SCSD-1435	HA	2082	Corridor	WF	6/2/2025	6:05:00 AM
SCSD-1436	HA	2082	Corridor	WC	6/2/2025	6:05:00 AM

Samples Submitted 11

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 09 25, PM08:43

PB200.8 SM 6/12/25

Building Address
181 Cold Spring Road
Syosset , NY 11791

Analysis Type: ELAP 200.5

Lab Recieved: A. Minnifield

Signature: A. Minnifield

Samplers Name: Trevan Gage

Samplers Signature:

JCB Project Manager: Bryan Ezelin

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553084
LIMS Reference ID: ED53084
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Berry Hill Elementary School, Syosset Central School District, 181 Cold Spring Road, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/10/2025 08:43
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0615		**Lims Reference ID:**		**ED53084-01**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:38	06/12/25 11:38	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0616		**Lims Reference ID:**		**ED53084-02**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:42	06/12/25 11:42	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0617		**Lims Reference ID:**		**ED53084-03**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:43	06/12/25 11:43	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0620		**Lims Reference ID:**		**ED53084-04**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**1.2**		1	1.0	µg/L	06/12/25 11:44	06/12/25 11:44	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0626		**Lims Reference ID:**		**ED53084-05**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:48	06/12/25 11:48	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1425		**Lims Reference ID:**		**ED53084-06**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:50	06/12/25 11:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1426		**Lims Reference ID:**		**ED53084-07**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:51	06/12/25 11:51	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1433		**Lims Reference ID:**		**ED53084-08**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:52	06/12/25 11:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1434		**Lims Reference ID:**		**ED53084-09**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553084
LIMS Reference ID: ED53084
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Berry Hill Elementary School, Syosset Central School District, 181 Cold Spring Road, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/10/2025 08:43
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1434 (Continued)		**Lims Reference ID:**		**ED53084-09**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals (Continued)									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:54	06/12/25 11:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1435		**Lims Reference ID:**		**ED53084-10**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:55	06/12/25 11:55	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1436		**Lims Reference ID:**		**ED53084-11**	**Matrix: Drinking Water**			**Sampled:**	**06/02/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/12/25 11:56	06/12/25 11:56	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553084
LIMS Reference ID: ED53084
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Berry Hill Elementary School, Syosset Central School District, 181 Cold Spring Road, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/10/2025 08:43
Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553084
LIMS Reference ID: ED53084
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Berry Hill Elementary School, Syosset Central School District, 181 Cold Spring Road, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/10/2025 08:43
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Lead in Water: Chain of Custody for ED52378

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: South Grove Elementary School

SGE

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush_____

Walk In

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0997	CA	2092	Multi Purpose Room	WF	6/3/2025	5:46:00 AM
SCSD-0999	CA	2092	Multi Purpose Room	KC	6/3/2025	5:48:00 AM
SCSD-1000	CA	2092	Multi Purpose Room	KC	6/3/2025	5:50:00 AM
SCSD-1008	FL	2044	Faculty Lounge - Room 15	KC	6/3/2025	6:02:00 AM
SCSD-1251	HA	NA	Gym Hallway	WF	6/3/2025	6:08:00 AM
SCSD-1252	HA	NA	Gym Hallway	WC	6/3/2025	6:08:00 AM
SCSD-1441	HA	2046	Corridor Main Office to Boiler Room	WF	6/3/2025	6:00:00 AM
SCSD-1442	HA	2046	Corridor Main Office to Boiler Room	WC	6/3/2025	6:00:00 AM
SCSD-1443	HA	2098	Corridor Room 32 - Main Entrance	WF	6/3/2025	5:55:00 AM
SCSD-1444	HA	2098	Corridor Room 32 - Main Entrance	WC	6/3/2025	5:55:00 AM
SCSD-1445	CA	2092	Multi Purpose Room	KC	6/3/2025	5:51:00 AM

Samples Submitted 11

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 04 25, AM11:55

Building Address
60 Colony Lane
Syosset, NY 11791

Analysis Type: ELAP 200.5

Lab Recieved: A. Minnifield

Signature: A. Minnifield
6-4-25 11:55AM

Samplers Name: Jeevan George

Samplers Signature: [signature]

JCB Project Manager: Bryan Ezdinis

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552878
LIMS Reference ID: ED52878
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Grove Elementary School, SGE, Syosset Central School District, 60 Colony Lane, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:55
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0997		**Lims Reference ID:**		**ED52878-01**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 20:12	06/06/25 20:12	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0999		**Lims Reference ID:**		**ED52878-02**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	1.5		1	1.0	µg/L	06/06/25 20:13	06/06/25 20:13	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1000		**Lims Reference ID:**		**ED52878-03**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	1.6		1	1.0	µg/L	06/06/25 20:15	06/06/25 20:15	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1008		**Lims Reference ID:**		**ED52878-04**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	4.3		1	1.0	µg/L	06/06/25 20:16	06/06/25 20:16	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1251		**Lims Reference ID:**		**ED52878-05**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 20:17	06/06/25 20:17	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1252		**Lims Reference ID:**		**ED52878-06**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 20:19	06/06/25 20:19	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1441		**Lims Reference ID:**		**ED52878-07**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 20:23	06/06/25 20:23	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1442		**Lims Reference ID:**		**ED52878-08**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/06/25 20:24	06/06/25 20:24	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1443		**Lims Reference ID:**		**ED52878-09**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552878
LIMS Reference ID: ED52878
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Grove Elementary School, SGE, Syosset Central School District, 60 Colony Lane, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:55
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1443 (Continued)		**Lims Reference ID:**		**ED52878-09**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals (Continued)									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 20:28	06/06/25 20:28	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1444		**Lims Reference ID:**		**ED52878-10**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 20:29	06/06/25 20:29	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1445		**Lims Reference ID:**		**ED52878-11**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**7.8**		1	1.0	µg/L	06/06/25 20:30	06/06/25 20:30	KT	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552878
LIMS Reference ID: ED52878
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Grove Elementary School, SGE, Syosset Central School District, 60 Colony Lane, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:55
Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552878
LIMS Reference ID: ED52878
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Grove Elementary School, SGE, Syosset Central School District, 60 Colony Lane, Syosset NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:55
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Pb200.8 8/L 6/9/25

ED52898

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: South Grove Annex

SGA

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush_____

Walk In

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1049	HA	2034	Corridor near Boiler Room	WF	6/3/2025	6:30:00 AM
SCSD-1050	HA	2034	Corridor near Boiler Room	WC	6/3/2025	6:21:00 AM
SCSD-1052	CA	2006	Kitchen	KC	6/3/2025	6:31:00 AM
SCSD-1053	CA	2006	Kitchen	KC	6/3/2025	6:32:00 AM
SCSD-1061	FL	2024	Faculty Room	CF	6/3/2025	6:20:00 AM
SCSD-1065	HA	2033	Corridor Room 5-7	WF	6/3/2025	6:18:00 AM
SCSD-1066	HA	2033	Corridor Room 5-7	WC	6/3/2025	6:18:00 AM
SCSD-1379	CA	2031	Multi Purpose Room	HW	6/3/2025	6:19:00 AM
SCSD-1446	HA	2032	Corridor Rooms 1-3	WF	6/3/2025	6:28:00 AM
SCSD-1447	HA	2032	Corridor Rooms 1-3	WC	6/3/2025	6:28:00 AM

Samples Submitted 10

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 04 25, AM11:51

Building Address
60 Colony Lane
Syosset , NY 11791

Analysis Type: ELAP 200.5

Lab Recieved: DAVID WHARTON 6/4/25 11:51 AM

Signature: David Wharton

Samplers Name: Joyce George

Samplers Signature:

JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552898
LIMS Reference ID: ED52898
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Annex SGA, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:51
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1049		**Lims Reference ID:**		**ED52898-01**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 22:10	06/06/25 22:10	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1050		**Lims Reference ID:**		**ED52898-02**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 22:11	06/06/25 22:11	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1052		**Lims Reference ID:**		**ED52898-03**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 22:12	06/06/25 22:12	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1053		**Lims Reference ID:**		**ED52898-04**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**1.4**		1	1.0	µg/L	06/06/25 22:14	06/06/25 22:14	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1061		**Lims Reference ID:**		**ED52898-05**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**17.0**		1	1.0	µg/L	06/06/25 22:15	06/06/25 22:15	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1065		**Lims Reference ID:**		**ED52898-06**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/06/25 22:16	06/06/25 22:16	KT	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1066		**Lims Reference ID:**		**ED52898-07**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 11:40	06/09/25 11:40	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1379		**Lims Reference ID:**		**ED52898-08**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**2.4**		1	1.0	µg/L	06/09/25 11:41	06/09/25 11:41	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1446		**Lims Reference ID:**		**ED52898-09**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552898
LIMS Reference ID: ED52898
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Annex SGA, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:51
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1446 (Continued)		**Lims Reference ID:**		**ED52898-09**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals (Continued)									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 11:42	06/09/25 11:42	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1447		**Lims Reference ID:**		**ED52898-10**	**Matrix: Drinking Water**			**Sampled:**	**06/03/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/09/25 12:11	06/09/25 12:11	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552898
LIMS Reference ID: ED52898
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Annex SGA, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:51
Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552898
LIMS Reference ID: ED52898
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Annex SGA, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/04/2025 11:51
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Lead in Water: Chain of Custody for

ED53192

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: Baylis Elementary School

BES

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1072	HA	2084	Corridor Room 9 to 14	WF	6/5/2025	6:55:00 AM
SCSD-1073	HA	2084	Corridor Room 9 to 14	WC	6/5/2025	6:55:00 AM
SCSD-1123	HA	2083	Corridor Main Office to Cafeteria	WF	6/5/2025	6:58:00 AM
SCSD-1124	HA	2083	Corridor Main Office to Cafeteria	WC	6/5/2025	6:58:00 AM
SCSD-1125	CA	2002	Cafeteria	KC	6/5/2025	7:00:00 AM
SCSD-1126	CA	2002	Cafeteria	KC	6/5/2025	7:00:00 AM
SCSD-1127	CA	2002	Cafeteria	KC	6/5/2025	7:00:00 AM
SCSD-1437	HA	2079	Corridor Fish Bowl to Stage	WF	6/5/2025	6:53:00 AM
SCSD-1438	HA	2079	Corridor Fish Bowl to Stage	WC	6/5/2025	6:53:00 AM

Samples Submitted 9

Pb200.8 ALL 6/6/25

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 12 25, PM06:06

Building Address
580 Woodbury Road
Plainview , NY 11803

Analysis Type: ELAP 200.5

Lab Recieved: 6/12/25 18:06

Signature: Kay Wagner

Samplers Name: Jeaon George

Samplers Signature:

JCB Project Manager: Bryan Fedkiw

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553192
LIMS Reference ID: ED53192
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: Baylis Elementary School: 580 Woodbury Road, Plainview, NY 11803: Syosset Central School District: Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1072		**Lims Reference ID:**		**ED53192-01**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 06:55:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 09:50	06/16/25 09:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1073		**Lims Reference ID:**		**ED53192-02**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 06:55:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 09:51	06/16/25 09:51	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1123		**Lims Reference ID:**		**ED53192-03**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 06:58:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 09:52	06/16/25 09:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1124		**Lims Reference ID:**		**ED53192-04**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 06:58:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 09:53	06/16/25 09:53	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1125		**Lims Reference ID:**		**ED53192-05**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 07:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 09:55	06/16/25 09:55	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1126		**Lims Reference ID:**		**ED53192-06**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 07:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 09:56	06/16/25 09:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1127		**Lims Reference ID:**		**ED53192-07**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 07:00:00**
Metals									
Lead	1.7		1	1.0	µg/L	06/16/25 09:57	06/16/25 09:57	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1437		**Lims Reference ID:**		**ED53192-08**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 06:53:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 10:01	06/16/25 10:01	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1438		**Lims Reference ID:**		**ED53192-09**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 06:53:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553192
LIMS Reference ID: ED53192
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: Baylis Elementary School: 580 Woodbury Road, Plainview, NY 11803: Syosset Central School District: Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1438 (Continued)			**Lims Reference ID:**		**ED53192-09 Matrix: Drinking Water**				**Sampled: 06/05/25 06:53:00**
Metals (Continued)									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 10:10	06/16/25 10:10	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553192

LIMS Reference ID: ED53192

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: Baylis Elementary School: 580 Woodbury Road, Plainview, NY 11803: Syosset Central School District: Project# 23-53856

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/12/2025 18:06

Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553192
LIMS Reference ID: ED53192
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: Baylis Elementary School: 580 Woodbury Road, Plainview, NY 11803: Syosset Central School District: Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Lead in Water: Chain of Custody for EDS 3193

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Maintenance Building
MB

Client:
Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1427	OF	1003	Locker/Common Room	WF	6/5/2025	6:15:00 AM
SCSD-1428	OF	1003	Locker/Common Room	WC	6/5/2025	6:15:00 AM

Samples Submitted 2

PO200-8 AB 6/5/25

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 12 25, PM06:06

Building Address
482 Woodbury Road
Woodbury , NY 11797

Analysis Type: ELAP 200.5
Lab Recieved: 6/2/25 18:06
Signature: Ivan Wagner

Samplers Name: John George
Samplers Signature:
JCB Project Manager: Bryan Erdle

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553193
LIMS Reference ID: ED53193
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: Maintenance Building: MB: 482 Woodbury Road, Woodbury, NY 11797: Syosset Central School District Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1427		**Lims Reference ID:**		**ED53193-01**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 06:15:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 10:11	06/16/25 10:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1428		**Lims Reference ID:**		**ED53193-02**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 06:15:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 10:13	06/16/25 10:13	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553193
LIMS Reference ID: ED53193
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: Maintenance Building: MB: 482 Woodbury Road, Woodbury, NY 11797: Syosset Central School District Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553193
LIMS Reference ID: ED53193
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: Maintenance Building: MB: 482 Woodbury Road, Woodbury, NY 11797: Syosset Central School District Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED53194

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: Maintenance Garage

MG

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1415	ST	NA	Wood Storage (Barn)	BW	6/5/2025	6:18:00 AM
SCSD-1416	ST	NA	Wood Storage (Barn)	WC	6/5/2025	6:18:00 AM

Samples Submitted 2

Pb 200.8 ALL Details

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 12 25, PM06:05

Building Address
482 Woodbury Road
Woodbury , NY 11797

Analysis Type: ELAP 200.5

Lab Recieved: AStanley 6/12/25

Signature: 6:05pm

Samplers Name: Sean Geary

Samplers Signature:

JCB Project Manager: Bryan Eselson

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553194
LIMS Reference ID: ED53194
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Maintenance Garage, MG, Syosset Central School District, 482 Woodbury Road, Woodbury, NY 11797
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:05
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1415		**Lims Reference ID:**		**ED53194-01**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 10:14	06/16/25 10:14	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1416		**Lims Reference ID:**		**ED53194-02**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 10:15	06/16/25 10:15	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553194
LIMS Reference ID: ED53194
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Maintenance Garage, MG, Syosset Central School District, 482 Woodbury Road, Woodbury, NY 11797
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:05
Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553194
LIMS Reference ID: ED53194
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Maintenance Garage, MG, Syosset Central School District, 482 Woodbury Road, Woodbury, NY 11797
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:05
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED53196

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: Walt Whitman Elementary School

WWE

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: Normal 1 wk Rush_____

Pb200 8 ppb 6/16/25

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1297	HA	2068	Corridor Room 2 to Room 6	WF	6/5/2025	5:53:00 AM
SCSD-1298	HA	2068	Corridor Room 2 to Room 6	WC	6/5/2025	5:53:00 AM
SCSD-1317	HA	2075	Corridor to Room A-C	WF	6/5/2025	6:02:00 AM
SCSD-1318	HA	2075	Corridor to Room A-C	WC	6/5/2025	6:02:00 AM
SCSD-1333	FA	2028	Faculty Lounge	KC	6/5/2025	6:07:00 AM
SCSD-1336	HA	2067	Corridor from Room 19 to Boy's Bathroom	WF	6/5/2025	5:37:00 AM
SCSD-1337	HA	2067	Corridor from Room 19 to Boy's Bathroom	WC	6/5/2025	5:37:00 AM
SCSD-1361	KI	2043	Kitchen/Serving Area	HW	6/5/2025	5:22:00 AM
SCSD-1362	KI	2043	Kitchen/Serving Area	KC	6/5/2025	5:21:00 AM
SCSD-1363	HA	2069A	Corridor Music Room to Main Office	WF	6/5/2025	5:17:00 AM
SCSD-1364	HA	2069A	Corridor Music Room to Main Office	WC	6/5/2025	5:17:00 AM

Samples Submitted 11

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 12 25, PM06:06

Building Address
482 Woodbury Road
Woodbury , NY 11797

Analysis Type: ELAP 200.5

Lab Recieved: AStanley 6/12/25

Signature: 6:05pm

Samplers Name: Jason George

Samplers Signature:

JCB Project Manager: Bryan Fazlius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553196
LIMS Reference ID: ED53196
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Walt Whitman Elementary School, WWE, Syosset Central School District, 482 Woodbury Road, Woodbury, NY 11797
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1297		**Lims Reference ID:**		**ED53196-01**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:55	06/16/25 11:55	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1298		**Lims Reference ID:**		**ED53196-02**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:57	06/16/25 11:57	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1317		**Lims Reference ID:**		**ED53196-03**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:58	06/16/25 11:58	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1318		**Lims Reference ID:**		**ED53196-04**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:59	06/16/25 11:59	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1333		**Lims Reference ID:**		**ED53196-05**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	4.3		1	1.0	µg/L	06/16/25 12:00	06/16/25 12:00	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1336		**Lims Reference ID:**		**ED53196-06**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 12:02	06/16/25 12:02	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1337		**Lims Reference ID:**		**ED53196-07**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 12:13	06/16/25 12:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1361		**Lims Reference ID:**		**ED53196-08**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	2.0		1	1.0	µg/L	06/16/25 12:17	06/16/25 12:17	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1362		**Lims Reference ID:**		**ED53196-09**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553196
LIMS Reference ID: ED53196
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Walt Whitman Elementary School, WWE, Syosset Central School District, 482 Woodbury Road, Woodbury, NY 11797
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1362 (Continued)		**Lims Reference ID:**		**ED53196-09**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals (Continued)									
Lead	**3.6**		1	1.0	µg/L	06/16/25 12:18	06/16/25 12:18	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1363		**Lims Reference ID:**		**ED53196-10**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 12:20	06/16/25 12:20	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1364		**Lims Reference ID:**		**ED53196-11**	**Matrix: Drinking Water**			**Sampled:**	**06/05/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 12:21	06/16/25 12:21	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553196
LIMS Reference ID: ED53196
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Walt Whitman Elementary School, WWE, Syosset Central School District, 482 Woodbury Road, Woodbury, NY 11797
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553196
LIMS Reference ID: ED53196
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Walt Whitman Elementary School, WWE, Syosset Central School District, 482 Woodbury Road, Woodbury, NY 11797
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:06
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Lead in Water: Chain of Custody for ED53195

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: South Woods Middle School
SWM

Client:
Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush_____

Pb200.8 SM 6/16/25

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0435	HA	2143	Corridor North Cafeteria to Boy's Bathroom	WF	6/6/2025	6:50:00 AM
SCSD-0436	HA	2143	Corridor North Cafeteria to Boy's Bathroom	WC	6/6/2025	6:50:00 AM
SCSD-0456	HE	3187	Room 204	EC	6/6/2025	5:50:00 AM
SCSD-0457	HE	3187	Room 204	EC	6/6/2025	5:51:00 AM
SCSD-0458	HE	3187	Room 204	EC	6/6/2025	5:51:00 AM
SCSD-0459	HE	3187	Room 204	EC	6/6/2025	5:52:00 AM
SCSD-0460	HE	3187	Room 204	EC	6/6/2025	5:53:00 AM
SCSD-0462	HE	3186	Room 202	EC	6/6/2025	5:56:00 AM
SCSD-0463	HE	3186	Room 202	EC	6/6/2025	5:56:00 AM
SCSD-0464	HE	3186	Room 202	EC	6/6/2025	5:57:00 AM
SCSD-0465	HE	3186	Room 202	EC	6/6/2025	5:58:00 AM
SCSD-0466	HE	3186	Room 202	EC	6/6/2025	5:58:00 AM
SCSD-0481	NO	2173	Nurse's Sick Room	NS	6/6/2025	6:16:00 AM
SCSD-0529	HA	2060	Corridor Library to Room 102	WF	6/6/2025	6:08:00 AM
SCSD-0530	HA	2060	Corridor Library to Room 102	WC	6/6/2025	6:08:00 AM
SCSD-0561	KI	2136	Kitchen	KC	6/6/2025	6:33:00 AM
SCSD-0564	KI	2136	Kitchen	KC	6/6/2025	6:34:00 AM
SCSD-0565	KI	2136	Kitchen	PK	6/6/2025	6:38:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 12 25 PM06:07

Building Address
99 Pell Lane
Syosset , NY 11791

Walk In

Analysis Type: ELAP 200.5
Lab Recieved: 6/12/25 13:07
Signature: Kay Wagner

Samplers Name: Dylan George
Samplers Signature:
JCB Project Manager: Bryan Eselus

Lead in Water: Chain of Custody for ED53195

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: South Woods Middle School
SWM

Client:
Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush_____

Pb200.8 SM 6/16/25

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0566	KI	2136	Kitchen	IM	6/6/2025	6:29:00 AM
SCSD-0567	KI	2136A	Kitchen Pantry	HW	6/6/2025	6:36:00 AM
SCSD-0573	FA	2139	Faculty Lounge	KC	6/6/2025	5:42:00 AM
SCSD-0574	FA	2179B	Superintendent's Kitchen	KC	6/6/2025	6:24:00 AM
SCSD-1419	HA	2060	Corridor Library to Room 102	WF	6/6/2025	7:20:00 AM
SCSD-1420	HA	2060	Corridor Library to Room 102	WC	6/6/2025	7:20:00 AM
SCSD-1421	HA	2157	Main Entrance Corridor	WF	6/6/2025	6:18:00 AM
SCSD-1422	HA	2157	Main Entrance Corridor	WC	6/6/2025	6:18:00 AM
SCSD-1423	CA	2132	South Cafeteria	WF	6/6/2025	6:44:00 AM
SCSD-1424	CA	2132	South Cafeteria	WC	6/6/2025	6:45:00 AM
SCSD-1429	ST	010	Basement Open Storage/Copy Area	WF	6/6/2025	7:12:00 AM
SCSD-1439	LI	2011	Library	KC	6/6/2025	6:11:00 AM
SCSD-1440	FA	2165	Main Office Kitchen	KC	6/6/2025	6:20:00 AM
SCSD-1457	KI	2136	Kitchen	KC	6/6/2025	6:40:00 AM
SCSD-1458	KI	2136	Kitchen	KC	6/6/2025	6:40:00 AM
SCSD-1459	CC	2095B	Gym Boy's Locker Room Coach Office	IM	6/6/2025	6:57:00 AM
SCSD-1517	HA	3192	Corridor Room 200 to 210	WF	6/6/2025	5:48:00 AM
SCSD-1518	HA	3192	Corridor Room 200 to 210	WC	6/6/2025	5:48:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 12 25 PM06:07

Building Address
99 Pell Lane
Syosset , NY 11791

Analysis Type: ELAP 200.5
Lab Recieved: 6/12/25 18:07
Signature: Ivan Hanson

Samplers Name: Jaqan George
Samplers Signature:
JCB Project Manager: Bryan Eedors

Lead in Water: Chain of Custody for ED53195

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: South Woods Middle School
SWM

Client:
Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1783	CA	2142	North Cafeteria	WF	6/6/2025	6:26:00 AM
SCSD-1784	CA	2142	North Cafeteria	WC	6/6/2025	6:26:00 AM

Samples Submitted 38

Pb200.8 SM 6/16/25

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 12 25, PM06:07

Building Address
99 Pell Lane
Syosset , NY 11791

Analysis Type: ELAP 200.5
Lab Recieved: 6/12/25 18:07
Signature:

Samplers Name: Jasan George
Samplers Signature:
JCB Project Manager: Bryan Fielin

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553195
LIMS Reference ID: ED53195
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: South Woods Middle School: SWM: 99 Pell Lane, Syosset, NY 11791: Syosset Central School District: Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:07
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0435		**Lims Reference ID:**		**ED53195-01**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:50:00**
Metals									
Lead	**1.4**		1	1.0	µg/L	06/16/25 10:17	06/16/25 10:17	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0436		**Lims Reference ID:**		**ED53195-02**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:50:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 10:18	06/16/25 10:18	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0456		**Lims Reference ID:**		**ED53195-03**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:50:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/17/25 10:32	06/17/25 10:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0457		**Lims Reference ID:**		**ED53195-04**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:51:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 10:39	06/16/25 10:39	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0458		**Lims Reference ID:**		**ED53195-05**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:51:00**
Metals									
Lead	**1.5**		1	1.0	µg/L	06/16/25 10:43	06/16/25 10:43	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0459		**Lims Reference ID:**		**ED53195-06**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:52:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 10:44	06/16/25 10:44	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0460		**Lims Reference ID:**		**ED53195-07**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:53:00**
Metals									
Lead	**2.2**		1	1.0	µg/L	06/16/25 10:46	06/16/25 10:46	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0462		**Lims Reference ID:**		**ED53195-08**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:56:00**
Metals									
Lead	**10.1**		1	1.0	µg/L	06/16/25 10:47	06/16/25 10:47	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0463		**Lims Reference ID:**		**ED53195-09**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:56:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553195
LIMS Reference ID: ED53195
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: South Woods Middle School: SWM: 99 Pell Lane, Syosset, NY 11791: Syosset Central School District: Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:07
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0463 (Continued)		**Lims Reference ID:**		**ED53195-09**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:56:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/16/25 10:51	06/16/25 10:51	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0464		**Lims Reference ID:**		**ED53195-10**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:57:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 10:52	06/16/25 10:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0465		**Lims Reference ID:**		**ED53195-11**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:58:00**
Metals									
Lead	1.3		1	1.0	µg/L	06/16/25 10:54	06/16/25 10:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0466		**Lims Reference ID:**		**ED53195-12**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:58:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 10:55	06/16/25 10:55	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0481		**Lims Reference ID:**		**ED53195-13**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:16:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 10:56	06/16/25 10:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0529		**Lims Reference ID:**		**ED53195-14**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:08:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 10:58	06/16/25 10:58	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0530		**Lims Reference ID:**		**ED53195-15**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:08:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:02	06/16/25 11:02	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0561		**Lims Reference ID:**		**ED53195-16**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:33:00**
Metals									
Lead	1.1		1	1.0	µg/L	06/16/25 11:03	06/16/25 11:03	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0564		**Lims Reference ID:**		**ED53195-17**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:34:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553195
LIMS Reference ID: ED53195
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: South Woods Middle School: SWM: 99 Pell Lane, Syosset, NY 11791: Syosset Central School District: Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:07
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0564 (Continued)		**Lims Reference ID:**		**ED53195-17**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:34:00**
Metals (Continued)									
Lead	**1.5**		1	1.0	µg/L	06/16/25 11:07	06/16/25 11:07	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0565		**Lims Reference ID:**		**ED53195-18**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:38:00**
Metals									
Lead	**2330**		25	25.0	µg/L	06/16/25 19:18	06/16/25 19:18	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: SCSD-0566		**Lims Reference ID:**		**ED53195-19**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:29:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 11:08	06/16/25 11:08	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0567		**Lims Reference ID:**		**ED53195-20**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:36:00**
Metals									
Lead	**19.4**		1	1.0	µg/L	06/16/25 11:09	06/16/25 11:09	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0573		**Lims Reference ID:**		**ED53195-21**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:42:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 11:11	06/16/25 11:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0574		**Lims Reference ID:**		**ED53195-22**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:24:00**
Metals									
Lead	**1.2**		1	1.0	µg/L	06/16/25 11:12	06/16/25 11:12	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1419		**Lims Reference ID:**		**ED53195-23**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 07:20:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 11:13	06/16/25 11:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1420		**Lims Reference ID:**		**ED53195-24**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 07:20:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/16/25 11:15	06/16/25 11:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1421		**Lims Reference ID:**		**ED53195-25**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:18:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553195
LIMS Reference ID: ED53195
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: South Woods Middle School: SWM: 99 Pell Lane, Syosset, NY 11791: Syosset Central School District: Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:07
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1421 (Continued)		**Lims Reference ID:**		**ED53195-25**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:18:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:26	06/16/25 11:26	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1422		**Lims Reference ID:**		**ED53195-26**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:18:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:30	06/16/25 11:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1423		**Lims Reference ID:**		**ED53195-27**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:44:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:31	06/16/25 11:31	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1424		**Lims Reference ID:**		**ED53195-28**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:45:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:33	06/16/25 11:33	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1429		**Lims Reference ID:**		**ED53195-29**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 07:12:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:34	06/16/25 11:34	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1439		**Lims Reference ID:**		**ED53195-30**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:11:00**
Metals									
Lead	4.9		1	1.0	µg/L	06/16/25 11:38	06/16/25 11:38	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1440		**Lims Reference ID:**		**ED53195-31**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:20:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:39	06/16/25 11:39	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1457		**Lims Reference ID:**		**ED53195-32**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:40:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:41	06/16/25 11:41	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1458		**Lims Reference ID:**		**ED53195-33**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:40:00**
Metals									

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553195
LIMS Reference ID: ED53195
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: South Woods Middle School: SWM: 99 Pell Lane, Syosset, NY 11791: Syosset Central School District: Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:07
Reported:

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1458 (Continued)		**Lims Reference ID:**		**ED53195-33**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:40:00**
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:42	06/16/25 11:42	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1459		**Lims Reference ID:**		**ED53195-34**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:57:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:43	06/16/25 11:43	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1517		**Lims Reference ID:**		**ED53195-35**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:48:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:45	06/16/25 11:45	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1518		**Lims Reference ID:**		**ED53195-36**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 05:48:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:49	06/16/25 11:49	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1783		**Lims Reference ID:**		**ED53195-37**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:26:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:50	06/16/25 11:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1784		**Lims Reference ID:**		**ED53195-38**	**Matrix: Drinking Water**			**Sampled:**	**06/06/25 06:26:00**
Metals									
Lead	< 1.0		1	1.0	µg/L	06/16/25 11:54	06/16/25 11:54	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553195

LIMS Reference ID: ED53195

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: South Woods Middle School: SWM: 99 Pell Lane, Syosset, NY 11791: Syosset Central School District: Project# 23-53856

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/12/2025 18:07

Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553195
LIMS Reference ID: ED53195
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: South Woods Middle School: SWM: 99 Pell Lane, Syosset, NY 11791: Syosset Central School District: Project# 23-53856
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/12/2025 18:07
Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Lead in Water: Chain of Custody for ED53747

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Baylis Elementary School
BES

Client:
Syosset Central School District

Retest/New Install M
Turn Around: Normal 1 wk Rush_____

Counter

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1486	HA	2079	Corridor Fish Bowl to Stage o/s 2046	WF	6/27/2025	7:26:00 AM
SCSD-1487	HA	2079	Corridor Fish Bowl to Stage o/s 2046	WC	6/27/2025	7:27:00 AM

Samples Submitted 2

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 27 25, PM03:52

Building Address
580 Woodbury Road
Plainview, NY 11803

Analysis Type: ELAP 200.5
Lab Recieved: S. Cherofsky 6/27/25
Signature: S. Cherofsky 3:52pm

Samplers Name: Jarett Boniface
Samplers Signature:
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553747
LIMS Reference ID: ED53747
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Baylis Elementary School, 580 Woodbury Road, Plainview, NY 11803
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 06/27/2025 15:52
Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1486		**Lims Reference ID:**		**ED53747-01**	**Matrix: Drinking Water**			**Sampled:**	**06/26/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/30/25 09:37	06/30/25 09:37	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1487		**Lims Reference ID:**		**ED53747-02**	**Matrix: Drinking Water**			**Sampled:**	**06/26/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	06/30/25 09:38	06/30/25 09:38	SEH	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553747

LIMS Reference ID: ED53747

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Baylis Elementary School, 580 Woodbury Road, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/27/2025 15:52

Reported:

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062553747

LIMS Reference ID: ED53747

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Baylis Elementary School, 580 Woodbury Road, Plainview, NY 11803

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/27/2025 15:52

Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

EE54448

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856

Building: Syosset High School

SHS

Client: Syosset Central School District

Retest/New Install [ ]

Turn Around: (Normal 1 wk) **Rush**_____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1777	EX	N/A	Exterior of Barn	WF	7/3/2024	6:45
SCSD-1778	EX	N/A	Exterior of Barn	WC	7/3/2024	6:31

Samples Submitted 2

RECEIVED
EHSL ANALYTICAL INC.
CARLE PLACE, NY
2024 JUL -3 P 4: 20

Walk In

Building Address
70 South Woods Road
Syosset , NY 11791

Analysis Type: ELAP 200.5

Lab Recieved: Cfaelo

Signature:

Samplers Name: Matthew Martin

Samplers Signature: Matthew Martin

JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062454448
LIMS Reference ID: EC54448
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: JCB#: 23-53856, Syosset High School, Syosset Central School District, 70 South Woods Road, Syosset, NY 11791

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 07/03/2024 16:20
Reported: 07/11/2024 15:26

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1777		**Lims Reference ID:**		**EC54448-01**	**Matrix: Drinking Water**				**Sampled: 07/03/24 00:00:00**
Metals									
Lead	**<1.0**		1	1.0	µg/L	07/11/24 14:37	07/11/24 14:37	BP	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1778		**Lims Reference ID:**		**EC54448-02**	**Matrix: Drinking Water**				**Sampled: 07/03/24 00:00:00**
Metals									
Lead	**1.2**		1	1.0	µg/L	07/11/24 14:38	07/11/24 14:38	BP	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062454448
LIMS Reference ID: EC54448
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: JCB#: 23-53856, Syosset High School, Syosset Central School District, 70 South Woods Road, Syosset, NY 11791

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 07/03/2024 16:20
Reported: 07/11/2024 15:26

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2025
06-NYSDOH	New York State Department of Health	11469	04/01/2025
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2025
06-California ELAP	California Water Boards	2339	04/01/2025
06-AIHA LAP	EMSL Analytical, Inc. Carle Place, NY AIHA-LAP, LLC-ELLAP Accredited	102344	09/01/2024

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062454448
LIMS Reference ID: EC54448
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: JCB#: 23-53856, Syosset High School, Syosset Central School District, 70 South Woods Road, Syosset, NY 11791

Customer PO:
EMSL Sales Rep: Jeromy Bish
Received: 07/03/2024 16:20
Reported: 07/11/2024 15:26

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
Q	Qualifier
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.

Lead in Water: Chain of Custody for ED55120

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Robbins Lane Elementary School

Client: Syosset central School District

Retest / New Install [ ]
Turn Around: Normal 1 wk / Rush_____

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1129	FL	2030	Faculty Room	SN	08/12/2025	7:50
SCSD-1202	KI	2080	kitchen	KC	08/12/2025	7:55

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 13 25, PM07:00

Building Address
157 Robbins Lane
Syosset, NY, 11791

Analysis Type: ELAP 200.5
Lab Recieved: Abigail Minnfield
Sinature: A. Minnfield

Samplers Name: Matthew Lane
Samplers Signature: [signature]
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555120

LIMS Reference ID: ED55120

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Robbins Lane Elementary School, Syosset Central School District, 157 Robbins Lane, Syosset, New York, 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/13/2025 19:00

Reported: 08/16/2025 10:56

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1129		**Lims Reference ID:**		**ED55120-01**	**Matrix: Drinking Water**			**Sampled:**	**08/13/25 00:00:00**
Metals									
Lead	**6.5**		1	1.0	µg/L	08/15/25 16:15	08/15/25 16:15	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-1202		**Lims Reference ID:**		**ED55120-02**	**Matrix: Drinking Water**			**Sampled:**	**08/13/25 00:00:00**
Metals									
Lead	**4.5**		1	1.0	µg/L	08/15/25 16:19	08/15/25 16:19	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555120

LIMS Reference ID: ED55120

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Robbins Lane Elementary School, Syosset Central School District, 157 Robbins Lane, Syosset, New York, 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/13/2025 19:00

Reported: 08/16/2025 10:56

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555120
LIMS Reference ID: ED55120
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Robbins Lane Elementary School, Syosset Central School District, 157 Robbins Lane, Syosset, New York, 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 19:00
Reported: 08/16/2025 10:56

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55109

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: South Grove Annex SGA

Client: Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1061	FL	2024	Faculty Room	CF	08/13/2025	7:40

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Garle Place, NY
AUG 13 25, PM07:00

Building Address
60 Colony Lane
Syosset, New York, 11791

Analysis Type: ELAP 200.5
Lab Recieved: Abigail Minnifield
Sinature: A. Minnifield
8/13/25 7:00pm

Samplers Name: Jeevan George
Samplers Signature: Jeevan George
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555109

LIMS Reference ID: ED55109

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, South Grove Annex, SGA, Syosset Central School District, 60 Colony Lane, Syosset, New York, 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/13/2025 19:00

Reported: 08/16/2025 10:51

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1061			**Lims Reference ID:**		**ED55109-01 Matrix: Drinking Water**			**Sampled:**	**08/13/25 00:00:00**
Metals									
Lead	**7.1**		1	1.0	µg/L	08/15/25 16:02	08/15/25 16:02	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555109
LIMS Reference ID: ED55109
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, South Grove Annex, SGA, Syosset Central School District, 60 Colony Lane, Syosset, New York, 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 19:00
Reported: 08/16/2025 10:51

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555109
LIMS Reference ID: ED55109
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, South Grove Annex, SGA, Syosset Central School District, 60 Colony Lane, Syosset, New York, 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 19:00
Reported: 08/16/2025 10:51

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55116

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Willits Elementary School WES

Client: Syosset Central School District

(Retest) New Install [ ]
Turn Around: (Normal 1 wk) Rush_____

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0947	ST	2042	Gym Kitchen	KC	08/13/2025	8:10
SCSD-0930	CA	NA	Cafeteria	KC	08/13/2025	8:13
SCSD-0931	CA	NA	Cafeteria	KC	08/13/2025	8:14

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 13 25, PM06:56

Building Address
99 Nana Place
Syosset, New York, 11791

Analysis Type: ELAP 200.5
Lab Recieved: DAVID WHARTON 8/13/25 6:58 PM
Sinature: David Wharton

Samplers Name: Jeevan George
Samplers Signature: Jeevan George
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555116

LIMS Reference ID: ED55116

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Willits Elementary School WES, 99 Nana Place, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/13/2025 18:58

Reported: 08/16/2025 10:54

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0947		**Lims Reference ID:**		**ED55116-01**	**Matrix: Drinking Water**			**Sampled:**	**08/13/25 00:00:00**
Metals									
Lead	**8.5**		1	1.0	µg/L	08/15/25 16:10	08/15/25 16:10	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0930		**Lims Reference ID:**		**ED55116-02**	**Matrix: Drinking Water**			**Sampled:**	**08/13/25 00:00:00**
Metals									
Lead	**1.9**		1	1.0	µg/L	08/15/25 16:11	08/15/25 16:11	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0931		**Lims Reference ID:**		**ED55116-03**	**Matrix: Drinking Water**			**Sampled:**	**08/13/25 00:00:00**
Metals									
Lead	**1.4**		1	1.0	µg/L	08/15/25 16:12	08/15/25 16:12	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555116
LIMS Reference ID: ED55116
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Willits Elementary School WES, 99 Nana Place, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 18:58
Reported: 08/16/2025 10:54

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555116
LIMS Reference ID: ED55116
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Willits Elementary School WES, 99 Nana Place, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 18:58
Reported: 08/16/2025 10:54

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55117

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: South Grove Elementary School SGE

Client: Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush_____

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD- 1445	CA	2092	Multi Purpose Room	KC	08/13/2025	7:31

Walk In

RECEIVED
ESL ANALYTICAL, INC.
Carle Place, NY
AUG 13 25, PM06:59

Building Address
60 Colony Lane
Syosset, New York, 11791

Analysis Type: ELAP 200.5
Lab Recieved: DAVID WHARTON 8/13/25 6:59 PM
Sinature: David Wharton

Samplers Name: Jeevan George
Samplers Signature: Jeevan George
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555117

LIMS Reference ID: ED55117

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Elementary School SGE, 60 Colony Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/13/2025 18:59

Reported: 08/16/2025 10:55

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1445			**Lims Reference ID:**		**ED55117-01 Matrix: Drinking Water**			**Sampled:**	**08/13/25 00:00:00**
Metals									
Lead	**5.6**		1	1.0	µg/L	08/15/25 16:14	08/15/25 16:14	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555117
LIMS Reference ID: ED55117
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Elementary School SGE, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 18:59
Reported: 08/16/2025 10:55

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555117
LIMS Reference ID: ED55117
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Elementary School SGE, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 18:59
Reported: 08/16/2025 10:55

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55121

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Syosset High School SHS

Client: Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush_____

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1378	GY	2332	Auxiliary Gym	DW	08/13/2025	6:08
SCSD-0045	KI	2240	Serving Area East	KC	08/13/2025	6:17

Walk In

RECEIVED
EMSL ANALYTICAL, INC
Carle Place, NY
AUG 13 25, PM06:58

Building Address
70 South Woods Road
Syosset, New York, 11791

Analysis Type: ELAP 200.5
Lab Recieved: S. Chevofsky 8/13/25
Sinature: S. Chevofsky 6:58pm

Samplers Name: Jeevan George
Samplers Signature: Jeevan George
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555121
LIMS Reference ID: ED55121
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: JCB #23-53856; Syosset High School; 70 South Woods Road Syosset, New York, 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 18:58
Reported: 08/16/2025 10:57

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1378		**Lims Reference ID:**		**ED55121-01**	**Matrix: Drinking Water**			**Sampled:**	**08/13/25 00:00:00**
Metals									
Lead	**52.5**		1	1.0	µg/L	08/15/25 16:23	08/15/25 16:23	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0045		**Lims Reference ID:**		**ED55121-02**	**Matrix: Drinking Water**			**Sampled:**	**08/13/25 00:00:00**
Metals									
Lead	**4.3**		1	1.0	µg/L	08/15/25 16:24	08/15/25 16:24	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555121
LIMS Reference ID: ED55121
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: JCB #23-53856; Syosset High School; 70 South Woods Road Syosset, New York, 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 18:58
Reported: 08/16/2025 10:57

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555121
LIMS Reference ID: ED55121
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: JCB #23-53856; Syosset High School; 70 South Woods Road Syosset, New York, 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/13/2025 18:58
Reported: 08/16/2025 10:57

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55473

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Thompson Middle School TMS

Client: Syosset Central School District

(Retest) New Install [ ]
Turn Around: Normal 1 wk (Rush) 48 hrs.

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0786	HE	2099	FCS A Family & Consumer Service A	EC	08/26/2025	6:02
SCSD-0787	HE	2099	Fcs A Family & Consumer Service A	EC	08/26/2025	6:03
SCSD-0781	HE	2098	Fcs B Family & Consumer Service B	EC	08/26/2025	6:07
SCSD-0782	HE	2098	Fcs B Family & consumer Service B	EC	08/26/2025	6:08
SCSD-0783	HE	2098	FCS B Family & consumer Service B	EC	08/26/2025	6:09
SCSD-0862	CA	2154 C	Snack Shop	KC	08/26/2025	6:16
SCSD-0843	OF	2132	Main Office Conference Room	KC	08/26/2025	6:20
SCSD-0842	NO	2125	Nurse's Office	NS	08/26/2025	6:22
						RECEIVED
						EMSL ANALYTICAL, INC.
						Carle Place, NY
						AUG 26 25 PM06:27

Walk In

Building Address
98 Ann Drive
Syosset, NY, 11791

Analysis Type: ELAP 200.5
Lab Recieved: DAVID WHARTON 8/26/25 6:27 PM
Sinature: David Wharton

Samplers Name: Matthew Lane
Samplers Signature: [signature]
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555473
LIMS Reference ID: ED55473
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Thompson Middle School TMS, 98 Ann Drive, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/26/2025 18:27
Reported: 08/28/2025 21:52

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0786		**Lims Reference ID:**		**ED55473-01**	**Matrix: Drinking Water**			**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**16.1**		1	1.0	µg/L	08/27/25 20:02	08/27/25 20:02	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0787		**Lims Reference ID:**		**ED55473-02**	**Matrix: Drinking Water**			**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**38.9**		1	1.0	µg/L	08/28/25 19:20	08/28/25 19:20	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: SCSD-0781		**Lims Reference ID:**		**ED55473-03**	**Matrix: Drinking Water**			**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**1.2**		1	1.0	µg/L	08/27/25 20:06	08/27/25 20:06	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0783		**Lims Reference ID:**		**ED55473-05**	**Matrix: Drinking Water**			**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**1.5**		1	1.0	µg/L	08/27/25 20:07	08/27/25 20:07	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0862		**Lims Reference ID:**		**ED55473-06**	**Matrix: Drinking Water**			**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**1.5**		1	1.0	µg/L	08/27/25 20:11	08/27/25 20:11	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0843		**Lims Reference ID:**		**ED55473-07**	**Matrix: Drinking Water**			**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	08/27/25 20:13	08/27/25 20:13	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0842		**Lims Reference ID:**		**ED55473-08**	**Matrix: Drinking Water**			**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**2.7**		1	1.0	µg/L	08/27/25 20:14	08/27/25 20:14	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555473

LIMS Reference ID: ED55473

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Thompson Middle School TMS, 98 Ann Drive, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/26/2025 18:27

Reported: 08/28/2025 21:52

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555473
LIMS Reference ID: ED55473
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Thompson Middle School TMS, 98 Ann Drive, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/26/2025 18:27
Reported: 08/28/2025 21:52

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55474

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23- 53856
Building: South Grove Elementary School SGE

Client: Syosset Central School District

Retest / New Install [ ]
Turn Around: Normal 1 wk Rush 48 hrs.

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1445	CA	2092	Multi - Purpose Room	KC	08/26/2025	7:09

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 26 25, PM06:27

Building Address
60 Colony Lane
Syosset, NY, 11791

Analysis Type: ELAP 200.5
Lab Recieved: DAVID WHARTON 8/26/25 6:27pm
Sinature: David Wharton

Samplers Name: Matthew Lane
Samplers Signature: [signature]
JCB Project Manager: Bryan Ezelius

Pb 200.8 [signature] 8/27/25

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555474

LIMS Reference ID: ED55474

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Elementary School SGE, 60 Colony Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/26/2025 18:27

Reported: 08/28/2025 13:38

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1445			**Lims Reference ID:**		**ED55474-01 Matrix: Drinking Water**			**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**2.0**		1	1.0	µg/L	08/27/25 16:12	08/27/25 16:12	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555474

LIMS Reference ID: ED55474

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Elementary School SGE, 60 Colony Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/26/2025 18:27

Reported: 08/28/2025 13:38

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555474
LIMS Reference ID: ED55474
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Elementary School SGE, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/26/2025 18:27
Reported: 08/28/2025 13:38

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55475

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: South Grove Annex SGA

Client: Syosset Central School District

Retest / New Install [ ]
Turn Around: Normal 1 wk / Rush 48 hrs.

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1061	FL	2024	Faculty Room	CF	08/26/2025	7:17

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 26 25, PM06:27

Building Address
60 Colony Lane
Syosset, NY, 11791

Analysis Type: ELAP 200.5
Lab Recieved: DAVID WHARTON 8/26/25 6:27 PM
Sinature: David Wharton

Samplers Name: Matthew Lane
Samplers Signature: [signature]
JCB Project Manager: Bryan Ezelius

Pb 200.8 Keellin Jones 8/27/25

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555475

LIMS Reference ID: ED55475

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Annex SGA, 60 Colony Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/26/2025 18:27

Reported: 08/28/2025 13:39

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1061			**Lims Reference ID:**		**ED55475-01 Matrix: Drinking Water**			**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**58.3**		1	1.0	µg/L	08/27/25 16:13	08/27/25 16:13	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555475
LIMS Reference ID: ED55475
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Annex SGA, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/26/2025 18:27
Reported: 08/28/2025 13:39

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555475
LIMS Reference ID: ED55475
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Grove Annex SGA, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/26/2025 18:27
Reported: 08/28/2025 13:39

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55476

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: Willits Elementary School WES

Client: Syosset Central School District

(Retest)/New Install [ ]
Turn Around: Normal 1 wk (Rush) 48 hrs.

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0947	ST	2042	GYM Kitchen	KC	08/26/2025	6:42

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
AUG 26 25, PM06:27

Walk In

Building Address
99 Nana Place
Syosset, NY 11791

Analysis Type: ELAP 200.5
Lab Recieved: DAVID WHARTON 8/26/25 6:27 PM
Sinature: David Wharton

Samplers Name: Matthew Lane
Samplers Signature: [signature]
JCB Project Manager: Bryan Ezelius

Pb 200.8 Validation 8/27/25

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555476

LIMS Reference ID: ED55476

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Willits Elementary School WES, 99 Nana Place, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/26/2025 18:27

Reported: 08/28/2025 13:40

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0947			**Lims Reference ID:**		**ED55476-01**	**Matrix: Drinking Water**		**Sampled:**	**08/26/25 00:00:00**
Metals									
Lead	**1.4**		1	1.0	µg/L	08/27/25 16:14	08/27/25 16:14	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555476

LIMS Reference ID: ED55476

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Willits Elementary School WES, 99 Nana Place, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/26/2025 18:27

Reported: 08/28/2025 13:40

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555476

LIMS Reference ID: ED55476

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, Willits Elementary School WES, 99 Nana Place, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/26/2025 18:27

Reported: 08/28/2025 13:40

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55477

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: South Woods Middle School SWM

Client: Syosset central School District

Retest New Install [ ]
Turn Around: Normal 1 wk Rush 48 hrs.

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0462	HE	3186	Room 202	EC	08/26/2025	7:52
						RECEIVED EMSL ANALYTICAL, INC. Carle Place, NY AUG 26 25, PM06:26

Walk In

Building Address
99 Pell Lane
Syosset, NY, 11791

Analysis Type: ELAP 200.5
Lab Recieved: DAVID WHARTON 8/26/25 6:26PM
Sinature: David Wharton

Samplers Name: Matthew Lane
Samplers Signature: [signature]
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555477

LIMS Reference ID: ED55477

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Woods Middle School SWM, 99 Pell Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/26/2025 18:26

Reported: 08/28/2025 13:37

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0462			**Lims Reference ID:**		**ED55477-01**	**Matrix: Drinking Water**			**Sampled: 08/26/25 00:00:00**
Metals									
Lead	**14.7**		1	1.0	µg/L	08/27/25 20:15	08/27/25 20:15	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555477

LIMS Reference ID: ED55477

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Woods Middle School SWM, 99 Pell Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 08/26/2025 18:26

Reported: 08/28/2025 13:37

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555477
LIMS Reference ID: ED55477
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856, Syosset Central School District, South Woods Middle School SWM, 99 Pell Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 08/26/2025 18:26
Reported: 08/28/2025 13:37

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55736

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23 – 53856
Building: South Woods Middle School SWM

Client: Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush 48 hrs.

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0462	HE	3186	Room 202	EC	9/6/2025	7:45 am
						RECEIVED
						EMSL ANALYTICAL, INC.
						Carle Place, NY
						SEP 06 25 AM08:58

Walk In

PB 200.8
Matthew 9/8/25

Building Address
99 Pell Lane
Syosset, NY 11791

Analysis Type: ELAP 200.8
Lab Recieved: Abigail Minnifield
Signature: A. Minnifield
9/6/25 8:58AM

Samplers Name: Matthew Lane
Samplers Signature: Matthew
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555736

LIMS Reference ID: ED55736

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Woods Middle School, SWM , Syosset Central School District, 99 Pell Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 09/06/2025 08:58

Reported: 09/09/2025 13:41

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0462			**Lims Reference ID:**		**ED55736-01 Matrix: Drinking Water**			**Sampled:**	**09/06/25 00:00:00**
Metals									
Lead	**1.2**		1	1.0	µg/L	09/08/25 16:20	09/08/25 16:20	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555736

LIMS Reference ID: ED55736

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Woods Middle School, SWM , Syosset Central School District, 99 Pell Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 09/06/2025 08:58

Reported: 09/09/2025 13:41

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555736
LIMS Reference ID: ED55736
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Woods Middle School, SWM , Syosset Central School District, 99 Pell Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 09/06/2025 08:58
Reported: 09/09/2025 13:41

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55737

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: South Grove Annex SGA

Client: Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush 48 hrs

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1061	FL	2024	Faculty Room	CF	9/6/2025	7:10 am

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
SEP 06 25, AM08:57

PB 200.8
9/8/25

Building Address
60 Colony Lane
Syosset, NY 11791

Analysis Type: ELAP 200.8
Lab Recieved: Abigail Minnifield
Signature: A. Minnifield
9/6/25 8:57AM

Samplers Name: Matthew Lane
Samplers Signature: [signature]
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555737
LIMS Reference ID: ED55737
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Grove Annex, SGA, Syosset Central School District, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 09/06/2025 08:57
Reported: 09/09/2025 13:45

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD- 1061			**Lims Reference ID:**		**ED55737-01 Matrix: Drinking Water**			**Sampled:**	**09/06/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	09/08/25 16:24	09/08/25 16:24	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555737
LIMS Reference ID: ED55737
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Grove Annex, SGA, Syosset Central School District, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 09/06/2025 08:57
Reported: 09/09/2025 13:45

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555737
LIMS Reference ID: ED55737
EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , South Grove Annex, SGA, Syosset Central School District, 60 Colony Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 09/06/2025 08:57
Reported: 09/09/2025 13:45

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED55738

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

Client: Syosset Central School District

JCB #: 23-53856

Building: Thompson Middle School TMS

(Retest)/New Install [ ]

Turn Around. Normal 1 wk (Rush) 48 hrs

Sample ID	Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-0786	HE	2099	FCS A Family & Consumer Service A	EC	9/6/2025	7:28 am
SCSD-0787	HE	2099	FCS A Family & Consumer Service A	EC	9/6/2025	7:29 am

Walk In

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
SEP 06 25, AM08:56

PB 200.8 MM 9/8/25

Building Address
98 Ann Drive
Syosset, NY 11791

Analysis Type: ELAP 200.8

Lab Recieved: Abigail Minnifield

Signature: [signature]

Samplers Name: Matthew Lane

Samplers Signature: [signature]

JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555738

LIMS Reference ID: ED55738

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Thompson Middle School, TMS, Syosset Central School District, 98 Ann Drive, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 09/06/2025 08:56

Reported: 09/09/2025 13:46

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-0786		**Lims Reference ID:**		**ED55738-01**	**Matrix: Drinking Water**			**Sampled:**	**09/06/25 00:00:00**
Metals									
Lead	**< 1.0**		1	1.0	µg/L	09/08/25 16:26	09/08/25 16:26	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: SCSD-0787		**Lims Reference ID:**		**ED55738-02**	**Matrix: Drinking Water**			**Sampled:**	**09/06/25 00:00:00**
Metals									
Lead	**1.4**		1	1.0	µg/L	09/08/25 16:27	09/08/25 16:27	KT1	EPA 200.8 (DA)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555738

LIMS Reference ID: ED55738

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Thompson Middle School, TMS, Syosset Central School District, 98 Ann Drive, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 09/06/2025 08:56

Reported: 09/09/2025 13:46

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555738

LIMS Reference ID: ED55738

EMSL Customer ID: JCBR50

Attention: Bryan Ezelius
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
bezelius@jcbroderick.com

Project Name: 23-53856 , Thompson Middle School, TMS, Syosset Central School District, 98 Ann Drive, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 09/06/2025 08:56

Reported: 09/09/2025 13:46

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53856
Building: South Woods Middle School
SWM

Client:
Syosset Central School District

Retest/New Install [ ]
Turn Around: Normal 1 wk Rush 48 HR

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
SCSD-1489	KI	2136	Kitchen	HW	9/10/2025	6:40:00 AM

Samples Submitted 1

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
SEP 10 25, PM01:22

Courier

Pb 200.8 Kathrohm 9/11/25

Building Address
99 Pell Lane
Syosset , NY 11791

Analysis Type: ELAP 200.5
Lab Recieved: Ofaele
Signature:

Samplers Name: Jarett Boniface
Samplers Signature:
JCB Project Manager: Bryan Ezelius

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555808

LIMS Reference ID: ED55808

EMSL Customer ID: JCBR50

Attention: George Greve
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: JCB#: 23-53856, South Woods Middle School, Syosset Central School District, 99 Pell Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 09/10/2025 13:22

Reported: 09/12/2025 09:42

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: SCSD-1489			**Lims Reference ID:**		**ED55808-01 Matrix: Drinking Water**				**Sampled: 09/10/25 00:00:00**
Metals									
Lead	**4.8**		1	1.0	µg/L	09/11/25 19:11	09/11/25 19:11	KT1	EPA 200.8 (Dig)/EPA 200.8

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555808

LIMS Reference ID: ED55808

EMSL Customer ID: JCBR50

Attention: George Greve
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: JCB#: 23-53856, South Woods Middle School, Syosset Central School District, 99 Pell Lane, Syosset, NY 11791

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 09/10/2025 13:22

Reported: 09/12/2025 09:42

Certified Analyses included in this Report

Analyte	Certifications
EPA 200.8 in Drinking Water	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <http://www.emsl.com> for a complete listing of parameters for which EMSL is certified.

EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555808
LIMS Reference ID: ED55808
EMSL Customer ID: JCBR50

Attention: George Greve
J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: JCB#: 23-53856, South Woods Middle School, Syosset Central School District, 99 Pell Lane, Syosset, NY 11791
Project ID: _06 - Carle Place Lead Analyses
Customer PO:
Sales Rep: Jeromy Bish
Received: 09/10/2025 13:22
Reported: 09/12/2025 09:42

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Attachment 4:

Laboratory Certifications

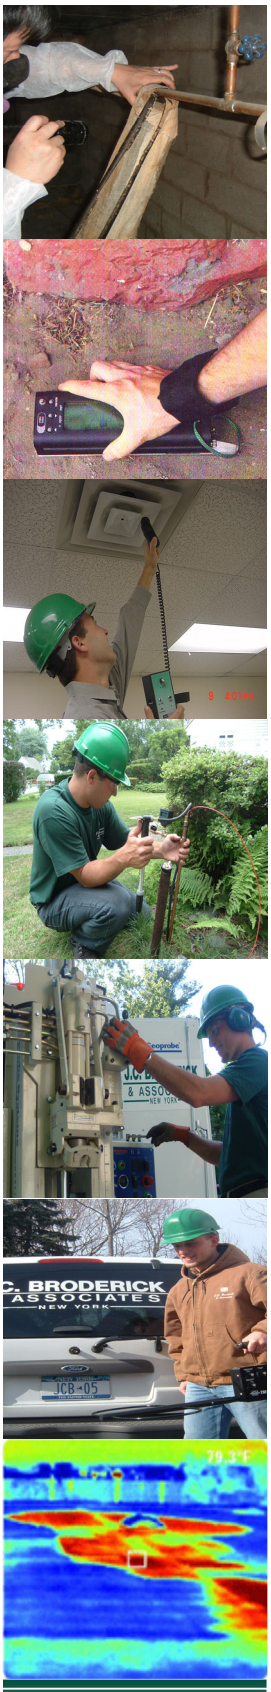

J.C. Broderick & Associates, Inc.
Environmental Consulting & Testing
1775 Expressway Drive North
Hauppauge, New York 11788
631.584.5492 fax 631.584.3395

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER

Expires 12:01 AM April 01, 2026
Issued April 01, 2025

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

is hereby APPROVED as an Environmental Laboratory in conformance with the National Environmental Laboratory Accreditation Conference Standards (2016) for the category ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C
	SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Heterotrophic Plate Count	SM 20, 21-23 9215B (-04)

Metals I

Copper, Total	EPA 200.8 Rev. 5.4
Lead, Total	EPA 200.8 Rev. 5.4
Silver, Total	EPA 200.8 Rev. 5.4

Miscellaneous

Asbestos	EPA 100.2

Serial No.: 70480

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/, by phone (518) 485-5570 or by email to elap@health.ny.gov.