

GRANITE STATE ANALYTICAL SERVICES, LLC

22 Manchester Road, Unit 2, Derry, NH 03038

Phone (800) 699-9920

(603) 432-3044

Fax (603) 434-4837

<http://www.granitestateanalytical.com/>

DRINKING WATER COMPLIANCE REPORT

DATE PRINTED: 10/24/2017 CHEMICAL RESULTS FOR THE 4th QUARTER 2017

SAMPLE ID#: 1710-02387-001

LAB ID#: 1015

SAMPLED BY: Boisvert, Glenn P.-PWW

SAMPLE CATEGORY: Routine Sample

SYSTEM NAME: Danville Elementary School

SYSTEM TOWN: Danville

SAMPLE AGENT #: 603-913-2177

SAMPLE LOCATION: 502 KITCHEN FAUCET ADJ TO BOILER ROOM/002

BAR CODE: 20170927016-001

EPA ID #: 0585010

DATE & TIME COLLECTED: 10/19/2017 8:30AM

DATE & TIME RECEIVED: 10/20/2017 10:05AM

WATER SYS TYPE: Non-Transient, Non-Community

RECEIPT TEMP: ON ICE 4.4° CELSIUS

CLIENT JOB #

Legend

Passes

Fails EPA Primary


Fails EPA Secondary

Fails State Guideline

Attention



Test Description	Results	Test Units	Pass /Fail	DQ Flag	RL	Limit	Method	Analyst	Date & Time Analyzed
1,1,1,2-Tetrachloroethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,1,1-Trichloroethane*	<0.5	ug/L	✓		0.5	200 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,1,2,2-Tetrachloroethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,1,2-Trichloroethane*	<0.5	ug/L	✓		0.5	5 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,1-Dichloroethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,1-Dichloroethylene*	<0.5	ug/L	✓		0.5	7 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,1-Dichloropropylene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2,3-Trichlorobenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2,3-Trichloropropane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2,4-Trichlorobenzene*	<0.5	ug/L	✓		0.5	70 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2,4-Trimethylbenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2-Dibromo-3-chloropropane	<0.5	ug/L	✓		0.5	0.2 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2-Dibromoethane	<0.5	ug/L	✓		0.5	0.05 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2-Dichlorobenzene*	<0.5	ug/L	✓		0.5	600 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2-Dichloroethane*	<0.5	ug/L	✓		0.5	5 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2-Dichloropropane*	<0.5	ug/L	✓		0.5	5 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,3,5-Trimethylbenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,3-Dichlorobenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,3-Dichloropropane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
1,4-Dichlorobenzene*	<0.5	ug/L	✓		0.5	75 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
2,2-Dichloropropane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
2-Butanone (MEK)	<10	ug/L			10	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
2-Chlorotoluene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
2-Hexanone	<10	ug/L			10	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
4-Chlorotoluene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
4-Isopropyltoluene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
4-Methyl-2-pentanone (MIBK)	<10	ug/L			10	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Acetone	<10	ug/L			10	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Benzene*	<0.5	ug/L	✓		0.5	5 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Bromobenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Bromochloromethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Bromodichloromethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM

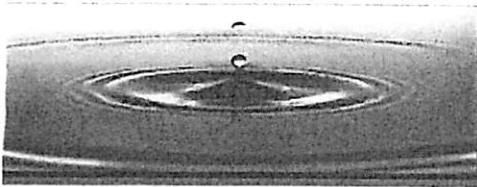

GRANITE STATE ANALYTICAL SERVICES, LLC

22 Manchester Road, Unit 2, Derry, NH 03038

Phone (800) 699-9920

(603) 432-3044

Fax (603) 434-4837

<http://www.granitestateanalytical.com/>

DRINKING WATER COMPLIANCE REPORT

DATE PRINTED: 10/24/2017 CHEMICAL RESULTS FOR THE 4th QUARTER 2017

SAMPLE ID#: 1710-02387-001

LAB ID#: 1015

SAMPLED BY: Boisvert, Glenn P.-PWW

SAMPLE CATEGORY: Routine Sample

SYSTEM NAME: Danville Elementary School

SYSTEM TOWN: Danville

SAMPLE AGENT #: 603-913-2177

SAMPLE LOCATION: 502 KITCHEN FAUCET ADJ TO BOILER ROOM/002

BAR CODE: 20170927016-001

EPA ID #: 0585010

DATE & TIME COLLECTED: 10/19/2017 8:30AM

DATE & TIME RECEIVED: 10/20/2017 10:05AM

WATER SYS TYPE: Non-Transient, Non-Community

RECEIPT TEMP: ON ICE 4.4° CELSIUS

CLIENT JOB #

Legend

Passes

Fails EPA Primary


Fails EPA Secondary

Fails State Guideline

Attention



Test Description	Results	Test Units	Pass /Fail	DQ Flag	RL	Limit	Method	Analyst	Date & Time Analyzed
Bromoform*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Bromomethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Carbon disulfide	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Carbon tetrachloride*	<0.5	ug/L	✓		0.5	5 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Chlorobenzene*	<0.5	ug/L	✓		0.5	100 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Chloroethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Chloroform*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Chloromethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
cis-1,2-Dichloroethylene*	<0.5	ug/L	✓		0.5	70 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
cis-1,3-Dichloropropylene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Dibromochloromethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Dibromomethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Dichlorodifluoromethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Diethyl ether	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Diisopropyl ether (DIPE)*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Ethyl tert-butyl ether (ETBE)*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Ethylbenzene*	<0.5	ug/L	✓		0.5	700 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Hexachlorobutadiene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Isopropylbenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
m&p-Xylenes	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Methyl tert-butyl ether (MTBE)*	<0.5	ug/L	✓		0.5	13 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Methylene chloride*	<0.5	ug/L	✓		0.5	5 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Naphthalene	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
n-Butylbenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Nitrobenzene	<10	ug/L			10	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
n-Propylbenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
o-Xylene	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
sec-Butylbenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Styrene*	<0.5	ug/L	✓		0.5	100 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
tert-Amyl methyl ether (TAME)*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
tert-Butyl alcohol (TBA)*	<10	ug/L			10	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
tert-Butylbenzene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM

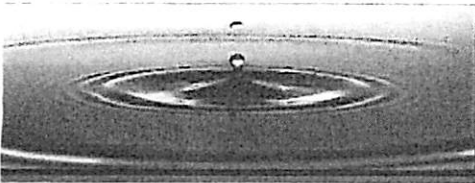

GRANITE STATE ANALYTICAL SERVICES, LLC

22 Manchester Road, Unit 2, Derry, NH 03038

Phone (800) 699-9920

(603) 432-3044

Fax (603) 434-4837

http://www.granitestateanalytical.com/

DRINKING WATER COMPLIANCE REPORT

DATE PRINTED: 10/24/2017 CHEMICAL RESULTS FOR THE 4th QUARTER 2017

SAMPLE ID#: 1710-02387-001

LAB ID#: 1015

SAMPLED BY: Boisvert, Glenn P.-PWW

SAMPLE CATEGORY: Routine Sample

SYSTEM NAME: Danville Elementary School

SYSTEM TOWN: Danville

SAMPLE AGENT #: 603-913-2177

SAMPLE LOCATION: 502 KITCHEN FAUCET ADJ TO BOILER ROOM/002

BAR CODE: 20170927016-001

EPA ID #: 0585010

DATE & TIME COLLECTED: 10/19/2017 8:30AM

DATE & TIME RECEIVED: 10/20/2017 10:05AM

WATER SYS TYPE: Non-Transient, Non-Community

RECEIPT TEMP: ON ICE 4.4° CELSIUS

CLIENT JOB #

Legend

Passes

Fails EPA Primary

Fails EPA Secondary

Fails State Guideline

Attention



Test Description	Results	Test Units	Pass /Fail	DQ Flag	RL	Limit	Method	Analyst	Date & Time Analyzed
Tetrachloroethylene*	<0.5	ug/L	✓		0.5	5 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Tetrahydrofuran (THF)	<10	ug/L			10	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Toluene*	<0.5	ug/L	✓		0.5	1000 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Total THMs*	<0.5	ug/L	✓		0.5	80 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Total xylenes*	<0.5	ug/L	✓		0.5	10000 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
trans-1,2-Dichloroethylene*	<0.5	ug/L	✓		0.5	100 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
trans-1,3-Dichloropropylene*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Trichloroethylene*	<0.5	ug/L	✓		0.5	5 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
Trichlorofluoromethane*	<0.5	ug/L			0.5	No Limit	EPA 524.2	BM-NH	10/23/17 10:14PM
Vinyl chloride*	<0.5	ug/L	✓		0.5	2 ug/L	EPA 524.2	BM-NH	10/23/17 10:14PM
1,2-Dichlorobenzene-d4	85	%			0.5	70-130%	EPA 524.2 - SS	BM-NH	10/23/17 10:14PM
4-Bromofluorobenzene	91	%			0.5	70-130%	EPA 524.2 - SS	BM-NH	10/23/17 10:14PM

The results presented in this report relate to the samples listed above in the condition in which they were received.

RL: "Reporting limit" means the lowest level of an analyte that can be accurately recovered from the matrix of interest.

Data Qualifier (DQ) Flags: None

* NELAP Accredited Analysis




Donald A. D'Anjou, Ph. D.
Laboratory Director

This analysis meets NELAP requirements except as noted.

State Certifications: | NH 1015 | MA M-NH003 | ME NH00003 | RI 101513 | VT VT-101507 |

This certificate shall not be reproduced, except in full, without the written approval of Granite State Analytical Services, LLC

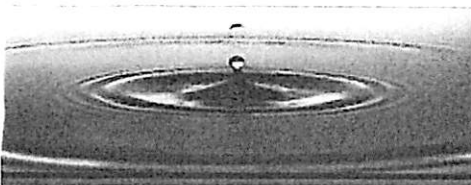

DRINKING WATER COMPLIANCE REPORT

DATE PRINTED: 10/23/2017 CHEMICAL RESULTS FOR THE 4th QUARTER 2017
 SAMPLE ID#: 1710-02390-001 LAB ID#: 1015
 SAMPLED BY: Boisvert, Glenn P.-PWW
 SAMPLE CATEGORY: Routine Sample
 SYSTEM NAME: Danville Elementary School EPA ID #: 0585010
 SYSTEM TOWN: Danville DATE & TIME COLLECTED: 10/19/2017 8:30AM
 SAMPLE AGENT #: 603-913-2177 DATE & TIME RECEIVED: 10/20/2017 10:05AM
 SAMPLE LOCATION: 502 KITCHEN FAUCET ADJ TO BOILER ROOM/002 WATER SYS TYPE: Non-Transient, Non-Community
 RECEIPT TEMP: ON ICE 4.4° CELSIUS
 BAR CODE: 20170927016-001 CLIENT JOB #

Legend
 Passes ✓
 Fails EPA Primary ⊗
 Fails EPA Secondary ▽
 Fails State Guideline ✕
 Attention ⚠

Test Description	Results	Test Units	Pass /Fail	DQ Flag	RL	Limit	Method	Analyst	Date & Time Analyzed
Nitrate as N*	<0.2	mg/L	✓		0.2	10 mg/L	EPA 300.0	CW-NH	10/21/17 5:40AM

The results presented in this report relate to the samples listed above in the condition in which they were received.
 RL: "Reporting limit" means the lowest level of an analyte that can be accurately recovered from the matrix of interest.

Data Qualifier (DQ) Flags: None

* NELAP Accredited Analysis



Donald A. D'Anjou
 Donald A. D'Anjou, Ph. D.
 Laboratory Director