

**Districtwide Lead in Drinking Water
Sampling and Remediation Plan for 2023-2025 Compliance.**

Hempstead UFSD

September 2025

Enviroscience Project #26343



2150 Smithtown Ave., Suite 3, Ronkonkoma, NY 11779

T: 631.580.3191 • **F:** 631.580.3195 • **W:** envirohealth.org

DISTRICTWIDE LEAD IN DRINKING WATER SAMPLING AND REMEDIATION PLAN

2023-2025

September 2025

ENVIROSCIENCE PROJECT #26343

Prepared for: HEMPSTEAD UFSD
15 Marshall Street,
Hempstead, NY, 11550

Prepared by: ENVIROSCIENCE CONSULTANTS, LLC
2150 Smithtown Avenue
Ronkonkoma, New York 11779
(631) 580-3191

Project Manager: *Pam Chadderton*

TABLE OF CONTENTS

SectionTitle

1.0	Executive Summary
2.0	Sampling Methodology
3.0	Initial Results

Appendices

Appendix A	Hempstead High School
Appendix B	Alverta B. Gray Schultz Middle School
Appendix C	Jackson Elementary School
Appendix D	Jackson Elementary School Annex
Appendix E	Barack Obama Elementary School
Appendix F	Joseph A. McNeil Elementary School
Appendix G	David Paterson Elementary School
Appendix H	Prospect Elementary School
Appendix I	Rhodes Academy Elementary School
Appendix J	Marshall Pre-Kindergarten School

1.0 EXECUTIVE SUMMARY

The Hempstead UFSD has developed their Lead in Drinking Water Sampling and Remediation Plan for the 2023-2025 compliance period, as required by the New York State Department of Health (Public Health Law Sections 1370-a and 1110, Subpart 67-4 Lead Testing in School Drinking Water).

In accordance with the regulation, this Lead Remediation Plan is prepared to identify locations deemed as Applicable Drinking Water Sources and report first draw sample results, to mitigate locations where sample results exceed 5 parts per billion, to identify locations deemed as Non-Applicable Water Sources, communicate this designation to building occupants, and to develop strategies for monitoring locations deemed Non-Applicable Water Sources to insure building occupants do not consume water from these locations.

The following locations within the Hempstead UFSD buildings have been deemed Applicable Drinking Water Sources by the administration:

- 1) Water fountains and bottle filling stations;
- 2) Kitchen water faucets and pot fillers used in food preparation;
- 3) Ice machines
- 4) Home Economics classroom sinks
- 5) Elementary School student bathroom sinks
- 6) Nurse's Office and Faculty Room sinks

First draw samples were collected from each of these locations within the district and analyzed by a New York State Department of Health ELAP certified laboratory. The chains of custody are available upon request. For results at or below 5 ppb, no further action is required until 2028. For locations above 5 ppb, options include: second and third draw sample collection to determine source of lead, designation of the location as Non-applicable Water Source, or permanent removal of the fixture from the location. In either case, the result was communicated by Enviroscience Consultants, and the fixture was shut off by the district immediately upon receipt of results.

The following locations within the Hempstead UFSD buildings were deemed Non-Applicable Water Sources by the administration:

- 1) Science Laboratory sinks
- 2) Art Room sinks
- 3) Technical Classroom sinks
- 4) Other Classroom sinks
- 5) Secondary School bathroom sinks
- 6) Outside spigots
- 7) Custodial Closet sinks
- 8) Mixed Valve sinks (or hot only)
- 9) Showers throughout buildings

In these cases, the Hempstead UFSD staff have placed signs adjacent to the fixture to notify occupants that the water is not intended for consumption. To further support this protocol, the following management of the locations is required:

- 1) Science Laboratory sinks - communicate in writing with students that these locations are for science experiments and hand washing only, not for consumption. This is most easily accomplished by including this language in the laboratory safety paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective science teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 2) Art Room sinks - communicate in writing to students that these locations are for cleaning of art supplies and hand washing only, not for consumption. This is most easily accomplished by including this language in the course paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective art teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 3) Technical Classroom sinks - classrooms in this category often include wood shop or auto mechanics classrooms, where students are to hand wash after bathroom usage or activities as part of a regular hygiene program. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.

- 4) Other classroom sinks - classrooms in this category often include elementary classrooms, where students are to hand wash after bathroom usage or activities as part of a regular hygiene program. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 5) Bathroom sinks - in intermediate buildings, signage should be sufficient for communicating the concept of hand washing only. In elementary schools, personal hygiene should be integrated into curriculum to ensure students understand bathroom sinks are for hand washing only, and not consumption. Further, show what the signage looks like in bathrooms, so they learn to recognize its meaning. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 6) Outside spigots - all-weather signage will be installed at each location. Further, spigots will have a special key maintained by the custodial staff to ensure that non-authorized persons do not fill sports coolers or use hoses for consumption. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 7) Custodial Closet sinks - these locations should be accessed by custodial personnel only and locked when not in use. Access to others should be restricted. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 8) Mixed Valve sinks (or hot only) – per Public Health Law Sections 1370-a and 1110, Subpart 67-4 Lead Testing in School Drinking Water mixed valve or hot water only sources are not required to be sampled. Signage is required for these sources. Signage should be sufficient for communicating the concept of hand washing only. In elementary schools, personal hygiene should be integrated into curriculum to ensure students understand bathroom sinks are for hand washing only, and not consumption. Further, show what the signage looks like so they learn to recognize its meaning. This program should be monitored by teachers and staff to ensure consumption is not taking


place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.

All locations deemed non-applicable, but do not have signs, should be taken offline until signs have been posted. Signs are suggested to have pictures that instruct for handwashing only, do not drink.


2.0 SAMPLING METHODOLOGY

In accordance with the regulation, Enviroscience Consultants, LLC performed initial water sampling at the Hempstead UFSD buildings on 9/9/25 to 9/12/25. Samples were collected in wide-mouth 250 milliliter containers and were collected in the morning hours before the facilities opened. The water sources were not used for at least 8 hours and not more than 18 hours prior to sampling. Unique source numbers and designations were assigned to each source location. Unique sample identification numbers were assigned to each sample taken. The key to fixture type codes, source designations, and the sampling location schematics are shown below.


Code Key for Lead in Water		
Fixture Type Codes		
BF	Bottle Filler	SK Sink
HB	Hose Bib	SL Supply Line
IM	Ice Machine	SP Spigot
OS	Other Source	SPY Spray
PF	Pot Filler	SS Slop Sink
		V Valve
		WC Water Cooler
		WF Water Fountain
Source Designations		
App	Applicable	N/A Non-applicable

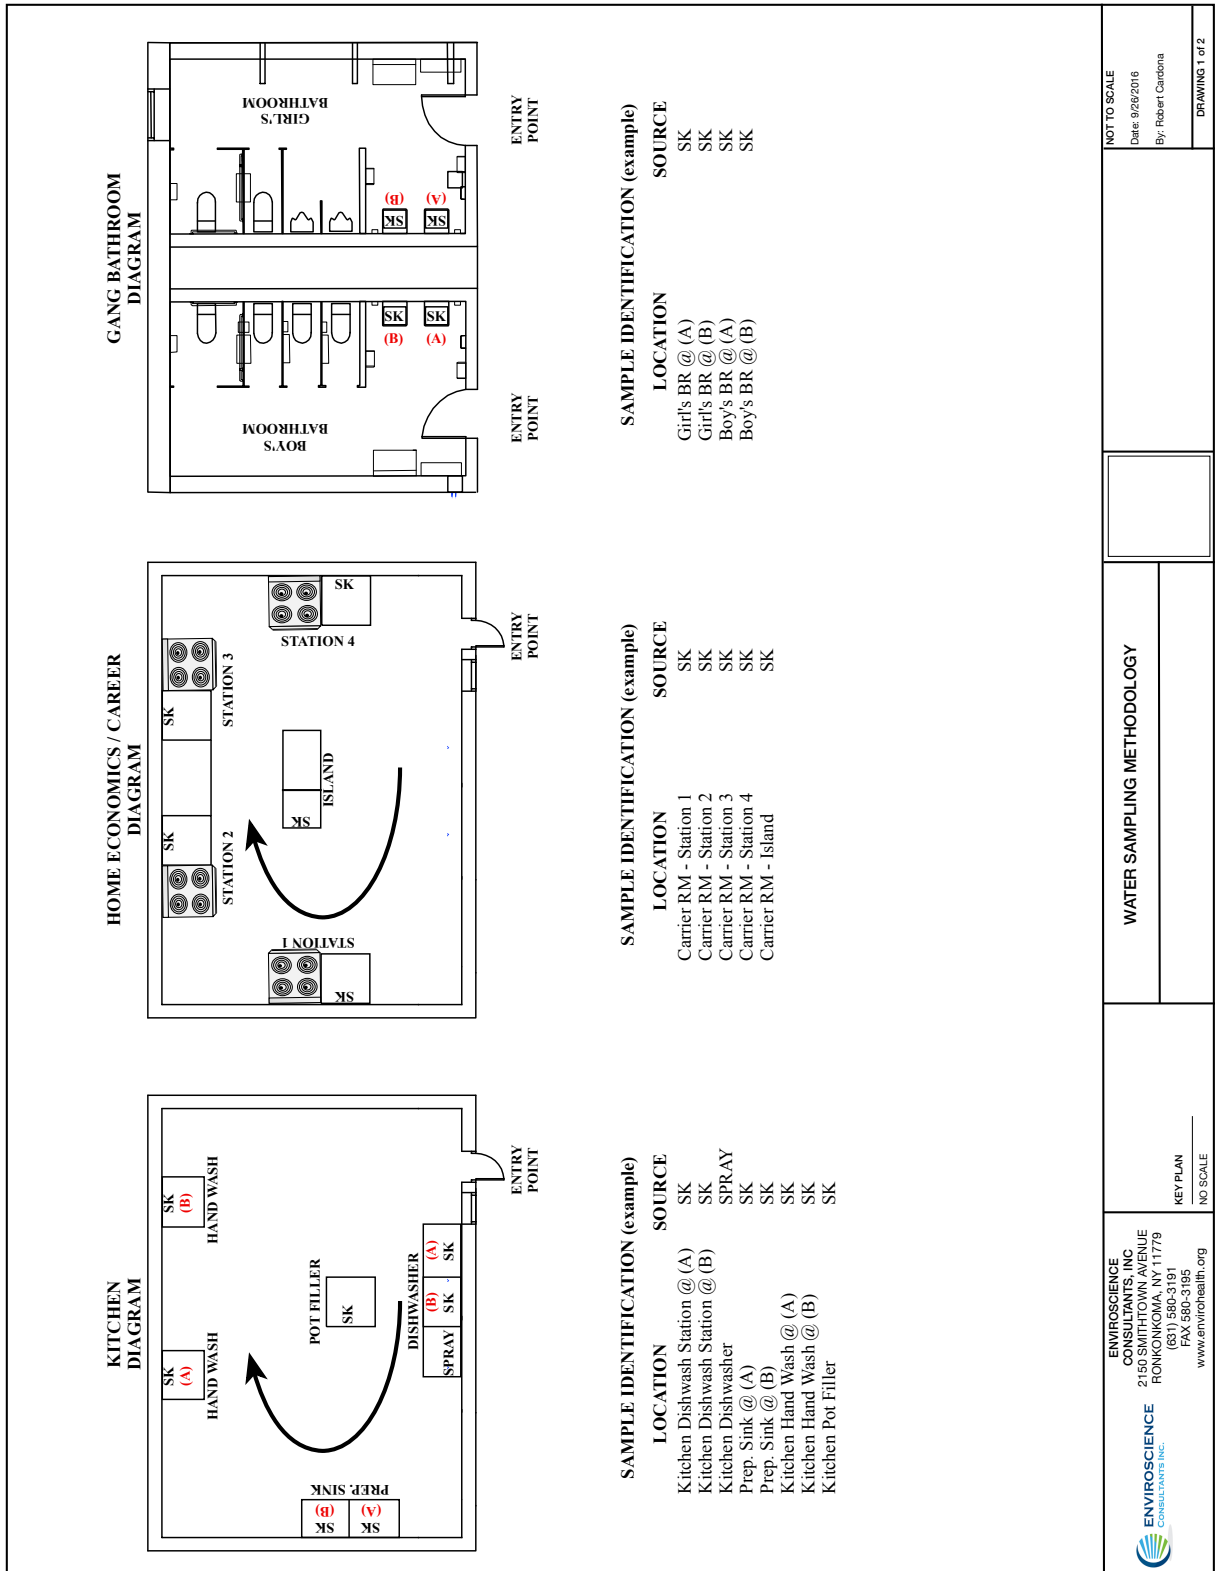


SCIENCE ROOM TYPE 1
DIAGRAM

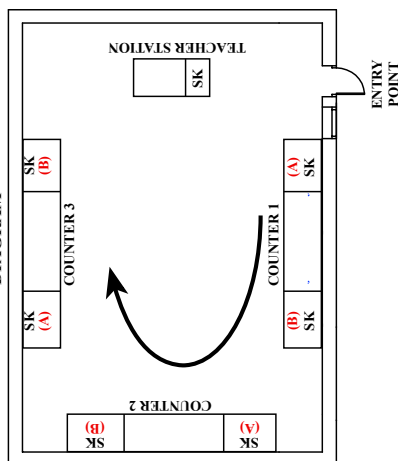

SCIENCE ROOM TYPE 2
DIAGRAM

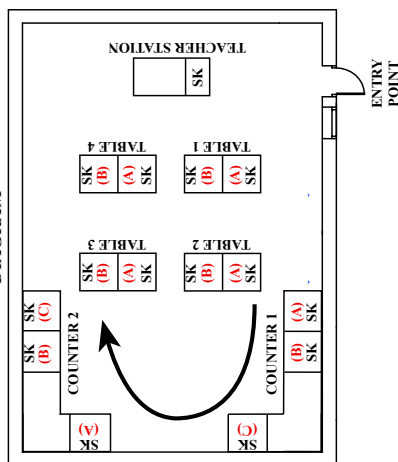

SCIENCE ROOM TYPE 3
DIAGRAM

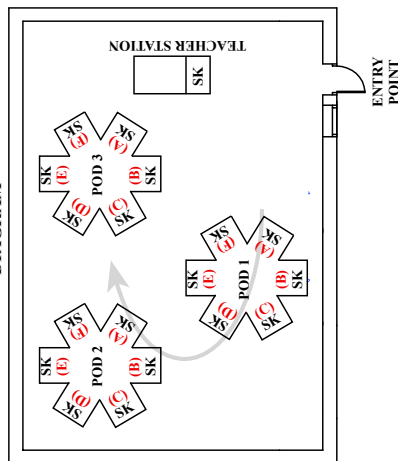

SAMPLE IDENTIFICATION (example)

LOCATION	SOURCE
Room 200 - Teacher Station	SK
Room 200 - Counter 1 @ (A)	SK
Room 200 - Counter 1 @ (B)	SK
Room 200 - Counter 2 @ (A)	SK
Room 200 - Counter 2 @ (B)	SK
Room 200 - Counter 3 @ (A)	SK
Room 200 - Counter 3 @ (B)	SK

SAMPLE IDENTIFICATION (example)

LOCATION	SOURCE
Room 200 - Teacher Station	SK
Room 200 - Table 1 @ (A)	SK
Room 200 - Table 1 @ (B)	SK
Room 200 - Table 2 @ (A)	SK
Room 200 - Table 2 @ (B)	SK
Room 200 - Table 3 @ (A)	SK
Room 200 - Table 3 @ (B)	SK
Room 200 - Table 4 @ (A)	SK
Room 200 - Table 4 @ (B)	SK
Room 200 - Counter 1 @ (A)	SK
Room 200 - Counter 1 @ (B)	SK
Room 200 - Counter 2 @ (A)	SK
Room 200 - Counter 2 @ (B)	SK
Room 200 - Counter 2 @ (C)	SK

SAMPLE IDENTIFICATION (example)

LOCATION	SOURCE
Room 200 - Teacher Station	SK
Room 200 - POD 1 @ (A)	SK
Room 200 - POD 1 @ (B)	SK
Room 200 - POD 1 @ (C)	SK
Room 200 - POD 1 @ (D)	SK
Room 200 - POD 1 @ (E)	SK
Room 200 - POD 1 @ (F)	SK
Room 200 - POD 2 @ (A)	SK
Room 200 - POD 2 @ (B)	SK
Room 200 - POD 2 @ (C)	SK
Room 200 - POD 2 @ (D)	SK
Room 200 - POD 2 @ (E)	SK
Room 200 - POD 2 @ (F)	SK
Room 200 - POD 3 @ (A)	SK
Room 200 - POD 3 @ (B)	SK
Room 200 - POD 3 @ (C)	SK
Room 200 - POD 3 @ (D)	SK
Room 200 - POD 3 @ (E)	SK
Room 200 - POD 3 @ (F)	SK

3.0 Initial Results

All water source locations in each of the school buildings were assessed. Water source locations identified as drinking water sources were considered Applicable, and first draw samples were collected. Water source locations identified as non-drinking water sources were considered non-applicable and these locations were documented.

The results of the initial sampling and the use of signs warning against water use at non-applicable sources is documented in the School Water Outlet Inventory for each building.

All elevated locations should be taken off line until the remediation is completed. Any other drinking water sources in these buildings that were not functional at the time of initial sampling and have not been tested should be tested before returning to service. All locations deemed non-applicable, but do not have signs, should be taken offline until signs have been posted. Signs are suggested to have pictures that instruct for handwashing only, do not drink.

The following is a summary of results in parts per billion (ppb) of locations in the Hempstead UFSD where sample results were found above 5 ppb:

Hempstead High School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Cafeteria Right	12.0	9/9/25	Filter Change, Pending Retest
Kitchen Pot Filler Left	13.0	9/9/25	Removed from Service; Pending Remediation
Kitchen Pot Filler Right	21.0	9/9/25	Removed from Service; Pending Remediation

Alverta B. Gray Schultz Middle School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen Pot Filler	32.0	9/9/25	Removed from Service; Pending Remediation
Business Office Kitchen	8.0	9/11/25	Aerator Cleaned; Pending Retest

Jackson Elementary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
No Exceedances in the Sample Location			

Jackson Elementary School Annex			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
No Exceedances in the Sample Location			

Barack Obama Elementary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
No Exceedances in the Sample Location			

Joseph A. McNeil Elementary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
No Exceedances in the Sample Location			

David Paterson Elementary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
No Exceedances in the Sample Location			

Prospect Elementary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
No Exceedances in the Sample Location			

Rhodes Academy Elementary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 102	6.0	9/10/25	Permanently Capped
Room 226	10.0	9/10/25	Permanently Capped

Marshall Pre-Kindergarten School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
No Exceedances in the Sample Location			

Appendix A

Hempstead High School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-01	Art Room 118 Unit Left	SK	N/A		9/9/2025				Sign
1001-02	Art Room 118 Unit Right	SK	N/A		9/9/2025				Sign
1001-03	Art Room between A118 & A116	SK	N/A		9/9/2025				Sign
1002-01	ADA Bathroom by Room A116	SK	N/A		9/9/2025				Sign
1003-01	Art Room 116 Unit 1 Left	SK	N/A		9/9/2025				Sign
1003-02	Art Room 116 Unit 1 Middle	SK	N/A		9/9/2025				Sign
1003-03	Art Room 116 Unit 1 Right	SK	N/A		9/9/2025				Sign
1003-04	Art Room 116 Unit 2 Left	SK	N/A		9/9/2025				Sign
1003-05	Art Room 116 Unit 2 Middle	SK	N/A		9/9/2025				Sign
1003-06	Art Room 116 Unit 2 Right	SK	N/A		9/9/2025				Sign
1004-01	Boy's Bathroom by Room A116 Left	SK	App		9/9/2025				Sign
1004-02	Boy's Bathroom by Room A116 Right	SK	App		9/9/2025				Sign
1005-01	Men's Faculty Bathroom by Room A116 Left	SK	N/A		9/9/2025				Sign
1005-02	Men's Faculty Bathroom by Room A116 Middle	SK	N/A		9/9/2025				Sign
1005-03	Men's Faculty Bathroom by Room A116 Right	SK	N/A		9/9/2025				Sign
1006-01	Custodial Closet by Room A116	SS	N/A		9/9/2025				Sign
1007-01	Hall by Room A114	WF	App	<1.0	9/9/2025				
1007-02	Hall by Room A114	BF	App	<1.0	9/9/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1008-01	Lounge between Room A112 and Room A1	SK	N/A		9/9/2025				Sign
1009-01	Room A110	SK	N/A		9/9/2025				Sign
1010-01	Room A109	SK	N/A		9/9/2025				Sign
1011-01	Hall by Room A105	WF	App	<1.0	9/9/2025				
1011-02	Hall by Room A105	BF	App	<1.0	9/9/2025				
1012-01	Custodial Closet by Room A103	SS	N/A		9/9/2025				Sign
1013-01	Girl's Bathroom by Room A103 Left	SK	App		9/9/2025				Sign
1013-02	Girl's Bathroom by Room A103 Middle	SK	App		9/9/2025				Sign
1013-03	Girl's Bathroom by Room A103 Right	SK	App		9/9/2025				Sign
1014-01	Women's Faculty Bathroom by Room A103	SK	N/A		9/9/2025				Sign
1014-02	Women's Faculty Bathroom by Room A103	SK	N/A		9/9/2025				Sign
1015-01	Little Theatre Men's Bathroom Left	SK	N/A		9/9/2025				Sign
1016-02	Little Theatre Lobby	BF	App	<1.0	9/9/2025				
1016-01	Little Theatre Lobby	WF	App	<1.0	9/9/2025				
1017-01	Little Theatre Women's Bathroom Left	SK	N/A		9/9/2025				Sign
1017-02	Little Theatre Women's Bathroom Right	SK	N/A		9/9/2025				Sign
1018-01	Room C103 Teacher's Station	SK	N/A		9/9/2025				Sign
1018-02	Room C103 Pod 1 @ A	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1018-03	Room C103 Pod 1 @ B	SK	N/A		9/9/2025				Sign
1018-04	Room C103 Pod 2 @ A	SK	N/A		9/9/2025				Sign
1018-05	Room C103 Pod 2 @ B	SK	N/A		9/9/2025				Sign
1018-06	Room C103 Pod 3 @ A	SK	N/A		9/9/2025				Sign
1018-07	Room C103 Pod 3 @ B	SK	N/A		9/9/2025				Sign
1018-08	Room C103 Pod 4 @ A	SK	N/A		9/9/2025				Sign
1018-09	Room C103 Pod 4 @ B	SK	N/A		9/9/2025				Sign
1018-10	Room C103 Pod 5 @ A	SK	N/A		9/9/2025				Sign
1018-11	Room C103 Pod 5 @ B	SK	N/A		9/9/2025				Sign
1018-12	Room C103 Pod 6 @ A	SK	N/A		9/9/2025				Sign
1018-13	Room C103 Pod 6 @ B	SK	N/A		9/9/2025				Sign
1018-14	Room C103 Pod 7 @ A	SK	N/A		9/9/2025				Sign
1018-15	Room C103 Pod 7 @ B	SK	N/A		9/9/2025				Sign
1019-01	Room C104B	SK	N/A		9/9/2025				Sign
1020-01	Men's Faculty Bathroom by Room C104 Le	SK	N/A		9/9/2025				Sign
1020-02	Men's Faculty Bathroom by Room C104 Rig	SK	N/A		9/9/2025				Sign
1021-01	Room C102	SK	N/A		9/9/2025				Sign
1022-01	Room C101 Teacher's Station	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1022-02	Room C101 Pod 1 @ A	SK	N/A		9/9/2025				Sign
1022-03	Room C101 Pod 1 @ B	SK	N/A		9/9/2025				Sign
1022-04	Room C101 Pod 2 @ A	SK	N/A		9/9/2025				Sign
1022-05	Room C101 Pod 2 @ B	SK	N/A		9/9/2025				Sign
1022-06	Room C101 Pod 3 @ A	SK	N/A		9/9/2025				Sign
1022-07	Room C101 Pod 3 @ B	SK	N/A		9/9/2025				Sign
1022-08	Room C101 Pod 4 @ A	SK	N/A		9/9/2025				Sign
1022-09	Room C101 Pod 4 @ B	SK	N/A		9/9/2025				Sign
1022-10	Room C101 Pod 5 @ A	SK	N/A		9/9/2025				Sign
1022-11	Room C101 Pod 5 @ B	SK	N/A		9/9/2025				Sign
1022-12	Room C101 Pod 6 @ A	SK	N/A		9/9/2025				Sign
1022-14	Room C101 Pod 7 @ A	SK	N/A		9/9/2025				Sign
1022-15	Room C101 Pod 7 @ B	SK	N/A		9/9/2025				Sign
1023-01	Hall by Room C105B	WF	App	<1.0	9/9/2025				
1023-02	Hall by Room C105B	BF	App	<1.0	9/9/2025				
1024-01	Boy's Bathroom by Room 105B Left	SK	N/A		9/9/2025				Sign
1024-02	Boy's Bathroom by Room 105B Right	SK	N/A		9/9/2025				Sign
1024-03	Boy's Bathroom by Room 105B Custodial C	SS	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1025-01	Room C107	SK	App		9/9/2025				Sign
1025-02	Room C107	WF	App		9/9/2025				Removed from Service
1026-01	Athletic Trainer Room	IM	App		9/9/2025				Non functional, sampling required before returning to service
1026-02	Athletic Trainer Room	SK	App	2.0	9/9/2025				
1027-01	Girl's Bathroom by Nurse's Office Left	SK	N/A		9/9/2025				Sign
1027-02	Girl's Bathroom by Nurse's Office Right	SK	N/A		9/9/2025				Sign
1028-01	Nurse's Station Exam Room 2	SK	App	<1.0	9/9/2025				
1028-02	Nurse's Station Bathroom	SK	App	<1.0	9/9/2025				
1028-03	Nurse's Station Exam Room 1	SK	App	<1.0	9/9/2025				
1028-04	Nurse's Station Office	SK	App	<1.0	9/9/2025				
1029-01	Girl's Locker Room Custodial Closet	SS	N/A		9/9/2025				Sign
1029-02	Girl's Locker Room Bathroom Left	SK	N/A		9/9/2025				Sign
1029-03	Girl's Locker Room Bathroom Right	SK	N/A		9/9/2025				Sign
1029-04	Girl's Locker Room	WF	App	<1.0	9/9/2025				
1029-06	Girl's Locker Room	BF	App	<1.0	9/9/2025				
1029-05	Girl's Locker Room Coach's Office Bathroo	SK	App		9/9/2025				Sign
1030-01	Hall by Girl's Locker Room	WF	App	<1.0	9/9/2025				
1030-02	Hall by Girl's Locker Room	BF	App	<1.0	9/9/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1031-01	Girl's Bathroom by Gym Left	SK	N/A		9/9/2025				Sign
1031-02	Girl's Bathroom by Gym Middle	SK	N/A		9/9/2025				Sign
1031-03	Girl's Bathroom by Gym Right	SK	N/A		9/9/2025				Sign
1032-01	Boy's Bathroom by Gym Left	SK	N/A		9/9/2025				Sign
1032-02	Boy's Bathroom by Gym Middle	SK	N/A		9/9/2025				Sign
1032-03	Boy's Bathroom by Gym Right	SK	N/A		9/9/2025				Sign
1033-01	Boy's Locker Room Coach's Office Bathroom	SK	N/A		9/9/2025				Sign
1033-02	Boy's Locker Room Bathroom Left	SK	N/A		9/9/2025				Sign
1033-03	Boy's Locker Room Bathroom Right	SK	N/A		9/9/2025				Sign
1033-04	Boy's Locker Room Bathroom	WF	App	<1.0	9/9/2025				
1033-05	Boy's Locker Room Bathroom	BF	App	<1.0	9/9/2025				
1034-01	Custodial Closet by Boy's Locker Room	SS	N/A		9/9/2025				Sign
1035-01	Pool Boy's Locker Room	WF	App	<1.0	9/9/2025				
1035-04	Pool Boy's Locker Room	BF	App	<1.0	9/9/2025				
1035-02	Pool Boy's Locker Room Bathroom Left	SK	App		9/9/2025				Sign
1035-03	Pool Boy's Locker Room Bathroom Right	SK	App		9/9/2025				Sign
1036-01	Athletic Director's Office	SK	N/A		9/9/2025				Sign
2001-01	Kitchen Island 2-Bay	SK	App	<1.0	9/9/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2001-02	Kitchen Island	SK	App	<1.0	9/9/2025				
2001-03	Kitchen 3-Bay Left	SK	N/A		9/9/2025				Sign
2001-04	Kitchen 3-Bay Right	SK	N/A		9/9/2025				Sign
2001-05	Kitchen Potfiller Left	PF	App	13.0	9/9/2025				Capped
2001-06	Kitchen Potfiller Right	PF	App	21.0	9/9/2025				Capped
2001-07	Kitchen Island 1 Bay	SK	App	<1.0	9/9/2025				
2001-08	Kitchen Bathroom	SK	N/A		9/9/2025				Sign
2001-09	Kitchen Pizza & Burger Serving Line	SK	N/A		9/9/2025				Sign
2001-10	Kitchen Tiger Deli Serving Line Left	SK	N/A		9/9/2025				Sign
2001-11	Kitchen Tiger Deli Serving Line Right	SK	N/A		9/9/2025				Sign
2002-01	Cafeteria Left	WF	App	<1.0	9/9/2025				
2002-02	Cafeteria Left	BF	App	<1.0	9/9/2025				
2003-01	Cafeteria Right	WF	App	<1.0	9/9/2025				
2003-2	Cafeteria Right	BF	App	<1.0	10/15/2025				Remediation complete
				12.0	9/9/2025				Filter change, pending retest
2004-01	Room C203 - Fashion	SK	App		9/9/2025				Sign
2005-01	Room C202 Handwash	SK	N/A		9/9/2025				Sign
2005-02	Room C202 Station 1	SK	App	<1.0	9/9/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2005-03	Room C202 Station 2	SK	App	<1.0	9/9/2025				
2005-04	Room C202 3 Bay Left	SK	App	<1.0	9/9/2025				
2005-05	Room C202 3 Bay Right	SK	App	<1.0	9/9/2025				
2006-01	Room C201	SK	App	<1.0	9/9/2025				
2007-01	Hall by Room C208	WF	App	<1.0	9/9/2025				
2007-02	Hall by Room C208	BF	App	<1.0	9/9/2025				
2008-02	Women's Bathroom by Faculty Room 224 R	SK	N/A		9/9/2025				Mixed Valve; Sign
2009-01	Men's Bathroom by Faculty Room C224 Le	SK	N/A		9/9/2025				Sign
2009-02	Men's Bathroom by Faculty Room C224 Rig	SK	N/A		9/9/2025				Mixed Valve; Sign
2010-01	Faculty Dining	SK	N/A		9/9/2025				Sign
2010-02	Faculty Dining Custodial Closet	SS	N/A		9/9/2025				Sign
2011-01	Custodial Closet by Guidance	SS	N/A		9/9/2025				Sign
2012-01	Women's Bathroom by Pool Left	SK	N/A		9/9/2025				Mixed Valve; Sign
2012-02	Women's Bathroom by Pool Right	SK	N/A		9/9/2025				Mixed Valve; Sign
2013-01	Hall by Pool	Wf	App	<1.0	9/9/2025				
2013-02	Hall by Pool	BF	App	<1.0	9/9/2025				
2014-01	Men's Bathroom by Pool Left	SK	N/A		9/9/2025				Mixed Valve; Sign
2014-02	Men's Bathroom by Pool Right	SK	N/A		9/9/2025				Mixed Valve; Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2015-01	Pool Girl's Locker Room Custodial Closet	SS	N/A		9/9/2025				Sign
2015-02	Pool Girl's Locker Room	WF	App	<1.0	9/9/2025				
2015-05	Pool Girl's Locker Room	BF	App	<1.0	9/9/2025				
2015-03	Pool Girl's Locker Room Bathroom Left	SK	N/A		9/9/2025				Sign
2015-04	Pool Girl's Locker Room Bathroom Right	SK	N/A		9/9/2025				Sign
2016-01	Pool Swimming Instructor Bathroom	SK	App		9/9/2025				
2017-01	Pool Coach's Office	SK	App		9/9/2025				
2018-01	Guidance Suite	WF	App	<1.0	9/9/2025				
2018-02	Guidance Suite	BF	App	<1.0	9/9/2025				
2019-01	Main Office Principal's Bathroom	SK	N/A		9/9/2025				Sign
2020-01	Custodial Closet by Board Room	SS	N/A		9/9/2025				Sign
2021-01	Women's Bathroom by Board Room Left	SK	App		9/9/2025				
2021-02	Women's Bathroom by Board Room Right	SK	N/A		9/9/2025				Sign
2022-01	Men's Bathroom by Board Room Left	SK	N/A		9/9/2025				Sign
2022-02	Men's Bathroom by Board Room Right	SK	N/A		9/9/2025				Sign
2023-01	ADA Bathroom by Room B201	SK	N/A		9/9/2025				Sign
2024-01	Boy's Bathroom by Room A218 Left	SK	N/A		9/9/2025				Sign
2024-02	Boy's Bathroom by Room A218 Rigt	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2025-01	Men's Faculty Bathroom by Room A218 Left	SK	N/A		9/9/2025				Sign
2025-02	Men's Faculty Bathroom by Room A218 Middle	SK	N/A		9/9/2025				Sign
2025-03	Men's Faculty Bathroom by Room A218 Right	SK	N/A		9/9/2025				Sign
2026-01	Custodial Closet by Room A218	SS	N/A		9/9/2025				Sign
2027-01	Hall by Room A217	WF	App	<1.0	9/9/2025				
2027-02	Hall by Room A217	BF	App	<1.0	9/9/2025				
2028-01	Hall by Room A205	WF	App	<1.0	9/9/2025				
2028-02	Hall by Room A205	BF	App	<1.0	9/9/2025				
2029-01	Custodial Closet by Room A202	SS	N/A		9/9/2025				Sign
2030-01	Girl's Bathroom by Room A202 Left	SK	N/A		9/9/2025				Sign
2030-02	Girl's Bathroom by Room A202 Middle	SK	N/A		9/9/2025				Sign
2030-03	Girl's Bathroom by Room A202 Right	SK	N/A		9/9/2025				Sign
2031-01	Women's Faculty Bathroom by Room A202	SK	N/A		9/9/2025				Sign
2031-02	Women's Faculty Bathroom by Room A202	SK	N/A		9/9/2025				Sign
3001-01	Boy's Bathroom by Room A314 Left	SK	N/A		9/9/2025				Sign
3001-02	Boy's Bathroom by Room A314 Right	SK	N/A		9/9/2025				Sign
3002-01	Men's Bathroom by Room A314 Left	SK	N/A		9/9/2025				Sign
3002-02	Men's Bathroom by Room A314 Middle	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
3002-03	Men's Bathroom by Room A314 Right	SK	N/A		9/9/2025				Sign
3003-01	Custodial Closet by Room A314	SS	N/A		9/9/2025				Sign
3004-01	Hall by Room A313	WF	App	<1.0	9/9/2025				
3004-02	Hall by Room A313	BF	App	<1.0	9/9/2025				
3005-01	Room A311 Teacher's Station	SK	N/A		9/9/2025				Sign
3005-02	Room A311 Counter @ A	SK	N/A		9/9/2025				Sign
3005-03	Room A311 Counter @ B	SK	N/A		9/9/2025				Sign
3005-04	Room A311 Counter @ C	SK	N/A		9/9/2025				Sign
3005-05	Room A311 Counter @ D	SK	N/A		9/9/2025				Sign
3005-06	Room A311 Prep Room	SK	N/A		9/9/2025				Sign
3006-01	Room A310 Teacher's Station	SK	N/A		9/9/2025				Sign
3006-02	Room A310 Counter @ A	SK	N/A		9/9/2025				Sign
3006-03	Room A310 Counter @ B	SK	N/A		9/9/2025				Sign
3006-04	Room A310 Counter @ C	SK	N/A		9/9/2025				Sign
3006-05	Room A310 Counter @ D	SK	N/A		9/9/2025				Sign
3007-01	Room A309 Teacher's Station	SK	N/A		9/9/2025				Sign
3007-02	Room A309 Counter @ A	SK	N/A		9/9/2025				Sign
3007-03	Room A309 Counter @ B	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
3007-04	Room A309 Counter @ C	SK	N/A		9/9/2025				Sign
3007-05	Room A309 Counter @ D	SK	N/A		9/9/2025				Sign
3007-06	Room A309 Counter @ E	SK	N/A		9/9/2025				Sign
3007-07	Room A309 Counter @ F	SK	N/A		9/9/2025				Sign
3007-08	Room A309 Counter @ G	SK	N/A		9/9/2025				Sign
3007-09	Room A309 Counter @ H	SK	N/A		9/9/2025				Sign
3007-10	Room A309 / A308 Prep Room	SK	N/A		9/9/2025				Sign
3008-01	Room A308 Teacher's Station	SK	N/A		9/9/2025				Sign
3008-02	Room A308 Counter @ A	SK	N/A		9/9/2025				Sign
3008-03	Room A308 Counter @ B	SK	N/A		9/9/2025				Sign
3008-04	Room A308 Counter @ C	SK	N/A		9/9/2025				Sign
3008-05	Room A308 Counter @ D	SK	N/A		9/9/2025				Sign
3008-06	Room A308 Counter @ E	SK	N/A		9/9/2025				Sign
3008-07	Room A308 Counter @ F	SK	N/A		9/9/2025				Sign
3008-08	Room A308 Counter @ G	SK	N/A		9/9/2025				Sign
3009-01	Room A307 Teacher's Station	SK	N/A		9/9/2025				Sign
3009-02	Room A307 Fume Hood 1	SK	N/A		9/9/2025				Sign
3009-03	Room A307 Fume Hood 2	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
3009-04	Room A307 Counter	SK	N/A		9/9/2025				Sign
3009-05	Room A307 Pod 1 @ A	SK	N/A		9/9/2025				Sign
3009-06	Room A307 Pod 1 @ B	SK	N/A		9/9/2025				Sign
3009-07	Room A307 Pod 2 @ A	SK	N/A		9/9/2025				Sign
3009-08	Room A307 Pod 2 @ B	SK	N/A		9/9/2025				Sign
3009-09	Room A307 Pod 3 @ A	SK	N/A		9/9/2025				Sign
3009-10	Room A307 Pod 3 @ B	SK	N/A		9/9/2025				Sign
3009-11	Room A307 Pod 4 @ A	SK	N/A		9/9/2025				Sign
3009-12	Room A307 Pod 4 @ B	SK	N/A		9/9/2025				Sign
3009-13	Room A307 Pod 5 @ A	SK	N/A		9/9/2025				Sign
3009-14	Room A307 Pod 5 @ B	SK	N/A		9/9/2025				Sign
3009-15	Room A307 Pod 6 @ A	SK	N/A		9/9/2025				Sign
3009-16	Room A307 Pod 6 @ B	SK	N/A		9/9/2025				Sign
3009-17	Room A307 Prep Room	SK	N/A		9/9/2025				Sign
3010-01	Science Office	SK	N/A		9/9/2025				Sign
3011-01	Room A306 Teacher's Station	SK	N/A		9/9/2025				Sign
3011-02	Room A306 Counter	SK	N/A		9/9/2025				Sign
3012-01	Hall by Room A305	WF	App	<1.0	9/9/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
3012-02	Hall by Room A305	BF	App		9/9/2025				
3013-01	Custodial Closet by Room A303	SS	N/A		9/9/2025				Sign
3014-01	Girl's Bathroom by Room A303 Left	SK	N/A		9/9/2025				Sign
3014-02	Girl's Bathroom by Room A303 Middle	SK	N/A		9/9/2025				Sign
3014-03	Girl's Bathroom by Room A303 Right	SK	N/A		9/9/2025				Sign
3015-01	Women's Bathroom by Room A303 Left	SK	N/A		9/9/2025				Sign
3015-02	Women's Bathroom by Room A303 Right	SK	N/A		9/9/2025				Sign
3016-01	Hall by Room B303	WF	App		9/9/2025				
3017-01	ADA Bathroom by Room B308 / Team Cen	SK	App		9/9/2025				
4001-01	Men's Bathroom B410 by JROTC	SK	N/A		9/9/2025				Sign
4002-01	Custodial Closet B412 by JROTC	SS	N/A		9/9/2025				Sign
4003-01	Women's Bathroom by JROTC	SK	N/A		9/9/2025				Sign
0	Water Fountain by Bleachers - Left	WF	App	2.0	9/9/2025				
0	Water Fountain by Bleachers - Right	WF	App	3.0	9/9/2025				
0	Field House Womans Bathroom Left	SK	N/A		9/9/2025				Sign
0	Field House Womans Bathroom Right	SK	N/A		9/9/2025				Sign
0	Field House Mens Bathroom Left	SK	N/A		9/9/2025				Sign
0	Field House Mens Bathroom Right	SK	N/A		9/9/2025				Sign

Laboratory Report

September 15, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779


Project: Hempstead UFSD: Hempstead High School
Project Address: 201 President St, Hempstead, NY 11550
Report ID: 250911006
Sample IDs: 250911006-575 - 250911006-626

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	9-Sep-25
Date Received:	11-Sep-25
Date Analyzed:	12-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250911006-575	1	Cafeteria Left - WF; initial	0.001	<0.001	mg/L	
250911006-576	2	Cafeteria Left - BF; initial	0.001	<0.001	mg/L	
250911006-577	3	Cafeteria Right - WF; initial	0.001	<0.001	mg/L	
250911006-578	4	Cafeteria Right - BF; initial	0.001	0.012	mg/L	H
250911006-579	5	Kitchen Island 2-Bay - SK; initial	0.001	<0.001	mg/L	
250911006-580	6	Kitchen Island - SK; initial	0.001	<0.001	mg/L	
250911006-581	7	Kitchen Potfiller Left - PF; initial	0.001	0.013	mg/L	H
250911006-582	8	Kitchen Potfiller Right - PF; initial	0.001	0.021	mg/L	H
250911006-583	9	Kitchen Island 1 Bay - SK; initial	0.001	<0.001	mg/L	
250911006-584	10	Room C202 Station 1 - SK; initial	0.001	<0.001	mg/L	
250911006-585	11	Room C202 Station 2 - SK; initial	0.001	<0.001	mg/L	
250911006-586	12	Room C202 3 Bay Left - SK; initial	0.001	<0.001	mg/L	
250911006-587	13	Room C202 3 Bay Right - SK; initial	0.001	<0.001	mg/L	
250911006-588	14	Room C201 - SK; initial	0.001	<0.001	mg/L	
250911006-589	15	Hall by Room C208 - WF; initial	0.001	<0.001	mg/L	
250911006-590	16	Hall by Room C208 - BF; initial	0.001	<0.001	mg/L	
250911006-591	17	Hall by Pool - Wf; initial	0.001	<0.001	mg/L	
250911006-592	18	Hall by Pool - BF; initial	0.001	<0.001	mg/L	
250911006-593	19	Pool Girl's Locker Room - WF; initial	0.001	<0.001	mg/L	
250911006-594	20	Pool Girl's Locker Room - BF; initial	0.001	<0.001	mg/L	
250911006-595	21	Guidance Suite - WF; initial	0.001	<0.001	mg/L	
250911006-596	22	Guidance Suite - BF; initial	0.001	<0.001	mg/L	
250911006-597	23	Hall by Room A217 - WF; initial	0.001	<0.001	mg/L	
250911006-598	24	Hall by Room A217 - BF; initial	0.001	<0.001	mg/L	
250911006-599	25	Hall by Room A205 - WF; initial	0.001	<0.001	mg/L	
250911006-600	26	A205 Hall by Room - BF; initial	0.001	<0.001	mg/L	
250911006-601	27	Hall by Room A313 - WF; initial	0.001	<0.001	mg/L	
250911006-602	28	Hall by Room A313 - BF; initial	0.001	<0.001	mg/L	
250911006-603	29	Hall by Room A305 - WF; initial	0.001	<0.001	mg/L	
250911006-604	30	Little Theatre Lobby - WF; initial	0.001	<0.001	mg/L	
250911006-605	31	Little Theatre Lobby - BF; initial	0.001	<0.001	mg/L	
250911006-606	32	Hall by Room A114 - WF; initial	0.001	<0.001	mg/L	
250911006-607	33	Hall by Room A114 - BF; initial	0.001	<0.001	mg/L	
250911006-608	34	Hall by Room A105 - WF; initial	0.001	<0.001	mg/L	



Date Collected:	9-Sep-25
Date Received:	11-Sep-25
Date Analyzed:	12-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250911006-609	35	Hall by Room A105 - BF; initial	0.001	<0.001	mg/L	
250911006-610	36	Hall by Room C105B - WF; initial	0.001	<0.001	mg/L	
250911006-611	37	Hall by Room C105B - BF; initial	0.001	<0.001	mg/L	
250911006-612	38	Nurse's Station Exam Room 2 - SK; initial	0.001	<0.001	mg/L	
250911006-613	39	Nurse's Station Bathroom - SK; initial	0.001	<0.001	mg/L	
250911006-614	40	Nurse's Station Exam Room 1 - SK; initial	0.001	<0.001	mg/L	
250911006-615	41	Nurse's Station Office - SK; initial	0.001	<0.001	mg/L	
250911006-616	42	Athletic Trainer Room - SK; initial	0.001	0.002	mg/L	
250911006-617	43	Girl's Locker Room - WF; initial	0.001	<0.001	mg/L	
250911006-618	44	Girl's Locker Room - BF; initial	0.001	<0.001	mg/L	
250911006-619	45	Hall by Girl's Locker Room - WF; initial	0.001	<0.001	mg/L	
250911006-620	46	Hall by Girl's Locker Room - BF; initial	0.001	<0.001	mg/L	
250911006-621	47	Boy's Locker Room Bathroom - WF; initial	0.001	<0.001	mg/L	
250911006-622	48	Boy's Locker Room Bathroom - BF; initial	0.001	<0.001	mg/L	
250911006-623	49	Pool Boy's Locker Room - WF; initial	0.001	<0.001	mg/L	
250911006-624	50	Pool Boy's Locker Room - BF; initial	0.001	<0.001	mg/L	
250911006-625	51	Water Fountain by Bleachers - Left - WF; initial	0.001	0.002	mg/L	
250911006-626	52	Water Fountain by Bleachers - Right - WF; initial	0.001	0.003	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

October 16, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779

Project: Hempstead High School
Project Address: 201 President St, Hempstead, NY 11550
Report ID: 251015019
Sample IDs: 251015019-270 - 251015019-270

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	15-Oct-25
Date Received:	15-Oct-25
Date Analyzed:	16-Oct-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
251015019-270	1A	Cafeteria-Right - BF; initial	0.001	<0.001	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID



Appendix B

Alverta B. Gray Schultz Middle School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Kitchen Bathroom	SK	App		9/9/2025				Sign
1001-2	Kitchen Slop Sink	SS	N/A		9/9/2025				Sign
1001-3	Kitchen 2-Bay Prep sink	SK	App	<1.0	9/9/2025				
1001-4	Kitchen Pot Filler	SK	App	32.0	9/9/2025				Capped
1001-5	Kitchen 2-Bay by Ovens (left)	SK	App		9/9/2025				Sign
1001-6	Kitchen 2-Bay by Ovens (right)	SK	App		9/9/2025				Sign
1001-7	Kitchen Handwash	SK	N/A		9/9/2025				Sign
1002-1	Hall by Room 147	WF	App		9/9/2025				Non-functional, sampling required before returning to service
1002-2	Hall by Room 147	BF	App		9/9/2025				Non-functional, sampling required before returning to service
1003-1	Boy's Locker Room bathroom (left)	SK	App		9/9/2025				Sign
1003-2	Boy's Locker Room bathroom (left center)	SK	App		9/9/2025				Sign
1003-3	Boy's Locker Room bathroom (right center)	SK	App		9/9/2025				Sign
1003-4	Boy's Locker Room bathroom (right)	SK	App		9/9/2025				Sign
1003-5	Boy's Locker Room	WF	App		9/9/2025				Non-functional, sampling required before returning to service
1004-1	Room 140 Home Economics @ A	SK	App	<1.0	9/9/2025				
1004-2	Room 140 Home Economics @ B	SK	App	<1.0	9/9/2025				
1004-3	Room 140 Home Economics @ C	SK	App	<1.0	9/9/2025				
1004-4	Room 140 Home Economics @ D	SK	App		9/9/2025				Non-functional, sampling required before returning to service

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1005-1	Hall by Room 150	WF	App	<1.0	9/9/2025				
1005-2	Hall by Room 150	BF	App	<1.0	9/9/2025				
1006-1	Custodial Closet by Room 150	SS	N/A		9/9/2025				Sign
1007-1	Faculty Lounge	SK	App	<1.0	9/9/2025				
1008-1	Women's Bathroom by Faculty Lounge (left)	SK	App		9/9/2025				Sign
1008-2	Women's Bathroom by Faculty Lounge (right)	SK	App		9/9/2025				Sign
1009-1	Men's Bathroom by Faculty Lounge (left)	SK	App		9/9/2025				Sign
1009-2	Men's Bathroom by Faculty Lounge (right)	SK	App		9/9/2025				Sign
1010-1	Administration Kitchenette	SK	App	2.0	9/9/2025				
1011-1	Girl's Bathroom by Lobby (left)	SK	App		9/9/2025				Sign
1011-2	Girl's Bathroom by Lobby (center)	SK	App		9/9/2025				Sign
1011-3	Girl's Bathroom by Lobby (right)	SK	App		9/9/2025				Sign
1013-1	Boy's Bathroom by Lobby (left)	SK	N/A		9/9/2025				Sign
1013-2	Boy's Bathroom by Lobby (right)	SK	App		9/9/2025				Sign
1014-1	Staff Bathroom by Lobby (left)	SK	App		9/9/2025				Sign
1014-2	Staff Bathroom by Lobby (right)	SK	App		9/9/2025				Sign
1015-1	Nurse's Office	SK	App	<1.0	9/9/2025				
1015-2	Nurse's Office Right Bathroom	SK	App		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1015-3	Nurse's Office left Bathroom	SK	App		9/9/2025				Sign
1016-1	Conference Room Bathroom	SK	App		9/9/2025				Sign
1017-1	Principal's Office Bathroom	SK	App		9/9/2025				Sign
1018-1	Room 132	SK	App		9/9/2025				Sign
1019-1	Room 126 Teacher's Station	SK	N/A		9/9/2025				Sign
1019-2	Counter 1	SK	N/A		9/9/2025				Sign
1019-3	Counter 2	SK	N/A		9/9/2025				Sign
1020-1	Hall by Room 126	WF	App	<1.0	9/9/2025				
1020-2	Hall by Room 126	BF	App		9/9/2025				Non-functional, sampling required before returning to service
1021-1	Men's Bathroom by Room 7022	SK	App		9/9/2025				Sign
1022-1	Women's Bathroom by Room 7022	SK	App		9/9/2025				Sign
1023-1	Boy's Bathroom by Room 7022 @ A	SK	N/A		9/9/2025				Mixed Valve; Sign
1023-2	Boy's Bathroom by Room 7022 @ B	SK	N/A		9/9/2025				Mixed Valve; Sign
1023-3	Boy's Bathroom by Room 7022 @ C	SK	N/A		9/9/2025				Mixed Valve; Sign
1023-4	Boy's Bathroom by Room 7022 @ D	SK	N/A		9/9/2025				Mixed Valve; Sign
1023-5	Boy's Bathroom by Room 7022 @ E	SK	N/A		9/9/2025				Mixed Valve; Sign
1024-1	Custodial Closet by Room 7022	SS	N/A		9/9/2025				Sign
1025-1	Girl's Bathroom by Room 7022 @ A	SK	N/A		9/9/2025				Mixed Valve; Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1025-2	Girl's Bathroom by Room 7022 @ B	SK	N/A		9/9/2025				Mixed Valve; Sign
1025-3	Girl's Bathroom by Room 7022 @ C	SK	N/A		9/9/2025				Mixed Valve; Sign
1025-4	Girl's Bathroom by Room 7022 @ D	SK	N/A		9/9/2025				Mixed Valve; Sign
1025-5	Girl's Bathroom by Room 7022 @ E	SK	N/A		9/9/2025				Mixed Valve; Sign
1026-1	Hall by Room 7033	WF	App	<1.0	9/9/2025				
1026-2	Hall by Room 7033	BF	App	<1.0	9/9/2025				Removed from service
1027-1	Room 121 Teacher's Station	SK	N/A		9/9/2025				Sign
1027-2	Counter 1	SK	N/A		9/9/2025				Sign
1027-3	Counter 2	SK	N/A		9/9/2025				Sign
1028-1	Room 124	SK	N/A		9/9/2025				Sign
1029-1	Room 116 Teacher's Station	SK	N/A		9/9/2025				Sign
1029-2	Counter 1	SK	N/A		9/9/2025				Sign
1029-3	Counter 2	SK	N/A		9/9/2025				Sign
1030-1	Room 119	SK	App		9/9/2025				Sign
1030-2	Room 119	WF	App		9/9/2025				Removed from service
1031-1	Room 111 Teacher's Station	SK	N/A		9/9/2025				Sign
1031-2	Counter 1	SK	N/A		9/9/2025				Sign
1031-3	Counter 2	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1032-1	Room 114	SK	App		9/9/2025				Sign
1032-2	Room 114	WF	App		9/9/2025				Removed from Service
1033-1	Boy's Bathroom 7033 @ A	SK	N/A		9/9/2025				Mixed Valve; Sign
1033-2	Boy's Bathroom 7033 @ B	SK	N/A		9/9/2025				Mixed Valve; Sign
1033-3	Boy's Bathroom 7033 @ C	SK	N/A		9/9/2025				Mixed Valve; Sign
1033-4	Boy's Bathroom 7033 @ D	SK	N/A		9/9/2025				Mixed Valve; Sign
1033-5	Boy's Bathroom 7033 @ E	SK	N/A		9/9/2025				Mixed Valve; Sign
1034-1	Custodial Closet 7044	SS	N/A		9/9/2025				Sign
1035-1	Girl's Bathroom 7005 @ A	SK	N/A		9/9/2025				Mixed Valve; Sign
1035-2	Girl's Bathroom 7005 @ B	SK	N/A		9/9/2025				Mixed Valve; Sign
1035-3	Girl's Bathroom 7005 @ C	SK	N/A		9/9/2025				Mixed Valve; Sign
1035-4	Girl's Bathroom 7005 @ D	SK	N/A		9/9/2025				Mixed Valve; Sign
1035-5	Girl's Bathroom 7005 @ E	SK	N/A		9/9/2025				Mixed Valve; Sign
1036-1	Hall by Dean's Office	WF	App	<1.0	9/9/2025				
1036-2	Hall by Dean's Office	BF	App	<1.0	9/9/2025				
1037-1	Room 106 Teacher's Station	SK	N/A		9/9/2025				Sign
1037-2	Counter 1	SK	N/A		9/9/2025				Sign
1037-3	Counter 2	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1038-1	Room 109	SK	N/A		9/9/2025				Sign
1038-2	Room 109	WF	App		9/9/2025				Removed from service
1039-1	Room 101 Teacher's Station	SK	N/A		9/9/2025				Sign
1039-2	Counter 1	SK	N/A		9/9/2025				Sign
1039-3	Counter 2	SK	N/A		9/9/2025				Sign
1040-1	Room 104	SK	N/A		9/9/2025				Sign
1040-2	Room 104	WF	App		9/9/2025				Removed from service
1041-1	Room 7013 Social Worker	SK	App		9/9/2025				Sign
1042-1	Library Office	SK	App		9/9/2025				Sign
1042-2	Library	BF	App	<1.0	9/9/2025				
1042-3	Library	WF	App	<1.0	9/9/2025				
2001-1	Girl's Bathroom by Gym (left)	SK	App		9/9/2025				Sign
2001-2	Girl's Bathroom by Gym (center)	SK	App		9/9/2025				Sign
2001-3	Girl's Bathroom by Gym (right)	SK	App		9/9/2025				Sign
2002-1	Boy's Bathroom by Gym (left)	SK	App		9/9/2025				Sign
2002-2	Boy's Bathroom by Gym (center)	SK	App		9/9/2025				Sign
2002-3	Boy's Bathroom by Gym (right)	SK	App		9/9/2025				Sign
2003-1	Hall by Room 206	WF	App	<1.0	9/9/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2003-2	Hall by Room 206	BF	App	<1.0	9/9/2025				
2004-1	Custodial Closet by Gym	SK	N/A		9/9/2025				Sign
2005-1	Room 209 Tech	SK	N/A		9/9/2025				Sign
2006-1	Hall by Room 209	WF	App	<1.0	9/9/2025				
2006-2	Hall by Room 209	BF	App	<1.0	9/9/2025				
2007-1	Room 207 Tech	SK	N/A		9/9/2025				Sign
2008-1	Room 203 Art	SK	N/A		9/9/2025				Sign
2009-1	Room 201 Art	SK	N/A		9/9/2025				Sign
0001-1	Hall by Girl's Gym (left)	WF	App	<1.0	9/9/2025				
0001-2	Hall by Girl's Gym (right)	WF	App	<1.0	9/9/2025				
0001-3	Hall by Girl's Gym (right)	BF	App	<1.0	9/9/2025				
0002-1	Girl's Locker Room Bathroom (left)	SK	App		9/9/2025				Sign
0002-2	Girl's Locker Room Bathroom (center)	SK	App		9/9/2025				Sign
0002-3	Girl's Locker Room Bathroom (right)	SK	App		9/9/2025				Sign
0003-1	Men's Bathroom by Facilities Office (left)	SK	App		9/9/2025				Sign
0003-2	Men's Bathroom by Facilities Office (Center)	SK	App		9/9/2025				Sign
0003-3	Men's Bathroom by Facilities Office (right)	SK	App		9/9/2025				Sign
0004-1	Hall by Facilities Office	WF	App	<1.0	9/9/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0004-2	Hall by Facilities Office	BF	App	<1.0	9/9/2025				
0006-1	Women's Bathroom by Personel (left)	SK	App		9/9/2025				Sign
0006-2	Women's Bathroom by Personel (left center)	SK	App		9/9/2025				Sign
0006-3	Women's Bathroom by Personel (right center)	SK	App		9/9/2025				Sign
0006-4	Women's Bathroom by Personel (right)	SK	App		9/9/2025				Sign
0007-1	Business Office Women's Bathroom (left)	SK	App		9/9/2025				Sign
0007-2	Business Office Women's Bathroom (right)	SK	App		9/9/2025				Sign
0007-3	Business Office Men's Bathroom (left)	SK	App		9/9/2025				Sign
0007-4	Business Office Men's Bathroom (right)	SK	App		9/9/2025				Sign
0007-5	Business Office Kitchen	SK	App	383.0	10/15/2025	235.0	16.0		Sign posted, water cooler provided
				8.0	9/9/2025				Aerator cleaned, pending retest

Laboratory Report

September 15, 2025

Pam Chadderton
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779


Project: Hempstead UFSD; ABGS Middle School
Project Address: 70 Greenwich St
Report ID: 250911009
Sample IDs: 250911009-793 - 250911009-818

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	9-Sep-25
Date Received:	11-Sep-25
Date Analyzed:	12-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250911009-793	1	Kitchen 2-Bay Prep sink - SK; initial	0.001	<0.001	mg/L	
250911009-794	2	Kitchen Pot Filler - SK; initial	0.001	0.032	mg/L	H
250911009-795	3	Hall by Room 150 - BF; initial	0.001	<0.001	mg/L	
250911009-796	4	Hall by Room 150 - WF; initial	0.001	<0.001	mg/L	
250911009-797	5	Faculty Lounge - SK; initial	0.001	<0.001	mg/L	
250911009-798	6	Administration Kitchenette - SK; initial	0.001	0.002	mg/L	
250911009-799	7	Room 140 Home Economics @ A - SK; initial	0.001	<0.001	mg/L	
250911009-800	8	Room 140 Home Economics @ B - SK; initial	0.001	<0.001	mg/L	
250911009-801	9	Room 140 Home Economics @ C - SK; initial	0.001	<0.001	mg/L	
250911009-802	10	Nurse's Office - SK; initial	0.001	<0.001	mg/L	
250911009-803	11	Hall by Room 206 - BF; initial	0.001	<0.001	mg/L	
250911009-804	12	Hall by Room 206 - WF; initial	0.001	<0.001	mg/L	
250911009-805	13	Hall by Room 209 - BF; initial	0.001	<0.001	mg/L	
250911009-806	14	Hall by Room 209 - WF; initial	0.001	<0.001	mg/L	
250911009-807	15	Hall by Girl's Gym (left) - WF; initial	0.001	<0.001	mg/L	
250911009-808	16	Hall by Girl's Gym (right) - BF; initial	0.001	<0.001	mg/L	
250911009-809	17	Hall by Girl's Gym (right) - WF; initial	0.001	<0.001	mg/L	
250911009-810	18	Hall by Room 7033 - BF; initial	0.001	<0.001	mg/L	
250911009-811	19	Hall by Room 7033 - WF; initial	0.001	<0.001	mg/L	
250911009-812	20	Hall by Dean's Office - BF; initial	0.001	<0.001	mg/L	
250911009-813	21	Hall by Dean's Office - WF; initial	0.001	<0.001	mg/L	
250911009-814	22	Hall by Room 126 - WF; initial	0.001	<0.001	mg/L	
250911009-815	23	Library - BF; initial	0.001	<0.001	mg/L	
250911009-816	24	Library - WF; initial	0.001	<0.001	mg/L	
250911009-817	25	Hall by Facilities Office - BF; initial	0.001	<0.001	mg/L	
250911009-818	26	Hall by Facilities Office - WF; initial	0.001	<0.001	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID

H: Sample result exceeds applicable regulatory limit.



Date Collected:	11-Sep-25
Date Received:	15-Sep-25
Date Analyzed:	15-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250915004-100	1	Business Office Kitchen - SK; initial	0.001	0.008	mg/L	H

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

October 16, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779

Project: Alberta B. Gray Shulz Middle School
Project Address: 70 Greenwich St, Hempstead, NY 11550
Report ID: 251015016
Sample IDs: 251015016-258 - 251015016-260

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	15-Oct-25
Date Received:	15-Oct-25
Date Analyzed:	16-Oct-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
251015016-258	1A	Business Office Kitchen - SK; initial	0.001	0.383	mg/L	H
251015016-259	1B	Business Office Kitchen - SK; 15 sec flush	0.001	0.235	mg/L	H
251015016-260	1C	Business Office Kitchen - SK; 60 sec flush	0.001	0.016	mg/L	H

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID

H: Sample result exceeds applicable regulatory limit.

NA: Samples not analyzed as per customer request.



Appendix C

Jackson Elementary School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Kitchen-3 Bay	SK	App	<1.0					
1002-1	Room 10	SK	N/A						Sign
1003-1	Hall near Room 11	BF	App	<1.0					
1003-2	Hall near Room 11	WF	App	<1.0					
1004-1	Boys Bathroom by Room 11 (Left)	SK	App	<1.0					
1004-2	Boys Bathroom by Room 11 (Right)	SK	App	<1.0					
1005-1	Girls Bathroom by Room 11 (Left)	SK	App	<1.0					
1005-2	Girls Bathroom by Room 11 (Right)	SK	App	<1.0					
1006-1	Hall near Room 19	WF	App	<1.0					
1006-2	Hall near Room 19	BF	App	<1.0					
1007-1	Custodial Closet	SS	N/A						Sign
1008-1	Room 14	SK	N/A						Sign
1009-1	Room 18	SK	N/A						Sign
1010-1	Mens Bathroom near Conference Room	SK	N/A						Sign
1011-1	Womens Bathroom near Conference Room	SK	N/A						Sign
1012-1	Nurses Office Bathroom	SK	App	<1.0					
1013-1	Main Office Bathroom	SK	N/A						Sign
1015-1	Girls Bathroom by Room 4 (Left)	SK	App	<1.0					

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1015-2	Girls Bathroom by Room 4 (Right)	SK	App	<1.0					
1014-1	Custodial Closet near Attendance Office	SS	N/A						Sign
1016-1	Hall near Room 6	WF	App	<1.0					
1016-2	Hall near Room 6	BF	App	<1.0					
1017-1	Boys Bathroom by Room 6 (Left)	SK	App	<1.0					
1017-2	Boys Bathroom by Room 6 (Right)	SK	App	<1.0					
1018-1	Room 8 Faculty Bathroom	SK	N/A						Sign
1019-1	Room 8-B	SK	N/A						Sign
1020-1	Boiler Room	SS	N/A						Sign
1021-1	Portable D Bathroom	SK	App	<1.0					
1022-1	Portable C Bathroom	SK	App	1.0					
1023-1	Portable B Bathroom	SK	App	<1.0					
1024-1	Portable A Bathroom	SK	App	2.0					

Laboratory Report

September 16, 2025

Pam Chadderton
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779

Project: Hempstead UFSD
Project Address: Jackson Elementary School
Report ID: 250915007
Sample IDs: 250915007-143 - 250915007-162

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	12-Sep-25
Date Received:	15-Sep-25
Date Analyzed:	15-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250915007-143	1	Kitchen-3 Bay - SK; initial	0.001	<0.001	mg/L	
250915007-144	2	Hall near Room 11 - BF; initial	0.001	<0.001	mg/L	
250915007-145	3	Hall near Room 11 - WF; initial	0.001	<0.001	mg/L	
250915007-146	4	Boys Bathroom by Room 11 (Left) - SK; initial	0.001	<0.001	mg/L	
250915007-147	5	Boys Bathroom by Room 11 (Right) - SK; initial	0.001	<0.001	mg/L	
250915007-148	6	Girls Bathroom by Room 11 (Left) - SK; initial	0.001	<0.001	mg/L	
250915007-149	7	Girls Bathroom by Room 11 (Right) - SK; initial	0.001	<0.001	mg/L	
250915007-150	8	Hall near Room 19 - BF; initial	0.001	<0.001	mg/L	
250915007-151	9	Hall near Room 19 - WF; initial	0.001	<0.001	mg/L	
250915007-152	10	Nurses Office Bathroom - SK; initial	0.001	<0.001	mg/L	
250915007-153	11	Girls Bathroom by Room 4 (Left) - SK; initial	0.001	<0.001	mg/L	
250915007-154	12	Girls Bathroom by Room 4 (Right) - SK; initial	0.001	<0.001	mg/L	
250915007-155	13	Boys Bathroom by Room 6 (Left) - SK; initial	0.001	<0.001	mg/L	
250915007-156	14	Boys Bathroom by Room 6 (Right) - SK; initial	0.001	<0.001	mg/L	
250915007-157	15	Hall near Room 6 - BF; initial	0.001	<0.001	mg/L	
250915007-158	16	Hall near Room 6 - WF; initial	0.001	<0.001	mg/L	
250915007-159	17	Portable A Bathroom - SK; initial	0.001	0.002	mg/L	
250915007-160	18	Portable B Bathroom - SK; initial	0.001	<0.001	mg/L	
250915007-161	19	Portable C Bathroom - SK; initial	0.001	0.001	mg/L	
250915007-162	20	Portable D Bathroom - SK; initial	0.001	<0.001	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID



Appendix D

Jackson Elementary School Annex

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Kitchen	SK	App	<1.0	9/9/2025				
1002-1	Boys Bathroom	SK	App	<1.0	9/9/2025				
1003-1	Girls Bathroom	SK	App	<1.0	9/9/2025				
1004-1	Faculty Room 7	SK	N/A		9/9/2025				Sign
1004-2	Faculty Room 7	WF	App		9/9/2025				Removed from Service
1005-1	Hall near Room 7	WF	App	<1.0	9/9/2025				
1005-2	Hall near Room 7	BF	App	<1.0	9/9/2025				
1006-1	Room 5 Multipurpose	SK	N/A		9/9/2025				Sign
1007-1	Room 6	SK	N/A		9/9/2025				Sign
1008-1	Nurses Office	SK	App	1.0	9/9/2025				
1009-1	Main Office	SK	N/A		9/9/2025				Sign
1010-1	Main Office Bathroom	SK	N/A		9/9/2025				Sign
1011-1	Room 1	SK	N/A		9/9/2025				Sign
1011-2	Room 1	WF	App		9/9/2025				Removed from Service
1012-1	Hall near Room 4	BF	App	<1.0	9/9/2025				
1012-2	Hall near Room 4	WF	App	<1.0	9/9/2025				
1013-1	Room 2	SK	N/A		9/9/2025				Sign
1013-2	Room 2	WF	App		9/9/2025				Removed from Service
1014-1	Room 3	SK	N/A		9/9/2025				Sign
1014-2	Room 3	WF	App		9/9/2025				Removed from Service

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1015-1	Room 4	SK	N/A		9/9/2025				Sign
1015-2	Room 4	WF	App		9/9/2025				Removed from Service
1016-1	Portable A/B Bathroom	SK	N/A		9/9/2025				Sign
1017-1	Portable C Bathroom	SK	N/A		9/9/2025				Sign
1018-1	Portable D Bathroom	SK	N/A		9/9/2025				Sign
1019-1	Portable E Bathroom	SK	N/A		9/9/2025				Sign
1020-1	Portable F Bathroom	SK	N/A		9/9/2025				Sign
1021-1	Portable G Bathroom	SK	N/A		9/9/2025				Sign
1022-1	Portable H Bathroom	SK	N/A		9/9/2025				Sign
1027-1	Portable M Bathroom	SK	N/A		9/9/2025				Sign
1029-1	Portable O Bathroom	SK	N/A		9/9/2025				Sign
1030-1	Portable P Bathroom	SK	N/A		9/9/2025				Sign
1025-1	Portable K Bathroom	SK	N/A		9/9/2025				Sign
1026-1	Portable L Bathroom	SK	N/A		9/9/2025				Sign
1023-1	Portable I Bathroom	SK	N/A		9/9/2025				Sign
1024-1	Portable J Bathroom	SK	N/A		9/9/2025				Sign
1008-1	Nurses Office Bathroom	SK	0	<1.0	9/9/2025				

Laboratory Report

September 15, 2025

Pam Chadderton
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779

Project: Hempstead UFSD; Jackson Annex/ES
Project Address: 380 Jackson St
Report ID: 250915006
Sample IDs: 250915006-114 - 250915006-122

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	12-Sep-25
Date Received:	15-Sep-25
Date Analyzed:	15-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250915006-114	1	Kitchen - SK; initial	0.001	<0.001	mg/L	
250915006-115	2	Boys Bathroom - SK; initial	0.001	<0.001	mg/L	
250915006-116	3	Girls Bathroom - SK; initial	0.001	<0.001	mg/L	
250915006-117	4	Hall near Room 7 - BF; initial	0.001	<0.001	mg/L	
250915006-118	5	Hall near Room 7 - WF; initial	0.001	<0.001	mg/L	
250915006-119	6	Nurses Office - SK; initial	0.001	0.001	mg/L	
250915006-120	7	Nurses Office Bathroom - SK; initial	0.001	<0.001	mg/L	
250915006-121	8	Hall near Room 4 - BF; initial	0.001	<0.001	mg/L	
250915006-122	9	Hall near Room 4 - WF; initial	0.001	<0.001	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID



Appendix E

Barack Obama Elementary School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-2	Kitchen Corner 3 Bay (Left)	SK	App	<1.0	9/11/2025				
1001-3	Kitchen Corner 3 Bay (Right)	SK	App	<1.0	9/11/2025				
1002-1	Boys Bathroom by Room 12 (Left)	SK	App	<1.0	9/11/2025				
1002-2	Boys Bathroom by Room 12 (Middle Left)	SK	App	<1.0	9/11/2025				
1002-3	Boys Bathroom by Room 12 (Middle Right)	SK	App	<1.0	9/11/2025				
1002-4	Boys Bathroom by Room 12 (Right)	SK	App	<1.0	9/11/2025				
1003-1	Custodial Closet by Room 12	SS	N/A		9/11/2025				Sign
1004-1	Nurses Office Bathroom	SK	App		9/11/2025				
1005-1	Hall by Room 12	WF	App	<1.0	9/11/2025				
1005-2	Hall by Room 12	BF	App	<1.0	9/11/2025				
1006-1	Room 6	WF	App		9/11/2025				Removed from Service
1006-2	Room 6	SK	App		9/11/2025				Sign
1007-1	Room 7	WF	App		9/11/2025				Removed from Service
1007-2	Room 7	SK	App		9/11/2025				Sign
1008-1	Room 8	WF	App		9/11/2025				Removed from Service
1008-2	Room 8	SK	App		9/11/2025				Sign
1009-1	Curriculum Room	SK	N/A		9/11/2025				
1010-1	Room 1	SK	App		9/11/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1011-1	Hall by Room 1	WF	App	<1.0	9/11/2025				
1011-2	Hall by Room 1	BF	App	<1.0	9/11/2025				
1012-1	Girls Bathroom by Room 3 (Left)	SK	App	<1.0	9/11/2025				
1012-2	Girls Bathroom by Room 3 (Right)	SK	App	<1.0	9/11/2025				
1013-1	Faculty Bathroom	SK	App		9/11/2025				Sign
1013-2	Custodial Closet by Room 3	SS	N/A		9/11/2025				Sign
1014-1	Hall by Principals Office	WF	App	<1.0	9/11/2025				
1014-2	Hall by Principals Office	BF	App	<1.0	9/11/2025				
1015-1	Faculty Bathroom by Principals Office	SK	App		9/11/2025				Sign
1016-1	Boys Bathroom by Room 17	SK	App	<1.0	9/11/2025				
1017-1	Girls Bathroom by Room 16 (Left)	SK	App	<1.0	9/11/2025				
1017-2	Girls Bathroom by Room 16 (Right)	SK	App	<1.0	9/11/2025				
1018-1	Portable Room 19 Bathroom	SK	App		9/11/2025				
1019-1	Portable Room 20 Bathroom	SK	App		9/11/2025				
1020-1	Portable Room 21 Bathroom	SK	App		9/11/2025				
1021-1	Portable Room 22 Bathroom	SK	App		9/11/2025				

Laboratory Report

September 12, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779

Project: Hempstaed UFSD - Barack Obama Elementary School
Project Address: 176 William St, Hempstead, NY 11550
Report ID: 250911005
Sample IDs: 250911005-501 - 250911005-522

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	11-Sep-25
Date Received:	11-Sep-25
Date Analyzed:	12-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250911005-501	1	Kitchen Corner 3 Bay (Left); initial	0.001	<0.001	mg/L	
250911005-502	2	Kitchen Corner 3 Bay (Right); initial	0.001	<0.001	mg/L	
250911005-503	3	Boys Bathroom by Room 12 (Left); initial	0.001	<0.001	mg/L	
250911005-504	4	Boys Bathroom by Room 12 (Middle Left); initial	0.001	<0.001	mg/L	
250911005-505	5	Boys Bathroom by Room 12 (Middle Right); initial	0.001	<0.001	mg/L	
250911005-506	6	Boys Bathroom by Room 12 (Right); initial	0.001	<0.001	mg/L	
250911005-507	7	Hall by Room 12; initial	0.001	<0.001	mg/L	
250911005-508	8	Hall by Room 12; initial	0.001	<0.001	mg/L	
250911005-509	9	Hall by Room 1; initial	0.001	<0.001	mg/L	
250911005-510	10	Hall by Room 1; initial	0.001	<0.001	mg/L	
250911005-511	11	Girls Bathroom by Room 3 (Left); initial	0.001	<0.001	mg/L	
250911005-512	12	Girls Bathroom by Room 3 (Right); initial	0.001	<0.001	mg/L	
250911005-513	13	Nurses Office Bathroom; initial	0.001	<0.001	mg/L	
250911005-514	14	Hall by Principals Office; initial	0.001	<0.001	mg/L	
250911005-515	15	Hall by Principals Office; initial	0.001	<0.001	mg/L	
250911005-516	16	Boys Bathroom by Room 17; initial	0.001	<0.001	mg/L	
250911005-517	17	Girls Bathroom by Room 16 (Left); initial	0.001	<0.001	mg/L	
250911005-518	18	Girls Bathroom by Room 16 (Right); initial	0.001	<0.001	mg/L	
250911005-519	19	Portable Room 19 Bathroom; initial	0.001	<0.001	mg/L	
250911005-520	20	Portable Room 20 Bathroom; initial	0.001	<0.001	mg/L	
250911005-521	21	Portable Room 21 Bathroom; initial	0.001	<0.001	mg/L	
250911005-522	22	Portable Room 22 Bathroom; initial	0.001	<0.001	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID



Appendix F

Joseph A. McNeil Elementary School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Kitchen 2 Bay	SK	App	<1.0	9/9/2025				
1002-1	Hall by Cafetorium	WF	App	<1.0	9/9/2025				
1002-2	Hall by Cafetorium	BF	App	<1.0	9/9/2025				
1003-1	ADA Accessible Bathroom by Cafetorium	SK	App	<1.0	9/9/2025				
1004-1	Boys Bathroom by Cafetorium (Left)	SK	App	<1.0	9/9/2025				
1004-2	Boys Bathroom by Cafetorium (Right)	SK	App	<1.0	9/9/2025				
1005-1	Room 31	SK	N/A		9/9/2025				Sign
1006-1	Room 32	WF	App		9/9/2025				Removed from service
1006-2	Room 32	SK	N/A		9/9/2025				Sign
1007-1	Girls Bathroom by Room 32 (Left)	SK	App	<1.0	9/9/2025				
1007-2	Girls Bathroom by Room 32 (Right)	SK	App	<1.0	9/9/2025				
1008-1	Custodial Closet by Room 32	SS	N/A		9/9/2025				Sign
1009-1	Room 33	WF	App		9/9/2025				Removed from service
1009-2	Room 33	SK	N/A		9/9/2025				Sign
1010-1	Room 35	WF	App		9/9/2025				Removed from service
1010-2	Room 35	SK	N/A		9/9/2025				Sign
1011-1	Faculty Lounge 38A	SK	N/A		9/9/2025				Sign
1012-1	Room 36	WF	App		9/9/2025				Removed from service
1012-2	Room 36	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1013-1	Room 37	WF	App		9/9/2025				Removed from service
1013-2	Room 37	SK	N/A		9/9/2025				Sign
2001-1	Room 42	WF	App		9/9/2025				Removed from service
2001-2	Room 42	SK	N/A		9/9/2025				Sign
2002-1	Room 41	WF	App		9/9/2025				Removed from service
2002-2	Room 41	SK	N/A		9/9/2025				Sign
2003-1	Room 40	WF	App		9/9/2025				Removed from service
2003-2	Room 40	SK	N/A		9/9/2025				Sign
2004-1	Room 39	WF	App		9/9/2025				Removed from service
2004-2	Room 39	SK	N/A		9/9/2025				Sign
2005-1	Boys Bathroom by Room 38 (Left)	SK	App	<1.0	9/9/2025				
2005-2	Boys Bathroom by Room 38 (Right)	SK	App	<1.0	9/9/2025				
2006-1	Custodial Closet by Room 38	SS	N/A		9/9/2025				Sign
2007-1	Girls Bathroom by Room 38 (Left)	SK	App	2.0	9/9/2025				
2007-2	Girls Bathroom by Room 38 (Right)	SK	App	<1.0	9/9/2025				
2008-1	Room 38	WF	App		9/9/2025				Removed from service
2008-2	Room 38	SK	N/A		9/9/2025				Sign
1014-1	Custodial Closet by Room 29	SS	N/A		9/9/2025				Sign
1015-1	Girls Bathroom by Room 29 (Left)	SK	App	<1.0	9/9/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1015-2	Girls Bathroom by Room 29 (Right)	SK	App	<1.0	9/9/2025				
1016-1	Room 28 Bathroom	SK	N/A		9/9/2025				Sign
1017-1	Room 27B	WF	App		9/9/2025				Removed from service
1017-2	Room 27B	SK	N/A		9/9/2025				Sign
1017-3	Room 27B Bathroom	SK	N/A		9/9/2025				Non functional, sign or sampling required after repair
1018-1	Boys Bathroom by Room 21 (Left)	SK	N/A		9/9/2025				Sign
1018-2	Boys Bathroom by Room 21 (Right)	SK	App	<1.0	9/9/2025				
1019-1	Girls Bathroom by Room 11 (Left)	SK	App	<1.0	9/9/2025				
1019-2	Girls Bathroom by Room 11 (Right)	SK	App	<1.0	9/9/2025				
1019-3	Girls Bathroom by Room 11	SS	N/A		9/9/2025				Sign
1020-1	Faculty Lounge Room 10	SK	N/A		9/9/2025				Sign
1021-1	Boys Bathroom by Room 6	SK	App	<1.0	9/9/2025				
1021-2	Boys Bathroom by Room 6 Custodial Closet	SS	N/A		9/9/2025				Sign
1022-1	Hall by Room 4	WF	App		9/9/2025				Removed from service
1023-1	Nurses Office Bathroom	SK	App	<1.0	9/9/2025				
1024-1	Hall by Nurses Office	WF	App	<1.0	9/9/2025				
1025-1	Girls Bathroom by Room 25 (Left)	SK	App	<1.0	9/9/2025				
1025-2	Girls Bathroom by Room 25 (Right)	SK	App	<1.0	9/9/2025				
1026-1	ESL Room 26 Storage Closet	SK	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1027-1	Portable 3 Bathroom	SK	N/A		9/9/2025				Sign
1028-1	Portable 4 Bathroom	SK	N/A		9/9/2025				Sign
1029-1	Hall by ADA Bathroom	WF	App		9/9/2025				
1029-2	Hall by ADA Bathroom	BF	App		9/9/2025				
1030-1	Hall by Room 4	BF	0	<1.0	9/9/2025				

Laboratory Report

September 15, 2025

Pam Chadderton
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779

Project: Hempstead UFSD; Joseph McNeil ES
Project Address: 335 S Franklin St
Report ID: 250915002
Sample IDs: 250915002-038 - 250915002-062

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	9-Sep-25
Date Received:	15-Sep-25
Date Analyzed:	15-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250915002-038	1	Kitchen 2 Bay - SK; initial	0.001	<0.001	mg/L	
250915002-039	2	Hall by Cafetorium - WF; initial	0.001	<0.001	mg/L	
250915002-040	3	Hall by Cafetorium - BF; initial	0.001	<0.001	mg/L	
250915002-041	4	Hall by ADA Bathroom - WF; initial	0.001	<0.001	mg/L	
250915002-042	5	Hall by ADA Bathroom - BF; initial	0.001	<0.001	mg/L	
250915002-043	6	ADA Accessible Bathroom by Cafetorium - SK; initial	0.001	<0.001	mg/L	
250915002-044	7	Boys Bathroom by Cafetorium (Left) - SK; initial	0.001	<0.001	mg/L	
250915002-045	8	Boys Bathroom by Cafetorium (Right) - SK; initial	0.001	<0.001	mg/L	
250915002-046	9	Girls Bathroom by Room 32 (Left) - SK; initial	0.001	<0.001	mg/L	
250915002-047	10	Girls Bathroom by Room 32 (Right) - SK; initial	0.001	<0.001	mg/L	
250915002-048	11	Boys Bathroom by Room 38 (Left) - SK; initial	0.001	<0.001	mg/L	
250915002-049	12	Boys Bathroom by Room 38 (Right) - SK; initial	0.001	<0.001	mg/L	
250915002-050	13	Girls Bathroom by Room 38 (Left) - SK; initial	0.001	0.002	mg/L	
250915002-051	14	Girls Bathroom by Room 38 (Right) - SK; initial	0.001	<0.001	mg/L	
250915002-052	15	Girls Bathroom by Room 29 (Left) - SK; initial	0.001	<0.001	mg/L	
250915002-053	16	Girls Bathroom by Room 29 (Right) - SK; initial	0.001	<0.001	mg/L	
250915002-054	17	Boys Bathroom by Room 21 (Right) - SK; initial	0.001	<0.001	mg/L	
250915002-055	18	Girls Bathroom by Room 11 (Left) - SK; initial	0.001	<0.001	mg/L	
250915002-056	19	Girls Bathroom by Room 11 (Right) - SK; initial	0.001	<0.001	mg/L	
250915002-057	20	Boys Bathroom by Room 6 - SK; initial	0.001	<0.001	mg/L	
250915002-058	21	Nurses Office Bathroom - SK; initial	0.001	<0.001	mg/L	
250915002-059	22	Hall by Nurses Office - WF; initial	0.001	<0.001	mg/L	
250915002-060	23	Hall by Room 4 - BF; initial	0.001	<0.001	mg/L	
250915002-061	24	Girls Bathroom by Room 25 (Left) - SK; initial	0.001	<0.001	mg/L	
250915002-062	25	Girls Bathroom by Room 25 (Right) - SK; initial	0.001	<0.001	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID



Appendix G

David Paterson Elementary School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Kitchen Handwash	SK	N/A		9/11/2025				Sign
1002-1	Custodial Closet By Room 6	SS	N/A		9/11/2025				Sign
1003-1	Women's Bathroom by Room 6 Left	SK	App	<1.0	9/11/2025				
1003-2	Women's Bathroom by Room 6 Right	SK	App	<1.0	9/11/2025				
1004-1	Hall by Room 6	WF	App		9/11/2025				Non functional, sampling required before returning to service
1005-1	Hall by Room 9	BF	App	<1.0	9/11/2025				
1005-2	Hall by Room 9	WF	App	<1.0	9/11/2025				
1006-1	Boy's Bathroom by Room 10 Left	SK	App	<1.0	9/11/2025				
1006-2	Boy's Bathroom by Room 10 Right	SK	App	<1.0	9/11/2025				
1007-1	Faculty Room Bathroom	SK	App		9/11/2025				Sign
1008-1	Boy's Bathroom by Room 23	SK	App	<1.0	9/11/2025				
1009-1	Girl's Bathroom by Room 23 Left	SK	App	<1.0	9/11/2025				
1009-2	Girl's Bathroom by Room 23 Right	SK	App	<1.0	9/11/2025				
1010-1	Room 21	SK	App		9/11/2025				Sign
1011-1	Room 18	SK	App		9/11/2025				Sign
1012-1	Hall by Room 19	BF	App	<1.0	9/11/2025				
1012-2	Hall by Room 19	WF	App	<1.0	9/11/2025				
1013-1	Room 19	SK	App		9/11/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1014-1	Room 20	SK	App		9/11/2025				Sign
1014-2	Room 20	WF	App		9/11/2025				Removed from service
1015-1	Hall by Room 23	BF	App	<1.0	9/11/2025				
1015-2	Hall by Room 23	WF	App	<1.0	9/11/2025				
1016-1	Men's Bathroom by Room 26 Left	SK	App		9/11/2025				Sign
1016-2	Men's Bathroom by Room 26 Right	SK	App		9/11/2025				Sign
1017-1	Media Center Bathroom	SK	App		9/11/2025				Sign
1018-1	Nurse's Office Bathroom	SK	App	<1.0	9/11/2025				
1019-1	Portable A Bathroom	SK	App	3.0	9/11/2025				
1020-1	Portable B Bathroom	SK	App	<1.0	9/11/2025				
1021-1	Portable D Bathroom	SK	App	<1.0	9/11/2025				
1022-1	Portable C Bathroom	SK	App	2.0	9/11/2025				

Laboratory Report

September 15, 2025

Pam Chadderton
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779

Project: Hempstead UFSD; David Paterson ES
Project Address: 40 Fulton Ave
Report ID: 250915003
Sample IDs: 250915003-081 - 250915003-098

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	11-Sep-25
Date Received:	15-Sep-25
Date Analyzed:	15-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250915003-081	1	Women's Bathroom by Room 6 Left - SK; initial	0.001	<0.001	mg/L	
250915003-082	2	Women's Bathroom by Room 6 Right - SK; initial	0.001	<0.001	mg/L	
250915003-083	3	Hall by Room 9 - BF; initial	0.001	<0.001	mg/L	
250915003-084	4	Hall by Room 9 - WF; initial	0.001	<0.001	mg/L	
250915003-085	5	Boy's Bathroom by Room 10 Left - SK; initial	0.001	<0.001	mg/L	
250915003-086	6	Boy's Bathroom by Room 10 Right - SK; initial	0.001	<0.001	mg/L	
250915003-087	7	Boy's Bathroom by Room 23 - SK; initial	0.001	<0.001	mg/L	
250915003-088	8	Girl's Bathroom by Room 23 Left - SK; initial	0.001	<0.001	mg/L	
250915003-089	9	Girl's Bathroom by Room 23 Right - SK; initial	0.001	<0.001	mg/L	
250915003-090	10	Hall by Room 19 - BF; initial	0.001	<0.001	mg/L	
250915003-091	11	Hall by Room 19 - WF; initial	0.001	<0.001	mg/L	
250915003-092	12	Hall by Room 23 - BF; initial	0.001	<0.001	mg/L	
250915003-093	13	Hall by Room 23 - WF; initial	0.001	<0.001	mg/L	
250915003-094	14	Nurse's Office Bathroom - SK; initial	0.001	<0.001	mg/L	
250915003-095	15	Portable A Bathroom - SK; initial	0.001	0.003	mg/L	
250915003-096	16	Portable B Bathroom - SK; initial	0.001	<0.001	mg/L	
250915003-097	17	Portable D Bathroom - SK; initial	0.001	<0.001	mg/L	
250915003-098	18	Portable C Bathroom - SK; initial	0.001	0.002	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID



Appendix H

Prospect Elementary School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0001-01	Custodial Closet by Elevator	SS	N/A		9/10/2025				Sign
0002-01	Adult Unisex Bathroom by Elevator Left	SK	App		9/10/2025				Sign
0003-01	Unisex Bathroom by Elevator Right	SK	App	<1.0	9/10/2025				Sign
0004-01	Room L8	SK	App		9/10/2025				Sign
0004-02	Room L8	WF	App	5.0	9/10/2025				
0005-01	Hall by Room L8 Left	WF	App	<1.0	9/10/2025				
0005-02	Hall by Room L8 Right	WF	App	1.0	9/10/2025				
0006-01	Room L2	SK	App		9/10/2025				Sign
0006-02	Room L2	WF	App		9/10/2025				Removed from service
0007-01	Room L9	SK	App		9/10/2025				Sign
0007-02	Room L9	WF	App	<1.0	9/10/2025				
0008-01	Custodial Office Break Room Kitchenette	SK	App	<1.0	9/10/2025				
1001-01	Kitchen Handwash	SK	N/A		9/10/2025				Sign
1001-02	Kitchen 3-Bay Left	SK	App		9/10/2025				Sign
1001-03	Kitchen 3-Bay Right	SK	App		9/10/2025				Sign
1001-04	Kitchen Serving Line Handwash	SK	N/A		9/10/2025				Sign
1001-05	Kitchen Serving Line Prep	SK	App	<1.0	9/10/2025				
1002-01	Hall by Room 14 Left	WF	App		9/10/2025				Non-functional, sampling required before returning to service

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1002-02	Hall by Room 14 Right	WF	App		9/10/2025				Non-functional, sampling required before returning to service
1003-01	Custodial Closet by Room 14	SS	N/A		9/10/2025				Sign
1004-01	Room 19	SK	App		9/10/2025				Sign
1004-02	Room 19	WF	App		9/10/2025				Removed from service
1005-01	Room 18	SK	App		9/10/2025				Sign
1005-02	Room 18	WF	App	3.0	9/10/2025				
1006-01	Room 17	SK	App		9/10/2025				Sign
1006-02	Room 17	WF	App	<1.0	9/10/2025				
1007-01	Room 16	SK	App		9/10/2025				Sign
1007-02	Room 16	WF	App	3.0	9/10/2025				
1008-01	Room 15	SK	App		9/10/2025				Sign
1008-02	Room 15	WF	App	<1.0	9/10/2025				
1009-02	Room 14	WF	App	<1.0	9/10/2025				
1010-01	Girl's Bathroom by Cafeteria Left	SK	N/A		9/10/2025				Mixed Valve; Sign
1010-02	Girl's Bathroom by Cafeteria Right	SK	N/A		9/10/2025				Mixed Valve; Sign
1011-01	Boy's Bathroom by Cafeteria Left	SK	N/A		9/10/2025				Mixed Valve; Sign
1011-02	Boy's Bathroom by Cafeteria Right	SK	N/A		9/10/2025				Mixed Valve; Sign
1012-01	Nurse's Office Bathroom	SK	App	<1.0	9/10/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1012-02	Nurse's Office	SK	App	<1.0	9/10/2025				
1013-01	Room 4	SK	App		9/10/2025				Sign
1013-02	Room 4	WF	App	<1.0	9/10/2025				
1014-01	Room 5	SK	App		9/10/2025				Sign
1014-02	Room 5	WF	App	<1.0	9/10/2025				
1015-01	Unisex Bathroom by Room 5	SK	N/A		9/10/2025				
1016-01	Room 3	SK	App		9/10/2025				Sign
1016-02	Room 3	WF	App	2.0	9/10/2025				
1017-01	Principal's Office Bathroom	SK	N/A		9/10/2025				#REF!
1017-02	Girl's Bathroom by Main Office Left	SK	N/A		9/10/2025				Mixed Valve; Sign
1017-03	Girl's Bathroom by Main Office Middle	SK	N/A		9/10/2025				Mixed Valve; Sign
1018-01	Girl's Bathroom by Main Office Right	SK	N/A		9/10/2025				Mixed Valve; Sign
1019-01	Custodial Closet by Main Office	SS	N/A		9/10/2025				Sign
1019-02	Hall by Room 8 Left	WF	App	<1.0	9/10/2025				
1020-01	Hall by Room 8 Right	WF	App	1.0	9/10/2025				
1021-01	Room 8	SK	App		9/10/2025				Sign
1021-02	Room 8	WF	App	1.0	9/10/2025				
1022-01	Room 13	SK	App		9/10/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1022-02	Room 13	WF	App	<1.0	9/10/2025				
1023-01	Room 12	SK	App		9/10/2025				Sign
1023-02	Room 12	WF	App	2.0	9/10/2025				
1024-01	Faculty Room 9	SK	App	<1.0	9/10/2025				
1025-01	Men's Bathroom by Faculty Room 9	SK	N/A		9/10/2025				Mixed Valve; Sign
1026-01	Room 10	SK	App		9/10/2025				Sign
1026-02	Room 10	WF	App	<1.0	9/10/2025				
1027-01	Room 11	SK	App		9/10/2025				Sign
1027-02	Room 11	WF	App	<1.0	9/10/2025				
2001-01	Room 27	SK	App		9/10/2025				Sign
2001-02	Room 27	WF	App	3.0	9/10/2025				
2002-01	Room 26	SK	App		9/10/2025				Sign
2002-02	Room 26	WF	App	<1.0	9/10/2025				
2003-01	Unisex Bathroom by Room 26	SK	App		9/10/2025				Mixed Valve; Sign
2004-01	Room 28	SK	App		9/10/2025				Sign
2004-02	Room 28	WF	App	1.0	9/10/2025				
2005-01	Room 24	SK	App		9/10/2025				Sign
2005-02	Room 24	WF	App		9/10/2025				Removed from service

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2006-01	Room 31	SK	App		9/10/2025				Sign
2006-02	Room 31	WF	App		9/10/2025				Removed from service
2007-01	Boy's Bathroom by Room 31 Left	SK	N/A		9/10/2025				Mixed Valve; Sign
2007-02	Boy's Bathroom by Room 31 Middle	SK	N/A		9/10/2025				Mixed Valve; Sign
2007-03	Boy's Bathroom by Room 31 Right	SK	N/A		9/10/2025				Mixed Valve; Sign
2008-01	Custodial Closet by Room 22	SS	N/A		9/10/2025				Sign
2009-01	Hall by Room 22 Left	WF	App	<1.0	9/10/2025				
2009-02	Hall by Room 22 Right	WF	App	<1.0	9/10/2025				
2010-01	Room 22	SK	App		9/10/2025				Sign
2010-02	Room 22	WF	App	1.0	9/10/2025				
2011-01	Room 32	SK	App		9/10/2025				Sign
2011-02	Room 32	WF	App		9/10/2025				
2012-01	Room 33	SK	App		9/10/2025				Sign
2012-02	Room 33	WF	App	<1.0	9/10/2025				
2013-01	Men's Bathroom by Office 21	SK	App		9/10/2025				Sign
2014-01	Room 34	SK	App		9/10/2025				Sign
2014-02	Room 34	WF	App	<1.0	9/10/2025				
2015-01	Room 20	SK	App		9/10/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2015-02	Room 20	WF	App	<1.0	9/10/2025				

Laboratory Report

September 15, 2025

Pam Chadderton
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779


Project: Hempstead UFSD - Prospect Elementary School
Project Address: 265 Peninsula Blvd, Hempstead, NY 11550
Report ID: 250911007
Sample IDs: 250911007-661 - 250911007-694

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	10-Sep-25
Date Received:	11-Sep-25
Date Analyzed:	12-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250911007-661	1	Kitchen Serving Line Prep - SK; initial	0.001	<0.001	mg/L	
250911007-662	2	Room 18 - WF; initial	0.001	0.003	mg/L	
250911007-663	3	Room 17 - WF; initial	0.001	<0.001	mg/L	
250911007-664	4	Room 16 - WF; initial	0.001	0.003	mg/L	
250911007-665	5	Room 15 - WF; initial	0.001	<0.001	mg/L	
250911007-666	6	Room 14 - WF; initial	0.001	<0.001	mg/L	
250911007-667	7	Nurse's Office Bathroom - SK; initial	0.001	<0.001	mg/L	
250911007-668	8	Nurse's Office - SK; initial	0.001	<0.001	mg/L	
250911007-669	9	Room 4 - WF; initial	0.001	<0.001	mg/L	
250911007-670	10	Room 5 - WF; initial	0.001	<0.001	mg/L	
250911007-671	11	Room 3 - WF; initial	0.001	0.002	mg/L	
250911007-672	12	Hall by Room 8 Left - WF; initial	0.001	<0.001	mg/L	
250911007-673	13	Hall by Room 8 Right - WF; initial	0.001	0.001	mg/L	
250911007-674	14	Room 8 - WF; initial	0.001	0.001	mg/L	
250911007-675	15	Room 13 - WF; initial	0.001	<0.001	mg/L	
250911007-676	16	Room 12 - WF; initial	0.001	0.002	mg/L	
250911007-677	17	Faculty Room 9 - SK; initial	0.001	<0.001	mg/L	
250911007-678	18	Room 10 - WF; initial	0.001	<0.001	mg/L	
250911007-679	19	Room 11 - WF; initial	0.001	<0.001	mg/L	
250911007-680	20	Room 27 - WF; initial	0.001	0.003	mg/L	
250911007-681	21	Room 26 - WF; initial	0.001	<0.001	mg/L	
250911007-682	22	Room 28 - WF; initial	0.001	0.001	mg/L	
250911007-683	23	Hall by Room 22 Left - WF; initial	0.001	<0.001	mg/L	
250911007-684	24	Hall by Room 22 Right - WF; initial	0.001	<0.001	mg/L	
250911007-685	25	Room 22 - WF; initial	0.001	0.001	mg/L	
250911007-686	26	Room 33 - WF; initial	0.001	<0.001	mg/L	
250911007-687	27	Room 34 - WF; initial	0.001	<0.001	mg/L	
250911007-688	28	Room 20 - WF; initial	0.001	<0.001	mg/L	
250911007-689	29	Unisex Bathroom by Elevator Right - SK; initial	0.001	<0.001	mg/L	
250911007-690	30	Hall by Room L8 Left - WF; initial	0.001	<0.001	mg/L	
250911007-691	31	Hall by Room L8 Right - WF; initial	0.001	0.001	mg/L	
250911007-692	32	Room L8 - WF; initial	0.001	0.005	mg/L	
250911007-693	33	Room L9 - WF; initial	0.001	<0.001	mg/L	
250911007-694	34	Custodial Office Break Room Kitchenette - SK; initial	0.001	<0.001	mg/L	



Date Collected:	10-Sep-25
Date Received:	11-Sep-25
Date Analyzed:	12-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
--------	-----	-----------------------------	-----	--------	-------	------

Comment(s):

LOQ: Limit of Quantitation
CID: Client ID



Appendix I

Rhodes Academy Elementary School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Room 116	SK	App		9/10/2025				Sign
1001-2	Room 116	WF	App		9/10/2025				Non-functional, sampling required before returning to service
1001-3	Room 116 Bathroom	SK	N/A		9/10/2025				Non-functional, sampling or sign required before returning to service
1002-1	General Music 117	SK	App		9/10/2025				Sign
1002-2	General Music 117	WF	App		9/10/2025				Non-functional, sampling required before returning to service
1002-3	General Music 117 Bathroom	SK	N/A		9/10/2025				
1003-1	Instrument Storage Room 120	SK	App	<1.0	9/10/2025				
1004-1	Cafeteria - Left	WF	App	<1.0	9/10/2025				
1004-2	Cafeteria - Right	WF	App	<1.0	9/10/2025				
1004-3	Cafeteria - Right	BF	App	<1.0	9/10/2025				
1004-4	Cafeteria Left Bathroom	SK	N/A		9/10/2025				Sign
1004-5	Cafeteria Right Bathroom	SK	N/A		9/10/2025				Sign
1005-1	Serving Line 123A	IM	App		9/10/2025				Non-functional, sampling required before returning to service
1005-2	Serving Line 123A Prep	SK	App	<1.0	9/10/2025				
1005-3	Serving Line 123A Handwash	SK	N/A		9/10/2025				Sign
1006-1	Kitchen Dishwash 3-Bay @ A	SK	N/A		9/10/2025				Sign
1006-2	Kitchen Dishwash 3-Bay @ B	SK	N/A		9/10/2025				Sign
1006-3	Kitchen Dishwash 3-Bay @ B	SPY	N/A		9/10/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1006-4	Kitchen Handwash @ A	SK	N/A		9/10/2025				Sign
1006-5	Kitchen Island Handwash @ B	SK	N/A		9/10/2025				Sign
1006-6	Kitchen Island 2-Bay	SK	App	<1.0	9/10/2025				
1006-7	Kitchen Island 2-Bay	SPY	App	<1.0	9/10/2025				Sign
1006-8	Kitchen Gender Neutral Bathroom	SK	N/A		9/10/2025				
1007-1	Custodial Receiving Room 124 Bathroom	SK	N/A		9/10/2025				Sign
1008-1	Hall by Gymnasium 125 - Left	WF	App	<1.0	9/10/2025				
1008-2	Hall by Gymnasium 125 - Right	WF	App	<1.0	9/10/2025				
1008-3	Hall by Gymnasium 125 - Right	BF	App		9/10/2025				Non-functional, sampling required before returning to service
1009-1	Custodial Closet 126	SS	N/A		9/10/2025				Sign
1010-1	Girl's Bathroom by Room 119 @ A	SK	N/A		9/10/2025				Mixed Valve; Sign
1010-2	Girl's Bathroom by Room 119 @ B	SK	N/A		9/10/2025				Mixed Valve; Sign
1011-1	Gender Neutral Bathroom by Room 119	SK	N/A		9/10/2025				Mixed Valve; Sign
1012-1	Boy's Bathroom by Room 119 @ A	SK	N/A		9/10/2025				Mixed Valve; Sign
1012-2	Boy's Bathroom by Room 119 @ B	SK	N/A		9/10/2025				Mixed Valve; Sign
1012-3	Boy's Bathroom by Room 119 @ C	SK	N/A		9/10/2025				Mixed Valve; Sign
1013-1	Nurse's Office	SK	App	<1.0	9/10/2025				
1013-2	Nurse's Office Staff Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1013-3	Nurse's Office Student Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
1014-1	Main Office Gender Neutral Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
1014-2	Main Office Break Room	SK	App	<1.0	9/10/2025				
1014-3	Main Office Principal's Office Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
1015-1	Room 101	SK	App		9/10/2025				Sign
1015-2	Room 101	WF	App	<1.0	9/10/2025				
1015-3	Room 101 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
1016-1	Room 102	SK	App		9/10/2025				Sign
1016-2	Room 102	WF	App	6.0	9/10/2025				Capped
1016-3	Room 102 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
1017-1	Faculty Break Room 105	SK	App	2.0	9/10/2025				
1018-1	Room 106	SK	App		9/10/2025				Sign
1018-2	Room 106	WF	App	<1.0	9/10/2025				
1018-3	Room 106 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
1019-1	Hall by Room 106 - Left	WF	App		9/10/2025				Sign
1019-2	Hall by Room 106 - Right	WF	App	<1.0	9/10/2025				
1019-3	Hall by Room 106 - Right	BF	App	<1.0	9/10/2025				
1020-1	Gender Neutral Bathroom by Room 106	SK	N/A		9/10/2025				Mixed Valve; Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1021-1	Room 108	SK	App		9/10/2025				Sign
1021-2	Room 108	WF	App	<1.0	9/10/2025				
1021-3	Room 108 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
1022-1	Room 109	SK	App		9/10/2025				Sign
1022-2	Room 109	WF	App	<1.0	9/10/2025				
1022-3	Room 109 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
1023-1	Room 112	SK	App		9/10/2025				Sign
1023-2	Room 112	WF	App	<1.0	9/10/2025				
1023-3	Room 112 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
1024-1	Room 113	SK	App		9/10/2025				Sign
1024-2	Room 113	WF	App	<1.0	9/10/2025				
1024-3	Room 113 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
2001-1	Room 217	SK	App		9/10/2025				Sign
2001-2	Room 217	WF	App	<1.0	9/10/2025				
2001-3	Room 217 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
2002-1	Room 218	SK	App		9/10/2025				Sign
2002-2	Room 218	WF	App	<1.0	9/10/2025				
2002-3	Room 218 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2003-1	Room 220	SK	App		9/10/2025				Sign
2003-2	Room 220	WF	App	3.0	9/10/2025				
2004-1	Room 223	SK	App		9/10/2025				Sign
2004-2	Room 223	WF	App	1.0	9/10/2025				
2005-1	Room 224	SK	App		9/10/2025				Sign
2005-2	Room 224	WF	App	<1.0	9/10/2025				
2006-1	Room 226	SK	App		9/10/2025				Sign
2006-2	Room 226	WF	App	10.0	9/10/2025				Capped
2007-1	Girl's Bathroom by Room 215 @ A	SK	N/A		9/10/2025				Mixed Valve; Sign
2007-2	Girl's Bathroom by Room 215 @ B	SK	N/A		9/10/2025				Mixed Valve; Sign
2007-3	Girl's Bathroom by Room 215 @ C	SK	N/A		9/10/2025				Mixed Valve; Sign
2008-1	Boy's Bathroom by Room 215 @ A	SK	N/A		9/10/2025				Mixed Valve; Sign
2008-2	Boy's Bathroom by Room 215 @ B	SK	N/A		9/10/2025				Mixed Valve; Sign
2008-3	Boy's Bathroom by Room 215 @ C	SK	N/A		9/10/2025				Mixed Valve; Sign
2009-1	Art Room 201	SK	App		9/10/2025				Sign
2009-2	Art Room 201	WF	App		9/10/2025				Sign
2009-3	Art Room 201 Unit - Left	SK	App		9/10/2025				Sign
2009-4	Art Room 201 Unit - Center	SK	App		9/10/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2009-5	Art Room 201 Unit - Right	SK	App		9/10/2025				Sign
2010-1	Room 202	SK	App		9/10/2025				Sign
2010-2	Room 202	WF	App	<1.0	9/10/2025				
2011-1	Room 203	SK	App		9/10/2025				Sign
2011-2	Room 203	WF	App	4.0	9/10/2025				
2012-1	Room 204	SK	App		9/10/2025				Sign
2012-2	Room 204	WF	App	3.0	9/10/2025				
2013-1	Room 205	SK	App		9/10/2025				Sign
2013-2	Room 205	WF	App	<1.0	9/10/2025				
2014-1	Room 207	SK	App		9/10/2025				Sign
2014-2	Room 207	WF	App	<1.0	9/10/2025				
2014-3	Room 207 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
2015-1	Hall by Room 207 - Left	WF	App	<1.0	9/10/2025				
2015-2	Hall by Room 207 - Right	WF	App	<1.0	9/10/2025				
2015-3	Hall by Room 207 - Right	BF	App	<1.0	9/10/2025				
2016-1	Gender Neutral Bathroom by Room 207	SK	N/A		9/10/2025				Mixed Valve; Sign
2017-1	Room 209	SK	App		9/10/2025				Sign
2017-2	Room 209	WF	App	<1.0	9/10/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2017-3	Room 209 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
2018-1	Room 210	SK	App		9/10/2025				Sign
2018-2	Room 210	WF	App		9/10/2025				Sign
2018-3	Room 210 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
2019-1	Room 213	SK	App		9/10/2025				Sign
2019-2	Room 213	WF	App	<1.0	9/10/2025				
2019-3	Room 213 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
2020-1	Room 214	SK	App		9/10/2025				Sign
2020-2	Room 214	WF	App	1.0	9/10/2025				
2020-3	Room 214 Bathroom	SK	N/A		9/10/2025				Mixed Valve; Sign
2021-1	Custodial Closet 215	SS	N/A		9/10/2025				Sign
3001-1	Room 314	SK	App		9/10/2025				Sign
3002-1	Room 315	SK	App		9/10/2025				Sign
3003-1	Room 316	SK	App		9/10/2025				Sign
3004-1	Faculty Break Room 317	SK	App	<1.0	9/10/2025				
3005-1	Gender Neutral Bathroom by Room 319	SK	N/A		9/10/2025				Mixed Valve; Sign
3006-1	Room 320	SK	App		9/10/2025				Sign
3007-1	Room 322	SK	App		9/10/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
3009-1	Girl's Bathroom by Room 313 @ A	SK	N/A		9/10/2025				Mixed Valve; Sign
3009-2	Girl's Bathroom by Room 313 @ B	SK	N/A		9/10/2025				Mixed Valve; Sign
3009-3	Girl's Bathroom by Room 313 @ C	SK	N/A		9/10/2025				Mixed Valve; Sign
3010-1	Boy's Bathroom by Room 313 @ A	SK	N/A		9/10/2025				Mixed Valve; Sign
3010-2	Boy's Bathroom by Room 313 @ B	SK	N/A		9/10/2025				Mixed Valve; Sign
3010-3	Boy's Bathroom by Room 313 @ C	SK	N/A		9/10/2025				Mixed Valve; Sign
3011-1	Room 301	SK	App		9/10/2025				Sign
3012-1	Room 302	SK	App		9/10/2025				Sign
3013-1	Room 303	SK	App		9/10/2025				Sign
3014-1	Room 304	SK	App		9/10/2025				Sign
3015-1	Room 305	SK	App	<1.0	9/10/2025				Sign
3015-2	Room 305	WF	App		9/10/2025				
3016-1	Room 307A	SK	App		9/10/2025				Sign
3017-1	Room 308	SK	App		9/10/2025				Sign
3018-1	Room 309A	SK	App		9/10/2025				Sign
3019-1	Room 310	SK	App		9/10/2025				Sign
3020-1	Hall by Room 312 - Left	WF	App	<1.0	9/10/2025				
3020-2	Hall by Room 312 - Right	WF	App	<1.0	9/10/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
3020-3	Hall by Room 312 - Right	BF	App	<1.0	9/10/2025				
3021-1	Custodial Closet 311	SS	N/A		9/10/2025				Sign

Laboratory Report

September 15, 2025

Pam Chadderton
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779

Project: Hempstead UFSD - Rhodes Academy Elementary School
Project Address: 270 Washington St
Report ID: 250911008
Sample IDs: 250911008-731 - 250911008-766

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	10-Sep-25
Date Received:	11-Sep-25
Date Analyzed:	12-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250911008-731	1	Instrument Storage Room 120 - SK; initial	0.001	<0.001	mg/L	
250911008-732	2	Hall by Gymnasium 125 - Left - WF; initial	0.001	<0.001	mg/L	
250911008-733	3	Hall by Gymnasium 125 - Right - WF; initial	0.001	<0.001	mg/L	
250911008-734	4	Cafeteria - Left - WF; initial	0.001	<0.001	mg/L	
250911008-735	5	Cafeteria - Right - WF; initial	0.001	<0.001	mg/L	
250911008-736	6	Cafeteria - Right - BF; initial	0.001	<0.001	mg/L	
250911008-737	7	Room 101 - WF; initial	0.001	<0.001	mg/L	
250911008-738	8	Room 102 - WF; initial	0.001	0.006	mg/L	H
250911008-739	9	Room 106 - WF; initial	0.001	<0.001	mg/L	
250911008-740	10	Hall by Room 106 - Right - WF; initial	0.001	<0.001	mg/L	
250911008-741	11	Hall by Room 106 - Right - BF; initial	0.001	<0.001	mg/L	
250911008-742	12	Room 108 - WF; initial	0.001	<0.001	mg/L	
250911008-743	13	Room 109 - WF; initial	0.001	<0.001	mg/L	
250911008-744	14	Room 112 - WF; initial	0.001	<0.001	mg/L	
250911008-745	15	Room 113 - WF; initial	0.001	<0.001	mg/L	
250911008-746	16	Room 217 - WF; initial	0.001	<0.001	mg/L	
250911008-747	17	Room 218 - WF; initial	0.001	<0.001	mg/L	
250911008-748	18	Room 220 - WF; initial	0.001	0.003	mg/L	
250911008-749	19	Room 223 - WF; initial	0.001	0.001	mg/L	
250911008-750	20	Room 224 - WF; initial	0.001	<0.001	mg/L	
250911008-751	21	Room 226 - WF; initial	0.001	0.01	mg/L	H
250911008-752	22	Room 202 - WF; initial	0.001	<0.001	mg/L	
250911008-753	23	Room 203 - WF; initial	0.001	0.004	mg/L	
250911008-754	24	Room 204 - WF; initial	0.001	0.003	mg/L	
250911008-755	25	Room 205 - WF; initial	0.001	<0.001	mg/L	
250911008-756	26	Room 207 - WF; initial	0.001	<0.001	mg/L	
250911008-757	27	Hall by Room 207 - Left - WF; initial	0.001	<0.001	mg/L	
250911008-758	28	Hall by Room 207 - Right - WF; initial	0.001	<0.001	mg/L	
250911008-759	29	Hall by Room 207 - Right - BF; initial	0.001	<0.001	mg/L	
250911008-760	30	Room 209 - WF; initial	0.001	<0.001	mg/L	
250911008-761	31	Room 213 - WF; initial	0.001	<0.001	mg/L	
250911008-762	32	Room 214 - WF; initial	0.001	0.001	mg/L	
250911008-763	33	Room 305 - WF; initial	0.001	<0.001	mg/L	
250911008-764	34	Hall by Room 312 - Left - WF; initial	0.001	<0.001	mg/L	



Date Collected:	10-Sep-25
Date Received:	11-Sep-25
Date Analyzed:	12-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250911008-765	35	Hall by Room 312 - Right - WF; initial	0.001	<0.001	mg/L	
250911008-766	36	Hall by Room 312 - Right - BF; initial	0.001	<0.001	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

September 12, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779


Project: Hempstead UFSD
Project Address: Rhodes Academy Elementary School
Report ID: 250911004
Sample IDs: 250911004-472 - 250911004-478

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	10-Sep-25
Date Received:	11-Sep-25
Date Analyzed:	12-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250911004-472	1	Kitchen Island 2-Bay; initial	0.001	<0.001	mg/L	
250911004-473	2	Kitchen Island 2-Bay; initial	0.001	<0.001	mg/L	
250911004-474	3	Serving Line 123A Prep; initial	0.001	<0.001	mg/L	
250911004-475	4	Nurse's Office; initial	0.001	<0.001	mg/L	
250911004-476	5	Main Office Bathroomeak Room; initial	0.001	<0.001	mg/L	
250911004-477	6	Faculty Room 317; initial	0.001	<0.001	mg/L	
250911004-478	7	Faculty Room 105; initial	0.001	0.002	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID



Appendix J

Marshall Pre-Kindergarten School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Barn Building-Kitchen-Single Unit	SK	App	<1.0	9/9/2025				-
1002-1	Barn Building Bathroom	SK	N/A		9/9/2025				Sign
1003-1	Portable 10 Bathroom	SK	N/A		9/9/2025				Sign
1004-1	Portable 9 Bathroom	SK	N/A		9/9/2025				Sign
1005-1	Portable 8 Bathroom	SK	N/A		9/9/2025				Sign
1006-1	Portable 6 Bathroom	SK	N/A		9/9/2025				Sign
1007-1	Portable 5 Bathroom	SK	N/A		9/9/2025				Sign
1008-1	Portable 7 Bathroom	SK	N/A		9/9/2025				Sign
1009-1	Portable 11 Bathroom	SK	N/A		9/9/2025				Sign
1010-1	Portable 12 Bathroom	SK	N/A		9/9/2025				Sign
1011-1	Room 3	SK	N/A		9/9/2025				Sign
1011-2	Room 3	WF	App		9/9/2025				Removed from Service
1012-1	Room 2	SK	N/A		9/9/2025				Sign
1012-2	Room 2	WF	App		9/9/2025				Removed from Service
1013-1	Hallway by Room 2	BF	App	<1.0	9/9/2025				-
1013-2	Hallway by Room 2	WF	App	<1.0	9/9/2025				-
1014-1	Boy's Bathroom by Room 2	SK	App	<1.0	9/9/2025				-
1015-1	Custodial Closet by Room 2	SS	N/A		9/9/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1016-1	Girl's Bathroom by Room 1	SK	App	<1.0	9/9/2025				-
1017-1	Room 1	SK	N/A		9/9/2025				Sign
1017-2	Room 1	WF	App		9/9/2025				Removed from Service
1018-1	Basement Boiler Room	SS	N/A		9/9/2025				Sign
1019-1	Principal's Office Bathroom	SK	N/A		9/9/2025				Sign
1020-1	Unisex Bathroom by Main Office	SK	N/A		9/9/2025				Sign
1021-1	Library Bathroom	SK	N/A		9/9/2025				Sign
1022-1	Nurse's Office	SK	App	<1.0	9/9/2025				-
1023-1	Room 4	SK	N/A		9/9/2025				Sign

Laboratory Report

September 16, 2025

Pam Chadderton
Enviroscience Consultants, Inc.
2150 Smithtown Ave.
Ronkonkoma, NY, 11779


Project: Hempstead UFSD
Project Address: Marshall Pre-Kindergarten School
Report ID: 250915001
Sample IDs: 250915001-007 - 250915001-012

New York Environmental is a NELAC accredited laboratory. Attached reported results meet the requirements of the NELAC standard unless otherwise noted.

Samples' analytical results relate only to the parameters tested for the samples received in the condition received by the laboratory, as noted on the Chain of Custody. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	12-Sep-25
Date Received:	15-Sep-25
Date Analyzed:	15-Sep-25

Analytical Method:	EPA 200.9
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250915001-007	1	Hallway by Room 2 - BF; initial	0.001	<0.001	mg/L	
250915001-008	2	Hallway by Room 2 - WF; initial	0.001	<0.001	mg/L	
250915001-009	3	Boy's Bathroom by Room 2 - SK; initial	0.001	<0.001	mg/L	
250915001-010	4	Girl's Bathroom by Room 1 - SK; initial	0.001	<0.001	mg/L	
250915001-011	5	Nurse's Office - SK; initial	0.001	0.001	mg/L	
250915001-012	6	Barn Building-Kitchen-Single Unit - SK; initial	0.001	<0.001	mg/L	

Comment(s):

LOQ: Limit of Quantitation

CID: Client ID

