



Department of Purchasing

100 N. Main Street, 2nd Floor
Suffolk, VA 23434
(757) 925-6762 Fax (757) 925-6763

MAY 19 21 PM 9:23
Poster

May 19, 2021

To All Interested Parties:

**Subject: Addendum #1,
Request for Proposals- Fire Suppression Systems Inspections, Testing and
Maintenance**

INFORMATION:

Suffolk Public Schools has received several requests for lists of systems and recent inspection reports. To meet both requests, the inspection reports for the Kitchen hoods are attached. They have been redacted to protect the pricing structure. The sprinkler system reports will follow in a separate addendum.


TIME EXTENSION:

In order to allow proposers to have time with this new information, proposals will be due on or before 2:00 on Friday, June 4, 2021.

SITE VISITS:

Reminder, that site visits may be coordinated by calling Vernon Jackson at 757-934-6206 or emailing him at vernonjackson@spsk12.net

Sent by:

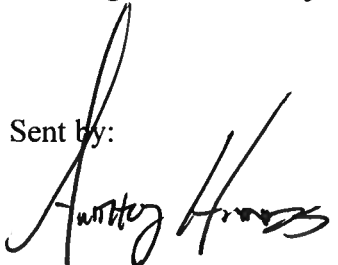

Anthony W. Hinds CPPB
Purchasing Manager



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-760-5649

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Richmond, VA
804-447-2900
FAX 804-447-2866

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762111

CUSTOMER'S NAME/ADDRESS		CUST. ACC. NO.	CUST/PURCHASE ORDER #	DATE OF CALL		
COLLEGE AND CAREER ACADEMY 4169 PRUDEN BLVD -KIT SUFFOLK, VA 23434		0320032				
TELE NO.: 757-925-5789 (C) 757-925-5254		PERSON TO SEE	TERMS	CONTRACT	CALL IN	AUTO
		LAWRENCE WHITING				


SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (KIDDE 400/260) (JAN)

I-KIDD SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	400/260	PRE-ENG. SYS. SERVICE - Kidde WHDR		[REDACTED]
		PRE-ENG SYS. SERVICE		
2	G360ML	FUSIBLE LINKS CHANGED - 360° ML 21		[REDACTED]
3	G500ML	- 500° ML 21		[REDACTED]
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

7/2/2021

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

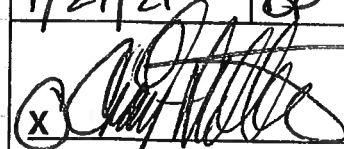BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL	[REDACTED]
	ATTN: BRIAN WILLIAMS	1/27/21	[Signature]	TAX EXEMPT	[REDACTED]
	119 FOREST GLEN DRIVE			TOTAL	[REDACTED]
	SUFFOLK, VA 23434	 PRINT SIGNATURE		SIGN SIGNATURE	

ORIGINAL

18000 WW



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2886

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	College and Career Academy
Address:	4169 Proden Blvd.
City:	Suffolk
State:	VA Zip: 2343A
Phone:	757-925-5789
Contact:	Lawrence
Account#	0320832

System Information	
System Location:	Culinary Arts Kitchen
Manufacturer:	Kidde Model: WHDP-400/260
Nozzles:	#Appl. - 9 #Boiler - 1
	#Duct - 6 #Plenum - 2 (13'x2)
Total Flows:	Cylinder Dates: 2018x2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input checked="" type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Flatgrill	24"	G	1	ADP	6. Smoker		G	1	ADP
2. _____			2	F	7. Chargrill	36"	G	1	ADP
3. Fryer	14"	G/E	1	F	8. Salamander	30"	G		ADP
4. Range	36"	G	2	R	9. _____				
5. Range	36"	G	1	R	10. _____				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure gauge indicator, discharge indicators. - gauges in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 232 oz. ___ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (2) 360° / (3) 560° MC 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition. -ok	/		
18) Re-Install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. -on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:

- System inspected, tagged, returned to operation

Service Tech: *EP* Date: *1/20/21* Time in: Time out:

Customer Authorized Agent: *(Signature)* Print: X



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719

Richmond, VA
804-447-2900
FAX 804-447-2866

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762096

CUSTOMER'S NAME/ADDRESS		CUST. ACC. NO.	CUST/PURCHASE ORDER #		DATE OF CALL		
CREEKSIDE ELEMENTARY 1000 BENNETTS CREEK PARK - KIT SUFFOLK, VA 23434		0314980					
TELE NO.: 757-923-4251 (C) 757-925-5789		PERSON TO SEE	TERMS	CONTRACT	CALL IN	AUTO	
		LAWRENCE WHITING					

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL 6 GAL) (JAN)

I-ANSUL SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	Legal	PRE-ENG. SYS. SERVICE - Ansul R-102		
		PRE-ENG SYS. SERVICE		
6	3360ML	FUSIBLE LINKS CHANGED - 360° ML 21		
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL
	ATTN: BRIAN WILLIAMS	1/28/21	OP	TAX EXEMPT
	119 FOREST GLEN DRIVE			TOTAL
	SUFFOLK, VA 23434			

PRINT SIGNATURE

SIGN SIGNATURE

ORIGINAL



HANOVER, MD
410-768-2200/800-986-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Creekside Elementary
Address:	1000 Bennetts Creek Park
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-923-4251
Contact:	Lawrence
Account#	0314980

System Information	
System Location:	Kitchen (End Cabinet)
Manufacturer:	Ansul Model: R-102 6gal
Nozzles:	#Appl. - 5 #Broller - N/A
	#Duct - 2 #Plenum - 4 (11'x2)
Total Flows:	20 Cylinder Dates: 2018 x 2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input checked="" type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Tilt Skillet	24"	G/E	2	230	6.				
2. Range	18"	G	1	245	7.				
3.			2	3N	8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators.	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 61 oz. ___ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (6) 360°ML 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition. -ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. -on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:
- system inspected, tagged, returned to operation

Service Tech: *EP* Date: 1/28/21 Time in: Time out:

Customer Authorized Agent: *(X) [Signature]* Print: X



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4606

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719

Richmond, VA
804-447-2900
FAX 804-447-2866

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762097

CUSTOMER'S NAME/ADDRESS		CUST. ACC. NO.	CUST/PURCHASE ORDER #		DATE OF CALL	
ELEPHANT'S FORK ELEMENTARY 2316 WILLIAM REID DR. - KIT SUFFOLK, VA 23434		0314982				
TELE NO.: 757-923-5250 (C) 757-925-5709		PERSON TO SEE	TERMS	CONTRACT	CALL IN	AUTO
		LAWRENCE WHITING				

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL 3 GAL) (JAN)

1-ANSUL SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	3gal	PRE-ENG. SYS. SERVICE - Ansul R-102	77	[REDACTED]
		PRE-ENG SYS. SERVICE		
5	3360ML	FUSIBLE LINKS CHANGED - 360°ML 21		[REDACTED]
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL [REDACTED]
	ATTN: BRIAN WILLIAMS	1/26/21	[Signature]	TAX EXEMPT [REDACTED]
	119 FOREST GLEN DRIVE			TOTAL [REDACTED]

SUFFOLK, VA 23434

Holly Martie
PRINT SIGNATURE

[Signature]
SIGN SIGNATURE

ORIGINAL

18000 WW



HANOVER, MD
410-768-2200/800-986-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4808

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2868

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Elephant's Fork Elementary
Address:	2316 William Reid Dr.
City:	Suffolk
State:	VA
Zip:	23434
Phone:	757-923-5250
Contact:	Lawrence
Account#	0314982

System Information	
System Location:	Kitchen Pantry
Manufacturer:	Ansul
Model:	R-102 3gal
Nozzles:	#Appl. - 1 #Broiler - N/A
	#Duct - 2 #Plenum - 4 (12'6" x 2)
Total Flows:	8
Cylinder Dates:	2012
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input checked="" type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input type="checkbox"/> Monitored Bldng. Alarm	<input checked="" type="checkbox"/> Local Bldng Alarm (H/S) <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Range	18"	G	1	245	6.				
2.					7.				
3.					8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators.	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 43 oz. ___ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (5) 360°ML	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition. - ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/21 Johnson Controls	/		

Comments and Deficiencies:

-system inspected, tagged, returned to operation

Service Tech: *BP*

Date: 1/26/21

Time in:

Time out:

Customer Authorized Agent (X)

Holly Martic

Print: X

Holly Martic



Corporate Headquarters
Hanover, MD
410-788-2200/800-966-2212
FAX 410-768-5649

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Richmond, VA
804-447-2900
FAX 804-447-2866

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762098

CUSTOMER'S NAME/ADDRESS		CUST. ACC. NO.	CUST/PURCHASE ORDER #		DATE OF CALL	
HILLPOINT ELEMENTARY 1101 HILLPOINT ROAD - KIT SUFFOLK, VA 23434		0314984				
TELE NO.: 757-923-5252 (C) 757-925-5789		PERSON TO SEE	TERMS	CONTRACT	CALL #	AUTO
		LAWRENCE WHITING				

SPECIAL INSTRUCTIONS: SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL 6 GAL) (JAN)
1-ANSU SEMI-ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	Legal	PRE-ENG. SYS. SERVICE - Ansul R-102		[REDACTED]
		PRE-ENG SYS. SERVICE		
4	GS COME	FUSIBLE LINKS CHANGED - 500°MC 21		[REDACTED]
		FIRE ALARM SYSTEM SERVICE		
		* Red Tagged - cylinders ^{past} due for Hydrotest		
		CLEAN AGENT SYSTEM SERVICE (Sent quote 2x) AG		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL	[REDACTED]
	ATTN: BRIAN WILLIAMS	1/27/21	of	TAX EXEMPT	[REDACTED]
	119 FOREST GLEN DRIVE SUFFOLK, VA 23434			TOTAL	[REDACTED]

[Signature]
PRINT SIGNATURE

[Signature]
SIGN SIGNATURE

ORIGINAL

18000 WWM 00081



HANOVER, MD
410-768-2200/800-986-2212
FAX 410-768-5849

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4808

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Hillpoint Elementary
Address:	1101 Hillpoint Rd.
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-923-5252
Contact:	Lawrence
Account#	0314984

System Information	
System Location:	Kitchen (End Cabinet)
Manufacturer:	Ansul Model: R-102 6gal
Nozzles:	#Appl. - 6 #Broiler - N/A #Duct - 2 #Plenum - 4 (11'x2)
Total Flows:	18 Cylinder Dates: 2008 x 2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input checked="" type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Range	18"	G	2	1N	6.				
2. Tilt Skillet	24"	G/E	4	230	7.				
3.					8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators.	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 112 oz. ___ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (4) 500° ML 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition. - ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:

- system inspected, ~~tags~~ non-compliant, returned to operation
* cylinders past due for Hydrotest *

Service Tech: Date: 1/27/21 Time in: Time out:

Customer Authorized Agent Linda Williams Print: X Linda Williams



- Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649
- Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806
- York, PA
717-741-9980/866-922-2373
FAX 717-741-9981
- Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719
- Richmond, VA
804-447-2900
FAX 804-447-2866
- Laurinburg, NC
910-276-1112
FAX 910-276-5811
- Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176
- Wilmington, NC
910-762-5410/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762105

CUSTOMER'S NAME/ADDRESS	CUST. ACC. NO.	CUST/PURCHASE ORDER #	DATE OF CALL		
JOHN YEATES MIDDLE 4901 BENNETT'S PASTURE RD. -KIT SOFFOLK, VA 23434	0314993				
TELE NO.: 757-923-4105 (C) 757-925-5789	PERSON TO SEE LAWRENCE WHITING	TERMS	CONTRACT	CALL IN	AUTO

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL & GAL) (JAN)
SHUNT IN HALLWAY BY RM 117-KILLS ALL POWER IN KITCHEN

1-ANSU SEMIANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	Legal	PRE-ENG. SYS. SERVICE - Ansul R-102		[REDACTED]
		PRE-ENG SYS. SERVICE		
3	3360ML	FUSIBLE LINKS CHANGED - 3600ML 21		[REDACTED]
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

B I L L T O	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL	[REDACTED]
	ATTN: BRIAN WILLIAMS	1/28/21	[Signature]	TAX	[REDACTED]
	119 FOREST GLEN DRIVE			TOTAL	[REDACTED]

SUFFOLK, VA 23434

[Signature]
PRINT SIGNATURE

SIGN SIGNATURE

18000 W/M

ORIGINAL



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4808

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	John Yeates Middle
Address:	4901 Bennett's Pasture Rd.
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-923-4105
Contact:	Lawrence
Account#	0314993

System Information	
System Location:	Kitchen
Manufacturer:	Ansol
Model:	P-102 Legal
Nozzles:	#Appl. - 6 #Broiler - N/A
	#Duct - 2 #Plenum - 1 (6')
Total Flows:	Cylinder Dates: 20A x 2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input type="checkbox"/> Contractor
<input checked="" type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldg. Alarm	<input type="checkbox"/> Local Bldg Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Flat Stove	12"	G	1	245	6.				
2.			3	245	7.				
3.			2	2W	8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators.	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 107 oz. ___ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (3) 360° ML 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays. - in Hall by Rm 117	/		
17) Re-Install all access panels and filters-Note Condition. - ok (kills all power)	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/21 Johnson Controls	/		

Comments and Deficiencies:

- system inspected, tagged, returned to operation

Service Tech: *[Signature]*

Date: 1/28/21

Time in:

Time out:

Customer Authorized Agent: X

[Signature]

Print: X



- Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649
- York, PA
717-741-9980/866-922-2373
FAX 717-741-9981
- Richmond, VA
804-447-2900
FAX 804-447-2866
- Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

- Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806
- Clayton, NC
919-550-2699/800-849-8806
FAX 919-550-0719
- Laurinburg, NC
910-276-1112
FAX 910-276-5811
- Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762099

CUSTOMER'S NAME/ADDRESS	CUST. ACC. NO.	CUST/PURCHASE ORDER #	DATE OF CALL		
KILBY SHORES ELEMENTARY 111 KILBY SHORES DR. - KIT SUFFOLK, VA 23434	0314985				
TELE NO.: 757-934-6214 (C) 757-925-5789	PERSON TO SEE LAWRENCE WHITING	TERMS	CONTRACT	CALL IN	AUTO

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL 3 GAL) (JAN)
1-ANSU SEMI ANNUAL.

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	3gal	PRE-ENG. SYS. SERVICE - Ansul R-102		█
		PRE-ENG SYS. SERVICE		
3	6260ML	FUSIBLE LINKS CHANGED - 360° ML 21		█
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
 REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

SUFFOLK PUBLIC SCHOOLS ATTN: BRIAN WILLIAMS 119 FOREST GLEN DRIVE SUFFOLK, VA 23434	COMPLETED DATE	SVRM.	SUB-TOTAL	█
	1/26/21	OR	TAX EXEMPT	█
	PRINT SIGNATURE			TOTAL

ORIGINAL

SIGN SIGNATURE

18000 WW



HANOVER, MD
410-768-2200/800-968-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-278-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-782-5418/800-948-9279
FAX 910-782-9279

Customer Information	
Name:	Kilby Shores Elementary
Address:	111 Kilby Shores Dr.
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-934-6214
Contact:	Lawrence
Account#	0314985

System Information	
System Location:	Kitchen
Manufacturer:	Ansol
Model:	P-102 3gal
Nozzles:	#Appl. - 1 #Broiler - N/A
	#Duct - 2 #Plenum - 4 (12'x2)
Total Flows:	9 Cylinder Dates: 2015
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input checked="" type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input type="checkbox"/> Monitored Bldng. Alarm	<input checked="" type="checkbox"/> Local Bldng Alarm (H/S) <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Flat Stove	12"	G	1	LN	6.				
2.					7.				
3.					8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators.	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 58 oz. ___ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (3) 360°ML 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition. - ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:

- System inspected, tagged, returned to operation
* Horn Strobe flashes, but does not ring (needs repair)

Service Tech: *EP* Date: 1/26/21 Time in: Time out:

Customer Authorized Agent (X) *[Signature]* Print: X



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Clayton, NC
919-550-2899/800-849-8886
FAX 919-550-0719

Richmond, VA
804-447-2900
FAX 804-447-2866

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762093

CUSTOMER'S NAME/ADDRESS	CUST. ACC. NO.	CUST/PURCHASE ORDER #	DATE OF CALL		
KING'S FORK HIGH 351 KING'S FORK RD. - HOME EC SUFFOLK, VA 23434	0304982				
	PERSON TO SEE	TERMS	CONTRACT	CALL IN	AUTO
TELE NO.: 757-923-5240 (C)-757-925-5789	LAWRENCE WHITING				

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (PCL-300) (JAN)
 THIS IS IN HOME ECONOMICS - NOT THE CAFETERIA!!RMC121
 1-PYRO SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	300	PRE-ENG. SYS. SERVICE - Pyro Chem PCL		
		PRE-ENG SYS. SERVICE		
4	6500ML	FUSIBLE LINKS CHANGED - 500 ^o ML 21		
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
 WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
 REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL \$	
	ATTN: BRIAN WILLIAMS	1/27/21	DP	TAX EXEMPT	
	119 FOREST GLEN DRIVE			TOTAL	
	SUFFOLK, VA 23434				

(X) NIKKA S. GATHING
 PRINT SIGNATURE

[Signature]
 SIGN SIGNATURE

ORIGINAL

18000 WW



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5849

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/886-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5410/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Kings Fork High
Address:	351 Kings Fork Rd.
City:	Suffolk
State:	VA Zip: 2343A
Phone:	757-923-5240
Contact:	Lawrence
Account#	0304982

System Information	
System Location:	Home Ec.
Manufacturer:	Pyro Chem
Model:	PCL-300
Nozzles:	#Appl. - 3 #Broiler - N/A
	#Duct - 1 #Plenum - 2 (12')
Total Flows:	Cylinder Dates: 2018
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input type="checkbox"/> Contractor
<input checked="" type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldg. Alarm	<input type="checkbox"/> Local Bldg Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Fryer	14"	G	1	2H	6.				
2. Chargrill	24"	G	1	1H	7.				
3. Range	24"	G	1	2L	8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators. - gauge in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 16 gram date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (A) 500 ML 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays. - Panel LC2	/		
17) Re-Install all access panels and filters-Note Condition. - ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:
- system inspected, tagged, returned to operation

Service Tech: *BP* Date: 1/27/21 Time in: Time out:

Customer Authorized Agent: *X* *[Signature]* Print: X *Nikka S. Catling*



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Clayton, NC
919-550-2699/800-849-8086
FAX 919-550-0719

Richmond, VA
804-447-2900
FAX 804-447-2866

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762110

CUSTOMER'S NAME/ADDRESS KING'S FORK HIGH SCHOOL 351 KING'S FORK RD. - KIT SUFFOLK, VA 23434	CUST. ACC. NO. 0314998	CUST/PURCHASE ORDER #	DATE OF CALL			
TELE NO.: 757-923-5240 (D) 757-506-5026	PERSON TO SEE ANGELO MILAN		TERMS	CONTRACT	CALL IN	AUTO

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (PCL-300X2) (JAN)

1-PYRO SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	300X2	PRE-ENG. SYS. SERVICE - Pyro Chem PCL		[REDACTED]
		PRE-ENG SYS. SERVICE		
1/7	6360ML 6500ML	FUSIBLE LINKS CHANGED - 360° ML 21 - 500° ML 21		[REDACTED]
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE 1/27/21	SVRM. [Signature]	SUB-TOTAL \$ [REDACTED]
	ATTN: BRIAN WILLIAMS			TAX EXEMPT
	119 FOREST GLEN DRIVE SUFFOLK, VA 23434			TOTAL \$ [REDACTED]
		<input checked="" type="checkbox"/> Nikka S. Catling PRINT SIGNATURE		[Signature] SIGN SIGNATURE

ORIGINAL



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9901

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Kings Fork High
Address:	351 Kings Fork Rd.
City:	Suffolk
State:	VA Zip: 2343A
Phone:	757-923-5240
Contact:	Lawrence
Account#	0314988

System Information	
System Location:	Kitchen
Manufacturer:	Pyro Chem
Model:	PCL-300X2
Nozzles:	#Appl. - 6 #Broiler - N/A
	#Duct - 2 #Plenum - 4 (14' x 2)
Total Flows:	20
Cylinder Dates:	2018X2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input type="checkbox"/> Contractor
<input checked="" type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldg. Alarm	<input type="checkbox"/> Local Bldg Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Tilt Skillet	30"	G/E	1	2H	6. Range	18"	G	1	2L
2. Fryer	14"	G/E	1	2H	7.				
3. Fryer	14"	G/E	1	2H	8.				
4. Fryer	14"	G/E	1	2H	9.				
5. Fryer	14"	G/E	1	2H	10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators. - gauges in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 16 gram date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (1) 360° / (2) 500° ML 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays. - panel LK3	/		
17) Re-Install all access panels and filters-Note Condition. - ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:

- system inspected, tagged, returned to operation

Service Tech: *DP* Date: 1/27/21 Time in: Time out:

Customer Authorized Agent *X* *DP* Print: X *Nick S. GATHIN*



- Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649
- York, PA
717-741-9980/866-922-2373
FAX 717-741-9981
- Richmond, VA
804-447-2900
FAX 804-447-2866
- Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

- Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806
- Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719
- Laurinburg, NC
910-276-1112
FAX 910-276-5811
- Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762094

CUSTOMER'S NAME/ADDRESS	CUST. ACC. NO.	CUST/PURCHASE ORDER #	DATE OF CALL		
KING'S FORK MIDDLE 350 KING'S FORK RD. - HOME EC SUFFOLK, VA 23434	0305822				
TELE NO.: 757-923-5246 (C) 757-925-5789	PERSON TO SEE LAWRENCE WHITING	TERMS	CONTRACT	CALL IN	AUTO

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (3-GUARDIAN) (JAN)
 THESE ARE IN HOME ECONOMICS - NOT THE CAFETERIA!!
 3-GUAR SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
3	2.5	PRE-ENG. SYS. SERVICE - Guardian	[REDACTED]	[REDACTED]
		PRE-ENG SYS. SERVICE		
12	6360ML	FUSIBLE LINKS CHANGED - 360° MC 21	[REDACTED]	[REDACTED]
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
 WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
 REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

B I L L T O	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL	[REDACTED]
	ATTN: BRIAN WILLIAMS	1/27/21	[Signature]	TAX	[REDACTED]
	119 FOREST GLEN DRIVE			EXEMPT	[REDACTED]
	SUFFOLK, VA 23434			TOTAL	[REDACTED]

ORIGINAL
 PRINT SIGNATURE: [Signature]
 SIGN SIGNATURE: [Signature]

18000 WW



HANOVER, MD
410-788-2200/800-966-2212
FAX 410-768-5849

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4808

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Kings Fork Middle
Address:	350 Kings Fork Rd.
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-923-5246
Contact:	Lawrence
Account#	0305822

System Information	
System Location:	Home Ec. #1 (Room B-1A)
Manufacturer:	Gardian Model: 2.5
Nozzles:	#Appl. - 2 #Broller - N/A
	#Duct - Ø #Plenum - Ø
Total Flows:	Cylinder Dates: 2016
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input checked="" type="checkbox"/> Mech. Gas Valve	<input checked="" type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input type="checkbox"/> Monitored Bldg. Alarm	<input type="checkbox"/> Local Bldg Alarm <input type="checkbox"/> Bell <input checked="" type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Res. Range	30"	E	2	Jet	6.				
2.					7.				
3.					8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators. - gauge in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge ____ oz. ____ date.			/
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		/
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (4) 360° ML 21	/		
12) Check for complete shutdown of gas or electric appliances.	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.			/
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition.	/		/
18) Re-install all cartridges.	/		/
19) Manual and remote releases set / seals in place.	/		/
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign.	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.			/
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:
- system inspected, tagged, returned to operation

Service Tech: *BP* Date: 1/22/21 Time in: Time out:

Customer Authorized Agent: *(X) [Signature]* Print: X *Juan Chen*



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5849

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2899/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Kings Fork Middle
Address:	350 Kings Fork Rd.
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-923-5246
Contact:	Lawrence
Account#	0305822

System Information	
System Location:	Home Ec. #2 (Room B-114)
Manufacturer:	Guardian Model: 2.5
Nozzles:	#Appl. - 2 #Broiler - N/A
	#Duct - 0 #Plenum - 0
Total Flows:	Cylinder Dates: 1/6
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input checked="" type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input checked="" type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Res. Range	30"	E	2	Jet	6.				
2.					7.				
3.					8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators. - gauge in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge ____ oz. ____ date.			/
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	mw		/
10) Activate system from terminal (last) links.	mw	/	mw
11) Replace fusible links. - (A) 360° MC 21	/		
12) Check for complete shutdown of gas or electric appliances.	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.			/
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition.			/
18) Re-install all cartridges.			/
19) Manual and remote releases set / seals in place.			/
20) Remove safety pins and install covers.			/
21) Check fan operation - Check for fan warning sign.	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.			/
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:
- system inspected, tagged, returned to operation

Service Tech: PO Date: 1/27/21 Time in: _____ Time out: _____

Customer Authorized Agent: (X) [Signature] Print: X Jans Charles



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5849

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Kings Fork Middle
Address:	350 Kings Fork Rd.
City:	Suffolk
State:	VA Zip: 23438
Phone:	757-923-5246
Contact:	Lawrence
Account#	0305822

System Information	
System Location:	Home Ec. # 3 (Room B-114)
Manufacturer:	Guardian Model: 2.5
Nozzles:	#Appl. - 2 #Broiler - N/A
	#Duct - 0 #Plenum - 0
Total Flows:	Cylinder Dates: 2016
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input checked="" type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input checked="" type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Res. Range	30"	E	2	Jet	6.				
2.					7.				
3.					8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators. - gauge in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge ____ oz. ____ date.			/
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		/
11) Replace fusible links. - (4) 360°ML 21	/		/
12) Check for complete shutdown of gas or electric appliances.	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		/
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition.	/		/
18) Re-Install all cartridges.	/		/
19) Manual and remote releases set / seals in place.	/		/
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign.	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		/
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		/

Comments and Deficiencies:

- system inspected, tagged, returned to operation

Service Tech: *[Signature]* Date: 1/27/20 Time in: Time out:

Customer Authorized Agent: *[Signature]* Print: X JAMK Chen JB



- Corporate Headquarters
Hanover, MD
410-760-2200/800-966-2212
FAX 410-768-5649
- York, PA
717-741-9980/866-922-2373
FAX 717-741-9981
- Richmond, VA
804-447-2900
FAX 804-447-2866
- Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176
- Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806
- Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719
- Laurinburg, NC
910-276-1112
FAX 910-276-5811
- Wilmington, NC
910-762-5418/800-948-5409
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762106

CUSTOMER'S NAME/ADDRESS	CUST. ACC. NO.	CUST/PURCHASE ORDER #	DATE OF CALL		
KING'S FORK MIDDLE 350 KING'S FORK RD. - KIT SUFFOLK, VA 23434	0314994				
TELE NO.: 757-923-5240 (C) 757-925-5789	PERSON TO SEE		TERMS	CONTRACT	CALL IN
	LAWRENCE WHITING				

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (PCL-350X2) (JAN)
DETECTION LINE SPLICED INSIDE OF CONTROL HEAD
1-PYRO SEMIANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	350x2	PRE-ENG. SYS. SERVICE - Pyro Chem PCL		
		PRE-ENG SYS. SERVICE		
4	G360ML	FUSIBLE LINKS CHANGED - 360° ML 21		
3	G500ML	-500° ML 21		
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL
	ATTN: BRIAN WILLIAMS	1/27/21	OP	TAX EXEMPT
	119 FOREST GLEN DRIVE			TOTAL
	SUFFOLK, VA 23434			PRINT SIGNATURE

18000 WW

ORIGINAL



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5849

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4808

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Kings Fork Middle
Address:	350 Kings Fork Rd.
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-923-5246
Contact:	Lawrence
Account#	0314994

System Information	
System Location:	Kitchen
Manufacturer:	Pyro Chem
Model:	PCL-350x2
Nozzles:	#Appl. - 9 #Broiler - N/A
	#Duct - 4 #Plenum - 4 (14'x2)
Total Flows:	Cylinder Dates: 2014 x 2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input checked="" type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldg. Alarm	<input type="checkbox"/> Local Bldg Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Flat Stove	18"	G	1	R/	6.				
2. Range	18"	G	1	RH2	7.				
3. Tilt Skillet	48"	G/E	3	F2	8.				
4. Fryer	18"	G/E	2	F2	9.				
5. Fryer	18"	G/E	2	F2	10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check <u>pressure gauge indicator</u> , discharge indicators. - gauges in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge <u>16 gram</u> date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (1) 360° / (3) 500ml 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel. - has crimp in line in box	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition. - ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:

-system inspected, tagged, returned to operation

Service Tech: Date: 1/27/21 Time in: Time out: *

Customer Authorized Agent: X Print: X



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Richmond, VA
804-447-2900
FAX 804-447-2866

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Dover, DE
302-527-2373/888-553-2373
FAX 302-348-4806

Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762100

CUSTOMER'S NAME/ADDRESS LAKELAND HIGH SCHOOL 214 KENYON ROAD - KIT SUFFOLK, VA 23434	CUST. ACC. NO. 0314996	CUST/PURCHASE ORDER #	DATE OF CALL		
TELE NO.: 757-925-5790 (C) 757-925-5789	PERSON TO SEE LAWRENCE WHITING	TERMS	CONTRACT	CALL IN	AUTO

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL & GAL) (JAN)
GAS VALVE RESET AT END OF HOOD & SHUNT IN BOILER/ELEC ROOM

1-ANSU SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	legal	PRE-ENG. SYS. SERVICE - Ansul R-10Z		
		PRE-ENG SYS. SERVICE		
4	6360ML	FUSIBLE LINKS CHANGED - 360° ML 21		
3	6500ML	- 500° ML 21		
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE 1/26/21	SVRM. BP	SUB-TOTAL \$ [REDACTED]
	ATTN: BRIAN WILLIAMS			TAX EXEMPT
	119 FOREST GLEN DRIVE SUFFOLK, VA 23434			TOTAL \$ [REDACTED]

[Handwritten Signature]
PRINT SIGNATURE

SIGN SIGNATURE

ORIGINAL

18000 WW



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Lakeland High School
Address:	214 Kenyon Rd.
City:	Suffolk
State:	VA
Zip:	23434
Phone:	757-925-5790
Contact:	Lawrence
Account#	0314996

System Information	
System Location:	Kitchen
Manufacturer:	Ansul
Model:	R-102 (Legal)
Nozzles:	#Appl. - 5 #Boiler - N/A
	#Duct - 4 #Plenum - 4 (9'x4')
Total Flows:	21 Cylinder Dates: 2015x2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input checked="" type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Tilt Skillet	48"	G/E	2	290	6.				
2. Tilt Skillet	36"	G/E	2	290	7.				
3. Flat Stove	18"	G	1	1N	8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators.	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 113 oz. ___ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (4) 360° / (3) 500° ML 21	/		
12) Check for complete shutdown of gas or electric appliances. -	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances. - gas reset at end of hood	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays. - boiler room (Elec. Rm)	/		
17) Re-Install all access panels and filters-Note Condition. - ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:

-system inspected, tagged, returned to operation

Service Tech: *BP* Date: 1/26/21 Time in: Time out:

Customer Authorized Agent: *(X) O'Connell* Print: X



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Richmond, VA
804-447-2900
FAX 804-447-2866

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762100

CUSTOMER'S NAME/ADDRESS		CUST. ACC. NO.	CUST/PURCHASE ORDER #		DATE OF CALL
MACK BENN JR. ELEMENTARY 1253 NANSEMOND PKWY. - KIT SUFFOLK, VA 23434		0314986			
TELE NO.: 757-934-6224		PERSON TO SEE	TERMS	CONTRACT	CALL IN
		LAWRENCE WHITING			AUTO

SPECIAL INSTRUCTIONS: SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL 7.5 GAL) (JAN)

1-ANSUL SEMIANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	7.5gal	PRE-ENG. SYS. SERVICE - Ansul R-102		[REDACTED]
		PRE-ENG SYS. SERVICE		
6	6360ML	FUSIBLE LINKS CHANGED - 360°ML 21		[REDACTED]
		FIRE ALARM SYSTEM SERVICE		
		* cylinders due for Hydrotest by end of year *		
		CLEAN AGENT SYSTEM SERVICE		
		(Will send quote)		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL	[REDACTED]
	ATTN: BRIAN WILLIAMS	1/26/21	Ⓚ	TAX EXEMPT	[REDACTED]
	113 FOREST GLEN DRIVE	 PRINT SIGNATURE		TOTAL	[REDACTED]
	SUFFOLK, VA 23434			 SIGN SIGNATURE	

ORIGINAL

1800 WM



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5849

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Mack Benn Jr. Elementary
Address:	1253 Nansemond Pkwy
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-934-6224
Contact:	Lawrence
Account#	0314986

System Information	
System Location:	Kitchen (End Cabinet)
Manufacturer:	Ansul Model: E-102 7.5gal
Nozzles:	#Appl. - 5 #Broiler - N/A #Duct - 4 #Plenum - 6 (11'8" x 2)
Total Flows:	20 Cylinder Dates: 2009 x3
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input checked="" type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input checked="" type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Flat Stove	18"	G	1	2W					
2. Tilt Skillet	36"	G/E	2	2W					
3.			2	2W					
4.									
5.									

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators.	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 125/46oz date. (double tank + 101-20)	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place. - need to be changed	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (G) 360° ML 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays. - panel LK	/		
17) Re-Install all access panels and filters-Note Condition. -ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. -on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/21 Johnson Controls	/		

Comments and Deficiencies:

-system inspected, tagged, returned to operation
* cylinder due for Hydrotest by end of year *

Service Tech: *AR* Date: 1/26/21 Time in: Time out:

Customer Authorized Agent (X) *Chetan E. Sharma* Print: X



- Corporate Headquarters
Hanover, MD
410-760-2200/800-966-2212
FAX 410-768-5649
- York, PA
717-741-9980/866-922-2373
FAX 717-741-9981
- Richmond, VA
804-447-2900
FAX 804-447-2866
- Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

- Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806
- Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719
- Laurinburg, NC
910-276-1112
FAX 910-276-5811
- Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762109

CUSTOMER'S NAME/ADDRESS NANSEMOND RIVER HIGH SCHOOL 3301 NANSEMOND PKWY. - KIT SUFFOLK, VA 23434	CUST. ACC. NO. 0314997	CUST/PURCHASE ORDER #	DATE OF CALL		
TELE NO.: 757-923-4101 (C) 757-925-5789	PERSON TO SEE LAWRENCE WHITING	TERMS	CONTRACT	CALL IN	AUTO

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL 6 GAL) (JAN)
FACE NOT MONITORED
GAS RESET AT END OF HOOD - SHUNT IN BOILER RM PANEL EML
1-ANSUL SEMI-ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	6gal	PRE-ENG. SYS. SERVICE - Ansul R-102		
		PRE-ENG SYS. SERVICE		
7	6360ML	FUSIBLE LINKS CHANGED - 360° ML 21		
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

B I L L T O SUFFOLK PUBLIC SCHOOLS ATTN: BRIAN WILLIAMS 119 FOREST GLEN DRIVE SUFFOLK, VA 23434	COMPLETED DATE 1/28/21	SVRM. [Signature]	SUB-TOTAL [Redacted]
			TAX EXEMPT [Redacted]
			TOTAL [Redacted]

ORIGINAL
 [Signature] PRINT SIGNATURE
 SIGN SIGNATURE

18000 WW



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/866-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2899/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-438-1301/800-394-2373
FAX 757-438-3178

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Nansemond River High
Address:	3301 Nansemond Pkwy
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-923-4101
Contact:	Lawrence
Account#	0314997

System Information	
System Location:	Kitchen
Manufacturer:	Ansul
Model:	R-102 6gal
Nozzles:	#Appl. - 5 #Broiler - N/A
	#Duct - 4 #Plenum - 4 (9'x4)
Total Flows:	21
Cylinder Dates:	2015 X 2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input checked="" type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Tilt Skillet	48"	G/E	2	290	6.				
2. Tilt Skillet	36"	G/E	2	290	7.				
3. Range	18"	G	1	IN	8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators.	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 61 oz. ___ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (7) 360° ML 21	/		
12) Check for complete shutdown of gas or electric appliances. - in Boiler Rm PNL EML	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays. -	/		
17) Re-Install all access panels and filters-Note Condition. - OK	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/21 Johnson Controls	/		

Comments and Deficiencies:

- system inspected, tagged, returned to operation

Service Tech: *[Signature]*

Date: 1/28/21

Time in:

Time out:

Customer Authorized Agent (X) *[Signature]*

Print: X



- Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649
- York, PA
717-741-9980/866-922-2373
FAX 717-741-9981
- Richmond, VA
804-447-2900
FAX 804-447-2866
- Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

- Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806
- Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719
- Laurinburg, NC
910-276-1112
FAX 910-276-5811
- Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762101

CUSTOMER'S NAME/ADDRESS NANSEMOND PARKWAY ELEMENTARY 3012 NANSEMOND PKWY. - KIT SUFFOLK, VA 23434	CUST. ACC. NO. 0314987	CUST/PURCHASE ORDER #	DATE OF CALL		
TELE NO.: 757-923-4167 (C) 757-925-5789	PERSON TO SEE LAWRENCE WHITING	TERMS	CONTRACT	CALL IN	AUTO

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL 6 GAL) (JAN)
1-ANSUL SEMI-ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	Legal	PRE-ENG. SYS. SERVICE - Ansul R-102		
		PRE-ENG SYS. SERVICE		
6	G360ML	FUSIBLE LINKS CHANGED - 360°ML 21		
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

7/21/21

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

B I L L T O	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE 1/28/21	SVRM. AP	SUB-TOTAL	
	ATTN: BRIAN WILLIAMS	no one to sign 		TAX EXEMPT	
	119 FOREST GLEN DRIVE			TOTAL	
	SUFFOLK, VA 23434	PRINT SIGNATURE		SIGN SIGNATURE	

ORIGINAL

18000 WM



HANOVER, MD
410-768-2200/800-968-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-348-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Nansemond Parkway Elementary
Address:	3012 Nansemond Pkwy
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-923-4167
Contact:	Lawrence
Account#	0314987

System Information	
System Location:	Kitchen (Pantry)
Manufacturer:	Ansel Model: P-102 legal
Nozzles:	#Appl. - 3 #Broller - N/A
	#Duct - 2 #Plenum - 4 (12'x2)
Total Flows:	14 Cylinder Dates: 2011 X 2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input checked="" type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input type="checkbox"/> Monitored Bldng. Alarm	<input checked="" type="checkbox"/> Local Bldng Alarm (H/S) <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Range	18"	G	1	2A5	6.				
2. Tilt skillet	36"	E	2	3N	7.				
3.					8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators.	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 47 oz. ___ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. (6) 360° ML 21	/		
12) Check for complete shutdown of gas or electric appliances. -off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays. -in storage rm 82	/		
17) Re-Install all access panels and filters-Note Condition. -ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. -on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. -1/21 Johnson Controls	/		

Comments and Deficiencies:

-system inspected, tagged, returned to operation

Service Tech: *AP*

Date: 1/28/21

Time in:

Time out:

Customer Authorized Agent: *(X)*

Print: X



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Richmond, VA
804-447-2900
FAX 804-447-2866

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762102

CUSTOMER'S NAME/ADDRESS		CUST. ACC. NO.	CUST/PURCHASE ORDER #		DATE OF CALL
NORTHERN SHORES ELEMENTARY 6701 RESPASS BEACH RD. - KIT SUFFOLK, VA 23434		0314988			
TELE NO.: 757-923-4169		PERSON TO SEE	TERMS	CONTRACT	CALL IN
		LAWRENCE WHITING			AUTO

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (KIDDE 4G SHORT) (JAN)

1-KIDD SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	400S	PRE-ENG. SYS. SERVICE - Kidde WADR		
		PRE-ENG SYS. SERVICE		
6	3360ML	FUSIBLE LINKS CHANGED - 360° ML 21		
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		*cylinders past due for Hydrotest * - Red Tagged -		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL
	ATTN: BRIAN WILLIAMS	1/26/21	OP	TAX EXEMPT
	119 FOREST GLEN DRIVE			TOTAL
	SUFFOLK, VA 23434			
		<i>(Signature)</i>	<i>(Signature)</i>	
		PRINT SIGNATURE	SIGN SIGNATURE	

ORIGINAL

18000 WW



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-278-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Northern Shores Elementary
Address:	6701 Respass Beach Rd.
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-923-4169
Contact:	Lawrence
Account#	0314988

System Information	
System Location:	Kitchen
Manufacturer:	Kidde
Model:	WHDR-400SXZ
Nozzles:	#Appl. - 6 #Broiler - N/A
	#Duct - 8 #Plenum - 4 (11'x2)
Total Flows:	18
Cylinder Dates:	2008x2
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input type="checkbox"/> Contractor
<input checked="" type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Tilt Skillet	30"	G/E	2	AOP	6.				
2.			3	96920	7.				
3. Flat Stove	18"	G	1	R	8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure gauge indicator, discharge indicators. - gauges in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 290 gram date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (6) 360°MC 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition. - ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:

-system inspected, non-compliant, returned to operation
cylinders past due for Hydrotest

Service Tech: [Signature] Date: 1/28/21 Time in: Time out:

Customer Authorized Agent: [Signature] Print: X



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719

Richmond, VA
804-447-2900
FAX 804-447-2866

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762103

CUSTOMER'S NAME/ADDRESS	CUST. ACC. NO.	CUST/PURCHASE ORDER #	DATE OF CALL		
OAKLAND ELEMENTARY 5505 GODWIN BLVD. - KIT SUFFOLK, VA 23434	0314989				
TELE NO.: 757-923-5240 (C) 757-925-5789	PERSON TO SEE	TERMS	CONTRACT	CALL IN	AUTO
	LAWRENCE WHITING				

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (R.G. 6 GAL) (JAN)
1-RG SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	Legal	PRE-ENG. SYS. SERVICE - Range Guard		[REDACTED]
		PRE-ENG SYS. SERVICE		
4	6360ML	FUSIBLE LINKS CHANGED - 360° ML 21		[REDACTED]
1	6500ML	- 500° ML 21		[REDACTED]
		FIRE ALARM SYSTEM SERVICE		
		* Cylinder due for Hydrotest; needs to be upgraded Red Tagged (SD will send quote for unit)		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE	SVRM.	SUB-TOTAL
	ATTN: BRIAN WILLIAMS	1/27/21	[Signature]	TAX EXEMPT
	119 FOREST GLEN DRIVE			TOTAL
	SUFFOLK, VA 23434			[REDACTED]
		<input checked="" type="checkbox"/> Patricia [Signature] PRINT SIGNATURE		[Signature] SIGN SIGNATURE

ORIGINAL

18000 WW



HANOVER, MD
410-768-2200/800-986-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Oakland Elementary
Address:	5505 Godwin Blvd.
City:	Suffolk
State:	VA
Zip:	23434
Phone:	757-923-5248
Contact:	Lawrence
Account#	0314989

System Information	
System Location:	Kitchen
Manufacturer:	Range Guard
Model:	Legal (old style)
Nozzles:	#Appl. -4 #Duct -4 #Brotler -N/A #Plenum -2 (10'x2)
Total Flows:	Cylinder Dates:
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input checked="" type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldng. Alarm	<input type="checkbox"/> Local Bldng Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Range	12"	E	1	R	6.				
2.			1	R	7.				
3. Tilt Skillet	36"	E	2	F	8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure guage indicator, discharge indicators. - gauge in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 16 gram date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (A) 360°ML / (1) 500°ML 21	/		
12) Check for complete shutdown of gas or electric appliances. - off	/		
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.	/		/
16) Reset all electrical shunt trips, contractors, and manual reset relays.	/		
17) Re-Install all access panels and filters-Note Condition. - ok	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - on	/		
22) Is system UL300 compliant.	/		
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.	/		
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Centrals	/		

Comments and Deficiencies:

-system inspected, non-compliant, returned to operation
* cylinder due for Hydro; needs to be upgraded *

Service Tech: *AP* Date: 1/27/20 Time in: Time out:

Customer Authorized Agent (X) *Patricia Cortes* Print: X



- Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649
- York, PA
717-741-9980/866-922-2373
FAX 717-741-9981
- Richmond, VA
804-447-2900
FAX 804-447-2866
- Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

- Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806
- Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719
- Laurinburg, NC
910-276-1112
FAX 910-276-5811
- Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762112

CUSTOMER'S NAME/ADDRESS	CUST. ACC. NO.	CUST/PURCHASE ORDER #	DATE OF CALL		
THE COLLEGE AND CAREER ACADEMY 4169 PRUDEN BLVD - PAINT BOOTH SUFFOLK, VA 23434	0320050				
	PERSON TO SEE	TERMS	CONTRACT	CALL IN	AUTO
TELE NO.: 757-934-6206	LAWRENCE WHITING				

SPECIAL INSTRUCTIONS SEMI-ANNUAL PAINT BOOTH TEST & INSPECTION (AMEREX 18) (JAN)
1-AMER SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	18	PRE-ENG. SYS. SERVICE - Amerex IS		[REDACTED]
		PRE-ENG SYS. SERVICE		
1	6212ML	FUSIBLE LINKS CHANGED - 2120ML 21		[REDACTED]
		FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

7/21/21

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

SUFFOLK PUBLIC SCHOOLS: A/P ATTN: VERNON JACKSON MAINT. DEPT 100 N. MAIN STREET SUFFOLK, VA 23434	COMPLETED DATE	SVRM.	SUB-TOTAL
	1/27/21	[Signature]	TAX EXEMPT
	[Signature]	[Signature]	TOTAL

18000 WW

ORIGINAL

PRINT SIGNATURE

SIGN SIGNATURE



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5649

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

A CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	College and Career Academy
Address:	4109 Pruden Blvd.
City:	Suffolk
State:	VA Zip: 23434
Phone:	757-934-6206
Contact:	Lawrence
Account#	0320850

System Information	
System Location:	Colission (Mix Booth)
Manufacturer:	Amerex Model: IS-18
Nozzles:	#Appl. - 1 #Broler - N/A
	#Duct - \emptyset #Plenum - \emptyset
Total Flows:	Cylinder Dates:
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input checked="" type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input type="checkbox"/> Monitored Bldng. Alarm	<input checked="" type="checkbox"/> Local Bldng Alarm (H/S) <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Paint Mix Room			1	TF	6.				
2.					7.				
3.					8.				
4.					9.				
5.					10.				

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	/		
2) Check pressure gauge indicator, discharge indicators. - gauge in green	/		
3) Check all seals and head assembly for tampering or activation.	/		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	/		
5) Weight or replace CO2/NIT cartridge 2000psi ____ date.	/		
6) Are piping and conduit securely braced, and free of damage?	/		
7) Check nozzles for proper position and alignment.	/		
8) Check nozzles for nozzle caps and / or seals in place.	/		
9) Actuate system from manual release.	/		
10) Activate system from terminal (last) links.	/		
11) Replace fusible links. - (1) 212°NL 21	/		
12) Check for complete shutdown of gas or electric appliances.			/
13) Reset link line tension, check links and cable for proper travel.	/		
14) Reset head and valve assemblies.	/		
15) Re-light all gas appliances.			/
16) Reset all electrical shunt trips, contractors, and manual reset relays.			/
17) Re-Install all access panels and filters-Note Condition.	/		
18) Re-install all cartridges.	/		
19) Manual and remote releases set / seals in place.	/		
20) Remove safety pins and install covers.	/		
21) Check fan operation - Check for fan warning sign. - off	/		
22) Is system UL300 compliant.	/		/
23) Install service tag and label.	/		
24) K-Class extinguisher in kitchen.			/
25) Portable extinguishers serviced? Last service date. - 1/20 Johnson Controls	/		

Comments and Deficiencies:
- system inspected, tagged, returned to operation

Service Tech: *[Signature]* Date: 1/27/21 Time in: Time out:

Customer Authorized Agent *[Signature]* Print: X



Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

Clayton, NC
919-550-2699/800-849-8886
FAX 919-550-0719

Richmond, VA
804-447-2900
FAX 804-447-2866

Laurinburg, NC
910-276-1112
FAX 910-276-5811

Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

JAN 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 1762107

3-1 LM VM

5-7-21
200

CUSTOMER'S NAME/ADDRESS TURLINGTON WOODS 629 TURLINGTON ROAD - KIT SUFFOLK, VA 23434	CUST. ACC. NO. 0314995	CUST/PURCHASE ORDER #	DATE OF CALL		
TELE NO.: 757-934-6215 (C) 757-925-5789	PERSON TO SEE 947-9645 ANGELO MILAN	TERMS	CONTRACT	CALL IN	AUTO

SPECIAL INSTRUCTIONS SEMI-ANNUAL HOOD TEST & INSPECTION (ANSUL 1.5 GAL) (JAN)
1-ANSU SEMIANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
		PRE-ENG. SYS. SERVICE		
		PRE-ENG SYS. SERVICE		
		FUSIBLE LINKS CHANGED		
		300 MC WAX FIRE ALARM SYSTEM SERVICE		
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

11/21/08

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO	SUFFOLK PUBLIC SCHOOLS	COMPLETED DATE 5-7-21	SVRM. 318	SUB-TOTAL
	ATTN: BRIAN WILLIAMS			TAX EXEMPT
	119 FOREST GLEN DRIVE			TOTAL
SUFFOLK, VA 23434	PRINT SIGNATURE	SIGN SIGNATURE		

18000 WW

ORIGINAL



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5849

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5410/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	Turkey Woods
Address:	6295 Turkey Road
City:	Suffolk
State:	VA
Zip:	23434
Phone:	757-934-0215
Contact:	Angelo
Account#	0314995

System Information	
System Location:	Kitchen
Manufacturer:	Ansel
Model:	R-102
Nozzles:	2
#Appl.:	2
#Broiler:	0
#Duct:	0
#Plenum:	0
Total Flows:	4
Cylinder Dates:	2010 (1.5 GNC)
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input type="checkbox"/> Shunt Trip	<input type="checkbox"/> None
<input checked="" type="checkbox"/> Contact	
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None
<input type="checkbox"/> Solenoid Gas Valve	
Alarm Tie-in:	
<input type="checkbox"/> Monitored Bldg. Alarm	<input checked="" type="checkbox"/> Local Bldg Alarm
<input type="checkbox"/> Bell	<input checked="" type="checkbox"/> None
Fan Tie-in	Back Alarm N/A

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
1. Red Pipe	32"	E	2	200					
2.									
3.									
4.									
5.									
6.									
7.									
8.									
9.									
10.									

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	✓		
2) Check pressure guage indicator, discharge indicators.	✓		
3) Check all seals and head assembly for tampering or activation.	✓		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	✓		
5) Weight or replace CO2/NIT cartridge <u>114 oz.</u> <u>2/10</u> date.	✓		
6) Are piping and conduit securely braced, and free of damage?	✓		
7) Check nozzles for proper position and alignment.	✓		
8) Check nozzles for nozzle caps and / or seals in place.	✓		
9) Actuate system from manual release.	✓		
10) Activate system from terminal (last) links.	✓		
11) Replace fusible links. <u>1 300 F1021</u>	✓		
12) Check for complete shutdown of gas or electric appliances. <u>Off</u>	✓		
13) Reset link line tension, check links and cable for proper travel.	✓		
14) Reset head and valve assemblies.	✓		
15) Re-light all gas appliances.	✓		
16) Reset all electrical shunt trips, contacts, and manual reset relays.	✓		
17) Re-Install all access panels and filters-Note Condition. <u>OK</u>	✓		
18) Re-install all cartridges.	✓		
19) Manual and remote releases set / seals in place.	✓		
20) Remove safety pins and install covers.	✓		
21) Check fan operation - Check for fan warning sign. <u>N/A</u>	✓		
22) Is system UL300 compliant.	✓		
23) Install service tag and label.	✓		
24) K-Class extinguisher in kitchen.	✓		
25) Portable extinguishers serviced? Last service date. <u>Johnson Contractors - JAN 21</u>	✓		

Comments and Deficiencies:
 Inspected system tested and tagged

Service Tech: S. Thomas Date: 5-7-21 Time in: Time out:

Customer Authorized Agent: X Print: X Angelo P.



□ Corporate Headquarters
Hanover, MD
410-768-2200/800-966-2212
FAX 410-768-5649

□ York, PA
717-741-9980/866-922-2373
FAX 717-741-9981

□ Richmond, VA
804-447-2900
FAX 804-447-2866

□ Chesapeake, VA
757-436-1301/800-394-2373
FAX 757-436-3176

□ Dover, DE
302-527-2373/888-553-2373
FAX 302-346-4806

□ Clayton, NC
919-550-2699/800-849-8806
FAX 919-550-0719

□ Laurinburg, NC
910-276-1112
FAX 910-276-5811

□ Wilmington, NC
910-762-5418/800-948-5489
FAX 910-762-9279

MAR 2021
SERVICE ORDER/INVOICE
MONTHLY

NO. W 17B171B

Fr
3.19.21
130

CUSTOMER'S NAME/ADDRESS PIONEER ELEMENTARY SCHOOL 150 PIONEER ROAD - KIT SUFFOLK, VA 23437		CUST. ACC. NO. 0322232	CUST/PURCHASE ORDER #	DATE OF CALL
TELE NO.: 757-925-5782 (C) 757-925-3789		PERSON TO SEE ROBERT MORRIS/ <i>Angelo</i>	TERMS	CONTRACT CALL IN AUTO

SPECIAL INSTRUCTIONS: SEMI-ANNUAL HOOD TEST & INSPECTION (ANNUAL 4.5GAL) (MAR)
JOHNSON CONTROLS DOES EXTS
1-ANSU SEMI ANNUAL

QUANTITY	WEIGHT	TYPE OF SERVICE/SALES	UNIT PRICE	TOTAL
		PORTABLE FIRE EXT.		
		CARTRIDGE EXCHANGE		
		EMERGENCY/EXIT LIGHTS		
1	45 lb	PRE-ENG. SYS. SERVICE <i>Ansul R-102</i> PRE-ENG SYS. SERVICE		[REDACTED]
5		FUSIBLE LINKS CHANGED <i>360' ALL LINKS</i> FIRE ALARM SYSTEM SERVICE		[REDACTED]
		CLEAN AGENT SYSTEM SERVICE		
		SPRINKLER SYSTEM SERVICE		
		FIRE PUMP TEST		

9/2/18

PLEASE PAY FROM THIS INVOICE IF TOTALED
WE ACCEPT AMERICAN EXPRESS, MASTERCARD AND VISA
REMIT TO: BFPE INTERNATIONAL, P.O. BOX 791045, BALTIMORE, MARYLAND 21279-1045

BILL TO SUFFOLK PUBLIC SCHOOLS ATTN: BRIAN WILLIAMS 119 FOREST GLEN DRIVE SUFFOLK, VA 23434	COMPLETED DATE <i>3-19-21</i>	SVRM. <i>318</i>	SUB-TOTAL [REDACTED]
			TAX EXEMPT TOTAL [REDACTED]
	<i>x Angela VanHorn</i> PRINT SIGNATURE		SIGN SIGNATURE

ORIGINAL

18000 WW



HANOVER, MD
410-768-2200/800-966-2212
FAX 410-768-5849

DOVER, DE
302-527-2373/888-553-2373
FAX 302-346-4806

CLAYTON, NC
919-550-2699/800-849-8866
FAX 919-550-0719

LAURINBURG, NC
910-276-1112
FAX 910-276-5811

CHESAPEAKE, VA
757-436-1301/800-394-2373
FAX 757-436-3176

RICHMOND, VA
804-447-2900
FAX 804-447-2866

YORK, PA
717-741-9980/866-922-2373
FAX 717-741-9981

WILMINGTON, NC
910-762-5418/800-948-9279
FAX 910-762-9279

Customer Information	
Name:	<i>Pinnacle Elementary School</i>
Address:	<i>150 Pinnacle Rd</i>
City:	<i>Suffolk</i>
State:	<i>VA</i> Zip: <i>23437</i>
Phone:	<i>757-925-5782</i>
Contact:	<i>Roberto</i>
Account#	<i>0322232</i>

System Information	
System Location:	<i>Kitchen</i>
Manufacturer:	<i>AnsoC</i>
Nozzles:	<i>10</i> #Appl. <i>9</i> #Broiler <i>N/A</i>
	#Duct <i>2</i> #Plenum <i>9</i>
Total Flows:	<i>14</i> Cylinder Dates: <i>2013/2019 (4.5 GAL)</i>
Type of Fuel Shutoff:	<input type="checkbox"/> Pressure switch
<input checked="" type="checkbox"/> Shunt Trip	<input type="checkbox"/> None <input checked="" type="checkbox"/> Contractor
<input type="checkbox"/> Mech. Gas Valve	<input type="checkbox"/> None <input type="checkbox"/> Solenoid Gas Valve
Alarm Tie-in:	
<input checked="" type="checkbox"/> Monitored Bldg. Alarm	<input type="checkbox"/> Local Bldg Alarm <input type="checkbox"/> Bell <input type="checkbox"/> None
Fan Tie-in	<input checked="" type="checkbox"/>

APPLIANCE LOCATION: LEFT TO RIGHT

Description	Size	G/E	Quantity	Nozzle ID	Description	Size	G/E	Quantity	Nozzle ID
<i>Knife</i>	<i>12"</i>	<i>E</i>	<i>1</i>	<i>243</i>					
<i>Fire Sprinkler</i>	<i>30"</i>	<i>E</i>	<i>3</i>	<i>243</i>					

	Yes	No	N/A
1) Are the hood and duct free of visible penetrations and hazards?	✓		
2) Check pressure guage indicator, discharge indicators.	✓		
3) Check all seals and head assembly for tampering or activation.	✓		
4) Are cylinders securely mounted and free of signs of external damage or corrosion?	✓		
5) Weight or replace CO2/NIT cartridge <i>112oz.</i> date.	✓		
6) Are piping and conduit securely braced, and free of damage?	✓		
7) Check nozzles for proper position and alignment.	✓		
8) Check nozzles for nozzle caps and / or seals in place.	✓		
9) Actuate system from manual release.	✓		
10) Activate system from terminal (last) links.	✓		
11) Replace fusible links <i>5-360' M21</i>	✓		
12) Check for complete shutdown of gas or electric appliances. <i>Off</i>	✓		
13) Reset link line tension, check links and cable for proper travel.	✓		
14) Reset head and valve assemblies.	✓		
15) Re-light all gas appliances.			✓
16) Reset all electrical shunt trips, contractors, and manual reset relays.	✓		
17) Re-Install all access panels and filters-Note Condition <i>OK</i>	✓		
18) Re-install all cartridges.	✓		
19) Manual and remote releases set / seals in place.	✓		
20) Remove safety pins and install covers.	✓		
21) Check fan operation - Check for fan warning sign. <i>OK</i>	✓		
22) Is system UL300 compliant.	✓		
23) Install service tag and label.	✓		
24) K-Class extinguisher in kitchen.	✓		
25) Portable extinguishers serviced? Last service date: <i>JAN 2021 - Johnson Controls</i>	✓		

Comments and Deficiencies:

Inspected system. Tested and tagged

Service Tech: *De Marco* Date: *3-19-21* Time in: Time out:

Customer Authorized Agent: X *Angela VanHemmel* Print: X