


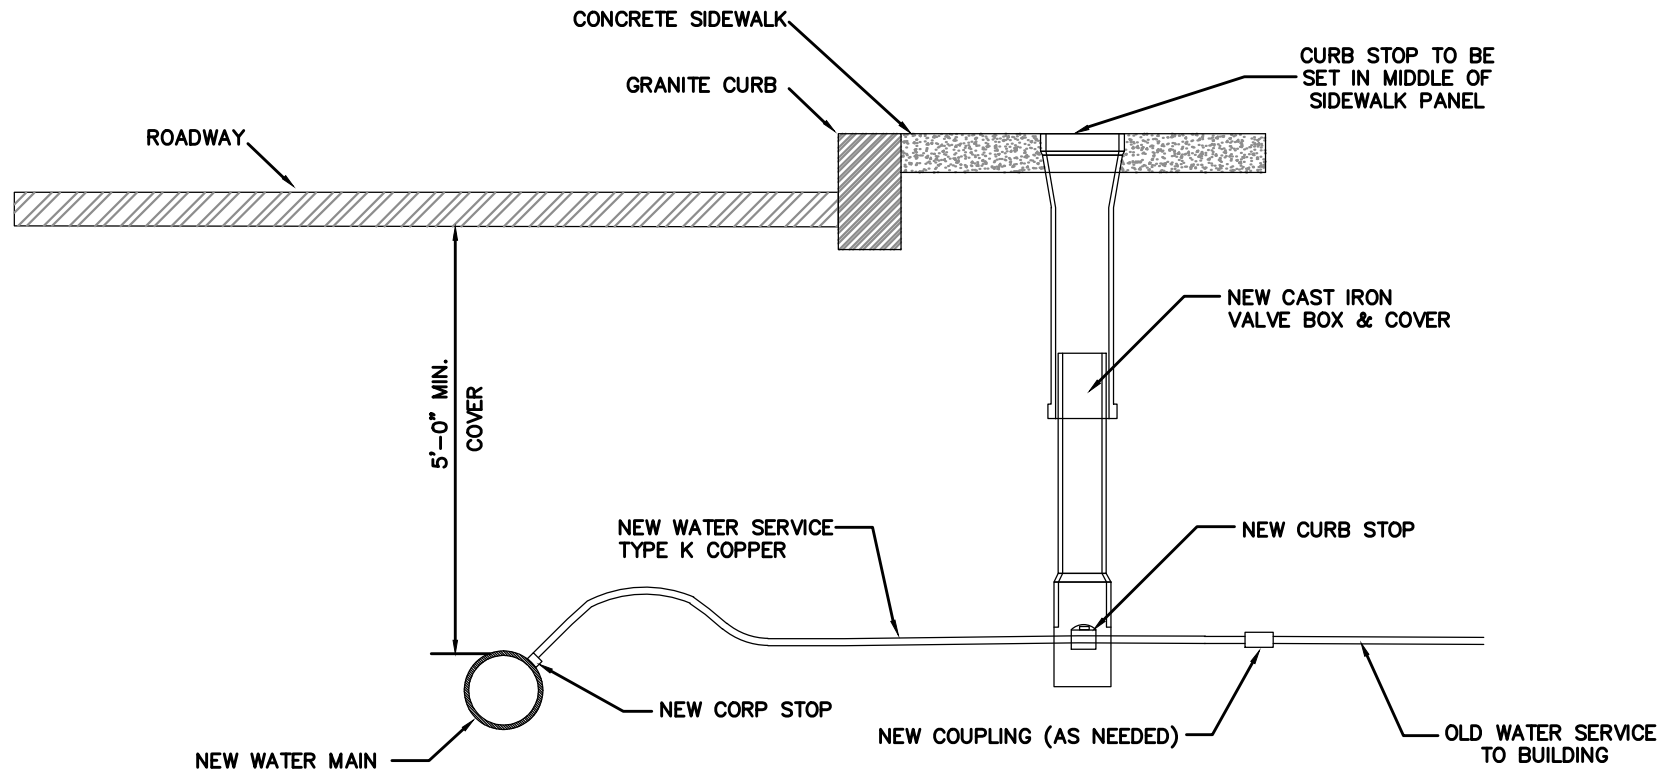

#### NOTES

1. ALL WATER SERVICES AND CURB STOPS SHALL BE REPLACED IN CENTER OF SIDEWALK PANEL.
2. ALL NEW WATER SERVICES, CORPORATIONS & CURB STOPS SHALL BE 1" IN DIAMETER UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
3. ALL LEAD SERVICES ARE TO BE REMOVED AND REPLACED TO THE EDGE OF THE R.O.W.

MAXIMUM SIZE  
TAPPED CONNECTION\*

| WATER MAIN<br>DIAMETER | MAXIMUM TAP<br>DIAMETER |
|------------------------|-------------------------|
| 4"                     | 1"                      |
| 6"                     | 1 1/4"                  |
| 8"                     | 2"                      |
| 12"                    | 3"                      |

\* WHERE THE SIZE OF THE CONNECTION EXCEEDS THAT GIVEN IN THE TABLE, A BOSS SHALL BE PROVIDED, OR THE TAP SHALL BE MADE BY MEANS OF MULTIPLE CORP. STOPS AND BRANCH FITTINGS, TAPPED TEE, OR TAPPED SADDLE.



**CITY OF MEDFORD,  
MASSACHUSETTS**

City Hall - Room 300, 85 George P. Hassett Drive,  
Medford, MA 02155  
781-393-2476

**TYPICAL WATER SERVICE  
WITH ADJUSTABLE  
VALVE BOX DETAIL**

FEB. 2023

SCALE: NTS

**B-7**