



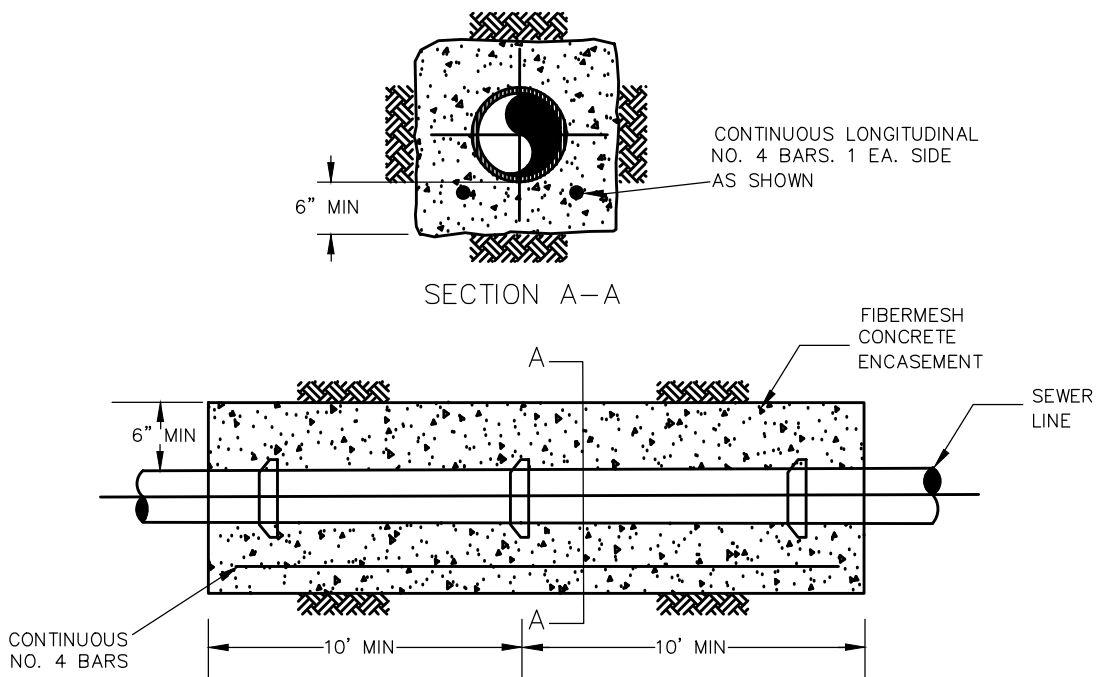

STEEL/DUCTILE CASING PIPE OR CONCRETE ENCASEMENT REQUIRED IN ALL CASES WHERE SEWER LINE IS ABOVE WATER LINE OR IS UNDER WATERWAY CROSSING

WATER LINE BELOW SEWER LINE

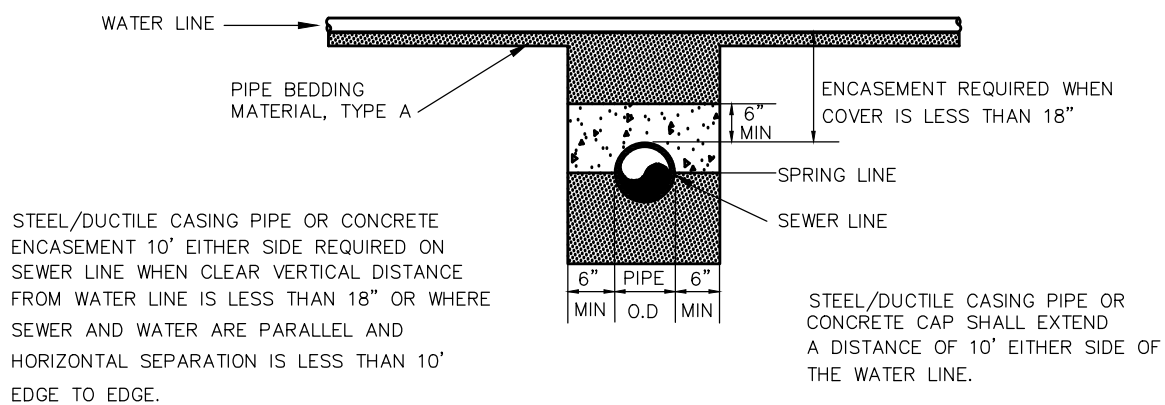

WATER LINE ABOVE SEWER LINE



**CITY OF MEDFORD,
MASSACHUSETTS**

City Hall - Room 300, 85 George P. Hassett Drive,
Medford, MA 02155
(781) 393-2476

**TYPICAL WATER AND SEWER
CROSSINGS**

DATE: JUNE 2011

SCALE: NTS

B-10