

Districtwide Lead in Drinking Water Sampling and Remediation Plan

2023-2025

Westbury UFSD

March 2024
Revised June 2024

Enviroscience Project #24498



2150 Smithtown Ave., Suite 3, Ronkonkoma, NY 11779

T: 631.580.3191 • F: 631.580.3195 • W: envirohealth.org

DISTRICTWIDE LEAD IN DRINKING WATER SAMPLING AND REMEDIATION PLAN

2023-2025

MARCH 2024

REVISED JUNE 2024

ENVIROSCIENCE PROJECT #24498

Prepared for: WESTBURY UFSD
2 Hitchcock Lane
Old Westbury, New York 11568

Prepared by: ENVIROSCIENCE CONSULTANTS, LLC
2150 Smithtown Avenue
Ronkonkoma, New York 11779
(631) 580-3191

Project Manager: *Shannon Gallagher*

TABLE OF CONTENTS

<u>Section</u>	<u>Title</u>
1.0	Executive Summary
2.0	Sampling Methodology
3.0	Initial Results

Appendices

Appendix A	Drexel Avenue Elementary
Appendix B	Dryden Street Elementary School
Appendix C	Park Avenue Elementary School
Appendix D	Powells Lane Elementary School
Appendix E	Westbury Middle School
Appendix F	Westbury High School
Appendix G	Westbury Administration Building
Appendix H	Westbury Facilities Building

1.0 EXECUTIVE SUMMARY

The Westbury Union Free School District has developed their 2023-2025 Lead in Drinking Water Sampling and Remediation Plan, as required by the New York State Department of Health (Public Health Law Sections 1370-a and 1110, Subpart 67-Powells Lane Elementary School Lead Testing in School Drinking Water).

In accordance with the regulation, this Lead Remediation Plan is prepared to identify locations deemed as Applicable Drinking Water Sources and report first draw sample results, to mitigate locations where sample results exceed 5 parts per billion, to identify locations deemed as Non-Applicable Water Sources, communicate this designation to building occupants, and to develop strategies for monitoring locations deemed Non-Applicable Water Sources to insure building occupants do not consume water from these locations.

The following locations within the Westbury UFSD buildings have been deemed Applicable Drinking Water Sources by the administration:

- 1) Water fountains and bottle filling stations;
- 2) Kitchen water faucets and pot fillers used in food preparation;
- 3) Ice machines
- 4) Home Economics classroom sinks
- 5) Classroom sinks
- 6) Nurse's Office and Faculty Room sinks

First draw samples were collected from each of these locations within the District, and analyzed by a New York State Department of Health ELAP certified laboratory. The chains of custody are available upon request. For results at or below 5 ppb, no further action is required until 2025. For locations above 5 ppb, options include: second and third draw sample collection to determine source of lead, designation of the location as Non-applicable Water Source, or permanent removal of the fixture from the location. In either case, the result was communicated by Enviroscience Consultants, and the fixture was shut off by the District immediately upon receipt of results.

The following locations within the Westbury UFSD buildings were deemed Non-Applicable Water Sources by the administration:

- 1) Science Laboratory sinks
- 2) Art Room sinks
- 3) Technical Classroom sinks
- 4) Other Classroom sinks
- 5) Bathroom sinks
- 6) Outside spigots
- 7) Custodial Closet sinks
- 8) Mixed Valve sinks (or hot only)

In these cases, the Westbury UFSD staff have placed signs adjacent to the fixture to notify occupants that the water is not intended for consumption. To further support this protocol, the following management of the locations is required:

- 1) Science Laboratory sinks - communicate in writing with students that these locations are for science experiments and hand washing only, not for consumption. This is most easily accomplished by including this language in the laboratory safety paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective science teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 2) Art Room sinks - communicate in writing to students that these locations are for cleaning of art supplies and hand washing only, not for consumption. This is most easily accomplished by including this language in the course paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective art teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 3) Technical Classroom sinks - classrooms in this category often include wood shop or auto mechanics classrooms, where students are to hand wash after bathroom usage or activities as part of a regular hygiene program. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.

- 4) Other classroom sinks - classrooms in this category often include elementary classrooms, where students are to hand wash after bathroom usage or activities as part of a regular hygiene program. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 5) Bathroom sinks - in intermediate buildings, signage should be sufficient for communicating the concept of hand washing only. In elementary schools, personal hygiene should be integrated into curriculum to ensure students understand bathroom sinks are for hand washing only, and not consumption. Further, show what the signage looks like in bathrooms, so they learn to recognize its meaning. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 6) Outside spigots - all-weather signage will be installed at each location. Further, spigots will have a special key maintained by the custodial staff to ensure that non-authorized persons do not fill sports coolers or use hoses for consumption. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 7) Custodial Closet sinks - these locations should be accessed by custodial personnel only and locked when not in use. Access to others should be restricted. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 8) Mixed Valve sinks (or hot only) – per Public Health Law Sections 1370-a and 1110, Subpart 67-Powells Lane Elementary School Lead Testing in School Drinking Water mixed valve or hot water only sources are not required to be sampled. Signage is required for these sources. Signage should be sufficient for communicating the concept of hand washing only. In elementary schools, personal hygiene should be integrated into curriculum to ensure students understand bathroom sinks are for hand washing only, and not consumption. Further, show what the signage looks like so they learn to recognize its meaning. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.


All locations deemed non-applicable, but do not have signs, should be taken offline until signs have been posted. Signs are suggested to have pictures that instruct for handwashing only, do not drink.




2.0 SAMPLING METHODOLOGY

In accordance with the regulation, Enviroscience Consultants, LLC performed initial water sampling at the Westbury UFSD buildings. Samples were collected in wide-mouth 250 milliliter containers and were collected in the morning hours before the facilities opened. The water sources were not used for at least 8 hours and not more than 18 hours prior to sampling. Unique source numbers and designations were assigned to each source location. Unique sample identification numbers were assigned to each sample taken. The key to fixture type codes, source designations, and the sampling location schematics are shown below.

Code Key for Lead in Water			
Fixture Type Codes			
BF	Bottle Filler	SK	Sink
HB	Hose Bib	SL	Supply Line
IM	Ice Machine	SP	Spigot
OS	Other Source	SPY	Spray
PF	Pot Filler	SS	Slop Sink
		V	Valve
		WC	Water Cooler
		WF	Water Fountain
Source Designations			
App	Applicable	N/A	Non-applicable

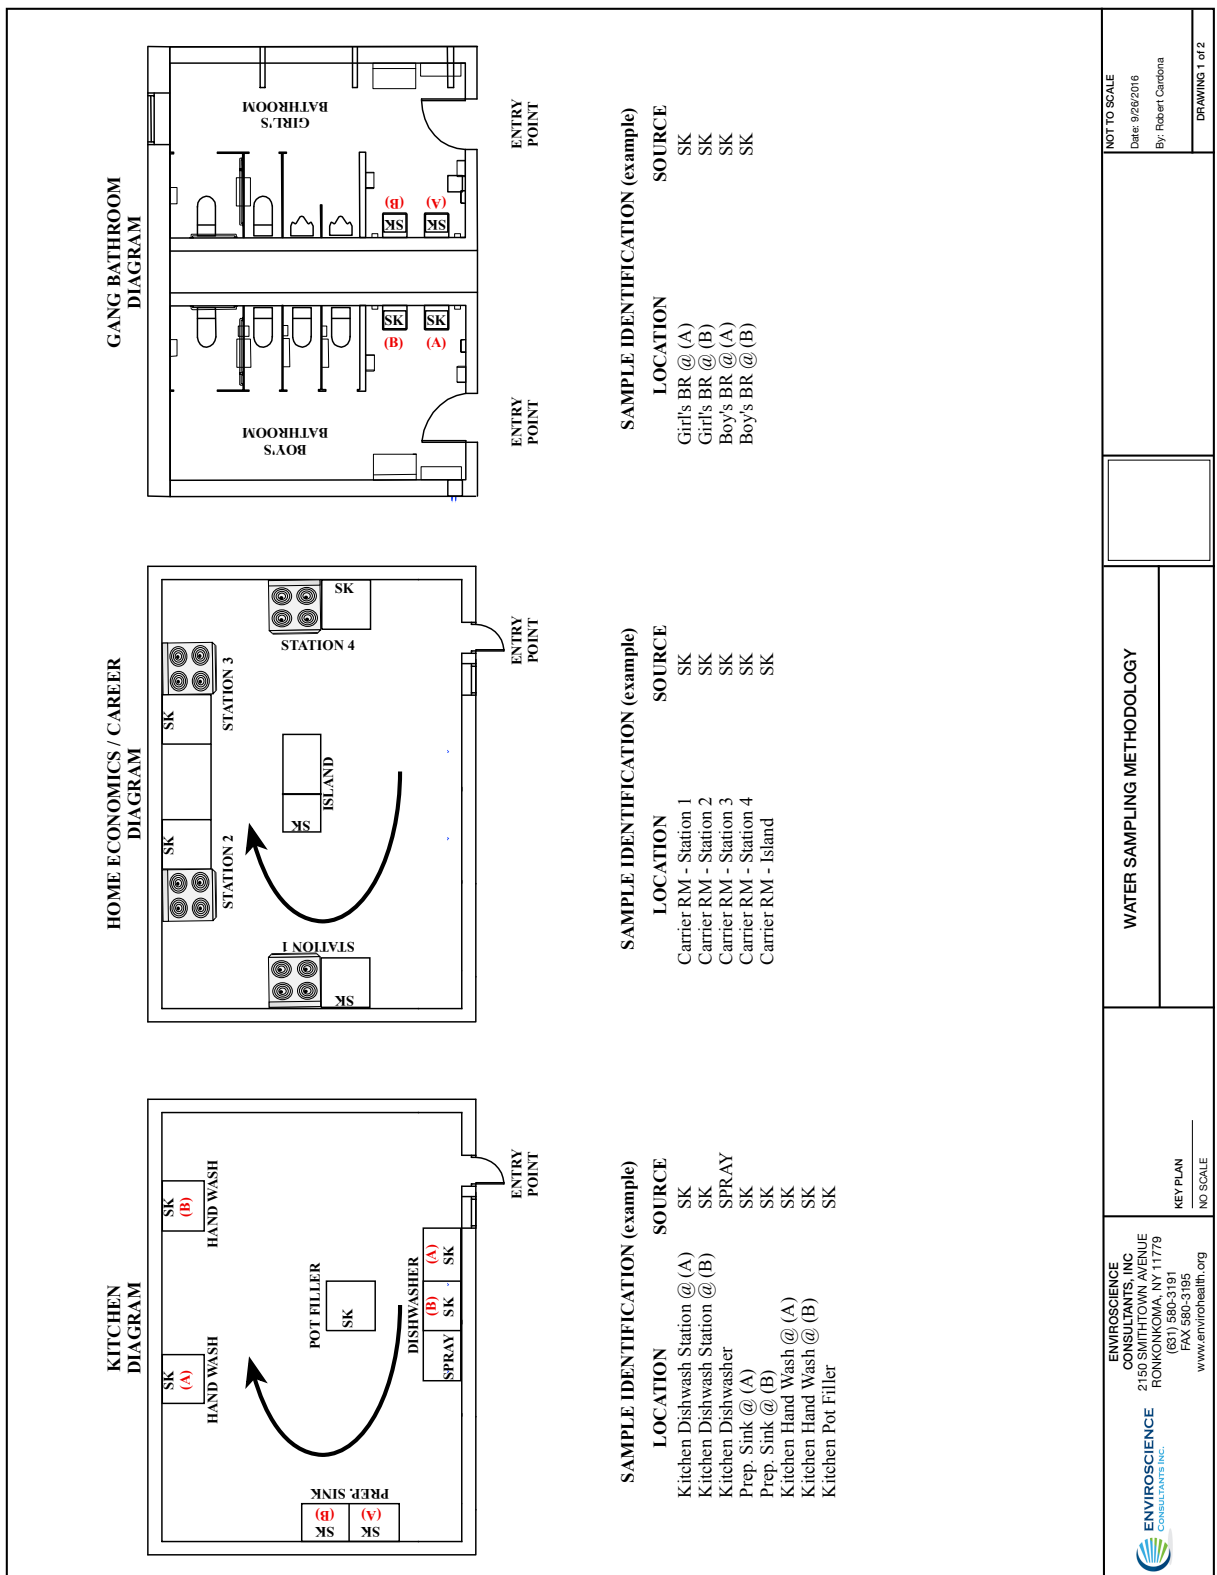

 <p>ENVIROSCIENCE CONSULTANTS, INC. 2150 SMITHTOWN AVENUE RONKONKOMA, NY 11779 (831) 580-3181 FAX 580-3185 www.envirohealth.org</p>	<p>KEY PLAN NO SCALE</p>	<p>WATER SAMPLING METHODOLOGY</p>	<p>NOT TO SCALE Date: 9/26/2016 By: Robert Cardona</p>
			<p>DRAWING 1 of 2</p>

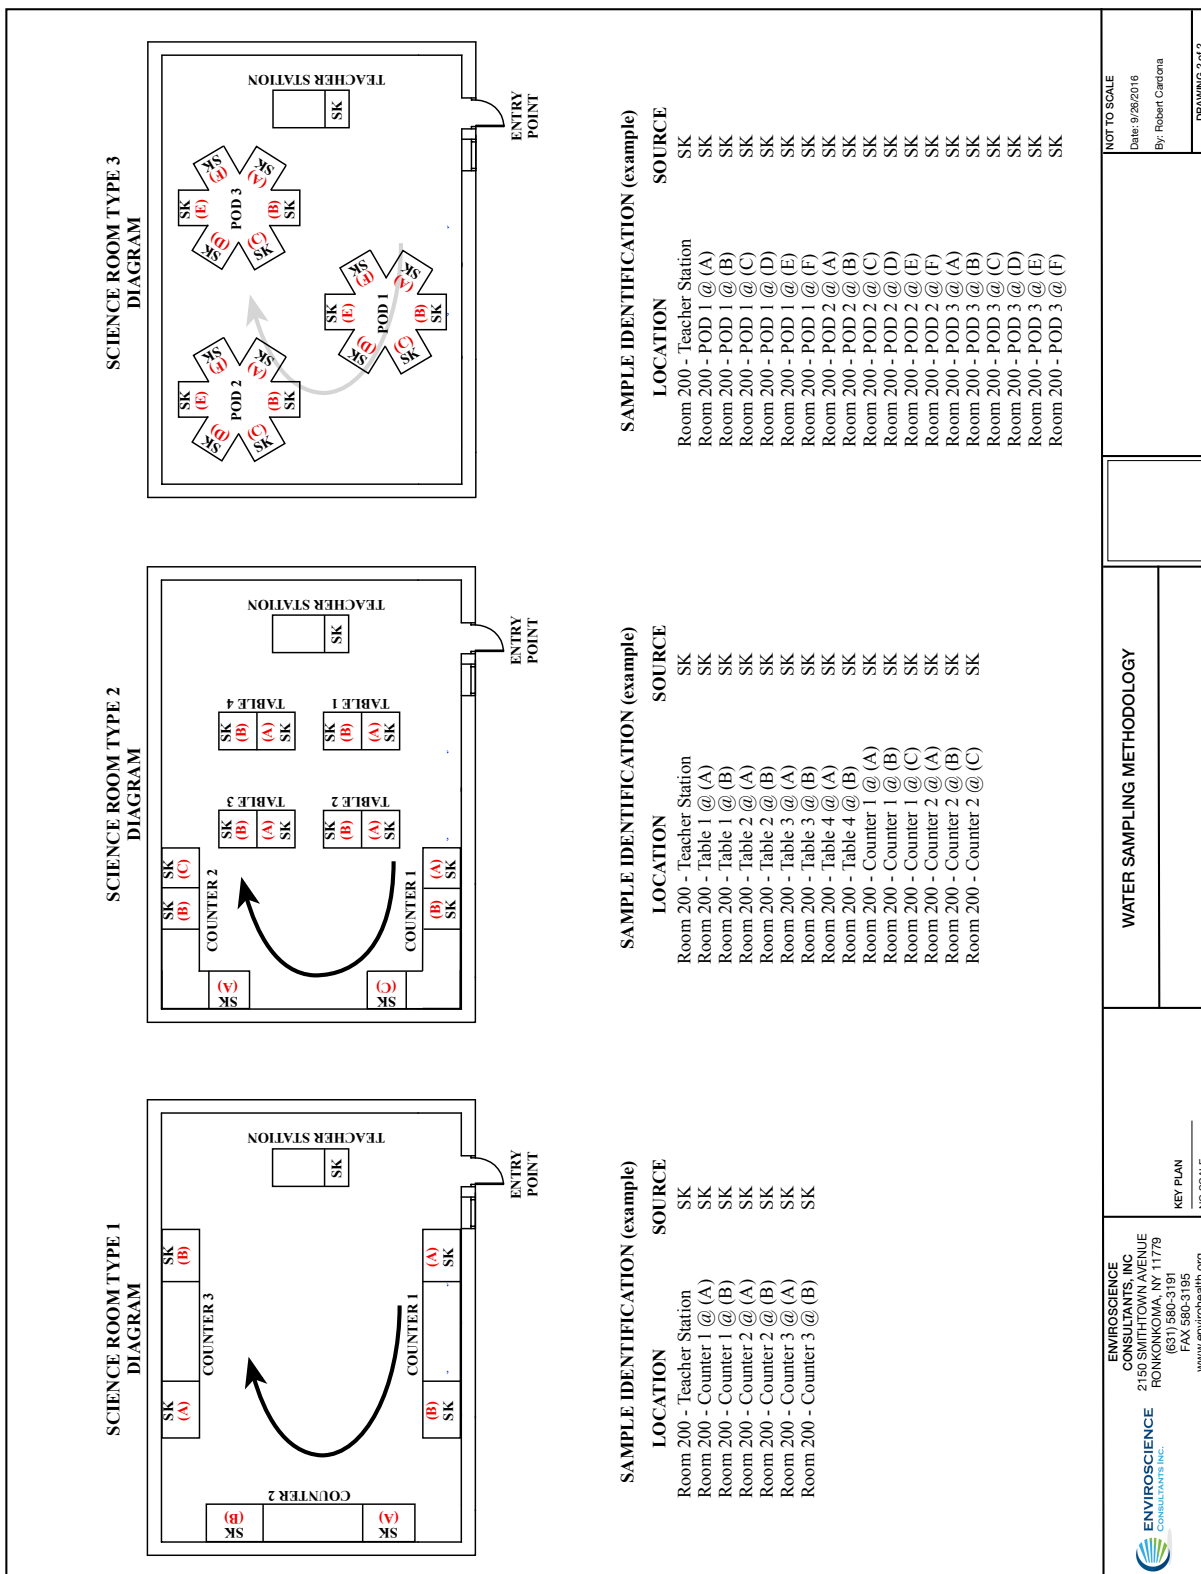

ENVIROSCIENCE CONSULTANTS, INC.
 2150 SMITHTOWN AVENUE
 RONKONKOMA, NY 11779
 (831) 580-3191
 FAX 580-3195
 www.envirohealth.org

KEY PLAN
 NO SCALE

WATER SAMPLING METHODOLOGY

NOT TO SCALE
 Date: 9/26/2016
 By: Robert Cardona
 DRAWING 2 of 2

3.0 Initial Results

All water source locations in each of the school buildings were assessed. Water source locations identified as drinking water sources were considered Applicable, and first draw samples were collected. Water source locations identified as non-drinking water sources were considered non-applicable and these locations were documented.

The results of the initial sampling and the use of signs warning against water use at non-applicable sources is documented in the School Water Outlet Inventory for each building.

All elevated locations should be taken off line until the remediation is completed. Any other drinking water sources in these buildings that were not functional at the time of initial sampling and have not been tested should be tested before returning to service. All locations deemed non-applicable, but do not have signs, should be taken offline until signs have been posted. Signs are suggested to have pictures that instruct for handwashing only, do not drink.

Drexel Avenue Elementary School

Sampling for was performed on June 25, 2024 for an elevated fixture at Drexel Avenue Elementary School. All elevated fixtures sampled passed.

Sampling for was performed on June 6, 2024 for a newly installed water fountain / bottle filler and elevated fixtures at Drexel Avenue Elementary School. Initial and flush samples were taken of the elevated fixtures. The majority of flush samples demonstrate that the issue is with the faucet with low lead levels at 15 seconds and 60 seconds. Storage Room 25 sink is the exception to this, and it is recommended that both the faucet and the water line from the wall to the sinks be replaced at this location.

Sampling was performed on May 21, 2024 for a newly installed water fountain / bottle filler and elevated fixtures at Drexel Avenue Elementary. Flush samples were taken of the elevated fixtures. The majority of flush samples demonstrate that the issue is with the faucet with low lead levels at 15 seconds and 60 seconds. Room 18 and Room 22 sinks are the exception to this and, it is recommended that both the faucet and the water line from the wall to the sinks be replaced at these locations.

Initial building wide sampling was performed on March 5, 2024 at Drexel Avenue Elementary School.

Dryden Street Elementary School

Sampling for was performed on June 25, 2024 for an elevated fixture at Dryden Street Elementary School. All elevated fixtures sampled passed.

Sampling for was performed on June 6, 2024 for two newly installed water fountain / bottle fillers and elevated fixtures at Dryden Street Elementary School. Initial and flush samples were taken of the elevated fixtures. The flush sample for the Principal's Office Kitchenette sink demonstrates that the issue is with the faucet with low lead levels at 15 seconds and 60 seconds.

Initial building wide sampling was performed on March 5, 2024 at Dryden Street Elementary School.

Park Avenue Elementary School

Sampling for was performed on June 7, 2024 for an elevated fixture at Park Avenue Elementary School. Initial and flush samples were taken of the elevated fixtures and all fixtures passed.

Sampling for was performed on June 6, 2024 for a newly installed water fountain / bottle filler and elevated fixtures at Park Avenue Elementary School . Initial and flush samples were taken of the elevated fixtures, and all fixtures passed.

Initial building wide sampling was performed on March 6, 2024 at Park Avenue Elementary School.

Powells Lane Elementary School

Sampling for was performed on June 6, 2024 for a newly installed water fountain / bottle filler and elevated fixtures at Park Avenue Elementary School. Initial and flush samples were taken of the elevated fixtures, and all fixtures passed.

Initial building wide sampling was performed on March 6, 2024 at Powells Lane Elementary

Westbury Middle School

Sampling for was performed on June 25, 2024 for an elevated fixture at Westbury Middle School. All elevated fixtures sampled passed.

Sampling for was performed on June 6, 2024 for a newly installed water fountain and elevated fixtures at Park Avenue Elementary. Initial and flush samples were taken of the elevated fixtures. The flush samples in Room 102 Home Economics sink A and sink B demonstrate that the issue is with the faucet with low lead levels at 15 seconds and 60 seconds.

Initial building wide sampling was performed on March 7, 2024 at Westbury Middle School.

Sampling was performed on December 20, 2023 for a newly installed bottle filler / water fountain at Westbury Middle School.

Westbury High School

Sampling was performed on June 6, 2024 for three newly installed water fountain / bottle fillers and elevated fixtures at Westbury High School. Flush samples were taken of the elevated fixtures. The majority of flush samples demonstrate that the issue is with the faucet with low lead levels at 15 seconds and 60 seconds. The Band Room sink is the exception to this and, it is recommended that both the faucet and the water line from the wall to the sinks be replaced at this location.

Initial building wide sampling was performed on March 7, 2024 at Westbury High School.

Westbury Administration Building

Initial building wide sampling was performed on March 8, 2024 at Westbury Administration Building.

Westbury Facilities Building

Initial building wide sampling was performed on March 8, 2024 at Westbury Facilities Building.

The following is a summary of results in parts per billion (ppb) of locations in the Westbury UFSD where sample results were found above 5 ppb:

Drexel Avenue Elementary				
AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
1001	Principal's Office Kitchenette - SK	5.0 ppb	5/21/2024	Remediation Complete
		11.0 ppb	3/5/2024	Removed from Service; Pending Remediation
	Principal's Office Kitchenette - SPY	34.0 ppb	6/6/2024	Removed from Service; Pending Remediation
		9.0 ppb	5/21/2024	Removed from Service; Pending Remediation
		8.0 ppb	3/5/2024	Removed from Service; Pending Remediation
1029	Room 38 - SK	1.0 ppb	5/21/2024	Remediation Complete
		9.0 ppb	3/5/2024	Removed from Service; Pending Remediation
1033	Room 31 - SK	3.0 ppb	5/21/2024	Remediation Complete
		8.0 ppb	3/5/2024	Removed from Service; Pending Remediation
1038A	Storage Room 25 - SK	2.0 ppb	6/6/24	15 second Flush Sampling had a result of 42.0 ppb. Removed from Service; Pending Remediation
		12.0 ppb	5/21/2024	Removed from Service; Pending Remediation
		27.0 ppb	3/5/2024	Removed from Service; Pending Remediation
	Storage Room 25 - WF	20.0 ppb	3/5/2024	Removed from Service; Waterline Turned Off
1045	Room 14 - SK	2.0 ppb	5/21/2024	Remediation Complete
		11.0 ppb	3/5/2024	Removed from Service; Pending Remediation

Drexel Avenue Elementary

AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS	
1047	Room 18 - SK	<1.0 ppb	6/25/2024	Remediation Complete	
		8.0 ppb	6/6/2024	Removed from Service; Pending Remediation	
		30.0 ppb	5/21/2024	Removed from Service; Pending Remediation	
		8.0 ppb	3/5/2024	Removed from Service; Pending Remediation	
1047	Room 18 - WF	30.0 ppb	3/5/2024	Removed from Service; Pending Remediation	
New Addition	Room 22 - SK	<1.0 ppb	6/6/2024	Remediation Complete	
		39.0 ppb	5/21/2024	Removed from Service; Pending Remediation	
		8.0 ppb	3/5/2024	Removed from Service; Pending Remediation	
	Room 24 - SK	3.0 ppb	6/6/2024	Remediation Complete	
		39.0 ppb	5/21/2024	Removed from Service; Pending Remediation	
		9.0 ppb	3/5/2024	Removed from Service; Pending Remediation	
	Room 23 - SK	<1.0	6/25/2024	Remediation Complete	
		9.0 ppb	6/6/2024	Removed from Service; Pending Remediation	
		6.0 ppb	5/21/2024	Removed from Service; Pending Remediation	
		6.0 ppb	3/5/2024	Removed from Service; Pending Remediation	
	1052	Room 17 - SK	3.0 ppb	6/6/2024	Remediation Complete
			7.0 ppb	5/21/2024	Removed from Service; Pending Remediation
14.0 ppb			3/5/2024	Removed from Service; Pending Remediation	
Room 17 - WF		1.0 ppb	5/21/2024	Remediation Complete	
		11.0 ppb	3/5/2024	Removed from Service; Pending Remediation	

Drexel Avenue Elementary

AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
1051	Room 15 - SK	3.0 ppb	5/21/2024	Remediation Complete
		9.0 ppb	3/5/2024	Removed from Service; Pending Remediation

Dryden Street Elementary School

AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
1004	Principals Office Kitchenette - SK	<1.0 ppb	6/25/2024	Remediation Complete
		11.0 ppb	6/6/2024	Removed from Service; Pending Remediation
		8.0 ppb	3/6/2024	Removed from Service; Pending Remediation
1007	Nurses Office - SPY	<1.0 ppb	6/6/2024	Remediation Complete
		165.0 ppb	3/6/2024	Removed from Service; Pending Remediation

Park Avenue Elementary School

AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
New Addition	Room 20 – SK	1.0 ppb	6/6/2024	Remediation Complete
		6.0 ppb	3/6/2024	Removed from Service; Pending Remediation
1001	Assistant Principal's Office - SK	4.0 ppb	6/6/2024	Remediation Complete
		10.0 ppb	3/6/2024	Removed from Service; Pending Remediation

Powells Lane Elementary School

AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
1001	Nurse's Office - SK	4.0 ppb	6/6/2024	Remediation Complete
		6.0 ppb	3/6/2024	Removed from Service; Pending Remediation
2002	Room "F" - SK	1.0 ppb	6/6/2024	Remediation Complete
		6.0 ppb	3/6/2024	Removed from Service; Pending Remediation
1012	Library Room 9 Kitchenette - SK	2.0 ppb	6/6/2024	Remediation Complete
		6.0 ppb	3/6/2024	Removed from Service; Pending Remediation

Westbury Middle School

AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
New Addition	Kitchen Steamer - SK	<1.0 ppb	6/6/2024	Remediation Complete
		29.0 ppb	3/7/2024	Removed from Service; Pending Remediation
	Kitchen Potfiller - PF	5.0 ppb	6/6/2024	Remediation Complete
		19.0 ppb	3/7/2024	Removed from Service; Pending Remediation
1008	Room 102-Home Economics @A - SK	<1.0	6/25/2024	Remediation Complete
		6.0 ppb	6/6/2024	Removed from Service; Pending Remediation
		6.0 ppb	3/7/2024	Removed from Service; Pending Remediation
	Room 102-Home Economics @B - SK	<1.0	6/25/2024	Remediation Complete
		12.0 ppb	6/6/2024	Removed from Service; Pending Remediation
		8.0 ppb	3/7/2024	Removed from Service; Pending Remediation

Westbury High School

AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
1073B	Kitchen Prep in Corner - SK	6.0 ppb	3/7/2024	Mixed Valve and Sign; Remediation Complete
1074B	Band Room - SK	5.0 ppb	6/6/2024	60 second Flush Sampling had a result of 6.0 ppb. Removed from Service; Pending Remediation
		21.0 ppb	3/7/2024	Removed from Service; Pending Remediation
	Band Room Office - SK	4.0 ppb	6/6/2024	Remediation Complete
		10.0 ppb	3/7/2024	Removed from Service; Pending Remediation

Westbury Administration Building

AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
-	No Elevated Fixtures	-	-	-

Westbury Facilities Building

AHERA SPACE #	SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
-	No Elevated Fixtures	-	-	-

Appendix A
Drexel Avenue Elementary

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0003A	0001-01	Basement Bathroom by Custodial Kitchenette	SS	N/A		3/5/2024	-	-	-	Sign
-	0001-02	Basement	SS	N/A		3/5/2024	-	-	-	Sign
-	0001-03	Basement	SP	App	<1.0	5/21/2024	-	-	-	-
1004	1001-01	Kitchen	IM	App	1.0	3/5/2024	-	-	-	-
	1001-02	Kitchen 3-Bay Left	SK	App	2.0	3/5/2024	-	-	-	-
	1001-03	Kitchen 3-Bay Right	SK	App	<1.0	3/5/2024	-	-	-	-
	1001-04	Kitchen Island	SK	App	2.0	3/5/2024	-	-	-	-
	1001-05	Kitchen Handwashing	SK	N/A		3/5/2024	-	-	-	Sign
1000	1002-01	Main Lobby Bathroom	SK	N/A		3/5/2024	-	-	-	Sign
1001	1003-01	Principal's Office Kitchenette	SK	App	5.0	5/21/2024	<1.0	<1.0	5/21/2024	Remediation Complete
					11.0	3/5/2024				Removed from Service; Pending Remediation
	1003-02	Principal's Office Kitchenette	SPY	App	34.0	6/6/2024	2.0	<1.0	6/6/2024	Removed from Service; Pending Remediation
					9.0	5/21/2024	<1.0	<1.0	5/21/2024	Removed from Service; Pending Remediation
					8.0	3/5/2024				Removed from Service; Pending Remediation
1007	1004-01	Room 7 Bathroom	SK	N/A		3/5/2024	-	-	-	Sign
1018	1005-01	Hall by Room 7	BF	App	<1.0	3/5/2024	-	-	-	-
	1005-02	Hall by Room 7	WF	App	<1.0	3/5/2024	-	-	-	-
1009	1006-01	Faculty Room	SK	App	2.0	3/5/2024	-	-	-	-
1018	1007-01	Hall by Auditorium	WF	App	<1.0	3/5/2024	-	-	-	-
	1007-02	Hall by Auditorium	BF	App	<1.0	5/21/2024	-	-	-	-
	1007	Hall by Auditorium	WF	N/A		5/21/2024	-	-	-	Removed from Service; Renovated Spring 2024

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1017	1008-01	Room 44 Custodial Storage	SS	N/A		3/5/2024	-	-	-	Sign
1017A	1009-01	Room 45	SK	App	1.0	3/5/2024	-	-	-	-
1016	1010-01	Room 26	SK	App	3.0	3/5/2024	-	-	-	-
1019	1011-01	Men's Faculty Bathroom by Room 26	SK	N/A		3/5/2024	-	-	-	Sign
1039	1012-01	Hall by Room 26	BF	App	<1.0	3/5/2024	-	-	-	-
	1012-02	Hall by Room 26	WF	App	<1.0	3/5/2024	-	-	-	-
1020	1013-01	Women's Faculty Bathroom by Room 26	SK	N/A		3/5/2024	-	-	-	Sign
1021A	1014-01	Boy's Bathroom by Room 28 Left	SK	N/A		3/5/2024	-	-	-	Sign
	1014-02	Boy's Bathroom by Room 28 Left Middle	SK	N/A		3/5/2024	-	-	-	Sign
	1014-03	Boy's Bathroom by Room 28 Right Middle	SK	N/A		3/5/2024	-	-	-	Sign
	1014-04	Boy's Bathroom by Room 28 Right	SK	N/A		3/5/2024	-	-	-	Sign
1023A	1015-01	Girl's Bathroom by Room 28 Left	SK	N/A		3/5/2024	-	-	-	Sign
	1015-02	Girl's Bathroom by Room 28 Left Middle	SK	N/A		3/5/2024	-	-	-	Sign
	1015-03	Girl's Bathroom by Room 28 Right Middle	SK	N/A		3/5/2024	-	-	-	Sign
	1015-04	Girl's Bathroom by Room 28 Right	SK	N/A		3/5/2024	-	-	-	Sign
1024	1016-01	Room 28	SK	App	1.0	3/5/2024	-	-	-	-
	1016-02	Room 28	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1025	1017-01	Room 30	SK	App	3.0	3/5/2024	-	-	-	-
	1017-02	Room 30	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1026	1018-01	Room 32	SK	App	3.0	3/5/2024	-	-	-	-

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1026	1018-02	Room 32	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1027	1019-01	Room 34	SK	App	<1.0	3/5/2024	-	-	-	-
	1019-02	Room 34	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1028	1020-01	Room 36	SK	App	<1.0	3/5/2024	-	-	-	-
	1020-02	Room 36	WF	App	<1.0	3/5/2024	-	-	-	-
1029	1021-01	Room 38	SK	App	1.0	5/21/2024	-	-	-	Remediation Complete
					9.0	3/5/2024				Removed from Service; Pending Remediation
	1021-02	Room 38	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1030	1022-01	Room 39	SK	App	<1.0	3/5/2024	-	-	-	-
	1022-02	Room 39	WF	App	<1.0	3/5/2024	-	-	-	-
1031	1023-01	Room 37	SK	App	<1.0	3/5/2024	-	-	-	-
1032	1024-01	Room 35	SK	App	<1.0	3/5/2024	-	-	-	-
	1025-01	Room 33	SK	App	<1.0	3/5/2024	-	-	-	-
1033	1026-01	Room 31	SK	App	3.0	5/21/2024	-	-	-	Remediation Complete
					8.0	3/5/2024				Removed from Service; Pending Remediation
	1026-02	Room 31	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1034	1027-01	Room 29	SK	App	<1.0	3/5/2024	-	-	-	-
	1027-02	Room 29	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1038A	1028-01	Storage Room 25	SK	App	2.0	6/6/2024	42.0	3.0	6/6/2024	15 second flush sample had a result of 42 ppb. Removed from Service; Pending Remediation
					12.0	5/21/2024	1.0	1.0	5/21/2024	Removed from Service; Pending Remediation
					27.0	3/5/2024				Removed from Service; Pending Remediation

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1038A	1028-02	Storage Room 25	WF	App	20.0	3/5/2024				Remediation Complete Removed from Service; Waterline Turned Off
1043A	1029-01	Room 10 Bathroom	SK	N/A		3/5/2024	-	-	-	Sign
1043	1029-02	Room 12	SK	App	5.0	3/5/2024	-	-	-	-
	1029-03	Room 12	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1045	1030-01	Room 14	SK	App	2.0	5/21/2024	-	-	-	Remediation Complete
					11.0	3/5/2024				Removed from Service; Pending Remediation
1045	1030-02	Room 14	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1053	1055-01	Hall by Room 14	WF	App	<1.0	6/6/2024	-	-	-	-
	1055-02	Hall by Room 14	BF	App	<1.0	6/6/2024	-	-	-	-
1045	1031-01	Room 16	SK	App	4.0	3/5/2024	-	-	-	-
	1031-02	Room 16	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1047	1032-01	Room 18	SK	App	<1.0	6/25/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					8.0	6/6/2024	<1.0	<1.0	6/6/2024	Removed from Service; Pending Remediation
					30.0	5/21/2024	113.0	4.0	5/21/2024	Removed from Service; Pending Remediation
					8.0	3/5/2024				Removed from Service; Pending Remediation
	1032-02	Room 18	WF	App	30.0	3/5/2024				Removed from Service; Pending Remediation
New Addition	1034-01	Room 22	SK	App	<1.0	6/6/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					39.0	5/21/2024	9.0	3.0	5/21/2024	Removed from Service; Pending Remediation
					8.0	3/5/2024				Removed from Service; Pending Remediation
	1035-01	Room 24	SK	App	3.0	6/6/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					39.0	5/21/2024	2.0	1.0	5/21/2024	Removed from Service; Pending Remediation
					9.0	3/5/2024				Removed from Service; Pending Remediation

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
New Addition	1036-01	Room 23	SK	App	<1.0	6/25/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					9.0	6/6/2024	<1.0	<1.0	6/6/2024	Removed from Service; Pending Remediation
					6.0	5/21/2024	1.0	<1.0	5/21/2024	Removed from Service; Pending Remediation
					6.0	3/5/2024				Removed from Service; Pending Remediation
	1037-01	Room 21	SK	App	5.0	3/5/2024	-	-	-	-
1052	1038-01	Room 17	SK	App	3.0	6/6/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					7.0	5/21/2024	<1.0	<1.0	5/21/2024	Removed from Service; Pending Remediation
					14.0	3/5/2024				Removed from Service; Pending Remediation
	1038-02	Room 17	WF	App	1.0	5/21/2024	-	-	-	Remediation Complete
					11.0	3/5/2024				Removed from Service; Pending Remediation
1051	1039-01	Room 15	SK	App	3.0	5/21/2024	-	-	-	Remediation Complete
					9.0	3/5/2024				Removed from Service; Pending Remediation
	1039-02	Room 15	WF	App		3/5/2024	-	-	-	Non-functional; Sampling Required
1048	1040-01	Room 13 Bathroom	SK	N/A		3/5/2024	-	-	-	Sign
1046	1041-01	Room 11 Library	SK	App	2.0	3/5/2024	-	-	-	-
	1041-02	Room 11 Library Bathroom	SK	N/A		3/5/2024	-	-	-	Sign
1044	1042-01	Girl's Bathroom by Room 10 Left	SK	N/A		3/5/2024	-	-	-	Sign
	1042-02	Girl's Bathroom by Room 10 Right	SK	N/A		3/5/2024	-	-	-	Sign
1042	1043-01	Custodial Closet by Room 10	SS	N/A		3/5/2024	-	-	-	Sign
1041	1044-01	Boy's Bathroom by Room 10 Left	SK	N/A		3/5/2024	-	-	-	Sign
	1044-02	Boy's Bathroom by Room 10 Middle	SK	N/A		3/5/2024	-	-	-	Sign
	1044-03	Boy's Bathroom by Room 10 Right	SK	N/A		3/5/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1045	1045-01	Nurse's Office Bathroom	SK	N/A		3/5/2024	-	-	-	Sign
	1045-02	Nurse's Office	SK	App	<1.0	3/5/2024	-	-	-	-

Laboratory Report
NYE Report #: 2401277-28744

March 11, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Drexel Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on March 07, 2024. New York Environmental analyzed the samples on March 08, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	05 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R068	1	Kitchen-IM, Initial	0.001	0.001	mg/L	
240307R069	2	Kitchen 3-Bay Left-SK, Initial	0.001	0.002	mg/L	
240307R070	3	Kitchen 3-Bay Right-SK, Initial	0.001	<0.001	mg/L	
240307R071	4	Kitchen Island-SK, Initial	0.001	0.002	mg/L	
240307R072	5	Principal's Office Kitchenette-SK, Initial	0.001	0.011	mg/L	H
240307R073	6	Hall by Room 7-BF, Initial	0.001	<0.001	mg/L	
240307R074	7	Hall by Room 7-WF, Initial	0.001	<0.001	mg/L	
240307R075	8	Faculty Room-SK, Initial	0.001	0.002	mg/L	
240307R076	9	Room 45-SK, Initial	0.001	0.001	mg/L	
240307R077	10	Room 26-SK, Initial	0.001	0.003	mg/L	
240307R078	11	Hall by Room 26-BF, Initial	0.001	<0.001	mg/L	
240307R079	12	Hall by Room 26-WF, Initial	0.001	<0.001	mg/L	
240307R080	13	Room 28-SK, Initial	0.001	0.001	mg/L	
240307R081	14	Room 30-SK, Initial	0.001	0.003	mg/L	
240307R082	15	Room 32-SK, Initial	0.001	0.003	mg/L	
240307R083	16	Room 34-SK, Initial	0.001	<0.001	mg/L	
240307R084	17	Room 36-SK, Initial	0.001	<0.001	mg/L	
240307R085	18	Room 36-WF, Initial	0.001	<0.001	mg/L	
240307R086	19	Room 38-SK, Initial	0.001	0.009	mg/L	H
240307R087	20	Room 39-SK, Initial	0.001	<0.001	mg/L	
240307R088	21	Room 39-WF, Initial	0.001	<0.001	mg/L	
240307R089	22	Room 37-SK, Initial	0.001	<0.001	mg/L	
240307R090	23	Room 35-SK, Initial	0.001	<0.001	mg/L	
240307R091	24	Room 33-SK, Initial	0.001	<0.001	mg/L	
240307R092	25	Room 31-SK, Initial	0.001	0.008	mg/L	H
240307R093	26	Room 29-SK, Initial	0.001	<0.001	mg/L	
240307R094	27	Storage Room 25-SK, Initial	0.001	0.027	mg/L	H



Date Collected:	05 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R095	28	Storage Room 25-WF, Initial	0.001	0.020	mg/L	H
240307R096	29	Room 12-SK, Initial	0.001	0.005	mg/L	
240307R097	30	Room 14-SK, Initial	0.001	0.011	mg/L	H
240307R098	31	Room 16-SK, Initial	0.001	0.004	mg/L	
240307R099	32	Room 18-SK, Initial	0.001	0.008	mg/L	H
240307R100	33	Room 18-SK, Initial	0.001	0.030	mg/L	H
240307R101	34	Room 22-SK, Initial	0.001	0.008	mg/L	H
240307R102	35	Room 24-SK, Initial	0.001	0.009	mg/L	H
240307R103	36	Room 23-SK, Initial	0.001	0.006	mg/L	H
240307R104	37	Room 21-SK, Initial	0.001	0.005	mg/L	
240307R105	38	Room 17-SK, Initial	0.001	0.014	mg/L	H
240307R106	39	Room 17-WF, Initial	0.001	0.011	mg/L	H
240307R107	40	Room 15-SK, Initial	0.001	0.009	mg/L	H
240307R108	41	Room 11 Library-SK, Initial	0.001	0.002	mg/L	
240307R109	42	Nurse's Office-SK, Initial	0.001	<0.001	mg/L	
240307R110	43	Principal's Office Kitchenette-SPY, Initial	0.001	0.008	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2403367-29809

May 24, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Drexel Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on May 22, 2024. New York Environmental analyzed the samples on May 23, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	21 May 2024
Date Received:	22 May 2024
Date Analyzed:	23 May 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240522O001	1A	Basement-SP, Initial	0.001	<0.001	mg/L	
240522O002	2A	Principal's Office Kitchenette-SK, Initial	0.001	0.005	mg/L	
240522O003	2B	Principal's Office Kitchenette-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240522O004	2C	Principal's Office Kitchenette-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240522O005	3A	Principal's Office Kitchenette-SPY, Initial	0.001	0.009	mg/L	H
240522O006	3B	Principal's Office Kitchenette-SPY, 15 Sec Flush	0.001	<0.001	mg/L	
240522O007	3C	Principal's Office Kitchenette-SPY, 60 Sec Flush	0.001	<0.001	mg/L	
240522O008	4A	Hall by Auditorium-WF, Initial	0.001	<0.001	mg/L	
240522O009	5A	Hall by Auditorium-BF, Initial	0.001	<0.001	mg/L	
240522O010	6A	Storage Room 25-SK, Initial	0.001	0.012	mg/L	H
240522O011	6B	Storage Room 25-SK, 15 Sec Flush	0.001	0.001	mg/L	
240522O012	6C	Storage Room 25-SK, 60 Sec Flush	0.001	0.001	mg/L	
240522O013	7A	Room 31-SK, Initial	0.001	0.003	mg/L	
240522O014	7B	Room 31-SK, 15 Sec Flush	0.001	NA	mg/L	
240522O015	7C	Room 31-SK, 60 Sec Flush	0.001	NA	mg/L	
240522O016	8A	Room 38-SK, Initial	0.001	0.001	mg/L	
240522O017	8B	Room 38-SK, 15 Sec Flush	0.001	NA	mg/L	
240522O018	8C	Room 38-SK, 60 Sec Flush	0.001	NA	mg/L	
240522O019	9A	Room 14-SK, Initial	0.001	0.002	mg/L	
240522O020	9B	Room 14-SK, 15 Sec Flush	0.001	NA	mg/L	
240522O021	9C	Room 14-SK, 60 Sec Flush	0.001	NA	mg/L	
240522O022	10A	Room 18-SK, Initial	0.001	0.030	mg/L	H
240522O023	10B	Room 18-SK, 15 Sec Flush	0.001	0.113	mg/L	E,H
240522O024	10C	Room 18-SK, 60 Sec Flush	0.001	0.004	mg/L	
240522O025	11A	Room 22-SK, Initial	0.001	0.039	mg/L	H
240522O026	11B	Room 22-SK, 15 Sec Flush	0.001	0.009	mg/L	H



Date Collected:	21 May 2024
Date Received:	22 May 2024
Date Analyzed:	23 May 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240522O027	11C	Room 22-SK, 60 Sec Flush	0.001	0.003	mg/L	
240522O028	12A	Room 24-SK, Initial	0.001	0.039	mg/L	H
240522O029	12B	Room 24-SK, 15 Sec Flush	0.001	0.002	mg/L	
240522O030	12C	Room 24-SK, 60 Sec Flush	0.001	0.001	mg/L	
240522O031	13A	Room 23-SK, Initial	0.001	0.006	mg/L	H
240522O032	13B	Room 23-SK, 15 Sec Flush	0.001	0.001	mg/L	
240522O033	13C	Room 23-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240522O034	14A	Room 17-SK, Initial	0.001	0.007	mg/L	H
240522O035	14B	Room 17-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240522O036	14C	Room 17-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240522O037	15A	Room 17-WF, Initial	0.001	0.001	mg/L	
240522O038	15B	Room 17-WF, 15 Sec Flush	0.001	NA	mg/L	
240522O039	15C	Room 17-WF, 60 Sec Flush	0.001	NA	mg/L	
240522O040	16A	Room 15-SK, Initial	0.001	0.003	mg/L	
240522O041	16B	Room 15-SK, 15 Sec Flush	0.001	NA	mg/L	
240522O042	16C	Room 15-SK, 60 Sec Flush	0.001	NA	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

NA: Sample not analyzed per customer request.

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

NYE Report #: 2403804-30070

June 10, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Drexel Elementary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 06, 2024. New York Environmental analyzed the samples on June 10, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	06 Jun 2024
Date Received:	06 Jun 2024
Date Analyzed:	10 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240606Q006	1A	Principal's Office Kitchenette-SPY, Initial	0.001	0.034	mg/L	H
240606Q007	1B	Principal's Office Kitchenette-SPY, 15 Sec Flush	0.001	0.002	mg/L	
240606Q008	1C	Principal's Office Kitchenette-SPY, 60 Sec Flush	0.001	<0.001	mg/L	
240606Q009	2A	Storage Room 25-SK, Initial	0.001	0.002	mg/L	
240606Q010	2B	Storage Room 25-SK, 15 Sec Flush	0.001	0.042	mg/L	H
240606Q011	2C	Storage Room 25-SK, 60 Sec Flush	0.001	0.003	mg/L	
240606Q012	3	Hall by Room 14-WF, Initial	0.001	<0.001	mg/L	
240606Q013	4	Hall by Room 14-BF, Initial	0.001	<0.001	mg/L	
240606Q014	5A	Room 18-SK, Initial	0.001	0.008	mg/L	H
240606Q015	5B	Room 18-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606Q016	5C	Room 18-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240606Q017	6A	Room 22-SK, Initial	0.001	<0.001	mg/L	
240606Q018	6B	Room 22-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606Q019	6C	Room 22-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240606Q020	7A	Room 24-SK, Initial	0.001	0.003	mg/L	
240606Q021	7B	Room 24-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606Q022	7C	Room 24-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240606Q023	8A	Room 23-SK, Initial	0.001	0.009	mg/L	H
240606Q024	8B	Room 23-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606Q025	8C	Room 23-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240606Q026	9A	Room 17-SK, Initial	0.001	0.003	mg/L	
240606Q027	9B	Room 17-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606Q028	9C	Room 17-SK, 60 Sec Flush	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

NYE Report #: 2404345-30417

June 27, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Drexel Avenue Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 26, 2024. New York Environmental analyzed the samples on June 27, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	25 Jun 2024
Date Received:	26 Jun 2024
Date Analyzed:	27 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240626Q001	1A	Room 18-SK, Initial	0.001	<0.001	mg/L	
240626Q002	1B	Room 18-SK, 15 Sec Flush	0.001	NA	mg/L	
240626Q003	1C	Room 18-SK, 60 Sec Flush	0.001	NA	mg/L	
240626Q004	2A	Room 23-SK, Initial	0.001	<0.001	mg/L	
240626Q005	2B	Room 23-SK, 15 Sec Flush	0.001	NA	mg/L	
240626Q006	2C	Room 23-SK, 60 Sec Flush	0.001	NA	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

NA: Sample not analyzed per customer request.

Appendix B
Dryden Street Elementary School

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001	1001-1	Kitchen 2 Bay (Left)	SK	App	<1.0	3/6/2024	-	-	-	-
	1001-2	Kitchen 2 Bay (Right)	SK	App	<1.0	3/6/2024	-	-	-	-
1003	1002-1	Faculty Bathroom by Main Entrance	SK	N/A		3/6/2024	-	-	-	Sign
1002	1003-1	Custodial Closet by Main Entrance	SS	N/A		3/6/2024	-	-	-	Sign
1004	1004-1	Principals Office Kitchenette	SK	App	<1.0	6/25/2024				Remediation Complete
					11.0	6/6/2024	2.0	1.0	6/6/2024	Removed from Service; Pending Remediation
					8.0	3/6/2024				Removed from Service; Pending Remediation
1006	1005-1	Student Unisex Bathroom by Kitchen	SK	N/A		3/6/2024	-	-	-	Sign
1007	1006-1	Nurses Office	SK	App	2.0	3/6/2024	-	-	-	-
	1006-2	Nurses Office	SPY	App	<1.0	6/6/2024	2	2	6/6/2024	Remediation Complete
165.0					3/6/2024				Removed from Service; Pending Remediation	
1007A	1006-3	Nurses Office Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1009	1007-1	Registration Office	SK	App	4.0	3/6/2024	-	-	-	-
	1007-2	Registration Office Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1010	1008-1	Room 1	SK	App	4.0	3/6/2024	-	-	-	-
	1008-2	Room 1 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1016	1009-1	Room 3	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1009-2	Room 3	SK	App	2.0	3/6/2024	-	-	-	-
1016A	1009-3	Room 3 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1015	1010-1	Room 2	SK	App	<1.0	3/6/2024	-	-	-	-

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1015A	1010-2	Room 2 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1016	1011-1	Room 5	SK	App	2.0	3/6/2024	-	-	-	-
1016A	1011-2	Room 5 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1023	1012-1	Hall by Room 4	WF	App	<1.0	3/6/2024	-	-	-	-
	1012-2	Hall by Room 4	BF	App	<1.0	3/6/2024	-	-	-	-
1017	1013-1	Room 4	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1013-2	Room 4	SK	App	2.0	3/6/2024	-	-	-	-
1017A	1013-3	Room 4 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1018	1014-1	Room 7	SK	App	<1.0	3/6/2024	-	-	-	-
1018A	1014-2	Room 7 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1019	1015-1	Room 9	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
1019A	1015-2	Room 9	SK	App	1.0	3/6/2024	-	-	-	-
1025	1016-1	Faculty Bathroom by Room 13	SK	N/A		3/6/2024	-	-	-	Sign
1026	1017-1	Custodial Office by Room 13	SS	N/A		3/6/2024	-	-	-	Sign
1037	1018-1	Hall by Room 13	WF	App	<1.0	6/6/2024	-	-	-	-
	1018-2	Hall by Room 13	BF	App	<1.0	6/6/2024	-	-	-	-
	1018	Hall by Room 13	WF	N/A		3/6/2024	-	-	-	Removed from Service; Renovated
1027	1019-1	Student Unisex Bathroom by Room 13	SK	N/A		3/6/2024	-	-	-	Sign
1029	1020-1	Room 13	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1020-2	Room 13	SK	App	<1.0	3/6/2024	-	-	-	-

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1029B	1020-3	Room 13 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1031	1021-1	Room 10	SK	App	<1.0	3/6/2024	-	-	-	-
1032	1022-1	Room 12	SK	App	<1.0	3/6/2024	-	-	-	-
1033	1023-1	Room 15	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1023-2	Room 15	SK	App	<1.0	3/6/2024	-	-	-	-
1033A	1023-3	Room 15 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1035	1024-1	Room 14	SK	App	2.0	3/6/2024	-	-	-	-
1021	1025-1	Room 6	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1025-2	Room 6	SK	App	3.0	3/6/2024	-	-	-	-
1020	1026-1	Room 11	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1026-2	Room 11	SK	App	1.0	3/6/2024	-	-	-	-
1023	1027-1	Hall by Room 6	WF	App	<1.0	6/6/2024	-	-	-	-
	1027-2	Hall by Room 6	BF	App	<1.0	6/6/2024	-	-	-	-
	1027	Hall by Room 6	WF	N/A		3/6/2024	-	-	-	Removed from Service; Renovated
1022	1028-1	Room 8	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1028-2	Room 8	SK	App	<1.0	3/6/2024	-	-	-	-
New Addition	1029-1	Room "D" Bathroom	SK	App	<1.0	3/6/2024	-	-	-	-
	1030-1	Room "E" Bathroom	SK	App	<1.0	3/6/2024	-	-	-	-
	1031-1	Room "F" Bathroom	SK	App	<1.0	3/6/2024	-	-	-	-
	1032-1	Room "G" Bathroom	SK	App	<1.0	3/6/2024	-	-	-	-

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
New Addition	1033-1	Room "C" Bathroom	SK	App	<1.0	3/6/2024	-	-	-	-
	1034-1	Room "B" Bathroom	SK	App	<1.0	3/6/2024	-	-	-	-
	1035-1	Room "A" Bathroom	SK	App	<1.0	3/6/2024	-	-	-	-
0002	0001-1	Basement Boiler Room	SS	N/A		3/6/2024	-	-	-	Sign
0004A	0002-1	Basement Custodial Office Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
0005	0003-1	Basement Book Room	SK	N/A		3/6/2024	-	-	-	Sign

Laboratory Report
NYE Report #: 2401276-28743

March 11, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Dryden Street Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on March 07, 2024. New York Environmental analyzed the samples on March 08, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	05 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R038	1	Kitchen 2 Bay (Left)-SK, Initial	0.001	<0.001	mg/L	
240307R039	2	Kitchen 2 Bay (Right)-SK, Initial	0.001	<0.001	mg/L	
240307R040	3	Principals Office Kitchenette-SK, Initial	0.001	0.008	mg/L	H
240307R041	4	Nurses Office-SK, Initial	0.001	0.002	mg/L	
240307R042	5	Nurses Office-SPY, Initial	0.001	0.165	mg/L	E,H
240307R043	6	Registration Office-SK, Initial	0.001	0.004	mg/L	
240307R044	7	Room 1-SK, Initial	0.001	0.004	mg/L	
240307R045	8	Room 3-SK, Initial	0.001	0.002	mg/L	
240307R046	9	Room 2-SK, Initial	0.001	<0.001	mg/L	
240307R047	10	Room 5 -SK, Initial	0.001	0.002	mg/L	
240307R048	11	Hall by Room 4-WF, Initial	0.001	<0.001	mg/L	
240307R049	12	Hall by Room 4 -BF, Initial	0.001	<0.001	mg/L	
240307R050	13	Room 4 -SK, Initial	0.001	0.002	mg/L	
240307R051	14	Room 7-SK, Initial	0.001	<0.001	mg/L	
240307R052	15	Room 9-SK, Initial	0.001	0.001	mg/L	
240307R053	16	Room 13-SK, Initial	0.001	<0.001	mg/L	
240307R054	17	Room 10-SK, Initial	0.001	<0.001	mg/L	
240307R055	18	Room 12-SK, Initial	0.001	<0.001	mg/L	
240307R056	19	Room 15-SK, Initial	0.001	<0.001	mg/L	
240307R057	20	Room 14-SK, Initial	0.001	0.002	mg/L	
240307R058	21	Room 6-SK, Initial	0.001	0.003	mg/L	
240307R059	22	Room 11-SK, Initial	0.001	0.001	mg/L	
240307R060	23	Room 8-SK, Initial	0.001	<0.001	mg/L	
240307R061	24	Room "D" Bathroom-SK, Initial	0.001	<0.001	mg/L	
240307R062	25	Room "E" Bathroom-SK, Initial	0.001	<0.001	mg/L	
240307R063	26	Room "F" Bathroom-SK, Initial	0.001	<0.001	mg/L	
240307R064	27	Room "G" Bathroom-SK, Initial	0.001	<0.001	mg/L	



Date Collected:	05 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
240307R065	28	Room "C" Bathroom-SK, Initial	0.001	<0.001	mg/L	
240307R066	29	Room "B" Bathroom-SK, Initial	0.001	<0.001	mg/L	
240307R067	30	Room "A" Bathroom-SK, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2403807-30073

June 10, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Dryden Elementary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 06, 2024. New York Environmental analyzed the samples on June 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	06 Jun 2024
Date Received:	06 Jun 2024
Date Analyzed:	07 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240606Q053	A1	Principals Office Kitchenette-SK, Initial	0.001	0.011	mg/L	H
240606Q054	B1	Principals Office Kitchenette-SK, 15 Sec Flush	0.001	0.002	mg/L	
240606Q055	C1	Principals Office Kitchenette-SK, 60 Sec Flush	0.001	0.001	mg/L	
240606Q056	A2	Nurses Office-SPY, Initial	0.001	<0.001	mg/L	
240606Q057	B2	Nurses Office-SPY, 15 Sec Flush	0.001	0.002	mg/L	
240606Q058	C2	Nurses Office-SPY, 60 Sec Flush	0.001	0.002	mg/L	
240606Q059	6	Hall by Room 13-WF, Initial	0.001	<0.001	mg/L	
240606Q060	7	Hall by Room 13-BF, Initial	0.001	<0.001	mg/L	
240606Q061	12	Hall by Room 6-WF, Initial	0.001	<0.001	mg/L	
240606Q062	13	Hall by Room 6-BF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2404344-30416

June 27, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Dryden Street Elementary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 26, 2024. New York Environmental analyzed the samples on June 27, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	25 Jun 2024
Date Received:	26 Jun 2024
Date Analyzed:	27 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
240626P001	1A	Principal's Kitchenette-SK, Initial	0.001	<0.001	mg/L	
240626P002	1B	Principal's Kitchenette-SK, 15 Sec Flush	0.001	NA	mg/L	
240626P003	1C	Principal's Kitchenette-SK, 60 Sec Flush	0.001	NA	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

NA: Sample not analyzed per customer request.

Appendix C

Park Avenue Elementary School

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1049	1001-1	Kitchen 2-Bay Unit	SK	App	1.0	3/6/2024	-	-	-	-
	1001-2	Kitchen Serving Area Prep Island	SK	App	1.0	3/6/2024	-	-	-	-
	1001-3	Kitchen 3-Bay Unit Left	SK	App	2.0	3/6/2024	-	-	-	-
	1001-4	Kitchen 3-Bay Unit Middle	SK	App	2.0	3/6/2024	-	-	-	-
	1001-5	Kitchen 3-Bay Unit Right	SK	App	1.0	3/6/2024	-	-	-	-
	1001-6	Kitchen Handwash	SK	N/A		3/6/2024	-	-	-	Sign
	1001-7	Kitchen Ice Machine	IM	App	<1.0	3/6/2024	-	-	-	-
1049A	1001-8	Kitchen Custodial Closet	SS	N/A		3/6/2024	-	-	-	Sign
1049B	1001-9	Kitchen Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1045B	1002-1	Room L Band Room Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1044	1003-1	Room 35	SK	App	<1.0	3/6/2024	-	-	-	-
	1003-2	Room 35	WF	App	<1.0	3/6/2024	-	-	-	-
1037	1004-1	Room 33	SK	App	<1.0	3/6/2024	-	-	-	-
	1004-2	Room 33	WF	App	<1.0	3/6/2024	-	-	-	-
1035	1005-1	Room 32	SK	App	<1.0	3/6/2024	-	-	-	-
	1005-2	Room 32	WF	App	<1.0	3/6/2024	-	-	-	-
1038	1006-1	Room 31	SK	App	<1.0	3/6/2024	-	-	-	-
	1006-2	Room 31	WF	App	<1.0	3/6/2024	-	-	-	-
1033	1007-1	Room 30	SK	App	<1.0	3/6/2024	-	-	-	-
	1007-2	Room 30	WF	App	<1.0	3/6/2024	-	-	-	-

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1039	1008-1	Room 29	SK	App	<1.0	3/6/2024	-	-	-	-
	1008-2	Room 29	WF	App	<1.0	3/6/2024	-	-	-	-
1032	1009-1	Room 28	SK	App	2.0	3/6/2024	-	-	-	-
	1009-2	Room 28	WF	App	<1.0	3/6/2024	-	-	-	-
1040	1010-1	Room 27	SK	App	1.0	3/6/2024	-	-	-	-
	1010-2	Room 27	WF	App	<1.0	3/6/2024	-	-	-	-
1031	1011-1	Room 26	SK	App	1.0	3/6/2024	-	-	-	-
	1011-2	Room 26	WF	App	<1.0	3/6/2024	-	-	-	-
1041	1012-1	Room 25	SK	App	2.0	3/6/2024	-	-	-	-
	1012-2	Room 25	WF	App	<1.0	3/6/2024	-	-	-	-
1030	1013-1	Room 24	SK	App	4.0	3/6/2024	-	-	-	-
	1013-2	Room 24	WF	App	<1.0	3/6/2024	-	-	-	-
1042	1014-1	Room 23	SK	App	1.0	3/6/2024	-	-	-	-
	1014-2	Room 23	WF	App	<1.0	3/6/2024	-	-	-	-
1029	1015-1	Girl's Bathroom by Room 23 Left	SK	N/A		3/6/2024	-	-	-	Sign
	1015-2	Girl's Bathroom by Room 23 Left Middle	SK	N/A		3/6/2024	-	-	-	Sign
	1015-3	Girl's Bathroom by Room 23 Right Middle	SK	N/A		3/6/2024	-	-	-	Sign
	1015-4	Girl's Bathroom by Room 23 Right	SK	N/A		3/6/2024	-	-	-	Sign
1028	1016-1	Custodial Closet by Room 23	SS	N/A		3/6/2024	-	-	-	Sign
1027	1017-1	Boy's Bathroom by Room 23 Left	SK	N/A		3/6/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1027	1017-2	Boy's Bathroom by Room 23 Left Middle	SK	N/A		3/6/2024	-	-	-	Sign
	1017-3	Boy's Bathroom by Room 23 Middle	SK	N/A		3/6/2024	-	-	-	Sign
	1017-4	Boy's Bathroom by Room 23 Right Middle	SK	N/A		3/6/2024	-	-	-	Sign
	1017-5	Boy's Bathroom by Room 23 Right	SK	N/A		3/6/2024	-	-	-	Sign
New Addition	1018-1	Room 20	SK	App	1.0	6/6/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					6.0	3/6/2024				Removed from Service; Pending Remediaton
	1018-2	Room 20	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1018-3	Room 20 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
	1019-1	Room 21	SK	App	2.0	3/6/2024	-	-	-	-
	1019-2	Room 21	WF	App	<1.0	3/6/2024	-	-	-	-
	1019-3	Room 21 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
	1020-1	Room 22	SK	App	3.0	3/6/2024	-	-	-	-
	1020-2	Room 22	WF	App	<1.0	3/6/2024	-	-	-	-
	1020-3	Room 22 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
	1021-1	Room 19	SK	App	<1.0	3/6/2024	-	-	-	-
	1021-2	Room 19	WF	App	<1.0	3/6/2024	-	-	-	-
	1021-3	Room 19 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
	1022-1	Room 18	SK	App	2.0	3/6/2024	-	-	-	-
	1022-2	Room 18	WF	App	<1.0	3/6/2024	-	-	-	-
1022-3	Room 18 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign	

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1025	1023-1	Room 17	SK	App	4.0	3/6/2024	-	-	-	-
	1023-2	Room 17	WF	App	<1.0	3/6/2024	-	-	-	-
1024	1024-1	Room 16	SK	App	1.0	3/6/2024	-	-	-	-
	1024-2	Room 16	WF	App	<1.0	3/6/2024	-	-	-	-
1023	1025-1	Room 15	SK	App	1.0	3/6/2024	-	-	-	-
	1025-2	Room 15	WF	App	<1.0	3/6/2024	-	-	-	-
1022	1026-1	Room 14	SK	App	2.0	3/6/2024	-	-	-	-
	1026-2	Room 14	WF	App	<1.0	3/6/2024	-	-	-	-
1026	1055-1	Hall by Room 14	WF	App	<1.0	6/6/2024	-	-	-	-
	1055-2	Hall by Room 14	BF	App	<1.0	6/6/2024	-	-	-	-
1021	1027-1	Room 13	SK	App	2.0	3/6/2024	-	-	-	-
	1027-2	Room 13	WF	App	<1.0	3/6/2024	-	-	-	-
1020	1028-1	Room 12	SK	App	2.0	3/6/2024	-	-	-	-
	1028-2	Room 12	WF	App	<1.0	3/6/2024	-	-	-	-
1018	1029-1	Room 11	SK	App	2.0	3/6/2024	-	-	-	-
	1029-2	Room 11	WF	App	<1.0	3/6/2024	-	-	-	-
1018A	1029-3	Room 11 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1019	1030-1	Custodial Closet by Room 11	SS	N/A		3/6/2024	-	-	-	Sign
1016	1031-1	Room 10	SK	App	3.0	3/6/2024	-	-	-	-
	1031-2	Room 10	WF	App	<1.0	3/6/2024	-	-	-	-

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1016C	1031-3	Room 10 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1014B	1032-1	Room 9 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1010	1033-1	Room 7	SK	App	<1.0	3/6/2024	-	-	-	-
1011	1034-1	Room 8	SK	App	<1.0	3/6/2024	-	-	-	-
1008	1035-1	Room 5	SK	App	<1.0	3/6/2024	-	-	-	-
1009	1036-1	Room 6	SK	App	<1.0	3/6/2024	-	-	-	-
1006	1037-1	Room 4	SK	App	2.0	3/6/2024	-	-	-	-
	1037-2	Room 4	WF	App	<1.0	3/6/2024	-	-	-	-
1007	1038-1	Room 3	SK	App	<1.0	3/6/2024	-	-	-	-
	1038-2	Room 3	WF	App	<1.0	3/6/2024	-	-	-	-
1004	1039-1	Room 2	SK	App	<1.0	3/6/2024	-	-	-	-
	1039-2	Room 2	WF	App	<1.0	3/6/2024	-	-	-	-
1005	1040-1	Room 1	SK	App	<1.0	3/6/2024	-	-	-	-
	1040-2	Room 1	WF	App	<1.0	3/6/2024	-	-	-	-
1001	1041-1	Assistant Principal's Office	SK	App	4.0	6/6/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					10.0	3/6/2024				Removed from Service; Pending Remediaton
	1041-2	Assistant Principal's Office	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
1002A1	1042-1	Nurse's Office Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1002A	1042-2	Nurse's Office	SK	App	2.0	3/6/2024	-	-	-	-
1064D	1043-1	Main Office Kitchette	SK	App	3.0	3/6/2024	-	-	-	-

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1064D	1043-2	Main Office	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
1064A	1043-3	Main Office Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1056	1044-1	Girl's Bathroom by Main Office	SK	N/A		3/6/2024	-	-	-	Sign
1065	1045-1	Custodial Closet by Main Office	SS	N/A		3/6/2024	-	-	-	Sign
1058	1046-1	Boy's Bathroom by Main Office	SK	N/A		3/6/2024	-	-	-	Sign
1063	1047-1	Unisex Bathroom by Main Office	SK	N/A		3/6/2024	-	-	-	Sign
1062	1048-1	Unisex Office by Room S	SK	App		3/6/2024	-	-	-	Sign
1061	1049-1	Faculty Room Kitchenette	SK	App	3.0	3/6/2024	-	-	-	-
	1049-2	Faculty Room	WF	App	<1.0	3/6/2024	-	-	-	-
	1049-3	Faculty Room	BF	App	<1.0	3/6/2024	-	-	-	-
1054	1050-1	Hallway by Gym	WF	App	<1.0	3/6/2024	-	-	-	-
	1050-2	Hallway by Gym	BF	App	<1.0	3/6/2024	-	-	-	-
1050	1051-1	Gym	WF	App	<1.0	3/6/2024	-	-	-	-
	1051-2	Gym	BF	App	<1.0	3/6/2024	-	-	-	-
1051	1052-1	Room 34	SK	App	<1.0	3/6/2024	-	-	-	-
	1052-2	Room 34	WF	App	<1.0	3/6/2024	-	-	-	-
New Addition	1053-1	Portable L	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1053-2	Portable L & R Bathroom	SK	N/A		3/6/2024	-	-	-	Mixed Valve; Sign
	1054-1	Portable R	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required

Laboratory Report
NYE Report #: 2401279-28746

March 11, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Park Avenue Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on March 07, 2024. New York Environmental analyzed the samples on March 08, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	06 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R157	1	Kitchen 2-Bay Unit-SK, Initial	0.001	0.001	mg/L	
240307R158	2	Kitchen Serving Area Prep Island-SK, Initial	0.001	0.001	mg/L	
240307R159	3	Kitchen 3-Bay Unit Left-SK, Initial	0.001	0.002	mg/L	
240307R160	4	Kitchen 3-Bay Unit Middle-SK, Initial	0.001	0.002	mg/L	
240307R161	5	Kitchen 3-Bay Unit Right-SK, Initial	0.001	0.001	mg/L	
240307R162	6	Kitchen Ice Machine-IM, Initial	0.001	<0.001	mg/L	
240307R163	7	Room 35-SK, Initial	0.001	<0.001	mg/L	
240307R164	8	Room 35-WF, Initial	0.001	<0.001	mg/L	
240307R165	9	Room 33-SK, Initial	0.001	<0.001	mg/L	
240307R166	10	Room 33-WF, Initial	0.001	<0.001	mg/L	
240307R167	11	Room 32-SK, Initial	0.001	<0.001	mg/L	
240307R168	12	Room 32-WF, Initial	0.001	<0.001	mg/L	
240307R169	13	Room 31-SK, Initial	0.001	<0.001	mg/L	
240307R170	14	Room 31-WF, Initial	0.001	<0.001	mg/L	
240307R171	15	Room 30-SK, Initial	0.001	<0.001	mg/L	
240307R172	16	Room 30-WF, Initial	0.001	<0.001	mg/L	
240307R173	17	Room 29-SK, Initial	0.001	<0.001	mg/L	
240307R174	18	Room 29-WF, Initial	0.001	<0.001	mg/L	
240307R175	19	Room 28-SK, Initial	0.001	0.002	mg/L	
240307R176	20	Room 28-WF, Initial	0.001	<0.001	mg/L	
240307R177	21	Room 27-SK, Initial	0.001	0.001	mg/L	
240307R178	22	Room 27-WF, Initial	0.001	<0.001	mg/L	
240307R179	23	Room 26-SK, Initial	0.001	0.001	mg/L	
240307R180	24	Room 26-WF, Initial	0.001	<0.001	mg/L	
240307R181	25	Room 25-SK, Initial	0.001	0.002	mg/L	
240307R182	26	Room 25-WF, Initial	0.001	<0.001	mg/L	
240307R183	27	Room 24-SK, Initial	0.001	0.004	mg/L	



Date Collected:	06 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R184	28	Room 24-WF, Initial	0.001	<0.001	mg/L	
240307R185	29	Room 23-SK, Initial	0.001	0.001	mg/L	
240307R186	30	Room 23-WF, Initial	0.001	<0.001	mg/L	
240307R187	31	Room 20-SK, Initial	0.001	0.006	mg/L	H
240307R188	32	Room 21-SK, Initial	0.001	0.002	mg/L	
240307R189	33	Room 21-WF, Initial	0.001	<0.001	mg/L	
240307R190	34	Room 22-SK, Initial	0.001	0.003	mg/L	
240307R191	35	Room 22-WF, Initial	0.001	<0.001	mg/L	
240307R192	36	Room 19-SK, Initial	0.001	<0.001	mg/L	
240307R193	37	Room 19-WF, Initial	0.001	<0.001	mg/L	
240307R194	38	Room 18-SK, Initial	0.001	0.002	mg/L	
240307R195	39	Room 18-WF, Initial	0.001	<0.001	mg/L	
240307R196	40	Room 17-SK, Initial	0.001	0.004	mg/L	
240307R197	41	Room 17-WF, Initial	0.001	<0.001	mg/L	
240307R198	42	Room 16-SK, Initial	0.001	0.001	mg/L	
240307R199	43	Room 16-WF, Initial	0.001	<0.001	mg/L	
240307R200	44	Room 15-SK, Initial	0.001	0.001	mg/L	
240307R201	45	Room 15-WF, Initial	0.001	<0.001	mg/L	
240307R202	46	Room 14-SK, Initial	0.001	0.002	mg/L	
240307R203	47	Room 14-WF, Initial	0.001	<0.001	mg/L	
240307R204	48	Room 13-SK, Initial	0.001	0.002	mg/L	
240307R205	49	Room 13-WF, Initial	0.001	<0.001	mg/L	
240307R206	50	Room 12-SK, Initial	0.001	0.002	mg/L	
240307R207	51	Room 12-WF, Initial	0.001	<0.001	mg/L	
240307R208	52	Room 11-SK, Initial	0.001	0.002	mg/L	
240307R209	53	Room 11-WF, Initial	0.001	<0.001	mg/L	
240307R210	54	Room 10-SK, Initial	0.001	0.003	mg/L	
240307R211	55	Room 10-WF, Initial	0.001	<0.001	mg/L	



Date Collected:	06 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R212	56	Room 7-SK, Initial	0.001	<0.001	mg/L	
240307R213	57	Room 8-SK, Initial	0.001	<0.001	mg/L	
240307R214	58	Room 5-SK, Initial	0.001	<0.001	mg/L	
240307R215	59	Room 6-SK, Initial	0.001	<0.001	mg/L	
240307R216	60	Room 4-SK, Initial	0.001	0.002	mg/L	
240307R217	61	Room 4-WF, Initial	0.001	<0.001	mg/L	
240307R218	62	Room 3-SK, Initial	0.001	<0.001	mg/L	
240307R219	63	Room 3-WF, Initial	0.001	<0.001	mg/L	
240307R220	64	Room 2-SK, Initial	0.001	<0.001	mg/L	
240307R221	65	Room 2-WF, Initial	0.001	<0.001	mg/L	
240307R222	66	Room 1-SK, Initial	0.001	<0.001	mg/L	
240307R223	67	Room 1-WF, Initial	0.001	<0.001	mg/L	
240307R224	68	Assistant Principal's Office-SK, Initial	0.001	0.010	mg/L	H
240307R225	69	Nurse's Office-SK, Initial	0.001	0.002	mg/L	
240307R226	70	Main Office Kitchette-SK, Initial	0.001	0.003	mg/L	
240307R227	71	Faculty Room Kitchenette-SK, Initial	0.001	0.003	mg/L	
240307R228	72	Faculty Room -WF, Initial	0.001	<0.001	mg/L	
240307R229	73	Faculty Room -BF, Initial	0.001	<0.001	mg/L	
240307R230	74	Hallway by Gym-WF, Initial	0.001	<0.001	mg/L	
240307R231	75	Hallway by Gym-BF, Initial	0.001	<0.001	mg/L	
240307R232	76	Gym-WF, Initial	0.001	<0.001	mg/L	
240307R233	77	Gym-BF, Initial	0.001	<0.001	mg/L	
240307R234	78	Room 34-SK, Initial	0.001	<0.001	mg/L	
240307R235	79	Room 34-WF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

NYE Report #: 2403809-30075

June 10, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Park Avenue Elementary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 06, 2024. New York Environmental analyzed the samples on June 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	06 Jun 2024
Date Received:	06 Jun 2024
Date Analyzed:	07 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
240606R013	1A	Room 20-SK, Initial	0.001	0.001	mg/L	
240606R014	1B	Room 20-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606R015	1C	Room 20-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240606R016	2	Hall by Room 14-WF, Initial	0.001	<0.001	mg/L	
240606R017	3	Hall by Room 14-BF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

Laboratory Report

NYE Report #: 2403873-30118

June 11, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Park Avenue Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 10, 2024. New York Environmental analyzed the samples on June 11, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	07 Jun 2024
Date Received:	10 Jun 2024
Date Analyzed:	11 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
240610J002	1A	Assistant Principal's Office-SK, Initial	0.001	0.004	mg/L	
240610J003	1B	Assistant Principal's Office-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240610J004	1C	Assistant Principal's Office-SK, 60 Sec Flush	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

Appendix D

Powells Lane Elementary School

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1028	1001-1	Kitchen Ice Machine	IM	App	<1.0	3/6/2024	-	-	-	-
	1001-2	Kitchen 3-Bay (Right)	SK	App	<1.0	3/6/2024	-	-	-	-
	1001-3	Kitchen 3-Bay (Left)	SK	App	<1.0	3/6/2024	-	-	-	-
	1001-4	Kitchen Handwash	SK	N/A		3/6/2024	-	-	-	Sign
	1001-5	Kitchen Pot Filler	SP	App		3/6/2024	-	-	-	-
1031	1002-1	Custodian Bathroom by Kitchen	SK	N/A		3/6/2024	-	-	-	Sign
1032	1003-1	Faculty Room	SK	App	<1.0	3/6/2024	-	-	-	-
	1003-2	Faculty Room	WF	App	<1.0	3/6/2024	-	-	-	-
	1003-3	Faculty Room	BF	App	<1.0	3/6/2024	-	-	-	-
1036	1004-1	Boys Bathroom by Room 12 (Left)	SK	N/A		3/6/2024	-	-	-	Sign
	1004-2	Boys Bathroom by Room 12 (Middle Left)	SK	N/A		3/6/2024	-	-	-	Sign
	1004-3	Boys Bathroom by Room 12 (Middle Right)	SK	N/A		3/6/2024	-	-	-	Sign
	1004-4	Boys Bathroom by Room 12 (Right)	SK	N/A		3/6/2024	-	-	-	Sign
1038	1005-1	Custodian Closet by Room 12	SS	N/A		3/6/2024	-	-	-	-
1039	1006-1	Girls Bathroom by Room 12 (Left)	SK	N/A		3/6/2024	-	-	-	Sign
	1006-2	Girls Bathroom by Room 12 (Middle)	SK	N/A		3/6/2024	-	-	-	Sign
	1006-3	Girls Bathroom by Room 12 (Right)	SK	N/A		3/6/2024	-	-	-	Sign
1040	1007-1	Room 13	SK	App	2.0	3/6/2024	-	-	-	-
1042	1008-1	Room 15	SK	App	2.0	3/6/2024	-	-	-	-
1044	1009-1	Room 17	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1044	1009-2	Room 17	SK	App	3.0	3/6/2024	-	-	-	-
1048	1040-1	Hall by Room 17	WF	App	<1.0	3/6/2024	-	-	-	-
	1040-2	Hall by Room 17	BF	App	<1.0	3/6/2024	-	-	-	-
1046	1010-1	Room 19	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1010-2	Room 19	SK	App	5.0	3/6/2024	-	-	-	-
New Addition	1011-1	Room 23	SK	App	1.0	3/6/2024	-	-	-	-
	1012-1	Room 25	SK	App	2.0	3/6/2024	-	-	-	-
	1013-1	Room 26	SK	App	1.0	3/6/2024	-	-	-	-
	1014-1	Room 24	SK	App	1.0	3/6/2024	-	-	-	-
1047	1015-1	Room 20	SK	App	1.0	3/6/2024	-	-	-	-
1045	1016-1	Room 18	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1016-2	Room 18	SK	App	<1.0	3/6/2024	-	-	-	-
1043	1017-1	Room 16	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1017-2	Room 16	SK	App	4.0	3/6/2024	-	-	-	-
1041	1018-1	Room 14	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1018-2	Room 14	SK	App	1.0	3/6/2024	-	-	-	-
1037	1019-1	Room 12	SK	App	5.0	3/6/2024	-	-	-	-
1034	1020-1	Hall by Gym	WF	App	<1.0	3/6/2024	-	-	-	-
	1020-2	Hall by Gym (Bottle Filler)	BF	App	<1.0	3/6/2024	-	-	-	-
1016	1021-1	Main Office	SK	App	3.0	3/6/2024	-	-	-	-

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1018	1022-1	Principal's Office Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1021	1023-1	Faculty Bathroom by Main Office	SK	N/A		3/6/2024	-	-	-	Sign
1022	1024-1	Faculty Bathroom by Room "A"	SK	N/A		3/6/2024	-	-	-	Sign
1023	1025-1	Room "A"	SK	App		3/6/2024	-	-	-	Sign
1014	1026-1	Room 11	SK	App	3.0	3/6/2024	-	-	-	-
1001	1027-1	Nurse's Office	SK	App	4.0	6/6/2024	2.0	1.0	6/6/2024	Remediation Complete
					6.0	3/6/2024				Removed from Service; Pending Remediation
	1027-2	Nurse's Office Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1002	1028-1	Room 10	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1028-2	Room 10	SK	App	<1.0	3/6/2024	-	-	-	-
1002A	1028-3	Room 10 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1003	1029-1	Room 8	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1029-2	Room 8	SK	App	1.0	3/6/2024	-	-	-	-
1003A	1029-3	Room 8 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1004	1030-1	Room 6	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1030-2	Room 6	SK	App	2.0	3/6/2024	-	-	-	-
1004A	1030-3	Room 6 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1005	1031-1	Room 4	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1031-2	Room 4	SK	App	2.0	3/6/2024	-	-	-	-
1005A	1031-3	Room 4 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1006	1032-1	Room 2	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
1006	1032-2	Room 2	SK	App	<1.0	3/6/2024	-	-	-	-
1006A	1032-3	Room 2 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
2002	1033-1	Room "F"	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1033-2	Room "F"	SK	App	1.0	6/6/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					6.0	3/6/2024				Removed from Service; Pending Remediation
1033-3	Room "F" Bathroom	SK	N/A		3/6/2024	-	-	-	Sign	
2003	1034-1	Room "G"	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1034-2	Room "G"	SK	App	3.0	3/6/2024	-	-	-	-
	1034-3	Room "G" Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
-	1041-1	Hall by Room "E"	WF	App	<1.0	6/6/2024	-	-	-	-
	1041-2	Hall by Room "E"	BF	App	<1.0	6/6/2024	-	-	-	-
1007	1035-1	Room 1	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1035-2	Room 1	SK	App	<1.0	3/6/2024	-	-	-	-
1007A	1035-3	Room 1 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1008	1036-1	Room 3	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1036-2	Room 3	SK	App	<1.0	3/6/2024	-	-	-	-
1008A	1036-3	Room 3 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1009	1037-1	Room 5	WF	App		3/6/2024	-	-	-	Non-functional; Sampling Required
	1037-2	Room 5	SK	App	1.0	3/6/2024	-	-	-	-
1009A	1037-3	Room 5 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1010A	1038-1	Computer Room 7 Bathroom	SK	N/A		3/6/2024	-	-	-	Sign
1011	1039-1	Custodian Closet by Library Room 9	SS	N/A		3/6/2024	-	-	-	-
1012	1040-1	Library Room 9 Kitchenette	SK	App	2.0	6/6/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					6.0	3/6/2024				Removed from Service; Pending Remediation
0001	0001-1	Boiler Room Bathroom	SK	N/A		3/6/2024	-	-	-	Sign

Laboratory Report
NYE Report #: 2401275-28742

March 11, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Powells Lane Elementary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on March 07, 2024. New York Environmental analyzed the samples on March 08, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	06 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R001	1	Kitchen Ice Machine-IM, Initial	0.001	<0.001	mg/L	
240307R002	2	Kitchen 3-Bay (Right)-SK, Initial	0.001	<0.001	mg/L	
240307R003	3	Kitchen 3-Bay (Left)-SK, Initial	0.001	<0.001	mg/L	
240307R004	4	Faculty Room-SK, Initial	0.001	<0.001	mg/L	
240307R005	5	Faculty Room-WF, Initial	0.001	<0.001	mg/L	
240307R006	6	Faculty Room-BF, Initial	0.001	<0.001	mg/L	
240307R007	7	Room 13-SK, Initial	0.001	0.002	mg/L	
240307R008	8	Room 15-SK, Initial	0.001	0.002	mg/L	
240307R009	9	Room 17-SK, Initial	0.001	0.003	mg/L	
240307R010	10	Hall by Room 17-WF, Initial	0.001	<0.001	mg/L	
240307R011	11	Hall by Room 17-BF, Initial	0.001	<0.001	mg/L	
240307R012	12	Room 19-SK, Initial	0.001	0.005	mg/L	
240307R013	13	Room 23-SK, Initial	0.001	0.001	mg/L	
240307R014	14	Room 25-SK, Initial	0.001	0.002	mg/L	
240307R015	15	Room 26-SK, Initial	0.001	0.001	mg/L	
240307R016	16	Room 24-SK, Initial	0.001	0.001	mg/L	
240307R017	17	Room 20-SK, Initial	0.001	0.001	mg/L	
240307R018	18	Room 18-SK, Initial	0.001	<0.001	mg/L	
240307R019	19	Room 16-SK, Initial	0.001	0.004	mg/L	
240307R020	20	Room 14-SK, Initial	0.001	0.001	mg/L	
240307R021	21	Room 12-SK, Initial	0.001	0.005	mg/L	
240307R022	22	Hall by Gym-WF, Initial	0.001	<0.001	mg/L	
240307R023	23	Hall by Gym (Bottle Filler)-BF, Initial	0.001	<0.001	mg/L	
240307R024	24	Main Office-SK, Initial	0.001	0.003	mg/L	
240307R025	25	Room 11-SK, Initial	0.001	0.003	mg/L	
240307R026	26	Nurse's Office-SK, Initial	0.001	0.006	mg/L	H
240307R027	27	Room 10-SK, Initial	0.001	<0.001	mg/L	



Date Collected:	06 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R028	28	Room 8-SK, Initial	0.001	0.001	mg/L	
240307R029	29	Room 6 -SK, Initial	0.001	0.002	mg/L	
240307R030	30	Room 4-SK, Initial	0.001	0.002	mg/L	
240307R031	31	Room 2-SK, Initial	0.001	<0.001	mg/L	
240307R032	32	Room "F"-SK, Initial	0.001	0.006	mg/L	H
240307R033	33	Room "G" -SK, Initial	0.001	0.003	mg/L	
240307R034	34	Room 1-SK, Initial	0.001	<0.001	mg/L	
240307R035	35	Room 3-SK, Initial	0.001	<0.001	mg/L	
240307R036	36	Room 5 -SK, Initial	0.001	0.001	mg/L	
240307R037	37	Library Room 9 Kitchenette-SK, Initial	0.001	0.006	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Laboratory Report
NYE Report #: 2401275-28742

March 11, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Powells Lane Elementary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on March 07, 2024. New York Environmental analyzed the samples on March 08, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	06 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R001	1	Kitchen Ice Machine-IM, Initial	0.001	<0.001	mg/L	
240307R002	2	Kitchen 3-Bay (Right)-SK, Initial	0.001	<0.001	mg/L	
240307R003	3	Kitchen 3-Bay (Left)-SK, Initial	0.001	<0.001	mg/L	
240307R004	4	Faculty Room-SK, Initial	0.001	<0.001	mg/L	
240307R005	5	Faculty Room-WF, Initial	0.001	<0.001	mg/L	
240307R006	6	Faculty Room-BF, Initial	0.001	<0.001	mg/L	
240307R007	7	Room 13-SK, Initial	0.001	0.002	mg/L	
240307R008	8	Room 15-SK, Initial	0.001	0.002	mg/L	
240307R009	9	Room 17-SK, Initial	0.001	0.003	mg/L	
240307R010	10	Hall by Room 17-WF, Initial	0.001	<0.001	mg/L	
240307R011	11	Hall by Room 17-BF, Initial	0.001	<0.001	mg/L	
240307R012	12	Room 19-SK, Initial	0.001	0.005	mg/L	
240307R013	13	Room 23-SK, Initial	0.001	0.001	mg/L	
240307R014	14	Room 25-SK, Initial	0.001	0.002	mg/L	
240307R015	15	Room 26-SK, Initial	0.001	0.001	mg/L	
240307R016	16	Room 24-SK, Initial	0.001	0.001	mg/L	
240307R017	17	Room 20-SK, Initial	0.001	0.001	mg/L	
240307R018	18	Room 18-SK, Initial	0.001	<0.001	mg/L	
240307R019	19	Room 16-SK, Initial	0.001	0.004	mg/L	
240307R020	20	Room 14-SK, Initial	0.001	0.001	mg/L	
240307R021	21	Room 12-SK, Initial	0.001	0.005	mg/L	
240307R022	22	Hall by Gym-WF, Initial	0.001	<0.001	mg/L	
240307R023	23	Hall by Gym (Bottle Filler)-BF, Initial	0.001	<0.001	mg/L	
240307R024	24	Main Office-SK, Initial	0.001	0.003	mg/L	
240307R025	25	Room 11-SK, Initial	0.001	0.003	mg/L	
240307R026	26	Nurse's Office-SK, Initial	0.001	0.006	mg/L	H
240307R027	27	Room 10-SK, Initial	0.001	<0.001	mg/L	



Date Collected:	06 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R028	28	Room 8-SK, Initial	0.001	0.001	mg/L	
240307R029	29	Room 6 -SK, Initial	0.001	0.002	mg/L	
240307R030	30	Room 4-SK, Initial	0.001	0.002	mg/L	
240307R031	31	Room 2-SK, Initial	0.001	<0.001	mg/L	
240307R032	32	Room "F"-SK, Initial	0.001	0.006	mg/L	H
240307R033	33	Room "G" -SK, Initial	0.001	0.003	mg/L	
240307R034	34	Room 1-SK, Initial	0.001	<0.001	mg/L	
240307R035	35	Room 3-SK, Initial	0.001	<0.001	mg/L	
240307R036	36	Room 5 -SK, Initial	0.001	0.001	mg/L	
240307R037	37	Library Room 9 Kitchenette-SK, Initial	0.001	0.006	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2403806-30072

June 10, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Powells Lane Elementary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 06, 2024. New York Environmental analyzed the samples on June 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	06 Jun 2024
Date Received:	06 Jun 2024
Date Analyzed:	07 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240606Q042	1A	Nurse's Office-SK, Initial	0.001	0.004	mg/L	
240606Q043	1B	Nurse's Office-SK, 15 Sec Flush	0.001	0.002	mg/L	
240606Q044	1C	Nurse's Office-SK, 60 Sec Flush	0.001	0.001	mg/L	
240606Q045	2A	Roof "F"-SK, Initial	0.001	0.001	mg/L	
240606Q046	2B	Roof "F"-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606Q047	2C	Roof "F"-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240606Q048	4A	Libarary Room 9 Kitchenette-SK, Initial	0.001	0.002	mg/L	
240606Q049	4B	Libarary Room 9 Kitchenette-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606Q050	4C	Libarary Room 9 Kitchenette-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240606Q051	5	Hall by Room "E"-WF, Initial	0.001	<0.001	mg/L	
240606Q052	6	Hall by Room "E"-BF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

Appendix E
Westbury Middle School

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0001	0001-1	Boiler Room	SK	N/A		3/7/2024	-	-	-	Sign
	0001-2	Boiler Room Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
0006B	0002-2	Bathroom by Wood Shop	SK	N/A		3/7/2024	-	-	-	Sign
0019	0003-1	Room B21	SK	App	2.0	3/7/2024	-	-	-	-
	0003-2	Room B21	WF	App	3.0	3/7/2024	-	-	-	-
0018	0004-1	Room B20-Wood Shop	SK	App	<1.0	3/7/2024	-	-	-	-
	0004-2	Room B20-Wood Shop	WF	App		3/7/2024	-	-	-	Non-functional; Sampling Required
New Addition	1001-1	Kitchen Steamer	SK	App	<1.0	6/6/2024	<1.0	<1.0	6/6/2024	Removed from Service; Pending Remediation
					29.0	3/7/2024				Removed from Service; Pending Remediation
	1001-2	Kitchen Potfiller	PF	App	5.0	6/6/2024	1.0	<1.0	6/6/2024	Removed from Service; Pending Remediation
					19.0	3/7/2024				Removed from Service; Pending Remediation
	1001-3	Kitchen Handwash @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1001-4	Kitchen Ice Machine	IM	App	<1.0	3/7/2024	-	-	-	-
	1001-5	Kitchen Slop Sink	SS	N/A		3/7/2024	-	-	-	Sign
	1001-6	Kitchen Slop Sink	SPY	N/A		3/7/2024	-	-	-	Sign
	1001-7	Kitchen Island 3-Bay Dishwash Left	SK	N/A		3/7/2024	-	-	-	Sign
	1001-8	Kitchen Island 3-Bay Dishwash Left	SPY	N/A		3/7/2024	-	-	-	Sign
	1001-9	Kitchen Island 3-Bay Dishwash Right	SK	N/A		3/7/2024	-	-	-	Sign
1001-10	Kitchen Handwash @ B	SK	N/A		3/7/2024	-	-	-	Sign	
1001-11	Kitchen Island-2 Bay	SK	App	<1.0	3/7/2024	-	-	-	-	

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
New Addition	1001-12	Kitchen Island	SK	App	<1.0	3/7/2024	-	-	-	-
	1001-13	Serving Line Prep by Kitchen	SK	App	<1.0	3/7/2024	-	-	-	-
	1001-14	Serving Line Handwash by Kitchen	SK	N/A		3/7/2024	-	-	-	Sign
	1001-15	Serving Line Prep	SK	App	<1.0	3/7/2024	-	-	-	-
	1001-16	Serving Line Handwash	SK	N/A		3/7/2024	-	-	-	Sign
	1001	Kitchen-Handwash	SK	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
	1001	Kitchen-3 Bay Unit-Left	SK	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
	1001	Kitchen-3 Bay Unit-Middle	SK	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
	1001	Kitchen-3 Bay Unit-Right	SK	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
	1001	Kitchen-2 Bay Unit	SK	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
	1001	Kitchen-Serving Area-3 Bay Unit	SK	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
	1001	Kitchen-Serving Area-3 Bay Unit	IM	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
	1001	Kitchen-Serving Area-Handwash	SK	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
1044	1002-1	Cafeteria	WF	N/A		3/7/2024	-	-	-	Removed from Service; Fixture Removed
1049A1	1003-1	Team Room	WF	App		3/7/2024	-	-	-	Non-functional; Sampling Required
1049A1B	1003-2	Team Room Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1046	1004-1	Custodial Closet by Girl's Locker Room	SK	N/A		3/7/2024	-	-	-	Sign
1047B	1005-1	Girl's Locker Room Bathroom-Left	SK	N/A		3/7/2024	-	-	-	Sign
	1005-2	Girl's Locker Room Bathroom-Right	SK	N/A		3/7/2024	-	-	-	Sign
1042	1006-1	Boy's Bathroom by Room 114	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1043A1	1007-1	Boy's Coach's Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1043C	1007-2	Boy's Locker Room Bathroom-Left	SK	N/A		3/7/2024	-	-	-	Sign
	1007-3	Boy's Locker Room Bathroom-Right	SK	N/A		3/7/2024	-	-	-	Sign
1040	1008-1	Custodial Closet by Room 114	SS	N/A		3/7/2024	-	-	-	Sign
1055	1009-1	Hall by Room 114	WF	App	<1.0	3/7/2024	-	-	-	-
	1009-2	Hall by Room 114	BF	App	<1.0	3/7/2024	-	-	-	-
1038	1010-1	Girl's Bathroom by Room 112-Left	SK	N/A		3/7/2024	-	-	-	Sign
	1010-2	Girl's Bathroom by Room 112-Right	SK	N/A		3/7/2024	-	-	-	Sign
1034A	1011-1	Art Room 110-Left	SK	N/A		3/7/2024	-	-	-	Sign
	1011-2	Art Room 110-Right	SK	N/A		3/7/2024	-	-	-	Sign
1024	1012-1	Guidance Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1023	1013-1	Women's Bathroom by Guidance Office @A	SK	N/A		3/7/2024	-	-	-	Sign
	1013-2	Women's Bathroom by Guidance Office @B	SK	N/A		3/7/2024	-	-	-	Sign
	1013-3	Women's Bathroom by Guidance Office @C	SK	N/A		3/7/2024	-	-	-	Sign
	1013-4	Women's Bathroom by Guidance Office @D	SK	N/A		3/7/2024	-	-	-	Sign
	1013-5	Women's Bathroom by Guidance Office @E	SK	N/A		3/7/2024	-	-	-	Sign
	1013-6	Women's Bathroom by Guidance Office @F	SK	N/A		3/7/2024	-	-	-	Sign
1030	1014-1	Hall by Room 103	WF	App	<1.0	3/7/2024	-	-	-	-
1022	1015-1	Nurse's Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
	1015-2	Nurse's Office	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1022	1015-3	Room 103 Exam Room	SK	N/A		3/7/2024	-	-	-	Removed from Service
1017	1016-1	Men's Bathroom by Room 109 @A	SK	N/A		3/7/2024	-	-	-	Sign
	1016-2	Men's Bathroom by Room 109 @B	SK	N/A		3/7/2024	-	-	-	Sign
	1016-3	Men's Bathroom by Room 109 @C	SK	N/A		3/7/2024	-	-	-	Sign
	1016-4	Men's Bathroom by Room 109 @D	SK	N/A		3/7/2024	-	-	-	Sign
1016	1017-1	Custodial Closet by Room 109	SS	N/A		3/7/2024	-	-	-	Sign
1003	1018-1	Hall by Room 109	WF	App	<1.0	3/7/2024	-	-	-	-
1014C2	1019-1	Psychologist's Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1008	1020-1	Room 102-Home Economics @A	SK	App	<1.0	6/25/2024	-	-	-	Remediation Complete
					6.0	6/6/2024	1.0	1.0	6/6/2024	Removed from Service; Pending Remediation
					6.0	3/7/2024			6/6/2024	Removed from Service; Pending Remediation
	1020-2	Room 102-Home Economics @A	SPY	App	1.0	3/7/2024	-	-	-	-
	1020-3	Room 102-Home Economics @B	SK	App	<1.0	6/25/2024	-	-	-	Remediation Complete
					12.0	6/6/2024	3.0	4.0	6/6/2024	Removed from Service; Pending Remediation
					8.0	3/7/2024			6/6/2024	Removed from Service; Pending Remediation
	1020-4	Room 102-Home Economics @B	SPY	App		3/7/2024	-	-	-	Non-functional; Sampling Required
1004	1021-1	Room 100-Home Economics @A	SK	App	4.0	3/7/2024	-	-	-	Sign
	1021-2	Room 100-Home Economics @B	SK	App	2.0	3/7/2024	-	-	-	Sign
	1021-3	Room 100-Home Economics @C	SK	App	2.0	3/7/2024	-	-	-	-
	1021-4	Room 100-Home Economics @C	SPY	App		3/7/2024	-	-	-	Non-functional; Sampling Required

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1004	1021-5	Room 100-Home Economics @D	SK	App	1.0	3/7/2024	-	-	-	-
	1021-6	Room 100-Home Economics @E	SK	App	2.0	3/7/2024	-	-	-	-
1006	1022-1	Room 101-Art Room	SK	N/A		3/7/2024	-	-	-	Sign
1001B	1023-1	Custodial Storage on Stage	SS	N/A		3/7/2024	-	-	-	Sign
1000	1024-1	Auditorium by Girl's Bathroom	WF	N/A		3/7/2024	-	-	-	Removed from Service
1000C	1025-1	Girl's Bathroom in Auditorium-Left	SK	N/A		3/7/2024	-	-	-	Sign
	1025-2	Girl's Bathroom in Auditorium-Right	SK	N/A		3/7/2024	-	-	-	Sign
1000	1026-1	Auditorium by Boy's Bathroom	WF	N/A		3/7/2024	-	-	-	Removed from Service
1000B	1027-1	Boy's Bathroom in Auditorium-Left	SK	N/A		3/7/2024	-	-	-	Sign
1000	1027-2	Boy's Bathroom in Auditorium-Right	SK	N/A		3/7/2024	-	-	-	Sign
1000A	1036-1	Auditorium Lobby-Left	WF	App	<1.0	12/20/2023	-	-	-	-
1000A	1036-2	Auditorium Lobby-Right	WF	App	<1.0	12/20/2023	-	-	-	-
1000A	1036-3	Auditorium Lobby-Right	BF	App	<1.0	12/20/2023	-	-	-	-
1076	1028-1	Girl's Bathroom by Library-Left	SK	N/A		3/7/2024	-	-	-	Sign
1076	1028-2	Girl's Bathroom by Library-Right	SK	N/A		3/7/2024	-	-	-	Sign
1077	1029-1	Hall by Library	WF	App	<1.0	3/7/2024	-	-	-	-
1060B	1030-1	Library Office	SK	N/A		3/7/2024	-	-	-	Sign
1057	1031-1	Boy's Bathroom by Room 2-Left	SK	N/A		3/7/2024	-	-	-	Sign
	1031-2	Boy's Bathroom by Room 2-Middle	SK	N/A		3/7/2024	-	-	-	Sign
	1031-3	Boy's Bathroom by Room 2-Right	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1058	1032-1	Custodial Closet by Room 2	SS	N/A		3/7/2024	-	-	-	Sign
1066	1033-1	Hall by Room 4	WF	App	<1.0	3/7/2024	-	-	-	-
1066	1033-2	Hall by Room 4	BF	App	<1.0	3/7/2024	-	-	-	-
1053	1034-1	Stairway by Room 117	SK	App	1.0	3/7/2024	-	-	-	-
1053D2	1035-1	Room 119	SK	App	2.0	3/7/2024	-	-	-	-
New Addition	1037-1	New Wing Custodial Closet by Elevator	SS	N/A		3/7/2024	-	-	-	Sign
New Addition	1038-1	New Wing Faculty Bathroom Left	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1039-1	New Wing Faculty Bathroom Right	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1040-1	New Wing Nurse's Office	SK	App	<1.0	3/7/2024	-	-	-	-
	1040-2	New Wing Nurse's Office Bathroom	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1041-1	New Wing, 1st Floor Hall-Left	WF	App	<1.0	3/7/2024	-	-	-	-
	1041-2	New Wing, 1st Floor Hall-Right	WF	App	<1.0	3/7/2024	-	-	-	-
	1041-3	New Wing, 1st Floor Hall-Right	BF	App	<1.0	3/7/2024	-	-	-	-
New Addition	1042-1	New Wing Boy's Bathroom by Main Office @	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1042-2	New Wing Boy's Bathroom by Main Office @	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1042-3	New Wing Boy's Bathroom by Main Office @	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1042-4	New Wing Boy's Bathroom by Main Office @	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1043-1	New Wing Girl's Bathroom by Main Office @ A	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1043-2	New Wing Girl's Bathroom by Main Office @ B	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1043-3	New Wing Girl's Bathroom by Main Office @ C	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
	1043-4	New Wing Girl's Bathroom by Main Office @ D	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1044-1	New Wing Main Office Kitchenette	SK	App	<1.0	3/7/2024	-	-	-	-
New Addition	1044-2	New Wing Main Office Bathroom	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1045-1	New Wing Wellness Room	SK	App	<1.0	3/7/2024	-	-	-	-
New Addition	2012-1	New Wing by Room 220-Left	WF	App	<1.0	3/7/2024	-	-	-	-
	2012-2	New Wing by Room 220-Right	WF	App	<1.0	3/7/2024	-	-	-	-
	2012-3	New Wing by Room 220-Right	BF	App	<1.0	3/7/2024	-	-	-	-
New Addition	2013-1	New Wing Bathroom	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	2014-1	New Wing Custodial Closet by Room 224	SS	N/A		3/7/2024	-	-	-	Sign
2033	2001-1	Girl's Bathroom by Psych Office @A	SK	N/A		3/7/2024	-	-	-	Sign
	2001-2	Girl's Bathroom by Psych Office @B	SK	N/A		3/7/2024	-	-	-	Sign
	2001-3	Girl's Bathroom by Psych Office @C	SK	N/A		3/7/2024	-	-	-	Sign
	2001-4	Girl's Bathroom by Psych Office @D	SK	N/A		3/7/2024	-	-	-	Sign
2041	2002-1	Hall by Room 207	WF	App	<1.0	6/6/2024	-	-	-	-
2034	2003-1	Room 207-Science	SK	N/A		3/7/2024	-	-	-	Sign
2036	2004-1	Room 209-Science-Counter	SK	N/A		3/7/2024	-	-	-	Sign
	2004-2	Room 209-Science-Island 1	SK	N/A		3/7/2024	-	-	-	Sign
	2004-3	Room 209-Science-Island 2	SK	N/A		3/7/2024	-	-	-	Sign
2040	2005-1	Room 211 Prep Room-Counter @A	SK	N/A		3/7/2024	-	-	-	Sign
	2005-2	Room 211 Prep Room-Counter @B	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2040	2005-3	Room 211 Prep Room-Counter @C	SK	N/A		3/7/2024	-	-	-	Sign
	2005-4	Room 211 Prep Room	SS	N/A		3/7/2024	-	-	-	Sign
2040	2005-5	Room 211-Science	SK	N/A		3/7/2024	-	-	-	Sign
2024	2006-1	Room 208-Counter	SK	N/A		3/7/2024	-	-	-	Sign
2027	2007-1	Room 210-Counter @A	SK	N/A		3/7/2024	-	-	-	Sign
	2007-2	Room 210-Counter @B	SK	N/A		3/7/2024	-	-	-	Sign
	2007-3	Room 210-Counter @C	SK	N/A		3/7/2024	-	-	-	Sign
	2007-3	Room 210-Eyewash Station	OS	N/A		3/7/2024	-	-	-	Sign
2029	2008-1	Hall by Room 200	WF	App	<1.0	3/7/2024	-	-	-	Sign
2021	2009-1	Custodial Closet by Room 200	SS	N/A		3/7/2024	-	-	-	Sign
2020	2010-1	Boy's Bathroom by Room 200-Left	SK	N/A		3/7/2024	-	-	-	Sign
	2010-2	Boy's Bathroom by Room 200-Left Middle	SK	N/A		3/7/2024	-	-	-	Sign
	2010-3	Boy's Bathroom by Room 200-Right Middle	SK	N/A		3/7/2024	-	-	-	Sign
	2010-4	Boy's Bathroom by Room 200-Right	SK	N/A		3/7/2024	-	-	-	Sign
2023	2011-1	Room 206 Island	SK	N/A		3/7/2024	-	-	-	Sign
2005	3001-1	Boy's Bathroom by Room 303-Left	SK	N/A		3/7/2024	-	-	-	Sign
	3001-2	Boy's Bathroom by Room 303-Right	SK	N/A		3/7/2024	-	-	-	Sign
2017	3002-1	Hall by Room 303	WF	App	1.0	3/7/2024	-	-	-	Sign
2001	3003-1	Assistant Principal's Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
2009A	3004-1	Girl's Bathroom-Custodial Closet	SS	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2009B	3004-2	Girl's Bathroom by Room 304-Left	SK	N/A		3/7/2024	-	-	-	Sign
	3004-3	Girl's Bathroom by Room 304-Middle	SK	N/A		3/7/2024	-	-	-	Sign
2009B	3004-4	Girl's Bathroom by Room 304-Right	SK	N/A		3/7/2024	-	-	-	Sign
2012	3005-1	Room 307-Left	SK	N/A		3/7/2024	-	-	-	Sign
	3005-2	Room 307-Right	SK	N/A		3/7/2024	-	-	-	Sign
-	-	Teacher's Work Room	SK	App	<1.0	3/7/2024	-	-	-	-

Laboratory Report

NYE Report #: 237177-27931

December 21, 2023

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Westbury Middle School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on December 20, 2023. New York Environmental analyzed the samples on December 21, 2023 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	20 Dec 2023
Date Received:	20 Dec 2023
Date Analyzed:	21 Dec 2023

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
231220L011	1	Auditorium Lobby - Left (#1036-1)	0.001	<0.001	mg/L	
231220L012	2	Auditorium Lobby - Right (#1036-2)	0.001	<0.001	mg/L	
231220L013	3	Auditorium Lobby - Right (#1036-3)	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

Laboratory Report
NYE Report #: 2401278-28745

March 11, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Westbury Middle School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on March 07, 2024. New York Environmental analyzed the samples on March 08, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	07 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R118	1	Kitchen Steamer-SK, Initial	0.001	0.029	mg/L	H
240307R119	2	Kitchen Potfiller-PF, Initial	0.001	0.019	mg/L	H
240307R120	3	Kitchen Ice Machine-IM, Initial	0.001	<0.001	mg/L	
240307R121	4	Kitchen Island-2 Bay-SK, Initial	0.001	<0.001	mg/L	
240307R122	5	Kitchen Island-SK, Initial	0.001	<0.001	mg/L	
240307R123	6	Serving Line Prep by Kitchen-SK, Initial	0.001	<0.001	mg/L	
240307R124	7	Serving Line Prep-SK, Initial	0.001	<0.001	mg/L	
240307R125	8	Stairway by Room 117-SK, Initial	0.001	0.001	mg/L	
240307R126	9	Room 119-SK, Initial	0.001	0.002	mg/L	
240307R127	10	Hall by Room 114-WF, Initial	0.001	<0.001	mg/L	
240307R128	11	Hall by Room 114-BF, Initial	0.001	<0.001	mg/L	
240307R129	12	Hall by Room 103-WF, Initial	0.001	<0.001	mg/L	
240307R130	13	Hall by Room 109-WF, Initial	0.001	<0.001	mg/L	
240307R131	14	Room 102-Home Economics @A-SK, Initial	0.001	0.006	mg/L	H
240307R132	15	Room 102-Home Economics @A-SPY, Initial	0.001	0.001	mg/L	
240307R133	16	Room 102-Home Economics @B-SK, Initial	0.001	0.008	mg/L	H
240307R134	17	Room 100-Home Economics @A-SK, Initial	0.001	0.004	mg/L	
240307R135	18	Room 100-Home Economics @B-SK, Initial	0.001	0.002	mg/L	
240307R136	19	Room 100-Home Economics @C-SK, Initial	0.001	0.002	mg/L	
240307R137	20	Room 100-Home Economics @D-SK, Initial	0.001	0.001	mg/L	
240307R138	21	Room 100-Home Economics @E-SK, Initial	0.001	0.002	mg/L	
240307R139	22	Hall by Library-WF, Initial	0.001	<0.001	mg/L	
240307R140	23	Hall by Room 4-WF, Initial	0.001	<0.001	mg/L	
240307R141	24	Hall by Room 4-BF, Initial	0.001	<0.001	mg/L	
240307R142	25	Hall by Room 200-WF, Initial	0.001	<0.001	mg/L	
240307R143	26	Hall by Room 303-WF, Initial	0.001	0.001	mg/L	
240307R144	27	Teacher's Work Room-SK, Initial	0.001	<0.001	mg/L	



Date Collected:	07 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307R145	28	New Wing Nurse's Office-SK, Initial	0.001	<0.001	mg/L	
240307R146	29	New Wing, 1st Floor Hall-Left-WF, Initial	0.001	<0.001	mg/L	
240307R147	30	New Wing, 1st Floor Hall-Right-WF, Initial	0.001	<0.001	mg/L	
240307R148	31	New Wing, 1st Floor Hall-Right-BF, Initial	0.001	<0.001	mg/L	
240307R149	32	New Wing Main Office Kitchenette-SK, Initial	0.001	<0.001	mg/L	
240307R150	33	New Wing Wellness Room-SK, Initial	0.001	<0.001	mg/L	
240307R151	34	New Wing by Room 220-Left-WF, Initial	0.001	<0.001	mg/L	
240307R152	35	New Wing by Room 220-Right-WF, Initial	0.001	<0.001	mg/L	
240307R153	36	New Wing by Room 220-Right-BF, Initial	0.001	<0.001	mg/L	
240307R154	37	Room B20-Wood Shop-SK, Initial	0.001	<0.001	mg/L	
240307R155	38	Room B21-WF, Initial	0.001	0.003	mg/L	
240307R156	39	Room B21-SK, Initial	0.001	0.002	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2403805-30071

June 10, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Westbury Middle School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 06, 2024. New York Environmental analyzed the samples on June 10, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	06 Jun 2024
Date Received:	06 Jun 2024
Date Analyzed:	10 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240606Q029	A1	Kitchen Pot Filler-PF, Initial	0.001	0.005	mg/L	
240606Q030	B1	Kitchen Pot Filler-PF, 15 Sec Flush	0.001	0.001	mg/L	
240606Q031	C1	Kitchen Pot Filler-PF, 60 Sec Flush	0.001	<0.001	mg/L	
240606Q032	A2	Kitchen Steamer-SK, Initial	0.001	<0.001	mg/L	
240606Q033	B2	Kitchen Steamer-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606Q034	C2	Kitchen Steamer-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240606Q035	A3	Room 102-Home Economics @A-SK, Initial	0.001	0.006	mg/L	H
240606Q036	B3	Room 102-Home Economics @A-SK, 15 Sec Flush	0.001	0.001	mg/L	
240606Q037	C3	Room 102-Home Economics @A-SK, 60 Sec Flush	0.001	0.001	mg/L	
240606Q038	A4	Room 102-Home Economics @B-SK, Initial	0.001	0.012	mg/L	H
240606Q039	B4	Room 102-Home Economics @B-SK, 15 Sec Flush	0.001	0.003	mg/L	
240606Q040	C4	Room 102-Home Economics @C-SK, 60 Sec Flush	0.001	0.004	mg/L	
240606Q041	5	Hall by Room 207-WF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

NYE Report #: 2404346-30418

June 27, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Westbury Middle School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 26, 2024. New York Environmental analyzed the samples on June 27, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	25 Jun 2024
Date Received:	26 Jun 2024
Date Analyzed:	27 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240626Q007	1A	Room 102 Sink A-SK, Initial	0.001	<0.001	mg/L	
240626Q008	1B	Room 102 Sink A-SK, 15 Sec Flush	0.001	NA	mg/L	
240626Q009	1C	Room 102 Sink A-SK, 60 Sec Flush	0.001	NA	mg/L	
240626Q010	2A	Room 102 Sink B-SK, Initial	0.001	0.001	mg/L	
240626Q011	2B	Room 102 Sink B-SK, 15 Sec Flush	0.001	NA	mg/L	
240626Q012	2C	Room 102 Sink B-SK, 60 Sec Flush	0.001	NA	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

NA: Sample not analyzed per customer request.

Appendix F
Westbury High School

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0002	0001-01	Custodial Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1073F	1001-01	Kitchen Staff Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1073B	1001-02	Kitchen Ice Machine	IM	App	<1.0	3/7/2024	-	-	-	-
	1001-03	Kitchen 2-Bay	SK	App	<1.0	3/7/2024	-	-	-	-
	1001-04	Kitchen 3-Bay Left	SK	App	<1.0	3/7/2024	-	-	-	-
	1001-05	Kitchen 3-Bay Right	SK	App	<1.0	3/7/2024	-	-	-	-
	1001-06	Kitchen Prep in Corner	SK	App	6.0	3/7/2024				Mixed Valve and Sign; Remediation Complete
	1001-07	Kitchen Prep by Serving Line	SK	App	<1.0	3/7/2024	-	-	-	-
	1001-08	Kitchen Island	SK	App	<1.0	3/7/2024	-	-	-	-
1073	1002-01	Main Cafeteria	WF	App	<1.0	3/7/2024	-	-	-	-
	1002-02	Main Cafeteria	BF	App	<1.0	3/7/2024	-	-	-	-
	1002-02	Main Cafeteria Deli Handwash	SK	N/A		3/7/2024	-	-	-	Sign
	1002	Main Cafeteria	WF	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
1100	1003-01	Hall by Main Entrance	BF	App	<1.0	3/7/2024	-	-	-	-
	1003-02	Hall by Main Entrance	WF	App	<1.0	3/7/2024	-	-	-	-
1000	1004-01	Main Lobby Girl's Bathroom Left	SK	N/A		3/7/2024	-	-	-	Sign
	1004-02	Main Lobby Girl's Bathroom Left Middle	SK	N/A		3/7/2024	-	-	-	Sign
	1004-03	Main Lobby Girl's Bathroom Right Middle	SK	N/A		3/7/2024	-	-	-	Sign
	1004-04	Main Lobby Girl's Bathroom Right	SK	N/A		3/7/2024	-	-	-	Sign
1085	1005-01	Main Lobby Boy's Bathroom Left	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1085	1005-02	Main Lobby Boy's Bathroom Right	SK	N/A		3/7/2024	-	-	-	Sign
-	1006-01	Custodial Closet in Main Lobby	SS	N/A		3/7/2024	-	-	-	Sign
1001B	1007-01	Principal's Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1004A	1008-01	Nurse's Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1004	1008-02	Nurse's Office	SK	App	5.0	3/7/2024	-	-	-	-
1006B1	1009-01	Faculty Room Men's Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1006	1009-02	Faculty Room	WF	App	<1.0	3/7/2024	-	-	-	-
	1009-03	Faculty Room	BF	App	<1.0	3/7/2024	-	-	-	-
	1009-04	Faculty Room	SK	App	<1.0	3/7/2024	-	-	-	-
1006A1	1009-05	Faculty Room Women's Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
1078	1010-01	Girl's Bathroom by Suite 112 Social Worker	SK	N/A		3/7/2024	-	-	-	Sign
1084	1011-01	Hall by Room 111	WF	App	<1.0	6/6/2024	-	-	-	-
	1011-02	Hall by Room 111	BF	App	<1.0	6/6/2024	-	-	-	-
	1011	Hall by Room 111	WF	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
1076	1012-01	Boy's Bathroom by Suite 112 Social Worker	SK	N/A		3/7/2024	-	-	-	Sign
1074B	1013-01	Band Room	SK	App	5.0	6/6/2024	5.0	6.0	6/6/2024	60 second flush sample had a result of 6.0 ppb. Removed from Service; Pending Remediation
					21.0	3/7/2024				Removed from Service; Pending Remediation
	1013-02	Band Room Office	SK	App	4.0	6/6/2024	<1.0	<1.0	6/6/2024	Remediation Complete
					10.0	3/7/2024				Removed from Service; Pending Remediation
1017	1014-01	Boy's Bathroom by Room 119 Left	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1017	1014-02	Boy's Bathroom by Room 119 Right	SK	N/A		3/7/2024	-	-	-	Sign
1018	1015-01	Custodial Closet A-4 by Room 118	SS	N/A		3/7/2024	-	-	-	Sign
1020	1016-01	Hall by Room 119	WF	App	<1.0	6/6/2024	-	-	-	-
1020	1016-02	Hall by Room 119	BF	App	<1.0	6/6/2024	-	-	-	-
	1016	Hall by Room 119	WF	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
1019	1017-01	Room 119 Computer Lab	SK	N/A		3/7/2024	-	-	-	Sign
1025	1018-01	Girl's Bathroom by 123 Left	SK	N/A		3/7/2024	-	-	-	Sign
	1018-02	Girl's Bathroom by 123 Right	SK	N/A		3/7/2024	-	-	-	Sign
1021	1019-01	Room 120 Ceramics Counter	SK	N/A		3/7/2024	-	-	-	Sign
	1019-02	Room 120 Ceramics Unit 1 Left	SK	N/A		3/7/2024	-	-	-	Sign
	1019-03	Room 120 Ceramics Unit 1 Middle	SK	N/A		3/7/2024	-	-	-	Sign
	1019-04	Room 120 Ceramics Unit 1 Right	SK	N/A		3/7/2024	-	-	-	Sign
	1019-05	Room 120 Ceramics Unit 2 Left	SK	N/A		3/7/2024	-	-	-	Sign
	1019-06	Room 120 Ceramics Unit 2 Middle	SK	N/A		3/7/2024	-	-	-	Sign
	1019-07	Room 120 Ceramics Unit 2 Right	SK	N/A		3/7/2024	-	-	-	Sign
1023	1020-01	Health Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
	1020-02	Health Office Soiled Utility Room	SK	N/A		3/7/2024	-	-	-	Sign
	1020-03	Health Office Clean Room	SK	N/A		3/7/2024	-	-	-	Sign
	1020-04	Health Office Exam Room 1	SK	App	<1.0	3/7/2024	-	-	-	-
	1020-05	Health Office Lab	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1023	1020-06	Health Office Exam Room 2	SK	App	<1.0	3/7/2024	-	-	-	-
1024	1021-01	Room 122	SK	N/A		3/7/2024	-	-	-	Sign
1027	1022-01	Room 124	SK	N/A		3/7/2024	-	-	-	Sign
	1022-02	Room 124	SPY	N/A		3/7/2024	-	-	-	Sign
1029	1023-01	Room 126	SK	N/A		3/7/2024	-	-	-	Sign
1030A	1024-01	Room 127	SS	N/A		3/7/2024	-	-	-	Sign
1036A	1025-01	Green House	SP	N/A		3/7/2024	-	-	-	Sign
1072	1026-01	Hall by Room 129	WF	App	2.0	6/6/2024	-	-	-	-
	1026-02	Hall by Room 129	BF	App	<1.0	6/6/2024	-	-	-	-
	1026	Hall by Room 129	WF	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
1035	1027-01	Room 132 Teacher's Station	SK	N/A		3/7/2024	-	-	-	Sign
	1027-02	Room 132 Counter @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1027-03	Room 132 Counter @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1027-04	Room 132 Fume Hood	SK	N/A		3/7/2024	-	-	-	Sign
	1027-05	Room 132 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1027-06	Room 132 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1027-07	Room 132 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1027-08	Room 132 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1027-09	Room 132 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1027-10	Room 132 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1035	1027-11	Room 132 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1027-12	Room 132 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1027-13	Room 132 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1027-14	Room 132 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1027-15	Room 132 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1027-16	Room 132 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1027-17	Room 132 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1027-18	Room 132 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1027-19	Room 132 Eyewash Station	OS	N/A		3/7/2024	-	-	-	Sign
1034	1028-01	Room 131 Teacher's Station Eyewash Station	OS	N/A		3/7/2024	-	-	-	Sign
	1028-02	Room 131 Counter @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1028-03	Room 131 Counter @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1028	Room 131 Teacher's Station	SK	N/A		3/7/2024	-	-	-	Removed from Service; Converted to Eyewash
	1029-01	Room 133 Teacher's Station	SK	N/A		3/7/2024	-	-	-	Removed from Service; Fixture Removed
	1029-02	Room 133 Counter @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1029-03	Room 133 Counter @ B	SK	N/A		3/7/2024	-	-	-	Sign
1037	1030-01	Room 134 Prep Room	SK	N/A		3/7/2024	-	-	-	Sign
1038	1031-01	Room 136 Teacher's Station	SK	N/A		3/7/2024	-	-	-	Sign
	1031-02	Room 136 Counter @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1031-03	Room 136 Counter @ B	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks	
1038	1031-04	Room 136 Fume Hood	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-05	Room 136 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-06	Room 136 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-07	Room 136 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-08	Room 136 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-09	Room 136 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-10	Room 136 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-11	Room 136 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-12	Room 136 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-13	Room 136 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-14	Room 136 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-15	Room 136 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-16	Room 136 Pod 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-17	Room 136 Pod 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign	
	1031-18	Room 136 Eyewash Station	OS	N/A		3/7/2024	-	-	-	Sign	
	1083	1032-01	Room 137	SK	N/A		3/7/2024	-	-	-	Removed from Service; Fixture Removed
	1040	1033-01	Custodial Closet by Room 141	SS	N/A		3/7/2024	-	-	-	Sign
	1042	1034-01	Room 142 Teacher's Station	SK	N/A		3/7/2024	-	-	-	Sign
1034-02		Room 142 Counter	SK	N/A		3/7/2024	-	-	-	Sign	
1034-03		Room 142A	SK	App		3/7/2024	-	-	-	-	

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1042	1034-04	Room 142B	SK	N/A		3/7/2024	-	-	-	Sign
1072	1035-01	Hall by Room 153	WF	N/A		3/7/2024	-	-	-	Removed from Service; Covered
1056	1036-01	Faculty Bathroom by Room 159	SK	N/A		3/7/2024	-	-	-	Sign
1058	1037-01	Women's Faculty Bathroom by Room 159	SK	N/A		3/7/2024	-	-	-	Sign
1057	1038-01	Boy's Bathroom by Room 159 Left	SK	N/A		3/7/2024	-	-	-	Sign
	1038-02	Boy's Bathroom by Room 159 Right	SK	N/A		3/7/2024	-	-	-	Sign
1072	1039-01	Hall by Room 159	WF	App	<1.0	3/7/2024	-	-	-	-
	1039-02	Hall by Room 159	BF	App	<1.0	3/7/2024	-	-	-	-
	1039	Hall by Room 159	WF	N/A		3/7/2024	-	-	-	Removed from Service; Renovated
1059	1040-01	Custodial Closet by Room 159	SS	N/A		3/7/2024	-	-	-	Sign
1060	1041-01	Girl's Bathroom by Room 159 Left	SK	N/A		3/7/2024	-	-	-	Sign
	1041-02	Girl's Bathroom by Room 159 Right	SK	N/A		3/7/2024	-	-	-	Sign
1058	1042-01	Girl's Locker Room Coach's Office	SK	App		3/7/2024	-	-	-	-
	1042-02	Girl's Locker Room Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
	1042-03	Girl's Locker Room by Pool Left	SK	App		3/7/2024	-	-	-	-
	1042-04	Girl's Locker Room by Pool Right	SK	App		3/7/2024	-	-	-	-
1063	1043-01	Room 160 Counter 1 A	SK	N/A		3/7/2024	-	-	-	Sign
	1043-02	Room 160 Counter 1 B	SK	N/A		3/7/2024	-	-	-	Sign
	1043-03	Room 160 Counter 2 A	SK	N/A		3/7/2024	-	-	-	Sign
	1043-04	Room 160 Counter 2 B	SK	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1063	1043-05	Room 160A Prep Room	SK	N/A		3/7/2024	-	-	-	Sign
	1043-06	Room 160 Eyewash Station	OS	N/A		3/7/2024	-	-	-	Sign
1065	1044-01	Room 162 Counter 1 A	SK	N/A		3/7/2024	-	-	-	Sign
	1044-02	Room 162 Counter 1 B	SK	N/A		3/7/2024	-	-	-	Sign
	1044-03	Room 162 Counter 2 A	SK	N/A		3/7/2024	-	-	-	Sign
	1044-04	Room 162 Counter 2 B	SK	N/A		3/7/2024	-	-	-	Sign
	1044-05	Room 162A Prep Room	SK	N/A		3/7/2024	-	-	-	Sign
	1044-06	Room 162 Eyewash Station	OS	N/A		3/7/2024	-	-	-	Sign
1066	1045-01	Boy's Locker Room Pool Bathroom	WF	App	2.0	3/7/2024	-	-	-	-
	1045-02	Boy's Locker Room Pool Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
	1045-03	Boy's Locker Room Coach's Office Bathroom	SK	N/A		3/7/2024	-	-	-	Sign
	1045-04	Boy's Locker Room Coach's Office	IM	App	<1.0	3/7/2024	-	-	-	-
	1045-05	Boy's Locker Room Bathroom Left	SK	N/A		3/7/2024	-	-	-	Sign
	1045-06	Boy's Locker Room Bathroom Right	SK	N/A		3/7/2024	-	-	-	Sign
	1045-07	Boy's Locker Room	WF	App		3/7/2024	-	-	-	-
New Addition	1046-01	Girl's Bathroom by Room 178 Left	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1046-02	Girl's Bathroom by Room 178 Middle	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1046-03	Girl's Bathroom by Room 178 Right	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1047-01	Custodial Closet by Room 178	SS	N/A		3/7/2024	-	-	-	Sign
New Addition	1048-01	Boy's Bathroom by Room 178 Left	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
New Addition	1048-02	Boy's Bathroom by Room 178 Middle	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1048-03	Boy's Bathroom by Room 178 Right	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1049-01	Hall by Room 178 Left	WF	App	<1.0	3/7/2024	-	-	-	-
	1049-02	Hall by Room 178 Right	WF	App	<1.0	3/7/2024	-	-	-	-
	1049-03	Hall by Room 178 Right	BF	App	<1.0	3/7/2024	-	-	-	-
New Addition	1050-01	Hall by Room 177 Left	WF	App	<1.0	3/7/2024	-	-	-	-
	1050-02	Hall by Room 177 Right	WF	App	<1.0	3/7/2024	-	-	-	-
	1050-03	Hall by Room 177 Right	BF	App	<1.0	3/7/2024	-	-	-	-
New Addition	1051-01	Prep Room by Room 178	SK	N/A		3/7/2024	-	-	-	Sign
New Addition	1052-01	Room 178 Counter 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1052-02	Room 178 Counter 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1052-03	Room 178 Counter 2 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1052-04	Room 178 Counter 2 @ B	SK	N/A		3/7/2024	-	-	-	Sign
New Addition	1053-01	Room 177 Counter 1 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1053-02	Room 177 Counter 1 @ B	SK	N/A		3/7/2024	-	-	-	Sign
	1053-03	Room 177 Counter 2 @ A	SK	N/A		3/7/2024	-	-	-	Sign
	1053-04	Room 177 Counter 2 @ B	SK	N/A		3/7/2024	-	-	-	Sign
New Addition	1054-01	Girl's Bathroom by New Cafeteria Left	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1054-02	Girl's Bathroom by New Cafeteria Middle	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1054-03	Girl's Bathroom by New Cafeteria Right	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
New Addition	1055-01	Custodial Closet by New Cafeteria	SS	N/A		3/7/2024	-	-	-	Sign
New Addition	1056-01	Boy's Bathroom by New Cafeteria Left	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1056-02	Boy's Bathroom by New Cafeteria Middle	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
	1056-03	Boy's Bathroom by New Cafeteria Right	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1057-01	Hall by New Cafeteria Left	WF	App	<1.0	3/7/2024	-	-	-	-
	1057-02	Hall by New Cafeteria Right	WF	App	<1.0	3/7/2024	-	-	-	-
	1057-03	Hall by New Cafeteria Right	BF	App	<1.0	3/7/2024	-	-	-	-
New Addition	1058-01	Left Faculty Bathroom by New Cafeteria	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1059-01	Right Faculty Bathroom by New Cafeteria	SK	N/A		3/7/2024	-	-	-	Mixed Valve; Sign
New Addition	1060-01	New Cafeteria Handwash	SK	N/A		3/7/2024	-	-	-	Sign
1093	1061-01	Custodial Closet by Auxiliary Gym	SS	N/A		3/7/2024	-	-	-	Sign
1087	1062-01	Gym	WF	App	<1.0	3/7/2024	-	-	-	-
1097	1063-01	Custodial Closet by Laundry	SS	N/A		3/7/2024	-	-	-	Sign
1087	1064-01	PE Office Bathroom by Gym	SK	N/A		3/7/2024	-	-	-	Sign
-	1065-01	Storage Closet by Gym Pool Pump	OS	N/A		3/7/2024	-	-	-	Sign
-	1066-01	Pool Pump Room	SS	N/A		3/7/2024	-	-	-	Sign
2000	2001-01	Girl's Bathroom by Room 256 Left	SK	N/A		3/7/2024	-	-	-	Sign
	2001-02	Girl's Bathroom by Room 256 Right	SK	N/A		3/7/2024	-	-	-	Sign
2015	2002-01	Hall by Room 256	WF	App	<1.0	3/7/2024	-	-	-	-
	2002-02	Hall by Room 256	BF	App	<1.0	3/7/2024	-	-	-	-
2001	2003-01	Custodial Closet by Room 256	SS	N/A		3/7/2024	-	-	-	Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2002	2004-01	Boy's Bathroom by Room 256 Left	SK	N/A		3/7/2024	-	-	-	Sign
	2004-02	Boy's Bathroom by Room 256 Right	SK	N/A		3/7/2024	-	-	-	Sign

Laboratory Report
NYE Report #: 2401274-28741

March 11, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Westbury High School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on March 07, 2024. New York Environmental analyzed the samples on March 08, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	07 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307Q001	1	Kitchen Ice Machine-IM, Initial	0.001	<0.001	mg/L	
240307Q002	2	Kitchen 2-Bay-SK, Initial	0.001	<0.001	mg/L	
240307Q003	3	Kitchen 3-Bay Left-SK, Initial	0.001	<0.001	mg/L	
240307Q004	4	Kitchen 3-Bay Right-SK, Initial	0.001	<0.001	mg/L	
240307Q005	5	Kitchen Prep in Corner-SK, Initial	0.001	0.006	mg/L	H
240307Q006	6	Kitchen Prep by Serving Line-SK, Initial	0.001	<0.001	mg/L	
240307Q007	7	Kitchen Island-SK, Initial	0.001	<0.001	mg/L	
240307Q008	8	Main Cafeteria -WF, Initial	0.001	<0.001	mg/L	
240307Q009	9	Main Cafeteria -BF, Initial	0.001	<0.001	mg/L	
240307Q010	10	Hall by Main Entrance-WF, Initial	0.001	<0.001	mg/L	
240307Q011	11	Hall by Main Entrance-BF, Initial	0.001	<0.001	mg/L	
240307Q012	12	Nurse's Office-SK, Initial	0.001	0.005	mg/L	
240307Q013	13	Faculty Room -WF, Initial	0.001	<0.001	mg/L	
240307Q014	14	Faculty Room -BF, Initial	0.001	<0.001	mg/L	
240307Q015	15	Faculty Room -SK, Initial	0.001	<0.001	mg/L	
240307Q016	16	Band Room-SK, Initial	0.001	0.021	mg/L	H
240307Q017	17	Band Room Office-SK, Initial	0.001	0.010	mg/L	H
240307Q018	18	Health Office Exam Room 2-SK, Initial	0.001	<0.001	mg/L	
240307Q019	19	Health Office Exam Room 1-SK, Initial	0.001	<0.001	mg/L	
240307Q020	20	Hall by Room 159-WF, Initial	0.001	<0.001	mg/L	
240307Q021	21	Hall by Room 159-BF, Initial	0.001	<0.001	mg/L	
240307Q022	22	Boy's Locker Room Pool Bathroom-WF, Initial	0.001	0.002	mg/L	
240307Q023	23	Boy's Locker Room Coach's Office-IM, Initial	0.001	<0.001	mg/L	
240307Q024	24	Hall by Room 178 Left-WF, Initial	0.001	<0.001	mg/L	
240307Q025	25	Hall by Room 178 Right-WF, Initial	0.001	<0.001	mg/L	
240307Q026	26	Hall by Room 178 Right-BF, Initial	0.001	<0.001	mg/L	
240307Q027	27	Hall by Room 177 Left-WF, Initial	0.001	<0.001	mg/L	



Date Collected:	07 Mar 2024
Date Received:	07 Mar 2024
Date Analyzed:	08 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240307Q028	28	Hall by Room 177 Right-WF, Initial	0.001	<0.001	mg/L	
240307Q029	29	Hall by Room 177 Right-BF, Initial	0.001	<0.001	mg/L	
240307Q030	30	Hall by New Cafeteria Left-WF, Initial	0.001	<0.001	mg/L	
240307Q031	31	Hall by New Cafeteria Right-WF, Initial	0.001	<0.001	mg/L	
240307Q032	32	Hall by New Cafeteria Right-BF, Initial	0.001	<0.001	mg/L	
240307Q033	33	Gym-WF, Initial	0.001	<0.001	mg/L	
240307Q034	34	Hall by Room 256 -WF, Initial	0.001	<0.001	mg/L	
240307Q035	35	Hall by Room 256 -BF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2403808-30074

June 10, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Westbury High School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on June 06, 2024. New York Environmental analyzed the samples on June 07, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	06 Jun 2024
Date Received:	06 Jun 2024
Date Analyzed:	07 Jun 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
240606R001	2	Hall by Room 111-WF, Initial	0.001	<0.001	mg/L	
240606R002	3	Hall by Room 111-BF, Initial	0.001	<0.001	mg/L	
240606R003	4A	Band Room-SK, Initial	0.001	0.005	mg/L	
240606R004	4B	Band Room-SK, 15 Sec Flush	0.001	0.005	mg/L	
240606R005	4C	Band Room-SK, 60 Sec Flush	0.001	0.006	mg/L	H
240606R006	5A	Band Room Office-SK, Initial	0.001	0.004	mg/L	
240606R007	5B	Band Room Office-SK, 15 Sec Flush	0.001	<0.001	mg/L	
240606R008	5C	Band Room Office-SK, 60 Sec Flush	0.001	<0.001	mg/L	
240606R009	6	Hall by Room 119-WF, Initial	0.001	<0.001	mg/L	
240606R010	7	Hall by Room 119-BF, Initial	0.001	<0.001	mg/L	
240606R011	8	Hall by Room 129-WF, Initial	0.001	0.002	mg/L	
240606R012	9	Hall by Room 129-BF, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Appendix G
Westbury Administration Building

AHRA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1009	1001-1	Administrative Kitchen	SK	App	2.0	3/8/2024	-	-	-	-
1009A	1001-2	Administrative Kitchen Bathroom	SK	N/A		3/8/2024	-	-	-	Sign
1011C	1003-1	Business Office Women's Bathroom	SK	N/A		3/8/2024	-	-	-	Sign
1011D1	1003-2	Treasurer Office Bathroom	SK	N/A		3/8/2024	-	-	-	Sign
1007	1004-1	Custodial Closet	SS	N/A		3/8/2024	-	-	-	Sign
1006	1005-1	Men's Bathroom by Stairwell	SK	N/A		3/8/2024	-	-	-	Sign
2000	2001-1	2nd Floor Women's Bathroom	SK	N/A		3/8/2024	-	-	-	Sign
3003	3001-1	3rd Floor Bathroom	SK	N/A		3/8/2024	-	-	-	Sign

Laboratory Report

NYE Report #: 2401326-28777

March 12, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Westbury Administration Building

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on March 11, 2024. New York Environmental analyzed the samples on March 12, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	08 Mar 2024
Date Received:	11 Mar 2024
Date Analyzed:	12 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
240311K005	1	Administrative Kitchenette-SK, Initial	0.001	0.002	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

Appendix H
Westbury Facilities Building

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1022	1001-1	Facilities Kitchenette	SK	App	<1.0	3/8/2024	-	-	-	-
1018	1002-1	People Personel	SK	App	<1.0	3/8/2024	-	-	-	-
1020	1003-1	Facilities Men's Bathroom	SK	N/A		3/8/2024	-	-	-	Mixed Valve; Sign
1019	1004-1	Facilities Women's Bathroom - left	SK	N/A		3/8/2024	-	-	-	Mixed Valve; Sign
1019	1004-2	Facilities Women's Bathroom - right	SK	N/A		3/8/2024	-	-	-	Mixed Valve; Sign
1017	1005-1	Hall by Women's Bathroom	SK	N/A		3/8/2024	-	-	-	Sign
1017	1005-2	Hall by Men's Bathroom	SK	N/A		3/8/2024	-	-	-	Sign
1011	1006-1	Break Room Kitchenette	SK	App	<1.0	3/8/2024	-	-	-	-
1011	1006-2	Break Room Kitchenette	SPY	App	<1.0	3/8/2024	-	-	-	-
1002A	1007-1	Transportation Bathroom	SK	N/A		3/8/2024	-	-	-	Sign
1011A	1008-1	Exterior by Grounds Men's Bathroom	SK	N/A		3/8/2024	-	-	-	Sign

Laboratory Report

NYE Report #: 2401327-28778

March 12, 2024

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Westbury UFSD; Westbury Facilities Building

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on March 11, 2024. New York Environmental analyzed the samples on March 12, 2024 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	08 Mar 2024
Date Received:	11 Mar 2024
Date Analyzed:	12 Mar 2024

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

<u>Lab ID</u>	<u>CID</u>	<u>Sample Location/Description</u>	<u>LOQ</u>	<u>Result</u>	<u>Units</u>	<u>Flag</u>
240311K006	1	Facilities Kitchenette-SK, Initial	0.001	<0.001	mg/L	
240311K007	2	People Personel Kitchenette-SK, Initial	0.001	<0.001	mg/L	
240311K008	3	Breakroom Kitchenette-SK, Initial	0.001	<0.001	mg/L	
240311K009	4	Breakroom Kitchenette-SPY, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation