

3636 N. 124th Street
Wauwatosa, WI 53222

LEAD CLEARANCE INSPECTION REPORT

Performed On: 08/22/2025

For Site Located at: Neeskara Elementary School, 1601 N. Hawley Road Milwaukee, WI 53208

Owner's Name: Milwaukee Public Schools



Inspection Performed By:

Pratap Singh, Ph.D., PE, Principal Engineer
DHS Certification #: LRA-239393
Abigail Scherwitz, Staff Engineer
DHS Certification #: ILL-302066

DHS Lead Company:

K. Singh & Associates, Inc.
Certification Number: DHS-2473250
Ph: (262) 821-1171

Submitted to:

Mr. Brian Berner, MS
Environmental Health Inspector
Dept. of Facilities and Maintenance Services
Milwaukee Public School
1124 N. 11th Street
Milwaukee, WI 53233

September 11, 2025

Mr. Brian Berner
Milwaukee Public Schools
1124 N. 11th Street
Milwaukee, WI 53233

Project #40638

Subject: Lead Clearance Inspection Report for Milwaukee Public Schools, Neeskara Elementary School, 1601 N. Hawley Road, Milwaukee, WI. 53208

Dear Mr. Berner:

Enclosed please find the Lead Clearance Inspection Report which K. Singh & Associates has prepared for the referenced property.

We appreciate the opportunity to provide environmental services for the project. If we can be of further assistance in discussing this report with you, please contact us.

Sincerely,

K. SINGH & ASSOCIATES, INC.



Pratap N. Singh, Ph.D., PE
Principal Engineer



Abigail M. Scherwitz
Staff Engineer



Robert Reineke, PE
Senior Engineer

LEAD CLEARANCE INSPECTION REPORT

NEESKARA ELEMENTARY SCHOOL
1601 N. HAWLEY ROAD
MILWAUKEE, WISCONSIN 53208

SEPTEMBER 11, 2025

PREPARED BY

K. SINGH & ASSOCIATES, INC.
ENGINEERS, SCIENTISTS, AND ENVIRONMENTAL CONSULTANTS
3636 N. 124TH STREET, SUITE 100
WAUWATOSA, WI 53222
(262) 821-1171
(262) 821-1174 FACSIMILE
WWW.KSINGHENGINEERING.COM

PREPARED FOR

MILWAUKEE PUBLIC SCHOOLS
ATTN: MR. BRIAN BERNER
1124 N. 11th STREET
MILWAUKEE, WI 53233

PROJECT #40638

This inspection was conducted by:

Pratap N. Singh, Ph.D., P.E.
Lead Risk Assessor Number: LRA-239393
K. Singh & Associates, Inc.

I certify that I prepared this report, performed sampling, and that I am a certified Lead Risk Assessor meeting the certification and training course requirements as set forth in Wisconsin Administrative Code chapter DHS 163.



Abigail M. Scherwitz
Lead Inspector Number: ILL-302066
K. Singh & Associates, Inc.

I certify that I prepared this report, performed sampling, and that I am a certified Lead Inspector meeting the certification and training course requirements as set forth in Wisconsin Administrative Code chapter DHS 163.



TABLE OF CONTENTS

EXECUTIVE SUMMARY	1
SECTION I. INTRODUCTION	2
1.1 Purpose and Scope.....	2
1.2 Reliance	3
SECTION II. LEAD CLEARANCE EXAMINATION	4
2.1 Safety Information	4
2.2 Inspection Methods	4
2.3 Dust Analysis	4
2.4 Conclusions and Recommendation.....	5
SECTION III. EXCLUSIONS AND LIMITATIONS.....	6
3.1 Excluded Inspection Locations.....	6
3.2 Limitations of Investigation	6
SECTION IV. REFERENCES.....	7

FIGURES

TABLES

APPENDICES

LIST OF FIGURES

- FIGURE 1: Ground Floor Sample Locations
- FIGURE 2: First Floor Sample Locations
- FIGURE 3: Second Floor Sample Locations
- FIGURE 4: Third Floor Sample Locations

LIST OF TABLES

TABLE 1: Wipe Sampling Summary

LIST OF APPENDICES

APPENDIX A:	Visual Assessment Results
APPENDIX B:	Chain of Custody and Laboratory Results

EXECUTIVE SUMMARY

K. Singh & Associates, Inc. (KSingh), was retained by Milwaukee Public Schools (MPS) to conduct a lead-based clearance testing at Neeskara Elementary School, 1601 N. Hawley Road, Milwaukee, Wisconsin 53208. The building is a 4-story building covered with brick used as an Elementary School. As part of this inspection, KSingh performed a visual inspection and collected lead-based paint dust samples from interior components for laboratory analysis.

Lead Clearance Examination

Lead clearance examinations are conducted to verify that dust lead levels meet regulatory clearance standards following abatement activities. Abatement work at the school was completed by contractor Paul Davis prior to August 15, 2025. Abatement was assumed to not be conducted in containment. KSingh mobilized to the site on August 22, 2025, to perform the post-abatement clearance inspection. Clearance inspection was performed more than 1 day following abatement and cleaning. The inspection was performed on August 22, 2025, by Pratap Singh (LRA-239393) and Abigail Scherwitz (ILL-302066) to evaluate the interior components of the four-story building for compliance with applicable lead clearance criteria. All rooms and common areas that were tested passed the visual inspection.

A total of 56 samples were collected and analyzed during the lead clearance examination. The inspection included floors and windowsills; however, window troughs were not accessible at the time of inspection. No porches were present, and no exterior work was performed. Of the 56 dust samples collected, 8 samples failed. Please note the following:

- All 8 of the failed samples were floor samples. These floor samples have a threshold of 10.0 $\mu\text{g}/\text{ft}^2$.
- Exceedances were identified as follows: one on the ground floor, five on the first floor, one on the second floor, and one on the third floor.
- All hallway floor samples on the first floor exceeded the threshold of 10.0 $\mu\text{g}/\text{ft}^2$.
- The following samples exceeded clearance standards: 10-1, 1000-1, 1000-2, 1000-3, 1000-4, 108-1, 211-1, and 313-1

In accordance with DHS 163 lead clearance protocols, sampling was conducted in designated interior areas following post-abatement cleanup. Sampling locations included all kindergarten and younger classrooms, dead-end corridors, corridor intersections, one boys' and one girls' bathroom per floor, and all rooms identified by the building engineer as special needs rooms. In the absence of K-5 or younger classrooms or special needs rooms on a given floor, four classrooms were randomly selected for dust wipe sampling.

Due to the 8 failed samples, Neeskara Elementary School has failed clearance. The contractor was notified of their responsibility to re-clean all failed components and all like components in all unsampled rooms.

SECTION I. INTRODUCTION

1.1 Purpose and Scope

K. Singh & Associates, Inc. (KSingh), was retained by Milwaukee Public Schools (MPS) to conduct a lead-based clearance testing at Neeskara Elementary School, 1601 N. Hawley Road, Milwaukee, Wisconsin 53208. The building is a 4-story building, covered with brick, used as an Elementary School. As part of this inspection, KSingh performed a visual inspection and collected lead-based paint dust samples from interior components for laboratory analysis.

Abatement work at the school was completed by contractor Paul Davis prior to August 15, 2025. Abatement was assumed to not be conducted in containment. A layout of the building can be found in Figure 1. On August 22, 2025, a visual inspection was conducted for the following rooms:

- Room 13
- Room 11
- Room 10
- Room 8
- Bathroom 6
- Bathroom 17
- Gym/Lunch room
- Room 106
- Room 103
- Room 101
- Room 109
- Room 108
- Room 103B
- Room 210
- Room 209
- Room 211
- Room 203
- Room 201
- Room 313
- Room 315
- Room 310
- Room 309
- Room 305
- Room 302

No visible dust, debris, or paint chips were observed on floors or any horizontal surfaces within the work areas or adjacent areas. All painted surfaces not previously tested and confirmed to be lead-free were found to be in good condition at the time of this clearance examination. The Visual Assessment (form 15.1) from the U.S. Department of Housing and Urban Development (HUD), can be found in Appendix A.

A minimum of one day elapsed before clearance testing commenced following abatement and cleaning. Dust wipe samples were collected following documented protocol and sampling methodologies found in Wisconsin Admin. Code ch. DHS 163. The field collection of settled dust samples using wipe sampling methods is used to determine the presence of lead dust hazards on floors and windowsills in a child-occupied structure. In Wisconsin, to pass clearance floors and windowsills must have laboratory sample results showing all sampled surfaces have amounts of lead dust less than 10 micrograms per square foot ($\mu\text{g}/\text{ft}^2$) on floors and 100 $\mu\text{g}/\text{ft}^2$ on windowsills.

In accordance with DHS 163 lead clearance protocols, sampling was conducted in designated interior areas following post-abatement cleanup. Sampling locations included all kindergarten and younger classrooms, dead-end corridors, corridor intersections, one boys' and one girls' bathroom per floor, and all rooms identified by the building engineer as special needs rooms. In the absence of K-5 or younger classrooms or special needs rooms on a given floor, four classrooms were randomly selected for dust wipe sampling.

1.2 Reliance

This report has been prepared for the use of our client, Milwaukee Public Schools. KSingh represents that within the limitation of the agreed upon scope of work, this work has been undertaken and performed in a professional manner, in accordance with generally accepted lead-based paint assessment practices, using the degree of skill and care ordinarily exercised by reputable consultants under similar circumstances, makes no other warranties, either expressed or implied.

SECTION II. LEAD CLEARANCE EXAMINATION

2.1 Safety Information

Where lead in paint is known or suspected, the owner and contractors must follow the OSHA lead in construction regulation 29 CFR 1926.62 (7). This applies for demolition or salvage of structures where lead or materials containing lead are present, not just for lead-based paint (>0.06% Lead).

Workers must take necessary care to limit the amount of lead dust generated and follow OSHA safety requirements for lead exposure. The regulation requires, in certain circumstances:

- Use of respiratory protection and protective clothing,
- Hygiene areas,
- Engineering controls to control lead dust,
- Worker training

2.2 Inspection Methods

On August 22, 2025, a total of 56 dust wipe samples were collected and analyzed as part of the post-abatement clearance process.

All samples were analyzed by:

EMSL Analytical, Inc.
4140 Litt Drive
Hillside, IL, 60162
856-858-4800
Accreditation ID: #102992

A visual inspection was conducted upon arrival, and a visual inspection form is included in Appendix A. Laboratory analysis of dust wipe samples were completed by EMSL Analytical and are included in Appendix B.

2.3 Dust Analysis

All 56 dust wipe samples collected during the August 22, 2025, clearance inspection were analyzed by an accredited laboratory and reported in Table 1 within the applicable clearance thresholds of 10.0 $\mu\text{g}/\text{ft}^2$ for floors and 100.0 $\mu\text{g}/\text{ft}^2$ for windowsills; however, window troughs were not accessible at the time of inspection. Minor variations in results, such as 7.5 $\mu\text{g}/\text{ft}^2$ compared to 8.0 $\mu\text{g}/\text{ft}^2$, are expected and can be attributed to the standardized area size used for each wipe sample. These variations are typical and do not affect the overall findings.

Hallways were addressed in accordance with the clearance requirement of at least one sample per 2,000 square feet of common-area floor space, with documentation of the specific sample locations available for verification.

2.4 Conclusions and Recommendation

Based on the results of laboratory analysis, eight lead hazards were identified throughout the building, and the property has failed the clearance testing. All of these samples were floor samples, each exceeding the threshold of 10.0 $\mu\text{g}/\text{ft}^2$. Of these, two were taken in classrooms (rooms 10 and 108), two from bathrooms (bathroom 211 and 313), and four from a common hallway area (1000-1, 1000-2, 1000-3, 1000-4). The contractor was notified of their responsibility to re-clean all failed components and all like components in all unsampled rooms.

SECTION III. EXCLUSIONS AND LIMITATIONS

3.1 Excluded Inspection Locations

This report represents the condition of the building and its visible/accessible materials at the date and the times of the onsite inspection. Areas and materials that were hidden or not accessible are excluded, including areas within walls, exterior, and above ceilings. Unsampld areas may present potential for residual lead-based dust. Hidden materials or those materials that could not be accessed at the point of inspection, over and above those stated in the inspection report, are the responsibility of the building owner and the demolition/renovation contractor.

3.2 Limitations of Investigation


The care and skill given to our procedures ensures the most reliable test results possible. The findings and conclusions of KSingh represent our professional opinions extrapolated from limited data. Significant limited data is gathered during the building inspection. No other warranty is expressed or implied. Prior to any abatement, demolition, or renovation activities, it is recommended that KSingh be provided the opportunity to review such plans in order that the inspection and assessments contained herein are properly interpreted and implemented.

This report and the information contained herein are prepared for the sole and exclusive use and possession of Milwaukee Public Schools and Wisconsin Department of Health Services. No other person or entity may rely on this report or any information contained herein without a reliance letter. Any dissemination of the Report or any information contained herein is strictly prohibited without prior written authorization from KSingh and Associates, Inc.

SECTION IV. REFERENCES

1. Chapter DHS 163: Certification for the Identification, Removal, and Reduction of Lead-Based Paint Hazards. Wisconsin Administrative Code, Department of Health Services (DHS). Register July 2025 No. 835.

FIGURES

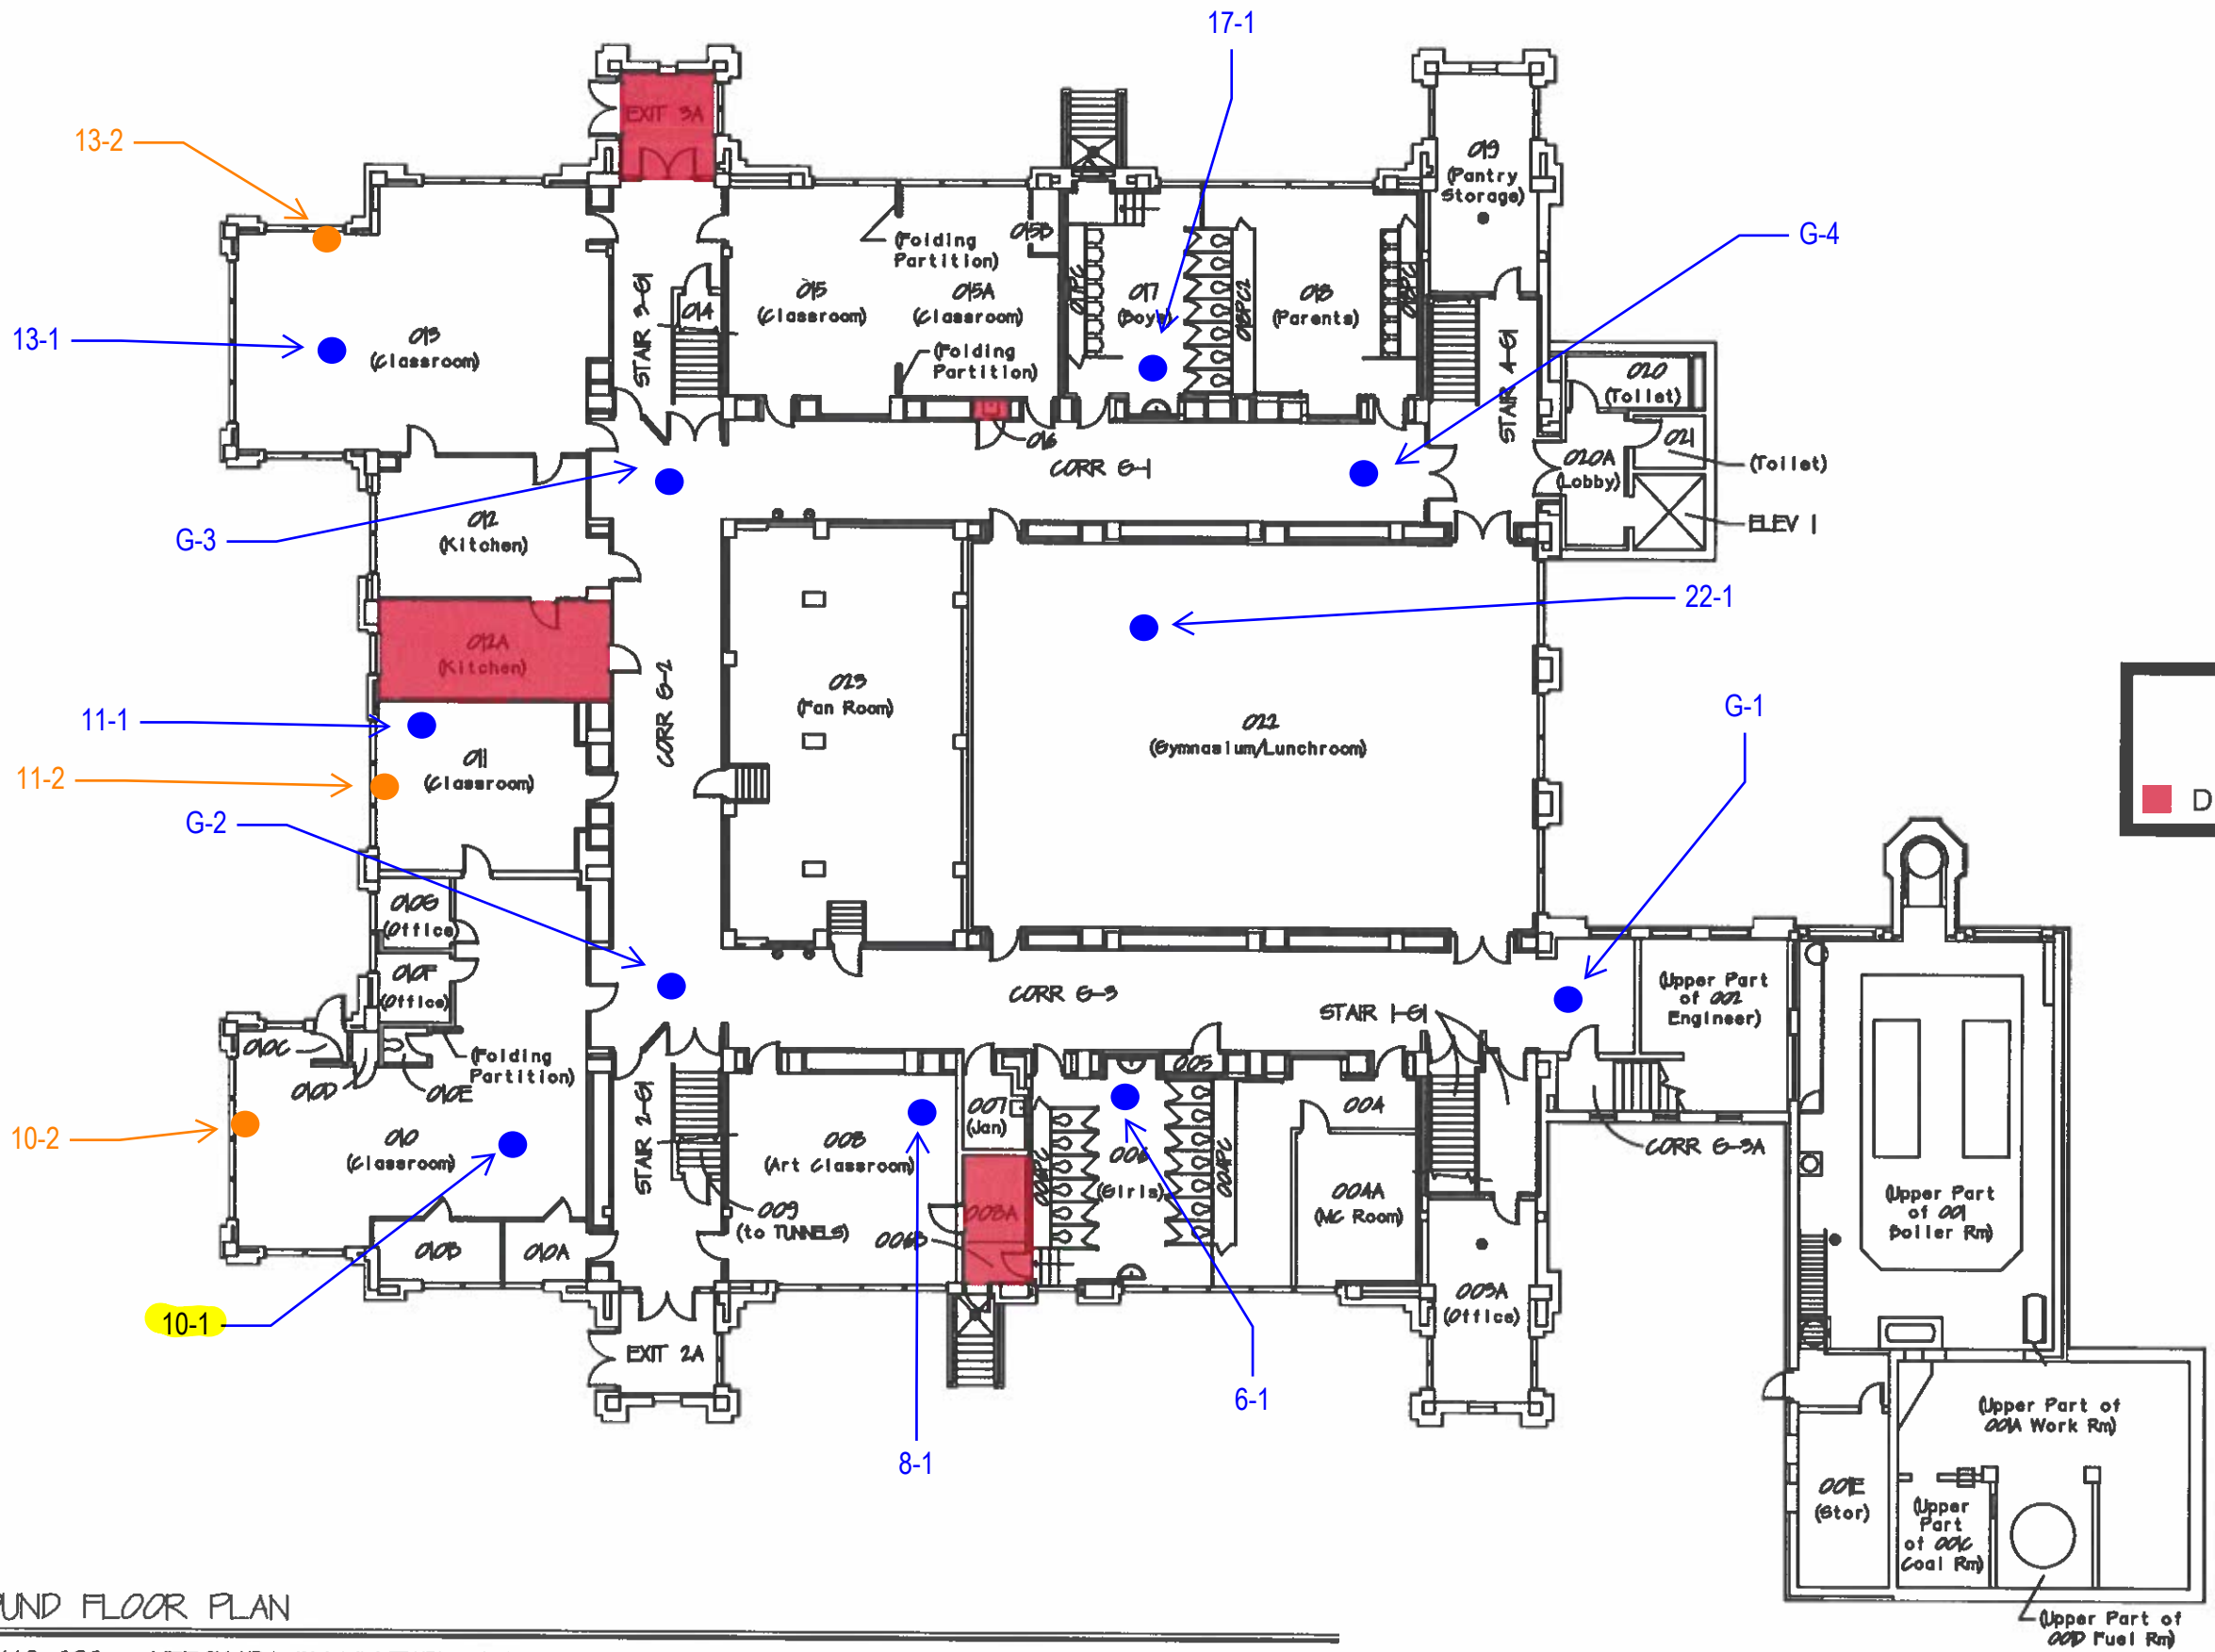


Legend	
Label	Quantity
 DHS 163	525.22


Legend	
	Floor sample location
	Sill sample location
	Exceeds Standards
	Abatement areas conducted

GROUND FLOOR PLAN

SITE NO. 283 - NEESKARA ELEMENTARY SCHOOL
 1601 N. HAWLEY RD., MILW., WI., 53208
 DATE: 9/15/08

Figure 1: Ground Floor Sample Locations

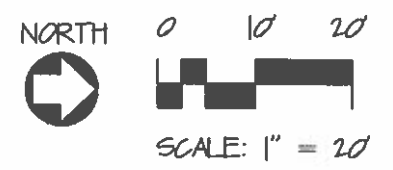

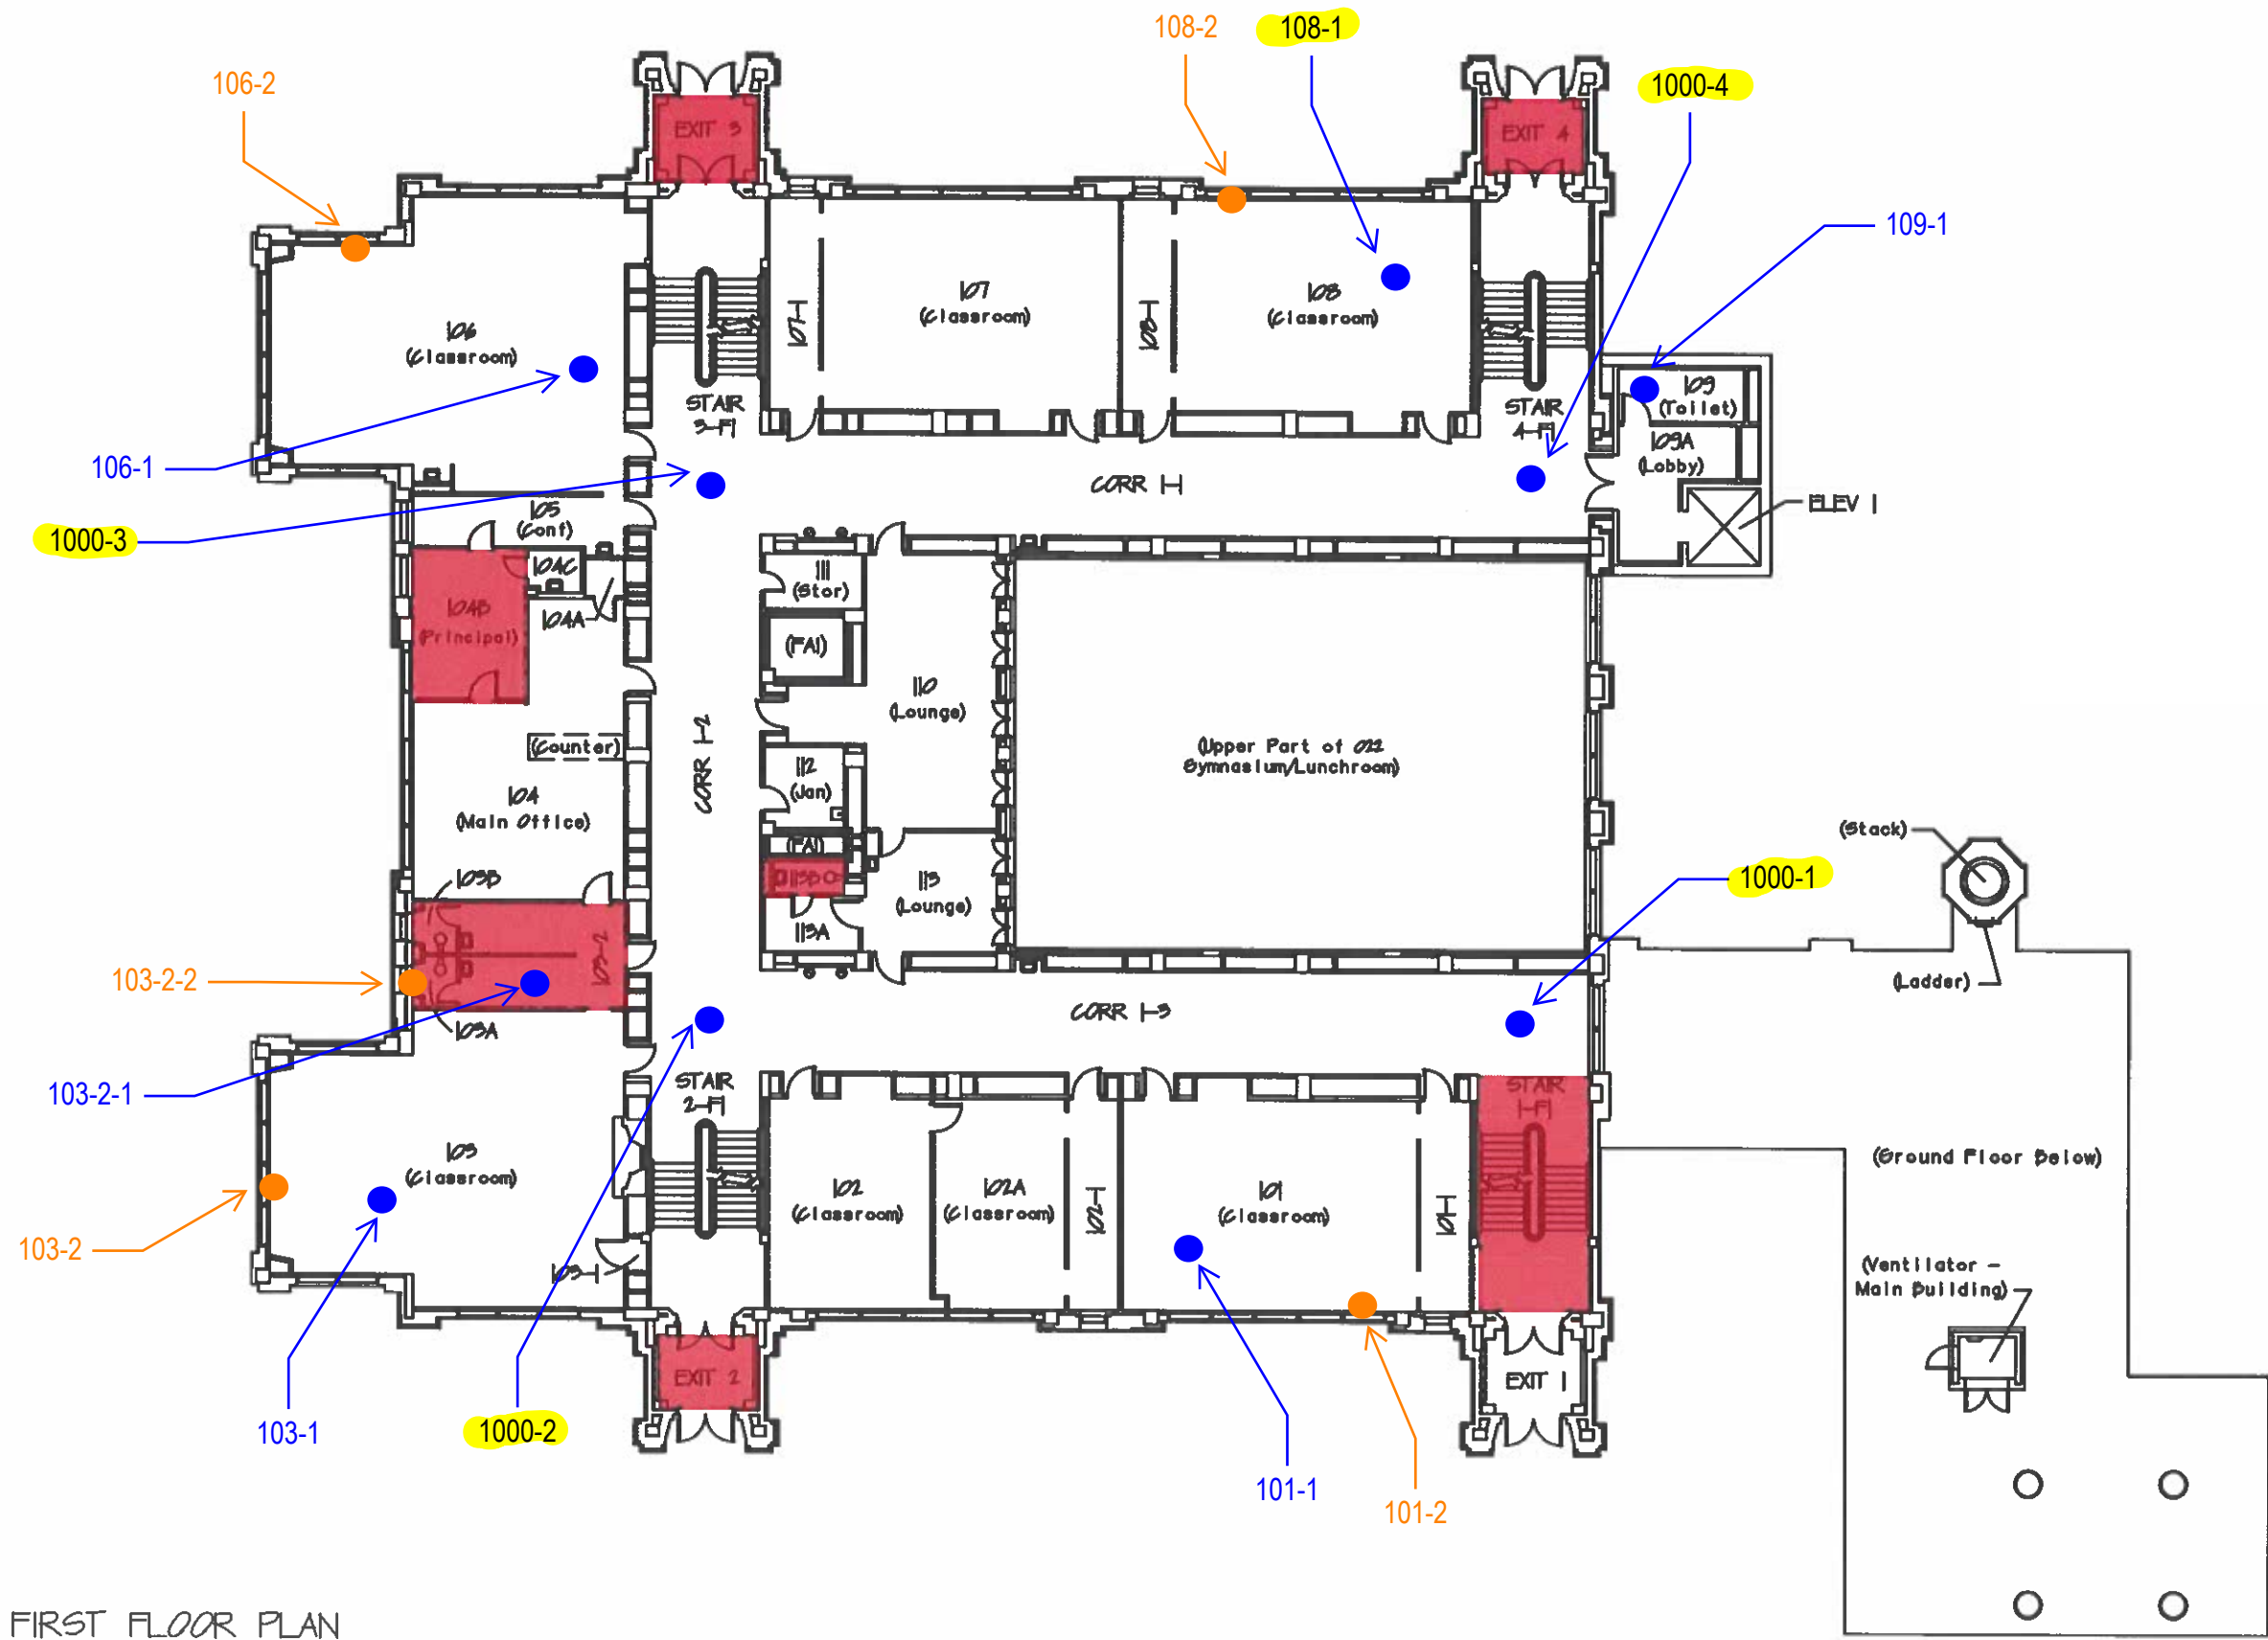

Legend

- Floor sample location
- Sill sample location
- Exceeds Standards
- Abatement areas conducted


NORTH

0 10 20

 SCALE: 1" = 20'

FIRST FLOOR PLAN
 SITE NO. 283 - NEESKARA ELEMENTARY SCHOOL
 1601 N. HAWLEY RD., MILW., WI., 53208
 DATE: 9/15/08

Figure 2: First Floor Sample Locations

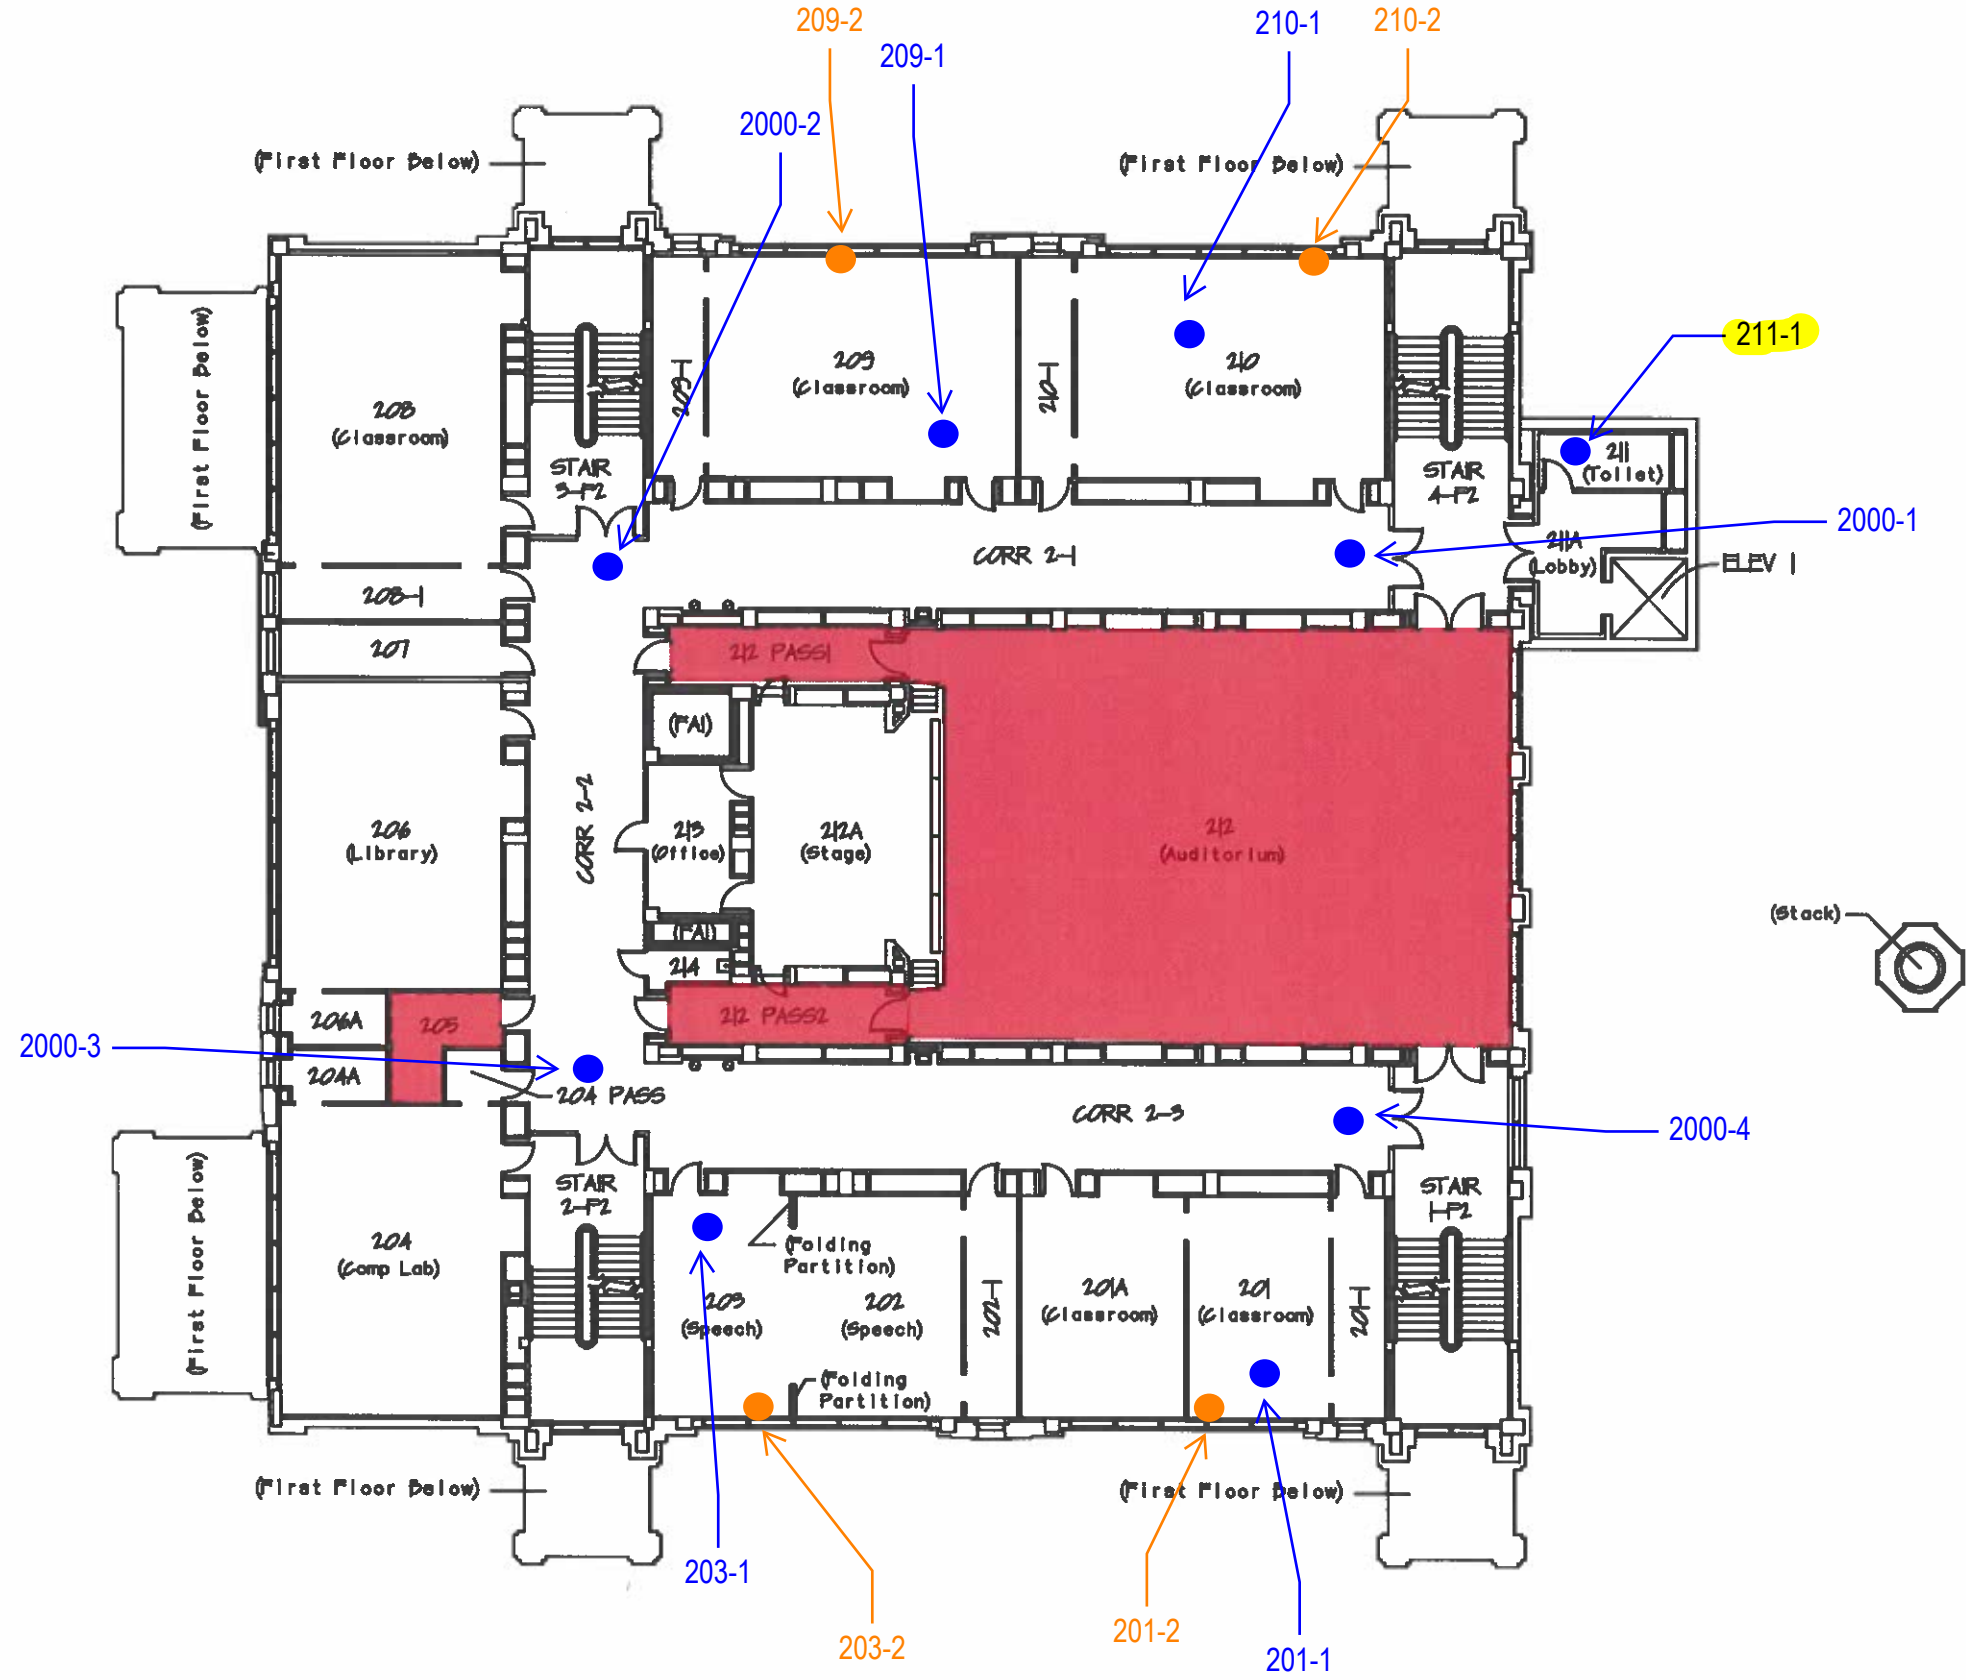

Legend

- Floor sample location
- Sill sample location
- Exceeds Standards
- Abatement areas conducted


NORTH

SCALE: 1" = 20'

SECOND FLOOR PLAN

SITE NO. 283 - NEESKARA ELEMENTARY SCHOOL
 1601 N. HAWLEY RD., MILW., WI., 53108
 DATE: 9/15/08

Figure 3: Second Floor Sample Locations

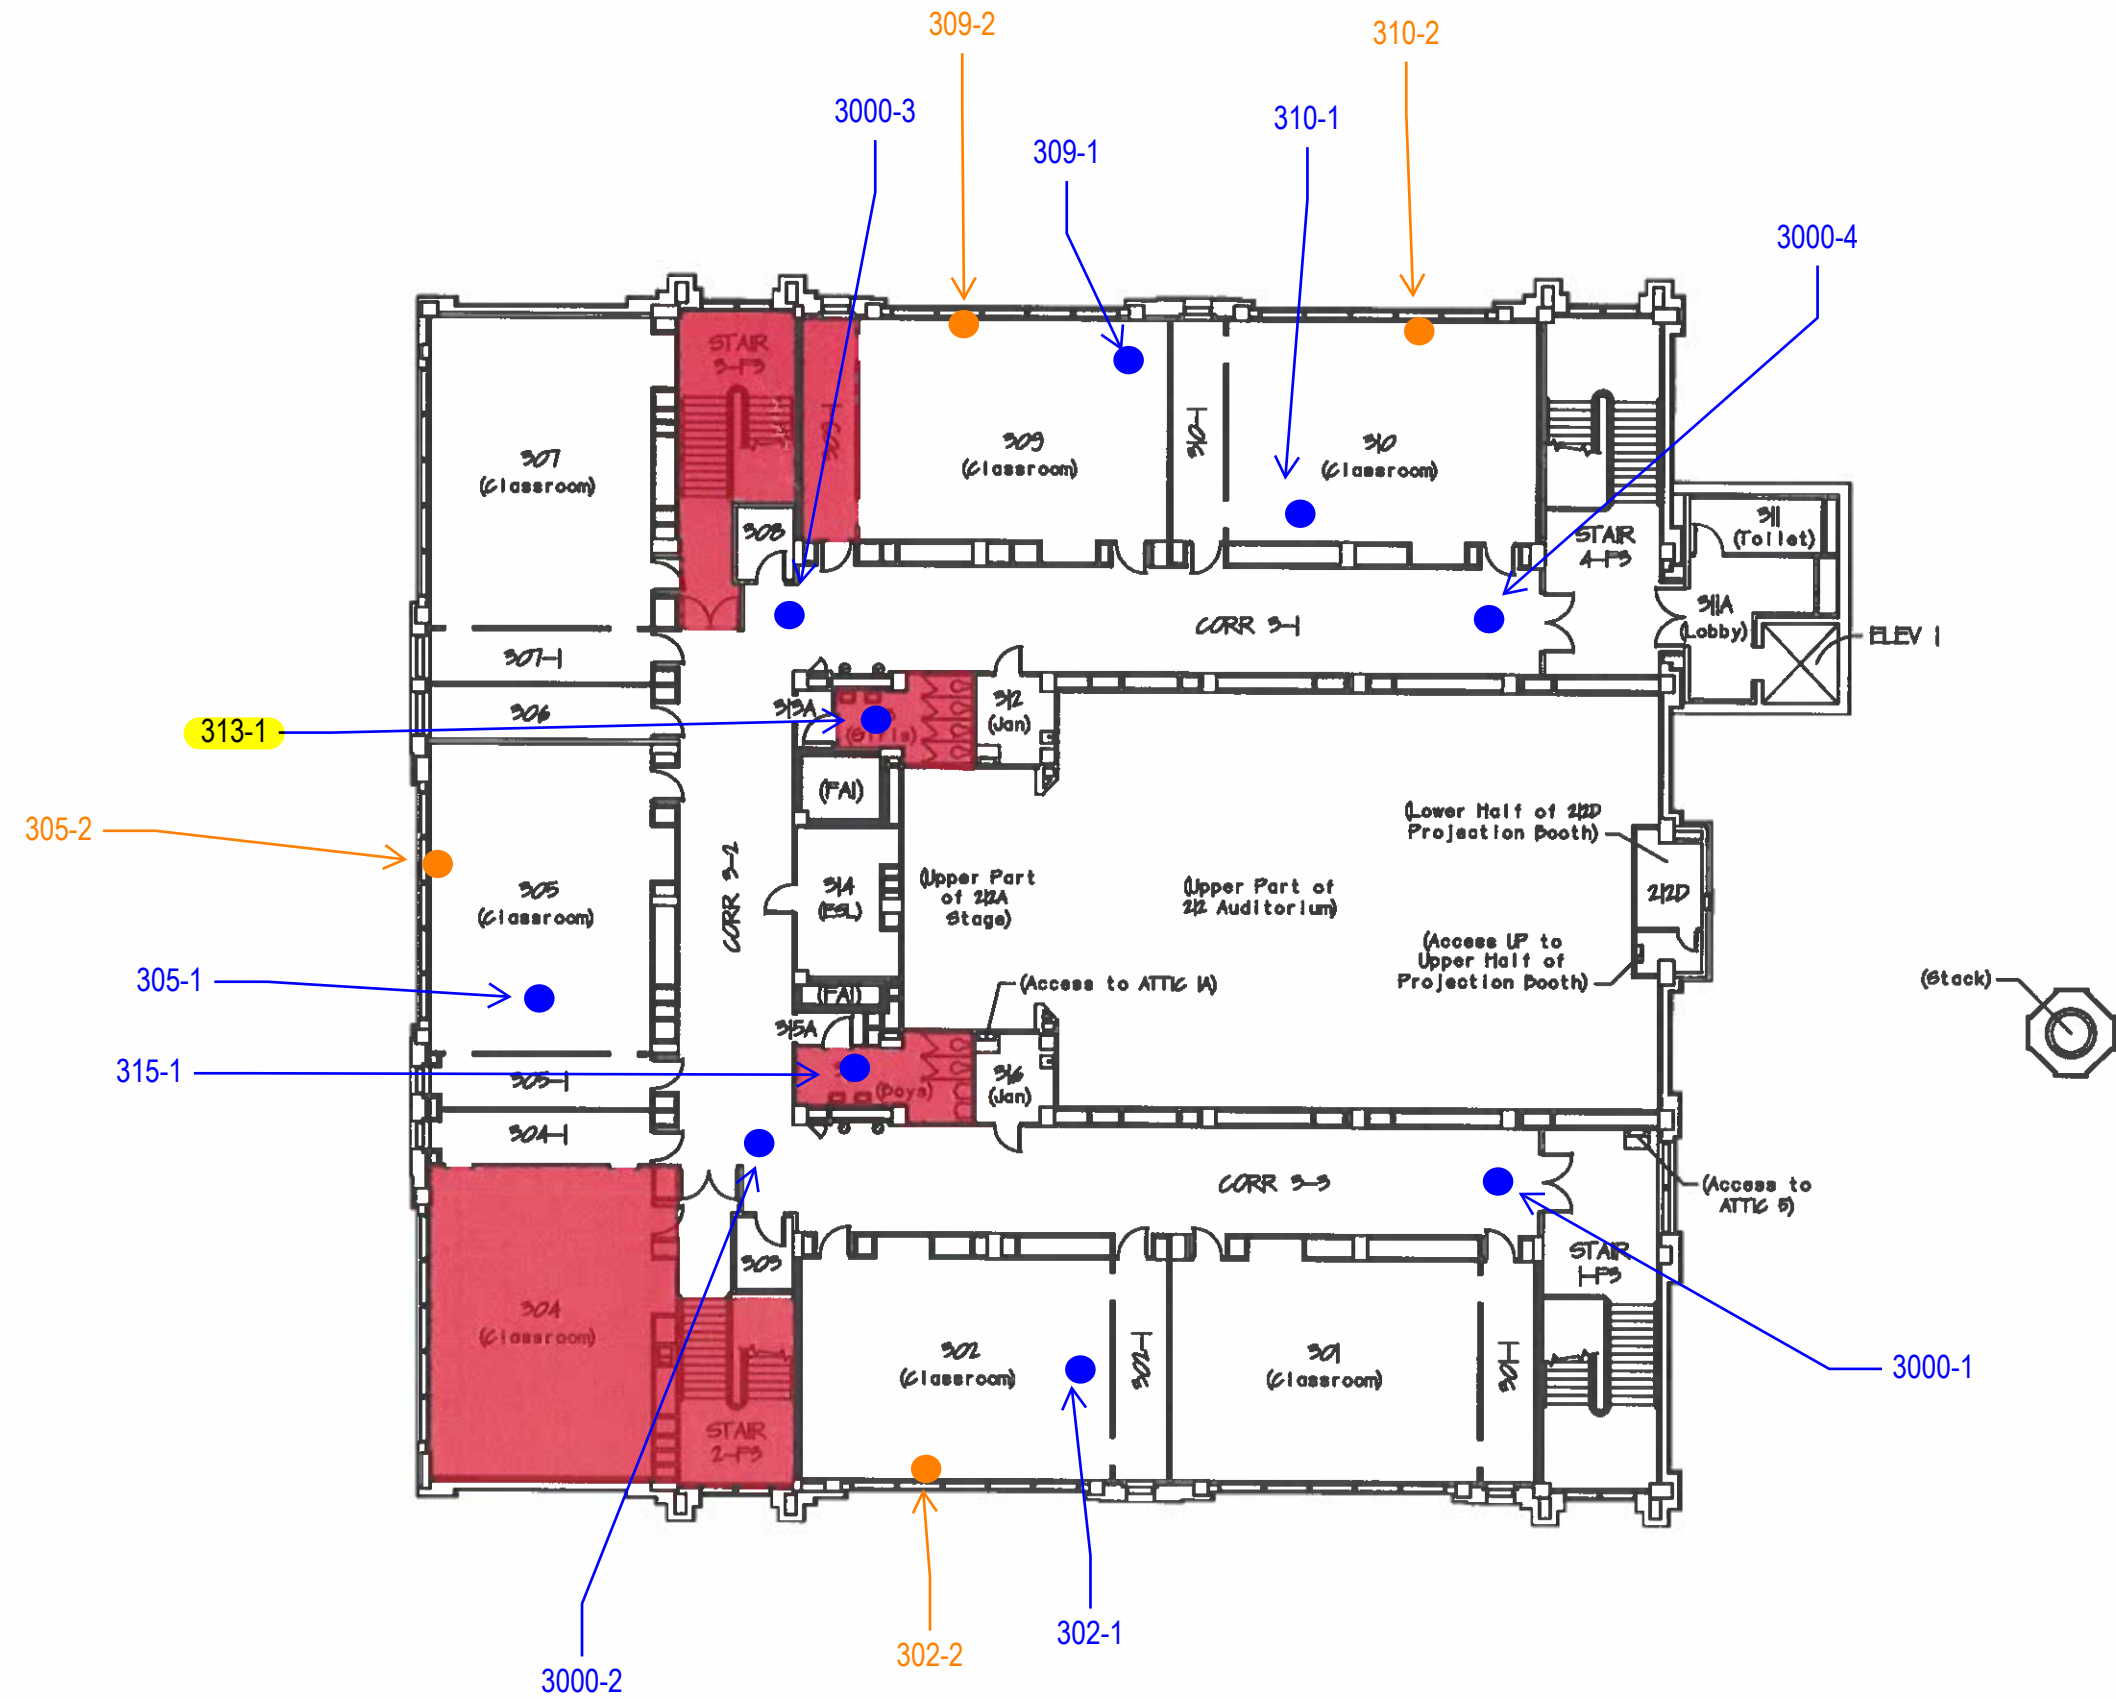

Legend

- Floor sample location
- Sill sample location
- Exceeds Standards
- Abatement areas conducted

NORTH

0 10 20

SCALE: 1" = 10'

THIRD FLOOR PLAN

SITE NO. 283 - NEESKARA ELEMENTARY SCHOOL
 1601 N. HAWLEY RD., MILW., WI., 53208
 DATE: 9/15/08

Figure 4: Third Floor Sample Locations

TABLES

Table 1: Wipe Sampling Summary

Sample #	Room	Sample Location	Results	Standard	Area Sampled (in ²)	Pass / Fail
G-1	Hallway	Floor, Corr G-3	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
G-2	Hallway	Floor, Corr G-3/G-2	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
G-3	Hallway	Floor, Corr G-2/G-1	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
G-4	Hallway	Floor, Corr G-1	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
13-1	Room 13	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
13-2	Room 13	Sill	3.4 µg/ft ²	100 µg/ft ²	540	Pass
11-1	Room 11	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
11-2	Room 11	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
10-1	Room 10	Floor	12 µg/ft ²	10 µg/ft ²	144	Fail
10-2	Room 10	Sill	52 µg/ft ²	100 µg/ft ²	315	Pass
8-1	Art room Rm 8	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
6-1	Bathroom #6	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
22-1	Lunch room/gym	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
17-1	Bathroom #17	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
1000-1	Hallway	Floor, outside stair 1-FI	12 µg/ft ²	10 µg/ft ²	144	Fail
1000-2	Hallway	Floor, outside stair 2-FI	37 µg/ft ²	10 µg/ft ²	144	Fail
1000-3	Hallway	Floor, outside stair 3-FI	16 µg/ft ²	10 µg/ft ²	144	Fail
1000-4	Hallway	Floor, outside stair 4-FI	450 µg/ft ²	10 µg/ft ²	144	Fail
106-1	Room 106	Floor	9.1 µg/ft ²	10 µg/ft ²	360	Pass
106-2	Room 106	Sill	22 µg/ft ²	100 µg/ft ²	144	Pass
103-1	Room 103	Floor	8.2 µg/ft ²	10 µg/ft ²	450	Pass
103-2	Room 103	Sill	55 µg/ft ²	100 µg/ft ²	144	Pass
101-1	Room 101	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
101-2	Room 101	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
109-1	Room 109	Floor	9.8 µg/ft ²	10 µg/ft ²	144	Pass
108-1	Room 108	Floor	11 µg/ft ²	10 µg/ft ²	144	Fail
108-2	Room 108	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
103-2-1	Room 103B	Floor	<8.0 µg/ft ²	10 µg/ft ²	336	Pass
103-2-2	Room 103B	Sill	8.8 µg/ft ²	100 µg/ft ²	144	Pass
2000-1	Hallway	Floor, corr 2-1	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
2000-2	Hallway	Floor, corr 2-1 / 2-2	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
2000-3	Hallway	Floor, corr 2-2 / 2-3	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
2000-4	Hallway	Floor, corr 2-3	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
210-1	Room 210	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
210-2	Room 210	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
209-1	Room 209	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass

Table 1: Wipe Sampling Summary cont.

Sample #	Room	Sample Location	Results	Standard	Area Sampled (in ²)	Pass / Fail
209-2	Room 209	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
211-1	Room 211	Floor	24 µg/ft ²	10 µg/ft ²	144	Fail
203-1	Room 203	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
203-2	Room 203	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
201-1	Room 201	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
201-2	Room 201	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
3000-1	Hallway	Floor, corr 3-3	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
3000-2	Hallway	Floor, corr 3-3 / 3-2	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
3000-3	Hallway	Floor, corr 3-2 / 3-1	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
3000-4	Hallway	Floor, corr 3-1	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
313-1	Bathroom #313	Floor	17 µg/ft ²	10 µg/ft ²	144	Fail
315-1	Bathroom #315	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
310-1	Room 310	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
310-2	Room 310	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
309-1	Room 309	Floor	8.6 µg/ft ²	10 µg/ft ²	144	Pass
309-2	Room 309	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
305-1	Room 305	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
305-2	Room 305	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass
302-1	Room 302	Floor	<8.0 µg/ft ²	10 µg/ft ²	144	Pass
302-2	Room 302	Sill	<8.0 µg/ft ²	100 µg/ft ²	144	Pass

APPENDICES

APPENDIX A

Visual Assessment Results

**Form 15.1 Visual Assessment –
Lead Hazard Clearance Examination.**

Property address: 1601 N. Hawley Road Milwaukee Page 1 of 1

Name of client: MPS

Name of clearance examiner: Pratap Singh Certification No.: LRA-239393 Exp. date: _____

Date of visual assessment: 8 / 22 / 25 Repeat visual assessment? Yes No

This form covers: Dwelling units. (Specify which units) _____
 Common areas. (Specify which areas) Room 13, 11, 10, 8, 6, 17, 106, 103, 101, 109, 103B, 210, 209, 211, 203, 201, 313, 315, 310, 309, 305, 302 Bathroom 6, 27, Gym/ lunchroom
 Exterior areas/outbuildings. (Specify) _____

Any deteriorated paint, visible dust, paint chips, or paint-related debris observed? Yes No

If "Yes," record observations in the table below:

Room, Area, or Side of Building (if exterior)	Building Component, or Other Surface (such as ground or vegetation)	Additional Notes on Specific Location	Description of Problem (i.e., deteriorated paint, visible dust, paint chips, or paint-related debris)

Notes (include any explanations by the client of why deteriorated paint has not been repaired; also include any instructions to client regarding further cleaning):

Signature of clearance examiner: *Pratap Singh*

APPENDIX B

Lead Laboratory Reports and Chain of Custody

**EMSL Analytical, Inc.**

4140 Litt Drive, Hillside, IL, 60162
 Telephone: 856-858-4800 Fax:856-786-5974
 www.emsl.com

EMSL Order ID: 262552097
LIMS Reference ID: MD52097
EMSL Customer ID: KSNG42

Attention: Pratap Singh
 K. Singh & Associates [KSNG42]
 3636 N. 124th Street
 Wauwatosa, WI 53222
 (262) 821-1171

Project Name: MPS LEAD STABILIZATION
 PROJECT-NEESKARA ELEMENTARY

Customer PO: 40638
EMSL Sales Rep: Jennifer Abels
Received: 08/23/2025 08:00
Reported: 08/23/2025 14:12

Analytical Results

Analyte	Results	RL	Area(in ²)	Prep Date & Tech	Prep Method	Analysis Date & Analyst	Analytical Method	Q	DF
Client Sample ID: G-1/CORR G-3							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-01		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: G-2/CORR G-3/G-2							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-02		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: G-3/CORR G-2/G-1							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-03		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: G-4/CORR G-1							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-04		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 13-1/ROOM 13-FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-05		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 13-2/ROOM 13 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-06		
Lead	3.4 µg/ft ²	2.1 µg/ft ²	540	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 11-1/ROOM 11 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-07		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 11-2/ROOM 11 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-08		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 10-1/ROOM 10 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-09		
Lead	12 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									

**EMSL Analytical, Inc.**

4140 Litt Drive, Hillside, IL, 60162
 Telephone: 856-858-4800 Fax:856-786-5974
 www.emsl.com

EMSL Order ID: 262552097
LIMS Reference ID: MD52097
EMSL Customer ID: KSNG42

Attention: Pratap Singh
 K. Singh & Associates [KSNG42]
 3636 N. 124th Street
 Wauwatosa, WI 53222
 (262) 821-1171

Project Name: MPS LEAD STABILIZATION
 PROJECT-NEESKARA ELEMENTARY

Customer PO: 40638
EMSL Sales Rep: Jennifer Abels
Received: 08/23/2025 08:00
Reported: 08/23/2025 14:12

Analytical Results (Continued)

Analyte	Results	RL	Area(in ²)	Prep Date & Tech	Prep Method	Analysis Date & Analyst	Analytical Method	Q	DF
Client Sample ID: 10-2/ROOM 10 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-10		
Lead	52 µg/ft ²	3.7 µg/ft ²	315	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 8-1/ART ROOM FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-11		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 6-1/GIRL BATHROOM FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-12		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 22-1/GYM/LUNCHROOM FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-13		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 17-1/BOY BATHROOM FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-14		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 1000-1/OUTSIDE ST 1-FL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-15		
Lead	12 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 1000-2/OUTSIDE ST 2-FL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-16		
Lead	37 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 1000-3/OUTSIDE ST 3-FL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-17		
Lead	16 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 1000-4/OUTSIDE ST 4-FL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-18		
Lead	450 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									

**EMSL Analytical, Inc.**

4140 Litt Drive, Hillside, IL, 60162
 Telephone: 856-858-4800 Fax:856-786-5974
 www.emsl.com

EMSL Order ID: 262552097
LIMS Reference ID: MD52097
EMSL Customer ID: KSNG42

Attention: Pratap Singh
 K. Singh & Associates [KSNG42]
 3636 N. 124th Street
 Wauwatosa, WI 53222
 (262) 821-1171

Project Name: MPS LEAD STABILIZATION
 PROJECT-NEESKARA ELEMENTARY

Customer PO: 40638
EMSL Sales Rep: Jennifer Abels
Received: 08/23/2025 08:00
Reported: 08/23/2025 14:12

Analytical Results (Continued)

Analyte	Results	RL	Area(in ²)	Prep Date & Tech	Prep Method	Analysis Date & Analyst	Analytical Method	Q	DF
Client Sample ID: 106-1/ROOM 106 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-19		
Lead	9.1 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 106-2/ROOM 106 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-20		
Lead	22 µg/ft ²	3.2 µg/ft ²	360	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 103-1/ROOM 103 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-21		
Lead	8.2 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 103-2/ROOM 103 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-22		
Lead	55 µg/ft ²	2.6 µg/ft ²	450	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 101-1/ROOM 101 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-23		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 101-2/ROOM 101 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-24		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 109-1/BATHROOM 109							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-25		
Lead	9.8 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 108-1/ROOM 108 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-26		
Lead	11 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 108-2/ROOM 108 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-27		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									

**EMSL Analytical, Inc.**

4140 Litt Drive, Hillside, IL, 60162
 Telephone: 856-858-4800 Fax:856-786-5974
 www.emsl.com

EMSL Order ID: 262552097
LIMS Reference ID: MD52097
EMSL Customer ID: KSNG42

Attention: Pratap Singh
 K. Singh & Associates [KSNG42]
 3636 N. 124th Street
 Wauwatosa, WI 53222
 (262) 821-1171

Project Name: MPS LEAD STABILIZATION
 PROJECT-NEESKARA ELEMENTARY

Customer PO: 40638
EMSL Sales Rep: Jennifer Abels
Received: 08/23/2025 08:00
Reported: 08/23/2025 14:12

Analytical Results (Continued)

Analyte	Results	RL	Area(in ²)	Prep Date & Tech	Prep Method	Analysis Date & Analyst	Analytical Method	Q	DF
Client Sample ID: 103-2-1/103B FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-28		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 103-2-2/103B SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-29		
Lead	8.8 µg/ft ²	3.4 µg/ft ²	336	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 2000-1/OUTSIDE 210 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-30		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 2000-2/OUTSIDE 208 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-31		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 2000-3/OUTSIDE 204 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-32		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 2000-4/OUTSIDE 201 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-33		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 210-1/ROOM 210 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-34		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 210-2/ROOM 210 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-35		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 209-1/ROOM 209 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-36		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									

**EMSL Analytical, Inc.**

4140 Litt Drive, Hillside, IL, 60162
 Telephone: 856-858-4800 Fax:856-786-5974
 www.emsl.com

EMSL Order ID: 262552097
LIMS Reference ID: MD52097
EMSL Customer ID: KSNG42

Attention: Pratap Singh
 K. Singh & Associates [KSNG42]
 3636 N. 124th Street
 Wauwatosa, WI 53222
 (262) 821-1171

Project Name: MPS LEAD STABILIZATION
 PROJECT-NEESKARA ELEMENTARY

Customer PO: 40638
EMSL Sales Rep: Jennifer Abels
Received: 08/23/2025 08:00
Reported: 08/23/2025 14:12

Analytical Results (Continued)

Analyte	Results	RL	Area(in ²)	Prep Date & Tech	Prep Method	Analysis Date & Analyst	Analytical Method	Q	DF
Client Sample ID: 209-2/ROOM 209 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-37		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
Sample Comments:									
Client Sample ID: 211-1/ROOM 211 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-38		
Lead	24 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
Sample Comments:									
Client Sample ID: 203-1/ROOM 203 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-39		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
Sample Comments:									
Client Sample ID: 203-2/ROOM 203 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-40		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
Sample Comments:									
Client Sample ID: 201-1/ROOM 201 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-41		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
Sample Comments:									
Client Sample ID: 201-2/ROOM 201 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-42		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
Sample Comments:									
Client Sample ID: 3000-1/CORR 3-3							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-43		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
Sample Comments:									
Client Sample ID: 3000-2/CORR 3-3/3-2							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-44		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
Sample Comments:									
Client Sample ID: 3000-3/CORR 3-2/3-1							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-45		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
Sample Comments:									

**EMSL Analytical, Inc.**

4140 Litt Drive, Hillside, IL, 60162
 Telephone: 856-858-4800 Fax:856-786-5974
 www.emsl.com

EMSL Order ID: 262552097
LIMS Reference ID: MD52097
EMSL Customer ID: KSNG42

Attention: Pratap Singh
 K. Singh & Associates [KSNG42]
 3636 N. 124th Street
 Wauwatosa, WI 53222
 (262) 821-1171

Project Name: MPS LEAD STABILIZATION
 PROJECT-NEESKARA ELEMENTARY

Customer PO: 40638
EMSL Sales Rep: Jennifer Abels
Received: 08/23/2025 08:00
Reported: 08/23/2025 14:12

Analytical Results (Continued)

Analyte	Results	RL	Area(in ²)	Prep Date & Tech	Prep Method	Analysis Date & Analyst	Analytical Method	Q	DF
Client Sample ID: 3000-4/CORR 3-1							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-46		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 313-1/BATHROOM GIRLS 313							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-47		
Lead	17 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 315-1/BATHROOM BOYS 315							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-48		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 310-1/ROOM 310-FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-49		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 310-2/ROOM 310-SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-50		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 309-1/ROOM 309 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-51		
Lead	8.6 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 309-2/ROOM 309 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-52		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 305-1/ROOM 305 FLOOR							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-53		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									
Client Sample ID: 305-2/ROOM 305 SILL							Date Sampled: 08/22/25		
Matrix: Wipe							LIMS Reference ID: MD52097-54		
Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B	1	
Sample Comments:									



EMSL Analytical, Inc.

4140 Litt Drive, Hillside, IL, 60162
Telephone: 856-858-4800 Fax:856-786-5974
www.emsl.com

EMSL Order ID: 262552097
LIMS Reference ID: MD52097
EMSL Customer ID: KSNG42

Attention: Pratap Singh
K. Singh & Associates [KSNG42]
3636 N. 124th Street
Wauwatosa, WI 53222
(262) 821-1171

Project Name: MPS LEAD STABILIZATION
PROJECT-NEESKARA ELEMENTARY

Customer PO: 40638
EMSL Sales Rep: Jennifer Abels
Received: 08/23/2025 08:00
Reported: 08/23/2025 14:12

**Analytical Results
(Continued)**

Analyte	Results	RL	Area(in ²)	Prep Date & Tech	Prep Method	Analysis Date & Analyst	Analytical Method	Q	DF
---------	---------	----	------------------------	------------------	-------------	-------------------------	-------------------	---	----

Client Sample ID: 302-1/ROOM 302 FLOOR

Date Sampled: 08/22/25

Matrix: Wipe

LIMS Reference ID: MD52097-55

Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
------	-------------------------	------------------------	-----	--------------	--------------	--------------	--------------	--	---

Sample Comments:

Client Sample ID: 302-2/ROOM 302 SILL

Date Sampled: 08/22/25

Matrix: Wipe

LIMS Reference ID: MD52097-56

Lead	<8.0 µg/ft ²	8.0 µg/ft ²	144	08/23/25 LOD	SW-846 3050B	08/23/25 LAS	SW 846-7000B		1
------	-------------------------	------------------------	-----	--------------	--------------	--------------	--------------	--	---

Sample Comments:

**EMSL Analytical, Inc.**

4140 Litt Drive, Hillside, IL, 60162
 Telephone: 856-858-4800 Fax:856-786-5974
 www.emsl.com

EMSL Order ID: 262552097
LIMS Reference ID: MD52097
EMSL Customer ID: KSNG42

Attention: Pratap Singh
 K. Singh & Associates [KSNG42]
 3636 N. 124th Street
 Wauwatosa, WI 53222
 (262) 821-1171

Project Name: MPS LEAD STABILIZATION
 PROJECT-NEESKARA ELEMENTARY

Customer PO: 40638
EMSL Sales Rep: Jennifer Abels
Received: 08/23/2025 08:00
Reported: 08/23/2025 14:12

Certified Analyses included in this Report

Analyte	Certifications
SW 846-7000B in Wipe	
Lead	26-AIHA ELLAP

List of Certifications

Code	Description	Number	Expires
26-AIHA ELLAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102992	12/01/2026
26-AIHA IHLAP	American Industrial Hygiene Association (AIHA LAP, LLC) - IHLAP	102992	12/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.



EMSL Analytical, Inc.

4140 Litt Drive, Hillside, IL, 60162
Telephone: 856-858-4800 Fax:856-786-5974
www.emsl.com

EMSL Order ID: 262552097
LIMS Reference ID: MD52097
EMSL Customer ID: KSNG42

Attention: Pratap Singh
K. Singh & Associates [KSNG42]
3636 N. 124th Street
Wauwatosa, WI 53222
(262) 821-1171

Project Name: MPS LEAD STABILIZATION
PROJECT-NEESKARA ELEMENTARY

Customer PO: 40638
EMSL Sales Rep: Jennifer Abels
Received: 08/23/2025 08:00
Reported: 08/23/2025 14:12

Lisa Odeshoo Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. QC sample results are within quality control criteria and met method specifications unless otherwise noted. All results for soil samples are reported on a dry weight basis, unless otherwise noted.

Analysis following EMSL SOP for the Determination of Environmental Lead by FLAA. The laboratory has a reporting limit of 8 µg/wipe and is not responsible for any result or reporting limit provided in µg/ft² since it is dependent upon an area value provided by non-lab personnel. A "<" (less than) result signifies that the analyte was not detected at or above the reporting limit. Measurement of uncertainty and definitions of modifications are available upon request. Results in this report are not blank corrected unless specified.



Lead Chain of Custody

EMSL Order Number / Lab Use Only

EMSL Analytical, Inc.
3410 Winnetka Avenue North
New Hope, MN, 55427

EMSL ANALYTICAL, INC.
TESTING LABS • PRODUCTS • TRAINING

M052097

PHONE: (763) 449-4922

EMAIL: minneapolislab@emsl.com

Customer Information	Customer ID: Jabels	Billing Information	Billing ID: 40638
	Company Name: K. Singh & Associates, Inc.		Company Name: K. Singh & Associates, Inc.
	Contact Name: Pratap Singh		Billing Contact: Pratap Singh
	Street Address: 3636 N. 124th Street		Street Address: 3636 N. 124th Street
	City, State, Zip: Wauwatosa, WI 53222 Country: USA		City, State, Zip: Wauwatosa, WI 53222 Country: USA
Phone: 262-821-1171	Phone: 262-821-1171		
Email(s) for Report: psingh@ksinghengineering.com, ascherwitz@ksinghengineering.com	Email(s) for Invoice: ap@ksinghengineering.com		

Project Name/No: MPS Lead Stabilization Project - Neeskara Elementary		Purchase Order: 40638
EMSL LIMS Project ID: (If applicable, EMSL will provide)	US State where samples collected: WI	State of Connecticut (CT) must select project location: <input type="checkbox"/> Commercial (Taxable) <input type="checkbox"/> Residential (Non-Taxable)
Sampled By Name: Abby Scherwitz	Sampled By Signature: <i>A.M. Scherwitz</i>	No. of Samples in Shipment: 56

Turn-Around-Time (TAT)

3 Hour 6 Hour 24 Hour 32 Hour 48 Hour 72 Hour 96 Hour 1 Week 2 Week

Please call ahead for large projects and/or turnaround times 6 Hours or Less. *32 Hour TAT available for select tests only; samples must be submitted by 11:30am.

MATRIX	METHOD	INSTRUMENT	REPORTING LIMIT	SELECTION
CHIPS* <input type="checkbox"/> % by wt. <input type="checkbox"/> ppm (mg/kg) <input type="checkbox"/> mg/cm ² <small>*Chips reporting Limit based on a minimum 0.25g sample weight. Not appropriate for Ceramic Tiles - XRF is recommended.</small>	SW 846-7000B	Flame Atomic Absorption	<small>*Please select reporting limit on left.</small> -0.008% -80 ppm -mg/cm ² - RL is Variable	<input type="checkbox"/>
	SW 846-6010D*	ICP-OES	<small>*Please select reporting limit on left.</small> -0.0004% -40 ppm -mg/cm ² - RL is Variable	<input type="checkbox"/>
AIR	NIOSH 7082	Flame Atomic Absorption	4µg/filter	<input type="checkbox"/>
	NIOSH 7303M	ICP-OES	1.0µg/filter	<input type="checkbox"/>
	NIOSH 7303M	ICP-MS	0.05µg/filter	<input type="checkbox"/>
WIPE <input checked="" type="checkbox"/> ASTM <input type="checkbox"/> NON-ASTM <small>*If no box is checked, non-ASTM Wipe is assumed</small>	SW 846-7000B	Flame Atomic Absorption	10µg/wipe	<input checked="" type="checkbox"/>
	SW 846-6010D*	ICP-OES	1.0µg/wipe	<input type="checkbox"/>
TCLP	SW 846-1311 / 7000B / SM 3111B	Flame Atomic Absorption	0.4 mg/L (ppm)	<input type="checkbox"/>
	SW 846-1311 / SW 846-6010D*	ICP-OES	0.1 mg/L (ppm)	<input type="checkbox"/>
SPLP	SW 846-1312 / 7000B / SM 3111B	Flame Atomic Absorption	0.4 mg/L (ppm)	<input type="checkbox"/>
	SW 846-1312 / SW 846-6010D*	ICP-OES	0.1 mg/L (ppm)	<input type="checkbox"/>
TTLIC	22 CCR App. II, 7000B	Flame Atomic Absorption	40mg/kg (ppm)	<input type="checkbox"/>
	22 CCR App. II, SW 846-6010D*	ICP-OES	2mg/kg (ppm)	<input type="checkbox"/>
STLC	22 CCR App. II, 7000B	Flame Atomic Absorption	0.4 mg/L (ppm)	<input type="checkbox"/>
	22 CCR App. II, SW 846-6010D*	ICP-OES	0.1 mg/L (ppm)	<input type="checkbox"/>
Soil	SW 846-7000B	Flame Atomic Absorption	40mg/kg (ppm)	<input type="checkbox"/>
	SW 846-6010D*	ICP-OES	2mg/kg (ppm)	<input type="checkbox"/>
Wastewater Unpreserved <input type="checkbox"/> Preserved with HNO3 <input type="checkbox"/> PH<2	SM 3111B / SW 846-7000B	Flame Atomic Absorption	0.4 mg/L (ppm)	<input type="checkbox"/>
	EPA 200.7	ICP-OES	0.020 mg/L (ppm)	<input type="checkbox"/>
Drinking Water Unpreserved <input type="checkbox"/> Preserved with HNO3 <input type="checkbox"/> PH<2	EPA 200.5	ICP-OES	0.003 mg/L (ppm)	<input type="checkbox"/>
	EPA 200.8	ICP-MS	0.001 mg/L (ppm)	<input type="checkbox"/>
TSP/SPM Filter	40 CFR Part 50	ICP-OES	12 µg/filter	<input type="checkbox"/>
Other:				<input type="checkbox"/>

Sample Number	Sample Location	Volume / Area (Lin)	Date / Time Sampled
g-1	Corr G-3	12x12	8/22/25 9:20 am
g-2	Corr G-3/G-2	↓	9:24 am
g-3	Corr G-2/G-1		9:27 am
g-4	Corr G-1		9:30 am
13-1	Room 13, floor		9:40 am

Method of Shipment:	Sample Condition Upon Receipt:
Relinquished by: <i>Abby Scherwitz</i> Date/Time: 8/22/25 3:30	Received by: <i>Rshu</i> Date/Time: 8/23/25 8 AM
Relinquished by:	Received by: <i>WT</i> Date/Time:



Lead Chain of Custody

EMSL Order Number / Lab Use Only

EMSL Analytical, Inc.
3410 Winnetka Avenue North
New Hope, MN, 55427

EMSL ANALYTICAL, INC.
TESTING LABS • PRODUCTS • TRAINING

52097

PHONE: (763) 449-4922

EMAIL: minneapolislab@emsl.com

Additional Pages of the Chain of Custody are only necessary if needed for additional sample information

Special Instructions and/or Regulatory Requirements (Sample Specifications, Processing Methods, Limits of Detection, etc.)

Sample Number	Sample Location	Volume / Area (in)	Date / Time Sampled	
13-2	Room 13, sill	12x12 6x90	8/22/25	
11-1	Room 11, floor	12 x 12		
11-2	Room 11, sill	3 x 48		
10-1	Room 10, floor	12 x 12		
10-2	Room 10, sill	7 x 45		
8-1	Art room, floor	12 x 12		
6-1	girl bathroom, floor			
22-1	gym/lunch room, floor			
17-1	boy bathroom, floor			
1000-1	outside st 1-F1			
1000-2	outside st 2-F1			
1000-3	outside st 3-F1			
1000-4	outside st 4-F1			
106-1	Room 106, floor			
106-2	Room 106, sill			8 x 45
103-1	Room 103, floor			12 x 12
103-2	Room 103, sill	10 x 45		
101-1	Room 101, floor	12 x 12		
101-2	Room 101, sill	3 x 48		
109-1	bathroom 109	12 x 12		
108-1	Room 108, floor	12 x 12		
108-2	Room 108, sill	3 x 48		
103-2-1	103b, floor	12 x 12		
103-2-2	103b, sill	12 x 28		
2000-1	outside 210, floor	12 x 12		

Method of Shipment:

Sample Condition Upon Receipt:

Relinquished by: Abby Scherwitz

Date/Time: 8/22/25 3:30

Received by: [Signature]

Date/Time: 8/23/25 8pm

Relinquished by:

Date/Time:

Received by:

Date/Time:

Controlled Document COC-25 Lead R19 08/19/2024



AGREE TO ELECTRONIC SIGNATURE (By checking, I consent to signing this Chain of Custody document by electronic signature.)

EMSL Analytical, Inc.'s Laboratory Terms and Conditions are incorporated into this Chain of Custody by reference in their entirety. Submission of samples to EMSL Analytical, Inc. constitutes acceptance and acknowledgment of all terms and conditions by Customer.



Lead Chain of Custody

EMSL Order Number / Lab Use Only

EMSL Analytical, Inc.
3410 Winnetka Avenue North
New Hope, MN, 55427

EMSL ANALYTICAL, INC.
TESTING LABS • PRODUCTS • TRAINING

52097

PHONE: (763) 449-4922

EMAIL: minneapolislab@emsl.com

Additional Pages of the Chain of Custody are only necessary if needed for additional sample information

Special Instructions and/or Regulatory Requirements (Sample Specifications, Processing Methods, Limits of Detection, etc.)

Sample Number	Sample Location	Volume / Area (in)	Date / Time Sampled
2000-2	outside 208, floor	12 x 12	8/22/25
2000-3	outside 204, floor	↓	↓
2000-4	outside 201, floor		
210-1	Room 210, floor		
210-2	Room 210, sill		
209-1	Room 209, floor	12 x 12	↓
209-2	Room 209, sill	3 x 48	
211-1	Room 211, floor	12 x 12	
203-1	Room 203, floor	12 x 12	
203-2	Room 203, sill	3 x 48	
201-1	Room 201, floor	12 x 12	
201-2	Room 201, sill	3 x 48	
3000-1	Corr. 3-3	12 x 12	
3000-2	corr 3-3/3-2	↓	
3000-3	corr 3-2/3-1		
3000-4	corr 3-1		
313-1	bathroom, girls 313		
315-1	bathroom, boys 315	↓	
310-1	Room 310, floor		
310-2	Room 310, sill	3 x 48	
309-1	Room 309, floor	12 x 12	
309-2	Room 309, sill	3 x 48	
305-1	Room 305, floor	12 x 12	
305-2	Room 305, sill	3 x 48	
302-1	Room 302, floor	12 x 12	↓

Method of Shipment:

Sample Condition Upon Receipt:

Relinquished by:

Aldy Scherwitz

Date/Time:

8/22/25 3:30

Received by:

[Signature]

Date/Time

8/23/25 SM

Relinquished by:

Date/Time:

Received by:

Date/Time

Controlled Document COC-25 Lead R19 08/19/2024



AGREE TO ELECTRONIC SIGNATURE (By checking, I consent to signing this Chain of Custody document by electronic signature.)

EMSL Analytical, Inc.'s Laboratory Terms and Conditions are incorporated into this Chain of Custody by reference in their entirety. Submission of samples to EMSL Analytical, Inc. constitutes acceptance and acknowledgment of all terms and conditions by Customer.

