

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



January 2, 2026

Ms. Jenny Carcana
Manhasset Union Free School District
200 Memorial Place
Manhasset, New York 11030

Re: **Lead Testing in School Drinking Water
Remedial Action Plan
2023-2025 Compliance 10 NYCRR Subpart 67-4
Update: January 2, 2026**

JCB#: **24-59790**

Dear Ms. Carcana:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 5 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead in Water Remediation Plan
Attachment 2: Outlet Inventory and Lead Testing Results
Attachment 3: Laboratory Analytical Reports
Attachment 4: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.

Sincerely,

A handwritten signature in black ink, appearing to read 'George Greve', is positioned above the printed name.

George Greve
J C Broderick & Associates, Inc.

Attachment 1:

Lead in Water
Remediation Plan


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

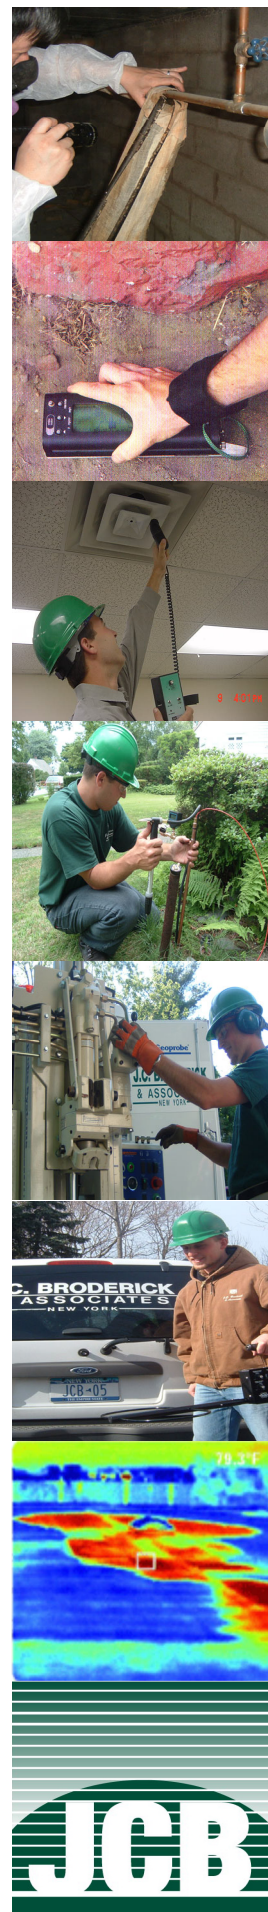

Lead in Water Remediation Plan

Section 67-4.4 Response of the New York State Department of Health (NYS DOH) Title 10 of the Official Compilation of the Codes, Rules and Regulations of the State of New York requires:

If the lead concentration of water at an outlet exceeds the action level, the school shall:

(a) prohibit use of the outlet until:

(1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and

(2) test results indicate that the lead levels are at or below the action level;

As historical sampling results have indicated, the concentrations of lead are more likely attributable to the individual fixtures and/or their immediately adjoining plumbing, and not with the building-wide plumbing. Based upon this information, the following remedial steps are recommended:

Step 1A: Potable Outlets (Outlets intended to be used for drinking/cooking)

Immediately remove the fixture from service. If necessary, provide an adequate supply of potable water for drinking/cooking to this location at no cost to the occupants. If an outlet is seldomly used or is unnecessary, the district may consider permanent removal of the outlet and capping of its supply line.

Step 1B: Non-Potable Outlets (Outlets not intended for drinking/cooking)


See Step 1A OR Placard the outlet for non-drinking use. Signs must be clearly visible and in close proximity to the affected outlet. Example signage is provided at: https://www.health.ny.gov/environmental/water/drinking/lead/docs/donotdrinksigns_lead.pdf.



Do not use for drinking



Hand washing only

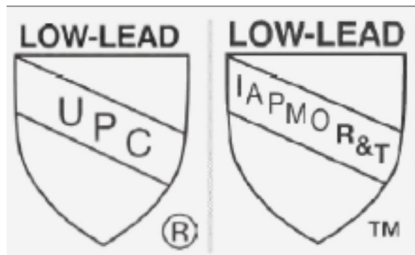

Step 2: Service & Repair or Outlet Replacement

The school district's plumber should evaluate the outlet to determine if any components require service or repair. Depending on the extent of service/repair necessary, age of the fixture, and or overall costs, the district may consider replacing the outlet entirely. Any newly installed components shall be certified lead free. (i.e. NSF/ANSI 61, NSF/ANSI-273). If servicing involves installing/replacing a point-of-use filtration system, this filter shall be certified for its lead reduction capability (i.e. NSF/ANSI 53). Follow all manufacturer's instructions for all component installations. OUTLET RESTRICTIONS MUST REMAIN IN PLACE UNTIL SATISFACTORY TEST RESULTS ARE RECEIVED. See Step 3.

Step 3: Retesting & Return to Service

Schedule a retest of the outlet. Outlet restrictions must remain in place until lead testing results at or below the action level are received. Once satisfactory results are received, the outlet may be returned to normal service. Note: It is recommended that "Do Not Drink" signage remain in place for all non-potable and non-applicable outlet types.

Attachment 2:

Outlet Inventory and Lead Testing Results

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-59790

Manhasset Union Free School District

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0001	Faculty Room 114	1000	Kitchen Faucet (Cold)	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0002	Faculty Room 114	1000	Kitchen Faucet (Cold)	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0003	Kitchen	1001	Kitchen Faucet (Cold)	Applicable	5/23/2025	1.2			Result Below Action Level Continue O&M
MAN-0004	Kitchen	1001	Spray Nozzle	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0005	Kitchen	1001	Kitchen Faucet (Cold)	Applicable	5/23/2025	5.9	8/19/2025	<1.00 ND	Outlet Remediated and Returned to Service, Continue O&M
MAN-0006	Kitchen	1001	Spray Nozzle	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0007	Kitchen	1001	Hand Wash Only	Applicable	5/23/2025	1.2			Result Below Action Level Continue O&M
MAN-0008	Kitchen	1001	Kitchen Faucet (Cold)	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0009	Kitchen Serving Area	1001A	Kitchen Faucet (Cold)	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0010	Kitchen Serving Area	1001A	Spray Nozzle	Applicable	5/23/2025	1.7			Result Below Action Level Continue O&M
MAN-0011	Kitchen Serving Area	1001A	Hand Wash Only	Applicable	5/23/2025	3.1			Result Below Action Level Continue O&M
MAN-0012	Cafeteria	1002	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0013	Cafeteria	1002	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0014	Custodial Area Slop Sink	1003C	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0015	Custodial Area 106D	1003F	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0016	S110	1004A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0017	S110	1004A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0018	Room 176A Bathroom	1013A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0019	Room 176A Bathroom	1013A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0020	Corridor Room 168 to Bookstore	1027	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0021	Corridor Room 168 to Bookstore	1027	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0022	Girls Bathroom (Renovated)	1023	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0023	Girls Bathroom (Renovated)	1023	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0024	Girls Bathroom (Renovated)	1023	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0025	Girls Bathroom (Renovated)	1023	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0026	Girls Bathroom (Renovated)	1023	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0027	Corridor Room 168 to Bookstore	1027	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0028	Corridor Room 168 to Bookstore	1027	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0029	Custodial Closet S-139	1024	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0030	Room 168/152B	1025A	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0031	Room 168/152A	1025B	Hand Wash Only	Non-Applicable					Placarded for Non-Drinking Use
MAN-0032	Room 156	1040	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0033	Room 156	1040	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0034	Room 156 Prep Room (Interior Wall Removed)	1040A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0035	Women's Faculty Bathroom	1042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0036	Women's Faculty Bathroom	1042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0037	Women's Faculty Bathroom	1042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0038	Custodial Closet S 138	1043	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0039	Corridor Room 147 to 149	1050	Bottle Fill Station	Applicable	5/23/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0040	Corridor Room 147 to 149	1050	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0041	Men's Faculty Bathroom	1046	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0042	Men's Faculty Bathroom	1046	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0043	Men's Faculty Bathroom	1046	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0044	Men's Faculty Bathroom	1046	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0045	Boys Bathroom	0003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0046	Boys Bathroom	0003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0047	Boys Bathroom	0003	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0048	Boys Bathroom	0003	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0049	Corridor 066 to Boys Bathroom	0018	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0050	Corridor 066 to Boys Bathroom	0018	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0051	Custodial Closet	0006	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0052	Girls Bathroom	0007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0053	Girls Bathroom	0007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0054	Girls Bathroom	0007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0055	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0056	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0057	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0058	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0059	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0060	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0061	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0062	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0063	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0064	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0065	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0066	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0067	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0068	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0069	Room 149	1048	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0070	Room 149 Prep Room	1048A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0071	Room 147	1049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0072	Room 147	1049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0073	Room 147	1049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0074	Room 147	1049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0075	Room 147	1049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0076	Room 147	1049	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0077	Room 147 Prep Room	1049A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0078	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0079	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0080	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0081	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0082	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0083	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0084	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0085	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0086	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0087	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0088	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0089	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0090	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0091	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0092	Room 142	1052	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0093	Room 145	1051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0094	Room 145	1051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0095	Room 145	1051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0096	Room 145	1051	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0097	Room 143	1053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0098	Room 143	1053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0099	Room 143	1053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0100	Room 143	1053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0101	Room 143	1053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0102	Room 143	1053	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0103	Corridor Room 122 to 143	1058	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0104	Corridor Room 122 to 143	1058	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0105	S 133	1054	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0106	Room 140 A	1055	Coffe Pot	Applicable	5/23/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0107	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0108	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0109	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0110	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0111	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0112	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0113	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0114	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0115	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0116	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0117	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0118	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0119	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0120	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0121	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0122	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0123	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0124	Room 141	1056	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0125	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0126	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0127	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0128	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0129	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0130	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0131	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0132	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0133	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0134	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0135	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0136	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0137	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0138	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0139	Room 140	1057	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0140	Corridor Room 122 to 143	1058	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0141	Corridor Room 122 to 143	1058	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0142	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0143	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0144	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0145	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0146	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0147	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0148	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0149	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0150	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0151	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0152	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0153	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0154	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0155	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0156	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0157	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0158	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0159	Room 131 (Old Room 113)	1060	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0160	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0161	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0162	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0163	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0164	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0165	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0166	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0167	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0168	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0169	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0170	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0171	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0172	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0173	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0174	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0175	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0176	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0177	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0178	Technology Room	1061	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0179	Corridor Prep 116 to 129	1103	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0180	Corridor Prep 116 to 129	1103	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0181	Boys Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0182	Boys Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0183	Room 145 Prep Room	1051A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0184	Room 145 Prep Room	1051A	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
MAN-0185	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0186	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0187	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0188	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0189	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0190	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0191	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0192	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0193	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0194	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0195	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0196	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0197	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0198	Room 127	1067	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0199	Corridor Media Center to Cafeteria	1068	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0200	Corridor Media Center to Cafeteria	1068	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0201	Custodial Closet	1072	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0202	Boys Bathroom	1073	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0203	Boys Bathroom	1073	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0204	Room 108	1074	Home Economics Faucet (Cold)	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0205	Room 108	1074	Home Economics Faucet (Cold)	Applicable	5/23/2025	1.8			Result Below Action Level Continue O&M
MAN-0206	Room 108	1074	Home Economics Faucet (Cold)	Applicable	5/23/2025	1.3			Result Below Action Level Continue O&M
MAN-0207	Room 108	1074	Home Economics Faucet (Cold)	Applicable	5/23/2025	7.3	8/19/2025	2.8	Outlet Remediated and Returned to Service, Continue O&M
MAN-0208	Corridor Room 104 to Media Center	1082	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0209	Corridor Room 104 to Media Center	1082	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0210	Girls Bathroom	1077	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0211	Girls Bathroom	1077	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0212	Room 100	1079	Home Economics Faucet (Cold)	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0213	Corridor Technology Room to Custodial Closet	2012	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0214	Corridor Technology Room to Custodial Closet	2012	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0215	Boys Bathroom	2010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0216	Boys Bathroom	2010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0217	Boys Bathroom	2010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0218	Boys Bathroom	2010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0219	Commons	2013	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0220	Commons	2013	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0221	Custodial Closet S 217	2011	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0222	Room 262	2020	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0223	Room 261	2025	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0224	Room 261	2025	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0225	Room 261	2025	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0226	Room 261	2025	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0227	Custodial Closet	2027	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0228	Corridor Teacher Center to Room 248	2039	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0229	Corridor Teacher Center to Room 248	2039	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0230	Boys Bathroom	2031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0231	Boys Bathroom	2031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0232	Boys Bathroom	2031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0233	Boys Bathroom	2031	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0234	Room 251	2032	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0235	Room 249	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0236	Room 249	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0237	Room 249	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0238	Room 249	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0239	Room 249	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0240	Room 247 Prep Room	2036A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0241	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0242	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0243	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0244	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0245	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0246	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0247	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0248	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0249	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0250	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0251	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0252	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0253	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0254	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0255	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0256	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0257	Room 245	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0258	Room 247	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0259	Room 247	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0260	Room 247	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0261	Room 247	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0262	Room 247	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0263	Office Resource Room Closet	2037A1	Coffe Pot	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0264	Girls Bathroom	2044	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0265	Girls Bathroom	2044	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0266	Girls Bathroom	2044	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0267	Custodial Closet	2045	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0268	Room 237	2049	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0269	Art Room S211 (Room Demolished)	2047A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0270	Men's Faculty Bathroom	2052	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0271	Men's Faculty Bathroom	2052	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0272	Men's Faculty Bathroom	2052	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0273	Janitors Closet	2053	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0274	Corridor Stairwell to Room 240	2063	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0275	Corridor Stairwell to Room 240	2063	Water Cooler	RFI	5/23/2025	OOS	12/30/2025		Outlet Permanently Removed from Service
MAN-0276	Theater Office Boys Bathroom	2069A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0277	Theater Office Bathroom	2069C	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0278	Corridor Attendance Office to Art Room	2076	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0279	Corridor Attendance Office to Art Room	2076	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0280	Media Center Small Office 225A	2072A	Kitchen Faucet (Cold)	Applicable	5/23/2025	19.3			Outlet Use Determined to be Non-Applicable, Placarded for Non-Drinking Use, Continue O&M
MAN-0281	Women's Faculty Bathroom	2073	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0282	Women's Faculty Bathroom	2073	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0283	Women's Faculty Bathroom	2073	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0284	Men's Faculty Bathroom	2074	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0285	Men's Faculty Bathroom	2074	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0286	Men's Faculty Bathroom	2074	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0287	Corridor Attendance Office to Art Room	2076	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0288	Corridor Attendance Office to Art Room	2076	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0289	Room 213 Bathroom Vestibule and Toilet	2079A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0290	Main Office Pricipal's Office Bathroom	2080B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0291	Corridor Auditorium to Counseling Center	2091	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0292	Corridor Auditorium to Counseling Center	2091	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0293	Custodial Closet	2091A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0294	Boys Bathroom	2082	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0295	Boys Bathroom	2082	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0296	Girls Bathroom	2084	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0297	Girls Bathroom	2084	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0298	Counseling Center Women's Bathroom	2090G	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0299	Counseling Center Men's Bathroom	2090H	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0300	Counseling Center Room 200	2090E	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0301	Board Room 313 Bathroom	3006C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0302	Custodial Closet S303	3009	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0303	Men's Faculty Bathroom	3010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0304	Men's Faculty Bathroom	3010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0305	Room 308	3012	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0306	Room 308	3012	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0307	Room 308	3012	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0308	Room 308	3012	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0309	Room 308	3012	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0310	Room 308	3012	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0311	Room 308	3012	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0312	Third Floor Corridor	3017	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0313	Third Floor Corridor	3017	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0314	Women's Faculty Bathroom	3013	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0315	Women's Faculty Bathroom	3013	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0316	Secretarial Area Room 306(Room Reconstructed)	3014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0317	Secretarial Area Room 306(Room Reconstructed)	3014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0318	Secretarial Area Room 306(Room Reconstructed)	3014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0319	Secretarial Area Room 306(Room Reconstructed)	3014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0320	Secretarial Area Room 306(Room Reconstructed)	3014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0321	Secretarial Area Room 306(Room Reconstructed)	3014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0322	Secretarial Area Room 306(Room Reconstructed)	3014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0323	Room 410 Storage	4000A	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0324	Room 122 Prep	1083A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0325	Room 122 Prep	1083A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0326	Room 122	1083	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0327	Room 122	1083	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0328	Room 122	1083	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0329	Room 122	1083	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0330	Room 122	1083	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0331	Room 122	1083	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0332	Room 122	1083	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0333	Room 122	1083	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0334	Room 122	1083	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0335	Health Office Bathroom	1087B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0336	Health Office Exam Room	1087C	Nurse's Office Sink	Applicable	5/23/2025	1.7			Result Below Action Level Continue O&M

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0337	Boys Bathroom (Space Renovated)	1088	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0338	Boys Bathroom (Space Renovated)	1088	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0339	Boys Bathroom (Space Renovated)	1088	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0340	S119	1089	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0341	MS Girls Locker Room (Space Renovated)	1086	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0342	MS Girls Locker Room (Space Renovated)	1086	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0343	MS Girls Locker Room (Space Renovated)	1086	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0344	MS Girls Locker Room (Space Renovated)	1086	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0345	Corridor Gym to Room 129	1102	Bottle Fill Station	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0346	Corridor Gym to Room 129	1102	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0347	Girls Bathroom (Space Renovated)	1093	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0348	Girls Bathroom (Space Renovated)	1093	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0349	Girls Bathroom (Space Renovated)	1093	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0350	Coach Office Bathroom	1094A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0351	Coach Office Bathroom	1094A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0352	High School Boys Locker Room (Space Renovated)	1095	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0353	High School Boys Locker Room (Space Renovated)	1095	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0354	High School Boys Locker Room (Space Renovated)	1095	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0355	Ice Machine Room	1097A	Ice Machine	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0356	Girls Coaches Office Bathroom	1097B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0357	Girls Coaches Office Bathroom	1097B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0358	High School Girls Locker Room (Space Renovated)	1097	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0359	High School Girls Locker Room (Space Renovated)	1097	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0360	High School Girls Locker Room (Space Renovated)	1097	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0361	High School Girls Locker Room (Space Renovated)	1097	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0362	High School Girls Locker Room (Space Renovated)	1097	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0363	Gym	1098	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0364	Gym	1098	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0365	Gym	1098	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0366	Gym	1098	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0367	Middle School Boys Locker Room (Space Renovated)	1100	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0368	Middle School Boys Locker Room (Space Renovated)	1100	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0369	Middle School Boys Locker Room (Space Renovated)	1100	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0370	Middle School Boys Locker Room (Space Renovated)	1100	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0371	Middle School Coaches Office Bathroom	1100A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0372	Gym Weight Room	N/A	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0373	Gym Weight Room	N/A	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0374	Back Gym Office Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0375	Back Gym Office Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0376	Wrestling Room Locker Room	1105A	Ice Machine	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0377	Wrestling Room Locker Room	1105A	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0378	Wrestling Room Locker Room	1105A	Water Cooler	Applicable	5/23/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0379	Wrestling Room Locker Room	1105A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0380	Central Office Rear Secretarial/File Area Inner	3016A2	Kitchen Faucet (Cold)	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0381	Central Office Rear Secretarial/File Area Inner	3016A2	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0382	Central Office Rear Secretarial/File Area	3016A	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0383	Central Office Rear Secretarial/File Area	3016A	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0384	Central Office Rear Secretarial/File Area	3016A	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0385	Central Office Rear Secretarial/File Area	3016A	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0386	Central Office Rear Secretarial/File Area	3016A	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0387	Central Office Rear Secretarial/File Area	3016A	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0388	Central Office Rear Secretarial/File Area	3016A	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0501	Admin - Bathroom 1 Near Entrance Vestibule	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0502	Admin - Bathroom 2 Near Entrance Vestibule	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0503	Admin - Bathroom Across from Conference Room	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0504	Admin - Custodial Across from Conference Room	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0505	Admin - Room 141 Kitchen	N/A	Kitchen Faucet (Cold)	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0506	Admin - Room 141 Kitchen	N/A	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0507	Admin - Superintendent Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0594	Maintenance Barn Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Manhasset Secondary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0595	Concession Stand - Storage Area	N/A	Bottle Fill Station	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0596	Concession Stand - Storage Area	N/A	Water Cooler	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0597	Concession Stand - Storage Area	N/A	Ice Machine	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0598	Concession Stand - Womens Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0599	Concession Stand - Mens Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0600	Concession Stand - Kitchen	N/A	Kitchen Faucet (Cold)	Applicable	5/23/2025	2.7			Result Below Action Level Continue O&M
MAN-0601	Concession Stand - Kitchen	N/A	Kitchen Faucet (Cold)	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0602	Exterior from Concession Stand	N/A	Water Fountain-No Chiller	Applicable	5/23/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0603	Exterior from Concession Stand	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0604	Exterior from Concession Stand	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0806	O/S Guidance Office	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0807	O/S Main Office Area	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0808	O/S Front Entrance Vestibule	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0809	O/S Classroom (1025)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0810	O/S Classroom (1052)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0811	O/S Classroom (1061)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0812	O/S Classroom (1074)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0813	Kitchen	1001	Ice Machine	Applicable	5/23/2025	<1.00 ND			Result Below Action Level Continue O&M

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0389	Custodial Area Office Locker Room Bathroom	1001C1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0390	Custodial Area Women's Bathroom	1001B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0391	Custodial Area	1001	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0392	Kitchen	1000	Kitchen Faucet (Cold)	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0393	Kitchen	1000	Spray Nozzle	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0394	Kitchen	1000	Hand Wash Only	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0395	Kitchen	1000	Kitchen Faucet (Cold)	Applicable	5/21/2025	4.8			Result Below Action Level Continue O&M
MAN-0396	Kitchen	1000	Kitchen Faucet (Cold)	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0397	Kitchen	1000	Pasta Pot/Steam Kettle	Applicable	5/21/2025	89.4			Removed From Service, Pending Remediation
MAN-0398	Boys Bathroom	1004	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0399	Boys Bathroom	1004	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0400	Boys Bathroom	1004	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0401	Main Corridor	1087	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0402	Main Corridor	1087	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0403	Girls Bathroom	1006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0404	Girls Bathroom	1006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0405	Room 34	1008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0406	Room 32 Bathroom	1012A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0407	Room 32	1012	Kitchen Faucet (Cold)	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0408	Custodial Closet	1013	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0409	Main Corridor	1087	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0410	Main Corridor	1087	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0411	Boys Bathroom (ADA Upgrade 2008)	1015	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0412	Boys Bathroom (ADA Upgrade 2008)	1015	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0413	Girls Bathroom (ADA Upgrade 2008)	1014	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0414	Faculty Lounge	1018	Kitchen Faucet (Cold)	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0415	Men's Bathroom	1017	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0416	Women's Bathroom	1016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0417	Faculty Lounge	1018	Coffe Pot	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0418	Women's Bathroom	1022	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0419	Principal's Office Bathroom	1019A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0420	Health Office	1028	Nurse's Office Sink	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0421	Health Office Bathroom	1028A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0422	Science Room	1027	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0423	Science Room	1027	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0424	Science Prep Room	1027B	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0425	Room 40	2033	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0426	Room 40	2033	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0427	Room 40	2033	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0428	Janitors Closet	1030	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0429	Girls Bathroom	1031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0430	Gym	1032	Water Fountain-No Chiller	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0431	Main Corridor	1087	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0432	Main Corridor	1087	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0433	Boys Bathroom	1034	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0434	Room 002	1035		Non-Applicable					Placarded for Non-Drinking Use
MAN-0435	Room 002 Bathroom	1035A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0436	Room 001	1036		Non-Applicable					Placarded for Non-Drinking Use
MAN-0437	Room 001 Bathroom	1036A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0438	Room 004	1037		Non-Applicable					Placarded for Non-Drinking Use
MAN-0439	Room 004	1037		Non-Applicable					Placarded for Non-Drinking Use
MAN-0440	Room 004 Bathroom	1037A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0441	Room 003 Bathroom	1038A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0442	Room 006	1039		Non-Applicable					Placarded for Non-Drinking Use
MAN-0443	Room 006 Bathroom	1039A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0444	Room 005	1040		Non-Applicable					Placarded for Non-Drinking Use
MAN-0445	Room 005 Bathroom	1040A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0446	Room 008	1041		Non-Applicable					Placarded for Non-Drinking Use
MAN-0447	Room 008 Bathroom	1041A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0448	Room 007	1042		Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0449	Room 007 Bathroom	1042A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0450	Room 9	1044		Non-Applicable					Placarded for Non-Drinking Use
MAN-0451	Corridor Room 9 to 11	1047	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0452	Room 10	1045	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0453	Room 10	1045	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0454	Room 11	1046	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0455	Room 11	1046	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0456	Room 15	1048		Non-Applicable					Placarded for Non-Drinking Use
MAN-0457	Room 16	1049		Non-Applicable					Placarded for Non-Drinking Use
MAN-0458	Room 12	1050		Non-Applicable					Placarded for Non-Drinking Use
MAN-0459	Room 13	1051		Non-Applicable					Placarded for Non-Drinking Use
MAN-0460	Room 14	1052		Non-Applicable					Placarded for Non-Drinking Use
MAN-0461	Corridor Room 20 to 24	1077	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0462	Corridor Room 20 to 24	1077	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0463	Boys Bathroom	1055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0464	Boys Bathroom	1055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0465	Boys Bathroom	1055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0466	Boys Bathroom	1055	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0467	Custodial Closet	1056	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0468	Girls Bathroom	1058	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0469	Girls Bathroom	1058	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0470	Girls Bathroom	1058	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0471	Girls Bathroom	1058	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0472	Women's Bathroom	1059	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0473	Room 21	1061	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0474	Room 21 Bathroom	1061A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0475	Room 21 Bathroom	1061A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0476	Media Center	1063	Kitchen Faucet (Cold)	Applicable	5/21/2025	2.6			Result Below Action Level Continue O&M
MAN-0477	Room 20	1065	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0478	Room 20	1065	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0479	Room 20	1065	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0480	Corridor Room 20 to 24	1077	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0481	Corridor Room 20 to 24	1077	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0482	Boys Bathroom	1067	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0483	Boys Bathroom	1067	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0484	Boys Bathroom	1067	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0485	Boys Bathroom	1067	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0486	Custodial Closet	1068	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0487	Girls Bathroom	1069	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0488	Girls Bathroom	1069	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0489	Girls Bathroom	1069	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0490	Girls Bathroom	1069	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0491	Women's Bathroom	1070	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0492	Men's Bathroom	1071	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0493	Room 22	1072	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0494	Room 23	1073	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0495	Room 24	1074	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0496	Room 25	1075	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0497	Room 25	1075	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0498	Room 26	1076	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0499	Room 26	1076	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0500	Room 23	1073	Water Fountain-No Chiller	RFI					Outlet Permanently Removed from Service
MAN-0508	Girls Locker Room Coach Office Bathroom	1079B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0509	Girls Locker Room	1079A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0510	Girls Locker Room	1079A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0511	Girls Locker Room	1079A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0512	Girls Locker Room Custodian Slop Sink Closet	1079A2	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0513	Girls Locker Room	1079A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0514	Boys Locker Room Office Bathroom	1081B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0515	Boys Locker Room Office Bathroom	1081B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0516	Boys Locker Room Bathroom	1081B1	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0517	Boys Locker Room Bathroom	1081B1	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0518	Boys Locker Room Coach Office	1081A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0519	Gym Corridor	1082	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0520	Gym Corridor	1082	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0521	New Construction-Boys Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0522	New Construction-Boys Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0523	New Construction-Boys Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0524	New Construction-Corridor	N/A	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0525	New Construction-Corridor	N/A	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0526	New Construction-Room 27	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0527	New Construction-Room 27	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0528	New Construction-Room 28	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0529	New Construction-Room 28	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0530	New Construction-Room 29	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0531	New Construction-Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0532	New Construction-Room 30	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0533	New Construction-Room 31	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0534	New Construction-Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0535	New Construction-Girls Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0536	New Construction-Girls Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0537	New Construction-Girls Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0538	Room 41	2001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0539	Room 41	2001	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0540	Room 42	2002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0541	Room 42	2002	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0542	Room 43	2003		Non-Applicable					Placarded for Non-Drinking Use
MAN-0543	Room 43	2003	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0544	Room 44	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0545	Room 44	2004	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0546	Room 45	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0547	Room 45	2005	Water Fountain-No Chiller	RFI					Outlet Permanently Removed from Service
MAN-0548	Women's Bathroom (ADA Upgrade 2008)	2006	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0549	Women's Bathroom (ADA Upgrade 2008)	2006	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0550	Girls Bathroom	2008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0551	Girls Bathroom	2008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0552	Girls Bathroom	2008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0553	Girls Bathroom	2008	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0554	Custodial Closet	2010	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0555	Boys Bathroom	2011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0556	Boys Bathroom	2011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0557	Boys Bathroom	2011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0558	Boys Bathroom	2011	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0559	2nd Floor Corridor	2032	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0560	2nd Floor Corridor	2032	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0561	Room 46	2013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0562	Room 46	2013	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0563	Room 47 Computer Room	2014C	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0564	Room 47 Computer Room	2014C	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0565	Room 48	2015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0566	Room 48	2015	Water Fountain-No Chiller	RFI					Outlet Permanently Removed from Service
MAN-0567	Room 49	2016	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0568	Room 49	2016	Water Fountain-No Chiller	RFI					Outlet Permanently Removed from Service
MAN-0569	Room 50	2017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0570	Room 50	2017	Water Fountain-No Chiller	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0571	Women's Bathroom (ADA Upgrade 2008)	2018	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0572	Women's Bathroom (ADA Upgrade 2008)	2018	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0573	Girls Bathroom	2019	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0574	Girls Bathroom	2019	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0575	Girls Bathroom	2019	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0576	Girls Bathroom	2019	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0577	Girls Bathroom	2019	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0578	Boys Bathroom	2024	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0579	Boys Bathroom	2024	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0580	Boys Bathroom	2024	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0581	Boys Bathroom	2024	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0582	2nd Floor Corridor	2032	Bottle Fill Station	Applicable	5/21/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0583	2nd Floor Corridor	2032	Water Cooler	Applicable	5/21/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0584	Room 51	2026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0585	Room 51	2026	Water Fountain-No Chiller	Applicable	5/21/2025	1.4			Result Below Action Level Continue O&M
MAN-0586	Room 52	2027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0587	Room 52	2027	Water Fountain-No Chiller	RFI					Outlet Permanently Removed from Service
MAN-0588	Room 53	2028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0589	Room 53	2028	Water Fountain-No Chiller	RFI					Outlet Permanently Removed from Service
MAN-0590	Room 54	2030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0591	Room 54	2030	Water Fountain-No Chiller	RFI					Outlet Permanently Removed from Service
MAN-0592	Room 55	2031	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0593	Room 55	2031	Water Fountain-No Chiller	Applicable	5/21/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0795	O/S Nurse (1028)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0796	O/S Office (1012)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Shelter Rock Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0797	O/S Office (1012)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0798	O/S Kitchen (1000)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0799	O/S Boiler Room (1002)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0800	O/S Locker Room (1079A)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0801	O/S Boys Bathroom (New Construction)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0802	O/S Girls Bathroom (New Construction)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0803	O/S Girls Bathroom (New Construction)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0804	O/S Classroom (1050)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0805	O/S Room (1033)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0814	Gym	1080	Water Fountain-No Chiller	Applicable	12/30/2025	<1.0			Result Below Action Level Continue O&M

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0605	Girls Bathroom	2000	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0606	Girls Bathroom	2000	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0607	Girls Bathroom	2000	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0608	Girls Bathroom	2000	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0609	Girls Bathroom	2000	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0610	Girls Bathroom	2000	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0611	Room 211	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0612	Boys Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0613	Boys Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0614	Boys Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0615	Boys Bathroom	2007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0616	Boys Bathroom	2007	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0617	Custodial Closet	2008	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0618	Corridor Room 209 to 212	2012	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0619	Corridor Room 209 to 212	2012	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0620	2nd Floor Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0621	2nd Floor Corridor	N/A	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0622	2nd Floor Corridor	N/A	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0623	Room 201	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0624	Room 202	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0625	Room 203	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0626	Room 204	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0627	Room 205	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0628	Room 206	N/A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0629	2nd Floor Boys Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0630	2nd Floor Boys Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0631	2nd Floor Boys Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0632	2nd Floor All Gender Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0633	2nd Floor Girls Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0634	2nd Floor Girls Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0635	2nd Floor Girls Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0636	Room 216	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0637	Room 216	2014	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
MAN-0638	Room 217	2015	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0639	Science Room 231	2021	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0640	Science Room 231	2021	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0641	Science Room 231	2021	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0642	Science Room 231	2021	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
MAN-0643	Custodial Closet	2023	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0644	Boys Bathroom	2024	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0645	Boys Bathroom	2024	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0646	Boys Bathroom	2024	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0647	Boys Bathroom	2024	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0648	Boys Bathroom	2024	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0649	Corridor Art Room to Computer Lab	2038	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0650	Corridor Art Room to Computer Lab	2038	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0651	Work Room 228	2026	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0652	Girls Bathroom	2029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0653	Girls Bathroom	2029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0654	Girls Bathroom	2029	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0655	Girls Bathroom	2029	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0656	Room 226 Faculty Lounge	2032	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0657	Room 226 Faculty Lounge	2032	Coffe Pot	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0658	Room 226 Faculty Lounge	2032	Coffe Pot	Applicable	5/22/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0659	Room 226 Faculty Lounge	2032	Coffe Pot	Applicable	5/22/2025	OOS	12/30/2025		Testing Required Before Return to Service
MAN-0660	Room 226 Faculty Lounge Bathroom	2032A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0661	Room 226 Faculty Lounge Bathroom	2032A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0662	Room 226 Art Room	2039	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0663	Room 226 Art Room	2039	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0664	Room 226 Art Room	2039	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0665	Corridor Art Room to Computer Lab	2038	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0666	Corridor Art Room to Computer Lab	2038	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0667	Main Office Bathroom	1000B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0668	Main Office Copy Room Bathroom	1000E1	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0669	Main Office Copy Room Bathroom	1000E1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0670	Multi Purpose Room Stage	1004A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0671	Nurses Office Exam Room	1003B	Nurse's Office Sink	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0672	Nurses Office Bathroom	1003A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0673	Nurses Office Bathroom	1003A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0674	Corridor Main Office to Room 129	1018	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0675	Corridor Main Office to Room 129	1018	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0676	Men's Bathroom	1008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0677	Men's Bathroom	1008	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0678	Room 128A Bathroom	1009A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0679	Room 128A Bathroom	1009A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0680	Girls Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0681	Girls Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0682	Girls Bathroom	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0683	Girls Bathroom	1011	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0684	Room 128 Prep Room	1013A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0685	Room 119	1012	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0686	Corridor Main Office to Room 129	1018	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0687	Corridor Main Office to Room 129	1018	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0688	Room 129	1015	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0689	Boys Bathroom	1016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0690	Boys Bathroom	1016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0691	Boys Bathroom	1016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0692	Boys Bathroom	1016	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0693	Boys Bathroom	1016	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0694	Storage Closet	1018A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0695	Music Room 130	1027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0696	Cafeteria Gym Corridor	1029	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0697	Cafeteria Gym Corridor	1029	Water Cooler	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0698	Cafeteria Gym Corridor	1029	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0699	Cafeteria Gym Corridor	1029	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0700	Storage Outside Boys Locker Room	1025	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0701	Girls Bathroom by Gym	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0702	Girls Bathroom by Gym	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0703	Boys Bathroom by Gym	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0704	Boys Bathroom by Gym	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0705	Faculty Bathroom by Gym	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0706	Faculty Bathroom by Gym	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0707	Girls Locker Room Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0708	Girls Locker Room Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0709	Boys Locker Room Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0710	Boys Locker Room Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0711	Room 135	1026	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0712	Courtyard Adjacent Room 135	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0713	Cafeteria	1028	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0714	Cafeteria	1028	Water Cooler	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0715	Cafeteria	1028	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0716	Kitchen Bathroom	1028C2	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0717	Kitchen	1028C	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0718	Kitchen	1028C	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0719	Kitchen	1028C	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0720	Kitchen	1028C	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0721	Kitchen Office	1028C1	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0722	Kitchen Office	1028C1	Spray Nozzle	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0723	Kitchen Office	1028C1	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0724	Kitchen Office	1028C1	Kitchen Faucet (Cold)	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0725	Corridor Girls Bathroom to Library	1044	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0726	Corridor Girls Bathroom to Library	1044	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0727	Corridor Closet	1034	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0728	Boys Bathroom	1035	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0729	Boys Bathroom	1035	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0730	Boys Bathroom	1035	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0731	Room 111	1039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0732	Girls Bathroom	1042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0733	Girls Bathroom	1042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0734	Girls Bathroom	1042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0735	Girls Bathroom	1042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0736	Girls Bathroom	1042	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0737	Girls Bathroom	1042	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0738	Corridor Girls Bathroom to Library	1044	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0739	Corridor Girls Bathroom to Library	1044	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0740	1st Floor Custodial Closet	N/A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
MAN-0741	1st Floor Corridor	N/A	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0742	1st Floor Corridor	N/A	Water Cooler	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0743	Room 106	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0744	Room 105	N/A		Non-Applicable					Placarded for Non-Drinking Use

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0745	Room 101	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0746	Room 102	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0747	Room 103	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0748	Room 104	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0749	Room 104	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0750	1st Floor Boys Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0751	1st Floor Boys Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0752	1st Floor Boys Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0753	1st Floor Gender Neutral Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0754	1st Floor Girls Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0755	1st Floor Girls Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0756	1st Floor Girls Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0757	Ground Floor Boys Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0758	Ground Floor Boys Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0759	Ground Floor Boys Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0760	Ground Floor Gender Neutral Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0761	Ground Floor Girls Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0762	Ground Floor Girls Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0763	Ground Floor Girls Bathroom	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0764	Ground Floor Corridor	N/A	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0765	Ground Floor Corridor	N/A	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0766	Room K01	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0767	Room K01 Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0768	Room K02	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0769	Room K02 Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0770	Room K03	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0771	Room K03 Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0772	Room K04	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0773	Room K04	N/A		Non-Applicable					Placarded for Non-Drinking Use
MAN-0774	Room K04 Bathroom	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0775	Room 132	1021	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0776	Corridor Room 134 to Ramp	1023	Bottle Fill Station	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0777	Corridor Room 134 to Ramp	1023	Water Cooler	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0778	Music Room 134	1019	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0779	Boys Bathroom by Auditorium	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0780	Boys Bathroom by Auditorium	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0781	Boys Bathroom by Auditorium	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0782	Girls Bathroom by Auditorium	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0783	Girls Bathroom by Auditorium	N/A	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
MAN-0784	Girls Bathroom by Auditorium	N/A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Munsey Park Elementary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
MAN-0785	Corridor O/S Auditorium	N/A	Bottle Fill Station	Applicable	5/22/2025	OOS	12/30/2025	<1.0	Result Below Action Level Continue O&M
MAN-0786	Corridor O/S Auditorium	N/A	Water Cooler	Applicable	5/22/2025	<1.00 ND			Result Below Action Level Continue O&M
MAN-0787	O/S Classroom (1040)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0788	O/S Classroom 106	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0789	O/S Classroom (1032)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0790	O/S Office (1000D)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0791	O/S Multipurpose (1004)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0792	O/S Multipurpose (1004)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0793	O/S Music Room (1021)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
MAN-0794	O/S Classroom (1041)	EX	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

Attachment 3:

Laboratory Analytical Reports


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

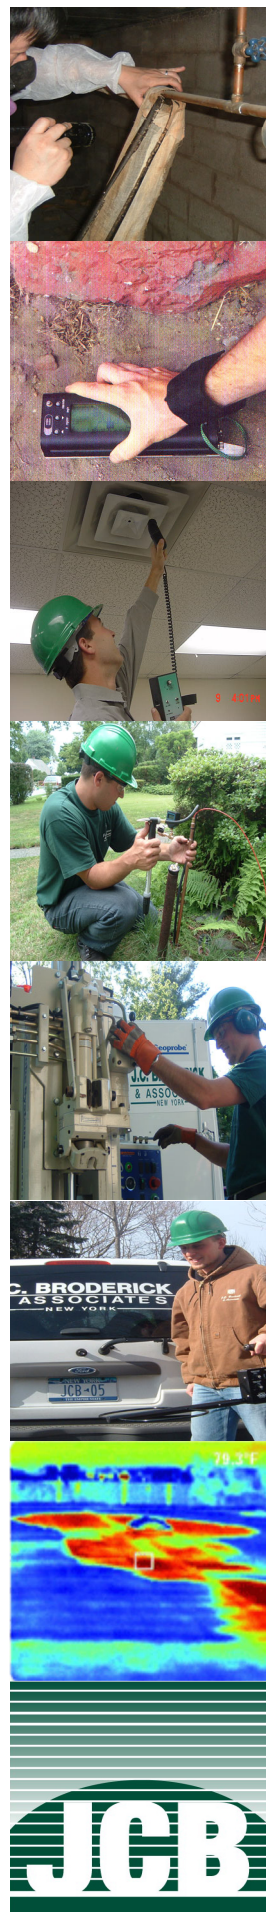



Lead in Water: Chain of Custody for

ED52852

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-59790

Building: Shelter Rock Elementary School

SRES

Client:

Manhasset Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0392	KI	1000	Kitchen	KC	5/21/2025	5:35:00 AM
MAN-0393	KI	1000	Kitchen	SN	5/21/2025	5:35:00 AM
MAN-0394	KI	1000	Kitchen	HW	5/21/2025	5:36:00 AM
MAN-0395	KI	1000	Kitchen	KC	5/21/2025	5:36:00 AM
MAN-0396	KI	1000	Kitchen	KC	5/21/2025	5:37:00 AM
MAN-0397	KI	1000	Kitchen	PK	5/21/2025	5:37:00 AM
MAN-0401	HA	1087	Main Corridor	WF	5/21/2025	5:39:00 AM
MAN-0407	OF	1012	Room 32	KC	5/21/2025	5:42:00 AM
MAN-0409	HA	1087	Main Corridor	WF	5/21/2025	5:43:00 AM
MAN-0414	FL	1018	Faculty Lounge	KC	5/21/2025	5:45:00 AM
MAN-0420	NO	1028	Health Office	NS	5/21/2025	5:50:00 AM
MAN-0426	CR	2033	Room 40	WF	5/21/2025	5:47:00 AM
MAN-0430	GY	1032	Gym	DW	5/21/2025	5:53:00 AM
MAN-0431	HA	1087	Main Corridor	WF	5/21/2025	5:54:00 AM
MAN-0461	HA	1077	Corridor Room 20 to 24	WF	5/21/2025	6:00:00 AM
MAN-0476	LI	1063	Media Center	KC	5/21/2025	6:03:00 AM
MAN-0480	HA	1077	Corridor Room 20 to 24	WF	5/21/2025	6:04:00 AM
MAN-0519	HA	1082	Gym Corridor	WF	5/21/2025	6:10:00 AM

Building Address

27A Shelter Rock Road

Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received: A Stanley

Signature: [Signature]

6/3/25


2:26pm

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: Daniel Smalls

Ph200 & SK 6/5/25



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-59790

Building: Shelter Rock Elementary School

SRES

ED52852

Client:

Manhasset Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0524	HA	N/A	New Construction-Corridor	WF	5/21/2025	6:15:00 AM
MAN-0559	HA	2032	2nd Floor Corridor	WF	5/21/2025	6:25:00 AM
MAN-0570	CR	2017	Room 50	DW	5/21/2025	6:32:00 AM
MAN-0582	HA	2032	2nd Floor Corridor	WF	5/21/2025	6:33:00 AM
MAN-0585	CR	2026	Room 51	DW	5/21/2025	6:35:00 AM

Samples Submitted 23

Building Address

27A Shelter Rock Road
Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received:

A Stanley

6/13/25

2:26 pm

Signature:

Samplers Name:

Daniel Smalls

Samplers Signature:

JCB Project Manager:

Daniel Smalls

Pb 200.8 SIA 0 6/15/25

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552852

LIMS Reference ID: ED52852

EMSL Customer ID: JCBR50

Attention: Select Contact - JCBR50

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
elementsupport@emsl.com

Project Name: 24-59790, Shelter Rock Elementary School, SRES,
Manhasset Union Free School District, 27A Shelter
Rock Road Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:26

Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0392 Lims Reference ID: ED52852-01 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 21:24	06/04/25 21:24	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0393 Lims Reference ID: ED52852-02 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 21:28	06/04/25 21:28	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0394 Lims Reference ID: ED52852-03 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 21:29	06/04/25 21:29	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0395 Lims Reference ID: ED52852-04 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	4.8		1	1.0	µg/L	06/04/25 21:33	06/04/25 21:33	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0396 Lims Reference ID: ED52852-05 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 21:34	06/04/25 21:34	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0397 Lims Reference ID: ED52852-06 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	89.4		1	1.0	µg/L	06/10/25 14:58	06/10/25 14:58	BP	EPA 200.8 (Dig)/EPA 200.8
Sample: MAN-0401 Lims Reference ID: ED52852-07 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 21:36	06/04/25 21:36	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0407 Lims Reference ID: ED52852-08 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 21:37	06/04/25 21:37	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0409 Lims Reference ID: ED52852-09 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062552852

LIMS Reference ID: ED52852

EMSL Customer ID: JCBR50

Attention: Select Contact - JCBR50

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
elementsupport@emsl.com

Project Name: 24-59790, Shelter Rock Elementary School, SRES,
Manhasset Union Free School District, 27A Shelter
Rock Road Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:26

Reported:

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0409 (Continued) Lims Reference ID: ED52852-09 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/04/25 21:38	06/04/25 21:38	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0414 Lims Reference ID: ED52852-10 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 21:40	06/04/25 21:40	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0420 Lims Reference ID: ED52852-11 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 21:41	06/04/25 21:41	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0426 Lims Reference ID: ED52852-12 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:37	06/05/25 12:37	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0430 Lims Reference ID: ED52852-13 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:41	06/05/25 12:41	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0431 Lims Reference ID: ED52852-14 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:43	06/05/25 12:43	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0461 Lims Reference ID: ED52852-15 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:44	06/05/25 12:44	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0476 Lims Reference ID: ED52852-16 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	2.6		1	1.0	µg/L	06/05/25 12:45	06/05/25 12:45	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0480 Lims Reference ID: ED52852-17 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552852

LIMS Reference ID: ED52852

EMSL Customer ID: JCBR50

Attention: Select Contact - JCBR50

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
elementsupport@emsl.com

Project Name: 24-59790, Shelter Rock Elementary School, SRES,
Manhasset Union Free School District, 27A Shelter
Rock Road Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:26

Reported:

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0480 (Continued) Lims Reference ID: ED52852-17 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:49	06/05/25 12:49	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0519 Lims Reference ID: ED52852-18 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:51	06/05/25 12:51	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0524 Lims Reference ID: ED52852-19 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:52	06/05/25 12:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0559 Lims Reference ID: ED52852-20 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:53	06/05/25 12:53	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0570 Lims Reference ID: ED52852-21 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:54	06/05/25 12:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0582 Lims Reference ID: ED52852-22 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/05/25 12:56	06/05/25 12:56	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0585 Lims Reference ID: ED52852-23 Matrix: Drinking Water Sampled: 05/21/25 00:00:00									
Metals									
Lead	1.4		1	1.0	µg/L	06/05/25 13:00	06/05/25 13:00	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062552852

LIMS Reference ID: ED52852

EMSL Customer ID: JCBR50

Attention: Select Contact - JCBR50

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
elementsupport@emsl.com

Project Name: 24-59790, Shelter Rock Elementary School, SRES,
Manhasset Union Free School District, 27A Shelter
Rock Road Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:26

Reported:

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062552852**LIMS Reference ID:** ED52852**EMSL Customer ID:** JCBR50**Attention:** Select Contact - JCBR50

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
elementsupport@emsl.com

Project Name: 24-59790, Shelter Rock Elementary School, SRES,
Manhasset Union Free School District, 27A Shelter
Rock Road Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:26

Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED52841

Page 1

Walk in



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-59790

Building: Munsey Park Elementary School

Client:

Manhasset Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

MPES

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0618	HA	2012	Corridor Room 209 to 212	WF	5/22/2025	6:25:00 AM
MAN-0621	HA	N/A	2nd Floor Corridor	WF	5/22/2025	6:07:00 AM
MAN-0649	HA	2038	Corridor Art Room to Computer Lab	WF	5/22/2025	6:27:00 AM
MAN-0656	FL	2032	Room 226 Faculty Lounge	KC	5/22/2025	6:28:00 AM
MAN-0657	FL	2032	Room 226 Faculty Lounge	CP	5/22/2025	6:28:00 AM
MAN-0665	HA	2038	Corridor Art Room to Computer Lab	WF	5/22/2025	6:39:00 AM
MAN-0671	NO	1003B	Nurses Office Exam Room	NS	5/22/2025	6:13:00 AM
MAN-0674	HA	1018	Corridor Main Office to Room 129	WF	5/22/2025	6:14:00 AM
MAN-0685	OF	1012	Room 119	KC	5/22/2025	6:16:00 AM
MAN-0686	HA	1018	Corridor Main Office to Room 129	WF	5/22/2025	6:17:00 AM
MAN-0696	HA	1029	Cafeteria Gym Corridor	WF	5/22/2025	6:20:00 AM
MAN-0697	HA	1029	Cafeteria Gym Corridor	WC	5/22/2025	6:20:00 AM
MAN-0698	HA	1029	Cafeteria Gym Corridor	WF	5/22/2025	6:21:00 AM
MAN-0713	CA	1028	Cafeteria	WF	5/22/2025	5:50:00 AM
MAN-0714	CA	1028	Cafeteria	WC	5/22/2025	5:50:00 AM
MAN-0715	CA	1028	Cafeteria	KC	5/22/2025	5:51:00 AM
MAN-0717	KI	1028C	Kitchen	KC	5/22/2025	5:54:00 AM
MAN-0718	KI	1028C	Kitchen	KC	5/22/2025	5:54:00 AM

Building Address

One Hunt Lane

Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received:

ASTANBY 6/3/25

Signature:

Samplers Name: Daniel Smalls

Samplers Signature:

JCB Project Manager:

Daniel Smalls

RECEIVED
EMBL ANALYTICAL, INC.

CARLE PLACE, NY

JUN 03 25, PM02:26

P200.8 SA 6/4/25

ED52841



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-59790

Building: Munsey Park Elementary School

MPES

Client:

Manhasset Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0719	KI	1028C	Kitchen	KC	5/22/2025	5:55:00 AM
MAN-0720	KI	1028C	Kitchen	KC	5/22/2025	5:55:00 AM
MAN-0721	KI	1028C1	Kitchen Office	KC	5/22/2025	5:56:00 AM
MAN-0722	KI	1028C1	Kitchen Office	SN	5/22/2025	5:56:00 AM
MAN-0723	KI	1028C1	Kitchen Office	KC	5/22/2025	5:57:00 AM
MAN-0724	KI	1028C1	Kitchen Office	KC	5/22/2025	5:57:00 AM
MAN-0725	HA	1044	Corridor Girls Bathroom to Library	WF	5/22/2025	6:00:00 AM
MAN-0738	HA	1044	Corridor Girls Bathroom to Library	WF	5/22/2025	6:02:00 AM
MAN-0741	HA	N/A	1st Floor Corridor	WF	5/22/2025	6:05:00 AM
MAN-0742	HA	N/A	1st Floor Corridor	WC	5/22/2025	6:05:00 AM
MAN-0764	HA	N/A	Ground Floor Corridor	WF	5/22/2025	6:09:00 AM
MAN-0776	HA	1023	Corridor Room 134 to Ramp	WF	5/22/2025	6:23:00 AM
MAN-0786	HA	N/A	Corridor O/S Auditorium	WC	5/22/2025	6:24:00 AM

Samples Submitted 31

RECEIVED

EMSL ANALYTICAL, INC.

Carle Place, NY

JUN 03 25, PM02:26

Building Address

One Hunt Lane

Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Recieved:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

P6200886 6/14/25

A. Stanley 6/13/25

Daniel Smalls

Daniel Smalls

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552841

LIMS Reference ID: ED52841

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name: 24-59790, Munsey Park Elementary School, MPES,
Manhasset Union Free School District, One Hunt
Lane Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:26

Reported:

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0618 Lims Reference ID: ED52841-01 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:03	06/04/25 15:03	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0621 Lims Reference ID: ED52841-02 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:04	06/04/25 15:04	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0649 Lims Reference ID: ED52841-03 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:05	06/04/25 15:05	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0656 Lims Reference ID: ED52841-04 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:07	06/04/25 15:07	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0657 Lims Reference ID: ED52841-05 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:11	06/04/25 15:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0665 Lims Reference ID: ED52841-06 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:12	06/04/25 15:12	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0671 Lims Reference ID: ED52841-07 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:13	06/04/25 15:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0674 Lims Reference ID: ED52841-08 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:15	06/04/25 15:15	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0685 Lims Reference ID: ED52841-09 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552841

LIMS Reference ID: ED52841

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name: 24-59790, Munsey Park Elementary School, MPES,
Manhasset Union Free School District, One Hunt
Lane Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:26

Reported:

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0685 (Continued) Lims Reference ID: ED52841-09 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:16	06/04/25 15:16	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0686 Lims Reference ID: ED52841-10 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:17	06/04/25 15:17	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0696 Lims Reference ID: ED52841-11 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:21	06/04/25 15:21	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0697 Lims Reference ID: ED52841-12 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:23	06/04/25 15:23	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0698 Lims Reference ID: ED52841-13 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:27	06/04/25 15:27	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0713 Lims Reference ID: ED52841-14 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:28	06/04/25 15:28	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0714 Lims Reference ID: ED52841-15 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:29	06/04/25 15:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0715 Lims Reference ID: ED52841-16 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:30	06/04/25 15:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0717 Lims Reference ID: ED52841-17 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552841

LIMS Reference ID: ED52841

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name: 24-59790, Munsey Park Elementary School, MPES,
Manhasset Union Free School District, One Hunt
Lane Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:26

Reported:

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0717 (Continued) Lims Reference ID: ED52841-17 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:32	06/04/25 15:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0718 Lims Reference ID: ED52841-18 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:33	06/04/25 15:33	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0719 Lims Reference ID: ED52841-19 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:34	06/04/25 15:34	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0720 Lims Reference ID: ED52841-20 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:46	06/04/25 15:46	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0721 Lims Reference ID: ED52841-21 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:50	06/04/25 15:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0722 Lims Reference ID: ED52841-22 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:51	06/04/25 15:51	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0723 Lims Reference ID: ED52841-23 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:53	06/04/25 15:53	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0724 Lims Reference ID: ED52841-24 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:54	06/04/25 15:54	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0725 Lims Reference ID: ED52841-25 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552841

LIMS Reference ID: ED52841

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name:

24-59790, Munsey Park Elementary School, MPES,
Manhasset Union Free School District, One Hunt
Lane Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/03/2025 14:26

Reported:**Analytical Results**
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0725 (Continued) Lims Reference ID: ED52841-25 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:58	06/04/25 15:58	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0738 Lims Reference ID: ED52841-26 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 15:59	06/04/25 15:59	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0741 Lims Reference ID: ED52841-27 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 16:01	06/04/25 16:01	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0742 Lims Reference ID: ED52841-28 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 16:02	06/04/25 16:02	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0764 Lims Reference ID: ED52841-29 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 16:03	06/04/25 16:03	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0776 Lims Reference ID: ED52841-30 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 16:05	06/04/25 16:05	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0786 Lims Reference ID: ED52841-31 Matrix: Drinking Water Sampled: 05/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/04/25 16:09	06/04/25 16:09	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552841

LIMS Reference ID: ED52841

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name:

24-59790, Munsey Park Elementary School, MPES,
Manhasset Union Free School District, One Hunt
Lane Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/03/2025 14:26

Reported:**Certified Analyses included in this Report**

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552841**LIMS Reference ID:** ED52841**EMSL Customer ID:** JCBR50**Attention:** Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name:

24-59790, Munsey Park Elementary School, MPES,
Manhasset Union Free School District, One Hunt
Lane Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/03/2025 14:26

Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

ED52840

Pb200.8 8/11 -> 6/18/25 Pb200.8 8/11 -> 6/19/25



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-59790
Building: Manhasset Secondary School
MSS

Client: Manhasset Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush ☒

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0001	FL	1000	Faculty Room 114	KC	5/23/2025	6:00:00 AM
MAN-0002	FL	1000	Faculty Room 114	KC	5/23/2025	6:00:00 AM
MAN-0003	KI	1001	Kitchen	KC	5/23/2025	5:50:00 AM
MAN-0004	KI	1001	Kitchen	SN	5/23/2025	5:50:00 AM
MAN-0005	KI	1001	Kitchen	KC	5/23/2025	5:51:00 AM
MAN-0006	KI	1001	Kitchen	SN	5/23/2025	5:51:00 AM
MAN-0007	KI	1001	Kitchen	HW	5/23/2025	5:53:00 AM
MAN-0008	KI	1001	Kitchen	KC	5/23/2025	5:53:00 AM
MAN-0009	KI	1001A	Kitchen Serving Area	KC	5/23/2025	5:55:00 AM
MAN-0010	KI	1001A	Kitchen Serving Area	SN	5/23/2025	5:55:00 AM
MAN-0011	KI	1001A	Kitchen Serving Area	HW	5/23/2025	5:56:00 AM
MAN-0012	CA	1002	Cafeteria	WF	5/23/2025	6:14:00 AM
MAN-0020	HA	1027	Corridor Room 168 to Bookstore	WF	5/23/2025	6:25:00 AM
MAN-0027	HA	1027	Corridor Room 168 to Bookstore	WF	5/23/2025	6:26:00 AM
MAN-0030	OF	1025A	Room 168/152B	WF	5/23/2025	6:28:00 AM
MAN-0049	HA	0018	Corridor 066 to Boys Bathroom	WF	5/23/2025	6:33:00 AM
MAN-0103	HA	1058	Corridor Room 122 to 143	WF	5/23/2025	6:36:00 AM
MAN-0140	HA	1058	Corridor Room 122 to 143	WF	5/23/2025	6:38:00 AM

RECEIVED
ENGLANDICAL INC.
CARLE PLACE, NY

JUN 03 25, PM02:25

Building Address
200 Memorial Place
Manhasset, NY 11030

Analysis Type: ELAP 200.5
Lab Received: 6/3/25 14:25
Signature: [Signature]

Samplers Name: Daniel Snells
Samplers Signature: [Signature]
JCB Project Manager: Daniel Snells



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-59790

Building: Manhasset Secondary School

MSS

Client:

Manhasset Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

EDS 2840

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0179	HA	1103	Corridor Prep 116 to 129	WF	5/23/2025	6:21:00 AM
MAN-0199	HA	1068	Corridor Media Center to Cafeteria	WF	5/23/2025	6:22:00 AM
MAN-0204	HE	1074	Room 108	EC	5/23/2025	7:05:00 AM
MAN-0205	HE	1074	Room 108	EC	5/23/2025	7:05:00 AM
MAN-0206	HE	1074	Room 108	EC	5/23/2025	7:06:00 AM
MAN-0207	HE	1074	Room 108	EC	5/23/2025	7:06:00 AM
MAN-0208	HA	1082	Corridor Room 104 to Media Center	WF	5/23/2025	7:07:00 AM
MAN-0212	HE	1079	Room 100	EC	5/23/2025	7:08:00 AM
MAN-0213	HA	2012	Corridor Technology Room to Custodial Closet	WF	5/23/2025	7:15:00 AM
MAN-0219	HA	2013	Commons	WF	5/23/2025	7:17:00 AM
MAN-0222	OF	2020	Room 262	WF	5/23/2025	7:19:00 AM
MAN-0228	HA	2039	Corridor Teacher Center to Room 248	WF	5/23/2025	7:21:00 AM
MAN-0268	OF	2049	Room 237	WF	5/23/2025	7:23:00 AM
MAN-0274	HA	2063	Corridor Stairwell to Room 240	WF	5/23/2025	7:25:00 AM
MAN-0278	HA	2076	Corridor Attendance Office to Art Room	WF	5/23/2025	7:27:00 AM
MAN-0280	LI	2072A	Media Center Small Office 225A	KC	5/23/2025	7:30:00 AM
MAN-0287	HA	2076	Corridor Attendance Office to Art Room	WF	5/23/2025	7:32:00 AM
MAN-0291	HA	2091	Corridor Auditorium to Counseling Center	WF	5/23/2025	7:37:00 AM

Building Address

200 Memorial Place
Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received: 6/3/25 14:25

Signature: [Signature]

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: Daniel Smalls

RECEIVED
ENGLAND TITAN INC.
CARLE PLACE, NY

JUN 03 25, PM02:25

Pb200.8 Sfl
6/8/25
Pb200.8 Sfl
6/9/25

Ph2008 8/10 6/18/25 Ph2008 8/10 6/18/25



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-59790

Building: Manhasset Secondary School

MSS

Client:

Manhasset Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

EDS2040

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0300	OF	2090E	Counseling Center Room 200	WF	5/23/2025	7:40:00 AM
MAN-0312	HA	3017	Third Floor Corridor	WF	5/23/2025	7:42:00 AM
MAN-0336	NO	1087C	Health Office Exam Room	NS	5/23/2025	6:42:00 AM
MAN-0355	ST	1097A	Ice Machine Room	IM	5/23/2025	6:45:00 AM
MAN-0363	GY	1098	Gym	WF	5/23/2025	6:48:00 AM
MAN-0365	GY	1098	Gym	WF	5/23/2025	6:51:00 AM
MAN-0372	GY	N/A	Gym Weight Room	WF	5/23/2025	6:55:00 AM
MAN-0376	LR	1105A	Wrestling Room Locker Room	IM	5/23/2025	6:58:00 AM
MAN-0377	LR	1105A	Wrestling Room Locker Room	WF	5/23/2025	6:58:00 AM
MAN-0380	OF	3016A2	Central Office Rear Secretarial/File Area Inner Office	KC	5/23/2025	7:46:00 AM
MAN-0381	OF	3016A2	Central Office Rear Secretarial/File Area Inner Office	WF	5/23/2025	7:46:00 AM
MAN-0505	KI	N/A	Admin - Room 141 Kitchen	KC	5/23/2025	5:50:00 AM
MAN-0506	KI	N/A	Admin - Room 141 Kitchen	WF	5/23/2025	5:50:00 AM
MAN-0595	CS	N/A	Concession Stand - Storage Area	WF	5/23/2025	8:06:00 AM
MAN-0596	CS	N/A	Concession Stand - Storage Area	WC	5/23/2025	8:06:00 AM
MAN-0597	CS	N/A	Concession Stand - Storage Area	IM	5/23/2025	8:07:00 AM
MAN-0600	CS	N/A	Concession Stand - Kitchen	KC	5/23/2025	8:10:00 AM
MAN-0601	CS	N/A	Concession Stand - Kitchen	KC	5/23/2025	8:10:00 AM

MAN-813 k1 1001 kitchen Im 5/23/2025 5:54:00 AM

Building Address

200 Memorial Place
Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received: 6/3/25 14:25

Signature: [Signature]

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: Daniel Smalls

RECEIVED
EHL ANALYTICAL, INC.
JUN 03 25 PM 02:25

E752840



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 24-59790
Building: Manhasset Secondary School
MSS

Client:
Manhasset Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 54

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
JUN 03 25, PM02:25

Building Address
200 Memorial Place
Manhasset, NY 11030

Analysis Type: ELAP 200.5
Lab Received: 6/3/25 14:25
Signature: *[Signature]*

Samplers Name: Daniel Smalls
Samplers Signature: _____
JCB Project Manager: _____

Pb200 & Sll 2618/25 Pb200 & Sll 2618/25

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552840

LIMS Reference ID: ED52840

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name: Manhasset Secondary School: MSS, 200 Memorial
Place, Manhasset, NY 11030: Manhasset Union Free
School District: Project# 24-59790

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 06/03/2025 14:25**Reported:****Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0001 Lims Reference ID: ED52840-01 Matrix: Drinking Water Sampled: 05/23/25 06:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 14:18	06/08/25 14:18	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0002 Lims Reference ID: ED52840-02 Matrix: Drinking Water Sampled: 05/23/25 06:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 14:22	06/08/25 14:22	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0003 Lims Reference ID: ED52840-03 Matrix: Drinking Water Sampled: 05/23/25 05:50:00									
Metals									
Lead	1.2		1	1.0	µg/L	06/08/25 14:24	06/08/25 14:24	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0004 Lims Reference ID: ED52840-04 Matrix: Drinking Water Sampled: 05/23/25 05:50:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 14:25	06/08/25 14:25	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0005 Lims Reference ID: ED52840-05 Matrix: Drinking Water Sampled: 05/23/25 05:51:00									
Metals									
Lead	5.9		1	1.0	µg/L	06/08/25 14:26	06/08/25 14:26	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0006 Lims Reference ID: ED52840-06 Matrix: Drinking Water Sampled: 05/23/25 05:51:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 14:30	06/08/25 14:30	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0007 Lims Reference ID: ED52840-07 Matrix: Drinking Water Sampled: 05/23/25 05:53:00									
Metals									
Lead	1.2		1	1.0	µg/L	06/08/25 14:32	06/08/25 14:32	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0008 Lims Reference ID: ED52840-08 Matrix: Drinking Water Sampled: 05/23/25 05:53:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 14:33	06/08/25 14:33	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0009 Lims Reference ID: ED52840-09 Matrix: Drinking Water Sampled: 05/23/25 05:55:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552840

LIMS Reference ID: ED52840

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name: Manhasset Secondary School: MSS, 200 Memorial
Place, Manhasset, NY 11030: Manhasset Union Free
School District: Project# 24-59790

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 06/03/2025 14:25**Reported:**

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: MAN-0009 (Continued)

Lims Reference ID: ED52840-09 Matrix: Drinking Water

Sampled: 05/23/25 05:55:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	06/08/25 14:34	06/08/25 14:34	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0010

Lims Reference ID: ED52840-10 Matrix: Drinking Water

Sampled: 05/23/25 05:55:00

Metals

Lead	1.7		1	1.0	µg/L	06/08/25 14:36	06/08/25 14:36	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0011

Lims Reference ID: ED52840-11 Matrix: Drinking Water

Sampled: 05/23/25 05:56:00

Metals

Lead	3.1		1	1.0	µg/L	06/08/25 14:37	06/08/25 14:37	SEH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0012

Lims Reference ID: ED52840-12 Matrix: Drinking Water

Sampled: 05/23/25 06:14:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/08/25 14:41	06/08/25 14:41	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0020

Lims Reference ID: ED52840-13 Matrix: Drinking Water

Sampled: 05/23/25 06:25:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/08/25 14:42	06/08/25 14:42	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0027

Lims Reference ID: ED52840-14 Matrix: Drinking Water

Sampled: 05/23/25 06:26:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/08/25 14:46	06/08/25 14:46	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0030

Lims Reference ID: ED52840-15 Matrix: Drinking Water

Sampled: 05/23/25 06:28:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/08/25 14:48	06/08/25 14:48	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0049

Lims Reference ID: ED52840-16 Matrix: Drinking Water

Sampled: 05/23/25 06:33:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/08/25 14:49	06/08/25 14:49	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0103

Lims Reference ID: ED52840-17 Matrix: Drinking Water

Sampled: 05/23/25 06:36:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552840

LIMS Reference ID: ED52840

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name: Manhasset Secondary School: MSS, 200 Memorial Place, Manhasset, NY 11030: Manhasset Union Free School District: Project# 24-59790

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:25

Reported:

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0103 (Continued) Lims Reference ID: ED52840-17 Matrix: Drinking Water Sampled: 05/23/25 06:36:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/08/25 14:50	06/08/25 14:50	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0140 Lims Reference ID: ED52840-18 Matrix: Drinking Water Sampled: 05/23/25 06:38:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 14:52	06/08/25 14:52	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0179 Lims Reference ID: ED52840-19 Matrix: Drinking Water Sampled: 05/23/25 06:21:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:05	06/08/25 15:05	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0199 Lims Reference ID: ED52840-20 Matrix: Drinking Water Sampled: 05/23/25 06:22:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:09	06/08/25 15:09	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0204 Lims Reference ID: ED52840-21 Matrix: Drinking Water Sampled: 05/23/25 07:05:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:10	06/08/25 15:10	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0205 Lims Reference ID: ED52840-22 Matrix: Drinking Water Sampled: 05/23/25 07:05:00									
Metals									
Lead	1.8		1	1.0	µg/L	06/08/25 15:12	06/08/25 15:12	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0206 Lims Reference ID: ED52840-23 Matrix: Drinking Water Sampled: 05/23/25 07:06:00									
Metals									
Lead	1.3		1	1.0	µg/L	06/08/25 15:13	06/08/25 15:13	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0207 Lims Reference ID: ED52840-24 Matrix: Drinking Water Sampled: 05/23/25 07:06:00									
Metals									
Lead	7.3		1	1.0	µg/L	06/08/25 15:17	06/08/25 15:17	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0208 Lims Reference ID: ED52840-25 Matrix: Drinking Water Sampled: 05/23/25 07:07:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552840

LIMS Reference ID: ED52840

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name: Manhasset Secondary School: MSS, 200 Memorial
Place, Manhasset, NY 11030: Manhasset Union Free
School District: Project# 24-59790

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 06/03/2025 14:25**Reported:**

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0208 (Continued) Lims Reference ID: ED52840-25 Matrix: Drinking Water Sampled: 05/23/25 07:07:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:18	06/08/25 15:18	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0212 Lims Reference ID: ED52840-26 Matrix: Drinking Water Sampled: 05/23/25 07:08:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:20	06/08/25 15:20	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0213 Lims Reference ID: ED52840-27 Matrix: Drinking Water Sampled: 05/23/25 07:15:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:21	06/08/25 15:21	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0219 Lims Reference ID: ED52840-28 Matrix: Drinking Water Sampled: 05/23/25 07:17:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:22	06/08/25 15:22	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0222 Lims Reference ID: ED52840-29 Matrix: Drinking Water Sampled: 05/23/25 07:19:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:24	06/08/25 15:24	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0228 Lims Reference ID: ED52840-30 Matrix: Drinking Water Sampled: 05/23/25 07:21:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:28	06/08/25 15:28	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0268 Lims Reference ID: ED52840-31 Matrix: Drinking Water Sampled: 05/23/25 07:23:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:29	06/08/25 15:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0274 Lims Reference ID: ED52840-32 Matrix: Drinking Water Sampled: 05/23/25 07:25:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:33	06/08/25 15:33	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0278 Lims Reference ID: ED52840-33 Matrix: Drinking Water Sampled: 05/23/25 07:27:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552840

LIMS Reference ID: ED52840

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name: Manhasset Secondary School: MSS, 200 Memorial Place, Manhasset, NY 11030: Manhasset Union Free School District: Project# 24-59790

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 06/03/2025 14:25

Reported:

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0278 (Continued) Lims Reference ID: ED52840-33 Matrix: Drinking Water Sampled: 05/23/25 07:27:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:34	06/08/25 15:34	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0280 Lims Reference ID: ED52840-34 Matrix: Drinking Water Sampled: 05/23/25 07:30:00									
Metals									
Lead	19.3		1	1.0	µg/L	06/08/25 15:36	06/08/25 15:36	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0287 Lims Reference ID: ED52840-35 Matrix: Drinking Water Sampled: 05/23/25 07:32:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:37	06/08/25 15:37	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0291 Lims Reference ID: ED52840-36 Matrix: Drinking Water Sampled: 05/23/25 07:37:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:38	06/08/25 15:38	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0300 Lims Reference ID: ED52840-37 Matrix: Drinking Water Sampled: 05/23/25 07:40:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:40	06/08/25 15:40	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0312 Lims Reference ID: ED52840-38 Matrix: Drinking Water Sampled: 05/23/25 07:42:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/08/25 15:41	06/08/25 15:41	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0336 Lims Reference ID: ED52840-39 Matrix: Drinking Water Sampled: 05/23/25 06:42:00									
Metals									
Lead	1.7		1	1.0	µg/L	06/09/25 11:07	06/09/25 11:07	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0355 Lims Reference ID: ED52840-40 Matrix: Drinking Water Sampled: 05/23/25 06:45:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 11:11	06/09/25 11:11	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0363 Lims Reference ID: ED52840-41 Matrix: Drinking Water Sampled: 05/23/25 06:48:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552840

LIMS Reference ID: ED52840

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name: Manhasset Secondary School: MSS, 200 Memorial
Place, Manhasset, NY 11030: Manhasset Union Free
School District: Project# 24-59790

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 06/03/2025 14:25**Reported:**

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: MAN-0363 (Continued)

Lims Reference ID: ED52840-41 Matrix: Drinking Water

Sampled: 05/23/25 06:48:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	06/09/25 11:12	06/09/25 11:12	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0365

Lims Reference ID: ED52840-42 Matrix: Drinking Water

Sampled: 05/23/25 06:51:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/09/25 11:13	06/09/25 11:13	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0372

Lims Reference ID: ED52840-43 Matrix: Drinking Water

Sampled: 05/23/25 06:55:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/09/25 11:15	06/09/25 11:15	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0376

Lims Reference ID: ED52840-44 Matrix: Drinking Water

Sampled: 05/23/25 06:58:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/09/25 11:19	06/09/25 11:19	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0377

Lims Reference ID: ED52840-45 Matrix: Drinking Water

Sampled: 05/23/25 06:58:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/09/25 11:20	06/09/25 11:20	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0380

Lims Reference ID: ED52840-46 Matrix: Drinking Water

Sampled: 05/23/25 07:46:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/09/25 11:21	06/09/25 11:21	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0381

Lims Reference ID: ED52840-47 Matrix: Drinking Water

Sampled: 05/23/25 07:46:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/09/25 11:23	06/09/25 11:23	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0505

Lims Reference ID: ED52840-48 Matrix: Drinking Water

Sampled: 05/23/25 05:50:00

Metals

Lead	< 1.0		1	1.0	µg/L	06/09/25 11:24	06/09/25 11:24	SEH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN-0506

Lims Reference ID: ED52840-49 Matrix: Drinking Water

Sampled: 05/23/25 05:50:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552840

LIMS Reference ID: ED52840

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name:

Manhasset Secondary School: MSS, 200 Memorial
Place, Manhasset, NY 11030: Manhasset Union Free
School District: Project# 24-59790

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/03/2025 14:25

Reported:**Analytical Results**
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0506 (Continued) Lims Reference ID: ED52840-49 Matrix: Drinking Water Sampled: 05/23/25 05:50:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	06/09/25 11:25	06/09/25 11:25	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0595 Lims Reference ID: ED52840-50 Matrix: Drinking Water Sampled: 05/23/25 08:06:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 11:29	06/09/25 11:29	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0596 Lims Reference ID: ED52840-51 Matrix: Drinking Water Sampled: 05/23/25 08:06:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 11:31	06/09/25 11:31	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0597 Lims Reference ID: ED52840-52 Matrix: Drinking Water Sampled: 05/23/25 08:07:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 11:35	06/09/25 11:35	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0600 Lims Reference ID: ED52840-53 Matrix: Drinking Water Sampled: 05/23/25 08:10:00									
Metals									
Lead	2.7		1	1.0	µg/L	06/09/25 11:36	06/09/25 11:36	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0601 Lims Reference ID: ED52840-54 Matrix: Drinking Water Sampled: 05/23/25 08:10:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 11:37	06/09/25 11:37	SEH	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0813 Lims Reference ID: ED52840-55 Matrix: Drinking Water Sampled: 05/23/25 05:54:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	06/09/25 11:38	06/09/25 11:38	SEH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062552840

LIMS Reference ID: ED52840

EMSL Customer ID: JCBR50

Attention: Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name:

Manhasset Secondary School: MSS, 200 Memorial
Place, Manhasset, NY 11030: Manhasset Union Free
School District: Project# 24-59790

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/03/2025 14:25

Reported:**Certified Analyses included in this Report**

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062552840**LIMS Reference ID:** ED52840**EMSL Customer ID:** JCBR50**Attention:** Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name:

Manhasset Secondary School: MSS, 200 Memorial
Place, Manhasset, NY 11030: Manhasset Union Free
School District: Project# 24-59790

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

06/03/2025 14:25

Reported:

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

24-59790

Building:

Manhasset Secondary School

MSS

Client:

Manhasset Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

48 hr

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0005	KI	1001	Kitchen	KC	8-19-2025	7:30
MAN-0207	HE	1074	Room 108	EC	8-19-2025	7:32

Samples Submitted 2



RECEIVED

ENSL ANALYTICAL, INC.

Carle Place, NY

AUG 20 25, PM 04:56

Building Address

200 Memorial Place

Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received: A. Minnifield

Signature: A. Minnifield

8/20/25 4:56 pm

Samplers Name: Kenneth Fuentes

Samplers Signature: [Signature]

JCB Project Manager: Dan Smalls

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555322**LIMS Reference ID:** ED55322**EMSL Customer ID:** JCBR50**Attention:** Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name:

24-59790, Manhasset Secondary School, MSS,
Manhasset Union Free School District, 200 Memorial
Place, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

08/20/2025 16:56

Reported:

08/22/2025 09:48

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: MAN -0005**Lims Reference ID:** ED55322-01 **Matrix:** Drinking Water**Sampled:** 08/19/25 00:00:00**Metals**

Lead	< 1.0		1	1.0	µg/L	08/21/25 21:23	08/21/25 21:23	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: MAN -0207**Lims Reference ID:** ED55322-02 **Matrix:** Drinking Water**Sampled:** 08/19/25 00:00:00**Metals**

Lead	2.6		1	1.0	µg/L	08/21/25 21:24	08/21/25 21:24	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062555322**LIMS Reference ID:** ED55322**EMSL Customer ID:** JCBR50**Attention:** Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name:

24-59790, Manhasset Secondary School, MSS,
Manhasset Union Free School District, 200 Memorial
Place, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

08/20/2025 16:56

Reported:

08/22/2025 09:48

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062555322**LIMS Reference ID:** ED55322**EMSL Customer ID:** JCBR50**Attention:** Daniel Smalls

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
dsmalls@jcbroderick.com

Project Name:

24-59790, Manhasset Secondary School, MSS,
Manhasset Union Free School District, 200 Memorial
Place, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

08/20/2025 16:56

Reported:

08/22/2025 09:48


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

25-63160

Building: Manhasset Secondary School

MSS

Walk In

ED57956

Page 1 of 2

Client:

Manhasset Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

48 Hour

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0013	CA	1002	Cafeteria	WC	12/30/25	7:37
MAN-0021	HA	1027	Corridor Room 168 to Bookstore	WC	12/30/25	9:58
MAN-0028	HA	1027	Corridor Room 168 to Bookstore	WC	12/30/25	9:57
MAN-0039	HA	1050	Corridor Room 147 to 149	WF	12/30/25	005
MAN-0040	HA	1050	Corridor Room 147 to 149	WC	12/30/25	9:54
MAN-0050	HA	0018	Corridor 066 to Boys Bathroom	WC	12/30/25	9:51
MAN-0104	HA	1058	Corridor Room 122 to 143	WC	12/30/25	9:46
MAN-0106	OF	1055	Room 140 A	CP	12/30/25	9:43
MAN-0141	HA	1058	Corridor Room 122 to 143	WC	12/30/25	9:38
MAN-0180	HA	1103	Corridor Prep 116 to 129	WC	12/30/25	9:31
MAN-0200	HA	1068	Corridor Media Center to Cafeteria	WC	12/30/25	9:25
MAN-0209	HA	1082	Corridor Room 104 to Media Center	WC	12/30/25	10:03
MAN-0214	HA	2012	Corridor Technology Room to Custodial Closet	WC	12/30/25	8:05
MAN-0220	HA	2013	Commons	WC	12/30/25	8:15
MAN-0229	HA	2039	Corridor Teacher Center to Room 248	WC	12/30/25	005
MAN-0263	OF	2037A1	Office Resource Room Closet	CP	12/30/25	8:28
MAN-0275	HA	2063	Corridor Stairwell to Room 240	WC	12/30/25	8:28
MAN-0279	HA	2076	Corridor Attendance Office to Art Room	WC	12/30/25	005

16200.9
Kathleen 12/31/25

Building Address

200 Memorial Place

Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Recieved: DAVID WILSON

Signature: David Wilson


12/30/25
3:58 PM

Samplers Name: Andy Carbone

Samplers Signature: Andy Carbone

JCB Project Manager: George Green

EMS ANALYTICAL, INC.
Cable Place, NY
DEC 30 2025 PM 03:58



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

25-63160

Building:

Manhasset Secondary School

MSS

ED57956

Page 2 of 2

Client:

Manhasset Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

48 Hours

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0288	HA	2076	Corridor Attendance Office to Art Room	WC	12/30/25	8:37
MAN-0292	HA	2091	Corridor Auditorium to Counseling Center	WC	12/30/25	8:42
MAN-0313	HA	3017	Third Floor Corridor	WC	12/30/25	7:40
MAN-0345	HA	1102	Corridor Gym to Room 129	WF	12/30/25	7:45
MAN-0346	HA	1102	Corridor Gym to Room 129	WC	12/30/25	7:46
MAN-0364	GY	1098	Gym	WC	12/30/25	8:50
MAN-0366	GY	1098	Gym	WC	12/30/25	8:55
MAN-0373	GY	N/A	Gym Weight Room	WC	12/30/25	9:10
MAN-0378	LR	1105A	Wrestling Room Locker Room	WC	12/30/25	9:20
MAN-0602	EX	N/A	Exterior from Concession Stand	DW	12/30/25	005

Samples Submitted 28

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
DEC 30 25, PM 04:03

Ab 200.8
Kathleen 12/31/25

Building Address

200 Memorial Place

Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received:

DAVID WARTON 12/30/25 4:03 PM

Signature:

David Warton

Samplers Name: Andy Carbow

Samplers Signature:

Andy Carbow

JCB Project Manager:

George Grove

Page 7 of 7

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557956

LIMS Reference ID: ED57956

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 25-63160 / Manhasset Union Free School District /
Manhasset Secondary School MSS / 200 Memorial
Place, Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 12/30/2025 15:58**Reported:** 12/31/2025 16:38**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0013 Lims Reference ID: ED57956-01 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:01	12/31/25 12:01	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0021 Lims Reference ID: ED57956-02 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:05	12/31/25 12:05	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0028 Lims Reference ID: ED57956-03 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:07	12/31/25 12:07	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0040 Lims Reference ID: ED57956-05 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:08	12/31/25 12:08	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0050 Lims Reference ID: ED57956-06 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:12	12/31/25 12:12	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0104 Lims Reference ID: ED57956-07 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:13	12/31/25 12:13	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0141 Lims Reference ID: ED57956-09 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:15	12/31/25 12:15	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0180 Lims Reference ID: ED57956-10 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:16	12/31/25 12:16	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0200 Lims Reference ID: ED57956-11 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557956

LIMS Reference ID: ED57956

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 25-63160 / Manhasset Union Free School District /
Manhasset Secondary School MSS / 200 Memorial
Place, Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 12/30/2025 15:58

Reported: 12/31/2025 16:38

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0200 (Continued) Lims Reference ID: ED57956-11 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:17	12/31/25 12:17	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0209 Lims Reference ID: ED57956-12 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:19	12/31/25 12:19	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0214 Lims Reference ID: ED57956-13 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:20	12/31/25 12:20	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0220 Lims Reference ID: ED57956-14 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:24	12/31/25 12:24	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0263 Lims Reference ID: ED57956-16 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 15:23	12/31/25 15:23	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: MAN-0279 Lims Reference ID: ED57956-18 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 15:24	12/31/25 15:24	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: MAN-0288 Lims Reference ID: ED57956-19 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:28	12/31/25 12:28	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0292 Lims Reference ID: ED57956-20 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:29	12/31/25 12:29	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0313 Lims Reference ID: ED57956-21 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557956

LIMS Reference ID: ED57956

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 25-63160 / Manhasset Union Free School District /
Manhasset Secondary School MSS / 200 Memorial
Place, Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 12/30/2025 15:58

Reported: 12/31/2025 16:38

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0313 (Continued) Lims Reference ID: ED57956-21 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:30	12/31/25 12:30	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0345 Lims Reference ID: ED57956-22 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:32	12/31/25 12:32	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0346 Lims Reference ID: ED57956-23 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 15:19	12/31/25 15:19	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: MAN-0364 Lims Reference ID: ED57956-24 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 15:28	12/31/25 15:28	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: MAN-0366 Lims Reference ID: ED57956-25 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:33	12/31/25 12:33	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0373 Lims Reference ID: ED57956-26 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:34	12/31/25 12:34	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0378 Lims Reference ID: ED57956-27 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 12:36	12/31/25 12:36	KT1	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557956**LIMS Reference ID:** ED57956**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

25-63160 / Manhasset Union Free School District /
Manhasset Secondary School MSS / 200 Memorial
Place, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/30/2025 15:58

Reported:

12/31/2025 16:38

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062557956**LIMS Reference ID:** ED57956**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

25-63160 / Manhasset Union Free School District /
Manhasset Secondary School MSS / 200 Memorial
Place, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/30/2025 15:58

Reported:

12/31/2025 16:38


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

Building: Munsey Park Elementary School

MPES

ED57955

25-63160

Client:

Manhasset Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush

Page 1 of 1

48 Hour

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0619	HA	2012	Corridor Room 209 to 212	WC	12/30/25	11:52
MAN-0622	HA	N/A	2nd Floor Corridor	WC	12/30/25	11:55
MAN-0650	HA	2038	Corridor Art Room to Computer Lab	WC	12/30/25	11:58
MAN-0658	FL	2032	Room 226 Faculty Lounge	CP		
MAN-0659	FL	2032	Room 226 Faculty Lounge	CP		
MAN-0666	HA	2038	Corridor Art Room to Computer Lab	WC	12/30/25	11:59
MAN-0675	HA	1018	Corridor Main Office to Room 129	WC	12/30/25	13:05
MAN-0687	HA	1018	Corridor Main Office to Room 129	WC	12/30/25	13:08
MAN-0699	HA	1029	Cafeteria Gym Corridor	WC	12/30/25	13:11
MAN-0726	HA	1044	Corridor Girls Bathroom to Library	WC	12/30/25	13:14
MAN-0739	HA	1044	Corridor Girls Bathroom to Library	WC	12/30/25	13:17
MAN-0765	HA	N/A	Ground Floor Corridor	WC	12/30/25	13:21
MAN-0777	HA	1023	Corridor Room 134 to Ramp	WC	12/30/25	13:24
MAN-0785	HA	N/A	Corridor O/S Auditorium	WF	12/30/25	13:30

Samples Submitted 14



Pb 200.8 Bldg 12/31/25

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
DEC 30 25, PM04:01

Building Address

One Hunt Lane
Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received: DAVID WARTON

Signature: David Warton

12/30/25
4:01 PM

Samplers Name: Andy Carbone

Samplers Signature: [Signature]

JCB Project Manager: George Grev

Page 5 of 5

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557955

LIMS Reference ID: ED57955

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 25-63160 / Manhasset Union Free School District /
Munsey Park Elementary School MPES / One Hunt
Lane, Manhasset, NY 11030

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 12/30/2025 16:01

Reported: 12/31/2025 15:02

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0619 Lims Reference ID: ED57955-01 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:34	12/31/25 10:34	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0622 Lims Reference ID: ED57955-02 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:36	12/31/25 10:36	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0650 Lims Reference ID: ED57955-03 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:37	12/31/25 10:37	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0666 Lims Reference ID: ED57955-04 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:38	12/31/25 10:38	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0675 Lims Reference ID: ED57955-05 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:40	12/31/25 10:40	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0687 Lims Reference ID: ED57955-06 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:44	12/31/25 10:44	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0699 Lims Reference ID: ED57955-07 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:48	12/31/25 10:48	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0726 Lims Reference ID: ED57955-08 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:49	12/31/25 10:49	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0739 Lims Reference ID: ED57955-09 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557955

LIMS Reference ID: ED57955

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

25-63160 / Manhasset Union Free School District /
Munsey Park Elementary School MPES / One Hunt
Lane, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/30/2025 16:01

Reported:

12/31/2025 15:02

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0739 (Continued)									
Lims Reference ID:				ED57955-09		Matrix: Drinking Water			Sampled: 12/30/25 00:00:00
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:50	12/31/25 10:50	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0765									
Lims Reference ID:				ED57955-10		Matrix: Drinking Water			Sampled: 12/30/25 00:00:00
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:52	12/31/25 10:52	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0777									
Lims Reference ID:				ED57955-11		Matrix: Drinking Water			Sampled: 12/30/25 00:00:00
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:53	12/31/25 10:53	BP	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0785									
Lims Reference ID:				ED57955-12		Matrix: Drinking Water			Sampled: 12/30/25 00:00:00
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 10:54	12/31/25 10:54	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557955**LIMS Reference ID:** ED57955**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

25-63160 / Manhasset Union Free School District /
Munsey Park Elementary School MPES / One Hunt
Lane, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/30/2025 16:01

Reported:

12/31/2025 15:02

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062557955**LIMS Reference ID:** ED57955**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

25-63160 / Manhasset Union Free School District /
Munsey Park Elementary School MPES / One Hunt
Lane, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/30/2025 16:01

Reported:

12/31/2025 15:02


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 25-63160
Building: Shelter Rock Elementary School
SRES

Walk In

ED57959

Page 1 of 2

Client: Manhasset Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

48 Hour

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0402	HA	1087	Main Corridor	WC	12/30/25	005
MAN-0410	HA	1087	Main Corridor	WC	12/30/25	005
MAN-0417	FL	1018	Faculty Lounge	EP	12/30/25	005
MAN-0427	CR	2033	Room 40	WC	12/30/25	005
MAN-0432	HA	1087	Main Corridor	WC	12/30/25	11:35
MAN-0453	CR	1045	Room 10	DW	12/30/25	10:49
MAN-0455	CR	1046	Room 11	DW	12/30/25	10:53
MAN-0462	HA	1077	Corridor Room 20 to 24	WC	12/30/25	10:59
MAN-0481	HA	1077	Corridor Room 20 to 24	WC	12/30/25	11:05
MAN-0497	CR	1075	Room 25	DW	12/30/25	005
MAN-0499	CR	1076	Room 26	DW	12/30/25	005
MAN-0520	HA	1082	Gym Corridor	WC	12/30/25	10:37
MAN-0525	HA	N/A	New Construction-Corridor	WC	12/30/25	11:20
MAN-0539	CR	2001	Room 41	DW	12/30/25	005
MAN-0541	CR	2002	Room 42	DW	12/30/25	005
MAN-0543	CR	2003	Room 43	DW	12/30/25	005
MAN-0545	CR	2004	Room 44	DW	12/30/25	005
MAN-0560	HA	2032	2nd Floor Corridor	WC	12/30/25	11:27

RECEIVED
ENGL ANALYTICAL, INC.
Carle Place, NY
DEC 30 25, PM 03:59

Building Address

27A Shelter Rock Road
Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received:

DAVID WHARTON

12/30/25
3:59 PM

Signature:

David Wharton

Samplers Name:

Andy Carls

Samplers Signature:


Andy Carls

JCB Project Manager:

George G...

Page 4 of 5

pb 200.8
Kathleen 12/31/25



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

25-63160

Building: Shelter Rock Elementary School

SRES

Client:

Manhasset Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

48 Hour

ED57959

Page 2 of 2

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MAN-0562	CR	2013	Room 46	DW	12/30/25	
MAN-0564	CR	2014C	Room 47 Computer Room	DW	12/30/25	
MAN-0583	HA	2032	2nd Floor Corridor	WC	12/30/25	11:31
MAN-0595 TSD	GW	2034 1005	Room 45 GYM	DW	12/30/25	11:30

Samples Submitted 22

RECEIVED
ENSL ANALYTICAL, INC.
Carle Place, NY
DEC 30 25, PM04:00

Pb 200.8
Kathleen
12/31/25

Building Address

27A Shelter Rock Road

Manhasset, NY 11030

Analysis Type: ELAP 200.5

Lab Received: DAVID WHITTON

12/30/25
4:00 pm

Signature:

David Whitton

Samplers Name: Andy Carbar

Samplers Signature:

Andy Carbar

JCB Project Manager:

George Gr

Page 5 of 5

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062557959

LIMS Reference ID: ED57959

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

25-63160 / Manhasset Union Free School District /
Shelter Rock Elementary School SRES / 27A Shelter
Rock Road, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/30/2025 15:59

Reported:

12/31/2025 15:06

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: MAN-0432 Lims Reference ID: ED57959-01 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 11:34	12/31/25 11:34	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0462 Lims Reference ID: ED57959-02 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 11:38	12/31/25 11:38	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0481 Lims Reference ID: ED57959-03 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 11:39	12/31/25 11:39	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0520 Lims Reference ID: ED57959-04 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 11:40	12/31/25 11:40	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0525 Lims Reference ID: ED57959-05 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 11:42	12/31/25 11:42	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0560 Lims Reference ID: ED57959-06 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 11:43	12/31/25 11:43	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-0583 Lims Reference ID: ED57959-07 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 11:44	12/31/25 11:44	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: MAN-TBD Lims Reference ID: ED57959-08 Matrix: Drinking Water Sampled: 12/30/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/31/25 11:46	12/31/25 11:46	KT1	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557959**LIMS Reference ID:** ED57959**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

25-63160 / Manhasset Union Free School District /
Shelter Rock Elementary School SRES / 27A Shelter
Rock Road, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/30/2025 15:59

Reported:

12/31/2025 15:06

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062557959**LIMS Reference ID:** ED57959**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

25-63160 / Manhasset Union Free School District /
Shelter Rock Elementary School SRES / 27A Shelter
Rock Road, Manhasset, NY 11030

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/30/2025 15:59

Reported:

12/31/2025 15:06

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.


Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Attachment 4:

Laboratory Certifications

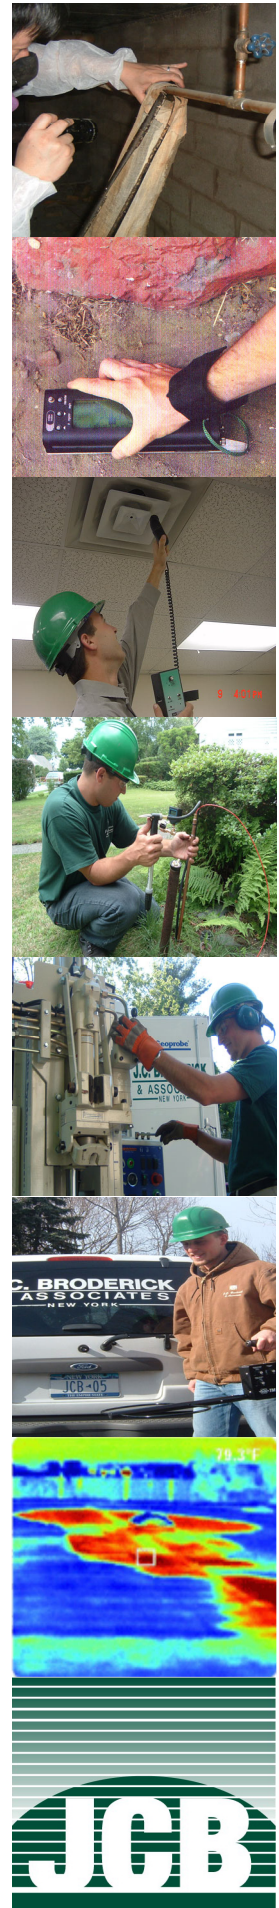

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2024
Issued April 01, 2022
Revised March 30, 2023

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Heterotrophic Plate Count	SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5
-------------	-----------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------



Serial No.: 66394

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at <https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/>, by phone (518) 485-5570 or by email to elap@health.ny.gov.

