

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



December 18, 2025

Mr. Ron Carritue
Elwood Union Free School District
Administrative Offices
100 Kenneth Avenue
Greenlawn, New York 11740

Re: **Lead Testing in School Drinking Water
Remedial Action Plan
2025 Compliance 10 NYCRR Subpart 67-4**

JCB#: **23-53894**

Dear Mr. Carritue:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 5 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead in Water Remediation Plan
Attachment 2: Outlet Inventory and Lead Testing Results
Attachment 3: Laboratory Analytical Reports
Attachment 4: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.

Sincerely,
J C Broderick & Associates, Inc.

Attachment 1:

Lead in Water
Remediation Plan


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

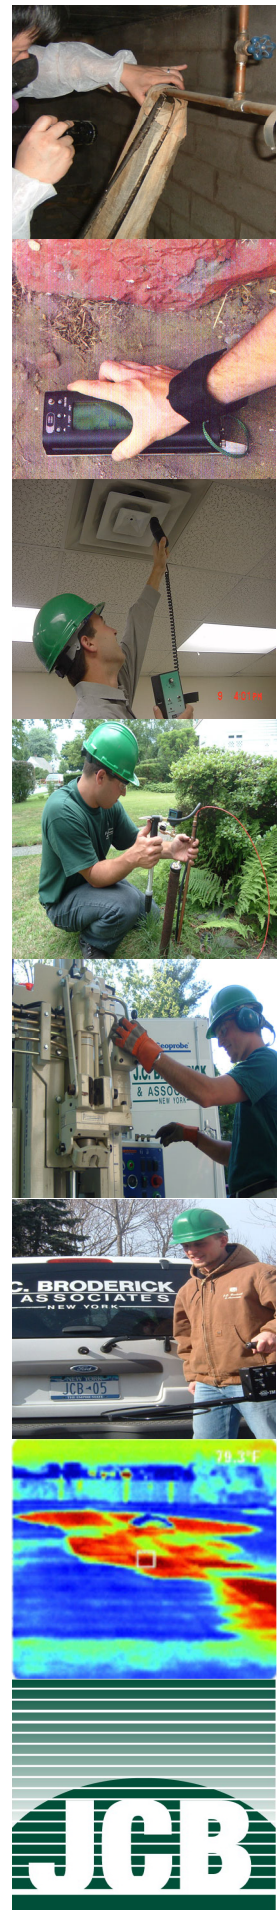

Lead in Water Remediation Plan

Section 67-4.4 Response of the New York State Department of Health (NYS DOH) Title 10 of the Official Compilation of the Codes, Rules and Regulations of the State of New York requires:

If the lead concentration of water at an outlet exceeds the action level, the school shall:

(a) prohibit use of the outlet until:

(1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and

(2) test results indicate that the lead levels are at or below the action level;

As historical sampling results have indicated, the concentrations of lead are more likely attributable to the individual fixtures and/or their immediately adjoining plumbing, and not with the building-wide plumbing. Based upon this information, the following remedial steps are recommended:

Step 1A: Potable Outlets (Outlets intended to be used for drinking/cooking)

Immediately remove the fixture from service. If necessary, provide an adequate supply of potable water for drinking/cooking to this location at no cost to the occupants. If an outlet is seldomly used or is unnecessary, the district may consider permanent removal of the outlet and capping of its supply line.

Step 1B: Non-Potable Outlets (Outlets not intended for drinking/cooking)


See Step 1A OR Placard the outlet for non-drinking use. Signs must be clearly visible and in close proximity to the affected outlet. Example signage is provided at: https://www.health.ny.gov/environmental/water/drinking/lead/docs/donotdrinksigns_lead.pdf.



Do not use for drinking



Hand washing only

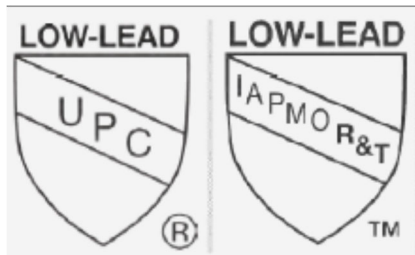

Step 2: Service & Repair or Outlet Replacement

The school district's plumber should evaluate the outlet to determine if any components require service or repair. Depending on the extent of service/repair necessary, age of the fixture, and or overall costs, the district may consider replacing the outlet entirely. Any newly installed components shall be certified lead free. (i.e. NSF/ANSI 61, NSF/ANSI-273). If servicing involves installing/replacing a point-of-use filtration system, this filter shall be certified for its lead reduction capability (i.e. NSF/ANSI 53). Follow all manufacturer's instructions for all component installations. OUTLET RESTRICTIONS MUST REMAIN IN PLACE UNTIL SATISFACTORY TEST RESULTS ARE RECEIVED. See Step 3.

Step 3: Retesting & Return to Service

Schedule a retest of the outlet. Outlet restrictions must remain in place until lead testing results at or below the action level are received. Once satisfactory results are received, the outlet may be returned to normal service. Note: It is recommended that "Do Not Drink" signage remain in place for all non-potable and non-applicable outlet types.

Attachment 2:

Outlet Inventory and Lead Testing Results


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

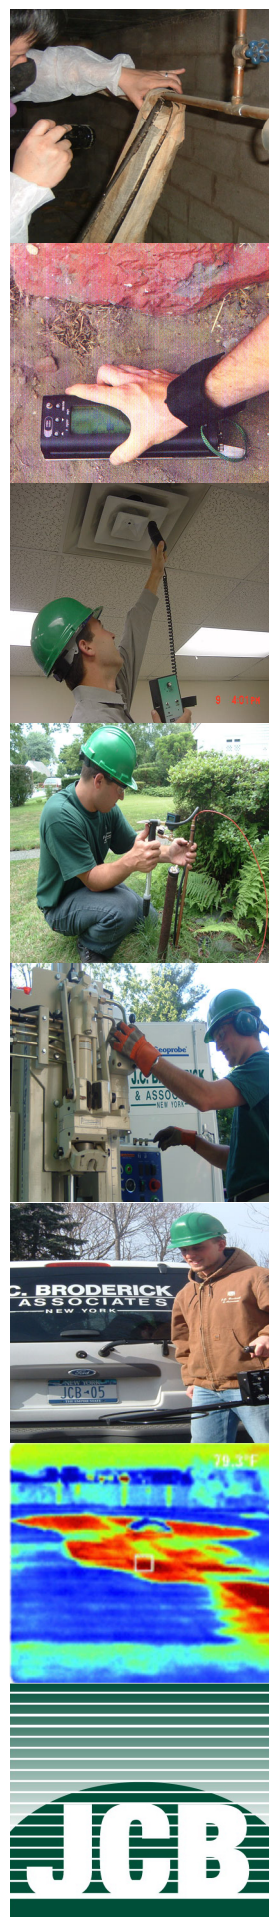



Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53894

Elwood Union Free School District

Harley Avenue Primary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0001	Receiving Room	1002	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0002	Receiving Room Storage/Slop Sink Closet	1002B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0003	Receiving Room Toilet	1002A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0004	Bathroom Behind Kitchen	1001	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0005	Kitchen	1003	Hand Wash Only	Applicable	10/18/2025	15.5	11/22/2025	<1.0	Result Below Action Level Continue O&M
EUFS-0006	Kitchen	1003	Kitchen Faucet (Cold)	Applicable	10/18/2025	2.4			Result Below Action Level Continue O&M
EUFS-0007	Kitchen	1003	Spray Nozzle	Applicable	10/18/2025	7.2	12/16/2025	2.6	Result Below Action Level Continue O&M
EUFS-0008	Kitchen	1003	Kitchen Service Area	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0009	Kitchen	1003	Kitchen Faucet (Cold)	Applicable	10/18/2025	3.5			Result Below Action Level Continue O&M
EUFS-0011	Boiler Room	1005	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0012	Book Room	1006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0013	OT/PT Bathroom	1008B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0015	Faculty Bathroom Formerly PTA Room	1012	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0018	Boys Bathroom	1014	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0019	Boys Bathroom	1014	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0028	Room 180	1025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Harley Avenue Primary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0029	Room 180	1025	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0031	Room 181	1026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0033	Room 182	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0034	Room 182	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0036	Room 156	1031	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0038	Room 157	1032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0040	Room 158	1033	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0042	Custodial Closet	1046	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0043	Room 161	1034	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0045	Room 162	1035	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0047	Room 163	1036	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0049	Room 164	1037	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0051	Room 165	1038	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0053	Room 166	1039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0055	Room 167	1040	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0057	Room 168	1041	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0059	Room 169	1042	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0061	Science Room 207	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0063	Room 206	2004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0065	Room 205	2005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Harley Avenue Primary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0067	Room 204	2006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0069	Room 203	2007	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0071	Room 202	2008	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0073	Room 201	2009	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0075	Room 221	2010	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0077	Room 220	2011	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0078	Girls Bathroom	2012	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0079	Girls Bathroom	2012	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0080	Girls Bathroom	2012	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0081	Girls Bathroom	2012	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0083	Girls Bathroom	2012	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0084	Faculty Bathroom	2013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0086	Custodian Closet	2014	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0087	Boys Bathroom	2015	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0088	Boys Bathroom	2015	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0089	Boys Bathroom	2015	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0090	Boys Bathroom	2015	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0091	Boys Bathroom	2015	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0092	Boys Bathroom	2015	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0094	Room 215	2016	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Harley Avenue Primary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0096	Room 214	2017	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0098	Room 213	2018	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0100	Room 212	2019	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0101	Art Room 210	2021	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0105		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0106		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0109		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0110		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0111	Courtyard	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0765	Nurse Room	1024A	Nurse's Office Sink	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0766	Nurse Bathroom	1024A2	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0767	Cafeteria	1019	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0768	Cafeteria	1019	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0899	Faculty Room	1011	Kitchen Faucet (Cold)	Applicable	10/18/2025	1.1			Result Below Action Level Continue O&M
EUFS-0900	Girls Bathroom	1013	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0901	Girls Bathroom	1013	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0902	Girls Bathroom	1013	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0903	Boys Bathroom	1014	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0904	Corridor Between Faculty Room & Room 182	1029	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0905	Corridor Between Faculty Room & Room 182	1029	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M

Harley Avenue Primary School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0906	Mail Room	1043	Kitchen Faucet (Cold)	Applicable	10/18/2025	2.9			Result Below Action Level Continue O&M
EUFS-0907	Main Office Bathroom	1022B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0908	Girls Bathroom	2012	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0909	Corridor From Art Storage To Room 201	2023	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0910	Corridor From Art Storage To Room 201	2023	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0911		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0912		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0946	Room 182	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0947	Near Playground	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0948	In Garden by Main Entrance	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0112	Storage Room Adjacent Kitchen Storage Room	0003	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0113	Receiving Room Office/Custodial Break Room	1062A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0114	Receiving Room Office/Custodial Break Room	1062A1	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0115	Custodial Office Bathroom	1060A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0117	Main Office Kitchenette	1012A	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0118	Main Office Bathroom	1012H2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0120	Nurses Office	1016A	Nurse's Office Sink	Applicable	10/18/2025	2.1			Result Below Action Level Continue O&M
EUFS-0122	Nurses Office Men's Bathroom	1016C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0135	Boys Bathroom Across Room 126	1036	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0136	Boys Bathroom Across Room 126	1036	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0137	Boys Bathroom Across Room 126	1036	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0138	Boys Bathroom Across Room 126	1036	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0139	Boys Bathroom Across Room 126	1036	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0140	Boys Bathroom Across Room 126	1036	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0142	Girls Bathroom	1038	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0143	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0144	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0145	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0146	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0147	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0148	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0151	Cafeteria	1051	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0152	Cafeteria	1051	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0155	Girls Locker Room Coach Office Bathroom	1052A1A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0156	Girls Locker Room	1052A1A	Water Fountain-No Chiller	RFI	10/18/2025	14.4			Outlet Permanently Removed from Service
EUFS-0157	Girls Locker Room Bathroom Area	1052B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0159	Women's Bathroom Across Gym	1054	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0161	Women's Bathroom Across Gym	1054	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0162	Women's Bathroom Across Gym	1054	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0163	Corridor From Nurses Office To Boys Locker Room	1050	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0165	Men's Bathroom Across Gym	1055	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0166	Men's Bathroom Across Gym	1055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0167	Men's Bathroom Across Gym	1055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0168	Men's Bathroom Across Gym	1055	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0169	Boys Locker Room Vestibule	1056	Bottle Fill Station	Applicable	10/18/2025	OOS			Testing Required Before Return to Service
EUFS-0170	Boys Locker Room Vestibule	1056	Water Fountain-No Chiller	Applicable	10/18/2025	OOS			Testing Required Before Return to Service
EUFS-0171	Boys Locker Room PE Office Bathroom	1056A6A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0172	Boys Locker Room	1056A	Water Fountain-No Chiller	RFI	10/18/2025	5.3			Outlet Permanently Removed from Service
EUFS-0173	Boys Locker Room Bathroom	1056A5	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0174	Boys Locker Room Bathroom	1056A5	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0177	Kitchen	1059	Kitchen Faucet (Cold)	Applicable	10/18/2025	1.7			Result Below Action Level Continue O&M
EUFS-0178	Kitchen	1059	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0179	Kitchen	1059	Spray Nozzle	Applicable	10/18/2025	1.1			Result Below Action Level Continue O&M
EUFS-0180	Kitchen	1059	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0181	Kitchen	1059	Kitchen Faucet (Cold)	Applicable	10/18/2025	4.7			Result Below Action Level Continue O&M
EUFS-0182	Kitchen	1059	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0183	Kitchen	1059	Kitchen Faucet (Cold)	Applicable	10/18/2025	40.7	12/16/2025	14.4	Removed From Service, Pending Remediation
EUFS-0184	Kitchen	1059	Kitchen Faucet (Cold)	Applicable	10/18/2025	1.2			Result Below Action Level Continue O&M
EUFS-0185	Kitchen Dishwashing Room	1059C	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0186	Kitchen Dishwashing Room	1059C	Spray Nozzle	Applicable	10/18/2025	4.6			Result Below Action Level Continue O&M
EUFS-0187	Kitchen Dishwashing Room	1059C	Kitchen Faucet (Cold)	Applicable	10/18/2025	1.3			Result Below Action Level Continue O&M
EUFS-0188	Kitchen Dishwashing Room	1059C	Kitchen Service Area	Applicable	10/18/2025	159	12/16/2025	<1.0	Result Below Action Level Continue O&M
EUFS-0189	Teachers Room Bathroom	1059D1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0190	Teachers Room Bathroom	1059D1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0192	Shop Vestibule Weight Room	1063A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0193	Shop Vestibule Weight Room	1063A	Ice Machine	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0200	Music Suite Boys Bathroom	1069A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0201	Music Suite Girls Bathroom	1069B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0203	Men's Faculty Bathroom	1074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0204	Men's Faculty Bathroom	1074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0205	Men's Faculty Bathroom	1074	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0206	Ladies Faculty Bathroom	1073	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0207	Ladies Faculty Bathroom	1073	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0211	Courtyard Adjacent Classrooms	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0212	Men's Faculty Bathroom	2003	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0213	Custodial Closet	2004	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0215	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0216	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0217	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0218	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0219	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0220	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0221	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0222	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0223	Room 246	2008	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0224	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0225	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0226	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0227	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0228	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0229	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0230	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0231	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0232	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0233	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0234	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0235	Room 246	2008	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0236	Room 246	2008	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0237	Room 246 Science Prep Room	2008A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0238	Storage Room Adjacent Room 246 Back Room	2010A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0240	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0241	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0242	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0243	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0244	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0245	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0246	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0247	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0248	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0249	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0250	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0251	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0252	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0253	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0254	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0255	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0256	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0257	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0258	Room 240	2012	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0259	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0260	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0261	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0262	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0263	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0264	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0265	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0266	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0267	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0268	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0269	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0270	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0271	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0272	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0274	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0275	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0276	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0277	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0278	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0280	Room 240 Prep Room	2012A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0281	Room 236	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0282	Room 236	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0283	Room 236	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0284	Room 236	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0285	Room 236	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0286	Room 236	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0287	Room 236	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0288	Room 236	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0289	Room 236	2014	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0290	Room 236 Greenhouse	2014A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0297	Room 234	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0298	Room 234	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0299	Room 234	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0300	Room 234	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0301	Room 234	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0302	Room 234	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0303	Room 234	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0304	Room 234	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0305	Room 234	2018	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0306	Room 230	2020	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0307	Room 230	2020	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0308	Room 230	2020	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0309	Room 230	2020	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0310	Room 230	2020	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0311	Room 230	2020	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0312	Room 230	2020	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0313	Room 230	2020	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0314	Room 230	2020	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0322	Room 228A/Lab	2024A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0325	Boys Bathroom	2028	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0326	Boys Bathroom	2028	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0327	Boys Bathroom	2028	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0328	Boys Bathroom	2028	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0329	Boys Bathroom	2028	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0330	Custodial Closet	2029	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0331	Women's Bathroom	2030	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0332	Women's Bathroom	2030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0333	Women's Bathroom	2030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0334	Women's Bathroom	2030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0335	Women's Bathroom	2030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0336	Women's Bathroom	2030	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0337		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0338		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0339		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0341		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0342		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0343		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0755	Room 138	1019	Home Economics Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0756	Room 138	1019	Home Economics Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0757	Room 138	1019	Home Economics Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0758	Room 138	1019	Home Economics Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0759	Room 138	1019	Home Economics Faucet (Cold)	Applicable	10/18/2025	2.3			Result Below Action Level Continue O&M
EUFS-0760	Nurses Office Interior Vestibule Women's Bathroom	1016B2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0761	Cafeteria	1051	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0762	Cafeteria	1051	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0855	Main Office Kitchenette	1012A	Spray Nozzle	Applicable	10/18/2025	1.9			Result Below Action Level Continue O&M
EUFS-0856	Guidance Office Suite	1015	Kitchen Faucet (Cold)	Applicable	10/18/2025	2.7			Result Below Action Level Continue O&M
EUFS-0857	Corridor Between Rooms 119 & 130	1047	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0858	Corridor Between Rooms 119 & 130	1047	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0859	Boys Bathroom Across Room 126	1036	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0860	Custodial Closet	1037	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0861	Women's Bathroom Across Gym	1054	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0862	Girls Locker Room Bathroom Area	1052B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0863	Custodial Closet	1057	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0864	Refuse Room	1058	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0865	Teachers Room	1075	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0866	Teachers Room	1075	Spray Nozzle	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0867	Shop Vestibule Shop B	1063B	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0868	Shop Vestibule Shop B	1063B	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0869	Shop C	1068	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0870	Shop C	1068	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0871	Shop C	1068	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0872	Custodial Closet	1070	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0873	Courtyard Adjacent Cafeteria	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0874	Room 242	2011	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0875	Room 242	2011	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0876	Room 240	2012	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0883	Room 233	2017	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0884	Room 234	2018	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0885	Room 231	2021	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0886	Room 231	2021	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0887	Room 231	2021	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0888	Room 231	2021	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0889	Corridor Between Room 228 & Elevator	2042	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0890	Corridor Between Room 228 & Elevator	2042	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0891		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0913	Corridor From Chorus Room To Lobby	1077	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0914	Corridor From Chorus Room To Lobby	1077	Water Fountain-No Chiller	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0915	Corridor From Chorus Room To Lobby	1077	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0916	Room 233	2017	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0917	Room 233	2017	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

John Glenn High School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0918	Room 233	2017	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0919	Room 233	2017	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0920	Room 233	2017	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0921	Room 233	2017	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0922	Room 233	2017	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0924	Faculty Women's Bathroom	2005	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0925	Room 246	2008	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0926	Room 242	2011	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use

James H. Boyd Intermediate School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0344	Basement 308	0001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0347	Room 307	0002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0348	Gym PE Office Bathroom	0003B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0349	Room 306	0004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0352	Room 305	0005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0354	Boiler Room	0006B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0355	Boiler Room	0006B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0356	Boys Locker Room	0007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0357	Boys Locker Room	0007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0358	Boys Locker Room	0007	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0360	Storage Room	0009	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0361	Girls Locker Room	0010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0362	Girls Locker Room	0010	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0363	Girls Locker Room	0010	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0364	Corridor Room 311 to 313	0016	Water Fountain-No Chiller	Applicable	10/18/2025	1.5			Result Below Action Level Continue O&M
EUFS-0365	Room 311	0012	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0367	Room 312	0013	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0370	Room 313	0014	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0371	Room 201	1001	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0373	Room 202	1002	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

James H. Boyd Intermediate School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0375	Room 203	1003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0377	Room 204	1004	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0379	Room 205	1005	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0381	Room 206	1006	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0383	Boys Bathroom	1007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0384	Boys Bathroom	1007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0385	Boys Bathroom	1007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0388	Girls Bathroom	1009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0389	Girls Bathroom	1009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0393	Women's Bathroom	1013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0394	Women's Bathroom	1013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0395	Art Room 112	1019	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0396	Storage/ Old Boiler Room Bathroom	1020A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0397	Faculty Room 110	1021	Kitchen Faucet (Cold)	Applicable	10/18/2025	8.3	11/22/2025	2.4	Result Below Action Level Continue O&M
EUFS-0398	Room 99	1024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0400	Room 99	1024	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0402	Room 99 Bathroom	1024A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0404	New Nurses Office	1025	Nurse's Office Sink	Applicable	10/18/2025	1.6			Result Below Action Level Continue O&M
EUFS-0407	Room 101	1026	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0411	Room 103	1028	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

James H. Boyd Intermediate School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0413	Room 104	1029	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0415	Room 105	1030	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0417	Room 106	1031	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0419	Room 107	1032	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0421	Room 108	1033	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0423	Room 109	1034	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0425	Boys Bathroom	1036	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0426	Boys Bathroom	1036	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0428	Boys Bathroom	1036	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0429	Custodial Closet	1037	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0431	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0432	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0433	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0435	Room 111	1039	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0438	Room 113	1041	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0440	Room 115	1042	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0442	Room 117	1044	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0446	Corridor Between Storage Closet & Kitchen	1055	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0447	Corridor Between Storage Closet & Kitchen	1055	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0448	Gender Neutral Bathroom	1052	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

James H. Boyd Intermediate School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0449	Unisex Bathroom	1053	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0450	Kitchen	1054	Hand Wash Only	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0451	Kitchen	1054	Spray Nozzle	Applicable	10/18/2025	3.0			Result Below Action Level Continue O&M
EUFS-0452	Kitchen	1054	Hand Wash Only	Applicable	10/18/2025	8.5	11/22/2025	<1.0	Result Below Action Level Continue O&M
EUFS-0453	Kitchen	1054	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0454	Kitchen	1054	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0455	Kitchen	1054	Spray Nozzle	Applicable	10/18/2025	1.7			Result Below Action Level Continue O&M
EUFS-0456	Kitchen	1054	Kitchen Faucet (Cold)	Applicable	10/18/2025	1.0			Result Below Action Level Continue O&M
EUFS-0457	Kitchen	1054	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0458	Kitchen	1054	Spray Nozzle	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0459	Kitchen	1054	Pasta Pot/Steam Kettle	RFI	10/18/2025	25.0			Outlet Permanently Removed from Service
EUFS-0460	Vestibule Between Kitchen & Boiler Room	1054A	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0462	Mens Bathroom	1044B	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0463	Mens Bathroom	1044B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0464	Mens Bathroom	1044B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0465	Custodial Closet	1044C	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0466	Womens Bathroom	1044D	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0467	Womens Bathroom	1044D	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0468	Womens Bathroom	1044D	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0470	Room 409	1056	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

James H. Boyd Intermediate School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0473	Room 410	1058	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0474	Room 412	1060	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0477	Room 413	1061	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0478	Girls Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0479	Girls Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0480	Girls Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0481	Girls Bathroom	1063	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0482	Girls Bathroom	1063	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0484	Women's Bathroom	1065	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0485	Women's Bathroom	1065	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0486	Custodial Closet	1066	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0487	Men's Bathroom	1067	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0488	Men's Bathroom	1067	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0490	Boys Bathroom	1078	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0491	Boys Bathroom	1078	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0492	Boys Bathroom	1078	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0493	Boys Bathroom	1078	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0495	Room 408	1070	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0498	Room 407	1071	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0499	Room 405	1073	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

James H. Boyd Intermediate School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0503	Room 404	1074	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0504	Courtyard (Right)	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0505	Main Corridor Adjacent Auditorium	1044A	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0506	Courtyard (Left)	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0515		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0769	Men's Bathroom Across Room 208	1011	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0770	Room 102	1027	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0771	Conference Room	1049	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0772	Conference Room Bathroom	1049B	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0774	Corridor Between Boiler Room & Room 308	0018	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0775	Corridor Between Boiler Room & Room 308	0018	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0777	Custodial Closet	1008	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0778	Girls Bathroom	1009	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0779	Boys Bathroom	1036	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0780	Girls Bathroom	1038	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0781	All Purpose Room	1040	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0782	All Purpose Room	1040	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0783	Boys Bathroom	1078	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0784		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0785		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use

James H. Boyd Intermediate School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0786		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0787		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0788		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0850		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0851		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0852		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0853		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0854		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0944	Nurses Office Bathroom	1025B	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0945	Faculty Bathroom	0008	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0518	Boiler Room	1001F	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0519	Receiving Room Custodial Closet	1001E	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0520	Kitchen	1003	Kitchen Faucet (Cold)	Applicable	10/18/2025	1.3			Result Below Action Level Continue O&M
EUFS-0521	Kitchen	1003	Spray Nozzle	Applicable	10/18/2025	2.2			Result Below Action Level Continue O&M
EUFS-0522	Kitchen	1003	Kitchen Faucet (Cold)	Applicable	10/18/2025	2.1			Result Below Action Level Continue O&M
EUFS-0523	Kitchen	1003	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0524	Kitchen	1003	Pasta Pot/Steam Kettle	Applicable	10/18/2025	24.9	12/16/2025	3.5	Result Below Action Level Continue O&M
EUFS-0525	Kitchen	1003	Kitchen Faucet (Cold)	Applicable	10/18/2025	5.2	11/22/2025	<1.0	Result Below Action Level Continue O&M
EUFS-0526	Kitchen	1003	Spray Nozzle	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0527	Kitchen	1003	Kitchen Faucet (Cold)	Applicable	10/18/2025	1.2			Result Below Action Level Continue O&M
EUFS-0528	Kitchen	1003	Spray Nozzle	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0530	Kitchen Custodial Closet	1003B	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0531	Kitchen Bathroom	1003A	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0536	Boys Bathroom	1007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0537	Boys Bathroom	1007	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0538	Boys Bathroom	1007	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0539	Girls Bathroom	1008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0540	Girls Bathroom	1008	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0541	Girls Bathroom	1008	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0558	Womens Faculty Bathroom	1013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0559	Womens Faculty Bathroom	1013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0560	Womens Faculty Bathroom	1013	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0567	Custodial Closet	1015	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0568	Mens Faculty Bathroom	1016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0569	Mens Faculty Bathroom	1016	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0570	Technology Room A	1018	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0571	Technology Room A	1018	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0572	Technology Room B	1019	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0573	Technology Room B	1019	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0575	Boys Bathroom	1031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0576	Boys Bathroom	1031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0577	Boys Bathroom	1031	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0578	Custodial Closet	1032	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0580	Faculty Room	1045	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0582	Women's Bathroom Across Superintendent Office	1055	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0583	Women's Bathroom Across Superintendent Office	1055	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0584	Men's Bathroom	1057	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0585	Men's Bathroom	1057	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0586	Men's Bathroom	1057	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0587	Custodial Closet	1056	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0590	Main Office Mail Room	1069B	Kitchen Faucet (Cold)	Applicable	10/18/2025	1.8			Result Below Action Level Continue O&M
EUFS-0592	Main Office Bathroom	1069D	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0605	Women's Faculty Bathroom	1081	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0606	Women's Faculty Bathroom	1081	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0607	Girls Bathroom	1082	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0608	Girls Bathroom	1082	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0609	Girls Bathroom	1082	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0610	Corridor Between Auditorium & Guidance Office	1087	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0612	Men's Faculty Bathroom	1084	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0613	Men's Faculty Bathroom	1084	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0614	Teachers Workroom Across Room 201(Language)	2003	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0615	Library Kitchen	2015A	Kitchen Faucet (Cold)	Applicable	10/18/2025	24.8	12/16/2025	<1.0	Result Below Action Level Continue O&M
EUFS-0616	Teachers Workroom Adjacent R C	2027	Kitchen Faucet (Cold)	Applicable	10/18/2025	5.4	12/16/2025	<1.0	Result Below Action Level Continue O&M
EUFS-0617	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0618	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0619	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0623	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0632	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0634	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0637	Room 216 Prep Room	2028A	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0638	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0642	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0643	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0644	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0655	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0656	Room 217	2029	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0657	Room 218	2030	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0658	Room 219	2033	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0659	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0660	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0661	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0662	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0663	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0664	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0665	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0666	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0667	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0668	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0669	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0670	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0671	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0672	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0673	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0674	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0675	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0676	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0677	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0678	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0679	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0680	Room 220	2034	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0681	Science Prep Room	2035	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0682	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0683	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0684	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0685	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0686	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0687	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0688	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0689	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0690	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0691	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0692	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0693	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0695	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0697	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0698	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0699	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0701	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0702	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0703	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0704	Faculty Men's Bathroom	2039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0705	Faculty Men's Bathroom	2039	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0708	Faculty Women's Bathroom	2040	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0709	Faculty Women's Bathroom	2040	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0713	Custodial Closet	2042	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0714	Boys Bathroom	2043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0715	Boys Bathroom	2043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0716	Boys Bathroom	2043	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0717	Girls Bathroom	2048	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0718	Girls Bathroom	2048	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0719	Girls Bathroom	2048	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0720	Girls Bathroom	2048	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0721	Custodial Closet	2049	Slop Sink	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0725	Courtyard	Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0731		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0747	Home Economics Room 101	1073	Home Economics Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0748	Home Economics Room 101	1073	Home Economics Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0749	Home Economics Room 101	1073	Home Economics Faucet (Cold)	Applicable	10/18/2025	1.1			Result Below Action Level Continue O&M
EUFS-0750	Home Economics Room 101	1073	Home Economics Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0751	Home Economics Room 101	1073	Home Economics Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0752	Home Economics Room 101	1073	Home Economics Faucet (Cold)	Applicable	10/18/2025	6.7	11/22/2025	<1.0	Result Below Action Level Continue O&M
EUFS-0753	Prep Room Between Rooms 101 & 102	1073A	Classroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0754	Room 102	1074	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0789	Cafeteria	1004	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0790	Cafeteria	1004	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0791	Teachers Room	1005	Kitchen Faucet (Cold)	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0792	Boys Locker Room Coach Office Bathroom	1009B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0793	Boys Locker Room Bathroom	1009A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0794	Boys Locker Room Bathroom	1009A2	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0795	Boys Locker Room	1009A2	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0796	Boys Locker Room	1009A2	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0797	Art Room E	1011	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0798	Art Room E	1011	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0799	Art Room E	1011	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0800	Art Room E	1011	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0801	Art Room E	1011	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0802	Art Room E	1011	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0803	Girls Coach Office Bathroom	1012B1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0804	Girls Locker Room Bathroom	1012C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0805	Girls Locker Room Bathroom	1012C	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0806	Girls Locker Room	1012C	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0807	Girls Locker Room	1012C	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0808	Art Room D	1014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0809	Art Room D	1014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0810	Art Room D	1014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0811	Art Room D	1014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0812	Art Room D	1014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0813	Art Room D	1014	Art Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0814	Main Office Hall	1069H	Water Cooler	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0815	Main Office Hall	1069H	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0816	Nurse Office	1070A	Nurse's Office Sink	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0817	Nurse Office Bathroom	1070A1	Bathroom Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0818	Prep Room Between Rooms 101 & 102	1073A	Washing Machine	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0819	Corridor Between Auditorium & Guidance Office	1087	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0822	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0827	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0828	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0829	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0830	Room 216	2028	Spray Nozzle	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0831	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0832	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0833	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0834	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0835	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0837	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0838	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0840	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0841	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0842	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0843	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0844	Girls Bathroom	2041	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0845	Girls Bathroom	2041	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0846	Girls Bathroom	2041	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0847	Boys Bathroom	2050	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0848	Boys Bathroom	2050	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0849	Boys Bathroom	2050	Tempered Water Outlet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0892		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0893		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0894		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0895		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0896		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0897		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0898		Exterior	Hose Bib	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0927	Corridor Between Room 119 & Lobby	1063	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M
EUFS-0928	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0929	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0930	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0931	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0932	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0933	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use

Elwood Middle School

Outlet Number	Room Name	Space ID	Outlet Type	Applicable/ Non-Applicable/ RFI	Initial Sample Date	Initial Result (ppb)	Post Remediation Sample Date	Post Remediation Result (ppb)	Remediation Actions/Current Status
EUFS-0934	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0935	Room 216	2028	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0936	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0937	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0938	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0939	Room 217	2029	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0940	Room 220	2034	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0941	Room 221	2036	Science Faucet	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0942	Room 221	2036	Eye Wash	Non-Applicable					Placarded for Non-Drinking Use
EUFS-0943	Corridor from Teachers Room to Library	2052	Bottle Fill Station	Applicable	10/18/2025	<1.00 ND			Result Below Action Level Continue O&M

Attachment 3:

Laboratory Analytical Reports

J.C. Broderick & Associates, Inc.


Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building:

Harley Avenue Primary School

HAPS

ED56723

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSID-0005	KI	1003	Kitchen	HW	10/18/2025	8:12:00 AM
EUFSID-0006	KI	1003	Kitchen	KC	10/18/2025	8:13:00 AM
EUFSID-0007	KI	1003	Kitchen	SN	10/18/2025	8:14:00 AM
EUFSID-0008	KI	1003	Kitchen	SA	10/18/2025	8:14:00 AM
EUFSID-0009	KI	1003	Kitchen	KC	10/18/2025	8:11:00 AM
EUFSID-0765	NO	1024A	Nurse Room	NS	10/18/2025	8:21:00 AM
EUFSID-0767	CA	1019	Cafeteria	WF	10/18/2025	8:16:00 AM
EUFSID-0768	CA	1019	Cafeteria	WC	10/18/2025	8:16:00 AM
EUFSID-0899	FL	1011	Faculty Room	KC	10/18/2025	8:17:00 AM
EUFSID-0904	HA	1029	Corridor Between Faculty Room & Room 182	WF	10/18/2025	8:19:00 AM
EUFSID-0905	HA	1029	Corridor Between Faculty Room & Room 182	WC	10/18/2025	8:19:00 AM
EUFSID-0906	OF	1043	Mail Room	KC	10/18/2025	8:20:00 AM
EUFSID-0909	HA	2023	Corridor From Art Storage To Room 201	WC	10/18/2025	8:23:00 AM
EUFSID-0910	HA	2023	Corridor From Art Storage To Room 201	WF	10/18/2025	8:23:00 AM

RECEIVED

Samples Submitted 14

Carle Place, NY

OCT 23 25, PM02:47



Building Address

30 Harley avenue
Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received: S. Cherofsky 10/23/25

Signature: S. Chung 2:47 PM

Samplers Name: Andrew Schneck

Samplers Signature: [Signature]

JCB Project Manager: George Greve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556723

LIMS Reference ID: ED56723

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894, Elwood Union Free School District, Harley
Avenue Primary School, 30 Harley Avenue Elwood,
NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:47

Reported:

11/07/2025 08:46

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFDS-0005 Lims Reference ID: ED56723-01 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	15.5		1	1.0	µg/L	10/28/25 14:06	10/28/25 14:06	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0006 Lims Reference ID: ED56723-02 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	2.4		1	1.0	µg/L	10/28/25 14:08	10/28/25 14:08	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0007 Lims Reference ID: ED56723-03 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	7.2		1	1.0	µg/L	10/28/25 14:11	10/28/25 14:11	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0008 Lims Reference ID: ED56723-04 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:13	10/28/25 14:13	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0009 Lims Reference ID: ED56723-05 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	3.5		1	1.0	µg/L	10/28/25 14:14	10/28/25 14:14	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0765 Lims Reference ID: ED56723-06 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:15	10/28/25 14:15	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0767 Lims Reference ID: ED56723-07 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:17	10/28/25 14:17	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0768 Lims Reference ID: ED56723-08 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:18	10/28/25 14:18	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0899 Lims Reference ID: ED56723-09 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556723

LIMS Reference ID: ED56723

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 23-53894, Elwood Union Free School District, Harley Avenue Primary School, 30 Harley Avenue Elwood, NY 11731

Project ID: _06 - Carle Place Lead Analyses

Customer PO:

Sales Rep: Jeromy Bish

Received: 10/23/2025 14:47

Reported: 11/07/2025 08:46

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFDS-0899 (Continued) Lims Reference ID: ED56723-09 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals (Continued)									
Lead	1.1		1	1.0	µg/L	10/28/25 14:19	10/28/25 14:19	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0904 Lims Reference ID: ED56723-10 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:30	10/28/25 14:30	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0905 Lims Reference ID: ED56723-11 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:34	10/28/25 14:34	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0906 Lims Reference ID: ED56723-12 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	2.9		1	1.0	µg/L	10/28/25 14:35	10/28/25 14:35	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0909 Lims Reference ID: ED56723-13 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:36	10/28/25 14:36	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFDS-0910 Lims Reference ID: ED56723-14 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:38	10/28/25 14:38	JH	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556723**LIMS Reference ID:** ED56723**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894, Elwood Union Free School District, Harley
Avenue Primary School, 30 Harley Avenue Elwood,
NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:47

Reported:

11/07/2025 08:46

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062556723**LIMS Reference ID:** ED56723**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894, Elwood Union Free School District, Harley
Avenue Primary School, 30 Harley Avenue Elwood,
NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:47

Reported:

11/07/2025 08:46


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building:

Harley Avenue Primary School

HAPS

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

ED57337

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSO-0005	KI	1003	Kitchen	HW	11/22/2025	8:35:00 AM
EUFSO-0007	KI	1003	Kitchen	SN	11/22/2025	8:37:00 AM

Samples Submitted 2



RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
NOV 22 25, AM 10:27

Pb 200.8
Kathleen
11/26/25

Building Address

30 Harley avenue

Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Sem Cell
11/22/25
10:27 AM

Samplers Name: Andy Carbajal

Samplers Signature: Andy Carbajal

JCB Project Manager: George Green

Page 4 of 4

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557337**LIMS Reference ID:** ED57337**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

30 Harley Avenue Elwood NY 11731, Harley Avenue
Primary School, Project#:23-53894, Elwood Union
Free School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:27

Reported:

11/29/2025 14:27

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD - 0005 Lims Reference ID: ED57337-01 Matrix: Drinking Water Sampled: 11/22/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	11/26/25 14:40	11/26/25 14:40	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD - 0007 Lims Reference ID: ED57337-02 Matrix: Drinking Water Sampled: 11/22/25 00:00:00									
Metals									
Lead	5.5		1	1.0	µg/L	11/26/25 14:41	11/26/25 14:41	KT1	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557337

LIMS Reference ID: ED57337

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

30 Harley Avenue Elwood NY 11731, Harley Avenue
Primary School, Project#:23-53894, Elwood Union
Free School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:27

Reported:

11/29/2025 14:27

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557337**LIMS Reference ID:** ED57337**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

30 Harley Avenue Elwood NY 11731, Harley Avenue
Primary School, Project#:23-53894, Elwood Union
Free School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:27

Reported:

11/29/2025 14:27


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

ED57739

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building:

Harley Avenue Primary School

HAPS

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFS-0007	KI	1003	Kitchen	SN	12/16/2025	7:04:00 AM

Samples Submitted 1



Pb 200.8 Bp/long 12/17/25

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
DEC 16 25, PM 01:49

Building Address

30 Harley avenue

Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received:

DAVID WARTON

Signature:

David Warton

12/16/25

1:49 PM

Samplers Name:

Andy Carbatw

Samplers Signature:

Andy Carbatw

JCB Project Manager:

George Greve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557739**LIMS Reference ID:** ED57739**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894 / Elwood Union Free School District /
Harley Avenue Primary School HAPS / 30 Harley
Avenue, Elwood, NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/16/2025 13:49

Reported:

12/17/2025 15:00

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD-0007									
Lims Reference ID: ED57739-01 Matrix: Drinking Water									
Sampled: 12/16/25 00:00:00									
Metals									
Lead	2.6		1	1.0	µg/L	12/17/25 13:14	12/17/25 13:14	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557739**LIMS Reference ID:** ED57739**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894 / Elwood Union Free School District /
Harley Avenue Primary School HAPS / 30 Harley
Avenue, Elwood, NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/16/2025 13:49

Reported:

12/17/2025 15:00

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062557739**LIMS Reference ID:** ED57739**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894 / Elwood Union Free School District /
Harley Avenue Primary School HAPS / 30 Harley
Avenue, Elwood, NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/16/2025 13:49

Reported:

12/17/2025 15:00


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53894
Building: John Glenn High School
JGHS

ED 56725

Client:
Elwood Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSD-0117	OF	1012A	Main Office Kitchenette	KC	10/18/2025	6:31:00 AM
EUFSD-0120	NO	1016A	Nurses Office	NS	10/18/2025	6:27:00 AM
EUFSD-0151	CA	1051	Cafeteria	WF	10/18/2025	6:35:00 AM
EUFSD-0152	CA	1051	Cafeteria	WC	10/18/2025	6:36:00 AM
EUFSD-0156	LR	1052A1A	Girls Locker Room	DW	10/18/2025	6:39:00 AM
EUFSD-0163	HA	1050	Corridor From Nurses Office To Boys Locker Room	WF	10/18/2025	6:19:00 AM
EUFSD-0172	LR	1056A	Boys Locker Room	DW	10/18/2025	6:42:00 AM
EUFSD-0177	KI	1059	Kitchen	KC	10/18/2025	6:09:00 AM
EUFSD-0178	KI	1059	Kitchen	KC	10/18/2025	6:07:00 AM
EUFSD-0179	KI	1059	Kitchen	SN	10/18/2025	6:07:00 AM
EUFSD-0180	KI	1059	Kitchen	KC	10/18/2025	6:08:00 AM
EUFSD-0181	KI	1059	Kitchen	KC	10/18/2025	6:08:00 AM
EUFSD-0182	KI	1059	Kitchen	KC	10/18/2025	6:09:00 AM
EUFSD-0183	KI	1059	Kitchen	KC	10/18/2025	6:10:00 AM
EUFSD-0184	KI	1059	Kitchen	KC	10/18/2025	6:10:00 AM
EUFSD-0185	KI	1059C	Kitchen Dishwashing Room	KC	10/18/2025	6:12:00 AM
EUFSD-0186	KI	1059C	Kitchen Dishwashing Room	SN	10/18/2025	6:13:00 AM
EUFSD-0187	KI	1059C	Kitchen Dishwashing Room	KC	10/18/2025	6:12:00 AM

RECEIVED
ENSL ANALYTICAL, INC.
Carle Place, NY
OCT 23 25, PM 02:46

Building Address

478 Elwood Road
Elwood, NY 11731



Analysis Type: ELAP 200.5

Lab Recieved: Sean Gull 10/23/25 2:46 PM


Signature: M. Gull

Samplers Name: Andrew Schreck

Samplers Signature: Andrew Schreck

JCB Project Manager: George Greve

Pb 200.8
Kathleen 10/31/25



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53894
Building: John Glenn High School
JGHS

E D 56725

Client:
Elwood Union Free School District

Retest/New Install ☒
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSD-0188	KI	1059C	Kitchen Dishwashing Room	SA	10/18/2025	6:14:00 AM
EUFSD-0193	SP	1063A	Shop Vestibule Weight Room	IM	10/18/2025	6:17:00 AM
EUFSD-0755	HE	1019	Room 138	EC	10/18/2025	6:23:00 AM
EUFSD-0756	HE	1019	Room 138	EC	10/18/2025	6:21:00 AM
EUFSD-0757	HE	1019	Room 138	EC	10/18/2025	6:22:00 AM
EUFSD-0758	HE	1019	Room 138	EC	10/18/2025	6:22:00 AM
EUFSD-0759	HE	1019	Room 138	EC	10/18/2025	6:21:00 AM
EUFSD-0761	CA	1051	Cafeteria	WF	10/18/2025	6:37:00 AM
EUFSD-0762	CA	1051	Cafeteria	WC	10/18/2025	6:38:00 AM
EUFSD-0855	KC	1012A	Main Office Kitchenette	SN	10/18/2025	6:31:00 AM
EUFSD-0856	KC	1015	Guidance Office Suite	KC	10/18/2025	6:30:00 AM
EUFSD-0857	HA	1047	Corridor Between Rooms 119 & 130	WC	10/18/2025	6:24:00 AM
EUFSD-0858	HA	1047	Corridor Between Rooms 119 & 130	WF	10/18/2025	6:24:00 AM
EUFSD-0865	FL	1075	Teachers Room	KC	10/18/2025	6:36:00 AM
EUFSD-0866	FL	1075	Teachers Room	SN	10/18/2025	6:36:00 AM
EUFSD-0889	HA	2042	Corridor Between Room 228 & Elevator	WC	10/18/2025	6:25:00 AM
EUFSD-0890	HA	2042	Corridor Between Room 228 & Elevator	WF	10/18/2025	6:25:00 AM
EUFSD-0913	HA	1077	Corridor From Chorus Room To Lobby	WF	10/18/2025	6:25:00 AM

RECEIVED
ENSL ANALYTICAL, INC.
Carle Place, NY
OCT 23 25, PM 2:47

Building Address

478 Elwood Road
Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received: Sean Gull 10/23/25 2:47 PM


Signature: M Gull

Samplers Name: Andrew Schuck

Samplers Signature: Andrew Schuck

JCB Project Manager: George Greve

Pb200.5
Kathleen 10/31/25



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building: John Glenn High School

JGHS

ED56725

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSO-0914	HA	1077	Corridor From Chorus Room To Lobby	DW	10/18/2025	6:33:00 AM
EUFSO-0915	HA	1077	Corridor From Chorus Room To Lobby	WF	10/18/2025	6:33:00 AM

Samples Submitted 38

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
OCT 23 25, PM 02:47

Building Address

478 Elwood Road

Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received: Sean Cull 10/23/25 2:47 PM

Signature: [Signature]

Samplers Name: Andrew Schreck

Samplers Signature: [Signature]

JCB Project Manager: George Greve

Pb 200.8
Kathleen 10/31/25

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556725

LIMS Reference ID: ED56725

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

John Glenn High School, Elwood Union Free School
District, 478 Elwood Road Elwood NY 11731,
23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:46

Reported:

11/07/2025 08:47

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD-0117 Lims Reference ID: ED56725-01 Matrix: Drinking Water Sampled: 10/18/25 06:31:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 16:33	10/31/25 16:33	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0120 Lims Reference ID: ED56725-02 Matrix: Drinking Water Sampled: 10/18/25 06:27:00									
Metals									
Lead	2.1		1	1.0	µg/L	10/31/25 16:36	10/31/25 16:36	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0151 Lims Reference ID: ED56725-03 Matrix: Drinking Water Sampled: 10/18/25 06:35:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 16:38	10/31/25 16:38	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0152 Lims Reference ID: ED56725-04 Matrix: Drinking Water Sampled: 10/18/25 06:36:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 16:39	10/31/25 16:39	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0156 Lims Reference ID: ED56725-05 Matrix: Drinking Water Sampled: 10/18/25 06:39:00									
Metals									
Lead	14.4		1	1.0	µg/L	10/31/25 16:43	10/31/25 16:43	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0163 Lims Reference ID: ED56725-06 Matrix: Drinking Water Sampled: 10/18/25 06:19:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 16:44	10/31/25 16:44	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0172 Lims Reference ID: ED56725-07 Matrix: Drinking Water Sampled: 10/18/25 06:42:00									
Metals									
Lead	5.3		1	1.0	µg/L	10/31/25 16:45	10/31/25 16:45	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0177 Lims Reference ID: ED56725-08 Matrix: Drinking Water Sampled: 10/18/25 06:09:00									
Metals									
Lead	1.7		1	1.0	µg/L	10/31/25 16:47	10/31/25 16:47	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0178 Lims Reference ID: ED56725-09 Matrix: Drinking Water Sampled: 10/18/25 06:07:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556725

LIMS Reference ID: ED56725

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

John Glenn High School, Elwood Union Free School
District, 478 Elwood Road Elwood NY 11731,
23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:46

Reported:

11/07/2025 08:47

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: EUFSD-0178 (Continued)

Lims Reference ID: ED56725-09 Matrix: Drinking Water

Sampled: 10/18/25 06:07:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:30	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0179

Lims Reference ID: ED56725-10 Matrix: Drinking Water

Sampled: 10/18/25 06:07:00

Metals

Lead	1.1		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:34	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0180

Lims Reference ID: ED56725-11 Matrix: Drinking Water

Sampled: 10/18/25 06:08:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:35	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0181

Lims Reference ID: ED56725-12 Matrix: Drinking Water

Sampled: 10/18/25 06:08:00

Metals

Lead	4.7		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:36	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0182

Lims Reference ID: ED56725-13 Matrix: Drinking Water

Sampled: 10/18/25 06:09:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:40	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0183

Lims Reference ID: ED56725-14 Matrix: Drinking Water

Sampled: 10/18/25 06:11:00

Metals

Lead	40.7		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:41	KT1	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0184

Lims Reference ID: ED56725-15 Matrix: Drinking Water

Sampled: 10/18/25 06:10:00

Metals

Lead	1.2		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:43	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0185

Lims Reference ID: ED56725-16 Matrix: Drinking Water

Sampled: 10/18/25 06:12:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:44	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0186

Lims Reference ID: ED56725-17 Matrix: Drinking Water

Sampled: 10/18/25 06:13:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556725

LIMS Reference ID: ED56725

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

John Glenn High School, Elwood Union Free School
District, 478 Elwood Road Elwood NY 11731,
23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:46

Reported:

11/07/2025 08:47

**Analytical Results
(Continued)**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD-0186 (Continued) Lims Reference ID: ED56725-17 Matrix: Drinking Water Sampled: 10/18/25 06:13:00									
Metals (Continued)									
Lead	4.6		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:45	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0187 Lims Reference ID: ED56725-18 Matrix: Drinking Water Sampled: 10/18/25 06:12:00									
Metals									
Lead	1.3		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:47	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0188 Lims Reference ID: ED56725-19 Matrix: Drinking Water Sampled: 10/18/25 06:14:00									
Metals									
Lead	159		2	2.0	µg/L	10/31/25 00:00	10/31/25 16:06	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0193 Lims Reference ID: ED56725-20 Matrix: Drinking Water Sampled: 10/18/25 06:17:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:52	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0755 Lims Reference ID: ED56725-21 Matrix: Drinking Water Sampled: 10/18/25 06:23:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:56	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0756 Lims Reference ID: ED56725-22 Matrix: Drinking Water Sampled: 10/18/25 06:21:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:57	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0757 Lims Reference ID: ED56725-23 Matrix: Drinking Water Sampled: 10/18/25 06:22:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 15:58	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0758 Lims Reference ID: ED56725-24 Matrix: Drinking Water Sampled: 10/18/25 06:22:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 16:00	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0759 Lims Reference ID: ED56725-25 Matrix: Drinking Water Sampled: 10/18/25 06:21:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556725

LIMS Reference ID: ED56725

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

John Glenn High School, Elwood Union Free School
District, 478 Elwood Road Elwood NY 11731,
23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:46

Reported:

11/07/2025 08:47

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: EUFSD-0759 (Continued)

Lims Reference ID: ED56725-25 Matrix: Drinking Water

Sampled: 10/18/25 06:21:00

Metals (Continued)

Lead	2.3		1	1.0	µg/L	10/31/25 00:00	10/31/25 16:01	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0761

Lims Reference ID: ED56725-26 Matrix: Drinking Water

Sampled: 10/18/25 06:37:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 16:02	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0762

Lims Reference ID: ED56725-27 Matrix: Drinking Water

Sampled: 10/18/25 06:38:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 16:03	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0855

Lims Reference ID: ED56725-28 Matrix: Drinking Water

Sampled: 10/18/25 06:31:00

Metals

Lead	1.9		1	1.0	µg/L	10/31/25 00:00	10/31/25 16:05	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0856

Lims Reference ID: ED56725-29 Matrix: Drinking Water

Sampled: 10/18/25 06:30:00

Metals

Lead	2.7		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:27	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0857

Lims Reference ID: ED56725-30 Matrix: Drinking Water

Sampled: 10/18/25 06:24:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:28	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0858

Lims Reference ID: ED56725-31 Matrix: Drinking Water

Sampled: 10/18/25 06:24:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:29	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0865

Lims Reference ID: ED56725-32 Matrix: Drinking Water

Sampled: 10/18/25 06:36:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:33	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0866

Lims Reference ID: ED56725-33 Matrix: Drinking Water

Sampled: 10/18/25 06:36:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556725

LIMS Reference ID: ED56725

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

John Glenn High School, Elwood Union Free School
District, 478 Elwood Road Elwood NY 11731,
23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:46

Reported:

11/07/2025 08:47

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD-0866 (Continued) Lims Reference ID: ED56725-33 Matrix: Drinking Water Sampled: 10/18/25 06:36:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:35	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0889 Lims Reference ID: ED56725-34 Matrix: Drinking Water Sampled: 10/18/25 06:25:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:36	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0890 Lims Reference ID: ED56725-35 Matrix: Drinking Water Sampled: 10/18/25 06:25:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:37	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0913 Lims Reference ID: ED56725-36 Matrix: Drinking Water Sampled: 10/18/25 06:33:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:38	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0914 Lims Reference ID: ED56725-37 Matrix: Drinking Water Sampled: 10/18/25 06:33:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:40	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0915 Lims Reference ID: ED56725-38 Matrix: Drinking Water Sampled: 10/18/25 06:33:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 00:00	10/31/25 14:41	KT1	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556725**LIMS Reference ID:** ED56725**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

John Glenn High School, Elwood Union Free School
District, 478 Elwood Road Elwood NY 11731,
23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:46

Reported:

11/07/2025 08:47

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062556725**LIMS Reference ID:** ED56725**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

John Glenn High School, Elwood Union Free School
District, 478 Elwood Road Elwood NY 11731,
23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:46

Reported:

11/07/2025 08:47


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building: John Glenn High School

JGHS

ED 57339

Client:

Elwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSO-0183	KI	1059	Kitchen	KC	11/22/2025	8:21:00 AM
EUFSO-0188	KI	1059C	Kitchen Dishwashing Room	SA	11/22/2025	8:23:00 AM

Samples Submitted 2



RECEIVED
ENSL ANALYTICAL, INC.
Carle Place, NY
NOV 22 25. AM 10:26

NOV 22 25. AM 10

Pb 200.8
Kathleen
11/26/25

Pb 200.8
11/26/25

Building Address

478 Elwood Road

Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Sean Cull
11/22/25
10:26AM

Samplers Name:

Samplers Signature:

JCB Project Manager:

Andy Carballo
George Greve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557339**LIMS Reference ID:** ED57339**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

478 Elwood Road Elwood NY 11731, John Glenn
High School, JCB#23-53894, Elwood Union Free
School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:26

Reported:

11/29/2025 14:19

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: EUFSD - 0183**Lims Reference ID:** ED57339-01 **Matrix:** Drinking Water**Sampled:** 11/22/25 00:00:00**Metals**

Lead	29.7		1	1.0	µg/L	11/26/25 21:57	11/26/25 21:57	DAZ	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD - 0188**Lims Reference ID:** ED57339-02 **Matrix:** Drinking Water**Sampled:** 11/22/25 00:00:00**Metals**

Lead	172		5	5.0	µg/L	11/26/25 22:27	11/26/25 22:27	DAZ	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557339**LIMS Reference ID:** ED57339**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

478 Elwood Road Elwood NY 11731, John Glenn
High School, JCB#23-53894, Elwood Union Free
School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:26

Reported:

11/29/2025 14:19

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557339**LIMS Reference ID:** ED57339**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

478 Elwood Road Elwood NY 11731, John Glenn
High School, JCB#23-53894, Elwood Union Free
School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:26

Reported:

11/29/2025 14:19

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building: John Glenn High School

JGHS

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

ED57740

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFS-0183	KI	1059	Kitchen	KC	12/16/2025	6:50:00 AM
EUFS-0188	KI	1059C	Kitchen Dishwashing Room	SA	12/16/2025	6:53:00 AM

Samples Submitted 2

Courier

200.8 Billing 12/17/25

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
DEC 16 25, PM 01:52

Building Address

478 Elwood Road

Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received: DAVID WHARTON 12/16/25 1:52 PM

Signature: David Wharton

Samplers Name: Andy Carbatu

Samplers Signature: Andy Carbatu

JCB Project Manager: George Greve

Page 4 of 4

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557740**LIMS Reference ID:** ED57740**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894 / Elwood Union Free School District / John
Glenn High School JGHS / 478 Elwood Road,
Elwood, NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeremy Bish

Received:

12/16/2025 13:52

Reported:

12/17/2025 15:05

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: EUFSD-0183**Lims Reference ID:** ED57740-01 **Matrix:** Drinking Water**Sampled:** 12/16/25 00:00:00**Metals**

Lead	14.4		1	1.0	µg/L	12/17/25 13:15	12/17/25 13:15	BP	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	----	--------------------------

Sample: EUFSD-0188**Lims Reference ID:** ED57740-02 **Matrix:** Drinking Water**Sampled:** 12/16/25 00:00:00**Metals**

Lead	< 1.0		1	1.0	µg/L	12/17/25 13:17	12/17/25 13:17	BP	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	----	--------------------------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557740**LIMS Reference ID:** ED57740**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894 / Elwood Union Free School District / John
Glenn High School JGHS / 478 Elwood Road,
Elwood, NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/16/2025 13:52

Reported:

12/17/2025 15:05

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062557740**LIMS Reference ID:** ED57740**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894 / Elwood Union Free School District / John
Glenn High School JGHS / 478 Elwood Road,
Elwood, NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/16/2025 13:52

Reported:

12/17/2025 15:05


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building:

James H. Boyd Intermediate School

JHBIS

Client:

Elwood Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush



Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSD-0364	HA	0016	Corridor Room 311 to 313	DW	10/18/2025	7:58:00 AM
EUFSD-0397	FL	1021	Faculty Room 110	KC	10/18/2025	7:46:00 AM
EUFSD-0404	NO	1025	New Nurses Office	NS	10/18/2025	7:49:00 AM
EUFSD-0446	HA	1055	Corridor Between Storage Closet & Kitchen	WF	10/18/2025	7:36:00 AM
EUFSD-0447	HA	1055	Corridor Between Storage Closet & Kitchen	WC	10/18/2025	7:36:00 AM
EUFSD-0450	KI	1054	Kitchen	HW	10/18/2025	7:38:00 AM
EUFSD-0451	KI	1054	Kitchen	SN	10/18/2025	7:43:00 AM
EUFSD-0452	KI	1054	Kitchen	HW	10/18/2025	7:43:00 AM
EUFSD-0453	KI	1054	Kitchen	KC	10/18/2025	7:41:00 AM
EUFSD-0454	KI	1054	Kitchen	KC	10/18/2025	7:41:00 AM
EUFSD-0455	KI	1054	Kitchen	SN	10/18/2025	7:41:00 AM
EUFSD-0456	KI	1054	Kitchen	KC	10/18/2025	7:38:00 AM
EUFSD-0457	KI	1054	Kitchen	KC	10/18/2025	7:39:00 AM
EUFSD-0458	KI	1054	Kitchen	SN	10/18/2025	7:40:00 AM
EUFSD-0459	KI	1054	Kitchen	PK	10/18/2025	8:02:00 AM
EUFSD-0774	HA	0018	Corridor Between Boiler Room & Room 308	WF	10/18/2025	7:57:00 AM
EUFSD-0775	HA	0018	Corridor Between Boiler Room & Room 308	WC	10/18/2025	7:57:00 AM
EUFSD-0781	CA	1040	All Purpose Room	WC	10/18/2025	7:45:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
OCT 23 25 PM 02:50

Building Address

286 Cuba Hill Road

Huntington, NY 11743

Analysis Type: ELAP 200.5

Lab Received:

Abigail Minnifield

Signature:

A. Minnifield

10/23/25 2:50 pm

Samplers Name:

Andrew Schreck

Samplers Signature:


Andrew Schreck

JCB Project Manager:

George Greve

Pb 200.8
Kathleen 10/31/25

Pb 200.8
JCB 10/28/25



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building: James H. Boyd Intermediate School

JHBIS

ED56727

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFS-0782	CA	1040	All Purpose Room	WF	10/18/2025	7:45:00 AM

Samples Submitted 19

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
OCT 23 25, PM 02:50

Building Address

286 Cuba Hill Road

Huntington, NY 11743

Analysis Type: ELAP 200.5

Lab Received: Abigail Minnick

Signature: A. Minnick
10/23/25 2:50pm

Samplers Name: Andrew Schreck

Samplers Signature: Andrew Schreck

JCB Project Manager: George Greve

Pb 200.8
Kathleen 10/31/25

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556727

LIMS Reference ID: ED56727

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 23-53894 , James H. Boyd Intermediate School ,
JHBIS, Elwood Union Free School District, 286 Cuba
Hill Road, Huntington NY 11743

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 10/23/2025 14:50**Reported:** 11/07/2025 08:45**Analytical Results**

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD- 0364 Lims Reference ID: ED56727-01 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	1.5		1	1.0	µg/L	10/28/25 14:41	10/28/25 14:41	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD- 0397 Lims Reference ID: ED56727-02 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	8.3		1	1.0	µg/L	10/28/25 14:43	10/28/25 14:43	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD- 0404 Lims Reference ID: ED56727-03 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	1.6		1	1.0	µg/L	10/28/25 14:44	10/28/25 14:44	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD- 0446 Lims Reference ID: ED56727-04 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:45	10/28/25 14:45	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD- 0447 Lims Reference ID: ED56727-05 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:47	10/28/25 14:47	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD- 0450 Lims Reference ID: ED56727-06 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/28/25 14:48	10/28/25 14:48	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD- 0451 Lims Reference ID: ED56727-07 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	3.0		1	1.0	µg/L	11/06/25 18:18	11/06/25 18:18	KT1	EPA 200.8 (Dig)/EPA 200.8
Sample: EUFSD- 0452 Lims Reference ID: ED56727-08 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									
Lead	8.5		1	1.0	µg/L	10/28/25 14:52	10/28/25 14:52	JH	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD- 0453 Lims Reference ID: ED56727-09 Matrix: Drinking Water Sampled: 10/18/25 00:00:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556727

LIMS Reference ID: ED56727

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name: 23-53894 , James H. Boyd Intermediate School ,
JHBIS, Elwood Union Free School District, 286 Cuba
Hill Road, Huntington NY 11743

Project ID: _06 - Carle Place Lead Analyses**Customer PO:****Sales Rep:** Jeromy Bish**Received:** 10/23/2025 14:50**Reported:** 11/07/2025 08:45

Analytical Results (Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: EUFSD- 0453 (Continued)

Lims Reference ID: ED56727-09 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	10/28/25 14:53	10/28/25 14:53	JH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	----	--------------------------

Sample: EUFSD- 0454

Lims Reference ID: ED56727-10 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/28/25 14:57	10/28/25 14:57	JH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	----	--------------------------

Sample: EUFSD- 0455

Lims Reference ID: ED56727-11 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

Lead	1.7		1	1.0	µg/L	10/28/25 14:58	10/28/25 14:58	JH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	----	--------------------------

Sample: EUFSD- 0456

Lims Reference ID: ED56727-12 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

Lead	1.0		1	1.0	µg/L	10/28/25 14:59	10/28/25 14:59	JH	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	----	--------------------------

Sample: EUFSD- 0457

Lims Reference ID: ED56727-13 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/28/25 15:01	10/28/25 15:01	JH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	----	--------------------------

Sample: EUFSD- 0458

Lims Reference ID: ED56727-14 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/28/25 15:02	10/28/25 15:02	JH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	----	--------------------------

Sample: EUFSD- 0459

Lims Reference ID: ED56727-15 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

Lead	25.0		1	1.0	µg/L	10/28/25 15:04	10/28/25 15:04	JH	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	----	--------------------------

Sample: EUFSD- 0774

Lims Reference ID: ED56727-16 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/28/25 15:05	10/28/25 15:05	JH	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	----	--------------------------

Sample: EUFSD- 0775

Lims Reference ID: ED56727-17 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556727

LIMS Reference ID: ED56727

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894 , James H. Boyd Intermediate School ,
JHBIS, Elwood Union Free School District, 286 Cuba
Hill Road, Huntington NY 11743

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:45

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: EUFSD- 0775 (Continued)

Lims Reference ID: ED56727-17 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	10/31/25 13:27	10/31/25 13:27	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD- 0781

Lims Reference ID: ED56727-18 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 13:28	10/31/25 13:28	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD- 0782

Lims Reference ID: ED56727-19 Matrix: Drinking Water

Sampled: 10/18/25 00:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 13:29	10/31/25 13:29	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556727

LIMS Reference ID: ED56727

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894 , James H. Boyd Intermediate School ,
JHBIS, Elwood Union Free School District, 286 Cuba
Hill Road, Huntington NY 11743

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:45

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556727

LIMS Reference ID: ED56727

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

23-53894 , James H. Boyd Intermediate School ,
JHBIS, Elwood Union Free School District, 286 Cuba
Hill Road, Huntington NY 11743

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:45


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building: James H. Boyd Intermediate School

JHBIS

EDS 7338

Client:

Elwood Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSO-0397	FL	1021	Faculty Room 110	KC	11/22/2025	8:53:00 AM
EUFSO-0452	KI	1054	Kitchen	HW	11/22/2025	8:50:00 AM

Samples Submitted 2



Pb 200.8
Kathleen
11/26/25

RECEIVED
ENSL ANALYTICAL, INC.
Carle Place, NY
NOV 22 25, AM 10:27

Pb 200.8 QW 11/26/25

Building Address

286 Cuba Hill Road

Huntington, NY 11743

Analysis Type: ELAP 200.5

Lab Received:

Sean Cull

11/22/25

Signature:

10:27 AM

Samplers Name: Andy Carbuta

Samplers Signature:

Andy Carbuta

JCB Project Manager:

George Grege

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557338**LIMS Reference ID:** ED57338**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

286 Cuba Hill Road Huntington NY 11743, James H.
Boyd Intermediate School, JCB#:23-53894, Elwood
Union Free School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:27

Reported:

11/29/2025 14:22

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD - 0397									
Lims Reference ID:				ED57338-01		Matrix: Drinking Water		Sampled: 11/22/25 00:00:00	
Metals									
Lead	2.4		1	1.0	µg/L	11/26/25 21:54	11/26/25 21:54	DAZ	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD - 0452									
Lims Reference ID:				ED57338-02		Matrix: Drinking Water		Sampled: 11/22/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	11/26/25 21:55	11/26/25 21:55	DAZ	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557338**LIMS Reference ID:** ED57338**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

286 Cuba Hill Road Huntington NY 11743, James H.
Boyd Intermediate School, JCB#:23-53894, Elwood
Union Free School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:27

Reported:

11/29/2025 14:22

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062557338**LIMS Reference ID:** ED57338**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

286 Cuba Hill Road Huntington NY 11743, James H.
Boyd Intermediate School, JCB#:23-53894, Elwood
Union Free School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:27

Reported:

11/29/2025 14:22


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building: Elwood Middle School

EMS

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Walk In

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSO-0520	KI	1003	Kitchen	KC	10/18/2025	6:56:00 AM
EUFSO-0521	KI	1003	Kitchen	SN	10/18/2025	6:56:00 AM
EUFSO-0522	KI	1003	Kitchen	KC	10/18/2025	6:56:00 AM
EUFSO-0523	KI	1003	Kitchen	KC	10/18/2025	6:54:00 AM
EUFSO-0524	KI	1003	Kitchen	PK	10/18/2025	6:54:00 AM
EUFSO-0525	KI	1003	Kitchen	KC	10/18/2025	6:50:00 AM
EUFSO-0526	KI	1003	Kitchen	SN	10/18/2025	6:51:00 AM
EUFSO-0527	KI	1003	Kitchen	KC	10/18/2025	6:50:00 AM
EUFSO-0528	KI	1003	Kitchen	SN	10/18/2025	6:53:00 AM
EUFSO-0580	FL	1045	Faculty Room	KC	10/18/2025	7:16:00 AM
EUFSO-0590	OF	1069B	Main Office Mail Room	KC	10/18/2025	7:07:00 AM
EUFSO-0610	HA	1087	Corridor Between Auditorium & Guidance Office	WC	10/18/2025	7:18:00 AM
EUFSO-0615	LI	2015A	Library Kitchen	KC	10/18/2025	7:26:00 AM
EUFSO-0616	FL	2027	Teachers Workroom Adjacent R C	KC	10/18/2025	7:13:00 AM
EUFSO-0747	HE	1073	Home Economics Room 101	EC	10/18/2025	7:02:00 AM
EUFSO-0748	HE	1073	Home Economics Room 101	EC	10/18/2025	7:02:00 AM
EUFSO-0749	HE	1073	Home Economics Room 101	EC	10/18/2025	7:03:00 AM
EUFSO-0750	HE	1073	Home Economics Room 101	EC	10/18/2025	7:04:00 AM

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY

OCT 23 25, PM02:50

Building Address

478 Elwood Road

Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Pb 200.8
10/22/25
10/23/25


10/23/25 14:30

May 10/23/25

Andrew Schreck

Chadwick

George Greve



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 23-53894
Building: Elwood Middle School

EMS

ED56726

Client:
Elwood Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSO-0751	HE	1073	Home Economics Room 101	EC	10/18/2025	7:04:00 AM
EUFSO-0752	HE	1073	Home Economics Room 101	EC	10/18/2025	7:03:00 AM
EUFSO-0789	CA	1004	Cafeteria	WC	10/18/2025	6:55:00 AM
EUFSO-0790	CA	1004	Cafeteria	WF	10/18/2025	6:58:00 AM
EUFSO-0791	FL	1005	Teachers Room	KC	10/18/2025	7:00:00 AM
EUFSO-0795	LR	1009A2	Boys Locker Room	WC	10/18/2025	7:24:00 AM
EUFSO-0796	LR	1009A2	Boys Locker Room	WF	10/18/2025	7:25:00 AM
EUFSO-0806	LR	1012C	Girls Locker Room	WC	10/18/2025	7:20:00 AM
EUFSO-0807	LR	1012C	Girls Locker Room	WF	10/18/2025	7:20:00 AM
EUFSO-0814	OF	1069H	Main Office Hall	WC	10/18/2025	7:07:00 AM
EUFSO-0815	OF	1069H	Main Office Hall	WF	10/18/2025	7:07:00 AM
EUFSO-0816	NO	1070A	Nurse Office	NS	10/18/2025	7:05:00 AM
EUFSO-0819	HA	1087	Corridor Between Auditorium & Guidance Office	WF	10/18/2025	7:18:00 AM
EUFSO-0927	HA	1063	Corridor Between Room 119 & Lobby	WF	10/18/2025	7:09:00 AM
EUFSO-0943	HA	2052	Corridor from Teachers Room to Library	WF	10/18/2025	7:12:00 AM

RECEIVED

EMSL ANALYTICAL, INC.
Carle Place, NY
OCT 23 25. PM02:51

Pb 200-8
Kathleen
10/29/25

Building Address
478 Elwood Road
Elwood, NY 11731

Analysis Type: ELAP 200.5


Lab Received: 10/23/25 14:50

Signature: [Signature]

Samplers Name: Andrew Schreck

Samplers Signature: [Signature]

JCB Project Manager: George Greve



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building: Elwood Middle School

EMS

ED 56726

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 33

RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
OCT 23 25, PM02:51

Pb 200.8
Kathleen 10/29/25

Building Address

478 Elwood Road

Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Recieved: 10/23/25 14:50

Signature: [Signature]

Samplers Name: Andrew Schrock

Samplers Signature: [Signature]

JCB Project Manager: George Greve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556726

LIMS Reference ID: ED56726

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Elwood Middle School: 478 Elwood Road, Elwood,
NY 11731: Elwood Union Free School District:
Project# 23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:48

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD-0520 Lims Reference ID: ED56726-01 Matrix: Drinking Water Sampled: 10/18/25 06:56:00									
Metals									
Lead	1.3		1	1.0	µg/L	10/29/25 16:02	10/29/25 16:02	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0521 Lims Reference ID: ED56726-02 Matrix: Drinking Water Sampled: 10/18/25 06:56:00									
Metals									
Lead	2.2		1	1.0	µg/L	10/29/25 16:04	10/29/25 16:04	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0522 Lims Reference ID: ED56726-03 Matrix: Drinking Water Sampled: 10/18/25 06:56:00									
Metals									
Lead	2.1		1	1.0	µg/L	10/29/25 16:05	10/29/25 16:05	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0523 Lims Reference ID: ED56726-04 Matrix: Drinking Water Sampled: 10/18/25 06:05:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/29/25 16:06	10/29/25 16:06	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0524 Lims Reference ID: ED56726-05 Matrix: Drinking Water Sampled: 10/18/25 06:54:00									
Metals									
Lead	24.9		1	1.0	µg/L	10/29/25 16:07	10/29/25 16:07	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0525 Lims Reference ID: ED56726-06 Matrix: Drinking Water Sampled: 10/18/25 06:50:00									
Metals									
Lead	5.2		1	1.0	µg/L	10/31/25 16:48	10/31/25 16:48	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0526 Lims Reference ID: ED56726-07 Matrix: Drinking Water Sampled: 10/18/25 06:51:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	10/31/25 16:49	10/31/25 16:49	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0527 Lims Reference ID: ED56726-08 Matrix: Drinking Water Sampled: 10/18/25 06:50:00									
Metals									
Lead	1.2		1	1.0	µg/L	10/31/25 16:50	10/31/25 16:50	KT1	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0528 Lims Reference ID: ED56726-09 Matrix: Drinking Water Sampled: 10/18/25 06:53:00									
Metals									

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556726

LIMS Reference ID: ED56726

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Elwood Middle School: 478 Elwood Road, Elwood,
NY 11731: Elwood Union Free School District:
Project# 23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:48

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: EUFSD-0528 (Continued)

Lims Reference ID: ED56726-09 Matrix: Drinking Water

Sampled: 10/18/25 06:53:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	10/31/25 16:54	10/31/25 16:54	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0580

Lims Reference ID: ED56726-10 Matrix: Drinking Water

Sampled: 10/18/25 07:16:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 16:58	10/31/25 16:58	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0590

Lims Reference ID: ED56726-11 Matrix: Drinking Water

Sampled: 10/18/25 07:07:00

Metals

Lead	1.8		1	1.0	µg/L	10/31/25 16:59	10/31/25 16:59	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0610

Lims Reference ID: ED56726-12 Matrix: Drinking Water

Sampled: 10/18/25 07:18:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 17:01	10/31/25 17:01	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0615

Lims Reference ID: ED56726-13 Matrix: Drinking Water

Sampled: 10/18/25 07:26:00

Metals

Lead	24.8		1	1.0	µg/L	10/31/25 17:02	10/31/25 17:02	KT1	EPA 200.8 (DA)/EPA 200.8
------	------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0616

Lims Reference ID: ED56726-14 Matrix: Drinking Water

Sampled: 10/18/25 07:13:00

Metals

Lead	5.4		1	1.0	µg/L	10/31/25 17:03	10/31/25 17:03	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0747

Lims Reference ID: ED56726-15 Matrix: Drinking Water

Sampled: 10/18/25 07:02:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 17:05	10/31/25 17:05	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0748

Lims Reference ID: ED56726-16 Matrix: Drinking Water

Sampled: 10/18/25 07:02:00

Metals

Lead	< 1.0		1	1.0	µg/L	10/31/25 17:06	10/31/25 17:06	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0749

Lims Reference ID: ED56726-17 Matrix: Drinking Water

Sampled: 10/18/25 07:03:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556726

LIMS Reference ID: ED56726

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Elwood Middle School: 478 Elwood Road, Elwood,
NY 11731: Elwood Union Free School District:
Project# 23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:48

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	--------------------	--------------------	------------------	-------------------------

Sample: EUFSD-0749 (Continued)

Lims Reference ID: ED56726-17 Matrix: Drinking Water

Sampled: 10/18/25 07:03:00

Metals (Continued)

Lead	1.1		1	1.0	µg/L	10/31/25 17:07	10/31/25 17:07	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0750

Lims Reference ID: ED56726-18 Matrix: Drinking Water

Sampled: 10/18/25 07:04:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:33	11/04/25 12:33	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0751

Lims Reference ID: ED56726-19 Matrix: Drinking Water

Sampled: 10/18/25 07:04:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:37	11/04/25 12:37	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0752

Lims Reference ID: ED56726-20 Matrix: Drinking Water

Sampled: 10/18/25 07:03:00

Metals

Lead	6.7		1	1.0	µg/L	11/04/25 12:38	11/04/25 12:38	KT1	EPA 200.8 (DA)/EPA 200.8
------	-----	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0789

Lims Reference ID: ED56726-21 Matrix: Drinking Water

Sampled: 10/18/25 06:55:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:42	11/04/25 12:42	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0790

Lims Reference ID: ED56726-22 Matrix: Drinking Water

Sampled: 10/18/25 06:58:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:43	11/04/25 12:43	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0791

Lims Reference ID: ED56726-23 Matrix: Drinking Water

Sampled: 10/18/25 07:00:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:45	11/04/25 12:45	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0795

Lims Reference ID: ED56726-24 Matrix: Drinking Water

Sampled: 10/18/25 07:24:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/01/25 13:55	11/01/25 13:55	DAZ	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0796

Lims Reference ID: ED56726-25 Matrix: Drinking Water

Sampled: 10/18/25 07:25:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556726

LIMS Reference ID: ED56726

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Elwood Middle School: 478 Elwood Road, Elwood,
NY 11731: Elwood Union Free School District:
Project# 23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:48

Analytical Results
(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
---------	--------	---	----	----	-------	-----------------------	-----------------------	---------------------	----------------------------

Sample: EUFSD-0796 (Continued)

Lims Reference ID: ED56726-25 Matrix: Drinking Water

Sampled: 10/18/25 07:25:00

Metals (Continued)

Lead	< 1.0		1	1.0	µg/L	11/01/25 13:59	11/01/25 13:59	DAZ	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0806

Lims Reference ID: ED56726-26 Matrix: Drinking Water

Sampled: 10/18/25 07:20:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:46	11/04/25 12:46	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0807

Lims Reference ID: ED56726-27 Matrix: Drinking Water

Sampled: 10/18/25 07:20:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:47	11/04/25 12:47	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0814

Lims Reference ID: ED56726-28 Matrix: Drinking Water

Sampled: 10/18/25 07:07:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:49	11/04/25 12:49	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0815

Lims Reference ID: ED56726-29 Matrix: Drinking Water

Sampled: 10/18/25 07:07:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:50	11/04/25 12:50	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0816

Lims Reference ID: ED56726-30 Matrix: Drinking Water

Sampled: 10/18/25 07:05:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 12:51	11/04/25 12:51	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0819

Lims Reference ID: ED56726-31 Matrix: Drinking Water

Sampled: 10/18/25 07:18:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 13:22	11/04/25 13:22	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0927

Lims Reference ID: ED56726-32 Matrix: Drinking Water

Sampled: 10/18/25 07:09:00

Metals

Lead	< 1.0		1	1.0	µg/L	11/04/25 13:24	11/04/25 13:24	KT1	EPA 200.8 (DA)/EPA 200.8
------	-------	--	---	-----	------	----------------	----------------	-----	--------------------------

Sample: EUFSD-0943

Lims Reference ID: ED56726-33 Matrix: Drinking Water

Sampled: 10/18/25 07:12:00

Metals

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556726**LIMS Reference ID:** ED56726**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Elwood Middle School: 478 Elwood Road, Elwood,
NY 11731: Elwood Union Free School District:
Project# 23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeremy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:48

Analytical Results

(Continued)

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD-0943 (Continued) Lims Reference ID: ED56726-33 Matrix: Drinking Water Sampled: 10/18/25 07:12:00									
Metals (Continued)									
Lead	< 1.0		1	1.0	µg/L	11/04/25 13:25	11/04/25 13:25	KT1	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062556726**LIMS Reference ID:** ED56726**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Elwood Middle School: 478 Elwood Road, Elwood,
NY 11731: Elwood Union Free School District:
Project# 23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:48

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062556726**LIMS Reference ID:** ED56726**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

Elwood Middle School: 478 Elwood Road, Elwood,
NY 11731: Elwood Union Free School District:
Project# 23-53894

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

10/23/2025 14:50

Reported:

11/07/2025 08:48


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building: Elwood Middle School

EMS

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

ED57336

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFS-0524	KI	1003	Kitchen	PK	11/22/2025	8:08:00 AM
EUFS-0525	KI	1003	Kitchen	KC	11/22/2025	8:03:00 AM
EUFS-0615	LI	2015A	Library Kitchen	KC	11/22/2025	8:13:00 AM
EUFS-0616	FL	2027	Teachers Workroom Adjacent R C	KC	11/22/2025	8:15:00 AM
EUFS-0752	HE	1073	Home Economics Room 101	EC	11/22/2025	8:10:00 AM

Samples Submitted 5



RECEIVED
ENSL ANALYTICAL, INC.
Carle Place, NY
NOV 22 25, AM 10:27

Pb2008 Clean 11/26/25

Building Address

478 Elwood Road
Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Andy Carba Jr.

Samplers Signature: Andy Carba Jr.

JCB Project Manager: George Greco

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557336**LIMS Reference ID:** ED57336**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

478 Elwood Road Elwood NY 11731, Elwood Middle
School, 23-53894, Elwood Union Free School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:27

Reported:

11/29/2025 14:34

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD - 0524									
Lims Reference ID:				ED57336-01		Matrix: Drinking Water		Sampled: 11/22/25 00:00:00	
Metals									
Lead	19.4		1	1.0	µg/L	11/26/25 21:42	11/26/25 21:42	DAZ	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD - 0525									
Lims Reference ID:				ED57336-02		Matrix: Drinking Water		Sampled: 11/22/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	11/26/25 21:44	11/26/25 21:44	DAZ	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD - 0615									
Lims Reference ID:				ED57336-03		Matrix: Drinking Water		Sampled: 11/22/25 00:00:00	
Metals									
Lead	22.3		1	1.0	µg/L	11/26/25 21:45	11/26/25 21:45	DAZ	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD - 0616									
Lims Reference ID:				ED57336-04		Matrix: Drinking Water		Sampled: 11/22/25 00:00:00	
Metals									
Lead	7.0		1	1.0	µg/L	11/26/25 21:49	11/26/25 21:49	DAZ	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD - 0752									
Lims Reference ID:				ED57336-05		Matrix: Drinking Water		Sampled: 11/22/25 00:00:00	
Metals									
Lead	< 1.0		1	1.0	µg/L	11/26/25 21:53	11/26/25 21:53	DAZ	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557336**LIMS Reference ID:** ED57336**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

478 Elwood Road Elwood NY 11731, Elwood Middle
School, 23-53894, Elwood Union Free School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:27

Reported:

11/29/2025 14:34

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062557336**LIMS Reference ID:** ED57336**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

478 Elwood Road Elwood NY 11731, Elwood Middle
School, 23-53894, Elwood Union Free School District

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

11/22/2025 10:27

Reported:

11/29/2025 14:34


Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #:

23-53894

Building: Elwood Middle School

EMS

EDS 7741

Client:

Elwood Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Page 1 of 1

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
EUFSO-0524	KI	1003	Kitchen	PK	12/16/2025	6:38:00 AM
EUFSO-0615	LI	2015A	Library Kitchen	KC	12/16/2025	6:41:00 AM
EUFSO-0616	FL	2027	Teachers Workroom Adjacent R C	KC	12/16/2025	6:43:00 AM

Samples Submitted 3



RECEIVED
EMSL ANALYTICAL, INC.
Carle Place, NY
DEC 16 25, PM 01:51

Ab 200.8 Bldg 12/17/25

Building Address

478 Elwood Road

Elwood, NY 11731

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: ANDY CARBUTAL

Samplers Signature: [Signature]

JCB Project Manager: George Greve

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557741**LIMS Reference ID:** ED57741**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 23-53894, Elwood Middle School, Elwood
Union Free School District, 478 Elwood Road,
Elwood, NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/16/2025 13:51

Reported:

12/17/2025 15:09

Analytical Results

Analyte	Result	Q	DF	RL	Units	Prepared Date/Time	Analyzed Date/Time	Analyst Initials	Prep /Analytical Method
Sample: EUFSD-0524 Lims Reference ID: ED57741-01 Matrix: Drinking Water Sampled: 12/16/25 00:00:00									
Metals									
Lead	3.5		1	1.0	µg/L	12/17/25 13:18	12/17/25 13:18	BP	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0615 Lims Reference ID: ED57741-02 Matrix: Drinking Water Sampled: 12/16/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/17/25 13:19	12/17/25 13:19	BP	EPA 200.8 (DA)/EPA 200.8
Sample: EUFSD-0616 Lims Reference ID: ED57741-03 Matrix: Drinking Water Sampled: 12/16/25 00:00:00									
Metals									
Lead	< 1.0		1	1.0	µg/L	12/17/25 13:21	12/17/25 13:21	BP	EPA 200.8 (DA)/EPA 200.8

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax:856-786-5974
EMSL-CP-06

EMSL Order ID: 062557741

LIMS Reference ID: ED57741

EMSL Customer ID: JCBR50

Attention: George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 23-53894, Elwood Middle School, Elwood
Union Free School District, 478 Elwood Road,
Elwood, NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/16/2025 13:51

Reported:

12/17/2025 15:09

Certified Analyses included in this Report

Analyte	Certifications
<i>EPA 200.8 in Drinking Water</i>	
Lead	06-NYSELAP

List of Certifications

Code	Description	Number	Expires
06-NYSELAP	NY NYS ELAP	11469	04/01/2026
06-NYSDOH	New York State Department of Health	11469	04/01/2026
06-CTDPH	Connecticut Department of Public Health	PH-0249	03/31/2027
06-California ELAP	California Water Boards	2339	04/01/2026
06-AIHA LAP	American Industrial Hygiene Association (AIHA LAP, LLC) - ELLAP	102344	08/01/2026

Please see the specific Field of Testing (FOT) on www.emsl.com <<http://www.emsl.com>> for a complete listing of parameters for which EMSL is certified.

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY, 11514
Telephone: 516.997.7251 Fax: 856-786-5974
EMSL-CP-06

EMSL Order ID: 062557741**LIMS Reference ID:** ED57741**EMSL Customer ID:** JCBR50**Attention:** George Greve

J.C. Broderick & Associates [JCBR50]
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788
(631) 584-5492
ggreve@jcbroderick.com

Project Name:

JCB#: 23-53894, Elwood Middle School, Elwood
Union Free School District, 478 Elwood Road,
Elwood, NY 11731

Project ID:

_06 - Carle Place Lead Analyses

Customer PO:**Sales Rep:**

Jeromy Bish

Received:

12/16/2025 13:51

Reported:

12/17/2025 15:09

Notes and Definitions

Item	Definition
(Dig)	For metals analysis, sample was digested.
[2C]	Reported from the second channel in dual column analysis.
DA	Direct Analysis
DF	Dilution Factor
MDL	Method Detection Limit.
ND	Analyte was NOT DETECTED at or above the detection limit.
NR	Spike/Surrogate showed no recovery.
Q	Qualifier
RCS	Respirable Crystalline Silica
RL	Reporting Limit
Wet	Sample is not dry weight corrected.

Measurement of uncertainty and any applicable definitions of method modifications are available upon request. Per EPA NLLAP policy, sample results are not blank corrected.

James Han Laboratory Manager or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

Attachment 4:

Laboratory Certifications


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

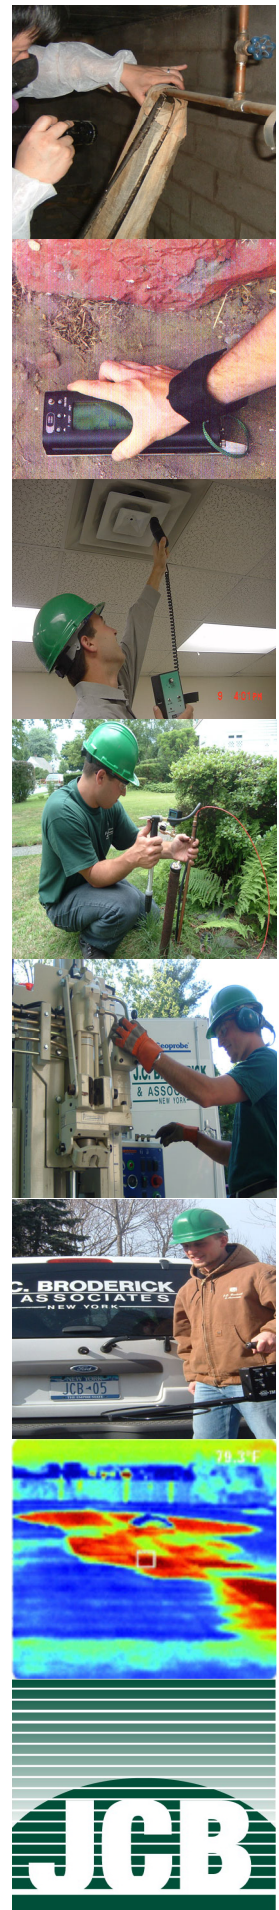

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2024
Issued April 01, 2022
Revised March 30, 2023

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Heterotrophic Plate Count	SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5
-------------	-----------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------



Serial No.: 66394

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at <https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/>, by phone (518) 485-5570 or by email to elap@health.ny.gov.

