



February 2, 2026

Will Wenzloff
Hillsboro School District
4901 SE Witch Hazel Road
Hillsboro, Oregon 97123

Via email: wenzlofw@hsd.k12.or.us

Regarding: Drinking Water Sampling Report
Eastwood Elementary School
2100 NE Lincoln Street
Hillsboro, Oregon
PBS Project No. 25012835 / 0001

Dear Mr. Wenzloff:

Between November 11, 2025, and January 8, 2026, Apex Companies LLC (Apex) collected drinking water samples at Eastwood Elementary School in Hillsboro, Oregon. Sampling included the main building, the stand-alone gymnasium, and modular building. The testing was requested by Hillsboro School District as part of their efforts to ensure that concentrations of lead in drinking water at the school remain below the Oregon Department of Education (ODE) action level of 15 parts per billion (ppb).

Water from all fixtures at the school used for drinking or food preparation have lead concentrations below 15 ppb.

Forty-seven samples were collected from the main building, 10 samples were collected from the gymnasium, and 12 samples were collected from the modular classroom building. All samples were delivered under chain of custody to Apex Laboratories in Tigard, Oregon, for lead analysis.

Initial water sampling in the main building and modular classroom was completed in two sampling rounds. The second round included some fixtures that were not working during the first round of sampling.

The results of each sampling round are shown in the following tables.

Main Building – Round 1

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
001	22390500-001KF25A	Kitchen pot filler – first draw	9.70
002	22390500-002BF25A	Kitchen restroom, handwash sink	3.71
003	22390500-003KF25A	Kitchen, north wall triple sink – left faucet	4.52
004	22390500-004KF25A	Kitchen, north wall triple sink – right faucet	7.27
005	22390500-005KF25A	Kitchen, south prep island sink faucet	3.07
006	22390500-006DW25A	Cafeteria drinking fountain	0.391
007		PE Office (old boys locker room) handwash sink – not sampled	

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
008		Cafeteria storage (old girls locker room) handwash sink – not sampled	
009	22390500-009BF25A	Girls RR at NE entry – left sink	0.909
010	22390500-010BF25A	Girls RR at NE entry – right sink	1.25
011	22390500-011BF25A	Boys RR at NE entry – right sink	1.61
012	22390500-012BF25A	Boys RR at NE entry – right sink	0.493
013	22390500-013WB25A	Kindergarten hall, water bottle filler	0.265
014	22390500-014DW25A	Kindergarten hall, drinking fountain – left	0.294
015	22390500-015DW25A	Kindergarten hall, drinking fountain - right	0.322
016	22390500-016WB25A	Cafeteria water bottle filler	ND
017	22390500-017SF25A	Faculty break room sink	1.24
018	22390500-018BF25A	Womens staff restroom sink	3.69
019	22390500-019BF25A	Mens staff restroom sink	3.56
020	22390500-020BF25A	Kindergarten pod restroom sink	3.57
021		Room 16 west sink drinking fountain – not working	
022	22390500-022CF25A	Room 16 west sink classroom faucet	0.435
023	22390500-023DW25A	Room 16 north sink drinking fountain	2.45
024	22390500-024CF25A	Room 16 north sink classroom faucet	1.76
025	22390500-025NS25A	Health Room sink	1.67
026	22390500-026SF25A	Main office work room sink	2.80
027	22390500-027BF25A	ADA restroom across from 1st grade pod	0.237
028	22390500-028DW25A	Drinking fountain near ADA restroom across from 1st grade pod	1.85
029	22390500-029DW25A	1st/2nd grade pod activity room, left sink drinking fountain	0.949
030	22390500-030CF25A	1st/2nd grade pod activity room, left sink faucet	0.806
031	22390500-031DW25A	1st/2nd grade pod activity room, right sink drinking fountain	1.60
032	22390500-032CF25A	1st/2nd grade pod activity room, right sink faucet	0.726
033	22390500-033DW25A	3rd/4th grade pod activity room, left sink drinking fountain	1.81
034	22390500-034CF25A	3rd/4th grade pod activity room, left sink faucet	0.953
035	22390500-035DW25A	3rd/4th grade pod activity room, right sink drinking fountain	1.81
036	22390500-036CF25A	3rd/4th grade pod activity room, right sink faucet	0.913
037	22390500-037BF25A	SW womens restroom – left sink	0.945
038	22390500-038BF25A	SW womens restroom – right sink	0.537
039	22390500-039BF25A	SW mens restroom – left sink	0.938
040	22390500-040BF25A	SW mens restroom – right sink	0.774
041	22390500-041DW25A	5th/6th grade pod activity room, left sink drinking fountain	1.10
042	22390500-042CF25A	5th/6th grade pod activity room, left sink faucet	5.41
043	22390500-043DW25A	5th/6th grade pod activity room, right sink drinking fountain	0.651
044		5th/6th grade pod activity room, right sink faucet – not sampled	
045	22390500-045SF25A	Media Center, sink at circulation desk	9.54
046	22390500-046DW25A	Media Center at north center column – drinking fountain	2.38
047	22390500-047CF25A	Media Center at north center column – sink faucet	7.40

ND = no lead detected

Main Building – Round 2

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
007	22390500-007BF26A	PE Office (old boys locker room) handwash sink	2.21
008	22390500-008BF26A	Cafeteria storage (old girls locker room) handwash sink	3.14
021	22390500-021DW26A	Room 16 west sink drinking fountain	2.01
044	22390500-044CF26A	5th/6th grade pod activity room, right sink faucet	2.69

ND = no lead detected

Gymnasium – Round 1

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
001	22390506-001WB25A	Entry lobby water bottle filler	ND
002	22390506-002DW25A	Entry lobby	ND
003	22390506-003DW25A	Entry lobby	ND
004	22390506-004BF25A	Family Restroom near lobby	ND
005	22390506-005BF25A	Restroom Sinks – Left to Right (1)	ND
006	22390506-006BF25A	Restroom Sinks – Left to Right (2)	ND
007	22390506-007BF25A	Restroom Sinks – Left to Right (3)	ND
008	22390506-008BF25A	Restroom Sinks – Left to Right (4)	ND
009	22390506-009BF25A	Restroom Sinks – Left to Right (5)	ND
010	22390506-010BF25A	Family Restroom at Janitor's Closet	0.204

ND = no lead detected

Modular Classroom – Round 1

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
001	22390505-001CF25A	Room M-1 classroom faucet	0.321
002	22390505-002CF25A	Room M-2 classroom faucet	0.491
003	22390505-003CF25A	Room M-4 classroom faucet	0.265
004		Drinking fountain at restroom – left (not working)	
005		Drinking fountain at restroom – right (not working)	
006	22390505-006CF25A	Room M-3 classroom faucet	1.19
007	22390505-007BF25A	Room M-4 restroom faucet	ND
008	22390505-008BF25A	Boys restroom sink faucet – left	ND
009	22390505-009BF25A	Boys restroom sink faucet – right	ND
010	22390505-010BF25A	Girls restroom sink faucet – left	ND
011	22390505-011BF25A	Girls restroom sink faucet – right	0.208
012	22390505-012BF25A	Staff restroom sink faucet	0.453

ND = no lead detected


Modular Classroom – Round 2

Fixture Number	Sample Number	Location / Room No.	Results (ppb)
004	22390505-004DW26A	Drinking fountain at restroom – left	ND
005	22390505-005DW26A	Drinking fountain at restroom – right	ND

ND = no lead detected

Please feel free to contact me at 503.515.4726 or dale.voeller@apexc.com with any questions or comments.


Sincerely,




Dale Voeller, CHMM, CSP
Senior Project Manager

Attachment: Fixture Location Drawings
Laboratory Analytical Reports


Eastwood Elementary School
 Fixture Location Drawing
 Partial North Wing
 January 2026
 1 of 3

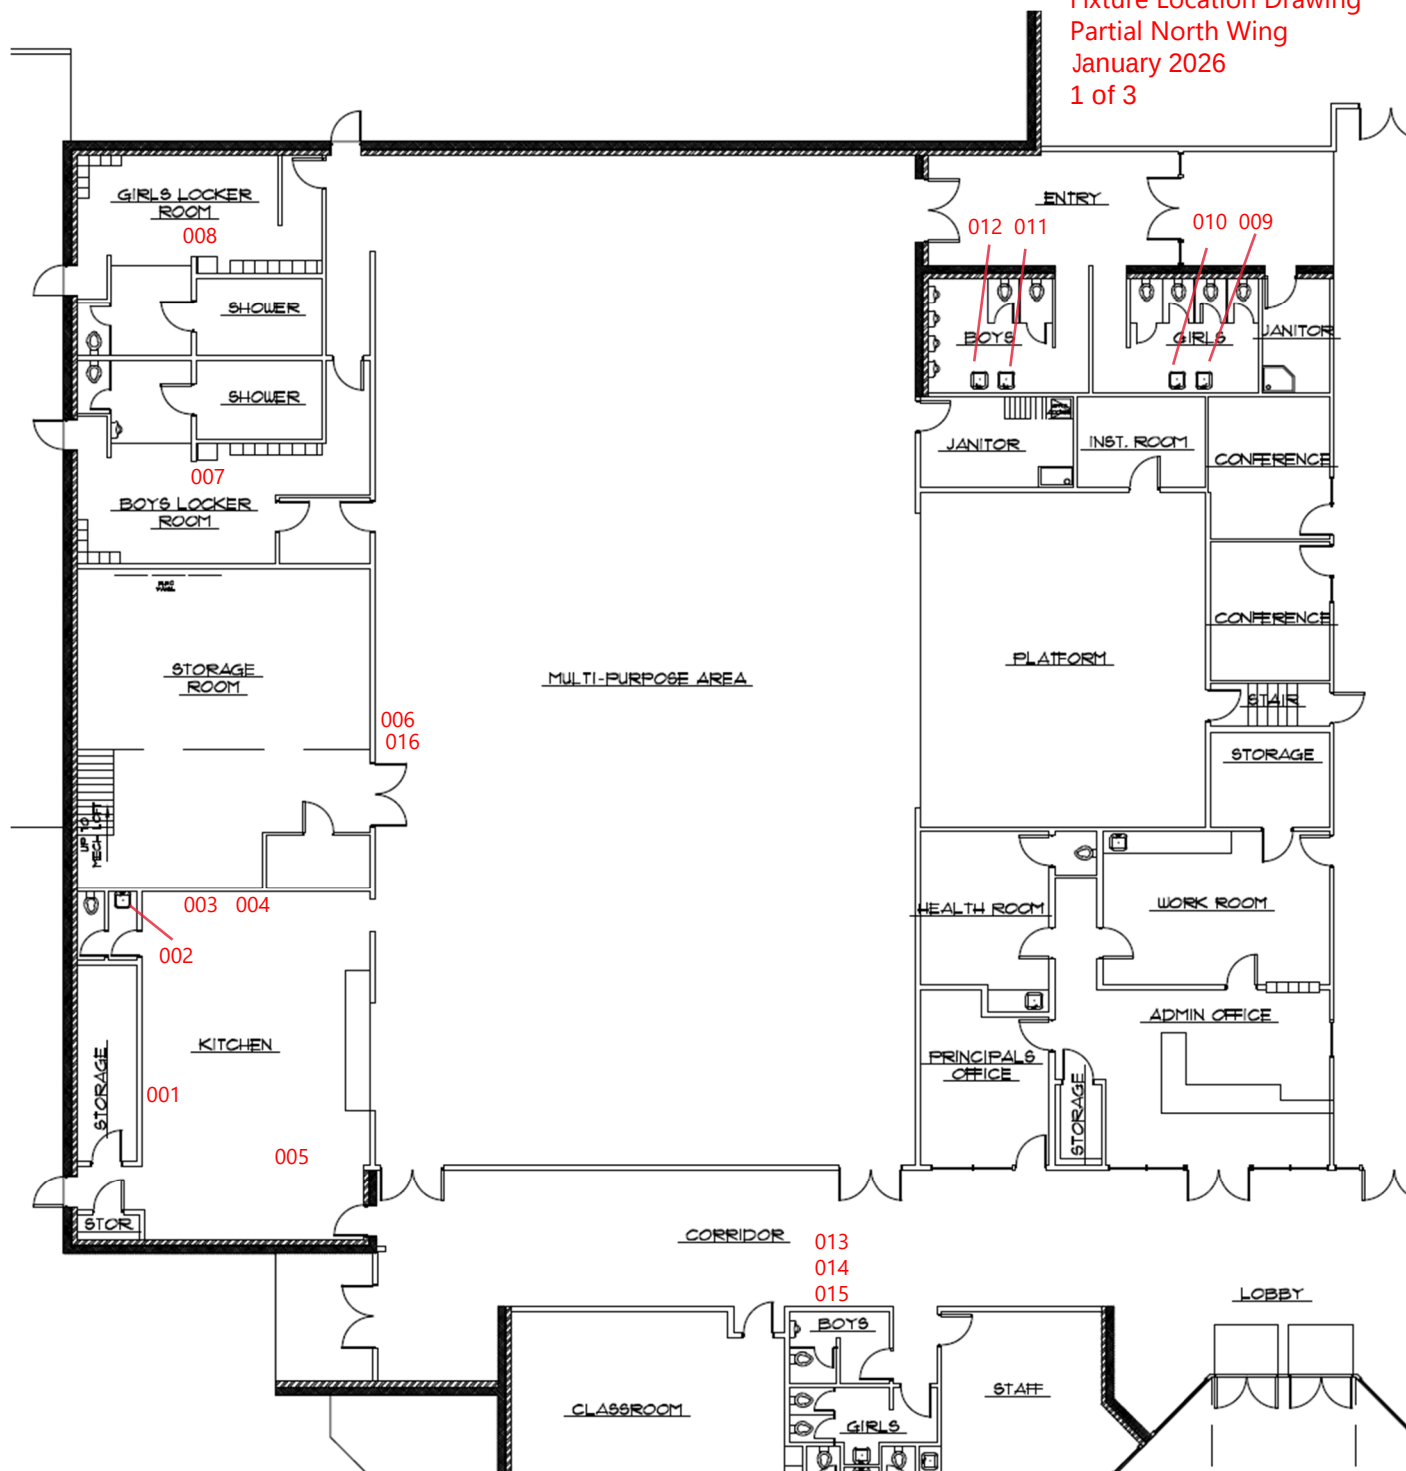

Eastwood Elementary School
Fixture Location Drawing
Main Office and West Wing
January 2026
2 of 3

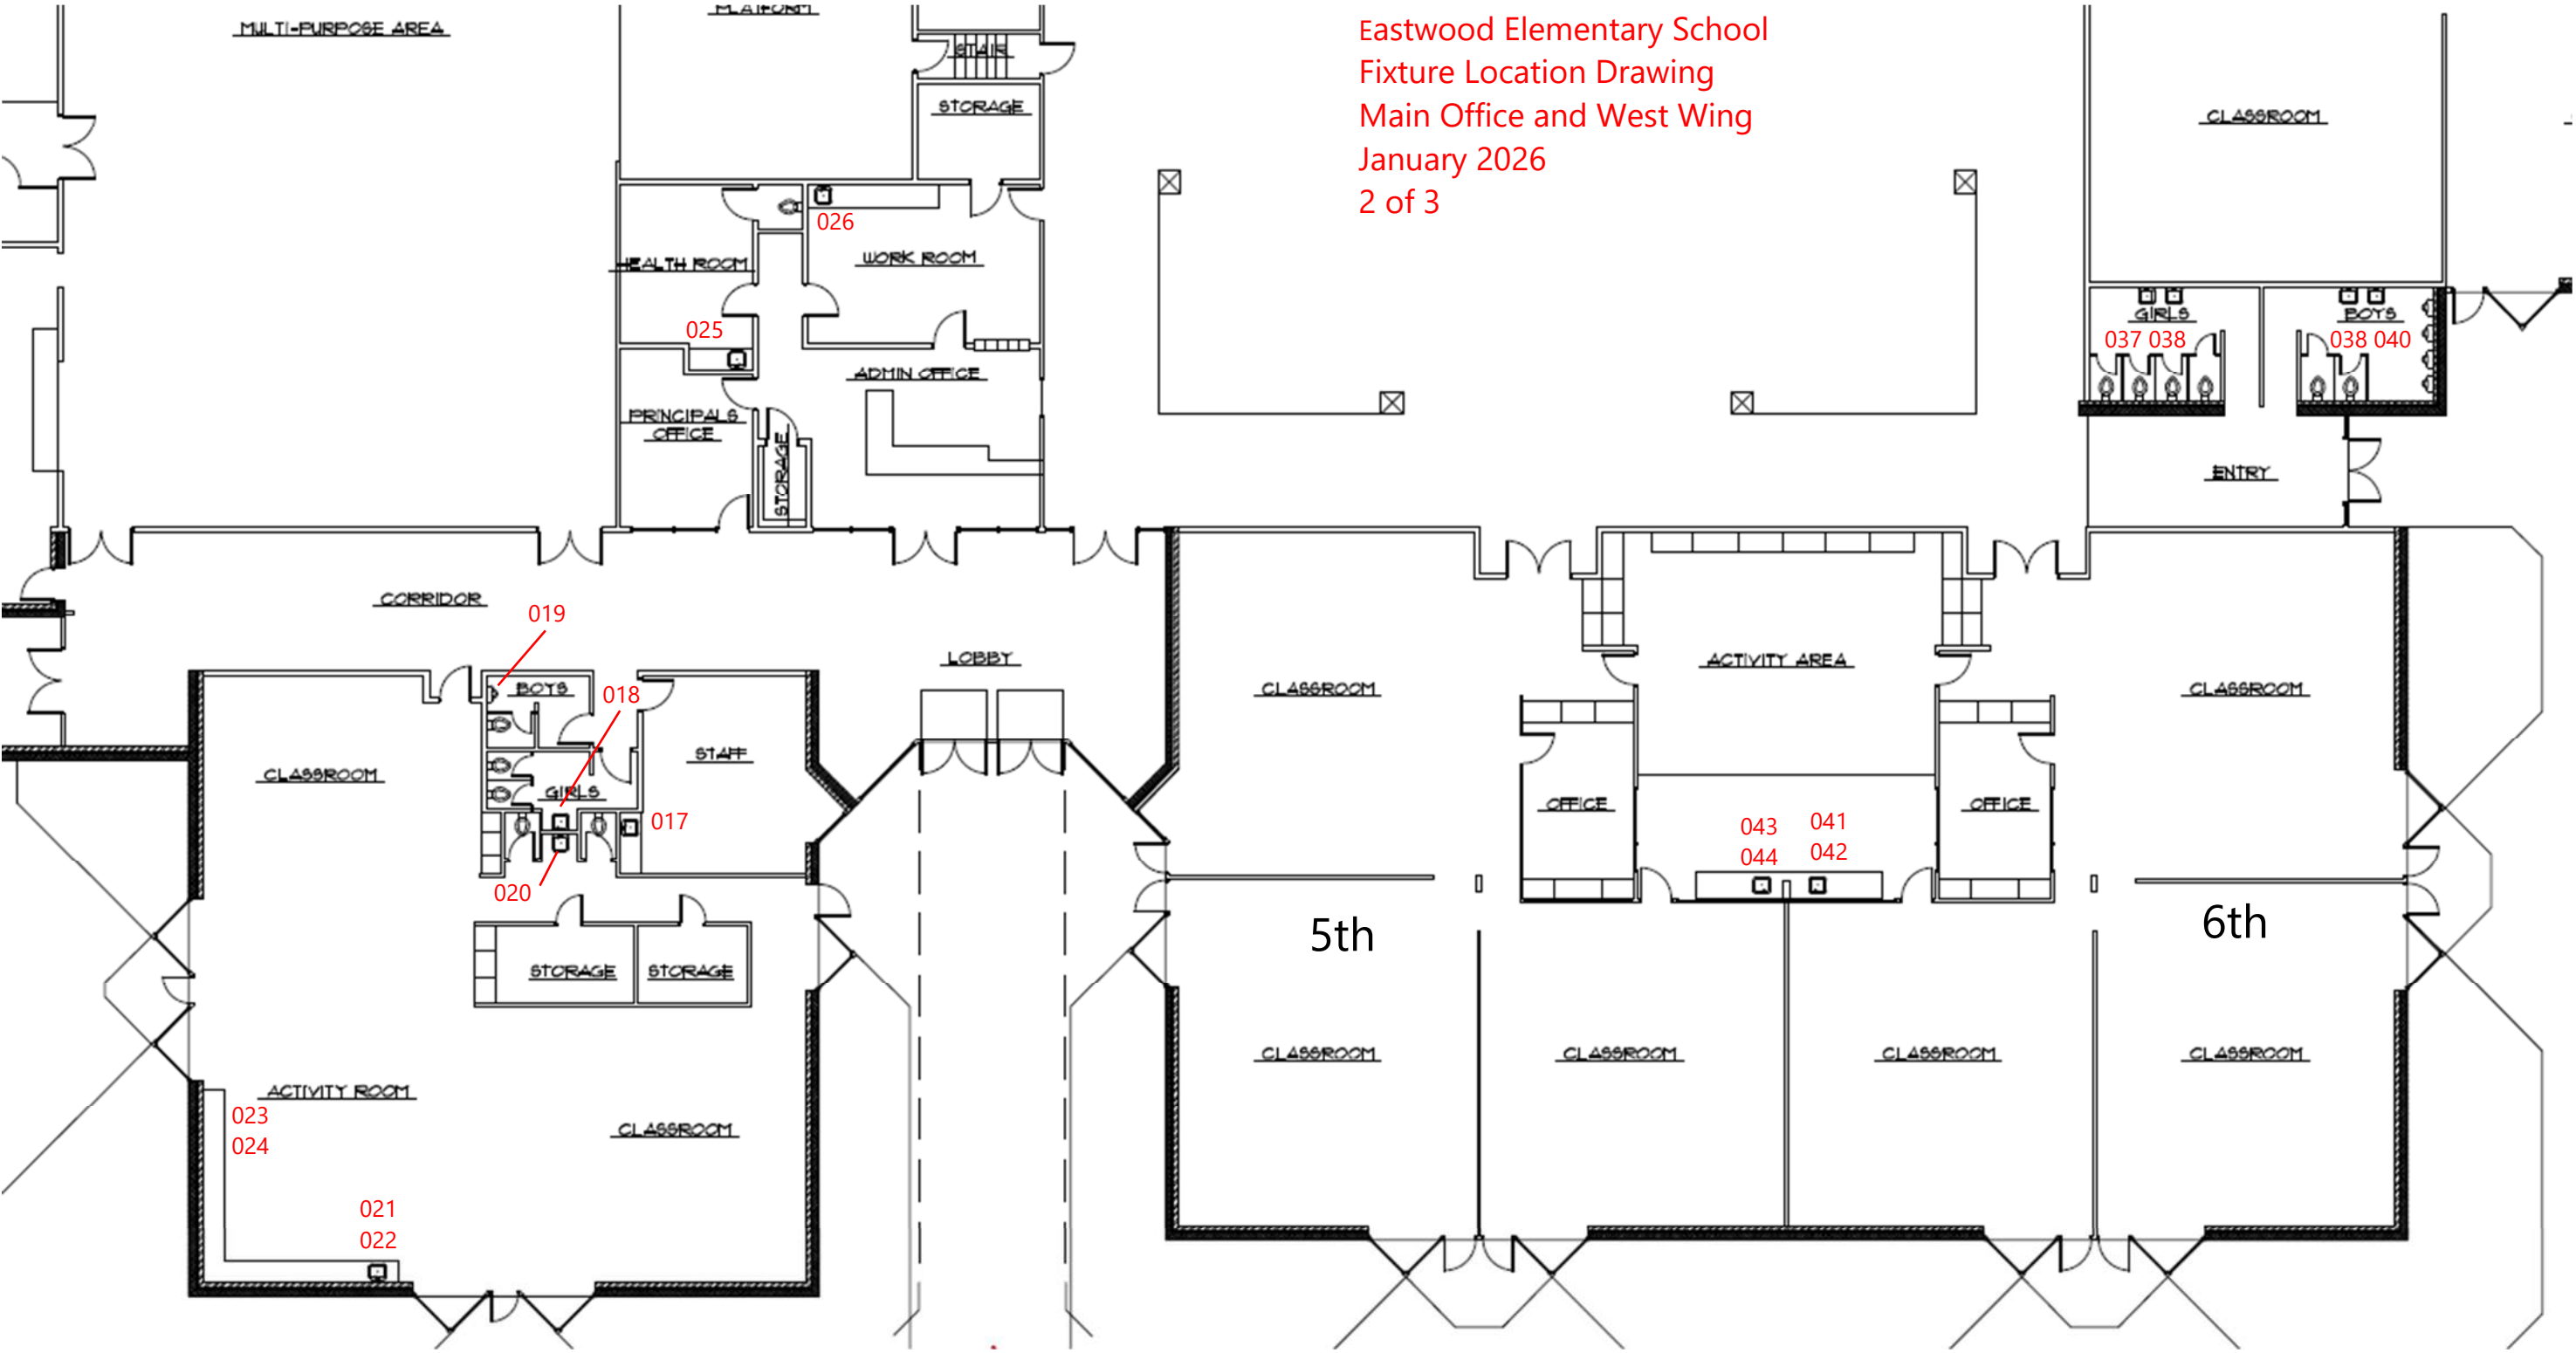



Eastwood Elementary School
Fixture Location Drawing
South and East Wings
January 2026
3 of 3

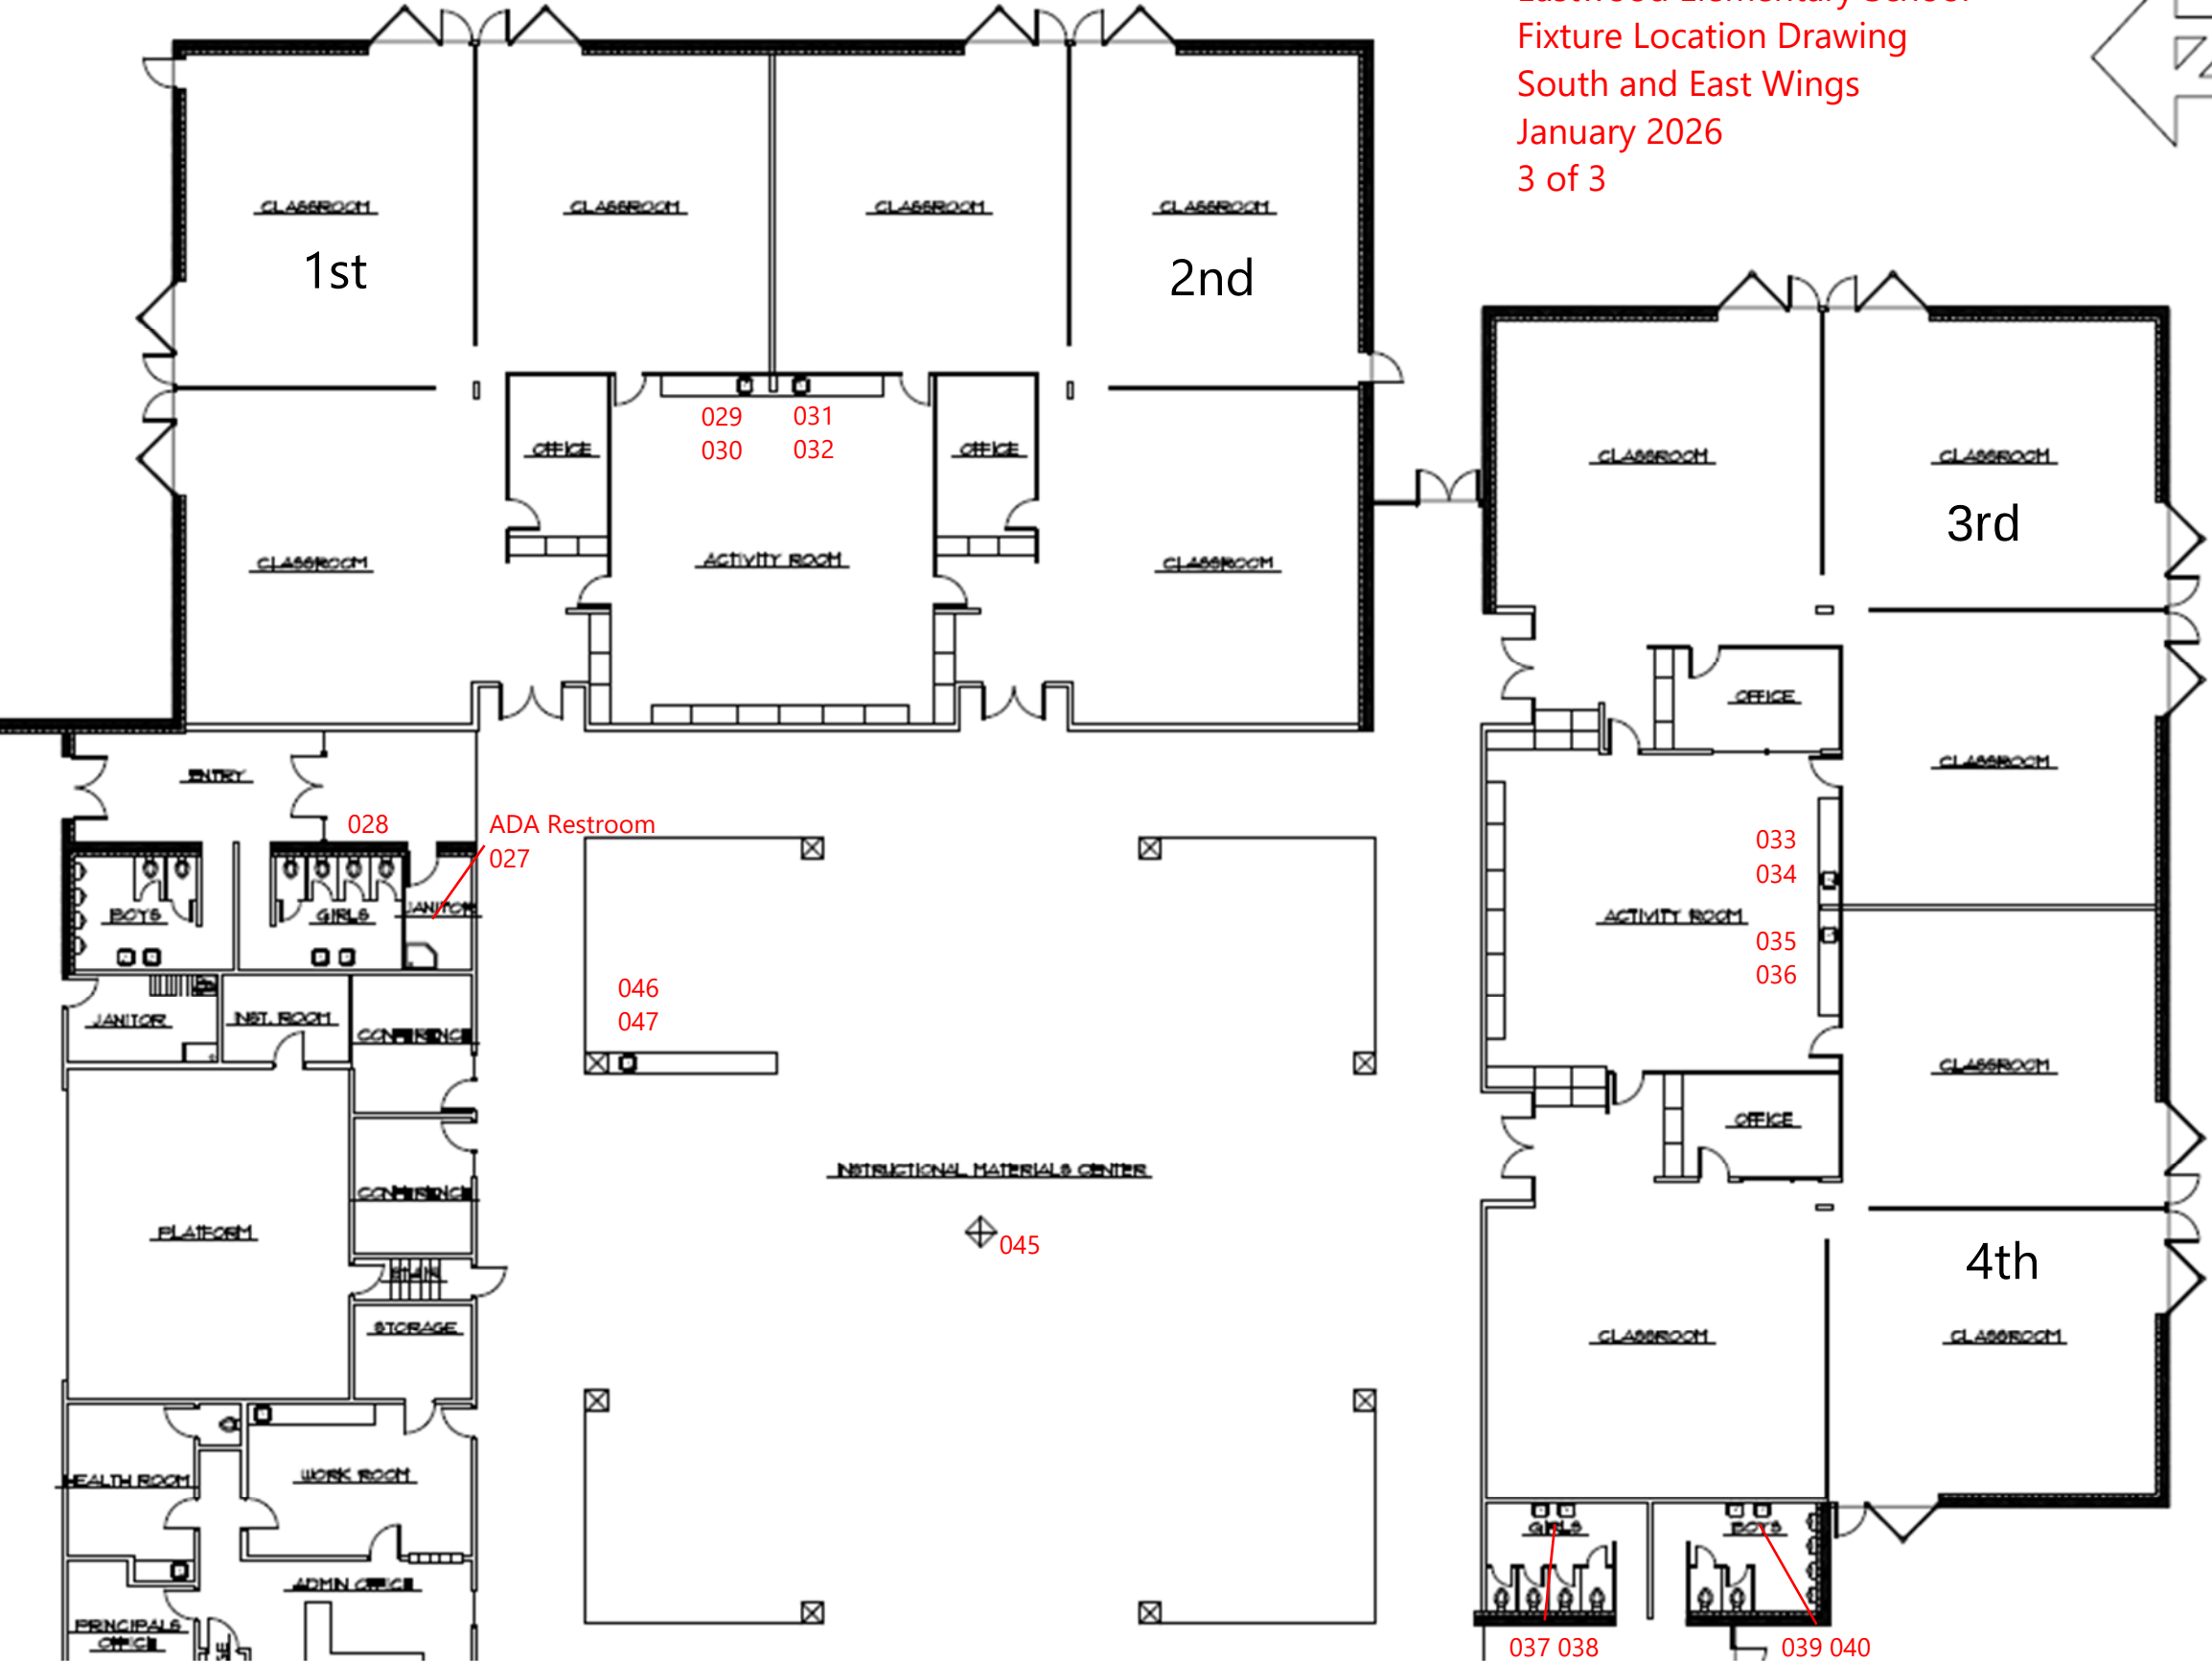

EASTWOOD Gym

- 001 - Water Bottle Filler
- 002 - Drinking Fountain Left
- 003 - Drinking Fountain Right

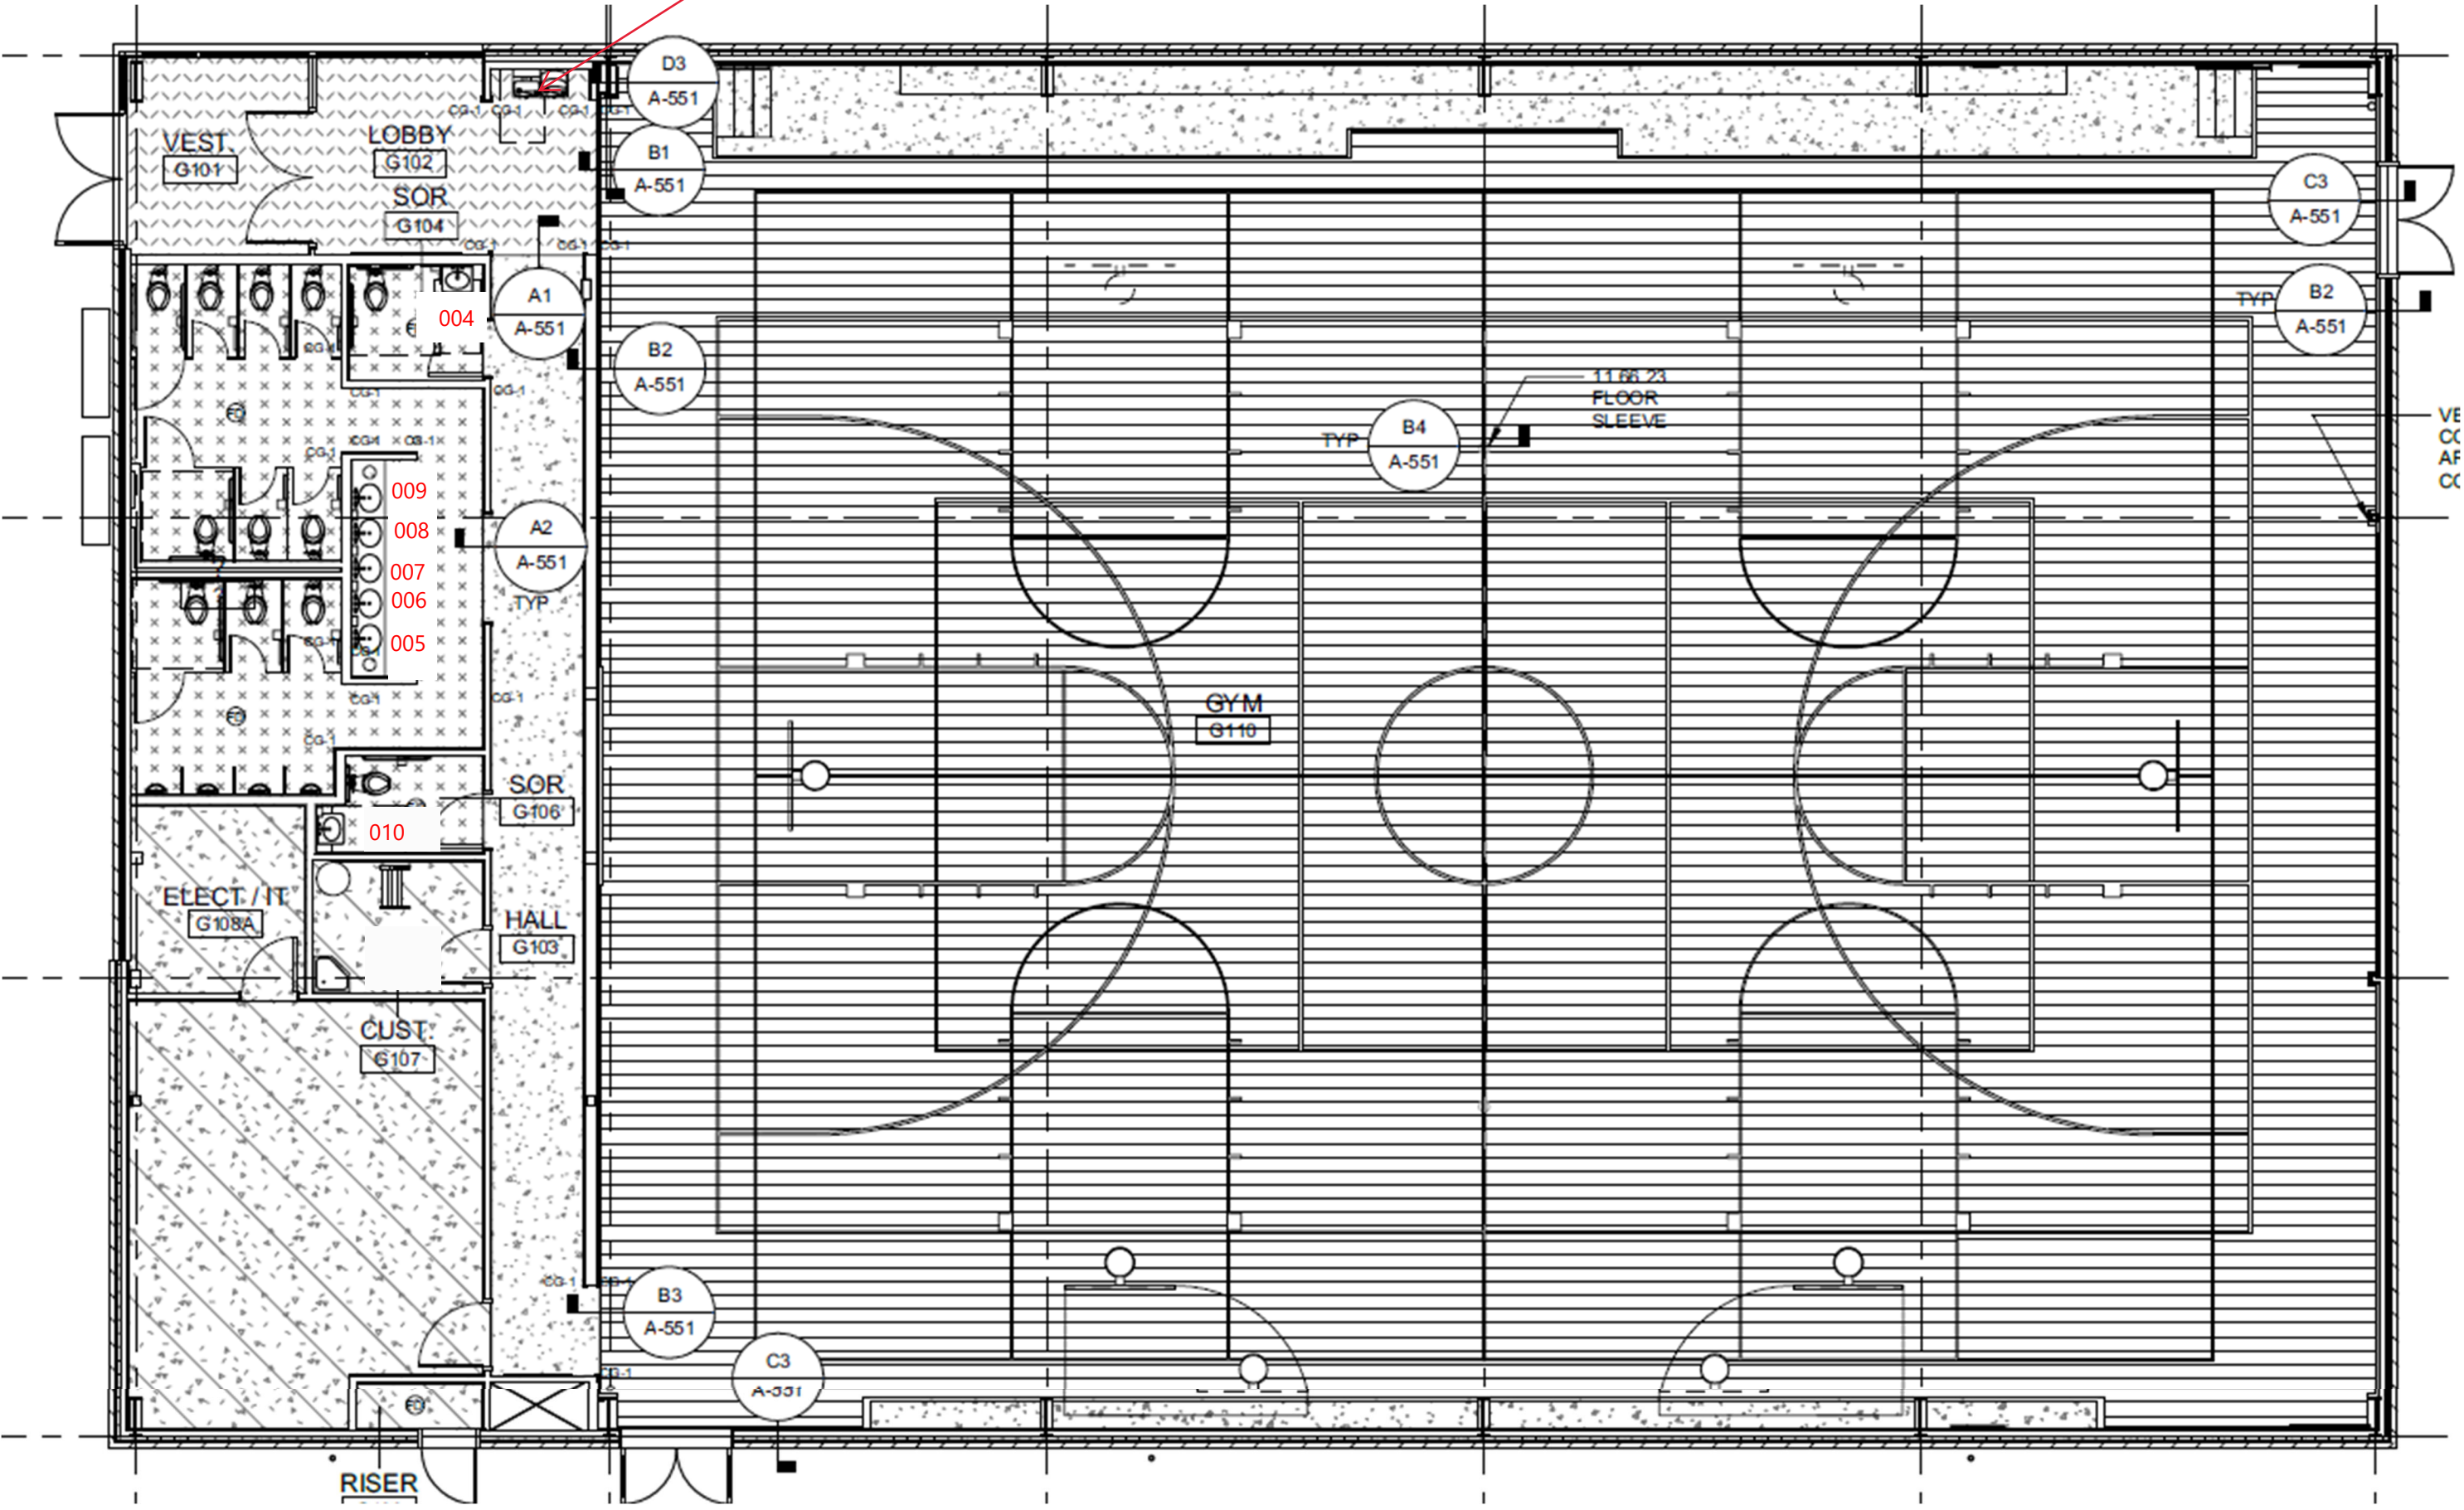

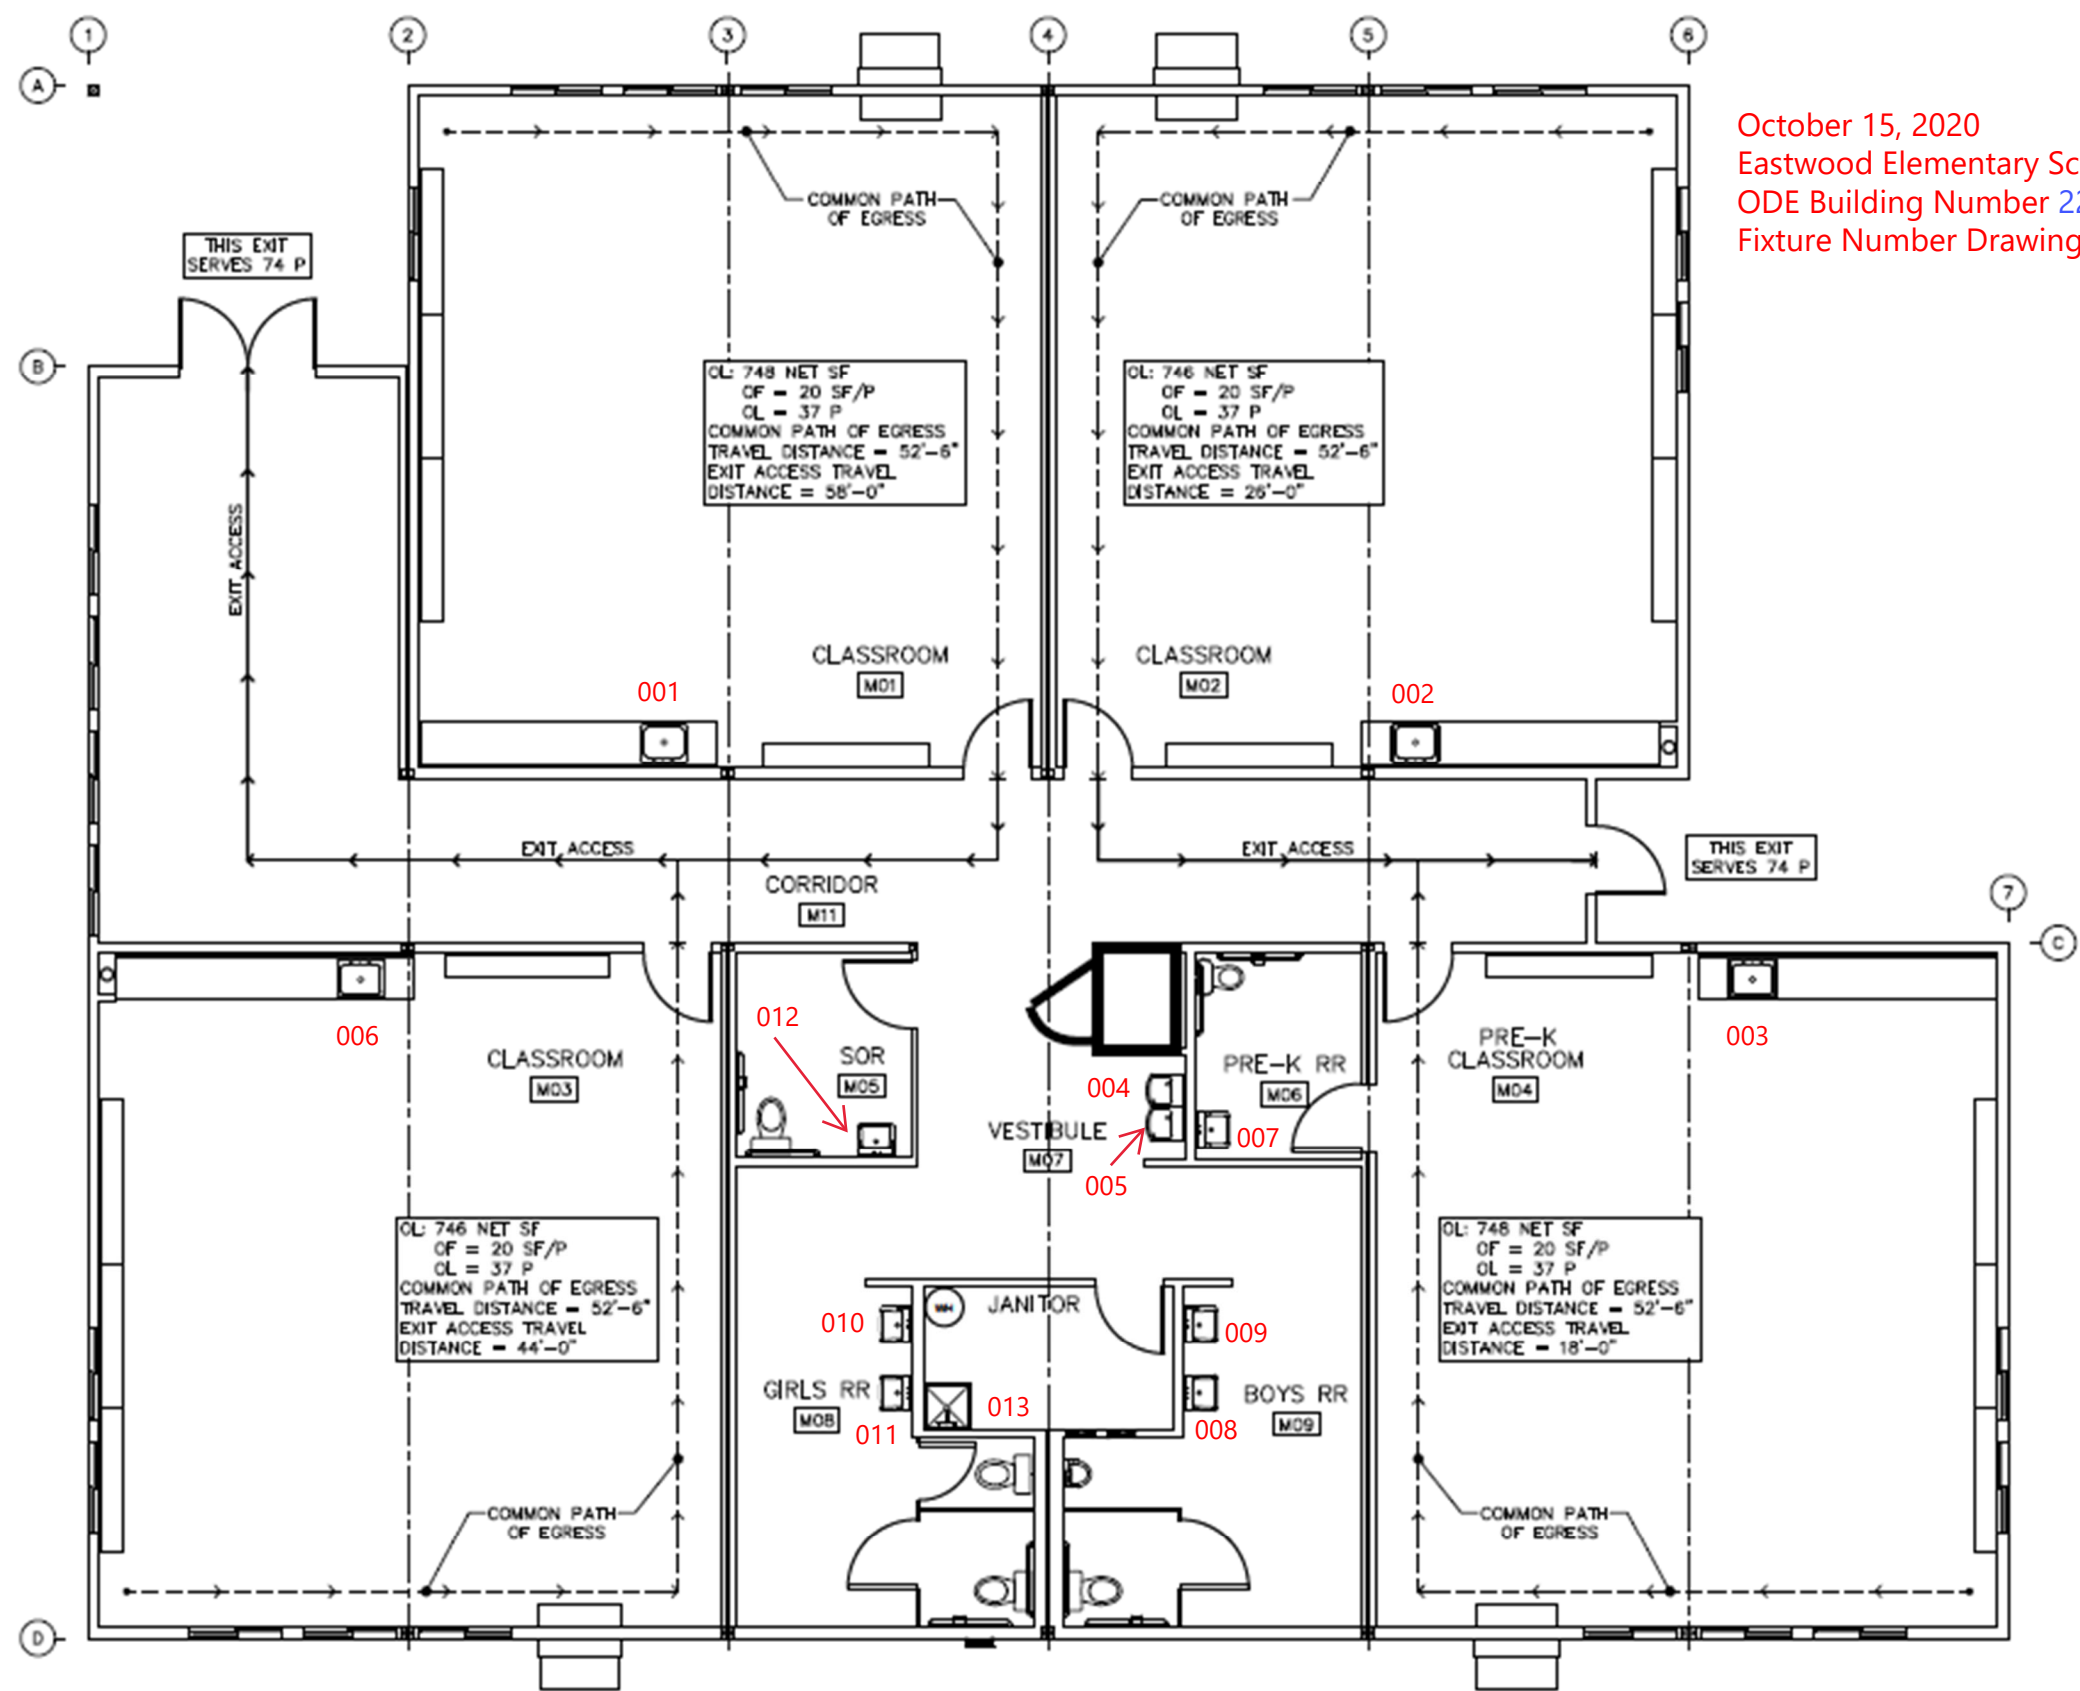

October 15, 2020
Eastwood Elementary School - Modular Building
ODE Building Number 22390505
Fixture Number Drawing

Laboratory Analytical Reports

Main Building



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Friday, December 12, 2025

Dale Voeller

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

RE: A5L1448 - Hillsboro School District - Eastwood ES/25012385

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A5L1448, which was received by the laboratory on 11/26/2025 at 11:20:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information

Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.

(See Cooler Receipt Form for details)

Default Cooler 18.3 degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

ANALYTICAL REPORT FOR SAMPLES**SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390500-001KF25A	A5L1448-01	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-002BF25A	A5L1448-02	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-003KF25A	A5L1448-03	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-004KF25A	A5L1448-04	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-005KF25A	A5L1448-05	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-006DW25A	A5L1448-06	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-009BF25A	A5L1448-07	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-010BF25A	A5L1448-08	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-011BF25A	A5L1448-09	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-012BF25A	A5L1448-10	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-013WB25A	A5L1448-11	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-014DW25A	A5L1448-12	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-015DW25A	A5L1448-13	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-016WB25A	A5L1448-14	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-017SF25A	A5L1448-15	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-018BF25A	A5L1448-16	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-019BF25A	A5L1448-17	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-020BF25A	A5L1448-18	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-022CF25A	A5L1448-19	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-023DW25A	A5L1448-20	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-024CF25A	A5L1448-21	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-025NS25A	A5L1448-22	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-026SF25A	A5L1448-23	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-027BF25A	A5L1448-24	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-028DW25A	A5L1448-25	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-029DW25A	A5L1448-26	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-030CF25A	A5L1448-27	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-031DW25A	A5L1448-28	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-032CF25A	A5L1448-29	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-033DW25A	A5L1448-30	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-034CF25A	A5L1448-31	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-035DW25A	A5L1448-32	Drinking Water	11/22/25 00:00	11/26/25 11:20

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A5L1448 - 12 12 25 1528

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390500-036CF25A	A5L1448-33	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-037BF25A	A5L1448-34	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-038BF25A	A5L1448-35	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-039BF25A	A5L1448-36	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-040BF25A	A5L1448-37	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-041DW25A	A5L1448-38	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-042CF25A	A5L1448-39	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-043DW25A	A5L1448-40	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-045SF25A	A5L1448-41	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-046DW25A	A5L1448-42	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390500-047CF25A	A5L1448-43	Drinking Water	11/22/25 00:00	11/26/25 11:20

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390500-001KF25A (A5L1448-01)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	9.70	---	0.200	ug/L	1	12/10/25 15:12	EPA 200.8	
22390500-002BF25A (A5L1448-02)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	3.71	---	0.200	ug/L	1	12/10/25 15:18	EPA 200.8	
22390500-003KF25A (A5L1448-03)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	4.52	---	0.200	ug/L	1	12/10/25 15:20	EPA 200.8	
22390500-004KF25A (A5L1448-04)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	7.27	---	0.200	ug/L	1	12/10/25 15:21	EPA 200.8	
22390500-005KF25A (A5L1448-05)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	3.07	---	0.200	ug/L	1	12/10/25 15:23	EPA 200.8	
22390500-006DW25A (A5L1448-06)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	0.391	---	0.200	ug/L	1	12/10/25 15:25	EPA 200.8	
22390500-009BF25A (A5L1448-07)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	0.909	---	0.200	ug/L	1	12/10/25 15:31	EPA 200.8	
22390500-010BF25A (A5L1448-08)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	1.25	---	0.200	ug/L	1	12/10/25 15:32	EPA 200.8	
22390500-011BF25A (A5L1448-09)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	1.61	---	0.200	ug/L	1	12/10/25 15:34	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Eastwood ES/25012385**Project Manager: **Dale Voeller****Report ID:****A5L1448 - 12 12 25 1528****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390500-012BF25A (A5L1448-10)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	0.493	---	0.200	ug/L	1	12/10/25 15:36	EPA 200.8	
22390500-013WB25A (A5L1448-11)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	0.265	---	0.200	ug/L	1	12/10/25 15:38	EPA 200.8	
22390500-014DW25A (A5L1448-12)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	0.294	---	0.200	ug/L	1	12/10/25 15:40	EPA 200.8	
22390500-015DW25A (A5L1448-13)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	0.322	---	0.200	ug/L	1	12/10/25 15:42	EPA 200.8	
22390500-016WB25A (A5L1448-14)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	ND	---	0.200	ug/L	1	12/10/25 15:43	EPA 200.8	
22390500-017SF25A (A5L1448-15)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	1.24	---	0.200	ug/L	1	12/10/25 15:45	EPA 200.8	
22390500-018BF25A (A5L1448-16)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	3.69	---	0.200	ug/L	1	12/10/25 15:47	EPA 200.8	
22390500-019BF25A (A5L1448-17)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	3.56	---	0.200	ug/L	1	12/10/25 15:53	EPA 200.8	
22390500-020BF25A (A5L1448-18)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	3.57	---	0.200	ug/L	1	12/10/25 15:54	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Eastwood ES/25012385**Project Manager: **Dale Voeller****Report ID:****A5L1448 - 12 12 25 1528****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390500-022CF25A (A5L1448-19)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	0.435	---	0.200	ug/L	1	12/10/25 15:56	EPA 200.8	
22390500-023DW25A (A5L1448-20)				Matrix: Drinking Water				
Batch: 25L0371								
Lead	2.45	---	0.200	ug/L	1	12/10/25 15:58	EPA 200.8	
22390500-024CF25A (A5L1448-21)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	1.76	---	0.200	ug/L	1	12/10/25 16:06	EPA 200.8	
22390500-025NS25A (A5L1448-22)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	1.67	---	0.200	ug/L	1	12/10/25 16:15	EPA 200.8	
22390500-026SF25A (A5L1448-23)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	2.80	---	0.200	ug/L	1	12/10/25 16:17	EPA 200.8	
22390500-027BF25A (A5L1448-24)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	0.237	---	0.200	ug/L	1	12/10/25 16:19	EPA 200.8	
22390500-028DW25A (A5L1448-25)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	1.85	---	0.200	ug/L	1	12/10/25 16:20	EPA 200.8	
22390500-029DW25A (A5L1448-26)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	0.949	---	0.200	ug/L	1	12/10/25 16:22	EPA 200.8	
22390500-030CF25A (A5L1448-27)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	0.806	---	0.200	ug/L	1	12/10/25 16:24	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**
4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**
Project Number: **Eastwood ES/25012385**
Project Manager: **Dale Voeller****Report ID:**
A5L1448 - 12 12 25 1528**ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390500-031DW25A (A5L1448-28) Matrix: Drinking Water								
Batch: 25L0382								
Lead	1.60	---	0.200	ug/L	1	12/10/25 16:26	EPA 200.8	
22390500-032CF25A (A5L1448-29) Matrix: Drinking Water								
Batch: 25L0382								
Lead	0.726	---	0.200	ug/L	1	12/10/25 16:28	EPA 200.8	
22390500-033DW25A (A5L1448-30) Matrix: Drinking Water								
Batch: 25L0382								
Lead	1.81	---	0.200	ug/L	1	12/10/25 16:30	EPA 200.8	
22390500-034CF25A (A5L1448-31) Matrix: Drinking Water								
Batch: 25L0382								
Lead	0.953	---	0.200	ug/L	1	12/10/25 16:31	EPA 200.8	
22390500-035DW25A (A5L1448-32) Matrix: Drinking Water								
Batch: 25L0382								
Lead	1.81	---	0.200	ug/L	1	12/10/25 16:37	EPA 200.8	
22390500-036CF25A (A5L1448-33) Matrix: Drinking Water								
Batch: 25L0382								
Lead	0.913	---	0.200	ug/L	1	12/10/25 16:39	EPA 200.8	
22390500-037BF25A (A5L1448-34) Matrix: Drinking Water								
Batch: 25L0382								
Lead	0.945	---	0.200	ug/L	1	12/10/25 16:41	EPA 200.8	
22390500-038BF25A (A5L1448-35) Matrix: Drinking Water								
Batch: 25L0382								
Lead	0.537	---	0.200	ug/L	1	12/10/25 16:43	EPA 200.8	
22390500-039BF25A (A5L1448-36) Matrix: Drinking Water								
Batch: 25L0382								
Lead	0.938	---	0.200	ug/L	1	12/10/25 16:44	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390500-040BF25A (A5L1448-37)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	0.774	---	0.200	ug/L	1	12/10/25 16:46	EPA 200.8	
22390500-041DW25A (A5L1448-38)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	1.10	---	0.200	ug/L	1	12/10/25 16:48	EPA 200.8	
22390500-042CF25A (A5L1448-39)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	5.41	---	0.200	ug/L	1	12/10/25 16:50	EPA 200.8	
22390500-043DW25A (A5L1448-40)				Matrix: Drinking Water				
Batch: 25L0382								
Lead	0.651	---	0.200	ug/L	1	12/10/25 16:52	EPA 200.8	
22390500-045SF25A (A5L1448-41)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	9.54	---	0.200	ug/L	1	12/10/25 17:29	EPA 200.8	
22390500-046DW25A (A5L1448-42)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	2.38	---	0.200	ug/L	1	12/10/25 17:31	EPA 200.8	
22390500-047CF25A (A5L1448-43)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	7.40	---	0.200	ug/L	1	12/10/25 17:33	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 25L0371 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (25L0371-BLK1)		Prepared: 12/10/25 11:26 Analyzed: 12/10/25 15:09										
<u>EPA 200.8</u>												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (25L0371-BS1)		Prepared: 12/10/25 11:26 Analyzed: 12/10/25 15:10										
<u>EPA 200.8</u>												
Lead	15.2	---	0.201	ug/L	1	15.0	---	101	85 - 115%	---	---	
Duplicate (25L0371-DUP1)		Prepared: 12/10/25 11:26 Analyzed: 12/10/25 15:14										
<u>QC Source Sample: 22390500-001KF25A (A5L1448-01)</u>												
<u>EPA 200.8</u>												
Lead	9.93	---	0.200	ug/L	1	---	9.70	---	---	2	20%	
Matrix Spike (25L0371-MS1)		Prepared: 12/10/25 11:26 Analyzed: 12/10/25 15:16										
<u>QC Source Sample: 22390500-001KF25A (A5L1448-01)</u>												
<u>EPA 200.8</u>												
Lead	24.8	---	0.201	ug/L	1	15.0	9.70	101	70 - 130%	---	---	
Matrix Spike (25L0371-MS2)		Prepared: 12/10/25 11:26 Analyzed: 12/10/25 16:00										
<u>QC Source Sample: 22390500-023DW25A (A5L1448-20)</u>												
<u>EPA 200.8</u>												
Lead	17.0	---	0.201	ug/L	1	15.0	2.45	97	70 - 130%	---	---	
Batch 25L0382 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (25L0382-BLK1)		Prepared: 12/10/25 13:00 Analyzed: 12/10/25 16:02										
<u>EPA 200.8</u>												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (25L0382-BS1)		Prepared: 12/10/25 13:00 Analyzed: 12/10/25 16:04										
<u>EPA 200.8</u>												
Lead	15.0	---	0.201	ug/L	1	15.0	---	100	85 - 115%	---	---	
Duplicate (25L0382-DUP1)		Prepared: 12/10/25 13:00 Analyzed: 12/10/25 16:07										
<u>QC Source Sample: 22390500-024CF25A (A5L1448-21)</u>												

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 25L0382 - EPA 200.8 Direct Analysis							Drinking Water					
Duplicate (25L0382-DUP1)			Prepared: 12/10/25 13:00		Analyzed: 12/10/25 16:07							
<u>QC Source Sample: 22390500-024CF25A (A5L1448-21)</u>												
<u>EPA 200.8</u>												
Lead	1.75	---	0.200	ug/L	1	---	1.76	---	---	0.4	20%	
Matrix Spike (25L0382-MS1)			Prepared: 12/10/25 13:00		Analyzed: 12/10/25 16:09							
<u>QC Source Sample: 22390500-024CF25A (A5L1448-21)</u>												
<u>EPA 200.8</u>												
Lead	17.8	---	0.201	ug/L	1	15.0	1.76	107	70 - 130%	---	---	
Matrix Spike (25L0382-MS2)			Prepared: 12/10/25 13:00		Analyzed: 12/10/25 16:54							
<u>QC Source Sample: 22390500-043DW25A (A5L1448-40)</u>												
<u>EPA 200.8</u>												
Lead	15.9	---	0.201	ug/L	1	15.0	0.651	102	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 25L0384 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (25L0384-BLK1)		Prepared: 12/10/25 13:35 Analyzed: 12/10/25 16:59										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (25L0384-BS1)		Prepared: 12/10/25 13:35 Analyzed: 12/10/25 17:01										
EPA 200.8												
Lead	15.2	---	0.201	ug/L	1	15.0	---	101	85 - 115%	---	---	
Matrix Spike (25L0384-MS2)		Prepared: 12/10/25 13:35 Analyzed: 12/10/25 17:35										
QC Source Sample: 22390500-047CF25A (A5L1448-43)												
EPA 200.8												
Lead	22.3	---	0.201	ug/L	1	15.0	7.40	99	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 25L0371							
A5L1448-01	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-02	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-03	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-04	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-05	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-06	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-07	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-08	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-09	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-10	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-11	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-12	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-13	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-14	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-15	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-16	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-17	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-18	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-19	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
A5L1448-20	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 11:26	10mL/10mL	10mL/10mL	1.00
Batch: 25L0382							
A5L1448-21	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-22	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-23	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-24	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-25	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-26	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-27	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-28	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-29	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-30	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-31	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-32	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-33	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-34	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-35	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Eastwood ES/25012385**Project Manager: **Dale Voeller****Report ID:****A5L1448 - 12 12 25 1528****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
A5L1448-36	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-37	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-38	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-39	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
A5L1448-40	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:00	10mL/10mL	10mL/10mL	1.00
Batch: 25L0384							
A5L1448-41	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1448-42	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1448-43	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A5L1448 - 12 12 25 1528

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or "" (blank) designation.

"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.

"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.

" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A5L1448 - 12 12 25 1528

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentration of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A5L1448 - 12 12 25 1528

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Eastwood ES/25012385**Project Manager: **Dale Voeller****Report ID:****A5L1448 - 12 12 25 1528****Lead in Drinking Water Testing Program****A5L1448**Date Collected: 11/22/25Apex Project: 25012385 / 0001School Name: Eastwood Elementary SchoolBuilding: Main Building - Round 1Building Number: 22390500Analysis Requested: Lead (Pb) in Drinking WaterEmail Results To: dale.voeller@apexcos.comTurnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	001	22390500-001KF25A	Kitchen pot filler - first draw
2	002	22390500-002BF25A	Kitchen restroom, handwash sink
3	003	22390500-003KF25A	Kitchen, north wall triple sink - left faucet
4	004	22390500-004KF25A	Kitchen, north wall triple sink - right faucet
5	005	22390500-005KF25A	Kitchen, south prep island sink faucet
6	006	22390500-006DW25A	Cafeteria drinking fountain
7	007		PE Office (old boys locker room) handwash sink - not sampled
8	008		Cafeteria storage (old girls locker room) handwash sink - not sampled
9	009	22390500-009BF25A	Girls RR at NE entry - left sink
10	010	22390500-010BF25A	Girls RR at NE entry - right sink
11	011	22390500-011BF25A	Boys RR at NE entry - right sink
12	012	22390500-012BF25A	Boys RR at NE entry - right sink
13	013	22390500-013WB25A	Kindergarten hall, water bottle filler
14	014	22390500-014DW25A	Kindergarten hall, drinking fountain - left
15	015	22390500-015DW25A	Kindergarten hall, drinking fountain - right
16	016	22390500-016WB25A	Cafeteria water bottle filler
17	017	22390500-017SF25A	Faculty break room sink
18	018	22390500-018BF25A	Womens staff restroom sink
19	019	22390500-019BF25A	Mens staff restroom sink
20	020	22390500-020BF25A	Kindergarten pod restroom sink
21	021		Room 16 west sink drinking fountain - not working
22	022	22390500-022CF25A	Room 16 west sink classroom faucet
23	023	22390500-023DW25A	Room 16 north sink drinking fountain
24	024	22390500-024CF25A	Room 16 north sink classroom faucet
25	025	22390500-025NS25A	Health Room sink
26	026	22390500-026SF25A	Main office work room sink
27	027	22390500-027BF25A	ADA restroom across from 1 st grade pod

1 of 2

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

Lead in Drinking Water Testing Program

A5L1448

Hillsboro School District

Date Collected: 10/22/2025

School Name: Eastwood Elementary School

	Fixture Number	Sample Number	Location / Description
28	028	22390500-028DW25A	Drinking fountain near ADA restroom across from 1 st grade pod
29	029	22390500-029DW25A	1 st /2 nd grade pod activity room, left sink drinking fountain
30	030	22390500-030CF25A	1 st /2 nd grade pod activity room, left sink faucet
31	031	22390500-031DW25A	1 st /2 nd grade pod activity room, right sink drinking fountain
32	032	22390500-032CF25A	1 st /2 nd grade pod activity room, right sink faucet
33	033	22390500-033DW25A	3 rd /4 th grade pod activity room, left sink drinking fountain
34	034	22390500-034CF25A	3 rd /4 th grade pod activity room, left sink faucet
35	035	22390500-035DW25A	3 rd /4 th grade pod activity room, right sink drinking fountain
36	036	22390500-036CF25A	3 rd /4 th grade pod activity room, right sink faucet
37	037	22390500-037BF25A	SW womens restroom – left sink
38	038	22390500-038BF25A	SW womens restroom – right sink
39	039	22390500-039BF25A	SW mens restroom – left sink
40	040	22390500-040BF25A	SW mens restroom – right sink
41	041	22390500-041DW25A	5 th /6 th grade pod activity room, left sink drinking fountain
42	042	22390500-042CF25A	5 th /6 th grade pod activity room, left sink faucet
43	043	22390500-043DW25A	5 th /6 th grade pod activity room, right sink drinking fountain
44	044		5 th /6 th grade pod activity room, right sink faucet – not sampled
45	045	22390500-045SF25A	Media Center, sink at circulation desk
46	046	22390500-046DW25A	Media Center at north center column – drinking fountain
47	047	22390500-047CF25A	Media Center at north center column – sink faucet
48			
49			
50			
51			
52			
53			
54			

Relinquished By/Signature

Date/Time:

11/22/25 7:06 PM

Received By/Signature:

Date/Time:

11/26/25 11:20



2 of 2

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1448 - 12 12 25 1528

APEX LABS COOLER RECEIPT FORM

Client: Apex Co. Element WO#: A5 L1448

Project/Project #: Eastwood Elementary School 25012385/0001

Delivery Info:

Date/time received: 11/16/15 @ 1120 By: AMW

Delivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒

Cooler Inspection Date/time inspected: 11/16/15 @ 1400 By: AMW

Chain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	18.3						
Custody seals? (Y/N)	N						
Received on ice? (Y/N)	N						
Temp. blanks? (Y/N)	N						
Ice type: (Gel/Real/Other)	None						
Condition (In/Out):	Out						

Cooler out of temp? (Y/N) Possible reason why: Drinking Water

Green dots applied to out of temperature samples? Yes ☒ No ☐Out of temperature samples form initiated? Yes ☒ No ☐

Sample Inspection: Date/time inspected: 11/16/15 @ 1745 By: AMW

All samples intact? Yes ☒ No ☐ Comments:Bottle labels/COCs agree? Yes ☒ No ☐ Comments:COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments:Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments:

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A25G271

Comments:

Labeled by:

AMW

Witness:

AMW

Cooler Inspected by:

AMW

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Thursday, January 22, 2026

Dale Voeller

Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239

RE: A6A1300 - Hillsboro School District - Eastwood Elementary School 25012835

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6A1300, which was received by the laboratory on 1/12/2026 at 11:50:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information			
<u>Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.</u>			
(See Cooler Receipt Form for details)			
Default Cooler	19.0	degC	

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1300 - 01 22 26 1222

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390500-007BF26A	A6A1300-01	Drinking Water	01/08/26 00:00	01/12/26 11:50
22390500-008BF26A	A6A1300-02	Drinking Water	01/08/26 00:00	01/12/26 11:50
22390500-021DW26A	A6A1300-03	Drinking Water	01/08/26 00:00	01/12/26 11:50
22390500-044CF26A	A6A1300-04	Drinking Water	01/08/26 00:00	01/12/26 11:50

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC****6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062****Apex Companies, LLC - Portland****4412 S Corbett Ave
Portland, OR 97239**Project: **Hillsboro School District**Project Number: **Eastwood Elementary School**Project Manager: **Dale Voeller****Report ID:****A6A1300 - 01 22 26 1222****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390500-007BF26A (A6A1300-01)				Matrix: Drinking Water				
Batch: 26A0326								
Lead	2.21	---	0.200	ug/L	1	01/15/26 16:34	EPA 200.8	
22390500-008BF26A (A6A1300-02)				Matrix: Drinking Water				
Batch: 26A0326								
Lead	3.14	---	0.200	ug/L	1	01/15/26 16:36	EPA 200.8	
22390500-021DW26A (A6A1300-03)				Matrix: Drinking Water				
Batch: 26A0326								
Lead	2.01	---	0.200	ug/L	1	01/15/26 16:38	EPA 200.8	
22390500-044CF26A (A6A1300-04)				Matrix: Drinking Water				
Batch: 26A0326								
Lead	2.69	---	0.200	ug/L	1	01/15/26 16:40	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A6A1300 - 01 22 26 1222

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26A0326 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26A0326-BLK1)		Prepared: 01/13/26 10:07 Analyzed: 01/15/26 16:10										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26A0326-BS1)		Prepared: 01/13/26 10:07 Analyzed: 01/15/26 16:12										
EPA 200.8												
Lead	14.7	---	0.201	ug/L	1	15.0	---	98	85 - 115%	---	---	

No Client related Batch QC samples analyzed for this batch. See notes page for more information.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6A1300 - 01 22 26 1222

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 26A0326							
A6A1300-01	Drinking Water	EPA 200.8	01/08/26 00:00	01/13/26 10:07	10mL/10mL	10mL/10mL	1.00
A6A1300-02	Drinking Water	EPA 200.8	01/08/26 00:00	01/13/26 10:07	10mL/10mL	10mL/10mL	1.00
A6A1300-03	Drinking Water	EPA 200.8	01/08/26 00:00	01/13/26 10:07	10mL/10mL	10mL/10mL	1.00
A6A1300-04	Drinking Water	EPA 200.8	01/08/26 00:00	01/13/26 10:07	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School
Project Manager: Dale Voeller

Report ID:

A6A1300 - 01 22 26 1222

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A6A1300 - 01 22 26 1222

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or " " (blank) designation.
"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.
"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.
" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.
" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6A1300 - 01 22 26 1222

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentration of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A6A1300 - 01 22 26 1222

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses. In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1300 - 01 22 26 1222

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1300 - 01 22 26 1222

Lead in Drinking Water Testing Program

Date Collected: 1/8/2026

Apex Project: ~~25012385 / 0001~~

School Name: Eastwood Elementary School

Building: Main Building - Round 2

Building Number: 22390500

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: dale.voeller@apexcos.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	007	22390500-007BF26A	PE Office (old boys locker room) handwash sink
2	008	22390500-008BF26A	Cafeteria storage (old girls locker room) handwash sink
3	021	22390500-021DW26A	Room 16 west sink drinking fountain
4	044	22390500-044CF26A	5 th /6 th grade pod activity room, right sink faucet
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

Relinquished By/Signature:

Date/Time: 1/10/26 @ 3:38 PM

Received By/Signature:

Date/Time: 1/12/26 11:50

1 of 1

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1300 - 01 22 26 1222

APEX LABS COOLER RECEIPT FORM

Client: Apex Co. Element WO#: A6 A1300Project/Project #: Eastwood Elementary School / 25012835/0001

Delivery Info:

Date/time received: 1/12/26 @ 11:50 By: AJMDelivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒Cooler Inspection Date/time inspected: 1/12/26 @ 1404 By: AJMChain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>19.0</u>						
Custody seals? (Y/N)	<u>N</u>						
Received on ice? (Y/N)	<u>N</u>						
Temp. blanks? (Y/N)	<u>N</u>						
Ice type: (Gel/Real/Other)	<u>None</u>						
Condition (In/Out)	<u>Out</u>						

Cooler out of temp? (Y/N) Possible reason why: Drinking WatersGreen dots applied to out of temperature samples? Yes ☒ No ☐Out of temperature samples form initiated? Yes ☒ No ☐Sample Inspection: Date/time inspected: 1/12/26 @ 1734 By: KNAll samples intact? Yes ☒ No ☐ Comments: _____Bottle labels/COCs agree? Yes ☒ No ☐ Comments: _____COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: _____Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments: _____

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A256291

Comments: _____

Labeled by:

KN

Witness:

AJM

Cooler Inspected by:

KAM

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Laboratory Analytical Reports

Gymnasium



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Tuesday, December 16, 2025

Dale Voeller

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

RE: A5L1413 - Hillsboro School District - Eastwood ES/25012385

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A5L1413, which was received by the laboratory on 11/26/2025 at 11:20:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information

Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.

(See Cooler Receipt Form for details)

Default Cooler 19.2 degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Eastwood ES/25012385**Project Manager: **Dale Voeller****Report ID:****A5L1413 - 12 16 25 1452****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390506-001WB25A	A5L1413-01	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390506-002DW25A	A5L1413-02	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390506-003DW25A	A5L1413-03	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390506-004BF25A	A5L1413-04	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390506-005BF25A	A5L1413-05	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390506-006BF25A	A5L1413-06	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390506-007BF25A	A5L1413-07	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390506-008BF25A	A5L1413-08	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390506-009BF25A	A5L1413-09	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390506-010BF25A	A5L1413-10	Drinking Water	11/22/25 00:00	11/26/25 11:20

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**Apex Companies, LLC - Portland**4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Eastwood ES/25012385**Project Manager: **Dale Voeller****Report ID:****A5L1413 - 12 16 25 1452****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390506-001WB25A (A5L1413-01)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	ND	---	0.200	ug/L	1	12/10/25 17:03	EPA 200.8	
22390506-002DW25A (A5L1413-02)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	ND	---	0.200	ug/L	1	12/10/25 17:09	EPA 200.8	
22390506-003DW25A (A5L1413-03)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	ND	---	0.200	ug/L	1	12/10/25 17:11	EPA 200.8	
22390506-004BF25A (A5L1413-04)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	ND	---	0.200	ug/L	1	12/10/25 17:12	EPA 200.8	
22390506-005BF25A (A5L1413-05)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	ND	---	0.200	ug/L	1	12/10/25 17:14	EPA 200.8	
22390506-006BF25A (A5L1413-06)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	ND	---	0.200	ug/L	1	12/10/25 17:16	EPA 200.8	
22390506-007BF25A (A5L1413-07)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	ND	---	0.200	ug/L	1	12/10/25 17:22	EPA 200.8	
22390506-008BF25A (A5L1413-08)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	ND	---	0.200	ug/L	1	12/10/25 17:24	EPA 200.8	
22390506-009BF25A (A5L1413-09)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	ND	---	0.200	ug/L	1	12/10/25 17:25	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Eastwood ES/25012385**Project Manager: **Dale Voeller****Report ID:****A5L1413 - 12 16 25 1452****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390506-010BF25A (A5L1413-10)				Matrix: Drinking Water				
Batch: 25L0384								
Lead	0.204	---	0.200	ug/L	1	12/10/25 17:27	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1413 - 12 16 25 1452

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 25L0384 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (25L0384-BLK1)		Prepared: 12/10/25 13:35			Analyzed: 12/10/25 16:59							
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (25L0384-BS1)		Prepared: 12/10/25 13:35			Analyzed: 12/10/25 17:01							
EPA 200.8												
Lead	15.2	---	0.201	ug/L	1	15.0	---	101	85 - 115%	---	---	
Duplicate (25L0384-DUP1)		Prepared: 12/10/25 13:35			Analyzed: 12/10/25 17:05							
QC Source Sample: 22390506-001WB25A (A5L1413-01)												
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	ND	---	---	---	20%	
Matrix Spike (25L0384-MS1)		Prepared: 12/10/25 13:35			Analyzed: 12/10/25 17:07							
QC Source Sample: 22390506-001WB25A (A5L1413-01)												
EPA 200.8												
Lead	14.8	---	0.201	ug/L	1	15.0	ND	99	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A5L1413 - 12 16 25 1452

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
<u>Batch: 25L0384</u>							
A5L1413-01	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1413-02	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1413-03	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1413-04	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1413-05	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1413-06	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1413-07	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1413-08	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1413-09	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1413-10	Drinking Water	EPA 200.8	11/22/25 00:00	12/10/25 13:35	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1413 - 12 16 25 1452

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A5L1413 - 12 16 25 1452

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or "" (blank) designation.

"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.

"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.

" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A5L1413 - 12 16 25 1452

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between $\frac{1}{2}$ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentration of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood ES/25012385**

Project Manager: **Dale Voeller**

Report ID:

A5L1413 - 12 16 25 1452

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1413 - 12 16 25 1452

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

ASL1413 - 12 16 25 1452

Lead in Drinking Water Testing Program

Date Collected: 11/22/2025

PBS Project: 25012385 / 0001

School Name: Eastwood Elementary School

Building: Gymnasium

Building Number: 22390506

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: voeller@pbsusa.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	001	22390506-001WB25A	Entry lobby water bottle filler
2	002	22390506-002DW25A	Entry lobby
3	003	22390506-003DW25A	Entry lobby
4	004	22390506-004BF25A	Family Restroom near lobby
5	005	22390506-005BF25A	Restroom Sinks - Left to Right (1)
6	006	22390506-006BF25A	Restroom Sinks - Left to Right (2)
7	007	22390506-007BF25A	Restroom Sinks - Left to Right (3)
8	008	22390506-008BF25A	Restroom Sinks - Left to Right (4)
9	009	22390506-009BF25A	Restroom Sinks - Left to Right (5)
10	010	22390506-010BF25A	Family Restroom at Janitor's Closet
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

Relinquished By/Signature: [Signature]

Date/Time: 11/24/25 @ 7:06 PM

Received By/Signature: [Signature]

Date/Time: 11/26/25 11:20

1 of 1

Apex Laboratories

[Signature]

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood ES/25012385

Project Manager: Dale Voeller

Report ID:

A5L1413 - 12 16 25 1452

APEX LABS COOLER RECEIPT FORM

Client: Apex Co

Element WO#: A5 L1413

Project/Project #: Eastwood Elementary School 25012385/0001

Delivery Info:

Date/time received: 11/6/15 @ 1:20 By: AM

Delivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒

Cooler Inspection Date/time inspected: 11/6/15 @ 1:40 By: AMW

Chain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	19.2						
Custody seals? (Y/N)	N						
Received on ice? (Y/N)	N						
Temp. blanks? (Y/N)	V						
Ice type: (Gel/Real/Other)	None						
Condition (In/Out):	Out						

Cooler out of temp? (Y/N) Possible reason why: Drinking Waters

Green dots applied to out of temperature samples? Yes ☒ No ☐Out of temperature samples form initiated? Yes ☒ No ☐

Sample Inspection: Date/time inspected: 11/6/15 @ 1:55 By: AMW

All samples intact? Yes ☒ No ☐ Comments:Bottle labels/COCs agree? Yes ☒ No ☐ Comments:COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments:Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments:

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A25677

Comments:

Labeled by: AMW

Witness: AMW

Cooler Inspected by: AMW

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Laboratory Analytical Reports

Modular Classroom Building



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Friday, December 12, 2025

Dale Voeller

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

RE: A5L1200 - Hillsboro School District - Eastwood Elementary School/25012835

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A5L1200, which was received by the laboratory on 11/26/2025 at 11:20:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information

Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.

(See Cooler Receipt Form for details)

Default Cooler 19.2 degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: Eastwood Elementary School
Project Manager: Dale Voeller

Report ID:

A5L1200 - 12 12 25 1215

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390505-001CF25A	A5L1200-01	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390505-002CF25A	A5L1200-02	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390505-003CF25A	A5L1200-03	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390505-006CF25A	A5L1200-04	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390505-007BF25A	A5L1200-05	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390505-008BF25A	A5L1200-06	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390505-009BF25A	A5L1200-07	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390505-010BF25A	A5L1200-08	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390505-011BF25A	A5L1200-09	Drinking Water	11/22/25 00:00	11/26/25 11:20
22390505-012BF25A	A5L1200-10	Drinking Water	11/22/25 00:00	11/26/25 11:20

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School
Project Manager: Dale Voeller

Report ID:

A5L1200 - 12 12 25 1215

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390505-001CF25A (A5L1200-01)				Matrix: Drinking Water				
Batch: 25L0312								
Lead	0.321	---	0.200	ug/L	1	12/09/25 15:54	EPA 200.8	
22390505-002CF25A (A5L1200-02)				Matrix: Drinking Water				
Batch: 25L0312								
Lead	0.491	---	0.200	ug/L	1	12/09/25 15:56	EPA 200.8	
22390505-003CF25A (A5L1200-03)				Matrix: Drinking Water				
Batch: 25L0312								
Lead	0.265	---	0.200	ug/L	1	12/09/25 15:58	EPA 200.8	
22390505-006CF25A (A5L1200-04)				Matrix: Drinking Water				
Batch: 25L0312								
Lead	1.19	---	0.200	ug/L	1	12/09/25 16:03	EPA 200.8	
22390505-007BF25A (A5L1200-05)				Matrix: Drinking Water				
Batch: 25L0312								
Lead	ND	---	0.200	ug/L	1	12/09/25 16:05	EPA 200.8	
22390505-008BF25A (A5L1200-06)				Matrix: Drinking Water				
Batch: 25L0312								
Lead	ND	---	0.200	ug/L	1	12/09/25 16:07	EPA 200.8	
22390505-009BF25A (A5L1200-07)				Matrix: Drinking Water				
Batch: 25L0312								
Lead	ND	---	0.200	ug/L	1	12/09/25 16:09	EPA 200.8	
22390505-010BF25A (A5L1200-08)				Matrix: Drinking Water				
Batch: 25L0335								
Lead	ND	---	0.200	ug/L	1	12/09/25 16:16	EPA 200.8	
22390505-011BF25A (A5L1200-09)				Matrix: Drinking Water				
Batch: 25L0335								
Lead	0.208	---	0.200	ug/L	1	12/09/25 16:25	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Eastwood Elementary School**Project Manager: **Dale Voeller****Report ID:****A5L1200 - 12 12 25 1215****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390505-012BF25A (A5L1200-10)				Matrix: Drinking Water				
Batch: 25L0335								
Lead	0.453	---	0.200	ug/L	1	12/09/25 16:27	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School
Project Manager: Dale Voeller

Report ID:

A5L1200 - 12 12 25 1215

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 25L0312 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (25L0312-BLK1)		Prepared: 12/09/25 09:37 Analyzed: 12/09/25 15:19										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (25L0312-BS1)		Prepared: 12/09/25 09:37 Analyzed: 12/09/25 15:21										
EPA 200.8												
Lead	15.7	---	0.201	ug/L	1	15.0	---	105	85 - 115%	---	---	
Matrix Spike (25L0312-MS2)		Prepared: 12/09/25 09:37 Analyzed: 12/09/25 16:11										
QC Source Sample: 22390505-009BF25A (A5L1200-07)												
EPA 200.8												
Lead	15.1	---	0.201	ug/L	1	15.0	ND	101	70 - 130%	---	---	
Batch 25L0335 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (25L0335-BLK1)		Prepared: 12/09/25 13:35 Analyzed: 12/09/25 16:12										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (25L0335-BS1)		Prepared: 12/09/25 13:35 Analyzed: 12/09/25 16:14										
EPA 200.8												
Lead	15.4	---	0.201	ug/L	1	15.0	---	102	85 - 115%	---	---	
Duplicate (25L0335-DUP1)		Prepared: 12/09/25 13:35 Analyzed: 12/09/25 16:18										
QC Source Sample: 22390505-010BF25A (A5L1200-08)												
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	0.109	---	---	***	20%	
Matrix Spike (25L0335-MS1)		Prepared: 12/09/25 13:35 Analyzed: 12/09/25 16:20										
QC Source Sample: 22390505-010BF25A (A5L1200-08)												
EPA 200.8												
Lead	14.9	---	0.201	ug/L	1	15.0	0.109	99	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland4412 S Corbett Ave
Portland, OR 97239Project: **Hillsboro School District**Project Number: **Eastwood Elementary School**Project Manager: **Dale Voeller****Report ID:****A5L1200 - 12 12 25 1215****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
Batch: 25L0312							
A5L1200-01	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 09:37	10mL/10mL	10mL/10mL	1.00
A5L1200-02	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 09:37	10mL/10mL	10mL/10mL	1.00
A5L1200-03	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 09:37	10mL/10mL	10mL/10mL	1.00
A5L1200-04	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 09:37	10mL/10mL	10mL/10mL	1.00
A5L1200-05	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 09:37	10mL/10mL	10mL/10mL	1.00
A5L1200-06	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 09:37	10mL/10mL	10mL/10mL	1.00
A5L1200-07	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 09:37	10mL/10mL	10mL/10mL	1.00
Batch: 25L0335							
A5L1200-08	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1200-09	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 13:35	10mL/10mL	10mL/10mL	1.00
A5L1200-10	Drinking Water	EPA 200.8	11/22/25 00:00	12/09/25 13:35	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School
Project Manager: Dale Voeller

Report ID:

A5L1200 - 12 12 25 1215

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A5L1200 - 12 12 25 1215

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or "" (blank) designation.

"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.

"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.

" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A5L1200 - 12 12 25 1215

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between $\frac{1}{2}$ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentration of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A5L1200 - 12 12 25 1215

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A5L1200 - 12 12 25 1215

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School
Project Manager: Dale Voeller

Report ID:

A5L1200 - 12 12 25 1215

Lead in Drinking Water Testing Program

A5L1200

Date Collected: 11/22/2025

PBS Project: 25012385 / 0001

School Name: Eastwood Elementary School

Building: Modular Classroom Building

Building Number: 22390505

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: voeller@pbsusa.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	001	22390505-001CF25A	Room M-1 classroom faucet
2	002	22390505-002CF25A	Room M-2 classroom faucet
3	003	22390505-003CF25A	Room M-4 classroom faucet
4	004		Drinking fountain at restroom – left (not working)
5	005		Drinking fountain at restroom – right (not working)
6	006	22390505-006CF25A	Room M-3 classroom faucet
7	007	22390505-007BF25A	Room M-4 restroom faucet
8	008	22390505-008BF25A	Boys restroom sink faucet – left
9	009	22390505-009BF25A	Boys restroom sink faucet – right
10	010	22390505-010BF25A	Girls restroom sink faucet – left
11	011	22390505-011BF25A	Girls restroom sink faucet – right
12	012	22390505-012BF25A	Staff restroom sink faucet
13			
14			
15			
16			
17			
18			
19			
20			

Relinquished By/Signature Dale Voeller

Date/Time: 11/24/25 @ 7:06 PM

Received By/Signature [Signature]

Date/Time: 11/26/25 11:20

1 of 1

Apex Laboratories

[Signature]

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A5L1200 - 12 12 25 1215

APEX LABS COOLER RECEIPT FORM

Client: Apex Co Element WO#: A5 L1200Project/Project #: Eastwood Elementary School 25012385/0001

Delivery Info:

Date/time received: 11/26/15 @ 1120 By: AMDelivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒Cooler Inspection Date/time inspected: 11/26/15 @ 1401 By: AMWChain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>19.2</u>						
Custody seals? (Y/N)	<u>N</u>						
Received on ice? (Y/N)	<u>N</u>						
Temp. blanks? (Y/N)	<u>V</u>						
Ice type: (Gel/Real/Other)	<u>None</u>						
Condition (In/Out):	<u>Out</u>						

Cooler out of temp? ☒ (Y/N) Possible reason why: Drinking WatersGreen dots applied to out of temperature samples? Yes ☒ No ☐Out of temperature samples form initiated? Yes ☒ No ☐Sample Inspection: Date/time inspected: 12-4-25 @ 1345 By: JAAll samples intact? Yes ☒ No ☐ Comments: _____Bottle labels/COCs agree? Yes ☒ No ☐ Comments: _____COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: _____Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments: _____

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A25G112

Comments: _____

Labeled by: JAWitness: AMWCooler Inspected by: JA

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Thursday, January 22, 2026

Dale Voeller

Apex Companies, LLC - Portland
4412 S Corbett Ave
Portland, OR 97239

RE: A6A1293 - Hillsboro School District - Eastwood Elementary School/25012835

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A6A1293, which was received by the laboratory on 1/12/2026 at 11:50:00AM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information

Acceptable Receipt Temperature is less than, or equal to, 6 degC (not frozen), or received on ice the same day as sampling.

(See Cooler Receipt Form for details)

Default Cooler 19.0 degC

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1293 - 01 22 26 1220

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22390505-004DW26A	A6A1293-01	Drinking Water	01/08/26 00:00	01/12/26 11:50
22390505-005DW26A	A6A1293-02	Drinking Water	01/08/26 00:00	01/12/26 11:50

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1293 - 01 22 26 1220

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22390505-004DW26A (A6A1293-01)				Matrix: Drinking Water				
Batch: 26A0326								
Lead	ND	---	0.200	ug/L	1	01/15/26 16:20	EPA 200.8	
22390505-005DW26A (A6A1293-02)				Matrix: Drinking Water				
Batch: 26A0326								
Lead	ND	---	0.200	ug/L	1	01/15/26 16:21	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A6A1293 - 01 22 26 1220

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 26A0326 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (26A0326-BLK1)		Prepared: 01/13/26 10:07 Analyzed: 01/15/26 16:10										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (26A0326-BS1)		Prepared: 01/13/26 10:07 Analyzed: 01/15/26 16:12										
EPA 200.8												
Lead	14.7	---	0.201	ug/L	1	15.0	---	98	85 - 115%	---	---	

No Client related Batch QC samples analyzed for this batch. See notes page for more information.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**

Project Manager: **Dale Voeller**

Report ID:

A6A1293 - 01 22 26 1220

SAMPLE PREPARATION INFORMATION

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Prep: EPA 200.8 Direct Analysis

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
<u>Batch: 26A0326</u>							
A6A1293-01	Drinking Water	EPA 200.8	01/08/26 00:00	01/13/26 10:07	10mL/10mL	10mL/10mL	1.00
A6A1293-02	Drinking Water	EPA 200.8	01/08/26 00:00	01/13/26 10:07	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1293 - 01 22 26 1220

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

There are No Qualifiers on Sample or QC Data for this report

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A6A1293 - 01 22 26 1220

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting and Detection Limits: Default Limits

Default Reporting and Detection Limits are based on 100% dry weight with the minimum dilution for the analysis. Reporting and Detection Limits are raised due to moisture content, additional dilutions required for analysis, matrix interferences and in other cases, as necessary.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or "" (blank) designation.

"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.

"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.

" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1293 - 01 22 26 1220

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to one half of the Reporting Limit (RL).

Blank results for gravimetric analyses are evaluated to the Reporting Level, not to half of the Reporting Level.

-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.

-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.

For further details, please request a copy of this document.

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Benzofluoranthene Isomer Reporting:

Due to coelutions present on the analytical column, the results reported for Benzo(b+j)fluoranthene(s) represent the concentration of both the Benzo(b)fluoranthene and Benzo(j)fluoranthene isomers. Calibration, validation and accreditation are based on the Benzo(b)fluoranthene isomer.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: **Eastwood Elementary School**
Project Manager: **Dale Voeller**

Report ID:

A6A1293 - 01 22 26 1220

Decanted Samples:

Soils/Sediments:

Unless TCLP analysis is required or there is notification otherwise for a specific project, all Soil and Sediments containing excess water are decanted prior to analysis in order to provide the most representative sample for analysis.

Water Samples:

Water samples containing solids and sediment may need to be decanted in order to eliminate these particulates from the water extractions. In the case of organics extractions, a solvent rinse of the container will not be performed.

Volatiles Soils (5035s)

Samples that are field preserved by 5035 for volatiles are dry weight corrected using the same dry weight correction as for normal analyses.

In the case of decanted samples, the dry weight may be performed on a decanted sample, while the aliquot for 5035 may not have been treated the same way. If this is a concern, please submit separate containers for dry weight analysis for volatiles can be provided.

All samples decanted in the laboratory are noted in this report with the DCNT qualifier indicating the sample was decanted.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave
Portland, OR 97239

Project: **Hillsboro School District**

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1293 - 01 22 26 1220

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
--------	----------	--------	---------	--------	---------------

All reported analytes are included in Apex Laboratories' current ORELAP scope.

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary Scho

Project Manager: Dale Voeller

Report ID:

A6A1293 - 01 22 26 1220

Lead in Drinking Water Testing Program

Date Collected: 01/08/2026

PBS Project: ~~25012385~~ / 0001

School Name: Eastwood Elementary School

25012385/0001

Building: Modular Classroom Building - Round 2

Building Number: 22390505

Analysis Requested: Lead (Pb) in Drinking Water

Email Results To: voeller@pbsusa.com

Turnaround Time: 10-day

	Fixture Number	Sample Number	Location / Description
1	004	22390505-004DW26A	Drinking fountain at restroom - left
2	005	22390505-005DW26A	Drinking fountain at restroom - right
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

Relinquished By/Signature: Dale Voeller

Date/Time: 1/10/26 3:38 PM

Received By/Signature: [Signature]

Date/Time: 1/12/26 11:50

1 of 1

Apex Laboratories

[Signature]

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

Apex Companies, LLC - Portland

4412 S Corbett Ave

Portland, OR 97239

Project: Hillsboro School District

Project Number: Eastwood Elementary School

Project Manager: Dale Voeller

Report ID:

A6A1293 - 01 22 26 1220

APEX LABS COOLER RECEIPT FORM

Client: Apex Co. Element WO#: A6A1293Project/Project #: Eastwood Elementary School / 25012835/0001

Delivery Info:

Date/time received: 1/12/26 @ 11:50 By: AJMDelivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Radio ☐ Morgan ☐ SDS ☐ Evergreen ☐ Other ☐From USDA Regulated Origin? Yes ☐ No ☒Cooler Inspection Date/time inspected: 1/12/26 @ 14:04 By: AJMChain of Custody included? Yes ☒ No ☐Signed/dated by client? Yes ☒ No ☐Contains USDA Reg. Soils? Yes ☐ No ☒ Unsure (email RegSoils) ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>19.0</u>						
Custody seals? (Y/N)	<u>N</u>						
Received on ice? (Y/N)	<u>N</u>						
Temp. blanks? (Y/N)	<u>N</u>						
Ice type: (Gel/Real/Other)	<u>None</u>						
Condition (In/Out)	<u>Out</u>						

Cooler out of temp? (Y/N) Possible reason why: Drinking WatersGreen dots applied to out of temperature samples? Yes ☒ No ☐Out of temperature samples form initiated? Yes ☒ No ☐Sample Inspection: Date/time inspected: 1/12/26 @ 17:38 By: KNAll samples intact? Yes ☒ No ☐ Comments: _____Bottle labels/COCs agree? Yes ☒ No ☐ Comments: _____COC/container discrepancies form initiated? Yes ☐ No ☒Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: _____Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments: _____

Water samples: pH checked: Yes ☒ No ☐ NA ☒ pH appropriate? Yes ☒ No ☐ NA ☐ pH ID: A256271

Comments: _____

Labeled by:

KN

Witness:

JA

Cooler Inspected by:

WAM

Form Y-003 R-02

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document(s) and updated by any subsequent written communications. This analytical report must be reproduced in its entirety.